
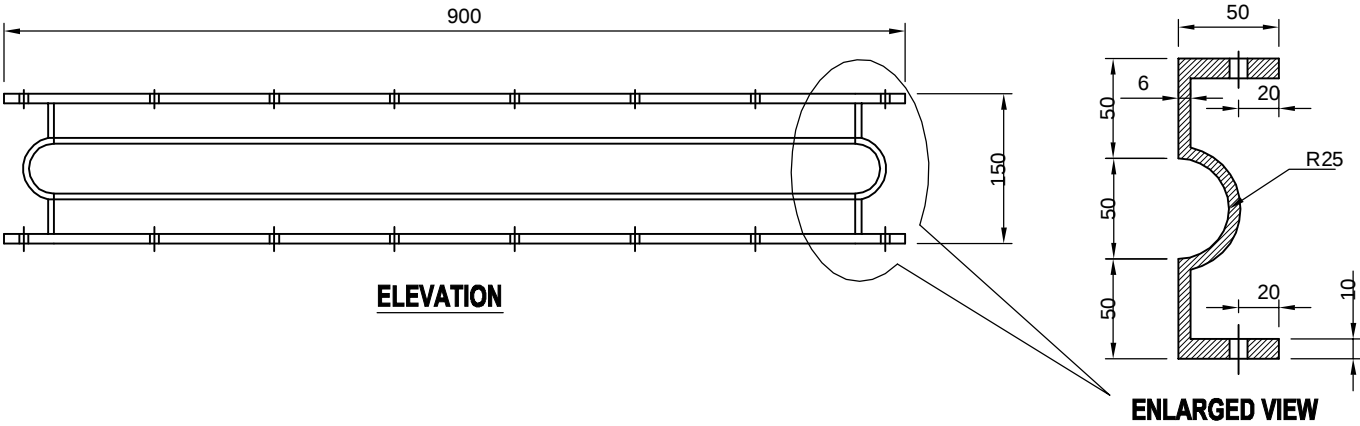





The contents of this Drawing are the sole property of C & S ELECTRIC LIMITED and they should neither be copied nor given to a third person without the prior permission of Company.

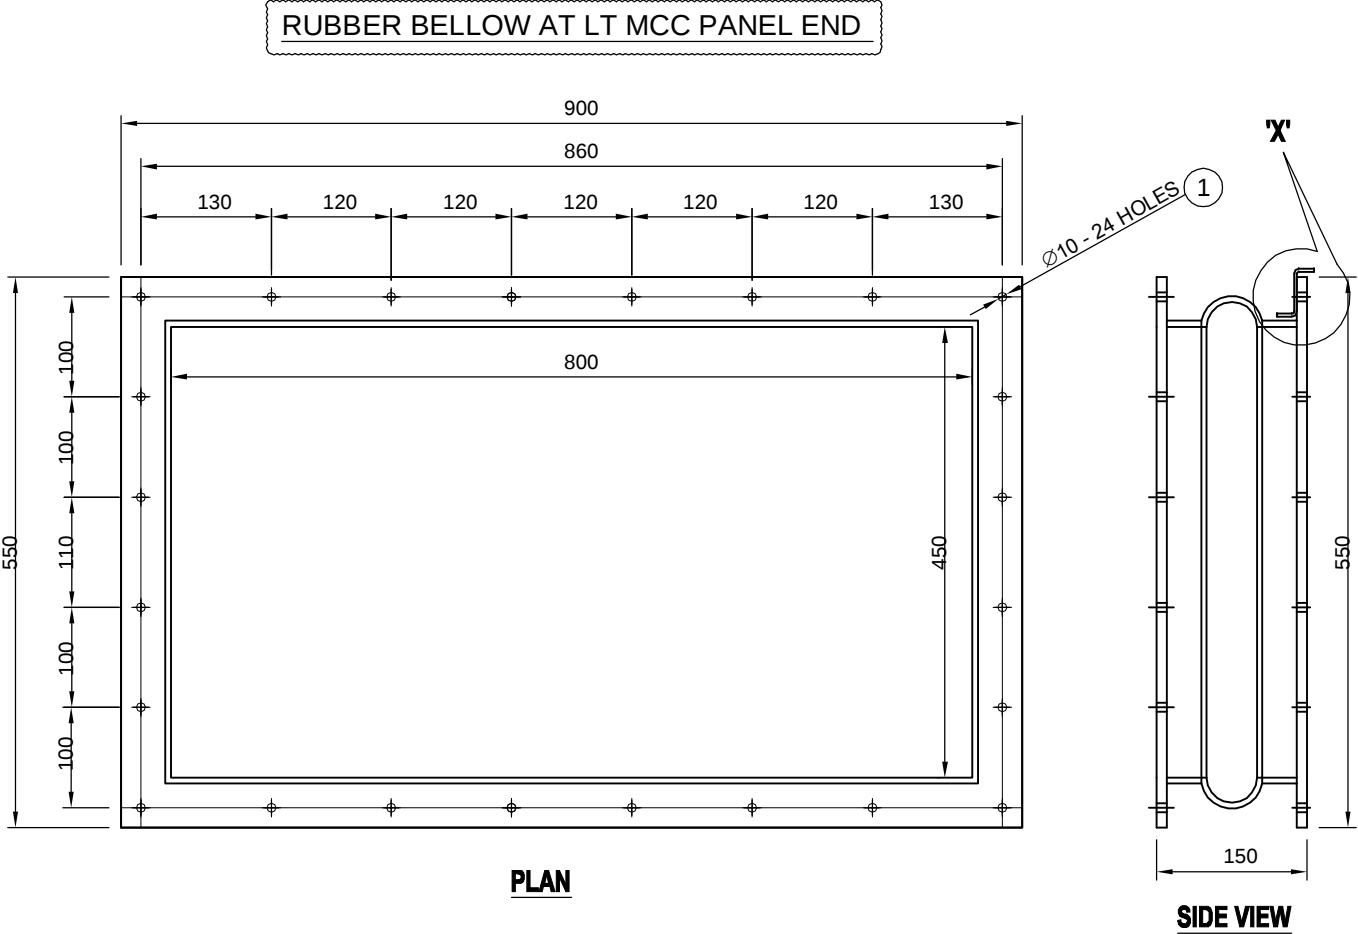

ITEM NO.	NAME OF ITEM	DESCRIPTION	QTY.	MATERIAL
1.	HEX. BOLT	M8x40+1N+2PW+1SW	24 SETS	MS. Zn. ELECTRO PLATED

TECHNICAL SPECIFICATION:-

1. MATERIAL	: EPDM
2. HARDNESS	: 40 TO 50 SHORE
3. ELONGATION AT BREAK	: 600% ~ 700%
4. TENSILE STRENGTH BEFORE AGEING	: 60 ~ 80 BAR
5. AGEING TEST	: AT 105 °C FOR 7 DAYS
6. RESISTANCE TO SHEARING	: 22 DA N/CM
7. INSULATION RESISTANCE	: 50 MEGA OHMS (WITH 1000V)

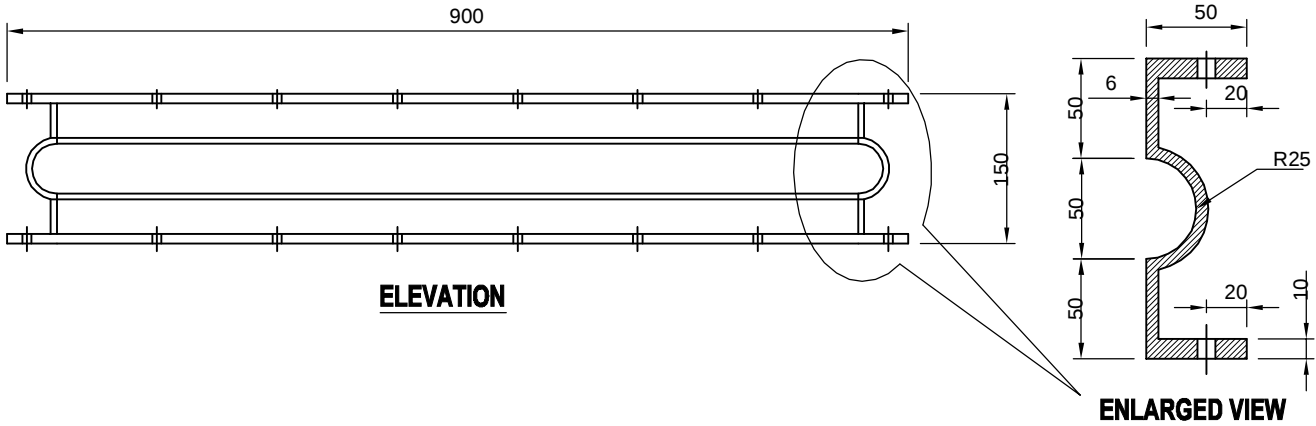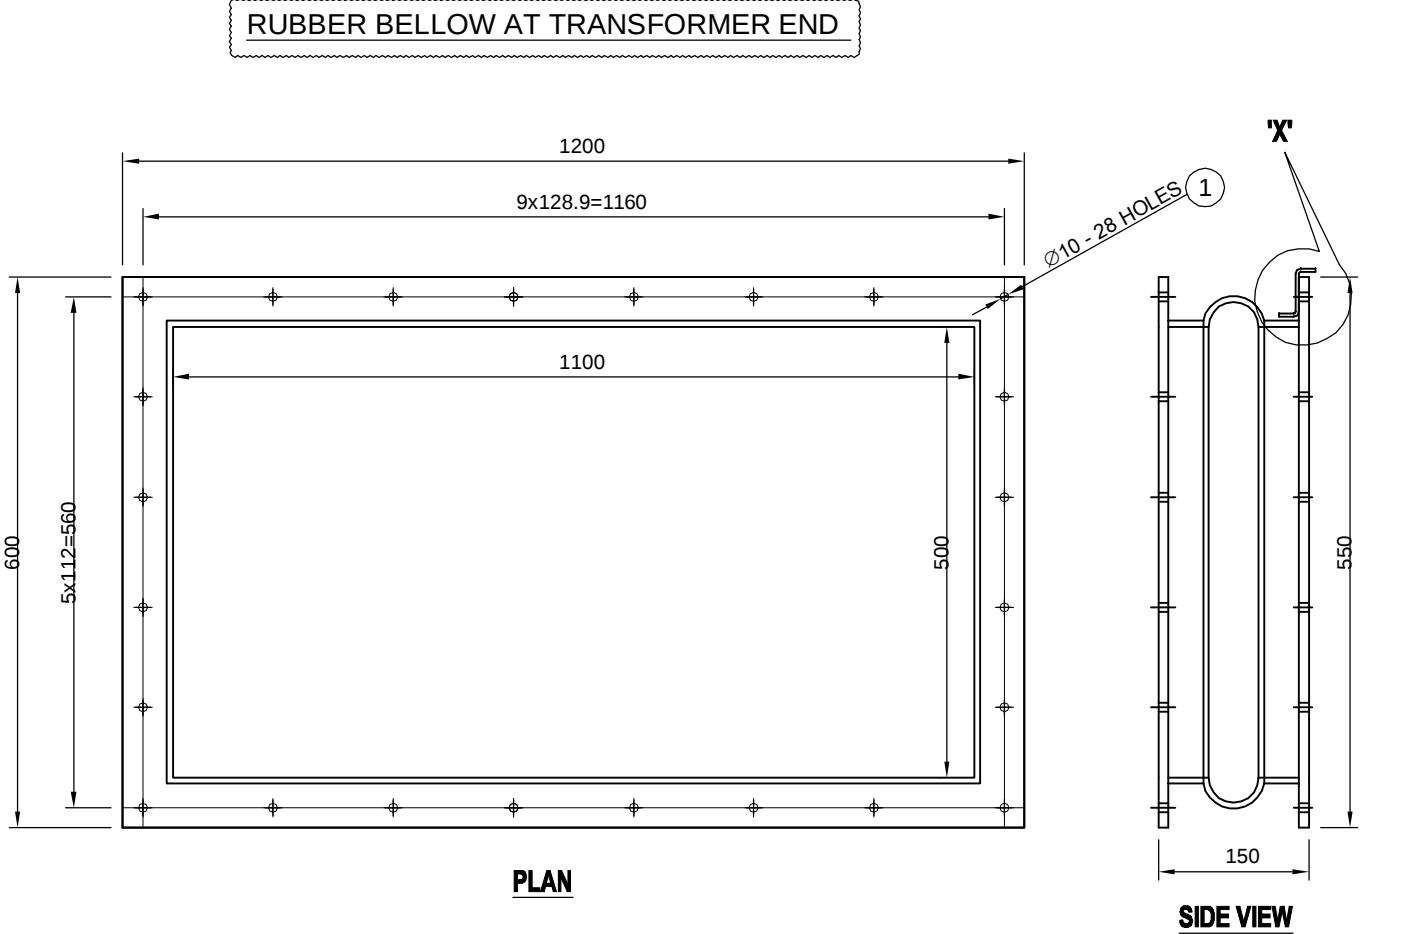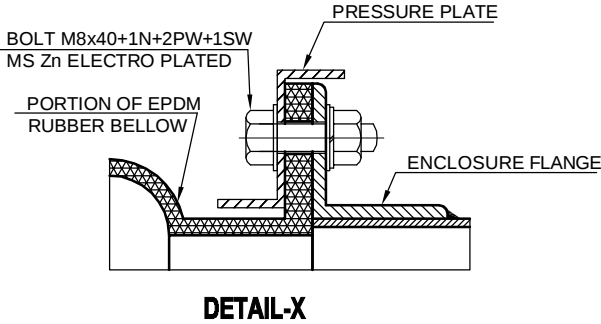

BHARAT HEAVY ELECTRICALS LIMITED
INDUSTRIAL SYSTEMS GROUP, BANGALORE



C&S Electric Ltd.
BUSDUCT DIVISION

CUSTOMER	M/s. BHEL - BANGALORE	PROJECT	KARNATAKA POWER CORPORATION LTD, BELLARY TPS, UNIT-3 1x700MW
DRG. TITLE	STANDARD RUBBER BELLOW DETAILS FOR 415V, NSPBD		
M.G.HARIHARAN	MGH	PSK / KJ	N.T.S.
DRN. BY	CHKD. BY	APPD. BY	SCALE
DATE : 14.03.15		REV. 01	SHEET NO. : 08 OF 16
		A3	