




FIRST ANGLE PROJECTION

ALL DIMENSIONS ARE IN mm.

REV 00

3 983 14 01216WB

DRG No.

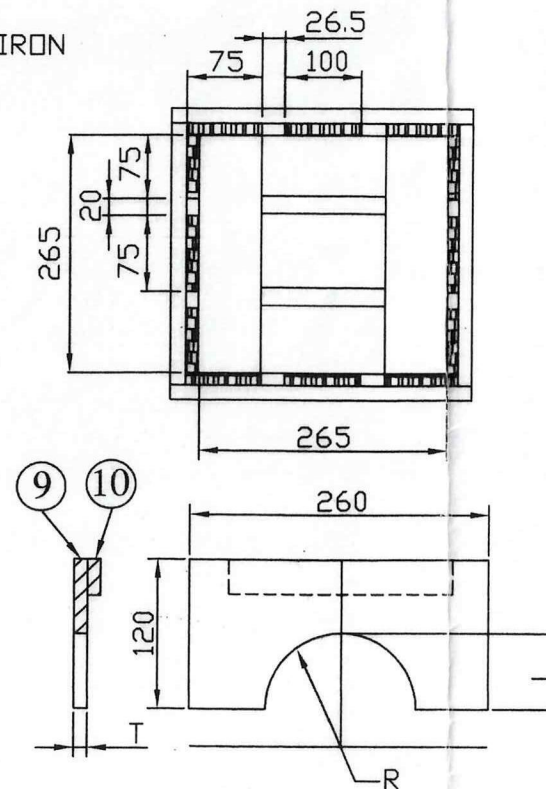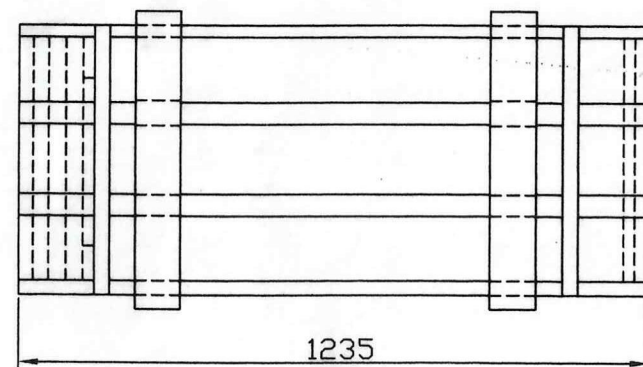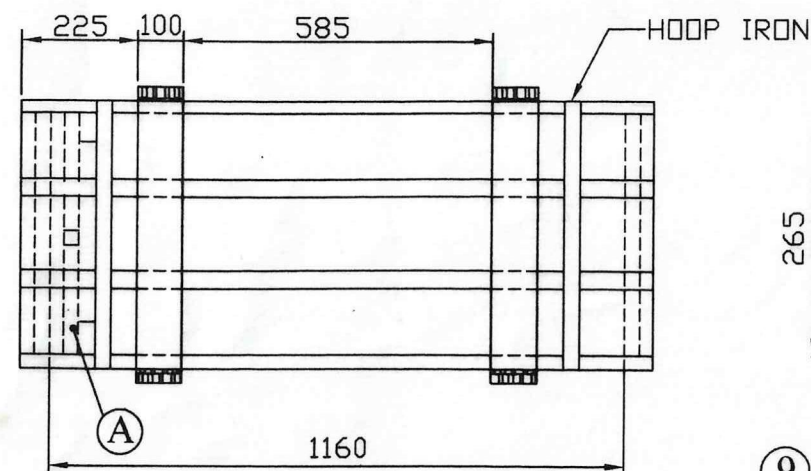

NOTES:


- * MATERIAL : WOOD AS PER GROUP I OR II OF IS:6662-1993.
- ALL JOINTS SHOULD BE SECURED BY ADEQUATE NUMBERS OF WIRE NAILS OF ($\phi 2 \times 40L$) CONFORMING TO IS:723-1972
- DIMENSIONS INDICATED REFER TO POST SHRINKAGE STAGE. DUE PROVISION FOR SHRINKAGE OF PLANKS SHOULD BE MADE BY THE VENDOR WHILE CUTTING SHOOKS.
- BAND = HOOP IRON OF 19mm WIDTH, 26 GAUGE, BLUE FINISH
- ENDS SHOULD BE PROVIDED WITH SUITABLE PACKING MATERIALS WHILE PACKING "INSULATOR WITHOUT METAL PARTS"
- SUPPORT AT 'A' SHOULD BE FIXED TO THE BOX ONLY AT THE TIME OF PACKING THE INSULATOR IN THE BOX
- VOLUME OF THE WOOD REQUIRED FOR ONE BOX = 0.0323 cu.meter
= (1.1440 cu.feet)
- LATERAL MOVEMENT OF INSULATOR SHOULD BE ARRESTED USING SUITABLE PACKING MATERIAL AT THE ENDS
- INSULATOR SHOULD BE SUPPLIED IN SET OF TOP, MIDDLE AND BOTTOM PIECES.
- TOP, MIDDLE & BOTTOM PIECES SHOULD BE MARKED WITH SET NUMBERS.
- FUMIGATION SHOULD BE DONE.**

CONTROLLED COPY

10	REINFORCEMENT PLANK	220x50x19	"		2
9	SUPPORT PLANK	260x120x19	"		2
8	SIDE PLANK	265x75x19	"		6
7	REINFORCEMENT PLANK	265x75x19	"		4
6	BATTEN	303x100x19	"		4
5	BATTEN	341x100x19	"		4
4	STAY PLANK	1235x75x19	"		2
3	STAY PLANK	1235x75x19	"		4
2	STAY PLANK	1235x100x19	"		2
1	STAY PLANK	1235x75x19	"		4
ITEM NO.	DESCRIPTION	PLANK SIZE	* MATERIAL	UNIT Wt.	QUANTITY

SUPPORT PLANKS	R	L	T
A	52	39.5	19

FOR EXPORT ORDER

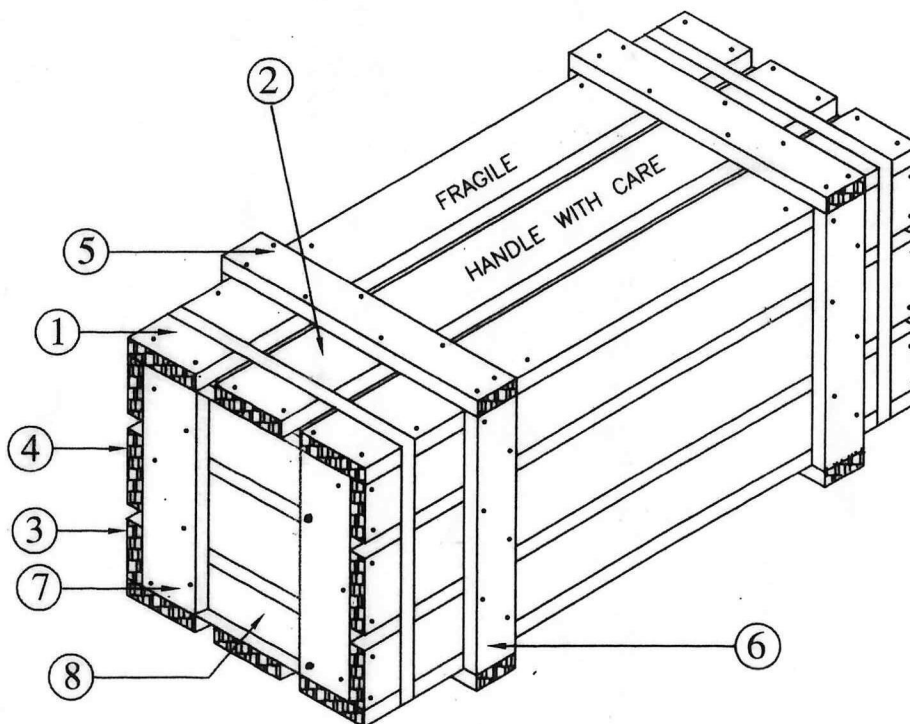

REV	DATE	ALTERED	REV	DATE	ALTERED	REV	DATE	ALTERED	DEPT	GRADE OF	SCALE	WEIGHT (kg)	REF TO ASSY.DRG	ITEM No.	No. OF ITEMS
		CHECKED			CHECKED			CHECKED	CODE	TOL DIM	N.T.S	--			
										C/M/F		(Approx)			
TITLE										CARD CODE		DRAWING No.			REV.
WOODEN BOX												3 983 14 01216WB			00
(FOR TOP PIECE)												No. OF SHEETS			