
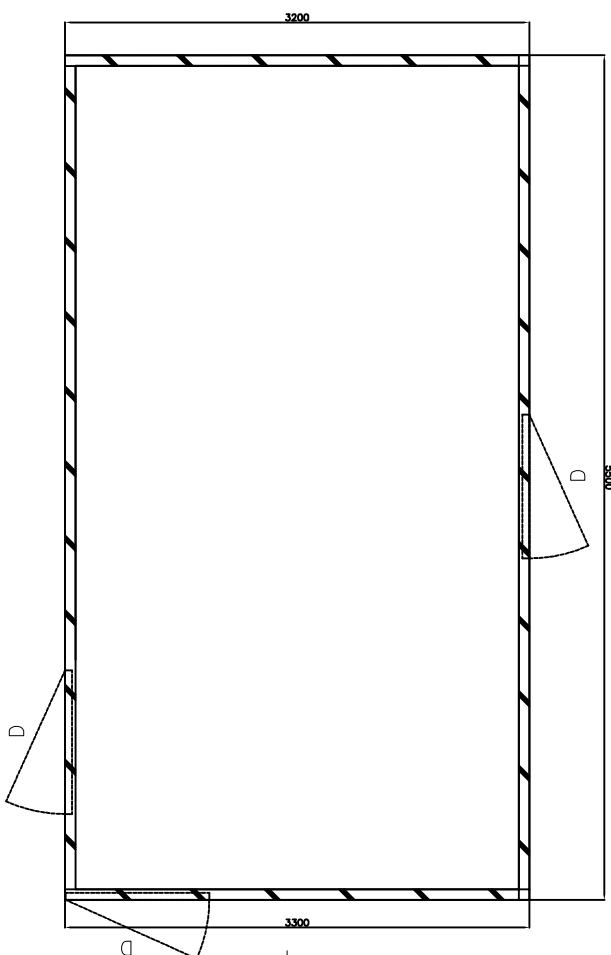
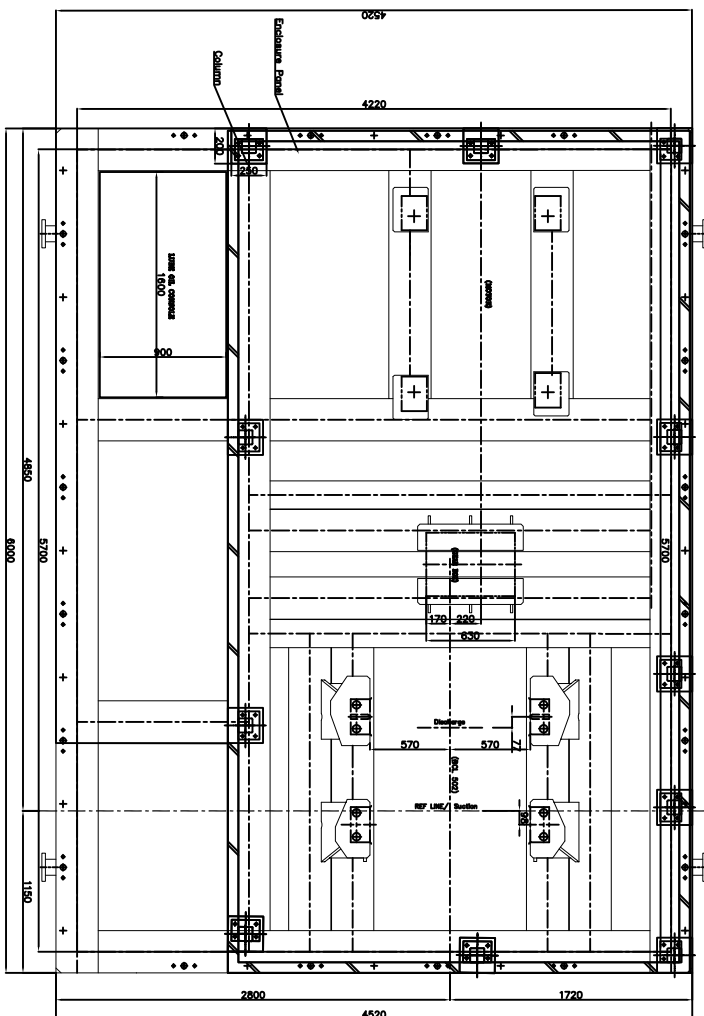


GENERAL DIMENSIONAL LIMITS, FITS & TOLERANCES AS PER HY0230261

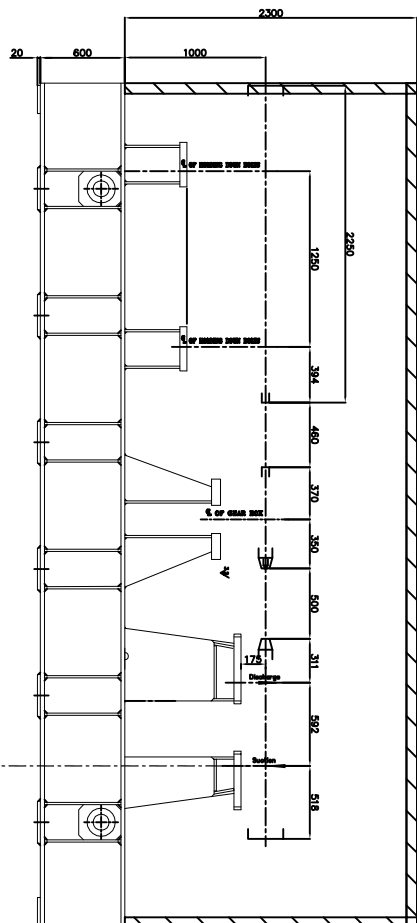

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE NOTED & EXTERNAL ONLY.
2. OPENINGS ARE TO BE CUT AFTER MEASURING THE DIMENSIONS AT SITE AND PROPER SEALING TO BE PROVIDED.
3. DOORS SHALL BE HINGED TYPE AND LOCATION TO BE FIXED AFTER CONSULTING WITH CUSTOMER/ELECTION AGENCY AT BHIL HD. NO OF DOORS SHALL BE 3-4 NOS DEPENDING ON FINAL REQUIREMENT. HEAT RADIATED THROUGH THE TURBINE : 45.0 KW.
5. MATERIAL CODE : TC97643272249
6. Doors shall open inside.
7. Height of the enclosure is 2300 mm.
8. Noise insertion loss shall be considered as 10dB(o).
9. Door, Silencer and fan location shall be finalised post PO placement.

[illegible]