

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-I007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 1	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)

350

GENERAL*	* PROJECT	4X270 MW BHADRADRI TPS	
	OFFER REFERENCE		
	* TAG NO. SERVICE		
	* DUTY	☒ ON / OFF REQUIRED ☒ INCHING (AS REQUIRED)	
	* LINE SIZE (inlet/outlet): MATERIAL		
	* VALVE TYPE	☐ GLOBE ☐ GATE ☐ REG. GLOBE ☐ BUTTERFLY	
	* OPENING / CLOSING TIME		
	* WORKING PRESSURE		
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%	
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY	
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY	
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY	
CONSTRUCTION AND SIZING	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL	
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.	
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.	
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 85% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING(REGULATING) SERVICE 150 STARTS/HR MINIMUM	
HANDWHEEL	* REQUIRED	☒ YES ☐ NO	
	* ORIENTATION	☐ TOP MOUNTED ☐ SIDE MOUNTED	
	TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.		
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY	
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY	
	MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT.	
	ACTUATOR APPLICABLE WIRING DIAGRAM	☒ ENCLOSED (BIDDER TO CONFIRM) A: ☒ DRG. NO. 3-V-MISC-24227 R00 B: ☐ DRG. NO. 3-V-MISC-24550 R00 C: ☐ DRG. NO. 3-V-MISC-24283 R00 D: ☐ DRG. NO. 4-V-MISC-90271 R11	
	COLOUR SHADE	☒ BLUE (RAL 5012) ENAMEL ☐	
	SHAFT RPM	BIDDER TO SPECIFY	
	OLR SET VALUE	BIDDER TO SPECIFY	
	STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY	
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY	
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC	
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED INTERNALLY	
	@ ENCLOSURE CLASS OF MOTOR	☐ IP 65 ☒ IP 67 ☐ FLAME PROOF ☐ IP 55, TOTALLY ENCL, SELF VENTILATED.	
	@ INSULATION CLASS	☐ CLASS-B ☒ CLASS-F (TEMP. RISE LIMITED TO CLASS B)	
	@ WINDING TEMP PROTECTION	☒ THERMOSTAT (3 Nos., 1 IN EACH PHASE) ☐	

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-I007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 2	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)		DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	

350

	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	☒ REQUIRED ☐ NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	☒ CONTACTORS ☐ THYRISTORS	
	TYPE	☒ CONVENTIONAL ☐ SMART (NON-INTRUSIVE)	
	STEP DOWN CONT. TRANSFORMER	☒ REQUIRED	
	OPEN / CLOSE PB	☒ REQUIRED ☐ NOT REQUIRED	
	STOP PB	☒ REQUIRED ☐ NOT REQUIRED	
	INDICATING LAMPS	☒ REQUIRED ☐ NOT REQUIRED	
	LOCAL REMOTE S/S	☒ REQUIRED ☐ NOT REQUIRED	
	STATUS CONTACTS FOR MONITORING	☒ REQUIRED ☐ NOT REQUIRED	
		INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT./POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)
INTERPOSING RELAY (Applicable for integral Starter)	INTERPOSING RELAYS	REQUIRED	
	INTERPOSING RELAY (QUANTITY)	☐ 2 NOS. ☒ 3 NOS.	
	DRIVING VOLTAGE	☒ 20.5 – 24V DC ☐ _____ V DC	
	DRIVING CURRENT	☒ 125mA MAX ☐ _____ mA MAX	
	LOAD RESISTANCE	☒ > 192 ohms - <25 k ohms ☐ > _____ ohms - < _____ ohms	
TORQUE SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	☒ 1 No. ☐ 2Nos. / ☒ 1 No. ☐ 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	☒ 1 No ☐ 2 Nos.	2 Nos. (ADJ.) ☒ 1 No. ☐ 2Nos.
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-I007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 3	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)

350

POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty)	☒ REQUIRED ☐ NOT REQUIRED		
	MFR & MODEL NO.	BIDDER TO SPECIFY		
	TYPE	☒ ELECTRONIC (2 WIRE) R/I CONVERTER ☐ ELECTRONIC (2 WIRE) CONTACTLESS		
	SUPPLY	☒ 24V DC ☐		
	OUTPUT	☒ 4-20mA		
	ACCURACY	$\pm 1\%$ FS		
SPACE HEATER	@SPACE HEATER	REQUIRED		
	@ POWER SUPPLY			
	@ RATING	415v, 3PH, AC FOR RATING > 0.2KW; SINGLE PHASE FOR RATING < 0.2KW		
TERMINAL BOX	MOTOR TERMINAL BOX	REQUIRED		
	ACTUATOR TERMINAL BOX	REQUIRED		
	ENCL CLASS MTR T.B. / ACTUATOR T.B.	@ ☒ IP 67 @ ☐	☒ IP67 ☐	
	@ EARTHING TERMINAL	REQUIRED		
	PLUG & SOCKET(9 PIN) (FOR COMM, LS/TS FEED BACK, PoT)	☐ REQUIRED ☒ NOT REQUIRED ☐ 2 NOS. ☐		
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:--DURING DETAIL ENGINEERING		
	@ SPACE HEATER CABLE GLAND	SIZE: 2C x 2.5 sq. mm		
	OTHER CONTROL CABLE GLANDS-1	INSTRUMENT CABLE SIZE FOR ON/OFF DUTY VALVES SHALL BE 8PX0.5 SQMM - ONE CABLE GLAND OF OD SIZE 20 MM. INSTRUMENT CABLE SIZE FOR INCHING DUTY TYPE VALVES SHALL HAVE TWO NO. CABLES (ONE NO. 8PX0.5 SQMM AND 2ND 2PX0.5 SQMM) - TWO NO. GLANDS OF OD SIZES 20 MM & 15 MM.		
	OTHER CONTROL CABLE GLANDS-2			
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY		_____ Kg.


NOTES:

- SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
- CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH:
IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
- TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
- CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED.
- THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
- THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
- THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.

NOTES* = TO BE FILLED BY MPL (LEAD AGENCY), @ = TO BE FILLED BY ES

3-V-MISC-24227

DRAWING NO.

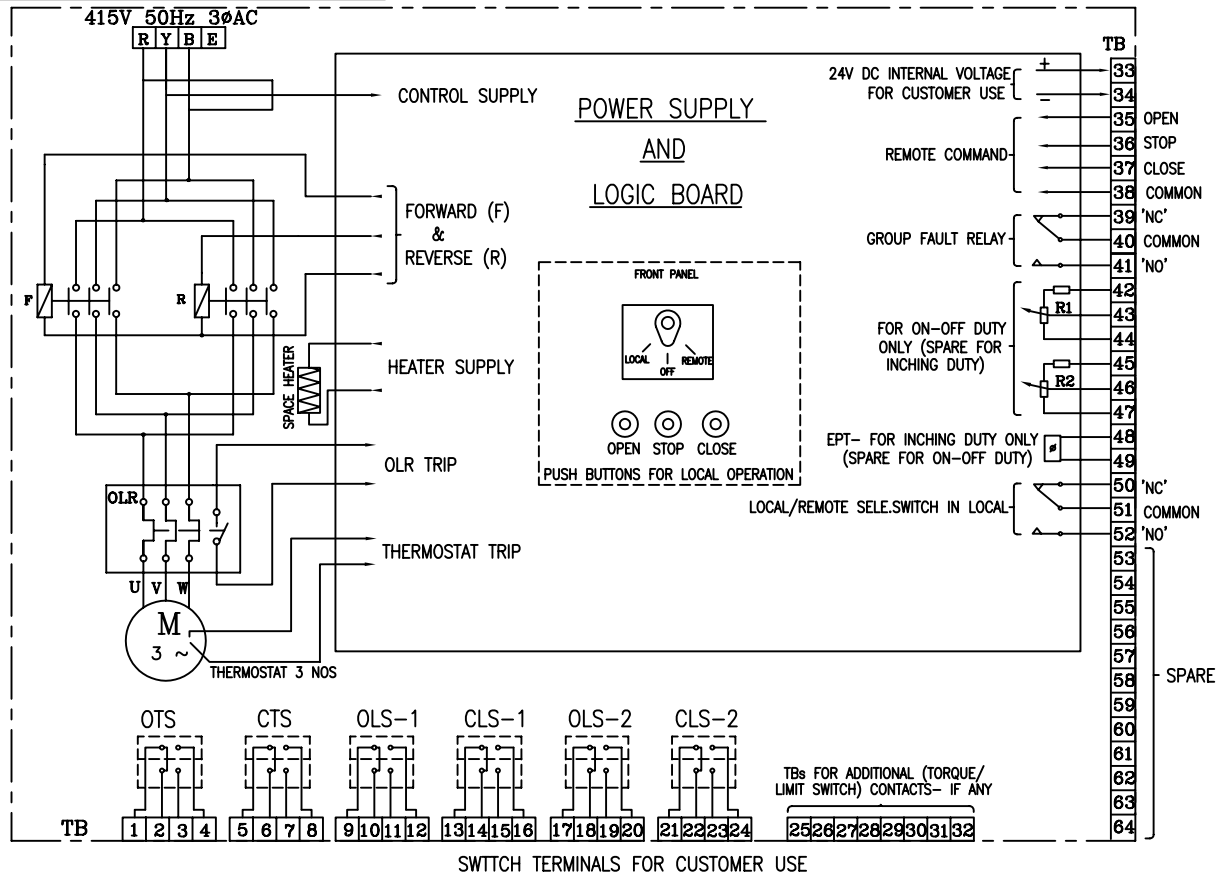

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL					
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL					
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL					
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL					
OLS-1	9-10						
	11-12						
CLS-1	13-14						
	15-16						
OLS-2	17-18						
	19-20						
CLS-2	21-22						
	23-24						
SWITCH	TERMINAL NO.	FULL OPEN	a	INTERMEDIATE		b	FULL CLOSE
		VALVE POSITION					
		INDICATES CONTACT CLOSED					
		INDICATES CONTACT OPEN					
CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC							

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#
# - CLS NOT TO BE CONNECTED IN TRIP CIRCUIT				
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)				

NOTE:-

- ALL TORQUE AND LIMIT SWITCHES (OTS, CTS, OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
- CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
- OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
- OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
- CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
- EPT - ELECTRONIC POSITION TRANSMITTER (Contactless, FOR INCHING DUTY)
- R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
- FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
- M - MOTOR 3Φ 415V 50 Hz AC SUPPLY

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS OR NAME OF CUSTOMER/PROJECT (DRAWN FOR INTERMEDIATE POSITION OF VALVES)		DRN N.P.ESWAR		SIGN N.P	DATE 07.10.04	NO. OF VAR.
BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT. TIRUCHIRAPALLI-620014.		CHD D.DINAKARAN	D.D	07.10.04		
365-121		APPD K.ARUNACHALAM	K.A	07.10.04		
DEPT VL	SCALE	WEIGHT (KG).	REFERENCE INFORMATION			NO. OF ITEMS
CODE						
TITLE WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER		CARD CODE U 01	DRAWING NO. 3-V-MISC-24227			REV 0



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00


DATE : 19.03.2015

SHEET

OF

Drive Control Philosophy

PLC INTERFACE FOR BIDIRECTIONAL DRIVE(WITH INTEGRAL STARTER)

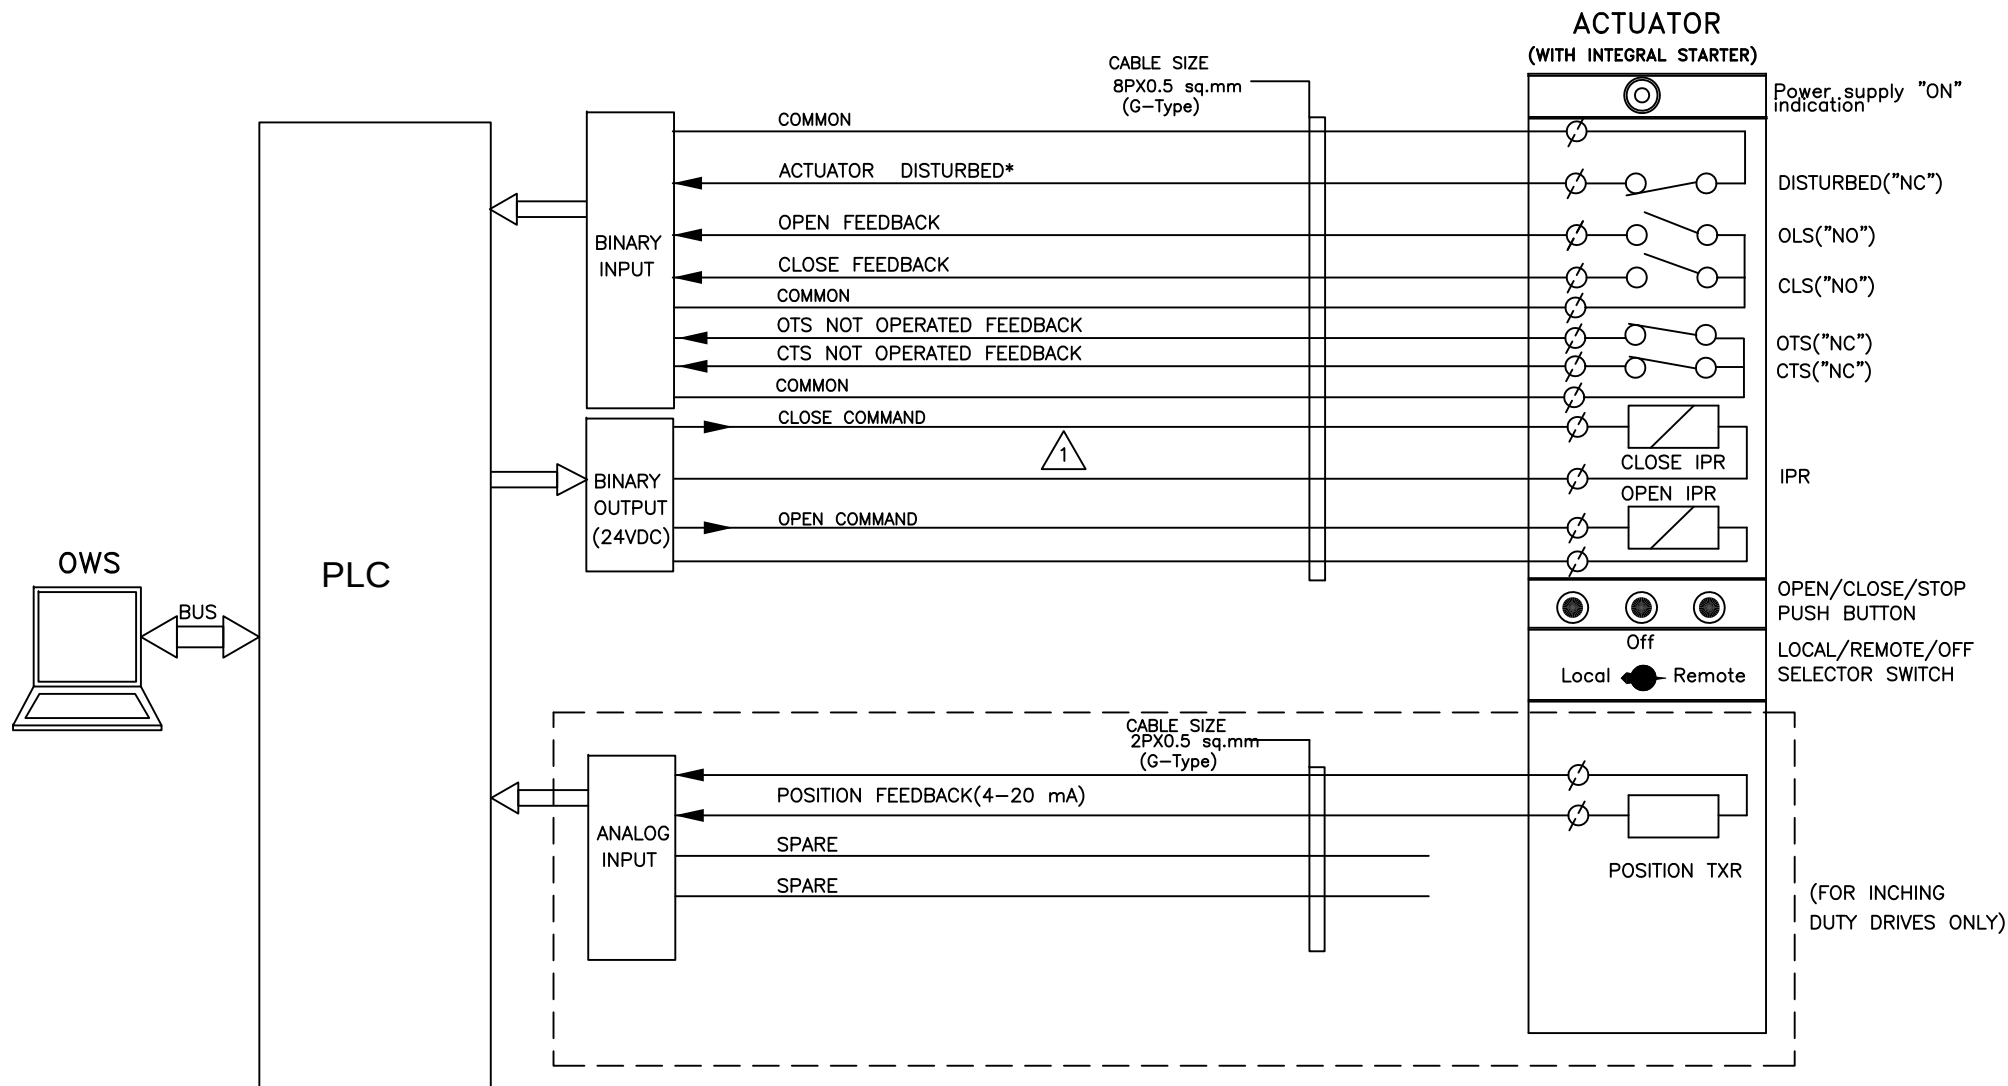

PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE
PLC INTERFACE FOR
BIDIRECTIONAL DRIVE


DRG.NO. PE-DM-411-145-I002

DATE 06.02.2015

REV.NO. 01

SHT 7 OF 11
Page 412 of 502

PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE

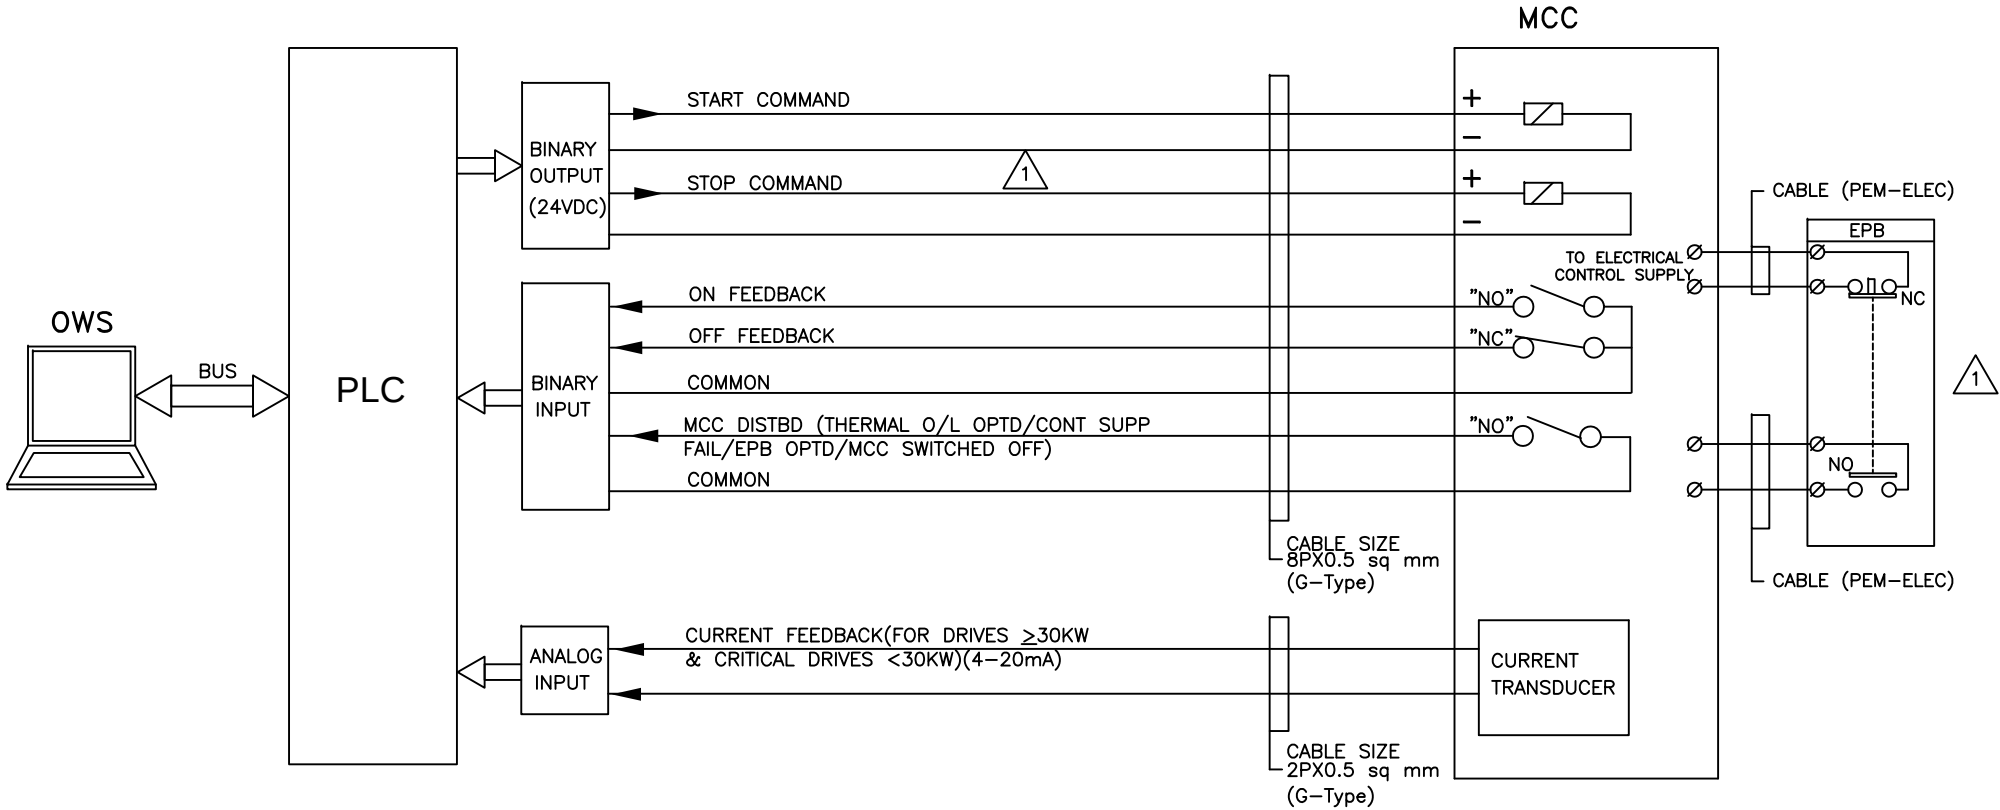

PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE
PLC INTERFACE FOR
UNIDIRECTIONAL LT DRIVE


DRG.NO. PE-DM-411-145-I002

DATE 06.02.2015

REV.NO. 01

SHT 8 OF 11
Page 413 of 502

PLC INTERFACE FOR SOLENOID DRIVE (24V DC / 240V AC UPS)

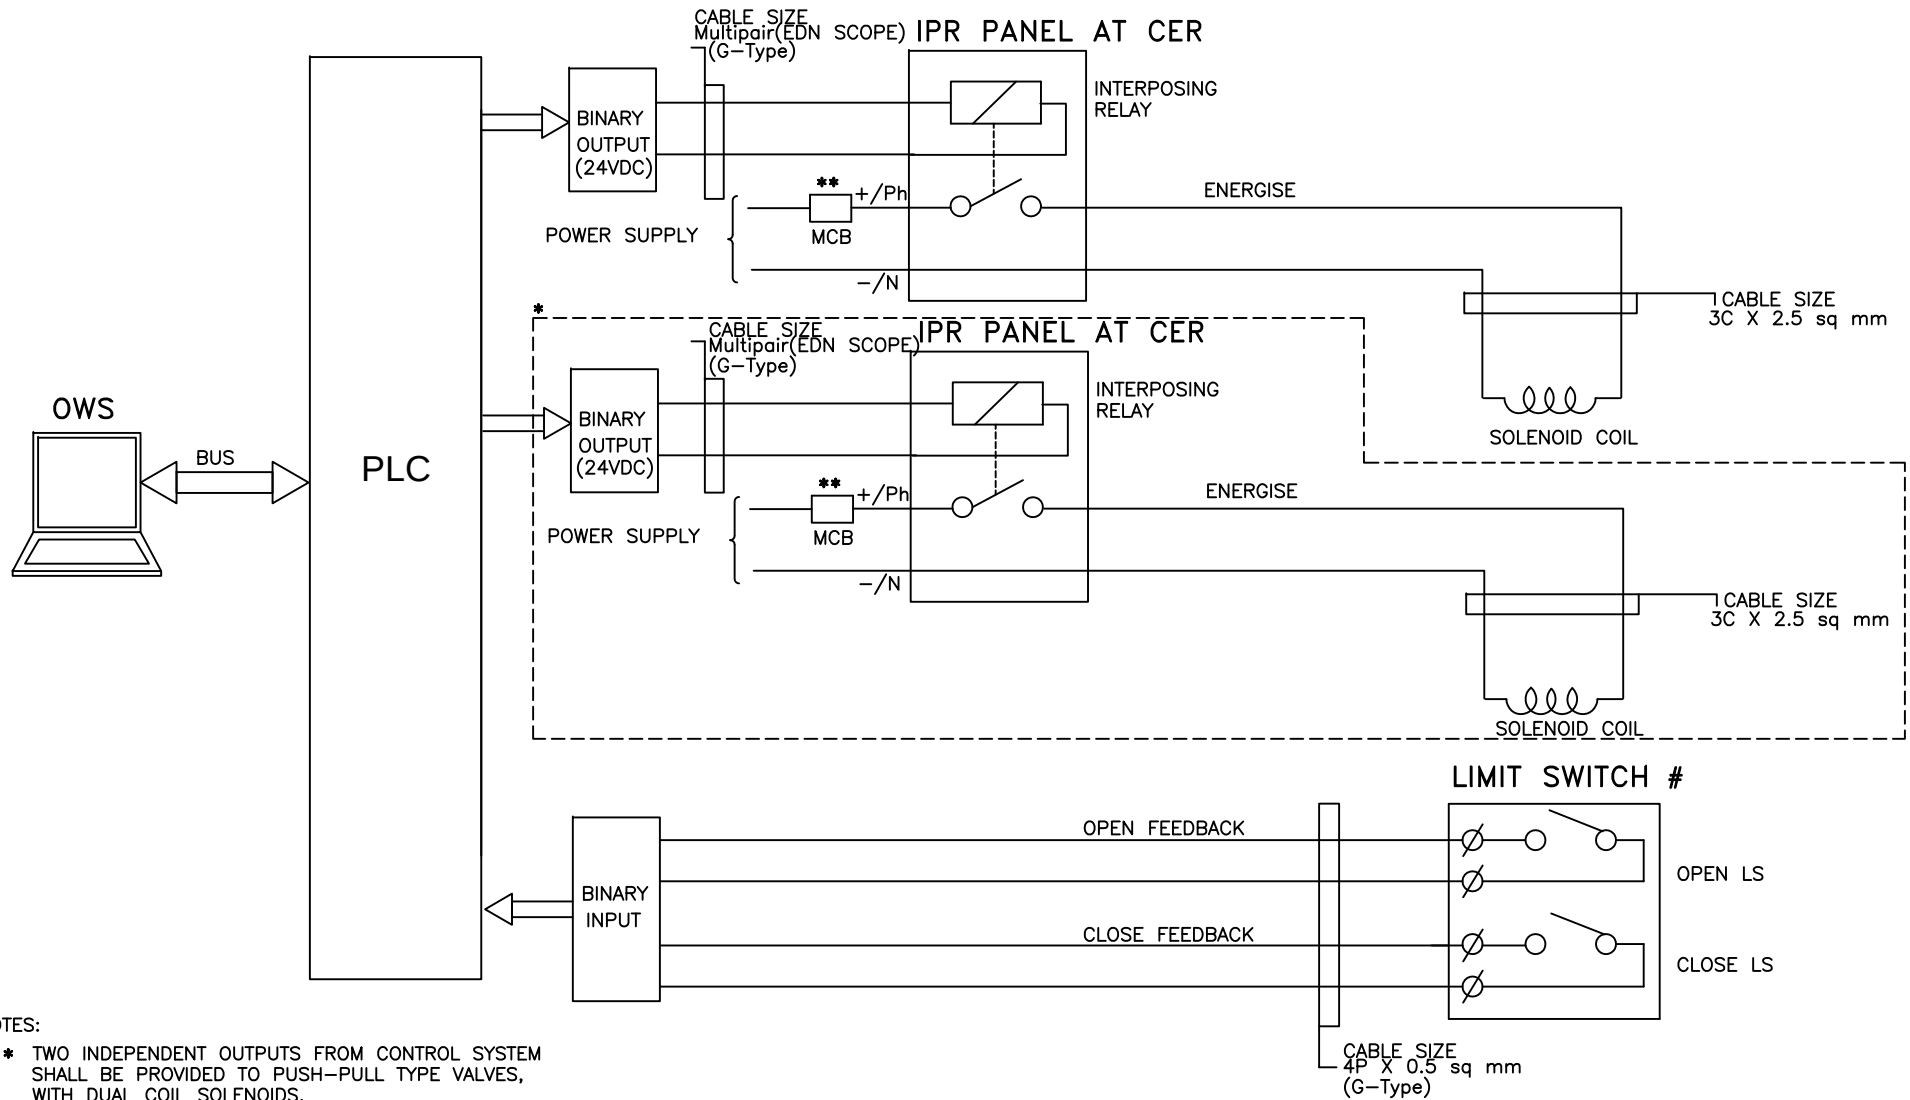

NOTES:

* TWO INDEPENDENT OUTPUTS FROM CONTROL SYSTEM SHALL BE PROVIDED TO PUSH-PULL TYPE VALVES, WITH DUAL COIL SOLENOIDS.

** MCB SHALL BE PROVIDED FOR EACH SOLENOID

FOR ON/OFF TYPE, SOLENOID ACTUATED CONTROL VALVE.



PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE **PLC INTERFACE FOR
SOLENOID DRIVE**


DRG.NO. **PE-DM-411-145-I002**

DATE 18.11.2014

REV.NO. 00

SHT 9 OF 11
Page 414 of 502

PLC INTERFACE FOR HT/LT UNIDIRECTIONAL DRIVES(BREAKER OPERATED)

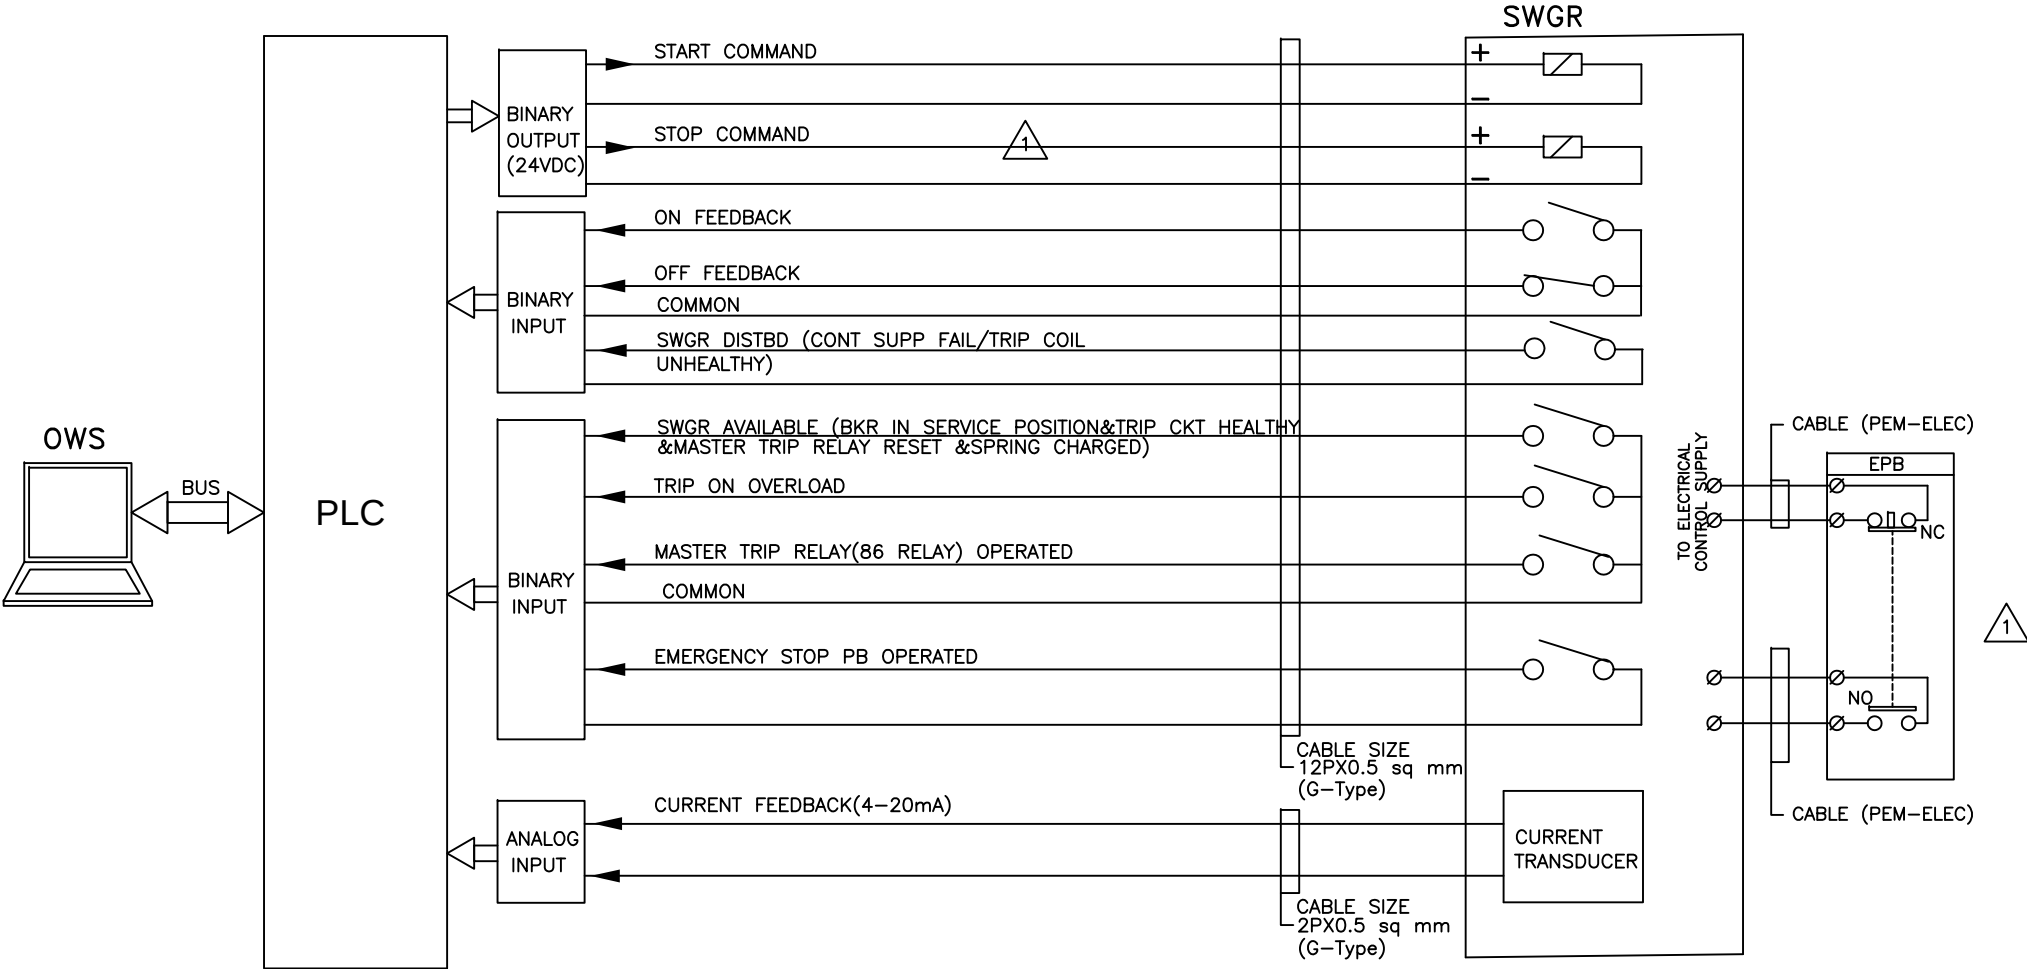

PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE
PLC INTERFACE FOR
UNIDIRECTIONAL HT DRIVE


DRG.NO. PE-DM-411-145-I002

DATE 06.02.2015

REV.NO. 01

SHT 10 OF 11
Page 415 of 502

PLC INTERFACE FOR ANALOG DRIVE

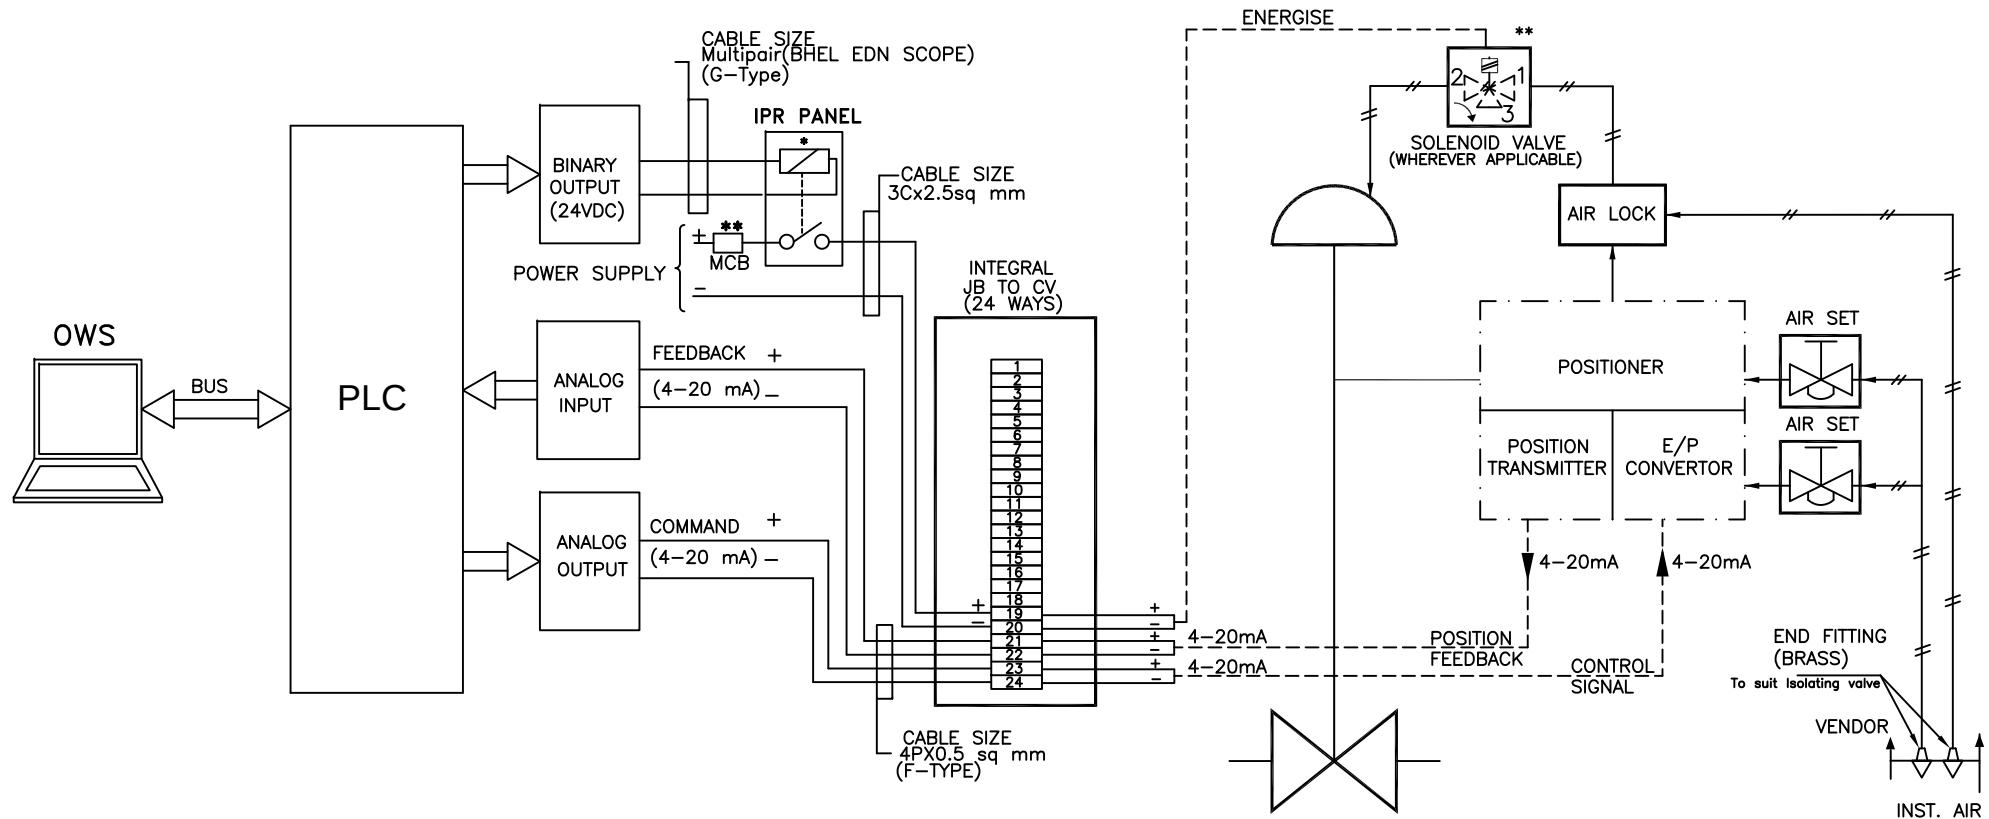

NOTES:

* APPLICABLE TO VALVES WHERE PROTECTION OPEN/CLOSE ACTION FOR CONTROL DEMAND OVERRIDING IS REQUIRED.

** MCB SHALL BE PROVIDED FOR EACH SOLENOID



PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE TYPICAL HOOK-UP DIAGRAM
ANALOG DRIVE(WITH SMART POSITIONER)

DRG.NO.	PE-DM-411-145-I002
DATE	18.11.2014
REV.NO.	00
SHT	11 OF 11 Page 416 of 502



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

UPS SCHEME



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

INSTRUMENTATION DATA SHEET

1.00.00 SPECIFICATION FOR ELECTRONIC TRANSMITTERS

1.01.00 PRESSURE TRANSMITTER

1. Working Principle : Smart (HART Compatible)
2. Type : Microprocessor based, 2 – Wire
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Measuring Element : Capsule / Diaphragm
5. Element material : SS-316 (Stainless Steel) or better
6. Static Pressure : 150 % of maximum span continuously, without affecting the calibration
7. Turn-down ratio : 100: 1
8. Span and Zero : Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10. Output Indicator : LCD (Integral indicator of 5 digit display)
11. Nameplate : Tag number, service engraved in SS tag plate
12. Body : SS
13. Operating Voltage : 24V DC
14. Load : 600 Ohms (min.) at 24 Volts D.C.
15. Ambient Temperature : 0 - 50 °C
16. Performance: :
 - i. Accuracy : $\pm 0.075\%$ of Span or better

- | | | |
|-----|-------------------------------------|--|
| ii. | Repeatability | ± 0.05% of Span or better |
| 17. | Sealing/Isolation | : Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications |
| 18. | Accessories | : <ul style="list-style-type: none"> a. Universal mounting bracket suitable for 2" pipe mounting b. High tensile carbon steel U-bolts c. Siphon for steam and hot water services d. ½" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock e. Companion flange with nuts, bolts and gaskets f. ½" NPT cable gland g. Handheld calibrator |
| 19. | Adjustment/Calibration/ Maintenance | : From handheld calibrator/ HART management system |

Notes: For primary air/ secondary air/ flue gas applications, DP type transmitters shall be provided for pressure measurement.
LVDT type is not acceptable.

1.02.00 DIFFERENTIAL PRESSURE TRANSMITTER / FLOW TRANSMITTER

- | | | |
|----|-------------------|---|
| 1. | Working Principle | : Smart (HART Compatible) |
| 2. | Type | : Microprocessor based, 2 – Wire |
| 3. | Output Signal | : 4-20 mA DC along with superimposed digital signal |
| 4. | Measuring Element | : Capsule / Diaphragm |

-
- | | | | |
|-----|---------------------|---|---|
| 5. | Element material | : | SS-316 (Stainless Steel) or better |
| 6. | Static Pressure | : | 150 % of maximum span continuously, without affecting the calibration |
| 7. | Turn-down ratio | : | 100: 1 |
| 8. | Span and Zero | : | Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span |
| 9. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 10. | Output Indicator | : | LCD (Integral indicator of 5 digit display) |
| 11. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 12. | Body | : | SS |
| 13. | Operating Voltage | : | 24V DC |
| 14. | Load | : | 600 Ohms (min.) at 24 Volts D.C. |
| 15. | Ambient Temperature | : | 0 - 50 °C |
| 16. | Performance: | | |
| | i. Accuracy | : | ± 0.075% of Span or better |
| | ii. Repeatability | : | ± 0.05% of Span or better |
| 17. | Sealing/Isolation | : | Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications |
| 18. | Accessories | : | <div style="margin-left: 20px;"> a. Universal mounting bracket suitable for 2" pipe mounting

 b. High tensile carbon steel U-bolts </div> |

- c. Siphon for steam and hot water services
- d. ½" NPT 5-valve stainless steel manifold, constructed from SS316 bar stock
- e. Companion flange with nuts, bolts and gaskets
- f. ½" NPT cable gland
- g. Handheld calibrator

19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

1.03.00 Displacer Type Level Transmitters

- 1. Type : Smart (HART Compatible)
- 2. Stages of operation : Continuous
- 3. Material :
- 4. i. Displacer SS-316
- 5. ii. Suspension wire SS-316
- 6. iii. Torque tube housing SS
- 7. iv. Torque tube Inconel
- 8. v. Displacer chamber SS
- 9. vi. Transmitter Housing SS
- 10. Operating Voltage : 24 V DC
- 11. Transmission : Microprocessor based, 2-wire
- 12. Output Signal : 4-20 mA DC along with superimposed digital signal
- 13. Static / overload : Maximum static pressure without

	pressure		permanent deformation or loss of accuracy
14.	Turn-down ratio	:	10 : 1 or better
15.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
16.	Enclosure Class	:	IP-65
17.	Output Indicator	:	LCD type (Integral indicator of 5 digit display)
18.	Nameplate	:	Tag number and Service engraved in stainless steel tag plate
19.	Ambient Temperature	:	0 - 50 °C
20.	Load Impedance	:	600 Ohms at 24 Volts (minimum)
21.	Process Connection	:	2" Flanged
22.	Performance - Accuracy	:	± 0.075 % of span or better
23.	Accessories	:	a) Counter Flange, nuts, bolts, gaskets etc b) Weights for 5 point calibration of instruments c) Vent and drain plugs d) ½" NPT Glands e) Handheld calibrator
24.	Preferred Features	:	a) Test plug connection and cutout terminals physically separated from other electronics b) Electronic Damping facility (adjustable)
25.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

26. Applications : During detail engineering on Owner's approval

1.04.00 MASS FLOW METER

1.04.01 SENSOR

1. Measuring Principle : Coriolis Mass flow
2. Primary Element : Flow Tube of 316SS or better
3. Heating Arrangement : Integral
4. Temperature Control : For heavy fuel oil application
5. Process Connection : Flanged of rating as per process requirement
6. Drain : Self-draining facility
7. Enclosure : Stainless steel
8. Accessories : Counter flanges, Mounting nuts, bolts, gaskets etc.

1.04.02 TRANSMITTER

1. Measured quantities : Mass Flow rate, Total Mass Flow, Density
2. Input Signal Processing : Smart (HART compatible)
3. Display : LCD
4. Output : 2 nos. isolated output of 4-20mA DC selectable from four measured quantities
5. Load : < 750 ohms
6. Power supply : 240V AC, 50 Hz

-
- | | | | |
|-----|---|---|---|
| 7. | Turn Down | : | 100:1 |
| 8. | Accuracy | : | ± 0.2 % of measured value |
| 9. | Housing | : | IP 65 (Explosion proof) |
| 10. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 11. | Accessories | : | a) Handheld calibrator
b) Mounting U-bolts, nuts, bolts, prefab cable etc
c) $\frac{1}{2}$ "NPT cable gland |
| 12. | Adjustment/Calibration/
/Maintenance | : | From handheld calibrator/ HART management system |
| 13. | Applications | : | Fuel Oil service |

1.05.00 RADAR TYPE LEVEL MEASUREMENT

- | | | | |
|----|---------------------------|---|---|
| 1. | Type | : | Smart (HART Compatible) |
| 2. | Antenna | : | Co axial / guided wave radar / Overspill protection |
| 3. | Principle | : | TDR (Time Domain Reflectometry) |
| 4. | Communication | : | Two wire 4-20mA DC with HART |
| 5. | Environmental temperature | : | 0 – 50 °C |
| 6. | Enclosure | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 7. | Calibration | : | a) Self calibration with internal reference
b) Zero & Span calibration |
| 8. | Process Connection | : | External cage mounting
Flanged /screwed |
| 9. | Electronic Housing | : | Epoxy painted Die-Cast aluminium |

		alloy	
10.	Antenna / Flange assembly	:	316 SS or Hest alloy (as required)
11.	Power supply	:	24 V DC
12.	Output Indicator	:	LCD
13.	Accuracy	:	5 mm or 0.1% of probe length
14.	Accessories	:	a) Handheld calibrator
		:	b) Counter Flange, nuts, bolts, gaskets etc
		:	c) ½"NPT cable gland
		:	d) SS Nameplate
15.	Adjustment/Calibration/ /Maintenance	:	From handheld calibrator/ HART management system
16.	Applications	:	Vessels under vacuum or low pressure applications, solid levels
1.06.00	ULTRASONIC LEVEL TRANSMITTER		
1.	Type	:	Microprocessor based, 2-wire, Smart (HART Compatible)
2.	Operating Principle	:	Detection of reflected ultrasonic pulse
3.	Output Signal	:	4-20 mA DC along with superimposed digital signal
4.	Operating frequency	:	10 KHz to 50 KHz (typical)
5.	Display	:	LCD
6.	Temperature Compensation	:	Built in –Programmable
7.	Power supply	:	24 V DC
8.	Enclosure	:	SS, IP-65 (Explosion proof for NEC Class-1, Division 1 area)

-
- | | | | |
|-----|--------------------------------------|---|---|
| 9. | Zero & Span | : | Continuous, tamper proof, remote as well locally adjustable. It shall be possible to calibrate the instrument without any level in the sump/ tank |
| 10. | Accuracy & Repeatability | : | 0.15 % of span or better |
| 11. | Resolution | : | 0.1 % of span |
| 12. | Operating temp. | : | Transmitter- 500 C and Sensor - 800 C |
| 13. | MOC Sensor | : | SS-316/Body- PVC and Face – Polyurethane |
| 14. | Mounting | : | 4" Flanged/ 2" NPT for sensor and Transmitter on panel |
| 15. | Accessories | : | <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 10px;">a)</div> <div>Handheld calibrator</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 10px;">b)</div> <div>Weather canopy for protection from direct sunlight and direct rain</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 10px;">c)</div> <div>½"NPT cable gland</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 10px;">d)</div> <div>All mounting hardware (SS-316), Prefab cable</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 10px;">e)</div> <div>SS Nameplate</div> </div> </div> </div> </div></div> |
| 16. | Diagnosis | : | On-line |
| 17. | Status Indication | : | Power On, HI, HI-HI, Lo, LO-LO, Fault |
| 18. | Output Contacts | : | 2 SPDT, 230V, 5A |
| 19. | Adjustment/Calibration/ /Maintenance | : | From handheld calibrator/ HART management system |
| 20. | Applications | : | Coal Bunker, Water Service etc. |

1.07.00 ULTRASONIC FLOW TRANSMITTER

1. Type : Ultrasonic – Clamp On
2. Accuracy : +/- 1 % of reading
3. Repeatability : +/- 0.3 % of reading
4. Rangeability : 400 : 1
5. Output Signal : 4-20 mA DC with HART
6. Measured Parameter : Volumetric flow, Totalized flow and flow Velocity
7. Display : LCD with internal Key Pad (Flow rate & Totalization)
8. Power Supply : 24 V DC (2 Wire)
9. Enclosure : SS (IP- 68 – Submersible)
10. Mounting : SS Chain or Strap
11. Accessories
 1. Handheld calibrator
 2. ½"NPT cable gland
 3. Transducer cable
 4. All mounting hardware (SS-316)
 5. SS Nameplate
12. Adjustment/Calibration/ /Maintenance : From handheld calibrator/ HART management system
13. Applications : Plant water service

Note: Multi-path insertion type (minimum 4 path) Ultrasonic Flow meter shall be provided for Raw water/ Cooling Water flow measurements.

~~2.00.00 HART HAND HELD CALIBRATOR~~

~~Hand held calibrators (5 nos. for each type) shall be provided for adjustment/ calibration/maintenance of the HART compatible~~

transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided.

3.00.00 PROCESS ACTUATED SWITCHES

3.01.00 PRESSURE SWITCH

1. Type :
 - i. Piston for high pressure application
 - ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.
material All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale.
Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure
6. Adjustments :
 - a) Internal Set Point
 - b) Differential adjustment
7. End Connection : 1/2" NPT bottom connected
8. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
9. Switch Type : Snap acting, shock & vibration proof
10. Terminal Block : Suitable for full ring lugs
11. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12. Performance :
 - a) Repeat accuracy $\pm 1.0\%$
 - b) Accuracy of Setting Indication of $\pm 1.5\%$
13. Ambient temperature : 0 – 50 Deg.C

14. Nameplate : Tag number, service engraved in SS tag plate
15. Accessories :
 - a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary for corrosive/ viscous/ solid bearing or slurry type fluid applications
 - b) Snubbers for pulsating fluid applications
 - c) Siphons for steam and hot water services
 - d) Retention ring and screws for surface mounting
 - e) 1/2" NPT 2 Valve SS-316 barstock manifold
 - f) 1/2" NPT cable gland
16. Applications : During Detail Engineering on Owner's approval

3.02.00 DIFFERENTIAL PRESSURE SWITCH

1. Type :
 - i. Piston for high pressure application
 - ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.
material All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure

-
- | | | | |
|-----|----------------------|---|---|
| 6. | Adjustments | : | a) Internal Set Point |
| | | : | b) Differential adjustment |
| 7. | End Connection | : | 1/2" NPT bottom/ back connected |
| 8. | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC) |
| 9. | Switch Type | : | Snap acting, shock & vibration proof |
| 10. | Terminal Block | : | Suitable for full ring lugs |
| 11. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 12. | Performance | : | a) Repeat accuracy $\pm 1.0\%$
b) Accuracy of Setting Indication of $\pm 1.5\%$ |
| 13. | Ambient temperature | : | 0 – 50 Deg.C |
| 14. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 15. | Accessories | : | a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary Diaphragm seals for corrosive/ viscous/ solid bearing or slurry type fluid applications
b) Snubbers for pulsating fluid applications
c) Siphons for steam and hot water services
d) Retention ring and screws for surface mounting
e) 1/2" NPT 5 Valve SS-316 barstock manifold
f) 1/2" NPT cable gland |
| 16. | Applications | : | During Detail Engineering on Owner's |

approval

3.03.00 LEVEL SWITCH

3.03.01 FLOAT OPERATED

1. Float material : SS-316
2. Wetted parts : SS-316
3. Float chamber : Stainless steel/Carbon steel,
construction welded
4. Float chamber : Side mounted
mounting
5. Fluid connection : Side – Side
6. Fluid connection size : 1" ANSI RF Flange (rubber line, if
required)
7. Drain : ½ inch NPT with Plug
8. Pressure rating of
chamber : Minimum 1.5 times of design pressure
9. Repeatability : +/- 1.5 mm or better
10. Switch housing : Stainless Steel
11. Switch housing type : IP- 65
12. Type of switch : Snap acting magnetically operated
hermetically sealed
13. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
14. Accessories :
 - a) Counter flange, nuts
& bolts, suitable
gasket etc.
 - b) Steel globe type
drain valve
 - c) ½"NPT cable gland

d) Stainless steel nameplate with alpha-numeric engraved for service and tag

15. Application : During Detail Engineering on Owner's approval

3.04.00 FLOW SWITCH

1. Type : Paddle /Piston/Disk
2. Wetted part material : Stainless steel or Hastelloy for acidic application
3. End connection :
 - a) Threaded upto 1" line size with integral Tee
 - b) Flanged for line size > 1 ½"
4. Enclosure material : Stainless Steel
5. Enclosure class : IP 65
6. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
7. Repeatability : 2%
8. Cable connection : ½"NPTF
9. Accessories :
 - a) Tee, Counter flange, nuts & bolts, suitable gasket etc
 - b) ½"NPT cable gland
 - c) Stainless steel nameplate with alpha-numeric engraved for service and tag

3.05.00 RF LEVEL SWITCH

-
- | | | |
|-----------------------------|---|---|
| 1. Type | : | RADIO FREQUENCY |
| Sensing probe | | |
| 2. Material | : | SS-316 |
| 3. Mounting | : | Threaded |
| Application | | |
| 4. Temperature | : | 250°C (Max.) |
| Electronic Controller | | |
| 5. Input Supply Voltage | : | 240V AC ±10%, 50 Hz. |
| 6. Relay Output | : | 2 SPDT (240V AC, 5A) |
| 7. Ambient Temperature | : | 50 °C |
| 8. Enclosure Protection | : | IP-66 |
| 9. Enclosure Housing | : | SS |
| | | Normal Level |
| | | Power On |
| 10. Local LED Indication | : | Alarm Level |
| | | Probe Healthy |
| 11. Switching Repeatability | : | ±0.5% |
| | | Co-axial cable for probe connection to controller |
| 12. Accessories | : | SS Tag plate |
| | | ½" NPT Cable Glands |
| 13. Application | : | Solid level |

3.06.00 CONDUCTIVITY TYPE LEVEL SWITCH

- | | | |
|------------------|---|-----------------------------|
| 1. Type | : | Conductivity discrimination |
| 2. Probe MOC | : | SS-316 |
| 3. Mounting | : | Flanged on external cage |
| Application | | |
| 4. Temperature | : | 250°C (Max.) |
| 5. Test Pressure | : | Two times rated pressure |

-
- | | | | |
|-----|----------------------|---|---|
| 6. | Input Supply Voltage | : | 240V AC $\pm 10\%$, 50 Hz.
Four independent channel with |
| 7. | Input | : | selectable switching threshold for water conductivity |
| 8. | Relay Output | : | 2 SPDT (240V AC, 5A) |
| 9. | Ambient Temperature | : | 50 °C |
| 10. | Enclosure Protection | : | IP-65 (Explosion proof for NEC Class-1, Division-1 area) |
| 11. | Enclosure Housing | : | SS
HI,LO, HIGH-HIGH, LOW-LOW |
| 12. | Local LED Indication | : | Power
Fault |
| 13. | Accessories | : | a) Interconnecting cable from probe to electronics
b) Mounting accessories
c) External cage
d) Washer & Gasket
e) $\frac{1}{2}$ " NPT Cable Glands
f) SS Tag Plate |
| 14. | Application | : | During Detail Engineering on Owner's approval |

3.07.00 TEMPERATURE SWITCH

- | | | | |
|----|-----------------------------|---|--------------------------|
| 1. | Type | : | Bimetallic or gas filled |
| 2. | Sensing Element
Material | : | SS-316 |
| 3. | Bulb Material | : | SS-316 |
| 4. | Capillary | : | Stainless Steel armored |

-
- | | | | |
|-----|-----------------------|---|--|
| 5. | Movement Material | : | Stainless Steel |
| 6. | Case material | : | Stainless Steel with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 7.. | Scale | : | Black graduation on white linear scale. Graduation 0-100% with red pointer for set points |
| 8. | Over range Protection | : | 120 % |
| 9. | Instrument connection | : | Bottom |
| 10. | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC) |
| 11. | Switch type | : | Snap acting, shock and vibration-proof |
| 12. | Adjustability | : | Internal Set point adjustable over span range |
| 13. | Compensation | : | a) Capillary compensation with invar wire throughout the capillary length
b) Case compensation |
| 14. | Performance | | |
| | a) Scale Accuracy | : | ± 1.0 % of full scale |
| | b) Repeatability | : | < 0.5 % of full range |
| | c) Response time | : | Less than 40 seconds with thermowell |
| 15. | Capillary length | : | 5 meters (minimum) for local mounting/15 meters for local panel mounting |
| 16. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 17. | Accessories | : | Mounting accessories, ½" NPT cable gland |
| 18. | Applications | : | During Detail Engineering on Owner's |

approval

4.00.00 **LOCAL INSTRUMENTS**

4.01.00 PRESSURE GAUGE AND DIFFERENTIAL PRESSURE GAUGE

1. Type : Bourdon/Bellows/Diaphragm
2. Sensing & Socket : SS-316
3. Movement Material : SS-316
4. Case Material : Stainless steel. IP-65 (Explosion proof for NEC Class-1, Division 1 area)
5. Dial Size : Generally 150 mm
6. Scale : Black lettering on white in 270 O arc.
7. Window : Shatterproof glass
8. Range Selection : Normal process pressure: 50~70 % of range
9. Over-range Protection : 125% of maximum range by internal stop. External stop at zero
For Zero adjustment (Micrometer screw external)
10. Adjustment : For Range adjustment (Micrometer screw internal).
11. Element Connection : Argon welding
12. Process Connection : 1/2" NPT (M) Bottom for local, back for panel mounting
13. Performance : Accuracy of ± 1.0 % of span or better
14. Operating ambient : 0 - 50 °C
15. Safety Feature : Blow out disc /diaphragm at the back
16. Accessories :
 - a) Snubbers for pulsating fluid application.discharge
 - b) Stainless steel Diaphragm seals

		for corrosive/ viscous/ solid bearing or slurry type fluid applications
	c)	3-Way SS316 Gauge cock for pressure gauges
		5-valve SS316 manifold from
	d)	barstock for differential pressure gauge
	e)	Siphons for steam and hot water services
17. Nameplate	:	Tag number, service engraved in stainless steel tag plate
4.02.00	LEVEL INDICATOR (FLOAT & BOARD TYPE)	
1. Type	:	Float and Board
2. Float Material	:	SS-316
3. Float Cable	:	SS-316
4. Indicator Assembly	:	Epoxy painted Aluminium
5. Guide wire spring assembly	:	SS-316 (2 Nos.)
6. Guide Wire Anchor	:	SS-316
		Anodized Aluminium with engraved marking (Minimum graduation 10mm),
7. Scale Board	:	mounting brackets and suitable hardware required as per tank height
8. Elbow Assembly	:	Anodized Aluminium
9. Flanges	:	RF , ANSI 150 , SS (3 Nos.)
10. Accuracy	:	± 10 mm or better
11. Accessories	:	All mounting accessories including counter flange, nuts & bolts, suitable

gasket etc. as applicable, SS Tag plate

4.03.00 GAUGE GLASS

1. Type : Reflex /Transparent
2. Material :
Glass : Toughened borosilicate resistant to thermal shock
Body Material : ~~Carbon Steel~~ Stainless Steel
Enclosure : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
3. Integral cocks & valves/Fittings :
i. SS 316
Rubber lined corrosion resistant
4. :
ii. stainless steel (for DM/RO service)
5. Vessel Connection : ANSI Flanged SS316
6. Accessories :
i. Integral cocks
ii. Drain Valves
iii. Companion Flanges, Bolts, nuts, gaskets, SS Tag plate
iv. Illuminating lamps, Mica shield as required
v. Calibrated scale
7. Pressure rating : Twice the maximum working pressure
8. Temperature : 300 ° C
For larger lengths (greater than 1200mm), additional gauge glasses
9. Other details : shall be provided with minimum of 50 mm overlap.

4.04.00	SLIGHT GLASS	
1.	Type	: Flap-type.
2.	End connection	: Screwed / Flanged
3.	Material	
	a) Body	: SS- 304
	b) Cover plate	: SS- 304
	c) Indicator	: SS- 316
4.	Sight Glass	: Toughened Borosilicate
5.	Gasket	: Neoprene
6.	Bolts & Nuts	: High tensile steel.
7.	Hydraulic Test Pressure	: 1.5 times maximum working pressure
8.	Accessories	: Companion Flanges, Bolts, nuts, gaskets as required, SS Tag plate.
4.05.00	ROTAMETER	
1.	Type	: ON-LINE for line upto and including 50 mm NB. : Borosilicate BY-PASS for line size above 50 NB
2.	Metering tube	: Toughened Borosilicate
3.	Float	: SS-316
4.	End fittings	: SS-316
5.	Packing material	: Teflon / PTFE
6.	Casing	: Stainless Steel
7.	Gland Rings /Followers/ Other wetted parts	: Stainless Steel
8.	Orifice Plate	: Stainless Steel (for bypass type)
9.	Operating Temperature	: 0-50 Deg. c

- | | | |
|------------------------|---|--|
| 10. Test Pressure | : | 200% of maximum operating pressure |
| 11. Scale | : | 250 mm nominal length |
| 12. Graduation | : | Direct reading |
| 13. Process Connection | : | Flanged (RF) to line size as per ANSI standards (150#) |
| 14. Tapping | : | D & D/2 |
| 15. Accuracy | : | +/- 2% of full scale reading |
| 16. Reproducibility | : | Within 0.5% of instantaneous reading |
| 17. Accessories | : | SS Tag Plate, orifice plate |

5.00.00 TEM PERATURE ELEMENTS & ACCESSORIES

5.01.00 RESISTANCE TEMPERATURE DETECTOR

- | | | |
|----------------------------------|---|--|
| 1. Type | : | Platinum (Duplex), Ungrounded |
| 2. Platinum (Duplex), Ungrounded | : | 100 ohm at 0 °C |
| 3. Base | : | Wound on ceramic (anti-inductive) |
| 4. Wiring | : | 3 Wire |
| 5. Protecting Tube | | |
| a) O.D. | : | 6 mm |
| b) Material | : | SS-316, Seamless |
| c) Filling | : | Magnesium oxide (Purity above 99.4%). |
| 6. Response time | : | a) 15 sec. (bare).
b) 30 sec. (with thermowell) |
| 7. Calibration | : | DIN 43760 |
| 8. Accuracy | : | ± 0.5% |
| 9. Head | | |
| a) Type | : | IP-65 universal screwed type |

-
- b) Material : Stainless Steel
- c) Terminal blocks : Nickel plated Brass-screw type / silver plated
- d) Cable connection : ½" NPT gland and grommet
- e) Others : Terminal head cover with SS chain and suitable gasket.
- Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).
- Adjustable nipple-union-nipple [1/2" Sch 80 X ½" NPT] with thermowell connection
10. Accessories : a)
- b) Compression fittings/unions
- Flanges etc. (for flanged
- c) connections only)
- Thermowell (As specified
- d) below)
11. Thermowell connection : ½" NPT (M) or 150 RF Flanged
- Tag number, service engraved in
12. Nameplate : stainless steel tag plate

Note: The specifications for RTDs of winding/ bearing of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However, the type of RTD shall be Pt-100.

5.02.00 THERMOCOUPLES

1. Type :
 - a) 16 SWG wire of Chromel AlumeI) (Type-K)
 - b) Duplex
 - c) Ungrounded
2. Protecting Tube
 - a) O.D. : 6 mm
 - b) Material : SS-316, Seamless
 - c) Filling : Magnesium oxide (Purity above 99.4%).
3. Response time :
 - a) < 20 seconds for measurement
 - b) < 10 seconds for control
4. Accuracy : $\pm 1.1^{\circ}\text{C}$ up to 300°C & 0.4% of measured temperature range above 300°C
5. Head
 - a) Type : IP-65 universal screwed type
 - b) Material : Stainless Steel
 - c) Terminal blocks : Nickel plated Brass-screw type / silver plated
 - d) Cable connection : $\frac{1}{2}$ " NPT gland and grommet
6.
 - e) Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

7. Accessories :
 - a) Adjustable nipple-union-nipple [1/2" Sch 80 X 1/2" NPT] with thermowell connection
 - b) Compression fittings/unions
 - c) Flanges etc. (for flanged connections only)
 - d) Thermowell (As specified below)
8. Thermowell connection : 1/2" NPT (M) or 150 RF Flanged
9. Nameplate : Tag number, service engraved in stainless steel tag plate

5.03.00 TEMPERATURE GAUGE

1. Type : Expansion type (Liquid filled system)
2. Sensing Element : Bourdon – SS-316
3. Material : SS-316
4. Bulb and Capillary : SS-316
5. Capillary Tubing : Inner sheath - solid drawn Material
Outer sheath - PVC tube
6. Movement Materials : Stainless Steel / Direct Bourdon tip connection to pointer spindle
7. Case Material : Stainless Steel stove enameled, black finish, threaded bezel ring, clear glass

		cover conforming to IP 65.
7.	Dial size	: 150 mm
8.	Scale	: Black lettering on white background in 270 Deg.C arc
9.	Over range protection	: 125 percent of FSD
10.	Capillary Glanding	: 1/2" NPT(M) x compression fitting (SS) to suit capillary
11.	Instrument Connection	: Bottom connection for local mounting, back connection for panel mounting
12.	Process Connection	: 1/2" NPT (M) or 150 RF Flanged
13.	Extension Neck Length	: 50 mm
14.	Compensation	: a) Capillary compensation
15.		: b) Case compensation
16.	Performance	: a) Accuracy : + /- 1.0 percent of full scale Deflection
		: b) Repeatability : Less than 0.5 percent of full range
		: c) Response time: 15 seconds (max.).
17.	Capillary length	: 3.0 meters (local) / 15.0 metres (local panel)
18.	Other features	: Shatter proof glass
19.	Nameplate	: Tag number, service engraved in stainless steel tag plate
20.	Accessories	: SS316 Thermowell
5.04.00	THERMOWELL	
1.	Material	: SS-316
2.	Manufacture	: Drilled from bar stock, Hex Head, Tapered design (As per ASME PTC 19.3)

3. Process connection : M33x2
4. Certification : Not applicable
5. Bore concentricity : +5% of wall thickness
6. Identification mark : Tag number punched on head
7. Surface treatment : Polish after machining
8. Element connection : ½" NPT (M) or 150 RF Flanged
9. Head : Hex
10. Length of the hex head : 31.75 mm (min.)
11. Accessories : SS Plug and chain for test thermo wells
SS Nameplate, Flange with companion
flange & all required accessories for
flanged connections.

Note: Wake frequency calculations shall be furnished for all thermowells for approval.

Thermowells shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid.

5.05.00 METAL TEMPERATURE THERMOCOUPLE

1. Measuring medium : Metal temperature
2. Type : Chromel Alumel (Type-K)
Duplex, Ungrounded
3. Insulation : Mineral Insulation Magnesium Oxide
4. Wire gauge : 16 AWG
5. Protective sheath : SS
6. Protective sheath :
diameter : 8 mm O.D.
7. Characteristics : Special limits of error as in ANSI
thermocouple MC 96.01
8. Accessories : ½" BSP SS sliding end connector, weld
pad, clamps of heat resistant steel

1. Type : Hydrometer Type
2. Mounting : On line
3. Accuracy : +/- 2% of range
4. Scale : Black letter on white scale
5. End connection : PVC flange

9.06.00 DENSITY/ CONCENTRATION METER

1. Wetted Part : Stainless Steel
2. Enclosure : Stainless Steel (IP-65)
3. Power Supply : 24 V DC
4. Output signal : 4-20 mA DC (isolated) into 600 ohms
5. Accuracy : ± 0.001 g/cc
6. Indication : LCD display
7. Temp. Compensation : Integral
8. Accessories : Mounting hardware, integral amplifier
(if required), cable glands, tag plate
etc.

10.00.00 SOLENOID VALVES

1. Operating Principle : Electromagnetic (noiseless)
2. Coil voltage rating : 240 V AC /24 V DC (as required)
3. Ways : 2/3/4 way
4. Port size : 1/4" NPT all ports
5. Body : SS bar stock
- Trim : SS-316
6. Duty : Suitable for continuous energization
7. Sealing : Airtight and leak proof
8. Ambient Temperature : 0 - 50 ° C

-
- | | | | |
|-----|-------------------|---|--|
| 9. | Fluid Temperature | : | 0-150 ° C (approx.) |
| 10. | Coil Enclosure | : | Stainless Steel |
| 11. | Insulation | : | Class-H |
| 12. | Coil Casing | : | IP-65 (Explosion proof for NEC Class-1, Division-1 area) |
| 13. | Mounting | : | On pipe or on panel |
| 14. | Cable Connection | : | ½" NPT |
| 15. | Accessories | : | Cable glands, SS Tag plate |



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

Instrumentation Check List



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR PRESSURE SWITCH

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	V	V	
	1.1 MODEL NO/TAG NO						
	1.2 RANGE						
	1.3 END CONN						
	1.4 NO. OF CONTACT						
2	CALIBRATION			P	V	V	
	2.1 REPEATABILITY						
	2.2 SET POINT ADJUSTMENT						
	2.3 DIFFERENTIAL						
3	OVER PR & LEAK TEST				P	V	V
4	ELECT. INSULATION/HV TEST	ONE	P	V	V		
5	REVIEW OF TC FOR MATERIALS OF	FOR LOT	V	V	V		
	5.1 SENSOR						
	5.2 MOVEMENT						
	5.3 PROCESS CONNECTION						
	5.4 HOUSING						
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST	V	V	V		
7	REVIEW OF TC OF MICROSWITCH	FOR LOT	V	V	V		

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to carry out ROUTINE TEST on 100 %.
- Contractor to provide compliance certificate for tests/checks verified by contractor and the same alongwith test certificates to be verified by BHEL



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR TRANSMITTER

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECKS FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	VISUAL.						
	MODEL/TAG No						
2	PROCESS CONNECTION			P	W	V	
3	ACCURACY			P	W	V	
4	REPEATABILITY			P	W	V	
5	HYSTERESIS			P	W	V	
6	EFFECT OF TEMP VARIATION ON ACCURACY			P	W	V	
7	SPAN / ZERO ADJUSTMENT	ONE / TYPE		P	W	V	
8	EFFECT OF SUPPLY VOLTAGE VARIATION			P	W	V	
9	EFFECT OF LOADING (500 OHM METERS)			P	W	V	
10	HIGH PRESSURE TEST	SEE NOTE-1 BELOW		P	W	V	
11	BURN-IN TEST	ONE / TYPE		P	W	V	
12	DEGREE OF PROTECTION			P	W	V	
13	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW		V	V	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- When material correlation are not available manufacturer's compliance to be provided.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR PRESSURE & DP GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	SENSOR TYPE						
	DIAL SIZE						
	MODEL NO/TAG NO						
	RANGE/SCALE						
	SWITCH CONTACT RATING & NOS.						
	END CONNECTION						
2	CALIBRATION			P	W	V	
	ACCURACY						
	REPEATABILITY						
	SET POINT ADJUSTMENT						
3	OVER PRESSURE & LEAK TEST			P	W	V	
4	OPERATION OF PRESSURE. RELIEF DEVICE	ONE		P	W	V	
5	REVIEW OF TC FOR	FOR LOT		V	V	V	
	MATERIALS OF SENSOR						
	MOVEMENT						
	PROCESS CONNECTION						
	HOUSING						
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST	V	V	V		
7	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW	V	V	V		

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- When material correlation is not available, MFR's compliance to be provided
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR LEVEL GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS / DRWGS	P	W	V	
	TYPE						
	MODEL/ TAG NO.						
	DAIL SIZE						
	RANGE/SCALE						
	END CONNECTION						
2	DIMENSIONS, PROCESS CONNECTION	ONE / LOT		P	W	V	
3	ACCURACY			P	W	V	
4	MATERIAL TC FOR			P	V	V	
	BODY ISO.						
	VALVE						
	GAUGE GLASS						
5	HYD. TEST	SEE NOTE-1 BELOW		P	W	V	
6	ACCESSORIES AS APPLICABLE			P	W	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR ANNUNCIATORS

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	TYPE/ MODEL						
	DIMENSIONS OF HARDWARE						
	MODULARITY						
	SEQUENCE						
	FACIA DETAILS						
2	FUNCTIONAL TEST	100%		P	W	V	
3	IMMUNE TO STEP VARIATIONS IN THE POWER SUPPLY	SEE NOTE-1 BELOW		P	W	V	
4	DEGREE OF PROTECTION FOR ENCLOSURE	TYPE TEST		P	W	V	
5	I/R CHECK	SEE NOTE-1 BELOW		P	W	V	
6	RESPONSE			P	W	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL,
P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

LCP & JUNCTION BOXES SPECIFICATION

- 1.00.00 **GENERAL REQUIREMENT**
- 1.01.00 ENCLOSURES FOR INSTRUMENTS AND OTHER EQUIPMENT
- 1.01.01 All panels, cabinets, distribution boxes, junction boxes, terminal boxes and all other field mounted equipment / enclosures shall have suitable environmental protection as detailed in Section-I of this volume of the specification.
- 1.02.00 SURFACE PREPARATION & PAINTING
- 1.02.01 All sheet metal panel/ desk exterior steel surfaces shall be sand blasted, ground smooth and painted as specified below.
- 1.02.02 Suitable filler shall be applied to all pits, blemishes and voids in the surface. The filler shall be sanded so that surfaces are level and flat; corners are smooth and even. Exposed raw metal edges shall be ground burr-free. The entire surface shall be blast clean to remove rust and scale and all other residue due to the fabrication operation. Oil, grease and salts etc. shall be removed from the panels by one or more solvent cleaning methods prior to blasting.
- 1.02.03 Two spray coats of inhibitive epoxy primer surfacer shall be applied to all exterior and interior surfaces, each coat of primer surfacer shall be of dry film thickness of 1.5 mil. A minimum of two spray coats of final finish color (Catalyzed epoxy or polyurethane) shall be applied to all surface of dry film thickness 2.0 Mil. The finish colors for exterior and interior surfaces shall conform to the following shades:
- Exterior – Opaline green shade 275 of IS: 5 or equivalent international code..
 - Interior - Brilliant White.
- 1.02.04 Paint films, which show sags, cheeks, blisters, teardrops, fat edges or other painting imperfections, shall not be acceptable.
- 1.03.00 WIRING
- 1.03.01 All spare contacts of relays, switches and push buttons shall be wired up to the terminal blocks. All intercommunications between sections of panels/desks shall be furnished.
- 1.03.02 Each wire shall be identified at both ends with wire designation as per approved wiring diagram. Heat shrinkable type ferrules with indelible computerized ink print shall be used with cross- identification.
- 1.03.03 All wire termination shall be made with insulated sleeve and crimping type lugs. Wire shall not be spliced or tapped between terminals. Open-ended terminal lugs will not be accepted. Wires shall not be looped around the terminal screws or studs.