

ANNEXURE - C TO TENDER BAP/FGD/2012/OT-6

**BONGAIGAON- 3X250 MW
FLUE GAS DESULFURIZATION SYSTEM**

**TECHNICAL SPECIFICATION FOR
MOTORIZED BUTTERFLY VALVES
FOR FLUE GAS & OXIDATION AIR**

CUSTOMER : NATIONAL THERMAL POWER CORPORATION LIMITED



NTPC: BONG: FGD: WVALVES- BUTTERFLY VALVE -SPEC-037: REV-01

Flue Gas Desulphurization Group
Air Quality Control Systems
BAP :: BHEL :: Ranipet



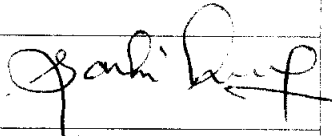




MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

TECHNICAL SPECIFICATION FOR MOTORIZED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

Prepared	Checked	Approved
		
SRIDHAR Assistant Engineer - FGD	MANOJ K THAKUR ENGINEER - FGD	SASHI KUMAR O Senior Engineer-FGD
R01 dated 07 09 12		





MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

CONTENTS

1.0	PROJECT INFORMATION
2.0	INTENT OF SPECIFICATION
3.0	STANDARDS AND CODES
4.0	SPECIFICATION FOR DESIGN / CONSTRUCTION / MATERIAL PARTICULARS
5.0	SCOPE OF SUPPLY
6.0	MATERIAL OF CONSTRUCTION
7.0	END CONNECTIONS
8.0	PROOF OF DESIGN TEST (TYPE TEST)
9.0	SPECIFICATION FOR ACTUATOR
10.0	PAINTING OF VALVES
11.0	DOCUMENTS / DETAILS ALONG WITH BID
12.0	DOCUMENTS / SERVICE AFTER ORDER
13.0	DOCUMENTATION
14.0	INSPECTION
15.0	GUARANTEE
16.0	ANNEXURE- I - DETAILED LIST OF VALVES WITH OPERATING PARAMETERS
17.0	ANNEXURE- II - DATA SHEET FOR VALVES
18.0	ANNEXURE- III -DATA SHEET FOR PNEUMATIC ACTUATOR
19.0	ANNEXURE- IV -FORM FOR TECHNICAL DEVIATIONS (If any)
20.0	ANNEXURE- V -PAINTING PROCEDURE



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

1.0 PROJECT INFORMATION

▪ Owner	NTPC
▪ Buyer	BHEL, Ranipet
▪ Process / application	Wet Lime Stone FGD system

1.1 SITE CONDITIONS

▪ Ambient temperature (Guarantee)	27 Deg C
▪ Ambient temperature (Design)	50 Deg C
▪ Height above sea level	47 m
▪ Relative Humidity	60 %

1.2 LOCATION AND APPROACH

▪ Project location	
▪ State	Assam
▪ District	Kokrajhar
▪ Place	Kumkuri near Salakati, Bongaigaon
▪ Height above sea level	47 m



2.0 INTENT OF SPECIFICATION

This specification together with the attendant Technical Data Sheet and other specifications/attachments to inquiry / order defines the minimum requirements for motorized butterfly valves along with their accessories /auxiliaries for use in the process of Flue gas Desulphurization (FGD) system handling flue gas and oxidation air. Bidder shall make all possible efforts to comply strictly with the requirements of this specification and other specifications/attachments to inquiry/order.

In case, deviations are considered essential by the Bidder (after exhausting all possible efforts), these shall be separately listed in the Bidder's proposal under separate section, titled as "List of Deviations/Exceptions to the Enquiry Document (Annexure-III)". Deviation shall be listed separately for each document with cross reference to Page No./Section/Clause No./Para etc. of the respective document supported with proper reasons for the deviation for purchaser's consideration. Any deviation, not listed under the above section, even if reflected in any other portion of the proposal, shall not be considered applicable. No deviation or exception shall be permitted without the written approval of the purchaser.

The design, material, construction, manufacture, inspection, testing and performance of valves shall comply with all currently applicable statutes, regulations and safety codes in the locality where the valves will be installed. The valves shall conform to the latest editions of applicable codes and standards as mentioned elsewhere. Nothing in this specification shall be construed to relieve the Bidder of his responsibility. Compliance to this specification shall not relieve the Bidder of the responsibility of furnishing equipment and accessories/auxiliaries of proper design, materials and workmanship to meet the specified start up and operating conditions.

In case the Bidder considers requirement of additional instrumentation, controls, safety devices and any other accessories/auxiliaries essential for safe and satisfactory operation of the equipment, he shall recommend the same along with reasons in a separate section along with his proposal and include the same in his scope of supply. The Bidder shall offer only proven design in successful operation.

3.0 STANDARDS AND CODES

The valves shall conform to the latest editions of applicable codes and standards as mentioned elsewhere. Valves in general shall conform to the requirements of the following standards:

- ANSI B 16.34 Standard for valves.
- AWWA-C-504 Rubber seated butterfly valves.
- BS-5155/EN-593 Cast iron and carbon steel butterfly valves for general purpose.



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

- * ANSI-B-16.10 Valves face to face and other relevant dimension.
- * API-594 Standard for Dual-check valves.
- * API-598 Valves inspection test.

4.0 SPECIFICATION FOR DESIGN / CONSTRUCTION / MATERIAL PARTICULARS

- 4.1. All valves shall be suitable for the service conditions i.e flow, temperature and pressure at which they are required to operate.
- 4.2. The valves as well as all accessories shall be designed for easy disassembly and maintenance.
- 4.3. Valves to be installed outside shall be required to have the stem properly protected against atmospheric corrosion
- 4.4. The valves supplied shall be suitable for flue gas and oxidation air application, the operating and design conditions are provided in valve list enclosed
- 4.5. Valves must be designed to withstand high operating temperature as per the valve list.
- 4.6. The valves shall be designed for the design pressure/temperature of the system on which it is installed and in accordance with AWWA-C-504, EN-593 or any other approved equivalent standard latest edition.
- 4.7. The valves shall be suitable for installation in any position (horizontal/ vertical etc.) and shall be of double-flanged construction. However for sizes 150 NB and below the valves may be lugged Wafer construction.
- 4.8. The seals, both on the body (sleeve) and on the disc shall be of the material specified. Necessary shaft seal shall be provided and adequately designed to ensure no leakage across the seal. This seal shall be designed so that they will allow replacement without removal of the valve shaft. The sealing ring on the disk shall be continuous type and easily replaceable.
- 4.9. For all types of valves, the design with shaft eccentric to the disc is preferred. The shaft shall be solid type and shall pivot on bushings. Bushings/sleeve type bearings shall be contained in the hub of valve body. The bearing shall be self-lubricated type with low coefficient of friction and should not have any harmful effect on water and on valve components.
- 4.10. The design of the shaft shall be such that it will safely sustain maximum differential pressure across the closed valve. The shaft and any key (taper pin etc.) for transmitting the torque between shaft and disc shall be capable of withstanding the maximum torque required to operate the valve. However, the shaft diameter shall not be less than the minimum shaft diameter specified in relevant code. Necessary Torque Calculation and the torque class selected on the basis of the same shall be furnished to the Employer for information.
- 4.11. The disc shall rotate from the full open to the tight shut position. The disc shall be contoured to ensure the least possible resistance to flow and shall be suitable for throttling operation. While the disc is in the throttled position,



- valve shall not create any noise or vibration. The operating mechanism shall be mounted directly on or supported from the valve body.
- 4.12. All valves shall be complete with: position indicator (located in a visible place), arrow indicating the flow direction; adjustable mechanical stop limiting devices to prevent over travel of valve disc in open/close position; all valves shall be "tight shut off"
- 4.13. Valves-350Nb and above shall have pressure equalizing bypass valves, wherever system parameters warrant the same.
- 4.14. Valves-350Nb and above shall also be provided with gear operator arrangement suitable for manual operation. Manual operation of valve shall be through worm and gear arrangement having totally enclosed gearing with hand wheel diameter and gear ratio designed to meet the required operating torque It shall be designed to hold the valve disc in intermediate position between full open and full closed position without creeping or fluttering. Adjustable stops shall be provided to prevent over travel in either direction.
- 4.15. Fabricated steel (IS:2062 Gr B) butterfly valves instead of cast Iron body valves are also acceptable for size above 300 mm NB diameter for water application other than Sea-water / corrosive water. In such a case, however, the bidder will have to necessarily submit thickness calculations, in order to establish the integrity of the fabricated valve body under the system operating pressure condition. Bidder has to clearly indicate the material offered in the bid. No change shall be entertained during detailed engg.
- 4.16. Limit and torque switches (if applicable) shall be enclosed in water tight enclosures along with suitable space heaters for motor actuated valves, which may be either for On-Off operation or inching operation with position transmitter.
- 4.17. Valves supplied for vent application shall be of full body design
- 4.18. All valves shall be provided with proper name plates indicating complete information about the valves
- 4.19. All valves shall be provided with embossed name plate giving details such as tag number, type, size etc.
- 4.20. The actuator-operated valves shall be designed on the basis of the following :
- (1) The internal parts shall be suitable to support the pressure caused by the actuators;
 - (2) The valve-actuator unit shall be suitably stiff so as not to cause vibrations, misalignments, etc.
 - (3) All actuator operated valves shall be provided with hand operated gearing mechanism also.
 - (4) All actuators operated valves shall open/ close fully within time required by the process but not later than 60 seconds after actuators starts.

5.0 SCOPE OF SUPPLY

- a) Valve as per specification
- b) Actuator as per the specification.
- c) Limit switch – 2 Nos. for each valves as per the spec.



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

6.0 MATERIAL OF CONSTRUCTION

Material of Gate valves for flue gas application shall be as per enclosed **Annexure – I** or its equivalent.

Material for counter flanges shall be the same as for the piping

7.0 END CONNECTIONS

End connection for Gate valves shall be as per enclosed **Annexure-I**.

8.0 PROOF OF DESIGN TEST (TYPE TEST) FOR BUTTERFLY VALVES

Proof of Design (P.O.D.) test certificates shall be furnished by the bidder for all applicable size-ranges and classes of Butterfly valves supplied by him, in the absence of which actual P.O.D. test shall be conducted by the bidder in the presence of Employer's representative. All valves that are designed and manufactured as per AWWA-C-504 shall be governed by the relevant clauses of P.O.D test in AWWA-C-504. For Butterfly valves designed and manufactured to EN-593 or equivalent, the P.O.D. test methods and procedures shall generally follow the guidelines of AWWA-C-504 in all respect except that Body & seat hydro test and disc-strength test shall be conducted at the pressures specified in EN-593 or the applicable code. Actuators shall also meet requirements of P.O.D. test of AWWA-C-504

9.0 SPECIFICATION FOR ACTUATOR

a) Quantity	: 01 No. for each valve
b) Type	: Linear electrical
actuator/Rotex/Elomatic/Virgo	
d) Failure position (power failure)	: Close
f) Local Position Indicator	: To be provided.
g) Hand wheel for manual opn	: Required (> 8 inch)
h) Actuator torque	: Vendor to specify
i) Actuator Protection Class	: IP-65 (Min)
j) Actuator Thrust	: Vendor to specify
Actuator travel time for 90 degree	: Vendor to specify
Power supply	: Vendor to specify
Working current of actuator	: Vendor to specify
Stall current of actuator	: Vendor to specify
Torque switch / rating	: 2 NOS, 2 NO+2NC contacts suitable for 24V DC/230V AC, min 5A for 24 V DC
Potentiometer	: Required for 0 to 100% valve opening indication
Control box (3φ)	: Integral starter required with PLC, remote manual operation from operator work stn.



9.1 LIMIT SWITCHES:

- a) Quantity /valve : 2 nos for close / open indication
- b) No. of Contacts : 2NO+2NC contacts
- c) Contact Rating : 24V DC / 230V AC
- d) Protection : Weather proof IP 55.
- e) Limit Switch Box : Limit Switch terminals shall be brought out to a Terminal Box

10.0 PAINTING OF VALVES:

The detailed painting procedure is enclosed in **Annexure-V**

11.0 DOCUMENTS / DETAILS ALONG WITH BID

The following information / documents shall be submitted along with the offer

- a. Duly filled up data sheet for each valve type as per **Annexure-II and III** in the enclosed format.
- b. Detailed assembly drawing with overall dimensions.
- c. Valve cross sectional drawings with Bill of Material including the material specifications.
- d. Valve Regulation Characteristic Curve.
- e. Cv calculation.
- f. List of applicable standards for shop test.
- g. Reference list for the offered model.
- h. Typical Quality plan for supply of the above equipments.
- i. Valves Catalogues.
- j. List of commissioning spares.
- k. Recommended spares list for 3 year O&M along with item wise price.
- l. Any deviation shall be specifically mentioned in the enclosed deviation format **Annexure-IV**.

In case of any deviation, the Bidder shall indicate the deviation, clause by clause in the deviation format attached in **Annexure-IV**. If there is no deviation "NIL" statement shall be furnished. In the absence of **Annexure-IV**, it will be construed that the bid confirms strictly to the specification. Acceptance or rejection of the offer with or without deviations (either fully or partially) is sole discretion of the purchaser without seeking further clarification from the bidder.

NOTE: Bidders to note that failing to submit the above documents, the bid shall be considered as incomplete and liable for rejection.



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

12.0 DOCUMENTS / SERVICE AFTER ORDER

10.1. The following documents are to be submitted for BHEL's approval.

- Duly filled up data sheet in the enclosed format.
- Detailed assembly drawing with overall dimensions.
- Valve cross sectional drawings with Bill of Material including the material specifications.
- C_v Calculation
- Quality plan

10.2. The following are to be submitted to BHEL's review and acceptance.

- Material test certificate
- Hydraulic & Leak test certificates
- Performance guarantee certificate
- Erection manual
- O&M manuals

13.0 DOCUMENTATION

- a. The documentation during bid and post order stage shall meet the following requirements.
- b. All documents and drawings shall be submitted in English.
- c. Hard copies of all documents and drawings during bid stage to be submitted in duplicate.
- d. Hard copies of all documents for approval to be submitted in triplicate.
- e. Hard copies of all final documents, drawings, manual etc., shall be submitted in bound folder in duplicate.
- f. Soft copies of all final documents in MS office in the form of CD-1 set.
- g. Soft copies of all final drawings in AutoCAD, latest version in the form of CD-1 set.

14.0 INSPECTION

The valves shall be inspected at Vendor's works by BHEL Engineer as per the procedure submitted by the Vendor.

15.0 GUARANTEE:

The Vendor shall provide guarantee for a period of 12 months from the date of commissioning or 24 months from the date of supply whichever is earlier.

**MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION****NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01****ANNEXURE-I****16.0 DETAILED LIST OF VALVES WITH OPERATING PARAMETERS**

Indent no	RFW00083									
Material Code	RFW000830001									
Process Liquid	Flue Gas Application									
Service	Vent									
Type of valve	Butterfly Valve									
Mode of Operation	Motorized									
Size	10 inch									
S. No	Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
		T (°C)	P (Kg/cm²)	T (°C)	P (Kg/cm²)	Body Material	Disc	Stem		
1	10HTD00AA201	57	0.01	100	0.066.	SS316/IS2 10 FG220	SS316	SS316	FLD	1
2	20HTD00AA201	57	0.01	100	0.066.	SS316/IS2 10 FG220	SS316	SS316	FLD	1
3	30HTD00AA201	57	0.01	100	0.066.	SS316/IS2 10 FG220	SS316	SS316	FLD	1



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

Indent no		RFW00083								
Material Code		RFW000830002								
Process Liquid		Oxidation Air Application								
Service		Isolation								
Type of valve		Butterfly Valve								
Mode of Operation		Motorized								
Size		18 inch								
S. No	Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
		T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
1	10HTG00AA101	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1
2	10HTG00AA102	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1
3	20HTG00AA101	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1
4	20HTG00AA102	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1
5	30HTG00AA101	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1
6	30HTG00AA102	140	1.15	200	10	SS316/IS2 10 FG220	SS316	SS316	FLD	1



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

MANDATORY SPARES:

Indent no		RFW20109								
Material Code		RFW201090001								
Process Liquid		Flue Gas Application								
Service		Vent								
Type of valve		Butterfly Valve								
Mode of Operation		Motorized								
Size		10 inch								
S. No	Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
		T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
1	M1-BFV-FG-MT-10	57	0.01	100	0.066.	SS316/IS210 FG220	SS316	SS316	FLD	1

Indent no		RFW20109								
Material Code		RFW201090002								
Process Liquid		Oxidation Air Application								
Service		Isolation								
Type of valve		Butterfly Valve								
Mode of Operation		Motorized								
Size		18 inch								
S. No	Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
		T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
1	M1-BFV-OA-MT-18	140	1.15	200	10	SS316/IS210 FG220	SS316	SS316	FLD	1

Note: All valves shall be provided with embossed name plate giving details such as tag number, type, size etc.



MOTORIZED OPERATED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION

NTPC: BONG: FGD: WVALVES-BUTTERFLY VALVE SPEC-037: REV-01

ANNEXURE-II

17.0 DATA SHEET FOR VALVES

I. TECHNICAL PARAMETERS


- A. VALVE SIZE :
- a. Make :
- b. Model/ Type :
- c. Fluid details - Medium handled :
- Temperature range ° C :
- d. Rated flow m³/Hr :
- e. Design Cv of the valve :
- f. Valve rating :
- g. Valve operation- (Lever/ Gear box) :
- h. Pressure Drop for rated flow bar(g) :
- i. Design pressure bar(g) :
- j. Hydraulic test pressure :
- Body bar(g) :
- Seat bar(g) :
- k. Max. Shut off pressure bar(g) :

II. CONSTRUCTION DETAILS

- a. Material of construction Body :
- (whatever applicable) - Ball :
- Stem :
- Disc :
- Seat :
- Bushing :
- Handle :
- Fasteners :
- b. End Connection / Rating / Standard :
- c. Recommended minimum pipe ID mm :
- d. Details of Gearbox if applicable :

III. GENERAL

- a. Weight per valve :
- b. Applicable standards :
- c. Valve GA Drawing / Cross Sectional Drg. :
- d. Enquiry / PO reference :

	TECHNICAL SPECIFICATION FOR MOTORIZED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION
	NTPC: BONG: FGD: WVALVES- BUTTERFLY VALVE -SPEC-037: REV-01

ANNEXURE-III

18.0 DATA SHEET FOR PNEUMATIC ACTUATOR

- 1) ACTUATOR
 - a) Make :
 - b) Model :
 - c) Type :
 - d) Torque rating :
 - f) Operating time for opening :
 - Operating time for closing :
 - g) Accessories offered :
 - h) Type of stay put :
 - i) Actuator torque :
 - j) Actuator Protection Class :
 - k) Actuator Thrust :
 - l) Actuator travel time for 90 :
 - m) Power supply :
 - n) Working current of actuator :
 - o) Stall current of actuator :

- 2) LIMIT SWITCH
 - a) Make :
 - b) Type :
 - c) Quantity :
 - d) Contact rating :
 - e) Reset type :

NOTE:

Vendor should fill up the “Vendor’s Confirmation column” and submit a signed copy of this specification with his offer.

Vendor’s Signature & Seal



**TECHNICAL SPECIFICATION
FOR
MOTORIZED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION
NTPC: BONG: FGD: WVALVES- BUTTERFLY VALVE -SPEC-037: REV-01**

ANNEXURE-IV

19.0 FORM FOR TECHNICAL DEVIATIONS (If any)

SL. NO	SEC / CLAUSE NO.	SPECIFICATION	STATEMENT OF DEVIATIONS/VARIATIONS	REASON FOR DEVIATION	COST OF WITHDRAWAL

Date:

Signature & seal of the Bidder



**TECHNICAL SPECIFICATION
FOR
MOTORIZED BUTTERFLY VALVES FOR FLUE GAS & AIR APPLICATION**
NTPC: BONG: FGD: WVALVES- BUTTERFLY VALVE -SPEC-037: REV-01

ANNEXURE-V

20.0 PAINTING PROCEDURE

Primer Coat		Intermediate Coat		Finish coat			Total DFT μm (min)
Paint	No of Coats /DFT	Paint	No of Coats	Paint	No of Coats	Shade	
HB Chlorinated Rubber based Zinc Phosphate Primer DFT= 50 μm per coat (Solid by Volume min 60%)	2	--	--	Chlorinated Rubber Based Finish paint DFT= 30 μm per coat (Solid by Volume min 60%)	3	Gray shade to R9002	160

