

ANNEXURE - C TO TENDER BAP/FGD/2012/01-5
**BONGAIGAON- 3X250 MW
FLUE GAS DESULFURIZATION SYSTEM**

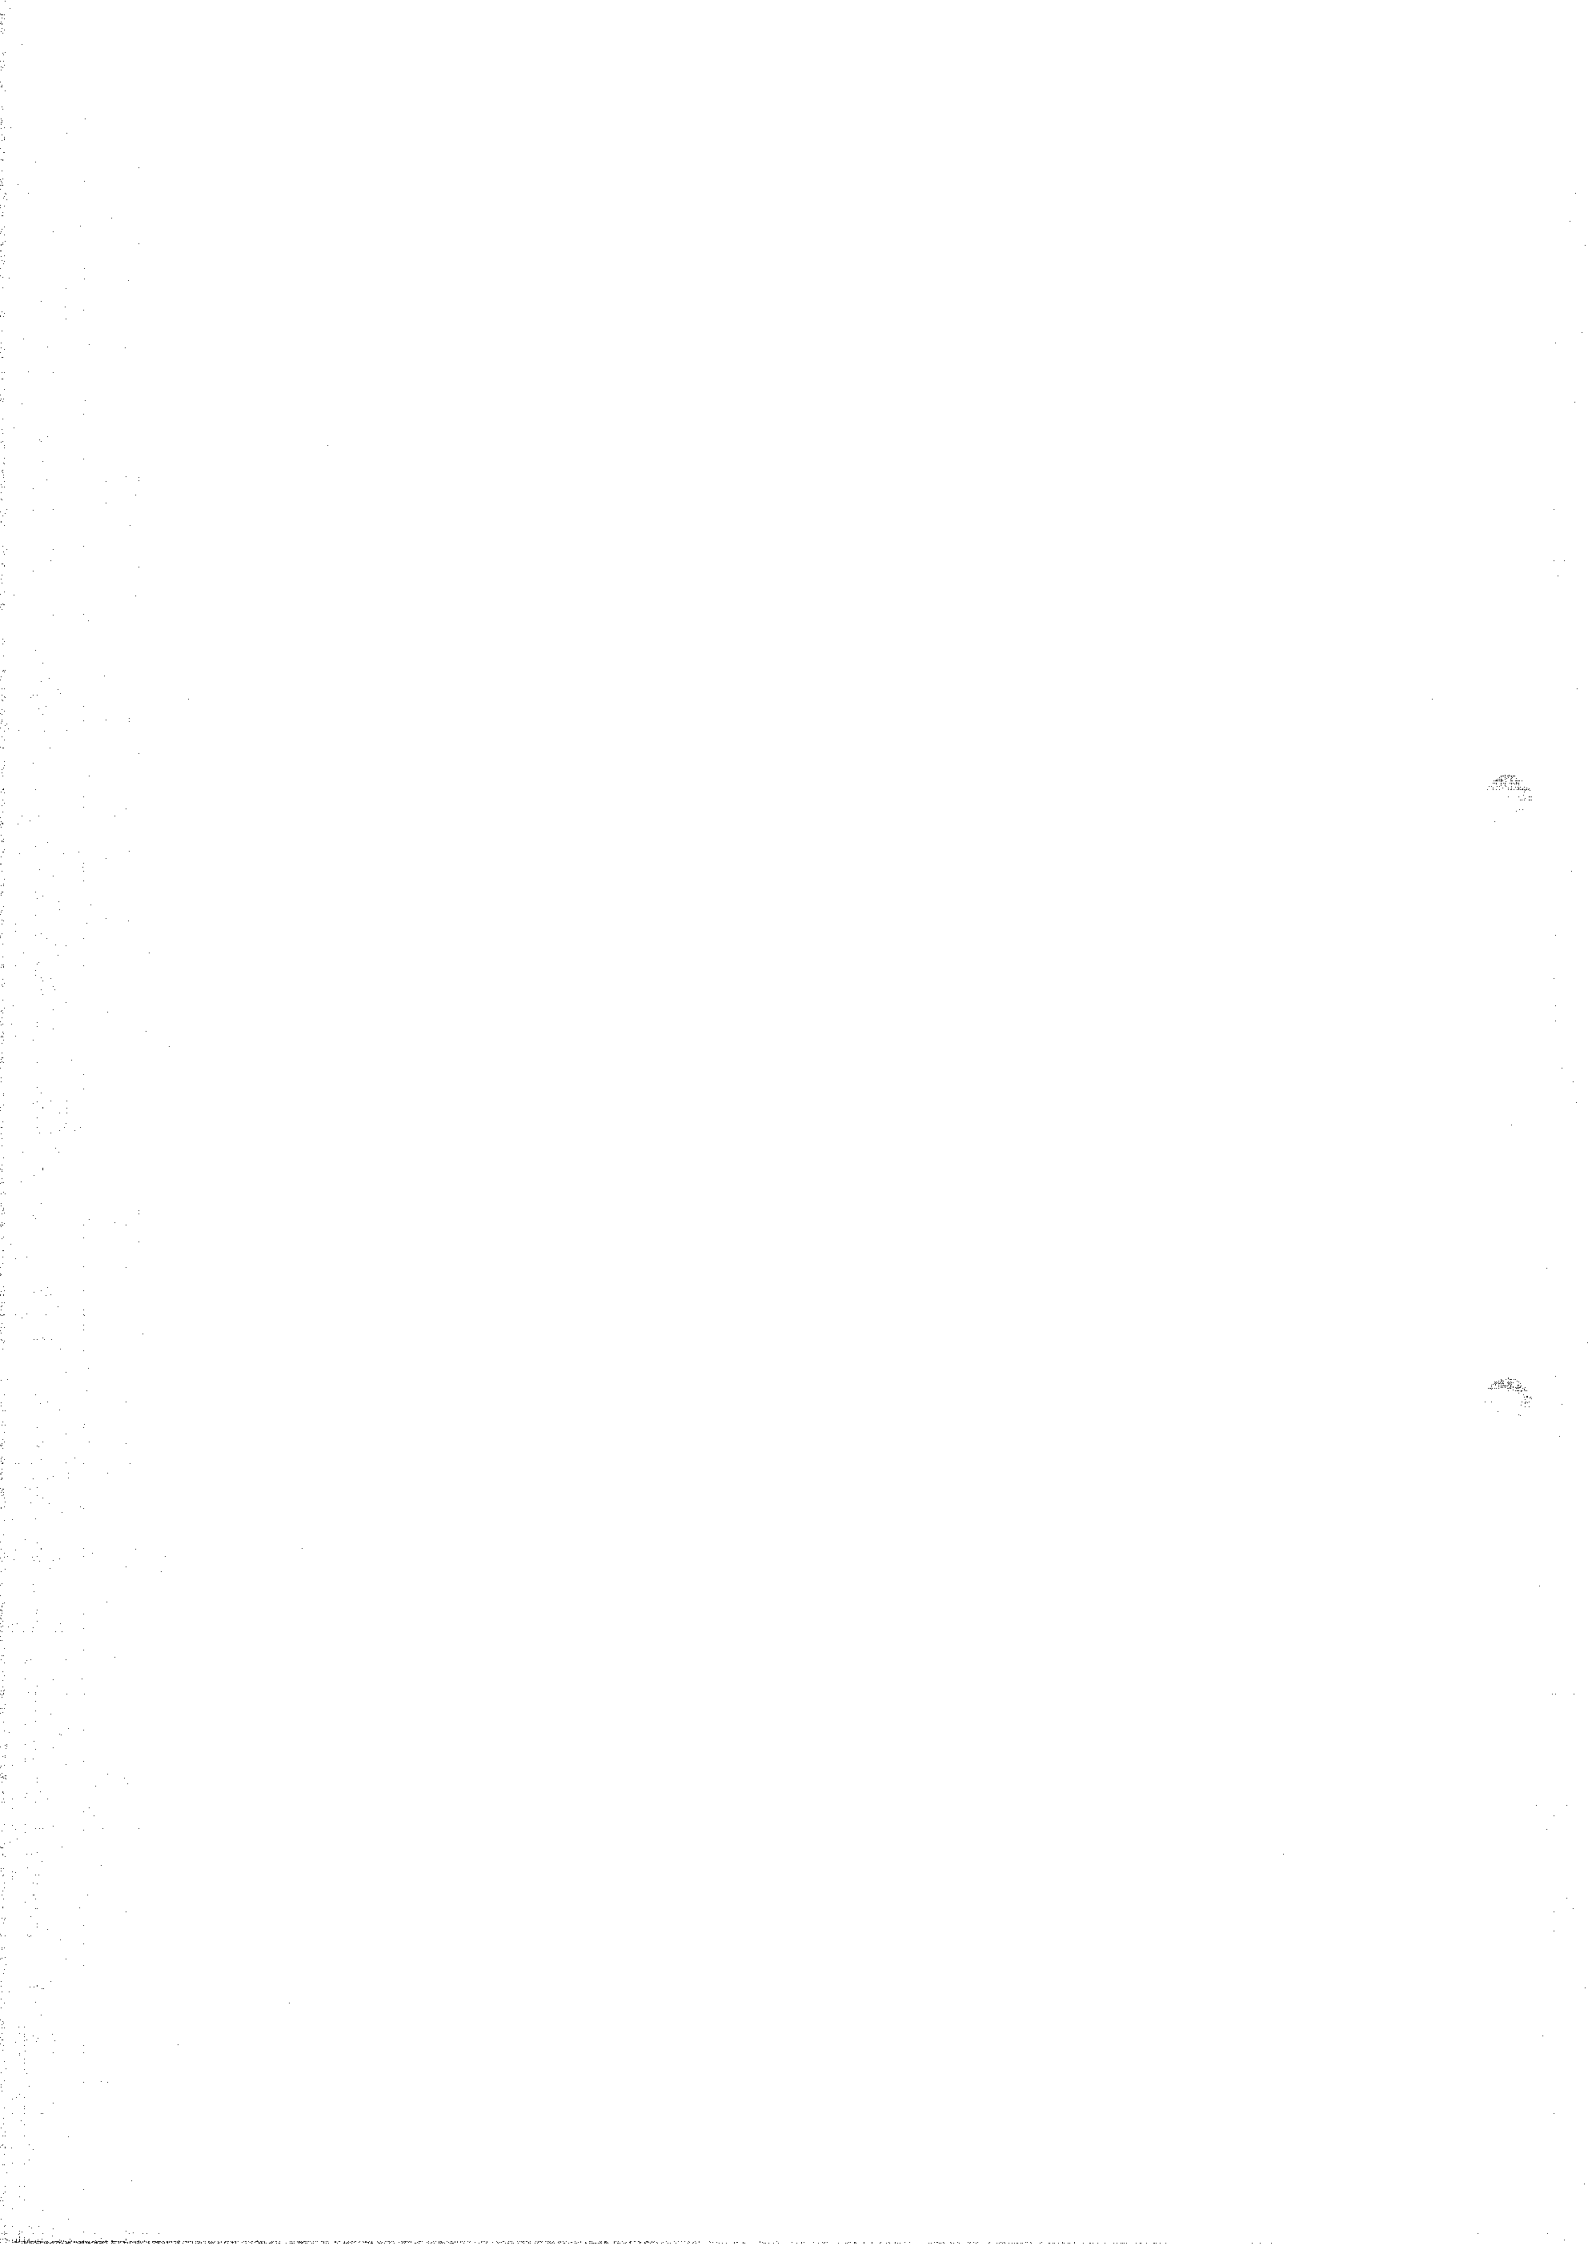
**TECHNICAL SPECIFICATION FOR
PNEUMATICALLY OPERATED
GLOBE VALVES HANDLING WATER**

CUSTOMER : NATIONAL THERMAL POWER CORPORATION LIMITED



NTPC: BONG: FGD: WVALVES-GLOBE VALVE SPEC-025: REV-01

**Flue Gas Desulphurization Group
Air Quality Control Systems
BAP :: BHEL :: Ranipet**



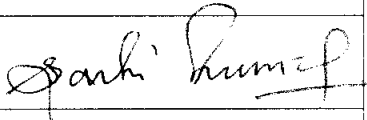


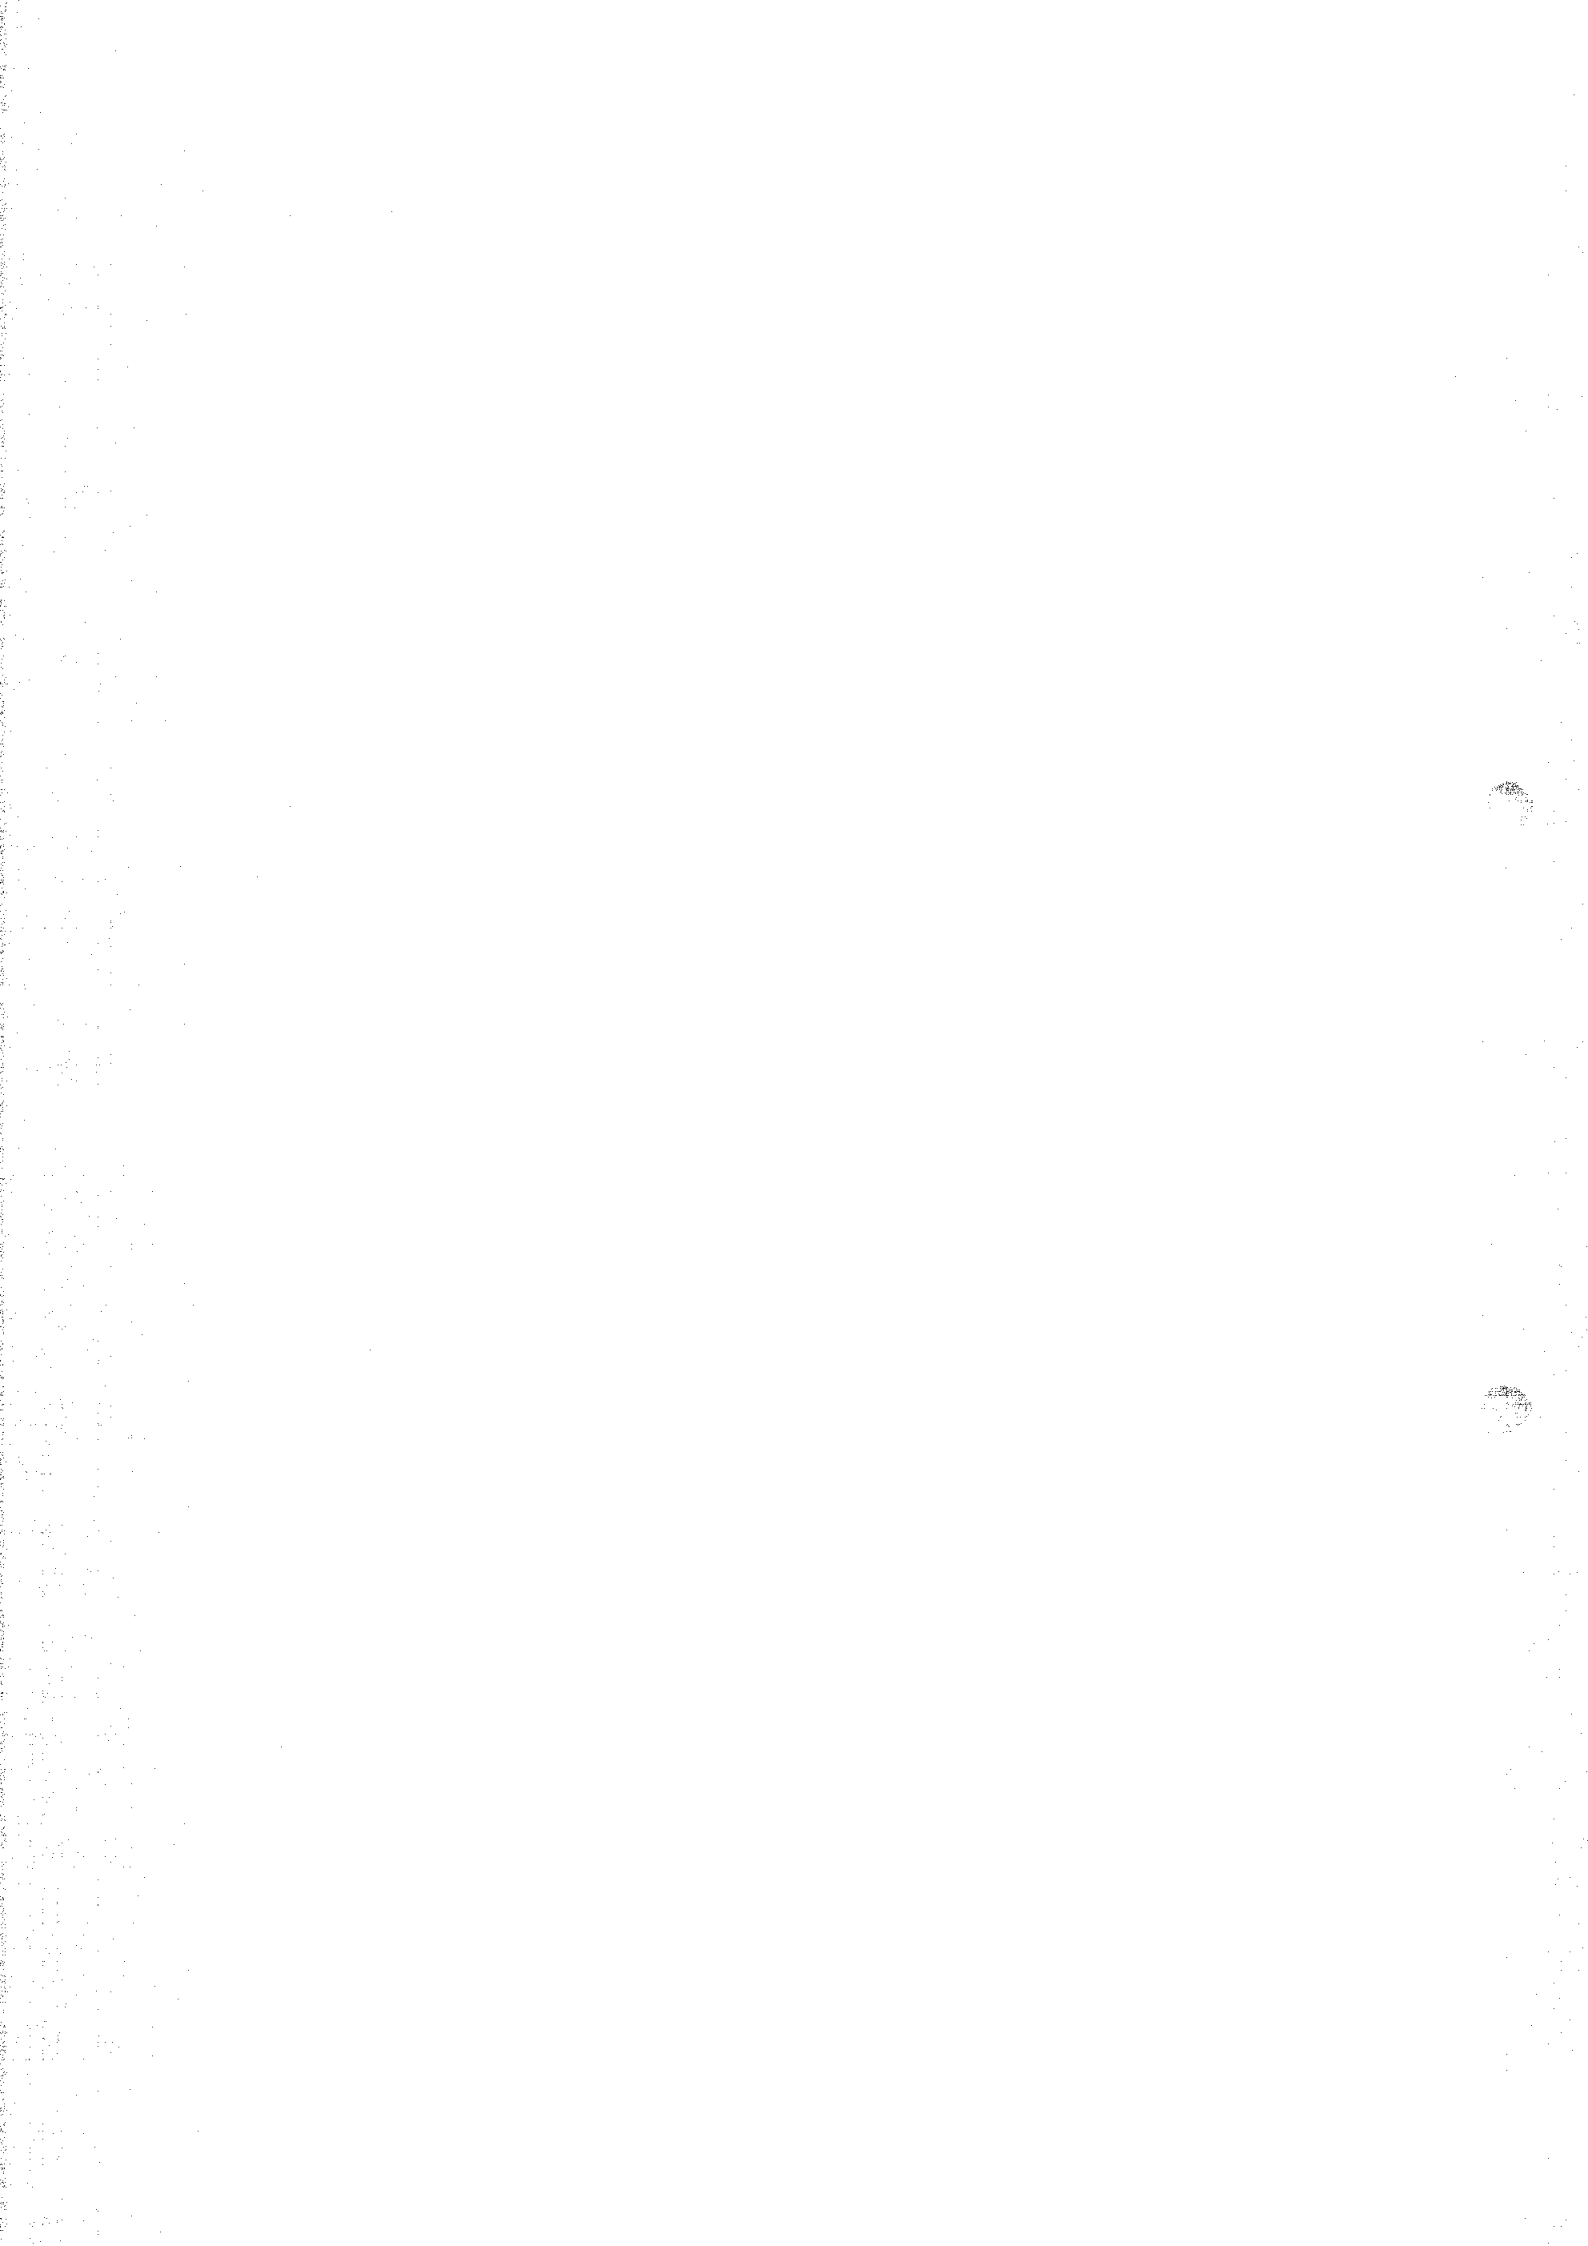


**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

TECHNICAL SPECIFICATION FOR PNEUMATICALLY OPERATED GLOBE VALVES HANDLING WATER

Prepared	Checked	Approved
		
ASHWIN R Engineer - FGD	MANOJ KUMAR THAKUR Engineer-FGD	SASHI KUMAR Senior Engineer-FGD
Rev 01 dated 04 09 2012		





**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

CONTENTS	
1.0	PROJECT INFORMATION
2.0	INTENT OF SPECIFICATION
3.0	STANDARDS AND CODES
4.0	SCOPE OF SUPPLY
5.0	SPECIFICATION FOR DESIGN / CONSTRUCTION / MATERIAL PARTICULARS
6.0	MATERIAL OF CONSTRUCTION
7.0	END CONNECTIONS
8.0	GLOBE VALVES
9.0	SPEIFIC REQUIREMENTS OF GLOBE VALVES
10.0	SPEIFIC REQUIREMENTS FOR PNEUMATIC ACTUATOR
11.0	LIMIT SWITCHES
12.0	NAME PLATE DETAILS
13.0	PAINTING
14.0	INSPECTION
15.0	DOCUMENTS AND DETAILS ALONG WITH BID
16.0	DOCUMENTS / SERVICE AFTER ORDER
17.0	DOCUMENTATION
18.0	GUARANTEE
19.0	VALVES DETAILS SHEET – ANNEXURE I
20.0	DATA SHEET FOR VALVES – ANNEXURE II
21.0	DATA SHEET FOR PNEUMATIC ACTUATOR – ANNEXURE III
22.0	FORM FOR TECHNICAL DEVIATIONS – ANNEXURE IV
23.0	PAINTING PROCEDURE – ANNEXURE V

R. K. Singh



TECHNICAL SPECIFICATION

FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

1.0	PROJECT INFORMATION	
	▪ Owner	NTPC
	▪ Buyer	BHEL, Ranipet
	▪ Process / application	Wet Lime Stone FGD system
1.1	SITE CONDITIONS	
	▪ Ambient temperature (Guarantee)	27 Deg C
	▪ Ambient temperature (Design)	50 Deg C
	▪ Height above sea level	47 m
	▪ Relative Humidity	60 %
1.2	LOCATION AND APPROACH	
	▪ Project location	
	▪ State	Assam
	▪ District	Kokrajhar
	▪ Place	Kumkuri near Salakati, Bongaigaon
	▪ Height above sea level	47 m

R. A. B. K.



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

2.0 INTENT OF SPECIFICATION

This specification together with the attendant Technical Data Sheet and other specifications/attachments to inquiry / order defines the minimum requirements for pneumatically globe valves along with their accessories /auxiliaries handling process water for use in the process of Flue gas Desulphurization (FGD) system.

Bidder shall make all possible efforts to comply strictly with the requirements of this specification and other specifications/attachments to inquiry/order.

In case, deviations are considered essential by the Bidder (after exhausting all possible efforts), these shall be separately listed in the Bidder's proposal under separate section, titled as "List of Deviations/Exceptions to the Enquiry Document (Annexure-IV)". Deviation shall be listed separately for each document with cross reference to Page No./Section/Clause No./Para etc. of the respective document supported with proper reasons for the deviation for purchaser's consideration. Any deviation, not listed under the above section, even if reflected in any other portion of the proposal, shall not be considered applicable. No deviation or exception shall be permitted without the written approval of the purchaser.

The design, material, construction, manufacture, inspection, testing and performance of valves shall comply with all currently applicable statutes, regulations and safety codes in the locality where the valves will be installed. The valves shall conform to the latest editions of applicable codes and standards as mentioned elsewhere. Nothing in this specification shall be construed to relieve the Bidder of his responsibility. Compliance to this specification shall not relieve the Bidder of the responsibility of furnishing equipment and accessories/auxiliaries of proper design, materials and workmanship to meet the specified start up and operating conditions.

In case the Bidder considers requirement of additional instrumentation, controls, safety devices and any other accessories/auxiliaries essential for safe and satisfactory operation of the equipment, he shall recommend the same along with reasons in a separate section along with his proposal and include the same in his scope of supply. The Bidder shall offer only proven design in successful operation.

3.0 STANDARDS AND CODES

Valves in general shall conform to the requirements of the following standards:
IS-778 Gun-metal gate, globe and check valves for general purpose.
BS-5154 Copper alloy globe/globe stop and check and gate valves for general purpose.
BS-5152 Specification for cast iron globe valves.
ANSI B 16.34 Standard for valves.
ANSI-B-16.10 Valves face to face and other relevant dimension.
API-598 Valves inspection test.

R. Ashwin



TECHNICAL SPECIFICATION

FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

4.0 SCOPE OF SUPPLY

- a) Valve as per specification
- b) Pneumatic actuator as per the specification No.
- c) Limit switch – 2 Nos. for each valves as per the spec.
- d) Air filter Regulator -1 No. per valve as per the spec.
- e) Solenoid valve – 1 No. for each valve as per the spec.

5.0 GENERAL SPECIFICATION FOR DESIGN/CONSTRUCTION/MATERIAL PARTICULARS OF GLOBE/ GLOBE STOP VALVE

- a) All valves shall be suitable for the service conditions i.e flow, temperature and pressure, at which they are required to operate.
- b) The valves as well as all accessories shall be designed for easy disassembly and maintenance.
- c) Valves to be installed outside shall be required to have the stem properly protected against atmospheric corrosion.
- d) For all globe and check valves, the direction of flow shall be clearly stamped on the body of the valve.
- e) All gate and globe valves shall have bonnet-back seating arrangement
- f) All rising stem valves shall be provided with back seat to permit repacking (of glands) with valves in operation. All valves shall preferably be of outside screw and yoke type.
- g) All valves shall be closed by rotating the hand wheel in the clockwise direction when looking at the face of the hand wheel. In case where the hand wheel is not directly attached to the valve spindle suitable gearing shall be introduced.
- h) All valves shall have indicators or direction clearly marked on the hand-wheel so that the valves opening/ closing can be readily determined.
- i) The actuator-operated valves shall be designed on the basis of the following :
 - (1) The internal parts shall be suitable to support the pressure caused by the actuators;
 - (2) The valve-actuator unit shall be suitably stiff so as not to cause vibrations, misalignments, etc.
 - (3) All actuator operated valves shall be provided with hand operated gearing mechanism also.
 - (4) All actuators operated valves shall open/ close fully within time required by the process but not later than 60 seconds after actuators starts.
- j) Globe valves shall be used for isolation/regulation purposes as provided in Annexure I. They shall be provided with hand wheel, position indicator, draining arrangement (wherever required) and arrow indicating flow direction. All globe valves shall be capable of being closed against the design pressure. Where globe valve has been specified for regulation purpose, the disc shall be tapered plug type and suitable for controlling throughout its lift.

2. Ashwin



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

- k) All globe valves shall be rising stem type and shall have limit switches for full OPEN and full CLOSED indication wherever required. This will include motor-operated valves also wherever required. In such cases the limit switches shall form an integral part of the valve. Stop-gap arrangement in this respect is not acceptable.
- l) All valves except those with rising stems shall be provided with continuous mechanical position indicators; rising stem valves shall have only visual indication through plastic/metallic stem cover for sizes above 50 mm nominal bore. Valves of 65 mm Nb & above with rising stem shall be provided with position indicator/visual indication either through plastic stem covers or through metallic stem covers.
- m) All globe valves shall be provided with bonnet-back seating arrangement to enable on line changing of gland packing.
- n) Hand wheels for all the valves shall close the valve in clockwise direction when viewing from the top. All hand wheels shall be clearly marked indicating the direction of opening/closing. Manual gear operators shall be provided to open/close the valve against the maximum differential pressure across the valve such that the effort required to operate the valve does not exceed 25 kgf.
- o) All globe valves shall be designed for reconditioning seating surfaces and replacement of stem and disc without removing the valve body from the line
- p) All valves shall be provided with embossed name plate giving details such as tag number, type, size etc.
- q) For gate, globe and check valves wherever thickness of body/bonnet is not mentioned in the valves standards, thickness mentioned in IS- 1538 for fitting shall be applicable.
- r) All valves shall be provided with proper name plates indicating complete information about the valves
- s) Where floors and extension spindle arrangements is required for valves, the height of floor stand shall be about one meter from the floor/platform. The floor stand shall be sturdy construction with column, nut plate and hand wheel made of the cast iron conforming to material ASTM-A-126 Grade B. Suitable thrust bearing shall be provided/between the hand wheel and floor stand. The connection of the extension spindle to the valve stem shall be through a flexible coupling and shall be designed to permit valve thermal movements. Necessary nuts, bolts etc. for mounting the floor stand on platform shall be provided.

6.0 MATERIAL OF CONSTRUCTION (GLOBE VALVE)

Material of Globe valves for flue gas application shall be as per enclosed **Annexure – I** or its equivalent.

Vendor shall provide the counter flange along with necessary nuts, bolts, gaskets etc. Material for counter flanges shall be the same as for the piping.

R. Adhikari



TECHNICAL SPECIFICATION

FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC-BONG-FGD-WVALVES-GLOBE VALVE-SPEC-025-REV-01

7.0 END CONNECTIONS

- a) End connection for Globe valves shall be as per enclosed **Annexure-I**.

8.0 GLOBE VALVES

The globe valves shall have the following characteristics:

- a) Straight conveyed flow, right angle preferably, the valves shall be of the vertical stem type.
- b) Globe valves shall preferably have radiused or spherical seating and discs shall be free to revolve on the spindle.
- c) The pressure shall preferably be under the disc of the valve. However, globe valves, with pressure over the disc shall also be accepted provided
 - (i) no possibility exists that flow from above the disc can remove either the disc from stem or component from disc
 - (ii) manual globe valves can easily be operated by hand. If the fluid load on the top of the disc is higher than 40-60 KN, bypass valve shall be provided which permits the downstream system to be pressurised before the globe valve is opened.
- d) Globe valves with NB smaller than or equal to 2" shall be of the integral type. Valves of this type shall be so as to permit the easiest disassembly of the internals (stem and disc).
- e) For the regulating valves, valves with regulating plug & parabolic outline disc type is preferred.

9.0 SPECIFIC REQUIREMENTS FOR GLOBE VALVES

- a) All valves shall be full port as per ANSI B 16.34.
- b) Locking arrangement, wherever specified shall be of non-detachable type.
- c) Valves shall be tested in accordance to ANSI B 16.34.
- d) All gate and globe valves shall be with outside screw and yoke with rising stem.
- e) Gate valves below 100 NB shall be solid wedge/flexible wedge type, valves of size 100 NB and above shall be of flexible wedge type. However, for sizes 100 mm and above for Temperatures above 300°C, parallel slide valves are also acceptable.
- f) Stem for all valves shall be heat treated and hardened - minimum, hardness 200 HB and surface finish of 16 RMS or better in area of stem packing.
- g) Gland packing for gate and globe valves shall be alloy steel/SS wire reinforced graphite with stem corrosion inhibitor.
- h) All bolts and nuts shall be ASTM A-193 Gr. B 7 and ASTM A-194 Gr. 2H respectively.
- i) Hand wheels for valves shall be of malleable iron / Carbon steel.
- j) Minimum differential hardness between seat and other disc material shall be 50 HB in case of 13% chrome hardened with heat treatment of steel.



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

- k) Valve closure test shall be as per ANSI B16.34 and MSS-SP-61. Acceptable maximum seat leakage shall be 2 ml of water per hour per 25 mm of nominal pipe size.
- l) Safety and Relief valves shall be supplied complete with discharge elbow and drip pan along with drain.
- m) For valves of size 65 NB and above in vacuum service, water gland sealing arrangement shall be provided. For valves of size 50 NB and below, deep gland packing shall be provided.

10.0 SPECIFICATION FOR PNEUMATIC ACTUATOR

- a) Quantity : 01 No. for each valve
- b) Type : Rotary actuator, Pneumatic (spring return)
- c) Action : Air to open
- d) Failure position (air failure) : Close
- e) Close/open at air Pressure : 4 to 6 Kg/sq.cm
- e) Air Connection : 1/4" NPT(F)
- f) Local Position Indicator : To be provided.
- g) Hand wheel for manual opn : Required (for valves greater than 8 inch)
- h) Actuator travel time : Vendor to specify
- i) Actuator Protection Class : IP-65 (Min)
- j) Actuator Thrust : Vendor to specify
- k) Spring range (kg/cm²) : Vendor to specify
- l) Speed adjustment for actuator operation : To be provided to facilitate speed adjustments both during opening & closing by means of flow control valve
- m) Solenoid valve type : 3/2 way, 24V DC power supply, ex. proof, 1/4" NPT pneumatic connection, 1/2" NPT Electrical connection. Solenoid Valve Energised for valve to open & Solenoid valve De-energised for valve to close.
- n) Air filter regulator : Size of filter shall be 5 Micron, Filter material shall be sintered bronze/equivalent, Body shall be aluminium, 1/4" NPT Pneumatic connection shall be envisaged.

11. LIMIT SWITCHES:

- a) Quantity /valve : One for Open & one for Close position
- b) No. of Contacts : Two normally open & two normally closed potential free contacts in each limit switch corresponding to open & close positions of the valve.

R. Ashir



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

- c) Contact Rating : 24 V DC
- d) Protection : Weather proof IP 55.
- e) Limit Switch Box : Limit Switch terminals shall be brought out to a Terminal Box

12.0 NAME PLATES DETAILS

Each valve shall be marked with rating plate or nameplate or label designating the tag number and service of the item etc.

13.0 PAINTING

The detailed painting procedure is enclosed in **Annexure-V**.
Bidder to note that if during transport, unloading/unpacking or erection at site any part of the painted surface gets damaged, the same shall be made good by the contractor by repainting with compatible painting primer and enamel to the satisfaction of the project manager.

14.0 INSPECTION

The valves shall be inspected at Vendor's works by BHEL Engineer as per the procedure submitted by the Vendor.

15.0 DOCUMENTS / DETAILS ALONG WITH BID

- The following information / documents shall be submitted along with the offer
- a. Duly filled up data sheet for each valve type as per **Annexure-II and III** in the enclosed format.
 - b. Detailed assembly drawing with overall dimensions.
 - c. Valve cross sectional drawings with Bill of Material including the material specifications.
 - d. Valve Regulation Characteristic Curve.
 - e. Cv calculation.
 - f. List of applicable standards for shop test.
 - g. Reference list for the offered model.
 - h. Typical Quality plan for supply of the above equipments.
 - i. Valves Catalogues.
 - j. List of commissioning spares.
 - k. Recommended spares list for 3 year O&M along with item wise price.
 - l. Any deviation shall be specifically mentioned in the enclosed deviation format **Annexure-IV**.

In case of any deviation, the Bidder shall indicate the deviation, clause by clause in the deviation format attached in **Annexure-IV**. If there is no deviation "NIL" statement shall be furnished. In the absence of **Annexure-IV**, it will be construed that the bid confirms strictly to the specification. Acceptance or rejection of the offer with



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

or without deviations (either fully or partially) is sole discretion of the purchaser without seeking further clarification from the bidder.

NOTE: Bidders to note that failing to submit the above documents, the bid shall be considered as incomplete and liable for rejection.

16.0 DOCUMENTS / SERVICE AFTER ORDER

16.1. The following documents are to be submitted for BHEL's approval.

- Duly filled up data sheet in the enclosed format.
- Detailed assembly drawing with overall dimensions.
- Valve cross sectional drawings with Bill of Material including the material specifications.
- C_v Calculation
- Quality plan

16.2. The following are to be submitted to BHEL's review and acceptance.

- Material test certificate
- Hydraulic & Leak test certificates
- Performance guarantee certificate
- Erection manual
- O&M manuals

17.0 DOCUMENTATION

- a. The documentation during bid and post order stage shall meet the following requirements.
- b. All documents and drawings shall be submitted in English.
- c. Hard copies of all documents and drawings during bid stage to be submitted in duplicate.
- d. Hard copies of all documents for approval to be submitted in triplicate.
- e. Hard copies of all final documents, drawings, manual etc., shall be submitted in bound folder in duplicate.
- f. Soft copies of all final documents in MS office in the form of CD-1 set.
- g. Soft copies of all final drawings in AutoCAD, latest version in form of CD-1 set

18.0 GUARANTEE

The Vendor shall provide guarantee for a period of 12 months from the date of commissioning or 24 months from the date of supply whichever is earlier.

R. Ashu



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

ANNEXURE-I

20.0 DETAILED LIST OF VALVES WITH OPERATING PARAMETERS

Indent no		RFW00092							
Material Code		RFW000920001							
Process Liquid		Process water Application							
Service		Isolation							
Type of valve		Globe Valve							
Mode of Operation		Pneumatic							
Size		1 inch							
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connectio n (SWD- SOCKET WELDED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
00HTS01AA203	50	3	100	10	A216 WCB	A217 CA15	A479-410	SWD	1

Indent no		RFW00092							
Material Code		RFW000920002							
Process Liquid		Process water Application							
Service		Isolation							
Type of valve		Globe Valve							
Mode of Operation		Pneumatic							
Size		4 inch							
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connectio n (FLD- FLANGED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
00HTQ03AA201	50	5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1
00HTQ03AA202	50	5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1



TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

Indent no	RFW00092									
Material Code	RFW000920003									
Process Liquid	Process water Application									
Service	Isolation									
Type of valve	Globe Valve									
Mode of Operation	Pneumatic									
Size	6 inch									
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connectio n (FLD- FLANGED)	QTY	
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem			
00HTQ01AA201	50	10	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ01AA202	50	10	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ01AA203	50	5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ01AA204	50	5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ01AA205	50	5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ02AA206	50	3.5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ02AA207	50	3.5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ02AA203	50	3.5	100	10	A216 WCB	SS304	SS304	FLD	1	
00HTQ02AA204	50	3.5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	
00HTQ02AA205	50	3.5	100	10	A216 WCB	A217 CA15	A479- 410	FLD	1	

R. J. F.



TECHNICAL SPECIFICATION

FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC, BONG, FGD, WVALVES-GLOBE VALVE-SPEC-025-REV-01

Indent no	RFW00092								
Material Code	RFW000920005								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	8 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
00HTQ02AA201	50	0.5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1
00HTQ02AA202	50	0.5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1

MANDATORY SPARE

Indent no	RFW20113								
Material Code	RFW201130001								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	1 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (SWD-SOCKET WELDED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
M1-GBV-PN-PW-1	50	3	100	10	A216 WCB	A217 CA15	A479-410	SWD	1

[Handwritten signature]



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVVALVES-GLOBE VALVE-SPEC-025: REV-01

Indent no	RFW20113								
Material Code	RFW201130002								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	4 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connectio n (FLD- FLANGED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
M1-GBV-PN-PW-4	50	5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1

Indent no	RFW20113								
Material Code	RFW201130003								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	6 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connectio n (FLD- FLANGED)	QTY
	T (°C)	P (Kg/cm ²)	T (°C)	P (Kg/cm ²)	Body Material	Disc	Stem		
M1-GBV-PN-PW-6	50	5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1

R. Aggarwal

**TECHNICAL SPECIFICATION**

FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**BHEL Document No.: NTPC/BONG/FGD/WVALVES-GLOBE VALVE-SPEC-025-REV-01**

Indent no	RFW20113								
Material Code	RFW201130004								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	2 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (SWD-SOCKET WELDED)	QTY
	T (°C)	P (Kg/cm²)	T (°C)	P (Kg/cm²)	Body Material	Disc	Stem		
M1-GBV-PN-PW-2	50	2	100	10	A216 WCB	A217 CA15	A479-410	SWD	1

Indent no	RFW20113								
Material Code	RFW201130005								
Process Liquid	Process water Application								
Service	Isolation								
Type of valve	Globe Valve								
Mode of Operation	Pneumatic								
Size	8 inch								
Valve / Instrument Tag No	Operating Conditions		Design Conditions		Material of Construction			End Connection (FLD-FLANGED)	QTY
	T (°C)	P (Kg/cm²)	T (°C)	P (Kg/cm²)	Body Material	Disc	Stem		
M1-GBV-PN-PW-8	50	5	100	10	A216 WCB	A217 CA15	A479-410	FLD	1

Note:

All valves shall be provided with embossed name plate giving details such as tag number, type, size etc.



**TECHNICAL SPECIFICATION
FOR
PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION**

BHEL Document No.: NTPC: BONG: FGD: WVALVES-GLOBE VALVE-SPEC-025: REV-01

ANNEXURE-II

21.0 DATA SHEET FOR VALVES (TO BE FILLED SEPARATELY FOR EACH TYPE OF VALVE)

I. TECHNICAL PARAMETERS

- A. VALVE SIZE :
- a. Make :
- b. Model/ Type :
- c. Fluid details - Medium handled :
- Temperature range °C :
- d. Rated flow m³/Hr :
- e. Design Cv of the valve :
- f. Valve rating :
- g. Valve operation- (Lever/ Gear box) :
- h. Pressure Drop for rated flow bar(g) :
- i. Design pressure bar(g) :
- j. Hydraulic test pressure
- Body bar(g) :
- Seat bar(g) :
- k. Max. Shut off pressure bar(g) :

II. CONSTRUCTION DETAILS

- a. Material of construction
- Body :
- (whatever applicable) - Ball :
- Stem :
- Disc :
- Seat :
- Bushing :
- Handle :
- Fasteners :
- b. End Connection / Rating / Standard :
- c. Recommended minimum pipe ID mm :
- d. Details of Gearbox if applicable :

III. GENERAL

- a. Weight per valve :
- b. Applicable standards :
- c. Valve GA Drawing / Cross Sectional Drg. :
- d. Enquiry / PO reference :

R. Aggarwal



TECHNICAL SPECIFICATION
FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC-BONG-FGD-WVALVES-GLOBE VALVE-SPEC-025-REV-01

ANNEXURE-III

22.0 DATA SHEET FOR PNEUMATIC ACTUATOR

1) ACTUATOR

- a) Make :
- b) Model :
- c) Type :
- d) Torque rating :
- e) Air consumption :
- f) Operating time for opening :
Operating time for closing :
- g) Accessories offered :
- h) Type of stay put :
- i) Air Connection :

2) LIMIT SWITCH

- a) Make :
- b) Type :
- c) Quantity :
- d) Contact rating :
- e) Reset type :



TECHNICAL SPECIFICATION
FOR

PNEUMATIC GLOBE VALVES FOR PROCESS WATER APPLICATION

BHEL Document No.: NTPC-BONG-FGD-WVALVES-GLOBE VALVE-SPEC-025-REV-01

ANNEXURE-V

24.0 PAINTING PROCEDURE:

Primer Coat		Intermediate Coat		Finish coat			Total DFT μm (min)
Paint	No of Coats /DFT	Paint	No of Coats	Paint	No of Coats	Shade	
HB Chlorinated Rubber based Zinc Phosphate Primer DFT= 50 μm per coat (Solid by Volume min 60%)	2	--	—	Chlorinated Rubber Based Finish paint DFT= 30 μm per coat (Solid by Volume min 60%)	2	Gray shade to R9002	160

R. A. E.