



भारत हेवी इलेक्ट्रिकल्स लिमिटेड
BHARAT HEAVY ELECTRICALS LIMITED
(A Government of India Undertaking)
पारेषण व्यापार समूह, नोएडा/Transmission
Business Group, Noida

निविदा आमंत्रण सूचना
NOTICE INVITING TENDER

Sir/Madam,

Bharat Heavy Electricals Limited (hereinafter referred to as BHEL) is a Central Public Sector Enterprise, having its Branch office at Transmission Business Group, BHEL, Plot no.:- 25, Sector-16A, Noida, Distt. Gautambudh Nagar, UP-201301, invites offer in sealed cover under two part bid system (Part-I: Techno commercial Part & Part-II: Price Part) from the competent agencies for “Supply of PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES for 400/220/132kV GIS SUBSTATION AT SHAMLI, UP”

Please submit your competitive offer for the above subject work as per the tender terms & conditions.

SCHEDULE TO TENDER

1.	Tender Enquiry No.	21Q2400200
2.	Date of Issue of Tender:	31.10.2023
3.	Type of Tender:	Open Tender
4.	Tender Title:	“Supply of PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES for 400/220/132kV GIS SUBSTATION AT SHAMLI, UP”
5.	Tender issuing Authority	Transmission Business Group, BHEL, Plot no.:- 25, Sector-16A, Noida, Distt. Gautambudh Nagar, UP-201301
6.	Last date/ time for receipt of tender:	10.11.2023 11:00 Hrs IST
7.	Date/ time of opening of (Part-I):	10.11.2023 16:00 Hrs IST
8.	Offer/Bid submission mode	Tender is invited through e-Procurement System only. The bidder shall submit their bid through e-Procurement platform at https://eprocurebhel.co.in .
9.	Tender will be opened at:	BHEL TBG– HQ Noida of above mentioned address at point no. 5.
10.	Date/Time of price bid opening:	Will be intimated separately to the Techno-commercially qualified bidders in due course of time.
Note:- For other instructions; bidder may please refer the Terms & Conditions and Special terms & conditions		

All corrigenda, addenda, amendments, Bid Submission extension, clarifications, etc. to the tender will be hosted on website <http://www.bhel.com> and <https://eprocurebhel.co.in> only. Bidders should regularly visit website till the due date of submission to keep themselves updated. Any clarification(s) regarding Notice Inviting Tender (NIT), if required, should be sought before the tender due date from the officials as mentioned in the tender Document.

Thanking you,

For & on behalf of
Bharat Heavy Electricals Ltd.

Transmission Business Group, BHEL, Plot no.:- 25, Sector-16A, Noida, Distt. Gautambudh Nagar, UP-201301

पंजीकृत कार्यालय: बी.एच.ई.एल. सिरी फोर्ट, नई दिल्ली 110049 -
Regd. Office : BHEL HOUSE, Siri Fort, New Delhi - 110049

TABLE OF CONTENTS/ INDEX

PART-I

Sections/Annexures	Contents
1	NOTICE INVITING TENDER
2	TABLE OF CONTENTS
3	Special TERMS & CONDITIONS OF TENDER
4	STANDARD GENERAL TERMS & CONDITIONS (Doc. No.:- BHEL/TBG/GTC/2016 Rev 01)
5	Pre-Qualifying requirement-Annexure-I (Annexure_TQR) Technical/Qualifying Requirement
6	Activity Schedule (Annexure-II),
7	List of ANNEXURES :- i) Billing Checklist - (Annexure-III) ii) Arbitration:- (Annexure-IV) iii) Format for declaration of minimum local content (Annexure-V). iv) Instruction of DPIIT Compliance to GOI Order for restrictions under Rule 144 (xi) of General Financial Rules (GFRs), 2017 (Annexure-VI, VII/ VIII (whichever applicable) v) MOP circular dated 02-07-2020 and its subsequent amendment, if any, in prescribed format (Annexure-IX/ X). vi) Format of Integrity pact (Annexure-XI)- Not applicable
8	BHEL's UNPRICE BID FORMAT (Bidders has to be mark "Quoted" Only)
9	Technical Specification No.:- TB-406-316-TI-02A E Rev 00
10	Format of Performance BG
11	LIST OF BANKS FOR THE SUBMISSION OF PERFORMANCE BANK GUARANTEE
12	Commercial and Technical deviation sheet

PART-II

1	PRICE BOQ - BIDDER has to quote their price in the On line (https://eprocurebhel.co.in) Price Bid format Only.
----------	---

Project: UPPTCL Shamli

Item : Supply of Partial Discharge Detector

1. For any technical clarification, please contact Mr. Manvender Singh Pundir, Manager (TBEM); Contact No. 0120-6748512; e-mail: manvender@bhel.in
2. For any commercial clarification, please contact Mr. P K Mishra, Manager (TBMM); Contact No. 0120-6748575; e-mail: piyush.kumar@bhel.in
3. **Technical PQR** – As per Annexure.
4. Vendor to quote prices on FOR destination basis including GST.
5. **Vendor Approval**- Bidder's offer will be acceptable subject to final acceptance by end customer. Bidders to provide Performance Certificate (state electricity boards, PSUs etc.), supply experience in Power grid (if available) with supporting documents, details of testing facilities etc. for approval along with bid documents.
6. Bidder to refer BOQ as per Annexure-I.
7. **Delivery period**- As per activity schedule
8. **Local content** - For this procurement, the local content to categorize a supplier as class-I local supplier / class-II local supplier / Non-Local supplier and purchase preference to class-I local supplier, is as defined in Public Procurement (Preference to Make in India), Order 2017 dated 04.06.2020, issued by DPIIT. In case of subsequent orders issued by the nodal ministry, changing the definition of local content for the items of the NIT, the same shall be applicable even if issued after issue of this NIT but before opening of part-II bids against this NIT.

"This tender is a global tender and in Global tender enquiries, "Non-local suppliers "shall also be eligible to bid along with "Class-I local suppliers" and "Class-II local suppliers"

9. **Tender Evaluation (Clause No. 17 of GTC)**- Comparative statement shall be prepared and evaluated on total cost basis in INR at destination/site (as per terms of NIT) after considering input credit for GST

In respect of price quoted by bidders in currency other than INR,, Exchange rate (TT selling rate , State Bank Of India), as applicable on latest date of Tender Opening (I.e extended date as per latest corrigendum for Technical Bids) shall be considered for the purpose of calculation of equivalent INR.

If relevant day happens to be a bank holiday, then forex rate as on previous bank (SBI) working day shall be taken for tender evaluation.

Evaluation in case of more than one L-1 bidders - In the course of evaluation, if more than one bidder happens to occupy L-1 status, effective L-1 will be decided by soliciting discount from respective L-1.

In case more than one bidder happens to occupy the L-1 status even after soliciting discounts, the L-1 bidder shall be decided by a toss/draw of lots, in the presence of the respective L-1 bidder(s) or their representative(s).

Ranking will be done accordingly. BHEL's decision in such situations shall be final and binding.

10. **Payment Terms** –Payment within 45 days from the date of receipt of complete invoice for Micro and Small suppliers, 60 days for medium Suppliers and within 90 days for other suppliers. TBG is

Project: UPPTCL Shamli

Item : Supply of Partial Discharge Detector

registered with RXIL (TReDS) platform. MSME Bidders are requested to get registered with RXIL (TReDS) platform to avail the facility as per the GOI guidelines.

For Indian Bidder -

- a) 95% of payment within 45 days from the date of receipt of complete invoice for Micro and Small suppliers, 60 days for medium Suppliers and within 90 days for other suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
- LR / GR duly endorsed by BHEL Site Official.
 - Material Receipt Certificate issued by BHEL Site Official/ CRAC.
 - GST Compliant Tax Invoice
 - Packing List (Case-wise)
 - Copy of Transit Insurance Certificate from underwriters.
 - Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management
 - Guarantee Certificate
 - Copy of Performance Bank Guarantee (PBG)
- b) 5% of payment within 45 days from the date of receipt of complete invoice for Micro and Small suppliers, 60 days for medium Suppliers and within 90 days for other suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows
- - Certificate of satisfactory Demonstration completion of Instrument issued by BHEL site.

For Foreign Bidder:-

- a) a) 95% of payment within 45 days from the date of receipt of complete invoice for Micro and Small suppliers, 60 days for medium Suppliers and within 90 days for other suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
- Invoice
 - Delivery Challan (if applicable) or Packing List (Case wise)
 - Certificate of Origin
 - Transit Insurance certificate from under writers or copy of intimation of Transit Insurance duly endorsed by under writers (if applicable)
 - Material Inspection Clearance Certificate (MICC) issued by BHEL
 - Guarantee Certificate
 - Copy of Performance Bank Guarantee (PBG)
- b) 5% of payment within 45 days from the date of receipt of complete invoice for Micro and Small suppliers, 60 days for medium Suppliers and within 90 days for other suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows
- Certificate of satisfactory Demonstration completion of Instrument issued by BHEL site.

11. Liquidated Damage for Supply (Clause no. 13 of BHEL/TBG/GTC/2016 Rev.01): In case of delay in execution of Purchase Order beyond the contractual delivery time, an amount of 0.5% of the total PO Ex-Works value & F & I Charges for supply per week of delay or part thereof subject to a maximum of 10% of the total PO Ex-Works value & F & I Charges shall be deducted as Liquidated Damages (LD) along with applicable GST (if any) on LD.

12. Guarantee Clause- The equipment / material supplied and services rendered (if applicable) shall be guaranteed to be free from all defects and faults in design & engineering, material, workmanship & manufacture and in full conformity with the Purchase Order / Contract, Technical Specifications & approved drawings / data sheets, if any, for 18 months from the date of last delivery or 12 months from the date of commissioning, whichever is earlier.

13. Performance BG / Deposit Clause (Clause no. 7 of BHEL/TBG/GTC/2016 Rev.01): Supplier shall arrange to submit Performance BG / Deposit of 10% of the total Ex Works PO value on a non-judicial stamp paper of appropriate value along with first invoice or within 60 days from placement of

Project: UPPTCL Shamli

Item : Supply of Partial Discharge Detector

Purchase Order (PO) whichever is earlier. PBG should valid till guarantee period with claim period of 3 months extra over and above guarantee period.

Ex-works PO value at the time of placement of PO shall be considered for calculation of the PBG amount.

“Bidder agrees to submit performance security required for execution of the contract within the time period mentioned. In case of delay in submission of performance security, enhanced performance security which would include interest (SBI rate + 6%) for the delayed period, shall be submitted by the bidder. Further, if performance security is not submitted till such time the first bill becomes due, the amount of performance security due shall be recovered as per terms and conditions defined in NIT / Contract, from the bills along with due interest.”

14. REVERSE AUCTION: “BHEL shall be resorting to Reverse Auction (RA) (Guidelines as available on www.bhel.com) for this tender. RA shall be conducted among the techno commercially qualified bidders. Price bids of all techno-commercially qualified bidders shall be opened and same shall be considered for RA. In case any bidder(s) do(es) not participate in online Reverse Auction, their sealed envelope price bid along with applicable loading, if any, shall be considered for ranking.”

Abridged Version of “Guidelines for Reverse Auction-2021” may also be seen at BHEL website (www.bhel.com) on “Supplier Registration” Page. Offer of techno – commercially acceptable vendors shall be considered for conducting Reverse Auction subject to their approval from Customer.

15. Validity of Purchase Order: Purchase Order shall be valid for two years from the date of Purchase Order.

16. MOP Circular : APPLICABLE

17. INTEGRITY PACT: Not Applicable.

18. BHEL Supplier Registration Portal- The link for Online Supplier registration Portal is <https://supplier.bhel.in/>. The link for Online Supplier Registration Portal may also be seen at BHEL website (www.bhel.com) on “Supplier Registration” Page.

19. Bidders to submit below documents alongwith their offer but not limited to:

- (a) PAN, GST, Certificate of Incorporation
- (b) Factory Registration Certificate
- (c) Overall organization Chart with Manpower Details (Design/Manufacturing/Quality etc.)
- (d) List of Plant and Machinery
- (e) List of Testing and Measuring equipment
- (f) Third party approval, if any (viz. ISO, BIS)
- (g) Pollution clearance wherever applicable
- (h) Energy conservation & Efficiency Report (Applicable to industries having contact load more than 100KVA)
- (i) Manufacturing Quality Plan (MQP)
- (j) List of past supplies references along with copy of major PO
- (k) Performance certificate from end user
- (j) Photographs of factory, plant and machinery & testing facilities

20. Clause No. 22 of GTC - Breach of contract, Remedies and Termination- In case of breach of contract, wherever the value of security instruments like performance bank guarantee available with BHEL against the said contract is atleast 10% of the contract value, the same be encashed. In case the value of the security instruments available is less than 10% of the contract value, the balance

Project: UPPTCL Shamli
Item : Supply of Partial Discharge Detector

amount be recovered from other financial remedies (i.e. available bills of the contractor, retention amount, etc. with BHEL) or legal remedies be pursued. The balance scope shall be got done independently without Risk & Cost of the failed supplier/ contractor. Further, levy of liquidated damages, debarment, termination, de-scoping, short-closure, etc., shall be applied as per provisions of the contract.

21. Clause No. 2.1 of GTC - Prices shall be on FIRM basis including packing and forwarding charges. Vendor to quote prices on FOR destination basis including GST. Export worthy packing shall be applicable as per specification. However, bidder to ensure proper packing to avoid any damage & packing of spares should be separated

22. Bidder to mention their works address below from where material will be supplied to Site.

Works Address- -----

Communication Address- -----

Person Name - -----
Email ID – -----
Contact no. - -----

IMPORTANT INSTRUCTION:

“We confirm that we have quoted as per specified price format provided along with this tender”.

NAME & SEAL OF TENDERER

ANNEXURE-1 (BOQ)

Sl. No.	Description	Qty	Unit
1.	SUPPLY- INSTRUMENTS : PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES	1	No.

**BHARAT HEAVY ELECTRICALS LTD.
(TRANSMISSION BUSINESS GROUP)**

GENERAL TERMS AND CONDITIONS FOR TENDER ENQUIRY / CONTRACT

This is to be submitted duly signed by bidder in original. Clause-wise deviations and / or additional conditions / clarifications, if any, are to be brought out clearly in “Schedule of Commercial Deviation”. Deviations and / or additional conditions / clarifications, if any, mentioned elsewhere in the bid / offer, shall not be considered.

Sr. No.	
1.	<p>INSTRUCTION TO BIDDERS :</p> <p>1.1 Sealed bids are invited for the items mentioned in the tender enquiry conforming to the NIT including Technical Specifications. Bids should be typed and free from overwriting and erasures. Corrections or additions / deletions, if any, must be clearly written and attested, otherwise offer may be rejected.</p> <p>1.2 Bidder must ensure that their bid is submitted / dropped in the tender box on or before 14-00 Hrs. IST on the due date of opening, unless otherwise specified in the NIT, at the address as follows :-</p> <p style="padding-left: 40px;">Tender Box, Materials Management, Transmission Business Group, Bharat Heavy Electricals Limited, 5th Floor, Tower-A, Advant Navis IT Business Park, Plot-7, Sector-142, Noida Expressway, Noida, Dist. G. B. Nagar, U. P. – 201305</p> <p>1.3 In case tender enquiry is floated through the e-procurement system, offer / bid has to be submitted through the e-procurement system ONLY as per instructions given in the e-procurement portal (https://bheleps.buyjunction.in).</p> <p>1.4 The bids shall be opened at 14-30 Hrs. IST on the due date of opening, in the presence of participating bidders who may like to be present, unless otherwise specified in the NIT. Bids received late are liable for rejection. Bidders sending bids by courier or post will have to ensure that it is timely delivered at the above address.</p> <p>1.5 Bids are to be submitted duly signed with seal in two parts :-</p> <p style="padding-left: 40px;">a) Techno-commercial Bid (Part-I) – To be submitted in 2 sets (original + copy). A copy of Price Bid (Part-II) clearly mentioning all the necessary information as per format without prices “Un-Priced Bid” is also to be enclosed in Part-I Bid.</p> <p style="padding-left: 40px;">b) Price Bid (Part-II) – To be submitted only in one set in a separate sealed envelope. This should not contain any Technical and / or Commercial Terms and Conditions. The rates should be quoted both in figures and words.</p> <p>1.6 The Part-I and Part-II Bids are to be sealed in separate envelopes and marked</p>

Sr. No.	
	<p>as “Techno-commercial Bid (Part-I)” and “Price Bid (Part-II)” respectively. Both the envelopes are to be kept in another common envelope and marked as “BID”. Each envelope should be sealed and super scribed with tender enquiry no., item / package name, project name and due date of opening. Bidder’s name and address shall also be mentioned on each envelope.</p> <p>1.7 For any technical clarification, please contact official mentioned in the tender enquiry / NIT.</p> <p>1.8 For any commercial clarification please contact official issuing tender enquiry / NIT.</p> <p>1.9 Price bid (Part-II) should not contain any additional information / description other than given in “Un-Priced Bid” submitted with “Techno-commercial Bid (Part-I)” except prices, otherwise bid is liable for rejection.</p> <p>1.10 Price Bid submitted along with the bid shall remain valid up to validity of offer. Any discount / revised offer submitted by the bidder on its own shall be accepted provided it is received before the due date and time of offer submission (i.e. Part-I Bid). The discount shall be applied on pro-rata basis to all items including optional items, if any, unless specified otherwise by the bidder. Discount offered shall be valid for full duration of validity of the offer including extension of validity, if any. Unsolicited Supplementary / Revised Price Bid submitted after the due date and time of offer submission (i.e. Part-I Bid), during validity period of offer, unless asked by BHEL, shall not be considered. Withdrawal of quotation by the bidder, at any stage after its opening, may entail suitable action against such bidder by BHEL.</p> <p>1.11 The consultants / firm (and any of its affiliates) shall not be eligible to participate against tender enquiry for the related goods or works or services for the same project, if they were engaged by BHEL-TBG for the consultancy services.</p> <p>1.12 In case any Foreign OEM / Foreign Principal insists on engaging the services of an agent, such agent shall not be allowed to represent more than one manufacturer / supplier in the same tender. Moreover, either the agent could bid on behalf of the manufacturer / supplier or the manufacturer / supplier could bid directly but not both. In case bids are received from the manufacturer / supplier and the agent, bid received from the agent shall be ignored.</p> <p>1.13 Non-conformities / errors / discrepancies in quoted prices in price bids shall be dealt as follows :-</p> <p>a) If, in the price structure quoted for the required goods / services / works, there is discrepancy between the unit price and the total price (which is obtained by multiplying the unit price by the quantity), the unit price shall prevail and the total price corrected accordingly, unless in the opinion of BHEL there is an obvious misplacement of the decimal point in the unit price, in which case the total price as quoted shall govern and the unit price corrected accordingly.</p> <p>b) If there is an error in a total corresponding to the addition or subtraction of subtotals, the subtotals shall prevail and the total shall be corrected.</p> <p>c) If there is a discrepancy between words and figures, the amount in</p>

Sr. No.	
	<p>words shall prevail, unless the amount expressed in words is related to an arithmetic error, in which case the amount in figures shall prevail subject to (a) and (b) above.</p> <p>d) If there is such discrepancy in an offer as mentioned in (a), (b) & (c) above, the same shall be conveyed to the bidder with target date upto which the bidder has to send his acceptance on the above lines and if the bidder does not agree to the decision of the BHEL, the bid is liable to be ignored.</p> <p>1.14 In case the scope of the successful bidder / supplier against this tender enquiry includes Erection, Testing and Commissioning (ETC) of the equipment / material at site in addition to Supply, Purchase Order shall be placed for Supply Portion and Contract shall be separately awarded for ETC at Site Portion. General Terms and Conditions for Tender Enquiry / Contract mentioned herein shall be applicable for both Supply & ETC at Site. Additional Terms and Conditions for Tender Enquiry / Contract for Erection, Testing and Commissioning at Site "BHEL/TBG/GTC-ETC/2016 Rev. 01" shall be applicable for ETC at Site only which is to be read in conjunction with General Terms and Conditions for Tender Enquiry / Contract mentioned herein. However, any breach of either the Purchase Order or the Contract shall be deemed to be breach of the other.</p> <p>1.15 Taxes and Duties payable extra as per Clause No. 2.3 in NIT, if not specified/quoted clearly as extra shall be considered as included in Ex-works Price and therefore shall not be reimbursed. Taxes and duties not payable extra as per NIT shall be deemed to be included in Ex-works Price.</p> <p>1.16 If the rates for taxes and duties in respect of the quoted materials and / or services assumed by the Supplier are less than the tariff prevailing at the time of tendering, Supplier will be responsible for such under quotations. However if the rates assumed are higher than the correct rates prevailing at the time tendering, the difference will be to the credit of BHEL.</p> <p>Note : Representative / official deputed by the bidder to witness tender opening must produce authorization letter for the same.</p>
2.	<p>PRICES :</p> <p>2.1 Unless specifically indicated in the NIT, all prices shall be FIRM. No enhancement of rate for whatsoever reasons unless and until asked by BHEL shall be allowed.</p> <p>2.2 Unless specifically indicated in the NIT, the prices shall be on INR basis.</p> <p>2.3 Unless specifically indicated in the NIT, the prices are to be quoted on FOR (Site / Destination) basis excluding GST. The break-up of prices shall be as under :-</p> <p>a) Ex-works Price: Ex-works price including packing & forwarding charges.</p> <p>b) Freight: Freight for door delivery up to destination / site / store are to be quoted separately.</p> <p>c) Insurance: Insurance for door delivery up to destination / site / store are to be quoted separately.</p>

Sr. No.	
	<p>d) Type Test Charges: If asked in the technical specification, it is to be quoted separately for each test.</p> <p>e) Charges for Supervision of Erection, Testing & Commissioning (ETC) at Site: To be quoted separately if specified in NIT/Price Schedule.</p> <p>f) Charges for Testing & Commissioning at Site: To be quoted separately if specified in NIT/Price Schedule.</p> <p>g) Charges for Erection, Testing & Commissioning at Site: To be quoted separately if specified in NIT/Price Schedule.</p> <p>h) Training Charges: To be quoted separately if specified in NIT/Price Schedule.</p> <p>2.4 GST rates along with HSN/SAC code as applicable on Sr No (a) to (h) above is to be mentioned separately in percentage in both un-priced bid and price bid.</p> <p>Note :</p> <p>i) Unless otherwise specified in the NIT, the purchase order shall be placed on Ex-works basis for Indian bidders.</p> <p>ii) Prices quoted by Indian bidders shall be in Indian Rupees only.</p> <p>iii) In case Supervision of Erection, Testing & Commissioning (ETC) at Site or Testing & Commissioning at Site or Erection, Testing & Commissioning at Site is also in scope of the bidder along with supply, bidder has to ensure that prices quoted for such services also are in line with special terms & conditions of the NIT, if any.</p> <p>iv) Unless otherwise specified in the NIT, Unloading at Site / Destination shall not be in the scope of the supplier.</p> <p>v) Prices in respect of Sr No (a) to Sr No (h) of Clause 2.3 above are to be quoted inclusive of all taxes & Duties, charges. Levies, royalty etc. if any, excluding GST.</p>
3.	<p>TERMS OF PAYMENT :</p> <p>3.1 For Supply only in scope of the supplier</p> <p>100% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows :</p> <ul style="list-style-type: none"> · LR / GR duly endorsed by BHEL Site Official. · Material Receipt Certificate issued by BHEL Site Official. · GST Compliant Tax Invoice · Packing List (Case-wise) · Copy of Transit Insurance Certificate from underwriters. · Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management · Guarantee Certificate · Copy of Performance Bank Guarantee (PBG) · Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order. <p>3.2 For Supply where Supervision of Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier or Supply where Testing & Commissioning at Site is in scope of the supplier</p>

Sr. No.	
	<p>a) 95% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows :</p> <ul style="list-style-type: none"> · LR / GR duly endorsed by BHEL Site Official. · Material Receipt Certificate issued by BHEL Site Official. · GST Compliant Tax Invoice · Packing List (Case-wise) · Copy of Transit Insurance Certificate from underwriters. · Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management · Guarantee Certificate · Copy of Performance Bank Guarantee (PBG) · Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order. <p>b) 5% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows :</p> <ul style="list-style-type: none"> · Certificate of successful completion of Supervision of Erection, Testing & Commissioning at Site if it is in the scope of the supplier or Certificate of successful completion of Testing & Commissioning at Site if it is in the scope of the supplier. · Certificate of completion of final documentation as per Purchase Order / Technical Specification issued by BHEL Engineering Management <p>3.3 For Supply where Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier</p> <p>a) 90% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows :</p> <ul style="list-style-type: none"> · LR / GR duly endorsed by BHEL Site Official. · Material Receipt Certificate issued by BHEL Site Official. · GST Compliant Tax Invoice · Packing List (Case-wise) · Copy of Transit Insurance Certificate from underwriters. · Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management · Guarantee Certificate · Copy of Performance Bank Guarantee (PBG) · Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order <p>b) 10% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows :</p> <ul style="list-style-type: none"> · Certificate of successful completion of Erection, Testing & Commissioning at Site issued by BHEL Site Official / Construction Management · Certificate of completion of final documentation as per Purchase Order / Technical Specification issued by BHEL Engineering Management <p>3.4 For Type Test Charges</p> <p>100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with copy of Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management in 3 sets (original + 2 copies) on completion of delivery (at site, if F&I is in scope of</p>

Sr. No.	
	<p>supplier) of main supplies (excluding spares) for which Type Tests are applicable. List of main supplies (excluding spares) for which Type Tests are applicable shall be certified by BHEL Engineering Management.</p> <p>3.5 For Charges for Supervision of Erection, Testing & Commissioning at Site</p> <p>100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of successful completion of Supervision of Erection, Testing & Commissioning at Site issued by BHEL Site Official / Construction Management in 3 sets (Original + 2 copies).</p> <p>3.6 For Charges for Testing & Commissioning at Site</p> <p>100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of successful completion of Testing & Commissioning at Site issued by BHEL Site Official / Construction Management in 3 sets (Original + 2 copies).</p> <p>3.7 For Training Charges</p> <p>100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of completion of training issued by BHEL Engineering Management in 3 sets (original + 2 copies).</p> <p>Note :</p> <ul style="list-style-type: none"> i) Supplier has to submit invoice(s) as per PO or approved billing break-up of prices (if applicable as per NIT). ii) In case of supplies for overseas project, Material Receipt Certificate issued by BHEL Authorized Representative shall also be acceptable. iii) In case of Transit Insurance under Open Insurance Policy, Intimation / Declaration of Transit Insurance as per terms of the relevant Open Insurance Policy along with copy of Open Insurance Policy from underwriters shall also be acceptable. iv) Supplier has to ensure commencement of transit insurance from the date not later than LR / GR date. v) Supplier has to submit Tax Invoice(s). Supplier should ensure that Tax Invoice should comply all statutory requirements under GST Law to enable BHEL to avail input credit vi) MSMED Act, 2006 and the rules made thereunder as amended from time to time shall be applicable for release of payment to suppliers qualified & registered as Micro & Small Enterprises based on documents mentioned in the NIT for MSME. vii) Supplier has to submit PBG (as per BHEL format) & Guarantee Certificate as per PO terms. viii) In case any shortages and / or damages in supplies, an amount calculated

Sr. No.	
	<p>based on comments against Material Receipt Certificate issued by the BHEL Site Official shall be withheld from the supply payment against 3.1(a) or 3.2(a) above to be deemed fit by BHEL subject to a minimum of 10% of the total ex-works value of the invoice corresponding to the LR / GR against which any shortages and / or damages are reported. The withheld amount shall be released after the shortages and / or damages in supplies are supplied / replenished against Certification by BHEL Site Official.</p> <p>ix) Payment of GST component shall be made only if vendor has deposited the Tax and credit for the same is reflected in GSTN (GST Network). In case credit of the same is not reflected in GSTN , vendor may alternatively furnish BG of GST Amount for a period valid for not less than 1 month .In case of disallowance of credit /non reflection of credit in GSTN , amount will be recovered from supplier along with applicable Interest , penalty etc from any of his dues.</p> <p>x) If GST is payable by BHEL on reverse Charge Mechanism basis, vendor should ensure the submission of GST compliant Tax invoice immediately on dispatch/ performance of service. In case of non-compliance any additional charges towards interest, penalty etc, will be to vendors account.</p> <p>xi) TDS under GST Act, if applicable, shall be deducted unless Exemption Certificate If applicable, from the appropriate authority is furnished to BHEL along with Invoice.</p>
4.	<p>INTEREST LIABILITY :</p> <p>In case of any delay in payment due to any reason, BHEL shall not pay any interest on delayed payment. Also, no interest shall be payable by BHEL on the bank guarantee / deposit amount or balance payment or any other money which may become due owing to difference or misunderstanding or any dispute before any quasi judicial authority between BHEL and the Supplier / Contractor.</p>
5.	<p>GUARANTEE :</p> <p>The equipment / material supplied and services rendered (if applicable) shall be guaranteed to be free from all defects and faults in design & engineering, material, workmanship & manufacture and in full conformity with the Purchase Order / Contract, Technical Specifications & approved drawings / data sheets, if any, for 18 months from the date of last delivery or 12 months from the date of commissioning, whichever is earlier.</p> <p>Wherever Erection, Testing & Commissioning at Site are also in the scope of the Supplier, the guarantee period shall be 18 months from the date of last delivery or 12 months from the date of commissioning, whichever is later.</p> <p>The defective equipment / material / component shall be replaced free of cost at site. Freight & Insurance during transit shall also be in the scope of the supplier / contractor. Any expenditure for dismantling and re-erection of the replaced equipment / material / component shall be to supplier's / contractor's account. All replacements during the guarantee period shall be delivered at site promptly and satisfactorily within a period not more than 45 days from the date of reporting the defect / rejection etc.</p> <p>In the event of the supplier / contractor failing to replace the defective equipment / material / component within the time period mentioned above, BHEL may proceed to undertake the replacement of such defective equipment / material / component at the risk and cost of the supplier / contractor without prejudice to any other rights under the contract and recover the same from PBG / other dues of this Purchase</p>

Sr. No.	
	<p>Order / Contract or any other Purchase Order / Contract executed by the supplier / contractor.</p> <p>Note :</p> <p>i) In case of Illumination System, items viz. Lamps, Tubes, Ballast, Starters, Capacitors & Fuses will not be under Guarantee after commissioning.</p> <p>ii) In addition to the above guarantee period, Extended Guarantee / Warranty, if any, shall be as per NIT / Technical Specifications.</p> <p>iii) In case offer of agent of Foreign OEM / Foreign Principal is considered, as per Clause No. 1.12 above, Guarantee as mentioned above has to be provided by the Foreign OEM / Foreign Principal also.</p>
6.	<p>LATENT DEFECT :</p> <p>Liability for latent defects shall be for defects inherently lying within material or arising out of design deficiency which does not manifest itself during guarantee period but later and shall be limited to five years from the expiry of the guarantee period.</p>
7.	<p>PERFORMANCE BANK GUARANTEE (PBG) :</p> <p>Supplier shall arrange to submit Performance BG / Deposit on a non-judicial stamp paper of appropriate value along with first invoice or within 60 days from placement of Purchase Order (PO) whichever is earlier, in line with one of the applicable options as follows :-</p> <p><u>Option "A"</u></p> <p>A single rolling PBG for Rs. 50 Lakhs initially valid for 18 months with claim period of 3 months extra over and above 18 months for all the Purchase Orders being executed for Transmission Business Group, BHEL. However, validity of the PBG shall be extended till 18 months from the date of last delivery with 3 months claim period extra over and above 18 months.</p> <p>Single Rolling PBG option shall not be applicable in case Ex-works value of the PO at the time of placement of PO exceeds Rs. One Crore.</p> <p><u>Option "B"</u></p> <p>PBG for 10% of the total Ex-works PO value, valid for 18 months from the date of last delivery with claim period of 3 months extra over and above 18 months. Ex-works PO value at the time of placement of PO shall be considered for calculation of the PBG amount.</p> <p><u>Option "C"</u></p> <p>In case the total Ex-works PO value at the time of placement of PO does not exceed Rs. Ten Lakhs, interest free Deposit of 10% of the total Ex-works PO value at the time of placement of PO in form of Demand Draft favouring "Bharat Heavy Electricals Limited" and payable at New Delhi / Delhi / Noida shall also be acceptable to BHEL in lieu of PBG, which shall be released after expiry of 21 months from the date of last delivery after deduction, if any, within 60 days from receipt of invoice in 3 sets (original + 2 copies) to be submitted by the supplier.</p> <p>Note :</p> <p>i) The Bank Guarantee shall be from any bank as per Annexure for List of Banks (32 Nos.). The original PBG should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida.</p> <p>ii) Extension of validity of the PBG in original, as per above clause, should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida at least 45 days before expiry of validity of the PBG.</p> <p>iii) Unless otherwise specified in the NIT, deviation taken for non-submission of PBG / Deposit, as applicable, shall not be accepted.</p>

Sr. No.	
	<ul style="list-style-type: none"> iv) Supplier has to confirm one of the applicable options for submission of PBG / Deposit before placement of PO. v) In case of non-submission PBG / Deposit, as applicable, BHEL reserve the right for Risk Purchase as per terms of the NIT and impose Suspension of Business Dealings with the Supplier / Contractor. vi) BHEL reserve the right to encash the Bank Guarantee and forfeit the amount in the event of any default, failure or neglect on part of the Supplier in fulfilment of performance of the Purchase Order. vii) Value of the Bank Guarantee (at the time of submission) shall remain unchanged for any subsequent variations in Purchase Order value up to $\pm 20\%$. Beyond this variation of $\pm 20\%$, the Supplier shall arrange to enhance or may reduce the value of the Bank Guarantee accordingly for the total variation promptly. viii) Vendor to ensure submission of Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, as the case may be, as referred in clause No 9 regarding Final Documentation. BG shall be released only after submission of the same to BHEL TBMM.
8.	<p>SUBMISSION OF DRAWINGS / DOCUMENTS FOR APPROVAL :</p> <p>Supplier shall submit the master document list within 7 days from date of Purchase Order / Contract, unless otherwise specified in the NIT, with planned dates for submission which shall be in line with activity schedule as per Purchase Order / Contract and shall be finalized with BHEL Engineering Management. Date of first submission of drawings / documents shall be certified by BHEL Engineering Management after the receipt of applicable drawings / documents (e.g. project specific cover sheet, GTP, OGA drawings, schemes, type test reports etc.) by BHEL. During detailed engineering stage, necessary hard copies of the engineering drawings / documents shall also be submitted by the supplier as per the Purchase Order / Contract requirement. The supplier shall also submit the packing drawings as per technical specifications.</p> <p>In case item(s) offered require any interface details of other item (not in the scope of supplier & required for operating the equipment), the supplier has to submit interfaces schedule along with submission of engineering drawings / documents. It shall be responsibility of the supplier to get the details of the interfaced item from BHEL before manufacturing to avoid any mismatch at site.</p>
9.	<p>FINAL DOCUMENTATION :</p> <p>Final documentation as called in the Technical /contract specification is to be submitted within 3 months from the date of first delivery of respective equipment, item/material. After submission of Final Documentation, BHEL Engineering Management (TBEM) will issue a Certificate of Completion of Final Documentation. Wherever Final Documentation is not applicable, BHEL Engineering Management (TBEM) will issue confirmation regarding the same, Vendor to submit the Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, as the case may be, to BHEL TBMM. In case of Non Submission of Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, BG will be liable for encashment.</p>
10.	<p>INSPECTION :</p> <p>BHEL / customer / third party shall inspect equipment / material before despatch. Stage inspection during manufacturing may also be carried out. Material to be despatched only after getting Material Despatch Clearance Certificate (MDCC) / MICC issued by BHEL.</p> <p>Supplier shall send inspection call on prescribed format / web site only, with an advance notice of 15 days.</p> <p>Supplier to ensure submission of all routine / acceptance test reports, inspection</p>

Sr. No.	
	<p>reports and all other documents related to inspection, immediately to BHEL.</p> <p>BHEL representative is authorised to carry out audits along with Third Party Inspection Agency at vendor's / supplier's works before clearing the items for despatch.</p>
11.	<p>DESPATCH DOCUMENTS : Despatch documents to be immediately sent to BHEL on despatch are as follows :-</p> <ul style="list-style-type: none"> • Copy of Invoice • Copy of LR / GR in case of Indian suppliers or BL / AWB in case of foreign suppliers • Copy of Packing List (Case-wise) • Copy of Transit Insurance Certificate from underwriters • Copy of Guarantee Certificate
12.	<p>DELIVERY PERIOD : Delivery / Completion requirement shall be mentioned in the NIT. Bidder to specify best delivery / completion period possible in weeks from the date of LOI / PO as per activity schedule for consideration by BHEL. Time required for type test, if applicable, is to be separately indicated. Note : LR / GR date or invoice date (whichever is later) for indigenous supplies and BL / AWB date for FOB / CIF (if applicable) contracts shall be considered as delivery date.</p>
13.	<p>LIQUIDATED DAMAGES FOR DELAYED DELIVERY: In case of delay in execution of Purchase Order beyond the contractual delivery time, an amount of 0.5% of the total Purchase Order value for supply (incl. taxes and duties, freight & insurance as applicable) per week of delay or part thereof subject to a maximum of 10% of the total Purchase Order value for supply (incl. taxes and duties, freight & insurance as applicable) shall be deducted as Liquidated Damages (LD) along with applicable GST (if any) on LD. However, in case of staggered (lot-wise) contractual delivery schedule, an amount of 0.5% of the total Purchase Order value for supply (incl. taxes, duties, freight & insurance as applicable) of delayed lot per week of delay or part thereof subject to maximum of 10% of the total Purchase Order value. (Incl taxes, duties, Freight & Insurance as applicable) shall be deducted as Liquidated Damages (LD) along with applicable GST (if any) on LD. Note : i) In case of any amendment / revision in PO /WO, the LD shall be linked to the amended / revised Purchase Order / Contract value and delivery / completion time / schedule, if applicable. ii) LR / GR date or invoice date (whichever is later) for indigenous supplies and BL / AWB date for FOB / CIF (if applicable) for imported supplies shall be treated as the date of dispatch for levying LD as above. iii) However, for indigenous supply, if time period between date of receipt of material at site / destination by Site Official & the date of LR / GR or invoice (whichever is later) is more than 30 days, where distance from place of despatch as per LR / GR is upto 1000 Kms or if time period between date of receipt of material at site / destination by Site Official & the date of LR / GR or invoice (whichever is later) is more than 45 days, where distance from place of despatch as per LR / GR is more than 1000 Kms, such excess period shall also be considered for LD purpose. iv) If, as per supplier, delay is not attributable to the supplier, delay analysis with documentary evidence may be submitted by the supplier at the earliest but not</p>

Sr. No.	
	later than six months from the end of the financial year in which the payment is withheld. Based on the above details / documents submitted by the supplier, BHEL shall take final decision and if considered appropriate by BHEL, withheld amount (full or part as the case may be) shall be released, otherwise, full or balance withheld amount shall be treated as deduction of Liquidated Damages (LD) towards delayed delivery.
14.	<p>VALIDITY OF OFFER : The offer shall be valid for 120 days from the due date of opening of tender (i.e. techno-commercial bid unless otherwise specified in the NIT). Prices of Spares, wherever they optional items, shall be valid till two years from the date of placement of PO.</p>
15.	<p>ACCEPTANCE / REJECTION OF TENDER : BHEL reserve the right to reject in full or part, any or all tender without assigning any reason thereof. BHEL also reserve right to vary the quantities as mentioned in the NIT. Acceptance of offer is subject to vendor approval by customer before opening of price bid.</p> <p>BHEL shall not be bound by any power of attorney granted by tenderer or by changes in composition of the firm made subsequent to award of order / contract. BHEL may however recognize such power of attorney and changes after obtaining proper legal advice, cost of which will be chargeable to the seller / contractor concerned. If the tenderer deliberately gives wrong information, BHEL reserves the right to reject such an offer at any stage or cancel the order / contract, if awarded, and forfeit the security deposit and bank guarantee.</p>
16.	<p>DEVIATION : The bids having deviation(s) w.r.t. tender are liable for rejection. However, BHEL, at its discretion, may load the prices for evaluation of offer with prior intimation to bidder.</p>
17.	<p>TENDER EVALUATION : Comparative statement shall be prepared and evaluated on total cost basis at destination/site (as per terms of NIT) considering overall quantity indicated in NIT unless contrary to same is specifically mentioned in the tender enquiry / NIT. Total cost for this purpose shall include cost of scope of work as mentioned in NIT along with applicable taxes & duties, and other services etc. (if applicable). GST input credit available to BHEL shall be reduced from prices while determining L1 status.</p> <p>In case all bidders are foreign & Port of Import (destination port) is same for all the bidders, evaluation of offers shall be done on CIF (Port of Import) basis. Otherwise, evaluation of offers shall be done on the basis of delivered cost at site /destination to BHEL. Further, in case of foreign bidders, marine freight & insurance are to be quoted separately & the purchase order may be placed on FOB basis with an option for delivery on CIF / CFR basis, if required, later.</p> <p>In case of foreign bidders, Exchange Rate (TT selling rate of State Bank of India) as on date of tender opening (Part-I Bid in case of two part bid) shall be considered. If the relevant day happens to be a bank holiday, then the forex rate as on the previous bank (SBI) working day shall be taken for tender evaluation.</p>
18.	<p>LOADING CRITERIA : List of permissible deviations & loading criteria thereof are as follows :-</p> <p>a) Payment Terms Base rate of SBI (as applicable on the date of bid opening / techno-commercial bid opening in case of two part bids) + 6% shall be considered for loading for the period of relaxation sought by bidder(s) against terms of payment in the NIT.</p> <p>b) Liquidated Damages (LD) for Delayed Delivery</p>

Sr. No.	
	<p>Loading on LD clause shall be to the extent to which it is not agreed to by the bidder (at offered value).</p> <p>c) In case of foreign bidders, if the quoted prices is on CIF basis only, it shall be loaded to arrive at total FOR (Site / Destination) price, as applicable, by factors as follows :-</p> <ul style="list-style-type: none"> i) Port handling / clearing charges: @ 1% of CIF value to arrive at Customs Assessable Value. ii) Custom Duty (including CVD & SAD) as per NIT prevailing on date of price bid opening. iii) Inland Freight & Transit Insurance: @ 5% of CIF value where distance between site / destination and Port of Discharge is upto 1000 Kms or @ 7% of CIF value where distance between site / destination and Port of Discharge is more than 1000 Kms. <p>Note : Additional deviations (if considered acceptable by BHEL) & the loading criteria shall be communicated to all the qualified bidders before price bid opening.</p>
19.	<p>ARBITRATION :</p> <p>In the event of any dispute emanating from and relating to this contract, the matter shall be referred to the sole arbitration of the person appointed by the competent authority of BHEL. Subject to aforesaid, the provisions of "The Arbitration and Conciliation Act, 1996" and the rules made thereunder as amended from time to time in India shall apply to the arbitration proceedings. The venue of arbitration shall be in New Delhi.</p> <p>Further there shall be no claim for any pre-reference or pendente-lite interest on the claims and any claim for such interest made shall be void.</p> <p>However, in case of contract with Public Sector Enterprise / Undertaking (PSE/PSU) or Govt. Dept., the extant guidelines of Govt. of India shall be followed.</p>
20.	<p>LEGAL SETTLEMENT :</p> <p>Indian Courts at New Delhi / Delhi shall have exclusive jurisdiction to decide the dispute, if any, arising out of or in respect of the contract(s) to which these conditions are applicable. Contract, including all matters connected with contract, shall be governed by the Indian Law, both substantive and procedural, for the time being in force including modification thereto.</p>
21.	<p>SUB-CONTRACTING :</p> <p>In case further subcontracting of BHEL Purchase Order / Contract or part thereof is envisaged by supplier, the same can be done after written permission is obtained from BHEL. However it shall not absolve the Supplier / Contractor of the responsibility of fulfilling BHEL Purchase Order / Contract requirements. In case of subcontracting of Purchase Order / Contract awarded by BHEL or part thereof without such permission, BHEL reserve the right to cancel the Purchase Order / Contract and source such material / component / equipment / system from any other agency at the risk and cost of the Supplier / Contractor.</p> <p>If Supplier / Contractor is an individual or proprietary concern and the individual or the proprietor dies or the partnership is dissolved or substantially affected, then unless BHEL is satisfied that legal representative of individual Supplier / Contractor or proprietor of proprietary concern and surviving partners of partnership firm are capable of carrying out and completing the Purchase Order / Contract, BHEL shall be entitled to cancel the Purchase Order / Contract as to its incomplete portion and without being in any way liable to payment of any compensation to legal representative of Supplier / Contractor and / or to surviving partners of Supplier's / Contractor's firm on account of cancellation of the Purchase Order / Contract.</p> <p>Decision of BHEL that legal representatives of deceased Supplier / Contractor or</p>

Sr. No.	
	<p>surviving partners of the Supplier's / Contractor's firm cannot carry out and complete the Purchase Order / Contract shall be final and binding on the parties hereto.</p> <p>Terms and Conditions shall not get affected in case of de-merger / amalgamation / taking-over / re-constitution etc.</p>
22.	<p>RISK PURCHASE : In case the Supplier / Contractor fails to supply or fails to comply with terms & conditions of the Purchase Order / Contract or delivers equipment / material not of the contracted quality or fails to adhere to the contract specifications or fails to perform as per the activity schedule and there are sufficient reasons even before expiry of the delivery / completion period to justify that supplies shall be inordinately delayed beyond contractual delivery / completion period, BHEL reserve the right to cancel the Purchase Order / Contract either in whole or in part thereof without compensation to Supplier / Contractor and if BHEL so desires, may procure such equipment / material / items not delivered or others of similar description where equipment / material / items exactly complying with particulars are not readily procurable in the opinion of BHEL which is final and in such manner as deemed appropriate, at the risk and cost of the Supplier / Contractor and the Supplier / Contractor shall be liable to BHEL for any excess cost to BHEL. However, the Supplier / Contractor shall continue execution of the Purchase Order / Contract to the extent not cancelled under the provisions of this clause.</p> <p>Recovery amount on account of purchases made by BHEL at the risk and cost of Supplier / Contractor shall be the difference of total value of new Purchase Order (PO) value and total value of old Purchase Order for applicable items, where the total value of new PO is more than total value of old PO for applicable items, plus additional 15% of the total ex-works value of new PO as overheads.</p> <p>The Supplier / Contractor shall on no account be entitled to any gain on such risk & cost purchase. In case the purchase order (PO) value of the new PO is less than the PO value of the old PO, 15% of the total ex-works value of the new PO shall be recovered as overheads and the difference between the PO value of the old PO and the new PO shall not be considered for calculation of the recovery amount.</p>
23.	<p>ADJUSTMENT OF RECOVERY : Any amount payable by the Supplier / Contractor under any of the condition of this contract shall be liable to be adjusted against any amount payable to the Supplier / Contractor under any other Purchase Order / Contract awarded to him by any BHEL unit. This is without prejudice to any other action, as may be deemed fit, by BHEL.</p>
24.	<p>FORCE MAJEURE CONDITION : If by reason of war, civil commotion, act of god, Government restrictions, strike, lockout which are not in control of Supplier / Contractor the deliveries / services are delayed, Supplier / Contractor shall not be held responsible.</p> <p>If at any time during the continuance of the Purchase Order / Contract, the performance in whole or in part by either party of any obligations under the Purchase Order / Contract is prevented or delayed by reason of any war hostilities, acts of the public enemy, restrictions by Govt. of India, civil commotion, sabotage, fires, floods, explosion, epidemics, quarantine restrictions, strike, lock-outs or acts of God (hereinafter referred to as "event"), which are not in control of Supplier / Contractor or BHEL, then provided notice of the happening of such event is given by either party to the other within fifteen (15) days from the date of occurrence thereof, neither party shall by reason of such event be entitled to terminate the Purchase Order / Contract nor shall have any claim for damages against each other in respect of such non-performance and delay in performance. Performance under the Purchase Order / Contract shall be resumed immediately after such event has come to an end or</p>

Sr. No.	
	<p>ceased to exist and decision of BHEL as to whether the deliveries have to be resumed or not shall be final, conclusive and binding on the parties hereto. In the event of the parties hereto not able to agree that a force majeure event has occurred, the parties shall submit the disputes for resolution pursuant to the provisions hereunder, provided that the burden of proof as to whether a force majeure event has occurred shall be upon the party claiming such an event. Notwithstanding above provisions, BHEL shall reserve the right to cancel the Purchase Order / Contract, wholly or partly, in order to meet the overall project schedule and make alternative arrangements for completion of delivery and other schedules.</p>
25.	<p>MANUFACTURING QUALITY PLAN (MQP) : Supplier to submit approved MQP in line with requirement of BHEL/customer.</p>
26.	<p>SUPPLIER PERFORMANCE MONITORING AND RATING SYSTEM : BHEL reserve the right for evaluation of Supplier Performance Rating as per Supplier Performance Monitoring and Rating System of BHEL for necessary action. Details are available at BHEL Website www.bhel.com for reference.</p>
27.	<p>DEALING WITH BANNED SUPPLIERS / CONTRACTORS IN BHEL : Offers of the bidders, who are on the banned list, as also the offers of the bidders who engage the services of the banned firms, shall be rejected. The list of banned firms is available on BHEL website www.bhel.com for reference.</p>
28.	<p>ORDER OF PRECEDENCE : The order of precedence shall be as follows :- a) Special Terms & Conditions (STC) for Tender Enquiry / Contract, if any b) General Terms & Conditions (GTC) for Tender Enquiry / Contract & Additional General Terms & Conditions (GTC) for Tender Enquiry / Contract for Erection Testing & Commissioning (ETC) at Site, if applicable Provisions in (a) above shall prevail over (b). In case of conflict, between Technical Specifications and STC / GTC, bidder to seek necessary clarifications from BHEL concerned official as specified in NIT.</p>
29.	<p>PACKING : Packing shall be in conformity with specifications and shall be such as to ensure prevention of damages, corrosion, deterioration, shortages, pilferage and loss in transit or storage. In case of shipment by sea or air, the packing shall be sea-worthy or air-worthy respectively and of international standards. Different types of spares i.e. start-up / commissioning spares and initial spares (mandatory spares and recommended O&M spares) are to be packed separately. Packing List shall be submitted as per standard format along with advance set of documents for claiming payment which shall also indicate :- a) Case / Packing size (as applicable). b) Gross weight and net weight of each package. c) Detailed contents of the package with quantity of each item separately.</p> <p>Project, Item / Package Description, BHEL's PO No. with date & Case / Packing Mark should also be clearly mentioned on the Case / Packing and Packing List for identification. Also, Packing List must be duly signed & should include respective Invoice No. & LR No.</p> <p>Note :</p> <p>Foreign suppliers to furnish details to arrange inland transportation by BHEL, if applicable, as follows :- i) No. of Packages ii) Size with Weight (Gross & Net) of each Package iii) No. of Containers with type & size required for inland transportation</p>

Sr. No.	
	iv) Type of Cargo (Break Bulk / LCL / FCL) v) Customs Tariff No.
30.	<p>COLOUR CODING : Aluminium stickers are required to be attached to large components but plastic sheet tags should be tied with small components, giving details like purchase order, description of the component, quantity etc. Tags should be of the colour as follows :- a) Main equipment : Yellow or White tag b) Start-up / Commissioning spares : Blue tag c) Mandatory spares : Pink or Red tag d) Recommended / O&M spares : Green tag</p>
31.	<p>MICRO, SMALL & MEDIUM ENTERPRISES (MSME) : MSMED Act 2006 as amended from time to time & extant regulations of Govt. of India for MSME will be applicable. Micro & Small Enterprises (MSE) can avail the intended benefits only if they submit along with the offer / bid, attested copies of either Acknowledgement of Entrepreneur Memorandum Part-II (EM-II certificate) having deemed validity (five years from the date of issue of acknowledgement in EM-II) or valid NSIC certificate or EM-II certificate along with attested copy of a CA certificate (As per BHEL format where deemed validity of EM-II certificate of five years have expired) applicable for the relevant financial year (latest audited). Date to be reckoned for determining the deemed validity will be the date of opening (for Techno-commercial Bid : Part-I in case of two part bid). Non-submission of such documents will lead to consideration of their bid at par with other bidders. No benefit shall be applicable for this enquiry if any deficiency in the above required documents are not submitted before price bid opening. If the tender is to be submitted through e-procurement portal, then the above required documents are to be uploaded on the portal. Documents should be notarized or arrested (in original) by a Gazetted officer. Copy of Udyog Aadhaar Memorandum with Acknowledgement of Ministry of Micro, Small & Medium Enterprises should also be furnished.</p>
32.	<p>BUSINESS ETHICS / SUSPENSION OF BUSINESS DEALINGS WITH SUPPLIERS / CONTRACTORS : If any bidder / supplier / contractor during pre-tendering / tendering / post tendering / award / execution / post-execution, indulges in malpractices cheating, bribery, fraud or other misconduct or formation of cartel so as to influence the bidding process or influences the price or fails to perform or is in default without any reasonable cause etc or performs any act considered objectionable as per extant guidelines, action may be taken against such bidders/supplier/contractor as per extant "Guidelines for Suspension of Business Dealings with Suppliers/Contractors". Abridged version of same is available at BHEL website (www.bhel.com) on "Supplier Registration" Page.</p>
33.	<p>REVERSE AUCTION : BHEL reserve the right to go for Reverse Auction (RA) instead of opening the sealed envelope price bid, submitted by the bidder or price bid submitted by the bidder through e-procurement system. This will be decided after techno-commercial evaluation. All bidders to give their acceptance for participation in RA. Non-acceptance to participate in RA may result in non-consideration of their bids, in case BHEL decides to go for RA. In case BHEL decides to go for Reverse Auction, only those bidders who have given their unconditional acceptance to participate in RA will be allowed to participate in the Reverse Auction. Those bidders who have given their acceptance to participate in Reverse Auction will have to necessarily submit "online sealed bid" in the Reverse Auction. Non-submission of "online sealed bid" by the bidder will be considered as tampering of the tender process and will invite action by BHEL as per extant guidelines in vogue. General Terms and Conditions of RA are available at Annexure. Business Rules for</p>

Sr. No.	
	<p>RA shall be sent to the bidders before conducting RA. Abridged Version of "Common Guidelines for Conducting Reverse Auction" may also be seen at BHEL website (www.bhel.com) on "Supplier Registration" Page & "Tender Notifications" Page.</p>
34.	<p>INTEGRITY PACT : Bidders shall have to enter into Integrity Pact with BHEL, duly signed with seal in original, if specified in NIT / RFQ failing which bidder's offer shall be liable for rejection.</p>
35.	<p>TERMINATION OF CONTRACT : BHEL shall have the right to cancel the Purchase Order / Contract without any financial implication to BHEL if vendor approval by end user / customer is withdrawn or in case of Suspension of Business Dealings with the Suppliers / Contractors by BHEL.</p> <p>BHEL shall have the right to cancel Purchase Order / Contract, wholly or in part, in case they are obliged to do so on account of any decline, diminution, curtailment or stoppage of their business and in that event, the Supplier's / Contractor' compensation claim shall be settled mutually.</p> <p>In case of cancellation of Purchase Order / Contract for main supply, all other associated Purchase Orders / Contracts like those for Mandatory Spares / Recommended Spares / Erection, Testing & Commissioning (ETC) / Supervision of ETC, if any, would also get cancelled.</p>
36.	<p>SHELF LIFE : Supplier has to inform the list of the items / sub-items which have limited shelf life like consumables or those required for the first fill and shall indicate the corresponding shelf life period in the offer. Such items / sub-items shall be manufactured / despatched only after getting formal clearance from BHEL.</p>
37.	<p>LIMITATION OF LIABILITY : Notwithstanding any other provisions, except in cases of wilful misconduct and / or criminal negligence / acts,</p> <p>a) Neither the Supplier / Contractor nor BHEL shall be liable to the other, whether in Purchase Order / Contract, tort, or otherwise, for any consequential loss or damage, loss of use, loss of production or loss of profits or interest costs, provided however that this exclusion shall not apply to any obligation of the Supplier / Contractor to pay Liquidated Damages to the BHEL and</p> <p>b) Notwithstanding any other provisions incorporated elsewhere in the contract, the aggregate liability of the Contractor in respect of this contract, whether under the Contract, in tort or otherwise, shall not exceed total Contract Price, provided however that this limitation shall not apply to any obligation of the Vendor to indemnify BHEL with respect to Patent Infringement or Intellectual Property Rights.</p>
38.	<p>SHORTAGES / DAMAGES :</p> <p>a) Against Supply only or Supply where Supervision of Erection, Testing & Commissioning (ETC) at Site or Supply where Testing & Commissioning at Site is in scope of the supplier :</p> <p>Any shortages and / or damages in supplies shall be supplied / replenished free of cost by the supplier as early as possible but not later than 30 days from the date of intimation by BHEL to the supplier.</p> <p>b) Against Supply where Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier :</p>

Sr. No.	
	<p>Any shortages and / or damages in supplies and during handling / storage, erection, testing and commissioning at site shall be supplied / replenished free of cost by the Supplier / Contractor, as early as possible, to meet the contractual completion time / schedule.</p> <p>Note: There shall not be any extension in the contractual delivery time / schedule due to any shortages and / or damages in supplies.</p>
39.	<p>VARIATION OF CONTRACT VALUE / QUANTITY VARIATION : BHEL shall have the right to variation in quantities of items within $\pm 30\%$ of the total Purchase Order / Contract value at the time of placement of PO or award of Contract on overall basis for all amendments together within two years from the date of original Purchase Order / Contract or completion of execution of the Purchase Order / Contract whichever is earlier but quantities of individual items may vary to any extent or may get deleted unless otherwise specified in the technical specifications. No compensation is payable due to variation in the quantities and the Supplier / Contractor shall be bound to accept the same the contracted prices / rates without any escalation. However, if the Purchase Order / Contract is on "Lumpsum" basis, no variation of Purchase Order / Contract value shall be admissible to the Supplier / Contractor within the scope of Purchase Order / Contract, as long as the inputs remain unchanged.</p>
40.	<p>STATUTORY VARIATION : GST rates prevailing at the time of dispatch of goods / completion of services shall be payable by BHEL. All other taxes, duties, charges, royalty, cess, other levies shall be deemed to be included in the Ex Works Prices / Charges quoted by bidders and no variations shall be payable in respect thereof. No other variations such as on customs duty, exchange rate, minimum wages, prices of controlled commodities, any other input etc. shall be payable by the BHEL.</p> <p>Notwithstanding anything above, where the actual completion of the supply / services occurs beyond the period stipulated in the Purchase Order / Contract or any extension thereof, variations referred to above, will be limited to the rates prevailing on the dates of such agreed completion periods only. For variations after the agreed completion periods, the Supplier / Contractor alone shall bear the impact for the upward revisions and for downward revisions BHEL shall be given the benefit of reduction in applicable taxes /GST. This will be without prejudice to the levy of liquidated damages for delay in delivery / completion.</p> <p>If new tax is introduced by Central/ State Govt / Municipality becomes directly applicable on items specified in Bill of Quantities/Purchase Order/Contract, full reimbursements shall be made provided it becomes applicable on items specified in Bill of Quantities.</p> <p>However, any additional tax implication due to delay in delivery, beyond the Contractual Delivery, attributable to supplier shall be borne by supplier.</p>
41.	<p>MODE OF PAYMENT : Payment shall be made directly to the Supplier / Contractor by BHEL through NEFT / RTGS.</p>
42.	<p>CONFIDENTIALITY : Supplier / Contractor shall, at all times, undertake to maintain complete confidentiality of all data, information, software, drawings & documents etc. belonging to BHEL and also of systems, procedures, reports, input documents, manuals, results and any other BHEL documents discussed and / or finalized during the course of execution of Purchase Order / Contract.</p>
43.	<p>INDEMNIFICATION : The Supplier / Contractor shall indemnify and keep indemnified and hold harmless BHEL and its employees and officers from and against any and all claims, suits, actions or administrative proceedings, demands, losses, damages, costs and</p>

Sr. No.	
	expenses and any other claim of whatsoever nature in respect of the death or injury of any person or loss of or damage to any property arising during the course and out of the execution of the Purchase Order / Contract.
44.	<p>TITLE OF GOODS :</p> <p>a) Ownership of the equipment / material procured in India, shall be transferred to BHEL upon loading on to the mode of transport to be used for transportation of the said equipment / material from the works to the site / destination and upon endorsement of the dispatch documents in favour of BHEL.</p> <p>b) Ownership of the equipment / material to be imported into the country where the site is located, if not procured in India, shall be transferred to BHEL upon loading on the mode of transport to be used for transportation of the equipment / material from the country of origin to that country / destination and upon endorsement of despatch document in favour of BHEL.</p> <p>c) Notwithstanding the transfer of ownership of the equipment / material, the responsibility for care and safe custody thereof together with the risk of loss or damage thereto for whatsoever reason shall remain with the Supplier.</p>
45.	<p>COMPLIANCE OF STATUTORY REQUIREMENTS :</p> <p>The vendor shall comply with all State and Central Laws / Acts, Statutory Rules, Regulations etc., as may be enacted by the Government during the tenure of the Purchase Order / Contract and having in force and applicable to the Purchase Order / Contract and nothing shall be done by the Supplier / Contractor in contravention of any Law / Act and / or Rules / Regulations, thereunder or any amendment thereof.</p> <p>The Supplier / Contractor shall pay all taxes, fees, licence charges / deposits, duties, tolls, royalty, commissions or other charges which may be levied on account of any of his operations connected with the Purchase Order / Contract. In case BHEL is constrained to make any of such payments, BHEL shall recover the same from the Supplier / Contractor either from moneys due to him or otherwise as deemed fit.</p>
46.	<p>ACCEPTANCE OF ORDER :</p> <p>Supplier should acknowledge and accept the Letter of Award / Purchase Order issued by BHEL within 7 days of the issue of Letter of Award / Purchase Order.</p> <p>In case of any discrepancy / typographical error in issue of Purchase Order / Contract, the agreed terms & conditions, scope of work, rates / prices for placement of PO / award of contract shall be applicable and BHEL reserves the right to issue amendment(s) to PO / Contract for correction of discrepancies / typographical errors in the PO / Contract at a later date.</p>
47.	<p>FRAUD PREVENTION POLICY :</p> <p>The Bidder along with its associate / collaborators / sub-contractors / sub-vendors / consultants / service providers shall strictly adhere to BHEL Fraud Prevention Policy displayed on BHEL website http://www.bhel.com and shall immediately bring to the notice of BHEL Management about any fraud or suspected fraud as soon as it comes to their notice.</p>

Signature of Bidder (Authorized Signatory) with Date & Seal

TECHNICAL PRE- QUALIFYING REQUIREMENT

Project: 400/220/132kV GIS SUBSTATION AT SHAMLI, UP

Item: *Partial Discharge Detector with 5 type of sensing technologies*

The following requirements shall be met by the bidders:

SL no.	Description of technical requirement	Documents to be submitted for proof
1.	The Offered Make/model should have been supplied in past to Power utility, Industry, any NABL accredited testing laboratory, etc.	a. Purchase order copy shall be submitted. b. Proof of dispatch & receipt OR Performance certificate shall be submitted.
3.	The bidder should be manufacturer/authorised distributor of the Item/Items quoted.	Valid Authorization letter from OEM or Proof of manufacturing facilities.

Prepared by:



M.S. PUNDIR

Mgr-TBEM

Approved by:



Sanjeev Kr. Shrivastava

Sr. DGM-TBEM

ACTIVITY SCHEDULE [ANNEXURE II]

IMMEDIATE after approval of drawing and documents and issuance of MFC by BHEL however Break up of delivery period taken (Delay analysis for cases of delivery extension if required, shall be governed as per below schedule).

SL. NO.	ACTIVITY	ACTIVITY TIME IN WEEKS
1.	Submission of documents necessary for getting manufacturing clearance like Drawings, data sheet, MQP etc. (In scope of vendor)	02
2.	Review and Approval of documents and issue of manufacturing clearance (In scope of BHEL)	04
3.	Manufacturing Time & offer of Inspection to BHEL (In scope of vendor)	08
4.	Inspection (In scope of BHEL)	01
5.	Issue of MICC (In scope of BHEL)	01
6.	Dispatch (In scope of vendor)	01
7.	Transit time and receipt of material at Site	01

Note – 1) Supplier to ensure every revised submission incorporating comments (Complete in all respect) within 1 week from the date of comments by BHEL.

2) Supplier to furnish the advance information (at least 02 weeks) for inspection of the material after ensuring the readiness

Signature & Seal of

Supplier

Date:

Check List for Supply bills (ANNEXURE III)

Name Of the Project							
Package Description							
Invoice No. & Date							
PO No. & date							
Sr. No	Documents Required	Copies	Check Points	Page no.	Vendor Remarks (Y/N/NA)	Verification by MM (Y/N/NA)	Verification by Fin (Y/N/NA)
1	Original for Buyer Invoice - GST compliant invoice	1 Original+2 Copy	1. Please ensure GST complaint invoice in original 2. Consignee address : BHEL C/o followed by site address 3. Item description and unit of quantity are matched with PO 4. Buyer address and GSTN No as required (TBG Noida or Nodal 5. PO No and date, LR No and date, Vehicle No and Project name are 6. Invoiced quantity are not more than th PO quantity and MICC 7. Ex works unit rate , Taxes and F&I rates are same as per PO 8. Signed and stamped by vendor				
2	Received LR (signed & stamped)/ confirmation from site regarding receipt of packages/ Boxes	1Original+2 Copy	1. Consignee address : BHEL C/o followed by Site address 2. In case of material purchased from sub vendor , Consignee address Vendor's name C/o BHEL C/o Site address 3. Vendor's Invoice no and Vehicle No are mentioned 4. No of boxes/No of packages are same as per Packing list 5. In case of and adverse remark on LR (Like shortages/damages/broken etc) , clarification from site/TBMM/TBCM is needed 6. LR is readable 7. In case of photo copy, LR is verified by TBMM 8. LR date is after the date of MICC/(MDCC if issued) or same date				
3	Packing List - showing number of packages, and gross weight/net Weight (if applicable)	1Original+2 Copy	1. PO No and date, LR No and date, Invoice No and date, Site Name and address, Consignor and consignee address are mentioned 2. Item description and quantity are matched with Invoice and PO 3. Signed and stamped by vendor 4. No of packages/ Item descriptions are matched with MRC and LR				
4	MICC from BHEL	1Original+2C opy	1. BHEL MICC has been issued prior to the date of dispatch or on same date 2. In case where MICC date is after the date of dispatch then MDCC date is same or prior to the date of dispatch 3. Project Name, PO, Po Date, Vendor's name and address is correct 4. Item description, Quantity and unit of quantity are same as per PO 5. All hold point in MICC , if any, have been resolved before submission of bill 6. Signed and stamped by BHEL Executive 7. MICC and MDCC quantity are not less than Invoice quantity and cover all invoiced items.				
5	Guarantee Certificate	1 Original+2 Copy	1. Project Name, PO No., Invoice No , LR No and date are mentioned 2. Guarantee Certificate is strictly matched with PO T&C 3. Signed and stamped by vendor				
6	Bank Guarantee	1 Copy	1. Ensure submission of BG directly from Bank before supply of material so that BG confirmation may be arranged before processing 2. Bill can be processed only after receipt of BG confirmation directly from bank 3. It should be in the name of BHEL , TBG Noida with registered office address Siri Fort, New Delhi 4. It should be in prescribed format. 5. BG value and validity plus claim period should be minimum as specified in PO / RC. Please check before supply , If BG extension is required please arrange the same 6. Vendor's name address should be same as per PO 7. Po No / RC No and date should be correct				
7	Insurance Certificate	1 Original+2 Copy	1. Invoice No and date, Vendor's Name,Place from Consignor to Consignee are mentioned 2. It has not been issued later than the LR date 3. Insured value is not less than the Invoice value 4. Signed and stamped by Insurance Company 5. In case of Open Insurance Policy, declaration has been submitted to Insurance Company as per declaration clause of Open policy and 6. In case of any discrepancy , consent of TBCM is required for processing the bill and amount will be deducted for invalid Insurance				
8	PVC (If applicable) Invoice is submitted along with the Despatch Invoice	1Original+2C opy	PVC (If applicable) Invoice is submitted along with the Despatch Invoice 1. PVC invoice is attched along with supply Invoice 2. Calculation sheet and applicable PVC indices are also enclosed 3. If delay in delivery, then PVC indices are as per PO conditions.				
9	Material receipt Certificate		1. LR No and date, Invoice No and date, Vehicle No and date , Site Name an address are mentioned 2. Date of receipt of material 3. Item description and quantity are same as per Invoice / Packing List 4. It is signed and stamped by Site executive 5. In case of any shortages / damages / adverse remark , clarification is needed				
10	Other Documents		To be seen as per specific requirement of PO.				

(A) CONCILIATION (MODEL CONCILIATION CLAUSE FOR CONDUCTING CONCILIATION PROCEEDINGS UNDER THE BHEL CONCILIATION SCHEME, 2018)

The Parties agree that if at any time (whether before, during or after the arbitral or judicial proceedings), any Disputes (which term shall mean and include any dispute, difference, question or disagreement arising in connection with construction, meaning, operation, effect, interpretation or breach of the agreement, contract or the Memorandum of Understanding (whichever is inapplicable), which the Parties are unable to settle mutually), arise inter-se the Parties, the same may, be referred by either party to Conciliation to be conducted through Independent Experts Committee to be appointed by competent authority of BHEL from the BHEL Panel of Conciliators.

Notes:

1. No serving or a retired employee of BHEL/Administrative Ministry of BHEL shall be included in the BHEL Panel of Conciliators.
2. Any other person(s) can be appointed as Conciliator(s) who is/are mutually agreeable to both the parties from outside the BHEL Panel of Conciliators.

The proceedings of Conciliation shall broadly be governed by Part-III of the Arbitration and Conciliation Act 1996 or any statutory modification thereof and as provided in **Annexure-A to this GCC (Enclosed)**.

The Annexure-A together with its appendices will be treated as if the same is part and parcel hereof and shall be as effectual as if set out herein in these GCC.”

(B) ARBITRATION (WITH SOLE ARBITRATOR)

- 1.1. Except as provided elsewhere in this Contract, in case amicable settlement is not reached between the Parties, in respect of any dispute or difference; arising out of the formation, breach, termination, validity or execution of the Contract; or, the respective rights and liabilities of the Parties; or, in relation to interpretation of any provision of the Contract; or, in any manner touching upon the Contract, then, either Party may, by a notice in writing to the other Party refer such dispute or difference to the Sole Arbitrator and such Arbitrator appointed by Head of the BHEL Unit/Region/Division issuing the Contract.
- 1.2. The Arbitrator shall pass a reasoned award and the award of the Arbitrator shall be final and binding upon the Parties.
- 1.3. Subject as aforesaid, the provisions of Arbitration and Conciliation Act 1996 (India) and amended in 2015 and further amendment passed in 2019 or statutory modifications or re-enactments thereof and the rules made thereunder and for the time being in force shall apply to the arbitration proceedings under this clause. The seat of arbitration shall

be New Delhi. The language of arbitration shall be English and the documents shall be submitted in English.

- 1.4. The cost of arbitration shall initially be borne equally by the Parties subject to the final apportionment of the cost of the arbitration in the award of the Arbitrator.
- 1.5. Notwithstanding the existence or any dispute or differences and/or reference for the arbitration, the Contractor shall proceed with and continue without hindrance the performance of its obligations under this Contract with due diligence and expedition in a professional manner except where the Contract has been terminated by either Party in terms of this Contract.

1.6. **SETTLEMENT OF COMMERCIAL DISPUTES BETWEEN CPSES INTER SE AND CPSE(S) AND GOVERNMENT DEPARTMENT(S)/ ORGANISATION(S) – ADMINISTRATIVE MECHANISM FOR RESOLUTION OF CPSES DISPUTES (AMRCD) – REGARDING**

Vide Dept. of Public Enterprises OM No. F. No. 4(1)/2013-DPE(GM)/FTS-1835 dated 22.05.2018 it has been conveyed that *"To make the mechanism more effective and binding on the disputing parties, a new mechanism namely Administrative Mechanism for resolution of CPSEs Disputes (AMRCD) having two level (tier) structure has been evolved in consultation with various stakeholders to replace the existing PMA mechanism which stands wound up from the date of issue of this OM."* Accordingly, the existing Permanent Machinery of Arbitration (PMA) stands wound up with effect from 22.05.2018 and cases relating to disputes or differences relating to the interpretation and application of the provisions of commercial contract(s) between CPSEs / Port Trust / Central or State Government Department / Organisations (excluding disputes concerning Railways, Income Tax, Customs and Excise Departments) shall be taken up by either party for its resolution through Administrative Mechanism for Resolution of CPSEs Disputes (AMRCD).

(C) JURISDICTION AND GOVERNING LAWS

The Courts at New Delhi shall have exclusive jurisdiction over any matter arising out of or in connection with this Contract. This Contract shall be construed as per and be governed by the Laws of India.

ANNEXURE TO MODEL CONCILIATION CLAUSE FOR CONDUCT OF CONCILIATION UNDER THE BHEL CONCILIATION SCHEME, 2018

BRIEF PROCEDURE FOR CONDUCT OF CONCILIATION PROCEEDINGS

1. The proceedings of Conciliation shall broadly be governed by Part-III of the Arbitration and Conciliation Act 1996 or any statutory modification thereof and as provided herein:
2. The party desirous of resorting to Conciliation shall send an invitation/notice in writing to the other party to conciliate specifying all points of Disputes with details of the amount claimed. The party concerned shall not raise any new issue thereafter. Parties shall also not claim any interest on claims/counter-claims from the date of notice invoking Conciliation till the conclusion of the Conciliation proceedings.
3. The party receiving the invitation/notice for Conciliation shall within 30 days of receipt of the notice of Conciliation intimate its consent for Conciliation along with its counter-claims, if any.
4. The Conciliation in a matter involving claim or counter-claim (whichever is higher) up to Rs 5 crores shall be carried out by sole Conciliator nominated by BHEL while in a matter involving claim or counter-claim (whichever is higher) of more than Rs 5 crores Conciliation shall be carried out by 3 Conciliators nominated by BHEL.
5. The Parties shall be represented by only their duly authorized in-house executives/officers and neither Party shall be represented by a Lawyer.
6. The first meeting of the IEC shall be convened by the IEC by sending appropriate communication/notice to both the parties as soon as possible but not later than 30 days from the date of his/their appointment. The hearings in the Conciliation proceeding shall ordinarily be concluded within two (2) months and, in exceptional cases where parties have expressed willingness to settle the matter or there exists possibility of settlement in the matter, the proceedings may be extended by the IEC by a maximum of further 2 months with the consent of the Parties subject to cogent reasons being recorded in writing.
7. The IEC shall thereafter formulate recommendations for settlement of the Disputes supported by reasons at the earliest but in any case within

15 days from the date of conclusion of the last hearing. The recommendations so formulated along with the reasons shall be furnished by the IEC to both the Parties at the earliest but in any case within 1 month from the date of conclusion of the last hearing.

8. Response/modifications/suggestions of the Parties on the recommendations of the IEC are to be submitted to the IEC within time limit stipulated by the IEC but not more than 15 days from the date of receipt of the recommendations from the IEC.
9. In the event, upon consideration, further review of the recommendations is considered necessary, whether by BHEL or by the other Party, then, the matter can be remitted back to the IEC with request to reconsider the same in light of the issues projected by either/both the Parties and to submit its recommendations thereon within the following 15 days from the date of remitting of the case by either of the Parties.
10. Upon the recommendations by the Parties, with or without modifications, as considered necessary, the IEC shall be called upon to draw up the Draft Settlement Agreement in terms of the recommendations.
11. When a consensus can be arrived at between the parties only in regard to any one or some of the issues referred for Conciliation the draft Settlement Agreement shall be accordingly formulated in regard to the said Issue(s), and the said Settlement Agreement, if signed, by the parties, shall be valid only for the said issues. As regards the balance issues not settled, the parties may seek to resolve them further as per terms and conditions provided in the contract.
12. In case no settlement can be reached between the parties, the IEC shall by a written declaration, pronounce that the Conciliation between the parties has failed and is accordingly terminated.
13. Unless the Conciliation proceedings are terminated in terms of para 22 (b), (c) & (d) herein below, the IEC shall forward his/its recommendations as to possible terms of settlement within one (1) month from the date of last hearing. The date of first hearing of Conciliation shall be the starting date for calculating the period of 2 months.

14. In case of 3 members IEC, 2 members of IEC present will constitute a valid quorum for IEC and meeting can take place to proceed in the matter after seeking consent from the member who is not available. If necessary, videoconferencing may be arranged for facilitating participation of the members. However, the IEC recommendations will be signed by all members. Where there is more than one (1) Conciliator, as a general rule they shall act jointly. In the event of differences between the Members of IEC, the decision/recommendations of the majority of the Members of IEC shall prevail and be construed as the recommendation of the IEC.
15. The Draft Settlement Agreement prepared by the IEC in terms of the consensus arrived at during the Conciliation proceedings between the Parties shall be given by the IEC to both the parties for putting up for approval of their respective Competent Authority.
16. Before submitting the draft settlement agreement to BHEL's Competent Authority viz. the Board Level Committee on Alternative Dispute Resolution (BLCADR) for approval, concurrence of the other party's Competent Authority to the draft settlement agreement shall be obtained by the other party and informed to BHEL within 15 days of receipt of the final draft settlement agreement by it. Upon approval by the Competent Authority, the Settlement Agreement would thereafter be signed by the authorized representatives of both the Parties and authenticated by the members of the IEC.
17. In case the Draft Settlement Agreement is rejected by the Competent Authority of BHEL or the other Party, the Conciliation proceedings would stand terminated.
18. A Settlement Agreement shall contain a statement to the effect that each of the person(s) signing thereto (i) is fully authorized by the respective Party(ies) he/she represents, (ii) has fully understood the contents of the same and (iii) is signing on the same out of complete freewill and consent, without any pressure, undue influence.
19. The Settlement Agreement shall thereafter have the same legal status and effect as an arbitration award on agreed terms on the substance of the dispute rendered by an arbitral tribunal passed under section 30 of the Arbitration and Conciliation Act, 1996.
20. Acceptance of the Draft Settlement Agreement/recommendations of the Conciliator and/or signing of the Settlement Agreement by BHEL shall

however, be subject to withdrawal/closure of any arbitral and/or judicial proceedings initiated by the concerned Party in regard to such settled issues.

21. Unless otherwise provided for in the agreement, contract or the Memorandum of Understanding, as the case may be, in the event of likelihood of prolonged absence of the Conciliator or any member of IEC, for any reason/incapacity, the Competent Authority/Head of Unit/Division/Region/Business Group of BHEL may substitute the Conciliator or such member at any stage of the proceedings. Upon appointment of the substitute Conciliator(s), such reconstituted IEC may, with the consent of the Parties, proceed with further Conciliation into the matter either de-novo or from the stage already reached by the previous IEC before the substitution.

22. The proceedings of Conciliation under this Scheme may be terminated as follows:

- a. On the date of signing of the Settlement agreement by the Parties; or,
- b. By a written declaration of the IEC, after consultation with the parties, to the effect that further efforts at conciliation are no longer justified, on the date of the declaration; or,
- c. By a written declaration of the Parties addressed to the IEC to the effect that the Conciliation proceedings are terminated, on the date of the declaration; or,
- d. By a written declaration of a Party to the other Party and the IEC, if appointed, to the effect that the Conciliation proceedings are terminated, on the date of the declaration.
- e. On rejection of the Draft Settlement Agreement by the Competent Authority of BHEL or the other Party.

23. The Conciliator(s) shall be entitled to following fees and facilities:

Sl No	Particulars	Amount
1	Sitting fees	Each Member shall be paid a Lump Sum fee of Rs 75,000/- for the whole case payable in terms of paragraph No. 27 herein below.
2	Towards drafting of settlement agreement	In cases involving claim and/or counter-claim of up to Rs 5crores. Rs 50,000/- (Sole Conciliator)

Sl No	Particulars	Amount
		<p>In cases involving claim and/or counter-claim of exceeding Rs 5 crores but less than Rs 10 crores. Rs 75,000 (per Conciliator)</p> <p>In cases involving claim and/or counter-claim of more than Rs 10 crores. Rs 1,00,000/- (per Conciliator)</p> <p>Note: The aforesaid fees for the drafting of the Settlement Agreement shall be paid on Signing of the Settlement Agreement after approval of the Competent Authority or Rejection of the proposed Settlement Agreement by the Competent Authority of BHEL.</p>
3	Secretarial expenses	<p>Rs 10,000/- (one time) for the whole case for Conciliation by a Sole Member IEC.</p> <p>Where Conciliation is by multi member Conciliators –Rs 30,000/- (one time)- to be paid to the IEC</p>
4	<p>Travel and transportation and stay at outstation</p> <p>i) Retired Senior Officials of other Public Sector Undertakings (pay scale wise equivalent to or more than E-8 level of BHEL)</p>	<p>As per entitlement of the equivalent officer (pay scale wise) in BHEL.</p>
	Others	<p>As per the extant entitlement of whole time Functional Directors in BHEL.</p>

Sl No	Particulars	Amount
		Ordinarily, the IEC Member(s) would be entitled to travel by air Economy Class.
5	Venue for meeting	Unless otherwise agreed in the agreement, contract or the Memorandum of Understanding, as the case may be, the venue/seat of proceedings shall be the location of the concerned Unit / Division / Region / Business Group of BHEL. Without prejudice to the seat/venue of the Conciliation being at the location of concerned BHEL Unit / Division / Region / Business Group, the IEC after consulting the Parties may decide to hold the proceedings at any other place/venue to facilitate the proceedings. Unless, Parties agree to conduct Conciliation at BHEL premises, the venue is to be arranged by either Party alternately.

24. The parties will bear their own costs including cost of presenting their cases/evidence/witness(es)/expert(s) on their behalf. The parties agree to rely upon documentary evidence in support of their claims and not to bring any oral evidence in IEC proceedings.
25. If any witness(es) or expert(s) is/are, with the consent of the parties, called upon to appear at the instance of the IEC in connection with the matter, then, the costs towards such witness(es)/expert(s) shall be determined by the IEC with the consent of the Parties and the cost so determined shall be borne equally by the Parties.
26. The other expenditures/costs in connection with the Conciliation proceedings as well as the IEC's fees and expenses shall be shared by the Parties equally.
27. Out of the lump sum fees of Rs 75,000/- for Sitting Fees, 50% shall be payable after the first meeting of the IEC and the remaining 50% of the Sitting Fees shall be payable only after termination of the conciliation proceedings in terms of para 22 hereinabove.

28. The travelling, transportation and stay at outstation shall be arranged by concerned Unit as per entitlements as per Serial No. 3 of the Table at para 23 above, and in case such arrangements are not made by the BHEL Unit, the same shall be reimbursed to the IEC on actuals limited to their entitlement as per Serial No. 4 of the Table at Para 23 above against supporting documents. The IEC Member(s) shall submit necessary invoice for claiming the fees/reimbursements.
29. The Parties shall keep confidential all matters relating to the conciliation proceedings. Confidentiality shall extend also to the settlement agreement, except where its disclosure is necessary for purposes of its implementation and enforcement or as required by or under a law or as per directions of a Court/Governmental authority/regulatory body, as the case may be.
30. The Parties shall not rely upon or introduce as evidence in any further arbitral or judicial proceedings, whether or not such proceedings relate to the Disputes that is the subject of the Conciliation proceedings:
 - a. Views expressed or suggestions made by the other party in respect of a possible settlement of the Disputes;
 - b. admissions made by the other party in the course of the Conciliator proceedings;
 - c. proposals made by the Conciliator;
 - d. The fact that the other Party had indicated his willingness to accept a proposal for settlement made by the Conciliator.
31. The Parties shall not present the Conciliator(s) as witness in any Alternative Dispute Resolution or Judicial proceedings in respect of a Disputes that is/was the subject of that particular Conciliation proceeding.
32. None of the Conciliators shall act as an arbitrator or as a representative or counsel of a Party in any arbitral or judicial proceeding in respect of a Disputes that is/was the subject of that particular Conciliation proceeding.
33. The Parties shall not initiate, during the Conciliation proceedings, any arbitral or judicial proceedings in respect of a Disputes that is the subject matter of the Conciliation proceedings except that a Party may initiate arbitral or judicial proceedings where, in his opinion, such proceedings are necessary for preserving his rights including for preventing expiry of period of limitation. Unless terminated as per the provisions of this Scheme, the Conciliation proceedings shall continue

notwithstanding the commencement of the arbitral or judicial proceedings and the arbitral or judicial proceedings shall be primarily for the purpose of preserving rights including preventing expiry of period of limitation.

34. The official language of Conciliation proceedings under this Scheme shall be English unless the Parties agree to some other language.

Format 2 to BHEL Conciliation Scheme, 2018

**FORMAT FOR SEEKING CONSENT FOR REFERRING THE DISPUTES TO
CONCILIATION THROUGH IEC**

To,

M/s. (Stakeholder's name)

**Sub: Resolution of the Disputes through conciliation by Independent
Expert Committee (IEC).**

Ref: Contract No/MoU/Agreement/LOI/LOA& date _____.

Sir,

With reference to above referred Contract/MoU/Agreement/LOI/LOA, you have raised certain Disputes/claims. Vide your letter dated_____ you have requested BHEL to refer the Disputes/claims to IEC for Conciliation.

We are enclosing herewith Format (3) for giving consent and the terms and conditions of BHEL Conciliation Scheme, 2018 governing conciliation through IEC. You are requested to give your unconditional consent to the said terms and conditions of the Scheme by returning the same duly sealed and signed on each page. On receipt of your consent, matter will be put to the Competent Authority for consideration and decision.

Please note that BHEL has also certain claims against you (if applicable). BHEL reserves its right to agree or not to agree conciliation of the said disputes through BHEL and this letter is being issued without prejudice to BHEL's rights and contentions available under the contract and law.

Yours faithfully,

Representative of BHEL

Format 3 to BHEL Conciliation Scheme, 2018
FORMAT FOR GIVING CONSENT BY
CONTRACTOR/VENDOR/CUSTOMER/COLLABORATOR/CONSORTIUM PARTNERS FOR REFERRING THE DISPUTES TO CONCILIATION THROUGH IEC

To,

BHEL

.....

Sub: Resolution of Disputes through Conciliation by Independent Expert Committee (IEC).

Ref: Contract/MoU/Agreement/LOI/LOA No & date____

With reference to above referred contract, our following bills/invoices/claims submitted to BHEL are still unpaid giving rise to Disputes:

SL. no.	Claim Description	Bill submitted to BHEL (no. and date)	Amount of the bill/claim	Amount received from BHEL	Outstanding Amount

Accordingly we request you to kindly refer the Disputes in respect of above claims to IEC for Conciliation.

We hereby agree and give our unconditional consent to the terms and conditions of BHEL Conciliation Scheme, 2018 governing conciliation through IEC. We have signed the same on each page and enclosed it for your consideration.

Yours faithfully,

(Signature with stamp)

Authorized Representative of Contractor

Name, with designation

Date

Format 5 to BHEL Conciliation Scheme, 2018
STATEMENT OF CLAIMS/COUNTER CLAIMS TO BE SUBMITTED TO
THE IEC BY BOTH THE PARTIES

1. Chronology of the Disputes
2. Brief of the Contract/MoU/Agreement/LOI/LOA
3. Brief history of the Disputes:
4. Issues:
5. Details of Clam(s)/Counter Claim(s):

SI. No.	Description of claim(s)/Counter Claim	Amount (in INR)Or currency applicable in the contract	Relevant contract clause

6. Basis/Ground of claim(s)/counter claim(s) (along with relevant clause of contract)

Note– *The Statement of Claims/Counter Claims may ideally be restricted to maximum limit of 20 pages. Relevant documents may be compiled and submitted along with the statement of Claims/Counter Claims. The statement of Claims/Counter Claims is to be submitted to all IEC members and to the other party by post as well as by email.*

Annexure-V

Item/Package Name :	Supply of PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES
Project:	400/220/132kV GIS SUBSTATION AT SHAMLI, UP
Percentage of Local Content	(Bidder to enter the applicable % of local content)

Format of Self certification regarding Local Content in line with PPP-MII order, order ref no.:- A-1/2021-FSC-Part (5) dated 16.11.2021 issued by Govt of India, Ministry of Power)

Date: / /

I _____ S/o, D/o, W/o, _____ Resident of _____ hereby solemnly affirm and declare as under:

That I will agree to abide by the terms and conditions of the Public Procurement (Preference to Make in India) Order, 2017 (*hereinafter PPP-MII order*) of Government of India issued vide Notification No: P-45021/2/2017-BE-II dated 15/06/2017, its revision dated 04/06/2020 and any subsequent modifications/ Amendments, if any.

That the information furnished hereinafter is correct to the best of my knowledge and belief and I undertake to produce relevant records before the procuring entity/ **BHEL** or any other Government authority for the purpose of assessing the local content of goods/ services/ works supplied by me for **(Enter the name of the Equipment/Item for Project)**.

That the local content for all inputs which constitute the said goods/ services/ works has been verified by me and I am responsible for the correctness of the claims made therein.

That the goods/ services/ works supplied by me for **(Enter the name of the Equipment/Item for Project)** **contains.....%** **(mention the Local content in %age)** Local Content.

That the value addition for the purpose of meeting the 'Minimum Local Content 'has been made by me at **(Enter the details of the location(s) at which value addition is made)**.

That in the event of the local content of the goods/ services/ works mentioned herein is found to be incorrect and not meeting the prescribed supplier class categorization criteria as per said order, based on the assessment of procuring agency (ies)/ **BHEL**/ Government Authorities for the purpose of assessing the local content, action shall be taken against me in line with the PPP-MII order and provisions of the Integrity pact/ Bidding Documents.

Annexure-V

Item/Package Name :	Supply of PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES
Project:	400/220/132kV GIS SUBSTATION AT SHAMLI, UP
Percentage of Local Content	(Bidder to enter the applicable % of local content)

I agree to maintain the following information in the Company's record for a period of 8 years and shall make this available for verification to any statutory authority.

- i Name and details of the Local Supplier
(Registered Office, Manufacturing unit location, nature of legal entity)
- ii. Date on which this certificate is issued
- iii. Goods/services/works for which the certificate is produced
- iv. Procuring entity to whom the certificate is furnished
- v. Percentage of local content claimed and whether it meets the Minimum Local Content prescribed
- vi. Name and contact details of the unit of the Local Supplier (s)
- vii. Sale Price of the product
- viii Ex-Factory Price of the product
- ix. Freight, insurance and handling
- x. Total Bill of Material
- xi List and total cost value of input used to manufacture the Goods/ to provide services/ in construction of works
- xii. List and total cost of input which are domestically sourced. Value addition certificates from suppliers, if the input is not in-house to be attached
- xiii. List and cost of inputs which are imported, directly or indirectly

For and on behalf of..... (Name of firm/entity)

Authorized signatory (To be duly authorized by the Board of Directors)

<Insert Name, Designation and Contact No.>

Clause regarding regarding restrictions under Rule 144 (XI) of the General Financial Rules (GFRs), 2017 as per Government of India order OM No.6/18/2019-PPD dated 23.07.2020

- I. Any bidder from a country which shares a land border with India will be eligible to bid in this tender only if the bidder is registered with the Competent Authority.
- II. "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any person or firm or company including any member of a consortium or joint venture (that is an association of several persons, or firms or companies), every artificial juridical person not failing in any of the descriptions of bidders stated hereinbefore, including any agency branch or office controlled by such person, participating in a procurement process.
- III. "Bidder from a country which shares a land border with India" for the purpose of this Order means:
 - a. An entity Incorporated, established or registered in such a country; or
 - b. A subsidiary of an entity Incorporated, established or registered in such a country; or
 - c. An entity substantially controlled through entitles incorporated, established or registered in such a country; or
 - d. An entity whose *beneficial owner* is situated in such a country, or
 - e. An Indian (or other) agent of such an entity; or
 - f. A natural person who is a citizen of such a country; or
 - g. A consortium or joint venture where any member of the consortium or joint venture falls under any of the above
- IV. The *beneficial owner* for the purpose of (iii) above will be as under:
 1. In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.
Explanation-
 - a. "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent. of shares or capital or profits of the company;
 - b. "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholder's agreements or voting agreements;
 2. In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting alone or together, or through one or more juridical person, has ownership or entitlement to more than fifteen percent of capital or profits of the partnership;
 3. In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has ownership or entitlement to more than fifteen percent of the property or capital or profits of such association or body of Individuals;
 4. Where no natural person is Identified under (1) or (2) or (3) above the beneficial owner is the relevant natural person who holds the position of senior managing official;
 5. In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen percent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.
- V. An Agent is a person employed to do any act for another or to represent another in dealings with third person.

Clause regarding regarding restrictions under Rule 144 (XI) of the General Financial Rules (GFRs), 2017 as per Government of India order OM No.6/18/2019-PPD dated 23.07.2020

VI. The successful bidder shall not be allowed to sub-contract works to any contractor from a country which shares a land border with India unless such contractor is registered with the Competent Authority.

** The above clause is not applicable to the bidders from those countries (even if sharing a land border with India) to which the GoI has extended lines of credit or in which the GoI is engaged in development projects.*

* List of countries to which lines of credit have been extended or in which development projects are undertaken are available on the Ministry of External affairs website (<https://www.mea.gov.in/>)

Compliance to be submitted in INR 100/- non judicial stamp paper

Sub: Compliance to Government of India order OM No.6/18/2019-PPD dated 23.07.2020 regarding restrictions under Rule 144 (XI) of the General Financial Rules (GFRs), 2017

Sl No.	Description	Bidder's confirmation
1	<i>We, M/s _____ have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India; We hereby certify that we are not from such a country.</i>	<i>Agreed</i>

(Note: Non-compliance of above said GoI Order and its subsequent amendment, (if any), by any bidder(s) shall lead for commercial rejection of their bids by BHEL)

Bidder's authorized signatory with stamp & seal

Compliance to be submitted in INR 100/- non judicial stamp paper

Sub: Compliance to Government of India order OM No.6/18/2019-PPD dated 23.07.2020 regarding restrictions under Rule 144 (XI) of the General Financial Rules (GFRs), 2017

SI No.	Description	Bidder's confirmation
1	<p><i>We, M/s_____ have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India. We are from such a country which shares a land border with India & have been registered with the Competent Authority as specified in above said order. We hereby certify that we fulfil all requirements in this regard and are eligible to be considered.</i></p> <p><i>Evidence of valid registration by the Competent Authority is attached.</i></p>	<p align="center"><i>Agreed</i></p>

(Note: Non-compliance of above said GoI Order and its subsequent amendment, (if any), by any bidder(s) shall lead for commercial rejection of their bids by BHEL)

Bidder's authorized signatory with stamp & seal

No.25-111612018-PG
Government of India
Ministry of Power
Shram Shakti Bhawan, Rafi Marg, New Delhi • — 110001
Tele Fax: 011-23730264

Dated 02/07/2020

ORDER

Power Supply System is a sensitive and critical infrastructure that supports not only our national defence, vital emergency services including health, disaster response, critical national infrastructure including classified data & communication services, defence installations and manufacturing establishments, logistics services but also the entire economy and the day-to-day life of the citizens of the country. Any danger or threat to Power Supply System can have catastrophic effects and has the potential to cripple the entire country. Therefore, the Power Sector is a strategic and critical sector.

The vulnerabilities in the Power Supply System & Network mainly arise out of the possibilities of cyber attacks through malware / Trojans etc. embedded in imported equipment. Hence, to protect the security, integrity and reliability of the strategically important and critical Power Supply System & Network in the country, the following directions are hereby issued:-

1. All equipment, components, and parts imported for use in the Power Supply System and Network shall be tested in the country to check for any kind of embedded malware/trojans/cyber threat and for adherence to Indian Standards.
2. All such testings shall be done in certified laboratories that will be designated by the Ministry of Power (MOP).
3. Any import of equipment/components/parts from "prior reference" countries as specified or by persons owned by, controlled by, or subject to the jurisdiction or the directions of these "prior reference" countries will require prior permission of the Government of India
4. Where the equipment/components/parts are imported from "prior reference" countries, with special permission, the protocol for testing in certified and designated laboratories shall be approved by the Ministry of Power (MOP).

This order shall apply to any item imported for end use or to be used as a component, or as a part in manufacturing, assembling of any equipment or to be used in power supply system or any activity directly or indirectly related to power supply system.

This issues with the approval of Hon'ble Minister of State for Power and New & Renewable Energy (Independent Charge).



(Goutam Ghosh)

Director Tel: 011-23716674 To:

1. All Ministries/Departments of Government of India (As per list)
2. Secretary (Coordination), Cabinet Secretariat
3. Vice Chairman, NITI Aayog

सेवा भवन, आर. के. पुरम-I, नई दिल्ली-110066 टेली: 011-26732257 ईमेल: ce-rndcea@nic.in वेबसाइट:
www.cea.nic.in

Sewa Bhawan, R.K Puram-I, New Delhi-110066 Tele: 011-26732257 Email: ce-rndcea@nic.in Website: www.cea.nic.in

Vendor Compliance format in bidder letter head

In view of by order No. 25-111612018-PG, Dated 02.07.2020 of Ministry of Power, GOI

Enquiry No/ PO No & Date : 21Q2400200 dated 31.10.2023
Project : 400/220/132kV GIS SUBSTATION AT SHAMLI, UP
Name of items/Package : PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES

This is to certify that all equipment, components, and parts imported for use in the Power Supply System and Network are in strict compliance to directions issued by Ministry of Power, Govt. of India vide order No. 25-111612018-PG dated 02.07.2020. The imported component(s), part or assembly item(s) does not carry any malware/Trojan etc.

Note: Non-compliance of MoP Order and its subsequent amendment(s), (if any), by vendor shall lead to rejection of their offer or cancellation of contract, which is awarded by BHEL.

Bidder's authorized signatory
with stamp & seal

Unpriced bid format

Bidders to mark "Quoted" in this unprice BOQ Format.

The price to be quoted in the "Price Bid Format" only which is attached separately with the Enquiry.

Tender Inviting Authority: BHEL/ TBG

Name of Item:- Supply of PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES for 400/220/132kV GIS SUBSTATION AT SHAMLI, UP

Enquiry/NIT No: 21Q2400200 dated 31.10.2023

Name of the Bidder/ Bidding Firm / Company :		
---	--	--

PRICE SCHEDULE

(This BOQ template must not be modified/replaced by the bidder and the same should be uploaded after filling the relevant columns, else the bidder is liable to be rejected for this tender. Bidders are allowed to enter the Bidder Name, Quoted and applicable GST % only)

Sl. No.	Item Description	Item Code / Make	Quantity	Units	Quoted (yes/No)	GST (in Percentage)
1	SUPPLY- INSTRUMENTS : PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES	item1	1.00	NOS		




BHARAT HEAVY ELECTRICALS LIMITED

TRANSMISSION BUSINESS ENGINEERING MANAGEMENT

COPYRIGHT AND CONFIDENTIALITY
The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.
It must not be used directly or indirectly in anyway detrimental to the interest of the company

DOCUMENT No.	TB-406-316-TI-02A	Rev. No.	00	Prepared	Checked	Approved		
TYPE OF DOC.	TECHNICAL SPECIFICATION	SIGN	-sd-	-sd-	-sd-			
TITLE	Testing Instruments	NAME	MSP	SKS	AG			
		DATE						
		GROUP	TBEM	W.O.No	88009			
CUSTOMER	UTTAR PRADESH TRANSMISSION CORPORATION LTD (UPPTCL)							
PROJECT	400/220/132 kV GIS SUBSTATION AT SHAMLI, U.P.							
CA NO.	1311/ESD-8/126/III/400 kV SHAMLI dtd 14.11.2018Services							
STATION	SHAMLI							
CONTENTS								
Section	Description					No. of sheets		
1	Scope, Quantities & Specific technical requirements					3		
2	Equipment Specification					3		
3	Project details and General Technical Requirement					54		
Rev No.	Date	Alte red	Checked	Approved	REVISION DETAILS			
Distribution				To	TBEM	TBMM	TBQM	Vendor
				Copies	1	1	1	4

	Project:	400/220/132 kV GIS Substation at Shamli, U.P.
	Customer:	Uttar Pradesh Transmission Corporation Ltd (UPPTCL)
	Contractor:	Bharat Heavy Electricals Limited
	Document No.	TB-406-316-TI-02A, Rev.00
	Technical Specification:	Testing Instruments

SECTION - I

Scope, Quantities and Specific Technical Requirements

1.1 Scope

This specification is intended to specify the requirements for Supply of operation & maintenance test equipment & tools required at the sites as mentioned in subsequent clause. The scope of work shall encompass at least the following:

- i) Detailed design of all the equipment
- ii) Inspection and testing before supply
- iii) Packing, Loading & Transportation to site
- iv) Providing engineering data, drawings, Brochures and O & M manuals for BHEL/UPPTCL review, approval and records.
- v) Testing, Demonstration at site & Commissioning of the testing equipment.

1.2 Terminology

The following terminology shall be applicable for the purpose of interpreting the relevant clauses of the specification.

Name of customer: **Uttar Pradesh Transmission Corporation Ltd (UPPTCL)**

Name of Projects: **400/220/132 kV GIS Substation at Shamli, U.P.**

Refer section-3 of this document for project details and general specification.

The fitment and equipments offered shall be of approved make of UPPTCL or its subsequent approval from UPPTCL shall be bidder's responsibility with no commercial implications to BHEL. If any of the make offered by the bidder is not acceptable to M/s UPPTCL, the bidder has to supply alternate UPPTCL approved make, meeting the specification, with no commercial implications to BHEL.


Any technical deviation shall be clearly mentioned by bidder as per Technical deviation schedule in its offer.

1.3 Bill of quantities

S. NO.	Description	Unit	Qty
1	Ground Grid Test Set	No.	1
2	Partial Discharge Detector with 5 type of sensing technologies	No.	1


Note:-

1. Supplier should specify the Make & Model & accessories/complete scope of supply offered against each item along with Technical Bid.
2. Supplier is required to provide all the Technical details/ Catalogue/Datasheet of the offered make/model against each item.
3. The Catalogue of the offered make/ Model shall be available on OEM website as on Technical Bid opening date. The catalogue submitted should match with the one available on website.
4. Make/Model offered is subject to UPPTCL approval. UPPTCL approval shall be considered

	Project:	400/220/132 kV GIS Substation at Shamli, U.P.
	Customer:	Uttar Pradesh Transmission Corporation Ltd (UPPTCL)
	Contractor:	Bharat Heavy Electricals Limited
	Document No.	TB-406-316-TI-02A, Rev.00
	Technical Specification:	Testing Instruments

as final.

5. All the above listed equipment shall be supplied with standard accessories & any other accessory required to meet the technical specification.
6. The Test equipment shall be delivered to each site separately in new/ fresh condition.
7. Supplier shall provide valid calibration certificate, test certificate & warranty certificate for the quoted test equipment (as applicable), in the event of order.
8. Supplier is required to give an undertaking "to address issue of warranty / after sales services either itself or from the respective manufacturer/OEM of the equipment" along with technical offer on its/OEM letterhead. Further Supplier may be required to furnish the Authorisation letter from OEM for sales/after sales for the equipment.
9. Supplier is required to give undertaking (in the technical offer) from respective manufacturer/OEM of the equipment on OEM letterhead stating that the offered make/model is suitable for use in 400kV AC charged station & there will be no change in technical performance of the equipment during the equipment life in the site conditions.
10. The test and maintenance equipment shall be of top quality & UPPTCL may call for demonstration of the offered test equipment in 400kV charged switchyard, to ensure satisfactory performance before accepting the equipment. The same shall be without any price implication.
11. Bidder should submit the performance certificate (in the technical offer) issued from customer (Power utilities, Powerplant, Govt approved Lab, etc) available with them for all the offered make/model. The performance certificate should be verifiable from the customer.
12. In case the performance certificate is not available, bidder should submit the Purchase order copy (unpriced) along with technical offer for all the offered make/model not more than 5 year old from Technical bid opening. Also the successful demonstration certificate shall be furnished for the offered make/model.
13. Bidder must comply at least any one of the above point 11/12 to check the proven ness of the offered make/model, or the technical offer for the respective item will not be considered for technical evaluation.
14. The instrument is intended for use in high-voltage substation (up to 400kV) and industrial environment. The testing equipment are generally meant for carrying out testing at site and movement from one place to another is unavoidable. Therefore equipment shall be robust in design so that it gives desired performance even in adverse site conditions. Necessary transport packing arrangement shall be provided along with the equipment.
15. Technical Evaluation of above items will be done item wise. Bidder may quote for One or more no of items from the above BOQ.
16. In event of placement of order, if the selected make/model is obsolete/upgraded during the supply stage, vendor need to supply equivalent/better make/model without any price implication with prior approval of BHEL/UPPTCL. The same need to be confirmed by bidder.

	Project:	400/220/132 kV GIS Substation at Shamli, U.P.
	Customer:	Uttar Pradesh Transmission Corporation Ltd (UPPTCL)
	Contractor:	Bharat Heavy Electricals Limited
	Document No.	TB-406-316-TI-02A, Rev.00
	Technical Specification:	Testing Instruments

Section-2

2.1 GROUND GRID TEST SET:

The Ground Grid Test Set shall be designed to ensure the integrity of grounding systems and to test personal safety grounds. The high-current method of testing ground grid continuity and connections is a reliable, accurate method of detecting faults in the ground system.

Testing of a ground grid consists of passing 300 amperes ac through the grid, for a specified time, between a reference ground (usually a transformer neutral) and the ground to be tested. The voltage drop and the magnitude and direction of the current are monitored to verify the integrity of the ground connection. Another application for Ground Grid Test Set is the testing of safety ground clamps, ferrules and cables. Testing these devices requires continuous current at the rating of the particular device. The Ground Grid Test Set can test devices that require up to 300 amperes continuous current.

Ground Grid Integrity Measurements


Neither the ground resistance measurements nor the touch potential measurements provide information on the ability of grounding conductors and connections to carry ground fault currents safely to earth. Experience has shown that the ground fault current can cause a lot of damage to equipment and pose safety hazard to personnel when it does not find a low-impedance path to the ground grid and thus to mother earth. Therefore, it makes sense to periodically check and verify the integrity of the ground grid connections.

The objective of this measurement is to determine whether the equipment, frame, structures, or enclosure grounds are connected to the grounding electrode or ground grid with low resistance. The resistance value of such connections is expected to be very low (100 micro Ohm or less). The best way for making tests for integrity of ground grid connections is to use a large but practical current and some means of detecting the voltage drop caused by this current. A test set is available to conduct this measurement using AC current. This test method is known as the high-current test method. This method consists of passing 300 A through the ground grid between a reference ground (usually a transformer neutral) and the ground (conductor and connections) to be tested. The voltage drop and the current magnitude and direction are monitored to verify the integrity of the ground connections.


The Ground Grid Test Set test connections for conducting this test are shown in **Figure below**.

The below listed guidelines are offered when using the high-current method of testing the continuity of ground grids and grounds. However, it should be kept in mind that these are only guidelines since each ground has to be considered on its own merits relative to other grounds in the immediate vicinity.

1. The voltage drop of the ground grid rises approximately 1 V for each 50 ft of straight distance from the reference point.
2. On equipment with single ground the ground can be considered satisfactory if the voltage drop is in line with item 1 above and at least 200 A flow to the ground conductor under test

	Project:	400/220/132 kV GIS Substation at Shamli, U.P.
	Customer:	Uttar Pradesh Transmission Corporation Ltd (UPPTCL)
	Contractor:	Bharat Heavy Electricals Limited
	Document No.	TB-406-316-TI-02A, Rev.00
	Technical Specification:	Testing Instruments

into the grid. On most equipment of this type, 300 A will flow to the grid; however, in some cases current will also flow through foundation bolts and or conduits.

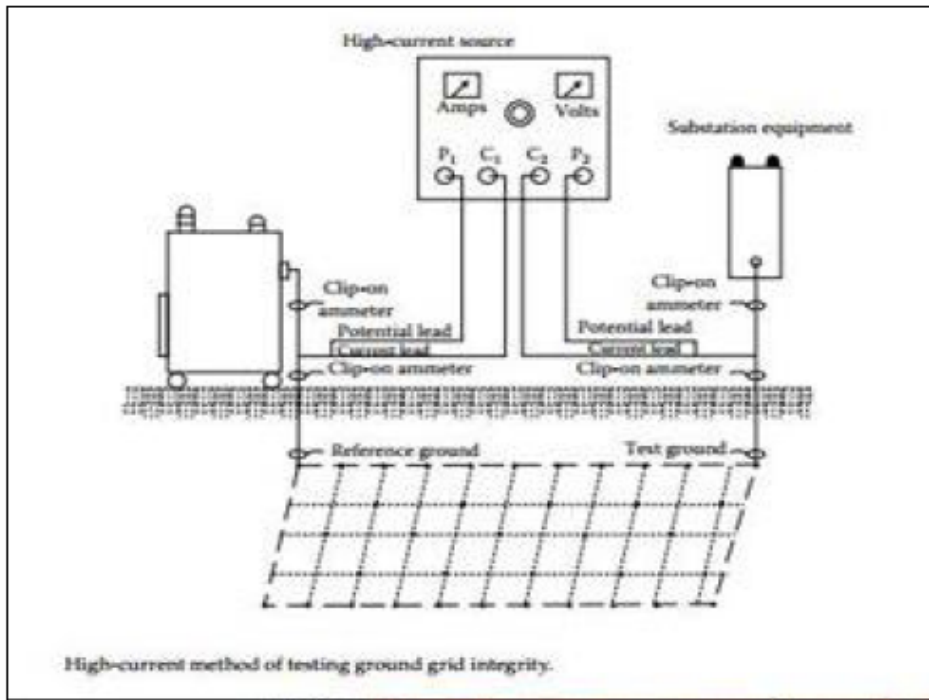


3. On equipment with multi-grounds, a ground can be considered satisfactory if the voltage drop is in line with item 1 above and at least 150 A flow to the ground conductor under test into the grid. If the current to the grid is less than 150 A, the ground should be disconnected from the equipment and 300 A again should be passed through the ground. If the ground passes the 300 A and the voltage drop does not increase more than 0.5 V over the previous level, the ground can be considered satisfactory.

“Caution: Before any ground is removed from an equipment be sure to parallel it with a 2/0 CU temporary ground, such as a truck ground or other grounds before it is disconnected.”

4. To test transformer neutral or reference point pass 300 A through the transformer neutral at a point above grade but below any bonding connections or clamps on the tank. If at least 150 A flow to the ground grid, the reference point can be considered satisfactory.

5. Establish a reference ground, preferably a transformer neutral. From a high-current AC source connect one test lead to ground being tested as shown in Figure. Connect the test lead at a point above grade but below the bonding connections or clamps. Pass 300 A through the ground grid and record the voltage drop across the grid. Using a clip-on ammeter, measure the amount of test current flowing above (to the equipment) and below (to the grid) the test lead on the ground being tested. The voltage drop should be in accordance with item 1 above. The test amperes should be in accordance with items 2 and 3 in this list.

	Project:	400/220/132 kV GIS Substation at Shamli, U.P.
	Customer:	Uttar Pradesh Transmission Corporation Ltd (UPPTCL)
	Contractor:	Bharat Heavy Electricals Limited
	Document No.	TB-406-316-TI-02A, Rev.00
	Technical Specification:	Testing Instruments

The instrument shall be supplied with all standard accessories required for complete working of the equipment.

2.2 Partial Discharge Detector with 5 type of sensing technologies:

S.No.	Parameter		Value
1.	Sample resolution		12bit
2.	HFCT Probe	Amplitude range	1-60dBmV
		Frequency range	0.5MHz-20MHz
3.	Airborne Acoustic Probe	Amplitude range	-10-73dB μ V
		Central frequency	40kHz
4.	Contact Acoustic Sensor	Frequency Range	20kHz - 300kHz
5.	TEV Probe	Amplitude range	1-60dBmV
		Central frequency	1-60MHz
6.	Ultra High Frequency Sensor	Amplitude range	1-60dBmV
		Central frequency	300-2000MHz
7.	Battery charge unit	Input voltage	90%-120% of 220VAC
		Frequency	45~55Hz
		Weight	<400g
		Output voltage	8.4V
		Output current	1A
8.	Weight	case materials	ABS
		Size	-
		Weight	<3.5kg

Package List

S.No.	Product Description
1.	The Penta PD Detector
2.	1 x HFCT 100/50 Split-Core Sensors
	(50mm \pm 3mm inner diameter)
3.	1 x TEV Probes
4.	1 x Ultra High Frequency Probe
5.	1 x Airborne Acoustic Probe
6.	1 x BNC Signal Cables 1m
7.	1 x case with foam
8.	1 no ,PD Analysis Software

The instrument shall be supplied with all standard accessories required for complete working of the equipment.

SECTION-3

GENERAL TECHNICAL REQUIREMENTS OF SPECIFICATIONS (GTR)

INDEX

1.0	GENERAL
2.0	COMPLETENESS OF EQUIPMENTS
3.0	STANDARDS
4.0	PROJECT DATA
5.0	SYSTEM PARTICULARS
6.0	SYSTEM PARAMETERS
7.0	SERVICES TO BE PERFORMED BY THE EQUIPMENT
8.0	CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS
9.0	SUPPORT STRUCTURES
10.0	COLOUR SCHEME AND CODES FOR PIPE SERVICE
11.0	MATERIAL / WORKMANSHIP
12.0	SPACE HEATERS
13.0	FUNGISTATIC VARNISH
14.0	VENTILATION OPENING
15.0	DEGREE OF PROTECTION
16.0	RATING PLATES, NAME PLATES AND LABELS
17.0	FIRST FILL OF CONSUMABLES, OIL AND LUBRICANTS
18.0	PACKAGING AND PROTECTION
19.0	SURFACE FINISH
20.0	HOT DIP GALVANISING
21.0	PROTECTIVE GUARDS
22.0	TOOLS AND TACKLES
23.0	CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES & MARSHALLING BOXES FOR OUTDOOR EQUIPMENT
24.0	TERMINAL BLOCKS AND WIRING
25.0	LAMPS AND SOCKETS
26.0	BUSHINGS, HOLLOW COLUMN INSULATORS, SUPPORT INSULATORS
27.0	MOTORS
28.0	TECHNICAL REQUIREMENT OF EQUIPMENTS
ANNEXURE – A	CORONA AND RADIO INTERFERENCE VOLTAGE (RIV) TEST
ANNEXURE – B	SEISMIC WITHSTAND TEST PROCEDURE
ANNEXURE – C	LIST OF SPECIFICATIONS STANDARDS AND CODES

GENERAL TECHNICAL REQUIREMENTS OF SPECIFICATIONS (GTR)

1.0 GENERAL

This section stipulates the General Technical Requirements (GTR) under the Contract and will form an integral part of the Technical Specification.

The provisions under this section are intended to supplement general requirements for the materials, equipments and services covered under respective equipment sections and are not exclusive. However in case of conflict between the requirement specified in this section and requirements specified under respective equipment sections, the requirements specified under respective sections shall hold good.

Every effort will be made to supply all equipment as per the technical details furnished in the specification. However, due to the standard manufacturing practice of various equipment suppliers and depending on the selected vendor, there may be slight variations from indicated values at the contract stage. Such variations should not affect the quality and performance of the equipment.

It is not the intent to specify completely in technical specifications of equipments/ materials all details of the design and construction of equipment. However, the equipment shall conform in all respects to high standards of engineering, design and workmanship and shall be capable of performing in continuous commercial operation. The Purchaser will interpret the meaning of drawing and specification and shall have the power to reject any work or material which in his judgement is not in accordance therewith. The equipment offered shall be complete with all components necessary for its effective and trouble free operation. Such components shall be deemed to be within the scope of Bidder's supply, irrespective of whether these are specifically brought out in this specification and/or commercial order or not.

2.0 COMPLETENESS OF EQUIPMENTS

2.1 Equipments furnished shall be complete in every respect with all mountings, fittings, fixtures and standard accessories specified &/or normally provided with such equipment and/ or needed for erection, completion and safe operation of the equipment as required by applicable codes though they may not have been specifically detailed in the Technical Specifications. Materials and components not specifically stated in the specification but which are necessary for commissioning and satisfactory operation of the substation unless specifically excluded shall be deemed to be included in the scope of the specification and shall be supplied without any extra cost All similar standard components/ parts of similar standard equipment provided, shall be inter-changeable with one another.

2.2 The Bidder shall supply type tested (including special test as per technical specification) equipments and materials. The test reports/details shall be furnished by the Bidder in the bid. In the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes or due to non-compliance with the requirement stipulated in the Technical Specification and/or IEC/ IS, same, shall be carried out without any additional cost implication to the Purchaser. The Purchaser reserves the right to get any or all type tests conducted/ repeated.

The reports for all type tests and additional type tests as per technical specification furnished by the Bidder shall be of the tests conducted within last 05(five) years prior to the date of bid opening. The type tests conducted should have either been conducted in accredited laboratory (accredited based on ISO/ IEC Guide 25/ 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by UPPTCL or representative authorized by UPPTCL or Utility or representative of accredited test lab or reputed consultant.

3.0 STANDARDS

3.1 Except as modified by this Bid specification, all material and equipment shall conform to the requirement of the latest editions of relevant ISS/ IEC and other applicable standards. The equipments/ works shall be designed, engineered, manufactured, built, tested and commissioned shall be carried out in accordance with the Acts, Rules, Laws and Regulations in force in India.

3.2 In addition to meeting the specific requirements called for in the respective sections of the Technical Specification, the equipment shall also conform to the general requirement of the relevant standards which shall form an integral part of the specification. When the specific requirements stipulated in the specifications exceed or differ than those required by the applicable standards, the stipulation of the specification shall take precedence.

3.3 In the event of the Bidder offering equipment conforming to standards other than ISS/IES standards, which ensure equivalent or better performance than that specified in the standards, the salient point of comparison between the standards adopted and relevant ISS/ IEC standards shall be indicated clearly in the proposal, along with English language version of such standard or relevant extract of the same. The equipment conforming to standards other than IS/IEC shall be subject to Purchaser's approval.

3.4 The standards mentioned in the respective equipment specifications are not mutually exclusive or complete in themselves. The equipment &/or work shall also conform to any other applicable standard, even if not specifically mentioned in these specifications.

3.5 Should the Bidder wish to depart from the provisions of the specifications, either on accounts of manufacturing practices or for any other reason, he shall clearly mention the departure and submit complete justification supported by information, drawings etc. as will enable to assess the suitability of equipment(s) offered. In the event of the Bidder's specifications, drawings, forms and tables etc. being found to disagree with the requirement of the Bid specifications at any stage, Bid specifications shall be binding, unless the departures have been duly approved in writing by the Purchaser.

3.6 REFERENCE OF STANDARDS

Reference	Abbreviation	Name and Address
IEC/ CISPR	International Electro technical Commission	Bureau Central de la Commission, Electro Technique International, 1 Rue de verembe Geneva, Switzerland
IS	Indian Standards,	Bureau of Indian Standard, Manak Bhavan, 9, Bahadur Shah Zafar Marg, New Delhi-110 002, INDIA

BS	British Standards,	British Standards Institution, 101, Pentonville Road, N-19-ND UK
ISO	International Organization For Standardization,	Danish Board of Standardization Danish Standardising Sraat, Aurehoevej-12, DK-2900, Heelstrup, DENMARK
NEMA	National Electric Manufacture Associate	115, East 44th Street, New York NY 10017 U.S.A

4.0 PROJECT DATA

- i. Location UTTAR PRADESH
- ii. Altitude not exceeding 1000 Meters
- iii. Climatic Conditions
 - (a) Design maximum ambient Air Temperature 50⁰ C
 - (b) Minimum ambient air temperature in shade 0⁰ C
 - (c) Relative Humidity 100%Max.
 - (d) Wind Load 195 Kg./ Sq.m.
 - (e) Seismic Level 0.3 g
 - (f) Isoceraunic Level 50days/ year
 - (g) Average annual rain fall 1200 mm
 - (h) Hot and humid tropical Climate conducive to rust and fungus growth

5.0 SYSTEM PARTICULARS

- (i) Rated System voltage 420 kV, 245kV, 145kV, 36kV
- (ii) System frequency 50 Hz, This may vary by ± 5%
- (iii) Number of phases Three
- (iv) Neutral Effectively Earthed
- (v) **Auxiliary power supply:-**

Auxiliary electrical equipment shall be suitable for operation on the following supply system:

- (a) Power device (Like drive motors) 400V, 3Phase, 4Wire 50Hz
Effectively earthed AC system.
 - (b) Lighting fixtures, space heaters, fractional Horse Power motors and control devices. 250V, 2wire, 50Hz,
AC supply with one
point grounded.
 - (c) DC alarm, Control and Protective Devices from sub station batteries as under 2wire ungrounded DC supplies
- (i) 400 kV S/S : 220V DC (ii)
 - 220/132kV S/S : 110V DC (iii)
 - Communication : 48 V DC equipment

The above supply voltage is subject to variation as follows:

All devices must be suitable for a continuous operation over the entire range of voltage variations :

- (i) AC
 - Voltage may vary by $\pm 10\%$.
 - Frequency by $\pm 5\%$
 - Combined Voltage & frequency by $\pm 10\%$.
- (ii) DC
 - a) 220 V may vary between 187 & 242 V
 - b) 110 V may vary between 93 & 121 V
 - c) 48 V may vary between 41 & 53 V

6.0 SYSTEM PARAMETERS

The following system parameters shall prevail:

Sl. No.	Description of Parameters	400 kV System	220 kV System	132 kV System	33 kV System
1.	Nominal system voltage	4000kV	220kV	132kV	33kV
2.	Maximum operating voltage of the system(rms)	420kV	245kV	145kV	36kV
3.	Rated frequency	50Hz	50Hz	50Hz	50Hz
4.	No. of phase	3	3	3	3
5.	Rated short time current	50 kA for 3 Sec.	40 kA for 3 sec	31.5 kA for 3 sec	25 kA for 3 sec
6.	Dry and wet one minute power frequency withstand voltage	680 kV	460 kV	275 kV	95 kV
7.	Dry and wet impulse withstand voltage positive and negative	1550 kVp	1050 kVp	650 kVp	250 kVp
8.	Corona extinction voltage	320 kV	156 kV	105 kV	-
9.	Max. Radio interference voltage for frequency between 0.5 MHz and 2 MHz at 508 kV rms for 765kV, 320kV rms for 400kV system and 156kV rms for 220kV system & 92kV rms for 132kV system	1000 microvolt	1000 microvolt	500 microvolt	-
10.	Minimum total creepage	25mm/ kV (10500 mm)	25mm/ kV (6125 mm)	25mm /kV (3625 mm)	25mm/kV (1300 mm)
11.	Min. clearances				
	i. Phase to phase	4000mm (for Conductor- conductor) 4200mm (for rod - Conductor)	2100 mm	1300 mm	320 mm
	ii. Phase to earth	3500 mm	2100 mm	1300 mm	320 mm

12.	iii) Sectional clearances	6500 mm	5000 mm	4000 mm	3000 mm
	System neutral earthing	Effectively Earthed	Effectively Earthed	Effectively Earthed	Effectively Earthed

Major technical parameters of bushings/ hollow column/ support insulators are given below:

Sl. No	Parameters	400 kV System	220 kV System	132 kV System	33 kV System
(a)	Max. System voltage Um (kV)	420	245	145	36
(b)	Impulse withstand voltage (dry & wet) (kVp)	± 1425	± 1050	± 650	±170
(c)	Switching surge withstand voltage (dry & wet) (kVp)	1050	-	-	-
(d)	Power frequency withstand voltage (dry and wet) (kV rms)	650	460	275	75
(e)	Total creepage distance(min) (mm)	10500	6125	3625	900

Insulator shall also meet requirement of IEC- 815 for 420kV, 245kV, 145kV and 36kV systems, as applicable having alternate long and short sheds.

7.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT

All equipments shall perform satisfactorily under various electrical, electromechanical and meteorological conditions of the installation site.

All equipment shall be able to withstand all external and internal mechanical thermal and electromechanical forces due to various factors like wind load temperature variation, ice & snow (wherever applicable) short circuit etc for the equipment.

The Bidder shall design the various forces which the terminal connectors of the equipment are required to withstand.

All outdoor EHV equipments except marshalling kiosks shall be suitable for hot line washing.

To facilitate erection of equipment, all items to be assembled at site shall be "match marked".

8.0 CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS

8.1 Each equipment shall be supplied with necessary terminals and connectors as required by the design for the particular installation. The terminal connector shall be suitable for the conductor used for particular installation, which are as under as per UPPTCL's practice:

8.2 Where copper to aluminum connections are required, bimetallic clamps shall be used, which shall be properly designed to ensure that any deterioration of the connection is kept to a minimum and restricted to part which are not current carrying or subjected to stress. The design details of the joint shall be furnished to the Purchaser by the Bidder.

- 8.3** Low voltage connectors, grounding connectors and accessories for grounding all equipment are also included in the scope of work.
- 8.4** No current carrying part of any clamp shall be less than 10 mm thick. All ferrous parts shall be hot dip galvanized. Copper alloy liner of minimum 2 mm thickness shall be used with aluminum body for Bimetallic clamps.
- 8.5** All casting shall be free from blow holes, surface blisters cracks and cavities. Sharp edges and corners shall be blurred and rounded off.
- 8.6** Flexible connectors, braids or laminated straps made for the terminal clamps for bus posts shall be suitable for both expansion or through (fixed/sliding) type connection of 4" IPS AL. tube as required. In both the cases the clamp height (top of the mounting pad to centre line of the tube) should be same.
- 8.7** The clamps/ connectors shall be designed to carry the same current as the conductor and the temperature rise shall be equal or less than that of the conductor at the specified ambient temperature. The rated current for which the clamp/ connector is designed with respect to specified reference ambient temperature, shall also be indelibly marked on each component of the clamp/connector, except on hardware.
- 8.8** All current carrying parts shall be designed and manufactured to have minimum contact resistant.
- 8.9** Clamps and connectors shall be designed to be corona controlled. Corona extinction voltage for 420kV, 220kV and 132kV class clamps shall not be less than 320, 156 and 105kV (rms) respectively and R.I.V. level shall not be more than specified 1000, 1000 and 500 micro volts for 420kV, 220kV and 132kV system at the test voltage specified.

9.0 SUPPORT STRUCTURES

- 9.1** The base design of all the equipments, to be installed on auxiliary structures, shall conform to the standard auxiliary structure designs presently being used in UPPTCL at 400/220/132/33kV Substations.
- 9.2** All equipment support structures shall be supplied alongwith brackets, angles, stools etc. for attaching the operating mechanism, control cabinets and marshalling box (wherever applicable) etc.
- 9.3** The support structures should be hot dip galvanised with minimum 610 gram/sq.m net of zinc.

10.0 COLOUR SCHEME AND CODES FOR PIPE SERVICE

The Bidder shall propose a colour scheme for the those equipments/ items for which the colour scheme has not been specified in the specification. For the approval of purchaser. The decision of Purchaser shall be final. The scheme shall include.

Finishing colour of Indoor equipment.

Finishing colour of Outdoor equipment.

Finish colour of all cubicles.

Finishing colour of various auxiliary system equipment including piping

Finishing colour of various building items.

All steel structures, plates etc. shall be painted with non-corrosive paint with a suitable primer. It may be noted that normally all electrical equipments in switchyard are painted with shade 631 of IS-5. The indoor cubicles, GIS enclosures and other miscellaneous items, the colour scheme shall be approved by the Purchaser during detailed engineering.

11.0 MATERIAL/ WORKMANSHIP

11.1 General Requirement

Where the specification does not contain references to workmanship, equipment, materials and components of the covered equipment, it is understood that the same must be new, of highest grade of the best quality of their kind, conforming to best engineering practice and suitable for the purpose for which they are intended.

The design of the works shall be such that installation, future expansions, replacements and general maintenance may be undertaken with a minimum of time and expenses. Each component shall be designed to be consistent with its duty and suitable factors of safety, subject to mutual agreements. All joints and fastenings shall be devised, constructed and documented so that the component parts shall be accurately positioned and restrained to fulfill their required function. In general screw threads shall be standard metric threads. The use of other thread forms will only be permitted when prior approval has been obtained from the Purchaser.

Whenever possible, all similar part of the Works shall be made to gauge and shall also be made interchangeable with similar parts. All spare parts shall also be interchangeable and shall be made of the same materials and workmanship as the corresponding parts of the Equipment supplied under the Specification. Where feasible, common component units shall be employed in different pieces of equipment in order to minimize spare parts stocking requirements. All equipment of the same type and rating shall be physically and electrically interchangeable.

All materials and equipment shall be installed in strict accordance with the manufacturer's recommendation(s). Only first-class work in accordance with the best modern practices will be accepted. Installation shall be considered as being the erection of equipment at its permanent location. This, unless otherwise specified, shall include unpacking, cleaning and lifting into position, grouting, leveling, aligning, coupling of or bolting down to previously installed equipment bases/foundations, performing the alignment check and final adjustment prior to initial operation, testing and commissioning in accordance with the manufacturer's tolerances, instructions and the Specification. All factory assembled rotating machinery shall be checked for alignment and adjustments made as necessary to re-establish the manufacturer's limits. Suitable guards shall be provided for the protection of personnel on all exposed rotating and/or moving machine parts and shall be designed for easy installation and removal for maintenance purposes. The spare equipment(s) shall be installed at designated locations and tested for healthiness.

The Bidder shall apply oil and grease of the proper specification to suit the machinery, as is

necessary for the installation of the equipment. Lubricants used for installation purposes shall be drained out and the system flushed through where necessary for applying the lubricant required for operation. The Bidder shall apply all operational lubricants to the equipment installed by him.

All oil, grease and other consumables used in the Works/ Equipment shall be purchased in India unless the Bidder has any special requirement for the specific application of a type of oil or grease not available in India. In such is the case he shall declare in the proposal, where such oil or grease is available. He shall help Purchaser in establishing equivalent Indian make and Indian Contractor. The same shall be applicable to other consumables too.

A cast iron or welded steel base plate shall be provided for all rotating equipment which are to be installed on a concrete base unless otherwise agreed to by the Purchaser. Each base plate shall support the unit and its drive assembly, shall be of design with pads for anchoring the units and shall have a raised up all around and shall have threaded in air connections, of so required.

11.2 PROVISIONS FOR EXPOSURE TO HOT AND HUMID CLIMATE

Outdoor equipment supplied under the specification shall be suitable for service and storage under tropical conditions of high temperature, high humidity, heavy rainfall and environment favourable to the growth of fungi and mildew. The indoor equipments located in non-air conditioned areas shall also be of same type.

12.0 SPACE HEATERS

The heaters shall be suitable for continuous operation at 240V AC supply. On-off switch and fuse shall be provided for the heater.

One or more adequately rated thermostatically connected heaters shall be supplied to prevent condensation in any compartment. The heaters shall be installed in the lower portion of the compartment and electrical connections shall be made sufficiently away from below the heaters to minimize deterioration of supply wire insulation. The heaters shall be suitable to maintain the compartment temperature to prevent condensation.

The heaters shall be suitably designed to prevent any contact between the heater wire and the air and shall consist of coiled resistance wire centered in a metal sheath and completely encased in a highly compacted powder of magnesium oxide or other material having equal heat conduction and electrical insulation properties, or they shall consist of resistance wire wound on a ceramic and completely covered with a ceramic material to prevent any contact between the wire and the air. Alternatively, they shall consist of a resistance wire mounted into a tubular ceramic body built into an envelope of stainless steel or the resistance wire is wound on a tubular ceramic body and embedded in glaze. The surface temperature of the heaters shall be restricted to a value which will not shorten the life of the heater sheaths or that of insulator wire or other component in the compartments.

13.0 FUNGI STATIC VARNISH

Besides the space heaters, special moisture and fungus resistant varnish shall be applied on parts which may be subjected or predisposed to the formation of fungi due to the presence or deposit of nutrient substances. The varnish shall not be applied to any surface of part where

the treatment will interface with the operation or performance of the equipment. Such surfaces or parts shall be protected against the application of the varnish.

14.0 VENTILATION OPENING

In order to ensure adequate ventilation, compartments shall have ventilation openings provided with fine wire mesh of brass to prevent the entry of insects and to reduce to a minimum the entry of dirt and dust. Outdoor compartment openings shall be provided with shutter type blinds and suitable provision shall be made so as to avoid any communication of air/ dust with any part in the enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc.

15.0 DEGREE OF PROTECTION

The enclosures of the Control Cabinets, junction boxes and Marshalling Boxes, panels etc. to be installed shall be provided with degree of protection as detailed here under:

- a) Installed out door : IP-55
- b) Installed indoor in air conditioned area : IP-31
- c) Installed in covered area : IP -52
- d) Installed indoor in non air-conditioned area where possibility of entry of water is limited: IP-41
- e) For LT Switchgear (AC & DC distribution Boards): IP-52

The degree of protection shall be in accordance with :13947 (Part-I)/ IEC-60947 (Part-I)/ IS 12063 / IEC-60529. Type test report for degree of protection test, on each type of the box shall be submitted for approval.

16.0 RATING PLATES, NAME PLATES AND LABELS

Each main and auxiliary item of substation is to have permanently attached to it in a conspicuous position a rating plate of non-corrosive material upon which is to be engraved manufacturer's name, year of manufacture, equipment name, type or serial number together with details of the loading conditions under which the item of substation in question has been designed to operate, and such diagram plates as may be required by the Purchaser. The rating plate of each equipment shall be according to IEC requirement.

All such nameplates, instructions plates, rating plates CB, CT, VT, SA, Isolators and Relay & Protection panels equipments shall be bilingual with Hindi inscription first followed by English. Alternatively two separate plates one with Hindi and the other with English inscriptions may be provided.

17.0 FIRST FILL OF CONSUMABLES, OIL AND LUBRICANTS

All the first fill of consumables such as oils, lubricants, filling compounds, touch up paints, soldering/brazing material for all copper piping of circuit breakers and essential chemicals etc. which will be required to put the equipment, covered under the scope of the specifications, into successful operation, shall be furnished by the Bidder unless specifically excluded under

the exclusions in these specifications and documents.

18.0 PACKAGING AND PROTECTION

All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at site till the time of erection. The Bidder shall also submit packing details/associated drawing for any equipment/material, to facilitate the Purchaser to repack any equipment/material at a later date. The Bidder shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Bidder.

All coated surfaces shall be protected against abrasion, impact, discolouration and any other damages. All exposed threaded portions shall be suitably protected with either a metallic or a non-metallic protectin device. All ends of all valves and pipings and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage. The parts which are likely to get rusted, due to exposure to weather should also be properly treated and protected in a suitable manner.

19.0 SURFACE FINISH

All interiors and exteriors of tanks, control cubicles and other metal parts shall be thoroughly cleaned to remove all rust, scales, corrosion, greases or other adhering foreign matter. All steel surfaces in contact with insulating oil as far as accessible shall be painted with not less than two coats of heat resistant, oil insoluble, insulating paints.

All metal surfaces exposed to atmosphere shall be given two primer coats of zinc chromate and two coats of epoxy paint with epoxy base thinner. All metal parts not accessible for painting shall be made of corrosion resisting material. All machine finished or bright surfaces shall be coated with a suitable preventive compound and suitably wrapped or otherwise protected. All paints shall be carefully selected to withstand tropical heat and extremes of weather within the limit specified. The paint shall not scale off or wrinkle or be removed by abrasion due to normal handling.

All external painting shall be as per shade No. 631 of IS: 5.

20.0 HOT DIP GALVANISING

All ferrous parts including all sizes of nuts, bolts, plain and spring washers, support channels, structures, shall be hot dip galvanized conforming to latest version of IS: 2629 or any other equivalent authoritative standard. However, hardware less than M12 size shall be electro-galvanized. Minimum weight of zinc coating shall be 610 gm/ sq.mm and minimum thickness of coating shall be 85 microns for all items thicker than 6 mm. For items lower than 6mm thickness, requirement of coating shall be as per relevant ASTM. For surface which shall be embedded in concrete, the zinc coating shall be 610 gm/sq. m minimum.

The galvanized surfaces shall have a continuous and uniform thick coating of zinc, firmly adhering to the surface of steel. The finished surface shall be clean and smooth and shall be free from defects like discoloured patches, bare spots, unevenness of coating, spelter which is loosely attached to the steel globules, spiky deposits, blistered surface, flaking or peeling off,

etc. The presence of any of these defects noticed on visual or microscopic inspection shall render the material liable to rejection.

After galvanizing, no drilling or welding shall be performed on the galvanized parts of the equipment excepting that nuts may be threaded after galvanizing. Sodium dichromate treatment shall be provided to avoid formation of white rust after hot dip galvanization.

Galvanised material must be transported properly to ensure that galvanised surfaces are not damaged during transit. Application of zinc rich paint at site shall not be allowed.

21.0 PROTECTIVE GUARDS

Suitable guards shall be provided for protection of personnel on all exposed rotation and/of moving machine parts. All such guards with necessary spares and accessories shall be designed for easy installation and removal for maintenance purpose.

22.0 TOOLS AND TACKLES

The Bidder shall supply with the equipment one complete set of all special tools and tackles for the erection, assembly, dis-assembly and maintenance of the equipment. However, these tools and tackles shall be separately packed and brought on to site.

23.0 CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES AND MARSHALLING BOXES FOR OUTDOOR EQUIPMENT

23.1 All types of boxes, cabinets etc. shall generally conform to and be tested in accordance with IS-5039/ IS-8623, IEC-60439, as applicable, and the clauses given below.

23.2 Control cabinets, junction boxes, marshalling boxes and terminal boxes shall be made of sheet steel or aluminum enclosure and shall be dust, water and vermin proof. Sheet steel used shall be at least 2.0 mm thick cold rolled or 2.5 mm hot rolled. The box shall be properly braced to prevent wobbling. There shall be sufficient reinforcement to provide level surfaces, resistance to vibrations and rigidity during transportation and installation. In case of aluminum enclosed box, the thickness of aluminum shall be such that it provides adequate rigidity and long life as comparable with sheet steel of specified thickness.

23.3 Cabinet/boxes shall be free standing floor mounting type, wall mounting type or pedestal mounting type as per requirements. A canopy and sealing arrangements for operating rods shall be provided in marshalling boxes/ Control cabinets to prevent ingress of rain water.

23.4 Cabinet/boxes shall be provided with double hinged doors with padlocking arrangements. The distance between two hinges shall be adequate to ensure uniform sealing pressure against atmosphere. The quality of the gasket shall be such that it does not get damaged/cracked during the operation of the equipment.

23.5 All doors, removable covers and plates shall be provided gasket all around with suitably profiled EPDM/Neoprene gaskets. The gasket shall be tested in accordance with approved quality plan, IS:11149 and IS:3400. The quality of gasket shall be such that it does not get damaged/cracked during 10(ten) years of operation of the equipment or its major overhaul whichever is earlier. All gasketed surfaces shall be smooth straight and reinforced if necessary to minimize distortion

and to make a tight seal. Ventilating Louvers, if provided, shall have screen and filters, the screen shall be fine wire mesh made of brass.

23.6 All boxes/ cabinets shall be designed for the entry of cables from bottom by means of weather proof and dust-proof connections. Boxes and cabinets shall be designed with generous clearances to avoid interference between the wiring entering from below and any terminal blocks or accessories mounted within the box or cabinet. Suitable cable gland plate projecting at least 150 mm above the base of the marshalling kiosk/box shall be provided for this purpose along with the proper blanking plates. Necessary number of cable glands shall be supplied and fitted on this gland plate. Gland plate shall have provision for some future glands to be provided later, if required.

23.7 A 240V, single phase, 50 Hz, 15 amp AC plug and socket shall be provided in the cabinet with ON-OFF switch for connection of hand lamps. Plug and socket shall be of industrial grade.

23.8 For illumination, a 20 Watts fluorescent tube or 15 watts CFL/LED bulb shall be provided. The switching of the fittings shall be controlled by the door switch.

For junction boxes of smaller sizes such as lighting junction box, manual operated earth switch mechanism box etc., plug socket, heater and illumination is not required to be provided.

23.9 All control switches shall be of rotary type. Toggle piano switches shall not be accepted.

23.10 Positive earthing of the cabinet shall be ensured by providing two separate earthing pads. The earth wire/ strip shall be terminated on to the earthing pad and secured by the use of self etching washer. Earthing of hinged door shall be done by using a separate earth wire.

23.11 The bay marshalling kiosks shall be provided with danger plate and a diagram showing the numbering/connection/feruling by pasting the same on the inside of the door.

23.12 a) The following routine tests alongwith the routine tests as per IS: 5039 shall also be conducted.

Check for wiring
Visual and dimension check

b) The enclosure of bay marshalling kiosk, junction box, terminal box shall be type tested for IP-55 as per IS: 13947. After IP-55 test, 2.5 kVrms for 1 (one) minute, insulation resistance and functional test should be conducted.

23.13 Auxiliary Switches

All the auxiliary switches shall be fully type tested as per relevant IS.

The following type test reports on auxiliary switches shall be submitted:

(a) Electrical endurance test - A minimum of 2000 operation for 2A D. C. with a time constant greater than or equal to 20 millisecond with a subsequent examination of mV drop/visual defects/temperature rise test.

- (b) Mechanical endurance test. A minimum of 1,00,000 operations with a subsequent checking of contact pressure test/visual examination.
- (c) Heat run test on contacts.
- (d) IR/HV test etc.

24.0 TERMINAL BLOCKS AND WIRING

24.1 Control and instrument leads from the switchboards or from other equipment will be brought to terminal boxes or control cabinets in conduits. All interphase and external connections to equipment or to control cubicles will be made through terminal blocks.

24.2 Terminal blocks shall be 1100 V grade and have continuous rating to carry the maximum expected current on the terminals. These shall be of moulded piece, complete with insulated/barriers stud type terminals, washers, nuts and lock nuts. Screw clamp, overall insulated, insertion type, rail mounted terminals can be used in place of stud type terminals. But preferably the terminal blocks shall be non-disconnecting stud type of Elmex type CATM4, phoenix cage clamp type or equivalent. The insulating material of terminal block shall be nylon 6.6 which shall be free of halogens, fluorocarbons etc.

24.3 Terminal blocks for current transformer and voltage transformer secondary leads shall be provided with test links and isolating facilities. The current transformer secondary leads shall also be provided with short circuiting and earthing facilities.

24.4 The terminals shall be such that maximum contact area is achieved when a cable is terminated. The terminal shall have a locking characteristic to prevent cable from escaping from the terminal clamp unless it is done intentionally.

24.5 The conducting part in contact with cable shall preferably be tinned or silver plated, however Nickel plated copper or zinc plated steel shall also be acceptable.

24.6 The terminal blocks shall be of extensible design.

24.7 The terminal blocks shall have locking arrangement to prevent its escape from the mounting rails.

24.8 The terminal blocks shall be fully enclosed with removable covers of transparent, non-deterioration type plastic material. Insulating barriers shall be provided between the terminal blocks. These barriers shall not hinder the operator from carrying out the wiring without removing the barriers.

24.9 Unless otherwise specified terminal blocks shall be suitable for connecting the following conductors on each side.

- a) All circuits except CT circuits Minimum of 2 nos. of 2.5 sq. mm copper flexible
- b) All CT circuits Minimum of 4 nos. of 2.5 sq.mm copper flexible

24.10 The arrangements shall be in such a manner so that it is possible to safely connect or disconnect terminals on live circuits and replace fuse links when the cabinet is live.

24.11 At least 20% spare terminals shall be provided on each panel/cubicle/box and these spare terminals shall be uniformly distributed on all terminal rows.

24.12 There shall be minimum clearance of 250 mm between the first bottom row of terminal block and the associated cable gland plate. Also the clearance between two rows of terminal blocks shall be a minimum of 150 mm.

24.13 The Bidder shall furnish all wire, conduits and terminals for the necessary interphase electrical connections (where applicable) as well as between phases and common terminal boxes or control cabinets.

24.14 All input and output terminals of each control cubicle shall be tested for surge withstand capability in accordance with the relevant IEC Publications, in both longitudinal and transverse modes. The Bidder shall also provide necessary filtering, surge protection, interface relays and any other measures necessary to achieve an impulse withstand level at the cable interfaces of the equipment.

25.0 LAMPS AND SOCKETS

25.1 Lamps

All incandescent lamps shall use a socket base as per IS-1258, except in the case of signal lamps.

25.2 Sockets

All sockets (convenience outlets) shall be suitable to accept both 5 Amp & 15 Amp pin round Standard Indian plugs. They shall be switched sockets with shutters.

25.3 Hand Lamp

A 240 Volts, single Phase, 50 Hz AC plug point shall be provided in the interior of each cubicle with ON- OFF Switch for connection of hand lamps.

25.4 Switches and Fuses

Each panel shall be provided with necessary arrangements for receiving, distributing, isolating and fusing of DC and AC supplies for various control, signalling, lighting and space heater circuits. The incoming and sub-circuits shall be separately provided with miniature circuit breaker/ switchfuse units. Selection of the main and Sub-circuit fuse ratings shall be such as to ensure selective clearance of sub-circuit faults. Potential circuits for relaying and metering shall be protected by HRC fuses.

All fuses shall be of HRC cartridge type conforming to IS-9228 mounted on plug-in type fuse bases. Miniature circuit breakers with thermal protection and alarm contacts will also be accepted. All accessible live connection to fuse bases shall be adequately shrouded. Fuses shall have operation indicators for indicating blown fuse condition. Fuse carrier base shall have imprints to the fuse rating and voltage. All control switches shall be of rotary type. Toggle piano switches shall not be accepted.

26.0 BUSHINGS, HOLLOW COLUMN INSULATORS, SUPPORT INSULATORS

26.1 Bushings shall be manufactured and tested in accordance with IS: 2099 & IEC-60137 while hollow column insulators shall be manufactured and tested in accordance with IEC-62155/IS:5621. The support insulators shall be manufactured and tested as per IS:2544/IEC-60168 and IEC-60273. The insulators shall also conform to IEC-60815 as applicable.

The bidder may also offer composite silicon rubber insulator, conforming to IEC-61462.

26.2 Support insulators, bushings and hollow column insulators shall be manufactured from high quality porcelain. Porcelain used shall be homogeneous, free from laminations, cavities and other flaws or imperfections that might affect the mechanical or dielectric quality and shall be thoroughly vitrified tough and impervious to moisture.

26.3 Glazing of the porcelain shall be uniform brown in colour, free from blisters, burrs and similar other defects.

26.4 Support insulators/bushings/hollow column insulators shall be designed to have ample insulation, mechanical strength and rigidity for the conditions under which they will be used.

26.5 When operating at normal rated voltage there shall be no electric discharge between the conductors and bushing which would cause corrosion or injury to conductors, insulators or supports by the formation of substances produced by chemical action. No radio interference shall be caused by the insulators/bushings when operating at the normal rated voltage.

26.6 Bushing porcelain shall be robust and capable of withstanding the internal pressures likely to occur in service. The design and location of clamps and the shape and the strength of the porcelain flange securing the bushing to the tank shall be such that there is no risk of fracture. All portions of the assembled porcelain enclosures and supports other than gaskets, which may in any way be exposed to the atmosphere shall be composed of completely non hygroscopic material such as metal or glazed porcelain.

26.7 All iron parts shall be hot dip galvanised and all joints shall be air tight. Surface of joints shall be trued up porcelain parts by grinding and metal parts by machining. Insulator/bushing design shall be such as to ensure a uniform compressive pressure on the joints.

26.8 Tests

In bushing, hollow column insulators and support insulators shall conform to type tests and shall be subjected to routine tests in accordance with IS: 2099 & IS: 2544 & IS : 5621.

27.0 MOTORS

Motors shall be "Squirrel Cage" three phase induction motors of sufficient size capable of satisfactory operation for the application and duty as required for the driven equipment and shall be subjected to routine tests as per applicable standards. The motors shall be of approved make.

27.1 Enclosures

- a) Motors to be installed outdoor without enclosure shall have hose proof enclosure equivalent to IP-55 as per IS: 4691. For motors to be installed indoor i.e. inside a box, the motor enclosure, shall be dust proof equivalent to IP-44 as per IS: 4691.
- b) Two independent earthing points shall be provided on opposite sides of the motor for bolted connection of earthing conductor.
- c) Motors shall have drain plugs so located that they will drain water resulting from condensation or other causes from all pockets in the motor casing.
- d) Motors weighing more than 25 Kg. shall be provided with eyebolts, lugs or other means to facilitate lifting.

27.2 Operational Features

- a) Continuous motor rating (name plate rating) shall be at least ten (10) percent above the maximum load demand of the driven equipment at design duty point and the motor shall not be over loaded at any operating point of driven equipment that will rise in service.
- b) Motor shall be capable at giving rated output without reduction in the expected life span when operated continuously in the system.

27.3 Starting Requirements

- a) All induction motors shall be suitable for full voltage direct-on-line starting. These shall be capable of starting and accelerating to the rated speed alongwith the driven equipment without exceeding the acceptable winding temperature even when the supply voltage drops down to 80% of the rated voltage.
- b) Motors shall be capable of withstanding the electrodynamic stresses and heating imposed if it is started at a voltage of 110% of the rated value.
- c) The locked rotor current shall not exceed six (6) times the rated full load current for all motors, subject to tolerance as given in IS:325.
- d) Motors when started with the driven equipment imposing full starting torque under the supply voltage conditions specified, shall be capable of withstanding atleast two successive starts from cold condition at room temperature and one start from hot condition without injurious heating of winding. The motors shall also be suitable for three equally spread starts per hour under the above referred supply condition.
- e) The locked rotor withstand time under hot condition at 110% of rated voltage shall be more than starting time with the driven equipment of minimum permissible voltage by at least two seconds or 15% of the accelerating time whichever is greater. In case it is not possible to meet the above requirement, the Bidder shall offer centrifugal type speed switch mounted on the motor shaft which shall remain closed for speed lower than 20% and open for speeds above 20% of the rated speed. The speed switch shall be capable of withstanding 120% of the rated speed in either direction of rotation.

27.4 Running Requirements

- a) The maximum permissible temperature rise over the ambient temperature of 50 degree C shall be within the limits specified in IS:325 (for 3 - phase induction motors) after adjustment due to increased ambient temperature specified.
- b) The double amplitude of motor vibration shall be within the limits specified in IS: 4729.

Vibration shall also be within the limits specified by the relevant standard for the driven equipment when measured at the motor bearings.

- c) All the induction motors shall be capable of running at 80% of rated voltage for a period of 5 minutes with rated load commencing from hot condition.

27.5 TESTING AND COMMISSIONING

The Bidder shall conduct following tests alongwith list of instruments and calibration certificates to the Purchaser. If any additional test is required the same shall be conducted without any extra cost to the Purchaser.

- (a) Insulation resistance.
- (b) Phase sequence and proper direction of rotation.
- (c) Any motor operating incorrectly shall be checked to determine the cause and the conditions corrected.

28.0 TECHNICAL REQUIREMENT OF EQUIPMENTS

28.1 Circuit Breakers (Applicable for 400kV, 220kV & 132 kV)

28.1.(i) The manufacturer(s) whose SF6 Circuit Breaker are offered should have designed, manufactured tested as per IEC/IS or equivalent standard supplied the same for the specified system voltage and **40kA/ 50kA fault level or above class** which are in satisfactory operation for at least 2 (two) years as on the date of bid opening

Or

28.1.(ii)(a) The manufacturer(s) whose SF6 Circuit Breaker are offered who have recently established production line in India for the specified system voltage or above class, based on technological support of a parent company or collaborator for the respective equipment(s) can also be considered provided the parent company (Principal) or collaborator meets qualifying requirements stipulated under clause no 28.1.(i) given above.

And

28.1.(ii)(b) Furnishes (jointly with parent company or collaborator) a legally enforceable undertaking to guarantee quality, timely supply, performance and warranty obligations as specified for the equipment(s)

And

28.1.(ii)(c) Furnishes a confirmation letter from the parent company or collaborator along with the bid stating that parent company or collaborator shall furnish performance guarantee for an amount of 10% of the cost of such equipment(s). This performance guarantee shall be in addition to contract performance guarantee to be submitted by the Bidder

28.2 Isolators (Applicable for 400kV, 220kV & 132kV)

28.2.(i) The manufacturer whose isolator are offered, should have designed, manufactured & tested as per IS/IEC or equivalent standard and supplied the isolator for the specified system voltage and and **40kA/ 50kA fault level or above class** and should be in satisfactory operation for at least 2 (two) years as on the date of bid opening

Or

28.2.(ii)(a) The manufacturer(s) whose Isolator are offered who have recently established production line in India for the specified system voltage or above class, based on technological support of a

parent company or collaborator for the respective equipment(s) can also be considered provided the parent company (Principal) or collaborator meets qualifying requirements stipulated under clause no 28.2.(i) given above.

And

- 28.2.(ii)(b) Furnishes (jointly with parent company or collaborator) a legally enforceable undertaking to guarantee quality, timely supply, performance and warranty obligations as specified for the equipment(s)

And

- 28.2.(ii)(c) Furnishes a confirmation letter from the parent company or collaborator along with the bid stating that parent company or collaborator shall furnish performance guarantee for an amount of 10% of the cost of such equipment(s). This performance guarantee shall be in addition to contract performance guarantee to be submitted by the Bidder

28.3 Instrument Transformers (Applicable for 400kV, 220kV & 132kV)

- 28.3.(i) The manufacturer whose instrument transformers are offered, should have designed, manufactured & tested as per IS/IEC or equivalent standard and supplied the same for the specified system voltage for CT & VT and 40kA/ 50kA fault level or above class. These equipment should be in satisfactory operation for at least 2 (two) years as on the date of bid opening

Or

- 28.3.(ii)(a) The manufacturer(s) whose Instrument Transformer are offered who have recently established production line in India for the specified system voltage or above class, based on technological support of a parent company or collaborator for the respective equipment(s) can also be considered provided the parent company (Principal) or collaborator meets qualifying requirements stipulated under clause no 28.3.(i) given above.

And

- 28.3.(ii)(b) Furnishes (jointly with parent company or collaborator) a legally enforceable undertaking to guarantee quality, timely supply, performance and warranty obligations as specified for the equipment(s)

And

- 28.3.(ii)(c) Furnishes a confirmation letter from the parent company or collaborator alongwith the bid stating that parent company or collaborator shall furnish performance guarantee for an amount of 10% of the cost of such equipment(s). This performance guarantee shall be in addition to contract performance guarantee to be submitted by the Bidder

28.4 Surge Arresters (Applicable for 400kV, 220kV & 132kV)

- (a) The manufacturer whose Surge Arresters are offered should have designed, manufactured and tested as per IEC/IS or equivalent standard and supplied the Surge Arrester for the specified energy capability with rated system voltage and which are in satisfactory operation for at least 2 (two) years as on the date of bid opening.

Or

- (b) The manufacturer(s) whose Surge Arrestors are offered who have recently established production line in India for the specified system voltage or above class, based on technological support of a parent company or collaborator for the respective equipment(s) can also be considered provided the parent company (Principal) or collaborator meets qualifying requirements stipulated under clause no (a) given above.

And

Furnishes (jointly with parent company or collaborator) a legally enforceable undertaking to

guarantee quality, timely supply, performance and warranty obligations as specified for the equipment(s)

And

Furnishes a confirmation letter from the parent company or collaborator alongwith the bid stating that parent company or collaborator shall furnish performance guarantee for an amount of 10% of the cost of such equipment(s). This performance guarantee shall be in addition to contract performance guarantee to be submitted by the Bidder.

28.5 220 kV Grade XLPE Power Cables

The cable shall be from the manufacturer who must have designed, manufactured, type tested and supplied in a single contract at least 15 (fifteen) km of single core, 220kV or higher grade XLPE insulated cable which must be in operation for at least 2 (two) years as on the date of bid opening.

28.6 132 kV Grade XLPE Power Cables

The cable shall be from the manufacturer who must have designed, manufactured, type tested and supplied in a single contract at least 15 (fifteen) km of single core, 132kV or higher grade XLPE insulated cable which must be in operation for at least 2 (two) years as on the date of bid opening.

28.7 33 kV Grade XLPE Power Cables

The cable shall be from the manufacturer who must have designed, manufactured, type tested and supplied in a single contract at least 15 (fifteen) km of single core, 33kV or higher grade XLPE insulated cable which must be in operation for at least 2 (two) years as on the date of bid opening.

28.8 1.1 kV Grade Power & Control Cables

28.8.1 Applicable for PVC Control Cable

The manufacturers, whose PVC control cables are offered, should have designed, manufactured, tested and supplied in a single contract at least 100 kms of 1.1 kV grade PVC insulated control cables as on the date of bid opening. Further the manufacturer should also have designed, manufactured, tested and supplied at least 1 km of 27C x 2.5 Sq.mm or higher size as on the date of bid opening.

28.8.2 Applicable for PVC Power Cable

The manufacturer, whose PVC Power Cables are offered, should have designed, manufactured, tested and supplied in a single contract atleast 100 kms of 1.1 kV or higher grade PVC insulated power cables as on the date of bid opening. Further the manufacturer should also have designed, manufactured, tested and supplied at least 1 km of 1C x 150 Sq. mm or higher size as on the date of bid opening.

28.8.3 Applicable for XLPE Power Cables

The Manufacturer, whose XLPE Power cables are offered, should have designed, manufactured,

tested and supplied in a single contract atleast 25 kms of 1.1 kV or higher grade XLPE insulated power cables as on the date of bid opening. Further the manufacturer should also have designed, manufactured, tested and supplied at least 1 km of 1C x 630 Sq. mm or higher size as on the date of bid opening.

28.9 LT Switchgear

28.9.1 The Manufacturer whose LT Switchgear are offered, should be a manufacturer of LT Switchboards of the type and rating being offered. He should have designe manufactured, tested and supplied at least 50 nos. draw out circuit breaker panels, out of which at least 5 nos. should have been with relay and protection schemes with current transformer. He should have also manufactured at least 50 nos. MCC panels comprising of MCCBs (ie Moulded Case Circuit Breakers) modules of the type offered which should be in successful operation as on date of bid opening.

28.9.2 The Switchgear items (such as circuit breakers, fuse switch units, contactors etc.), may be of his own make or shall be procured from reputed manufacturers and of proven design. At least one hundred circuit breakers of the make and type being offered shall be operating satisfactory as on date of bid opening.

28.10 Battery and Battery Charger

28.10.1 Requirements for Battery Manufacturers

The manufacturer whose Batteries are offered should have designed, manufactured and supplied DC Batteries of the type specified and being offered, having a capacity of at least 600 AH and these shall be operating satisfactorily for two years in power sector and/or industrial installations as on date of bid opening.

28.10.2 Requirements for Battery Charger Manufacturers

The manufacturer, whose Battery Chargers are offered, should have designed, manufactured and supplied Battery Chargers generally of the type offered, with static automatic voltage regulators and having a continuous output of at least ten (10) kW and these should be in successful as on the date of bid opening.

28.11 LT Transformers

The manufacturer, whose transformers are offered should have designed, manufactured, type tested including short circuit test as per IEC/IS or equivalent standards and supplied transformers of at least **33 kV class of 800 kVA** or higher. The transformer should have been in successful operation for at least 2 years as on the date of bid opening.

28.12 Fire Fighting System

The bidder or his sub-vendor should have designed, supplied, tested, erected and commissioned at least one number fire protection system of the each type described in (i), (ii), (iii) and (iv) below in installations such as power plants, substations, refineries, fertilizer plants or other industrial or commercial installations. Such systems must have been designed to the recommendations of Tariff Advisory Committee of India or any other international reputed

authority like (FOC, London or NFPA, USA etc.) executed during last ten (10) years and should have been in successful operation for at least 2 (two) years as on the date of bid opening.

- i) Nitrogen Injection Fire Prevention cum Extinguishing System
- ii) Portable Fire Extinguishers
- iii) GI Buckets – 9.0 liters capacity and Steel stand for Buckets
- iv) Fire Detection and Alarm System

In case bidder himself do not meet the requirement of design, he can engage a consultant(s) who must have designed the above system, which must be in successful operation for at least two years as on the date of bid opening.

28.13 Control and Relay Panels (400 kV, 220 kV, 132 kV & 33 kV)

The manufacturer whose Control, Relay & Protection System (Control & protection Intelligent Electronic Devices (IEDs)), and Sub-station Automation System (If applicable) are offered should have designed, manufactured, tested, installed and commissioned Control, Relay & Protection system along with Sub-station Automation System which must be in satisfactory operation on specified voltage level or above for atleast 2 (two) years on the date of bid opening.

AND

The Manufacturer or their joint venture or subsidiary company must have established repair, testing and integration (for at least 4 bays) facilities for Control, Relay & Protection System and Sub-station Automation System in India.

CORONA AND RADIO INTERFERENCE VOLTAGE (RIV) TEST

1.0 General

Unless otherwise stipulated, all equipment together with its associated connectors, where applicable, shall be tested for external corona (for 400 kV & above) both by observing the voltage level for the extinction of visible corona under falling power frequency voltage and by measurement of radio interference voltage (RIV) for 132 kV above.

2.0 Test Levels

The test voltage levels for measurement of external RIV and for corona extinction voltage are listed under the relevant clauses of the specification.

3.0 Test Methods for RIV

3.1 RIV tests shall be made according to measuring circuit as per International Special-Committee on Radio Interference (CISPR) Publication 16-1(1993) Part -1. The measuring circuit shall preferably be tuned to frequency with 10% of 0.5 MHz but other frequencies in the range of 0.5 MHz to 2 MHz may be used, the measuring frequency being recorded. The results shall be in microvolts.

3.2 Alternatively, RIV tests shall be in accordance with NEMA standard Publication No. 107-1964, except otherwise noted herein.

3.3 In measurement of, RIV, temporary additional external corona shielding may be provided. In measurements of RIV only standard fittings of identical type supplied with the equipment and a simulation of the connections as used in the actual installation will be permitted in the vicinity within 3.5 meters of terminals.

3.4 Ambient noise shall be measured before and after each series of tests to ensure that there is no variation in ambient noise level. If variation is present, the lowest ambient noise level will form basis for the measurements. RIV levels shall be measured at increasing and decreasing voltages of 85%, 100%, and 110% of the specified RIV test voltage for all equipment unless otherwise specified. The specified RIV test voltage for 400kV, 220kV, 132kV is listed in the detailed specification together with maximum permissible RIV level in microvolts.

3.5 The metering instruments shall be as per CISPR recommendation or equivalent device so long as it has been used by other testing authorities.

3.6 The RIV measurement may be made with a noise meter. A calibration procedure of the frequency to which noise meter shall be tuned shall establish the ratio of voltage at the high voltage terminal to voltage read by noise meter.

4.0 Test Methods for Visible Corona

The purpose of this test is to determine the corona extinction voltage of apparatus, connectors etc. The test shall be carried out in the same manner as RIV test described above with the exception that RIV measurements are not required during test and a search technique shall be used near the onset and extinction voltage, when the test voltage is raised

and lowered to determine their precise values. The test voltage shall be raised to 110% of specified corona extinction voltage and maintained there for five minutes. In case corona inception does not take place at 110%, test shall be stopped, otherwise test shall be continued and the voltage will then be decreased slowly until all visible corona disappears. The procedure shall be repeated at least 4 times with corona inception and extinction voltage recorded each time. The corona extinction voltage for purposes of determining compliance with the specification shall be the lowest of the four values at which visible corona (negative or positive polarity) disappears. Photographs with laboratory in complete darkness shall be taken under test conditions, at all voltage steps i.e. 85%, 100%, and 110%. Additional photographs shall be taken at corona inception and extinction voltages. At least two views shall be photographed in each case using Panchromatic film with an ASA daylight rating of 400 with an exposure of two minutes at a lens aperture of f/5.6 or equivalent. The photographic process shall be such that prints are available for inspection and comparison with conditions as determined from direct observation. Photographs shall be taken from above and below the level of connector so as to show corona on bushing, insulators and all parts of energised connectors. The photographs shall be framed such that test object essentially, fills the frame with no cut-off.

For recording purpose, modern devices utilizing UV recording methods such as image intensifier may also be used.

- 4.1 The test shall be recorded on each photograph. Additional photograph shall be taken from each camera position with lights on to show the relative position of test object to facilitate precise corona location from the photographic evidence.
- 4.2 In addition to photographs of the test object preferably four photographs shall be taken of the complete test assembly showing relative positions of all the test equipment and test objects. These four photographs shall be taken from four points equally spaced around the test arrangement to show its features from all sides. Drawings of the laboratory and test set up locations shall be provided to indicate camera positions and angles. The precise location of camera shall be approved by Purchaser's inspector, after determining the best camera locations by trial energisation of test object at a voltage which results in corona.
- 4.3 The test to determine the visible corona extinction voltage need not be carried out simultaneously with test to determine RIV levels.
- 4.4 However, both test shall be carried out with the same test set up and as little time duration between tests as possible. No modification on treatment of the sample between tests will be allowed. Simultaneous RIV and visible corona extinction voltage testing may be permitted at the discretion of Purchaser's inspector if, in his opinion, it will not prejudice other test.

5.0 Test Records

In addition to the information previously mentioned and the requirements specified as per CISPR or NEMA 107-1964 the following data shall be included in test report:

- a) Background noise before and after test.
- b) Detailed procedure of application of test voltage.
- c) Measurements of RIV levels expressed in micro volts at each level.

- d) Results and observations with regard to location and type of interference sources detected at each step.
- e) Test voltage shall be recorded when measured RIV passes through 100 microvolts in each direction.
- f) Onset and extinction of visual corona for each of the four tests required shall be recorded.

ANNEXURE – B

SEISMIC WITHSTAND TEST PROCEDURE

The seismic withstanding test on the complete equipment (for 132 kV and above) shall be carried out alongwith supporting structure.

The Bidder shall arrange to transport the structure from his Contractor's premises/UPPTCL sites for the purpose of seismic withstand test only.

The seismic level specified shall be applied at the base of the structure. The accelerometers shall be provided at the Terminal Pad of the equipment and any other point as agreed by the Purchaser. The seismic test shall be carried out in all possible combinations of the equipment. The seismic test procedure shall be furnished for approval of the Purchaser.

LIST OF SPECIFICATIONS

GENERAL STANDARDS AND CODES

India Electricity Rules

Indian Electricity Act

Indian Electricity (Supply) Act

Indian Factories Act

- IS-5, - Colors for Ready Mixed Paints and Enamels.
- IS-335, - New Insulating Oils.
- IS-617, - Aluminium and Aluminium Alloy Ingots and Castings for General Engineering Purposes
- IS-1448 (P1 to P 145) - Methods of Test for Petroleum and its Products.
- IS-2071 (P1 to P3) - Methods of High Voltage Testing.
- IS-12063 - Classification of degrees of protection provided by enclosures of electrical equipment.

- IS-2165
P1:1997
P2:1983 - Insulation Coordination.
- IS-3043 - Code of Practice for Earthing
- IS-6103 - Method of Test for Specific Resistance (Resistivity) of Electrical Insulating Liquids
- IS-6104 - Method of Test for Interfacial Tension of Oil against Water by the Ring Method
- IS-6262 - Method of test for Power factor & Dielectric Constant of Electrical Insulating Liquids.
- IS-6792 - Method for determination of electric strength of insulating oils.
- IS-5578 - Guide for marking of insulated conductors.
- IS-11353 - Guide for uniform system of marking & identification of conductors & apparatus terminals.
- IS-8263 - Methods for Radio Interference Test on High voltage Insulators.
- IS-9224 (Part 1,2&4) - Low Voltage Fuses
- IEC-60060 (Part 1 to P4) - High Voltage Test Techniques
- IEC 60068 - Environmental Test

IEC-60117	-	Graphical Symbols
IEC-60156,	-	Method for the Determination of the Electrical Strength of Insulation Oils.
IEC-60270,	-	Partial Discharge Measurements.
IEC-60376	-	Specification and Acceptance of New Sulphur Hexafluoride
IEC-60437	-	Radio Interference Test on High Voltage Insulators.
IEC-60507	-	Artificial Pollution Tests on High Voltage Insulators to be used on AC Systems.
IEC-62271-1	-	Common Specification for High Voltage Switchgear & Controlgear Standards.
IEC-60815	-	Guide for the Selection of Insulators in respect of Polluted Conditions.
IEC-60865 (P1 & P2)	-	Short Circuit Current - Calculation of effects.
ANSI-C.1/NFPA.70	-	National Electrical Code
ANSI-C37.90A	-	Guide for Surge Withstand Capability (SWC) Tests
ANSI-C63.21,	-	Specification for Electromagnetic Noise and
C63.3	-	Field Strength Instrumentation 10 KHz to 1 GHZ
C36.4ANSI-C68.1	-	Techniques for Dielectric Tests
ANSI-C76.1/IEEE21	-	Standard General Requirements and Test Procedure for Outdoor Apparatus Bushings.
ANSI-SI-4	-	Specification for Sound Level Meters
ANSI-Y32-2/C337.2	-	Drawing Symbols
ANSI-Z55.11	-	Gray Finishes for Industrial Apparatus and Equipment No. 61 Light Gray
NEMA-107T	-	Methods of Measurements of RIV of High Voltage Apparatus
NEMA-ICS-II	-	General Standards for Industrial Control and Systems Part ICSI-109
CISPR-1	-	Specification for CISPR Radio Interference Measuring Apparatus for the frequency range 0.15 MHz to 30 MHz
CSA-Z299.1-1978h	-	Quality Assurance Program Requirements
CSA-Z299.2-1979h	-	Quality Control Program Requirements
CSA-Z299.3-1979h	-	Quality Verification Program Requirements

CSA-Z299.4-1979h - Inspection Program Requirements

TRANSFORMERS AND REACTORS

- IS:10028 (Part 2 & 3) - Code of practice for selection, installation & maintenance of Transformers (P1:1993), (P2:1991), (P3:1991)
- IS-2026 (P1 to P4) - Power Transformers
- IS-3347 (part 1 to Part 8) - Dimensions for Porcelain transformer Bushings for use in lightly polluted atmospheres.
- IS-3639 - Fittings and Accessories for Power Transformers
- IS-6600 - Guide for Loading of Oil immersed Transformers.
- IEC-60076 (Part 1 to 5) - Power Transformers
- IEC-60214 - On-Load Tap-Changers.
- IEC-60289 - Reactors.
- IEC- 60354 - Loading Guide for Oil - Immersed power transformers
- IEC-60076-10 - Determination of Transformer and Reactor Sound Levels
- ANSI-C571280 - General requirements for Distribution, Power and Regulating Transformers
- ANSI-C571290 - Test Code for Distribution, Power and Regulation Transformers
- ANSI-C5716 - Terminology & Test Code for Current Limiting Reactors
- ANSI-C5721 - Requirements, Terminology and Test Code for Shunt Reactors Rated Over 500 KVA
- ANSI-C5792 - Guide for Loading Oil-Immersed Power Transformers upto and including 100 MVA with 55 deg C or 65 deg C Winding Rise
- ANSI-CG,1EEE-4 - Standard Techniques for High Voltage Testing

CIRCUIT BREAKERS

- IEC-62271-100 - High-voltage switchgear and controlgear - Part 100: Alternating current circuit-breakers
- IEC-62271-101 - High-voltage switchgear and controlgear - Part 101:

Synthetic testing

- IEC-62155 - Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1000 V
- IEC-62271-110 - High-voltage switchgear and controlgear - Part 110: Inductive load switching
- IEC-62271-109 - High-voltage switchgear and controlgear - Part 110: Inductive load switching

CURRENT TRANSFORMERS, VOLTAGE TRANSFORMERS AND COUPLING

CAPACITOR VOLTAGE TRANSFORMERS

- IS-2705- (P1 to P4) - Current Transformers.
 - IS:3156- (P1 to P4) - Voltage Transformers.
 - IS-4379 - Identification of the Contents of Industrial Gas Cylinders
 - IEC-60044-1 - Current transformers.
 - IEC-60044-2 - Inductive Voltage Transformers.
 - IEC-60044-4 - Instrument Transformes : Measurement of Partial Discharges
 - IEC-60044-5 - Instrument transformers - Part 5: Capacitor voltage transformers
 - IEC-60358 - Coupling capacitors and capacitor dividers.
 - IEC-60481 - Coupling Devices for power Line Carrier Systems.
 - ANSI-C5713 - Requirements for Instrument transformers
 - ANSIC92.2 - Power Line Coupling voltage Transformers
 - ANSI-C93.1 - Requirements for Power Line Carrier Coupling Capacitors
- BUSHING**
- IS-2099 - Bushings for Alternating Voltages above 1000V
 - IEC-60137 - Insulated Bushings for Alternating Voltages above 1000V

SURGE ARRESTERS

- IS-3070 (PART2) - Lightning arresters for alternating current systems

	-	: Metal oxide lightning arrestors without gaps.
IEC-60099-4	-	Metal oxide surge arrestors without gaps
IEC-60099-5	-	Selection and application recommendation
ANSI-C62.1	-	IEE Standards for S A for AC Power Circuits
NEMA-LA 1	-	Surge Arresters

CUBICLES AND PANELS & OTHER RELATED EQUIPMENTS

IS-722, IS-1248, IS-3231, 3231 (P-3)	-	Electrical relays for power system protection
IS:5039	-	Distributed pillars for Voltages not Exceeding 1000 Volts.
IEC-60068.2.2	-	Basic environmental testing procedures Part 2: Test B: Dry heat
IEC-60529	-	Degree of Protection provided by enclosures.
IEC-60947-4-1	-	Low voltage switchgear and control gear.
IEC-61095	-	Electromechanical Contactors for household and similar purposes.
IEC-60439 (P1 & 2)	-	Low Voltage Switchgear and control gear assemblies
ANSI-C37.20	-	Switchgear Assemblies, including metal enclosed bus.
ANSI-C37.50	-	Test Procedures for Low Voltage Alternating Current Power Circuit Breakers
ANSI-C39	-	Electric Measuring instrument
ANSI-C83	-	Components for Electric Equipment
IS: 8623: (Part I to 3)	-	Specification for Switchgear & Control Assemblies.
NEMA-AB	-	Moulded Case Circuit and Systems
NEMA-CS	-	Industrial Controls and Systems
NEMA-PB-1	-	Panel Boards
NEMA-SG-5	-	Low voltage Power Circuit breakers
NEMA-SG-3	-	Power Switchgear Assemblies
NEMA-SG-6	-	Power switching Equipment
NEMA-5E-3	-	Motor Control Centers
1248 (P1 to P9)	-	Direct acting indicating analogue electrical

measuring instruments & their accessories.

Disconnecting Switches

- IEC-62271-102 - High-voltage switchgear and controlgear - Part 102: Alternating current disconnectors and earthing switches
- IEC-60129 - Alternating Current Disconnectors (Isolators) and Earthing switches
- IEC-1129 - Alternating Current Earthing Switches Induced Current switching
- IEC-60265 (Part 1 & 2) - High Voltage switches
- ANSI-C37.32 - Schedule of preferred Ratings, Manufacturing Specifications and Application Guide for high voltage Air Switches, Bus supports and switch accessories
- ANSI-C37.34 - Test Code for high voltage air switches
- NEMA-SG6 - Power switching equipment

PLCC and Line Traps

- IS-8792 - Line traps for AC power system.
- IS-8793 - Methods of tests for line traps.
- IS-8997 - Coupling devices for PLC systems.
- IS-8998 - Methods of test for coupling devices for PLC systems.
- IEC-60353 - Line traps for A.C. power systems.
- IEC-60481 - Coupling Devices for power line carrier systems.
- IEC-60495 - Single sideboard power line carrier terminals
- IEC-60683 - Planning of (single Side-Band) power line carrier systems.
- CIGRE - Teleprotection report by Committee 34 & 35.
- CIGRE - Guide on power line carrier 1979.
- CCIR - International Radio Consultative Committee
- CCITT - International Telegraph & Telephone Consultative Committee

EIA - Electric Industries Association

Protection and Control Equipment

- IEC-60051 : (P1 to P9) - Recommendations for Direct Acting indicating analogue electrical measuring instruments and their accessories.
- IEC-60255 (Part 1 to 23) - Electrical relays.
- IEC-60297 (P1 to P4) - Dimensions of mechanical structures of the 482.6mm (19 inches) series.
- IEC-60359 - Expression of the performance of electrical & electronic measuring equipment.
- IEC-60387 - Symbols for Alternating-Current Electricity meters.
- IEC-60447 - Man machine interface (MMI) - Actuating principles.
- IEC-60521 - Class 0.5, 1 and 2 alternating current watt hour metres
- IEC-60547 - Modular plug-in Unit and standard 19-inch rack mounting unit based on NIM Standard (for electronic nuclear instruments)
- ANSI-81 - Screw threads
- ANSI-B18 - Bolts and Nuts
- ANSI-C37.1 - Relays, Station Controls etc.
- ANSI-C37.2 - Manual and automatic station control, supervisory and associated telemetering equipment
- ANSI-C37.2 - Relays and relay systems associated with electric power apparatus
- ANSI-C39.1 - Requirements for electrical analog indicating Instruments

MOTORS

- IS-325 - Three phase induction motors.
- IS-4691 - Degree of protection provided by enclosure for rotating electrical machinery.
- IEC-60034 (P1 to P19:) - Rotating electrical machines

IEC-Document 2 - Three phase induction motors
(Central Office) NEMA-MGI Motors and Generators

Electronic Equipment and Components

MIL-21B, MIL-833 & MIL-2750

- IEC-60068 (P1 to P5) - Environmental testing
- IEC-60326 (P1 to P2) - Printed boards
Material and workmanship standards
- IS-1363 (P1 to P3) - Hexagon headbolts, screws and nuts of product grade C.
- IS-1364 (P1 to P5) - Hexagon head bolts, screws and nuts of products grades A and B.
- IS-3138 - Hexagonal Bolts and Nuts (M42 to M150)
- ISO-898 - Fasteners: Bolts, screws and studs
- ASTM - Specification and tests for materials

Clamps & Connectors

- IS-5561 - Electric power connectors.
- NEMA-CC1 - Electric Power connectors for sub station
- NEMA-CC 3 - Connectors for Use between aluminium or aluminum-Copper Overhead Conductors

Bus Hardware and Insulators

- IS: 2121 - Fittings for Aluminum and steel cored Al conductors for overhead power lines.
- IS-731 - Porcelain insulators for overhead power lines with a nominal voltage greater than 1000 V.
- IS-2486 (P1 to P4) - Insulator fittings for overhead power lines with a nominal voltage greater than 1000 V.
- IEC-60120 - Dimensions of Ball and Socket Couplings of string insulator units.
- IEC-60137 - Insulated bushings for alternating voltages above 1000 V.
- IEC-60168 - Tests on indoor and outdoor post insulators of ceramic material or glass for Systems with Nominal Voltages Greater than 1000 V.

- IEC-62155 - Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1 000 V
- IEC-60233 - Tests on Hollow Insulators for use in electrical equipment.
- IEC-60273 - Characteristics of indoor and outdoor post insulators for systems with nominal voltages greater than 1000V.
- IEC-61462 - Pressurized and un-pressurized insulator for use in electrical equipment with rated voltage greater than 1000V – Definitions, Test methods, acceptance criteria and design recommendations
- IEC-60305 - Insulators for overhead lines with nominal voltage above 1000V-ceramic or glass insulator units for a.c. systems Characteristics of String Insulator Units of the cap and pintype.
- IEC-60372 (1984) - Locking devices for ball and socket couplings of string insulator units : dimensions and tests.
- IEC-60383 (P1 and P2) - Insulators for overhead lines with a nominal voltage above 1000 V.
- IEC-60433 - Characteristics of string insulator units of the long rod type.
- IEC-60471 - Dimensions of Clevis and tongue couplings of string insulator units.
- ANSI-C29 - Wet process procelain insulators
- ANSI-C29.1 - Test methods for electrical power insulators
- ANSI-C92.2 - For insulators, wet-process porcelain and toughened glass suspension type
- ANSI-C29.8 - For wet-process porcelain insulators apparatus, post-type
- ANSI-G.8 - Iron and steel hardware
- CISPR-7B - Recommendations of the CISPR, tolerances of form and of Position, Part 1
- ASTM A-153 - Zinc Coating (Hot-Dip) on iron and steel hardware

Strain and Rigid Bus-Conductor

- IS-2678 - Dimensions & tolerances for Wrought Aluminum and Aluminum Alloys drawn round tube.

IS-5082	-	Wrought Aluminum and Aluminum Alloy Bars. Rods, Tubes and Sections for Electrical purposes.
ASTM-B 230-82	-	Aluminum 1350 H19 Wire for electrical purposes
ASTM-B 231-81	-	Concentric - lay - stranded, aluminum 1350 conductors
ASTM-B 221	-	Aluminum - Alloy extruded bar, rod, wire, shape
ASTM-B 236-83	-	Aluminum bars for electrical purpose (Bus-bars)
ASTM-B 317-83	-	Aluminum-Alloy extruded bar, rod, pipe and structural shapes for electrical purposes (Bus Conductors)

Batteries and Batteries Charger

Battery

IS:1651	-	Stationary Cells and Batteries, Lead-Acid Type (with Tubular Positive Plates)
IS:1652	-	Stationary Cells and Batteries, Lead-Acid Type (with Plante Positive Plates)
IS:1146	-	Rubber and Plastic Containers for Lead-Acid Storage Batteries
IS:6071	-	Synthetic Separators for Lead-Acid Batteries
IS:266	-	Specification for Sulphuric Acid
IS:1069	-	Specification for Water for Storage Batteries
IS:3116	-	Specification for Sealing Compound for Lead-Acid Batteries
IS:1248	-	Indicating Instruments
IS:10918	-	Vented type nickel Cadmium Batteries
IEC:60896-21&22	-	Lead Acid Batteries Valve Regulated types – Methods of Tests & Requirements
IEC: 60623	-	Vented type nickel Cadmium Batteries
IEC:60622	-	Secondary Cells & Batteries – Sealed Ni-Cd rechargeable single cell
IEC:60623	-	Secondary Cells & Batteries – Vented Ni-Cd rechargeable single cell
IEC:60896-11	-	Stationary Lead Acid Batteries – Vented Type – General requirements & method of tests
IEEE-485	-	Recommended practices for sizing of Lead Acid

Batteries

- IEEE-1115 - Sizing of Ni-Cd Batteries
- IEEE-1187 - Recommended practices for design & installation of VRLA Batteries
- IEEE-1188 - Recommended practices for design & installation of VRLA Batteries
- IEEE-1189 - Guide for selection of VRLA Batteries

Battery Charger

- IS:3895 - Mono-crystalline Semiconductor Rectifier Cells and Stacks
- IS:4540 - Mono-crystalline Semiconductor Rectifier Assemblies and Equipment.
- IS:6619 - Safety Code for Semiconductor Rectifier Equipment
- IS:2026 - Power Transformers
- IS:2959 - AC Contactors for Voltages not Exceeding 1000 Volts
- IS:1248 - Indicating Instruments
- IS:2208 - HRC Fuses
- IS:13947 (Part-3) - Air break switches, air break disconnectors & fuse combination units for voltage not exceeding 1000V AC or 1200V DC
- IS:2147 - Degree of protection provided by enclosures for low voltage switchgear and controlgear.
- IS:6005 - Code of practice for phosphating of Iron and Steel
- IS:3231 - Electrical relays for power system protection
- IS:3842 - Electrical relay for AC Systems
- IS:5 - Colours for ready mix paint
- IEEE-484 - Recommended Design for installation design and installation of large lead storage batteries for generating stations and substations.
- IEEE-485 - Sizing large lead storage batteries for generating stations and substations

Wires and Cables

ASTMD-2863	-	Measuring the minimum oxygen concentration to support candle like combustion of plastics (oxygen index)
IS-694	-	PVC insulated cables for working voltages upto and including 1100 Volts.
IS-1255	-	Code of practice for installation and maintenance of power cables, upto and including 33 kV rating
IS-1554 (P1 and P2)	-	PVC insulated (heavy duty) electric cables (part 1) for working voltage upto and including 1100 V.
	-	Part (2) for working voltage from 3.3 kV upto and including 11kV.
IS:1753	-	Aluminium conductor for insulated cables
IS:2982	-	Copper Conductor in insulated cables.
IS-3961 (P1 to P5)	-	Recommended current ratings for cables.
IS-3975	-	Mild steel wires, formed wires and tapes for armouring of cables.
IS-5831	-	PVC insulating and sheath of electric cables.
IS-6380	-	Elastometric insulating and sheath of electric cables.
IS-7098	-	Cross linked polyethylene insulated PVC sheathed cables for working voltage upto and including 1100 volts.
IS-7098	-	Cross-linked polyethyle insulated PVC sheathed cables for working voltage from 3.3kV upto and including 33 kV.
IS-8130	-	Conductors for insulated electrical cables and flexible cords.
IS-1753	-	Aluminum Conductors for insulated cables.
IS-10418	-	Specification for drums for electric cables.
IEC-60096 (part 0 to p4)	-	Radio Frequency cables.
IEC-60183	-	Guide to the Selection of High Voltage Cables.
IEC-60189 (P1 to P7)	-	Low frequency cables and wires with PVC insulation and PVC sheath.
IEC-60227 (P1 to P7)	-	Polyvinyl Chloride insulated cables of rated voltages up to and including 450/750V.
IEC-60228	-	Conductors of insulated cables
IEC-60230	-	Impulse tests on cables and their accessories.

IEC-60287 (P1 to P3)	-	Calculation of the continuous current rating of cables (100% load factor).
IEC-60304	-	Standard colours for insulation for low-frequency cables and wires.
IEC-60331	-	Fire resisting characteristics of Electric cables.
IEC-60332 (P1 to P3)	-	Tests on electric cables under fire conditions.
IEC-60502	-	Extruded solid dielectric insulated power cables for rated voltages from 1 kV upto to 30 kV
IEC-754 (P1 and P2)	-	Tests on gases evolved during combustion of electric cables.

Air Conditioning and Ventilation

IS-659	-	Safety code for air conditioning
IS-660	-	Safety code for Mechanical Refrigeration
ARI:520	-	Standard for Positive Displacement Refrigeration Compressor and Condensing Units
IS:4503	-	Shell and tube type heat exchanger
ASHRAE-24	-	Method of testing for rating of liquid coolers
ANSI-B-31.5	-	Refrigeration Piping
IS:2062	-	Steel for general structural purposes
IS:655	-	Specification for Metal Air Dust
IS:277	-	Specification for Galvanised Steel Sheets
IS-737	-	Specification for Wrought Aluminium and Aluminium Sheet & Strip
IS-1079	-	Hot rolled cast steel sheet & strip
IS-3588	-	Specification for Electrical Axial Flow Fans
IS-2312	-	Propeller Type AC Ventilation Fans
BS-848	-	Methods of Performance Test for Fans
BS-6540 Part-I	-	Air Filters used in Air Conditioning and General Ventilation
BS-3928	-	Sodium Flame Test for Air Filters (Other than for Air Supply to I.C. Engines and Compressors)
US-PED-2098	-	Method of cold DOP & hot DOP test
MIL-STD-282	-	DOP smoke penetration method
ASHRAE-52	-	Air cleaning device used in general ventilation for

		removing particle matter
IS:3069	-	Glossary of Terms, Symbols and Units Relating to Thermal Insulation Materials.
IS:4671	-	Expanded Polystyrene for Thermal Insulation Purposes
IS:8183	-	Bonded Mineral Wool
IS:3346	-	Evaluation of Thermal Conductivity properties by means of guarded hot plate method
ASTM-C-591-69	-	Standard specification for rigid preformed cellular urethane thermal insulation
IS:4894	-	Centrifugal Fans
BS:848 Fans	-	Method of Performance Test for Centrifugal Fans
IS:325	-	Induction motors, three-phase
IS:4722	-	Rotating electrical machines
IS:1231	-	Three phase foot mounted Induction motors, dimensions of
IS:2233	-	Designations of types of construction and mounting arrangements of rotating electrical machines
IS:2254	-	Vertical shaft motors for pumps, dimensions of
IS:7816	-	Guide for testing insulation resistance of rotating machines
IS:4029	-	Guide for testing three phase induction motors
IS:4729	-	Rotating electrical machines, vibration of, Measurement and evaluation of
IS:4691	-	Degree of protection provided by enclosures for rotating electrical machinery
IS:7572	-	Guide for testing single-phase a.c. motors
IS:2148	-	Flame proof enclosure for electrical apparatus
BS:4999 (Part-51)	-	Noise levels

Galvanizing

IS-209	-	Zinc Ingot
IS-2629	-	Recommended Practice for Hot-Dip galvanizing

on iron and steel.

- IS-2633 - Methods for testing uniformity of coating of zinc coated articles.
- ASTM-A-123 - Specification for zinc (Hot Galvanizing) Coatings, on products Fabricated from rolled, pressed and forged steel shapes, plates, bars and strips.
- ASTM-A-121-77 - Zinc-coated (Galvanized) steel barbed wire

Painting

- IS-6005 - Code of practice for phosphating of iron and steel.
- ANSI-Z551 - Gray finishes for industrial apparatus and equipment
- SSPEC - Steel structure painting council

Fire Protection System

Fire protection manual issued by tariff advisory committee (TAC) of India

HORIZONTAL CENTRIFUGAL PUMPS

- IS:1520 - Horizontal centrifugal pumps for clear, cold and fresh water
- IS:9137 - Code for acceptance test for centrifugal & axial pumps
- IS:5120 - Technical requirement - Rotodynamic special purpose pumps
- API-610 - Centrifugal pumps for general services
- Hydraulic Institutes Standards
- BS:599 - Methods of testing pumps
- PTC-8.2 - Power Test Codes - Centrifugal pumps

DIESEL ENGINES

- IS:10000 - Methods of tests for internal combustion engines
- IS:10002 - Specification for performance requirements for

		constant speed compression ignition engines for general purposes (above 20 kW)
BS:5514	-	The performance of reciprocating compression ignition (Diesel) engines, utilising liquid fuel only, for general purposes
ISO:3046	-	Reciprocating internal combustion engines performance
IS:554	-	Dimensions for pipe threads where pressure tight joints are required on threads
ASME Power Test Code	-	Internal combustion engine PTC-17
	-	Codes of Diesel Engine Manufacturer's Association, USA

PIPING VALVES & SPECIALITIES

IS:636	-	Non percolating flexible fire fighting delivery hose
IS:638	-	Sheet rubber jointing and rubber inserting jointing
IS:778	-	Gun metal gate, globe and check valves for general purpose
IS:780	-	Sluice valves for water works purposes (50 to 300 mm)
IS:901	-	Couplings, double male and double female instantaneous pattern for fire fighting
IS:902	-	Suction hose couplings for fire fighting purposes
IS:903	-	Fire hose delivery couplings branch pipe nozzles and nozzle spanner
IS:1538	-	Cast iron fittings for pressure pipes for water, gas and sewage
IS:1903	-	Ball valve (horizontal plunger type) including floats for water supply purposes
IS:2062	-	SP for weldable structural steel
IS:2379	-	Colour Code for the identification of pipelines
IS:2643	-	Dimensions of pipe threads for fastening purposes
IS:2685	-	Code of Practice for selection, installation and maintenance of sluice valves
IS:2906	-	Sluice valves for water-works purposes (350 to 1200 mm size)

IS:3582	-	Basket strainers for fire fighting purposes (cylindrical type)
IS:3589	-	Electrically welded steel pipes for water, gas and sewage (150 to 2000 mm nominal diameter)
IS:4038	-	Foot valves for water works purposes
IS:4927	-	Unlined flax canvas hose for fire fighting
IS:5290	-	Landing valves (internal hydrant)
IS:5312 (Part-I)	-	Swing check type reflex (non-return) valves
IS:5306	-	Code of practice for fire extinguishing installations and equipment on premises
Part-I	-	Hydrant systems, hose reels and foam inlets
Part-II	-	Sprinkler systems
BS:5150	-	Specification for cast iron gate valves

MOTORS & ANNUNCIATION PANELS

IS:325	-	Three phase induction motors
IS:900	-	Code of practice for installation and maintenance of induction motors
IS:996	-	Single phase small AC and universal electric motors
IS:1231	-	Dimensions of three phase foot mounted induction motors
IS:2148	-	Flame proof enclosure of electrical apparatus
IS:2223	-	Dimensions of flange mounted AC induction motors
IS:2253	-	Designations for types of construction and mounting arrangements of rotating electrical machines
IS:2254	-	Dimensions of vertical shaft motors for pumps
IS:3202	-	Code of practice for climate proofing of electrical equipment
IS:4029	-	Guide for testing three phase induction motors
IS:4691	-	Degree of protection provided by enclosure for rotating electrical machinery
IS:4722	-	Rotating electrical machines

IS:4729	-	Measurement and evaluation of vibration of rotating electrical machines
IS:5572	-	Classification of hazardous areas for electrical (Part-I) installations (Areas having gases and vapours)
IS:6362	-	Designation of methods of cooling for rotating electrical machines
IS:6381	-	Construction and testing of electrical apparatus with type of protection 'e'
IS:7816	-	Guide for testing insulation for rotating machine
IS:4064	-	Air break switches
IEC DOCUMENT 2 (Control Office) 432	-	Three Phase Induction Motor
VDE 0530 Part I/66	-	Three Phase Induction Motor
IS:9224 (Part-II)	-	HRC Fuses
IS:6875	-	Push Button and Control Switches
IS:694	-	PVC Insulated cables
IS:1248	-	Indicating instruments
IS:375	-	Auxiliary wiring & busbar markings
IS:2147	-	Degree of protection
IS:5	-	Colour Relay and timers
IS:2959	-	Contactors

PG Test Procedures

NFPA-13	-	Standard for the installation of sprinkler system
NFPA-15	-	Standard for water spray fixed system for the fire protection
NFPA-12A	-	Standard for Halong 1301 Fire Extinguishing System
NFPA-72E	-	Standard on Automatic Fire Detectors
Fire Protection Manual by TAC (Latest Edition)		
NFPA-12	-	Standard on Carbon dioxide extinguisher systems
IS:3034	-	Fire of industrial building:
Electrical generating and distributing stations code of practice		

- IS:2878 - CO2 (Carbon dioxide) Type Extinguisher
- IS:2171 - DC (Dry Chemical Powder) type
- IS:940 - Pressurised Water Type

D.G. SET

- IS:10002 - Specification for performance requirements for constant speed compression ignition (diesel engine) for general purposes
- IS:10000 - Method of tests for internal combustion engines
- IS:4722 - Rotating electrical machines-specification
- IS:12063 - Degree of protection provided by enclosures
- IS:12065 - Permissible limit of noise levels for rotating electrical machines.
- Indian Explosive Act 1932

Steel Structures

- IS-228 (1992) - Method of Chemical Analysis of pig iron, cast iron and plain carbon and low alloy steels.
- IS-802 (P1 to 3:) - Code of practice for use of structural steel in overhead transmission line towers.
- IS-806 - Code of practice for use of steel tubes in general building construction
- IS-808 - Dimensions for hot rolled steel beam, column channel and angle sections.
- IS-814 - Covered electrodes for manual arc welding of carbon of carbon manganese steel.
- IS-816 - Code of Practice for use of metal arc welding for general construction in Mild steel
- IS-817 - Code of practice for training and testing of metal arc welders. Part 1 : Manual Metal arc welding.
- IS-875 (P1 to P4) - Code of practice for design loads (other than earthquake) for buildings and structures.
- IS-1161 - Steel tubes for structural purposes.
- IS-1182 - Recommended practice for radiographic examination of fusion welded butt joints in steel

		plates.
IS-1363 (P1 to P3)	-	Hexagonal head bolts, screws & nuts of products grade C.
IS-1364	-	Hexagon headbolts, screws and nuts of product grades A and B.
IS-1367 (P1 to P18)	-	Technical supply condition for threaded steel fasteners.
IS-1599	-	Methods for bend test.
IS-1608	-	Method for tensile testing of steel products.
IS-1893	-	Criteria for earthquake resistant design of structures.
IS-1978	-	Line Pipe.
IS-2062	-	Steel for general structural purposes.
IS-2595	-	Code of practice for Radiographic testing.
IS-3063	-	Single coil rectangular section spring washers for bolts, nuts and screws.
IS-3664	-	Code of practice for ultrasonic pulse echo testing by contact and immersion methods.
IS-7205	-	Safety code for erection of structural steel work.
IS-9595	-	Recommendations for metal arc welding of carbon and carbon manganese steels.
ANSI-B18.2.1	-	Inch series square and Hexagonal bolts and screws
ANSI-B18.2.2	-	Square and hexagonal nuts
ANSI-G8.14	-	Round head bolts
ASTM-A6	-	Specification for General Requirements for rolled steel plates, shapes, sheet piling and bars of structural use
ASTM-A36	-	Specifications of structural steel
ASTM-A47	-	Specification for malleable iron castings
ASTM-A143	-	Practice for safeguarding against embilement of Hot Galvanized structural steel products and procedure for detaching embrilement
ASTM-A242	-	Specification for high strength low alloy structural steel
ASTM-A283	-	Specification for low and intermediate tensile strength carbon steel plates of structural quality
ASTM-A394	-	Specification for Galvanized steel transmission

		tower bolts and nuts
ASTM-441	-	Specification for High strength low alloy structural manganese vanadium steel.
ASTM-A572	-	Specification for High strength low alloy columbium-Vanadium steel of structural quality
AWS D1-0	-	Code for welding in building construction welding inspection
AWS D1-1	-	Structural welding code
AISC	-	American institute of steel construction
NEMA-CG1	-	Manufactured graphite electrodes

Piping and Pressure Vessels

IS-1239 (Part 1 and 2) steel	-	Mild steel tubes, tubulars and other wrought fittings
IS-3589	-	Seamless Electrically welded steel pipes for water, gas and sewage.
IS-6392	-	Steel pipe flanges
ASME	-	Boiler and pressure vessel code
ASTM-A120	-	Specification for pipe steel, black and hot dipped, zinc-coated (Galvanized) welded and seamless steel pipe for ordinary use
ASTM-A53	-	Specification for pipe, steel, black, and hotdipped, zinc coated welded and seamless
ASTM-A106	-	Seamless carbon steel pipe for high temperature service
ASTM-A284	-	Low and intermediate tensile strength carbonsilicon steel plates for machine parts and general construction.
ASTM-A234	-	Pipe fittings of wrought carbon steel and alloy steel for moderate and elevated temperatures
ASTM-S181	-	Specification for forgings, carbon steel for general purpose piping
ASTM-A105	-	Forgings, carbon steel for piping components
ASTM-A307	-	Carbon steel externally threaded standard fasteners
ASTM-A193	-	Alloy steel and stainless steel bolting materials for

		high temperature service
ASTM-A345	-	Flat rolled electrical steel for magnetic applications
ASTM-A197	-	Cupola malleable iron
ANSI-B2.1	-	Pipe threads (Except dry seal)
ANSI-B16.1	-	Cast iron pipe flanges and flanged fittings. Class 25, 125, 250 and 800
ANSI-B16.1	-	Malleable iron threaded fittings, class 150 and 300
ANSI-B16.5	-	Pipe flanges and flanged fittings, steel nickel alloy and other special alloys
ANSI-B16.9	-	Factory-made wrought steel butt welding fittings
ANSI-B16.11	-	Forged steel fittings, socket-welding and threaded
ANSI-B16.14	-	Ferrous pipe plug, bushings and locknuts with pipe threads
ANSI-B16.25	-	Butt welding ends
ANSI-B18.1.1	-	Fire hose couplings screw thread.
ANSI-B18.2.1	-	Inch series square and hexagonal bolts and screws
ANSI-B18.2.2	-	Square and hexagonal nuts
ANSI-B18.21.1	-	Lock washers
ANSI-B18.21.2	-	Plain washers
ANSI-B31.1	-	Power piping
ANSI-B36.10	-	Welded and seamless wrought steel pipe
ANSI-B36.9	-	Stainless steel pipe

Other Civil Works Standards

IS-269	-	33 grade ordinary portland cement.
IS2721	-	Galvanized steel chain link fence fabric
IS-278	-	Galvanized steel barbed wire for fencing.
IS-383	-	Coarse and fine aggregates from natural sources for concrete.
IS-432 (P1 and P2)	-	Mild steel and medium tensile steel bars and hard-drawn steel wire for concrete reinforcement.
IS-456	-	Code of practice for plain and reinforced concrete.

IS-516	-	Method of test for strength of concrete.
IS-800	-	Code of practice for general construction in steel.
IS-806	-	Steel tubes for structural purposes.
IS-1172	-	Basic requirements for water supply, drainage and sanitation.
IS-1199	-	Methods of sampling and analysis of concrete.
IS-1566	-	Hard-drawn steel wire fabric for concrete reinforcement.
IS-1742	-	Code of Practice for Building drainage.
IS-1785	-	Plain hard-drawn steel wire for prestressed concrete.
IS-1786	-	High strength deformed Steel Bars and wires for concrete reinforcement.
IS-1811	-	Methods of sampling Foundry sands.
IS-1893	-	Criteria for earthquake resistant design of structures.
IS-2062	-	Steel for general structural purposes.
IS-2064	-	Selection, installation and maintenance of sanitary appliances-code of practices.
IS-2065	-	Code of practice for water supply in buildings.
IS-2090	-	High tension steel bars used in prestressed concrete.
IS-2140	-	Standard Galvanized steel wire for fencing.
IS-2470 (P1 & P2)	-	Code of practice for installation of septic tanks.
IS-2514	-	Concrete vibrating tables.
IS-2645	-	Integral cement waterproofing compounds.
IS-3025 (Part 1 to Part 48)	-	Methods of sampling and test (Physical and chemical) for water and waste water.
IS-4091	-	Code of practice for design and construction of foundations for transmission line towers and poles.
IS-4111 (Part 1 to P5)	-	Code of practice for ancillary structures in sewerage system.
IS-4990	-	Plywood for concrete shuttering work.
IS-5600	-	Sewage and drainage pumps.

National Buiding Code of India 1970

USBR E12	-	Earth Manual by United States Department of the interior Bureau of Reclamation
ASTM-A392-81	-	Zinc/Coated steel chain link fence fabric
ASTM-D1557-80	-	test for moisture-density relation of soils using 10-lb (4.5 kg) rame land 18-in. (457 mm) Drop.
ASTM-D1586 (1967)	-	Penetration Test and Split-Barrel Sampling of Soils
ASTM-D2049-69	-	Test Method for Relative Density of Cohesionless Soils
ASTM-D2435	-	Test method for Unconsolidated, (1982) Undrained Strengths of Cohesive Soils in Triaxial Compression.
BS-5075	-	Specification for accelerating Part I Admixtures, Retarding Admixtures and Water Reducing Admixtures.
CPWD	-	Latest CPWD specifications

ACSR MOOSE CONDUCTOR

IS:6745	Methods for Determination of BS:443-1969 Mass of zinc coating on zinc coated Iron and Steel Articles
IS:8263	Methods for Radio Interference
IEC:437-1973	Test on High Voltage Insulators NEMA:107-1964 CISPR
IS:209	Zinc Ingot BS:3436-1961
IS:398 Part - V	Aluminum Conductors for IEC:209-1966 Overhead Transmission Purposes
BS:215(Part-II)	Aluminium Conductors galvanized IEC:209-1966 steel reinforced extra high
BS:215(Part-II)	voltage (400 kV and above)
IS:1778	Reels and Drums forBS:1559-1949 Bare Conductors
IS:1521	Method for Tensile Testing ISO/R89-1959of steel wire

IS:2629	Recommended practice for Hot dip Galvanising on Iron and Steel.
IS:2633	Method for Testing Uniformity of coating of zinc Coated Articles.
IS:4826	Hot dip galvanised coatings on round steel wires ASTM-A-472-729

GALVANISED STEEL EARTHWIRE

IS:1521	Method for Tensile Testing ISO/R:89-1959 of Steel Wire
IS:1778	Reels and Drums for Bare Conductors
IS:2629	Recommended practice for Hot Dip Galvanising on Iron and Steel.
IS:2633 Coated	Methods for testing Uniformity of Coating of Zinc Articles.
IS:4826	Hot dip Galvanised Coatings ASTM:A 475-72a on Round Steel Wires BS:443-1969
IS:6745	Method for Determination BS:443-1969 of mass of Zinc Coating on Zinc coated Iron and Steel Articles.
IS:209	Zinc ingot BS:3463-1961
IS:398 (Pt. I to P5:1992)	Aluminum Conductors for BS:215 (Part-II) overhead transmission purposes.

Lighting Fixtures and Accessories

IS:1913	General and safety requirements for electric lighting fittings.
IS:3528	Water proof electric lighting fittings.
IS:4012	Dust proof electric lighting fittings.
IS:4013	Dust tight proof electric lighting fittings.
IS:10322	Industrial lighting fittings with metal reflectors.
IS:10322	Industrial lighting fittings with plastic reflectors.
IS:2206 mines	Well glass lighting fittings for use under ground in

	(non-flameproof type).
IS:10322	Specification for flood light.
IS:10322	Specification for decorative lighting outfits.
IS:10322	Luminaries for street lighting
IS:2418	Tubular fluorescent lamps
IS:9900	High pressure mercury vapour lamps.
IS:1258	Specification for Bayonet lamp fluorescent lamp.
IS:3323	Bi-pin lamp holder tubular fluorescent lamps.
IS:1534	Ballasts for use in fluorescent lighting fittings. (Part-I)
IS:1569	Capacitors for use in fluorescent lighting fittings.
IS:2215	Starters for fluorescent lamps.
IS:3324	Holders for starters for tubular fluorescent lamps
IS:418	GLS lamps
IS:3553	Water tight electric fittings
IS:2713	Tubular steel poles
IS:280	MS wire for general engg. Purposes

Conduits, Accessories and Junction Boxes

IS:9537	Rigid steel conduits for electrical wiring
IS:3480	Flexible steel conduits for electrical wiring
IS:2667	Fittings for rigid steel conduits for electrical wiring
IS:3837	Accessories for rigid steel conduits for electrical wiring
IS:4649	Adaptors for flexible steel conduits.
IS:5133	Steel and Cast Iron Boxes
IS:2629	Hot dip galvanising of Iron & Steel.

Lighting Panels

IS:13947	LV Switchgear and Control gear(Part 1 to 5)
IS:8828	Circuit breakers for over current protection for house hold
	and similar installations.
IS:5	Ready mix paints

IS:2551	Danger notice plates
IS:2705	Current transformers
IS:9224 (7)IS:5082 and	HRC Cartridge fuse links for voltage above 650V(Part-2) Wrought aluminium and Al. alloys, bars, rods, tubes sections for electrical purposes.
(8)IS:8623 Gear	Factory built Assemblies of Switchgear and Control for voltages upto and including 1000V AC and 1200V DC.
(9)IS:1248	Direct Acting electrical indicating instruments

Electrical Installation

IS:1293 3	pin plug
IS:371	Two to three ceiling roses
IS:3854	Switches for domestic and similar purposes
IS:5216	Guide for safety procedures and practices in electrical work.
IS:732 (system	Code of practice for electrical wiring installation voltage not exceeding 650 Volts.)
IS:3043	Code of practice for earthing.
IS:3646	Code of practice of interior illumination part II & III.
IS:1944	Code of practice for lighting of public through fares.
IS:5571 hazardous	Guide for selection of electrical equipment for areas.
IS:800	Code of practice for use of structural steel in general building construction.
IS:2633 coated	Methods of Testing uniformity of coating on zinc articles.
IS:6005	Code of practice for phosphating iron and steel.
	INDIAN ELECTRICITY ACT
	INDIAN ELECTRICITY RULES

LT SWITCHGEAR

IS:8623 (Part-I) gear	Specification for low voltage switchgear and control assemblies
IS:13947 (Part-I) gear,	Specification for low voltage switchgear and control Part 1 General Rules
IS:13947 (part-2) gear,	Specification for low voltage switchgear and control Part 2 circuit breakers.
IS:13947 (part-3) gear.	Specification for low voltage switchgear and control Part 3 Switches, Disconnectors, Switch-disconnectors and fuse combination units
IS:13947 (part-4) gear.	Specification for low voltage switchgear and control Part 4 Contactors and motors starters.
IS:13947 (part-5) gear.	Specification for low voltage switchgear and control Part 5 Control-circuit devices and switching elements
IS:13947 (part-6) gear.	Specification for low voltage switchgear and control Part 6 Multiple function switching devices.
IS:13947 (part-7) gear.	Specification for low voltage switchgear and control Part 7 Ancillary equipments
IS:12063	Degree of protection provided by enclosures
IS:2705	Current Transformers
IS:3156	Voltage Transformers
IS:3231	Electrical relays for power system protection
IS:1248	Electrical indicating instruments
IS:722	AC Electricity meters
IS:5578	Guide for Marking of insulated conductors of apparatus terminals
IS:13703 (part 1) or	Low voltage fuses for voltage not exceeding 1000V AC 1500V DC Part 1 General Requirements
IS:13703 (part 2) or	Low voltage fuses for voltage not exceeding 1000V AC 1500V DC Part 2 Fuses for use of authorized persons

IS:6005

Code of practice of phosphating iron and steel

IS:5082

Wrought Aluminum and Aluminum alloys for electrical purposes

IS:2633

Hot dip galvanising

BANK GUARANTEE FOR PERFORMANCE SECURITY

Bank Guarantee No:

Date:

To

NAME

& ADDRESSES OF THE BENEFICIARY

Dear Sirs,

In consideration of the Bharat Heavy Electricals Limited ¹ (hereinafter referred to as the 'Employer' which expression shall unless repugnant to the context or meaning thereof, include its successors and permitted assigns) incorporated under the Companies Act, 1956 and having its registered office at BHEL House Siri Fort New Delhi-110049 through its Unit at BHEL, TBG, Noida having awarded to (Name of the Vendor / Contractor / Supplier) having its registered office at _____ ² hereinafter referred to as the 'Contractor/Supplier', which expression shall unless repugnant to the context or meaning thereof, include its successors and permitted assigns), a contract Ref No PO No.....dated³ valued at Rs.....⁴ (Rupees -----)/FC.....(in words.....) for⁵ (hereinafter called the 'Contract') and the Contractor having agreed to provide a Contract Performance Guarantee, equivalent to% (.... Percent) of the said value of the Contract to the Employer for the faithful performance of the Contract,

we,, (hereinafter referred to as the Bank), having registered/Head office at and inter alia a branch at being the Guarantor under this Guarantee, hereby, irrevocably and unconditionally undertake to forthwith and immediately pay to the Employer a maximum amount Rs ----- (Rupees -----) without any demur, immediately on a demand from the Employer, .

Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding Rs. _____.

We undertake to pay to the Employer any money so demanded notwithstanding any dispute or disputes raised by the Contractor/ Supplier in any suit or proceeding pending before any Court or Tribunal relating thereto our liability under this present being absolute and unequivocal.

The payment so made by us under this Guarantee shall be a valid discharge of our liability for payment thereunder and the contractors/supplier shall have no claim against us for making such payment.

We thebank further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said Contract and that it shall continue to be enforceable till all the dues of the Employer under or by virtue of the said Contract have been fully paid and its claims satisfied or discharged.

We BANK further agree with the Employer that the Employer shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said Contract or to extend time of performance by the said Contractor/Supplier from time to time or to postpone for any time or from time to time any of the powers exercisable by the Employer against the said Contractor/Supplier and to forbear or enforce any of the terms and conditions relating to the said Agreement and we shall not be relieved from our liability by reason of any such variation, or extension being granted to the said Contractor/Supplier or for any forbearance, act or omission on the part of the Employer or any indulgence by the Employer to the said Contractor/Supplier or by any such matter or thing whatsoever which under the law relating to sureties would but for this provision have effect of so relieving us.

The Bank also agrees that the Employer at its option shall be entitled to enforce this Guarantee against the Bank as a principal debtor, in the first instance without proceeding against the Contractor and notwithstanding any security or other guarantee that the Employer may have in relation to the Contractor's liabilities.

This Guarantee shall remain in force upto and including.....⁶ and shall be extended from time to time for such period as may be desired by Employer.

This Guarantee shall not be determined or affected by liquidation or winding up, dissolution or change of constitution or insolvency of the Contractor/Supplier but shall in all respects and for all purposes be binding and operative until payment of all money payable to the Employer in terms thereof.

Unless a demand or claim under this guarantee is made on us in writing on or before the⁷we shall be discharged from all liabilities under this guarantee thereafter.

We BANK lastly undertake not to revoke this guarantee during its currency except with the previous consent of the Employer in writing.

Notwithstanding anything to the contrary contained hereinabove:

- a) The liability of the Bank under this Guarantee shall not exceed.....⁸
- b) This Guarantee shall be valid up to⁹
- c) Unless the Bank is served a written claim or demand on or before _____¹⁰ all rights under this guarantee shall be forfeited and the Bank shall be relieved and discharged from all liabilities under this guarantee irrespective of whether or not the original bank guarantee is returned to the Bank.

We, _____ Bank, have power to issue this Guarantee under law and the undersigned as a duly authorized person has full powers to sign this Guarantee on behalf of the Bank.

For and on behalf of
(Name of the Bank)

Dated.....

Place of Issue.....

¹ NAME AND ADDRESS OF EMPLOYER I.e Bharat Heavy Electricals Limited

² NAME AND ADDRESS OF THE VENDOR /CONTRACTOR / SUPPLIER.

³ DETAILS ABOUT THE NOTICE OF AWARD/CONTRACT REFERENCE

⁴ PROJECT/SUPPLY DETAILS

⁵ BG AMOUNT IN FIGURES AND WORDS

⁶ VALIDITY DATE

⁷ DATE OF EXPIRY OF CLAIM PERIOD

⁸ BG AMOUNT IN FIGURES AND WORDS.

⁹ VALIDITY DATE

¹⁰ DATE OF EXPIRY OF CLAIM PERIOD

Note:

1. Units are advised that expiry of claim period may be kept 2/3 months after validity date.
2. In Case of Bank Guarantees submitted by Foreign Vendors-
 - a. **From Nationalized/Public Sector / Private Sector/ Foreign Banks (BG issued by Branches in India)** can be accepted subject to the condition that the Bank Guarantee should be enforceable in the town/city or at nearest branch where the Unit is located i.e. Demand can be presented at the Branch located in the town/city or at nearest branch where the Unit is located.
 - b. **From Foreign Banks (wherein Foreign Vendors intend to provide BG from local branch of the Vendor country's Bank)**
 - b.1 In such cases, in the Tender Enquiry/ Contract itself, it may be clearly specified that Bank Guarantee issued by **any of the Consortium Banks only** will be accepted by BHEL. As such, Foreign Vendor needs to make necessary arrangements for issuance of Counter- Guarantee by Foreign Bank in favour of the Indian Bank (BHEL's Consortium Bank). It is advisable that all charges for issuance of Bank Guarantee/ counter- Guarantee should be borne by the Foreign Vendor. The tender stipulation should clearly specify these requirements.
 - b.2 **In case, Foreign Vendors intend to provide BG from Overseas Branch of our Consortium Bank** (e.g. if a BG is to be issued by SBI Frankfurt), the same is acceptable. However, the procedure at **sl.no. b.1** will required to be followed.
 - b.3 The BG issued may preferably be subject to Uniform Rules for Demand Guarantees (URDG) 758 (as amended from time to time). In case, of Foreign Vendors, the BG Format provided to them should clearly specify the same.
 - b.4 The BG should clearly specify that the demand or other document can be presented in electronic form.

Sl.	Name of the bank	
1	State Bank of India	
2	Canara Bank	
3	Axis Bank	
4	Bank of Baroda	
5	Central Bank	
6	Citi Bank N.A.	
7	Deutsche Bank **	
8	Exim Bank	
9	Federal Bank Limited	
10	HDFC Bank Limited	
11	Hongkong and Shanghai Banking Corporation Ltd	
12	Indian Bank	
13	ICICI Bank Limited	
14	IDBI Bank Limited	
15	IndusInd Bank Limited	
16	Indian Overseas Bank	
17	Kotak Mahindra Bank Limited	
18	Punjab National Bank	
19	RBL Bank Ltd.	
20	Standard Chartered Bank	
21	Union Bank of India	
22	Yes Bank Limited	
	TOTAL	

SCHEDULE OF COMMERCIAL DEVIATION

Enquiry No: 21Q2400200 dated 31.10.2023

Item: PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES

Project: 400/220/132kV GIS SUBSTATION AT SHAMLI, UP

The following are the deviations/ variations exception from the General Terms and Conditions:

SL.NO.	CLAUSE NO. OF GENERAL TERMS AND CONDITIONS	STATEMENT OF DEVIATION
	NIL DEVIATION	NIL DEVIATION

In case, this schedule is not submitted, it will be presumed that the equipment /material to be supplied under this contract is deemed to be in compliance with the General Terms and Conditions.

If there is NIL deviation, even then the format to be filled as NIL DEVIATION.

Note : Continuation Sheets of like size and format may be used as per the Bidder's Requirement and shall be annexed to this schedule.

All deviations must be mentioned in this format only. Deviation(s) to terms mentioned elsewhere will not be considered.

Place:

Date :

Signature of the authorised representative of

Bidder's name :

Designation:

Company Seal:

SCHEDULE OF TECHNICAL DEVIATION

Enquiry No: 21Q2400200 dated 31.10.2023

Item: PARTIAL DISCHARGE DETECTOR WITH 5 TYPE OF SENSING TECHNOLOGIES

Project: 400/220/132kV GIS SUBSTATION AT SHAMLI, UP

The following are the deviations/ variations exception from the Technical Specifications:

SL.NO.	CLAUSE NO. OF GENERAL TERMS AND CONDITIONS	STATEMENT OF DEVIATION
	NIL DEVIATION	NIL DEVIATION

In case, this schedule is not submitted, it will be presumed that the equipment /material to be supplied under this contract is deemed to be in compliance with the Technical Specifications,

If there is NIL deviation,even then the format to be filled as NIL DEVIATION.

Note : Continuation Sheets of like size and format may be used as per the Bidder's Requirement and shall be annexed to this schedule.

All deviations must be mentioned in this format only. Deviation(s) to terms mentioned else where will not be considered.

Place:

Date :

Signature of the authorised representative of

Bidder's name :.....

Designation:.....

Company Seal:.....