



ಭಾರತ್ ಹೆವಿ ಎಲೆಕ್ಟ್ರಿಕಲ್ಸ್ ಲಿಮಿಟೆಡ್
भारत हेवी इलेक्ट्रिकल्स लिमिटेड
Bharat Heavy Electricals Limited

(A Government of India Undertaking)

ELECTRONICS DIVISION

P.B. No 2606, Mysore Road, Bangalore - 560 026

An ISO 9001, ISO 14001, OHSAS 18001 & ISO/IEC 27001-2005 Company

Fax : +91-80-26989219
Phone : +91-80-26989667
E-mail : spankaj@bheledn.co.in

**Corrigendum 02 to RFQ : SPKSCP V002 Dt.19.07.2017 Due Dt. 07.08.2017 for
Design, Supply, I&C and O&M for Balance of Systems for 15MW (AC) Solar PV
Plant**

Following corrigendum to BHEL Technical spec: PS-439-1139 for BOS tender RFQ for 15MW GACL SPV project.

"1) Page no. 8, BHEL Scope:

(i) Pt. no. 1: Approximate quantity of 'Supply of LT cable, 1C x 300, Al, XLPE, armoured as per IS: 7098 (from SMB to PCU and PCUs to Inverter transformers)', revised to ~65000 m.

2) Page no 5, Cl. 1.4: Enclosures to this tender specification;


(i) Pt. 4 & 5: Revised typical layouts of Main control room and inverter room are issued.


(ii) Pt. 7: The SMBs are to be mounted on MMS structure only. No separate vertical legs mounting/structure and civil work is required for the same.

(iii) Pt. 10: Customer's (GACL's) vendor list is to be followed for procurement of material specified in the list. For items where BHEL has specified vendors, GACL's vendor list for those items to be followed (if available)."

All other terms and conditions of RFQ remains unchanged.

Additional General Manager
SC&PV/MM

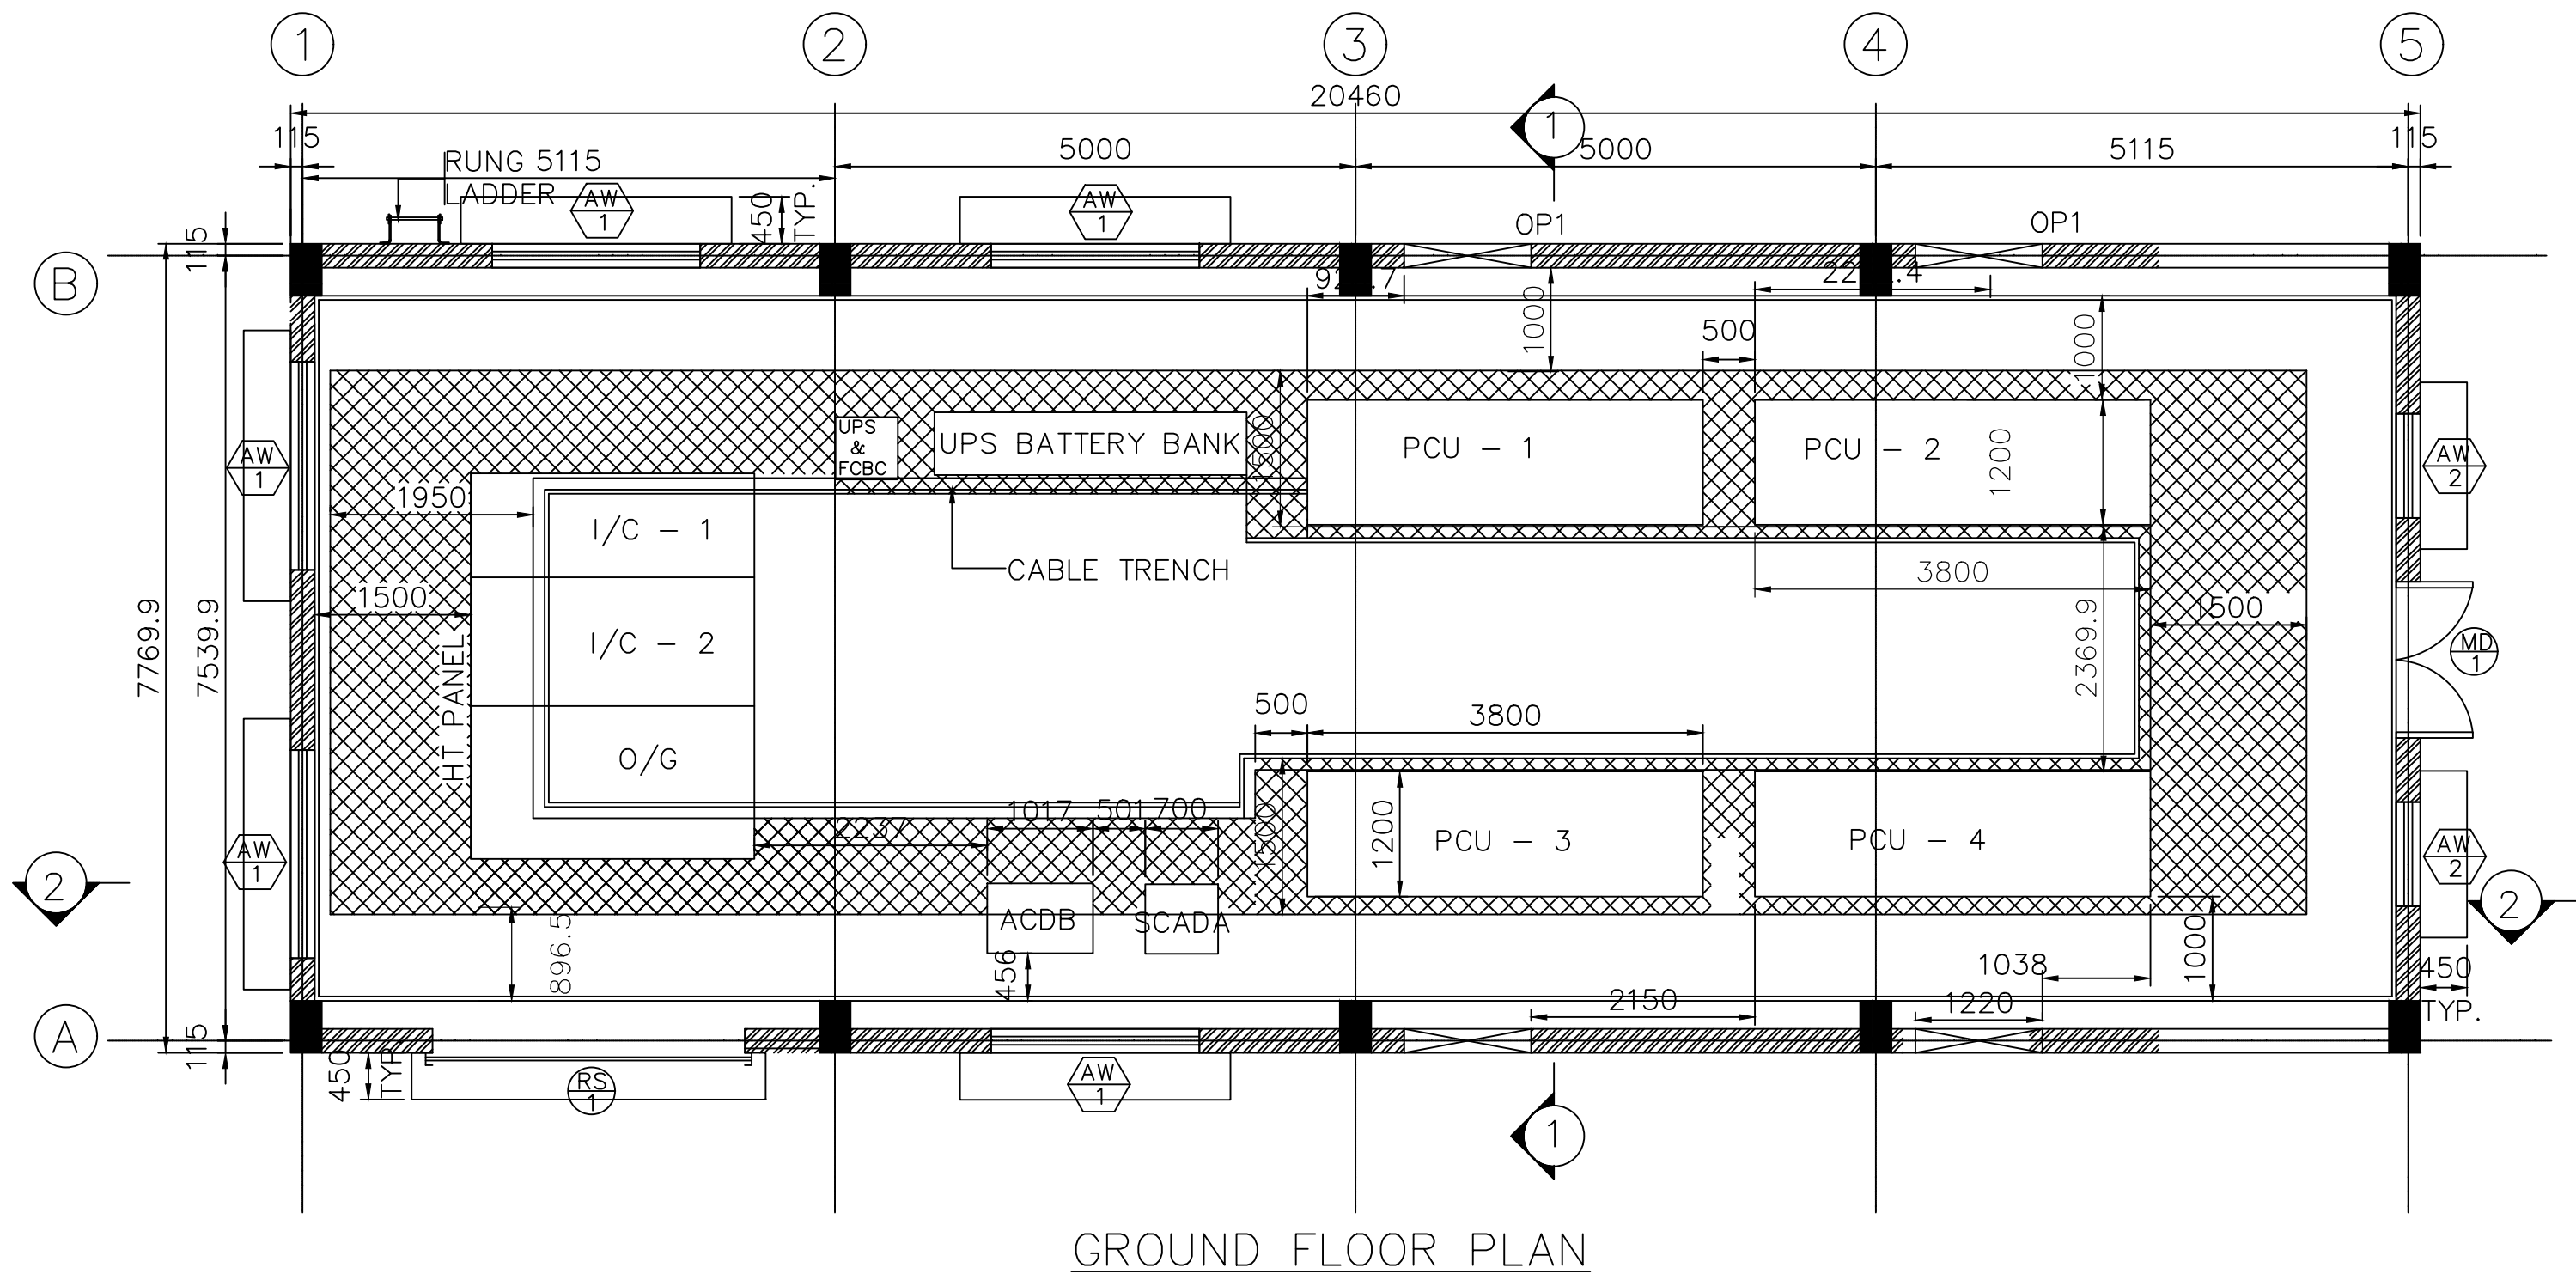

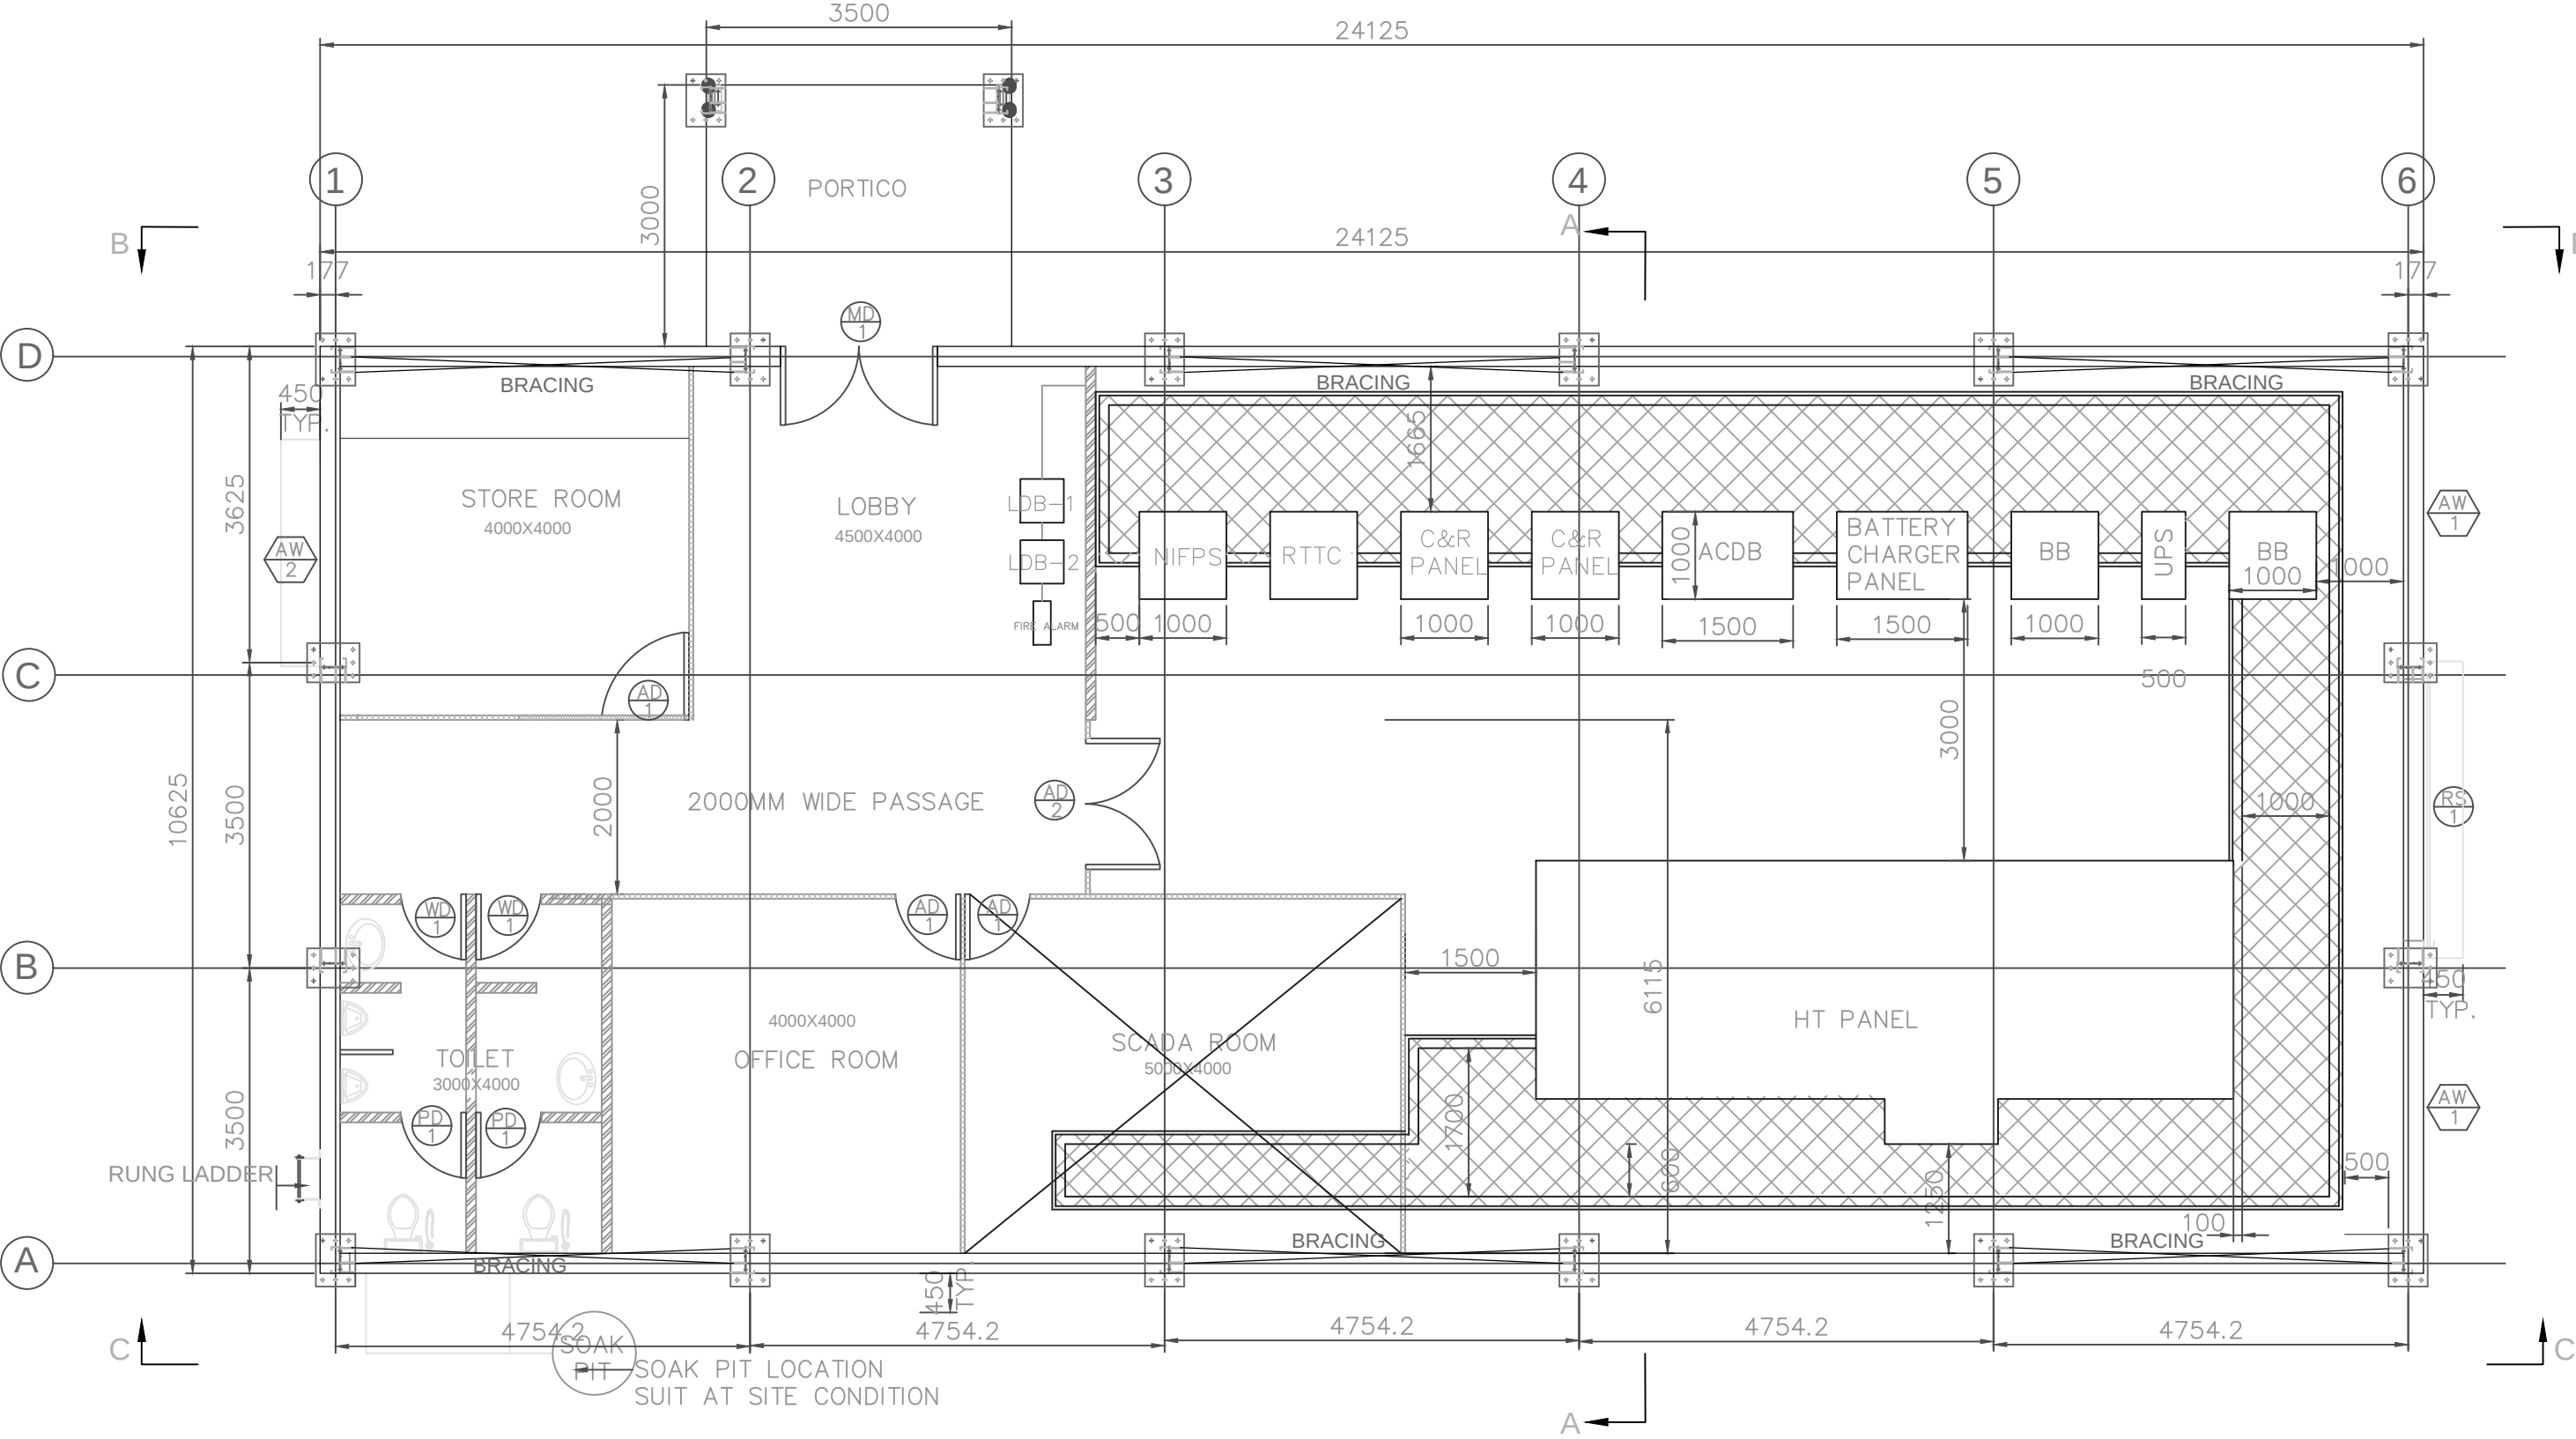

GROUND FLOOR PLAN