


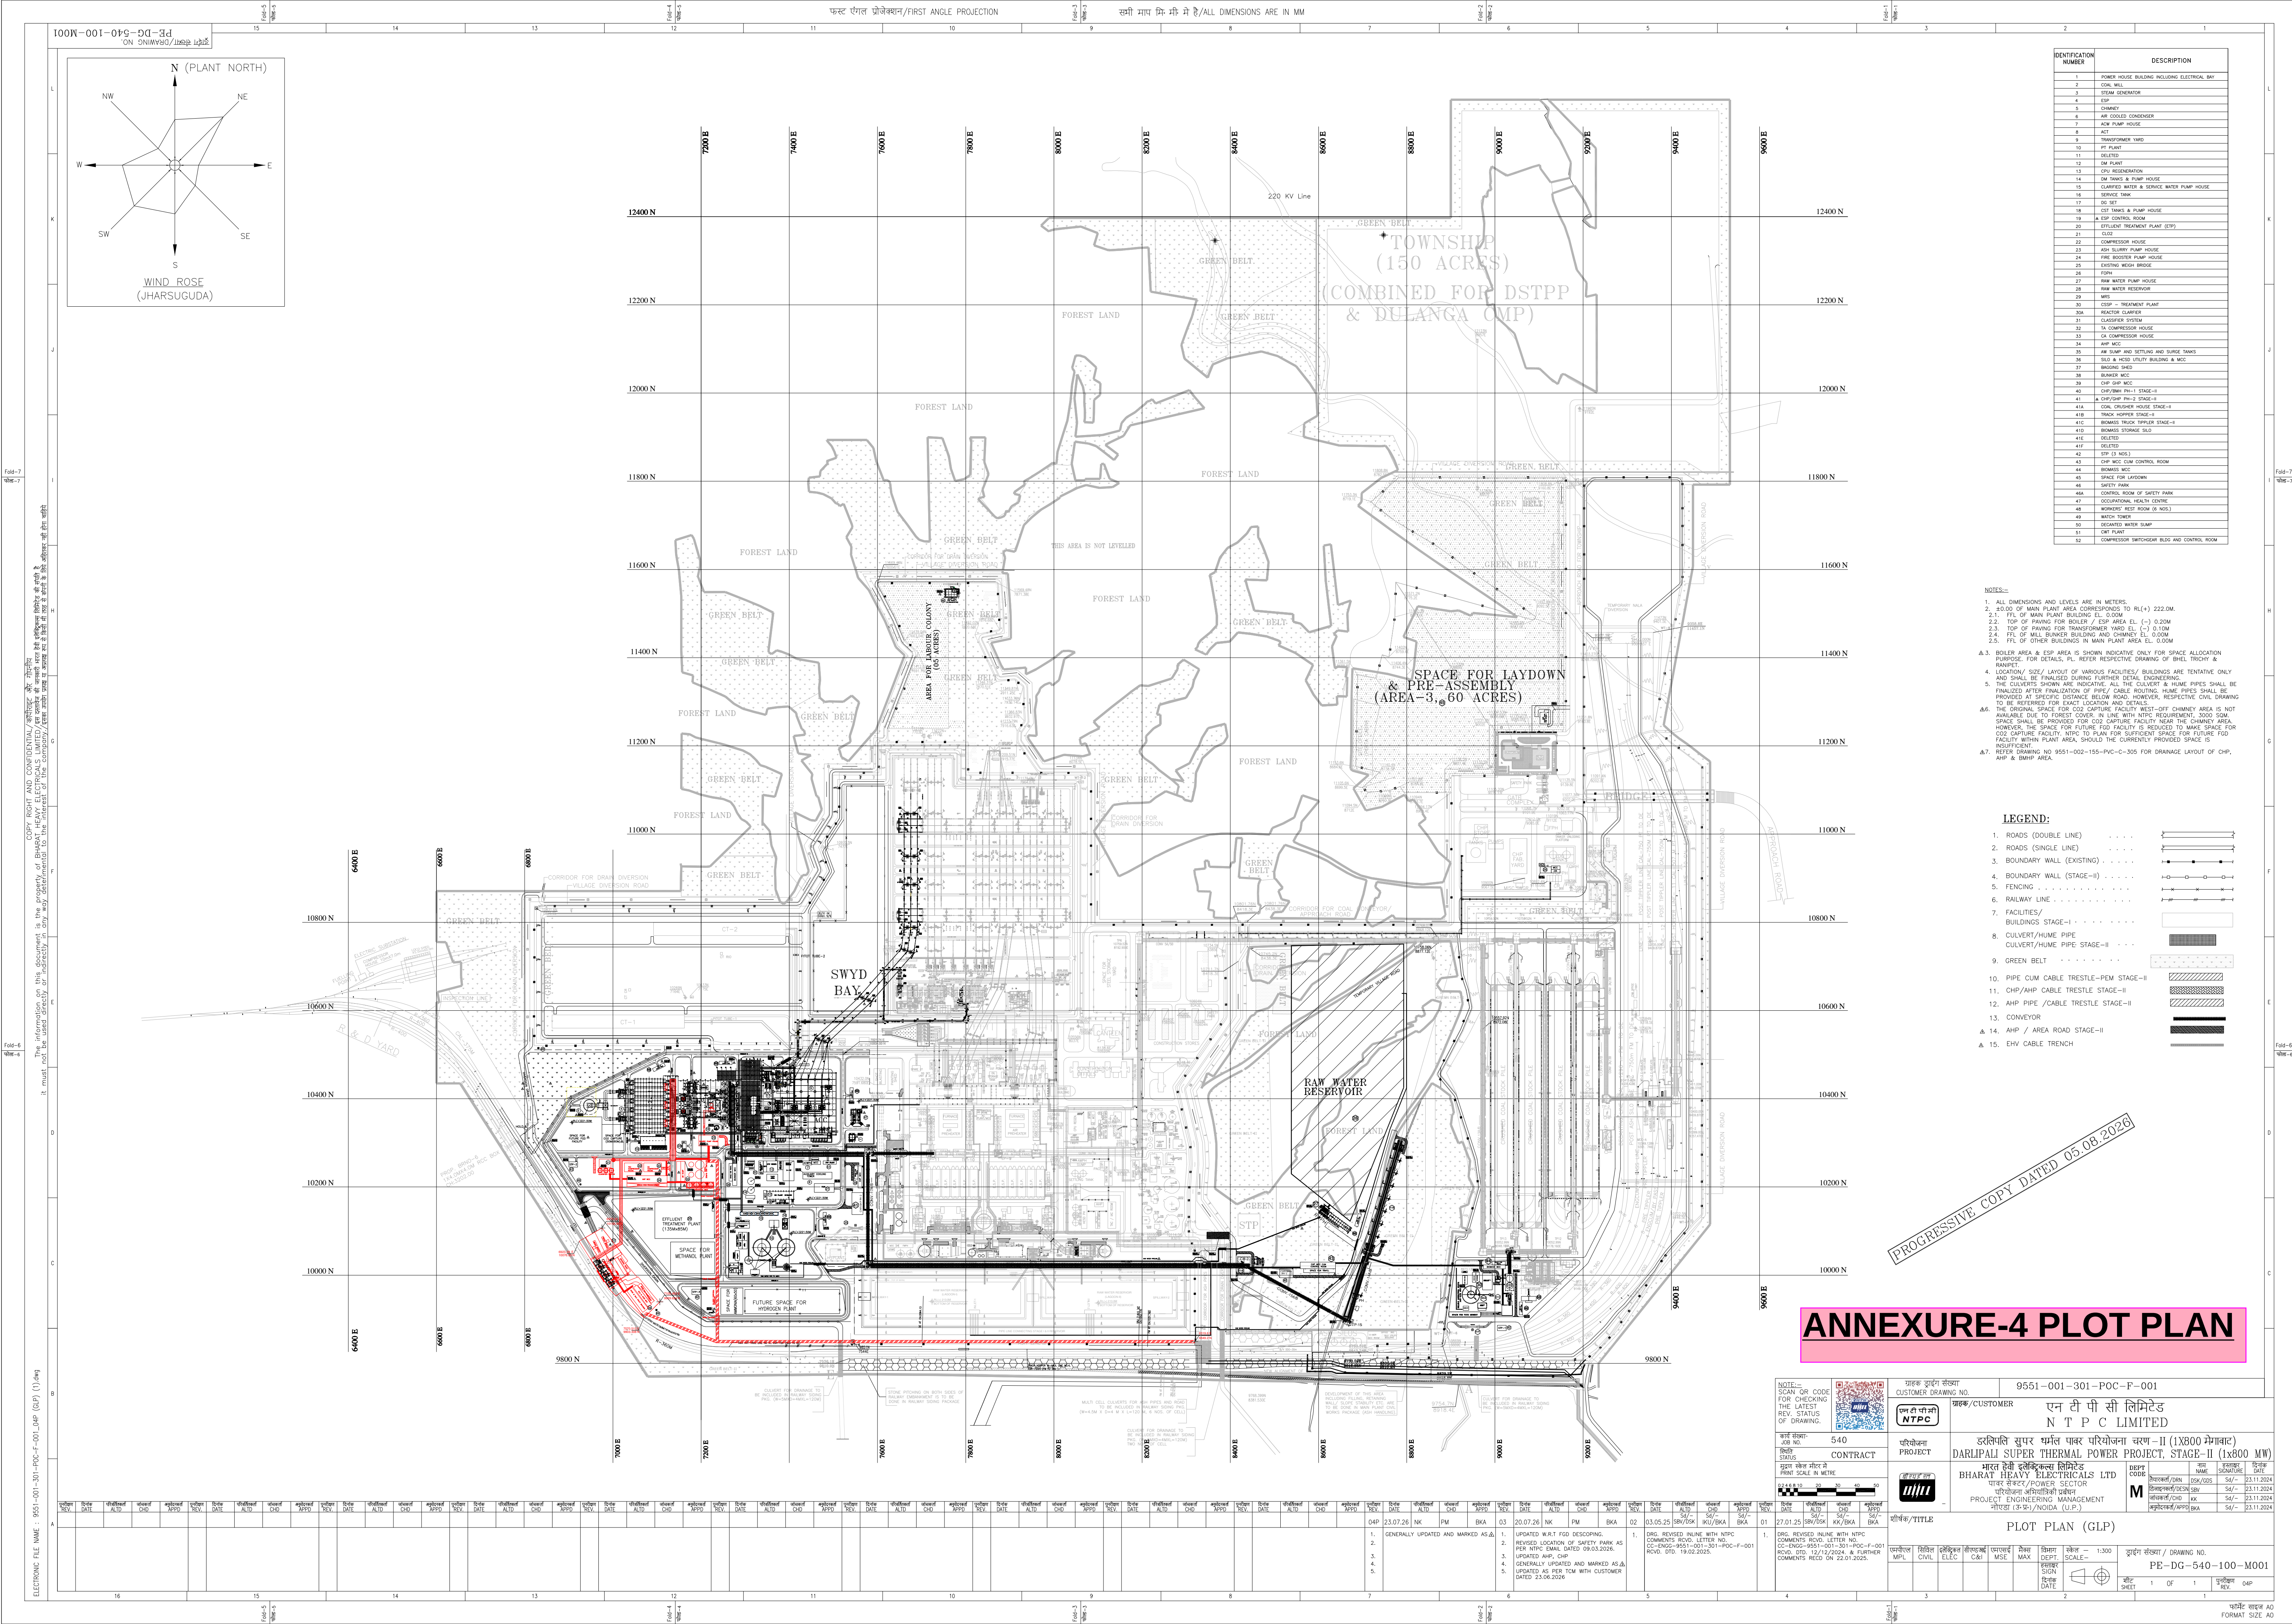

All pipe/cable tray arrangements are tentative. Actual shall be shown during detail engg.
ALL other details given in the tender pertaining other than the below like Fire fighting pipes etc , respective annexures shall be referred/considered

-