


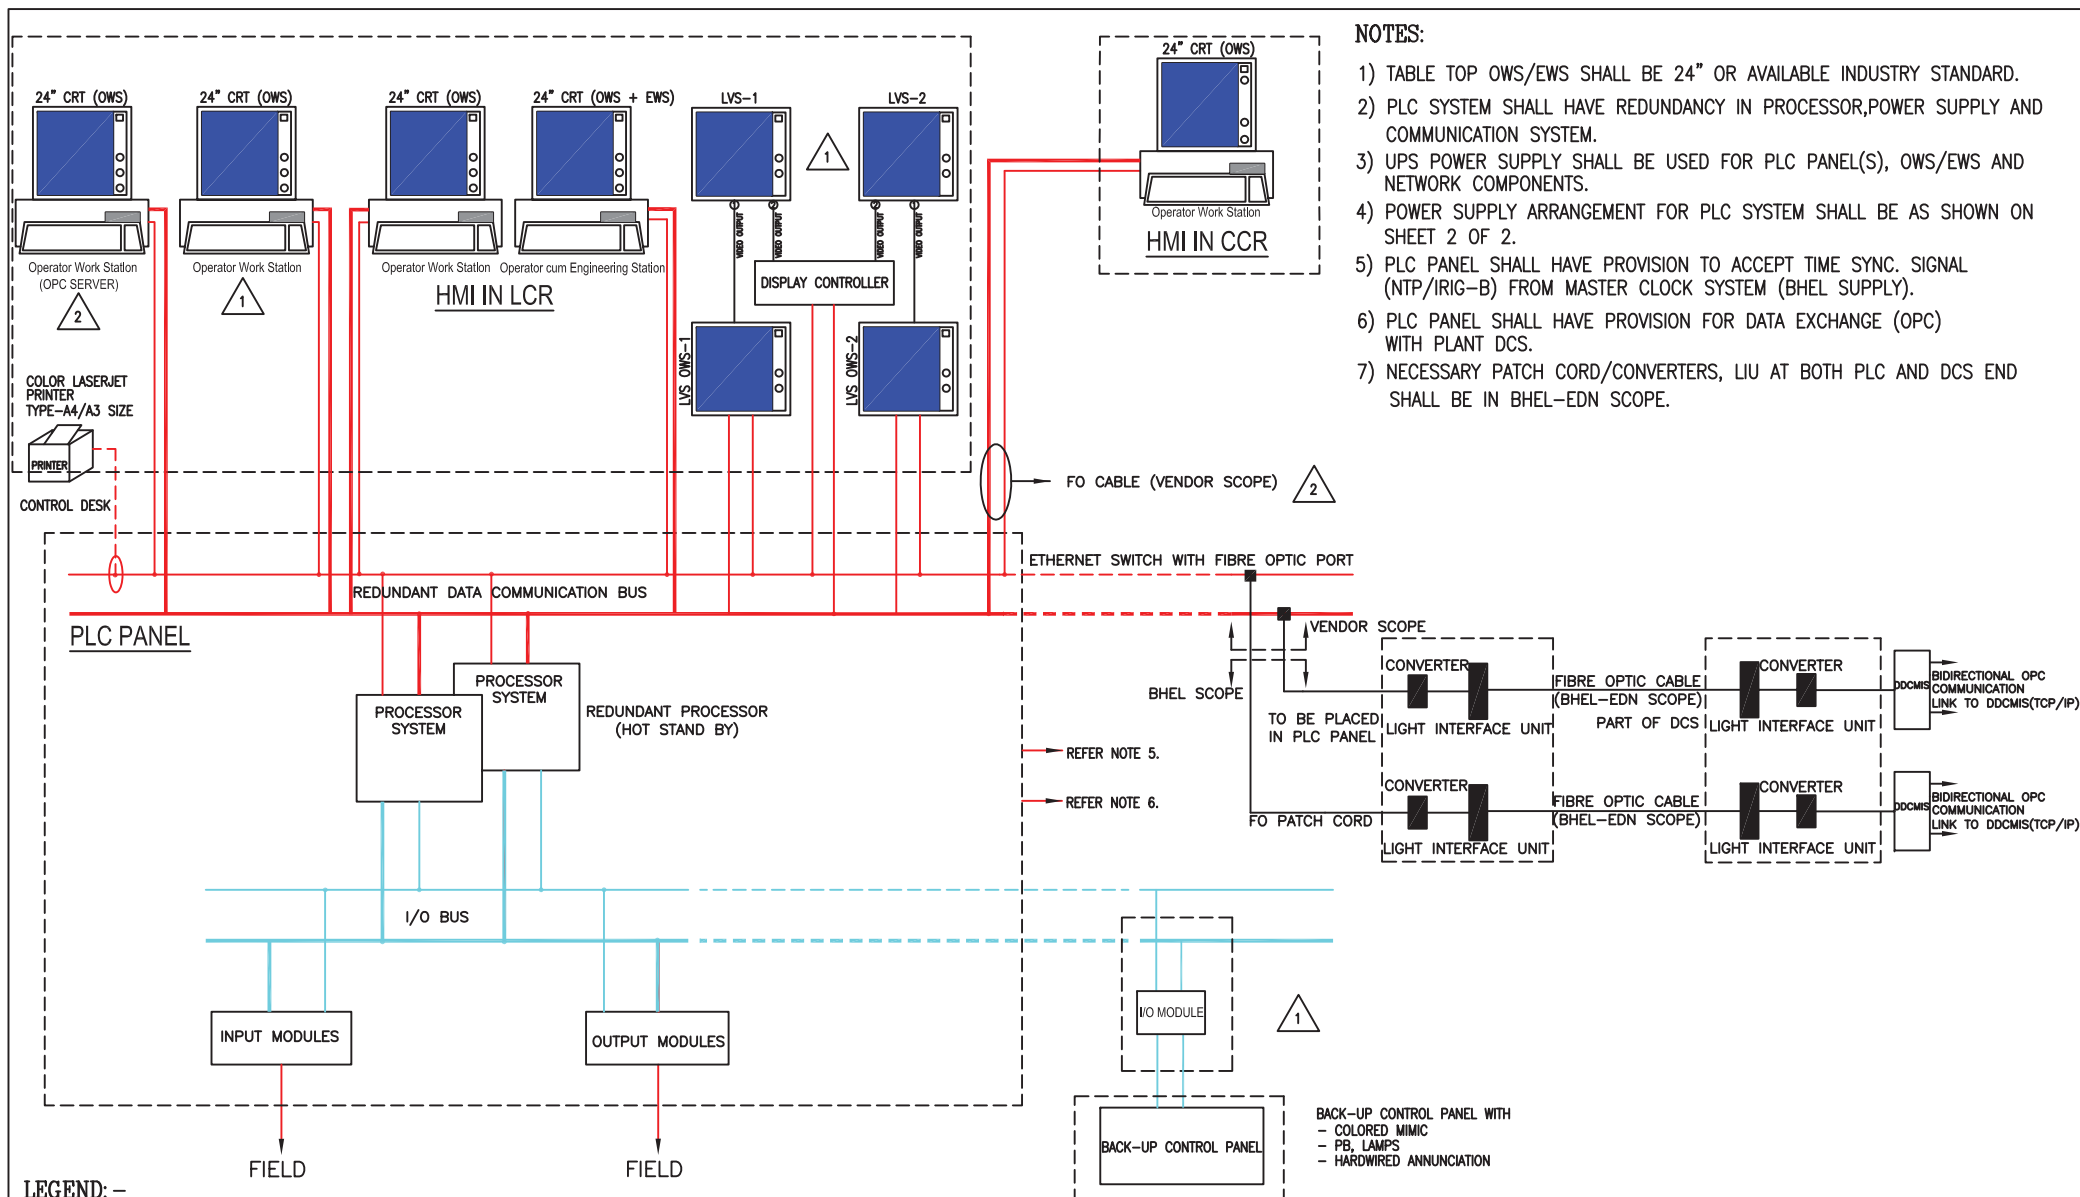

Maharatna Company

PROJECT:

1X800 KOTHAGUDEM TPS
STAGE-VII, UNIT-12

TITLE:

PLC CONFIGURATION DM PLANT &
POTABLE WATER

DRG.NO. PE-DM-410-145-I900

DATE

REV.NO.

SHT 1 OF 1