


## LEGEND

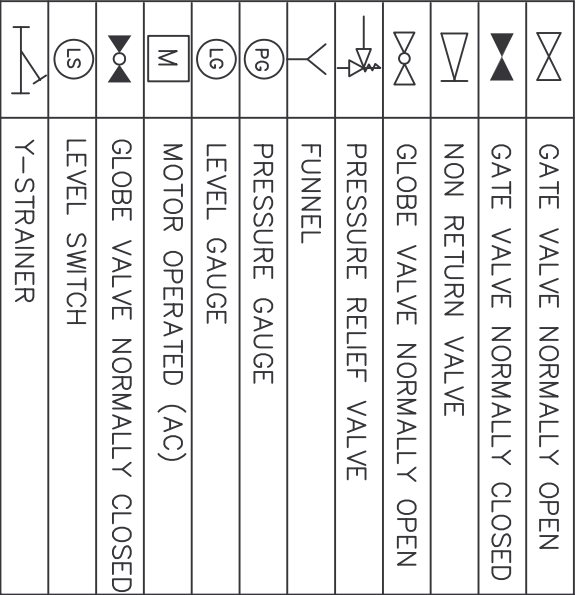

- 1 DOSING SYSTEM SHALL BE SKID MOUNTED.
- 2 TANKS SHALL BE OF SS-304 CONSTRUCTION.
- 3 ALL PIPING SHALL BE OF SS 304 AND DRAIN PIPE CS.
- 4 ALL VALVES SHALL BE OF SS 304 SOCKET WELD ENDS.
- 5 ALL DRAINS SHALL BE CONNECTED AT ONE POINT ON SKID.
6. ONE NO. OF HAND PUMP SHALL BE SUPPLIED WITH THE SKID

ALARM

 <b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b> <b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b> <b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b> <b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b> <b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b>	<b>भारत भारी इलेक्ट्रिकल्स लिमिटेड</b> <b>PROJECT DIVISION, BHOPAL</b>			
		<b>NAME</b>	<b>SIGN</b>	<b>DATE</b>
	<b>PRPD</b>	<b>EXT</b>		
	<b>CMD</b>	<b>SS</b>		
	<b>APPD</b>	<b>SKM</b>		

**BHARAT HEAVY ELECTRICALS LIMITED**  
**PROJECT DIVISION, BHOPAL**

## DV:DOSING VENDOR SCOPE

BHEL DRAWING No.

3 726 29 36 001

Rev  
No.  
0