

NO. DRAWING

L E G E N D


	GATE VALVE NORMALLY OPEN
	GATE VALVE NORMALLY CLOSED
	NON RETURN VALVE
	GLOBE VALVE NORMALLY OPEN
	PRESSURE RELIEF VALVE
	FUNNEL
	PRESSURE GAUGE
	LEVEL GAUGE
	MOTOR OPERATED (AC)
	GLOBE VALVE NORMALLY CLOSED
	LEVEL SWITCH
	Y-STRAINER

- NOTES:-
- 1 DOSING SYSTEM SHALL BE SKID MOUNTED.
 - 2 TANKS SHALL BE OF SS-304 CONSTRUCTION.
 - 3 ALL PIPING SHALL BE OF SS 304 AND DRAIN PIPE CS.
 - 4 ALL VALVES SHALL BE OF SS 304 SOCKET WELD ENDS.
 - 5 ALL DRAINS SHALL BE CONNECTED AT ONE POINT ON SKID.

COPY RIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED

it must not be used directly or indirectly in any way detrimental to the interest of the company.

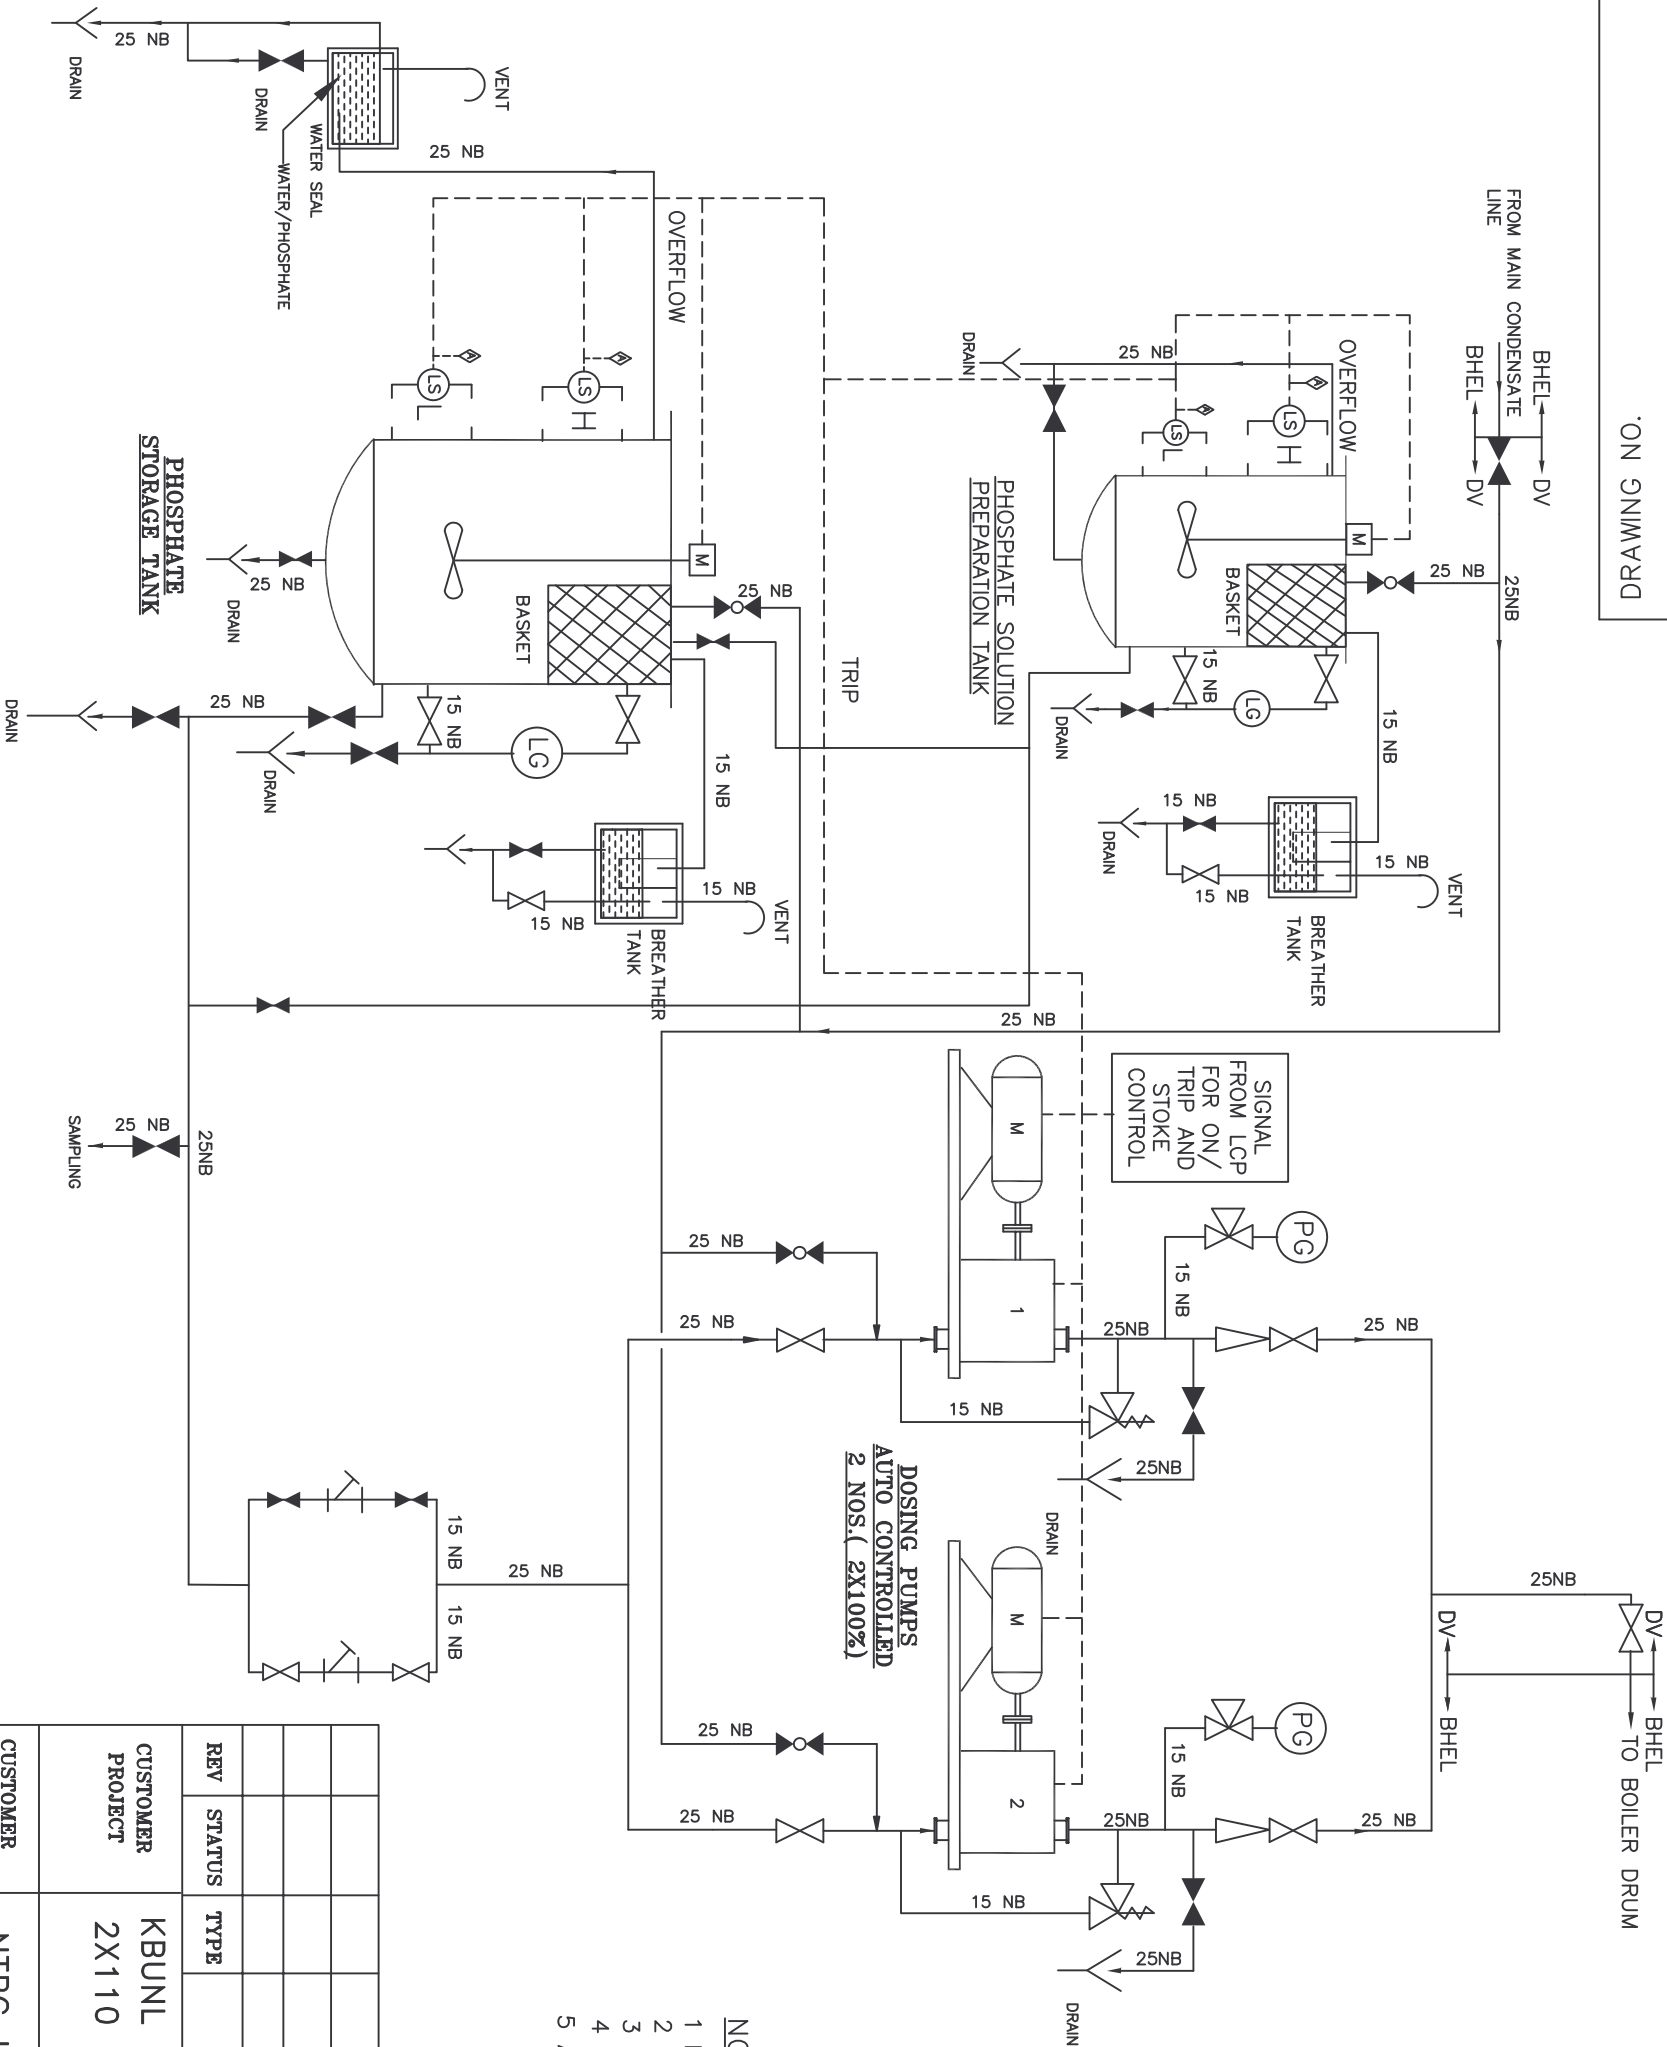


DV→BHEL

DV:DOSING VENDOR SCOPE

DV→BHEL



REV	STATUS	TYPE	REASONS FOR REVISION	PREPARED BY	CHECKED BY	APPROVED BY	DATE		
CUSTOMER PROJECT		KBUNL 2X110 MW(UNIT-1&2) R&M FOR MUZAFFARPUR TPS							
CUSTOMER CONSULTAN		NTPC LTD. NOIDA							
		BHARAT HEAVY ELECTRICALS LIMITED PROJECT DIVISION, BHOPAL				NAME	SIGN	DATE	
					PRPD	BRY			
					CDD	SS			
					APPD	SMD			
BHEL SUBVENDORS									
TITLE: P&I DIAGRAM FOR PHOSPHATE DOSING SYSTEM				BHEL DRAWING No.			Rev No.	0	