

SUPERSEDES INVENTORY NO.

 सामग्री सूची संख्या को अधिस्थिति करता है

TECHNICAL SPECIFICATION OF DUPLEX OIL FILTER

1.0 INTENT OF SPECIFICATION :- The specification is intended to cover design, manufacturing, assembly, testing and supply of Duplex filter complete with commissioning spares(including one set of filter element and one set of all seal gaskets), special tools & tackles & differential pressure switch cum indicator(as per specification given in Anexure-1). The duplex filter is intended for operation in conjunction with Steam Turbines and should be suitable for operation at an ambient temperature of 60°C & 95% humidity.

2.0 FUNCTION :- One side of duplex filter comes in operation with the start of any one of the lubricating oil pumps and remains in service as long as any one of the lubricating oil pump runs. The other side of the duplex filter remains as a stand-by and is brought into operation when the running side gets saturated with dirt and other contaminants which is reflected by the differential pressure read across the inlet and outlet of filter.
 The stand by filter is kept in primed condition to facilitate the immediate change over. The change over device must prevent both the filters being off at the same time. The change over should be possible by the operation of single hand wheel.

3.0 OIL SPECIFICATION :- The specification of oil to be filtered complies with IS : 1012 or ISO VG 46. The equivalent grades of various oil suppliers are servoprime 46 of M/s Indian Oil Corporation and Turbinol – 47 of M/s Hindustan Petroleum Corporation.

COPYRIGHT AND CONFIDENTIAL
 The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company

- Kinematic viscosity at 50°C : 28 CS
- Specific gravity at 50°C : 0.852
- Flash point : 200°C (Min.)
- Operational temperature : 40°C
- Pour point : -6.0°C (Max.)

3.1 **COMPLIANCE WITH NATIONAL STANDARD** ——— **NIL** ———

4.0 FILTER DATA :-

- Type : Duplex
- Inlet/Outlet Nozzles : Flanged

Variant no.	01	02	03	04	05	06	07	08
Capacity (M ³ /hr)	40	130	250	7	60	170	6	130
Nozzle size Nb(mm)	100	125	200	25	125	150	25	150
Design Pr. (Kg/cm ²)	12		250		12		250	12

- Design Temperature : 50° C
- Actual pressure drop cleaned condition : 4000 mm wc(Including change over valve)
- Actual pressure drop saturated condition : 12000 mm wc for var. 01 to 06 and 08
42000 mm wc for var. 04 and 07
- Quality of filtration : 37 micron

स्वत्वाधिकार एवं गोपनीय
 इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रकाश एवं आलेख रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो म किया जाए।

हस्ताक्षर एवं दिनांक
 SIGN & DATE
 13.8.07

				नाम NAME	दिनांक एवं हस्ताक्षर SIGNATURE & DATE
MEMBER PSC	R.PANJA	13/8/07	अनुवादक TRANSLATED BY		
QAX	N.K. Manwani	13/8/07	निर्माणकर्ता WORKED BY	M.SINGH	13/8/07
TSX	V.K. CHAUHAN	13/8/07	जांचकर्ता CHECKED BY	S.D.ROY	13/8/07
सहमत विभाग AGREED DEPTT.	नाम NAME	दिनांक एवं हस्ताक्षर DATE & SIGNATURE	पर्यवेक्षणकर्ता SUPERVISED BY	S.C.A.	13/8/07
			स्वीकृति APPROVED :	A.K. JAIN	13/8/07 8:20
REV. NO. 03			निर्माण PREPARED :	STE	जारी ISSUED :
Dt 30.10.09				STE (TL)	दिनांक DATE :
					02.02.1993

सामग्री सूची संख्या
 INVENTORY NO.
 P-5136

5.0 DESIGN, MATERIAL & CONSTRUCTION OF FILTER :-

a) Filter element	: Wire cloth of 25 micron to 40 micron	
	: Material Stainless Steel	
	: Pleated type filter Elements are not acceptable	
	: Elements shall be cleanable type for reuse.	
b) Filter body	: Seamless pipe ASTM A 106 Gr. B or equivalent for var .01, 02, 03, 05,06, 08 and ASTM A 105 or equivalent for var. 04 & 07.	
c) Change over Valve	: Type	Ball valve
	: Body Material	ASTM 216 Gr. B or equivalent
	: Internals	Stainless Steel
d) Sealings	: VITON	

Materials of other components shall be selected by the bidder. The materials of construction of filter shall be such as to resist corrosion & erosion and shall give a long trouble free service. No cast iron components shall be acceptable. BHEL/owner reserves the right to ask for changes in material.

At suitable points on filter, lifting lugs shall be provided for ease of transportation & erection. Their locations must be shown on the dimensional drawings.

Each side of the filter shall be provided with a vent connection suitable for pipe thread R1/4" and a drain connection suitable for pipe thread R1/2" for var. 01, 04 & 07 and R1" for var.02, 03, 05, 06 & 08. Vent connections should necessarily be provided on the sides of each filter chamber top flange to facilitate removal of filter cover for cleaning / maintenance without removal of vent piping connected to this connection.

Priming line with a valve shall be provided between two filter chambers. The filter as per var. 01, 02, 03, 05, 06, 08 is envisaged to be mounted in a tray and the distance between legs of filter shall be above inlet connection. Other dimensions shown in the sketch are binding.

The filter as per var. 04 & 07 shall be provided with suitable arrangement to support it with Main Oil Tank /steel structure.

6.0 QUALITY ASSURANCE, INSPECTION AND TESTINGS :



- 6.1 The bidder shall submit quality plan along with his offer format for BHEL/Owner's approval.
- 6.2 The particulars of the proposed shop tests and procedures for the tests shall be submitted to BHEL/Owner for approval along with Quality Plan.
- 6.3 The filter shall be dispatched only after inspection, approval of test certificates and clearance from BHEL/Owner.
- 6.4 Wherever welding is involved, it is to be carried out by qualified welders and weld procedures are to be qualified as per ASME code section-IX.
- 6.5 The minimum tests/checks to be carried out on the Duplex Oil Filter are given below. BHEL/Owner reserves the right to ask for any more checks at the time of Quality Plan finalisation.

6.5.1 **Testing of materials:** The material of body, spindle, disc seat, filter elements etc. shall be tested as per relevant standard for its chemical composition, mechanical properties viz. YS. UTS, impact, %age elongation, reduction in areas etc and NDT . The test certificates for all the tests indicating actual test results should be furnished. Supplier shall give the type and details of NDT to be carried out along with the offer. Material certificate of conformance & acceptable in case of M/s hydac & M/s EPE & BOLL & KIRCH.
 * Ductile cast iron (EN-GJS-400-10)

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly, in any way, detrimental to the interest of the company.

स्वत्वाधिकार एवं गोपनीय
 इस दस्तावेज में दी गई जानकारी भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग केवल केवल केवल के लिए ही किया जा सकता है। अन्य किसी भी उद्देश्य के लिए इस दस्तावेज का उपयोग नहीं किया जाये।

संशोधन संख्या: 13/8/07
 SIGN: & DATE

संशोधन संख्या INVENTORY NO P-5136	REV. NO. 03		निर्माणकर्ता WORKED BY M.SINGH		31/7/07
			जांचकर्ता CHECKED BY SDR.		31/7/07

उत्पाद मानक

ST46056



**STEAM TURBINE ENGINEERING
PRODUCT STANDARD**

पृष्ठ का

Page 03 of 07

दिनांक एवं हस्ताक्षर
SIGN & DATE

सुपरसेड्स
INVENTORY NO

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.

स्वत्वधिकार एवं गोपनीय
इस दस्तावेज में की गई सूचना भारत भारत भारती, भारत के सम्पत्ति है। इसका प्रयोग बिना भारत भारती की लिखित अनुमति के बिना नहीं किया जा सकता।

दिनांक एवं हस्ताक्षर
SIGN & DATE

सुपरसेड्स
INVENTORY NO

6.5.2 All butt welds shall be subjected to 10% RT and all fillet welds to 100% MPI. All welding shall be carried out by qualified procedures and welders.

6.5.3 Following tests shall be carried out during various stages of manufacturing at bidder's works :-

- a) Check for dimensions of all the component.
- b) **Hydraulic Test** : The body of filters shall be tested at one and half times the design Pressure in fully assembled condition for 5 mts.
- c) **Seat leakage test** : It shall be carried out at the design pressure for 5 minutes. Acceptance norms shall be nil leakage.
- d) **Functional Test** : It shall demonstrate smooth operation of change over valve.
- e) **Verification of mesh size of element** : By recognised lab.
- f) **Collapsibility Test** : A type test at a differential pressure of 5.0 kg/cm² for var 01,02,03,05,06 & 160.0 kg/cm² for variant 04 & 07. This test shall be conducted as per ISO : 2941.
- g) **Pressure Drop Test** : As per ISO 3968. The pressure drop in clean condition should not exceed 0.4kg/cm² including change over valve. This is type test.

7.0 DOCUMENTS:

A. Along with offer :

- i) Detailed catalogue with electrical contact rating.
- ii) Assembly drawing with part lists, material of each part, nozzle sizes & their coordinates, leg spacing, cross sectional arrangement incorporating overall dimensions.
- iii) Pressure loss curve for normal flow at different flow areas.
- iv) Details of priming connection, change over valve, differential pressure switch, flow direction indicator, etc.
- v) Quality plan.
- vi) Testing procedures.
- vii) List of commissioning spares which will include one set of all type of seals/gaskets & one filter element.
- viii) List of spares for 5 years of operation.
- ix) List of special erection/maintenance tools.
- x) Type test certificate for collapsibility test and pressure drop test shall be submitted alongwith the offer.

B. After Placement of order

- i) Documents listed at 7.0(A) above (for approval) 4 weeks
- ii) O & M instructions 12 weeks
- iii) Instruction on conservation and deconservation. 12 weeks

No. of copies shall be specified at the time of ordering. However if not specified, 10 copies shall be furnished by the bidder.

C. Along with Dispatch

- i) Detailed catalogue
- ii) Calibration & test certificates
- iii) Guarantee certificate
- iv) Type test certificate for degree of protection

REV. NO.

03

निर्माणकर्ता
WORKED BY

M.SINGH

[Signature]

31/7/07

जांचकर्ता
CHECKED BY

SDR.

[Signature]

31/7/07

P-5136
31/7/07

SUPERSEDES INVENTORY NO.
 सामग्री सूची संख्या को प्रतिस्थापित करता है

8.0 IDENTIFICATION : The name plate of filter shall have following information

- i) Type/Designation : Duplex filter
 ii) Tag no.

Var.	01 & 05	02,03,06&08	04 & 07
Tag no.	MAV43 BT001	MAV42 BT001	MAV35 BT001

- iii) Nominal size of inlet / outlet nozzles
 iv) Press loss (in cleaned condition)
 v) Manufacturer's name
 vi) Medium
 vii) Purchase order no.
 viii) Month & year of manufacture

9.0 CLEANING, PAINTING, CONSERVATION & PACKING : The bidder shall give exact and precise details about the measures envisaged by him for surface protection. Painting of interior surface coming in contact with oil is prohibited. After testing of filter its internals shall be thoroughly cleaned, dried and conserved before packing . conservation shall be suitable for storing in saline atmosphere & for a period of 2 years before use. Filter shall be suitably packed for transportation. Instruction should be issued regarding reconsevation, deconsevation and storage of package

10.0 GENERAL : The bidder can make suitable offers even if there are minor deviations which do not effect the efficient functioning of the equipment. However the deviation must be clearly spelt the same along with the offer. The offer may not be considered if all the technical particulars and information called for in the specification are not submitted along with the offer.


11.0 GUARANTEE :



- i) The supplier shall guarantee trouble free and satisfactory operation of the equipment for a period of 18 months after delivery or 12 months after commissioning whichever is earlier.
 ii) The bidder shall guarantee the quality of filtration & pressure loss in cleaned and saturated conditions.
 iii) If during erection / commissioning at site and deficiency in parts is detected. BHEL site office shall prepare the assessment report and copy of the same shall be forwarded to the bidder. The bidder shall replace / rectify the concerned items free of charge. The bidder if he so desires may depute his representative to site at his own cost with in one week after receipt of the above report, shall be final & binding on bidder of Duplex filter.









12.0 DESPATCH : The equipment along with all accessories shall be dispatched to a destination to be specified after the placement of order.

COPYRIGHT AND CONFIDENTIAL
 The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company

स्वास्वाधिकार एवं गोपनीय
 इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रलेख एवं आलेख का से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए ।

हस्ताक्षर एवं चिन्हक
SIGN & DATE
 13/8/07

सामग्री सूची संख्या INVENTORY NO. P-5136	REV. NO. 03		निर्माणकर्ता WORKED BY M.SINGH	 31/7/07	
			जांचकर्ता CHECKED BY SDR	 31/7/07	

हस्ताक्षर एवं तिनांक SIGN & DATE		उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD	ST46056 पृष्ठ का Page 05 of 07								
सामग्री सूची संख्या को अधिकृत करता है SUPERSEDES INVENTORY NO.	ANNEXURE-1 <u>DIFFERENTIAL PRESSURE SWITCH CUM INDICATOR :</u>										
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company	<p>1.0 The differential pressure switch shall consist of a calibrated indicator for indicating the differential pressure across each filter basket. Switch with electrical contacts shall be actuated when the differential pressure reaches preset value.</p> <p>2.0 The differential pressure switch shall be suitable for Ambient temperature : 0-60°C and Relative humidity : 95%</p> <p>3.0 Housing : Body material : Die cast aluminum alloy or stainless steel Degree of protection : IP 65 External surface : Finished with staving enamel</p> <p>4.0 Sensing element type : Diaphragm/piston</p> <p>5.0 Material of sensing element and other parts : Stainless steel AISI 304 or equivalent in contact with the service medium</p> <p>6.0 Differential pressure range : 0-1.2 kg/cm² for var. 01,02,03,05,06 & 08 0-6 kg/cm² for var. 04 & 07</p> <p>7.0 Max. static pressure : one and half times design pressure</p> <p>8.0 Set point adjustment : The switching point shall be adjusted to operate at 0.9 kg/cm² in pressure increasing direction for var. 01, 02, 03, 05, 06 & 08 .for var. 04 & 07 the switching shall be set at 4.2 kg/cm². However, the set point for variants shall be adjustable over the specified differential pressure range. There shall be proper facility with suitable lockable arrangement for set point adjustment.</p> <p>8.1 Switching repeatability : ± 1% of differential pressure range</p> <p>8.2 Accuracy : Equal or better than ± 2% at mid 50% of differential pressure range</p> <p>9.0 Electrical contact : Contact type : Snap action micro switch / Reed contact Contact material : Silver plated Contact rating : 0.25A / 120 V AC, 3W/ DC No. of Contact s : 1 No. change over type i. e. 1 SPDT Contact life : approx. (10)⁶ switching cycles.</p> <p>10.0 Electrical connection : Cable entry shall be provided with cable gland complete with neoprene grommet. Terminals shall be suitable for cable termination of 0.5 mm² cable core cross section.</p> <p>11.0 Identification Tag : In addition to the instrument name plate, one separate stainless steel tag punched with tag no. MAV 43 CP 011 for variants 01 & 05, MAV 42 CP 013 for var. 02, 03, 06 & 08 and MAV 35 CP 016 for var. 04 & 07 shall be fastened with the switch, if not possible to engrave on instrument name plate.</p>										
	स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रत्येक एवं अपरिच्छेद्य रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हासिलकराए हो स कि या जाए ।										
हस्ताक्षर एवं तिनांक SIGN & DATE											
सामग्री सूची संख्या INVENTORY NO.	P-5136	REV. NO. 03	<table border="1" style="width: 100%;"> <tr> <td>निर्माणकर्ता WORKED BY</td> <td>M.SINGH</td> <td></td> <td>31/7/07</td> </tr> <tr> <td>जांचकर्ता CHECKED BY</td> <td>SDR.</td> <td></td> <td>31/7/07</td> </tr> </table>	निर्माणकर्ता WORKED BY	M.SINGH		31/7/07	जांचकर्ता CHECKED BY	SDR.		31/7/07
निर्माणकर्ता WORKED BY	M.SINGH		31/7/07								
जांचकर्ता CHECKED BY	SDR.		31/7/07								



उत्पाद मानक

STEAM TURBINE ENGINEERING
PRODUCT STANDARD

ST46056

पृष्ठ का

Page 06 of 07

दिनांक एवं हस्ताक्षर
SIGN & DATE

सामग्री सूची संख्या का
संश्लेषित क्रमांक है
SUPERSEDES
INVENTORY NO

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.

स्वत्वाधिकार एवं गोपनीय

इस प्रलेख में दी गई सूचना भारत भारी इलेक्ट्रिकल्स लिमिटेड की संपत्ति है। इसका प्रयोग एवं प्रसारण केवल इस लिखित ही संज्ञा पर ही होना चाहिए। अन्य किसी भी संज्ञा पर प्रयोग, जो कि कंपनी के हित में अधिकारिक है, न किया जाए।

दिनांक एवं हस्ताक्षर
SIGN & DATE

सामग्री सूची संख्या
INVENTORY NO

12.0 Hydraulic impulse connection details = R1/4

DATA SHEET TO BE FURNISHED BY THE BIDDER OF DUPLEX FILTER

- 1.0 a) Differential pressure switch cum indicator Yes/ No
- b) Connected piping & valve Yes/ No
- 2.0 Priming valve & piping Yes/ No
- 3.0 Legs, flange connections & other dimensions as per sketch Yes/ No
- 4.0 Contract drawings & curves Yes/ No
- 5.0 Commissioning spares , O & M spares for five years of operation Yes/ No
- 6.0 Special erection/ Maintenance tools Yes/ No
- 7.0 Quality of filtration Micron's
- 8.0 Pressure loss at normal flow :
 - a) In cleaned condition mm wc
 - i) In the filter
 - ii) In the valve
 - b) In saturated condition (50% choked condition) mm wc
- 9.0 Material of components as per clause-5 Yes/ No
- 10.0 Weight of filter kg
- 11.0 Tests to be carried out :
 - a) Chemical composition & Mechanical properties of components mentioned in clauses – 5 Yes/ No
 - b) NDT Yes/ No
 - c) Hydraulic test of body (filter & valve) Yes/ No
 - d) Functional test Yes/ No
 - e) Collapsibility test Yes/ No
 - f) Mesh size verification from recognized lab Yes/ No
 - g) Pressure drop test Yes/ No
- 12.0 Gross filtering area mm²
- 13.0 Net filtering area mm²

LIST OF CROSS REFERRED STANDARD ——— NEXT PAGE.

REV. NO.

03

निर्माणकर्ता
WORKED BY

M.SINGH

M.Singh 31/7/07

जांचकर्ता
CHECKED BY

SDR

SDR 31/7/07

13/6/07

P-5136

उत्पाद मानक

ST46056



STEAM TURBINE ENGINEERING
PRODUCT STANDARD

पृष्ठ का

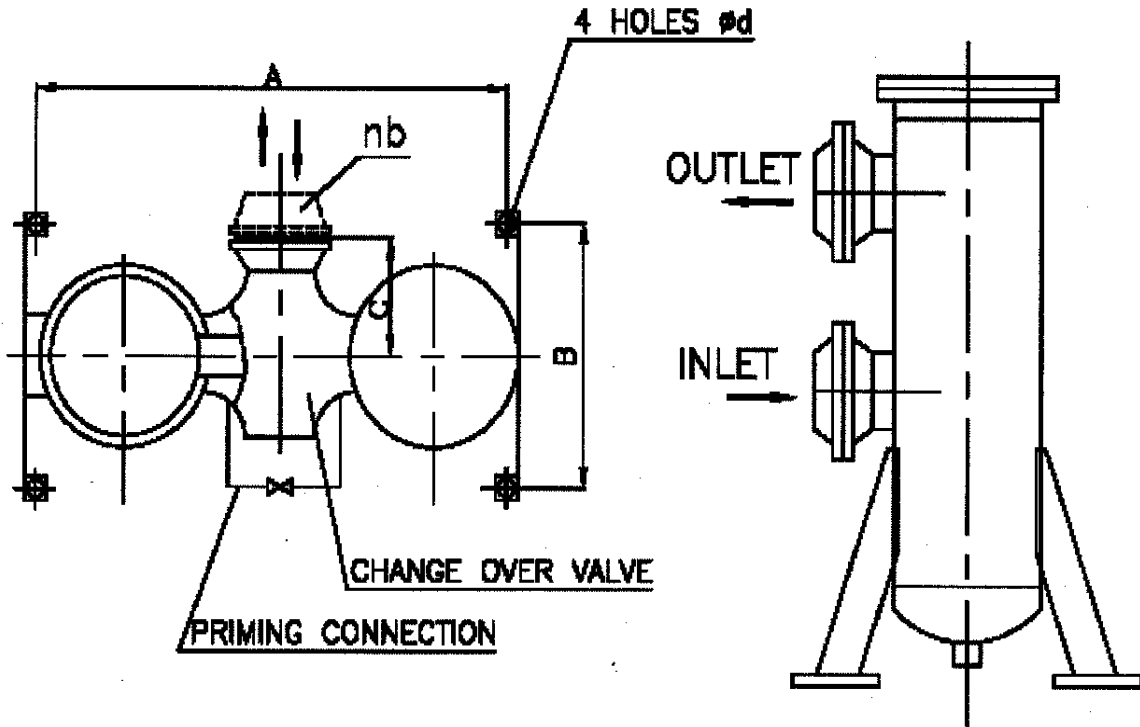
Page 07 of 07

दिनांक एवं हस्ताक्षर
SIGN & DATE

सामग्री सूची संख्या को
अधिकृतित करता है
SUPERSEDES
INVENTORY NO.

Cross referred standard:- IS:1012-1978
ISOV 46 ! ISO 2941, ISO 3968
AISI-321/316

COPYRIGHT AND CONFIDENTIAL
The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company



DIMENSIONS ARE INDICATIVE ONLY NOT BINDING

08	150	1120	560	255	23	DIN 2633
06	200	1180	560	285	23	
05	125	890	560	235	23	
03	200	1315	560	285	23	
02	125	890	560	235	23	
01	100	785	320	235	18	FLANGE DETAILS
VAR. NO.	nb	A	B	C	d	

DUPLEX FILTER

दिनांक एवं हस्ताक्षर
SIGN & DATE

सामग्री सूची संख्या
INVENTORY NO.
P-5136

REV. NO.
03

निर्माणकर्ता WORKED BY	M.SINGH	<i>M.Singh</i>	31/7/07
जांचकर्ता CHECKED BY	SDR.	<i>SDR.</i>	31/7/07

MANUFACTURER'S NAME AND ADDRESS		STANDARD QUALITY PLAN				TO BE FILLED BY BHEL			TO BE FILLED BY BHEL					
BHEL	VENDOR'S NAME	ITEM	DUPLEX OIL FILTER (LUBE OIL)		QP NO.	QA/BI/QP/020								
				DATED	17.07.2023									
		DRG. NO.	AS PER PO		REV	02								
		SPEC.	ST46056											
		REV	AS PER PO		Page 1 of 2									
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS		
1	2	3	4	5	6	7	8	9	D	M	B	N	10	11

1. MATERIAL													
1.1	BODY, DISC COVER, FLANGE, SPINDLE, SEAT, MAGNETIC INSERTS	CHEMICAL COMPOSITION	MAJOR	CHEMICAL	1/HEAT	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	TC	✓	P	V		
		MECHANICAL PROPERTIES	MAJOR	MECHANICAL	1/HEAT	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	TC	✓	P	V		
1.2	FILTER ELEMENT	MESH SIZE	MAJOR	DIMENSIONS	100%	BHEL APPD DRAWING	BHEL APPD DRAWING	TC	✓	P	V		FROM RECOGNIZED LAB
		CHEMICAL COMPOSITION	MAJOR	CHEMICAL	1/HEAT	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	ORDERING SPEC. / BHEL APPD. DRG. & DATA SHEET	TC	✓	P	V		
2. IN-PROCESS INSPECTION													
2.1	WELD QUALITY	RT	MAJOR	VISUAL	10% BUTT WELDS	BHEL APPD DRAWING	BHEL APPD DRAWING	TC	✓	P	V		
		DPT	MAJOR	VISUAL	100% FILLET WELDS	BHEL APPD DRAWING	BHEL APPD DRAWING	TC	✓	P	V		
3. FINAL INSPECTION													
3.1	ASSEMBLY	DIMENSIONS	MAJOR	MEASUREMENT	100%	BHEL APPD DRAWING	BHEL APPD DRAWING	IR	✓	P	W		
3.2	FUNCTIONAL TEST	OPENING & CLOSING	MAJOR	VISUAL	100%	SMOOTH OPERATION OF CHANGEOVER VALVE		TC	✓	P	W		

		LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	
MANUFACTURER/ SUBCONTRACTOR				APPROVED BY

MANUFACTURER'S NAME AND ADDRESS		STANDARD QUALITY PLAN				TO BE FILLED BY BHEL			TO BE FILLED BY BHEL			
BHEL	VENDOR'S NAME	ITEM	DUPLEX OIL FILTER (LUBE OIL)		QP NO.	QA/BI/QP/020						
					DATED	17.07.2023						
		DRG. NO.	AS PER PO		REV	02						
		SPEC.	ST46056									
		REV	AS PER PO			Page 2 of 2						
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
1	2	3	4	5	6	7	8	9	D	10		11

3.3	BODY AND ASSEMBLED FILTER	LEAKAGE	CRITICAL	HYDRAULIC TEST	100%	BHEL APPD DRAWING	NO LEAKAGE	TC	✓	P	W		
3.4	SEAT LEAKAGE	LEAKAGE	CRITICAL	HYDRAULIC TEST	100%	BHEL APPD DRAWING	NO LEAKAGE	TC	✓	P	W		
3.5	COLLAPSIBILITY TEST		MAJOR	TYPE TEST		BHEL APPD DRAWING/SPEC	BHEL APPD DRAWING/SPEC	TC	✓	P	V		SHALL BE SUBMITTED ALONG WITH OFFER
3.6	PRESSURE DROP TEST		MAJOR	TYPE TEST		BHEL APPD DRAWING/SPEC	BHEL APPD DRAWING/SPEC	TC	✓	P	V		SHALL BE SUBMITTED ALONG WITH OFFER
3.7	PRESERVATION AND PACKING	-	MAJOR	VISUAL	100%	BHEL SPEC	BHEL SPEC	-	-	P	-		

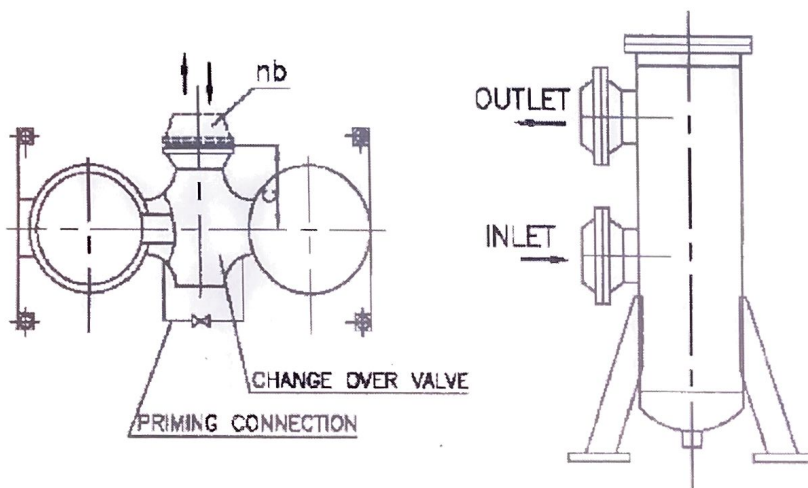
		LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	
MANUFACTURER/ SUBCONTRACTOR				APPROVED BY

PRE-QUALIFICATION REQUIREMENT FOR DUPLEX FILTER LUBE OIL-BI017

Brief Introduction: - Duplex Filter Lube Oil is used to filter Lube oil going to turbine Bearings.

One side of duplex filter comes in operation with start of any one of the lubricating oil pumps and remains in service as long as any one of the lubricating oil pumps runs. The other side of the Duplex filter remains as a Stand-by and is brought into operation when the running side gets saturated with dirt and other contaminants. This saturation is reflected by the differential pressure read across the inlet and outlet of filter. The stand by filter is kept in primed condition (by equalizing valve) to facilitate the immediate change over. The change over device must prevent both the filters being off at the same time. The change over should be possible by the operation of single hand wheel/lever.

An Indicative Drawing of Duplex Filter is shown below. Please note that Inlet and Outlet connections are indicative and that their locations are interchangeable.



Pre-qualification Criteria for vendor

1. Vendor should have executed at least 2 projects within 8 years from date of issue of enquiry, satisfying the minimum Pre-evaluation criteria mentioned against each row in Table-1.
2. Vendor to furnish the details against each column in Table-1, of the projects executed by them satisfying clause-1 above.



From the experience list furnished in Table-1

- a. Vendor has to furnish customer acceptance / successful operation certificate alongwith certified GA drawing/documents of Duplex Filters of any one project.
- b. Vendor to submit PO copies in support of clause 1 of PQR.

Table-1

	Minimum Pre- evaluation criteria	Project 1 (to be filled by Vendor)	Project 2 (to be filled by Vendor)
End customer Name	-		
Inlet- Outlet Size	Min 150 NB		
Design Pressure	Min 12 kg/cm ²		
Design Temp.	40-60 °C		
Type of fluid	Turbine oil VG46		
Differential pressure Switch cum Indicator Across filter	DP range 0 -1.2 Kg/Cm ²		
Material of construction of body	ASTM A 106 Gr B or equivalent		
Material of Filter element	Stainless Steel		
Application	To filter Lubricating Oil going to bearings of Steam turbine/Gas Turbine		
Year of Execution	Within last 8 years of date of issue of enquiry.		
No. of PO copies	02		
Quality of Filtration	25 to 40 microns		
Flow	Min 170 m ³ /hr		
Contact details, Telephone no's & Email id of End User	-		

Against vendor's replies, BHEL reserves the right to ask for more information / documents/ clarifications.

Prepared By		Approved By	
Rajeev Kumar	23/07/2022	Sh. Anuj Jain	23/07/22
Dy. Manger(STE-TL)		SDGM (STE-TL)	