



Toilet Block(5 X3.6 M C/C)

Note:


- 1) 4" thick RCC (1:2:4) slab shall be constructed over toilet block at a height of 3.0m(clear) from FFL.
- 2) Reinforcement details of Slab:
 - a) Main Reinforcement - 12mm dia @ 150mm c/c
 - b) Distribution Reinforcement - 10mm dia @ 150mm c/c.
- 3) Brick Masonry footing followed by 100mm PCC of Mix 1:4:8 shall be step footing all along the All wall. (refer drawing)
- 4) All dimensions are in Feet unless otherwise mentioned. (refer respective dimensions)
- 5) PVC Over head Water Tank Shall be directly placed over the RCC roof

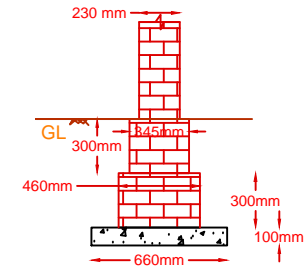

Foundation Details for Main wall (230mm thick)



Foundation Details for Partition wall (230mm thick)

Title	plan of Toilet block
Drg No	BHE/PW/TB / 01
Project	2X800 MW NTPC LARA
Owner	 BHEL-PSWR