



**Bharat Heavy Electricals Limited
(A Govt. of India Undertaking)**

Piping Centre , 80, G. N. Chetty Road, CHENNAI - 600 017
Phone : 91 (044) 2815 8821, Fax : 91 (044) 2815 8869
e-mail: prs@bhelmpc.co.in

REF: ENQ NO:PC:4100900064

DT: 04.05.2009

Sub: Procurement of formed pipe fittings.

Ref: Enquiry No:PC:4100900064 dt 04.05.09

Please find the following tender documents for reference.

1. Enquiry with list of items and check list
2. Edge preparation drawings
3. Tech. delivery condition TDG: 102:04

Pre qualification is the criteria for consideration for other than BHEL approved vendors. After qualifying for registration, the new vendors may be considered for future requirements, in line with BHEL system and policy. Such vendors will not be considered for this enquiry.

This is a limited tender and only vendors who are contacted through e-mail/courier may submit their offers.

The New vendors may download vendor registration forms from BHEL web site www.bhel.com and relevant data for formal registration.

Dy Manager / Purchase
BHEL / Piping Centre
80,GN Road, T.Nagar
Chennai-600017



ENQUIRY
(IMPORTS)

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
80, G.N.ROAD, T.NAGAR
Purchase Department - Piping Centre
CHENNAI - 600 017.
TAMILNADU (INDIA)

PHONE :
GRAMS : BHARATELEC
FAX NO :
E-mail :
Web :

Page 1/3

OFFICE COPY	Collective No.	Enquiry Date	Due Date for Quotation
	4100900064	04.05.2009	18.05.2009 Due Date for
Please quote Enquiry No, Date and due date in all correspondences. This is only a request for quotation and not an order			
RFQ No: 4100900064			

Item	Description	Unit	Quantity	Delivery Quantity	Schedule Date
10	921174680000 CONRED 508X120 /355.6 X 55 SA234WP22CL1 TDC:	NO	2.000	2.00	30.09.09
20	921174790000 ECCRED 406.4 X 38 / 273.1 X 25 SA234WP91 TDC:	NO	2.000	2.00	30.09.09
30	921174800000 ECCRED 406.4 X 38 / 355.6 X 29 SA234WP91 TDC:	NO	2.000	2.00	30.09.09
40	921174810000 C.RED 355.6 X 62/273 X 63.5 SA234WP22CL2 TDC:	NO	3.000	3.00	30.09.09
50	925249480000 BW LR 90 DEG ELL 355.6 X29 SA234WP91 TDC:	NO	54.000	54.00	30.09.09
60	925249490000 BW LR 90 DEG ELL 406.4 X 38 SA234WP91 TDC:	NO	28.000	28.00	30.09.09
70	925249500000 BW LR 90 DEG ELL 273.1 X 25 SA234WP91 TDC:	NO	20.000	20.00	30.09.09

General Note:

Enclosures:

"LD clause has to be confirmed without fail."

S. VARADARAJAN
Dy. Manager - Purchase
BHEL / Piping Centre
80, G.N. Road, T. Nagar
Chennai - 600 017.


CHECK LIST

Vendors are requested to give confirmation against each point and send it along with the technical cum commercial part **without fail**.

Sl No	Details of Enquiry	Confirmation by vendor
1	This is a Two part bid a. Technical cum commercial part and b. Price part Please Submit your offer as per the terms and conditions.	
2	Kindly confirm supply as per TDG:102:04	
3	EP as per dl value mentioned against each item and EP style as per DRG 3-80-300-19825/01 (CS/AS) or 3-80-999-97744/00 (P91) as applicable.	
4	Quotation shall be submitted in Euro currency only.	
5	Please quote on FOB - Sea port (or) CFR - Chennai sea port basis. Price shall include inspection, packing and forwarding charges. Please do not quote on Ex-works basis.	
6	Delivery shall be within 4 months from the date of ordering.	
7	Validity of your offer shall be for 90 days from tender opening date.	
8	Payment terms shall be 100% through LC with PBG for 10% of PO Value.	
9	LD of 0.5% per week subject to a max of 15% for the undelivered portion.	
10	Vendors shall guarantee the supplies for a period of 24 months from the date of dispatch of materials or 18 months from the date of their commissioning whichever is later	
11	BHEL reserves the right to order in Part quantity. No Minimum order condition is acceptable to BHEL.	

Vendors signature.

DRAWING NO.
3-80-999-97744

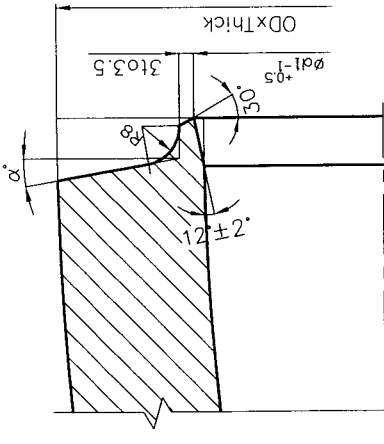

$\alpha' = 6^\circ$ FOR WALL THICKNESS $\leq 30\text{mm}$.
 $\alpha' = 10^\circ$ FOR WALL THICKNESS $> 30\text{mm}$.

FIGURE-Xf

CAUTION
THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LTD. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPANY

STANDARD

		BHARAT HEAVY ELECTRICALS LTD., PIPING CENTRE, CHENNAI, 600 017		NAME	SIGN	DATE
DEPT. CODE		GRADE OF UN TOL. DIM C/M/F	SCALE N.T.S.	WEIGHT (Kg)	REF TO ASSY / OLD DRG.	
REV 01		DATE	ALTERED APPROVED	DRN R. ANANTH	19.01.2009	
				CHD R. ANANTH	19.01.2009	
				APPD M.N. VASUDEVAN	19.01.2009	
TITLE		CARD CODE		DRAWING No.		REV
BW EP FOR WP91 ASMEB16.9 FITTINGS		U 01		3-80-999-97744		00

SHEET NO.



1.0 CODES:-

The fittings shall meet Indian Boiler Regulations (IBR) and the following requirements in addition to the standards specified in the Purchase Order (PO)

2.0 RAW MATERIALS:-

- a) All pipes used for fittings shall meet the respective specification. The test certificate shall be furnished.
- b) All mother pipes used for fittings shall be subjected to a hydraulic test as per SA 530 or UT as per ASTM E 213 at the mill
- c) All plates used for fittings shall be UT tested as per S1 of SA578 and acceptance norms shall be as per Level B of SA578
- d) The raw material forging shall be ultrasonically tested as per SA 388 and the acceptance norm shall be as per 3.3.4 of ASME Sec VIII Div 2.
- e) Steel for SA182 F11, F12 & F22 if indigenously procured, to be from following manufacturers approved under IBR for creep resistant steels: i) Alloy Steel Plant Durgapur, ii) Tata Iron & Steel company, Jamshedpur & iii) Mahindra Ugine Steel Company, Mumbai.
- f) Carbon content of SA 234 WPB, WPC, SA 105 fittings shall be restricted to 0.25% max

3.0 PROCESS:-

- a) Process of manufacture shall conform to applicable standards.
- b) All fittings shall be of seamless unless otherwise specified in the purchase order.
- c) In case of welded fittings, WPS, PQR & welder qualification shall be approved by BHEL - PC, prior to start of welding.
- d) All fittings shall have smooth surfaces, workman like finish and free from loose scales and defects like laps, seams, folds, cracks, pitting etc.. Repair by welding is NOT permitted.
- e) Dimensions shall be as per ASME B16.9 or B16.28, Butt Weld edges shall be as given in Purchase Order. The ends of reducers shall have a straight portion of Minimum 13mm.
- f) Unless otherwise specified in the P.O SA 234 WP 11/12/22 fittings shall be supplied as per class 1, SA 182 F11/12 shall be supplied as class 2, SA 182 F22 shall be of class 3 only.

4.0 HEAT TREATMENT:-

4.1 All fittings shall be heat treated as below.

SA 234 WP B	- As per specification
SA 105, SA234 WP C	- Normalised
SA234 WP11/ WP12/ WP22	- Normalised & Tempered
SA182 F11/ F12/ F22	- Normalised & Tempered
Stainless Steel :-	
SA 182 F304/ 316/ 321/ 347	- Solution annealed
SA 403 WP304/ 316/ 321/ 347	- Solution annealed

- 4.2** Fittings conforming to SA 234 WP91 and SA182 F91 shall be normalised at 1040 to 1070 deg C (for wall thickness larger than 75 mm, accelerated cooling may be done to obtain a fully martensitic structure) and tempered at 760 ± 10 deg C

5.0 TESTING :-

- (a) All ferrous fittings shall be tested by MPI as per ASTM E-709 and SS fittings shall be LPI tested as per ASTM E 165.

S. Jayakumar, Engg	Approved by	K. Vedaprasad, QC
P. Elangovan, QA		K. Ganeshan, MPL



- (b) One fitting of each specification, heat, heat treatment lot and size shall be subjected to Tension Test as per applicable standard.
- (c) All fittings of wall thickness above 6mm or NB 200mm and above shall be Ultrasonically Tested as per SA 388; acceptance norms shall be 3.3.4 of ASME section VIII Div.2.
- (d) Hardness test shall be carried out on each fittings of WP91 / F91. For other fittings hardness shall be checked on 10% of the fittings.
- (e) In case of welded fittings; all the welds shall be 100% RT tested and acceptance norms shall be UW 51 of ASME Sec VIII DIV-1
- (f) The following supplementary tests shall be carried out for specifications namely SA105, SA 182 F11 / F12 / F22 / F91, SA 234 WPC / WP11 / WP12 / WP22 / WP91 (No supplementary test applicable for SA 234 WPB)
 - a) Product analysis – one / heat / size.
 - b) Tension test – one / heat / heat treatment lot / size.
- (g) Metallography:- Metallography shall be carried out on one per heat, per size, per heat treatment lot of WP91 / F91 fittings. Acceptance norms - The Material shall be free from any micro fissures. Microstructure shall show tempered martensite and also to be examined for any grain growth. Photomicrograph with 500x (Min) magnification along with Metallography report to be provided. The actual magnification shall be indicated.

6.0 POSITIVE MATERIAL IDENTIFICATION (PMI) FOR ALLOY STEEL FITTINGS.

Each alloy steel fitting shall be checked for the correctness of the material during manufacturing and final inspection using X-ray fluorescence principle or spark emission spectrography.

7.0 PAINTING , COLOUR CODING, MARKING, PACKING & END PROTECTION

7.1 **PAINTING** : All fittings (except stainless steel and galvanised) shall be **painted** on the external surface as given below

- a) surface preparation : Blast cleaning
- b) Primer coat : 50 microns of Red oxide zinc phosphate confirming to IS 12744
- c) Final coat : 70 microns of Synthetic enamel paint confirming to IS2934 .
- d) Shade : (i) smoke grey – shade no 692 of IS5 for all carbon steel fittings
(ii) Sea green -- shade no 217 of IS5 for all Alloy steel fittings

The internal surface shall be protected with rust preventive coating or rust inhibitor. Stainless steel and Galvanised fittings need not be painted.

7.2 **COLOUR CODING** : All fittings shall be colour coded circumferentially at ends as given below

SA 234 WPB / WPBW	=	Red
WPC / SA105	=	Blue

S. Jayakumar, Engg

P. Elangovan, QA

Approved by

K. Vedaprasad, QC

K. Ganeshan, MPL



Bharat Heavy Electricals Limited, Piping Centre, Chennai
**Technical Delivery Conditions Conditions for Butt
Welded – Fittings as per Indian Boiler Regulations.**

TDG : 102 Rev 04

Date : 27.02.2009

Page : 3 of 4

WP11 / SA182 F11	=	Green & White
WP12 / SA182 F12	=	Black & Red
WP22 / SA182 F22	=	Blue & Red
WP91 / SA182 F91	=	Brown & Red
SA182 / SA 403 F / WP 304	=	Blue & Yellow
316	=	Black & Green
321	=	Blue & Brown
347	=	Yellow & Black

7.3 MARKING :

7.3.1 The fittings dispatched to **BHEL Stores** shall be punched / etched with Material code, Heat number, material specification, maker's emblem, Inspectors seal and Statutory authorities seal (as applicable).

In addition, the above details along with size shall be paint stenciled on the fittings.

If the thickness of the fitting is less than 6 mm, punching is not permitted and the above details shall be paint stenciled only. Fittings of size up to 2" (50mm) shall be tied together and the above details shall be punched / etched in a separate tag and tied to it.

7.3.2 The fittings dispatched directly to project site as **DTS** shall be punched and paint stenciled with DU code (14 digit work order du detail) as given by purchase in addition to marking done as per para 7.3.1.

7.4 **PACKING AND END PROTECTION :** Machined ends of the fittings shall be well protected using end caps and fittings shall be suitably packed in box / crate to avoid transit & other damages.

8.0 INSPECTION & CERTIFICATION : -

All fittings are to be Inspected at the manufacturer's works by the Inspection agencies / authorities as per IBR and as indicated in the P.O. Inspection certificate in IBR Form III C shall be submitted along with the Work Test Certificate countersigned by the above authorities and shall include the following.

1. Test Certificate Number & date.
2. BHEL P.O Number & Amendment Number
3. BHEL P.O. Serial Number
4. BHEL TDC Number
5. Size-wise Quantity
6. Specification, Grade & Year of code.
7. Heat/Melt Number
8. Starting material details.
9. Steel making process
10. Ladle Analysis of Raw Material and product analysis of fitting.
- *11. Positive Material Identification (PMI) report for Alloy steel fittings.
- *12. Supplementary Test(Product analysis, Tension test..) results.
- *13. Heat Treatment Chart.
- *14. NDE report. (VISUAL.MPI, LPI,UT)
- *15. Tensile Test Report
- *16. Hardness Test Report

S. Jayakumar, Engg

P. Elangovan, QA

Approved by

K. Vedaprasad, QC

K. Ganeshan, MPL



- 17. Metallography Report along with photomicrograph with 500x (min) magnification.
- *18. Dimensional conformance.
- *19. RT test report / Results (for welded fittings)
- *20. Guarantee of HTP shall be given as follows:- "Fittings are capable of withstanding without failure, leakage or impairment of their serviceability a hydrostatic test pressure equal to that prescribed for the specified matching pipe of equivalent material".

*Details furnished in the Tests certificate in lieu of chart/report is acceptable.

9.0 RECORDS OF REVISION :-

Rev 01 : a) Fully revised for better clarity.

: b) Para 2.0 e added.

Rev 02 : a) Para 2.0 (c): UT acceptance norms revised from level A to B.

Rev 03 : a) Fully revised for better clarity.

: b) Para 4.2, 6.0, 8.0 (11) added.

c) Para 2 (d) , 4.1, 5 (d) are revised.

Rev 04 : a) Para 5.0 (g), 7.0 and 8.0 (17) are revised.

S. Jayakumar, Engg

P. Elangovan, QA

Approved by

K. Vedaprasad, QC

K. Ganeshan, MPL