

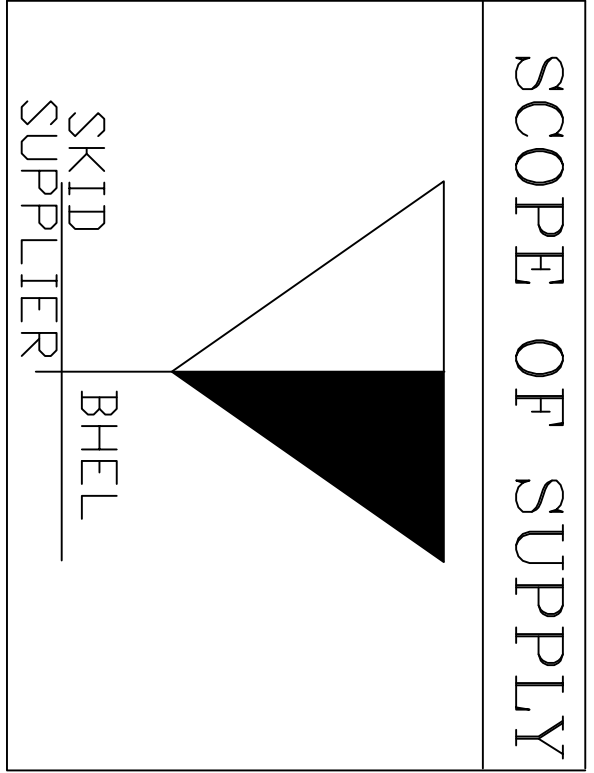




- NOTE:
- 1.SCOPE SHALL BE AS MARKED.
 - 2.ALL INSTRUMENTS, PIPING, FITTING SHALL BE PROVIDED.
 - 3.ALL INSTRUMENTS SHALL BE FOR LOCAL DISPLAY.
 - 4.MOC OF TANK, FILTER AND INTERCONNECTING PIPE SHALL BE CS.
 5. ANY ACCESSORIES REQUIRED OTHER THAN THE P&ID REQUIRED FOR EFFICIENT OPERATION SHALL BE CLEARLY SPELT.
 - 6.TEMPERATURE GAUGE SHALL BE TOP MOUNTED. IF POSSIBLE LEVEL GAUGE SHALL BE TOP MOUNTED.
 7. ANY PROVISION REQUIRED FOR PRIMING OF PUMP SHALL BE PROVIDED. IF CHECK VALVE IS REQUIRED IN DISCAHRGE OF PUMP SAME SHALL BE CONSIDERED.
 8. PIPE SIZING SHALL BE SUITABLE TO MEET THE REQUIRED PARAMETER
 - 9.OPERATING PRESSURE 6 kg/cm2(g), OPERATING TEMP. 50 DEG C.
 - 10.DESIGN PRESSURE 9 kg/cm2(g), OPERATING TEMP. 80 DEG C.

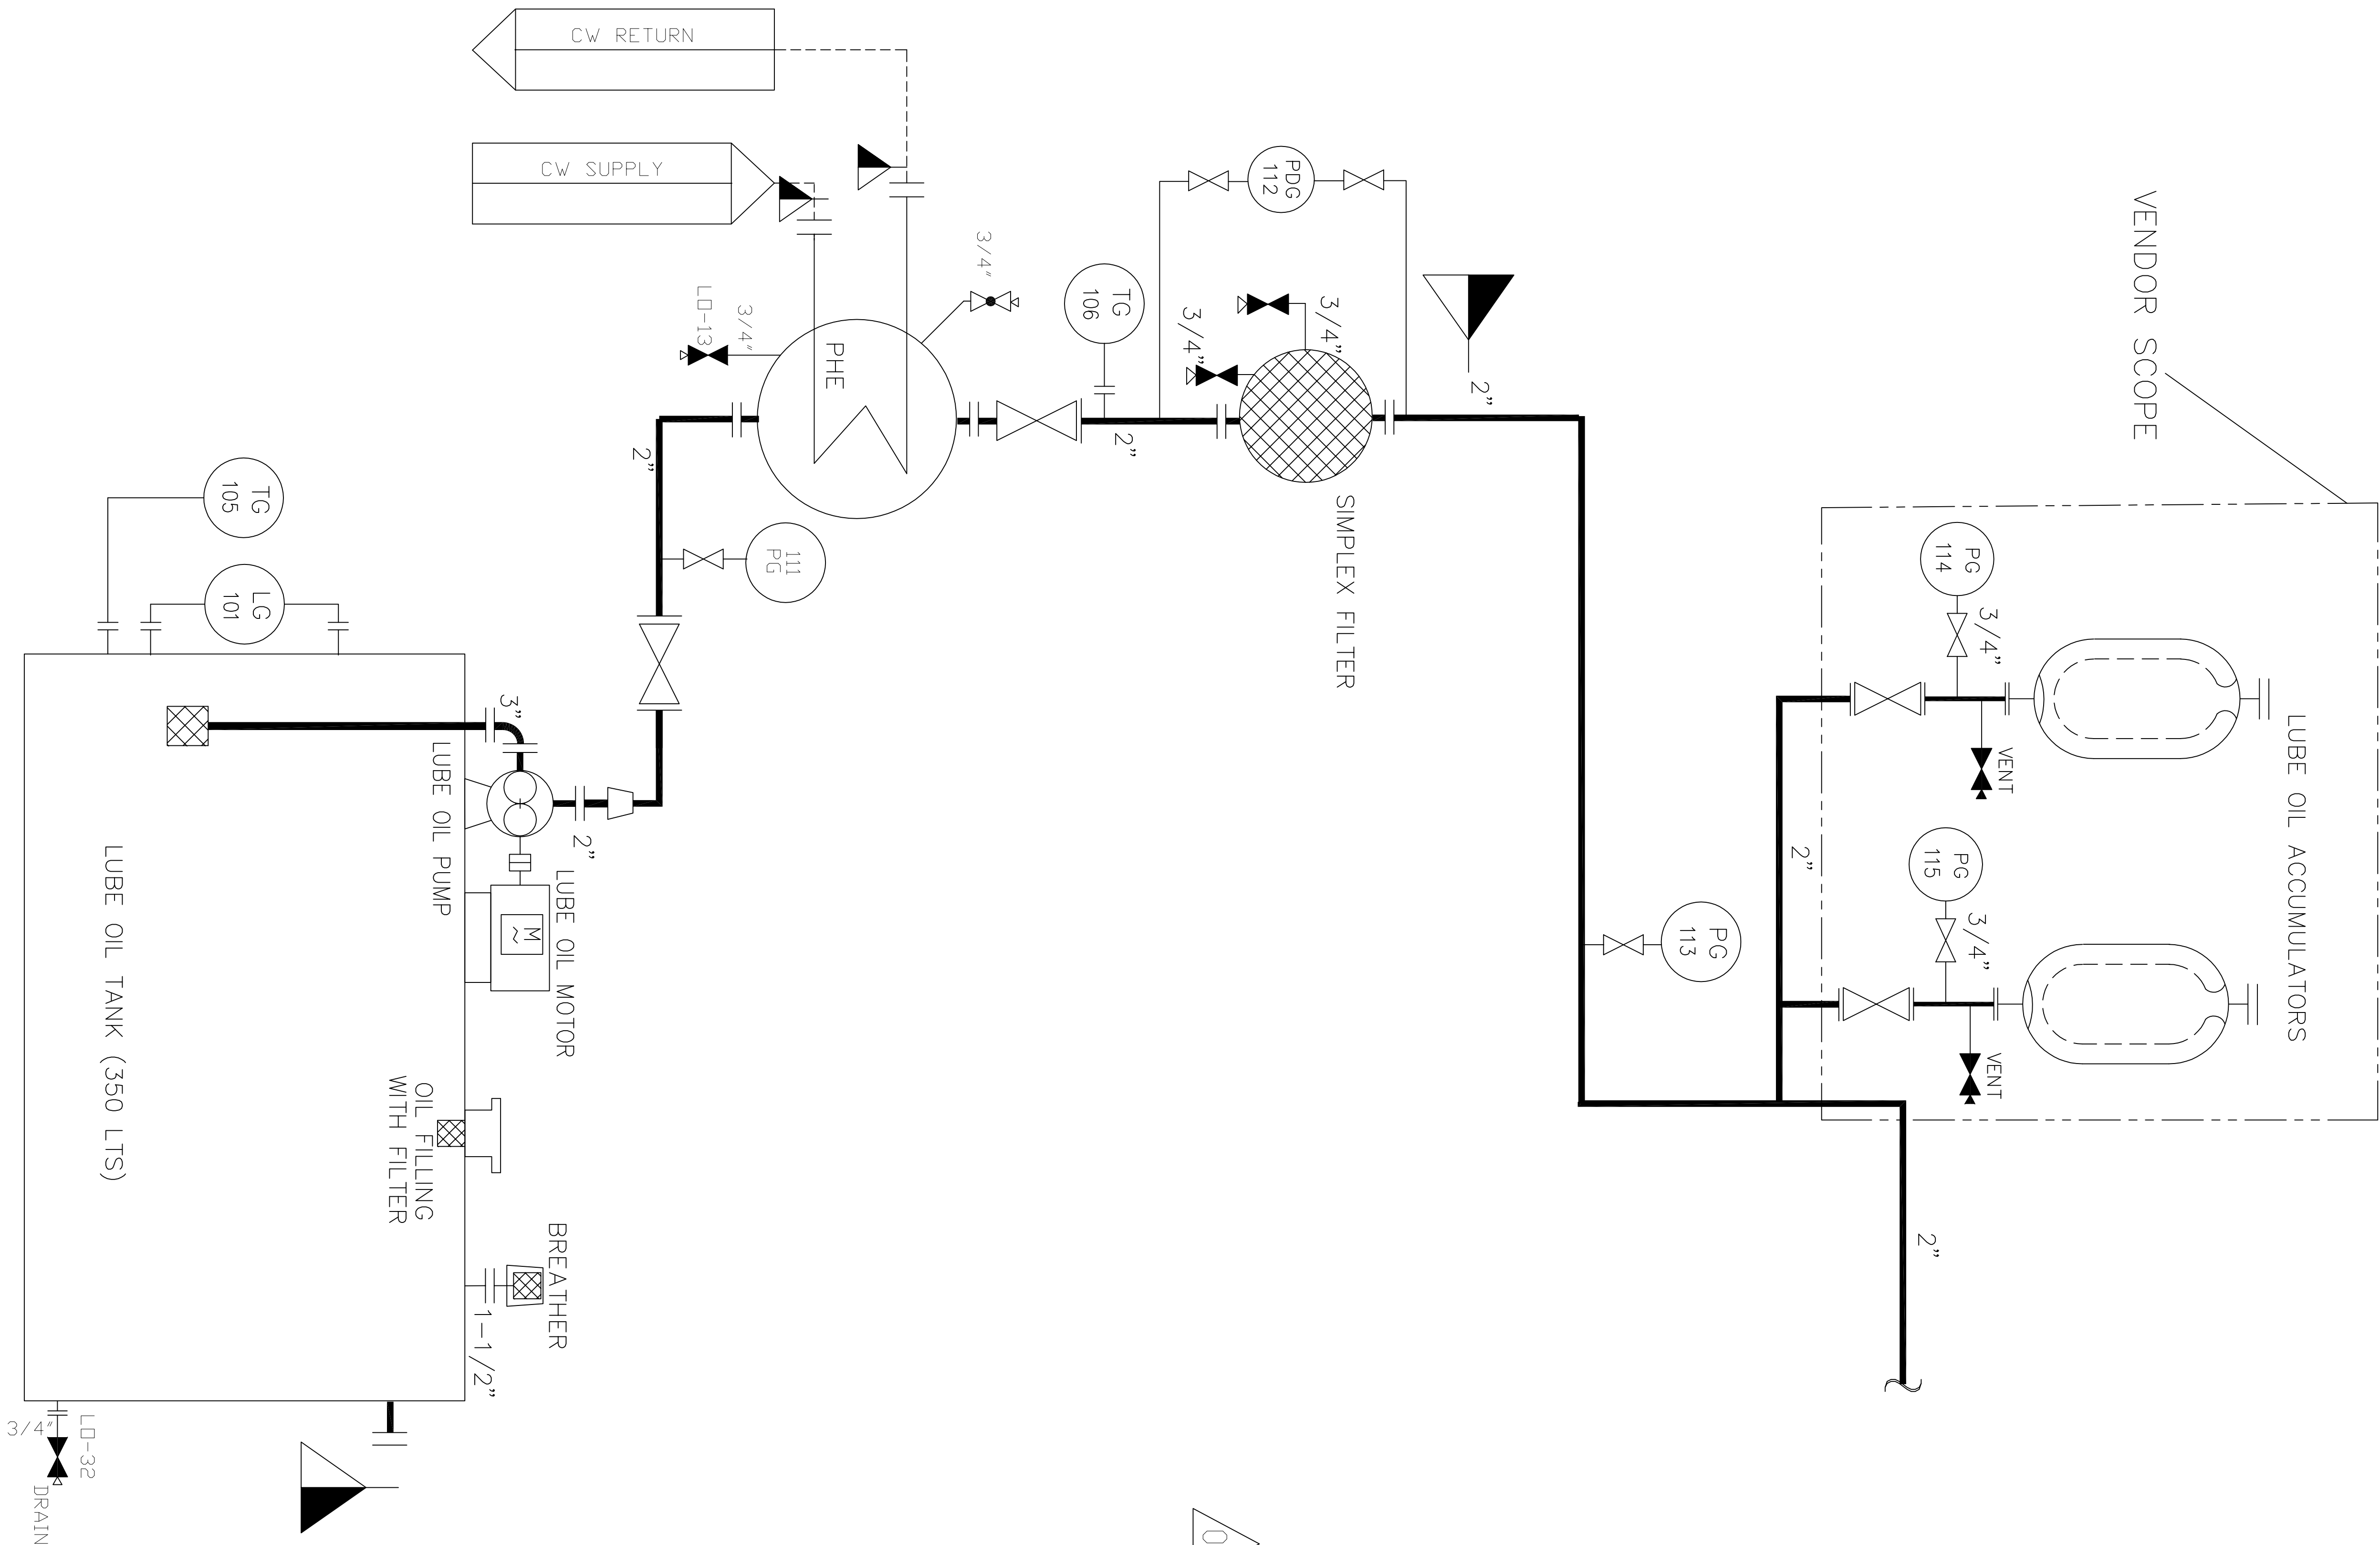

EQUIPMENT SIZES

EQUIPMENT	SIZES
TANK	1600*900*520 (MM)
ACCUMULATOR	2X55 Litres
SIMPLEX FILTER	200 LPM
COOLER	AS PER ANNEX 7
LUBE OIL PUMP	135 LPM @ 5.5 Kg/cm2(g)