




MAHAGENCO BHUSAWAL

S6	4"–150# SORF	DRAIN CONNECTION
S5	2"–150# SORF	SIMPLEX FILTER 
S4	3/4" NPT	DRAIN CONNECTION
S3	1 1/2"–300# SORF	AIR BREATHER
S2	1" NPT	FOR TG
S1	3/4" NPT	LEVEL GAUGE (2 Nos)

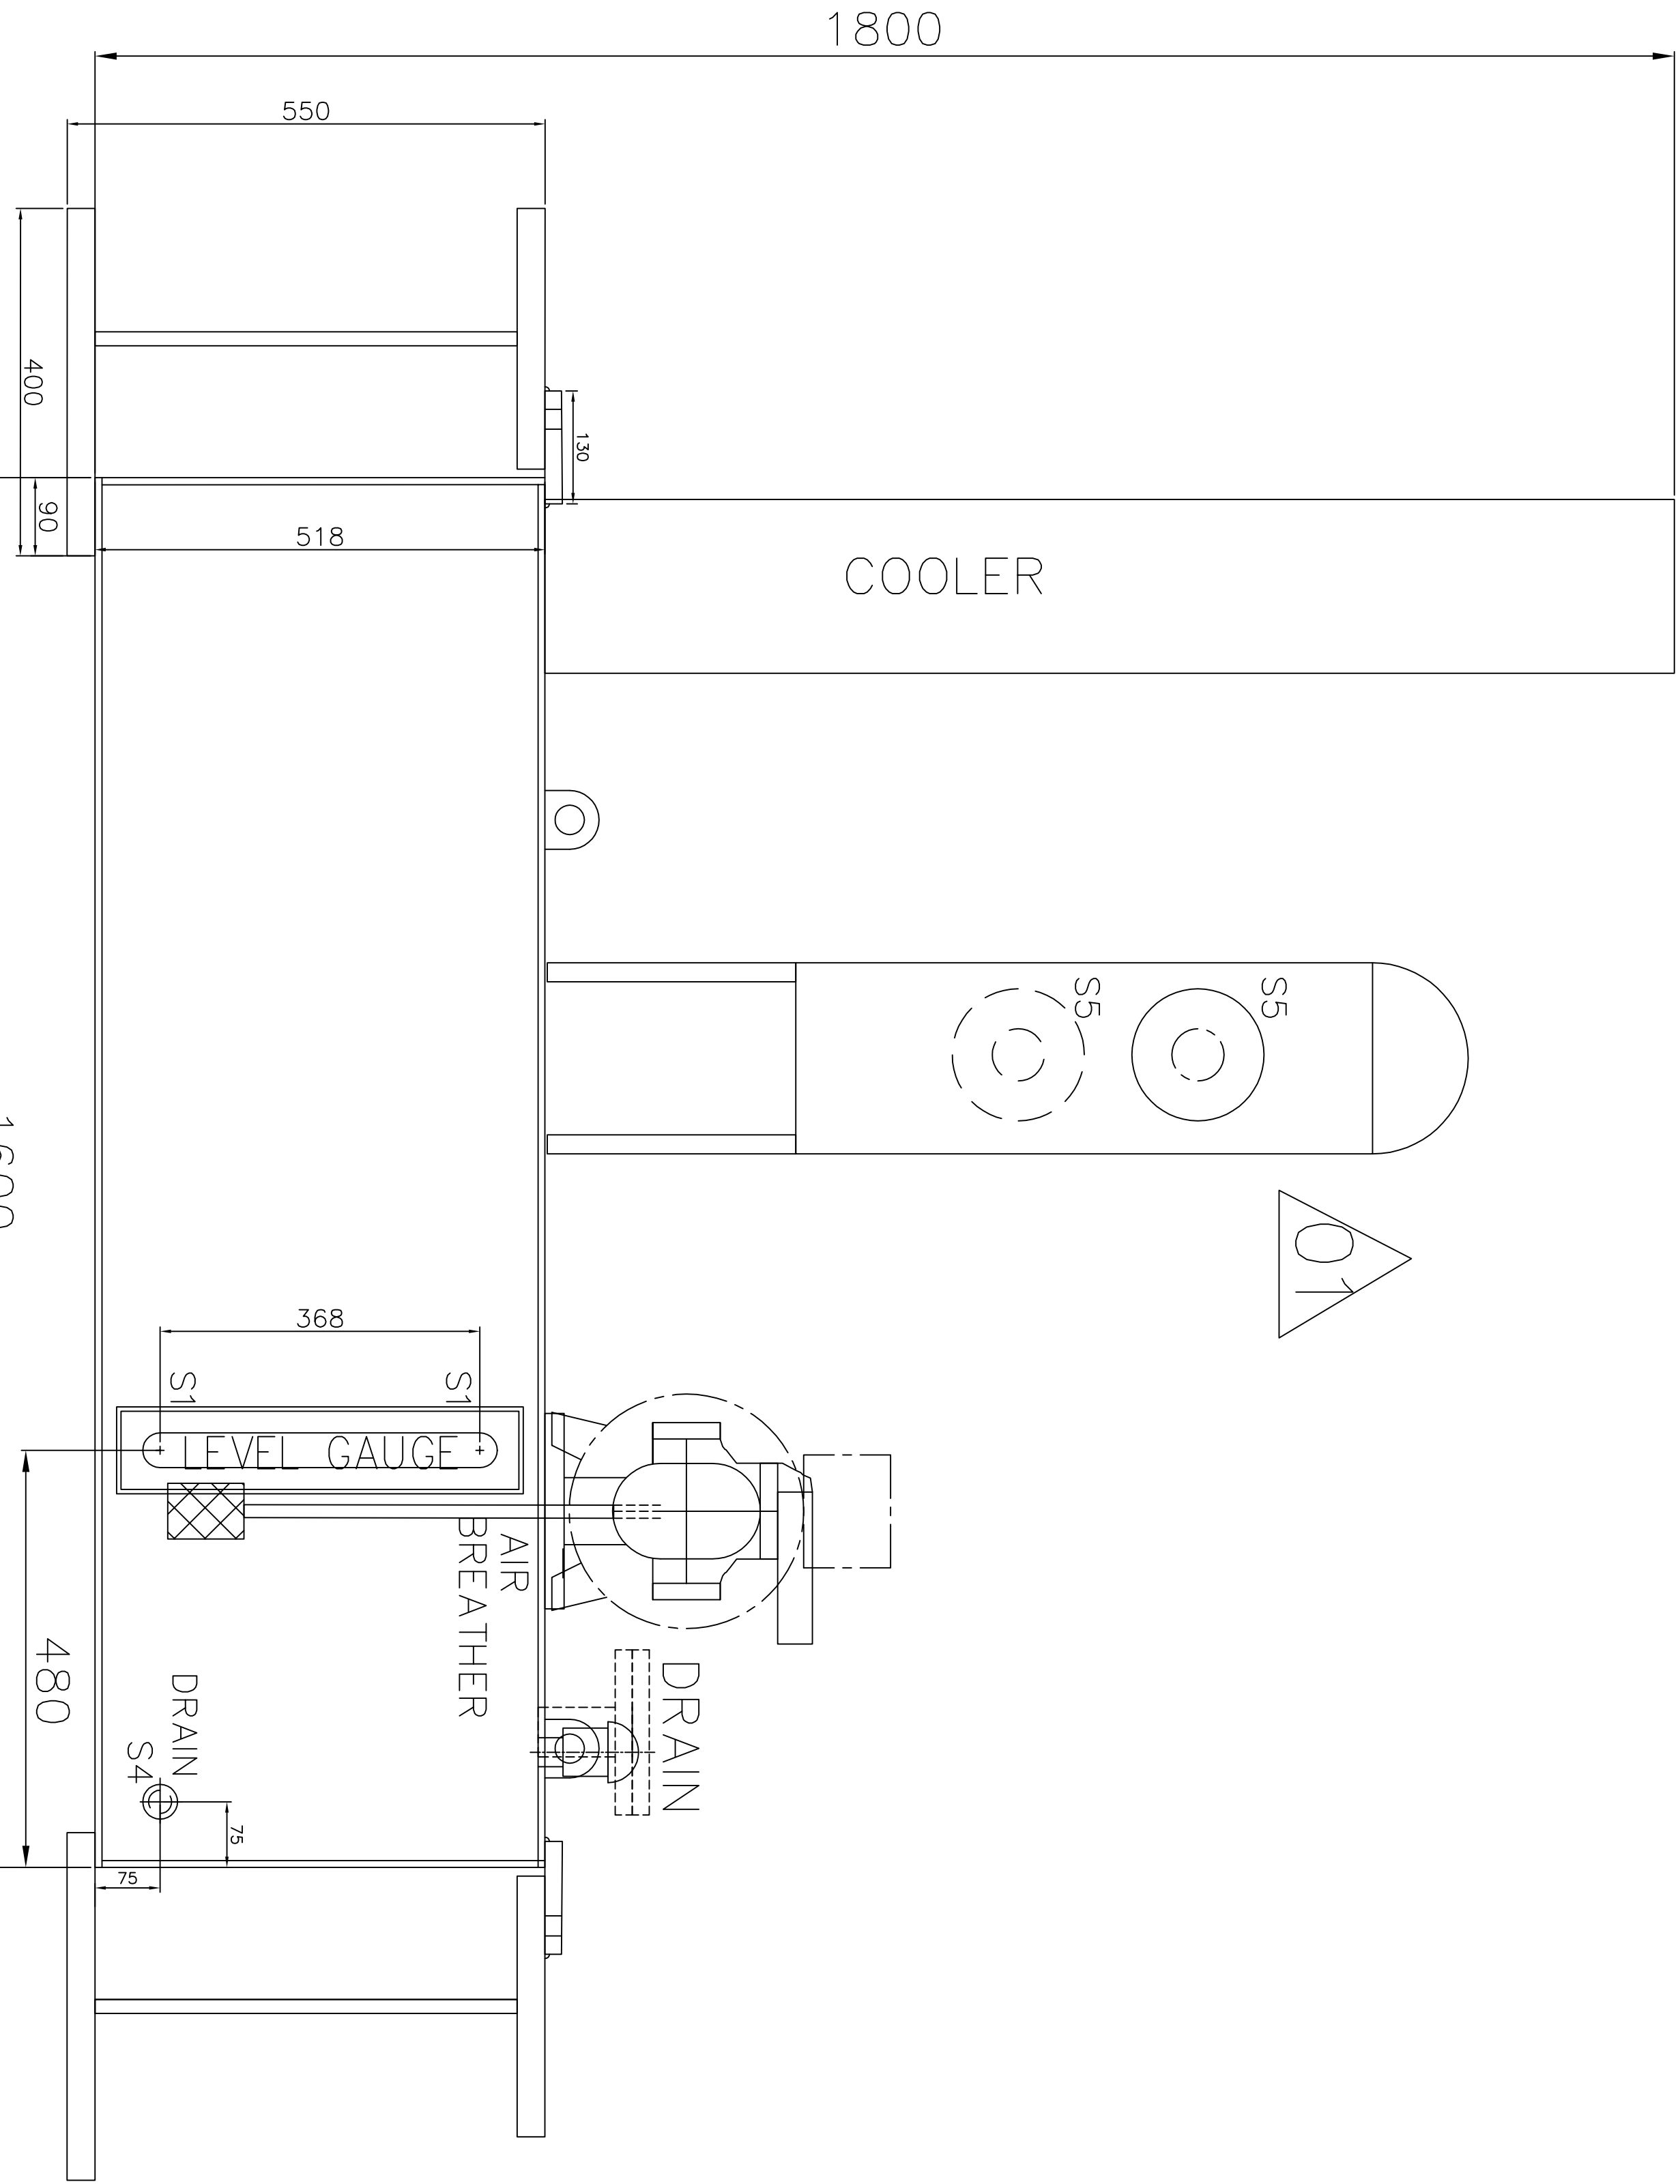

- NOTE:
- The diemnsion of tank will be 1600x900x520 (in mm)
Equipment mounted are pump–motor assly, Simplex filter and cooler.
Accumulator location is tentative. It shall be decided based on the proximity to supply header and space availability.
Accumulator fixing shall be as per the supplier drawing.
 - Vendor will terminate till simplex filter discharge nozzle with blind flange.
 - Drain connection S4 will terminate with Gate Valve–NPT.

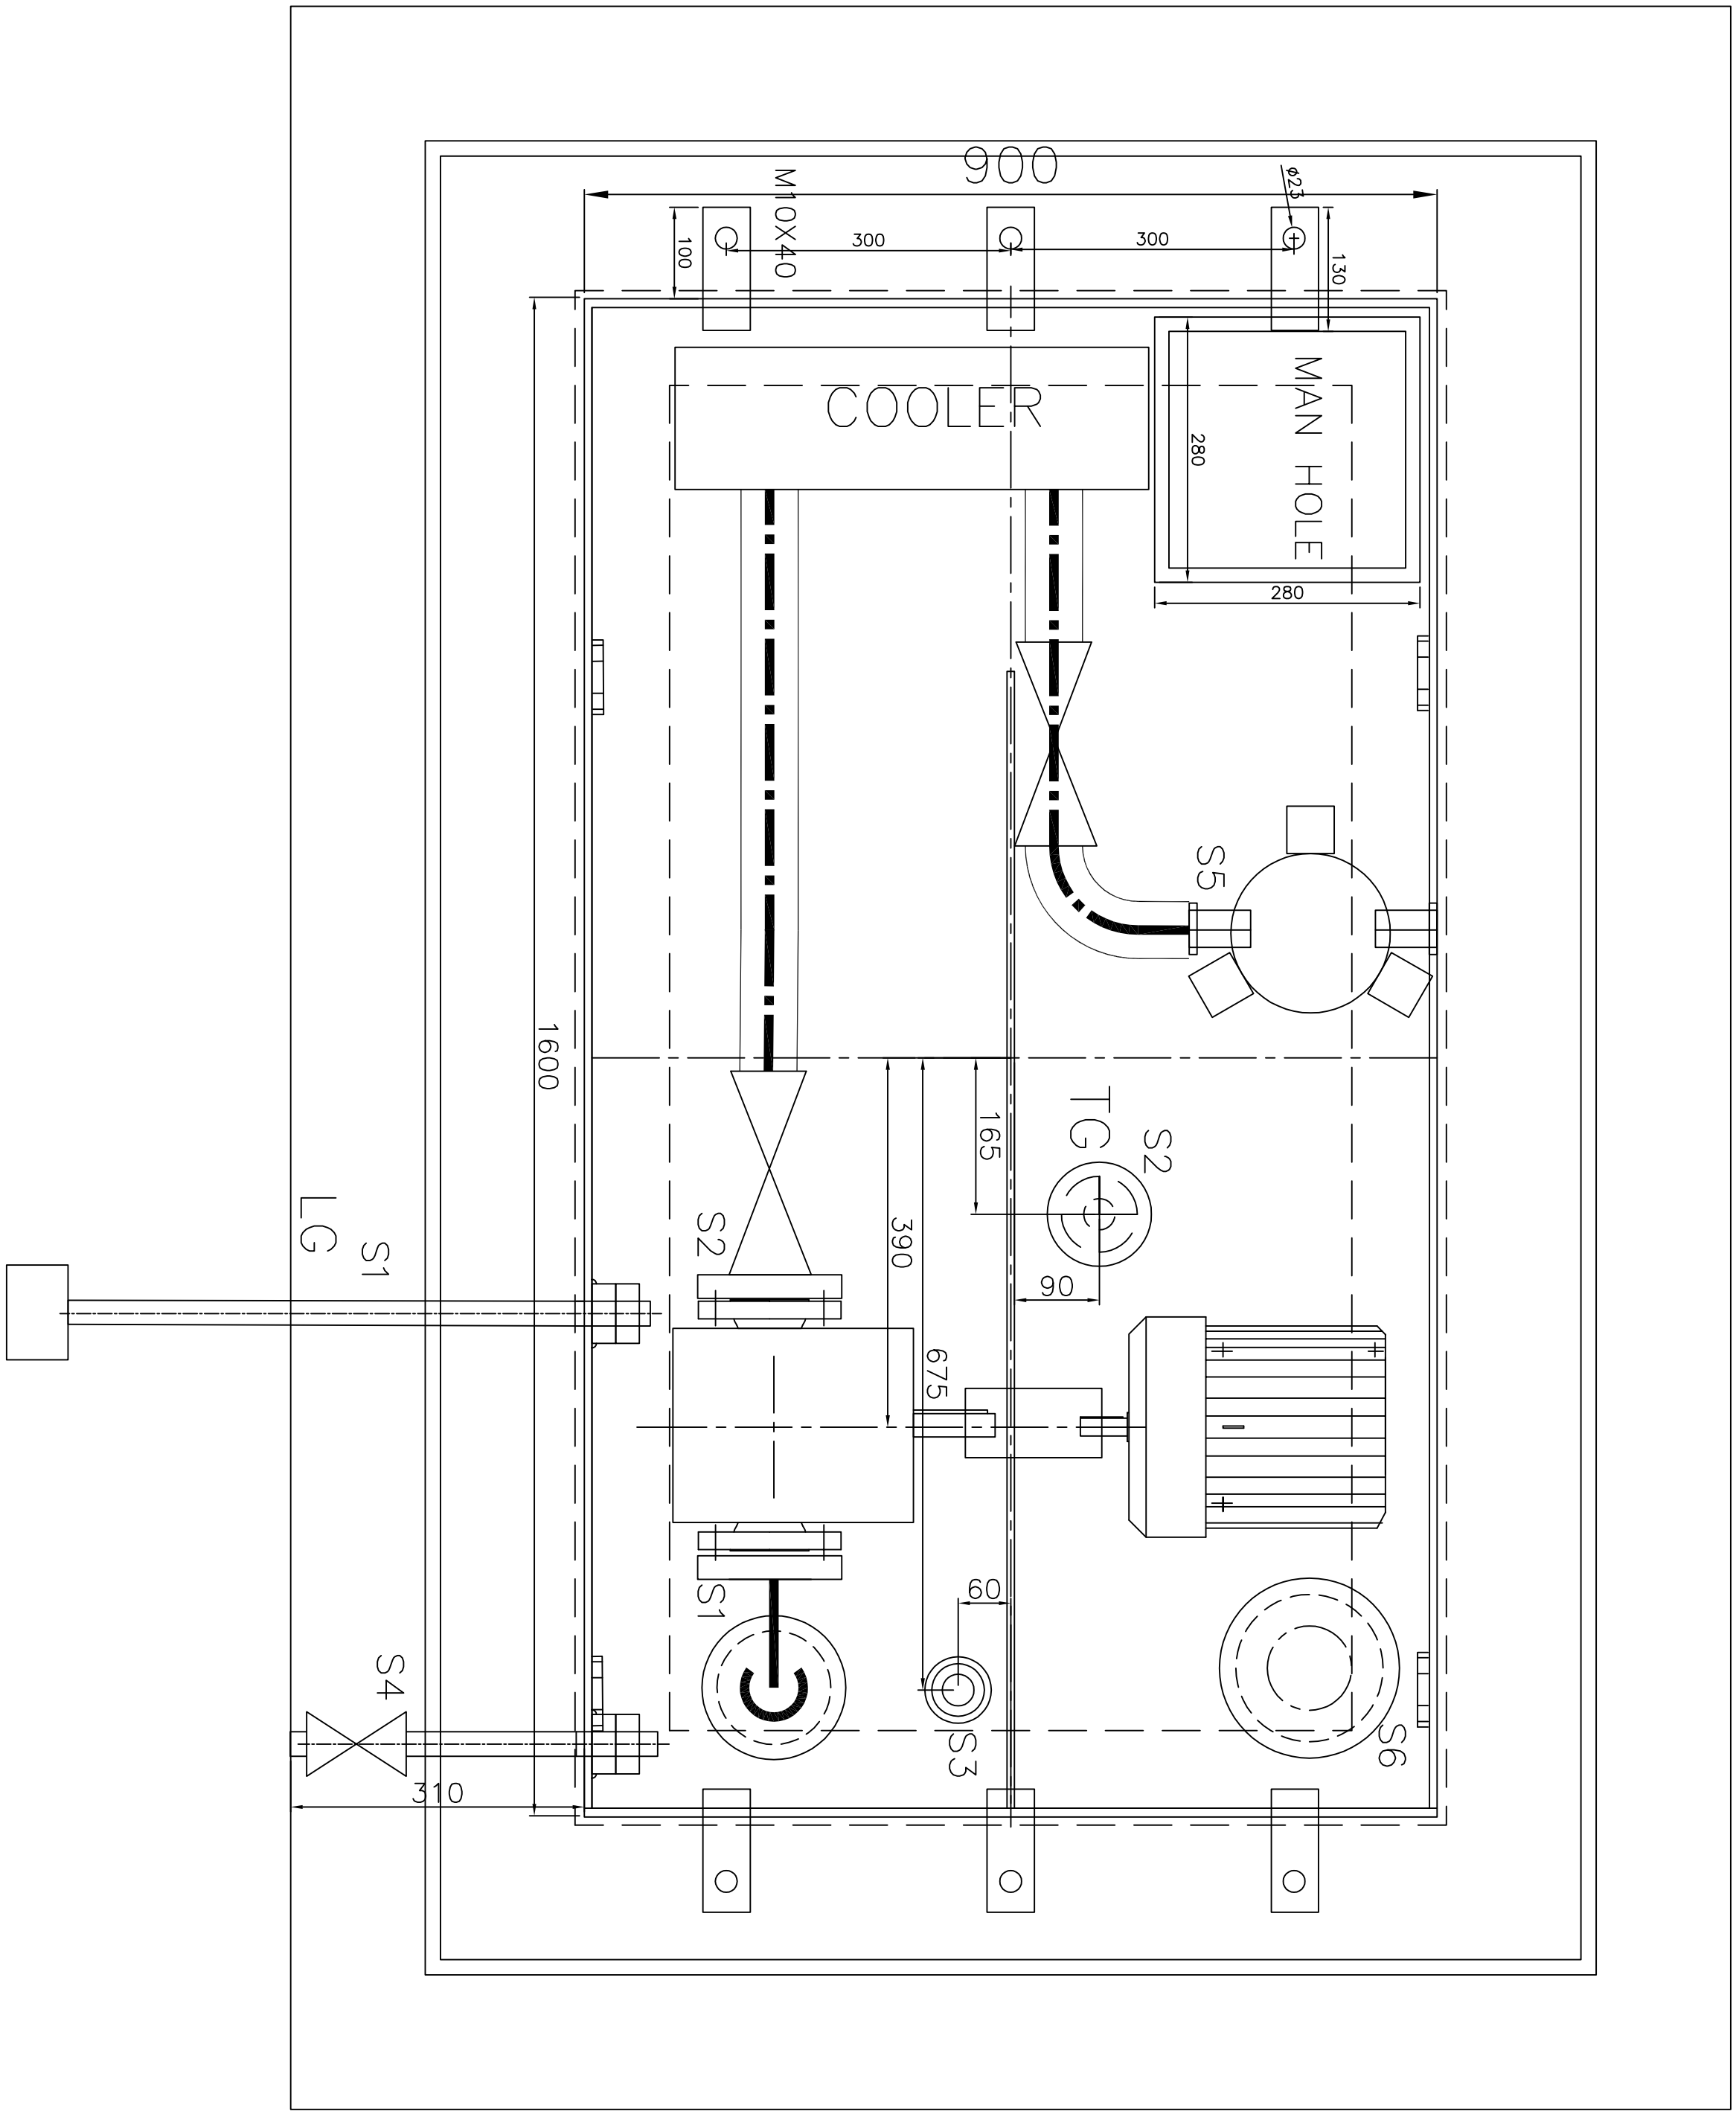

STATUS: FINAL