

Bid Document

Bid Details	
Bid End Date/Time	04-04-2022 16:00:00
Bid Opening Date/Time	04-04-2022 16:30:00
Bid Life Cycle (From Publish Date)	90 (Days)
Bid Offer Validity (From End Date)	75 (Days)
Ministry/State Name	Ministry Of Heavy Industries And Public Enterprises
Department Name	Department Of Heavy Industry
Organisation Name	Bharat Heavy Electricals Limited (bhel)
Office Name	10250020-pem, Noida
Total Quantity	31000
Item Category	1.1 kV Copper conductor PVC insulated Innersheath PVC type ST1 Outersheath PVC Type ST1 with FRLS property Unarmoured Control cable , 1.1 kV Copper conductor PVC insulated Innersheath PVC type ST1 Outersheath PVC Type ST1 with FRLS property Unarmoured Control cables
BOQ Title	LT PVC CONTROL CABLE
Years of Past Experience required	1 Year (s)
MSE Exemption for Years of Experience and Turnover	No
Startup Exemption for Years of Experience and Turnover	No
Document required from seller	Experience Criteria,Past Performance,Certificate (Requested in ATC),Additional Doc 1 (Requested in ATC),Additional Doc 2 (Requested in ATC),Additional Doc 3 (Requested in ATC),Additional Doc 4 (Requested in ATC),Compliance of BoQ specification and supporting document *In case any bidder is seeking exemption from Experience / Turnover Criteria, the supporting documents to prove his eligibility for exemption must be uploaded for evaluation by the buyer
Past Performance	10 %
Bid to RA enabled	Yes
RA Qualification Rule	50% Lowest Priced Technically Qualified Bidders
Primary product category	1.1 kV Copper conductor PVC insulated Innersheath PVC type ST1 Outersheath PVC Type ST1 with FRLS property Unarmoured Control cables
Time allowed for Technical Clarifications during technical evaluation	7 Days

Bid Details

Payment Timelines	Payments shall be made to the Seller within 90 days of issue of consignee receipt-cum-acceptance certificate (CRAC) and on-line submission of bills (This is in supersession of 10 days time as provided in clause 12 of GeM GTC)
Evaluation Method	Total value wise evaluation

EMD Detail

Required	No
----------	----

ePBG Detail

Advisory Bank	State Bank of India
ePBG Percentage(%)	3.00
Duration of ePBG required (Months).	27

(a). EMD & Performance security should be in favour of Beneficiary, wherever it is applicable.

Beneficiary:

MANAGER

10250020-PEM, Noida, Department of Heavy Industry, Bharat Heavy Electricals Limited (BHEL), Ministry of Heavy Industries and Public Enterprises
(Manish Kumar Sinha)

Splitting

Bid splitting not applied.

Reserved for Make In India products

Reserved for Make In India products	Yes
-------------------------------------	-----

MSE Purchase Preference

MSE Purchase Preference	Yes
-------------------------	-----

1. Experience Criteria: In respect of the filter applied for experience criteria, the Bidder or its OEM {themselves or through reseller(s)} should have regularly, manufactured and supplied same or similar Category Products to any Central / State Govt Organization / PSU / Public Listed Company for number of Financial years as indicated above in the bid document before the bid opening date. Copies of relevant contracts to be submitted along with bid in support of having supplied some quantity during each of the Financial year. In case of bunch bids, the category of primary product having highest value should meet this criterion.

2. Bid reserved for Make In India products: : Procurement under this bid is reserved for purchase from Class 1 local supplier as defined in public procurement (Preference to Make in India), Order 2017 as amended from time to time and its subsequent Orders/Notifications issued by concerned Nodal Ministry for specific Goods/Products. However, eligible micro and small enterprises will be allowed to participate. The minimum local content to qualify as a class 1 local supplier is denoted in the bid document. All bidders must upload a certificate from the OEM regarding the percentage of the local content and the details of locations at which the local value addition is

made along with their bid, failing which the bid is liable to be rejected. In case the bid value is more than Rs 10 Crore, the declaration relating to percentage of local content shall be certified by the statutory auditor or cost auditor, if the OEM is a company and by a practicing cost accountant or a chartered accountant for OEMs other than companies as per the Public Procurement (preference to Make-in -India) order 2017 dated 04.06.2020 . In case Buyer has selected Purchase preference to Micro and Small Enterprises clause in the bid, the same will get precedence over this clause.

3. Purchase preference to Micro and Small Enterprises (MSEs): Purchase preference will be given to MSEs as defined in Public Procurement Policy for Micro and Small Enterprises (MSEs) Order, 2012 dated 23.03.2012 issued by Ministry of Micro, Small and Medium Enterprises and its subsequent Orders/Notifications issued by concerned Ministry. If the bidder wants to avail the Purchase preference, the bidder must be the manufacturer of the offered product in case of bid for supply of goods. Traders are excluded from the purview of Public Procurement Policy for Micro and Small Enterprises. In respect of bid for Services, the bidder must be the Service provider of the offered Service. Relevant documentary evidence in this regard shall be uploaded along with the bid in respect of the offered product or service. If L-1 is not an MSE and MSE Seller (s) has/have quoted price within L-1+ 15% (Selected by Buyer) of margin of purchase preference /price band defined in relevant policy, such Seller shall be given opportunity to match L-1 price and contract will be awarded for 100%(selected by Buyer) percentage of total QUANTITY.

4. Estimated Bid Value indicated above is being declared solely for the purpose of guidance on EMD amount and for determining the Eligibility Criteria related to Turn Over, Past Performance and Project / Past Experience etc. This has no relevance or bearing on the price to be quoted by the bidders and is also not going to have any impact on bid participation. Also this is not going to be used as a criteria in determining reasonableness of quoted prices which would be determined by the buyer based on its own assessment of reasonableness and based on competitive prices received in Bid / RA process.

5. Past Performance: The Bidder or its OEM {themselves or through re-seller(s)} should have supplied same or similar Category Products for 10% of bid quantity, in at least one of the last three Financial years before the bid opening date to any Central / State Govt Organization / PSU / Public Listed Company. Copies of relevant contracts (proving supply of cumulative order quantity in any one financial year) to be submitted along with bid in support of quantity supplied in the relevant Financial year. In case of bunch bids, the category related to primary product having highest bid value should meet this criterion.

6. Reverse Auction would be conducted amongst first 50% of the technically qualified bidders arranged in the order of prices from lowest to highest. Number of sellers eligible for participating in RA would be rounded off to next higher integer value if number of technically qualified bidders is odd (e.g. if 7 bids are technically qualified, then RA will be conducted amongst L-1 to L-4). In case number of technically qualified bidders are 2 or 3, RA will be between all without any elimination. If Buyer has chosen to split the bid amongst N sellers, then minimum N sellers would be taken to RA round. In case Primary products of only one OEM are left in contention for participation in RA based on lowest 50% bidders qualifying for RA, the number of sellers qualifying for RA would be increased to get at least products of one more OEM (directly participated or through its reseller) if available. Further, if bid(s) of any seller(s) eligible for MSE preference is / are coming within price band of 15% of Non MSE L-1 or if bid of any seller(s) eligible for Make in India preference is / are coming within price band of 20% of non MII L-1, then such MSE / Make in India seller shall also be allowed to participate in the RA process.

1.1 KV Copper Conductor PVC Insulated Innersheath PVC Type ST1 Outersheath PVC Type ST1 With FRLS Property Unarmoured Control Cable (25000 pieces)

(Minimum 50% Local content required for qualifying as Class 1 Local Supplier)

Brand Type	Unbranded
------------	-----------

Technical Specifications

Specification Document	View File
BOQ Detail Document	View File

Advisory-Please refer attached BOQ document for detailed consignee list and delivery period.

Consignees/Reporting Officer and Quantity

S.No.	Consignee/Reporting Officer	Address	Quantity	Delivery Days
1	Mridul Kumar Taisum	825321,BHEL SITE OFFICE, Construction Manager, BHEL 3X660 MW NORTH KARANPURA STPP (NTPC), BHEL site office, Tandwa, Dist. - Chatra, Jharkhand, Pin - 825321	25000	180

1.1 KV Copper Conductor PVC Insulated Innersheath PVC Type ST1 Outersheath PVC Type ST1 With FRLS Property Unarmoured Control Cables (6000 pieces)

(Minimum 50% Local content required for qualifying as Class 1 Local Supplier)

Brand Type	Unbranded
------------	-----------

Technical Specifications

Specification Document	View File
BOQ Detail Document	View File

Advisory-Please refer attached BOQ document for detailed consignee list and delivery period.

Consignees/Reporting Officer and Quantity

S.No.	Consignee/Reporting Officer	Address	Quantity	Delivery Days
1	Mridul Kumar Taisum	825321,BHEL SITE OFFICE, Construction Manager, BHEL 3X660 MW NORTH KARANPURA STPP (NTPC), BHEL site office, Tandwa, Dist. - Chatra, Jharkhand, Pin - 825321	6000	180

Buyer Added Bid Specific Terms and Conditions

1. **Scope of Supply**

Scope of supply (Bid price to include all cost components) : Only supply of Goods

2. **Inspection**

Nominated Inspection Agency: On behalf of the Buyer organization, any one of the following Inspection Agency would be conducting inspection of stores before acceptance:
Pre-dispatch Inspection at Seller Premises (applicable only if pre-dispatch inspection clause has been selected in ATC): At Vendor's works by BHEL/TPIA
Post Receipt Inspection at consignee site before acceptance of stores: NA

3. **Certificates**

Bidder's offer is liable to be rejected if they don't upload any of the certificates / documents sought in the Bid document, ATC and Corrigendum if any.

4. **Generic**

Bidders are advised to check applicable GST on their own before quoting. Buyer will not take any responsibility in this regards. GST reimbursement will be as per actuals or as per applicable rates (whichever is lower), subject to the maximum of quoted GST %.

5. **Generic**

OPTION CLAUSE: The Purchaser reserves the right to increase or decrease the quantity to be ordered up to 25 percent of bid quantity at the time of placement of contract. The purchaser also reserves the right to increase the ordered quantity by up to 25% of the contracted quantity during the currency of the contract at the contracted rates. Bidders are bound to accept the orders accordingly.

6. **Certificates**

The bidder is required to upload, along with the bid, all relevant certificates such as BIS licence, type test certificate, approval certificates and other certificates as prescribed in the Product Specification given in the bid document.

7. **Generic**

While generating invoice in GeM portal, the seller must upload scanned copy of GST invoice and the screenshot of GST portal confirming payment of GST.

8. **Buyer Added Bid Specific ATC**

Buyer uploaded ATC document [Click here to view the file.](#)

9. **Buyer Added Bid Specific ATC**

Buyer Added text based ATC clauses

1. **Only Class-1 Local suppliers are eligible to bid for subject GeM tender / bid. Minimum Local Content required for qualifying a bidder as "Class 1 Local Supplier" is 50%.**

2. Performance Security amount i.e. CPBG @ 3% of the value of Contract shall be applicable.

Initial e-PBG validity: Initial ePBG validity shall be 27 months from PO date for Main supply (Considering 3 months in getting drawing/ Documents approval from customer/BHEL + delivery period of 4 months + 18 months guarantee period + 2 months claim period is already mentioned in GTC cl no. 7. ii GeM 3.0 Version 1.21). However, BG will be released only after completion of all contractual liability or guarantee period whichever is later.

3. **Payment Terms:** Payments shall be made to the Seller within following no. of days of issue of consignee receipt-cum-acceptance certificate (CRAC) and on-line submission of bills (This is in supersession of 10 days' time as provided in Cl. No. 12 of GeM GTC): -

- i) 45 days for seller qualified and registered as Micro or Small Enterprises as per MSMED Act
- ii) 60 days for seller qualified and registered as Medium Enterprises as per MSMED Act
- iii) 90 days for Non-MSME

Supplier has to provide Original Tax invoice, Packing List, LR/RR, CRAC, Insurance intimation Guarantee Certificate, E-way bill (as applicable) for payment. Provision of offline payment in GeM shall be utilized.

4. **Terms of Delivery:** As per Cl. No. 13 of GTC on GeM (i.e. Free Delivery at site basis including loading). However, Transit insurance shall be in the scope of Seller and unloading of items at delivery point shall be in the scope of BHEL. Bidder to quote prices accordingly.
5. **Delivery Period:** Delivery period for sake of GeM bid shall be chosen as 999 days from PO date. This is Indicative only. However, this period shall not be considered for Delivery and Delay analysis purpose.
For Delivery and delay analysis (LD) purpose, Delivery Schedule shall be within Four (04) months from the date of CAT-1 approval of Primary drawing / documents or BHEL manufacturing clearance whichever is later, subjected to drawing / document submission / re-submission schedule as stipulated. In case of any delay in submission / re-submission of "PRIMARY" drawings/ documents, the same shall be reduced from the given delivery period. Delay in BHEL's comments/ approval beyond 15 days shall also be considered for delay analysis.

TYPE TEST CERTIFICATES - Within 1 week after conduction of type test.

List of applicable drawing shall be as under:

Sl. No.	Drawings/Document Description	Primary/Secondary	Drawings / Document Number
1	Technical Data sheet - LT PVC Control cables	Primary	PE-V0-405-507-E131
2	Cross-sectional Drgs.- LT PVC Control Cables	Primary	PE-V0-405-507-E133
3	Quality Plan - LT PVC Control Cables	Primary	PE-V0-405-507-E915*
4	Steel drum drawing - LT PVC Control Cables (if applicable)	Secondary	PE-V0-405-507-E135
5	Type Test Reports - LT PVC Control Cables	Secondary	PE-V0-405-507-E134

Further, followings also to be noted : -
a) The end period specified in for

- completion of the deliveries. Deliveries to start progressively so as to meet the completion schedule.
- b) The delivery conditions specified are for contractual LD purposes, however, BHEL may ask for early deliveries without any compensation thereof.
- c) Non-applicable drawings shall be decided during bid evaluation.
- d) Wherever schedule of drawings / documents submission / re-submission is stipulated in the Technical Specifications, same shall be superseded by delivery specified in NIT.
- e) Vendor to start manufacturing activities only after obtaining specific manufacturing clearance from BHEL Purchase group.
- f) In case BHEL manufacturing clearance date is later than the date of Cat-1 approval of Primary drawing/documents, then the contractual delivery period will be calculated by setting off the time gap between Cat-1 approval date of Primary drawing/documents and the manufacturing clearance date from any delay by vendor in submission/re-submission of Primary drawing/documents.

6. **Liquidated Damage:** Following LD clause shall be applicable -

Purchaser reserves the right to recover from the Seller / Contractor, as agreed liquidated damages and not by way of penalty, a sum equivalent to half (½) percent and applicable GST thereon, of the total supply contract price excluding GST per week or part thereof, subject to a maximum of ten (10) percent of the total main supply contract price excluding GST, if the Seller/ Contractor fails to deliver

any part of the ordered goods/stores within the period stipulated in the Order/ Contract.

NOTES:

- i. LR/RR date for indigenous supplies (Bill of Lading/AWB for Foreign supplies) shall be treated as the date of dispatch for levying LD. However, if receipted LR date for indigenous supply is beyond 30 days for FTL / 45 days for PTL from the date of LR (PTL to be clearly mentioned in LR), such excess period shall be considered for LD purpose irrespective of dispatch date. Import General Manifest (IGM)/Bill of entry date (whichever is earlier), for foreign supplies, is beyond 90 days from the date of Bill of Lading/AWB, such excess period shall be considered for LD purpose irrespective of dispatch date.
- ii. In case of any amendment/ revision, LD shall be linked to the amended/ revised contract value and delivery date(s).
- iii. If Order/ Contract involves two or more Units/ Sets/ Lots/ Stages, then Liquidated Damages shall be levied on order/ contract value excluding GST of the delayed Unit/ Set/ Lot/ Stage, provided delivery stipulated in the Order/ Contract is Unit/ Set/ Lot/Stage wise, however total LD amount shall be limited to 10% of total order/ amended order value excluding GST of delayed Unit/ Set/ Lot/Stage. Any subsequent lot released (not envisaged in original contract) due to increase in quantity within permissible quantity variation shall be treated as separate lot for the purpose of LD.
- iv. The sum specified above is not a penalty but a genuine pre-estimate of the loss/ damage which will be suffered by purchaser on account of delay on the part of the Contractor/Seller and the said amount will be deductible without proof of actual loss or damage caused by such delay.

7. **Guarantee Terms:** As per Cl. No. 10 of GTC on GeM for the bid. However, Guarantee & Warranty time period shall be 18 months from the date of last supply in the contract.

8. **PVC shall be applicable as per enclosed PVC formula.** PVC shall be payable within agreed contractual delivery period. In case of delay attributable to vendor, for the payment purpose, the PVC shall be calculated based on rates applicable as on the date of expiry of contractual delivery date or actual delivery date whichever is beneficial to BHEL.

9. **Quantity Variation:** The Purchaser reserves the right to increase or decrease the quantity to be ordered up to 25% of bid quantity at the time of placement of contract. The purchaser also reserves the right to increase the ordered quantity by up to 25% of the contracted quantity during the currency of the contract at the contracted rates. Bidders are bound to accept the orders accordingly.

10. **Any other special major condition:**

- (i) Bidders to provide detailed break-up of quoted prices in Ex-works, freight & Tax components.
- (ii) Bidders to submit applicable Freight % & GST % included in their prices during tender clarification stage.
- (iii) Packing Instructions and other parameters, if any, shall be as per Technical Specification.

11. This is a conditional tender enquiry. Financial bid opening (Part-II) of a bidder shall be subjected to the following:

- i) Techno-Commercial evaluation by BHEL.
- ii) **Clearance from NTPC as per Provenness Clause mentioned at sl. no. 5 of Vol-II of Technical Specification.**
- iii) Offered item should mandatorily conform to PP-MII order provisions.
- iv) Approval of vendor by the end customer i.e. NTPC. Vendor is required to submit the Credentials as per Performa for vendor approval i.e. NTPC's sub-supplier questionnaire enclosed.

12. **Evaluation shall be on the basis of total all inclusive, landed price at consignee's destination (refer Cl. No. 6 of GTC of GeM).**

13. This item /package / system falls under the list of items defined in para 3 of ministry of finance guideline dt. 20.09.16 (Procurement of items related to Public safety, Health, Critical Security operations & Equipment etc.) & hence criteria of prior experience/Turnover shall be same for all the bidders including start-up/MSME.

14. For this procurement, the local content to categorize a supplier as a Class I Local Supplier and Purchase preference to Class I local supplier, is as defined in Public Procurement (Preference to Make in India), (PPP-MII) Order 2017 dt. 16/09/2020 issued by DPIIT. In case of subsequent orders issued by the nodal ministry, changing the definition of local content for the items of the NIT, the same shall be applicable even if issued after issue of this NIT, but before opening of Part-II bids against this NIT.

Only Class-I local suppliers are eligible to bid in this tender.

Regarding verification of local content, the local supplier at the time of tender, bidding or solicitation shall be required to provide certification as per para 9 of PP-MII order revision dated 16.09.2020.

15. Bidders to ensure that Third party / customer issued certificates being submitted as proof of PQI qualification should have verifiable details of document / certificate issuing authority such as name & designation of Issuing Authority and its organization contact number and email Id etc. In case the same found not available, Purchaser has right to reject such document from evaluation.
16. Bidders to,
- ensure compliance to Ministry of Power (MoP) Order No. 25-11/6/2018-PG dt. 02/07/2020 & Order No. 11/05/2018-Coord. dt. 23/07/2020, if applicable.
 - ensure compliance of Ministry of Finance (MoF) Order (Public Procurement No. 1 & 2) F. No. 6/18/2019/PPD dt. 23/07/2020.
 - to submit "Model Certificate for Tenders" as per Annexure-III of Ministry of Finance (MoF) Order (Public Procurement No. 1 & 2) F. No. 6/18/2019/PPD dt. 23/07/2020.

Note: Subsequent orders/circulars to be checked and to be complied.

17. Due to COVID-19 pandemic condition prevailing in the country, BHEL-PEM may go for Remote Inspection of Offered items, if required. Vendors are requested to be equipped with the facilities/gadgets as indicated in the guidelines to take up the inspection REMOTELY.

Link for Remote Inspection Guidelines :

<https://pem.bhel.com/Documents/VendorSection/Vendor/Guidelines.pdf>

Inspection call to be raised by bidder on BHEL CQIR portal (details shall be shared at the of execution of order) and Inspection agency shall attend at the inspection within seven (07) days of the date on which the material is notified as being ready. In case of delay in witnessing of inspection beyond stipulated time (i.e. 7 days from the date on which the material is notified as being ready), by BHEL arising due to reasons not attributable to vendor, BHEL will extend the delivery period for such delay in carrying out inspection. If BHEL is not able to witness inspection up to 15 days then in addition to delay beyond stipulated period, extension in delivery time of 07 days for arranging fresh inspection will be given.

When the tests have been satisfactorily completed at Seller/ Contractor's works, the Inspection Agency shall issue an inspection report that effect within seven (07) days after completion of the tests, but if the tests were not witnessed by the Inspection Agency or his representative, the material acceptance report would be issued within seven (07) days after receipt of the test certificates by the Purchaser.

Purchaser will issue MDCC to the Seller/ Contractor within 7 days based on inspection report/ test certificates/Certificate of Conformance as applicable. In case of delay in issuance of MDCC beyond 7 days stipulated time (i.e. from the date of successful inspection report), by BHEL arising due to reasons not attributable to vendor, BHEL will extend the delivery period for such delay in issuing MDCC. If BHEL is not able to issue MDCC up to 15 days then in addition to delay beyond stipulated period, 7 days' additional time shall be given to vendor to facilitate the vendor for arranging logistic arrangements.

18. The Bidder declares that they will not enter into any illegal or undisclosed agreement or understanding, whether formal or informal with other Bidder(s). This applies in particular to prices specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process. In case, the bidder is found having indulged in above activities, suitable action shall be taken by BHEL as per extant policies/guidelines.
19. Bidder to note that Technical PQR shall not be applicable for this tender. **However, Clearance from NTPC as per Provenness Clause mentioned at sl. no. 5 of Vol-II of Technical Specification shall be required.** This will supersede the Experience and Past Performance Criteria of GeM.
20. Following BOQ Notes shall remain applicable: -

- Quantities indicated above shall be known as Order Quantities. The variation in quantities shall be as per NIT.
- The bidder shall indicate the unit price of each type and size of cables listed as per the BOQ-Cum Price Schedule. The unit prices shall apply for adjustment of variation in quantity as stipulated in NIT.
- Manufacturing of the cables shall be taken up by the successful bidder only after approval of technical and quality documentation. Subsequent qty. shall be cleared for manufacture based on progress of engineering & site requirements.
- The standard drum length shall be 1000 meters as indicated above. Tolerance on individual drum length shall be $\pm 5\%$.
- Overall tolerance on total dispatched quantity of each size shall be (-) 2% and (+) 0% except where the total ordered quantity is one single drum length of 1000m, in which case it shall be -5%/0%. Cables consumed for testing and inspection shall be to bidder's account.
- For each individual cable size, one short length of not less than 200m may be accepted only in the final drum length to complete the supply (except where the total ordered quantity is one single drum length of 1000m). The overall tolerance limits stipulated above shall continue to apply (in case short lengths are accepted).
- Bidder shall quote for all sizes / types of cables as per specification, failing which their offer shall be rejected.
- Bidder shall indicate unit price of cables inclusive of type test charges. No separate charges shall be payable for type tests.

21. **DEFAULT/ BREACH OF CONTRACT, INSOLVENCY AND RISK PURCHASE:**

In case of delays (beyond the maximum late delivery period as per LD clause) in supplies, or if there be defective supplies or non-fulfilment of any other terms and conditions of the Contract as enumerated subsequently in this clause, then, without prejudice to its right to recover any expenses, losses or damages to which the Buyer may be put to incur or sustain by reason of the Seller/Contractor's default or breach of Order/Contract or to suspend business dealings with the Seller/Contractor in terms of the Buyers' Guidelines for Suspension of Business Dealings as applicable from time to time, the Buyer shall also be entitled to cancel the Order/ Contract either in whole or portion thereof without compensation to Seller. On the occurrence of any of the acts/omissions mentioned below, the Buyer may if it so desires, procure upon such terms and in such manner as deemed appropriate, plant / equipment / stores not so delivered or others of similar description where plant / equipment / stores exactly complying with particulars are not, in the opinion of the Buyer (which shall be final), readily procurable, at the risk and cost of the Seller.

The Seller shall be liable to the Buyer for any excess costs incurred thereof and the Seller shall continue the performance of the Order/Contract to the extent not cancelled under the provisions of this clause. The Seller shall on no account be entitled to any gain on such re-purchases. If the Bidder does not agree to this Risk Purchase clause, BHEL reserves the right to reject the bid/offer of the Bidder. The order/contract may be cancelled in whole or part thereof and Risk & Cost Clause in line with terms and conditions of PO/Contract may be invoked by the Buyer in any of the following cases:

- i) If the Seller/Contractor fails to deliver the goods or materials or any instalment thereof within the period(s) fixed for such delivery or the seller's poor progress of the supply/service vis-à-vis delivery/execution timeline as stipulated in the contract, backlog attributable to the Seller including unexecuted portion of supply does not appear to be executable within balance period available.
- ii) Delivers goods or materials not of the contracted quality and failing to adhere to the contract specifications/execution methodology.
- iii) Withdrawal from or repudiation/abandonment of the supply/services by the Seller before completion as per contract or if the Seller refuses or is unable to supply goods or material covered by the order/Contract either in whole or in part or otherwise fails to perform the Order/Contract.
- iv) Non supply by the Seller within scheduled completion/delivery period as per contract or as extended from time to time for reasons attributable to the Seller.
- v) Termination of Contract on account of any other reason(s) attributable to the Seller.
- vi) Assignment, transfer, subletting of contract without BHEL's written permission resulting in termination of Contract or part thereof by BHEL.
- vii) If the Seller be an individual or a Sole Proprietorship, in the event of death or insanity of the Seller.
- viii) If the Seller/Contractor being an individual or if a partnership firm thereof, shall at any time be adjudged insolvent or shall have a receiving order for administration of his estate made against him or shall take any proceeding for composition under any Insolvency Act for the time being in force or make any assignment of the order/Contract or enter into any arrangement or composition with his creditors or suspend payment or if the firm dissolves

under the Partnership Act.

- ix) If the Seller/Contractor being a Company is wound up voluntarily or by order of a Court or Receiver, Liquidator or Manager on behalf of the debenture holders and creditors is appointed or circumstances have arisen which entitles the Court of debenture holder and creditors to appoint a receiver, liquidator or manager.
- x) Non- Compliance to any contractual condition or any other default attributable to the Seller.

BHEL reserves the right to terminate the contract or withdraw portion of work and get it done through other agency, at the risk and cost of the contractor after due notice of a period of 14 days' by BHEL in any of the above said cases. Such defaulting vendor/Seller shall not be eligible to participate in re-tendering conducted on account of risk purchase made due to fault of such vendor/Seller.

22. **Risk & Cost Amount against Balance Work** To be calculated as follows: -

Risk & Cost Amount= [(A-B) + (A x H/100)]

Where,

A = Value of Balance scope of Work (*) as per rates of new contract

B = Value of Balance scope of Work (*) as per rates of old contract being paid to the contractor at the time of termination of contract i.e. inclusive of PVC & ORC, if any.

H = Overhead Factor to be taken as 5

In case (A-B) is less than 0 (zero), value of (A-B) shall be taken as 0 (zero).

23. **Balance scope of work (in case of termination of contract)** Difference of Contract Quantities and Executed Quantities as on the date of issue of Letter for 'Termination of Contract', shall be taken as balance scope of Work for calculating risk & cost amount.

Contract quantities are the quantities as per original contract. If, Contract has been amended, quantities as per amended Contract shall be considered as Contract Quantities.

Items for which total quantities to be executed have exceeded the Contract Quantities based on drawings issued to contractor from time to time till issue of Termination letter, then for these items total Quantities as per issued drawings would be deemed to be contract quantities.

Substitute / extra items whose rates have already been approved would form part of contract quantities for this purpose.

Substitute / extra items which have been executed but rates have not been approved, would also form part of contract quantities for this purpose and rates of such items shall be determined in line with contractual provisions.

However, increase in quantities on account of additional scope in new tender shall not be considered for this purpose.

NOTE: In case portion of work is being withdrawn at risk & cost of contractor instead of termination of contract, contract quantities pertaining to portion of work withdrawn shall be considered as 'Balance scope of work' for calculating Risk & Cost amount.

-

24. **LD against delay in executed work in case of Termination of Contract:** LD against delay in executed work shall be calculated in line NIT terms & conditions, for the delay attributable to contractor. For limiting the maximum value of LD, contract value shall be taken as Executed Value of work till termination of contract.

Method for calculation of LD against delay in executed work in case of termination of contract" is given below:

- i. Let the time period from scheduled date of start of work till termination of contract excluding the period of Hold (if any) not attributable to contractor = T1
- ii. Let the value of executed work till the time of termination of contract = X
- iii. Let the Total Executable Value of work for which inputs/fronts were made available to contractor and were planned for execution till termination of contract = Y
- iv. Delay in executed work attributable to contractor i.e. T2 = [1-(X/Y)] x T1
- v. LD shall be calculated in line with LD clause (clause 16) of the Contract for the delay attributable to contractor taking "X" as Contract Value and "T2" as period of delay attributable to contractor.

25. **Recoveries arising out of Risk & Cost and LD or any other recoveries due from Contractor**

Without prejudice to the other means of recovery of such dues from the Seller recoveries from the Seller on whom risk & cost has been invoked shall be made from the following:

- a) Dues available in the form of Bills payable to seller, SD, BGs against the same contract.
- b) Dues payable to seller against other contracts in the same Region/Unit/ Division of BHEL.
- c) Dues payable to seller against other contracts in the different Region/Unit/ division of BHEL.

In-case recoveries are not possible with any of the above available options, Legal action shall be initiated for recovery against contractor.

26. All other terms & conditions shall be as per GeM bid, selected Additional Terms & Conditions from GeM library and GTC on GeM version available on GeM Portal as on enquiry floating date.

Disclaimer

The additional terms and conditions have been incorporated by the Buyer after approval of the Competent Authority in Buyer Organization. Buyer organization is solely responsible for the impact of these clauses on the bidding process, its outcome and consequences thereof including any eccentricity / restriction arising in the bidding process due to these ATCs and due to modification of technical specification and / or terms and conditions governing the bid. Any clause incorporated by the Buyer such as demanding Tender Sample, incorporating any clause against the MSME policy and Preference to make in India Policy, mandating any Brand names or Foreign Certification, changing the default time period for Acceptance of material or payment timeline governed by OM of Department of Expenditure shall be null and void and would not be considered part of bid. Further any reference of conditions published on any external site or reference to external documents / clauses shall also be null and void. If any seller has any objection / grievance against these additional clauses or otherwise on any aspect of this bid, they can raise their representation against the same by using the Representation window provided in the bid details field in Seller dashboard after logging in as a seller within 4 days of bid publication on GeM. Buyer is duty bound to reply to all such representations and would not be allowed to open bids if he fails to reply to such representations.

[This Bid is also governed by the General Terms and Conditions](#)

In terms of GeM GTC clause 26 regarding Restrictions on procurement from a bidder of a country which shares a land border with India, any bidder from a country which shares a land border with India will be eligible to bid in this tender only if the bidder is registered with the Competent Authority. While participating in bid, Bidder has to undertake compliance of this and any false declaration and non-compliance of this would be a ground for immediate termination of the contract and further legal action in accordance with the laws.

---Thank You---

**NTPC LIMITED
3X660 MW NORTH KARANPURA STPP**

VOLUME IIB

TECHNICAL SPECIFICATION

FOR

LT CONTROL CABLES

SPECIFICATION NO.: PE-TS-405-507-E003 (REV. 01)



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA-201301
INDIA**



3 X 660 MW NORTH KARANPUAR TPS

**TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS- 405-507-E003

VOLUME II

REVISION 01

DATE: 11.02.2022

SHEET

CONTENTS

<u>S. NO.</u>	<u>DESCRIPTION</u>	<u>NO. OF SHEETS</u>
1.	CONTENTS	01
2.	COMPLIANCE CERTIFICATE	01
3.	SECTION – I	
	a. SPECIFIC TECHNICAL REQUIREMENTS	02
	b. DATA SHEET-A	03
	c. DATA SHEET-C (GUARANTEED TECHNICAL PARTICULARS)	02
4.	SECTION – II	
	a. GENERAL TECHNICAL SPECIFICATION	01
	b. QUALITY PLAN (ALONGWITH ANNEXURE A to QP)	13
	c. ANNEXURE-B TO SECTION-II	02
	d. ANNEXURE-C	04
	TOTAL NO. OF SHEETS=	37
	(INCLUDING COVER/ SEPARATOR SHEETS)	



3 X 660 MW NORTH KARANPUAR TPS

**TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS- 405-507-E003

VOLUME II

REVISION 01

SHEET

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance to the following by signing/ stamping this compliance certificate and furnishing same with the offer.

1. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same
2. There are no deviation with respect to specification other than those furnished in the 'schedule of deviations'
3. Only those technical submittals which are specifically asked for in NIT to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of offer.
4. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
5. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in 'BOQ-Cum-Price schedule' of the specification shall not be considered (i.e., technical description & quantities as per the specification shall prevail).

BIDDER'S STAMP & SIGNATURE

**3 X 660 MW NORTH KARANPUAR TPS****TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS- 405-507-E003

VOLUME II

REVISION 01

DATE: 11.02.2022

SHEET

SECTION - I

SPECIFIC TECHNICAL REQUIREMENTS



3 X 660 MW NORTH KARANPUAR TPS

**TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS- 405-507-E003

VOLUME II

REVISION 01

DATE: 11.02.2022

SHEET 1 OF 2

1.0 SCOPE OF ENQUIRY

- 1.1 Design, Manufacture, Inspection and Testing at Manufacturer's works, proper packing and delivery to site of LT PVC Control cables conforming to this specification.
- 1.2 General technical requirements of the LT PVC Control cables are indicated in Section-II. Project specific technical/ quality requirements / changes are listed in Section-I.
- 1.3 The stipulations of Section-I, followed by those of Data Sheet-A shall prevail in case of any conflict between the stipulations of Section-I, Data Sheet - A & Section-II.
- 1.4 The documents shall be in English Language and MKS system of units.

2.0 BILL OF QUANTITIES:

- 2.1 Quantity requirements shall be as per 'BOQ-cum-price schedule' as part of NIT.


3.0 SPECIFIC TECHNICAL REQUIREMENTS

<u>S.No.</u>	<u>Reference Clause No. of Section- II</u>	<u>Specific Requirement/ Change</u>
1	3.1	BHEL Standard Quality Plan (PE-QP-999-507-E003) shall be read as "QP. NO. 0000-999-QOE-S-040, REV-00". Additionally, The QP. NO. 0000-999-QOE-S-040 REV-00 shall be read in conjunction with Annexure C (Quality Assurance & Inspection). However Type testing on cables shall be conducted as per attached BHEL QP along with Annexure-A..

4.0 DRAWINGS & DOCUMENTS TO BE SUBMITTED

- 4.1 Following documents/drawings shall be submitted after placement of order for BHEL & customer's approval:-

Sl. No.	Drawings/Document Description	Drawings / Document Number
1.	Technical Data sheet - LT PVC Control cables	PE-V0-405-507-E131
2.	Cross-sectional Drgs.- LT PVC Control Cables	PE-V0-405-507-E133
3.	Quality Plan - LT PVC Control Cables	PE-V0-405-507-E915*

	3 X 660 MW NORTH KARANPUAR TPS TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES	SPECIFICATION NO. PE-TS- 405-507-E003	
		VOLUME II	
		REVISION 01	DATE: 11.02.2022
		SHEET 2 OF 2	

Sl. No.	Drawings/Document Description	Drawings / Document Number
4.	Steel drum drawing - LT PVC Control Cables (if applicable)	PE-V0-405-507-E135
5.	Type Test Reports - LT PVC Control Cables	PE-V0-405-507-E134

Note:

* Standard Quality Plan as enclosed in the technical specification is to be appended with cover sheet bearing document number and description as stated above. The signed and stamped copy of the same shall be submitted to BHEL without making any changes in the contents of the document.

5.0 PROVENNESS

The Bidder/ Sub Vendor should have manufactured and supplied following cables, prior to the date of Techno-Commercial bid opening i.e, 28.11.2013

- (A) At least 300 km of PVC insulated, PVC sheathed stranded copper conductor 1.1kV grade cables in one single contract.
- (B) At least one (1) km of Flame-retardant low smoke cables.

688226/2022/PS-PEM-EL

**3 X 660 MW NORTH KARANPUAR TPS****TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS- 405-507-E003

VOLUME II

REVISION 01

DATE: 11.02.2022

SHEET

ANNEXURE-A TO SECTION I

	The reports for the following type tests shall be submitted for one size of control cables. Size shall be decided by the employer during detailed engineering		
S. No.	Type Test	Remarks	
	For Conductor		
1.	Resistance test		
	For Armour Wires / Formed Wires (If applicable)		
2.	Measurement of Dimensions		
3.	Tensile Test		
4.	Elongation test		
5.	Torsion test	For round wire only	
6.	Wrapping test	For aluminium wires / formed wires only.	
7.	Resistance test		
8(a).	Mass of zinc Coating test	For GS wires/formed wires only	
8(b).	Uniformity of zinc coating	For GS wires/formed wires only	
9.	Adhesion test	For GS wires/formed wires only	
	For PVC insulation & PVC Sheath		
10.	Test for thickness		
11.	Tensile strength and elongation test	before ageing and after ageing	
12.	Ageing in air oven		
13.	Loss of mass test	For PVC insulation and sheath only	
14.	Hot deformation test	For PVC insulation and sheath only	
15.	Heat shock test	For PVC insulation and sheath only	
16.	Shrinkage test		
17.	Thermal stability test	For PVC insulation and sheath only	
18.	Oxygen index test	For outer sheath only	

	S. No.	Type Test	Remarks
	19.	Smoke density test	For outer sheath only
	20.	Acid gas generation test	For outer sheath only
	For completed cables		
	21.	Insulation resistance test(Volume resistivity method)	
	22.	High voltage test	
	23.	Flammability test as per IEC-332 Part-3 (Category-B)	

CLAUSE NO.



Control Cables

Attributes / Characteristics Item / Components / Sub System Assembly	Make, Type & T.C as per relevant standard	Dimension/surface finish	Mechanical properties	Chemical Composition	Spark Test(as applicable)	Electrical properties	Lay length & Sequence	Armour coverage, cross over, looseness, gap between two	Sequential marking/ Batch marking/ surface finish/ cable length	T.S & elongation before & after ageing on outer sheath & insulation	Thermal stability	Anti termite coating on wooden	Constructional requirements feature as per NTPC specification	Routine & Acceptance Tests as per relevant standard & NTPC	FRLS Tests
Copper (IS-8130)	Y	Y	Y	Y		Y									
PVC insulation Compound (IS: 5831)	Y		Y			Y				Y	Y				
FRLS PVC Compound (IS-5831, ASTM-D2843, IS10810(Part 58), IEC-60754 Part-1)	Y		Y							Y	Y				Y
Extrusion & curing /Manufacturing of Core		Y			Y						Y				
Core Laying						Y									
Armour wire/strip	Y	Y	Y												
Inner sheath	Y	Y													
Armouring		Y					Y								
Outer Sheathing		Y						Y							
Finished Cable (IS-5831, ASTM-D2843, IS10810(Part 58), IEC-60754 Part-1, IEC 60332 part III cat B)						Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Wooden drum(IS-10418) /Steel Drum		Y										Y	Y		

Notes:

1. This is an indicative list of tests / checks. The manufacturer is to furnish a detailed Quality Plan indicating the practice and procedure along with relevant supporting documents.
2. Make of all major Bought out items will be subject to NTPC approval.

PAGE

CLAUSE NO.

QUALITY ASSURANCE



ROUTINE TESTS	Following routine tests shall be carried out on each drum of finished cables for all sizes.	
1)	Conductor Resistance test	
2)	High voltage test	
ACCEPTANCE TESTS	Following Acceptance tests shall be carried out on each size of cables, in the offered lot.	
A) For Conductor (as per sampling plan mentioned in IS: 1554)		
	1)	Annealing test (Copper)
	2)	Resistance test
B) For Armour Wires / Formed Wires (If applicable) (as per sampling plan mentioned in IS: 1554)		
	1.	Measurement of Dimensions
	2.	Tensile Tests
	3.	Elongation Test
	4.	Torsion Test For Round wires only
	5.	Wrapping Test
	6.	Resistance Test
	7.	Mass of Zinc coating test For G S wires / Formed wires only
	8.	Uniformity of Zinc coating For G S wires / Formed wires only
	9.	Adhesion test For G S wires / Formed wires only
	10.	Freedom from surface defects
C) For PVC insulation & PVC Sheath (as per sampling plan mentioned in IS: 1554)		
	1)	Test for thickness
	2)	Tensile strength & Elongation before ageing (for tests after ageing see "D")

PAGE

CLAUSE NO.

QUALITY ASSURANCE

**D) Ageing test:**

	Criteria	Condition	Test Requirements	Remarks
PVC insulation & outer sheath:	Samples as per relevant IS, from each size of cables in the offered lot, shall be tested for tensile strength & elongation (before ageing). Tensile & elongation testing shall preferably be done with a computerized machine. The values will be compared with corresponding values mentioned in the Type Test report accepted by NTPC. These values of Tensile Strength & Elongation (before ageing) should be within +/- 15% of the corresponding values of Type Test report. (Please note that test values should be more than the minimum values indicated in relevant standard).	All sizes which meet the criteria	The size which has maximum negative deviation from type test report values will be put on accelerated ageing test. The samples shall be aged in air oven at temperature of 130°C +/- 2°C for 5 hours and tested for TS & elongation. Acceptance norms shall be as per IS.	In case the size does not meet the requirement in accelerated ageing test then all sizes (which had met the criteria) will be put on ageing test as per IS.
		Sizes which do not meet the criteria	Every size will be put on ageing test as per IS.	----

E) Following tests will be carried out on completed cables as per IS on each size:

	1)	Insulation resistance test (Volume resistivity method)
	2)	High voltage test


F) Following tests shall be carried out on only one size of offered lot (comprising of all sizes):

	1)	Thermal stability test on PVC insulation and outer sheath
	2)	Oxygen index test on outer sheath
	3)	Smoke density rating test on outer sheath
	4)	Acid gas generation test on outer sheath

G) Flammability test as per IEC 60332 - Part- 3 (Category- B) on completed cable will be carried out as per following sampling plan:

		This test will be carried out using composite sampling i.e. irrespective of size; cables of one particular type (i.e. armoured, unarmoured) will be bunched together, as per calculations in line with the IEC. All sizes of armoured & unarmoured cables shall be covered.
--	--	---

PAGE

CLAUSE NO.	QUALITY ASSURANCE		
H) Following tests shall be carried on one length of each size (armoured & unarmoured) of offered lot:			
	1)	Constructional / dimensional check, surface finish, length measurement, sequence of cores, armour coverage, Gap between two consecutive armour wires / formed wires, Sequential marking, drum / outer sheath extrusion's batch number marking	
	2)	Measurement of Eccentricity & Ovality	
			PAGE

688226/2022/PS-PEM-EL



3 X 660 MW NORTH KARANPUAR TPS

TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES

SPECIFICATION NO. PE-TS- 405-507-E003


VOLUME II

REVISION 01

DATE: 11.02.2022

SHEET

DATA SHEET A

	DOCUMENT TITLE		SPECIFICATION NO. PE-TS-405-507-E003	
	TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES 3 x 660 MW North Karanpura TPP		VOLUME II B	
			SECTION	
			REVISION 01	DATE: 11.02.2022
	SHEET	42	OF	47

DATA SHEET A

SPECIFIC TECHNICAL REQUIREMENTS

- 1.0 Type of cable : FRLS
- 2.0 Standard applicable : IS: 1554 Part-I (in general)
- 3.0 Voltage designation of cables : 1.1 kV
- 4.0 Number of cores and cross section area : As per BOQ, Annexure-A to Section-C
- 5.0 CONDUCTOR**
- a) Material : Copper
- b) Grade, shape & class : Stranded, non-compacted & circular, high conductivity annealed plain copper, class-2
- c) Strands : (Min.) 7
- d) Applicable standard : IS: 8130

6.0 INSULATION

- a) Material & Standard : PVC, Type A (IS: 5831)
- b) Continuous withstand temperature : 70° C
- c) Short circuit withstand temperature : 160° C
- d) Method of Application : By extrusion (Sleeve extrusion not permitted)
- e) Color of insulation : Grey


7.0 IDENTIFICATION OF CORES

Cores of the cables of upto 5 cores shall be identified by colouring of insulation. Following colour scheme shall be adopted.

- 1 core - Red, Black, Yellow or Blue
- 2 core - Red & Black
- 3 core - Red, Yellow & Blue
- 4 core - Red, Yellow, Blue and Black
- 5 core - Red, Yellow, Blue, Black and Grey

For cables having more than 5 cores, core identification shall be done by numbering the insulation of cores sequentially, starting by number 1 in the inner layer (e.g. say for 10 core cable, core numbering shall be from 1 to 10). The number shall be printed in Hindu- Arabic numerals on the outer surfaces of the cores. All the numbers shall be of the same colour, which shall contrast with the colour of insulation. The colour of insulation for all the cores shall be grey only. The numerals shall be legible and indelible. The numbers shall be repeated at regular intervals along the core, consecutive numbers being inverted in relation to each other. When the number is a single numeral, a dash shall be placed underneath it. If the number consists of two numerals, these shall be disposed one below the other and a dash placed below the lower numeral. The spacing between consecutive numbers shall not exceed 50 mm.

8.0 INNER SHEATH

	DOCUMENT TITLE		SPECIFICATION NO. PE-TS-405-507-E003
	TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES 3 x 660 MW North Karanpura TPP		VOLUME II B
			SECTION
			REVISION 01
	SHEET	43	OF

- | | | | |
|----|-------------------------|---|---|
| a) | Material & Standard | : | PVC Type ST 1 (IS: 5831) |
| b) | Colour | : | Black |
| c) | Whether FRLS | : | NO |
| d) | Fillers | : | Acceptable |
| e) | Material of fillers | : | Same as inner sheath. (Material to be compatible with inner sheath) |
| f) | Method of application : | | |
| | i) With fillers | : | Pressure / Vacuum Extruded |
| | ii) Without fillers | : | Pressure Extruded. |

9.0 ARMOUR


- | | | | |
|----|--------------------------|---|---|
| a) | Material | : | Galvanised steel round / formed wire conforming to IS: 3975 |
| b) | Minimum coverage | : | 90% |
| c) | Gap between armour wires | : | Shall not exceed one armour wire space
(No cross over/ overriding) |
| d) | Breaking load of joint | : | 95% of normal armour wire |
| e) | Standard applicable | : | IS 1554 (Part I) & IS 3975 |

10.0 OUTER SHEATH

- | | | | |
|----|---------------------|---|---|
| a) | Material & Standard | : | PVC Type ST 1 (IS : 5831) |
| b) | Application | : | Extruded |
| c) | Colour | : | Grey |
| d) | Whether FRLS | : | YES |
| e) | Marking | : | Cable size (cross section area and no. of cores)
(by embossing),
Voltage grade (by embossing),
Letters FRLS@ 5m (by embossing)
Progressive sequential marking of length @ 1m
(by embossing/printing).
Manufacturer's name and /or trade name, year of
manufacture, 'BHEL-PEM' & 'NTPC' @5m (by
embossing) |

11.0 CHARACTERISTICS OF FRLS SHEATH

- | | | | |
|----|----------------------|---|--|
| a) | Oxygen index | : | Min. 29 (As per ASTM D2863) |
| b) | Temperature Index | : | Min. 250° C (As per ASTM D 2863) |
| c) | Acid gas generation | : | Max. 20% (As per IEC-754-1) |
| d) | Smoke density rating | : | Max. 60% (As per ASTM D 2843) |
| e) | Flammability Test | : | As per IEC: 60332-III CAT-B, IEEE: 383 & SS:
424:1475 (Class-F3), IS:1554 (Part I). |

	DOCUMENT TITLE		SPECIFICATION NO. PE-TS-405-507-E003	
	TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES 3 x 660 MW North Karanpura TPP		VOLUME II B	
			SECTION	
			REVISION 01	DATE: 11.02.2022
	SHEET	44	OF	47

12.0 TOLERANCE ON OUTER DIAMETER

- a) Upto 30 mm O.D. : (+/-) 1.5 mm
b) Above 30 mm O.D. : (+/-) 5% or (+/-) 2 mm whichever is less.


13.0 MINIMUM BENDING RADIUS : 12 X OD

14.0 SAFE PULLING FORCE : 50N / sq. mm


15.0 CABLE DRUMS

- a) Type & construction : Non-returnable Steel or Wooden
(The surface of the drum and the outer most cable layer shall be covered with water proof cover. Both the ends of the cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by 'U' nails so as to eliminate ingress of water during transportation, storage and erection. Wood preservative anti-termite treatment shall be applied to the entire drum. Wooden drums shall comply with IS 10418).
- b) Standard drum length : As specified in BOQ cum price schedule (Annexure A to section C)
- c) Marking on Cable drums : Manufacturer's name or trade mark, purchaser's name, address and contract number, item number & type of cable & voltage grade, year of manufacture, type of insulation/sheath, no. of core and size of cables, cable code, length of cable on drum, direction of rotation (by arrow), approx. net gross weight. A tag containing same information shall be attached to the leading end of the cable.

688226/2022/PS-PEM-EL

	DOCUMENT TITLE		SPECIFICATION NO. PE-TS-405-507-E003	
	TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES 3 x 660 MW North Karanpura TPP		VOLUME II B	
			SECTION	
			REVISION 01	DATE: 11.02.2022
	SHEET 45		OF 47	


DATA SHEET C

	3 X 660 MW NORTH KARANPUAR TPS TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES	SPECIFICATION NO. PE-TS- 405-507-E003	
		VOLUME	II B
		SECTION I	
		REV NO. 01	DATE: 11.02.2022
		SHEET 1	OF 2

DATA SHEET C
GUARANTEED TECHNICAL PARTICULARS
(TO BE SUBMITTED BY SUCCESSFUL BIDDER)

- 1.1 Name of manufacturer :
- 1.2 Place of manufacture :
- 2.0 **INFORMATION TO BE FILLED IN FOR EACH SIZE CABLE IN THE FORM OF TABLE**
- 2.1 No. of cores x size :
- 2.2 Current rating of cable confirms to :
- 2.3 Short circuit rating of cable confirms to :
- 2.4 **CONDUCTOR**
- a) Material type & grade :
- b) No. & dia of wires in each core : no x mm
before stranding
- 2.5 **PVC INSULATION**
- a) Type :
- b) Minimum & Nominal thickness of insulation : mm
- 2.6 **PVC ST1 INNERSHEATH**
- a) Thickness (min.) : mm
- b) Method of application
- 1) Multi-core cables
- i) with fillers
- ii) without fillers :

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	3 X 660 MW NORTH KARANPUAR TPS TECHNICAL SPECIFICATION FOR LT PVC CONTROL CABLES	SPECIFICATION NO. PE-TS- 405-507-E003	
		VOLUME	II B
		SECTION I	
		REV NO. 01	DATE: 11.02.2022
		SHEET 2	OF 2

- c) Type of fillers (if used) :
 Shape of fillers (if used) :

2.7 ARMOUR

- a) Material :
 i) Multi-core cables
- b) Size / dimensions :
- c) Minimum no. of wires :
- d) Maximum resistivity of GS wire :
- e) Maximum resistivity of Aluminium round wire :

2.8 PVC ST1 FRLS OUTERSHEATH

- a) Minimum thickness of outer sheath : mm
- b) Colour :

2.9 Diameters

- a) Diameter of insulated conductor : mm
- b) Cable diameter under armour : mm
- c) Cable diameter over armour : mm
- d) Overall diameter of cable : mm

2.10 Weight of cable : kg./km

2.11 Dimension of drum : mm

2.12 Shipping weight : kg.

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

**3 X 660 MW NORTH KARANPUAR TPS****TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS-405-507-E003

VOLUME II

SECTION II

REVISION 01

DATE: 11.02.2022

SECTION - II**GENERAL TECHNICAL SPECIFICATION**



3 X 660 MW NORTH KARANPUAR TPS

**TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES**

SPECIFICATION NO. PE-TS-405-507-E003

VOLUME II

SECTION II

REVISION 01

DATE: 14.02.2022

SHEET 1 OF 1

1.0 TECHNICAL REQUIREMENTS

- 1.1 Technical requirements for LT PVC CONTROL CABLES shall be as indicated in this section, in addition to those specified in Section I & Datasheet-A.
- 1.2 It is not the intent to specify herein all the details of design & manufacture. However, the equipment shall conform in all respects to high standards of design engineering and workmanship and shall be capable of performing in Continuous commercial operation at site conditions.

2.0 CODES & STANDARDS


- 2.1 The design, material, construction, manufacture, inspection, testing and performance of LT PVC CONTROL CABLES shall conform to the latest revision of relevant standards and codes of practices mentioned in Data Sheet - A.
- 2.2 In case of conflict between the applicable reference standard and this specification, this specification shall govern.

3.0 QUALITY ASSURANCE REQUIREMENTS

- 3.1 Bidder shall confirm compliance with the BHEL Standard Quality Plan (PE-QP-999-507-E003) as attached with the specification without any deviations. At contract stage, the successful bidder shall submit the same QP for BHEL/ultimate customer's approval. In case bidder has reference QP agreed with ultimate customer, same can be submitted for specific project after award of contract for BHEL/ultimate customer's approval. There shall be no commercial implication to BHEL on account of minor changes in QP during contract stage.
- 3.2 All materials shall be procured, manufactured, inspected and tested by vendor/ sub-vendor as per approved Quality Plan.
- 3.3 Type testing requirements, routine / acceptance testing and special testing requirements shall be as per Annexure –A to QAP. Charges for all these tests for all the equipments & components shall be deemed to be included in the bid price (except UV Radiation & Hydraulic Stability test).
- 3.4 The charges of UV Radiation test & Hydrolytic Stability test (if applicable) shall be reimbursed extra at actual against original money receipt of Govt. Lab. (CPRI/ ERDA etc).
- 3.5 Cost of cables consumed for testing shall be to bidder's account.

4.0 Packing

- 4.1 Cables shall be supplied in non-returnable drums. Material of cable drums shall be as specified in Datasheet-A.
- 4.2 In case of wooden drums, all wooden parts shall be manufactured from seasoned wood treated with copper naphthenates / zinc naphthenates (refer IS: 401). Dimensions of wooden drums shall be as per IS 10418. All ferrous parts shall be treated with suitable rust protective finish or coating to avoid rusting during transit and storage. BIS certification mark shall be stamped on each cable drum.
- 4.3 In case of Steel drums, New or practically new cable drums made of steel and painted with epoxy resin paint are to be used. Cable ends are carefully protected before packing. Over the cables polyethylene sheet shall be wrapped and then sealed properly. For Typical details of Steel drums, Annexure-A to Section-II, may be referred by the bidder. Bidder may modify, to choose appropriate dimensions of steel drums to suite various sizes/weight/ lengths of LT PVC CONTROL CABLES.

	ANNEXURE TO QP	CUSTOMER:	PROJECT TITLE	SPECIFICATION NUMBER: PE-TS-405-507-E003
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E003, R1	SPECIFICATION TITLE:
	SHEET 6 OF 8	SYSTEM	ITEM: LT PVC CONTROL CABLE	DOC. NO.

TYPE/ ACCEPTANCE/ ROUTINE TEST REQUIREMENTS

A. Type Test Conduction:

1. Tests for which "T" is indicated in the 'Test Conduction Required As' column below shall be conducted as Type Test.
2. Sampling:
 - a) Type test to be conducted on one size of cable for every lot of cable.
 - b) FRLS & Flammability Test to be conducted only on one sample/ lot.

B. Acceptance Test Conduction:

1. Tests for which "A" is indicated in the 'Test Conduction Required As' column below shall be conducted as Acceptance tests.
2. Sampling:
Sampling for acceptance tests shall be as per Appendix-B of IS: 1554 Part-I (control cable).
3. Flammability Test to be conducted only on one sample/ lot.

C. Routine Test Conduction:

1. Tests for which "R" is indicated in the 'Test Conduction Required As' column below shall be conducted as Routine tests.

- D. Tests listed in S. No-7.0 & 8.0 shall be conducted only on one sample / lot.


NOTE

LOT shall be defined as per IS: 1554 Part-I (control cable).

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
1.0	Tests for Conductor				
I.	Annealing test	For copper conductor	T, A	IS 10810 Pt 1	<i>In process records shall be furnished to inspector at the time of inspection.</i>
II.	Resistance test	For copper conductor	T, A, R	IS 10810 Pt 5	
2.0	Tests for Armour Wires/Strips				
I.	Measurement of dimensions	Applicable for GS wire/Strip	T,A	IS 10810 Pt 36	
II.	Tensile test	Applicable for GS wire/Strip	T, A	IS 10810 Pt 37	
III.	Elongation at break test	Applicable for GS wire/Strip only	T, A	IS 10810 Pt 37	
IV.	Torsion test	For GS round wire only	T, A	IS 10810 Pt 38	
V.	Winding / Adhesion Test	For GS strip only	T, A	IS 10810 Pt 39	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL


688226/2022/PS-PEM-EL

	ANNEXURE TO QP	CUSTOMER:	PROJECT TITLE	SPECIFICATION NUMBER: PE-TS-405-507-E003
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E003, R1	SPECIFICATION TITLE:
	SHEET 7 OF 8	SYSTEM	ITEM: LT PVC CONTROL CABLE	DOC. NO.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
VI.	Resistivity test	Applicable for GS wire/Strip	T, A	IS 10810 Pt 42	
VII.	Uniformity of Zinc coating test	For G. S. wires/Strip only	T, A	IS 10810 Pt 40	
VIII.	Mass of Zinc coating test	For G. S. wires/Strip only	T, A	IS 10810 Pt 41	
IX.	Wrapping Test	For G. S. wires/Strip only	A	IS 10810 Pt 3	
3.0	<u>Physical Tests for PVC Insulation & PVC sheath</u>				
I.	Test for thickness	Applicable for PVC insulation, PVC inner sheath & PVC outer sheath	T, A	IS 10810 Pt 6	
II.	Tensile strength and elongation test at break	Applicable for PVC insulation & PVC outer sheath			
(a)	Before ageing		T, A	IS 10810 Pt 7	
(b)	After ageing		T, A	IS 10810 Pt 7	
III.	Ageing in air oven	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 11	
IV.	Loss of mass in air oven test	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 10	
V.	Hot deformation test	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 15	
VI.	Heat shock test	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 14	
VII.	Shrinkage test	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 12	
VIII.	Thermal stability test	Applicable for PVC insulation & PVC outer sheath	T	IS 10810 Pt 60	
4.0	<u>Improved Fire performance (FR-LSH) Tests</u>				
I.	Oxygen index test	For PVC outer sheath only	T, A	IS 10810 Pt 58 / ASTM D 2863	Applicable for Inner Sheath also, if the same is indicated in Datasheet-A
II.	Smoke density test	For PVC outer sheath only	T, A	IS 10810 Pt 63 / ASTM D 2843	
III.	Acid gas generation test	For PVC outer sheath only	T, A	IS 10810 Pt 59 / IEC-754-1	
IV.	Temperature Index Test	For PVC outer sheath only	T	IS 10810 Pt 64 / ASTM D 2863	
5.0	<u>Flammability Tests</u>				
I.	Flammability test for bunched cables	For complete cable	T	IS 10810 Pt 62 / IEC-60332 (Part-3-23-Cat-B)	Test & Category applicable

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

688226/2022/PS-PEM-EL

	ANNEXURE TO QP	CUSTOMER:	PROJECT TITLE	SPECIFICATION NUMBER: PE-TS-405-507-E003
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E003, R1	SPECIFICATION TITLE:
	SHEET 8 OF 8	SYSTEM	ITEM: LT PVC CONTROL CABLE	DOC. NO.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
II.	Flammability test for single cable	For complete cable	T,A	IS: 10810 Pt 61 / IEC:60332 Part-1	as indicated in Datasheet-A
III.	Swedish chimney test	For complete cable	A	SEN SS 424 1475 (Class F3)	
IV.	Flammability test	For complete cable	A	IEEE: 60383	
6.0	Electrical Tests				
I.	High Voltage Test (Water immersion test)	On cores	T	IS 10810 Pt 45	
II.	High Voltage Test at room temperature	For complete cable	T, A, R	IS 10810 Pt 45	
III.	Insulation Resistance Test (Volume resistivity method)	For complete cable	T, A	IS 10810 Pt 43	
7.0	Anti-rodent and Termite Repulsion test	For PVC outer sheath only	A	Refer Note	Test applicable if indicated in Datasheet-A
8.0	Anti-Fungal Test	For PVC outer sheath only	A	--	
9.0	Special Tests				
I.	Hydrolytic Stability Test	For complete cable	**	ASTM D 3137:81	Test applicable if indicated in Datasheet-A
II.	Ultraviolet Radiation Test	For complete cable	**	BS EN ISO 4892-2	

**** These tests shall be conducted on one sample for the entire contract and duration of these tests shall be 14 days.**

Note: A few chipping of the PVC compound is slowly ignited on a porcelain dish or cubicle in a muffle furnace at about 60-degree C. The resulting ignited ash is boiled with a little ammonium acetate solution (10%). Place a drop of aqueous sodium sulphide solution on a thick filter paper and allow soaking. Touch the spot with a drop of above extract. A black spot indicates the presence of lead, the anti-termite and rodent compound.

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

688226/2022/PS-PEM-EL



3 X 660 MW NORTH KARANPUAR TPS

TECHNICAL SPECIFICATION FOR
LT PVC CONTROL CABLES

SPECIFICATION NO. PE-TS-405-507-E003

VOLUME II-B

SECTION II

REVISION 0

DATE: 11.02.2022

QUALITY PLAN



Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks
					M	C/N				D*	M	C	N	
<p>Item: 1.1 KV PVC Insulated FRLS Control cables</p> <p>STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART 1 AND NTPC TECHNICAL SPECIFICATION)</p> <p>Q.P. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 1 of 9</p> <p>VALID UP TO: 24-11-14</p> <p>REVIEWED BY: Inderjit Singh, Vikram Talwar, Rajeev Garb APPROVED BY: A.K. Gidrg</p>														
<p>Instructions: 1) Cable manufacturer to maintain records to show co- relation of raw materials to finished cables i.e raw material batch/ lot no. should be traceable to the cable drum. 2) Cable manufacturer to maintain all quality control records identified as per all QP stages enumerated below whether it is identified for NTPC verification or witness or not.</p>														
<p>A Raw material/ Brought out Items</p>														
1.01	Copper	1. Make	MA	Verify	100%	--	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	QCR	V	--	--	--	
		2. Resistivity	MA	Elect	As per cable Mnfir Sid.	--	IS 613	IS 613	-do-	P	--	--	--	
1.02	PVC compound for insulation	1. Make	MA	Verify	--do--	100%	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	-do-	V	V	--	--	
		2. Type/ Grade	MA	Verify	100%	100%	NTPC ADS	NTPC ADS	-do-	V	V	V	V	Refer note 1
		3. All acceptance test as per manufacturer norms including Thermal Stability test	MA	Verify	As per manufacturer norms	--do--	--do--	--do--	-do-	V	V	V	V	
1.03	PVC Compound for Inner sheath	1. Make	MA	Verify	--do--	--do--	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	-do-	V	V	V	V	
		2. Type/ Grade	MA	Verify	--do--	--do--	NTPC ADS	NTPC ADS	-do-	V	V	V	V	
1.04	Steel wire / Formed Wire (As applicable)	1. Make	MA	Verify	--do--	--do--	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	-do-	V	V	V	V	
		2. Dimension	MA	Meas	1 sample from each size / lot	--	NTPC APPROVED DATA SHEET & IS 3975	NTPC APPROVED DATA SHEET & IS 3975	-do-	P	--	--	--	
		3. All acceptance tests as per IS 3975	MA	Verify	As per IS 3975	--	IS 3975	IS 3975	Supplier TC	V	V	V	V	
1.05	PVC compound for Sheath	1. Make	MA	Verify	As per manufacturer norms	100%	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	QCR	V	V	--	--	
		2. Type / Grade	MA	Verify	100%	100%	NTPC ADS	NTPC ADS	-do-	V	V	V	V	
		3. All acceptance test as per manufacturer norms	MA	Verify	As per manufacturer norms	As per manufacturer norms	--do--	--do--	-do-	V	V	V	V	Refer note 1
		4. Thermal Stability	MA	Chem	One sample / Batch	--	NTPC ADS	NTPC ADS	QCR	P	--	--	--	
		5. Oxygen Index	MA	Chem	--do--	--	NTPC ADS/ IS 10810 Part 58	NTPC ADS	-do-	P	--	--	--	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M:MANUFACTURER/SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO:QS-01-QAI-P-10/F3-R1



Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency			Remarks
					M	C/N				D*	M	C	
1	2	3	4	5	6	7	8	9	10	11			
<p>Item: 1.1 KV PVC Insulated FRLS Control cables</p> <p>STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART I AND NTPC TECHNICAL SPECIFICATION)</p> <p>QP. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 2 of 9</p> <p>REVIEWED BY: INDERJIT SINGH APPROVED BY: M. T. A. K. GARG Date: 25-11-2022</p> <p>VALID UP TO: 24-11-14</p> <p>IKRAM TALWAR RAJEEV GARG</p>													
1.06	Wooden Drum	1. Dimension 2. Anti termite treatment	MI	Meas	One sample / Batch	IS 10418	IS10418	-do-	P	--	--		
1.07	Steel Drum	1. Dimension 2. Surface finish	MI	Meas	--do--	CABLE MANUF. STD.	CABLE MANUF. STD.	COC	V	V	V	COC from drum manuf.	
<p>Process & Stage Inspection</p>													
2.01	Wire Drawing	1. Surface finish 2. Wire Diameter 3. Annealing Test	MA	Visual	One sample/Setting of each size	SHOULD BE SMOOTH & FREE FROM SCRATCHES	SHOULD BE SMOOTH & FREE FROM SCRATCHES	QCR	P	--	--		
2.02	Bunching / stranding	1. No. of wires	MA	Meas	--do--	NTPC ADS	NTPC ADS	--do--	P	--	--		
		2. Dia of wire	MA	Meas	--do--	IS8130/NTPC ADS	IS8130/NTPC ADS	--do--	P	V	V	Refer Sl. No. 3.03(iii).	
		3. Dimension of Conductor	MA	Meas	--do--	Same as 6M			--do--	P	--	--	
		4. Direction of lay	MA	Visual	--do--				--do--	P	--	--	
		5. Records of strand breakage / welding during conductor stranding	MA	Verify	--do--				--do--	P	--	--	
		6. Surface finish	MA	Visual	--do--				--do--	P	--	--	
		7. DC Resistance	CR	Meas	--do--				--do--	P	--	--	
2.03	Insulation extrusion	1. Surface finish	MA	Visual	--do--	NTPC spec	SHOULD BE SMOOTH, NO POROSITY IS PERMITTED.	--do--	P	--	--	PVC compound shall be preferably loaded in to extruder by suction method.	
		2. Colour of cores	MA	Visual	--do--	NTPC ADS	NTPC ADS	--do--	P	--	--		

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M-MANUFACTURER/SUPPLIER, C-MAIN SUPPLIER, N-NTPC, P-PERFORM W-WITNESS, V-VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO: QS-01-QA1-P-10/F3-R1



Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency			Remarks
					M	C/N				D*	M	C	
1	2	3	4	5	6	7	8	9	10	11	11	Core printing shall be legible & indelible	
		3 Core identification	MA	Visual	One sample/Setting of each size	NTPC ADS	NTPC ADS	QCR					
		4. Thickness	CR	Meas	--do--	--do--	--do--	--do--					
		5. Spark Test	CR	Elect	100%	100%	CABLE MANUF. STD.	No FAILURE				1. Spark test failure record is to be verified. 2. Core repairing not permitted	
2.04	Laying up	1. Core sequence	MA	Visual	One sample/Setting of each size	IS 1554 (Part I)	IS 1554 (Part I)	--do--					
		2. Direction of lay	MA	Visual	--do--	--do--	--do--	--do--					
		3. Dia over laid up core	MA	Meas	--do--	NTPC ADS	NTPC ADS	--do--					
		1. Colour	MA	Visual	--do--	--do--	--do--	--do--					
		2. Surface Finish	MA	Visual	100%	NTPC SPECIFICATION	FISH EYE, BLOW HOLE NOT PERMITTED	--do--					
		3. Thickness	MA	Meas	One sample/Setting of each size	NTPC ADS	NTPC ADS	--do--					
		4. Dia over inner sheath	MI	Meas	--do--	--do--	--do--	--do--					
2.06	Armouring (As Applicable)	1. Dimension	MA	Meas	--do--	--do--	--do--	--do--					
		2. No. of wires / strip	MA	Meas.	--do--	--do--	--do--	--do--					

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QAI-P-10/F3-R1



Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks
					M	C/N				D*	M	C	N	
<p>Item: 1.1 KV PVC Insulated FRLS Control cables</p> <p>STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART 1 AND NTPC TECHNICAL SPECIFICATION)</p> <p>QP. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 4 of 9</p> <p>VALID UP TO: 24-11-14</p> <p>REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG</p> <p>APPROVED BY Dt... Vikram Talwar N.T.P.C., Kharagpur</p>														
1	2	3	4	5	6	7	8	9						
		3. Direction of lay	MA	Visual	One sample/Setting of each size	IS 1554 (Part 1)	IS 1554 (Part 1)	QCR		P				11
		4. Coverage & Quality of armouring	MA	Meas.	100%		Min. area of coverage of armouring shall be 90%. The gap between amour wires / formed wires shall not exceed one amour wire/ formed wire space & there shall be no cross over/ over riding of amour wire / formed wire. Zn rich paint shall be applied on amour joint surface of G.S. Wire /formed wire. The breaking load of amour wire joint shall not be less than 95% of that amour wire / formed wire. (As per NTPC specification)	--do--		P				
		5 Dia over armouring	MA	Meas.	One sample/Setting of each size	NTPC ADS	NTPC ADS	--do--		P				
2.07	Outer Sheath	1. Surface finish	MA	Visual	100%		Pimple, Fish Eye, Burnt particles, Blow Hole not permitted. Repairing on outer sheath not permitted. (As per NTPC specification)	--do--		P				PVC FRLS compound shall be preferably loaded in to extruder by suction method.
		2. Colour of sheath	MA	Visual	One sample/Setting of each size	NTPC ADS	NTPC ADS	--do--		P				
		3. Dia over outer sheath	MA	Meas	--do--		--do--	--do--		P				
		4. Thickness of outer sheath	CR	Meas	--do--		--do--	--do--		P				
		5. Embossing quality	MA	Visual	100%		Drum no., IS1554 Part-1, Cable size, Voltage grade & Words "FRLS" at every 5 meter is to be embossed. Embossing shall be automatic, in line & marking shall be legible & indelible. (As per NTPC specification)	--do--		P				Drum no. on cable may be embossed/ printed.

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M:-MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO:QS-01-QA1-P-10/F3-R1

Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	APPROVED BY			Remarks	
					M	C/N				D*	M	E		N
<p>Item: 1.1 KV PVC Insulated FRLS Control cables</p> <p>STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART I AND NTPC TECHNICAL SPECIFICATION)</p> <p>REVISED BY: INDERJIT SINGH, VIKRAM TALWAR, RAJEEV GARG</p> <p>APPROVED BY: [Signature]</p> <p>Q.P. NO. 0000-999-QOE-S-040 REV-00 DATE: 25-11-11 Page 5 of 9</p> <p>VALID UP TO: 24-11-14</p>														
1	2	6. Sequential marking	4 MA	5 Visual	6 Full length	--	7	8	9	10	11			
<p>Sequential marking of length of cable in meter at every one meter is to be embossed / printed. Embossing / printing shall be progressive, automatic, in line & marking shall be legible & indelible. (A s per NTPC specification)</p>														
C Finished Cables														
3.01	Type test reports clearance from NTPC Engineering Routine Tests	All type tests as per NTPC specification	CR	Doc.	100%	100%	NTPC SPECIFICATION / NTPC ADS / IS 1554 (Part I)	NTPC SPECIFICATION / NTPC ADS / IS 1554 (Part I)	--do--	✓	P	V	V	
3.02	1.High Voltage test at room temperature	1.High Voltage test at room temperature	CR	Elect	100%	100%	NTPC ADS / IS 1554 (Part I)	NTPC ADS / IS 1554 (Part I)	Test certificate	✓	P	W	W	Refer note 2
3.02	2.Conductor Resistance	2.Conductor Resistance	CR	Elect	100%	100%	NTPC ADS / IS 1554 (Part I)	NTPC ADS / IS 1554 (Part I)	--do--	✓	P	W	W	
3.03 Acceptance Tests														
3.03(i)	Construction of finished Cable	1. OD of Cable	MA	Meas.	Each type & size of cables as per sampling plan of IS 1554 (Part I)		NTPC ADS	NTPC ADS	--do--	✓	P	W	W	
		2. Laying of core	CR	Visual	--do--	--do--	IS 1554 (Part I)	NTPC ADS / IS 1554 (Part I)	--do--	✓	P	W	W	
		3. Core Identification	CR	Visual	--do--	--do--	--do--	--do--	--do--	✓	P	W	W	Core printing shall be legible & indelible
		4. Colour of outer sheath	MA	Visual	--do--	--do--	NTPC ADS	NTPC ADS	--do--	✓	P	W	W	
		5. Inner sheath thickness	CR	Meas	- do -	- do -	--do--	--do--	--do--	✓	P	W	W	
		6. Inner sheath colour	MA	Visual	- do -	- do -	- do -	- do -	--do--	✓	P	W	W	
3.03 (ii)	Armour wires/ Formed wires (if applicable)	1. Dimensions	CR	Meas	Each type & size of cables as per sampling plan of IS 1554 (Part I)		NTPC ADS /IS1554(Part I)/IS3975	NTPC ADS /IS1554(Part I)/ IS3975	--do--	✓	P	W	W	
		2. No. of wires/ formed wire	CR	Mech	-- do --	-- do --	--do--	--do--	--do--	✓	P	W	W	
		3. Tensile test	CR	Mech	--do--	--do--	--do--	--do--	--do--	✓	P	W	W	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO:QS-01-QAI-P-10/F3-RI


Sl. No	Component & Operations	Characteristics	STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART 1 AND NTPC TECHNICAL SPECIFICATION)		Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	APPROVED BY				Remarks
			Class	Type of check		M	C/N				D*	M	C	N	
1	Item: 1.1 KV PVC Insulated FRLS Control cables	3	4	5	6	7	8	9	10	11	REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG APPROVED BY A.K. GARG				
3.03 (iii)	Conductor	4. Elongation test 5. Torsion test (for round wires only) 6. Wrapping test 7. Resistance test 8. Mass of Zinc coating 9. Uniformity of Zinc Coating 10. Adhesion test 11. Freedom from defects	CR	Mech	Each type & size of cables as per sampling plan of IS 1554 (Part 1) --do--	NTPC ADS /IS1554(Part1)/IS3975 --do--	NTPC ADS /IS1554(Part1)/IS3975 --do--	Test certificate --do--	✓	P	W	W	W	11	
3.03 (iv)	PVC Insulation & PVC Sheath	1. Annealing Test 2. Resistance Test 1. Thickness of insulation & sheath 2. Tensile strength & elongation at break of insulation & outer sheath (before ageing) 3. Tensile strength & elongation at break of insulation & outer sheath (after Ageing) 4. Insulation resistance (Volume resistivity method) 5. High voltage test at room temperature 6. Thermal stability on PVC Insulation and outer sheath 7. Oxygen index Test on outer sheath 8. Smoke density rating test on outer sheath	CR	Mech Elect Meas. Mech	Refer Note 3 --do-- --do-- --do--	NTPC ADS/ IS 8130 --do-- NTPC ADS/ IS 1554(Part1) --do--	NTPC ADS/ IS 8130 --do-- NTPC ADS/ IS 1554(Part1) --do--	--do-- --do-- --do-- --do--	✓ ✓ ✓ ✓	P P P P	V W W W	V W W W	V W W W	Refer Sl. No. 2.01 Refer Note 3 also Refer Note 3	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M: MANUFACTURER/SUPPLIER, C: MAIN SUPPLIER, N: NTPC, P: PERFORM W: WITNESS, V: VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO: QS-01-QA1-P-10/F3-R1

Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency			Remarks
					M	C/N				D*	M	C	
<p>Item: 1.1 KV PVC Insulated FRLS Control cables</p> <p>STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART 1 AND NTPC TECHNICAL SPECIFICATION)</p> <p>CP. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 7 of 9</p> <p>VALID UP TO: 24-11-14</p> <p>REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJNEESH GARG</p> <p>APPROVED BY A.K. Garg</p>													
1	2	9. Acid gas generation test on outer sheath 10. Flammability test on completed cable 11. Surface finish & length measurement.	4 CR	5 Chem	6 One sample of each offered lot of all offered sizes	7 NTPC ADS & IEC 60754-1	8 NTPC ADS	9 Test certificate	✓	P	W	W	11
		12. Sequence of cores armour coverage, gap between two consecutive armour/formed wire	CR	Visual & Meas	One length of each size	Refer Note 4 One length of each size	NTPC ADS & IEC 60332 Part-3 (Category-B) (1) Drum no. (2) IS 1554 -Part-1 (3) Cable size, Voltage grade & Words "FRLS" at every 5 meter is to be embossed. Embossing shall be automatic, in line & marking shall be legible & indelible. (4) Sequential marking of length of cable in meter at every one meter is to be embossed / printed. Embossing / printing shall be progressive, automatic, in line & marking shall be legible & indelible	--do--	✓	P	W	W	Pimple, Fish Eye, Burnt particles, Blow Hole etc. not permitted. Repairing on outer sheath not permitted.
4	Packing	1. Sealing	MA	Visual	100%	100%	Min. area of coverage of armouring shall be 90%. The gap between armour wires / formed wires shall not exceed one armour wire/ formed wire space & there shall be no cross over/ over riding of armour wire / formed wire. Zn rich paint shall be applied on armour joint surface of G.S. Wire /formed wire	--do--	✓	P	W	W	
4.01	Identification	NTPC Sealing	MA	Visual	100%	100%	(1) IS1554(Part-1) (2) The surface of the drum and the outer most cable layer shall be covered with water proof cover. (3) Both the ends of cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by "U" nails. Sealing shall be visible	QCR	✓	P	--	--	
			MA	Visual	100%	100%	Sealing shall be visible	Sealing shall be visible	✓	P	V	V	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M-MANUFACTURER/SUPPLIER, C-MAIN SUPPLIER, N:NTPC, P-PERFORM W:WITNESS,V-VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO:QS-01-QAI-P-10/F3-R1

**BHEL QP APPLICABLE FOR
TYPE TEST**



		QUALITY PLAN			CUSTOMER :		PROJECT : 3X660 MW NORTH KARANPURA		SPECIFICATION :			
					BIDDER/ VENDOR :		TITLE QUALITY PLAN NUMBER PE-QP-999-507-E003, R-1		NUMBER : TECHNICAL SPECIFICATION TITLE FOR LT PVC CONTROL CABLE			
		SHEET 5 of 8			SYSTEM		ITEM : LT PVC CONTROL CABLE		SECTION VOLUME III			
SL. NO.	COMPONENT/OPERATION	CHARACTERISTICS CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS
									P	W	V	
1	2	3	4	5	6	7	8	9	10			11
3.0	Final Inspection	6. Type Tests (Refer Note-A)	CR	Phy & Elect. Tests FRLS Tests	Sample#	BHEL Specn. Apprd.Data Sheet	BHEL Specn. Apprd.Data Sheet	Test Report	2	1	-	# Refer Annexure -A to QAP enclosed.
NOTES:- (A) FOR LISTS OF ROUTINE TESTS , ACCEPTANCE TESTS & TYPE TESTS REFER ANNEXURE TO QAP. LEGEND : P : PERFORMER W: WITNESSER V: VERIFIER 1- BHEL 2-VENDOR 3- SUB VENDOR CHP: CUSTOMER HOLD POINT WHICH WILL BE DECIDED AT CONTRACT STAGE.												
			PARTICULARS			BIDDER/VENDOR						
BHEL			NAME									
			SIGNATURE									
			DATE						BIDDER'S/VENDORS COMPANY SEAL			

Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check	Q.P. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 8 of 9 VALID UP TO: 24-11-14 Reference Document	REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG	APPROVED BY A.K. Garg	Remarks
	Item: 1.1 KV PVC Insulated FRLS Control cables				STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART 1 AND NTPC TECHNICAL SPECIFICATION)				
Notes:									
1)		If the compound manufacturer is carrying out Ageing test , test report of compound manufacturer is to be reviewed. If the compound manufacturer is not carrying out ageing test, then cable manufacturer is to carry out ageing test & test report is to be reviewed (quantum of ageing test sample shall be one sample /batch)							
2)		(a) In case of manufacturers / supplier who have supplied cables in the past through Corporate Centre/ Regional Offices :- Routine Test of manufacturer internal test report are to be verified by NTPC at the time of final inspection. 2(b) In case of manufacturers / supplier WHO HAVE NOT SUPPLIED cables in the past through Corporate Centre/ Regional Offices, :- Routine Test are to be witnessed by Main Contractor & NTPC. This is in addition to manufacturer internal test report to be verified by NTPC at the time of final inspection. Refer table on page 8 of 8 for Sampling & Acceptance criteria.							
3)									
4)		The test shall be carried out on every size & type of control cable offered for inspection as an acceptance test. This test will be carried out using composite sampling i.e. irrespective of sizes of cables of a particular type, may be tested together as per calculations in line with the IEC (all sizes will be covered)							
		LEGEND: NTPC ADS: NTPC approved data sheet, QCR: quality control records of cable manufacturer, CABLE MANUF STD- cable manufacturer's internal plant standard, MI: minor, MA: major, CR: critical, COC- certificate of conformance							

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURE/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

	Item: 1.1 KV PVC Insulated FRLS Control cables		STANDARD QUALITY PLAN (CONFORMING TO CODE: IS 1554 PART I AND NTPC TECHNICAL SPECIFICATION)		QP. NO. 0000-999- QOE- S-040 REV-00 DATE: 25-11-11 Page 9 of 9 VALID UP TO: 24-11-14 Reference Document	REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG	APPROVED BY  A.K. Garg		
	Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check	Acceptance Norms	Record Format	Agency



SAMPLING & ACCEPTANCE CRITERIA

Criteria	Manufacturer experience prerequisite	Condition	Testing procedure	Remarks
Samples as per relevant IS from every size of cable in the offered lot shall be tested for Tensile Strength & Elongation (before ageing). The values will be compared with corresponding values mentioned in the Type Test report accepted by NTPC. These values of Tensile Strength & Elongation (before ageing) should be within +/- 15% tolerance (final values should be more than the minimum values indicated in relevant standard) of the Type Test report	In case of Manufacturers/ Supplier who have supplied cables in the past through Corporate Centre / Regional offices	In case of sizes which meet the criteria	1 Sample per type out of sizes which have met the criteria, will be put on accelerated ageing test (refer IRS specification no. IRS: S-63/2007 Rev 3.0). The samples shall be aged in air oven at temperature of 130°C +/- 2°C for 5 hours. After wards the samples shall be tested for Tensile Strength & Elongation. Acceptance norms shall be as per relevant IS. This test shall be witnessed by NTPC.	In case the samples do not meet the requirement in accelerated ageing test then 1 sample of that size will be put on ageing test as per IS.
		In case of size which do not meet the criteria	Particular size will be put on ageing test as per IS. This test shall be witnessed by NTPC.	----
	In case of Manufacturers/ Supplier WHO HAVE NOT SUPPLIED cables in the past through Corporate Centre / Regional offices	In case of size which meet the criteria	1 Sample per type out of all sizes which have met the criteria, will be put on aging test and witnessed by NTPC as per relevant IS	----
		In case of size which do not meet the criteria	Particular size will be put on ageing test as per IS. This test shall be witnessed by NTPC	----

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP:NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"
 FORMAT NO:QS-01-QA1-P-10/F3-R1



ANNEXURE A TO SECTION II

(Sheet 1 of 2)

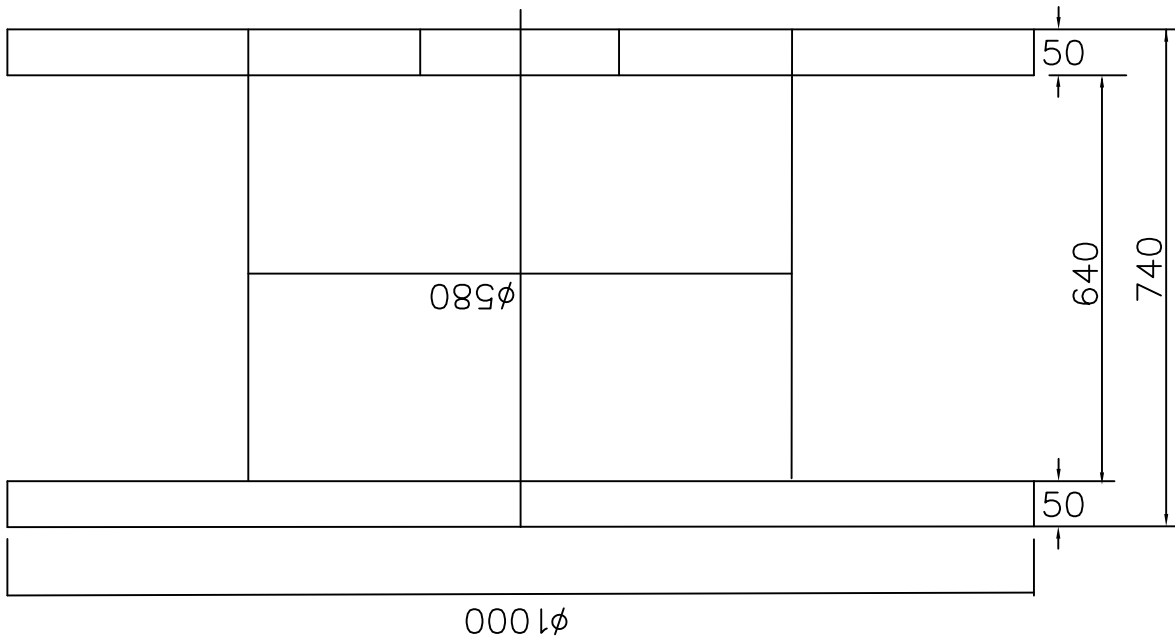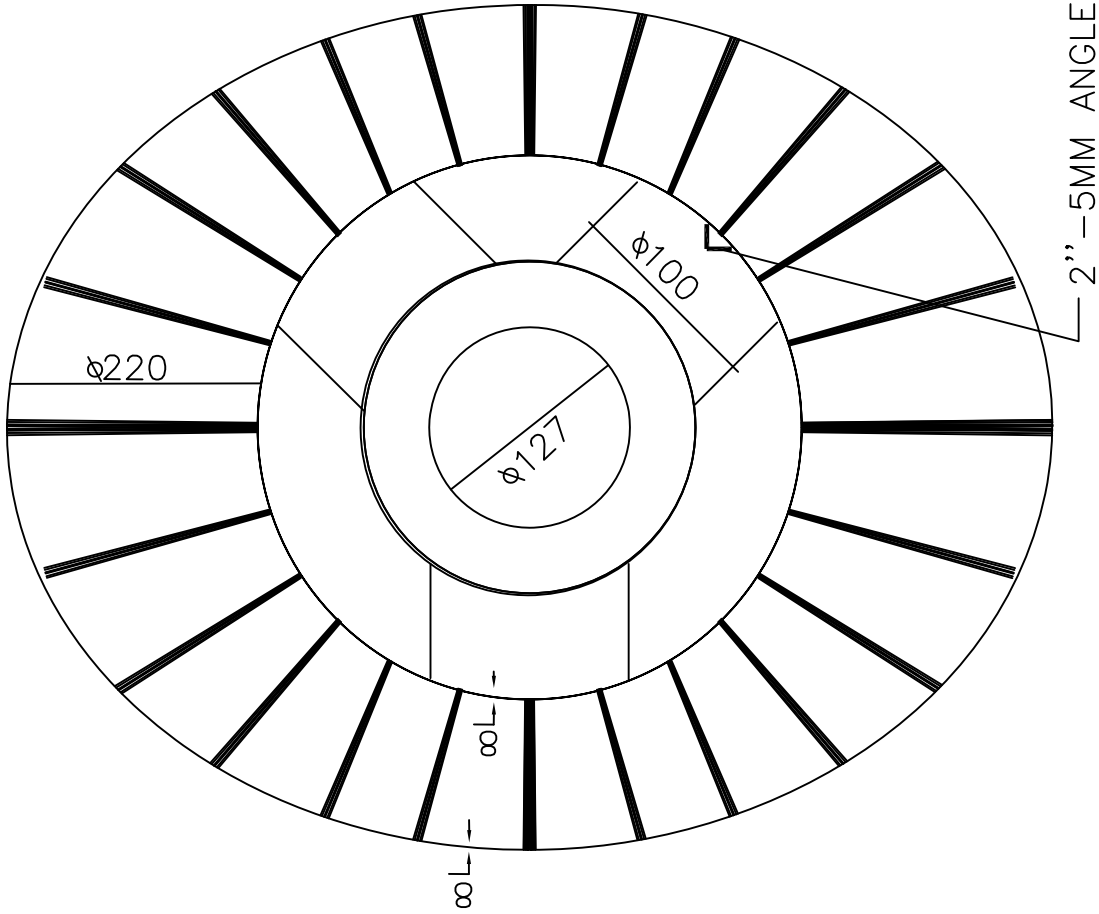

DIMENSION in mm

ANNEXURE A TO SECTION II

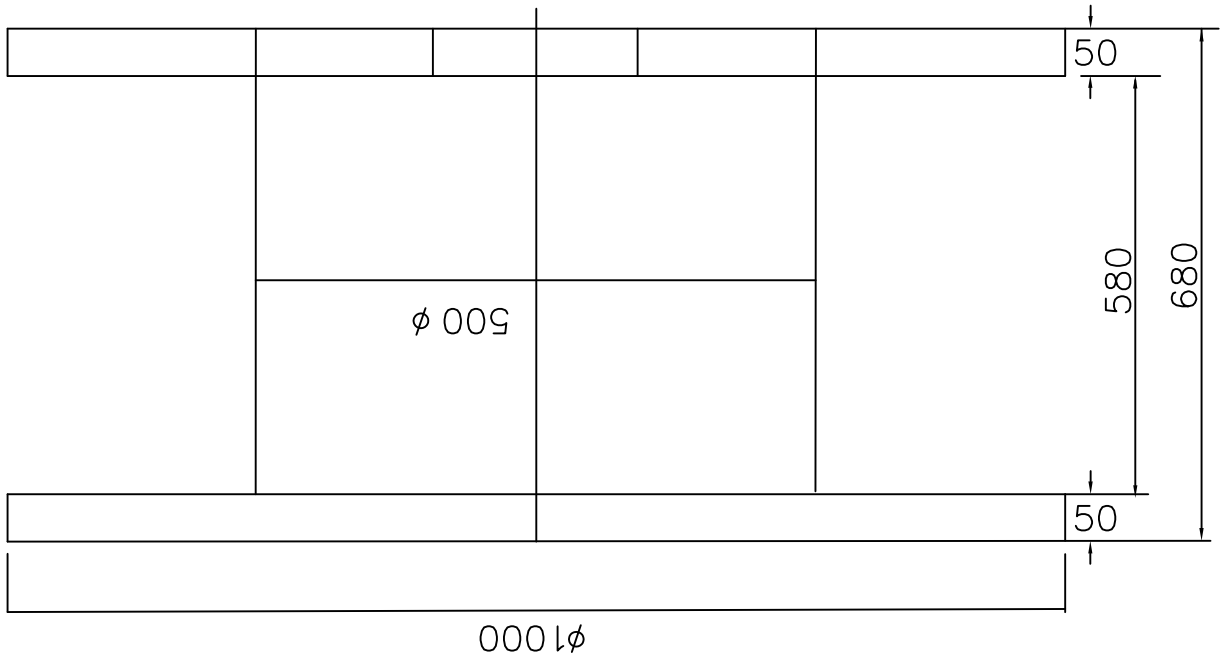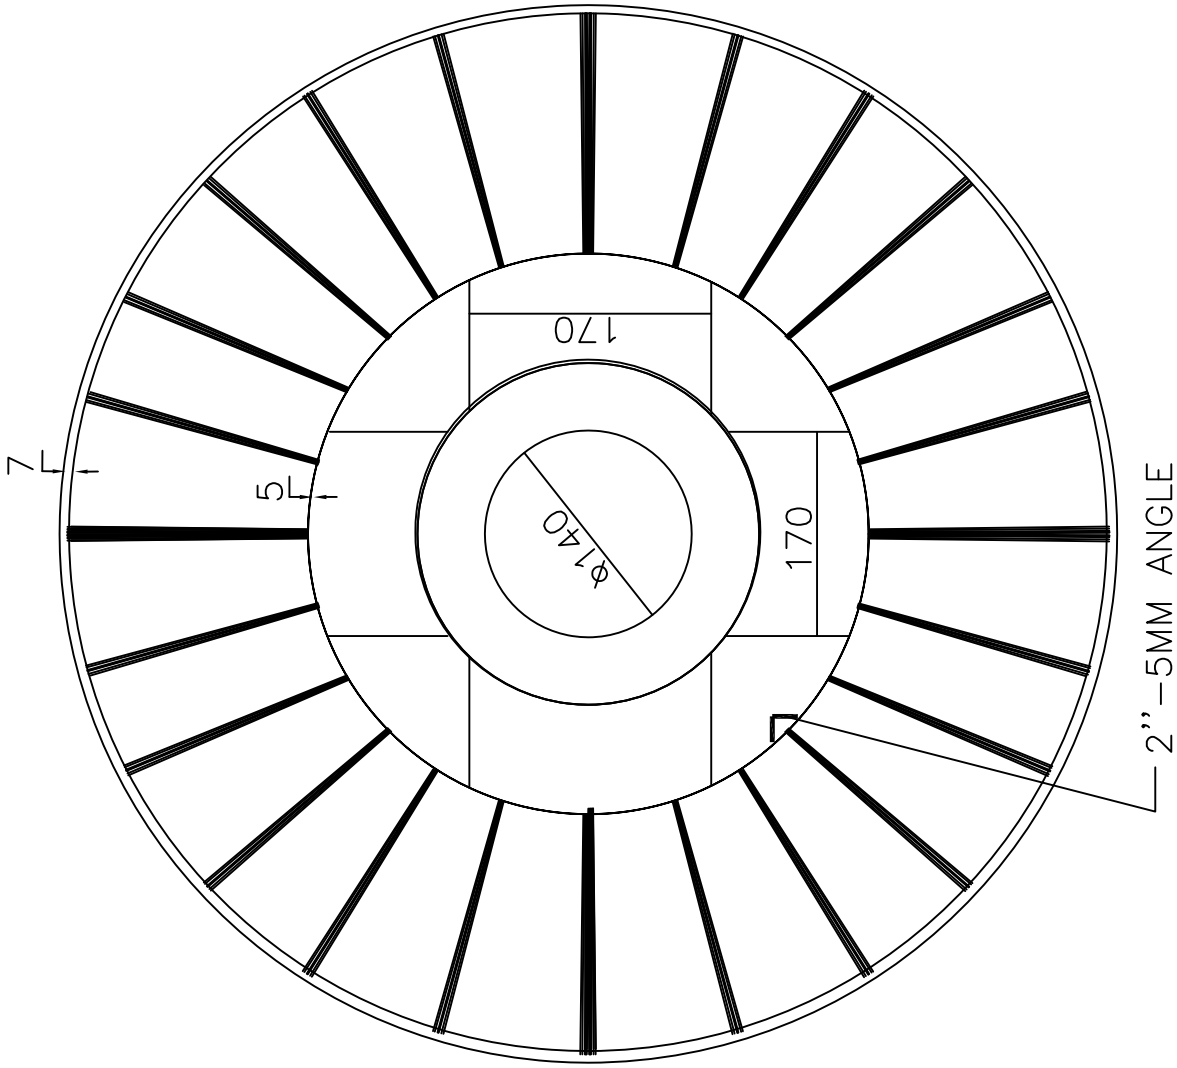

DIMENSION in mm

एनटीपीसी NTPC	CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली
--------------------------	---

i.	Item/Scope of Sub-contracting उप-संविदा(अनुबंध) का मद/ दायरा	
ii.	Address of the registered office पंजीकृत कार्यालय का पता	Details of Contact Person संपर्क व्यक्ति का विवरण (Name, Designation, Mobile, Email) (नाम, पदनाम, मोबाइल, ईमेल)
iii.	Name and Address of the proposed Sub-vendor's works where item is being manufactured प्रस्तावित उप-विक्रेता के कार्यों का नाम और पता, जहां मद का निर्माण किया जा रहा है	Details of Contact Person: संपर्क व्यक्ति का विवरण (Name, Designation, Mobile, Email) (नाम, पदनाम, मोबाइल, ईमेल)
iv.	Annual Production Capacity for proposed item/scope of sub-contracting उप-संविदा(अनुबंध) के प्रस्तावित मद / दायरे के लिए वार्षिक उत्पादन क्षमता	
v.	Annual production for last 3 years for proposed item/scope of sub-contracting उप-संविदा(अनुबंध) के प्रस्तावित मद / दायरे के लिए पिछले 3 वर्षों का वार्षिक उत्पादन	
vi.	Details of proposed works प्रस्तावित कार्यों का विवरण	
1.	Year of establishment of present works वर्तमान फैक्टरी की स्थापना का वर्ष	
2.	Year of commencement of manufacturing at above works उपरोक्त फैक्टरी में निर्माण कार्य शुरू होने का वर्ष	
3.	Details of change in Works address in past (if any) पूर्व में फैक्टरी स्थल में परिवर्तन का विवरण (यदि कोई हो)	
4.	Total Area कुल क्षेत्र	
	Covered Area शामिल क्षेत्र	
5.	Factory Registration Certificate फैक्टरी पंजीकरण प्रमाण पत्र	Details attached at Annexure – F2.1 विवरण अनुलग्नक- एफ 2.1 पर संलग्न है
6.	Design/ Research & development set-up डिजाइन / अनुसंधान और विकास सेटअप (No. of manpower, their qualification, machines & tools employed etc.) (श्रमिकों की संख्या, उनकी योग्यता, मशीन और उपलब्ध उपकरण आदि)	Applicable / Not applicable if manufacturing is as per Main Contractor/purchaser design) Details attached at Annexure – F2.2 (if applicable) लागू / लागू नहीं, अगर विनिर्माण मुख्य संविदाकार / खरीददार के डिजाइन के अनुसार है) विवरण अनुलग्नक –एफ 2.2 पर संलग्न है। (यदि लागू हो)
7.	Overall organization Chart with Manpower Details (Design/Manufacturing/Quality etc) मैनपावर विवरण के साथ समग्र संगठन का चार्ट(डिजाइन / विनिर्माण / गुणवत्ता आदि)	Details attached at Annexure – F2.3 विवरण अनुलग्नक – F2.3 में संलग्न है।



CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन
SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली

8.	After sales service set up in India, in case of foreign sub-vendor(Location, Contact Person, Contact details etc.) भारत में बिक्री सेवा की स्थापना के बाद, विदेशी उप-विक्रेता के मामले में(स्थल , संपर्क व्यक्ति, संपर्क विवरण आदि)	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.4 विवरण अनुलग्नक -2.4 पर संलग्न है।			
9.	Manufacturing process execution plan with flow chart indicating various stages of manufacturing from raw material to finished product including outsourced process, if any फ्लोचार्ट सहित विनिर्माण प्रक्रिया निष्पादन योजना , जिसमें आउटसोर्स प्रक्रिया, यदि कोई हो, सहित कच्चे माल से तैयार उत्पाद तक विनिर्माण के विभिन्न चरणों को दर्शाया गया हो,	Details attached at Annexure – F2.5 विवरण अनुलग्नक - F2.5में संलग्न है।			
10.	Sources of Raw Material/Major Bought Out Item कच्चे माल के स्रोत / खरीदे हुए मुख्य मद	Details attached at Annexure – F2.6 विवरण अनुलग्नक - F2.6में संलग्न है।			
11.	Quality Control exercised during receipt of raw material/BOI, in-process , Final Testing, packing कच्चे माल / खरीदे हुए मद, प्रक्रियाबद्ध, अंतिम परीक्षण, पैकिंग करते समय गुणवत्ता नियंत्रण	Details attached at Annexure – F2.7 विवरण अनुलग्नक - F2.7 पर संलग्न है			
12.	Manufacturing facilities (List of machines, special process facilities, material handling etc.) विनिर्माण सुविधा(मशीनों की सूची, विशेष प्रक्रिया सुविधाएं, सामग्री रख-रखाव आदि)	Details attached at Annexure – F2.8 विवरण अनुलग्नक - F2.8में संलग्न है।			
13.	Testing facilities (List of testing equipment) परीक्षण सुविधाएं(परीक्षण उपकरण की सूची)	Details attached at Annexure – F2.9 विवरण अनुलग्नक – F2. 9 में संलग्न है।			
14.	If manufacturing process involves fabrication then- यदि निर्माण प्रक्रिया में फेब्रिकेशन की गई है तो- List of qualified Welders पात्र वेल्डर की सूची List of qualified NDT personnel with area of specialization विशेषज्ञता के क्षेत्र सहित पात्र एनडीटी कार्मिकों की सूची	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.10 विवरण अनुलग्नक - F2.10में संलग्न है। (if applicable) लागू / लागू नहीं			
15.	List of out-sourced manufacturing processes with Sub-Vendors' names & addresses सब-वेंडर द्वारा बाह्य स्रोतों (उनके नाम और पते सहित)से करवाएं गए निर्माण प्रक्रियाओं की सूची	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure. –F2.11 विवरण अनुलग्नक - F2.10में संलग्न है। (if applicable) (यदि लागू हो)			
16.	Supply reference list including recent supplies नवीनतम आपूर्ति सहित आपूर्ति संदर्भ सूची	Details attached at Annexure – F2.12 विवरण अनुलग्नक - F2.12 में संलग्न है। (as per format given below) (नीचे दिए गए प्रारूप के अनुसार)			
Project/ package परियोजना /पैकेज	Customer Name ग्राहक का नाम	Supplied Item (Type/Rating/Model /Capacity/Size etc) आपूर्ति की गई वस्तु (प्रकार / रेटिंग / मॉडल / क्षमता / आकार आदि)	PO ref no/date पीओ संदर्भ सं. / तिथि	Supplied Quantity आपूर्ति की मात्रा	Date of Supply आपूर्ति की तारीख
17.	Product satisfactory performance feedback letter/certificates/End User Feedback उत्पाद के संतोषजनक प्रदर्शन संबंधी फीडबैक पत्र / प्रमाण पत्र / अंतिम उपयोगकर्ता फीडबैक	Attached at annexure - F2.13 अनुलग्नक F2. 3पर संलग्न है			



CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन
SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली

18.	Summary of Type Test Report (Type Test Details, Report No, Agency, Date of testing) for the proposed product (similar or higher rating) प्रस्तावित उत्पाद (एक समान या उच्च रेटिंग वाले) के लिए टाइप टेस्ट रिपोर्ट (टाइप टेस्ट विवरण, रिपोर्ट संख्या, एजेंसी, जांच की तारीख) का सारांश नोट: - रिपोर्ट प्रस्तुत करने की आवश्यकता नहीं है Note:- Reports need not to be submitted	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.14 विवरण अनुलग्नक - F2.1 4में संलग्न है (if applicable) (यदि लागू हो)
19.	Statutory / mandatory certification for the proposed product प्रस्तावित उत्पाद के लिए वैधानिक / अनिवार्य प्रमाणीकरण	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.15 (if applicable) (यदि लागू हो)
20.	Copy of ISO 9001 certificate आईएसओ 9001 प्रमाण पत्र की प्रति (if available) (यदि उपलब्ध हो)	Attached at Annexure – F2.16 अनुलग्नक में संलग्न - F2.1 6 है
21.	Product technical catalogues for proposed item (if available) प्रस्तावित मद के लिए उत्पाद तकनीकी कैटलॉग (यदि उपलब्ध हो)	Details attached at Annexure – F2.17 विवरण अनुलग्नक - F2.1 7 में संलग्न है
Name: Desig: Sign: Date: नाम: पद: हस्ता तिथि: क्षर:		

Company's Seal/Stamp:- कंपनी की मुहर / मोहर: -



PVC ANNEXURE

ANNEXURE-C

Price Variation Formulae
3 X 660 MW NORTH KARANPURA
LT PVC CONTROL CABLE

1. Prices shall be variable as per following PVC formulae as per IEEMA. The price shall be limited to +20% of total Ex-works price actually supplied (cable size wise) & -ve price variation shall be unlimited. PVC shall be limited for the metals for which rates published by IEEMA.

CABLE TYPE	CONDUCTOR	FORMULA	TABLE REF
LT PVC CONTROL CABLE	(Cu conductor,)	$P = P_0 + CuF (Cu - Cu_0) + CCFCu (PVCC - PVCC_0) + FeF (Fe - Fe_0)$	as applicable as per IEEMA

Note:

1. PVC shall be applicable for Order Qty. and subsequent lots (if any).
2. Base date for prices (as per IEEMA):

Initial Price:

Base date shall be **Feb-2022**

Final Price:

The first working day of month, one month prior to the **date of delivery**.

Note: The date of delivery is the date on which the cable is notified as being ready for inspection/dispatch (in the absence of such notification, the date of manufacturer's dispatch note is to be considered as the date of delivery) or the contracted delivery date (including any agreed extension thereto), whichever is earlier.

3. PVC shall be payable within agreed contractual delivery period. In case of delay is attributable to vendor, for the payment purpose, the PVC shall be calculated based on rates applicable as on the date of expiry of contractual delivery date or actual delivery date, whichever is beneficial to BHEL.



IEEMA table for Price variation cause for various type of cable

1. Aluminium conductor cable

S.No	Cable Type	AIF (Single core unarmoured & Multi core armoured)	AIF (Single core armoured)	CCFAI	XLFAL (Single core)	XLFAL (Multi core)	FeF	FeW	IEEMA Formula
1.	HT XLPE Power cable	ALP	H1	H2	XL3	XL4	H3	H5	$P = P_o + AIF(AL - A_{lo}) + XLFAL(CC - CC_o) + CCFAI(PVCC - PVCC_o) + FeF(Fe - Fe_o)$
2.	LT XLPE Power Cable	ALP	P1	L2	XL1	XL1	P3	P3 (Additional)	$P = P_o + AIF(AL - A_{lo}) + XLFAL(CC - CC_o) + CCFAI(PVCC - PVCC_o) + FeF(Fe - Fe_o)$
3.	LT PVC Power Cable	ALP	P1	P2	-	-	P3	P3 (Additional)	$P = P_o + AIF(AL - A_{lo}) + CCFAI(PVCC - PVCC_o) + FeF(Fe - Fe_o)$
4.	LT HRPVC Power Cable	ALP	P1	P2	-	-	P3	P3 (Additional)	$P = P_o + AIF(AL - A_{lo}) + CCFAI(PVCC - PVCC_o) + FeF(Fe - Fe_o)$

2. Copper conductor cable

S no.	Cable type	CuF	AIF (single core armoured)	CCFCu	XLFCU (Single core)	XLFCU (Multi core)	FeF	FeW	IEEMA Formula
1	HT XLPE Power cable	CUP	H4	H2	XL3	XL4	H3	H5	$P = P_o + CuF(Cu - Cu_o) + XLFCU(CC - CC_o) + CCFCu(PVCC - PVCC_o) + FeF(Fe - Fe_o) + AIF(AL - A_{lo})$
2	LT XLPE Power Cable	CUP	P4	L2	XL1	XL1	P3	P3 (Additional)	$P = P_o + CuF(Cu - Cu_o) + XLFCU(CC - CC_o) + CCFCu(PVCC - PVCC_o) + FeF(Fe - Fe_o) + AIF(AL - A_{lo})$

S no.	Cable type	CuF	AIF (single core armoured)	CCFCu	XLFCU (Single core)	XLFCU (Multi core)	FeF	FeW	IEEMA Formula
3	LT PVC Power Cable	CUP	P4	P2	--	--	P3	P3 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
4	LT HRPVC Power Cable	CUP	P4	P2	--	--	P3	P3 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
5	LT XLPE Control Cable	CUC	--	P5	--	XL2	P6	P6 (Additional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
6	LT PVC Control Cable	CUC	--	P5	--	--	P6	P6 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
7	LT HRPVC Control Cable	CUC	--	P5	--	--	P6	P6 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
8	LT XLPE Fire Survival Power Cable	CUP	P4	L2	XL1	XL1	P3	P3 (Additional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
9	LT XLPE Fire Survival Control	CUC	--	P5	--	XL2	P6	P6 (Additional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
10	LT EPR Fire Survival Power Cable	CUP	P4	L2	--	--	P3	P3 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
11	LT EPR Fire Survival Control cable	CUC	--	P5	--	--	P6	P6 (Additional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
12	Screened control Cable (Overall screen)	Cu POS	--	--	--	--	Fe POS	Fe POS	$P=Po+CuF(Cu-Cuo) + FeF(Fe-Feo)$
13	Screened control Cable (Individual	Cu PIS	--	--	--	--	Fe PIS	Fe PIS	$P=Po+CuF(Cu-Cuo) + FeF(Fe-Feo)$

IEEMA Table for Price Variation Clause for various types of CablesNotes:-

- (i) Cu POS, Cu PIS, Fe POS & Fe PIS tables shall be as per IEEMA circular No. IEEMA (PVC) /Instrumentation Cable/2014 effective from dtd 01.07.2014.
- (ii) All other tables shall be as per IEEMA circular No. 35//DIV/CAB/05/ dated 24.04.2018.

Terms used in PVC formulae:

P = Price payable as adjusted in accordance with above appropriate formula (In Rs./Km).
 Po= Price quoted/confined (in Rs./km).

1. ALUMINIUM

ALF = Variation factor for aluminium.
 Al = Price of aluminium.
 Alo = Price of aluminium.

2 COPPER

CuF = Variation factor for copper.
 Cu = Price of CC copper rods.
 Cuo = Price of CC copper rods.

3.PVCc COMPOUND/POLYMER

PVCc = Price of PVC compound.
 PVCco= Price of PVC compound.
 CCFAL= Variation factor for PVC compound/Polymer for aluminium conductor cable.
 CCFCu = Variation factor for PVC compound/Polymer for copper conductor cable.

4. XLPE COMPOUND

Cc = Price of XLPE compound.
 Cco= Price of XLPE compound.
 XLFAL= Variation factor for XLPE compound for aluminium conductor cable.
 XLFCu = Variation factor for XLPE compound for copper conductor cable.

5.STEEL

Fe= Price of steel strips/steel wire.
 Feo= Price of steel strips/steel wire.
 FeF = Variation factor for steel.
 FeW= Variation factor for round wire steel armouring.



501, Kasad Chambers
132, Dr. Amie Besant Road, Worli
Mumbai 400018
India

P: +91 22 2693 0532
F: +91 22 2693 2705
E: mumbai@ieema.org
www.ieema.org

IEEMA (PVC)/Instrumentation Cable/2014

Effective from: 1st July 2014

Material Price Variation Clause For Instrumentation Cables

The Price quoted/confirmed is based on the input cost of raw materials/components as on the date of quotation, and the same is deemed to be related to the prices of raw materials as specified in the price variation clause given below. In case of any variation in these prices, the price payable shall be subject to adjustment up or down in accordance with the formulae provided in this document.

Terms used in price variation formulae:

P Price payable as adjusted in accordance with above appropriate formula (In Rs/Km)

P₀ Price quoted/confirmed (InRs/Km)

COPPER

Cu_F Variation factor for copper

Cu Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cu_t Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of tendering.

STEEL

Fe_F Variation factor for steel

Fe Price of Steel Strip/steel wire. This price is as applicable on the first working day of the month, one month prior to the date of delivery.

Fe_t Price of steel strips/steel wire. This price is as applicable on first working day of the month, one month prior to the date of tendering.

The above prices and indices are as published by IEEMA vide Circular reference IEEMA(PVC)/CABLE/--- prevailing as on 1st working day of the month i.e. one month prior to the date of tendering.

The date of delivery is the date on which the cable is notified as being ready for inspection/dispatch (in the absence of such notification, the date of manufacturer's dispatch note is to be considered as the date of delivery) or the contracted delivery date (including any agreed extension thereto), whichever is earlier.

Page 1 of 2

New Delhi
Rishyanook Building, First Floor
85 A, Panchsheel Road
New Delhi 110001, India
P: +91 11 2336 3013/14
F: +91 11 2336 3015
E: delhi@ieema.org

Bangalore
204, Swiss Complex
33, Race Course Road
Bangalore 560001, India
P: +91 80 2220 1316/18
F: +91 80 2220 1317
E: bangalore@ieema.org

Kolkata
503A, Oswal Chambers
2, Church Lane
Kolkata 700001, India
P: +91 33 650 7855
F: +91 33 2213 1326
E: kolkata@ieema.org

Indian Electrical & Electronics Manufacturers' Association



IEEMA (PVC)/Instrumentation Cable/2014

Effective from: 1st July 2014

Notes

- (a) All prices of raw materials are exclusive of modvatable excise/CV duty amount and exclusive of any other central, state or local taxes, octroi, etc.
- (b) All Prices are as on first working day of the month.
- (c) The details of prices are as under:
 - 1. Price of CC copper rods (in Rs/MT) is ex-works price as quoted by the primary producer.
 - 2. Price of galvanized steel strip / steel wire (in Rs/MT) is ex-works price as quoted by the manufacturer for Round steel Wire and Flat steel strip (the relevant price of steel strip or steel wire is to be selected depending upon the type of armouring of the cable).

Price Variation formula for 'Instrumentation Cables'

$$P = P_0 + CuF (Cu - Cu_0) + FeF (Fe - Fe_0)$$

- 1. For Pair Instrumentation Over all Screen Cables

Tables References:

Cu POS Copper Factor
Fe POS Steel Factor

- 2. For Pair Instrumentation Individual and Over all Screen Cables

Tables References:

Cu PIS Copper Factor
Fe PIS Steel Factor

- 3. For Triad Instrumentation Over all Screen Cables

Tables References:

Cu TOS Copper Factor
Fe TOS Steel Factor

- 4. For Triad Instrumentation Individual & Overall Screen Cables

Tables References:

Cs TIS Copper Factor
Fe TIS Steel Factor


Deputy Director General
Page 2 of 2

Copper Factors for Instrumentation Cables - CuF

Cu POS

Pair Instrumentation Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.0142	0.0185	0.0233	0.0326	0.0500
2	0.0258	0.0345	0.0440	0.0625	0.0978
3	0.0353	0.0484	0.0626	0.0904	0.1433
4	0.0448	0.0623	0.0811	0.1183	0.1888
5	0.0578	0.0800	0.1022	0.1467	0.2356
6	0.0652	0.0928	0.1210	0.1768	0.2829
7	0.0756	0.1057	0.1378	0.2000	0.3245
8	0.0852	0.1204	0.1582	0.2327	0.3741
9	0.0933	0.1334	0.1734	0.2534	0.4134
10	0.1046	0.1485	0.1959	0.2893	0.4685
11	0.1111	0.1600	0.2089	0.3067	0.5023
12	0.1236	0.1784	0.2333	0.3452	0.5580
13	0.1289	0.1867	0.2445	0.3600	0.5912
14	0.1378	0.2000	0.2623	0.3867	0.6356
15	0.1467	0.2134	0.2800	0.4134	0.6801
16	0.1618	0.2322	0.3080	0.4573	0.7409
17	0.1645	0.2400	0.3156	0.4667	0.7590
18	0.1734	0.2534	0.3334	0.4934	0.8134
19	0.1822	0.2667	0.3512	0.5201	0.8579
20	0.1911	0.2800	0.3689	0.5467	0.9023
21	0.2000	0.2934	0.3867	0.5734	0.9468
22	0.2089	0.3067	0.4045	0.6001	0.9912
23	0.2178	0.3200	0.4223	0.6267	1.0357
24	0.2381	0.3437	0.4575	0.6813	1.1068
25	0.2356	0.3467	0.4578	0.6801	1.1246
26	0.2445	0.3600	0.4756	0.7068	1.1690
27	0.2534	0.3734	0.4934	0.7334	1.2135
28	0.2623	0.3867	0.5112	0.7601	1.2579
29	0.2711	0.4001	0.5290	0.7868	1.3024
30	0.2800	0.4134	0.5467	0.8134	1.3468
31	0.2889	0.4267	0.5645	0.8401	1.3913
32	0.2978	0.4401	0.5823	0.8668	1.4357
33	0.3067	0.4534	0.6001	0.8934	1.4802
34	0.3156	0.4667	0.6179	0.9201	1.5246
35	0.3245	0.4801	0.6356	0.9468	1.5691
36	0.3334	0.4934	0.6534	0.9735	1.6135
37	0.3423	0.5067	0.6712	1.0001	1.6580
38	0.3512	0.5201	0.6890	1.0268	1.7024
39	0.3600	0.5334	0.7068	1.0535	1.7469
40	0.3689	0.5467	0.7245	1.0801	1.7913
41	0.3778	0.5601	0.7423	1.1068	1.8358
42	0.3867	0.5734	0.7601	1.1335	1.8802
43	0.3956	0.5867	0.7779	1.1601	1.9247
44	0.4045	0.6001	0.7957	1.1868	1.9691
45	0.4134	0.6134	0.8134	1.2135	2.0136
46	0.4223	0.6267	0.8312	1.2402	2.0580
47	0.4312	0.6401	0.8490	1.2668	2.1025
48	0.4710	0.6759	0.9010	1.3410	2.2009



Copper Factors for Instrumentation Cables - CuF

Cu PIS

Pair Instrumentation Individual and Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.0133	0.0178	0.0222	0.0311	0.0409
2	0.0349	0.0437	0.0531	0.0717	0.1069
3	0.0490	0.0621	0.0763	0.1041	0.1670
4	0.0630	0.0806	0.0994	0.1389	0.2071
5	0.0800	0.1022	0.1245	0.1689	0.2576
6	0.0937	0.1200	0.1484	0.2042	0.3103
7	0.1067	0.1378	0.1689	0.2311	0.3556
8	0.1218	0.1569	0.1948	0.2692	0.4107
9	0.1334	0.1734	0.2134	0.2934	0.4534
10	0.1503	0.1943	0.2417	0.3349	0.5122
11	0.1600	0.2089	0.2578	0.3556	0.5512
12	0.1785	0.2313	0.2882	0.4001	0.6128
13	0.1867	0.2445	0.3023	0.4178	0.6490
14	0.2000	0.2623	0.3245	0.4489	0.6979
15	0.2134	0.2800	0.3467	0.4801	0.7468
16	0.2350	0.3053	0.3812	0.5305	0.8141
17	0.2400	0.3156	0.3912	0.5423	0.8448
18	0.2534	0.3334	0.4134	0.5734	0.8934
19	0.2667	0.3512	0.4356	0.6045	0.9423
20	0.2800	0.3689	0.4578	0.6356	0.9912
21	0.2934	0.3867	0.4801	0.6668	1.0401
22	0.3067	0.4045	0.5023	0.6979	1.0890
23	0.3200	0.4223	0.5245	0.7290	1.1379
24	0.3479	0.4535	0.5673	0.7911	1.2165
25	0.3467	0.4578	0.5690	0.7912	1.2357
26	0.3600	0.4758	0.5912	0.8223	1.2846
27	0.3734	0.4934	0.6134	0.8534	1.3335
28	0.3867	0.5112	0.6356	0.8846	1.3824
29	0.4001	0.5290	0.6579	0.9157	1.4313
30	0.4134	0.5467	0.6801	0.9468	1.4802
31	0.4267	0.5645	0.7023	0.9779	1.5291
32	0.4401	0.5823	0.7245	1.0090	1.5780
33	0.4534	0.6001	0.7468	1.0401	1.6269
34	0.4667	0.6179	0.7690	1.0712	1.6758
35	0.4801	0.6356	0.7912	1.1024	1.7247
36	0.4934	0.6534	0.8134	1.1335	1.7736
37	0.5067	0.6712	0.8357	1.1646	1.8225
38	0.5201	0.6890	0.8579	1.1957	1.8713
39	0.5334	0.7068	0.8801	1.2268	1.9202
40	0.5467	0.7245	0.9023	1.2579	1.9691
41	0.5601	0.7423	0.9246	1.2891	2.0180
42	0.5734	0.7601	0.9468	1.3202	2.0669
43	0.5867	0.7779	0.9690	1.3513	2.1158
44	0.6001	0.7957	0.9912	1.3824	2.1647
45	0.6134	0.8134	1.0135	1.4135	2.2136
46	0.6267	0.8312	1.0357	1.4446	2.2625
47	0.6401	0.8490	1.0579	1.4757	2.3114
48	0.6887	0.8936	1.1186	1.5587	2.4186



Steel Factors for Instrumentation Cables - FeF					
Fe POS					
Pair Instrumentation Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.1490	0.1565	0.1635	0.1735	0.1930
2	0.2190	0.2335	0.2470	0.2665	0.2595
3	0.2360	0.2545	0.2690	0.2900	0.2680
4	0.2390	0.2580	0.2715	0.2945	0.2830
5	0.2630	0.2820	0.2420	0.2805	0.3155
6	0.2840	0.3160	0.2805	0.2995	0.3430
7	0.2940	0.2595	0.2805	0.2995	0.3430
8	0.3235	0.2930	0.3030	0.3315	0.3780
9	0.2905	0.3180	0.3290	0.3590	0.4205
10	0.2970	0.3215	0.3455	0.3755	0.4385
11	0.3005	0.3255	0.3490	0.3805	0.4435
12	0.3055	0.3440	0.3690	0.3880	0.4520
13	0.3265	0.3530	0.3780	0.4105	0.4785
14	0.3265	0.3530	0.3760	0.4105	0.4785
15	0.3490	0.3765	0.4015	0.4365	0.5195
16	0.3490	0.3765	0.4015	0.4365	0.5195
17	0.3590	0.4005	0.4140	0.4635	0.5470
18	0.3590	0.4005	0.4265	0.4635	0.5470
19	0.3590	0.4005	0.4265	0.4635	0.5470
20	0.3830	0.4240	0.4535	0.4920	0.5760
21	0.3830	0.4240	0.4535	0.4920	0.5760
22	0.4065	0.4520	0.4785	0.5310	0.6190
23	0.4065	0.4520	0.4810	0.5310	0.6190
24	0.4305	0.4770	0.5070	0.5595	0.6475
25	0.4305	0.4770	0.5070	0.5595	0.6475
26	0.4305	0.4770	0.5070	0.5595	0.6475
27	0.4355	0.4820	0.5245	0.5660	0.6700
28	0.4570	0.5045	0.5345	0.5895	0.6950
29	0.4570	0.5045	0.5345	0.5895	0.6950
30	0.4570	0.5045	0.5345	0.5895	0.6950
31	0.4795	0.5285	0.5595	0.6150	0.7225
32	0.4820	0.5285	0.5595	0.6150	0.7225
33	0.4820	0.5285	0.5595	0.6150	0.7225
34	0.4920	0.5520	0.5835	0.6410	0.7500
35	0.4920	0.5520	0.5835	0.6410	0.7500
36	0.4920	0.5520	0.5835	0.6410	0.7500
37	0.4920	0.5520	0.5835	0.6410	0.7500
38	0.5145	0.5760	0.6225	0.6550	0.7805
39	0.5145	0.5760	0.6225	0.6550	0.7805
40	0.5145	0.5760	0.6225	0.6550	0.7805
41	0.5395	0.6025	0.6475	0.6975	0.8230
42	0.5395	0.6025	0.6475	0.6975	0.8230
43	0.5395	0.6025	0.6475	0.6975	0.8230
44	0.5635	0.6285	0.6735	0.7250	0.8540
45	0.5635	0.6285	0.6760	0.7250	0.8540
46	0.5635	0.6285	0.6760	0.7250	0.8540
47	0.5635	0.6285	0.6760	0.7250	0.8540
48	0.5635	0.6285	0.6760	0.7375	0.8855



Steel Factors for Instrumentation Cables - Fe^F

Fe PIS

Pair Instrumentation Individual and Over all Screen Cables

No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.1660	0.1980	0.2070	0.2220	0.2410
2	0.2315	0.2460	0.2595	0.2615	0.2755
3	0.2505	0.2690	0.2820	0.2495	0.2890
4	0.2645	0.2830	0.2420	0.2805	0.3155
5	0.2895	0.2730	0.2905	0.3005	0.3430
6	0.2755	0.2980	0.3005	0.3280	0.3750
7	0.2755	0.2980	0.3005	0.3280	0.3730
8	0.2980	0.3215	0.3435	0.3740	0.4230
9	0.3230	0.3490	0.3730	0.4040	0.4615
10	0.3405	0.3655	0.3765	0.4215	0.4885
11	0.3430	0.3690	0.3815	0.4265	0.4945
12	0.3490	0.3765	0.4015	0.4470	0.5160
13	0.3715	0.3990	0.4255	0.4720	0.5420
14	0.3715	0.3990	0.4255	0.4720	0.5420
15	0.3955	0.4240	0.4510	0.5020	0.5720
16	0.3955	0.4240	0.4510	0.5020	0.5720
17	0.4190	0.4495	0.4795	0.5295	0.6130
18	0.4190	0.4495	0.4795	0.5295	0.6130
19	0.4190	0.4495	0.4795	0.5295	0.6130
20	0.4445	0.4770	0.5060	0.5570	0.6450
21	0.4445	0.4895	0.5060	0.5895	0.6450
22	0.4695	0.5045	0.5345	0.5870	0.6885
23	0.4695	0.5045	0.5345	0.5870	0.6885
24	0.4970	0.5310	0.5620	0.6285	0.7210
25	0.4970	0.5310	0.5620	0.6285	0.7210
26	0.4970	0.5310	0.5620	0.6285	0.7210
27	0.5035	0.5495	0.5810	0.6360	0.7410
28	0.5135	0.5610	0.6050	0.6610	0.7650
29	0.5135	0.5610	0.6050	0.6610	0.7650
30	0.5260	0.5610	0.6050	0.6610	0.7650
31	0.5495	0.5845	0.6300	0.6885	0.7990
32	0.5495	0.5845	0.6300	0.6885	0.7990
33	0.5495	0.5845	0.6300	0.6885	0.7990
34	0.5735	0.6225	0.6585	0.7285	0.8445
35	0.5735	0.6225	0.6585	0.7285	0.8445
36	0.5735	0.6225	0.6585	0.7285	0.8445
37	0.5735	0.6225	0.6585	0.7285	0.8445
38	0.5990	0.6485	0.6850	0.7575	0.8740
39	0.5990	0.6485	0.6850	0.7575	0.8740
40	0.5990	0.6485	0.6850	0.7575	0.8740
41	0.6250	0.6775	0.7135	0.7880	0.9180
42	0.6250	0.6775	0.7135	0.7880	0.9180
43	0.6250	0.6775	0.7135	0.7880	0.9180
44	0.6485	0.7050	0.7410	0.8165	0.9495
45	0.6485	0.7050	0.7410	0.8165	0.9495
46	0.6485	0.7050	0.7410	0.8165	0.9495
47	0.6485	0.7050	0.7410	0.8165	0.9495
48	0.6485	0.7050	0.7535	0.8290	0.9620





Indian Electrical & Electronics Manufacturer's Association
501, Kakad Chambers P +91 22 2493 0532
132, Dr. A. B. Road, Worli F +91 22 2493 2705
Mumbai - 400 018. E : mumbai@ieema.org
INDIA. W www.ieema.org

Cir. No. 35/DIV/ CAB/05/

24th April 2018

To Members of the Cable Division, Utilities, Railways & Listed purchasing organizations

Sub: Correction in PV formulae of LT XLPE Power Cable and addition of factors for HT XLPE Power Cables

We have recently published revised Price Variation Clause for LT&HT XLPE Power Cables and made it effective from 1st November 2017 vide Cir. No.111/DIV/CAB/05 dated 5th December 2017


While replying to a query of a buyer it is observed that the polymer factor for LT XLPE Power Cables (both aluminium and copper) was incorrectly represented by Table P2.

We have now corrected the anomaly by correcting the PV formulae of LT XLPE Aluminium and Copper Insulated Cables (Sl. No. D & E) by representing Polymer factor by Table L2.

We have also worked out factors for XLPE, Copper and Steel for 3 core HT XLPE Power Cables for 500 and 630 sq.mm.

We now enclose complete PV clause of Cable by including all the PV formulae of different types of power cable (Sl. No. A to I), polymer factor Table L2 and updated XL4, H2 and H5 Table of factors for your perusal & record.

We request to replace PV clause of Cable already circulated vide Cir. 111/DIV/CAB/05 dated 5th December 2017 with the enclosed PV clause in your records for future use.


Senior Director
Encl: as above


good partners in implementation



HEAD OFFICE - DELHI

Rishysmook Building, First Floor, 85 A, Panchkulan Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org





Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017**Effective from: 1st November 217****Material Price Variation Clause For PVC And XLPE Insulated Cables**

The Price quoted/confirmed is based on the input cost of raw materials/components as on the date of quotation, and the same is deemed to be related to the prices of raw materials as specified in the price variation clause given below. In case of any variation in these prices, the price payable shall be subject to adjustment up or down in accordance with the formulae provided in this document.

Terms used in price variation formulae:

P Price payable as adjusted in accordance with above appropriate formula (in Rs/Km)

Po Price quoted/confirmed (in Rs/Km)

ALUMINIUM

AIF Variation factor for aluminium

AI Price of Aluminium. This price is as applicable of first working day of the month, one month prior to the date of delivery.

Alo Price of aluminium. This price is as applicable on first working day of the month, one month prior to the date of tendering.

COPPER

CuF Variation factor for copper

Cu Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cuo Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of tendering.

PVC COMPOUND

PVCC price of PVC compound. This price is as applicable on first working day of the month, one month prior to the date of delivery.

PVCCo Price of PVC compound. This price is as applicable on first working day of the month, one month prior to the date of tendering.

CCFAI Variation factor for PVC compound/Polymer for aluminum conductor cable.

CCFCu Variation factor for PVC compound/Polymer for copper conductor cable.

Joint IEEMA & AEP Association

**HEAD OFFICE - DELHI**

Rishyamook Building, First Floor, 85 A, Panchkulan Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018, E mumbai@ieema.org
 INDIA, W www.ieema.org

**IEEMA (PVC)/CABLE(R-1)/2017
 XLPE COMPOUND**

Effective from: 1st November 217

Cc price of XLPE compound. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cco Price of XLPE compound. This price is as applicable on first working day of the month, one month prior to the date of tendering.

XLFAL Variation factor for XLPE compound for aluminum conductor cable.

XLFCU Variation factor for XLPE compound for Copper conductor cable.

STEEL

FeF Variation factor for steel

FeW Variation factor for round wire steel armouring

Fe Price of Steel Strips/steel wire. This price is as applicable on the first working day of the month, one month prior to the date of delivery.

Feo Price of steel strips/steel wire. This price is as applicable on first working day of the month, one month prior to the date of tendering.

The above prices and indices are as published by IEEMA vide Circular reference IEEMA (PVC)/CABLE R(1)/--/-- prevailing as on 1st working day of the month i.e. one month prior to the date of tendering.

The date of delivery is the date on which the cable is notified as being ready for inspection/dispatch (in the absence of such notification, the date of manufacturer's dispatch note is to be considered as the date of delivery) or the contracted delivery date (including any agreed extension thereto), whichever is earlier.

Notes

- (a) All prices of raw materials are exclusive of GST amount.
- (b) All prices excluding Aluminium & Copper are as on first working day of the month.
- (c) The details of prices are as under:

1. Price of Aluminium is LME average Cash SELLER Settlement price of Primary Aluminium in US\$ per MT as published by London Metal Bulletin (LME) including Premium for Aluminium Ingot in US\$ per MT is converted in Indian Rs./MT.
2. Price of PVC Compound (in Rs/MT) is the ex-works price, as quoted by the manufacturer.
3. Price of XLPE Compound (in Rs/MT) is the ex-works price, as quoted by the manufacturer.
4. Price of CC copper rods (in Rs/MT) is ex-works price as quoted by the primary producer.
5. Price of galvanized steel strip / steel wire (in Rs/MT) is ex-works price as quoted by the manufacturer for Round steel Wire and Flat steel strip (the relevant price of steel strip or steel wire is to be selected depending upon the type of armouring of the cable).



HEAD OFFICE - DELHI
 Rishyamook Building, First Floor, 85 A, Panchsulan Road, New Delhi - 110001, INDIA.
 P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org





Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 2017

Price variation formulae for 'Power Cables'

A. Aluminum conductor PVC insulated 1.1 kV power cables

$$P = P_0 + AIF (AL - A_{lo}) + CCFAI (PVCc - PVCco) + FeF (Fe - Fe_0)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
P1	Aluminium conductor aluminium armour in single core armoured cables
P2	PVC compound
P3	Steel armour

B. Copper conductor PVC insulated 1.1 kV power cables

$$P = P_0 + CuF (Cu - Cu_0) + CCFCu (PVCc - PVCco) + FeF (Fe - Fe_0) + AIF (Al - A_{lo})$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0

For unarmoured cables; FeF, AIF = 0

Tables References:

CUP	Copper conductor
P2	PVC compound
P3	Steel armour
P4	Aluminium armour

C. Copper conductor PVC insulated 1.1 kV control cables

$$P = P_0 + CuF (Cu - Cu_0) + CCFCu (PVCc - PVCco) + FeF (Fe - Fe_0)$$

For unarmoured cables; FeF = 0

Tables References:

CUC	Copper conductor
P5	PVC compound
P6	Steel armour

D. Aluminum conductor XLPE insulated 1.1 kV power cables

$$P = P_0 + AIF (AL - A_{lo}) + XLFAL (CC - Cco) + CCFAI (PVCc - PVCco) + FeF (Fe - Fe_0)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
P1	Aluminium conductor aluminium armour in single core armoured cables
L2	Polymer (CCFAI)
P3	Steel armour
XL1	XLPE Compound (XLFAL)

E. Copper conductor XLPE insulated 1.1 kV power cables

$$P = P_0 + CuF (Cu - Cu_0) + XLFCU (CC - Cco) + CCFCu (PVCc - PVCco) + FeF (Fe - Fe_0) + AIF (Al - A_{lo})$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0



HEAD OFFICE - DELHI

Rishyamook Building, First Floor, 85 A, Panchsukian Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



IEEMA (PVC)/CABLE(R-1)/2017Effective from: 1st November 217

For unarmoured cables; FeF, AIF = 0

Tables References:

CUP	Copper conductor
L2	Polymer (CCFCu)
P3	Steel armour
P4	Aluminium armour
XL1	XLPE Compound (XLFCu)

F. Copper conductor XLPE insulated 1.1 kV control cables

$$P = P_o + CuF (Cu - Cuo) + XLFCU (CC-Cco) + CCFCu (PVCc-PVCco) + FeF (Fe-Feo)$$

For unarmoured cables; FeF = 0

Tables References:

CUC	Copper conductor
P5	PVC compound
P6	Steel armour
XL2	XLPE Compound

G. For Aluminium conductor XLPE insulated 3.3 to 33 kV power cables

$$P = P_o + AIF (Al - Alo) + XLFAL(CC-Cco) + CCFAI (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
H1	Aluminium conductor + aluminium armour in single core armoured cables
H2	Polymer
H3/H5	Steel armour (Flat/Round)
XL3/XL4	XLPE Compound (Single core /Multicore)

H. Copper conductor XLPE Insulated 3.3 to 33 kV power cables

$$P = P_o + CuF (Cu - Cuo) + XLFCU (CC-Cco) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo) + AIF (Al - Alo)$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0

For unarmoured cables; FeF, AIF = 0

Table References:

CUP	Copper conductor
H2	Polymer
H3/H5	Steel armour (Flat/Round)
H4	Aluminium armour
XL3/XL4	XLPE Compound (Single core /Multicore)

I. Copper conductor XLPE insulated 1.0 and 1.5 kV Solar PV DC cables

$$P = P_o + CuF (Cu - Cuo)$$

Table CU_{sd} Copper Conductor

[Signature]
Authorized Signatory

**HEAD OFFICE - DELHI**

Rishyamook Building, First Floor, 85 A, Panchkuian Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE ALP

**VARIATION FACTOR FOR ALUMINIUM (AIF)
POWER CABLES WITH ALUMINIUM CONDUCTOR
(EXCLUDING SINGLE CORE ARMOURED CABLES)**

Nominal Cross Sectional Area (in Sq. mm.)	1 core	2 core	3 core	3.5 core	4 core
2.5	0.007	0.014	0.021	-	0.028
4	0.011	0.023	0.034	-	0.046
6	0.017	0.034	0.052	-	0.069
10	0.029	0.053	0.087	-	0.116
16	0.046	0.091	0.137	-	0.183
25/16	0.073	0.146	0.219	0.262	0.292
35/16	0.101	0.202	0.302	0.345	0.404
50/25	0.137	0.273	0.410	0.478	0.547
70/35	0.197	0.395	0.593	0.687	0.791
95/50	0.274	0.548	0.821	0.949	1.095
120/70	0.346	0.691	1.035	1.221	1.382
150/70	0.425	0.853	1.279	1.464	1.706
185/95	0.533	1.070	1.605	1.861	2.140
225/120	0.655	1.310	1.965	2.287	2.620
240/120	0.703	1.400	2.099	2.421	2.799
300/150	0.879	1.757	2.635	3.033	3.514
400/185	1.126	2.249	3.374	3.873	4.498
500	1.418	2.838	4.256	-	5.675
630	1.828	3.663	5.494	-	7.326
800	2.340	4.679	7.018	-	9.357
1000	2.951	5.890	8.834	-	11.779

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE CUP


**VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
POWER CABLES WITH COPPER CONDUCTOR**

Nominal Cross Sectional Area (in Sq. mm.)	1 core	2 core	3 core	3.5 core	4 core
2.5	0.023	0.046	0.069	-	0.092
4	0.036	0.076	0.112	-	0.151
6	0.056	0.112	0.171	-	0.227
10	0.095	0.174	0.286	-	0.382
16	0.151	0.299	0.451	-	0.602
25/16	0.240	0.480	0.720	0.862	0.960
35/16	0.332	0.664	0.993	1.135	1.329
50/25	0.451	0.898	1.348	1.572	1.799
70/35	0.648	1.299	1.950	2.260	2.602
95/50	0.901	1.802	2.700	3.121	3.601
120/70	1.138	2.273	3.407	4.016	4.545
150/70	1.398	2.806	4.207	4.815	5.611
185/95	1.753	3.519	5.279	6.121	7.038
225/120	2.154	4.309	6.463	7.522	8.617
240/120	2.312	4.605	6.904	7.963	9.206
300/150	2.891	5.779	8.667	9.976	11.558
400/185	3.703	7.397	11.097	12.738	14.794
500	4.664	9.334	13.998	-	18.665
630	6.012	12.048	18.070	-	24.095
800	7.696	15.389	23.082	-	30.775
1000	9.706	19.372	29.055	-	38.741

TABLE CU_{sd}c

**VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
1.0 & 1.5KV Solar PV DC Cables with Copper Conductor**

Cable Size in sq.mm.	Copper content in MT/km
2.5	0.023
4	0.038
6	0.058
10	0.090



IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE CUC

VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
CONTROL CABLES WITH COPPER CONDUCTOR

No of Cores	Core size 1.5 sq mm	Core size 2.5 sq mm
2	0.026	0.047
3	0.039	0.070
4	0.052	0.094
5	0.065	0.117
6	0.078	0.141
7	0.091	0.164
8	0.110	0.182
9	0.117	0.205
10	0.130	0.235
12	0.157	0.282
14	0.183	0.329
16	0.209	0.376
18	0.246	0.410
19	0.248	0.446
20	0.260	0.456
24	0.313	0.563
27	0.352	0.634
30	0.391	0.704
37	0.483	0.809
44	0.573	1.033
52	0.678	1.221
61	0.796	1.432

IEEMA (PVC)/CABLE(R-1)/2017
TABLE P1

Effective from: 1st November 2017

VARIATION FACTOR FOR ALUMINIUM (AIF)
ALUMINIUM ARMoured SINGLE CORE PVC INSULATED 1.1 KV CABLES

Nominal cross sectional area (in Sq.mm)	Aluminium factor for Aluminium armoured cable with aluminium conductor
4	0.0685
6	0.0795
10	0.1017
16	0.1303
25	0.1693
35	0.2090
50	0.2597
70	0.3360
95	0.4567
120	0.5443
150	0.6427
185	0.7743
240	0.9737
300	1.2582
400	1.5502
500	1.8958
630	2.3650
800	2.9306
1000	3.7666

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 2017

TABLE P2

VARIATION FACTOR FOR PVC COMPOUND (CCFAI/CCFCu)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal cross Sectional Area (in Sq. mm)	1 core	2 core		3 core		3.5 core		4 core	
	Unarm	Unarm	arm	Unarm	arm	Unarm	arm	Unarm	arm
2.5	0.079	0.125	0.139	0.141	0.157	-	-	0.161	0.179
4	0.094	0.140	0.156	0.164	0.182	-	-	0.188	0.209
6	0.101	0.154	0.171	0.179	0.199	-	-	0.198	0.220
10	0.114	0.194	0.216	0.214	0.238	-	-	0.249	0.277
16	0.142	0.234	0.246	0.279	0.290	-	-	0.328	0.345
25	0.171	0.288	0.303	0.364	0.383	0.422	0.444	0.443	0.466
35	0.189	0.321	0.338	0.403	0.429	0.489	0.515	0.498	0.524
50	0.211	0.411	0.433	0.508	0.535	0.613	0.645	0.647	0.681
70	0.241	-	-	0.613	0.645	0.707	0.744	-	-
95	0.284	-	-	0.795	0.811	0.908	0.927	-	-
120	0.339	-	-	0.866	0.884	1.024	1.045	-	-
150	0.388	-	-	1.070	1.092	1.289	1.315	-	-
185	0.450	-	-	1.310	1.337	1.499	1.530	-	-
225	0.521	-	-	1.586	1.618	1.840	1.878	-	-
240	0.534	-	-	1.649	1.683	1.990	2.031	-	-
300	0.653	-	-	2.007	2.048	2.361	2.409	-	-
400	0.770	-	-	2.437	2.487	2.616	2.669	-	-
500	0.936	-	-	3.117	3.181	3.687	3.762	-	-
630	1.175	-	-	-	-	-	-	-	-
800	1.433	-	-	-	-	-	-	-	-
1000	1.642	-	-	-	-	-	-	-	-

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P3

VARIATION FACTOR FOR STEEL (FeF)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal Cross sectional Area (In Sq. mm)	2 core	Shape	3 core	Shape	3 ½ core	Shape	4 core	Shape
4	0.305	W	0.335	W	-	-	0.363	W
6	0.348	W	0.363	W	-	-	0.407	W
10	0.392	W	0.407	W	-	-	0.293	F
16	0.235	F	0.293	F	-	-	0.323	F
25	0.293	F	0.352	F	0.382	F	0.382	F
35	0.323	F	0.382	F	0.411	F	0.440	F
50	0.382	F	0.440	F	0.469	F	0.499	F
70	0.411	F	0.499	F	-	F	0.587	F
95	0.499	F	0.587	F	0.616	F	0.645	F
120	0.528	F	0.616	F	0.675	F	0.731	F
150	0.587	F	0.675	F	0.731	F	0.790	F
185	0.645	F	0.761	F	0.820	F	0.879	F
240	0.731	F	0.879	F	0.937	F	0.996	F
300	0.820	F	0.966	F	1.055	F	1.113	F
400	0.937	F	1.083	F	1.172	F	1.231	F
500	1.055	F	1.231	F	1.348	F	1.406	F
630	1.172	F	-	-	-	-	-	-

IEEMA (PVC)/CABLE(R-1)/2017
TABLE P3 (Additional)

Effective from: 1st November 217

VARIATION FACTOR FOR ROUND WIRE 'W' STEEL (FeF)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in sq. mm)	2 Core	3 Core	3.5 Core	4 Core
1.5	0.247	0.259		0.288
2.5	0.273	0.289		0.329
4	0.305	0.335		0.363
6	0.348	0.363		0.407
10	0.392	0.407		0.533
16	0.439	0.523	0.014	0.573
25	0.526	0.625	0.664	0.685
35	0.591	0.685	0.729	0.761
50	0.661	0.790	0.864	1.108
70	0.745	1.122	1.200	1.256
95	1.085	1.286	1.376	1.443
120	1.147	1.386	1.479	1.562
150	1.267	1.526	1.684	2.173
185	1.403	2.090	2.315	2.421
240	1.994	2.397	2.641	2.722
300	2.180	2.642	3.670	3.842
400	2.987	3.728	4.126	4.292
500	3.517	4.225	5.958	6.301
630	4.774	6.018	6.737	7.141

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P4

VARIATION FACTOR FOR ALUMINIUM (AIF)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	Aluminium Factor for Aluminium armoured cable with copper conductor
4	0.058
6	0.063
10	0.073
16	0.084
25	0.096
35	0.108
50	0.123
70	0.139
95	0.183
120	0.198
150	0.218
185	0.241
240	0.271
300	0.379
400	0.424
500	0.478
630	0.537
800	0.591
1000	0.816

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P5

VARIATION FACTOR FOR PVC COMPOUND (CCFCu)
PVC INSULAYTED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm		Core size 2.5 sq mm	
	Unarm	Arm	Unarm	Arm
2	0.118	0.121	0.125	0.139
3	0.121	0.131	0.141	0.157
4	0.137	0.152	0.161	0.179
5	0.157	0.174	0.187	0.206
6	0.179	0.199	0.234	0.260
7	0.179	0.199	0.234	0.260
8	0.193	0.215	0.292	0.325
9	0.216	0.241	0.300	0.335
10	0.236	0.262	0.303	0.337
12	0.249	0.277	0.334	0.371
14	0.311	0.327	0.389	0.409
16	0.344	0.362	0.435	0.458
18	0.352	0.371	0.474	0.500
19	0.375	0.395	0.476	0.501
20	0.391	0.412	0.519	0.546
24	0.457	0.481	0.584	0.615
27	0.491	0.517	0.631	0.664
30	0.529	0.557	0.706	0.743
37	0.615	0.647	0.835	0.879
44	0.739	0.778	1.019	1.026
52	0.845	0.889	1.100	1.158
61	0.952	1.002	1.246	1.312



IEEMA (PVC)/CABLE(R-1)/2017
TABLE P6

Effective from: 1st November 2017

VARIATION FACTOR FOR STEEL (FeF)
PVC INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm	Shape of armour	Core size 2.5 sq mm	Shape of armour
2	0.243	W	0.277	W
3	0.257	W	0.289	W
4	0.277	W	0.314	W
5	0.303	W	0.342	W
6	0.329	W	0.379	W
7	0.329	W	0.379	W
8	0.341	W	0.456	W
9	0.383	W	0.275	F
10	0.408	W	0.325	F
12	0.289	F	0.342	F
14	0.306	F	0.360	F
16	0.317	F	0.372	F
18	0.332	F	0.350	F
19	0.343	F	0.397	F
20	0.368	F	0.400	F
24	0.398	F	0.475	F
27	0.414	F	0.478	F
30	0.425	F	0.503	F
37	0.461	F	0.548	F
44	0.507	F	0.601	F
52	0.556	F	0.641	F
61	0.585	F	0.685	F

IEEMA (PVC)/CABLE(R-1)/2017
TABLE P6 (Additional)

Effective from: 1st November 2017

VARIATION FACTOR FOR ROUND WIRE 'W' STEEL (FeF)
PVC INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No. of Cores	Core size 1.5 sq mm	Core size 2.5 sq mm
2	0.243	0.273
3	0.257	0.289
4	0.277	0.314
5	0.303	0.342
6	0.329	0.379
7	0.329	0.379
8	0.341	0.456
9	0.383	0.508
10	0.408	0.535
12	0.510	0.572
14	0.546	0.625
16	0.581	0.660
19	0.608	0.696
24	0.714	0.819
25	0.679	0.798
27	0.732	0.837
28	0.696	0.815
30	0.758	0.861
33	0.747	0.883
37	0.820	1.217
44	0.926	1.355
48	1.122	1.308
50	1.122	1.308
52	1.149	1.361
56	1.202	1.388
61	1.299	1.520


IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE L2

VARIATION FACTOR FOR POLYMER (CCFAI / CCFCu)
XLPE INSULATED 1.1 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	1 core		2 core		3 core		3.5 core		4 core	
	Unarm	Arm	Unarm	Arm	Unarm	Arm	Unarm	Arm	Unarm	Arm
2.5	0.055	0.163	0.175	0.166	0.177	-	-	0.177	0.188	
4	0.075	0.201	0.204	0.205	0.213	-	-	0.218	0.213	
6	0.085	0.213	0.234	0.205	0.230	-	-	0.242	0.232	
10	0.082	0.252	0.280	0.217	0.251	-	-	0.285	0.298	
16	0.089	0.278	0.341	0.289	0.246	-	-	0.300	0.279	
25	0.101	0.307	0.278	0.276	0.247	0.295	0.264	0.331	0.290	
35	0.109	0.330	0.319	0.305	0.270	0.328	0.292	0.368	0.319	
50	0.124	0.482	0.685	0.348	0.311	0.372	0.335	0.422	0.394	
70	0.146	0.354	0.335	0.469	0.397	0.489	0.420	0.528	0.464	
95	0.163	0.436	0.389	0.504	0.441	0.544	0.471	0.591	0.523	
120	0.176	0.475	0.421	0.556	0.498	0.599	0.538	0.722	0.656	
150	0.217	0.510	0.490	0.690	0.611	0.717	0.633	0.840	0.762	
185	0.236	0.631	0.608	0.836	0.738	0.854	0.756	1.007	0.899	
240	0.273	0.750	0.726	1.002	0.842	1.079	0.952	1.238	1.119	
300	0.303	0.919	0.887	1.161	1.012	1.170	1.031	1.457	1.414	
400	0.372	1.093	1.040	1.376	1.283	1.545	1.379	1.778	1.626	
500	0.413	1.342	-	1.568	1.400	1.806	1.456	-	-	
630	0.469	1.546	-	-	-	-	-	-	-	
800	0.569	-	-	-	-	-	-	-	-	
1000	0.667	-	-	-	-	-	-	-	-	



IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 2017

TABLE XL1
VARIATION FACTOR FOR XLPE COMPOUND (XLFAL/XLFCU)
XLPE INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR


Nominal cross Sectional Area (in Sq. mm)	1 core		2 core		3 core		3.5 core		4 core	
	Unarm	Arm	Unarm	Arm	Unarm	arm	Unarm	Arm	Unarm	arm
2.5	0.007	0.010	0.014	0.014	0.021	0.021			0.028	0.028
4	0.009	0.012	0.018	0.018	0.027	0.027			0.036	0.036
6	0.010	0.015	0.022	0.022	0.033	0.033			0.043	0.043
10	0.013	0.018	0.025	0.025	0.039	0.039			0.053	0.053
16	0.016	0.023	0.034	0.034	0.049	0.049			0.065	0.065
25	0.021	0.030	0.048	0.048	0.070	0.070	0.084	0.084	0.093	0.093
35	0.025	0.035	0.059	0.059	0.084	0.084	0.099	0.099	0.112	0.112
50	0.033	0.044	0.075	0.075	0.108	0.108	0.130	0.130	0.144	0.144
70	0.042	0.054	0.095	0.095	0.137	0.137	0.160	0.160	0.179	0.179
95	0.048	0.062	0.110	0.110	0.160	0.160	0.190	0.190	0.211	0.211
120	0.060	0.076	0.138	0.138	0.200	0.200	0.239	0.239	0.266	0.266
150	0.078	0.095	0.180	0.180	0.259	0.259	0.296	0.296	0.344	0.344
185	0.097	0.116	0.224	0.224	0.324	0.324	0.369	0.369	0.430	0.430
240	0.116	0.137	0.266	0.266	0.388	0.388	0.446	0.446	0.518	0.518
300	0.138	0.164	0.325	0.325	0.467	0.467	0.540	0.540	0.620	0.620
400	0.175	0.214	0.357	0.357	0.536	0.536	0.619	0.619	0.714	0.714
500	0.217	0.260	0.440	0.440	0.660	0.660	0.769	0.769	0.880	0.880
630	0.265	0.318	0.542	0.542	0.814	0.814	0.941	0.941	1.085	1.085
800	0.323	0.389								
1000	0.375	0.444								

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE XL2
VARIATION FACTOR FOR XLPE COMPOUND (XLFCU)
XLPE INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm		Core size 2.5 sq mm	
	Unarm	Arm	Unarm	Arm
2	0.010	0.010	0.012	0.012
3	0.016	0.016	0.018	0.018
4	0.021	0.021	0.025	0.025
5	0.026	0.026	0.031	0.031
6	0.031	0.031	0.037	0.037
7	0.036	0.036	0.043	0.043
8	0.036	0.036	0.043	0.043
9	0.042	0.042	0.049	0.049
10	0.052	0.052	0.061	0.061
12	0.062	0.062	0.074	0.074
14	0.073	0.073	0.086	0.086
16	0.083	0.083	0.098	0.098
18	0.094	0.094	0.110	0.110
19	0.099	0.099	0.116	0.116
20	0.104	0.104	0.123	0.123
24	0.125	0.125	0.147	0.147
27	0.140	0.140	0.165	0.165
30	0.156	0.156	0.184	0.184
37	0.192	0.192	0.227	0.227
44	0.229	0.229	0.270	0.270
52	0.270	0.270	0.319	0.319
61	0.317	0.317	0.374	0.374



IEEMA (PVC)/CABLE(R-1)/2017

 Effective from: 1st November 217

TABLE XL3
VARIATION FACTOR FOR XLPE(XLFAL/XLFCU)

 SINGLE CORE ARMoured /UNARMoured XLPE INSULATED 3.3 to 33 KV POWER CABLES WITH
 CU / AL CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm.)	XLPE Factor for Armoured/ Unarmoured Cable with AL/CU Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	0.110	0.131	0.170	0.279		
35	0.122	0.137	0.175	0.284	0.317	0.522
50	0.135	0.151	0.191	0.307	0.341	0.563
70	0.155	0.172	0.215	0.342	0.379	0.615
95	0.174	0.193	0.241	0.377	0.417	0.670
120	0.192	0.212	0.262	0.407	0.449	0.713
150	0.209	0.229	0.283	0.437	0.481	0.757
185	0.228	0.250	0.308	0.471	0.518	0.809
240	0.255	0.279	0.343	0.519	0.569	0.883
300	0.280	0.322	0.372	0.560	0.613	0.943
400	0.326	0.392	0.420	0.625	0.683	1.041
500	0.388	0.461	0.469	0.694	0.757	1.142
630	0.467	0.520	0.529	0.777	0.845	1.265
800	0.567	0.593	0.602	0.874	0.949	1.407
1000	0.656	0.665	0.660	0.955	1.036	1.525

Note : XLPE factors include Semicons for Conductor & Insulation screen

TABLE - XL4
VARIATION FACTOR FOR XLPE (CCF1A) / CCF1Cu)

3 CORE XLPE INSULATED 3.3 to 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	3.3 KV ARM	6.6 KV (E) ARM	6.6 KV (UE) / 11 KV (E) ARM	11 KV (UE) ARM	22 KV (E) ARM	33 KV (E) ARM
25	0.315	0.394	0.511	0.838		
35	0.339	0.427	0.545	0.880	0.982	1.638
50	0.378	0.474	0.600	0.957	1.065	1.751
70	0.435	0.541	0.679	1.067	1.183	1.916
95	0.489	0.604	0.755	1.171	1.295	2.071
120	0.537	0.661	0.822	1.265	1.396	2.210
150	0.585	0.719	0.890	1.359	1.497	2.350
185	0.642	0.784	0.968	1.468	1.614	2.513
240	0.717	0.873	1.074	1.615	1.773	2.732
300	0.781	1.006	1.167	1.744	1.928	2.919
400	0.886	1.227	1.314	1.948	2.130	3.229
500	0.956	1.421	1.445	2.148	2.381	3.538
630	1.129	1.582	1.609	2.382	2.630	3.940

Note : XLPE factors include Semicons for Conductor & Insulation screen




TABLE H1
VARIATION FACTOR FOR ALUMINIUM (AIF)
ALUMINIUM ARMoured SINGLE CORE XLPE INSULATED 3.3 TO 33 KV CABLES

Nominal Cross Sectional Area (in Sq. mm.)	Aluminium Factor for Aluminium Armoured Cable with Aluminium Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
35	0.251	0.284	0.301	0.344	0.358	0.473
50	0.312	0.336	0.352	0.397	0.408	0.672
70	0.385	0.409	0.423	0.469	0.501	0.723
95	0.476	0.500	0.518	0.637	0.656	0.856
120	0.561	0.586	0.601	0.726	0.744	0.949
150	0.653	0.678	0.696	0.823	0.842	1.050
185	0.773	0.797	0.893	0.949	0.965	1.183
240	0.997	1.063	1.083	1.139	1.154	1.387
300	1.209	1.271	1.283	1.333	1.307	1.753
400	1.438	1.556	1.565	1.620	1.636	2.046
500	1.873	1.901	1.910	2.110	2.128	2.484
630	2.337	2.361	2.369	2.580	2.595	2.978
800	3.007	3.071	3.080	3.145	3.163	3.588
1000	3.737	3.741	3.749	3.804	3.822	4.565

TABLE H2
VARIATION FACTOR FOR POLYMER (CCFAI / CCFCu)
3 CORE XLPE INSULATED 3.3 TO 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	3.3 KV ARM	6.6 KV (E) ARM	6.6 KV (UE) / 11 KV (E) ARM	11 KV (UE) ARM	22 KV (E) ARM	33 KV (E) ARM
35	0.374	0.990	1.142	1.604	1.782	-
50	0.445	1.119	1.260	1.834	2.046	2.064
70	0.547	1.290	1.396	2.011	2.284	3.219
95	0.594	1.440	1.647	2.269	2.428	3.367
120	0.732	1.692	1.877	2.498	2.715	3.646
150	0.812	1.906	2.061	2.767	2.931	3.927
185	0.960	2.086	2.406	3.028	3.180	4.166
240	1.130	2.484	2.744	3.398	3.590	4.589
300	1.219	2.912	3.161	3.840	4.016	5.029
400	1.313	3.530	3.664	4.353	4.666	5.736
500	1.652	3.925	3.971	4.621	4.878	5.913
630	1.949	4.487	4.982	5.225	5.477	6.696

Fillers added in PVC consumption

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE H3
VARIATION FACTOR FOR STEEL (FeF)
XLPE INSULATED 3.3 TO 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area Sq. mm.	3.3 KV	6.6 KV (E)	11 KV (E) / 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	0.551	0.604	0.656	0.814		
35	0.645	0.645	0.731	0.879	0.937	-
50	0.675	0.703	0.761	0.937	0.966	1.181
70	0.761	0.761	0.849	0.996	1.055	1.289
95	0.820	0.849	0.907	1.083	1.113	1.348
120	0.879	0.907	0.966	1.142	1.172	1.406
150	0.966	0.966	1.055	1.201	1.259	1.494
185	1.025	1.055	1.113	1.259	1.318	1.553
240	1.142	1.142	1.231	1.377	1.406	1.641
300	1.231	1.259	1.318	1.465	1.524	1.758
400	1.348	1.406	1.435	1.582	1.641	1.876

TABLE H4
VARIATION FACTOR FOR ALUMINIUM (AIF)
XLPE INSULATED SINGLE CORE 3.3 TO 33 KV POWER CABLES WITH COPPER CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm.)	Aluminium Factor for Aluminium Armoured Cable with Copper Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
35	0.153	0.187	0.204	0.247	0.258	0.372
50	0.179	0.203	0.220	0.262	0.275	0.425
70	0.196	0.219	0.233	0.278	0.311	0.444
95	0.213	0.237	0.254	0.373	0.392	0.470
120	0.228	0.253	0.268	0.393	0.410	0.488
150	0.243	0.269	0.287	0.414	0.432	0.504
185	0.261	0.285	0.381	0.437	0.455	0.526
240	0.324	0.389	0.410	0.465	0.480	0.556
300	0.365	0.428	0.440	0.490	0.510	0.737
400	0.432	0.471	0.480	0.536	0.552	0.783
500	0.489	0.517	0.526	0.726	0.744	0.844
630	0.544	0.568	0.572	0.787	0.801	0.902
800	0.706	0.787	0.797	0.862	0.880	0.982
1000	0.824	0.865	0.867	0.923	0.940	1.324

TABLE - H5
VARIATION FACTOR FOR STEEL (FeW)
XLPE INSULATED 3.3KV TO 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area in Sq. mm	3.3/3.3 KV	3.3/6.6 KV	11 KV (E) / 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	1.258	1.457	1.612	2.509	1.503	--
35	1.361	1.569	1.853	2.644	2.797	2.517
50	1.682	1.687	2.321	2.800	2.921	4.569
70	2.033	1.979	2.503	3.219	3.347	4.809
95	2.202	2.507	2.718	4.019	4.200	5.437
120	2.371	2.675	2.882	4.241	4.416	6.713
150	2.870	2.847	3.265	4.447	4.621	6.976
185	3.121	3.309	4.148	4.726	5.289	7.356
240	3.758	4.227	4.442	5.442	6.651	7.718
300	4.099	5.024	5.182	6.894	7.084	8.187
400	5.750	6.572	6.658	7.433	7.657	8.760
500	6.716	6.777	6.861	7.588	7.797	8.830
630	7.492	7.465	7.477	8.209	8.386	9.413

3 X 660MW North Karanpura TPS

BILL OF QUANTITIES (1.1kV LT PVC CONTROL CABLES)

- 1) 1.1 kV /Copper conductor / PVC insulated / Innersheath PVC type ST1 / Outersheath PVC Type ST1 with FRLS property Unarmoured Control cable

S.No.	Item code	Item name	UOM	Ordered Quantity	unit price	total price
1	507-30044-A	2C-1.5-UNARMoured	MTR	25000		
6	507-30022-A	5C-2.5-UNARMoured	MTR	6000		

NOTES :

- Quantities indicated above shall be known as Order Quantities. The variation in quantities shall be as per NIT.
- The bidder shall indicate the unit price of each type and size of cables listed as per the BOQ-Cum-Price Schedule. The unit prices shall apply for adjustment of variation in quantity as stipulated in NIT.
- Manufacturing of the cables shall be taken up by the successful bidder only after approval of technical and quality documentation. Subsequent qty. shall be cleared for manufacture based on progress of engineering & site requirements.
- Delivery schedule shall be as per NIT.
- The standard drum length shall be 1000 meters as indicated above. Tolerance on individual drum length shall be $\pm 5\%$.
- Overall tolerance on total dispatched quantity of each size shall be (-) 2% and (+) 0% except where the total ordered quantity is one single drum length of 1000m, in which case it shall be -5%/0%. Cables consumed for testing and inspection shall be to bidder's account.
- For each individual cable size, one short length of not less than 200m may be accepted only in the final drum length to complete the supply (except where the total ordered quantity is one single drum length of 1000m). The overall tolerance limits stipulated above shall continue to apply (in case short lengths are accepted).

एनटीपीसी NTPC	CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली
--------------------------	---

i.	Item/Scope of Sub-contracting उप-संविदा(अनुबंध) का मद/ दायरा	
ii.	Address of the registered office पंजीकृत कार्यालय का पता	Details of Contact Person संपर्क व्यक्ति का विवरण (Name, Designation, Mobile, Email) (नाम, पदनाम, मोबाइल, ईमेल)
iii.	Name and Address of the proposed Sub-vendor's works where item is being manufactured प्रस्तावित उप-विक्रेता के कार्यों का नाम और पता, जहां मद का निर्माण किया जा रहा है	Details of Contact Person: संपर्क व्यक्ति का विवरण (Name, Designation, Mobile, Email) (नाम, पदनाम, मोबाइल, ईमेल)
iv.	Annual Production Capacity for proposed item/scope of sub-contracting उप-संविदा(अनुबंध) के प्रस्तावित मद / दायरे के लिए वार्षिक उत्पादन क्षमता	
v.	Annual production for last 3 years for proposed item/scope of sub-contracting उप-संविदा(अनुबंध) के प्रस्तावित मद / दायरे के लिए पिछले 3 वर्षों का वार्षिक उत्पादन	
vi.	Details of proposed works प्रस्तावित कार्यों का विवरण	
1.	Year of establishment of present works वर्तमान फैक्टरी की स्थापना का वर्ष	
2.	Year of commencement of manufacturing at above works उपरोक्त फैक्टरी में निर्माण कार्य शुरू होने का वर्ष	
3.	Details of change in Works address in past (if any) पूर्व में फैक्टरी स्थल में परिवर्तन का विवरण (यदि कोई हो)	
4.	Total Area कुल क्षेत्र	
4.	Covered Area शामिल क्षेत्र	
5.	Factory Registration Certificate फैक्टरी पंजीकरण प्रमाण पत्र	Details attached at Annexure – F2.1 विवरण अनुलग्नक- एफ 2.1 पर संलग्न है
6.	Design/ Research & development set-up डिजाइन / अनुसंधान और विकास सेटअप (No. of manpower, their qualification, machines & tools employed etc.) (श्रमिकों की संख्या, उनकी योग्यता, मशीन और उपलब्ध उपकरण आदि)	Applicable / Not applicable if manufacturing is as per Main Contractor/purchaser design) Details attached at Annexure – F2.2 (if applicable) लागू / लागू नहीं, अगर विनिर्माण मुख्य संविदाकार / खरीददार के डिजाइन के अनुसार है) विवरण अनुलग्नक –एफ 2.2 पर संलग्न है। (यदि लागू हो)
7.	Overall organization Chart with Manpower Details (Design/Manufacturing/Quality etc) मैनपावर विवरण के साथ समग्र संगठन का चार्ट(डिजाइन / विनिर्माण / गुणवत्ता आदि)	Details attached at Annexure – F2.3 विवरण अनुलग्नक – F2.3 में संलग्न है।



CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन
SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली

8.	After sales service set up in India, in case of foreign sub-vendor(Location, Contact Person, Contact details etc.) भारत में बिक्री सेवा की स्थापना के बाद, विदेशी उप-विक्रेता के मामले में(स्थल , संपर्क व्यक्ति, संपर्क विवरण आदि)	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.4 विवरण अनुलग्नक -2.4 पर संलग्न है।			
9.	Manufacturing process execution plan with flow chart indicating various stages of manufacturing from raw material to finished product including outsourced process, if any फ्लोचार्ट सहित विनिर्माण प्रक्रिया निष्पादन योजना , जिसमें आउटसोर्स प्रक्रिया, यदि कोई हो, सहित कच्चे माल से तैयार उत्पाद तक विनिर्माण के विभिन्न चरणों को दर्शाया गया हो,	Details attached at Annexure – F2.5 विवरण अनुलग्नक - F2.5में संलग्न है।			
10.	Sources of Raw Material/Major Bought Out Item कच्चे माल के स्रोत / खरीदे हुए मुख्य मद	Details attached at Annexure – F2.6 विवरण अनुलग्नक - F2.6में संलग्न है।			
11.	Quality Control exercised during receipt of raw material/BOI, in-process , Final Testing, packing कच्चे माल / खरीदे हुए मद, प्रक्रियाबद्ध, अंतिम परीक्षण, पैकिंग करते समय गुणवत्ता नियंत्रण	Details attached at Annexure – F2.7 विवरण अनुलग्नक - F2.7 पर संलग्न है			
12.	Manufacturing facilities (List of machines, special process facilities, material handling etc.) विनिर्माण सुविधा(मशीनों की सूची, विशेष प्रक्रिया सुविधाएं, सामग्री रख-रखाव आदि)	Details attached at Annexure – F2.8 विवरण अनुलग्नक - F2.8में संलग्न है।			
13.	Testing facilities (List of testing equipment) परीक्षण सुविधाएं(परीक्षण उपकरण की सूची)	Details attached at Annexure – F2.9 विवरण अनुलग्नक – F2. 9 में संलग्न है।			
14.	If manufacturing process involves fabrication then- यदि निर्माण प्रक्रिया में फेब्रिकेशन की गई है तो- List of qualified Welders पात्र वेल्डर की सूची List of qualified NDT personnel with area of specialization विशेषज्ञता के क्षेत्र सहित पात्र एनडीटी कार्मिकों की सूची	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.10 विवरण अनुलग्नक - F2.10में संलग्न है। (if applicable) लागू / लागू नहीं			
15.	List of out-sourced manufacturing processes with Sub-Vendors' names & addresses सब-वेंडर द्वारा बाह्य स्रोतों (उनके नाम और पते सहित)से करवाएं गए निर्माण प्रक्रियाओं की सूची	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure. –F2.11 विवरण अनुलग्नक - F2.10में संलग्न है। (if applicable) (यदि लागू हो)			
16.	Supply reference list including recent supplies नवीनतम आपूर्ति सहित आपूर्ति संदर्भ सूची	Details attached at Annexure – F2.12 विवरण अनुलग्नक - F2.12 में संलग्न है। (as per format given below) (नीचे दिए गए प्रारूप के अनुसार)			
Project/ package परियोजना /पैकेज	Customer Name ग्राहक का नाम	Supplied Item (Type/Rating/Model /Capacity/Size etc) आपूर्ति की गई वस्तु (प्रकार / रेटिंग / मॉडल / क्षमता / आकार आदि)	PO ref no/date पीओ संदर्भ सं. / तिथि	Supplied Quantity आपूर्ति की मात्रा	Date of Supply आपूर्ति की तारीख
17.	Product satisfactory performance feedback letter/certificates/End User Feedback उत्पाद के संतोषजनक प्रदर्शन संबंधी फीडबैक पत्र / प्रमाण पत्र / अंतिम उपयोगकर्ता फीडबैक			Attached at annexure - F2.13 अनुलग्नक F2. 3पर संलग्न है	



CORPORATE QUALITY ASSURANCE/ कॉरपोरेट गुणवत्ता आश्वासन
SUB-VENDOR QUESTIONNAIRE/ सब-वेंडर प्रश्नावली

18.	Summary of Type Test Report (Type Test Details, Report No, Agency, Date of testing) for the proposed product (similar or higher rating) प्रस्तावित उत्पाद (एक समान या उच्च रेटिंग वाले) के लिए टाइप टेस्ट रिपोर्ट (टाइप टेस्ट विवरण, रिपोर्ट संख्या, एजेंसी, जांच की तारीख) का सारांश नोट: - रिपोर्ट प्रस्तुत करने की आवश्यकता नहीं है Note:- Reports need not to be submitted	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.14 विवरण अनुलग्नक - F2.1 4में संलग्न है (if applicable) (यदि लागू हो)
19.	Statutory / mandatory certification for the proposed product प्रस्तावित उत्पाद के लिए वैधानिक / अनिवार्य प्रमाणीकरण	Applicable / Not applicable लागू / लागू नहीं Details attached at Annexure – F2.15 (if applicable) (यदि लागू हो)
20.	Copy of ISO 9001 certificate आईएसओ 9001 प्रमाण पत्र की प्रति (if available) (यदि उपलब्ध हो)	Attached at Annexure – F2.16 अनुलग्नक में संलग्न - F2.1 6 है
21.	Product technical catalogues for proposed item (if available) प्रस्तावित मद के लिए उत्पाद तकनीकी कैटलॉग (यदि उपलब्ध हो)	Details attached at Annexure – F2.17 विवरण अनुलग्नक - F2.1 7 में संलग्न है
Name: Desig: Sign: Date: नाम: पद: हस्ता तिथि: क्षर:		

Company's Seal/Stamp:- कंपनी की मुहर / मोहर: -