

NTPC LIMITED

3X200+3X500+1x500 MW NTPC KORBA TPP-FGD

TECHNICAL SPECIFICATION

FOR

LIME FEEDING/DOSING SYSTEM (WASTEWATER NEUTRALISATION SYSTEM FOR FGD)

SPECIFICATION NO.: PE-TS-466-571-A102



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
PROJECT ENGINEERING INSTITUTE BUILDING
SECTOR-16A, PLOT NO. 25, NOIDA, INDIA**



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD

LIME FEEDING / DOSING SYSTEM

TECHNICAL SPECIFICATION

SPECIFICATION No: PE-TS-466-571-A102

SECTION

REV. 00

SHEET : 1 OF 1

CONTENTS**SECTION - I**

SUB- SECTIONS	TITLE		Page No.	
Sub-Section-A	INTENT OF SPECIFICATION		4-6	
Sub-Section-B	PROJECT INFORMATION		7-24	
Sub-Section-C	TECHNICAL SPECIFICATIONS		25	
	Sub Section-C1	SPECIFIC TECHNICAL REQUIREMENT	26-43	
	Sub Section-C2	CUSTOMER SPECIFICATION (PROJECT SPECIFIC GENERAL REQUIREMENTS INCLUDING):		44-178
		C2 - A	GENERAL TECHNICAL REQUIREMENT ALONGWITH DRAWINGS/DOCUMENTS SUBMISSION PROCEDURE & PACKING PROCEDURE	45-107
		C2 - B	FUNCTIONAL GUARANTEES	108-115
		C2 - C	PIPING	116-132
		C2 - D	QUALITY ASSURANCE	133-147
		C2 - E	PAINTING SPECIFICATION	148-178
	Sub Section-C3	TECHNICAL SPECIFICATION (ELECTRICAL PORTION)		179-236
	Sub Section-C4	TECHNICAL SPECIFICATION (C&I PORTION)		237-359
Sub Section-D	ANNEXURE-I	LIST OF MAKES OF SUB-VENDOR ITEMS	361	
	ANNEXURE-II	MANDATORY SPARE LIST	362-365	
	ANNEXURE-III	INSPECTION AND TESTING	366-372	
	ANNEXURE-IV	INPUT DRAWINGS (PID/ MECHANICAL LAYOUT DRAWINGS SHOWING LOCATION OF EQUIPMENT)	373-379	
	ANNEXURE-V	MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION	380-384	
	ANNEXURE-VI	PACKING PROCEDURE	385-386	
	ANNEXURE-VII	PIPE & VALVE MATERIAL SPECIFICATION	387-392	

SECTION – II

SUB SECTIONS	TITLE	Page No.
Annexure-1	LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	394
Annexure-2	COMPLIANCE CUM CONFIRMATION CERTIFICATE	395-396
Annexure-3	PRE-BID CLARIFICATION SCHEDULE	397
Annexure-4	DEVIATION SHEET (COST OF WITHDRAWAL)	398
Annexure-5	SCHEDULE OF GUARANTEES	399
Annexure-6	LIST OF MAKES OF SUB VENDOR ITEMS	400
Annexure-7	LIST OF TOOLS & TACKLES	401
Annexure-8	EQUIPMENT DATA SHEET/ SCHEDULE (TO BE FILLED BY BIDDER)	402-408
Annexure-9	LIST OF COMMISSIONING/RECOMMENDED SPARES	409-410



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION**

SPECIFICATION No: PE-TS-466-571-A102

SECTION: I

REV. 00

SECTION - I

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION INTENT OF SPECIFICATION	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 1 OF 3	

SECTION-I

SUB-SECTION-A

INTENT OF SPECIFICATION

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION INTENT OF SPECIFICATION	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 2 OF 3	

1.0 INTENT OF SPECIFICATION

- 1.1 The specification covers Supply part, Services part and supply of Mandatory spares. Scope of Supply shall comprise of design (i.e. Preparation and submission of drawing /documents including “As Built” drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor's works, painting, maintenance tools & tackles, fill of lubricants & consumables (till handing over), mandatory spares along with spares for erection, start-up and commissioning, proper packing, forwarding, shipment and delivery of all equipment at site. Services part covers **supervision services** for erection & commissioning, trial run at site and carrying out Performance guarantee tests at site. Training of customer/ clients O&M staff covering all aspects of the Lime feeding/dosing system (LDS) and inclusive of training for Operation & Maintenance (6 days) at Site, training of customer's personnel at manufacturer's works (6 man-days including lodging and boarding), troubleshooting etc. shall be part of services to be provided by supplier. Services also include handing over of LDS package complete with all accessories in flawless condition to the customer, for the total scope defined for lime dosing/feeding system as per BHEL NIT & tender technical specification, amendment & agreements till placement of order for Lime Feeding/Dosing System (LDS) of Flue Gas Desulphurization (FGD) plant of **Flue Gas Desulphurization (FGD) plant of (3X200+3X500+1X500) MW KORBA STG-I, II & III STPP, District- Korba, Chhattisgarh of M/s NTPC Limited.**
- 1.2 There are total seven (7) units, three (3) of 200 MW (each) in Stage-I, three (3) of 500 MW (each) in Stage-II and one (1) of 500 MW in Stage-III, envisaged with one (1) FGD system. Two (02) Sets of lime feeding / dosing system (1 working + 1 standby) common for all seven (7) units shall be provided. Twin feed Bucket Elevator, 2-way Diverter Flap Gate, surge hopper vibrating feeders shall be 1 no. each and common for complete lime feeding / dosing system. Lime Dosing pumps after the neutralisation tanks shall be common (1 working + 1 standby). Supplier to read/refer P&ID/ technical specifications in conjunction with data sheets, as enclosed with the specifications.
- 1.3 The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve the contractor of the responsibility of providing such facilities to complete the supply, erection and commissioning (Supervision of E&C by supplier & E&C by BHEL), performance and guarantee/demonstration testing of **LIME FEEDING / DOSING SYSTEM.**
- 1.4 The Bidder shall offer only proven design, which meets the Provenness criteria indicated in the NIT. Necessary document evidences shall be submitted along with the bid. If bidder doesn't meet the specified provenness criteria, their bid may not be considered for further evaluation.
- 1.5 It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to the highest standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to the purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION INTENT OF SPECIFICATION	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 3 OF 3	

- 1.6 The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing. Similarly, the extent of supply also includes all items required for completion of the system for its safe, efficient, reliable and trouble-free operation and maintenance shall also be in supplier's scope unless specifically excluded and notwithstanding that they may have been omitted in drawings / specifications or schedules.
- 1.7 The general term and conditions, instructions to tenderers and other attachment(s) referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification is subject to the compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.
- 1.8 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek **any clarification on specification requirement in the format enclosed under Section-III of the specification within 10 days of receipt of tender documents**. In absence of any such clarification(s), **in case of any contradictory requirement, the more stringent requirement as per interpretation of Purchaser / Customer shall prevail and shall be complied by the bidder without any commercial implication** on account of the same. Further, in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.
- 1.9 The bidder's offer shall not carry any section like clarification, interpretations and /or assumptions.
- 1.10 **Deviations, if any, should be very clearly brought out clause by clause along with cost of withdrawal in the enclosed schedule (in Section -II); otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.** If no cost of withdrawal is given against the deviation, it will be presumed that deviation can be withdrawn without any cost to BHEL/it's customer.
- 1.11 In the event of any conflict between the requirements of two clauses of this specification & requirements of different codes/standards and between respective clauses of sub-section C & sub-section D, more stringent clause as per the interpretation of the owner shall apply.
- 1.12 In case, all the above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.
- 1.13 For definition of words like Contractor, bidder, supplier, vendor, Customer/ Purchaser / Employer, consultant, please refer relevant clause of General Conditions of Contract (GCC).

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION PROJECT INFORMATION	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		Sub Section : B	
		REV. 00	

SECTION: I

SUB-SECTION: B

PROJECT INFORMATION

CLAUSE NO.	PROJECT INFORMATION
1.00.00 1.01.00 1.02.00 1.03.00 ~~1.04.00~~	 BACKGROUND Korba Super Thermal Power Project (KSTPP) was originally conceived as a pit head coal-based power plant. The present capacity of the plant is 2600 MW which has been implemented in 3 stages. Stage-I comprises of three 200 MW units, Stage-II comprises of three 500 MW units and the Stage-III of the plant comprises of one 500 MW unit. The present proposal is for implementation of FGD system in ~~the stage-III (1x500MW)~~ of Korba STPP for reduction of SOx emissions. LOCATION AND APPROACH The site is located on the western bank of river Hasdeo near Korba town in Korba District of Chhattisgarh State. The site is contiguous to the Right Bank Irrigation Canal emanating from Hasdeo Barrage. BALCO's aluminium plant and two power stations are already located on both the banks of Hasdeo river in the vicinity. Korba town is a broad gauge railhead 37 kms away from Champa railway station on Calcutta-Nagpur main line of South-Eastern Central Railway and is approximately 510 kms from Nagpur by rail. The site is very close to all weather road between Katghora & Korba and is approximately 110 kms from Bilaspur and 10 kms from Korba town. Vicinity plan of the proposed project is placed at Annexure –I. LAND Wet Limestone Forced Oxidation FGD equipment shall be installed within the existing station premises. WATER The source of raw water for the project is Right Bank Canal (RBC) originating from Hasdeo Barrage near the Plant boundary. 110 MCM (123 Cusecs) of water for Korba STPP is available from Chhattisgarh Govt. Coal Quality Parameters / Fuel Oil Characteristics & Plant Water details: (i) The Coal quality parameters and Fuel Oil characteristics are indicated in Table-1 & Table-2 respectively below. (ii) Process water: Process water quality is CW Blowdown based on the COC indicated in Table-4. (iii) Clarified water: Clarified water quality is indicated in Table-4. (iv) DM water for Equipment cooling water system.
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9 SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III) PAGE 1 OF 36

CLAUSE NO.	PROJECT INFORMATION			
	DM water quality is indicated in Table-5.			
~~1.05.00~~	~~Steam Generator and ESP data: refer Table 6.~~			
~~1.06.00~~	~~Drawings are enclosed as per Table 7 for initial overview to the Bidder.~~			
2.00.00	NOT USED			
3.00.00	Capacity Stage-I 3 x 200 MW Stage-II 3 x 500 MW Stage-III 1 x 500 MW			
4.00.00	Metrological Data The metrological data from nearest observatory is placed at Annexure-II .			
5.00.00	Criteria for Earthquake Resistant Design of Structures and Equipment All structures and equipment shall be designed for seismic forces adopting the site specific seismic information provided in this document and using the other provisions in accordance with IS:1893 (Part 1 to Part 4). Pending finalization of Part 5 of IS:1893, provisions of part 1 shall be read along with the relevant clauses of IS:1893:1984, for embankments. A site specific seismic study has been conducted for the project site. The peak ground horizontal acceleration for the project site, the site specific acceleration spectral coefficients (in units of gravity acceleration 'g') in the horizontal direction for the various damping values and the multiplying factor (to be used over the spectral coefficients) for evaluating the design acceleration spectra are as given at Appendix-I. Vertical acceleration spectral values shall be taken as 2/3rd of the corresponding horizontal values. The site specific design acceleration spectra shall be used in place of the response acceleration spectra, given at figure-2 in IS:1893 (Part 1) and Annex B of IS:1893 (Part 4). The site specific acceleration spectra along with multiplying factors specified in Appendix-I includes the effect of the seismic environment of the site, the importance factor related to the structures and the response reduction factor. Hence, the design spectra do not require any further consideration of the zone factor (Z), the importance factor (I) and response reduction factor (R) as used in the IS:1893 (Part 1 to Part 4).			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 2 OF 36

CLAUSE NO.	PROJECT INFORMATION			एनटीपीसी NTPC
	Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: a) Steel structures : 2% b) Reinforced Concrete structures : 5% c) Reinforced Concrete Stacks : 3% d) Steel stacks : 2%			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 3 OF 36

CLAUSE NO.	PROJECT INFORMATION 		
	Method of Analysis Since most structures in a power plant are irregular in shape and have irregular distribution of mass and stiffness, dynamic analysis for obtaining the design seismic forces shall be carried out using the response spectrum method. The number of vibration modes used in the analysis should be such that the sum total of modal masses of all modes considered is at least 90 percent of the total seismic mass and shall also meet requirements of IS:1893 (Part 1). Modal combination of the peak response quantities shall be performed as per Complete Quadratic Combination (CQC) method or by an acceptable alternative as per IS:1893 (Part 1). In general, seismic analysis shall be performed for the three orthogonal (two principal horizontal and one vertical) components of earthquake motion. The seismic response from the three components shall be combined as specified in IS:1893 (Part 1). The spectral acceleration coefficient shall get restricted to the peak spectral value if the fundamental natural period of the structure falls to the left of the peak in the spectral acceleration curve. For buildings, if the design base shear (V_B) obtained from modal combination is less than the base shear ($\bar{V}_B$) computed using the approximate fundamental period (T_a) given in IS:1893:Part 1 and using site specific acceleration spectra with appropriate multiplying factor, the response quantities (e.g. member forces, displacements, storey forces, storey shears and base reactions) shall be enhanced in the ratio of $\bar{V}_B / V_B$. However, no reduction is permitted if $\bar{V}_B$ is less than V_B. Design/Detailing for Ductility for Structures The site specific design acceleration spectra is a reduced spectra and has an in-built allowance for ductility. Structures shall be engineered and detailed in accordance with relevant Indian/International standards to achieve ductility.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 4 OF 36

CLAUSE NO.	PROJECT INFORMATION 
	APPENDIX – I SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT The various site specific seismic parameters for the project site shall be as follows: 1) Peak ground horizontal acceleration : 0.17g 2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra a) for special moment resisting steel frames designed and detailed as per IS:800 : 0.043 b) For special concentrically braced steel frames designed and detailed as per IS:800 : 0.032 c) for special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.026 d) for RCC chimney, RCC Natural Draft Cooling Tower : 0.085 e) For Liquid retaining tanks : 0.051 f) for Steel chimney, Absorber tower, Vessels : 0.064 g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below, in general (excluding special structure/ configuration/materials) : 0.043 3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.085 Note: g = Acceleration due to gravity The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9 SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III) PAGE 5 OF 36

CLAUSE NO.	PROJECT INFORMATION				
	ANNEXURE-A				
	<u>HORIZONTAL SEISMIC ACCELERATION SPECTRAL</u> <u>COEFFICIENTS</u> <u>(In units of 'g')</u>				
	Time Period (Sec)	Damping Factor (as a percentage of critical damping)			
		2%	5%	3%	
	1.450	1.846	1.295	1.594	
	1.500	1.785	1.252	1.541	
	1.550	1.727	1.212	1.492	
	1.600	1.673	1.174	1.445	
	1.650	1.622	1.138	1.401	
	1.700	1.575	1.105	1.360	
	1.750	1.530	1.073	1.321	
	1.800	1.487	1.043	1.284	
	1.850	1.447	1.015	1.250	
	1.900	1.409	0.988	1.217	
	1.950	1.373	0.963	1.186	
	2.000	1.339	0.939	1.156	
	2.050	1.306	0.916	1.128	
	2.100	1.275	0.894	1.101	
	2.150	1.245	0.873	1.075	
	2.200	1.217	0.854	1.051	
	2.250	1.190	0.835	1.028	
	2.300	1.164	0.817	1.005	
	2.350	1.139	0.799	0.984	
	2.400	1.115	0.783	0.963	
	2.450	1.093	0.767	0.944	
	2.500	1.071	0.751	0.925	
	2.550	1.050	0.736	0.907	
	2.600	1.030	0.722	0.889	
	2.650	1.010	0.709	0.872	
	2.700	0.991	0.696	0.856	
	2.750	0.973	0.683	0.841	
	2.800	0.956	0.671	0.826	
	2.850	0.939	0.659	0.811	
2.900	0.923	0.648	0.797		
2.950	0.907	0.637	0.784		
3.000	0.892	0.626	0.771		
3.050	0.878	0.616	0.758		
3.100	0.864	0.606	0.746		
3.150	0.850	0.596	0.734		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 7 OF 36	

CLAUSE NO.	PROJECT INFORMATION	एनटीपीसी NTPC	
	Analysis for dynamic effects of wind must be undertaken for any structure which has a height to minimum lateral dimension ratio greater than “5” and/or if the fundamental frequency of the structure is less than 1 Hz. Susceptibility of structures to across-wind forces, galloping, flutter, ovalling etc. should be examined and designed/detailed accordingly following the recommendations of IS:875(Part-3) and other relevant Indian standards. It should be estimated if size and relative position of other structures are likely to enhance the wind loading on the structure under consideration. Enhancement factor, if necessary, shall suitably be estimated and applied to the wind loading to account for the interference effects. Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: a) Welded steel structures : 1.0% b) Bolted steel structures/RCC structures : 2.0% c) Prestressed concrete structures : 1.6% d) Steel stacks : As per IS:6533 & CICIND Model Code whichever is more critical. ANNEXURE-B SITE SPECIFIC DESIGN PARAMETERS The various design parameters, as defined in IS: 875 (Part-3), to be adopted for the project site shall be as follows: a) The basic wind speed “V_b” at ten metres above the mean ground level : 45 metres/second b) The risk coefficient “K₁” : 1.07 c) Category of terrain : Category-2		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 9 OF 36

CLAUSE NO.	TECHNICAL REQUIREMENTS			
7.00.0	FOUNDATION SYSTEM AND GEOTECHNICAL DATA			
7.00.01	Employer had carried out geotechnical investigation in the vicinity of proposed structures during the plant construction stage. The available boreholes in the vicinity of proposed structures are enclosed at Annexure-IV. The provided soil data is limited and the proposed foundation system is with the best efforts based on the available data. The onus of correct assessment / interpretation and understanding of the existing subsoil condition is on the Bidder. Owner is not responsible for any variation in the provided soil data and foundation system.			
7.00.02	The available soil data is of the vicinity of the proposed structures, therefore, bidder shall carryout his own detailed soil investigation for facilities under this package and shall be as per the scheme approved by owner. The scheme for geotechnical investigation shall be as given at Clause 7.07.00 and shall be approved by owner before execution. Geotechnical investigation work shall got executed by the Contractor through the agencies as mentioned in Clause No. 7.07.03. However, no time extension shall be given on account of soil investigation carried out by the Bidder. The geotechnical investigation report shall be prepared with detailed recommendations regarding type of foundation and allowable bearing pressure for various structures/ facilities and other soil parameters. The report shall be submitted for Owner's approval prior to commencement of design of foundation.			
7.00.03	The furnished borelog details are specific to the co-ordinates where the boreholes have been carried out and are provided for bidder's information only. Soil profile in the proposed area may vary with respect to the borelogs enclosed for bidder's information. Bidder has to consider all such variations in his estimation, over the extent of the work to be carried out. The Bidder should note that nothing extra whatsoever on account of variation between soil data provided by Owner and that found by the Bidder during geotechnical investigation by him or during execution of works, shall be Payable			
7.00.04	Tank Foundations a) The tanks shall rest on flexible tank pad foundation, resting on sand with concrete ring wall to retain sand. Base of the concrete ring wall shall not rest on the expansive soil, if any. b) Entire loose/ soft soil inside the concrete ring wall shall be removed and shall be filled with sand. Sand for filling shall be clean and well graded conforming to IS 383 with grading Zone I to III. c) Sand shall be spread in layers not exceeding 30cm compacted thickness over the area. Each layer shall be uniformly compacted by mechanical means like plate vibrators, small vibratory rollers, etc to achieve a relative density of not less than 80%. d) Other requirements of tank foundations shall be as per IS 803 and as specified elsewhere in the specifications.			
7.02.00	Foundation System The requirements for the foundation system to be adopted are as given in subsequent clauses. Depending upon the depth of competent strata/stratum, type of structures, functional requirement of facility, extent of cutting / filling, suitable foundation, open or pile shall be adopted with approval of owner.			
KORBA STAGE-I, II & III FGD Package		TECHNICAL SPECIFICATION	SUB-SECTION- CIVIL WORKS	PAGE

CLAUSE NO.	TECHNICAL REQUIREMENTS			
7.02.01	General Requirements			
	a) All structures/equipment shall be supported either on suitable open foundations (isolated, combined, raft) or pile foundations depending on type of structures/facilities, sub-strata, topography etc.			
	b) The roads, ground floor slabs, trenches, pipe pedestals, channels/drains and staircase foundation with foundation loading intensity less than 4 T / M2 may be supported on open / shallow foundations resting on virgin / controlled compacted filled up soil.			
	c) No other foundation (other than as mentioned in (b) above) shall rest on the filled up ground / soil.			
	d) No foundation shall rest on the black cotton soil.			
	e) Before execution of work the bidder shall ensure that there is no obstruction to underground/over ground facilities like sewer lines, pipe lines etc. Any such damage and remedial/ rectification measures shall be at the contractors cost. For underground facilities survey, Ground Penetration Radar (GPR) may be used.			
	f) Bidder shall also ensure that there is no damage to existing nearby foundations and the foundations pertaining to this package are not placed at shallower depth than the nearby foundations. If required depth of foundation is deeper than the existing foundations, proper protection shall be provided to existing foundations.			
	g) All foundations shall be designed in accordance with relevant parts of the latest revisions of Indian Standards.			
	h) The water table for design purpose shall be considered at Finished Ground Level.			
	i) A combination of open and pile foundations shall not be permitted under the same equipment / structure / building.			
	j) Foundation for equipments on ground floor			
	For equipments of static weight upto 1.5 T, the equipment may be supported on the ground floor slab by locally thickening the slab. Thickening of the ground floor slab shall be done upto an extent of about 0.6 m beyond the plan area of the equipment on all the sides. Further, the load intensity below the equipment shall be limited to 4T/m2. Other requirements of floor slab and compaction below the floor slab shall be adhered, as specified elsewhere in the specifications.			
	For equipment's of static weight between 1.5 T and 20 T, the equipment may be supported on compacted sand filling with the load intensity below the equipment limited to 4T/m2. The minimum depth of foundation is 1.0m below FFL. Other requirements of sand compaction below the foundation shall be adhered, as specified elsewhere in the specifications.			
	For equipment of static weight more than 20 T, the equipment foundation shall be taken to the founding level or shall be built up with PCC from the level as mentioned in the Table 2. The pedestal of equipment foundation or the foundation Block shall be isolated from the adjoining floor slab by providing bitumen impregnated fiber board of			
KORBA STAGE-I, II & III FGD Package		TECHNICAL SPECIFICATION	SUB-SECTION- CIVIL WORKS	PAGE

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC							
7.02.02	minimum 50 mm thick, conforming to IS: 1838 all around the equipment pedestal for the full depth of the floor slab.										
	Open Foundations In case open foundations are adopted, following shall be adhered to. a) The minimum width of foundation shall be 1.0 m. b) Minimum depth of foundation shall be 1.0m below Ground Level. c) It shall be ensured that all foundations of a particular structure/ buildings/ facility shall rest on one bearing stratum. d) Wherever the intended bearing sub-strata is virgin soil stratum but the actual stratum encountered during foundation excavation consists of filled up soil at founding level, under such cases either the foundation shall be lowered completely into the virgin stratum or the filled up soil upto the virgin layers shall be removed and built up through PCC (1:4:8) up to designed foundation level. e) During detailed engineering, the allowable Bearing Pressure shall be adopted after approval of geotechnical investigation report. In case any loose/soft pockets in rocky strata is encountered at founding level, the same shall be removed completely upto the hard strata and filled up with PCC (1:4:8). f) For open foundations, the total permissible settlement and differential settlement shall be governed by IS: 1904 / IS: 13063 and from functional requirements whichever is more stringent. However, total settlement shall be restricted to the following: <table><tr><td>Isolated & Raft (machine foundation)</td><td>25 mm</td></tr><tr><td>Isolated & Strip (other than machine foundation)</td><td>40 mm</td></tr><tr><td>Raft (other than machine foundation)</td><td>75 mm</td></tr><tr><td>Foundations in Weathered rock/ rock</td><td>12 mm</td></tr></table>				Isolated & Raft (machine foundation)	25 mm	Isolated & Strip (other than machine foundation)	40 mm	Raft (other than machine foundation)	75 mm	Foundations in Weathered rock/ rock
Isolated & Raft (machine foundation)	25 mm										
Isolated & Strip (other than machine foundation)	40 mm										
Raft (other than machine foundation)	75 mm										
Foundations in Weathered rock/ rock	12 mm										
7.02.03	Pile Foundations – In case piles are adopted, following shall be adhered to :										
KORBA STAGE-I, II & III FGD Package		TECHNICAL SPECIFICATION	SUB-SECTION- CIVIL WORKS	PAGE							

CLAUSE NO.	PROJECT INFORMATION			एनटीपीसी NTPC
	ANNEXURE-I			
	Vicinity Map			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB SECTION-II-A4 PROJECT INFORMATION (KSTPP-I, II & III)	PAGE 19 OF 36	

CLAUSE NO.		PROJECT INFORMATION										ANNEXURE-II									
		जलवायवी सारणी CLIMATOLOGICAL TABLE										BACK									
STATION : चम्पा		श्रेणी का माप से ऊँचाई HEIGHT ABOVE M.S.L. 245 METRES										प्रणीत या अवधि BASED ON OBSERVATIONS 1971-1987									
STATION : Champā		LAT. 22°02' LONG. 82°42'																			
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास		मास										मास									
मास</																					

22 of 410
This page is the part of Tech. Spec. No. PE-TS-466-571-A102

CLAUSE NO.	PROJECT INFORMATION				एनटीपीसी NTPC
	----- Sl. No. Constituent				



NTPC Limited
(A GOVT. OF INDIA ENTERPRISE)
ENGINEERING DIVISION



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

Sub Section : C

REV. 00

SECTION: I

SUB SECTION: C

TECHNICAL SPECIFICATION

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 1 OF 18	

SECTION: I

SUB-SECTION: C 1

SPECIFIC TECHNICAL REQUIREMENT

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 2 OF 18	

1.0 SYSTEM DESCRIPTION

The purpose of the specification is to provide complete Lime feeding/dosing system (LDS) for use in waste water neutralization in Flue Gas Desulphurization (FGD) plant for NTPC's KORBA STAGE-I (3X200 MW), STAGE- II (3x500 MW) & STAGE- III (1x500 MW) STPP under the scope of this tender.

Lime dosing system is provided to dose lime solution in wastewater tank of FGD system to increase pH from acidic zone to neutral (or slightly basic pH) (i.e. from 5.5 to 7.0) and after mixing of the effluent (using agitator/re-circulation system of the pumping system), the effluent shall be discharged once the waste water has been neutralized to desired pH. The lime dosing is envisaged to be done in wastewater tank continuously.

Lime powder is to be stored in sacks in storage room provided at the ground floor of Gypsum Dewatering Building. Lime powder is filled manually in surge hopper/(s), which shall feed lime to vibrating feeders/Bucket Elevators (Bucket conveyor). Bucket elevator discharges lime powder in lime silo, from where the lime powder is fed to neutralisation tank via outlet chute/pipe using rotary feeder and screw conveyor provided at the bottom of lime silo. The lime is being dissolved in service water inside neutralization tank with the help of the motorized agitator (provided in neutralization tank). The dilute solution of lime prepared in neutralisation tank is then fed to the wastewater tank by means of lime slurry pumps (1W+1SB - common for LDS). The dosing is controlled as per requirements of desired pH in wastewater. (Tentative range of neutralization is from pH 5.5 to pH 7.0).

All piping, valves & instrumentation up to the employer's terminal point shall be in the supplier's scope. Supply of complete lime storage, feeding & dosing system shall be in supplier's scope. The complete waste water neutralization system shall be automated and controlled from the control room (DCS control system- by BHEL).

2.0	TECHNICAL INFORMATION	
2.1	Quantity of Lime Feeding/Dosing System	Two (2x100%) Lots (one working +one standby), however Common Bucket Conveyor (1 no.) and (1W+1SB) dosing pumps for LDS
2.2	Quantity of water to be neutralized	105 m ³ /hr.
2.3	Purity of Lime	83 %

3.0 SCOPE OF SUPPLY & SERVICES

The specification covers Supply part, Services part and supply of Mandatory spares. Scope of Supply shall comprise of design (i.e. Preparation and submission of drawing /documents including "As Built" drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor's works, painting, maintenance tools & tackles, fill of lubricants & consumables (till handing over), mandatory spares along with spares for erection, start-up and commissioning, proper packing, forwarding, shipment and delivery of all equipment at site. Services part covers **supervision services** for erection & commissioning, trial run at site and carrying out Performance guarantee tests at site. Training of customer/clients O&M staff covering all aspects of the Lime feeding/dosing system (LDS) and inclusive of training for Operation & Maintenance (6 days) at Site, training of customer's personnel at manufacturer's works (6 man-days including lodging and boarding), troubleshooting etc. shall be part of services to be provided by supplier. Services also include handing over of LDS package complete with all accessories in flawless

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 3 OF 18	

condition to the customer, for the total scope defined for lime dosing/feeding system as per BHEL NIT & tender technical specification, amendment & agreements till placement of order for Lime Feeding/Dosing System (LDS).

Design: Includes basic engineering, detail engineering, preparation and submission of engineering drawings/calculations/datasheets/quality assurance documents/field quality plans, storage instructions, commissioning procedures, Erection & assembly Drawings, operation & maintenance manuals, performance guarantee test procedures and assisting BHEL in obtaining time bound approval from NTPC.

Supply: Includes manufacturing/fabrication, shop floor testing, stage inspections, final inspections, painting, packing & transportation, customer clearance/port clearance (as applicable) and any other statutory clearances and delivery at site.

Services: following services are included in vendor's scope-

1. Supervision of Erection and Commissioning of the complete Lime feeding/dosing system at project site is in bidder's scope. Detailed Erection and commissioning procedure, check list shall be submitted by successful bidder and same shall be followed by BHEL for erection and commissioning of the system at site.
2. Trial run at site and carrying out Performance guarantee tests at site & handover in flawless condition of the package to the customer is in bidder's scope.
3. Training of customer/ client O&M staff covering all aspects of the Lime Feeding/Dosing system - operation & maintenance (6 days) at Site is in bidder's scope.
4. Training of customer at manufacturer's works (6 man-days) including lodging and boarding) is in bidder's scope.
5. TA/DA, boarding and lodging of bidder's personnel shall be borne by the bidder and shall be inclusive in supervision portion.
6. During implementation of logic and FAT of BHEL DCS, bidder will depute his concerned representative for technical support as and when required by customer / BHEL. Bidder to attend regular engineering meeting with BHEL and Customer fortnightly in BHEL or Customer office as decided during detail engineering. Vendor will depute his entire concerned engineering representatives along with the project manager for discussion and approval of engineering drawings/ documents during detailed engineering to meet project's various milestones and completion schedule, without any price implication to BHEL and Customer. Meeting can be held at site also.
7. Visits shall be planned by BHEL site team and prior intimation shall be sent to supplier for visit to site for supervision services. Bidder shall be informed at least 10 days in advance for the requirement of visit at site. Visiting team shall consist of one or two experts of bidder as deemed necessary by them.
8. Relevant requirements as per GTR, GCC, ECC & SCC etc.

Supplier's scope covers complete Lime Feeding/Dosing system including start-up spares and required special tools. Supplier to refer enclosed progressive 'Layout Details of Gypsum Dewatering building' drg. No.- 2100-109-PVM-B-269. Supplier to note that Lime preparation/neutralisation tanks shall be placed on ground level. Slurry feeding/dosing pumps shall also be placed on ground level for further dosing lime to Waste Water Tank (00 HTM 05 BB 001)- refer 'P & ID -Waste Water System' drg no.- 2100-109-PVM-F-046.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 4 OF 18	

The scope of supply for complete Lime Feeding/Dosing system shall include but not limited to the following:

S.No	Scope of work for Lime Dosing/Feeding system
1.	Entire Lime Feeding/Dosing System as per cloud marked portion of P&ID (drg no.- 2100-109-PVM-F-046, 2-sheets), Equipment Data sheet (Section-II, Annexure-8) & other Technical Specification requirements enclosed with this specification.
2.	1- No. of Surge hopper shall be supplied (sloping portion lined with SS 304).
3.	1-No. of Vibrating feeder/feeding arrangement shall be supplied for feeding Lime from surge hopper to Bucket elevator.
4.	1-No of Continuous Discharge twin feed type Bucket Elevator(conveyor) shall be supplied with standard components like buckets(SS-304), belt, drive/tail pulleys with shaft & bearing assemblies, middle/top/bottom casings, take up unit, drive base frame, drive unit – geared motor, chain for final power transmission, zero speed switch, complete with 2-way (Motorised) Diverter Flap Gate along with all flanges/chutes, supporting steel structure, platforms, ladders, railings, and holdback as applicable along with all accessories and necessary hardware to handle/ discharge lime from ground level to Lime silo. Chute for feeding lime from bucket elevator to the lime silos shall be supplied.
5.	2- Nos of Lime Silo (MS with SS 304 lining on conical portion) complete with supporting steel structure, platforms, ladders, railings, level switches, air relief devices, etc. shall be supplied. Aeration pads/ flexible vibro pads/ electro-magnetic vibrators for conical portion of silo shall be supplied as per system requirement to ensure free flow of lime from silo to onward equipment.
6.	2-Nos. of self-cleaning bag filter system of suitable capacity along with blowers, automatic/on-load cleaning system, etc. shall be supplied.
7.	2-Sets of flanges of 250 NB/suitable size for connecting silo to inlet chute of downstream equipment (Valve/ Rotary feeder / screw conveyor) shall be supplied.
8.	2-Nos of Manual gate/ KGV shall be supplied for isolation purpose /control the feeding of lime from lime silo to downstream equipment.
9.	2-Nos of Motorized Gates/KGV shall be supplied to control the feeding of lime from lime silo to screw conveyor
10.	2-Nos of Rotary vane feeder/ Rotary air lock feeders (MOC –Stainless Steel) along with gear box, motor, etc shall be supplied.
11.	2-Nos of Screw Conveyor shall be supplied. Screw conveyors shall be complete with screw flight with pipe, trough, end plates, inlet/outlet standard chutes, end shafts with bearings & plumber blocks, drive base frame, dust seals, drive geared motor, output coupling, zero speed switch and necessary hardware along with all accessories to handle/ discharge lime to neutralization.
12.	2-Nos of Neutralisation Tank (MSRL) with SS dissolving basket, Agitator of SS construction with motor, reduction gear and its mounting arrangement, drain, manholes, level transmitters, level gauges, etc shall be supplied.
13.	2-Nos Lime Slurry Pumps (1W+1S after Neutralisation tank) shall be supplied.
14.	Process water piping from TP outside building to neutralisation tanks along with overflow and drain piping of tanks, back-flushing pipeline along with valves, fittings, etc shall be supplied.
15.	Lime slurry piping from Neutralization Tanks to feeding/dosing pumps inlet & from feeding/dosing pumps outlet to Waste water tank inlet along with re-circulation line with all required valves, fittings, etc shall form part of supply.
16.	All Interconnecting pipe/ ducts, valves and all chutes (inlet and discharge) for complete lime feeding system shall also be supplied.
17.	Painting and Rust Prevention during shipment and construction shall be ensured by bidder.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 5 OF 18	

S.No	Scope of work for Lime Dosing/Feeding system
18.	Transportation of complete lime feeding/dosing system to site.
19.	Special tools & tackles as applicable. These shall form the part of main supply (if applicable).
20.	Erection and start-up spare as applicable. These shall form the part of main supply (if applicable).
21.	Installation, operation and maintenance manuals.
22.	Bidder to quote for the Recommended Spare Parts (for 24 months operation) with break up price (shall not be part of evaluation/PO).
23.	All instruments as required for the complete lime dosing/feeding system shall be supplied.
24.	Inspection and testing at site
25.	Any other items required for completeness of the equipment other than items covered in the exclusions.
26.	Mandatory spares as per attached list in specs at Section I-D-Annex II.
27.	Supervision of E &C, trial run at site and carrying out Performance guarantee tests at site, training of customer/ client O&M staff is also in bidder's scope

4.0 BASIC DESIGN

This section covers the Design manufacturing and performance requirement of the Lime feeding/dosing system and accessories.

4.1 BUCKET ELEVATOR SYSTEM (CONVEYOR) SYSTEM (1-Set)

1 General Requirement

The type (Centrifugal/Continuous) of the Bucket Elevator shall be chosen by Bidder for the material and conditions specified. The Bucket Elevator shall be sized to handle the design capacity at the specified material bulk density & maximum material size. The equipment shall be complete with all necessary sub-systems and components and shall be designed and supplied in conformance with the attached datasheets, site conditions, specific Employer's requirements and applicable International, National, State and Local codes. The Equipment shall be complete in all aspects and all items required for erection/smooth operation shall be in Bidder's scope, unless otherwise noted in exclusions. Sizing of the equipment and components shall be the responsibility of the Bidder, based on the service conditions specified.

2 Codes and Standards

All design, fabrication, testing, supply and erection, if applicable, shall conform to the latest edition of all the relevant standards and regulations issued by the governing bodies. Bidder shall follow the applicable INDIAN/INTERNATIONAL codes by the following Organizations:

EN European Norm

IEC International Electro Technical Commission

ISO International Organization for Standardization

DIN German Institute for Standardization (To be used when no EN standards exist)

Other internationally acceptable standards/codes, which ensure equal or higher performance than those specified, shall also be accepted. Nothing in this specification shall be construed to relieve the contractor of the required statutory responsibility. In case of any conflict in the standard and this specification, the decision of the Employer shall be final and binding.

3 Design Criteria

The equipment shall be designed for continuous twenty-four-hour service. The Equipment shall be designed for service in a heavy-duty industrial application, handling abrasive materials in a dusty environment. The

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 6 OF 18	

Bucket Elevator should be sized to handle the design capacity as indicated on the Data Sheet with the minimum material bulk density and a maximum bucket filling of 75%.

4 Casing

Casing to be self-supported, dust-tight construction and capable of supporting head shaft, drive, and service platform. Head section is to be split and equipped with handles or lifting lugs for easy removal. Access and inspection doors are to be provided. Intermediate sections are to have a minimum plate thickness of 4 mm. Boot section to be fabricated of minimum 6 mm steel plate, with front and rear access panels. A beam is to be provided in casing for servicing internal gravity take-up. The beam may be located either in the boot section or intermediate section as applicable.

5 Buckets

Size, capacity and type of buckets and appropriate reinforcement necessary for the application shall be adequately sized. Provide pin holes in bottom of buckets for air relief, as necessary, when handling materials such as Lime. Bucket width is to be a minimum of four times the maximum particle size.

6 Belting

Belting shall be provided as specified elsewhere in the specification.

7 Pulley

Drive and guide pulleys shall be provided as specified elsewhere in the specification and shall be at least the minimum recommended for belt conveyor pulleys.

8 Head Shaft and Bearings

The bearings on head shaft to be antifriction type with one bearing fixed and the other expansion. All bearings are to have an L10 life of 60000 hours.

9 Foot Shaft and Bearings

The tail shaft is to be of hardened steel with tool steel sleeves operating in heat treated white iron bearings. All bearings are to have an L10 life of 60000 hours.

10 Take-up

Take-up shall be screw or internal gravity type with guide rails and weights included.

11 Drive

Bucket elevator drive should be sized as follows:

Minimum power for drive, either:

100% bucket filling @ minimum material bulk density, or

75% bucket filling @ maximum material bulk density, whichever is greater.

12 Inspection and Access Doors

Inspection doors and access doors shall be loose-hinged type with quick-opening jamb bar fasteners and gaskets enclosed and retained in the door. Access doors shall be 1.5m minimum.

13 Dust Vent

A dust collecting vent in the head section and boot section shall be furnished with drilled flanges. Bidder quote is to include recommended vent volumes for the boot and head sections of the elevator. The Pick-Up velocity shall not be greater than 2.5m/sec.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 7 OF 18	

14 Drive Equipment

The Drive Equipment for Bucket Elevator shall be as specified elsewhere in the Specification.

4.2 SCREW CONVEYOR(2-Nos.)

- 1 Necessary overload protection guard for geared motor and drive chain to be provided.
- 2 Zero speed switch not required. However, speed sensing flag to be provided.
- 3 The motor and Gear reducer should be mounted such that there is not vibration during operation of the conveyor.
- 4 All fasteners shall be of Gr. 8.8 and reputed make.
- 5 The data as per Annexure-8 to be filled in by vendor (in the same format only).

4.3 LIME SILOS (2-Nos.)

Contractor shall provide 2x 100% Lime Storage Silos for feeding lime to the Lime Neutralisation tanks. The lime storage silo shall be of minimum 24 hr. capacity (refer tentative dimensions in data sheet & attached sketch) and shall be complete with supporting steel structure, platforms, railings, ladders, power operated outlet gates, level switches, air relief devices, etc. For dust free operation each silo should be provided with a covering arrangement and a self-cleaning bag filter system of suitable capacity along with blower, automatic/on-load cleaning system, etc. The storage silos and hopper cones shall be fabricated of minimum 10 mm thick carbon steel with a SS lining of grade SS304 of minimum 4 mm thickness in the complete cones to ensure reliable discharge of material. The design of storage silos shall confirm to IS 9178 or any other proven international standards. The storage silo shall be capable of feeding the lime by motorized rotary feeding system to the Lime Neutralization tank.

4.4 NEUTRALISATION TANKS (2-Nos.)

Contractor shall provide 2x100% Lime Neutralization tanks (lime preparation/dosing tanks) which shall be of minimum 8 hr. capacity (refer tentative dimensions in data sheet & attached layout) made of carbon steel with rubber lining.

Lime Neutralization tanks shall be designed, fabricated, erected and tested in accordance with the IS:803, latest edition. Additional Corrosion allowance of 3mm on the minimum tank shell thickness as calculated by IS:803, latest edition shall be provided by the Contractor. Tanks shall be made from IS:2062 quality mild steel plates of tested quality. The tanks shall be of welded construction. Interior surface of the tanks shall be lined with replaceable chlorobuty/bromobutyl rubber lining of minimum 5 mm thickness and the outside surface shall be coated with paint as approved by the Employer. The tanks shall be provided with SS dissolving basket, Agitator of SS construction with motor, reduction gear and its mounting arrangement, drain, manholes, over flow & inlet level control valves, level transmitters, level gauges, etc. Coarse-screen(s) at suction-side of the lime dosing pumps (pumps installed after the neutralisation tank shall be provided.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 8 OF 18	

4.5 AGITATORS (2nos, 1 in each Neutralisation Tank)

Agitators shall be supplied in neutralisation tanks to prevent caking and settlement of particles out of the lime slurry. Agitators shall be designed for continuous operation unless otherwise specified. Vertical agitators shall be used in Neutralisation tank. The design of the agitators shall be of proven type.

Standard type agitators with suitable characteristics shall be used wherever practical. The agitators shall be complete with motor, gearbox, agitator shaft, coupling, safety guards, mechanical seal, impeller, support legs, agitator mounting flange including bolts nuts and gasket etc.

All agitator parts and accessories in contact with the stirred fluid shall be constructed of materials specifically designed for the conditions and nature of the stirred fluid and be resistant to erosion and corrosion. The material for the shaft and agitator blades shall be in accordance with Alloy 926 or better. This does not release the Contractor of the responsibility for selecting the correct materials. Each agitator and its associated equipment shall be arranged in such a manner as to permit easy access for operation, maintenance and agitator removal without interrupting plant operation.

To prevent mechanical blocking load start-up after standstill of pumps, piping and agitators for slurries shall be applied with C-hose connection. Lifting lugs and eyes and other special tackle shall be provided as necessary to permit easy handling of the agitators and their components.

Static and dynamic (as far as applicable) balancing of all agitators shall be carried out after assembly.

All agitator parts and components shall be designed and calculated for fatigue life, considering maximum bending loads, induced by fluctuating hydraulic forces and torsional loads, based on the installed motor power. All exposed moving parts shall be covered by guards.

The shape of the impeller blades of agitators shall be designed to avoid wear on the impellers which will affect the agitator performance as specified for a minimum period of 2 years of continuous operation under design conditions for the range of application specified in the specification. In order to avoid excessive wear impeller tip speeds must not exceed 12 m/s. Belt drives (if applied) shall be properly designed to provide a minimum lifetime of 2 years under design conditions. Detailed calculation is to be submitted by bidder in support of selected rpm of agitator.

4.6 LIME FEEDING/DOSING PUMPS

The Contractor shall offer only proven design lime feeding/dosing pumps which were in successful operation in similar application at previous installations. The design, manufacture, installation and testing of the pumps shall follow the latest applicable Indian / International (ASME / EN / Japanese) Standards.

The pumps shall be designed for continuous operation. The pump shall be capable of delivering the rated flow at rated head with margins.

All the slurry pumps shall be provided with motorized suction and discharge valves. In addition, flushing water lines with motorized valves shall be provided for each pump for automatic flushing of the pump after

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 9 OF 18	

each shut down. The flushing water for the pumps shall be taken from the process water supply. The pump casing should be radially split to allow easy removal of impeller.

All the pump wear parts in contact with the slurry shall be provided with replaceable rubber/elastomer liners suitable for the fluid handled. The Bidder can also offer a hi chrome alloy line pump if the Bidder has previous experience of the same for similar applications. The material used by the contractor shall be proven in previous installations.

The material and thickness of the liners shall ensure a minimum service life of 2 years before replacement. All the wear parts of the pump shall be guaranteed for a minimum wear life of not less than 14000 hrs. The design of the shaft shall ensure that the operating speed is at least 20% above the critical speed of the shaft. The pump shall be provided with seals of proven type and shall be designed for minimization of seal water consumption (if/as applicable). The shaft shall be supported on heavy duty ball/roller bearings.

4.7 LIME SLURRY LINES, VALVES & INSTRUMENTS

Lime slurry pipes shall be designed to keep the velocity above the settling velocity under all operating conditions. The contractor may provide a recirculation line with motorized isolation valve for the above purpose.

All the pipes handling slurry shall be provided with replaceable rubber lining of proven quality. The Contractor can provide slurry pipes of size lower than 3" made up of abrasion resistant FRP material (silicon carbide coating on slurry exposed surface) if it has previous experience of providing the same.

The isolation valves provided in all the slurry lines shall be of knife gate type/butterfly type unless specifically mentioned. Motorized actuators shall be provided for valves requiring frequent operation as indicated in the relevant scheme. The valves shall be of proven type and the contractor shall submit a detailed valve schedule for employer's approval. Reference list for previous installations for similar application shall also be furnished to the employer. Bidder shall provide all necessary arrangements for purging & flushing of all the process pipelines, equipment etc.

4.7.1 PIPING, VALVES AND ACCESSORIES: Complete engineering and supply of interconnected piping (slurry, air and water pipes) along with valves, rubber lining (wherever applicable), supports, gaskets, fasteners and accessories which is integral to Lime feeding/dosing system (LDS) – One (1) set* which is broadly defined below:

- Service water piping from service water line tapping to Neutralization Tank inlet.
- Slurry piping from Neutralization Tank to Waste water tank
- Process water piping from TP outside building to wash tanks along with overflow and drain piping of tanks.
- Instrument air piping from TP outside building up to equipment related to the system

4.7.1.1 Expansion Joints at suction and discharge of each pump/other equipment, as applicable: One (1) set*

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 10 OF 18	

4.7.2 Instruments for the entire Lime feeding/dosing system including integral piping as defined at 4.7.1 above (minimum requirement for each Lime feeding/dosing system is given in the P&ID): One (1) set*

4.7.3 SCOPE OF SUPPLY (ELECTRICAL): For Electrical scope, refer Electrical specification (Sub-section- C3 of Section-I) in conjunction with cloud marked portion of P&ID (drg no.- 2100-109-PVM-F-046, 2 sheets).

4.7.3.1 All motors shall be provided with suitable double compression cable gland. Bidder shall provide cable glands and lugs for all equipment in his scope. Cables shall be terminated using double compression type cable glands and solder less crimping type tinned copper cable lugs. Bidder shall provide junction box. The Junction box shall have provision for installing glands of suitable size on the bottom of the box. All LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615.

4.7.4 SCOPE OF SUPPLY (C&I): For Control & Instrumentation (C&I) scope, refer C&I specification (Sub-section- C4 of Section-I) in conjunction with cloud marked portion of P&ID (drg no.- 2100-109-PVM-F-046, 2 sheets)

4.7.4.1 Control System: Control system shall be DDCMIS/ DCS which shall be BHEL scope. Each equipment shall be furnished with required instrumentation and electrical accessory devices mounted and connected to a junction box/ cabinet.

4.7.5 Electric and C&I common equipment including but not limited to

- i. Local control panel, if required
- ii. LT Motors
- iii. Junction Box
- iv. Instruments
- v. Push buttons

4.7.6 First fill lubricants: All the first fill and one year's toppings requirements of consumables such as grease, oil, lubricants, servo fluids etc. which will be required to put the equipment covered under the scope of specifications into successful commissioning/initial operation and to establish completion to facilities should be provided by contractor/supplier.

4.7.7 Painting and rust prevention during shipment and construction.

4.7.8 Packing & forwarding to project site. Refer project information specified elsewhere in the specification.

4.8 APPROACH AND HANDLING FACILITIES

Proper approach shall be provided for access to all equipment during normal operation and maintenance. Equipment requiring monitoring during regular operation shall be approachable from the ground floor through staircase. Staircase with minimum width of 1200 mm shall be provided for approach to elevated structures at 5m height from the nearest platform. Below this height a vertical ladder with minimum clear width of 600 mm may also be acceptable. Platform with a minimum clear width of 1000 mm shall be provided for LDS equipment. Similar platforms shall be provided at subsequent elevations if they are more than 3000 mm apart from each other. Ladders/staircase shall be provided for the access to the platform. A

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 11 OF 18	

1500 mm space shall be provided around all pumps. Minimum Headroom (free height) under all floors, ducts, walkways and stairs shall be 2.50 M.

4.9 Mandatory spares as defined as Annexure-II, Sub Section-D of Section I.

4.10 Recommended spare parts list to be furnished (is not part of scope of supply/evaluation).

4.11 Any other items required not covered above but required for the completeness of the system; same shall be included in the offer and shall be supplied by the Bidder/supplier. Bidder shall refer to the P&ID enclosed in Annexure-IV, Sub-Section-D of Section-I for the items under the bidder's scope. All the items indicated in the P&ID are minimal requirements.

***One set means complete requirement for lime feeding/dosing system.**

5.0	TERMINAL POINTS
5.1	Process water & instrument air will be provided at one location, located at 5 m from building boundary. Further piping from terminal point to LDS system utilities are in bidder's scope.
5.2	Inlet at Lime feeding surge hopper.
5.3	Lime dosing inlet flange of waste water tank.
6.0	EXCLUSIONS
6.1	Waste water tank and all other items which are outside cloud marked portion of P&ID (drg no.- 2100-109-PVM-F-046, 2 sheets)
6.2	All civil construction.
6.3	Ventilation in area/building.
6.4	Other exclusions control system (excluding Junction box) and as mentioned in Electrical & C&I parts of this specification.
6.5	Process water, Instrument Air, Service Air upto terminal points.
6.6	Monorail beams for electrical hoists

7.0 CODES & STANDARDS AND OTHER REQUIREMENTS

The design of Lime Feeding system shall conform to the latest edition of International codes accepted by the Buyer according to good engineering practice.

List of codes/standards recommended: (The list is not exhaustive)

S.No.	Description	Material	Design & others
1	Piping	AISI, ASTM, ASME, DIN, EN, BS or Equivalent	AFNOR, ANSI, API, ASME, ASTM, AWWA, BS, DIN, EN, EJMA
2	Machinery	AISI, ASTM, ASME, DIN, EN, BS or Equivalent	AFNOR, AFBMA, AGMA, ANSI, API, ASTM, AWS, BS, DIN, IEC, HI, HEI, ISO, NEC, NEMA, EN, TEMA, VDI
3	Instrumentation	AISI, ASTM, ASME, DIN, EN, BS or Equivalent	AFNOR, ANSI, API, ASME, BS, DIN, EN, IEC, IEEE, ISA, ISO, NC
4	Electrical	AISI, ASTM, ASME, DIN, EN, BS	BS, VDE, IEC, EN, ANSI, IEEE, NEMA

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : C1	
			REV.	00
			SHEET 12 OF 18	

		or Equivalent	
5	Civil	AISI, ASTM, ASME, DIN, EN, BS or Equivalent	AFNOR, ASCE, ASNT, BS, DIN, EN, ANSI, ACI, AISC, AWS, SSPC
6	Structural Steel	SA/IS2062	BS/EN 1993 (Eurocode-3) or Equivalent international codes.

The design, materials, construction, manufacture, inspection, testing and performance of Lime Feeding system shall also comply with all currently applicable statutes, regulations and safety codes in the locality where the equipment is to be installed. It is the supplier's responsibility to fully comply with the latest version of changes in regulations, codes and standards. GB Standards are not acceptable.

If there is a conflict between this specification and a referenced document or between the codes and standards the most stringent shall apply.

7.1 In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India as well as of the locality where they will be installed, including the following:

- a) Indian Electricity Act
- b) Indian Electricity Rules
- c) Indian Explosives Act
- d) Indian Factories Act and State Factories Act
- e) Indian Boiler Regulations (IBR)
- f) Regulations of the Central Pollution Control Board, India
- g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India
- h) Pollution Control Regulations of Department of Environment, Government of India
- i) State Pollution Control Board.
- (j) Rules for Electrical installation by Tariff Advisory Committee (TAC).
- (k) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996
- (l) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998
- (m) Explosive Rules, 1983
- (n) Petroleum Act, 1984
- (o) Petroleum Rules, 1976,
- (p) Gas Cylinder Rules, 1981
- (q) Static and Mobile Pressure Vessels (Unified) Rules, 1981
- (r) Workmen's Compensation Act, 1923
- (s) Workmen's Compensation Rules, 1924
- (t) NTPC Safety Rules for Construction and Erection
- (u) NTPC Safety Policy
- (v) Any other statutory codes / standards / regulations, as may be applicable.

7.2 Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply:

- a) Bureau of Indian standards (BIS)
- b) Japanese Industrial Standards (JIS)

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : C1	
		REV.	00
		SHEET 13 OF 18	

- c) American National Standards Institute (ANSI)
- d) American Society of Testing and Materials (ASTM)
- e) American Society of Mechanical Engineers (ASME)
- f) American Petroleum Institute (API)
- g) Standards of the Hydraulic Institute, U.S.A.
- h) International Organization for Standardization (ISO)
- i) Tubular Exchanger Manufacturer's Association (TEMA)
- j) American Welding Society (AWS)
- k) National Electrical Manufacturers Association (NEMA)
- l) National Fire Protection Association (NFPA)
- m) International Electro-Technical Commission (IEC)
- n) Expansion Joint Manufacturers Association (EJMA)
- o) Heat Exchange Institute (HEI)
- p) IEEE standard
- q) JEC standard

- 7.3 Other International/ National standards such as DIN, VDI, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the BHEL Customer's approval, for which the bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases, the bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English.
- 7.4 Two (2) English language copies of all national and international codes and/or standards used in the design of the plant and equipment shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award.
- 7.5 In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the BHEL shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of BHEL such changes and advise BHEL of the resulting effect.
- 7.6 All items of equipment shall comply with the stipulations of Inspectorate of Factories and other statutory bodies of Government of India and Chief Electrical Inspectorate of the State in which the plant site is located, wherever applicable. Wherever required, the successful bidder has to obtain the necessary approvals from statutory authorities and other concerned agencies. All cost on these accounts shall be borne by the successful Bidder.

8.0 COMMON REQUIREMENTS FOR PUMPS

- (a) All the pump wear parts in contact with the slurry shall be provided with replaceable rubber/elastomer liners suitable for the fluid handled. The Bidder can also offer a hi-chrome alloy line pump if the Bidder has previous experience of the same for similar applications.
- (b) The pump shall be provided with seals of proven type. The shaft shall be supported on heavy-duty ball/roller bearings.
- (c) All pumps shall be designed to withstand a test pressure of 1.5 times the maximum possible pump shut off pressure under maximum suction pressure conditions.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : C1	
		REV.	00
		SHEET 14 OF 18	

- (d) Product water flushing lines and drains are to be supplied for each pump handling the prevailing water to avoid corrosion if the pump is out of operation for extended periods.
- (e) The NPSH Values are to be referred to the least favorable operating conditions- lowest atmospheric pressure, lowest level of water on the suction side of the pump and highest temperature of the pumped fluid. An adequate safety margin of normally greater than 1 m to the max NPSH required shall be provided.
- (f) All pumps shall be fitted with suction and discharge pressure gauges. Pressure gauges shall be with diaphragm seal for slurry application. Pressure gauges for other medium shall be with gate valves. All the wetted parts shall be SS 316 or equivalent.
- (g) Venting valve shall be fitted to all pumps at suitable points on the pump casing unless the pump is self-venting due to the arrangement of the suction and discharge nozzles. Drainage facilities shall be provided on the pump casing or adjacent pipe work to facilitate the dismantling of pumps.
- (h) Pumps shall have stable head-capacity characteristics curve from run-off to shut-off. Shut-off head should be minimum 125% of Best Efficiency Point (BEP).
- (i) Selection of Duty point should preferably be at BEP (Best Efficiency Point) or slightly at the left of BEP. Selection of Duty point beyond 115% of BEP will not be acceptable. It should be noted that head variation is due to level variation in tank. Pump has to run in the system without compromising its NPSH requirement at lowest water level in tank. Hence, when tanks are filled-up and are at normal water level, pump will operate at the right of BEP, pump's operating zone should be considered accordingly.
- (j) External flushing is required to remove the accumulated particles and all related information should be mentioned in datasheet.
- (k) Pump should have adjustment provision of axial clearance between casing and impeller for maintenance of performance at best efficiency when there is wear in between impeller and casing.
- (l) In case rubber or nonmetallic linings are used, these will be two pieces molded under pressure and adjusted to the screwed metallic clamping which have been welded to the casting.
- (m) Each pump will have a coupling of adequate size, designed for full load and capable of supporting start –up on overload moments. Each half of the coupling will be factory mounted and locked to its shaft. The coupling must be able to accept the adjustment of the impeller.
- (n) The pumps shall have mechanical seals of cartridge type with self-lubrication sliding ring cartridges. The static part will be mounted on the seal plate with circumferential ring (O-ring) or another flexible sealing ring. Built in seal design will not be accepted.
- (o) The sealing areas shall be designed in such a way so that solids do not precipitate in them or affect the cooling or affect the adjustment and mechanical functioning of the seals. Seals which do not need jet cleaning are preferred.
- (p) Pump induced vibration due to flow pulsations shall be avoided through suitable design.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 15 OF 18	

- (q) Each rotating equipment shall be first statically balanced and then dynamically balanced according to ISO 1940 (in the case of impellers this shall be done before and after mounting of the service rotor shaft).
- (r) All the wear parts of the pump shall be guaranteed for a minimum wear life of not less than 25000 hours.
- (s) Coupling halves shall be machine matched to ensure accurate alignment. Couplings must have a rated capacity of at least 120% of the maximum potential power transmission requirement.
- (t) All rotating parts such as coupling shall be covered with suitable protective guards. Guards shall be easily removable type. Coupling shall be of flexible type made of cast steel. The bidder shall furnish both halves of the coupling. Both the Coupling halves shall be bored and keyed to fit shafts of the pump and the motor by bidder. The coupling between shafts shall be so designed that they become tight during pump operation.
- (u) A common base plate shall be provided for pump assembly & Motor and the same shall be rigidly constructed, adequately braced and provided with finish pads for mounting pump.
- (v) Pump manufacturer is to supply base plate along with Foundation bolt & Nut, "Taper wedge" and the necessary fastener for Pump and Motor with Base plate. Even if Motor is excluded from their scope, necessary fastener for motor foot with base plate will remain in pump scope of supply in order to avoid any problem.
- (w) Limit of connection: The buyer (BHEL) has an intention to minimize interface for utilities as much as possible. The bidder shall consider this requirement in the planning stage of layout for the equipment. The bidder shall provide the header piping for utilities.
- (x) Nameplate: All equipment shall be provided with name plates indicating the item number and service name. Nameplates shall be of 304 Stainless steel plate and placed at a readily visible location. Nameplate of main equipment shall have enough information, which will be confirmed during engineering phase. Stainless steel nameplates for all instruments and valves shall be provided.
- (y) Rotation arrows shall be cast in or attached with stainless steel plate on each item of rotation equipment at a readily visible location.
- (z) Unless otherwise specified, all equipment items where the weight exceeds 15 kg shall be provided with suitable lifting lugs, ears or ring bolts or tapped holes for lifting rings. Minimum shock factor for lifting lugs shall be 2.0. The position of lifting lugs and reference dimension shall be shown on GA and/or outline drawings. NDT shall be conducted for lifting lugs. When any spreader bars are required for lifting and laydown, the bidder shall provide spreader bar with equipment.
- (aa) Skid Mount/Transportation: Equipment shall be fabricated as skid mount design as much as practical to minimize erection at the site.
- (bb) Two pieces of stainless-steel earth lugs shall be provided with equipment diagonally. The position of earth lugs shall be shown on each GA and/or outline drawing.
- (cc) Provide double nuts for anchor bolts.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : C1	
		REV.	00
		SHEET 16 OF 18	

- (dd) Bidder shall provide allowable vibration level on foundation in foundation drawings and/or general arrangement drawings.
- (ee) If the driver/driven equipment train is in the resonance condition or any vibration problems occur, the bidder shall solve the problems in a timely manner.
- (ff) Bidder shall provide the mating flanges with the necessary gaskets.
- (gg) All the surfaces of the carbon steel should be rust prevented before shipment for the period of at least 12 months for storage and construction.
- (hh) Bidder to provide capacity of crane or hoist required for safe material handling and the details of heaviest component to be handled.
- (ii) The list of all Bought out items with makes and country of origin and contact details of the manufacturers to be mentioned along with offer to be submitted. Acceptance of makes shall be subject to BHEL's Customer's acceptance during the detailed engineering without cost and delivery implication to BHEL.

9.0	PROCESS WATER CHARACTERISTICS		
S.No.	Constituents	Unit	Water quality Korba Stg-I, II & III
1.	Calcium as CaCO ₃	ppm	51.2
2.	Magnesium as CaCO ₃	ppm	14
3.	Sodium + Potassium as CaCO ₃	ppm	25
4.	Total Cations as CaCO ₃	ppm	90.2
5.	Bicarbonates as CaCO ₃	ppm	35.7
6.	Carbonates as CaCO ₃	ppm	0
7.	Nitrate as CaCO ₃	ppm	0
8.	Chloride CaCO ₃	ppm	15
9.	Sulphate as CaCO ₃	ppm	39.5
10.	Total Anions as CaCO ₃	ppm	90.2
11.	Silica reactive	SiO ₂	11
12.	Iron(total)	Fe	0.3
13.	pH value	-	6.8-8
14.	Turbidity	NTU	20

Note: Process water will be used for preparation of Lime solution in neutralisation tank before dosing.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION No: PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : C1	
	SPECIFIC TECHNICAL REQUIREMENT		REV.	00
			SHEET 17 OF 18	

10.0	SPARES, TOOLS & TACKLES
10.1	START UP & COMMISSIONING SPARES
	Start-up & Commissioning Spares shall be part of the main supply of the Lime feeding/Dosing system. Start-up & commissioning spares are those spares which may be required during the start-up and commissioning of the equipment/system. All spares required for successful operation till commissioning of Lime feeding/Dosing shall come under this category. Bidder shall provide an adequate stock of such start-up and commissioning spares to be brought by him to the site for the equipment erection and commissioning. The spares must be available at Site before the equipment's are energized. List shall be furnished by bidder along with bid as indicated at Section-III.
10.2	MANDATORY SPARES
	a) The list of mandatory spares considered essential by the BHEL's Customer/Employer (NTPC) is indicated in Annexure-II of Sub Section-D of Section-I in the specification. The bidder shall indicate the prices for each and every item (except for items not applicable to the bidder's design) in the 'Schedule of Mandatory Spares' whether or not he considers it necessary for the Employer to have such spares. If the bidder fails to comply with the above or fails to quote the price of any spare item, the cost of such spares shall be deemed to be included in the contract price. The bidder shall furnish the population per unit of each item in their Bid. Whenever the quantity is mentioned in "sets", the bidder has to give the item details and prices of each item. b) Whenever the quantity is indicated as a percentage, it shall mean percentage of total population of that item in the station (project), unless specified otherwise, and the fraction will be rounded off to the next higher whole number. Also, one set for the particular equipment. e.g. 'set' of bearings for a pump would include the total number of bearings in a pump. Also, the 'set' would include all components required to replace the item; for example, a set of bearings shall include all hardware normally required while replacing the bearings. c) The assembly / sub assembly which have different orientation (like left hand, right hand, top or bottom), different direction of rotation or mirror image positioning or any other regions which result in maintaining two different sets of spares to be used for subject assembly / sub-assembly shall be considered as different type of assembly/sub-assembly. d) The prices of mandatory spares indicated by the Bidder in the Bid Proposal sheets shall be used for bid evaluation purposes. Bidder to provide the split-up price for mandatory spares during placement of order as per price format.
10.3	RECOMMENDED SPARES
	In addition to the spare parts mentioned above, the bidder shall also provide a list of recommended spares for 3 years of normal operation of the plant and indicate the list and total prices. This list shall take into consideration the mandatory spares specified in this Sub-Section and should be independent of the list of the mandatory spares.
10.4	SPECIAL TOOLS & TACKLES
	Any special tools & tackles required for the entire equipment to disassemble, assemble or maintain the units, they shall be included in the quotation and furnished as part of the initial

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : C1	
		REV.	00
		SHEET 18 OF 18	

supply of the machine. List of special tools & tackles shall be decided by bidder as per his proven practice. When special tools are provided, they shall be packaged in separate, boxes with lugs and marked as "Special Tools for (tag / item number)." Each tool shall be stamped or tagged to indicate its intended usage. Levers and eye bolts for the removal of parts to be serviced shall be submitted with special tools. List shall be furnished by bidder along with bid as indicated at Section-III.

10.5 FIRST FILL OF CONSUMABLES

1	Bidder's scope shall include supply and filling of all chemicals, lubricants, grease, filters and consumable items for operation up to commissioning including top up requirements. All lubricants proposed for the plant operation shall be suitable for all operating and environmental conditions that will be met on site consistent with good maintenance procedures as instructed in the maintenance manuals.
2	Bidder shall also supply a quantity not less than 10% of the full charge of each variety of lubricants, servo fluids, gases, chemicals etc. (as applicable) used which is expected to be utilized during the first year of operation. This additional quantity shall be supplied in separate containers.
3	Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals including items qualities and quantities required per month of the plant operation for the NTPC /BHEL's approval herein shall be furnished within 2 months of placement of Order. On completion of erection, complete list of bearings/equipment giving their location and identification marks shall be furnished to BHEL along with lubrication requirements. All types of chemicals, consumables, lubricants and grease shall be readily obtainable locally and the number of different types shall be kept to a minimum. For each type and grade of lubricant recommended, bidder shall list at least three equivalent lubricants manufactured by alternative companies.

11.0 LIST OF REFERENCE DRAWINGS BY BHEL

The drawings specified in in Annexure-IV, Sub-Section-D of Section-I are being provided along with the tender specification for estimation and calculation purpose of the bidder.

12.0 PAINTS / PAINTING

Bidder shall follow BHEL/ Customer painting philosophy specified Sub-Section- C2-E Section-I in the specification. However, for components where no specific requirement is stipulated, the bidder shall follow its standard practice suitable for operating condition and subject to customer approval.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
PROJECT SPECIFIC GENERAL REQUIREMENTS**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : C 2

REV. 00

SECTION: I

SUB-SECTION: C 2

CUSTOMER SPECIFICATIONS PROJECT SPECIFIC GENERAL REQUIREMENTS



**SECTION-I
SUB-SECTION-C2-A**

GENERAL TECHNICAL REQUIREMENTS

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-C
BID DOC NO: CS-0011-109(3)-9



GENERAL TECHNICAL REQUIREMENTS

PART - C

CONTENTS

Clause No.	Description	Page No.
1.00.00	Introduction	1
2.00.00	Brand Name	1
3.00.00	Base Offer & Alternate Proposals	1
4.00.00	Completeness of Facilities	1
5.00.00	Codes & Standards	2
6.00.00	Equipment Functional Guarantee	4
7.00.00	Design of Facilities/ Maintenance & Availability Considerations	5
8.00.00	Documents, Data and Drawings to be furnished by Contractor	5
9.00.00	Technical Co-ordination Meeting	21
10.00.00	Design Improvements	22
11.00.00	Equipment Bases	22
12.00.00	Protective Guards	22
13.00.00	Lubricants, Servo fluids and Chemicals	23
14.00.00	Lubrication	23
15.00.00	Material of Construction	23
16.00.00	Rating Plates, Name Plates & Labels	23
17.00.00	Tools and Tackles	25
18.00.00	Welding	25

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-C
BID DOC NO: CS-0011-109(3)-9



Clause No.	Description	Page No.
19.00.00	Colour Code for All equipments/Pipings/PlpeServices	25
20.00.00	Protection and Preserveative shop Coating	25
21.00.00	Quality Assurance Programme	26
22.00.00	General Requirements - Quality Assurance	27
23.00.00	Quality Assurance Documents	32
24.00.00	Project Manager's Supervision	34
25.00.00	Inspection, Testing and Inspection Certificates	34
26.00.00	Pre-commissioning and Commissioning Facilities	37
27.00.00	Taking over	40
28.00.00	Training of Employer's Personnel	40
29.00.00	Safety Aspects during Construction and Erection	41
30.00.00	Noise Level	42
31.00.00	Packaging and Transportation	42
32.00.00	Electrical Equipments/Enclosures	42
33.00.00	Instrumentation and Control	42
34.00.00	Electrical Noise Control	43
35.00.00	Surge protection for solid state equipment	44
36.00.00	Instrument Air System	44
37.00.00	Tapping Points for Measurements	44
38.00.00	System Documentation	44
39.00.00	Maintenance Manuals of Electronic Modules	45
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(3)-9

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
1.00.00	INTRODUCTION This part covers technical requirements which will form an integral part of the Contract. The following provisions shall supplement all the detailed technical specifications and requirements brought out in Section-VI, the Technical Specification and the Technical Data Sheets.			
2.00.00	BRAND NAME Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific item mentioned shall be understood to be indicative of the function and quality desired, and not restrictive; other manufacturer's products may be considered provided sufficient information is furnished to enable the Employer to determine that the products proposed are equivalent to those named.			
3.00.00	BASE OFFER & ALTERNATE PROPOSALS The Bidder's proposal shall be based upon the use of equipment and material complying fully with the requirements specified herein. It is recognised that the Contractor may have standardized on the use of certain components, materials, processes or procedures different than those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered, provided the base offer is in line with technical specifications and such proposals meet the specified design standards and performance requirement and are acceptable to the Employer. Sufficient amount of information for justifying such proposals shall be furnished to Employer alongwith the bid to enable the Employer to determine the acceptability of these proposals.			
4.00.00	COMPLETENESS OF FACILITIES			
4.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant shall be engineered and designed in accordance with the specification requirement. All engineering and associated services are required to ensure a completely engineered plant shall be provided.			
4.02.00	All equipments furnished by the Contractor shall be complete in every respect, with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or those needed for erection, completion and safe operation of the equipment and for the safety of the operating personnel, as required by applicable codes, though they may not have been specifically detailed in the respective specifications, unless included in the list of exclusions. All same standard components/ parts of same equipment provided, shall be interchangeable with one another.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 1 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
4.03.00	For the C&I systems, the Contractor shall be required to provide regular information about future upgrades and migration paths to the Employer.			
5.00.00	RULES, REGULATIONS, CODES & STANDARDS			
5.01.00	In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India, NTPC rules/codes of practices as well as of the locality where they will be installed, including the following: a) Indian Electricity Act b) Indian Electricity Rules c) Indian Explosives Act d) Indian Factories Act and State Factories Act e) Indian Boiler Regulations (IBR) f) Regulations of the Central Pollution Control Board, India g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India h) Pollution Control Regulations of Department of Environment, Government of India i) State Pollution Control Board. (j.) Rules for Electrical installation by Tariff Advisory Committee (TAC). (k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996 (l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998 (m.) Explosive Rules, 1983 (n.) Petroleum Act, 1984 (o.) Petroleum Rules, 1976,			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 2 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
5.02.00	(p.) Gas Cylinder Rules, 1981 (q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981 (r.) Workmen's Compensation Act, 1923 (s.) Workmen's Compensation Rules, 1924 (t.) NTPC Safety Rules for Construction and Erection (u.) NTPC Safety Policy (v.) Any other statutory codes / standards / regulations, as may be applicable. Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply: a) Bureau of Indian standards (BIS) b) Japanese Industrial Standards (JIS) c) American National Standards Institute (ANSI) d) American Society of Testing and Materials (ASTM) e) American Society of Mechanical Engineers (ASME) f) American Petroleum Institute (API) g) Standards of the Hydraulic Institute, U.S.A. h) International Organisation for Standardisation (ISO) i) Tubular Exchanger Manufacturer's Association (TEMA) j) American Welding Society (AWS) k) National Electrical Manufacturers Association (NEMA) l) National Fire Protection Association (NFPA) m) International Electro-Technical Commission (IEC)/European Norm (EN) n) Expansion Joint Manufacturers Association (EJMA) o) Heat Exchange Institute (HEI)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 3 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
5.03.00 5.04.00 5.05.00 5.06.00 5.07.00 5.08.00	p) IEEE standard q) JEC standard Other International/ National standards such as DIN, JIS, VDI, EN, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English. Not used. In the event of any conflict between the codes and standards referred to in the above clauses and the requirement of this specification, the requirement of Technical Specification shall govern. Two (2) English language copies of all national and international codes and/or standards used in the design of the plant, equipment, civil, structural and architectural works shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award. In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the Employer shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of the Employer such changes and advise Employer of the resulting effect. A detailed list of standards apart from those mentioned in the respective detailed specifications in other parts of Section-VI to which all equipment/systems/civil works should conform as indicated in this Part C and elsewhere in the specification.			
6.00.00	EQUIPMENT FUNCTIONAL GUARANTEE			
6.01.00	The functional guarantees of the equipment under the scope of the Contract is given in Section-VI Part - A of Technical Specifications. These guarantees shall supplement the general functional guarantee provisions covered under Defect liabilities Section-IV, General Conditions of Contract.			
6.02.00	Liquidated damages for shortfall in meeting functional guarantee(s) during the performance and guarantee tests shall be assessed and recovered from the Contractor as specified elsewhere in this specification.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 4 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
7.00.00	DESIGN OF FACILITIES/ MAINTENANCE & AVAILABILITY CONSIDERATIONS			
7.01.00	DESIGN OF FACILITIES All the design procedures, systems and components proposed shall have already been adequately developed and shall have demonstrated good reliability under similar conditions elsewhere. The Contractor shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic requirements are detailed out in various clauses of the Technical Specifications. The design of various components, assemblies and subassemblies shall be done so that it facilitates easy field assembly and dismantling. All the rotating components shall be so selected that the natural frequency of the complete unit is not critical or close to the operating range of the unit.			
7.02.00	MAINTENANCE AND AVILABILITY CONSIDERATIONS Equipment/works offered shall be designed for high availability, low maintenance and ease of maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability/ availability and ease of maintenance. The Bidder shall also furnish details of availability records in the reference plants stated in his experience list. Bidder shall state in his offer the various maintenance intervals, spare parts and man-hour requirement during such operation. The intervals for each type of maintenance namely inspection of the furnace, inspection of the entire hot gas path and the minor and major overhauls shall be specified in terms of fired hours , clearly defining the spare parts and man-hour requirement for each stage. Lifting devices i.e. hoists and chain pulley jacks ,etc. shall be provided by the contractor for handling of any equipment or any of its part having weight in excess of 500 Kgs during erection and maintenance activities. Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist / crane shall be provided by the contractor for lifting the equipment and accessories covered under the specification.			
8.00.00	DOCUMENTS, DATA AND DRAWINGS TO BE FURNISHED BY CONTRACTOR			
8.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant and equipment shall be fully integrated, engineered and designed to perform in accordance with the technical specification. All engineering and technical services required to ensure a completely			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 5 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	engineered plant shall be provided in respect of mechanical, electrical, control & instrumentation, civil & structural works as per the scope. Each main and auxiliary equipment/item of the plant including instruments shall be assigned a unique tag number. The assignment of tag numbers shall be in accordance with KKS system. In all drawings/documents/data sheet etc. KKS tag number of the equipment/item/instrument etc. shall be indicated. The Contractor shall furnish engineering data /drawings in accordance with the schedule of information as specified in Technical Data Sheets and Technical Specification. A comprehensive engg and quality coordination procedure shall be finalized with the successful bidder covering salient features as described in this section of specifications.			
8.02.00	The number of copies/prints/CD-ROMs/manuals to be furnished for various types of document is given in Annexure-VI to this Part-C, Section-VI of the Technical Specification.			
8.03.00	The documentation that shall be provided by the Contractor is indicated in the various sections of specification. This documentation shall include but not be limited to the following:			
8.03.01	A) BASIC ENGINEERING DOCUMENTATION Prior to commencement of the detailed engineering work, the Contractor shall furnish a Plant Definition Manual within 12 weeks from the date of the Notification of Award. This manual shall contain the following as a minimum: i) System description of all the mechanical, electrical, control & instrumentation & civil systems. ii) Technology scan for each system / sub-system & equipment. iii) Selection of appropriate technology / schemes for various systems/ subsystems including techno-economic studies between various options. iv) Optimisation studies including thermal cycle optimisation. v) Sizing criteria of all the systems, sub-systems/ equipments/ structures/ equipment foundations alongwith all calculations justifying and identifying the sizing and the design margins. vi) Schemes and Process & Instrumentation diagrams for the various systems/ sub-system with functional write-ups.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 6 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	vii) Operation Philosophy and the control philosophy of the equipments/system covered under the scope. ix) General Layout plan of the FGD System incorporating all facilities in Bidder's as well as those in the Employer's scope. This drawing shall also be furnished in the form of CD-ROMs to the Employer for engineering of areas not included in bidder's scope. x) Basic layouts and cross sections of the main plant building (various floor elevations), boiler, fuel oil area and other areas included in the scope of the bidder. xi) Documentation in respect of Quality Assurance System as listed out elsewhere in this specification. The successful bidder shall furnish within three (3) weeks from the date of Notification of Award, a list of contents of the Plant Definition Manual (PDMs) including techno-economic studies, which shall then be mutually discussed & finalised with the Employer. B) DETAILED ENGINEERING DOCUMENTS i) General layout plan of the FGD System. ii) Layouts, general arrangements, elevations and cross-sections drawings for all the equipment and facilities of the plant. iii) Flow diagram, process and instrumentation diagrams along with write up and system description. iv) Performance curves for Absorber v) Piping isometric, composite layout and fabrication drawings. vi) Piping engineering diagrams, pipe and fittings schedules, valve schedules, hanger and support schedules, insulation schedules. vii) Technical data sheets for all bought out and manufactured items. Contractor shall use the Employer's specifications as a base for placement of orders on their sub vendors. viii) Detailed design calculations for components, system, piping etc., wherever applicable including sizing calculations for all auxiliaries like mills, fans etc- as per criteria specified elsewhere in specification. ix) Absorber sizing calculations. Absorber performance data.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 7 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	x) Mass Balance Diagram xi) Characteristic Curves/ Performance Correction Curves. xii) Comprehensive list of all terminal points which interface with Employer's facilities, giving details of location, terminal pressure, temperature, fluid handled & end connection details, forces, moments etc. xiii) Power supply single line diagram, block logics, control schematics, electrical schematics, etc. xiv) Protection system diagrams and relay settings. xv) Cables schedules and interconnection diagrams. xvii) Cable routing plan. xviii) Instrument schedule, measuring point list, I/O list, Interconnection & wiring diagram, functional write-ups, and installation drawings for field mounted instruments, logic diagrams, control schematics, wiring and tubing diagrams of panels and enclosures etc. Drawings for open loop and close loop controls (both hardware and software). Motor list and valve schedule including type of actuator etc. xix) Alarm and annunciation/ Sequence of Event (SOE) list and alarms & trip set points. xx) Sequence and protection interlock schemes. xxi) Type test reports, insulation co-ordination study report xxii) Control system configuration diagramsand card circuit diagrams and maintenance details. xxiii) Detailed Control system manuals. xxiv) Detailed flow chart for digital control system. xv) Mimic diagram layout, Assignment for other application engg.drawings and documents. xxvi) Civil and Structural works drawings and documents for all structures, facilities, architectural works, foundations underground and overground works and super-structural works as included in the			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 8 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.03.02	scope of the bidder civil calculation sheets including structural analysis and design alongwith output results. xxvii) Underground facilities, levelling, sanitary, land scaping drawings. xxviii) Geotechnical investigation and site survey reports (if and as applicable). xxix) Model study reports wherever applicable. xxx) Functional & guarantee test procedures and test reports. xxxi) Documentation in respect of Quality Assurance System, and Documentation in respect of Commissioning, as listed out elsewhere in this specification. xxxii) Maintenance schedule for Absorber & auxiliaries clearly indicating interval, duration if shutdown required, manhours required and tools & tackles required for maintenance. The Contractor's while submitting the above documents/ drawings for approval/ reference as the case may be, shall mark on each copy of submission the reference letter alongwith the date vide which the submissions are made.			
	INSTRUCTION MANUALS The Contractor shall make first submission of instruction manual for all the equipments covered under the Contract as per agreed engineering information schedule. The Instruction manuals shall contain full details required for erection, commissioning, operation and maintenance of each equipment. The manual shall be specifically compiled for this project. After finalisation and approval of the Employer the Instruction Manuals shall be submitted as indicated in Annexure-IV. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals have been supplied to the Employer. The Instruction Manuals shall comprise of the following. A) ERECTION MANUALS The erection manuals shall be submitted atleast three (3) months prior to the commencement of erection activities of particular equipment/system. The erection manual should contain the following as a minimum. a) Erection strategy. b) Sequence of erection.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 9 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	c) Erection instructions. d) Critical checks and permissible deviation/tolerances. e) List of tool, tackles, heavy equipments like cranes, dozers, etc. f) Bill of Materials g) Procedure for erection and General Safety procedures to followed during erection/installation. h) Procedure for initial checking after erection. i) Procedure for testing and acceptance norms. j) Procedure / Check list for pre-commissioning activities. k) Procedure / Check list for commissioning of the system. l) Safety precautions to be followed in electrical supply distribution during erection. B) OPERATION & MAINTENANCE MANUALS a) The manual shall be a two rim PVC bound stiff sided binder able to withstand constant usage or where a thicker type is required it shall have locking steel pins, the size of the manual shall not be larger than international size A3. The cover shall be printed with the Project Name, Services covered and Volume / Book number Each section of the manual shall be divided by a stiff divider of the same size as the holder. The dividers shall clearly state the section number and title. All written instructions within the manual not provided by the manufacturers shall be typewritten with a margin on the left hand side. b) The arrangement and contents of O & M manuals shall be as follows: 1) Chapter 1 - Plant Description: To contain the following sections specific to the equipment/system supplied (a) Description of operating principle of equipment / system with schematic drawing / layouts.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 10 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(b) Functional description of associated accessories / controls. Control interlock protection write up. (c) Integrated operation of the equipment alongwith the intended system. (This is to be given by the supplier of the Main equipment by taking into account the operating instruction given by the associated suppliers). (d) Exploded view of the main equipment, associated accessories and auxiliaries with description. Schematic drawing of the equipment alongwith its accessories and auxiliaries. (e) Design data against which the plant performance will be compared. (f) Master list of equipments, Technical specification of the equipment/ system and approved data sheets. (g) Identification system adopted for the various components, (it will be of a simple process linked tagging system). (h) Master list of drawings (as built drawing - Drawings to be enclosed in a separate volume). 2) <u>Chapter 2.0 - Plant Operation</u>: To contain the following sections specific to the equipment supplied (a) Protection logics provided for the equipment alongwith brief philosophy behind the logic, Drawings etc. (b) Limiting values of all protection settings. (c) Various settings of annunciation/interlocks provided. (d) Startup and shut down procedure for equipment alongwith the associated systems in step mode. (e) Do's and Don'ts related to operation of the equipment. (f) Safety precautions to be take during normal operation. Emergency instruction on total power failure condition/lubrication failure/any other conditions. (g) Parameters to be monitored with normal value and limiting values. (h) Equipment isolating procedures.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 11 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(i) Trouble shooting with causes and remedial measures. (j) Routine testing procedure to ascertain healthiness of the safety devices alongwith schedule of testing. (k) Routine Operational Checks, Recommended Logs and Records (l) Change over schedule if more than one auxiliary for the same purpose is given. (m) Preservation procedure on long shut down. (n) System/plant commissioning procedure. 3) <u>Chapter 3.0 - Plant Maintenance</u>- To contain the following sections specific to the equipment supplied. (a) Exploded view of each of the equipments. Drawings alongwith bill of materials including name, code no. & population. (b) Exploded view of the spare parts and critical components with dimensional drawings (In case of Electronic cards, the circuit diagram to be given) and spare parts catalogue for each equipment. (c) List of Special T/ P required for Overhauling /Trouble shooting including special testing equipment required for calibration etc. (d) Stepwise dismantling and assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained etc. Clearance to be maintained etc. (e) Preventive Maintenance schedules linked with running hours/calendar period alongwith checks to be carried out. (f) Overhauling schedules linked with running hours/calendar period alongwith checks to be done. (g) Long term maintenance schedules (h) Consumables list alongwith the estimated quantity required during normal running and during maintenance like Preventive Maintenance and Overhauling. (i) List of lubricants with their Indian equivalent, Lubrication Schedule including charts showing lubrication checking, testing and replacement procedure to be carried daily, weekly, monthly & at			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 12 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	longer intervals to ensure trouble free operation and quantity required for complete replacement. (j) Tolerance for fitment of various components. (k) Details of sub vendors with their part no. in case of bought out items. (l) List of spare parts with their Part No, total population, life expediency & their interchangeability with already supplied spares to NTPC. (m) List of mandatory and recommended spare list along with manufacturing drawings, material specification & quality plan for fast moving consumable spares. (n) Lead time required for ordering of spares from the equipment supplier, instructions for storage and preservation of spares. (o) General information on the equipment such as modification carried out in the equipment from its inception, equipment population in the country / foreign country and list of utilities where similar equipments have been supplied.			
8.03.03	After finalization and approval of the Employer, the O & M Manuals shall be submitted as indicated in Annexure-VI. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals (both erection and O & M manuals have been supplied to the Employer. If after the commissioning and initial operation of the plant, the instruction manuals (Erection and /or O &M manuals) require modifications/additions/ changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer for records and number of copies shall be as mentioned in Annexure-VI.			
8.03.03	PLANT HANDBOOK AND PROJECT COMPLETION REPORT			
8.03.03.01	PLANT HANDBOOK			
	The Contractor shall submit to the Employer a preliminary plant hand book preferably in A-4 size sheets which shall contain the design and performance data of various plants, equipments and systems covering the complete project including i) Design and performance data. ii) Process & Instrumentation diagrams. iii) Single line diagrams.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 13 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	iv) Sequence & Protection Interlock Schemes. v) Alarm and trip values. vi) Performance Curves. vii) General layout plan and layout of main plant building and auxiliary buildings viii) Important Do's & Don't's The plant handbook shall be submitted within twelve (12) months from the date of award of contract. After the incorporation of Employer's comments, the final plant handbook complete in all respects shall be submitted three (3) months before start-up and commissioning activities.		
8.03.03.02	PROJECT COMPLETION REPORT The Contractor shall submit a Project Completion Report at the time of handing over the plant.		
8.03.04	DRAWINGS a) i) All the FGD plant layouts shall be made in computerised 3D modelling system. The Employer reserves the right to review the 3D model at different stages during the progress of engineering. The layout drawings submitted for Employer's review shall be fully dimensioned and extracted from 3D model after interference check. ii) All documents submitted by the Contractor for Employer's review shall be in electronic form (soft copies) along with the desired number of hard copies as per Annexure-VI of Part-C. The soft copies shall be uploaded by the vendors in C-folders, a Web-based system of NTPC ERP, for which a username and password will be allotted to the new vendor by NTPC. Similarly, the vendor can download the drawings/documents, approved/ commented by NTPC, through above site. The soft copies of identified drawings/documents shall be in pdf format, whereas the attachments/reply to the submitted document(s) can be in .doc, .xls, .pdf, .dwg or .std formats. iii) Final copies of the approved drawings along with requisite number of hard copies shall be submitted as per Annexure-VI of Part-C. iv) Contractor shall prepare the model of all the facilities located in FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE (including all		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 14 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	facilities), and any other facility in an integrated & intelligent 3D software solution using rule-based, data centric 3D Design software with equipment drawings, data sheets, intelligent P&ID correlated with intelligent 3D Model, BOQ, schematics and logic diagrams etc. attached to the respective equipment / systems in the aforesaid 3D model. Contractor shall make a presentation on 3D model every 3 months from LOA to enable NTPC to review the progress of engineering. After the completion of engineering the corresponding complete 3D review model shall be handed over to the employer for its reference. Contractor shall provide 3D model (which shall include visual interference check, walk-through animation, video simulation for major equipment placement and removal, visual effect, photo realism etc), which is extracted from intelligent 3D model, for employer's review as & when desired by employer. However, all piping layouts, equipment layouts, floor plans, ducting layout (Air/flue gas, A/C, Ventilation etc.), General Arrangement drawings of major buildings, structural arrangement drawings and RCC layout drawings shall necessarily be extracted from the aforesaid 3D model and submitted for employer's review along with the 3D review model to enable NTPC to review and approve these drawings. b) All documents/text information shall be in latest version of MS Office / MS Excel / PDF FORMAT as applicable. c) All drawings submitted by the Contractor including those submitted at the time of bid shall be in sufficient detail indicating the type, size, arrangement, weight of each component for packing and shipment, the external connection, fixing arrangement required, the dimensions required for installation and interconnections with other equipments and materials, clearance and spaces required between various portions of equipment and any other information specifically requested in the drawing schedules. d) Each drawing submitted by the Contractor (including those of subvendors) shall bear a title block at the right hand bottom corner with clear mention of the name of the Employer, the system designation, the specifications title, the specification number, the name of the Project, drawing number and revisions. If standard catalogue pages are submitted the applicable items shall be indicated therein. All titles, notings, markings and writings on the drawing shall be in English. All the dimensions should be in metric units. e) The drawings submitted by the Contractor (or their subvendors) shall bear Employer's drawing number in addition to contractor's (their sub-vendor's) own drawing number. Employer's drawing numbering system shall be made available to the successful bidder so as to enable him to assign Employer's drawing numbers to the drawings to be submitted by him during the course of execution of the Contract.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 15 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	The Contractor shall also furnish a "Master Drawing List" which shall be a comprehensive list of all drawings/ documents/ calculations envisaged to be furnished by him during the detailed engineering to the Employer. Such list should clearly indicate the purpose of submission of these drawings i.e. "FOR APPROVAL" or "FOR INFORMATION ONLY". Similarly, all the drawings/ documents submitted by the Contractor during detailed engineering stage shall be marked "FOR APPROVAL" or "FOR INFORMATION" prior to submission. Further, space shall be identified on each drawing for Approval stamp and electronic signature. f) The furnishing of detailed engineering data and drawings by the Contractor shall be in accordance with the time schedule for the project. The review of these documents/ data/ drawings by the Employer will cover only general conformance of the data/ drawings/ documents to the specifications and contract, interfaces with the equipments provided by others and external connections & dimensions which might affect plant layout. The review by the Employer should not be construed to be a thorough review of all dimensions, quantities and details of the equipments, materials, any devices or items indicated or the accuracy of the information submitted. The review and/ or approval by the Employer/ Project Manager shall not relieve the Contractor of any of his responsibilities and liabilities under this contract. g) After the approval of the drawings, further work by the Contractor shall be in strict accordance with these approved drawings and no deviation shall be permitted without the written approval of the Employer. h) All manufacturing, fabrication and execution of work in connection with the equipment / system, prior to the approval of the drawings, shall be at the Contractor's risk. The Contractor is expected not to make any changes in the design of the equipment /system, once they are approved by the Employer. However, if some changes are necessitated in the design of the equipment/system at a later date, the Contractor may do so, but such changes shall promptly be brought to the notice of the Employer indicating the reasons for the change and get the revised drawing approved again in strict conformance to the provisions of the Technical Specification. i) Drawings shall include all installations and detailed piping layout drawings. Layout drawings for all piping of 65 mm and larger diameter shall be submitted for review/ approval of Employer prior to erection. Small diameter pipes shall however be routed as per site conditions in consultation with site authority/ representative of Employer based on requirements of such piping indicated in approved/ finalised Flow Scheme/ Process & Instrumentation Diagrams and/or the requirements cropping up for draining & venting of larger diameter piping or otherwise after their erection as per actual physical condition for the entire scope of work of this package.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 16 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Assessing & anticipating the requirement and supply of all piping and equipment shall be done by the contractor well in advance so as not to hinder the progress of piping & equipment erection, subsequent system charging and its effective draining & venting arrangement as per site suitability. j) As Built Drawings After final acceptance of individual equipment / system by the Employer, the Contractor will update all original drawings and documents for the equipment / system to “as built” conditions and submit no. of copies as per Annexure VI. k) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to Engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data/ drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. l) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The Employer shall review the drawings and return soft copy to the Contractor authorizing either to proceed with manufacture or fabrication, or marked to show changes desired. When changes are required, drawings shall be re-submitted promptly, with revisions clearly marked, for final review. Any delays arising out of the failure of the Contractor to submit/rectify and resubmit in time shall not be accepted as a reason for delay in the contract schedule. m) All engineering data submitted by the Contractor after final process including review and approval by the Project Manager/ Employer shall form part of the contract documents and the entire works covered under these specification shall be performed in strict conformity with technical specifications unless otherwise expressly requested by the Project Manager in writing. n) The Contractor shall submit drawings in line with the suggestive MDL covered in Part-B, Section-VI of Technical Specification and which shall be duly integrated with approved PERT network.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 17 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
8.04.00	ENGINEERING INFORMATION SUBMISSION SCHEDULE Prior to the award of Contract, a Detailed Engineering Information Submission Scheduler/Master Drawing List duly integrated with approved PERT network shall be tied up with the Employer. For this, the bidder shall furnish a detailed list of engineering information alongwith the proposed submission schedule. This list would be a comprehensive one including all engineering data / drawings / information for all bought out items and manufactured items. The information shall be categorized into the following parts. i) Information that shall be submitted for the approval to the Employer before proceeding further, and ii) Information that would be submitted for Employer's information only. The Master Drawing List (MDL) shall be updated periodically and submitted to the employer, highlighting the changes made in MDL. The schedule should allow adequate time for proper review and incorporation of changes/ modifications, if any, to meet the contract without affecting the equipment delivery schedule and overall project schedule. The early submission of drawings and data is as important as the manufacture and delivery of equipment and hardware and this shall be duly considered while determining the overall performance and progress.		
8.05.00	ENGINEERING PROGRESS AND EXCEPTION REPORT		
8.05.01	The Contractor shall submit every month an Engineering progress and Exception Report giving the status of each engineering information including a) A list of drawings/engineering information which remains unapproved for more than four (4) weeks after the date of first submission b) Drawings which were not submitted as per agreed schedule.		
8.05.02	The draft format for this report shall be furnished to the Employer within four (4) weeks of the award of the contract, which shall then be discussed and finalised with the Employer.		
8.06.00	Engineering Co-ordination Procedure		
8.06.01	The following principal coordinators will be identified by respective organizations at time of award of contract: NTPC Engineering Coordinator (NTPC EC):		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 18 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE : Contractor's/ Vendor's Engineering Coordinator (VENDOR EC): Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE :			
8.06.02	All engineering correspondence shall be in the name of above coordinators on behalf of the respective organizations.			
8.06.03	Contractor's/Vendor's Drawing Submission and Approval Procedure: a) All data/information furnished by Vendor in the form of drawings/ documents/catalogues or in any other form for NTPC's information/ interface and or review and approval are referred by the general term "drawings". b) The 'Master drawings list' indicating titles, Drawing Number, Date of submission and approval etc. shall be finalised mutually between Contractor and Employer before the award of contract. This list shall be updated if required at suitable interval during detailed engineering. c) All drawings (including those of subvendor's) shall bear at the right hand bottom corner the 'title plate' with all relevant information duly filled in. The Contractor shall furnish this format to his subvendor along with his purchase order for subvendor's compliance.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 19 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	d) Employer and contractor shall follow their own numbering systems for the drawings. However, Employer shall intimate the contractor, NTPC drawing number on receipt of the first submission of each drawing. Vendor, thereafter, shall indicate NTPC's drawing number in subsequent Submission, in the space provided for this purpose in title plate, in addition to his own drawing number. e) The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data / drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. f) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper endorsement for checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. g) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The drawings submitted by the Contractor/vendor shall be reviewed by NTPC and their comments shall be forwarded within four (4) weeks of receipt of drawings. Upon review of each drawing, depending on the correctness and completeness of the drawing, the same will be categorized and approval accorded in one of the following categories : CATEGORY- I: Approved CATEGORY- II Approved, subject to incorporation of comments/ modification as noted. Resubmit revised drawing incorporating the comments. CATEGORY –III Not approved. Resubmit revised drawings for approval after incorporating comments/ modification as noted. CATEGORY -IV For information and records. h) Contractor shall resubmit the drawings approved under Category II, III & IV within three (3) weeks of receipt of comments on the drawings, incorporating all comments. Every revision of the drawing shall bear a revision index wherein such revisions shall be highlighted in the form of description or marked up in the drawing identifying the same with relevant revision Number			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 20 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	enclosed in a triangle (eg. 1, 2, 3 etc). Contractor shall not make any changes in the portions of the drawing other than those commented. If changes are required to be made in the portions already approved, the Contractor shall resubmit the drawing identifying the changes for Employer's review and approval. Drawings resubmitted shall show clearly the portions where the same are revised marking the relevant revision numbers and Employer shall review only such revised portion of documents. i) In case, the Contractor/ Vendor does not agree with any specific comment, he shall furnish the explanation for the same to NTPC for consideration. In all such cases the Contractor shall necessarily enclose explanations along with the revised drawing (taking care of balance comments) to avoid any delay and/or duplication in review work. j) It is responsibility of the Contractor/ Vendor to get all the drawings approved in the Category I & IV (as the case may be) and complete engineering activities within the agreed schedule. Any delay arising out of submission and modification of drawings shall not alter the contract completion schedule. k) If Contractor/ Vendor fails to resubmit the drawings as per the schedule, construction work at site will not be held up and work will be carried out on the basis of comments furnished on previous issues of the drawing. l) These comments will be taken care by the contractor while submitting the revised drawing. The contractor shall use a single transmittal for drawings. Submission. This shall include transmittal numbers and date, number of copies being sent, names of the agencies to whom copies being sent, drawing number and titles, remarks or special notes if any etc.			
9.00.00	TECHNICAL CO-ORDINATION MEETING			
9.01.00	The Contractor shall be called upon to organise and attend monthly Design/ Technical Co-ordination Meetings (TCMs) with the Employer/Employer's representatives and other Contractors of the Employer during the period of contract. The Contractor shall attend such meetings at his own cost at NEW DELHI / NOIDA or at mutually agreed venue as and when required and fully co-operate with such persons and agencies involved during the discussions.			
9.02.00	The Contractor should note that Time is the essence of the contract. In order to expedite the early completion of engineering activities, the Contractor shall submit all drawings as per the agreed Engineering Information Submission Schedule. The drawings submitted by the Contractor will be reviewed by the Employer as far as practicable within three (3) weeks from the date of receipt of the drawing .The			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 21 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	comments of the Employer shall then be discussed across the table during the above Technical Co-ordination Meeting (s) wherein best efforts shall be made by both sides to ensure the approval of the drawing.		
9.02.01	The Contractor shall ensure availability of the concerned experts / consultants/ personnel who are empowered to take necessary decisions during these meetings. The Contractor shall be equipped with necessary tools and facilities so that the drawings/documents can be resubmitted after incorporating necessary changes and approved during the meeting itself.		
9.02.02	Should any drawing remain unapproved for more than six (6) weeks after it's first submission ,this shall be brought out in the monthly Engineering Progress and Exception Report with reasons thereof.		
9.03.0	Any delays arising out of failure by the Contractor to incorporate Employer's comments and resubmit the same during the TCM shall be considered as a default and in no case shall entitle the Contractor to alter the Contract completion date.		
10.00.00	DESIGN IMPROVEMENTS The Employer or the Contractor may propose changes in the specification of the equipment or quality thereof and if the parties agree upon any such changes the specification shall be modified accordingly. If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any changing the price and/or schedule of completion before the Contractor proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.		
11.00.00	EQUIPMENT BASES A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base, unless otherwise specifically agreed to by the Employer. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.		
12.00.00	PROTECTIVE GUARDS Suitable guards shall be provided for protection of personnel on all exposed rotating and/or moving machine parts. All such guards shall be designed for easy installation and removal for maintenance purpose.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 22 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
13.00.00	LUBRICANTS, SERVO FLUIDS AND CHEMICALS	
13.01.00	I. All the first fills of consumables and one years topping requirement of consumables such as greases, oil, lubricants, servo fluids / control fluids, gases and essential chemicals etc. which will be required to put the equipment covered under the scope of specifications, into successful commissioning / initial operation and to establish completion of facilities shall be supplied by the Contractor. Suitable standard lubricants as available in India are desired. Efforts should be made to limit the variety of lubricants to minimum. Bidder shall supply a quantity not less than 10 % of the full charge or one (1) year topping requirement mentioned above (whichever is higher) of each variety of lubricants, servo fluids, gases, chemicals etc (as detailed above) which is expected to be utilized during the first year of operation. The additional quantity shall be supplied in separate container.	
13.02.00	As far as possible lubricants marketed by the Indian Oil Corporation shall be used. The variety of lubricants shall be kept to a minimum possible. Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals etc. required for the complete plant covered herein shall be furnished. On completion of erection, a complete list of bearings/ equipment giving their location and identification marks shall be furnished to the Employer alongwith lubrication requirements.	
14.00.00	LUBRICATION	
14.01.00	Equipment shall be lubricated by systems designed for continuous operation. Lubricant level indicators shall be furnished and marked to indicate proper levels under both standstill and operating conditions.	
15.00.00	MATERIAL OF CONSTRUCTION	
15.01.00	All materials used for the construction of the equipment shall be new and shall be in accordance with the requirements of this specification. Materials utilised for various components shall be those which have established themselves for use in such applications.	
16.00.00	RATING PLATES, NAME PLATES & LABELS	
16.01.00	Each main and auxiliary item of plant including instruments shall have permanently attached to it in a conspicuous position, a rating plate of non-corrosive material upon which shall be engraved manufacturer's name, equipment, type or serial number together with details of the ratings, service conditions under which the item of plant in question has been designed to operate, and such diagram plates as may be required by the Employer.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9
PART-C GENERAL TECHNICAL REQUIREMENTS		PAGE 23 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
16.02.00	Each item of plant shall be provided with nameplate or label designating the service of the particular equipment. The inscriptions shall be approved by the Employer or as detailed in appropriate section of the technical specifications.			
16.03.00	Such nameplates or labels shall be of white nonhygroscopic material with engraved black lettering or alternately, in the case of indoor circuit breakers, starters, etc. of transparent plastic material with suitably coloured lettering engraved on the back. The name plates shall be suitably fixed on both front and rear side.			
16.04.00	Items of plant such as valves, which are subject to handling, shall be provided with an engraved chromium plated nameplate or label with engraving filled with enamel. The name plates for valves shall be marked in accordance with MSS standard SP-25 and ANSI B 16.34 as a minimum.			
16.05.00	Hanger/ support numbers shall be marked on all pipe supports, anchors, hangers, snubbers and restraint assemblies. Each constant and variable spring support shall also have stamped upon it the designed hot and cold load which it is intended to support. Suitable scale shall also be provided to indicate load on support or hanger.			
16.06.00	Valves, steam traps and strainers shall be identified by Employer's tag number of a metal tap permanently attached to non pressure parts such as the yoke by a stainless steel wire. The direction of flow shall also be marked on the body.			
16.07.00	Safety and relief valves shall be provided with the following: - Manufacturer's identification. - Nominal inlet and outlet sizes in mm. - Set pressure in Kg/cm² (abs). - Blowdown and accumulation as percentage of set pressure. - Certified capacity in Kg of saturated steam per hour or in case of liquid certified capacity in litres of water per minute.			
16.08.00	All such plates, instruction plates, etc. shall be bilingual with Hindi inscription first, followed by English. Alternatively, two separate plates one with Hindi and the other with English inscriptions may be provided.			
16.09.00	All segregated phases of conductors or bus ducts, indoor or outdoor, shall be provided with coloured phase plates to clearly identify the phase of the system.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 24 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
17.00.00	TOOLS AND TACKLES The Contractor shall supply with the equipment one complete set of all special tools and tackles and other instruments required and other instruments for the erection, assembly, disassembly and proper maintenance of the plant and equipment and systems (including software). These special tools will also include special material handling equipment, jigs and fixtures for maintenance and calibration / readjustment, checking and measurement aids etc. A list of such tools and tackles shall be submitted by the Bidder alongwith the offer. The price of each tool / tackle shall be deemed to have been included in the total bid price. These tools and tackles shall be separately packed and sent to site. The Contractor shall also ensure that these tools and tackles are not used by him during erection, commissioning and initial operation. For this period the Contractor should bring his own tools and tackles. In case these tools and tackles are used by the Contractor during erection, commissioning or initial operation the same shall be refurbished repaired/replaced as required to the satisfaction of the Employer before handing over to the Employer. All the tools and tackles shall be of reputed make acceptable to the Employer.			
18.00.00	WELDING			
18.01.00	If the manufacturer has special requirements relating to the welding procedures for welds at the terminals of the equipments to be performed by others the requirements shall be submitted to the Employer in advance of commencement of erection work.			
19.00.00	COLOUR CODE FOR ALL EQUIPMENTS/ PIPINGS/ PIPE SERVICES			
19.01.00	All equipment/ piping/ pipe services are to be painted by the Contractor in accordance with Employer's standard colour coding scheme, which will be furnished to the Contractor during detailed engineering stage.			
20.00.00	PROTECTION AND PRESERVATIVE SHOP COATING			
20.01.00	PROTECTION All coated surfaces shall be protected against abrasion, impact, discoloration and any other damages. All exposed threaded portions shall be suitably protected with either metallic or a nonmetallic protection device. All ends of all valves and piping and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage. The parts which are likely to get rusted, due to exposure to weather, should also be properly treated and protected in a suitable manner. All primers/paints/coatings shall take into account the hot humid, corrosive & alkaline, subsoil or over ground environment as the case may be. The requirements for			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 25 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	painting specification shall be complied with as detailed out in Part-A & B of the Technical Specification.		
20.02.00	PRESERVATIVE SHOP COATING		
	All exposed metallic surfaces subject to corrosion shall be protected by shop application of suitable coatings. All surfaces which will not be easily accessible after the shop assembly, shall be treated beforehand and protected for the life of the equipment. All surfaces shall be thoroughly cleaned of all mill scales, oxides and other coatings and prepared in the shop. The surfaces that are to be finish-painted after installation or require corrosion protection until installation, shall be shop painted as per the requirements covered in the relevant part of the Technical Specification. Transformers and other electrical equipments, if included shall be shop finished with one or more coats of primer and two coats of high grade resistance enamel. The finished colors shall be as per manufacturer's standards, to be selected and specified by the Employer at a later date.		
20.03.00	Shop primer for all steel surfaces which will be exposed to operating temperature below 95 degrees Celsius shall be selected by the Contractor after obtaining specific approval of the Employer regarding the quality of primer proposed to be applied. Special high temperature primer shall be used on surfaces exposed to temperature higher than 95 degrees Celsius and such primer shall also be subject to the approval of the Employer.		
20.04.00	All other steel surfaces which are not to be painted shall be coated with suitable dust preventive compound subject to the approval of the Employer.		
20.05.00	All piping shall be cleaned after shop assembly by shot blasting or other means approved by the Employer. Lube oil piping or carbon steel shall be pickled.		
20.06.00	Painting for Civil structures and equipment/system covered under this package shall be done as specified under technical requirements on civil works in relevant part of this specifications.		
21.00.00	QUALITY ASSURANCE PROGRAMME		
21.01.00	To ensure that the equipment and services under the scope of contract whether manufactured or performed within the Contractor's works or at his sub-contractor's premises or at the Employer's site or at any other place of work are in accordance with the specifications, the Contractor shall adopt suitable quality assurance programme to control such activities at all points, as necessary. Such programmes shall be outlined by the Contractor and shall be finally accepted by the Employer/authorised representative after discussions before the award of the contract. The QA programme shall be generally in line with ISO-9001/IS-14001. A		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 26 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	quality assurance programme of the contractor shall generally cover the following: a) His organisation structure for the management and implementation of the proposed quality assurance programme b) Quality System Manual c) Design Control System d) Documentation Control System e) Qualification data for Bidder's key Personnel. f) The procedure for purchase of materials, parts, components and selection of sub-contractor's services including vendor analysis, source inspection, incoming raw-material inspection, verification of materials purchased etc. g) System for shop manufacturing and site erection control including process controls and fabrication and assembly controls. h) Control of non-conforming items and system for corrective actions. i) Inspection and test procedure both for manufacture and field activities. j) Control of calibration and testing of measuring testing equipments. k) System for Quality Audits. l) System for indication and appraisal of inspection status. m) System for authorising release of manufactured product to the Employer. n) System for handling storage and delivery. o) System for maintenance of records, and p) Furnishing of quality plans for manufacturing and field activities detailing out the specific quality control procedure adopted for controlling the quality characteristics relevant to each item of equipment/component as per formats enclosed as Annexure-I and Annexure-II respectively.			
22.00.00	GENERAL REQUIREMENTS - QUALITY ASSURANCE			
22.01.00	All materials, components and equipment covered under this specification shall be procured, manufactured, erected, commissioned and tested at all the stages, as per a comprehensive Quality Assurance Programme. An indicative programme of			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 27 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	inspection/tests to be carried out by the contractor for some of the major items is given in the respective technical specification. This is, however, not intended to form a comprehensive programme as it is the contractor's responsibility to draw up and implement such programme duly approved by the Employer. The detailed Quality Plans for manufacturing and field activities shall be drawn up by the Bidder and will be submitted to Employer for approval. Schedule of finalisation of such quality plans will be finalised before award on enclosed format No. QS-01-QAI-P-1/F3-R0. Monthly progress reports shall be furnished.			
22.02.00	Manufacturing Quality Plan will detail out for all the components and equipment, various tests/inspection, to be carried out as per the requirements of this specification and standards mentioned therein and quality practices and procedures followed by Contractor's/ Sub-contractor's/ sub-supplier's Quality Control Organisation, the relevant reference documents and standards, acceptance norms, inspection documents raised etc., during all stages of materials procurement, manufacture, assembly and final testing/performance testing. The Quality Plan shall be submitted on electronic media through C-folders, a web based system of NTPC ERP in addition to hard copy, for review and approval. After approval the same shall be submitted in compiled form on CD-ROM (As per format at Annexure-I)			
22.03.00	Field Quality Plans will detail out for all the equipment, the quality practices and procedures etc. to be followed by the Contractor's "Site Quality Control Organisation", during various stages of site activities starting from receipt of materials/equipment at site (As per format at Annexure – II).			
22.04.00	The Bidder shall also furnish copies of the reference documents/plant standards/acceptance norms/tests and inspection procedure etc., as referred in Quality Plans along with Quality Plans. These Quality Plans and reference documents/standards etc. will be subject to Employer's approval without which manufacturer shall not proceed. These approved documents shall form a part of the contract. In these approved Quality Plans, Employer shall identify customer hold points (CHP), i.e. test/checks which shall be carried out in presence of the Employer's Project Manager or his authorised representative and beyond which the work will not proceed without consent of Employer in writing. All deviations to this specification, approved quality plans and applicable standards must be documented and referred to Employer along with technical justification for approval and dispositioning.			
22.05.00	The contractor shall submit to the Employer Field Welding Schedule for field welding activities in the format enclosed at Annexure-V . The field welding schedule shall be submitted to the Employer along with all supporting documents, like welding procedures, heat treatment procedures, NDT procedures etc. at least ninety days before schedule start of erection work at site.			
22.06.00	The contractor shall have suitable Field Quality Organization with adequate manpower at Employer's site, to effectively implement the Field Quality Plan (FQP)			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 28 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	and Field Quality Management System for site activities. The contractor shall submit the details of proposed FQA setup (organizational structure and manpower) for employer's approval. The FQA setup shall be in place at least one month before the start of site activities.			
22.07.00	No material shall be despatched from the manufacturer's works before the same is accepted, subsequent to predespatch final inspection including verification of records of all previous tests/inspections by Employer's Project Manager/Authorised representative and duly authorised for despatch by issuance of Material Despatch Clearance Certificate (MDCC).			
22.08.00	All material used for equipment manufacture including casting and forging etc. shall be of tested quality as per relevant codes/standards. Details of results of the tests conducted to determine the mechanical properties; chemical analysis and details of heat treatment procedure recommended and actually followed shall be recorded on certificates and time temperature chart. Tests shall be carried out as per applicable material standards and/or agreed details			
22.09.00	All welding and brazing shall be carried out as per procedure drawn and qualified in accordance with requirements of ASME Section IX/BS-4870 or other International equivalent standard acceptable to the Employer. All welding/brazing procedures shall be submitted to the Employer or its authorised representative for approval prior to carrying out the welding/brazing.			
22.10.00	All brazers, welders and welding operators employed on any part of the contract either in Contractor's/his sub-contractor's works or at site or elsewhere shall be qualified as per ASME Section-IX or BS-4871 or other equivalent International Standards acceptable to the Employer.			
22.11.00	Welding procedure qualification & Welder qualification test results shall be furnished to the Employer for approval. However, where required by the Employer, tests shall be conducted in presence of Employer/authorized representative.			
22.12.00	For all IBR pressure parts and high pressure piping welding, the latest applicable requirements of the IBR (Indian Boiler Regulations) shall also be essentially complied with. However, other piping system ASME B31.1 or other relevant code as applicable shall be followed. Similarly, any other statutory requirements for the equipment/systems shall also be complied with. On all back-gauged welds MPI/LPI shall be carried before seal welding			
22.13.00	All the heat treatment results shall be recorded on time temperature charts and verified with recommended regimes.			
22.14.00	No welding shall be carried out on cast iron components for repair.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 29 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.15.00	Unless otherwise proven and specifically agreed with the Employer, welding of dissimilar materials and high alloy materials shall be carried out at shop only.			
22.16.00	All non-destructive examination shall be performed in accordance with written procedures as per International Standards. The NDT operator shall be qualified as per SNT-TC-IA (of the American Society of non-destructive examination) or equivalent. NDT shall be recorded in a report, which includes details of methods and equipment used, result/evaluation, job data and identification of personnel employed and details of co-relation of the test report with the job. In general all plates of thickness greater than 40mm & for pressure parts plates of thickness equal to or greater than 25mm shall be ultrasonically tested otherwise as specified in respective equipment specification. All bar stock/Forging of diameter equal to or greater than 40 mm shall be ultrasonically tested.			
22.17.00	The Contractor shall list out all major items/ equipment/ components to be manufactured in house as well as procured from sub-contractors (BOI). All the sub-contractor proposed by the Contractor for procurement of major bought out items including castings, forging, semi-finished and finished components/equipment etc., list of which shall be drawn up by the Contractor and finalised with the Employer, shall be subject to Employer's approval on enclosed format No. QS-01-QAI-P-01/F3. The contractor's proposal shall include vendor's facilities established at the respective works, the process capability, process stabilization, QC systems followed, experience list, etc. along with his own technical evaluation for identified sub-contractors enclosed and shall be submitted to the Employer for approval within the period agreed at the time of pre-awards discussion and identified in "DR" category prior to any procurement. Monthly progress reports on sub-contractor detail submission / approval shall be furnished preferably on enclosed format at Annexure-IV. Such vendor approval shall not relieve the contractor from any obligation, duty or responsibility under the contract.			
22.18.00	For components/equipment procured by the contractors for the purpose of the contract, after obtaining the written approval of the Employer, the contractor's purchase specifications and inquiries shall call for quality plans to be submitted by the suppliers. The quality plans called for from the sub-contractor shall set out, during the various stages of manufacture and installation, the quality practices and procedures followed by the vendor's quality control organisation, the relevant reference documents/standards used, acceptance level, inspection of documentation raised, etc. Such quality plans of the successful vendors shall be finalised with the Employer and such approved Quality Plans shall form a part of the purchase order/contract between the Contractor and sub-contractor. With in three weeks of the release of the purchase orders /contracts for such bought out items /components, a copy of the same without price details but together with the detailed purchase specifications, quality plans and delivery conditions shall be furnished to the Employer on the			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 30 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	monthly basis by the Contractor along with a report of the Purchase Order placed so far for the contract.		
22.19.00	Employer reserves the right to carry out quality audit and quality surveillance of the systems and procedures of the Contractor's or their sub-contractor's quality management and control activities. The contractor shall provide all necessary assistance to enable the Employer carry out such audit and surveillance.		
22.20.00	The contractor shall carry out an inspection and testing programme during manufacture in his work and that of his sub-contractor's and at site to ensure the mechanical accuracy of components, compliance with drawings, conformance to functional and performance requirements, identity and acceptability of all materials parts and equipment. Contractor shall carry out all tests/inspection required to establish that the items/equipment conform to requirements of the specification and the relevant codes/standards specified in the specification, in addition to carrying out tests as per the approved quality plan.		
22.21.00	Quality audit/surveillance/approval of the results of the tests and inspection will not, however, prejudice the right of the Employer to reject the equipment if it does not comply with the specification when erected or does not give complete satisfaction in service and the above shall in no way limit the liabilities and responsibilities of the Contractor in ensuring complete conformance of the materials/equipment supplied to relevant specification, standard, data sheets, drawings, etc.		
22.22.00	For all spares and replacement items, the quality requirements as agreed for the main equipment supply shall be applicable.		
22.23.00	Repair/rectification procedures to be adopted to make the job acceptable shall be subject to the approval of the Employer/ authorised representative.		
22.24.00	Environmental Stress Screening Environmental stress screening test process / procedure for eliminating infant mortile components for DDCMIS / PLC based system & for other systems having substantial electronics components (as determined by employer) like Electronic transmitter, CCTV components, PA systems etc. shall be necessarily furnished for any sub vendors proposed for vendor assessment and approval for this contract. For other approved sub vendors of above mentioned systems, contractor shall furnish the test procedure for eliminating infant mortile components in case, if it is asked for by the employer before these items are offered for inspection / dispatched to site.		
22.25.00	The Contractor / Sub-contractor shall carry out routine test on 100% item at contractor / sub-contractor's works. The quantum of check / test for routine & acceptance test by employer shall be generally as per criteria / sampling plan defined in referred standards. Wherever standards have not been mentioned quantum of check / test for routine / acceptance test shall be as agreed during detailed engineering stage.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 31 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.26.00	Software Reliability / Quality Certification Certification from OEM's authorized signatory that software offered with DDCMIS, PLC, CCTV, PA, Pyrometer, CEMS, AAQMS, EQMS, BHMS etc. declaring that the all the offered software(s) had gone through the established software quality test and offered software is not of β-version and offered software is also free from all known bugs as on date of approval of systems documents by NTPC as a part of quality documentation review and approval process during detail engineering.			
23.00.00	QUALITY ASSURANCE DOCUMENTS			
23.01.00	The Contractor shall be required to submit the QA Documentation in two hard copies and two CD ROMs, as identified in respective quality plan with tick (✓) mark.			
23.01.01	Each QA Documentation shall have a project specific Cover Sheet bearing name & identification number of equipment and including an index of its contents with page control on each document. The QA Documentation file shall be progressively completed by the Supplier's sub-supplier to allow regular reviews by all parties during the manufacturing. The final quality document will be compiled and issued at the final assembly place of equipment before despatch. However CD-Rom may be issued not later than three weeks.			
23.02.00	Typical contents of QA Documentation is as below:- (a.) Quality Plan (b.) Material mill test reports on components as specified by the specification and approved Quality Plans. (c.) Manufacturer / works test reports/results for testing required as per applicable codes and standard referred in the specification and approved Quality Plans. (d.) Non-destructive examination results /reports including radiography interpretation reports. Sketches/drawings used for indicating the method of traceability of the radiographs to the location on the equipment. (e.) Heat Treatment Certificate/Record (Time- temperature Chart) (f.) All the accepted Non-conformance Reports (Major/Minor)/deviation, including complete technical details / repair procedure). (g.) CHP / Inspection reports duly signed by the Inspector of the Employer and Contractor for the agreed Customer Hold Points.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 32 OF 83

एनटीपीसी
NTPC

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
24.00.00	PROJECT MANAGER'S SUPERVISION			
24.01.00	To eliminate delays and avoid disputes and litigation, it is agreed between the parties to the Contract that all matters and questions shall be referred to the Project Manager and without prejudice to the provisions of 'Arbitration' clause in Section GCC, the Contractor shall proceed to comply with the Project Manager's decision.			
24.02.00	The work shall be performed under the supervision of the Project Manager. The scope of the duties of the Project Manager pursuant to the Contract, will include but not be limited to the following: (a.) Interpretation of all the terms and conditions of these documents and specifications (b.) Review and interpretation of all the Contractor's drawing, engineering data, etc (c.) Witness or his authorised representative to witness tests and trials either at the manufacturer's works or at site, or at any place where work is performed under the contract (d.) Inspect, accept or reject any equipment, material and work under the contract (e.) Issue certificate of acceptance and/or progressive payment and final payment certificates (f.) Review and suggest modifications and improvement in completion schedules from time to time, and (g.) Supervise Quality Assurance Programme implementation at all stages of the works.			
25.00.00	INSPECTION, TESTING AND INSPECTION CERTIFICATES			
25.01.00	The word 'Inspector' shall mean the Project Manager and/or his authorised representative and/or an outside inspection agency acting on behalf of the Employer to inspect and examine the materials and workmanship of the works during its manufacture or erection.			
25.02.00	The Project Manager or his duly authorised representative and/or an outside inspection agency acting on behalf of the Employer shall have access at all reasonable times to inspect and examine the materials and workmanship of the works during its manufacture or erection and if part of the works is being manufactured or assembled on other premises or works, the Contractor shall obtain			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 34 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	for the Project Manager and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works.			
25.03.00	The Contractor shall give the Project Manager/Inspector fifteen (15) days written notice of any material being ready for testing. Such tests shall be to the Contractor's account except for the expenses of the Inspector's. The Project Manager/Inspector, unless the witnessing of the tests is virtually waived and confirmed in writing, will attend such tests within fifteen (15) days of the date on which the equipment is noticed as being ready for test/inspection failing which the contractor may proceed with test which shall be deemed to have been made in the inspector's presence and he shall forthwith forward to the inspector duly certified copies of test reports in two (2) copies.			
25.04.00	The Project Manager or Inspector shall within fifteen (15) days from the date of inspection as defined herein give notice in writing to the Contractor, or any objection to any drawings and all or any equipment and workmanship which is in his opinion not in accordance with the contract. The Contractor shall give due consideration to such objections and shall either make modifications that may be necessary to meet the said objections or shall inform in writing to the Project Manager/Inspector giving reasons therein, that no modifications are necessary to comply with the contract.			
25.05.00	When the factory tests have been completed at the Contractor's or sub-contractor's works, the Project Manager /Inspector shall issue a certificate to this effect fifteen (15) days after completion of tests but if the tests are not witnessed by the Project Manager /Inspectors, the certificate shall be issued within fifteen (15) days of the receipt of the Contractor's test certificate by the Project Manager /Inspector. Project Manager /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the works. The completion of these tests or the issue of the certificates shall not bind the Employer to accept the equipment should it, on further tests after erection be found not to comply with the contract.			
25.06.00	In all cases where the contract provides for tests whether at the premises or works of the Contractor or any sub-contractor, the Contractor, except where otherwise specified shall provide free of charge such items as labour, material, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Project Manager /Inspector or his authorised representatives to carry out effectively such tests on the equipment in accordance with the Contractor and shall give facilities to the Project Manager/Inspector or to his authorised representative to accomplish testing.			
25.07.00	The inspection by Project Manager / Inspector and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed Quality Assurance Programme forming a part of the contract.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 35 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
25.08.00	To facilitate advance planning of inspection in addition to giving inspection notice as specified at clause no 25.03.00 of this chapter, the Contractor shall furnish quarterly inspection programme indicating schedule dates of inspection at Customer Hold Point and final inspection stages. Updated quarterly inspection plans will be made for each three consecutive months and shall be furnished before beginning of each calendar month.	
25.09.00	All inspection, measuring and test equipment used by contractor shall be calibrated periodically depending on its use and criticality of the test/measurement to be done. The Contractor shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by NTPC. Wherever asked specifically, the contractor shall re-calibrate the measuring/test equipment in the presence of Project Manager / Inspector.	
25.10.00	Associated document for Quality Assurance programme	
25.10.01	Manufacturing Quality Plan Format No. : QS-01-QAI-P-09/F1-R1 enclosed at Annexure-I.	
25.10.02	Field Quality Plan Format No.: QS-01-QAI-P-09/F2-R1 enclosed at Annexure-II.	
25.10.03	List of items requiring quality plan and sub supplier approval. Format No.: QS-01-QAI-P-01/F3-R0 (Annexure-III).	
25.10.04	Status of items requiring Quality Plan and sub supplier approval. Format enclosed at Annexure-IV.	
25.10.05	Field Welding Schedule Format enclosed at Annexure-V.	
25.11.00	Not Used	
25.12.00	DEMONSTRATION OF APPLICATION ENGINEERING	
25.12.01	Based on NTPC inputs, the Contractor shall prepare and submit typical implemented scheme in their system (Control system & HMI) on sample basis. The typical cases to be covered shall include but not be limited to the following. (i) Logics/Loops: a) Drive logic implementation for each type of binary drive along with its display in HMI. b) Sequence implementation along with its display in HMI. c) Single non-cascade controller implementation. d) Cascade loop implementation.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 36 OF 83

एनटीपीसी
NTPC

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(b) The Contractor's pre-commissioning/ commissioning/start-up engineers, specially identified as far as possible, shall be responsible for carrying out all the pre-commissioning tests at Site. On completion of inspection, checking and after the pre-commissioning tests are satisfactorily over, the commissioning of the complete facilities shall be commenced during which period the complete facilities, equipments shall be operated integral with sub-systems and supporting equipment as a complete plant. (c) All piping system shall be flushed, steam blown, air blown as required and cleanliness demonstrated using acceptable industry standards. Procedures to accomplish this work shall be submitted for approval to the Employer six months prior to the respective implementations. The Employer will approve final verification of cleanliness. (d) The time consumed in the inspection and checking of the units shall be considered as a part of the erection and installation period. (e) The check outs during the pre - commissioning period should be programmed to follow the construction completion schedule. Each equipment/system, as it is completed in construction and turned over to Employer's commissioning (start-up) Engineer(s), should be checked out and cleaned. The checking and inspection of individual systems should then follow a prescribed commissioning documentation [SLs(standard check list)/TS(testing schedule)/CS(commissioning schedule)] approved by the employer. (f) The Contractor during initial operation and performance testing shall conduct vibration testing to determine the 'base line' of performance of all plant rotating equipment. These tests shall be conducted when the equipment is running at the base load, peak load as well as lowest sustained operating condition as far as practicable.			
26.01.00	Contractor shall furnish the commissioning organization chart for review & acceptance of employer at least twelve months prior to the schedule date of commissioning of 1st unit. The chart should contain: (1.) Biodata including experience of the Commissioning Engineers. (2.) Role and responsibilities of the Commissioning Organisation members. (3.) Expected duration of posting of the above Commissioning Engineers at site.			
26.02.00	Initial Operation (a) On completion of all pre-commissioning activities/ tests and as a part of commissioning the complete facilities shall be put on 'Initial Operation' during			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 38 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
26.03.00	which period all necessary adjustments shall be made while operating over the full load range enabling the facilities to be made ready for the Guarantee Tests. (b) The 'Initial Operation' of the complete facility as an integral unit shall be conducted for 720 continuous hours. During the period of initial operation of 720 hours, the FGD System shall operate continuously at full load for a period not less than 72 hours. The Initial Operation shall be considered successful, provided that each item/part of the facility can operate continuously at the specified operating characteristics, for the period of Initial Operation with all operating parameters within the specified limits and at or near the predicted performance of the equipment/ facility. The Contractor shall intimate the Employer about the commencement of initial operation and shall furnish adequate notice to the Employer in this respect. (c) Any operational interruption in the FGD System due to constraints attributable to the Employer shall be construed as Deemed to be in operation. (d) An Initial Operation report comprising of observations and recordings of various parameters to be measured in respect of the above Initial Operation shall be prepared by the Contractor. This report, besides recording the details of the various observations during initial operation shall also include the dates of start and finish of the Initial Operation and shall be signed by the representatives of both the parties. The report shall have sheets, recording all the details of interruptions occurred, adjustments made and any minor repairs done during the Initial Operation. Based on the observations, necessary modifications/repairs to the plant shall be carried out by the Contractor to the full satisfaction of the Employer to enable the latter to accord permission to carry out the Guarantee tests on the facilities. However, minor defects which do not endanger the safe operation of the equipment, shall not be considered as reasons for with- holding the aforesaid permission. Guarantee Tests a) The final test as to prove the Functional Guarantees shall be conducted at Site by the Contractor in presence of the Employer. The contractor's Commissioning, start-up Engineer shall make the unit ready to conduct such test before start of initial operation. Such test shall be conducted along with the Initial Operations.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 39 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	b) These tests shall be binding on both the parties of the Contract to determine compliance of the equipment with the functional guarantee. c) For performance/ demonstration tests instrumentations, of accuracy class shall be as per specified test codes. The numbers and location of the instruments shall be as per the specified test codes. In addition the values of parameters shall be logged from the information system provided under Employer's Distributed Digital Control Monitoring and Information system. Test will be conducted at specified load points. d) Any special equipment, tools and tackles required for the successful completion of the Guarantee Tests shall be provided by the Contractor, free of cost. e) The Guarantee tests and specific tests to be conducted on equipments have been brought out in detail elsewhere in the specifications.		
27.00.00	TAKING OVER Upon successful completion of Initial Operations and all the tests conducted to the Employer's satisfaction, the Employer shall issue to the Contractor a Taking over Certificate as a proof of the final acceptance of the equipment. Such certificate shall not unreasonably be with held nor will the Employer delay the issuance thereof, on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the equipment. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issuance of such certificate.		
28.00.00	TRAINING OF EMPLOYER'S PERSONNEL		
28.01.00	Training for Employers O&M Personnel The scope of service under training of Employer's engineers shall include a training module covering upto six (6) man months in the areas of Operation & Maintenance. Such training should enable the personnel to individually take the responsibility of operating and maintaining the FGD system in a manner acceptable to the Employer.		
28.02.00	Training for Employers Engineering Personnel The scope of services under training for Employer's engineering personnel shall also necessarily include three (3) man months. This shall cover all disciplines viz, Mechanical, Electrical, C&I, & QA etc. and shall include all the related areas like		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 40 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Design familiarization, training on product design features and product design softwares of major equipment and systems, engineering, manufacturing, erection, commissioning, training on operating features of equipment, quality assurance and testing, plant visits and visits to manufacturer's works, exposure to various kinds of problems which may be encountered in fabrication, manufacturing, erection, welding etc. An indicative module of the training requirement of Employer's Engineering personnel is attached as Annexure-VII.			
28.03.00	Bidder shall furnish in his offer, details of training module(s) covering above requirements which shall be subject to Employer's approval. Consolidated training period included above (i.e. 6 man months and 3 man months respectively for O&M and Engineering) is indicative only. Employer reserves the right to re appropriate the training period between O&M and engineering depending upon the details of training module proposed by the Bidder.			
28.04.00	Exact details, extent of training and the training schedule shall be finalised based on the Bidder's proposal within two (2) months from placement of award.			
28.05.00	In all the above cases, wherever the training of Employer's personnel is arranged at the works of the manufacturer's it shall be noted that the lodging and boarding of the Employer's personnel shall be at the cost of Contractor. The Contractor shall make all necessary arrangements towards the same.			
28.06.00	Take off prices (product wise) should be indicated by the Bidder in the Bid Proposal Sheets. Employer reserves the right to include or exclude these item(s) during placement of Award. Note: For training purposes, one (1) man month implies 30 working days (excluding all intervening holidays) per person.			
29.00.00	SAFETY ASPECTS DURING CONSTRUCTION AND ERECTION In addition to the requirements given in Erection Conditions of Contract (ECC) the following shall also cover: i) Working platforms should be fenced and shall have means of access. ii) Ladders in accordance with Employer's safety rules for construction and erection shall be used. Rungs shall not be welded on columns. All the stairs shall be provided with handrails immediately after its erection.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 41 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
30.00.00	NOISE LEVEL The equivalent 'A' weighted sound pressure level measured at a height of 1.5 m above floor level in elevation and at a distance of one (1) metre horizontally from the nearest surface of any equipment/machine, furnished and installed under these specifications, expressed in decibels to a reference of 0.0002 microbar, shall not exceed 85 dBA . However for Ball Mills the noise levels as per following shall also be acceptable: a) Ball Mill < 90 dBA		
31.00.00	PACKAGING AND TRANSPORTATION All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. While packing all the materials, the limitation from the point of view of the sizes of railway wagons available in India should be taken account of. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. The Contractor shall ascertain the availability of Railway wagon sizes from the Indian Railways or any other agency concerned in India well before effecting despatch of equipment. Before despatch it shall be ensured that complete processing and manufacturing of the components is carried out at shop, only restricted by transport limitation, in order to ensure that site works like grinding, welding, cutting & preassembly to bare minimum. The Employer's Inspector shall have right to insist for completion of works in shops before despatch of materials for transportation.		
32.00.00	ELECTRICAL EQUIPMENTS/ENCLOSURES		
32.01.00	All electrical equipments and devices, including insulation, heating and ventilation devices shall be designed for ambient temperature and a maximum relative humidity as specified elsewhere in the specifications.		
33.00.00	INSTRUMENTATION AND CONTROL All instrumentation and control systems/ equipment/ devices/ components, furnished under this contract shall be in accordance with the requirements stated herein, unless otherwise specified in the detailed specifications.		
33.01.00	All instrument scales and charts shall be calibrated and printed in metric units and shall have linear graduation. The ranges shall be selected to have the normal reading at 75% of full scale. All scales and charts shall be calibrated and printed in Metric Units as follows: 1 Temperature - Degree centigrade (deg C)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 42 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	2. Pressure - Kilograms per square centimetre (Kg/cm^2). Pressure instrument shall have the unit suffixed with 'a' to indicate absolute pressure. If nothing is there, that will mean that the indicated pressure is gauge pressure. 3. Draught - Millimetres of water column (mm wc). 4. Vacuum - Millimeters of mercury gauge (mm Hg) or water column (mm Wcl). 5. Flow (Gas) - Tonnes/ hour 6. Flow (Steam) - Tonnes/ hour 7. Flow (Liquid) - Tonnes / hour 8. Flow base - 760 mm Hg. 0 deg.C 9. Density - Grams per cubic centimeter.		
33.02.00	All instruments and control devices provided on panels shall be of miniaturized design, suitable for modular flush mounting on panels with front draw out facility and flexible plan-in connection at rear.		
33.03.00	All electronic modules shall have gold plated connector fingers and further all input and output modules shall be short circuit proof. These shall also be tropicalised & components shall be of industrial grade or better.		
34.00.00	ELECTRICAL NOISE CONTROL The equipment furnished by the Contractor shall incorporate necessary techniques to eliminate measurement and control problems caused by electrical noise. Areas in Contractor's equipment which are vulnerable to electrical noise shall be hardened to eliminate possible problems. Any additional equipment, services required for effectively eliminating the noise problems shall be included in the proposal. The equipment shall be protected against ESD as per IEC-61000-2. Radio Frequency interference (RFI) and Electro Magnetic Interference (EMI) protection against hardware damage and control system mal-operations/errors shall be provided for all systems as per EN-50082-2 (1995).		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 43 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
35.00.00	SURGE PROTECTION FOR SOLID STATE EQUIPMENT All solid state systems /equipment shall be able to withstand the electrical noise and surge as encountered in actual service conditions and inherent in a power plant and shall meet the requirements of surge protection as defined in ANSI C37.90.1-1989 on its suitable equivalent class of IEC 254-4. Details of the features incorporated and relevant tests carried out. The test certificates. etc. shall be submitted by the Bidder.			
36.00.00	INSTRUMENT AIR SYSTEM The instrument air supply system as supplied by the Bidder for various pneumatic control & instrumentation devices like pneumatic actuators, power cylinders, E/P converters, piping / tubing etc. Each pneumatic instrument shall have an individual air shut - off valve. The pressure regulating valve shall be equipped with an internal filter, a 50 mm pressure gauge and a built-in filter housing blow down valve.			
37.00.00	TAPPING POINTS FOR MEASUREMENTS Tapping points shall include probes, wherever applicable, for analytical measurements and sampling. For direct temperature measurement of all working media, one stub with internal threading of approved pattern shall be provided along with suitable plug and washer. The Contractor will be intimated about thread standard to be adopted. The following shall be provided on equipment by the Bidder. The standard which is to be adopted, will be intimated to the Contractor. i) Temperature test pockets with stub and thermowell ii) Pressure test pockets			
38.00.00	SYSTEM DOCUMENTATION The Bidder shall provide drawings, system overview & description, hardware/ software details, technical literature, functional & hardware schemes, bill of material, parts list, interconnection diagrams, data sheets, erection/ installation/ commissioning procedures, instruction/ operating manuals, etc. for each of the C& I system / sub-systems/ equipment supplied under this package. The documentation shall include complete details of the C&I systems/ sub-systems/ equipment to enable review by Employer during detailed engineering stage and to provide information to plant personnel for operation & Maintenance (including quick diagnostics & trouble shooting) of these C&I systems/ sub-systems/ equipment at site. The minimum documentation requirements for C&I systems shall be as stipulated under C&I			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 44 OF 83

एनटीपीसी
NTPC

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	LIST OF CODES AND STANDARDS			
	Indian Standards	Title	International and Internationally recognised standards	
	IS:277	Galvanised steel sheets (plain or corrugated)		
	IS:655	Specification for metal air duct		
	IS:800	Code of practice for use of structural steel in general building construction	BS 449:1969 BS 5950 ASA A57, 1-1952	
	IS:807	Code of practice for design, manufacture, erection and testing (Structural portion) of cranes and hoists 6588 (Issued by Standards Association of Australia). DIN 120:1936 (Sheet 1) DIN 120:1936 (Sheet 2) 327 part-I, 1951 BS 466 part-II, 1960 BS 644:1960 BS 1757:1951 BS 2573:part-I:1960	Draft Revision of A.S. NO. CS.2 SAA Crane and Hoist code Doc:No. BU/4 Rev	
	IS:875	Code of practice for design loads (other than earthquake) for buildings and structures Leading standards (issued by Canadian Standard) DIN-1055-1955 (Issued by ASA)	National Building code of Canada (1953)-Part-IV Design section 4.1	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 46 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:1239 Part-I	Mild steel tubes	(ISO/R 65-1957) (ISO/R-64-1958) (ISO/R-65-1958) (BS 1387 : 1957)	
	IS:1239 Part-II	Mild steel tubulars and other wrought steel pipe fittings	BS 1387 : 1967 BS 1387 :1967 BS 1740 :1965	
	IS:2825	Code for unfired vessels		
	IS:1520	Horizontal centrifugal pumps for clear cold and fresh water		
	IS:1600	Code for practice for performance of constant speed IC Engines for general purpose		
	IS:1601	Specification for performance of constant speed IC Engines for general Purpose		
	IS:1893	Criteria for earthquake resistant design of structures		
	IS1978-1971	Line Pipe April 1969.	API Standards 5L	
	IS:2254-1970	Dimensions of vertical shaft motor for pumps	IEC Pub 72-1 part I NEMA Pub MG 1 1954	
	IS:2266	Steel wire ropes for general engineering purposes	BS :302 : 1968	
	IS:2312	Propellant type Ventilation fans		
	IS:2365	Steel wire suspension ropes for lifts and hoists	BS : 1957	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 47 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:3346	Method for the determination of thermal conductivity of thermal insulation materials (two slab guarded hot plate method)	DIN 52612 (Deutscher Normenausschuss) ASTM C 163-1964 (American Society of Testing and materials) ASTM C 167-1974 ASTM C 177-1963	
	IS:3354	Outline dimensions for electric lifts.		
	IS:3401	Silica gel		
	IS:3588	Specification for electrical axial flow fans		
	IS:3589	Electrically welded steel pipes for water, gas and sewage (200mm to 2000 mm Nominal Diametre)		
	IS:3677	Unbonded rock and slag wool for thermal insulation		
	IS:3815	Point hook with shank for general engineering purposes	BS 482 - 1968 Doc.:67/3 1284 (Revision of BS 2903) (Issued BS)	
	IS:3895	Specification for monocrystalline semiconductor rectifier cells and stacks		
	IS:3963	Roof extractor unit		
	IS:3975	Mild steel wires, strips and tapes for armouring cables		
	IS:4503	Shell and tube type heat Exchanger		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 48 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:4540 IS:4671 IS:4736 IS:4894 IS:5456 IS:5749 IS:6392 IS:6524 Part-I IS:7098 IS:7373 IS:7938 ISO:1217 ASHRAE-33 and air heating coils. ASHRAE-52-76	Specification for monory- stallines rectifire assembly equipment Expanded polystyrene for thermal insulation purpose Hot dip zinc coating on steel tubes Centrifugal fans Code of practice for testing of positive displacement type air compressors and exhauster (For Test Tolerance Only) Forged ramshorn hooks Steel pipe flanges Code of practice for design of tower cranes Static and rail mounted Cross linked Polyethylene insulated PVC sheathed cables Specification for wrought aluminium and aluminium sheet and strips Air receivers for compressed air installation Displacement compressor-Acceptance test Methods of testing for rating of forced circulation air cooling Air cleaning device used in general ventilation for removing particle matter.	Entwurf DIN 15402 Blett 1 Entwurf DIN 15402 BS 3017-1958 BS 4504 : 1969 BS 2799 : 1956 Standard No. 1 to IPCEA (USA) Pub. No. 5-66-524	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 49 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	ASHRAE-22-72 Method of testing for rating of water cooled refrigerant condensers. ASHRAE 23-67 Methods of testing for rating of positive displacement refrigerant compressors. ARI-450-6 Standard for water cooled refrigerant condensers. ARI-550 Standard for centrifugal water chilling packages. ARI-410 Standard for forced circulation air cooling and air heating coils ARI-430/435 Central station AHU/Application of Central Station AHU BS:848 Fans (Part-1,2) BS:400 Low carbon steel cylinders for the storage & transport of permanent gases. BS:401 Low carbon steel cylinders for the storage & transport of liquified gases. CTI Code Acceptance test code for Water Cooling Tower. ACT-105 ANSI-31.5 Refrigerant piping ASME-PTC- Atmospheric Water Cooling Equipment 23-1958 AMCA A-21C Test Code for air moving devices API:618 Reciprocating Compressor for general refinery services. HYDRAULIC INSTITUTE STANDARDS. HYDRANT SYSTEM MANUALS OF TAC. TAC MANUALS OF SPRAY SYSTEM NFPA USA/ NSC UK/ UL USA/ FM USA STANDARDS. INDIAN EXPLOSIVES ACT. INDIAN FACTORIES ACT. STANDARD OF TUBULAR EXCHANGER MANUFACTURER'S ASSOCIATION.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 50 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	REFERENCE CODES AND STANDARDS FOR CONTROL AND INSTRUMENTATION The design, manufacture, inspection, testing & installation of all equipment and system covered under this specification shall conform to the latest editions of codes and standards mentioned below and all other applicable VDE, IEEE, ANSI, ASME, NEC, NEMA, ISA AND Indian Standards and their equivalents. Temperature Measurements 1. Instrument and apparatus for temperature measurement - ASME PTC 19.3 (1974). 2. Temperature measurement - Thermocouples ANSI MC 96.1 - 1982. 3. Temperature measurement by electrical Resistance thermometers - IS:2806. 4. Thermometer - element - Platinum resistance - IS:2848. Pressure Measurements 1. a) Instruments and apparatus for pressure measurement - ASME PTC 19.2 (1964). b) Electronic transmitters BS:6447. 2. Bourdon tube pressure and vacuum gauges - IS:3624 - 1966. 3. Process operated switch devices (Pr. Switch) BS-6134. Flow Measurements Instruments and apparatus for flow measurements - ASME PTC 19.5 (1972) Interim supplement, Part-II. Measurement of fluid flow in closed conduits - BS-1042. Electronic Measuring Instrument & Control Hardware/ Software 1. Automatic null balancing electrical measuring instruments - ANSI C 39.4 (Rev. 1973): IS:9319. 2. Safety requirements for electrical and electronic measuring and controlling instrument - ANSI C 39.5 - 1974. 3. Compatibility of analog signals for electronic industrial process instruments - ISA - S 50.1 (1982) ANSI MC 12.1 - 1975.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 69 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	4. Dynamic response testing of process control instrumentation ISA - S 26 (1968). 5. Surge Withstand Capability (SWC) tests - ANSI C 37.90 a/IEEE-472 or suitable class of IEC-255-4 equivalent to ANSI C37.90a/IEEE-472. 6. Printed circuit boards - IPC TM - 650, IEC 326 C. 7. General requirement and tests for printed wiring boards - IS 7405 (Part-I) 1973. 8. Edge socket connectors - IEC 130-11. 9. Requirements and methods of testing of wire wrap terminations DIN 41611 Part-2. 10. Dimensions of attachment plugs & receptacles - ANSI C 73 - 1973 (Supplement ANSI C 73 a - 1980). 11. Direct acting electrical indicating instrument - IS:1248 - 1968 (R). 12. Standard Digital Interface for Programmable Instrumentation - IEEE-488.2 - 1990. 13. Information Processing Systems - Local Area Networks - Part 2 : Logical Link Control - IEEE-802.2 - 1989. 14. Standard for Local Area Networks : Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1985. 15. Supplements A, B, C and E to Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1988. 16. Standard for Local Area Networks : Token - Passing Bus Access Method - IEEE-802.4 - 1985. 17. Standard for Local Area Networks : Token - Ring Access Method and Physical Layer Specification - IEEE-802.5 - 1985. 18. IEEE Guide to Software Requirements Specifications - IEEE-830 - 1984. 19. Hardware Testing of Digital Process Computers - ISA RP55.1 - 1983. 20. Electromagnetic Susceptibility of Process Control Instrumentation - SAMA PMC 33.1 - 1978. 21. Interface Between the Data Terminal Equipment and Data Circuit - Terminating Equipment Employing Serial Binary Data Interchange - EIA-232-D-1987.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 70 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	22. Electromagnetic Compatibility for Industrial Process Measurement and Control Equipment, Part 3 : Radiated Electromagnetic Field Requirements - IEC 801-3-1984. Instrument Switches and Contact 1. Contact rating - AC services NEMA ICS 2 - 1978 (with revision through May 1983), Part - 2-125, A6000. 2. Contact rating - DC services NEMA ICS 2-1978 Part-2 125, N600. Enclosures 1. Type of Enclosures - NEMA ICS Part - 6 - 1978 (with Rev. 1 4/80) through 110.22 (Type 4 to 13). 2. Racks, panels and associated equipment - EIA : RS - 310 C- 1983 (ANSI C 83.9 - 1972). 3. Protection class for Enclosures, cabinets, control panels & desks - IS:2147 - 1962. Apparatus, enclosures and installation practices in hazardous area 1. Classification of hazardous area - NFPA 70 - 1984, Article 500. 2. Electrical Instruments in hazardous dust location - ISA - 512.11, 1973. 3. Intrinsically safe apparatus - NFPA 493 1978. 4. Purged and pressurised enclosure for electrical equipment in hazardous location - NFPA 496-1982. 5. Enclosures for Industrial Controls and Systems - NEMA IS 1.1 - 1977. Sampling System 1. Stainless steel material of tubing and valves for sampling system - ASTMA 296-82, Grade 7 P 316. 2. Submerged helical coil heat exchangers for sample coolers ASTM D11 92-1977. 3. Water and steam in power cycle - ASME PTC 19.11. 4. Standard methods of sampling system - ASTM D 1066-99. Annunciators 1. Specifications and guides for the use of general purpose annunciators - ISA S 19.1, 1979.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 71 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	2. Surge withstand capability tests - ANSI C 37.90a - 1989/IEEE-472 or suitable class of IEC 255-4 equivalent to ANSI C37.90a 1989/IEEE-472 3. Damp heat cycling test - IS:2106 4. Specification for Electromagnetic Susceptibility - SAMA DMC 33, 1/78 Protections 1. Relays and relay system associated with electric power apparatus. ANSI C 37.90, 1 - 1989. 2. General requirements & tests for switching devices for control and auxiliary circuits including contactor relays - IS:6875 (Part-I) - 1973. 3. Turbine water damage prevention - ASME TDP-1-1980. 4. Boiler safety interlocks - NFPA 85 - 2011 or latest version. UPS System 1. Practices and requirements for semi-conductor power rectifiers - ANSI C 34.2, 1973. 2. Relays and relays system associated with electrical power apparatus - ANSI C 3.90 - 1983. 3. Surge withstand capability test - ANSI C 37.90 1 -1989. 4. Performance testing of UPS - IEC 146. 5. Stationary cells & Batteries Lead Acid type (with tubular positive plates) specification IS-1651-1991. 6. Recommended practice for sizing large lead storage batteries for generating stations & sub-stations - IEEE-485-1985. 7. Printed Circuit Board - IPC TM 650, IEC 326C. 8. General Requirements & tests for printed wiring boards, IS:7405 (Part-I) 1973. Control Valves 1. Control valve sizing - Compressible & Incompressible fluids - ISA S 75.01-1985. 2. Face to face dimensions of control valves - ANSI B 16.00 - 1973. 3. ISA Hand Book of Control Valves - (ISBN : B: 1047-087664-234-2). 4. Codes for pressure piping - ANSI B 31.1		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 72 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	5. Control Valve leak class - ISA RP 39.6 Process Connection & Piping 1. Codes for pressure piping "power piping" - ANSI B 31.1. 2. Seamless carbon steel pipe ASTM - A - 106. 3. Forged & Rolled Alloy steel pipe flanges, forged fittings and valves and parts - ASTM - A - 182. 4. Material for socket welded fittings - ASTM - A - 105. 5. Seamless ferritic alloy steep pipe - ASTM - A - 335. 6. Pipe fittings of wrought carbon steel and alloy steel - ASTM - A - 234. 7. Composition bronze of ounce metal castings - ASTM - B - 62. 8. Seamless Copper tube, bright annealed - ASTM - B - 168. 9. Seamless copper tube - ASTM - B - 75. 10. Dimension of fittings - ANSI - B - 16.11. 11. Valves flanged and butt welding ends - ANSI - B - 16.34. Instrument Tubing 1. Seamless carbon steel pipe - ASTM - A 106. 2. Material of socketweld fittings - ASTM - A105. 3. Dimensions of fittings - ANSI - B - 16.11. 4. Code for pressure piping, welding, hydrostatic testing - ANSI B 31.1. Cables 1. Thermocouples extension wires/cables - ANSI MC 96.1 - 1992. 2. Requirements for copper conductor-Wiring cables for telecommunications & information processing system - VDE:0815. 3. Colour coding of single or multi-pair cables - ICEA - S - 61-402 (third edition) NEMA WCS - 1979 with revisions thorough 2/83. 4. Insulation & Sheathing compounds for cables : VDE 0207 (Part-4, 5 & 6). 5. Guide design and installation of cable systems in power generating stations (insulation, jacket materials) - IEEE Std. 422-1977. 6. Rules for Testing insulated cables and flexible cables : VVDE - 0472		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 73 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	7. Requirements of vertical flame propagation test - IEEE 383 - 1974 (R 1980) 8. Standard specification for tinned soft or annealed copper wire for electrical purpose - ASTM B-33-81. 9. Oxygen index and temperature index test - ASTM D - 2863. 10. Smoke density measurement test - ASTM D - 2843. 11. Acid gas generation test - IEC - 754 - 1. 12. Swedish Chimney test - SEN - 4241475 (F3). 13. Teflon (FEP) insulation & sheath test - ASTM D - 2116. 14. Thermocouple compensating cables - Testing requirements & sampling plan IS:8784. 15. PVC insulated electric cables for working voltage upto and including 1100 V - IS:1554 (Part-I). Cable Trays, Conduits 1. Guide for design and installation of cable systems in power generating station (Cable trays, support systems, conduits) - IEEE Std. 422, 1977, NEMA VE-1 1979, NFPA 70-1984. 2. -do- Test Standards. NEMA VE-1-1979. 3. Zinc coating "hot dip" on assembled products for galvanising of carbon steel cable trays - ASTM A - 386-78. Public Address System 1. Specifications for loud speakers - IS:7741 (Part-I, II and III) 2. Code of safety requirement for electric mains operated audio amplifiers - IS:1301 3. Specification for Public Address Amplifiers - IS:10426. 4. Code of practice for outdoor installation of PA system - IS:1982. 5. Code of practice for installation for indoor amplifying and sound distribution system - IS:1881. 6. Basic environmental testing procedures for electronic and electrical items - IS:9000. 7. Characteristics and methods of measurements for sound system equipment - IS:9302			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 74 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	8. Code of practice of electrical wiring installations (System voltage not exceeding 650 volts) - IS:732 9. Rigid steel conduits for electric wiring - IS:9537 (Part-I and II) 10. Fittings for rigid steel conduits for electrical wiring - IS:2667 11. Degree of protection provided by enclosure for low voltage switchgear and control gear - IS:2147. Vibration Monitoring System 1. API 670 - 1994 2. BS : 4675 Part-2		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 75 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)																																																																																		
	<table><tr><th>S.No</th><th>Description of Drgs/Docs</th><th>No of Prints</th><th>No of ROMs/DVDs/Portable Hard Disk</th><th>CD</th></tr><tr><td rowspan="10">1</td><td>Drawings, Data sheets, Design calculations, Purchase specifications and other documents</td><td></td><td></td><td></td></tr><tr><td>First submission and submission with major changes</td><td></td><td></td><td></td></tr><tr><td>▪ Layout (A0&A1 sizes)</td><td>4</td><td>-</td><td></td></tr><tr><td>▪ Other Drawings/Documents (A0&A1 sizes)</td><td>2</td><td>-</td><td></td></tr><tr><td>▪ P&ID (All sizes)</td><td>4</td><td>-</td><td></td></tr><tr><td>a) Final drawings/documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr><tr><td>b) "As Built" Drawing/Documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr><tr><td>c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.</td><td>2</td><td>2</td><td></td></tr><tr><td>2</td><td>Erection Manual (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr><tr><td>3</td><td>Operation & Maintenance manual</td><td rowspan="2">1 set</td><td>--</td><td></td></tr><tr><td></td><td>i) First Submission</td><td></td><td></td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr><tr><td>4</td><td>Plant Hand Book</td><td rowspan="2">1</td><td>1</td><td></td></tr><tr><td></td><td>i) First Submission</td><td></td><td></td></tr><tr><td rowspan="2">5</td><td>Commissioning and Performance Test Procedure manual</td><td rowspan="2">1 set</td><td>--</td><td></td></tr><tr><td>i) First Submission</td><td></td><td></td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr></table>	S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD	1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents				First submission and submission with major changes				▪ Layout (A0&A1 sizes)	4	-		▪ Other Drawings/Documents (A0&A1 sizes)	2	-		▪ P&ID (All sizes)	4	-		a) Final drawings/documents (Directly to site)	6	2		b) "As Built" Drawing/Documents (Directly to site)	6	2		c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2		2	Erection Manual (Directly to site)	4 sets	2		3	Operation & Maintenance manual	1 set	--			i) First Submission				ii) Final Submission (Directly to site)	4 sets	2		4	Plant Hand Book	1	1			i) First Submission			5	Commissioning and Performance Test Procedure manual	1 set	--		i) First Submission				ii) Final Submission (Directly to site)	4 sets	2				
S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD																																																																															
1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents																																																																																		
	First submission and submission with major changes																																																																																		
	▪ Layout (A0&A1 sizes)	4	-																																																																																
	▪ Other Drawings/Documents (A0&A1 sizes)	2	-																																																																																
	▪ P&ID (All sizes)	4	-																																																																																
	a) Final drawings/documents (Directly to site)	6	2																																																																																
	b) "As Built" Drawing/Documents (Directly to site)	6	2																																																																																
	c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2																																																																																
	2	Erection Manual (Directly to site)	4 sets	2																																																																															
	3	Operation & Maintenance manual	1 set	--																																																																															
	i) First Submission																																																																																		
	ii) Final Submission (Directly to site)	4 sets	2																																																																																
4	Plant Hand Book	1	1																																																																																
	i) First Submission																																																																																		
5	Commissioning and Performance Test Procedure manual	1 set	--																																																																																
	i) First Submission																																																																																		
	ii) Final Submission (Directly to site)	4 sets	2																																																																																
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI																																																																															
PAGE 81 OF 83																																																																																			

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)			
	S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk
	6	Performance and Functional Guarantee Test Report i) First Submission	2 sets	—
		ii) Approved Copies (Direct to Site)	4 sets	2
	7	Project Completion Report (Directly to site)	6 sets	2
	8	QA programme including Organisation for implementation and QA system manual(with revisions)	1	—
	9	Vendor details in respect of proposed vendors including contractor's evaluation report.	2	—
	10	Manufacturing QPs, Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc i) For review/comment	1	—
		ii) Approved final copies of Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc (Direct to Site)	4	2
	11	Welding Manual, Heat Treatment Manuals, Storage & preservation manuals i) For review/comment	1 set	—
		ii) Approved copies (Direct to Site)	4 sets	2
	12	QA Documentation Package for items / equipment manufactured and despatched to site	2 sets	2
	13	QA Documentation Package for field activities on equipment/systems at site	2 sets	2
	LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS				ANNEXURE-VII
As applicable for Lime Feeding/Dosing system.					
PRODUCT	AREAS OF TRAINING REQUIREMENT				
	PRODUCT DESIGN	Plant Visit	Visit to Manufacturer's Work	Operation & Maintenance of Plant	
FGD	Layout & model of FGD area, cable & piping trestles etc. FGD • Mass balance, Design, selection and sizing calculations of FGD • Training on factors affecting sizing/ efficiency of FGD system, equipments & auxiliaries • Materials for FGD & selection • Basic concepts, Design and sizing calculations on slurry systems including piping, valves, etc.. • FGD electrical system • FGD control system Erection strategies, erection procedures Performance as per applicable code and demonstration tests.	Familiarization with various system and equipment Performance, data collection analysis and review O&M feed back Operation history of various equipments and system Failure analysis	Manufacturing process of Absorber and equipments Welding process Testing facilities Product development in process Future plan for technology induction R&D work in progress	Control philosophy operation, notices, logic & protection schemes, O&M manual familiarization O&M issues. Familiarization of special maintenance techniques Special tool and tackles familiarization	
MANMONTH	2	0.5	0.5	6	

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS ANNEXURE-VII	PAGE 83 OF 83



SECTION-I SUB-SECTION-C2-B

FUNCTIONAL GUARANTEES

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
2.02.00	Test Instrumentation, Flow Measurement and their Calibration			
2.02.01	All instruments required for performance testing shall be of the type and accuracy required by the code and prior to the test, the Contractor shall get these instruments calibrated in an independent test Institute approved by the Employer and submit the same to Employer prior to commencement of test. All test instrumentation required for performance tests shall be supplied by the Contractor and shall be retained by him upon satisfactory completion of all such tests at site. All calibration procedures and standards shall be subject to the approval of the Employer prior to commencement of test. The protecting tubes, pressure connections and other test connections required for conducting guarantee tests shall conform to the relevant codes. Tools and tackles, thermowells (both screwed and welded) in instruments/devices including flow devices, matching flanges, impulse piping & valves etc. and any special equipment, required for the successful completion of the tests, shall be provided by the Contractor free of cost. The Performance test shall be carried out as per the agreed procedure. The detailed PG test procedure shall be submitted within 90 days of the date of Notification of Award and finalization of the PG test procedure shall be done within 180 days from the date of Notification of Award.			
2.02.02	The P&G test procedures shall be submitted for equipments/system & subsystem under Contractor's scope for all Guarantees as mentioned below, as per latest International codes / standard including correction curves, meeting the specification requirements along with sample calculations & detailed activity plan of preparation (including test instrumentation), conductance and evaluation of Guarantees.			
2.02.03	The Contractor shall submit for Employer's approval the detailed Performance Test procedure containing the following: (a) Object of the test. (b) Various guaranteed parameters & tests as per contract. (c) Method of conductance of test and test code. (d) Duration of test, frequency of readings & number of test runs. (e) Method of calculation. (f) Correction calculations & curves. (g) Instrument list consisting of range, accuracy, least count, and location of instruments.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 2 OF 30

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	Accept the equipment /system/ plant after levying Liquidated Damages. The liquidated damages for shortfall in performance indicated in clause 3.00.00 of this sub-section shall be levied separately for each unit. The rates indicated in clause 3.00.00 of this sub-section are on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units where common absorber has been specified for two / three units based on scope of supply, LD values are applicable for combination of units as indicated in the clause 3.00.00. The liquidated damages shall be pro-rated for the fractional parts of the deficiencies. (ii) For Category-II Guarantees In case during performance guarantee test(s) it is found that the equipment/system has failed to meet the guarantees, the Contractor shall carry out all necessary modifications and/or replacements to make the equipment/system comply with the guaranteed requirements at no extra cost to the Employer and re-conduct the performance guarantee test(s) with Employer's consent. In case the specified performance guarantee(s) are still not met even after the above modifications/replacements within ninety (90) days or a reasonable period allowed by the Employer, after the tests have been completed, the Employer will have the right to either of the following: Reject the equipment / system / plant and recover from the Contractor the payments already made. OR Accept the equipment/system after assessing the deficiency in respect of the various ratings, performance parameters and capabilities and recover from the contract price an amount equivalent to the damages as determined by the Employer. Such damages shall, however be limited to the cost of replacement of the equipment(s)/system(s), replacement of which shall remove the deficiency so as to achieve the guaranteed performance. These parameters/capacities shall be termed as "Category-II" Guarantees. 3.00.00 AMOUNT OF LIQUIDATED DAMAGES (LD) APPLICABLE FOR GUARANTEES FOR EACH PROJECT The rate of liquidated damages and acceptable shortfall limits for different guarantees shall be as under and such liquidated damages shall be deducted from the Contract Price of the project.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 4 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	NOTES APPLICABLE FOR EACH PROJECT: i) Each of the liquidated damages specified above shall be independent and these liquidated damages shall be levied concurrently as applicable. ii) All these liquidated damages for short fall in performance shall be deducted from the contract price as detailed in accompanying General Conditions of Contract (GCC)/ Special Conditions of Contract (SCC) iii) Contractor's aggregate liability to pay Liquidated Damages (LD) for failure to attain the functional guarantee shall not exceed twenty five percent (25%) of the Contract Price. iv) The LD values are applicable on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units common absorber has been specified for two / three units based on scope of supply and LD values are applicable for combination of units as indicated in the clause 3.00.00 4.00.00 GUARANTEES PARAMETERS 4.01.00 Guarantees Under Category-I The Performance Guarantees which attract Liquidated Damages (LD) are as follows. The following shall be guaranteed by the Bidder under guarantee point condition of Sub- Section-V, Part-A of section- VI: (i) SO₂ removal Efficiency The Contractor shall guarantee that SO₂ removal efficiency shall not be less than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (To be conducted as per the stipulation of Cl. no. 6.00.00 of this sub-section.) (ii) Limestone Consumption The Contractor shall guarantee that limestone consumption of FGD system in kg/hr shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (iii) Auxiliary Power Consumption The Contractor shall guarantee that total auxiliary power consumption for the unit in normal operations shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 21 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES		
	Sub-section-V, Part-A of Section-VI applicable for complete scope of work for the respective project), inline with the requirements stipulated in clause 5.00.00 of this Sub-Section.		
4.02.00	Guarantees Under Category-II The parameters/capabilities shall be demonstrated for various systems/equipments shall include but not limited to the following:-		
	(i) Wet ball Mill capacity at rated fineness The contractor shall demonstrate the guaranteed capacity of each limestone pulverizer under the following conditions: i) Limestone Output fineness : 90% or higher (as per the requirement of the absorber) through 325 mesh (for spray tower process) (OR) 90% or higher (as per the requirement of the absorber) through 200 mesh (for bubbling process) ii) Limestone Quality : All available quality from the specified range. (ii) Wet ball Mill wear parts guarantee Contractor shall demonstrate the life of wet ball Mill wear parts in line with requirements stipulated in Part B of the Technical Specification. The establishment of the above guarantee shall be based on the operating records available at the Power station and will be computed for each pulverizer based on actual total hours of operation. (iii) Wet ball Mill ball consumption Contractor shall guarantee ball consumption per ton of limestone throughput in line with requirements stipulated in Part B of the Technical Specification. Contractor shall furnish the minimum ball diameter below which the balls shall be replaced. (iv) Vacuum Belt Filter Capacity Contractor shall demonstrate the Designed Capacity of the Vacuum Belt Filters to dewater the quantity of gypsum with the specified purity and moisture content as specified in Part B of the Technical Specification.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	~~(v) Gypsum Purity~~ ~~The contractor shall demonstrate that the purity of the gypsum produced shall not be less than 90%, chloride content shall not be more than 100ppm and the moisture content shall not be more than 10% for guarantee point condition.~~ ~~(vi) NOT USED~~ ~~(vii) Performance characteristics of fans (capacity, head developed, etc.).~~ ~~(viii) Margins on fans in case Booster Fan is provided by the Contractor.~~ ~~Booster Fans - As specified in Part B of Technical Specifications~~ ~~(ix) Passenger cum Goods Elevator for FGD absorber & Limestone Grinding Building: Over load tests, travel and hoist speed checks.~~ (x) Noise All the plant, equipment and systems covered under this specification shall perform continuously without exceeding the noise level over the entire range of output and operating frequency specified in Part-C of Section-VI of the technical specifications. Noise level measurements shall be carried out using applicable and internationally acceptable standards. The measurement shall be carried out with a calibrated integrating sound level meter meeting the requirement of IEC 651 or BS 5969 or is 9779. Sound pressure shall be measured all around the equipment at a distance of 1.0 m horizontally from the nearest surface of any equipment/ machine and at a height of 1.5 m above the floor level in elevation. A minimum of 6 points around each equipment shall be covered for measurement. additional measurement points shall be considered based on the applicable standards and the size of the equipment. the measurement shall be done with slow response on the a - weighting scale. the average of a-weighted sound pressure level measurements expressed in decibels to a reference of 0.0002 micro bars shall not exceed the guaranteed value. corrections for background noise shall be considered in line with the applicable standards. all the necessary data for determining these corrections, in line with the applicable standards, shall be collected during the tests.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 23 OF 30	



SECTION-I SUB-SECTION-C2-C

PIPING

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC																																					
	<u>LOW PRESSURE PIPING</u>																																								
1.00.00	EQUIPMENT SIZING CRITERIA																																								
1.01.00	All the piping systems and equipments supplied under this package shall be designed to operate without replacement and with normal maintenance for a plant service life of 30 years, and shall withstand the operating parameter fluctuations and cycling which can be normally expected during this period.																																								
1.02.00	For all Low Pressure piping systems covered under this specification, sizing and system design shall be to the requirements of relevant codes and standard indicated. In addition to this, requirements of any statutory code as applicable shall also be taken into consideration.																																								
1.03.00	Inside diameters of piping shall be calculated for the flow requirements of various systems. The velocities for calculating the inside diameters shall be limited to the following: a) Water Application <table><tr><th colspan="2"></th><th colspan="3">Water Velocity in m/sec</th></tr><tr><th></th><th>Pipe Size</th><th>Below 50 mm</th><th>50-150 mm</th><th>200 mm & above</th></tr><tr><td>(a)</td><td>Pump suction</td><td>-----</td><td>1.2-1.5</td><td>1.2-1.8</td></tr><tr><td>(b)</td><td>Pump discharge and recirculation</td><td>1.2-1.8</td><td>1.8-2.4</td><td>2.1-2.5</td></tr><tr><td>(c)</td><td>Header</td><td>-----</td><td>1.5-2.4</td><td>2.1-2.4</td></tr></table> Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally. Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec. WILLIAM & HAZEN formula shall be used for calculating the friction loss in piping systems with the following "C" value: <table><tr><td>(i)</td><td>Carbon steel pipe</td><td>100</td></tr><tr><td>(ii)</td><td>Ductile Iron.</td><td>140</td></tr><tr><td>(iii)</td><td>Rubber lined steel pipe</td><td>120</td></tr><tr><td>(i v)</td><td>Stainless steel pipe</td><td>10 0</td></tr></table> For calculating the required pump head for pump selection, at least 10% margin shall be taken over the pipe friction losses and static head shall be calculated from the minimum water level of the tank/ sump/ reservoir from which the pumps draw water. 						Water Velocity in m/sec				Pipe Size	Below 50 mm	50-150 mm	200 mm & above	(a)	Pump suction	-----	1.2-1.5	1.2-1.8	(b)	Pump discharge and recirculation	1.2-1.8	1.8-2.4	2.1-2.5	(c)	Header	-----	1.5-2.4	2.1-2.4	(i)	Carbon steel pipe	100	(ii)	Ductile Iron.	140	(iii)	Rubber lined steel pipe	120	(i v)	Stainless steel pipe	10 0
		Water Velocity in m/sec																																							
	Pipe Size	Below 50 mm	50-150 mm	200 mm & above																																					
(a)	Pump suction	-----	1.2-1.5	1.2-1.8																																					
(b)	Pump discharge and recirculation	1.2-1.8	1.8-2.4	2.1-2.5																																					
(c)	Header	-----	1.5-2.4	2.1-2.4																																					
(i)	Carbon steel pipe	100																																							
(ii)	Ductile Iron.	140																																							
(iii)	Rubber lined steel pipe	120																																							
(i v)	Stainless steel pipe	10 0																																							

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC					
1.04.00	The pipes shall be sized for the worst (i.e. maximum flow, temp. and pressure values) operating conditions.						
1.05.00	Based on the inside dia. so established, thickness calculation shall be made as per ANSI B 31.1 OD and thickness of pipes shall than be selected as per ANSI B 36.10/IS-1239 Heavy grade/IS-3589/ASTM-A-53/API-5L/ANSI B 36.19 as the case may be.						
1.06.00	Corrosion allowance of 1.6 mm will be added to the calculated thickness being considered (except stainless steel piping).						
1.07.00	Bend thinning allowance/manufacturing allowance etc. shall be as per the requirement of the design code provision.						
1.08.00	High points in piping system shall be provided with vents along with valves as per the system requirement. Low poi nts sh all b e provided w ith drai ns a long w ith drain valves a s per the system requirement. Drain lines shall be adequately sized so as to cle ar condensate in the lines. Ma terial for drain and ven t li nes sh all be compatible with that of the parent pipe material.						
1.09.00	Material of construction for pipes carrying various fluids shall be as specified elsewhere.						
1.10.00	Compressed air pipe work sha ll be a dequately dr ained to pr event intern al moist ure accumulation and m oisture trap s shall be provided at strate gic lo cations i n t he piping systems.						
1.11.00	Depending upon the size and system pressure, joints in compressed air pipe work shall be screwed or flanged. The flange shall be welded with the parent pipe at shop and shall be hot dip galvanized before dispatch to site. Alternatively, the flanges on GI pipes may be screwed-on flanges also.						
1.12.00	Threaded joints shall be provided with Teflon sealant tapes.						
1.13.00	Following types of valves shall be used for the system/service indicated.						
	SYSTEM		TYPES OF VALVES				
		Butterfly	Gate	Globe	Check	Ball	Plug
Wa	ter	x	x	x	x	x	
A	ir		x	x	x	x	
	Drains & vents		x	x x			
	Fuel oil (if any)		x	x	x	x	x
1.14.0	Recirculation pipes along with valves, b reakdown orifice s etc. sha ll b e provided fo r important pumping systems as indicated in respective process and instrumentation diagrams (P&IDs). The recirculation pipe shall be sized for minimum 30%design flow of single pump operation or the recommended flow of the pump manufacturer whichever is higher.						
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)		PAGE 2 OF 16	

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.00.00	TECHNICAL SPECIFICATION			
2.01.00	GENERAL			
	Specific technical requirements of low-pressure piping, fittings, supports, valves, specialties and tanks etc. have been covered under this Sub-section. It includes details pertaining to design and material of construction for piping, fittings, valves, equipment, etc. cleaning/surface preparation application of primer and painting on over ground piping. It also includes detailed technical requirement of laying underground/buried piping including water proofing/anti corrosive protection. It also covers design, engineering, manufacturing, fabrication, technical details of piping, valves, specialties, piping hangers / supports, tanks etc.			
2.02.00	Pipes and fittings			
2.02.01	All low pressure piping systems shall be capable of withstanding the maximum pressure in the corresponding lines at the relevant temperatures. However, the minimum thickness as specified in the following clauses and or respective codes for pipes and fittings shall be adhered to. The bidder shall furnish the pipe sizing/ thickness calculation as per the criteria mentioned above under LP piping equipment sizing criteria of this Technical Specification.			
2.02.02	Piping and fittings coming under the purview of IBR shall be designed satisfying the requirements of IBR as a minimum.			
2.02.03	Supporting arrangement of piping systems shall be properly designed for systems where hydraulic shocks and pressure surges may arise in the system during operation. Bidder should provide necessary protective arrangement like anchor blocks/anchor bolt etc. for the safeguard of the piping systems under above mentioned conditions. The requirement will be, however, worked out by the contractor and he will submit the detailed drawings for thrust/anchor block to the Employer. External, and internal, attachments to piping shall be designed so as not to cause flattening of pipes and excessive localized bending stresses.			
2.02.04	Bends, loops, offsets, expansion or flexible joints shall be used as required in order to prevent overstressing the piping system and to provide adequate flexibility. Flexibility analysis (using software packages such as Caesar-II etc.) shall be carried out for sufficiently long piping (straight run more than 300M).			
2.02.05	Wherever Bidder's piping coming under this specification, terminates at an equipment or terminal point not included in this specification, the reaction and the thermal movement imposed by bidder's piping on equipment terminal point shall be within limits to be approved by the Employer.			
2.02.06	The hot lines shall be supported with flexible connections to permit axial and lateral movements. Flexibility analysis shall be carried out for pipelines which have considerable straight run as indicated above and necessary loops/ expansion joint etc. shall be provided as may be necessary depending on layout.			
2.02.07	Piping and fittings shall be manufactured by a n approved manufacturer of repute. They should be truly cylindrical of clear internal diameter, of uniform thickness, smooth and strong, free from dents, cracks and holes and other defects.			
2.02.08	For rubber lined ERW pipes, beads shall be removed for pipe size 80 NB and above.			
2.02.09	Inspection holes shall be provided at suitable locations for pipes 800 Nb and above as required for periodic observations and inspection purposes.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 3 OF 16

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC													
2.02.10	At a l l i ntersection j oints, it i s Con tractor's r esponsibility to design and provide suitable reinforcements as per the applicable codes and standards.														
2.02.11	For large size pipe s/ducts, at high poin t and bends/change of d irection of flo w, air release valves shall be provided as dictated by the system requirement and o peration philosophy & tripping conditions of pumping system. Sizing criteria for air release valves shall be generally on the basis of valve size to pipe diameter ratio of 1:8. Requirement shall be decided as per relevant code. Transient analysis /surge analysis where ever specified and required shall be conducted in order to determine the location , nu mber and size of the Air-Release valve on certain long distance/high volume piping systems, if applicable within the scope of work of the package.														
2.03.00	Material														
2.03.01	Alternate m aterials offered by B idder against tho se spe cified. sh all either be equal to or superior to tho se specified, The responsibility for establishing equality or superiority of the alternate materials offered rests entirely with the Bidder and any standard code required for establishing the same shall be in English language.														
2.03.02	No extra cred it would be given to offers containing materials super ior to tho se spe cified. Likewise no extr a credit would be give n to offers containing pipe thickness more tha n specified.														
2.03.03	All materials shall be new and procured directly f rom the manu facturers. Materials procured from traders or stockists are not acceptable.														
2.03.04	All materials shall be certified by proper material test certificates. All material test certificates shall carry proper heat number or other acceptable references to enable identification of the certificate that certifies the material.														
2.03.05	Material of construction for pipes carrying various fluids shall be as follows: <table><tr><th>SI N</th><th>Type of Fluid</th><th>Material</th></tr><tr><td>1.</td><td>i) Ordinar y Wate r (Raw W ater, Clarified Water, etc.) ii) E quipment cooli ng water including Both primary & se condary circuit (DMCW pH-corrected & ACW drain water)</td><td>IS-2062 Gr.-E-250B/A STM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.</td></tr><tr><td>2.</td><td>i) Demineralised water, ii)Alkaline so lution (ECW system chemical dosing)</td><td>Stainless Steel to A STM A312, G r. 30 4 welded for sizes 65 mm NB and above. Stainless stee l t o A STM A 312, Gr. 30 4 sch.40s seamless for sizes 50mm and below</td></tr><tr><td>3.</td><td>i) Drinking (potable) water ii)Compressed air (Instrument & service air)</td><td>ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 358 9 Gr 410 galvanized. Galvanized shall be to IS- 4 736 or equivalent.</td></tr></table>	SI N	Type of Fluid	Material	1.	i) Ordinar y Wate r (Raw W ater, Clarified Water, etc.) ii) E quipment cooli ng water including Both primary & se condary circuit (DMCW pH-corrected & ACW drain water)	IS-2062 Gr.-E-250B/A STM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.	2.	i) Demineralised water, ii)Alkaline so lution (ECW system chemical dosing)	Stainless Steel to A STM A312, G r. 30 4 welded for sizes 65 mm NB and above. Stainless stee l t o A STM A 312, Gr. 30 4 sch.40s seamless for sizes 50mm and below	3.	i) Drinking (potable) water ii)Compressed air (Instrument & service air)	ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 358 9 Gr 410 galvanized. Galvanized shall be to IS- 4 736 or equivalent.		
SI N	Type of Fluid	Material													
1.	i) Ordinar y Wate r (Raw W ater, Clarified Water, etc.) ii) E quipment cooli ng water including Both primary & se condary circuit (DMCW pH-corrected & ACW drain water)	IS-2062 Gr.-E-250B/A STM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.													
2.	i) Demineralised water, ii)Alkaline so lution (ECW system chemical dosing)	Stainless Steel to A STM A312, G r. 30 4 welded for sizes 65 mm NB and above. Stainless stee l t o A STM A 312, Gr. 30 4 sch.40s seamless for sizes 50mm and below													
3.	i) Drinking (potable) water ii)Compressed air (Instrument & service air)	ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 358 9 Gr 410 galvanized. Galvanized shall be to IS- 4 736 or equivalent.													
2.03.06	In water lines, pipes upto 150mm Nb shall conform to ANSI B36.10/ASTM-A-53, Type-E Gr.B /IS:1239 Gr. Heavy and minimum selected thickness shall not be less than IS:1239 Grade Heavy except for demineralized water, drinking water .														
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING) PAGE 4 OF 16												

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.03.07	Pipes of above 150mm Nb shall be to A WWA-C200/ANSI B 36 .10/ASTM A -53/IS 35 89 Gr.410. Pipe to be fabricated by the bidder shall be rolled and butt welded from plates conforming to ASTM A-53 type 'E' Gr. B/IS 20 62 Gr.E-250B/ASTM-A-36. However, larger pipes, i.e. 1000 mm Nb and above shall be made from plates conforming to ASTM A 36/IS 2062 Gr.E-250B and shall meet the requirements of AWWA-M-11 (for deflection & buckling criteria considering water filled pipe as well as vacuum condition that may prevail during transient/surge conditions, truck-load, rail-load and weight density for compacted soil or any other load as the case may be).			
2.03.08	In demineralised water service, the pipes upto 50 Nb shall be of stainless steel ASTM A 312, Gr. 304 sch. 40 Seamless. The size for these pipes shall be to ANSI B 36.19. These shall be socket welded. The material for pipe from 65mm NB upto and including 400 NB shall be to ASTM A 312, Gr. 304 (welded). In no case the thickness of fittings shall be less than parent pipe thickness. Bidder/Contractor shall note that pipes offered as per a particular code shall conform to that code in all respects i.e. Dimension, tolerances, manufacturing methods, material, heat treatment, testing requirements, etc. unless otherwise mentioned elsewhere in the specification.			
2.03.09	Instrument air, Plant (service) air lines and Drinking water lines shall be to ASTM A 53 type E grade B/ANSI B 36. 10/IS 3589, Gr. 410 / IS: 1 239 Heavy (in case thickness calculated is more than gr. Heavy, ANSI B 3 6.10 Schedule numbers shall be followed) and galvanized to IS 4736 or any equivalent internationally reputed standard. The material of the pipes shall be to ASTM A 53 type 'E' Gr. B / IS: 3589, Gr. 410 / IS: 1239 Gr. Heavy. The fittings shall be of either same as parent material or malleable iron to IS-1879 (galvanized).			
2.03.10	Spiral welded pipes as per API-5L/IS-3589 are also acceptable for pipe of size above 150 NB. However minimum thickness of the pipes shall be as elaborated in above clauses.			
2.03.11	Condensate lines shall be to ASTM A 106 Gr. B and dimension to ANSI B 36 .10 schedule "standard" as minimum to be maintained.			
2.03.12	If carbon steel plates of thickness more than 12 mm are used for manufacture of pipes, fittings and other appurtenances, then the same shall be control-cooled or normalized as the case may be following the guidelines of the governing code.			
2.04.00	Field routed pipes:			
2.04.01	Pipe lines of NB 50 size and below are regarded as field run piping. It is Bidder's responsibility to plan suitable layouts for these system in situ. Bidder shall prepare drawings indicating the layout of field run pipe work. These drawings shall be approved by Project Manager to the installation of the field run pipe work. Based on these approved layouts the Bidder shall prepare the BOQ of field run-pipes and submit to Employer for approval.			
2.05.00	Slope/Drains and Vents			
2.05.01	Suitable slopes shall be provided for all pipelines towards drain points. It is Bidder responsibility to identify the requirements of drains and vents, and supply the necessary pipe work, valves, fittings, hangers and supports etc. As per the system requirement low points in the pipelines shall be provided with suitable draining arrangement and high points shall be provided with vent connections where air or gas pockets may occur. Vent for use during hydrostatic test shall be plugged after the completion of the test. Vent shall not be less than 15mm size. Drains shall be provided at low points and at pockets in piping such that complete drainage of all systems is possible. Drain shall not be less than 15mm for line size up to 150mm, not less than 20mm up to 300mm and not less than 25mm for 350mm to 600mm pipes and not less than 50mm for 600mm and above pipes.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 5 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.05.02	Air piping shall be sloped so that any part of the system can be drained through the shut-off drain valve or drain plugs.			
2.06.00	Pipe Joints In general all water lines 65mm NB and above, are to be joined generally by butt welding except the locations where valves/fittings are to be installed with flanged connections and 50mm and below by socket welding unless mentioned otherwise specifically. All air lines shall be of screwed connection and rubber lined pipes of flanged connections.			
2.06.01	Screwed Joints (a) Threading of pipes shall be carried out after bending, heat treatment etc. If not possible, threading may be done prior to these operations but proper care should be taken to protect them from damage. Threads shall be to ANSI B 2.1 (taper) NPT/ ANSI B1.20.1 (taper) NPT / IS: 554 unless specified otherwise. (b) Galvanized pipe shall generally be joined by screwing into sockets. The exposed threaded portion on the outside of the pipes shall be given a zinc silicate coating. Galvanized pipes shall not be field joined by welding for protection of Galvanizing Zinc layer. Screwed ends of GI pipes shall be thoroughly cleaned and painted with a mixture of red and white lead before jointing. For galvanized pipe sizes above 150 mm NB, screw & socket jointing as per ASTM-A-865 shall be employed for both pipe-to-pipe and pipe-to-fitting jointing. For pipe to fitting connection since no direct threading can be done on the fittings (supplied as per ASTM-A-234 Gr. WPB and ANSI B-16.9) necessary straight pipe lengths acting as match pieces shall be welded to the fitting at both ends and subsequently the free ends of the straight lengths shall be threaded as per ASTM A-865 for jointing with main pipe. Once welding of fittings with match pieces and threading of free ends of match pieces are over, the entire fabricated piece shall be galvanized, or in case match pipes and fittings are already galvanized before the above mentioned fabrication then suitable application of Zinc-Silicate paste adequately at the welded surface (both in side & outside) after welding with zinc rich electrode, along with the nascent threaded metal portions at both free ends given the same application of Zinc Silicate paste. Alternatively flanged jointing may be employed for pipe sizes 100 NB and above. However, the bidder shall ensure the galvanized pipe joints do not fail during hydro test. (c) Teflon tapes shall be used to seal out screwed joints and shall be applied to the male threads only. Threaded parts shall be wiped clean of oil or grease with appropriate solvent if necessary and allowing proper time for drying before applying the sealant. Pipe ends shall be reamed and all chips shall be removed. Screwed flanges shall be attached by screwing the pipe through the flange and the pipe and flange shall be refaced accurately. (d) For pipe sizes from 350 mm NB to 550 mm NB (including 350 NB & 550 NB) the GI pipes shall be of flanged connection. However, the pipes after welding of flanges shall be completely galvanized. Any site welding done on galvanized pipes shall be done with zinc-rich special electrodes and the welded surfaces whether inside or outside shall be coated with zinc-silicate paste. Seal welding of flanges with zinc-rich electrode will be permitted only when any flange is leak-prone during hydro testing. (e) For pipe sizes 600 mm NB and above, the GI pipes shall be of welded connection (with zinc-rich special electrodes) followed by application of zinc silicate coating at welded surfaces both inside and outside the pipe, except for the last blank/blind flange, or, equipment connection where application of zinc-silicate paste after welding cannot be done due to inaccessibility of the inside welded surface and where galvanic protection has been impaired due to welding of pipe-to-pipe joint. Thus the last erection joint shall be flanged joint.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 6 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.06.02	Welded Joints (a) For making up welded joints (butt weld or socket weld) the welding shall be performed by manual shielded metal arc process in accordance with the requirements specified elsewhere in the spec. Any welder employed for carrying butt welding shall be qualified as per ASME section IX for the type of joints he is going to weld. Jointing by butt weld, or socket weld shall depend upon the respective piping material specifications.			
2.06.03	Flanged Joints (a) Flanged connections for pipes are to be kept to the minimum and used only for connections to vessel, equipments, flanged valves and other fittings like strainer/traps/orifices etc. for ease of connection and maintenance etc. Rubber lined pipes shall be flange joined only. (b) All flanged valves intended for installation on steel piping system, shall have their flanges drilled to ANSI B 16.5 (or equivalent) and according to the pressure class stated in their respective piping material specification. (c) Drilling on flanges of flanged valves must correspond to the drilling of flanges on the piping system on which the valves are installed.			
2.07.00	Bends/elbows/mitre bends/ Tees/ Reducers & other fittings			
2.07.01	For pipe fittings such as elbows (long radius), reducers, tees, etc. the material shall be to ASTM-A-234 Gr. WPB/ASTM-105 up to 300 NB. For pipe fittings above 300 NB, the fittings may be fabricated conforming to parent pipe material. Provision of compensation pads shall be kept as per ANSI B 31.1. The fitting shall conform to the dimensional standard of ANSI B-16.9/ 16.11. Further branching in pipes for sizes 65nb and above is also acceptable (ANSI B 31.1). However, for pipes up to 150 NB, pipe fittings may be supplied with material and dimension conforming to IS 1239 in case parent pipes also conform to IS 1239.			
2.07.02	For pipe size 350Nb and above mitre bends may be used for all pipes except rubber lined pipes. However, mitre bends are also acceptable for rubber lined pipes above 1200 NB. The bend radius shall be 1½ times the nominal pipe diameter. 90 deg. bends (mitre) shall be in 4 pieces (3 cuts) and 45 deg. mitre bends shall be in 3 pieces 22½ deg. Fabrication of mitre bends shall be as detailed in BS 2633/BS534.			
2.07.03	For pipes, above 1200 NB, reducer and tees shall be to dimensional standard of AWWA-C-208.			
2.07.04	Stainless steel fittings shall conform to either ASTM-A-182 Gr. 304 or ASTM-A-403 Grade WP. 304 Class-S, for sizes up to and including 50 mm NB, i.e. the fittings shall be of seamless construction. However, for stainless fittings above 50 mm NB, the same shall conform to ASTM-A-403 Gr. WP 304 Class W i.e. the fittings shall be of welded construction strictly in accordance with ASTM-A-403.			
2.07.07	In no case, the thickness of fittings shall be less than the thickness of parent pipe, irrespective of material of construction.			
2.08.00	Flanges			
2.08.01	Flanges shall be slip on type or weld neck type. Welding of flanges in tension is not permitted.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 7 OF 16

22/PS-PEM-MAX				
CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.08.02	All flanges and-flanged drilling shall be to ANSI B 16.5 / BS E N-1092 / AWW A C - 207 of relevant p ressure/temperature cla ss. Flanges sha ll be fa bricated from stee l p lates conforming to ASTM A 105/IS 2062 Gr. E -250B. However s tainless s teel flanges s hall be fabricated from SS plates to ASTM-A-240, Gr. 304 or equivalent.			
2.09.00	Specific technical requirement of laying buried pipe with anti-corrosive treatment The pipe i n general shall be l aid with the top of the pipe minimum 1.0 (o ne) meter b elow finished general ground level.			
2.09.01	Trenching (a) The trench shall be cut true to the line and level and shall follow the gradient of the pipeline. The width of the trench shall be sufficient to give free w orking space on each side of the p ipe. Tr enches sh all conform to IS 5 822 or a ny international standard.			
2.09.02	Preparation and cleaning of piping (a) The pipeline shall be thoroughly cleaned of all rust, grease, dirt, weld scales and weld burrs etc. moisture or other foreign matter by power cleaning method such as sand or grit blasting, power tool cleaning, etc. Grease or heavy oil shall be removed by washing with a volatile solvent such as gasoline. Certain inaccessible portions of the pipeline (which otherwise not possible to be cleaned by power cleaning methods) may be s crubbed manually with a stiff wire brush and s crapped where necessary with specific permission of the Project Manager. (b) On the internal surface for pipes 1000 Nb and above, a coat of primer followed by a hot coal-tar enamel or coal tar epoxy painting (cold) shall be applied.			
2.09.03	Coating and wrapping/ Anti corrosive Protection Coal tar tape a. Buried piping shall be coated and wrapped, as per specification, after completion of welded a nd/or flang ed co nnections, and after completion and a pproval of Hyd ro testing. Materials to be used for coating and wrapping of underground pipelines are: (1) Coating primer (coal tar primer) (2) Coating enamel (coal tar enamel) (3) Wrapping materials. All primer/coating/wrapping materials and methods of application shall conform to IS: 10221 except asp halt/bitumen materi al. Materials (primer/coating/wrapping) as per AWWA-C-203 are also acceptable. Protective coating shall co nsist of coal t ar primer, co al tar e namel co ating, glass fiber, tissu e inner w rap followed by g lass fiber or co al tar im pregnated Kraft outer wrap or finish coat. Number of coats and wraps, minimum thickness for each layer of application shall be as per IS-10221. Nu mber of. Co ats and wraps shall be de cided ba sed on soil corrosivity/resistivity as indicated i n I S-10221. S oil data-for t his purpose s hall b e made available. Total thickness of completed coating and wrapping shall not be less than 4.0 mm. b. Alternatively, the anti-corrosive prote ction for bur ied pipes can con sist of a nti-corrosive protection Coal-tar tapes. Material and application of tapes shall conform to			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 8 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	IS 15 337 or equivalent. The se-tapes shall be applied hot over the cold coal tar primer in steps of 2mm thickness so as to cover the spiral edges of the first tape by the application of second tape. The total thickness of the finished protective coating shall be 4.0 mm minimum.			
2.09.04	Trench bed preparation and back filling Prior to lowering and laying pipe in any excavated trench, the bottom of the trench may require to be back filled and compacted (or as the case may be) to provide an acceptable bed for placing the pipe. Bed preparation in general shall be as per IS: 5822.			
2.09.05	Laying of galvanized steel (GI) pipes All the joints shall be screwed with socket or flanged. Screwed ends of GI pipes shall be thoroughly cleaned and painted with a mixture of red and white lead before jointing. Threaded portion on either side of the socket joint shall be applied with Zinc silicate paste. All the provisions for trenching' bed preparation' laying the pipe application of primer' coating' wrapping with tapes and back filling etc. as indicated for "laying of buried piping" and "anti corrosive protection for buried piping" are applicable for buried galvanized steel (GI) pipes also.			
2.10.00	Cleaning and flushing			
2.10.01	All piping shall be cleaned by the Bidder before and after erection to remove grease, dirt, dust, scale and welding slag.			
2.10.02	Before erection all pipe work, assemblies, sub-assemblies, fittings, and components, etc. shall be thoroughly cleaned internally and externally by blast cleaning or by power driven wire brushes and followed by air-blowing. However for pipe sizes below 100nb the pipes may be cleaned internally by compressed air blowing as an alternative to internal blast cleaning. The brushes shall be of the same or similar material as the metal being cleaned. Cleaning of Galvanized pipes shall be done by air blowing only.			
2.10.03	After erection, all water lines shall be mass flushed with water. The cleaning velocities in water lines shall be 1.2-1.5 times the operating velocities in the pipelines.			
2.10.04	All compressed air pipe work shall be cleaned by blowing compressed air.			
2.11.00	Specification for hangers and supports			
2.11.01	All supports and parts shall conform to the requirement of power piping code ANSI B 31.1 or approved equivalent.			
2.11.02	The maximum spans of the supports of straight length shall not exceed the recommended values indicated in ANSI B 31.1.			
2.11.03	At all sliding surfaces of supports suitable arrangement is to be provided to minimize sliding friction.			
2.12.00	Design/Construction/Material Particulars of Gate/ Globe /Check /Butterfly / Ball / Air release /Float valves / Moisture Traps.			
2.12.01	GENERAL (a) All valves shall have indicators or direction clearly marked on the hand-wheel so that the valves opening/closing can be readily determined.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 9 OF 16

22/PS-PEM-MAX				एनटीपीसी NTPC	
CLAUSE NO.		TECHNICAL REQUIREMENTS			
		(b) Special attention shall be given to operating mechanism for large size valves with a view to obtaining quick and easy operation ensuring that a minimum of maintenance is required. (c) The valves coming in vacuum lines shall be of extended gland type and/or water sealed. (d) The actuator-operated valves shall be designed on the basis of the following: (1) The internal parts shall be suitable to support the pressure caused by the actuators; (2) The valve-actuator unit shall be suitably stiff so as not to cause vibrations, misalignments, etc. (3) All actuator-operated valves shall be provided with hand operated gearing mechanism also. (4) All actuators operated valves shall open/ close fully within time required by the process. (e) Valves coming under the purview of IBR shall meet IBR requirements. (f) All valves shall be provided with embossed name plate giving details such as tag number, type, size etc. (g) Wherever required valves shall be provided with chain operator, extension spindles and floor stands or any other arrangement approved by employer so that they can be operated with ease from the nearest operating floor. Wherever necessary for safety purpose locking device shall be provided. Further, necessary small platforms for facilitating easy valve operation shall be provided by the contractor wherever necessary in consultation with project manager within the bid price at no extra cost to employer			
2.12.02		VALVE BODY MATERIAL Valve body material for various services shall be as follows: Valve body material for water application like Secondary circuit auxiliary cooling water of ECW system, clarified water, DM cooling water (pH corrected) , drinking water etc. shall be cast iron for sizes 65NB and above; gun-metal for sizes 50 Nb and below. For compressed air application, valve body material shall be cast carbon steel or forged carbon steel for sizes 65 mm NB & above and Gun metal for sizes 50 NB and below. DM water: SS body and disc along with SS internals. However for butterfly valves, Cast Iron /Ductile Iron/SG iron/carbon steel body and disc with elastomer lining are also acceptable.			
2.12.03		The design, material, construction, manufacture, inspection, testing and performance of valves shall comply with all currently applicable statutes, regulations and safety codes in the locality where the valves will be installed. The valves shall conform to the latest editions of applicable codes and standards as mentioned elsewhere. Nothing in this specification shall be construed to relieve the Bidder of his responsibility. Valves in general shall conform to the requirements of the following standards.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	
				PAGE 10 OF 16	



CLIPS-PEM-MAX		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC		
CLAUSE NO.						
2.12.04	Standards and Codes					
	AWWA-C-504		Rubber seated butterfly valves.			
	BS-5155/EN-593		Cast iron and steel body butterfly valves for general purpose.			
	IS-778		Gun-metal gate, globe and check valves for general purpose.			
	BS-5154		Copper alloy globe/globe stop and check and gate valves for general purpose.			
	IS-780		Sluice valves for water works purpose (50-300 mm size)			
	IS-2906		Sluice valves for water works purpose (350-1200 mm size)			
	IS-5150		Cast iron wedge and double disc gate for general purpose.			
	BS-5152		Specification for cast iron globe valves.			
	BS-5153		Cast iron check valves for general purpose.			
	IS-5312		Swing check type reflux (non-return) valves.			
	ANSI B 16.34		Standard for valves.			
	API-594		Standard for Dual-check valves.			
	API-600		Steel gate valves.			
	ANSI-B-16.10		Valves face to face and other relevant dimension.			
	API-598		Valves inspection test.			
	End Connections					
	The end connections, shall comply with the following:					
	Socket welding (SW) - ANSI B 16.11					
	Butt Welding (BW) - ANSI B 16.25.					
	Threaded (SC) - ANSI B 2.1					
	Flanged (FL) - ANSI B 16.5& AWWA-C-207 (steel flanges), ANSI B 16.1 (Cast Iron flanges).					
	2.13.00	Gate/Globe/Check Valves				
		(a) All cast iron body valves (gate, globe and non-return) shall have flanged end connections; (screwed ends for Ductile D.2NI body valves are not acceptable).				
		(b) All steel and stainless steel body valves of sizes 65 mm and above shall have flanged or butt welding ends. Valves of sizes below 65mm shall have flanged or socket welded ends. Compatibility of welding between valve body material and connecting pipe material is a pre-requisite in case of butt-welded joints.				
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)		
					PAGE 11 OF 16	

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	(c) All gun metal body valves shall have screwed ends. (d) All flanged end valves/specialties shall be furnished along with matching counter flanges, fasteners, gaskets etc. as required to complete the joints. (e) Gate/slucie valves shall be used for isolation of flow. All gate valves shall be of the full-way type, and when in the full open position the bore of the valve shall not be constricted by any part of the gate. Gate valves shall be of the solid/elastic or articulated wedge disc. Gate valves shall be provided with the following accessories in addition to other standard items: (1) Hand wheel (2) Position indicator (for above 50 mm NB valve size) (3) Draining arrangement wherever required. (f) Globe valves shall be used for regulation purposes. They shall be provided with hand wheel, position indicator, draining arrangement (wherever required) and arrow indicating flow direction. Preferably, the valves shall be of the vertical stem type. Globe valves shall preferably have radiused or spherical seating and discs shall be free to revolve on the spindle. The pressure shall preferably be under the disc of the valve. However, globe valves, with pressure over the disc shall also be accepted provided (i) no possibility exists that flow from above the disc can remove either the disc from stem or component from disc (ii) manual globe valves can easily be operated by hand. If the fluid load on the top of the disc is higher than 40-60 KN, bypass valve shall be provided which permits the downstream system to be pressurized before the globe valve is opened. (g) Check valves shall be used for non-return service. They shall be swing check type or double door (Dual plate) check type with a permanent arrow inscription on the valve body indicating the fluid flow direction. In long distance pipes lines with possibility of surge-occurrence, dual plate check valves are preferable for its spring controlled opening /closing of flaps/doors against flow reversals. However, dual plate check valves shall not be used for sizes more than 600mm NB. (h) For bore greater than 2" the valves must be swing check type or dual plate check type suitable for installation in all positions (vertical and horizontal); (i) For bore smaller than or equal to 2" the valves must be of the piston type to be installed, in horizontal position. (j) All gate and globe valves shall be provided with back seating arrangement to enable on line changing of gland packing. The valves shall be preferably outside screw & yoke type. (k) All gate and globe valves shall be rising stem type and shall have limit switches for full OPEN and full CLOSED indication wherever required. This will include motor-operated valves also wherever required. In such cases the limit switches shall form an integral part of the valve. Stop-gap arrangement in this respect is not acceptable. (l) All valves except those with rising stems shall be provided with continuous mechanical position indicators; rising stem valves shall have only visual indication through plastic/metallic stem cover for sizes above 50 mm nominal bore. (m) For CI gate, globe and check valves wherever thickness of body/bonnet is not mentioned in the valves standards, thickness mentioned in IS- 1538 for fitting shall be applicable.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 12 OF 16

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
2.13.01	MATERIAL OF CONSTRUCTION (GATE/GLOBE/CHECK VALVE)			
	(a) The materials shall generally comply with the following:			
	(1) Cast Steel Valves			
		Body & bonnet		ASTM A 216 Gr. WCB/ ASTM A 105
	V	Disc for non-return alves	ASTM	ASTM A 216 Gr. WCB/ A 105
	T	rim.	A	STM A 182 Gr. F6 or Equivalent
	(2) Stainless steel valves			
		Body & Bonnet		SS 304
		Disc		-do-
		Trim.		SS 316
	(3) Cast iron valves			
		Body & bonnet		BS 1452 Gr. 14/ IS-210 Gr. FG 260
		Seating surfaces and rings		13% chromium steel/ 13% Chrome overlay
		Disc for non-return valves		BS 1452 Gr. 14/IS-210 Gr FG 260
		Hinge pin for non-return valves		AISI 316
		Stem for gate globe valves		13% chromium steel or Equivalent
		Back seat		13 % chromium steel / 13% Chrome overlay
(4) Gun Metal valves				
	Body and bonnet		IS 318 Gr. 2/ Equivalent Standard	
	Trim.		-do-	
	(b) Cast iron body valves shall have high alloy steel stem and seat.			
	(c) Material for counter flanges shall be the same as for the piping.			
	(d) Forged carbon steel valves are also acceptable in place of Gun metal valves.			
2.14.00	Air Release Valve			
	(a) The air release valves shall be of automatic double air valve with two orifices and two floats. The float shall not close the valve at higher air velocities. The orifice contact joint with the float shall be leak tight joint.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)
PAGE 13 OF 16				

22/PS-PEM-MAX				एनटीपीसी NTPC	
CLAUSE NO.		TECHNICAL REQUIREMENTS			
		(b) The valve shall efficiently discharge the displaced air automatically from ducts/pipes while filling them and admit air automatically into the ducts/pipes while they are being emptied. Th e va lve shall also automa tically rele ase tra pped ai r from du cts/pipes during operation at the normal working pressure. (c) Body material of au tomatic air release valves shall comply generally with BS 1452 Gr. 14/IS: 210 Gr. FG 260. and spindle shall conform to high tensile brass. (d) Air release valves shall not have any integral isolation device within them. Each Air release valve sha ll be mounted, preceded by a sep arate isola tion gate / b utterfly valve.			
2.15.00		Butterfly valves			
2.15.01		Design/Construction			
		(a) The valves shall be designed for the design pressu re/temperature of the system on which it is installed and i n acco rdance with AWW A-C-504, EN -593 o r any other approved equivalent standard latest edition. Fabricated steel (IS: 2062 GR. E-250B) butterfly valves instead of cast iron body valves are also acceptable for size above 300 mm nb diameter. (b) The valves shall be suitable for installation in any position (horizontal/vertical etc.) and shall be generally of double-flanged construction. However for sizes 600 NB and below the valves of Wafer construction are also acceptable (c) Valves-350Nb a nd above shall have p ressure e qualizing bypass valves, wherever system parameters warrant the same. (d) Valves-200Nb and above shall also be provided with gear operator arrangement as a standard practice suitable for manual operation. Manual op eration of valve sha ll be through gear arrangement having totally enclosed gearing with hand wheel diameter and gear ratio designed to meet the required operating torque It shall be designed to hold the valve disc in intermediate position between full open and full closed position without creeping or fluttering . Adjustab le stop s sha ll be provided to prevent over travel in either direction. Limit and torque switches (if applicable) shall be enclosed in water tight enclosures along with suitable space heaters for motor actuated valves, which may be either for On-Off operation or inching operation with position transmitter.			
2.15.02		Material of Construction (Butterfly Valves)			
		Materials and other design details shall be as indicated below :			
(a)		Cast Iron Butterfly Valves			
		Body & DiscASTM A48, Gr. 40 with 2% Ni / IS: 210. Gr. FG-260, with 2% Ni / SG iron BSEN 1563, Gr EN GJS-400-15 with 2%Ni and epoxy coated ShaftBS 970 431 S: 291 / EN 57, or AISI-410 or AWWA-permitted shaft material equivalent to EN-57/AISI-410 or better. Seat ring18-8 Stainless steel			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	
				PAGE 14 OF 16	

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	(b)	Seal	Nitrile Rubber	
		Stainless Steel Butterfly Valves		
		Body & Disc	SS 304	
		Shaft	SS 316	
		Seat Rings	EPT/BUNA-N/Neoprene	
	(c)	Carbon steel Butterfly Valves		
		Body & Disc	ASTM A 216, Gr. WCB	
		Shaft	SS 304	
		Disc & Seat Rings	EPT/BUNA-N/Neoprene	
	(d)	Elastomer lined Butterfly Valves		
Body & Disc		ASTM A48, Gr. 40 / IS: 210. Gr. FG-260 / SG Iron (ductile iron) IS 1865 Gr 400-15 or BSEN 1563, Gr EN GJS-400-15 / ASTM A 216, Gr. WCB with elastomer lining.		
Shaft		SS 316		
2.15.03	Proof of Design Test (Type Test) for Butterfly Valves			
2.16.00	Proof of Design (P. O.D.) test certificates shall be furnished by the bidder for all applicable size- ranges and classes of Butterfly valves supplied by him, in the absence of which actual P.O.D. test shall be conducted by the bidder.			
	All valves that are designed and manufactured as per AWWA-C-504 / AWWA-C-516 shall be governed by the relevant clauses of P.O.D test in AWWA-C-504/AWWA-C-516. For Butterfly valves, designed and manufactured to EN-593 or equivalent, the P.O.D. test methods and procedures shall generally follow the guidelines of AWWA-C-504 in all respect except that Body & seat hydro test and disc-strength test shall be conducted at the pressures specified in EN-593 or the applicable code. Actuators shall also meet requirements of P.O.D. test of AWWA-C-504/AWWA-C-516.			
	Float operated valves			
	(a)	Valve shall automatically control the rate of filling and will shut off when a predetermined level is reached and close to prevent over flow on pre-set maximum water level. Valve shall also open and close in direct proportion to rise or fall of water level.		
	(b)	DESIGN AND CONSTRUCTION FEATURES		
		The following design and construction feature of the valve shall be the minimum acceptable.		
(c)	Valves shall be right-angled or globe pattern.			
(d)	Valves shall be balance piston type with float ball.			
(e)	Leather liner shall not be provided.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 15 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	(f) The body and cover material shall be cast iron conforming to ASTM-A 126 Grade 'B' or IS: 210 Grade 200 or equivalent, and Float shall be of copper with epoxy painting of two (2) coats. (g) Valves shall be suitable for flow velocities of 2 to 2.5 m/sec. (h) The valves shall have flanged connections. 2.17.00 Surface preparation and Painting for external piping surfaces (non-coastal projects) a) Surface preparation - Power tool cleaning / Shot blasting/ abrasive blasting b) Type of Primer - Red Oxide Zinc Phosphate primer (Alkyd base) to IS 12744 (2 X 25 microns) c) Intermediate Coat – Synthetic Enamel (long oil alkyd) to IS 2932 (1 X 30 microns) d) Final Coat - Synthetic Enamel (long oil alkyd) to IS2932 (2 X 35 microns) Min. Total DFT (Microns) to be maintained – 150 (Min) and Color shall be as per NTPC Color Coding Scheme Note: No painting is required on Galvanized, Stainless Steel, Gun Metal surfaces 2.18.00 Surface preparation and Painting for external piping surfaces (coastal projects) a) Surface preparation - Near white metal blast cleaning with surface profile 35-50 microns as per surface preparation specification SSPC.SP10 of Society of Protective coatings, USA b) Type of Primer – Inorganic zinc (ethyl) silicate primer coat (1 X 70 microns): Self-curing Inorganic Zinc (ethyl) Silicate Primer Coat (having minimum 80% of metallic Zinc content in dry film, Solid by Volume Minimum 60% $\pm 2\%$) to be applied over blast cleaned surface. c) Intermediate Coat (2 X 90 microns)– Polyamide Cured pigmented Micaceous Iron Oxide Epoxy based Paint (containing lamellar MIO minimum 30% on pigment, Solid by Volume Minimum 80% $\pm 2\%$) Polyamide Cured pigmented Micaceous Iron Oxide Epoxy based Paint (containing lamellar MIO minimum 30% on pigment, Solid by Volume Minimum 80% $\pm 2\%$). d) Final Coat (1 X 70 microns) - Acrylic Aliphatic Polyurethane, two pack, isocyanate based color pigmented Paint (Solid by Volume Minimum 55% $\pm 2\%$) Min. Total DFT (Microns) to be maintained – 320 (Min) and Color shall be as per NTPC Color Coding Scheme No te: 1.) For external surfaces (galvanized steel), proper surface preparation with power tool cleaning up to grade ST2, ISO :8501-01 followed by zinc phosphate primer with 50 microns DFT, again followed by Acrylic Aliphatic Polyurethane coat of 40 microns DFT. 2.) If final shade of 9002 (off white) is required then Micaceous Iron Oxide (MIO) color shall be grey. 3.) No painting is required on Stainless Steel, Gun Metal surfaces.			
LOT-3 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(3)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 16 OF 16	



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
PROJECT SPECIFIC GENERAL REQUIREMENTS

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : C 2D

REV. 00

**SECTION-I
SUB-SECTION-C2-D
QUALITY ASSURANCE**

ZZ/PS-PEM-MAX		QUALITY ASSURANCE		एनटीपीसी NTPC	
CLAUSE NO.					
		FLUE GAS DESULPHURISATION SYSTEM			
1.00.0		FLUE GAS DESULPHURISATION SYSTEM			
1.01.0		Mills:			
1.01.01		Raw material for shaft, coupling, gears and pinions, top and bottom races and other rotating components shall be subjected to UT. MPI /LPI shall be carried out to check surface soundness.			
1.01.02		Wear-resistant parts shall be UT/RT tested to check soundness after suitable heat treatment. Check for chemical composition, hardness and micro structure shall be carried out.			
1.01.03		Butt welds in the tube/separator/body casing of the mill shall be tested by RT and MPI. All other welds in main tube/separator shall be tested by MPI/LPI for acceptance. The tube shall be statically balanced.			
1.01.04		All gearboxes shall be run tested for adequate duration to check rise in oil temperature, noise level and vibration. Check for leak tightness of gearbox also shall be performed.			
1.02.0		Feeders:			
1.02.01		Any welds in the casing/pulley fabrication shall be checked with MPI.			
1.02.02		Routine tests shall be done as per relevant Indian Standards or equivalent International Standards.			
1.02.03		All major items like plates for casing, head pulley, tail pulley, pulley shaft and major castings shall be procured with respective material test certificates.			
1.02.04		Calibration check shall be carried out on all feeders.			
1.03.0		Dampers:			
1.03.01		All the dampers shall be subjected to operational test/checks.			
1.03.02		Gas tight Dampers shall be subjected to shop leakage test to demonstrate the guaranteed tightness as per NTPC Tech Specification.			
1.04.0		PIPING, VALVE AND SPECIALITIES:			
1.04.01		All pipes and fittings shall be tested as per applicable code.			
1.04.02		All valves shall be hydraulically/Air tested for body, seat and back-seat (if applicable) as per relevant standard.			
1.04.03		NDT on valves shall be as per relevant standard.			
1.04.04		Valves shall be offered for hydro test in unpainted conditions.			
1.04.05		Functional checks of the valves for smooth opening and closing shall also be done.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-B SUB-SECTION-V-QM1 FGD SYSTEM	
				Page 1 of 4	

ZZ/PS-PEM-MAX		QUALITY ASSURANCE		एनटीपीसी NTPC	
CLAUSE NO.					
1.05.00		TANKS / VESSELS:			
1.05.01		Atmospheric tanks:			
		i) All welds joints shall be DP tested and complete tanks shall be water fill tested. ii) All atmospheric storage tanks fabricated and erected at site shall be subjected to tests (Hydro, NDT and Vacuum) according to design code as applicable. iii) Rubber lining shall be tested for hardness and spark test, as applicable.			
1.05.02		Pressure vessels:			
		1) NDT on weld joint shall be as per respective code requirements or the minimum as specified as below: i) 100% DPT on root run of butt weld, nozzle welds and finished fillet welds. ii) 10% DPT on all finished butt welds. iii) 10% RT (covering all 'T'/cross joints) of butt welds. 2) Butt welds of dished ends shall be stress relieved and subjected to 100% RT. 3) Each finished vessels shall be hydraulic ally tested to 150% of the design pressure for a duration of 30 minutes.			
1.06.00		~~HEAT EXCHANGER/HEATER:~~			
1.06.01		~~All material shall be tested for chemical and mechanical properties and NDT as per relevant standard.~~			
1.06.02		~~NDT on welds and other checks shall be as per relevant code.~~			
1.06.03		~~Air heaters shall be subjected to dimensional and clearance checks as per standard practice~~			
1.06.04		~~Lub. oil system, drive system, soot blowing system etc. of Air heaters shall be checked suitably as per standard practice~~			
1.07.00		PUMPS:			
1.07.01		UT on shaft forgings (greater or equal to 40mm) and MPI/DPT shall be done on shafts and impeller to ensure freedom from defects.			
1.07.02		The pump casing shall be hydraulically tested at 200% of pump rated head or at 150% of shut off head, whichever is higher. The test pressure shall be maintained for at least half an hour.			
1.07.03		The pump rotating parts shall be subjected to static and dynamic balancing.			
1.07.04		All pumps shall be tested at shop for capacity, head efficiency and brake horse power at rated speed as per relevant/applicable standard.			
1.07.05		Noise and vibration shall be measured during the performance testing at shop.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-B SUB-SECTION-V-QM1 FGD SYSTEM	
				Page 2 of 4	

22/PS-PEM-MAX		QUALITY ASSURANCE		एनटीपीसी NTPC	
CLAUSE NO.					
1.08.00		STRUCTURES , DUCTS, HOPPERS:			
1.08.01		All materials shall be tested for chemical and mechanical properties as per relevant standard. All plates above 40mm shall be 100% Ultrasonically tested.			
1.08.02		Visual inspection of all welds shall be performed in accordance with AWS D1.1.			
1.08.03		NDT requirements of structural steel welds shall be as under: i) ii) iii) 100% RT/UT on butt-welds of plate thickness$\geq$ 32mm. For plates of 25mm$\leq$thickness$<$32mm-10% RT and 100% MPI. For plates of thickness $<$25mm-10% MPI/LPI.			
1.08.04		Edge for shop and field weld shall be examined by MPI for plate thickness $\geq$ 32mm.			
1.09.00		VACUUM BELT FILTER SYSTEM:			
1.09.01		Impeller, casing and shaft of vacuum pumps shall be tested for chemical and mechanical properties as per relevant standard. All plates above 40mm shall be 100% Ultrasonically tested.			
1.09.02		UT on shaft (if greater or equal to 40mm) and impeller shall be carried out.			
1.09.03		All vacuum pumps shall be tested at shop for capacity, power, pressure, efficiency, noise and vibration etc.			
1.09.04		Filter cloths and belts shall be tested for physical properties as per relevant standard			
1.09.05		Hydro cyclones shall be checked by visual, dimensional etc.			
1.10.00		SPRAY NOZZLES:			
1.10.01		Spray nozzles shall be tested for physical properties			
1.10.02		Spray nozzles also shall be subjected to performance test.			
1.11.00		AGITATORS:			
1.11.01		Rubber lining shall be tested for hardness and spark test			
1.11.02		Impellers shall be tested for dimensional and balancing check			
1.11.03		Gear Boxes shall be tested for run test as per standard practice			
1.12.00		FANS:			
1.12.01		Rotor components shall be subjected to ultrasonic test and magnetic particle inspection / liquid penetrant examination after rough machining.			
1.12.02		Butt welds in rotor components shall be subjected to 100% RT and all welds shall be magnetic particle/dye penetrant tested after stress relieving.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-B SUB-SECTION-V-QM1 FGD SYSTEM	
				Page 3 of 4	

22/PS-PEM-MAX		QUALITY ASSURANCE		एनटीपीसी NTPC	
CLAUSE NO.					
1.12.03	All rotating components and assemblies of fan shall be balanced dynamically				
1.12.04	Performance test shall be carried out on fans as per Technical specification/ Relevant standard				
1.12.05	Test for Natural Frequency and hardness of Fans blades shall be carried out as per Technical specification/ Relevant standard				
1.13.00	Thermal Insulation, Lagging & Cladding:				
	(a) Lightly resin bonded mineral wool:				
	LRB mattresses/sections of Rockwool/ Glasswool shall conform to & tested as per relevant clauses of Indian Standards and shall meet the requirements of NTPC data sheet. Type tests except Thermal Conductivity shall be regularly carried out once in three months, Thermal Conductivity Type Test shall be carried out minimum once in twelve months by the manufacturer. Requirements of various components like Binding wires, Lacing wires, Wire mesh, etc. shall be as per NTPC approved data sheet / as given in respective Sub-Section of Technical Requirements of Steam Generator & Auxiliaries.				
	(b) Lagging & Cladding:				
	All insulation shall be protected by means of an outer covering of Aluminium sheeting confirming to ASTM B-209-1060 temper H14 from reputed manufacturer meeting the requirements of NTPC data sheet.				
1.14.00	OTHER CRITICAL EQUIPMENTS:				
1.14.01	Checks/ NDTs shall be done as per relevant Indian Standards or equivalent International Standards.				
		</			



QUALITY ASSURANCE

LIME & GYPSUM HANDLING

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9

CLAUSE NO.	QUALITY ASSURANCE	
Lime & Gypsum Handling		
~~1.01.00~~ ~~1.01.01~~	~~Brakes and Clamps : Final testing of brakes shall include load, HV/IR & heat run tests.~~	
~~1.02.00~~ ~~1.02.01~~	~~Monorails and Hoists All electric hoist shall be tested as per IS 3938 and chain pulley block shall be tested as per IS 3832.~~	
1.03.00 1.03.01	Hoppers & Liners Rack & Pinion Gates/Flap Gates/Rod Gates	
	a) MPI/DP test shall be conducted on rack and pinion / rod / weld joint b) Functional checks on the gates shall be carried out along with respective actuator, if applicable.	
	1.04.00 Storage Silo 1.04.01 All materials shall be tested for Chemical & Mechanical properties as per relevant standard. MPI/DP test on welding shall be carried out. Fit up assembly checks shall be carried out at shop for all despatchable segments	
	1.04.02 Bag Filters : Leakage test shall be carried out for pressure parts. Pulsing and sequential test on bag filter shall be done.	
~~1.05.00~~	~~Belt Conveyor System The details of the checks to be carried out in the various equipments are to be submitted by the Contractor for Owner's approval. However, some indicative checks on different items are given below which should necessarily form a part of the Quality Assurance Plan to be agreed with the Owner.~~	
~~1.05.01~~	~~Idlers a) Check for run out and free movements shall be carried out on idlers. Run out shall be restricted as per IS:8598 b) Test for dust proofness, water proofness and dynamic friction factor of the Idlers shall be conducted at shop. The detailed procedures for the same shall be submitted for review and approval.~~	
~~1.05.02~~	~~Belting (a) Rubber cover of finished belt shall be checked for tensile strength and elongation at break before and after ageing. Rubber cover shall also be checked for abrasion, tear strength and hardness. (b) For finished belts, checks for elongation at 10% nominal tensile strength, tensile and elongation at break in longitudinal (warp) direction and tensile in transverse (weft) direction shall be carried out. (c) Adhesion test between ply to ply and cover to ply shall be carried out.~~	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION - VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
		Page 1 of 9

CLAUSE NO.	QUALITY ASSURANCE	
	(d) Troughability test and Test for fire resistance shall be carried out. (e) Test for procedure qualification for belt vulcanizing joint (at site) shall be done. Procedure for belt vulcanizing joint shall be discussed and finalized during FQP finalization. (f) There will be a limitation on the no. of repairs allowed on the belts. Following will be the acceptance norm for the cover repairs. i) The maximum size of a repair shall be limited to a size equivalent to one fifth the belt width. No single dimension shall exceed one fifth(1/5) of belt width. ii) Small local repair by dough filling of size 25mm x 25mm to a limited extent shall not be counted of repairs. However, in case of cluster of repairs, same shall be counted as a patch repair. iii) The maximum number of patch repair shall not exceed 5 per 100 mts. However, the total number of patch and dough filling repairs shall not exceed 10 per 100 meters. (g) In addition to above, Steel Cord belt shall also be tested for following. i. Cord dia and breaking strength ii. Finished belt shall be tested for cord pull -out strength before and after ageing, peeling resistance. iii. Dynamic cord pull out test iv. Cord dia, pitch and number of cords (h) In no case shall the cover thickness or the width of belt be less than that given in specification. (i) For testing purpose, belt sample shall be taken from anywhere of the belt roll length offered	
1.05.03	Belt Vulcanizing Machine	
	a) Check for tensile strength shall be carried out on a sample vulcanized belt joint for each type of belt in shop. However if such test has been done earlier, the report for same shall be submitted for verification. b) Complete assembly shall be tested at shop for temp. and pressure developed	
1.05.04	Pulleys	
	a) In addition to chemical, mechanical, hardness, microstructure as per applicable material specification, pulleys shaft forgings shall be subjected to ultrasonic testing.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION - VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
		Page 2 of 9

CLAUSE NO.	QUALITY ASSURANCE	
	b) 100% MPI/DPT on all welds shall be conducted and 10% RT/UT on butt welds shall be conducted. c) Static balancing of pulleys shall be carried out after rubber lagging. d) Checks on rubber lagging to include abrasion loss, shore hardness test, peel-off strength test and physical properties. Peel-off strength shall be 10 K g/Cm, Abrasion loss shall be less than 250 cubic mm when tested as per DIN 53516.	
1.05.05	Pull Chord & Belt Sway Switches a. Acceptance tests i) Over all dimension and functional test. ii) HV & IR test iii) Degree of protection test report.	
1.05.06	Zero Speed Switch, Under Belt Switch and Chute Blockage Switch a Acceptance test i) Burn in test at 50 degree C for 48 hours shall be done for electronic switches. ii) Over all dimension and functional test shall be carried out. iii) HV & IR iv) Degree of protection test	
1.06.00	Drive Equipments 1.06.01 Gear Boxes : (a) In addition to checks for physical, chemical, hardness, microstructure as per relevant standard, the shaft and gear/pinion forgings shall be subjected to ultrasonic testing. (b) MPI to be carried out on Gears/Pinions after machining. Case depth, hardness and MPI after hardfacing shall be checked to ensure freedom from defects. (c) Gear reducer shall be checked for reduction ratio, backlash and contact pattern. No load shop trial run to be conducted on gear boxes to check for oil leakage, temperature rise, noise level and vibration. 1.06.02 Flexible Coupling (a) Ultrasonic testing shall be conducted on forgings for gear sleeve and gear hub, if gear coupling is provided. (b) MPI shall be carried out after machining to ensure freedom from cracks.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
		Page 3 of 9

CLAUSE NO.	QUALITY ASSURANCE	
1.06.03	Fluid Coupling (a) Dynamic balancing shall be carried out for the rotating parts. (b) Check for leak tightness of the coupling shall be carried out. (c) Functional test on fusible plug for each type of coupling shall be conducted at shop. (d) All couplings to be run tested at shop on no load (e) Check for temperature rise, torque-speed, torque-slip characteristics and over speed test shall be included during performance test of one coupling of each type preferably at full load.	
1.07.00	Belt Scales The details of the checks to be carried out in the various equipments are to be submitted by the Contractor for Employer's approval. However, some indicative checks are given below which should necessarily form a part of the quality assurance plan to be agreed with the Employer. 1.07.01 Mounting arrangement/Overall dimensional checks shall be carried out on the Belt Scales. 1.07.02 Belt scale shall be calibrated with test weight/test chain in static at works and with test weight for dynamic condition at site. 1.07.03 All electronic modules shall be subjected to burn in test at 50 Degree C for 48 hours. 1.07.04 General check for load cell shall be carried out. 1.07.05 Test report for degree of protection on enclosure shall be furnished. 1.07.06 Accuracy/performance check shall be demonstrated at site. 1.08.00 Dust Control & Miscellaneous Systems(Dust Suppression & Dry Fog Dust Suppression System) The details of the checks to be carried out on the various equipments are to be submitted by the Contractor for Owners approval. However some indicative checks on different items are given below which should necessarily form a part of the Quality Assurance Plan to be agreed with by the Owner.	
1.08.01	Pumps (a) All materials should be of tested quality and test certificates to be provided. (b) DPT of machined shaft and impeller shall be done. (c) Shaft forgings to be also subjected to ultrasonic testing.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING Page 4 of 9

CLAUSE NO.	QUALITY ASSURANCE	
(d) Impellers to be dynamically balanced to ISO 1940 Gr.6.3 (e) All pressure parts shall be hydraulically tested at 150% of the shut-off head or 200% of rated head, whichever is higher for 30 minutes. No leakage is allowed. (f) All pumps to be performance tested as per Hydraulic Institute Standard/Indian Standard. Performance test to include check for noise, vibration level and temperature rise. 1.08.02 Valves & Specialities (a) Valves and Specialities shall be tested as per relevant standards / codes. (b) Seat Leakage and hydraulic test to be carried out as per relevant standards / codes. 1.08.03 Pipes and Fittings Pipes and fittings shall be tested as per relevant standards/ codes		
1.08.04 Air Compressor a) All pressure parts shall be hydraulically tested at not less than 150% of design pressure for a duration of 30 minutes prior to painting. b) All other parts including inter-connecting piping shall be hydraulically tested wherever possible, as per relevant codes. c) Ultrasonic testing shall be carried out on all forgings and rotor for dia 50mm and above. MPI/DPT shall be done on machined area of the components. d) During assembly all clearances and alignments shall also be checked and recorded e) Rotor shall be statically and dynamically balanced f) Performance Test(Shop Test) i. Performance test on the compressor shall be carried out in accordance with ISO:1217/Eq. The test shall also include demonstration of loading and unloading mechanism(Capacity control) and operation of safety valve ii. Vibration and Noise level measurement shall be done during shop performance test. 1.08.05 Air Receiver a) Each finished vessel shall be hydraulically tested at 150% of the design pressure for a duration of 30 minutes b) NDT on weld joints shall be as per respective code requirements or the minimum as specified below		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING Page 5 of 9

CLAUSE NO.	QUALITY ASSURANCE	
	i. 100% DPT on root run of butt welds ii. 100% DPT on all finished butt welds and fillet welds iii. 10% RT on butt welds which shall include all T-Joints	
1.09.00	Dust Extraction and Ventilation System	
1.09.01	Fan	
	(a) All materials should be of tested quality and test certificates should be provided. (b) Dynamic balancing of the fan impellers to be carried out. (c) Shop run test shall be conducted on all centrifugal fans including check for noise and vibration level. (d) Performance test shall be conducted on one fan of each type at shop for capacity, pressure, efficiency and power consumption.	
1.09.02	Valves and Specialties	
	Refer 1.08.02 above	
1.09.03	Pipes and Fittings	
	Refer 1.08.03 above	
1.09.04	Package Air-Conditioner	
	Each Unit shall be subjected to production routine Test excluding performance test carried out as per relevant standard. Performance test of PAC shall be carried out as per relevant standard on one unit of each type and rating at site.	
1.10.00	Crushers The details of the checks to be carried out for various components are to be submitted by the Contractor for Owner's approval. However, some indicative checks on different items are given below which should necessarily form part of the Quality Assurance Plan to be agreed with the Owner. (a) All plates equal to or above 25mm thickness shall be ultrasonically tested. (b) Shaft forgings and suspension bars to be checked for ultrasonic testing in addition to check for chemical, mechanical, hardness, microstructure etc. as per applicable material specification. (c) Following minimum NDT requirements to be ensured for welds: i) Butt welds - 10% UT/RT and 100% MPI/DPT. ii) Fillet Welds - 10% MPI/DPT.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING Page 6 of 9

CLAUSE NO.	QUALITY ASSURANCE	
	(d) Crusher rotor to be dynamically balanced. Procedure to be submitted for approval. (e) No-load trial run test to be carried out at shop to check for speed(RPM), temperature rise, noise level and vibration. 1.11.00 Mobile Trippers (a) Shaft and wheel forgings – Ultrasonic test in addition to check for chemical, mechanical, hardness, microstructure etc. as per applicable material specification shall be conducted. (b) Following minimum NDT requirements to be ensured for welds: i) Butt welds - 10% UT/RT and 100% MPI/DPT. ii) Fillet Welds - 10% MPI/DPT. (c) Shop trial run test shall be carried out and shall include check for noise level and vibration. 1.12.00 In-Line Magnetic Separators i) Overall Dimensional Visual check alongwith control panel. ii) HV & IR. iii) Operation, temperature rise, lifting capacity, force index and gauss strength. 1.13.00 Metal Detectors i) Functional test including sensitivity, Burn in test, operation of liquid spray marker, detection of smallest piece of different materials as specified. ii) Test report for Degree of protection test to be furnished. 1.14.00 Sampling Units (a) Free carriage and cutter movement, speed of cutter and dust door closing and sealing shall be tested for samplers. (b) "No load test" shall be carried out for crushers. 1.15.00 Elevators (Passenger cum goods elevator) Refer QA table for passenger/service elevator.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
		Page 7 of 9

CLAUSE NO.	QUALITY ASSURANCE	
1.16.00 Steel Structure	1.16.01 Only material which has been identified against mill sheet or test certificates shall be used for construction. Check testing shall be carried out in the absence of MTC. Correlation shall be maintained by Manufacturer. All plates above 40mm thickness shall be 100% ultrasonically tested. 1.16.02 Visual inspection of all welds shall be performed in accordance with AWS D.1.1. 1.16.03 NDT requirements of structural steel welds shall be as under: a) 100% RT/UT on butt-welds of plate thickness ≥ 32 mm. Edge for field weld shall be examined by MPI for plate thickness ≥ 32mm. b) For Plates of $10 \text{ mm} < \text{thickness} < 32 \text{ mm}$ - 10% RT On butt welds. c) 10% Ultrasonic testing shall be carried out on full penetration welds (other than butt welds) d) DP Test on Welds: • 100% on Root Run & 10% on Final Welds of all butt welds • At random 5% on fillet of built-up plate girders. 1.16.04 Girders/columns/Beams etc shall be trial assembled and match marked prior to dispatch. Trial assembly procedure at shop shall be submitted for NTPC review and approval.	
~~1.17.00 Paddle feeder~~	<del> 1.17.01 Shaft and wheel forgings – Chemical, Mechanical, Hardness and Ultrasonic Test shall be conducted. 1.17.02 Following minimum NDT on Weld Joint shall be carried out (a) Butt Welds - 10% UT/RT & 100% MPI/DPT (b) Fillet Welds - 10% MPI/DPT 1.17.03 Shop trial run shall be conducted to check for movement and RPM of Paddle wheel & Travel wheel, function of P/F in locked rotor condition, noise and vibration etc. </del>	
1.18.00 Vibrating Screen Feeders	(a) Shaft forgings to be checked for ultrasonic testing in addition to check for chemical, mechanical, hardness, microstructure etc. as per applicable material specification	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
Page 8 of 9		

CLAUSE NO.	QUALITY ASSURANCE	
	(b) Following minimum NDT requirements to be ensured for welds: i) Butt welds - 10% UT/RT and 100% MPI/DPT. ii) Fillet Welds - 10% MPI/DPT. (c) Shop trial run test shall be conducted to check s for speed (RPM), a mplitude (stroke), temperature rise and noise level.	
	1.19.00 APRON FEEDER 1.19.01 All plates equal to or above 25 mm thickness shall be ultrasonically tested. 1.19.02 Castings and forgings, forged/rolled bar/section shall be subjected to ultrasonically test in addition to check for chemical, mechanical, hardness, microstructure etc. as per applicable material specification. 1.19.03 Machined and hard faced surface of casting/forging and other hardened, stellited parts shall be subjected to DPT/MPI in addition to check for case depth, hardness as applicable for chain/sprocket/gear reducer/rollers/wheel/pan etc. 1.19.04 Suitable check for life time sealing of rollers for protection from dust and water shall be done 1.19.05 Following minimum NDT requirements shall be followed for welds: i) Butt Welds in Tension- 100% UT/RT and 100% MPI/DPT. ii) Butt Welds in Compression- 10% UT/RT and 10% MPI/DPT. iii) Fillet Welds - 10% MPI/DPT. 1.19.06 For other items like drive system, motor, pulley, etc. the relevant portion of specification shall be applicable 1.19.07 No load trial run test shall be carried out at shop on completely assembled apron feeder to check for trouble free operation, temperature rise, Noise & vibration.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION - VI BID DOC. NO.:CS-0011-109(3)-9	PART-B SUB-SECTION-V-QM2 LIME & GYPSUM HANDLING
		Page 9 of 9

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

RECORD OF REVISION

REV NO	DATE	DETAILS OF REVISION
00	01.11.2019	Original Issue - First Submission
01	18.11.2019	NTPC comments: SI no: 32, 33& 38 of FGD, DFT- 300 microns BHEL reply: The SI nos: 32, 33& 38 of FGD are of Limestone silo structures, Limestone silo- Outside surfaces and Platform structures are given painting as per the civil specification as they are the steel structures. As per the clause 31.03.00 of Sec.VI, Part-B, Sub section IV-D civil works, total DFT is 240 microns only. We have given as per the NTPC specification only. We request you to kindly consider and approve our painting schedule.
		NTPC comments: We understand that the painting details of DCS and control panels shall be provided in the respective GA/ IA details kindly clarify. BHEL reply: We wish to submit that the painting details of DCS and control panels is provided in the respective GA/IA details. We request you to kindly approve the painting schedule.

SECTION-I SUB-SECTION-C2-E

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

1. FANS

1	Axial Fan tool & fixtures (Clause 20.03.00 of Part- C Section VI)	55 000	Power Tool Cleaning to st3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
2	Booster Fan foundation material	55 081	Temporary rust preventive fluid application as per PRQA 523 DFT- 20µ All Threaded and other surfaces of foundation bolt and its materials shall be coated with temporary rust preventive fluid. During execution of civil works the dried film of coating will be removed using Organic Solvents.					
3	Booster Fan Handrails & Insert (Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D)	55 082	Blast cleaning to Sa 2½/ Acid pickling	Hand rails, Gratings- Hot dip galvanizing to 610gms/sq.m (minimum) and to a coating thickness of 87µm (min).				
4	Booster Fan Handrails & Insert- Structural items other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	55 082	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
5	Axial booster cooling/ seal fan (Clause 1.04.00 of Part- A Section VI)	55 084	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat	100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ	75	300

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

				Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100	Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	25	
6	Booster fan canopy for motor (Clause 1.04.00 of Part- A Section VI)	55 089	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat	100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ	75	300
				Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100	Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	25	
7	Axial booster fan rotor (Clause 20.03.00 of Part- C Section VI)	55 286	Power Tool Cleaning to St3 (SSPC-SP3)	Two coats of Epoxy based Zinc phosphate primer (Two pack system) to IS 13238; DFT- 30µ/coat	60	NIL	--	60
8	Axial booster fan stator (Clause 20.03.00 of Part- C Section VI)	55 586	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
9	Axial booster fan coupling (Clause 1.04.00 of Part- A Section VI)	55 880	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat	100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ	75	300
				Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100	Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	25	

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
10	Booster fan LOS with lubricant (Clause 1.04.00 of Part- A Section VI)	55 980	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
11	Booster fan actuator (Clause 1.04.00 of Part- A Section VI)	55 983	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

2. FGD SYSTEM

1	Slurry recirculation pump System (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 212	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Light blue RAL 5012	100	210
2	Absorber System Internals – Structural items (Clause 1.04.00 of Part- A Section VI)	FW 213	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
3	Mist eliminator and accessories, Absorber baffle grating support, Mist eliminator support& Absorber Spray pipe support - Structural items (Clause 1.04.00 of Part- A Section VI)	FW 215 FW 216 FW 217 FW 218	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
4	Absorber System- Base (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 219	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
			conforming to ISO 8501-1	and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
5	Absorber system structures, Absorber shear plate, Duct supports, Structures for RC pump house& Hook up duct structure (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 220 FW 231 FW 232 FW 233 FW 234 FW 236 FW 238	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
6	Absorber system casing bottom- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 221	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
	Inside surfaces are of C276 clad sheets, hence no paint is envisaged.			Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
7	Absorber system casing top- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D) Inside surfaces are of C276 clad sheets, hence no paint is envisaged.	FW 222	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
8	Absorber system accessories (Clause 20.03.00 of Part- C Section VI)	FW 223	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
9	Emergency Quench water tank- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 226	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
				Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
10	Emergency Quench water tank- Inside surfaces	FW 226	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm	Primer: Two coats of Red Oxide Zinc phosphate primer, DFT-30µ/coat; Total-60µ (Primer is only envisaged as lining is given in inside surfaces of the tank)				
11	Emergency quench system, Handling Equipment RC pump (Clause 20.03.00 of Part- C Section VI)	FW 227 FW 249	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	60	120
12	Air oxidation system, Viewing ports (Without glass) (Clause 20.03.00 of Part- C Section VI)	FW 230 FW 239	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
13	Absorber W/D interface, W/D wash system, Slurry distribution system, Oxidation Air distribution system (Clause 1.04.00 of Part- A Section VI)	FW 228 FW 229 FW 243 FW 244	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
14	Expansion joint between bypass (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 251	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (two coats)	60	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	40
15	Expansion joint (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 252	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	40
16	Ducts between bypass duct inlet& booster fan (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 255	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	40
17	Ducts between Booster fan& Absorber (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 256	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	40

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)	
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)		
18	Ducts between Absorber& Stack (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 257	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
19	Duct structure between bypass duct& Booster fan (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)		FW 260	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
20	Duct structure between Booster fan& Absorber (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)		FW 261	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

				with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ		exposure, gloss less than 30 and colour change less than 2.0Δ E)		
21	Duct structure between Absorber & Stack (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 262	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

25	Structures for booster fan handling (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 310	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
26	Galleries and railings for Stairs, Absorber, Dampers, Ducts, Tanks (Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 237 FW 610 FW 612 FW 613 FW 722	Blast cleaning to Sa 2½/ Acid pickling	Hand rails, Gratings- Hot dip galvanizing to 610gms/sq.m (minimum) and to a coating thickness of 87µm (minimum)				
27	Galleries and railings for Stairs, Absorber, Dampers, Ducts, Tanks – Structures other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 237 FW 610 FW 612 FW 613 FW 722	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
				Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
28	Slurry pumps & accessories, Water pumps (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 701 FW 702	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Light blue RAL 5012	100	210
29	Monorail for hoist & cranes (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 710	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
30	Handling Equipment- Hoists& Man hole door (Clause 20.03.00 of Part-C Section VI)	FW 713 FW 714 FW 717	Power Tool Cleaning to st3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Idler roller shall be applied with two coats of 70 microns at shop	70	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	60	130
31	Agitator support Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 721	Blast cleaning to Sa 2½ (Near white metal) with surface	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
			profile 40-60µm conforming to ISO 8501-1	minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
32	Limestone silo structures Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 730	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
33	Limestone Silo- Outside surfaces Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
				Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
34	Lime stone Silo- Inside surfaces (Conical portion)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm conforming to ISO 8501-1	Primer: Two coats of Red Oxide Zinc phosphate primer to IS: 12744 (SS lining is inside the Limestone silo conical portion, hence primer is only envisaged; SS lining will be done at shops itself)	60	NIL	--	60
35	Lime stone Silo- Inside surfaces (Cylindrical portion)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 µm per coat (min.) Zinc dust composition shall be Type-II as per ASTM D520-00	70	--	--	70
36	Air cannon silo, Bag filter & Fan assy, Nozzles& Flanges (Clause 20.03.00 of Part-C Section VI)	FW 723 FW 724 FW 725	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
37	Limestone silo approach platform, Platform for Pipe racks& Sub pipe racks (Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767	Blast cleaning to Sa 2½/ Acid pickling	Hand rails, Ladders, Gratings- Hot dip galvanizing to 610gms/sq. m (minimum) and to a coating thickness of 87µm (minimum)				

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
38	Limestone silo approach platform, Pipe racks, Sub pipe racks platform- Structures other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
39	Limestone Mill – Outside surfaces (Clause 1.04.00 of Part- A Section VI)	FW 735	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
40	Lime stone mill- Inside surfaces	FW 735	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 µm per coat (min.) Zinc dust composition shall be Type-II as per ASTM D520-00	70	--	--	70

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
41	Gypsum belt filter and accessories Structural items (Clause 1.04.00 of Part- A Section VI)	FW 738	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
42	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydro cyclone waste water tank, Neutralization tank, Process Water tank, Belt filter washing tank, Primary hydro cyclone feed tank, Clarified water tank Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 785 FW 786 FW 800 FW 802	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
43	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydrocyclone waste water tank, Neutralization tank,	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 749	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) (Liner is inside the tank, hence primer is only envisaged; Protection till erection only)	60	NIL	--	60

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

	Process Water tank, Belt filter washing tank, Primary Hydrocyclone feed tank, Clarified water tank, Tank internal structure Inside surfaces	FW 800 FW 802						

44	Process water pipe accessories, Cooling pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 751 FW 752	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	210
45	Slurry pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 753	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	210
46	Service Air pipe accessories (Referred from cl. 10.00.00 of Section-VI, Part-B, Sub section-I-M3)	FW 754	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
47	Instrument air pipe accessories (Referred from cl. 10.00.00 of Section-VI, Part-B, Sub section-I-M3)	FW 755	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat	60	120

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
						Identification Tag: Sky Blue Shade no: 101 as per IS 5		
48	All valves (Temp <95 deg C) (Clause 20.03.00 of Part-C Section VI)	FW 815 to FW 851	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat	60	120
49	Structure for Pipe racks, Sub pipe racks Trestle for pipe racks, Structures inside Gypsum dewatering building & Ball mill building (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 761 FW 765 FW 768 FW 769 FW 787	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
50	Supports for cable trays, Air receivers, commissioning& Mandatory spares, Tools & tackles (Clause 20.03.00 of Part-C Section VI)	FW 779 FW 798 FW 988 FW 996	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

3. GATES & DAMPERS

01	Gates & Dampers > 95° C Insulated Surfaces& Uninsulated surfaces	57 540 57 550 57 583	Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	--	--	40
02	Seal air piping	57 141	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
03	Blower with Motor Knife Gate valve Mounting bracket Mandatory spares	57 491 57 497 57 209	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
04	Ladder, Cage for Ladder Toe Guard Plate Floor Grill, Hand Rails, Hand Rail Post Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D	57 466 57 566	Blast cleaning to Sa 2½/ Acid Pickling	Hot Dip Galvanizing to 610 gm per sq. Meter (minimum) and to a coating thickness of 87 µm (minimum)				
05	Other Structural Items- Other than sl.no. 3 of above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	57 466 57 566	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat	70	240

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μm min.)
				PAINT	DFT (μm min.)	PAINT	DFT (μm min.)	
				and properties shall be as per Type II as per ASTM D520-00 DFT- 70 μ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80% $\pm$ 2) DFT- 100 μ	100	Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0 Δ E)		

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μm min.)
				PAINT	DFT (μm min.)	PAINT	DFT (μm min.)	

4. PAINTING OF DAMAGED AREAS

Areas where paint has deteriorated badly by erosion and areas where the paint film has lost its adhesion property and where the steel has got rusted appreciably - these areas are to be repainted as per the following procedure:

SL NO	SURFACE LOCATION	SURFACE PREPARATION	PRIMER, INTERMEDIATE & FINISH
1	Paint damaged Components falling under Sl.no. 04,05,06,09,10,11 of Fans, Sl no.02,03,04, 05,06,07, 09, 13,19,20,21,23,25,27, 29, 31,32 33,38,39,41,42, 49 of FGD and Sl no. 5 of GAD.	Hand/ Power Tool cleaning to Bare metal to minimum 6 inches peripheral area adjoining to damaged area	Primer: Epoxy Zinc rich primer to IS 14589, DFT-70μ (If Metal surface exposed) followed by intermediate & finish coat as per respective scheme If primer is intact- Intermediate & finish as per respective scheme
2	Paint damaged components failing under other Sl.nos of Fans, FGD& GAD	Power Tool Cleaning to Bare metal	Primer and Finish : As given in respective scheme

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μ m min.)
				PAINT	DFT (μ m min.)	PAINT	DFT (μ m min.)	

GENERAL NOTES

1. No painting is required for Galvanized, non-ferrous & stainless steel items, except as indicated above.
2. Machined items are to be applied with coat of temporary rust preventive oil
3. PGMA's covered in sub-supplier (ie., Purchased) items viz., Agitator/ slide bearing and other sub-delivery components etc., are not indicated in the above list. However, the Painting Schedule for all items supplied by all sub-suppliers and BOI under the scope of BHEL shall be same as for main equipment covered in this document.
4. In sub-assy, wherever plates / sheets of thickness less than or equal to 5mm and rods are used, very minor items like clamps, small items etc - Power Tool or Hand Tool Cleaning to SSPC - SP 3 / SP 2 shall be followed and painting under SI no:01 of Fans shall be followed.
5. Ground shade/colour of finish paints and identification tag/band for equipment, fans, piping, pipe services, supporting structures and other components is followed as per NTPC doc no: QS-01-DIV-W-4 at site.
6. All components covered under different PGMA's are to be painted. Incase any component is left out, the same shall deemed to be included under the relevant section.
7. All threaded and other surfaces of foundation bolts and its materials, insulation pins, Anchor channels, Sleeves shall be coated with temporary rust preventive fluid and during execution of civil works; the dried film of coating shall be removed using organic solvents.
8. Painting requirement for all electrical equipment shall be as per the details identified in specification for the respective equipment.
9. All steel structures shall be provided with painting as given in the specification. Further, painting system shall also meet the requirements of corrosivity category C3 (durability high) as per ISO 12944.
10. Finish coat to be applied after an interval of min 10 hrs and within 6 months (after completion of intermediate coat).
11. Primer coat on steel shall be applied in shop immediately after blast cleaning by airless spray technique.
12. For the portion of steel surfaces embedded in concrete, the surface shall be prepared by Manual cleaning and provided with Primer coat of Chlorinated Rubber based Zinc Phosphate Primer of Minimum 50 Micron DFT.

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μ m min.)
				PAINT	DFT (μ m min.)	PAINT	DFT (μ m min.)	

PAINTING SCHEME- DETAILS OF PROCUREMENT & APPLICATION PROCESSES

SL NO	TYPE OF PAINT	SPECIFICATION OF PAINT	NO OF PACK	VOLUME OF SOLIDS (% Min)	MODE OF APPLICATION	MIN. OVER COATING INTERVAL (hours)	SHADE
01	Epoxy Zinc phosphate primer	IS 13238	2	40	Spray	24	Grey
02	Zinc Ethyl silicate primer (% Zn on dry film= 80 (min))	IS 14946	2	60	Airless Spray only At Shop	24	Grey
03	Epoxy High solid- Polyamide cured Epoxy based MIO pigmented intermediate coat	--	2	80	Airless Spray only At Shop	16	Brown
04	Aliphatic isocyanate acrylic polyurethane paint	IS 13213	2	55	Spray At Shop	16	Corresponding shade no
05	Heat resistant aluminium paint	IS 13183 Grade II	1	--	Brush/ Spray	24	--
06	Long oil alkyd Synthetic enamel finish paint	IS 2932	1	35	Brush/ Spray	12	Corresponding shade no
07	Synthetic Enamel Intermediate coat	IS 2932	1	40	Brush/ Spray	12	--
08	Red oxide Zinc phosphate primer	IS 12744	1	--	Brush/ spray	12	--

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

PGMA DETAILS

SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
01	FW 212	Slurry recirculation pump system	RC Pumps incl Shaft seal Common Base Plate Coupling and Guard Gear Box Expansion Bellow Anchor Bolts & Fasteners Special Tools
02	FW 219	Absorber system base	Absorber tank bottom plate
03	FW 220	Absorber system structures	Absorber tank structure Absorber tower structure Spray headers structure
04	FW 221	Absorber system casing bottom	Absorber tank wall casing- bottom
05	FW 222	Absorber system casing top	Absorber Tank wall casing –Top Mist Eliminator supports Spray pipe supports Internal Beam Shim plates in Absorber area Internal Struts
06	FW 223	Absorber system accessories	Nozzles and flanges Inspection doors & Man holes Viewing ports Antifoam dosing equipment Suction strainers- FRP
07	FW 226	Emergency Quench water tank	Base Plate & its supports Roof, Shell
08	FW 227	Emergency Quench System	Emergency Quenching Spray Pipe Nozzle for Emergency Pipe Fasteners Gaskets
09	FW 230	Air oxidation System	Oxidation Blowers Common Base Plate Coupling and Guard Anchor Bolts & Fasteners Expansion Bellow Suction & Discharge Silencers Acoustic Enclosure Water Injection cooling system

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

			Pipe, Valves & Instruments Special Tools

SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
10	FW 244	Oxidation air distribution System	Pipe & Fittings Flanges Pipe Hanger, Bottom Elbow, Bottom sliding supports
11	FW 251	Expansion joint between bypass	Expansion joints Seal Plates & Fasteners
12	FW 252	Expansion joint between scrubbers	Fabric & its fixing fasteners Sleeves & Flanges Gaskets
13	FW 255	Ducts between bypass duct inlet & booster fan	Plates & Stiffeners Guide Vanes
14	FW 256	Ducts between Booster fan & Absorber	Plates & Stiffeners Guide Vanes
15	FW 257	Ducts between Absorber & stack	Plates & Stiffeners Guide Vanes
16	FW 260	Duct structure between bypass duct& Booster fan	Duct Supports Gusset Plate Divider plate Internal Struts Support bearings
17	FW 261 FW 262	Duct structure between booster fan& absorber & Absorber and Stack	Duct Supports Gusset Plate Divider plate Internal Struts Support bearings
18	FW 292	Structures for Elevator	Columns Seal Plate Bracings Enclosure (Purlin& sheeting)
19	FW 293	Elevator and accessories	Base Frame Buffer Spring Mast Section Cage Control Panel & AC Mandatory Spares

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
20	FW 310	Structures for booster fan handling	Columns Beams Bracings Seal plate
21	FW 610 FW 722	Galleries & railings for Scrubbers, Tank	Stairs Handrail Step treads Floor grills Ladders Foundation bolts Fasteners
22	FW 701	Slurry pumps & accessories	Slurry Pumps incl Shaft seal Common Base Plate Coupling and Guard Belt & Pulley Expansion Bellow Anchor Bolts & Fasteners Motor & accessories Sump Pumps incl Shaft seal Common Base Plate Coupling and Guard Belt & Pulley Anchor Bolts & Fasteners Motor & accessories
23	FW 710	Monorail for hoist& cranes	Insert Plate Stiffener plate Monorail beam
24	FW 721	Agitator support	Channels & Beams
25	FW 730	Limestone silo structures	Columns Beams Bracings Seal plate Angles, channels

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
26	FW 731	Limestone silo	Base plate & its supports Shell, Roof
27	FW 723 FW 724 FW 725	Air cannon Bag filter Nozzles & flanges	Bag filter Air cannon bin activator Nozzles & Flanges
28	FW 733	Limestone silo approach platforms	Stairs Handrail Step treads Floor grills Ladders Foundation bolts Fasteners
29	FW 734	Limestone mill	Wet ball mill Hydro cyclone- Mill area Mill circuit pump Mill separator tank with Agitator
30	FW 742	Lime stone slurry storage tank	Base plate & its supports Shell, Roof
31	FW 743	Auxiliary Absorber tank	Base plate & its supports Shell, Roof
32	FW 744	Filtrate tank	Base plate & its supports Shell, Roof
33	FW 745	Wastage water tank	Base plate & its supports Shell, Roof
34	FW 747	Hydro cyclone waste water tank	Base plate & its supports Shell, Roof
35	FW 748 FW 785 FW 786	Process Water tank Belt filter washing tank Primary Hydro cyclone feed tank	Base plate & its supports Shell, Roof
36	FW 751 FW 752	Process water pipe accessories Cooling water pipe accessories	CS/FRP Pipes & Fittings Sight Glass R Orifice Gaskets & Fasteners
37	FW 753	Slurry pipe accessories	CSRL/FRP Pipes & Fittings Strainer (Cone) Expansion Joint-Rubber R Orifice Gaskets & Fasteners

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
38	FW 754	Service air pipe accessories	GI Pipes & Fittings Flexible Hose Expansion Joint (Metallic) Hose connector R Orifice Gaskets & Fasteners
39	FW 755	Instrument air pipe accessories	SS Pipes & Fittings Strainer(Y Type) Gaskets & Fasteners
40	FW 815 to FW 851	Valves and fittings	Globe valves Ball Valves Butterfly Valves Diaphragm Valves Gate Valves CheckValves Pinch Valves Knife Gate Valves Control Valves Relief Valves
41	FW 761 FW 765	Structures for Pipe racks Structures for Sub pipe racks	Bracings Columns
42	FW 280 FW 281 FW 282 FW 283 FW 740 FW 760 FW 763	Foundation material for duct structure Foundation material for absorber Foundation material for Tanks Foundation material for Pipe racks Foundation material for Elevator Foundation material for RC pump shed	Foundation bolts Template
43	FW 766	Platforms for Pipe rack	Stairs Handrail Step treads Floor grills Ladders Foundation bolts Fasteners
44	FW 768 FW 769	Trestle for Main & sub Pipe racks	Truss Beams, Supports for all Pipes
45	FW 779	Supports for cable tray	Double Sup Channel & Base plates Single Sup Channel & Base plates

SI No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μm min.)
				PAINT	DFT (μm min.)	PAINT	DFT (μm min.)	

			Cantilever Arm Fasteners & clamps Brackets
46	FW 996	Tools	Erection , commissioning, special tools
SNO	PGMA	PGMA DESCRIPTION	PGMA DETAILS
47	FW 798	Air receivers	Instrument Air receivers Any Instruments/Valves
48	FW 800	Clarified water tank	Base plate & its supports Shell, Roof
49	FW 802	Neutralization tank & accessories	Base plate & its supports Shell, Roof
50	FW 988 FW 997 FW 999	Commissioning spares & Mandatory spares	Startup & commissioning spares Mandatory spares

963437/2022/PS-PEM-MAX



TITLE :
ELECTRICAL EQUIPMENT SPECIFICATION
FOR
LIME DOSING/FEEDING SYSTEM
KORBA STPP, STAGE-I,II & III

SPECIFICATION NO.

VOLUME NO. :

SECTION :

REV NO. **00** : DATE : 23.05.2020

SHEET : 1 OF 3

SECTION-I SUB-SECTION-C3

TECHNICAL SPECIFICATION FOR LIME DOSING/FEEDING SYSTEM (ELECTRICAL PORTION)

963437/2022/PS-PEM-MAX



TITLE :
ELECTRICAL EQUIPMENT SPECIFICATION
FOR
LIME DOSING SYSTEM
KORBA STPP, STAGE- I, II & III

SPECIFICATION NO.

VOLUME NO. :

SECTION :

REV NO. **00** : DATE : 23.05.2020

SHEET : 1 OF 1

CONTENTS

Sr. NO.	TITLE	NO. OF SHEETS
1	TITLE SHEET	1
2	CONTENT SHEET	1
3	SPECIFIC TECHNICAL REQUIREMENTS	3
4	ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR	2
5	NTPC TECHNICAL SPECIFICATION FOR MOTORS	10
6	STANDARD SPECIFICATION FOR LV MOTORS	5
7	NTPC TECHNICAL SPECIFICATION FOR CABLING	13
8	QUALITY PLAN FOR MOTORS	12
9	NTPC QUALITY PLAN	2
10	MOTOR DATASHEET A AND C (ANNEXURE-I)	6
11	ELECTRICAL LOAD DATA FORMAT (ANNEXURE-II)	1
12	CABLE SCHEDULE FORMAT (ANNEXURE-III)	1
13	TYPICAL DETAILS FOR CABLE TRAY AND ACCESSORIES (ANNEXURE-IV)	2



TITLE :
ELECTRICAL EQUIPMENT SPECIFICATION
FOR
LIME DOSING/FEEDING SYSTEM
KORBA STPP, STAGE-I,II & III

SPECIFICATION NO.
 VOLUME NO. :
 SECTION :
 REV NO. 00 : DATE : 23.05.2020
 SHEET : 2 OF 3

1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for LIME DOSING/FEEDING SYSTEM .
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:

Refer “Electrical Scope between BHEL and Vendor”.

3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID

- 3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder



TITLE :
ELECTRICAL EQUIPMENT SPECIFICATION
FOR
LIME DOSING/FEEDING SYSTEM
KORBA STPP, STAGE-I,II & III

SPECIFICATION NO.

VOLUME NO. :

SECTION :

REV NO. **00** : DATE : 23.05.2020

SHEET : 3 OF 3

furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate.

- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.

4.0 List of enclosures :

- a) Electrical scope between BHEL & vendor
- b) Customer (NTPC) specification for Motors
- c) Customer (NTPC) cabling spec (to be referred by vendor for their scope of work as per Electrical scope between BHEL & vendor).
- d) Quality plan for motors & NTPC quality plan.
- e) Datasheet A and C for LT Motors (Annexure-I)
- f) Electrical Load data format (Annexure –II)
- g) BHEL cable listing format (Annexure –III)
- h) Typical details for Cable Tray and accessories(Annexure-IV)

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGES: LIME DOSING/FEEDING SYSTEM

SCOPE OF VENDOR: SUPPLY & SUPERVISION OF ERECTION AND COMMISSIONING BY VENDOR

PROJECT: KORBA STPP STAGE-I,II & III

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	415 V Switchgear	BHEL	BHEL	For all LT motor & Auxiliary supply, 415 V AC (3 ph. 4 wire)/240 V AC (supply feeder) shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motor.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL BHEL BHEL	1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by Vendor.
4	Junction box for control & instrumentation cable	Vendor	BHEL	Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 10-12 mtrs) and trunk cable.
5	Any special type of cable like compensating, co-axial, prefab, MICC etc.	Vendor	BHEL	
6	Cable trays, accessories & cable trays supporting system 100/ 50 mm cable trays/ Conduits/ Galvanised steel cable troughs for local cabling	BHEL Vendor	BHEL BHEL	Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs, as per approved layout drawing during contract stage.
7	a. Cable glands b. Lugs and bimetallic strip for equipment supplied by Vendor	Vendor Vendor	BHEL BHEL	a. Double compression Ni-Cr plated brass cable glands b. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
8	Conduit and conduit accessories for cabling between equipment supplied by vendor	Vendor	BHEL	Conduits shall be medium duty, hot dip galvanised cold rolled mild steel rigid conduit as per IS: 9537.
9	Lighting	BHEL	BHEL	

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR**PACKAGES: LIME DOSING/FEEDING SYSTEM****SCOPE OF VENDOR: SUPPLY & SUPERVISION OF ERECTION AND COMMISSIONING BY VENDOR****PROJECT: KORBA STPP STAGE-I,II & III**

10	Equipment grounding (including electronic earthing) & lightning protection	BHEL	BHEL	
11	Below grade grounding	BHEL	BHEL	
12	LT Motors with base plate and foundation hardware.	Vendor	BHEL	Makes shall be subject to customer/ BHEL approval at contract stage.
13	Mandatory spares	Vendor	-	Vendor to quote as per specification.
14	Recommended O & M spares	Vendor	-	As specified elsewhere in specification
15	Any other equipment/ material/ service required for completeness of system based on system offered by the vendor (to ensure trouble free and efficient operation of the system).	Vendor	BHEL	
16	a) Input cable schedules (Control & Screened Control Cables) b) Cable interconnection details for above c) Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for Control and Instrumentation Cable and electronic earthing cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.
17	Electrical Equipment & cable tray layout drawings	-	-	Vendor to furnish drawing (both in print form as well as in AUTOCAD) of Lime Dosing/Feeding Building layout clearly indicating all motors, panels, JB's etc. which require cabling along with their terminal box/location/ Foundation etc.
18	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.
3. In case the requirement of Junction Box arises on account of Power Cable size mis-match due to vendor engineering at later stage, vendor shall supply the Junction Box for suitable termination.



SUB-SECTION-II-E2

MOTORS

**LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9**

CLAUSE NO.	TECHNICAL REQUIREMENTS			एन टी पी सी NTPC
	MOTORS			
1.00.00	GENERAL REQUIREMENTS			
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.			
1.02.00	All equipment's shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.			
1.03.00	Contactor shall provide fully compatible electrical system, equipment's, accessories and services.			
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.			
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.			
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for Contactors equipment and systems shall be under the Contactor scope.			
1.07.00	Degree of Protection			
	Degree of protection for various enclosures as per IEC60034-05 shall be as follows :-			
	i)	Indoor motors	-	IP 54
	ii)	Outdoor motors	-	IP 55
	iii)	Cable box-indoor area	-	IP 54
	iv)	Cable box-Outdoor area	-	IP 55
2.00.00	CODES AND STANDARDS			
	1)	Three phase induction motors	:	IS/IEC:60034
	2)	Single phase AC motors	:	IS/ IEC:60034
	3)	Crane duty motors	:	IS:3177, IS/IEC:60034
	4)	DC motors/generators	:	IS:4722, IS/IEC:60034
	5)	Energy Efficient motors	:	IS 12615, IEC:60034-30
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9		SUB SECTION-II-E2 MOTORS
PAGE 1 OF 9				

एनटीपीसी
NTPC

CLAUSE NO.	TECHNICAL REQUIREMENTS	एन टी पी सी NTPC	
6.01.01	For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.		
6.01.02	For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.		
6.01.03	For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.		
6.01.04	Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.		
6.02.00	Torque Requirements		
6.02.01	Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor rated torque.		
6.02.02	Pull out torque at rated voltage shall not be less than 205% of rated torque. It shall be 275% for crane duty motors.		
6.03.00	Starting voltage requirement (a) Up to 85% of rated voltage for ratings below 110 KW (b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW (c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW (d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW (e) Up to 75 % of rated voltage for ratings above 4000KW		
7.00.00	DESIGN AND CONSTRUCTIONAL FEATURES		
7.01.00	Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable.		
7.02.00	All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS:2148 as detailed below		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS
			PAGE 3 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS			
7.03.00	(a) Fuel oil area	:	Group – IIB	
	(b) Hydrogen generation	:	Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA /IEC60034)	
	Winding and Insulation			
	(a) Type	:	Non-hygroscopic, oil resistant, flame resistant	
	(b) Starting duty	:	Two hot starts in succession, with motor initially at normal running temperature.	
	(c) 11kV, 6.6 KV & 3.3 kV AC motors	:	Thermal class 155 (F) insulation. The winding insulation process shall be total Vacuum Pressure Impregnated i.e resin poor method. The lightning Impulse & interturn insulation surge withstand level shall be as per IEC-60034 part-15.	
	(d) 240VAC, 415V AC & 220V DC motors	:	Thermal Class (B) or better	
7.04.00	Motors rated above 1000KW shall have insulated bearings/housing to prevent flow of shaft currents.			
7.05.00	Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature.			
7.06.00	Noise level for all the motors shall be limited to 85 dB(A) except for BFP motor for which the maximum limit shall be 90dB(A). Vibration shall be limited within the limits prescribed in IS:12075 / IEC 60034-14 . Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.			
7.07.00	In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer and minimum 2 numbers duplex platinum resistance type temperature detectors.			
7.08.00	Motor body shall have two earthing points on opposite sides.			
7.09.00	11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.			
7.10.00	3.3/6.6 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Contractor shall provide termination kit for the offered Terminal box. The offered Terminal Box shall be			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9		SUB SECTION-II-E2 MOTORS
PAGE 4 OF 9				

CLAUSE NO.	TECHNICAL REQUIREMENTS			एन टी पी सी NTPC
	suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non magnetic material for single core cables) shall be provided.			
7.11.00	The spacing between gland plate & centre of bottom terminal stud shall be as per Table-I.			
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.			
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 6.6 KV, 3.3 kV /415V systems without any injurious effect on its life.			
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.			
7.15.00	The size and number of cables (for HT motors) to be intimated to the successful Contactor during detailed engineering and the Contactor shall provide terminal box suitable for the same.			
8.00.00	The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance):			
	(a)	From 50KW & upto 110KW	:	11.0
	(b)	From 110 KW & upto 200 KW	:	9.0
	(c)	Above 200 KW & upto 1000KW	:	10.0
	(d)	From 1001KW & upto 4000KW	:	9.0
	(e)	Above 4000KW	:	6 to 6.5
10.00.00	TYPE TEST			
10.01.00	HT MOTORS			
10.01.01	The Contactor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The Contactor shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the Employer's engineer.			
10.01.02	The type tests shall be carried out in presence of the Employer's representative, for which minimum 15 days notice shall be given by the Contactor. The Contactor shall obtain the Employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9		SUB SECTION-II-E2 MOTORS
PAGE 5 OF 9				

CLAUSE NO.	TECHNICAL REQUIREMENTS			एन टी पी सी NTPC
10.01.03	parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out. In case the Contactor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contactor.			
10.01.04	Further the Contactor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.			
10.01.05	LIST OF TYPE TESTS TO BE CONDUCTED The following type tests shall be conducted on each type and rating of HT motor (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test(subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp.,coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 6 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS			एन टी पी सी NTPC
10.01.06	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of HT motor (a) Degree of protection test for the enclosure followed by IR, HV and no load run test. (b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on inter-turn insulation shall be as per clause no. 4.2 of IEC 60034, part-15			
10.02.00	LT Motors			
10.02.01	LT Motors supplied shall be of type tested design. During detailed engineering, the Contactor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.			
10.02.02	However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.			
10.02.03	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of LT motor of above 100 KW only 1. Measurement of resistance of windings of stator and wound rotor. 2. No load test at rated voltage to determine input current power and speed 3. Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) 4. Full load test to determine efficiency power factor and slip 5. Temperature rise test			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 7 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS 
	6. Momentary excess torque test. 7. High voltage test 8. Test for vibration severity of motor. 9. Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section) 10. Test for degree of protection and 11. Overspeed test. 12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1 10.03.00 All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price. 10.04.00 The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9
SUB SECTION-II-E2 MOTORS	PAGE 8 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS			एन टी पी सी NTPC
	TABLE - I			
	DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS			
	Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm		
	UP to 3 KW	As per manufacturer's practice.		
	Above 3 KW - upto 7 KW	85		
	Above 7 KW - upto 13 KW	115		
	Above 13 KW - upto 24 KW	167		
	Above 24 KW - upto 37 KW	196		
	Above 37 KW - upto 55 KW	249		
	Above 55 KW - upto 90 KW	277		
	Above 90 KW - upto 125 KW	331		
	Above 125 KW-upto 200 KW	385/203 (For Single core cables only)		
	For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm.			
	PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE:			
	NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows:			
Motor MCR in KW	Clearance			
UP to 110 KW	10mm			
Above 110 KW and upto 150 KW	12.5mm			
Above 150 KW	19mm			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 9 OF 9

963437/2022/PS-PEM-MAX:



GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.

PE-SS-999-506-E101

VOLUME NO. : **II-B**SECTION : **D**REV NO. : **00** DATE : 29/08/2005

SHEET : 1 OF 1

GENERAL TECHNICAL REQUIREMENTS**FOR****LV MOTORS****SPECIFICATION NO.: PE-SS-999-506-E101 Rev 00**

2022/PS-PEM-11-MAX : 07/2025 (11)		SPECIFICATION NO. PE-SS-999-506-E101	
 GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS		VOLUME NO. : II-B	
		SECTION : D	
		REV NO. : 00 DATE : 29/08/2005	
		SHEET : 1 OF 4	

1.0

INTENT OF SPECIFIATION

The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer’s work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station.

Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.

2.0

CODES AND STANDARDS

Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards:

IS:325	Three phase Induction motors
IS : 900	Code of practice for installation and maintenance of induction motors
IS: 996	Single phase small AC and universal motors
IS: 4722	Rotating Electrical machines
IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines
IS: 4728	Terminal marking and direction of rotation rotating electrical machines
IS: 1231	Dimensions of three phase foot mounted induction motors
IS: 8789	Values of performance characteristics for three phase induction motors
IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment
IS: 2148	Flame proof enclosures for electrical appliance
IS: 5571	Guide for selection of electrical equipment for hazardous areas
IS: 12824	Type of duty and classes of rating assigned
IS: 12802	Temperature rise measurement for rotating electrical machnines
IS: 12065	Permissible limits of noise level for rotating electrical machines
IS: 12075	Mechanical vibration of rotating electrical machines

In case of imported motors, motors as per IEC-34 shall also be acceptable.

3.0

DESIGN REQUIREMENTS

3.1

Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A

3.2

Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information
Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.

3.3

Starting Requirements

3.3.1

Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.

3.3.2

Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 2 OF 4
The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors. 3.3.3 The following frequency of starts shall apply i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature. ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour) iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor 3.4 Running Requirements 3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor. 3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs. 3.5 Stress During bus Transfer 3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer. 3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition. 3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065. 3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075. 4.0 CONSTRUCTIONAL FEATURES 4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy 4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362. Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled 4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.		

2022/PS-PEM-MAX: 07/05/17		SPECIFICATION NO. PE-SS-999-506-E101	
	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	VOLUME NO. : II-B	
		SECTION : D	
		REV NO. : 00 DATE : 29/08/2005	
		SHEET : 3 OF 4	
4.4.	Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.		
4.5	Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.		
4.6	In case Class ‘F’ insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class ‘B’ insulation. In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.		
4.7	Terminals and Terminal Boxes		
4.7.1	Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A. Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet “A”.		
4.7.2	unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.		
4.7.3	Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.		
4.7.4	Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.		
4.7.5	Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.		
4.7.6	Degree of protection for terminal boxes shall be IP 55 as per IS 4691.		
4.7.7	Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.		
4.7.8.	Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.		
4.7.9	Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.		
4.8	Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.		
4.9	General		

963437/2022/PS-PEM-MAX:

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101 VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 29/08/2005 SHEET : 4 OF 4
	4.9.1 Motors provided for similar drives shall be interchangeable. 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors. 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above. 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956. 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz. 4.9.6 Name plate with all particulars as per IS: 325 shall be provided 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions. 5.0 INSPECTION AND TESTING 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied. 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser. 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan. 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A. 6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT a) OGA drawing showing the position of terminal boxes, earthing connections etc. b) Arrangement drawing of terminal boxes. c) Characteristic curves: (To be given for motor above 55 kW unless otherwise specified in Data Sheet). i) Current vs. time at rated voltage and minimum starting voltage. ii) Speed vs. time at rated voltage and minimum starting voltage. iii) Torque vs. speed at rated voltage and minimum voltage. For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling. iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.	



SUB-SECTION-II-E6

~~CABLING-EARTHING & LIGHTNING PROTECTION~~

**LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9**

CLAUSE NO.	TECHNICAL REQUIREMENTS																																											
1.00.00	CODES AND STANDARDS																																											
1.01.00	All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions as on date of opening of bid. In case of conflict between this specification and those (IS codes, standards, etc.) referred to herein, the former shall prevail. All work shall be carried out as per the following standards/ codes as applicable . <table><tr><td>IS:513</td><td>Cold rolled low carbon steel sheets and strips.</td></tr><tr><td>IS:802</td><td>Code of practice for the use of Structural Steel in Overhead Transmission Line Towers.</td></tr><tr><td>IS:1079</td><td>Hot Rolled carbon steel sheet & strips</td></tr><tr><td>IS:1239</td><td>Mild steel tubes, tubulars and other wrought steel fittings</td></tr><tr><td>IS:1255</td><td>Code of practice for installation and maintenance of power cables upto and including 33 KV rating</td></tr><tr><td>IS:1367 Part-13</td><td>Technical supply conditions for threaded Steel fasteners. (Hot dip galvanized coatings on threaded fasteners).</td></tr><tr><td>IS:2147</td><td>Degree of protection provided by enclosures for low voltage switchgear and control gear</td></tr><tr><td>IS:2309</td><td>Code of Practice for the protection of building and allied structures against lightning.</td></tr><tr><td>IS:2629</td><td>Recommended practice for hot dip galvanising of iron & steel</td></tr><tr><td>IS:2633</td><td>Method for testing uniformity of coating on zinc coated articles.</td></tr><tr><td>IS:3043</td><td>Code of practice for Earthing</td></tr><tr><td>IS:3063</td><td>Fasteners single coil rectangular section spring washers.</td></tr><tr><td>IS:6745</td><td>Methods for determination of mass of zinc coating on zinc coated iron & steel articles.</td></tr><tr><td>IS:8308</td><td>Compression type tubular in- line connectors for aluminium conductors of insulated cables</td></tr><tr><td>IS:8309</td><td>Compression type tubular terminal ends for aluminium conductors of insulated cables.</td></tr><tr><td>IS:9537</td><td>Conduits for electrical installation.</td></tr><tr><td>IS:9595</td><td>Metal - arc welding of carbon and carbon manganese steels - recommendations.</td></tr><tr><td>IS:13573</td><td>Joints and terminations for polymeric cables.</td></tr><tr><td>BS:476</td><td>Fire tests on building materials and structures</td></tr><tr><td>IEEE:80</td><td>IEEE guide for safety in AC substation grounding</td></tr></table>				IS:513	Cold rolled low carbon steel sheets and strips.	IS:802	Code of practice for the use of Structural Steel in Overhead Transmission Line Towers.	IS:1079	Hot Rolled carbon steel sheet & strips	IS:1239	Mild steel tubes, tubulars and other wrought steel fittings	IS:1255	Code of practice for installation and maintenance of power cables upto and including 33 KV rating	IS:1367 Part-13	Technical supply conditions for threaded Steel fasteners. (Hot dip galvanized coatings on threaded fasteners).	IS:2147	Degree of protection provided by enclosures for low voltage switchgear and control gear	IS:2309	Code of Practice for the protection of building and allied structures against lightning.	IS:2629	Recommended practice for hot dip galvanising of iron & steel	IS:2633	Method for testing uniformity of coating on zinc coated articles.	IS:3043	Code of practice for Earthing	IS:3063	Fasteners single coil rectangular section spring washers.	IS:6745	Methods for determination of mass of zinc coating on zinc coated iron & steel articles.	IS:8308	Compression type tubular in- line connectors for aluminium conductors of insulated cables	IS:8309	Compression type tubular terminal ends for aluminium conductors of insulated cables.	IS:9537	Conduits for electrical installation.	IS:9595	Metal - arc welding of carbon and carbon manganese steels - recommendations.	IS:13573	Joints and terminations for polymeric cables.	BS:476	Fire tests on building materials and structures	IEEE:80	IEEE guide for safety in AC substation grounding
IS:513	Cold rolled low carbon steel sheets and strips.																																											
IS:802	Code of practice for the use of Structural Steel in Overhead Transmission Line Towers.																																											
IS:1079	Hot Rolled carbon steel sheet & strips																																											
IS:1239	Mild steel tubes, tubulars and other wrought steel fittings																																											
IS:1255	Code of practice for installation and maintenance of power cables upto and including 33 KV rating																																											
IS:1367 Part-13	Technical supply conditions for threaded Steel fasteners. (Hot dip galvanized coatings on threaded fasteners).																																											
IS:2147	Degree of protection provided by enclosures for low voltage switchgear and control gear																																											
IS:2309	Code of Practice for the protection of building and allied structures against lightning.																																											
IS:2629	Recommended practice for hot dip galvanising of iron & steel																																											
IS:2633	Method for testing uniformity of coating on zinc coated articles.																																											
IS:3043	Code of practice for Earthing																																											
IS:3063	Fasteners single coil rectangular section spring washers.																																											
IS:6745	Methods for determination of mass of zinc coating on zinc coated iron & steel articles.																																											
IS:8308	Compression type tubular in- line connectors for aluminium conductors of insulated cables																																											
IS:8309	Compression type tubular terminal ends for aluminium conductors of insulated cables.																																											
IS:9537	Conduits for electrical installation.																																											
IS:9595	Metal - arc welding of carbon and carbon manganese steels - recommendations.																																											
IS:13573	Joints and terminations for polymeric cables.																																											
BS:476	Fire tests on building materials and structures																																											
IEEE:80	IEEE guide for safety in AC substation grounding																																											
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 1 of 23																																								

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	IEEE:142	Grounding of Industrial & commercial power systems	
	DIN 46267 (Part-II)	Non tension proof compression joints for Aluminium conductors.	
	DIN 46329	Cable lugs for compression connections, ring type ,for Aluminium conductors	
	BS:6121	Specification for mechanical Cable glands for elastomers and plastic insulated cables.	
		Indian Electricity Act.	
		Indian Electricity Rules.	
1.02.00	Equipment complying with other internationally accepted standards such as IEC, BS, DIN, USA, VDE, NEMA etc. will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate the standard(s) adopted, furnish a copy in English of the latest revision of the standards alongwith copies of all official amendments and revisions in force as on date of opening of bid and shall clearly bring out the salient features for comparison.		
2.00.00	DESIGN AND CONSTRUCTIONAL FEATURE		
2.01.00	Inter Plant Cabling		
2.01.01	Interplant cabling for main routes shall be laid along overhead trestles/duct banks. Cables from main plant to switchyard control room shall be laid in overhead trestles or duct bank. In case of Duct banks, pull-pits shall be filled with sand and provided with a PCC covering. Directly buried cables, if essential, shall not have concentration of more than 4 cables in one route. Cables crossing Railway line (if applicable) shall be laid underground through nearest culvert. Necessary statutory clearance if required shall be taken by Bidder. All HT,LT and control cable shall be armoured.		
2.01.02	Transformer yard In transformer yard cables shall be laid in overhead trestle. The main cable routes coming out from Main plant building and crossing the Transformer yard shall be laid in overhead trestles. In transformer yard, trestle height for rail/road crossing shall be suitable for movement of Generator Transformer with bushing.		
2.01.03	Trenches PCC flooring of built up trenches shall be sloped for effective drainage with sump pits and sump pumps.		
2.01.04	No sub zero level cable vault/trenches shall be provided below control building/switchgear rooms in main plant.		
2.01.05	Cable Vault The cable vault/ / cable spreader room space below the HT / LT switchgear room, Control Rooms, unit control equipment room, Programmer room, UPS, Charger & Battery Rooms, shall have 800 mm wide and 2.1 m high movement passage all around the cable trays in the cable vault/ cable spreader room for easy laying/maintenance of cables Cable vaults shall be provided with adequate drainage facilities for drainage of fire water.		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
Page 2 of 23			

एनटीपीसी
NTPC

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	galvanised as per Clause No. 3.13.00 of this chapter. Troughs shall be standard width of 50 mm & 75 mm with depth of 25 mm.			
3.01.05	The tolerance for cable tray and accessories shall be as per IS 2102 (Part-1). Tolerance Class: - Coarse			
3.02.00	Support System for Cable Trays			
3.02.01	Cable tray support system shall be pre-fabricated out of single sheet as per enclosed tender drawings.			
3.02.02	Support system for cable trays shall essentially comprise of the two components i.e. main support channel and cantilever arms. The main support channel shall be of two types : (i) C1:- having provision of supporting cable trays on one side and (ii) C2:-having provision of supporting cable trays on both sides. The support system shall be the type described hereunder a. Cable supporting steel work for cable racks/cables shall comprise of various channel sections, cantilever arms, various brackets, clamps, floor plates, all hardwares such as lock washers, hexagon nuts, hexagon head bolt, support hooks, stud nuts, hexagon head screw, channel nut, channel nut with springs, fixing studs, etc. b. The system shall be designed such that it allows easy assembly at site by using bolting. All cable supporting steel work, hardwares fittings and accessories shall be prefabricated factory galvanised. c. The main support and cantilever arms shall be fixed at site using necessary brackets, clamps, fittings, bolts, nuts and other hardware etc. to form various arrangements required to support the cable trays. Welding of the components shall not be allowed. However, welding of the bracket (to which the main support channel is bolted) to the overhead beams, structural steel, insert plates or reinforcement bars will be permitted. Any cutting or welding of the galvanised surface shall be brushed and red lead primer, oil primer & aluminium paint shall be applied d. All steel components, accessories, fittings and hardware shall be hot dip galvanised after completing welding, cutting, drilling and other machining operation. e. The typical arrangement of flexible support system is shown in the enclosed drawings and described briefly below: The main support channel and cantilever arms shall be fabricated out of 2.5 thick rolled steel sheet conforming to IS 1079. f. Cantilever arms of 320 mm, 620mm and 750 mm in length are required, and shall be as shown in the enclosed drawing. The arm portion shall be suitable for assembling the complete arm assembly on to component constructed of standard channel section. The back plate shall allow sufficient clearance for fixing bolt to be tightened with tray in position. g. Support system shall be able to withstand - weight of the cable trays - weight of the cables (75 Kg/Metre run of each cable tray) - Concentrated load of 75 Kg between every support span. - Factor of safety of minimum 1.5 shall be considered.			
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 4 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.02.03	The size of structural steel members or thickness of sheet steel of main support channel and cantilever arms and other accessories as indicated above or in the enclosed drawings are indicative only. Nevertheless, the support system shall be designed by the bidder to fully meet the requirements of type tests as specified. In case the system fails in the tests, the components design modification shall be done by the Bidder without any additional cost to the Employer. The bidder shall submit the detailed drawings of the system offered by him alongwith the bid.			
3.02.04	Four legged structure shall be provided wherever there is change in elevation and change in direction			
3.02.05	FOR COAL HANDLING PLANT/FGD PLANT AREA THE FOLLOWING SHALL ALSO BE APPLICABLE:			
	a) All overhead cable routes shall be along the route of the conveyor gallery on separate supporting structures and cables shall be laid in vertical trays. The bottom of the steel shall be such that the existing facilities, movement of trucks/human beings etc. does not get affected. The cable trestle shall have a minimum 600mm clear walk way and shall have maintenance platforms as required. The bottom of the steel supporting structure shall be generally at 3.0M above the grade level except for rail/road crossings where it shall be at 8.0M above grade level. Tap offs from the overhead cable trestle can be through shallow trenches with prior approval of the Employer. Directly buried cable, if essential, shall not have concentration of more than 4 cables on one route. b) Cable trenches shall be provided only in Switchgear/MCC rooms. c) Cables shall not be routed through the conveyor galleries except for the equipment located in the conveyor galleries for a particular conveyor i.e. protection switches, receptacles etc. d) Cables for PCS and BSS shall be routed along the conveyors through GI conduits.			
3.03.00	Pipes, Fittings & Accessories			
3.03.01	Pipes offered shall be complete with fittings and accessories (like tees, elbows, bends, check nuts, bushings, reducers, enlargers, coupling caps, nipples etc.) The size of the pipe shall be selected on the basis of maximum 40% fill criteria			
3.03.02	GI Pipes shall be of medium duty as per IS: 1239			
3.03.03	Duct banks shall be High Density PE pipes encased in PCC (10% spare of each size, subject to minimum one) with suitable water-proof manholes.			
3.03.04	Hume pipes shall be NP3 type as per IS 458.			
3.03.05	TERNE Coated Flexible Steel Conduits shall be water proof and rust proof made of heat resistant lead coated steel. Conduit diameter shall be uniform throughout its length. Internal surface of the conduit shall be free from burrs and sharp edges. Conduits shall be complete with necessary accessories for proper termination of the conduit with junction boxes and lighting fixtures			
3.03.06	HDPE pipes and conduits shall be PE-80, PN-10 type as per IS 4984/IS 8008 part-I.			
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 5 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.04.00	Junction Boxes			
3.04.01	Junction box shall be made of Fire retardant material. Material of JB shall be Thermoplastic or thermosetting or FRP type. The box shall be provided with the terminal blocks, mounting bracket and screws etc. The cable entry shall be through galvanized steel conduits of suitable diameter. The JB shall have suitable for installing glands of suitable size on the bottom of the box. The JB shall be suitable for surface mounting on ceiling/structures. The JB shall be of grey color RAL 7035. All the metal parts shall be corrosion protected. Junction box surface should be such that it is free from crazings, blisterings, wrinkling, colour blots/striations. There should not be any mending or repair of surface. JB's will be provided with captive screws so that screws don't fall off when cover is opened. JB's mounting brackets should be of powder coated MS. Type test reports for the following tests shall be furnished:- (a) Impact resistance for impact energy of 2 Joules (IK07)as per BS EN50102 (b) Thermal ageing at 70deg C for 96 hours as per IEC60068-2-2Bb. (c) Class of protection shall be IP 55. (d) HV test.			
3.04.02	Terminal blocks shall be 1100V grade, of suitable current rating, made up of unbreakable polyamide 6.6 grade. The terminals shall be screw type or screw-less (spring loaded) / cage clamp type with lugs. Marking on terminal strips shall correspond to the terminal numbering in wiring diagrams. All metal parts shall be of non-ferrous material. In case of screw type terminals the screw shall be captive, preferably with screw locking design. All terminal blocks shall be suitable for terminating on each side the required cables/wire size. All internal wiring shall be of cu. Conductor PVC wire.			
3.05.00	Terminations & Straight Through Joints			
3.05.01	Termination and jointing kits for 33kV, 11 kV, 6.6 KV and 3.3 kV grade XLPE insulated cables shall be of proven design and make which have already been extensively used and type tested. Termination kits and jointing kits shall be Pre-moulded type or heat shrinkable type. Further Cold shrinkable type termination and jointing kits are also acceptable. The Cold shrinkable type kits shall be type tested as per relevant standards. Calculation to withstand the required fault level shall also be furnished in case of cold shrinkable type kits. 33 kV, 11 kV, 6.6 KV and 3.3kV grade joints and terminations shall be type tested and Type test reports as per IS:13573 Part-II and IEC60502 shall be furnished. Also, heat shrink material shall comply with requirements of ESI 09-13 (external tests). Critical components used in cable accessories shall be of tested and proven quality as per relevant product specification/ESI specification. Cable joints and terminations should be with FRLS properties as per IEC 60754-1&2. Kit contents shall be supplied from the same source as were used for type testing. The kit shall be complete with the tinned copper solderless crimping type cable lugs & ferrule or mechanical connectors (wherein bolts are tightened that shear off at an appropriate torque) as per DIN standard suitable for aluminium compacted conductor cables. (Tender drg. no 0000-211-POE –A-51-RA of cable lug attached at the end of this chapter).			
3.05.02	Straight through joint and termination shall be capable of withstanding the fault level of 21 KA for 0.12 Sec. with dynamic peak of 52 KA for 33 KV system & of 40 kA for 0.12 sec with a dynamic peak of 100 kA for 11 kV, 6.6 KV & 3.3 KV system. Straight through joints shall have provisions for shield connection and earthing wherever required and complete with all accessories and consumables suitable for storage without deterioration at a temperature of 50 deg. C with shelf life of more than five years. 1.1 kV grade straight through joints shall also be of proven design			
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 6 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS		
3.05.03	1.1 KV grade Straight Through Joint shall be of proven design.		
3.06.00	Cable glands		
3.06.01	Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.		
3.07.00	Cable lugs/ferrules		
3.07.01	Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to IS/DIN standards.		
3.08.00	Trefoil clamps		
3.08.01	Trefoil clamps for single core cables shall be pressure die cast aluminum or fibre glass or nylon and shall include necessary fixing accessories like G.I. nuts, bolts, washers, etc. Trefoil clamps shall have adequate mechanical strength, when installed at 1 mtr intervals, to withstand the forces generated by the peak value of maximum system short circuit current.		
3.09.00	Cable Clamps & Ties		
3.09.01	The cable clamps/ties required to clamp multicore cables shall be of SS-316 material, 12mm wide, polyster coated ladder lock type. The clamps/ties shall have self locking arrangement & shall have sufficient strength. The cable clamps/ties shall be supplied in finished individual pieces of suitable length to meet the site requirements.		
3.10.00	Receptacles		
3.10.01	Receptacles boxes shall be fabricated out of MS sheet of 2mm thickness and hot dipped gavanised or of die-cast aluminium alloy of thickness not less than 2.5 mm. The boxes shall be provided with two nos. earthing terminals, gasket to achieve IP55 degree of protection, terminal blocks for loop-in loop-out for cable of specified sizes, mounting brackets suitable for surface mounting on wall/column/structure, gland plate etc. The ON-OFF switch shall be rotary type heavy duty, double break,AC23 category, suitable for AC supply. Plug and Socket shall be shrouded Die-cast aluminium. Socket shall be provided with lid safety cover. Robust mechanical interlock shall be provided such that the switch can be put ON only when the plug is fully engaged and plug can be withdrawn only when the switch is in OFF position. Also cover can be opened only when the switch is in OFF position. Wiring shall be carried out with 1100 V grade PVC insulated stranded aluminium/copper wire of adequate size. The Terminal blocks shall be of 1100 V grade. The Terminal blocks shall be of 1100 V grade made up of unbreakable polyimide 6.6 grade with adequate current rating and size. The welding receptacles shall be provided with RCCB/RCD of 30mA sensitivity having facility for manual testing/checking of operation of RCCB/RCD.		
3.11.00	Cable Drum Lifting Jack The jack for cable drum lifting shall be of screw type with 10 ton capacity. The cable drum jacks shall be manufactured from fabricated steel. The spindles supplied with the cable drum jack shall be manufactured using BSEN-24 grade steel bar with locking collars. Jack		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
			Page 7 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	nests shall be of SG cast steel. Cable drum jack supplied shall have undergone load testing and reports for the same shall be submitted. At least Two Nos. of jacks shall be supplied for NTPC use. Contractor has to make arrangements for his own jacks for cable reeling/unreeling under his scope of installation.		
3.12.00	Galvanising		
3.12.01	Galvanising of steel components and accessories shall conform to IS:2629 , IS4759 & IS:2633. Additionally galvanising shall be uniform, clean smooth, continuous and free from acid spots.		
3.12.02	The amount of zinc deposit over threaded portion of bolts, nuts, screws and washers shall be as per IS:1367 . The removal of extra zinc on threaded portion of components shall be carefully done to ensure that the threads shall have the required zinc coating on them as specified		
3.13.00	Welding		
3.13.01	The welding shall be carried out in accordance with IS:9595. All welding procedures and welders qualification shall also be followed strictly in line with IS:9595		
4.00.00	INSTALLATION		
4.01.00	Cable tray and Support System Installation		
4.01.01	Cables shall run in cable trays mounted horizontally or vertically on cable tray support system which in turn shall be supported from floor, ceiling, overhead structures, trestles, pipe racks, trenches or other building structures.		
4.01.02	Horizontally running cable trays shall be clamped by bolting to cantilever arms and vertically running cable trays shall be bolted to main support channel by suitable bracket/clamps on both top and bottom side rails at an interval of 2000 mm in general. For vertical cable risers/shafts cable trays shall be supported at an interval of 1000mm in general. Fixing of cable trays to cantilever arms or main support channel by welding shall not be accepted. Cable tray installation shall generally be carried out as per the approved guidelines/ drawings. Vendor shall design the support system along with tray, spacing etc in line with tray loadings/drawings.		
4.01.03	The cantilever arms shall be positioned on the main support channel with a minimum vertical spacing of 300 mm unless otherwise indicated.		
4.01.04	The contractor shall fix the brackets/ clamps/ insert plates using anchor fasteners. Minimum size of anchor fasteners shall be M 8 X 50 and material shall be stainless steel grade 316 or better. Anchor fastener shall be fixed as recommended by manufacturer and as approved by site engineer. For brick wall suitable anchor fasteners shall be used as per the recommendations of manufacturer. Make of anchor fasteners subject to QA approval and the same shall be finalized at pre-award stage.		
4.01.05	All cable way sections shall have identification, designations as per cable way layout drawings and painted/stenciled at each end of cable way and where there is a branch connection to another cable way. Minimum height of letter shall be not less than 75 mm. For long lengths of trays, the identification shall be painted at every 10 meter. Risers shall additionally be painted/stenciled with identification numbers at every floor.		
4.01.06	In certain cases it may be necessary to site fabricate portions of trays, supports and other non standard bends where the normal prefabricated trays, supports and accessories may not be suitable. Fabricated sections of trays, supports and accessories to make the		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
			Page 8 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS													
	installation complete at site shall be neat in appearance and shall match with the prefabricated sections in the dimensions. They shall be applied with one coat of red lead primer, one coat of oil primer followed by two finishing coats of aluminium paint.													
4.02.00	Conduits/Pipes/Ducts Installation													
4.02.01	The Contractor shall ensure for properly embedding conduit pipe sleeves wherever necessary for cabling work. All openings in the floor/roof/wall / cable tunnel/cable trenches made for conduit installation shall be sealed and made water proof by the Contractor.													
4.02.02	GI pull wire of adequate size shall be laid in all conduits before installation. Metallic conduit runs at termination shall have two lock nuts wherever required for junction boxes etc.													
4.02.03	Conduit runs/sleeves shall be provided with PVC bushings having round edge at each end. All conduits/pipes shall have their ends closed by caps until cables are pulled. After cables are pulled, the ends of conduits/pipes shall be sealed with Glass wool/Cement Mortar/Putty to prevent entrance of moisture and foreign material													
4.02.04	Exposed conduit/pipe shall be adequately supported by racks, clamps, straps or by other approved means. Conduits /pipe support shall be installed square and true to line and grade with an average spacing between the supports as given below, unless specified otherwise <table><tr><th>Conduit /pipe size (dia).</th><th>Spacing</th></tr><tr><td>Upto 40 mm</td><td>1 M</td></tr><tr><td>50 mm</td><td>2.0 M</td></tr><tr><td>65-85 mm</td><td>2.5 M</td></tr><tr><td>100 mm and above</td><td>3.0 M</td></tr></table>				Conduit /pipe size (dia).	Spacing	Upto 40 mm	1 M	50 mm	2.0 M	65-85 mm	2.5 M	100 mm and above	3.0 M
Conduit /pipe size (dia).	Spacing													
Upto 40 mm	1 M													
50 mm	2.0 M													
65-85 mm	2.5 M													
100 mm and above	3.0 M													
4.02.05	For bending of conduits, bending machine shall be arranged at site by the contractor to facilitate cold bending. The bends formed shall be smooth.													
4.03.00	Junction Boxes Installation													
4.03.01	Junction boxes shall be mounted at a height of 1200mm above floor level or as specified in the drawings and shall be adequately supported/mounted on masonry wall by means of anchor fasteners/ expandable bolts or shall be mounted on an angle, plate or other structural supports fixed to floor, wall, ceiling or equipment foundations.													
4.04.00	Cable Installation													
4.04.01	Cable installation shall be carried out as per IS:1255 and other applicable standards.													
4.04.02	For Cable unloading, pulling etc following guidelines shall be followed in general: a) Cable drums shall be unloaded, handled and stored in an approved manner on hard and well drained surface so that they may not sink. In no case shall be drum be stored flat i.e. with flange horizontal. Rolling of drums shall be avoided as far as possible. For short distances, the drums may be rolled provided they are rolled slowly and in proper direction as marked on the drum. In absence of any indication, the drums may be rolled in the same direction as it was rolled during taking up the cables. For unreeling the cable, the drum shall be mounted on suitable jacks or on cable wheels and shall be rolled slowly so that cable comes out over the drum and not from below. All possible care shall be taken during unreeling and laying to avoid													
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 9 of 23										

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	damage due to twist, kink or sharp bends. Cable ends shall be provided with sealed plastic caps to prevent damage and ingress of moisture. b) While laying cable, ground rollers shall be used at every 2 meter interval to avoid cable touching ground. The cables shall be pushed over the rollers by a gang of people positioned in between the rollers. Cables shall not be pulled from the end without having intermediate pushing arrangements. Pulling tension shall not exceed the values recommended by cable manufacturer. Selection of cable drums for each run shall be so planned so as to avoid using straight through joints. Care should be taken while laying the cables so as to avoid damage to cables. If any particular cable is damaged, the same shall be repaired or changed to the satisfaction of Project Manager.		
4.04.03	Cables shall be laid on cable trays strictly in line with cable schedule		
4.04.04	Power and control cables shall be laid on separate tiers inline with the approved guidelines/drawings. The laying of different voltage grade cables shall be on different tiers according to the voltage grade of the cables. In horizontal tray stacks, H.T. cables shall be laid on top most tier and cables of subsequent lower voltage grades on lower tiers of trays. Single core cable in trefoil formation shall be laid with a distance of four times the diameter of cable between trefoil center lines and clamped at every two metre. All multicore cables shall be laid in touching formation. Power and control cables shall be secured fixed to trays/support with cable clamps/ties with self locking arrangement. For horizontal trays arrangements, multicore power cables and control cables shall be secured at every five meter interval. For vertical tray arrangement, individual multicore power cables and control cables shall be secured at every one meter. After completion of cable laying work in the particular vertical tray, all the control cables shall be binded to trays/supports by cable clamps/ties with self locking arrangement at every five meter interval and at every bend. Fibre Optical cable shall be laid in trenches/trays or as decided by Employer.		
4.04.05	Bending radii for cables shall be as per manufacturer's recommendations and IS:1255.		
4.04.06	Where cables cross roads/rail tracks, the cables shall be laid in hume pipe/ HDPE pipe.		
4.04.07	No joints shall be allowed in trip circuits, protection circuits and CT/PT circuits. Also joints in critical equipment in main plant area shall not be permitted. Vendor shall identify and accordingly procure the cable drum length.		
4.04.08	In each cable run some extra length shall be kept at suitable point to enable one LT/two HT straight through joints to made, should the cable develop fault at a later stage. Control cable termination inside equipment enclosure shall have sufficient lengths so that shifting of termination in terminal blocks can be done without requiring any splicing.		
4.04.09	Wherever few cables are branching out from main trunk route troughs shall be used.		
4.04.10	Wind loading shall be considered for designing support as well Cable trays wherever required.		
4.04.11	Where there is a considerable risk of steam, hot oil or mechanical damage cable routes shall be protected by barriers or enclosures.		
4.04.12	The installation work shall be carried out in a neat workman like manner & areas of work shall be cleaned of all scraps, water, etc. after the completion of work in each area every day. Contractor shall replace RCC/Steel trench covers after the Installation work in that particular area is completed or when further work is not likely to be taken up for some time.		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
			Page 10 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS		
4.04.13	Separation		
	At least 300mm clearance shall be provided between:		
	- HT power & LT power cables,		
	- LT power & LT control/instrumentation cables,		
4.04.14	Segregation		
	1) Segregation means physical isolation to prevent fire jumping.		
	2) All cables associated with the unit shall be segregated from cables of other units.		
	3) Interplant cables of station auxiliaries and unit critical drives shall be segregated in such a way that not more than half of the drives are lost in case of single incident of fire. Power and control cables for AC drives and corresponding emergency AC or DC drives shall be laid in segregated routes. Cable routes for one set of auxiliaries of same unit shall be segregated from the other set.		
	4) In switchyard, control cables of each bay shall be laid on separate racks/trays.		
4.04.15	Minimum number of spare cores required to be left for interconnection in control cables shall be as follows:		
	Minimum number of spare cores required to be left for interconnection in control cables shall be as follows:		
	No. of cores in cable	No. of spare cores	
	2C,3C	NIL	
	5C	1	
	7C-10C	2	
	14C and above	3	
4.04.16	Directly Buried Cables		
	a) Cable trenches shall be constructed for directly buried cables. Construction of cable trench for cables shall include excavation, preparation of sieved sand bedding, riddled soil cover, supply and installation of brick or concrete protective covers, back filling and compacting, supply and installation of route markers and joint markers. Laying of cables and providing protective covering shall be as per IS:1255 and the enclosed drawings showing cabling details.		
	b) RCC cable route and RCC joint markers shall be provided wherever required. The voltage grade of the higher voltage cables in route shall be engraved on the marker. Location of underground cable joints shall be indicated with cable marker with an additional inscription "Cable Joint". The marker shall project 150 mm above ground and shall be spaced at an interval of 30 meters and at every change in direction. They shall be located on both sides of road crossings and drain crossings. Top of cable marker/joint marker shall be sloped to avoid accumulation of water/dust on marker.		
4.04.17	Cable tags shall be provided on all cables at each end (just before entering the equipment enclosure), on both sides of a wall or floor crossing, on each duct/conduit entry, and at		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
			Page 11 of 23

CLAUSE NO.	TECHNICAL REQUIREMENTS	एन टी पी सी NTPC	
	every 20 meters in cable tray/trench runs. Cable tags shall also be provided inside the switchgear, motor control centers, control and relay panels etc. where a number of cables enter together through a gland plate. Cable tag shall be of rectangular shape for power cables and control cables. Cable tag shall be of 2 mm thick aluminum with number punched on it and securely attached to the cable by not less than two turns of 20 SWG GI wire conforming to IS:280. Alternatively, the Contractor may also provide cable tags made of nylon, cable marking ties with cable number heat stamped on the cable tags. The cable tag requirements mentioned above shall prevail over Tag requirements mentioned elsewhere in this document for HT power, LT power & control cables.		
4.04.18	While crossing the floors, unarmoured cables shall be protected in conduits upto a height of 500 mm from floor level if not laid in tray.		
4.05.00	Cable Terminations & Connections		
4.05.01	The termination and connection of cables shall be done strictly in accordance with cable termination kit manufacturer" instructions, drawings and/or as directed by Project Manager. Cable jointer shall be qualified to carryout satisfactory cable jointing/termination. Contractor shall furnish for review documentary evidence/experience reports of the jointers to be deployed at site.		
4.05.02	Work shall include all clamps, fittings etc. and clamping, fitting, fixing, plumbing, soldering, drilling, cutting, taping, preparation of cable end, crimping of lug, insulated sleeving over control cable lugs, heat shrinking (where applicable), connecting to cable terminal, shorting and grounding as required to complete the job to the satisfaction of the Project Manager.		
4.05.03	The equipment will be generally provided with undrilled gland plates for cables/conduit entry. The Contractor shall be responsible for punching of gland plates, painting and touching up. Holes shall not be made by gas cutting. The holes shall be true in shape. All cable entry points shall be sealed and made vermin and dust proof. Unused openings shall be effectively sealed by 2mm thick aluminium sheets.		
4.05.04	Control cable cores entering control panel/switchgear/MCC/miscellaneous panels shall be neatly bunched, clamped and tied with self locking type nylon cable ties with de interlocking facility to keep them in position.		
4.05.05	All the cores of the control cable to be terminated shall have identification by providing ferrules at either end of the core, each ferrule shall be indelible, printed single tube ferrule and shall include the complete wire number and TB number as per the drawings. The ferrule shall fit tightly on the core. Spare cores shall have similar ferrules with suffix sp1, sp2, ---etc along with cable numbers and coiled up after end sealing.		
4.05.06	All cable terminations shall be appropriately tightened to ensure secure and reliable connections.		
5.00.00	EARTHING SYSTEM		
5.01.00	Earthing system shall be in strict accordance with IS:3043 and Indian Electricity Rules/Acts The earthing system shall be designed for a life expectancy of at least forty (40) years, for a system fault current of 50 kA for 1.0 sec. The minimum rate of corrosion of steel for selection of earthing conductor shall be 0.12mm per year.		
LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
			Page 12 of 23



SUB-SECTION-V-QE1

MOTORS

**LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9**

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))	SYSTEM:	SECTION: II	SHEET 1 OF 2	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	10	M	C	N
					M	C/N							
1.0	ASSEMBLY	1 WORKMANSHIP	MA	VISUAL	100%	-	MFG SPEC	MFG SPEC	DO		P		
		2 DIMENSIONS	MA	DO	DO	-	MFG DRG / MFG SPEC	MFG DRG / MFG SPEC	DO		P		
		3 CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOR CODE	MA	VISUAL	100%	-	MFG SPEC /	MFG SPEC	DO		P		
2.0	PAINTING	1 SHADE	MA	VISUAL	SAMPLE		MFG SPEC / APPROVED DATASHEET	SAME AS COL 7	LOG BOOK		P		
3.0	TESTS	1 ROUTINE TEST INCLUDING SPECIAL TEST	MA	DO	100%	100%	IS 325 / IS 12615 / APPROVED DATA SHEET	SAME AS COL 7	TEST/ INSPN REPORT		P	W	W
		2 OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET	TEST/ INSPN REPORT		P	W	W
													NOTE -1 & NOTE -2
													NOTE -1 & NOTE -2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		Kunal
Reviewed by:		P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))	SYSTEM:	SECTION: II	SHEET 2 OF 2	



SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	10	M	C	N	
					M	CR				D				
		3.NAMEPLATE DETAILS	MA	VISUAL	100%	100%	IS-325 / IS-12015 / APPROVED DATA SHEET	SAME AS COL 7	TEST/INSPN REPORT		P	W	W	
40	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MFG STANDARD / APPROVED PACKING DRAWING (#)	AS PER MFG STANDARD / APPROVED PACKING DRAWING (#)	INSPC REPORT		P	W		(#) APPLICABLE FOR EXPORT JOBS

NOTES:

- 1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON
- 2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW, ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL FOR REVIEW
- 6 IN CASE, ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER

LEGENDS:

RECORDS, IDENTIFIED WITH "TICK"() SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER.
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		P. D. H.
Reviewed by:		P. D. H.	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ VENDOR/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN	SPEC. NO.	DATE: 27.02.2020
		CUSTOMER :	QIP NO. : PED-466-571-Q007, REV.04	
		PROJECT :	PO NO. :	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (11 V (415V))	SYSTEM:	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	10	M	P	N
					M	C/N							
1.0	RAW MATERIAL & REWORK OUT CONTROL												
1.1	SHEET STEEL PLATES SECTION, EYEBOARDS	1 SURFACE CONDITION	MA	VISUAL	100%			FREE FROM BLINDS, CRACKS, WAVINESS ETC	LOG BOOK		P		
		2 DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG / SPEC.	MANUFACTURER'S DRG / SPEC.	DO		P		
		3 PROOF LOAD TEST (EYE BOLT)	MA	Mech Test	DO		DO	DO	TEST REPORT		PV		
1.2	HARDWARES	1 SURFACE CONDITION	MA	VISUAL	100%			FREE FROM CRACKS, UN-EVENNESS ETC	DO		P		
		2 PROPERTY CLASS	MA	VISUAL	SAMPLES		MANUFACTURER'S DRG / SPEC.	MANUFACTURER'S DRG / SPEC.	SUPPLIER'S TC & LOG		PV		PROPERTY CLASS MARKING SHALL BE CHECKED BY THE VENDOR
1.3	CASTING	1 SURFACE CONDITION	MA	VISUAL	100%			FREE FROM CRACKS, BLOW HOLES, ETC	LOG BOOK		PV		
		2 CHEM & PHY PROP	MA	CHEM & MECH TEST	10% AT NO		MANUFACTURER'S DRG / SPEC.	MANUFACTURER'S DRG / SPEC.	SUPPLIER'S TC		PV		HEAT NO. SHALL BE VERIFIED
		3 DIMENSIONS	MA	MEASUREMENT	100%		MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		PV		
1.4	PAINT & VARNISH	1 MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100% CONTINUOUS		MANUFACTURER'S DRG / SPEC.	MANUFACTURER'S DRG / SPEC.	LOG BOOK		PV		

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i> 27/2/2020	Hema R.	Checked by:	<i>[Signature]</i>	<i>[Signature]</i>
Reviewed by:	<i>[Signature]</i>	P. Dutt	Reviewed by:		

VENDOR/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

SI No.		Component & Operations	Characteristics	Class	Type of Check	Quantum of check	Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
1		2	3	4	5	6	7	8	9	10	11	12	13	
						M	MIN							
15	SHAFT (FORGED OR BILLED)	1 SURFACE COND	MA	VISUAL	100%			FREE FROM VISHAL DEFECTS	DO				VENDOR'S APPROVAL INFORMATION SHALL BE MAINTAINED	
		2 CHEM & PHYSICAL PROPERTIES	MA	CHEM & PHYSICAL TESTS	100% AT NO OR HEAT TREATMENT BATCH NO		MANUFACTURER'S DRG / SPEC	MANUFACTURER'S DRG / STD	SUPPLIER'S TC			INV		
		3 DIMENSIONS	MA	MEASUREMENT	100%		DO	MANUFACTURER'S DRG	LOG BOOK			INV		
		4 INTERNAL FLAWS	CR	ULTRASONIC TEST	100%	100%	ASTM-A308	MANUFACTURER'S STD	DO	✓		INV		V
16	SPACE HEATER (S) CORRECTOR CABLES (CABLE LOSS) CABLE IN DRUM (TEMP DETECTORS, RTD, RTDS)	1 MAKE & MATERIALS	MA	VISUAL	DO		MANUFACTURER'S DRG / STD	MANUFACTURER'S DRG / STD	DO			INV		
		2 PHYSICAL CONST	MA	DO	DO			NO PHYS. DAMAGE, NO ELECTRICAL DISCONTINUITY	DO			INV		
		3 DIMENSIONS (WHERE NECESSARY APPLICABLE)	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG / STD	MANUFACTURER'S DRG / STD	DO			INV		
		4 PERFORMANCE CALIBRATION	MA	TEST	100%		DO	DO	TEST REPORT			INV		

DHCL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by: <i>[Signature]</i>	Hema K.	Checked by: <i>[Signature]</i>	K. P. S. S.	K. P. S. S.	GANDHI
Reviewed by: <i>[Signature]</i>	K. P. S. S.	Reviewed by:			

ORDER/SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER BIDDER SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC NO	DATE 21.02.2022 SHEET 1 OF 3
		CUSTOMER		OP NO. / REV NO. / QTY. / REQ. NO.	
		PROJECT		PO NO.	
		ITEM ASPECT NOTED SE KW & ABOVE ILY (XISV)	SYSTEM	SECTION 1	

Sl No.	Component & Operation	Characteristics	Class	Type of Class	Quantity of Check	Reference Document	Acceptance NORMS	FORMAT OF REPORT	AGENCY	
1	2	3	4	5	6	7	8	9	10	11
					M	CON				
1.1	OTHER INSULATING MATERIALS (SLEEVES, BRASS BUSHINGS, PAPER, PRESS BUSHINGS ETC.)	1. SURFACE (PINS ETC.)	MA	VISUAL	100%		NO VISUAL DEFECTS	1. NO REPORT	FW	
		2. DIELECTRIC CHARACTERISTICS	MA	TEST	SAMPLE	MANUFACTURER'S STD.	MANUFACTURER'S STD.	1. COEFFICIENT OF VARIATION (C.V.)	FW	
1.2	SHEET DRAWING (PUNCHES)	1. SURFACE (PINS)	MA	VISUAL	100%		NO VISUAL DEFECTS (FREE FROM MARKS)	1. NO REPORT	FW	
		2. DIMENSIONS INCLUDING SURF. HEIGHT	MA	MEASUREMENT	SAMPLE	MANUFACTURER'S STD.	MANUFACTURER'S STD.	1. C.V.	FW	
		3. ACCEPTANCE TESTS	MA	TEST & MEASUREMENT	100%	MANUFACTURER'S STD.	MANUFACTURER'S STD.	1. COEFFICIENT OF VARIATION (C.V.)	FW	
1.3	CONDUCTORS	1. SURFACE (PINS)	MA	VISUAL	100%		FREE FROM VISUAL DEFECTS	1. NO REPORT	FW	
		2. DIELECTRIC CHARACTERISTICS	MA	TEST & MEASUREMENT	SAMPLE	MANUFACTURER'S STD.	MANUFACTURER'S STD.	1. COEFFICIENT OF VARIATION (C.V.)	FW	

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
Prepared by: <i>[Signature]</i>	Henry K.	Checked by: <i>[Signature]</i>	P. J. J. J.	Reviewed by: <i>[Signature]</i>	P. J. J. J.
Reviewed by: <i>[Signature]</i>		Reviewed by: <i>[Signature]</i>		Reviewed by: <i>[Signature]</i>	



BIDDER SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.		DATE 27.02.2020
		CUSTOMER		UP NO. PED 466-00-0-007, REV.04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM	SECTION: II	SHEET 4 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
					M	C/N			D		M	C	N
1.10	BEARINGS	1 DIMENSIONS	MA	MEASUREMENT	DO-		DO-	DO-	Log Book		PV		
		1 MAKE & TYPE	MA	VISUAL	100%		MANUFACTURER'S DRG / APPROVED DATASHEET	MANUFACTURER'S DRG / APPROVED DATASHEET	DO-		PV		
		2 DIMENSIONS	MA	MEASUREMENT	SAMPLE		APPROVED DATASHEET	APPROVED DATASHEET / BEARING MANUF'S CATALOGUES	DO-		PV		
		3 SURFACE FINISH	MA	VISUAL	100%			FREE FROM VISUAL DEFECTS	DO-		PV		
1.11	SLIP RING (WHEREVER APPLICABLE)	1 SURFACE COND	MA	VISUAL	100%			DO-	DO-		P		
		2 DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG	MANUFACTURER'S DRG	DO-		P		
		3 TEST WITH STAND CAPACITY	MA	ELECT TEST	DO-		MANUFACTURER'S STD / APPROVED DATASHEET	MANUFACTURER'S STD / APPROVED DATASHEET	DO-		PV		
		4 TWR	MA	DO-	100%		DO-	DO-	DO-		PV		
1.12	OIL SEALS & GASKETS	1 MATERIAL OF GASKET	MA	VISUAL	100%		MANUFACTURER'S UNOSPEC'S	MANUFACTURER'S DRG / SPEC'S	DO-		P		
		2 SURFACE COND	MA	VISUAL	100%			FREE FROM VISUAL DEFECTS	DO-		P		
		3 DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG	MANUFACTURER'S DRG	DO-		P		

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		Ravi L.
Reviewed by:		P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURING INSPECTION SUPPLEMENT & ADDRESS	STANDARD QUALITY PLAN		SPQC NO.	DATE 17 JUL 2022
		COMMENTS:		OF NO. PRODUCTION RUNS	
		PROJECT:		TO NO.	
		FROM: AC ELECT. MOTORS 22 KW & ABOVE (JULY 1973)	SYSTEM:	SECTION:	

ITEM	Component & Operation	Characteristics	Class	Type of Check	Operation of Check		Reference Document	Inspection Method	Format of Record		AGENCY		
					A	B			C	D	E	F	G
2.0	WINDINGS	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.1	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.2	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.3	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.4	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.5	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.6	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.7	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.8	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.9	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.10	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.11	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.12	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.13	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.14	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.15	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.16	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.17	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.18	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.19	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				
2.20	WINDING WELDING	WINDING WELDING	W	WELD	WELD			WELD WELD	WELD WELD				

ENGINEERING		QUALITY	
Prepared by	Checked by	Prepared by	Checked by
Reviewed by	Reviewed by	Reviewed by	Reviewed by




SIGNATURES	
Sign & Date	Sign & Date
Seal	Seal

SIGNATURES			
Sign & Date	Sign & Date	Sign & Date	Sign & Date
Seal	Seal	Seal	Seal

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO. :		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 6 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	10	11	12	13	14
					M	C/N				D	M	C	N	
2.4	SHEET STACKING	1.COMPLETENESS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S STD	MANUFACTURER'S STD.	LOG BOOK		P	-	-	
		2.COMPRESSION & TIGHTENING	MA	MEASUREMENT	100%	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.5	WINDING	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STD /APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-	
		2.CLEANLINESS	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		3 IR-HV-IR	CR	ELECT. TEST	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		4 RESISTANCE	CR	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		5.INTERTURN INSULATION	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.6	IMPREGNATION	1 VISCOSITY	MA	PHY. TEST	AT STARTING	-	MANUFACTURER'S STANDARD	MANUFRT'S STANDARD	LOG BOOK		P	-	-	
		2 TEMP. PRESSURE VACCUM	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		3 NO. OF DIPS	MA	-DO-	CONTINUOUS	CONTINUOUS	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-	THREE DIPS TO BE GIVEN

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		P. Dutt
Reviewed by:		P. Dutt	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.		DATE: 27.09.2020
		CUSTOMER :		OP NO.: PEU-NOR-004407, REV.04		
		PROJECT:		PG NO.		
		ITEM: AC ELECT. MOTORS 45 KW & ABOVE (LV (415V))	SYSTEM:	SECTION II	SHEET 7 OF 8	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	10	M	V	N
					M	C/N							
2.7	COMPLETE STATOR ASSEMBLY	4 DURATION	MA	-DO-	CONTINUOUS	CONTINUOUS	DO	DO	LOG BOOK	✓	P	V	
		1 COMPACTNESS & CLEANLINESS	MA	VISUAL	100%		DO	DO	LOG BOOK		P		
2.8	BRAZING/COMPRESSION JOINT	1 COMPLETENESS	CR	-DO-	-DO-		DO	DO	LOG BOOK		P		
		2.SOUNDNESS	CR	Mallet Test & UT	100%	100%	DO	DO	LOG BOOK	✓	P	V	
		3 HV	MA	ELECT TEST	100%	100%	DO	DO	LOG BOOK	✓	P	V	
2.9	COMPLETE ROTOR ASSEMBLY	1.RESIDUAL UNBALANCE	CR	DYN BALANCE	-DO-		MANUFACTURER'S SPEC / ISO 1990	MANUFACTURER'S DOWS	LOG BOOK		P		
		2.SOUNDNESS OF DIE CASTING	CR	ELECT (GROWLER TEST)	100%	100%	MANUFACTURER'S SPEC	MANUFACTURER'S SPEC	LOG BOOK	✓	P	V	
2.10	ASSEMBLY	1.ALIGNMENT	MA	MEAS.	-DO-		DO	DO	LOG BOOK		P		
		2.WORKMANSHIP	MA	VISUAL	-DO-		DO	DO	LOG BOOK		P		
		3.AXIAL PLAY	MA	MEAS.	100%	100%	DO	DO	LOG BOOK	✓	P	V	
		4.DIMENSIONS	MA	-DO-	-DO-		MANUFACTURER'S DOWS / MANUFACTURER'S SPEC	MANUFACTURER'S DOWS / RELEVANT IS	LOG BOOK		P		
		5.CORRECTNESS, COMPLETENESS, TERMINATIONS, MARKING, COLOUR CODE	MA	VISUAL	100%		MANUFACTURER'S SPEC	MANUFACTURER'S SPEC	LOG BOOK		P		
		6. RTD, BTD & SPACE HEATER MOUNTING.	MA	VISUAL	100%	100%	MANUFACTURER'S SPEC	MANUFACTURER'S SPEC	LOG BOOK	✓	P	V	

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.			
	Sign & Date	Name	Seal
Reviewed by			
Approved by			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-508-00-Q-007, REV-04		
		PROJECT:		PG NO.		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION II	SHEET 8 OF 9	

SI No.	Component & Operations	Characteristic	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	10	11			
					M	C/N					D	M	C	N
3.0	TESTS	1 TYPE TESTS INCLUDING SPECIAL TESTS	MA	ELECT. TEST	1/TYPE/SIZE	1/TYPE/SIZE	IS 325/IS 12615/APPROVED DATASHEET	IS 325/IS 12615/APPROVED DATASHEET	TEST REPORT		P	W ¹	W ¹	* NOTE - 1
		2.ROUTINE TESTS INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	DO-	DO-	DO-		P	VW ¹	VW ¹	* NOTE - 2
		3.VIBRATION & NOISE LEVEL	MA	-DO-	100%	100%	IS 12025 / IEC 60034-14 & IS 12005	IS 12025 / IEC 60034-14 & IS 12005	DO-		P	VW ¹	VW ¹	* NOTE - 2
		4.OVERALL DIMENSIONS AND ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DIM/DATA SHEET	APPROVED DIM/DATA SHEET	TESTING/INSPECTION REPORT		P	W	-	
		5.DEGREE OF PROTECTION	MA	ELECT. & MECH. TEST	1/TYPE/ SIZE	1/TYPE/ SIZE	IEC 60034-5/IS 12615	APPROVED DATASHEET	DO-	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		6. MEASUREMENT OF RESISTANCE OF RTD & BTD	MA	-DO-	100%	100%	IS 325/IS 12615/IEC 60034 PART 1/IS 12602	IS 325/IS 12615/IEC 60034 PART 1/IS 12602	DO-		P	VW ¹	VW ¹	* NOTE - 2
		7. MEASUREMENT OF RESISTANCE, IR OF SPACE HEATER	MA	-DO-	100%	100%	IS 325/IS 12615/IEC 60034 PART 1	IS 325/IS 12615/IEC 60034 PART 1	DO-		P	VW ¹	VW ¹	* NOTE - 2
		8. NAME PLATE DETAILS	MA	VISUAL	100%	100%	IS 325/IS 12615/ DATA SHEET	IS 325/IS 12615/ DATA SHEET	TESTING/INSPECTION REPORT		P	VW ¹	VW ¹	* NOTE - 2
		9.EXPLOSION FLAME PROOF NESS (IF SPECIFIED)	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	1/TYPE	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		10. PAINT SHADE, THICKNESS & FINISH	MA	VISUAL & MEASUREMENT BY ELKOWETER	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC		P	WS	WS	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY * NOTE - 2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hemant K.	Checked by:		KUNAL GANDHI
Reviewed by:		P. Datta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SHEET NO.		DATE 27.02.2020
		CUSTOMER :		QIP NO. : PEH 506 00 41007, REV 01A		
		PROJECT:		PO NO.		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (1 V (415V))	SYSTEM	SECTION: II	SHEET 9 OF 9	



Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	10	11	12	13	
					M	C/N								
40	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING	INSPE. REPORT			M	W	N
														IF APPLICABLE, REFER TO APPROPRIATE DRAWING ALSO

NOTES:

1. DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
2. ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
3. IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
4. BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
5. AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
6. IN CASE, ANY CHANGES IN QIP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, S: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		KUNAL K. GANDHI
Reviewed by:		P. Dutt	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc. No.	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

CLAUSE NO.		QUALITY ASSURANCE																		
MOTOR																				
TESTS/CHECKS TEMS/COMPONENTS		Visual	Dimensional	Make/Type/Rating Physical Inspection	Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034\IEC 60079-I/ IS-12615	Vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
Plates for stator frame, end shield, spider etc.		Y	Y	Y	Y	Y				Y										
Shaft		Y	Y	Y	Y	Y	Y			Y										
Magnetic Material		Y	Y	Y	Y			Y			Y		Y							
Rotor Copper/Aluminium		Y	Y	Y	Y			Y		Y			Y							
Stator copper		Y	Y	Y	Y			Y		Y			Y							
SC Ring		Y	Y	Y	Y	Y		Y	Y	Y			Y							
Insulating Material		Y		Y	Y			Y					Y							
Tubes, for Cooler		Y	Y	Y	Y	Y				Y		Y								
Sleeve Bearing		Y	Y	Y	Y	Y				Y		Y								
Stator/Rotor, Exciter Coils		Y	Y	Y				Y	Y											
Castings, stator frame, terminal box and bearing housing etc.		Y	Y	Y	Y	Y			Y											
Fabrication & machining of stator, rotor, terminal box		Y	Y			Y			Y	Y										
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE						TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9						PART-B SUB-SECTION-V-QE1 MOTORS				PAGE 1 OF 2				

CLAUSE NO.	QUALITY ASSURANCE																		
Wound stator	Y	Y					Y	Y											
Wound Exciter	Y	Y					Y	Y											
Rotor complete	Y	Y					Y						Y	Y					
Exciter, Stator, Rotor, Terminal Box assembly	Y	Y					Y												
Accessories, RTD, BTDC, CT, Space heater, antifriction bearing, gaskets etc.	Y	Y	Y																
Complete Motor	Y	Y	Y												Y	Y	Y	Y1	Y
Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW. 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard 3. Makes of major bought out items for HT motors will be subject to NTPC approval. 4. Y1 = for HT Motor / Machines only.																			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE							TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9							PART-B SUB-SECTION-V-QE1 MOTORS				PAGE 2 OF 2	



**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
LIME DOSING/FEEDING SYSTEM
KORBA STPP, STAGE-I,II & III**

SPECIFICATION NO.

VOLUME NO. : **II-B**

SECTION :

REV NO. **00** : DATE : 23.05.2020

SHEET : 1 OF 1

DATASHEET-A

ANNEXURE-I

- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : 200KW *
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Details of supply system
- a) Rated voltage (with variation) : 415V $\pm$ 10%
 - b) Rated frequency (with variation) : 50 Hz + 3 % to - 5%
 - c) Combined voltage & freq. variation : 10% (sum of absolute values)
 - d) System fault level at rated voltage : 50 kA for 1 sec
 - e) Short time rating for terminal boxes
 - o 110 kW and above (Breaker : 50 KA for 0.25 sec. Controlled)
 - o Below 110 kW (Contactor : 50 KA protected by HRC fuse Controlled)
 - f) LV System grounding : Solidly
- 5.0 Winding & Insulation : Class F with temp rise limited to class B
- 6.0 Minimum voltage for starting : 85% for motor ratings below 110kW
(As percentage of rated voltage) 80% for motor ratings from 110kW to 200kW.
- 7.0 Power cables data : Shall be given during detailed engg.
- 8.0 Earth Conductor Size & Material : Shall be given during detailed engg.
- 9.0 Space heater supply (for motors $\geq$ 30kW) : 240 V, 1 ϕ , 50 Hz
- 10.0 Rating up to which Single phase motor : Acceptable below 0.2 kW
- 11.0 Locked rotor current
- a) Limit as percentage of FLC : As per IS 12615
- 12.0 Makes : BHEL/ Customer approval (Package owner to take care)
- 13.0 Paint shade : Blue (RAL 5012) – Corrosion proof
- 14.0 Degree Of protection for motor/ terminal box : Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-
- i) Indoor motors - IP 54
 - ii) Outdoor motors - IP 55
 - iii) Cable box-indoor area - IP 54
 - iv) Cable Box-Outdoor area - IP 55

*** LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615**

15.0 TESTING REQUIREMENTS: IN LINE WITH SPECIFICATION

DATASHEET-C

CLAUSE NO.	Bidder's Name			
	DE-1B	LT MOTORS		
	A.	GENERAL		
	5.	Manufacturer & Country of origin. (Shall be as per approved QA make)		
	6.	Equipment driven by motor		
	7.	Motor type		
	8.	Quantity		
	B.	DESIGN AND PERFORMANCE DATA		
	18.	Frame size		
	19.	Type of duty		
	20.	Type of enclosure /Method of cooling/ Degree of		
	21.	Applicable standard to which motor generally		
	22.	Efficiency class as per IS 12615		
	23.	(a)Whether motor is flame proof	Yes/No	
		(b)If yes, the gas group to which it conforms as per IS:2148		
	24.	Type of mounting		
	25.	Direction of rotation as viewed from DE END		
	26.	Standard continuous rating at 40 deg.C. ambient temp. as per Indian Standard (KW)		
	27.	Derated rating for specified normal condition i.e. 50 deg. C ambient temperature (KW)		
	28.	Maximum continuous load demand of driven		
	29.	Rated Voltage (volts)		
	30.	Permissible variation of :		
		a. Voltage (Volts)		
		b. Frequency (Hz)		
		c. Combined voltage and frequency		
	31.	Rated speed at rated voltage and		
	32.	At rated Voltage and frequency:		
		a. Full load current		
	LOT 3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		ATTACHMENT-12 TO SECTION-VII TECHNICAL DATA SHEETS BID DOC. NO.: CS-00111-109(3)-9	PART-F CHAPTER-II MODULE-II SUB-SECTION:DE1 MOTORS
			PAGE 13 OF 17	

CLAUSE NO.	Bidder's Name		
		b. No load current	
	33.	Power Factor at	
		a. 100% load	
		b. NO load	
		c. Starting.	
	34.	Efficiency at rated voltage and frequency,	
		a. 100% load	
		b. 75% load	
		c. 50% load	
	35.	Starting current (amps) at	
		a. 100 % voltage	
		b. 85% voltage	
		c. 80% voltage	
	36.	Minimum permissible starting Voltage (Volts)	
	37.	Starting time with minimum permissible voltage	
		a. Without driven equipment coupled	
		b. With driven equipment coupled	
	38.	Safe stall time with 100% and 110% of rated	
		a. From hot condition	
		b. From cold condition	
	39.	Torques :	
		a. Starting torque at min. permissible voltage(kg-	
		b. Pull up torque at rated voltage.	
		c. Pull out torque	
		d. Min accelerating torque (kg.m) available	
		e. Rated torque (kg.m)	
	40.	Stator winding resistance per phase (ohms at 20	
	41.	GD ² value of motors	
LOT 3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		ATTACHMENT-12 TO SECTION-VII TECHNICAL DATA SHEETS BID DOC. NO.: CS-00111-109(3)-9	PART-F CHAPTER-II MODULE-II SUB-SECTION:DE1 MOTORS
		PAGE 14 OF 17	

CLAUSE NO.	Bidder's Name				
	42.	No of permissible successive starts when motor is in hot condition			
	43.	Locked Rotor KVA Input			
	44.	Locked Rotor KVA/KW			
	45.	Vibration limit :Velocity (mm/s)			
	46.	Noise level limit (dBA)			
	C.	CONSTRUCTIONAL FEATURES			
	1.	Stator winding insulation			
		a. Class & Type			
		b. Winding Insulation Process			
		c. Tropicalised (Yes/No)			
		d. Temperature rise over specified maximum ambient temperature of 50 deg C			
		e. Method of temperature measurement			
		f. Stator winding connection			
	2.	Main Terminal Box			
		a. Type			
		b. Location(viewed from NDE side)			
		c. Entry of cables(bottom/side)			
		d. Recommended cable size(To be matched with cable size envisaged by owner)			
		e. Fault level (MVA),Fault level duration(sec)			
		f. Cable glands & lugs details (shall be suitable for			
	3.	Type of DE/NDE Bearing			
	4.	Motor Paint shade			
	5.	Weight of			
		a. Motor stator (KG)			
		b. Motor Rotor (KG)			
		c. Total weight (KG)			
	LOT 3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		ATTACHMENT-12 TO SECTION-VII TECHNICAL DATA SHEETS BID DOC. NO.: CS-00111-109(3)-9	PART-F CHAPTER-II MODULE-II SUB-SECTION:DE1 MOTORS	PAGE 15 OF 17

CLAUSE NO.	Bidder's Name				
	D.	List of accessories.			
	1.	Space Heaters (Applicable for 30 KW & above motor) (Nos./Power in watts/supply voltage)			
	2.	Terminal Box for Space Heater (Yes/No)			
	3.	Speed switch (Yes/No)			
	4.	Insulation of bearing (Yes/No)			
	5.	Noise reducer(Yes/No)			
	6.	Grounding pads			
		i) No and size on motor body			
		ii) Nos on terminal Box			
	7.	Vibration pads			
		i) Nos and size			
		ii) Location			
	8.	Any other fitments			
	E.	List of curves.			
	1.	Torque speed characteristic of the motor			
	2.	Thermal withstand characteristic			
	3.	Starting. current Vs. Time			
	4.	Starting. current Vs speed			
	5.	P.F. and Effl. Vs Load			
	F.	Additional Data to be filled for each rating of DC Motor			
	1.	Rated armature voltage (Volt)			
	2.	Rated field excitation (Amp)			
	3.	Permissible % variation in voltage			
	4.	Minimum Permissible Starting voltage (volt)			
	5.	At rated voltage			
		i)Full load Armature current.(Amp)			
	LOT 3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		ATTACHMENT-12 TO SECTION-VII TECHNICAL DATA SHEETS BID DOC. NO.: CS-00111-109(3)-9	PART-F CHAPTER-II MODULE-II SUB-SECTION:DE1 MOTORS	PAGE 16 OF 17


CLAUSE NO.	Bidder's Name				
		ii) Full load Field current (Amp)			
		iii) No load Armature current (Amp)			
	6.	Full load Field current (Amp)			
	7.	No load Armature current (Amp)			
	8.	Minimum permissible field current (Amp) to avoid			
		i) Maximum permissible voltage			
		ii) Rated voltage			
		iii) Minimum Permissible Voltage			
	9.	Resistance (indicative Values) in ohm			
		i) Armature winding (Arm + IP + Series) at 25			
		ii) Field Winding at 25 deg. C			
	10..	Inductance (indicative values)			
		i) Armature winding			
		ii) Field winding			
	11	Value of trimmer resistance (ohm) to be connected in series with the shunt field to			
		i) 220 V DC			
		ii) 250 V DC			
		iii) 187 V DC			
	12	Value of the external resistance (ohm) required to be connected in series with armature during starting only			
	13	Technical data sheet for external resistance box			
	14	GA drawing of motor			
	15	Starting time calculation			
	16	Starter resistance design calculation			
	17	Electrical connection diagram of motor			
	LOT 3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		ATTACHMENT-12 TO SECTION-VII TECHNICAL DATA SHEETS BID DOC. NO.: CS-00111-109(3)-9	PART-F CHAPTER-II MODULE-II SUB-SECTION: DE1 MOTORS	PAGE 17 OF 17

963437/2022/PS-PEM-MAX

LOAD TITLE	RATING (KW / A)		UNIT (U)/STN (S)	Nos.		VOLTAGE CODE*	FEEDER CODE**	EMER. LOAD (Y)	CONT.(C)/ INTT.(I)	STARTING TIME >5 SEC (Y)	LOCATION	BOARD NO.	CABLE		BLOCK CABLE DRG. No.	CONTROL CODE	REMARKS	LOAD No.
	NAME PLATE	MAX. CONT. DEMAND (MCR)		RUNNING	STANDBY								SIZE CODE	NOS				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19
ANNEXURE-II																		
NOTES: 1. COLUMN 1 TO 12 & 18 SHALL BE FILLED BY THE REQUISITIONER (ORIGINATING AGENCY); REMAINING COLUMNS ARE TO BE FILLED UP BY PEM (ELECTRICAL)/ CUSTOMER																		
2. ABBREVIATIONS : * VOLTAGE CODE (7):- (ac) A=11 KV, B=6.6 KV, C=3.3 KV, D=415 V, E=240 V (1 PH), F=110 V (cc): G=220 V, H=110 V, J=48 V, K=+24V, L=-24 V																		
: ** FEEDER CODE (8):- U=UNIDIRECTIONAL STARTER, B=BI-DIRECTIONAL STARTER, S=SUPPLY FEEDER, D=SUPPLY FEEDER (CONTACTER CONTROLLED)																		
LOAD DATA (ELECTRICAL)	JOB NO.		466				ORIGINATING AGENCY				PEM (ELECTRICAL)							
	PROJECT TITLE		KORBA STPP STAGE-I,II & III				NAME				DATA FILLED UP ON							
	SYSTEM		LIME DOSING/FEEDING SYSTEM				SIGN.				DATA ENTERED ON							
	DEPTT. / SECTION		MAUX				SHEET 1 OF 1		REV. 00		DE'S SIGN. & DATE							
This page is the part of Tech. Spec. No. PE-TS-466-571-A102																		

234 of 410
This page is the part of Tech. Spec. No. PE-TS-466-571-A102

963437/2022/PS-PEM-MAX

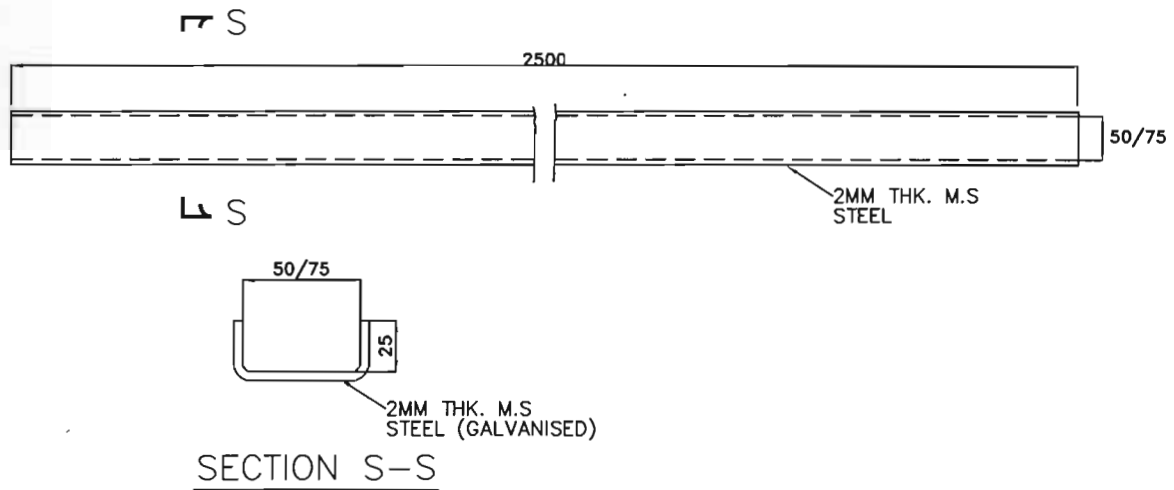CABLE TROUGHS~~SEE GENERAL NOTES IN SHEET 11.~~

TYPICAL DETAILS OF
CABLE TRAY AND ACCESSORIES

BHEL DRAWING NO.

~~PE-DG-427-507-E005~~~~SH-10-OF-11~~

REV 00

963437/2022/PS-PEM-MAX

(3X200+3X500+1X500) MW KORBA STG-I, II & III STPP FGD

TECHNICAL SPECIFICATION (C&I) LIME DOSING SYSTEM

SECTION-I

SUB-SECTION-C4

CONTROL & INSTRUMENTATION

FOR

LIME DOSING SYSTEM

(3X200+3X500+1X500) MW KORBA STG-I, II & III STPP FGD		DESG	SK
JOB No. 466		CHKD	SCS
REV No. 00	DATE 25.04.2020	APPD	SCS

237 of 410



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

INDEX

S. No.	DESCRIPTION
1	TITLE SHEET
2	INDEX SHEET
3	C&I SPECIFIC TECHNICAL REQUIREMENT
4	GENERAL TECHNICAL REQUIREMENTS
5	LIST OF DOCUMENTS/DELIVERABLES
6	SPECIFICATION FOR MEASURING INSTRUMENTS (PRIMARY & SECONDARY), ELECTRICAL ACTUATOR AND LCP
7	INSTRUMENTATION CABLE, CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY
8	INSTRUMENT STUB DETAILS
9	INSTRUMENT INSTALLATION DRAWING
10	SIGNAL EXCHANGE BETWEEN DRIVES AND DCS
11	DRIVE AND INSTRUMENT INTERFACE DIAGRAM
12	QUALITY ASSURANCE FOR INSTRUMENTS & STARTER PANEL/LCP AND TYPE TEST REQUIREMENTS
13	MANDATORY SPARES Refer Annexure-II, Sub Section-D, Section-I of Technical Specification for mandatory spares of
14	SUB VENDOR LIST

|



**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**

SECTION: C
SUB SECTION: C&I

**C&I SPECIFIC TECHNICAL REQUIREMENT
FOR DCS BASED
LIME DOSING SYSTEM**

|



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

Specific Technical Requirements (C&I):

1. LIME DOSING SYSTEM shall be operated from DCS (BHEL's scope).
2. The Contractor shall provide complete Instrumentation along with necessary fittings, accessories and valve manifold etc for control, monitoring and operation of entire LIME DOSING SYSTEM except marked as BHEL's scope in P&ID attached in specification. All instruments shall be provided with durable epoxy coating for housing and all exposed surfaces of the instruments.
3. All the Electronic Transmitter for Pressure, Temperature and DP based Flow /Level measurements shall be genuine, verifiable PROFIBUS PA protocol compatible instruments. The transmitters shall be connected to DDCMIS through PROFIBUS PA protocol complying to IEC 61158 directly from transmitter. This is subject to customer approval and BHEL decision shall be final.
4. Electrical Actuators (as applicable) shall be Non-Intrusive type electric actuators envisaged with integral starter. The interface of these actuators with DCS shall be of two types viz. with Hardwired interface and with PROFIBUS DP interface. All actuator settings including torque, limit shall be possible without opening the actuator cover and LCD indication shall be available integral to actuator body. Open/Close command termination logic suitably built inside the actuator Details shall be referring in the specification.
5. All ON, OFF, and INCHING Type electric actuators shall be PROFIBUS DP compatible. However, the exact protocol shall be based on finalized protocol of DCS. If PROFIBUS DP protocol is envisaged, then actuator shall have two (redundant) PROFIBUS DP ports for connecting the redundant PROFIBUS DP cables. That is if one PROFIBUS DP cable is cut or not working/not available, then complete actuator functionality shall be available through the second redundant cable without any manual intervention.
6. The PROFIBUS protocol design shall be further validated by BHEL and approved by NTPC during detailed engineering and any variation/ changes required based on DDCMIS system requirements and actual field installation, operational philosophy etc. shall be considered by bidder without any implications.
7. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre- bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of customer shall prevail without any commercial implication.
8. The make of the items shall be from sub-vendor list. However, the make/model of various instruments/items/systems shall be subject to approval of owner/purchaser during detailed engineering stage. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict or repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
9. All transmitters shall be suitably grouped together and mounted inside (i) Local Instruments Enclosures (LIEs) in case of open areas of the plant and (ii) In Local Instrument Racks (LIRs) in case of covered areas.



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

10. All instruments (except PROFIBUS PA compatible transmitters) and control elements shall be terminated on JB/LCP in field and JB/LCP are in bidder's scope for bidder's supplied instrument and in BHEL's scope for BHEL's supplied instrument. Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 12-15 mtrs) and trunk cable.
11. The contacts of equipment mounted instruments; sensors, switches etc. For external connection including spare contacts shall be wired out to suitably located junction boxes by bidder.
12. For cable scope refer to electrical scope between BHEL and vendor defined in electrical specification.
13. The design, manufacture, inspection, testing, site calibration and installation of all C&I equipment and systems covered under this specification shall conform to the latest editions of applicable codes and standards.
14. Bidder to provide mandatory spares as per mandatory spares list.
15. The specifications for instruments mentioned in the specification are minimum requirements. The detail specifications shall be finalized during detail engineering. The bidders shall specifically mention any deviation they would like to take on the C&I specification. In absence of only deviation, a No deviation certificate is to be furnished.
16. The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.
17. Bidder to provide input/output list, drives list, junction box schedule and termination details, recommended control logics / write-up etc. the list of documents to be submitted after award of contract is to be referred by bidder.
18. All the transmitters supplied by Bidder shall be rack mounted. The transmitter racks shall be in Bidder's scope of supply. All transmitters shall be HART compatible.
19. Bidder to perform tests of C&I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to perform by Bidder without any cost implication.



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

20. Instrument installation and accessories required for the same shall be in Bidder's scope and shall be submitted after award of contract. However, any instrument/ analyser installation not covered in the same shall be subject to customer and BHEL approval during detailed engineering. Bidder to provide erection hardware including junction boxes, canopies, structural steel as required.
21. Provision for separate Terminal block/wiring diagram for power and control blocks of control panel to be ensured.
22. Bidder to provide Flow measuring device suitable for the service condition, which shall be decided by BHEL/customer during detail engineering. Bidder to comply the requirement without any commercial implication.
23. Bidder to furnish electrical load/UPS load data during detailed engineering.
24. 415VAC /230 V UPS Power supply shall be provided by BHEL at a single point, further distribution to various instruments/equipment of the system shall be in bidder scope. Bidder to include necessary power distribution board in his scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
25. Power supply derived for contact interrogation, interposing relay and solenoid shall generally be ungrounded 24 V D.C. only.
26. Interface of MCC, HT SWGR, Solenoid valves, field instruments, Actuators etc. with DDCMIS based control system shall be as per Drive Control Philosophy enclosed in specification.
27. Local control panel , if any required for operation shall be in bidder scope.
28. The solenoid operated valves/Dampers/Gate shall have a limit switch for open/close feedback. Solenoid Valve shall be rated for 24V Dc only.
29. All field instruments enclosure shall be IP65, local panel/cabinet enclosure shall be IP 55, unless otherwise specified.
30. Diaphragm seal shall be provided with Instruments having contact with corrosive media.
31. To ensure availability, adequate redundancy in system design shall be provided at hardware, software and sensor level. For the protection system, independent sensing device shall be provided to ensure adequate safety of plant equipment.
32. Redundancy of sensors shall be provided by bidder
 - (i) Triple redundancy for all Analog and binary inputs required for protection of system/drives.
 - (ii) For all other control functions dual redundancy of the sensors shall be provided by the bidder.



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

33. Double root valve shall be provided for all pressure tapings where the pressure exceeds 40kg/cm².
34. Use of process actuated shall be avoided unless unavoidable.
35. Number of pairs to be selected for Screen /Control cable
 - a) F-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - b) G-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - c) Core Cable: 3CX2.5sqmm²/ 5CX2.5sqmm²/ 12CX1.5sqmm²
36. Instrument installation shall be as per the attached "Standard Hook-up diagram of instrument."
37. In addition to requirements specified here, all C&I systems/ sub-systems/ equipment/ devices shall also meet other requirements stipulated under other Sub-sections/ parts/ sections of specification. In case of any conflict and repetition of clauses in the specification, BHEL discretion will prevail. The requirements given are to be read in conjunction with detailed Technical specification enclosed.
38. All field instruments shall be weatherproof, drip tight, dust tight and splash proof suitable for use under outdoor ambient conditions prevalent in the subject plant. All field-mounted instruments shall be mounted in suitable locations where maximum accessibility for maintenance is achieved. All the field instruments shall also be provided with SS tag nameplate and double compression type Nickel-plated brass cable gland. Gaskets, Fasteners, Counter and mating flange (SS316 material), nuts & bolts etc. shall also be included, wherever required with the field instruments.
39. All the outdoor field instruments such as analysers/transmitters/meters etc. shall be provided with suitable Free standing cabinet(s)/panel/rack/canopy so that the equipments are protected against rain/ sunlight etc.
40. All instruments should be supplied with valid calibration and test certificates provided by OEM.
41. At least 20% spare unused terminals shall be provided everywhere including local junction boxes, instrument racks/enclosures, termination/marshalling cabinets, etc.
42. Drive control philosophy/signal exchange list attached elsewhere in the specification are Tentative. Shall be finalized during detailed engineering.



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

43. Contractor shall furnish Instrument Schedule, I/O list, Drive list, Cable Schedule, Cable interconnection (DCS end terminal details shall be provided to vendor during detail engineering to incorporate in cable interconnection), JB grouping, Annunciation list, SOE list, List of Instruments/devices for HART in BHEL approved format. Also reusable database format like MS Excel, MS Access etc. of these documents shall also be provided by Contractor in BHEL approved format. Soft copy of the formats shall be provided to the successful bidder.

Note:-

1. All equipment items shall be of latest design with proven on track record.
2. The above given scope is indicative & minimum. Any item/ equipment not indicated above however required for the completeness of the system is to be supplied by bidder without any technical, commercial and delivery implication to BHEL.
3. Documents of C&I System shall be submitted to end user/owner for approval during detail engineering. Changes, if any, shall be accommodated by the bidder without any price/time implication.

|



**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**

SECTION: C
SUB SECTION: C&I

**GENERAL TECHNICAL REQUIREMENTS
(LIME DOSING SYSTEM)**

FORM NO. PEM-666-0		SPECIFICATION FOR CONTROL & INSTRUMENTATION FOR AUX PACKAGES		SPECIFICATION NO.:	
				VOLUME	
				SUB SECTION	
				REV. NO.	DATE :
				SHEET	OF
GENERAL REQUIREMENT 1.0 Bidder shall provide complete and independent control & instrumentation system with all accessories, auxiliaries and associated equipments for the safe, efficient and reliable operation of auxiliary systems. 2.0 The quantity of instruments for auxiliary system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication. 3.0 Measuring instruments/equipment and subsystems offered by the bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Further all the instruments shall be of proven reliability, accuracy, and acceptable international standards and shall be subject to employer's approval. All instrumentation equipment and accessories under this specification shall be furnished as per technical specification, ranges, makes/ numbers as approved by the employer' during detail engineering. 4.0 The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifold and all the other accessories required for mounting/ erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments; sensors, switches etc for external connection including spare contacts shall be wired out to suitably located junction boxes. 5.0 The customer specification attached as Specific Technical Requirement will supercede the Data sheets, if there is any mismatch.					

	C&I SPECIFICATION FOR LIME DOSING SYSTEM	SECTION: C SUB SECTION: C&I

LIST OF DOCUMENTS/DELIVERABLES

|



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

LIST OF DELIVERABLES OF PEM - C&I DEPARTMENT

Sl. No.	DRAWING NO.	DRAWING/DOCUMENT TITLE	CATEGORY
1	PE-V4-466-145-I901	CONTROL & OPERATIONAL WRITE-UP FOR THE SYSTEM WITH SET POINTS	A
2	PE-V4-466-145-I902	CONTROL SCHEME/LOGIC DIAGRAM (TO BE IMPLEMENTED IN DDCMIS)	A
3	PE-V4-466-145-I903	HMI PICTURES/PLANT SCHEMATICS	A
4	PE-V4-466-145-I904	INSTRUMENT SCHEDULE WITH SET POINTS	A
5	PE-V4-467-145-I905	I/O LIST (ANALOG & BINARY)	A
6	PE-V4-466-145-I906	DRIVE LIST/SOLENOID/ACTUATOR VALVE LIST WITH LOCATION DATA	A
7	PE-V4-466-145-I907	FIELD JB/LIE/LIR, DRIVES TERMINATIONS	A
8	PE-V4-466-145-I908	DATASHEETS FOR INSTRUMENTS, JBs, etc.	A
9	PE-V4-466-145-I909	QUALITY PLANS (INSTRUMENTS, VMS, etc.)	A
10	PE-V4-466-145-I910	INSTRUMENT HOOK-UP DRAWING	A
11	PE-V4-466-145-I911	THERMOWELL SIZING CALCULATION	A
12	PE-V4-466-145-I913	CABLE SCHEDULE & INTERCONNECTION	A
13	PE-V4-466-145-I914	ANNUNCIATION & SOE LIST	A

NOTES:

ANY OTHER DOCUMENT DECIDED DURING DETAILED ENGINEERING SHALL BE PROVIDED BY BIDDER WITHOUT ANY COMMERCIAL/TECHNICAL IMPLICATION.

CONTRACTOR TO SUBMIT REUSABLE DATABASE FORMATS IN BHEL/CUSTOMER APPROVED FORMATS LIKE MS EXCEL, MS ACCESS OF DOCUMENTS LIKE INSTRUMENT SCHEDULE, I/O LIST, DRIVE LIST, FIELD JB TERMINATIONS, CABLE SCHEDULE & INTERCONNECTION, etc. SOFT COPY OF FORMATS SHALL BE PROVIDED TO SUCCESSFUL BIDDERS.



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

SPECIFICATION FOR MEASURING INSTRUMENTS
(PRIMARY & SECONDARY), ELECTRICAL
ACTUATOR AND LCP.

|

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
1.00.00	MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)			
1.01.00	Measuring instruments/equipment and subsystems offered by the Bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Refer Sub-section Basic Design Criteria. Further, all instruments shall be of proven reliability, accuracy, and repeatability requiring a minimum of maintenance and shall comply with the acceptable international standards and shall be subject to Employer's approval.			
1.02.00	Every panel-mounted instrument requiring power supply shall be provided with easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a grounding terminal and shall be suitably connected to the panel grounding bus.			
1.03.00	All transmitters, sensors, switches and gauges for parameters like pressure, temperature, level, flow etc. as required for the safe and efficient operation and maintenance as well as for operator and management information (including all computation) of equipment in the system under the scope of specification shall be provided on as required basis with in quoted lump sum price. The Contractor shall furnish all Instrumentation / Control equipment & accessories under this specification as per technical specification, ranges, makes & model as approved by the Employer during detailed engineering.			
1.04.00	The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting/erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments, sensors, switches etc. for external connection including spare contacts shall be wired out in flexible/rigid conduits, independently to suitably located common junction boxes. The proposal shall include the necessary cables, flexible conduits, junction boxes and accessories for the above purpose. Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kg./sq.cm.			
1.05.00	All instruments envisaged for sea water applications, shall be provided with wetted parts made of Monel/ Hastelloy C or any other material (if provenness experience of the proposed material for such applications is established by contractor). For Chlorine application: instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Hastelloy C. Also, filled liquid shall be Fluorolube oil/ Inert Hydrocarbon / CTFE etc., for these applications. For applications of FECL3 solution: Instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Tantalum.			
1.06.00	For coastal areas, all instruments shall be provided with durable epoxy coating for housings and all exposed surfaces of the instruments.			
1.07.00	The instruments, for which technical specification is not attached, shall be supplied as per the standard and proven practice of the contractor. The same shall be established by the contractor during detailed engineering by providing detailed explanation/concepts, if required by the employer, of such implementation along with standard documentation.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 1 OF 34

1/2022/PS-PEM-MAX		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC							
CLAUSE NO.											
16.00.00		FIELD INSTRUMENTS BASED ON FIELDBUS									
		The following instruments shall be connected to DDCMIS through fieldbus i.e. FOUNDATION Fieldbus/PROFIBUS PA protocol complying to IEC 61158 directly from transmitter.									
16.01.00		Electronic Transmitter for Pressure, Differential Pressure and DP based Flow / Level measurements.									
		<table><tr><td>S No.</td><td>Features</td><td>Essential/Minimum Requirements</td></tr><tr><td>1.</td><td>Type of Transmitter</td><td>FOUNDATION Fieldbus/PROFIBUS PA based output</td></tr></table>				S No.	Features	Essential/Minimum Requirements	1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output
S No.	Features	Essential/Minimum Requirements									
1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output									
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS							
				PAGE 5 OF 8							

H/2022/PS-PEM-MAX					
CLAUSE NO.		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
		2	Accuracy	± 0.060 % of calibrated range (minimum) for calibrated range greater than 400 mmwc. +0.065% of calibrated range (minimum) for calibrated range greater than 250 kg/cm2. ± 0.10 % of calibrated range (minimum) for calibrated range less than 400 mmwc.	
		3.	Stability	0.25 % of calibrated range for 10 years for calibrated range greater than equal to 400 mmwc on standard conditions of manufacturer. 0.2 % of calibrated range for 1 years for calibrated range less than 400 mmwc on standard conditions of manufacturer. 0.15% of calibrated range for 5 years for DPT with static pressure greater than 250 kg/cm2.	
		4	Turn down	50:1 for greater than or equal to span of 400mmwcl. 20:1 for span below 400mmwcl. 10:1 for span greater than 250 kg/cm2 (Above mentioned (2,3,4) parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only).	
		5	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating	
		6.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible	
		7.	Process connection	½” NPT (F)	
		8.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.	
			Overpressure	150% of max operating pressure	
		9	Accessories	-Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & gauge pressure transmitters, -3-valve for DP and 5 valve manifold for level/flow applications. -The valve manifold shall be non-integral type. -For hazardous area, enclosure as described in NEC article 5.	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 6 OF 8

1/2022/PS-PEM-MAX		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
CLAUSE NO.					

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC															
2.02.00	GUIDED WAVE RADAR TYPE LEVEL TRANSMITTER <table><tr><td>Type</td><td>Microprocessor based 2 wire type (loop powered); HART protocol compatible Guided wave radar transmitter.</td></tr><tr><td>Principle</td><td>TDR (Time domain reflectometry)</td></tr><tr><td>Probe Type & Material</td><td>(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.</td></tr><tr><td>Output signal</td><td>4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.</td></tr><tr><td>Accuracy</td><td>± 0.5% of calibrated span or minimum 5mm.</td></tr><tr><td>Power supply</td><td>24 VDC ± 10%.</td></tr><tr><td>Housing</td><td>Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.</td></tr></table>	Type	Microprocessor based 2 wire type (loop powered); HART protocol compatible Guided wave radar transmitter.	Principle	TDR (Time domain reflectometry)	Probe Type & Material	(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.	Output signal	4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.	Accuracy	± 0.5% of calibrated span or minimum 5mm.	Power supply	24 VDC ± 10%.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.		
Type	Microprocessor based 2 wire type (loop powered); HART protocol compatible Guided wave radar transmitter.																
Principle	TDR (Time domain reflectometry)																
Probe Type & Material	(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.																
Output signal	4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.																
Accuracy	± 0.5% of calibrated span or minimum 5mm.																
Power supply	24 VDC ± 10%.																
Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.																
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: ES-0011-189(1)-2	SUB-SECTION-B-CF MEASURING INSTRUMENTS PAGE 3 OF 34														

CLAUSE NO.	TECHNICAL REQUIREMENTS			
2.03.00	Adjustment/ calibration		Using hand held HART calibrator/ centralized PC based system (as applicable).	
	Zero & span adjustment		Continuous temper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.	
	Display		Integral digital display.	
	Load Impedance		500 ohms (minimum).	
	Electromagnetic compatibility		Shall meet EN 61326-1 (1997) and AmdA1, class A equipment/EN 50081-2 & EN 50081-2 & EN 50082-2	
	Mounting		(i) External cage shall be provided where ever side mounting is required. External cage and other mounting accessories to be provided by the contractor. (ii) Where ever top mounting is required, all mounting accessories, stiling well (as required) etc.. shall be provided by the contractor. (iii) All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations.	
	Note: Four wire type transmitters can also be provided for applications where 2- wire transmitter has some technical limitations, subject to employer's approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC.			
	2.03.00 Ultrasonic Type level Transmitter			
	S.No.	Features	Essential/Minimum requirement	
	1.	Type of Transmitter	Non-contact Microprocessor based 2 wire type (loop powered), HART protocol compatible Ultrasonic transmitter.	
	2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol)	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI PART-B BID DOCUMENT NO.: DS-0015-189(V)-2		SUB-SECTION-III-CF MEASURING INSTRUMENTS PAGE 8 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
3.	Accuracy		+/- 0.5% of calibrated span or minimum 5mm	
4.	Power supply		24 V DC +/- 10%	
5.	Temperature compensation		To be provided within transducer.	
6.	Housing		Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.	
7.	Adjustment/calibration/ maintenance		Using hand held HART calibrator/ centralized PC based system (as applicable)	
8.	Zero and Span adjustment		Continuous, tamper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.	
9.	Sensor Material		Corrosion resistant material to suit individual application requirement.	
10.	False signal tolerance		Transmitter shall be capable of ignoring false echoes from internal tank/sumps obstructions such as pipes, heating coils or agitator blades. Also transmitter shall have adjustable damping circuitry.	
11.	Range		Range of transmitter shall be capable of covering the complete level span of tank taking care of blocking distance, frequency attenuation due to surface, obstructions, vapors etc.	
12.	Display		Integral digital display	
13.	Diagnostics		Loss of echo alarm etc.	
14.	Load Impedance		500 ohms (minimum)	
15.	Electrical Connection		Plug and socket	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI PART-B BID DOCUMENT NO.: DS-0015/189(I)-2		SUB-SECTION-B-CF MEASURING INSTRUMENTS PAGE 3 OF 34

22/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	18	Accessories	- All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations. - All mounting accessories required for erection and commissioning shall be provided. - For hazardous area, explosion proof enclosure as described in NEC article 500
Note: 1) Contractor can also provide Radar type transmitter as per above specification in place of ultrasonic transmitter subject to approval by Employer during detailed Engineering. Sonic frequency based transmitters can also be provided under "ultrasonic transmitters" category for fly ash silo level. 2) Four wire type transmitters can also be provided for applications where 2-wire transmitter has some technical limitations, subject to employer's approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC. 3) For applications where transmitter location is not accessible, the transmitter shall have separate sensor unit and electronic unit for such applications. It shall be possible to mount the electronic unit at accessible location.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: ES-0011-189(V)-2	SUB-SECTION-B-CF MEASURING INSTRUMENTS PAGE 8 OF 34

CLAUSE NO.

TECHNICAL REQUIREMENTS

4.00.00

SPECIFICATIONS FOR PR. GAUGE, D.P. GAUGE, TEMP. GAUGE AND LEVEL GAUGE.

Sl. No	FEATURES	ESSENTIAL/MINIMUM REQUIREMENTS		
		Pr. Gauge/ DP Gauge/ Draught gauges	Temperature Gauge	Level Gauge
1	Sensing Element	Bourdon for high pressure, Diaphragm/ Bellow for low pr.	Inert gas actuated/ Liquid filled other than mercury	Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.
2	Material of sensing element	SS 316	SS 316	
3	Material of movement	SS 304	SS 304	
4	Body material	Die-cast aluminium	Die-cast aluminium	Forged carbon steel/304 SS
5	Dial size	150mm	150 mm	Tubular covering entire range
6	End connection	1/2 inch NPT (M)	1/2 inch or 3/4 inch NPT (M).	Process connection as per ASME PTC and drain/vent 15 NB

 FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

 TECHNICAL SPECIFICATION
SECTION-VI, PART-B
BID DOCUMENT NO. CS-0011-109(1)-2

 SUB-SECTION-III-C2
MEASURING
INSTRUMENTS

PAGE 12 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS				एनटीपीसी NTPC
	7	Accuracy	±1% of span	± 1% of span	± 2%
	8	Scale	Linear, 270° arc graduated in metric units	Linear, 270° arc graduated in °C	Linear vertical
	9	Range selection	Shall cover 125% of max operating press	Shall cover 125% of max operating temp	Shall cover max. Operating level
	10	Over range	125% of FSD	125% of FSD	-
	11	Housing	Weather and dust proof as per IP-55	Weather and dust proof as per IP-55	CS/304 SS leak proof
	12	Zero/span adjustment	Provided	Provided	-
	13	Identification	Engraved with service legend or laminated phenolic name plate		
	14	Accessories	Blow out disc, siphon, scrubber, pulsation dampener, chemical seal (if required by process) gauge isolation valve	SS Thermowell	Gasket for all KEL-F shield for transparent type vent and drain valves of Steel/SS as per CS/Alloy process Requirement.
	Notes:-				
	*Bicolour type level gauges will be provided for applications involving steam and water except for condensate and feed water services.				
	Length of gauge glass shall not be more than 1400 mm. If the vessel is higher, multiple gauge glasses with 50 mm overlapping shall be provided.				
	Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.				
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO. CS-0011-109(1)-2		SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 13 OF 34

7/2022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS				
5.00.00	PROCESS ACTUATED SWITCHES				
	FEATURES	ESSENTIAL / MINIMUM REQUIREMENTS			
		Pressure/ Draft Switches/ DP Switches	Temperature switches	Level switches	
	Sensing Element	Piston actuated for high pressure and diaphragm or bellows for low pr/ vacuum	Vapor pressure sensing, liquid filled bellow type with SS bulb and capillary (5 m minimum, to suit application)	Capacitance types, float type, conductivity type, RF type, Ultrasonic type as per suitability to the application.	
	Material	316 SS	Bulb 316 SS/ capillary 304 SS	316 SS	
	End connection	½ inch NPT (F)	½ inch NPT (F)	Manufacturer standard	
	Over range/ proof pressure	150% of maximum operating pr.	-	150% of maximum operating pr.	
	Repeatability	+/- 0.5% of full range			
	No. of contacts	2 No.+2NC, SPDT snap action dry contact			
	Rating of contacts	60 V DC, 6 VA (or more if required by DDCMIS)			
	Elect. Connection	Plug in socket.			
	Set point adjustment	Provided over full range.			
	Dead band adjustment	Adjustable/ fixed as per requirement of application.			
	Enclosure	Weather and dust proof as per IP-55, metallic housing.			
	Accessories	Siphon, snubber, chemical seal, pulsation dampeners as required by process	Thermo well of 316 SS and packing glands	All mounting accessories	
	Mounting	Suitable for enclosure/ rack mounting or direct mounting	Suitable for rack mounting or direct mounting	-	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO. CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS		PAGE 14 OF 34

07/2022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	Power Supply (wherever required)	As per Contractor's Standard practice	
	Notes :- 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice.		
6.00.00	SOLENOID VALVES Solenoid valves shall fulfill the following requirements: - a) Type 2/3/4 way SS 316/ forged brass (depending on the application subject to Employer's approval during detailed engg.) b) Power supply 24v DC. c) Plug in connector connection. d) Insulation : Class "H"		
7.00.00	Limit switches e) Limit switches shall be silver plated with high conductivity and non-corrosive type. Contact rating shall be sufficient to meet the requirement of Fire alarm Control System subject to a minimum of 60V, 6VA rating. Protection class shall be IP-55.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO. CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 13 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS	

10.04.00

pH Analyser

a)	Type	: Cell - flow through
b)	Accuracy	: $< \pm 1\%$ of reading
c)	Range	: 0 - 14 pH freely programmable (For others)
d)	No. of streams	: Single
e)	Temp. compensation	: Automatic

2022/PS-PEM-MAX CLAUSE NO.		TECHNICAL REQUIREMENTS		
1.00.00	GENERAL:			
1.01.00	Actuators shall be designed for valve operation to ensure proper function in accordance with specifications given below and complying to EN15714-2 or equivalent. All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions.			
1.02.00	This sub-section of specification is applicable for following types of electric actuators:			
1.02.01	Modulating duty electric actuators: These shall be provided as per standard practice of OEM of equipment, meeting other requirements of specifications. For specifications of Blade pitch actuators, refer clause no. 5.00.00 of this chapter.			
1.02.02	Electric actuators for valves/ dampers/ gates (other than covered in 1.02.01): These actuators shall be Non-Intrusive type electric actuators. The interface of these actuators with DDCMIS shall be of two types viz. with Hardwired interface and with Fieldbus interface. The common requirements of both these type of actuators are specified at clause 2.00.00, specific requirements of Non-Intrusive hardwired actuators are specified at clause 3.00.00 and specific requirements of Non-Intrusive fieldbus actuators are specified at clause 4.00.00. The applications where these two types of actuators are to be provided is specified in Part-A of Technical Specifications.			
2.00.00	COMMON REQUIREMENTS FOR NON INTRUSIVE ELECTRIC ACTUATORS			
2.01.00	TYPE:			
2.01.01	The actuators shall have integral starters with built in SPP (Single Phasing Preventer). 415 V, 3 phase 3 wire power supply shall be given to the actuator from switch board as applicable through a switch fuse unit. Control voltage of the motor starter shall be 110 V AC / 24 V DC, derived suitably from 415V power supply.			
2.01.02	The actuators shall be Non- Intrusive electric actuator. All actuator settings including torque, limit shall be possible without opening the actuator cover and LCD indication shall be available integral to actuator body.			
2.02.00	RATING: (a) Supply Voltage & frequency: 415V +/- 10%, 3 Phase, 3 Wire & 50HZ +/-5%. (b) Sizing: Open/Close at rated speed against designed differential pressure at 90% of rated voltage. For ON/OFF type: Three successive open-close operations or 15 minutes, whichever is higher. For inching type: 150 starts per hour or required cycles, whichever is higher.			
2.03.00	CONSTRUCTION: (a) Enclosure: Totally enclosed weatherproof, minimum IP-68 degree of protection. (b) Manual Wheel: Shall disengage automatically during motor operation.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS
PAGE 1 OF 4				

MAX		TECHNICAL REQUIREMENTS		एन टी पी सी NTPC	
2.04.00	MOTOR: (a) Type : Squirrel cage induction motor suitable for Direct On Line (DOL)starting. (b) Enclosure: Totally enclosed, self-ventilated. (c) Insulation Class F. Temperature rise 70 Deg C. over 50 Deg C ambient. (d) Bearings: Double shielded, grease lubricated antifriction. (e) Earth Terminals: Two (f) Protection: Single Phasing Protection, Over heating protection through Thermostat (as applicable) and wrong phase sequence protection shall be provided over and above other protection features standard to bidder's design. Suitable means shall be provided to diagnose the type of fault locally.				
2.05.00	POSITION/TORQUE TRANSMITTER: The Position/ Limit measurement shall be done using absolute encoders which will give information of position/ limit in both the directions. Electronic measurement of torque shall be provided.				
2.06.00	LOCAL OPERATION: It shall be possible to operate the actuator locally also. Lockable local/remote selection shall be provided on the actuator.				
2.07.00	LCD DISPLAY: A local LCD display shall be provided to give information regarding actuator alarms, status and valve position indications as a minimum in local.				
2.08.00	WIRING: Suitable voltage grade copper wire.				
2.09.00	TERMINAL BLOCK: For power cables, the grade of TBs shall be minimum 650V.				
2.10.00	ACCESSORIES: All required accessories (if applicable) for calibration / settings/ configuration of various parameters of actuator shall be provided. For quantities, please refer Part A of technical specifications.				
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-III-C-8 ELECTRIC ACTUATORS	
				PAGE 2 OF 4	

2.22/3-ITEM MAX CLAUSE NO.		TECHNICAL REQUIREMENTS		एन टी पी सी NTPC	
2.11.00		SIL CERTIFICATION: All actuators shall be certified for SIL 2 or better.			
3.00.00		SPECIFIC REQUIREMENTS FOR NON INTRUSIVE HARDWIRED ACTUATORS			
3.01.00		INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through hardwired signal only. (a) Open/Close command, open/ close status and disturbance monitoring signal (common contact for Overload, Thermostat, control supply failure, L/R selector switch at local & other protections operated) shall be provided hardwired. (b) The actuator shall be able to accept open/close command at 24V DC with max. 2.5VA load from control system. Accordingly suitable isolated interface in the actuator shall be provided. (c) Open/close command termination logic shall be suitably built inside actuator. (d) For typical wiring diagram Refer Tender Drawing No. 0000-999-POI-A-063 (Except plug & socket connector, if not applicable)			
3.02.00		TERMINAL BOX: Suitable terminals/ connectors, integral to actuator, for terminating instrumentation & power cables shall be provided. Necessary glands for power cables and instrumentation cables shall be provided.			
4.00.00		SPECIFIC REQUIREMENTS FOR NON INTRUSIVE FIELDBUS ACTUATORS			
4.01.00		INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through fieldbus network. (a) Open/ close commands, open/ close feedback status, disturbance signal etc. shall be available to the Control System through the fieldbus network along with diagnostics. The detailed diagnostics including the actuator operating data shall be available to the DDCMIS through the fieldbus network. (b) All actuators shall be Foundation Fieldbus/ Profibus compatible. However the exact protocol shall be based on finalized protocol of DDCMIS. If Profibus DP protocol is envisaged then actuator shall have two (redundant) Profibus DP ports for connecting the redundant Profibus DP cables. That is if one profibus cable is cut or not working/ not available, then complete actuator functionality shall be available through the second redundant cable without any manual intervention. (c) Open/close command termination logic shall be suitably built inside actuator.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS	
				PAGE 3 OF 4	

022/PS-PEM-MAX			
CLAUSE NO.	TECHNICAL REQUIREMENTS		
4.02.00	TERMINAL BOX: Suitable terminals/ connectors, integral to actuator, for terminating fieldbus cables and power cables shall be provided. Necessary glands for power cables and armored fieldbus cables shall be provided.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS
			PAGE 4 OF 4

022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	CONTROL VALVES, ACTUATORS & ACCESSORIES		
1.00.00	CONTROL VALVES & ACCESSORIES		
1.01.00	General Requirements		
1.01.01	The control valves and accessories equipment furnished by the Bidder shall be designed, constructed and tested in accordance with the latest applicable requirements of code for pressure piping ANSI B 31.1, the ASME Boiler & pressure vessel code, Indian Boiler Regulation (IBR), ISA, and other standards specified elsewhere as well as in accordance with all applicable requirements of the "Federal Occupational Safety and Health Standards, USA" or acceptable equal standards. All the Control Valves, their actuators and accessories to be furnished under this Sub-section will be fully suitable and compatible with the modulating loops covered under the Specification.		
1.01.02	All the control valves and accessories offered by the Bidder, shall be from reputed, experienced manufacturers of specified type and range of valves.		
1.02.00	CONTROL VALVE SIZING & CONSTRUCTION		
1.02.01	The design of all valve bodies shall meet the specification requirements and shall conform to the requirements of ANSI (USA) for dimensions, material thickness and material specification for their respective pressure classes.		
1.02.02	The valve sizing shall be suitable for obtaining maximum flow conditions with valve opening at approximately 80% of total valve stem travel and minimum flow conditions with valve stem travel not less than 10% of total valve stem travel. All the valves shall be capable of handling at least 120% of the required maximum flow. Further, the valve stem travel range from minimum flow condition to maximum flow condition shall not be less than 50% of the total valve stem travel. The sizing shall be in accordance with the latest edition of ISA handbook on control valves. While deciding the size of valves, Bidder shall ensure that valves trim exit outlet velocity as defined in ISA handbook does not exceed 8 m/sec for liquid services, 150 m/sec. for steam services and 50% of sonic velocity for flashing services. Bidder shall furnish the sizing calculations clearly indicating the outlet velocity achieved with the valve size selected by him as well as noise calculations, which will be subject to Employer's approval during detailed engineering.		
1.02.03	Control valves for steam and water applications shall be designed to prevent cavitation, wire drawing, flashing on the downstream side of valve and down stream piping. Thus for cavitation/flashing service, only valve with anti cavitation trim shall be provided. Detailed calculations to establish whether cavitation will occur or not for any given application shall be furnished.		
1.02.04	Control valves shall have leakage rate as per leakage Class-IV.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-108(1A)-2	SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES PAGE 1 OF 5

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
1.02.05	The control valve induced noise shall be limited to 85 dBA at 1 meter from the valve surface under actual operating conditions. The noise abatement shall be achieved by valve body and trim design and not by use of silencers.			
2.00.00	VALVE CONSTRUCTION			
2.01.00	All valves shall be of globe /Butterfly body design & straightaway pattern with single or double port, unless other wise specified or recommended by the manufacturer to be of angle body type. Rotary valve may alternatively be offered when pressure and pressure drops permit.			
2.02.00	Valves with high lift cage guided plugs & quick-change trims shall be supplied.			
2.03.00	Cast Iron valves are not acceptable.			
2.04.00	Bonnet joints for all control valves shall be of the flanged and bolted type or other construction acceptable to the Employer. Bonnet joints of the internal threaded or union type will not be acceptable.			
2.05.00	Plug shall be of one-piece construction cast, forged or machined from solid bar stock. Plug shall be screwed and pinned to valve stems or shall be integral with the valve stems.			
2.06.00	All valves connected to vacuum on down stream side shall be provided with packing suitable for vacuum applications (e.g. double vee type chevron packing)			
2.07.00	Valve characteristic shall match with the process characteristics.			
2.08.00	Extension bonnets shall be provided when the maximum temperature of flowing fluid is greater than 280 deg. C.			
2.09.00	Flanged valves shall be rated at no less than ANSI press class of 300 lbs.			
3.00.00	VALVE MATERIALS Refer mechanical sections for body and trim materials. The exact body and trim materials shall be finalised during detailed engineering depending on the service applications. However, Bidder may offer valves with body and trim materials better than specified materials and in such cases Bidder shall furnish the comparison of properties including cavitation resistance, hardness, tensile strength, strain energy, corrosion resistance and erosion resistance etc. of the offered material vis-a-vis the specified material for Employer's consideration and approval.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-108(1A)-2	SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES	PAGE 2 OF 5

022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS			
4.00.00	END PREPARATION Valve body ends shall be either butt welded/socket welded, flanged (Rubber lined for condensate service) or screwed as finalised during detailed engineering and as per Employer's approval. The welded ends wherever required shall be butt welded type as per ANSI B 16.25 for control valves of sizes 65 mm and above. For valves size 50 mm and below welded ends shall be socket welded as per ANSI B 16.11. Flanged ends wherever required shall be of ANSI pressure-temperature class equal to or greater than that of the control valve body.			
5.00.00	VALVE ACTUATORS All Control Valves shall be furnished with Pneumatic Actuators. The Bidder shall be responsible for proper selection and sizing of valve actuators in accordance with the pressure drop and maximum shut off pressure and leakage class requirements. The valve actuators shall be capable of operating at 60 deg C continuously. Valve actuators and stems shall be adequate to handle the unbalanced forces occurring under the specified flow conditions or the maximum differential pressure specified. An adequate allowance for stem force, at least 0.15 Kg/sq.cm. per linear millimeter of seating surface, shall be provided in the selection of the actuator to ensure tight seating unless otherwise specified. The travel time of the pneumatic actuators shall not exceed 10 seconds.			
6.00.00	CONTROL VALVE ACCESSORY DEVICES			
6.01.00	All pneumatically actuated control valve accessories such as air locks, hand wheels/hand-jacks, limit switches, Microprocessor based Positioner, diffusers, external volume chambers, position transmitters (capacitance or resistance type only), reversible pilot for Positioner, tubing and air sets, solenoid valves and junction boxes etc. shall be provided as per the requirements.			
7.00.00	SPECIFICATIONS FOR MICROPROCESSOR BASED POSITIONERS			
	1	Electrical	a) Input signal	4-20 mA
			b) Power Supply	Loop powered from the output card of control system.
			c) Hart Protocol	Compatibility for remote calibration & diagnostics (Super-imposed Hart signal on input signal (4-20 mA))
			d) Valve position sensing	Non contact type position sensing with 4-20 mA output signal
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-108(1A)-2		SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES
PAGE 3 OF 5				

963437/2022/PS-PEM-MAX

022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS					
	2	Environment	a) Operating Temp	(-)30 To 80 Deg. C		
			b) Humidity	0-95 %		
			c) Protection Class	IP-65 Minimum		
	4	Test reports/certificates	Factory Valve Signature Tests reports (Pr vs Valve travel and Travel vs I/P signal) are to be provided.			
			Test certificates as per Manufacture Standard/Relevant Standard are To Be Submitted			
	5	Configuration/calibration	Remote calibration, Auto & Manual calibration shall be possible. Universal HART Calibrator to be provided.			
	6	Operating	Operating Range	Full range & split range signal.		
	7	Modes	Valve Action	Direct & Reverse valve action(selectable)		
			Flow Characterization	Possible to fit valve characteristic curve - Linear & Equal Percentage.		
	8	Fail Safe/Fail Freeze	Fail safe/Fail freeze feature is to be provided. (In case, the fail freeze feature is not intrinsic to the positioner, Bidder shall achieve the same externally through solenoid valve connected in the pneumatic circuit).			
	9	Pneumatic	Air capacity	Sufficient to handle the valves selected/boosters to be supplied if required.		
			Air supply pressure	To suit air supply pressure/quality available		
Process connection			1/4 inch NPT			
10	Electrical Cable Entry	1/2-NPT, side or bottom entry to avoid water ingress.				
11	Performance	Characteristic Deviation	<=0.5 % Of Span			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-108(1A)-2		SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES	PAGE 4 OF 5	

2022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS			
			Ambient Temp Effect	<=0.01 %/Deg C Or Better
	12	EMC & CE Compliance	Required To International Standard Like EN/IEC.	En50081-2& En50082 Or Equivalent
	13	Accessories	In-built operator panel	Display with push buttons for configuration and display on the Positioner itself (password protected/hardware lock).
			Press gauge block	For supply & output pressure.
			Mounting assembly	On as required basis.
8.00.00	TEST AND EXAMINATION All valves shall be tested in accordance with the quality assurance programme agreed between the Employer and Contractor, which shall meet the requirements of IBR and other applicable codes mentioned elsewhere in the specifications. The tests shall include but not be limited to the following: 8.01.00 Non Destructive Test as per ANSI B-16.34. 8.02.00 Hydrostatic shell test in accordance with ANSI B 16.34 prior to seat leakage test. 8.03.00 Valve closure test and seat leakage test in accordance with ANSI-B 16.34 and as per the leakage class indicated above. 8.04.00 Functional Test: The fully assembled valves including actuators control devices and accessories shall be functionally tested to demonstrate times from open to close position. 8.05.00 CV Test: Refer Cl.no 3.00.00 (8) Subsection IIIC-06 (Type test requirements)			
9.00.00	CONTROL VALVE QUANTITIES Bidder shall furnish all the control valves under this package as finalised during detailed engineering stage without any price repercussions whatsoever depending on the process requirements. All the control valves provided by the Bidder for this project shall meet the specifications requirements specified herein. Specification for control valves in this Sub-section has to be read in conjunction with other relevant Sub-sections of this specification.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-108(1A)-2		SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES
PAGE 5 OF 5				

CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.00.00	CONTROL DESK & PANELS			
1.01.00	GENERAL			
1.01.01	All control desk, panels, LVS panel etc. shall be furnished fully wired with necessary provision for convenience outlets, internal lighting, grounding, ventilation, space heating, anti vibration pads, internal piping & accessories as required for completeness of the system.			
1.01.02	All panels, desks, cabinets shall be free standing type & have bottom / top entry for cables to be finalised application wise during detailed engineering stage. The bottom of desk & cabinets shall be sealed with bottom plate, compression cable glands (double for field and single for inside rooms) and fire proof sealing material to prevent ingress of dust and propagation of fire. Sufficient number of power receptacles with disconnect switches shall be installed within all panels/desk.			
1.01.03	Exterior steel surface shall be sand blasted, ground smooth, filled, primed, sanded and smooth enamel painted to give a good finish subject to minimum paint thickness of 65-75 microns for sheet thickness of 3 mm and 50 microns for sheet thickness of 2mm. The exact color shall be finalised during detailed engineering.			
1.01.04	The design shall conform to the EN ISO 11064 (Ergonomical design of control room), Part-1,2 and 3.			
2.00.00	CONTROL DESK & PANEL			
2.01.00	GENERAL			
2.01.01	The exact dimensions, material, construction details, grounding, general arrangement etc. of Control Desk etc. shall be as per the actual requirement and shall be finalised during detailed engineering and subjected to Employer's Approval.			
2.01.02	For control desk mounted instruments/ devices etc., which are to be powered from UPS, all required conversion of interface equipments / accessories to make such devices compatible with UPS supply shall be provided. All necessary hardware like Input switches/ fuse unit for each feeder as well as switch fuse unit for each instrument/ device on the power supply line shall be provided. From UPS, redundant feeders shall be provided with suitably rated MCB and provision of fast auto changeover of UPS feeders.			
2.02.00	Control Desk (CD)			
2.02.01	Control desk shall be Modular, non-welded construction free standing table top type with front & back cover constructed of 1.6 mm thick CRCA steel plates. The tabletop of the control desk shall be arc-shaped for mounting TFT monitors & mice. The work surface of control desk shall be 30mm thick with the top 12mm of Acrylic Solid Surface (ASS) and the remaining 18mm of laminated medium density fiber board. Work surface shall be made of two different colors at same level and seamlessly joined in each section. The structure frame shall consist of extruded aluminum top and bottom horizontal beams and vertical support tensioned together to form an integrated, finished curvilinear shaped frame. Vertical & Horizontal supports, minimum 2.5mm and 2mm thick respectively, have to be provided for the structure frame. Extreme side legs shall be illuminated type and should complete the			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIC-9 CONTROL DESK & PANELS	PAGE 1 OF 3

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	overall form and aesthetics of the desk. It shall have concealed cable & wire way management system. Telephone sets shall be mounted on the control desk. Sliding keyboard trays shall be provided on the CD. The exact profile of the desk, dimension and the radius of curvature shall be finalised during detailed engineering stage.			
2.02.02	All operator monitors & mice shall be mounted on this CD.			
2.02.03	The cabling / wiring between OWS & CPU's, power supply cables etc. shall be aesthetically routed and concealed from view.			
2.03.00	Internal Panel/Desk Items Equipment and devices mounted within the panels/desk shall be mounted on suitable racks/brackets and shall be arranged for convenient access for adjustment and maintenance work.			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIC-9 CONTROL DESK & PANELS	PAGE 2 OF 3



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 1 OF 6

1.0 SCOPE

This specification covers the Design, Manufacture, Inspection and Testing at the manufacturer's works, proper packing for transportation and delivery to site, **supervision, erection, and commissioning at site** of Local Panels required for control and monitoring of the Auxiliary Plant & Equipment.

2.0 CODES AND STANDARDS

2.1 All the equipments specified herein shall comply with the requirements of the latest issue of the relevant National and International standards.

2.2 As a minimum requirement, the following standards shall be complied with:

- a) IS-6005 : 1998 : Code of practice for phosphating of iron and steel.
- b) IS-5 : 2007 : Colors for ready mixed paints and enamels.
- c) IS-1248:2003 : Direct Acting Indicating Analog Elec Measuring Instruments.
- d) IS/IEC 60947:Part 1:2004 : Low Voltage switchgear & control gear: Part-I (General Rules)
- e) IS-8828:1996 : Circuit breaker for household and similar installations.
- f) IS-13947 (Part-I):1993 : Low Voltage switchgear & control gear : Part-I (General Rules)
- g) ISA-18.1:1979 : Annunciator Sequences and Specification
- h) NFPA-496:2003 : Purged & Pressurised Enclosure for Electrical Equipment in Hazardous Locations.

3.0 TECHNICAL REQUIREMENTS

3.1 Panel Construction

3.1.1 The local panels shall house the secondary instruments, annunciation system, Single loop controller, Control switches / push buttons, indicating lamps/**LED cluster**, relays, timers and other devices required for operation and monitoring of the equipment locally.

3.1.2 The panels shall be of free standing type either welded construction on angle iron (minimum section of 50 x 50 x 4 mm) structure or folded construction by sheet metal formation depending upon the equipments to be mounted on it. The panels shall be robustly built and **stiffeners** as necessary shall be provided.

3.1.3 The panel shall be suitably reinforced to ensure adequate support for all instruments mounted thereon. All welds on exposed panel surfaces shall be ground smooth.

3.1.4 The salient features of construction shall be:

Sheet material: Cold rolled sheet steel

Frame thickness: Not less than 3.0mm

Enclosure thickness: Not less than 2.5 mm for load bearing sections (Mounted with instruments)
1.6 mm for doors and Not less than 2.0 mm for others

Gland plate thickness: 3.0mm

Base channel: ISMC 100 with anti-vibration mounting & foundation bolts.

3.1.5 The panel shall be provided with rear doors with integral lockable handle. The door when locked shall be held at minimum three places. The door width shall not be more than 550mm. The doors shall be provided with suitable **stiffeners** to prevent buckling. The handle shall be on the right side of the door. The door shall be removable type with concealed hinges to facilitate maintenance work. Suitable pocket inside the door shall be provided for keeping the drawings / documents. **Double door shall be provided with suitable glass windows, as per the requirement.**

3.1.6 Suitable neoprene gasket shall be provided on all doors and removable covers. Suitable ventilation **system along with louvers** shall be provided at bottom and top of the doors covered with removable wire mesh.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 2 OF 6

- 3.1.7 The class of protection shall be in accordance with IP-42 unless otherwise specified in the data sheet – A (No. PES-145-54A-DS1-0).
- 3.1.8 All steel surfaces shall be cleaned by sand / pellet blasting, treated for pickling, degreasing and phosphating etc. by seven tank method. The panel shall have a high quality finish and appearance. The panel shall be painted with two coats of primer followed by two coats of epoxy / synthetic enamel based final paint of color shade and finish as given in data sheet-A (No. PES-145A-DS1-0). Minimum thickness of the paint shall be 85 microns for external paint and 70 microns for internal paint.
- 3.1.9 The cable glands of the required size and type as given in data sheet-A (No. PES-145A-DS1-0) shall be supplied alongwith the Panel.
- 3.1.10 All operable and indicating devices shall be mounted on the front of the panel while aux. Relays / timers MCBs etc. required for realization of control logics shall be mounted on a mounting plate inside the panel. Auxiliary relays and timers etc. shall be grouped according to the control function. No operable or indicating devices shall be mounted below 750 mm and above 1800 mm (w.r.t. finished ground level). The devices shall be located in such a way so as to ensure easy access for operation / maintenance.
- 3.1.11 Single / dual control power supply feeders of voltage class as specified in data sheet-A (No. PES-145A-DS1-0) shall be provided by the purchaser. In case redundant power supply feeders are provided then auto changeover unit shall be mounted on the panel are in the panel supplier's scope. Where DC control power supply is specified an additional 240V, 50 Hz AC supply feeder for powering of space heater and lighting shall be provided by the purchaser. Suitable arrangement shall be provided inside the panel to receive and terminate the power supply feeder(s). For this purpose MCBs of suitable current rating shall be provided by the vendor. A supervisory relay along with a pilot lamp to indicate control supply 'ON' shall be provided on the panel. Any other power supply required for the operation of the devices mounted in the panel shall be arranged by the vendor.
- 3.1.12 The internal wiring shall be carried out with 1100 volt grade PVC insulated copper multi strand wire / flexible of 1.5mm² size. AC & DC wires shall be kept separate from each other. Separate coloured wires to be used for AC and DC circuits. All wires shall be properly numbered and identified with ferrules as per the Control scheme / wiring diagram. Wires shall be routed and run through PVC troughs.
- 3.1.13 Terminal blocks shall be clip on type, 1100 volts grade. Separate terminal blocks shall be used for AC & DC circuits. The terminals shall be suitable for terminating 0.5 mm² to 2.5mm² external cables. **The TB points in terminal block shall be cage clamp type / screw type.** The terminal for ammeters shall be provided with removable links for shorting CTs. Each terminal strip shall be provided with identification strip. The terminal shall not be mounted below 250 mm **height from finished floor. The panel shall have ten (20) percent spare terminal.**
- 3.1.14 The interior of each panel shall be suitably illuminated through fluorescent **lamps / tube lights with shrouded cover of minimum 15W** operable on 240V 50 Hz AC power supply through panel door switch. A 15 Amp. 3-pin Power receptacle shall be provided.
- 3.1.15 Suitable space heaters operable on 240 Volts 50 Hz AC power system shall be provided at the panel bottom. These shall be designed to maintain the panel temperature five (5) deg. C above the ambient temperature during maintenance shutdown. Suitable isolating and control devices comprising of MCB, thermostat etc. shall be provided for the space heater.
- 3.1.16 The panel shall be provided with a copper earth bus of 25 x 6 mm size running throughout the width of the panel. It shall be terminated internally with 10 mm bolts at extreme ends for connection to; main station earth. The panel mounted equipments / devices shall be connected to earth bus through green coloured PVC insulated stranded copper conductor of 2.5 mm² size.
- 3.1.17 Local Panel shall be provided with main name plate of 150 mm x 40 mm size having inscription of 20 mm height. The individual devices on the panels shall be as provided with separate name plate with inscription of 3 mm height. The instrument / devices shall be provided with stick on label plates inside the panel. The material of the main and individual labels shall be three (3) ply 3 mm thick Traffolyte



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 3 OF 6

Sheet / 2 mm Anodised Aluminium Plate. The inscription shall be with white letters on black background on traffolyte sheet. The labels shall be fixed by self tapping non-rusting screws.

3.1.18 Vendor shall furnish electric load and heat load list (in case panel is to be placed in ac environment) of each panel.

3.2 Hazardous Area Panel Requirement

3.2.1 The Local Panel located in hazardous area shall be pressurized as per NFPA-496 requirements to render it non-hazardous. Alarms shall be provided for local and remote annunciation when pressurisation falls below 2.5 mm of water column. Protection shall be of type Z of NFPA-496. It shall not be possible to switch ON the power of purged section unless it is purged as per the recommendation of NFPA-496. Vendor must provide a protective device on the panel to protect the panel from over pressurisation.

3.2.2 Vendor shall supply pressurisation kit consisting of valves, restriction orifices, dual filter regulation, pressure gauges, pressure switches, rotameter etc. Pressurisation kit shall be surface mounting on a metal board and located outside the local panel. Pressurisation kit shall further consist of solenoid valve flow switch, timer blow off safety device etc., so as to make purging fully automatic. However final start shall be manual. Panel protection against over pressure to be provided as per NFPA-496.

3.2.3 Pressurised local control panel pressurization kit assembly design shall provide minimum leakage flow through the Local Control Panel. Panel venting shall be as per NFPA-496.

3.2.4 All components in the local panel like indicating instruments, push buttons switches, lamps etc., which are required to be energized without panel pressurization or before completion of purge cycle shall be explosion proof as per NEMA-7 & suitable for area classification.

3.2.5 All push buttons etc. requiring frequent operation during machine running shall have good positive sealing. Weatherproof housing or cover to be provided wherever necessary. Vendor shall provide pressurisation bypass switch outside explosion proof enclosure of pressurized panel with lamp indication. This shall be used only during maintenance. All hinges, screws, other non-painted metallic parts shall be of stainless steel material.

3.2.6 Provision to switch off manually all types of power shall be provided in the panel. In addition, it shall also be possible to switch off power circuits / components which are powered from motor control centre or control room manually in case of pressurization failure. All such cables from MCC and main control room shall be terminated in explosion proof boxes (NEMA-7).

3.3 Control & Monitoring devices

3.3.1 Instruments like Indicators, recorders, single loop controllers etc. as applicable and specified elsewhere for the plant / equipment shall be supplied and mounted on the panel.

3.3.2 Alarm Annunciator System

It shall be solid state discrete facia type having a sequence of ISA-S18.1A or as specified, opaque facia windows of 70 mm x 50 mm size, having two (2) lamps per window, and hooter of 10W, and provision for repeat group alarm at remote. The annunciator shall be provided with ten (10) percent spare windows or minimum two (2) windows along with electronics.

3.3.3 Relays

The relays shall be electromagnetic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable. There shall be ten (10) percent spare contacts.

3.3.4 Timers

The timers shall be electronic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However, minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 4 OF 6

3.3.5 Control / Selector Switches

Switches shall be Rotary Cam type with minimum of 5 Amps AC & 2 Amp DC continuous current rating. Selector switches shall be stay put type while control switches shall be spring-return-to-neutral type. Contact configuration and rating shall be as per the control function requirement. The switches shall be lockable type wherever specified. Each switch shall be provided with engraved plates indicating the switch position / functions.

3.3.6 Push Buttons / Indicating Lights

The push buttons shall be momentary action self-resetting type, however stop P.B. for unidirectional drives shall be provided with manual reset facility. Its contact configuration & rating shall be as required for the control function but minimum 2 NO + 2 NC of 5 Amp. AC rating. It shall have round coloured projecting tab and engraved escutcheon plate / inscription plate. Colour coding of push buttons shall be as under:

RED	Motor OFF / Valve CLOSE	YELLOW	Alarm acknowledge	Left Hand Side
GREEN	Motor ON / Valve OPEN	BLACK	Lamp test	Right Hand Side

Indicating lights shall be suitable for direct connections across specified power supplies. It shall be fitted with built in resistance to prevent circuit tripping on shorting of lamp filament. It shall be fitted with LED cluster type lamp replaceable from front.

GREEN	Motor OFF / Valve CLOSED condition	AMBER	Motor tripped	Left Hand Side
RED	Motor ON / Valve OPEN condition	WHITE	Normal / healthy	Right Hand Side

3.3.7 Ammeters

Ammeter shall be 96 x 96 mm size, 90 deg. deflection, 1.5% accuracy, 1 Amp. CT operated or with 4-20mA input and Flush mounting type as called for in the data sheet-A (No. PES-145-54A-DS1-0). Ammeters for motors shall have six (6) times folded scale at upper end to enable motor starting current indication

3.3.8 Miniature Circuit Breaker (MCB)

These shall be instantaneous magnetic trip type for short circuit in addition to current time inverse delayed thermal trip feature for over current protection. The housing of MCB shall be made of non-ignitable, high impact material. It shall have minimum short circuit rating of 9 KA for AC Voltages and 4 KA for DC Voltages.

3.3.9 Makes of various instruments / devices shall be as given below

1.	Alarm Annunciators	:	Procon / IIC
2.	Ammeters	:	AEP / IMP
3.	Control / Selector Switches	:	Alsthom / Kaycee / Siemens / L&T
4.	Push Buttons / Indicating Lamps	:	Siemens / L&T / Teknic / Alsthom
5.	Auxiliary Relays	:	Jyoti / Siemens / L&T / OEN
6.	Timers	:	L&T / Alsthom / Bhartiya Cutler Hammer
7.	MCBs	:	S&S Power Engg. / Indo Asian / MDS
8.	Terminal Blocks	:	Jyoti / Elmex

4.0 TESTING AND INSPECTION

4.1 The bidder shall adopt suitable quality assurance program to ensure that the equipments offered will meet the specification requirements in full.

4.2 BHEL's standard Quality Plan for LCP is enclosed with the specification. The bidder shall furnish his acceptance to BHEL's QP and submit the signed and stamped copy of QP along with the offer.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS –999- 145 –054A	
VOLUME	II B
SECTION	D
REV. NO. 03	DATE : 16-09-2013
SHEET	5 OF 6

4.3 The vendor shall conduct the following tests as a minimum requirement:

4.3.1 Routine Tests

1. High Voltage (H.V.)
2. Insulation Resistance (I.R.)
3. Functional

4.3.2 Type Tests

1. Enclosure Class Test



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 6 OF 6

5.0 SPARES AND CONSUMABLES

5.1 Commissioning Spares and consumables

The bidder shall supply all commissioning spares and consumables 'as required' during Start-up, as part of the main equipment supply.

5.2. Mandatory Spares

The bidder shall offer alongwith main offer, the Mandatory Spares as specified elsewhere in the specification. The Mandatory Spares offered shall be of the same make and type as the main equipment.

5.3. Recommended Spares

The bidder shall furnish a list of Recommended Spares indicating the normal service expectancy period and frequency of replacement; quantities recommended for 3 years operation alongwith unit rate against each item to enable BHEL/BHEL's Customer to place a separate order later, if required.

6.0 DRAWINGS AND DOCUMENTS

6.1 The bidder shall furnish the following documents in required number of copies along with the bid :

1. Data Sheet no. PES-145A-DS1-0
2. General Arrangement Drawing.
3. Catalogue and technical information for instruments and devices.
4. Quality Plan.

6.2 The vendor shall furnish the following documents in required number as agreed after the award of contract:

1. Data Shee No. PES-145A-DS2-0
2. GA Drawing indicating layout of instruments, construction details, foundation details, cable gland plate alongwith cable glands and all details mentioned in this specification.
3. Control Schematic Diagram along with grouping of different terminals for various functions.
4. Catalogue and technical information for instruments and devices with selected options clearly marked.
5. O&M Manuals.
6. "As Built" Drawing.
7. CDs.

7.0 MARKING AND PACKING

7.1 Panel with all instruments / devices mounted on it shall be suitably packed & protected for the entire period of despatch, storage and erection against impact, abrasion, corrosion, incidental damage due to vermin, sunlight, high temperature, rain moisture, humidity, dust, sea-water spray (where applicable) as well as rough handling and delays in Transit and storage in open.


8.0 APPLICABLE DATA SHEET FORMS

This document shall be read with one or more of the following data sheet forms :

- Data sheet A&B for Local Panels : Data sheet no. PES-145A-DS1-0
- Data sheet C for Local Panels : Data sheet no. PES-145A-DS2-0

963437/2022/PS-PEM-MAX


This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

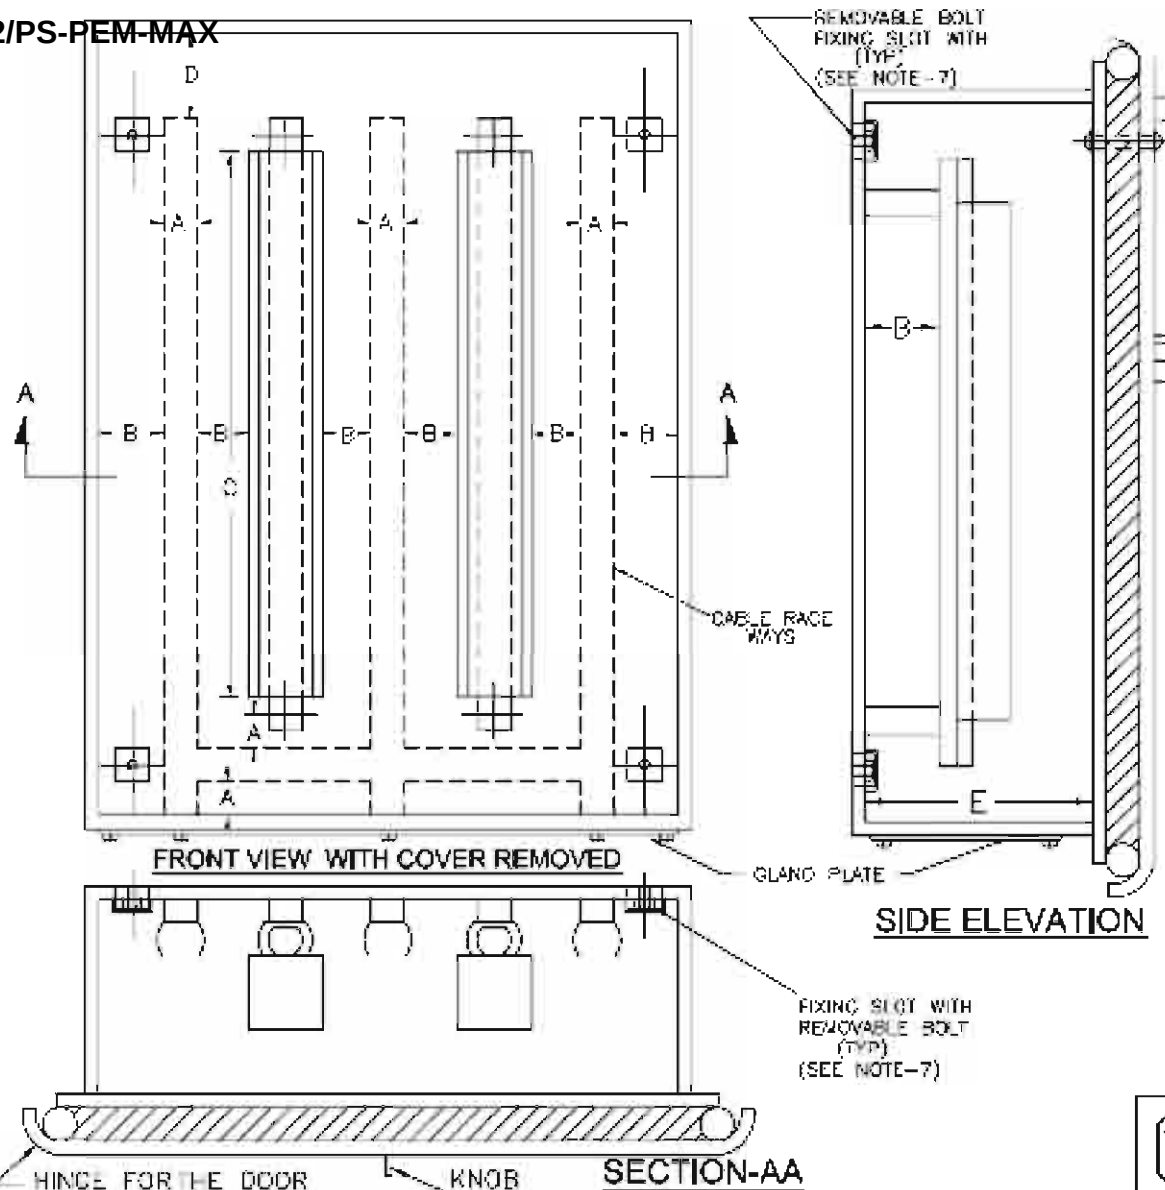

FOR TENDER PURPOSE ONLY

 एन टी सी
NTPC
NTPC LIMITED
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION

												PROJECT TYPICAL THERMAL POWER PLANT			
D	GENERALLY REVISED		JW	KS							21.08.12	TITLE			
C	GENERALLY REVISED		JW	KS							24.08.09	G.A. OF JUNCTION BOX			
B	GENERALLY REVISED	S.K.	A.R	PS											
A	FIRST ISSUE	S.K.	A.R	PS							24.06.03				
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPRO	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
												A4	N.T.S.	0000-999-POI-A-017	D
This page is the part of Tech. Spec. No. PE-TS-466-571-A102															

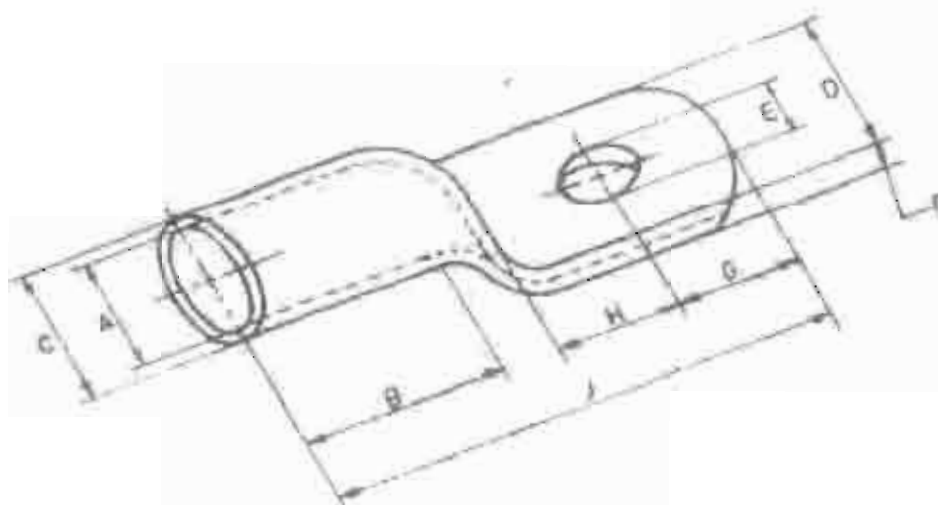

S.No.	Conductor Size HT Power Cables	E (Dimensions in mm)
1	95 sq.mm	13
2	150 sq.mm	17
3	300 sq.mm	17

[illegible]



**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**

SECTION: C
SUB SECTION: C&I

**INSTRUMENTATION CABLE,
CABLE INTERCONNECTION AND
TERMINATION PHILOSOPHY**

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC													
1.00.00	INSTRUMENTATION CABLE, CONTROL & POWER SUPPLY CABLE, INTERNAL WIRING AND ELECTRICAL FIELD CONSTRUCTION MATERIAL (CABLE SUB-TRAYS ETC)														
1.01.00	General requirements														
1.01.01	All cables including special cables, internal wiring and electrical field construction material shall conform to this specification, Employer approved detail engineering drawings & documents and the latest edition of the relevant standards & guidelines. The Bidder shall furnish all material and services required for the completeness of the work identified in his scope as per this specification.														
1.01.02	The Contractor shall supply, erect, terminate and test all instrumentation cables for control and instrumentation equipment/devices/systems included under Contractor's scope and ensuring completeness of the control system.														
1.01.03	Any other application where it is felt that instrumentation cables are required due to system/operating condition requirements, are also to be provided by Contractor.														
1.01.04	Other type of cables like fiber optic/co-axial cables for system bus, cables for connection of peripherals etc. (under Contractor's scope) are also to be furnished by the Contractor.														
1.01.05	Contractor shall supply all cable erection and laying hardware from the main trunk routes like branch cable trays/sub-trays, supports, flexible conduits, cable glands, lugs, pull boxes etc. on as required basis for all the systems covered under this specification.														
1.01.06	Wherever the quantity has been defined as on as required basis, the same are to be furnished by contractor on as required basis within his quoted lump sum price without any further cost implication to the Employer.														
2.00.00	SPECIFICATION OF INSTRUMENTATION CABLE														
2.01.00	Common Requirements														
	<table><tr><th>S. No.</th><th>Property</th><th>Requirement</th></tr><tr><td>1</td><td>Operating Voltage</td><td>225 V (peak value)</td></tr><tr><td>2</td><td>Codes and standard</td><td>All instrumentation cables shall comply with VDE 0815, VDE 0207, Part 4, Part 5, Part 6, VDE 0816, VDE 0472, SEN 4241475, ANSI MC 96.1, IS-8784, IS-10810 (latest editions) and their amendments read along with this specification.</td></tr><tr><td>3</td><td>Continuous operation suitability</td><td>At 205 Deg C for Type-C cables & heat resistant cables, at 70 Deg C for all other type of cables.</td></tr></table>	S. No.	Property	Requirement	1	Operating Voltage	225 V (peak value)	2	Codes and standard	All instrumentation cables shall comply with VDE 0815, VDE 0207, Part 4, Part 5, Part 6, VDE 0816, VDE 0472, SEN 4241475, ANSI MC 96.1, IS-8784, IS-10810 (latest editions) and their amendments read along with this specification.	3	Continuous operation suitability	At 205 Deg C for Type-C cables & heat resistant cables, at 70 Deg C for all other type of cables.		
S. No.	Property	Requirement													
1	Operating Voltage	225 V (peak value)													
2	Codes and standard	All instrumentation cables shall comply with VDE 0815, VDE 0207, Part 4, Part 5, Part 6, VDE 0816, VDE 0472, SEN 4241475, ANSI MC 96.1, IS-8784, IS-10810 (latest editions) and their amendments read along with this specification.													
3	Continuous operation suitability	At 205 Deg C for Type-C cables & heat resistant cables, at 70 Deg C for all other type of cables.													
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 1 OF 13												

CLAUSE NO.	TECHNICAL REQUIREMENTS				एनटीपीसी NTPC																																							
	S. No.	Property	Requirement																																									
	4.	Marking - a. Progressive automatic on-line sequential marking of length in meters to be provided at every one meter on outer sheath b. Marking to read 'FRLS' to be provided at every 5 meters on outer sheath except for Type-C cable c. Durable marking at intervals not exceeding 625 mm shall include manufacturer's name, insulation material, conductor's size, number of pairs, voltage rating, type of cable, year of manufacturer to be provided on outer sheath.																																										
	5.	Allowable Tolerance on overall diameter	+/- 2 mm (maximum) over the declared value in data sheet																																									
	6.	Variation in diameter	Not more than 1.0 mm throughout the length of cable.																																									
	7.	Ovality at any cross-section	Not more than 1.0 mm																																									
	8.	CAGE-CLAMP suitability	To be provided																																									
	9.	Color	The outer sheath shall be of blue color.																																									
	10.	Others	Repaired cables shall not be acceptable.																																									
	2.02.00	Specific Requirements																																										
	<table><tr><th>Specification Requirements</th><th>Type-A cable</th><th>Type-B cable</th><th>Type F & G cable</th><th>Type-C cable</th></tr><tr><td colspan="5">A. CONDUCTORS</td></tr><tr><td>Cross section area</td><td colspan="4">0.5 sq. mm</td></tr><tr><td>Conductor material</td><td>ANSI type KX</td><td>ANSI type SX</td><td>Annealed bare copper</td><td>ANSI type KX</td></tr><tr><td>Colour code</td><td>Yellow-Red</td><td>Black-Red</td><td>As per VDE-815</td><td>Yellow-Red</td></tr><tr><td>Conductor Grade</td><td colspan="2">As per ANSI MC 96.1</td><td>Electrolytic</td><td>As per ANSI MC 96.1</td></tr><tr><td>No & dia of strands</td><td colspan="4">7x0.3 mm (nom)</td></tr><tr><td>No. of Pairs</td><td>2</td><td>2</td><td>2/4/8/12/16/24 / 48</td><td>2</td></tr></table>					Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable	A. CONDUCTORS					Cross section area	0.5 sq. mm				Conductor material	ANSI type KX	ANSI type SX	Annealed bare copper	ANSI type KX	Colour code	Yellow-Red	Black-Red	As per VDE-815	Yellow-Red	Conductor Grade	As per ANSI MC 96.1		Electrolytic	As per ANSI MC 96.1	No & dia of strands	7x0.3 mm (nom)				No. of Pairs	2	2	2/4/8/12/16/24 / 48
Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable																																								
A. CONDUCTORS																																												
Cross section area	0.5 sq. mm																																											
Conductor material	ANSI type KX	ANSI type SX	Annealed bare copper	ANSI type KX																																								
Colour code	Yellow-Red	Black-Red	As per VDE-815	Yellow-Red																																								
Conductor Grade	As per ANSI MC 96.1		Electrolytic	As per ANSI MC 96.1																																								
No & dia of strands	7x0.3 mm (nom)																																											
No. of Pairs	2	2	2/4/8/12/16/24 / 48	2																																								
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 2 OF 13																																							

CLAUSE NO.	TECHNICAL REQUIREMENTS				एनटीपीसी NTPC
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable
	Max. conductor loop resistance per Km (in ohm) at 20 deg. C	As per ANSI MC 96.1		73.4	As per ANSI MC 96.1
	Reference Standard	As per ANSI MC 96.1		VDE : 0815	As per ANSI MC 96.1
	B. INSULATION				
	Material	Extruded PVC type YI 3			Teflon (i.e. extruded FEP)
	Thickness in mm (Min/Max)	0.25/0.35			0.4 / 0.50 (nominal)
	Volume Resistivity (Min) in ohm-cm	1 x 10 ¹⁴ at 20 deg. C & 1x10 ¹¹ at 70 deg. C.			2.8x 10 ¹⁴ at 20 deg. C & 2x10 ¹¹ at 205 deg. C.
	C. PAIRING & TWISTING				
	Max. lay of pairs (mm)	50			
	Single layer of binder tape on each pair provided	Each core printed with number or Numbered binder tape to be provided on each pair	Yes		Each core printed with number or Numbered binder tape to be provided on each pair
	Bunch (Unit Formation) for more than 4P	N.A	To be provided		N.A
	Conductor /pair identification as per VDE0815	N.A	To be provided		N.A
	D. SHIELDING				
	Type of shielding	Al-Mylar tape			
	Individual pair shielding	No	To be provided for F-type cable		No
	Minimum thickness of Individual pair shielding	No	0.028mm (28 micron)		No
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B IID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 3 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS					एनटीपीसी NTPC
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable	
	Overall cable assembly shielding	To be provided				
	Minimum thickness of Overall cable assembly shielding	0.055 mm (55 micron)				
	Coverage / Overlapping	100% / 20%				
	Drain wire provided for individual shield	N.A.	Yes (for F-type) Size- 0.5 sqmm No of strands-7 Dia of strands- 0.3mm Annealed Tin coated copper		N.A.	
	Drain wire provided for overall shield	Yes, Size- 0.5 sqmm,No of strands-7,Dia of strands- 0.3mm,Annealed Tin coated copper				
	E. FILLERS (if applicable)					
	Non-hygroscopic, flame retardant	To be provided				
	F. OUTER SHEATH					
	Material	Extruded PVC compound YM1 with FRLS properties			Teflon (i.e, extruded FRP)	
	Minimum Thickness at any point	1.8 mm			0.4 mm	
	Nominal Thickness at any point	>1.8 mm			0.5 mm	
	Resistant to water, fungus, termite & rodent attack	Required				
	Minimum Oxygen index as per ASTM-D-2863	29 %			N.A.	
	Minimum Temperature index as per ASTM-D-2863	250 deg.C			N.A.	
	FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI. PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 4 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS 			
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable
	Maximum Acid gas generation by weight as per IEC-60754-1		20%	N.A.
	Maximum Smoke Density Rating as per ASTMD-2843		60%	N.A.
	Reference standard		VDE207 Part 5,VDE-816	VDE207 Part 6 ASTM D2116
	G. Electrical Parameters			
	Mutual Capacitance Between Conductors At 0.8 KHz (Max.)	200 nF/km	120 nF/km for F type 100 nF/km for G-type	200 nF/km
	Insulation Resistance (Min.)		100 M Ohm/Km	
	Cross Talk Figure (Min.) At 0.8 KHz	60 dB	60 dB	60dB
	Characteristic Impedance (Max) At 1 KHz	N.A.	320 OHM FOR F-TYPE 340 OHM FOR G-TYPE	N.A.
	Attenuation Figure At 1 KHz (Max)	N.A.	1.2 db/km	N.A.
	H. COMPLETE CABLE			
	Complete Cable assembly		Shall pass Swedish Chimney test as per SEN-SS 4241475 class F3.	N.A.
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 5 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS				एनटीपीसी NTPC
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable
	Flammability	Shall pass flammability as per IEEE-383 read in conjunction to this specification			As per manufacturer's standard subject to employer's approval
	I. CABLE DRUM				
	Type	Non-returnable wooden drum (wooden drum to be constructed from seasoned wood free from defects with wood preservative applied to entire drum) or steel drum.			
	Length	1000 m $\pm$ 5% for up to & including 12 pairs 500 m $\pm$ 5% for above 12 pairs			
Note: Heat resistant instrumentation cable shall have same specification as of G/F type instrumentation cable as specified above, except that insulation and outer sheath material shall be Teflon and cable shall be suitable for continuous operation at 205 Deg. C					
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	
				PAGE 6 OF 13	

CLAUSE NO.	TECHNICAL REQUIREMENTS																																																				
3.07.00	Penetration of water resistance and impact resistance shall be as per IEC standard.																																																				
4.00.00	SPECIFICATION OF CONTROL & POWER SUPPLY CABLES Refer Electrical sub-sections.																																																				
5.00.00	INSTRUMENTATION CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY The cable interconnection philosophy to be adopted shall be such that extensive grouping of signals by large scale use of field mounted Group Junction Boxes (JBs) at strategic locations (where large concentration of signals are available, e.g. valves limit & torque switches, switchgear) is done and consequently cable with higher number of pairs are extensively used. The details of termination to be followed are mentioned in the given Table A. TABLE A: CABLE TERMINATION TO BE FOLLOWED																																																				
<table><tr><th colspan="2">Application</th><th colspan="2">Type Of Termination</th><th rowspan="2">Type Of Cable</th></tr><tr><th>FROM (A)</th><th>TO (B)</th><th>END A</th><th>END B</th></tr><tr><td>Valves/dampers drives (Integral Junction box)</td><td>Marshalling / Marshalling – cum Termination Cubicle / local group JB</td><td>Plug in connector</td><td>Post mount cage clamp type.</td><td>G</td></tr><tr><td>Transmitters, Process Actuated switches mounted in LIE/LIR</td><td>Integral Junction box of LIE/LIR</td><td>Plug in connector</td><td>Cage clamp (Rail mount) type.</td><td>F,G</td></tr><tr><td>RTD heads</td><td>Local junction box</td><td>Plug in connector</td><td>Cage clamp (Rail mount) type.</td><td>F</td></tr><tr><td>Thermocouple</td><td>Local junction box / CJC box (if applicable)</td><td>Plug in connector</td><td>Cage clamp (Rail mount) type.</td><td>A, B, C*</td></tr><tr><td>Other Field mounted Instrument</td><td>Local JB / Group JB</td><td>Plug in connector</td><td>Cage clamp (Rail mount) type.</td><td>F,G</td></tr><tr><td>RTD</td><td>Temperature transmitter</td><td>Plug in connector</td><td>Screwed, Cage clamp type</td><td>F</td></tr><tr><td>Thermocouple</td><td>Temperature transmitter</td><td>Plug in connector</td><td>Screwed, Cage clamp type</td><td>A, B, C*</td></tr><tr><td>Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR</td><td>Group JB</td><td>Cage clamp (Rail mount) type.</td><td>Cage clamp (Rail mount) type.</td><td>F,G</td></tr></table>					Application		Type Of Termination		Type Of Cable	FROM (A)	TO (B)	END A	END B	Valves/dampers drives (Integral Junction box)	Marshalling / Marshalling – cum Termination Cubicle / local group JB	Plug in connector	Post mount cage clamp type.	G	Transmitters, Process Actuated switches mounted in LIE/LIR	Integral Junction box of LIE/LIR	Plug in connector	Cage clamp (Rail mount) type.	F,G	RTD heads	Local junction box	Plug in connector	Cage clamp (Rail mount) type.	F	Thermocouple	Local junction box / CJC box (if applicable)	Plug in connector	Cage clamp (Rail mount) type.	A, B, C*	Other Field mounted Instrument	Local JB / Group JB	Plug in connector	Cage clamp (Rail mount) type.	F,G	RTD	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	F	Thermocouple	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	A, B, C*	Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR	Group JB	Cage clamp (Rail mount) type.	Cage clamp (Rail mount) type.	F,G
Application		Type Of Termination		Type Of Cable																																																	
FROM (A)	TO (B)	END A	END B																																																		
Valves/dampers drives (Integral Junction box)	Marshalling / Marshalling – cum Termination Cubicle / local group JB	Plug in connector	Post mount cage clamp type.	G																																																	
Transmitters, Process Actuated switches mounted in LIE/LIR	Integral Junction box of LIE/LIR	Plug in connector	Cage clamp (Rail mount) type.	F,G																																																	
RTD heads	Local junction box	Plug in connector	Cage clamp (Rail mount) type.	F																																																	
Thermocouple	Local junction box / CJC box (if applicable)	Plug in connector	Cage clamp (Rail mount) type.	A, B, C*																																																	
Other Field mounted Instrument	Local JB / Group JB	Plug in connector	Cage clamp (Rail mount) type.	F,G																																																	
RTD	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	F																																																	
Thermocouple	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	A, B, C*																																																	
Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR	Group JB	Cage clamp (Rail mount) type.	Cage clamp (Rail mount) type.	F,G																																																	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES																																																	
PAGE 7 OF 13																																																					

CLAUSE NO.	TECHNICAL REQUIREMENTS				
	Application		Type Of Termination		Type Of Cable
	FROM (A)	TO (B)	END A	END B	
	Local Junction box, Temperature Transmitter, Int. Junction box of LJE/ LIR/ Group JB / MCC/SWGR	Marshalling / Marshalling – cum Termination Cubicle	Cage clamp (Rail mount) type.	Cage clamp (Post mounted) type.	F,G
	Marshalling cubicle/ Termination Cabinet	Electronic system cabinet	Cage clamp (Post mounted) type.	Plug-in connector / other system as per Mfr.'s Standard	Internal wiring
	Marshalling/ Termination System Cabinets	UCD mounted equipments	Cage clamp (Post mounted) type.	Plug in connector / Cage clamp type (rail mounted).	F,G (with plug-in connect or at one end)
	DDCMIS/PLC cabinets	PC, Printers etc.	Plug in connector	Plug in connector	Mfr.'s Standard
Notes 1 Normally 10% spare cores shall be provided when the numbers of pairs of cables are more than four pairs, except for pre-fabricated cables which shall be as per manufacturer's standard. 2 For analog signals, individual pair shielding & overall shielding & for Binary signals, only overall shielding of instrumentation cables shall be provided. 3 * For high temperature applications only. 4 For connection between field/JB and DDCMIS marshalling cabinet Minimum 4 pair instrumentation cable shall be used. 5 All the spare cores of instrumentation cable have to be terminated in Marshalling cabinets/ DCS panel end. 6 Not used.					
6.00.00	TERMINAL BLOCKS				
6.01.00	All terminal blocks shall be rail mounted/post mounted, cage clamp type with high quality non-flammable insulating material of melamine suitable for working temperature of 105 deg. C. The terminal blocks in field mounted junction boxes, temperature transmitters, instrument enclosures/racks, etc., shall be suitable for cage clamp connections. The terminal blocks in Control Equipment Room logic/termination/marshalling cubicles shall be suitable for post				
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	
				PAGE 8 OF 13	

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	mounted cage clamp connection at the field input end. The exact type of terminal blocks to be provided by the Bidder and the technical details of the same including width etc. shall be subject to Employer's approval.		
6.02.00	All the terminal blocks shall be provided complete with all required accessories including assembly rail, locking pin and section, end brackets, partitions, small partitions, transparent covers, support brackets, distance sleeves, warning label, marking, etc.		
6.03.00	The marking on terminal strips shall correspond to the terminal numbering on wiring diagrams. At least 20% spare unused terminals shall be provided everywhere including local junction boxes, instrument racks/enclosures, termination/marshalling cabinets, etc. All terminal blocks shall be numbered for identification and grouped according to the function. Engraved labels shall be provided on the terminal blocks.		
6.04.00	For terminating each process actuated switches, drive actuators, control valves, Thermocouple, RTD, etc. in Local Junction Boxes, etc, refer Drg no. 0000-999-POI-A-085.		
6.05.00	The terminal blocks shall be arranged with at least 100 mm clearance between two sets of terminal blocks and between terminal blocks and junction box walls.		
7.00.00	INTERNAL PANELS/ SYSTEM CABINETS WIRING		
7.01.00	Internal panel/cabinet wiring shall be of multi-stranded copper conductor with FRLS PVC insulation without shield and outer sheath meeting the requirements of VDE 0815.		
7.02.00	All internal wires shall be provided with tag and identification nos. etched on tightly fitted ferrules at both ends. All wires directly connected to trip devices shall be distinguished by one additional red colour ferrule.		
7.03.00	All external connection shall be made with one wire per termination point. Wires shall not be tapped or spliced between terminal points.		
7.04.00	All floor slots of desk/panels/cabinets used for cable entrance shall be provided with removable gasketed gland plates and sealing material. Split type grommets shall be used for prefabricated cables.		
7.05.00	All the special tools as may be required for solder less connections shall be provided by Bidder.		
7.06.00	Wire sizes to be utilised for internal wiring. (i) Current (4-20 mA), low voltage signals (48V); Ammeter/Voltmeter circuit, control switches etc. for electrical system. (ii) Power supply and internal illumination.	0.5 Sq.mm. 2.5Sq.mm. minimum (shall be as per load requirement.)	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 9 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS										
8.02.00	Cables shall be segregated as per IEEE Std.422. In vertically stacked trays, the higher voltage cable shall be in higher position and instrumentation cable shall be in bottom tier of the tray stack. The distance between instrumentation cables and those of other system shall be as follows: <table border="0"> <tr> <td>From 11 kV/6.6 kV/3.3 kV tray system</td><td>-</td><td>914 mm</td></tr> <tr> <td>From 415V tray system</td><td>-</td><td>610 mm</td></tr> <tr> <td>From control cable tray system</td><td>-</td><td>305 mm</td></tr> </table>	From 11 kV/6.6 kV/3.3 kV tray system	-	914 mm	From 415V tray system	-	610 mm	From control cable tray system	-	305 mm	
From 11 kV/6.6 kV/3.3 kV tray system	-	914 mm									
From 415V tray system	-	610 mm									
From control cable tray system	-	305 mm									
8.03.00	Cables shall terminate in the enclosure through cable glands. All cable glands shall be properly gasketed. Sealing (to prevent ingress of dust entry and propagation of fire) shall be provided for all floor slots used for cable entrance. Compression cable glands (double for armoured and single for other cables) shall be provided.										
8.04.00	Not in use										
8.05.00	The cables emanating from redundant equipment/devices shall be routed through different paths. The above segregation of cables & wiring for redundant equipments/devices shall be in accordance with IEEE-Std-422.										
9.00.00	CABLE LAYING AND ACCESSORIES										
9.01.00	CABLE LAYING - Cables shall be laid strictly in line with cable schedule. - Identification tags for cables. Indelible tags to be provided at all terminations, on both sides of wall or floor crossing, on each conduit/duct/pipe entry/exit, and at every 20 m in cable trench/tray. - Cable tray numbering and marking. To be provided at every 10m and at each end of cable way & branch connection. - No jointing is permissible for instrumentation cables. For other cables Jointing for more than 250 Meters run of cable shall be permitted. - Buried cable protection With concrete slabs; Route markers at every 20 Meters along the route & at every bend. - Road Crossings Cables to pass through buried high density PE pipes encased in PCC. At least 300 mm clearance shall be provided between - HT power & LT power cables, - LT power & LT control/instrumentation cables,										
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 10 OF 13									

CLAUSE NO.	TECHNICAL REQUIREMENTS	एन टी पी सी NTPC	
	Spacing between cables of same voltage grade shall be in accordance with the derating criteria adopted for cable sizing. 7 Segregation (physical isolation to prevent fire jumping) a All cable associated with the unit shall be segregated from cables of other Units. b Interplant cables of station auxiliaries and unit critical drives shall be segregated in such a way that not more than half of the drives are lost in case of single incident of fire. 8 Cable clamping All cables laid on trays shall be neatly dressed up & suitably clamped/tied to the tray. For cables in trefoil formation, trefoil clamps shall be provided. 9 Optical fiber cables (OFCs) : Outside Building Area - to be laid necessarily inside GI conduit with support from cable tray/Trestle structure Inside Building Area – to be laid on separate cable sub-trays While buried- in separate buried trench approx.1.0 meter depth, to be laid in 2" rodent proof HDPE conduits covered with sand, brick, laid breadth-wise and soil along the pipe line route by contractor; While crossing roads - to be laid in GI/ rodent proof HDPE conduits with sand filling at bottom and sand, soil filling at top with cement concrete; While crossing canals/river- to be laid in rodent proof HDPE conduits within hume pipe. 10 Laying of Network Cable (UTP/STP) : Out side Building Area- to be laid necessarily inside GI conduits with support from cable tray / Trestle structure. Inside Building Area- to be laid necessarily inside GI conduits on separate cable sub-trays.		
9.02.00	Bidder shall supply and install all cable accessories and fittings like Light Interface Units, Surge suppressors, Opto isolators, Interface Converters, Fibre Optic Card Cage, Fibre Optic Line Driver, Repeater / Modem (for Optical Fibre Cables), cable glands, grommets, lugs, termination kits etc, on as required basis.		
9.03.00	Cables, which terminate in cabinets of draw out sections shall have sufficient cable coiled in the bottom of the cabinet to permit full withdrawal of draw out sections without disconnecting the cables. When prefabricated cables with factory connectors on both ends are longer than required, the excess cable shall be coiled in the bottom of one or both termination cabinets.		
9.04.00	The Bidder shall be responsible for proper grounding of all equipment under this package. Further, proper termination of cable shields shall be verified and the grounding of the same shall be coordinated so as to achieve grounding of all instrumentation cable shields at same potential. This shall be completed prior to system tests.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI. PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES
			PAGE 11 OF 13




CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
9.05.00	The Contractor shall take full care while laying / installing cables as recommended by cable manufacturers regarding pulling tensions and cable bends. Cables damaged in any way during installation shall be replaced at the expense of the Contractor.		
10.00.00	FIELD MOUNTED LOCAL JUNCTION BOXES (i) No. of ways 12/24/36/48/64/72/96/128 with 20% spares terminals. (ii) Material and Thickness 4mm thick Fiberglass Reinforced Polyester (FRP). (iii) Type Screwed at all four corners for door. Door gasket shall be of synthetic rubber. (iv) Mounting clamps and accessories Suitable for mounting on walls, columns, structures etc. The brackets, bolts, nuts, screws, glands required for erection shall be of SS, included in Bidders scope of supply. (v) Type of terminal blocks Rail mounted cage-clamp type suitable for conductor size upto 2.5 mm ² . A M6 earthing stud shall be provided. (vi) Protection Class IP- 55 minimum for indoor & IP-65 minimum for outdoor applications. (vii) Grounding To be provided. (viii) Color RAL 7035		
11.00.00	CONDUITS		
11.01.00	Conduits shall be generally used for interconnecting cables from field instruments to Local JB's. All rigid conduits, couplings and elbows shall be hot dipped galvanised rigid mild steel in accordance with IS: 9537 Part-I (1980) and Part-II (1981). The conduit interior and exterior surfaces shall have continuous zinc coating with an overcoat of transparent enamel lacker or zinc chromate. Flexible conduit shall be heat resistant terne coated steel with , water leak, fire and rust proof protected <i>for the areas of Mills,Drum, Main Steam, RH steam Air Heaters and Furnace, BFPDT's</i> . <i>And for remaining applications, water leak, fire and rust proof flexible GI conduits shall be provided.</i> The temperature rating of flexible conduit shall be suitable for actual application.		
11.02.00	All rigid conduit fittings shall conform to the requirements of IS: 2667, 1976. Galvanized steel fitting shall be used with steel conduit. All flexible conduit fittings shall be liquid tight, galvanized steel. The end fittings shall be compatible with the flexible conduit supplied.		
11.03.00	Conduit sealing, explosion proof, dust proof and other types of special fittings shall be provided as required by these specifications and shall be consistent with the area and equipment with which they are installed. Fittings installed outdoors and in damp locations shall be sealed and gasketed. Hazardous area fittings and conduits sealing shall conform with NEC requirements for the area classification.		
11.04.00	Contractor shall provide double locknuts on all conduit terminations not provided with threaded hubs and couplings. Water tight conduit unions and rain tight conduit hubs shall be		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 12 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	utilised for all the application which shall be exposed to weather. Moisture pockets shall be eliminated from conduits.		
11.05.00	Conduits shall be securely fastened to all boxes and cabinets.		
12.00.00	CABLE SUB-TRAY & SUPPORT		
12.01.00	The cable sub-trays and the supporting system, to be generally used between Local/Group JBs and the main cable trays and the same shall be furnished and installed by the Contractor. It is the assembly of sections and associated fittings forming a rigid structural system used to support the cable from the equipment or instrument enclosure upto the main cable trays (trunk route).		
12.02.00	The covers on the cable sub-trays shall be used for protection of cables in areas where damage may occur from falling objects, welding spark, corrosive environment, etc. & shall be electrically continuous and solidly grounded.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-199(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES PAGE 13 OF 13

	C&I SPECIFICATION FOR LIME DOSING SYSTEM	SECTION: C SUB SECTION: C&I

INSTRUMENT STUB DETAILS

|

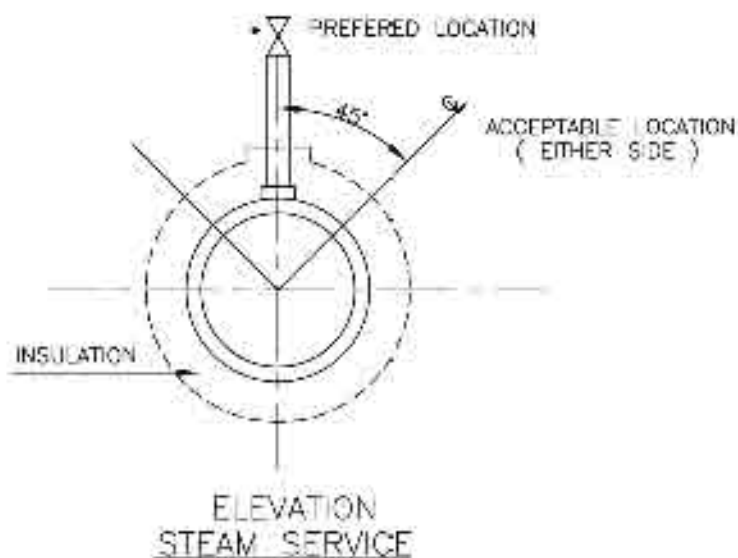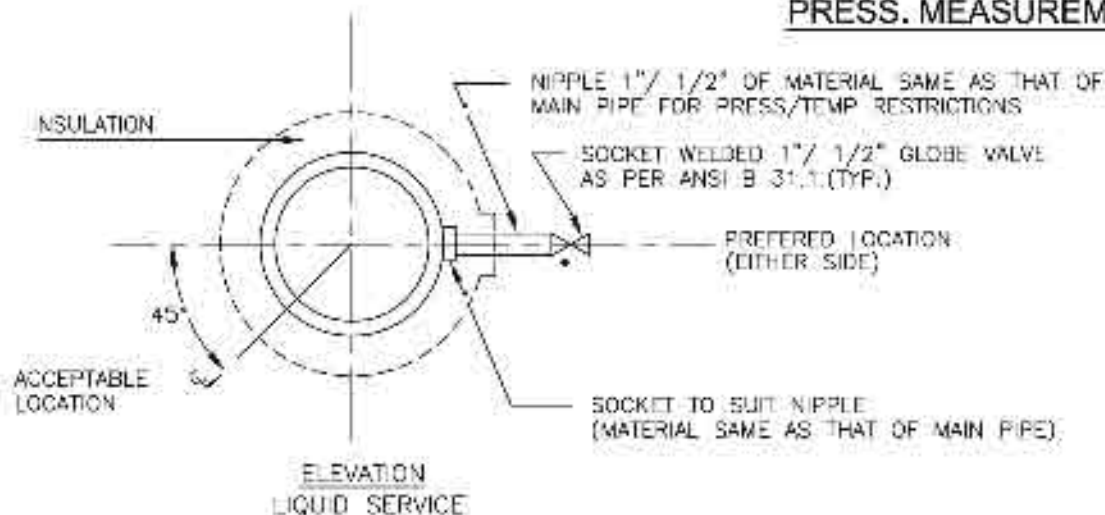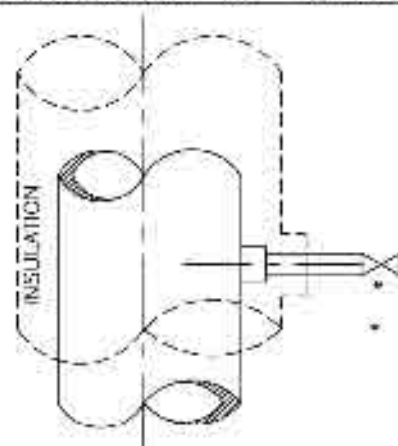PRESS. MEASUREMENTPRESSURE CONNECTION ON HORIZONTAL PIPE


- USE DOUBLE ISOLATION VALVES FOR PRESSURE EQUAL TO OR EXCEEDING 40 Kg/Cm².

PRESSURE CONNECTIONS ON VERTICAL PIPESFOR TENDER PURPOSE ONLY


										NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT										TYPICAL THERMAL POWER PROJECT									
TITLE										INSTRUMENT SOURCE CONNECTION DETAILS									
A FIRST ISSUE										T.D.									
DESCRIPTION										0000-999-POI-A-035 N.T.S.									
297 of 410 This page is the part of Tech. Spec. No. PE-TS-466-571-A102										29-1 OF 14 A									

PRESSURE MEASUREMENT


(SYSTEM PR. >40Kg/Sq Cm CL 9000)

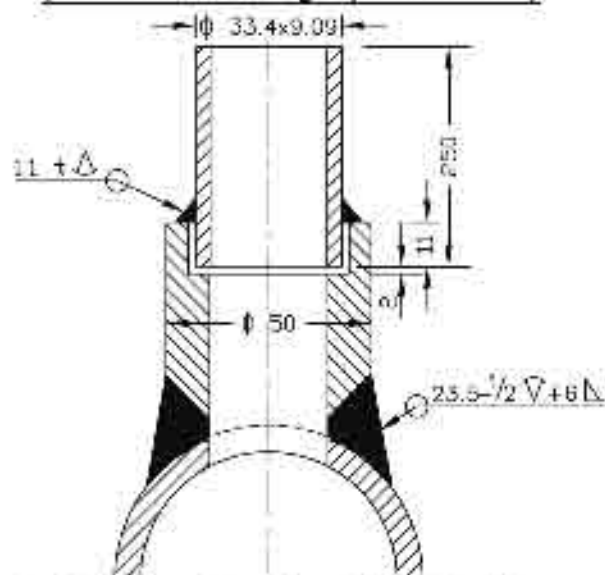


(SYSTEM PR. >40Kg/Sq Cm CL 6000)

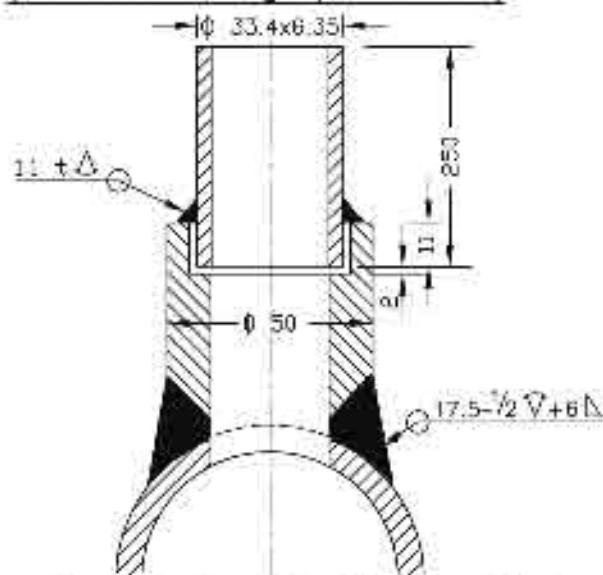

(SYSTEM PR. <40Kg/Sq cm Nb 25 CL 3000)

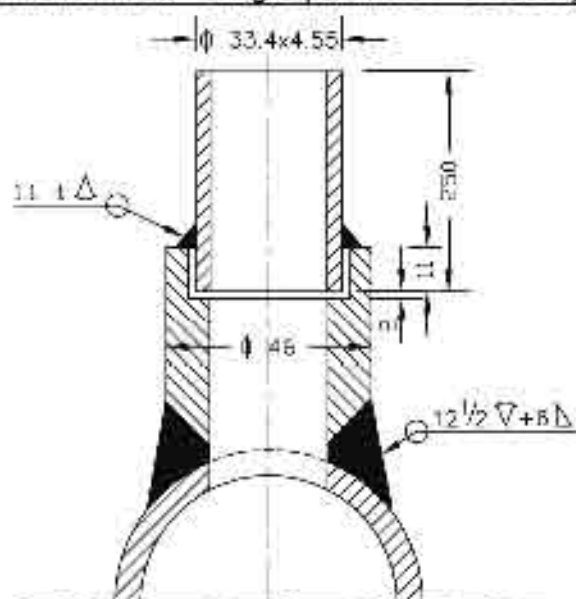

(SYSTEM PR. <40Kg/Sq cm Nb 15 CL 3000)

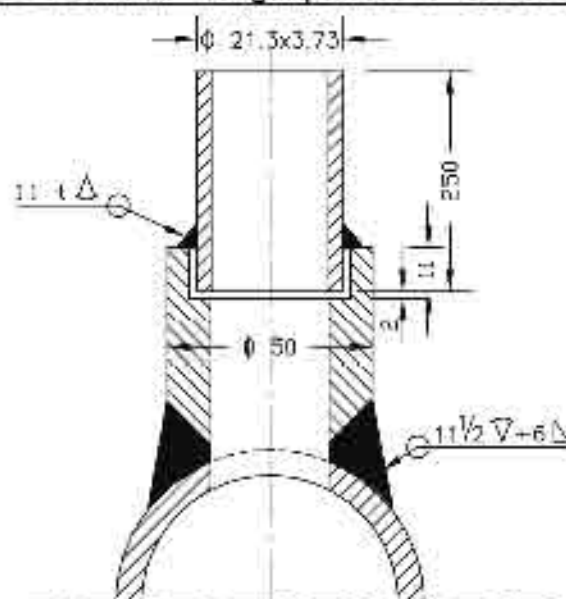


NOTES:-

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFIRM TO ANSI B 16.11.
2. THE LENGTH OF THE NIPPLE SHOULD BE 250mm.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 16.1.
4. TWO ISOLATED VALVES ARE TO BE USED FOR PRESSURE = >40 Kg/Cm².
5. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY (1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.
6. ORIENTATION OF TAP WILL BE VARY WITH TYPE OF PROCESS FLUID AND NATURE OF RUN OF THE PIPE.
7. ACTIVITIES TO BE COMPLETED AT THE SHOP, WELD THE COUPLING (OR BOSS) ON THE PIPE AND DRILL PRESSURE CONNECTION HOLE (SAME AS I.D. OF NIPPLE) IN THE PIPE IN ALIGNMENT WITH HOLE IN THE COUPLING.
8. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.

FOR TENDER PURPOSE ONLY


										एन टी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION								
										PROJECT		TYPICAL THERMAL POWER PROJECT						
										TITLE		INSTRUMENT SOURCE CONNECTION DETAILS						
A FIRST ISSUE																		
REV. NO.	DESCRIPTION			QUANTITY	UNIT	M	E	E	EN	WELL	WTD	UNIT	DATE	SCALE	DRAWN BY	0000-999-POI-A-035	REV. NO.	
										CHECKED BY		29-3-2014						A

LEVEL MEASUREMENT

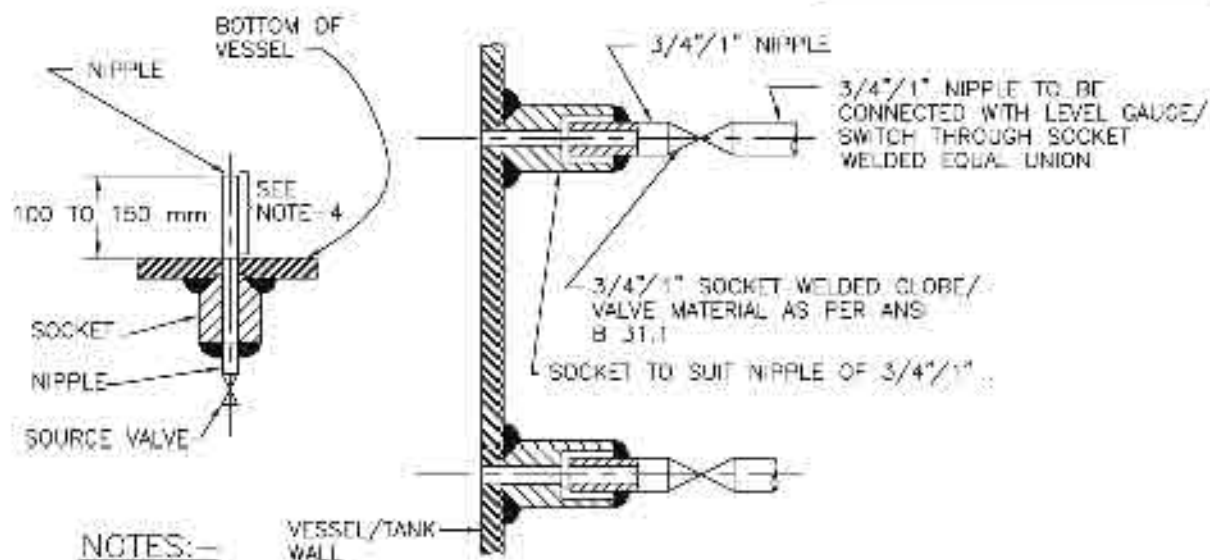

NOTES:—

1. THIS TYPE OF PROCESS CONNECTION SHALL BE USED FOR LEVEL GAUGE AND EXTERNAL CAGE TYPE FLOAT OR DISPLACER OPERATED LEVEL SWITCH.
2. FOR GAUGES $3/4"$ NIPPLE ALONG WITH $3/4"$ SW SOURCE VALVE AND FOR SWITCHES $1"$ NIPPLE ALONG WITH $1"$ SW SOURCE VALVE SHALL BE PROVIDED AS PROCESS CONNECTION.
3. SOURCE CONNECTION ON VESSEL SHOULD NOT BE LOCATED AT PLACES SUBJECTED TO INTERFACE AND TURBULENCE FROM INLETS AND OUTLETS.
4. IF LOWER CONNECTION IS TAKEN FROM BOTTOM OF THE VESSEL THEN THE NIPPLE MUST BE 100 mm TO 150 mm ABOVE THE BOTTOM OF THE VESSEL.

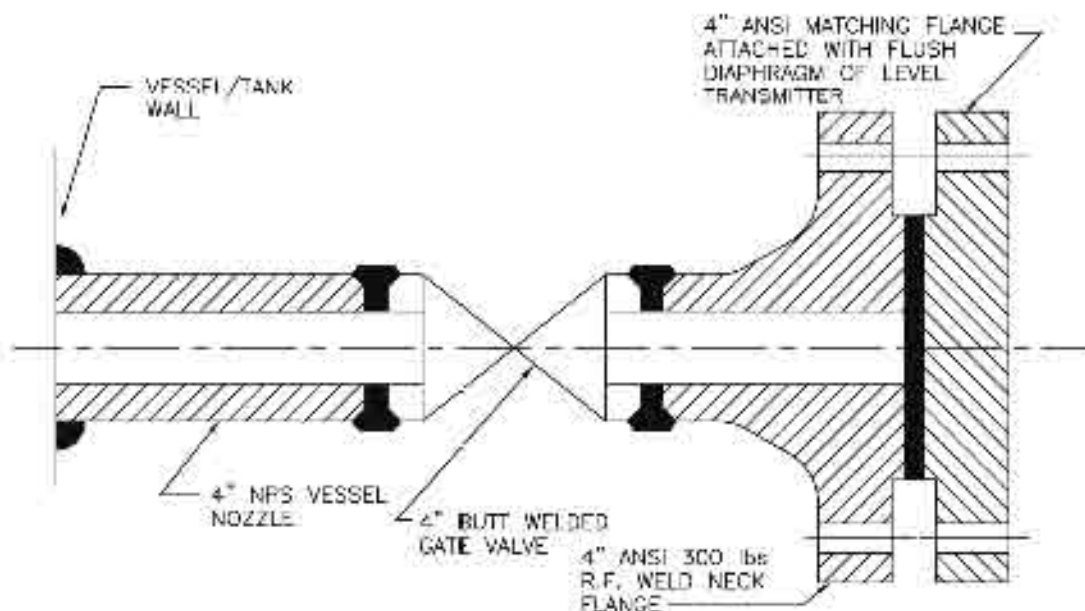


NOTES:

1. THIS TYPE OF PROCESS CONNECTION SHALL BE PROVIDED FOR TANK LEVEL MEASUREMENT OF VISCOUS OR CORROSIVE LIQUID USING FLUSH DIAPHRAGM/WAFER TYPE LEVEL TRANSMITTER.
2. WELDING OF MATCHING FLANGE TO GATE VALVE SHALL BE DONE BY BIDDER.

FOR TENDER PURPOSE ONLY

NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
TITLE INSTRUMENT SOURCE CONNECTION DETAILS									
REV. NO. A	DESCRIPTION FIRST ISSUE	DATE 29.12.2022	BY M. E.	CHECKED BY T.S.	APPROVED BY T.S.	SCALE N.T.S.	DRW. NO. 0000-999-POI-A-035	REV. NO. A	

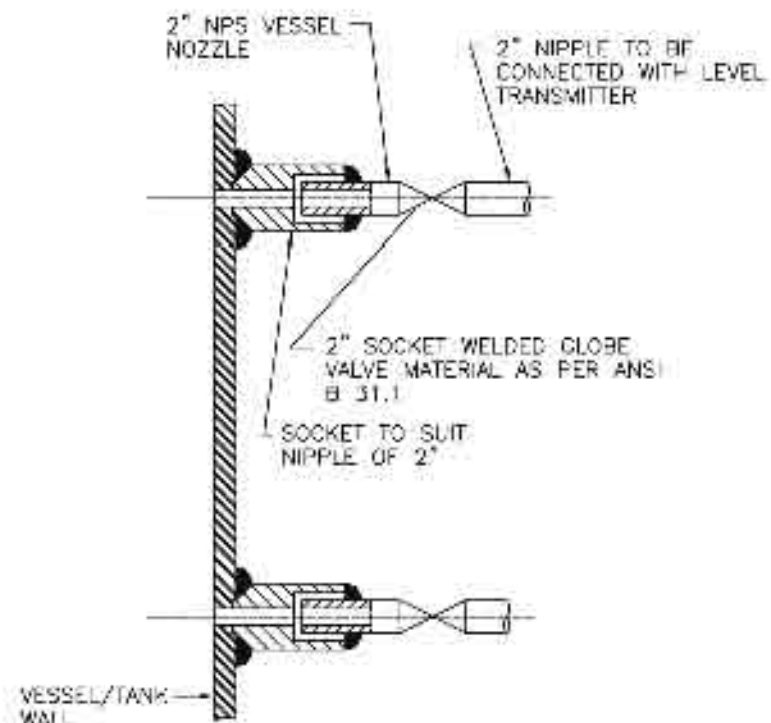LEVEL MEASUREMENTNOTES:-


1. THIS TYPE OF PROCESS CONNECTION SHALL BE USED FOR DISPLACER TYPE LEVEL TRANSMITTER.
2. SOURCE CONNECTION ON VESSEL SHOULD NOT BE LOCATED AT PLACES SUBJECTED TO INTERFACE AND TURBULENCE FROM INLETS AND OUTLETS.
3. IF LOWER CONNECTION IS TAKEN FROM BOTTOM OF THE VESSEL THEN THE NIPPLE MUST BE 100 mm TO 150 mm ABOVE THE BOTTOM OF THE VESSEL.

FOR TENDER PURPOSE ONLY

 NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION PROJECT: TYPICAL THERMAL POWER PROJECT TITLE: INSTRUMENT SOURCE CONNECTION DETAILS									
0000-999-POI-A-035									
21-14 OF 14									

	C&I SPECIFICATION FOR LIME DOSING SYSTEM	SECTION: C SUB SECTION: C&I

INSTRUMENT INSTALLATION DRAWING



**GROUNDING FOR EACH ROW OF PANELS
(TYPICAL)**


NOTES:-


1. SUPPLY, ERECTION, TERMINATION OF CABLES, FLATS ETC. REQUIRED FOR PROPER GROUNDING OF CONTRACTOR'S CONTROL SYSTEM, SYSTEM CABINETS, POWER SUPPLY CABINETS ETC. ARE IN THE SCOPE OF CONTRACTOR.
2. CABLE IN CONTRACTOR'S SCOPE.
3. TO BE LOCATED IN RIDGE.
4. EXACT LOCATION, ARRANGEMENTS OF FLATS ETC. SHALL BE AS FINALISED WITH CONTRACTOR DURING DETAILED ENGINEERING.
5. CABINET BODY, CABINET BOTTOM PLATE, CABINET DOORS ARE TO BE CONNECTED TO PANEL (WITH FLAT) GROUND CABLE BY CONTRACTOR.

FOR TENDER PURPOSE ONLY


एन टी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PRODUCT TYPICAL THERMAL POWER PROJECT									
TYPE INSTRUMENTATION CABLING DIAGRAM GROUNDING SCHEME FOR CABINETS / PANELS / POWER SUPPLY									
REV.	NO.	DATE	BY	CHKD.	APPD.	DATE	REV.	NO.	DATE
A	1	01/01/2022	...	...	...	...	A3	11.1	0000-999-PCI-A-019A
DESIGNED BY: <i>[Signature]</i>							CHECKED BY: <i>[Signature]</i>		
PROJECT NO. 0000-999-PCI-A-019A									

SH-3 OF 2

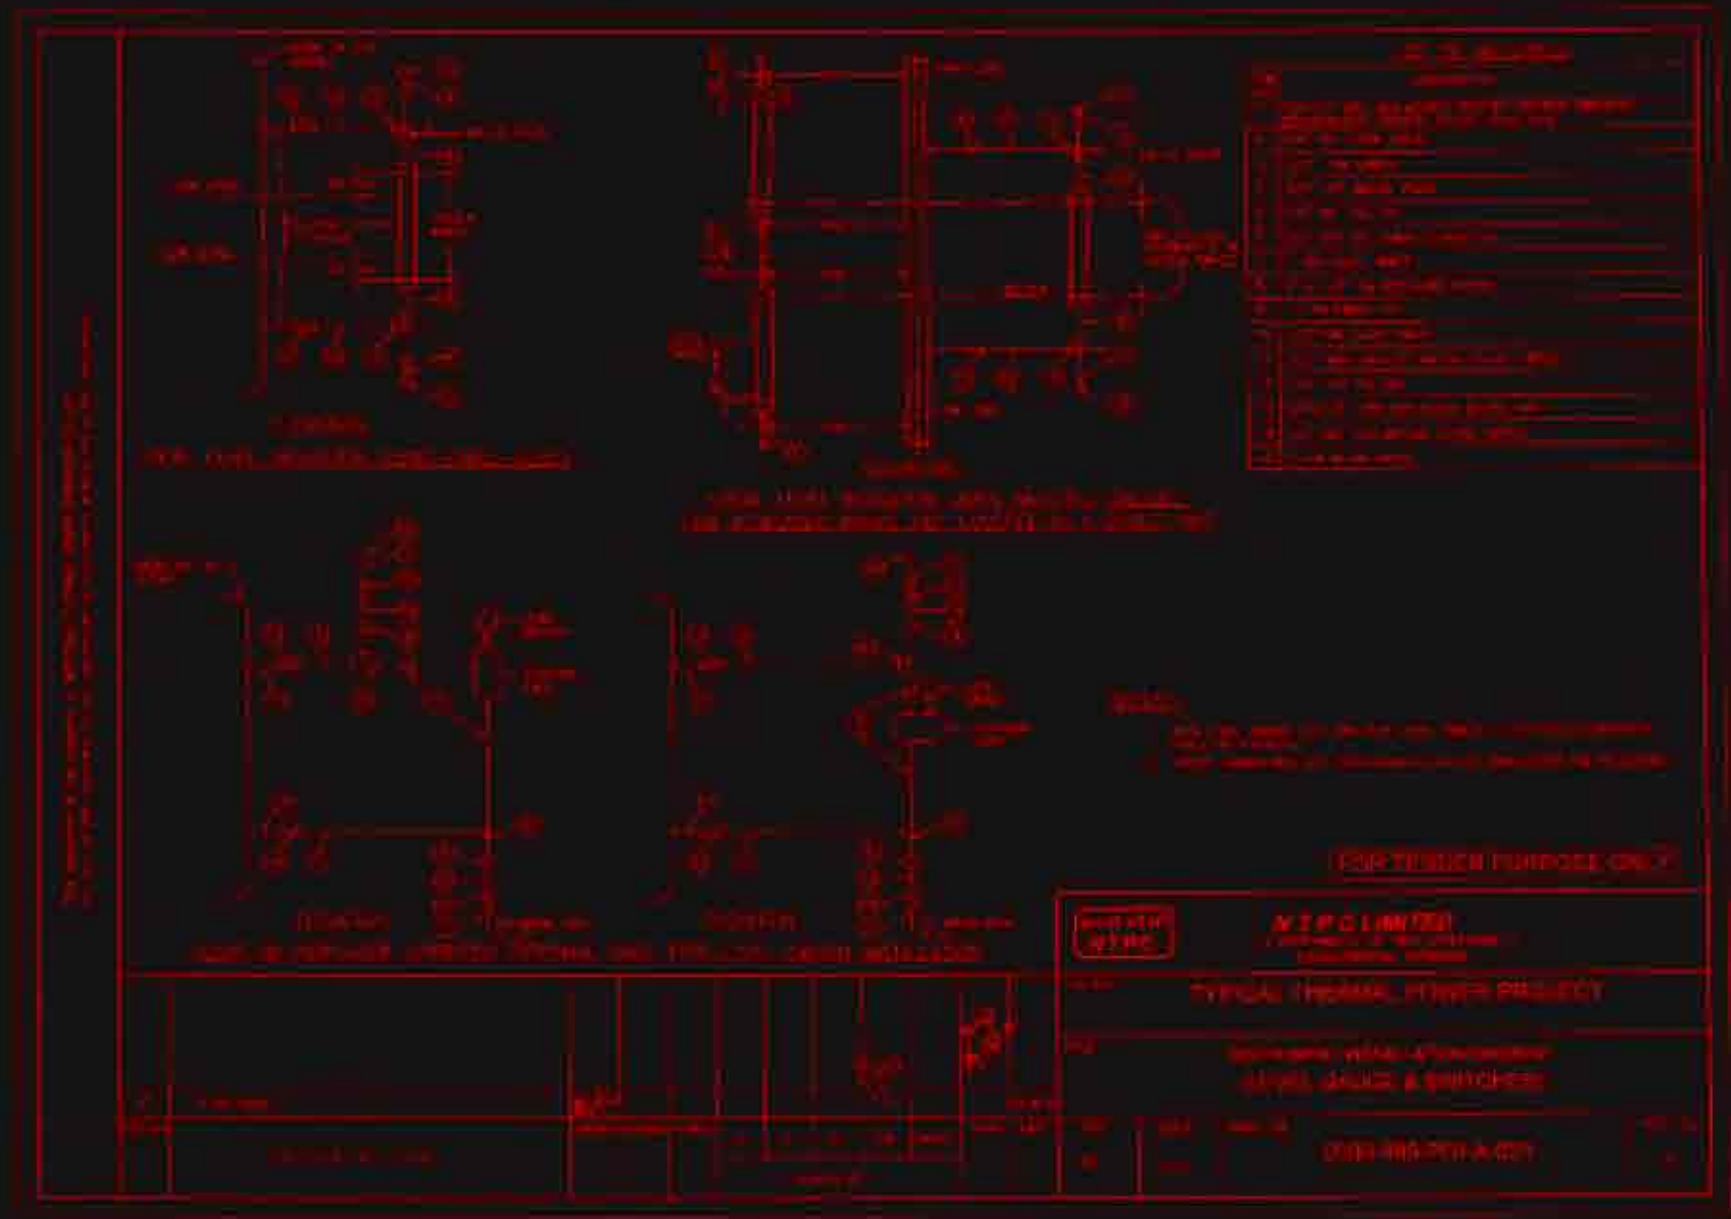

CLAUSE NO.	TECHNICAL REQUIREMENTS										
	PROCESS CONNECTION AND PIPING										
1.00.00	PROCESS CONNECTION PIPING										
1.01.00	The Contractor shall provide, install and test all required material for completeness of Impulse Piping System and Air Piping System as per the requirements of this Sub-Section on as required basis for the connection of all instruments and control equipments of entire plant.										
1.01.01	IMPULSE PIPING, TUBING, FITTINGS, VALVES AND VALVE MANIFOLDS										
1.01.02	All impulse pipes shall be of seamless type conforming to ANSI B36.10 for schedule numbers. The size of impulse pipe shall be ½" for Steam & Water Application and ¾" for Air & Flue Gas applications. The rating of material of impulse pipes, tubes, fittings, valves and their installation thereof shall conform to the latest edition of standards as per following table: <table><tr><td>Impulse Pipes, Tubes (Material, Rating)</td><td>ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70</td></tr><tr><td>Valves (Material, Pr. Class, Size)</td><td>ASTM A182/ASTM A105 as per ASME 16.34</td></tr><tr><td>Fittings (Size, Rating, Material)</td><td>ANSI B31.1, ANSI B31.1a, ASME B16.11-2009</td></tr><tr><td>Installation Schemes</td><td>BS 6739-2009, ANSI/ISA 77.70</td></tr></table> Stainless steel tube shall be provided inside enclosures & racks from tee connection to valve manifold and then to instrument. The source shut-off (primary process root valve) and blow down valve shall be of 1/2 inch size globe valve type for all applications except for air and flue gas service wherein no source shut-off valves are to be provided. Two root valves are to be used wherever pressure is more than 40 Kg/cm² or Temp>280 °C. The end connections of valves shall be of socket welded type. Typical installation scheme of DP Transmitter (inside LIE/LIR) mounted below instrument source point is indicated in Drg. No. 0000-999-POI-A-036. Same scheme with necessary changes shall be applied for other instruments.			Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70	Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34	Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009	Installation Schemes	BS 6739-2009, ANSI/ISA 77.70
Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70										
Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34										
Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009										
Installation Schemes	BS 6739-2009, ANSI/ISA 77.70										
1.01.03	The valve manifolds of 316 SS with pressure rating suitable for intended application shall be provided as given below: <table><tr><th>Manifold</th><th>Application/Measurement</th></tr><tr><td>2 Valve</td><td>Pressure measurements using pressure transmitters/pressure switches</td></tr><tr><td>3 Valve</td><td>Pressure measurements using differential pressure transmitter/ switches</td></tr><tr><td>5 Valve</td><td>Differential Pressure, Flow and Level Measurements</td></tr></table> For Pr /D.P gauges, two-way globe/gate valve shall be provided on each impulse line to the instrument in Fluid/Air & Flue Gas applications respectively .			Manifold	Application/Measurement	2 Valve	Pressure measurements using pressure transmitters/pressure switches	3 Valve	Pressure measurements using differential pressure transmitter/ switches	5 Valve	Differential Pressure, Flow and Level Measurements
Manifold	Application/Measurement										
2 Valve	Pressure measurements using pressure transmitters/pressure switches										
3 Valve	Pressure measurements using differential pressure transmitter/ switches										
5 Valve	Differential Pressure, Flow and Level Measurements										
2.00.00	AIR SUPPLY PIPING										
2.01.01	All pneumatic piping, fittings, valves, air filter cum regulator, purge rotameter and other accessories required for instrument air for the various pneumatic devices/ instruments shall be provided. This will include as a minimum air supply to pneumatically operated control valves, actuators, instruments, continuous and intermittent purging requirements etc.										
2.02.00	Instrument air and Service air supply shall be provided for continuous and intermittent purging respectively for all transmitters of mill, dirty air and flue gas applications. Purging Scheme shall be as per Drg. No. 0000-999-POI-A-036.										
2.03.00	The Contractor shall also provide SS Tubing and associated fittings (screwed type) of suitable sizes for all pneumatic equipments/actuators (including supply air, signal air and output to actuators) conforming to ANSI 31.1 and 31.3 standard. All other air supply lines shall be of mild steel hot dipped galvanized inside and outside as per IS-1239, heavy duty										
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BIS DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C3 PCP PAGE 1 OF 4								

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	with threaded ends. Fittings for air supply line shall be of forged carbon steel A234 Gr. WPB galvanized inside and outside, screwed as per ASA B2.1. Dimensions of fittings shall be as per ASA B16.11 of rating 3000 lbs. Air supply piping shall be adequately sloped to prevent accumulation of condensed water within the pipe. The air supply headers, sub-headers and branch pipes shall be supported properly by clamps or supports.		
2.04.00	The instrument/service air supply to each equipment/devices requiring air supply shall be provided by a well designed air distribution scheme comprising of 2" GI Pipe Header feeding 1" GI Pipe sub-header feeding 1/2" pipe at each equipment/device. Instrument air filters cum regulator set with mounting accessories shall be provided for each pneumatic device requiring air supply except for Ash Handling System wherein it shall be provided on instrument air header at each location.		
2.05.00	All the isolation valves in the air supply line shall be gate valves as per ASTM B62 inside screw rising stem, screwed female ends as per ASA B2.1. Valve bonnet shall be union type & trim material shall be stainless steel, body rating 150 pounds ASA. The valve sizes shall be 1/2 inch to 2 inch.		
2.06.00	Instrument air filters cum regulator set with mounting accessories shall be provided for pneumatic device requiring air supply. The filter regulators shall be suitable for 10-kg/ sq.cm max. Inlet pressure. The filter shall be of size 5 microns and of material sintered bronze. The air set shall have 2-inch size pressure gauge and built in filter housing blowdown valve. The end connection shall be as per the requirement to be finalized during detailed engineering.		
3.00.00	INSTALLATION AND ROUTING		
3.01.01	All instrument piping, tubing and its accessories shall be supported in a safe manner to prevent excessive vibrations and anchored sufficiently to prevent undue strain on connected equipment. Impulse piping shall be supported at an interval not exceeding 1.5 meters. The slope of the impulse pipe from the process connection to the instrument shall be as per ANSI/ISA 77.70 latest edition and BS 6739-2009. All impulse piping shall be installed to permit free movement due to thermal expansion. Wherever required expansion loops shall be provided. Condensate pots shall be provided for all level measurements in steam and water services, all flow measurement in steam services and for flow measurements in water services above 120 Deg. C. Colour coding of all impulse pipes shall be done by the Contractor in line with the colour coding being followed for the parent pipes.		
4.00.00	SHOP AND SITE TESTS		
4.01.01	The equipment and work performed as per this Sub-section shall be subject to shop and site test as per requirements of Sub-section-III-E-04 (Quality Assurance & Inspection) other applicable clauses of this Sub-section and Employer approved quality assurance plan.		
4.01.02	Hydrostatic and Pneumatic leakage tests shall be performed on all pipes, tubing and systems and shall conform to ANSI B31.1.		
5.00.00	LOCAL INSTRUMENT ENCLOSURE AND RACKS All transmitters, switches etc. for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) local instruments enclosures in case of open areas of the plant and (ii) in local instrument racks in case of covered areas. The GA of LIE with purging indicated in the Drg. No. 0000-999-POI-A-036 is to be followed by contractor. The GA of LIR shall be similar to LIE except for front/rear doors and side panels.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BIS DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C3 PCP	PAGE 2 OF 4

CLAUSE NO.	TECHNICAL REQUIREMENTS		
5.01.00	The internal layout shall be such that the impulse piping/ blow down lines are accessible from back side of the enclosure / rack and the transmitters etc. are accessible from front side for easy maintenance. Bulkheads, especially designed to provide isolation from process line vibration shall be installed on instrument enclosures/racks to meet the process sensing line connection requirement. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of LIE and JB of LIE/LIR shall be IP-55. The enclosures shall be constructed of 3 mm sheet plate and shall be of modular construction with one or more modules and two end assemblies bolted together to form an enclosure. Double inter locking doors shall be provided. The doors shall be the three-point locking type constructed of not less than 1.6 mm thick steel. Doors shall have concealed quick removal type pinned hinges and locking handles. Door locks shall accept the same key. The instrument racks shall be free standing type constructed of suitable 5 mm thick channel frame of steel and shall be provided with a canopy to protect the equipment mounted in racks from falling objects, water etc. The canopy shall not be less than 3 mm thick steel, and extended beyond the ends of the rack. Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein. Centre posts or any member which would reduce access shall not be provided. Contractor shall provide not more than three variants for LIE/LIR with respect to max. no. transmitters mounted in each LIE/LIR.		
	ENCLOSURE / RACKS FOR DUAL I/P TEMPERATURE TRANSMITTERS All Dual Input temperature transmitters for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) Enclosures in case of open areas of the plant and (ii) Racks in case of covered areas. Integral JB shall be provided with each Enclosure and Rack. The internal layout shall be such that the transmitters are accessible from both front and back side of the enclosure / rack for easy maintenance. Enclosure/ Racks shall be of robust and rugged design. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of Enclosure and JB shall be IP-55. Enclosure and Racks shall be free standing type. Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein. Contractor shall provide not more than five variants for Enclosure/ Rack with respect to max. no. transmitters mounted in each Enclosure/ Rack. However, the maximum number of Transmitters that can be grouped in one Enclosure/ Rack shall be decided during detail Engineering.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BIS DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C3 PCP	PAGE 3 OF 4

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
5.00.00	INSTALLATION OF OTHER INSTRUMENTS: For installation and routing of other field mounted instruments which are not covered in Cl. No. 5.00.00, please refer Cl. No 52.04.00(J) of Section-VI, Part-D, Erection Conditions of Contract (ECC) of Technical Specifications.		
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: C5-0011-109(1A)-2	SUB-SECTION-III-C3 PCP	PAGE 4 OF 4




**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**


SECTION: C
SUB SECTION: C&I

**SIGNAL INTERFACE
BETWEEN
DRIVES AND DCS**


DDCMIS INTERFACE WITH LT MCC (LT)

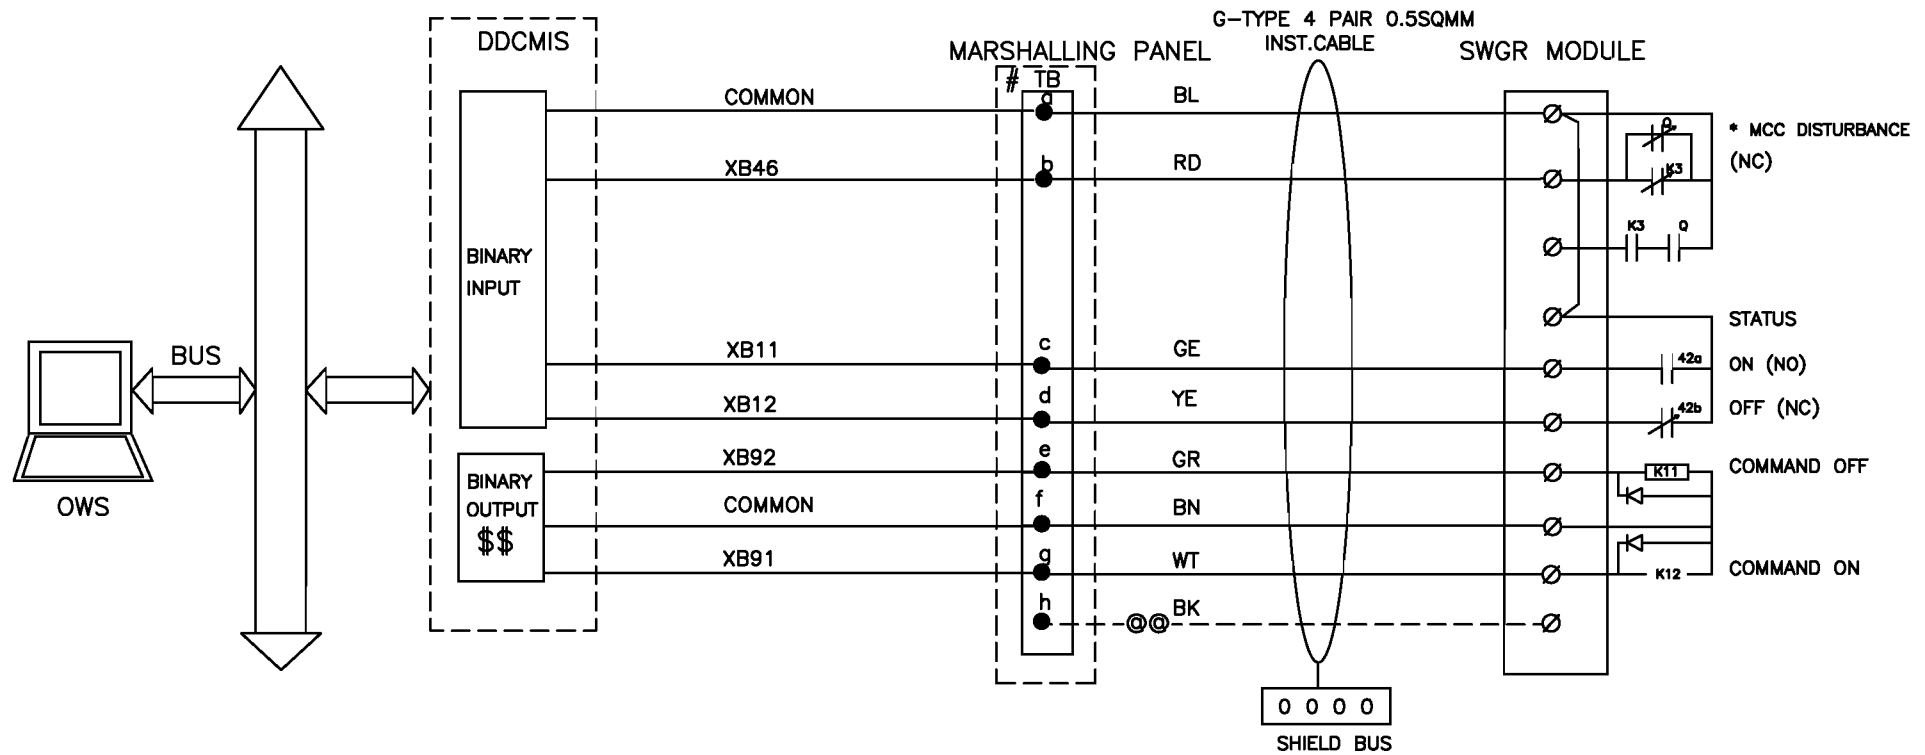


DDCMIS INTERFACE WITH BID

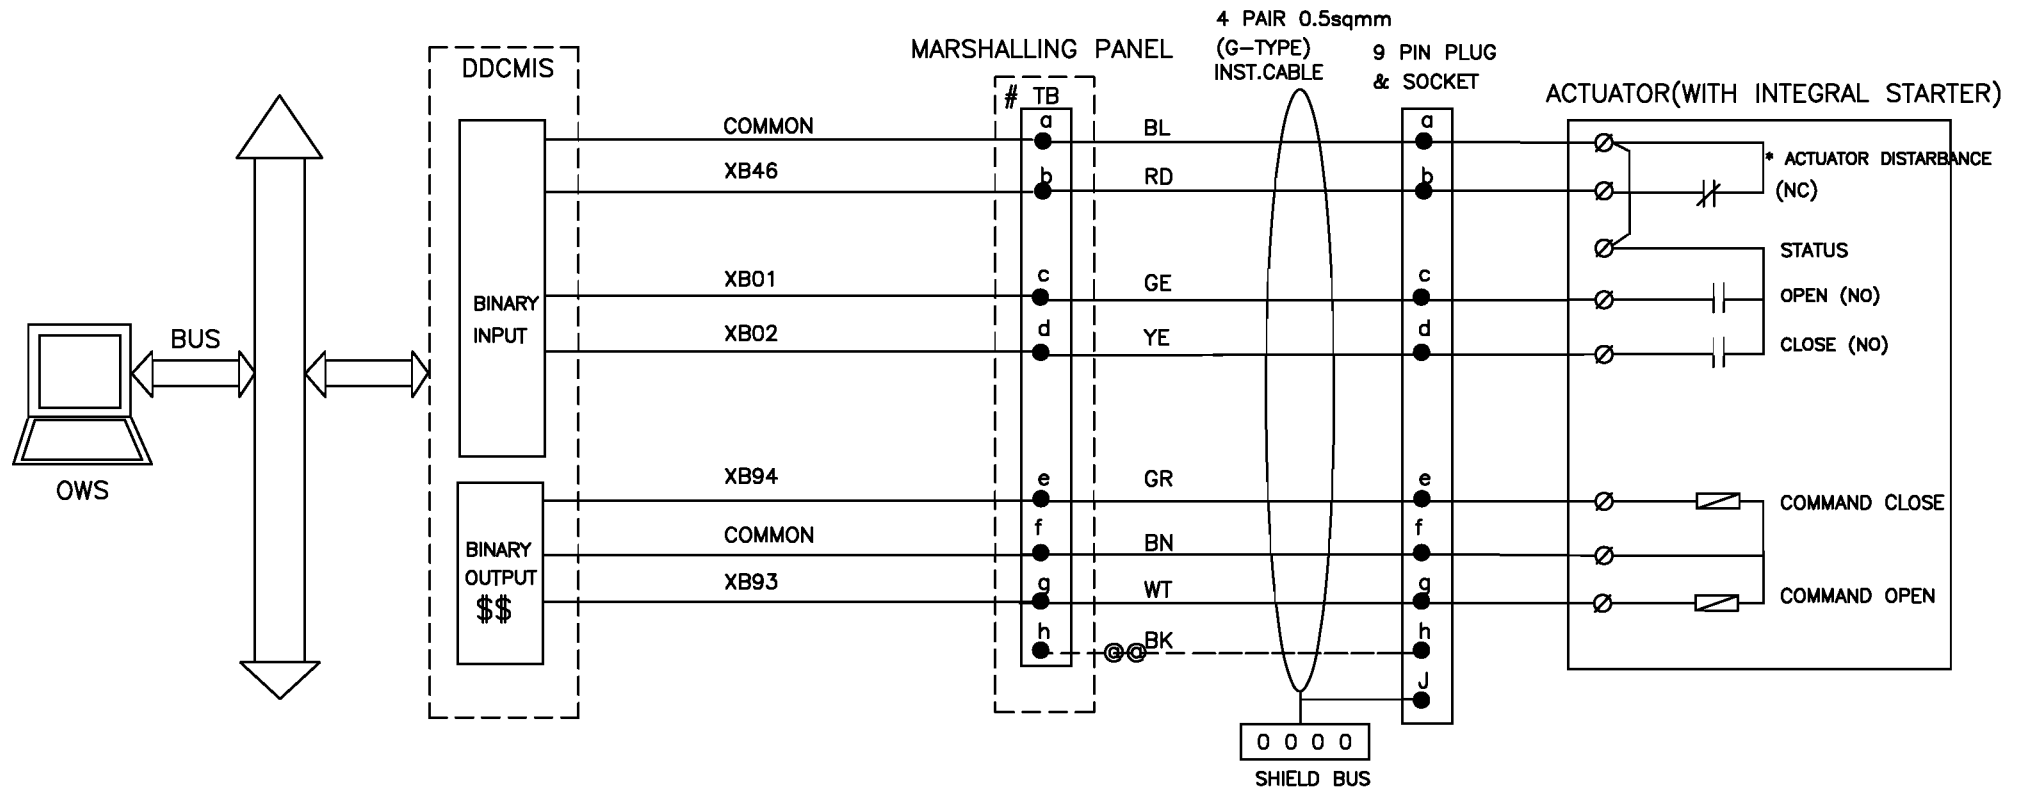


DDCMIS INTERFACE WITH DUAL COIL SOLENOID (DSOV/L)

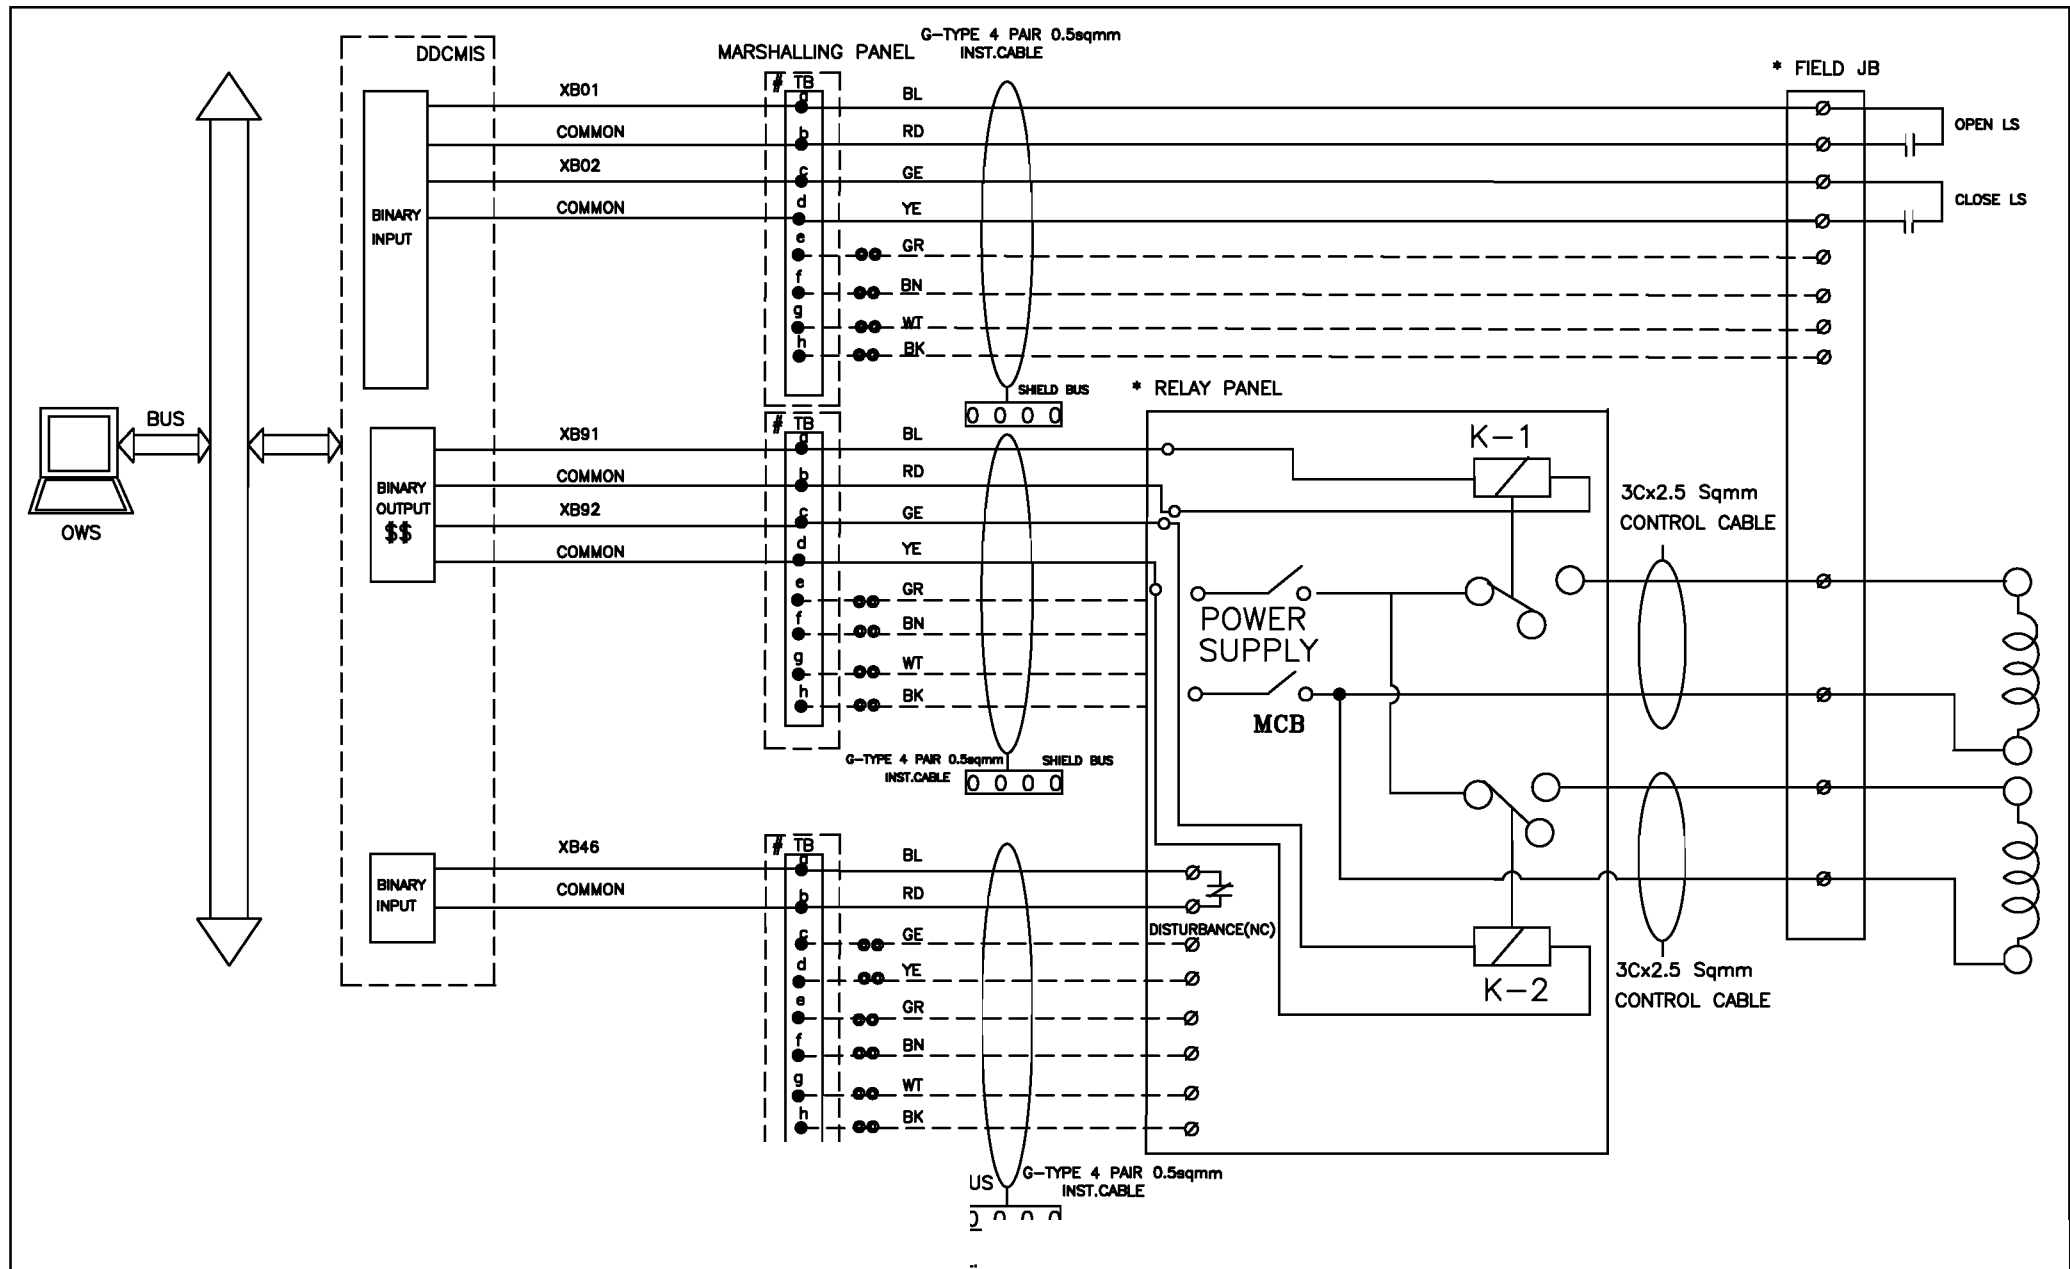

INTERFACE FOR MODULATING DRIVES – CLCS

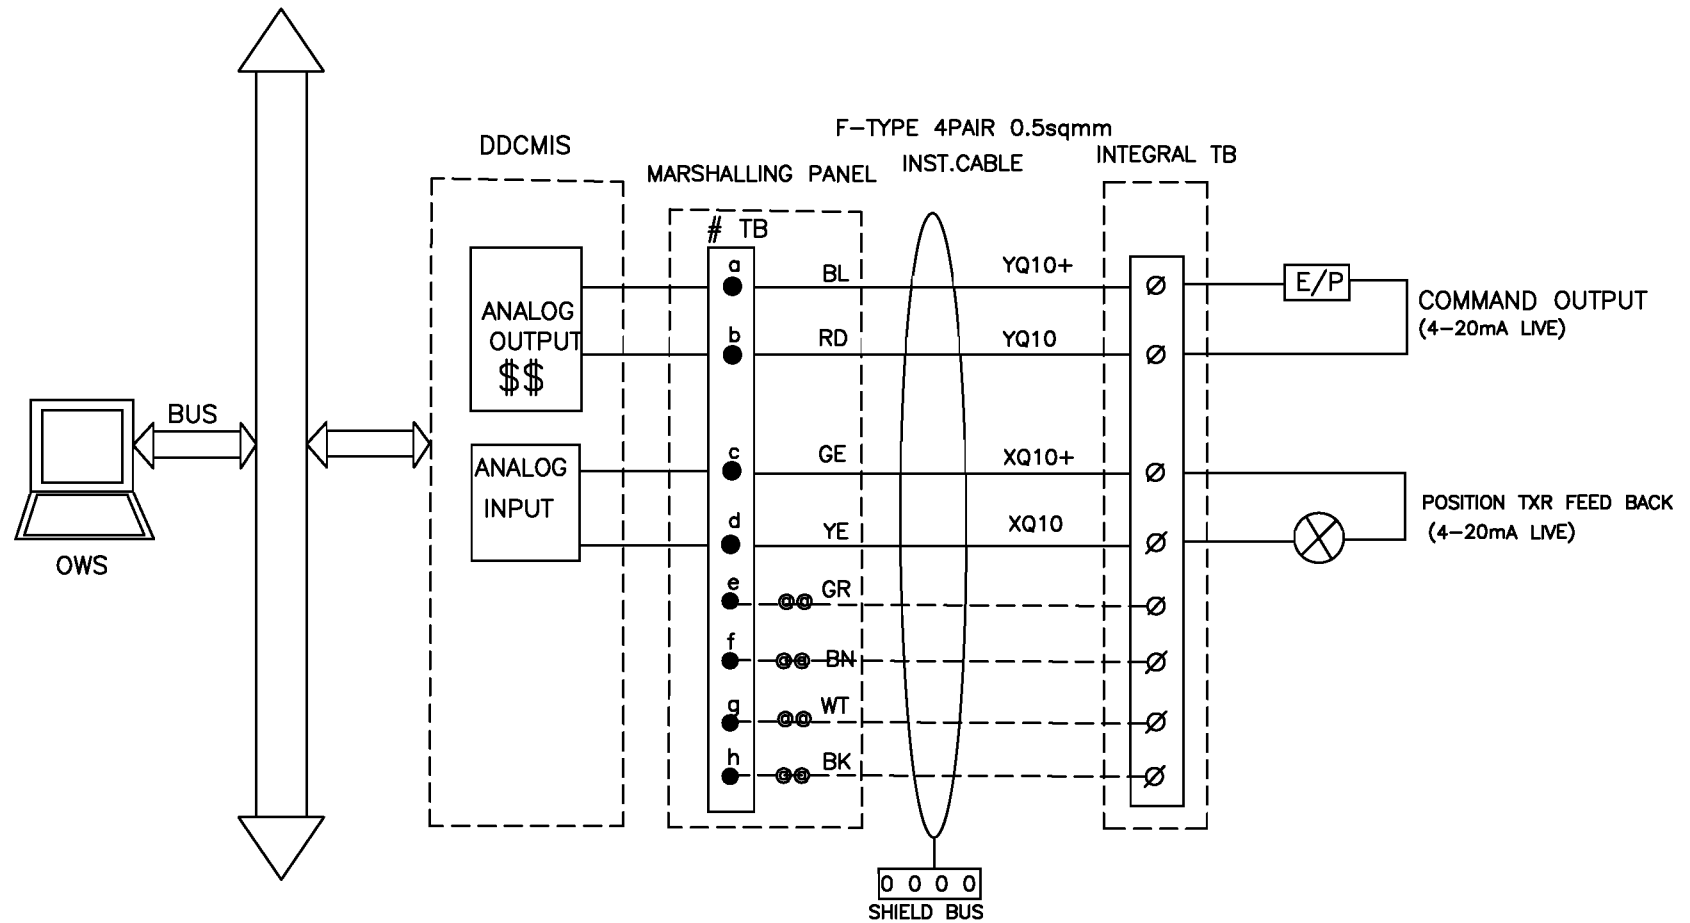


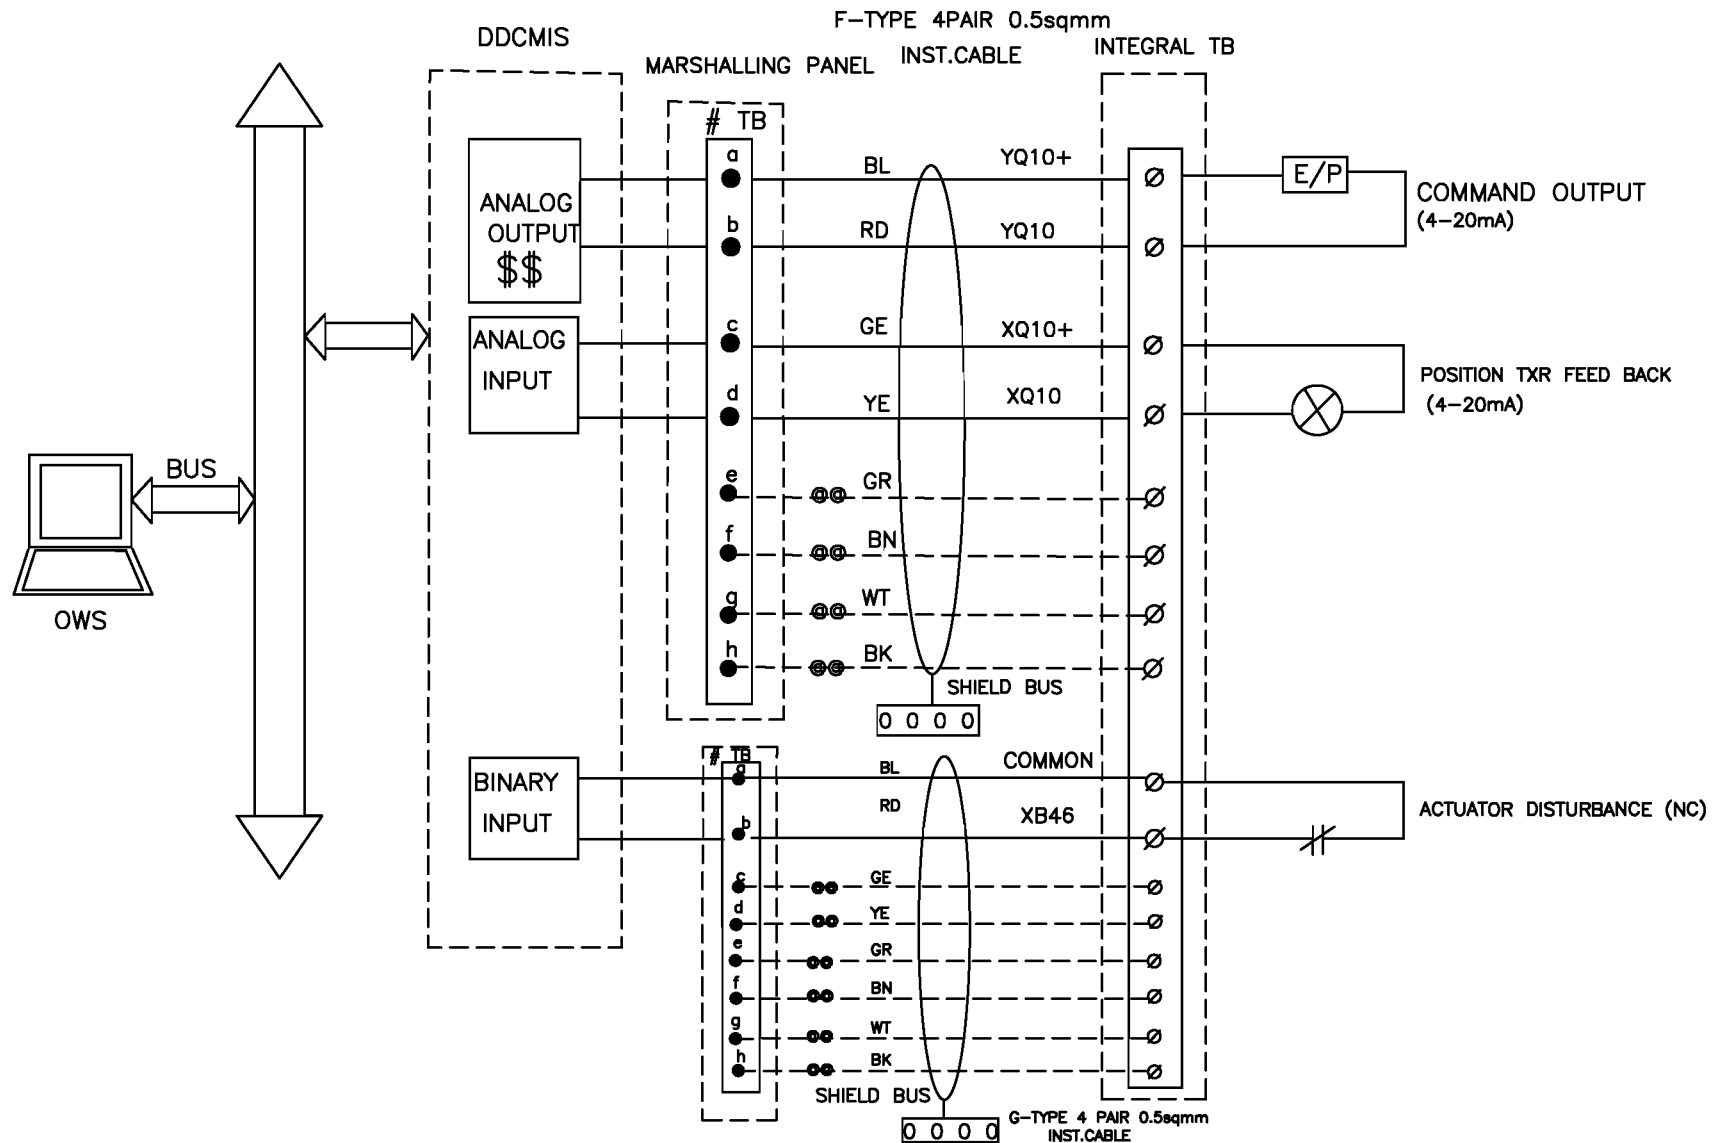

**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**SECTION: C
SUB SECTION: C&I**DRIVE & INSTRUMENT INTERFACE
DIAGRAM**

|

963437/2022/PS-PEM-MAX

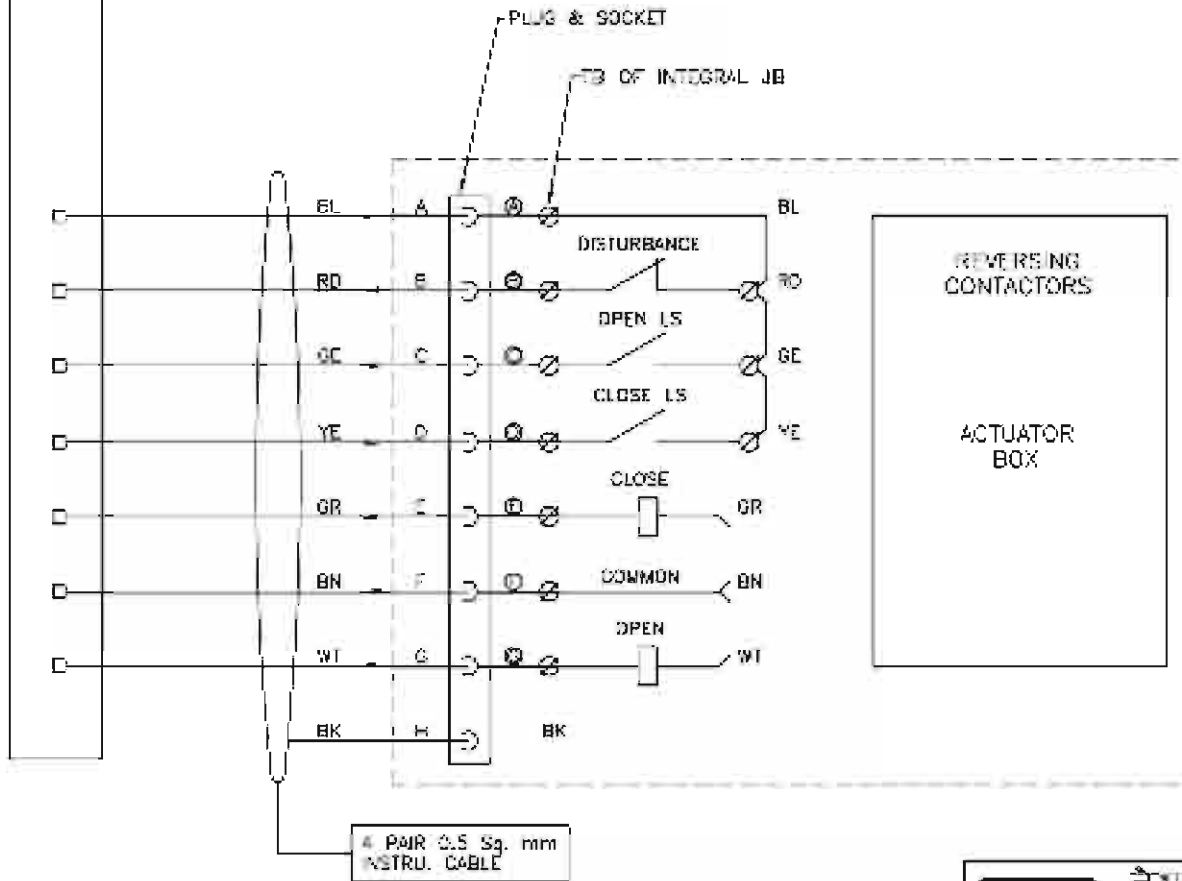
TERMINATION AT
CONTROL SYSTEM END

FOR TENDER PURPOSE ONLY

नैशनल थर्मल पावर कॉर्पोरेशन लिमिटेड
NTPC
National Thermal Power Corporation Ltd.
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION

											PROJECT TYPICAL THERMAL POWER PROJECT				
											TITLE INTERFACING OF ACTUATORS				
D	FIRST ISSUE										21.08.12				
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPRO	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
												A3	N.T.S.	0000-999-POI-A-063	D
This page is the part of Tech. Spec. No. PE-TS-466-571-A102 CLEARED BY 320 of 410															

CLEARED BY 320 of 410
 This page is the part of Tech. Spec. No. PE-TS-466-571-A102

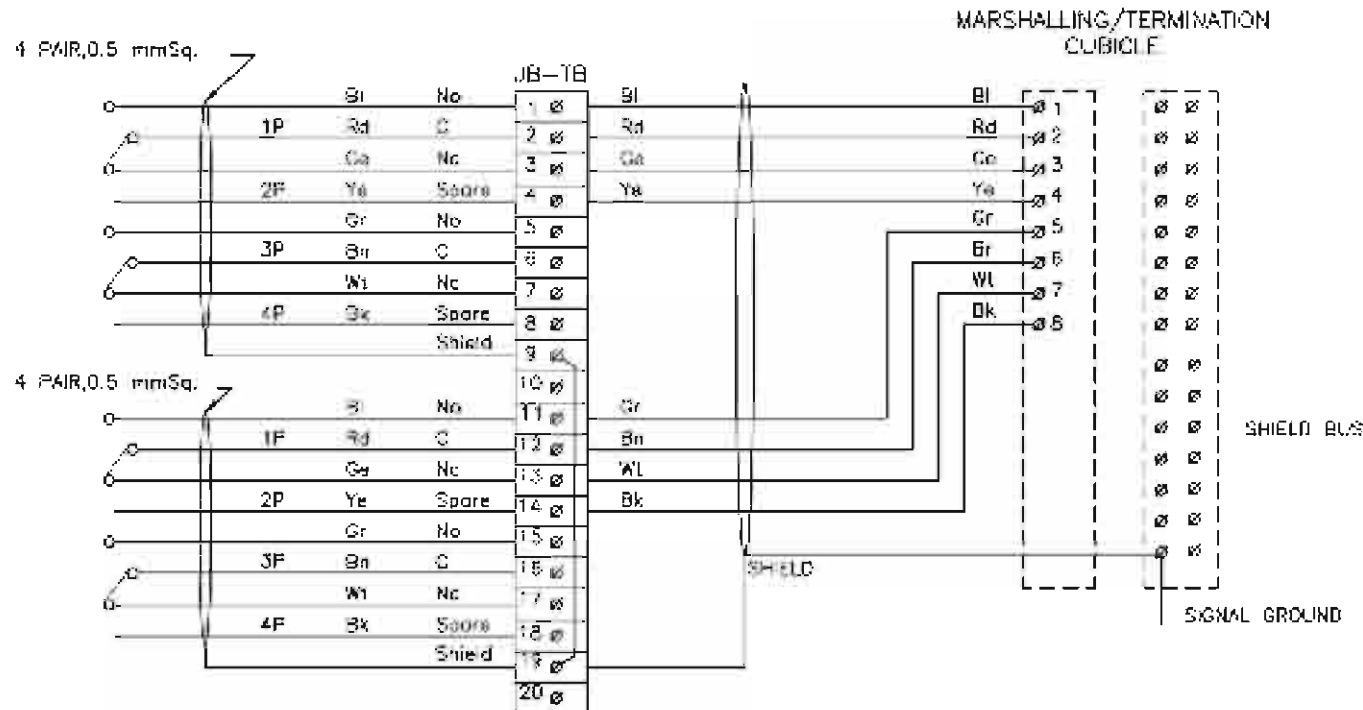

[FOR TENDER PURPOSE ONLY]

NTPC LIMITED
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION


PROJECT: TYPICAL THERMAL POWER PROJECT

TITLE: INTERFACING OF FIELD INSTRUMENTS/
 SWGR SWITCH (COC) TERMINATION DETAILS

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH	APPRO	DATE	SIZE	SCALE	Dwg. No.	REV. NO.
A	FIRST ISSUE										21.08.12	A3	NTS	0000-999-POI-A-065	A

963437/2022/PS-PFM-MAX

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

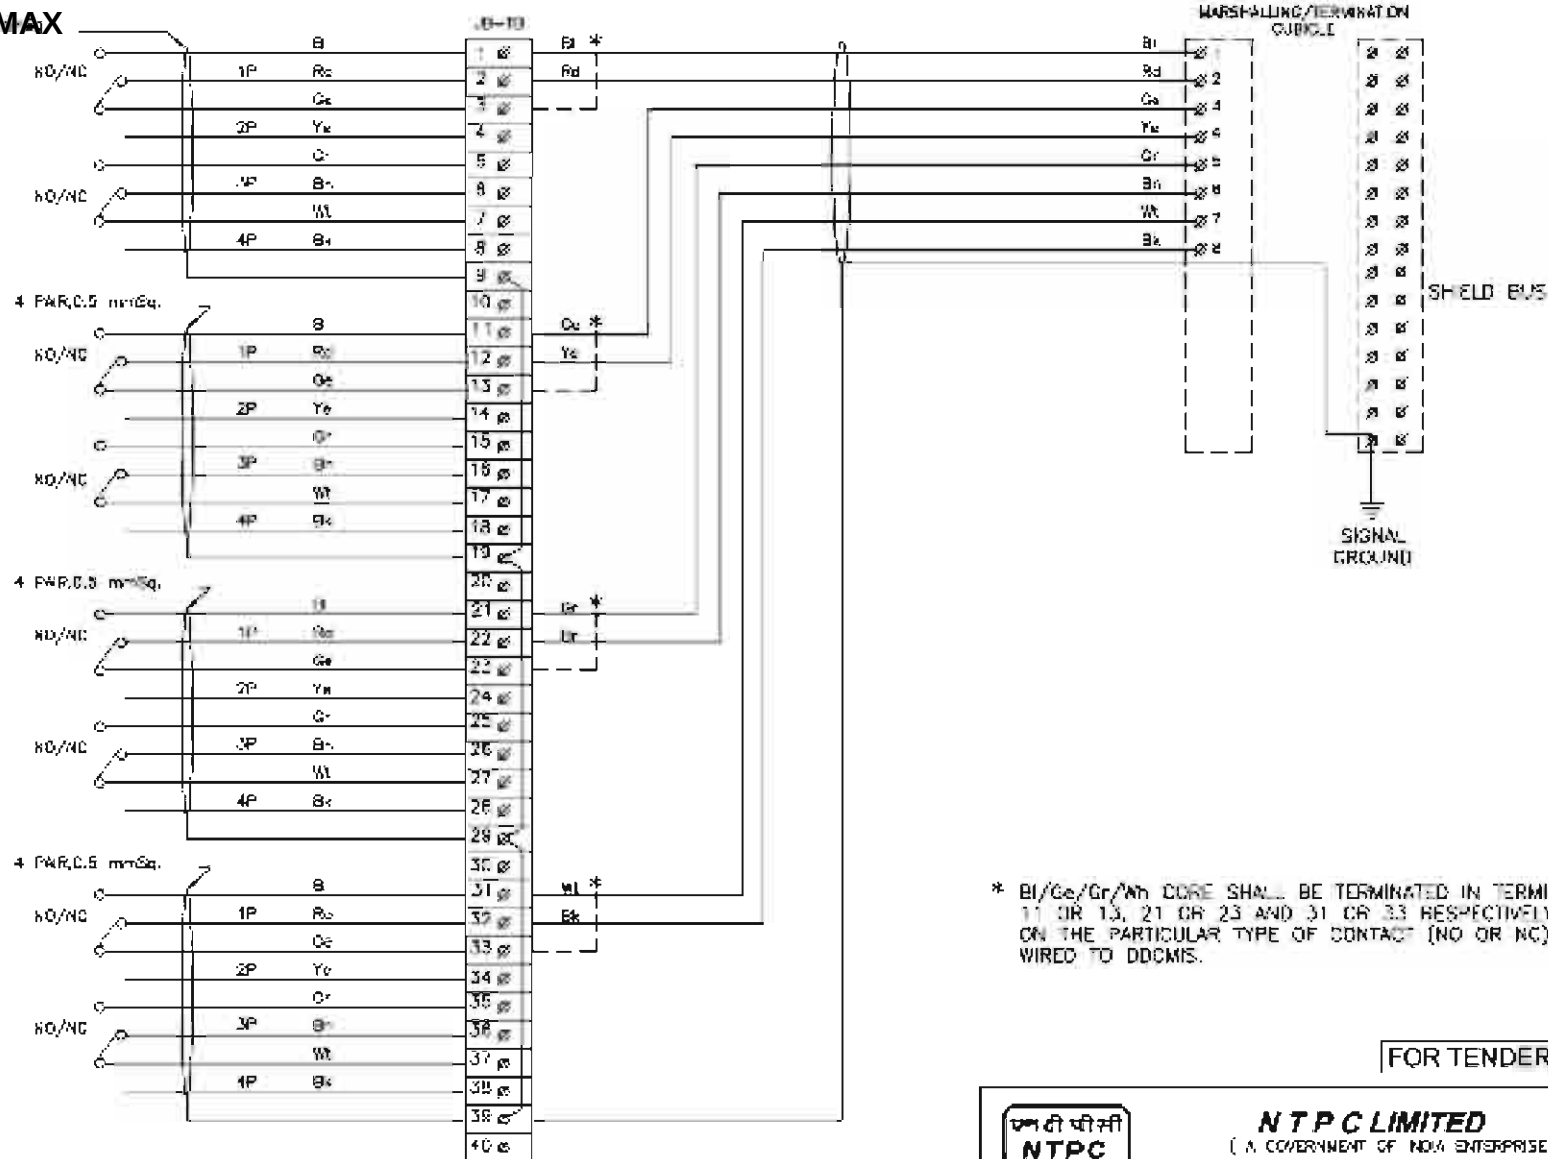

* BI/Ge/Gr/Wh CORE SHALL BE TERMINATED IN TERMINAL 1 OR 3, 11 OR 13, 21 OR 23 AND 31 OR 33 RESPECTIVELY DEPENDING ON THE PARTICULAR TYPE OF CONTACT (NO OR NC) IS TO BE WIRED TO DDCMIS.


FOR TENDER PURPOSE ONLY

एन टी पी सी
NTPC

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT										
TITLE		INTERFACING OF FIELD INSTRUMENTS SWITCH TERMINATION DETAILS NO/NC										
SIZE	SCALE	DRG. NO.										REV. NO.
A3	NTS	0000-999-POIA-065										A
1 A102		SH 02 OF 15										

963437/2022/PS-PEM-MAX

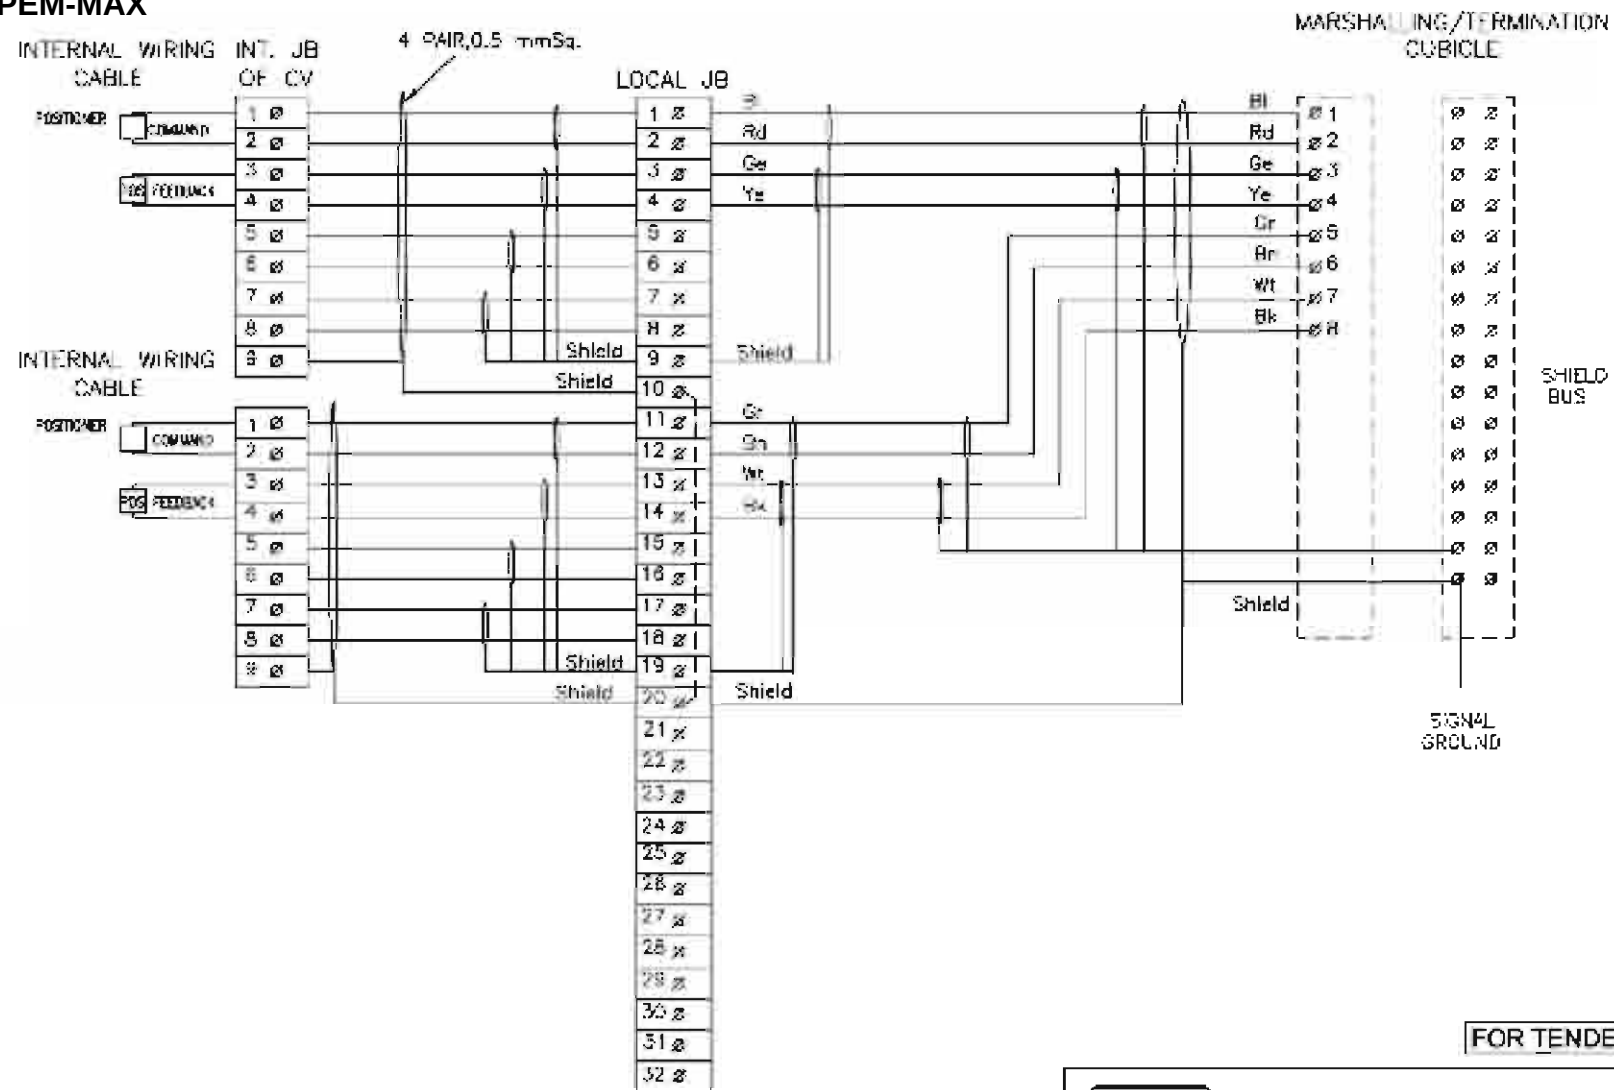

FOR TENDER PURPOSE ONLY

एन टी सी
NTPC


NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

										PROJECT				TYPICAL THERMAL POWER PROJECT			
										TITLE				INTERFACING OF FIELD INSTRUMENTS CONTROL VALVE			
A										REV. NO.				REV. NO.			
DESCRIPTION										DATE				A			
DRAWN										SIZE				0000-999-POI-A-065			
DESIGN										SCALE				NTS			
CHKD.										JRG. NO.				SH. D.3. OF 15			
M										C&I				A3			
E										ARCH.				A3			
C										APPRO				A3			
C&I										DATE				A3			
ARCH.										SIZE				A3			
APPRO										DATE				A3			
DATE										SIZE				A3			
SIZE										SCALE				NTS			
SCALE										JRG. NO.				0000-999-POI-A-065			
JRG. NO.										REV. NO.				A			
REV. NO.										DATE				A3			

963437/2022/PS-PEM-MAX

 This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
 No part of this document will be reproduced by any means without the written permission.

INTERFACIAL WIRING 2 PWR, 0.5 mmSq. (TYP)

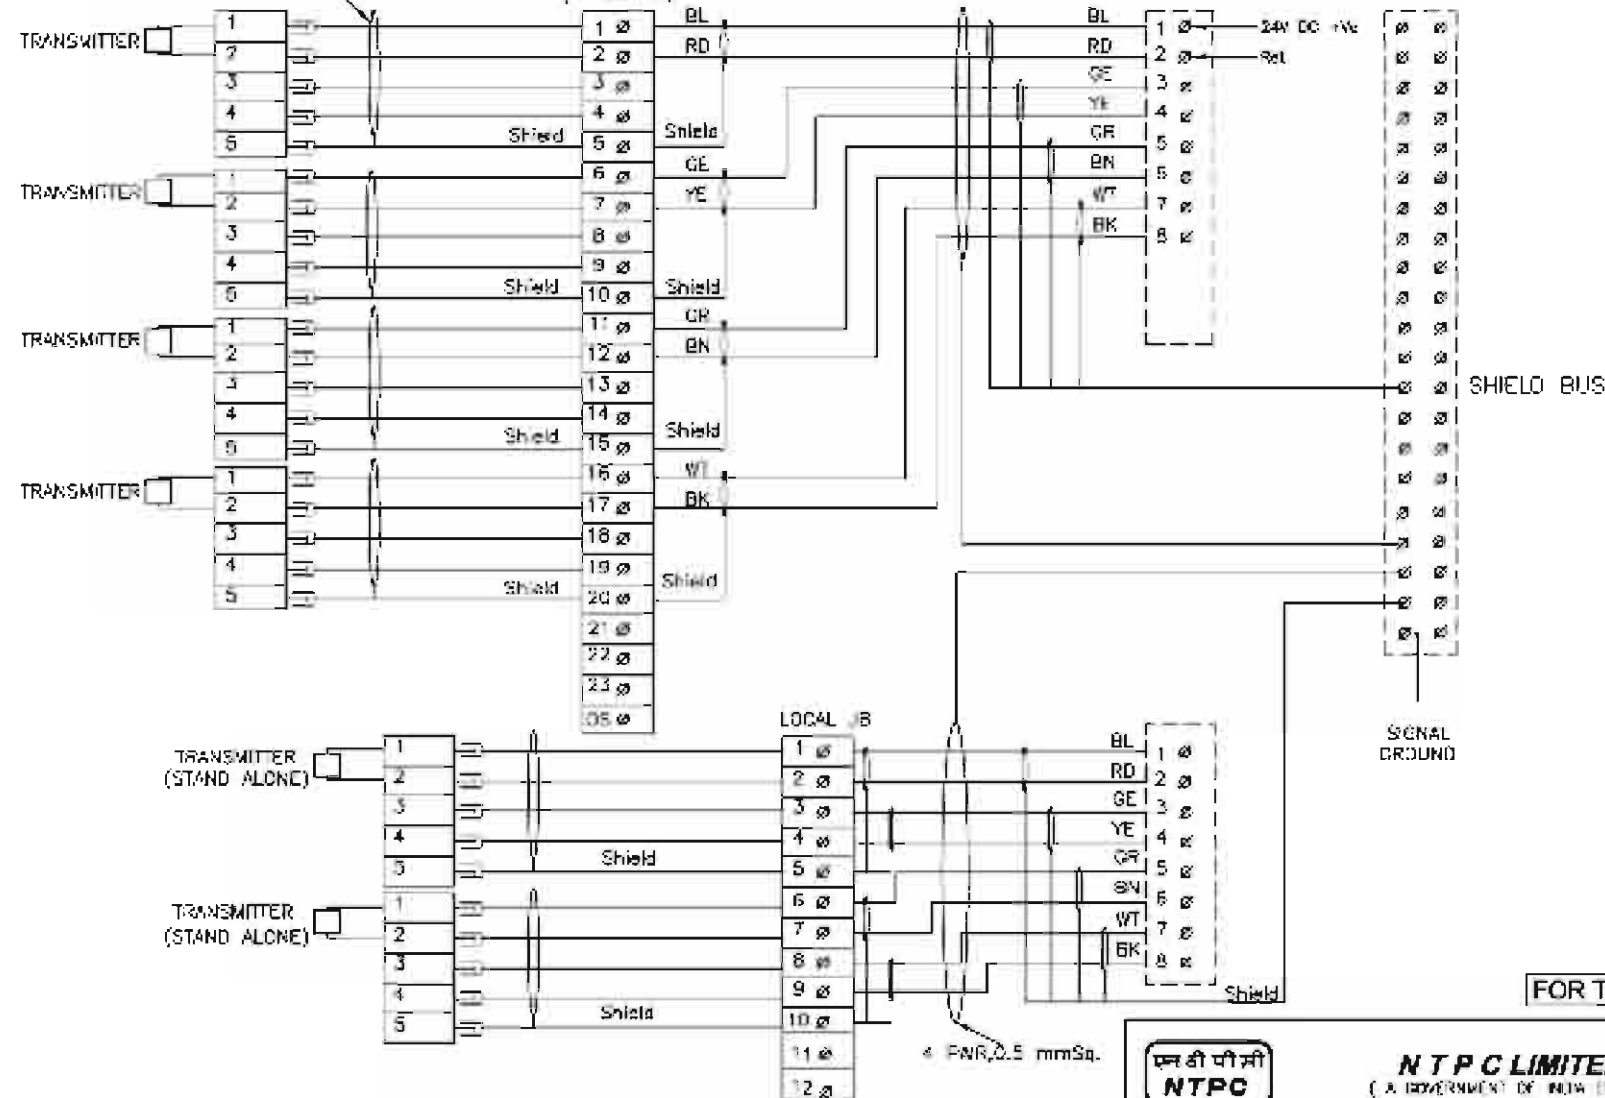INTEGRAL JB OF LIE/LIR
(4-20mA)MARSHALLING/TERMINATION
CUBICLEएन टी पी सी
NTPC
NTPC LIMITED
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION


										PROJECT					TYPICAL THERMAL POWER PROJECT			
B	NATIONAL WIRING FOR LIE/LIR MOUNTED SHOWN WIRING OF STAND ALONE TTR SHOWN										21.06.13	TITLE INTERFACING OF FIELD INSTRUMENTS 4-20mA						
A	FIRST ISSUE										12.1.05							
REV. NO.	DESCRIPTION			DRAWN	DESIGN	CHKD.	W	E	C	C&I	ARCH	APPRO	DATE	SIZE	SCALE	DRG. NO.	REV. NO.	
														A3	NTS	0000-999-POI-A-065	B	
This page is the part of Ttr Spec. No. DT TS 466-571 A102 CLEARED BY 324 of 410 SH 04 OF 15																		

963437/2022/PS-PEM-MAX

 This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
 No part of this document will be reproduced by any means without the written permission.
SH-LU
8JSSIGNAL
GROUND

NOTE

1. FOR CHP DRIVES, THE SCHEME SHALL
 BE FINALISED DURING DETAILED ENGG.

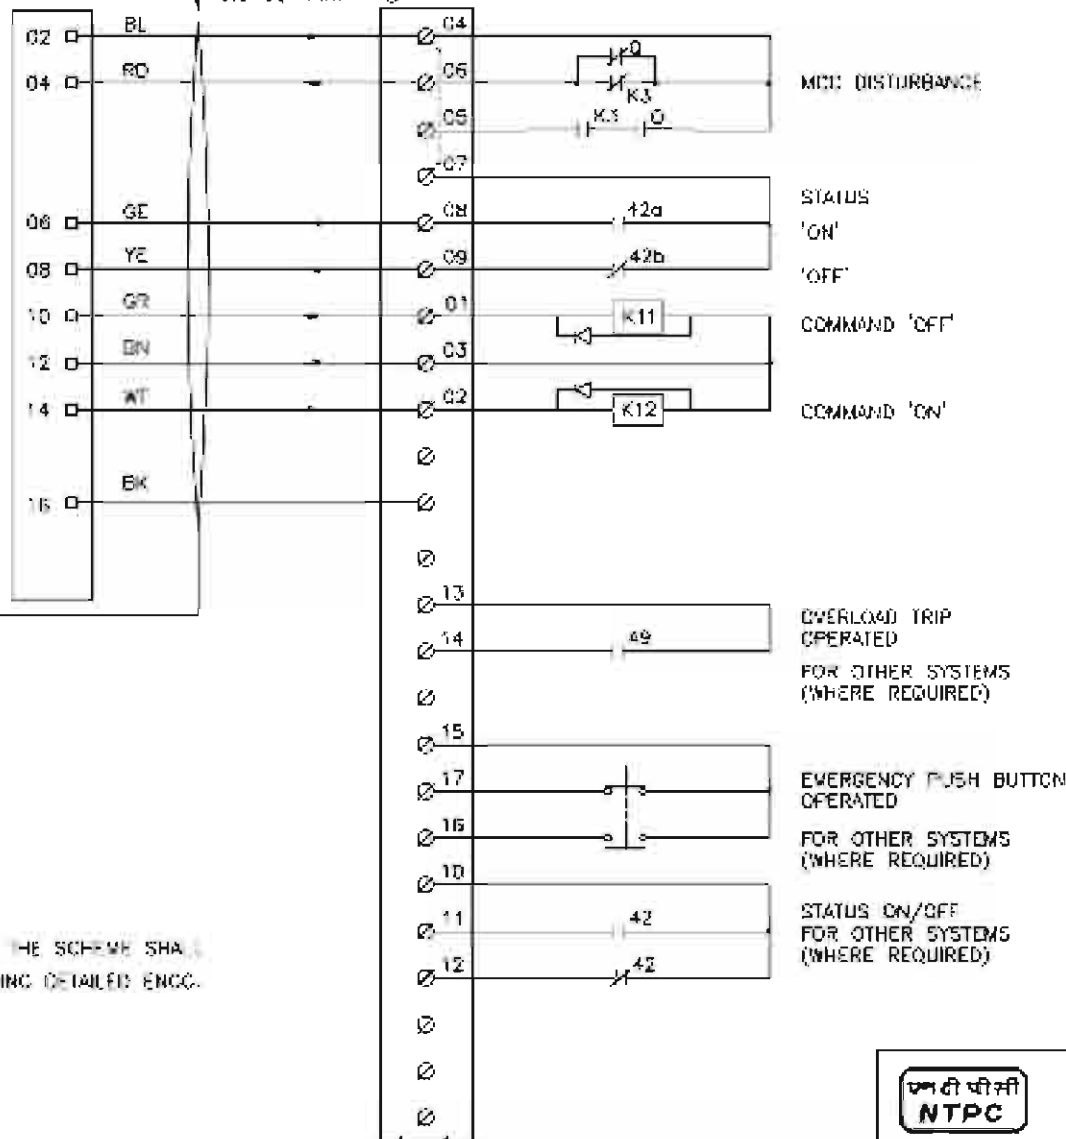MARSHALLING / TERMINATION CUBICLES 4 PAIR,
0.5 Sq. mmMCC/SWGR
D

[FOR TENDER PURPOSE ONLY]



NTPC LIMITED
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION

										PROJECT TYPICAL THERMAL POWER PROJECT							
										TITLE INTERFACING OF FIELD INSTRUMENTS INTERFACE OF DDCMIS WITH MCC/SWGR/ACTUATOR (LT MOTORS)							
A	FIRST ISSUE			AS							21.08.12	SIZE A3	SCALE NTS	DRG. NO 0000-999-POHA-065			REV. NO. A
REV. NO.	DESCRIPTION			DRAWN	DESIGN	CHECK.	W	E	C	C&I	ARCH	APPRO	DATE	SIZE	SCALE	DRG. NO	REV. NO.
					</												



**C&I SPECIFICATION FOR
LIME DOSING SYSTEM**

SECTION: C
SUB SECTION: C&I

**QUALITY ASSURANCE FOR
INSTRUMENTS & LCP AND TYPE TEST
REQUIREMENTS**

|

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION												
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)													
TESTS		ITEMS											
		Dimensions (R)	Make, Model, Type, Rating (R)	Process / Electrical connection (R)	Calibration (R)	Test as per standard(R)	Insulation Resistance (R)	IBR Certification (if applicable)(R)	Hydro Test(R)	Material Test certificate (R)			
1. PR Gauge (IS-3624)		Y	Y	Y	Y	Y							
2. Temp. Gauge (BS-5235)		Y	Y	Y	Y	Y							
3. Pr./D.P.Switch(BS-6134)		Y	Y	Y	Y	Y	Y						
4. Electronic Transmitter(IEC-60770)		Y	Y	Y	Y	Y	Y						
5. Temp. Switch		Y	Y	Y	Y	Y	Y						
6. Recorder(IS-9319/ANSI C-39.1)		Y	Y	Y	Y	Y	Y						
7. Vertical indicators		Y	Y	Y	Y		Y						
8. Digital Indicators		Y	Y	Y	Y		Y						
9. Integrators		Y	Y	Y	Y								
10. Electrical Metering Instrument (IS-1248)		Y	Y	Y	Y	Y	Y						
11. Transducer (IEC-688)		Y	Y	Y	Y	Y	Y						
12. Thermocouples [IEC – 754 / ANSI-MC-96.1)		Y	Y	Y	Y	Y	Y						
13. RTD(IEC-751)		Y	Y	Y	Y	Y	Y						
14. Thermowell		Y		Y				Y	Y	Y			
R-Routine Test		A- Acceptance Test				Y – Test applicable							
Note: 1) Detailed procedure of Environmental Stress Screening shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization 2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.													

FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION - VI, PART-B EID DOC. NO CS-0011-109(1A)-2	SUB-SECTION-V-QC1 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 1 OF 2

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION												एनटीपीसी NTPC
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)													
ITEMS	TESTS	Dimensions (R)	Make, Model, Type, Rating (R)	Process / Electrical connection (R)	Calibration (R)	Requirement as per standard (R)	WPS approval (A)	Non-destructive testing (R)	Calculation for accuracy (R)	Insulation Resistance (R)	IBR Certification as applicable (R)	Hydro test (R)	Material test certificate (A)
15. Cold junction compensation box		Y	Y	Y	Y					Y			
16. Orifice plate(BS-1042)		Y	Y	Y	Y *	Y	Y **	Y **			Y	Y **	Y
17. Flow nozzle(BS-1042)		Y	Y	Y	Y *	Y	Y	Y			Y	Y	Y
18. Impact head type element		Y	Y	Y					Y				Y
19. Level transmitter/float type switch		Y	Y	Y	Y					Y	Y	Y	Y
20. Analysers		Y	Y	Y	Y								
21. Dust emission monitors		Y	Y	Y	Y								
*Calibration to be carried out on one flow element of each type and size if calibration carried out as type test same shall not be repeated.													
** If applicable													
R-Routine Test A- Acceptance Test Y – Test applicable													
Note: 1) Detailed procedure of Environmental Stress screening test shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization 2) This is an Indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.													
FLUE GAS DESULPHURISATION SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION - VI, PART-B EID DOC. NO CS-0011-109(1A)-2				SUB-SECTION-V-QC1 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)				PAGE 2 OF 2			

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION														एनटीपीसी NTPC		
Process, Connection & piping FOR C&I SYSTEMS																	
TESTS																	
ITEMS	Visual @	GA, BOM, Layout of component & construction features @	Dimension @	Paint Shade/thickness @	Flattening, flaring, hydrotest, hardness check as per ASTM standard	Component Ratings @	Wiring @	Make, Model, Type, Rating @	R & HV @	Review of TC for instrument/devices (R)	Accessibility of TBs/Devices @	Illumination grounding @	Tubing @	Leak/Hydro test(A)	Chemical/physical properties of material (A)	Proof pressure test,Dismantling & reassembly test,Hydraulic impulse and vibration test (R)	Tests as per standards & specification
Local Instrument enclosure	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Local instruments racks	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Junction Box	Y	Y	Y	Y		Y		Y	Y								
Gauge Board	Y	Y	Y	Y		Y		Y		Y			Y	Y			
Impulse pipes and tubes	Y		Y		Y			Y							Y		
Socket weld fittings ANSI B-16.11	Y		Y					Y							Y		Y
Compression fittings	Y		Y					Y						Y	Y	Y	
Instrument valves & Valve manifolds	Y		Y					Y						Y	Y		
Copper tubings ASTM B75	Y							Y									Y
*-applicable for painted junction boxes.																	
Note: R-Routine Test A- Acceptance Test Y – Test applicable																	
Note: This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted alongwith relevant supporting documents.																	
FLUE GAS DESULPHURISATION SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION - VI, PART-B EID DOC. NO CS-0011-109(1A)-2				SUB-SECTION-V-QC2 PROCESS CONNECTION PIPING				PAGE 1 OF 1							

CLAUSE NO.		QUALITY ASSURANCE & INSPECTION														एनटीपीसी NTPC	
INSTRUMENTATION CABLE																	
TESTS		ITEMS															
		Conductor Resistance @ & (A)	High Voltage @ & (A)	Insulation Resistance @ & (A)	Constructional detail, dimensions (A)	Outer-Sheath/core marking, end sealing (A)	Thermal Stability (A) +	Visual, Surface finish (A) +	Electrical Parameters ** (A) +	Persulphate Test (A) +	Overall/Coverage/Continuity (A)	Swidesh chimney Test (SS-4241475) (A) ++	FRLS Test * (A) ++	Tensile & Elongation before & after aging (A) ++	Vol Resistivity at room & Elevated Temp. (A) ++	Spark test report review @	
1. Instrument cable twisted and shielded																	
Conductor(IS-8130)		Y			Y			Y									
Insulation(VDE-207)					Y	Y	Y	Y						Y		Y	
Pairing/Twisting					Y	Y		Y									
Shielding					Y			Y			Y						
Drain wire		Y			Y			Y		Y	Y						
Inner Sheath					Y	Y	Y	Y					Y	Y			
Outer Sheath					Y	Y	Y	Y					Y	Y			
Over all cable		Y	Y	Y	Y	Y		Y	Y			Y			Y		
Cable Drums(IS-10418)					Y			Y									
Note : High Temp. cables shall be subjected to tests as per VDE-207(Part-6) Compensating cables shall be checked for Thermal EMF/Endurance test as per IS 8784. Note : This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating his practice & Procedure along with relevant supporting documents during QP finalization for all items. Note : @ - Routine Test A - Acceptance Test																	

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION														एनटीपीसी NTPC	
CONTROL DESK, PLC PANEL SMOKE DETECTOR FIRE ALARM & CONTROL SYSTEM																
ITEMS	TESTS															
	Visual ®	GA, BOM, Lay Out of components ®	Dimensions ®	Paint Shade/Thickness/Adhesion ®	Alignment of Section ®	Component Rating/ Make / Type ®	Wiring ®	IR & HV ®	Review of TC for Instruments/ Devices/ Recorders, Indicators/ osaic Items/ Transducers ®	Accessibility of TBS/ Devices ®	Illumination ®	Functional Check for Control Element	Mimic ®	Test as per IEC 1131 ® *	Test as per Std ® & (A)	
1. Control Desk	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
2. Annunciation/ Control/ PLC Panel	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y			Y	Y	
3.Smoke Detectors (UL-268,EN-54 PT-7), Heat Detectors(UL-521/EN 54 PT-5) Annunciation/ Control Panel (UL -864, EN-54, PT-2)															Y	
Note: 1) Detailed procedure of Environmental Stress Screening test shall be as per Quality Assurance Programme in General Technical Conditions 2) This is an indicative list of test/ checks. The manufacturer is to furnish a detailed quality plan indicating the Practice and Procedure alongwith relevant supporting documents. • *Applicable for PLC • Y - Test Applicable , ® - Routine Test (A) - Acceptance Test																
FLUE GAS DESULPHURISATION SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION - VI, PART-B SID DOC. NO CS-0011-109(1A)-2						SUB-SECTION-V-QC4 CONTROL DESK, PLC PANEL, SMOKE DETECTOR, FIRE ALARM & CONTROL SYSTEM						PAGE 1 OF 1		

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION												एनटीपीसी NTPC		
ELECTRICAL ACTUATOR WITH INTEGRAL STARTER															
Test/Attributes Characteristics															
ITEM/ COPONENT/ SUB SYSTEM ASSEMBLY/ TESTING	RPM ®	No Load Current ®	IR & HV Test®	Mounting Dimension®	All routine Test as per Standard & Specification®	Correct Phase Sequence®	Operation & Setting of limit Switch/Torque Switch®	Stall Torque/Current (A)	Hand Wheel operation/ Auto de clutch function (A)	Function of Aux. like Potentiometer, space heater, position indicator	EPT output ®	Grease leakage ®	Local/ Remote (Open-Stop-Close) Operation® Safety check (Single phasing, Phase correction, Tripping etc.) (A)		
ELECTRICAL ACTUATOR WITH INTEGRAL STARTER(IS 9334)															
Motor	Y	Y	Y	Y	Y										
Final Testing	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Note: 1) Detailed procedure of Environmental Stress Screening test shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure finalized during QP finalization 2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the practices and procedure adopted along with relevant supporting documents.															
® - Routine Test (A) - Acceptance Test Y - Test applicable															

FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2	SUB-SECTION-V-QC7 ELECTRICAL ACTUATOR WITH INTEGRAL STARTERS	PAGE 1 OF 1

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS			STANDARD QUALITY PLAN				SPEC. NO :		DATE:			
					CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020			
		PROJECT:				PO NO.: --		DATE: --						
		ITEM: LOCAL CONTROL PANEL				SYSTEM: C&I		SECTION: C		SHEET 1 OF 9				
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	* D	** M C N			
					M	C/N								
1.0	RAW MATERIAL Sheet Steel (CRCA & HR)	1. Chemical Composition	MA	Chemical analysis	Sample	Sample	IS:1079 IS:513	IS:1079 IS:513	Test Certificate	✓	P/W	V		
		2. Bend Test	CR	Mech. test	Sample	Sample	IS:1079 IS:513	IS:1079 IS:513	Test Certificate	✓	P/W	V		
		3. Surface finish	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	---		
		4. Waviness	MA	Visual	100%	10%	Manufacturing Standard	No Waviness	Inspection Report	✓	P/W	---		
		5. Thickness	MA	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W	V		
		6. Mill marking	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	V		
2.0	Flats / Angles / Channels	1. Dimensions	MA	Measurement	Sample	Sample	IS:2062	IS:2062	Test Certificate	✓	P/W	---		
		2. Surface Defects	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	---		
		3. Straightness	MA	Measurement	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	---		
		4. Mill marking	MA	Visual	100%	10%	IS:2062	IS:2062	Inspection Report	✓	P/W	V		

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Seal		Reviewed by:	Sign & Date	Name	Seal
Reviewed by:			Reviewed by:					Approved by:			

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO :		DATE:				
				CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
						PROJECT:				PO NO.: --		DATE: --		
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 2 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	* D	** M C N			
					M	C/N								
3.0	Cables / Wires	1. Visual / Surface defects	MA	Visual	100%	10%	IS:1554 or IS:694	IS:1554 or IS:694	Inspection Report	√	P/W			
		2. IR and HV	MA	Electrical	100%	10%	IS:1554 or IS:694	IS:1554 or IS:694	Inspection Report	√	P/W			
		3. Conductor a) Resistance b) Size c) Sheet colour	MA MA MA	Electrical Measuremen t Visual	100% 100% 100%	10% 10% 10%	IS:1554 or IS:694	IS:1554 or IS:694	Inspection Report	√	P/W			
		4. Type / Routine Test Certificates	MA	Verification	100%	10%	IS:1554 or IS:694	IS:1554 or IS:694	Inspection Report	√	P/W			
4.0	Electrical Components like Annunciator Transformers Lamps Switches PBs Contactors Relays	1. Verification at make and Type	CR	Visual	Sample	Sample	Approved Drg/Datasheet	Approved Drg/Datasheet	Test Certificate	√	P/W			
		2. Verification of Test Certificates	CR	Scrutiny of Type / Routine T.Cs.	100%	10%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Inspection Report	√	P/W			
		3. Operation / Functional check	CR	Electrical	Sample e+ 100% @	Sample e+ 10% @	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Inspection Report	√	P/W			+ for relay & contactors only

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Seal			Sign & Date	Name	Seal
Reviewed by:			Reviewed by:								

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO :		DATE:				
				CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
						PROJECT:				PO NO.: --		DATE: --		
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 3 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	*	**			REMARKS
1	2	3	4	5	M	C/N	7	8	9	D	M	C	N	
	Timers, Space Heaters, Thermostat, Indicating meters etc.	4. I.R. 5. H.V. 6. Calibration 7. Pick up / Drop off Voltage	MA MA MA MA	Electrical Electrical Electrical Electrical	100% 100% 100% 100%	10% 10% 10% 10%	Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue	Inspection Report Inspection Report Inspection Report Inspection Report	√ √ √ √	P/W P/W P/W P/W	V		@ for all components except relays & contactors.
5.0	Misc. Components like Gaskets, Terminal Blocks etc.	1. Verification of Type / Make 2. Surface defects 3. IR / HV on Terminal Blocks	MA MA MA	Visual Visual Electrical	Sample Sample Sample	Sample Sample Sample	Manufacturing Standard Manufacturing Standard Manufacturing Standard	Manufacturing Standard Manufacturing Standard Manufacturing Standard	Test Certificate Test Certificate Test Certificate	√ √ √	P/W P/W P/W			
	IN PROCESS INSPECTION													

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Sign & Date		Name	Sign & Date		Name	Seal		Sign & Date		Name	Seal
Prepared by:	<i>Amal</i> 14/2/2020	CHETAN MALIK	Checked by:	<i>Kundan</i> 14/2/2020	KUNDAN PRASAD	336 of 410		Reviewed by:			
Reviewed by:	<i>P. R.</i> 14/2/2020	RK RAINA	Reviewed by:	<i>R. R.</i> 14/2/2020	RK JAISWAL			Approved by:			

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS			STANDARD QUALITY PLAN			SPEC. NO :		DATE:				
					CUSTOMER :			QP NO.: PE-QP-999-145-I056		DATE: 07.02.2020				
					PROJECT:			PO NO.: --		DATE: --				
					ITEM: LOCAL CONTROL PANEL			SYSTEM: C&I		SECTION: C		SHEET 4 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	* D	AGENCY			REMARKS
1	2	3	4	5	M	C/N	7	8	9		M	C	N	
6.0	Blanking / Bending / Forming	1. Dimensions	MI	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		2. Surface defects after bending	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W			
7.0	Nibbling / Punching	1. Cutout Sizes	MI	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		2. Deburring	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
8.0	ASSEMBLY Frame Assembly & Sheet fixing	1. Dimensions	MA	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		2. Alignment	MA	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		3. Welding Quality	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		4. Surface defects	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Seal		Reviewed by:	Sign & Date	Name	Seal
	<i>[Signature]</i> 14/2/2020	CHETAN MALIK		<i>[Signature]</i> 14/2/2020	KUNDAN PRASAD						
Reviewed by:	<i>[Signature]</i> 14/2/2020	RK RAINA	Reviewed by:	<i>[Signature]</i> 14/2/2020	RK JAISWAL			Approved by:			

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO :		DATE:				
				CUSTOMER :				QP NO.: PE-QP-999-145-I056		DATE: 07.02.2020				
						PROJECT:		PO NO.: --		DATE: --				
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 5 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANC E NORMS	FORMAT OF RECORD	AGENCY			REMARKS	
1	2	3	4	5	6		7	8	9	* D	**			
					M	C/N					M	C	N	
9.0	Pre-treatment and Painting	1. Pretreatment Process	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		2. Process parameters like bath temp. concentration etc.	MA	Measuremen t	Perio dic	Perio dic	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		3. Dipping / Removal Time	MA	Measuremen t	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		4. Surface quality after every dip	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		5. Primer after phosphating	MA	Visual, Thickness	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		6. Putty Application & Rubbing after primer	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		7. Paint first coat	MA	Visual, Thickness	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		

BHEL					
ENGINEERING			QUALITY		
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
	<i>[Signature]</i>	CHETAN MALIK		<i>[Signature]</i>	KUNDAN PRASAD
Reviewed by:		RK RAINA	Reviewed by:		RK JAISWAL
	<i>[Signature]</i>			<i>[Signature]</i>	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	
338 of 410	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO :		DATE:				
				CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
						PROJECT:				PO NO.: --		DATE: --		
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 6 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	* D	**			
					M	C/N					M	C	N	
		8. Putty Application and Rubbing after first coat of paint	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
		9. Paint second coat	MA	Visual, Thickness, Scratch test Colour adhesion	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	V		
10.	Panel Wiring	1. Wiring Layout	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		2. Wiring Termination (Crimped Lugs)	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		3. Ferrule numbers	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		4. Colour of wiring	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W	V		
		5. Size of Conductor	MA	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W	V		
11.	Component Mounting	1. Correct components	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			
		2. Fixing	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W			

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Seal			Sign & Date	Name	Seal
Prepared by:	<i>[Signature]</i>	CHETAN MALIK	Checked by:	<i>[Signature]</i>	KUNDAN PRASAD						
Reviewed by:	<i>[Signature]</i>	RK RAINA	Reviewed by:	<i>[Signature]</i>	RK JAISWAL						

339 of 410

This page is the part of Tech. Spec. No. PE TS 466-572 A102

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS			STANDARD QUALITY PLAN				SPEC. NO :		DATE:			
					CUSTOMER :				QP NO.: PE-QP-999-145-I056		DATE: 07.02.2020			
					PROJECT:				PO NO.: --		DATE: --			
					ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 7 OF 9			
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANC E NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	*	**			
					M	C/N				D	M	C	N	
12.	FINAL TESTING Final Inspection	1. Workmanship 2. Component layout (neatness, accessibility & safety) Mounting / Proper fixing of all components 3. Components identification Marking / Name plates	MA MA MA	Visual Visual Visual	100% 100% 100%	10% 10% 10%	Manufacturing Standard Approved Drg/Datasheet Approved Drg/Datasheet	Manufacturing Standard Approved Drg/Datasheet Approved Drg/Datasheet	Inspection Report Inspection Report Inspection Report	√ √ √	P/W P/W P/W	W W W		At Random by BHEL, based on 100 % internal test reports by Mfr.
		5. Dimensions 6. Door functioning 7. Paint Shade	MA MA CR	Measuremen t Functional Visual	100% 100% 100%	10% 10% 10%	Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Inspection Report Inspection Report Inspection Report	√ √ √	P/W P/W P/W	W W W		At Random by BHEL, based on 100 % internal test reports by Mfr.

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Seal		Sign & Date	Name	Seal	
Reviewed by:			Reviewed by:								

963437/2022/PS-PEM-MAX

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO :		DATE:				
				CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
						PROJECT:				PO NO.: --		DATE: --		
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 8 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	*	**			
					M	C/N				D	M	C	N	
		8. Paint Thickness	CR	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W	W		
		9. Workmanship of Gaskets	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	√	P/W	W		
		10. Wiring Layout	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	P/W	W		
		11. Wire Termination	MA	Pulling manually	Sample	Sample	----	Firm termination	Inspection Report	√	P/W	W		
		12. Continuity	MA	Electrical	100%	10%	----	Continuity OK	Inspection Report	√	P/W	W		
13.	TYPE TEST	Degree of Protection	CR	Mech. Protection	Sample	Sample	Approved Drg/Datasheet Relevant IS-13947 Part-1, IS-2148.	Approved Drg/Datasheet Relevant IS-13947 Part-1, IS-2148.	Type Test Certificate	√	P/W	V		
14	ROUTINE TEST	IR before & after HV Test	CR	Electrical	100%	10%	Approved Drg/Datasheet Relevant IS.	Approved Drg/Datasheet Relevant IS.	Inspection Report	√	P/W	W		

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
Sign & Date		Name	Sign & Date		Name	Seal		Sign & Date		Name	Seal
Prepared by:	<i>[Signature]</i> 14/02/2020	CHETAN MALIK	Checked by:	<i>[Signature]</i> 14/02/2020	KUNDAN PRASAD			Reviewed by:			
Reviewed by:	<i>[Signature]</i> 14/02/2020	RK RAINA	Reviewed by:	<i>[Signature]</i> 14/02/2020	RK JAISWAL			Approved by:			

963437/2022/PS-PEM-MAX





		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS				STANDARD QUALITY PLAN				SPEC. NO :		DATE:		
						CUSTOMER :				QP NO.: PE-QP-999-145-I056		DATE: 07.02.2020		
						PROJECT:				PO NO.: --		DATE: --		
						ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 9 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	D	**			
					M	C/N					M	C	N	
15	FUNCTIONAL TEST	1. Control Logic Operation	CR	Electrical	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	PW	W		
		2. Instrument Calibration	CR	Electrical	10%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	√	PW	W		
		3. Temperature rise	CR	Electrical	100%	10%	Approved Drg/Datasheet Relevant IS.	Approved Drg/Datasheet Relevant IS.	Inspection Report	√	PW	W		

NOTES:

- Customer's specification for painting shall be included in the technical specification. In the absence of Customer's spec. for painting, vendor to obtain BHEL's approval on their painting specification / procedure.
- Copies of all TC's (Test Certificates) for components shall be submitted to BHEL for verification and acceptance.
- BHEL reserves the right to conduct repeat tests, if required.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION, D: DOCUMENTATION,
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, C: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, N: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL

BHEL						BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY			Sign & Date		Doc No:			
	Sign & Date	Name		Sign & Date	Name	Seal			Sign & Date	Name	Seal
Prepared by:		CHETAN MALIK	Checked by:		KUNDAN PRASAD			Reviewed by:			
Reviewed by:		RK RAINA	Reviewed by:		RK JAISWAL			Approved by:			

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	TYPE TEST REQUIREMENTS 1.00.00 TYPE TEST REQUIREMENTS 1.01.00 General Requirements 1.01.01 The Contractor shall furnish the type test reports of all type tests as per relevant standards and codes as well as other specific tests indicated in this specification. A list of such tests are given for various equipment in table titled 'TYPE TEST REQUIREMENT FOR C&I SYSTEMS' at the end of this chapter and under the item Special Requirement for Solid State Equipments/Systems. For the balance equipment instrument, type tests may be conducted as per manufactures standard or if required by relevant standard. (a) Out of the tests listed, the Bidder/ sub-vendor/ manufacturer is required to conduct certain type tests specifically for this contract (and witnessed by Employer or his authorized representative) even if the same had been conducted earlier as clearly indicated subsequently against such tests. (b) For the rest, submission of type test results and certificate shall be acceptable provided. i. The same has been carried out by the Bidder/ sub-vendor on exactly the same model /rating of equipment. ii. There has been no change in the components from the offered equipment & tested equipment. iii. The test has been carried out as per the latest standards alongwith amendments as on the date of Bid opening but not more than five (5) year back. (c) In case the approved equipment is different from the one on which the type test had been conducted earlier or any of the above grounds, then the tests have to be repeated and the cost of such tests shall be borne by the Bidder/ sub-vendor within the quoted price and no extra cost will be payable by the Employer on this account. 1.01.02 As mentioned against certain items, the test certificates for some of the items shall be reviewed and approved by the main Bidder or his authorized representative and the balance have to be approved by the Employer. 1.01.03 The schedule of conduction of type tests/ submission of reports shall be submitted and finalized during pre-award discussion.	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CB-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS PAGE 1 OF 7

07/2022/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	
1.01.04	For the type tests to be conducted, Contractor shall submit detailed test procedure for approval by Employer. This shall clearly specify test setup, instruments to be used, procedure, acceptance norms (wherever applicable), recording of different parameters, interval of recording precautions to be taken etc. for the tests to be carried out.	
1.01.05	The Bidder shall indicate in the relevant BPS schedule, the cost of the type test for each item only for which type tests are to be conducted specifically for this project. The cost shall only be payable after conduction of the respective test in presence of authorize representative of Employer. If a test is waived off, then the cost shall not be payable.	
2.00.00	SPECIAL REQUIREMENT FOR SOLID STATE EQUIPMENTS/ SYSTEMS	
2.01.00	The minimum type test reports, over and above the requirements of above clause, which are to be submitted for each of the major C&I systems Analyzer instruments, various PLCs etc. shall be as indicated below: i) Surge Protections for Solid State Equipments/ Systems All solid state systems/ equipments shall be able to withstand the electrical noise and surges as encountered in actual service conditions and inherent in a power plant. All the solid state systems/ equipments shall be provided with all required protections that needs the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Hence, all front end cards which receive external signals like Analog input & output modules, Binary input & output modules etc. including power supply, data highway, data links shall be provided with protections that meets the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Complete details of the features incorporated in electronics systems to meet this requirement, the relevant tests carried out, the test certificates etc. shall be submitted alongwith the proposal. As an alternative to above, suitable class of IEC-60255-4 which is equivalent to ANSI 37.90a/ IEEE-472 may also be adopted for SWC test. ii) Dry Heat test as per IEC-68-2-2 or equivalent. iii) Damp Heat test as per IEC-68-2-3 or equivalent. iv) Vibration test as per IEC-68-2-6 or equivalent. v) Electrostatic discharge tests as per IEC 61000-4-2 or equivalent. vi) Radio frequency immunity test as per EN 50082-2 or equivalent.	
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS
PAGE 2 OF 7		

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	vii) Electromagnetic Immunity as per EN 61131-2 or equivalent. Test listed at item no. v, vi, vii. above are applicable for front end cards only as defined under item (i) above			
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CB-0011/109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 3 OF 7	

3.00.00 TYPE TEST REQUIREMENT FOR C&I SYSTEMS

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
1	Elect. Metering instruments	As per standard (col 4)	IS-1248	No	Yes	
2	Electronic transmitter	As per standard (col 4)	BS-6447 / IEC-60770	No	Yes	
3	INSTRUMENTATION CABLES TWISTED & SHIELDED			No	Yes	
4	Pressure gauge	Degree of protection test	IS-2147	No	No	
		Temp interference test	IS -3624	No	No	
5	Temperature gauge	Degree of protection test	IS-2147	No	No	
6	Pressure & DP switch	Degree of protection test	IS-2147	No	No	
		As per standard (col 4)	BS 5134	No	No	
7	Level switch	Degree of protection test	IS-2147	No	No	
8	Control valves	CV Test	ISA 75.02	No	Yes	
9	Flow Nozzles & Orifice plate	Calibration	ASME PTC , BS 1042	No	Yes	
10	PLCs	All tests as per IEC-1131	IEC-601131	No	Yes	

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0014667442	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 4 OF 7

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
11	Junction Box	Degree of protection test	IS-13947	No	Yes	
12	Battery charger (Not required for inbuilt chargers)	Degree of protection test	IS-13947	No	No	
		Short circuit current capability	IEC-60146-2	No	Yes	
		Temp rise test without redundant fans	Approved procedure, IEC 60146-2	No	Yes	
		SWC test	Approved procedure	No	Yes	
		Burn-in-test	Approved procedure	No	Yes	
		Efficiency	IEC-60146-2,	No	Yes	
		Audible Noise Test	IEC 60146-2	No	Yes	
		Fuse Clearing Capability	Approved procedure	No	Yes	
		Relative harmonic content	Approved procedure	No	Yes	

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0014691442	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 8 OF 11

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		ESD immunity test	IEC-61000-4-2-9(1)	No	Yes	
		Radio interference	IEC 60146-2	No	Yes	
		Over Load Test on Inverter & charger	Approved procedure	No	Yes	
		Restart Test	IEC 60146-2	No	Yes	
		Output voltage tolerance	Approved	No	Yes	
		Output voltage Harmonic content	Approved procedure	No	Yes	
		Insulation test	IEC 60146	No	Yes	
		Load Tests	Approved procedure	No	Yes	
		Preliminary light load test	IEC 60146	No	Yes	
		Current division / Voltage division	IEC 60146-2	No	Yes	
13	Battery	As per standard (col 4)	IEC -623 / IS 10918 for Ni-Cd IS-1652 for Plante Lead Acid	No	Yes	
14	Voltage stabilizers	Over Load Test	Approved procedure	No	Yes	

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-001-169-11-12	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 8 OF 11

963437/2022/PS-PEM-MAX

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		Temp rise test without redundant fans	Approved procedure	No	Yes	

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-001-1907-142	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 1 OF 7



C&I SPECIFICATION FOR LIME DOSING SYSTEM

SECTION: C
SUB SECTION: C&I

MANDATORY SPARES

Refer Annexure-II, Sub Section-D, Section-I of
Technical Specification for mandatory spares of C&I.

	C&I SPECIFICATION FOR LIME DOSING SYSTEM	SECTION: C SUB SECTION: C&I
SUB VENDOR LIST		

963437/2022/PS-PEM-MAX

PACKAGE WISE REGISTERED SUPPLIER LIST (PERMANENT CATEGORY) AS ON 2/22/2020

3:23:31 PM

SI No	Package Name	Supplier Name	Supplier Communication Address	Supplier Works Address
1	CONTROL VALVE	Valvitalia S.P.A. ,	Mr. Salvatore Ruggeri Via Tortona 69, Rivanazzano (Pavia) Phone- +39-03839459875 Pincode : 27055 Email : dario.torluccio@valvitalia.com	Works-1->Mr. Salvatore Ruggeri Via Tortona 69,Rivanazzano (Pavia) -- Italy Phone- +39-03839459875 FAX : Pincode : 27055 Email : dario.torluccio@valvitalia.com; diego.poletti@valvitalia.com; sales@bhgassociates.com
2	CONTROL VALVE	R.K.CONTROL INSTRUMENTS PVT. LTD.	PLOT NO.A-250, OPP.POLICE STATION, WAGLE INDUSTRIAL ESTATE, THANE Phone- 25820943/2331 Pincode : 400604 Email : rkcipl@vsnl.com ; rkcipl@bol.net.in	Works-1->SAVITH KUMAR PLOT NO. A-250, OPP.POLICE STATION,WAGLE INDUSTRIAL ESTATE, THANE -THANE-MAHARASHTRA INDIA Phone- 022-66060942 FAX : 022-25820801 Pincode : 400 604 Email : rkadmin@rkcipl.co.in
3	CONTROL VALVE	Mascot Valves Pvt. Ltd.	166-167 GIDC Naroda Ahmedabad Phone- 0792282 1619 Pincode : 382330 Email : dom.sales@mascotvalves.com	Works-1->Varun Patel Dir 166-167 ,GIDC Naroda -Ahmedabad-GUJARAT India Phone- 0792282 1619 / 3369 FAX : Pincode : 382330 Email : dom.sales@mascotvalves.com
4	CONTROL VALVE	EMERSON PROCESS MANAGEMENT CHENNAI LIMITED	147, KARAPAKKAM VILLAGE, CHENNAI Phone- 23722184, 23716242 Pincode : 600096 Email : jatinder.singh@emerson.com	Works-1->Mr. Rangarajan (Head - Lean and Manufact 147,Karapakkam Village, -Chennai-TAMIL NADU India Phone- 0444903 4395 FAX : Pincode : 600097 Email : Rangarajan.M@emerson.com
5	CONTROL VALVE	Severn Glocon India Pvt. Ltd.	F96 & F97, Sipcot Industrial Park, Irungattukottai, Chennai, Phone- 044-47104200, Pincode : 602117, Email : info@severnglocon.co.in,	Works-1->Mr. K.Kaushik, F96 & F97, Sipcot Industrial Park,Irungattukottai, -Chennai-TAMIL NADU India Phone- 044-47104200, FAX : 044-47100073, Pincode : 602117, Email : info@severnglocon.co.in
6	CONTROL VALVE	BOMAFI SPECIAL VALVE SOLUTIONS PVT LTD	Mr. K.M. Anklesaria/ R. M. Anklesaria Plot No: 285/2, Panchratna Estate, Near Ramol Bridge, Vatva Ahmedabad Phone- 079-40083825 Pincode : 382445 Email : info@bomafi-india.com	Works-1->Mr. K.M. Anklesaria/ Mr. R.M. Anklesaria Dir Plot No: 285/2, Panchratna Estate, Near Ramol Bridge, Vatva, -Ahmedabad-GUJARAT INDIA Phone- 079-40083825 FAX : Pincode : 382445 Email : info@bomafi-india.com
7	CONTROL VALVE	FORBES MARSHALL ARCA PVT.LTD.	A-34/35 , MIDC ESTATE, H-BLOCK, PIMPRI, PUNE, Phone- 020-27442020, Pincode : 411018 Email : mnadgaundi@forbesmarshall.com	Works-1->Mr. Sanjeev Shinde A-34/35 MIDC Estate,H Block, Pimpri, -Pune-MAHARASHTRA India Phone- 9323176406 FAX : 020-27442040 Pincode : 411018 Email : sshinde@forbesmarshall.com
8	CONTROL VALVE	INSTRUMENTATION LTD.	KANJIKODE WEST, PALAKKAD, PALAKKAD Phone- 2566127-130,2567128 Pincode : 678623 Email : icvldil@gmail.com;fa2@ilpgt.com	Works-1->D.SASIDHARAN, AGM(Works&PPC) KANJIKODE WEST, -PALAKKAD-KERALA INDIA Phone- 0491-2566536 FAX : 0491-2566135 Pincode : 678623 Email : sasidharan@ilpgt.com;mraraj@ilpgt.com;gireesh@ilpgt.com, commercial@ilpgt.com;fa2@ilpgt.com;nazeera@ilpgt.com;pkv@ilpgt.com;remith@ilpgt.com
9	CONTROL VALVE	Koso India Private Limited,	H 33 & 34, MIDC, Ambad, Nashik, Phone- 09650233433 Pincode : 422010, Email : jetmal.gour@koso.co.in	Works-1->P.J.ASHOK KUMAR/SEEMA ANAND Control Valve Division, H-33&34, MIDC, Ambad, -Nashik-MAHARASHTRA India Phone- 91 944 744 3198 FAX : 0491 - 5269914 Pincode : 422010 Email : pja@koso.co.in;enquiry@koso.co.in Works-2->+P.J.ASHOK KUMAR/SEEMA ANAND J-1,MIDC,Ambad -Nashik-MAHARASHTRA India Phone- 91 944 744 3198 FAX : 0491 - 5269914 Pincode : 422010 Email : pja@koso.co.in;enquiry@koso.co.in
10	CONTROL VALVE	SAMSON CONTROLS PVT. LTD.	Mr. Atul raje-MD D 281, MIDC Ranjangaon Ta Shirur Pune Phone- 02067246600 Pincode : 412220 Email : sales@samsoncontrols.net	Works-1-> Others D 281, MIDC Ranjangaon - Pune-MAHARASHTRA India Phone- 02067246600,8554997963 FAX : Pincode : 412220 Email : sales@samsoncontrols.net
11	CONTROL VALVE	KSB MIL CONTROLS LTD.	Mr.Jacob Cherian/Mr.Geo Jolly Meladoor, Annamanada P.O. MALA, Thrissur Phone- 0480-2695700 Pincode : 680741 Email : hiiu.simon@ksb.com	Works-1->Mr.Biju Simon/Mr.Jose Paul Meladoor, Annamanada, -Thrissur-KERALA INDIA Phone- 9447555500 FAX : 91 480 2890952 Pincode : 680741 Email : jose.paul@ksb.com

963437/2022/PS-PEM-MAX

12	CONTROL VALVE	SUZHOU DELAN ENERGY SCIENCE & TECHNOLOGY CO., LTD.	No 566 Fangqiao Road Caohu Industrial Park, Xiangcheng Economic Development Zone, Suzhou Phone- 008618012776062 Pincode : 215143 Email : jeanielei@delan-valve.com	Works-1->Mr. Zong Xin CEO No 566 Fangqiao Road Caohu Industrial Park,Xiangcheng E. Z. - Suzhou-Foreign Country CHINA Phone- 008618012776062 FAX : Pincode : 215143 Email : jeanielei@delan-valve.com
13	CONTROL VALVE	WALDEMAR PRUSS ARMATURENFABRIK GMBH	Mr. Winfried Dremhel Schulenburgerlandstrasse 261, Hannover Phone- +49-511279260 Pincode : 30419 Email : dremhel@pruss.de; vogel@pruss.de	Works-1->Mr. Winfried Dremhel CEO Schulenburgerlandstrasse 261, -Hannover- GERMANY Phone- +49-511279260 FAX : Pincode : 30419 Email : dremhel@pruss.de
14	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Kaustubha Udyog,	S.No. 36/1/1, Sinhgad Road, Vadgaon Khurd, Near Lokmat Press, Pune, Phone- 020-24393577, Pincode : Email : pressure@vsnl.com,	
15	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com	Works-1->Mr. Hitesh Parmar/Mr. Hitesh Parmar Plot No.2306, Phase II, GIDC Chhatral, -Kalol- GUJARAT INDIA Phone- 9327359227 FAX : 02764-233440 Pincode : 382729 Email : hitesh.parmar@ashcroftindia.com
16	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in	Works-1->C S Shankar 127, Sidco North Phase, Ambattur Estates, -CHENNAI-TAMIL NADU INDIA Phone- 8754491904 FAX : 044-26248849 Pincode : 600050 Email : cservice@switzerinstrument.com
17	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com	
18	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Barksdale GmbH, Germany	Michael Weileder Dorn Assenheimer, Strasse 27 Reichelsheim Phone- +91-9999107840 Pincode : D-61203 Email : msingh@barksdale.de	
19	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	DRESSER INDUSTRIES INC.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 02764-233682 Pincode : 382729 Email : Nishit_patel@ashcroftindia.com	
20	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdresh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdresh@sherman-india.com	Works-1->LARRY DEGARMO/ ROY STUMBOUGH 14685 W. 105TH STREET, LENEXA -KANSAS- USA Phone- 913-888-0767 FAX : 913-888-0767 Pincode : 66215 Email : rstumbough@sorinc.com
21	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS INDUSTRIES LIMITED	B-20-21, INDUSTRIAL AREA, MEERUT ROAD, GHAZIABAD Phone- 0120-2712016 Pincode : Email : mkta@indfos.com	
22	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS (INDIA) LIMITED	MR.L.C.VENKATRANGAN/MR.B.KANNA N New No.17, II Floor, Adwave Towers, Dr.Sevalia Shivaji Salai, T.Nagar Chennai Phone- +91 44 24353407 Pincode : 600017 Email : delhi@indfos.com	
23	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	BOSE PANDA INSTRUMENTS PVT.LTD.	Mr. Partha Bose 44, Saheed Hemanta Kumar Bose, Sarani, Kolkata Phone- +91 33 2548 7220 Pincode : 700074 Email : parthabosebpi@gmail.com; bosepanda@vsnl.net	Works-1->Mr. Partha Bose 44, Saheed Hemanta Kumar Bose,Sarani, -Kolkata-WEST BENGAL India Phone- +91 33 2548 7220 FAX : +91 33 2548 0429, Pincode : 700074 Email : parthabosebpi@gmail.com bosepanda@vsnl.net
24	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in	Works-1->Mr. Gautam Mukherjee Kusumba,Sonarpur Station Road,P.O. - Narendrapur, -Kolkata-WEST BENGAL INDIA Phone- 9836878855 FAX : 033-24342748 Pincode : 700103 Email : gkm_ani@hotmail.com
25	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700035 Email : mguru@vsnl.net	Works-1->NA NA -- Phone- FAX : Pincode : Email :

963437/2022/PS-REM-MAX

26	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com	Works-1->MR G.SRINIVASAN/MR ANUJ MALPANI PLOT NO:A-19/2 & T-4/2,I.DA. NACHARAM , -HYDERABAD-TELANGANA INDIA Phone- 09866550762 FAX : 040 27152193 Pincode : 560076 Email : gshrinivasan@forbesmarshall.com
27	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com	Works-1->Mr. Hitesh Parmar/Mr. Hitesh Parmar Plot No.2306, Phase II, GIDC Chhatral, -Kalol-GUJARAT INDIA Phone- 9327359227 FAX : 02764-233440 Pincode : 382729 Email : hitesh.parmar@ashcroftindia.com
28	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com	Works-1->Mr. Shyam Warilani/Mr. V Suresh Babu Plot No 34 À GIDC À Phase 1, -VAPI-GUJARAT INDIA Phone- +91 11 4161 7111 FAX : 022 2687 3613 Pincode : 396 195 Email : pbajaj@baumer.com
29	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com	Works-1->Shikha Hazra/ Shyamal Hazra 32, Industrial Suburb,Yeshwanthpur -BANGALORE-KARNATAKA INDIA Phone- 080-23370300 FAX : 080-23379890 Pincode : 560022 Email : shikhahazra@hgurusouth.com
30	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,	Works-1->Gauge Bourdon India Pvt. Ltd., Plot No-4, 5, 6,Jawahar Co-operative Industrial Estate, -Kalamboli Taluka Panvel-MAHARASHTRA India Phone- 022-27421095, FAX : 022-27421901, Pincode : 410209, Email : info@general-gauges.com
31	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in	Works-1-> Others 26/2, G Type, Global Ind. Park Near Nahuli Railway Crossing, -Vapi-GUJARAT INDIA Phone- 9920576002 FAX : Pincode : 396105 Email : sales@nesstech.co.in, bkapadia@nesstech.co.in
32	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com	Works-1->Scientific Center, Others By-Pass Junction,Near Kalsekar College kausa, mumbra,Thane -Mumbai-MAHARASHTRA INDIA Phone- 022-25491409,9892230623 FAX : Pincode : 400612 Email : sdbpl@vsnl.com
33	LEVEL GAUGE	TOSHNIWAL BROTHERS PVT.LTD.	WORKS:TOSHNIWAL IND.PVT.LTD, INDUSTRIAL ESTATE MAKHUPURA, AJMER Phone- 441171 Pincode : 305002 Email : toshniwalprocess@gmail.com	
34	LEVEL GAUGE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com	Works-1->Mr. Bharat Kumar/ Mr. Sasi Kumar Plot No. 92B & 93B,Sec-V, IMTManesar -GURGAON-HARYANA INDIA Phone- 0124-4366000 TO 9 FAX : 0124-2290884 Pincode : 122002 Email : bharat@blissanand .com
35	LEVEL GAUGE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in	Works-1->R Gopinath 27 Nahur Udyog Industrial Premises,M.M.Malviya Road, Mulund(-MUMBAI-MAHARASHTRA INDIA Phone- +912225918567 FAX : +912225918566 Pincode : 400080 Email : sales@sigmainstruments.co.in
36	TRANSMITTERS	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,	Works-1-> Khasra No.: 218-230& 235, Industrial Estate,Makhupura, -Ajmer-RAJASTHAN India Phone- 9887865856, FAX : 0145-2695174, Pincode : 305002, Email : raiteev.aunta@tipl.com
37	TRANSMITTERS	YOKOGAWA INDIA LIMITED,	PLOT NO.96, ELECTRONICS CITY COMPLEX, HOSUR ROAD, BANGALORE, Phone- 080-41586000, Pincode : Email : udav.shankar@in.yokogawa.com.	Works-1-> PLOT NO.96, ELECTRONICS CITY COMPLEX, HOSUR ROAD, -BANGALORE-KARNATAKA INDIA Phone- 080-41586000, FAX : 080-28521442, Pincode : Email : udav.shankar@in.yokogawa.com
38	TRANSMITTERS	ABB INDIA LIMITED	MR. RAJIV GOVIL 14, MATHURA ROAD, FARIDABAD Phone- 09971085678 Pincode : 121003 Email : vinin.swami@in.abb.com	

963437/2022/PS-PEM-MAX

39	TRANSMITTERS	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com	Works-1->Mr. BHAGWAN SINGH/ Mr. NANDAN SINGH F-61, OKHLA INDL.AREA,PHASE-I -NEW DELHI-DELHI INDIA Phone- 011-47627200 Extn. 3 FAX : 011- 26819440 Pincode : 110 020 Email : production@vautomat.com
40	TRANSMITTERS	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com	
41	TRANSMITTERS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com	Works-1->Mr. Santosh Shukla Others R-628,TTC Industrial Area, MIDC Rabale, -Navi Mumbai- MAHARASHTRA India Phone- 9821350761, FAX : 022-27695559, Pincode : 400701, Email : sales@panamengineers.com
42	TRANSMITTERS	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in	Works-1->MR. MOHAN PADWAL 691/A/2,BIBWEWADI INDL ESTATE -PUNE- MAHARASHTRA INDIA Phone- 918600042374 FAX : 912024215670 Pincode : 411037 Email : wm@sbem.co.in
43	TRANSMITTERS	Endress + Hauser (India) Pvt. Ltd.,	Mr. Prakash Vaghela 215-216, DLF Tower 'A', Jasola District Centre, New Delhi, Phone- 9717593001, Pincode : 110025, Email : prakash.vaghela@in.endress.com,	Works-1-> M-171 to 173, MIDC, Waluj, - Aurangabad-MAHARASHTRA India Phone- 9881000474, FAX : 0240-2555179, Pincode : 431136, Email : Narendra.Kulkarni@wetzer.endress.com
44	TRANSMITTERS	Moore Industries International Inc.	Leonard.W. Moore/ Matt Moren 16650 Schoenborn St. North Hills Phone- +1 818 830 5548 Pincode : 91343 Email : mmoren@miinet.com	Works-1->Matt Moren/Gina Cruz 16650 Schoenborn St., North Hills -CALIFORNIA- USA Phone- +1 818 894 7111, ext FAX : +1 818 830 5588 Pincode : 91343 Email : gcruz@miinet.com
45	TRANSMITTERS	EMERSON PROCESS MANAGEMENT (INDIA) PVT.LTD.	Mr. Amit Paithankar/Vikram Raj Singh 206-210,BALARAMA BUILDING 2ND FLR. BANDRA EAST MUMBAI Phone- 9619121500 Pincode : 400051 Email : vikramraj.singh@emerson.com	Works-1->Kalpesh Chandan/Hrishikesh Aghor Plot No. A 145/4 TTC IND AREA,MIDC, PAWANE, - NAVI MUMBAI-MAHARASHTRA INDIA Phone- 9619688001 FAX : 022-66736000 Pincode : 400 705 Email : Kalpesh.chandan@emerson.com
46	TRANSMITTERS	NIVO CONTROLS PVT. LTD.	Mr. Praveen Toshniwal 104-115, Electronic Complex, Indore Phone- 0731-4081305 Pincode : 452010 Email : sales@nivocontrols.com	Works-1->Mr. S L Sadani Others 104 - 115,Electronic Complex -Indore-MADHYA PRADESH INDIA Phone- 0731-4081307 FAX : Pincode : 452010 Email : sales@nivocontrols.com;sadanis@nivocontrols.com
47	TRANSMITTERS	SMART INSTRUMENTS LTD, BRAZIL	Agents: Digital Electronic Ltd. 74/11 'C' Cross Road MIDC Andheri (East) MUMBAI Phone- 28208477 Pincode : 400093 Email : corp@delbby.rpgms.ems.vsnl.net.in	
48	TRANSMITTERS	SIEMENS LIMITED	Dr. Armin Bruck/Sandeep Mathur 130, Pandurang Budhkar Marg Worli Mumbai Phone- 0124 383 7377 Pincode : 400018 Email : ankit.varshnev@siemens.com	Works-1->Ankit Varshney Kalwa Works, Thane- Belapur Road, Thane, -MUMBAI-MAHARASHTRA INDIA Phone- FAX : Pincode : 400708 Email :
49	TRANSMITTERS	Honeywell Automation India Limited	Mr. Ritwiji Kulkarni 917, INTERNATIONAL TRADE TOWER, NEHRU PLACE, NEW DELHI Phone- 9890200584 Pincode : 110019 Email : rajesh.chaudhary@honeywell.com	Works-1->Mr.Kedar Tillu 53, 54, 56 & 57,Hadapsar Industrial Estate -PUNE- MAHARASHTRA INDIA Phone- 9665034625 FAX : 020 66039905 Pincode : 411013 Email : kedar.tillu@honeywell.com
50	SIGHT FLOW INDICATORS	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com	Works-1->Mr. BHAGWAN SINGH/ Mr. NANDAN SINGH F-34, OKHLA INDL.AREA,PHASE-I -NEW DELHI-DELHI INDIA Phone- 011-47627200 Extn. 3 FAX : 011- 26819440 Pincode : 110 020 Email : production@vautomat.com
51	SIGHT FLOW INDICATORS	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com	

963437/2022/PS-PEM-MAX

52	SIGHT FLOW INDICATORS	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr. RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com	Works-1->Mr. Bharat Kumar/ Mr. Sasi Kumar Plot No. 240, Sector-3, HSIIDC, Bawal -Rewari-HARYANA INDIA Phone- 0124-4366000 TO 9 FAX : 0124-2290884 Pincode : 123501 Email : bharat@blissanand.com
53	SIGHT FLOW INDICATORS	B.K.EQUIPMENTS PVT.LTD.	T. BALAKRISHNAN/S.VENKATESH 217 , ARCOT ROAD PORUR , CHENNAI Phone- 9444057761 Pincode : 600116 Email : bkequip@gmail.com	Works-1->V.KARUNANIDHI/P.BABU 217 , ARCOT ROAD,PORUR , -CHENNAI-TAMIL NADU INDIA Phone- 9444131187 FAX : 044-24766852 Pincode : 600116 Email : bkequip@gmail.com
54	SIGHT FLOW INDICATORS	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in	Works-1->R Gopinath 27 Nahur Udyog Industrial Premises,M.M.Malviya Road, Mulund(-MUMBAI-MAHARASHTRA INDIA Phone- +912225918567 FAX : +912225918566 Pincode : 400080 Email : sales@sigmainstruments.co.in
55	SIGHT FLOW INDICATORS	INSTRUMENTATION ENGINEERS PVT LTD	SH.N.V.RAM GOPAL/MS. N.NIHARIKA PLOTS 1,2,3, PHASE-III, IDA, JEEDIMETLA HYDERABAD Phone- 9848407365 Pincode : 500055 Email : iedelhi@ieflowmeters.com	Works-1->MR. A.V.MURTHY/MR. K.T. RAVISANKER PLOTS 1,2,3, PHASE-III,IDA, JEEDIMETLA -HYDERABAD-TELANGANA INDIA Phone- 9885107312 FAX : 040-23096401 Pincode : 500055 Email : sales@ieflowmeters.com
56	DIFFERENTIAL PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdresh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdresh@sherman-india.com	
57	JUNCTION BOX	K.S.INSTRUMENTS PVT.LTD.	S Raghavan No. 72, 3rd Main, 1st Stage Industrial Suburb, Yeshwanthpur Bangalore Phone- 9880385770 Pincode : 560022 Email : sales1@ksinstruments.net	
58	JUNCTION BOX	SUCHITRA INDUSTRIES	NO-2,OPP-27 AECS LAYOUT 2ND STG REJAMAHALVILAS EXTN 2ND STG BANGALORE Phone- Pincode : Email : suchitra.industriesblr@gmail.com	Works-1->B. Srinivas Suchitra Industries, Opp No 53, Muneshwara Black Devinagar, Lottagal hal -BANGALORE-KARNATAKA INDIA Phone- 080-23511247 FAX : Pincode : 560094 Email : suchitra_industries@yahoo.com
59	JUNCTION BOX	FLEXPRO ELECTRICALS PVT. LTD.	Mr. Dineshbhai Zaveri C-1/ 27&37, GIDC, Kabilpore, Navsari Phone- 02637-265140,265003 Pincode : 396424 Email : flexpro@flexproltd.com	Works-1->Mr. Dineshbhai Zaveri CEO C-1/ 27&37, GIDC, Kabilpore, -Navsari-GUJARAT INDIA Phone- 02637-265140,265003 FAX : 02637-265308 Pincode : 396424 Email : flexpro@flexproltd.com
60	JUNCTION BOX	Shrenik & Company,	Mr. Mitesh Shah/Mr. Pulin Shah 39 A/3 ,Panchratna Industrial Estate, Sarkhej-Bavla Road Ahmedabad Phone- 9825024921 Pincode : 382213 Email : sales@pustron.com, pulin@sumip.com	Works-1->Mr.Pulin Shah/ Mr. Kaloesh Parmar 39 A/3 ,Panchratna Industrial Est,Sarkhej-Bavla Road, Changodhar -Ahmedabad-GUJARAT INDIA Phone- 98250 80339 1 FAX : 079-26932424 Pincode : 382213 Email : sales@sumip.com
61	JUNCTION BOX	AJMERA INDUSTRIAL & ENGINEERING WORKS	JIGNESH MAHENDRA AJMERA DENA BANK BLDG.,SHREE NAGESH INDL. ESTATE,STATION ROAD, MUMBAI Phone- 022 67973578 Pincode : 400 088 Email : ajmera@ajmera.net, jmajmera@yahoo.com	Works-1->JIGNESH MAHENDRA AJMERA DENA BANK BLDG., SHREE NAGESHINDL. ESTATE,STATION ROAD, -MUMBAI-MAHARASHTRA INDIA Phone- 022 67973578 FAX : Pincode : 400 088 Email : ajmera@ajmera.net
62	INSTRUMENTS TUBE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com	Works-1->S.R.SINGH/ NAVEEN SINGH B - 2, SECTOR - 6, -NOIDA-UTTAR PRADESH INDIA Phone- 0120-4352940 FAX : 0120-4352940 Pincode : 201301 Email : naveensingh@vsnl.com
63	INSTRUMENTS TUBE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com	
64	INSTRUMENTS TUBE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com	Works-1->ALEX BAPTIST/ K. SRINIVAS 7. SIDHAPURA INDUSTRIAL ESTATE,SV ROAD, GOREGAON(WEST) -MUMBAI-MAHARASHTRA INDIA Phone- 022-42631700 FAX : 022-40035259 Pincode : 400 062 Email : srinivas@precision-engg.com

963437/2022/PS-PEM-MAX

65	INSTRUMENTS TUBE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone-(022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com	Works-1->Mr. Tansen Choudhari/Mr. Mahesh Darekar Shed No.8, Lonavla Indl.Co-op.Estate Ltd,Nagargaon, -Lonavla-MAHARASHTRA INDIA Phone- 9823951347 FAX : (02114) 271132 Pincode : 410 401 Email : factory@hyd-air.com
66	LEVEL SWITCH-CAPACITANCE TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone-+919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in	Works-1->R Gopinath 27 Nahur Udyog Industrial Premises,M.M.Malviya Road, Mulund(-MUMBAI-MAHARASHTRA INDIA Phone-+912225918567 FAX : +912225918566 Pincode : 400080 Email : sales@sigmainstruments.co.in
67	LEVEL SWITCH-CAPACITANCE TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com	Works-1->Mr. BHAGWAN SINGH/ Mr. NANDAN SINGH F-61, OKHLA INDL.AREA,PHASE-I -NEW DELHI-DELHI INDIA Phone- 011-47627200 Extn. 3 FAX : 011- 26819440 Pincode : 110 020 Email : production@vautomat.com
68	LEVEL SWITCH-CAPACITANCE TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone-9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com	Works-1->Scientific Center, Others By-Pass Junction,Near Kalsekar College kausa, mumbra,Thane -Mumbai-MAHARASHTRA INDIA Phone- 022-25491409,9892230623 FAX : Pincode : 400612 Email : sdbpl@vsnl.com
69	LEVEL SWITCH-CAPACITANCE TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone-9850560042 Pincode : 411 026 Email : ho@punetechtrol.com	
70	LEVEL SWITCH-CAPACITANCE TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : h_iana@levcongroup.com	
71	LEVEL SWITCH-CAPACITANCE TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone-+91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com	Works-1->Mr. Shyam Warilani/Mr. V Suresh Babu Plot No 34 A GIDC A Phase 1, -VAPI-GUJARAT INDIA Phone- +91 11 4161 7111 FAX : 022 2687 3613 Pincode : 396 195 Email : pbajaj@baumer.com
72	LEVEL SWITCH-CONDUTIVITY TYPE	Sapcon Instrument Pvt Ltd.	131, PALSHIKAR COLONY Contact Person- Mr. Ashwin (9826080207) INDORE Phone- +91-731-4085751, Pincode : 452004 Email : sales@sapconinstruments.com	Works-1->Mr. Ashwin R Palshikar/Mr. Navin Bodse 131 PALSHIKAR COLONY, -INDORE-MADHYA PRADESH INDIA Phone- 9754261005 FAX : 0731-2475475 Pincode : 452004 Email : sales@sapcon.in
73	LEVEL SWITCH-CONDUTIVITY TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : h_iana@levcongroup.com	Works-1-> 38G, PICNIC GARDEN ROAD, -KOLKATA-WEST BENGAL INDIA Phone- FAX : Pincode : Email :
74	LEVEL SWITCH-CONDUTIVITY TYPE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com	Works-1->Mr. Bharat Kumar/ Mr. Sasi Kumar Plot No. 92B & 93B,Sec-V, IMTManesar -GURGAON-HARYANA INDIA Phone- 0124-4366000 TO 9 FAX : 0124-2290884 Pincode : 122002 Email : bharat@blissanand .com
75	LEVEL SWITCH-CONDUTIVITY TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com	Works-1->Mr. BHAGWAN SINGH/ Mr. NANDAN SINGH F-61, OKHLA INDL.AREA,PHASE-I -NEW DELHI-DELHI INDIA Phone- 011-47627200 Extn. 3 FAX : 011- 26819440 Pincode : 110 020 Email : production@vautomat.com
76	LEVEL SWITCH-CONDUTIVITY TYPE	HI-TECH SYSTEMS & SERVICES LTD.	Mr. Vikash Agrawal/Mr. Tarun Debnath 119, PARK STREET , KOLKATA Phone- 033-22290045 Pincode : 700016 Email : sandeen@hitech.in	Works-1->Mr. Jitendra Kumar/Mr. Debasis Dey 82/1, Sarsuna Main Road, -KOLKATA-WEST BENGAL INDIA Phone- 9883994030 FAX : Pincode : 700061 Email : jitendra@hitech.in
77	LEVEL SWITCH-CONDUTIVITY TYPE	RAMAN INSTRUMENTS PVT.LTD.	Mr. N R Shenoy/Mr G B Viji 8, First Floor.Plot : 160A Bait-Ush-Sharaf, 29th Road,Bandra(W) MUMBAI Phone-09892331381 Pincode : 400050 Email : ramanbpl@vsnl.com	Works-1->NA -- Phone- FAX : Pincode : Email :

963437/2022/PS-PEM-MAX

78	LEVEL SWITCH- CONDUCTIVITY TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in	Works-1->R Gopinath 27 Nahur Udyog Industrial Premises,M.M.Malviya Road, Mulund(- MUMBAI-MAHARASHTRA INDIA Phone- +912225918567 FAX : +912225918566 Pincode : 400080 Email : sales@sigmainstruments.co.in
79	LEVEL SWITCH- CONDUCTIVITY TYPE	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com	Works-1->LARRY DEGARMO/ ROY STUMBOUGH 14685 W. 105TH STREET, LENEXA -KANSAS- USA Phone- 913-888-0767 FAX : 913-888-0767 Pincode : 66215 Email : rstumbough@sorinc.com
80	LEVEL SWITCH-FLOAT TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com	
81	LEVEL SWITCH-FLOAT TYPE	D.K. INSTRUMENTS PVT.LTD.	N.SIKDAR/ SUMIT SIKDAR 76/2,SELIMPUR RD DHAKURIA Kolkata Phone- 033-2415-1310. Pincode : 700031 Email : dkinst@vsnl.net	
82	LEVEL SWITCH-FLOAT TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com	Works-1->Mr. BHAGWAN SINGH/ Mr. NANDAN SINGH F-61, OKHLA INDL.AREA,PHASE-I -NEW DELHI-DELHI INDIA Phone- 011-47627200 Extn. 3 FAX : 011- 26819440 Pincode : 110 020 Email : production@vautomat.com
83	LEVEL SWITCH-FLOAT TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com	Works-1->Scientific Center, Others By-Pass Junction,Near Kalsekar College kausa, mumbra,Thane -Mumbai-MAHARASHTRA INDIA Phone- 022-25491409,9892230623 FAX : Pincode : 400612 Email : sdbpl@vsnl.com
84	LEVEL SWITCH-FLOAT TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : h_jana@levcongroup.com	
85	LEVEL SWITCH-FLOAT TYPE	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com	
86	LEVEL SWITCH-FLOAT TYPE	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in	Works-1->MR. MOHAN PADWAL 691/A/2,BIBWEWADI INDL ESTATE -PUNE- MAHARASHTRA INDIA Phone- 918600042374 FAX : 912024215670 Pincode : 411037 Email : wm@sbem.co.in
87	LEVEL SWITCH-FLOAT TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com	Works-1->Mr. Shyam Warilani/Mr. V Suresh Babu Plot No 34 A GIDC A Phase 1, -VAPI- GUJARAT INDIA Phone- +91 11 4161 7111 FAX : 022 2687 3613 Pincode : 396 195 Email : pbajaj@baumer.com
88	LEVEL SWITCH-FLOAT TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in	Works-1->R Gopinath 27 Nahur Udyog Industrial Premises,M.M.Malviya Road, Mulund(- MUMBAI-MAHARASHTRA INDIA Phone- +912225918567 FAX : +912225918566 Pincode : 400080 Email : sales@sigmainstruments.co.in
89	LEVEL SWITCH-FLOAT TYPE	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com	Works-1->LARRY DEGARMO/ ROY STUMBOUGH 14685 W. 105TH STREET, LENEXA -KANSAS- USA Phone- 913-888-0767 FAX : 913-888-0767 Pincode : 66215 Email : rstumbough@sorinc.com
90	INSTRUMENTS PIPE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com	Works-1->ALEX BAPTIST/ K. SRINIVAS 7. SIDHAPURA INDUSTRIAL ESTATE,SV ROAD, GOREGAON(WEST) -MUMBAI-MAHARASHTRA INDIA Phone- 022-42631700 FAX : 022- 40035259 Pincode : 400 062 Email : srinivas@precision-engg.com

963437/2022/PS-PEM-MAX

91	INSTRUMENTS PIPE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com	
92	INSTRUMENTS PIPE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com	Works-1->S.R.SINGH/ NAVEEN SINGH B - 2, SECTOR - 6, -NOIDA-UTTAR PRADESH INDIA Phone- 0120-4352940 FAX : 0120-4352940 Pincode : 201301 Email : naveensingh@vsnl.com
93	INSTRUMENTS PIPE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Mochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone-(022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com	Works-1->Mr. Tansen Choudhari/Mr. Mahesh Darekar Shed No.8, Lonavla Indl.Co-op.Estate Ltd,Nagargaon, -Lonavla-MAHARASHTRA INDIA Phone- 9823951347 FAX : (02114) 271132 Pincode : 410 401 Email : factory@hyd-air.com
94	INSTRUMENT FITTINGS	HP VALVES & FITTINGS INDIA PVT. LTD.	S. Harichandran/P.S. Pandi B-11, Mugappair Industrial Estate, CHENNAI Phone- 044 26252537 Pincode : 600037 Email : sales@hnvalvesindia.com	Works-1->S. Harichandran/ P.S. Pandi B-11, Mugappair Industrial Estate, -CHENNAI-TAMIL NADU INDIA Phone- 044-25252537 FAX : 044-26252538 Pincode : 600037 Email : sales@hnvalvesindia.com
95	INSTRUMENT FITTINGS	Perfect Instrumentation Control (India) Pvt. Ltd.	MD Hussain Shaikh/Shahanawaz Khan Gala No. 168, Loheki Chwal,216/ 218, Maulana Azad Rd. Nagpada Junction Mumbai Phone- 91-9324383121 Pincode : 400008 Email : shahanawaz.khan@perfectinstrumentation.com	Works-1->Shahanawaz Khan Vishweshwar Ind. Premises Co-op Soc. Ltd,F-18/19, Pradhikaran,Bhosadi MIDC -PUNE-MAHARASHTRA INDIA Phone- 020-30694134 FAX : 022-23013010 Pincode : 411026 Email : shahanawaz.khan@perfectinstrumentation.com
96	INSTRUMENT FITTINGS	Comfit & Valve Pvt. Ltd.	Mr. Jeetu Jain/Mr. Vinay Sosa Survey No. 23/1, Part 2, Ahmedabad-Mehsana Highway Laxmipura, Nandasan Phone- 02764-267036/37 Pincode : 382705 Email : marketing@com-fit.com	Works-1->Miss Sonal Pithadia/Miss Pavan Chavda Survey No. 23/1, Part 2, Ahmedabad-Mehsana Highway, Laxmipura -Nandasan-GUJARAT INDIA Phone- 8460848087 FAX : 2764-267036/37 Pincode : 382705 Email : domestic@com-fit.com
97	INSTRUMENT FITTINGS	Arya Crafts & Engineering Pvt. Ltd.	Mr.Sanjay Brahman/Mr.Shyam Vazirani 102, Vora Industrial Estate No.4 Navghar, Vasai Road (E) Dist.Thane, Mumbai Phone- +91-250-2392246 Pincode : 401210 Email : arya@aryaengg.com	
98	INSTRUMENT FITTINGS	FLUIDFIT ENGINEERS PVT. LTD.	Mr. Abbas Bhola Potia Building No. 2, Office No. 3,292, Bellasis Road,Mumbai Central (East) Mumbai Phone- 9920044113 Pincode : 400008 Email : ab@fluidfitengg.com	Works-1->Mr. Abbas Bhola Unit No. 16, Supreme Industrial Estate,Kaman Bhiwandi Road,Devdal, -Vasai East-MAHARASHTRA India Phone- 9920044113 FAX : 07303178243 Pincode : 401208 Email : ab@fluidfitengg.com
99	INSTRUMENT FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com	Works-1->S.R.SINGH/ NAVEEN SINGH B - 2, SECTOR - 6, -NOIDA-UTTAR PRADESH INDIA Phone- 0120-4352940 FAX : 0120-4352940 Pincode : 201301 Email : naveensingh@vsnl.com
100	INSTRUMENT FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Mochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone-(022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com	Works-1->Mr. Tansen Choudhari/Mr. Mahesh Darekar Shed No.8, Lonavla Indl.Co-op.Estate Ltd,Nagargaon, -Lonavla-MAHARASHTRA INDIA Phone- 9823951347 FAX : (02114) 271132 Pincode : 410 401 Email : factory@hyd-air.com
101	INSTRUMENT FITTINGS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com	Works-1->Mr. Santosh Shukla Others R-628,TTC Industrial Area, MIDC Rabale, -Navi Mumbai-MAHARASHTRA India Phone- 9821350761, FAX : 022-27695559, Pincode : 400701, Email : sales@panamengineers.com
102	INSTRUMENT FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com	
103	INSTRUMENT FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com	Works-1->ALEX BAPTIST/ K. SRINIVAS 7. SIDHAPURA INDUSTRIAL ESTATE,SV ROAD, GOREGAON(WEST) -MUMBAI-MAHARASHTRA INDIA Phone- 022-42631700 FAX : 022-40035259 Pincode : 400 062 Email : srinivas@precision-engg.com



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

Sub Section : D

REV. 00

ANNEXURES

SECTION: I

SUB SECTION: D

ANNEXURES



**3X200+3X500+1x500 MW NTPC KORBA TPP-
FGDLIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
SUB-VENDOR LIST**

SPECIFICATION NO. PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00 Annexure-I

SHEET 1 OF 1

ANNEXURE-I

SUB-VENDOR LIST

1. REFER ELECTRICAL AND C&I SPECIFICATION FOR APPLICABLE SUB-VENDOR LIST FOR THE RELEVANT ELECTRICAL AND C&I ITEMS.
2. THE LIST OF ALL BOUGHT OUT ITEMS WITH MAKES AND PLACE OF ORIGIN AND CONTACT DETAILS OF THE MANUFACTURERS TO BE MENTIONED ALONG WITH OFFER TO BE SUBMITTED IN THE FORMAT ATTACHED IN SECTION III AS AN INFORMATION TO BHEL.
3. ACCEPTANCE OF MAKES SHALL BE SUBJECT TO BHEL/ END CUSTOMER ACCEPTANCE DURING THE DETAILED ENGINEERING WITHOUT COST AND DELIVERY IMPLICATION TO BHEL.



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD

LIME FEEDING / DOSING SYSTEM

 TECHNICAL SPECIFICATION
 MANDATORY SPARES LIST

SPECIFICATION NO. PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00 ANNEXURE-II

SHEET 1 OF 4

ANNEXURE-II

MANDATORY SPARES LIST

Sl. No.	DESCRIPTION	Qty.
I.	MECHANICAL	
A	Agitators (For Neutralisation tank)	
1.	Impeller Assembly	1 no. of each type
2.	Bearing Assembly	1 no. of each type
3.	Motor	1 no. of each type
4.	Belt and Pulley (If applicable)	1 no. of each type
5.	Gear Box Assembly (If Applicable)	1 no. of each type
6.	Agitators shaft assembly	1 no. of each type and size
7.	Complete Agitator Assembly	1 no. of each type and size
B	Slurry Pumps	
1.	Impeller Assembly	4 no. of each type and size
2.	Casing Liners (where replaceable liners are provided)	1 Set
3.	Seals	4 set of each type and size
4.	Bearings	1 no. of each type and size
5.	Motor	1 no. of each type and size
6.	GEAR BOX	1 No. for each type and size of pump
7.	Motor-Pump Coupling	1 no. of each type
C	For Integral Piping As Defined In Specification	
1.	Slurry Valves	4 no. of each type & size
2.	Slurry Line Bends	4 no. of each type & size

II.	CONTROL & INSTRUMENTATION	
i	MEASURING INSTRUMENTS	
a	(i) Transmitters of all types and model no. (for measurement of pressure, differential pressure, flow, level, etc.). This shall include magnetic/ electromagnetic flow meter, mass flow meter also.	10% or 1 no. of each type and model, whichever is more.
b	(i) Process Actuated Switches (Pressure, Differential pressure, flow, level, temp) (ii) Limit switches (for pneumatic and manual valves)	10% or 2 no. of each type and model, whichever is more. 10% or 2 no. of each type and model, whichever is more.
c	Local Gauges for Pressure, Differential pressure, flow, level, temp	5% or 1 no. of each type, model and range, whichever is more.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD		SPECIFICATION NO. PE-TS-466-571-A102	
	LIME FEEDING / DOSING SYSTEM		SECTION : I	
	TECHNICAL SPECIFICATION		SUB-SECTION : D	
	MANDATORY SPARES LIST		REV 00	ANNEXURE-II
			SHEET 2 OF 4	

ii.	OTHER RELATED CONTROL AND INSTRUMENTATION SYSTEMS / EQUIPMENTS	
a.	Set of gaskets/O-rings/ seals	200% of each type, model, rating and size
b.	Filters, light source, sensor, detector, etc.	100% of each type, model and rating
c.	Complete Probe with shield assembly (Not applicable for In situ-path)	1 no. of each type and model
d.	Electronic card assembly/ PCBs, moisture/condensate monitor, power supply modules	10% of each type, model and rating
iii.	PROCESS CONNECTION PIPING (For Impulse Piping /Tubing and Air Supply Piping as Applicable)	
a.	Valves of all types and models	10% or 1 no. of each type, class, size and model whichever is more.
b.	2 way, 3way, 5way valve manifolds	10% or 1 no. of each type, class, size and model whichever is more.
c.	Fittings	10% or 1 packet of each type, class, size and model whichever is more.
d.	Purge meters	5% of each model or 1 no. whichever is more.
e.	Filter regulators	20% of each model or 2 nos. whichever is more.
iv	CONTROL VALVES, ACTUATORS & ACCESSORIES (Following items shall be provided under this clause for all modulating control valves being supplied under this package)	
a.	Pneumatic and electro-hydraulic actuator assembly	10% or 1 no. of each type, model and rating, whichever is more.
b.	Valve trim (including cage, plug, stem, seat rings, guide bushings etc.)	1 set for each type of control valve.
c.	Diaphragms, O’ rings, seals etc. of all types make etc.	100 %
d.	Pressure Gauges of all types, make, rating etc.	10% or 2 nos. of each type whichever is more
e.	Solenoid valves (if applicable)	10% or 2 nos. of each type whichever is more
f.	Positioner units (complete unit) & accessories (link assembly)	10% or 1 no. of each type whichever is more
g.	Pneumatic air-filter/Regulator of each type, make rating etc.	10% or 2 Nos., whichever is more
h.	Air lock relays	10% or 2 nos. of each type whichever is more
v	PNEUMATICS ISOLATION / BLOCK VALVES, ACTUATORS & ACCESSORIES (For all ON/OFF valves supplied under this package)	
a.	Pneumatic actuator assembly	10% or 1 no. of each type, model and rating, whichever is more.
b.	Diaphragms, O’ rings, seals etc. of all types make etc.	100 %

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION MANDATORY SPARES LIST	SPECIFICATION NO. PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : D	
		REV 00	ANNEXURE-II
		SHEET 3 OF 4	

c.	Limit switches (complete unit) & accessories (link assembly)	10% or 2 Nos., whichever is more
d.	Pneumatic air-filter/Regulator of each type, make rating etc.	10% or 2 Nos., whichever is more
vi	ELECTRICAL ACTUATORS	
a.	Actuators	1 no of each type and rating
b.	Electronic PCB of all types	10% of each type & model
c.	Absolute Encoder (replaceable part)	5% of each type & model
d.	Electronic Torque sensor	5% of each type & model

Note (s):

- Wherever quantity has been specified as percentage (%), the quantity of mandatory spares to be provided by contractor shall be the specified percentage (%) of the total population of the plant. In case, the quantity so calculated happens to be fraction, the same shall be rounded off to next higher whole number.
- One set means 100% complete replacement of the particular component/equipment, as mentioned i.e., Set for the particular equipment, would include all components required to replace the item. For example, a set of bearing shall include all hardware normally required while replacing the bearings. It is further, intended that the assembly / sub-assembly which have different orientation (like left hand or right hand, top or bottom), different direction of rotation or mirror image positioning or any other reasons which result in maintaining two different sets of the spares to be used for the subject assembly / sub-assembly, these shall be considered as different types of assembly/sub-assembly.
- Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc. these shall cover all the items supplied and installed and the breakup for these shall be furnished in the bid. Any fraction of an item shall mean the next higher. Any change in size, material, design etc., which obviates one to one replacement of the part shall be considered a different type.
- In case spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered design with quantities generally in line with the approach followed in the above list.
- Any item which is quoted as "not applicable" in the above list and is found to be "applicable" at a later date shall be supplied by the Bidder without any commercial implications. The Bidder shall note that if there is any change/ variation in equipment/ system during detail engineering which causes any change/ variation in the essential spares quantity, the same shall be supplied without any commercial implications. The price indicated for the mandatory spares shall be considered for the purpose of evaluation.
- Mandatory spares shall not be dispatched before dispatch of corresponding main equipment. The spares shall be treated and packed for a long storage under the climatic condition prevailing at site.
- All spares supplied under this contract shall be strictly interchangeable with parts for which they are intended for replacements. These spares should include all mounted accessories like components, boards, add on items, fitting, connectors etc. and be complete in all respects so that the replacement of the main items by these spares does not require any additional item. The vendors must conform the

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION MANDATORY SPARES LIST	SPECIFICATION NO. PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : D	
		REV 00	ANNEXURE-II
		SHEET 4 OF 4	

pair to pair compatibility of each electrical spares modules with the modules should be supplied in the original package. All electronic modules should be pre-set and/or pre-programmed for ready use at site. Alternatively, suitable instruction sheet indicating the details of required PCB jumper position, BCD which is setting, EPROM/PROM listing etc should be packed along with each module. Also, a caution mark sign should be put on all such module which needs pre-setting/pre-programming before putting them in to service. The spare shall be treated and properly packed for long term storage.

8. Each spare shall be clearly marked and labelled on the outside of the packing with its description. When more than one spare part is packed in single case, a general description of the contents shall be shown on the outside of such case and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purpose of identification.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-466-571-A102	
SECTION : I	
SUB-SECTION : D	
REV 00	ANNEXURE- III
SHEET 1 OF 7	

**ANNEXURE- III
INSPECTION AND TESTING**

1.0 INSPECTION AND TESTS DURING MANUFACTURE

- 1.01. The method and techniques to be used by the Bidder for the control of quality during manufacture of all plant and equipment shall be agreed with the Owner.
- 1.02 The Owner's general requirements with respect to quality control and the required shop tests are set out elsewhere in this specification.
- 1.03 Before any item of plant or equipment leaves its place of manufacture, the Owner shall be given the option of witnessing inspections and tests for compliance with the specification and related standards.
- 1.04 Advance notice shall be given to the Owner as agreed in the Contract, prior to the stage of manufacture being reached, and the piece of plant must be held at this stage until the Owner has inspected the piece, or has advised in writing that inspection is waived. If having consulted the Owner and given reasonable notice in writing of the date on which the piece of plant will be available for inspection, the Owner does not attend, the Bidder may proceed with manufacturing having forwarded to the Owner duly certified copies of his own inspection and test results.
- The owner's representative shall have at all reasonable times access to bidder's or his sub-vendor's premises and shall have power to inspect/ examine materials and workmanship or equipment under manufacture.
- The Bidder shall forthwith forward to the engineer duly certified copies of the Test Certificates in six copies (one to the Purchaser and five to the Consulting Engineer) for approval. Further nine (9) copies of Shop Test Certificates shall be bound with Instruction Manuals referred to elsewhere in the specification.
- For electrical equipment, routine tests as per relevant IS/International standard as detailed in the specification are to be carried out on all equipment. Type tests are also to be carried out on selected equipment as detailed in the specifications of the electrical equipment concerned.
- 1.05 Under no circumstances, any repair or welding of castings be carried out without the consent of the Engineer. Proof of the effectiveness of each repair by radiographic and/or other non-destructive testing technique, shall be provided to the Engineer.
- 1.06 All the individual and assembled rotating parts shall be statically and dynamically balanced at the works. Where accurate alignment is necessary for component parts of machinery normally assembled on site, the Bidder shall allow for trial assembly prior to dispatch from place of manufacture.
- 1.07 All materials used for the manufacture of equipment covered under this specification shall be of tested quality. Relevant test certificates shall be made available to the Purchaser. The certificates shall include tests for mechanical properties and chemical analysis of representative material.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-466-571-A102	
SECTION : I	
SUB-SECTION : D	
REV 00	ANNEXURE- III
SHEET 2 OF 7	

- Equipment or parts coming under any statutory Regulations shall be certified by a Competent Authority under the regulations in the specified format.
- 1.08 All pressure parts connected to pumping main shall be subjected to hydraulic testing at a pressure of 150% of shut-off head for a period not less than one hour. Other parts shall be tested for one and half times the maximum operating pressure, for a period not less than one hour.
- 1.09 All necessary non-destructive examinations shall be performed to meet the applicable code requirements.
- 1.10 All welding procedures adopted for performing welding work shall be qualified in accordance with the requirements of Section-IX of ASME code or IBR as applicable. All welded joints for pressure parts shall be tested by liquid penetrant examination according to the method outlined in ASME Boiler and Pressure Vessel code. Radiography, magnetic particle examination magnaflux and ultrasonic testing shall be employed wherever necessary/ recommended by the applicable code. At least 10% of all major but welding joints shall be radiographed unless otherwise stipulated.

Statutory payments in respect of IBR approvals including inspection shall be made by the bidder. Bidder's scope shall include to preparation of all necessary documents, co-ordination and follow-up for above approval. Owner shall only forward assistance/endorsement of documents /design /drawings /reports/records to be submitted for approval as stipulated/ required by Statutory Authorities till registration of the unit and clearance for commercial operation.

2.0	PERFORMANCE TESTS AT SITE

- 02.01 The full requirements for testing the system shall be agreed between the Owner and the Bidder prior to Award of Contract. The completely erected System shall be tested by the Bidder on site under normal operating conditions. The Bidder shall also ensure the correct performance of the System under abnormal conditions, i.e. the correct working of the various emergency and safety devices, interlocks, etc.
- 02.02 The Bidder shall provide complete details of his normal procedures for testing, for the quality of erection and for the performance of the erected plant. These tests shall include site pressure test on all erected pipe work to demonstrate the quality of the piping and the adequacy of joints made at site.
- 02.03 The Bidder shall furnish the quality procedures to be adopted for assuring quality from the receipt of material at site, during storage, erection, pre-commissioning to tests on completion and commissioning of the complete system/equipment.

All Statutory testing / clearance is in Bidder's scope including payment of all fees, etc. as required.

A)	Minimum Test requirements
	• Dimensional checks • Material test certificates • No load trial run of the equipment to be done at vendor works. • Performance test.
B)	General Inspection requirements to be considered are as below:

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION INSPECTION AND TESTING		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : D	
			REV 00	ANNEXURE- III
			SHEET 3 OF 7	

1.	Bidder shall furnish written copies of shop production, fabrication and quality test procedures and drawings to be used for review by NTPC prior to manufacture. Inspection of above-mentioned tests by BHEL representative at bidder's works is envisaged.
2.	Items of Lime Feeding/Dosing system will be inspected at the Bidder's works before dispatch or where the test facilities are available.
3.	Acceptance tolerance shall be as per applicable standard.
4.	Items for Lime Feeding/Dosing system shall not be released for shipment, until tests/inspection have been approved by BHEL/NTPC.
5.	BHEL shall witness the test at Bidder's works and a notice of minimum three (3) weeks shall be given for attending the inspection.
6.	Bidder to arrange all calibrated gauges, Instruments during inspection.

3.0	SPECIFIC INSPECTION REQUIREMENT FOR COMPONENTS/EQUIPMENTS
1.	Bucket Elevator / Screw Conveyor
a.	Dimensional checks
b.	Material test certificates
c.	No load trial run of the equipment to be done at vendor works.
d.	Performance test.
2.	Pumps :
e.	All pressure parts shall be hydraulically tested at 150% of the shut-off head or 200% of rated head, whichever is higher for 30 minutes. No leakage is allowed.
f.	Impeller and rotor shall be first statically balanced and then dynamically balanced according to ISO 1940 (in the case of impellers this shall be done before and after mounting of the service rotor shaft).
g.	Vibration levels measured on the non-rotating parts shall not exceed the zone limit "B" as defined in ISO 10816 at steady conditions and shall not exceed the zone limit "C" as defined in ISO 10816 at transient conditions.
h.	List of Non-Destructive test over and above the material test are as follows: Casing: Material test, Magnetic particle (MPI), DP and Hydro test, as applicable Impeller- DPT and MPI as applicable Shaft- Ultrasonic (UT), DPT and MPI Sleeve- DP and Hardness test/ Manufacturer's recommendation Mechanical Seal- Manufacturer's recommendation. Base Plate- Stress relieving of weld. Replaceable Rubber liner- Shore Hardness, Class and Type certificate
i.	Vibration test and Noise level test shall be witnessed at shop. (as already stated above.)



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-466-571-A102
SECTION : I
SUB-SECTION : D
REV 00 ANNEXURE- III
SHEET 4 OF 7

j. Mechanical running and the performance test shall be conducted for Pump at the Bidder's works before dispatch or where the test facilities are available. All pumps to be performance tested as per Hydraulic Institute Standard/Indian Standard. Performance test to include check for noise, vibration level and temperature rise.

k. The Bidder shall conduct performance test for the remaining pump and submit the reports.

4. General Inspection Requirements to be considered are as below:

Sl.No.	Item	Inspection & Test Item	Remarks
1.	Pumps	Material certificate check	Shaft & impeller only
		Dimensional inspection	
		Non-destructive testing	DPT on shaft & impeller
		Hydrostatic test	
		Balancing Test	Static & dynamic
		Performance test	Incl. Noise & Vibration
2.	Motors	Material certificate check	
		Non-Destructive Testing	
		Dimensional inspection	
		Balancing Test	Static & dynamic
		Function test	
3.	Vent Fan	Material certificate check	
		Dimensional inspection	
		Performance Test	
4.	Conveyor & Silo Extraction Device	Material certificate check	
		Dimensional inspection	
		Function Test	Short time no load test
5.	Rubber lining Pipe	Dimensional inspection	
		Visual Inspection	
		Spark Test	
6.	Flow Nozzles	Material certificate check	
		Dimensional Inspection	
7.	Control Panel	Insulation Resistance Test	
		Dielectric Strength Test	
		Function Test	
		Dimensional Inspection	



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00 ANNEXURE- III

SHEET 5 OF 7

	8.	Control valves	Material certificate check	
			Hydrostatic test	
			Seat leak test	
			Function test	
			Dimensional Inspection	
	9.	RTD	Material certificate check	
			Performance test	
			Hydrostatic test	
	10.	Shut off valve	Material certificate check	
			Hydrostatic test	
			Seat Leak test	
			Function Test	
			Dimensional Inspection	
	11.	Flow meter	Material certificate check	
			Calibration Test	
			Dimensional Inspection	
			Hydrostatic test	
	12.	Butterfly Valve	Material Certificate check	
			Non-destructive testing	
			Hydrostatic test	
Operation test			Motorized valve only	
4.	Valves and Specialties shall be tested as per relevant standards / codes. Seat Leakage and hydraulic test to be carried out as per relevant standards /codes.			
5.	Pipes and fittings shall be tested as per relevant standards/ codes			
6.	MQP (Manufacturing Quality Plan) shall be submitted by the bidder along with the technical offer. Above mentioned item-wise inspection requirement is tentative only and shall be mutually discussed and finalized during detail engineering.			
7.	Bidder shall furnish written copies of shop production, fabrication and quality test procedures and drawings to be used for review by BHEL / BHEL's Customer prior to manufacture. Inspection of above-mentioned tests by BHEL/ BHEL's Customer representative at bidder's works is envisaged			
8.	The Bidder shall furnish performance test procedure along with standard. The test procedure will be reviewed and approved by the BHEL / BHEL's Customer.			

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION INSPECTION AND TESTING	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : D	
		REV 00	ANNEXURE- III
		SHEET 6 OF 7	

9.	A dynamic balancing certificates stating that the rotating assembly has been balanced dynamically shall be sent to BHEL/ BHEL's Customer within one (1) week of the successful completion of balancing.
10.	Vibration levels shall be measured during shop running/performance tests.
11.	For surfaces with rubber lining, Welding shall be visually inspected to verify the absence of rough area and unacceptable transition between surfaces which prevent the adequate adherence of rubber. The acceptance criteria shall be as per latest standard.
12.	For surfaces with rubber lining, degree of cleaning shall be visually checked before the application of the coating. There must be no area with oxidation, dirt or partially or generalized corrosion defects.
13.	Test certificates shall be issued for each lot of raw material used in the coating, corresponding to specific weight and traction resistance.
14.	For surfaces with rubber lining, adherence test shall be conducted on production samples. Adherence test shall be conducted on the actual surface through hammering. In order to verify the absence of air pockets (or) surface without adherence.
15.	For surfaces with rubber lining, Coating thickness shall be checked at 100%. A High voltage porosity test will be conducted on 100 % of the coated surface.
16.	Equipment shall not be released for shipment, until shop tests data and performance tests curves have been approved by Owner.
17.	Bidder should furnish performance guarantee as per applicable standard guarantee for the design, manufacture, material and safe operation of the equipment's.
18.	BHEL/BHEL's Customer of their authorized third-party inspection agency representative shall witness the test at Bidder's works and a notice of minimum three (3) weeks shall be given for attending the inspection.
19.	Bidder to arrange all calibrated gauges, Instruments during inspection at works and also during performance test at site. All inspection, measuring and test equipment(s) used by Bidder shall be calibrated (<i>at accredited laboratory, as applicable</i>) periodically depending on its use and criticality of the test/measurement to be done. The Bidder shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by the Owner. Wherever asked specifically, the Bidder shall re-calibrate the measuring/test equipment in the presence of Project Manager/Inspector.
20.	Mechanical running test shall be carried out for Bucket Elevator & Lime Slurry Pump. Bidder to arrange Motor for the shop test and inspection.
21.	Bidder/supplier to note that no order is to be placed on any foreign vendor (i.e. supplies from outside India), and all supplies for lime dosing/feeding system shall be indigenous (so as to aid in promotion of Make in India initiative). For all supplies related to the Lime Feeding/Dosing System, vendor will tie-up with BHEL approved inspection agency on their own cost and carry out inspection as per the Quality Plan approved by BHEL/ BHEL's Customer. Vendor shall furnish BHEL the inspection reports and other documents required as per approved Quality plan duly signed by the Inspection Agency after their witness for our review and acceptance.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-466-571-A102	
SECTION : I	
SUB-SECTION : D	
REV 00	ANNEXURE- III
SHEET 7 OF 7	

QAP FORMAT

[illegible]

The Quality Plan shall be finalized during the detailed engineering.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
INPUT DRAWING LIST**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D




REV 00 ANNEXURE-IV

SHEET 1 OF 1


ANNEXURE-IV

INPUT DRAWINGS BY BHEL

Sl.No.	Drawing Title	NTPC/BHEL Drawing No.
1.	General Arrangement of Gypsum Dewatering System	2100-109-PVM-B-269 (2-Sheets)
2.	P&ID - Legends & Notes	B240-00001 & B240-00002 (2-Sheets)
3.	P&ID-Waste Water System (Covering Lime Feeding /Dosing system) (2-Sheets)	2100-109-PVM-F-046 (2-Sheets)

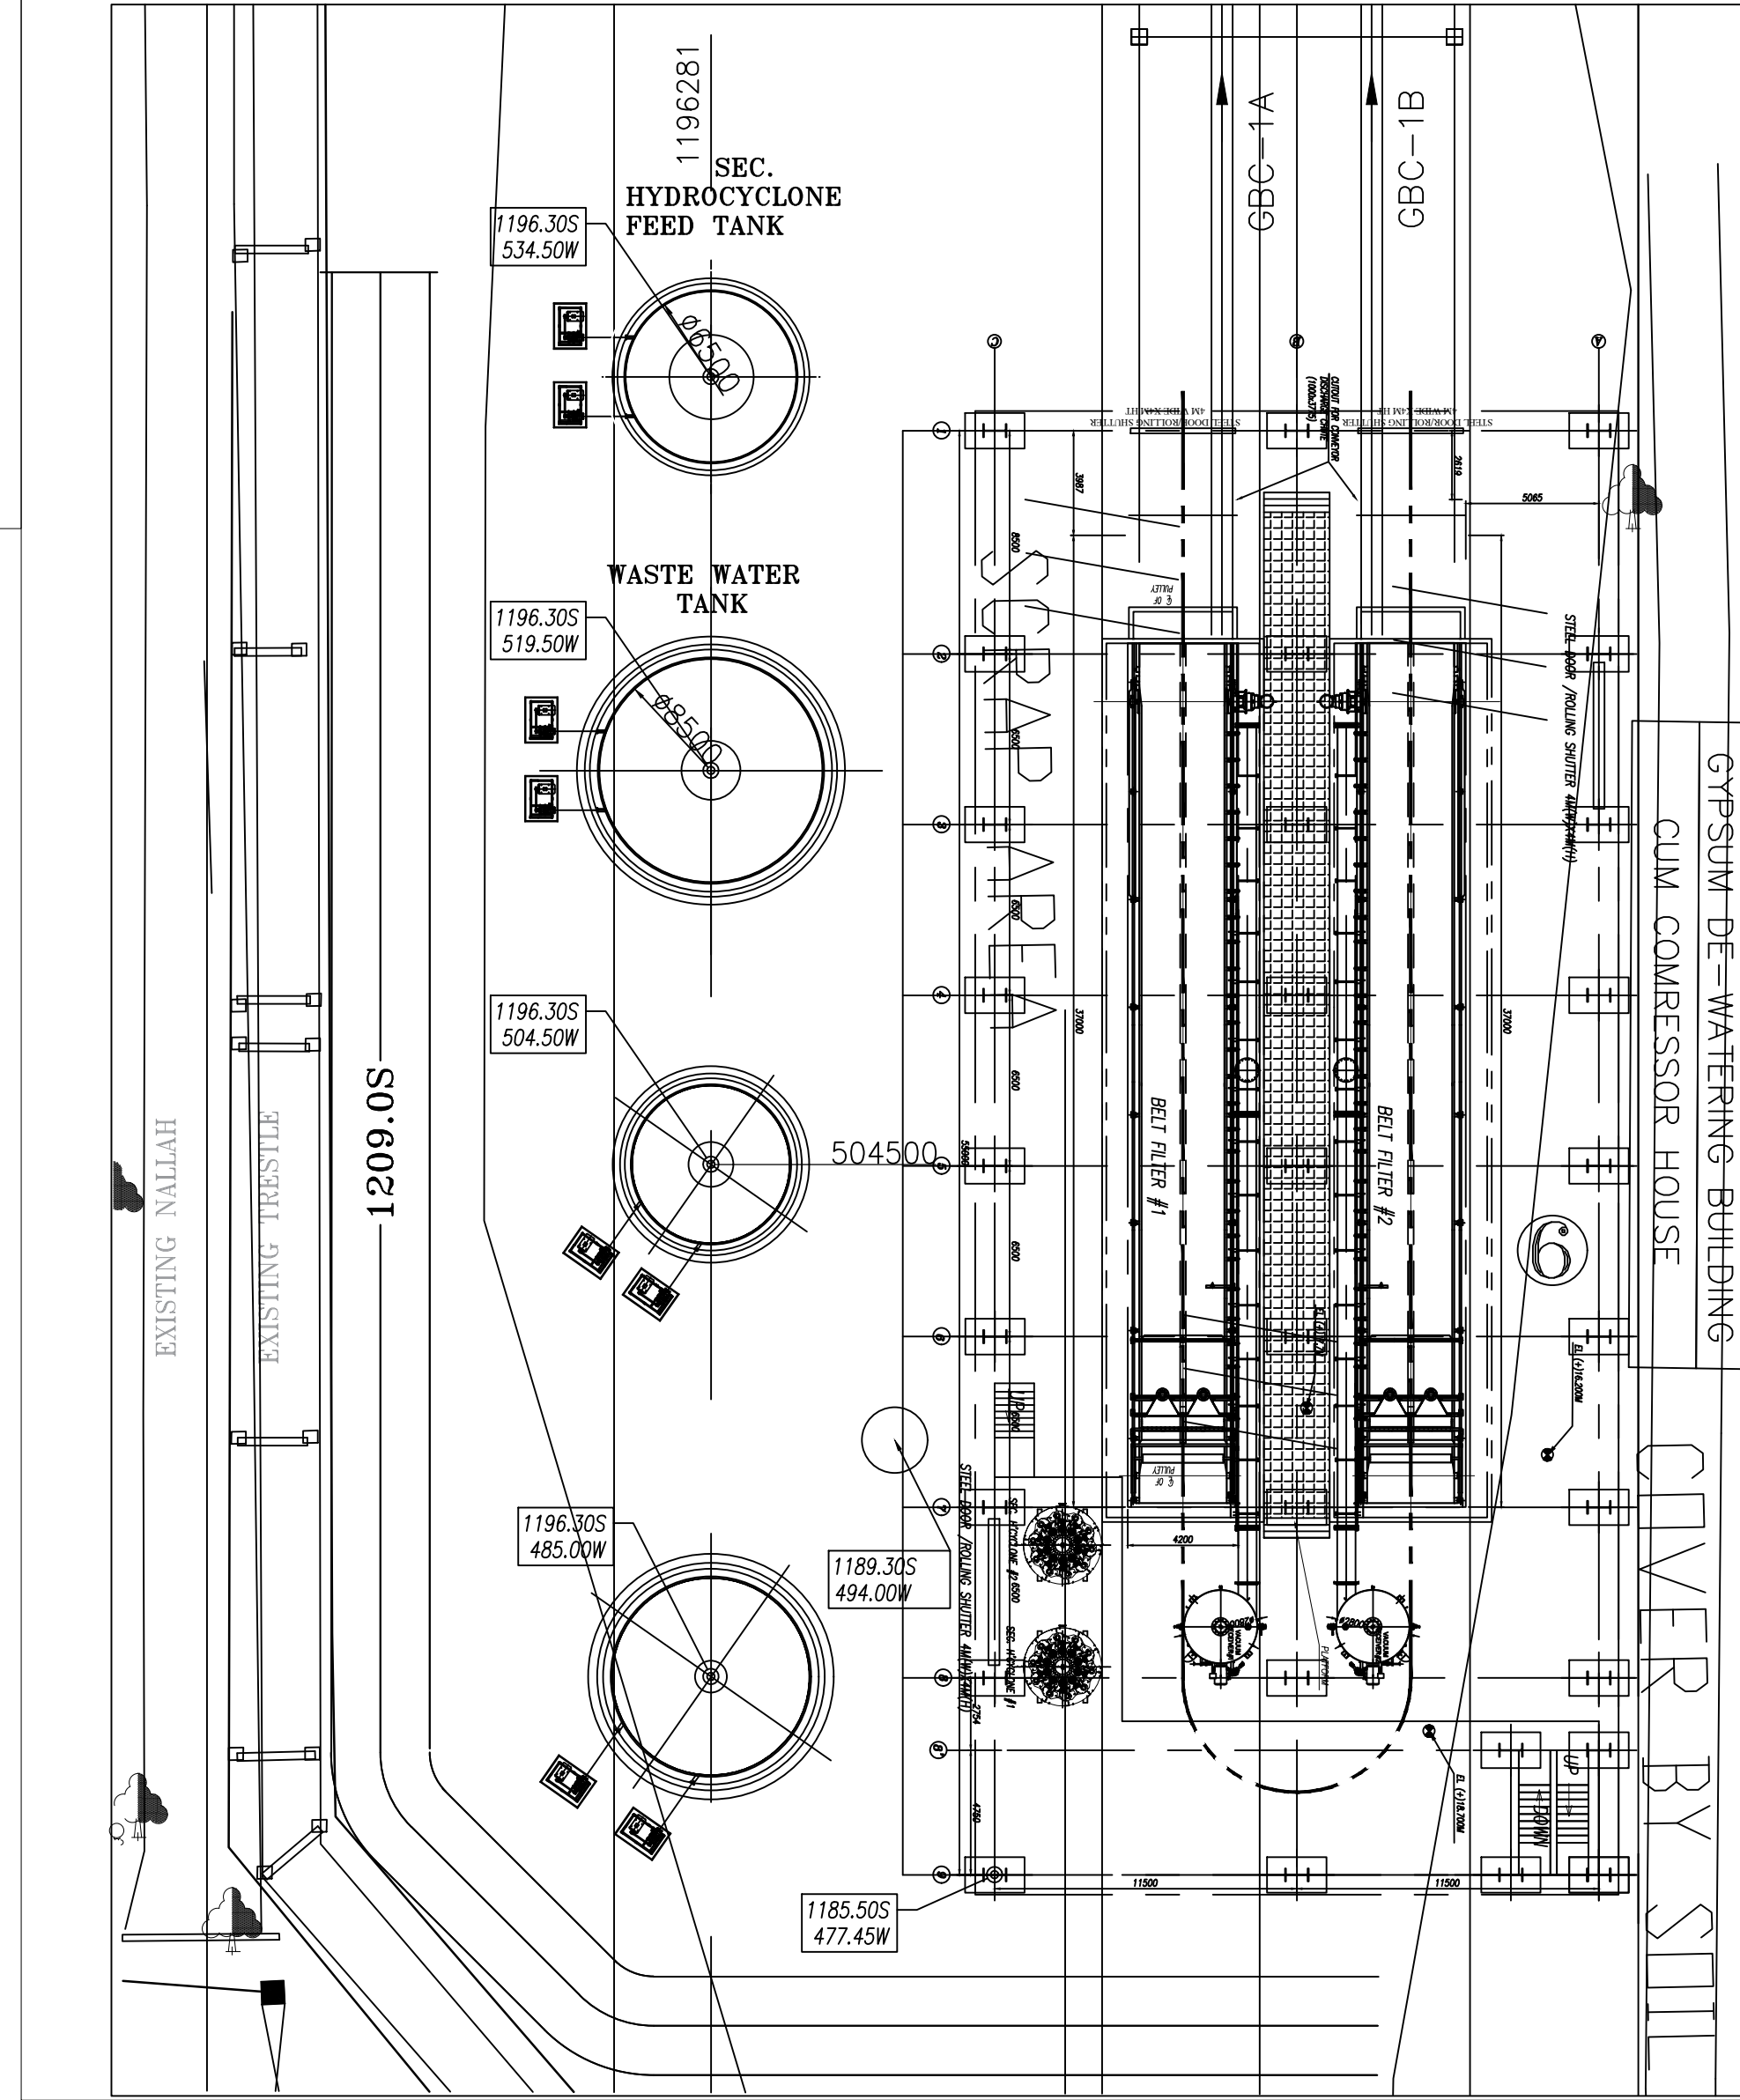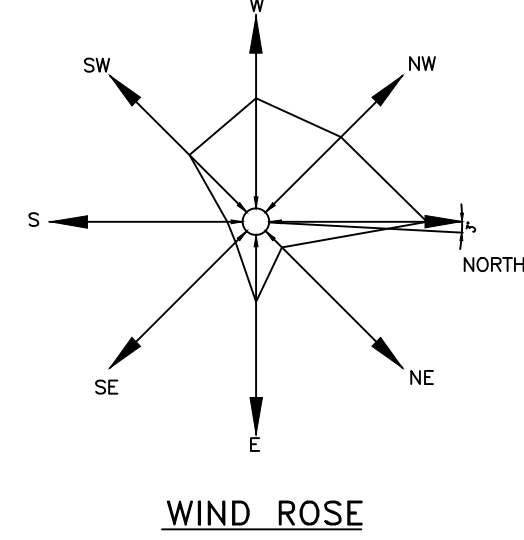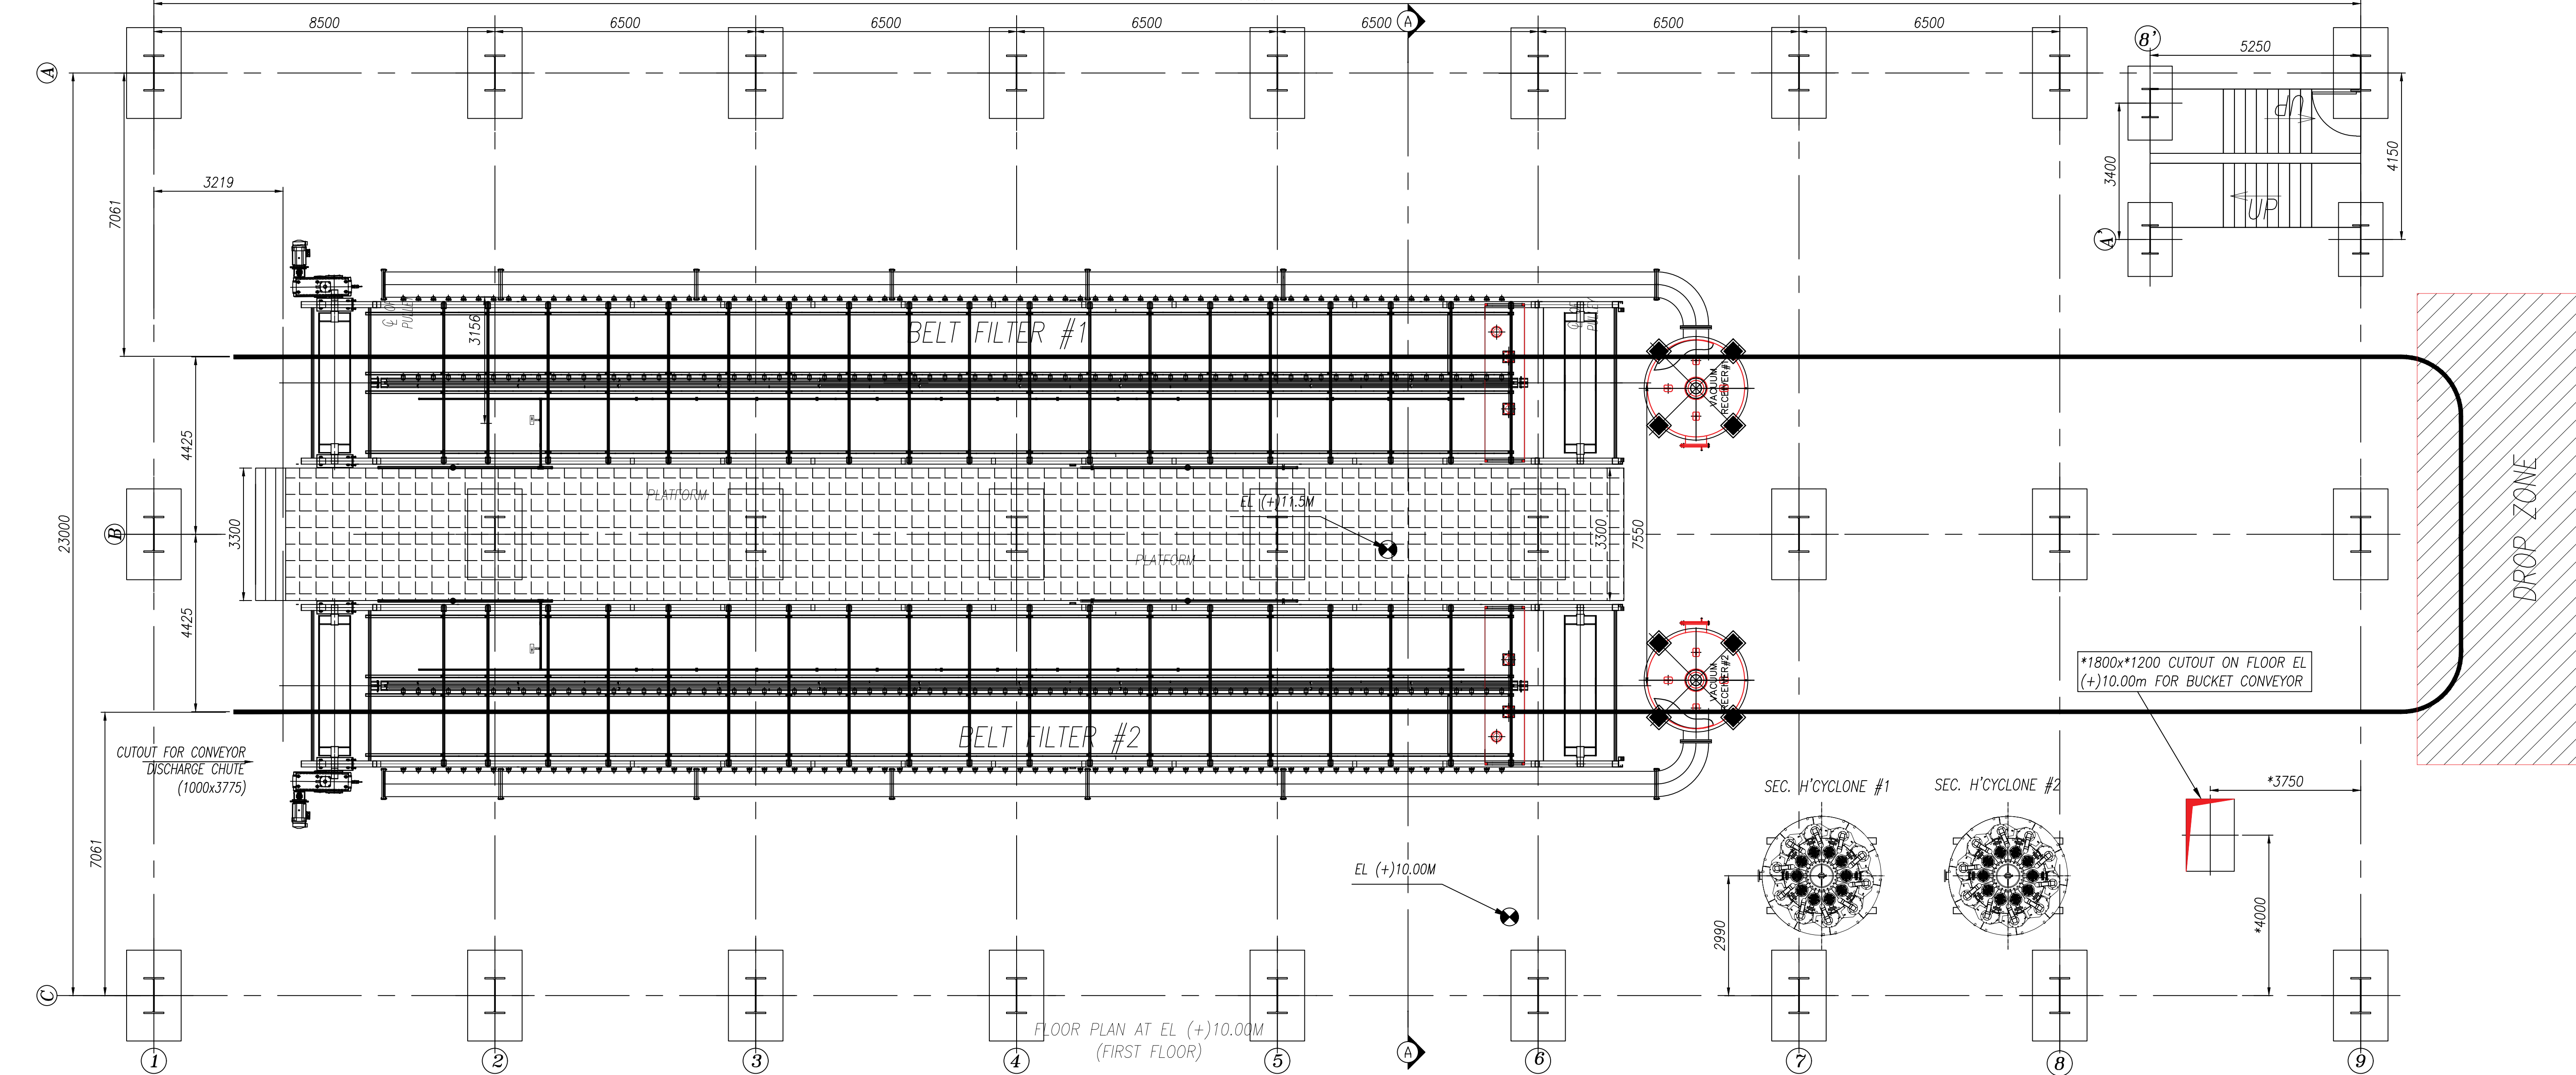

KEY PLAN

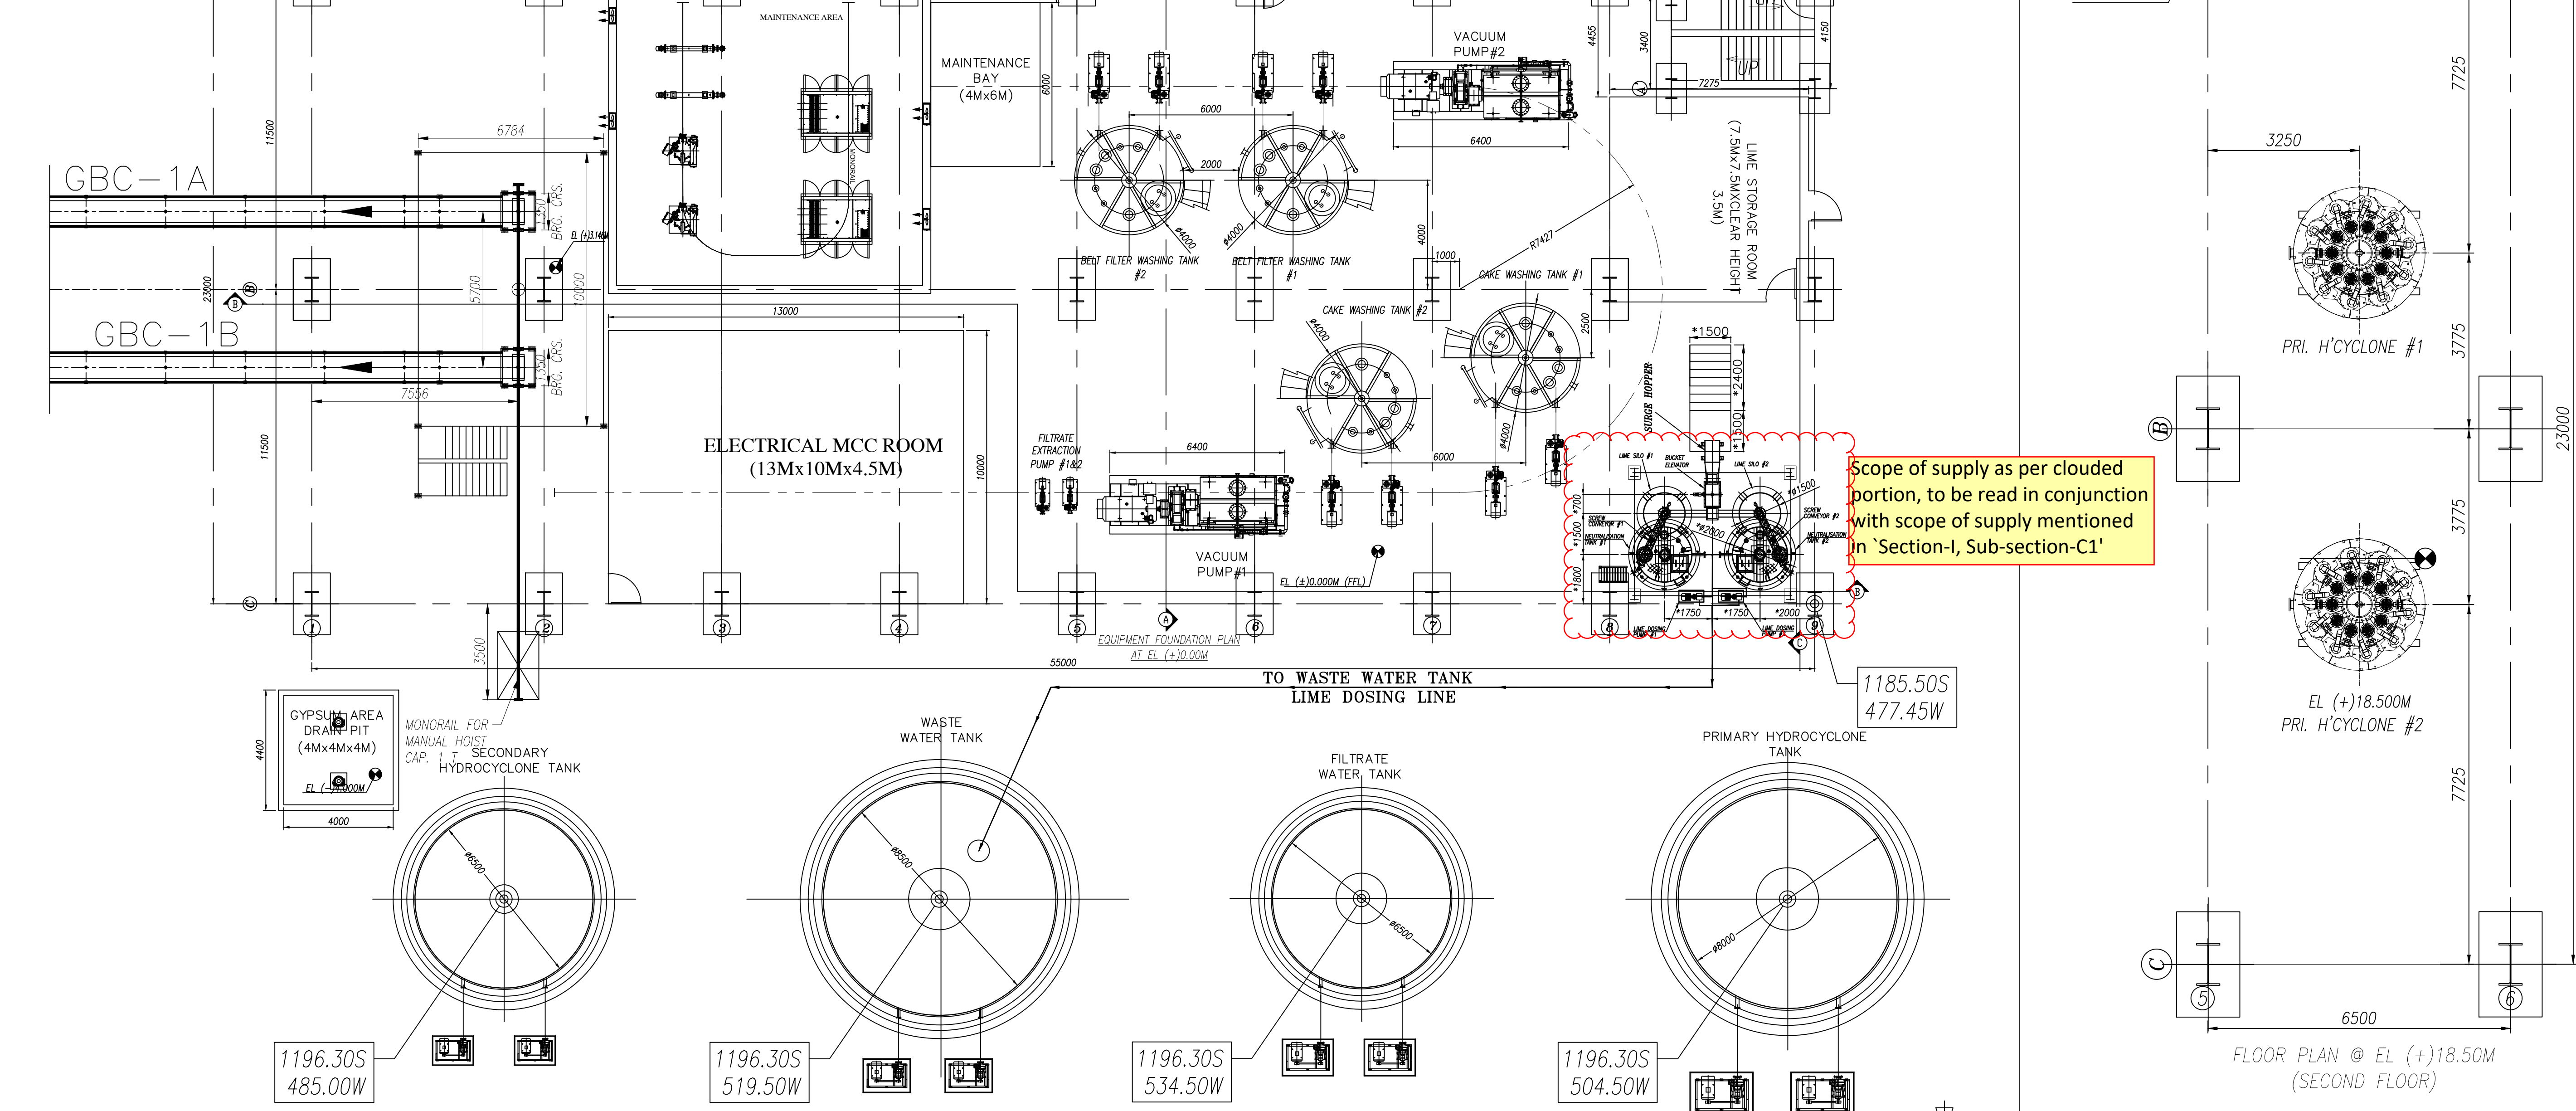


*** MARKED DIMENSIONS OF LIME FEEDING/DOSING SYSTEM SHOWN IN THE DRAWING ARE FOR GUIDANCE PURPOSE ONLY AND SHALL BE FINALISED DURING DETAIL ENGG. BY VENDOR.

LEGEND:-


FGL	- FINISHED GROUND LEVEL
FFL	- FINISHED FLOOR LEVEL
T.O.P.F	- TOP OF PLATFORM
TOP	- TOP OF CONCRETE
OPENG	- OPENING
MR	- MONORAIL
THK	- THICK
TYP	- TYPICAL
GDWB	- GYPSUM DEWATERING
BUILDING	- BUILDING
VBF	- VACUUM BELT FILTER

- NOTES:
- ALL DIMENSIONS ARE IN MILLIMETRES AND ELEVATIONS IN METRES.
 - EL (+)10.00M OF MAIN PLANT AREA CORRESPONDS TO RL (+)289.5
 - THE EQUIPMENT MACHINERY SIZES SHOWING IN THE DRAWING IS INDICATIVE ONLY AND WILL BE CONFIRMED AFTER VENDOR DATA. THE MAXIMUM ANTICIPATED SIZE AND LOADING IS PROVIDED IN THE DRAWING.
 - FLOOR OPENINGS, PIPE CROSSINGS SHALL BE CONFIRMED DURING DETAIL ENGINEERING.
 - FLOOR ELEVATION TO BE CONSIDERED AS PRELIMINARY. FINAL LEVEL WILL BE FIXED AFTER EQUIPMENT FINALIZATION.
 - DETAILS OF STAIRCASE, SUITABLE DOORS, WINDOWS, VENTILATORS SHALL BE CONSIDERED BY CIVIL DESIGNER FOR GYPSUM DEWATERING BUILDING.
 - *** MARKED DIMENSIONS OF LIME DOSING/FEEDING SYSTEM SHOWN IN THE DRAWING ARE FOR GUIDANCE PURPOSE ONLY AND SHALL BE FINALISED DURING DETAIL ENGG. BY VENDOR


NTPC DRG NO: 2100-109-PVM-B-269			
CUSTOMER: NTPC LIMITED.			
PROJECT: KORBA SUPER THERMAL POWER PROJECT (KSTPP)			
KORBA I,II,& III (3x200 MW + 3x500 MW+ 1x500 MW)			
DEPT	NAME	SIGN	DATE
CHD	GP		21.12.21
APPD	RR		21.12.21
TITLE:			SCALE : NTS
GA OF GYPSUM DEWATERING BUILDING LAYOUT			
DRAWING NO.			REV. OD
PE-DG-466-521-A940			
SHEET 1 OF 2			

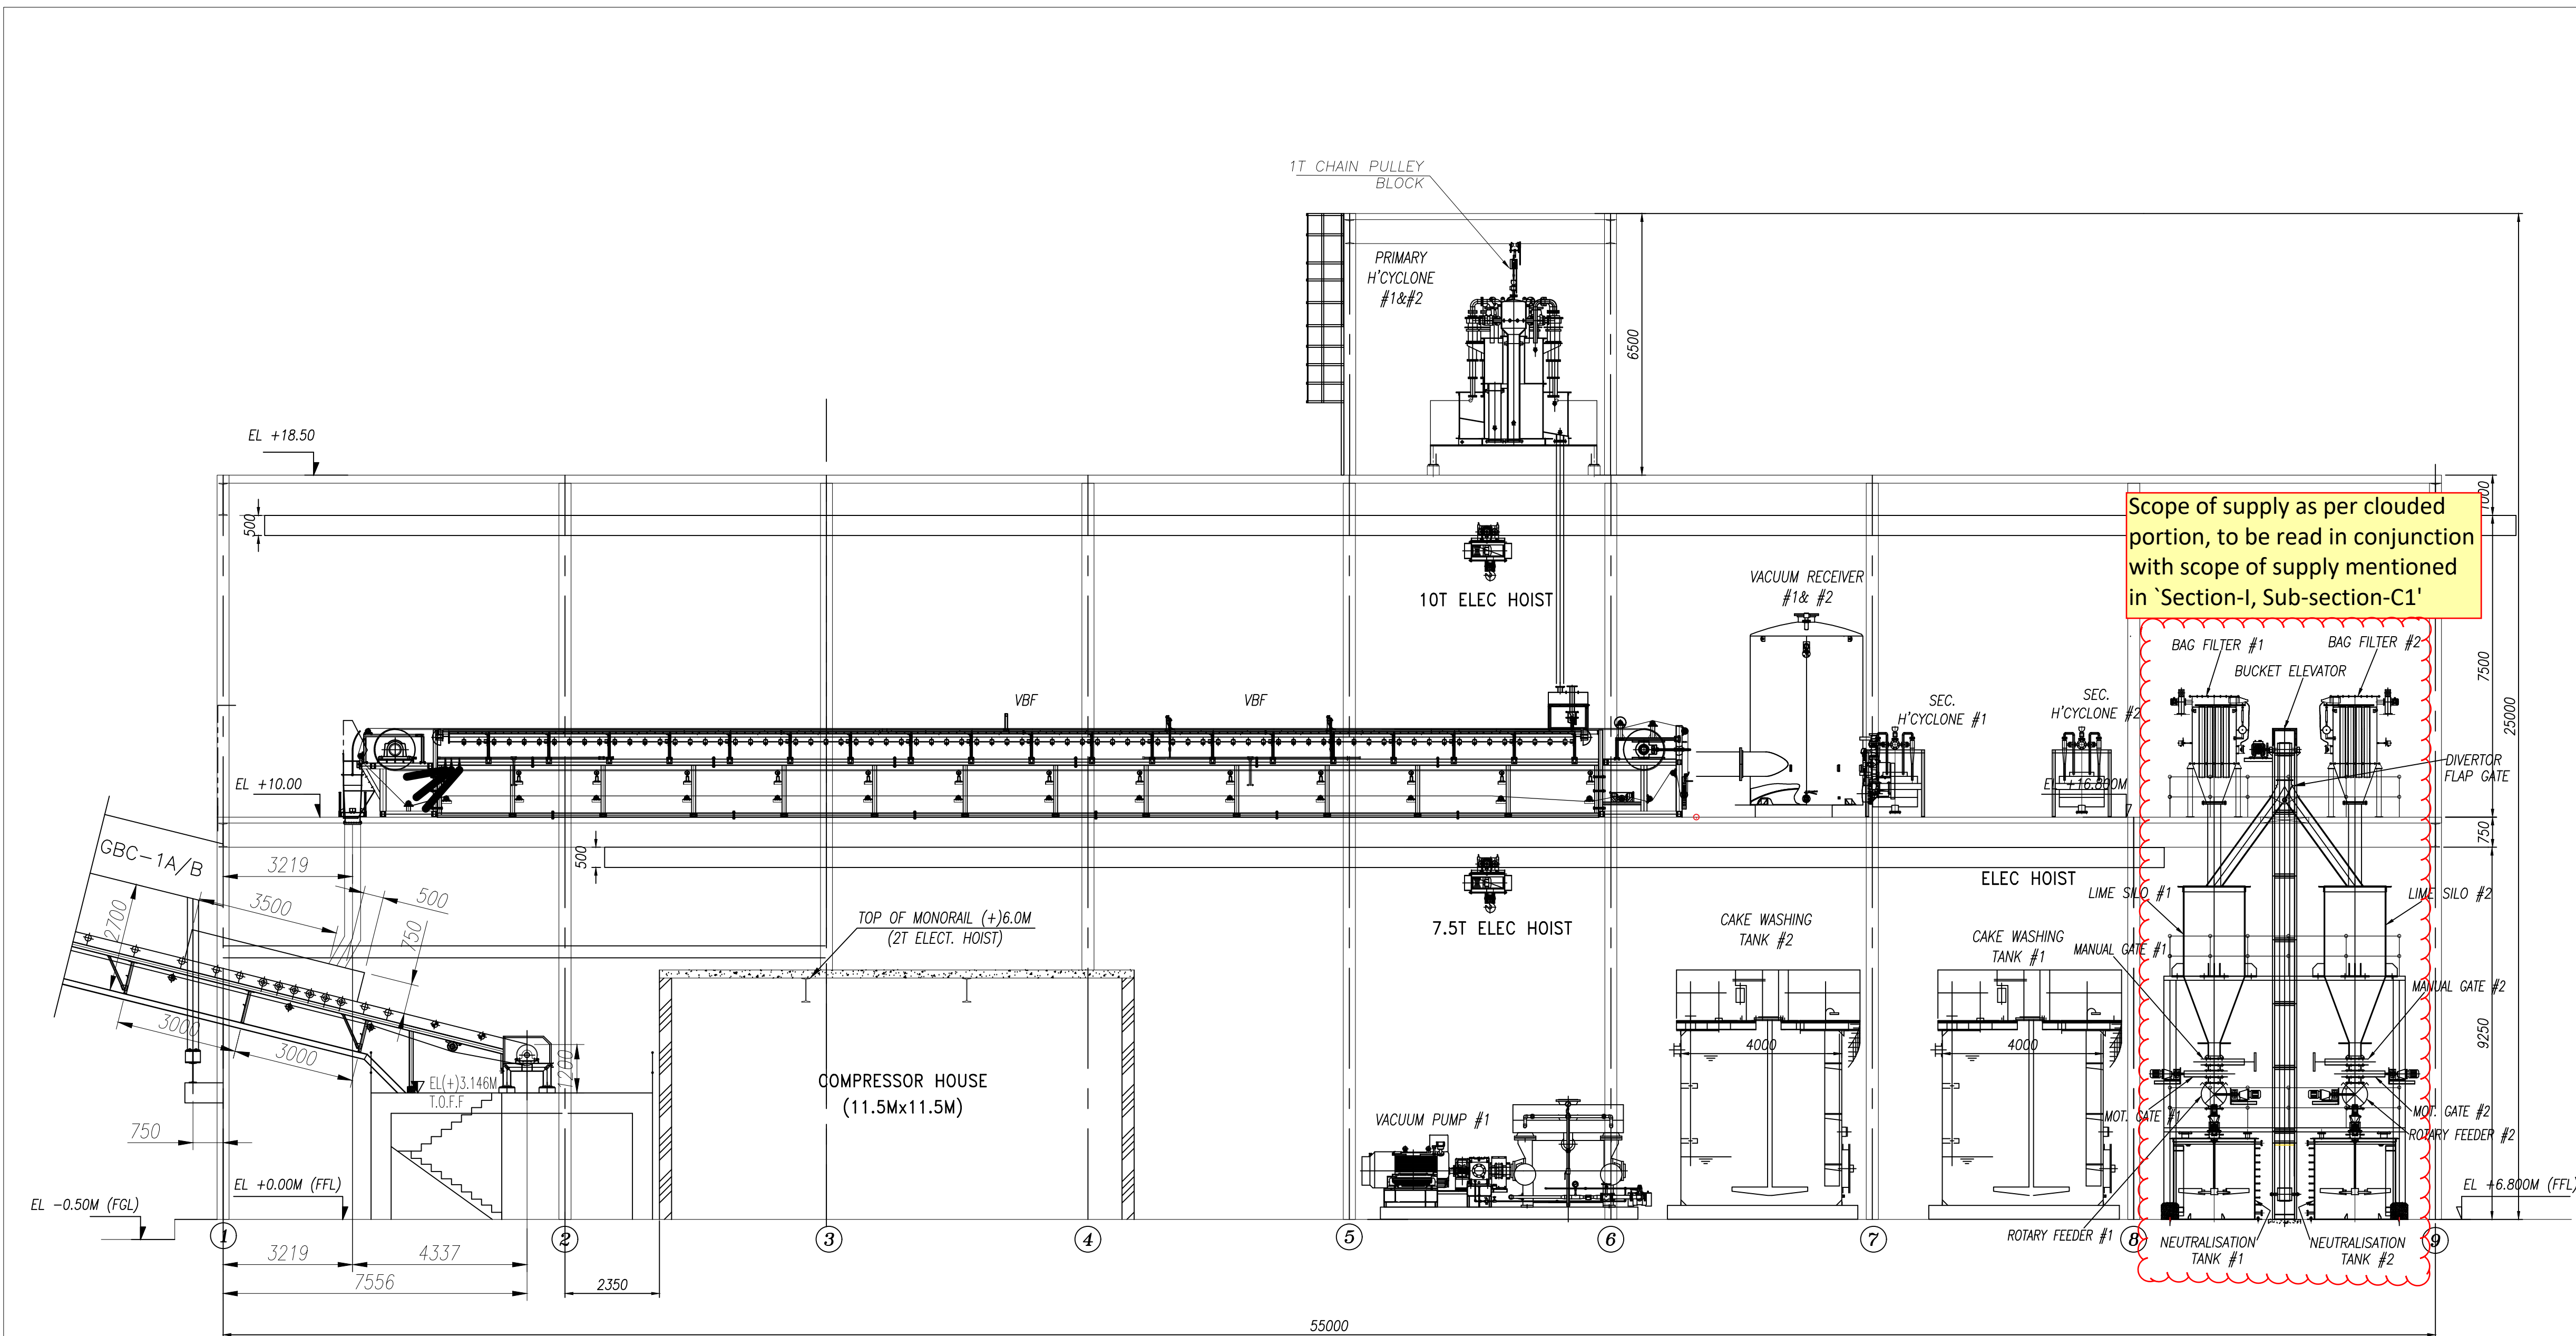

SECTION - BB

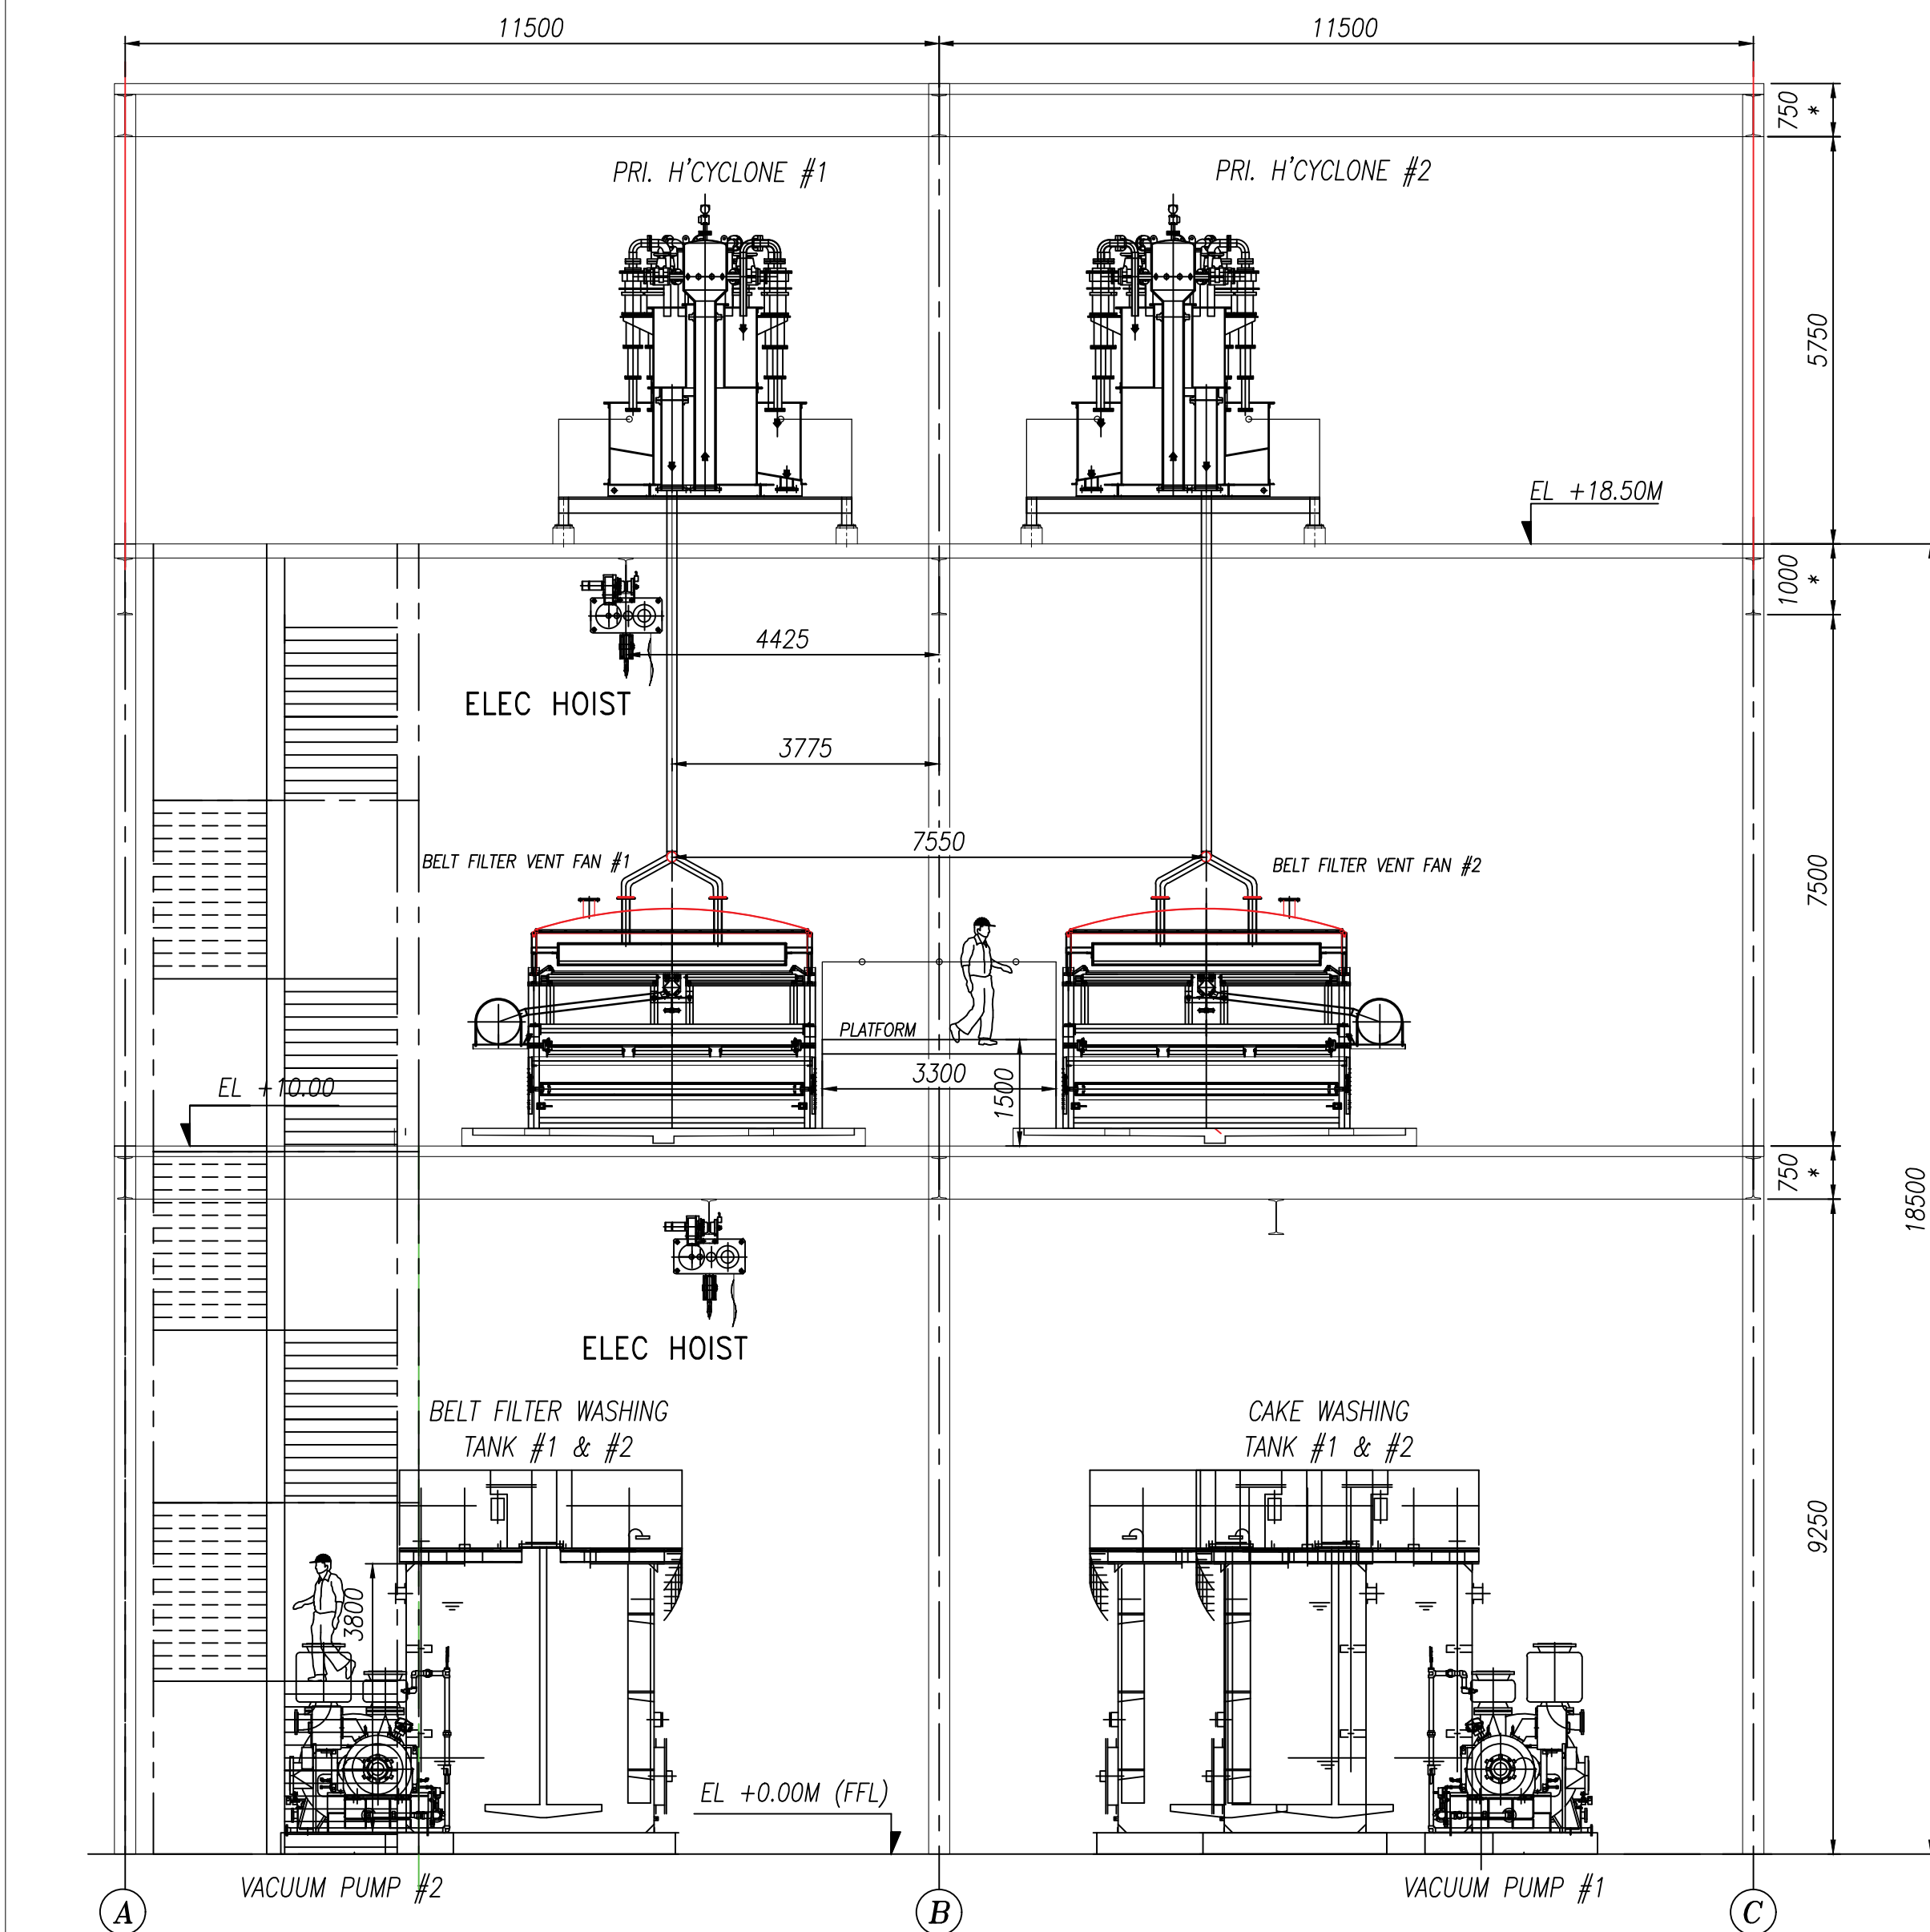

SECTION - AA

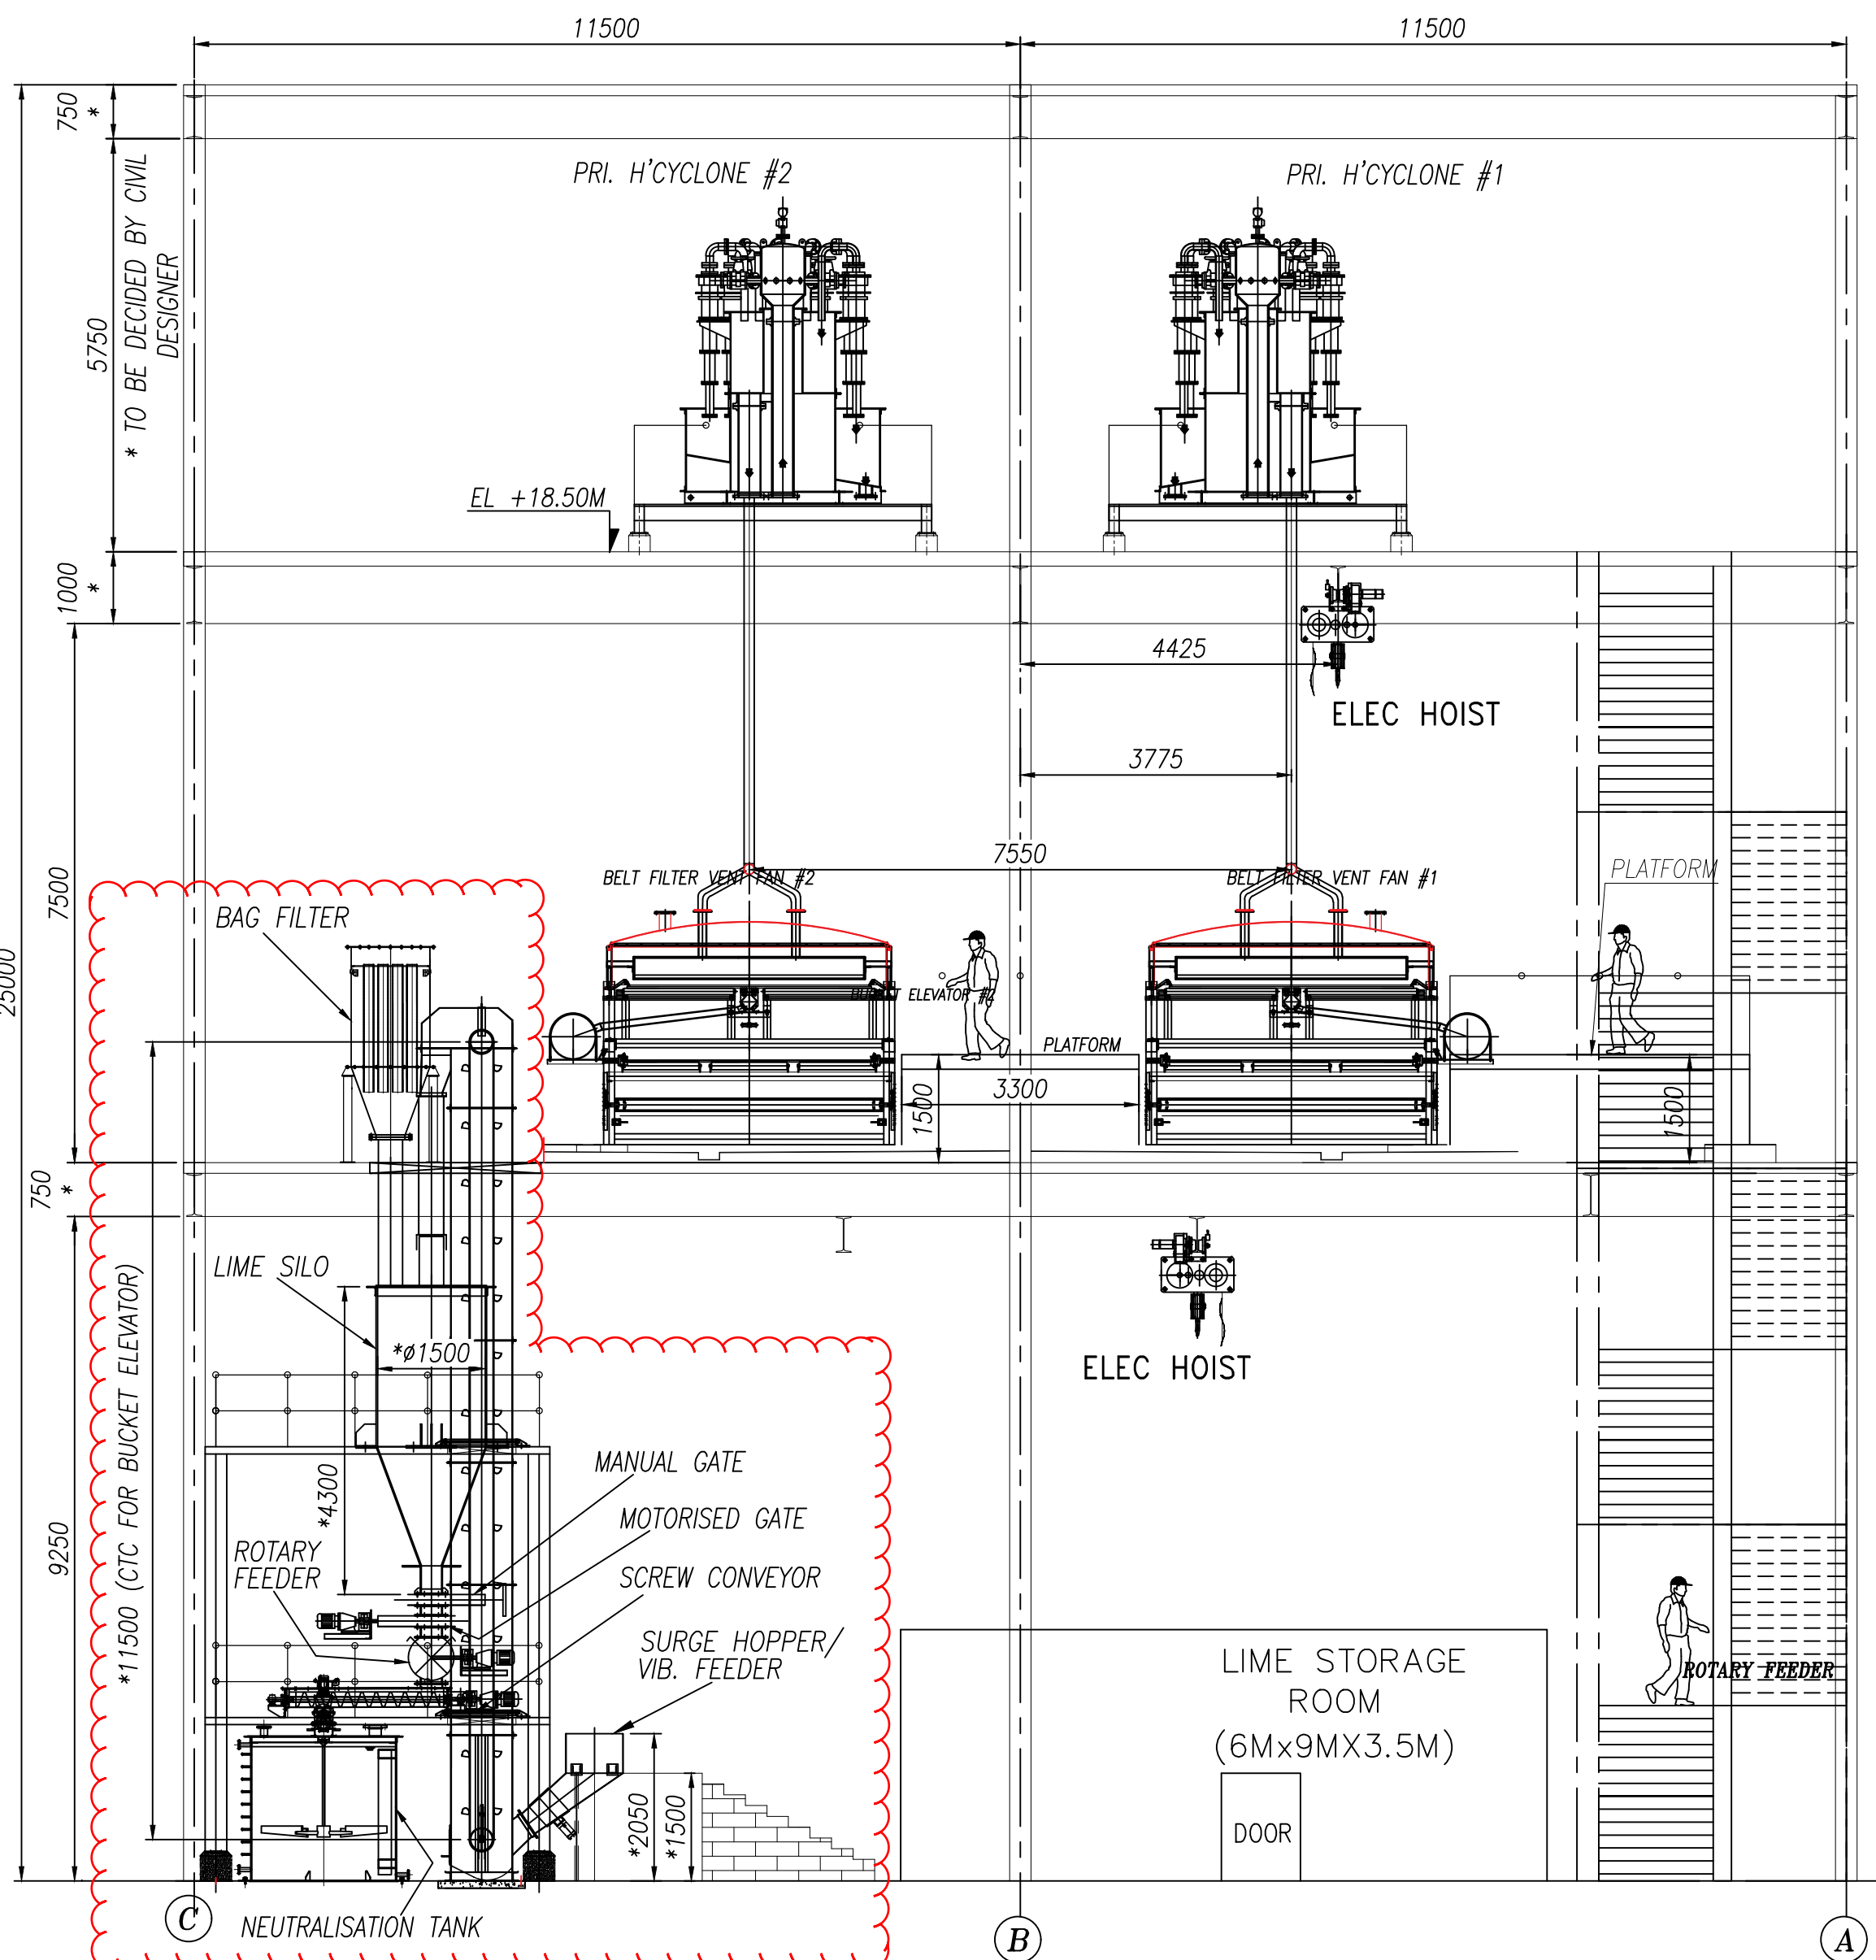

SECTION - CC

*** MARKED DIMENSIONS OF LIME FEEDING/DOSING SYSTEM SHOWN IN THE DRAWING ARE FOR GUIDANCE PURPOSE ONLY AND SHALL BE FINALISED DURING DETAIL ENGG. BY VENDOR.

TABLE OF EQUIPMENTS					
EQPT NO	QTY.	DISCRPTIONS	APPX WEIGHT OF EACH EQPT UNDER OPRATION	LOCATION IN GDW BUILDING	REMARKS.
1	02	VACUUM BELT FILTER WITH ACCESSORIES	95 MT	ON FIRST FLOOR EL(+10.00	THE EQUIPMENT COLUMNS WILL BE SUPPORTED ON THE FLOOR
2	02	SECONDARY HYDRO CYCLONE - (SET)	15 MT (INCLUDING SUPPORTING PLATFORMS)	ON FIRST FLOOR EL(+10.00	THE EQUIPMENT COLUMNS WILL BE SUPPORTED ON THE FLOOR
3	02	NEUTRALISATION (LIME DOSING) TANK WITH AGITATOR	6.5 MT	GROUND FLOOR @ EL(+0.00	FLOOR MOUNTED. FOUNDATION BY CIVIL.
4	02	LIME FEED SCREW CONVEYER	2 MT	ABOVE NEUTRALISATION (LIME DOSING) TANK	THE SCREW CONVEYER WILL BE MOUNTED BELOW LIME SILO/HOPPER TO CONNECT NEUTRALIZATION TANK
5	02	LIME DOSING SILO/HOPPER, MANUAL GATE, MOTORISED GATE, ROTARY FEEDER & SUPPORT STRUCTURE	12 MT (COMBINED WEIGHT INCLUDING SUPPORTS)	ABOVE NEUTRALISATION (LIME DOSING) TANK	LIME SILO WILL BE SUPPORTED ON PLATFORM ON SUPPORTING STRUCTURE FROM GROUND FLOOR OF BUILDING
6	02	PRIMARY HYDROCYCLONE - (SET)	10MT (INCLUDING SUPPORTING PLATFORMS)	ON SECOND FLOOR EL(+18.50	PRIMARY HYDRO CYCLONE WILL BE SUITABLY SUPPORTED ON FLOOR
7	02	VACUUM PUMP & MOTOR	25 MT	GROUND FLOOR @ EL(+0.00	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
8	02	VACUUM RECEIVER	10 MT	FIRST FLOOR @ EL(+10.00	FLOOR MOUNTED
9	02	CAKE WASH TANK	AS PER REFERENCE DRG	GROUND FLOOR @ EL(+10.00	SEPARATE FOUNDATION OR FLOOR MOUNTED AS PER CIVIL DESIGN
10	02	BELT FILTER(CLOTH) TANK	AS PER REFERENCE DRG	GROUND FLOOR @ EL(+0.00	SEPARATE FOUNDATION OR FLOOR MOUNTED AS PER CIVIL DESIGN
11	01	BUCKET CONVEYOR ASSY.(WITH DIVERTING FLAP GATE, SURGE HOPPER & VIBRATING FEEDER) FOR LIME FEED	16 T	FROM GROUND FLOOR TO LIME STORAGE SILO TOP	THE BUCKET ELEVATOR IS MOUNTED ON PIT FLOOR BELOW GROUND AND WILL REACH TO LIME SILO TOP THROUGH SUPPORT STRUCTURE. FOUNDATION ON PIT FOR BUCKET ELEVATOR SHALL BE BY CIVIL.
12	02	BAG FILTER WITH BLOWERS	1 T	ON LIME STORAGE SILO PLATFORM	BAG FILTER WILL BE SUPPORTED ON LIME SILO / PLATFORM WHICH WILL BE SUPPORTED ON FLOOR
13	02	LIME DOSING PUMPS	0.35 T	GROUND FLOOR @ EL(+0.00	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
14	01	PRIMARY HYDROCYCLONE FEED TANK & PUMPS WITH MOTORS	AS PER REFERENCE DRG	OUTSIDE GDW BUILDING	SEPARATE FOUNDATION OR FLOOR MOUNTED AS PER CIVIL DESIGN
15	01	FILTRATE WATER TANK & PUMPS WITH MOTORS	AS PER REFERENCE DRG	OUTSIDE GDW BUILDING	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
16	01	SECONDARY HYDROCYCLONE FEED TANK & PUMPS WITH MOTORS	AS PER REFERENCE DRG	OUTSIDE GDW BUILDING	SEPARATE FOUNDATION OR FLOOR MOUNTED AS PER CIVIL DESIGN
17	01	WASTE WATER STORAGE TANK & PUMPS WITH MOTORS	AS PER REFERENCE DRG	OUTSIDE GDW BUILDING	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
18	02	FILTRATE EXTRACTION PUMPS & MOTORS	3 T	GROUND FLOOR @ EL(+0.00	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
19	04	CAKE WASH PUMPS & MOTORS	0.3 T	GROUND FLOOR @ EL(+0.00	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
20	04	BELT/CLOTH WASH PUMPS & MOTORS	0.3 T	GROUND FLOOR @ EL(+0.00	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
21	-	PLATFORMS FOR VBF & HYDROCYCLONES	15 T	AS SHOWN	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN
22	02	DISCHARGE CHUTE	10 T	AS SHOWN	FOUNDATION TO BE PROVIDED AS PER CIVIL DESIGN

LIST OF REFERENCE DRAWINGS

SL. NO	DRAWING NO.	DRAWING TITLE	AGENCY
1	2100-109-PVM-F-044	PLANT LAYOUT FOR FGD SYSTEM	PEM/BAP
2	2100-109-PVM-B-074	FLOW DIAGRAM OF LIME STONE AND GYPSUM HANDLING PLAN	ISG/VENDOR
3	2100-109-PVM-B-175	GA OF CONVEYOR GBC 1A/1B	ISG/VENDOR
4	2100-109-PVM-B-143	GA DRAWING OF PRIMARY HYDRO CYCLONE FEED TANK	PEM/VENDOR
5	2100-109-PVM-B-143	GA DRAWING OF FILTRATE WATER TANK	PEM/VENDOR
6	2100-109-PVM-B-143	GA DRAWING OF SECONDARY HYDRO CYCLONE FEED TANK	PEM/VENDOR
7	2100-109-PVM-B-143	GA DRAWING OF WASTE WATER TANK	PEM/VENDOR
8	2100-109-PVM-B-143	GA DRAWING OF BELT FILTER WASH TANKS	PEM/VENDOR
9	2100-109-PVM-B-143	GA DRAWING OF CAKE WASH (CLARIFIED WATER) TANK	PEM/VENDOR

LEGEND:-	
FGL	- FINISHED GROUND LEVEL
FFL	- FINISHED FLOOR LEVEL
T.O.P.F	- TOP OF PLATFORM
T.O.C	- TOP OF CONCRETE
OPENG	- OPENING
MR	- MONORAIL
THK	- THICK
TYP	- TYPICAL
GDWB	- GYPSUM DEWATERING BUILDING
VBF	- VACUUM BELT FILTER

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES AND ELEVATIONS IN METRES.
- EL (+0.00M OF MAIN PLANT AREA CORRESPONDS TO RL (+1289.6M
- THE EQUIPMENT MACHINERY SIZES SHOWING IN THE DRAWING IS INDICATIVE ONLY AND WILL BE CONFIRMED AFTER VENDOR DATA. THE MAXIMUM ANTICIPATED SIZE AND LOADING IS PROVIDED IN THE DRAWING.
- FLOOR OPENINGS, PIPE CROSSINGS SHALL BE CONFIRMED DURING DETAIL ENGINEERING.
- FLOOR ELEVATION TO BE CONSIDERED AS PRELIMINARY. FINAL LEVEL WILL BE FIXED AFTER EQUIPMENT FINALIZATION.
- DETAILS OF STAIRCASE, SUITABLE DOORS, WINDOWS, VENTILATORS SHALL BE CONSIDERED BY CIVIL DESIGNER FOR GYPSUM DEWATERING BUILDING.
- ** MARKED DIMENSIONS OF LIME DOSING/FEEDING SYSTEM SHOWN IN THE DRAWING ARE FOR GUIDANCE PURPOSE ONLY AND SHALL BE FINALISED DURING DETAIL ENGG. BY VENDOR.

NTPC DRG NO: 2100-109-PVM-B-269			
CUSTOMER: NTPC LIMITED.			
PROJECT: KORBA SUPER THERMAL POWER PROJECT (KSTPP)			
KORBA I,II,& III (3x200 MW + 3x500 MW+ 1x500 MW)			
DEPT	NAME	SIGN	DATE
CODE	DRN	SA	21.12.21
M	CHD	GP	21.12.21
APPD	RR		21.12.21
TITLE:			SCALE : NTS
GA OF GYPSUM DEWATERING BUILDING LAYOUT			
DRAWING NO.			REV. OD
PE-DG-466-521-A940			
SHEET 2 OF 2			

A3

DRAWING No.

LINE SYMBOLS

SYMBOLS	NAME
	PIPE LINE
	CAPILLARY TUBING
	ELECTRIC SIGNAL
	SOFTWARE LINK
	PRESSURE LEAD
	DUCT

PIPING VALVE SYMBOLS

SYMBOLS	NAME
	GATE VALVE (NOR.CLOSED)
	GLOBE VALVE (NOR.CLOSED)
	BALL VALVE (NOR.CLOSED)
	BUTTERFLY VALVE (NOR.CLOSED)
	DIAPHRAGM VALVE (NOR.CLOSED)
	PINCH VALVE (NOR.CLOSED)
	NEEDLE VALVE (NOR.CLOSED)
	CHECK VALVE
	CHECK VALVE (WAFER)
	PRESSURE RELIEF VALVE
	KNIFE EDGE GATE VALVE

INSTRUMENT VALVE SYMBOLS

SYMBOLS	NAME
	ACTUATED BY AIR
	ACTUATED BY MOTOR
	AIR CONTROL VALVE
	SOLENOID ACTUATOR
	SELF REGULATING VALVE
	SELF REGULATING VALVE

TRENCH SYMBOLS

SYMBOLS	NAME
	TO ABSORBER AREA DRAIN SUMP
	TO GYPSUM AREA DRAIN SUMP
	TO LIMESTONE AREA DRAIN SUMP

SYMBOLS FOR PIPING PARTS
& INSTRUMENT PARTS

SYMBOLS	NAME
	STEAM TRAP
	AIR TRAP
	Y-STRAINER
	T-STRAINER
	TEMPORARY STRAINER
	REDUCER
	EXPANSION JOINT
	DUCT EXPANSION JOINT
	FLEXIBLE HOSE
	SPOOL PIECE
	VENT
	HOSE CONNECTION
	BLIND FLANGE
	REDUCING FLANGE
	CAP (BW)
	CAP (SCR)
	TRENCH
	SIGHT GLASS
	SILENCER
	ORIFICE
	DIAPHRAGM
	MAGNETIC FLOW METER
	VORTEX FLOW METER
	PH METER
	FILTER
	MANHOLE
	PITOT TUBE
	SAMPLING POT
	SAMPLING NOZZLE
	ROTOMETER TYPE FLOW METER

SYMBOLS FOR VALVE OPERATION

SYMBOLS	NAME
	FAILURE OPEN (THE VALVE OPENS WHEN AIR OR ELECTRICITY FOR ACTUATOR FAILS.)
	FAILURE CLOSE (THE VALVE CLOSES WHEN AIR OR ELECTRICITY FOR ACTUATOR FAILS.)

INSULATION SYMBOLS

SYMBOLS	DESCRIPTION
H10	THERMAL INSULATION (100°C & LOWER)
H15	THERMAL INSULATION (101°C ~ 150°C)
H20	THERMAL INSULATION (151°C ~ 200°C)
H25	THERMAL INSULATION (201°C ~ 250°C)
H30	THERMAL INSULATION (251°C ~ 300°C)
H35	THERMAL INSULATION (301°C ~ 350°C)
HF	INSULATION FOR ANTI FREEZING
ET	ELECTRIC TRACE
ST	STEAM TRACE (LOW PRESSURE STEAM)
P10	PERSONAL PROTECTION (100°C & LOWER)
P15	PERSONAL PROTECTION (101°C ~ 150°C)
P20	PERSONAL PROTECTION (151°C ~ 200°C)
P25	PERSONAL PROTECTION (201°C ~ 250°C)
P30	PERSONAL PROTECTION (251°C ~ 300°C)
P35	PERSONAL PROTECTION (350°C ~ 400°C)

DELIVERY LIMITS

SYMBOLS	NAME
	BETWEEN NTPC AND CONTRACTOR
	BETWEEN SUB CONTRACTOR AND VENDOR

SYSTEM

NUMBER	NAME
1	FLUE GAS SYSTEM
2	SO ₂ ABSORPTION OXIDATION SYSTEM
3	REHEATING SYSTEM
4	GYPSUM DEWATERING HANDLING SYSTEM
5	LIMESTONE PREPARATION SYSTEM
6	BLANK
7	SUMP SYSTEM
8	UTILITY SYSTEM

FLUID NAME

FLUID SYMBOL	FLUID NAME	FLUID SYMBOL	FLUID NAME
AC	COMPRESSED AIR	WCS	COOLING WATER SUPPLY
AF	FLUIDIZER AIR	WCR	COOLING WATER RETURN
AI	INSTRUMENT AIR	WD	DRINKING WATER
AO	OXIDATION AIR	WP	PROCESS WATER
AS	SEAL AIR	WR	RAW WATER
DD	DUCT DRAIN	WC	Ca(OH) ₂ WATER
FS	FILTRATE SLURRY	WW	WASTE WATER
GS	GYPSUM SLURRY	VG	VACUUM PUMP VENT
LS	LIMESTONE SLURRY	VBG	BELT FILTER VENT GAS
		LD	LIME/LIMESTONE DEDUSTING
		LOL	LUBE OIL (LOW PRESSURE)
		LOH	LUBE OIL (HIGH PRESSURE)
		CW	CLARIFIED WATER

SERVICE CLASS

SERVICE CLASS	MATERIAL	FLUID SYMBOL
AA40	NATURAL RUBBER LINED PIPING	LS, WP, WC GS,FS,WW,DD AI, LOL LOH WP, AO AS,AO,AC,AF,LD WP,WR,WCS,WCR, VG, AA, CW
AA60	NATURAL RUBBER LINED PIPING	
BA01	Gr.304 STAINLESS STEEL PIPING / GI PIPING	
BA02	Gr.304 STAINLESS STEEL PIPING / GI PIPING	
BA03	Gr.316L STAINLESS STEEL PIPING	
CA01	CARBON STEEL GENERAL PIPING	
CC01	CARBON STEEL PRESSURE PIPING	
DA60	FRP PIPING (PIPE DIA UPTO 250 NB)	
DA40	FRP PIPING (PIPE DIA UPTO 250 NB)	

UNIT CODE

SYMBOLS	UNIT IDENTIFICATION
00	COMMON
10	UNIT-1 FGD SYSTEM AND AUXILIARIES
20	UNIT-2 FGD SYSTEM AND AUXILIARIES

EXPRESSION OF PIPING LINE

10	-	200	-	GS	-	2	00	1	-	AA60	-	HF
UNIT CODE		NOMINAL PIPE SIZE (mm)		FLUID SYMBOL		SYSTEM	SUFFIX NUMBER	SERIAL NUMBER		PIPING SERVICE CLASS		INSULATION CLASS

CUSTOMER NOS:G505toG508&G205toG207

CUSTOMER: NTPC LIMITED.

PROJECT: KORBA STG1,II&III(3X200MW&4X500MW)
FGD SYSTEM PACKAGE

DEPT CODE	NAME (BHEL)	DATE
DRN	M. VENKATA RMAN	09.11.20
CHD	P.NAVEEN	09.11.20
APPD	ACR	09.11.20

MITSUBISHI HITACHI POWER SYSTEMS, LTD.
AIR QUALITY CONTROL SYSTEMS TECHNOLOGY DIVISION

P & ID - LEGENDS AND NOTES

SCALE : NTS

TITLE:

NTPC DRG NO.

SH 01 of 02

BHEL DRG NO

FILE NO

B240 - 00001

REV NO

01


A3

DRAWING No.

A		B		C		D		E		F		G		H			
INSTRUMENT ABBREVIATION														THIRD ANGLE PROJECTION		No. REQ'D	
1	FIRST-LETTER		SUCCEEDING-LETTERS														
		MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER											
	A	ANALYSIS		ALARM													
	B	BURNER, COMBUSTION		BLANK	BLANK	BLANK											
	C	BLANK			CONTROL												
	D	BLANK	DIFFERENTIAL														
	E	VOLTAGE		SENSOR (PRIMARY ELEMENT)													
	F	FLOW RATE	RATIO (FRACTION)														
	G	BLANK		GLASS, VIEWING DEVICE													
	H	HAND				HIGH											
	I	CURRENT (ELECTRICAL)		INDICATE													
	J	POWER	SCAN														
	K	TIME, TIME SCHEDULE	TIME RATE OF CHANGE		CONTROL STATION												
	L	LEVEL		LIGHT		LOW											
	M	BLANK	MOMENTARY			MIDDLE, INTERMEDIATE											
	N	BLANK		BLANK	BLANK	BLANK											
	O	BLANK		ORIFICE, RESTRICTION													
	2	P	PRESSURE, VACUUM		POINT(TEST) CONNECTION												
Q		QUANTITY	INTEGRATE, TOTALIZE														
R		RADIATION		RECORD													
S		SPEED, FREQUENCY	SAFETY		SWITCH												
T		TEMPERATURE			TRANSMIT												
U		MULTIVARIABLE		MULTIFUNCTION	MULTIFUNCTION	MULTIFUNCTION											
V		VIBRATION, MECHANICAL ANALYSIS			VALVE, DAMPER, LOUVER												
W		WEIGHT, FORCE		WELL													
X		UNCLASSIFIED	X AXIS	UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED											
Y		EVENT, STATE OR PRESENCE	Y AXIS		RELAY, COMPUTE, CONVERT												
Z		POSITION, DIMENSION	Z AXIS		DRIVER, ACTUATOR, UNCLASSIFIED FINAL CONTROL ELEMENT												
INSTRUMENT SYMBOLS																	
SYMBOLS		NAME															
		FIELD MOUNTED															
		FOR CONTROL ROOM															
		FOR LOCAL CONTROL PANEL															
		FOR DCS															
		INTERLOCK LOGIC															
PNEUMATIC VALVE ACTUATOR																	
CODE NO.		ACTUATION															
FLXXWA-D		DOUBLE SOLENOID NO LIMIT SWITCH															
FLXXWA-DL		DOUBLE SOLENOID WITH LIMIT SWITCH															
FLXXWA-S		SINGLE SOLENOID NO LIMIT SWITH															
FLXXWA-SL		SINGLE SOLENOID WITH LIMIT SWITCH															
MACHINERY SYMBOLS																	
SYMBOLS		NAME															
		PUMP															
		FAN / BLOWER															
		AGITATOR (FLAT BLADE)															
		AGITATOR (PROPELLOR)															
		ROTARY VALVE															
		CRUSHER															
		BELT FEEDER															
		BELT FILTER															
		BALL MILL															
		CYCLONE															
		MIST ELIMINATOR															
EQUIPMENT SYMBOLS																	
SYMBOLS		NAME															
		BAG FILTER															
		SILO															
		SLIDE GATE															
		TANDEM LOUVER DAMPER (MULTIVANE)															
		SINGLE STAGE LOUVER DAMPER (MULTIVANE)															
		LOUVER DAMPER (SINGLE VANE)															
		DISTRIBUTION BOX (3WAY)															
		DISTRIBUTION BOX (2WAY)															
		SUMP															
		HEAT EXCHANGER															
		SHELL AND TUBE HEAT EXCHANGER															
		AIR DRYER															
		FILTER															
		SPRAY NOZZLE															
DRIVER SYMBOLS																	
SYMBOLS		NAME															
		AIR MOTOR															
		ELECTRIC MOTOR															
OTHER SYMBOLS																	
SYMBOLS		NAME															
		INSERT PIPE / LANCE															
		CHUTE															
		TRUCK															
		CHANGE OF MATERIAL															
CONFIDENTIAL & PROPRIETARY INFORMATION																	
CUSTOMER NOS:G505toG508&G205toG207																	
CUSTOMER: NTPC LIMITED.																	
PROJECT: KORBA STGI,II&III(3X200MW&4X500MW)																	
FGD SYSTEM PACKAGE																	
DEPT CODE NAME (BHEL) DATE																	
M CHD P.NAVEEN 09.11.20																	
APPD ACR 09.11.20																	
MITSUBISHI HITACHI POWER SYSTEMS, LTD.																	
AIR QUALITY CONTROL SYSTEMS TECHNOLOGY DIVISION																	
P & ID - LEGENDS AND NOTES																	
SCALE : NTS																	
TITLE:																	
NTPC DRG NO. SH 02 of 02																	
BHEL DRG NO. FILE NO. REV NO.																	
B240 - 00002 01																	

0 1 2 3 4 5 6 7 8 9 10

THIRD ANGLE	No. REQ'D

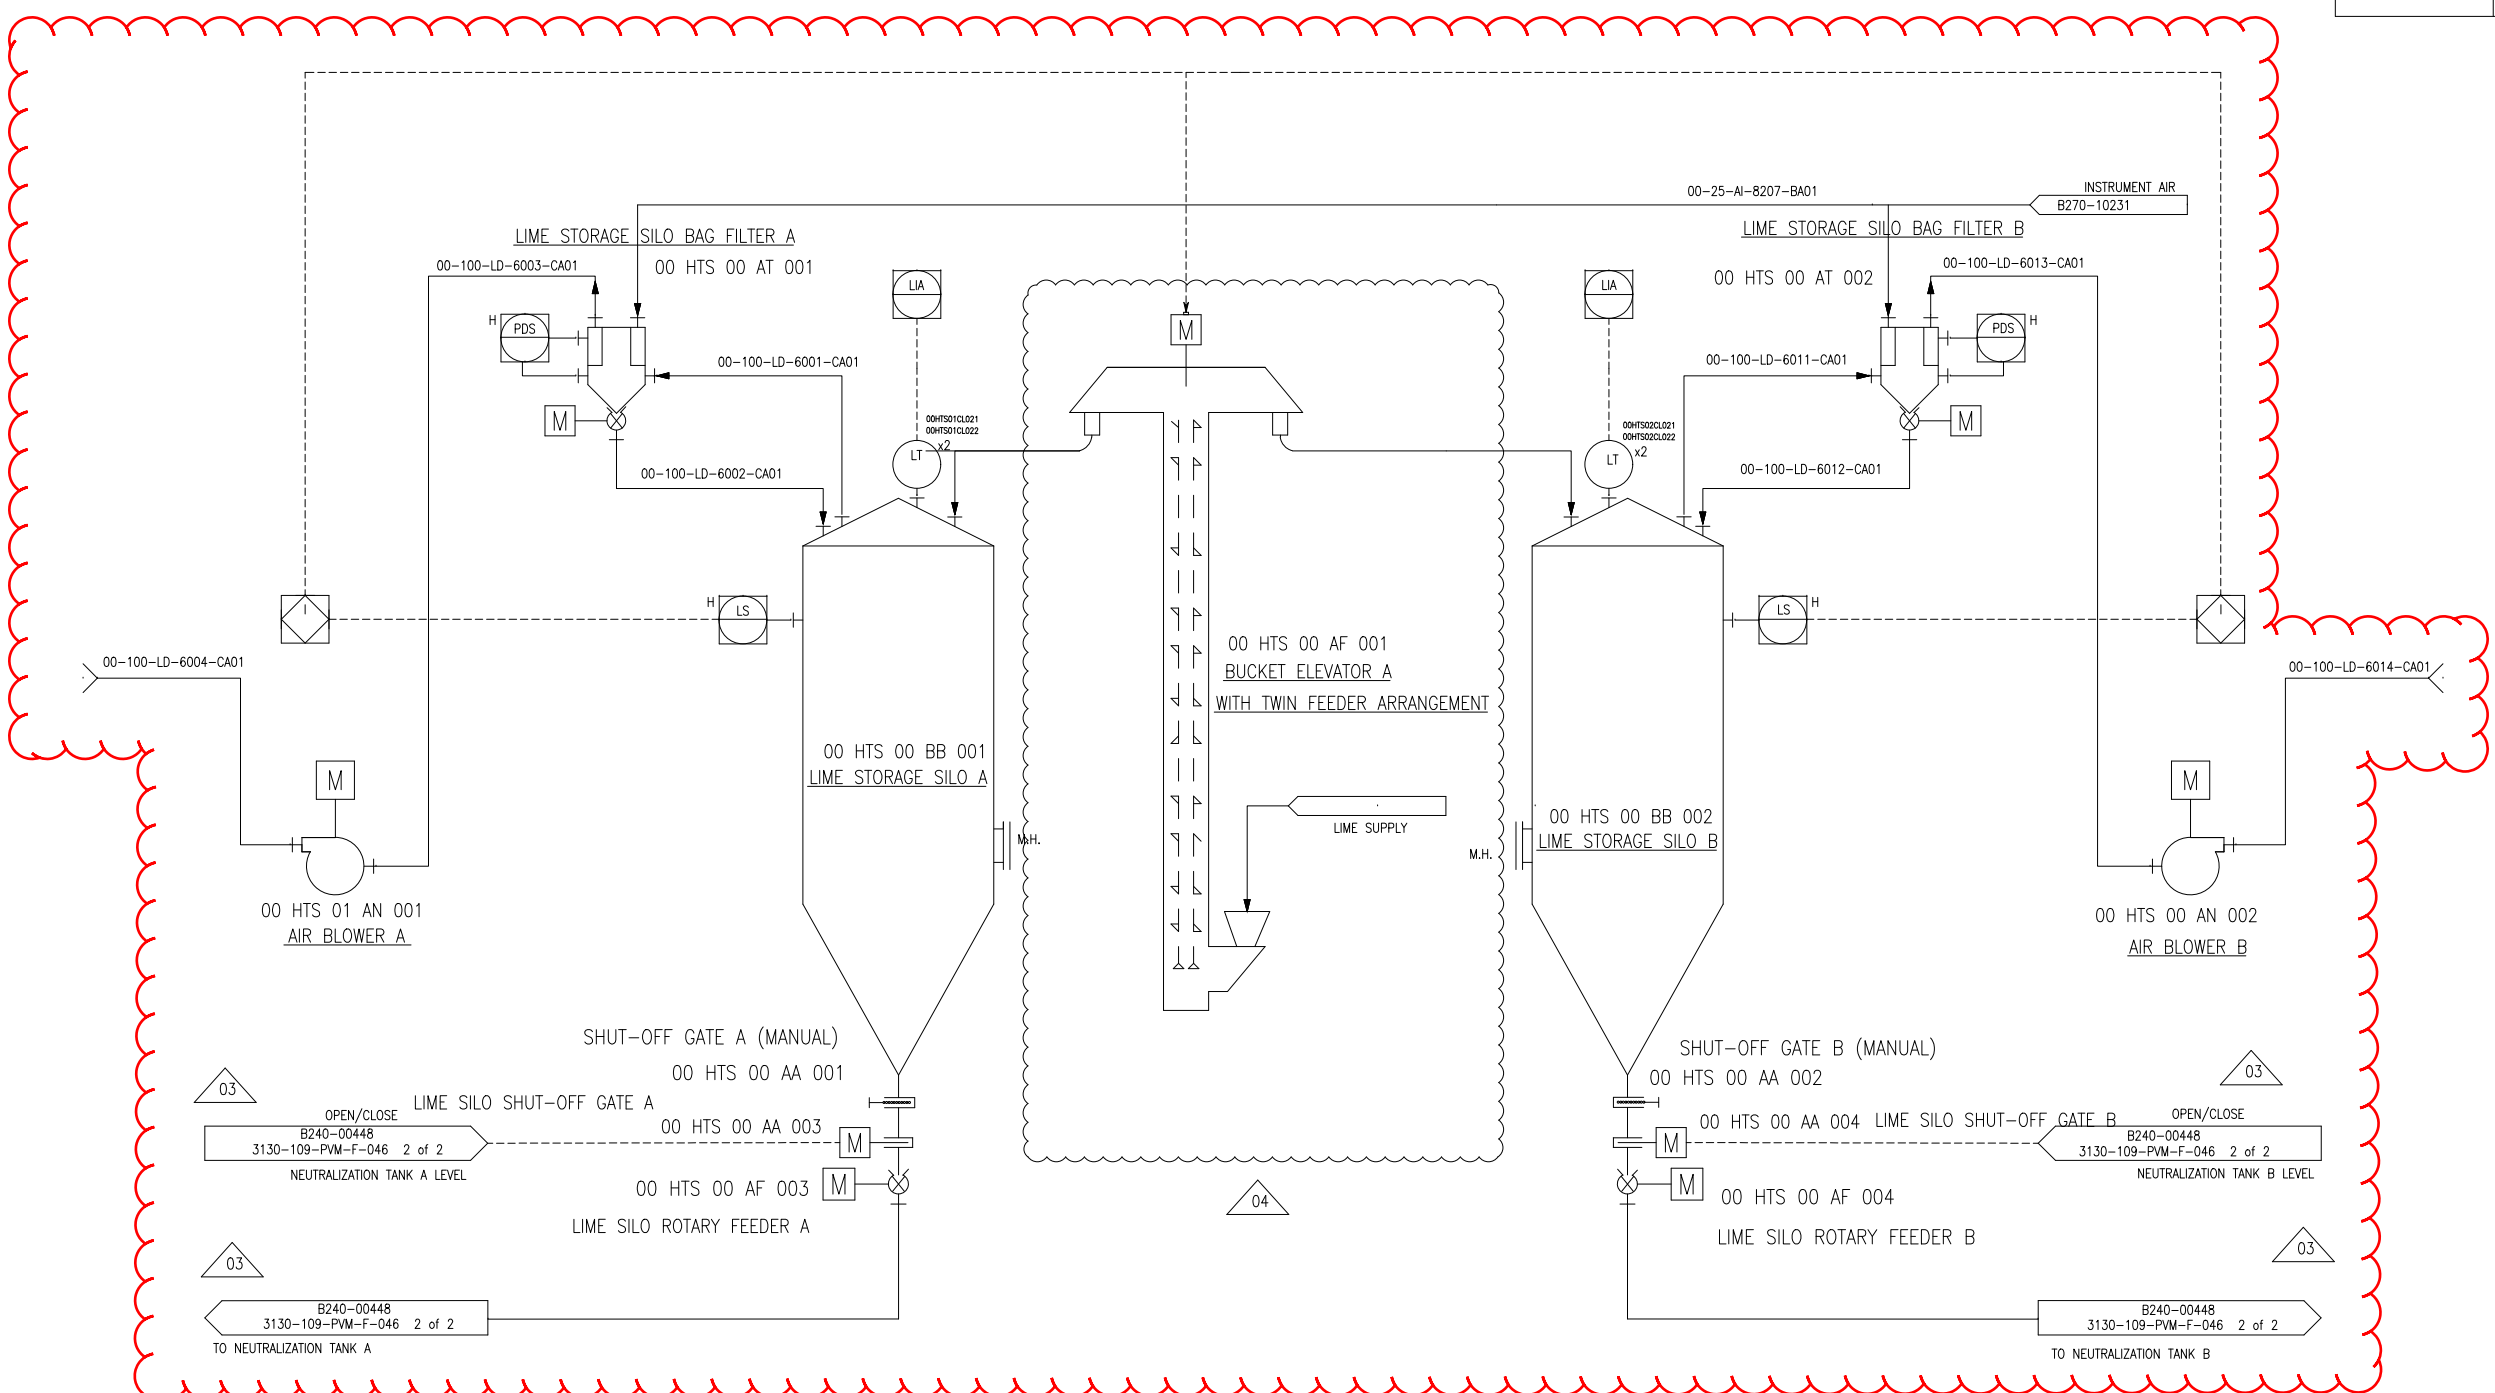

Scope of supply as per clouded portion, to be read in conjunction with scope of supply mentioned in 'Section-I, Sub-section-C1'.

S.NO	SECTION	FLOW	TEMP (C)	DENSITY kg/m ³
1	Lime supply to Bucket elevator	144 kg /Day	Ambient	450
2	Lime supply to dosing tank	6.0 kg/hr	Ambient	450

REV.	DATE	ALTD.	CHKD.	APPR.	REV.	DATE	ALTD.	CHKD.	APPR.	REV.	DATE	ALTD.	CHKD.	APPR.	REV.	DATE	ALTD.	CHKD.	APPR.
04	03.03.22	RAJU.P	NAVEEN	ACR	03	06.08.20	RAJU.P	NAVEEN	ACR	02	23.06.20	RAJU.P	NAVEEN	ACR	01	30.05.20	RAJU.P	NAVEEN	ACR
1. Revised the Lime silo bucket conveyor by changing it to twin feeder arrangement instead of single feeder arrangement to fill both A & B Silos.					Revised the document as per NTPC comments					Revised the document as per NTPC comments					Revised the document as per NTPC comments				
2. NTPC Drawing Number included in the drawing along with BHEL file number.					1. Applied to NTPC comments by including loading details of line.					1. Provided Manual Shut off gate.					2. Included Process parameters				

CUSTOMER NOS: G205toG207&G505toG508

CUSTOMER: NTPC LIMITED.
PROJECT: KORBA STAGE-I, II & III (3X200MW & 3X500MW)
FGD SYSTEM PACKAGE

BHARAT HEAVY ELECTRICALS LIMITED.
UNIT: BOILER AUXILIARIES PLANT,
RANIPET-632 406.

DEPT CODE: DRN
M
CHD
APPD

NAME (BHEL)
P.N.REDDY
ACR/RSB

DATE

MITSUBISHI HITACHI POWER SYSTEMS, LTD.
AIR QUALITY CONTROL SYSTEMS TECHNOLOGY DIVISION

TITLE: P & ID-LIME SILO HANDLING SYSTEM-A

SCALE: NTS

NTPC DRG NO: 2100-109-PVM-F-046

SH 01 of 02

BHEL DRG NO

FILE NO: B240-00449

REV NO: 01


THIRD ANGLE
PROJECTION

No. REQ'D

A3

DRAWING No.

Scope of supply as per clouded portion, to be read
in conjunction with scope of supply mentioned in
'Section-I, Sub-section-C1'.

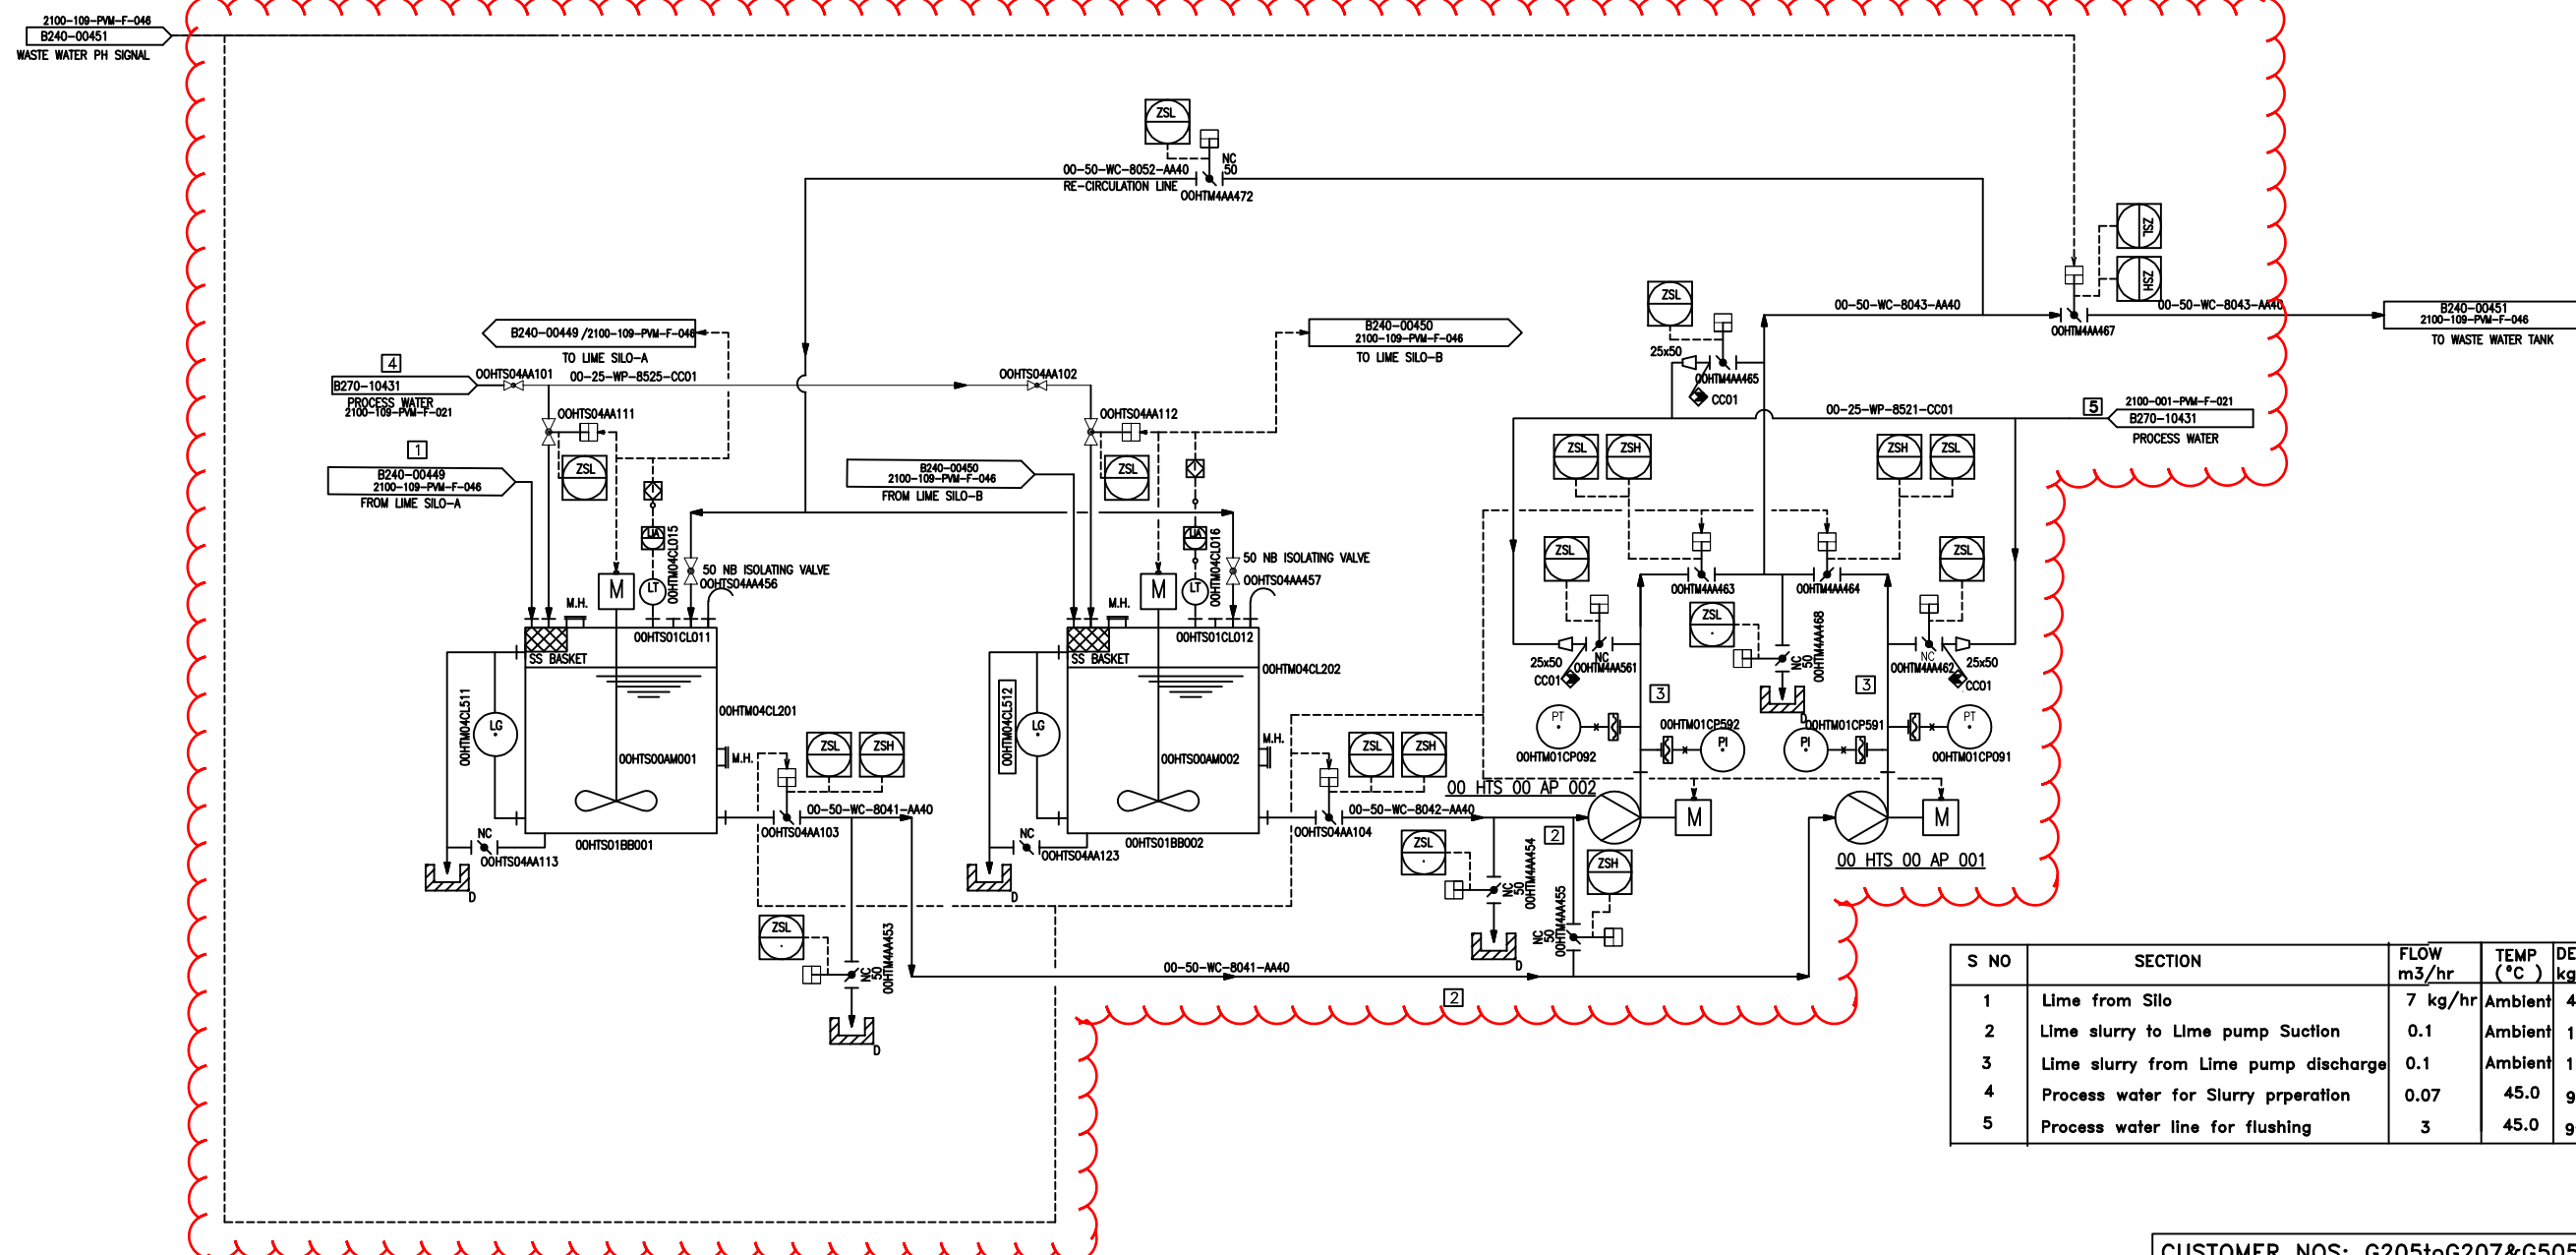

S NO	SECTION	FLOW m ³ /hr	TEMP (°C)	DENSITY kg/m ³
1	Lime from Silo	7 kg/hr	Ambient	450
2	Lime slurry to Lime pump Suction	0.1	Ambient	1100
3	Lime slurry from Lime pump discharge	0.1	Ambient	1100
4	Process water for Slurry prparation	0.07	45.0	990
5	Process water line for flushing	3	45.0	990

00 HTS 01 BB 001/002

LIME DOSING TANK

00 HTS 00 AM 001/002

LIME DOSING TANK AGITATOR

00 HTS 00 AP 001/002

LIME PUMP A/B

CUSTOMER NOS: G205toG207&G505toG508

CUSTOMER: NTPC LIMITED.
PROJECT: KORBA STG-I,II&III(3X200MW & 4X500MW)
FGD SYSTEM PACKAGE

DEPT CODE	NAME (BHEL)	DATE
DRN	M.VENKATA RAMAN	18.11.20
CHD	P.N.REDDY	18.11.20
APPD	ACR	18.11.20

MITSUBISHI HITACHI POWER SYSTEMS, LTD.
AIR QUALITY CONTROL SYSTEMS TECHNOLOGY DIVISION

P & ID-NEUTRALISATION SYSTEM

SCALE : NTS

NTPC DRG NO: 2100-109-PVM-F-046

SH 02 of 02

BHEL DRG NO

FILE NO
B240-00448REV NO
01

REV.	DATE	ALTD	CHK	APPD
01	18.11.20	MVR	NAVEEN	ACR

Revised the document as per NTPC comments

CAUTION: THE DRAWING IS THE PROPERTY OF BHEL.
IT IS TO BE USED FOR THE PROJECT ONLY AND NOT TO BE
REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF
DRAWINGS OF APPARATUS EXCEPT THOSE PROVIDED
FOR AGREEMENT WITH SAID COMPANY.

0 1 2 3 4 5 6 7 8 9 10



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
MASTER DRAWING LIST WITH SCHEDULE OF
SUBMISSION**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00 ANNEXURE-V

SHEET 1 OF 5

ANNEXURE-V**MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION****1. DOCUMENTS TO BE SUBMITTED ALONG WITH THE OFFER/AWARD OF CONTRACT:**

The Bidder shall submit all documents, drawings, diagrams and all such information, which are necessary to fully understand the offer for techno – commercial evaluation as per Annexure-V. The above documents are required for proper evaluation purpose and vendors are requested to comply with above in all respect.

S.No	Description	Along with offer	After Award of Contract
1	Compliance of Specification	Yes	--
2	Deviation List	Yes	--
3	Data Sheet & General Assembly Drawing of complete Lime feeding System	Yes	Yes
4	Manufacturing Drawing & Part Drawing	--	Yes
5	Data sheet & Performance curve	--	Yes
6	Sub Vendor List	Yes	Yes
7	Test certificates	--	Yes
8	Erection check list	--	Yes
9	Pre-commissioning check list	--	Yes
10	Scope of supply	Yes	--
11	Quality plan	--	Yes
12	Operation & Maintenance manual	--	Yes
13	Spare list (Recommended)	Yes	Yes
14	Startup & Commissioning spare	Yes	Yes
15	List of special tools	Yes	Yes
16	Delivery Schedule	Yes	Yes
17	Test & Inspection Procedure	--	Yes
18	Catalogue	Yes	--

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION		SPECIFICATION No: PE-TS-466-571-A102	
			SECTION : I	
			SUB-SECTION : D	
			REV 00	ANNEXURE-V
			SHEET 2 OF 5	

2. DOCUMENTS TO BE SUBMITTED AFTER AWARD OF CONTRACT:

The Successful bidder shall submit necessary data, documents and drawings for review, approval with requirements specified here under.

Drawings that are reviewed by the NTPC / NTPC's Consultant will be returned to bidder with a transmittal letter with any comments and / or questions marked on the drawings or noted in the letter. All comments and questions must be resolved before a resubmission of drawings / documents. If the design has not developed enough to resolve some of the comments or questions, bidder shall place a "hold" on those items or areas of design. NTPC / NTPC's Consultant reserves the right to return drawings unprocessed to bidder if there exists any evidence that bidder has not acknowledged all comments and questions.

All necessary GA drawings, sections, sub-assembly drawings, specifications of main and sub components and necessary set of operation & maintenance manual as asked by NTPC must be furnished by bidder in soft and hard copy forms. For all document's softcopy format shall be searchable pdf, however in addition all drawings, diagrams like P&IDS shall be supplied in ACAD or other editable format and all lists in Excel format. Further break up of technical documents will be discussed during finalization of the purchase contract.

Unless agreed otherwise, Ten (10) hard copies and five (05) sets of electronic copies of all documents are to be submitted in the English language. Electronic Copies shall be submitted in primary original data format (e.g. DOC, XLS, DWG) as well as in a printable non-proprietary document format (e.g. PDF). Especially P&IDs shall be submitted as DWG files and PDF files. Bidder to ensure submission of hard copies as per NTPC's requirement for all engineering drg/doc and for all subsequent revisions along with a soft copy through email to concerned project team. However, all the engineering related information shall be furnished in soft form to BHEL.

Notes:

1. The above drawing list is tentative and shall be finalized with the successful bidder after placement of order. While some of the drawings indicated above may not be applicable, some additional drawings may also be required based on scope of work.
2. Drawings shall be prepared in Auto-Cad latest edition. Required no. of hard and soft copies (editable) of the drawings shall be furnished as per requirement specified elsewhere in the specification.
3. Only manual calculation with authentic supporting literature (e.g. extracts of hand Book/ standard/codes) shall be acceptable. All design calculations and drawings shall be in SI system only.
4. All the drawings and documents including general arrangement drawing, data sheet, calculation etc. to be furnished to the customer during detailed engineering stage shall include / indicate the following details for clarity w.r.t. Inspection, construction, erection and maintenance etc.:
 - a) All drawings and documents shall indicate the list of all reference drawings including General Arrangement.
 - b) All drawings shall include / show plan, elevation, side view, cross-section, skin section, blow-up view; all major self-manufactured and bought out items shall be labeled and included in BOQ / BOM in tabular form.
 - c) Painting schedule shall also be made as a part of general arrangement drawing of each equipment / item indicating at least 3 trade names.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
MASTER DRAWING LIST WITH SCHEDULE OF
SUBMISSION**

SPECIFICATION No: PE-TS-466-571-A102	
SECTION : I	
SUB-SECTION : D	
REV 00	ANNEXURE-V
SHEET 3 OF 5	

- d) All the drawings required to be furnished to customer during detailed engineering stage shall include technical parameters, details of paints and lubrication, hardness and BOQ / BOM in tabular form indicating all major components including bought out items and their quantity, material of construction indicating its applicable code / standard, weight, make etc.
- e) Drawings/ documents to be submitted for purchaser's review/ approval shall be under Revision A, B, C... etc. while drawings /documents to be submitted thereafter for customer's approval after purchaser's approval shall be under R-0, 1, 2, 3 etc.
- f) Drawings and documents not covered above but required to check safety of machines/ system, shall be submitted during detailed engineering stage without any commercial implication.
- g) All drawings shall include "B.O.M" and indicate quantity, material of construction, make along with IS/BS No., Technical parameters, dimensions, hardness, machining symbol and tolerance, requirement of radiography and hydraulic tests, painting details, elevation, side view, plan, skin section and blow-up view for clarity.
- h) All drawings shall be prepared as per BHEL's title block and shall bear BHEL's drawing No. Documents marked for submission to BHEL's Customer shall also bear BHEL's Customer's drawing No.
- i) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's/ Customer's/ Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- j) Bidder to follow the following the drawing submission schedule:
- k) 1st submission of drawings from date of LOI as per the submission schedule.
- l) Every revised submission incorporating comments – within 7 days.
- m) Bidder to submit revised drawings complete in all respects incorporating all comments. Any incomplete drawing submitted shall be treated as non-submission with delays attributable to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall depute his personal to BHEL for across the table discussions/ finalizations/ submissions of drawings.

Sl.No.	Document required after award of contract	No. of hard copies after award of contract	Submission time*
1. #	Sub-Vendor list and Categorization of Lime Feeding/ Dosing System (LDS)	6	3
2. #	Equipment GA of Lime Feeding/ Dosing System (LDS)	6	3
3. #	Equipment Tech. Datasheet of Lime Feeding/ Dosing System (LDS)	6	3
4. #	Layout of Lime Feeding/ Dosing System (LDS)	6	3
5.	O&M of Lime Feeding/ Dosing System (LDS)	6	12



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
MASTER DRAWING LIST WITH SCHEDULE OF
SUBMISSION**

SPECIFICATION No: PE-TS-466-571-A102
SECTION : I
SUB-SECTION : D
REV 00 ANNEXURE-V
SHEET 4 OF 5

6.	Instrument Schedule & Valve Schedule	6	8
7.	CONTROL & OPERATIONAL WRITE-UP FOR THE SYSTEM WITH SET POINTS for LDS	6	8
8.	Electrical Load List	6	8
9.	Drawing for complete Piping Arrangement including Supports (Water, Slurry, Instrument Air) for LDS	6	10
10.	Hook-up Drawing for Instruments of LDS	6	10
11.	I/O List (Drives & Instruments) of LDS	6	10
12.	Painting Specification for LDS	6	6
13.	Cable Schedule & Cable Duct/Tray Routing Plan of LDS	6	8
14.	GA & Data Sheet of Motors for LDS	6	10
15.	GA & Data Sheet of Instruments of LDS	6	10
16.	GA & Data Sheet of Valves of LDS	6	10
17.	BOQ/BOM of LDS for Main Supply & Mandatory Spares	6	12
18.	Erection & Commissioning Manual of LDS	6	12
19.	Performance Test Procedure of LDS	6	12

Indicates Primary drawings.

***Within No. of Weeks after the placement of LOI/PO**

R-0 within 21 days from PO & subsequent revisions within 7 days of comments received from BHEL.

Notes:

1. The above drawing list is tentative and shall be finalized with the successful bidder after placement of order. While some of the drawings indicated above may not be applicable, some additional drawings may also be required based on scope of work.
2. Drawings shall be prepared in Auto-Cad latest edition. Required no. of hard and soft copies (editable) of the drawings shall be furnished as per requirement specified elsewhere in the specification.

	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION	SPECIFICATION No: PE-TS-466-571-A102	
		SECTION : I	
		SUB-SECTION : D	
		REV 00	ANNEXURE-V
		SHEET 5 OF 5	

3. Only manual calculation with authentic supporting literature (e.g. extracts of hand Book/ standard/codes) shall be acceptable. All design calculations and drawings shall be in SI system only.

4. All the drawings and documents including general arrangement drawing, data sheet, calculation etc. to be furnished to the customer during detailed engineering stage shall include / indicate the following details for clarity w.r.t. Inspection, construction, erection and maintenance etc.:

- n) All drawings and documents shall indicate the list of all reference drawings including General Arrangement.
- o) All drawings shall include / show plan, elevation, side view, cross-section, skin section, blow-up view; all major self-manufactured and bought out items shall be labeled and included in BOQ / BOM in tabular form.
- p) Painting schedule shall also be made as a part of general arrangement drawing of each equipment / item indicating at least 3 trade names.
- q) All the drawings required to be furnished to customer during detailed engineering stage shall include technical parameters, details of paints and lubrication, hardness and BOQ / BOM in tabular form indicating all major components including bought out items and their quantity, material of construction indicating its applicable code / standard, weight, make etc.
- r) Drawings/ documents to be submitted for purchaser's review/ approval shall be under Revision A, B, C... etc. while drawings /documents to be submitted thereafter for customer's approval after purchaser's approval shall be under R-0, 1, 2, 3 etc.
- s) Drawings and documents not covered above but required to check safety of machines/ system, shall be submitted during detailed engineering stage without any commercial implication.
- t) All drawings shall include "B.O.M" and indicate quantity, material of construction, make along with IS/BS No., Technical parameters, dimensions, hardness, machining symbol and tolerance, requirement of radiography and hydraulic tests, painting details, elevation, side view, plan, skin section and blow-up view for clarity.
- u) All drawings shall be prepared as per BHEL's title block and shall bear BHEL's drawing No. Documents marked for submission to BHEL's Customer shall also bear BHEL's Customer's drawing No.
- v) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's/ Customer's/ Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- w) Bidder to follow the following the drawing submission schedule:
 - (i) 1st submission of drawings from date of LOI as per the submission schedule.
 - (ii) Every revised submission incorporating comments – within 7 days.

(iii) Bidder to submit revised drawings complete in all respects incorporating all comments. Any incomplete drawing submitted shall be treated as non-submission with delays attributable to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall depute his personal to BHEL for across the table discussions/ finalizations/ submissions of drawings.



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
PACKING PROCEDURE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00 ANNEXURE-VI

SHEET 1 OF 2

**ANNEXURE-VI
PACKING PROCEDURE**

1.0	PACKING AND FORWARDING
1.	Lime Dosing/Feeding System & sub system assembly shall be wrapped in polythene bags & packed in a strong rigid wooden crate. Rain water should not enter into the equipment packings during storage in the outer yard of power plant. Proper packing to be ensured.
2.	Equipment and process materials shall be packed and semi-knocked down, to the extent possible, to facilitate handling and storage and to protect bearings and other machine surfaces from oxidation. Each container, box, crate or bundle shall be reinforced with steel strapping in such a manner that breaking of one strap will not cause complete failure of packaging. The packing shall be of best standard to withstand rough handling and to provide suitable protection from tropical weather while in transit and while awaiting erection at the site.
3.	Equipment and materials in wooden cases or crates shall be properly cushioned to withstand the abuse of handling, transportation and storage. Packing shall include preservatives suitable to tropical conditions. All machine surfaces and bearings shall be coated with oxidation preventive compounds. All parts subject to damage when in contact with water shall be coated with suitable grease and wrapped in heavy asphalt or tar impregnated paper.
4.	The entire system has to be supplied in containers and it should be suitable for storing in the outer yard of the plant for a minimum period of 12 months. Crates and packing material used for shipping will become the property of owner (NTPC).
5.	Packaging or shipping units shall be designed within the limitations of the unloading facilities of the receiving ports and the ship will be used. It shall be the bidder's responsibility to investigate these limitations and to provide suitable packaging and shipping to permit transportation to site.
6.	Packing (tare) shall be part of the equipment cost and shall not be subject to return. The packing should ensure integrity and cohesiveness of each delivery batch of equipment during transportation. In case of equipment assemblies and unit's delivery in the packing of glass, plastics or paper the specification of packing with the material and weight characteristics are to be indicated.
7.	Each package should have the following inscriptions and signs stenciled with an indelible ink legibly and clearly: a. Destination b. Package Number c. Gross and Net Weight d. Dimensions e. Lifting places f. Handling marks and the following delivery marking
8.	Each package or shipping units shall be clearly marked or stenciled on at least two sides with the DETAILED SHIPPING ADDRESS –TO BE PROVIDED LATER. In addition, each package or shipping unit shall have the symbol painted in red on at least two sides of the package, covering one fourth of the area of the side.
9.	Each part of the equipment which is to be shipped as a separate piece or smaller parts packed within the same case shall be legibly marked to show the unit of which it is part, and match marked to show its relative position in the unit, to facilitate assembly in the field. Unit marks and match marks shall be made with steel stamps and with paint.
10.	Each case shall contain a packing list showing the detailed contents of the package. When any technical documents are supplied together with the shipment of materials no single package shall

		3X200+3X500+1x500 MW NTPC KORBA TPP-FGD LIME FEEDING / DOSING SYSTEM TECHNICAL SPECIFICATION PACKING PROCEDURE		SPECIFICATION No: PE-TS-466-571-A102	
				SECTION : I	
				SUB-SECTION : D	
				REV 00	ANNEXURE-VI
				SHEET 2 OF 2	
	contain more than one set of such documents. Shipping papers shall clearly indicate in which packages the technical documents are contained.				
11.	The case number shall be written in the form of a fraction, the numerator of which is the serial number of the case and the denominator the total number of cases in which a complete unit of equipment is packed.				
12.	Wherever necessary besides usual inscriptions the cases shall bear special indication such as “Top”, “Do not turn over”, “Care”, “Keep Dry” etc. as well as indication of the center of gravity (with red vertical lines) and places for attaching slings (with chain marks).				
13.	Marking for Safe handling: To ensure safe handling, packing case shall be marked to show the following: a. Upright position b. Sling position and center of Gravity position c. Storage category d. Fragile components (to be marked properly with a clear warning for safe handling)				
14.	Each crate or package is to contain a packing list in a waterproof envelope. All items are to be clearly marked for easy identification against the packing List. All cases, packages etc. are to be clearly marked on the outside to indicate the total weight where the weight is bearing and the correct position of the slings are to bear an identification mark relating them to the appropriate shipping documents. All stencil marks on the outside of cases are either to be made in waterproof material or protected by shellac or varnish to prevent obliteration in transit.				
15.	The packing slip shall contain the following information: - Customer name, Name of the equipment, Purchase Order number with Date, Address of the delivery site, Name and Address of the Sender, Serial Number of pump & accessories, BHEL item Code, Gross Weight and Net weight of Supplied items.				
16.	Prior to transport from manufacturer’s work to destination, components of the unit shall be completely cleaned to remove any foreign particles. Flange faces and other machined surfaces shall be protected by an easily removable rust preventive coating followed by suitable wrapping.				
17.	All necessary painting, corrosion protection & preservation measures shall be taken as specified in painting schedule. Supplier shall consider the coastal environment zone which is defined as “very severe” during final finishing/shipping.				
18.	Successful bidder shall furnish the detail packing /shipment box details with information like packing box size, type of packing, weight of each consignment, sequence no. of dispatch, no. of consignment for each deliverable item against each billing break up units/ billable blocks. Without these details the BBU shall not be approved during detail engineering. Also, complete billing break-up with above mentioned details shall be submitted to Purchaser within 10 days of placement of the LOI.				
19.	All items/equipment shall be dispatched in properly packed condition (i.e. no item shall be dispatched in loose condition such that it becomes difficult to store/identify its location at site at a later stage).				
20.	Cases which cannot be marked as above shall have metal tags with the necessary markings on them. The metal tags shall be securely attached to the packages with strong steel binding wire. Each piece, Skid, Case or package shipped separately shall be labelled or tagged properly.				
BIDDER TO REFER SUB-SECTION C2-A FOR CUSTOMER SPECIFICATION IN THIS REGARD.					

SPECIFICATION No: PE-TS-466-571-A102

SECTION : I

SUB-SECTION : D

REV 00

Annexure VII - Pipe & Valve Material Specification (6 Pages)

Page 1 of 6

1. General

This specification covers the basic requirements for the design and materials of process and utility piping for the Flue Gas Desulfurization Plant.

2. Material Selection

- 1) Basically, rubber lined pipes are selected to prevent the corrosion and erosion for process service, namely slurry line and other line possible to contact with raw gas.
- 2) Class AA60 is applied according to process line conditions.
- 3) For utility services, other classes are applied.
- 4) In principle, piping material will conform to ASTM, but ASTM equivalent material specified by other authorized code may be applied.
- 5) Non-asbestos type shall be used for Packing and Gasket.

3. Design of Piping Component

- 1) In principle, each component of all piping will be selected from ANSI ASME or international standard in the dimensions and other requirements.
- 2) Metric series are applied to the bolt thread.
- 3) Nozzle weld tees or extruded tees are used as branch connection in lined piping, in general.
- 4) Short radius elbow may be used for 550mm or larger size piping.
- 5) Fittings for 50 and smaller galvanized piping shall be of screwed type.

4. Piping Material

1) Symbols of Piping Service Class

Piping service class name is composed of the following symbols.

Example: A A 60

Suffix Number

Second Pipe Material Symbol

First Pipe Material Symbol

Note:

First Pipe Material Symbol	
A: Lining	AA: Rubber Lining
B : Stainless Steel	BA: 304 Stainless steel
C: Carbon Steel	CA: A53 Gr.B Welded
	CC: A53 Gr.B or A106 Gr.B/C
	CG: Galvanized

2) Class No. and Fluid Designation

CLASS NO.	FLUID NAME	SYMBOL	
AA60	Gypsum Slurry	GS	
	Filtrate Slurry	FS	
	Waste Water	WW	
	Duct Drain	DD	
	Beltfilter Vent Gas	VBG	
BA01	Instrument Air	AI	
	Lube Oil (Low Pressure)	LOL	
CC01	Process Water	WP	Note 1
	Raw Water	WR	
	Cooling Water Supply	WCS	
	Cooling Water Return	WCR	
	Vacuum Pump Vent	VG	
	Antifoam Agent	AA	

Note I

Class AA60 shall be applied for process water service line in contact with corrosive and abrasive media.

3) Abbreviations

Abbreviations used throughout this specification are as follows:

BB	:	Bolted Bonnet
BC	:	Bolted Cover
BE	:	Bevel End
BW	:	Butt Weld
CAL	:	Calculation
CR	:	Chloroprene Rubber
E	:	Electric Resistance Weld
EPDM	:	Ethylene Propylene Diene Methylene Rubber
Eq	:	Equal
FE	:	Flange End
FF	:	Flat Face
G. OP	:	Gear Operation
Gal.	:	Galvanized
HEX.	:	Hexagon
IIR	:	Isobutylene Isoprene Rubber

ISRS	:	Inside Screw Rising Stem
La	:	Larger
L.OP	:	Lever Operation
NB	:	Nominal Bore
NW	:	Nozzle Weld
OS&Y	:	Outside Screw & York
PE	:	Plane End
PP	:	Poly Propylene
PTFE	:	Poly Tetra Fluoro Ethylene
RF	:	Raised Face
R/L	:	Rubber lined or rubber seated
S	:	Seamless
SB	:	Screw Bonnet
SC	:	Screw Cover
SCH	:	Schedule No.
SCR'D	:	Screwed
Sm	:	Smaller
SO	:	Slip On
St.	:	Stelliting
SW	:	Socket Weld
W	:	Weld
WN	:	Welding Neck
W/LINING	:	With Lining
V#	:	Valve No.
13 CR	:	13% CHROMIUM

CLASS	Max. Press. (MPaG)	1.1		C. A. mm	CLASS
AA60 (1/1)	Max. Temp. (degC)	65			AA60 (1/1)
FLUID	GYPSUM SLURRY				
ITEM	Size	Thickness	Specification		ITEM No.
PIPING	DN25 – DN50	SCH40	A53-B SML PE (I:R/L) ASME		
	DN65 – DN150	SCH40	A53-B E. R. W BE (I:R/L) ASME		
	DN200 – DN300	SCH20	A53-B E. R. W BE (I:R/L) ASME		
	DN350 – DN400	SCH10	A53-B E. R. W BE (I:R/L) ASME		
	DN450 – DN500	SCH10	A53-B E. R. W BE (I:R/L) ASME		
	DN550 – DN1000	7.9T	A134 (A283-C) EFW BE (I:R/L) ASME		
	DN1100– DN1200	9.5T	A134 (A283-C) EFW BE (I:R/L) ASME		
FITTING	DN25 – DN50	Suit to PIPE	BW A234-WPB (I:R/L) ASME-B16.9		
	DN65 – DN150	Suit to PIPE	BW A234-WPBW (I:R/L) ASME-B16.9		
	DN200 – DN300	Suit to PIPE	BW A234-WPBW (I:R/L) ASME-B16.9		
	DN350 – DN500	Suit to PIPE	BW A234-WPBW (I:R/L) ASME-B16.9		
	DN550 – DN1000	Suit to PIPE	BW A134 (A283-C) EFW (I:R/L) ASME-B16.9		
	DN1100– DN1200	Suit to PIPE	BW A134 (A283-C) EFW (I:R/L) ASME-B16.9		
SMOOTH BEND	DN25 – DN80	Suit to PIPE	BW A53-B (I:R/L)		
FLANGE	DN25 – DN600		SO A105 ASME150 SO FF (I:R/L) ASME-B16.5		
	DN650 – DN1800		SO A105 AWWA CL.B SO FF (I:R/L) AWWA-C207		
PINCH VALVE	DN25 – DN150		PN 16 A126-B TRIM-13CR SLEEVE-CR LINING-IIR FF HAND WHEEL		
GASKET	DN25 – DN600		V-2000 RUBBER RUBBER OR EQ. ASME150 2.0T FLAT RING		
	DN650 – DN1800		V-2000 RUBBER RUBBER OR EQ. AWWA CL.B 2.0T FLAT RING		
BOLT & NUT	ALL SIZE		STUD U HEAVY NUT A307-GR.B/A563-GR.A FINISHED		
Note: I: R/L - Replaceable Wear Resistant Natural Rubber Lining of minimum 6mm thickness. Additional thickness of 2 mm rubber lining shall be provided in bends.					

CLASS	Max. Press. (MPaG)	1		C. A. mm
BA01 (1/1)	Max. Temp. (degC)	45		
FLUID	INSTRUMENT AIR, LUBE OIL			
ITEM	Size	Thicknes s	Specification	
PIPING	DN6- DN50	SCH40S	A312-TP304 SML PE ASME	
	DN65-DN250	SCH20S	A312-TP304 E. R. W BE ASME	
FITTING	DN6 - DN50	Suit to PIPE	3000LB SW A182-F304 ASME-B16.11	
	DN65 - DN250		BW A403-WP304 ASME-B16.9	
FLANGE	DN6 - DN50	Suit to PIPE	SW GR. 304 GR. 304 ASME150 SW RF ASME-B16.5	
	DN65 - DN250		LOOSE A105 ASME150 LOOSE ASME-B16.5	
GATE VALVE	DN6 - DN50		API-602 PN 16 A182-F304 AISI304 SW BB, OS&Y HAND WHEEL	
	DN65 - DN250		ASME-B16.34 PN 16 A351-CF8 AISI304 RF BB, OS&Y HAND WHEEL	
GASKET	DN6 - DN150		V-6500 NON-ASBESTOS OR EQ. ASME150 1.5T FLAT RING	
	DN200- DN250		V-6500 NON-ASBESTOS OR EQ. ASME150 3.0T FLAT RING	
BOLT & NUT	ALL SIZE		STUD U HEAVY NUT A307-GR. B/A563-GR. A FINISHED	

CLASS	Max. Press. (MPaG)	0.11	0.85		C. A. mm
CC01 (1/1)	Max. Temp. (degC)	155	45		
FLUID	WATER, VENT GAS				
ITEM	Size	Thickness	Specification		
PIPING	DN6 - DN50	SCH80	A53-B SML PE ASME		
	DN65 - DN150	SCH40	A53-B E. R. W BE ASME		
	DN200 - DN300	SCH20	A53-B E. R. W BE ASME		
FITTING	DN6 - DN50		3000LB SW A105 ASME-B16.11		
	DN65 - DN150	Suit to PIPE	BW A234-WPB ASME-B16.9		
	DN200 - DN300		BW A234-WPB ASME-B16.9		
FLANGE	DN6 - DN150	Suit to PIPE	SO A105 ASME150 SO RF ASME-B16.5		
	DN200 - DN300		SO A105 ASME150 SO RF ASME-B16.5		
GATE VALVE	DN6 - DN50		API-602 PN16 A105 13CR SEAT STL SW BB, OS&Y HAND WHEEL		
	DN65 - DN300		ASME-B16.34 PN16 A395 13CR RF BB, OS&Y HAND WHEEL		
GLOBE VALVE	DN6 - DN50		API-602 PN16 A105 13CR SEAT STL SW BB, OS&Y HAND WHEEL		
	DN65 - DN300		ASME-B16.34 PN16 A395 13CR RF BB, OS&Y HAND WHEEL		
CHECK VALVE	DN6 - DN50		API-602 PN16 A105 13CR SEAT STL SW BC, LIFT		
	DN65 - DN300		ASME-B16.34 PN16 A395 13CR RF BC, SWING		
BALL VALVE	DN6 - DN100		ASME-B16.34 PN16 A105 AISI304 RF BALL LEVER. FULL BORE		
BUTTERFLY VALVE	DN50 - DN150		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER LEVER.		
	DN50 - DN150		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER AIR CYLINDER W/L. SWITCH		
	DN50 - DN150		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER ELECTRIC MOTOR W/L. SWITCH		
	DN200 - DN300		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER WHEEL WITH GEAR		
	DN200 - DN300		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER AIR CYLINDER W/L. SWITCH		
	DN200 - DN300		ASME-B16.34 PN16 A216-WCB 13CR EPDM RF WAFER WAFER ELECTRIC MOTOR W/L. SWITCH		
GASKET	DN6 - DN150		V-6500 NON-ASBESTOS OR EQ. ASME150 1.5T FLAT RING		
	DN200 - DN300		V-6500 NON-ASBESTOS OR EQ. ASME150 3.0T FLAT RING		
BOLT & NUT	ALL SIZE		STUD U HEAVY NUT A307-GR. B/A563-GR. A FINISHED		



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION**

SPECIFICATION No: PE-TS-466-571-A002

SECTION: II

REV. 00

SECTION - II



**3X200+3X500+1X500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
LIST OF DOCUMENTS TO BE SUBMITTED WITH BID**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 1

REV: 00

SHEET 1 OF 1

ANNEXURE - 1

DOCUMENTS TO BE SUBMITTED WITH THE BID

Bidder should submit the filled up (wherever applicable), signed and stamped copy of the following documents along with the offer/ bid for technical evaluation:

Sr.	Reference	Description
1.	*Annexure-2	COMPLIANCE CUM CONFIRMATION CERTIFICATE
2.	*Annexure-3	PRE-BID CLARIFICATION SCHEDULE
3.	*Annexure-4	DEVIATION SHEET (COST OF WITHDRAWAL)
4.	*Annexure-5	SCHEDULE OF GUARANTEES
5.	*Annexure-6	LIST OF MAKES OF SUB VENDOR ITEMS
6.	*Annexure-7	LIST OF TOOLS & TACKLES
7.	*Annexure-8	EQUIPMENT DATA SHEET/ SCHEDULE (TO BE FILLED BY BIDDER)
8.	*Annexure-9	A) LIST OF COMMISSIONING SPARES B) LIST OF RECOMMENDED SPARES
9.	*	UNPRICED SCHEDULE IN THE PRICE FORMAT ISSUED ALONG WITH TENDER

***Bidder is required to submit signed & stamped copy all above annexures/documents along with bid.**



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
COMPLIANCE CUM CONFIRMATION CERTIFICATE

SPECIFICATION No: PE-TS-466-571-A102
SECTION : II
ANNEXURE : 2
REV. NO. 00
SHEET: 1 OF 2

ANNEXURE – 2

COMPLIANCE-CUM-CONFIRMATION CERTIFICATE

The bidder shall confirm compliance with following by signing / stamping this compliance certificate (every sheet) and furnish same with the offer.

- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions, other than those mentioned under “exclusion and those resolved as per ‘Schedule of Deviations’, with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the ‘Schedule of Deviations’. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the ‘Schedule of Deviations’.
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL / CUSTOMER approval & customer hold points for inspection / testing shall be marked in the QP at the contract stage. Inspection / testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc. This is within the contracted price without any extra implications to BHEL after award of the contract.
- d) All drawings/ data-sheets / calculations etc. submitted along with the offer, if not sought/required for bid evaluation shall not be taken cognizance off.
- e) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified / intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements, the same shall be resolved by the bidder during the pre-bid discussions, otherwise BHEL/Customer’s decision shall be binding on the bidder, whenever the deficiency is pointed out.

For components where materials are not specified, the same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- f) The commissioning spares shall be supplied on ‘As Required Basis’ & prices for same are deemed to be included in the base price.
- g) All sub-vendors shall be subject to BHEL / CUSTOMER approval in the event of order.
- h) Guarantee/Warranty for plant/equipment shall be as per relevant clause of GCC / SCC / other Commercial Terms & Conditions
- i) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break-up, approved drawing or approved Bill of quantities within the scope of work as tender specification.



3X200+3X500+1X500 MW NTPC KORBA TPP-FGD

LIME FEEDING / DOSING SYSTEM

TECHNICAL SPECIFICATION

COMPLIANCE CUM CONFIRMATION CERTIFICATE

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 2

REV. NO. 00

SHEET: 2 OF 2

- j) Schedule of drawings/documents/quality plans submission, comment incorporation & approval shall be as stipulated elsewhere in the specification. The successful bidder shall depute his design personnel to BHEL's / Customer's / Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- k) As-built drawings shall be submitted as and when required during the project execution.
- l) The bidder has not tampered with this compliance-cum-confirmation certificate and if at any stage any tampering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.
- m) Successful bidder shall furnish detailed erection/installation manual for each of the equipment supplied under this contract as per the schedule of submission of documents and well before the scheduled erection of the equipment / component concerned.
- n) Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations of completing the work as per specification requirement. Any deviation from specified requirement shall be reported by the vendor in writing and shall require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.
- o) In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor's account and shall not be used as a reason for extension in contract completion.

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal

963437/2022/PS-PEM-MAX



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD

LIME FEEDING / DOSING SYSTEM

TECHNICAL SPECIFICATION

PRE-BID CLARIFICATION SCHEDULE

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 3

REV. NO. 00

SHEET: 1 OF 1

ANNEXURE - 3**PRE-BID CLARIFICATION SCHEDULE**

S. NO.	SECTION/CLAUSE/PAGE NO.	STATEMENT OF THE REFERRED CLAUSE	CLARIFICATION REQUIRED

The bidder hereby clarifies that above mentioned are the only clarifications required on the technical specification for the subject package.

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
DEVIATION SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 4

REV: 00

SHEET 1 OF 1

ANNEXURE - 4

DEVIATION SHEET (COST OF WITHDRAWAL)

**(TO BE FILLED UP BY BIDDER IN THE FORMAT ATTACHED AS
ANNEXURE –II OF GENERAL CONDITIONS OF CONTRACT ISSUED
ALONG WITH TENDER. ANY DEVIATION QUOTED ELSEWHERE/ IN
OTHER FORMAT SHALL NOT BE CONSIDERED)**



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
SCHEDULE OF GUARANTEES**

SPECIFICATION No: PE-TS-466-571-A102	
SECTION : II	
ANNEXURE : 5	
REV: 00	
SHEET 1 OF 1	

ANNEXURE – 5

SCHEDULE OF GUARANTEES

1.0 PERFORMANCE GUARANTEE

- 1) All performance tests for LDS shall be carried out in accordance with the relevant latest international codes/standards.
- 2) Bidder shall furnish Performance guarantee for the design, manufacture, material, safe and trouble-free operation of the LDS and its accessories.
- 3) Vendor shall Guarantee and demonstrate Bucket Elevator design capacity (1 TPH). Further satisfactory operation of the downstream system of bucket elevator shall also be demonstrated by bidder in line with design capacities mentioned in the technical specifications.
- 4) Noise level ≤ 85 dB (A) at 1 m horizontal distance from equipment/enclosures & 1.5m above operating floor is to be guaranteed.
- 5) Vibration levels measured on the non-rotating parts shall not exceed the zone limit "B" as defined in ISO 10816 at steady conditions and shall not exceed the zone limit "C" as defined in ISO 10816 at transient conditions. Arrangement of calibrated equipment for measurement of vibration & noise levels shall be supplier's responsibility.
- 6) Acceptance tests to be carried out as per the procedure defined by the bidder which shall be submitted for BHEL/ Customer approval.
- 7) In the event that the performance test is unsuccessful, bidder shall take necessary remedial action at his cost and the performance test shall be repeated.

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
SUB-VENDOR LIST**

SPECIFICATION NO. PE-TS-466-571-A102

SECTION : II

ANNEXURE : 6

REV 00

SHEET 1 OF 1

ANNEXURE – 6

LIST OF MAKES OF ITEMS

Sr. No.	ITEM NAME	MANUFACTURER	LOCATION

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
LIST OF SPECIAL TOOLS & TACKLES

SPECIFICATION No: PE-TS-466-571-A002

SECTION : II

ANNEXURE : 7

REV 00

SHEET 1 OF 1

ANNEXURE – 7

LIST OF SPECIAL TOOLS & TACKLES

Sr. No.	ITEMS	QUANTITY

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 1 OF 7

ANNEXURE – 8
EQUIPMENT DATA SHEET/SCHEDULE

S.N	DESCRIPTION	DATA
I	GENERAL	
1.	Client	BHEL-PEM, Noida
2.	Project	3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
3.	End Customer	NTPC
4.	Location	District-Korba, Chhattisgarh
5.	Service	Continuous
6.	Installation	Inside the Building
7.	Quantity for all 3 FGD units	2 sets (1W+1S) Lime Feeding/Dosing system (1 no. twin feed Bucket Elevator with motorized Diverter Flap Gate)
II	MANUFACTURER DETAILS	
1.	a. Model	Bidder to Provide
2.	b. Type	Bidder to Provide
III	OPERATING CONDITION	
	Medium to be handled	Bulk Lime / Lime slurry
IV	TECHNICAL DATA	
A	BUCKET ELEVATOR	
1.	Qty.	1 No.
2.	Type	Continuous discharge type
3.	Material to be handled	Lime powder
4.	Bulk density	450 kg/m ³ (volumetric) 640 kg/m ³ (load/structural)
5.	Capacity Rated / Design (TPH)	0.5 / 1.0
6.	Speed (m/sec)	Bidder to specify
7.	Lift height (m)	To suit layout/ 12-14 approx. (Bottom to Top of Lime Silo- As per enclosed drg). Bidder to accommodate ± 5 % variation in lift height without any price implication.
8.	Bucket type	Bidder to specify



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 2 OF 7

9.	Bucket size	Bidder to specify
10.	Bucket thickness / MOC	4 mm thk./ SS 304
11.	Belt Specifications	Bidder to specify
12.	Casing material of construction	MS, 6 mm thick. Top/ bottom casing, 4mm thk. Middle and hood casing
13.	Pulley type	Bidder to specify
14.	Head /Boot Pulley dia.	Bidder to specify
15.	Bearing type	Spherical roller bearing of suitable size
16.	Take up type	Bidder to specify
17.	Motor type	As per Motor Specification
18.	Motor KW	Bidder to specify
19.	Gear box	Bidder to specify
20.	Gear box ratio	Bidder to specify
21.	High Speed coupling	Bidder to specify
22.	Low Speed coupling	Bidder to specify
23.	Hold back	Bidder to specify
24.	Drive base frame	Bidder to specify
25.	Zero Speed Switch	Required.
B	2-Way Diverter Flap Gate for Bucket Elevator	
1.	Qty.	1 Nos.
2.	Inlet Flange Size	Bidder to specify
3.	Outlet Flange Size	Bidder to specify
4.	Angle of each Discharge Flange	15 ° / to suit
5.	Motor rating of actuator (W/V/F)	Bidder to specify
6.	MOC of Diverter Flap Gate	Bidder to specify
7.	Weight of Diverter Flap Gate	Bidder to specify
C	LIME SILO	
1.	Qty.	2 Nos. (1W+1S)
2.	Service/Application	Lime powder handling
3.	Location	Indoor (Gypsum Dewatering Building)
4.	Operating Pressure	Atmospheric



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 3 OF 7

6.	Design Temperature	60 °C
7.	Design Code	IS 9178
9.	Silo Capacity	2.5 m ³ each/ To suit system requirement
10.	Silo Cylinder Diameter	1. 5 m
11.	Silo Cylinder Height	2.3 – 2.4 m
12.	Total Silo Height	4.3 - 4.4 m
13.	Silo Bottom Cone Angle	70 °
14.	Material for Shell & Bottom Cone	IS 2062: 2011 E250 Quality BR
15.	Thickness of shell	10 mm (Min.) + 3 mm (min. corrosion allowance)
16.	Material of Silo cone internal lining (conical portion)	SS304
17.	Thickness Of SS lining	4 mm
18.	Outlet of Cone Silo	To suit Screw conveyor
10.	Moisture contain in Lime powder	8%
11.	Lime Powder Particle size	During detailed engineering
12.	Bulk density of material	450 kg/m ³ (volumetric) 640 kg/m ³ (load/structural)
13.	Design Temperature	45°C / Ambient
D	CHUTES AND HOPPERS	
1.	Minimum Valley Angle	Bidder to Provide
2.	Material :	Bidder to Provide
	i) Chute work	Bidder to Provide
	ii) Sliding zones & adjacent sides	Bidder to Provide
	iii) No striking/ Non-sliding zones	Bidder to Provide
	iv) Chute with valley angle 80 degree	Bidder to Provide
	v) In the zone of magnetic field	Bidder to Provide
	vi) In the zone of flap gates	Bidder to Provide
	vii) Discharge Hoods overhead pulleys	Bidder to Provide
3.	Inspection Doors	Bidder to Provide
4.	Chute Construction	Bidder to Provide
	i) Corners	Bidder to Provide
	ii) Joints Bolted	Bidder to Provide
	iii) Bolt size	Bidder to Provide
	iv) Bolts spacing	Bidder to Provide
E	a) SCREW CONVEYOR (DUTY PARAMETERS)	



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 4 OF 7

1.	Orientation of screw Axis	Horizontal
2.	Length of Screw Conveyor from Feed to Discharge end	3- 3.5 m (approx.)/ To suit layout requirement
3.	Quantity of Lime to be handled (Rated/ Design) TPH	To suit Process requirement / 60 kg/hr
4.	Material to be handled	Hydrated Pulverized Lime
5.	Impurities	Traces of chloride
6.	Type of Inlet feed	Vertical
7.	Abrasiveness type	abrasive
8.	Shape of dust	Spherical.
9.	Hardness	Bond index = 3
10.	Moisture contain	8%
11.	Particle size	200 mesh
12.	Bulk density of material	550 kg/m ³
13.	Design Temperature	45°C
14.	Type of operation	Batch/ continuous
15.	Place of application	Gypsum Dewatering Building
16.	Type of Screw	Continuous helical spirally welded on central pipe.
17.	Type of Trough	"U" Trough
18.	Length of the screw flight and outlet spout size	Vendor to confirm
19.	Saddle supports for Trough	To be provided throughout the length of Trough.
20.	Hanger bearing	Not to be used.
21.	Diameter of the Screw and Pitch of the flight	Vendor to confirm
22.	Trough Ends	Trough end to be provided at both drive and tail ends to support the central screw, and bearings with Plummer block (anti friction type) and to hold the sealing arrangement to avoid air ingress.
23.	Seal type	Split gland type to be provided
24.	Moisture content	8% (approx)
25.	Ambient Temperature	As per details in Project Information
26.	Angle of repose for the dust	70 degree
27.	Type of operation	Batch Operation



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 5 OF 7

28.	Measure for prevention of explosion	Not required
29.	Whether Hygroscopic	Yes
30.	Whether corrosive	Yes
E	b) SCREW CONVEYOR (MOC)	
1.	Trough	3.15mm. thick min. SS304 (suitable MS supports to be provided)
2.	End plate	SS304, thickness not less than 8mm
3.	Screw flight	SS304, 3.15 thick minimum.
4.	Central pipe (Holding the screw)	SS304, 3.15 thick minimum.
5.	End shaft	EN24 shrink fitted with central pipe and welded.
6.	Type of bearings	Spherical Roller Bearings
7.	Drive and tail end bearings	Anti-friction bearings with plumper block. Vendor to specify.
8.	Make of bearings	SAF/FAG/NTN / SIBCO / Equivalent
9.	Drive, Driven & Tightened Sprocket	EN24 (Forged with hardness 450 –500 BHN)
10.	Top cover with inspection door (for extension outside portion Flanged Type)	SS304
11.	Gasket	EPDM Rubber (5Thk)/ equivalent
12.	Connecting Chute	SS304
13.	Chain and sprocket should be of reputed make. Chain – EN24 Forged Hardness 350-400 BHN Sprocket – EN24 Forged Hardness 450-500 BHN	
F	DETAILS OF DRIVE & DRIVE MOTOR (SCREW CONVEYOR)	
1.	Type of drive	Geared motor directly coupled to screw end or connected by chain and sprocket with suitable chain adjuster.
2.	Type of gear box	Helical gear box (The gear motor assembly shall be of integral with flange mounted motor)
3.	Whether zero speed switch/monitor Required.	No.
4.	Support for Drive system	To be provided.
5.	Safety Guards	To be provided



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 6 OF 7

6.	Drive Rating	To be indicated by the vendor. Necessary backup calculation substantiating the same to be furnished along with the offer
G	NEUTRALISATION TANK	
1.	Qty.	2 Nos. (1W+1S)
2.	Service/Application	Lime Neutralisation Tank
3.	Location	Indoor
4.	Operating Pressure	Atmospheric
5.	Design Pressure	Design Liquid Level
6.	Design Temperature	60 °C
7.	Design Code	IS:803
8.	Hydro Test	Full of Water
9.	Tank Capacity Normal/Maximum	3.8 m ³ / 4.7 m ³ each To suit system requirement
10.	Tank Diameter	2.0 m
11.	Tank Height	2.0 m / To suit
12.	Tank Top Style	Flat
13.	Tank Bottom Style	Flat
14.	Material for Shell, top & Bottom	IS 2062: 2011 E250 Quality BR
15.	Thickness of shell	As calculated from IS:803 + 3 mm (min. corrosion allowance)
16.	Material of Tank internal lining	Chlorobutyl/Bromobutyl Rubber
17.	Thickness Of lining	5 mm
18.	Nozzle Schedule & Orientation	1 no. Inlet for service water, 1 no. outlet for Waste water tank & other nozzles as required in GA drg.
H	AGITATOR	
1.	Qty.	2 Nos. (1 no per neutralization tank)
2.	Type	Top entry
3.	Location	Indoor (over Neutralisation Tank)
3.	MOC	Impeller & Shaft - Alloy 926
4.	Impeller Tip Speed	Must not exceed 12m/s
6.	Reduction Gear	To be provided as per applicability
I	LIME SLURRY PUMPS	
1.	Qty.	2 Nos. (1W+1S) common for complete LDS
2.	Type	Radial Split, Centrifugal, Continuous Duty
3.	Location	Indoor
4.	Rated Capacity Flow (m3/hr)	0.5-0.6 / to suit
5.	Rated Capacity Head (mWCI)	15 / to suit



**3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
EQUIPMENT DATA SHEET/SCHEDULE**

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 8

REV 00

SHEET 7 OF 7

6.	Rated Capacity Power (KW)	Bidder to Provide
7.	Power consumption (KW)	Bidder to Provide
8.	Pump Speed (rpm)	Bidder to Provide
9.	Motor Rating (KW)	Bidder to Provide
10.	Motor Speed (rpm)	Bidder to Provide
11.	Margins (Flow/Head) (%/%)	Bidder to Provide
12.	Operation Pressure	Bidder to Provide
13.	Design Pressure	Bidder to Provide
14.	Material of Base plate	Bidder to Provide
15.	Material of Casing	Bidder to Provide
16.	Material of Shaft	Bidder to Provide
17.	Material of Impeller	Bidder to Provide
18.	No. of Bearings	Bidder to Provide
19.	Type Of Bearings	Heavy duty ball bearings
20.	Type of coupling	Bidder to Provide
J	SLURRY PIPES	
1.	Pipe size (mm)	Bidder to Provide
2.	Type of Joints	Bidder to Provide
	Pipe to Pipe/Pipe to Fittings	Bidder to Provide
	Fittings	Bidder to Provide
3.	Material / Thickness (mm) of Pipe	MSRL/ for pipes size lower than 3-inch abrasive resistant FRP material (silicon carbide coating on slurry exposed surface)
4.	Material Thickness of lining	Bidder to Provide
5.	Estimated Life of liners (hrs.)	Bidder to Provide
6.	Slurry Solid concentration (w/w %)	Bidder to Provide
7.	Slurry Settling Velocity (m/s)	Bidder to Provide
8.	Pipe Velocity (m/s)	Bidder to Provide
K	SUPPORTING STEEL STRUCTURE, PLATFORMS, RAILINGS, LADDERS	
1.	Qty.	As per system requirements requirements described in tech. spec. (for 2 no Lime Feeding/Dosing System)

Signature: _____ Name: _____ Designation: _____

Company: _____ Company Seal _____ Date: _____



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
 LIME FEEDING / DOSING SYSTEM
 TECHNICAL SPECIFICATION
 LIST OF COMMISSIONING SPARES

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 9

REV 00

SHEET 1 OF 2

ANNEXURE – 9**A) LIST OF COMMISSIONING SPARES**

SR. NO.	ITEMS	QUANTITY

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal



3X200+3X500+1x500 MW NTPC KORBA TPP-FGD
LIME FEEDING / DOSING SYSTEM
TECHNICAL SPECIFICATION
LIST OF COMMISSIONING SPARES

SPECIFICATION No: PE-TS-466-571-A102

SECTION : II

ANNEXURE : 9

REV 00

SHEET 2 OF 2

ANNEXURE – 9**B) LIST OF RECOMMENDED SPARES**

SR. NO.	ITEMS	QUANTITY

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal