BHARAT HEAVY ELECTRICALS LTD. (TRANSMISSION BUSINESS GROUP)

NOTICE INVITING TENDER

Subject:	Tender for supply and supervision of testing of Current Transformers for PGCIL HVDC-Nagpur projects
Project:	Package-I for +/-800kV, 6000MW HVDC Terminal at Khavda pooling station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS substation at KPS2 associated with "Transmission system for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V Part-A (8 GW)"
Customer	Powergrid Corporation of India Limited

BHARAT HEAVY ELECTRICALS LTD. (TRANSMISSION BUSINESS GROUP)

SPECIAL TERMS AND CONDITIONS FOR TENDER ENQUIRY / CONTRACT

IN CASE ANY DISCREPANCY BETWEEN THE REQUIREMENTS MENTIONED UNDER SPECIAL TERMS & CONDITIONS AND GENERAL TERMS & CONDITIONS, SPECIAL TERMS AND CONDITIONS SHALL PREVAIL.

THIS IS TO BE SUBMITTED DULY SIGNED AND STAMPED BY BIDDER. CLAUSE-WISE DEVIATIONS AND / OR ADDITIONAL CONDITIONS / CLARIFICATIONS, IF ANY, ARE TO BE BROUGHT OUT CLEARLY IN "SCHEDULE OF COMMERCIAL DEVIATION". DEVIATIONS AND / OR ADDITIONAL CONDITIONS / CLARIFICATIONS, IF ANY, MENTIONED ELSEWHERE IN THE BID / OFFER, SHALL NOT BE CONSIDERED.

SL. NO.	TERMS AND CONDITIONS		
1.	INSTRUCTION TO BIDDERS		
	1.1 Sealed bids are invited for the items mentioned in the tender enquiry confort to the NIT including Technical Specifications. Bids should be typed and free overwriting and erasures. Corrections or additions / deletions, if any, more clearly written and attested, otherwise offer may be rejected.		
bid through e-Procurement platform only at (https://eprocurebhel.co.in/ Bidders participating through e-procurement portal for this tender sho Class-III Digital Signature Certificate (DSC) for Signing & Encryption of bid		Tender is invited through e-Procurement System only. The bidder shall submit their bid through e-Procurement platform only at (https://eprocurebhel.co.in/). Bidders participating through e-procurement portal for this tender should have Class-III Digital Signature Certificate (DSC) for Signing & Encryption of bids issued by any of the valid Certifying Authorities (approved by Controller of Certifying Authorities) in India.	
	1.3 Offer Submission Date & Time: 19.09.2025, 11:00 Hrs IST, Offer Opening Date & Time: 19.09.2025, 16:00 Hrs IST The critical Dates of tendering activities shall be provided separately tendering processes.		
		Address of tender Issuing Authority: - BHARAT HEAVY ELECTRICALS LIMITED, Transmission Business Group, 5th Floor, BHEL Sadan, Plot No. 25, Sector-16A, Noida – 201301 (U.P.)	
	1.4	For any technical clarification, kindly contact: Ms. Muneet Mehta, Sr. DGM (TBEM) Phone: +91 (0) 0120- 2218816, E-mail: muneet@bhel.in	

	1.5 For any commercial clarification, kindly contact: Mr. Deep Shekhar Dewangan, Manager (TBMM); Phone: +91 (0) 0120- 2218832, E-mail: dsdewangan@bhel.in
2.	PACKAGE
	Single package for 765kV Current Transformers
	Evaluation shall be done as per clause no. 18 of STC.
3.	TECHNICAL SPECIFICATION
	Technical specification no. TB-437-510-017, R-00 is applicable.
4.	PRE QUALIFYING CRITERIA FOR OPEN TENDER
	i) The Technical Pre-Qualification criteria is as per ANNEXURE-I (A) ii) The Financial Parameters for Pre-QUALIFYING CRITERIA shall be as per ANNEXURE-I (B)
	Note: (1). Bidder must submit all supporting documents along with their offer. No deviation against this enquiry is acceptable, else offer shall be rejected.
	(2). All documents (including third party documents/supporting documents) in language other than English, certified translated copy in English language should also be furnished.
	(3). Offers will be scrutinized based on the qualifying requirements and only those who are technically and financially capable to execute the job and who fulfil the prequalifying requirements (PQR) are eligible to quote against above NIT.
5.	PRE-BID MEETING
	Not Applicable
6.	BID SECURITY / EARNEST MONEY DEPOSIT (EMD) NIL
7.	PRICES:
	(i) The prices as quoted in price schedule shall be on Firm basis .
	(ii) The prices shall be on INR basis.
	(iii) The prices are to be quoted on FOR (Site / Destination) basis excluding GST. The break-up of prices shall be as under:
	a) Ex-works Price: Ex-works price including packing & forwarding charges.

- **b)** Freight & Insurance: Freight and Transit Insurance for door delivery up to destination/store is in scope of bidder. Freight and insurance are to be quoted separately.
- c) Charges for Supervision of Pre-Commissioning Testing at Site: To be quoted separately if specified in NIT/Price Schedule.
- (iv) GST rates along with HSN/SAC code as applicable on Sr No (a) to (c) above is to be mentioned separately in percentage in both un-priced bid and price bid.

Note:

- i) The purchase order shall be placed on Ex-works basis. F&I (Freight & Insurance) up to site shall be in the scope of bidder.
- ii) Prices quoted shall be in Indian Rupees only.
- iii) Unloading at Site / Destination shall not be in the scope of the bidder.
- iv) Prices in respect of Sr No (a) to (c) of Clause 7.3 above are to be quoted inclusive of all taxes & Duties, charges. Levies, royalty etc. If any, excluding GST.

8. PRICE BID FORMAT

Bidder to quote their best prices strictly in BHEL's prescribed format of NIT, else their offer shall be liable to be rejected. Bidder has to mention "quoted" (in each applicable cell) in UN-PRICED BID. In case that cell is Not Applicable, "NA" must be mentioned in that particular cell. Prices shall be mentioned in Price bid schedule only. In case during detailed engineering stage, wherever, it is mentioned as NA (not applicable), is to be supplied, bidder shall supply the same without any cost and delivery implication to BHEL.

9. TERMS OF PAYMENT

[A] Payment for Supply:

- i) 95% of payment along with 100% GST & F&I shall be made within 45 days for MSE (Micro & Small Enterprises) / within 60 days for Medium Enterprises & non MSME suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
 - LR / GR
 - Material Receipt Certificate issued by BHEL (to be arrange by BHEL-TBG**)
 - GST Compliant Tax Invoice
 - Packing List (Case-wise)
 - Copy of Transit Insurance Certificate from underwriters.
 - Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management

- Guarantee Certificate
- Performance Security
- ** MRC shall be issued by BHEL site within 7-10 working days from the date of receipt of last consignment of each lot of dispatch (as per Invoice) at site and submission of following undertaking by vendor- "Boxes shall be opened in the presence of vendor's representative and in case of any shortage/damage found inside the factory packed boxes during verification, then vendor shall supply the same without any financial implications to BHEL."
- ii) Balance 05% of payment shall be made within 45 days for MSE (Micro & Small Enterprises) / within 60 days for Medium Enterprises & non MSME suppliers from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
 - Claim Invoice
 - Certificate of successful completion of Pre-Commissioning testing at Site issued by BHEL Site Official / Construction Management
 - Certificate of completion of final documentation as per Purchase Order / Technical Specification issued by BHEL Engineering Management

Note 01: In case Pre-Commissioning testing of Current Transformers gets delayed beyond 06 months from the date of last delivery of purchase order for the reasons not attributable to supplier, supplier may claim this 5% payment of supply portion by furnishing following documents:

- Claim Invoice
- Copy of certificate issued by BHEL site in charge, confirming that delay in testing is not attributable to supplier (to be arranged by BHEL TBG)

Copy of Bank Guarantee of equivalent value initially valid for 6 months from the date of submission of invoice with additional claim period of two months. In case Pre-Commissioning test is not successfully completed before expiry of Bank Guarantee, BG shall be kept suitably extended till completion of all Pre-Commissioning tests or 36 months from the date last delivery, whichever is earlier.

[B] Payment for Supervision of Pre-Commissioning testing:

100% Payment for Supervision of Pre-Commissioning testing along with applicable GST shall be made on prorate basis within 45 days for MSE (Micro & Small Enterprises) / within 60 days for Medium Enterprises & non MSME suppliers against certificate of successful completion of supervision of Pre-Commissioning testing at Site issued by BHEL Site Official / Construction Management from the date of receipt of GST Compliant Tax invoice in 3 sets (original + 2 copies).

Note:

i) Supplier has to submit invoice(s) as per PO along with billing checklist (Annexure-III).

- ii) In case of Transit Insurance under Open Insurance Policy, Intimation / Declaration of Transit Insurance as per terms of the relevant Open Insurance Policy along with copy of Open Insurance Policy from underwriters shall also be acceptable.
- iii) Supplier has to ensure commencement of transit insurance from the date not later than LR / GR date.
- iv) Supplier has to submit Tax Invoice(s). Supplier should ensure that Tax Invoice should comply all statutory requirements under GST Law to enable BHEL to avail input credit
- v) MSMED Act, 2006 and the rules made thereunder as amended from time to time shall be applicable for release of payment to suppliers qualified & registered as Micro & Small Enterprises based on documents mentioned in the NIT for MSME.
- vi) Supplier has to submit Performance Security & Guarantee Certificate as per PO terms.
- vii) In case any shortages and / or damages in supplies, an amount calculated based on comments against Material Receipt Certificate issued by the BHEL Site Official shall be withheld from the supply payment to be deemed fit by BHEL subject to a minimum of 10% of the total ex-works value of the invoice corresponding to the LR / GR against which any shortages and / or damages are reported. The withheld amount shall be released after the shortages and / or damages in supplies are supplied / replenished against Certification by BHEL Site Official.
- viii) Payment of GST component shall be made only if vendor has deposited the Tax and credit for the same is reflected in GSTN (GST Network). In case credit of the same is not reflected in GSTN, vendor may alternatively furnish BG of GST Amount for a period valid for not less than 1 month. In case of disallowance of credit /non-reflection of credit in GSTN, amount will be recovered from supplier along with applicable Interest, penalty etc. from any of his dues.
- ix) If GST is payable by BHEL on reverse Charge Mechanism basis, vendor should ensure the submission of GST compliant Tax invoice immediately on dispatch/ performance of service. In case of non-compliance any additional charges towards interest, penalty etc. will be to vendors account.
- x) TDS under GST Act, if applicable, shall be deducted unless Exemption Certificate If applicable, from the appropriate authority is furnished to BHEL along with Invoice.

10. GUARANTEE

The contractor shall guarantee that the equipment being supplied under this contract shall be new and of first quality workmanship and equipment / material supplied and services rendered (if applicable) shall be guaranteed to be free from all defects and faults in design & engineering, material, workmanship & manufacture and in full conformity with the Purchase Order / Contract, Technical Specifications & approved drawings / data sheets, if any, for 765kV rating Current Transformers- for 18 months from the date of last delivery OR Sixty (60) months from the date of Taking Over/Completion of Facilities*, whichever is later.

*Taking over / Completion of facility: For purpose of guarantee, date of taking over/completion of facilities is fixed as **22.03.2029** for PGCIL HVDC-Nagpur

The defective equipment / material / component shall be replaced free of cost at site. Freight & Insurance during transit shall also be in the scope of the supplier / contractor. Notification of any transit damage will be sent by BHEL to supplier within 15 days from date of receipt of material at site. Any expenditure for dismantling and re-erection of the replaced equipment / material /component shall be to supplier's / contractor's account. All replacements during the guarantee period shall be delivered at site promptly and satisfactorily within the reasonable period mutually agreed between BHEL and supplier. In the event of the supplier / contractor failing to replace the defective equipment / material / component within the time period mentioned above, the same shall be considered as breach of the contract and BHEL may proceed as per provision mentioned in this NIT without prejudice to any other rights under the contract.

Upon correction of the defects in the equipment by repair / replacement, such repair/replacement shall have the Defect Liability Period extended by a period equal to the period during which the facilities or such part cannot be used by the customer because of any of the aforesaid reasons. However, such extensions shall be limited up to period of 7 years of operation from the date of Taking Over/Completion of Facilities.

11. PERFORMANCE SECURITY

Performance security of 10% of Total Ex-works value (excl. Supervision charges) shall be submitted by the vendor within 30 days from the date of award of PO. Ex-works PO value (excl. Supervision charges) at the time of placement of PO shall be considered for calculation of the performance security amount.

"Bidder agrees to submit performance security required for execution of the contract within the time period mentioned. In case of delay in submission of performance security, enhanced performance security which would include interest (SBI rate + 6%) for the delayed period, shall be submitted by the bidder. Further, if performance security is not submitted till such time the first bill becomes due, the amount of performance security due shall be recovered as per terms and conditions defined in NIT / Contract, from the bills along with due interest."

(A) Modes of deposit:

Performance security may be furnished in the following forms:

(i) Local cheques of Scheduled Banks (subject to realization)/ Pay Order/Demand Draft/ Electronic Fund Transfer in favor of BHEL -TBG, Noida. Bank Account details for EFT mode is mentioned in EMD clause.

Bank Account details for submission of performance security through EFT mode.

NAME OF THE COMPANY

BHARAT HEAVY ELECTRICALS LTD

TRANSMISSION BUSINESS GROUP, 5TH FLOOR, BHEL SADAN, PLOT NO. 25, SECTOR-16A, NOIDA – 201301 (U.P.)
STATE BANK OF INDIA
CAG-II NEW DELHI (17313)
NEW DELHI
00000030206227732
CASH CREDIT
SBIN0017313

- (ii) Bank Guarantee from Scheduled Banks / Public Financial Institutions as defined in the Companies Act. Bank Guarantee shall be submitted as per BHEL format.
- (iii) Fixed Deposit Receipt issued by Scheduled Banks / Public Financial Institutions as defined in the Companies Act (FDR should be in the name of the vendor, a/c BHEL).
- (iv) Securities available from Indian Post offices such as National Savings Certificates, Kisan Vikas Patras etc. (held in the name of vendor furnishing the security and duly endorsed/ hypothecated/pledged, as applicable, in favor of BHEL).
- (v) Insurance Surety Bond.

(B) Forfeiture of performance security

The performance security will be forfeited and credited to BHEL's account in the event of a breach of contract by the vendor.

Important Notes:

- (1) The performance security should remain valid for a period of 60 days beyond the date of completion of all contractual obligations of the supplier including warranty/Guarantee obligations.
- (2) Performance security shall be refunded to the vendor without interest, after he duly performs and completes the contract in all respects but not later than 60(sixty) days of completion of all such obligations including the warranty under the contract.
- (3) BHEL will not be liable or responsible in any manner for the collection of interest or renewal of the documents or in any other matter connected therewith.
- (4) The Performance Security shall not carry any interest.
- (5) Value of the Bank Guarantee shall remain unchanged for any subsequent variations in Purchase Order value up to ± 30%. Beyond this variation of ± 30%, the Supplier shall arrange to enhance or may reduce the value of the Bank Guarantee accordingly for the total variation promptly.

- (6) The Bank Guarantee shall be from any bank as per Annexure-XIV for List of Banks. The original BG should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida.
- (7) Extension of validity of the BG in original, as per above clause, should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida at least 45 days before expiry of validity of the BG.
- (8) Non–submission BG / Deposit, as applicable, shall be considered as breach of contract as per terms of the NIT and BHEL reserves the right to impose Suspension of Business Dealings with the Supplier / Contractor.
- (9) Vendor to ensure submission of Certificate of Final Documentation /Confirmation regarding Non-applicability of Final Documentation, as the case may be, as referred in clause No. 9 regarding Final Documentation. BG shall be released only after submission of the same to BHEL TBMM.

12. DELIVERY LOCATION

District- Nagpur (Maharashtra)

Actual site location and consignee details shall be shared with successful bidder(s) during project execution.

13. DELIVERY PERIOD

Proposed delivery plan:

Sl. No.	Project Name	Delivery By-
1	PGCIL HVDC-Nagpur	Refer attached activity schedule, Annexure-II

Vendor to dispatch the material as per delivery plan mentioned in ACTIVITY SCHEDULE (Annexure-II) to meet the project requirement. Vendor to ensure supply/delivery of goods in time.

In case, BHEL's delivery requirement is not met by vendor(s), then a chance may be given to all such vendors to review their quoted delivery schedule in line with BHEL's delivery requirement. However, if vendor fails to meet the requisite delivery plan, then BHEL reserves the right not to consider the offer of such vendor(s).

The delivery conditions specified are for the contractual LD purpose. However, BHEL may ask for the early delivery without any compensation.

Note: LR / GR date or invoice date (whichever is later) shall be considered as delivery date.

14.	LIQUIDATED DAMAGES FOR DELAYED DELIVERY		
	Liquidated Damages, wherever referred under this Tender/Agreement, shall mean and		
	refer to the damages, not in the nature of penalty, which the contractor agrees to pay i		
	the event of delay in delivery of supplies, breach of contract etc. as the case may be.		
	Liquidated Damages leviable upon the Supplier/Vendor is a sum which is agreed by the		
	parties as a reasonable and genuine pre-estimate of damages which will be suffered by		
	BHEL on account of delay/breach on the part of the Supplier/Vendor.		
	If the Seller/Service Provider fails to deliver any or all of the Goods/Services within the		
	original/re-fixed delivery period(s) specified in the contract, the Buyer will be entitled to		
	deduct/recover the Liquidated Damages for the delay, unless covered under Force		
	Majeure conditions aforesaid, @ 0.5% of the contract value of delayed quantity per week		
	or part of the week of delayed period as pre-estimated damages not exceeding 05% of		
	the contract value of delayed quantity without any controversy/dispute of any sort whatsoever.		
	whatsoever.		
15.	VALIDITY OF OFFER:		
	The offer shall be valid for 120 days from the date of opening of tender (i.e. techno-		
	commercial bid unless otherwise specified in the NIT).		
16.	VENDOR APPROVAL/ ACCEPTANCE		
10.			
	 Bidder's offer will be considered for evaluation based on PQR, Technical and other commercial documents submitted along with bid. 		
	Bidder's offer will be acceptable subject to final acceptance of bidder by ultimate customer as approved supplier.		
	The bidders which are not Powergrid approved supplier or not including in		
	POWERGRID compendium, bidder shall submit necessary credentials/documents as		
	per Annexure-XII for onward submission to customer for approval.		
17	DEVIATION		
17.	Technical Deviation: No Technical Deviation is envisaged.		
	Commercial Deviation: No Commercial Deviation envisaged except defined in GTC.		
	The bids having deviation(s) w.r.t. tender is liable for rejection. However, BHEL, at its		
	discretion, may load the prices for evaluation of offer with prior intimation to bidder.		
	Clause-wise deviations and / or additional conditions / clarifications, if any, are to be		
	brought out clearly in "Schedule of Commercial Deviation" and "Schedule of Technical		
	Deviation" If any. Deviations and / or additional conditions / clarifications, if any,		
	mentioned elsewhere in the bid / offer, shall not be considered.		
10	TENDED EVALUATION		
18.	TENDER EVALUATION		

- Cost evaluation shall be done on total cost to BHEL basis.
- Comparative statement shall be prepared and evaluated on the basis of total cost to BHEL, considering Ex-Works Price, F&I and GST. GST input credit available to BHEL shall be reduced from prices while determining L1 status.
- Evaluation in case of more than one L-1 bidders. In the course of evaluation, if more
 than one bidder happens to occupy L-1 status, effective L-1 will be decided by
 soliciting discount from respective L-1 In case more than one bidder happens to
 occupy the L-1 status even after soliciting discounts, the L-1 bidder shall be decided
 by a toss/draw of lots, in the presence of the respective L-1 bidder(s) or their
 representative(s).
- Ranking will be done accordingly. BHEL decision in such situations shall be final and binding.

19. . QUANTITY SPLITTING AND AWARDING:

Entire quantity under this package shall be awarded to L1 bidder.

20. VALIDITY OF PURCHASE ORDER:

The purchase order(s) shall be valid for one year from date of PO.

21. WORKS ADDRESS:

Bidders to mention their works address in Annexure-XV (Contact details of bidder).

22. Settlement of Dispute

If any dispute or difference of any kind whatsoever shall arise between BHEL and the Supplier/Vendor, arising out of the contract for the performance of the work whether during the progress of contract termination, abandonment or breach of the contract, it shall in the first place referred to Designated Engineer for amicable resolution by the parties. Designated Engineer (to be nominated by BHEL for settlement of disputes arising out of the contract) who within 60 days after being requested shall give written notice of his decision to the contractor. Save as hereinafter provided, such decision in respect of every matter so referred shall forthwith be given effect to by the Supplier/Vendor who shall proceed with the work with all due diligence, whether he or BHEL desires to resolve the dispute as hereinafter provided or not.

If after the Designated Engineer has given written notice of this decision to the party and no intention to pursue the dispute has been communicated to him by the affected party within 30 days from the receipt of such notice, the said decision shall become final and binding on the parties. In the event the Supplier/Vendor being dissatisfied with any such decision or if amicable settlement cannot be reached then all such disputed issues shall be resolved through conciliation in terms of the BHEL Conciliation Scheme 2018 as per Clause 22.1.

22.1 Conciliation:

Any dispute, difference or controversy of whatever nature howsoever arising under or out of or in relation to this Agreement (including its interpretation) between the Parties, and so notified in writing by either party to other party (the "Dispute") shall, in the first instance, be attempted to be resolved amicably in accordance with the conciliation procedure as per BHEL Conciliation Scheme 2018. The proceedings of Conciliation shall broadly be governed by Part-III of the Arbitration and Conciliation Act 1996 or any statutory modification thereof and as provided in "Procedure for conduct of conciliation proceedings" (as available in www.bhel.com)).

22.2 Arbitration:

- **22.2.1** Except as provided elsewhere in this Contract, in case Parties are unable to reach amicable settlement (whether by Conciliation to be conducted as provided in Clause 22.1 herein above or otherwise) in respect of any dispute or difference; arising out of the formation, breach, termination, validity or execution of the Contract; or, the respective rights and liabilities of the Parties; or, in relation to interpretation of any provision of the Contract; or in any manner touching upon the Contract (hereinafter referred to as the 'Dispute'), then, either Party may, refer the disputes to Arbitral Institution "IIAC" (India International Arbitration Centre) and such dispute to be adjudicated by Sole Arbitrator appointed in accordance with the Rules of said Arbitral Institution.
- **22.2.2** A party willing to commence arbitration proceeding shall invoke Arbitration Clause by giving notice to the other party in terms of section 21 of the Arbitration & Conciliation Act, 1996 (hereinafter referred to as the 'Notice') before referring the matter to arbitral institution. The Notice shall be addressed to the Head of the Unit, BHEL, executing the Contract and shall contain the particulars of all claims to be referred to arbitration with sufficient detail and shall also indicate the monetary amount of such claim including interest, if any.
- **22.2.3** After expiry of 30 days from the date of receipt of aforesaid notice, the party invoking the Arbitration shall submit that dispute to the Arbitral Institutions and that dispute shall be adjudicated in accordance with their respective Arbitration Rules. The matter shall be adjudicated by a Sole Arbitrator who shall necessarily be a Retd. Judge having considerable experience in commercial matters to be appointed/nominated by the respective institution. The cost/expenses pertaining to the said Arbitration shall also be governed in accordance with the Rules of the respective Arbitral Institution. The decision of the party invoking the Arbitration for reference of dispute to a specific Arbitral institution for adjudication of that dispute shall be final and binding on both the parties and shall not be subject to any change thereafter. The institution once selected at the time of invocation of dispute shall remain unchanged.
- **22.2.4** The fee and expenses shall be borne by the parties as per the Arbitral Institutional rules.
- **22.2.5** The Arbitration proceedings shall be in English language and the seat and venue of Arbitration shall be New Delhi.
- **22.2.6** Subject to the above, the provisions of Arbitration & Conciliation Act 1996 and any amendment thereof shall be applicable. All matters relating to this Contract and arising out of invocation of Arbitration clause are subject to the exclusive jurisdiction of the Court(s) situated at New Delhi.

- **22.2.7** Notwithstanding any reference to the Designated Engineer or Conciliation or Arbitration herein, a. the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree. Settlement of Dispute clause cannot be invoked by the Contractor, if the Contract has been mutually closed or 'No Demand Certificate' has been furnished by the Contractor or any Settlement Agreement has been signed between the Employer and the Contractor.
- **22.2.8** It is agreed that Mechanism of resolution of disputes through arbitration shall be available only in the cases where the value of the dispute is less than Rs. 10 Crores.
- **22.2.9** In case the disputed amount (Claim, Counter claim including interest is Rs. 10 crores and above, the parties shall be within their rights to take recourse to remedies other than Arbitration, as may be available to them under the applicable laws after prior intimation to the other party. Subject to the aforesaid conditions, provisions of the Arbitration and Conciliation Act, 1996 and any statutory modifications or re-enactment thereof as amended from time to time, shall apply to the arbitration proceedings under this clause.
- **22.2.10** In case, multiple arbitrations are invoked (whether sub-judice or arbitral award passed) by any party to under this contract, then the cumulative value of claims (including interest claimed or awarded) in all such arbitrations shall be taken in account while arriving at the total claim in dispute for the subject contract for the purpose of clause 22.2.9. Disputes having cumulative value of less than 10 crores shall be resolved through arbitration and any additional dispute shall be adjudicated by the court of competent jurisdiction.

22.3 In case of Contract with Public Sector Enterprise (PSE) or a Government Department, the following shall be applicable:

In the event of any dispute or difference relating to the interpretation and application of the provisions of commercial contract(s) between Central Public Sector Enterprises (CPSEs)/ Port Trusts inter se and also between CPSEs and Government Departments/Organizations (excluding disputes concerning Railways, Income Tax, Customs & Excise Departments), such dispute or difference shall be taken up by either party for resolution through AMRCD (Administrative Mechanism for Resolution of CPSEs Disputes) as mentioned in DPE OM No. 05/0003/2019-FTS-10937 dated 14-12-2022 as amended from time to time.

23. BREACH OF CONTRACT, REMEDIES AND TERMINATION

- **23.1** Following conditions shall be considered as breach of contract:
- i) Non-supply of material/ non-completion of work by the vendor within scheduled delivery/ completion period as per contract or as extended from time to time.
- ii) The vendor fails to perform as per the activity schedule and there are sufficient reasons even before expiry of the delivery/ completion period to justify that supplies shall be inordinately delayed beyond contractual delivery/ completion period.
- iii) The vendor delivers equipment/ material not of the contracted quality.
- iv) The vendor fails to replace the defective equipment/ material/ component as per guarantee clause.

Page **13** of **24**

- v) Withdrawal from or abandonment of the work by the vendor before completion as per contract.
- vi) Assignment, transfer, subletting of Contract without BHEL's written permission resulting in termination of Contract or part thereof by BHEL.
- vii) Non-compliance to any contractual condition or any other default attributable to Contractor/ Vendor.
- viii) Any other reason(s) attributable to Vendor towards failure of performance of contract. In case of breach of contract, BHEL shall have the right to terminate the Purchase Order/ Contract either in whole or in part thereof without any compensation to the Supplier/Vendor.
- ix) Any of the declarations furnished by the contractor at the time of bidding and/ or entering into the contract for supply are found untruthful and such declarations were of a nature that could have resulted in non-award of contract to the contractor or could expose BHEL and/ or Owner to adverse consequences, financial or otherwise.
- x) Supplier/Vendor is convicted of any offence involving corrupt business practices, antinational activities or any such offence that compromises the business ethics of BHEL, in violation of the Integrity Pact entered into with BHEL has the potential to harm the overall business of BHEL/ Owner.

Note:

Once BHEL considers that a breach of contract has occurred on the part of Supplier/Vendor, BHEL shall notify the Supplier/Vendor by way of notice in this regard. Contractor shall be given an opportunity to rectify the reasons causing the breach of contract within a period of 14 days.

In case the contractor fails to remedy the breach, as mentioned in the notice, to the satisfaction of BHEL, BHEL shall have the right to take recourse to any of the remedial actions available to it under the relevant provisions of contract.

23.2 Remedies for breach of contract:

- a) Wherein the period as stipulated in the notice issued under clause 22.1 has expired and Supplier/Vendor has failed to remedy the breach, BHEL will have the right to terminate the contract on the ground of "Breach of Contract" without any further notice to contractor.
- b) Upon termination of contract, BHEL shall be entitled to recover an amount equivalent to 10% of the Contract Value for the damages on account of breach of contract committed by the Supplier/Vendor. This amount shall be recovered by way of encashing the security instruments like performance bank guarantee etc available with BHEL against the said contract. In case the value of the security instruments available is less than 10% of the contract value, the balance amount shall be recovered from other financial remedies (i.e. available bills of the Supplier/Vendor,

retention amount, from the money due to the Supplier/Vendor etc. with BHEL) or the other legal remedies shall be pursued.

- c) wherever the value of security instruments like performance bank guarantee available with BHEL against the said contract is 10% of the contract value or more, such security instruments to the extent of 10% contract value will be encashed. In case no security instruments are available or the value of the security instruments available is less than 10% of the contract value, the 10% of the contract value or the balance amount, as the case may be, will be recovered in all or any of the following manners:
- d) In case the amount recovered is not sufficient to fulfil the amount recoverable then; a demand notice to deposit the balance amount within 30 days shall be issued to Supplier/Vendor.
- e) If Supplier/Vendor fails to deposit the balance amount within the period as prescribed in demand notice, following action shall be taken for recovery of the balance amount:
 - i) from dues available in the form of Bills payable to defaulted Supplier/Vendor against the same contract.
 - ii) If it is not possible to recover the dues available from the same contract or dues are insufficient to meet the recoverable amount, balance amount shall be recovered from any money(s) payable to Supplier/Vendor under any contract with other Units of BHEL including recovery from security deposits or any other deposit available in the form of security instruments of any kind against Security deposit or EMD.
- f) In-case recoveries are not possible with any of the above available options, Legal action shall be initiated for recovery against defaulted supplier/Vendor.
- g) It is an agreed term of contract that this amount shall be a genuine pre-estimate of damages that BHEL would incur in completion of balance contractual obligation of the contract through any other agency and BHEL will not be required to furnish any other evidence to the Supplier/Vendor for the purpose of estimation of damages.
- h) In addition to the above, imposition of liquidated damages, debarment, termination, de-scoping, short-closure, etc., shall be applied as per provisions of the contract.

Note:

- (1) The defaulting Supplier/Vendor shall not be eligible for participation in any of the future enquiries floated by BHEL to complete the balance work. The defaulting contractor shall mean and include:
- (a) In case defaulted Supplier/Vendor is the Sole Proprietorship Firm, any Sole Proprietorship Firm owned by same Sole Proprietor.

Page **15** of **24**

(b) In case defaulted Supplier/Vendor is The Partnership Firm, any firm comprising of same partners/ some of the same partners; or sole proprietorship firm owned by any partner(s) as a sole proprietor.

LD against delay in executed supply in case of Termination of Contract:

LD against delay in executed supply shall be calculated in line with LD clause no. 14.0, for the delay attributable to Supplier/Vendor. For limiting the maximum value of LD, contract value shall be taken as Executed Value of supply till termination of contract.

Method for calculation of "LD against delay in executed supply in case of termination of contract" is given below.

- a) Let the time period from scheduled date of start of work till termination of contract excluding the period of Hold (if any) not attributable to contractor/ supplier = T1
- b) Let the value of executed work/ supply till the time of termination of contract = X
- Let the Total Executable Value of work/ supply for which inputs/ fronts were made available to contractor/ supplier and were planned for execution till termination of contract = Y
- d) Delay in executed work/ supply attributable to contractor/ supplier i.e. T2 = [1-(X/Y)] x T1
- ED shall be calculated in line with LD clause of the Contract for the delay attributable to supplier taking "X" as Contract Value and "T2" as delay attributable to contractor/ supplier.

Note: In case portion of service/ supply is withdrawn, no LD shall be applicable for portion of service/ supply withdrawn.

24. MICRO & SMALL ENTERPRISES (MSE)

Any bidder falling under MSE category shall submit Udyam Registration certificate along with their techno-commercial offer.

Type under MSE	SC/ST owned	Others (excluding SC/ ST & Women Owned)
Micro		or & Women Owned
Small		

Note:

- a) If the bidder does not furnish the Udyam Registration certificate for MSE category, offer shall be processed construing that the bidder is not falling under MSE category.
- b) Documents submitted by the bidder shall be verified by BHEL for rendering the applicable benefits.
- c) MSE suppliers can avail the intended benefits in respect of the procurements related to the Goods and Services only (Definition of Goods and Services as enumerated by Govt. of India vide Office Memorandum F. No. 21(8)/2011-MA dtd. 09/11/2016 office

Page **16** of **24**

	offer.	
d)	Bidder to select purchase preference in GeM Portal to avail MSE purchase preference	
	for this enquiry.	
N 1 -	The state of the s	1

No purchase preference shall be applicable for this enquiry if MSE purchase preference is not selected by the bidder in GeM Portal.

of AS & DC. MSMF) only if they submit Udyam Registration certificate along with the

25. REVERSE AUCTION

Not applicable for this enquiry.

26. INTEGRITY PACT

Bidders shall have to enter into Integrity Pact with BHEL, duly signed with seal in original, if specified in NIT / RFQ failing which bidder's offer shall be liable for rejection.

(a) IP is a tool to ensure that activities and transactions between the Company and its Bidders/ Contractors are handled in a fair, transparent and corruption free manner. Following Independent External Monitors (IEMs) on the present panel have been appointed by BHEL with the approval of CVC to oversee implementation of IP in BHEL.

SI.	IEM	Email
1	Shri Bishwamitra Pandey, IRAS (Retd.)	lem2@bhel.in
2	Shri Mukesh Mittal, IRS (retd.)	lem3@bhel.in

- (b) The IP as enclosed with the tender is to be submitted (duly signed by authorized signatory) along with techno-commercial bid (Part-I, in case of two/ three part bid). Only those bidders who have entered into such an IP with BHEL would be competent to participate in the bidding. In other words, entering into this Pact would be a preliminary qualification.
- (c) Please refer Section-8 of IP for Role and Responsibilities of IEMs. In case of any complaint arising out of the tendering process, the matter may be referred to any of the above IEM(s). All correspondence with the IEMs shall be done through email only. Note: No routine correspondence shall be addressed to the IEM (phone/ post/ email) regarding the clarifications, time extensions or any other administrative queries, etc on

the tender issued. All such clarification/ issues shall be addressed directly to the tender issuing (procurement) department's officials whose contact details are provided below:

Details of contact person(s):

(1) Name: Mr. Deep Shekhar Dewangan (2) Name: Mr. Nandlal Verma

Deptt: TBMM Deptt: TBMM

Address: BHEL Noida
Phone: 0120 2218832
Phone: 0120 2218836
Email: dsdewangan@bhel.in
Address: BHEL Noida
Phone: 0120 2218836
Email: nverma@bhel.in

27.	VARIATION OF CONTRACT VALUE / QUANTITY VARIATION
	BHEL shall have the right to variation in quantities of items within -25% to +25% of the total Purchase Order / Contract value at the time of placement of PO or award of Contract on overall basis for all amendments together within one year from the date of original Purchase Order / Contract or completion of execution of the Purchase Order / Contract whichever is earlier but quantities of individual items may vary to any extent or may get deleted unless otherwise specified in the technical specifications. No compensation is payable due to variation in the quantities and the Supplier / Contractor shall be bound to accept the same the contracted prices / rates without any escalation. However, if the Purchase Order / Contract is on "Lumpsum" basis, no variation of Purchase Order / Contract value shall be admissible to the Supplier / Contractor within the scope of Purchase Order / Contract, as long as the inputs remain unchanged.
28.	GeM Seller ID
20.	GeM seller ID is mandatory for the bidders and must be mentioned in their offer. In case at the time of submission of offer GeM seller ID is not available with bidder, then successful tenderer should ensure to have GeM Seller ID prior to award of contract. Department of Expenditure (DOE) OM no. 6/9/2020-PPD dated 24.08.2020 may be referred in this regard.
	referred in this regard.
29.	MODE OF PAYMENT
	Payment shall be made directly to the Supplier / Contractor by BHEL through NEFT / RTGS. TBG is registered with RXIL (TReDS) platform. MSME bidders are requested to get registered with RXIL (TReDS) platform to avail the facility as per Gol guidelines.
30.	MAKE IN INDIA (PPP-MII)
	For this procurement, the local content to categorize a supplier as Class-I local supplier / class-II local supplier / Non-Local supplier and purchase preference to Class-I local supplier, is as defined in Public Procurement (Preference to Make in India), Order 2017 dated 04.06.2020, issued by DPIIT. In case of subsequent orders issued by the nodal ministry, changing the definition of local content for the items of the NIT, the same shall be applicable even if issued after issue of this NIT but before opening of part-II bids against this NIT.
	"Bidder to specify the percentage of local content as per the format of self-declaration for local content" as per Annexure-V."
	"This tender is not a global tender and only Class-I suppliers as defined under the DPIIT order no. P-45021/2/2017-PP (BE-II) dated 04.06.2020 are eligible to bid in this tender. Bids received from Class II & Non- Local supplier shall be rejected."
	The minimum local content to qualify as a Class-I local supplier is 60%.

Procurement under this bid is reserved for purchase from Class-I local supplier as defined in public procurement (Preference to Make in India), Order 2017 as amended from time to time and its subsequent Orders/Notifications issued by concerned Nodal Ministry for specific Goods/Products. However, eligible micro and small enterprises will be allowed to participate. In case the bid value is more than Rs.10 Crore, the declaration relating to percentage of local content shall be certified by the statutory auditor or cost auditor, if the OEM is a company and by a practicing cost accountant or a chartered accountant for OEMs other than companies as per the Public Procurement (preference to Make-in - India) order 2017 dated 04.06.2020. Purchase preference to Micro and Small Enterprises clause will get precedence over this clause.

31. COMPLIANCE TO GOI ORDER FOR RESTRICTIONS UNDER RULE 144 (XI) OF GENERAL FINANCIAL RULES (GFRS), 2017

- Any bidder from a country which shares a land border with India will be eligible to bid
 in any procurement whether of goods, services (including consultancy services and
 non-consultancy services) or works (including turnkey projects) only if the bidder is
 registered with the Competent Authority. Further, any bidder (including bidder from
 India) having specified Transfer of Technology (ToT) arrangement with an entity from
 a country which shares a land border with India, shall also require to be registered
 with the same competent authority.
- "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any person or firm or company, including any member of a consortium or joint venture (that is an association of several persons, or firms or companies), every artificial juridical person not falling in any of the descriptions of bidders stated hereinbefore, including any agency branch or office controlled by such person, participating in a procurement process.
- "Bidder (or entity) from a country which shares a land border with India" for the purpose of this Order means: -
- (a) An entity incorporated, established or registered in such a country; or
- (b) A subsidiary of an entity incorporated, established or registered in such a country; or
- (c) An entity substantially controlled through entities incorporated, established or registered in such a country; or
- (d) An entity whose beneficial owner is situated in such a country; or
- (e) An Indian (or other) agent of such an entity; or
- (f) A natural person who is a citizen of such a country; or
- (g) A consortium or joint venture where any member of the consortium or joint venture falls under any of the above.
- The beneficial owner for the purpose of (iii) above will be as under:
- 1. In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.

Page **19** of **24**

Explanation-

- a) "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent. of shares or capital or profits of the company;
- b) "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholders agreements or voting agreements;
- 2. In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting alone or together, or through one or more juridical person, has ownership of entitlement to more than fifteen percent of capital or profits of the partnership;
- 3. In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has ownership of or entitlement to more than fifteen percent of the property or capital or profits of such association or body of individuals;
- 4. Where no natural person is identified under (1) or (2) or (3) above, the beneficial owner is the relevant natural person who holds the position of senior managing official;
- 5. In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen percent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.
- An Agent is a person employed to do any act for another, or to represent another in dealings with third person.
- 1. The successful bidder shall not be allowed to sub-contract works to any contractor from a country which shares a land border with India unless such contractor is registered with the Competent Authority
- 2. The registration shall be valid at the time of submission of bid and at the time of acceptance of bid.

If the bidder was validly registered at the time of acceptance/ placement of order, registration shall not be a relevant consideration during contract execution

The above clause is not applicable to the bidders from those countries (even if sharing a land border with India) to which the GoI has extended lines of credit or in which the GoI is engaged in development projects. List of countries to which lines of credit have been extended or in which development projects are undertaken are available on the Ministry of External affairs website (https://www.mea.gov.in/).

32. COMPLIANCE TO ORDER NO. 25-111612018-PG, DATED 02.07.2020 OF MINISTRY OF POWER, GOI:

Power Supply System is a sensitive and critical infrastructure that supports not only our national defence, vital emergency services including health, disaster response, critical national infrastructure including classified data & communication services, defense installations and manufacturing establishments, logistics services but also the entire economy and the day-today life of the citizens of the country. Any danger or threat to Power Supply System can have catastrophic effects and has the potential to cripple the entire country. Therefore, the Power Sector is a strategic and critical sector.

The vulnerabilities in the Power Supply System & Network mainly arise out of the possibilities of cyber-attacks through malware / Trojans etc. embedded in imported equipment. Hence, to protect the security, integrity and reliability of the strategically important and critical Power Supply System & Network in the country, the following directions are hereby issued: -

- 1. All equipment, components, and parts imported for use in the Power Supply System and Network shall be tested in the country to check for any kind of embedded malware/trojans/cyber threat and for adherence to Indian Standards.
- 2. All such testing's shall be done in certified laboratories that will be designated by the Ministry of Power (MOP).
- 3. Any import of equipment/components/parts from "prior reference" countries as specified or by persons owned by, controlled by, or subject to the jurisdiction or the directions of these "prior reference" countries will require prior permission of the Government of India
- 4. Where the equipment/components/parts are imported from "prior reference" countries, with special permission, the protocol for testing in certified and designated laboratories shall be approved by the Ministry of Power (MOP).

This order shall apply to any item imported for end use or to be used as a component, or as a part in manufacturing, assembling of any equipment or to be used in power supply system or any activity directly or indirectly related to power supply system.

33. PREVENTION FOR CARTEL FORMATION

The Bidder declares that they will not enter into any illegal or undisclosed agreement or understanding, whether formal or informal with other Bidder(s). This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process. In case, the Bidder is found having indulged in above activities, suitable action shall be taken by BHEL as per extant policies/ guidelines

34. Force Majeure

- **34.1** "Force Majeure" shall mean circumstance which is:
- a) beyond control of either of the parties to contract,
- b) either of the parties could not reasonably have provided against the event before entering into the contract,
- c) having arisen, either of the parties could not reasonably have avoided or overcome, and

Page **21** of **24**

d) is not substantially attributable to either of the parties And

Prevents the performance of the contract,

Such circumstances include but shall not be limited to:

- War, hostilities, invasion, act of foreign enemies.
- Rebellion, terrorism, revolution, insurrection, military or usurped power, or civil war.
- Riot, commotion or disorder by persons other than the contractor's personnel and other employees of the contractor and sub-contractors.
- Strike or lockout not solely involving the contractor's personnel and other employees of the contractor and sub-contractors.
- Encountering munitions of war, explosive materials, ionizing radiation or contamination by radio-activity, except as may be attributable to the contractor's use of such munitions, explosives, radiation or radio- activity.
- Natural catastrophes such as earthquake, tsunami, volcanic activity, hurricane or typhoon, flood, fire, cyclones etc.
- Epidemic, pandemic etc.
- **34.2** The following events are explicitly excluded from Force Majeure and are solely the responsibilities of the non-performing party:
- any strike, work-to-rule action, go-slow or similar labour difficulty late delivery of equipment or material (unless caused by Force Majeure event) and economic hardship.
- **34.3** If either party is prevented, hindered or delayed from or in performing any of its obligations under the Contract by an event of Force Majeure, then it shall notify the other in writing of the occurrence of such event and the circumstances thereof within 15 (fifteen) days after the occurrence of such event.
- **34.4** The party who has given such notice shall be excused from the performance or punctual performance of its obligations under the Contract for so long as the relevant event of Force Majeure continues and to the extent that such party's performance is prevented, hindered or delayed. The Time for Completion shall be extended by a period of time equal to period of delay caused due to such Force Majeure event.
- **34.5** Delay or non-performance by either party hereto caused by the occurrence of any event of Force Majeure shall not
- (i) Constitute a default or breach of the Contract.
- (ii) Give rise to any claim for damages or additional cost expense occasioned thereby, if and to the extent that such delay or non-performance is caused by the occurrence of an event of Force Majeure.
- **34.6** BHEL at its discretion may consider short closure of contract after 1 year of imposition of Force Majeure in line with extant guidelines. In any case, Supplier/Vendor cannot consider deemed short-closure after 1 year of imposition of Force Majeure.

Page 22 of 24

35	Fraud Prevention Policy
	The Bidder along with its associate / collaborators / sub-contractors / sub-vendors /
	consultants / service providers shall strictly adhere to BHEL Fraud Prevention Policy
	displayed on BHEL website http://www.bhel.com and shall immediately bring to the
	notice of BHEL Management about any fraud or suspected fraud as soon as it comes to their notice.
36.	Suspension of Business dealings with Suppliers
	BHEL reserves the right to take action against Contractors who either fail to perform or
	Tenderers/Contractor who indulge in malpractices, by suspending business dealings with them in line with BHEL guidelines issued from time to time.
	The offers of the bidders who are under suspension as also the offers of the bidders, who
	engage the services of the banned firms / principal / agents, shall be rejected. The list of banned firms is available on BHEL web site www.bhel.com .
	If any bidder / supplier / contractor during pre-tendering / tendering / post tendering / award / execution / post-execution stage indulges in any act, including but not limited to,
	mal-practices, cheating, bribery, fraud or and other misconduct or formation of cartel so as to influence the bidding process or influence the price or tampers the tendering process or acts or omits in any manner which tantamount to an offence punishable under any provision of the Indian Penal Code, 1860 or any other law in force in India, or does
	anything which is actionable under the Guidelines for Suspension of Business dealings, action may be taken against such bidder / supplier / contractor as per extant guidelines of the company available on www.bhel.com and / or under applicable legal provisions. Guidelines for suspension of business dealings is available in the webpage: http://www.bhel.com/vender_registration/vender.php
37	Additional Loading Criteria
	If bidder takes deviation against NIT delivery schedule, the quoted price of corresponding
	project / package of the bidder shall be loaded @ 0.5% of quoted price (i.e., ex-works +
	F&I + Total Service charges, excluding GST) per week to the extent to which delivery
	schedule is not agreed to by the bidder.
	However, maximum permissible deviation in delivery schedule shall be 10 weeks from
	the delivery schedule mentioned in the NIT.
	In case, the delivery schedule quoted beyond 10 weeks from the NIT delivery schedule,
	then BHEL reserves the right not to consider the offer of such vendor(s).

Enclosures:

Sl. No.	
1.1	Special terms and conditions
1.2	General Terms and conditions
2.	Technical Specifications
3.	Price Bid format
4.	Annexure-I (A) & (B)-Pre-Qualifying requirement
5.	Annexure-II- Activity Schedules
6.	Annexure-III Check List-For Bill
7.	Annexure-IV- Deleted.
8.	Annexure-V- Self-Certification for Local Content
9.	Annexure-VI- Restrictions under Rule 144 (xi) of General Financial Rules (GFRs), 2017
10.	Annexure-VII-Bidders certification regarding compliance to Rule 144 (xi) of General Financial Rules
	(GFRs), 2017
11.	Annexure-VIII-Bidders certification regarding compliance to Rule 144 (xi) of General Financial Rules
	(GFRs), 2017
12.	Annexure-IX-Order No. 25-111612018-PG, Dated 02.07.2020-MOP
13.	Annexure-X-Bidder certification regarding compliance to MOP circular
14.	Annexure-XI-Implementation of Integrity Pact IP in BHEL
15.	Annexure-XII-Format for vendor approval
16.	Annexure-XIII-Format of Security cum Performance BG
17.	Annexure-XIV-List of Banks for the Submission of Security cum Performance Bank Guarantee
18.	Annexure-XV-Contact details of bidder
19.	Annexure-XVI-Sch of Technical Dev
20.	Annexure-XVII-Sch of Commercial Dev
21.	PPP-MII-Order
22.	MRC-Format
23.	Inspection call format

BHARAT HEAVY ELECTRICALS LTD. (TRANSMISSION BUSINESS GROUP)

GENERAL TERMS AND CONDITIONS FOR TENDER ENQUIRY / CONTRACT

This is to be submitted duly signed by bidder in original. Clause-wise deviations and / or additional conditions / clarifications, if any, are to be brought out clearly in "Schedule of Commercial Deviation". Deviations and / or additional conditions / clarifications, if any, mentioned elsewhere in the bid / offer, shall not be considered.

Sr. No.				
1.	INST	TRUCTION TO BIDDERS :		
	1.1	confo	ed bids are invited for the items mentioned in the tender enquiry orming to the NIT including Technical Specifications. Bids should be typed free from overwriting and erasures. Corrections or additions / deletions, if must be clearly written and attested, otherwise offer may be rejected.	
	1.2	befor	er must ensure that their bid is submitted / dropped in the tender box on or re 14-00 Hrs. IST on the due date of opening, unless otherwise specified e NIT, at the address as follows:-	
		Mate Trans Bhar 5 th Fl Adva Plot- Noida	ler Box, srials Management, smission Business Group, at Heavy Electricals Limited, loor, Tower-A, ant Navis IT Business Park, 7, Sector-142, a Expressway, Noida, G. B. Nagar, U. P 201305	
	1.3	has	ise tender enquiry is floated though the e-procurement system, offer / bid to be submitted through the e-procurement system ONLY as per uctions given in the e-procurement portal (https://bheleps.buyjunction.in).	
	1.4	prese spec bids	bids shall be opened at 14-30 Hrs. IST on the due date of opening, in the ence of participating bidders who may like to be present, unless otherwise ified in the NIT. Bids received late are liable for rejection. Bidders sending by courier or post will have to ensure that it is timely delivered at the e address.	
	1.5	Bids are to be submitted duly signed with seal in two parts :-		
		a)	Techno-commercial Bid (Part-I). To be submitted in 2 sets (original + copy). A copy of Price Bid (Part-II) clearly mentioning all the necessary information as per format without prices %In-Priced Bid+is also to be enclosed in Part-I Bid.	
		b)	Price Bid (Part-II) . To be submitted only in one set in a separate sealed envelope. This should not contain any Technical and / or Commercial Terms and Conditions. The rates should be quoted both in figures and words.	
	1.6	The I	Part-I and Part-II Bids are to be sealed in separate envelopes and marked	

Sr. No. as %Eechno-commercial Bid (Part-I)+and %Price Bid (Part-II)+respectively. Both the envelopes are to be kept in another common envelope and marked as %ID+ Each envelope should be sealed and super scribed with tender enquiry no., item / package name, project name and due date of opening. Bidderos name and address shall also be mentioned on each envelope. 1.7 For any technical clarification, please contact official mentioned in the tender enquiry / NIT. 1.8 For any commercial clarification please contact official issuing tender enquiry / Price bid (Part-II) should not contain any additional information / description other than given in %Un-Priced Bid+ submitted with %Techno-commercial Bid (Part-I)+except prices, otherwise bid is liable for rejection. 1.10 Price Bid submitted along with the bid shall remain valid up to validity of offer. Any discount / revised offer submitted by the bidder on its own shall be accepted provided it is received before the due date and time of offer submission (i.e. Part-I Bid). The discount shall be applied on pro-rata basis to all items including optional items, if any, unless specified otherwise by the bidder. Discount offered shall be valid for full duration of validity of the offer including extension of validity, if any. Unsolicited Supplementary / Revised Price Bid submitted after the due date and time of offer submission (i.e. Part-I Bid), during validity period of offer, unless asked by BHEL, shall not be considered. Withdrawal of quotation by the bidder, at any stage after its opening, may entail suitable action against such bidder by BHEL. 1.11 The consultants / firm (and any of its affiliates) shall not be eligible to participate against tender enquiry for the related goods or works or services for the same project, if they were engaged by BHEL-TBG for the consultancy services. 1.12 In case any Foreign OEM / Foreign Principal insists on engaging the services of an agent, such agent shall not be allowed to represent more than one manufacturer / supplier in the same tender. Moreover, either the agent could bid on behalf of the manufacturer / supplier or the manufacturer / supplier could bid directly but not both. In case bids are received from the manufacturer / supplier and the agent, bid received from the agent shall be ignored. 1.13 Non-conformities / errors / discrepancies in quoted prices in price bids shall be dealt as follows :-If, in the price structure quoted for the required goods / services / works, there is discrepancy between the unit price and the total price (which is obtained by multiplying the unit price by the quantity), the unit price shall prevail and the total price corrected accordingly, unless in the opinion of BHEL there is an obvious misplacement of the decimal point in the unit price, in which case the total price as quoted shall govern and the unit price corrected accordingly. b) If there is an error in a total corresponding to the addition or subtraction of subtotals, the subtotals shall prevail and the total shall be corrected.

If there is a discrepancy between words and figures, the amount in

c)

The state of the s
words shall prevail, unless the amount expressed in words is related to an arithmetic error, in which case the amount in figures shall prevail subject to (a) and (b) above.
d) If there is such discrepancy in an offer as mentioned in (a), (b) & (c) above, the same shall be conveyed to the bidder with target date upto which the bidder has to send his acceptance on the above lines and if the bidder does not agree to the decision of the BHEL, the bid is liable to be ignored.
1.14 In case the scope of the successful bidder / supplier against this tender enquiry includes Erection, Testing and Commissioning (ETC) of the equipment / material at site in addition to Supply, Purchase Order shall be placed for Supply Portion and Contract shall be separately awarded for ETC at Site Portion. General Terms and Conditions for Tender Enquiry / Contract mentioned herein shall be applicable for both Supply & ETC at Site. Additional Terms and Conditions for Tender Enquiry / Contract for Erection, Testing and Commissioning at Site %HEL/TBG/GTC-ETC/2016 Rev. 01+ shall be applicable for ETC at Site only which is to be read in conjunction with General Terms and Conditions for Tender Enquiry / Contract mentioned herein. However, any breach of either the Purchase Order or the Contract shall be deemed to be breach of the other.
1.15 Taxes and Duties payable extra as per Clause No. 2.3 in NIT, if not specified/quoted clearly as extra shall be considered as included in Ex-works Price and therefore shall not be reimbursed. Taxes and duties not payable extra as per NIT shall be deemed to be included in Ex-works Price.
1.16 If the rates for taxes and duties in respect of the quoted materials and / or services assumed by the Supplier are less than the tariff prevailing at the time of tendering, Supplier will be responsible for such under quotations. However if the rates assumed are higher than the correct rates prevailing at the time tendering, the difference will be to the credit of BHEL.
Note: Representative / official deputed by the bidder to witness tender opening must produce authorization letter for the same. PRICES:
2.1 Unless specifically indicated in the NIT, all prices shall be FIRM. No enhancement of rate for whatsoever reasons unless and until asked by BHEL shall be allowed.
2.2 Unless specifically indicated in the NIT, the prices shall be on INR basis.
2.3 Unless specifically indicated in the NIT, the prices are to be quoted on FOR (Site / Destination) basis excluding GST. The break-up of prices shall be as under :-
a) Ex-works Price: Ex-works price including packing & forwarding charges.
b) Freight: Freight for door delivery up to destination / site / store are to be quoted separately.
c) Insurance : Insurance for door delivery up to destination / site / store are to be quoted separately.

Sr. No. d) Type Test Charges: If asked in the technical specification, it is to be quoted separately for each test. e) Charges for Supervision of Erection, Testing & Commissioning (ETC) at **Site**: To be quoted separately if specified in NIT/Price Schedule. f) Charges for Testing & Commissioning at Site: To be quoted separately if specified in NIT/Price Schedule. g) Charges for Erection, Testing & Commissioning at Site: To be quoted separately if specified in NIT/Price Schedule. h) Training Charges: To be quoted separately if specified in NIT/Price Schedule. 2.4 **GST rates** along with HSN/SAC code as applicable on Sr No (a) to (h) above is to be mentioned separately in percentage in both un-priced bid and price bid. Note: i) Unless otherwise specified in the NIT, the purchase order shall be placed on Exworks basis for Indian bidders. ii) Prices quoted by Indian bidders shall be in Indian Rupees only. iii) In case Supervision of Erection, Testing & Commissioning (ETC) at Site or Testing & Commissioning at Site or Erection, Testing & Commissioning at Site is also in scope of the bidder along with supply, bidder has to ensure that prices quoted for such services also are in line with special terms & conditions of the NIT, if any. iv) Unless otherwise specified in the NIT, Unloading at Site / Destination shall not be in the scope of the supplier. v) Prices in respect of Sr No (a) to Sr No (h) of Clause 2.3 above are to be quoted inclusive of all taxes & Duties, charges. Levies, royalty etc. if any, excluding GST. 3. TERMS OF PAYMENT: 3.1 For Supply only in scope of the supplier 100% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows: LR / GR duly endorsed by BHEL Site Official. Material Receipt Certificate issued by BHEL Site Official. **GST Compliant Tax Invoice** Packing List (Case-wise) Copy of Transit Insurance Certificate from underwriters. Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management **Guarantee Certificate** Copy of Performance Bank Guarantee (PBG) Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order. 3.2 For Supply where Supervision of Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier or Supply where Testing &

Commissioning at Site is in scope of the supplier

Sr. No. a) 95% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows: LR / GR duly endorsed by BHEL Site Official. Material Receipt Certificate issued by BHEL Site Official. **GST Compliant Tax Invoice**

- Packing List (Case-wise)
- Copy of Transit Insurance Certificate from underwriters.
- Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management
- **Guarantee Certificate**
- Copy of Performance Bank Guarantee (PBG)
- Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order.
- b) 5% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
- Certificate of successful completion of Supervision of Erection, Testing & Commissioning at Site if it is in the scope of the supplier or Certificate of successful completion of Testing & Commissioning at Site if it is in the scope of the supplier.
- Certificate of completion of final documentation as per Purchase Order / Technical Specification issued by BHEL Engineering Management

3.3 For Supply where Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier

- a) 90% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
- LR / GR duly endorsed by BHEL Site Official.
- Material Receipt Certificate issued by BHEL Site Official.
- **GST Compliant Tax Invoice**
- Packing List (Case-wise)
- Copy of Transit Insurance Certificate from underwriters.
- Material Inspection Clearance Certificate (MICC) issued by BHEL Quality Management
- **Guarantee Certificate**
- Copy of Performance Bank Guarantee (PBG)
- Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management wherever specifically mentioned in the Purchase Order
- b) 10% of payment within 60 days from the date of receipt of complete invoice along with documents in 3 sets (original + 2 copies) as follows:
- Certificate of successful completion of Erection, Testing & Commissioning at Site issued by BHEL Site Official / Construction Management
- Certificate of completion of final documentation as per Purchase Order / Technical Specification issued by BHEL Engineering Management

3.4 For Type Test Charges

100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with copy of Certificate of acceptance of Type Test Reports issued by BHEL Engineering Management in 3 sets (original + 2 copies) on completion of delivery (at site, if F&I is in scope of

Sr. No.

supplier) of main supplies (excluding spares) for which Type Tests are applicable. List of main supplies (excluding spares) for which Type Tests are applicable shall be certified by BHEL Engineering Management.

3.5 For Charges for Supervision of Erection, Testing & Commissioning at Site

100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of successful completion of Supervision of Erection, Testing & Commissioning at Site issued by BHEL Site Official / Construction Management in 3 sets (Original + 2 copies).

3.6 For Charges for Testing & Commissioning at Site

100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of successful completion of Testing & Commissioning at Site issued by BHEL Site Official / Construction Management in 3 sets (Original + 2 copies).

3.7 For Training Charges

100% payment along with applicable GST within 60 days from the date of receipt of complete GST compliant Tax invoice along with certificate of completion of training issued by BHEL Engineering Management in 3 sets (original + 2 copies).

Note:

- Supplier has to submit invoice(s) as per PO or approved billing break-up of prices (if applicable as per NIT).
- ii) In case of supplies for overseas project, Material Receipt Certificate issued by BHEL Authorized Representative shall also be acceptable.
- iii) In case of Transit Insurance under Open Insurance Policy, Intimation / Declaration of Transit Insurance as per terms of the relevant Open Insurance Policy along with copy of Open Insurance Policy from underwriters shall also be acceptable.
- iv) Supplier has to ensure commencement of transit insurance from the date not later than LR / GR date.
- v) Supplier has to submit Tax Invoice(s). Supplier should ensure that Tax Invoice should comply all statutory requirements under GST Law to enable BHEL to avail input credit
- vi) MSMED Act, 2006 and the rules made thereunder as amended from time to time shall be applicable for release of payment to suppliers qualified & registered as Micro & Small Enterprises based on documents mentioned in the NIT for MSME.
- vii) Supplier has to submit PBG (as per BHEL format) & Guarantee Certificate as per PO terms.
- viii) In case any shortages and / or damages in supplies, an amount calculated

Sr. No.

based on comments against Material Receipt Certificate issued by the BHEL Site Official shall be withheld from the supply payment against 3.1(a) or 3.2(a) above to be deemed fit by BHEL subject to a minimum of 10% of the total exworks value of the invoice corresponding to the LR / GR against which any shortages and / or damages are reported. The withheld amount shall be released after the shortages and / or damages in supplies are supplied / replenished against Certification by BHEL Site Official.

- ix) Payment of GST component shall be made only if vendor has deposited the Tax and credit for the same is reflected in GSTN (GST Network). In case credit of the same is not reflected in GSTN, vendor may alternatively furnish BG of GST Amount for a period valid for not less than 1 month. In case of disallowance of credit /non reflection of credit in GSTN, amount will be recovered from supplier along with applicable Interest, penalty etc from any of his dues.
- x) If GST is payable by BHEL on reverse Charge Mechanism basis, vendor should ensure the submission of GST compliant Tax invoice immediately on dispatch/ performance of service. In case of non-compliance any additional charges towards interest, penalty etc, will be to vendors account.
- xi) TDS under GST Act, if applicable, shall be deducted unless Exemption Certificate If applicable, from the appropriate authority is furnished to BHEL along with Invoice.

4. INTEREST LIABILITY:

In case of any delay in payment due to any reason, BHEL shall not pay any interest on delayed payment. Also, no interest shall be payable by BHEL on the bank guarantee / deposit amount or balance payment or any other money which may become due owing to difference or misunderstanding or any dispute before any quasi judicial authority between BHEL and the Supplier / Contractor.

5. **GUARANTEE**:

The equipment / material supplied and services rendered (if applicable) shall be guaranteed to be free from all defects and faults in design & engineering, material, workmanship & manufacture and in full conformity with the Purchase Order / Contract, Technical Specifications & approved drawings / data sheets, if any, for 18 months from the date of last delivery or 12 months from the date of commissioning, whichever is earlier.

Wherever Erection, Testing & Commissioning at Site are also in the scope of the Supplier, the guarantee period shall be 18 months from the date of last delivery or 12 months from the date of commissioning, whichever is later.

The defective equipment / material / component shall be replaced free of cost at site. Freight & Insurance during transit shall also be in the scope of the supplier / contractor. Any expenditure for dismantling and re-erection of the replaced equipment / material / component shall be to supplier / contractor account. All replacements during the guarantee period shall be delivered at site promptly and satisfactorily within a period not more than 45 days from the date of reporting the defect / rejection etc.

In the event of the supplier / contractor failing to replace the defective equipment / material / component within the time period mentioned above, BHEL may proceed to undertake the replacement of such defective equipment / material / component at the risk and cost of the supplier / contractor without prejudice to any other rights under the contract and recover the same from PBG / other dues of this Purchase

BHEL/TBG/GTC/2016 REV 01 Sr. No. Order / Contract or any other Purchase Order / Contract executed by the supplier / contractor. Note: i) In case of Illumination System, items viz. Lamps, Tubes, Ballast, Starters, Capacitors & Fuses will not be under Guarantee after commissioning. ii) In addition to the above guarantee period, Extended Guarantee / Warranty, if any, shall be as per NIT / Technical Specifications. iii) In case offer of agent of Foreign OEM / Foreign Principal is considered, as per Clause No. 1.12 above, Guarantee as mentioned above has to be provided by the Foreign OEM / Foreign Principal also. 6. LATENT DEFECT: Liability for latent defects shall be for defects inherently lying within material or arising out of design deficiency which does not manifest itself during guarantee period but later and shall be limited to five years from the expiry of the guarantee period. 7. PERFORMANCE BANK GUARANTEE (PBG):

Supplier shall arrange to submit Performance BG / Deposit on a non-judicial stamp paper of appropriate value along with first invoice or within 60 days from placement of Purchase Order (PO) whichever is earlier, in line with one of the applicable options as follows:-

Option %+

A single rolling PBG for Rs. 50 Lakhs initially valid for 18 months with claim period of 3 months extra over and above 18 months for all the Purchase Orders being executed for Transmission Business Group, BHEL. However, validity of the PBG shall be extended till 18 months from the date of last delivery with 3 months claim period extra over and above 18 months.

Single Rolling PBG option shall not be applicable in case Ex-works value of the PO at the time of placement of PO exceeds Rs. One Crore.

Option %B+

PBG for 10% of the total Ex-works PO value, valid for 18 months from the date of last delivery with claim period of 3 months extra over and above 18 months. Ex-works PO value at the time of placement of PO shall be considered for calculation of the PBG amount.

Option %G+

In case the total Ex-works PO value at the time of placement of PO does not exceed Rs. Ten Lakhs, interest free Deposit of 10% of the total Ex-works PO value at the time of placement of PO in form of Demand Draft favouring %Bharat Heavy Electricals Limited+ and payable at New Delhi / Delhi / Noida shall also be acceptable to BHEL in lieu of PBG, which shall be released after expiry of 21 months from the date of last delivery after deduction, if any, within 60 days from receipt of invoice in 3 sets (original + 2 copies) to be submitted by the supplier.

Note:

- The Bank Guarantee shall be from any bank as per Annexure for List of Banks (32 Nos.). The original PBG should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida.
- ii) Extension of validity of the PBG in original, as per above clause, should be sent by issuing Bank directly to AGM (Finance), TBG, BHEL, Noida at least 45 days before expiry of validity of the PBG.
- iii) Unless otherwise specified in the NIT, deviation taken for non-submission of PBG / Deposit, as applicable, shall not be accepted.

BHEL/TBG/GTC/2016 REV 01 Sr. No. iv) Supplier has to confirm one of the applicable options for submission of PBG / Deposit before placement of PO. v) In case of non. submission PBG / Deposit, as applicable, BHEL reserve the right for Risk Purchase as per terms of the NIT and impose Suspension of Business Dealings with the Supplier / Contractor. vi) BHEL reserve the right to encash the Bank Guarantee and forfeit the amount in the event of any default, failure or neglect on part of the Supplier in fulfilment of performance of the Purchase Order. vii) Value of the Bank Guarantee (at the time of submission) shall remain unchanged for any subsequent variations in Purchase Order value up to ± 20%. Beyond this variation of ± 20%, the Supplier shall arrange to enhance or may reduce the value of the Bank Guarantee accordingly for the total variation promptly. viii) Vendor to ensure submission of Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, as the case may be, as referred in clause No 9 regarding Final Documentation. BG shall be released only after submission of the same to BHEL TBMM. 8. SUBMISSION OF DRAWINGS / DOCUMENTS FOR APPROVAL: Supplier shall submit the master document list within 7 days from date of Purchase Order / Contract, unless otherwise specified in the NIT, with planned dates for submission which shall be in line with activity schedule as per Purchase Order / Contract and shall be finalized with BHEL Engineering Management. Date of first submission of drawings / documents shall be certified by BHEL Engineering Management after the receipt of applicable drawings / documents (e.g. project specific cover sheet, GTP, OGA drawings, schemes, type test reports etc.) by BHEL. During detailed engineering stage, necessary hard copies of the engineering drawings / documents shall also be submitted by the supplier as per the Purchase Order / Contract requirement. The supplier shall also submit the packing drawings as per technical specifications. In case item(s) offered require any interface details of other item (not in the scope of supplier & required for operating the equipment), the supplier has to submit interfaces schedule along with submission of engineering drawings / documents. It shall be responsibility of the supplier to get the details of the interfaced item from BHEL before manufacturing to avoid any mismatch at site. 9. **FINAL DOCUMENTATION:** Final documentation as called in the Technical /contract specification is to be submitted within 3 months from the date of first delivery of respective equipment, item/material. After submission of Final Documentation, BHEL Engineering Management (TBEM) will issue a Certificate of Completion of Final Documentation. Wherever Final Documentation is not applicable, BHEL Engineering Management (TBEM) will issue confirmation regarding the same, Vendor to submit the Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, as the case may be, to BHEL TBMM. In case of Non Submission of Certificate of Final Documentation /Confirmation regarding Non applicability of Final Documentation, BG will be liable for encashment. 10. **INSPECTION:** BHEL / customer / third party shall inspect equipment / material before despatch. Stage inspection during manufacturing may also be carried out. Material to be

despatched only after getting Material Despatch Clearance Certificate (MDCC) / MICC issued by BHEL.

Supplier shall send inspection call on prescribed format / web site only, with an advance notice of 15 days.

Supplier to ensure submission of all routine / acceptance test reports, inspection

BHEL/TBG/GTC/2016 REV 01 Sr. No. reports and all other documents related to inspection, immediately to BHEL. BHEL representative is authorised to carry out audits along with Third Party Inspection Agency at vendors / suppliers works before clearing the items for despatch. 11. **DESPATCH DOCUMENTS:** Despatch documents to be immediately sent to BHEL on despatch are as follows:-Copy of Invoice Copy of LR / GR in case of Indian suppliers or BL / AWB in case of foreign suppliers Copy of Packing List (Case-wise) Copy of Transit Insurance Certificate from underwriters Copy of Guarantee Certificate 12. **DELIVERY PERIOD:** Delivery / Completion requirement shall be mentioned in the NIT. Bidder to specify best delivery / completion period possible in weeks from the date of LOI / PO as per activity schedule for consideration by BHEL.

Time required for type test, if applicable, is to be separately indicated.

Note:

LR / GR date or invoice date (whichever is later) for indigenous supplies and BL / AWB date for FOB / CIF (if applicable) contracts shall be considered as delivery date.

LIQUIDATED DAMAGES FOR DELAYED DELIVERY: 13.

In case of delay in execution of Purchase Order beyond the contractual delivery time, an amount of 0.5% of the total Purchase Order value for supply (incl. taxes and duties, freight & insurance as applicable) per week of delay or part thereof subject to a maximum of 10% of the total Purchase Order value for supply (incl. taxes and duties, freight & insurance as applicable) shall be deducted as Liquidated Damages (LD) along with applicable GST (if any) on LD.

However, in case of staggered (lot-wise) contractual delivery schedule, an amount of 0.5% of the total Purchase Order value for supply (incl. taxes, duties, freight & insurance as applicable) of delayed lot per week of delay or part thereof subject to maximum of 10% of the total Purchase Order value. (Incl taxes, duties, Freight &Insurance as applicable) shall be deducted as Liquidated Damages (LD) along with applicable GST (if any) on LD.

Note:

- i) In case of any amendment / revision in PO /WO, the LD shall be linked to the amended / revised Purchase Order / Contract value and delivery / completion time / schedule, if applicable,
- ii) LR / GR date or invoice date (whichever is later) for indigenous supplies and BL / AWB date for FOB / CIF (if applicable) for imported supplies shall be treated as the date of dispatch for levying LD as above.
- iii) However, for indigenous supply, if time period between date of receipt of material at site / destination by Site Official & the date of LR / GR or invoice (whichever is later) is more than 30 days, where distance from place of despatch as per LR / GR is upto 1000 Kms or if time period between date of receipt of material at site / destination by Site Official & the date of LR / GR or invoice (whichever is later) is more than 45 days, where distance from place of despatch as per LR / GR is more than 1000 Kms, such excess period shall also be considered for LD purpose.
- iv) If, as per supplier, delay is not attributable to the supplier, delay analysis with documentary evidence may be submitted by the supplier at the earliest but not

Sr. No.			
NO.	later than six months from the end of the financial year in which the payment is withheld. Based on the above details / documents submitted by the supplier, BHEL shall take final decision and if considered appropriate by BHEL, withheld amount (full or part as the case may be) shall be released, otherwise, full or balance withheld amount shall be treated as deduction of Liquidated Damages (LD) towards delayed delivery.		
14.	VALIDITY OF OFFER: The offer shall be valid for 120 days from the due date of opening of tender (i.e. techno-commercial bid unless otherwise specified in the NIT). Prices of Spares, wherever they optional items, shall be valid till two years from the date of placement of PO.		
15.	ACCEPTANCE / REJECTION OF TENDER: BHEL reserve the right to reject in full or part, any or all tender without assigning any reason thereof. BHEL also reserve right to vary the quantities as mentioned in the NIT. Acceptance of offer is subject to vendor approval by customer before opening of price bid.		
	BHEL shall not be bound by any power of attorney granted by tenderer or by changes in composition of the firm made subsequent to award of order / contract. BHEL may however recognize such power of attorney and changes after obtaining proper legal advice, cost of which will be chargeable to the seller / contractor concerned. If the tenderer deliberately gives wrong information, BHEL reserves the right to reject such an offer at any stage or cancel the order / contract, if awarded, and forfeit the security deposit and bank guarantee.		
16.	DEVIATION: The bids having deviation(s) w.r.t. tender are liable for rejection. However, BHEL, at its discretion, may load the prices for evaluation of offer with prior intimation to bidder.		
17.	TENDER EVALUATION: Comparative statement shall be prepared and evaluated on total cost basis at destination/site (as per terms of NIT) considering overall quantity indicated in NIT unless contrary to same is specifically mentioned in the tender enquiry / NIT. Total cost for this purpose shall include cost of scope of work as mentioned in NIT along with applicable taxes & duties, and other services etc. (if applicable). GST input credit available to BHEL shall be reduced from prices while determining L1 status.		
	In case all bidders are foreign & Port of Import (destination port) is same for all the bidders, evaluation of offers shall be done on CIF (Port of Import) basis. Otherwise, evaluation of offers shall be done on the basis of delivered cost at site /destination to BHEL. Further, in case of foreign bidders, marine freight & insurance are to be quoted separately & the purchase order may be placed on FOB basis with an option for delivery on CIF / CFR basis, if required, later.		
18.	In case of foreign bidders, Exchange Rate (TT selling rate of State Bank of India) as on date of tender opening (Part-I Bid in case of two part bid) shall be considered. If the relevant day happens to be a bank holiday, then the forex rate as on the previous bank (SBI) working day shall be taken for tender evaluation. LOADING CRITERIA: List of permissible deviations & loading criteria thereof are as follows:-		
	a) Payment Terms Base rate of SBI (as applicable on the date of bid opening / techno-commercial bid opening in case of two part bids) + 6% shall be considered for loading for the period of relaxation sought by bidder(s) against terms of payment in the NIT.		
	b) Liquidated Damages (LD) for Delayed Delivery		

Sr. No.

Loading on LD clause shall be to the extent to which it is not agreed to by the bidder (at offered value).

- c) In case of foreign bidders, if the quoted prices is on CIF basis only, it shall be loaded to arrive at total FOR (Site / Destination) price, as applicable, by factors as follows:-
 - i) Port handling / clearing charges: @ 1% of CIF value to arrive at Customs Assessable Value.
 - ii) Custom Duty (including CVD & SAD) as per NIT prevailing on date of price bid opening.
 - iii) Inland Freight & Transit Insurance: @ 5% of CIF value where distance between site / destination and Port of Discharge is upto 1000 Kms or @ 7% of CIF value where distance between site / destination and Port of Discharge is more than 1000 Kms.

Note:

Additional deviations (if considered acceptable by BHEL) & the loading criteria shall be communicated to all the qualified bidders before price bid opening.

19. ARBITRATION:

In the event of any dispute emanating from and relating to this contract, the matter shall be referred to the sole arbitration of the person appointed by the competent authority of BHEL. Subject to aforesaid, the provisions of ‰he Arbitration and Conciliation Act, 1996+and the rules made thereunder as amended from time to time in India shall apply to the arbitration proceedings. The venue of arbitration shall be in New Delhi.

Further there shall be no claim for any pre-reference or pendente-lite interest on the claims and any claim for such interest made shall be void.

However, in case of contract with Public Sector Enterprise / Undertaking (PSE/PSU) or Govt. Dept., the extant guidelines of Govt. of India shall be followed.

20. LEGAL SETTLEMENT:

Indian Courts at New Delhi / Delhi shall have exclusive jurisdiction to decide the dispute, if any, arising out of or in respect of the contract(s) to which these conditions are applicable. Contract, including all matters connected with contract, shall be governed by the Indian Law, both substantive and procedural, for the time being in force including modification thereto.

21. SUB-CONTRACTING:

In case further subcontracting of BHEL Purchase Order / Contract or part thereof is envisaged by supplier, the same can be done after written permission is obtained from BHEL. However it shall not absolve the Supplier / Contractor of the responsibility of fulfilling BHEL Purchase Order / Contract requirements. In case of subcontracting of Purchase Order / Contract awarded by BHEL or part thereof without such permission, BHEL reserve the right to cancel the Purchase Order / Contract and source such material / component / equipment / system from any other agency at the risk and cost of the Supplier / Contractor.

If Supplier / Contractor is an individual or proprietary concern and the individual or the proprietor dies or the partnership is dissolved or substantially affected, then unless BHEL is satisfied that legal representative of individual Supplier / Contractor or proprietor of proprietary concern and surviving partners of partnership firm are capable of carrying out and completing the Purchase Order / Contract, BHEL shall be entitled to cancel the Purchase Order / Contract as to its incomplete portion and without being in any way liable to payment of any compensation to legal representative of Supplier / Contractor and / or to surviving partners of Suppliercs / Contractors firm on account of cancellation of the Purchase Order / Contract.

Decision of BHEL that legal representatives of deceased Supplier / Contractor or

BHEL/TBG/GTC/2016 REV 01 Sr. No. surviving partners of the Suppliers / Contractors firm cannot carry out and complete the Purchase Order / Contract shall be final and binding on the parties hereto. Terms and Conditions shall not get affected in case of de-merger / amalgamation / taking-over / re-constitution etc. 22. **RISK PURCHASE:** In case the Supplier / Contractor fails to supply or fails to comply with terms & conditions of the Purchase Order / Contract or delivers equipment / material not of the contracted quality or fails to adhere to the contract specifications or fails to perform as per the activity schedule and there are sufficient reasons even before expiry of the delivery / completion period to justify that supplies shall be inordinately delayed beyond contractual delivery / completion period, BHEL reserve the right to cancel the Purchase Order / Contract either in whole or in part thereof without compensation to Supplier / Contractor and if BHEL so desires, may procure such equipment / material / items not delivered or others of similar description where equipment / material / items exactly complying with particulars are not readily procurable in the opinion of BHEL which is final and in such manner as deemed appropriate, at the risk and cost of the Supplier / Contractor and the Supplier / Contractor shall be liable to BHEL for any excess cost to BHEL. However, the Supplier / Contractor shall continue execution of the Purchase Order / Contract to the extent not cancelled under the provisions of this clause. Recovery amount on account of purchases made by BHEL at the risk and cost of Supplier / Contractor shall be the difference of total value of new Purchase Order (PO) value and total value of old Purchase Order for applicable items, where the total value of new PO is more than total value of old PO for applicable items, plus additional 15% of the total ex-works value of new PO as overheads. The Supplier / Contractor shall on no account be entitled to any gain on such risk & cost purchase. In case the purchase order (PO) value of the new PO is less than the PO value of the old PO, 15% of the total ex-works value of the new PO shall be recovered as overheads and the difference between the PO value of the old PO and

the new PO shall not be considered for calculation of the recovery amount.

ADJUSTMENT OF RECOVERY: 23.

Any amount payable by the Supplier / Contractor under any of the condition of this contract shall be liable to be adjusted against any amount payable to the Supplier / Contractor under any other Purchase Order / Contract awarded to him by any BHEL unit. This is without prejudice to any other action, as may be deemed fit, by BHEL.

24. **FORCE MAJEURE CONDITION:**

If by reason of war, civil commotion, act of god, Government restrictions, strike, lockout which are not in control of Supplier / Contractor the deliveries / services are delayed, Supplier / Contractor shall not be held responsible.

If at any time during the continuance of the Purchase Order / Contract, the performance in whole or in part by either party of any obligations under the Purchase Order / Contract is prevented or delayed by reason of any war hostilities, acts of the public enemy, restrictions by Govt. of India, civil commotion, sabotage, fires, floods, explosion, epidemics, quarantine restrictions, strike, lock-outs or acts of God (hereinafter referred to as \&vent+), which are not in control of Supplier / Contractor or BHEL, then provided notice of the happening of such event is given by either party to the other within fifteen (15) days from the date of occurrence thereof, neither party shall by reason of such event be entitled to terminate the Purchase Order / Contract nor shall have any claim for damages against each other in respect of such non-performance and delay in performance. Performance under the Purchase Order / Contract shall be resumed immediately after such event has come to an end or

BHEL/TBG/GTC/2016 REV 01 Sr. No. ceased to exist and decision of BHEL as to whether the deliveries have to be resumed or not shall be final, conclusive and binding on the parties hereto. In the event of the parties hereto not able to agree that a force majeure event has occurred, the parties shall submit the disputes for resolution pursuant to the provisions hereunder, provided that the burden of proof as to whether a force majeure event has occurred shall be upon the party claiming such an event. Notwithstanding above provisions, BHEL shall reserve the right to cancel the Purchase Order / Contract, wholly or partly, in order to meet the overall project schedule and make alternative arrangements for completion of delivery and other schedules. 25. **MANUFACTURING QUALITY PLAN (MQP):** Supplier to submit approved MQP in line with requirement of BHEL/customer. 26. **SUPPLIER PERFORMANCE MONITORING AND RATING SYSTEM:** BHEL reserve the right for evaluation of Supplier Performance Rating as per Supplier Performance Monitoring and Rating System of BHEL for necessary action. Details are available at BHEL Website www.bhel.com for reference.

27. **DEALING WITH BANNED SUPPLIERS / CONTRACTORS IN BHEL:**

Offers of the bidders, who are on the banned list, as also the offers of the bidders who engage the services of the banned firms, shall be rejected. The list of banned firms is available on BHEL website www.bhel.com for reference.

28. **ORDER OF PRECEDENCE:**

The order of precedence shall be as follows:-

- a) Special Terms & Conditions (STC) for Tender Enquiry / Contract, if any
- b) General Terms & Conditions (GTC) for Tender Enquiry / Contract & Additional General Terms & Conditions (GTC) for Tender Enquiry / Contract for Erection Testing & Commissioning (ETC) at Site, if applicable

Provisions in (a) above shall prevail over (b). In case of conflict, between Technical Specifications and STC / GTC, bidder to seek necessary clarifications from BHEL concerned official as specified in NIT.

29. **PACKING:**

Packing shall be in conformity with specifications and shall be such as to ensure prevention of damages, corrosion, deterioration, shortages, pilferage and loss in transit or storage.

In case of shipment by sea or air, the packing shall be sea-worthy or air-worthy respectively and of international standards.

Different types of spares i.e. start-up / commissioning spares and initial spares (mandatory spares and recommended O&M spares) are to be packed separately.

Packing List shall be submitted as per standard format along with advance set of documents for claiming payment which shall also indicate :-

- a) Case / Packing size (as applicable).
- b) Gross weight and net weight of each package.
- c) Detailed contents of the package with quantity of each item separately.

Project, Item / Package Description, BHELos PO No. with date & Case / Packing Mark should also be clearly mentioned on the Case / Packing and Packing List for identification. Also, Packing List must be duly signed & should include respective Invoice No. & LR No.

Note:

Foreign suppliers to furnish details to arrange inland transportation by BHEL, if applicable, as follows:-

- i) No. of Packages
- ii) Size with Weight (Gross & Net) of each Package
- iii) No. of Containers with type & size required for inland transportation

BHEL/TBG/GTC/2016 REV 01 Sr. No. iv) Type of Cargo (Break Bulk / LCL / FCL) v) Customs Tariff No. **COLOUR CODING:** 30. Aluminium stickers are required to be attached to large components but plastic sheet tags should be tied with small components, giving details like purchase order, description of the component, quantity etc. Tags should be of the colour as follows:a) Main equipment: Yellow or White tag b) Start-up / Commissioning spares : Blue tag c) Mandatory spares: Pink or Red tag d) Recommended / O&M spares : Green tag 31. MICRO, SMALL & MEDIUM ENTERPRISES (MSME): MSMED Act 2006 as amended from time to time & extant regulations of Govt. of India for MSME will be applicable. Micro & Small Enterprises (MSE) can avail the intended benefits only if they submit along with the offer / bid, attested copies of either Acknowledgement of Entrepreneur Memorandum Part-II (EM-II certificate) having deemed validity (five years from the date of issue of acknowledgement in EM-II) or valid NSIC certificate or EM-II certificate along with attested copy of a CA certificate (As per BHEL format where deemed validity of EM-II certificate of five years have expired) applicable for the relevant financial year (latest audited). Date to be reckoned for determining the deemed validity will be the date of opening (for Techno-commercial Bid : Part-I in case of two part bid). Non-submission of such documents will lead to consideration of their bid at par with other bidders. No benefit shall be applicable for this enquiry if any deficiency in the above required documents are not submitted before price bid opening. If the tender is to be submitted through e-procurement portal, then the above required documents are to be uploaded on the portal. Documents should be notarized or arrested (in original) by a Gazetted officer. Copy of Udyog Aadhaar Memorandum with Acknowledgement of Ministry of Micro, Small & Medium Enterprises should also be furnished. BUSINESS ETHICS / SUSPENSION OF BUSINESS DEALINGS 32. WITH **SUPPLIERS / CONTRACTORS:** If any bidder / supplier / contractor during pre-tendering / tendering / post tendering / award / execution / post-execution, indulges in malpractices cheating, bribery, fraud or other misconduct or formation of cartel so as to influence the bidding process or

If any bidder / supplier / contractor during pre-tendering / tendering / post tendering / award / execution / post-execution, indulges in malpractices cheating, bribery, fraud or other misconduct or formation of cartel so as to influence the bidding process or influences the price or fails to perform or is in default without any reasonable cause etc or performs any act considered objectionable as per extant guidelines, action may be taken against such bidders/supplier/contractor as per extant Guidelines for Suspension of Business Dealings with Suppliers/Contractors+. Abridged version of same is available at BHEL website (www.bhel.com) on Supplier Registration+Page.

33. REVERSE AUCTION:

BHEL reserve the right to go for Reverse Auction (RA) instead of opening the sealed envelope price bid, submitted by the bidder or price bid submitted by the bidder through e-procurement system. This will be decided after techno-commercial evaluation. All bidders to give their acceptance for participation in RA. Non-acceptance to participate in RA may result in non-consideration of their bids, in case BHEL decides to go for RA.

In case BHEL decides to go for Reverse Auction, only those bidders who have given their unconditional acceptance to participate in RA will be allowed to participate in the Reverse Auction. Those bidders who have given their acceptance to participate in Reverse Auction will have to necessarily submit %unline sealed bid in the Reverse Auction. Non-submission of %unline sealed bid by the bidder will be considered as tampering of the tender process and will invite action by BHEL as per extant guidelines in vogue.

General Terms and Conditions of RA are available at Annexure. Business Rules for

Sr. No. RA shall be sent to the bidders before conducting RA. Abridged Version of Common Guidelines for Conducting Reverse Auction+may also be seen at BHEL website (www.bhel.com) on % Supplier Registration+ Page & ‰ender Notifications+Page. 34. **INTEGRITY PACT:** Bidders shall have to enter into Integrity Pact with BHEL, duly signed with seal in original, if specified in NIT / RFQ failing which bidders offer shall be liable for rejection. 35. TERMINATION OF CONTRACT: BHEL shall have the right to cancel the Purchase Order / Contract without any financial implication to BHEL if vendor approval by end user / customer is withdrawn or in case of Suspension of Business Dealings with the Suppliers / Contractors by BHEL. BHEL shall have the right to cancel Purchase Order / Contract, wholly or in part, in case they are obliged to do so on account of any decline, diminution, curtailment or stoppage of their business and in that event, the Suppliercs / Contractor' compensation claim shall be settled mutually. In case of cancellation of Purchase Order / Contract for main supply, all other associated Purchase Orders / Contracts like those for Mandatory Spares / Recommended Spares / Erection, Testing & Commissioning (ETC) / Supervision of ETC, if any, would also get cancelled. **SHELF LIFE:** 36. Supplier has to inform the list of the items / sub-items which have limited shelf life like consumables or those required for the first fill and shall indicate the corresponding shelf life period in the offer. Such items / sub-items shall be manufactured / despatched only after getting formal clearance from BHEL. 37. **LIMITATION OF LIABILITY:** Notwithstanding any other provisions, except in cases of wilful misconduct and / or criminal negligence / acts, a) Neither the Supplier / Contractor nor BHEL shall be liable to the other, whether in Purchase Order / Contract, tort, or otherwise, for any consequential loss or damage, loss of use, loss of production or loss of profits or interest costs, provided however that this exclusion shall not apply to any obligation of the Supplier / Contractor to pay Liquidated Damages to the BHEL and b) Notwithstanding any other provisions incorporated elsewhere in the contract, the aggregate liability of the Contractor in respect of this contract, whether under the Contract, in tort or otherwise, shall not exceed total Contract Price, provided however that this limitation shall not apply to any obligation of the Vendor to indemnify BHEL with respect to Patent Infringement or Intellectual Property Rights. 38. **SHORTAGES / DAMAGES:** a) Against Supply only or Supply where Supervision of Erection, Testing & Commissioning (ETC) at Site or Supply where Testing & Commissioning at Site is in scope of the supplier: Any shortages and / or damages in supplies shall be supplied / replenished free of cost by the supplier as early as possible but not later than 30 days from the date of intimation by BHEL to the supplier. b) Against Supply where Erection, Testing & Commissioning (ETC) at Site is in scope of the supplier:

	T
Sr. No.	
NO.	Any shortages and / or damages in supplies and during handling / storage, erection, testing and commissioning at site shall be supplied / replenished free of cost by the Supplier / Contractor, as early as possible, to meet the contractual completion time / schedule.
	Note: There shall not be any extension in the contractual delivery time / schedule due to any shortages and / or damages in supplies.
39.	VARIATION OF CONTRACT VALUE / QUANTITY VARIATION: BHEL shall have the right to variation in quantities of items within ± 30% of the total Purchase Order / Contract value at the time of placement of PO or award of Contract on overall basis for all amendments together within two years from the date of original Purchase Order / Contract or completion of execution of the Purchase Order / Contract whichever is earlier but quantities of individual items may vary to any extent or may get deleted unless otherwise specified in the technical specifications. No compensation is payable due to variation in the quantities and the Supplier / Contractor shall be bound to accept the same the contracted prices / rates without any escalation. However, if the Purchase Order / Contract is on ‰umpsum+basis, no variation of Purchase Order / Contract value shall be admissible to the Supplier / Contractor within the scope of Purchase Order / Contract, as long as the inputs remain unchanged.
40.	STATUTORY VARIATION: GST rates prevailing at the time of dispatch of goods / completion of services shall be payable by BHEL. All other taxes, duties, charges, royalty, cess, other levies shall be deemed to be included in the Ex Works Prices / Charges quoted by bidders and no variations shall be payable in respect thereof. No other variations such as on customs duty, exchange rate, minimum wages, prices of controlled commodities, any other input etc. shall be payable by the BHEL.
	Notwithstanding anything above, where the actual completion of the supply / services occurs beyond the period stipulated in the Purchase Order / Contract or any extension thereof, variations referred to above, will be limited to the rates prevailing on the dates of such agreed completion periods only. For variations after the agreed completion periods, the Supplier / Contractor alone shall bear the impact for the upward revisions and for downward revisions BHEL shall be given the benefit of reduction in applicable taxes /GST. This will be without prejudice to the levy of liquidated damages for delay in delivery / completion.
	If new tax is introduced by Central/ State Govt / Municipality becomes directly applicable on items specified in Bill of Quantities/Purchase Order/Contract, full reimbursements shall be made provided it becomes applicable on items specified in Bill of Quantities.
	However, any additional tax implication due to delay in delivery, beyond the Contractual Delivery, attributable to supplier shall be borne by supplier.
41.	MODE OF PAYMENT: Payment shall be made directly to the Supplier / Contractor by BHEL through NEFT / RTGS.
42.	CONFIDENTIALITY: Supplier / Contractor shall, at all times, undertake to maintain complete confidentiality of all data, information, software, drawings & documents etc. belonging to BHEL and also of systems, procedures, reports, input documents, manuals, results and any other BHEL documents discussed and / or finalized during the course of execution of Purchase Order / Contract.
43.	INDEMNIFICATION: The Supplier / Contractor shall indemnify and keep indemnified and hold harmless BHEL and its employees and officers from and against any and all claims, suits, actions or administrative proceedings, demands, losses, damages, costs and

Sr. No. expenses and any other claim of whatsoever nature in respect of the death or injury of any person or loss of or damage to any property arising during the course and out of the execution of the Purchase Order / Contract. 44. TITLE OF GOODS: a) Ownership of the equipment / material procured in India, shall be transferred to BHEL upon loading on to the mode of transport to be used for transportation of the said equipment / material from the works to the site / destination and upon endorsement of the dispatch documents in favour of BHEL. b) Ownership of the equipment / material to be imported into the country where the site is located, if not procured in India, shall be transferred to BHEL upon loading on the mode of transport to be used for transportation of the equipment / material from the country of origin to that country / destination and upon endorsement of despatch document in favour of BHEL. c) Notwithstanding the transfer of ownership of the equipment / material, the responsibility for care and safe custody thereof together with the risk of loss or damage thereto for whatsoever reason shall remain with the Supplier. 45. **COMPLIANCE OF STATUTORY REQUIREMENTS:** The vendor shall comply with all State and Central Laws / Acts, Statutory Rules, Regulations etc., as may be enacted by the Government during the tenure of the Purchase Order / Contract and having in force and applicable to the Purchase Order / Contract and nothing shall be done by the Supplier / Contractor in contravention of any Law / Act and / or Rules / Regulations, thereunder or any amendment thereof. The Supplier / Contractor shall pay all taxes, fees, licence charges / deposits, duties, tolls, royalty, commissions or other charges which may be levied on account of any of his operations connected with the Purchase Order / Contract. In case BHEL is constrained to make any of such payments, BHEL shall recover the same from the Supplier / Contractor either from moneys due to him or otherwise as deemed fit. 46. **ACCEPTANCE OF ORDER:** Supplier should acknowledge and accept the Letter of Award / Purchase Order issued by BHEL within 7 days of the issue of Letter of Award / Purchase Order. In case of any discrepancy / typographical error in issue of Purchase Order / Contract, the agreed terms & conditions, scope of work, rates / prices for placement of PO / award of contract shall be applicable and BHEL reserves the right to issue amendment(s) to PO / Contract for correction of discrepancies / typographical errors in the PO / Contract at a later date. 47. FRAUD PREVENTION POLICY: The Bidder along with its associate / collaborators / sub-contractors / sub-vendors / consultants / service providers shall strictly adhere to BHEL Fraud Prevention Policy displayed on BHEL website http://www.bhel.com and shall immediately bring to the notice of BHEL Management about any fraud or suspected fraud as soon as it comes to their notice.

Signature of Bidder (Authorized Signatory) with Date & Seal



BHARAT HEAVY ELECTRICALS LIMITED TRANSMISSION PROJECTS ENGINEERING MANAGEMENT

DOCUMENT No.	TB-437-510-017	Rev. No.	00		Prepared	Checked	Approved
TYPE OF DOC.	TECHNICAL SPECIF	ICATION		NAME	Vrom	MM	MM
TITLE				SIGN	alin	Met C	45011
765kV CU	765kV CURRENT TRANSFORMER			DATE	02.08.25	02.08.25	02.08.25
				GROUP	TBEM	W.O. No	437

CUSTOMER | POWERGRID Corporation of India Ltd (PGCIL)

PROJECTS

Section

The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in anyway detrimental to the interest of the company

COPYRIGHT AND CONFIDENTIALITY

Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

No. of Sheets

REVISION DETAILS

TBCM

TBTS

TBQM

CONTENTS

Description

Section	Description	110. Of Bileets
1.	TECHNICAL PRE-QUALIFICATION REQUIREMENT Annexure TQR	02
2.	Scope, Specific Technical Requirements and Quantities	05
**	Annexure -A: PROJECT WISE BILL OF QUANTITY	01
	4 2	
3.	Equipment Specification	18
4.	Project Details and General Specification	68
5.	Section 4 Compliance Certificate of Technical Specification Deviation(s) of Technical Specification	02
6.	Check List (To be submitted at Tender Stage)	05
7.	Section 6 – General Technical Particular	04

Approved

Distribution

TBMM

File No. TBG-TBMMoPROC(CT)/3/2025-TBG-TBG_MM1 (Computer No. 217417)

Date

Rev No.

Altered Checked



COPYRIGHT AND CONFIDENTIALITY

BHARAT HEAVY ELECTRICALS LIMITED TRANSMISSION PROJECTS ENGINEERING MANAGEMENT

TRANSMISSION PROJECTS ENGINEERING MANAGEMENT											
DOCUMENT	TB-437-	510-017	Rev	v. No.	00		Prepared	Checked	Approve		
No. TYPE OF			CIFICATIO)N		NAME	Vyom	MM	MM		
DOC. TITLE						SIGN					
765kV CU	RRENT	TRAN	SFORM	ER		DATE	02.08.25	02.08.25	02.08.25		
						GROUP	TBEM	W.O. No	437		
CUSTOMER	POWER	RGRID (Corporati	on of I	ndia Lt	d (PGCI	L)	•			
PROJECTS	Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/external 400kV GIS Substation at KPS2 associated with "Transmission Evacuation of power from potential renewable energy zone in Gujarat under Phase-V (8 GW): Part A" through Tariff Based Bidding (TBCB) route.								nsion of existing a System for Khavda area of		
CONTENTS											
Section			Des	scripti	on			No. of	Shee		
 1. 2. 3. 	Scope, S Annexur	Annexure TQR Scope, Specific Technical Requirements and Quantities Annexure -A: PROJECT WISE BILL OF QUANTITY Equipment Specification						02 05 01			
4.	Project I	Project Details and General Specification							68		
5.	Complia	Section 4 Compliance Certificate of Technical Specification Deviation(s) of Technical Specification					02				
6.	Check List (To be submitted at Tender Stage)						05				
7.	Section	6 – Gene	ral Techi	nical Pa	articula	r			04		
Rev No.	Date	Altered	Checked		roved			N DETAIL			
			2	Distri	bution	TBMM	TBQM	TBCM	TBTS		

Copies

File No. TBG-TBMM0PROC(CT)/3/2025-TBG-TBG_MM1 (Computer No. 217417)

TECHNICAL PRE QUALIFICATION REQUIREMENT

Name of Project : Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Name of Customer : POWERGRID

Name of Consultant : POWERGRID

Name of Item

: 765kV CURRENT TRANSFORMER

TECHNICAL PRE-QUALIFICATION REQUIREMENT

Indenter to Tick ($\sqrt{\ }$)

Technical PQR is based on

Customer PQR 7;

Customised PQR □;

Standard PQR □

- The manufacturer whose 765/400/220/132kV/110kV * Current Transformer are (i) offered, must have manufactured, type tested (as per IS/IEC or equivalent standard) and supplied 715/345/220/132kV* or higher voltage class equipment(s), which are in satisfactory operation# for at least two (2) years as on date of NOA.
- (ii) Alternatively, the manufacturer, who have established manufacturing and testing facilities in India for the offered equipment(s) and not meeting the requirement stipulated in (i) above, can also be considered provided that:
 - a) 715/345/220/132kV/110kV* or higher Voltage class equipment(s) must have been manufactured in the above Indian works & type tested (as per IS/IEC standard) as on date of NOA
 - b) In case manufacturer meets the technical requirement through clause (ii) above, warranty obligations for additional warranty of two(2) years over & above the warranty period as specified in the bidding documents shall be applicable for the entire quantity of the offered equipment to be supplied under the contract.

*: voltage class of respective equipment as applicable.

#: satisfactory operation means certificate issued by the Employer/Utility certifying the operation without any adverse remark.

NOTE: The date of NOA shall be 22 Nov 2024

Indenter to identi	Indenter to identify and tick ($\sqrt{\ }$) type of bidder from the following						
Manufacturer ;	Supplier □;	Authorised agent* of OEM □	System Integrator □				
(*) Agent/ Supplier au	thorised by OEM f	or sale and after-sales support, Guaran	tee/ Warrantee, as applicable				

Uma more	PORTING DOCUMENT applicable as per PQ requ	
Sr	Required Criteria	Supporting Documents to be submitted by bidder along with technical bid
1	Manufacturing	Approved Drawings / GTP / Approved Quality Plan / Factory Inspection Test Report e.t.c
2	Supply	PO / Dispatch clearance / LR / Material Receipt certificate at site / installation or commissioning certificate e.t.c
3	Satisfactory operation	Certificate issued by the Employer/Utility certifying the operation without any adverse remark.

Notes (General points):

- 1. Consideration of offer shall be subject to customer's approval of bidder's, if applicable.
- 2. Bidder to submit all supporting documents in English. If documents submitted by bidder are in language other than English, a self- attested English translated document should also be submitted.
- 3. Notwithstanding anything stated above, BHEL reserves the right to assess the capabilities and capacity of the bidder to perform the contract, should the circumstances warrant such assessment in the overall interest of BHEL.
- 4. After satisfactory fulfilment of all the above criteria / requirement, offer shall be considered for further evaluation as per NIT and all the other terms of the tender.

PREPARED BY

Vvom

Manager/TBEM

REVIEWED BY

Muneet Mehta Sr DGM/TBEM APPROVED BY

Muneet Mehta Sr DGM/TBEM Project: Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur

(HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

SECTION 1

SCOPE, SPECIFIC TECHNICAL REQUIREMENTS AND QUANTITIES

1.0 SCOPE

This technical specification covers the requirements of design, manufacture, testing at works, packing and dispatch of Current Transformers complete with accessories as listed in clause 5.0 below. This section covers the specific technical requirements of 765kV CT.

The specification comprises of following sections:

Section-1: Scope, Specific Technical Requirements & Quantities

Section-2: Equipment Specification

Section-3: Project Details & General Technical Requirements

Section-4: Guaranteed Technical Particulars

Section-5: Checklist

In case of any conflict between various sections, <u>order of precedence</u> shall be in the same order as listed above.

<u>Note:</u> The terms used in this specification namely, "Employer/Purchaser" refers to POWERGRID & "Contractor/Sub-contractor/manufacturer" refers to successful bidder.

2.0 THE EQUIPMENT IS REQUIRED FOR THE FOLLOWING PROJECT

Name of Customer: POWERGRID Corporation of India Ltd (PGCIL)

Name of the Project:

Package-I for \pm 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Refer Section - 3 for Project Details and General Specifications.

3.0 SPECIFIC TECHNICAL REQUIREMENTS

a. Technical Parameters of 765kV CT:

S.No.	Description of parameters	Data
1.	Max. System Voltage	800kV
2.	Rated frequency	50 Hz
3.	System Fault Level	50kA for 1 Sec
4.	Min. Creepage Distance	20000mm

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

CTs must have adequate provision for taking oil samples from the bottom of the CT without exposure to atmosphere. Manufacturer shall recommend the frequency at which oil samples should be taken and norms for various gases in oil after being in operation for different durations. Manufacturer should also indicate the total quantity of oil which can be withdrawn from CT for gas analysis before refilling or further treatment of CT becomes necessary.

Manufacturer/Contractor shall supply 2 nos. of oil sampling device for every 20 nos. of oil filled CT, supplied with a minimum of 2 nos. of oil sampling device, for each substation.

b. 765kV CT Parameters:

Refer - Section II, Table -IIA

For detailed Technical requirements refer Section-2 of the Technical Specification.

4.0 TECHNICAL PRE-QUALIFYING REQUIREMENTS:

Refer - Annexure-TQR

5.0 PRECOMMISSIONING AND COMMISSIONING:

An indicative list of tests is specified in Section -II, 9.2 (i,j)

The bidder shall perform all pre-commissioning tests including any additional tests based on specialties of the items as per approved field Q.P / Instructions of equipment supplier without any extra cost to BHEL / Customer. The bidder shall arrange all special instruments required for conducting these tests along with calibration certificates and shall furnish the list of instruments for approval.

"Commissioning checks"," installation checks", "Site tests" wherever mentioned in the Specification shall be considered as pre-commissioning checks.

Note: The respective dates of commencement of erection, pre-commissioning and commissioning activity by BHEL will be intimated to the equipment manufacturer from time to time, so that arrangements for supervising the activity can be made accordingly by the manufacturer

(However, the travel, lodging and boarding expenses for each visit of the bidder's engineers shall be borne by the bidder).

6.0 MANUFACTURING QUALITY PLAN:

Bidder has to follow POWERGRID approved Manufacturing Quality Plan, SAT /FAT procedure at contract stage.

7.0 BILL OF OUANTITES:

As per annexure-A, Section-1.

6

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

8.0 TYPE TEST:

NOTE: The date of NOA shall be 22 Nov 2024

- a. All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under 6.0 of section II.
- b. The reports for all type tests as per technical specification shall be furnished by the bidder along with equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all project with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID or representative authorized by POWERGRID or Utility or representative of accredited test lab or reputed consultant.

The type test reports submitted shall be of the tests conducted within last 10 (ten) years prior to the date of NOA In case the test reports are of the test conducted_earlier than 10 (ten) years prior the date of NOA, the bidder shall repeat these test(s) at no extra cost to BHEL.

In the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes (including substitution of components) or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost and delivery implication to the Purchaser.

The supplier shall intimate the BHEL/POWERGRID the detailed program about the tests atleast two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

In case type tests are to be conducted /repeated and deputation of Inspectors/Purchasers representative is required, then all expenses shall be borne by Bidder

9.0 PACKING:

- 9.1 All equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and outdoor storage (for a minimum period of 6 months) at site till the time of erection. While packing all the materials, the limitations from the point of view of availability of transportation facilities in India should be considered. The Bidder shall be responsible for any loss or damage during transportation, handling and storage.
- **9.2** The Bidder shall include and provide for security, protection and packing the equipment so as to avoid loss or damage during transport by any mode.

7

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

- 9.3 All packing shall allow for easy removal and checking at site. Wherever necessary, proper arrangement for attaching slings for lifting shall be provided. All packages shall be clearly marked for with signs showing 'UP' and 'DOWN' side of boxes, and handling and unpacking instructions as considered necessary. Special precautions shall be taken to prevent rusting of steel and iron parts during transit and storage. Gas seals or other methods proposed to be adopted for protection against moisture during transit shall be to the satisfaction of the purchaser.
- 9.4 The cases containing easily damageable material shall be very carefully packed and marked with appropriate caution symbols i.e. FRAGILE, HANDLE WITH CARE, USE NO HOOKS etc.
- 9.5 Each package delivered under the contract shall be marked by the Bidder at his expense and such marking must be distinct (all previous irrelevant marking being carefully obliterated). Such marking shall show the description and quantity of contents, the name of consignee and address, the gross and net weights of the package, the name of Bidder with a distinctive number of mark sufficient for purpose of identification. All markings shall be carried out with such materials as to ensure quickness of drying, fastness and legibility.
- 9.6 Each Package shall contain a note quoting specifically the name of the Bidder, the number and date of contract or order and the name of office placing the contract, nomenclature of the stores and include a schedule of parts for each complete equipment giving the parts number with reference to the General Arrangement/ Assembly drawing and the quantity of each part, drawing number and tag numbers.
- 9.7 All equipment/ material shall be suitably packed for transport, carriage at site and outdoor storage during transit. The Bidder shall be responsible for any damage to the equipment during transit. The contents of each package shall bear marking that can be readily identified from the package list and packing shall provide complete protection from moisture, termites and mechanical shocks etc.
- **9.8** Any material found short inside the packing cases shall be supplied by the Bidder without any extra cost.
- **9.9** Notwithstanding anything stated in this clause the Bidder shall be entirely responsible for any loss, damage or depreciation to the stores.

10.0 DEVIATIONS:

The bidder shall list all the deviation from the specification separately. Offers without specific deviation will be deemed to be totally in compliance with the specification and NO DEVIATION on any account will be entertained at a later date.

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017


Technical Specification: 765kV CURRENT TRANSFORMER

11.0 DRAWINGS and SCHEME:

The documentation requirements detailed under Section-2 and 3 shall be submitted to BHEL at various stages of contract. Softcopy of the drawings and schemes are to be submitted at contract stage. Preparation of AS- BUILT drawings is also in the scope of the bidder.

12.0 DOCUMENTS REQUIRED WITH TECHNICAL OFFER:

- a) Clause-wise confirmation/ comments
- b) Bill of Materials
- c) Unpriced schedule of Unit Prices
- d) Filled-up Guaranteed Technical Particulars
- e) Catalogue and Technical Leaflets for the offered Equipments



Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

ANNEXURE-A PROJECT WISE BILL OF QUANTITY

SN	Description	Unit	QUANTITY
Ia	765kV,3000A ,50kA for 1sec with 120% extended current rating, 6 Core, 1ph Current Transformer complete in all respect.	No.	54
Ιb	Supervision of Testing (or Pre-commissioning)	No.	54
Ιc	Spare: 765kV,3000A,50kA for 1sec with 120% extended current rating, 6 Core, 1ph Current Transformer complete in all respect.	Nos	3

NOTE:

- 1) The Quantity is subject to change by +/-10%
- 2) Hardware (Nut, Bolts and washers) for mounting CT on structure One (1) set for each CT to be included by the bidder in their offer.
- 3) Multiple visits for Supervision of testing the CTs for respective project site are envisaged for each lot against Sl. No. Ib above.
- 4) Prices for Oil Sampling & supply of oil sampling devices (as applicable) as per TS is deemed to be included in the prices quoted against Ia.
- 5) BHEL shall procure support structure, terminal clamps & connectors and Junction Box separately.
- 6) Dissolved Gas Analysis (DGA) shall be carried as per Cl:9.2 Section-II. The sampling (including equipment for sampling) shall be under the scope of the bidder.
- 7) BHEL shall bear the charges for sending the sample to laboratory and laboratory testing.

-----xxx------

SECTION-II EQUIPMENT SPECIFICATION

Following are the major changes made in the Technical specification, Section-Switchgear-INST, Rev. 11:

Clause No.	Major Modification
1.	New IEC-61869 referred. IEC-60044 is superseded by IEC-61869
2.	245kV and above rating CT are acceptable with Polymer Insulator
3.	Cantilever strength for 72.5kV Instrument Transformer specified
4.	Live Tank CT shall be preferably of Bar primary design with SS
	Bellow
5.	Type test & Special test requirements mentioned in line with IEC-
	61869
6.	DGA sampling after commissioning elaborated
7.	Requirement of Oil sampling device added
8.	Defect liability clause added for actions required in case of defects
	observed during warrantee period
9.	Protection class of CT mentioned as "PX class" in line with IEC-
	61869

<u>Note:</u> The above is the list of major changes with respect to previous revision (Rev. 10). However, the bidders are advised to read the entire section/chapter for other changes and quote accordingly.

SECTION-II EQUIPMENT SPECIFICATION

SECTION-SWITCHGEAR-INST

INSTRUMENT TRANSFORMERS

1.0 GENERAL:

1.1 The instrument transformers and accessories shall conform to the latest version of the standards specified below except to the extent explicitly modified in this specification and shall be in accordance with the requirements in Section-GTR.

Current Transformers (CT): IEC: 61869-1 & 61869-2 or IS: 2705 Part-1 to 4

Capacitive Voltage Transformers (CVT): IEC: 61869-1, 61869-5 & IEC-60358 or IS-3156 Part-1 to 4

Inductive Voltage Transformers (IVT): IEC: 61869-1 & 61869-3 or IS-3156 Part-1 to 3

1.2 The instrument transformers shall be designed for use in geographic and meteorological conditions as given in Section-GTR and Section-Project.

2.0 CONSTRUCTION FEATURES:

The features and constructional details of instrument transformers shall be in accordance with requirements stipulated hereunder:

- a) Instrument transformers of **800kV/420kV/245kV/145kV/72.5** kV class, shall be oil filled/SF₆ gas filled, suitable for outdoor service and upright mounting on steel structures. **245kV, 420kV and** 800kV CT shall be with polymer insulator.
- b) Bushings/Insulators shall conform to requirements stipulated in Section-GTR. The bushing/insulator for CT shall be one piece without any metallic flange joint.
- c) Oil filling and drain plugs, oil sight glass shall be provided for CT & IVT. Oil sight glass shall be provided for electromagnetic unit of CVT. The Instrument transformer shall have cantilever strength of not less than 500 kg, 500 kg, 350 kg, 350 kg and 250 kg respectively for 800kV, 420kV, 245kV, 145kV and 72.5kV Instrument Transformers. For CVT/IVT with polymer housing, the cantilever strength shall not be less than 150kg. Oil filling and drain plugs are not required for SF₆ gas filled CT/IVT.
- d) Instruments transformers shall be hermetically sealed units. The details of the arrangements made for the sealing of instrument transformers shall be furnish during detailed engineering.

Technical Specification, Section: Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017

- e) Polarity marks shall indelibly be marked on each instrument transformer and at the lead terminals at the associated terminal block.
- f) SF₆ gas filled CT/IVT shall be provided with a suitable SF₆ gas density monitoring device, with NO/NC contacts to facilitate the remote annunciation and tripping in case of SF₆ gas leakage. Provisions shall be made for online gas filling. Suitable rupture disc shall be provided to prevent explosion.
- g) The instrument transformers shall be complete with its terminal box and a common marshalling box for a set of 3 instrument transformers.
- h) The external surface of instrument transformer, if made of steel, shall be hot dip galvanized or painted as per Section-GTR. External surface of aluminum can have natural finish.
- i) The impregnation details alongwith tests/checks to ensure successful completion of impregnation cycle shall be furnished for approval.

2.2 Terminal box/Marshalling Box:

Terminal box/**Marshalling Box** shall conform to the requirements of Section-GTR.

2.3 **Insulating Oil/Gas:**

- a) Insulating oil to be used for instrument transformers shall be of EHV grade and shall conform to IS-335/IEC-60296 (required for first filling). Non–PCB based synthetic insulating oil conforming to IEC 60867 **shall** be used in the capacitor units of CVT.
- b) The SF₆ gas shall comply with IEC-60376, 60376A, 60376B & IEC-60480 and shall be suitable in all respects for use in the switchgear under operating conditions.

2.4 Name Plate:

Name plate shall conform to the requirements of IEC incorporating the year of manufacture. The rated current & extended current rating in case of current transformers and rated voltage, voltage factor & intermediate voltage in case of voltage transformers shall be clearly indicated on the name plate.

3.0 CURRENT TRANSFORMERS:

a) Current transformers shall have single primary either ring type or hair pin type and suitably designed for bringing out the secondary terminals

Technical Specification, Section: Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017

in a weather proof (IP-55) terminal box at the bottom. PF (**Tan delta**) terminal for measurement of tan delta and capacitance of the unit shall be provided. These secondary terminals shall be terminated to stud type non disconnecting terminal blocks inside the terminal box.

In case of inverted type (**Live Tank**) current transformers, the manufacturer shall meet following additional requirements:

- (i) The primary conductor shall preferably be of bar type meeting the desired characteristics.
- (ii) The secondaries shall be totally encased in metallic shielding providing a uniform equipotential surface for even electric field distribution.
- (ii) The lowest part of the insulation assembly **i.e. insulation at neck** shall be properly secured to avoid any risk of damage due to transportation stresses.
- (iii) The upper part of insulation assembly resting on primary bar shall be properly secured to avoid any damage during transportation due to relative movement between insulation assembly & top dome.
- (iv) Bellows made of stainless steel shall be used at the top for hermetic sealing of CT.
- (v) Bidder/Manufacturer shall recommend whether any special storage facility is required for spare CT.
- b) Different ratios specified shall be achieved by secondary taps only and primary reconnection shall not be accepted.
- c) Core lamination shall be of cold rolled grain oriented silicon steel or other equivalent alloys. μ metal or nano-crystalline core can also be used for metering cores.
- d) The expansion chamber at the top of the porcelain insulators should be suitable for expansion of oil.
- e) Facilities shall be provided at terminal blocks in the marshalling box for star delta formation, short circuiting and grounding of CT secondary terminals.
- f) Current Transformer's guaranteed burdens and accuracy class are to be intended as simultaneous for all cores.
- g) The rated extended currents for 800kV and 420kV class Current transformers shall be as given below:

Tap Ratio	800kV, 3000A	400kV, 3000A		
тар Кано	Rated extended current	ts in % of rated current		
500/1	200	200		
1000/1				
2000/1	180	180		
3000/1	120 (200 for 15 min)	120		

h) The secondary winding shall be rated for 2A continuously.

Further, the intermediate tapping at 3000-2000 of metering core of 3000 A rated 400kV and 800kV CTs shall be suitable for using as 1000/1 ratio **also**. The Auxiliary reactor, **if used**, as referred at wiring diagram No.0000-000-T-E-L-028 shall be suitable for connecting to the selected taps. The requirements of 3000A CTs are given at TABLE II-A.

For 245/145/72.5kV class CTs, the rated extended primary current shall be 120% (or 150% if applicable) on all cores of the CTs.

- h) For 800/420/245/145/**72.5**kV Current Transformer, characteristics shall be such as to provide satisfactory performance of burdens ranging from 25% to 100% of rated burden over a range of 5% to 120% (or specified rated extended current whichever is higher) of rated current in case of metering CTs and up to the accuracy limit factor/knee point voltage in case of relaying CTs.
- i) The current transformer shall be suitable for horizontal transportation. It shall be ensured that the CT is able to withstand all the stresses imposed on it while transporting and there shall be no damage in transit. The Contractor shall submit the details of packing **and transportation** design to the Employer for review.
- j) For 800kV CTs, the instrument security factor at all ratios shall be less than ten (10) for metering core. For 420/245/145/72.5kV CTs, the instrument security factor at all ratios shall be less than five (5) for metering core. If any auxiliary CTs/reactor are used in the current transformers then all parameters specified shall have to be met treating auxiliary CTs as an integral part of the current transformer. The auxiliary CTs/reactor shall preferably be inbuilt construction of the CTs. In case these are to be mounted separately these shall be mounted in the central marshalling box suitably wired upto the terminal blocks.
- k) The wiring diagram plate for the interconnections of the three single phase CTs shall be provided inside the marshalling box. A typical

- wiring diagram no. 0000-000-T-E-L-028 (Sh.1 & 2) is enclosed herewith at Annexure-III of this specification.
- The Current Transformers should be suitable for mounting on lattice structure (for 800 kV) or pipe structure (for 420 kV and below) to be provided by the Contractor in accordance with stipulations of Section-Project/Section-Structures.
- m) The CT shall be designed so as to achieve the minimum risks of explosion in service. Bidder/Manufacturer shall bring out in his offer, the measures taken to achieve this.
- n) 800/420/245/145kV Current Transformers shall be suitable for high speed auto reclosing.

4.0 **VOLTAGE TRANSFORMERS:**

- a) 800/420/245/145kV Voltage Transformers shall be capacitor voltage divider type with electromagnetic units and shall be suitable for carrier coupling.
- b) Voltage transformers secondaries shall be protected by HRC cartridge type fuses or MCBs for all the windings. In addition, fuses/MCBs shall be provided for the protection and metering windings for fuse monitoring scheme. The secondary terminals of the VTs shall be terminated to the stud type non-disconnecting terminal blocks in the individual phase secondary boxes via the fuse/MCBs.
- c) CVTs shall be suitable for high frequency (HF) coupling required for power line carrier communication. Carrier signal must be prevented from flowing into potential transformer (EMU) circuit by means of a RF choke/reactor suitable for effectively blocking the carrier signals over the entire carrier frequency range i.e. 40 to 500 KHz. H.F. terminal of the CVT shall be brought out through a suitable bushing and shall be easily accessible for connection to the coupling filters of the carrier communication equipment, when utilized. Further, earthing link with fastener to be provided for HF terminal.
- d) The electromagnetic unit comprising compensating reactor, intermediate transformer and protective and damping devices should have separate terminal box with all the secondary terminals brought out.
- e) The damping device, which should be permanently connected to one of the secondary windings, should be capable of suppressing the ferroresonance oscillations.
- f) The accuracy of 0.2 on secondary III for all CVTs/IVTs should be maintained through out the entire burden range upto 50 VA on all the windings without any adjustments during operation.

- g) The Voltage Transformers shall be suitable for mounting on lattice structure (for 800kV) or Pipe structure (for 420kV and below) to be provided by the Contractor in accordance with stipulations of Section-Project/Section-Structures.
- h) It should be ensured that access to secondary terminals is without any danger of access to high voltage circuit.
- i) A protective surge arrester shall be provided, if required, to prevent breakdown of insulation by incoming surges and to limit abnormal rise of terminal voltage of shunt capacitor/primary winding, tuning reactor/RF choke etc. due to short circuit in transformer secondaries. Alternate arrangement shall also be acceptable.
- j) The wiring diagram for the interconnection of the three single phase CVTs/IVTs shall be provided inside the marshalling box in such a manner that it does not deteriorate with time. Wiring diagram no.: 0000-000-T-E-L-029 enclosed herewith at Annexure-IV of this specification shall be followed.

5.0 TERMINAL CONNECTORS:

The terminal connectors shall meet the requirements as given in Section-GTR and technical parameters for the respective equipment as per Annexure-I and Annexure-II of this specification.

6.0 TESTS:

- In accordance with the requirements in Section-GTR, Current Transformer and Voltage Transformer should have been type tested and shall be subjected to routine tests in accordance with **relevant IEC**.
- The test reports of type tests, as applicable, as per IEC-61869-2 for CT, IEC-61869-5/IEC-60358 for CVT, and IEC-61869-3 for IVT and following additional tests shall be submitted for the Employer's review. The type tests for which the procedure is under consideration as per abovesaid IEC is not required to be considered.
 - a) Current Transformers (CT):
 - i) Corona test as per Annexure-A of Section-GTR for 420kV and above voltage rating.
 - ii) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.

- iii) Seismic withstand test as per Annexure-B of Section-GTR or IEC-62271-2 (with Seismic acceleration requirement as per Annexure-I of this specification/Section-Project) for 145kV and above voltage rating.
- iv) Thermal stability test, i.e. application of rated voltage and rated extended thermal current simultaneously by synthetic test circuit **for 145kV and above voltage rating** (not applicable for SF₆ filled CT).
- Thermal co-efficient test i.e. measurement of tan-delta as a function of temperature (at ambient and between 80°C & 90°C) and voltage (at 0.3, 0.7, 1.0 and 1.1 Um/ $\sqrt{3}$) for 145kV and above voltage rating (not applicable for SF₆ filled CT).
- vi) Multiple chopped impulse test (not applicable for SF₆ filled CT) with the application of 600 chopped impulses **for 145kV and above voltage rating**.
- vii) Transmitted over voltage test for 145kV and above voltage rating
- viii) Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 145kV and above voltage rating
- ix) Internal Arc fault test for 145kV and above voltage rating (not applicable for CT with Polymer Insulator)
- x) Enclosure tightness test at low & high temperature for SF_6 filled CT of 145kV and above voltage rating
- xi) Gas dew point test for SF₆ filled CT
- xii) Corrosion test for 145kV and above voltage rating
- b) Capacitive Voltage Transformers (CVT):
 - i) High frequency capacitance and equivalent series resistance measurement (as per IEC-60358)
 - ii) Seismic withstand test (as per Annexure-B of Section-GTR) or IEC-62271-2 (with Seismic acceleration requirement as per Annexure-II of this specification/Section-Project) for 145kV and above voltage class.
 - iii) Stray capacitance and stray conductance measurement of the low voltage terminal (as per IEC-60358)

- iv) Corona test as per Annexure-A of Section-GTR for 420kV and above voltage rating.
- v) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.
- vi) Transmitted over voltage test for 145kV and above voltage rating
- vii) Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 72.5kV and above voltage rating
- viii) Determination of Temperature coefficient for 145kV and above voltage rating
- ix) Tightness design test of capacitor units for 145kV and above voltage rating
- x) Corrosion test for 145kV and above voltage rating
- c) Inductive Voltage Transformers (IVT):
 - i) Seismic withstand test (as per Annexure-B of Section-GTR) or IEC-62271-2 (with Seismic acceleration requirement as per Annexure-II of this specification/Section-Project) for 145kV and above voltage rating.
 - ii) Corona test as per Annexure-A of Section-GTR for 420kV and above voltage rating.
 - ii) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.
 - iii) Multiple chopped impulse test with application of 600 chopped impulses for 145kV and above voltage rating (not applicable for SF₆ filled CT).
 - iv) Transmitted over voltage test for 145kV and above voltage rating
 - v) Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 72.5kV and above voltage rating
 - vi) Enclosure tightness test at low & high temperature for SF₆ filled CT of 145kV and above voltage rating
 - vii) Gas dew point test for SF₆ filled CT

viii) Corrosion test for 145kV and above voltage rating

- ix) Measurement of Capacitance and Dielectric dissipation factor for 145kV and above voltage rating
- 6.3 The current and voltage transformer shall be subjected to the following routine tests in addition to routine tests as per *relevant* IEC-

a) **CURRENT TRANSFORMERS:**

ROUTINE TESTS:

For Oil filled CT:

- i) Measurement of Capacitance.
- ii) Oil leakage test.
- iii) Measurement of tan delta at 0.3, 0.7, 1.0 and 1.1 Um/ $\sqrt{3}$.

For SF₆ filled CT:

- i) Dew point measurement
- ii) SF₆ alarm/ lockout check.
- iii) SF₆ gas leakage test: Gas leakage rate shall be maintained within 0.2% per annum.

b) **VOLTAGE TRANSFORMERS:**

Routine tests on CVT/IVT shall be done in line with IEC-61869-3/61869-5.

7.0 MANDATORY SPARES:

Bidder shall include in his proposal mandatory spares as mentioned in the Bidding Documents.

8.0 MAJOR TECHNICAL PARAMETERS:

Major technical parameters for 800kV/420kV/245kV/145kV/72.5kV Instrument Transformers are enclosed at Annexure-I and Annexure-II to this specification.

9.0 PRE-COMMISSIONING TESTS

9.1 An indicative list of tests is given below. Contractor shall perform any additional test based on specialties of the items as per the field Q.P./Instructions of the equipment Supplier or Employer without any extra cost to the Employer. The Contractor shall arrange all instruments

Technical Specification, Section: Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017

required for conducting these tests alongwith calibration certificates at his own cost.

9.2 **Current Transformers**

- (a) Insulation Resistance Test for primary and secondary
- (b) Polarity test
- (c) Ratio identification test checking of all ratios on all cores by primary injection of current
- (d) Dielectric test of oil (wherever applicable)
- (e) Magnetizing characteristics test
- (f) Tan delta and capacitance measurement
- (g) Secondary winding resistance measurement
- (h) Contact resistance measurement (wherever possible/accessible)
- (i) Test for SF₆ (for SF₆ filled CTs) Dew point measurement, SF₆ alarm/lockout check
- (i) DGA test of oil

Dissolved Gas Analysis (DGA) shall be carried out twice within the first year of service, first within the first month of commissioning/charging and second between six months to one year from the date of commissioning/charging.

CTs/IVTs must have adequate provision for taking oil samples from the bottom of the CT/IVT without exposure to atmosphere. Manufacturer shall recommend the frequency at which oil samples should be taken and norms for various gases in oil after being in operation for different durations. Bidder/Manufacturer should also indicate the total quantity of oil which can be withdrawn from CT for gas analysis before refilling or further treatment of CT becomes necessary.

Bidder shall supply 2 nos. oil sampling device for every 20 nos. oil filled CT supplied with a minimum of 2 nos. oil sampling device for each substation.

9.3 Inductive Voltage Transformers/Capacitive Voltage Transformers

- (a) Insulation Resistance test for primary (if applicable) and secondary winding
- (b) Polarity test
- (c) Ratio test
- (d) Dielectric test of oil (wherever applicable)

- (e) Tan delta and capacitance measurement of individual capacitor stacks
- (f) Secondary winding resistance measurement

For pre-commissioning procedures and formats for Current Transformers, Doc.No.: CF/CT/04/R-4 dtd-01.04.2013 and for Voltage Transformers, CF/CVT/05/R-4 dtd-01.04.2011 under POWERGRID document no. D-2-01-03-01-04 will be the reference document. This document will be available at respective sites and shall be referred by the contractor.

10.0 Defect Liability

The actions required to be taken by contractor in case of defects observed in CT/CVT of ratings 145kV & above during the warranty period (defect liability period) shall be as per enclosed Annexure-V of this specification. Further, the replaced/repaired/refurbished equipment (or part of equipment) shall have Two (2) years warranty without prejudice to contractual warranty period (defect liability period).

TABLE-IIA

REQUIREMENTS FOR 800 KV CURRENT TRANSFORMER

No. of Cores.	Core No.	Application	Current Ratio	Output Burden (VA)	Accuracy Class	Min. Knee Pt. Voltage (Vk)	Max. CT Sec. wdg. Resistance (in Ω)	Max. Excit. Current at Vk (in mA)
6	1	BUS DIFF. CHECK	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	2.	BUS DIFF. MAIN	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	3.	METERING	3000/ 2000/ 500/1	20 20 20	0.2S 0.2S 0.2S	- -		-
	4.	METERING	3000/ 2000/ 500/1	20 20 20	0.2S 0.2S 0.2S	- - -		- -
	5.	TRANSF DIFF./ LINE PROTN.	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	6	LINE PROTN/LBB PROTN.	3000- 2000- 500/1	-	PX	3000/ 2000 500	15/10/2.5	20 on 3000/1 Tap,30 on 2000/1 Tap,120 on 500/1 Tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.

Technical Specification, Section: Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017

^{2.} Metering Core shall be of accuracy class 0.2S as per IEC: 61869

Annexure-I

MAJOR TECHNICAL PARAMETERS FOR CT

S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for Tertiary loading)
1	Rated voltage, U _m (kVrms)	800	420	245	145	72.5
2	Rated frequency (Hz)	50	50	50	50	50
3	No. of Poles	1	1	1	1	1
4	Design ambient temperature (°C)	50	50	50	50	50
5	Rated Primary Current (A)	3000	3000	1600	800/600	50
6	Rated extended primary current	120%	120%	120%/150%	120%/150 %	120%
7	Rated short time thermal withstand current	40kA/50kA (as applicable) for 1 sec	40kA/50kA/63kA (as applicable) for 1 sec	40kA/50kA (as applicable) for 1 sec	31.5kA for 1sec	25kA for 3sec
8	Rated dynamic current	100kAp/125kAp (as applicable)	100kAp/125kAp/ 157.5kAp (as applicable)	100kAp/125kAp (as applicable)	80kAp	63kAp
9	Temperature rise over design ambient temperature		A	s per IEC		
10	Rated Insulation levels					
a)	Full wave impulse with	stand voltage (1.2/5	50 microsecond)			
i)	between line terminals and ground(kVpeak)	±2100	±1425	±1050	±650	±325
b)	Switching impulse with	stand voltage (250/	2500 microsecond)	(dry and wet)		
i)	between line terminals and ground (kVpeak)	± 1550	± 1050	-NA-	-NA-	-NA-
c)	One minute power frequency	uency dry withstand	d voltage (dry and w	et)		
i)	between line terminals and ground (kVrms)	975 (dry only)	630 (dry only)	460	275	140
d)	One minute power frequency withstand voltage between secondary terminals & earth (kVrms)			5kV		


Technical Specification, Section: Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017

S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for Tertiary loading)
11	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz at (microvolts)	2500 at 508 kV rms	1000 at 266kV rms	1000 at 156kV rms	500 at 92kV rms	-NA-
12	Minimum Corona extinction voltage (kVrms)	508	320	-NA-	-NA-	-NA-
13	Seismic acceleration (Horizontal)	0.3g	0.3g	0.3g	0.3g	-NA-
14	Partial Discharge	As per IEC	As per IEC	As per IEC	As per IEC	As per IEC
15	Number of terminals	All terminals of control circuits are to be wired up to marshaling box plus 20% spare terminals evenly distributed on all TBs.				
16	Minimum Creepage distance (mm) *	20000	10500	6125	3625	1813
17	System neutral earthing		Effect	tively Earthed		


^{*}The values indicated are for specific creepage of 25mm/kV. In case of specific creepage of 31mm/kV is specified, the Minimum Creepage distance values shall be considered proportionately.

For other parameters, refer respective Table for the applicable voltage class of CTs.

Annexure-III: Wiring Diagram of CT

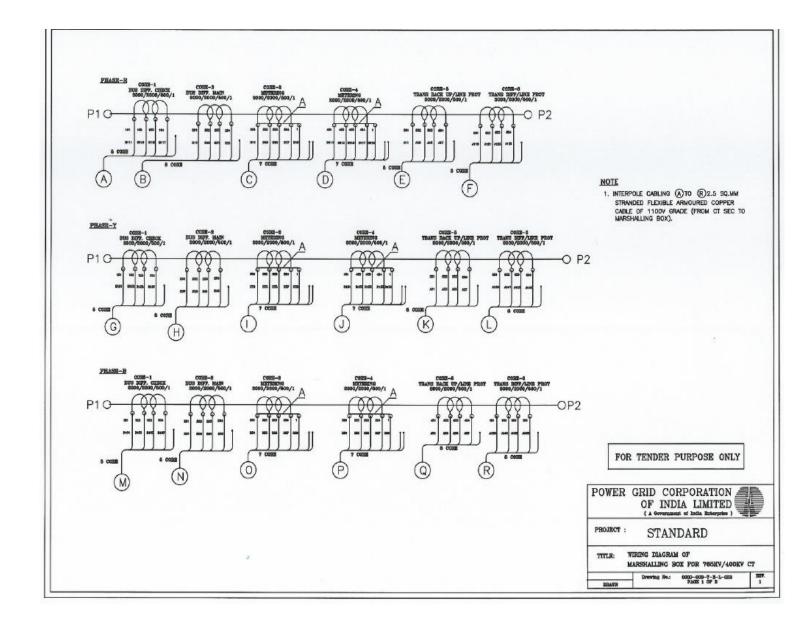

Annexure-III: Wiring Diagram of CT

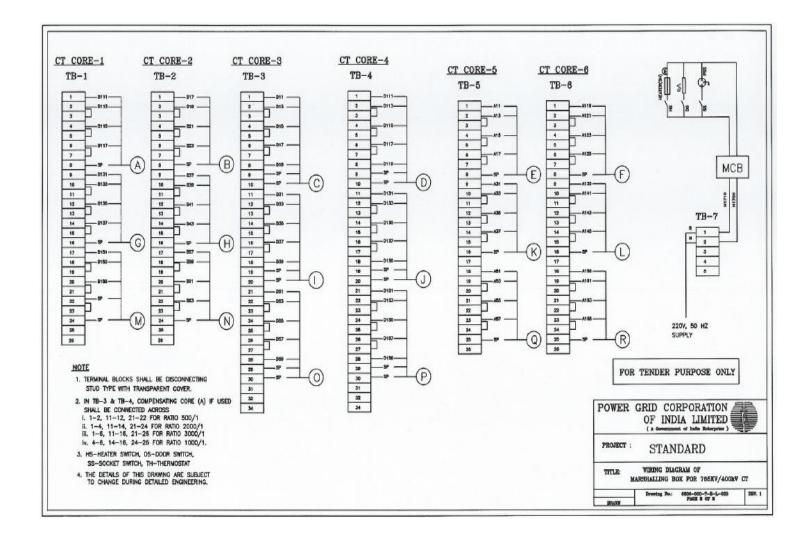

Annexure-V: Actions required in case of defects observed during warrantee period

Equipment	Nature of problem	Corrective measures to be taken by
		contractor
CT	DGA Violation	CT to be refurbished or replaced
(Oil filled)	H2 > 300 ppm	
	C2H2> 2 ppm	
CT	a) SF6 gas leakage	a)Repair/ replacement
(SF ₆ filled)	b) High Dew point of SF6 gas (> -36 deg C at atm	b)Re-processing of gas and
	press)	replacement of Gas in case of no
	•	improvement
		_
CT	Violation of Tan delta	Replacement of CT
(Oil filled)	Tan Delta:	_
	>0.5% (during pre-commissioning)	
	>0.7% (in operation)	
	or change w.r.t. to previous year value > 0.1%	
CT & CVT	- Oil leakage	Replacement or repair as per repair
	- Low Oil level	procedure approved by QA.
	-Sec winding problem leading to open/ short	
	circuit, saturation etc	
CVT	Secondary voltage drift: Upto ± 0.5 volts Healthy	
	a) \pm 0.5 or beyond	a) CVT to be replaced

^{*}Replaced/Repaired/Refurbished Equipment (or part of equipment) shall have 2 years warranty without prejudice to contractual warranty period.

Bharat Heavy Electricals Limited

Project: Package-I for \pm 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Section -3 of Technical Specification

Sl. No. Particular

SECTION-3

PROJECT DETAILS & GENERAL TECHNICAL REQUIREMENTS

Details

SITE INFORMATION

51. 110.	Farticulai	Details			
a)	Customer	M/s. KHAVDA V-A POWER TRANSMISSION LTD (100%			
		owned subsidiary of M/s POWERGRID)			
b)	Consultant	Power Grid Corporation of India Ltd. (POWERGRID)			
c)	Project Title	U	0 kV, 6000MW HVDC		
		•	(KPS2) (HVDC) & N	01	
			tension of existing 400		
			rith "Transmission Syst		
		-	ial renewable energy zo	one in Khavda area of	
		Gujarat under Pha	Gujarat under Phase-V Part A (8 GW)"		
d)	Location: Location of	the Substation - The	location of substation	is indicated below:	
T	T	T			
Sl. No.	Name of Substation	Name of State	Nearest Rail Head	Nearest Airport	
1	KPS2 HVDC	Gujarat	Bhuj	Bhuj	
2	NAGPUR S/S	Maharashtra	Nagpur	Nagpur	
e)	e) Transport Facilities As above				
	METEOROLOGICAL	DATA			
			£1t-t:		
Sl. No.	The meteorological dat Parameter	a and other paramet	KPS2 HVDC	NAGPUR	
		/ 1 1 11 1			
1	Max Ambient temperatu average)	are (dry bulb one hou	50° C	50° C	
	average)				
	Minimum Ambient temp.		0° C	0° C	
	Max dry bulb 24hr avera	age	40° C	40° C	
2	Snowfall (mm)		NA	NA	
3	Average annual rainfall		As per rainfall map of	As per rainfall map	
			IMD	of IMD	
I I .	Iso-keraunic level		A 1' 11	A a ammliaahla	
5	Relative humidity		As applicable 100%	As applicable 100%	

6	Basic wind speed as per National Building	50 m/s	44 m/s
	Code 2016		
7	Seismic zone as per IS-1893	Zone-V	Zone-II
8	Altitude (above M.S.L. in m)	<1000 m	<1000 m
9	Pollution level (IEC 60815)	Heavy	Heavy
10	Hottest month	May/June	May/June
11	Annual mean dry bulb Temperature	30	30
12	Maximum wet bulb one hour average	33	33
13	Dry bulb temperature for low ambient condition	33	33
14	Wet bulb temperature for low ambient	23	23
	condition		
15	Coastal Considerations	Yes	No

SYSTEM PARAMETERS

Sl. No.	Parameter	KPS2 HVDC	NAGPUR
1	Fault Level	63 kA for 1 Sec (400 kV)	50 kA for 1 Sec for 765 kV 63 kA for 1 Sec for 400 kV
2	Minimum Creepage Distance	35 mm/kV	25 mm/kV

Note: NOA Date, wherever appearing in the document to be read as 22.11.2024.

ENCLOSED:

Section-GTR (general technical requirement) rev.15A" for details of general technical specification.

Please read terminology as follows:

- 1. Read "GTR" as "Section-3 of technical specification"
- 2. Read "POWERGRID" as "BHEL/POWERGRID".
- 3. Read "Employer" as "POWERGRID".
- 4. Read "EPC Contractor" as "BHEL"

SECTION-3 of Technical Specification

Contents

1.0 FOREWORD	18
2.0 GENERAL REQUIREMENT	18
3.0 STANDARDS	18
4.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT BEING FURNISHED	19
5.0 ENGINEERING DATA AND DRAWINGS	22
6.0 MATERIAL/ WORKMANSHIP	24
7.0 DESIGN IMPROVEMENTS / COORDINATION	26
8.0 QUALITY ASSURANCE PROGRAMME	26
9.0 TYPE TESTING & CLEARANCE CERTIFICATE	31
10.0 TESTS	33
11.0 PACKAGING & PROTECTION	34
12.0 FINISHING OF METAL SURFACES	34
12.3 PAINTING	35
13.0 HANDLING, STORING AND INSTALLATION	36
14.0 TOOLS	36
15.0 AUXILIARY SUPPLY	37
16.0 SUPPORT STRUCTURE	37
17.0 CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS	37
$18.0\ \ CONTROL\ CABINETS, JUNCTION\ BOXES, TERMINAL\ BOXES\ \ MARSHALLING\ BOXES$	
FOR OUTDOOR EQUIPMENT	39
19.0 DISPOSAL OF PACKING MATERIAL & WASTE FROM CONSTRUCTION SITE	40
20.0 TERMINAL BLOCKS AND WIRING	40
21.0 LAMPS & SOCKETS	41
22.0 BUSHINGS, HOLLOW COLUMN INSULATORS, SUPPORT INSULATORS:	41
23.0 MOTORS	42

Annexure-A: Corona and Radio Interface Voltage (RIV) Test

Annexure-B: Seismic Withstand Test Procedure

Annexure-C: List of General Standards and codes

Annexure-F: Assessment report from Main Bidder for proposed sub vendor's-List of Enclosure

Annexure-G: MQP & Inspection Level Requirement

Annexure-J: List of make for which type test reports are not required to be submitted

1.0 **FOREWORD**

The provisions under this section are intended to supplement requirements for the materials, equipment's and services covered under other sections of tender documents and are not exclusive.

2.0 **GENERAL REQUIREMENT**

2.1 a) All equipment/materials/items, as per Annexure-K, as applicable under present scope of works, shall be procured and supplied from domestic manufacturers only

Any imported equipment/material/item/parts/component (comprising of embedded systems) to be supplied under the contract shall be tested in the certified laboratories to check for any kind of embedded malware/trojans/cyber threats and for adherence to Indian Standards as per the directions issued by Ministry of Power/Govt. of India from time to time. In case of such import from specified "prior reference" countries, the requirement of prior permission from the Govt. of India including protocol for testing in certified and designated laboratories by Ministry of Power/Govt. of India shall also be complied with by the bidder.

The bidder/bidder shall list out the products and components producing Toxic ewaste under the contract and shall furnish to the Employer the procedure of safe disposal at the time of closing of the contract

- 2.1 b) The Supplier/Manufacturer shall furnish catalogues, engineering data, technical information, design documents, drawings etc., fully in conformity with the technical specification during detailed engineering.
- 2.2 It is recognised that the Bidder may have standardised on the use of certain components, materials, processes or procedures different from those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered provided such proposals meet the specified designs, standard and performance requirements and are acceptable to Employer.
- 2.3 Wherever a material or article is specified or defined by the name of a particular brand, Manufacturer or Vendor, the specific name mentioned shall be understood as establishing type, function and quality and not as limiting competition.
- Equipment furnished shall be complete in every respect with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or needed for erection, completion and safe operation of the equipment as required by applicable codes though they may not have been specifically detailed in the Technical Specifications unless included in the list of exclusions. Materials and components which are minor in nature and incidental to the requirement but not specifically stated in the specification and bid price schedule, which are necessary for commissioning and satisfactory operation of the switchyard/ substation unless specifically excluded shall be deemed to be included in the scope of the specification and shall be supplied without any extra cost. All similar standard components/parts of similar standard equipment provided, shall be inter-changeable with one another.

3.0 STANDARDS

- 3.1 The works covered by the specification shall be designed, engineered, manufactured, built, tested and commissioned in accordance with the Acts, Rules, Laws and Regulations of India.
- The equipment offered by the bidder shall at least conform to the requirements specified under relevant IS standard. In case of discrepancy between IS and other international standard, provisions of IS shall prevail. The Bidder shall also note that the list of standards presented in this specification at Annex-C is not complete. Whenever necessary, the list of standards shall be considered in conjunction with specific IS. If the IS standard is not available for an equipment/material, then other applicable International standard (IEC/Equivalegg), as per the specification, shall be accepted.

- 3.3 The bidder shall note that standards mentioned in the specification are not mutually exclusive or complete in themselves, but intended to compliment each other.
- 3.4 When the specific requirements stipulated in the specifications exceed or differ than those required by the applicable standards, the stipulation of the specification shall take precedence.
- 3.5 Other internationally accepted standards which ensure equivalent or better performance than that specified in the standards specified under Annexure-C/ individual sections for various equipments shall also, be accepted, however the salient points of difference shall be clearly brought out during detailed engineering along with English language version of such standard. The equipment conforming to standards other than specified under Annexure-C/individual sections for various equipments shall be subject to Employer's approval.

4.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT BEING FURNISHED

- 4.1 Switching surge over voltage and power frequency over voltage is specified in the system parameters below. In case of the 400kV system, the initial value of the temporary overvoltages could be 2.0 p.u. for 1-2 cycles. The equipment furnished under this specification shall perform all its functions and operate satisfactorily without showing undue strain, restrike etc under such over voltage conditions.
- 4.2 All equipments shall also perform satisfactorily under various other electrical, electromechanical and meteorological conditions of the site of installation.
- 4.3 All equipment shall be able to withstand all external and internal mechanical, thermal and electromechanical forces due to various factors like wind load, temperature variation, ice & snow, (wherever applicable) short circuit etc for the equipment.
- 4.4 If indicated in Section 1, the Bidder shall design terminal connectors of the equipment taking into account various forces as mentioned at Sl.No.4.3 that are required to withstand.
- 4.5 The equipment shall also comply to the following:
 - a) To facilitate erection of equipment, all items to be assembled at site shall be "match marked".
 - b) All piping, if any between equipment control cabinet/operating mechanism to marshalling box of the equipment, shall bear proper identification to facilitate the connection at site.

4.6 **System Parameter**

765kV, 400kV & 220kV System

SL No	Description of parameters	765 kV System	400 kV System	220kV System
1.	System operating voltage	765kV	400kV	220kV
2.	Maximum operating voltage of the system (rms)	800kV	420kV	245kV
3.	Rated frequency	50HZ	50Hz	50Hz
4.	No. of phase	3	3	3
5.	Rated Insulation levels			
i)	Full wave impulse withstand voltage (1.2/50 microsec.)	2100kVp	1550kVp	1050 kVp

Switching impulse withstand voltage (250/2500 micro sec.) dry and wet	1550kVp	1050kVp	-
One minute power frequency dry withstand voltage (rms)	830kV	630kV	-
One minute power frequency dry and wet withstand voltage (rms)	-	-	460kV
Corona extinction voltage	508 kV	320kV	-
Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	2500 μV at 508 kV rms	1000 μV at 266kV rms	1000 μV at 156kV rms
Minimum creepage distance - for Equipment other than Insulator string	20000 mm (24800 mm for coastal area)	10500 mm (13020 mm for coastal area)	6125 mm (7595 mm for coastal area)
Minimum creepage distance - for Insulator String	As specified in Section-Switchyard Erection		
Min. clearances			
Phase to phase	7600mm (for conductor - conductor configuration) 9400mm (for rod -conductor configuration)	4000mm (for conductor - conductor configuration) 4200mm (for rod - conductor configuration)	2100 mm
Phase to earth	4900mm (for conductor- structure) 6400mm (for rod-	3500 mm	2100 mm
Sectional clearances	-	6500 mm	5000 mm
Rated short circuit current for 1 sec. duration		40kA/50kA/ 63 kA (as applicable)	40kA/ 50kA(as applicable)
	voltage (250/2500 micro sec.) dry and wet One minute power frequency dry withstand voltage (rms) One minute power frequency dry and wet withstand voltage (rms) Corona extinction voltage Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz Minimum creepage distance - for Equipment other than Insulator string Minimum creepage distance - for Insulator String Min. clearances Phase to phase Phase to phase Sectional clearances Rated short circuit current for 1 sec.	voltage (250/2500 micro sec.) dry and wet One minute power frequency dry withstand voltage (rms) One minute power frequency dry and wet withstand voltage (rms) Corona extinction voltage Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz Minimum creepage distance - for Equipment other than Insulator string Minimum creepage distance - for Insulator String Min. clearances Phase to phase 7600mm (for conductor configuration) Phase to earth 4900mm (for rod -conductor structure) 6400mm (for rod structure) 6400mm (for rod structure) Sectional clearances Rated short circuit current for 1 sec.	voltage (250/2500 micro sec.) dry and wet 830kV 630kV One minute power frequency dry withstand voltage (rms) 830kV 630kV One minute power frequency dry and wet withstand voltage (rms) - - Corona extinction voltage 508 kV 320kV Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz 2500 μV at 508 kV rms 1000 μV at 266kV rms Minimum creepage distance - for Equipment other than Insulator string 20000 mm (24800 mm for coastal area) 10500 mm (13020 mm for coastal area) Minimum creepage distance - for Insulator String As specified in Section-Switchyard Min. clearances 7600mm (for conductor conductor conductor configuration) (for conductor configuration) Min. clearances 7600mm (for rod conductor configuration) 4200mm (for rod conductor configuration) Phase to phase 7600mm (for conductor configuration) 4200mm (for rod conductor configuration) Phase to earth 4900mm (for rod structure) 3500 mm Sectional clearances 10300 mm 6500 mm Rated short circuit current for 1 sec. duration 40kA/50kA (as applicable) 40kA/50kA/63 kA

132kV, 66kV, 52kV, 33kV & 11kV System

SL No	Description of parameters	132 kV System	66kV System	52 kV System	33 kV System	11kV System
1.	System operating voltage	132kV	66kV	52kV	33kV	11kV
2.	Maximum operating voltage of the system(rms)	145kV	72.5kV	52kV	36kV	12kV
3.	Rated frequency	50Hz	50Hz	50Hz	50Hz	50Hz
4.	No. of phase	3	3	3	3	3
5.	Rated Insulation Levels	34				

SL No	Description of parameters	132 kV System	66kV System	52 kV System	33 kV System	11kV System
i)	Full wave impulse withstand voltage (1.2/50 microsec.)	650 kVp	325 kVp	250 kVp	170 kVp	75 kVp
ii)	One minute power frequency dry and wet withstand voltage (rms)	275kV	140kV	95kV	70kV	28kV
6.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	500 μV at 92kV rms	-	-	-	-
7.	Minimum creepage distance	3625 mm (4495mm for coastal area)	1813mm (2248m m for coastal area)	300mm (1612 mm for coastal area)	900 mm (1116m m for coastal area)	300 mm (372mm for coastal area)
8.	Min. Clearance					
i.	Phase to phase	1300 mm	750 mm	530mm	320 mm	280 mm
ii.	Phase to earth	1300 mm	630 mm	480mm	320 mm	140 mm
iii.	Sectional clearances	4000 mm	3100 mm	3100m m	2800 mm	2800 mm
9.	Rated short circuit current	40kA/ 31.5 kA (as applicable) for 1 sec	31.5 kA for 3 sec/25k A for 3 Sec*	25kA for 1 Sec	25 kA for 3 sec	25 kA for 3 sec
10.	System neutral earthing	Effectively earthed	Effectively earthed	Effectively earthed	Effectively earthed	Effectively earthed

Notes:

- 1. The above parameters are applicable for installations up to an altitude of 1000m above mean sea level. For altitude exceeding 1000m, necessary altitude correction factor shall be applicable as per relevant IEC/IS.
- 2. The insulation and RIV levels of the equipments shall be as per values given in the Technical Specification of respective equipment.
- 3. Corona and radio interference voltage test and seismic withstand test procedures for equipments shall be in line with the procedure given at **Annexure-A** and **Annexure-B** respectively.
- 4. "*" For tertiary loading Equipment's fault level shall be 25kA for 3 Sec. For other switchyard equipment shall be as specified in Section project.
- 5. Costal Area is to be considered only if defined in Section project.

4.7 Planning and Designing in purview of Vulnerability Atlas of India

Vulnerability Atlas of India (VAI) is a comprehensive document which provides existing hazard scenario for the entire country and presents the digitized State/UT wise hazard, maps with respect to earthquakes, winds and floods for district wise identification of vulnerable areas. It also includes additional digitized maps for thunderstorms, cyclones and landslides. The main purpose of this Atlas is its use for disaster preparedness and mitigation at policy planning and project formulation stage.

This Atlas is one of its kind single point source for the various stakeholders including policy makers, administrators, municipal commissioners, urban managers, engineers, architects, planners, public etc. to ascertain proneness of any city/ location/ site to multi-hazard which includes earthquakes, winds, floods thunderstorms, cyclones and landslides. While project formulation, approvals and implementation of various urban housing, buildings and infrastructures schemes, this Atlas provides necessary information for risk analysis and hazard assessment.

The Vulnerability Atlas of India has been prepared by Building Materials and Technology Promotion Council under Ministry of Housing and Urban Affairs, Government of India and available at their website https://www.bmtpc.org/. It is mandatory for the bidders to refer Vulnerability Atlas of India for multi-hazard risk assessment and include the relevant hazard proneness specific to project location while planning and designing the project in terms of:

- i) Seismic zone for earthquakes,
- ii) Wind velocity
- iii) Area liable to floods and Probable max. surge height
- iv) Thunderstorms history
- v) Number of cyclonic storms/ severe cyclonic storms and max sustained wind specific to coastal Region
- vi) Landslides incidences with Annual rainfall normal
- vii) District wise Probable Max. Precipitation

5.0 ENGINEERING DATA AND DRAWINGS

5.3 Drawings

5.3.1 All drawings submitted by the Bidder shall be in sufficient detail to indicate the type, size, arrangement, material description, Bill of Materials, weight of each component,

break-up for packing and shipment, dimensions, internal & the external connections, fixing arrangement required and any other information specifically requested in the specifications.

- 5.3.2 Drawings submitted by the Bidder shall be clearly marked with the name of the Employer, the unit designation, the specifications title, the specification number and the name of the Project. POWERGRID has standardized a large number of drawings/documents of various make including type test reports which can be used for all projects having similar requirements and in such cases no project specific approval (except for list of applicable drawings alongwith type test reports) is required. However, distribution copies of standard drawings/documents shall be submitted as per provision of the contract. All titles, noting, markings and writings on the drawing shall be in English. All the dimensions should be in SI units.
- 5.3.3 The review of these data by the Employer will cover only general conformance of the data to the specifications and documents, interfaces with the equipment provided under the specifications, external connections and of the dimensions which might affect substation layout. This review by the Employer may not indicate a thorough review of all dimensions, quantities and details of the equipment, materials, any devices or items indicated or the accuracy of the information submitted. This review and/or approval by the Employer shall not be considered by the Bidder, as limiting any of his responsibilities and liabilities for mistakes and deviations from the requirements, specified under these specifications and documents.

- All manufacturing and fabrication work in connection with the equipment prior to the approval of the drawings shall be at the Bidder's risk. The Bidder may make any changes in the design which are necessary to make the equipment conform to the provisions and intent of the Contract and such changes will again be subject to approval by the Employer. Approval of Bidder's drawing or work by the Employer shall not relieve the bidder of any of his responsibilities and liabilities under the Contract.
- All engineering data submitted by the Bidder after final process including review and approval by the Employer shall form part of the Contract Document and the entire works performed under these specifications shall be performed in strict conformity, unless otherwise expressly requested by the Employer in Writing.

5.7 Approval Procedure

The following schedule shall be followed generally for approval and for providing final documentation.

- i) Approval/comments/by Employer on initial submission
- ii) Resubmission (whenever required)
- iii) Approval or comments
- iv) Furnishing of distribution copies (2 hard copies to each substation and one scanned copy (pdf format)

Please refer activity schedule attached in commercial terms of tender specifications.

- v) Furnishing of distribution copies of reports

 - (b) Routine Test Reports (one copy for each substation)
- vi) Furnishing of instruction/ operation manuals (2 copies per substation and one softcopy (pdf format) for corporate centre & per substation)

On completion of Engineering

vii) As built drawings (two sets of hardcopy per substation & one softcopy (pdf format) for corporate centre & per substation)

On completion of entire works

NOTE:

- (1) The bidder may please note that all resubmissions must incorporate all comments given in the earlier submission by the Employer or adequate justification for not incorporating the same must be submitted failing which the submission of documents is likely to be returned.
- (2) The instruction Manuals shall contain full details of drawings of all equipment being supplied under this contract, their exploded diagrams with complete instructions for storage, handling, erection, commissioning, testing, operation, trouble shooting, servicing and overhauling procedures.
- (3) If after the commissioning and initial operation of the substation, the instruction manuals require any modifications/additions/changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Bidder to the Employer.
- (4) The Bidder shall furnish to the Employer catalogues of spare parts.

(5) All As-built drawings/documents shall be certified by site indicating the changes before final submission.

6.0 MATERIAL/ WORKMANSHIP

6.1 General Requirement

- 6.1.1 Where the specification does not contain references to workmanship, equipment, materials and components of the covered equipment, it is essential that the same must be new, of highest grade of the best quality of their kind, conforming to best engineering practice and suitable for the purpose for which they are intended.
- In case where the equipment, materials or components are indicated in the specification as "similar" to any special standard, the Employer shall decide upon the question of similarity. When required by the specification or when required by the Employer the Bidder shall submit, for approval, all the information concerning the materials or components to be used in manufacture. Machinery, equipment, materials and components supplied, installed or used without such approval shall run the risk of subsequent rejection, it is to be understood that the cost as well as the time delay associated with the rejection shall be borne by the Bidder.
- 6.1.3 The design of the Works shall be such that installation, future expansions, replacements and general maintenance may be undertaken with a minimum of time and expenses. Each component shall be designed to be consistent with its duty and suitable factors of safety, subject to mutual agreements. All joints and fastenings shall be devised, constructed and documented so that the component parts shall be accurately positioned and restrained to fulfill their required function. In general, screw threads shall be standard metric threads. The use of other thread forms will only be permitted when prior approval has been obtained from the Employer.
- 6.1.4 Whenever possible, all similar part of the Works shall be made to gauge and shall also be made interchangeable with similar parts. All spare parts shall also be interchangeable and shall be made of the same materials and workmanship as the corresponding parts of the Equipment supplied under the Specification. Where feasible, common component units shall be employed in different pieces of equipment in order to minimize spare parts stocking requirements. All equipment of the same type and rating shall be physically and electrically interchangeable.
- 6.1.5 All materials and equipment shall be installed in strict accordance with the manufacturer's recommendation(s). Only first-class work in accordance with the best modern practices will be accepted. Installation shall be considered as being the erection of equipment at its permanent location. This, unless otherwise specified, shall include unpacking, cleaning and lifting into position, grouting, levelling, aligning, coupling of or bolting down to previously installed equipment bases/foundations, performing the alignment check and final adjustment prior to initial operation, testing and commissioning in accordance with the manufacturer's tolerances, instructions and the Specification. All factory assembled rotating machinery shall be checked for alignment and adjustments made as necessary to re-establish the manufacturer's limits suitable guards shall be provided for the protection of personnel on all exposed rotating and / or moving machine parts and shall be designed for easy installation and removal for The spare equipment(s) shall be installed at designated maintenance purposes. locations and tested for healthiness.
- 6.1.6 The Bidder shall apply oil and grease of the proper specification to suit the machinery, as is necessary for the installation of the equipment. Lubricants used for installation purposes shall be drained out and the system flushed through where necessary for applying the lubricant required for operation. The Bidder shall apply all operational lubricants to the equipment installed by him.
- All oil, grease and other consumables used in the Works/Equipment shall be purchased in India unless the Bidder has any special requirement for the specific application of a type of oil or grease not available in India. If such is the case, he shall declare source of oil/grease /other consumables in the GTP/Drawings, where such oil or grease is

available. He shall help Employer in establishing equivalent Indian make and Indian Bidder. The same shall be applicable to other consumables too.

6.2 Provisions for Exposure to Hot and Humid climate

Outdoor equipment supplied under the specification shall be suitable for service and storage under tropical conditions of high temperature, high humidity, heavy rainfall and environment favourable to the growth of fungi and mildew. The indoor equipments located in non-air conditioned areas shall also be of same type.

6.2.1 Space Heaters

- 6.2.1.1 The heaters shall be suitable for continuous operation at 240V as supply voltage. On-off switch and fuse shall be provided.
- 6.2.1.2 One or more adequately rated thermostatically connected heaters shall be supplied to prevent condensation in any compartment. The heaters shall be installed in the compartment and electrical connections shall be made sufficiently away from below the heaters to minimize deterioration of supply wire insulation. The heaters shall be suitable to maintain the compartment temperature to prevent condensation.

6.2.2 FUNGI STATIC VARNISH

Besides the space heaters, special moisture and fungus resistant varnish shall be applied on parts which may be subjected or predisposed to the formation of fungi due to the presence or deposit of nutrient substances. The varnish shall not be applied to any surface of part where the treatment will interfere with the operation or performance of the equipment. Such surfaces or parts shall be protected against the application of the varnish.

6.2.3 Ventilation opening

Wherever ventilation is provided, the compartments shall have ventilation openings with fine wire mesh of brass to prevent the entry of insects and to reduce to a minimum the entry of dirt and dust.

6.2.4 Degree of Protection

The enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc. to be installed shall comply with following degree of protection as detailed here under:

- a) Installed out door: IP- 55
- b) Installed indoor in air-conditioned area: IP-31
- c) Installed in covered area: IP-52
- d) Installed indoor in non-air conditioned area where possibility of entry of water is limited: IP-
- e) For LT Switchgear (AC & DC distribution Boards): IP-52

The degree of protection shall be in accordance with IS/IEC60947; IS/IEC/60529. Type test report for of relevant Degree of Protection test, shall be submitted for approval.

6.3 RATING PLATES, NAME PLATES AND LABELS

- 6.3.1 Each main and auxiliary item of substation is to have permanently attached to it in a conspicuous position a rating plate of non-corrosive material upon which is to be engraved manufacturer's name, Customer Name, year of manufacture, equipment name, type or serial number together with details of the loading conditions under which the item of substation in question has been designed to operate, and such diagram plates as may be required by the Employer. The rating plate of each equipment shall be according to IS/ IEC requirement.
- 6.3.2 All such nameplates, instruction plates, rating plates of transformers, reactors, CB, CT, CVT, SA, Isolators, C & R panels and PLCC equipments shall be bilingual with Hindi inscription first followed by English. Alternatively, two separate plates one with Hindi and the other with English inscriptions may be provided.

6.4 FIRST FILL OF CONSUMABLES, OIL AND LUBRICANTS

All the first fill of consumables such as oils, lubricants, filling compounds, touch up paints, soldering/brazing material for all copper piping of circuit breakers and essential chemicals etc. which will be required to put the equipment covered under the scope of the specifications, into operation, shall be furnished by the Bidder unless specifically excluded under the exclusions in these specifications and documents.

7.0 DESIGN IMPROVEMENTS / COORDINATION

- 7.1 The bidder shall offer the equipment meeting the requirement of the technical specification. However, the Employer or the Bidder may propose changes in the specification of the equipment or quality thereof and if the bidder & Employer agree upon any such changes, the specification shall be modified accordingly.
- 7.2 If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any change in the price and/or schedule of completion before the Bidder proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.
- 7.3 The Bidder shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic design requirements are detailed out in this Specification. The design of various components, sub-assemblies and assemblies shall be so done that it facilitates easy field assembly and maintenance.
- 7.4 The Bidder has to coordinate designs and terminations with the agencies (if any) who are Consultants/Bidder for the Employer. The names of agencies shall be intimated to the successful bidders.
- 7.5 The Bidder will be called upon to attend design co-ordination meetings with the Engineer, other Bidder's and the Consultants of the Employer (if any) during the period of Contract. The Bidder shall attend such meetings at his own cost at POWERGRID Corporate Centre, Gurgaon (Haryana) or at mutually agreed venue as and when required and fully cooperate with such persons and agencies involved during those discussions.

8.0 QUALITY ASSURANCE PROGRAMME

- 8.1 To ensure that the equipment and services under the scope of this Contract, whether manufactured or performed within the Manufacturer's Works or at his Sub-Vendor's premises or at the Employer's site or at any other place of Work as applicable, are in accordance with the specifications, the Bidder shall ensure suitable quality assurance programme to control such activities at all points necessary. A quality assurance programme of the Bidder shall be in line with ISO requirements & shall generally cover the following:
 - a) The organisation structure for the management and implementation of the proposed quality assurance programme.
 - b) System for Document and Data Control.
 - c) Qualification and Experience data of Bidder's key personnel.
 - d) The procedure for purchases of materials, parts, components and selection of sub vendors's services including vendor analysis, source inspection, incoming raw material inspection, verification of material purchases etc.
 - e) System for shop manufacturing and site erection controls including process controls, fabrication and assembly control.
 - f) System for Control of non-conforming products including deviation dispositioning, if any and system for corrective and preventive actions based on the feedback received from the Customers and also internally documented system for Customer complaints.

- g) Inspection and test procedure both for manufacture and field activities.
- h) System for Control of calibration of testing and measuring equipment and the indication of calibration status on the instruments.
- i) System for indication and appraisal of inspection status.
- j) System of Internal Quality Audits, Management review and initiation of corrective and Preventive actions based on the above.
- k) System for authorising release of manufactured product to the Employer.
- l) System for maintenance of records.
- m) System for handling, storage and delivery.
- n) A quality plan detailing out the specific quality control measures and procedure adopted for controlling the quality characteristics relevant to each item of equipment furnished and /or service rendered.
- o) System for various field activities i.e. unloading, receipt at site, proper storage, erection, testing and commissioning of various equipment and maintenance of records. In this regard, the Employer has already prepared Standard Field Quality Plan for transmission line/substation equipments as applicable, Civil/erection Works which is required to be followed for associated works.

The Employer or his duly authorised representative reserves the right to carry out quality audit and quality surveillance of the system and procedure of the Bidder/his vendor's quality management and control activities.

8.2 **Quality Assurance Documents**

The Bidder shall ensure availability of the following Quality Assurance Documents:

- i) All Non-Destructive Examination procedures, stress relief and weld repair procedure actually used during fabrication, and reports including radiography interpretation reports.
- ii) Welder and welding operator qualification certificates.
- iii) Welder's identification list, welding operator's qualification procedure and welding identification symbols.
- iv) Raw Material test reports on components as specified by the specification and in the quality plan.
- V) The Manufacturing Quality Plan (MQP) indicating Customer Inspection Points (CIPs) at various stages of manufacturing and methods used to verify that the inspection and testing points in the quality plan were performed satisfactorily.
- vi) Factory test results for testing required as per applicable quality plan/technical specifications/GTP/Drawings etc.
- vii) Stress relief time temperature charts/oil impregnation time temperature charts, wherever applicable.

8.3 INSPECTION, TESTING & INSPECTION CERTIFICATE

Bidder shall procure bought out items from sub-vendors as per the list in "Compendium of Vendors" available on POWERGRID web-site www.powergridindia.com after ensuring compliance to the requirements/conditions mentioned therein. Bidder shall explore first the possibilities of procuring the bought out items from POWERGRID approved existing vendors. In case of their unavailability / non-response, Bidder may approach POWERGRID for additional sub-vendor approval. In that case, the assessment report of proposed sub vendor by Bidder along with the enclosures as per **Annexure-F** shall be submitted within 60 days of the award. The proposal shall be reviewed and appredatal will be accorded based on the verification of

the document submitted and/or after the physical assessment of the works as the case may be. The physical assessment conducted by POWERGRID, if required, shall be on chargeable basis. Charges shall be as per the POWERGRID norms prevailing at that time, which shall be intimated by POWERGRID separately. If proposal for sub-vendor is submitted after 60 days, the Bidder's proposal normally will not be considered for current LOA. However, POWERGRID may process the case for developing more vendors for referred items, if found relevant. In all cases, It is the responsibility of the Bidder that Project activities do not suffer on account of delay in approval/non approval of a new sub-vendor.

The responsibility and the basis of inspection for various items & equipment is placed at **Annexure-G** along with the requirement of MQP (Manufacturing Quality Plan), ITP (Inspection & Test Plan), FAT (Factory Acceptance Test) which should be valid & POWERGRID approved and Level of inspection envisaged against each item.

Bidder shall ensure that order for items where MQP/ITP/FAT is required will be placed only on vendors having valid MQP/ITP/FAT and where the supplier's MQP/ITP/FAT is either not valid or has not been approved by POWERGRID, MQP shall be generally submitted as per POWERGRID format before placing order.

Items not covered under MQP/ITP/FAT shall be offered for inspection as per POWERGRID LOA/technical Specifications/POWERGRID approved data sheets/POWERGRID approved drawings and relevant Indian/International standards.

Inspection **Levels**: For implementation of projects in a time bound manner and to avoid any delay in deputation of POWERGRID or its authorized representative, involvement of POWERGRID for inspection of various items / equipment will be based on the level below:

- **Level -I**: EPC Contractor to raise all inspection calls and review the report of tests carried out by the manufacturer, on his own, as per applicable standards/ POWERGRID specification, and submit to concerned POWERGRID inspection office/Inspection Engineer. CIP/MICC will be issued by POWERGRID based on review of test reports/certificates of manufacturers.
- **Level II**: EPC Contractor to raise all inspection calls and carry out the inspection on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during inspection, the same would be intimated to EPC Contractor and CIP/MICC will be issued by POWERGRID. Else, EPC Contractor would submit their test reports/certificates to POWERGRID. CIP/MICC will be issued by POWERGRID based on review of test reports/ certificates.
- Level III: EPC Contractor to raise inspection calls for both, stage (as applicable) & final inspection and carry out the stage inspections (if applicable) on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during stage inspection, the same would be intimated to EPC Contractor and CIP will be issued by POWERGRID. Else, EPC Contractor would submit the test reports / certificates of stage inspection after their own review and CIP will be issued by POWERGRID based on review of test reports / certificates. Final inspection will be carried out by POWERGRID and CIP/MICC will be issued by POWERGRID.
- **Level IV**: EPC Contractor to raise inspection calls for both, stage (as applicable) & final inspections. POWERGRID will carry out the inspection for both stage & final inspection as per applicable standards/specification and CIP/MICC will be issued by POWERGRID.
- 8.3.2 Bidder shall ensure that to implement the above inspection levels, particularly for the quality control and inspection at sub-vendor's works, they would depute sufficient qualified & experienced manpower in their Quality Control and Inspection department. Further, to assure quality of construction, Bidder shall have a separate workforce having

appropriate qualification & experience and deploy suitable tools and plant for maintaining quality requirement during construction in line with applicable Field Quality Plan (FQP).

Wherever references to SFQP is made in Technical Specifications, it shall be the latest edition/revision of the same uploaded up to seven (7) days prior to the actual date of bid opening.

- 8.3.3 The Employer, his duly authorised representative and/or outside inspection agency acting on behalf of the Employer shall have at all reasonable times access to the Bidder's premises or Works and shall have the power at all reasonable times to ensure that proper Quality Management practices / norms are adhered to, inspect and examine the materials & workmanship of the Works, to carry out Quality/Surveillance Audit during manufacture or erection and if part of the Works is being manufactured or assembled at other premises or works. The Bidder shall obtain for the Employer and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Bidder's own premises or works. The item/equipment, if found unsatisfactory with respect to workmanship or material is liable to be rejected. The observations for improvements during product/ process inspection by POWERGRID shall be recorded in Quality Improvement Register (available & maintained at works) for review & timely compliance of observations.
- 8.3.4 EPC Contractor shall submit inspection calls over internet through POWERGRID website. The required vendor code and password to enable raising inspection call will be furnished to the main EPC Contractor within 30 days of award of contract on submission of documents by EPC Contractor. After raising the inspection calls, EPC Contractor shall then proceed as per the message of that particular call which is available on the message board.
- The Employer reserves the right to witness any or all type, acceptance and routine tests 8.3.5 specified for which the Bidder shall give the Employer/Inspector Twenty-one (21) days written notice of any material being ready for testing for each stage of testing as identified in the approved quality plan as customer inspection point (CIP) for indigenous inspections. All inspection calls for overseas material shall be given at least forty-five (45) days in advance. Such tests shall be to the Bidder's account except for the expenses of the Inspection Engineer. The Employer/inspector, unless witnessing of the tests is waived by Employer, will attend such tests within Twenty one (21) days of the date of which the equipment is notified as being ready for test/inspection, failing which the Bidder may proceed with the test which shall be deemed to have been made in the Inspector's presence and he shall forthwith forward to the Inspector three copies of tests, duly certified. Bidder shall ensure, before giving notice for type test, that all drawings and quality plans have been got approved. The equipment shall be dispatched to site only after approval of Routine and Acceptance test results and Issuance of Dispatch Clearance in writing by the Employer. CIP/Material Inspection clearance certificate (MICC) shall be issued by the Employer after inspection of the equipment or review of test reports as applicable. Employer may waive off the presence of Employer's inspecting engineer. In that case test will be carried out as per approved QP and test certificate will be furnished by the supplier for approval. CIP/MICC will be issued only after review and approval of the test reports.
- 8.3.6 Bidder shall generally offer material for inspection as per supply bar chart approved by POWERGRID and not before 30 days from schedule indicated in the bar chart. In case Bidder offers material(s) for inspection prior to 30 days from the scheduled date with necessary approval of POWERGRID, POWERGRID shall inspect the material and issue CIP only. However, in such an exceptional case, MICC shall be issued only as per provision of original / revised approved supply schedule.
- 8.3.7 Bidder shall minimize the number of inspection calls by offering optimum quantities in each inspection call at the respective manufacturer's works.
- 8.3.8 Bidder shall inspect the material themselves and only after they are fully convinced about the Quality, they shall offer the material for POWERGRID inspection and shall also ensure that relevant portion of LOA/NOA, approved drawing and data sheets along with

applicable Quality Plans are available at the works of Bidder or their Sub-vendor before the material is offered for inspection.

- 8.3.9 Bidder shall ensure that material which has been cleared for dispatch after inspection will be dispatched within 30 days in case of domestic supplies and within 60 days in case of Off-shore supplies from the date of issuance of CIP. Material which is not dispatched within stipulated time as above will be reoffered for POWERGRID inspection or specific approval of POWERGRID QA&I shall be obtained for delayed dispatch.
- 8.3.10 The Employer or IE shall give notice in writing to the Bidder, of any objection either to conformance to any drawings or to any equipment and workmanship which in his opinion is not in accordance with the Contract. The Bidder shall give due consideration to such objections and shall either make the modifications that may be necessary to meet the said objections or shall confirm in writing to the Employer/Inspection Engineer giving reasons therein, that no modifications are necessary to comply with the Contract.
- 8.3.11 All Test Reports and documents to be submitted in English during final inspection of equipment by POWERGRID or as and when required for submission.
- When the factory tests have been completed at the Bidder's or Sub-Bidder's works, the Employer/Inspection Engineer(IE) shall issue a certificate to this effect
 - within fifteen (15) days after completion of tests & submission of documents by Bidder/manufacturer but if the tests are not witnessed by the Employer/IE, the certificate shall be issued within fifteen (15) days of receipt of the Bidder's Test certificate by the Employer/IE. Bidder shall, on completion of all tests, submit test reports within Ten (10) days to POWERGRID IE. Failure of the Employer/IE to issue such a certificate shall not prevent the Bidder from proceeding with the Works. The completion of these tests or the issue of the certificate shall not bind the Employer to accept the equipment should, it, on further tests after erection, be found not to comply with the Contract.
- 8.3.13 In all cases, where the Contract provides for tests whether at the premises or works of the Bidder or of any Sub-vendor, the Bidder, except where otherwise specified, shall provide free of charge such items as labour, materials, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Employer/Inspector or his authorised representative to carry out effectively such tests of the equipment in accordance with the Contract and shall give facilities to the Employer/Inspection Engineer or to his authorised representative to accomplish testing.
- 8.3.14 The inspection and acceptance by Employer and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Bidder in respect of the agreed quality assurance programme forming a part of the Contract, or if such equipment is found to be defective at a later stage.
- 8.3.15 The Employer will have the right of having at his own expenses any other test(s) of reasonable nature carried out at Bidder's premises or at site or in any other place in addition of aforesaid type and routine tests, to satisfy that the material comply with the specification.
- 8.3.16 The Employer reserves the right for getting any additional field tests conducted on the completely assembled equipment at site to satisfy that material complies with specifications.
- 8.3.17 Rework/ Re-engineering, if any, on any item/equipment shall be carried out only after mutual discussions and in accordance with mutually agreed procedure. Bidder shall submit Joint Inspection Report of equipments under Re-Work/Re-Engineering alongwith procedure for the same to POWERGRID for approval, before taking up the ReWork/Re-Engineering, failing which POWERGRID reserves the right to reject the equipment.
- 8.3.19 Bidder shall ensure that all possible steps are taken to avoid damages to the equipment during transport, storage and erection 44

- 8.3.20 Bidder shall implement additional stringent quality checks and preparation during installation of GIS at site (if applicable) as per POWERGRID approved guidelines/Technical specifications.
- 8.3.21 Bidder shall ensure commissioning of all CSDs along with Circuit Breakers wherever applicable.
- 8.3.23 The Employer reserves the right to increase or decrease their involvement in inspections at Bidder's Works or at his Sub-Bidder's premises or at the Employer's site or at any other place of Work based on performance of Bidder/sub-vendor.

9.0 TYPE TESTING & CLEARANCE CERTIFICATE

- 9.1 All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under respective sections.
- 9.2 The reports for all type tests as per technical specification shall be furnished by the Bidder along with equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all projects with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID/representative authorized by POWERGRID/representative of Utility /representative of accredited test lab/ representative of The National Accreditation Board for Certification Bodies (NABCB) certified agency shall also be acceptable.

Unless otherwise specified elsewhere, the type test reports submitted shall be of the tests conducted within the years specified below from the date of NOA. In case the test reports are of the test conducted earlier than the years specified below from the date of NOA, the bidder shall repeat these test(s) at no extra cost to the Employer.

Extract from Section Project:

The bidder shall offer type tested equipment for the project and the Employer shall accept the equipment type test reports under the following conditions:

- i) Type test in accordance with the relevant specified Standards & Technical specification.
- (ii) The Type tested equipment shall be of a similar design, insulation class as per the equipment offered under this contract. Technical justification shall be submitted for differences between tested and offered equipment, if any. Employer's interpretation in this regard shall be final.

In the event that equipment furnished includes important modifications of, or significant departure from, the designs of equipment on which type test report has been furnished or if there is evidence that the equipment does not comply with the requirements of the Specifications, type test procedure was not properly followed as laid down in standards, the Bidder shall conduct the type test without any cost implication to the Employer.

In the price bid, the test charges shall be included in the contract price and no separate test charges shall be indicated by the bidder.

Unless otherwise specified elsewhere, the type test reports submitted shall be of the tests conducted within the years specified below from the date of NOA. In case the test reports are of the test conducted earlier than the years specified below from the date of NOA, the bidder shall repeat these test(s) at no extra cost to the Employer.

S.No	Name of Equipment	Validity of type test (in years)
1	Power Transformer	5
2	LT Transformer (33 kV and below)	5
3	Shunt Reactor	5
4	OLTC	10
5	Bushing of Power Transformers/Reactors	7
6	Fittings and accessories for Power transformers, Reactors	10
7	Circuit Breaker	10
8	Isolator	10
9	Lighting Arrester	10
10	Wave Trap	10
11	Instrument transformer	10
12	GIS & Hybrid GIS	15
13	LT Switchgear, MV Switchgear	10
14	Cable and associated accessories	10
15	Relay	7
16	Capacitors	10
17	Battery & Battery Charger	7
18	Conductor & Earth wire	10
19	AC Insulators (Porcelain/Glass)	10
20	AC Composite Insulators	5
21	PLCC	5
22	DC equipment (Converter Transformer and bushings, Thyristor	15
	valves, DC measuring devices, Smoothing Reactor, AC & DC	
	Filter components, DC switchgear, DC wall bushings, DC	
	arresters, PLC/RI or other high frequency filter components or	
	any equipment covered under HVDC system)	

Table- 1: Validity of Type test for major equipment

Fibre-optic communication equipment, ventilation system and any other equipment not covered above, tests performed within 10 years from date of NOA shall be considered subject to condition that either the type tests were performed on the identical equipment or performed on an equipment of similar design. A justification report shall also be submitted by Bidder along with the type-test report for Employer's review.

For standard market products (like motors, air-compressors, air-conditioners, fans etc), of reputed make, from POWERGRID approved compendium of vendors, the same can be accepted on submission of suitable documentation as per standard POWERGRID practice in other projects.

All equipment shall be supplied from same manufacturing works, where from the previous equipment/ sample of same design/ process was manufactured and successfully type tested as per relevant (IS/IEC).

Acceptance of the type test reports shall be at the discretion of the Employer. In case the test reports are of the test conducted earlier than the years specified above from the date of NOA, the bidder shall repeat these test(s) at no extra cost to the Employer.

All type tests for equipment, if performed after the date of award of the Contract shall be witnessed by the Employer unless authority to proceed with the tests in his absence is

received from the Employer in writing. All expenses towards Employer deputation for witnessing of type testing, shall be borne by Employer.

The Bidder shall intimate the Employer the detailed program about the type tests at least two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

Note: For all other equipment's validity of type test shall be 10 years from date of NOA

Further, in the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost implication to the Employer.

The Bidder shall intimate the Employer the detailed program about the type tests at least two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

- 9.3 The Employer intends to repeat those type tests which are indicated in the price schedule and the same shall be payable as per provision of contract. The price of conducting type tests shall be included in Bid price and break up of these shall be given in the relevant schedule of Bid Proposal Sheets. These Type test charges would be considered in bid evaluation. In case Bidder does not indicate charges for any of the type tests or does not mention the name of any test in the price schedules, it will be presumed that the particular test has been offered free of charge. Further, in case any Bidder indicates that he shall not carry out a particular test, his offer shall be considered incomplete and shall be liable to be rejected. The Employer reserves the right to waive the repeating of type tests partly or fully and in case of waival, test charges for the same shall not be payable.
- 9.4 The Employer reserves the right to witness any or all the type tests. The Employer shall bear all expenses for deputation of Employer's representative(s) for witnessing the type tests except in the case of re-deputation if any, necessitated due to no fault of the Employer.
- 9.5 The list of makes of various items, for which Type test reports are not required to be submitted are specified at Annexure-J.

10.0 TESTS

10.1 Pre-commissioning Tests

On completion of erection of the equipment and before charging, each item of the equipment shall be thoroughly cleaned and then inspected jointly by the Employer and the Bidder for correctness and completeness of installation and acceptability for charging, leading to initial pre-commissioning tests at Site. The list of pre-commissioning tests to be performed are given in respective chapters and shall be included in the Bidder's quality assurance programme.

10.2 Commissioning Tests

- 10.2.1 The available instrumentation and control equipment will to be used during such tests and the Employer will calibrate, all such measuring equipment and devices as far as practicable.
- Any special equipment, tools and tackles required for the successful completion of the Commissioning Tests shall be arranged by the Bidder at his own cost.
- 10.2.3 The specific tests requirement on equipment have been brought out in the respective chapters of the technical specification.

11.0 PACKAGING & PROTECTION

- All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. On request of the Employer, the Bidder shall also submit packing details/associated drawing for any equipment/material under his scope of supply, to facilitate the Employer to repack any equipment/material at a later date, in case the need arises. While packing all the materials, the limitation from the point of view of availability of Railway wagon sizes in India should be taken into account. The Bidder shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Bidder. Employer takes no responsibility of the availability of the wagons.
- All coated surfaces shall be protected against abrasion, impact, discolouration and any other damages. All exposed threaded portions shall be suitably protected with either a metallic or a non-metallic protecting device. All ends of all valves and pipings and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage.

12.0 FINISHING OF METAL SURFACES

All metal surfaces shall be subjected to treatment for anti-corrosion protection. All ferrous surfaces for external use unless otherwise stated elsewhere in the specification or specifically agreed, shall be hot-dip galvanized after fabrication. All steel conductors including those used for earthing/grounding (above ground level) shall also be galvanized according to IS: 2629.

12.2 HOT DIP GALVANISING

- The minimum weight of the zinc coating shall be 610 gm/sq.m and minimum average thickness of coating shall be 86 microns for all items having thickness 6mm and above and 900 gm/sq.m for coastal area (if defined in Section Project) For items lower than 6mm thickness requirement of coating thickness shall be as per relevant ASTM. For surface which shall be embedded in concrete, the zinc coating shall be 610 gm/sq.m minimum and 900 gm/sq.m for coastal area (if specified in Section-Project).
- The galvanized surfaces shall consist of a continuous and uniform thick coating of zinc, firmly adhering to the surface of steel. The finished surface shall be clean and smooth and shall be free from defects like discoloured patches, bare spots, unevenness of coating, spelter which is loosely attached to the steel globules, spiky deposits, blistered surface, flaking or peeling off, etc. The presence of any of these defects noticed on visual or microscopic inspection shall render the material liable to rejection.
- 12.2.3 After galvanizing, no drilling or welding shall be performed on the galvanized parts of the equipment excepting that nuts may be threaded after galvanizing. Sodium dichromate or alternate approved treatment shall be provided to avoid formation of white rust after hot dip galvanization.
- 12.2.4 The galvanized steel shall be subjected to four numbers of one minute dips in copper sulphate solution as per IS-2633.
- 12.2.5 Sharp edges with radii less than 2.5 mm shall be able to withstand four immersions of the Standard Preece test. All other coatings shall withstand six immersions. The following galvanizing tests should essentially be performed as per relevant Indian Standards.
 - Coating thickness
 - Uniformity of zinc
 - Adhesion test
 - Mass of zinc coating
- 12.2.6 Galvanised material must be transported properly to ensure that galvanised surfaces are not damaged during transit. Application of touch-up zinc rich paint at site shall be allowed with approval of Engineer Incharge.

12.3 PAINTING

- 12.3.1 All sheet steel work shall be degreased, pickled, phosphated in accordance with the IS6005 "Code of practice for phosphating iron and sheet". All surfaces, which will not be easily accessible after shop assembly, shall beforehand be treated and protected for the life of the equipment. The surfaces, which are to be finished painted after installation or require corrosion protection until installation, shall be shop painted with at least two coats of primer. Oil, grease, dirt and swaf shall be thoroughly removed by emulsion
 - cleaning. Rust and scale shall be removed by pickling with dilute acid followed by washing with running water, rinsing with slightly alkaline hot water and drying.
- Hot Phosphating shall be done for phosphating process under pretreatment of sheets After phosphating, thorough rinsing shall be carried out with clean water followed by final rinsing with dilute dichromate solution and oven drying. The phosphate coating shall be sealed with application of two coats of ready mixed, stoving type zinc chromate primer. The first coat may be "flash dried" while the second coat shall be stoved.
- 12.3.3 After application of the primer, two coats of finishing synthetic enamel paint shall be applied, each coat followed by stoving. The second finishing coat shall be applied after inspection of first coat of painting.
- 12.3.4 The exterior and interior colour of the paint in case of new substations shall preferably be RAL 7032 for all equipment, marshalling boxes, junction boxes, control cabinets, panels etc. unless specifically mentioned under respective sections of the equipments. Glossy white colour inside the equipments /boards /panels/junction boxes is also acceptable. The exterior colour for panels shall be matching with the existing panels in case of extension of a substation. Each coat of primer and finishing paint shall be of slightly different shade to enable inspection of the painting. A small quantity of finishing paint shall be supplied for minor touching up required at site after installation of the equipments.
- 12.3.5 In case the bidder proposes to follow his own standard surface finish and protection procedures or any other established painting procedures, like electrostatic painting etc., the procedure shall be submitted during detailed engineering for Employer's review & approval.
- 12.3.6 The colour scheme as given below shall be followed for Fire Protection and Air Conditioning systems

S.No.	PIPE LINE	Base colour	Band colour
Fire Pr	otection System		
1	Hydrant and Emulsifier system pipeline/NIFPS	FIRE RED	-
2	Emulsifier system detection line – water	FIRE RED	Sea Green
3	Emulsifier system detection line –Air	FIRE RED	Sky Blue
4	Pylon support pipes	FIRE RED	
Air Co	nditioning Plant		
5	Refrigerant gas pipeline – at compressor suction	Canary Yellow	-
6	Refrigerant gas pipeline – at compressor discharge	Canary Yellow	Red
7	Refrigerant liquid pipeline	Dark Admiralty Green	-
8	Chilled water pipeline	Sea Green	-
9	Condenser water pipeline	Sea Green	Dark Blue

The direction of flow shall be marked by \rightarrow (arrow) in black colour.

Base Colour Direction of flow Band Colour

- 12.3.7 For aluminium casted surfaces, the surface shall be with smooth finish. Further, in case of aluminium enclosures, the surface shall be coated with powder (coating thickness of 60 microns) after surface preparation for painting. For stainless steel surfaces, no painting is envisaged.
- 12.3.8 Band colour is required for Emulsifier system detection line only if both water and air detection lines are present at the same substation. Further, band colour shall be applied at an interval of 2 meters approx. along the length and minimum width of band shall be 25mm.

13.0 HANDLING, STORING AND INSTALLATION

- 13.2 EPC Contractor may engage manufacturer's Engineers to supervise the unloading, transportation to site, storing, testing and commissioning of the various equipment being procured by them separately. EPC Contractor shall unload, transport, store, erect, test and commission the equipment as per instructions of the manufacturer's supervisory Engineer(s) and shall extend full cooperation to them.
- Bidder shall also do necessary adjustments/alignments for proper operation of circuit breakers, isolators and their operating mechanisms. All components shall be protected against damage during unloading, transportation, storage, installation, testing and commissioning. Any equipment damaged due to negligence or carelessness or otherwise shall be replaced by the Bidder at his own expense.
- 13.6 The Bidder shall be solely responsible for any shortages or damages in loading, handling and in transit of the equipment up to Site. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Bidder.
- The design and workmanship shall be in accordance with the best engineering practices to ensure satisfactory performance throughout the service life.

13.13 Equipment Bases

A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base unless otherwise agreed to by the Employer. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.

13.14 Erection, testing and commissioning of Transformers, Reactors, Circuit breakers, Isolators, Substation automation system, Control & protection panels, PLCC, PMU, Telecommunication Equipments, NIFPS System etc. shall be done by the EPC Contractor under the supervision of respective equipment manufacturers. Charges for the above supervision shall be included by the bidder for the respective equipment in the BPS.

14.0 TOOLS

TOOLS & PLANTS (T&P) – Please refer Section-1 for scope under 14.1

The Bidder shall arrange all T&P (such as necessary supports, cranes, ladders, platforms etc.) for erection, testing & commissioning of the system at his own cost. Further, all consumables, wastage and damages shall be to the account of bidder.

All such T&P shall be taken back by the bidder after commissioning of the system.

14.2 SPECIAL TOOLS AND TACKLES

The bidder shall supply all special tools and tackles required for Operation and maintenance of equipment. The special tools and tackles shall only cover items which are specifically required for the equipment offered and are proprietary in nature. The

list of special tools and tackles, if any, shall be finalized during detail engineering and the same shall be supplied without any additional cost implication to the Employer.

15.0 AUXILIARY SUPPLY

The auxiliary power for station supply, including the equipment drive, cooling system of any equipment, air-conditioning, lighting etc shall be designed for the specified Parameters as under. The DC supply for the instrumentation and PLCC system shall also conform the parameters as indicated in the following table:

Normal Voltage	Variation in Voltage	Frequency in HZ	Phase/Wire	Neutral connection
415V	<u>+</u> 10%	50 <u>+</u> 5%	3/4 Wire	Solidly Earthed.
240V	<u>+</u> 10%	50 <u>+</u> 5%	1/2 Wire	Solidly Earthed.
220V	190V to 240V	DC	Isolated 2 wire System	-
110V	95V to 120V	DC	Isolated 2 wire System	-
48V		DC	2 wire system (+) earthed	-

Combined variation of voltage and frequency shall be limited to \pm 10%.

Pickup value of binary input modules of Intelligent Electronic Devices, Digital protection couplers, Analog protection couplers shall not be less than 50% of the specified rated station auxiliary DC supply voltage level.

16.0 SUPPORT STRUCTURE

- The equipment support structures shall be suitable for equipment connections at the first level i.e 14.0 meter, 8.0 meter, 5.9 meter and 4.6 meter from plinth level for 765kV, 400kV, 220kV and 132kV substations respectively. All equipment support structures
 - shall be supplied alongwith brackets, angles, stools etc. for attaching the operating mechanism, control cabinets & marshalling box (wherever applicable) etc.
- The minimum vertical distance from the bottom of the lowest porcelain/polymer part of the bushing, porcelain/polymer enclosures or supporting insulators to the bottom of the equipment base, where it rests on the foundation pad shall be 2.55 metres.

17.0 CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS

(In bidder's scope if indicated in Section-1)

17.1 All power clamps and connectors shall conform to IS:5561 or other equivalent international standard and shall be made of materials listed below:

Sl. No.	Description	Materials
	For connecting ACSR conductors/AAC conductors/	Aluminum alloy casting, conforming to designation 4600 of IS:617 and all test
	Aluminium tube 51	shall conform to IS:617

b)	For connecting equipment terminals mad of copper with ACSR conductors/AAC conductors/ Aluminium tube	Bimetallic connectors made from aluminum alloy casting, conforming to designation 4600 of IS:617 with 2mm thick bimetallic liner/strip and all test shall conform to IS:617
c)	For connecting G.I	Galvanised mild steel shield wire
d)	Bolts, nuts & plain washers	Electro-galvanised for sizes below M12, for others hot dip galvanised.
e)	Spring washers	Electro-galvanised mild steel suitable for atleast service condition-3 as per IS:1573

- 17.2 Necessary clamps and connectors shall be supplied for all equipment and connections. If corona rings are required to meet these requirements they shall be considered as part of that equipment and included in the scope of work.
- Where copper to aluminum connections are required, bi-metallic clamps shall be used, which shall be properly designed to ensure that any deterioration of the connection is kept to a minimum and restricted to parts which are not current carrying or subjected to stress.
- 17.4 Low voltage connectors, grounding connectors and accessories for grounding all equipment as specified in each particular case, are also included in the scope of Work.
- No current carrying part of any clamp shall be less than 10 mm thick. All ferrous parts shall be hot dip galvanised. Copper alloy liner/strip of minimum 2 mm thickness shall be cast integral with aluminum body or 2 mm thick bi-metallic liner/strips shall be provided for Bi-metallic clamps.
- 17.6 All casting shall be free from blow holes, surface blisters, cracks and cavities. All sharp edges and corners shall be blurred and rounded off.
- 17.7 Flexible connectors, braids or laminated straps made for the terminal clamps for bus posts shall be suitable for both expansion or through (fixed/sliding) type connection of IPS AL tube as required. In both the cases the clamp height (top of the mounting pad to centre line of the tube) should be same.
- 17.8 Current carrying parts (500A and above) of the clamp/connector shall be provided with minimum four numbers of bolts preferably for 132kV and above.
- 17.9 All current carrying parts shall be designed and manufactured to have minimum contact resistance.
- 17.10 Power Clamps and connectors shall be designed to control corona as per requirement.

17.11 Tests

Clamps and connectors should be type tested on minimum three samples as per IS:5561 and shall also be subjected to routine tests as per IS:5561. Following type test reports shall be submitted for approval. Type test once conducted shall hold good. The requirement of test conducted within last ten years, shall not be applicable.

- i) Temperature rise test (maximum temperature rise allowed is 35°C over 50°C ambient)
- ii) Short time current test
- iii) Corona (dry) and RIV (dry) test [for 132kV and above voltage level clamps]
- iv) Resistance test and Pullout strength test
- v) Cantilever Strength test on bus support clamps & connectors

18.0 CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES MARSHALLING BOXES FOR OUTDOOR EQUIPMENT

- 18.1 All types of boxes, cabinets etc. shall generally conform to & be tested in accordance with IS/IEC 61439-0, as applicable, and the clauses given below:
- 18.2 Control cabinets, junction boxes, Marshalling boxes & terminal boxes, Out door ACDB cum DCDB panels shall be made of stainless steel of atleast 1.5 mm thick or aluminum enclosure of atleast 1.6 mm thick and shall be dust, water and vermin proof. Stainless steel used shall be of grade SS304 (SS316 for coastal area) or better. The box shall be properly braced to prevent wobbling. There shall be sufficient reinforcement to provide level surfaces, resistance to vibrations and rigidity during transportation and installation. In case of aluminum enclosed box the thickness of aluminum shall be such that it provides adequate rigidity and long life as comparable with sheet steel of specified thickness.

Control cabinets, junction boxes, marshalling boxes & terminal boxes, out-door ACDB cum DCDB panels shall have adequate space/clearance as per guidelines/technical specifications to access/replace any component. Necessary component labelling to be also done on non-conducting sheet.

For CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES MARSHALLING BOXES

FOR OUTDOOR EQUIPMENT Junction Box, wire should be as per IS or equivalent IEC with FRLS grade

Machine laid PU Foam gasket may be permitted for use in Control Cabinets etc.

- 18.3 A canopy and sealing arrangements for operating rods shall be provided in marshalling boxes / Control cabinets to prevent ingress of rain water.
- 18.4 Cabinet/boxes with width more than 700 mm shall be provided with double hinged doors with padlocking arrangements. The distance between two hinges shall be adequate to ensure uniform sealing pressure against atmosphere.
- All doors, removable covers and plates shall be gasketed all around with suitably profiled EPDM/Neoprene/PU gaskets. The gasket shall be tested in accordance with approved quality plan, IS:11149 and IS:3400. Ventilating Louvers, if provided, shall have screen and filters. The screen shall be fine wire mesh made of brass.

Further, the gasketing arrangement shall be such that gaskets are pasted in slots (in door fabrication/gasket itself) in order to prevent ingression of dust and moisture inside the panels so that no internal rusting occurs in panels during the operation of the equipment.

- All boxes/cabinets shall be designed for the entry of cables by means of weather proof and dust-proof connections. Boxes and cabinets shall be designed with generous clearances to avoid interference between the wiring entering from below and any terminal blocks or accessories mounted within the box or cabinet. Suitable cable gland plate above the base of the marshalling kiosk/box shall be provided for this purpose along with the proper blanking plates. Necessary number of cable glands shall be supplied and fitted on this gland plate. Gland plate shall have provision for some future glands to be provided later, if required. The Nickel plated glands shall be dust proof, screw on & double compression type and made of brass. The gland shall have provision for securing armour of the cable separately and shall be provided with earthing tag. The glands shall conform to BS:6121.
- 18.7 A 240V, single phase, 50 Hz, 15 amp AC plug and socket shall be provided in the cabinet with ON-OFF switch for connection of hand lamps. Plug and socket shall be of industrial grade.
- 18.8 LED based illumination of minimum 9 watts shall be provided. The switching of the fittings shall be controlled by the door switch.

For junction boxes of smaller sizes such as lighting junction box, manual operated earth switch mechanism box etc., plug socket, heater and illumination is not required to be provided.

- 18.9 All control switches shall be of MCB/rotary switch type and Toggle/piano switches shall not be accepted.
- 18.10 Earthing of the cabinet shall be ensured by providing two separate earthing pads. The earth wire shall be terminated on to the earthing pad and secured by the use of self etching washer. Earthing of hinged door shall be done by using a separate earth wire.
- The bay marshalling kiosks shall be provided with danger plate and a diagram showing the numbering/connection/feruling by pasting the same on the inside of the door.
- 18.12 The following routine tests alongwith the routine tests as per IS:5039 shall also be conducted:
 - i) Check for wiring
 - ii) Visual and dimension check
- 18.13 The enclosure of bay marshalling kiosk, junction box, terminal box and control cabinets shall conform to IP-55 as per IS/IEC60947 including application of 1kV rms for 1 (one) minute, after IP-55 test.

19.0 DISPOSAL OF PACKING MATERIAL & WASTE FROM CONSTRUCTION SITE

After completion of the work, Bidder shall dispose-off all the packing & waste materials including empty conductor drums, cable drums, wooden containers, oil drums, gas cylinders and other waste/scrapped materials from construction site at his own cost and shall make the substation area properly cleaned.

20.0 TERMINAL BLOCKS AND WIRING

- 20.1 Control and instrument leads from the switchboards or from other equipment will be brought to terminal boxes or control cabinets in conduits. All interphase and external connections to equipment or to control cubicles will be made through terminal blocks.
- 20.2 Terminal blocks shall be 650V grade and have continuous rating to carry the maximum expected current on the terminals and non-breakable type. These shall be of moulded piece, complete with insulated barriers, stud type terminals, washers, nuts and lock nuts. Screw clamp, overall insulated, insertion type, rail mounted terminals can be used in place of stud type terminals. But the terminal blocks shall be non-disconnecting stud type except for the secondary junction boxes of Current Transformer and Voltage Transformer.
- 20.3 Terminal blocks for current transformer and voltage transformer secondary leads shall be provided with test links and isolating facilities. The current transformer secondary leads shall also be provided with short circuiting and earthing facilities.
- The terminal shall be such that maximum contact area is achieved when a cable is terminated. The terminal shall have a locking characteristic to prevent cable from escaping from the terminal clamp unless it is done intentionally.
- The conducting part in contact with cable shall preferably be tinned or silver plated however Nickel plated copper or zinc plated steel shall also be acceptable.
- The terminal blocks shall be of extensible design, multilayer terminal arrangement is not allowed in any junction box (Common MB, Individual MB, JB etc.). There should be sufficient space at both sides of terminals so that ferrule number of wires / TB numbers are clearly visible during wire removal or insertion.
- 20.7 The terminal blocks shall have locking arrangement to prevent its escape from the mounting rails.
- The terminal blocks shall be fully enclosed with removable covers of transparent, nondeteriorating type plastic material. Insulating barriers shall be provided between the terminal blocks. These barriers shall and thinder the operator from carrying out the wiring without removing the barriers.

- 20.9 Unless otherwise specified terminal blocks shall be suitable for connecting the following conductors on each side.
 - a) All circuits except Minimum of two of 2.5 sq mm copper flexible. CT/PT circuits
 - b) All CT/PT circuits Minimum of 4 nos. of 2.5 sq mm copper flexible.
- The arrangements shall be in such a manner so that it is possible to safely connect or disconnect terminals on live circuits and replace fuse links when the cabinet is live.
- 20.11 Atleast 20 % spare terminals shall be provided on each panel/cubicle/box and these spare terminals shall be uniformly distributed on all terminals rows.
- There shall be a minimum clearance of 250 mm between the First/bottom row of terminal block and the associated cable gland plate for outdoor ground mounted marshalling box and the clearance between two rows of terminal blocks shall be a minimum of 150 mm.
- The Bidder shall furnish all wire, conduits and terminals for the necessary interphase electrical connections (where applicable) as well as between phases and common terminal boxes or control cabinets.

21.0 LAMPS & SOCKETS

21.1 Lamps & Sockets

All lamps shall use a socket base as per IS-1258, except in the case of signal lamps.

All sockets (convenience outlets) shall be suitable to accept both 5 Amp & 15 Amp pin round Standard Indian plugs. They shall be switched sockets with shutters.

21.2 Hand Lamp:

A 240 Volts, single Phase, 50 Hz AC plug point shall be provided in the interior of each cubicle with ON-OFF Switch for connection of hand lamps.

21.3 Switches and Fuses:

- 21.3.1 Each panel shall be provided with necessary arrangements for receiving, distributing, isolating and fusing of DC and AC supplies for various control, signaling, lighting and space heater circuits. The incoming and sub-circuits shall be separately provided with miniature circuit breaker / switch fuse units. Selection of the main and Sub-circuit fuse ratings shall be such as to ensure selective clearance of sub-circuit faults. Potential circuits for relaying and metering shall be protected by HRC fuses.
- All fuses shall be of HRC cartridge type conforming to relevant IS mounted on plug-in type fuse bases. Miniature circuit breakers with thermal protection and alarm contacts will also be accepted. All accessible live connection to fuse bases shall be adequately shrouded. Fuses shall have operation indicators for indicating blown fuse condition. Fuse carrier base shall have imprints of the fuse rating and voltage.

22.0 BUSHINGS, HOLLOW COLUMN INSULATORS, SUPPORT INSULATORS:

- Bushings shall be manufactured and tested in accordance with IS:2099 & IEC-60137 while hollow column insulators shall be manufactured and tested in accordance with IEC-62155/IS:5621. The support insulators shall be manufactured and tested as per IS:2544/IEC-60168 and IEC-60273. The insulators shall also conform to IEC-60815 as applicable.
 - The bidder may also offer composite hollow insulators, conforming to IEC-61462.
- Support insulators, bushings and hollow column insulators shall be manufactured from high quality porcelain. Porcelain used shall be homogeneous, free from laminations, cavities and other flaws or imperfections that might affect the mechanical or dielectric quality and shall be thoroughly vitrified tough and impervious to moisture.
- Glazing of the porcelain shall be uniform brown in colour, free from blisters, burrs and similar other defects.

- 22.4 Support insulators/bushings/hollow column insulators shall be designed to have ample insulation, mechanical strength and rigidity for the conditions under which they will be used.
- When operating at normal rated voltage there shall be no electric discharge between the conductors and bushing which would cause corrosion or injury to conductors, insulators or supports by the formation of substances produced by chemical action. No radio interference shall be caused by the insulators/bushings when operating at the normal rated voltage.
- Bushing porcelain shall be robust and capable of withstanding the internal pressures likely to occur in service. The design and location of clamps and the shape and the strength of the porcelain flange securing the bushing to the tank shall be such that there is no risk of fracture. All portions of the assembled porcelain enclosures and supports other than gaskets, which may in any way be exposed to the atmosphere shall be composed of completely non hygroscopic material such as metal or glazed porcelain.
- All iron parts shall be hot dip galvanised and all joints shall be air tight. Surface of joints shall be trued up porcelain parts by grinding and metal parts by machining. Insulator/bushing design shall be such as to ensure a uniform compressive pressure on the joints.
- In case, different designs of lattice and pipe structures other than Employer supplied structures are required to be adopted in view of higher creepage (31mm/kV) of the switchgear/equipment's, insulator strings, bushings & bus post insulators etc., Design, supply & erection of such structures shall be in the scope of bidder against respective standard structure. However dimensional details (except height) shall not be less than that specified in standard structure drawing of respective equipment's.

23.0 MOTORS

Motors shall be "Squirrel Cage" three phase induction motors of sufficient size capable of satisfactory operation for the application and duty as required for the driven equipment and shall be subjected to routine tests as per applicable standards. The motors shall be of approved make.

23.1 Enclosures

- a) Motors to be installed outdoor without enclosure shall have hose proof enclosure equivalent to IP-55 as per IS: 4691. For motors to be installed indoor i.e. inside a box, the motor enclosure, shall be dust proof equivalent to IP-44 as per IS: 4691.
- b) Two independent earthing points shall be provided on opposite sides of the motor for bolted connection of earthing conductor.
- c) Motors shall have drain plugs so located that they will drain water resulting from condensation or other causes from all pockets in the motor casing.
- d) Motors weighing more than 25 Kg. shall be provided with eyebolts, lugs or other means to facilitate lifting.

23.2 Operational Features

- a) Continuous motor rating (name plate rating) shall be at least ten (10) percent above the maximum load demand of the driven equipment at design duty point and the motor shall not be over loaded at any operating point of driven equipment that will rise in service.
- b) Motor shall be capable at giving rated output without reduction in the expected life span when operated continuously in the system having the particulars as given in Clause 15.0 of this Section.

56

23.3 Starting Requirements:

- a) All induction motors shall be suitable for full voltage direct-on-line starting. These shall be capable of starting and accelerating to the rated speed alongwith the driven equipment without exceeding the acceptable winding temperature even when the supply voltage drops down to 80% of the rated voltage.
- b) Motors shall be capable of withstanding the electrodynamic stresses and heating imposed if it is started at a voltage of 110% of the rated value.
- c) The locked rotor current shall not exceed six (6) times the rated full load current for all motors, subject to tolerance as given in IS:325.
- d) Motors when started with the driven equipment imposing full starting torque under the supply voltage conditions specified under Clause 15.0 shall be capable of withstanding atleast two successive starts from cold condition at room temperature and one start from hot condition without injurious heating of winding. The motors shall also be suitable for three equally spread starts per hour under the above referred supply condition.
- e) The locked rotor withstand time under hot condition at 110% of rated voltage shall be more than starting time with the driven equipment of minimum permissible voltage by at least two seconds or 15% of the accelerating time whichever is greater. In case it is not possible to meet the above requirement, the Bidder shall offer centrifugal type speed switch mounted on the motor shaft which shall remain closed for speed lower than 20% and open for speeds above 20% of the rated speed. The speed switch shall be capable of withstanding 120% of the rated speed in either direction of rotation.

23.4 Running Requirements:

- a) The maximum permissible temperature rise over the ambient temperature of 50 degree C shall be within the limits specified in IS:325 (for 3-phase induction motors) after adjustment due to increased ambient temperature specified.
- b) The double amplitude of motor vibration shall be within the limits specified in IS: 4729. Vibration shall also be within the limits specified by the relevant standard for the driven equipment when measured at the motor bearings.
- c) All the induction motors shall be capable of running at 80% of rated voltage for a period of 5 minutes with rated load commencing from hot condition.

23.5 TESTING AND COMMISSIONING

An indicative list of tests is given below. Bidder shall perform any additional test based on specialities of the items as per the field Q.P./Instructions of the equipment Bidder or Employer without any extra cost to the Employer. The Bidder shall arrange all instruments required for conducting these tests alongwith calibration certificates and shall furnish the list of instruments to the Employer for approval.

- (a) Insulation resistance.
- (b) Phase sequence and proper direction of rotation.
- (c) Any motor operating incorrectly shall be checked to determine the cause and the conditions corrected.

CORONA AND RADIO INTERFERENCE VOLTAGE (RIV) TEST

1. General

Unless otherwise stipulated, all equipment together with its associated connectors, where applicable, shall be tested for external corona (for 400kV & above) both by observing the voltage level for the extinction of visible corona under falling power frequency voltage and by measurement of radio interference voltage (RIV) for 132kV and above.

2. Test Levels:

The test voltage levels for measurement of external RIV and for corona extinction voltage are listed under the relevant clauses of the specification.

3. Test Methods for RIV:

- 3.1 RIV tests shall be made according to measuring circuit as per International Special Committee on Radio Interference (CISPR) Publication 16-1(1993) Part 1. The measuring circuit shall preferably be tuned to frequency with 10% of 0.5 Mhz but other frequencies in the range of 0.5 MHz to 2 MHz may be used, the measuring frequency being recorded. The results shall be in microvolts.
- 3.2 Alternatively, RIV tests shall be carried out in accordance with relevant IEC of respective equipment or NEMA standard Publication No. 107-1964.
- 3.3 In measurement of, RIV, temporary additional external corona shielding may be provided. In measurements of RIV only standard fittings of identical type supplied with the equipment and a simulation of the connections as used in the actual installation will be permitted in the vicinity within 3.5 meters of terminals.
- Ambient noise shall be measured before and after each series of tests to ensure that there is no variation in ambient noise level. If variation is present, the lowest ambient noise level will form basis for the measurements. RIV levels shall be measured at increasing and decreasing voltages of 85%, 100%, and 110% of the specified RIV test voltage for all equipment unless otherwise specified. The specified RIV test voltage for 765kV, 400 kV, 220 KV is listed in the detailed specification together with maximum permissible RIV level in microvolts.
- 3.5 The metering instruments shall be as per CISPR recommendation or equivalent device so long as it has been used by other testing authorities.
- 3.6 The RIV measurement may be made with a noise meter. A calibration procedure of the frequency to which noise meter shall be tuned shall establish the ratio of voltage at the high voltage terminal to voltage read by noise meter.

4. Test Methods for Visible Corona

The purpose of this test is to determine the corona extinction voltage of apparatus, connectors etc. The test shall be carried out in the same manner as RIV test described above with the exception that RIV measurements are not required during test and a search technique shall be used near the onset and extinction voltage, when the test voltage is raised and lowered to determine their precise values. The test voltage shall be raised to 110% of specified corona extinction voltage and maintained there for five minutes. In case corona inception does not take place at 110%, test shall be stopped, otherwise test shall be continued and the voltage will then be decreased slowly until all

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)

visible corona disappears. The procedure shall be repeated at least 3 times with corona inception and extinction voltage recorded each time. The corona extinction voltage for purposes of determining compliance with the specification shall be the lowest of the three values at which visible corona (negative or positive polarity) disappears.

The test to determine the visible corona extinction voltage need not be carried out simultaneously with test to determine RIV levels.

However, both test shall be carried out with the same test set up and as little time duration between tests as possible. No modification on treatment of the sample between tests will be allowed. Simultaneous RIV and visible corona extinction voltage testing may be permitted at the discretion of Employer's inspector if, in his opinion, it will not prejudice other test.

5. Test Records:

In addition to the information previously mentioned and the requirements specified as per CISPR or NEMA 107-1964 the following data shall be included in test report:

- a) Background noise before and after test.
- b) Detailed procedure of application of test voltage.
- c) Measurements of RIV levels expressed in micro volts at each level.
- d) Results and observations with regard to location and type of interference sources detected at each step.
- e) Test voltage shall be recorded when measured RIV passes through 100 microvolts in each direction.
- f) Onset and extinction of visual corona for each of the four tests required shall be recorded.

SEISMIC WITHSTAND TEST PROCEDURE

The seismic withstanding test on the complete equipment (for 400kV and above) shall be carried out along with supporting structure. Seismic Withstand Test carried out using either lattice or pipe structure is acceptable." **Seismic Calculations certified by NABL Labs shall also be acceptable**

The Bidder shall arrange to transport the structure from his Bidder's premises/POWERGRID sites for the purpose of seismic withstand test only.

The seismic level specified shall be applied at the base of the structure. The accelerometers shall be provided at the Terminal Pad of the equipment and any other point as agreed by the Employer. The seismic test shall be carried out in all possible combinations of the equipment. The seismic test procedure shall be furnished for approval of the Employer.

The frequency range for the earthquake spectra shall be as per IEC-62271-300.

LIST OF GENERAL STANDARDS AND CODES

CODES	TITLE
	India Electricity Rules
	Indian Electricity Act
	Indian Electricity (Supply) Act
	Indian Factories Act
IS-5	Colors for Ready Mixed Paints and Enamels
IS-335	New Insulating Oils
IS-617	Aluminium and Aluminium Alloy Ingots and Castings for General Engineering Purposes
IS-1448 (P1 to P 145)	Methods of Test for Petroleum and its Products
IS-2071 (P1 to P3)	Methods of High Voltage Testing
IS-12063	Classification of degrees of protection provided by enclosures of electrical equipment
IS-2165 ; P1:1997, P2:1983	Insulation Coordination
IS-3043	Code of Practice for Earthing
IS-6103	Method of Test for Specific Resistance (Resistivity) of Electrical Insulating Liquids
IS-6104	Method of Test for Interfacial Tension of Oil against Water by the Ring Method
IS-6262	Method of test for Power factor & Dielectric Constant of Electrical Insulating Liquids
IS-6792	Method for determination of electric strength of insulating oils
IS-5578	Guide for marking of insulated conductors
IS-11353	Guide for uniform system of marking & identification of conductors & apparatus terminals.
IS-8263	Methods for Radio Interference Test on High voltage Insulators
IS-9224 (Part 1,2&4)	Low Voltage Fuses
IEC-60060 (Part 1 to P4)	High Voltage Test Techniques
IEC 60068	Environmental Test
IEC-60117	Graphical Symbols
IEC-60156	Method for the Determination of the Electrical Strength of Insulation Oils
IEC-60270	Partial Discharge Measurements
IEC-60376	Specification and Acceptance of New Sulphur Hexafloride
IEC-60437	Radio Interference Test on High Voltage Insulators
IEC-60507	Artificial Pollution Tests on High Voltage Insulators to be used on AC Systems

IEC-62271-1	Common Specification for High Voltage Switchgear & Control gear Standards
IEC-60815	Guide for the Selection of Insulators in respect of Polluted Conditions
IEC-60865 (P1 & P2)	Short Circuit Current - Calculation of effects
ANSI-C.1/NFPA.70	National Electrical Code
ANSI-C37.90A	Guide for Surge Withstand Capability (SWC) Tests
ANSI-C63.21, C63.3	Specification for Electromagnetic Noise and Field Strength Instrumentation 10 KHz to 1 GHZ
C36.4ANSI-C68.1	Techniquest for Dielectric Tests
ANSI-C76.1/EEE21	Standard General Requirements and Test Procedure for Outdoor Apparatus Bushings
ANSI-SI-4	Specification for Sound Level Meters
ANSI-Y32-2/C337.2	Drawing Symbols
ANSI-Z55.11	Gray Finishes for Industrial Apparatus and Equipment No. 61 Light Gray
NEMA-107T	Methods of Measurements of RIV of High Voltage Apparatus
NEMA-ICS-II	General Standards for Industrial Control and Systems Part ICSI109
CISPR-1	Specification for CISPR Radio Interference Measuring Apparatus for the frequency range 0.15 MHz to 30 MHz
CSA-Z299.1-1978h	Quality Assurance Program Requirements
CSA-Z299.2-1979h	Quality Control Program Requirements
CSA-Z299.3-1979h	Quality Verification Program Requirements
CSA-Z299.4-1979h	Inspection Program Requirements
TRANSFORMERS AND RE	ACTORS
IS:10028 (Part 2 & 3)	Code of practice for selection, installation & maintenance of Transformers (P1:1993), (P2:1991), (P3:1991)
IS-2026 (P1 to P4)	Power Transformers
IS-3347 (part 1 to Part 8)	Dimensions for Porcelain transformer Bushings for use in lightly polluted atmospheres
IS-3639	Fittings and Accessories for Power Transformers
IS-6600	Guide for Loading of oil immersed Transformers
IEC-60076 (Part 1 to 5)	Power Transformers
IEC-60214	On-Load Tap-Changers
IEC-60289	Reactors
IEC- 60354	Loading Guide for Oil - Immersed power transformers
IEC-60076-10	Determination of Transformer and Reactor Sound Levels

ANSI-C571280	General requirements for Distribution, Power and Regulating Transformers
ANSI-C571290	Test Code for Distribution, Power and Regulation Transformers
ANSI-C5716	Terminology & Test Code for Current Limiting Reactors
ANSI-C5721	Requirements, Terminology and Test Code for Shunt Reactors Rated Over 500 KVA
ANSI-C5792	Guide for Loading Oil-Immersed Power Transformers upto and including 100 MVA with 55 deg C or 65 deg C Winding Rise
ANSI-CG,1EEE-4	Standard Techniques for High Voltage Testing
IEC 60076	Power transformers
IEC 60076-1	Part 1: General
IEC 60076-2	Part 2: Temperature rise
IEC 60076-3	Part 3: Insulation levels, dielectric tests and external clearances in air
IEC 60076-4	Part 4: Guide to the lightning impulse and switching impulse testing - Power transformers and reactors
IEC 60076-3-1	Part 3-1: Insulation Levels and Dielectric Tests –External Clearances in Air
IEC 60076-5	Part 5: Ability to withstand short circuit
IEC 60076-6	Part 6: Reactors
IEC 60076-7	Part 7: Loading guide for oil-immersed power transformers
IEC 60076-8	Part 8: Application guide
IEC 60076-10	Part 10: Determination of sound levels
IEC 60076-10-1	Part 10-1: Determination of sound levels - Application guide
IEC 60076-11	Part 11: Dry-type transformers
IEC 60076-12	Part 12: Loading guide for dry-type power transformers
IEC 60076-13	Part 13: Self-protected liquid-filled transformers
IEC 60076-14	Part 14: Design and application of liquid-immersed power transformers using high-temperature insulation materials
IEC 60076-15	Part 15: Gas-filled power transformers
IEC 60076-16	Part 16: Transformers for wind turbine applications
IEC 60076-18	Part 18: Measurement of frequency response
IEC 60076-19	Part 19: Rules for the determination of uncertainties in the measurement of losses in power transformers and reactors
IEC 60076-21	Part 21: Standard requirements, terminology, and test code for step-voltage regulators
IEC 60044, BS 3938	Current transformers
IEC 60050	International Electrotechnical Vocabulary

IEC 60050(421)	International Electrotechnical vocabulary- Chapter 421: Power Transformers and Reactors
IEC 60060	High Voltage test techniques
IEC 60060-1	General definitions and test requirements
IEC 60060-2	Measuring systems
IEC 60071	Insulation co-ordination
IEC 60071-1	Part 1: Definitions, principles and rules
IEC 60071-2	Part 2: Application guide
IEC 60137	Bushing for alternating voltage above 1000V
IEC 60214	On-Load Tap changers
IEC 255-21-3	Relays vibration
IEC 60270	Partial discharge measurements
IEC 60296	Specification for Unused Mineral Oil for Transformers and Switchgear
IEC 60422	Supervision and Maintenance guide for Mineral Insulating Oil in Electrical Equipment
IEC 60475	Method of Sampling Liquid dielectrics
IEC 60529	Classification of Degrees of Protection provided by Enclosures
IEC 60542	Application Guide for On-Load Tap-Changers
IEC 60567	Guide for the Sampling of Gases and of Oil from Oil-filled Electrical Equipment for the Analysis of Free and Dissolved Gases
IEC 60651	Sound Level Meters
IEC 61083	Digital Recorders and Software for High Voltage Impulse testing
IEC 61083-1	Part 1: Requirements for digital recorders in high voltage impulse tests
IEC 61083-2	Part 2: Evaluation of software used for the determination of the parameters of impulse waveforms
CISPR 16	Specification for radio disturbance and immunity measuring apparatus
CISPR 16-1	Radio disturbance and immunity measuring apparatus
CISPR-18	Radio Interference Characteristics of Power Lines and High Voltage Equipment
ISO 9001	Quality system-Model for Quality Assurance in Design /development
Cigre Publication 202	Guidelines for conducting design reviews for transformers 100 MVA and 123 kV and above. August 2002-Cigre Working Group 12.22
WG 12-15	Guide for Customers Specifications for Transformers 100 MVA and 123 kV and above
WG 12 19	Short Circuit Performance of Transformers.

BS-4360	Specification for weldable structural steel
BS-5135	Specification for arc welding of carbon and carbon manganese steels
BS-5500	Specification for unfired fusion welded pressure vessels
IS-3618	Specification for phosphate treatment of iron & steel for protection against corrosion
IS-6005	Code of practice for phosphating of Iron and Steel
ISO-8501	Preparation of steel surface before application of Paints and related product
IEC-60599	Mineral oil impregnated electrical equipment in service – guide to the interpretation of dissolved and free gases analysis
IS-10593	Method of evaluating the analysis of gases in oil filled electrical equipment in service
IS-2099	Bushings for alternating voltages above 1000 volts
IS-3347 Part I to 8	Dimension for porcelain transformer bushing
DIN-42530	Bushing up to 1000kV from 250A-5000A for liquid filled Transformer
IS-2026 Part 1 to 5	Power transformer
IS-4691	Degrees of protection provided by enclosure for rotating electrical machinery
IEC-60034-5	Degrees of protection provided by integral design of rotating electrical machines (IP Code) classification
IS:325 / IEC -60034	Performance of cooling fan / oil pump motor
IS-13947 part 1 to 5	Specification for low voltage switchgear and control gear
IS:3400	Methods of test for vulcanised rubber
IS:7016 part 1 to 14	Methods of test for coated and treated fabrics
IS:803	Code of practice for design, fabrication and erection of vertical mild steel cylindrical welded oil storage tanks.
IS:3637	Gas operated Relays
IS:335	New Insulating oils – Specification
IEC-62271-203	Gas insulated metal enclosed switchgear for rated voltage above 52kV
IEC-61639	Direct connection between power transformers and gasinsulated metal enclosed switchgear for rated voltages of 52.5 kV and above.
IS:3400 / BS 903 / IS:7016	Air cell (Flexible Air Separator)
IEC 60529 / IP: 55	Degree of protection for cooler control cabinet, MOLG, Cooling fan , oil pump, Buchholz Relay
IEC 60529 / IP : 56	Degree of protection for Pressure Relief Device

IEC 60529 / IP: 43	Degree of protection for Remote tap Changer cubicle (RTCC)
CIRCUIT BREAKERS	
IEC-62271-100	High-voltage switchgear and control gear - Part 100: Alternating current circuit-breakers
IEC-62271-101	High-voltage switchgear and control gear - Part 101: Synthetic testing
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1000 V
IEC-62271-110	High-voltage switchgear and control gear - Part 110: Inductive load switching
IEC-62271-109	High-voltage switchgear and control gear - Part 110: Inductive load switching
CURRENT TRANSFORMI VOLTAGE TRANSFORMI	ERS, VOLTAGE TRANSFORMERS AND COUPLING CAPACITOR ERS
IS-2705- (P1 to P4)	Current Transformers
IS:3156- (P1 to P4)	Voltage Transformers
IS-4379	Identification of the Contents of Industrial Gas Cylinders
IEC-61869 (Part-1)	Instrument transformers - Part 1: General requirements
IEC-61869 (Part-2)	Instrument transformers - Part 2: Additional requirements for current transformers
IEC-61869 (Part-3)	Instrument transformers - Part 3: Additional requirements for inductive voltage transformers
IEC-61869 (Part-4)	Instrument transformers - Part 4: Additional requirements for combined transformers
IEC-61869 (Part-5)	Instrument transformers - Part 5: Additional requirements for capacitor voltage transformers
IEC-61869 (Part-6)	Instrument transformers - Part 6: Additional general requirements for low-power instrument transformers
IEC-61869 (Part-9)	Instrument transformers - Part 9: Digital interface for instrument transformers
IEC-61869 (Part-102)	Instrument transformers - Part 102: Ferroresonance oscillations in substations with inductive voltage transformers
IEC-61869 (Part-103)	Instrument transformers - The use of instrument transformers for power quality measurement
BUSHING	
IS-2099	Bushings for Alternating Voltages above 1000V
IEC-60137	Insulated Bushings for Alternating Voltages above 1000V

SURGE ARRESTERS	
IS-3070 (PART2)	Lightning arresters for alternating current systems: Metal oxide lightning arrestors without gaps
IEC-60099-4	Metal oxide surge arrestors without gaps
IEC-60099-5	Selection and application recommendation
ANSI-C62.1	IEE Standards for S A for AC Power Circuits
NEMA-LA 1	Surge Arresters
CUBICLES AND PANELS &	OTHER RELATED EQUIPMENTS
IS-722, IS-1248	Electrical relays for power system
IS-3231, 3231 (P-3)	Protection
IS:5039	Distributed pillars for Voltages not Exceeding 1000 Volts
IEC-60068.2.2	Basic environmental testing procedures Part 2: Test B: Dry heat
IEC-60529	Degree of Protection provided by enclosures
IEC-60947-4-1	Low voltage switchgear and control gear
IEC-61095	Electromechanical Contactors for household and similar purposes
IEC-60439 (P1 & 2)	Low Voltage Switchgear and control gear assemblies
ANSI-C37.20	Switchgear Assemblies, including metal enclosed bus
ANSI-C37.50	Test Procedures for Low Voltage Alternating Current Power Circuit Breakers
ANSI-C39	Electric Measuring instrument
ANSI-C83	Components for Electric Equipment
IS: 8623: (Part I to 3)	Specification for Switchgear & Control Assemblies
NEMA-AB	Moulded Case Circuit and Systems
NEMA-CS	Industrial Controls and Systems
NEMA-PB-1	Panel Boards
NEMA-SG-5	Low voltage Power Circuit breakers
NEMA-SG-3	Power Switchgear Assemblies
NEMA-SG-6	Power switching Equipment
NEMA-5E-3	Motor Control Centers
1248 (P1 to P9)	Direct acting indicating analogue electrical measuring instruments & their accessories
Disconnecting switches	
IEC-62271-102	High-voltage switchgear and control gear - Part 102: Alternating current disconnectors and earthing switches
IEC-60265 (Part 1 & 2)	High Voltage switches

ANSI-C37.32	Schedule of preferred Ratings, Manufacturing Specifications and Application Guide for high voltage Air Switches, Bus supports and switch accessories
ANSI-C37.34	Test Code for high voltage air switches
NEMA-SG6	Power switching equipment
PLCC and line traps	
IS-8792	Line traps for AC power system
IS-8793	Methods of tests for line traps
IS-8997	Coupling devices for PLC systems
IS-8998	Methods of test for coupling devices for PLC systems
IEC-60353	Line traps for A.C. power systems
IEC-60481	Coupling Devices for power line carrier systems
IEC-60495	Single sideboard power line carrier terminals
IEC-60683	Planning of (single Side-Band) power line carrier systems
CIGRE	Teleprotection report by Committee 34 & 35
CIGRE	Guide on power line carrier 1979
CCIR	International Radio Consultative Committee
CCITT	International Telegraph & Telephone Consultative Committee
EIA	Electric Industries Association
Protection and control ed	quipment
IEC-60051: (P1 to P9)	Recommendations for Direct Acting indicating analogue electrical measuring instruments and their accessories
IEC-60255 (Part 1 to 23)	Electrical relays
IEC-60297 (P1 to P4)	Dimensions of mechanical structures of the 482.6mm (19 inches) series
IEC-60359	Expression of the performance of electrical & electronic measuring equipment
IEC-60387	Symbols for Alternating-Current Electricity meters
IEC-60447	Man machine interface (MMI) - Actuating principles
IEC-60521	Class 0.5, 1 and 2 alternating current watt hour metres
IEC-60547	Modular plug-in Unit and standard 19-inch rack mounting unit based on NIM Standard (for electronic nuclear instruments)
ANSI-81	Screw threads
ANSI-B18	Bolts and Nuts
ANSI-C37.1	Relays, Station Controls etc
ANSI-C37.2	Manual and automatic station control, supervisory and associated telemetering equipment
ANSI-C37.2	Relays and relay systems associated with electric power apparatus

ANSI-C39.1	Requirements for electrical analog indicating instruments
MOTORS	
IS-325	Three phase induction motors
IS-4691	Degree of protection provided by enclosure for rotating electrical machinery
IEC-60034 (P1 to P19:)	Rotating electrical machines
IEC-Document 2	Three phase induction motors
(Central Office) NEMA-MGI	Motors and Generators
Electronic equipment an	nd components
MIL-21B, MIL-833 & MIL-2750	Environmental testing
EC-60068 (P1 to P5)	Printed boards
IEC-60326 (P1 to P2)	Material and workmanship standards
IS-1363 (P1 to P3)	Hexagon head bolts, screws and nuts of product grade C
IS-1364 (P1 to P5)	Hexagon head bolts, screws and nuts of products grades A and B
IS-3138	Hexagonal Bolts and Nuts (M42 to M150)
ISO-898	Fasteners: Bolts, screws and studs
ASTM	Specification and tests for materials
Clamps & connectors	
IS-5561	Electric power connectors
NEMA-CC1	Electric Power connectors for sub station
NEMA-CC 3	Connectors for Use between aluminium or aluminum-Copper Overhead Conductors
Bus hardware and insula	ators
IS: 2121	Fittings for Aluminum and steel cored Al conductors for overhead power lines
IS-731	Porcelain insulators for overhead power lines with a nominal voltage greater than 1000 V
IS-2486 (P1 to P4)	Insulator fittings for overhead power lines with a nominal voltage greater than 1000 V
IEC-60120	Dimensions of Ball and Socket Couplings of string insulator units
IEC-60137	Insulated bushings for alternating voltages above 1000 V
IEC-60168	Tests on indoor and outdoor post insulators of ceramic material or glass for Systems with Nominal Voltages Greater than 1000 V
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1 000 V

IEC-60273	Characteristics of indoor and outdoor post insulators for systems with nominal voltages greater than 1000V
IEC-61462	Pressurized and un-pressurized insulator for use in electrical equipment with rated voltage greater than 1000V – Definitions, Test methods, acceptance criteria and design recommendations
IEC-60305	Insulators for overhead lines with nominal voltage above 1000V ceramic or glass insulator units for ac systems Characteristics of String Insulator Units of the cap and pin type
IEC-60372 (1984)	Locking devices for ball and socket couplings of string insulator units: dimensions and tests
IEC-60383 (P1 and P2)	Insulators for overhead lines with a nominal voltage above 1000 V
IEC-60433	Characteristics of string insulator units of the long rod type
IEC-60471	Dimensions of Clevis and tongue couplings of string insulator units
ANSI-C29	Wet process porcelain insulators
ANSI-C29.1	Test methods for electrical power insulators
ANSI-C92.2	For insulators, wet-process porcelain and toughened glass suspension type
ANSI-C29.8	For wet-process porcelain insulators apparatus, post-type
ANSI-G.8	Iron and steel hardware
CISPR-7B	Recommendations of the CISPR, tolerances of form and of Position, Part 1
ASTM A-153	Zinc Coating (Hot-Dip) on iron and steel hardware
Strain and rigid bus-con	ductor
IS-2678	Dimensions & tolerances for Wrought Aluminum and Aluminum Alloys drawn round tube
IS-5082	Wrought Aluminum and Aluminum Alloy Bars. Rods, Tubes and Sections for Electrical purposes
ASTM-B 230-82	Aluminum 1350 H19 Wire for electrical purposes
ASTM-B 231-81	Concentric - lay - stranded, aluminum 1350 conductors
ASTM-B 221	Aluminum - Alloy extruded bar, road, wire, shape
ASTM-B 236-83	Aluminum bars for electrical purpose (Bus-bars)
ASTM-B 317-83	Aluminum-Alloy extruded bar, rod, pipe and structural shapes for electrical purposes (Bus Conductors)

Batteries	
IS:1651	Stationary Cells and Batteries, Lead-Acid Type (with Tubular Positive Plates)
IS:1652	Stationary Cells and Batteries, Lead-Acid Type (with Plante Positive Plates)
IS:1146	Rubber and Plastic Containers for Lead-Acid Storage Batteries
IS:6071	Synthetic Separators for Lead-Acid Batteries
IS:266	Specification for Sulphuric Acid
IS:1069	Specification for Water for Storage Batteries
IS:3116	Specification for Sealing Compound for Lead-Acid Batteries
IS:1248	Indicating Instruments
IS:10918	Vented type nickel Cadmium Batteries
IEC:60896-21&22	Lead Acid Batteries Valve Regulated types – Methods of Tests & Requirements
IEC: 60623	Vented type nickel Cadmium Batteries
IEC:60622	Secondary Cells & Batteries – Sealed Ni-Cd rechargeable single cell
IEC:60623	Secondary Cells & Batteries – Vented Ni-Cd rechargeable single cell
IEC:60896-11	Stationary Lead Acid Batteries – Vented Type – General requirements & method of tests
IEEE-485	Recommended practices for sizing of Lead Acid Batteries
IEEE-1115	Sizing of Ni-Cd Batteries
IEEE-1187	Recommended practices for design & installation of VRLA Batteries
IEEE-1188	Recommended practices for design & installation of VRLA Batteries
IEEE-1189	Guide for selection of VRLA Batteries
Battery Charger	
IS:3895	Mono-crystalline Semiconductor Rectifier Cells and Stacks
IS:4540	Mono-crystalline Semiconductor Rectifier Assemblies and Equipment
IS:6619	Safety Code for Semiconductor Rectifier Equipment
IS:2026	Power Transformers
IS:2959	AC Contactors for Voltages not Exceeding 1000 Volts
IS:1248	Indicating Instruments
IS:2208	HRC Fuses
IS:13947 (Part-3)	Air break switches, air break disconnectors & fuse combination units for voltage not exceeding 1000V AC or 1200V DC

IS:2147	Degree of protection provided by enclosures for low voltage switchgear and control gear
IS:6005	Code of practice for phosphating of Iron and Steel
IS:3231	Electrical relays for power system protection
IS:3842	Electrical relay for AC Systems
IS:5	Colours for ready mix paint
IEEE-484	Recommended Design for installation design and installation of large lead storage batteries for generating stations and substations
IEEE-485	Sizing large lead storage batteries for generating stations and substations
Wires and cables	
ASTMD-2863	Measuring the minimum oxygen concentration to support candle like combustion of plastics (oxygen index)
IS-694	PVC insulated cables for working voltages upto and including 1100 Volts
IS-1255	Code of practice for installation and maintenance of power cables, upto and including 33 kV rating
IS-1554 (P1 and P2)	PVC insulated (heavy duty) electric cables (part 1) for working voltage upto and including 1100 V
	Part (2) for working voltage from 3.3 kV upto and including 11kV
IS:1753	Aluminium conductor for insulated cables
IS:2982	Copper Conductor in insulated cables
IS-3961 (P1 to P5)	Recommended current ratings for cables
IS-3975	Mild steel wires, formed wires and tapes for armouring of cables
IS-5831	PVC insulating and sheath of electric cables
IS-6380	Elastometric insulating and sheath of electric cables
IS-7098	Cross linked polyethylene insulated PVC sheathed cables for working voltage upto and including 1100 volts
IS-7098	Cross-linked polyethyle insulated PVC sheathed cables for working voltage from 3.3kV upto and including 33 kV
IS-8130	Conductors for insulated electrical cables and flexible cords
IS-1753	Aluminum Conductors for insulated cables
IS-10418	Specification for drums for electric cables
IEC-60096 (part 0 to p4)	Radio Frequency cables
IEC-60183	Guide to the Selection of High Voltage Cables
IEC-60189 (P1 to P7)	Low frequency cables and wires with PVC insulation and PVC sheath
IEC-60227 (P1 to P7)	Polyvinyl Chloride insulated cables of rated voltages up to and including 450/750V
IEC-60228	Conductors of insulated cables

IEC-60230	Impulse tests on cables and their accessories
IEC-60287 (P1 to P3)	Calculation of the continuous current rating of cables (100% load factor)
IEC-60304	Standard colours for insulation for low-frequency cables and wires
IEC-60331	Fire resisting characteristics of Electric cables
IEC-60332 (P1 to P3)	Tests on electric cables under fire conditions
IEC-60502	Extruded solid dielectric insulated power cables for rated voltages from 1 kV upto to 30 kV
IEC-754 (P1 and P2)	Tests on gases evolved during combustion of electric cables
AIR conditioning and v	entilation
IS-659	Safety code for air conditioning
IS-660	Safety code for Mechanical Refrigeration
ARI:520	Standard for Positive Displacement Refrigeration Compressor and Condensing Units
IS:4503	Shell and tube type heat exchanger
ASHRAE-24	Method of testing for rating of liquid coolers
ANSI-B-31.5	Refrigeration Piping
IS:2062	Steel for general structural purposes
IS:655	Specification for Metal Air Dust
IS:277	Specification for Galvanised Steel Sheets
IS-737	Specification for Wrought Aluminium and Aluminium Sheet & Strip
IS-1079	Hot rolled cast steel sheet & strip
IS-3588	Specification for Electrical Axial Flow Fans
IS-2312	Propeller Type AC Ventilation Fans
BS-848	Methods of Performance Test for Fans
BS-6540 Part-I	Air Filters used in Air Conditioning and General Ventilation
BS-3928	Sodium Flame Test for Air Filters (Other than for Air Supply to I.C. Engines and Compressors)
US-PED-2098	Method of cold DOP & hot DOP test
MIL-STD-282	DOP smoke penetration method
ASHRAE-52	Air cleaning device used in general ventilation for removing particle matter
IS:3069	Glossary of Terms, Symbols and Units Relating to Thermal Insulation Materials
IS:4671	Expanded Polystyrene for Thermal Insulation Purposes
IS:8183	Bonded Mineral Wool

IS:3346	Evaluation of Thermal Conductivity properties by means of guarded hot plate method
ASTM-C-591-69	Standard specification for rigid preformed cellular urethane thermal insulation
IS:4894	Centrifugal Fans
BS:848	Method of Performance Test for Centrifugal Fans
IS:325	Induction motors, three-phase
IS:4722	Rotating electrical machines
IS:1231	Three phase foot mounted Induction motors, dimensions of
IS:2233	Designations of types of construction and mounting arrangements of rotating electrical machines
IS:2254	Vertical shaft motors for pumps, dimensions of
IS:7816	Guide for testing insulation resistance of rotating machines
IS:4029	Guide for testing three phase induction motors
IS: 4729	Rotating electrical machines, vibration of, Measurement and evaluation of
IS:4691	Degree of protection provided by enclosures for rotating electrical machinery
IS:7572	Guide for testing single-phase ac motors
IS:2148	Flame proof enclosure for electrical apparatus
BS:4999(Part-51)	Noise levels
Galvanizing	
IS-209	Zinc Ingot
IS-2629	Recommended Practice for Hot-Dip galvanizing on iron and steel
IS-2633	Methods for testing uniformity of coating of zinc coated articles
ASTM-A-123	Specification for zinc (Hot Galavanizing) Coatings, on products Fabricated from rolled, pressed and forged steel shapes, plates, bars and strips
ASTM-A-121-77	Zinc-coated (Galvanized) steel barbed wire
Painting	
IS-6005	Code of practice for phosphating of iron and steel
ANSI-Z551	Gray finishes for industrial apparatus and equipment
SSPEC	Steel structure painting council
Fire protection system	m
	Fire protection manual issued by tariff advisory committee (TAC) of India
HORIZONTAL CENTR	IFUGAL PUMPS
IS:1520	Horizontal centrifugal pumps for clear, cold and fresh water
IS:9137	Code for acceptance test for centrifugal & axial pumps

IS:5120	Technical requirement – Rotodynamic special purpose pumps
API-610	Centrifugal pumps for general services
	Hydraulic Institutes Standards
BS:599	Methods of testing pumps
PTC-8.2	Power Test Codes - Centrifugal pumps
DIESEL ENGINES	
IS:10000	Methods of tests for internal combustion engines
IS:10002	Specification for performance requirements for constant speed compression ignition engines for general purposes (above 20 kW)
BS:5514	The performance of reciprocating compression ignition (Diesel) engines, utilizing liquid fuel only, for general purposes
ISO:3046	Reciprocating internal combustion engines performance
IS:554	Dimensions for pipe threads where pressure tight joints are required on threads
ASME Power Test Code	Internal combustion engine PTC-17
	Codes of Diesel Engine Manufacturer's Association, USA
PIPING VALVES & SPECI	ALITIES
IS:636	Non-percolating flexible fire-fighting delivery hose
IS:638	Sheet rubber jointing and rubber inserting jointing
IS:778	Gun metal gate, globe and check valves for general purpose
IS:780	Sluice valves for water works purposes (50 to 300 mm)
IS:901	Couplings, double male and double female instantaneous pattern for fire fighting
IS:902	Suction hose couplings for fire-fighting purposes
IS:903	Fire hose delivery couplings branch pipe nozzles and nozzle spanner
IS:1538	Cast iron fittings for pressure pipes for water, gas and sewage
IS:1903	Ball valve (horizontal plunger type) including floats for water supply purposes
IS:2062	SP for weldable structural steel
IS:2379	Colour Code for the identification of pipelines
IS:2643	Dimensions of pipe threads for fastening purposes
IS:2685	Code of Practice for selection, installation and maintenance of sluice valves
IS:2906	Sluice valves for water-works purposes (350 to 1200 mm size)
IS:3582	Basket strainers for fire-fighting purposes (cylindrical type)
IS:3589	Electrically welded steel pipes for water, gas and sewage (150 to 2000 mm nominal diameter)

IS:4038	Foot valves for water works purposes
IS:4927	Unlined flax canvas hose for fire fighting
IS:5290	Landing valves (internal hydrant)
IS:5312 (Part-I)	Swing check type reflex (non-return) valves
IS:5306	Code of practice for fire extinguishing installations and equipment on premises
Part-I	Hydrant systems, hose reels and foam inlets
Part-II	Sprinkler systems
BS:5150	Specification for cast iron gate valves
MOTORS & ANNUNCI	ATION PANELS
IS:325	Three phase induction motors
IS:900	Code of practice for installation and maintenance of induction motors
IS:996	Single phase small AC and universal electric motors
IS:1231	Dimensions of three phase foot mounted induction motors
IS:2148	Flame proof enclosure of electrical apparatus
IS:2223	Dimensions of flange mounted AC induction motors
IS:2253	Designations for types of construction and mounting arrangements of rotating electrical machines
IS:2254	Dimensions of vertical shaft motors for pumps
IS:3202	Code of practice for climate proofing of electrical equipment
IS:4029	Guide for testing three phase induction motors
IS:4691	Degree of protection provided by enclosure for rotating electrical machinery
IS:4722	Rotating electrical machines
IS:4729	Measurement and evaluation of vibration of rotating electrical machines
IS:5572	Classification of hazardous areas for electrical (Part-I) installations (Areas having gases and vapours)
IS:6362	Designation of methods of cooling for rotating electrical machines
IS:6381	Construction and testing of electrical apparatus with type of protection 'e'
IS:7816	Guide for testing insulation for rotating machine
IS:4064	Air break switches
IEC DOCUMENT 2 (Control Office) 432	Three Phase Induction Motor
VDE 0530 Part I/66	Three Phase Induction Motor
IS:9224 (Part-II)	HRC Fuses

IS:6875	Push Button and Control Switches
IS:694	PVC Insulated cables
IS:1248	Indicating instruments
IS:375	Auxiliary wiring & busbar markings
IS:2147	Degree of protection
IS:5	Colour Relay and timers
IS:2959	Contactors
PG Test Procedures	·
NFPA-13	Standard for the installation of sprinkler system
NFPA-15	Standard for water spray fixed system for the fire protection
NFPA-12A	Standard for Halong 1301 Fire Extinguishing System
NFPA-72E	Standard on Automatic Fire Detectors
	Fire Protection Manual by TAC (Latest Edition)
NFPA-12	Standard on Carbon dioxide extinguisher systems
IS:3034	Fire of industrial building
	Electrical generating and distributing stations code of practice
IS:2878	CO2 (Carbon dioxide) Type Extinguisher
IS:2171	DC (Dry Chemical Powder) type
IS:940	Pressurised Water Type
D.G. SET	
IS:10002	Specification for performance requirements for constant speed compression ignition (diesel engine) for general purposes
IS:10000	Method of tests for internal combustion engines
IS:4722	Rotating electrical machines-specification
IS:12063	Degree of protection provided by enclosures
IS:12065	Permissible limit of noise levels for rotating electrical machines
	Indian Explosive Act 1932
Steel structures	·
IS-228 (1992)	Method of Chemical Analysis of pig iron, cast iron and plain carbon and low alloy steels.
IS-802 (P1 to 3)	Code of practice for use of structural steel in overhead transmission line towers
IS-806	Code of practice for use of steel tubes in general building construction
IS-808	Dimensions for hot rolled steel beam, column channel and angle sections
IS-814	Covered electrodes for manual arc welding of carbon of carbon manganese steel

IS-816	Code of Practice for use of metal arc welding for general construction in Mild steel
IS-817	Code of practice for training and testing of metal arc welders. Part 1 : Manual Metal arc welding
IS-875 (P1 to P4)	Code of practice for design loads (other than earthquake) for buildings and structures
IS-1161	Steel tubes for structural purposes
IS-1182	Recommended practice for radiographic examination of fusion welded butt joints in steel plates
IS-1363 (P1 to P3)	Hexagonal head bolts, screws & nuts of products grade C
IS-1364	Hexagon head bolts, screws and nuts of product grades A and B
IS-1367 (P1 to P18)	Technical supply condition for threaded steel fasteners
IS-1599	Methods for bend test
IS-1608	Method for tensile testing of steel products
IS-1893	Criteria for earthquake resistant design of structures
IS-1978	Line Pipe
IS-2062	Steel for general structural purposes
IS-2595	Code of practice for Radiographic testing
IS-3063	Single coil rectangular section spring washers for bolts, nuts and screws
IS-3664	Code of practice for ultrasonic pulse echo testing by contact and immersion methods
IS-7205	Safety code for erection of structural steel work
IS-9595	Recommendations for metal arc welding of carbon and carbon manganese steels
ANSI-B18.2.1	Inch series square and Hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
ANSI-G8.14	Round head bolts
ASTM-A6	Specification for General Requirements for rolled steel plates, shapes, sheet piling and bars of structural use
ASTM-A36	Specifications of structural steel
ASTM-A47	Specification for malleable iron castings
ASTM-A143	Practice for safeguarding against embilement of Hot Galvanized structural steel products and procedure for detaching embrilement
ASTM-A242	Specification for high strength low alloy structural steel
ASTM-A283	Specification for low and intermediate tensile strength carbon steel plates of structural quality
ASTM-A394	Specification for Galvanized steel transmission tower bolts and nuts

ASTM-441	Specification for High strength low alloy structural manganese vanadium steel		
ASTM-A572	Specification for High strength low alloy colombium-Vanadium steel of structural quality		
AWS D1-0	Code for welding in building construction welding inspection		
AWS D1-1	Structural welding code		
AISC	American institute of steel construction		
NEMA-CG1	Manufactured graphite electrodes		
Piping and pressure ve	ssels		
IS-1239 (Part 1 and 2)	Mild steel tubes, tubulars and other wrought steel fittings		
IS -3589	Seamless Electrically welded steel pipes for water, gas and sewage		
IS-6392	Steel pipe flanges		
ASME	Boiler and pressure vessel code		
ASTM-A120	Specification for pipe steel, black and hot dipped, zinc-coated (Galvanized) welded and seamless steel pipe for ordinary use		
ASTM-A53	Specification for pipe, steel, black, and hot-dipped, zinc coated welded and seamless		
ASTM-A106	Seamless carbon steel pipe for high temperature service		
ASTM-A284	Low and intermediate tensile strength carbon-silicon steel plates for machine parts and general construction		
ASTM-A234	Pipe fittings of wrought carbon steel and alloy steel for moderate and elevated temperatures		
ASTM-S181	Specification for forgings, carbon steel for general purpose piping		
ASTM-A105	Forgings, carbon steel for piping components		
ASTM-A307	Carbon steel externally threated standard fasteners		
ASTM-A193	Alloy steel and stainless-steel bolting materials for high temperature service		
ASTM-A345	Flat rolled electrical steel for magnetic applications		
ASTM-A197	Cupola malleable iron		
ANSI-B2.1	Pipe threads (Except dry seal)		
ANSI-B16.1	Cast iron pipe flangesand glanged fitting. Class 25, 125, 250 and 800		
ANSI-B16.1	Malleable iron threaded fittings, class 150 and 300		
ANSI-B16.5	Pipe flanges and flanged fittings, steel nickel alloy and other special alloys		
ANSI-B16.9	Factory-made wrought steel butt welding fittings		
ANSI-B16.11	Forged steel fittings, socket-welding and threaded		
ANSI-B16.14	Ferrous pipe plug, bushings and locknuts with piple threads		
ANSI-B16.25	Butt welding ends		

ANSI-B18.1.1	Fire hose couplings screw thread
ANSI-B18.2.1	Inch series square and hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
NSI-B18.21.1	Lock washers
ANSI-B18.21.2	Plain washers
ANSI-B31.1	Power piping
ANSI-B36.10	Welded and seamless wrought steel pipe
ANSI-B36.9	Stainless steel pipe
Other civil works standar	rds
IS-269	33 grade ordinary portland cement
IS2721	Galvanized steel chain link fence fabric
IS-278	Galvanized steel barbed wire for fencing
IS-383	Coarse and fine aggregates from natural sources for concrete
IS-432 (P1 and P2)	Mild steel and medium tensile steel bars and hard-dawn steel wire for concrete reinforcement
IS-456	Code of practice for plain and reinforced concrete
IS-516	Method of test for strength of concrete
IS-800	Code of practice for general construction in steel
IS-806	Steel tubes for structural purposes
IS-1172	Basic requirements for water supply, drainage and sanitation
IS-1199	Methods of sampling and analysis of concrete
IS-1566	Hard-dawn steel wire fabric for concrete reinforcement
IS-1742	Code of Practice for Building drainage
IS-1785	Plain hard-drawn steel wire for pre-stressed concrete
IS-1786	High strength deformed Steel Bars and wires for concrete reinforcement
IS-1811	Methods of sampling Foundry sands
IS-1893	Criteria for earthquake resistant design of structures
IS-2062	Steel for general structural purposes
IS-2064	Selection, installation and maintenance of sanitary appliances code of practices
IS-2065	Code of practice for water supply in buildings
IS-2090	High tension steel bars used in pre-stressed concrete
IS-2140	Standard Galvanized steel wire for fencing
IS-2470 (P1 & P2)	Code of practice for installation of septic tanks
IS-2514	Concrete vibrating tables
IS-2645	Integral cement waterproofing compounds

IS-3025 (Part 1 to Part 48)	Methods of sampling and test (Physical and chemical) for water and waste water
IS-4091	Code of practice for design and construction of foundations for transmission line towers and poles
IS-4111 (Part 1 to P5)	Code of practice for ancillary structures in sewerage system
IS-4990	Plywood for concrete shuttering work
IS-5600	Sewage and drainage pumps
National building code of	f India 1970
USBR E12	Earth Manual by United States Department of the interior Bureau of Reclamation
ASTM-A392-81	Zinc/Coated steel chain link fence fabric
ASTM-D1557-80	test for moisture-density relation of soils using 10-lb (4.5 kg) rame land 18-in. (457 mm) Drop
ASTM-D1586(1967)	Penetration Test and Split-Barrel Sampling of Soils
ASTM-D2049-69	Test Method for Relative Density of Cohesionless Soils
ASTM-D2435	Test method for Unconsolidated, (1982)
	Undrained Strengths of Cohesive Soils in Triaxial Compression
BS-5075	Specification for accelerating Part I Admixtures, Retarding Admixtures and Water Reducing Admixtures
CPWD	Latest CPWD specifications
ACSR MOOSE CONDUCTO	R
IS:6745 BS:443-1969	Methods for Determination of mass of zinc coating on zinc coated Iron and Steel Articles
IS:8263	Methods for Radio Interference
IEC:437-1973 NEMA:107-1964 CISPR	Test on High Voltage Insulators
IS:209, BS:3436-1961	Zinc Ingot
IS:398 Part - V IEC:209-1966	Aluminum Conductors for Overhead Transmission Purposes
BS:215(Part-II), IEC:209-1966	Aluminium Conductors galvanized steel reinforced extra high voltage (400 kV and above)
IS:1778, BS:1559-1949	Reels and Drums for Bare Conductors
IS:1521, ISO/R89-1959	Method for Tensile Testing of steel wire
IS:2629	Recommended practice for Hot dip Galvanising on Iron and Steel
IS:2633	Method for Testing Uniformity of coating of zinc Coated Articles
IS:4826/ ASTMA-472-729	Hot dip galvanised coatings on round steel wires

GALVANISED STEEL EART	1 11 VV 11\L	
IS:1521, ISO/R:89-1959	Method for Tensile Testing of Steel Wire	
IS:1778	Reels and Drums for Bare Conductors	
IS:2629	Recommended practice for Hot Dip Galvanising on Iron and Steel	
IS:2633	Methods for testing Uniformity of Coating of Zinc Coated Articles	
IS:4826/ ASTM: A 475- 72a BS:443-1969	Hot dip Galvanised Coatings on Round Steel Wires	
IS:6745/ BS:443-1969	Method for Determination of mass of Zinc Coating on Zinc coated Iron and Steel Articles.	
IS:209/ BS:3463-1961	Zinc ingot	
IS:398 (Pt. I to P5:1992)/ BS:215 (Part-II	Aluminum Conductors for overhead transmission purposes	
Lighting Fixtures and Acc	eessories	
IS:1913	General and safety requirements for electric lighting fittings	
IS:3528	Water proof electric lighting fittings	
IS:4012	Dust proof electric lighting fittings	
IS:4013	Dust tight proof electric lighting fittings	
IS:10322	Industrial lighting fittings with metal reflectors	
IS:10322	Industrial lighting fittings with plastic reflectors	
IS:2206	Well glass lighting fittings for use under ground in mines (non-flameproof type)	
IS:10322	Specification for flood light	
IS:10322	Specification for decorative lighting outfits	
IS:10322	Luminaries for street lighting	
IS:2418	Tubular fluorescent lamps	
IS:9900	High pressure mercury vapour lamps	
IS:1258	Specification for Bayonet lamp fluorescent lamp	
IS:3323	Bi-pin lamp holder tubular fluorescent lamps	
IS:1534	Ballasts for use in fluorescent lighting fittings. (Part-I)	
IS:1569	Capacitors for use in fluorescent lighting fittings	
IS:2215	Starters for fluorescent lamps	
IS:3324	Holders for starters for tubular fluorescent lamps	
IS:418	GLS lamps	
IS:3553	Water tight electric fittings	
IS:2713	Tubular steel poles	
IS:280	MS wire for general engg. Purposes	

Conduits, Accessor	ies and Junction Boxes
IS:9537	Rigid steel conduits for electrical wiring
IS:3480	Flexible steel conduits for electrical wiring
IS:2667	Fittings for rigid steel conduits for electrical wiring
IS:3837	Accessories for rigid steel conduits for electrical wiring
IS:4649	Adaptors for flexible steel conduits
IS:5133	Steel and Cast Iron Boxes
IS:2629	Hot dip galvanising of Iron & Steel
Lighting Panels	<u>'</u>
IS:13947	LV Switchgear and Control gear (Part 1 to 5)
IS:8828	Circuit breakers for over current protection for house hold and similar installations
IS:5	Ready mix paints
IS:2551	Danger notice plates
IS:2705	Current transformers
IS:9224	HRC Cartridge fuse links for voltage above 650V(Part-2)
IS:5082	Wrought aluminium and Al. alloys, bars, rods, tubes and sections for electrical purposes
IS:8623	Factory built Assemblies of Switchgear and Control Gear for voltages upto and including 1000V AC and 1200V DC
IS:1248	Direct Acting electrical indicating instruments
Electrical Installati	ion
IS:1293	3 pin plug
IS:371	Two to three ceiling roses
IS:3854	Switches for domestic and similar purposes
IS:5216	Guide for safety procedures and practices in electrical work
IS:732	Code of practice for electrical wiring installation (system voltage not exceeding 650 Volts.)
IS:3043	Code of practice for earthing
IS:3646	Code of practice of interior illumination part II & III
IS:1944	Code of practice for lighting of public through fares
IS:5571	Guide for selection of electrical equipment for hazardous areas
IS:800	Code of practice for use of structural steel in general building construction
IS:2633	Methods of Testing uniformity of coating on zinc coated articles
IS:6005	Code of practice for phosphating iron and steel
	INDIAN ELECTRICITY ACT
	INDIAN ELECTRICITY RULES

LT SWITCHGEAR	
IS:8623 (Part-I)	Specification for low voltage switchgear and control gear assemblies
IS:13947 (Part-I)	Specification for low voltage switchgear and control gear, Part 1 General Rules
IS:13947 (part-2)	Specification for low voltage switchgear and control gear, Part 2 circuit breakers
IS:13947 (part-3)	Specification for low voltage switchgear and control gear. Part 3 Switches, Disconnectors, Switch-disconnectors and fuse combination units
IS:13947 (part-4)	Specification for low voltage switchgear and control gear. Part 4 Contactors and motors starters
IS:13947 (part-5)	Specification for low voltage switchgear and control gear. Part 5 Control-circuit devices and switching elements
IS:13947 (part-6)	Specification for low voltage switchgear and control gear. Part 6 Multiple function switching devices
IS:13947 (part-7)	Specification for low voltage switchgear and control gear. Part 7 Ancillary equipments
IS:12063	Degree of protection provided by enclosures
IS:2705	Current Transformers
IS:3156	Voltage Transformers
IS:3231	Electrical relays for power system protection
IS:1248	Electrical indicating instruments
IS:722	AC Electricity meters
IS:5578	Guide for Marking of insulated conductors of apparatus terminals
IS:13703 (part 1)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 1 General Requirements
IS:13703 (part 2)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 2 Fuses for use of authorized persons
IS:6005	Code of practice of phosphating iron and steel
IS:5082	Wrought Aluminum and Aluminum alloys for electrical purposes
IS:2633	Hot dip galvanising

Note: If any standard is expired or does not exist anymore than other standard which has substituted it, shall be applicable.

Annexure- F

Assessment report from Bidder for proposed sub-vendor along with following enclosures (to the extent available):

- 1. Registration / License of the works
- 2. Organization chart with name and qualification of key persons
- 3. List of Plant and Machinery.
- 4. List of testing equipment with their calibration status.
- 5. List of Raw material, bought out items with sourcing details
- 6. List of out-sourced services with sourcing details.
- 7. List of supply in last three years.
- 8. Third party approval, if any (viz. ISO, BIS),
- 9. Pollution clearance wherever applicable
- Energy Conservation & Efficiency report(Applicable to industries having contract load more than 100 KVA)
- 11. Formats for RM, in process and acceptance testing
- 12. Type test approvals conducted in last 5 years, if applicable
- 13. Performance Certificates from customers
- 14. Photographs of factory, plant and machinery & testing facilities

MQP & INSPECTION LEVEL REQUIREMENT

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
A.01	LT Transformer /Power Transformer/ Reactor/ Converter Transformer/ Filter Reactor	MQP/ITP	IV
A.02	Bushing	MQP	IV
A.03	Insulating Oil	POWERGRID TS	III
A.04	Oil storage tank for transformers	MQP	III
A.05	Nitrogen injection based explosion prevention system	FAT/ITP	III
A.06	On Line oil drying system for transformers	POWERGRID TS	п**
A.07	On Line DGA and moisture monitoring system	POWERGRID TS	п**
A.08	Flow sensitive conservator isolation valve	POWERGRID TS	П**
A.09	Oil Filtration Machine	MQP	III
B.01	Circuit Breakers	MQP	IV
B.02	Current Transformers	MQP/ITP	IV
B.03	CVT/PT/IVT	MQP	IV
B.04	Isolators	MQP/ITP	IV
B.05	Surge Arrestors	MQP/ITP	III
B.06	Line Trap & Air Core Reactor	MQP/ITP	III
B.07	Point On switching device (CSD) for Circuit Breaker (wherever required)	FAT/ITP	IV
C.01	STATCOM including Valve, valve base electronics, DC capacitor, series reactor and all accessories	ITP	IV
C.02	Mechanically switched Reactor bank (3-ph) including all accessories (MSR Branches)	ITP	IV
C.03	Mechanically switched Capacitor bank (3-ph) including all accessories (MSC Branches)	ITP	IV
C.04	Harmonic Pass filters	ITP	IV
C.05	HT Capacitor	MQP	IV
D.01	Thyristor Valve	FAT/ITP	III
D.02	PLC Capacitors for HVDC	FAT/ITP	III
D.03	Valve Cooling system for	FAT/ITP	III

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
	HVDC		
D.04	AC/DC Filter Resistors	ITP	III
D.05	DC Current and Voltage measuring device for HVDC	FAT/ITP	III
D.06	Maintenance platform for valve hall	POWERGRID TS	П
D.07	Optical signal column for FSC	FAT/ITP	II
E.01	GIS including spares	MQP/ITP	IV
E.02	Dew Point Meter for GIS	POWERGRID TS	I*
E.03	Portable Partial Discharge monitoring system for GIS	POWERGRID TS	I*
E.04	Partial Discharge Monitoring System (Online) for GIS	ITP	III
E.05	PEB Structure and Puf Panels	MQP	III
F.01	Substation Automation system	FAT/MQP	III
F.02	Event Logger	POWERGRID TS	III
F.03	PLCC equipment Viz PLCC Terminal, Carrier equipment, Protection Coupler, Coupling Device but excluding EPAX / HF Cable	MQP	III
F.04	Control & Relay Panels	MQP	III
G.01	EHV Cables	MQP/ITP	III
G.02	Power Cables & Control Cables	MQP	III
G.03	Cable Joints (11 kV and above)	POWERGRID TS	II
G.04	Cable Lugs & Glands / Clamps/Terminations	POWERGRID TS	I
H.01	LT Switchgear & ACDB/DCDB/MLDB/ELDB	MQP	III
H.02	Battery	POWERGRID TS	II
H.03	Battery Charger	MQP	III
H.04	UPS & Voltage Stablizer	MQP/FAT	III
H.05	D. G. Set	FAT/ITP	III
H.06	Lighting Panel	POWERGRID TS	II
H.07	Lighting Poles	POWERGRID TS	II
H.08.1	Lighting Fixtures, Lighting Earthwire, Switches / sockets, Conduits, Lamps & fans including exhaust fans	POWERGRID TS	I
H.8.2	Solar based LEDs System including street light/pole solar panel, Inverter controller/LED fixture	FAT	III
H.09	MS/GI /PVC Pipes for cable	POWERGRID TS	I

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
	trenches and lighting		
H.10	Outdoor Receptacle	POWERGRID TS	I
H.11	Split A.C/window A.C./ precision AC/ Kiosk AC/ Cascade AC/ Tower AC	POWERGRID TS	I
H.12	Occupancy sensors for control of lighting	POWERGRID TS	I
H.13	Solar based street lighting pole including Solar Panel, Inverter, Controller, etc.	POWERGRID TS	III
H.14	Junction Box / Lighting Switch Boards / Bay MB / Portable Flood Light Panel	POWERGRID TS	П
H.15	Lighting transformer	POWERGRID TS	II
I.01	SF6 gas processing unit, SF6 gas Leakage detector, SF6 gas Analyzer	POWERGRID TS	I*
I.02	SF6 Gas	POWERGRID TS	I
I.03	Spark Gap	FAT/ITP	III
I.04	Time synchronizing Equipment (GPS Clock)	POWERGRID TS	I
I.05	Galvanized Cable trays	POWERGRID TS	II
I.06	Video Monitoring System	FAT/ITP	I
I.07	Public Address System (All Components)	POWERGRID TS	I
I.08	Building Management System (All components)	POWERGRID TS	I
I.09	Access Control System (All Components)	POWERGRID TS	I
I.10	Video Display system/ Video Projection system	POWERGRID TS	I
I.11	VESDA (smoke detector)	POWERGRID TS	I
I.12	High Mast Pole	MQP	III
J.01	Aluminium ladder	POWERGRID TS	I
J.02	Hume Pipes	POWERGRID TS	I
J.03	Castle Key	POWERGRID TS	I
J.04	Water Treatment plant (All components).	POWERGRID TS	I
J.05	Furniture	POWERGRID TS	I
J.06	DOL Starter	POWERGRID TS	I
J.07	Oil Sample Bottles and Syringe	POWERGRID TS	I
J.08	Test & Measuring Equipment, T&P	POWERGRID TS	I*
K.01	EOT Crane	POWERGRID TS	II
K.02	Boom Crane/Golf Cart/Platform Truck/Man Lift/ Fork Lift/ Lifts	POWERGRID TS	П

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
L.00	Fire Protection System		
L.001	Panels, Hydro pneumatic tank for fire protection system.	POWERGRID TS	III
L.002	Deluge valve, Strainers, MS/GI pipes, Pumps, motors, air compressor, and other valves, Diesel Engines	POWERGRID TS	II
L.003	Others	POWERGRID TS	I
M.00	HVAC SYSTEM		
M.001	Air Cooled Chiller	POWERGRID TS	III
M.002	Pump	POWERGRID TS	II
M.003	Air Handling Unit	POWERGRID TS	II
M.004	Fan Filter Unit With Centrifugal Blower	POWERGRID TS	II
M.005	Axial Flow Fan	POWERGRID TS	II
M.006	Main Climate Control Unit (Dehumidifier)	POWERGRID TS	I
M.007	Dampers	POWERGRID TS	II
M.008	Fire Dampers	POWERGRID TS	II
M.009	Pressure Gauge, Thermometers, Other Instruments / Sensors	POWERGRID TS	I
M.010	Grill, Diffuser, Jet Nozzle, Louvers etc	POWERGRID TS	I
M.011	Ducting	POWERGRID TS	III
M.012	M S Pipe	POWERGRID TS	II
M.013	Pipe Insulation Material	POWERGRID TS	I
M.014	Duct Insulation Material	POWERGRID TS	I
M.015	Underdeck Insulation Material	POWERGRID TS	I
M.016	Gate Valve & Non Return valve	POWERGRID TS	I
M.017	Y Strainer	POWERGRID TS	II
M.018	Ball Valve/ Motorised Butterfly Valve/ Balancing Valve	POWERGRID TS	I
M.019	Closed Expansion Tank	POWERGRID TS	II
M.020	Air Separator	POWERGRID TS	I
M.021	MCC /PLC /Electrical Panels	POWERGRID TS	III
M.022	Propeller Fan/ Conduit	POWERGRID TS	II
M.023	Air Filter/ Mixing Valve with Thermostat	POWERGRID TS	I
N.01	SDH Equipment	FAT/ITP	IV
N.02	Termination Equipment Primary/ DI Multiplexer	FAT/ITP	IV

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
N.03	DACS	FAT/ITP	IV
N.04	Optical Amplifier	FAT/ITP	IV
N.05	FODP including pigtail, Joint Box, FDMS	FAT/ITP	П
N.06	IMPS	FAT/ITP	IV
N.07	Optical bypass switch	FAT/ITP	IV
N.08	Air Purifier	FAT/ITP	I
N.09	Patch cord & connector	FAT/ITP	I
N.10	NMS	FAT/ITP	IV
N.11	OPGW Cable	MQP/ITP/FAT	III
N.12	Hardware Fittings for OPGW cable	MQP/ITP	III
N.13	DCPS	FAT/ITP	III
N.14	Radio Links	FAT/ITP	III
N.15	SMPS based DC Power Supply (DCPS) system	FAT/ITP	III
N.16	WAMS (PMU & Accessories)	FAT/ITP	III
N.17	PUF Shelter	FAT/ITP	III
N.18	Aerial OFC/UGOFC/ADSS/FO Cable	FAT/ITP	III
N.19	DWDM	FAT/ITP	III
N.20	OTN	FAT/ITP	III
N.21	MPLS-TP Equipment	FAT/ITP	III
N.22	L2 Switch	FAT/ITP	III
N.23	IP-MPLS Router	FAT/ITP	III
N.24	HDPE Pipes	POWERGRID TS	II
N.25	Equipment Cabinets	POWERGRID TS	II
N.26	Main Distribution Frame	POWERGRID TS	I
N.27	Telephone system, EPAX, Telephone wires, Telephone sockets	POWERGRID TS	I
N.28	Fibre Optic Cable	MQP	III
N.29	Hardware Fittings for Fibre Optic cable	MQP	III
O.01	Re-rollers of MS/HT Angle Section and galvanized tower parts.	MQP	IV
O.02	Conductor	MQP	IV
O.03	Hardware fittings and Conductor & Earthwire Accessories	MQP	IV
O.04	Earth wire	MQP	IV
O.05	Insulator	MQP	IV
O.06	Bolts & Nuts of Gr 8.8 / 8	MQP	IV
O.07	Mono Pole	MQP	IV

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
O.08	Foundation Bolts & Anchor Bolts	POWERGRID TS	Ш
O.09	D-shackle/ Hanger / Links and associated Special bolt/nuts	MQP	Ш
O.10	Span Marker, Obstruction lights and Wind Measuring Equipment	POWERGRID TS	III
O.11	MS ROD rolled by Approved Re-roller of POWERGRID	MQP	Ш
O.12	MS ROD rolled by Approved steel producers of POWERGRID	POWERGRID TS	I
O.13	Spring Washers & Pack washers	POWERGRID TS	II
O.14	Bolts & Nuts Gr up to 5.6/5	POWERGRID TS	II
O.15	ACD & Barbed wire for ACD/Bird guard	POWERGRID TS	II
O.16	Danger Plate / Phase Plate / Number Plate / Circuit plate	POWERGRID TS	I
O.17	Sub Station Structure (lattice/pipe type)	MQP	III
O.18	Clamps & Connecters (including equipment connectors)	MQP	Ш
O.19	MS/ GI Flat, rod type, pipe type and other earthing material.	POWERGRID TS	П
O.20	Aluminium Tube & Busbar materials	POWERGRID TS	II
O.21	Pipe Type & Counter Poise Earthing	POWERGRID TS	П
O.22	DTS System	POWERGRID TS	II

For Equipment where requirement of MQP is envisaged, ITP/FAT will be followed If sourced from off shore. For items required in S/S or T/L or TELECOM/LD&C, same inspection level as specified shall be followed for all the cases.

^{*}MICC for test and measuring equipment (inspection level I or II) shall be issued only after actual verification/ demonstration of satisfactory performance at site.

^{**} Though level-2 items, CIP/MICC can be issued also on review of TCs and visual inspection of these item.

S1. No.	ITEM DESCRIPTION	MAKE			
<i>A</i> .	Substation Accessories [Type Testing	ig is not envisaged]			
1.	Outdoor receptacles	CGL/B&C/BCH/Sakti, Chennai/Indo Asian/AVAIDS			
2.	Trefoil clamp	Moulded Fibre Glass Products, Calcutta			
3.	Diesel Engine	Cummins/Ruston & Hornsby/Greaves Cotton/Kirloskar/Mahindra/Ashok Leyland			
4.	Alternator	AVK/KIRLOSKAR/STAMFORD/ Leroy Somer			
5.	Motors	KEC/Siemens/NGEF/Crompton/ABB			
6.	Cable Glands	Sunil & Co./Arup/ Comet/QPIE			
7.	Junction Box	Sarvana/ECS/C&S/Vikas/Maktel/Unilac/Jasper/ Amara raja/AVAIDS			
8.	EPAX	MATRIX, BPL			
9.	ACSR Conductor (Bersimis/Moose/Zebra)	Sterlite/Apar/HVPL/Sharavathy/Hiren Aluminium Ltd./Smita/Deepak Cables/Polycab wires/Cabcon/JSK			
10.	AAC Conductor (BULL)	Sterlite/Cabcon / JSK			
11.	G.S. Earthwire	Sharavathy/Bharat Wire Ropes/Ramswarup			
12.	Lighting Fixtures	Phillips/CGL/Bajaj / Havels			
13.	Lighting Transformer	Gujarat-Plug-In			
14.	Lighting Panels	Vikas/Makel/Nitya/AVAIDS			
15.	MCCB/ACB/Protective relays of LT Switchgear Boards	All approved makes as per Compendium of Vendors			
16.	EOT Crane	Reva			
В.	ACCESSORIES FOR TRANSFORMER applicable and not required to be subm	R & REACTOR [Earlier approved type test reports is nitted]			
17.	BUCHHOLZ RELAY [Upto 765kV Transformer & Reactor]	 (i) M/S CEDESPE, ITLAY [Model Type-EE 3 (Plug & Socket type)]/ (ii) M/s VIAT INSTRUMENTS PVT. LTD.KOLKATA [Model type-GOR-3M (Plug & Socket type)] 			
18.	PRESSURE RELIEF DEVICE [Upto 765kV Transformer & Reactor]	(i) M/S SUKRUT UDYOG, Pune [Model type-T-6- MS15-SHB-PS (Plug & Socket type)] /			
19.	MAGNETIC OIL LEVEL GAUGE [Upto 765kV Transformer & Reactor]	(i) M/S SUKRUT UDYOG PUNE [Model type-SO-HE-10-M-ATMS-PS (Plug & Socket type)], [Model Type:-SO-6-M-P-PS (Plug & Socket type)]/			

2	.0.	AIR CELL (FLEXIBLE AIR	Type test of following makes are not to be submitted	
		SEPARATOR)	(i) M/S PRONAL FRANCE /	
		[Upto 765kV Transformer & Reactor]	(ii) FUJIKURA, JAPAN /	
			(iii)	PRONAL ASIA, MALAYSIYA /
			(vi)	SHENYANG HONGDA GENERAL RUBBER

S1. No.	ITEM DESCRIPTION	MAKE	
		(v)	FACTORY / BAODING XINKE RUBBER PRODUCT
		(V)	INSTITUTE, CHINA /
		(vi)	M/S ZENITH INDUSTRIAL RUBBER PRODUCTS PVT. LTD. THANE/
		(vii)	M/S UNIRUB TECHNO PUNE
21.	OTI & WTI	(i)	M/S PRESIMEASURE BANGALORE [Model type-
	[Upto 765kV Transformer & Reactor]		1005A
22.	OIL PUMP	(i)	FLOWWELL PUMPS & METERS, BANGALORE
	[Upto 765kV Transformer & Reactor]		[Model type-1220D, 1250D
23.	COOLING FAN AND MOTOR	(i)	M/S MARATHON LTD KOLKATA [Model Type:-
	ASSEMBLY [Upto 765kV		36M/K75-P8, 0.7kW, 725RPM, 22J/K37-P6,
2.4	Transformer & Reactor]	(*)	0.25kW, 940RPM, AFF 915103, 0.625kW, 550RPM]
24.	Sudden Pressure Relay	(i)	Qualitrol [Model/Drawing No.900-003-02 CS46518,
	[Upto 765kV Transformer & Reactor]	(::)	900-003-32 CS-46369] /
		(ii)	Shenyang KEQI Electrical Equipment Co. Ltd.
25.	BUCHHOLZ RELAY	(;)	[Model/Drawing No. SYJ9-50-25 TH]
23.	[Upto 400kV Transformer & Reactor]	(i)	M/S CEDASPE, ITALY [Model type-EE3 (Plug & Socket type)]/
		(ii)	VIAT INSTRUMENTS [Model type-GOR-3M (Plug
		(11)	& Socket type)]
26.	PRESSURE RELIEF DEVICE	(i)	M/S SKURUT UDYOG, PUNE [Model type-T-6-
	[Upto 400kV Transformer & Reactor]	()	MS-15-SHB-PS (Plug & Socket type)]
27.	MAGNETIC OIL LEVEL GAUGE	(i)	M/S SUKRUT UDYOG PUNE [Model type-SOHE-
	[Upto 400kV Transformer & Reactor]	()	10-M-ATMS-PS (Plug & Socket type)], [Model
			Type: SO-6-M-P-PS (Plug & Socket type)]/
		(ii)	M/S YOGYA ENTERPRISES, JHANSI [Model type-
20	AID CELL (ELEVIDLE AID	TF.	SO-10 (Plug & Socket type)]
28.	AIR CELL (FLEXIBLE AIR	7 1	e test of following makes are not to be submitted
	SEPARATOR) [Upto 400kV Transformer & Reactor]	(i)	M/S THE RUBBER PRODUCTS MUMBAI / M/S UNIRUB TECHNO PUNE /
		(ii)	
		(iii)	M/S PRONAL FRANCE/
		(iv)	M/S ZENITH INDUSTRIAL RUBBER PRODUCTS
			PVT. LTD. THANE /
		(v)	SHENYANG HONGDA GENERAL RUBBER
			FACTORY, CHINA

29.	Sudden Pressure Relay [Upto 400kV Transformer & Reactor]	(i) Qualitrol [Model/Drawing No.900-003-02 CS46518, 900-003-32 CS-46369] /	
		(ii) VIAT INSTRUMENTS [Model/Drawing No.950 /	
		(iii) Shenyang KEQI Electrical Equipment Co. Ltd. [Model/Drawing No.SYJ9-50-25 TH]	
30.	RIP Bushing (52kV, 3150A)	ABB Micafil, Switzerland [Model/Drawing No. 1ZCD073617 (Rev F)]	
31.	RIP Bushing (420kV, 1250A)	ABB, SWEDEN [Model/Drawing No.1ZSC005378A0001 REV. K]	
32.	RIP Bushing (245kV, 1250A)	ABB, SWEDEN [Model/Drawing No.1ZSC005416A0001 (Rev. D)]	
S1. No.	ITEM DESCRIPTION	MAKE	
33.	RIP Bushing (245kV, 2000A)	ABB, SWEDEN [Model/Drawing No.1ZSC005373A0001 (Rev. C)]	
34.	RIP Bushing (420kV, 1250A)	HSP Germany [Model/Drawing No.327470]	
35.	RIP Bushing (245kV, 2000A)	HSP Germany [Model/Drawing No.329260]	
36.	RIP Bushing (52kV, 3150A)	HSP Germany [Model/Drawing No.329280]	
37.	RIP Bushing (420kV, 1250A)	Izolyator, Russia [Model/Drawing No.686354.603]	
38.	RIP Bushing (245kV, 2000A)	Izolyator, Russia [Model/Drawing No.686353.602]	
39.	RIP Bushing (52kV, 3150A)	Izolyator, Russia [Model/Drawing No.686351.601]	
40.	RIP Bushing (145kV, 1250A)	Izolyator, Russia [Model/Drawing No.686352.604]	
41.	RIP Bushing (420kV, 1250A)	TRENCH, CHINA [Model/Drawing No. ECT 707 (C2)]	
42.	RIP Bushing (245kV, 2000A)	TRENCH, CHINA [Model/Drawing No. ECT 617 (C3)]	
43.	RIP Bushing (245kV, 1250A)	TRENCH, CHINA [Model/Drawing No. ECT 616 (C3)]	
44.	RIP Bushing (145kV, 1250A)	TRENCH, CHINA [Model/Drawing No. ECT 516 (C3)]	
45.	RIP Bushing (52kV, 1250A)	TRENCH, CHINA [Model/Drawing No. ECT 415 (C3)]	
46.	RIP Bushing (52kV, 3150A)	TRENCH, CHINA [Model/Drawing No. ECT 419 (C3)]	
47.	RIP Bushing (420kV, 1250A)	Xian China [Model/Drawing No. 75706 (Rev 09)]	
48.	RIP Bushing (245kV,2000A)	Xian China [Model/Drawing No. 75618 (Rev 09)]	
49.	RIP Bushing (52kV, 3150A)	Xian China [Model/Drawing No. 75366 (Rev 03)]	
50.	RIP Bushing (52kV, 3150A)	Xian China [Model/Drawing No. 75332 (Rev 08)]	
51.	OIP Bushing (800kV, 2500A)	ABB, SWEDEN [Model / Drawing No. GOE-2550-16002500-0.6-B, 1ZSC026186-AAM REV. H]	
52.	OIP Bushing (420kV, 2500A)	ABB, SWEDEN [Model / Drawing No.GOE-1425- 11502500-0.6, 1ZSC026186-AAL REV. F]	

53.	OIP Bushing (800kV, 2500A)	TBEA, CHINA [Model / Drawing No. TBEA-500-765TA0035-01, REV. 02]
54.	OIP Bushing (420kV, 2500A)	TBEA, CHINA [Model / Drawing No. TBEA-500-765TA0035-02, REV. 02]
55.	OIP Bushing (420kV, 2500A)	TRENCH, CHINA [Model / Drawing No. OT-738-1 (C 5)]
56.	OLTC (500MVA, 765kV ICT)	MR Germany [Model/Drawing No. MI 1503 72.5/RC- 12231WR]
57.	OLTC (500MVA, 400kV ICT)	Easun MR, Chennai [Model/Drawing No. 3 x MI 1200 300/D 10.19.3W]
58.	OLTC (220kV & below rating transformer)	BHEL, Bhopal [Model/Drawing No. MIII 600 110/C 10.19.3W]
C.	TESTING EQUIPMENT FOR TRANSF	ORMER & REACTOR
59.	Oil BDV Test Kit	Baur [Model/Drawing No. DTA 100C]
S1. No.	ITEM DESCRIPTION	MAKE
60.	Oil BDV Test Kit	Megger [Model/Drawing No. OTS 100AF]
61.	Online Dissolved Gas (Multi-gas) and Moisture Analyser	A Eberle GmbH & Co. KG [Model/Drawing No. HYDROCAL 1008]
62.	Online Dissolved Gas (Multi-gas) and Moisture Analyser	Ningbo Ligong Online Monitoring Technology Co. LTD [Model/Drawing No. MGA2000]
63.	Online Dissolved Gas (Multi-gas) and Moisture Analyser	GE Energy [Model/Drawing No. KELMAN TRANSFIX]
64.	Online Dissolved Gas (Multi-gas) and Moisture Analyser	Qualitrol Company LLC [Model/Drawing No. SERVERON TM 8]
65.	On line Insulating Oil Drying System	CEE DEE Vacuum Equipment Pvt. Ltd. [Model/Drawing
		No. TRANSDRY CD-002]
66.	On line Insulating Oil Drying System	No. TRANSDRY CD-002] PTSS [Model/Drawing No. PTSS-TDS1GA6XS]

NOTES:-

- **1.** For sub-station accessories mentioned at Sr. No. A above, model specific separate approval of type test report is not required.
- **2.** For Transformer/Reactor accessories & testing equipment mentioned at Sr. No. B & C above, wherever, model/drawing no. is specified separate approval of type test report and drawing/documents is not required, thus requirement of type test report validity of 10 years is not applicable.

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

SECTION-4

ANNEXURE-A: Compliance Certificate of Technical Specification

The bidder shall confirm compliance to the following by signing and stamping this compliance certificate and furnishing same with the offer.

- 1. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same.
- 2. There are no deviation(s) with respect to specification other than those furnished in the schedule of deviations.
- 3. Only those technical submittals which are specifically asked for in Notice Inviting Tender (NIT) to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of technical offer.
- 4. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
- 5. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in 'BOQ' of the specification shall not be considered (i.e., technical description & quantities as per the specification shall prevail).

Date:	Bidder's Stamp & Signature

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

SECTION-4

ANNEXURE-B: Deviation(s) of Technical Specification

Bidder shall list out all technical potential deviation/ change request (s) along with clause with respect to technical specifications.

Sl. No.	Page No.	Clause No.	Deviation	Reason	/ Justification(s	5)
---------	----------	------------	-----------	--------	-------------------	----

Any deviation not specifically brought out in this section shall not be admissible for any commercial implication at later stage. Except to the technical deviations listed in this schedule, bidder's offer shall be considered in full compliance to the tender specifications irrespective of any such deviation indicated / taken elsewhere in the submitted offer.

Date: Bidder's Stamp & Signature

Section 4: Annexures 98 Page 2 of 2

Project: Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur

(HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

SECTION - V

CHECK LIST FOR 765kV CURRENT TRANSFORMER

Put a tick mark ($\sqrt{}$) on 'YES' if the specified requirement is met, or put a tick mark on 'NO', if the specified requirement is not met and give comments in the "Remarks" column.

Sl. No.	<u>Parameters</u>	<u>Data</u>	YES/NO	<u>Remarks</u>
1	Manufacturer's type designation	Bidder to furnish in Remarks Col.		
2	Type of CT			
	a) Insulation (As per clause 2.3 of section-II)	i. SF6	YES/NO	
		ii. Oil	YES/NO	
	b) Installation	Outdoor	YES/NO	
	c) Mounting	Upright	YES/NO	
	d) Tank design	i. Live tank	YES/NO	
		ii. Dead tank	YES/NO	
3	Standards Applicable	IEC: 61869-1 & 61869-2 or IS: 2705 Part-1 to 4, ANSI-C5713	YES/NO	
4	Rated Voltage (kV rms)	765KV	YES/NO	
5	Rated Primary Current	3000A	Yes/No	
6	Rated short time thermal current	As per Clause 3.0 of Section-I	YES/NO	
7	Rated dynamic current	As per section –II	YES/NO	
8	Max. Temperature rise over design ambient temperature	As per IEC	YES/NO	
9	One minute power frequency withstand voltage - Secondary Terminal and Earth	5KV	YES/NO	
10	Cantilever Strength	Not less than 500Kg	YES/NO	
11	Class of Insulation	A	YES/NO	
12	Core parameters	As per clause 3.0 b of Section –I.	YES/NO	

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

13	External Surface		
	Steel	i) Hot dip galvanized As per Section III	YES/NO
		ii)Painted As per Section III	YES/NO
14	Insulator /Bushing		
	a. Material		
	i. Shedded Polymer insulator		YES/NO
	ii. Shedded Porcelain insulator	CT conforms to the internal arc fault test (internal fault protection class-2), as a special test as per IEC- 61869, with at least 40 kA internal arc fault current."	YES/NO
	b. One-piece construction without any metallic flange joint		YES/NO
15	Specific requirements for Oil/SF6 CT's		
	a. Oil filled CT's:		
	i. Grade of oil	EHV grade	YES/NO
	ii. Standard to which oil conforms	IS-335 / IEC-60296	YES/NO
	iii. Oil filling and drain plug provided.		YES/NO
	iv. Oil sight glass provided		YES/NO
	b. <u>SF6 filled CT's:</u>		
	i. Standard to which gas conforms	IEC-60376,60376A, 60376B	YES/NO
	ii. Suitable SF6 gas density monitoring device		YES/NO

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

	iii. NO/NC contacts available in		
	SF6 gas density monitoring device for remote annunciation and tripping in case of SF6 leakage	YI	ES/NO
	iv. Provision for online gas filling	YI	ES/NO
	v. Suitable rupture disc provided to prevent explosion.	YI	ES/NO
16	Hermetic Sealing		
	a. Hermetically Sealed	YI	ES/NO
	b. Details of arrangement made for Hermetical sealing of the CT's are available and shall be furnished for approval at contract stage.	YI	ES/NO
	c. Details of Site test to check the effectiveness of the hermetic sealing are available and shall be furnished for approval at contract stage.		ES/NO
17	Polarity of CT permanently marked	YI	ES/NO
18	Impregnation details along with Test/Checks: to ensure successful completion of impregnation cycle are available and shall be furnished for approval at contract stage	YI	ES/NO
19	Name Plate		
	As per IEC standards, and shall clearly indicate Year of manufacture, Rated current, Extended current rating & rated thermal current	YI	ES/NO
20	Terminal Box -Ingress Protection	IP 55 YI	ES/NO

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

21	In case of "Bar primary" inverted type CT	The CT conforms to the additional requirements specified under 3.0 a) of Section –II. Clauses .i,ii,iii,iv,v	YES/NO
22	Rated extended current	As per 3.0 g) of Section –II.	YES/NO
23	Packing & Transportation		
	CT suitable for horizontal transportation.		YES/NO
	Details of packing design shall be furnished for review at contract stage.		YES/NO
24	CT suitable for mounting on lattice support structure.		YES/NO
25	CT suitable for High speed autoreclosing.		YES/NO
26	Details of measures taken to achieve minimum risk of explosion of the CT in service is attached along with this offer.		YES/NO
27	The CT manufacturer meets the Qualifying requirements specified in Annexure-TQR of this Technical Specification.		YES/NO
28	Valid Type test reports as per Section-II, 6.0 shall be submitted at contract stage.		YES/NO
29	The list of equipments required for conducting pre commissioning shall be submitted for approval during contract stage		YES/NO

Project: Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBCB) route.

Customer: POWERGRID Corporation of India Ltd (PGCIL)

Document No. TB-437-510-017

Technical Specification: 765kV CURRENT TRANSFORMER

30	Confirmation to clause 8.0 of Section –I pertaining to TYPE TESTING, INSPECTION, TESTING & INSPECTION CERTIFICATE		YES/NO
31	List of Deviations if any, is attached along with offer		YES/NO
32	List of any special tools and tackles as per technical Specification shall be furnished during Contract stage.		YES/NO
33	Following Documents are attached along with the offer:		
	Filled Checklist.		YES/NO
	Documents to support the qualifying requirements of the Equipment manufacturer 'as per clause 4.0 of Section-I' of this Technical Specification.		YES/NO
34	Bidder to confirm if Powergrid standard approved drawings/ Previous Powergrid approval for the offered CTs are available for approval extension.	If Yes, bidder shall submit the powergrid approval letters along with offer .	YES/NO

XXX

Technical Specification: TB-437-510-017
765kVCURRENT TRANSFORMER

SECTION -IV GUARANTEED TECHNICAL PARTICULARS

CURRENT TRANSFORMER

1.		Name and address of manufacturer	1.	
2.		Manufacture's type designation	2.	
3.		Standards applicable	3.	
4.		Rated frequency (HZ)	4.	
5.		Rated voltage Ur (KV)	5.	
6.		Rated current	6.	
	I)	Rated continuous normal current (A)		I)
	ii)	Rated extended primary Current (A)		ii)
7.		Short time thermal current withstand for 1 sec. (KA).	7.	
8.		Dynamic current withstand (KA peak).	8.	
9.		1.2/50 micro second impulse withstand voltage (KV peak)	9.	
10.		250/2500 micro seconds switching surge withstand voltage (KV peak dry and wet)	10.	
11.		One minute dry and wet power frequency withstand voltage (KV rms)	11.	
12.		No. of cores per CT	12.	
13.		Transformation ratio	13.	
14.		No. of secondary turns (Nominal)	14.	
15.		Rated output (VA) at different taps	15.	
16.		Accuracy class	16.	
17.		Knee point voltage (V) at different	17.	

Technical Specification: TB-437-510-017
765kVCURRENT TRANSFORMER

SECTION -IV GUARANTEED TECHNICAL PARTICULARS

18.		Secondary data	18.	
	a)	Secondary resistance at different taps.		a)
	b)	Oversize factor and transient error under CO-t-CO duty condition of fault (100 ms)		b)
19.		Maximum exciting current	19.	
	a)	100% Kpv (mA)		
	b)	25% kpv (mA)		
	c)	20% kpv (mA)		
	d)	10% kpv (mA)		
20.		Instrument security factor at different ratios	20.	
21.		Radio interference voltage at 1.1 Ur/(SQRT 3) at 1.0 MHz (micro volts)	21.	
22.		Whether auxiliary CT/reactors provided for metering winding.	22.	
23.		Conona extinction voltage (KV rms)	23.	
24.		Partial discharge level (pico coulumbs)	24.	
25.		Total creepage distance (mm)	25.	
26.		Primary	26.	
	a)	No. of primary turms		a)
	b)	Material and cross section of primary (cm ²)		b)
	c)	Whther bar type or ring type primary		c)
27.		Whether CT is suitable for transportation horizontally	27.	

Technical Specification: TB-437-510-017
765kVCURRENT TRANSFORMER

SECTION -IV GUARANTEED TECHNICAL PARTICULARS

28.		Composite error at rated burden and at	28.	
	a)	20% rated current		a)
	b)	120% rated current		b)
29.		Composite error at 25% rated burden and at	29.	
	a)	20% rated current		a)
	b)	120% rated current		b)
30.		Quantity of oil per CT (Litres)	30.	
31.		Whether spark gap/surge arrester provided at the primary	31.	
32.		Standard to which oil conforms generally	32.	
33.		Charteristics of oil (prior to filling)	33.	
	a)	Breakdown voltage (KV)		a)
	a) b)	Breakdown voltage (KV) Dielectric dissipation constant at 90° C		a) b)
	ŕ	- ' '		·
	b)	Dielectric dissipation constant at 90° C		b)
	b)	Dielectric dissipation constant at 90° C Water content (ppm)		b)
	b) c) d)	Dielectric dissipation constant at 90° C Water content (ppm) Gas content (ppm)		b) c) d)
	b) c) d) e)	Dielectric dissipation constant at 90° C Water content (ppm) Gas content (ppm) Interfacial tension at 27° C (N/m)		b) c) d) e)
34.	b) c) d) e)	Dielectric dissipation constant at 90° C Water content (ppm) Gas content (ppm) Interfacial tension at 27° C (N/m) Specific resistance I) at 90 ° C (ohm - cm)	34.	b) c) d) e)
34.	b) c) d) e)	Dielectric dissipation constant at 90° C Water content (ppm) Gas content (ppm) Interfacial tension at 27° C (N/m) Specific resistance I) at 90 ° C (ohm - cm) ii) at 27° C (ohm - cm) Whether currnet transformers are	34.	b) c) d) e)

Technical Specification: TB-437-510-017
765kVCURRENT TRANSFORMER

SECTION -IV GUARANTEED TECHNICAL PARTICULARS

37.		Dimensional details	37.	
	I)	Overall height from mounting plane		I)
	ii)	Height up to terminals from mounting plane		ii)
	iii)	Mounting dimensions & diameter of mounting holes		
	iv)	Terminal pad diameter and length		iv)
	v)	Material of terminal pad		v)
	vi)	Diameter of insulator at		vi)
	a)	Top end		a)
	b)	Bottom end		b)
38.		Temperature rise over an ambient temp. of 50° C (°C)	38.	
39.		Transient over voltage withstand for	39.	
	a)	30 seconds (KV peak)		a)
	b)	1 minute (KV peak)		b)
40.		Whether CT chartercteristic curves enclosed		40.
41.		Details of recommended support structure enclosed		41.
42.		Drawing showing clearance from earthed objects enclosed		42.
43.		Type test reports as per IEC enclosed		43.
44.		OGA drawing enclosed		44.
45.		Details of spark gap provided at the primary or secondary enclosed		45.

UNPRICED FORMAT

Tender Inviting Authority: BHEL, TBG Noida

TENDER DESCRIPTION: SUPPLY AND SUPERVISION OF TESTING OF 765KV CURRENT TRANSFORMERS FOR PGCIL HVDC-Nagpur PROJECT.

Enquiry/NIT No:

Name of the Bidder/ Bidding Firm / Company :	

PRICE SCHEDULE (BoQ is applicable only for Indian Bidders)

(This BOQ template must not be modified/replaced by the bidder and the same should be uploaded after filling the relevent columns, else the bidder is liable to be rejected for this tender. Bidders are allowed to enter the Bidder Name and Values only)

NUMBER #	TEXT #	TEXT #	NUMBE R#	TEXT#	TEXT	NUMBER #	NUMBER	NUMBER	NUMBER	NUMBER	NUMBER	NUMBER#	NUMBER#	NUMBER #
SI. No.	Item Description	Item Code / Make	Quantit Y	Units	Material Code	Unit Ex- Works RATE In Figures To be entered by the Bidder in Rs. P	Percentage)	GST Amount (Unit Rate*Qua ntity*GST) Rs. P		GST on F&I (in Percentage)	GST Amount on F&I (Unit Rate*Quantit y*GST) Rs. P	HSN / SAC Code	TOTAL AMOUNT With Taxes	TOTAL Ex- Works + F & I AMOUNT including GST in Rs. P
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
1.01	SUPPLY- CURRENT TRANSFORMER : 765KV, 50KA FOR 1S, 25MM/KV CREEPAGE, 3000A 120% EXTENDED RATING 6 CORE SINGLE PHASE CURRENT TRANSFORMER	HVDC- Nagpur- Supply-1	54	NO	TB9127526483	QUOTED	QUOTED	QUOTED	QUOTED	QUOTED	QUOTED		QUOTED	QUOTED
1.02	SERVICES- CURRENT TRANSFORMER : 765KV, SUPERVISION FOR TESTING (PRE-COMMISSIONING)	HVDC- Nagpur- Service-1	54	NO	TB3127006731	QUOTED	QUOTED	QUOTED	Not Applicable	Not Applicable	Not Applicable		QUOTED	QUOTED
1.03	SPARES- CURRENT TRANSFORMER : 765KV, 50KA FOR 1S, 25MM/KV CREEPAGE, 3000A 120% EXTENDED RATING 6 CORE SINGLE PHASE CURRENT TRANSFORMER	HVDC- Nagpur- Supply-2	3	NO	TB8127526482	QUOTED	QUOTED	QUOTED	QUOTED	QUOTED	QUOTED		QUOTED	QUOTED
	Total												QUOTED	QUOTED

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL HVDC-
	NAGPUR
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-I (A)

TECHNICAL PRE-QUALIFYING CRITERIA FOR 765kV Current Transformers

TECHNICAL PRE QUALIFICATION REQUIREMENT

Name of Project : Package-I for ± 800 kV, 6000MW HVDC terminals at Khavda Pooling Station-2 (KPS2) (HVDC) & Nagpur (HVDC) and interconnection/extension of existing 400kV GIS Substation at KPS2 associated with "Transmission System for Evacuation of power from potential renewable energy zone in Khavda area of Gujarat under Phase-V (8 GW): Part A" through Tariff Based Competitive Bidding (TBC8) route.

Name of Customer : POWERGRID

Name of Consultant : POWERGRID

Name of Item : 765kV CURRENT TRANSFORMER

TECHNICAL PRE-QUALIFICATION REQUIREMENT

Indenter to Tick (√)
Technical PQR is based on

Customer PQR ♥; Customised PQR □;

Standard PQR

- (i) The manufacturer whose 765/400/220/132kV/110kV * Current Transformer are offered, must have manufactured, type tested (as per IS/IEC or equivalent standard) and supplied 715/345/220/132kV* or higher voltage class equipment(s), which are in satisfactory operation# for at least two (2) years as on date of NOA.
- (ii) Alternatively, the manufacturer, who have established manufacturing and testing facilities in India for the offered equipment(s) and not meeting the requirement stipulated in (i) above, can also be considered provided that:
 - a) 715/345/220/132kV/110kV* or higher Voltage class equipment(s) must have been manufactured in the above Indian works & type tested (as per IS/IEC standard) as on date of NOA
 - b) In case manufacturer meets the technical requirement through clause (ii) above, warranty obligations for additional warranty of two(2) years over & above the warranty period as specified in the bidding documents shall be applicable for the entire quantity of the offered equipment to be supplied under the contract.

*: voltage class of respective equipment as applicable.

#: satisfactory operation means certificate issued by the Employer/Utility certifying the operation without any adverse remark.

NOTE: The date of NOA shall be 22 Nov 2024

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL HVDC-
	NAGPUR
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

Indenter to ident	ify and tick (V) type of bidder from the follow	ring
Manufacturer√;	Supplier □;	Authorised agent* of OEM □	System Integrator
(*) Agent/ Supplier av	thorised by OEM J	or sale and after-sales support, Guaran	tee/ Warrantee, as capplicable

SUPPORTING DOCUMENTS TO BE ATTACHED (As applicable as per PQ requirement)				
Sr	Required Criteria	Supporting Documents to be submitted by bidder along with technical bid		
1	Manufacturing	Approved Drawings / GTP / Approved Quality Plan / Factory Inspection Test Report e.t.c		
2	Supply	PO / Dispatch clearance / LR / Material Receipt certificate at site / installation or commissioning certificate e.t.c		
3	Satisfactory operation	Certificate issued by the Employer/Utility certifying the operation without any adverse remark.		

Notes (General points):

- Consideration of offer shall be subject to customer's approval of bidder's, if applicable.
- Bidder to submit all supporting documents in English. If documents submitted by bidder are in language other than English, a self- attested English translated document should also be submitted.
- Notwithstanding anything stated above, BHEL reserves the right to assess the capabilities and capacity of the bidder to perform the contract, should the circumstances warrant such assessment in the overall interest of BHEL.
- After satisfactory fulfilment of all the above criteria / requirement, offer shall be considered for further evaluation as per NIT and all the other terms of the tender.

		Signature of the au	thorized representative of
Place	:	Bidder's Name	:
Date	:	Designation	:
		Company Seal	

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL HVDC-
	NAGPUR
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-I (B)

FINANCIAL PRE-QUALIFYING CRITERIA

- (i) Bidder should have a minimum average audited annual turnover / Sales* Value of **INR 5 Crores** for last three financial years 2021-22, 2022-23, 2023-24 or 2022-23, 2023-24. 2024-25
- (ii) Bidder should have earned profit in at least one year during the last three years for which turnover has been considered.

Note:

* Audited Profit & Loss Account and Balance Sheet of relevant financial years as per PQR must be submitted as proof of Average Annual Turnover/Sales. The Financial statements must be signed by the owner/director and the auditor. Auditors seal, Name, Membership No., Firm Registration No. & firm name (if applicable), UDIN and the capacity in which he is signing (Proprietor/Partner), must be mentioned on the Profit & Loss A/c and Balance Sheet.

BIDDER TO FURNISH DETAILS IN BELOW FORMAT AND SHOULD SUBMIT AUDITED BALANCE SHEET AND PROFIT & LOSS ACCOUNT SHEET OF THESE YEARS.

Turnover deta	ails	
Sl. No.	Financial year	Turnover (in Lakhs)
1	2021-2022 / 2022-2023	
2	2022-2023 / 2023-2024	
3	2023-2024 / 2024-2025	
Avg of S.no.	Average annual Turnover for above financial	
1,2,3	years	
4	Whether bidder has earned profit in at least one year during the last three years for which turnover has been considered.	Yes/ No

		Signature of the	authorized representative of
Place	:	Bidder's Name	:
Date	:	Designation	÷
		Company Seal	•

ANNEXURE-II

Activity Schedule for 765kV Current Transformers [For PGCIL HVDC-Nagpur]

	[For PGCIL HVDC-Nagpur]				
		765kV CT- 20 nos.	765kV CT- 20 nos.	765kV CT- 17 nos.	
A. Supply	Brief Description of work	ACTIVITY TIME IN WEEKS	ACTIVITY TIME IN WEEKS	ACTIVITY TIME IN WEEKS	Responsibility
1	Inputs to vendor from BHEL after issue of PO	1 Week	1 Week	1 Week	BHEL scope.
2	Submission of Documents necessary for getting manufacturing clearance like Drawings, Data sheet, Type test reports, Spare BOQ etc.	2 Weeks	2 Weeks	2 Weeks	Supplier scope.
3	Review and Approval of documents from BHEL/Customer and issue of manufacturing clearance.	2 Weeks	2 Weeks	2 Weeks	BHEL scope.
4	Manufacturing time (after Manufacturing Clearance from BHEL) along with Inspection Call (ie. Time from Manufacturing Clearance date and inspection date mentioned in inspection call)	51 Weeks	57 Weeks	63 Weeks	Supplier scope.
5	BHEL/ customer Inspection & dispatch clearance	2 Weeks	2 Weeks	2 Weeks	BHEL scope
6	Dispatch	2 Weeks	2 Weeks	2 Weeks	Supplier scope
	Total time for supply	60 Weeks	66 Weeks	72 Weeks	
Note:	manufacturing time. 3. Inspection call should be raised Two (02) weeks in advance before inspection date. Inspection call should be given in the prescribed format only (enclosed). Inspection calls not in the prescribed format shall not be entertained. 4. Delay in activity pertaining to BHEL, not attributable to vendor, as listed above shall be added, if required in case of time extension and Delivery date will be re-fixed accordingly based on bi request & delay analysis. 5. Supplier to give monthly plan for delivery of equipment matching the site requirement and manufacturing time as per sl. no. 4 of activity schedule.				late will be re-fixed accordingly based on bidder's
B. Services	Brief Description of work				Responsibility
1	Deputation of service engineer for the supervision of pre- commissioning testing work				Supplier scope
Note:	1.Supplier must ensure the deputation of service engineer	at site within one week from th	e date of confirmation mail fr	om BHEL.	
Place	:		Signature of the authorized	representative of	:

Designation Company Seal

Date

Check List for Supply bills

			Check List for Supply bills				
	Name Of the Project						
	Package Description						
	Invoice No. & Date						
	PO No. & date						
Sr. No	Documents Required	Copies	Check Points	Page no.	Vendor	Verification by	Verification b
01.110	Doddinento required				Remarks	MM	Fin
					(Y/N/NA)	(Y/N/NA)	(Y/N/NA)
			Please ensure GST complaint invoice in original				
			Consignee address : BHEL C/o followed by site address				
			Item description and unit of quantity are matched with PO				
	Original for Buyer Invoice -	1 Original+2	4. Buyer address and GSTN No as required (TBG Noida or Nodal agency)				
1	GST compliant invoice	Сору	5. PO No and date, LR No and date, Vehicle No and Project name are				
	·		Invoiced quantity are not more than th PO quantity and MICC quantity				
			7. Ex works unit rate , Taxes and F&I rates are same as per PO				
			Signed and stamped by vendor				
			Consignee and stamped by Vendor Consignee address : BHEL C/o followed by Site address				
			In case of material purchased from sub vendor , Consignee address				
			Vendor's name C/o BHEL C/o Site address				
	Receipted LR (signed &		Vendor's Invoice no and Vehicle No are mentioned				
	stamped)/ confirmation	1Orignal+2	No of boxes/No of packages are same as per Packing list				
2	from site regarding receipt	Copy	5. In case of and adverse remark on LR (Like shortages/damages/broken				
	0 0 1	Сору	etc) , clarification from site/TBMM/TBCM is nedded				
	of packages/ Boxes					1	
			6. LR is readable	1	 	1	}
			7. In case of photo copy, LR is verified by TBMM		1		
			8. LR date is after the date of MICC/(MDCC if issued) or same date				
						1	
	Packing List - showing		1. PO No and date, LR No and date, Invoice No and date, Site Name and				
	number of packages, and	1Orignal+2	address. Consignor and consignee address are mentior				
3	·	_	Item description and quantity are matched with Invoice and PO				
	gross weight/net Weight (if	Сору	Signed and stamped by vendor				
	applicable)		4. No of packages/ Item descriptions are matched with MRC and LR				
			BHEL MICC has been issued prior to the date of dispatch or on same dat	e			
			2. In case where MICC date is after the date of dispatch then MDCC date is				
			same or prior to the date of dispatch				
		1Original+2Cor	Project Name, PO,Po Date, Vendor's name and address is correct				
4	MICC from BHEL	TOTIGITIAI+2CO					
		У	4. Item description, Quantity and unit of quantity are same as per PO and				
			5. All hold point in MICC, if any, have been resolved before submission of b	ill			
			6. Signed and stamped by BHEL Executive				
			7. MICC and MDCC quantity are not less than Invoice quantity and cover al				
			invoiced items. 1. Project Name, PO No., Invoice No , LR No and date are mentioned .				
5		1 Original+2	11. Floject Name, FO No., invoice No , ER No and date are mentioned .				
	Guarantee Certificate	Сору	Guarantee Certificate is strictly matched with PO T&C				
			Signed and stamped by vendor				
			Signed and stamped by vendor Ensure submission of BG directly from Bank before supply of material so				
6							
			that BG confirmation may be arranged before processing the bill	1	1	+	
			Bill can be processed only after receipt of BG confirmation directly from				
			bank 3. It should be in the name of RHEL. TRG Noids with registered office.			1	
			3. It should be in the name of BHEL , TBG Noida with registered office				
	Bank Guarantee	1 Copy	address Siri Fort. New Dell 4. It should be in prescribed format.				
			it should be in prescribed format. BG value and valdity plus claim period should be minimum as specified in	 		1	
]			
			PO / RC. Please check before supply , If BG extension is required please				
			arrange the same 6. Vendor's name address should be same as per PO	1	1	1	1
	1		7. Po No / RC No and date should be correct	1	1	1	1
			Invoice No and date, Vendor's Name, Place from Consignor to Consignee				
			are mentioned				
			It has not been issued later than the LR date	ĺ	1		
			Insured value is not less than the Invoice value				
7	Inquironno Cartife - 1 -	1 Orignal+2					
7	Insurance Certifcate	Сору	Signed and stamped by Insurance Company				
				<u> </u>	<u> </u>		<u> </u>
			5. In case of Open Insurance Policy, declaration has been submitted to				
			Insurance Company as per declaration clause of Open policy and copy of o	<u></u>	<u> </u>		<u> </u>
					T T		
			6. In case of any discrepancy, consent of TBCM is required for processing				
			In case of any discrepancy , consent of TBCM is required for processing the bill and amount will be deducted for invalid Insurance certific.				
	PVC (If applicable) Invoice		the bill and amount will be deducted for invalid Insurance certific				

Check List for Supply bills

	Name Of the Project						
	Package Description						
	Invoice No. & Date						
	PO No. & date						
Sr. No	Documents Required	Copies	Check Points	Page no.	Vendor	,	Verification by
-					Remarks (Y/N/NA)	MM (Y/N/NA)	Fin (Y/N/NA)
8	is submitted along with the Despatch Invoice	тонушатьо у	Calculation sheet and applicable PVC indices are also enclosed		(Y/N/NA)	(Y/N/NA)	(T/IN/INA)
			3. If delay in delivery, then PVC indicies are as per PO conditions.				
9			LR No and date, Invoice No and date, Vehicle No and date , Site Name a address are mentione	ו			
			2. Date of receipt of material				
	Material receipt Certificate		3. Item description and quantity are same as per Invoice / Packing List				
			4. It is signed and stamped by Site executive				
			5. In case of any shortages / damages / adverse remark , clarification is				
			needed				
10	Other Documents		To be seen as per specific requirement of PO.				

Check List for Supply bills

			·				
	Name Of the Project						
	Package Description						
	Invoice No. & Date						
	PO No. & date						
Sr. No	Documents Required	Copies	Check Points	Page no.	Vendor Remarks	Verification by MM	Verification by
					(Y/N/NA)	(Y/N/NA)	(Y/N/NA)
			To be filled by BHEL (MM) only				
10	Date Of Submission of Last Billing Document		Date to be mentioned				
11	LD Calculation, if applicable as per PO.		Calculation Sheet of LD due to delay in delivery is attached				
12	Receipted LR (signed & stamped)/ confirmation from site regarding receipt of packages/ Boxes	1 Copy	Damages if any mentioned in the Receipted LR have been accounted for. Withhel amount if any		Not to be filled by vendor		
13	Packing List - showing number of packages and gross weight & net Weight (If applicable	1 Original	If Packing list does not match with Purchase order (with ref to sl 4 above), Engg/MM acceptance as to the completeness is enclosed.				
14	РО сору	1 Copy	PO copy with original seal and signature is attached along with amendment any	if			
15	Dan	1 copy	Relevant DANs are attached duly signed by TBMM representative.				
Note*	Every Field to be ticked. If strom the bottom Page	some document	t is not applicable, same should be mentioned, All Pages to be numbered upv	N			
	Invoice control No				Vendor Signature	MM Signature	Finance Signature
					Date:	Date:	Date:

DELETED

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR
	PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-V

Item/ Package Name	SUPPLY AND SUPERVISION OF TESTING OF 765kV CURRENT TRANSFORMERS
Enquiry No.	THAT STATE OF THE
Project	PGCIL HVDC NAGPUR PROJECT
Percentage of Local Content	%

Format of Self-certification regarding Local Content in line with PPP-MII order, 2017 and its revision Dtd. 04.06.2020 and any subsequent modifications/ amendments, if any.

Date	:			
I		 . S/o, D/o, W/o,	 	Resident of
decla	are as under:			

That I will agree to abide by the terms and conditions of the Public Procurement (Preference to Make in India) Order, 2017 (hereinafter PPP-MII order) of Government of India issued vide Notification No. P-45021/2/2017-BE-II Dtd. 15.06.2017, its revision Dtd. 04.06.2020 and any subsequent modifications/amendments, if any.

That the information furnished hereinafter is correct to the best of my knowledge and belief and I undertake to produce relevant records before the procuring entity/ BHEL or any other Government authority for the purpose of assessing the local content of goods/ services/ works supplied by me for "Supply and supervision of ETC of Circuit Breakers (Package-I/ Package-II) for various Powergrid projects".

That the local content for all inputs which constitute the said goods/ services/ works has been verified by me and I am responsible for the correctness of the claims made therein.

That the value addition for the purpose of meeting the 'Minimum Local Content 'has been made by me at _______ (Enter the details of the location(s) at which value addition is made).

That in the event of the local content of the goods/ services/ works mentioned herein is found to be incorrect and not meeting the prescribed supplier class categorization criteria as per said order, based on the assessment of procuring agency(s)/ BHEL/ Government Authorities for the purpose of assessing the

PROJECT:	SUPPLY AND SUPERVISION OF ETC OF CIRCUIT BREAKERS FOR VARIOUS
	POWERGRID PROJECTS.
ITEM:	CIRCUIT BREAKERS
ENQUIRY No.	

local content, action shall be taken against me in line with the PPP-MII order and provisions of the Integrity pact/ Bidding Documents.

I agree to maintain the following information in the Company's record for a period of 8 years and shall make this available for verification to any statutory authority:

- i. Name and details of the Local Supplier (Registered Office, Manufacturing unit location, nature of legal entity)
- ii. Date on which this certificate is issued
- iii. Goods/ services/ works for which the certificate is produced
- iv. Procuring entity to whom the certificate is furnished
- v. Percentage of local content claimed and whether it meets the Minimum Local Content prescribed
- vi. Name and contact details of the unit of the Local Supplier(s)
- vii. Sale Price of the product
- viii. Ex-Factory Price of the product
- ix. Freight, insurance and handling
- x. Total Bill of Material
- xi. List and total cost value of input used to manufacture the Goods/ to provide services/ in construction of works
- xii. List and total cost of input which are domestically sourced. Value addition certificates from suppliers, if the input is not in-house to be attached
- xiii. List and cost of inputs which are imported, directly or indirectly

For and on behalf of(Name of firm/ entity)
--

Authorized signatory (To be duly authorized by the Board of Directors)

(Insert Name, Designation and Contact No.)

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS
	FOR PGCIL HVDC NAGPUR PROJECT
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-VI

CLAUSE REGARDING RESTRICTIONS UNDER RULE 144 (XI) OF THE GENERAL FINANCIAL RULES (GFRS), 2017 AS PER GOVERNMENT OF INDIA ORDER OM NO. F.7/10/2021-PPD (1) DATED 23.02.2023

- I. Any bidder from a country which shares a land border with India will be eligible to bid in any procurement whether of goods, services (including consultancy services and non-consultancy services) or works (including turnkey projects) only if the bidder is registered with the Competent Authority. Further, any bidder (including bidder from India) having specified Transfer of Technology (ToT) arrangement with an entity from a country which shares a land border with India, shall also require to be registered with the same competent authority.
- II. "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any person or firm or company, including any member of a consortium or joint venture (that is an association of several persons, or firms or companies), every artificial juridical person not falling in any of the descriptions of bidders stated hereinbefore, including any agency branch or office controlled by such person, participating in a procurement process.
- **III.** "Bidder (or entity) from a country which shares a land border with India" for the purpose of this Order means: -
 - (a) An entity incorporated, established or registered in such a country; or
 - (b) A subsidiary of an entity incorporated, established or registered in such a country; or
 - (c) An entity substantially controlled through entities incorporated, established or registered in such a country; or
 - (d) An entity whose beneficial owner is situated in such a country; or
 - (e) An Indian (or other) agent of such an entity; or
 - (f) A natural person who is a citizen of such a country; or
 - (g) A consortium or joint venture where any member of the consortium or joint venture falls under any of the above.

IV. The beneficial owner for the purpose of (iii) above will be as under:

1. In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.

Explanation-

- a) "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent. of shares or capital or profits of the company;
- b) "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholders agreements or voting agreements;

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS
	FOR PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

- **2.** In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting alone or together, or through one or more juridical person, has ownership of entitlement to more than fifteen percent of capital or profits of the partnership;
- **3.** In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has ownership of or entitlement to more than fifteen percent of the property or capital or profits of such association or body of individuals;
 - 4. Where no natural person is identified under (1) or (2) or (3) above, the beneficial owner is the relevant natural person who holds the position of senior managing official;
 - 5. In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen percent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.
- **V.** An Agent is a person employed to do any act for another, or to represent another in dealings with third person.
- VI. The successful bidder shall not be allowed to sub-contract works to any contractor from a country which shares a land border with India unless such contractor is registered with the Competent Authority
- VII. The registration shall be valid at the time of submission of bid and at the time of acceptance of bid.
- **VIII.** If the bidder was validly registered at the time of acceptance/ placement of order, registration shall not be a relevant consideration during contract execution

The above clause is not applicable to the bidders from those countries (even if sharing a land border with India) to which the GoI has extended lines of credit or in which the GoI is engaged in development projects. List of countries to which lines of credit have been extended or in which development projects are undertaken are available on the Ministry of External affairs website (https://www.mea.gov.in/).

PROJECT:	SUPPLY AND SUPERVISION TESTING OF CURRENT TRANSFORMERS
	FOR PGCIL HVDC NAGPUR PROJECT
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-VII

COMPLIANCE TO GOVERNMENT OF INDIA ORDER OM No. F.7/10/2021-PPD (1) dated 23.02.2023 REGARDING RESTRICTIONS UNDER RULE 144 (XI) OF THE GENERAL FINANCIAL RULES (GFRS), 2017

PROJECT:	SUPPLY AND SUPERVISION TESTING OF CURRENT TRANSFORMERS FOR	
	PGCIL HVDC NAGPUR PROJECT.	
ITEM:	: 765kV CURRENT TRANSFORMERS	
ENQUIRY No.		

Sl. No.	Description	Bidder's confirmation
1.	We, M/s have read the clause	Agreed
	regarding restrictions on procurement from a bidder of a country which	
	shares a land border with India; We hereby certify that we are not from	
	such a country.	
	We also have read the clause regarding restrictions on procurement from	
	a bidder having Transfer of Technology (ToT) arrangement. We certify that	
	we do not have any ToT arrangement requiring registration with the	
	competent authority."	

Note: Non-compliance of above said GoI Order and its subsequent amendment, (if any), by any bidder(s) shall lead for commercial rejection of their bids by BHEL.

		Signature of the	authorized representative of
Place	:	Bidder's Name	·
Date	:	Designation	:
		Company Seal	:

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-VIII

COMPLIANCE TO GOVERNMENT OF INDIA ORDER OM No. F.7/10/2021-PPD (1) dated 23.02.2023 REGARDING RESTRICTIONS UNDER RULE 144 (XI) OF THE GENERAL FINANCIAL RULES (GFRS), 2017

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL HVDC		
	NAGPUR PROJECT		
ITEM:	765kV CURRENT TRANSFORMERS		
ENQUIRY No.			

Sl. No.	Description	Bidder's confirmation
1.	We, M/s have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India. We are from such a country which shares a land border with India & have been registered with the Competent Authority as specified in above said order. We hereby certify that we fulfil all requirements in this regard and are eligible to be considered. We also have read the clause regarding restrictions on procurement from a bidder having Transfer of Technology (ToT) arrangement. We certify that we have valid registration to participate in this procurement."	

Note: Non-compliance of above said GoI Order and its subsequent amendment, (if any), by any bidder(s) shall lead for commercial rejection of their bids by BHEL.

		Signature of the	authorized representative of
Place	:	Bidder's Name	:
Date		Designation	•
		•	:

No.25-111612018-PG Government of India Ministry of Power

Shram Shakti Bhawan, Rafi Marg, New Delhi • — 110001 Tele Fax: 011-23730264

Dated 02/07/2020

ORDER

Power Supply System is a sensitive and critical infrastructure that supports not only our national defence, vital emergency services including health, disaster response, critical national infrastructure including classified data & communication services, defence installations and manufacturing establishments, logistics services but also the entire economy and the day-today life of the citizens of the country. Any danger or threat to Power Supply System can have catastrophic effects and has the potential to cripple the entire country. Therefore, the Power Sector is a strategic and critical sector.

The vulnerabilities in the Power Supply System & Network mainly arise out of the possibilities of cyber attacks through malware / Trojans etc. embedded in imported equipment. Hence, to protect the security, integrity and reliability of the strategically important and critical Power Supply System & Network in the country, the following directions are hereby issued:-

- 1. All equipment, components, and parts imported for use in the Power Supply System and Network shall be tested in the country to check for any kind of embedded malware/trojans/cyber threat and for adherence to Indian Standards.
- 2. All such testings shall be done in certified laboratories that will be designated by the Ministry of Power (MOP).
- 3. Any import of equipment/components/parts from "prior reference" countries as specified or by persons owned by, controlled by, or subject to the jurisdiction or the directions of these "prior reference" countries will require prior permission of the Government of India
- 4. Where the equipment/components/parts are imported from "prior reference" countries, with special permission, the protocol for testing in certified and designated laboratories shall be approved by the Ministry of Power (MOP).

This order shall apply to any item imported for end use or to be used as a component, or as a part in manufacturing, assembling of any equipment or to be used in power supply system or any activity directly or indirectly related to power supply system.

This issues with the approval of Hon'ble Minister of State for Power and New & Renewable Energy (Independent Charge).

(Goutam Ghosh)

Director Tel: 011-23716674 To:

- 1. All Ministries/Departments of Government of India (As per list)
- 2. Secretary (Coordination), Cabinet Secretariat

3. Vice Chairman, NITI Aayog

सेवा भवन, आर. के. पुरम-I, नई दिल्ली-110066 टेली: 011-26732257 ईमेल: ce-rndcea@nic.in वेबसाइट: www.cea.nic.in

Sewa Bhawan, R.K Puram-i, New Delhi - 110066 Tele: 011-26732257 Email: ce-rndcea@nic.in Website: www.cea.nic.in

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR
	PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-X

IN VIEW OF ORDER NO. 25-111612018-PG, DATED 02.07.2020 OF MINISTRY OF POWER, GOI

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS
	FOR PGCIL HVDC NAGPUR PROJECTS.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

This is to certify that all equipment, components, and parts imported for use in the Power Supply System and Network are in strict compliance to directions issued by Ministry of Power, Govt. of India vide order No. 25-111612018-PG Dtd. 02.07.2020. The imported component(s), part or assembly item(s) does not carry any malware/ Trojan, etc.

Note: Non-compliance of MoP Order and its subsequent amendment(s), (if any), by vendor shall lead to rejection of their offer or cancellation of contract, which is awarded by BHEL.

		Signature of the	authorized representative of
Place	:	Bidder's Name	:
Date	:	Designation	:
		Company Soal	

Annexure-XI

INTEGRITY PACT

Between

Bharat Heavy Electricals Ltd. (BHEL), a company registered under the Companies Act 1956 and having its registered office at "BHEL House", Siri Fort, New Delhi - 110049 (India) hereinafter referred to as "The Principal", which expression unless repugnant to the context or meaning hereof shall include its successors or assigns of the ONE PART

and
, (description of the party along with address), hereinafter referred to as "The Bidder/ Contractor" which expression unless repugnant to the context or meaning hereof shall include its successors or assigns of the OTHER PART
<u>Preamble</u>
The Principal intends to award, under laid-down organizational procedures, contract/s for
(hereinafter referred to as "Contract"). The Principal values full compliance with all relevant laws of the land, rules and regulations, and the principles of economic use of resources, and of fairness and transparency in its relations with its Bidder(s)/ Contractor(s).

In order to achieve these goals, the Principal will appoint panel of Independent External Monitor(s) (IEMs), who will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

Section 1- Commitments of the Principal

- 1.1 The Principal commits itself to take all measures necessary to prevent corruption and to observe the following principles: -
- 1.1.1 No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.
- 1.1.2 The Principal will, during the tender process treat all Bidder(s) with equity and reason. The Principal will in particular, before and during the tender process, provide to all Bidder(s) the same information and will not provide to any Bidder(s) confidential/ additional information through which the Bidder(s) could obtain an advantage in relation to the tender process or the contract execution.
- 1.1.3 The Principal will exclude from the process all known prejudiced persons.
 - 1.2 If the Principal obtains information on the conduct of any of its employees which is a penal offence under the Indian Penal Code 1860 and Prevention of Corruption Act 1988 or any other statutory penal enactment, or if there be a substantive suspicion in this regard, the Principal will inform its Vigilance Office and in addition can initiate disciplinary actions.

Section 2 - Commitments of the Bidder(s)/ Contractor(s)

2.1 The Bidder(s)/ Contractor(s) commit himself to take all measures necessary to prevent corruption. The Bidder(s)/ Contractor(s) commits himself to observe the following principles during participation in the tender process and during the contract execution.

- 2.1.1 The Bidder(s)/ Contractor(s) will not, directly or through any other person or firm, offer, promise or give to the Principal or to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material, immaterial or any other benefit which he/ she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.
- 2.1.2 The Bidder(s)/ Contractor(s) will not enter with other Bidder(s) into any illegal or undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.
- 2.1.3 The Bidder(s)/ Contractor(s) will not commit any penal offence under the relevant Indian Penal Code (IPC) and Prevention of Corruption Act; further the Bidder(s)/ Contractor(s) will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
- 2.1.4 Foreign Bidder(s)/ Contractor(s) shall disclose the name and address of agents and representatives in India and Indian Bidder(s)/ Contractor(s) to disclose their foreign principals or associates. The Bidder(s)/ Contractor(s) will, when presenting his bid, disclose any and all payments he has made, and is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.
 - 2.2 The Bidder(s)/ Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.
 - 2.3 The Bidder(s)/ Contractor(s) shall not approach the Courts while representing the matters to IEMs and shall await their decision in the matter.

Section 3 - Disqualification from tender process and exclusion from future contracts

If the Bidder(s)/ Contractor(s), before award or during execution has committed a transgression through a violation of Section 2 above, or acts in any other manner such as to put his reliability or credibility in question, the Principal is entitled to disqualify the Bidder(s)/ Contractor(s) from the tender process, terminate the contract, if already awarded, exclude from future business dealings and/ or take action as per the separate "Guidelines on Banning of Business dealings with Suppliers/ Contractors", framed by the Principal.

Section 4 - Compensation for Damages

- 4.1 If the Principal has disqualified the Bidder (s) from the tender process before award / order acceptance according to Section 3, the Principal is entitled to demand and recover the damages equivalent to Earnest Money Deposit/ Bid Security.
- 4.2 If the Principal is entitled to terminate the Contract according to Section 3, or terminates the Contract in application of Section 3 above , the Bidder(s)/ Cotractor (s) transgression through a violation of Section 2 above shall be construed breach of contract and the Principal shall be-entitled to demand and recover from the Contractor an amount equal to 5% of the contract value or the amount equivalent to Security Deposit/ Performance Bank Guarantee , whichever is higher, as damages, in addition to and without prejudice to its right to demand and recover compensation for any other loss or damages specified elsewhere in the contract.

Section 5 - Previous Transgression

5.1 The Bidder declares that no previous transgressions occurred in the last 3 (three) years with any other company in any country conforming to the anti-corruption approach or with any other Public Sector Enterprise in India that could justify his exclusion from the tender process.

5.2 If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason or action can be taken as per the separate "Guidelines on Banning of Business dealings with Suppliers/ Contractors", framed by the Principal.

Section 6 - Equal treatment of all Bidder (s)/ Contractor (s) / Sub-contractor (s)

- 6.1 The Principal will enter into Integrity Pacts with identical conditions as this Integrity Pact with all Bidders and Contractors.
- In case of Sub-contracting, the Principal Contractor shall take the responsibility of the adoption of Integrity Pact by the Sub-contractor(s) and ensure that all Sub-contractors also sign the Integrity Pact.
- 6.3 The Principal will disqualify from the tender process all Bidders who do not sign this Integrity Pact or violate its provisions.

Section 7 - Criminal Charges against violating Bidders/ Contractors / Subcontractors

If the Principal obtains knowledge of conduct of a Bidder, Contractor or Subcontractor, or of an employee or a representative or an associate of a Bidder, Contractor or Subcontractor which constitutes corruption, or if the Principal has substantive suspicion in this regard, the Principal will inform the Vigilance Office.

Section 8 -Independent External Monitor(s)

- 8.1 The Principal appoints competent and credible panel of Independent External Monitor (s) (IEMs) for this Integrity Pact. The task of the IEMs is to review independently and objectively, whether and to what extent the parties comply with the obligations under this Integrity Pact.
- 8.2 The IEMs are not subject to instructions by the representatives of the parties and performs his functions neutrally and independently. He reports to the CMD, BHEL.
- 8.3 The IEMs shall be provided access to all documents/ records pertaining to the Contract, for which a complaint or issue is raised before them as and when warranted. However, the documents/records/information having National Security implications and those documents which have been classified as Secret/Top Secret are not to be disclosed.
- 8.4 The Principal will provide to the IEMs sufficient information about all meetings among the parties related to the Contract provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the IEMs the option to participate in such meetings.

- 8.5 The advisory role of IEMs is envisaged as that of a friend, philosopher and guide. The advice of IEMs would not be legally binding and it is restricted to resolving issues raised by a Bidder regarding any aspect of the tender which allegedly restricts competition or bias towards some Bidders. At the same time, it must be understood that IEMs are not consultants to the Management. Their role is independent in nature and the advice once tendered would not be subject to review at the request of the organization.
- 8.6 For ensuring the desired transparency and objectivity in dealing with the complaints arising out of any tendering process or during execution of Contract, the matter should be examined by the full panel of IEMs jointly, who would look into the records, conduct an investigation, and submit their joint recommendations to the Management.
- 8.7 The IEMs would examine all complaints received by them and give their recommendations/ views to the CMD, BHEL at the earliest. They may also send their report directly to the CVO, in case of suspicion of serious irregularities requiring legal/ administrative action. Only in case of very serious issue having a specific, verifiable Vigilance angle, the matter should be reported directly to the Commission. IEMs will tender their advice on the complaints within 30 days.
- 8.8 The CMD, BHEL shall decide the compensation to be paid to the IEMs and its terms and conditions.
- 8.9 IEMs should examine the process integrity, they are not expected to concern themselves with fixing of responsibility of officers. Complaints alleging mala fide on the part of any officer of the Prinicpal should be looked into by the CVO of the Principal.
- 8.10 If the IEMs have reported to the CMD, BHEL, a substantiated suspicion of an offence under relevant Indian Penal Code / Prevention of Corruption Act, and the CMD, BHEL has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Office, the IEMs may also transmit this information directly to the Central Vigilance Commissioner, Government of India.
- 8.11 After award of work, the IEMs shall look into any issue relating to execution of Contract, if specifically raised before them. As an illustrative example, if a Contractor who has been awarded the Contract, during the execution of Contract, raises issue of delayed payment etc. before the IEMs, the same shall be examined by the panel of IEMs. Issues like warranty/ guarantee etc. shall be outside the purview of IEMs.
- 8.12 However, the IEMs may suggest systemic improvements to the management of the Principal, if considered necessary, to bring about transparency, equity and fairness in the system of procurement.
- 8.13 The word 'Monitor' would include both singular and plural.

Section 9 - Pact Duration

- 9.1 This Integrity Pact shall be operative from the date this Integrity Pact is signed by both the parties till the final completion of contract for successful Bidder, and for all other Bidders 6 months after the Contract has been awarded. Any violation of the same would entail disqualification of the bidders and exclusion from future business dealings.
- 9.2 If any claim is made/ lodged during currency of this Integrity Pact, the same shall be binding and continue to be valid despite the lapse of this Pact as specified above, unless it is discharged/ determined by the CMD, BHEL.

Section 10 - Other Provisions

- 10.1 This Integrity Pact is subject to Indian Laws and exclusive jurisdiction shall be of the competent Courts as indicated in the Tender or Contract, as the case may be.
- 10.2 Changes and supplements as well as termination notices need to be made in writing.
- 10.3 If the Bidder(s)/ Contractor(s) is a partnership or a consortium or a joint venture, this Integrity Pact shall be signed by all partners of the partnership or joint venture or all consortium members.
- 10.4 Should one or several provisions of this Integrity Pact turn out to be invalid, the remainder of this Integrity Pact remains valid. In this case, the parties will strive to come to an agreement to their original intentions.
- Only those bidders / contractors who have entered into this Integrity Pact with the Principal would be competent to participate in the bidding. In other words, entering into this Integrity Pact would be a preliminary qualification.
- In the event of any dispute between the Principal and Bidder(s)/ Contractor(s) relating to the Contract, in case, both the parties are agreeable, they may try to settle dispute through Mediation before the panel of IEMs in a time bound manner. In case, the dispute remains unresolved even after mediation by the panel of IEMs, either party may take further action as the terms & conditions of the Contract. The fees/expenses on dispute resolution through mediation shall be shared by both the parties. Further, the mediation proceedings shall be confidential in nature and the parties shall keep confidential all matters relating to the mediation proceedings including any settlement agreement arrived at between the parties as outcome of mediation. Any views expressed, suggestions, admissions or proposals etc. made by either party in the course of mediation shall not be relied upon or introduced as evidence in any further arbitral or judicial proceedings, whether or not such proceedings relate to the dispute that is the subject of mediation proceedings. Neither of the parties shall present IEMs as witness in any Alternative Dispute Resolution or judicial proceedings in respect of the dispute that was subject of mediation.

3 62/ lether 2025	
निर्मा केर्क देवाने Deep Chelheir Lapangan जर प्रवेषक (कार्म) प्रवेषन (कार्म) पारेषण व्यापार संगृहितां Smission Business Group भारत हेवी इलेक्ट्रिकला निर्मेटेड / Bharat Heavy Electricals Ltd. इसी मुख्यित, शेल स्टार क्लंट न 25 संस्टर-160, लोएडा-201301 (उ.स.) Shi मुख्यित, शेल स्टार क्लंट न 25 संस्टर-160, लोएडा-201301 (उ.स.)	For & On behalf of the Bidder/ Contractor (Office Seal)
Date	
Witness: NWOLW (Name & Address) 03 102 125	Witness:
Name & Address) Nandlal Verma	(Name & Address)

Assessment report from Contractor for proposed sub-vendor along with following enclosures (to the extent available):

- 1. Registration / License of the works
- 2. Organization chart with name and qualification of key persons
- 3. List of Plant and Machinery.
- 4. List of testing equipment with their calibration status.
- 5. List of Raw material, bought out items with sourcing details
- 6. List of out-sourced services with sourcing details.
- 7. List of supply in last three years.
- 8. Third party approval, if any (viz. ISO, BIS),
- 9. Pollution clearance wherever applicable
- 10. Energy Conservation & Efficiency report

(Applicable to industries having contract load more than 100 KVA)

- 11. Formats for RM, in process and acceptance testing
- 12. Type test approvals conducted in last 5 years, if applicable
- 13. Performance Certificates from customers
- 14. Photographs of factory, plant and machinery & testing facilities

256m

MANUFACTURING QUALITY PLAN

Annexure- III Page 1 of 2

	Manufacturers Details (Name, Works Address etc.)		omer RGRID	Vendor's Code:	Item:	Q.P. No. Rev. No. Date:				Fi Va	alid rom alid pto:	:	
Sr.	Components /	Type of	Quantu	Reference	Acceptance	Format of	ΙΑ	ppli	cab	le C	ode	es	Remarks
No.	Operations & Description of Test	check	m of Check / Samplin g with basis	document for Testing	Norms	Record	1	-	3	4	5		
A. Sec	tion: RAW MATERIAL INSPECTION												
B. Sect	ion : IN PROCESS INSPECTION												
C. Sect	ion: FINAL TESTING												
D. Sect	ion: PACKING & DISPATCH												

3 dra

MANUFACTURING QUALITY PLAN

Page 2 of 2

		130	1.0	1 =	Page 2 of 2
	Customer	Vendor's Code:	Item:	Q.P. No.	Valid From:
	POWERGRID			Rev. No.	Valid Upto:
				Date:	
	Indicates place where testing is planned to be				
Code 1	performed i.e. Inspection location	Code 2	Indicates The Equi		orm the tests i.e. Testing Agency
Α	At Equipment Manufacturer's works	J	Manufact The Com	turer	
В	At Component Manufacturer's works	K	Manufact		
С	At Authorised Distributor's place	L	The Third	d Party	
D	At Independent Lab	М		key Contractor	
Ε	At Turn Key Contractor's location			,	
F	Not specified				
Code 3	Indicates who shall witness the tests i.e. Witnessing Agency	Code 4		Certificates	win a second size III
Р	Component Manufacturer itself	W	Inspection		ring raw material/bought out component
Q	Component Manufacturer and Equipment Manufacturer Component Manufacturer, Equipment Manufacturer and	X			ct/process inspection
R	Contractor	Y	By POWI	ERGRID during pro	oduct/process inspection ERGRID during product/process
S	Equipment Manufacturer itself	Z	inspection		Trains daming product/process
Т	Equipment Manufacturer and Contractor				
U	Equipment Manufacturer, Contractor and POWERGRID				
٧	Third Party itself				
Code 5	Whether specific approval of sub-vendor / Component make is envisaged?	Code 6		test records require	ed to be submitted after final inspection
E	* · · · · · · · · · · · · · · · · · · ·			ice of CIP/IVIICC	
_	S				
E	Envisaged Not Envisaged	Y N	Yes No		



BANK GUARANTEE FOR PERFORMANCE SECURITY

Bank Guarantee No:
Date:

To

NAME

& ADDRESSES OF THE BENEFICIARY

Dear Sirs,

In consideration of the $\underline{Bharat\ Heavy\ Electricals\ Limited}$ 1 (hereinafter referred to as the 'Employer' which
expression shall unless repugnant to the context or meaning thereof, include its successors and permitted
assigns) incorporated under the Companies Act, 1956 and having its registered office at BHEL House Siri Fort
New Delhi-110049 through its Unit at BHEL, TBG, Noida having awarded to (Name of the Vendor / Contractor
/ Supplier) having its registered office at2 hereinafter referred to as the 'Contractor/Supplier', which
expression shall unless repugnant to the context or meaning thereof, include its successors and permitted
assigns), a contract Ref No PO No. $\tilde{0}$ \tilde
Rsõ õ õ õ õ 4 (Rupees)/FCõ õ õ õ õ õ õ õ õ õ o õ o õ o õ o õ o õ
(hereinafter called the 'Contract') and the Contractor having agreed to provide a Contract Performance
Guarantee, equivalent to \tilde{o} \tilde{o} % (\tilde{o} . Percent) of the said value of the Contract to the Employer for the faithful
performance of the Contract,
we, $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$, (hereinafter referred to as the Bank), having registered/Head office at $\tilde{0}$
inter alia a branch at õ õ õ o being the Guarantor under this Guarantee, hereby, irrevocably and
unconditionally undertake to forthwith and immediately pay to the Employer a maximum amount Rs
(Rupees) without any demur, immediately on a demand from the Employer, .
Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank
under this guarantee. However, our liability under this guarantee shall be restricted to an amount not
exceeding Rs

We undertake to pay to the Employer any money so demanded notwithstanding any dispute or disputes raised by the Contractor/ Supplier in any suit or proceeding pending before any Court or Tribunal relating thereto our liability under this present being absolute and unequivocal.

The payment so made by us under this Guarantee shall be a valid discharge of our liability for payment thereunder and the contractors/supplier shall have no claim against us for making such payment.

We the $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ bank further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said Contract and that it shall continue to be enforceable till all the dues of the Employer under or by virtue of the said Contract have been fully paid and its claims satisfied or discharged.

We õ õ õ õ õ õ a ... BANK further agree with the Employer that the Employer shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said Contract or to extend time of performance by the said Contractor/Supplier from time to time or to postpone for any time or from time to time any of the powers exercisable by the Employer against the said Contractor/Supplier and to forbear or enforce any of the terms and conditions relating to the said Agreement and we shall not be relieved from our liability by reason of any such variation, or extension being granted to the said Contractor/Supplier or for any forbearance, act or omission on the part of the Employer or any indulgence by the Employer to the said Contractor/Supplier or by any such matter or thing whatsoever which under the law relating to sureties would but for this provision have effect of so relieving us.

The Bank also agrees that the Employer at its option shall be entitled to enforce this Guarantee against the Bank as a principal debtor, in the first instance without proceeding against the Contractor and notwithstanding any security or other guarantee that the Employer may have in relation to the Contractor's liabilities.

This Guarantee shall remain in force upto and including $\tilde{0}$ \tilde

This Guarantee shall not be determined or affected by liquidation or winding up, dissolution or change of constitution or insolvency of the Contractor/Supplier but shall in all respects and for all purposes be binding and operative until payment of all money payable to the Employer in terms thereof.

Unless a demand or claim under this guarantee is made on us in writing on or before the $\tilde{0}$ $\tilde{0}$

We õ õ õ õ õ BANK lastly undertake not to revoke this guarantee during its currency except with the previous consent of the Employer in writing.

Notwithstanding anything to the contrary contained hereinabove:

- a) The liability of the Bank under this Guarantee shall not exceed o o o o o o o o o o
- b) This Guarantee shall be valid up to $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$ $\tilde{0}$

We,	Bank, have power to issue this	Guarantee under law and the undersigned as a duly
authorized pers	son has full powers to sign this Guarante	ee on behalf of the Bank.
		For and on behalf of
		(Name of the Bank)

Datedõ õ õ õ õ õ .

Place of Issueõ õ õ õ õ õ .

Instruction for BG

- ¹ NAME AND ADDRESS OF EMPLOYER I.e Bharat Heavy Electricals Limited
- ² NAME AND ADDRESS OF THE VENDOR /CONTRACTOR / SUPPLIER.
- ³ DETAILS ABOUT THE NOTICE OF AWARD/CONTRACT REFERENCE
- ⁴ PROJECT/SUPPLY DETAILS
- ⁵ BG AMOUNT IN FIGURES AND WORDS
- ⁶ VALIDITY DATE
- ⁷ DATE OF EXPIRY OF CLAIM PERIOD
- 8 BG AMOUNT IN FIGURES AND WORDS.
- ⁹ VALIDITY DATE
- 10 DATE OF EXPIRY OF CLAIM PERIOD

Note:

- 1. Units are advised that expiry of claim period may be kept 2/3 months after validity date.
- 2. In Case of Bank Guarantees submitted by Foreign Vendors
 - a. From Nationalized/Public Sector / Private Sector/ Foreign Banks (BG issued by Branches in India) can be accepted subject to the condition that the Bank Guarantee should be enforceable in the town/city or at nearest branch where the Unit is located i.e. Demand can be presented at the Branch located in the town/city or at nearest branch where the Unit is located.
 - b. From Foreign Banks (wherein Foreign Vendors intend to provide BG from local branch of the Vendor country's Bank)
 - b.1 In such cases, in the Tender Enquiry/ Contract itself, it may be clearly specified that Bank Guarantee issued by any of the Consortium Banks only will be accepted by BHEL. As such, Foreign Vendor needs to make necessary arrangements for issuance of Counter- Guarantee by Foreign Bank in favour of the Indian Bank (BHELs Consortium Bank). It is advisable that all charges for issuance of Bank Guarantee/ counter- Guarantee should be borne by the Foreign Vendor. The tender stipulation should clearly specify these requirements.
 - **b.2** In case, Foreign Vendors intend to provide BG from Overseas Branch of our Consortium Bank (e.g. if a BG is to be issued by SBI Frankfurt), the same is acceptable. However, the procedure at sl.no. b.1 will required to be followed.
 - **b.3** The BG issued may preferably be subject to Uniform Rules for Demand Guarantees (URDG) 758 (as amended from time to time). In case, of Foreign Vendors, the BG Format provided to them should clearly specify the same.
 - **b.4** The BG should clearly specify that the demand or other document can be presented in electronic form.

Annexure for List of Banks (32 Nos.)

Sr. No.	Name of Bank
1	Allahabad Bank
2	Andhra Bank
3	Bank of Baroda
4	Canara Bank
5	Corporation Bank
6	Central Bank
7	Indian Bank
8	Indian Overseas Bank
9	Oriental Bank of Commerce
10	Punjab National Bank
11	Punjab & Sindh Bank
12	State Bank of India
13	State Bank of Hyderabad
14	Syndicate Bank
15	State Bank of Travancore
16	UCO Bank
17	Union Bank of India
18	United Bank of India
19	Vijaya Bank
20	IDBI
21	CITI Bank N. A.
22	Deutsche Bank AG
23	The Hongkong and Shanghai Banking Corporation Limited
24	Standard Chartered Bank
25	J P Morgan
26	Axis Bank
27	The Federal Bank Limited
28	HDFC
29	Kotak Mahindra Bank
30	ICICI
31	Indusind Bank
32	Yes Bank

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR PGCIL
	HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-XV

CONTACT DETAILS OF BIDDER

Work Address		
Correspondence Address		
PAN NO.	_	
GST No.		
GeM Seller Id.		
Gelvi Seller Id.		
MSME Status		
(MICRO/SMALL/MEDIUM)		
Details of contact person fo	clarification regarding bid:	
Contact Person Name		
Designation		
email ID		
Mobile No.		
Landline No.		
	Signature of t	the authorized representative of
Place :	Bidder's Nam	
Date		
Date :	Designation	·
	Company Sea	31 :

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR
	PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-XVI

SCHEDULE OF TECHNICAL DEVIATION

Sl. No.	Clause No. of Technical Specifications	Statement of Deviation
	Nil Deviation	Nil Deviation
under this	nis schedule is not submitted, it will be presumed contract is deemed to be in compliance with the Nil Deviation, even then the format to be filled as	Technical Specifications.
Note:		

- 1. Continuation sheets of like size and format may be used as per the Bidder's Requirement and shall be annexed to this schedule.
- 2. Deviation mentioned in this schedule shall only be considered.

		Signature of the	authorized representative of
Place	:	Bidder's Name	·
Date	·	Designation	·
		J	:

PROJECT:	SUPPLY AND SUPERVISION OF TESTING OF CURRENT TRANSFORMERS FOR
	PGCIL HVDC NAGPUR PROJECT.
ITEM:	765kV CURRENT TRANSFORMERS
ENQUIRY No.	

ANNEXURE-XVII

SCHEDULE OF COMMERCIAL DEVIATION

SI. No.	Clause No. of Terms and Conditions	Statement of Deviation
	Nil Deviation	Nil Deviation
	schedule is not submitted, it will be presumed that ontract is deemed to be in compliance with Terms a	· · ·

Note:

- Continuation sheets of like size and format may be used as per the Bidder's Requirement and shall be annexed to this schedule.
- Deviation mentioned in this schedule shall only be considered. 2.

	Signature of the	authorized representative of
: :	Designation	:

No. A-1/2021-FSC-Part(5) Government of India Ministry of Power

Shram Shakti Bhawan, New Delhi Dated: 16th November, 2021

ORDER

Subject: Public Procurement (Preference to Make in India) to provide for Purchase Preference (linked with local content) in respect of Power Sector.

Reference: Department for Promotion of Industry and Internal Trade (DPIIT) Notification No. P-45021/2/2017-PP (BE-II) dated 16.09.2020.

The Government of India, Department for Promotion of Industry and Internal Trade (DPIIT) issued Public Procurement (Preference to Make in India), Order 2017, for encouraging 'Make in India' and promoting manufacturing and production of goods and services in India with a view to enhancing income and employment. Subsequently, DPIIT vide order No. P-45021/2/2017-PP (BE-II) dated 4th June, 2020 and further vide order dated 16th September, 2020 have issued the revised Public Procurement (Preference to Make in India) Order 2017.

- 2. In light of the Public Procurement (Preference to Make in India) Order 2017, this Ministry had notified purchase preference (linked with local content) for Hydro and Transmission sectors vide Order No. 11/05/2018-Coord dated 20.12.2018, for Thermal sector vide Order dated 28.12.2018 and for Distribution sector vide Order dated 17.03.2020. Further, a combined order dated 04.04.2020 was also issued in supersession of all previous orders to indicate equipment/material/components for which there was sufficient local capacity and competition and also to indicate conditions for including suitably in the tenders to be issued by the procurers. In furtherance of Para 19 of the DPIIT Notification No. P-45021/2/2017-PP(BE-II) dated 04.06.2020, Ministry of Power (MoP) issued a revised comprehensive Order dated 28.07.2020 (Annexure-I amended by order dated 17.09.2020).
- 3. DPIIT Notification No. P-45021/2/2017-PP(BE-II) dated 16.09.2020 has further revised its order dated 04.06.2020. Therefore, in supersession of all the aforementioned orders including order No.10/1/2019-St.Th. (Part-II) dated 20.03.2020 issued by this Ministry, the following has been decided:
 - i. For the purpose of this order, the definitions of various terms used in the order, and provisions relating to (i) Eligibility of 'Class-I local supplier'/'Class-II local supplier'/'Non-local suppliers' for different types of procurement, (ii) purchase preference (iii) exemption to small purchases and (iv) margin of purchase preference shall be the same as in DPIIT order dated 16.09.2020, referred to above and extracts of the same is given at Appendix.
 - ii. In procurement of all goods and services or works in respect of which there is sufficient local capacity and local competition as in Annexure-I, only "Class-I local supplier" shall be eligible to bid irrespective of purchase value. "Class-I local supplier" is a supplier or service provider whose goods, services or works offered for procurement meets the Minimum Local Content (MLC) as prescribed in Annexure-I of this order. "Class-II local supplier" means a

(B)

- supplier, as defined by DPIIT in its Order No. P-45021/2/2017-PP (BE-II) dated 16-09-2020.
- iii. In the procurement of all goods and services or works other than those listed in Annexure-I, only "Class-I local supplier" and "Class-II local supplier" as defined in the order of this Ministry herewith shall be eligible to bid in procurement undertaken by procuring entities, except when Global Tender Enquiry has been issued. In Global tender enquiries, "Non-local suppliers" shall also be eligible to bid along with "Class-I local suppliers" and "Class-II local suppliers". In procurement of all goods, services or works not covered by sub-para 3(ii) above, and with estimated value of purchases less than Rs. 200 crores, in accordance with Rule 161(iv) of GFR, 2017, Global Tender Enquiry(GTE) shall not be issued except with the approval of the competent authority as designated by Department of Expenditure.
- iv. For the purpose of this order, 'Works' means all works as per Rule 130 of GFR- 2017, and will also include 'tumkey works', Engineering, Procurement and Construction (EPC) contracts and service contracts including System Integrator (SI) contracts.
- 4. The list of items, in respect of which, local capacity with sufficient competition exists as per Annexure-I, will be reviewed at regular intervals with a view to increase number of items in this list and also to increase the MLC for each item, wherever it is less than 100%.
- Purchase preference shall be given to local suppliers in accordance with para
 3A of DPIIT Order dated 16.09.2020, and extracts of the same are given at Appendix.
- 6. Further, it has been decided to constitute a committee for independent verification of self-declarations and auditor's / accountant's certificates on random basis and in the case of complaints. The composition of the committee is given below:

Member (Planning), Central Electricity Authority (CEA)	Chairperson
Chief Engineer (PSETD), CEA	Member
Chief Engineer (HETD), CEA	Member
Chief Engineer (TETD), CEA	Member
Chief Engineer (DP&R), CEA	Member
As may be co-opted by CEA	External Expert
Chief Engineer (R&D), CEA	Convener

7. Further, it has also been decided to constitute a committee to examine the grievances in consultation with stakeholders and recommend appropriate actions to the Competent Authority in MoP. The composition of the Committee is given below:

Chairperson, CEA	Chairperson	
Member (Hydro), CEA	Member	



Member (Power System), CEA	Member
Member (Thermal), CEA	Convener

- 8. The complaint fee of Rs. 2 Lakhs or 1% of the value of the local item being procured (subject to maximum of Rs. 5 Lakhs), whichever is higher, shall be paid in the form of Demand Draft, drawn in favour of PAO, CEA, New Delhi. In case the complaint is found to be incorrect, the complaint fee shall be forfeited. In case, the complaint is upheld and found to be substantially correct, the deposited fee of the complainant would be refunded without any interest.
- All other conditions, not stipulated in this order, shall be as laid down in the DPIIT's order No. P-45021/2/2017-PP (BE-II) dated 16.09.2020.
- 10. This order shall be applicable in respect of the procurement made by all attached or subordinate offices or autonomous bodies under the Government of India including Government Companies as defined in the Companies Act, and /or the States and Local Bodies making procurement under all Central Schemes/ Central Sector Schemes where the Scheme is fully or partially funded by the Government of India. The aforesaid orders shall also be applicable in respect of projects wherein funding of goods, services or works is by Power Finance Corporation (PFC) /Rural Electrification Corporation (REC) and any Financial Institution in which Government of India/ State Government share exists. This order shall be applicable to Tariff Based Competitive Bidding (TBCB) projects also. Procuring entities as defined in the DPIIT's Order dated 16.09.2020 are advised to revise their tender documents to fully comply with the said DPIIT's Order and the subsequent Orders that would be issued in this regard by DPIIT/ this Ministry from time to time.
- 11. All tenders for procurement by Central Government Agencies or the States and Local Bodies, as the case may be, have to be certified for compliance of the Public Procurement (Preference to Make in India) 'PPP-MII' Order by the concerned procurement officer of the Government Organization before uploading the same on the portal.
- 12. Exemption from meeting the stipulated local content is allowed as per clause 13 and 13A of PPP-MII Order dated 16.09.2020, if the manufacturer declares that the item is manufactured in India under a License from a foreign Manufacturer who holds Intellectual Property Rights (IPRs) and there is Transfer of Technology (ToT) with phasing to increase Minimum Local Content. For such items, if any CPSE under the administration of Ministry of Power requests exemption for any item, it shall be considered by Ministry of Power, on case to case basis.
- 13. In order to further encourage Make in India initiatives and promote manufacturing and production of goods and services in India, general guidelines as enclosed at Annexure-II may be adopted in an appropriate manner according to the circumstances by the procuring entities in their tendering process.
- 14. The procurers may specify the higher values of MLC than those specified in this Order in respect of goods, services or works covered in their tenders and award the weightage to the product of higher MLC for which they have to specify the criteria beforehand in their tender. The values given in Annexure-I are the minimum prescribed values for becoming a class-I local supplier for the products indicated therein.

Ba

15. This issues with the approval of Hon'ble Minister for Power and New & Renewable Energy.

(S. Majumdar) Under Secretary to the Government of India Tele No. 011- 23356938

To:

- Secretary to Government of India (All Ministries/ Departments of Government of India) (As per list)
- 2. Secretary (Coordination), Cabinet Secretariat
- 3. CEO, NITI Aayog
- 4. Chief Secretaries of all States/ UTs
- 5. Comptroller and Auditor General of India
- Secretary, DPIIT, Chairman of Standing Committee for implementation of Public Procurement Order, 2017
- Director General, Bureau of Indian Standards (BIS)
- Joint Secretary, DPIIT, Member-Convener of Standing Committee for implementation of Public Procurement Order, 2017
- 9. Chairperson, CEA
- CMDs of CPSEs, CMD NLC, Chairman of DVC/ BBMB/ EESL, DGs of BEE/ CPRI/ NPTI
- 11. All Additional Secretaries/ JSs/ EA/ CE, Ministry of Power

Copy to:

Director (Technical), NIC with a request to publish the Order on the website of Ministry of Power

APPENDIX

Extracts of important provisions contained in DPIIT Order No. P-45021/2/2017-PP (BE-II) dated 16-09-2020

1. Definitions (Para 2 of DPIIT order):

'Local content' means the amount of value added in India which shall, unless otherwise prescribed by the Nodal Ministry, be the total value of the item procured (excluding net domestic indirect taxes) minus the value of imported content in the item (including all customs duties) as a proportion of the total value, in percent.

'Class-I local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, meets the minimum local content as prescribed for 'Class-I local supplier' under this Order.

'Class-II local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, meets the minimum local content as prescribed for 'Class-II local supplier' but less than that prescribed for "Class-I Local supplier" under this Order.

'Non-Local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, has local content less than that prescribed for 'Class-II local supplier' under this Order.

'L1' means the lowest tender or lowest bid or the lowest quotation received in a tender, bidding process or other procurement solicitation as adjudged in the evaluation process as per the tender or other procurement solicitation.

'Margin of purchase preference' means the maximum extent to which the price quoted by a 'Class-I local supplier' may be above the L1 for the purpose of purchase preference.

'Nodal Ministry' means the Ministry or Department identified pursuant to this order in respect of a particular item of goods or services or works.

'Procuring entity' means a Ministry or department or attached or subordinate office of, or autonomous body controlled by, the Government of India and includes Government companies as defined in the Companies Act.

'Works' means all works as per Rule 130 of GFR- 2017, and will also include 'tumkey works'.

- Eligibility of 'Class-I local supplier'/ 'Class-II local supplier'/ 'Non-local suppliers' for different types of procurement (Para 3 of DPIIT order)
 - (a) In procurement of all goods, services or works in respect of which the Nodal Ministry / Department has communicated that there is sufficient local capacity and local competition, only 'Class-I local supplier', as defined under the Order, shall be eligible to bid irrespective of purchase value.
 - (b) Only 'Class-I local supplier' and 'Class-II local supplier', as defined under the Order, shall be eligible to bid in procurements undertaken by procuring entities, except when Global tender enquiry has been issued. In global tender enquiries, 'Non-local suppliers' shall also be eligible to bid along with 'Class-I local suppliers' and 'Class-II local suppliers'. In procurement of all goods, services or works, not covered by 3(a)above, and with estimated value of purchases less than Rs 200 crores, in accordance with Rule 161(iv) of GFR, 2017 Global tender enquiry shall not

be issued except with the approval of competent authority as designated by Department of Expenditure.

(c) For the purpose of this Order, works includes Engineering, Procurement and Construction (EPC) contracts and services include System Integrator (SI) contracts.

3. Purchase Preference (Para 3A of DPIIT order)

- (a) Subject to the provisions of this Order and to any specific instructions issued by the Nodal Ministry or in pursuance of this Order, purchase preference shall be given to 'Class-I local supplier' in procurements undertaken by procuring entities in the manner specified here under.
- (b) In the procurements of goods or works, which are covered by para 3(b) of DPIIT Order No. P-45021/2/2017-PP(BE-II) dated 16-09-2021 and which are divisible in nature, the "Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
- Among all qualified bids, the lowest bid will be termed as L1 If L1 is 'Class-I local supplier', the contract for full quantity will be awarded to L1.
- ii. If L1 bid is not a 'Class-I local supplier', 50% of the order quantity shall be awarded to L1. Thereafter, the lowest bidder among the 'Class-I local supplier' will be invited to match the L1 price for the remaining 50% quantity subject to the Class-I local supplier's quoted price falling within the margin of purchase preference, and contract for that quantity shall be awarded to such 'Class-I local supplier' subject to matching the L1 price. In case such lowest eligible 'Class-I local supplier' fails to match the L1 price or accepts less than the offered quantity, the next higher 'Class-I local supplier' within the margin of purchase preference shall be invited to match the L1 price for remaining quantity and so on, and contract shall be awarded accordingly. In case some quantity is still left uncovered on Class-I local suppliers, then such balance quantity may also be ordered on the L1 bidder.
- (c) In the procurements of goods or works, which are covered by para 3(b) of DPIIT Order No. P-45021/2/2017-PP(BE-II) dated 16-09-2021 and which are not divisible in nature, and in procurement of services where the bid is evaluated on price alone, the 'Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
- Among all qualified bids, the lowest bid will be termed as L1. If L1 is 'Class-I local supplier', the contract will be awarded to L1,
- iv. If L1 is not 'Class-I local supplier', the lowest bidder among the 'Class-I local supplier', will be invited to match the L1 price subject to Class-I local supplier's quoted price falling within the margin of purchase preference, and the contract shall be awarded to such 'Class-I local supplier' subject to matching the L1 price.
- v. In case such lowest eligible 'Class-I local supplier' fails to match the L1 price, the 'Class-I local supplier' with the next higher bid within the margin of purchase preference shall be invited to match the L1 price and so on and contract shall be awarded accordingly. In case none of the 'Class-I local supplier' within the margin of purchase preference matches the L1 price, the contract may be awarded to the L1 bidder.
- (d) "Class-II local supplier" will not get purchase preference in any procurement, undertaken by procuring entities.

- Applicability in tenders where contract is to be awarded to multiple bidders (Para 3B of DPIIT order)-
 - In tenders where contract is to be awarded to multiple bidders subject to matching of L1 rates or otherwise, the 'Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
 - a) In case there is sufficient local capacity and competition for the items to be procured, as notified by the Nodal Ministry, only 'Class-I local supplier' shall be eligible to bid. As such, the multiple supplier who would be awarded the contract, should be all and only 'Class-I local suppliers'.
 - b) In other cases, 'Class-II local suppliers' and 'Non-Local suppliers' may also participate in the bidding process along with 'Class-I local supplier' as per provisions of this order.
 - c) If 'Class-I local supplier' qualify for award of contract for at least 50% of the tendered quantity in any tender, the contract may be awarded to all the qualified bidders as per award criteria stipulated in the bid documents. However, in case 'Class-I local supplier' do not qualify for award of the contract for at least 50% of the tendered quantity, purchase preference should be given to the 'Class-I local supplier' over 'Class-II local supplier'/Non-local suppliers' provided that their quoted rate falls within 20% margin of purchase preference of the highest quoted bidder considered for award of contract so as to ensure that the 'Class-I local suppliers' taken in totality or considered for award of contract for at least 50% of the tendered quantity.
 - d) First purchase preference has to be given to the lowest quoting 'Class-I local supplier', whose quoted rates fall within 20% margin of purchase preference subject to its meeting the prescribed criteria for award of contract as also the constraints of maximum quantity that can be sourced from any single supplier. If the lowest quoting 'Class-I local supplier', does not qualify for purchase preference because of aforesaid constraints or does not accept the offered quantity, an opportunity may be given to next higher 'Class-I local supplier' falling within 20% margin of purchase preference, and so on.
 - e) To avoid any ambiguity during bid evaluation process, the procuring entities may stipulate its own tender specific criteria for award of contract amongst different bidders including the procedure for purchase preference to 'Class-I local supplier' within the broad policy guidelines stipulate in sub-paras above.
- 5. Exemption of small purchases (Para 4 in DPIIT order): Procurements where the estimated value to be procured is less than Rs. 5 lakhs shall be exempt from this Order. However, it shall be ensured by procuring entities that procurement is not split for the purpose of avoiding the provisions of this Order.
- 6. Minimum Local Content (Para 5 in DPIIT order): The 'local content' requirement to categorize a supplier as 'Class-I local supplier' is minimum 50%. For 'Class-II local supplier', the local content requirement is minimum 20%. Nodal Ministry/Department may prescribe only a higher percentage of minimum local content requirement to categorize a supplier as 'Class-I local supplier'/'Class-II local supplier'. For the item for which Nodal Ministry/Department has not prescribed higher minimum local content notification under the order, it shall be 50% and 20% for 'Class-I local supplier'/'Class-II local supplier' respectively.

- 7. Vide DPIIT OM No. P-45021/102/2019-BE-IIPart(1) (E-50310) dated 4.03.2021 services such as transportation, insurance, installation, commissioning, training and after sales service support like AMC/CMC etc. shall not be considered as local value addition. Bidders offering imported products will fall under the category of Non- local suppliers. They can't claim themselves as Class-I local suppliers/Class-II local suppliers by claiming the services such as transportation, insurance, installation, commissioning, training and after sales service support like AMC/CMC etc. as local value addition.
- Margin of Purchase Preference (Para 6 of DPIIT order): The margin of purchase preference shall be 20%.
- Specifications in Tenders and other procurement solicitations (Para 10 of DPIIT order);
 - a. Every procuring entity shall ensure that the eligibility conditions in respect of previous experience fixed in any tender or solicitation do not require proof of supply in other countries or proof of exports.
 - b. Procuring entities shall endeavour to see that eligibility conditions, including on matters like turnover, production capability and financial strength do not result in unreasonable exclusion of 'Class-I local supplier'/ 'Class-II local supplier' who would otherwise be eligible, beyond what is essential for ensuring quality or creditworthiness of the supplier.
 - c. Procuring entities shall, within 2 months of the issue of this Order review all existing eligibility norms and conditions with reference to sub-paragraphs 'a' and 'b' above.
 - d. Reciprocity Clause:
 - i. When a Nodal Ministry/Department identifies that Indian suppliers of an item are not allowed to participate and/ or compete in procurement by any foreign government, due to restrictive tender conditions which have direct or indirect effect of baring Indian companies such as registration in the procuring country, execution of projects of specific value in the procuring country etc. it shall provide such details to all its procuring entities including CMDs/CEOs of PSEs/PSUs, State Governments and other procurement agencies under their administrative control and GeM for appropriate reciprocal action.
 - ii. Entities of countries which have been identified by the nodal Ministry/Department as not allowing Indian companies to participate in their Government procurement for any item related to that nodal Ministry shall not be allowed to participate in Government procurement in India for all the items related to that nodal Ministry/Department, except for the list of items published by the Ministry/Department permitting their participation.
 - iii. The stipulation in (ii) above shall be part of all tenders invited by the Central Government procuring entities stated in (i) above. All purchase on GeM shall also necessarily have the above provisions for items identified by nodal Ministry/Department.
 - iv. State Governments should be encouraged to incorporate similar provisions in their respective tenders.
 - v. The term 'entity' of a country shall have the same meaning as under the FDI Policy of DPIIT as amended from time to time.
 - e. Specifying foreign certification/ unreasonable technical specifications/ brands/ models in the bid document is restrictive and discriminatory practice against local

suppliers. If foreign certification is required to be stipulated because of non-availability of Indian Standards and/ or for any other reason, the same shall be done only after written approval of Secretary of Department concerned or any other authority having been designated such power by the Secretary of the Department concerned.

f. "All administrative Ministries/Departments whose procurement exceeds Rs. 1000 Crore per annum shall notify/ update their procurement projections every year, including those of PSEs/PSUs, for the next 5 years on their respective website."

Annexure-I

SI. No.	Electrical Equipment for Generation, Transmission and Distribution sectors with sufficent local capacity and competition	Class-I Local Supplier (Minimum Loca Content (%)
	(A) Common items for Transmission, Distribution and Generation	Sector
1	Power Transformers (up to 765 kV, including Generator transformers)	60
2	Instrument Transformer (up to 765 kV)	60
3	Transformer Oil Dry Out System (TODOS)	60
4	Reactors up to 765 kV	60
5	Oil Impregnated Bushing (up to 400 kV)	60
6	Resin Insultated Paper (RIP) bushings (up to 145 kV)	50
7	Circuit Breakers (up to 765 kV AC - Alternating Current)	60
8	Disconnectors/Isolators (up to 765 kV AC)	60
9		
	Wave trap (up to 765 kV AC)	60
10	Oil Filled Distribution Transformers up to & Including 33 kV [Cold Rolled Grain Oriented (CRGO)/Amorphous, Aluminium/Copper wound]	60
11	Dry Type Distribution Transformer upto and including 33 kV (CRGO/Amorphous, Aluminium/Copper wound)	60
12	Conventional Conductor	60
13	Accessories for Conventional conductors	60
14	High Temperature/High Temperature Low Sag (HTLS) conductors (such as Composite core, GAP, ACSS, INVAR, AL59) and Accessories	60
15	Optical ground wire (OPGW) – all designs	60
16	Fiber OpticTerminal Equipment (FOTE) for OPGW	50
17	OPGW related Hardware and Accessories	60
18	Remote Terminal Unit (RTU)	50
19	Power Cables and accessories up to 33 kV	60
20	Control cables including accessories	60
21	XLPE Cables up to 220 kV	60
22	Substation Structures	60
23	Transmission Line Towers	60
24	Porcelain (Disc/Long Rod) Insulators	60
25	Bus Post Insulators (Porcelain)	60
26	Porcelain Disc Insulators with Room Temperature Vulcanisation (RTV) coating	50
27	Porcelain Longrod Insulators withRoom Temperature Vulcanisation (RTV) coating	50
28	Hardware Fittings for Porcelain Insulators	60
29	Composite/Polymeric Long Rod Insulators	60
30	Hardware Fittings for Polymer Insulators	60
31	Bird Flight Diverter (BFD)	60
32	Power Line Carrier Communication (PLCC) System (up to 800 kV)	60
33	Gas Insulated Switchgear (up to 400 kV AC)	60
34	Gas Insulated Switchgear (above 400 kV AC)	50
35	Surge/Lightning Arrester (up to 765 kV AC)	60
36	Power Capacitors	60
37	Packaged Sub-station (6.6 kV to 33 kV)	60
38	Ring Main Unit (RMU) (up to 33 kV)	60
39	Medium Voltage (MV) GIS Panels (up to 33 kV)	60
40	Automation and Control System/Supervisory Control and data Acquisition (SCADA) System in Power System	50
41	Control and Relay Panel (including Digital/Numerical Relays)	50
42	Electrical Motors 0.37 kW to 1 MW	60
43	Energy Meters excluding smart meters Control & power cables and Accessories (up to 1.1 kV)	50 60
44		

SI. No.	Electrical Equipment for Generation, Transmission and Distribution sectors with sufficent local capacity and competition	Class-I Local Supplier (Minimum Local Content (%)
46	DC system (DC Battery & Battery Charger)	60
47	AC & DC Distribution Board	60
48	Indoor Air Insulated Switchgear (AIS) upto 33 kV	60
49	Poles (PCC, PSCC, Rolled Steel Joist, Rail Pole, Spun, Steel Tubular)	60
50	Material for Grounding/earthing system	60
51	Illumination system	60
52	Overhead Fault Sensing Indicator (FSI)	50
53	Power Quality Meters	50
54	Auxilliary Relays	50
55	Load Break Switch	50
	(B) Hydro Sector	30
56	Hydro Turbine & Associated equipment	
-	a) Francis Turbine	60
	b) Kaplan Turbine	60
	c) Pelton Turbine	50
57	Main Inlet Valve & Associated Equipment	60
58	Penstock Protection Valve and Associated Equipment	60
59	Governing system & Accessories	60
60	Generator for Hydro Project & Associated Equipment	60
61	Static Excitation System	60
62	Workshop Equipment	60
63	Cooling Water System	60
64	Compressed Air System	60
65		
66	Drainage/Dewatering System	60
	Fire Protection System	60
67	Heating, Ventilation & Air Conditioning System (HVAC)	60
68	Oil Handling System	60
03	Mechanical Balance of Plant (BOP) Items	60
	(C) Thermal Sector Boiler Auxiliaries	
70	Air Pre-Heater	
70		60
	Steam Coil Air Pre Heater (SCAPH)	
		60
72	Steam soot blowers [wall blowers & Long Retractable Soot Blower (LRSB)]	60
	Steam soot blowers [wall blowers & Long Retractable Soot Blower (LRSB)] Auxiliary Steam Pressure Reducing & Desuperheating (PRDS)	
72 73 74	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system	60
72 73	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS)	60
72 73 74	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system	60 60
72 73 74 75	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan	60 60 60 60
72 73 74 75 76 77 78	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks	60 60 60 60
72 73 74 75 76 77 78 79	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints	60 60 60 60 60
72 73 74 75 76 77 78	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills	60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners	60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills	60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill	60 60 60 60 60 60 60 60 50
72 73 74 75 76 77 78 79 80 81 82	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders	60 60 60 60 60 60 60 60 50
72 73 74 75 76 77 78 79 80 81 82 83	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans	60 60 60 60 60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81 82 83 84	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans Forced Draft Fans Induced Draft (FD)/Induced Draft (ID)/ Primary Air (PA) Fan Servo Motor	60 60 60 60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81 82 83 84 85 86	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans Forced Draft Fans Induced Draft (FD)/Induced Draft (ID)/ Primary Air (PA) Fan Servo Motor Assembly	60 60 60 60 60 60 60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81 82 83 84 85 86	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans Forced Draft Fans Induced Draft Fans Forced Draft (FD)/Induced Draft (ID)/ Primary Air (PA) Fan Servo Motor Assembly Tubes (Carbon Steel)	60 60 60 60 60 60 60 60 60 60 60 60 60
72 73 74 75 76 77 78 79 80 81 82 83 84 85 86	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans Forced Draft Fans Induced Draft Fans Forced Draft (FD)/Induced Draft (ID)/ Primary Air (PA) Fan Servo Motor Assembly Tubes (Carbon Steel) Steam pipes (Carbon Steel)	60 60 60 60 60 60 60 60 60 60 60 60 60 50
72 73 74 75 76 77 78 79 80 81 82 83 84 85 86	Auxiliary Steam Pressure Reducing & Desuperheating (PRDS) Fuel oil system Seal air Fan Ducts and dampers Duct expansion joints Blowdown tanks Coal burners and oil burners Coal mills Gear Box of Coal Mill Coal feeders Primary Air Fans Forced Draft Fans Induced Draft Fans Forced Draft (FD)/Induced Draft (ID)/ Primary Air (PA) Fan Servo Motor Assembly Tubes (Carbon Steel)	60 60 60 60 60 60 60 60 60 60 60 60 60

SI. No.	Electrical Equipment for Generation, Transmission and Distribution sectors with sufficent local capacity and competition	Class-I Local Supplier (Minimum Local Content (%)
	Electro-Static Precipitators (ESPs)	
92	Casing	60
93	Electrodes	60
94	Rapping System	60
95	Hopper Heaters	60
96	Transformer Rectifiers	60
97	Insulators	60
	Turbine & Auxiliaries	
98	Turbine (High Pressure/Intermediate Pressure/Low Pressure)	50
99	Condensate Extraction Pumps	60
100	Condenser On line Tube Cleaning System (COLTC)	60
101	Debris filters	60
102	Deaerator	60
103	Drain Cooler and Flash Tank	60
104	ECW Pump	50
105	Plate Heat Exchanger	50
106	Self- cleaning filters	50
107	Condensate Polishing Units (CPUs)	60
108	Chemical Dosing System	60
109	Oil Filter	60
110	Gland Steam Condenser	60
111	Oil Purifying Centrifuge	50
112	Water Cooled Condenser	50
113	Boiler Feed Pumps (BFPs)	50
113	Generator and Auxillieries	50
114		00
114	Generator (including Seal Oil System, Hydrogen Cooling System, Stator water cooling system)	60
	Electrical Works	
115	Control and metering equipment	60
,,,,	Control & Instrumentation System (C&I System)	
116	Thermocouples	50
117	Measuring instruments [Resistance Temperature Detectors (RTDs)], Local	50
	gauges	00
118	Actuators (Pneumatic and conventional electric)	50
119		50
	Coal Handling Plant	
120	Conveyors	60
121	Wagon Tippler	60
122	Side Arm Charger	
123	Paddle feeder	60 60
124	Crushers & Screens	60
125	Dust suppression (dry fog & plain water) system	60
126	Air Compressors	50
127	Magnetic separators & metal detectors	60
128	Coal Sampling System	
129		60
130		60
131	Wheel & axle assembly (without bearings) for Bottom Opening Bottom Release (BOBR) Wagons	60
	Ash Handling System	
132	Clinker grinder	60
133	Water jet ejectors	60
	Scrapper chain conveyor	60
134		60

SI. No.	Electrical Equipment for Generation, Transmission and Distribution sectors with sufficent local capacity and competition	Class-I Local Supplier (Minimum Local Content (%)	
137	Ash water & ash slurry pumps	60	
138	Compressors, air dryers & air receivers	50	
139	Ash water recovery system	60	
	Raw Water Intake & Supply System		
140	Travelling water screens	60	
141	Raw water supply pumps	60	
142	Valves, RE joints etc.	60	
	Water Treatment System and Effluent Treatment System		
143	Clarification plant	60	
144	Filtration plant	60	
145	Ultra filtration plant	50	
146	Reverse Osmosis (RO) plant and its membrane	55	
147	De-Mineralised water plant (DM Plant)	60	
148	Chlorination plant	60	
149	Chemical dosing system	60	
150	Effluent Treatment Plant	60	
	Circulationg Water (CW) & Auxiliary Circulating Water (ACW) System		
151	CW & ACW Pumps	60	
152	Butter Fly (BF) valves, Non-return Valves (NRVs) etc.	60	
153	Rubber Expansion (RE) joints	60	
154	Air release valves	60	
	Cooling Towers (NDCT/ IDCT)-Natural-Draft and Induced Draft Cooling Tower		
155	Water Distribution System	60	
156	Spray nozzles	60	
157	Packing	60	
158	Drift eliminators	60	
159	Cooling Tower (CT) Fans (for Induced Draft Cooling Towers IDCT)	60	
160	Gear boxes, shafts & motors (for IDCT)	60	
	Air Conditioning & Ventilation System		
161	Split & window air conditioners	60	
162	Chilling/ condensing unit [upto 500 ton of refrigeration(TR)]	55	
163	Air Handling Unit (AHU) and Fresh air unit	60	
164		60	
165	Air Washing Units (AWUs), axial fans, roof extractors	60	
166	Ducts, louvers & dampers	60	
	Flue Gas Desulphurization (FGD)		
167	Spray Nozzles,	50	
168	Spray header	50	
169	Oxidation Blowers	50	
170	Limestone wet Ball Mill	50	
171		50	
172		50	
173		60	
174		60	
175		50	
	(D) Other Common Items		
	Fire protection and detection system		
176		60	
177		60	
178		60	
179		60	
180		60	
181	and the second contract of the second contrac	60	
182	Inert gas flooding system	60	

SI. No.	Electrical Equipment for Generation, Transmission and Distribution sectors with sufficent local capacity and competition	Class-I Local Supplier (Minimum Local Content (%)	
183	Fire tenders	60	
184	Portable fire-extinguishers	60	
185	Cranes, EOT cranes, gantry crane & chain pulley blocks etc.	60	
186	Elevator	60	

(E) Minimum Local Content percentages in Engineering, Procurement & Construction (EPC) / Turnkey project

In case the contract is awarded through the EPC route, the contractor should comply with the requirement of MLC for individual items as listed in Annexure-I and should purchase these items only from Class-I Local supplier. In addition, MLC for complete EPC project may also be prescribed as below:

	(1) Package Based Works	Minimum Local Content (%)
1	Boiler	60
2	TG System (Water Cooled Condenser)	60
3	Ash Handling Plant	60
4	Coal Handling Plant	60
5	Electro-static Precipitator (ESP)	60
6	Circulating Water (CW) System	60
7	Cooling Tower	60
8	Water Treatment System	60
9	Air Conditioning System (below 500TR)	60
10	Flue Gas Desusphurisation (FGD) System	60
11	Station Control & Instrumentation (C&I)	50
12	Hydro Power Projects (Electro-Mechanical Works)	60
	Gas based generation	
	Overall Gas Turbine Package (on finished Product basis)	
13	< 44 MW	60
14	44 –145 MW	50
	Overall Combined Cycle Gas Turbine (CCGT) Package (on finished Product basis)	
15	< 44 MW	60
16	44 – 145 MW	60
17	> 150 MW	60
	(2) Project as a whole	1
1	Works and service contracts in Power Sector	60
2	Transmission Line with Conventional conductors (ACSR, AAAC, AL-59 etc.)	60
3	Transmission Line with High temperature Low Sag (HTLS) conductors	60
4	HVAC Substation Air Insulated (AIS)	60
5	HVAC Substation Gas Insulated (GIS)	60
6	HVDC Substation	60
7	Distribution Sector	60

Annexure-II

General guidelines to be adopted selectively in an appropriate manner by the procuring entities in their tender documents.

- The bidder shall have to be an entity registered in India in accordance with law.
- The bids shall be in the language as prescribed by the tenderer/procurer.
- 3. The bids shall be in Indian Rupees (INR) (in respect of local content only).
- Indian subsidiaries of foreign bidders shall have to meet the qualifying criteria in terms of capability, competency, financial position, past performance etc.
- 5. The bidder shall follow Indian laws, regulations and standards.
- To be eligible for participation in the bid, foreign bidders shall compulsorily set up their manufacturing units on a long term basis in India as may be specified by the tenderer/ procurer.
- Similar or better technology than the technology offered in respect of material, equipment and process involved shall be transferred to India. Along with the transfer of technology, adequate training in the respective field shall also be provided.
- 8. Country of origin of the equipment/material shall be provided in the bid.
- For supply of equipment / material from the country of origin other than India, the bidder shall submit performance certificate in support of satisfactory operation in India or a country other than the country of origin having climatic and operational conditions including ambient temperature similar to that of India for more than years (to be specified by the procurer).
- 10. The technologies/ products offered shall be environmental friendly, consuming less energy, safe, energy efficient, durable and long lasting under the prescribed operational conditions.
- 11. The supplier shall ensure supply of spares, materials and technological support for the entire life of the project.
- 12. The manufacturers/ supplier shall list out the products and components producing Toxic E-waste and other waste as may be specified. It shall have an Extended Producers Responsibility (EPR) so that after the completion of the lifecycle, the materials are safely recycled / disposed of by the Manufacturer/ supplier and for this, the Manufacturer/supplier along with procurer has to establish recycling / disposal unit or as may be specified.
- 13. Minimum Local Content requirement for goods, services or works shall be in accordance with the conditions laid down in respective Order(s) of the sectors on Public Procurement (Preference to Make in India) to provide for purchase preference (linked with local content).

- 14. The equipment/ material sourced from foreign companies may be tested in accredited labs in India before acceptance wherever such facilities are available.
- 15. The Tender fee and the Bank Guarantee (BG) shall be in Indian Rupees only.
- 16. The bidder shall have to furnish a certificate regarding cyber security/safety of the equipment/process to be supplied/services to be rendered as safe to connect.
- Applicable safety requirements shall be met. Regular safety audit shall be carried out by the manufacturer/ supplier.
- 18. Statutory laws/regulations including the labour and environmental laws shall be strictly complied with during supply, storage, erection, commissioning and operation process. A regular compliance report shall be submitted to the procurer/appropriate Authorities.
- Formation of new joint venture in India shall be permitted only with the Indian companies.
- 20. Tendering by the agent shall not be accepted.
- 21. In case local testing is not considered necessary by the procurer, theoriginal test report in the language prescribed by the procurer may be accepted. The translated test report shall not be accepted unless it is notarised.
- Certification/compliance as per the Indian Standards/ International Standards/ Indian Regulations/ specified Standards shall be mandatory, where ever applicable.
- 23. Quality assurance of the product shall be carried out by the procurer or an independent third party agency appointed by the procurer. Manufacturing Quality Plan as approved by the procurer shall be followed by the manufacturer/supplier.
- 24. Wherever required by the procurer, foreign supplier shall establish fully functional service centers in India and shall keep spares/material locally for future needs of utilities.
- 25. Arbitration proceedings shall be instituted in India only and all disputes shall be settled as per applicable Indian Laws.

No. P-45021/2/2017-PP (BE-II)

Government of India

Ministry of Commerce and Industry

Department for Promotion of Industry and Internal Trade (Public Procurement Section)

Udyog Bhawan, New Delhi Dated: 16th September, 2020

<u>To</u>

All Central Ministries/Departments/CPSUs/All concerned

ORDER

Subject: Public Procurement (Preference to Make in India), Order 2017– Revision; regarding.

Department for Promotion of Industry and Internal Trade, in partial modification [Paras 2, 3, 5, 10 & 13] of Order No.P-45021/2/2017-B.E.-II dated 15.6.2017 as amended by Order No.P-45021/2/2017-B.E.-II dated 28.05.2018, Order No.P-45021/2/2017-B.E.-II dated 29.05.2019 and Order No.P-45021/2/2017-B.E.-II dated 04.06.2020, hereby issues the revised 'Public Procurement (Preference to Make in India), Order 2017" dated 16.09.2020 effective with immediate effect.

Whereas it is the policy of the Government of India to encourage 'Make in India' and promote manufacturing and production of goods and services in India with a view to enhancing income and employment, and

Whereas procurement by the Government is substantial in amount and can contribute towards this policy objective, and

Whereas local content can be increased through partnerships, cooperation with local companies, establishing production units in India or Joint Ventures (JV) with Indian suppliers, increasing the participation of local employees in services and training them,

Now therefore the following Order is issued:

- 1. This Order is issued pursuant to Rule 153 (iii) of the General Financial Rules 2017.
- Definitions: For the purposes of this Order:

'Local content' means the amount of value added in India which shall, unless otherwise prescribed by the Nodal Ministry, be the total value of the item produced (excluding net domestic indirect taxes) minus the value of imported content in the item (including all customs duties) as a proportion of the total value, in percent.

'Class-I local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, meets the minimum local content as prescribed for 'Class-I local supplier' under this Order.

.....Contd. p/2

'Class-II local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, meets the minimum local content as prescribed for 'Class-II local supplier' but less than that prescribed for 'Class-I local supplier' under this Order.

'Non - Local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, has local content less than that prescribed for 'Class-II local supplier' under this Order.

"L1" means the lowest tender or lowest bid or the lowest quotation received in a tender, bidding process or other procurement solicitation as adjudged in the evaluation process as per the tender or other procurement solicitation.

'Margin of purchase preference' means the maximum extent to which the price quoted by a "Class-I local supplier" may be above the £1 for the purpose of purchase preference.

'Nodal Ministry' means the Ministry or Department identified pursuant to this order in respect of a particular item of goods or services or works.

'Procuring entity' means a Ministry or department or attached or subordinate office of, or autonomous body controlled by, the Government of India and includes Government companies as defined in the Companies Act.

'Works' means all works as per Rule 130 of GFR- 2017, and will also include 'turnkey works'.

3. Eligibility of 'Class-Hocal supplier'/ 'Class-H local supplier'/ 'Non-local suppliers' for different types of procurement

- (a) In procurement of all goods, services or works in respect of which the Nodal Ministry / Department has communicated that there is sufficient local capacity and local competition, only 'Class-Hocal supplier', as defined under the Order, shall be eligible to bid irrespective of purchase value.
- (b) Only 'Class-I local supplier' and 'Class-II local supplier', as defined under the Order, shall be eligible to bid in procurements undertaken by procuring entities, except when Global tender enquiry has been issued. In global tender enquiries, 'Non-local suppliers' shall also be eligible to bid along with 'Class-II local suppliers' and 'Class-II local suppliers'. In procurement of all goods, services or works, not covered by subpara 3(a) above, and with estimated value of purchases less than Rs. 200 Crore, in accordance with Rule 161(iv) of GFR, 2017, Global tender enquiry shall not be issued except with the approval of competent authority as designated by Department of Expenditure.
- (c) For the purpose of this Order, works includes Engineering, Procurement and Construction (EPC) contracts and services include System Integrator (SI) contracts.

3A. Purchase Preference

- (a) Subject to the provisions of this Order and to any specific instructions issued by the Nodal Ministry or in pursuance of this Order, purchase preference shall be given to 'Class-I local supplier' in procurements undertaken by procuring entities in the manner specified here under.
- (b) In the procurements of goods or works, which are covered by para 3(b) above and which are divisible in nature, the 'Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
 - Among all qualified bids, the lowest bid will be termed as L1. If L1 is 'Class-I local supplier', the contract for full quantity will be awarded to L1.
 - ii. If L1 bid is not a 'Class-I local supplier', 50% of the order quantity shall be awarded to L1. Thereafter, the lowest bidder among the 'Class-I local supplier' will be invited to match the L1 price for the remaining 50% quantity subject to the Class-I local supplier's quoted price falling within the margin of purchase preference, and contract for that quantity shall be awarded to such 'Class-I local supplier' subject to matching the L1 price. In case such lowest eligible 'Class-I local supplier' fails to match the L1 price or accepts less than the offered quantity, the next higher 'Class-I local supplier' within the margin of purchase preference shall be invited to match the L1 price for remaining quantity and so on, and contract shall be awarded accordingly. In case some quantity may also be ordered on Class-I local suppliers, then such balance quantity may also be ordered on the L1 bidder.
- (c) In the procurements of goods or works, which are covered by para 3(b) above and which are not divisible in nature, and in procurement of services where the bid is evaluated on price alone, the 'Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
 - Among all qualified bids, the lowest bid will be termed as L1. If L1 is 'Class-local supplier', the contract will be awarded to L1.
 - ii. If L1 is not 'Class-I local supplier', the lowest bidder among the 'Class-I local supplier', will be invited to match the L1 price subject to Class-I local supplier's quoted price falling within the margin of purchase preference, and the contract shall be awarded to such 'Class-I local supplier' subject to matching the L1 price.
 - iii. In case such lowest eligible 'Class-I local supplier' fails to match the L1 price, the 'Class-I local supplier' with the next higher bid within the margin of purchase preference shall be invited to match the L1 price and so on and contract shall be awarded accordingly. In case none of the 'Class-I local supplier' within the margin of purchase preference matches the L1 price, the contract may be awarded to the L1 bidder.

- (d) "Class-If local supplier" will not get purchase preference in any procurement, undertaken by procuring entities
- **3B.** Applicability in tenders where contract is to be awarded to multiple bidders In tenders where contract is awarded to multiple bidders subject to matching of L1 rates or otherwise, the 'Class-I local supplier' shall get purchase preference over 'Class-II local supplier' as well as 'Non-local supplier', as per following procedure:
 - a) In case there is sufficient local capacity and competition for the item to be produced, as notified by the nodal Ministry, only Class I local suppliers shall be eligible to bid. As such, the multiple suppliers, who would be awarded the contract, should be all and only 'Class I Local suppliers'.
 - b) In other cases, 'Class II local suppliers' and 'Non local suppliers' may also participate in the bidding process along with 'Class I Local suppliers' as per provisions of this Order.
 - c) If 'Class I Local suppliers' qualify for award of contract for at least 50% of the tendered quantity in any tender, the contract may be awarded to all the qualified bidders as per award criteria stipulated in the bid documents. However, in case 'Class I Local suppliers' do not qualify for award of contract for at least 50% of the tendered quantity, purchase preference should be given to the 'Class I local supplier' over 'Class I local suppliers' 'Non local suppliers' provided that their quoted rate falls within 20% margin of purchase preference of the highest quoted bidder considered for award of contract so as to ensure that the 'Class I Local suppliers' taken in totality are considered for award of contract for at least 50% of the tendered quantity.
 - d) First purchase preference has to be given to the lowest quoting 'Class-I local supplier', whose quoted rates fall within 20% margin of purchase preference, subject to its meeting the prescribed criteria for award of contract as also the constraint of maximum quantity that can be sourced from any single supplier. If the lowest quoting 'Class-I local supplier', does not qualify for purchase preference because of aforesaid constraints or does not accept the offered quantity, an opportunity may be given to next higher 'Class-I local supplier', falling within 20% margin of purchase preference, and so on.
 - e) To avoid any ambiguity during bid evaluation process, the procuring entities may stipulate its own tender specific criteria for award of contract amongst different bidders including the procedure for purchase preference to 'Class-I local supplier' within the broad policy guidelines stipulated in sub-paras above.
- 4. Exemption of small purchases: Notwithstanding anything contained in paragraph 3, procurements where the estimated value to be procured is less than Rs. 5 lakhs shall be exempt from this Order. However, it shall be ensured by procuring entities that procurement is not split for the purpose of avoiding the provisions of this Order.
- Minimum local content: The 'local content' requirement to categorize a supplier as 'Class-I local supplier' is minimum 50%. For 'Class-II local supplier', the 'local content' requirement is minimum 20%. Nodal Ministry/ Department may prescribe only a higher

percentage of minimum local content requirement to categorize a supplier as 'Class-local supplier'/ 'Class-II local supplier'. For the items, for which Nodal Ministry/ Department has not prescribed higher minimum local content notification under the Order, it shall be 50% and 20% for 'Class-II local supplier'/ 'Class-II local supplier' respectively.

- 6. Margin of Purchase Preference: The margin of purchase preference shall be 20%.
- 7. Requirement for specification in advance: The minimum local content, the margin of purchase preference and the procedure for preference to Make in India shall be specified in the notice inviting tenders or other form of procurement solicitation and shall not be varied during a particular procurement transaction.
- 8. Government E-marketplace: In respect of procurement through the Government E-marketplace (GeM) shall, as far as possible, specifically mark the items which meet the minimum local content while registering the item for display, and shall, wherever feasible, make provision for automated comparison with purchase preference and without purchase preference and for obtaining consent of the local supplier in those cases where purchase preference is to be exercised.

Verification of local content;

- a. The 'Class-I local supplier'/ 'Class-II local supplier' at the time of tender, bidding or solicitation shall be required to indicate percentage of local content and provide self-certification that the item offered meets the local content requirement for 'Class-I local supplier'/ 'Class-II local supplier', as the case may be. They shall also give details of the location(s) at which the local value addition is made.
- b. In cases of procurement for a value in excess of Rs. 10 crores, the 'Class-I local supplier' local supplier' shall be required to provide a certificate from the statutory auditor or cost auditor of the company (in the case of companies) or from a practicing cost accountant or practicing chartered accountant (in respect of suppliers other than companies) giving the percentage of local content.
- c. Decisions on complaints relating to implementation of this Order shall be taken by the competent authority which is empowered to look into procurement-related complaints relating to the procuring entity.
- d. Nodal Ministries may constitute committees with internal and external experts for independent verification of self-declarations and auditor's/ accountant's certificates on random basis and in the case of complaints.
- e. Nodal Ministries and procuring entities may prescribe fees for such complaints.
- f. False declarations will be in breach of the Code of Integrity under Rule 175(1)(i)(h) of the General Financial Rules for which a bidder or its successors can be debarred for up to two years as per Rule 151 (iii) of the General Financial Rules along with such other actions as may be permissible under law.

- g. A supplier who has been debarred by any procuring entity for violation of this Order shall not be eligible for preference under this Order for procurement by any other procuring entity for the duration of the debarment. The debarment for such other procuring entities shall take effect prospectively from the date on which it comes to the notice of other procurement entities, in the manner prescribed under paragraph 9h below.
- h. The Department of Expenditure shall issue suitable instructions for the effective and smooth operation of this process, so that:
 - The fact and duration of debarment for violation of this Order by any procuring entity are promptly brought to the notice of the Member-Convenor of the Standing Committee and the Department of Expenditure through the concerned Ministry / Department or in some other manner;
 - ii. on a periodical basis such cases are consolidated and a centralized fist or decentralized lists of such suppliers with the period of debarment is maintained and displayed on website(s);
 - iii. in respect of procuring entities other than the one which has carried out the debarment, the debarment takes effect prospectively from the date of uploading on the website(s) in the such a manner that ongoing procurements are not disrupted.

10. Specifications in Tenders and other procurement solicitations:

- a. Every produring entity shall ensure that the eligibility conditions in respect of previous experience fixed in any tender or solicitation do not require proof of supply in other countries or proof of exports.
- b. Procuring entities shall endeavour to see that eligibility conditions, including on matters like turnover, production capability and financial strength do not result in unreasonable exclusion of 'Class-I local supplier'/ 'Class-II local supplier' who would otherwise be eligible, beyond what is essential for ensuring quality or creditworthiness of the supplier.
- c. Procuring entities shall, within 2 months of the issue of this Order review all existing eligibility norms and conditions with reference to sub-paragraphs 'a' and 'b' above.

d. Reciprocity Clause

i. When a Nodal Ministry/Department identifies that Indian suppliers of an item are not allowed to participate and/ or compete in procurement by any foreign government, due to restrictive tender conditions which have direct or indirect effect of barring Indian companies such as registration in the procuring country, execution of projects of specific value in the procuring country etc., it shall provide such details to all its procuring entities including CMDs/CEOs of PSEs/PSUs, State Governments and other procurement agencies under their administrative control and GeM for appropriate reciprocal action.

- ii. Entities of countries which have been identified by the nodal Ministry/Department as not allowing Indian companies to participate in their Government procurement for any item related to that nodal Ministry shall not be allowed to participate in Government procurement in India for all items related to that nodal Ministry/ Department, except for the list of items published by the Ministry/ Department permitting their participation.
- iii. The stipulation in (ii) above shall be part of all tenders invited by the Central Government procuring entities stated in (i) above. All purchases on GeM shall also necessarily have the above provisions for items identified by nodal Ministry/ Department.
- State Governments should be encouraged to incorporate similar provisions in their respective tenders.
- v. The term 'entity' of a country shall have the same meaning as under the FDI Policy of DPIIT as amended from time to time.
- e. Specifying foreign certifications/ unreasonable technical specifications/ brands/ models in the bid document is restrictive and discriminatory practice against local suppliers. If foreign certification is required to be stipulated because of nonavailability of Indian Standards and/or for any other reason, the same shall be done only after written approval of Secretary of the Department concerned or any other Authority having been designated such power by the Secretary of the Department concerned.
- f. "All administrative Ministries/Departments whose procurement exceeds Rs. 1000 Crore per annum shall notify/ update their procurement projections every year, including those of the PSEs/PSUs, for the next 5 years on their respective website."
- 10A. Action for non-compliance of the Provisions of the Order: In case restrictive or discriminatory conditions against domestic suppliers are included in bid documents, an inquiry shall be conducted by the Administrative Department undertaking the procurement (including procurement by any entity under its administrative control) to fix responsibility for the same. Thereafter, appropriate action, administrative or otherwise, shall be taken against erring officials of procurement entities under relevant provisions. Intimation on all such actions shall be sent to the Standing Committee.
- 11. Assessment of supply base by Nodal Ministries: The Nodal Ministry shall keep in view the domestic manufacturing / supply base and assess the available capacity and the extent of local competition while identifying items and prescribing the higher minimum local content or the manner of its calculation, with a view to avoiding cost increase from the operation of this Order.
- 12. Increase in minimum local content: The Nodal Ministry may annually review the local content requirements with a view to increasing them, subject to availability of sufficient local competition with adequate quality.

- 13 Manufacture under license/ technology collaboration agreements with phased indigenization: While notifying the minimum local content, Nodal Ministries may make special provisions for exempting suppliers from meeting the stipulated local content if the product is being manufactured in India under a license from a foreign manufacturer who holds intellectual property rights and where there is a technology collaboration agreement / transfer of technology agreement for indigenous manufacture of a product developed abroad with clear phasing of increase in local content.
- 13A. In procurement of all goods, services or works in respect of which there is substantial quantity of public procurement and for which the nodal ministry has not notified that there is sufficient local capacity and local competition, the concerned nodal ministry shall notify an upper threshold value of procurement beyond which foreign companies shall enter into a joint venture with an Indian company to participate in the tender. Procuring entities, while procuring such items beyond the notified threshold value, shall prescribe in their respective tenders that foreign companies may enter into a joint venture with an Indian company to participate in the tender. The procuring Ministries/Departments shall also make special provisions for exempting such joint ventures from meeting the stipulated minimum local content requirement, which shall be increased in a phased manner.
- 14. Powers to grant exemption and to reduce minimum local content: The administrative Department undertaking the procurement (including procurement by any entity under its administrative control), with the approval of their Minister-in-charge, may by written order, for reasons to be recorded in writing,
 - a. reduce the minimum local content below the prescribed level; or
 - b. reduce the margin of purchase preference below 20%; or
 - exempt any particular item or supplying entities from the operation of this
 Order or any part of the Order.

A copy of every such order shall be provided to the Standing Committee and concerned Nodal Ministry / Department. The Nodal Ministry / Department concerned will continue to have the power to vary its notification on Minimum Local Content.

- 15. Directions to Government companies: In respect of Government companies and other produring entities not governed by the General Financial Rules, the administrative Ministry or Department shall issue policy directions requiring compliance with this Order.
- Standing Committee: A standing committee is hereby constituted with the following membership.

Secretary, Department for Promotion of Industry and Internal Trade—Chairman Secretary, Commerce—Member Secretary, Ministry of Electronics and Information Technology—Member Joint Secretary (Public Procurement), Department of Expenditure—Member Joint Secretary (DPIIT)—Member-Convenor

The Secretary of the Department concerned with a particular item shall be a member in respect of issues relating to such item. The Chairman of the Committee may co-opt technical expects as relevant to any issue or class of issues under its consideration.

- 17. Functions of the Standing Committee: The Standing Committee shall meet as often as necessary, but not less than once in six months. The Committee
 - a. shall oversee the implementation of this order and issues arising therefrom, and make recommendations to Nodal Ministries and produring entities.
 - b. shall annually assess and periodically monitor compliance with this Order
 - shall identify Nodal Ministries and the allocation of items among them for issue of notifications on minimum local content
 - d. may require furnishing of details or returns regarding compliance with this Order and related matters
 - e. may, during the annual review or otherwise, assess issues, if any, where it is felt that the manner of implementation of the order results in any restrictive practices, cartelization or increase in public expenditure and suggest remedial measures
 - f. may examine cases covered by paragraph 13 above relating to manufacture under license/ technology transfer agreements with a view to satisfying itself that adequate mechanisms exist for enforcement of such agreements and for attaining the underlying objective of progressive indigenization
 - g. may consider any other issue relating to this Order which may arise.
- 18. Removal of difficulties: Ministries /Departments and the Boards of Directors of Government companies may issue such clarifications and instructions as may be necessary for the removal of any difficulties arising in the implementation of this Order.
- 19. **Ministries having existing policies**: Where any Ministry or Department has its own policy for preference to local content approved by the Cabinet after 1st January 2015, such policies will prevail over the provisions of this Order. All other existing orders on preference to local content shall be reviewed by the Nodal Ministries and revised as needed to conform to this Order, within two months of the issue of this Order.
- 20. Transitional provision: This Order shall not apply to any tender or procurement for which notice inviting tender or other form of procurement solicitation has been issued before the issue of this Order

(jesh Gupta) Director

Tel: 23063211

rajesh.gupta66@gov.in



A BHARAT HEAVY ELECTRICALS LIMITED TRANSMISSION BUSINESSS GROUP MATERIAL RECEIPT CERTIFICATE

Site:									
Invoice	e no.:								
- 1		1 _		Τ					
S.no.	Item Description	Type of Packages	(MT/KM/	Qty as per packing list	Qty Received	Remarks			
			NO.)						
her Rer	marks: Materials subj	ect to physic	cal verification	on.					
	•								
nature	with date:								
me & D	esignation:								
ith Seal)								
	Invoice LR No. Vehicle Date o Supplie Mater S.no.	Invoice no.: LR No. with date: Vehicle no.: Date of receipt of material Supplier: Material details (as mention S.no. Item Description ther Remarks: Materials subjection	Invoice no.: LR No. with date: Vehicle no.: Date of receipt of material at site: Supplier: Material details (as mentioned below): S.no. Item Description Type of Packages ther Remarks: Materials subject to physical mature with date: me & Designation:	Invoice no.: LR No. with date: Vehicle no.: Date of receipt of material at site: Supplier: Material details (as mentioned below): S.no. Item Description Type of Packages (MT/KM/NO.) There Remarks: Materials subject to physical verification in the package of the physical verification in the physical verification in the package of the physical verification in the	Invoice no.: LR No. with date: Vehicle no.: Date of receipt of material at site: Supplier: Material details (as mentioned below): S.no. Item Description Type of Packages (MT/KM/ NO.) Packing list where Remarks: Materials subject to physical verification. There with date:	Invoice no.: LR No. with date: Vehicle no.: Date of receipt of material at site: Supplier: Material details (as mentioned below): S.no. Item Description Type of Packages (MT/KM/NO.) Received NO.) There Remarks: Materials subject to physical verification.			

INSPECTION REQUEST

1.	Name & Address of Supplier	:
2.	Project	:
3.	Purchase Order No., Revision No. & Date	:

4. Details of equipment / Material to be Inspected

SI. No.	Material offered for Inspection	P.O. Item No.	Total Quantity Ordered	Quantity offered for Inspection	Quantity Already Cleared	P.O. value of offered qty.
					_	

 For structure, whether BOM & Proto Corrected Drawings approved and available at place of inspection : Yes / No

6. Whether GTP/Drgs approved in Category – 1 available at place of inspection

: Yes / No

7. Whether Quality Plan approved in Category – 1 available at place of inspection

: Yes / No.

8. Whether all type tests approved by Engineering

:Yes / No

12. Working Hours:

9. (a) Place of Inspection & Address

9. (b) Name & contact No. of Supplier rep. for inspection

9. (b) Name & contact No. of Supplier rep. for inspection

10. Sub - supplier contact person's name & contact No.

11. Weekly off day :

13. Date on which inspection requested (Inspection call to be raised at least 7 days prior to inspection):

14. No of road permits required

It is certified that the above materials shall be completed in all respects and shall have been inspected by us before the date indicated above for inspection. You are requested to please depute your representative for inspection

Signature
Name :
Contact No. :
Date :

Distribution:

1. Material Management, BHEL, New Delhi

Note:

1. Unsigned inspection request & Inspection requests not given in this format are not accepted.

2. Drawings, Quality Plan should be approved in category – I by BHEL Transmission Business Engineering Management before the inspection date. In case inspection request is given without Category – I approved documents, supplier should be obtain from BHEL Transmission Business Engineering Management in writing to this effect and attach to inspection request.