




VIEW-A

NOTE:

1. ALL NUTS,BOLTS AND WASHERS SHALL BE GALVANISED AS PER SPECIFICATION.


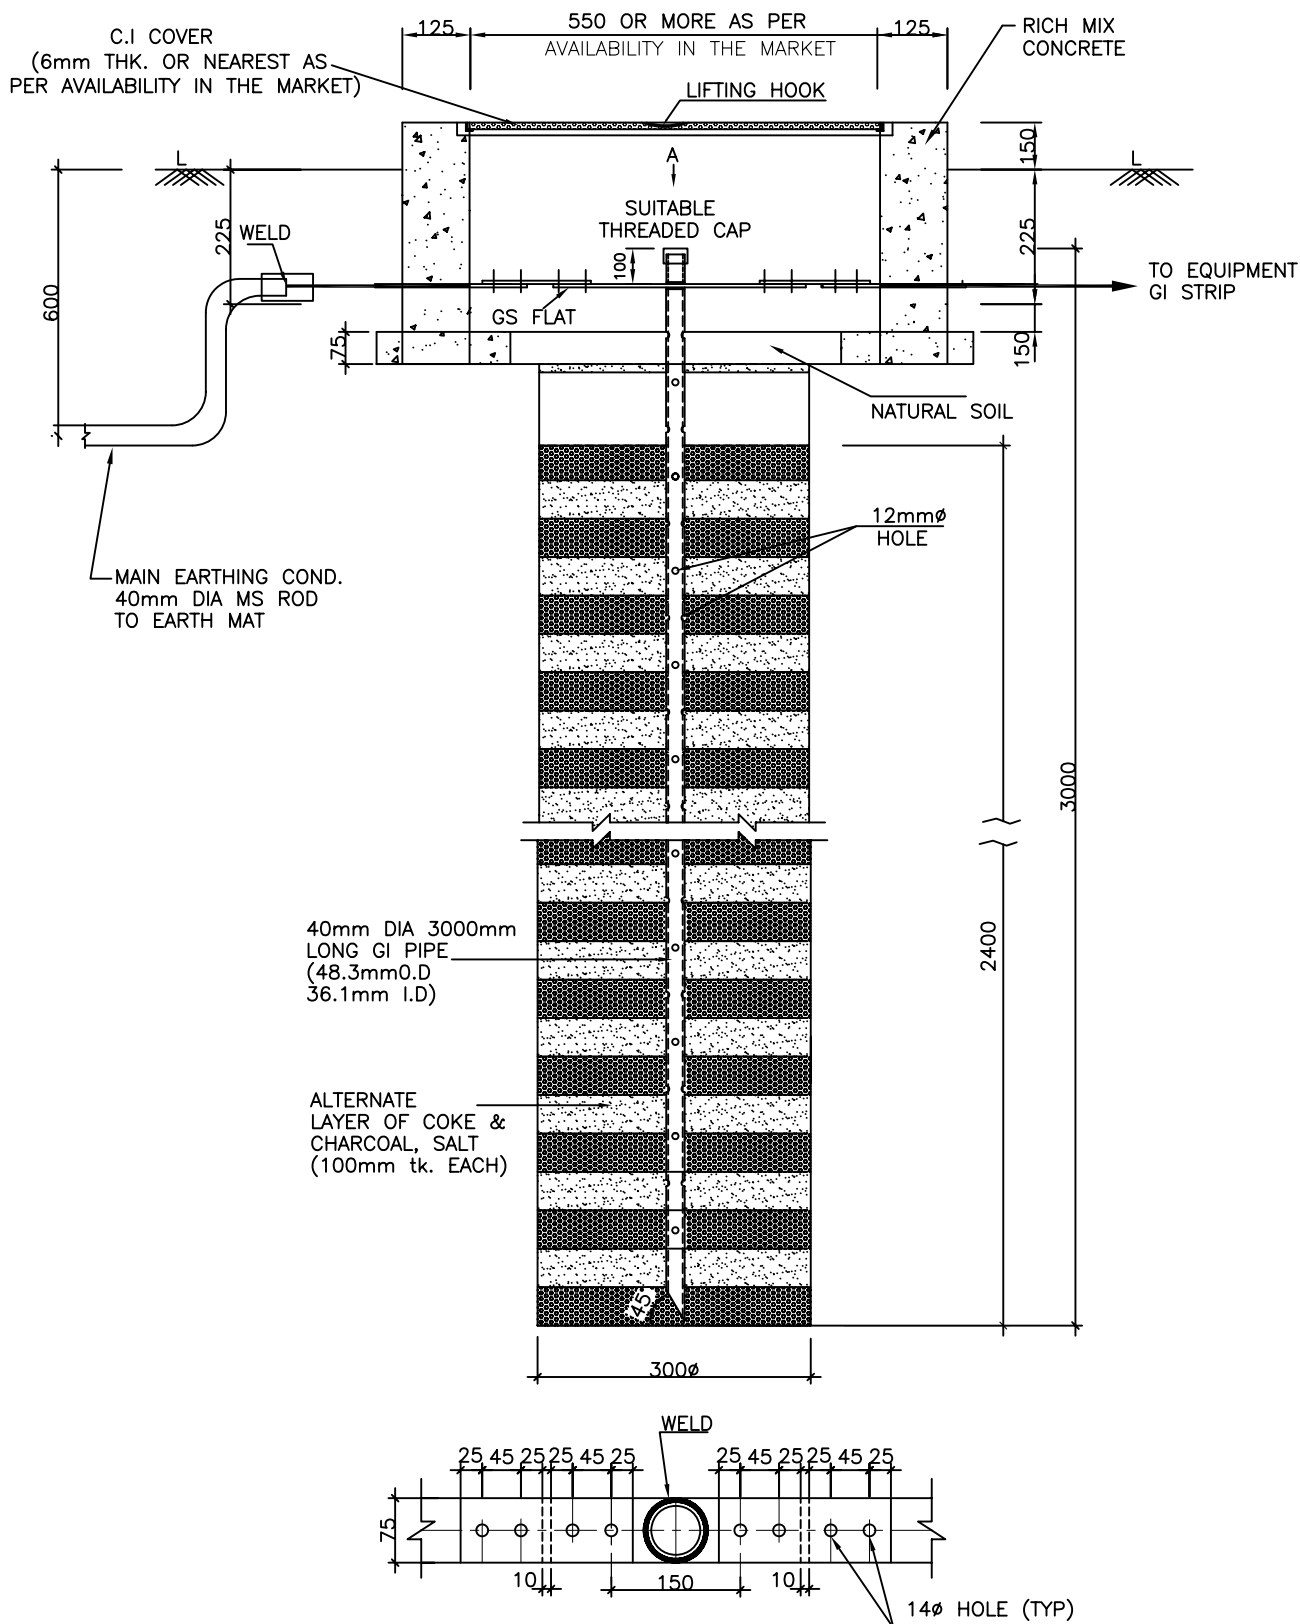


EQUIPMENT EARTHING DETAILS
DETAILS OF PIPE EARTH ELECTRODE
IN TREATED EARTH PIT (ET)

COMPUTERREF.NO.

DRG. No.

TB-4-342-316-PIPE ELECTRODE

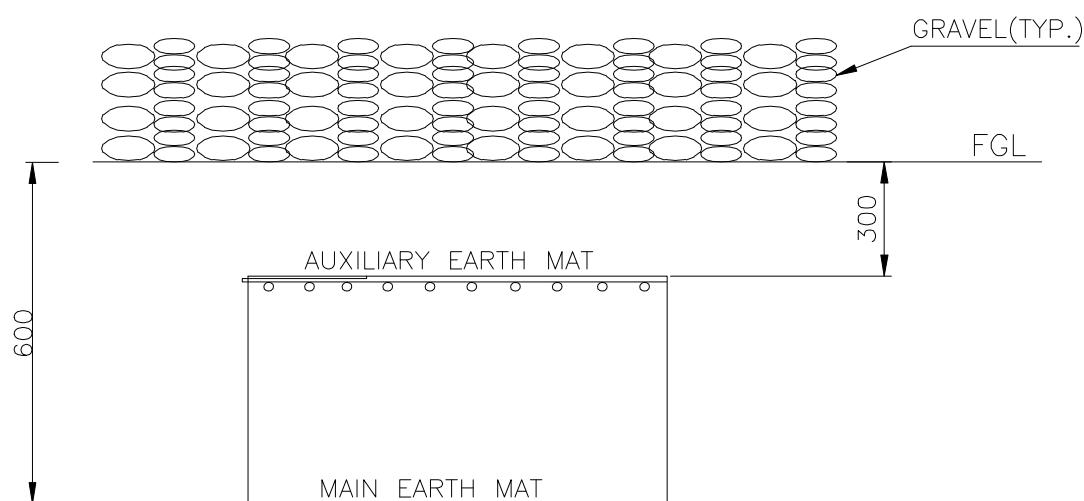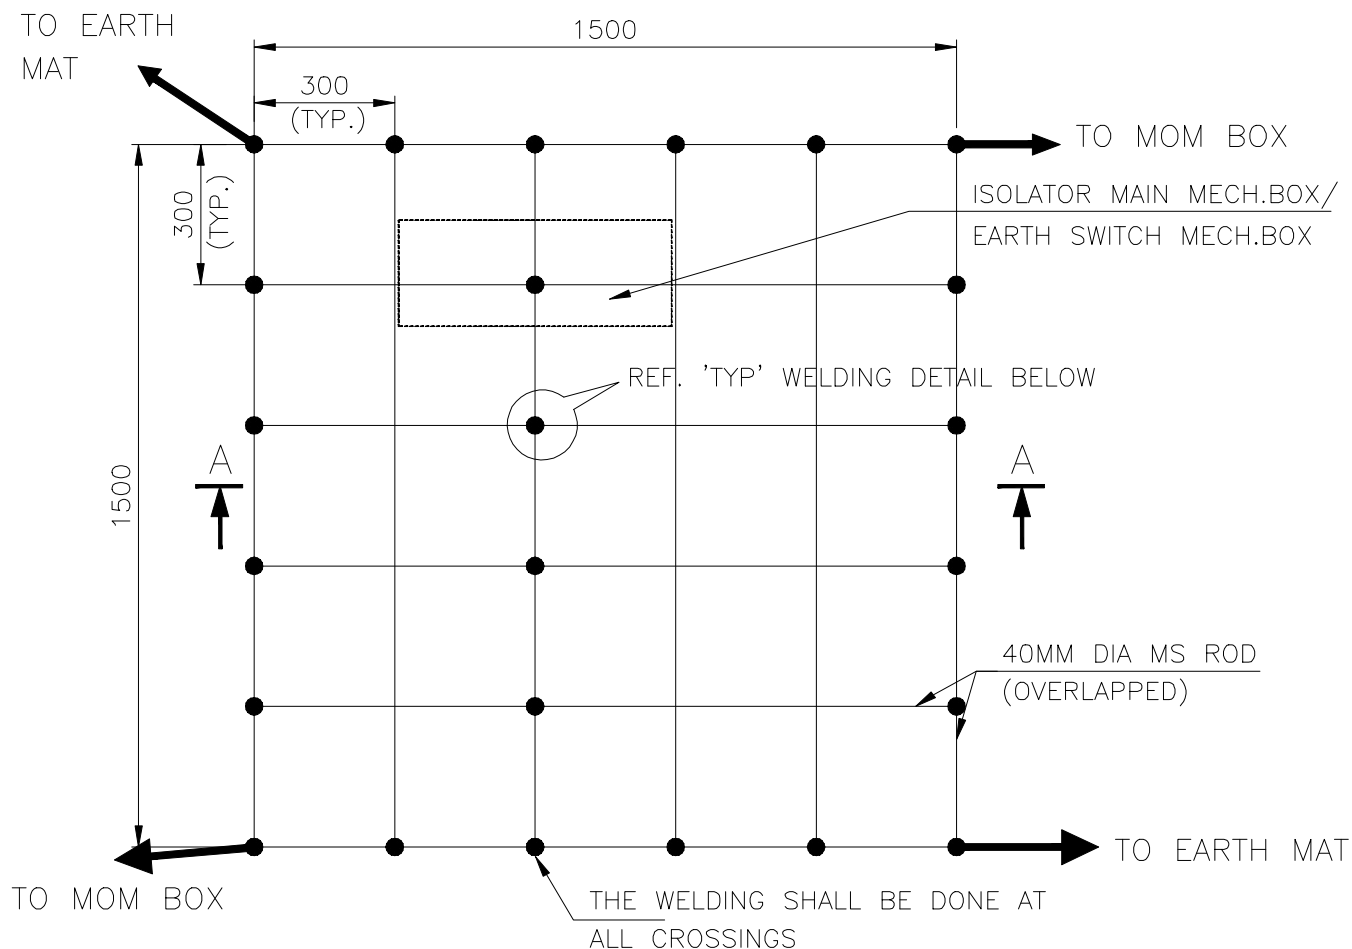

SECTION AA

NOTE:

AUX. EARTH MAT SHALL BE SO POSITIONED THAT THE FOOT OF THE OPERATOR ALWAYS LIE OVER THE AUX. EARTH MAT AREA WHILE ATTENDING / OPERATING THE MECH. BOX THE CABLE TRENCH ROUTING SHALL BE PLANNED ACCORDINGLY.



COMPU. DRG. REF.

EQUIPMENT EARTHING DETAILS


AUXILIARY EARTH MAT FOR ISOLATOR MAIN MECH., E/S MECH. BOX

Report No.


TB-XXX-316-AUX_MAT

SHEET No.

14

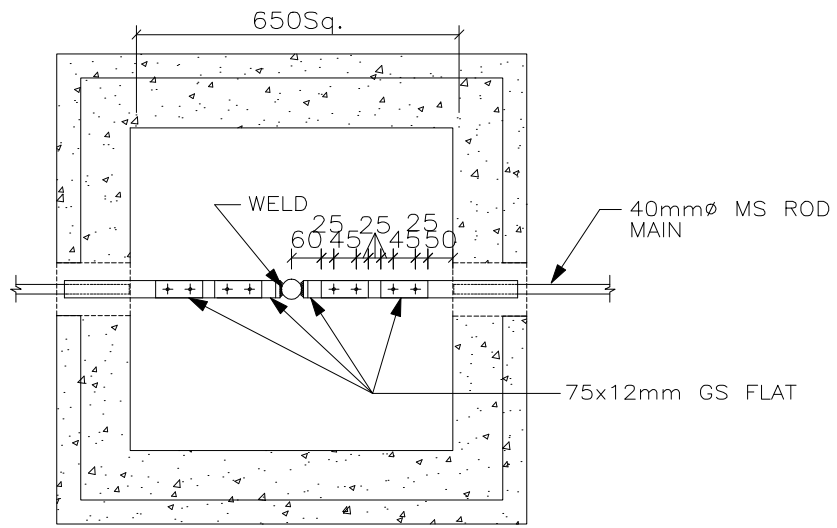

PLAN

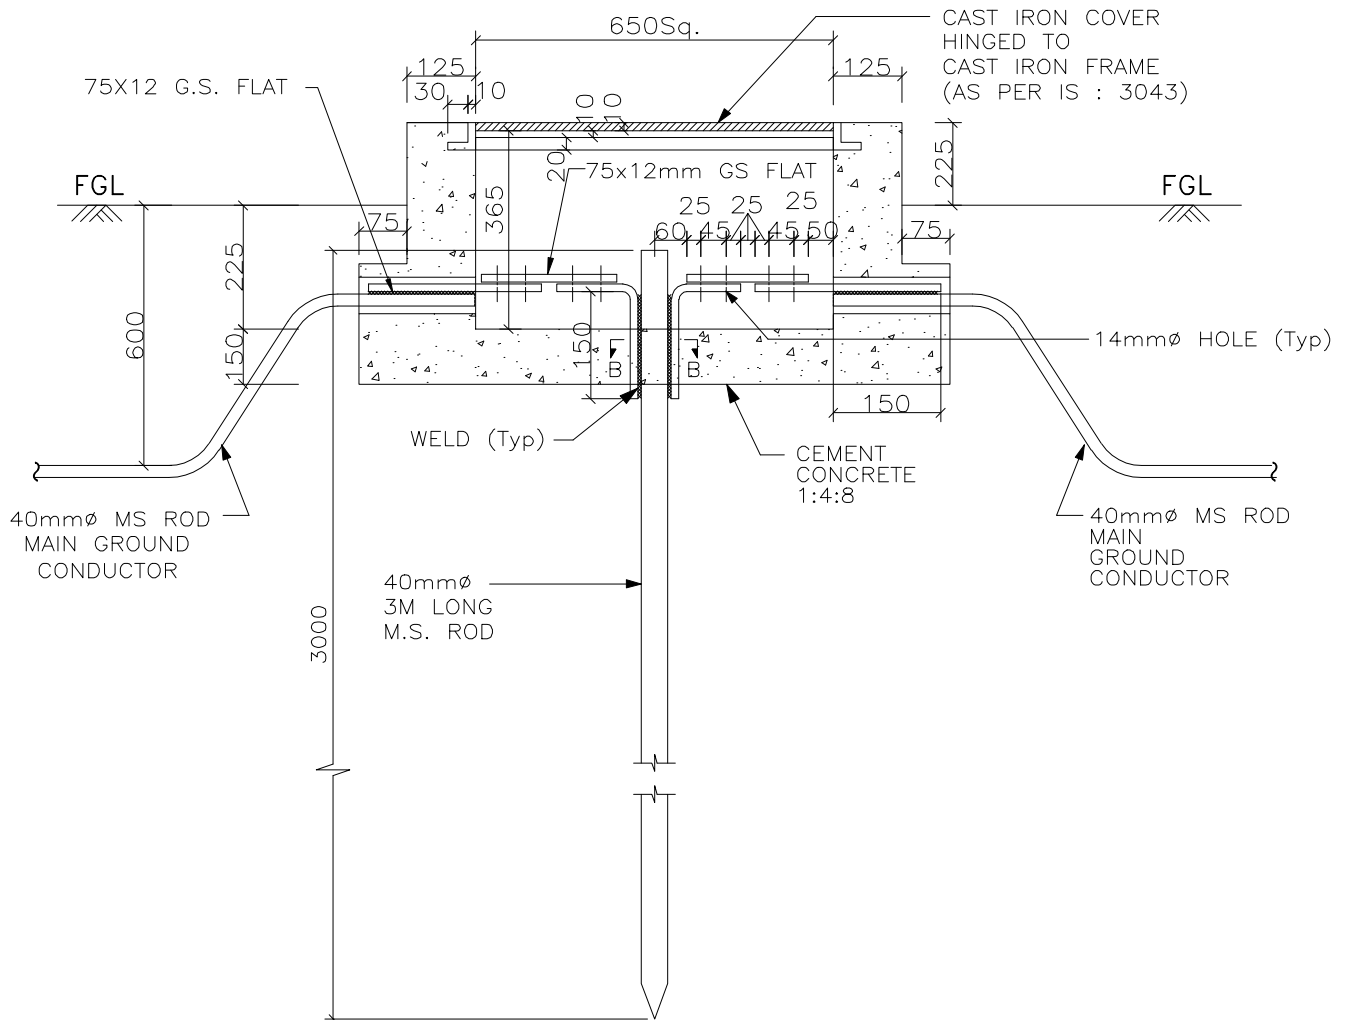

ELEVATION



EQUIPMENT EARTHING DETAILS ROD ELECTRODE WITH TEST LINK FOR LM, TOWER WITH PEAK, LA & CVT

COMPU. DRG. REF.






DRG. No.

TB-4-XXX-316-ROD_ELECTRODE

SHEET No.

Clause No.

TECHNICAL REQUIREMENTS

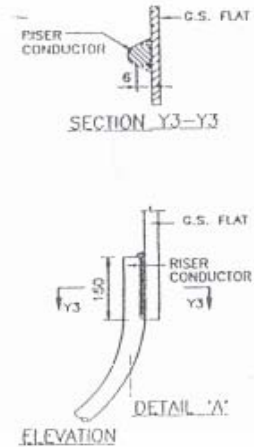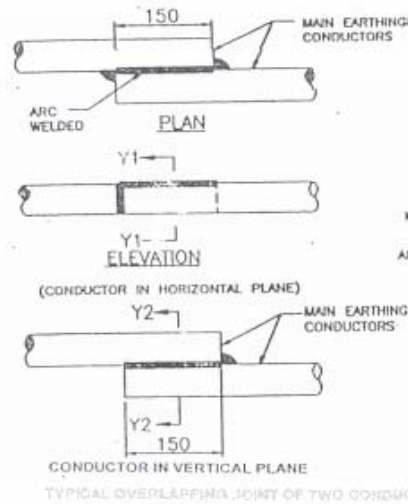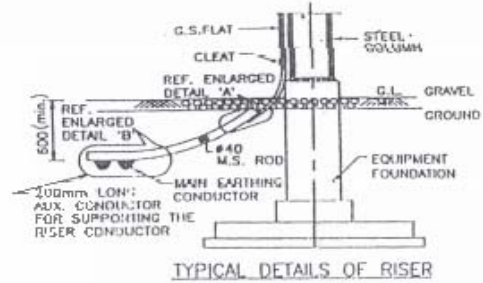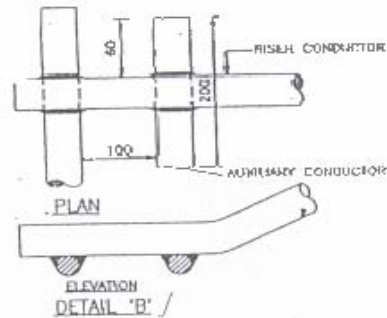

NOTE : WELDING OF EARTHING CONDUCTOR SHALL BE CONDUCTED IN VERTICAL PLANE WHEREVER POSSIBLE

EQUIPMENT EARTHING DETAILS STANDARD DRAWING

NABINAGAR STPP (3X660MW)
400/132KV SWITCHYARD
PACKAGE

Bid DOC. NO:
CS-0370-572-2

TECHNICAL
SPECIFICATIONS

PART-II
SECTION-VI

Page
E13-19 of 19