FIRST ANGLE PROJECTION

(ALL DIMENSIONS ARE IN mm)

DRG. NO. PY-LE-1-M231-2012-01 SHT. 00 OF 00

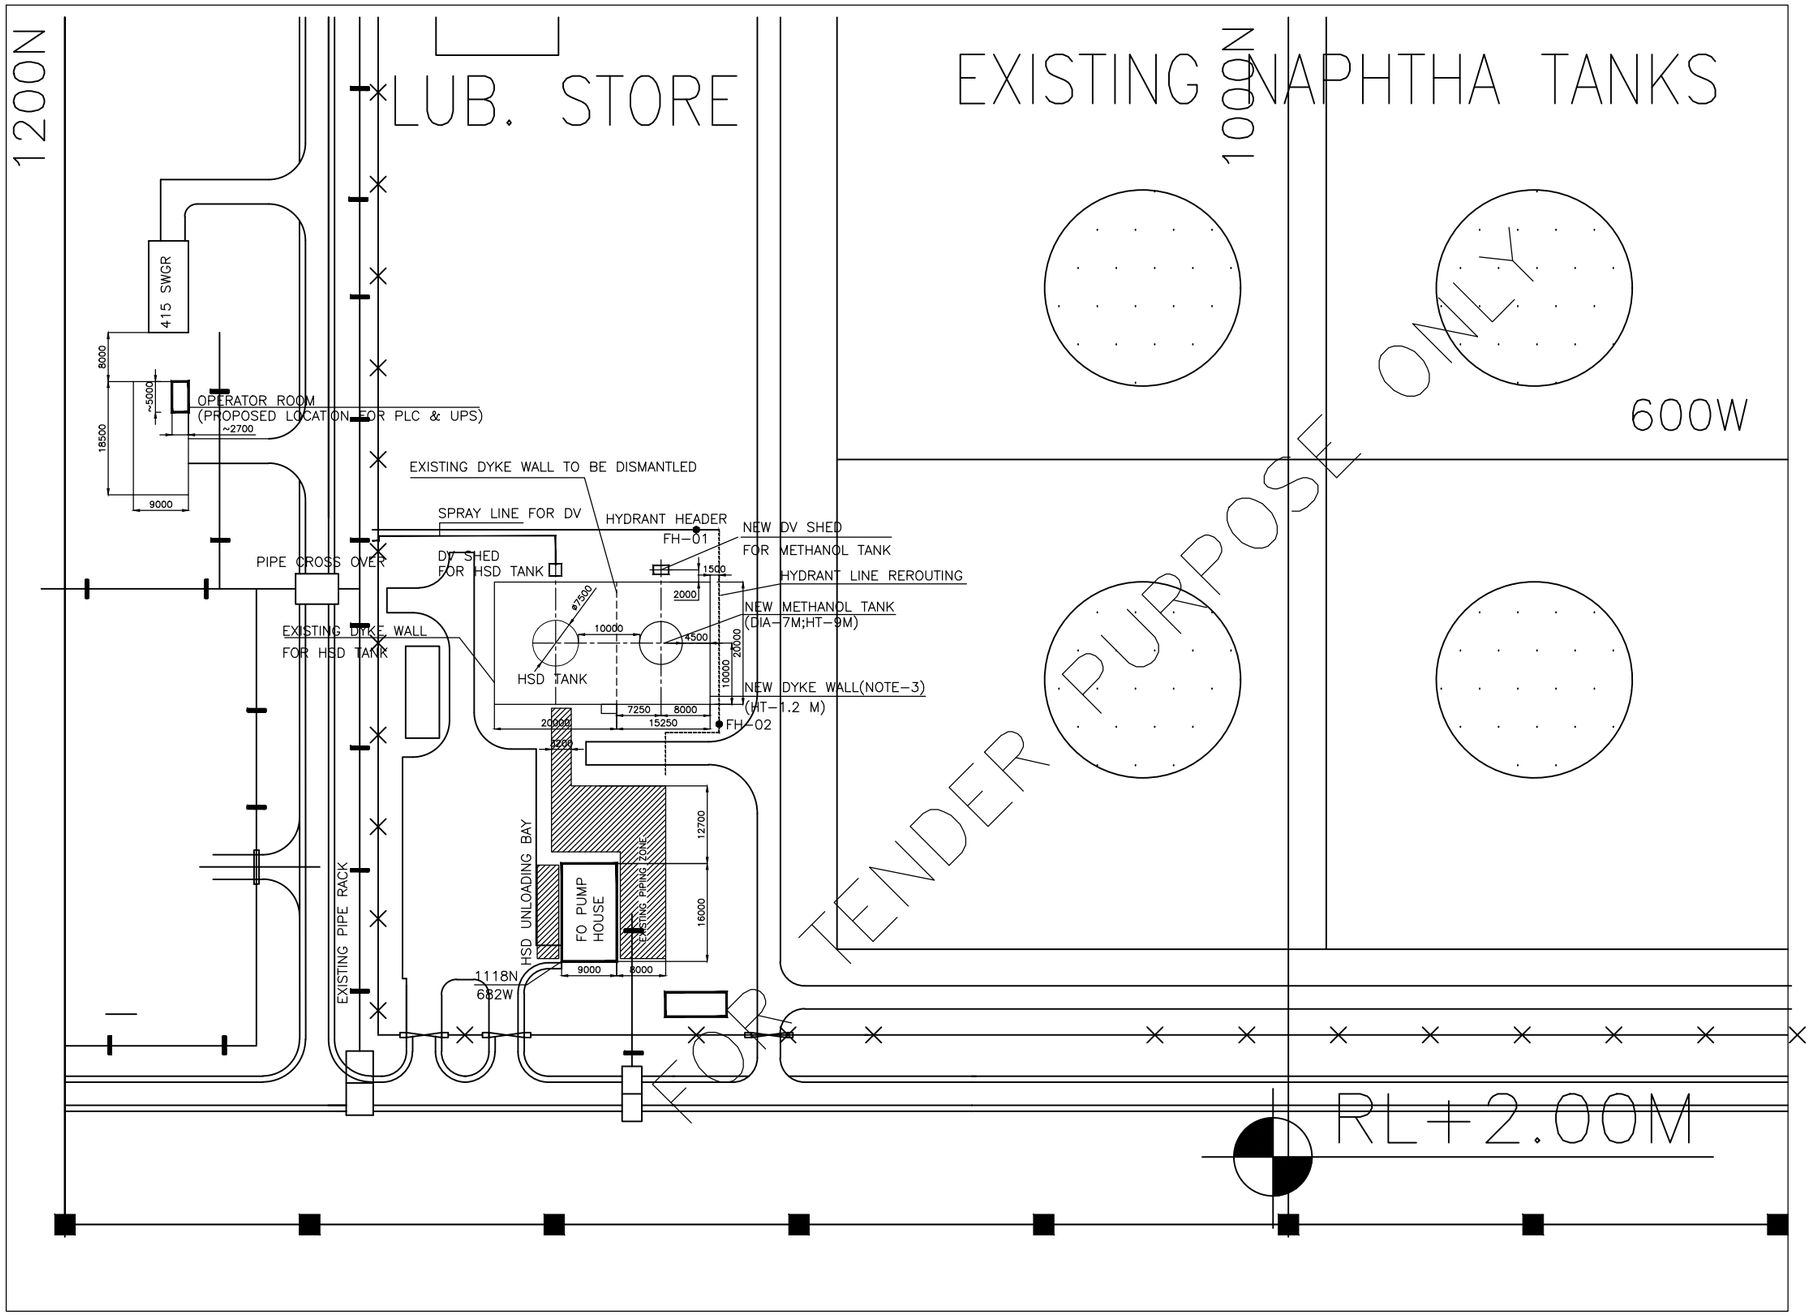



WIND ROSE

NOTES:-

1. EL (+) 0.00 M CORRESPONDS TO RL (+) 2.50M.
2. FORMATION LEVEL FOR SITE LEVELLING SHALL BE SHALL BE RL (+) 2.50M.HOWEVER AFTER GROUND IMPROVEMENT WORKS THE FINISHED GROUND LEVEL SHALL BE RL(+)2.00M.
3. NEW DYKE WALL SHALL BE MADE AROUND METHANOL TANK FROM 3 SIDES WITH HEIGHT-1.2M AS IN EXISTING WALL.THE SOUTH SIDE OF THE EXISTING DYKE WALL SHALL BE DISMANTLED.
4. FIRE WATER LINE IN THE NEW TANK AREA SHALL BE REROUTED OUTSIDE THE NEW DYKE WALL.

REFERENCE DRAWINGS

1. PLOT PLAN-3230-999-POC-F-001
2. FUEL SUPPLY SYSTEM-LAYOUT PLAN-TC-P06-0-003,REV-12

THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPAY

GENERAL DIMENSIONAL LIMITS,FITS & TOLERANCES AS PER HY0230261

COMPUTER FILE NAME: 0300100077-PS01-R01

SIGN. AND DATE | REF. DRG. NO. | INVENTORY NO

CUSTOMER: RAJIV GANDHI COMBINED CYCLE POWER PROJECT

NTPC Limited (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION

TYPE OF PRODUCT OR NAME OF CUSTOMER/PROJECT: METHANOL FIRING IN GT NTPC KAYAMKULAM

BHARAT HEAVY ELECTRICALS LTD. HYDERABAD

	NAME	SIGN.	DATE	NO.OF VAR.
DRN.	SHRN	--sd--	16.08.24	
CHD.	SRNN ANND	--sd--	16.08.24	--N.A--
APPD.	UDV G	--sd--	16.08.24	

REV.	DATE	ALTERED	REV.	DATE	ALTERED	REV.	DATE	ALTERED	REV.	DATE	ALTERED	REV.	DATE	ALTERED
		CHD/APPD			CHD/APPD			CHD/APPD			CHD/APPD			CHD/APPD
ZONE			ZONE			ZONE			ZONE			ZONE		

DEPT-PED | CODE ASD | UNTOL. DIMS. | SCALE 1:500 | WEIGHT (KG) --N.A-- | REF. TO ASSY. DRG. --N.A-- | ITEM NO. --N.A-- | NO.OF ITEMS --N.A--

TITLE: PLOT PLAN & EQUIPMENT LAYOUT METHANOL FIRING SYSTEM

CARD CODE: NTPC DWG NO. 1101-131-PVN-F-002 | BHEL DWG NO. PY-LE-1-M231-2012-01 | REV. 00

SHT. No 01 | NO. OF SHT. 01