

Date: 23-6-18

Ref: Tender RFQ No. RKR0000062 Dtd. 1-6-18

Corrigendum to UPS specifications: PS-251-615

In the UPS specification PS-251-615, the following points should be read as given below:

1.

11	Back-up	Minimum 30 minutes full load back-up shall be provided. • Design margin: 1.10 • Aging factor: 1.25 • Minimum VAH: 4,44,000 (battery sizing calculations to be shared).	
----	---------	--	--


Instead of above, the point no. 11 shall be read as below:

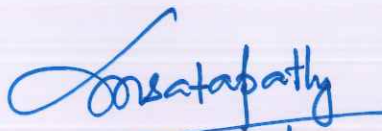
11	Back-up	Minimum 30 minutes full load back-up shall be provided. • Design margin: 1.10 • Aging factor: 1.25 (Battery sizing calculations to be shared).	
----	---------	--	--

2. For point no. 13, the Battery voltage shall be read as 2V instead of 12 V.
3. For point no. 18, the Battery end cell voltage shall be read as 1.75V instead of 10.5V.


(PRAVEEN KUMAR SINHA)


(RIPANDEEP SINGH)


23/6/18


23/6/18
ಡಾ.ಎಲ್.ಎನ್.ಸತ್ಯಪತಿ, ಅ.ಮ.ಪ. / ಡಿಎಬಿ (ಎಸ್.ಪಿ.ಡಿ-ಎಸ್.ಬಿ.ಡಿ.)
ಡಾ.ಎಲ್.ಎನ್.ಸತ್ಯಪತಿ, ಅ.ಮ.ಪ. / ಡಿಎಬಿ (ಎಸ್.ಪಿ.ಡಿ-ಎಸ್.ಬಿ.ಡಿ.)
DR.L.N.SATAPATHY, AGM / DABG (SPD-SBD)
BHEL - ESD, ELECTRONICS CITY, BANGALORE-560 100

ಪಿ. ಬರದಿ, ಅ.ಮ.ಪ./ಡಿ.ಇ.
ಪಿ. ಬರದಿ, ಅ.ಮ.ಪ./ಡಿ.ಇ.
P. BARADHI, AGM/DE
BHEL-ESD, ELECTRONICS CITY, BANGALORE - 560 100