

CONTENTS

SI No	Description	Chapter	No. of
			Pages
Vol IA	Part-I: Contract specific details		
1	Project Information	Chapter-I	01
2	Scope of works	Chapter-II	01
3	Facilities & Consumables in the scope of Contractor / BHEL (Scope Matrix)	Chapter-III	04
4	T&Ps and MMEs to be deployed by Contractor	Chapter-IV	01
5	T&Ps and MMEs to be deployed by BHEL on sharing basis	Chapter-V	01
6	Time Schedule	Chapter-VI	02
7	Terms of Payment	Chapter-VII	01
8	Taxes and Duties	Chapter-VIII	02
9	Bill of Quantity	Chapter-IX	01
10	General	Chapter-X	04
Vol	Part-II: Technical specifications		
IA			
1	Corrections / Revisions in Special Conditions of Contract, General Conditions of Contract and Forms & Procedures.	Chapter-1	11
2	Standard Specification For Preliminary Topographical Survey And Geotechnical Investigation	Chapter-2	50
3	Standard Specification For Bathymetric Survey	Chapter-3	06
4	Drawings	Chapter-4	04
5	"HSE Plan for Site Operations by Subcontractor" (Document No. HSEP: 14 Rev01)	Chapter-5	82
6	Format for Form no.: F-14 (Rev 01); Monthly Plan and Review with Contractors	Chapter6	05
7	Format for Form no.: F-15 (Rev 02); Monthly Performance Evaluation of contractor	Chapter-7	06
8	Pro forma for Bank Guarantee (in lieu of Security Deposit)	Chapter-8	03
9	Procedure 2.3-Procedure For Conduct Of Conciliation Proceedings	Chapter-9	11

VOLUME-IA PART-I CHAPTER-I PROJECT INFORMATION

1.1.1.	Project Title		3 x 800 MW NLC Talabira Thermal Power Project
1.1.2.	<u> </u>		800 MW
1.1.2.	Plant capacity	<u>.</u>	Green Field
1.1.3.	Type of project Owner		NLC India Limited
1.1.4.	Owner	•	
1.1.5.	Plant site location	:	The plant and township of the project proposed to be located near Kumbhari and Tareikela villages on south west of Brijraj Nagar town on Sambalpur Rourkela highway in Jharsuguda district and ash disposal area is located near Thelkolai village in Sambalpur district.
1.1.6.	Location co-ordinates	:	21° 46' 56.11" N 83° 58' 50.54" E
1.1.7.	Nearest Village	:	Kumbhari and Tareikela villages on south west of Brijraj Nagar town
1.1.8.	Nearest Town & City		Sambalpur
1.1.9.	State Capital		Bhubaneswar (350 Km)
1.1.10.	Nearest Railway Station	:	Jharsuguda (11 Km)
1.1.11.	Nearest Airport	:	Raipur (290 Km)
1.1.12.	Nearest Seaport	:	Paradip (385 Km)
1.1.13.	Nearest Road access	:	Sambalpur – Jharsuguda highway after crossing Bedhan River via state PWD road
1.1.14.	Meteorological Condition)	
1.1.14.1.	Altitude	:	203 M above MSL
1.1.14.2.	Ambient Temperature		
a.	Annual Maximum Mean Temperature	:	33.1°C
b.	Annual Minimum Mean Temperature	:	20.7°C
C.	Mean Wet Bulb Temperature	:	26.3 °C
1.1.14.3.	Mean Relative humidity		66% at 8:30 Hrs
1.1.14.4.	Annual Rainfall		
	Average	:	1445 mm (avg.)
1.1.14.5.	Basic Design Wind Pressure	:	In accordance with IS-875 for a basic wind speed of 50 m/sec, up to a height of 10 meters above mean ground level.)
1.1.14.6.	Seismic zone	:	Zone III as per IS:1893 (latest edition)
· · · · · · · · · · · · · · · · · · ·	· · · · · · · · · · · · · · · · · · ·	_	

VOLUME-IA PART-I CHAPTER-II SCOPE OF WORKS

THE SCOPE OF THE WORK WILL COMPRISE OF BUT NOT LIMITED TO THE FOLLOWING:

(All the works mentioned hereunder shall be carried out within the accepted rate unless otherwise specified.)

1.2.1 SCOPE OF WORK IN GENERAL:

It is not the intent to specify herein all details. Any item related to this work, not covered here under but necessary to complete the system will be deemed to have been included in the scope of the work.

1.2.2 Geotechnical investigation:

For detailed scope refer enclosed Bill of quantity (rate schedule), Standard Specification for Geotechnical investigation & layout drawing in Part II of Volume IA Technical Conditions of Contract.

1.2.3 Topographical survey:

For detailed scope refer enclosed Bill of quantity (rate schedule), Technical Specification for Topographical Survey & layout drawing in Part II of Volume IA Technical Conditions of Contract

1.2.4 Bathymetric Survey

For detailed scope refer enclosed Bill of quantity (rate schedule), standard specification for bathymetric survey & layout drawing in Part II of Volume IA Technical Conditions of Contract.

Note:

The bidder should visit site and acquire full knowledge & information about site conditions and acquaint themselves with the conditions prevailing at site and in & around the plant premises, together with all statutory, obligatory, mandatory requirements of various authorities before submission of bid.

VOLUME-IA PART-I CHAPTER-III FACILITIES & CONSUMABLES IN THE SCOPE OF CONTRACTOR / BHEL

(SCOPE MATRIX)

Description			e / to be	
SI.No			care by	Remarks
	PART I	BHEL	Bidder	
1.3.1	ESTABLISHMENT			
1.3.1.1	FOR CONSTRUCTION PURPOSE:			
1.3.1.1.1	Open space for office		Yes	
1.3.1.1.2	Open space for storage		Yes	
1.3.1.1.3	Construction of bidder's office, canteen and storage building including supply of materials and other services		Yes	
1.3.1.1.4	Bidder's all office equipments, office / store / canteen consumables		Yes	
1.3.1.1.5	Canteen facilities for the bidder's staff, supervisors and engineers etc		Yes	
1.3.1.1.6	Fire fighting equipments like buckets, extinguishers etc		Yes	
1.3.1.1.7	Fencing of storage area, office, canteen etc of the bidder		Yes	
1.3.1.2	FOR LIVING PURPOSES OF THE BIDDER			
1.3.1.2.1	Open space for labour colony		Yes	
1.3.1.2.2	Labour Colony with internal roads, sanitation, complying with statutory requirements		Yes	
1.3.1.3	ELECTRICITY			
1.3.1.3.1	Electricity For construction purposes (to be specified whether chargeable or free)		Yes	
1.3.1.3.1a	Single point source		Yes	
1.3.1.3.1b	Further distribution including all materials, Energy Meter, Protection devices and its service		Yes	
1.3.1.3.1c	Duties and deposits including statutory clearances if applicable		Yes	
1.3.1.3.2	Electricity for the office, stores, canteen etc of the bidder which include:		Yes	
1.3.1.3.2a	Distribution from single point including supply of materials and service		Yes	

SINo	Description		e / to be care by	Domorko
SI.No	PART I	BHEL		Remarks
1.3.1.3.2b	Supply, installation and connection of material of energy meter including operation and maintenance		Yes	
1.3.1.3.2c	Duties and deposits including statutory clearances for the above if applicable		Yes	
1.3.1.3.3	Living facilities for office use including charges		Yes	
1.3.1.3.4	Electricity for living accommodation of the bidder's staff, engineers, supervisors etc. in the above lines (in case BHEL provides this facility, the scope should be given without ambiguity)		Yes	
1.3.1.3.5	Demobilization of the facilities after completion of works		Yes	
1.3.1.4	WATER SUPPLY			
1.3.1.4.1	For construction purposes			
1.3.1.4.1a	Making the water available at single point		Yes	
1.3.1.4.1b	Further distribution as per the requirement of work including supply of materials and execution		Yes	
1.3.1.4.2	Water supply for bidder's office, stores, canteen etc			
1.3.1.4.2a	Making the water available at single point		Yes	
1.3.1.4.2b	Further distribution as per the requirement of work including supply of materials and execution		Yes	
1.3.1.4.3	Water supply for Living Purpose			
1.3.1.4.3a	Making the water available at single point		Yes	
1.3.1.4.3b	Further distribution as per the requirement of work including supply of materials and execution		Yes	
1.3.1.5	LIGHTING			
1.3.1.5.1	For construction work (supply of all the necessary materials) a) At office / storage area b) At the preassembly area c) At the construction site / area		Yes	

SI.No	Description		e / to be care by	Remarks
SI.NO	PART I	BHEL		Remarks
1.3.1.5.2	For construction work (execution of the lighting work / arrangements) a) At office/storage area b) At the preassembly area c) At the construction site /area		Yes	
1.3.1.5.3	Providing the necessary consumables like bulbs, switches, etc during the course of project work		Yes	
1.3.1.5.4	Lighting for the living purposes of the bidder at the colony / quarters		Yes	
1.3.1.6	COMMUNICATION FACILITIES FOR SITE OPERATIONS OF THE BIDDER			
1.3.1.6.1	Telephone, fax, internet, intranet, e-mail etc		Yes	
1.3.1.7	Compressed air Supply			
1.3.1.7.1	Supply of Compressor and all other equipments required for compressor & compressed air system including pipes, valves, storage systems etc		Yes	
1.3.1.7.2	Installation of above system and operation & maintenance of the same		Yes	
1.3.1.7.3	Supply of the all the consumables for the above system during the contract period		Yes	
1.3.1.8	TRANSPORTATION			
1.3.1.8.1	For site personnel of the bidder		Yes	
1.3.1.8.2	For bidder's equipments and consumables (T&P, Consumables etc)		Yes	
1.3.1.9	Demobilization of all the above facilities		Yes	

1.3.3 **OPEN SPACE**:

Contractor has to make his own arrangements for temporary office shed, stores shed(s) and labour colony.

1.3.4 **ELECTRICITY**:

- 1.3.4.1 The contractor shall make his own arrangement for all the electricity requirement including his labour tenements.
- 1.3.4.2 Any duty, deposit involved in getting the Electricity shall be borne by the bidder.

1.3.5 **CONSTRUCTION WATER:**

Contractor has to make his own arrangements for all water requirement for executing the scope of works and for his labour accommodation at his cost.

1.3.6 **MATERIAL SUPPLY**:

All materials required for the work are in the scope of the contractor.

1.3.7 **CONSUMABLES**

The contractor shall provide all consumables required for carrying out the work covered under this scope of work.

1.3.8 **DRAWINGS**

Plot plan drawing enclosed in chapter-4 in Part II of Volume IA Technical Conditions of Contract is for information and this may get revised during execution.

VOLUME-IA PART – I CHAPTER – IV T&PS AND MMEs TO BE DEPLOYED BY CONTRACTOR

- 1.4.1 All the T & P's like Total station, survey equipment's, rotary rigs, SCPT equipment, lab equipment etc. required for completion of the scope of works are to be arranged by the contractor within the quoted rate. Any other tools & plants required for this scope of work are to be arranged by the contractor within the quoted rates.
- 1.4.2 All the distribution boards, connecting cables, hoses etc., and temporary connection work including electrical connections shall have to be arranged by the contractor at his cost.
- 1.4.3 Adequate number of Rigs (Mutually agreed with BHEL for requirement of the work) to be mobilized within 1 week from start of work at site as the work is to be done on topmost priority basis

VOLUME-IA PART – I CHAPTER – V T&PS AND MMEs TO BE DEPLOYED BY BHEL ON SHARING BASIS

- 1.5.1 BHEL shall not provide any T&Ps.
- 1.5.2 BHEL shall not provide any MMEs.

VOLUME-IA PART-I CHAPTER-VI TIME SCHEDULE

1.6.1 TIME SCHEDULE

- 1.6.1.1 The commencement of work at site shall be within 7 days from the date of LOI.
- 1.6.1.2 The entire work as detailed in the Tender Specification shall be completed within 30 Days from the date of commencement of work at site.
- 1.6.1.3 During the total period of contract, the contractor has to carry out the activities/tests in a phased manner as required by BHEL and the program of milestone events.
- 1.6.1.4 The work shall be deemed as completed in all respect only when so certified by the site Engineer. The decision of BHEL in this regard shall be final and binding of the contractor.
- 1.6.1.5 The contractor is required to refer Form 15 in chapter-7 in Part II of Volume IA Technical Conditions of Contract, for all the instructions to be taken immediately after receipt of LOI.

1.6.2 COMMENCEMENT OF CONTRACT PERIOD

The date of commencement of contract period shall be the date of commencement of work. In case of discrepancy, the decision of BHEL engineer is final.

1.6.3 MOBILISATION:

1.6.3.1 The activities shall be started as per directions of Construction manager of BHEL. The contractor has to augment his resources in such a manner that following activities are achieved on specified schedules:

Tentative Schedule

Activity	Tentative Schedule
Tentative commencement of work	April 2021.
"Final report" shall be submitted including all field data's and laboratory reports to BHEL – PEM – New Delhi with copy to BHEL-PSSR-HQR and site	30 days from the date of commencement of work

1.6.3.2 The above time allowed for completion of work including Sundays and Holidays is from the date of commencement of work. Detailed program to be prepared by the tenderer taking in to consideration of the COMPLETION SCHEDULES.

1.6.4 In order to meet above schedule in general, and any other intermediate targets set, to meet customer / project schedule requirements, contractor shall arrange & augment all necessary resources from time to time on the instructions of BHEL.

1.6.5 CONTRACT PERIOD

The contract period for completion of entire work under scope shall be **30 Days**, from the "COMMENCEMENT OF CONTRACT PERIOD" as specified earlier.

1.6.6 GUARANTEE PERIOD:-

Guarantee period is not applicable for the subject works

VOLUME-IA PART – I CHAPTER-VII TERMS OF PAYMENT

1.7.1 Terms of payment:

- 1.7.1.1 Secured advance is not applicable for this tender.
- 1.7.1.2 Advance for Mobilization is not applicable for this tender.
- 1.7.1.3 The progressive payment against monthly running bills for the completed items will be released on accepted rate / price of contract value as mentioned below at clauses 1.7.1.3.1 and 1.7.1.3.2 on Pro rata basis (for the measured and accepted quantity).

SI. No.	Activity / Work Description	% of
		unit rate
1.7.1.3.1	On completion of field test, and submission of data in line with respective item (for the measured and accepted quantity)	95%
1.7.1.3.2	On submission of final report to BHEL PEM/ New Delhi, duly accepted and approved by BHEL/PEM New Delhi etc. thereof by BHEL against contractors invoice. (for the measured and accepted quantity) consisting of detailed bore logs, sub-soil sections, field test results, laboratory observations and test results in both tabular as well as graphical forms, practical and theoretical considerations for the interpretation of test results, the supporting calculations for the conclusions/ recommendation drawn, etc, duly accepted and approved by BHEL/PEM New Delhi etc. and against contractor's invoice. (for the measured and accepted quantity)	

Note:

- 1. Detailed definition of the terms "Draft Report" & "Final Report", preparation and submission of reports shall be in line with the technical specification attached.
- 2. Retention Amount clause as per clause 2.22 of General Conditions of Contract (Volume IC Book-II) is not applicable for the subject work.
- 3. RA Bill payments shall be as per Chapter X of SCC (Volume IB Book-II) & Chapter 2.23 of GCC (Volume-IC of Book-II)
- Please Refer Chapter-1 in Part II of Volume IA Technical Conditions of Contract for Corrections / Revisions In Special Conditions Of Contract, General Conditions Of Contract And Forms & Procedures.

VOLUME-IA PART – I CHAPTER-VIII TAXES AND DUTIES

- 1.8.1. Goods and service Tax (GST) & Cess
- 1.8.1.1. The successful bidder shall furnish proof of GST registration with GSTN Portal in the State in which the Project is being executed, covering the services under this contract. Registration should also bear endorsement for the premises from where the billing shall be done by the successful bidder on BHEL for this project/ work.
- 1.8.1.2. Contractor's price/rates shall be exclusive of GST & Cess (if applicable) (herein after termed as GST). Contractor shall submit to BHEL the GST compliant tax invoice/debit note/revised tax invoice on the basis of which BHEL will claim the input tax credit in its return. Since this is a works contract, the applicable rate shall be @ 18% GST, as applicable presently.
- 1.8.1.3. Bidder shall note that the GST Tax Invoice complying with GST Invoice Rules wherein the 'Bill To' details will be as below:

 BHEL GSTN: 21AAACB4146P1ZR
- 1.8.1.4. GST charged in the tax invoice/debit note/revised tax invoice by the contractor shall be released separately to the contractor only after contractor files the outward supply details in GSTR-1 on GSTN portal and input tax credit of such invoice is matched with corresponding details of outward supply of the contractor and has paid the GST at the time of filing the monthly return.
- 1.8.1.5. In case BHEL has to incur any liability (like interest / penalty etc.) due to denial/reversal / delay of input tax credit in respect of the invoice submitted by the contractor, for the reasons attributable to the contractor, the same shall be recovered from the contractor.
- 1.8.1.6. Further, in case BHEL is deprived of the Input tax credit due to any reason attributable to contractor, the same shall not be paid or Recovered if already paid to the contractor.
- 1.8.1.7. Tax invoice/debit Note/revised tax invoice shall contain all such particulars as prescribed in GST law and comply to the timelines for issue of the same. Invoices shall be submitted on time to the concerned BHEL Engineer In Charge.
- 1.8.1.8. TDS under GST (if/ as & when applicable) shall be deducted at prevailing rates on gross invoice value from the running bills.
- 1.8.1.9. E-way bills / Transit passes / Road Permits, if required for materials / T&P etc., bought into the project site is to be arranged by the Contractor only.
- 1.8.1.10.BHEL shall not reimburse any amounts towards any interest / penalty etc., incurred by contractor. Any additional claim at a later date due to issues such as wrong rates / wrong classification by contractor shall not be paid by BHEL.

1.8.2. All taxes and duty other than GST & Cess

The contractor shall pay all (except the specific exclusion viz GST & Cess), taxes, fees, license charges, deposits, duties, tools, royalty, commissions, Stamp Duties, or other charges / levies, which may be levied on the input goods & services consumed and output goods & services delivered in course of his operations in executing the contract and the same shall not be reimbursed by BHEL. In case BHEL is forced to pay any of such taxes, BHEL shall have the right to recover the same from his bills or otherwise as deemed fit.

1.8.3. Statutory Variations

Statutory variations are applicable under the GST Acts, against production of proof. The changes implemented by the Central / State Government during the tenure of the contract viz. increase / decrease in the rate of taxes, applicability, etc. and its impact on upward revision / downward revision are to be suitably paid/ adjusted from the date of respective variation. The bidder shall give the benefit of downward revision in favour of BHEL. No other variations shall be allowed during the tenure of the contract.

1.8.4. New Taxes/Levies -

In case Government imposes any new levy / tax after submission of bid during the tenure of the contract, BHEL shall reimburse the same at actual on submission of documentary proof of payment subject to the satisfaction of BHEL that such new levy / tax is applicable to this contract.

1.8.5. Direct Tax

BHEL shall not be liable towards Income Tax of whatever nature including variations thereof arising out of this contract as well as tax liability of the bidder and their personnel. Deduction of tax at source at the prevailing rates shall be effected by BHEL before release of payment as a statutory obligation, unless exemption certificate is produced by the bidder. TDS certificate will be issued by BHEL as per the provisions of Income Tax Act.

VOLUME-IA PART-I CHAPTER-IX BILL OF QUANTITY

1.9.1. Notes to Bill of Quantities

- 1. Details of items shall be read in conjunction with the corresponding specification, drawings and other tender terms.
- 2. The bidder shall quote for finished items of work and shall provide all necessary power, water, instruments, fuel, tools and plants, tackles, materials, transport, labour, supervision and maintenance till handing over, repairs, rectifications, safety and security of their workmen and equipment's including insurance etc.
- 3. Quantities of the various items mentioned in the schedule of quantities are approximate and may vary upto any extent or be deleted altogether and new items may be added. The contractor shall carry out all the works upto a variation of +/-30% (plus or minus thirty percent) on the tendered value of the contract and all tendered rates shall remain firm within this limit.
- 4. Engineer-in-charge's decision regarding clarification of items in the schedule with respect to other sections of the contract shall be final and binding on the contractor.
- 5. Contractor shall make his own arrangement for water, electricity, accommodation, access to site and the cost of all such work shall be considered to be included in his/her quoted price.
- 6. Also refer Volume II, Price Bid.

VOLUME-IA PART-I CHAPTER-X GENERAL

The scope of the work will comprise of but not limited to the following:

(All the works mentioned hereunder shall be carried out within the accepted rate unless otherwise specified.)

- 1.10.1. Contractors are requested to furnish the following documents at PSSR-HQ, Chennai immediately after release of Letter of Intent (LOI).
 - i. Security Deposit and additional Security Deposit.
 - ii. Unqualified Acceptance for Detailed LOI / Work Order.
- 1.10.2. Contractors are requested to furnish the proof of documents for the following at PSSR- Site
 - i. Provident Fund Registration Number.
 - ii. Labour License Number.
 - iii. Workmen Insurance Policy Number.
- 1.10.3. In addition to the clause 2.8 of General Conditions of Contract (Volume-IC of Book-II) the contractor shall comply with the following.
- 1.10.3.1. BOCW Act & BOCW Welfare Cess Act
- 1.10.3.1.1. The Contractor should Register their Establishment under BOCW Act 1996 read with rules 1998 by submitting Form I (Application for Registration of Establishment) and Form IV (Notice Of Commencement / Completion of Building Other Construction Work) to the respective Labour Authorities i.e.,
 - a. Assistant Labour Commissioner (Central) in respect of the project premises which is under the purview of Central Govt.–NTPC, NTPL etc.
 - b. Appropriate State authorities in respect of the project premises which is under the purview of State Govt.
- 1.10.3.1.2. The Contractor should comply with the provisions of BOCW Welfare Cess Act 1996 in respect of the work awarded to them by BHEL.
- 1.10.3.1.3. The contractor should ensure compliance regarding Registration of Building Workers as Beneficiaries, Hours of work, welfare measures and other conditions of service with particular reference to Safety and Health measures like Safety Officers, safety committee, issue of Personal protective equipments, canteen, rest room, drinking water, Toilets, ambulance, first aid centre etc.
- 1.10.3.1.4. The contractor irrespective of their nature of work and manpower (Civil, Mechanical, Electrical works etc) should register their establishment under BOCW Act 1996 and comply with BOCW Welfare Cess Act 1996.
- 1.10.3.1.5. Contractor shall make remittance of the BOCW cess as per the Act in consultation with BHEL as per the rates in force (presently 1%). BHEL shall reimburse the same upon production of documentary evidence. However, BHEL shall not reimburse the fee paid towards the registration of establishment, fees paid towards registration of Beneficiaries and contribution of Beneficiaries

remitted.

1.10.3.1.6. Non-compliance to Provisions of the BOCW Act & BOCW Welfare Cess Act is not acceptable. In case of any non-compliance, BHEL reserves the right to withhold any sum as it deems fit. Only upon total compliance to the BOCW Act and also discharge of total payment of Cess under the BOCW Cess Act by the Contractor, BHEL shall consider refund of the Amounts

1.10.3.2. **PROVIDENT FUND**

- 1.10.3.2.1. The contractor is required to extent the benefit of Provident Fund to the labour employed by you in connection with this contract as per the Employees Provident Fund and Miscellaneous Provisions Act 1952. For due implementation of the same, you are hereby required to get yourself registered with the Provident Fund authorities for the purpose of reconciliation of PF dues and furnish to us the code number allotted to you by the Provident Fund authorities within one month from the date of issue of this letter of intent. In case you are exempted from such remittance an attested copy of authority for such exemption is to be furnished. Please note that in the event of your failure to comply with the provisions of said Act, if recoveries therefore are enforced from payments due to us by the customer or paid to statutory authorities by us, such amount will be recovered from payments due to you.
- 1.10.3.2.2. The final bill amount would be released only on production of clearance certificate from PF / ESI and labour authorities as applicable.

1.10.3.3. OTHER STATUTORY REQUIREMENTS

- 1.10.3.3.1. The Contractor shall submit a copy of Labour License obtained from the Licensing Officer (Form VI) u/r25 read with u/s 12 of Contract Labour (R&A) Act 1970 & rules and Valid WC Insurance copy or ESI Code (if applicable) and PF code no. along with the first running bill.
- 1.10.3.3.2. The contactor shall submit monthly running bills along with the copies of monthly wages (of the preceding month) u/r78(1)(a)(1) of Contract Labour Rules, copies of monthly return of PF contribution with remittance Challans under Employees Provident Fund Act 1952 and copy of renewed WC Insurance policy or copies of monthly return of ESI contribution with Challans under ESI Act 1948 (if applicable) in respect of the workmen engaged by them.
- 1.10.3.3.3. The Contractor should ensure compliance of Sec 21 of Contract Labour (R&A) Act 1970 regarding responsibility for payment of Wages. In case of "Non-compliance of Sec 21 or non-payment of wages" to the workmen before the expiry of wage period by the contactor, BHEL will reserve its right to pay the workmen under the orders of Appropriate authority at the risk and cost of the Contractor.
- 1.10.3.3.4. The Contractor shall submit copies of Final Settlement statement of disbursal of retrenchment benefits on retrenchment of each workmen under I D Act 1948,

copies of Form 6-A (Annual Return of PF Contribution) along with copies of PF Contribution Card of each member under PF Act and copies of monthly return on ESI Contribution – Form 6 under ESI Act 1948 (if applicable) to BHEL along with the Final Bill.

- 1.10.3.3.5. In case of any dispute pending before the appropriate authority under ID Act 1948, WC Act 1923 or ESI Act 1948 and PF Act 1952, BHEL reserve the right to hold such amounts from the final bills of the Contractor which will be released on submission of proof of settlement of issues from the appropriate authority under the act.
- 1.10.3.3.6. In case of any dispute prolonged / pending before the authority for the reasons not attributable to the contractor, BHEL reserves the right to release the final bill of the contractor on submission of Indemnity bond by the contractor indemnifying BHEL against any claims that may arise at a later date without prejudice to the rights of BHEL.

1.10.3.4. DEPLOYMENT OF SKILLED / SEMI-SKILLED TRADESMEN

The following clause is applicable in case the contract value / contract price is Rs. Five crores and above.

shall, at all stages of work deploy skilled / semi-skilled contractor tradesmen who are qualified and possess certificate in particular trade from CPWD Training Institute / Industrial Training. Institute / National Institute of Construction Management and Research (NICMAR), National Academy of Construction, CIDC or any similar reputed and recognized Institute managed / certified by State / Central Government. The number of such qualified tradesmen shall not be less than 20% of total skilled / semi-skilled workers required in each trade at any stage of work. The contractor shall submit number of man days required in respect of each trade, its scheduling and the list of qualified tradesmen along with requisite certificate from recognized Institute to Engineerin-Charge for approval. Notwithstanding such approval, if the tradesmen are found to have inadequate skill to execute the work of respective trade, the contractor shall substitute such tradesmen within two days of written notice from Engineer-in-Charge. Failure on the part of contractor to obtain approval of Engineer-in-Charge or failure to deploy qualified tradesmen will attract a compensation to be paid by contractor at the rate of Rs. 100 per such tradesman per day. Decision of Engineer-in-Charge as to whether particular tradesman possesses requisite skill and amount of compensation in case of default shall be final and binding.

1.10.3.5. RECOVERY OF COMPENSATION PAID TO VICTIMS BY BHEL IN CASES OF DEATH/ PERMANENT INCAPACITATION OF PERSON DUE TO AN ACCIDENT DURING THE WORKS

BHEL shall recover the amount of compensation paid to victim(s) by BHEL towards loss of life / permanent disability due to an accident which is attributable

to the negligence of contractor, agency or firm or any of its employees as detailed below.

- a) Victim: Any person who suffers permanent disablement or dies in an accident as defined below.
- b) Accident: Any death or permanent disability resulting solely and directly from any unintended and unforeseen injurious occurrence caused during the manufacturing / operation and works incidental thereto at BHEL factories/ offices and precincts thereof, project execution, erection and commissioning, services, repairs and maintenance, trouble shooting, serving, overhaul, renovation and retrofitting, trial operation, performance guarantee testing undertaken by the company or during any works /during working at BHEL Units/ Offices/ townships and premises/ Project Sites.
- Compensation in respect of each of the victims:
 In the event of death or permanent disability resulting from Loss of both limbs: Rs. 10,00,000/- (Rs. Ten Lakh)
 In the event of other permanent disability: Rs. 7,00,000/- (Rs. Seven Lakh)

Permanent Disablement: A disablement that is classified as a permanent total disablement under the proviso to Section 2 (I) of the Employee's Compensation Act, 1923.

VOLUME-IA PART-II CHAPTER-1

CORRECTIONS / REVISIONS IN SPECIAL CONDITIONS OF CONTRACT, GENERAL CONDITIONS OF CONTRACT AND FORMS & PROCEDURES

SI.No.: 1

Clause 4.1.11 of SCC is deleted.

SI. No.: 2

OCCUPATIONAL HEALTH, SAFETY & ENVIRONMENT MANAGEMENT/ QUALITY ASSURANCE PROGRAMME

The following clauses in Occupational Health, Safety & Environment Management / Quality Assurance Programme published in Chapter-IX of Special Conditions of Contract (Volume I Book-II) is revised as under.

Chapter IX Clause 9.1 is modified as below:

Contractor will comply with HSE (Health, Safety & Environment) requirements of BHEL as per the "HSE Plan for Site Operations by Subcontractor" (Document No. HSEP: 14 Rev 01) enclosed.

Chapter IX Clause 9.1.1 to 9.1.25 stands deleted.

Chapter IX Clause 9.2 to 9.62 stands deleted.

SI No.: 3

Clause No. 10.5 on RA Bill Payments, in Special Conditions of Contract (SCC), Volume- IB, Book- II, is revised as under:

The payment for running bills will normally be released within 30 days of submission of running bill complete in all respects with all documents. It is the responsibility of the contractor to make his own arrangements for making timely payments towards labour wages, statutory payments, outstanding dues etc., and other dues in the meanwhile.

SI No.: 4

Void

<u>SI No.: 5</u>

SECURITY DEPOSIT

The **SECURITY DEPOSIT** (SD) clause 1.10 published in General Conditions of Contract (Volume I Book-II) is revised as under.

1.10 <u>Security Deposit:</u>

- 1.10.1 Upon acceptance of Tender, the successful Tenderer should deposit the required amount of Security Deposit for satisfactory completion of work, as given below:
- 1.10.2 The total amount of Security Deposit will be 5% of the contract value. EMD of the

successful tenderer shall be converted and adjusted towards the required amount of Security Deposit.

- 1.10.3 The Security Deposit should be furnished before start of the work by the contractor.
- 1.10.4 Modes of deposit:
- 1.10.4.1The balance amount to make up the required Security Deposit of 5% of the contract value may be furnished in any one of the following forms
 - i. Cash (as permissible under the extant Income Tax Act)
 - ii. Local cheques of Scheduled Banks (subject to realization)/ Pay Order / Demand Draft/ Electronic Fund Transfer in favour of BHEL
 - iii. Bank Guarantee from Scheduled Banks / Public Financial Institutions as defined in the Companies Act. The Bank Guarantee format for Security Deposit shall be in the prescribed formats.
 - iv. Fixed Deposit Receipt issued by Scheduled Banks / Public Financial Institutions as defined in the Companies Act. The FDR should be in the name of the contractor, A/C BHEL, duly discharged on the back.
 - v. Securities available from Indian Post offices such as National Savings Certificates, Kisan Vikas Patras etc. (Certificates should be held in the name of Contractor furnishing the security and duly endorsed / hypothecated / pledged, as applicable, in favour of BHEL and discharged on the back)
 - (Note: BHEL will not be liable or responsible in any manner for the collection of interest or renewal of the documents or in any other matter connected therewith)

Bank details for the purpose of Security Deposit is as follows:

For Electronic Fund Transfer the details are as below-:

- a) Name of the Beneficiary -: Bharat Heavy Electricals Limited
- b) Bank Particulars
 - i). Bank Name -: State Bank of India
 - ii). Bank Telephone No.(with STD code)-: 044 2433 0583 / 2433 0407
 - iii). Branch Address-: SBI Saidapet Branch, 690, Anna Salai,

Nandanam, Chennai-600035

- iv). Bank Fax No. (with STD code) -: 044 2431 0959
- v). Branch Code -: 00912
- vi). 9 Digit MICR Code of the Bank Branch -: 600002045
- vii). Bank Account Number -: 10610819499
- viii). Bank Account Type -: Cash Credit Account
- ix). 11 Digit IFSC Code of Beneficiary Branch-: SBIN0000912

Details for SFMS (Structured Financial Messaging System) transmission of BG

Bank and Branch	SBI TFCPC Branch
Branch Code	5056
IFSC Code	SBIN0005056

- 1.10.5 At least 50% of the Security Deposit including the EMD should be deposited in any form as prescribed before start of the work and the balance 50% of the Security Deposit will be recovered by deducting 10% of the gross amount progressively from each running bills of the contractor till the total amount of the required Security Deposit is collected.
- 1.10.6 The recoveries made from running bills (cash deduction towards balance SD amount) will be released against submission of equivalent Bank Guarantee in the prescribed formats, but only once, before completion of work.
- 1.10.7 The Security Deposit shall not carry any interest.
- 1.10.8 If the value of work done at any time exceeds the contract value, the amount of Security Deposit shall be correspondingly enhanced and the excess Security Deposit due the enhancement shall be immediately deposited by the Contractor or recovered from payment/s due to the Contractor.
- 1.10.9 The validity of Bank Guarantees towards Security Deposit shall be initially upto the completion period as stipulated in the Letter of Intent/Award + 3 months, and the same shall be kept valid by proper renewal till the acceptance of Final Bills of the Contractor, by BHEL
 - Date of Expiry of Claim shall be as given in the prescribed formats for Bank Guarantee towards Security Deposit.
- 1.10.10 BHEL reserves the right of forfeiture of Security Deposit in addition to other claims and penalties in the event of the Contractor's failure to fulfill any of the contractual obligations or in the event of termination of contract as per terms and conditions of contract. BHEL reserves the right to set off the Security Deposit against any claims of other contracts with BHEL.
- 1.10.11 Penalty for Delayed Remittance of Security Deposit

If the contractor fails to furnish SD before start of work, in line with 1.10.3 above, Simple Interest against delayed remittance of the Security Deposit shall be deducted from the sub-contractor at the rate of SBI PLR + 2% on the value of 50% SD of the contract, for the delayed period (i.e., period between start of work and date of remittance of Initial SD, i.e., atleast 50% of SD). In case, the delayed period has different SBI PLR rates, Simple Interest shall be calculated based on different rates by considering the corresponding time period. On similar lines Penalty shall be levied for delayed remittance of Additional Security Deposit (if applicable).

Note: - Bank details & SFMS details provided above in SI. No. 04 (Earnest Money Deposit) may be used for the purpose of arranging Bank Guarantees towards Security Deposit / Additional Security Deposit also.

SI. No.: 6

Clause 2.7.1, 2.7.2 and 2.7.3 in GCC regarding Rights of BHEL is revised as under:

2.7.1 To withdraw any portion of work and / or to restrict / alter quantum of work as indicated in the contract during the progress of work and get it done through other agencies to suit BHEL's commitment to its customer or in case BHEL decides to advance the date of completion due to other emergent reasons / BHEL's obligation to its customer.

In case of inadequate manpower deployed by the contractor, BHEL reserves the right to deploy additional manpower through any other agency for expediting activities in the interest of the project. Supplied manpower shall be put on job by the contractor and payments and other statutory compliances related to manpower shall be the contractor's responsibility. In case of contractor's failure to fulfill his obligations in respect of such manpower, BHEL reserves the right to take necessary action as per contract conditions.

2.7.2.

- 2.7.2.1 To terminate the contract or withdraw portion of work and get it done through other agency, at the risk and cost of the contractor after due notice of a period of 14 days' by BHEL in any of the following cases:
 - i. Contractor's poor progress of the work vis-à-vis execution timeline as stipulated in the Contract, backlog attributable to contractor including unexecuted portion of work does not appear to be executable within balance available period considering its performance of execution.
 - ii. Withdrawal from or abandonment of the work by contractor before completion of the work as per contract.
 - iii. Non-completion of work by the Contractor within scheduled completion period as per Contract or as extended from time to time, for the reasons attributable to the contractor.
 - iv. Termination of Contract on account of any other reason(s) attributable to Contractor.
 - v. Assignment, transfer, subletting of Contract without BHEL's written permission.
 - vi. Non-compliance to any contractual condition or any other default attributable to Contractor.

Risk & Cost Amount against Balance Work:

Risk & Cost amount against balance work shall be calculated as follows: Risk & Cost Amount= [(A-B) + (A x H/100)]

Where.

A= Value of Balance scope of Work (*) as per rates of new contract

B= Value of Balance scope of Work (*) as per rates of old contract being paid to the contractor at the time of termination of contract i.e. inclusive of PVC & ORC, if any.

H = Overhead Factor to be taken as 5

In case (A-B) is less than 0 (zero), value of (A-B) shall be taken as 0 (zero).

Difference of Contract Quantities and Executed Quantities as on the date of issue of Letter for 'Termination of Contract', shall be taken as balance scope of Work for calculating risk & cost amount.

Contract quantities are the quantities as per original contract. If, Contract has been amended, quantities as per amended Contract shall be considered as Contract Quantities.

Items for which total quantities to be executed have exceeded the Contract Quantities based on drawings issued to contractor from time to time till issue of Termination letter, then for these items total Quantities as per issued drawings would be deemed to be contract quantities.

Substitute / extra items whose rates have already been approved would form part of contract quantities for this purpose. Substitute / extra items which have been executed but rates have not been approved, would also form part of contract quantities for this purpose and rates of such items shall be determined in line with contractual provisions.

However, increase in quantities on account of additional scope in new tender shall not be considered for this purpose.

NOTE: Incase portion of work is being withdrawn at risk & cost of contractor instead of termination of contract, contract quantities pertaining to portion of work withdrawn shall be considered as 'Balance scope of work' for calculating Risk & Cost amount.

LD against delay in executed work in case of Termination of Contract:

LD against delay in executed work shall be calculated in line with LD clause no. 2.7.9 of GCC, for the delay attributable to contractor. For limiting the maximum value of LD, contract value shall be taken as Executed Value of work till termination of contract.

Method for calculation of "LD against delay in executed work in case of termination of contract" is given below.

^{*} Balance scope of work (in case of termination of contract):

- i). Let the time period from scheduled date of start of work till termination of contract excluding the period of Hold (if any) not attributable to contractor = T1
- ii). Let the value of executed work till the time of termination of contract= X
- Let the Total Executable Value of work for which inputs/fronts were made available to contractor and were planned for execution till termination of contract = Y
- iv). Delay in executed work attributable to contractor i.e. T2= [1-(X / Y)] x T1
- v). LD shall be calculated in line with LD clause (clause 2.7.9) of the Contract for the delay attributable to contractor taking "X" as Contract Value and "T2" as period of delay attributable to contractor.
- 2.7.2.2 In case Contractor fails to deploy the resources as per requirement, BHEL can deploy own/hired/otherwise arranged resources at the risk and cost of the contractor and recover the expenses incurred from the dues payable to contractor. Recoveries shall be actual expenses incurred plus 5% overheads or as defined in TCC.

2.7.3 Recoveries arising out of Risk & Cost and LD or any other recoveries due from Contractor

Following sequence shall be applicable for recoveries from contractor:

- a) Dues available in the form of Bills payable to contractor, SD, BGs against the same contract.
- b) Demand notice for deposit of balance recovery amount shall be sent to contractor, if funds are insufficient to effect complete recovery against dues indicated in (a) above.
- c) If contractor fails to deposit the balance amount to be recovered within the period as prescribed in demand notice, following action shall be taken for balance recovery:
 - Dues payable to contractor against other contracts in the same Region shall be considered for recovery.
 - ii) If recovery cannot be made out of dues payable to the contractor as above, balance amount to be recovered, shall be informed to other Regions/Units for making recovery from the Unpaid Bills / Running Bills / SD / BGs / Final Bills of contractor.
 - iii) In-case recoveries are not possible with any of the above available options, Legal action shall be initiated for recovery against contractor.

SI. No.: 7 Void

SI. No.: 8

The OVERRUN COMPENSATION (ORC) clause 2.12 published in General Conditions of Contract (Volume I Book II) is revised as under.

2.12 OVERRUN COMPENSATION (ORC)

Void. (Explanation: Over Run Compensation is not applicable for this tender.)

SI No.: 9

<u>Clauses 2.13.1, 2.13.6, 2.13.7 in GCC on Interest Bearing Recoverable Advances are revised as under</u>

- > Clauses 2.13.1, 2.13.6 & 2.13.7 in GCC are revised as under:
- ➤ Clause 2.13.1 in GCC is revised as "Normally no advance payment shall be payable to the contractor. Mobilization advance payment in exceptional circumstances shall be interest bearing and secured through a Bank Guarantee and shall be limited to a maximum of 5% of contract value. This 'Interest Bearing Recoverable Advance' shall be payable in not less than two installments with any of the installment not exceeding 60% of the total eligible advance".
- ➤ Clause 2.13.6 in GCC is revised as "The rate of interest applicable for the above advances shall be the Base rate of State Bank of India prevailing at the time of disbursement of the advance + 6%, and such rate will remain fixed till the total advance amount is recovered".
- ➤ Clause 2.13.7 in GCC is revised as "Unadjusted amount of advances paid shall not exceed 5% of the total contract value at any point of time. Recovery of advances shall be made progressively from each Running Bill such that the advance amounts paid along with the interest is fully recovered by the time the contractor's billing reaches 90% of contract value."

SI. No.: 10

Clause 2.14.1 on Quantity Variation in General Conditions of Contract (GCC), Volume-IC, Book- II is revised as under:

2.14.1 Quantities of the various items mentioned in the schedule of quantities are approximate and may vary upto any extent or be deleted altogether and new items may be added. The contractor shall carry out all the works upto a variation of +/-30% (plus or minus thirty percent) on the tendered value of the contract and all tendered rates shall remain firm within this limit.

SI. No.: 11

PRICE VARIATION COMPENSATION (PVC)

The PRICE VARIATION COMPENSATION (PVC) clause 2.17 published in General Conditions of Contract (Volume IC Book-II) is revised as under.

2.17 PRICE VARIATION COMPENSATION

Void. (Explanation: Price Variation Compensation is not applicable for this tender.)

SI. No.: 12

Clause 2.21 "ARBITRATION" of GCC has been amended as follows:

2.21 ARBITRATION & CONCILIATION

2.21.1 ARBITRATION:

2.21.1.1 Except as provided elsewhere in this Contract, in case Parties are unable to reach amicable settlement (whether by Conciliation to be conducted as provided in Clause 2.21.2 herein below or otherwise) in respect of any dispute or difference; arising out of the formation, breach, termination, validity or execution of the Contract; or, the respective rights and liabilities of the Parties; or, in relation to interpretation of any provision of the Contract; or. in any manner touching upon the Contract (hereinafter referred to as the 'Dispute'), then, either Party may, commence arbitration in respect of such Dispute by issuance of a notice in terms of section 21 of the Arbitration & Conciliation Act, 1996 (hereinafter referred to as the 'Notice'). The Notice shall contain the particulars of all claims to be referred to arbitration in sufficient detail and shall also indicate the monetary amount of such claim. The arbitration shall be conducted by a sole arbitrator to be appointed by the Head of the BHEL Power Sector Region issuing the Contract within 60 days of receipt of the complete Notice. The language of arbitration shall be English.

The Arbitrator shall pass a reasoned award.

Subject as aforesaid, the provisions of Arbitration and Conciliation Act 1996 (India) or statutory modifications or re-enactments thereof and the rules made thereunder as in force from time to time shall apply to the arbitration proceedings under this clause. The seat of arbitration shall be Chennai (the place from where the contract is Issued). The Contract shall be governed by and be construed as per provisions of the laws of India. Subject to this provision 2.21.1.1 regarding ARBITRATION, the principal civil court exercising ordinary civil jurisdiction over the area where the seat of arbitration is located shall have exclusive jurisdiction over any DISPUTE to the exclusion of any other court.

2.21.1.2 In case of Contract with Public Sector Enterprise (PSE) or a Government Department, the following shall be applicable:

In the event of any dispute or difference relating to the interpretation and application of the provisions of commercial contract(s) between Central Public Sector Enterprises (CPSEs)/ Port Trusts inter se and also between CPSEs and

Government Departments/Organizations (excluding disputes concerning Railways, Income Tax, Customs & Excise Departments), such dispute or difference shall be taken up by either party for resolution through AMRCD (Administrative Mechanism for Resolution of CPSEs Disputes) as mentioned in DPE OM No. 4(1)/2013-DPE(GM)/FTS-1835 dated 22-05-2018 as amended from time to time.

- 2.21.1.3 The cost of arbitration shall initially be borne equally by the Parties subject to the final allocation thereof as per the award/order passed by the Arbitrator.
- 2.21.1.4 Notwithstanding the existence of any dispute or differences and/or reference for the arbitration, the Contractor shall proceed with and continue without hindrance the performance of its obligations under this Contract with due diligence and expedition in a professional manner unless the dispute inter-alia relates to cancellation, termination or short-closure of the Contract by BHEL.

2.21.2 CONCILIATION:

If at any time (whether before, during or after the arbitral or judicial proceedings), any Disputes (which term shall mean and include any dispute, difference, question or disagreement arising in connection with construction, meaning, operation, effect, interpretation or breach of the agreement, contract), which the Parties are unable to settle mutually, arise inter-se the Parties, the same may, be referred by either party to Conciliation to be conducted through Independent Experts Committee (IEC) to be appointed by competent authority of BHEL from the BHEL Panel of Conciliators.

Notes:

- 1. No serving or a retired employee of BHEL/Administrative Ministry of BHEL shall be included in the BHEL Panel of Conciliators.
- 2. Any other person(s) can be appointed as Conciliator(s) who is/are mutually agreeable to both the parties from outside the BHEL Panel of Conciliators.

The proceedings of Conciliation shall broadly be governed by Part-III of the Arbitration and Conciliation Act 1996 or any statutory modification thereof and as provided in Procedure 2.3 to this GCC. The Procedure 2.3 together with its Formats will be treated as if the same is part and parcel hereof and shall be as effectual as if set out herein in this GCC.

The Contractor hereby agrees that BHEL may make any amendments or modifications to the provisions stipulated in the Procedure 2.3 to this GCC from time to time and confirms that it shall be bound by such amended or modified provisions of the Procedure 2.3 with effect from the date as intimated by BHEL to it.

Note: Procedure 2.3 that forms the part of Forms and Procedures is published as Chapter 9 in Volume IA Part II of this booklet (Volume-I Book-I).

2.21.3 No Interest payable to Contractor

Notwithstanding anything to the contrary contained in any other document comprising in the Contract, no interest shall be payable by BHEL to Contractor on any moneys or balances including but not limited to the Security Deposit, EMD, Retention Money, RA Bills or the Final Bill, or any amount withheld and/or appropriated by BHEL etc., which becomes or as the case may be, is adjudged to be due from BHEL to Contractor whether under the Contract or otherwise.

SI No: 13

Procedure 2.3 that forms the part of Forms and Procedures is published as Chapter 9 in Volume IA Part II of this booklet (Volume-I Book-I).

SI. No.: 14

Existing format on Monthly Plan Review with Contractor, as available in Form No F-14 of Volume ID Forms and procedure stands Deleted. Form No.- F-14 (Rev 01) is enclosed.

SI No.: 15

Existing format on Monthly Performance Evaluation of Contractor, as available in Form No F-15 of Volume ID Forms and procedure stands Deleted. Form No.- F-15 (Rev 02) is enclosed.

SI No: 16

The RETENTION AMOUNT clause 2.22 published in General Conditions of Contract (Volume IC Book-II) is revised as under.

Void. (Explanation: Retention Amount is not applicable for this tender.)

SI. No.: 17

The chapter Reverse auction procedure published in 'Forms and Procedures' of Volume I Book-II stands deleted. 'Guidelines for Reverse Auction-2021' available in the website http://www.bhel.com -> Supplier Registration, shall be applicable.

SI. No.: 18

Existing format on BANK GUARANTEE FOR SECURITY DEPOSIT as available in Form No F-11 (Rev 00) of Volume ID Forms and Procedure stands deleted. Refer Proforma of Bank Guarantee (in lieu of Security Deposit)- Form WAM 22 provided as Volume IA Part II Chapter 8

SI No.: 19

Void

SI No.: 20

Clause 2.15.5 of GCC in Extra Works is revised as under:

2.15.5: After eligibility of extra works is established and finally accepted by BHEL engineer / designer, payment will be released on competent authority's approval at the following rate.

MAN-HOUR RATE FOR ELIGIBLE EXTRA WORKS:

Single composite average labour man-hour rate, including overtime if any, supervision, use of tools and tackles and other site expenses and incidentals, consumables for carrying out any major rework / repairs / rectification / modification / fabrication as certified by site as may arise during the course of erection, testing, commissioning or extra works arising out of transit, storage and erection damages, payment, if found due will be at Rs 108/- per man hour.


VOLUME-IA PART – II CHAPTERS 2 to 9 Chapter 2 to 9 in next 167 pages as below

Description	Chapter No.	No. of Pages
Standard Specification For Preliminary Topographical	Chapter-2	50
Survey And Geotechnical Investigation Standard Specification For Bathymetric Survey	Chapter-3	06
Drawings	Chapter-4	04
"HSE Plan for Site Operations by Subcontractor" (Document No. HSEP: 14 Rev01)	Chapter-5	82
Format for Form no.: F-14 (Rev 01); Monthly Plan and Review with Contractors	Chapter6	05
Format for Form no.: F-15 (Rev 02); Monthly Performance Evaluation of contractor	Chapter-7	06
Pro forma for Bank Guarantee (in lieu of Security Deposit)	Chapter-8	03
Procedure 2.3-Procedure For Conduct Of Conciliation Proceedings	Chapter-9	11

BHARAT HEAVY ELECTRICALS LTD

STANDARD SPECIFICATION FOR PRELIMINARY TOPOGRAPHICAL SURVEY AND GEOTECHNICAL INVESTIGATION

SPECIFICATION NO. PE-TS-999-602-003 VOLUME IIB



APRIL, 2012

POWER SECTOR
PROJRCT ENGINEERING MANAGEMENT
PPEI BUILDING, PLOT NO: 25
SECTOR-16A
NOIDA, (U.P.) - 201301



STANDARD SPECIFICATION FOR PRELIMINARY TOPOGRAPHICAL SURVEY & GEOTECHNICAL INVESTIGATION

SPEC. NO.	PE-T	ΓS-999-6	02-003	
VOLUME	IIB			
SECTION	D			
REV. NO.	0	DATE	27.04.2012	
SHEET		1 O	F 49	

CONTENTS

Part-I Preliminary Topographical Survey

Clause	Description	Sheet
1.0	General	5
2.0	Scope	5
3.0	Specification	6
4.0	Carrying Out and Setting up of Bench Mark	
	and Reference Pillars	7
5.0	Topographical Survey and Mapping	8
6.0	Traversing	8
7.0	Contouring	9
8.0	Construction of Bench Mark & Reference	
	Pillar	10
9.0	Progress Report	10
10.0	Preparation & Submission of Survey Maps	11
11.0	Submission of Field Data and Report	11
12.0	Clearance of Jungles and Cutting of Trees	12
13.0	Inspection	12
Fig. 1	Bench Mark Pillar	13
Fig.2	Reference Pillar	14



STANDARD SPECIFICATION FOR PRELIMINARY TOPOGRAPHICAL SURVEY & GEOTECHNICAL INVESTIGATION

SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	2 OF 49

Part-II Preliminary Geotechnical Investigation

Clause	Description	Sheet
1.0	General	16
2.0	Scope	16
3.0	General Requirements	18
4.0	Codes and Standards	19
5.0	Field Investigation-Soil	22
6.0	Field Investigation-Rock	32
7.0	Laboratory Investigation	35
8.0	Report	39
9.0	Rates & Measurements	43
	ANNEXURE – A	46
	ANNEXURE – B	47
	ANNEXURE – C	48
	ANNEXURE – D	49



STANDARD SPECIFICATION FOR PRELIMINARY TOPOGRAPHICAL SURVEY & GEOTECHNICAL INVESTIGATION

SPEC. NO. PE-TS-999-602-003		
VOLUME	IIB	
SECTION	D	
REV. NO.	0 DATE 27.04.2012	
SHEET	3 OF 49	

STANDARD SPECIFICATION FOR PRELIMINARY TOPOGRAPHICAL SURVEY & GEOTECHNICAL INVESTIGATION

1.0 GENERAL

This specification covers the technical requirements for carrying out the following works for locating power plant and its allied systems.

- a) Part-1: Preliminary Topographical Survey
- b) Part-2: Preliminary Geotechnical Investigation

2.0 SITE

The site for carrying out the work shall be anywhere in the respective Power Sector Region (Northern/Southern/Eastern/Western Region) in India and shall be identified by BHEL during execution stage.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	4 OF 49

PART-I

PRELIMINARY TOPOGRAPHICAL SURVEY



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	5 OF 49

PART-1

PRELIMINARY TOPOGRAPHICAL SURVEY

1.0 GENERAL

1.1 This specification covers the technical requirements for carrying out a "Preliminary Topographical Survey and Allied Works" for locating power plant and its other systems. The work shall be executed in accordance with the specification and good standard of practice necessary to fulfil the objectives of the survey work strictly in accordance with the instruction and satisfaction of the engineer-in-charge.

2.0 SCOPE

- 2.1 The scope of work includes the following.
- 2.1.1 Carrying out topographical survey and preparation of plans (maps) and report of the entire area/areas indicated for locating the power plant and its other systems.
- 2.1.2 Carrying out bench mark (GTS/any other reference bench mark approved by the engineer-in-charge) to site/sites under survey by parallel levelling, establishing and constructing bench mark pillar and reference pillars in the field.
- 2.1.3 Spot level survey of the entire area/areas at specified interval(s) and development of contours.
- 2.1.4 Providing survey instruments, construction equipments, tools & plants, materials, labours, qualified surveyors, clearance of jungles, cutting of trees, earth work, scaffoldings, transport, supervision by competent engineers/surveyors, testing of materials, full insurance and all other incidental items as may be necessary for successful completion of the surveying, mapping and construction works etc.
- 2.1.5 Furnishing all field data and drawings on compact discs apart from hard copies.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	6 OF 49

2.1.6 Furnishing survey report as described in details in the succeeding paragraphs is also included in the scope of work.

3.0 SPECIFICATION

- 3.1 The work shall be executed according to the specification and good standard of practice necessary to fulfil the objectives of the survey work strictly in accordance with the instruction and satisfaction of the engineer-in-charge.
- 3.2 The specification shall be read in conjunction with the description of items in the schedule of quantities. The bidder shall refer to the employer for any discrepancy which may exist between drawings (if any), specification and corresponding items of the schedule for clarification before submission of quotation and the employer's decision as to the clarity of the point raised shall be final and binding on the bidder.
- 3.3 The work at site shall be carried out under the full time supervision by a qualified engineer or a senior surveyor. The engineer or senior surveyor shall be responsible for and capable of co-ordinating the work of the surveying teams, setting out the work accurately, identifying immediately and positively the type of instruments to be deployed and the methodology of surveying to achieve speed and accuracy in the work and shall be fully conversant with the theory and techniques of traversing, triangulation, spot levelling, survey work etc covered by this contract.
- 3.4 The contractor shall be responsible for the proper execution of the work to such lines and grades as specified in the specification, drawings and as directed by the engineer-in-charge from time to time.
- 3.5 After arrival of the instruments to site, these shall not be moved out of the site by the contractor without the prior written permission and approval of the engineer-in-charge. In case the instruments are moved out of the site without the prior written permission and approval, the engineer-in-charge/owner reserves the right to deduct from the contractor's bill(s) the amount as considered reasonable and or to withheld the payments for the work done. The decision of the engineer-in-charge in this regard shall be final and binding on the contractor.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	7 OF 49

4.0 CARRYING OUT AND SETTING UP OF BENCH MARK & REFERENCE PILLARS

- 4.1 The contractor shall carry out bench mark by fly-levelling from the nearest GTS bench mark or available source as approved by the engineer-in-charge and establish the same on a permanent bench mark to be constructed as per **Fig.1** at a convenient location(s) at site as per the instructions of the engineer-in-charge. All subsequent transfer of levels shall be carried out with respect to this bench mark.
- 4.2 The work shall also include constructing permanent reference pillars as per **Fig.2** at suitable locations as approved by the engineer-in-charge. These reference pillars shall be labelled permanently with their respective co-ordinates and reduced levels for future use. The bench mark and reference pillars shall be shown on the survey drawings.
- 4.3 The fly levelling should be carried out using two good quality levels simultaneously. The levelling instruments should always be kept free of collimation error which should be checked and adjusted before start of the work every day. A record of adjustments should be kept in the field book.
- 4.4 While carrying bench mark to the project site, levels shall be established on the permanent objects like culverts etc at least on one object in every 500m along the route with adequate description about the objects and levels to be mentioned in the level book/survey report to facilitate locating these objects later on. The route for transferring levels shall follow the existing roads as for as possible and this route shall require the approval of the engineer-in-charge before the commencement of work.
- 4.5 Closing error in levelling should be limited to $12 \sqrt{L}$ mm, where L is the length of the route in km.
- 4.6 Payment shall be made on the basis of shortest length of the said route measured between the original reference bench mark and the bench mark to be established at site.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	8 OF 49

5.0 TOPOGRAPHICAL SURVEY AND MAPPING

- 5.1 Positions both in plan and elevation of all natural and artificial features of the area like waterways, railway tracks, trees, cultivation, houses/any structure, fences, pucca and kutcha roads including culverts and crossings, foot tracks, other permanent objects like telephone posts and transmission towers etc are to be established and subsequently be shown on survey maps by means of conventional symbols (preferably symbols of Survey of India maps). All earth deposits, depressions, hills and valleys within the area/areas are to be surveyed and plotted on maps by contours. Necessary levelling work of the entire area/ areas are to be surveyed and plotted on maps by establishing horizontal location so that location and sketching of contours for the area/ areas can be done at specified intervals and in specified scales on maps. In case of steep slopes and dense jungle etc where griding is not possible, the method of survey, contour intervals etc shall be decided by the engineer-in-charge at site. Any unusual condition or formations on the ground, location of rock outcrops and springs/falls etc shall also be noted and plotted on the maps.
- 5.2 The field work shall be done with total station equipment in the following steps.
 - i) Establishing horizontal and vertical controls and locating reference grids and bench mark in the area.
 - ii) Surveying for establishing spot levels and plotting contours.
 - iii) Surveying for locating natural and man made details as described earlier.
- 5.3 The grids for the survey work shall be established in N-S & E-W direction corresponding to magnetic north or the plant north as directed by the engineer-in-charge.

6.0 TRAVERSING

6.1 Triangulation or traversing or a combination of both shall be adopted for the purpose of establishing horizontal control and in order to determine the exact relationship between various existing points on the ground so



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	9 OF 49

that surveys required under the present scope of work and in future may be co-related and tied together.

- 6.2 Total intelligent station instruments should be deployed to achieve the specified accuracy of the work. Proper precautions for avoiding graduation errors, instrumental and personal errors should be scrupulously observed.
- 6.3 From main traverse/triangulation station, subsidiary stations shall be established at suitable interval to cover the entire area. Level of these stations shall be based on the bench mark established in the survey area. Occupying the main and subsidiary stations, all major details shall be surveyed by total station equipment. Further classification of details if necessary shall be carried out by plane table method.
- 6.4 The closing error in traverse shall not exceed one in twenty five thousand (1 in 25000) in terms of length or $L\sqrt{N}$ seconds (total in angular measurement) whichever is less (where L is the least count of the instrument and N is the number of stations).

7.0 CONTOURING

- 7.1 Contractor shall carry out spot level surveying at an interval of 25m for contouring the area/areas. Levels shall also be taken on all traverse stations and on salient points located at random over the area (ground points). Contours are to be interpolated at 1m interval after the above points are plotted. The contours shall not be just interpolated but properly surveyed on the ground so that features falling between the two successive levels are also picked up. Sufficient points properly distributed over the entire area shall be located and levels taken so that accurate contouring can be done. At places of sharp curvature or abrupt change in direction and elevation, points selected shall be close to each other. Salient points on ridge lines and valley lines shall also be measured.
- 7.2 Levelling operation shall always start from main/subsidiary stations whose levels are based on the bench mark established in the survey area and end on the same.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	10 OF 49

7.3 Closing error in levelling shall not exceed the limit mentioned in clause 4.5.

8.0 CONSTRUCTION OF BENCH MARK & REFERENCE PILLAR

- 8.1 A bench mark pillar shall be constructed as per the sketch at **Fig-1** at location as directed by the engineer-in-charge. The reduced level of the top of hemispherical ball and co-ordinates with respect to survey grid shall be engraved clearly on the top of the bench mark pillar. The top surface of MS plate along with the hemispherical ball shall be painted with anticorrosive paint. The pillar should be white washed.
- 8.2 There shall be one reference pillar constructed within one meter distance of the bench mark pillar as per the sketch at **Fig-2**. The relation of reference pillar with respect to the bench mark pillar and survey grids should be established and indicated in the drawings. The reduced level and co-ordinates should be transferred and punched on the top of steel plate on the reference pillar. The top surface of MS plate shall be painted with anticorrosive paint. The pillar should be white washed.
- 8.3 The payment shall be made on the number of bench mark/reference pillars actually constructed at site as per the directions of engineer-incharge.

9.0 PROGRESS REPORT

- 9.1 The contractor shall prepare and submit progress report in three copies every week to the engineer-in-charge without fail indicating status of setting out of the grids, total area surveyed, grid pillars constructed, methodology adopted for surveying and instruments deployed including staff working on the site and difficulties encountered during execution of the work etc.
- 9.2 The submission of such reports and review thereof by the engineer-incharge shall not be deemed to absolve the contractor of his responsibility of timely completion of the assignment as per the time schedule indicated.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	11 OF 49

10.0 PREPARATION & SUBMISSION OF SURVEY MAPS

- 10.1 The contractor shall submit survey maps of the site in 1:1000 scale indicating grid lines and contour lines, demarcating all permanent features like roads, railways, waterways, buildings, power lines, natural streams, trees etc. Project area should have two originals, one showing spot levels and contours with grid lines and other with grid lines, contour lines and permanent features.
- 10.2 All the maps should be prepared in digitised forms using Inkjet/Pen plotter and standard computer software like Autocad 12/13/14 or auto civil on standard A-0 size polyester base film. The block of name plate of all the drawings should be as per BHEL standard.
- 10.3 The contractor shall submit three copies of all the maps for review and approval of the engineer-in-charge. After approval, six prints of all the final maps along with a set of originals on polyester base film and on a compact disc shall be submitted. Copies of the maps shall be submitted in proper flappers and original polyester base drawings should be handed over in proper card board covers indicating index of drawings.
- 10.4 Payment shall be made on the area actually surveyed as covered by the plan.

11.0 SUBMISSION OF FIELD DATA AND REPORT

- 11.1 Contractor shall submit all data pertaining to the survey in original to the engineer-in-charge.
- 11.2 All field data shall be submitted to the engineer-in-charge from time to time as per progress of the work.
- 11.3 Three copies of draft report shall be submitted on the completion of the field work for review and approval of the engineer-in-charge. The report should give the introduction of the site, methodology adopted for surveying the areas, calculation of errors, transfer of bench mark and any other calculation required for surveying and preparation of the survey maps.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	12 OF 49

- 11.4 The survey report should also cover the following.
 - General site observation such as location of access roads, river and nallah courses, irrigation canals etc.
 - Presence of any well and /or tube well in the site and water level in them shall also be indicated.
 - Whether there is any rock outcrops in the site.
 - Existing drainage pattern of the site, possibility of water logging and high flood level of the area.
- 11.5 Final survey report shall be submitted in six copies of standard A-4 size sheets properly bound and printed using good quality paper and material.

12.0 CLEARANCE OF JUNGLES AND CUTTING OF TREES

Clearance of jungles and cutting of trees as required to facilitate the survey work also form part of the contract. Necessary permission of concerned public bodies shall be secured by the owner. The contractor shall ensure that minimum amount of jungles are cleared and trees are properly cut under the direction of public bodies. The trees and jungles as cleared shall be stacked and handed over to the engineer-in-charge/owner. No extra payment is admissible under this account.

13.0 INSPECTION

The contractor shall make all arrangements of men, material, instruments, surveyors, necessary records and field data etc at the work site for checking of the work to the satisfaction of the engineer-in-charge or to his authorised representative during the progress and on successful completion of the work. The contractor shall intimate well in advance before final decamping from work site so that the final work can be inspected by the engineer-in-charge. This will form a part of acceptance of the work for release of payments.




 SPEC. NO. PE-TS-999-602-003

 VOLUME IIB

 SECTION D

 REV. NO. 0
 DATE 27.04.2012

 SHEET 13 OF 49

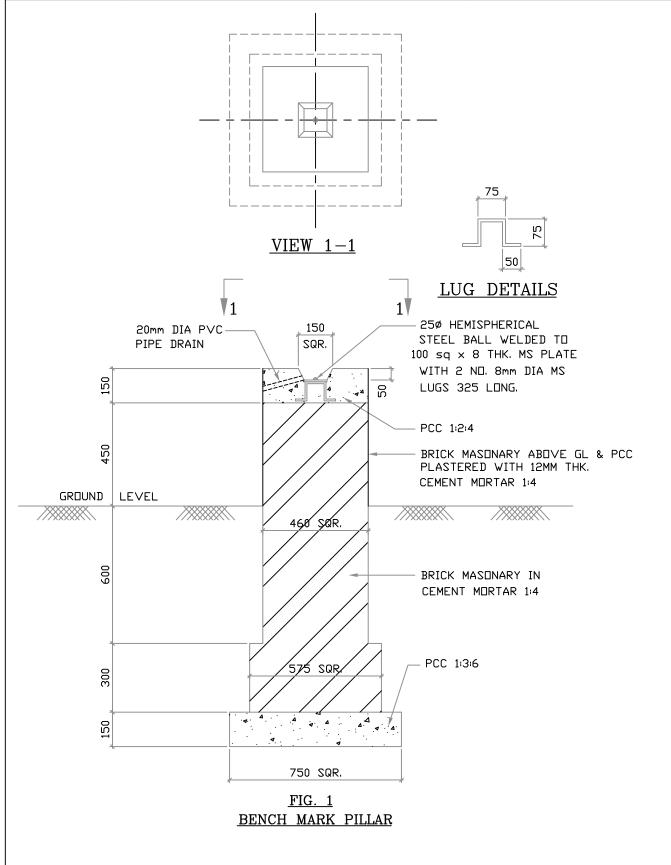

NOTES

- 1. ALL DIMENSIONS ARE IN MM
- 2. ALL MATERIALS AND WORKMANSHIP SHALL BE AS PER SPECIFICATION & RELEVANT IS CODES




 SPEC. NO. PE-TS-999-602-003

 VOLUME IIB

 SECTION D

 REV. NO. 0 DATE 27.04.2012

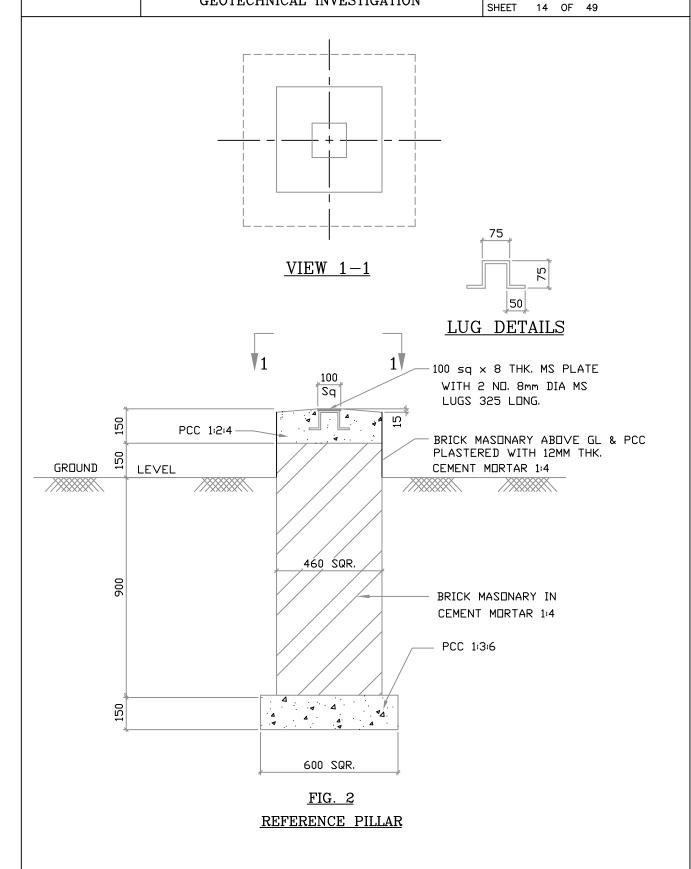

NOTES

- 1. ALL DIMENSIONS ARE IN MM
- 2. ALL MATERIALS AND WORKMANSHIP SHALL BE AS PER SPECIFICATION & RELEVANT IS CODES



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	15 OF 49

PART-2 PRELIMINARY GEOTECHNICAL INVESTIGATION



SPEC. NO. PE-TS-999-602-003	
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	16 OF 49

PART-2

PRELIMINARY GEOTECHNICAL INVESTIGATION

1.0 GENERAL

1.1 This specification covers the technical requirements for a "Preliminary Geotechnical Investigation and submission of a Geotechnical Report". The geotechnical investigation shall be carried out onshore to provide the designer with sufficiently accurate information both general and specific about the substrata profile and relevant soil and rock parameters at site on the basis of which the foundation for various structures and equipments of the power station can be designed rationally. Such structures would include main power house, chimney, boiler foundation, turbo-generator foundation, foundation for vibratory equipments, deep pits, reservoir, ash pond, pipe supports and all other related structures of the power station etc. The above list is indicative and not exhaustive. The range of load intensities from the various structures are expected to be between 50 kN/sqm and 600 kN/sqm.

2.0 SCOPE

2.1 The work shall include mobilization of all necessary equipments, providing necessary engineering supervision and technical personnel, skilled and unskilled labours, arranging water for drilling etc as required to carry out the entire field as well as laboratory investigation, analysis and interpretation of test data collected and preparation of a geotechnical report. The entire field as well as laboratory investigation work shall be supervised by a graduate in civil engineering with atleast 5 years of site experience in respective areas of geotechnical investigation work. A geologist shall also be deputed at site during investigation whenever rock drilling is undertaken. The scheduling of laboratory tests, analysis and interpretation of test results, drafting of report and recommendations shall be carried out by a post graduate in geotechnical engineering with atleast 5 years of experience.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	17 OF 49

- 2.2 The contractor shall make his own arrangements for locating the coordinates and position of bore holes, trial pits and other field tests as per the drawings/sketches supplied to him and for determining the reduced levels at these locations with respect to a single bench mark indicated by the engineer-in-charge. Two established reference lines will be indicated to him. The contractor has to provide at site all the required survey instruments to the satisfaction of the engineer-in-charge so that the work can be carried out accurately according to the specification and drawings.
- 2.3 All the field data shall be recorded in the proforma as recommended in relevant Indian Standard Codes and the field records shall be countersigned by the engineer-in-charge. The contractor shall submit two copies of the field borelogs to the engineer-in-charge soon after the completion of each bore hole. All the investigations are to be carried out by the contractor as per the priority requirements of the engineer-in-charge.
- 2.4 Whenever the contractor is unable to extract undisturbed samples he should immediately inform the engineer-in-charge. In such a case payment for boring charges shall be subject to the engineer-in-charge being satisfied that adequate effort has been made to extract undisturbed samples.
- 2.5 All the laboratory test data shall be recorded in the proforma as recommended in the Indian Standard Codes and a copy of these shall be sent to the engineer-in-charge every week during the progress of laboratory testing. Whenever desired during the progress of work the owner/engineer-in-charge may be present at the laboratory where the contractor is arranging for execution of laboratory tests.
- 2.6 The contractor shall interact with the engineer-in-charge to get acquainted with the different type of structures envisaged and in assessing the load intensities on the foundations for the various structures of the power project in order to enable him to make specific recommendation for the depth & type of foundation and the allowable bearing pressure. The contractor shall submit the final geotechnical investigation report after incorporating the comments (if any) on the draft report.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	18 OF 49

3.0 GENERAL REQUIREMENTS

- In areas which have already been developed, the contractor shall take advantage of existing local knowledge, record of trial pits, bore holes etc in the vicinity and the type of foundation adopted and behaviour of existing structures particularly those of similar nature to the ones proposed for this project.
- 3.2 The contractor shall make use of information gathered from quarries, unlined wells, cuttings from nearby areas etc. The general topography of the near by areas will often give some indication about the variation of the soil/rock conditions which are likely to exist.
- 3.3 The contractor shall gather data regarding the removal of overburden by excavation, erosion or land slides in the areas which may give an idea of the amount of reconsolidation that the soil strata has undergone. Similarly data regarding recent fills shall also be studied to determine the characteristics of the fill as well as the original strata.
- 3.4 The water level in streams and water courses if any in the neighbourhood shall be noted. Reliable information regarding ground water level shall also be gathered from water level in the near by wells.
- 3.5 The contractor shall make enquiries and verify regarding earlier use of the site which can have an important bearing on its suitability for the proposed structures. This is important particularly in areas where there have been underground works e.g. worked out ballast pits, quarries, old brick fields, mines, mineral workings etc. The possibility of damage to the structures, sewers, conduits and drainage system by subsidence shall also be investigated.
- 3.6 It is essential that the equipments/instruments are properly calibrated at the commencement of the work so that they represent true values and submit the test reports to the engineer-in-charge. If the engineer-in-charge so desires, the contractor shall arrange for having the instruments tested in presence of the engineer at an approved laboratory at the contractor's cost and the test reports shall be submitted to the engineer-in-charge.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	19 OF 49

4.0 CODES AND STANDARDS

- 4.1 All standards, specification and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions.
- 4.2 In case of conflict between this specification and those (IS codes and standards etc) referred to herein the former shall prevail.
- 4.3 All work shall be carried out as per the specification and as per the following standards and codes.
 - IS: 1080 Code of practice for design and construction of simple spread foundations
 - IS: 1498 Classification and identification of soils for general engineering purposes
 - IS: 1892 Code of practice for subsurface Investigation for foundation
 - IS: 1904 Code of practice for design and construction of foundations in soils: General requirements
 - IS: 2131 Method of standard penetration test for soils
 - IS: 2132 Code of practice for thin walled tube sampling of soils
 - IS: 2720 Method of test for soils (Relevant parts)
 - IS: 2809 Glossary of terms and symbols relating to soil engineering
 - IS: 2911 Code of practice for design and construction of pile foundations (Relevant parts)
 - IS: 2950 Code of practice for design and construction of raft foundation



 SPEC. NO. PE-TS-999-602-003

 VOLUME IIB

 SECTION D

 REV. NO. 0 DATE 27.04.2012

 SHEET 20 OF 49

EUIECI	INICAL INVESTIGATION	
IS: 3025	Methods of sampling and testing (Physical and chemical) for water used in Industry	
IS: 3043	Code of practice for earthing	
IS: 4078	Code of practice for indexing and storage of drill cores	
IS: 4453	Code of practice for exploration by pits, trenches, drifts and shafts	
IS: 4464	Code of practice for presentation of drilling information and core description in foundation investigation	
IS: 4968 Part -II	\mathcal{E}	
IS: 5313	Guide for core drilling observations	
IS: 6065	Recommendation for the preparation of geological and geotechnical maps for river valley project	
IS: 6403	Code of practice for determination of allowable bearing pressure on shallow foundation	
IS: 6926	Code of practice for diamond core drilling for site investigation of river valley projects	
IS: 6935	Method of determination of water level in a bore hole	
IS: 6955	Code of practice of subsurface exploration for earth and rockfill dams	
IS: 7422	Symbols and abbreviations for use in geological maps, sections and subsurface exploratory logs (Relevant parts)	
IS: 8009 Part-I	Code of practice for calculation of settlement of foundation subjected to symmetrical vertical loads - Shallow foundations	

IS: 8009 Code of practice for calculation of settlement of



 SPEC. NO. PE-TS-999-602-003

 VOLUME IIB

 SECTION D

 REV. NO. 0 DATE 27.04.2012

 SHEET 21 OF 49

JEUTEUN	NICAL INVESTIGATION STEEL 27 97 97
Part-II	foundation subjected to symmetrical vertical loads – Deep foundations
IS: 9143	Method for the determination of unconfined compressive strength of rock materials
IS: 9179	Method for preparation of rock specimen for laboratory testing
IS: 9198	Compaction rammer for soil testing
IS: 9214	Determination of modulus of sub-grade reaction in field
IS: 9259	Specifications for liquid limit apparatus
IS: 9640	Specifications for split spoon sampler
IS: 9669	Specifications for CBR mould and its accessories
IS: 10060	Code of practice for subsurface investigation for power house sites
IS: 10074	Specification for compaction mould assembly for light and heavy compaction
IS: 10108	Code of practice for sampling by thin wall sampler with stationary piston
IS: 10589	Equipment for determination of subsurface sounding of soils
IS: 10837	Specifications of moulds for determination of relative density and its accessories
IS: 11229	Specifications for shear box testing of soils
IS: 11315 Part-II	Description of discontinuities in rock mass - Core recovery and rock quality



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	22 OF 49

IS: 12070 Code of practice for design and construction of shallow foundations on rocks

5.0 FIELD INVESTIGATION - SOIL

5.1 Boring

5.1.1 General Requirements

- a) Bore holes shall be drilled at specified locations to obtain information about the sub-soil profile, its nature, strength and to collect soil samples for strata identification and conducting laboratory tests. The minimum diameter of the bore hole shall be 150 mm and boring shall be carried out in accordance with the provisions of IS: 1892 and as per this specification.
- b) All bore holes shall extend up to the depths shown on the construction drawings or as directed by the engineer-in-charge. If the strata with standard penetration test (SPT) 'N' value greater than 100 with characteristics of rock is met with earlier, the bore hole shall be advanced further by chiselling. Chiselling shall be continued for a maximum depth of 20 cm or upto 2 hours whichever is earlier. During chiselling rock fragments/rock cores shall be collected. Identification of rock strata shall be on the basis of visual examination of SPT sample and rock fragments. After it is established that rock is met with, the borehole shall be advanced further by drilling in rock as specified in Clause: 6.0 and cores shall be collected. When the bore hole is terminated in soil strata, an additional standard penetration test shall be carried out at the termination depth.
- c) Casing pipe shall be used in the borehole to support its sides when side fall is suspected to occur inside the borehole. When casing pipe is used, it shall be ensured that its bottom end is at all times 15 cm above the bottom of the bore hole. In case of cohesionless soils the advancement of the casing pipe shall be such that it does not disturb the soil to be tested or sampled. The casing shall be advanced by slowly turning the casing pipe and not by driving.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	23 OF 49

- d) In-situ tests and collection of undisturbed samples (UDS) shall be carried out at regular intervals and at change of strata or as decided by the engineer-in-charge. Representative disturbed and undisturbed samples shall be preserved for conducting various tests in the laboratory. Water table in the borehole shall be carefully recorded and reported. No water/drilling mud shall be added while boring above ground water table. For cohesionless soil below water table, the water level in the borehole shall all times be maintained at slightly above the water table.
- e) The bore hole shall be cleaned using suitable tools up to the depth of testing or sampling ensuring that there is minimum disturbance of soil at the bottom of the bore hole. The process of jetting through an open tube sampler shall not be permitted. In cohesive soils, the borehole may be cleaned using a bailer with a flap valve. Gentle circulation of drilling fluid shall be done when rotary mud circulation boring is adopted.
- f) On completion of the borehole, the portion drilled in soil shall be backfilled with sand unless otherwise directed by the engineer-incharge.
- g) Wash boring shall not be adopted.

5.1.2 Auger Boring

Auger boring can be adopted in soft to stiff cohesive soils above water table. Augers shall be of helical or post hole type which may be manually or power operated. While boring care shall be taken to minimise the disturbance to the deposits below the bottom of the borehole. The cuttings brought up by the auger shall be carefully examined in the field and the description of all the strata shall be duly recorded in the field borelog as per IS:1498. No water shall be used while auger boring.

5.1.3 Shell and Auger Boring

Shell and Auger boring can be used in all types of soil free from boulders. For cohesionless soil below ground water table, the water level in the bore hole shall always be maintained at or above the



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	24 OF 49

ground water level. The use of chisel bit shall be permitted in hard strata with SPT-N value greater than 100. Chisel bits may also be used to extend the borehole through local obstruction such as old construction, boulders, rocky formations etc. All other requirements in clause 5.1.2 shall apply for this type of boring also.

5.1.4 Percussion Drilling

This method can be adopted in soil with gravel and boulders when the boring has to be done at a faster rate. This method consists of breaking of the strata by repeated blows from a chisel or drilling bit and bailing out the debris at intervals by adding water into the bore hole. This method is not suitable for careful and very reliable sampling operation because of the disturbance caused during boring. This method shall not be adopted unless otherwise specified or permitted by the engineer-in-charge.

5.1.5 Rotary Mud Circulation Drilling

This method can be used in all types of soil below water table. In this method boring shall be done by rotating the bit fixed at the bottom of the drill rod. Proper care shall be taken to keep a firm contact between the bit and the bottom of the borehole. Bentonite or mud laden fluids shall be used as the drilling fluid to serve as the protective surface inside the borehole.

5.2 Standard Penetration Test (SPT)

This test shall be conducted in all type of soil deposits met within the bore hole to find the variation in the soil stratification by correlating with the number of blows required for unit penetration of a standard penetrometer. This test shall be conducted at every 1m interval alternate to collection of UDS upto 10m depth below ground level and at every at every 1.5m interval alternate to collection of UDS beyond 10m depth, at change of strata, at depths wherever undisturbed soil sample could not be collected and as per the direction of the engineer-in-charge. The starting depth of performing SPT shall be 1m below ground level. The depth interval between the top level of standard penetration test and to that of (next) undisturbed sampling shall not be less than 1m. The specification for equipments,



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	25 OF 49

accessories, procedure for conducting the test, presentation of test results and collection of disturbed soil samples etc shall conform to IS: 2131.

This test shall be carried out by driving a standard split spoon sampler in the borehole by means of a 63.5kg hammer having a free fall of 0.75m. The sampler shall be driven using the hammer for 450 mm penetration. While driving, the number of blows for every 150 mm penetration and the penetration for every 50 blows shall be recorded. The number of blows for the last 300 mm drive shall be reported as 'N' value. This test shall be discontinued when the blow count is equal to 100 and the penetration shall be recorded. Refusal shall be considered to be met with when the blow count is equal to 100. At the location where the test is discontinued, the penetration and the corresponding number of blows shall be reported. Sufficient quantity of disturbed soil samples shall be collected from the split spoon sampler for identification and laboratory testing. The samples shall be visually classified & recorded at site and shall be properly preserved and labelled for future identification & testing.

5.3 Sampling

5.3.1 General

- a) Sufficient number of soil samples shall be collected for reliable estimation of soil properties. The samples collected shall be either disturbed or undisturbed. Disturbed soil samples shall be collected for field identification and for conducting laboratory tests such as sieve analysis, index properties, specific gravity, chemical analysis etc. Undisturbed samples shall be collected to estimate physical, strength and settlement properties of the soil.
- b) All the accessories required for sampling and the method of sampling shall conform to IS:2132. All disturbed and undisturbed samples collected in the field shall be classified at site as per IS: 1498.
- c) All the samples shall be identified with date, bore hole or trial pit number, depth of sampling etc. It is also essential to mark an arrow pointing towards the top surface of the undisturbed sample as the soil



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	26 OF 49

was in-situ. Care shall be taken to keep the undisturbed soil samples vertically with the arrow directing upwards. The tube samples shall be properly trimmed at both ends and suitably sealed with molten paraffin wax at both ends immediately after extracting the samples from the bore hole/trial pit and suitably capped on both sides.

- d) When the contractor fails to collect undisturbed soil sample at a specified depth, the borehole shall be advanced by 0.50m and shall be performed with a standard penetration test. The reason for not obtaining the undisturbed soil sample shall be indicated in the borelog.
- e) Precaution shall be taken to ensure that there shall not be any change in moisture content and disturbance of the soil samples and they shall be placed in a temporary store at the end of the day's work. All the samples shall be kept over a bed of sand, jute bags, saw dust etc and covered over the top with similar material. The bed and top cover shall be kept moist till they are properly packed in wooden boxes. The contractor shall be responsible for packing and transporting of all the samples from site to the laboratory within seven days after sampling with proper protection against loss and damage.
- f) All the samples shall be suitably packed in wooden boxes using sand, saw dust etc all around the samples before transporting to the laboratory for testing.

5.3.2 Disturbed Samples

- a) Disturbed soil samples shall be collected from cuttings and from split spoon sampler in boreholes at regular intervals to provide complete description of soil profile and its variation. The samples shall be immediately stored in airtight jars or polythene bags and labelled with borehole/trial pit number and depth.
- b) In elevated areas, if superficial material is available in plenty, then bulk samples from a depth of about 0.5m below ground level shall be collected to establish all required properties to use it as a fill material. Disturbed samples weighing about 25kg shall be collected at shallow depths and immediately stored in polythene bags as per IS:



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	27 OF 49

1892. The bags shall be sealed properly and shall be kept in wooden boxes.

5.3.3 Undisturbed Samples

In each borehole undisturbed sample (UDS) shall be collected at regular interval of 1m alternate to conducting SPT upto 10m depth below ground level and at every 1.5m interval alternate to conducting SPT beyond 10m depth and as directed by the engineer-in-charge. The starting depth of collecting UDS shall be 2m below ground level and as directed by the engineer-in-charge. Undisturbed samples shall be of 100mm diameter and 450mm length. Samples shall be collected in such a manner that the structure of soil and its moisture content do not get altered. The specification for the accessories required for sampling and the sampling procedure shall conform to IS:1892 and IS:2132. Thin walled sampler shall be used to collect undisturbed samples by pushing the tube into the soil. The sampling tube shall have a smooth finish on both surfaces and minimum effective length of 450mm. The area ratio of sampling tubes shall be less than 12.5%. However in case of very stiff soils, area ratio upto 20% shall be permitted.

a) Undisturbed Sampling Using Thin Walled Sampler

Undisturbed samples shall be obtained using a thin walled sampler. In order to reduce wall friction, suitable precautions such as oiling the surfaces shall be taken. The bore hole shall be cleaned and the depth of sampling below ground level shall be noted. The sampler shall then be attached to the bottom of boring rods and lowered into the borehole. The sampler shall be pushed into the soil by hand or by jacking and soil sample of specified length shall be collected without disturbing the soil. The distance by which the sampler penetrates into the soil strata shall be checked. Care shall be taken to ensure that the sampler is not driven too far as this will compress the soil. The sampler shall be rotated to break the core at bottom of the sampler and then steadily drawn up.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	28 OF 49

b) Undisturbed Sampling Using Piston Sampler

Undisturbed samples in very loose saturated sandy & silty soils and very soft clays shall be obtained by using a piston sampler consisting of a sampling cylinder and piston system. In soft clays and silty clays with water standing in the casing pipe, piston sampler shall be used to collect undisturbed samples. During this method of sampling expert supervision is called for.

The interior surface of the sampler shall be smooth, clean and corrosion resistant. Its cutting edge and the ring seals shall be inspected for wear and rejected if worn. Check shall be done to ensure that the moving parts of the sampler function freely before the sampler is lowered into the borehole. While pushing the system into the soil and till the beginning of sampling operations, the bottom of the piston shall be flushed with the cutting edge of the sampler. At the depth of sampling, the piston should be fixed relative to the ground and the sampler cylinder shall be independently pressed down smoothly and continuously into the ground. If an obstruction is met, the sampler shall be withdrawn and another sample be taken after the obstruction is removed.

Accurate measurements of the depth of sampling, height of sampler, stroke and length of sample recovery shall be noted and recorded. After the sampler is pushed to the required depth, both the sampler cylinder and the piston system shall be drawn up together ensuring that there shall not be any disturbance to the sample which shall then be protected from changes in moisture content.

5.3.4 Relaxation During Sampling

- a) The sampler shall be pushed into the soil and driving of sampler shall be resorted to only when it cannot be pushed into the soil. This shall be done only with the permission of engineer-in-charge and all the details about the same shall be recorded in the bore logs.
- b) In clays when 'N' value is greater than 50, the undisturbed sampling may be replaced by standard penetration test.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	29 OF 49

5.4 Ground Water

- One of the following methods shall be adopted for determining the ground water table in bore holes as per IS:6935 and as per the instructions of the engineer-in-charge.
 - a) In permeable soils, the water level in borehole shall be allowed to stabilize after lowering it adequately by bailing. When water level inside the borehole is found to be stable, the depth of water level below ground level shall be measured. Stability of sides and bottom of the borehole shall be ensured at all times.
 - b) For both permeable and impermeable soils, the following method shall be suitable. The borehole shall be filled with water and then bailed out to various depths. Observation on the rise or fall of water level shall be made at each depth. The level at which neither a fall nor a rise is observed shall be considered as the water table elevation. This shall be established by three successive readings of water level taken at an interval of two hours.
- 5.4.2 In case any variation in the ground water level is observed in any specific boreholes then the water level in these bore holes shall be recorded daily during the course of field investigation. Levels in nearby wells, streams etc if any shall also be noted whenever these readings are taken.

5.4.3 Sub-Soil Water Samples

- a) Sub-soil water samples shall be collected for carrying out chemical analysis. Representative samples of ground water shall be collected when it is first encountered in boreholes before addition of water to aid boring or drilling. Water samples shall not be collected when bentonite slurry or mud has been used for drilling operations. If water has been added for drilling purposes or if ground water has been diluted by surface rain water then the bore hole shall be dewatered and water be allowed to rise from which the sample may be taken.
- b) The sampling apparatus shall be such that the water at the desired depth can be collected directly without any disturbance and any



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	30 OF 49

change in concentration of constituents like dissolved gases etc. Undue agitation shall be avoided. An ordinary suction pump with its suction end inserted upto the required depth in the borehole shall be used for this purpose.

- c) The sample shall be collected in a clean vessel and allowed to settle so that the supernatural liquid can be poured into a clean well rinsed glass or polythene bottle. Sufficient quantity and number of samples shall be collected to carry out the chemical analysis and sent to a laboratory in airtight bottles with proper labelling. Chemical analysis of water samples shall include determination of pH value, turbidity, sulphate, carbonate, nitrate & chloride contents, presence of organic matter and suspended solids etc.
- d) In some cases constituents may be mixed and analysed later as specified in the specific test methods. Chemical preservatives may be added to the sample for cases as specified in the test method/IS codes. This shall only be done if analysis cannot be conducted within an hour of collection and shall have the prior written permission and approval of the engineer-in-charge.

5.5 TRIAL PIT

5.5.1 Trial pits shall be of 3m x 3m size so as to permit easy access for visual examination of walls of the pit and to facilitate sampling and in-situ testing operations. Pits shall be excavated upto a maximum depth of 4m below ground level or as directed by the engineer-incharge. Precautions shall be taken to ensure the stability of pit walls including provision of shoring if necessary as per IS: 4453. Precautions shall be taken to prevent surface water draining into the pit. Arrangements shall be made for dewatering if the pit is extended below water table. Trial pits shall be kept dry and a ladder shall be provided for easy access to the bottom of the pit. In-situ tests shall be conducted and undisturbed samples shall be collected immediately on reaching the specified depth so as to avoid substantial changes in moisture content of the subsoil. Arrangements shall be made for barriers, protective measures and lighting necessary for the period the pits remain open.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	31 OF 49

- A note on the visual examination of soil strata shall be prepared. This should include the nature, colour, consistency and visual classification of the soil, thickness of soil strata, thickness of expansive soil and ground water table if any etc.
- Undisturbed samples shall be collected at 1m, 2m, 3m depth and at the termination depth in all the pits. Undisturbed tube samples shall be obtained by means of 100mm diameter thin walled sampling tubes with a cutting edge. The sampler shall be slightly oiled or greased inside and outside to reduce friction. The sampler shall be pushed into the soil and while doing so soil around the tube shall be carefully removed. In case it is not possible to push the sampler it may be driven by light blows from a "monkey".
- In case it is not possible to collect undisturbed samples in the pit, insitu density of soil shall be determined by sand replacement method. The specification, equipments, accessories etc required for the test and the procedure of testing shall be in accordance with IS: 2720, Part-XXVIII. No separate payment shall be made for this test.
- After the completion of testing, sampling and visual examination, the pit shall be suitably backfilled as directed by the engineer-in-charge. Unless otherwise specified excavated soil shall be used for this purpose.

5.6 **Dynamic Cone Penetration Test**

Dynamic cone penetration test shall be conducted using bentonite slurry by driving a standard size cone attached to the bottom of a string of drill rods. The test shall be conducted upto the specified depth or refusal whichever is earlier. Refusal shall be considered when the blow count exceeds 150 for 300mm penetration. The specification for the equipment and accessories required for performing the test, test procedure, field observations and reporting of results shall conform to IS:4968, Part-II. The driving system shall comprise of a 65kg weight having a free fall of 0.75m. The cone shall be of 65mm diameter provided with vents for continuous flow of bentonite slurry through the cone and rods in order to avoid friction between the rods and soil. On completion of the test, the results shall be presented as a continuous record of number of blows



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	32 OF 49

required for every 300mm penetration of the cone into the soil in a suitable chart supplemented by a graphical plot.

5.7 Electrical Resistivity Test

This test shall be conducted to determine the electrical resistivity of soil required for designing safety grounding system in the entire power plant area. The specification for the equipments and other accessories required for performing the test, test procedure and reporting of field observations shall conform to IS:3043. The test shall be conducted using Wenner's four electrode method as specified in IS:1892, Appendix-B2. Unless otherwise specified, at each test location the test shall be conducted along two perpendicular lines parallel to the co-ordinate axes. On each line, the electrode spacing shall be kept at 1m, 2m, 3m, 5m and 10m. Testing shall be done during the driest season prevalent in the area to the extent possible.

6.0 FIELD INVESTIGATION - ROCK

6.1 Rock Drilling

Drilling in rock shall be done at specified locations as per the directions of the engineer-in-charge. Before commencing drilling, it shall be proved that characteristics of rock has been met with as mentioned in clause 5.1.1(b). The starting depth of drilling in rock as mentioned in clause 5.1.1(b) shall be certified by the engineer-in-charge. The portion drilled in rock shall be backfilled with 1part of cement: 3 part of sand (1:3) grout unless otherwise directed by the engineer-in-charge.

6.1.1 Equipment

a) Core drilling shall be done by rotary motion using diamond bit. The feed or thrust to the drilling bit shall be actuated by hydraulic system. The rotary core drilling equipment and procedure for drilling shall conform to IS: 6926. The equipment shall be provided with necessary facilities to regulate the spindle speed, bit pressure and water pressure during core drilling to get a good core recovery.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	33 OF 49

b) Drilling shall be carried out with Nx size diamond tipped drill bits or impregnated diamond bits depending on the type of rock encountered. Double tube swivel core barrel of Type-B conforming to IS: 6926 shall be used to ensure a good core recovery and to pick up cores from all layers of rock. Suitable core catchers shall be used to ensure continuous and good core recovery.

6.1.2 Procedure

- a) The drilling fluid shall be clean water. Circulation of drilling fluid shall be started before the core barrel reaches the bottom of the hole to prevent cuttings or sludge from entering the core barrel at the start of coring. Drilling fluid shall be circulated continuously down the hollow rods and the sludge conveying the rock cuttings to the surface shall be collected.
- b) When drilling through soft/weathered/fractured rock, water circulation must be reduced so as to avoid shattering/breaking of core.
- c) The rotational speed of the bit (spindle speed), the amount of downward pressure applied on the bit (bit pressure) and water pressure shall be suitably adjusted and properly monitored so that the core is collected with least disturbance and to avoid shearing of the core from its base. Bit speed, bit pressure and water pressure for the type of bit for various rock types shall be as per Appendix-A of IS:6926.
- d) No drill run shall exceed 0.75m in length. This can be increased to 1.5m provided the core recovery observed is more than 80% in two successive 0.75m drill runs and on approval from the engineer-incharge. If the core recovery is less than 20% then SPT shall be performed before commencing the next drill run as explained in clause 5.2.
- e) If at any time blocking of the bit or grinding of the core is observed, the core barrel shall be immediately withdrawn from the borehole regardless of the length of drill run completed.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	34 OF 49

6.1.3 Observations

- a) The colour of return water at regular intervals, the depth at which any change of colour of return water is observed, the depth of occurrence and amount of flow of hot water if encountered shall be recorded.
- b) The depth through which an uniform rate of penetration was maintained, the depth at which a marked change in rate of penetration or sudden fall of drill rod occurs, the depth at which any blockage of drill bit causing core loss if any etc shall be recorded.
- c) Any heavy vibration or torque noticed during drilling should be recorded together with the depth of occurrence.
- d) Special conditions like the depth at which grouting was done during drilling, presence of artesian conditions, loss of drilling fluid, observation of gas discharge with return water etc shall also be observed and recorded.
- e) During drilling operation, observation on return water, rate of penetration etc shall be recorded in a proforma as given in IS: 5313, Appendix-A.

6.1.4 Core Samples

- a) Core samples shall be extracted by the application of a continuous pressure at one end of the core with the barrel held horizontally without vibration. Friable cores shall be extracted from the barrel directly into a suitable sized half round plastic channel section. Care shall be taken to maintain the direction of extrusion of sample same as that while coring to avoid stress reversal.
- b) Immediately after withdrawal from the core barrel, the cores shall be placed in a tray and transferred into boxes specially prepared for the purpose. The boxes shall be made from seasoned timber or any other durable material and shall be indexed on top of the lid as per IS:4078. The cores shall be numbered serially and arranged in the boxes in a sequential order. The description of the core samples shall be recorded as per IS:4464. Where no core is recovered, it



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	35 OF 49

shall be recorded as specified in the continuous record of core recovery and RQD in the corelog as per IS:11315, Part-II.

c) The basic information for the description of rocks shall cover i) degree of weathering ii) discontinuity spacing iii) strength iv) colour v) grain size vi) structural condition, the mineralogy of the grains and cementing material vii) rock name, special features like major joint planes, features/laminations, faults etc.

6.2 Standard Penetration Test

The relevant hardness of rocks shall be tested in boreholes after every drill run of 0.75m in rock if core recovery observed is less than 20% or as directed by the engineer-in-charge. The testing equipment and arrangement shall be conforming to IS: 2131. The number of blows for each 75mm penetration to a total penetration of 450mm shall be recorded. Penetration for every 50 blows shall be recorded and the test shall be stopped at a total of 100 blows for last 300mm or less penetration.

7.0 LABORATORY INVESTIGATION

7.1 Essential Requirements

- a) All laboratory tests shall be conducted in an approved laboratory using approved apparatus complying with the requirements and specifications of Indian standards or other approved standards for this class of work. It shall be checked that the apparatus are in good working condition before starting the laboratory tests. Calibration of all the instruments and their accessories shall be done carefully and precisely.
- b) Depending on the type of sub-strata encountered, appropriate laboratory tests shall be conducted on soil and rock samples collected in the field. Laboratory tests shall be scheduled and performed by qualified and experienced personnel who are thoroughly conversant with the work. Tests indicated in the schedule of items shall be performed on soil, rock and water samples as per relevant IS codes. One copy of all the laboratory test data records shall be submitted to the engineer-in-charge/owner



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	36 OF 49

progressively every week. Laboratory tests shall be carried out concurrently with field investigation since initial laboratory test results could be useful in planning the later part of field work. A schedule of laboratory tests shall be established by the contractor and the same shall be submitted and got approved by the engineer-in-charge before starting of laboratory tests.

- c) All samples whether undisturbed or disturbed shall be extracted, prepared and examined by a competent personnel properly trained and experienced in soil sampling, examination, testing and in using the apparatus as per the specified standards.
- d) Undisturbed soil samples retained in liners or seamless tube samplers shall be taken out without causing any disturbance to the samples using suitably designed extruder just prior to actual testing. If the extruder is horizontal, proper support shall be provided to prevent the sample from breaking. For screw type extruders the pushing head shall be free from the screw shaft so that no torque is applied to the soil sample in contact with the pushing head. For soft clay samples, the sample tube shall be cut by means of a high speed hacksaw to specified test length and placed over the mould before pushing the sample into it with a suitable piston.
- e) While extracting a sample from a liner or tube care shall be taken to see that its direction of movement is the same as that during sampling to avoid stress reversal.
- f) On all undisturbed soil samples tested for bulk density, water content, grain size distribution, liquid limit and plastic limit tests shall also be performed.
- g) On all rock samples tested for unconfined compression test, bulk density and water content tests shall also be performed.
- h) After completion of all tests, a summary of test results for each soil and rock sample shall be presented in a proforma as enclosed in **Annexure-A & B** respectively. Chemical test results on soil and water samples shall be furnished in a tabular form separately.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	37 OF 49

7.2 Tests

Tests as indicated in this specification and as called for by the engineer-in-charge shall be conducted. The tests shall include the following.

a) Tests on Undisturbed and Disturbed Soil Samples

- Visual and engineering classification
- Sieve analysis and hydrometer analysis
- Liquid, plastic and shrinkage limits
- Specific gravity
- Standard Proctor test
- Free swell index determination

b) Test on Undisturbed Soil Samples

- Bulk density and moisture content
- Relative density (for sand)
- Unconfined compression test
- Box shear test
- Triaxial shear test (unconsolidated undrained test on undisturbed / remoulded samples)
- One dimensional consolidation test

c) Test on Rock Samples

- Visual classification
- Water absorption, porosity and density
- Specific gravity



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	38 OF 49

- Unconfined compression test (both at saturated and an in-situ water content)

d)Chemical Analysis of Sub-soil and Ground Water

7.3 Salient Test Requirements

- a) Remoulded soil specimen whenever desired shall be fully reworked at field density and natural moisture content. For conducting triaxial test for dyke/road material, the sample shall be remoulded to 95% of standard proctor density.
- b)Triaxial shear test shall be conducted on undisturbed soil samples saturated by the application of backpressure. Only if the water table is at sufficient depth such that chances of its rising to the base of the footing are meagre or nil, the triaxial tests shall be performed on the specimens at natural moisture content. Each test shall be carried out on a set of three test specimens from one sample at cell pressures equal to 100, 200 and 300kN/sqm or as required depending on the soil conditions.
- c) Direct shear test shall be conducted on undisturbed soil samples. The three normal vertical stresses for each test shall be 100, 200 and 300 kN/sqm or as required depending on the soil conditions.
- d) Consolidation test shall have loading stages of 10, 25, 50, 75, 100, 200, 400 and 800 kN/sqm. Rebound curve shall be recorded for all the samples by unloading the specimen at the in-situ stress of the specimen. Additional rebound curves shall also be recorded whenever desired by the engineer-in-charge.
- e)Chemical analysis of sub-soil shall include determination of pH value, carbonate, sulphate (both SO₃ and SO₄), chloride and nitrate contents, organic matter, salinity and any other chemicals harmful to the foundation material. The contents in soil shall be indicated as percentage.
- f) Chemical analysis of sub-soil water sample shall include the determination of the properties such as colour, odour, turbidity, pH value and chemical contents such as carbonate, sulphate (both SO₃ and



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	39 OF 49

SO₄), chloride, nitrate, organic matter and any other chemicals harmful to the foundation material. The contents such as sulphate etc shall be indicated as ppm by weight.

8.0 REPORT

8.1 General

- a) On completion of all the field and laboratory works, the contractor shall submit a draft report containing geological information of the region, procedure adopted for investigation, field observations, summarised test data, conclusion and recommendations. The report shall include detailed borelogs, sub-strata profiles, field test results, laboratory observations and test results in both tabular as well as graphical forms, practical and theoretical considerations for the interpretation of test results, the supporting calculations for the conclusions drawn etc. Initially, the contractor shall submit three copies of the report in draft form for the engineer-in-charge/owner's review.
- b) After review of the draft report, the engineer-in-charge/owner's comments will be intimated to the contractor. The contractor shall incorporate the comments and after getting the amended draft report approved, five copies of the final report shall be submitted along with one set of reproducible of the graphs, tables etc. Any expenditure on account of redrafting, finalising the report etc shall be deemed to have been included in the quoted rates.
- c) The final report based on field observations, in-situ and laboratory tests shall encompass theoretical as well as practical considerations for foundation of different type of structures envisaged in the area under investigation. The contractor shall acquaint himself about the type of structures, foundation loads and other information required from the engineer-in-charge.

8.2 Data to be Furnished

The report shall also include but not be limited to the following.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	40 OF 49

- a) A plot plan showing the location and reduced levels of all field tests e.g. bore holes, trial pits, DCPT etc properly drawn to scale and dimensioned with reference to the established grid lines.
- b) Geological information of the area such as geomorphology, geological structure, lithology, stratigraphy and tectonic faults, seismicity of the region and site, core recovery and rock quality designation etc.
- c) Past observations and historical data if available for the area or for other areas with similar soil profile for similar structures in the surrounding areas.
- d) A true cross section of all individual boreholes and trial pits with reduced levels and co-ordinates showing the classification and thickness of individual stratum, position of ground water table, various in-situ tests conducted and samples collected at different depths and the rock stratum if met with.
- e) A set of longitudinal and transverse soil/rock profiles connecting various bore holes in order to give a clear picture of the variation of the subsoil strata as per IS: 6065.
- f) Water level contours and rock level contours
- g) Plot of standard penetration test 'N' values (both uncorrected and corrected) with depth for identified areas.
- h) Results of all field tests in tabular as well as in graphical forms.
- i) Results of all laboratory tests summarised (i) for each sample as well as (ii) a consolidated table giving the layer-wise soil and rock properties. All the relevant charts, tables, graphs, figures, supporting calculations, conclusions and photographs of representative rock cores and trial pits shall be furnished.
- j) For all triaxial shear tests, stress vs strain diagrams as well as Mohr's circle envelopes shall be furnished. If back pressure is applied for saturation, the magnitude of the same shall be indicated.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	41 OF 49

The value of modulus of elasticity 'E' shall be furnished for all tests along with relevant calculations.

k) For all consolidation tests the following curves shall be furnished.

e vs log P e vs P and

Compression vs log t or square root of t (depending upon shape of the plot for proper determination of coefficient of consolidation)

The point showing initial condition (eo, Po) of the soil shall be marked on the curves.

- l) Values of compression index, coefficient of volume compressibility etc shall be furnished. The procedure adopted for calculating the compression index from the field curve and settlement of soil strata shall be clearly specified. The time required for 50% and 90% primary consolidation along with secondary settlement if significant shall also be calculated.
- m) Values of cohesion, angle of internal friction and co-efficient of sub-grade reaction along with sample calculations. Calculation for allowable bearing pressures and corresponding total settlements for shallow foundations and load carrying capacity calculation of piles in various modes etc.
- n)Analysis and discussion of test results.

8.3 Recommendations

Recommendations shall be given areawise duly considering the type of soil/rock, structure, foundation type and ground water table etc in the area. The recommendations shall include but not be limited to the following.

a) Type of foundation to be adopted for various structures duly considering the sub-strata characteristics, water table, total settlement permissible for the structures and equipments, minimum depth and width of foundation etc.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	42 OF 49

- b) For shallow foundations the following shall be indicated with comprehensive supporting calculations.
- i) Net safe bearing pressure for isolated square/rectangular footings and continuous strip footings of sizes 1, 2, 3, 4 & 5m at different founding depths of 1, 2, 3, 4 & 5m below ground level considering both shear failure and settlement criteria giving reasons for the type of shear failure adopted in the calculation.
- ii) Net safe bearing pressure for raft foundation of widths greater than 6m at 2, 3, 4, 5 & 6m below ground level considering both shear failure and settlement criteria.
- c) If piling is envisaged the following shall be furnished with comprehensive supporting calculations.
- i) Type of pile and reasons for recommending the same duly considering the sub-strata characteristics.
- ii) Suitable founding strata for the pile.
- iii) Estimated length of pile for 800kN (450mm dia.), 1050kN (500mm dia.), 1500kN (600mm dia.) and 4500kN (1070mm dia.) capacities. End bearing and frictional resistance shall be indicated separately. Safe lateral and tensile load carrying capacities of pile with supporting calculations.
- iv) Magnitude of negative skin friction if any.
- d) Cone resistance, frictional resistance, total resistance and settlement analysis for different size of foundations.
- e) Electrical resistivity of sub-soil based on electrical resistivity tests including electrode spacing vs cumulative resistivity curves.
- f) Suitability of the soil for construction of roads and embankments, their stable slopes for shallow and deep excavations, active and passive earth pressures, earth pressure at rest and modulus of elasticity as a function of depths for the design of underground structures etc.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	43 OF 49

- g) Suitability of locally available soil at site for filling and back filling purposes.
- h) If expansive soil is met with, then recommendation on removal or retainment of the same under the structures/roads etc shall be given. In the latter case, detailed specifications of any special treatment required including specification for materials to be used, construction method, equipments to be deployed etc shall be furnished.
- i) Protective measures based on chemical nature of soil and ground water with due regard to the potential deleterious effects on concrete, steel and other building materials etc. Remedial measures for sulphate attack and acidity shall be dealt in detail.
- j) Susceptibility of sub-soil strata to liquefaction in the event of earthquake. If so, recommendation for remedial measures.
- k) Identification of any other potential geotechnical problems and their remedial measures.
- 1) Description of measures required for erosion control.
- m) Identification of corrective measures required for the improvement of sub surface conditions such as removal of poor sub soil/material and in-situ densification etc. If ground improvement is recommended then its detailed specification, specification for the materials to be used, construction methodology, equipments to be deployed etc shall be furnished.

9.0 RATES & MEASUREMENTS

9.1 RATES

a) The item of work in the schedule of quantities describe the work very briefly. The various items of the schedule of quantities shall be read in conjunction with the corresponding sections in the technical specification including amendments and additions if any. For each item in the schedule of quantities, the bidder's rate shall include all



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	44 OF 49

the activities covered in the description of the items as well as for all necessary operations in detail described in the technical specification.

- b) The rates quoted are for any site within the said Power Sector Region with 'as is where is' basis.
- c) The unit rates quoted shall include minor details which are obviously and fairly intended and which may not have been included in these documents but are essential for the satisfactory completion of the work.
- d) The bidders quoted rates shall be inclusive of providing all equipments, men, materials, skilled and unskilled labours, making observations, establishing the ground level and co-ordinates at location of each bore hole, trial pit, field test etc by carrying levels from one established bench mark and distances from one set of grid lines furnished by the engineer-in-charge. Also no extra payments shall be made for conducting the standard penetration tests, collection, packing and transportation of all the samples and cores, recording of all results and submitting them in approved formats etc.
- e) The quoted rates for trial pits shall be inclusive of dewatering and backfilling etc.
- f) The quoted rates for drilling in rock shall satisfy the requirements as furnished in specification.
- g)The rates quoted for laboratory tests shall include preparation of samples, performing tests, recording, analysis and submission of data etc.
- i) The bidder shall submit a scheme showing the arrangement and equipments proposed to be used for conducting the site work along with rates. However the minimum number of staff and equipments to be deployed/mobilised for site works shall be as per **Annexure-C & D** respectively.



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	45 OF 49

9.2 **MEASUREMENTS**

- a) All measurements shall be in SI Units.
- b) Length shall be measured in metre(m) correct to two place of decimals. Area shall be worked out in square metre(Sqm) and volume in cubic metre(Cum) rounded off to two decimals.
- c) Certain tests have to be conducted in the bore holes and trial pits etc. Such bore holes and trails pits etc shall be measured once only and not again just because the tests are conducted therein.
- d) The depth of penetration due to SPT at the bottom of bore hole shall not be considered for the measurement of bore hole depth.
- e) Pits shall be measured in Cum.
- f) Coring in rock with diamond bit shall be measured in length correct to two places of decimal for the actual cored length satisfying the criteria as per specification.



SPEC. NO.	PE-TS-9	999-602	-003		
VOLUME	IIB				
SECTION	D				
REV. NO.	0	DATE	27.04.20	12	
SHEET	46	OF	49		

ANNEXURE - A SUMMARY OF LABORATORY TEST RESULTS ON SOIL SAMPLES

				DENS (kN/C					TICL E (%)		ATTI	ERBEF	RG'S LI	MITS		SOII	-		RENO TEST	GTH [(CON		IDA ST	TION	I	SWELL TEST		/IPAC			
BORE HOLE/ TRIAL	NO.	DEPTH (m)	TYPE OF SAMPLE	BULK	H L	 	GRAVEL	SAND	SILT	CLAY	LL	PL	PI	SL	IS CLASSIFICATION	DESCRIPTION	SPECIFIC GRAVITY	TYPE	C	Φ	e°	Pc	Cc	d	m,	Cv	FSI	MDD	OMC	CBR	RELATIVE DENSITY	REMARKS

For type of sample								For other tests											p m	Pressure range (kN/Sq.m) Coefficient of volume						
DS	Dist	urbed so	oil sar	nple					LL		Liaui	id Lir	nit (%)						m_v					m/kN)	
UDS		sturbed		•	le				PL			tic Li	•	•						Cv					nsolidatio	
RMS	Ren	oulded	soil s	ampl	е				PΙ		Plas	ticity	Inde	x (%)								(So	q.m/r	nr)	
WS	Wat	er samp	le	•					SL		Shrir	nkag	e lim	it (%))					MDD	Max	imun	n Dry I	Dens	ity (kN/Cı	
									С		Cohe	esior	ı (kN	/Sq.	m)					OMC	Opti	mum	moist	ure o	content (%	
For stre	ngth tes	<u>t</u>							φ Angle of internal friction (degrees)									CBR	Cali	fornia	a Bear	ing F	Ratio (%)			
UCC	Unc	onfined	comp	ressi	on te	est			FSI Free swell index (%)																	
Tuu	Unc	onsolida	ted u	ndrai	ined	triaxia	l test		e _o Initial Void ratio																	
(Note:	Replace	T by D	for Di	rect S	Shea	r test)			Pc Preconsolidation pressure (kN/Sq.m)									n)								
•	•	•				,			Сс		Com	pres	sion	inde	ex	•		-	•							
												•														



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	47 OF 49

ANNEXURE-B

SUMMARY OF LABORATORY TEST RESULTS ON ROCK CORE SAMPLES

BORE HOLE NO.	
BORE HOLE NO.	
DEDELL	
DEPTH	
GODE DIEGELIA	
CORE PIECE NO.	
MOISTURE CONTENT	
SPECIFIC GRAVITY	
POROSITY	
DRY DENSITY	
DEFORMABILITY	
(DRY /SATURATED)	
(DR1/SATURATED)	
UNCONFINED	
COMPRESSIVE	
STRENGTH	
(INSITU/SATURATED)	
CORE DESCRIPTION	
REMARKS	
L	



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	48 OF 49

ANNEXURE-C

MINIMUM STAFF TO BE DEPLOYED

<u>S.No.</u>	Description	No. of persons
1.	Geotechnical Engineer	01
2	Engineering Geologist	01
3.	Engineer/Senior Surveyor	01
4.	Supervisor	01
5.	Rig Operator	01
6.	Mechanic	01



SPEC. NO.	PE-TS-999-602-003
VOLUME	IIB
SECTION	D
REV. NO.	0 DATE 27.04.2012
SHEET	49 OF 49

ANNEXURE-D

LIST OF EQUIPMENTS TO BE MOBILISED TO SITE (MINIMUM)

<u>S.No.</u>	Description	Quantity
1	Shell and auger boring set	01
2.	Rotary core drilling unit (Hydraulic feed)	01
3.	Dynamic cone penetration test equipment	01
4.	Electrical resistivity test set up	01
5.	Total station	01
6.	Auto Level	01

Note:

Additional equipments shall be mobilized if required as per the directions of the engineer-in-charge to match the work schedule.



SPEC. NO.	PE-	DC-N80-	601-C002
VOLUME	II		
SECTION	D		
REV. NO.	0	DATE	05.01.2021
SHEET	1	OF	7

STANDARD SPECIFICATION FOR BATHYMETRIC SURVEY

1.0 GENERAL

- 1.1 NLC India Ltd. (NLCIL) formerly Neyveli Lignite Corporation Limited is a 'Navratna', Government of India Enterprise engaged in mining of lignite and generation of power through lignite based thermal power plants. NLCIL have now taken up implementation of Coal based pit head type NLC Talabira Thermal Power Project, consisting of three (3) supercritical units of 800 MW capacity each, near Kumbhari & Tareikela villages in Jharsuguda District, Odisha. Development Consultants Private Limited (DCPL) has been appointed as the Consultant for the project.
- 1.2 This specification covers the technical requirements for carrying out "Bathymetric Survey" for the entire area/areas indicated for locating the raw water intake pipe line, intake pump house and bridge across Bhedan river and other system etc. The work shall be executed in accordance with the specification and good standard of practice necessary to fulfil the objectives of the survey work strictly in accordance with the instruction and satisfaction of the engineer-in-charge.

2.0 SCOPE

- 2.1 The scope of work includes but not limited to the following.
- 2.1.1 Carrying out bathymetric survey (Digital depth & positions data collection by digital echo-sounder, satellite base GPS and computer based data collection software) along the specified chainage/intervals, preparation of plan, cross sections, longitudinal sections (maps) and report of the entire areas indicated for locating the raw water intake pipe line, intake pump house and bridge across Bhedan river and other systems etc.
- 2.1.2 Establishing water level using water level gauges.
- 2.1.3 Spot level survey on land for the area at specified intervals and development of plan, cross section, longitudinal section.
- 2.1.4 Providing necessary equipment/instruments, tools & plants, materials, labours, qualified engineer/surveyors including all other incidental items as may be required for successful completion of the surveying, mapping etc.
- 2.1.5 Necessary site clearance, earth work, scaffolding, transportation/ navigation, testing of materials, insurance, approvals etc as may be required.



SPEC. NO.	PE-	DC-N80-	601-C002
VOLUME	II		
SECTION	D		
REV. NO.	0	DATE	05.01.2021
SHEET	2	OF	7

- 2.1.6 Furnishing all data and drawings on CDs apart from hard copies.
- 2.1.7 Furnishing survey report as described in details in the succeeding paragraphs is also included in the scope of work.

3.0 TENDER DRAWING

- 3.1 The enclosed Bathymetric Survey Layout indicate the tentative location of the area/areas to be surveyed. The location/area(s) indicated in the drawing are subject to change that may be necessary during actual execution of the work. The work shall be carried out as per the instruction of the engineer-in-charge.
- 3.2 The bidder must visit the site prior to submitting his/her quotations to acquaint himself fully with the nature, type, scope of work and involvement therein. The rates quoted shall remain firm during the entire period of execution till completion of the work and any additional claim for lack of knowledge shall not be entertained.

4.0 SPECIFICATION

- 4.1 The work shall be executed in accordance with the specification and good standards of practice necessary to fulfil the objectives of the survey work and as per the instruction of the engineer-in-charge.
- 4.2 The specification shall be read in conjunction with the description of items in the schedule of quantities. The bidder shall refer to the employer for any discrepancy which may exist between the drawings, specification and corresponding items of the schedule for clarification before submission of quotation and the employer's decision as to the clarity of the point raised shall be final and binding on the bidder.
- 4.3 The work at site shall be carried out under the full time supervision by a qualified engineer or a senior surveyor. The engineer or senior surveyor shall be responsible for and capable of co-ordinating the work of the surveying teams, setting out the work accurately, identifying immediately and positively the type of instruments to be deployed and the methodology of surveying to achieve speed and accuracy in the work and shall be fully conversant with the theory and techniques of survey work etc. covered in this contract.
- 4.4 The contractor shall be responsible for the proper execution of the work to such lines and grades as specified in the specification, drawings or as directed by the engineer-in-charge from time to time.



SPEC. NO.	PE-DC-N80-601-C002		
VOLUME	II		
SECTION	D		
REV. NO.	0	DATE	05.01.2021
SHEET	3	OF	7

- 4.5 Men, materials, instruments/equipment etc. mobilised to the site shall not be demobilised by the contractor without prior written permission and approval of the engineer-in-charge. In case the instruments are moved out of the site without the prior written permission and approval, the engineer-in-charge/owner reserves the right to deduct from the contractor's bill(s) the amount as considered reasonable and or to be withheld the payments for the work done. The decision of the engineer-in-charge in this regard shall be final and binding on the contractor.
- 4.6 The contractor shall carry out survey from available reference bench mark at project site or nearby project site at his own cost in consultation of engineer-in-charge and transfer of levels shall be carried out by fly-levelling with respect to this bench mark. The correctness of the levels marked on bench mark shall be examined by contractor and approval on the same shall be taken from BHEL and NLCIL (owner) before starting the work.
- 4.7 Closing error in levelling should be limited to I2 \sqrt{L} mm, where L is the length of the route in km.

5.0 BATHYMETRIC SURVEY

- 5.1 The bidder shall establish the river bed levels and water levels in Bhedan river and other water submerged areas. Survey stations shall be established at suitable locations from where exact location of data collection positions inside the submergence area shall be correctly established.
- 5.2 The bidder shall carry out survey by digital echo-sounder supported by GPS and computer based data collection software. In river and water submerged areas, the bed levels shall be taken at 10m interval in the specified area subject to the condition that no important feature of the bed is missed out. The bed levels at locations as described above shall be observed and plotted on plan. Longitudinal section (LS) and Cross section (CS) shall be provided as specified. In LS and CS, grid points including spot level/bed level, water level, base line of survey work and any other important structures within the vicinity shall be depicted.
- 5.3 LS along river and other water submerged areas shall be provided at every 100m interval including one at starting chainage and one at the end chainage.
- 5.4 CS across river and other water submerged areas shall be provided at every 100m interval including one at starting chainage and one at the end chainage.

6.0 ONSHORE (ON LAND) TOPOGRAPHICAL SURVEY

6.1 The field work shall be done with total station equipment in the following steps.



80-601-C002
TE 05.01.2021
7

- i) Establishing horizontal and vertical controls
- ii) Surveying for establishing spot levels at 10m interval
- iii) Surveying for locating natural/manmade structures, trees, nallah etc.
- 6.2 The grids for the survey work shall be established in N-S & E-W direction corresponding to magnetic north or the plant north as directed by the engineer-in-charge.

7.0 TRAVERSING

- 7.1 Triangulation or traversing or a combination of both shall be adopted for the purpose of establishing horizontal control and in order to determine the exact relationship between various existing points on the ground so that surveys required under the present scope of work and in future may be co-related and tied together.
- 7.2 Total intelligent station instruments should be deployed to achieve the specified accuracy of the work. Proper precautions for avoiding graduation errors, instrumental and personal errors should be scrupulously observed.
- 7.3 From main traverse/triangulation station, subsidiary stations shall be established at suitable interval to cover the entire area.
- 7.4 The closing error in traverse shall not exceed one in twenty five thousand (1 in 25000) in terms of length or $L\sqrt{N}$ seconds (total in angular measurement) whichever is less (where L is the least count of the instrument and N is the number of stations).

8.0 PROGRESS REPORT

- 8.1 The contractor shall prepare and submit progress report in three copies every week to the engineer-in-charge without fail indicating status of setting out of the grids, total area surveyed, grid pillars constructed, methodology adopted for surveying and instruments deployed including staff working on the site and difficulties encountered during execution of the work etc.
- 8.2 The submission of such reports and review thereof by the engineer-in-charge shall not be deemed to absolve the contractor of his responsibility of timely completion of the assignment as per the time schedule indicated.

9.0 PREPARATION & SUBMISSION OF SURVEY MAPS



SPEC. NO.	PE-DC-N80-601-C002		
VOLUME	II		
SECTION	D		
REV. NO.	0	DATE	05.01.2021
SHEET	5	OF	7

- 9.1 The contractor shall submit survey map of the site in 1:1000 scale indicating grid lines, demarcating all permanent features like roads, waterways, buildings, power lines, natural streams, trees etc for the onshore area.
- 9.2 The contractor shall submit survey map of the the area in 1:1000 scale indicating grid lines, bed levels and any other feature as encountered during bathymetric survey for the offshore area.
- 9.3 The contractor shall submit longitudinal section and cross section at specified intervals/chainages.
- 9.4 All the maps should be prepared in digitised forms using Inkjet/Pen plotter and standard computer software like Autocad or auto civil on standard A-0 size polyester base film. The block of name plate of all the drawings should be as per BHEL standard.
- 9.5 The contractor shall submit three copies of all the maps for review and approval of the engineer-in-charge. After approval, 8 (eight) prints of all the final maps along with a set of the originals on polyester base film and 2 (two) soft copies on a CD shall be submitted. Copies of the maps shall be submitted in proper flappers and original polyester base drawings should be handed over in proper card board covers indicating index of drawings.

10.0 SUBMISSION OF FIELD DATA AND REPORT

- 10.1 Contractor shall submit all data pertaining to the survey in original to the engineer-in-charge.
- 10.2 All field data shall be submitted to the engineer-in-charge from time to time as per progress of the work.
- 10.3 Three copies of draft report shall be submitted on the completion of the field work for review and approval of the engineer-in-charge. The report should give the introduction of the site, methodology adopted for surveying the areas, calculation of errors and any other calculation required for surveying and preparation of the survey maps.
- 10.4 Details of trees with their name, numbers and girths shall also form part of the survey report.
- 10.5 The survey report should also cover the following.
 - General site observation such as location of access roads, river and nallah courses, irrigation canals etc.



SPEC. NO.	PE-	DC-N80-	601-C002
VOLUME	II		
SECTION	D		
REV. NO.	0	DATE	05.01.2021
SHEET	6	OF	7


- Presence of any well and /or tube well in the site and water level in them shall also be indicated.
- Site photographs.
- 10.6 Final survey report shall be submitted in 8 (eight) copies of standard A4 size sheets properly bound and printed using good quality paper and material.


11.0 CLEARANCE OF JUNGLES AND CUTTING OF TREES


Clearance of jungles and cutting of trees as required to facilitate the survey work also form part of the contract. Necessary permission of concerned public bodies shall be secured by the owner. The contractor shall ensure that minimum amount of jungles are cleared and trees are properly cut under the direction of public bodies. The trees and jungles as cleared shall be stacked and handed over to the engineer-in-charge/owner. No extra payment is admissible under this account.


12.0 INSPECTION

The contractor shall make all arrangements of men, material, instruments, surveyors, necessary records and field data etc at the work site for checking of the work to the satisfaction of the engineer-in-charge or his authorised representative during the progress and on successful completion of the work. The contractor shall intimate well in advance before final decamping from work site so that the final work can be inspected by the engineer-in-charge. This will form a part of acceptance of the work for release of payments.

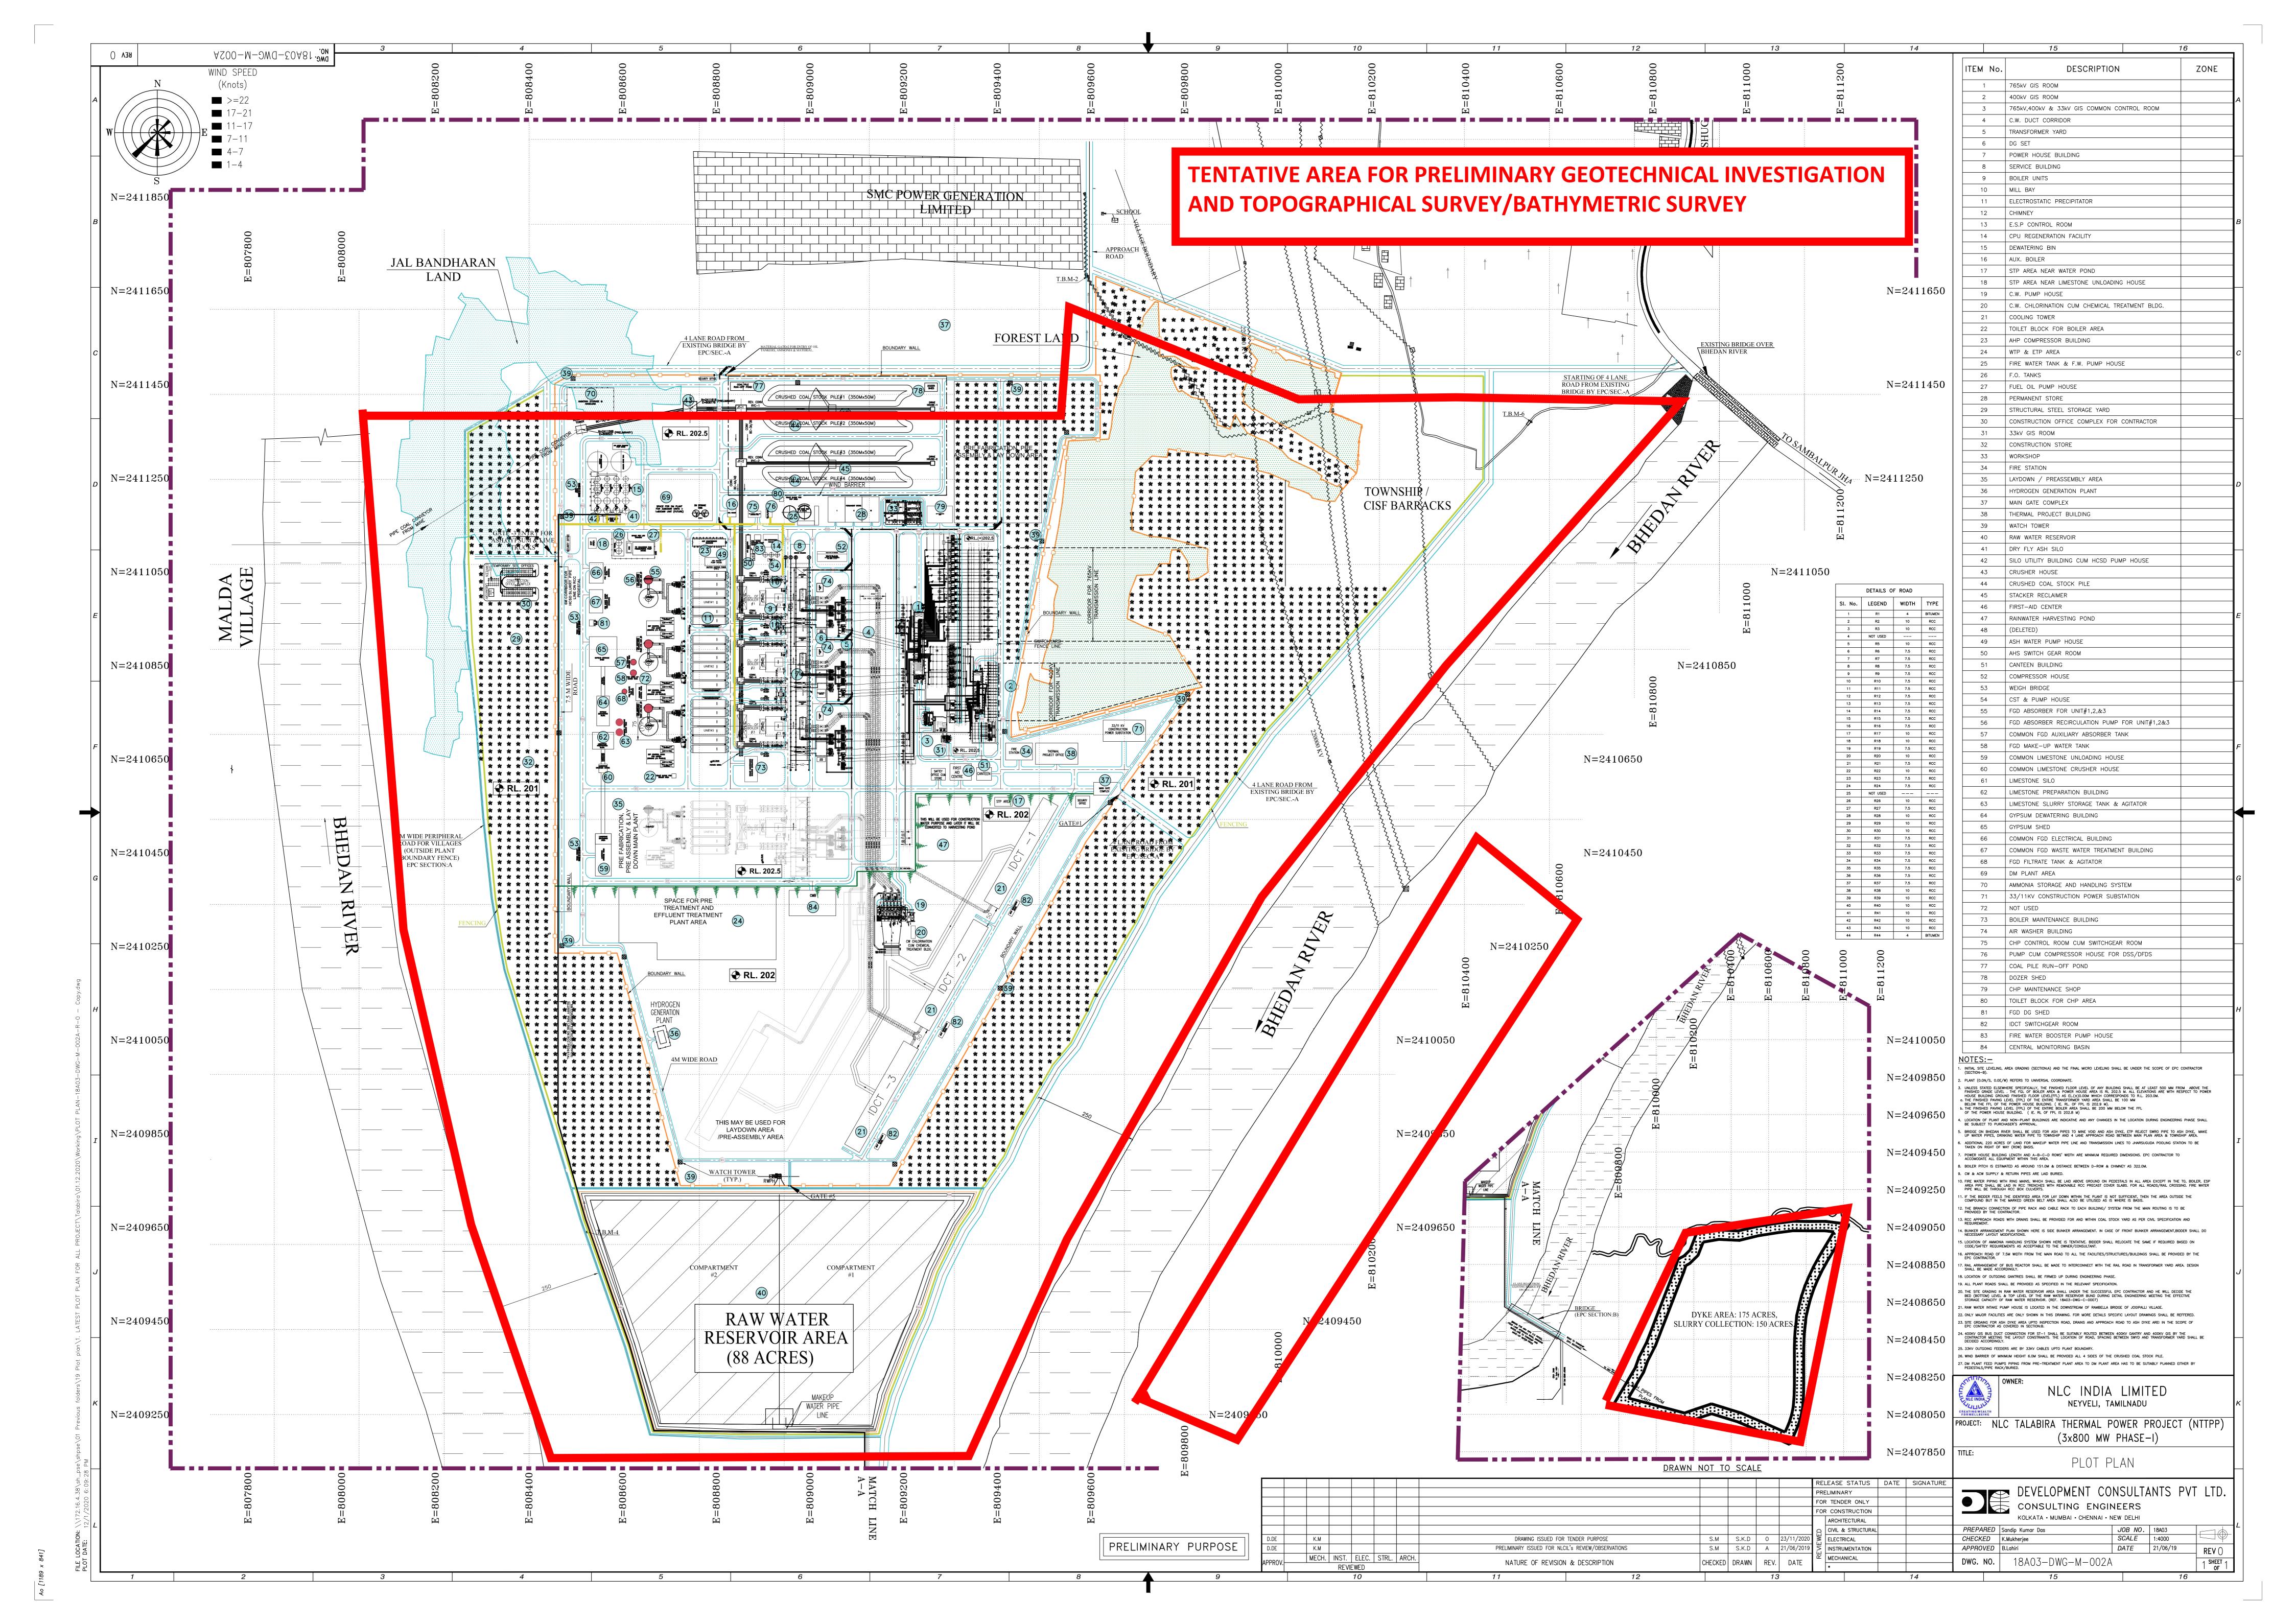

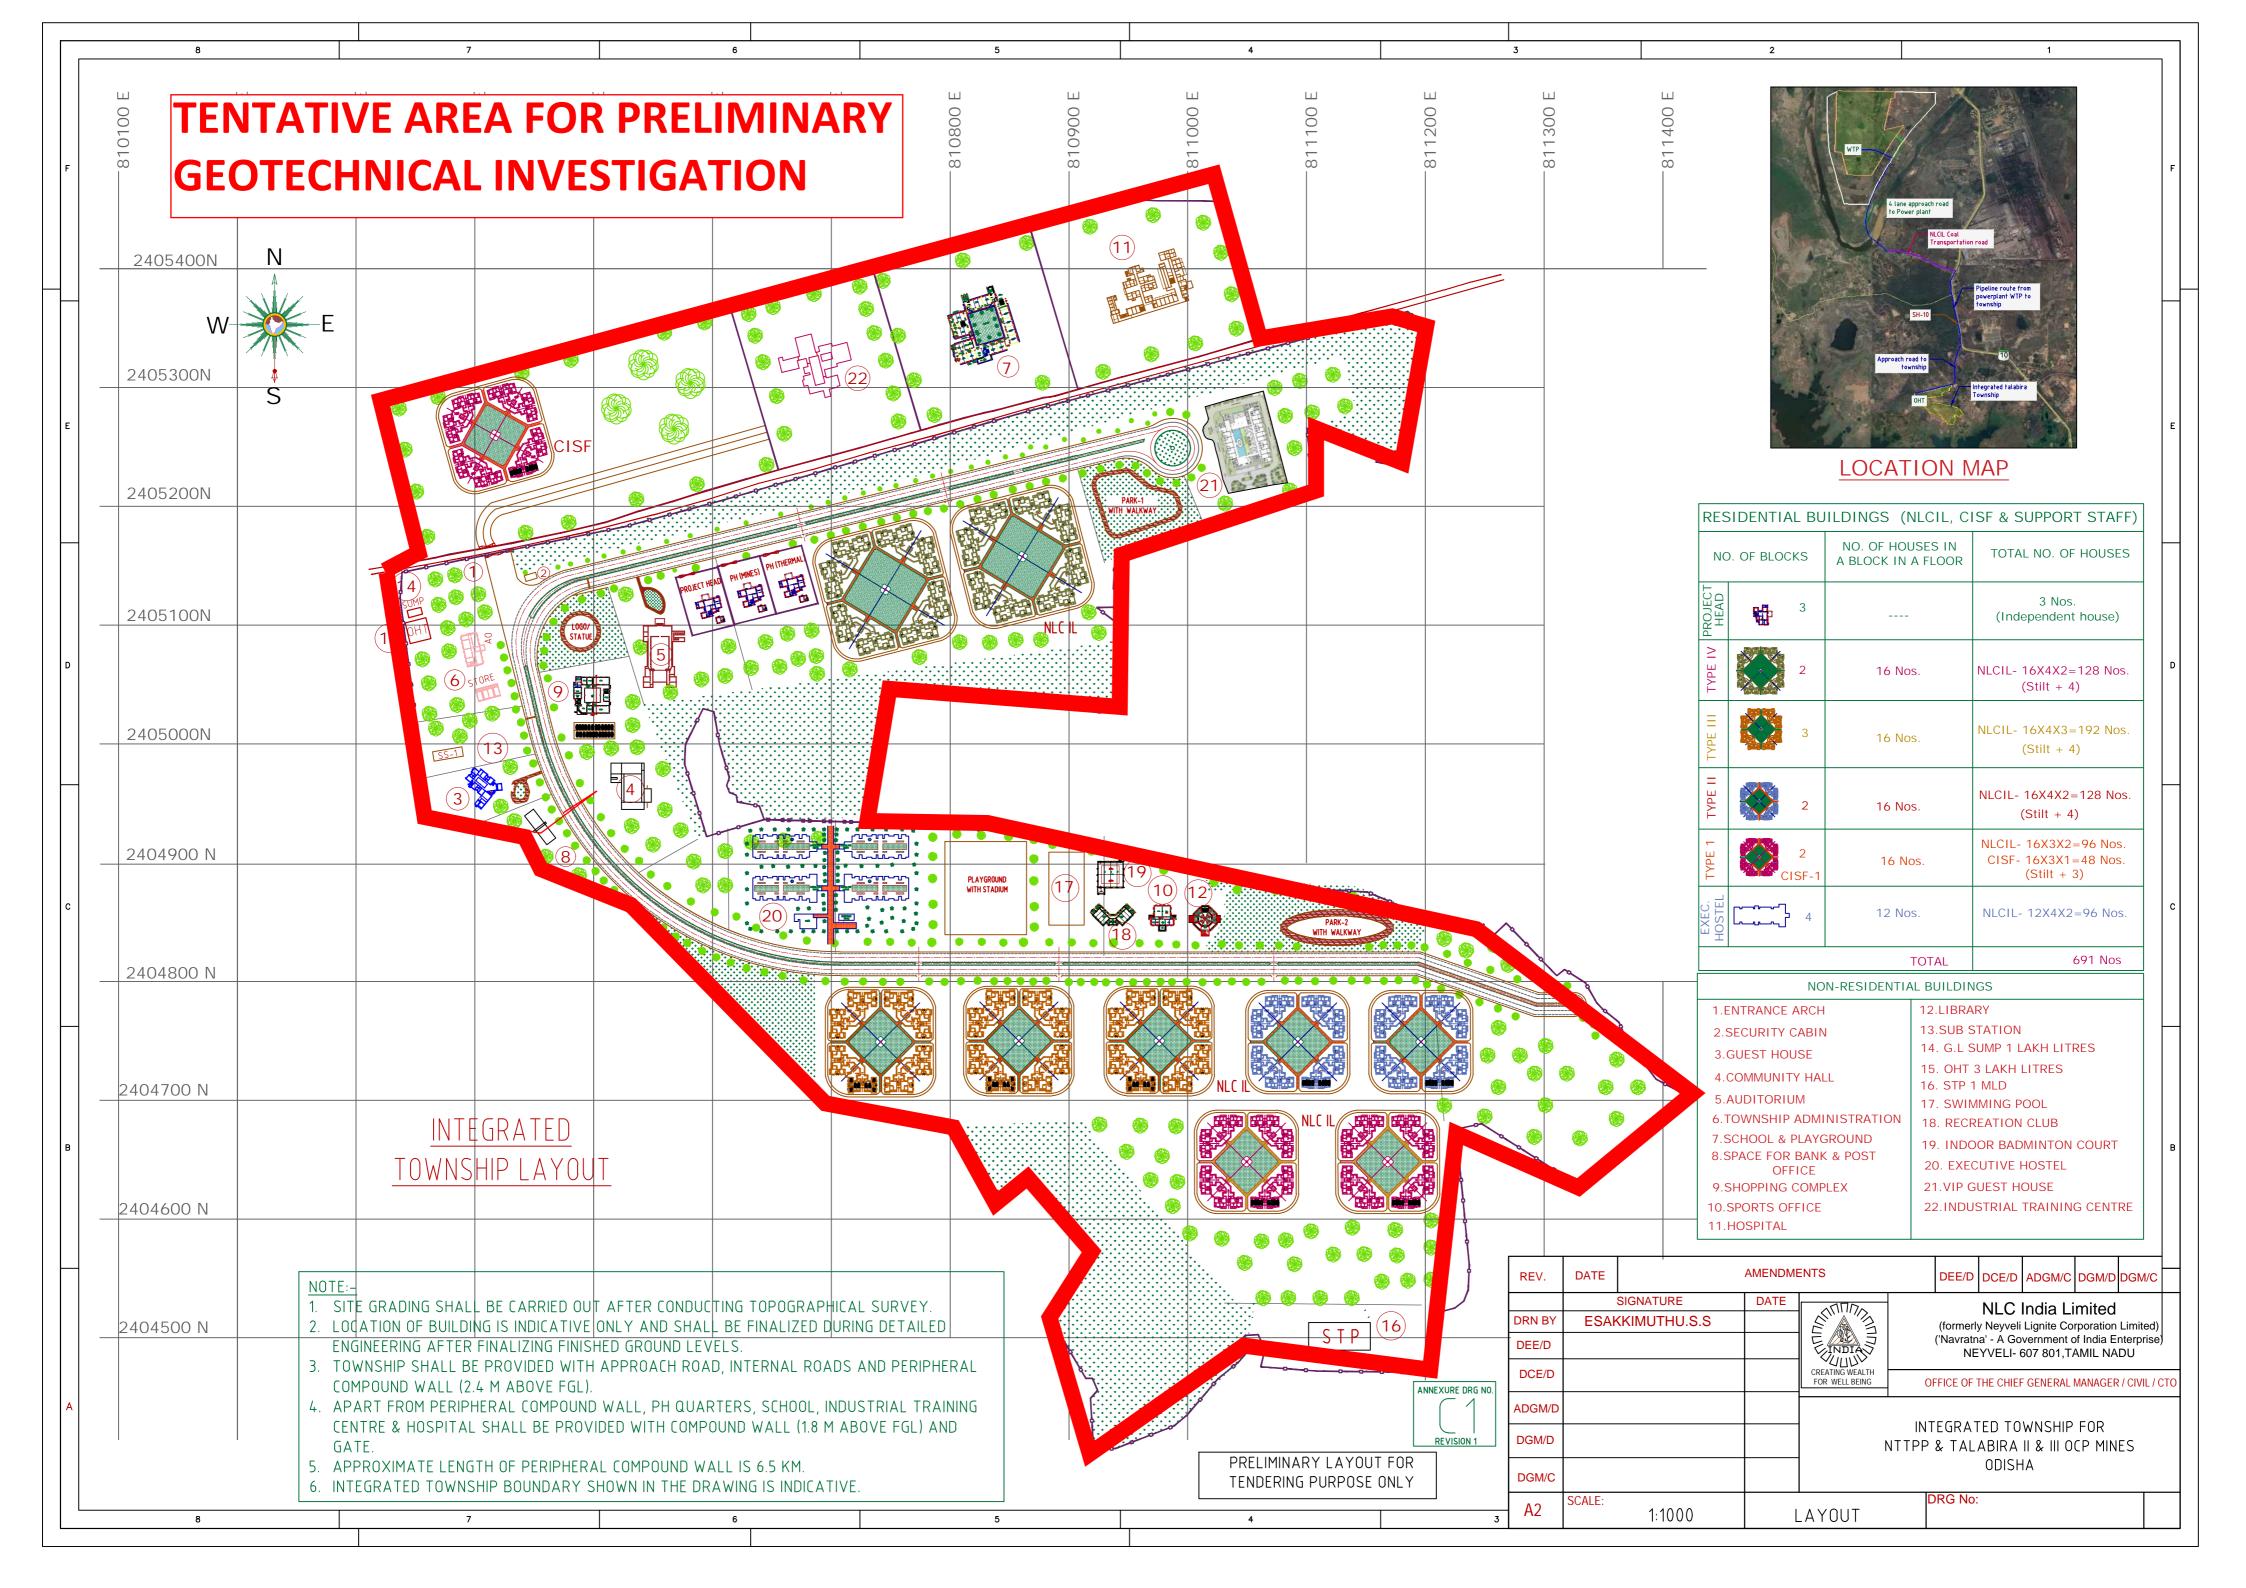


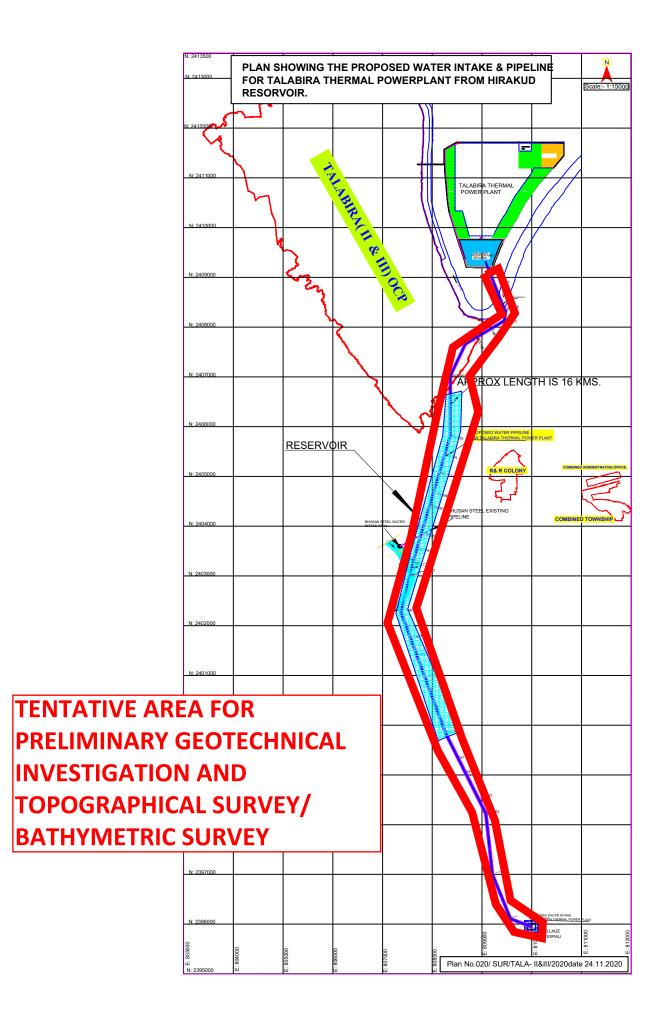

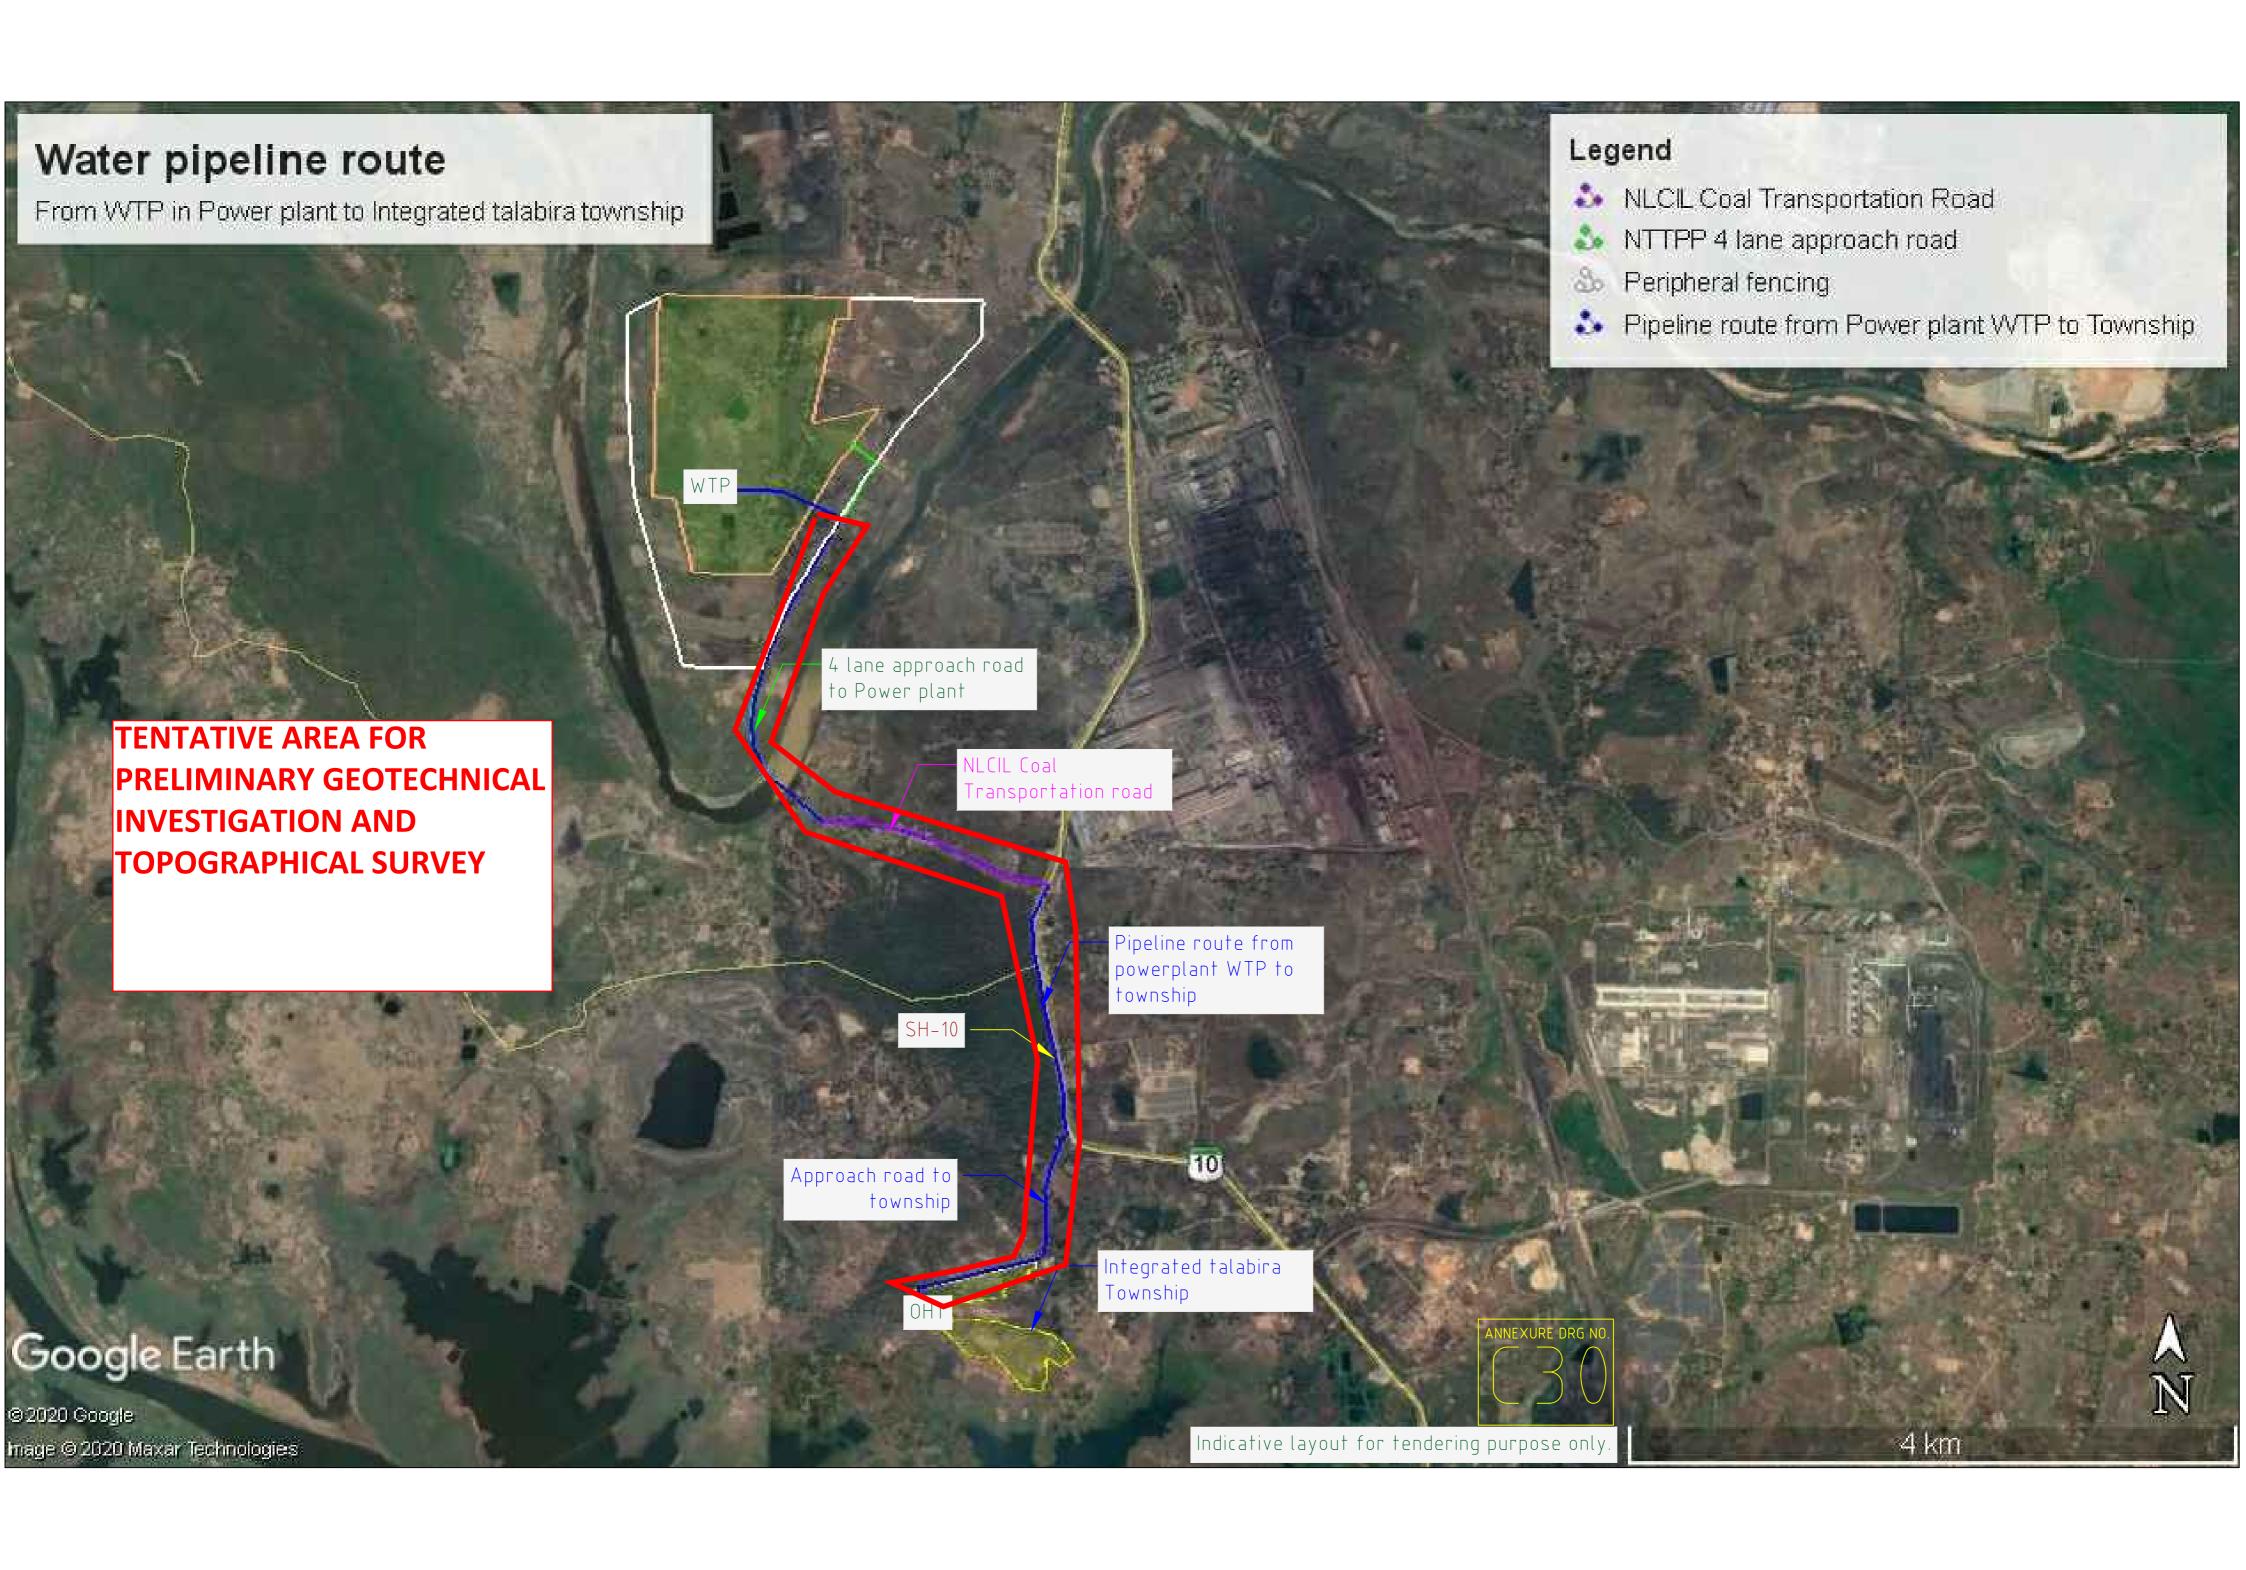





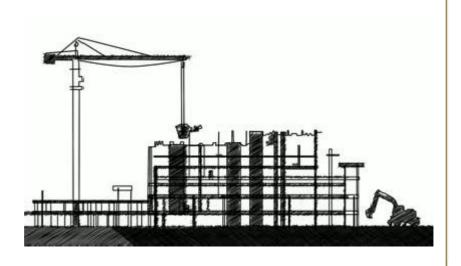

HEALTH,
SAFETY and
ENVIRONMENT
PLAN

for

SITE OPERATIONS

by

SUB-CONTRACTORS

HSE PLAN FOR SITE OPRATIONS BY BHEL'S SUBCONTRACTORS

AT A GLANCE

BEFORE START

SIGNING OF MOU

Agree to comply to HSE requirement- Statutory and BHEL's

Z Y

HSE ORGANISATION

Manpower

- 1 (one) safety officer for every 500 workers or part thereof
- 1(one) safety-steward/ supervisor for every 100 workers

Qualification

As per Cl. 7.1

HSE Roles and responsibilities

- Site In-charge- As per clause 7.2.1
- Safety officer- As per clause 7.2.2

HSE Planning

for Man, Machinery/Equipment/Tools & Tackles

PROVIDE

HSE INFRASTUCTURE

- PPEs
- Drinking Water
- Washing Facilities
- Latrines and Urinals
- Provision of shelter for rest
- Medical facilities

- Canteen facilities
- Labour Colony
- Emergency Vehicle
- Pest Control
- Scrapyard
- Illumination

TRAIN

HSE TRAINING, AWARENESS & PROMOTION

Training

- Induction training
- Height work and other critical areas
- Tool Box talk & Pep Talk

Awareness & Promotion

- Signage
- Poster
- Banner
- Competition
- Awards

DMMUNICAT

Incident Reporting

- Accident- Fatal & Major
- Property damage
- Near Miss

HSE COMMUNICATION

Event Reporting

- Celebrations
- Training
- Medical camp

EXECUTE SAFELY

CHECKS

OPERATIONAL CONTROL PROCEDURES

PERMIT TO WORK

Height work (above 2 metres), Hot Work, Heavy Lifting, Confined Space, Radiography, excavation (More than 4 metres)

SAFETY DURING WORK EXECUTION

- Welding
- Rigging
- Cylinder- storage & Movement
- Demolition work
- T&Ps
- Chemical Handling
- Electrical works

- Fire
- Scaffolding
- Height work
- Working Platform
- Excavation
- Ladder
- Lifting
- Hoisting appliance

HOUSE KEEPING

WASTE MANGEMENT

TRAFFIC MANAGEMENT

ENVIRONMENTAL CONTROL

EMERGENCY PREPAREDNESS AND RESPONSE PLAN

HSE AUDITS & INSPECTION

- Daily Checks
- Inspection of PPEs
- Inspection of T& Ps
- Inspection of Cranes & Winches
- Inspection of Height work
- Inspection of Welding and Gas cutting
- Inspection of elevators etc.

HSE PERFORMANCE EVALUATION PARAMETERS

PENALTY for NON CONFORMANCE Refer Clause 16 Incremental penalty

For repeated violation by the same person, the penalty would be double of the previous penalty

For repeated fatal incident in the same Unit incremental penalty to be imposed. The subcontractor will pay 2 times the penalty compared to previously paid in case there are repeated cases of fatal incidents under the same subcontractor for the same package in the same unit.



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

POWER SECTOR

REVISION HISTORY SHEET

Date	Revision No.	Details of Changes	Reason	Prepared	Reviewed	Approved
12.08.2014	00	First Issue	First Issue	S. B. Jayant, Dy Manager- FQA & Safety	A. K. Sinha, GM-FQA & Safety	Anuj Bhatnagar, ED-FQA & Safety
20.01.2020	01	Formats added: HSEP:14-F30 – Monthly HSE Planning & Review (Page 11, Clause 8.0 - updated) HSEP:14-F13E-Excavation Inspection Format (part of F30)) HSEP:14-F32B – Job Safety Analysis Format (part of F30) HSEP:14-F31A – Daily HSE Reporting (Page 18, Clause 10.3 – added) HSEP:14-F33 – HSE Performance Evaluation (Page 31, Clause 13 – revised)	PSHQHSE/M ONREP/02 Dated 08-Jan- 2020	Rohit Kumar		sh Nair, K & HSE)



REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 1 of 43

POWER SECTOR

Sr. No.	Description	Page No.
1.0	PURPOSE	4
2.0	SCOPE	4
3.0	OBJECTIVES AND TARGETS	4
4.0	HEALTH, SAFETY & ENVIRONMENT POLICY	5
5.0	MEMORANDUM OF UNDERSTANDING	6
6.0	TERMS & DEFINITIONS	7
7.0	HSE ORGANIZATION	8
7.1	QUALIFICATION FOR HSE PERSONNEL	8
7.2	RESPONSIBILITIES	9
8.0	PLANNING BY SUBCONTRACTOR	11
8.1	MOBILISATION OF MACHINERY/EQUIPMENT/TOOLS	11
8.2	MOBILISATION OF MANPOWER BY SUBCONTRACTOR	11
8.3	PROVISION OF PPEs	12
8.4	ARRANGEMENT OF INFRASTRUCTURE	13
9.0	HSE TRAINING & AWARENESS	16
9.1	HSE INDUCTION TRAINING	16
9.2	HSE TOOLBOX TALK	17
9.3	TRAINING ON HEIGHT WORK	17
9.4	HSE TRAINING DURING PROJECT EXECUTION	17



REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 2 of 43

POWER SECTOR

		1
9.5	HSE PROMOTION-SIGNAGE, POSTERS, COMPETITION, AWARDS ETC	18
10.0	HSE COMMUNICATION	18
10.1	INCIDENT REPORTING	18
10.2	HSE EVENT REPORTING	18
11.0	OPERATIONAL CONTROL	19
11.1	HSE ACTIVITIES	19
11.2	WORK PERMIT SYSTEM	20
11.3	SAFETY DURING WORK EXECUTION	20
11.4	ENVIRONMENTAL CONTROL	24
11.5	HOUSEKEEPING	24
11.6	WASTE MANAGEMENT	25
11.7	TRAFFIC MANAGEMENT SYSTEM	26
11.8	EMERGENCY PREPAREDNESS AND RESPONSE	28
12.0	HSE INSPECTION	29
12.1	DAILY HSE CHECKS	29
12.2	INSPECTION OF PPE	29
12.3	INSPECTION OF T&Ps	30
12.4	INSPECTION OF CRANES AND WINCHES	30
12.5	INSPECTION ON HEIGHT WORKING	30
12.6	INSPECTION ON WELDING AND GAS CUTTING OPERATION	30



REV:

POWER SECTOR

Doc no.: HSEP: 14

01

20.01.2020 Date:

Page: 3 of 43

12.7	INSPECTION ON ELECTRICAL INSTALLATION / APPLIANCES	31
12.8	INSPECTION OF ELEVATOR	31
12.9	INSPECTION OF EXCAVATION ACTIVITIES	31
13.0	HSE PERFORMANCE	31
14.0	HSE PENALTIES	32
15.0	OTHER REQUIREMENTS	32
16.0	NON COMPLIANCE	33
17.0	HSE AUDIT/INSPECTION	34
18.0	MONTHLY HSE REVIEW MEETING	34
19.0	FORMATS USED	34
20.0	Annexures	36



S REV: 01

2 1 22

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 4 of 43

POWER SECTOR

1.0 PURPOSE

- 1.1 The purpose of this HSE Plan is to provide for the systematic identification, evaluation, prevention and control of general workplace hazards, specific job hazards, potential hazards and environmental impacts that may arise from foreseeable conditions during installation and servicing of industrial projects and power plants.
- 1.2 This document shall be followed by BHEL's subcontractors at all installation and servicing sites. In case customer specific documents are to be implemented, this document will be followed in conjunction with customer specific documents.
- **1.3** Although every effort has been made to make the procedures and guidelines in line with statutory requirements, in case of any discrepancy relevant statutory guidelines must be followed.
- **1.4** In case the customer has any specific requirement, the same is to be fulfilled.

2.0 SCOPE

The document is applicable for BHEL's Subcontractors at all installation / servicing activities of BHEL Power Sector as per the relevant contractual obligations.

3.0 OBJECTIVES AND TARGETS

The HSE Plan reflects that BHEL places high priority upon the Occupational Health, Safety and Environment at workplaces.

- Ensure the Health and Safety of all persons at work site is not adversely affected by the work.
- Ensure protection of environment of the work site.
- Comply at all times with the relevant statutory and contractual HSE requirements.
- Provide trained, experienced and competent personnel. Ensure medically fit personnel only are engaged at work.
- Provide and maintain plant, places and systems of work that are safe and without risk to health and the
 environment.
- Provide all personnel with adequate information, instruction, training and supervision on the safety aspect of their work
- Effectively control, co-ordinate and monitor the activities of all personnel on the Project sites including subcontractors in respects of HSE.
- Establish effective communication on HSE matters with all relevant parties involved in the Project works.
- Ensure that all work planning takes into account all persons that may be affected by the work.
- Ensure fitness testing of all T&Ps/Lifting appliances like cranes, chain pulley blocks etc. are to be certified by competent person.
- Ensure timely provision of resources to facilitate effective implementation of HSE requirements.
- Ensure continual improvements in HSE performance
- Ensure conservation of resources and reduction of wastage.
- Capture the data of all incidents including near misses, process deviation etc. Investigate and analyze the same
 to find out the root cause.
- Ensure timely implementation of correction, corrective action and preventive action.



DE\/ 04

REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 5 of 43

POWER SECTOR

HSE TARGETS

EXPLOSION ZERO
FATALITY ZERO
LOST TIME INJURY ZERO
FIRE ZERO
VEHICLE INCIDENTS ZERO
ENVIRONMENTAL INCIDENTS ZERO

4.0 BHEL POWER SECTOR HEALTH, SAFETY & ENVIRONMENT POLICY

Health, Safety & Environment Policy of BHEL

In BHEL, Health, Safety and Environment (HSE) responsibilities are driven by our commitment to protect our employees and people we work with, community and environment. BHEL believes in zero tolerance for unsafe work/non-conformance to safety and in minimizing environmental footprint associated with all its business activities. We commit to continually improve our HSE performance by:

- ➤ Developing safety and sustainability culture through active leadership and by ensuring availability of required resources.
- Ensuring compliance with applicable legislation, regulations and BHEL systems.
- > Taking up activities for conservation of resources and adopting sound waste management by following Reduce/Recycle/Reuse approach.
- Continually identifying, assessing and managing environmental impacts and Occupational Health & Safety risks of all activities, products and services adopting approach based on elimination/substitution/reduction/control.
- Incorporating appropriate Occupational Health, Safety and Environment criteria into business decisions, design of products & systems and for selection of plants, technologies and services.
- Imparting appropriate structured training to all persons at workplace and promoting awareness amongst customers, contractors and suppliers on HSE issues.
- Reviewing periodically this policy and HSE Management Systems to ensure its relevance, appropriateness and effectiveness.
- Communicating this policy within BHEL and making it available to interested parties.

sd/-

CMD, BHEL



REV:

POWER SECTOR

01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **6** of **43**

MEMORANDUM OF UNDERSTANDING: 5.0

After award of work, subcontractors are required to enter into a memorandum of understanding as given below:

, inc. amara c. indik, dabboninabio	to are required to effici into a memorahadin of anaerotamanig as given selew.
	Memorandum of Understanding
	orRegion is committed to Health, Safety and Environment Policy (HSE Policy)do hereby also commit to comply with the same HSE Policy w h i l e
executing the Contract Number	
	shall ensure that safe work practices as per the HSE plan. Spirit and
content therein shall be reached	d to all workers and supervisors for compliance.
In addition to this, M/S	shall comply to all applicable statutory and regulatory requirements
which are in force in the place	of project and any special requirement specified in the contract document of the
principal customer.	
M/s	shall co-operate in HSE audits/inspections conducted by BHEL /customer/
third party and ensure to close a	any non-conformity observed/reported within prescribed time limit.
Signed by authorized representa	tive of M/s
Name :	

Place & Date:



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS REV:

01

20.01.2020 Date:

Doc no.: HSEP: 14

Page: **7** of **43**

POWER SECTOR

TERMS AND DEFINITIONS 6.0

6.1 **DEFINITIONS**

6.1.1 **INCIDENT**

Work- related or natural event(s) in which an injury, or ill health (regardless of severity), damage to property or fatality occurred, or could have occurred.

6.1.2 **NEAR MISS**

An incident where no ill health, injury, damage or other loss occurs, but it had a potential to cause, is referred to as "Near-Miss".

MAN-HOURS WORKED 6.1.3

The total number of man hours worked by all employees including subcontractors working in the premises. It includes managerial, supervisory, professional, technical, clerical and other workers including contract labours. Man-hours worked shall be calculated from the payroll or time clock recorded including overtime. When this is not feasible, the same shall be estimated by multiplying the total man-days worked for the period covered by the number of hours worked per day. The total number of workdays for a period is the sum of the number of men at work on each day of period. If the daily hours vary from department to department separate estimate shall be made for each department and the result added together.

FIRST AID CASES 6.1.4

First aids are not essentially all reportable cases, where the injured person is given medical treatment and discharged immediately for reporting on duty, without counting any lost time.

6.1.5 **LOST TIME INJURY**

Any work injury which renders the injured person unable to perform his regular job or an alternative restricted work assignment on the next scheduled work day after the day on which the injury occurred.

6.1.6 **MEDICAL CASES**

Medical cases come under non-reportable cases, where owing to illness or other reason the employee was absent from work and seeks Medical treatment.

6.1.7 TYPE OF INCIDENTS & THEIR REPORTING:

The three categories of Incident are as follows:

Non-Reportable Cases:

An incident, where the injured person is given medical help and discharged for work without counting any lost time.



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS REV:

01

20.01.2020 Date:

Doc no.: HSEP: 14

Page: 8 of 43

POWER SECTOR

Reportable Cases:

In this case the injured person is disable for 48 hours or more and is not able to perform his duty.

Injury Cases:

These are covered under the heading of non-reportable cases. In these cases the incident caused injury to the person, but he still continues his duty.

6.1.8 TOTAL REPORTABLE FREQUENCY RATE

Frequency rate is the number of Reportable Lost Time Injury (LTI) per one Million Man hours worked. Mathematically, the formula read as:

Number of Reportable LTI x 1,000,000

Total Man Hours Worked

6.1.9 **SEVERITY RATE**

Severity rate is the Number of days lost due to Lost Time Injury (LTI) per one Million Man hours worked. Mathematically, the formula reads as:

Days lost due to LTI __x 1,000,000

Total Man Hours Worked

6.1.10 INCIDENCE RATE

Incidence Rate is the Number of LTI per one thousand manpower deployed. Mathematically, the formula reads as:

Number of LTIx1000

Average number of manpower deployed

7.0 **HSE ORGANISATION**

Number of safety officers:

The subcontractor must deploy one safety officer for every 500 workers or part thereof in each package. In addition, there must be one safety-steward/safety-supervisor for every 100 workers.

Deployment: The subcontractor should deploy sufficient safety officers and safety-steward/Safety-supervisor, as per requirement given above, since initial stage and add more in proportion to the added strength in work force. Any delay in deployment will attract a penalty of Rs.30,000/- per man month for the delayed period.

7.1 **QUALIFICATION FOR HSE PERSONNEL**

Sl.no	Designation	Qualification	Experience
1	Safety officer (Construction Agency)	Degree or Diploma in Engineering with full time diploma in Industrial Safety with construction safety as one of the subjects	Minimum two years for degree holder and five years for diploma holder in the field of Construction of power plant/ major industries



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS REV:

> 20.01.2020 Date:

Doc no.: HSEP: 14

01

POWER SECTOR Page: 9 of 43

2	Safety-Steward/ Safety-	Degree or diploma in any discipline with	Minimum two years
	Supervisor	full time diploma in Industrial Safety with	
		construction safety as one of the	
		subjects	

7.2 **RESPONSIBILITIES**

7.2.1 SITE IN -CHARGE OF SUBCONTRACTOR

- Shall sign Memorandum of Understanding (MoU) for compliance to BHEL's HSE Plan for Site Operations as per clause 5.0
- Shall engage qualified safety officer(s) and steward (s) as per clause 7.0
- Shall adhere to the rules and regulations mentioned in this code, practice very strictly in his area of work in consultation with his concerned engineer and the safety coordinator.
- Shall screen all workmen for health and competence requirement before engaging for the job and periodically thereafter as required.
- Shall not engage any employee below 18 years.
- Shall arrange for all necessary PPEs like safety helmets, belts, full body harness, shoes, face shield, hand gloves etc. before starting the job. Shall ensure that no working men/women carry excessive weight more than stipulated in Factory Rule Regulation R57.
- Shall ensure that all T&Ps engaged are tested for fitness and have valid certificates from competent person.
- Shall ensure that provisions stipulated in contract Labour Regulation Act 1970, Chapter V C.9, canteen, rest rooms/washing facilities to contracted employees at site.
- Shall adhere to the instructions laid down in Operation Control Procedures (OCPs) available with the site management.
- Shall ensure that person working above 2.0 meter should use Safety Harness tied to a life line/stable structure.
- Shall ensure that materials are not thrown from height. Cautions to be exercised to prevent fall of material from height.
- Shall report all incidents (Fatal/Major/Minor/Near Miss) to the Site engineer /HSE officer of BHEL.
- Shall ensure that Horseplay is strictly forbidden.
- Shall ensure that adequate illumination is arranged during night work.
- Shall ensure that all personnel working under subcontractor are working safely and do not create any Hazard to self and to others.
- Shall ensure display of adequate signage/posters on HSE.
- Shall ensure that mobile phone is not used by workers while working.
- Shall ensure conductance of HSE audit, mockdrill, medical camps, induction training and training on HSE at site.
- Shall ensure full co-operation during HQ/External /Customer HSE audits.



REV: 01

Date: 20

20.01.2020

Page: **10** of **43**

Doc no.: HSEP: 14

POWER SECTOR

Shall ensure submission of look-ahead plan for procurement of HSE equipment's and PPEs as per work schedule.

- Shall ensure good housekeeping.
- Shall ensure adequate valid fire extinguishers are provided at the worksite.
- Shall ensure availability of sufficient number of toilets /restrooms and adequate drinking water at work site and labour colony.
- · Shall ensure adequate emergency preparedness.
- · Shall be member of site HSE committee and attend all meetings of the committee
- Power source for hand lamps shall be maximum of 24 v.
- ☐ Temporary fencing should be done for open edges if Hand railings and Toe-guards are not available.

7.2.2 HEALTH, SAFETY AND ENVIRONMENT OFFICER OF SUBCONTRACTOR

- Carry out safety inspection of Work Area, Work Method, Men, Machine & Material, P&M and other tools and tackles.
- Facilitate inclusion of safety elements into Work Method Statement.
- Highlight the requirements of safety through Tool-box / other meetings.
- Help concerned HOS to prepare Job Specific instructions for critical jobs.
- Conduct investigation of all incident/dangerous occurrences & recommend appropriate safety measures.
- Advice & co-ordinate for implementation of HSE permit systems, OCPs & MPs.
- Convene HSE meeting & minute the proceeding for circulation & follow-up action.
- Plan procurement of PPE & Safety devices and inspect their healthiness.
- Report to PS Region/HQ on all matters pertaining to status of safety and promotional program at site level.
- · Facilitate administration of First Aid
- · Facilitate screening of workmen and safety induction.
- Conduct fire Drill and facilitate emergency preparedness
- · Design campaigns, competitions & other special emphasis programs to promote safety in the workplace.
- □ Apprise PS− Region on safety related problems.
- · Notify site personnel non-conformance to safety norms observed during site visits / site inspections.
- Recommend to Site In charge, immediate discontinuance of work until rectification, of such situations warranting immediate action in view of imminent danger to life or property or environment.
- To decline acceptance of such PPE / safety equipment that do not conform to specified requirements.
- Encourage raising Near Miss Report on safety along with, improvement initiatives on safety.
- Shall work as interface between various agencies such customer, package-in-charges, subcontractors on HSE matters



REV:

Date: 20.01.2020

> Page: **11** of **43**

Doc no.: HSEP: 14

01

POWER SECTOR

8.0 **PLANNING BY SUBCONTRACTOR**

Monthly planning and review of HSE activities shall be carried out by subcontractor as per format No. HSEP:14-F30 jointly along with BHEL.

MOBILISATION OF MACHINERY/EQUIPMENT/TOOLS BY SUBCONTRACTOR 8.1

- As a measure to ensure that machinery, equipment and tools being mobilized to the construction site are fit for purpose and are maintained in safe operating condition and complies with legislative and owner requirement, inspection shall be arranged by in-house competent authority for acceptance as applicable.
- The machinery and equipment to be embraced for this purpose shall include but not limited to the following:
 - Mobile cranes. 0
 - Side Booms.
 - Forklifts.
 - Grinding machine.
 - Drilling machine.
 - Air compressors.
 - 0 Welding machine.
 - 0 Generator sets.
 - Dump Trucks.
 - Excavators.
 - Dozers
 - Grit Blasting Equipment. 0
 - Hand tools.
- Subcontractor shall notify the engineer, of his intention to bring on to site any equipment or any container, with liquid or gaseous fuel or other substance which may create a hazard. The Engineer shall have the right to prescribe the condition under which such equipment or container may be handled and used during the performance of the works and the subcontractor shall strictly adhere to such instructions. The Engineer shall have the right to inspect any construction tool and to forbid its use, if in his opinion it is unsafe. No claim due to such prohibition will be entertained.

8.2 MOBILISATION OF MANPOWER BY SUBCONTRACTOR

- The subcontractor shall arrange induction and regular health check of their employees as per schedule VII of BOCW rules by a registered medical practitioner.
- The subcontractor shall take special care of the employees affected with occupational diseases under rule 230 and schedule II of BOCW Rules. The employees not meeting the fitness requirement should not be engaged for
- Ensure that the regulatory requirements of excessive weight limit (to carry/lift/ move weights beyond prescribed limits) for male and female workers are complied with.
- Appropriate accommodation to be arranged for all workmen in hygienic condition.



REV:

Date: 20.01.2020

> Page: **12** of **43**

Doc no.: HSEP: 14

01

POWER SECTOR

8.3 **PROVISION OF PPEs**

Personnel Protective Equipment (PPEs), in adequate numbers, will be made available at site & their regular use by all concerned will be ensured

The following matrix recommends usage of minimum PPEs against the respective job.

SI.	Type of work	PPEs
No		
1	Concrete and asphalt mixing	Nose mask, hand glove, apron and gum boot
2	Welders/Grinders/ Gas cutters	Welding/face screen, apron, hand gloves, nose mask and ear
		muffs if noise level exceeds 90dB. Helmet fitted with welding shield
		is preferred for welders
3	Stone/ concrete breakers	Ear muffs, safety goggles, hand gloves
4	Electrical Work	Rubber hand glove, Electrical Resistance shoes
5	Insulation Work	Respiratory mask, Hand gloves, safety goggles
6	Work at height	Double lanyard full body harness, Fall arrestor (specific cases)
7	Grit/Sand blasting	Blast suit, blast helmet, respirator, leather gloves
8	Painting	Plastic gloves, Respirators (particularly for spray painting)
9	Radiography	As per BARC guidelines

The PPEs shall conform to the relevant standards as below and bear ISI mark.

Relevant is-codes for personal protection

IS: 2925 – 1984	Industrial Safety Helmets.	
IS: 4770 – 1968	Rubber gloves for electrical purposes.	
IS: 6994 – 1973 (Part-I)	Industrial Safety Gloves (Leather &Cotton Gloves).	
IS: 1989 – 1986 (Part-I-II)	Leather safety boots and shoes.	
IS: 5557 – 1969	Industrial and Safety rubber knee boots.	
IS: 6519 – 1971	Code of practice for selections care and repair of Safety footwear.	
IS: 11226 – 1985	Leather Safety footwear having direct molding sole.	
IS: 5983 – 1978	Eye protectors.	
IS: 9167 – 1979	Ear protectors.	
IS: 1179-1967	Eye & Face protection during welding	
IS: 3521 – 1983	Industrial Safety Belts and Harness	
IS:8519 -1977	Guide for selection of industrial Safety equipment for body protection	
IS:9473-2002,14166- 1994,14746-1999	Respiratory Protective Devices	

The list is not exhaustive. The safety officer may demand additional PPEs based on specific requirement.



REV: 01

Date: 20.0

20.01.2020

Page: 13 of 43

Doc no.: HSEP: 14

POWER SECTOR

Where workers are employed in sewers and manholes, which are in use, the subcontractor shall ensure that the
manhole covers are opened and ventilated at least for an hour before the workers are allowed to get into
manhole, and the manholes so opened shall be cordoned off with suitable railing and provided with warning
signals or boards to prevent incident to the public

• Besides the PPEs mentioned above, the persons shall use helmet and safety shoe. The visitors shall use Helmet and any other PPEs as deemed appropriate for the area of work.

Colour scheme for Helmets:

1. Workmen: Yellow

2. Safety staff: Green or white with green band

3. Electrician: Red

4. Others including visitors: White

- All the PPEs shall be checked for its quality before issue and the same shall be periodically checked. The users shall be advised to check the PPEs themselves for any defect before putting on. The defective ones shall be repaired/ replaced.
- The issuing agency shall maintain register for issue and receipt of PPEs.
- The Helmets shall have logo or name (abbreviation of agency name permitted) affixed or printed on the front.
- The body harnesses shall be serial numbered.

8.4 ARRANGEMENT OF INFRASTRUCTURE

8.4.1 DRINKING WATER

- Drinking water shall be provided and maintained at suitable places at different elevations.
- Container should be labeled as "Drinking Water"
- Cleaning of the storage tank shall be ensured atleast once in 3 months indicating date of cleaning and next due
 date.
- Potability of water should be tested as per IS10500 at least once in a year.

8.4.2 WASHING FACILITIES

- In every workplace, adequate and suitable facilities for washing shall be provided and maintained.
- Separate and adequate cleaning facilities shall be provided for the use of male and female workers. Such facilities shall be conveniently accessible and shall be kept in clean and hygienic condition and dully illuminated for night use.
- Overalls shall be supplied by the subcontractor to the workmen and adequate facilities shall be provided to enable the painters and other workers to wash during the cessation of work.

8.4.3 LATRINES AND URINALS

- Latrines and urinals shall be provided in every work place.
- Urinals shall also be provided at different elevations.
- They shall be adequately lighted and shall be maintained in a clean and sanitary condition at all times, by appointing designated person.
- Separate facilities shall be provided for the use of male and female worker if any.



REV: 01

REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 14 of 43

POWER SECTOR

8.4.4 PROVISION OF SHELTER DURING REST

Proper Shed & Shelter shall be provided for rest during break

8.4.5 MEDICAL FACILITIES

8.4.5.1 MEDICAL CENTRE (As per Schedule V, X and XI of BOCW central Rules, 1998)

- A medical centre shall be ensured/identified at site with basic facilities for handling medical emergencies. The
 medical center can be jointly developed on proportionate sharing basis with permission from BHEL
- A qualified medical professional, not less than MBBS, shall be deployed at the medical centre
- The medical centre shall be equipped with one ambulance, with trained driver and oxygen cylinder.
- Medical waste shall be disposed as per prevailing legislation (Bio-Medical Waste –Management and Handling Rules, 1998)

8.4.5.2 FIRST AIDER

- Ensure availability of Qualified First-aider throughout the working hours.
- Every injury shall be treated, recorded and reported.
- Refresher course on first aid shall be conducted as necessary.
- List of Qualified first aiders and their contact numbers should be displayed at conspicuous places.

8.4.5.3 FIRST AID BOX (as per schedule III of BOCW)

- The subcontractor shall provide necessary first aid facilities as per schedule III of BOCW. At every work place first aid facilities shall be provided and maintained.
- The first aid box shall be kept by first aider who shall always be readily available during the working hours of the work place. His name and contact no to be displayed on the box.
- The first aid boxes should be placed at various elevations so as to make them available within the reach and at the quickest possible time.
- The first aid box shall be distinctly marked with a Green Cross on white background.
- Details of contents of first aid box is given in Annexure No. 01
- Monthly inspection of First Aid Box shall be carried out by the owner as per format no. HSEP:14-F01
- The subcontractor should conduct periodical first –aid classes to keep his supervisor and Engineers properly trained for attending to any emergency.

8.4.5.4 HEALTH CHECK UP (As per schedule VII and Form XI)

The persons engaged at the site shall undergo health checkup as per the format no. HSEP:14-F02 before induction. The persons engaged in the following works shall undergo health checkup at least once in a year:

- a. Height workers
- b. Drivers/crane operators/riggers



REV:

01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **15** of **43**

POWER SECTOR

- Confined space workers
- d. Shot/sand blaster
- Welding and NDE personnel

8.4.6 PROVISION OF CANTEEN FACILITY

- Canteen facilities shall be provided for the workmen of the project inside the project site.
- Proper cleaning and hygienic condition shall be maintained.
- Proper care should be taken to prevent biological contamination.
- Adequate drinking water should be available at canteen.
- Fire extinguisher shall be provided inside canteen.
- Regular health check-up and medication to the canteen workers shall be ensured.

PROVISION OF ACCOMODATION/LABOUR COLONY 8.4.7

The subcontractor shall arrange for the accommodation of workmen at nearby localities or by making a labour
colony.
Regular housekeeping of the labour colony shall be ensured.
Proper sanitation and hygienic conditions to be maintained.
Drinking water and electricity to be provided at the labour colony.
Bathing/ washing bay
Room ventilation and electrification.

8.4.8 PROVISION OF EMERGENCY VEHICLE

Dedicated emergency vehicle shall be made available at workplace by each subcontractor to handle any emergency

8.4.9 **PEST CONTROL**

Regular pest control should be carried out at all offices, mainly laboratories, canteen, labour colony and stores.

8.4.10 SCRAPYARD

- In consultation with customer, scrapyard shall be developed to store metal scrap, wooden scrap, waste, hazardous waste.
- Scrap/Waste shall be segregated as Bio-degradable and non-bio-degradable and stored separately.

8.4.11 ILLUMINATION

- The subcontractor shall arrange at his cost adequate lighting facilities e.g. flood lighting, hand lamps, area lighting etc. at various levels for safe and proper working operations at dark places and during night hours at the work spot as well as at the pre-assembly area.
- Adequate and suitable light shall be provided at all work places & their approaches including passage ways as per IS: 3646 (Part-II). Some recommended values are given below:



REV:

01

20.01.2020 Date:

Doc no.: HSEP: 14

Page: **16** of **43**

POWER SECTOR

	S. No.	Location	Illumination (Lux)
A.	Construction Are	a	, ,
1.		Outdoor areas like store yards, entrance and exit roads	20
2.		Platforms	50
3.		Entrances, corridors and stairs	100
4.		General illumination of work area	150
5.		Rough work like fabrication, assembly of major items	150
6.		Medium work like assembly of small machined parts rough measurements etc.	300
7.		Fine work like precision assembly, precision measurements etc.	700
8.		Sheet metal works	200
9.		Electrical and instrument labs	450
В.	Office		
1.		Outdoor area like entrance and exit roads	20
2.		Entrance halls	150
3.		Corridors and lift cars	70
4.		Lift landing	150
5.		Stairs	100
6.		Office rooms, conference rooms, library reading tables	300
7.		Drawing table	450
8.		Manual telephone exchange	200

- Lamp (hand held) shall not be powered by mains supply but either by 24V or dry cells.
- Lamps shall be protected by suitable guards where necessary to prevent danger, in case of breakage of lamp.
- Emergency lighting provision for night work shall be made to minimise danger in case of main supply failure.

If the subcontractor fails to take appropriate safety precautions or to provide necessary safety devices and equipment or to carry out instructions issued by the authorized BHEL official, BHEL shall have the right to take corrective steps at the risk and cost of the subcontractor

9.0 **HSE TRAINING& AWARENESS**

9.1 **HSE INDUCTION TRAINING**

All persons entering into project site shall be given HSE induction training by the HSE officer of BHEL /subcontractor before being assigned to work.

In-house induction training subjects shall include but not limited to:

- Briefing of the Project details.
- Safety objectives and targets.
- Site HSE rules.
- Site HSE hazards and aspects.
- First aid facility.
- Emergency Contact No.
- Incident reporting.
- Fire prevention and emergency response.
- Rules to be followed in the labour colony (if applicable)



REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 17 of 43

POWER SECTOR

- Proper safety wear & gear must be issued to all the workers being registered for the induction (i.e., Shoes/Helmets/Goggles/Leg guard/Apron etc.)
- They must arrive fully dressed in safety wear & gear to attend the induction.
- Any one failing to conform to this safety wear& gear requirement shall not qualify to attend.
- On completing attending subcontractor's in-house HSE induction, each employee shall sign an induction training form (format no. HSEP:14-F03) to declare that he had understood the content and shall abide to follow and comply with safe work practices. They may only then be qualified to be issued with a personal I.D. card, for access to the work site.

9.2 HSE TOOLBOX TALK

- HSE tool Box talk shall be conducted by frontline foreman/supervisor of subcontractor to specific work groups prior to the start of work. The agenda shall consist of the followings:
 - Details of the job being intended for immediate execution.
 - The relevant hazards and risks involved in executing the job and their control and mitigating measures.
 - Specific site condition to be considered while executing the job like high temperature, humidity, unfavorable weather etc.
 - Recent non-compliances observed.
 - Appreciation of good work done by any person.
 - Any doubt clearing session at the end.
- Record of Tool box talk shall be maintained as per format no. HSEP:14-F04
- Tool box talk to be conducted at least once a week for the specific work.

9.3 TRAINING ON HEIGHT WORK

Training on height work shall be imparted to all workers working at height by in-house/external faculty at least twice in a year. The training shall include following topics:

- Use of PPEs
- Use of fall arrester, retractable fall arrester, life line, safety nets etc.
- Safe climbing through monkey ladders.
- Inspection of PPEs.
- Medical fitness requirements.
- Mock drill on rescue at height.
- Dos & Don'ts during height work.

9.4 HSE TRAINING DURING PROJECT EXECUTION

- Other HSE training shall be arranged by BHEL/ subcontractor as per the need of the project execution and recommendation of HSE committee of site.
- The topics of the HSE training shall be as follows but not limited to:
 - Hazards identification and risk analysis (HIRA)
 - o Work Permit System
 - o Incident investigation and reporting
 - Fire fighting
 - o First aid
 - o Fire-warden training
 - EMS and OHSMS
 - o T & Ps fitness and operation



RS REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 18 of 43

POWER SECTOR

- Electrical safety
- Welding, NDE & Radiological safety
- Storage, preservation & material handling.
- A matrix shall be maintained to keep an up-to-date record of attendance of training sessions carried out.

9.5 HSE PROMOTION-SIGNAGE, POSTERS, COMPETITION, AWARDS ETC

9.5.1 Display of HSE posters and banners

Site shall arrange appropriate posters, banners, slogans in local/Hindi/English languages at work place

9.5.2 Display of HSE signage

 Appropriate HSE signage shall be displayed at the work area to aware workmen and passersby about the work going on and do's and don'ts to be followed

9.5.3 Competition on HSE and award

• Site will arrange different competition (slogan, poster, essay etc.) on HSE time to time (Safety day, BHEL day, World Environment Day etc.) and winners will be suitably awarded.

9.5.4 HSE awareness programme

• Subcontractor shall arrange HSE awareness programme periodically on different topics including medical awareness for all personnel working at site

10.0 HSE COMMUNICATION

10.1 INCIDENT REPORTING

- The subcontractor shall submit report of all incidents, fires and property damage etc to the Engineer immediately
 after such occurrence, but in any case not later than 24 hours of the occurrence. Such reports shall be furnished
 in the manner prescribed by BHEL. (Refer HSE procedure for incident investigation, analysis and reporting for
 details)
- In addition, periodic reports on safety shall also be submitted by the subcontractor to BHEL from time to time as prescribed by the Engineer. Compiled monthly reports of all kinds of incidents, fire and property damage to be submitted to BHEL safety officer as per prescribed formats.
- HSE incidents of site shall be reported to BHEL site Management as per Procedure for Incident Investigation
 and Reporting in format no. HSEP:14-F15. Corrective action shall be immediately implemented at the work place
 and compliance shall be verified by BHEL HSE officer and until then, work shall be put on hold by Construction
 Manager.

10.2 HSE EVENT REPORTING

- Important HSE events like HSE training, Medical camp etc. organized at site shall be reported to BHEL site
 management in detail with photographs for publication in different in-house magazines
- Celebration of important days like National Safety Day, World Environment Day etc. shall also be reported as mentioned above.

10.3 DAILY HSE ACTIVITY REPORTING

Daily HSE activities shall be reported by subcontractor to BHEL as per Format No. HSEP:14-F31A



S REV:

REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **19** of **43**

POWER SECTOR

11.0 OPERATIONAL CONTROL

All applicable OCPs (Operational control procedures) will be followed by subcontractor as per BHEL instructions. This will be done as part of normal scope of work. List of such OCPs is given below. In case any other OCP is found to be applicable during the execution of work at site, then subcontractor will follow this as well, within quoted rate. These OCPs (applicable ones) will be made available to subcontractor during work execution at site. However for reference purpose, these are kept with Safety Officer of BHEL at the Power Sector Regional HQ, or available in downloadable format in the website, which may be refereed by subcontractor, if they so desire.

LIST OF OCPs

Safe handling of chemicals	Safety in use of cranes	Hydraulic test
Electrical safety	Storage and handling of gas cylinders	Spray insulation
Energy conservation	Manual arc welding	Trial run of rotary equipment
Safe welding and gas cutting operation	Safe use of helmets	Stress relieving
Fire safety	Good house keeping	Material preservation
Safety in use of hand tools	Working at height	Cable laying/tray work
First aid	Safe excavation	Transformer charging
Food safety at canteen	Safe filling of hydrogen in cylinder	Electrical maintenance
Illumination	Vehicle maintenance	Safe handling of battery system
Handling and erection of heavy metals	Safe radiography	Computer operation
Safe acid cleaning	Waste disposal	Storage in open yard
Safe alkali boil out	Working at night	For sanitary maintenance
Safe oil flushing	Blasting	Batching
Steam blowing	DG set	Piling rig operation
Safe working in confined area	Handling & storage of mineral wool	Gas distribution test
Safe operation of passenger lift, material hoists & cages	Drilling, reaming and grinding(machining)	Cleaning of hotwell / deaerator
Electro-resistance heating	Compressor operation	O&M of control of AC plant & system
Air compressor	Passivation	Safe Loading of Unit
Safe EDTA Cleaning	Safe Chemical cleaning of Pre boiler system	Safe Boiler Light up
Safe Rolling and Synchronization		

11.1 HSE ACTIVITIES

HSE activities shall be conducted at site based on the HSEMSM developed by Power Sector and issued to site by Regions.

While planning for any activity the following documents shall be referred for infrastructural requirements to establish control measures:

- 1) HSE Procedure for Register of OHS Hazards and Risks
- 2) HSE Procedure for Register of Environmental Aspects and Impacts
- 3) HSE Procedure for Register of Regulations



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS REV:

> 20.01.2020 Date:

> > Page: **20** of **43**

Doc no.: HSEP: 14

01

POWER SECTOR

- **Operational Control Procedures**
- 5) HSE Procedure for Emergency Preparedness and Response Plan
- 6) Contract documents

11.2 **WORK PERMIT SYSTEM**

- The following activities shall come under Work Permit System
 - a. Height working above 2 metres
 - b. Hot working at height
 - c. Confined space
 - d. Radiography
 - e. Excavation more than 4 meter depth
 - f. Heavy lifting above 50 ton

Refer Annexure 05 for Work permit formats.

- "HSE Procedure for Work Permit System" shall be followed while implementing permit system. Where customer is having separate Work Permit System the same shall be followed.
- □ Permit applicant shall apply for work permit of particular work activity at particular location before starting of the work with Job Hazard Analysis.
- Permit signatory shall check that all the control measures necessary for the activity are in place and issue the permit to the permit holder.
- □ Permit holder shall implement and maintain all control measures during the period of permit .He will close the permit after completion of the work. The closed permit shall be archived in HSE Department of site.

SAFETY DURING WORK EXECUTION 11.3

Respective OCPS are to be followed and adherence to the same would be contractually binding

11.3.1 WELDING SAFETY

All safety precautions shall be taken for welding and cutting operations as per IS-818. All safety precautions shall be taken for foundation and other excavation marks as per IS-3764.

RIGGING 11.3.2

Rigging equipment shall not be loaded in excess of its recommended safe working load. Rigging equipment, when not in use, shall be removed from the original work area so as not to present a hazard to employees.

CYLINDERS STORAGE AND MOVEMENT 11.3.3

All gas cylinders shall be stored in upright position. Suitable trolley shall be used. There shall be flash-back arrestors conforming to IS-11006 at both cylinder and burner ends. Damaged tube and regulators must be immediately replaced. No of cylinders shall not exceed the specified quantity as per OCP

Cylinders shall be moved by tilting and rolling them on their bottom edges. They shall not be intentionally dragged, struck or permitted to strike each other violently.



REV:

20.01.2020 Date:

Doc no.: HSEP: 14

01

POWER SECTOR **21** of **43** Page:

When cylinders are transported by powered vehicle they shall be secured in a vertical position.

11.3.4 DEMOLITION WORK

Before any demolition work is commenced and also during the process of the work the following shall be ensured:

- All roads and open areas adjacent to the work site shall either be closed or suitably protected.
- No electric cable or apparatus which is liable to be a source of danger nor a cable or an apparatus used by the operator shall remain electrically charged.
- All practical steps shall be taken to prevent danger to persons employed from the risks of fire or explosion or flooding. No floor, roof or other part of the building shall be so overloaded with debris or materials as to render them unsafe.

11.3.5 T&Ps

All T&Ps/ MMEs should be of reputed brand/appropriate quality & must have valid test/calibration certificates bearing endorsement from competent authority of BHEL..Subcontractor to also submit monthly reports of T&Ps deployed and validity test certificates to BHEL safety Officer as per the format/procedure of BHEL.

11.3.6 CHEMICAL HANDLING

Displaying safe handling procedures for all chemicals such as lube oil, acid, alkali, sealing compounds etc , at work place. Where it is necessary to provide and/or store petroleum products or petroleum mixture & explosives, the subcontractor shall be responsible for carrying out such provision / storage in accordance with the rules & regulations laid down in the relevant petroleum act, explosive act and petroleum and carbide of calcium manual, published by the chief inspector of explosives of India. All such storage shall have prior approval if necessary from the chief inspector of explosives or any other statutory authority. The subcontractor shall be responsible for obtaining the same.

11.3.7 ELECTRICAL SAFETY

- Providing adequate no. of 24 V sources and ensure that no hand lamps are operating at voltage level above 24 Volts.
- Fulfilling safety requirements at all power tapping points.
- High/ Low pressure welders to be identified with separate colour clothings. No welders will be deployed without passing appropriate tests and holding valid welding certificates. Approved welding procedure should be displayed at work place.
- The subcontractor shall not use any hand lamp energized by Electric power with supply voltage of more than 24 volts in confined spaces like inside water boxes, turbine casings, condensers etc.
- All portable electric tools used by the subcontractor shall have safe plugging system to source of power and be appropriately earthed. Only electricians licensed by appropriate statutory authority shall be employed by the subcontractor to carry out all types of electrical works. Details of earth resource ad their test date to be given to BHEL safety officer as per the prescribed formats of BHEL
- The subcontractor shall use only properly insulated and armored cables which conform to the requirement of Indian Electricity Act and Rules for all wiring, electrical applications at site.



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

Page: **22** of **43**

POWER SECTOR

- BHEL reserves the right to replace any unsafe electrical installations, wiring, cabling etc. at the cost of the subcontractor.
- All electrical appliances used in the work shall be in good working condition and shall be properly earthed.
- No maintenance work shall be carried out on live equipment.
- The subcontractor shall maintain adequate number of qualified electricians to maintain his temporary electrical installations.
- Area wise Electrical safety inspection is to be carried out on monthly basis as per "Electrical Safety Inspection checklist" and the report is to be submitted to BHEL safety officer
- Adequate precautions shall be taken to prevent danger for electrical equipment. No materials on any of the sites of work shall be so stacked or placed as to cause danger or inconvenience to any person or the public
- The subcontractor shall carefully follow the safety requirement of BHEL/ the purchaser with the regard to voltages used in critical areas.

11.3.8 FIRE SAFETY

- Providing appropriate fire fighting equipment at designated work place and nominate a fire officer/warden adequately trained for his job.
- Subcontractor shall provide enough fire protecting equipment of the types and numbers at his office, stores, temporary structure in labor colony etc. Such fire protection equipment shall be easy and kept open at all times.
- The fire extinguishers shall be properly refilled and kept ready which should be certified at periodic intervals. The date of changing should be marked on the Cylinders.
- All other fire safety measures as laid down in the "codes for fire safety at construction site" issued by safety coordinator of BHEL shall be followed.
- Non-compliance of the above requirement under fire protection shall in no way relieve the subcontractor of any of his
 responsibility and liabilities to fire incident occurring either to his materials or equipment or those of others.
- Emergency contacts nos must be displayed at prominent locations
- Tarpaulin being inflammable should not be used (instead, only non-infusible covering materials shall be used) as protective cover while preheating, welding, stress relieving etc. at site.

11.3.9 SCAFFOLDING

- Suitable scaffolds shall be provided for workman for all works that cannot safely be done from the ground, or from solid construction except in the case of short duration of work which can be done safely from ladders.
- When a ladder is used, it shall be of rigid construction made of steel. The steps shall have a minimum width of 45 cm and a maximum rise of 30 cm. Suitable handholds of good quality wood or steel shall be provided and the ladder shall be given an inclination not steeper then ¼ horizontal and 1 vertical.
- Scaffolding or staging more than 3.6 m above the ground floor, swung or suspended from an overhead support or
 erected with stationery support shall have a guard rail properly bolted, braced or otherwise secured, at least 90 cm above
 the floor or platform of such scaffolding or staging and extending along the entire length of the outside and ends thereof
 with only such openings as may be necessary for the delivery of materials. Such scaffolding or staging shall be so
 fastened as to prevent it from saver, from swaying, from the building or structure.

11.3.10 **WORK AT HEIGHT**:

• Guardrails and toe-board/barricades and sound platform conforming to IS:4912-1978 should be provided.



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

Page: **23** of **43**

POWER SECTOR

- Wherever necessary, life-line (pp or metallic) and fall arrestor along with Polyamide rope or Retractable lifeline should be provided.
- Safety Net as per IS:11057:1984 should be used extensively for prevention/ arrest of men and materials falling from height. The safety nets shall be fire resistant, duly tested and shall be of ISI marked and the nets shall be located as per site requirements to arrest or to reduce the consequences of a possible fall of persons working at different heights.
- Reaching beyond barricaded area without lifeline support, moving with support of bracings, walking on beams without support, jumping from one level to another, throwing objects and taking shortcut must be discouraged.
- Use of Rebar steel for making Jhoola and monkey-ladder (Rods welded to vertical or inclined structural members), temporary platform etc. must be avoided.
- Monkey Ladder should be properly made and fitted with cages.
- Jhoola should be made with angles and flats and tested like any lifting tools before use.
- Lanyard must be anchored always and in case of double lanyard, each should be anchored separately.
- In case of pipe-rack, persons should not walk on pipes and walk on platforms only.
- In case of roof work, walking ladder/ platform should be provided along with lifeline and/ or fall arrestor.
- Empty drums must not be used.
- For chimney or structure painting, both hanging platform and men should be anchored separately to a firm structure along with separate fall arrestor. Rope ladder should be discouraged.

11.3.11 WORKING PLATFORM

Working platforms, gangways and stairways shall be so constructed that they do not sag unduly or unequally and if the height of the platform gangways provided is more than 3.6 m above ground level or floor level, they shall be closely boarded and shall have adequate width which shall not be less than 750 mm and be suitably fenced as described above. Every opening in the floor or a building or in a working platform shall be provided with suitable means to prevent the fall of persons or materials by providing suitable fencing or railing whose minimum height shall be 90 cm.

11.3.12 EXCAVATION

Wherever there are open excavation in ground, they shall be fenced off by suitable railing and danger signals installed at night so as to prevent persons slipping into the excavations.

11.3.13 LADDER SAFETY

Safe means of access shall be provided to all working places. Every ladder shall be securely fixed. No portable single ladder shall be over 9 m in the length while the width between side rails in rung ladder shall in no case be less than app. 29.2 cm for ladder upto and including 3 m in length. For longer ladders this width shall be increased at least ¼" for each additional foot of length.

A sketch of the ladders and scaffolds proposed to be used shall be prepared and approval of the Engineer obtained prior to Construction.

11.3.14 LIFTING SAFETY

• It will be the responsibility of the subcontractor to ensure safe lifting of the equipment, taking due precaution to avoid any incident and damage to other equipment and personnel.



REV: 01

Date: 20.01.2020

Page: **24** of **43**

Doc no.: HSEP: 14

POWER SECTOR

 All requisite tests and inspection of handling equipment, tools & tackle shall be periodically done by the subcontractor by engaging only the Competent Persons as per law.

- Defective equipment or uncertified shall be removed from service.
- Any equipment shall not be loaded in excess of its recommended safe working load.

11.3.15 HOISTING APPLIANCE

- Motors, gearing, transmission, electric wiring and other dangerous parts of hoisting appliances should be provided with efficient safe guards.
- Hoisting appliance should be provided with such means as will reduce to the minimum the risk of any part of a suspended load becoming incidentally displaced.
- When workers employed on electrical installations which are already energized, insulating mats, wearing apparel, such as gloves, sleeves and boots as may be necessary should be provided.
- The worker should not wear any rings, watches and carry keys or other materials which are good conductor of electricity.

11.4 ENVIRONMENTAL CONTROL

Environment protection has always been given prime importance by BHEL. Environmental damage is a major concern of the principal subcontractor and every effort shall be made, to have effective control measures in place to avoid pollution of Air, Water and Land and associated life. Chlorofluorocarbons such as carbon tetrachloride and trichloroethylene shall not be used. Waste disposal shall be done in accordance with the guidelines laid down in the project specification.

Any chemical including solvents and paints, required for construction shall be stored in designated bonded areas around the site as per Material Safety Data Sheet (MSDS).

In the event of any spillage, the principle is to recover as much material as possible before it enters drainage system and to take all possible action to prevent spilled materials from running off the site. The subcontractor shall use appropriate MSDS for clean-up technique

All subcontractors shall be responsible for the cleanliness of their own areas.

The subcontractors shall ensure that noise levels generated by plant or machinery are as low as reasonably practicable. Where the subcontractor anticipates the generation of excessive noise levels from his operations the subcontractor shall inform to Construction Manager of BHEL accordingly so that reasonable &practicable precautions can be taken to protect other persons who may be affected.

It is imperative on the part of the subcontractor to join and effectively contribute in joint measures such as tree plantation, environment protection, contributing towards social upliftment, conversion of packing woods to school furniture, keeping good relation with local populace etc.

The subcontractor shall carry out periodic air and water quality check and illumination level checking in his area of work place and take suitable control measure.

11.5 HOUSEKEEPING

 Keeping the work area clean/ free from debris, removed scaffoldings, scraps, insulation/sheeting wastage /cut pieces, temporary structures, packing woods etc. will be in the scope of the subcontractor. Such cleanings has to be done by



REV: 01

Doc no.: HSEP: 14

Date:

20.01.2020

Page:

25 of **43**

POWER SECTOR

subcontractor within quoted rate, on daily basis by an identified group. If such activity is not carried out by subcontractor / BHEL is not satisfied, then BHEL may get it done by other agency and actual cost along with BHEL overheads will be deducted from contractor's bill. Such decisions of BHEL shall be binding on the subcontractor

- Proper housekeeping to be maintained at work place and the following are to be taken care of on daily basis.
- All surplus earth and debris are removed/disposed off from the working areas to identified locations.
- Unused/Surplus cables, steel items and steel scrap lying scattered at different places/elevation within the working
 areas are removed to identified locations.
- All wooden scrap, empty wooden cable drums and other combustible packing materials, shall be removed from workplace to identified locations. Sufficient waste bins shall be provided at
- Different work places for easy collection of scrap/waste. Scrap chute shall be installed to remove scrap from high location.
- Access and egress (stair case, gangways, ladders etc.) path should be free from all scrap and other hindrances.
- Workmen shall be educated through tool box talk about the importance of housekeeping and encourage not to litter.
- Labour camp area shall be kept clear and materials like pipes, steel, sand, concrete, chips and bricks, etc. shall not be allowed in the camp to obstruct free movement of men and machineries.
- Fabricated steel structures, pipes & piping materials shall be stacked properly.
- No parking of trucks/trolleys, cranes and trailers etc. shall be allowed in the camp, which may obstruct the traffic movement as well as below LT/HT power line.
- Utmost care shall be taken to ensure over all cleanliness and proper upkeep of the working areas

11.6 WASTE MANAGEMENT

Take suitable measures for waste management and environment related laws/legislation as a part of normal construction activities. Compliance with the legal requirements on storage/ disposal of paint drums (including the empty ones), Lubricant containers, Chemical Containers, and transportation and storage of hazardous chemicals will be strictly maintained.

11.6.1 BINS AT WORK PLACE

- Sufficient rubbish bins shall be provided close to workplaces.
- Bins should be painted yellow and numbered.
- Sufficient nos. of drip trays shall be provided to collect oil and grease.
- Sufficient qty. of broomsticks with handle shall be provided.
- Adequate strength of employees should be deployed to ensure daily monitoring and service for waste management.

11.6.2 STORAGE AND COLLECTION

- Different types of rubbish/waste should be collected and stored separately.
- Paper, oily rags, smoking material, flammable, metal pieces should be collected in separate bins with close fitting
 lide.
- Rubbish should not be left or allowed to accumulate on construction and other work places.
- Do not burn construction rubbish near working site.



RS REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **26** of **43**

POWER SECTOR

11.6.3 SEGREGATION

- Earmark the scrap area for different types of waste.
- Store wastes away from building.
- Oil spill absorbed by non-combustible absorbent should be kept in separate bin.
- Clinical and first aid waste stored and incinerated separately.

11.6.4 DISPOSAL

- Sufficient containers and scrap disposal area should be allocated.
- All scrap bin and containers should be conveniently located.
- Provide self-closing containers for flammable/spontaneously combustible material.
- · Keep drainage channels free from choking.
- Make schedule for collection and disposal of waste.

11.6.5 WARNING AND SIGNS

- Appropriate sign to be displayed at scrap storage area
- No toxic, corrosive or flammable substance to be discarded into public sewage system.
- Waste disposal shall be in accordance with best practice.
- Comply with all the requirements of Pollution Control Board (PCB) for storage and disposal of hazardous waste.

11.7 TRAFFIC MANAGEMENT SYSTEM

11.7.1 SAFE WORKPLACE TRANSPORT SYSTEM

- Traffic routes in a work place shall be suitable for the persons or vehicles using them. This shall be sufficient in number and of sufficient size. This shall reflect the suitability of traffic routes for vehicles and pedestrians.
- Where vehicles and pedestrians use the same traffic routes there shall be sufficient space between them. Where
 necessary all traffic routes must be suitably indicated. Pedestrians or vehicles must be able to use traffic routes
 without endangering those at work. There must be sufficient separation of traffic routes from doors, gates and
 pedestrian traffic routes.
- For internal traffic, lines marked on roads / access routes and between buildings shall clearly indicate where vehicles are to pass.
- Temporary obstacles shall be brought to the attention of drivers by warning signs or hazard cones.
- Speed limits shall be clearly displayed. Speed ramps preceded by a warning signs or marker are necessary.
- The traffic route should be wide enough to allow vehicles to pass and re-pass oncoming or parked traffic and it may be advisable to introduce on-way system or parking restrictions.
- Safest route shall be provided between places where vehicles have to call or deliver.
- Avoid vulnerable areas/items such as fuel or chemicals tanks or pipes, open or unprotected edges and structures likely to collapse



REV:

01 Date: 20.01.2020

Doc no.: HSEP: 14

Page: **27** of **43**

POWER SECTOR

Safe areas shall be provided for loading and unloading.

- Avoid sharp or blind bends. If this is not possible hazards should be indicated e.g. blind corner.
- Ensure road crossings are minimum and clearly signed.
- Entrance and gateways shall be wide enough to accommodate a second vehicle without causing obstruction.
- Set sensible speed limits which are clearly sign posted.
- Where necessary ramps should be used to retard speed. This shall be preceded by a warning sign or mark on the road.
- Forklift trucks shall not pass over road hump unless of a type capable of doing so.
- Overhead electric cable, pipes containing flammable hazardous chemical shall be shielded by using goal posts height gauge posts or barriers.
- Road traffic signs shall be provided on prominent locations for prevention of incidents and hazards and for quick guidance and warning to employees and public. Safety signs shall be displayed as per the project working requirement and guideline of the state in which project is done. Vehicles hired or used shall not be parked within the 15m radius of any working area. Any vehicle, that is required to be at the immediate/near the vicinity, shall be approved by the person in-charge of the site.

11.7.2 TRAFFIC ROUTE FOR PEDESTRIANS

- Where traffic routes are used by both pedestrians and vehicles road shall be wide enough to allow vehicles and pedestrians safely.
- Separate routes shall be provided for pedestrians to keep them away from vehicles. Provide suitable barriers/guard at entrances/exit and the corners or buildings.
- Where pedestrian and vehicle routes cross, appropriate crossing shall be provided.
- Where crowd is likely to use roadway e.g. at the end of shift, stop vehicles from using them at such times.
- Provide high visibility clothing for people permitted in delivery area.

11.7.3 WORK VEHICLE

Work vehicle shall be as safe stable efficient and roadworthy as private vehicles on public roads. Site management shall ensure that drivers are suitably trained. All vehicle e.g. heavy motor vehicle forklift trucks dump trucks mobile cranes shall ensure that the work equipment conforms to the following:

- A high level of stability.
- o A safe means of access/egress.
- o Suitable and effective service and parking brakes.
- Windscreens with wipers and external mirrors giving optimum all round visibility.
- o Provision of horn, vehicle lights, reflectors, reversing lights, reversing alarms.
- Provision of seat belts.
- Guards on dangerous parts.
- Driver protection to prevent injury from overturning and from falling objects/materials.
- Driver protection from adverse weather.
- No vehicle shall be parked below HT/LT power lines.
- Valid Pollution Under Control certification for all vehicles



REV:

Date: 20.01.2020

> Page: **28** of **43**

Doc no.: HSEP: 14

01

POWER SECTOR

11.7.4 **DAILY CHECK BY DRIVER**

- There should also be daily safety checks containing below mentioned points by the driver before the vehicle is
 - Brakes. 0
 - Tires. 0
 - Steering. 0
 - Mirrors.
 - Windscreen waters.
 - 0 Wipers.
 - Warning signals.
 - Specific safety system i.e. control interlocks
- Management should ensure that drivers carry out these checks.

11.7.5 TRANSPORTATION OF PERSONNEL AND MATERIALS BY VEHICLES

- All drivers shall hold a valid driving License for the class of vehicle to be driven and be registered as an authorized BHEL driver with the Administration Department.
- Securing of the load shall be by established and approved methods, i.e. chains with patented tightening equipment for steel/heavy loads. Sharp corners on loads shall be avoided when employing ropes for securing.
- All overhangs shall be made clearly visible and restricted to acceptable limits
- Load shall be checked before moving off and after traveling a suitable distance.
- On no account is construction site to be blocked by parked vehicles Drivers of vehicles shall only stop or park in the areas designate by the stringing foreman.
- Warning signs shall be displayed during transportation of material. All vehicles used by BHEL shall be in worthy condition and in conformance to the Land Transport requirement.

11.7.6 MAINTENANCE

All Vehicles used for transportation of man and material shall undergo scheduled inspections on frequent intervals to secure safe operation. Such inspections shall be conducted in particular for steering, brakes, lights, horn, doors etc. Site management shall ensure that work equipment is maintained in an efficient, working order and in good repair. Inspections and services carried out at regular intervals of time and or mileage. No maintenance shall be carried below HT/LT power lines.

EMERGENCY PREPAREDNESS AND RESPONSE 11.8

- Emergency preparedness and response capability of site shall be developed as per Emergency Preparedness and Response plan issued by Regional HQ
- Availability of adequate number of first aiders and fire warden shall be ensured with BHEL and its subcontractors
- All the subcontractor's supervisory personnel and sufficient number of workers shall be trained for fire protection systems. Enough number of such trained personnel must be available during the tenure of contract. Subcontractor should nominate his supervisor to coordinate and implement the safety measures.
- Assembly point shall be earmarked and access to the same from different location shall be shown
- Fire exit shall be identified and pathway shall be clear for emergency escape.



REV: 01

Date: 20

20.01.2020

Page: **29** of **43**

Doc no.: HSEP: 14

POWER SECTOR

- Appropriate type and number of fire extinguisher shall be deployed as per Fire extinguisher deployment plan and validity shall be ensured periodically through inspection
- Adequate number of first aid boxes shall be strategically placed at different work places to cater emergency need. Holder of the first aid box shall be identified on the box itself who will have the responsibility to maintain the same
- · First aid center shall be developed at site with trained medical personnel and ambulance
- Emergency contact numbers (format given in EPRP) of the site shall be displayed at prominent locations.
- Tie up with fire brigade shall be done in case customer is not having fire station.
- Tie up with hospital shall be done in case customer is not having hospital.
- Disaster Management group shall be formed at site
- Mock drill shall be arranged at regular intervals. Monthly report of the above to be given to BHEL safety Officer as per prescribed BHEL formats
- Mock drill shall be conducted on different emergencies periodically to find out gaps in emergency preparedness and taking necessary corrective action

12.0 HSE INSPECTION

Inspection on HSE for different activities being carried out at site shall be done to ensure compliance to HSEMS requirements. The subcontractor shall maintain and ensure necessary safety measures as required for inspection and tests HV test, Pneumatic test, Hydraulic test, Spring test, Bend test etc. as applicable, to enable inspection agency for performing Inspection. If any test equipment is found not complying with proper safety requirements then the Inspection Agency may withhold inspection, till such time the desired safety requirements are met.

12.1 DAILY HSE CHECKS

Both the Site Supervisors and safety officer of Subcontractor are to conduct daily site Safety inspection around work activities and premises to ensure that work methods and the sites are maintained to an acceptable standard. The following are to form the common subjects of a daily safety inspection:

- Personal Safety wears & gear compliance.
- Complying with site safety rules and permit-to-work (PTW).
- Positions and postures of workers.
- Use of tools and equipment etc. by the workers.

The inspection should be carried out just when work starts in beginning of the day, during peak activities period of the day and just before the day's work ends.

12.2 INSPECTION OF PPE

- PPEs shall be inspected by HSE officer at random once in a week as per format no. HSEP:14-F06 for its compliance to standard and compliance to use and any adverse observation shall be recorded in the PPE register.
- The applicable PPEs for carrying out particular activities are listed below.



551

REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: 30 of 43

POWER SECTOR

12.3 INSPECTION OF T&Ps

- A master list of T&Ps shall be maintained by each subcontractor.
- All T&Ps being used at site shall be inspected by HSE officer once in a month as per format no. HSEP:14-F07 for its healthiness and maintenance.
- The T&Ps which require third party inspection shall be checked for its validity during inspection. The third party test certificate should be accompanied with a copy of the concerned competent person's valid qualification record.
- The validity of T&P shall be monitored as per "Status of T&Ps" format no. HSEP:14-F08

12.4 INSPECTION OF CRANES AND WINCHES

- Cranes and winches shall be inspected by the operator through a daily checklist for its safe condition (as provided by the equipment manufacturer) before first use of the day.
- Cranes and Winches shall be inspected by HSE officer once in a month as per format no. HSEP:14-F09 for healthiness, maintenance and validity of third party inspection.
- The date of third party inspection and next due date shall be painted on cranes and winches.
- The operators/drivers shall be authorized by sub-contractor based on their competency and experience and shall carry the I-card.
- The operator should be above 18 years of age and should be in possession of driving license of HMV man & goods), vision test certificate and should have minimum qualification so that he can read the instructions and check list.

12.5 INSPECTION ON HEIGHT WORKING

- Inspection on height working shall be conducted daily by supervisors before start of work to ensure safe working condition including provision of
 - Fall arrestor
 - Lifelines
 - Safety nets
 - Fencing and barricading
 - Warning signage
 - Covering of opening
 - Proper scaffolding with access and egress.
 - Illumination
- Inspection on height working shall be conducted once in a week by HSE officer as per format no. HSEP:14-F10.
- Medical fitness of height worker shall be ensured.
- Height working shall not be allowed during adverse weather.

12.6 INSPECTION ON WELDING AND GAS CUTTING OPERATION

- Supervisor shall ensure that no flammable items are available in near vicinity during welding and gas cutting activity.
- Gas cylinders shall be kept upright.
- Use of Flash back arrestor shall be ensured at both ends.



REV:

01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **31** of **43**

POWER SECTOR

- Inspection during welding and gas cutting operations shall be carried out by HSE officer once a month as per format no. HSEP:14-F11.
- Use of fire blanket to be ensured to avoid falling of splatters during welding or gas cutting operation at height.
- Availability of fire extinguisher at vicinity shall be ensured.

12.7 INSPECTION ON ELECTRICAL INSTALLATION/APPLIANCES

- Ensure proper earthing in electrical installation
- Use ELCB at electrical booth
- Electrical installation shall be properly covered at top where required
- Use appropriate PPEs while working
- Use portable electrical light < 24 V in confined space and potentially wet area.
- Monthly inspection shall be carried out as per format no. HSEP:14-F12.

12.8 **INSPECTION OF ELEVATOR**

- Elevators shall be inspected by concerned supervisors once in a week as per format no. HSEP:14-F13.
- All elevators shall be inspected by competent person and validity shall be ensured.
- The date of third party inspection and next due date shall be painted on elevator.

12.9 **INSPECTION OF EXCAVATION**

Excavation activities shall be inspected as per Format HSEP:14-F13A

13.0 **HSE PERFORMANCE**

- Contractor shall be assessed on monthly basis for HSE Compliance by BHEL Safety In-charge at site. The HSE compliance shall be based on Online HSE Evaluation System of BHEL as per Format No. HSEP:14-
- BHEL shall reserve the right to use this assessment for evaluating bidder's capacity for future tenders
- Suitable HSE reward system shall be developed at site level to promote HSE compliance amongst workmen by the subcontractor.
 - To decide HSE reward, performance towards HSE shall be evaluated for workmen and it shall be awarded regularly in public gathering.
- If safety record of the subcontractor in execution of the awarded job is to the satisfaction of safety department of BHEL, issue of an appropriate certificate to recognize the safety performance of the subcontractor may be considered by BHEL after completion of the job.



HEALTH, SAFETY AND ENVIRONMENT **PLAN FOR**

SITE OPERATION by SUBCONTRACTORS REV:

> 20.01.2020 Date:

> > Page: **32** of **43**

Doc no.: HSEP: 14

01

POWER SECTOR

14.0 **HSE PENALTIES**

- As per contractual provision HSE penalties shall be imposed on subcontractors for non- compliance on HSE requirement as per format no. HSEP:14-F14. The list in the format is only indicative. For any other violation, not listed in the format, the minimum penalty amount is to be decided as per BOCW act.
- If principal customer/statutory and regulatory bodies impose some penalty on HSE due to the non-compliance of the subcontractor the same shall be passed on to them.
- The penalty amount shall be recovered by Site Finance department from subcontractors from the RA/Final bill.

OTHER REQUIREMENTS 15.0

- In case of any delay in completion of a job due to mishaps attributable to lapses by the subcontractor, BHEL shall have the right to recover cost of such delay from the payments due to the subcontractor, after notifying the subcontractor suitably.
- If the subcontractor fails to improve the standards of safety in its operation to the satisfaction of BHEL after being given reasonable opportunity to do so and/or if the subcontractor fails to take appropriate safety precautions or to provide necessary safety devices and equipment or to carry out instruction regarding safety issued by BHEL, BHEL shall have the right to take corrective steps at the risk and cost of the subcontractor after giving a notice of not less than 7 days indicating the steps that would be taken by BHEL.
- If the subcontractor succeeds in carrying out its job in time without any fatal or disabling injury incident and without any damage to property BHEL may, at its sole discretion, favorably consider to reward the subcontractor suitably for the performance.
- In case of any damage to property due to lapses by the subcontractor, BHEL shall have the right to recover the cost of such damages from the subcontractor after holding an appropriate enquiry.
- The subcontractor shall take all measures at the sites of the work to protect all persons from incidents and shall be bound to bear the expenses of defense of every suit, action or other proceeding of law that may be brought by any persons for injury sustained or death owing to neglect of the above precautions and to pay any such persons such compensation or which may with the consent of the subcontractor be paid to compromise any claim by any such person, should such claim proceeding be filed against BHEL, the subcontractor hereby agrees to indemnify BHEL against the same.
- The subcontractor shall not employ men below the age of 18 years and women on the work of painting with products containing lead in any form. Wherever men above the age of 18 are employed on the work of lead painting, overalls shall be supplied by the subcontractor to the workmen and adequate facilities shall be provided to enable the working painters to wash during the cessation of work.
- The subcontractor shall notify BHEL of his intention to bring to site any equipment or material which may create hazard.
- BHEL shall have the right to prescribe the conditions under which such equipment or materials may be handled and the subcontractor shall adhere to such instructions.



REV:

20.01.2020 Date:

POWER SECTOR Page: **33** of **43**

Doc no.: HSEP: 14

01

BHEL may prohibit the use of any construction machinery, which according to the organization is unsafe. No claim for compensation due to such prohibition will be entertained by BHEL.

16. NON COMPLIANCE

NONCONFORMITY OF SAFETY RULES AND SAFETY APPLIANCES WILL BE VIEWED SERIOUSLY AND BHEL HAS RIGHT TO IMPOSE FINES ON THE SUBCONTRACTOR AS UNDER FOR EVERY INSTANCE OF VIOLATION NOTICED:

SN	Violation of Safety Norms	Fine (in Rs)
01	Not Wearing Safety Helmet	200/- *
02.	Not wearing Safety Belt or not anchoring life line	500/-*
03	Not wearing safety shoe	200/-*
04	Not keeping gas cylinders vertically	200/-
05	Not using flash back arrestors	100/-
06	Not wearing gloves	50/- *
07.	Grinding Without Goggles	50/- *
08.	Not using 24 V Supply For Internal Work	500/-
09.	Electrical Plugs Not used for hand Machine	100/-
10.	Not Slinging properly	200/-
11.	Using Damaged Sling	200/-
12.	Lifting Cylinders Without Cage	500/-
13.	Not Using Proper Welding Cable With Lot of Joints And Not Insulated Property.	200/-
14.	Not Removing Small Scrap From Platforms	500/-
15.	Gas Cutting Without Taking Proper Precaution or Not Using Sheet Below Gas Cutting	500/-
16.	Not Maintaining Electric Winches Which are Operated Dangerously	500/-
17.	Improper Earthing Of Electrical T&P	500/-
18	No or improper barricading	500/-
19.	Activity carried out without Safety work permit (Height work, Lifting activity, Hot work-each person/case)	1000/-
20.	Incident Resulting in Partial Loss in Earning Capacity	25,000/- per victim
21.	Fatal Incident Resulting in total loss in Earning Capacity	1,00,000/- per victim for first instance #

Legend:-

#: or as deducted by customer, whichever is higher. For repeated fatal incident in the same Unit incremental penalty to be imposed. The subcontractor will pay 2 times the penalty compared to previously paid in case there are repeated cases of fatal incidents under the same subcontractor for the same package in the same unit.

Any other non-conformity noticed not listed above will also be fined as deemed fit by BHEL. The decision of BHEL engineer is final on the above. The amount will be deducted from running bills of the subcontractor. The amount collected above will be utilized for giving award to the employees who could avoid incident by following safety rules. Also the amount will be spent for purchasing the safety appliances and supporting the safety activity at site.

^{*:} per head. For repeated violation by the same person, the penalty would be double of the previous penalty. Date of "Repeated violation" will be counted from subsequent days.



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS REV:

> Date: 20.01.2020

POWER SECTOR Page: **34** of **43**

Doc no.: HSEP: 14

01

17.0 **HSE AUDIT/INSPECTION**

- Regular HSE Audit/inspection shall be carried out by Subcontractor as per Site HSE audit calendar.
- HSE checklist (Annexure 02) shall be used for carrying out audit/inspection and report shall be submitted to BHEL site management
- All non-conformities and observations on HSE identified during internal or external HSE audit shall be disposed off by site in a time bound manner and reported back the implementation status
- Corrective action and Preventive action on HSE issues raised by certification body issued by Regional HQs shall be implemented by site and reported to Site management.

18.0 MONTHLY HSE REVIEW MEETING

- Site shall hold HSE review meeting every month to discuss and resolve HSE issues of site and improve HSE performance. It will also discuss the incidents occurred since previous meeting, its root cause and Corrective action and Preventive action. The agenda is given below:
 - Implementation of earlier MOM
 - **HSE** performance
 - **HSE** inspection Ω
 - HSE audit and CAPA
 - **HSE** training
 - Health check-up camp
 - HSE planning for the erection and commissioning and installation activities in the coming month
 - HSE reward and promotional activities
- The meeting shall be chaired by Construction Manager, convened by HSE coordinator and attended by all HOS, Site Incharge of Subcontractors and HSE officer of Subcontractors.
- MOM on the discussion will be circulated to the concerned for implementation.

FORMATS USED (Details available in Annexure-04)

SL. No.	Format Name	Format No.	Rev No.
01	Inspection of First Aid Box	HSEP:14-F01	00
02	Health Check Up	HSEP:14-F02	00
03	HSE Induction Training	HSEP:14-F03	00
04	Tool Box Talk	HSEP:14-F04	00
05	Monthly Site HSE Report	As specified by BHEL	00
06	Inspection of PPE	HSEP:14-F06	00



01

REV:

20.01.2020 Date:

Doc no.: HSEP: 14

Page: **35** of **43**

POWER SECTOR

07	Inspection of T&Ps	HSEP:14-F07	00
08	Status of T&Ps	HSEP:14-F08	00
09	Inspection of Cranes and Winches	HSEP:14-F09	00
10	Inspection on Height Working	HSEP:14-F10	00
11	Inspection on Welding & Gas Cutting	HSEP:14-F11	00
12	Inspection on Electrical Installation	HSEP:14-F12	00
13	Inspection on Elevator	HSEP:14-F13	00
14	HSE Penalty	HSEP:14-F14	00
15	Accident /incident / property damage /fire incident report	HSEP:14-F15	00



HEALTH, SAFETY AND ENVIRONMENT PLAN FOR

SITE OPERATION by SUBCONTRACTORS

POWER SECTOR

Doc no.: HSEP: 14

REV: 01

20.01.2020 Date:

Page: **36** of **43**

20.0 **ANNEXURES**

ANNEXURE 01

As per Contract Labour (Regulation & Abolition Act), Central Rules, 1971,

(1) The first-aid box shall be distinctively marked with a Red Cross on a white background and shall contain the following items, namely:

(a) For establishments in which the number of contract labour employed does not exceed fifty, each first aid box shall contain the following equipment:

(i)	6 small sterilized dressings
(ii)	3 medium size sterilized dressings
(iii)	3 large size sterilized dressings
(iv)	6 pieces of sterilized eye pads in separate sealed packets.
(v)	6 roller bandages 10 cm wide.
(vi)	6 roller bandages 5 cm wide.
(vii)	One tourniquet
(viii)	A supply of suitable splints
(ix)	Three packets of safety pins.
(x)	Kidney tray.
(xi)	3 large sterilized burn dressings.
(xii)	1 (30ml) bottle containing a two percent alcoholic solution of iodine
(xiii)	1 (30 ml) bottle containing Sal volatile having the dose and mode of administration
	indicated on the label
(xiv)	1 snake bite lancet
(xv)	1 (30gms) bottle of potassium permanganate crystals.
(xvi)	1 pair scissors
(xvii)	1 copy of the First-Aid leaflet issued by the Director General, Factory Advice Service and
	Labour Institutes, Government of India.
(xviii)	A bottle containing 100 tablets (each of 5 grains) of aspirin
(xix)	Ointment for burns
(xx)	A bottle of suitable surgical anti-septic solution

(b) For establishment in which the number of contract labour exceeds fifty each first-aid box shall contain the following equipment:

(i)	12 small sterilized dressings	
(ii) 6 medium size sterilized dressings		
(iii) 6 large size sterilized dressings.		
(iv) 6 large size sterilized burn dressings (v) 6 (15 grams) packets sterilized cotton wool		
		(vi)



DE\/ 04

REV: 01

Date: 20.01.2020

Doc no.: HSEP: 14

Page: **37** of **43**

POWER SECTOR

(vii)	12 roller bandages 10 cm wide.
(viii)	12 roller bandages 5 cm wide.
(ix)	One tourniquet.
(x)	A supply of suitable splints.
(xi)	Three packets of safety pins.
(xii)	Kidney tray.
(xiii)	Sufficient number of eye washes bottles filled with distilled water or suitable liquid clearly indicated by a distinctive sign which shall be visible at all times.
(xiv)	4 per cent Xylocaine eye drops, and boric acid eye drops and soda by carbonate eye drops.
(xv)	1 (60ml) bottle containing a two percent alcoholic solution of iodine
(xvi)	One (two hundred ml) bottle of mercurochrome (2 per cent) solution in water.
(xvii)	1 (120ml) bottle containing Sal volatile having the dose and mode of administration indicated on the label.
(xviii)	1 roll of adhesive plaster (6 cmX1 meter)
(xix)	2 rolls of adhesive plaster (2 cmX1 meter)
(xx)	A snake bite lancet.
(xxi)	1 (30 grams) bottle of potassium permanganate crystals.
(xxii)	1 pair scissors
(xxiii)	1 copy of the First-Aid leaflet issued by the Director-General, Factory Advice service and labour Institutes, Government of India.
(xxiv)	a bottle containing 100 tablets (each of 5 grains) of aspirin
(xxv)	Ointment for burns
(xxvi)	A bottle of a suitable surgical anti septic solution.

(2) Adequate arrangement shall be made for immediate recoupment of the equipment when necessary.



REV:

POWER SECTOR

01 20.01.2020 Date:

Doc no.: HSEP: 14

38 of **43** Page:

ANNEXURE 02

HSE AUDIT/INSPECTION CHECKLIST CUM COMPLIANCE REPORT					
PROJECT:SUBCONTRACTOR:					
DATE :	OW	NER	:		
INSPECTION BY:					
Note: write 'NA' wherever the items is not applicable					
Item	Υ	N	Remarks	Action	
	е	0			
HOUSEKEEPING	S				
Waste containers provided and used					
Passageways and walkways clear					
General neatness of working area					
Other					
PERSONNELPROTECTIVEEQUIPTMENTS					
Goggles; shields					
Face protection					
Hearing protection					
Respiratory masks etc.					
Safety belts					
Other					
EXCAVATIONS / OPENINGS					
Openings properly covered or barricaded					
Excavations shored					
Excavations barricaded					
Overnight lighting provided					
Other					
WELDING, CUTTING					
Gas cylinders chained upright					
Cable and hoses not obstructing					
Fire extinguisher (s) accessible					
Others					
SCAFFOLDING					
Fully decked platforms					
Guard and intermediate rails in place		ļ			
Toe boards in place		ļ			
Adequate shoring					
Adequate access					
Others					
LADDER		1			
Extension side rails 1 m above					
Top of landing					
Properly secured					



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

Page: **39** of **43**

POW	/FR	SEC	TOR
	, – 1 ,	\circ	$\cdot \cdot$

			T
Angle + 70° from horizontal			
Other			
HOISTS, CRANES AND DERRICKS			
Condition of cables and sheaf OK			
Condition of slings, chains, hooks OK			
Inspection & maintenance log maintained			
Outriggers used			
Signals observed and understood			
Qualified operators			
Others			
MACHINERY, TOOLS & EQUIPMENT			
Proper instruction			
Safety devices			
Proper cords			
Inspection and maintenance			
Other			
VEHICLE AND TRAFFIC			
Rules and regulations observed			
Inspection and maintenance			
Licensed drivers			
Other			
TEMPORARY FACILITIES			
Emergency instructions posted			
Fire extinguishers provided			
Fire-aid equipment available			
General neatness			
Others			
FIRE PREVENTION			
Personnel instructed			
Fire extinguishers checked			
No smoking in prohibited areas.			
Hydrants			
Clearance			
Others			
ELECTRICAL			
Proper wiring			
ELCB's provided			
Ground fault circuit interrupters			
Protection against damage			
Prevention of tripping hazards			
Other			
HANDLING & STORAGE OF MATERIALS			
HANDLING & STORAGE OF MATERIALS			
Properly stored or stacked			
Passageways clear			
Other			
FLAMMABLE GASES AND LIQUIDS			
Containers clearly identified			
Proper storage	 		
Fire extinguisher nearby	+ +		
I I IIO CAUTUUISHEI HEALDY	1	1	1



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

Page: **40** of **43**

-		SEC	-
P()\/	$\vee \vdash \vdash$	\sim \vdash ι	1 () H

Other		
WORKING AT HEIGHT		
Safety nets		
Safety belts		
Safety helmets		
Anchoring of safety belt to the life line rope		
ENVIRONMENT		
Lubricant waste/engine oils properly dispose.		
Waste from Canteen, offices, sanitation etc. disposed properly.		
Disposal of surplus earth, stripping materials, expired batteries, oily rags and combustible materials done properly.		
HEALTH CHECKS		
Hygienic conditions at labor camps O.K.		
Availability of first-aid facilities		
Proper sanitation at site, office & labor camps.		
Arrangement of medical facilities.		
Measures for dealing with illness.		
Availability of potable drinking water for workmen & staff.		
Provision of crèches for children.		



REV:

POWER SECTOR

Doc no.: HSEP: 14

01

20.01.2020 Date:

Page: **41** of **43**

ANNEXURE 03

REFERENCES

- Contract documents
- Relevant legislations
- **HSEMSM**
- Relevant Indian standards as listed below (illustrative only):

SL	CODE NAME	TITLE
NO		
(1)	IS : 818-1888	Code of Practice for safety and health requirements in
	(Reaffirmed 2003)	Electric and Gas Welding and Cutting operations.
(2)	IS: 1179-1967	Specification for Equipment for Eye & Face protection during
	(Reaffirmed 2003)	welding.
(3)	IS: 1989 (Part 2):1986	Specification for Leather Safety Boots & Shoes
	(Reaffirmed 1997)	
(4)	IS:2925 – 1984	Specification for Industrial Safety Helmets
	(Reaffirmed 2010)	
(5)	IS:3521 : 1999	Industrial Safety Belts & Harnesses-Specification
	(Reaffirmed 2002)	
(6)	IS:3646(Part II) - 1966	Code of Practice for Interior Illumination
	(Reaffirmed 2003)	
(7)	IS:3696 (Part I) - 1987	Safety Code for Scaffolds and Ladders
	(Reaffirmed 2002)	
(8)	IS: 3696(Part 2) : 1991	Scaffolds and Ladders-Code of Safety
	(Reaffirmed 2002)	
(9)	IS:3786 – 1983	Method for Computation of Frequency and Severity Rates for
	(Reaffirmed 2002)	Industrial Injuries and Classification of Industrial Incidents
(10)	IS:4770 : 1991	Rubber Gloves – Electricals purposes-Specification
	(Reaffirmed 2006)	
(11)	IS:4912 : 1978	Safety Requirements for Floor and Wall Openings, Railings
	(Reaffirmed 2002)	and Toe Boards
(12)	IS: 5983 – 1980	Specification for Eye-Protectors
	(Reaffirmed 2002)	
(13)	IS:6519 – 1971	Code of Practice for Selection, Care and Repair of Safety
	(Reaffirmed 1997)	Footwear
(14)	IS:9167:1979	Specification for Ear-Protectors
(15)	IS:6994(Part I)-1973	Specification for Industrial Safety Gloves
	(Re affirmed 1996)	Leather and Cotton Gloves
(16)	IS:8519 – 1977	Guide for Selection of Industrial Safety Equipment for Body
	(Reaffirmed 1983)	Protection.
(17)	IS 11006 : 2011	Flash Back(Flame Arrestor) Specification



Doc no.: HSEP: 14

REV: 01

Date: 20.01.2020

Page: **42** of **43**

POWER SECTOR

(18)	IS:8520 – 1977	Guide for Selection of Industrial Safety Equipment for Eye,		
	(Reaffirmed 2002)	Face and Ear Protection.		
(19)	IS:9473:2002	Respiratory Protective Devices-Filtering Half Masks to protect		
		against Particles-Specification.		
(20)	IS:9944:1992	Natural and Man-made Fiber Rope Slings-Recommendations		
	(Reaffirmed 2003)	on Safe working loads.		
(21)	IS:11057 – 1884	Specification for Industrial Safety Nets		
	(Reaffirmed 2001)			
(22)	IS:12254:1993	Polyvinyl Chloride (PVC) Industrial Boots-Specification		
	(Reaffirmed 2002)			
(23)	IS:13367(Part 1):1992	Safe Use of Cranes-Code of Practice		
	(Reaffirmed 20030			
(24)	IS:14166:1994	Respiratory Protective Devices-Full Face Masks Specification		
	(Reaffirmed 2002)			
(25)	IS:14746 : 1999	Respiratory Protective Devices-Half Masks and Quarter		
	(Reaffirmed 2003)	Masks - Specification		
(26)	IS: 15397:2003	Portable Extinguisher Mechanical Foam Type(Stored		
	(Reaffirmed 2008)	Pressure)-Specification		
(27)	IS: 19011:2002	Guidelines for Quality and/or Environmental Management		
		Systems Auditing		



01

REV:

20.01.2020 Date:

Doc no.: HSEP: 14

Page: **43** of **43**

POWER SECTOR

ANNEXURE 04 : SAFETY FORMATS

& ANNEXURE 05 : WORK PERMIT FORMATS



INSPECTION OF FIRST AID BOX

FORMAT NO: HSEP:14-F01

REV NO.: 00 PAGE NO. 01 OF 02

Name of Site :	
Name of Sub-Contractor :	
Name of Sub-Contractor:	
Inspected by :	
Date of Inspection :	
Date of Inspection :	

Number of employees on the site: -_____

Sl.No.	Item	No. Available	Remarks
1	No. of small sterilized dressings		
2	No of medium sized sterilized dressings		
3	No of large sized sterilized dressings.		
4	No of large sized sterilized burn dressings		
5	No of (15 grams) packets sterilized cotton wool		
6	No of pieces of sterilized eye pads in separate sealed packets.		
7	No of roller bandages 10 cm wide.		
8	No of roller bandages 5 cm wide.		
9	Whether tourniquet available		
10	Whether supply of Suitable splints available.		
11	No of packets of safety pins.		
12	Whether kidney tray available		
13	Whether sufficient number of eye wash bottles, filled with distilled water or suitable liquid, clearly indicated by a distinctive sign which shall be visible at all times, available.		
14	Whether 4%-xylocaine eye drops, and boric acid eye drops and soda by carbonate eye drops available.		
15	Whether (60ml) bottle containing a two percent alcoholic solution of iodine available		
16	Whether (two hundred ml) bottle of mercurochrome (2 per cent) solution in water available.		



INSPECTION OF FIRST AID BOX

FORMAT NO: HSEP:14-F01

REV NO.: 00 PAGE NO. 02 OF 02

Sl.No.	Item	No. Available	Remarks
17	Whether 120ml bottle containing Sal volatile having the dose and mode of administration indicated on the label, available.		
18	Whether roll of adhesive plaster (6 cmX1 meter) available		
19	No of rolls of adhesive plaster (2 cmX1 meter)		
20	Whether snake bite lancet available.		
21	Whether (30 grams) bottle of potassium permanganate crystals available.		
22	Whether a pair scissors available		
23	Whether copy of the First-Aid leaflet issued by the Director-General, Factory Advice service and labour Institutes, Government of India available.		
24	Whether bottle containing 100 tablets (each of 5 grains) of aspirin available		
25	Whether Ointment for burns available		
26	Whether bottle of a suitable surgical anti-septic solution available		

Signature of Subcontractor's Site I/C:



HEALTH CHECK UP

FORMAT NO: HSEP:14-F02

REV NO.: 00 PAGE NO. 1 OF 02

Name of Site :				
Name of Sub-Contractor :				
Name of Employee :				
NAME:	<u> </u>			
History Of Past Illness	H/O Epilep	osy		
	H/O Drug			
		tics/ Hypertension		
	H/O Uncor	nsciousness		
Personal History				
EXAMINATI			OBSERVATION	
General Physical Examination	<u>on</u>			
Height	:			
Weight	:			
ВМІ	:			
Built And nourishment	:			
Pallor	:			
Temperature	:			
Chest Expansion	:	Inspiration	Expansion	
Lymph Node Enlargement	:			
Ear, Nose, Throat	:			
Ear	:			
Nose	:			
Throat	:			



HEALTH CHECK UP

FORMAT NO: HSEP:14-F02

REV NO.: 00 PAGE NO. 2 OF 02

EXAMINATION			OBSERVATION	
Cardiovascular System Examination	on :			
Inspection	:			
Palpation	:	Pulse	ВР	
Auscultation (Heart Sounds)	:			
Respiratory System	<u>:</u>			
Inspection	:	Respiratory Rate		
Palpation:	:			
Percussion	:			
Auscultation (Breath Sounds)	:			
Examination of Abdomen	:			
Inspection	:			
Palpation	:			
Auscultation (Bowel Sounds)	:			
Any Other	:			
Clinical Impression				

Signature of the examining doctor



HSE INDUCTION TRAINING

FORMAT NO: HSEP:14-F03

REV NO.: 00 PAGE NO. 01 OF 01

Name of Site :	
Name of Sub-Contractor	
:	
Date :	
Name of Training	
Co-ordinator	

SI	Name	Designation	Organisation	Signature
No.				

Signature of Training co-ordinator :



Name of Site:

POWER SECTOR

TOOL-BOX TALK

FORMAT NO: HSEP:14-F04

REV NO.: 00

PAGE	NO.	01	OF	01
------	-----	----	----	----

_			
ate :			
Горіс	Name of person delivered Tool Box Talk	No. of Participants attended	Remarks

Signature of Site I/C of Subcontractor:



PERSONAL PROTECTIVE EQUIPMENTS

FORMAT NO: HSEP:14-F06

REV NO.: 00

PAGE NO. 01 OF 01

Name of Site:			
Name of Sub-Contract:	or		
Inspected by :			
Date of Inspection :			
Item	Issued this Month	Nos. Issued up to the Month	Percentage of usage at site
Safety Helmet		the Month	ut site
Safety Shoes			
Full Body Harness			
Fall Arrestor			
Safety Nets			
Other PPEs.			

Signature of Site I/C of Subcontractor:



INSPECTION OF T&Ps

FORMAT NO: HSEP:14-F07

REV NO.: 00 PAGE NO. 01 OF 01

Signature-Subcontractor/ Subcontractor's

Safety Officer

Name of S	ite:					
	Name of Sub-Contractor :					
Date of Ins	spection :					
		1				
Sl.No.	Description	Remarks				
1.0	Name of equipment					
2.0	Basic Information of equipment					
2.1	Specification					
2.2	Sr. No. of equipment					
2.3	Make					
2.4	Year of manufacture					
3.0	3.0 Major repairs / overhauls(Furnish details of work carried out)		Date(s) of major			
			repair/overhaul			
3.1						
3.2						
3.3	Repairs carried out at site					
4.0	Any performance test conducted	Yes/No				
5.0	Document Submitted	Yes/No				
6.0	Manufacturer's test / guarantee certificate	Available/ I	Not available			
7.0	Performance test	Done/ Not Done				
8.0	Acceptance Norms					
9.0	Committee Observations					
10.0	Date of next review (if accepted)					
		Ш				

Signature-Site Safety Officer (BHEL)



STATUS OF T&Ps

FORMAT NO: HSEP:14-F08

REV NO.: 00 PAGE NO. 01 OF 01

Name of Site	
Name of Sub-Contractor	
Date of Inspection	

Item	Nos. Deployed	Identification	Nos. Tested by	Validity of Test
		No.	competent	Certificate
			person	
Winches				
Chain Blocks				
Wire Rope				
Slings				
Man Cages				
D-Shackles				
Air				
Compressors				
Crawler				
Cranes				
Mobile Cranes				
Hydra Cranes				
Others				

Signature of Site I/C of subcontractor:

बीएचई एल	
HHE	

INSPECTION OF CRANES AND WINCHES

FORMAT NO: HSEP:14-F09

REV NO.: 00

	PAGE NO. 01 OF 03
Name of Site :	
Name of Sub-Contractor :	
Inspected by :	
Date of Inspection:	
Crane Reg. No (Make/Model) Name of Driver/Operator	

Sl.no.	Description	Observation	Measures
1	Valid Driving license		
2	Hook & Hook Latch		
3	Over Hoist limit switch		
4	Boom limit switch		
5	Boom Angle Indicator		
6	Boom limit cutoff switch		
7	Condition of Boom		
8	Condition of ropes		
9	Number of load lines		
10	Size and condition of the slings		
11	Stability of the cranes		
12	Soil Condition		
13	Swing Break And Lock		
14	Proper Break And Lock		
15	Hoist Break And Lock		
16	Boom Break And Lock		
17	Main Clutch		
18	Leakage in Hydraulic Cylinders		
19	Out riggers filly extendable		
20	Tyre pressure		
21	Condition of Battery And Lamps		



INSPECTION OF CRANES AND WINCHES

FORMAT NO: HSEP:14-F09

REV NO.: 00 PAGE NO. 2 OF 03

Sl.no.	Description	Observation	Measures
22	Guards of moving and rotating parts		
23	Load chart provided		
24	Number and position of pedant ropes		
25	Reverse Horn		
26	Load Test Details		
27	Operator's fitness		
28	Pollution under control certificate		
29	Fire extinguisher of appropriate type.		
30	Training of the operator		

WINCH

SI.	Description	YES	NO	NA	Remarks
No.	Description				
1	Has the copy of Third Party Inspection				
	certificate been provided in winch machine shed?				
2	Is winch machine operator experienced				
	enough to operate the winch machine?				
3	Is the winch machine operated by				
	someone other than the winch machine				
	operator?				
4	Is there guard provided in all moving parts				
	like wheel and motor's shaft?				
5	Will it protect against unforeseen				
	operational contingencies?				
6	Are brakes, clutch and locking				
	arrangement working properly?				
7	Has it been ensured that the guard does				
	not constitute a hazard by itself?				
8	Are the cranks and the connecting rods				
	protected by guardrails?				
9	Is there provision for fully covered shed				
	with wooden plank roof?				



INSPECTION OF CRANES AND WINCHES

FORMAT NO: HSEP:14-F09

REV NO.: 00 PAGE NO. 3 OF 03

SI.	Description	YES	NO	NA	Remarks
No.	Description				
10	Is wire rope free from any kind of damage				
	or wear and tear?				
11	Is split pin provided for the protection of				
	clutch and brake locking arrangement?				
12	Is pulley inspected by competent person				
	and certified before use?				
13	Is pulley free from any wear and tear				
	visually?				
14	Is winch rope barricaded with clipsheet for				
	the protection of rope and person?				
15	Is the wire rope lubricated by cardium oil?				
16	Is there any friction in wire rope which				
	may damage the wire rope rather than the				
	rolling parts?				
17	Is there any oil leakage in the hydraulic				
	system of the winch machine?				
18	Has it been ensured that the guard will not				
	cause discomfort or inconvenience to				
	operator?				
	Total Number of NO:				
	Total Number of NA:				
	% Compliance :				

Signature of Site I/C of subcontractor:



INSPECTION OF HEIGHT WORKING

FORMAT NO: HSEP:14-F10

REV NO.: 00 PAGE NO. 01 OF 02

Name of Site :	
Name of Sub-Contractor :	
Inspected by :	
Date of Inspection:	

Sl. No.	Descriptions	Observation	Remarks
		(Yes/No)	
1	All the workers have been explained safe work method?		
2	An established communication system has been		
	established and explained to the workers.		
3	Adequate illumination has been ensured.		
4	Work area inspected prior to the start of the work.		
5	Area below the work place barricaded, particularly below		
	hot work.		
6	Workers provided with bags /box to carry bolts, nuts and		
	hand tools		
7	Arrangement for fastening hand tools made.		
8	All work platforms ensured to be of adequate strength		
	and ergonomically suitable.		
9	Fabricated makeshift arrangements are checked for		
	quality and type of material welding, anchoring etc.		
10.	Work at more than one elevation at the same segment is		
	restricted.		
	ACCESS/EGRESS		
1	Walkways provided with handrail, mid-rail and toe		
	guard?		
2	All checkered plates, gratings properly welded/ bolted?		
3	Are ladders inspected and they are in good condition?		
4	Are ladders spliced?		
5	Are ladders properly secured to prevent slipping, sliding		
	or falling?		
6	Do side rails extend 36" above top landing?		
7	Are built up ladders constructed of sound materials?		



INSPECTION OF HEIGHT WORKING

FORMAT NO: HSEP:14-F10

REV NO.: 00

PAGE NO. 02 OF 02

Sl. No.	Descriptions	Observation	Remarks
		(Yes/No)	
8	Are rugs and cleats not over 12" on center?		
9	Metal ladders not used around electrical hazards.		
10	Proper maintenance and storage.		
11	Ladders placed at right slope.		
12	Ladders / staircases welded/ bolted properly.		
13	Any obstruction in the stairs.		
14	Are landing provided with handrails, knee rails, toe		
	boards etc.?		
15	Whether ramp is provided with proper slope.		
16	Proper hand rails / guards provided in ramps.		
	Housekeeping		
1	Walkways, aisles & all overhead workplaces cleared of		
	loose material.		
2	Flammable materials, if any, are cleared.		
3	All the de shuttering materials are removed after de		
	shuttering is done.		
4	Platforms and walkways free from oil/grease or other		
	slippery material.		
5	Collected scrap are brought down or lowered down and		
	not dropped from height.		
	PPE And Safety Devices		
1	Use of safety helmet, safety belts ensured for all workers		
2	Anchoring points provided at all places of work.		
3	Common lifeline provided wherever linear movement at		
	height is required.		
4	Safety nets are use wherever required.		
5	Proper fall arrest system is deployed at critical		
	workplaces.		
6	Crawler boards/Safety system or works on fragile roof		
	are used.		

Signature of Site I/C of subcontractor :



INSPECTION OF WELDING AND GAS CUTTING

FORMAT NO: HSEP:14-F11 REV NO.: 00 PAGE NO. 1 OF 02

Name of Site	
Name of Sub-Contractor	
Inspected by	
Date of Inspection	

Welding				
Sl.no.	Description	Υ	N	Remarks
		е	О	
		S		
1	Is electric connection given through			
	30 mA ELCB/RCCB to welding m/c?			
2	Is electric cable fitted properly in			
	junction box on m/c?			
3	Is electrical cable free from joints?			
4	Are the joints attached firmly &			
	insulated with tape?			
5	Is double earthing given to body of			
	m/c?			
6	Is the physical condition of the m/c			
	good?			
7	Is ON/OFF switch connected to the			
	m/c is working and in good			
	condition?			
8	Are indication lamps on m/c			
	working?			
9	Is the electrode holder in good			
	condition?			
10	Are the cables of the welding m/c			
	lugged & tight properly?			
11	Are return lead connected properly			
	(Rod, Angle, Channels shall not be			
	used)			
	Total No of NO			
	Total No of YES			



INSPECTION OF WELDING AND GAS CUTTING

FORMAT NO: HSEP:14-F11

REV NO.: 00 PAGE NO. 2 OF 02

Gas Cutt	ting			
SI. no	Description	Yes	No	Remarks
1	Are Cylinders kept on trolleys?			
2	Physical condition of Gas cylinders Good?			
3	Is there Oil/Grease on valve of the cylinder?			
4	Are pressure regulators in good condition?			
5	Condition of hose pipe OK?			
6	Are hose pipe clamped with hose clip?			
7	Is flash back arrestor & NRV fitted on torch both for O2 and LPG cylinder?			
8	Is nozzle of the torch cleaned?			
	Total Number of NO			
	Total No of YES			
	% Compliance			

Signature of Site I/C of subcontractor :



INSPECTION OF ELECTRICAL INSTALLATION

FORMAT NO: HSEP:14-F12

REV NO.: 00

PAGE NO. 01 OF 02

Name of Site	
Name of Sub-Contractor	
Inspected by	
Date of Inspection:	

Sr.	Contents	Yes/No	Remarks
No.			
Α	Cable		
1.	Whether the condition of cable is checked?		
2.	Are cables received from other sites checked for		
	insulation resistance before putting them into use?		
3.	Are all main cables taken either underground /		
	overhead?		
4.	Are welding cables routed properly above the ground?		
5.	Are welding and electrical cables overlapping?		
6.	Is any improper joining of cables/wires prevailing at site?		
В	DBs/SDBs		
1.	Is earth conductor continued up to DB / SDB?		
2.	Whether DBs and extension boards are protected from		
	rain / water?		
3.	Is there any overloading of DBs / SDBs?		
4.	Are correct / proper fuses & CBs provided at main		
	boards and sub-boards?		
5.	Is energized wiring in junction boxes, CB panels &		
	similar places covered all times?		
С	ELCB		
1.	Whether the connections are routed through ELCB?		
2.	Is ELCB sensitivity maintained at 30 mA?		



INSPECTION OF ELECTRICAL INSTALLATION

FORMAT NO: HSEP:14-F12

REV NO.: 00 PAGE NO. 02 OF 02

Sr.	Contents	Yes/No	Remarks
No.			
3.	Are the ELCB numbered and tested periodically & test		
	results recorded in a logbook countersigned by a		
	competent person?		
D	Grounding		
1.	Is natural earthing ensured at the source of power		
	(main DB at Generator or Transformer)?		
2.	Whether the continuity and tightness of the earth		
	conductor are checked?		
3.	Mention the gauge of the earth conductor used at the		
	site.		
4.	Mention the value of Earth Resistance.		
E	Electrically operated Machines or Accessories.		
1.	Whether the plug top is provided everywhere.		
2.	Are all metal parts of electrical equipment and light		
	fittings / accessories grounded?		
3.	Is there any shed or cover for welding machines?		
4.	Are halogen lamps fixed at proper places?		
5.	Are portable power tools maintained as per norms?		
6.	Any other information:		

Signature of Site I/C of subcontractor :



Name of Site

Name of Sub-Contractor

POWER SECTOR

INSPECTION OF ELEVATOR

FORMAT NO: HSEP:14-F13

REV NO.: 00 PAGE NO. 01 OF 01

Inspecte	ed by				
Date of	Inspection				
Sr. No.	Description			Remarks	
1.0	Name of equipment				
2.0	Basic Information of e	equipment			
2.1	Specification				
2.2	Sr. No. of equipment				
2.3	Make				
2.4	Year of manufacture				
3.0	Major repairs/overha	uls(Furnish details of	work carried o	out)	Date(s) of major repair/overhaul
3.1					
3.2					
3.3	Repairs carried out at	site			
4.0	Any performance test	conducted		Yes/No	
5.0	Document Submitted			Yes/No	
6.0	Manufacturer's test /	guarantee certificate		Available/ N	Not available
7.0	Performance test			Done/ Not	Done
8.0	Acceptance Norms				
9.0	Committee Observati	ons			
10.0	Date of next review (i	f accepted)			
Signa	ture-Subcontractor/ Sul Safety Officer	ocontractor's	Signatu	re-Site Safet	y Officer (BHEL)

	3	7
/-	4	4
		F

Inspection of Excavation

FORMAT NO: HSEP:14-F13E REV NO.: 00 PAGE NO. 01 OF 01

Name of Site :	
Name of Sub-Contractor :	
Inspected by :	
Date of Inspection :	

Sl.no.	Description	Yes	No	Remarks
1	Precautions taken for Underground Electrical Cable			
2	Precautions taken for Under / Above ground sewer/ Drinking Water Line			
3	Precautions taken for Underground Telecommunication Line			
4	Precautions taken for Underground Product/Utility Line			
5	Precautions taken for Underground Fire Water Line			
6	Shoring / Shuttering / Sheet piling done to prevent collapse of excavation walls. Strength of Excavation wall ensured at all times			
7	Slope Cutting / Angle Maintained			
8	Hard Barricading & Edge Protection provided			
9	Separate Safe Access for Man and Vehicle			
10	Lighting arrangement			
11	Banksman Provided			
12	Required basic PPEs provided			
13	Excavated soil / Construction Material / equipment kept away from the edge.			
14	First aid in attendance.			
15	Other:			
	Total No of YES			



HSE PENALTY

FORMAT NO: HSEP:14-F14

REV NO.: 00 PAGE NO. 1 OF 02

Sub: MEMO for Penalty for non-compliances in Safety

Following lapse (tick marked) was observed and penalty is imposed as stated at the bottom of this memo. It is requested that such occurrences be please avoided in future.

Safety Area

SN	Violation of Safety Norms	Fine (in Rs)
01	Not Wearing Safety Helmet	200/- *
02.	Not wearing Safety Belt or not anchoring life line	500/-*
03	Not wearing safety shoe	200/-*
04	Not keeping gas cylinders vertically	200/-
05	Not using flash back arrestors	100/-
06	Not wearing gloves	50/- *
07.	Grinding Without Goggles	50/- *
08.	Not using 24 V Supply For Internal Work	500/-
09.	Electrical Plugs Not used for hand Machine	100/-
10.	Not Slinging properly	200/-
11.	Using Damaged Sling	200/-
12.	Lifting Cylinders Without Cage	500/-
13.	Not Using Proper Welding Cable With Lot of Joints And Not Insulated Property.	200/-
14.	Not Removing Small Scrap From Platforms	500/-
15.	Gas Cutting Without Taking Proper Precaution or Not Using Sheet Below Gas Cutting	500/-
16.	Not Maintaining Electric Winches Which are Operated Dangerously	500/-
17.	Improper Earthing Of Electrical T&P	500/-
18	No or improper barricading	500/-
19.	Activity carried out without Safety work permit (Height work, Lifting activity, Hot work-each person/case)	1000/-
20.	Incident Resulting in Partial Loss in Earning Capacity	25,000/- per victim
21.	Fatal Incident Resulting in total loss in Earning Capacity	1,00,000/- per victim for first instance #

Legend: -

#: or as deducted by customer, whichever is higher. For repeated fatal incident in the same Unit incremental penalty to be imposed. The subcontractor will pay 2 times the penalty compared to previously paid in case there are repeated cases of fatal incidents under the same subcontractor for the same package in the same unit.

^{*:} per head. For repeated violation by the same person, the penalty would be double of the previous penalty. Date of "Repeated violation" will be counted from subsequent days.



HSE PENALTY

FORMAT NO: HSEP:14-F14

REV NO.: 00 PAGE NO. 2 OF 02

Details (if any) related to non-compliance (Name of persons, Nature of deficiency, etc.)

Penalty imposed:
1, Rate as per above chart
2. No. of Persons/ machine/ event/ labour
3. Total Penalty= 1. X 2. =
Signature:
Witnessed by: (Sub- Contractor representative) (BHEL Personnel)
NameName
Distribution: 1 Copy: to Sub- contractor, 1 Copy to Site Construction Manager (BHEL)



Incident Report

FORMAT NO: HSEP:14-F15 REV NO.: 00

(To be submitted within 24 hours of time of incident)

PAGE NO. 01 OF 01

Type of incident: Fatal/Major/ Minor/Fire/Property Damage/Near-miss

1	NAME OF SITE		3	ACTIVITY AREA				
2	SCOPE OF WORK	COPE OF WORK		4	4 NAME OF CONTRACTOR			
			5	NAME & DESIGNATION OF BHEL ACTIVITY I/C				
6	DATE & TIME OF ACCIDENT		7	DATE RESUMED				
8	NO. OF WORK-DAYS							
9	NO. OF MANHOURS	LOST BY O	THERS					
10	PERSONAL DETAILS	OF INJURE	D AND / OR DETAILS O	F M	ATERIALS / EQUIPMENT / PROP	ERTY DAMAGED		
NAME				N/	AME OF MATERIAL / EQUIPMEN	T / PROPERTY		
PERIO	OD OF EMPLOYMENT							
AGE	YRS	SEX	MALE/ FEMALE		ESTIMATED COST	ACTUAL COST		
MARI	TAL STATUS	SIN	GLE / MARRIED					
occi	JPATION				NATURE OF DAI	MAGE		
PART	OF BODY INJURED							
NATU	IRE OF INJURY							
	ICY (OBJECT / EQUIF ONSIBLE FOR CAUSI		STANCE) MOST NT/INJURY/DAMAGE					
PERSON (NAME & DESIGNATION) WITH MOST CONTROL OVER AGENCY (OBJECT / EQUIPMENT / SUBSTANCE) CAUSING ACCIDENT INJURY / DAMAGE								
13	DESCRIBE CLEARLY	Y HOW THE	ACCIDENT OCCURRED	(US	E ADDITIONAL SHEET, IF REQU	IRED		
ANAL	.YSIS							
14	WHAT ACTS AND / C							
15	WHAT ARE THE BAS OF THESE ACTS AN		I FOR THE EXISTENCE DITION ?					
WHAT CORRECTIVE ACTIONS HAVE BEEN TAKEN TO PREVENT ACCIDENT RECURRENCE?								
DATE :					SIGNATURE OF SI	TE HSE COORDINATOR		
17 COMMENTS OF HEAD / SOX								
	DATE:				s	GIGNATURE OF HEAD/SOX		



Format for Monthly HSE Planning & Review

FORMAT NO: HSEP:14-F30

REV NO.: 00 PAGE NO. 01 OF 3

Name	of the Site		Name of the Subcontractor				
Scope	of Work		Date				
PART	- A: PLAN OF HSE ACTIVITIES FOR	THE MONTH OF		PART-B: REVIEW ON			
SN.	Description of HSE Activity & Forn	nats	Plan & Targets for the month	Review			
1	Availability of First Aid Box at Requi per Format: Fo1		Areas 1				
2	Health check-up as per Format: Fo2		Health check-up for Nos 1. New inductees 2. Drivers & Operators 3. Workers in following high risk areas: a				
3	Induction training of newly joined w	orkers as per Format: Fo3	Minimum No. of workers:				
+	Toolbox talks (TBT) conducted befo	re start of work as per Format: Fo4	Locations of TBTs & No. of workers 1				
5	PPE usage and issue as per Format:	Fo6					
5	Inspection of T&Ps as per Format: F	07	List of T&Ps to be inspected 1.				
•	Identification & Inspection Status of	T&Ps as per Format: Fo8					
}	Inspection of Cranes & Winches as p	er Format: Fo9	List of Cranes & Winches & Nos. 1				
)	Inspection of Height Working as per	Format: F10	Areas: 1				
0	Inspection of Welding & Gas Cutting	operations as per Format: F11	Areas: 1				
1	Inspection of Electrical Installations	as per Format: F12	Locations: 1				
.2	Inspection of Elevators (as applicabl	e) as per Format: F13	Locations: 1				
<u>1</u> 3	Inspection of Excavation as per Forn	nat: F13E	Locations: 1				



Format for Monthly HSE Planning & Review

FORMAT NO: HSEP:14-F30

REV NO.: 00 PAGE NO. 02 OF 3

SN.	Description of HSE Activity & Formats	Plan & Targets for the month	Review
14	Job Safety Analysis as per Format F ₃ 2B	Activities:	
15	Regular Job Specific Training (Re-training) for workers involved in hazardous activities	Topics/ Hazards & No. of workers 1	
16	Mass housekeeping (HK) drive in work areas	Areas 1.	
17	Vertigo Test of Height workers	Minimum No. of workers:	
18	Deployment of qualified HSE Officers as per contract	Location(s) & Nos. 1	
19	Deployment of qualified HSE Stewards as per contract	Location(s) & Nos.	
20	Deployment of Safety tools & Equipment (Safety Nets, Lifelines, Fall arrestors, Man-cages, flashback arrestors, scaffolding etc.)	Tool/ Equipment & Location 1	
21	Safety Walks by site in charge of agency (4 -Weekly once)	Dates:	
22	Safety walks by departmental head (8-Weekly twice)	Dates:	
23	Availability/ deployment of Safety posters/ placards/ signage at strategic locations	Locations: Nos.	
24	Provision of clean drinking water sources for workers	Locations: Nos.	
25	Provision of toilets for workers (separate for male & female workers)	Locations: Nos.	
26	Rest sheds for workers during lunchtime, rain, dust storm etc.	Locations: Nos.	
27	Availability of following in Labor colony	 Clean drinking water Toilets Cleanliness & Hygiene Grass cutting, Fogging Electrical Inspection 	



Format for Monthly HSE Planning & Review

FORMAT NO: HSEP:14-F30

REV NO.: 00 PAGE NO. 03 OF 3

SN.	Description of HSE Activity & Formats	Plan & Targets for the month	Review
28	Availability of dust/ waste bins at various locations	Locations:	
29	Availability of Ambulance (individual/joint) in each shift	Ambulance No.	
30	Availability of emergency vehicle in each shift	Emergency vehicle	
31	Deployment/ Availability of tested Fire Extinguishers	Locations & Nos. 1	
32	Tree plantation	Locations & Nos. 1	
33	Waste disposal & Scrap Bins	Locations 1	
34	Illumination checks	Locations 1	
35	Safety award function: 1. Display of good practices Award presentation	Minimum 1 per month	
36	Submission of Daily Reports as per Format No.F31A	Daily Reports (Night & Day Shifts)	

PLAN		REVIEW				
Agency	BHEL	Agency	BHEL			
Name:	Name:	Name:	Name:			
Sign:	Sign:	Sign:	Sign:			
Date:	Date:	Date:	Date:			



Format for Daily HSE Reporting

FORMAT NO: **HSEP:14-F31** A REV NO.: oo

REV NO.: 00 PAGE NO. 01 OF 1

Note: Following format to be submitted (preferably) in excel/ soft copy by subcontractor daily at the end of each shift. Any photographs/ records to be attached

Site														Subcontractor														
Year	1			1	1			I	Mon	th	1							ı	1	Day						1		
SHIFT	Submitted By	Work Area(s)	Staff	Man-Power	Safety Officers	Safety Stewards	Tool Box (Topics and No. of Participants)	Induction Training (No. of Participants)	Vertigo Test (Numbers Tested)	On-the-Job Training (Topic & participants)	Work Permits	Job Safety Analyses conducted	Height Work Inspection	Other Hazardous Activities Inspection	T&P Inspection (Names & Nos. Inspected)	Safety Walk (Designation, Areas)	HSE Meeting	Safety Reward (Details)	Housekeeping/ Dust Suppression/ Tree Plantation Activities (Locations/ Details)	Lost time Accident	Restricted Work Case	Medical Treatment Case	First Aid Case	Near miss	Property Damage/ Fire	Non-Compliances Submitted by BHEL	Complied by Agency	Any other Remarks/Inputs
Day																												
Night															NA		NA	NA	NA									



Job Safety Analysis Format

FORMAT NO	O: HSEP	:14-F32B
-----------	---------	----------

REV NO.: 00 PAGE NO. 01 OF 1

Name of the Site		
Name of the Subcontractor		
Activity, Area		
	HAZARDS	PRECAUTION
(1)		
(Name) Submitted By	Reviewed By	Approved By
(Agency HSE)	(BHEL Execution)	(BHEL HSE)
(Date)	Execution	



FORMAT NO: HSEP:14-F33

REV NO.: 00 PAGE NO. 01 OF 3

Checklist for Evaluation of HSE Performance

SL	Parameter for Measurement	M/ O	Wt	Supporting Documents
1a	Induction training for new workers conducted through audio-visual medium & documented ?	М	1	Induction Training Records
1b	Tool box talk conducted regularly as per plan, and documented?	М	1	Toolbox Talk Records
10	Contractor in charge and safety in charge attended safety meetings?	М	2	Minutes of Meeting
1d	Whether observations in safety meetings are complied before next meeting?	М	2	-do-
1e	Preparation and submission of Monthly HSE report within stipulated time	М	1	Report submission date
1 f	Preparation and submission of Incident/near-miss report and RCA Report (as applicable) within stipulated time	М	1	Incident/ Near Miss Records
1 g	Carrying out Inspections and submission of Inspection reports within stipulated time	М	1	Inspection Records
1h	Regular Job Specific Training ensured for High Risk Workers (through audio-visual medium) as per plan	М	1	Training & Attendance Records
2a	Whether the contractor is registered under BOCW	М	2	BOCW Registration Certificate
2b	Availability of Qualified safety officer (1 for every 500 labour)	М	2	Safety Officer qualification & experience records
20	Availability of Qualified safety supervisor (1 for every 100 labour)	М	2	Safety Officer qualification & experience records
2d	All the workers are provided and using safety helmets and safety shoes/gum boots	М	2	PPE Issue Records, Inspection/ non-conformity records
2e	Housekeeping done on regular basis and scrap removal at site	М	1	Housekeeping records, Inspection/ non-conformity records
2f	Usage of Goggles/Face shields and Hand gloves for gas cutter and grinders		1	PPE Issue Records, Inspection/ non-conformity records
2g	Wall openings & floor openings are guarded?		1	Inspection/ non-conformity records
2h	Adequate illumination provided in all working area?		1	Inspection/ non-conformity records
2i	Safety posters, sign boards and emergency contact numbers in all prominent location are displayed?		1	Inspection/ non-conformity records
2j	Availability of automatic reverse horns, Main horn, hook latches for Vehicles, mobile cranes, Hydras		1	Inspection/ non-conformity records
2k	Ban of carrying mobile phones to work place is implemented for workers		1	Inspection/ non-conformity records
2	Availability of Tags & Inspection Certificates for Cranes of all capacities		1	Master T&P List with internal & external test details
21.2	Availability of Tags & Inspection Certificates for Winches of all capacities		1	Master T&P List with internal & external test details
21.3	Availability of Tags & Inspection Certificates, color coding for Chain pulley blocks		1	Master T&P List with internal & external test details
21.4	Availability of Tags & Inspection Certificates for Vehicles - Trailers, Dozers, Dumpers, Excavators. Mixers etc.		1	Master T&P List with internal & external test details
21.5	Availability of Tags & Inspection Certificates for Welding machines, grinders, Drilling machines, etc.		1	Master T&P List with internal & external test details
21.6	Availability of Tags & Inspection Certificates, colour coding for Wire rope slings etc.		1	Master T&P List with internal & external test details
21.7	Availability of Tags & Inspection Certificates for Batching plants		1	Master T&P List with internal & external test details



FORMAT NO: HSEP:14-F33

REV NO.: 00 PAGE NO. 02 OF 3

Checklist for Evaluation of HSE Performance

SL	Parameter for Measurement	M/ O	Wt	Supporting Documents
2m.1	Use of Lifting Permit as per requirement		1	Permit Records
2m.2	Use of Height Permit as per requirement		1	Permit Records
2m.3	Use of Hot Work Permit as per requirement		1	Permit Records
2m.4	Use of Excavation permit as per requirement		1	Permit Records
2m.5	Use of Confined space work permit as per requirement		1	Permit Records
2m.6	Use of Grating removal and safety net removal permit as per requirement		1	Permit Records
2m.7	Use of Lockout-Tag out permit as per requirement		1	Permit Records
2m.8	Use of Radiography permit as per requirement		1	Permit Records
2m.9	Use of Night/ Holiday Work Permit as per requirement		1	Permit Records
2m.10	Use of Any other Applicable Permit as per requirement		1	Permit Records
3a	Material safety data sheet(MSDS) available for all chemicals and displayed in usage and storage area?		1	Inspection/ non-conformity records
3p	Spillages of oil/concrete and other chemical is controlled and cleaned by proper method in case of spill?		1	Inspection/ non-conformity records
3c	Availability of adequate number of urinals in workplace and in elevations and maintained	М	1	
3d	Availability of rest rooms for workers at site	М	1	
3е	Availability of Drinking water facility at work spot		1	
3f	Hygienic Labour colony is provided for workers.		1	
4a	Is heavy/complex critical lifting permit obtained for heavy, complex materials before handling/erection activity?		1	Work Permit records
4b	Whether area below lifting activities barricaded		1	Inspection/ non-conformity records
4C	Availability of experienced rigging foreman		1	Experience details of rigging foreman
4d	Is agency is following proper storage and handling procedure as per manufacturer standard for all hazardous material?		1	Procedure for storage & handling
4e	Are oxygen and acetylene cylinders are transported to work place from storage area in trolleys		1	
5a	Whether all deep excavation has been protected by barrier		1	Inspection/ non-conformity records
5b	Sloping/benching & shoring provided for excavation as per requirement?		1	-do-
5C	Proper access and egress provided for excavations?		1	-do-
5d	Blasting is done in controlled manner?		2	-do-
6a	Whether Electrical booth is equipped with Co ₂ fire extinguishers and fire buckets filled with sand?		2	Inspection/ non-conformity records
6b	Availability of Illumination lamp in electric booth?		1	-do-
6c	whether Caution Boards have been displayed?		1	-do-
6d	Usage of Metal Plug top for all hand power tools?		1	-do-
6e	Usage of Insulated welding cables.		1	-do-
6f	Electrical Booth/Distribution Board to be covered by proper Canopy.		1	-do-
6g	Availability of functional & individual 30ma ELCB / RCCB and MCB for protection and conducting periodical check-up?		1	-do-
6h	Double earthing for panel boards and all machinery & proper earth pit with regular inspection available?		1	-do-
6i	Whether Electrician is qualified and experienced		1	Qualification & Experience records of electrician
6 <u>j</u>	Availability and usage of Rubber hand gloves by electrician?		1	Inspection/ non-conformity records



FORMAT NO: HSEP:14-F33

REV NO.: 00 PAGE NO. 03 OF 3

Checklist for Evaluation of HSE Performance

SL	Parameter for Measurement	M/ O	Wt	Supporting Documents
7a	Whether Scaffolding pipes made with steel or aluminum, are being used and checked periodically by experienced/ certified scaffolder?		2	Inspection/ non-conformity records
7b	8mm Stainless Steel wire rope with plastic cladding is provided for life line (Vertical / Horizontal) during height work?		2	-do-
7C	Availability of emergency lighting in case of power failure		1	-do-
7d	Whether all the openings are covered with Safety Nets made of fire proof Nylon?		1	-do-
7e	Whether MS pipe rails around staircases & platforms in usage are provided with top, middle rails and toe guard?		1	-do-
7f	Whether Ladder with vertical life line /Fall arrestor is available to climb?		1	-do-
79	Whether all workers deployed for working at height have been issued height pass after undergoing vertigo test?		1	Height Pass records
7h	Whether all workers deployed for height work / climbing ladder are provided and using Double lanyard safety belt?		1	PPE Issue records, inspection/ non- conformity reports
7 i	Is all hand tools/Small material used by height workers is tied firmly to prevent fall?		1	-do-
8a	Flash back arrestors for all gas cutting sets is available on Torch side and cylinder side		1	Inspection/ non-conformity records
8b	Oxygen/Acetylene/LPG cylinders not in use have caps in place and stored separately?		1	-do-
8c	Availability of Face screen, Hand gloves, and Apron, for welders		1	-do-
8d	Protection from falling hot molten metal during metal cutting / welding at height by providing GI sheet below the cutting area especially in fire prone areas		1	-do-
9a	Pre-employment medical check-up done for all workers and submitted?		1	Medical check records
9b	Availability of first aid center, with MBBS doctor(Own or Sharing basis)	М	2	Attendance records
9с	Availability of Ambulance facility 24 hours (Own or sharing basis)	М	2	-do-
9d	Is First aid trained personnel's are available and their names are displayed at site?	М	1	-do-
9e	Availability of Emergency vehicle at site		1	
9f	Periodical medical check-up is conducted for all the workers and submitted?		1	Medical check records
99	Availability of sufficient number of first aid box as per standard list and maintaining record		1	Inspection records
10a	Availability of Fire extinguishers, buckets at all vulnerable points		2	Fire extinguisher records
10b	Periodic fire mock drill conducted?		1	Fire, Mock drill records
100	Are all flammable materials are stored separately?		1	
10d	Periodic grass cutting is done in material storage area?		1	
10e	Availability of 24V DC lighting in confined space work area		1	
10f	Availability of exhaust fan in confined space work area		1	

Note:

- M: Mandatory; O: Optional. Points other than mandatory can be excluded with appropriate justification (scope etc.) by BHEL
- Additionally: 30 Marks for each Fatal Accident and 10 mark for each major accident shall be deducted.



SAFETY WORK CLEARANCE	Permit no.
Project:	Emergency Contact Nos:
Subcontractor:	

BURNING/WELDING /HOT WORK PERMIT

Area	:	Date:		Time:	
	e of Site Engineer (Permit Requesting Authority):				
	e of Work Performing Contractor:		_		
	e of Package In charge:				
Desc	ription of Work:				
	Execution Date:				
The a	above signing person(s) will be responsible to ensure a e permit to work.	that the above described work will be o	done under all the	safety precauti	ons mentioned
	ollowing precautions are to be taken:				
No.	Item			Yes	Not required
1.	Proper Access/Exit available				
2.	Proper ventilation and /or lighting provided.				
3.	Proper and safe scaffolding, platform, ladder provid	led.			
4.	Welding machine located in a clean and dry area.				
5.	Welding machine grounded at the equipment and p provided for welding machine.	proper leakage current protection devic	e (ELCB)		
6.	Emergency STOP buttons are in working condition.	. Welder /Helper knows how to operate	e it.		
7.	Welding machine input/output cables, welding holds good condition.	er and weld return clamp (Holder) are	insulated and in		
8.	Welder & Fitter trained to connect ground/work retu welding machine.	ırn clamps (Holder) to work place prior	to energization of		
9.	Gas cylinders are stacked vertically and not below twith cylinder.	the welding / cutting area. Regulator ke	ey is available		
10.	Pressure gauges/Flash back arrestor provided and	in working condition.			
11.	Personal Protective equipment Minimum applicable shoes, leather gloves, long sleeve and nose mask -		ng helmet, safety		
12.	In case of pits, water removed from the pit and woo	od/rubber insulation provided.			
13.	Safety signboards are in place.				
14.	Adequate and Suitable nos. of fire fighting extinguis	sher provided.			
15.	Nearby combustible material removed. Housekeepi	ing done.			
16.	Other				
			_	_	
	e of Contractor Safety Officer:ewed and approved by BHEL Site Engineer (Permi		Da	ate:	1 ime:
	ewed and approved by BNEL Site Engineer (Fermi e:	• • • • • • • • • • • • • • • • • • • •	Date:	Ti	me:
	e of BHEL Safety Representative:				
I und	erstand the precaution to be taken as described above upervision by following all precaution and Safety Rules	e and as per project requirement and I			
-	e of Work Performing Authority:		Date:	Time):
Perm	it Cancellation:				
I here	eby declare that the work is complete, all workers und	er my control have been withdrawn an	d the site restored	to safe tidy cor	ndition.
Name	e of Work performing Authority:	Sign:	Date:	Time:_	
Name	e of Site Engr. (Permit Requesting Authority):	Sign:	Date:	Time:	
Name	e of BHEL Site Engr. (Permit Issuing Authority):	Sign:	Date:	Time:	
	(This perr	mit is valid only for the date it is issued)		
Origi	nal at BHEL site Second	Copy - BHEL SAFETY	Third Copy : C	ontractor	



SAFETY WORK CLEARANCE	Permit no.
Project:	Emergency Contact Nos:
Subcontractor:	

LIFTING ACTIVITY PERMIT

Area	·	Date:	Time:	
Name	e of Site Engineer (Permit Requesting Authority):		Sign: Nar	ne of Work
Perfo	orming Contractor:			
Name	e of Package In charge:	Sign:	Date):
Desc	ription of Work:			
	Execution Date:			
	above signing person(s) will be responsible to ensu autions mentioned on the permit to work.	re that the above described work w	vill be done under all	the safety
The f	ollowing precautions are to be taken:			
No.	Item		Yes	Not required
1.	Crane used for lifting activity tested, certified and appro-	ved for rated lifting		
2.	All lifting tackles, gears/appliances are tested and certifi	ed for lifting works.		
3.	Crane operator is trained and competent for lifting opera	ation.		
4.	Lifting sling/ belt is protected against sharp edge of the	jobs to be lifted.		
5.	Access and exit marked and without obstruction.			
6.	Lifting arrangement adequate.			
7.	Unwanted rubbish material removed from work platform	l.		
8.	Minimum 2 guidelines have been provided for balancing	g and guiding jobs to be lifted.		
9.	Periphery area of crane booms as well as lifting job is be posted.	arricaded and unauthorized/no-entry si	gn board	
10.	Rigger and signal man is trained and competent for lifting	ng work.		
11.	No lifting activity to be carried out during lightening, hea	vy wind/rain.		
12.	If scaffolding to be used during lift, scaffolding with valid	I tag available for use.		
13.	Double lanyards safety harness/belt checked an in work	king condition.		
14.	Safety shoes (non-slip), helmet with chin strap available	e with employees.		
15.	Others.			
Name	e of Contractor Safety Officer:	Sign:	Date:	Time:
	ewed and approved by BHEL Site Engineer (Per		Batc	111110.
	e:		Date:	Time:
	e of BHEL Safety Representative:			
	lerstand the precaution to be taken as described ab uted under my supervision by following all precautio		t and hereby confirm	that work will be
	e of Work Performing Authority:		Date:	Time:
Perm	nit Cancellation:			
I here	eby declare that the work is complete, all workers unition.	nder my control have been withdra	wn and the site resto	ored to safe tidy
Name	e of Work performing Authority:	Sign:	Date:	Time:
	e of Site Engr. (Permit Requesting Authority):			
Name	e of BHEL Site Engr. (Permit Issuing Authority):	Sign:	Date:	Time:

(This permit is valid only for the date it is issued)



SAFETY WORK CLEARANCE	Permit no.
Project:	Emergency Contact Nos:
Subcontractor:	

WORKING AT HEIGHT PERMIT

moa.		Date:	Tir	me:
Name	of Site Engineer (Permit Requesting Authority):		Sign: N	Name of Work
Perfor	rming Contractor:			
Name	of Package In charge:	Sign:	D	ate:
Descr	iption of Work:			
	Execution Date:Ti			
	bove signing person(s) will be responsible to ensure to utions mentioned on the permit to work.	tnat the above described work	wiii be aone unaer	all the safety
The fo	ollowing precautions are to be taken:			
No.	Item		Yes	Not required
1.	All workers on job are medically fit for working at height (Pe	erson should not have vertigo)		
2.	Scaffolding with valid tag available for use			
3.	Safety harness with life line support/ fall arrester are check	ed and in working condition		
4.	Safety shoes (non-slip), Helmet with chin strip available wi	th employees		
5.	Safety nets are provided as per design and provided 25 ft.	below working area & extending 8	3 ft beyond.	
6.	Horizontal life lines are provided to cater to design specifical	ation of 2300kg per person.		
7.	Ladders have been inspected and provided as per BHEL s	tandard/contract.		
8.	All lifting / tightening tools, hand tools/equipment checked a	and in good condition		
9.	Access and exit marked and without obstruction.			
10.	Lighting arrangement adequate.			
11.	Unwanted and rubbish material removed from working plat	form.		
12.	Electrical cable, welding Hose/Compressed air hose prope	rly secured and lay down without	obstruction.	
13.	Signboards provided on working platforms			
14.	Hazards in the vicinity are identified and communicated to	the worker.		
15.	Other			
Nome	of Contractor Safaty Officer	Sign	Data	Time:
	e of Contractor Safety Officer:ewed and approved by BHEL Site Engineer (Permi		Date	riine
	:::		Date:	Time:
	e of BHEL Safety Representative:			
I unde	erstand the precaution to be taken as described above tted under my supervision by following all precaution a	e and as per project requireme		
Name	of Work Performing Authority:	Sign:	Date:	Time:
Perm	it Cancellation:			
I here condit	by declare that the work is complete, all workers under tion.	er my control have been withd	rawn and the site re	stored to safe tidy
	of Work performing Authority:			
	e of Site Engr. (Permit Requesting Authority):			
	of BHEL Site Engr. (Permit Issuing Authority):	•		

(This permit is valid only for the date it is issued)



Regd Office: BHEL House, Siri Fort, New Delhi-110049



Page 1of 5

Name of Project	Contract No.	
Name of Work	Name of Contractor	

PART- A: PLAN/ REVIEW OF WORK FOR THE MONTH OF

Data	of Dlass	D	
Date	or Plan/	Keview	

Form No: F-14 (Rev 01)

SN.	Description of work	Unit of Measur ement	Unit Rate	(QTY Pla	nned for the per Part –C of month)	attril contrac	tive Shortfall butable to ctor upto last month er Note 1)	Ac	hieved	to BHE	attributable L w.r.t Plan ol. 3 of Part- D)	attril Contra	tive Shortfall butable to actor upto & ng this month	REMARKS (Reasons for Shortfall attributable to Contractor.
(a)	(b)	(c)	(d)		A		В		C	D		E=A	A+B-C-D	Supporting documents to be kept as record.)
				Phy.	Financial	Phy.	Financial	Phy.	Financial	Phy.	Financial	Phy.	Financial	kept us record.)
	Value of Other Items not mentioned above but planned to be executed in this month													
	Total			<u> </u>	ΣΑ		ΣΒ		ΣC		ΣD		ΣΕ	

Note 1: In addition to the work planned as per Col. 'A', Contractor shall also make full efforts to minimize the 'Cumulative shortfall attributable to contractor upto the month' as mentioned in Col. 'B' by enhancing its resources, so as to achieve the completion of activities as per agreed schedule. In case contractor is not able to execute the entire shortfall, then BHEL 'Engineer in-charge', shall decide the priority of work to be executed and it shall be binding on the contractor.

Note 2: Percentage Shortfall attributable to contractor w.r.t. "Plan - Shortfall attributable to BHEL" for the month = $[(\Sigma E - \Sigma B)/(\Sigma A - \Sigma D)]x100$ In case, $(\Sigma E - \Sigma B)$ is negative, then it shall be treated as zero percent."

Note 3: Form 14 should include all items being planned in the current month, and all items against which shortfall was attributable to contractor till previous month. However, for practical reason, if it is not possible to mention some of the items in Form-14 being planned to be executed in this month, then also value of such items shall necessarily be included in calculation of Total Value.

Note 4: In case reason for shortfall attributable to contractor is w.r.t. T&P and Manpower, it should be in conformity with Part B1 and B2.





Name of Project	Contract No.	
Name of Work	Name of Contractor	

CONTRACTOR'S SCOPE:-

PLAN			DEPLOYMENT STATUS				
Major T&P to be deployed as per work planned for the month	QTY.	Deployment Period (in days)	Weightage assigned to planned T&P (in fraction such that ΣC =1)	Actual Deployed Quantity	Actual Deployment Period (in days)	Weighted T&P Deployed	REMARKS (Works affected due to non-deployment of T&Ps)
	A	В	С	D	Е	$F=(C \times D \times E) / (A \times B)$	

Note: In case, E>B, it shall be considered as E=B. Similarly, in case D>A, it shall be considered as D=A. Percentage of T&P Deployed = $\Sigma F \times 100$

BHEL SCOPE:-

	PLAN				DEPLOYMENT STATUS			
SN.	Major T&P to be deployed as per work planned for the month	QTY.	Deployment Period (in days)	Actual Deployed Quantity	Actual Deployment Period (in days)	REMARKS (Works affected due to non-deployment of T&Ps)		

Form No: F-14 (Rev 01)

Page 2of 5





Form No: F-14 (Rev 01)

Name of Project Contract No. Name of Work Name of Contractor

PART – B-2: PLAN/ REVIEW OF DEPLOYMENT OF MANPOWER FOR THE MONTH OF	Date of Plan/ Review

CONTRACTOR'S SCOPE:-

SN.	Area of Work	Category of Labour	No. of Labour required as per category	Deployment Period (in days)	No. of Labour actually deployed	Actual Deployment Period (in days)	REMARKS (Works affected due to non-availability of labour)
			A	В	С	D	

Percentage of Manpower Deployed= $100 \times \Sigma(CxD)/\Sigma(AxB)$

Page 3of 5



Page 4of 5

Name of Project	Contract No.	
Name of Work	Name of Contractor	

PART – C: PLAN(PHYSICAL) FOR THE NEXT MONTH i.e. Date of Plan

	Planned		raci s required				Manpower Required		REMARKS		
		Original	Quantity (excluding	Unit of	Contractor Sc	ope	BHEL Sco	pe			(Reasons for
SN.	Description of work	Planned Quantity	shortfalls attributable to contractor till date)	ortfalls Measu- butable to rement tractor till	Major T&P to be deployed as per work planned for the month	Quantity	Major T&P to be deployed as per work planned for the month	Quantity	Category of Labour	No. of Labour required as per Category	difference in Original Planned Quantity w.r.t. Planned quantity to be given)

Note 1: Planned quantity should be based on available/ expected fronts/ inputs in the next month

Form No: F-14 (Rev 01)

Note 2: "Original Planned Quantity" shall be as per latest jointly agreed programme between BHEL and Contractor before commencement of work or at the time of latest Time Extension, as the case may be.





- Page 5of 5

Name of Project	Contract No.	
Name of Work	Name of Contractor	

PART - D: REASONS FOR SHORTFALL ATTRIBUTABLE TO BHEL IN RESPECT OF PLAN FOR THE MONTH

	Description of Work	Quantities Affected		Reasons for Shortfall	Agency responsible for	Remarks	
SN.	(from Part-A)	Physical	Unit of Measu-	attributable to BHEL	reasons for shortfall	(Supporting Documents in respect of agency responsible	
	, , , ,	Quantity	rement				
1	2	3		4	5	6	

Note1: Reasons for shortfall shall include non-availability of fronts/ drawings/ materials/ T&P (BHEL Scope)/ clearances etc. and other hindrances for which contractor is not responsible.

Note2: Agency responsible may be BHEL Site/ MUs/ Design Centre/ BHEL Customer etc.

Form No: F-14 (Rev 01)

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
#1.01	Cumulative number of days in the month, the nominated Quality Officer or his authorised nominee was not available	QUALITY	1.5		Quality Officer or his authorised nominee should be available for all the days of working at site	Daily Log Book entry/Incident Registers/letter references
#1.02	Number of instances of non- compliance wrt FQP, Standard Drawings, Specifications, E&C Manuals etc.	QUALITY	1.5		No deviation from FQP, Standard Drawings, Specifications, E&C Manuals etc. is allowed without BHEL Engineer's approval.	Daily Log Book entry/Incident Registers/letter references
#1.03	Percentage submission of test certificates for batches of welding electrodes, cement, sand, aggregate, consumable, Paints etc. as applicable for this month OR In case of MM & MH package, monthly checks for Storage/Preservation of material.	QUALITY	1		Submission of 100% Test certificates for materials as per FQP is mandatory. MM & MH package: Storage/Preservation as per manual/procedure.	Daily Log Book entry/Incident Registers/letter references
#1.04	Number of incidences of improper storage & preservation (not in accordance to the guidelines of BHEL MUs or approved FQP) of materials, consumables (viz. gases, welding electrodes & fluxes, fuel etc.) & bought-out items (paints, fasteners etc.) under the custody of the contractor	QUALITY	1		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references
#1.05	Rework/ Rejection instances in a month necessitated due to deviation from Standard Drawings /Specifications /Manuals /E&C procedures /FQPs or due to Poor Workmanship by contractor	QUALITY	2		Reworks/ Rejection should be as minimum as possible. Total number of reworks/ rejections due to reasons attributable to contractor.	Daily Log Book entry/Incident Registers/letter references
#1.06	Delay in preparation & submission of signed protocols / log sheets / site register / NDT test reports as per approved FQP/ Qualified Welder List along with photocopies of Welder ID cards / Welder Performance Evaluation records etc. in the month OR in case of MM / MH package reconciliation statement / verification report.	QUALITY	1		Within 2 days of measurements taken or within first 3 working days of next month, as advised by BHEL Engineer	Daily Log Book entry/Incident Registers/letter references
#1.07	Number of instances for Major equipment/product failure due to negligence/improper work/poor workmanship by contractor	QUALITY	1		No such event should happen	Daily Log Book entry/Incident Registers/letter references
#1.08	Total number of complaints received in the month on the quality of finish / aesthetics	QUALITY	1		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references

Form No.: F-15 (Rev 02)

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
#2.01	Cumulative number of days of delay in submission of Plan FOR THE MONTH supported by deployment plan of Major T&Ps and Manpower (as per Form F-14) and relevant construction/layout drawings - like A4 plan / elevation views of plan status for structures / pressure parts/Civil Works, Piping isometrics for piping, Layout / PID / System reference sketch, Unloading / storage plans etc.as applicable.	PERFORMANCE	5		Number of days delayed from second working day of the month	Daily Log Book entry/Incident Registers/letter references
#2.02	Percentage of timely submission of Daily Reports for Progress of work, Resources, Consumables etc.	PERFORMANCE	1.5		Percentage of timely submission of daily reports/ Scheduled date is successive next day for each day	Daily Log Book entry/Incident Registers/letter references
#2.03	Number of days delayed for submission of FQP log sheets / protocols / Monthly Progress Reports for the work executed during the month under measurement	PERFORMANCE	1.5		Number of days delayed/Scheduled date is first 2 working days of next month	Daily Log Book entry/Incident Registers/letter references
#2.04	Percentage Shortfall attributable to contractor w.r.t. "Plan - Shortfall attributable to BHEL" for the month as per Form-14	PERFORMANCE	35		As per Part-A of Form-14	Progress review formats
#2.05	Number of days delayed in submission of Running bills with complete supporting documents (including updated reconciliation statement of BHEL issued material) for the month	PERFORMANCE	2		Number of days delayed / Scheduled date is 7th day of next month	Daily Log Book entry/Incident Registers/letter references
#2.06	Number of times the Top Management of contractor did not respond to critical issues of site, for the month	PERFORMANCE	1		Total number of instances	Daily Log Book entry/Incident Registers/letter references
#2.07	Cumulative number of days in the month the works were stopped / refused on interpretation of contract clauses/scope due to tendency of taking undue advantage by interpreting contract clauses in their favour	PERFORMANCE	2		Cumulative number of days lost	Daily Log Book entry/Incident Registers/letter references
#2.08	Number of times rework was refused by contractor	PERFORMANCE	1		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
#2.09	Cumulative number of days in the month recording / logging was not done in daily log / history register / hindrance register / soft form in a PC maintained at BHEL Site Office	PERFORMANCE	1		Cumulative number of days recording or logging was not done / all days of the month	Daily Log Book entry/Incident Registers/letter references
#3.01	Percentage of Manpower Deployed w.r.t. Plan for the month as per Form-14.	RESOURCES	7		As per Part-B2 of Form-14	Daily Log Book entry/Incident Registers/letter references
#3.02	Percentage of T&P Deployed w.r.t. Plan for the month as per Form-14.	RESOURCES	7		As per Part-B1 of Form-14	Daily Log Book entry/Incident Registers/letter references
#3.03	Cumulative number of major instances in the month hampering / affecting progress of work due to breakdown or non-availability of major T&P and MME for the work, under the scope of Contractor	RESOURCES	3		Cumulative number of instances	Daily Log Book entry/Incident Registers/letter references
#3.04	Cumulative number of major instances in the month hampering / affecting progress of work due to non-availability of Consumables/ use of improper consumables under the scope of contractor	RESOURCES	3		Cumulative number of instances	Daily Log Book entry/Incident Registers/letter references
#4.01	Number of non-compliances during the month for Statutory requirements like validity of Labour Licence, Insurance Policy, Labour Insurance, PF, BOCW Compliance etc. and any other applicable laws/ Regulation, Electrical Licence, T&P fitness certificate, Contractors' All Risk Policy etc. as applicable	SITE INFRASTRUCTURE & SERVICE	1		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references
#4.02	Cumulative number of days in a month poor illumination is reported at storage area, erection area, pre-assembly area and other designated areas by BHEL site.	SITE INFRASTRUCTURE & SERVICE	0.5		Total number of non-compliances/random checks	Daily Log Book entry/Incident Registers/letter references
#4.03	Cumulative number of days of non-availability of well-maintained toilets facilities for workers (separate for men and women) and non-availability of potable drinking water stations for workers in specified areas.	SITE INFRASTRUCTURE & SERVICE	1		Total number of non-compliances/random checks	Daily Log Book entry/Incident Registers/letter references

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
#4.04	Total number of instances in the month, Housekeeping NOT attended to in spite of instructions by BHEL -i.e. removal / disposal of surplus earth / debris / scrap / unused / surplus cable drums / other electrical items / surplus steel items / packing materials, thrown out scrap like weld butts, cotton waste etc. from the working area to identified locations	SITE INFRASTRUCTURE & SERVICE	2		Total number of non-compliances/random checks	Daily Log Book entry/Incident Registers/letter references
#4.05	Total number of instances in a month, Site Office with reasonably good facilities including enough nos. of computers and printers etc. for use by office and supporting staff was not made available/maintained.	SITE INFRASTRUCTURE & SERVICE	0.5		No discrepancy during regular or surprise visits	Photograph and report of the Engineer
#5.01	Number of days delayed in making labour payments for the last month	SITE FINANCE	2		Number of days delayed / Scheduled date is 7th day of next month	Daily Log Book entry/Incident Registers/letter references
#5.02	Number of complaints from labour/ sub supplier/ sub-contractor for non-receipt of payments from contractor	SITE FINANCE	1.5		Total number of complaints or reporting	Daily Log Book entry/Incident Registers/letter references
#5.03	Number of times the site operations were hampered for want of funds at the disposal of site-in-charge.	SITE FINANCE	1.5		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references
#6.01	Cumulative number of days in a month the nominated Safety Officer was not available	HSE & SA	1		Safety Officer should be available for all the days	Daily Log Book entry/Incident Registers/letter references
#6.02	Shortfall in number of weekly safety meetings in the month conducted or attended by the Safety Officer	HSE & SA	0.5		Safety meetings to be held every week	Copy of Minutes of meeting
#6.03	Level of compliance w.r.t decisions taken in previous Safety meetings	HSE & SA	0.5		Number of consolidated issues discussed in Safety meetings	Copy of Minutes of meeting, Non- compliance intimation documents from BHEL site
#6.04	Delay in submission of monthly report on safety (including electrical safety for equipment & personnel etc.) in the prescribed form	HSE & SA	1		Number of days delayed/Scheduled date is third working day of next month	Daily Log Book entry/Incident Registers/letter references
#6.05	Number of days taken for lodging FIRs from date of occurrence/notice of incident of theft / accident etc.	HSE & SA	0.5		Number of days delayed/Scheduled date is within 24 Hrs of occurrence/notice of incidence	Copy of FIR lodged by Contractor

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
#6.06	Number of times written(email, letters etc.) warning issued for non-availability/ use of improper Fall protection and rescue arrangement as lifeline, fall arrestors, safety net, hand-railings, covered floors, man-basket, rescue basket & kit etc. by the contractor	HSE & SA	2		Total number of non-compliances	Daily Log Book entry/Incident Registers/letter references
#6.07	Number of times punitive fines imposed for unsafe practices as per contract like non-availability/use of PPEs as safety shoes, helmets, goggles, gloves, lifeline, safety belts etc.	HSE & SA	1		Total number of non-compliances	Non-compliance intimation documents from BHEL site
#6.08	Percentage compliance to Emergency preparedness and response plan: Portable Fire-extinguishers, Buckets, Fire-wardens, display of emergency numbers, mock-drills, Hazard Identification and Risk Assessment(HIRA) etc.	HSE & SA	1		Compliance should be 100% as per HSE Plan or as finalized in Safety Meetings	Non-compliance intimation documents from BHEL site
#6.09	Number of times the agency has defaulted on display of safety posters / safety slogans / safety barriers/emergency numbers etc. in identified areas	HSE & SA	0.5		Total number of instances	Non-compliance intimation documents from BHEL site
#6.10	Non compliances observed during HSE and Safety Audit	HSE & SA	0.5		Total number of non-compliances	Non-compliance intimation documents from BHEL site, Audit Reports
#6.11	Cumulative number of days in the month, non- availability of First Aid Kit, First Aider & Emergency Vehicles/Ambulance.	HSE & SA	0.5		Cumulative number of days	Non-compliance intimation documents from BHEL site
#6.12	Number of days taken for submission of Root Cause analysis (RCA) for the accident from the cut-off date intimated by BHEL for submission of RCA	HSE & SA	0.5		Number of days delayed/Scheduled date is cut-off date intimated by BHEL	Daily Log Book entry/Incident Registers/letter references
#6.13	Non conductance of training (induction, job specific, height work etc.), tool box meeting and health check-up as per Contract requirements	HSE & SA	0.5		Number of incidences of non-conductance during the month	Daily Log Book entry/Incident Registers/letter references

Project		Vendor			Package/Unit	
SI. No.	Parameter for Measurement	Classification	Max Score	Score Obtained	Measurement Key/Scheduled date	Supporting Documents
person injur Equipment	Less Deduction in Score Due to Major Accidents (Fatal, Permanent Disability or bodily injury by which person injured is prevented to resume to work within 48 hours or more after accident,, Major Damage to Equipment etc.) attributable to the contractor @ 3 points/ accident Less Deduction in Score Due to Minor Accidents attributable to the contractor @ 1 point/ accident					
Less Deduction in Score Due to not Maintaining of Labour Colony (if applicable) as per BHEL HSE policy @2 points in a month on verification any day						
	Final Score					

Performance Score Summary for the Month	Total Score	Score Obtained
QUALITY	10	
PERFORMANCE	50	
RESOURCES	20	
SITE INFRASTRUCTURE & SERVICE	5	
SITE FINANCE	5	
HSE & SA	10	
OTHERS (deductions if any)	0	
TOTAL	100	

Note:

- It is only indicative and shall be as per the online format issued by BHEL time to time.
 No request will be entertained after specified date of current month w.r.t. changes requested in the scores of immediate previous month.

PROFORMA OF BANK GUARANTEE (in lieu of SECURITY DEPOSIT)

(On non-Judicial paper of appropriate value) (Para 4.7.6 of Works Accounts Manual)

	Bank Guarantee No
	Date
To (Employer's Name and Address)	
In consideration of Bharat Heavy Electricals Limited (hereinafter reference expression shall unless repugnant to the context or meaning there permitted assigns) incorporated under the Companies Act, 1956 an BHEL House, Siri Fort, Asiad, New Delhi – 110049 through its unit at Enewer Sector Southern Region, Tek Towers, No.11, Old Mahabalipurar Chennai - 600097 having agreed to exempt	eof, include its successors and d having its registered office at Bharat Heavy Electricals Limited, m Road, Okkiyam Thoraipakkam,
Contractor / Supplier) with its registered office at² (hereina	
which term includes supplier), from demand under the terms and co	onditions of the Contract arising
vide Letter of Intent (LOI) reference No	dated ³ valued
at Rs 4 (Rupees	only) ⁴ (hereinafter called the
said Contract), of Security Deposit for the due fulfilment by the sa	id Contractor of the terms and
conditions contained in the said Contract, on production of a Bank G	juarantee for Rs5
(Rupees only),	
We, the	ng our Head Office at Bank), at the request of antor under this Guarantee, do
an amount not exceeding Rs without any demur, in Employer and without any reservation, protest, and recourse and w prove or demonstrate reasons for its such demand	mmediately on demand from the
Any such demand made on the bank, shall be conclusive as regards the Bank under this guarantee. However, our liability under this guarantee amount not exceeding Rs5.	
We undertake to pay to the Employer any money so demanded r disputes raised by the Contractor(s) in any suit or proceeding pending Arbitrator or any other authority, our liability under this present b	g before any Court or Tribunal or
The payment so made by us under this guarantee shall be a valid dischereunder and the Contractor(s) shall have no claim against us for materials.	
We, further agree that the guarantee herein contained shall remain in period that would be taken for the performance of the said Contract enforceable till all the dues of the Employer under or by virtue of the paid and its claims satisfied & the Employer certifies that the terms an have been fully and properly carried out by the said contractor(s) of discharge of this guarantee by the Employer, whichever is earlier. This in force upto and including6 and shall be extended from time	t and that it shall continue to be ne said Contract have been fully d conditions of the said Contract or acceptance of the final bill or s guarantee shall initially remain

on or before the ⁷ , we shall be discharged from all the liability under this guarantee thereafter.
We,(indicate the name of the Bank) further agree with the Employer that the Employer shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said Contract or to extend time of performance by the said contractor(s) from time to time or to postpone for any time or from time to time any of the powers exercisable by the Employer against the said contractor(s) and to forbear or enforce any of the terms and conditions relating to the said Contract and we shall not be relieved from our liability by any reason of any such variation or extension being granted to the said contractor(s) or for any forbearance, act or omission on the part of the Employer or any indulgence by the Employer to the said contractor(s) or by any such matter or thing whatsoever which under the law relating to sureties would but for this provision have effect of so relieving us.
The Bank also agrees that the Employer at its option shall be entitled to enforce this Guarantee against the Bank as a principal debtor, in the first instance without proceeding against the Contractor and notwithstanding any security or other guarantee that the Employer may have in relation to the Contractor's liabilities.
This Guarantee shall not be determined or affected by liquidation or winding up, dissolution or change of constitution or insolvency of the Contractor but shall in all respects and for all purposes be binding and operative until payment of all money payable to the Employer in terms thereof. This guarantee will not be discharged due to the change in the constitution of the Bank or the Contractor(s).
We, BANK lastly undertake not to revoke this guarantee during its currency except with the previous consent of the Employer in writing. Notwithstanding anything to the contrary contained hereinabove:
a) The liability of the Bank under this Guarantee shall not exceed
b) This Guarantee shall be valid up to
We, Bank, have power to issue this Guarantee under law and the undersigned as a duly authorized person has full powers to sign this Guarantee on behalf of the Bank.
Date Day of for (indicate the name of the Bank)
(Signature of Authorised signatory)
 NAME OF VENDOR /CONTRACTOR / SUPPLIER REGISTERED OFFICE ADDRESS OF THE VENDOR /CONTRACTOR / SUPPLIER. LETTER OF INTENT(LOI) REFERENCE NO. WITH DATE CONTRACT VALUE (AS MENTIONED IN LOI) BG AMOUNT IN FIGURES AND WORDS VALIDITY DATE DATE OF EXPIRY OF CLAIM PERIOD (CLAIM PERIOD SHALL BE MINIMUM OF 3 MONTHS AFTER VALIDITY DATE)

Note:

- 1. The BG should be on Non-Judicial Stamp paper/e-stamp paper of appropriate value as per Stamp Act prevailing in the State(s) where the BG is submitted or is to be acted upon or the rate prevailing in the State where the BG was executed, whichever is higher. The Stamp Paper/e-stamp paper shall be purchased in the name of Vendor/Contractor/Supplier /Bank issuing the guarantee.
- 2. In Case of Bank Guarantees submitted by Foreign Vendors
 - a. From Nationalized/Public Sector / Private Sector/ Foreign Banks (BG issued by Branches in India) can be accepted subject to the condition that the Bank Guarantee should be enforceable in the town/city or at nearest branch where the Unit is located i.e. Demand can be presented at the Branch located in the town/city or at nearest branch where the Unit is located.
 - b. From Foreign Banks (wherein Foreign Vendors intend to provide BG from local branch of the Vendor Country's Bank)
 - b.1 In such cases, in the Tender Enquiry/ Contract itself, it may be clearly specified that Bank Guarantee issued by any of the Consortium Banks only will be accepted by BHEL. As such, Foreign Vendor needs to make necessary arrangements for issuance of Counter- Guarantee by Foreign Bank in favour of the Indian Bank's (BHEL's Consortium Bank) branch in India. It is advisable that all charges for issuance of Bank Guarantee/ counter- Guarantee should be borne by the Foreign Vendor. The tender stipulation should clearly specify these requirements.
 - b.2 In case, Foreign Vendors intend to provide BG from Overseas Branch of our Consortium Bank (e.g. if a BG is to be issued by SBI Frankfurt), the same is acceptable. However, the procedure at sl.no. b.1 will required to be followed.
 - b.3 The BG issued may preferably be subject to Uniform Rules for Demand Guarantees (URDG) 758 (as amended from time to time).

PROCEDURE FOR CONDUCT OF CONCILIATION PROCEEDINGS

- 1. The proceedings of Conciliation shall broadly be governed by Part-III of the Arbitration and Conciliation Act 1996 or any statutory modification thereof and as provided herein:
- 2. The party desirous of resorting to Conciliation shall send an invitation/notice in writing to the other party to conciliate specifying all points of Disputes with details of the amount claimed. The party concerned shall not raise any new issue thereafter. Parties shall also not claim any interest on claims/counterclaims from the date of notice invoking Conciliation till the conclusion of the Conciliation proceedings. If BHEL is to initiate Conciliation, then, the invitation to Conciliate shall be extended to the concerned Stakeholder in Format 7 hereto. Where the stakeholder is to initiate the Conciliation, the notice for initiation of Conciliation shall be sent in Format-8 hereto.
- **3.** The party receiving the invitation/notice for Conciliation shall within 30 days of receipt of the notice of Conciliation intimate its consent for Conciliation along with its counter-claims, if any.
- 4. The Conciliation in a matter involving claim or counter-claim (whichever is higher) up to Rs 5 crores shall be carried out by sole Conciliator nominated by BHEL while in a matter involving claim or counter-claim (whichever is higher) of more than Rs 5 crores Conciliation shall be carried out by 3 Conciliators nominated by BHEL. The appointment of Conciliator(s) shall be completed and communicated by the concerned Department/Group of BHEL Unit/Division/Region/Business Group to the other party and the Conciliator(s) within 30 days from the date of acceptance of the invitation to conciliate by the concerned party in the **Format-9**. The details of the Claim, and counter-claim, if any, shall be intimated to the Conciliator(s) simultaneously in **Format-5**.
- **5.** The Parties shall be represented by only their duly authorized in-house executives/officers and neither Party shall be represented by a Lawyer.
- **6.** The first meeting of the IEC shall be convened by the IEC by sending appropriate communication/notice to both the parties as soon as possible but not later than 30 days from the date of his/their appointment. The hearings in the Conciliation proceeding shall ordinarily be concluded within two (2) months and, in exceptional cases where parties have expressed willingness to settle the matter or there exists possibility of settlement in the matter, the proceedings may be extended by the IEC by a maximum of further 2 months with the consent of the Parties subject to cogent reasons being recorded in writing.

- 7. The IEC shall thereafter formulate recommendations for settlement of the Disputes supported by reasons at the earliest but in any case within 15 days from the date of conclusion of the last hearing. The recommendations so formulated along with the reasons shall be furnished by the IEC to both the Parties at the earliest but in any case within 1 month from the date of conclusion of the last hearing.
- **8.** Response/modifications/suggestions of the Parties on the recommendations of the IEC are to be submitted to the IEC within time limit stipulated by the IEC but not more than 15 days from the date of receipt of the recommendations from the IEC.
- **9.** In the event, upon consideration, further review of the recommendations is considered necessary, whether by BHEL or by the other Party, then, the matter can be remitted back to the IEC with request to reconsider the same in light of the issues projected by either/both the Parties and to submit its recommendations thereon within the following 15 days from the date of remitting of the case by either of the Parties.
- **10.** Upon the recommendations by the Parties, with or without modifications, as considered necessary, the IEC shall be called upon to draw up the Draft Settlement Agreement in terms of the recommendations.
- 11. When a consensus can be arrived at between the parties only in regard to any one or some of the issues referred for Conciliation the draft Settlement Agreement shall be accordingly formulated in regard to the said Issue(s), and the said Settlement Agreement, if signed, by the parties, shall be valid only for the said issues. As regards the balance issues not settled, the parties may seek to resolve them further as per terms and conditions provided in the contract.
- **12.** In case no settlement can be reached between the parties, the IEC shall by a written declaration, pronounce that the Conciliation between the parties has failed and is accordingly terminated.
- **13.** Unless the Conciliation proceedings are terminated in terms of para 22 (b), (c) & (d) herein below, the IEC shall forward his/its recommendations as to possible terms of settlement within one (1) month from the date of last hearing. The date of first hearing of Conciliation shall be the starting date for calculating the period of 2 months.
- **14.** In case of 3 members IEC, 2 members of IEC present will constitute a valid quorum for IEC and meeting can take place to proceed in the matter after

seeking consent from the member who is not available. If necessary, videoconferencing may be arranged for facilitating participation of the members. However, the IEC recommendations will be signed by all members. Where there is more than one (1) Conciliator, as a general rule they shall act jointly. In the event of differences between the Members of IEC, the decision/recommendations of the majority of the Members of IEC shall prevail and be construed as the recommendation of the IEC.

- **15.** The Draft Settlement Agreement prepared by the IEC in terms of the consensus arrived at during the Conciliation proceedings between the Parties shall be given by the IEC to both the parties for putting up for approval of their respective Competent Authority.
- **16.** Before submitting the draft settlement agreement to BHEL's Competent Authority viz. the Board Level Committee on Alternative Dispute Resolution (BLCADR) for approval, concurrence of the other party's Competent Authority to the draft settlement agreement shall be obtained by the other party and informed to BHEL within 15 days of receipt of the final draft settlement agreement by it. Upon approval by the Competent Authority, the Settlement Agreement would thereafter be signed by the authorized representatives of both the Parties and authenticated by the members of the IEC.
- **17.** In case the Draft Settlement Agreement is rejected by the Competent Authority of BHEL or the other Party, the Conciliation proceedings would stand terminated.
- **18.** A Settlement Agreement shall contain a statement to the effect that each of the person(s) signing thereto (i) is fully authorized by the respective Party(ies) he/she represents, (ii) has fully understood the contents of the same and (iii) is signing on the same out of complete freewill and consent, without any pressure, undue influence.
- **19.** The Settlement Agreement shall thereafter have the same legal status and effect as an arbitration award on agreed terms on the substance of the dispute rendered by an arbitral tribunal passed under section 30 of the Arbitration and Conciliation Act, 1996.
- **20.** Acceptance of the Draft Settlement Agreement/recommendations of the Conciliator and/or signing of the Settlement Agreement by BHEL shall however, be subject to withdrawal/closure of any arbitral and/or judicial proceedings initiated by the concerned Party in regard to such settled issues.
- **21.** Unless otherwise provided for in the agreement, contract or the Memorandum of Understanding, as the case may be, in the event of likelihood of prolonged

absence of the Conciliator or any member of IEC, for any reason/incapacity, the Competent Authority/Head of Unit/Division/Region/Business Group of BHEL may substitute the Conciliator or such member at any stage of the proceedings. Upon appointment of the substitute Conciliator(s), such reconstituted IEC may, with the consent of the Parties, proceed with further Conciliation into the matter either de-novo or from the stage already reached by the previous IEC before the substitution.

- **22.** The proceedings of Conciliation under this Scheme may be terminated as follows:
 - **a.** On the date of signing of the Settlement agreement by the Parties; or,
 - **b.** By a written declaration of the IEC, after consultation with the parties, to the effect that further efforts at conciliation are no longer justified, on the date of the declaration; or,
 - **c.** By a written declaration of the Parties addressed to the IEC to the effect that the Conciliation proceedings are terminated, on the date of the declaration; or,
 - **d.** By a written declaration of a Party to the other Party and the IEC, if appointed, to the effect that the Conciliation proceedings are terminated, on the date of the declaration; or,
 - **e.** On rejection of the Draft Settlement Agreement by the Competent Authority of BHEL or the other Party.
- **23.** The Conciliator(s) shall be entitled to following fees and facilities:

S1 No	Particulars	Amount					
1	Sitting fees	Each Member shall be paid a Lump					
		Sum fee of Rs 75,000/- for the whole					
		case payable in terms of paragraph No.					
		27 herein below.					
2	Towards drafting of	In cases involving claim and/or					
	settlement	counter-claim of up to Rs 5crores.					
	agreement	Rs 50,000/- (Sole Conciliator)					
		In cases involving claim and/or					
		counter-claim of exceeding Rs 5 crores					
		but less than Rs 10 crores.					
		Rs 75,000 (per Conciliator)					

S1 No	Particulars	Amount
		In cases involving claim and/or counter-claim of more than Rs 10 crores. Rs 1,00,000/- (per Conciliator) Note: The aforesaid fees for the drafting of the Settlement Agreement shall be paid on the, Signing of the Settlement Agreement after approval of the Competent Authority or Rejection of the proposed Settlement Agreement by the Competent Authority of BHEL.
3	Secretarial expenses	Rs 10,000/- (one time) for the whole case for Conciliation by a Sole Member IEC. Where Conciliation is by multi member Conciliators –Rs 30,000/- (one time)- to
		be paid to the IEC
4	Travel and transportation and stay at outstation Retired Senior Officials of other Public Sector Undertakings (pay scale wise equivalent to or more than E-8 level of BHEL)	As per entitlement of the equivalent officer (pay scale wise) in BHEL.
	Others	As per the extant entitlement of whole time Functional Directors in BHEL. Ordinarily, the IEC Member(s) would be entitled to travel by air Economy Class.
5	Venue for meeting	Unless otherwise agreed in the agreement, contract or the Memorandum of Understanding, as the case may be, the venue/seat of proceedings shall be the location of the concerned Unit / Division / Region /

S1 No	Particulars	Amount
		Business Group of BHEL. Without
		prejudice to the seat/venue of the
		Conciliation being at the location of
		concerned BHEL Unit / Division /
		Region / Business Group, the IEC after
		consulting the Parties may decide to
		hold the proceedings at any other
		place/venue to facilitate the
		proceedings. Unless, Parties agree to
		conduct Conciliation at BHEL premises,
		the venue is to be arranged by either
		Party alternately.

- **24.** The parties will bear their own costs including cost of presenting their cases/evidence/witness(es)/expert(s) on their behalf. The parties agree to rely upon documentary evidence in support of their claims and not to bring any oral evidence in IEC proceedings.
- 25. If any witness(es) or expert(s) is/are, with the consent of the parties, called upon to appear at the instance of the IEC in connection with the matter, then, the costs towards such witness(es)/expert(s) shall be determined by the IEC with the consent of the Parties and the cost so determined shall be borne equally by the Parties.
- **26.** The other expenditures/costs in connection with the Conciliation proceedings as well as the IEC's fees and expenses shall be shared by the Parties equally.
- **27.** Out of the lump sum fees of Rs 75,000/- for Sitting Fees, 50% shall be payable after the first meeting of the IEC and the remaining 50% of the Sitting Fees shall be payable only after termination of the conciliation proceedings in terms of para 22 hereinabove.
- 28. The travelling, transportation and stay at outstation shall be arranged by concerned Unit as per entitlements as per Serial No. 4 of the Table at para 23 above, and in case such arrangements are not made by the BHEL Unit, the same shall be reimbursed to the IEC on actuals limited to their entitlement as per Serial No. 4 of the Table at Para 23 above against supporting documents. The IEC Member(s) shall submit necessary invoice for claiming the fees/reimbursements.
- **29.** The Parties shall keep confidential all matters relating to the conciliation proceedings. Confidentiality shall extend also to the settlement agreement,

- except where its disclosure is necessary for purposes of its implementation and enforcement or as required by or under a law or as per directions of a Court/Governmental authority/ regulatory body, as the case may be.
- **30.** The Parties shall not rely upon or introduce as evidence in any further arbitral or judicial proceedings, whether or not such proceedings relate to the Disputes that is the subject of the Conciliation proceedings:
 - **a.** Views expressed or suggestions made by the other party in respect of a possible settlement of the Disputes;
 - **b.** admissions made by the other party in the course of the Conciliator proceedings;
 - **c.** proposals made by the Conciliator;
 - **d.** The fact that the other Party had indicated his willingness to accept a proposal for settlement made by the Conciliator.
- **31.** The Parties shall not present the Conciliator(s) as witness in any Alternative Dispute Resolution or Judicial proceedings in respect of a Disputes that is/was the subject of that particular Conciliation proceeding.
- **32.** None of the Conciliators shall act as an arbitrator or as a representative or counsel of a Party in any arbitral or judicial proceeding in respect of a Disputes that is/was the subject of that particular Conciliation proceeding.
- or judicial proceedings in respect of a Disputes that is the subject matter of the Conciliation proceedings except that a Party may initiate arbitral or judicial proceedings where, in his opinion, such proceedings are necessary for preserving his rights including for preventing expiry of period of limitation. Unless terminated as per the provisions of this Scheme, the Conciliation proceedings shall continue notwithstanding the commencement of the arbitral or judicial proceedings and the arbitral or judicial proceedings shall be primarily for the purpose of preserving rights including preventing expiry of period of limitation.
- **34.** The official language of Conciliation proceedings under this Scheme shall be English unless the Parties agree to some other language.

STATEMENT OF CLAIMS/COUNTER CLAIMS TO BE SUBMITTED TO THE IEC BY BOTH THE PARTIES

1.	Chrono	logy	of	the	Disputes	
----	--------	------	----	-----	----------	--

- 2. Brief of the Contract/MoU/Agreement/LOI/LOA
- 3. Brief history of the Disputes:
- 4. Issues:
- 5. Details of Clam(s)/Counter Claim(s):

SI. No.	Description of claim(s)/Counter Claim	Amount (in INR)Or currency applicable in the contract	Relevant contract clause

6. Basis/Ground of claim(s)/counter claim(s) (along with relevant clause of contract)

Note– The Statement of Claims/Counter Claims may ideally be restricted to maximum limit of 20 pages. Relevant documents may be compiled and submitted along with the statement of Claims/Counter Claims. The statement of Claims/Counter Claims is to be submitted to all IEC members and to the other party by post as well as by email.

FORMAT FOR NOTICE INVOKING CONCILIATION CLAUSE BY BHEL FOR REFERRING THE DISPUTES TO CONCILIATION THROUGH IEC

M/s. (Stakeholder's name)

Subject: NOTICE FOR INVOCATION OF THE CONCILIATION CLAUSE OF THE CONTRACT BY BHEL

Ref: Contract No/MoU/Agreement/LOI/LOA& date

- 1021			8-0001				 '	
Dear Si	r/Madan	1,						
As	you	are	aware,	with	reference	to	above	referred
Contrac	t/MoU/A	greeme	nt/LOI/LO	OA, certa	in disputes h	ave ari	sen, which	h, in-spite
of severa	al rounds	of muti	ıal discuss	ions and	various corres	sponde	ences have	remained
unresolv	red. The 1	orief par	ticulars of	our clain	ns which arise	out o	f the above	e- referred

Sl.	Claim description	Amount involved
No.		

Contract/MoU/Agreement/LOI/LOA are reproduced hereunder:

As you are aware, there is a provision in the captioned Contract/MoU/Agreement/LOI/ LOA for referring disputes to conciliation.

Please note that upon receipt of your consent in writing within 30 days of the date of receipt of this letter by you, BHEL shall appoint suitable person(s) from the BHEL Panel of Conciliators.

This letter is being issued without prejudice to our rights and contentions available under the contract and law.

Thanking you Yours faithfully

Representative of BHEL

Note: The Format may be suitably modified, as required, based on facts and circumstances of the case.

FORMAT FOR NOTICE INVOKING CONCILIATION CLAUSE BY A STAKEHOLDER FOR REFERRING THE DISPUTES TO CONCILIATION THROUGH IEC

To,

BHEL (Head of the Unit/Division/Region/Business Group)

Subject: NOTICE FOR INVOCATION OF THE CONCILIATION CLAUSE OF THE CONTRACT BY A STAKEHOLDER

Ref: Cont	tract No/MoU/Agreement/LOI/LOA& dat	te
	, , , , , , , , , , , , , , , , , , , ,	
Dear Sir	r/Madam,	

As you are aware, with reference to above referred Contract/MoU/Agreement/LOI/LOA, certain disputes have arisen, which, in-spite of several rounds of mutual discussions and various correspondences have remained unresolved. The brief particulars of our claims which have arisen out of the above-referred Contract/MoU/Agreement/LOI/LOA are enumerated hereunder:

Sl. No.	Claim description	Amount involved

As you are aware, there is a provision in the captioned Contract/MoU/Agreement/LOI/ LOA for referring inter-se disputes of the Parties to conciliation.

We wish to refer the above-said disputes to Conciliation as per the said Clause of the captioned Contract/MoU/Agreement/LOI/ LOA. In terms of Clause --------of Procedure i.e., Annexure ------ to the Contract/MoU /Agreement / LOI / LOA, we hereby invite BHEL to provide its consent in writing to proceed with conciliation into the above mentioned disputes within a period of 30 days from the date of this letter along with details of counter-claims, if any, which it might have with regard to the subject Contract/ MoU/ Agreement/ LOI/ LOA and to appoint suitable person(s) as Conciliator(s) from the BHEL Panel of Conciliators.

This letter is being issued without prejudice to our rights and contentions available under the contract and law.

Thanking you Yours faithfully

Representative of the Stakeholder

Note: The Format may be suitably modified, as required, based on facts and circumstances of the case.

FORMAT FOR INTIMATION TO THE STAKEHOLDER ABOUT APPOINTMENT OF CONCILIATOR/IEC

Το,			
	M/s.	(Stakeholder's name)

Subject: INTIMATION BY BHEL TO THE STAKEHOLDER AND CONCILIATOR(S) ABOUT APPOINTMENT OF CONCILIATOR/IEC

Ref: Contract No/MoU/Agreement/LOI/LOA& date
Sir,
This is with reference to letter dated regarding reference of the disputes arising in connection with the subject Contract No /MoU/Agreement/LOI/LOA to conciliation and appointment of Conciliator(s).
In pursuance of the said letter, the said disputes are assigned to conciliation and the following persons are nominated as Conciliator(s) for conciliating and assisting the Parties to amicably resolve the disputes in terms of the Arbitration & Conciliation Act, 1996 and the Procedure to the subject Contract/MoU/Agreement/LOI/LOA, if possible.
Name and contact details of Conciliator(s)
a)
b)
c)
You are requested to submit the Statement of Claims or Counter-Claims (strike off

You are requested to submit the Statement of Claims or Counter-Claims (strike off whichever is inapplicable) before the Conciliator(s) in Format 5 (enclosed herewith) as per the time limit as prescribed by the Conciliator(s).

Yours faithfully,

Representative of BHEL

CC: To Conciliator(s)... for Kind Information please.

Encl: As above

Note: The Format may be suitably modified, as required, based on facts and circumstances of the case.