




VOLUME – IA Part I & II

TECHNICAL CONDITIONS OF CONTRACT (TCC)

BHARAT HEAVY ELECTRICALS LIMITED

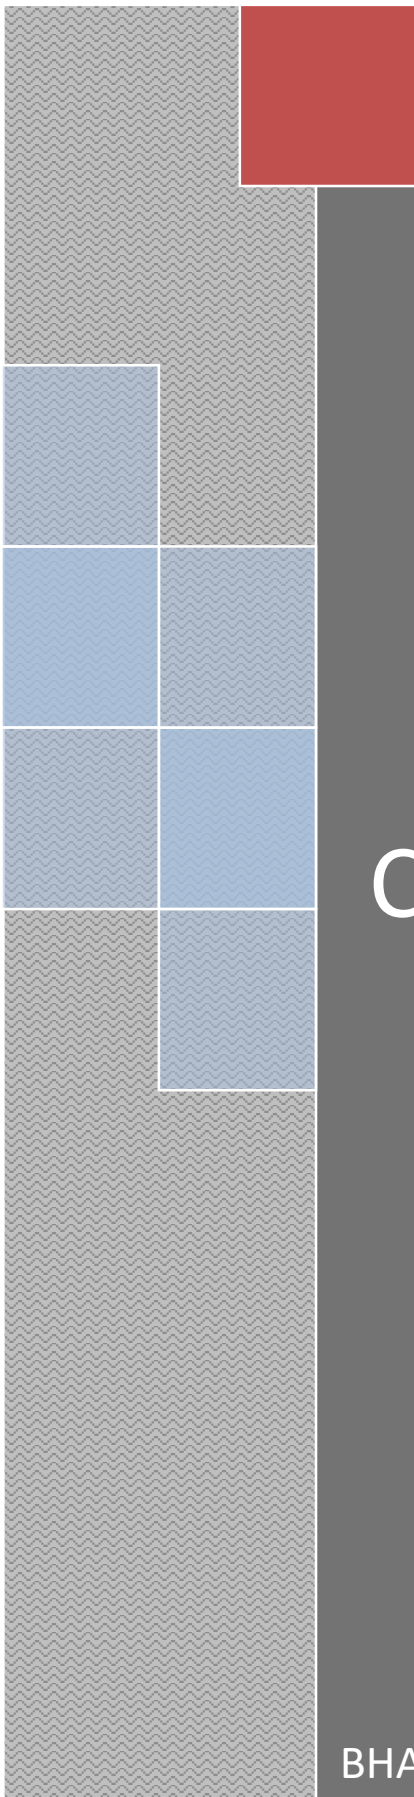

TECHNICAL CONDITIONS OF CONTRACT (TCC)

CONTENTS

Sl no	DESCRIPTION	Chapter	No. of Pages
Vol I A	Part-I: Contract specific details		
1	Project Information	Chapter-I	2
2	Scope of works	Chapter-II	3
3	Facilities in Scope of Contractor / BHEL (Scope Matrix)	Chapter-III	9
4	T&Ps and MMEs to be deployed by Contractor	Chapter-IV	4
5	T&Ps and MMEs to be deployed by BHEL	Chapter-V	2
6	Time Schedule	Chapter-VI	5
7	Terms of Payment	Chapter-VII	2
8	Taxes and Duties	Chapter-VIII	2
9	Bill of Quantity	Chapter-IX	1
10	General	Chapter-X	10
11	Progress of work	Chapter-XI	3
12	Material Handling	Chapter-XII	2
13	Accounting of materials	Chapter-XIII	1
Vol IA	Part-II: Technical specifications		
1	Corrections / Revisions in General Conditions of Contract and Forms & Procedures	Chapter-1	4
2	T&P Hire Charges	Chapter-2	12
3	“HSE Plan for Site Operations by Subcontractor” (Document No. HSEP: 14 Rev02)	Chapter-3	131
2	Technical Specifications & drawings	Chapter-4	109

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER – I

PROJECT INFORMATION

INTRODUCTION

ENNORE SEZ SUPERCRITICAL TPS UNITS- 1 & 2 [2 x 660 MW] is being set up by **TAMILNADU GENERATION AND DISTRIBUTION CORPORATION** at a site in Vayalur Village Near Ennore Port, Tamilnadu, India. Plant will be set up in existing Ash Dyke of NCTPS by reclamation of some portion of the Ash Dyke. The Bidder shall acquaint himself by a visit to the site, if felt necessary, with the conditions prevailing at site before submission of the bid. The information given here in under is for general guidance and shall not be contractually binding on BHEL/Owner. All relevant site data /information as may be necessary shall have to be obtained /collected by the Bidder.

APPROACH TO SITE

The proposed plant will be located at Ash dyke of North Chennai Thermal Power, approximately 35 km from Chennai, in the state of Tamilnadu, India. The site is occupying a coastal site near the village of Vayalur. The nearest commercial airport is at Chennai located at a distance of 60 km from the project site.

Nearest Airport – Chennai

Nearest Airstrip – Chennai

Nearest Seaport – Ennore

A. Project Information & Location

Project Title: Ennore SEZ project of 2 x 660 MW Coal Based Super Critical Thermal Power Project at ash dyke of NCTPS

Plant Capacity: 1320 MW (2 units of 660 MW each)

Type of Project: Green field

Owner: Tamil Nadu Generation and Distribution Corporation Limited (TANGEDCO)

Plant site location: Ash dyke of North Chennai Thermal Power Station (NCTPS)

Location co-ordinates: 80o 18' E to 80o 19' E Longitude

TECHNICAL CONDITIONS OF CONTRACT (TCC)

13o 17' N to 13o 18' N Latitude

Nearest Village: Vayalur

Nearest Town & City: Chennai (35 Km)

State Capital: Chennai (35 Km)

Nearest Railway Station: Athipattu Pudunagar (~5 Km)

Nearest Airport: Chennai (~60 Km)

Nearest Seaport: Ennore (~5 Km)

Nearest Road access: All weather road from Pattamandri on the Thiruvottiur – Ponneri district highway.

B. Meteorological Condition

Owner: Tamil Nadu Generation and Distribution Corporation Limited (TANGEDCO)

Owner Consultant: DESEIN, DELHI,

Site Elevation: (+) 10.0 m above Mean Sea Level

Ambient Temperature: a. Maximum 32.0 Deg. C

b. Minimum 24 Deg. C

c. Design ambient temperature 35 Deg. C

Relative Humidity: a. Maximum 100%

b. Minimum 36%

c. Design 75%

Annual Rainfall: a. Maximum 2540 mm

b. Average 1600 mm

c. Minimum 1175 mm

Wind Data: a. Basic wind speed at 10m height: 50 m/sec

b. Wind pressure As per IS: 875 Part III-1984

Seismic Zone: Zone III as per IS: 1893-2002

Design ambient temperature: 50 Deg. C (For electrical Equipments)

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER – II

SCOPE OF WORKS

1.2.1 The scope of works covers mainly Balance Fabrication, Erection, alignment including blast cleaning and Painting and other allied works of Power house building Unit # 2, Common Control room, Mill bunker building etc. at Ennore SEZ (2 x 660 MW) STPP, as mentioned below, including supply of all materials (excluding Structural steel and other bought out construction materials as mentioned in the BOQ), labour, tools and plants and hand over the structures to TANGEDCO in all respect as per BOQ, Specifications and drawings.

The list of structures and buildings for LEFT OUT Balance structural works is as mentioned below,

- i. Power House Building – Unit # 2
- ii. Common Control room
- iii. Mill Bunker building
- iv. Structural works in other miscellaneous system requirements

Note:

- Work also involves joining to parts of columns, fixing of brackets and gussets, plates, left out welding, left out drilling, completion of balance welding, fixing of SS Liner in bunker shell, fixing of stools at tripper floor, making of poking holes in shell, fabrication of handmade gratings for bunker, fabrication & erection of catwalk structure in control room etc.
- The above provided list is indicative only for the bidder's guideline. **Any other work not mentioned above, but required for completion of the package in total, deemed to have been included in the bidder's scope under this contract.** Such work will be executed under this contract by bidder as per the direction of Engineer in charge. If any item of work not

TECHNICAL CONDITIONS OF CONTRACT (TCC)

available in the rate schedule of this contract, the rate will be fixed in line with clause 2.15.7 of GCC.

- 1.2.2 **Structural steel for structural works and other bought out materials such as electro forged gratings, SS liner, GI pipe for handrail shall be provided by BHEL free of cost.**
- 1.2.3 The works to be performed under this contract, consist of providing all labour, supervision, material, scaffolding, construction equipment's, tools and plants, temporary works, supplies including POL (Petroleum, oil & lubricants), transportation and all incidental items not shown or specified but reasonably implied or necessary for the proper completion of work in all respects. Testing of all materials, preparation of fabrication drawings as required etc. are included in the rates of items of work. Works shall only be carried out with approved structural fabrication drawings.
- 1.2.4 The area of work shall be cleared of all vegetation, rubbish and other objectionable matter and materials removed shall be burnt or otherwise disposed of as directed by the Engineer-in-Charge. No separate payment for these operations shall be made. The cost of all these operations shall be deemed to have been included in the unit rates rendered for the different items under bill of quantities.
- 1.2.5 All the works areas shall be adequately flood lighted to the satisfaction of the Engineer-in-Charge when the work is in progress during the night shifts.
- 1.2.6 The unit rates shall include all material equipment, fixtures, labour construction plant, temporary works and everything whether of permanent or temporary nature necessary for the completion of job in all respects.
- 1.2.7 The unit rates for various items of B.O.Q shall include all the stipulations mentioned in technical specifications and nothing extra over B.O.Q rates shall be payable.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 1.2.8 Drawings showing enough details for the construction as per the specification shall be furnished to the contractor in a phased manner. Preparation of detailed fabrication drawing as required is in the scope of contractor.
- 1.2.9 The bidder should fully apprise himself of the prevailing conditions at the proposed site, climatic conditions including monsoon pattern, local conditions, soil strata and site specific parameters and shall include for all such conditions and contingent measures in the bid, including those which may have not been specifically brought out in the specifications.
- 1.2.10 Bidder shall visit site for better clarification against present status of structural works in the area of works as mentioned under the scope and assessment of pending works. The work covered under scope shall be taken up on AS IS WHERE IS basis, as applicable in site as per the instructions of BHEL Engineer in charge.
- 1.2.11 Special arrangements to be made for tackling COVID-19 pandemic –
- 1.2.11.1 Government order (state/ center) being issued time to time for protective measures of COVID-19 pandemic shall be complied with strictly until government (state/ center) declares end of pandemic.
- 1.2.11.2 Contractor shall make arrangements for implementation of STANDARD OPERATING PROTOCOL (SOP) as per government order. Any person violating the COVID -19 measures published vide government order time to time will be liable to be proceeded for legal action as per the government order.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER – III

FACILITIES & CONSUMABLES IN THE SCOPE OF CONTRACTOR / BHEL (SCOPE MATRIX)

1.3.1 PART I

Sl.No	Description	Scope to be taken care by		Remarks
		BHEL	Bidder	
1.3.1.1	ESTABLISHMENT			
1.3.1.1.1	FOR CONSTRUCTION PURPOSE:			
1.3.1.1.1.1	Open space for office	Yes		As provided by TANGEDCO
1.3.1.1.1.2	Open space for storage	Yes		
1.3.1.1.1.3	Construction of bidder's office, canteen and storage building including supply of materials and other services		Yes	At Bidder's Own Cost
1.3.1.1.1.4	Bidder's all office equipments, office / store / canteen consumables		Yes	
1.3.1.1.1.5	Canteen facilities for the bidder's staff, supervisors and engineers etc.		Yes	
1.3.1.1.1.6	Firefighting equipments like buckets, extinguishers etc.		Yes	
1.3.1.1.1.7	Fencing of storage area, office, canteen, labour hutment, etc. of the bidder,		Yes	
1.3.1.1.2	FOR LIVING PURPOSES OF THE BIDDER			
1.3.1.1.2.1	Open space		Yes	At Bidder's Own Cost
1.3.1.1.2.2	Living accommodation		Yes	
1.3.1.2.0	ELECTRICITY			
1.3.1.2.1	Electricity for construction purposes (to be specified whether chargeable or free)	YES		Chargeable to bidder as provided by TANGEDCO

TECHNICAL CONDITIONS OF CONTRACT (TCC)

Sl.No	Description	Scope to be taken care by		Remarks
		BHEL	Bidder	
	PART I			
1.3.1.2.1.1	Single point source (In general) For detail, refer clause no. 1.3.4.1	Yes		On chargeable basis to bidder as per Prevailing rate of TANGEDCO
1.3.1.2.1.2	Further distribution for the work to be done which include supply of materials and execution		Yes	At Bidder's Own Cost
1.3.1.2.2	Electricity for the office, stores, canteen etc. of the bidder which include:		Yes	
1.3.1.2.2.1	Distribution from single point including supply of materials and service		Yes	
1.3.1.2.2.2	Supply, installation and connection of material of energy meter including operation and maintenance		Yes	
1.3.1.2.2.3	Duties and deposits including statutory clearances for the above		Yes	
1.3.1.2.2.4	Living facilities for office use including charges		Yes	
1.3.1.2.2.5	Demobilization of the facilities after completion of works		Yes	
1.3.1.2.3	Electricity for living accommodation of the bidder's staff, engineers, supervisors, labour hutment etc. on the above lines		Yes	
1.3.1.3.0	WATER SUPPLY			
1.3.1.3.1	For construction purposes:	Yes		Chargeable to bidder as per prevailing rate of TANGEDCO
1.3.1.3.1.1	Making the water available at single point	Yes		Chargeable to bidder as per prevailing rate of TANGEDCO

TECHNICAL CONDITIONS OF CONTRACT (TCC)

Sl.No	Description	Scope to be taken care by		Remarks
		BHEL	Bidder	
	PART I			
1.3.1.3.1.2	Further distribution as per the requirement of work including supply of materials and execution		Yes	At Bidder's Own Cost
1.3.1.3.2	Water supply for bidder's office, stores, canteen etc.		Yes	
1.3.1.4.0	LIGHTING			
1.3.1.4.1	For construction work (supply of all the necessary materials) i. At office storage area ii. At the preassembly area iii. At the construction site / area		Yes	At Bidder's Own Cost
1.3.1.4.2	For construction work (Execution of the lighting work / arrangements) i. At office storage area ii. At the preassembly area iii. At the construction site /area		Yes	
1.3.1.5.0	COMMUNICATION FACILITIES for site operations of the bidder			
1.3.1.5.1	Telephone, Fax, internet, intranet, email etc.		Yes	At Bidder's Own Cost

1.3.2 PART II

Sl. No.	Description	Scope to be taken care by		Remarks
		BHEL	Bidder	
	PART II			
	CONSTRUCTION FACILITIES			
1.3.2.1	Engineering works for construction			
1.3.2.1.1	Providing the construction drawings for all the equipment's covered under this scope	Yes		
1.3.2.1.2	Drawings for construction methods		Yes	In consultation with BHEL

TECHNICAL CONDITIONS OF CONTRACT (TCC)

Sl. No.	Description	Scope to be taken care by		Remarks
		BHEL	Bidder	
	PART II			
1.3.2.1.3	As-built drawings – wherever deviations observed and executed and also based on the decisions taken at site- example – routing of small bore pipes	Yes	Yes	In consultation with BHEL
1.3.2.1.4	Shipping lists etc. for reference and planning the activities	Yes	Yes	In consultation with BHEL
1.3.2.1.5	Preparation of site construction schedules and other input requirements		Yes	In consultation with BHEL
1.3.2.1.6	Review of performance and revision of site construction schedules in order to achieve the end dates and other commitments		Yes	
1.3.2.1.7	Weekly construction schedules based on SI No 1.3.2.1.5		Yes	
1.3.2.1.8	Daily construction / work plan based on SI No 1.3.2.1.7		Yes	For daily monitoring meeting at site
1.3.2.1.9	Periodic visit of the senior official of the bidder to site to review the progress so that works are completed as per schedule. It is suggested this review by the senior official of the bidder should be done once in every two months.		Yes	

1.3.3 OPEN SPACE:

1.3.3.1 Open space will be provided to the bidder free of cost as provided by TANGEDCO.

Availability of land within plant boundary is very limited and the contractor has to plan and use the existing land considering the use of land by other Civil /mechanical/ electrical contractors and the storage of plant machineries and materials. The existing land shall be shared by all erections agencies. Land will be allocated with certain time frame and to the extent available/ considered necessary, and will be reviewed by BHEL depending upon the area availability. Area within

TECHNICAL CONDITIONS OF CONTRACT (TCC)

plant premises for batching plant, fabrication yard, office, storage area etc. for construction purpose shall be provided as per availability free of cost. The contractor will be responsible for handing back all lands, as handed over to him by BHEL.

1.3.3.2 Contractor has to make his own arrangements for labour colony at their own cost.

The contractor to construct labour colony/ hutment as per his requirements after obtaining approval of formalities from statutory body. The contractor shall provide adequate water arrangement for drinking/washing/bathing with required toilets, drainage system, lighting facilities etc. in labour colony at their own cost. Suitable paved area to be provided in the labour colony at their own cost.

1.3.4 **ELECTRICITY:**

1.3.4.1 In general, Construction power will be provided to the contractor on prevailing rates of TANGEDCO on **chargeable basis** at one single point WITHIN THE PLANT AREA by BHEL. Bidder to make his own arrangement for further distribution to their work area or make suitable arrangement for alternative source of power supply through deployment of adequate number of DG sets.

1.3.4.2 The contractor to provide necessary energy meter for measuring the power consumption. The contractor shall make his own arrangement for further distribution with necessary isolator/LCB etc. However, based on request of Contractor and requirement of project, BHEL Site in charge, at his discretion, may provide construction power at multiple point (as close to work area as possible), for smooth execution of the work at site. If, BHEL provides electricity at more than one point (as close to work area as possible), it will be responsibility of the contractor to provide all the support necessary for enabling BHEL for extending such provision to contractor. However, the Construction power provided to the contractor shall be on chargeable basis at prevailing rates of TANGEDCO. The contractor has to provide necessary meter for measuring the power consumption. The contractor shall make

TECHNICAL CONDITIONS OF CONTRACT (TCC)

his own arrangement for further distribution with necessary isolator/ LCB etc. Any dispute, BHEL engineer's decision shall be final and binding on contractor.

Construction power prevailing charges are as below,

The present LT tariff VI rate of TANGEDCO is

- a) Consumption charges at Rs.12.00 per unit
- b) Maximum demand (MD) charges as applicable per month
- c) Low Power Factor (LPF) charges
- d) Electricity Tax on total amount
- e) Any other miscellaneous charges charged by M/s TANGEDCO pertaining to construction power supply.

Note - The TANGEDCO tariff and tax may vary from time to time and the same is applicable for the bidder.

1.3.4.3 Necessary "Capacitor Banks" to improve the Power factor to a minimum of 0.9 shall be provided by the contractor at his cost. Penalty if any levied by customer on this account will be recovered from contractor's bills.

1.3.4.4 Any duty, deposit involved in getting the Electricity shall be borne by the bidder. As regards contractor's office shed also all such expenditure shall be borne by the contractor.

1.3.4.5 Provision for distribution of electrical power from the given single central common point to the required places with proper distribution boards, approved cables and cable laying including supply of all materials like cables, switch boards, pipes etc., observing the safety rules laid down by electrical authority of the State / BHEL / their customer with appropriate statutory requirements shall be the responsibility of the tenderer / contractor.

1.3.4.6 BHEL is not responsible for any loss or damage to the contractor's equipment as a result of variations in voltage / frequency or interruptions in power supply.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.3.4.7 Contractor has to make their own arrangements for electricity requirement for labour colony at his own cost.

1.3.4.8 As there are bound to be interruptions in regular power supply, power cut/ load shedding in any construction sites, contractor should make his own arrangement for alternative source of power supply through deployment of adequate number of DG sets at their cost during the power breakdown / failure to get urgent and important work to go on without interruptions. No separate payment shall be made for this contingency.

1.3.5 **WATER:**

1.3.5.1 Water (Raw water) required for construction purposes will be provided at one single point WITHIN THE PLANT AREA on chargeable basis to contractor at the prevailing rates of TANGEDCO. The contractor to Provide necessary meter for measuring the water consumption. The required pumps & accessories, pipes for drawing water from the given point and further distribution will be arranged by the contractor at their cost to go on without interruptions.

1.3.5.2 Successful Bidder to make his own arrangements for drinking water / water for sanitation for their labourer & staff at bidders cost.

1.3.5.3 The water charges may vary from time to time as per TANGEDCO/ Metro conditions. However, the prevailing water charge is Rs 191.00 per Kilo litres and may be liable to changes. Any dispute regarding consumption, the BHEL engineer decision will be final. The TANGEDCO tariff and tax may vary from time to time and the same is applicable for the successful bidder.

1.3.5.4 In case non-availability of water or the TANGEDCO is not able to supply the water, the contractor shall make his own arrangements of water suitable for construction purpose to have uninterrupted work. No separate payment shall be made for any contingency arrangement made by contractor, due to delay / failure for providing water supply. Contractor has to make his own arrangements for their water requirement for their labour colony at their own cost.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.3.6 MATERIAL SUPPLY:

- Supply / providing all materials required (except free supply materials i.e. structural steel and bought out construction materials as mentioned in the BOQ) for the work are in the scope of the contractor. BHEL shall provide structural steel for fabrication works only for incorporation in the permanent work AS FREE SUPPLY.
- The steel material will be issued from BHEL stores, within the plant premises. Collection and transporting to the place of work is in contractor's scope without any extra cost to BHEL. The steel will be issued to the agency in standard lengths.
- If any matching sections of steel are not available with BHEL, contractor may arrange these sections from Customer approved agencies only on certification of BHEL and the same shall be paid against relevant BOQ item in the price bid.

1.3.7 CONSUMABLE

All consumables, like gas, electrodes, chemicals, lubricants etc. required for the scope of work, shall be arranged by the contractor at his cost unless otherwise specifically mentioned in the contract. Prior approval from Engineer In-Charge shall be obtained for all the consumable to be used in permanent work. In the event of failure of contractor to bring necessary and sufficient consumables, BHEL may arrange for the same at the risk and cost of the contractor. The entire cost towards this along-with overhead shall be paid by the contractor or deducted from the contractor's bills.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.3.8 LIGHTING FACILITY:

Adequate lighting facilities such as flood lamps, hand lamps and area lighting shall be arranged by the contractor at the site of construction, and contractor's material storage area etc. at his cost.

1.3.9 CONTRACTOR'S OBLIGATION ON COMPLETION:

On completion of work, all the temporary buildings, structures, pipe lines, cables etc. shall be dismantled and leveled and debris shall be removed as per instructions of BHEL by the contractor at his cost. In the event of his failure to do so, same shall be carried out by BHEL and the expenditure towards clearance of the same will be recovered from the contractor. The decision of BHEL Engineer in this regard is final.

1.3.10 DEWATERING

Contractor shall ensure at all times that his work area & approach/ access roads are free from accumulation of water, so that the materials are safe and the erection/ progress schedule are not affected. No separate claim in this regard shall be admitted by BHEL. No separate payments for dewatering of subsoil, surface water or catchments water, if required, at any time during execution of the work including monsoon period shall be considered by BHEL.

1.3.11 BID DRAWINGS

Bid drawings like plot plan/ Layout plan enclosed along with this tender is only for information is enclosed for information and may not be referred for scope of works and this may also get revised during execution.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER – IV

T&Ps TO BE DEPLOYED BY CONTRACTOR

- 1.4.1 All the tools and plants required for satisfactory completion of the work have to be arranged by the contractor.
- 1.4.2 The contractor is required to arrange the following tentative Major T&Ps and other T&Ps for the satisfactory completion of the work

Sl. No.	Major T&P	Mobilizing time from the date of commencement of work
1.	1 Nos. 150 T capacity crawler crane for erection.	As per BHEL requirement at site.
2.	1 Nos. 75 T capacity crawler crane for Fabrication (or) 1 No 40 T Capacity gantry crane with 150m length rails for movement	As per BHEL requirement at site.
	Other T&Ps	Mobilizing time from the date of commencement of work at site
3.	4 nos. pick & carry cranes (10/ 12 T cap)	As per BHEL requirement at site.
4.	2 Nos. Radial drill machine	As per BHEL requirement at site.
5.	2 nos. magnetic base drill machine	As per BHEL requirement at site.
6.	1 no. Plasma Cutting machine	As per BHEL requirement at site.
7.	2 nos. SS Welding rectifier	As per BHEL requirement at site.
8.	1 no. Plate bending machine	As per BHEL requirement at site.
9.	10 nos. MIG machine	As per BHEL requirement at site.
10.	20 nos. welding rectifier	10 Nos. within 30 days, Balance as per BHEL requirement at site.
11.	2 no. trailor – 15T	As per BHEL requirement at site.
12.	2 no. power driven HSFG bolt tightening m/c	As per BHEL requirement at site.
13.	2 no. torque tightening m/c. (1 no. Capacity up to 30mm dia HSFG bolt tightening)	As per BHEL requirement at site.
14.	Sufficient quantity of steel ladders for approach up to the top of each erected column to be required during erection of columns.	As per BHEL requirement at site.
15.	Power winch – 3T - 4 nos. for structural erection	As per BHEL requirement at site.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

16.	Power winch – 5T - 2 nos. for structural erection	As per BHEL requirement at site.
17.	1 no ultra-sonography testing machine with recording device for structural work.	As per BHEL requirement at site.
18.	2 nos. Painting equipment sets complete with compressor, hopper, screen, blasting hose pipe, nozzle airless/conventional spray (within CGI temporary cover shed)	As per BHEL requirement at site.
19.	Mother oven- 2 nos. for fabrication and 2 nos. for erection	As per BHEL requirement at site.
20.	Portable oven- 25 nos. (10 nos. for fabrication and 15 nos. for erection)	As per BHEL requirement at site.
21.	2 nos. drinking water tank – 5000 lit.	1 nos. Within 30 days. Balance as per BHEL requirement at site.
22.	4 nos. mobile toilet for labour use.	2 no's within 30 days balance as per requirement at site
23.	2 nos. truck mounted 125 KVA DG set	1 no. within 30 days and balance as per requirement at site.
24.	Construction power cable	As per Requirement
25.	Construction water Pipeline	As per Requirement
26.	Portable fire extinguishers as below: Soda acid – 5 sets. Dry chemical powder – 5 sets CO2 – 5 sets. Water & sand bucket (4 buckets in one stand) – 5 sets. Fire hose with nozzle (50 M length) – 3 sets.	25% within 30 days and balance progressively within 60 days.

Note:

1. T&P shown in the above mentioned list is tentative requirement considering parallel working in all areas mentioned in scope of work. However, mobilization schedule & quantity/ numbers as mutually agreed at site for major T&Ps, have to be adhered to. Numbers/ time of requirement will be reviewed time to time at site and contractor will provide required T&P/ equipment's to ensure completion of entire work within schedule/target date of completion without any additional financial implication to BHEL. Vendor will give advance intimation & certification regarding capacity etc. prior to dispatch of heavy equipment's. Also on completion of the respective activity, demobilization of T&P in total or in part can be done with the due approval of engineer in charge. Retaining of the T&P's during the contract period will be mutually agreed in line with construction requirement.

2. All T&P and all IMTEs, which are required for successful and timely execution of the work covered within the scope of this tender, shall be arranged and provided by the contractor at his own cost in working condition.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

3. In the event of non-mobilisation of Tools, Plants, Machinery, Equipment, Material or non-availability of the same owing to breakdown and as a result progress of work suffered, BHEL reserves the right to make alternative arrangement (available or higher capacity) in line with SCC clause no. 4.2.1. 7 and hire charges shall be applicable as under:

A: BHEL provides its own Capital T&P: If BHEL provides owned T&P then BHEL, hire charges (as per BHEL norms) will be recovered from the contractor as per the prevailing BHEL Corporate hire charges applicable (as enclosed in Volume I Book I TCC- Volume 1A Part II) as per following cases:

- In case the T&P is specifically listed in “T&Ps to be deployed by Contractor”, ‘Rates of hire charges applicable to outside agencies other than contractors working for BHEL’ will apply.
- In case the T&P is not specifically listed in “T&Ps to be deployed by Contractor”, ‘Rates of hire charges applicable to contractors working for BHEL’ will apply.

The hire charges of Capital Tools & Plants are exclusive of operating expenses e.g., Operator, fuel & Consumables and the same shall be arranged by the contractor at his cost.

B: BHEL provides hired T&P: In all cases other than that specified in “A” above, actual expenses incurred by BHEL along with applicable overheads will be back-charged to the contractor.

4. In the event of need of change of type of any of major T&Ps, approval shall be taken from BHEL Engineer in-charge prior to mobilization. The decision of Number of T&P required due to replacing the enlisted T&P as per above table, shall be taken after analyzing the production capacity and suitability of both the T&Ps.

5. Clause no. 1.6.1 of this specification (i.e. TCC) shall be referred for date of start of work.

1.4.3 In addition to the above, any other tools and plants required for execution of the above work are in contractor’s scope.

1.4.4. Contractor shall have at all times experienced operators and technicians for routine and breakdown maintenance of the equipment. Any delay in rectification of defects will warrant BHEL rectifying the defect and charging the cost to the contractor.

1.4.6. **In construction projects of this magnitude it is possible that all the areas/ approaches may not be ready. In such cases consolidation of ground and arrangement of sleepers / sand bag filling, construction of Temporary approach road for all their working area etc. for safe operation / movement of**

TECHNICAL CONDITIONS OF CONTRACT (TCC)

equipment including cranes / trailers etc. shall be the responsibility of the contractor at his cost. No compensation on this account shall be payable.

- 1.4.7 In case the contractor fails to provide any T&P which is in the scope of contractor and if BHEL provides such T&P available with BHEL, hire charges prevailing (as per BHEL norms) as on that day will be recovered from the contractor as per the prevailing BHEL Corporate Crane hire charges (may vary from time to time). Corresponding pages of Corporate Crane hire charges are enclosed in relevant chapter of part II of Technical Conditions of Contract (Volume-I Book-I). This may get revised further as per the BHEL corporate guidelines. However, prevailing rates as on date of execution may be applicable. Crane operators deployed by the contractor shall be tested by BHEL before they are allowed to operate the cranes.
- 1.4.8 The age of the contractor deployed cranes upto 150 T should be within 15 years as on date of deployment. Contractor has to provide documentary proof for the age of the crane at the time of deployment to the BHEL Engineer.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER – V

T&Ps PROVIDED BY BHEL

- 1.5.1 BHEL will provide suitable higher capacity cranes above 150T capacity to the contractors as per the requirement at the discretion of BHEL on free of hire charges on shareable basis. The cranes of 150MT and below 150MT is in the scope of bidder.
- 1.5.2 Besides the T & P mentioned above, which is being made available to the contractor on free of hire charges, any additional crane and other T & P which may be required for successful and timely execution of the work covered within the scope of this tender shall be arranged and provided at site by the contractor at his cost. In case if the contractor fails to provide such equipment's, BHEL will arrange for the same and the cost will be recovered from the contractor's bill with BHEL overheads, as applicable from time to time which may vary even during contract period.
- 1.5.3 BHEL's Crane is only for erection purpose and shall not be available for material handling or transportation purpose. Contractor shall make their own arrangements for material transportation to erection site.
- 1.5.4 BHEL may provide either BHEL owned cranes or hired cranes at the discretion of BHEL. Operator for the BHEL supplied cranes will be provided by BHEL on free of charges.
- 1.5.4.1 Bidder to note the following:-
- a. In the event of providing BHEL own Cranes:
 - a.1: Fuel has to be arranged by the contractor at his cost.
 - b. In the event of providing BHEL hired cranes:
 - b.1: Fuel has to be arranged by the contractor at his cost.
- 1.5.4.2 For all BHEL's crane, BHEL shall provide crane operators free of charges, all consumables for BHEL crane maintenance shall be provided by the contractor within the quoted rates.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.5.4.3 Tentative List of consumables required to be provided by contractor is as below:

- i. Engine Oil 15 W 40
- ii. Fuel Filters
- iii. Air Filters
- iv. Hydraulic Filters
- v. Hydraulic Oil –Servo 68
- vi. Gear Oil- Servo 90
- vii. Engine oil Filter
- viii. Oil Separator Filter
- ix. Rope- CRG 100 Grease
- x. Grease- Servo Multi-Purpose Grease

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER-VI

TIME SCHEDULE

- 1.6.1 The date of commencement of work at site shall be mutually agreed between bidder and BHEL site in-charge.
- 1.6.2 The entire scope of work for as detailed in the Tender Specification shall be completed within **10 (Ten) Months** from the date of commencement of work with intermediate milestones as mentioned in clause no. 1.6.8.2
- 1.6.3 During the total period of contract, the contractor has to carry out the activities in a phased manner as required by BHEL and the program of milestone events.
- 1.6.4 The contractor is required to refer Form 15 in Volume 1- BOOK 2 for all the instructions to be taken immediately after receipt of LOI.

1.6.5 MOBILISATION

- 1.6.5.1 The Contractor has to subsequently augment his resources in a prudent manner to achieve the COMPLETION SCHEDULES:
- 1.6.5.2 The above time allowed for completion of work including Sundays and Holidays is from the date of commencement of work. Detailed program to be prepared by the successful bidder taking in to consideration of the COMPLETION SCHEDULES /site decision on drawings flow (latest) and submitted for BHEL's approval.
- 1.6.5.3 In order to meet above schedule in general, and any other intermediate targets set, to meet customer / project schedule requirements, contractor shall arrange & augment all necessary resources from time to time on the instructions of BHEL.
- 1.6.5.4 In case the project is to be advanced, the civil works in the scope of the contractor is to be advanced to meet the project requirement. No extra payment whatsoever shall be paid on this account.

1.6.6 SUBMISSION OF L3 SCHEDULE

The contractor shall submit a detailed area/structure wise L3 schedule within 15 days from date of issue of LOI, in consultation with BHEL based on the tentative

TECHNICAL CONDITIONS OF CONTRACT (TCC)

schedule provided as per the clause 1.6.8. The detailed L3 schedule shall be approved by BHEL and same shall be implemented. Bidder shall submit L3 schedule in MS Projects (or any suitable format as agreed between contractor and BHEL engineer in-charge) to meet the agreed project schedule covering various mile stone activities and their split up details such as construction, procurement of materials, fabrication & erection activities, etc. This schedule shall also clearly indicate the interface facilities/inputs to be provided by BHEL/Customer and the dates by which such facilities/inputs are required. The schedule shall be acceptable to BHEL for meeting their mile stone targets/schedule.

1.6.7 GUARANTEE PERIOD FOR THE PACKAGE

Guarantee period of 12 months shall commence from the date of completion of the whole work certified by the BHEL Engineer.

1.6.8 STRUCTURAL WORKS SCHEDULE

1.6.8.1 Tentative time schedule for the scope of works is as mentioned below

Sl.No	Area	Completion from Date of commencement of work
1.	Power house building Unit-2 Crane Girder for EOT Erection from Grid 12a to 23	2 nd Month
2.	Readiness of HT/LT Switchgear Unit#2 at EL+3.5 M and 12 m	3 rd Month
3.	Readiness of Bunker Gallery Supporting Beam SB1/SB1X	3 rd Month
4.	Readiness of Oil Canal	4 th Month
5.	Readiness of Bunker Tripper Floor with stools	5 th Month
6.	Bunker erection completion with cladding support, poking platform etc.	9 th Month
7.	Material Reconciliation & Final bill submission	10 th Month

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.6.8.2 INTERMEDIATE MILESTONES

Intermediate milestones are as below.

S No	Description	Completion month from the contractual date of start of the work	Intermediate Milestone
1	Readiness of HT/LT Switchgear Unit#2 at EL+3.5 M and 12 m	3rd Month	M1
2	Readiness of Bunker Tripper Floor with stools	5 th Month	M2

1.6.8.3 Penalty for Intermediate Milestones

1.6.8.3.1 M1 and M2 shall be intermediate Milestones for this work.

1.6.8.3.2 In case of slippage of these identified Intermediate Milestones, Delay Analysis shall be carried out on achievement of each of these two Intermediate Milestones in reference to Form 14.

1.6.8.3.3 Incase delay in achieving M1 milestone is solely attributable to the contractor, 0.5% per week of executable contract value* limited to Maximum 2% of executable contract value will be withheld.

1.6.8.3.4 Incase delay in achieving M2 milestone is solely attributable to the contractor, 0.5% per week of executable contract value* limited to maximum 3% of executable contract value will be withheld.

1.6.8.3.5 Amount already withheld, if any, against slippage of M1 milestone, shall be released only if there is no delay attributable to contractor in achievement of M2 milestone.

1.6.8.3.6 Amount required to be withheld on account of slippage of identified intermediate milestone(s) shall be withheld out of respective milestone payment and balance amount (if any) shall be withheld @10% of RA Bill amount from subsequent RA bills.

1.6.8.3.7 Final deduction towards LD (if applicable), on account of delay attributable to contractor shall be based on final delay analysis on completion / closure

TECHNICAL CONDITIONS OF CONTRACT (TCC)

of contract. Withheld amount, if any due to slippage of intermediate milestones shall be adjusted against LD or released as the case may be.

1.6.8.3.8 In case of termination of contract due to any reason attributable to contractor before completion of work, the amount already withheld against slippage of intermediate milestones shall not be released and be converted in to recovery.

1.6.8.3.9 Note: *Executable contract value-value of work for which inputs/fronTS were made available to contractor and were scheduled for execution till the date of achievement of that milestone.

1.6.9 The above schedule is tentative. In case the project is to be advanced, works in the scope of the contractor is to be advanced to meet the project requirement. No extra payment whatsoever shall be paid on this account. The above schedule is for entire completion and handing over the structure/ Building to BHEL. Date of commencement of work shall be as mutually agreed at site between BHEL & contractor.

1.6.10 Structural floors etc., required for the mechanical equipment erection/ structural erection shall be handed over to BHEL progressively within the scheduled period given in the above table, as per the BHEL site requirement. Detailed area handing over plan shall be mutually discussed and agreed upon with BHEL site in-charge.

1.6.11 The left out minor finishing works shall also be completed and handed over to BHEL within the contract period.

1.6.12 The above time allowed for completion of work including Sundays and Holidays is from the date of commencement of work. Detailed program to be prepared by the bidder taking in to consideration of the COMPLETION SCHEDULES / site decision on drawings flow (latest) and submitted for BHEL's approval.

1.6.13 In order to meet the above schedule in general, and any other intermediate targets set, to meet customer/ project schedule requirements, Contractor shall

TECHNICAL CONDITIONS OF CONTRACT (TCC)

arrange & augment all necessary resources from time to time on the instructions of BHEL Engineer.

1.6.14 The bidder must submit a detail schedule (area wise) for completion of work to meet civil work schedule given in Clause 1.6.8.1 within 15 days from the date of issue of LOI.

1.6.15 The major activities as mentioned against the work schedule given in clause No. 1.6.8.1 are to be indicated in detailed schedule which shall be prepared by the bidder.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER-VII

TERMS OF PAYMENT

1.7.1 Secured Advance

Not applicable

1.7.2 Advance for Mobilization

1.7.2.1 Interest bearing advance for Mobilization, limited to 5% of the contract value will be paid against submission of bank guarantee of at least 110% of the advance valid for the contract period, which will be recovered from the first running bill onwards. The advance for mobilization shall be paid as under.

1.7.2.2 2% of contract value after receipt of initial Security Deposit as per relevant clauses in the GCC/TCC along with unqualified acceptance of detailed letter of intent.

1.7.2.3 1.5% of contract value on completion of site Mobilization of Machinery & T&P as given below and on certification by site in-charge for compliance provided clause no. 1.7.2.2 as mentioned above is also complied with.

1. 150 T capacity Crawler Crane - 1 nos.
2. Pick & carry cranes (10/ 12 T cap) – 2 nos.

1.7.2.4 1.5% of contract value on completion of site Mobilization of Machinery & T&P as given below in addition to the above, and on certification by site in-charge for compliance.

1. 75 T capacity Crawler Crane or 1 No 40 T Capacity gantry crane with 150m length rails - 1 nos.
2. Pick & carry cranes (10/ 12 T cap) – 2 nos.
3. Power winch – 5T capacity – 2 nos
4. Tractor – 15 T - 1 nos.

1.7.2.5 Payment of the advance as specified herein and recovery of the advance will be as per clause 2.13 of GCC. Option of availing the interest bearing mobilization advance is left with the bidder.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.7.3 Interim Payment

- 1.7.3.1 Interim bills in the form of monthly running bills prepared by the contractor in soft as well as hard copies shall be based on the quantities executed and measured.
- 1.7.3.2 95% item rate shall be released after completion of works certification by Engineer in charge.
- 1.7.3.3 5% of the item rate shall be released after submission of the quality check formats as per the quality plan for the quantum of work billed and duly certified by engineer.
- 1.7.3.4 Retention Amount shall be as per GCC.
- 1.7.3.5 BHEL Site Engineer, at his discretion, may operate the part rate of the items in line with GCC clause no. 2.23.1 (v). Payment for supply portion (subjected to approval of Engineer In-Charge) shall be made only after receipt of material at site.

1.7.4 METHOD OF MEASUREMENT

Mode of measurement shall be as per relevant IS 1200 in conjunction of IS code 3385. In case the same is also not available, the standard procedure adopted in CPWD shall be adopted. In case, the same is also not available in CPWD, the measurement of the work done will be based on the mutual agreement between BHEL and contractor. In all the above cases, the interpretation of BHEL will be final and binding to the contractor. Measurement guidelines as a ready reference is also available in the technical specification.

- 1.7.5 NO CLAIM WHAT SO EVER MAY BE, WILL BE ENTERTAINED UNDER THIS CONTRACT, AFTER DULY SIGNING THE FINAL BILL ALONG WITH MEASUREMENT BOOKS AND ACCEPTED BY BHEL.**

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME -IA PART-1 CHAPTER VIII

TAXES AND DUTIES

8.1 Goods and service Tax (GST) & Cess

- 8.1.1. The successful bidder shall furnish proof of GST registration with GSTN Portal in the State in which the Project is being executed, covering the services under this contract. Registration should also bear endorsement for the premises from where the billing shall be done by the successful bidder on BHEL for this project/ work.
- 8.1.2. Contractor's price/rates shall be exclusive of GST & Cess (if applicable) (herein after termed as GST). Contractor shall submit to BHEL the GST compliant tax invoice/debit note/revised tax invoice on the basis of which BHEL will claim the input tax credit in its return. Since this is a works contract, the applicable rate shall be @ 18% GST, as applicable presently.
- 8.1.3. Bidder shall note that the GST Tax Invoice complying with GST Invoice Rules wherein the 'Bill To' details will as below:
BHEL GSTN : 33AAACB4146P2ZL
NAME : BHARAT HEAVY ELECTRICALS LIMITED
ADDRESS : BHEL- PSSR SITE OFFICE, 2 X 660 MW ENNORE SEZ STPP, VAYALUR BR PO MINJUR PO, TAMILNADU - 601203
- 8.1.4. GST charged in the tax invoice/debit note/revised tax invoice by the contractor shall be released separately to the contractor only after contractor files the outward supply details in GSTR-1 on GSTN portal and input tax credit of such invoice is matched with corresponding details of outward supply of the contractor and has paid the GST at the time of filing the monthly return.
- 8.1.5. In case BHEL has to incur any liability (like interest / penalty etc.) due to denial/reversal / delay of input tax credit in respect of the invoice submitted by the contractor, for the reasons attributable to the contractor, the same shall be recovered from the contractor.
- 8.1.6. Further, in case BHEL is deprived of the Input tax credit due to any reason attributable to contractor, the same shall not be paid or Recovered if already paid to the contractor.
- 8.1.7. Tax invoice/debit Note/revised tax invoice shall contain all such particulars as prescribed in GST law and comply to the timelines for issue of the same. Invoices shall be submitted on time to the concerned BHEL Engineer In

TECHNICAL CONDITIONS OF CONTRACT (TCC)

Charge.

- 8.1.8. TDS under GST (if/ as & when applicable) shall be deducted at prevailing rates on gross invoice value from the running bills.
- 8.1.9. E-way bills / Transit passes / Road Permits, if required for materials / T&P etc., bought into the project site is to be arranged by the Contractor only.
- 8.1.10. BHEL shall not reimburse any amounts towards any interest / penalty etc., incurred by contractor. Any additional claim at a later date due to issues such as wrong rates / wrong classification by contractor shall not be paid by BHEL.

8.2 All taxes and duty other than GST & Cess

The contractor shall pay all (except the specific exclusion viz GST & Cess) taxes, fees, license charges, deposits, duties, tools, royalty, commissions, Stamp Duties, or other charges / levies, which may be levied on the input goods & services consumed and output goods & services delivered in course of his operations in executing the contract and the same shall not be reimbursed by BHEL. In case BHEL is forced to pay any of such taxes, BHEL shall have the right to recover the same from his bills or otherwise as deemed fit.

8.3 Statutory Variations

Statutory variations are applicable under the GST Acts, against production of proof. The changes implemented by the Central / State Government during the tenure of the contract viz. increase / decrease in the rate of taxes, applicability, etc. and its impact on upward revision / downward revision are to be suitably paid/ adjusted from the date of respective variation. The bidder shall give the benefit of downward revision in favor of BHEL. No other variations shall be allowed during the tenure of the contract.

8.4 New Taxes/Levies

In case Government imposes any new levy / tax after submission of bid during the tenure of the contract, BHEL shall reimburse the same at actual on submission of documentary proof of payment subject to the satisfaction of BHEL that such new levy / tax is applicable to this contract.

8.5 Direct Tax

BHEL shall not be liable towards Income Tax of whatever nature including variations thereof arising out of this contract as well as tax liability of the bidder and their personnel. Deduction of tax at source at the prevailing rates shall be effected by BHEL before release of payment as a statutory obligation, unless exemption certificate is produced by the bidder. TDS certificate will be issued by BHEL as per the provisions of Income Tax Act.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME 1A PART-1 CHAPTER IX **BILL OF QUANTITY**

1.9.1 As mentioned in the price bid.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME -IA PART-1 CHAPTER X

GENERAL

The scope of the work will comprise of but not limited to the following:

(All the works mentioned hereunder shall be carried out within the accepted rate unless otherwise specified.)

10.1 Successful Bidder is requested to furnish the following at PSSR-HQ Chennai immediately after release of Letter of Intent (LOI)

- i) Security Deposit
- ii) Unqualified Acceptance for LOI, Detailed LOI / Work Order.
- iii) Rs.100/- Stamp Paper for preparation of Contract Agreement.

10.2 Successful Bidder are requested to furnish the proof of documents for the following at the respective PSSR- Site

- i) PF Regn No.
- ii) Labour License No.
- iii) Workmen Insurance Policy No.

10.3 In addition to the clause 2.8 of General Conditions of Contract (Volume-1C of Book-II) the contractor shall comply with the following.

10.3.1 BOCW Act & BOCW Welfare Cess Act

10.3.1.2 The Contractor should Register their Establishment under BOCW Act 1996 read with rules 1998 by submitting Form I (Application for Registration of Establishment) and Form IV (Notice Of Commencement / Completion of Building other Construction Work) to the respective Labour Authorities i.e.,

- a) Assistant Labour Commissioner (Central) in respect of the project premises which is under the purview of Central Govt.-NTPC, NTPL etc.
- b) Appropriate State authorities in respect of the project premises which is under the purview of State Govt.

10.3.1.2 The Contractor should comply with the provisions of BOCW Welfare Cess Act 1996 in respect of the work awarded to them by BHEL.

10.3.1.3 The contractor should ensure compliance regarding Registration of Building Workers as Beneficiaries, Hours of work, welfare measures and other conditions of service with particular reference to Safety and Health measures like Safety Officers, safety committee, issue of Personal protective equipments, canteen, rest room, drinking water, Toilets, ambulance, first aid centre etc.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 10.3.1.4 The contractor irrespective of their nature of work and manpower (Civil, Mechanical, Electrical works etc) should register their establishment under BOCW Act 1996 and comply with BOCW Welfare Cess Act 1996.
- 10.3.1.5 Contractor shall make remittance of the BOCW cess as per the Act in consultation with BHEL as per the rates in force (presently 1%) BHEL shall reimburse the same upon production of documentary evidence. However, BHEL shall not reimburse the Fee paid towards the registration of establishment, fees paid towards registration of Beneficiaries and Contribution of Beneficiaries remitted.
- 10.3.1.6 Non-compliance to Provisions of the BOCW Act & BOCW Welfare Cess Act is not acceptable. In case of any non-compliance, BHEL reserves the right to withhold any sum as it deems fit. Only upon total compliance to the BOCW Act and also discharge of total payment of Cess under the BOCW Cess Act by the Contractor, BHEL shall consider refund of the Amounts

10.4 PROVIDENT FUND

- 10.4.1 The contractor is required to extend the benefit of Provident Fund to the labour employed by you in connection with this contract as per the Employees Provident Fund and Miscellaneous Provisions Act 1952. For due implementation of the same, you are hereby required to get yourself registered with the Provident Fund authorities for the purpose of reconciliation of PF dues and furnish to us the code number allotted to you by the Provident Fund authorities within one month from the date of issue of the letter of intent. In case you are exempted from such remittance an attested copy of authority for such exemption is to be furnished. Please note that in the event of your failure to comply with the provisions of said Act, if recoveries therefore are enforced from payments due to us by the customer or paid to statutory authorities by us, such amount will be recovered from payments due to you.
- 10.4.2 The final bill amount would be released only on production of clearance certificate from PF / ESI and labour authorities as applicable.

10.5 OTHER STATUTORY REQUIREMENTS

- 10.5.1 The Contractor shall submit a copy of Labour License obtained from the Licensing Officer (Form VI) u/r25 read with u/s 12 of Contract Labour (R&A) Act 1970 & rules and Valid WC Insurance copy or ESI Code (if applicable) and PF code no. along with the first running bill.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 10.5.2 The contractor shall submit monthly running bills along with the copies of monthly wages (of the preceding month) u/r78(1)(a)(1) of Contract Labour Rules, copies of monthly return of PF contribution with remittance Challans under Employees Provident Fund Act 1952 and copy of renewed WC Insurance policy or copies of monthly return of ESI contribution with Challans under ESI Act 1948 (if applicable) in respect of the workmen engaged by them.
- 10.5.3 The Contractor should ensure compliance of Sec 21 of Contract Labour (R&A) Act 1970 regarding responsibility for payment of Wages. In case of “Non-compliance of Sec 21 or non-payment of wages” to the workmen before the expiry of wage period by the contractor, BHEL will reserve its right to pay the workmen under the orders of Appropriate authority at the risk and cost of the Contractor.
- 10.5.4 The Contractor shall submit copies of Final Settlement statement of disbursement of retrenchment benefits on retrenchment of each workmen under ID Act 1948, copies of Form 6-A (Annual Return of PF Contribution) along with copies of PF Contribution Card of each member under PF Act and copies of monthly return on ESI Contribution – Form 6 under ESI Act 1948 (if applicable) to BHEL along with the Final Bill.
- 10.5.5 In case of any dispute pending before the appropriate authority under ID Act 1948, WC Act 1923 or ESI Act 1948 and PF Act 1952, BHEL reserve the right to hold such amounts from the final bills of the Contractor which will be released on submission of proof of settlement of issues from the appropriate authority under the act.
- 10.5.6 In case of any dispute prolonged / pending before the authority for the reasons not attributable to the contractor, BHEL reserves the right to release the final bill of the contractor on submission of Indemnity bond by the contractor indemnifying BHEL against any claims that may arise at a later date without prejudice to the rights of BHEL.

10.6 DEPLOYMENT OF SKILLED / SEMI-SKILLED TRADESMEN

The following clause is applicable in case the contract value / contract price is Rs. Five crores and above.

The contractor shall, at all stages of work deploy skilled / semi-skilled tradesmen who are qualified and possess certificate in particular trade from CPWD Training Institute / Industrial Training Institute / National Institute of Construction Management and Research (NICMAR), National Academy of Construction, CIDC or any similar reputed and recognized Institute managed

TECHNICAL CONDITIONS OF CONTRACT (TCC)

/ certified by State / Central Government. The number of such qualified tradesmen shall not be less than 20% of total skilled / semi-skilled workers required in each trade at any stage of work. The contractor shall submit number of man days required in respect of each trade, its scheduling and the list of qualified tradesmen along with requisite certificate from recognized Institute to Engineer-in-Charge for approval. Notwithstanding such approval, if the tradesmen are found to have inadequate skill to execute the work of respective trade, the contractor shall substitute such tradesmen within two days of written notice from Engineer-in-Charge. Failure on the part of contractor to obtain approval of Engineer-in-Charge or failure to deploy qualified tradesmen will attract a compensation to be paid by contractor at the rate of Rs. 100 per such tradesman per day. Decision of Engineer-in-Charge as to whether particular tradesman possesses requisite skill and amount of compensation in case of default shall be final and binding.

10.7 Site Visit by the Bidder

- 10.7.1 The bidder shall, prior to submitting his tender for the work, visit, examine and acquire full knowledge & information and necessary conditions prevailing at the site and its surroundings of the plant premises together with all statutory, obligatory, mandatory requirements of various authorities about the site of works at his own expense, and obtain and ascertain for himself on his own responsibility that may be for preparing his tender and entering into a contract, and take the same into account in the quoted contract price for the work.
- 10.7.2 The bidder shall satisfy themselves about the following factors:
- i) Site conditions including access to the site, existing and required roads and other means of transport/communication for use by him in connection with the work including diverting and re-routing of services.
 - ii) Requirement and availability of land and other facilities of his enabling works, establishment of his nursery, office, stores etc.
 - iii) Ground conditions including those bearing upon transportation, disposal, handling and storage of materials required for the work or obtained therefrom.
 - iv) Source and extent of availability of suitable materials, including water etc., and labour (skilled and unskilled) required for work, and laws and regulations governing their use and employment.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- v) Geological, meteorological, topographical and other general features of the site and its surroundings as are pertaining to and needed for the performance of the work.
 - vi) The limit and extent of surface and subsurface water to be encountered during the performance of the work, and the requirement of drainage and pumping.
 - vii) The type of equipment and facilities needed, for and in the performance of the work;
 - viii) The extent of lead and lift required for the work in complete form over the entire duration of the contract, and
 - ix) All other information pertaining to and needed for the work including information as to the risks, contingencies and other circumstances which may influence or affect the work or the cost thereof under this contract.
- 10.7.3 The bidder should note that information, if any, in regard to the local conditions, as contained in these tender documents, has been given to tenderer merely for guidance and is not warranted to be complete.
- 10.7.4 A bidder shall be deemed to have full knowledge of the site, whether he inspects it or not, and no extra charges consequent on any misunderstanding or otherwise shall be allowed.
- 10.7.5 The bidder and any of his personnel or agents will be granted permission by the Site-In-Charge or his authorized nominee, on receipt of formal application in respect thereof a week in advance of the proposed date of inspection of site, to enter upon his premises and lands for purpose of such inspection, but only on the express condition that the tenderer (and his personnel and agents) will relieve and indemnify the Employer (and his personnel and agents) from and against all liability in respect thereof and will be responsible for personal injury (whether fatal or otherwise), loss of or damage to property and any other loss, damage, costs and expenses however caused which, but for the exercise of such permission, would not have arisen.
- 10.7.6 All works shall be carried out in proper workmen like manner. Items of works covered by the following specification shall be carried out as per the best practices and according to the direction of the Engineer In- charge / BHEL, Site Engineer and to his satisfaction. Unless otherwise specified in this section or in the description of item, the cost of stage of works mentioned here under shall be deemed to have been included in the rates of items provided in the schedule.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 10.7.7 Scope of work covered under this specification requires quality workmanship, engineering and green belt management along with the supply of all consumables, tools and tackles and testing instruments. The contractor shall ensure timely completion of work. The contractor shall have adequate tools, measuring instruments etc. in his possession. He shall also have adequate trained, qualified and experienced engineers, supervisory staff and skilled personnel. The manpower deployment identified by contractor shall match with above scope of works.
- 10.7.8 It is not the intent to specify herein all details of all material. Any item related this work not covered by this but necessary to complete the system will be deemed to have been included in the scope of the work.
- 10.7.9 All the necessary certificates and licenses required to carry out this scope of work are to be arranged by the contractor then and there at no extra cost.
- 10.7.10 Site testing wherever required shall be carried out for all items / materials installed by the contractor to ensure proper installation and functioning in accordance with drawings, specifications and manufacturer's recommendations.
- 10.7.11 The contractor shall carryout additional tests if any, which the Engineer feels necessary because of site conditions and also to meet system specification.
- 10.7.12 All the work shall be carried out as per instructions of BHEL engineer. BHEL engineer's decision regarding the correctness of the work and method of working shall be final and binding on the contractor.
- 10.7.13 Wherever work sequences are furnished by BHEL, the contractor shall follow the same sequence.
- 10.7.14 The Contractor may have to execute work in such a place and condition where other agencies also will be under such circumstances. The contractor shall co-operate with other contractors and agencies so that various activities can be carried out simultaneously in order to achieve an early completion.
- 10.7.15 Contractor shall execute the supply and works as per sequence prescribed by BHEL at site engineer. No claims for extra payment from the contractor will be entertained on the grounds of deviation from the methods of execution of similar job in any other site or for any reasons whatsoever.
- 10.7.16 If required by BHEL, the contractor shall change the sequence of his operation so that work on priority sectors can be completed within the projects schedule. The contractor shall afford maximum assistance to BHEL in this connection without causing delay to agreed completion date.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 10.7.17 Contractor shall, transport all materials to site and unload at site / working area for inspection and checking. All material handling equipment required shall be arranged by the contractor.
- 10.7.18 Contractor shall retain all T&P / Testing instrument / Material handling equipments etc at site as per advice of BHEL engineer and same shall be taken out from site only after getting the clearances from engineer in charge.
- 10.7.19 The contractor at his cost shall arrange necessary security measures for adequate protection of his machinery, equipment, tools, materials etc. BHEL shall not be responsible for any loss or damage to the contractor's construction equipment and materials. The contractor may consult the Engineer-in-Charge on the arrangements made for general site security for protection of his machinery equipment tools etc.
- 10.7.20 The Contractor may have to execute work in such a place and condition where other agencies also will be under such circumstances. However, completion time for work agreed will be subject to the condition that contractor's work is not hampered by the agencies.
- 10.7.21 Contractor has to work in close co-ordination with other work agency at site. BHEL engineer will co-ordinate area clearance. In a project of such magnitude, it is possible that the area clearance may be less / more at a particular given time. Activities and work program have to be planned in such a way that the milestones are achieved as per schedule/ plans. Contractor shall arrange & augment the resources accordingly.
- 10.7.22 The contractor must obtain the signature and permission of the security personnel of the customer for bringing any of their materials inside the site premises. Without the Entry Gate Pass these materials will not be allowed to be taken outside.
- 10.7.23 Contractor shall remove all scrap materials periodically generated from his working area and collect the same at one place earmarked for the same. Load of scraps is to be shifted to a place earmarked by BHEL. Failure to collect the scrap is likely to lead to accidents and as such BHEL reserves the right to collect and remove the scrap at contractor's risk and cost if there is any failure on the part of contractor in this respect.
- 10.7.24 The contractor shall ensure that his premises are always kept clean and tidy to the extent possible. Any untidiness noted on the part of the contractor shall be brought to the attention of the contractor's site representative who shall take immediate action to clean the surroundings to the satisfaction of the Engineer-in-Charge.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 10.7.25 The contractor is strictly prohibited from using BHEL's regular components like angles, channels, beams, plates, pipe / tubes, and handrails etc for any temporary supporting or scaffolding works. Contractor shall arrange himself all such materials. In case of such misuse of BHEL materials, a sum as determined by BHEL engineer will be recovered from the contractor's bill. The decision of BHEL engineer is final and binding on the contractor.
- 10.7.26 No member of the already erected structure / buildings, other component and auxiliaries should be removed / modified without specific approval of BHEL engineer.
- 10.7.27 Contractors shall ensure that all their Staff / Employees are exposed to periodical training programme conducted by qualified agencies/ personnel on ISO 9001 – 2008 Standards.
- 10.7.28 The terminal points decided by BHEL are final and binding on the contractor for deciding the scope of work and effecting the payment for the work done up to the terminals.
- 10.7.29 Crane operators deployed by the contractor shall be tested by BHEL before he is allowed to operate the cranes.
- 10.7.30 On Completion of work, all the temporary buildings, structures, pipe lines, cable etc. shall be dismantled and leveled and debris shall be removed as per instruction of BHEL by the contractor at his cost. In the event of his failure to do so, the expenditure towards clearance of the same will be recovered from the contractor. The decision of BHEL Engineer in this regard is final.
- 10.7.31 It is the responsibility of the contractor to do the checking, testing etc. if necessary, repeatedly to satisfy BHEL Engineer with all the necessary tools and tackles, manpower etc. without any extra cost. The testing will be completed only when jointly certified so, by the BHEL Engineer.
- 10.7.32 If any item or equipment not covered but requires being executed, same shall be carried out by the contractor. Equivalent or proportional unit rate shall be considered wherever possible from the BOQ. The rates quoted by the contractor shall be uniform as far as possible for similar items appearing in rate schedule.
- 10.7.33 The contractor's work shall not hinder other work, either underground or over ground, such as electrical, phone lines, water or sewage lines, etc. In areas of overlap, the contractor shall work in coordination with other related contractors. Any damage by the landscape contractor's team to such utilities will be penalized and contractor shall be responsible for cost for such damages.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

10.8 SITE INSPECTION

- 10.8.1 BHEL or his authorized agents may inspect various stages of work during the currency of the contract awarded to him. The contractor shall make necessary arrangements for such inspection and carry out the rectification pointed out by the owner / employer without any extra cost to the owner / employer. No cost whatsoever such duplication of inspection of work be entertained.
- 10.8.2 BHEL will have full power and authority to inspect the works at any time, either on the site or at the contractor's premises. The contractor shall arrange every facility and assistance to carry out such inspection. On no account will the contractor be allowed to proceed with work of any type unless such work has been inspected and entries are made in the site inspection register by BHEL.
- 10.8.3 Wherever the performance of work by the contractor is not satisfactory in respect of workmanship, deployment of sufficient labour or equipment, leading to delay in execution of work or any other matter, BHEL shall have the right to engage labour at normal ruling rates and get the work executed through other agency and debit the cost to the contractor and the contractor shall have no right to claim compensation thereof. In such a case, BHEL shall have the right to utilize the materials and tools brought by the contractors for the same work.

10.9 DOCUMENTATION

- 10.9.1 The following information shall be furnished by the bidder within two weeks of award of contract for purchaser's approval:
- a) Bar chart covering planned activities at site
 - b) Detailed organization chart
 - c) Details of T&P available with contractors with documents proofs.
- 10.9.2 The following information shall be furnished by the bidder after testing and inspection:
Test certificates of various tests conducted at site. All inspection and test certificates shall be signed by BHEL representative also.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

10.10 RECORDS TO BE MAINTAINED AT SITE:

- 10.10.1 Record of Quantity of FREE/Chargeable items issued by BHEL must be maintained during contract execution. Also reconciliation statement to be prepared at regular intervals.
- 10.10.2 The under mentioned Records/ Log-books/ Registers applicable to be maintained.
 - a. Hindrance Register.
 - b. Site Order Book.
 - c. Test Check of measurements.
 - d. Supply and Consumption Daily Register of Cement and Steel
 - e. Records of Test reports of Field tests.
 - f. Records of manufacture's test certificates.
 - g. Records of disposal of scraps generated during and after the work completion.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – I CHAPTER - XI **PROGRESS OF WORK**

The scope of the work will comprise of following but not limited to the following:

1.11 PROGRESS AND MONITORING OF WORK

1.11.1 Refer forms F -14 to F-15 of volume I D of volume -I book-II. Plan and review will be done as per the formats.

1.11.2 Contractor is required to draw mutually agreed monthly construction programs in consultation with BHEL well in advance monthly as per the Form-14. Contractor shall ensure achievement of agreed program and shall also timely arrange additional resources considered necessary at no extra cost to BHEL. Progress review meetings will be held at site during which actual progress during the week vis-a-vis scheduled program shall be discussed for actions to be taken for achieving targets. Contractor shall also present the program for subsequent week. The contractor shall constantly update / revise his work program to meet the overall requirement. All quality problems shall also be discussed during above review meetings. Necessary preventive and corrective action shall be discussed and decided upon in such review meetings and shall be implemented by the contractor in time bound manner so as to eliminate the cause of nonconformities.

1.11.3 The contractor shall submit daily, weekly and monthly progress reports, manpower reports, materials reports, consumables (gases / electrodes / ferules / lugs) report, T&Ps availability report and other reports as per Performa considered necessary by the Site Engineer as per the BHEL formats.

1.11.4 The contractor shall submit weekly / fortnightly / monthly statement report regarding consumption of all consumables for cost analysis purposes.

1.11.5 The monthly report at the end of every month shall be submitted as a booklet and shall contain the following details:

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- a) Colour Progress photographs to accompany the report should be submitted.
- b) Construction progress in terms of quantity, CUM, etc., completed as relevant to the respective work areas against planned.
- c) Site Organization chart of engineers & supervisors as on 24th of the month with further mobilization plan
- d) Category- wise man hours engaged during the previous month under the categories like fitters, electricians, welders, riggers, khalasis, grinder-men, gas-cutters, crane operators, store keepers, lab technicians, helpers, security etc. Data will be spilt up under the work area.
- e) Consumables report giving consumption of all types of gases and electrodes during the previous month (as applicable).
- f) Availability report of cranes/T&Ps
- g) Safety implementation report in the format
- h) Pending material and any other inputs required from BHEL for activities planned during the subsequent month.

1.11.6 The manpower reports shall clearly indicate the manpower deployed, category wise specifying also the activities in which they are engaged.

1.11.7 During the course of construction, if the progress is found unsatisfactory, or if the target dates fixed from time to time for every milestone are to be advanced, or in the opinion of BHEL, if it is found that the skilled workmen like fitters, operators, technicians etc employed are not sufficient BHEL will induct required additional workmen to improve the progress and recover all charges incurred on this account including all expenses together with BHEL overheads from contractor's bills.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

- 1.11.8 It is the responsibility of the contractor to provide all relevant information on a regular basis regarding construction progress, laborer availability, equipment deployment, testing, etc.
- 1.11.9 The progress reports shall indicate the progress achieved against plan, indicating reasons for delays, if any. The report shall also give remedial actions which the contractor intends to make good the slippage or lost time so that further works can proceed as per the original plan the slippages do not accumulate and affect the overall programme.
- 1.11.10 The contractor to reflect actual progress achieved during the month and will be submitted to BHEL, so that slippages can be observed and necessary action taken in order to ensure that the situation does not get out of control will update the construction schedule forming part of this contract each month.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART –I CHAPTER -XII **MATERIAL HANDLING**

- 1.12.1 Open land as available shall be provided by BHEL on free of cost basis as provided by TANGEDCO. Contractor shall maintain one centralized fenced store cum fabrication yard at his own cost. Hard surfacing of this yard and all-round drain shall be carried out by the contractor at his own cost within the quoted rate. The bidder shall make complete arrangement of necessary security personnel, to safeguard all such materials in his custody at his own cost. Materials issued will be used only for construction of permanent work. The contractor shall take care of material issued by BHEL and shall protect the same from theft, damage and weathering at his own cost.
- 1.12.2 The system for receipt, storage & issue of materials shall be available with vendors for easy traceability.
- 1.12.3 Periodic audit of system of purchasing, storing and issue, etc. will have to be carried out by the vendors. BHEL will also audit the same.
- 1.12.4 The contractor shall in no case be entitled for any compensation or damages on account of any delay in supply or non-supply thereof for all or any such material.
- 1.12.5 Excessive rusting of steel must be avoided. In case, due to any cause attributable to the contractor, rusting of steel for BHEL issued steel occur rendering the same unusable, then such quantity of steel shall be recovered from the interim payment at the penal rate specified in the tender
- 1.12.6 The contractor shall maintain proper store account for all the BHEL issued materials and shall give three copies of computerized reconciliation statement of such account to the BHEL with each running bill.
- 1.12.7 All structural steel and bought out construction materials shall be stacked plate size wise, thickness wise and item wise. Materials issued by BHEL as free of supply shall be stacked separately on sleepers.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

1.12.8 Materials shall not under any circumstances taken out of the project site unless otherwise permitted by BHEL.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME 1A PART-1 CHAPTER XIII

ACCOUNTING OF MATERIALS ISSUE

The material issued to the contractor by BHEL will be accounted as follows:

1.13.1 ISSUE OF STEEL, CONSUMPTION, WASTAGE & RETURN OF MATERIALS

Please refer SPECIAL CONDITIONS OF CONTRACT (SCC)- Civil & Structural Chapter – VI: Material Handling, Storage & Preservation

1.13.2 SCRAP & SERVICEABLE MATERIALS

Please refer SPECIAL CONDITIONS OF CONTRACT (SCC)- Civil & Structural Chapter – VI: Material Handling, Storage & Preservation

1.13.3 RECONCILIATION OF MATERIALS

Please refer SPECIAL CONDITIONS OF CONTRACT (SCC)- Civil & Structural Chapter – VI: Material Handling, Storage & Preservation

1.13.4 RECOVERY OF MATERIAL

Recovery of wastages shall be made from the bills of contractor at the penal rate mentioned in the table below for the following cases:

- a) If wastage exceeds the specified limit
- b) If the wastage not exceeded specified limit, but not returned to BHEL store except invisible wastage
- c) For not returning the surplus serviceable materials.

13.2.1 PENAL RATE OF MATERIALS

A	STRUCTURAL STEEL MS plates, MS flats, rolled steel beams, channels, and angles, MS pipes, Chequered Plates, etc. in sizes and lengths as available	Rs. 71,219/- per MT + GST and/or other taxes & duties
B	Bought Out Construction Material Gratings, SS liner, GI pipe for handrail etc.	BHEL's latest purchase Price per MT + 5% overhead + GST and/or other taxes & duties

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART-II CHAPTER-1

CORRECTIONS / REVISIONS IN SPECIAL CONDITIONS OF CONTRACT, GENERAL CONDITIONS OF CONTRACT AND FORMS & PROCEDURES

Following Clauses from S. No.1 to S.No.9 are modified in the Special Conditions of Contract (SCC):

S.No. 1

Clause no. 6.3.4.1 is revised as under:

“6.3.4.1 The steel shall be issued to the contractor on the following basis:

i.	Structural Steel	Weighment basis (Unit – MT)
ii.	Bought out construction material (i.e. Gratings, SS liner, GI pipe for handrail etc.)	Weighment basis (Unit – MT)

S.No. 2

Clause no. 6.3.4.2 is revised as under:

“6.3.4.2 All the steel (structural and bought out construction materials) issued by BHEL shall be properly accounted for. The total quantity of steel required for the work will be calculated from the approved fabrication drawing. The measurement for payment as well as for accounting shall be based on the sectional weights as indicated in the following IS/BS/EN specifications.”

S.No. 3

Clause no. 6.4.1 stands deleted.

S.No. 4

Heading of Clause no. 6.4.2 is revised as under:

“6.4.2. Return of Structural Steel and bought out construction materials including Scrap:”

S.No. 5

Clause no. 6.4.3.4 stands deleted.

S.No. 6

Heading of Clause no. 6.4.4 is revised as under:

“6.4.4 Steel Consumption and wastage”

TECHNICAL CONDITIONS OF CONTRACT (TCC)

S.No. 7

Clause no. 6.4.4.1 to 6.4.4.2 stands deleted

S.No. 8

Clause no. 6.4.4.3 is revised as under:

Bought out construction material (i.e. Gratings, SS liner, GI pipe for handrail etc.) Consumption

The theoretical consumption of various sections of steel shall be based on approved construction drawing. Weight shall be calculated considering the sectional weights as per Indian standards. No extra cost shall be payable to the contractor for any deviation in weights for the different procedures adopted for issue and calculation of the theoretical consumption including rolling tolerances.

- a) Actual consumption = Issue - Surplus.
- b) Surplus = un-tampered, unused, uncut QTY of steel including serviceable material returned by the contractor to BHEL store along-with relevant documents.
- c) Wastage = Actual consumption - Theoretical consumption.

S.No. 9

Heading of Clause no. 6.4.4.4 is revised as under:

“Bought out construction material wastage”

Table item description is revised as “Bought out construction material wastage”

Following Clause is added in the Special Conditions of Contract (SCC):

S. No.10

Following clauses are added:

6.3.4.9 Following shall be limit for the maximum quantity of BHEL issue materials that would be with the contractor at any point of time when work is in progress (excluding what has already been incorporated in the works).

<i>SL NO</i>	<i>ISSUE OF MATERIALS</i>	<i>MAX. QTY IN CONTRACTOR'S STORE</i>
1.	Structural Steel	Requirement of one month

S.No.: 11

GCC Clause 2.17 shall be revised as:

NO PRICE VARIATION COMPENSATION IS APPLICABLE

TECHNICAL CONDITIONS OF CONTRACT (TCC)

S.No.:12

In addition to The EARNEST MONEY DEPOSIT (EMD) clause 1.9 and The SECURITY DEPOSIT (SD) clause 1.10 published in General Conditions of Contract (Volume I Book II) following is added for FDR:

1. FDR should be Lien marked in favour of M/s BHEL.
2. Bank issuing FDR should agree to the following conditions and submit duly signed letter addressed to BHEL, confirming the following points:
 - a) There is no Lock in Period for Encashment of the Said FDR
 - b) The amount under the Said FDR would be paid to BHEL-PSSR on Demand, at any point of Time before, or upon Maturity, without any reference to the (Contactor Name).
 - c) Encashment whether premature or otherwise would not require any clearance from any other authority /Person.
 - d) FDR will be auto renewed for such period/s initially mentioned in the FDR and the intimation of Such renewal shall be sent to BHEL, PSSR and (Contractor), immediately after the renewal.
 - e) FDR will not be closed, Encashed, Changed or Discharged without the Written permission/Confirmation from M/s BHEL PSSR.
 - f) Bank to acknowledge and agree that the Lien created on the FDR shall be in Force until M/s BHEL PSSR, gives a Discharge Letter in this regard.

S. No.: 13

Detailed Instruction for EMD / Security deposits through SBI e-collect:

Step 1: Vendors may visit SBI collect website, the URL of which is <https://www.onlinesbi.sbi/sbicollect> where they get the home page with various categories of institutions.

Step 2: Select PSU - Public Sector Undertakings – leading to a page with list of PSUs

Step 3: Type BHEL and search, they get to see all BHEL divisions wherein they shall select BHEL PSSR Chennai. The screen shot of the same is given below.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

The screenshot displays the SBI SB Collect web interface. At the top, the SBI logo and navigation links (HOME, TRANSACTION HISTORY, FAQ'S, CUSTOMER SUPPORT) are visible. Below this, a 'Payment Progress' section shows a five-step flow: Select Payee (active), Enter Payment Details, Verify Payment Details, Complete Payment, and Print Receipt. The 'Select Payee' section is expanded, showing a search for 'bhel' under the category 'PSU-Public Sector Undertaking'. A table lists two results, both from Tamil Nadu:

Name of PSU-Public Sector Undertaking	State
BHEL BAP RANIPET	Tamil Nadu
BHEL PSSR CHENNAI	Tamil Nadu

Below the table, it indicates 'Showing 1 to 2 of 2 entries (filtered from 113 total entries)'. A 'Back' button is located at the bottom of the section. The footer includes the State Bank of India logo and links for Privacy Statement, Disclosures, and Terms of Use. The Windows taskbar at the bottom shows the date as 29-06-2023 and the time as 18:28.

Step 4: Select EMD receipts. Having selected the Payee in the Payment Progress, it will lead to the payment details – a drop down list of values. From that list, vendors shall select EMD receipts. Upon clicking the entry EMD receipts, a form will open asking for the remitters details and the details of the tender.

Step 5: Confirm details and pay

Fill in all the details correctly, verify the details, and complete the payment as it is leading to the payment gateway.

Step 6: Take a printout on completing the payment and enclose the copy of the same along with the bid submission. Store the copy of receipt for future reference.

TECHNICAL CONDITIONS OF CONTRACT (TCC)

VOLUME-IA PART – II CHAPTER 2 to 4

Next pages are as below

Chapter 2	T&P Hire Charges	12
Chapter 3	“HSE Plan for Site Operations by Subcontractor” (Document No. HSEP: 14 Rev02)	131
Chapter 4	Technical Specifications & drawings	109

AnnexureC1

DATE:31/08/2021

REVISED RATES OF T&P HIRE CHARGES FOR CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS

SL NO.	ITEM DESCRIPTION	USEFUL LIFE (IN YRS)	Revised rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (WITHIN USEFUL LIFE)	Revised Rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (BEYOND USEFUL LIFE)
I.	CRANES :-			
1	Portal Gantry Crane 500T	15	24500.00	24500.00
2	100MT Crawler Crane ZOOMLION CRANE-QUY-100	10	11370.00	10940.00
3	Heavy Lift Crawler Crane 600MT Class DEMAG Model CC2800	15	56290.00	53560.00
4	PORTAL CRANE, 360T	15	14070.00	13390.00
5	600MT Class Crawler Crane- Manitowoc Model 18000-UPGRADED	15	55460.00	52770.00
6	600MT Class Crawler Crane- Liebherr Model LR1600-2 (Upgraded)	15	68610.00	65280.00
7	CRAWLER CRANE FMC/LINKBELT 718, 250T (WITH RINGER)	15	33510.00	31880.00
8	CRAWLER CRANE FMC/LINKBELT 718, 250T (WITH-OUT RINGER)	15	20940.00	19920.00
9	MANITOWOC M-250T TRUCK CRANE	15	30160.00	28690.00
10	270 MT Class Crawler Crane- Manitowoc Model 2250	15	31660.00	30130.00
11	300MT Crane Crawler Crane LIEBHERR Model LR-1350/1	15	26390.00	25110.00
11.A	300MT Crane Crawler Crane LIEBHERR Model LR-1350/1 (UPGRADED)	15	36110.00	34580.00
12	250MT Class Mid range Crawler Crane- Kobelco Model CKE2500-2	15	15130.00	14390.00
12.A	250MT Class Mid range Crawler Crane- Kobelco Model CKE2500-2 (UPGRADED)	15	18850.00	18050.00
13	LINKBELT LS- 248H CRAWLER CRANE (180T)	15	16750.00	15940.00
14	MANITOWAC MODEL 888 CRAWLER CRANE (200 MT)	15	21780.00	20720.00
15	CRAWLER CRANE SUMITOMO, 150T	15	10890.00	10360.00
16	All Terrain Crane, 150MT- Liebherr Model LTM1150	15	13400.00	12750.00
17	CRAWLER CRANE, 120 T Fushun Model QUY120	10	10830.00	10420.00
18.A	CRAWLER CRANE 135MT Kobelco Model CK1350- 1F	15	10720.00	10200.00
18.B	CRAWLER CRANE 135MT Kobelco Model CK1350	15	8880.00	8440.00
19	CRAWLER CRANE 120MT - Tata-Sumitomo Model SCX1200-2	15	10050.00	9560.00
20	CRAWLER CRANE 100 T (KH 500)	15	10050.00	9560.00
21	Hydraulic Crawler Crane 80MT, Fushun Model QUY 80B	10	5410.00	5210.00
22	ROUGH TERRAIN CRANE 75T (RT880)	12	6140.00	5880.00
23	CRAWLER CRANE, 75T -Tata Model 955ALC/TFC280	12	5370.00	5150.00
24	Mobile Crane, 55MT (TIL)	12	4410.00	4230.00
25	CRAWLER CRANE, 25T -Tata Model TFC75	10	3030.00	2910.00
26	MOBILE CRANE, 20MT (TIL)	10	2270.00	2180.00
27	MOBILE CRANE, 20MT (ESCORTS)	10	2270.00	2180.00
28	MOBILE CRANE ESCORTS- 14MT	10	710.00	680.00
29	HYDAULIC PICK & CARRY CRANE, 8/9/10/11/12 MT	10	390.00	370.00

Annexure**C1**

DATE:31/08/2021

**REVISED RATES OF T&P HIRE CHARGES FOR CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS**

SL NO.	ITEM DESCRIPTION	USEFUL LIFE (IN YRS)	Revised rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (WITHIN USEFUL LIFE)	Revised rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (BEYOND USEFUL LIFE)
30	FORK LIFT 5T	5	650.00	640.00
31	FORK LIFT 3T	5	540.00	530.00

**REVISED RATES OF T&P HIRE CHARGES FOR CRANES & TRAILERS ETC. FOR
OUTSIDE AGENCIES**

SL NO.	ITEM DESCRIPTION	USEFUL LIFE (IN YRS)	Revised rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (WITHIN USEFUL LIFE)	Revised rates (Rs./Hour) valid from 01/09/2019 to 31/8/2021 (BEYOND USEFUL LIFE)
I.	CRANES :-			
1	Portal Gantry Crane 500T	15	27230.00	27230.00
2	100MT Crawler Crane ZOOMLION CRANE-QUY-100	10	12630.00	12160.00
3	Heavy Lift Crawler Crane 600MT Class DEMAG Model CC2800	15	62550.00	59520.00
4	PORTAL CRANE, 360T	15	15630.00	14880.00
5	600MT Class Crawler Crane- Manitowoc Model 18000-UPGRADED	15	61620.00	58630.00
6	600MT Class Crawler Crane- Liebherr Model LR1600-2 (Upgraded version)	15	76230.00	72540.00
7	CRAWLER CRANE FMC/LINKBELT 718, 250T (WITH RINGER)	15	37230.00	35420.00
8	CRAWLER CRANE FMC/LINKBELT 718, 250T (WITH-OUT RINGER)	15	23270.00	22140.00
9	MANITOWOC M-250T TRUCK CRANE	15	33510.00	31880.00
10	270 MT Class Crawler Crane- Manitowoc Model 2250	15	35180.00	33480.00
11	300MT Crane Crawler Crane LIEBHERR Model LR-1350/1	15	29320.00	27900.00
11.A	300MT Crane Crawler Crane LIEBHERR Model LR-1350/1 (UPGRADED)	15	40120.00	38420.00
12	250MT Class Mid range Crawler Crane- Kobelco Model CKE2500-2	15	16810.00	15990.00
12.A	250MT Class Mid range Crawler Crane- Kobelco Model CKE2500-2 (UPGRADED)	15	20950.00	20060.00
13	LINKBELT LS- 248H CRAWLER CRANE (180T)	15	18610.00	17710.00
14	MANITOWAC MODEL 888 CRAWLER CRANE (200 MT)	15	24200.00	23020.00
15	CRAWLER CRANE SUMITOMO, 150T	15	12100.00	11510.00
16	All Terrain Crane, 150MT- Liebherr Model LTM1150	15	14890.00	14170.00
17	CRAWLER CRANE, 120 T Fushun Model QUY120	10	12030.00	11580.00
18.A	CRAWLER CRANE 135MT Kobelco Model CK1350- 1F	15	11910.00	11330.00
18.B	CRAWLER CRANE 135MT Kobelco Model CK1350	15	9860.00	9380.00
19	CRAWLER CRANE 120MT - Tata-Sumitomo Model SCX1200-2	15	11170.00	10620.00
20	CRAWLER CRANE 100 T (KH 500)	15	11170.00	10620.00
21	Hydraulic Crawler Crane 80MT, Fushun Model QUY 80B	10	6010.00	5790.00
22	ROUGH TERRAIN CRANE 75T (RT880)	12	6830.00	6540.00
23	CRAWLER CRANE, 75T -Tata Model 955ALC/TFC280	12	5970.00	5720.00
24	Mobile Crane, 55MT (TIL)	12	4900.00	4700.00
25	CRAWLER CRANE, 25T -Tata Model TFC75	10	3370.00	3240.00
26	MOBILE CRANE, 20MT (TIL)	10	2520.00	2430.00
27	MOBILE CRANE, 20MT (ESCORTS)	10	2520.00	2430.00
28	MOBILE CRANE ESCORTS- 14MT	10	790.00	760.00
29	HYDAULIC PICK & CARRY CRANE, 8/9/10/11/12 MT	10	430.00	410.00

**REVISED RATES OF T&P HIRE CHARGES FOR CRANES & TRAILERS ETC. FOR
OUTSIDE AGENCIES**

SL NO.	ITEM DESCRIPTION	USEFUL LIFE (IN YRS)	Revised rates (Rs./Hour) valid from 01/09/2021 to 31/8/2023 (WITHIN USEFUL LIFE)	Revised rates (Rs./Hour) valid from 01/09/2019 to 31/8/2021 (BEYOND USEFUL LIFE)
30	FORK LIFT 5T	5	720.00	710.00
31	FORK LIFT 3T	5	600.00	590.00

**RATES OF T&P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS**

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
I.	LIFTING EQUIPMENTS	
1	Strand Jack System for Boiler Drum Lifting	20930
2	MULTI SHEAVE PULLEY BLOCK 40/50T/60T	310
3	MULTI SHEAVE PULLEY BLOCK 100T	630
4	MULTI SHEAVE PULLEY BLOCK 150T	1260
5	ELCTRIC WINCH 5T	1270
6	ELCTRIC WINCH 10T	2360
7	ELECTRIC WINCH 15 T	2150
8	PASSENGER CUM GOODS HOIST 1T	2270
9	FURNACE MAINTENANCE PLATFORM	5040
10	Gang Operated Hydraulic Jack (Set of 4 Jacks - 175 MT each)	2100
II	WELDING & HEAT TREATMENT EQUIPMENT	
1	125KW, 3KHZ, AIR-COOLED INDUCTION HEATING EQUIPMENT	16380
2	75KW, 10 KHZ, COMPACT INDUCTION HEATING EQUIPMENT	8190
3	WELDING GENERATOR 320/300 A	300
4	WELDING RECTIFIER 400A/300A	300
5	WELDING RECTIFIER 600A	400
6	DIESEL WELDING GENERATOR 400A/300A	400
7	TRANSFORMER,600A	300
8	TRANSFORMER 300/400A	200
III	SERVICE PLANTS & ALLIED EQUIPT.	0
1	500KVA DIESEL GENERATOR	3800
2	TRANSFORMER OIL FILTERATION EQUIPMENT 6000LPH CAPACITY WITHOUT STORAGE TANK	6370
3	-DO- , WITH STORAGE TANK	7280
4	OIL FILTERATION M/C, 250/500 LPH (OTHER THAN SILICON OIL)	910
5	OIL FILTERATION M/C, 250GPH/1000LPH (OTHER THAN SILICON OIL)	1360
6	OIL FILTERATION M/C, 500GPH/2500LPH (OTHER THAN SILICON OIL)	1820
7	OIL FILTERATION M/C, 1000GPH/5000LPH (OTHER THAN SILICON OIL)	3640
8	Portable Lube Oil Purification Unit (Centrifuge M/c) Capacity: 750 LPH	1270
9	Low Vacuum de-hydration unit	630
10	DIESEL GENERATING SET,250 KVA	1770
11	DIESEL GENERATING SET,25 KVA	500

**RATES OF T&P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS**

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
12	VACUUM PUMP(ABSOLUTE V.C.)	540
13	ACID CIRCULATING PUMP WITH MOTOR 120M HEAD, 150T/HR	1090
14	ACID TRANSFER PUMP 20/50 T/HR	540
15	DEWATERING PUMP (Kirloskar make,11KW/15HP)	80
16	HP Air compressor (32 Kg/Sq. Cm, 150 CFM)	4240
17	AIR COMPRESSORS 250/300/330/360/350 CFM	2730
18	AIR COMPRESSORS 140/150/190/210 CFM	910
19	ACID CIRCULATING PUMP WITH MOTOR & STARTER, 200T/HR, 150M, 220 HP	1820
20	Industrial Blower 2000CFM	1270
21	Air Leak Test Blower (Flow: 40000 m³/Hr)	1160
22	Air Blower (Flow: 20000 m³/Hr)	940
IV	METAL FORMING /CUTTING EQUIPMENT	
1	TUBE EXPANDING M/C PNEUMATIC 60-100 MM	630
2	ELECTRO HYDRAULIC PIPE BENDING M/C 4"	1630
3	BOLTING MACHINE (ALCOA/AVLOCK/ HUCK)	1800
4	-do- Gun with nose Assembly only	540
V	TESTING/INSPECTION EQUIPMENT	
1	DATA LOGGER for PG TESTING	36980
2	MOTORISED HYDRAULIC TEST PUMP 250kg/cmsq	800
3	MOTORISED HYDRAULIC TEST PUMP 400-450kg/cmsq	1090
4	MOTORISED HYDRAULIC TEST PUMP 600 KG/CMSQ	1270
5	HYDRAULIC TEST PUMP 800 KG/CMSQ	1330
6	HYDRAULIC TEST PUMP 1000 KG/CMSQ	2230
7	BOLT STRETCHING DEVICE	910
8	BOROSCOPE/FIBROSCOPE FLEXIBLE TYPE (FLEXUX) IMPORTED	3640
9	ULTRASONIC FLAW DETECTOR	2730
10	MPI TEST KIT	360
11	GAS LEAK DETECTOR	270
12	VIBRATION/SOUND LEVEL METER IRD-306	360
13	VIBRATION/SOUND LEVEL METER IRD-308	360
14	VIBRATION ANALYSER/DYNAMIC BALANCING M/C IRD 350	1450
15	VIBRATION ANALYSER/DYNAMIC BALANCING M/C IRD 360	2540
16	SHOCK PULSE METER	630
17	HV.DC TEST KIT UPTO 50 KV	540
18	HV.DC TEST KIT ABOVE 50 KV	1000
19	HV.AC TEST KIT UPTO 50KV	810
20	HV.AC TEST KIT ABOVE 50KV	2910
21	MOTORISED MEGGER 2.5KV	400
22	MOTORISED MEGGAR 5KV	450
23	OSCILLOSCOPE-DUAL BEAM INDIGENOUS	450
24	OSCILLOSCOPE-DUAL BEAM IMPORTED	1090
25	WAVEFORM ANALYSER	910
26	OSCILLOGRAPH/UV RECORDER 24 CHANNEL	1630
27	OSCILLOGRAPH/UV RECORDER 12 CHANNEL	1090
28	OSCILLOGRAPH/UV RECORDER 6 CHANNEL	910

**RATES OF T&P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS**

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
29	DIGITAL LOW RESISTANCE METER	630
30	DC POTENTIOMETER	180
31	PRECISION DEAD WEIGHT TESTER	1000
32	OPTICAL ALIGNMENT KIT	1360
33	BOROSCOPE/FIBROSCOPE(NON FLEXIBLE)	1200
34	VERNIER THEODOLITE,PRECISION	1200
35	VERNIER THEODOLITE,ORDINARY	200
36	ENGINEERS PRECISION LEVEL/DUMPY LEVEL	120
37	ISKAMATIC 'A'	3200
38	CALIBRATOR '03'	1000
39	48 POLE EXTENDER CARD	200
40	MULTIJET NPM	400
41	OSCILLOMETER	10190
42	VOC EQUIPMENT	1400
43	BINARY SIGNAL GENERATOR	290
44	ELECTRIC COUNTER	690
45	FREQUENCY GENERATOR	1000
46	DBF 3 VIBRATION RECORDER/ANALYSER	3270
47	L&T GOULD OSCILLOGRAPH 2-CHANNEL	490
48	L&T GOULD OSCILLOGRAPH 6-CHANNEL	1180
49	VIBROPORT 41/FFT ANALYSER	5460
50	ELCID kit	10010
51	UNIVERSAL CALIBRATION SYSTEM	2730
52	NATURAL FREQUENCY TESTER	2910
53	DIGITAL HARDNESS TESTER	360
54	ADRE 208 VIBRATION ANALYSER	7280
55	PCB DIAGNOSTIC REPAIR KIT	2000
56	SECONDARY INJECTION RELAY TEST KIT	5270
57	MICRO OHM METER	1450
58	DIGITAL MICRO OHM METER MEASURING RANGE: 200 $\mu\Omega$ TO 20K Ω	3230
59	PMI Machine OLYMPUS make	3350
60	Móbile Lighting Mast - 9 metres (4X400 W)	860
61	10KVA RESISTANCE BRAZING MACHINE	140
62	RECURRENT SURGE OSCILLOGRAPH (RSO) TEST KIT WITH PORTABLE HANDHELD OSCILLOSCOPE.	460
63	HYDROGEN GAS LEAK DETECTOR	50
64	STATOR WEDGE ANALYZER KIT WITH COMPLETE ACCESSORIES	4980
65	WEDGE DEFLECTION KIT	80
66	TILE PRESSING MACHINE FOR GAS TURBINE	270
67	INDUCTION BRAZING MACHINE	4870
68	MAGNETIC COHESIVE FORCE (MCF) EQUIPMENT	3640
69	ULTRASONIC FLOW METER	180
70	PORTABLE VIBRATION ANALYSER (MODEL 811T)	40
71	CENTRIFUGAL PUMP SET FOR ACID CLEANING (WITH MOTOR AND PANEL) : PRESSURE -14KG/SQ CM. ; FLOW 60 M3/HR	470
72	CENTRIFUGAL PUMP SET FOR ACID CLEANING (WITH MOTOR AND PANEL) : PRESSURE -30KG/SQ CM. ; FLOW 15 M3/HR	430

**RATES OF T&P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILERS ETC. FOR
SUB-CONTRACTORS WORKING FOR BHEL FOR DOING BHEL JOBS**

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
73	HI SPEED MEMORY RECORDER, MAKE -YOKOGAWA, MODEL DL850E-Q-HE/B5/HD1	1810
74	TROLLEY MOUNTED HYDRAULIC JACK (100 MT)	1260
75	5KV Insulation Tester	450
76	4 Channel Digital Oscilloscope /Fast Recorder	1710
77	4 Channel Oscillographic Recorder	580
78	Sound Level Meter	230
79	Thermal Imaging Camera	770
80	Videoscope (Video Boroscope)	1510
81	DO (Dissolve Oxygen) Meter (0 to 1500 ppb)	1310
82	Conductivity Meter	80
83	Core Flux Test Kit	7280
84	Primary Current Injection Kit (2000A)	870
85	3 Phase Secondary Injection Kit (Relay Test)	3760
86	FRF Filtration Kit	1330
87	FFT Analyser	2290
88	Flue Gas Analyser	1030
89	Oil Test Kit (Mineral Oil)-Transformer	1010
90	Winding Resistance kit (R L C Load)	880
91	SFRA test Kit	1190
92	Tan Delta test Kit	4060
93	PF Meter	330
94	Ultrasonic Flow Meter	830
95	Oil Particle Counter	360
96	Plasma Cutting Machine (With complete accessories)	310
97	JCB make DG Set 80 KVA	670
98	Diesel Generating Set 82.5 KVA	610
99	Portable Jacking Oil Pump	1080
100	Alloy Analyser	1770

RATES OF T & P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILLERS ETC. FOR OUTSIDE AGENCIES

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
I.	LIFTING EQUIPMENTS	
1	Strand Jack System for Boiler Drum Lifting	23250
2	MULTI SHEAVE PULLEY BLOCK 40/50T/60T	350
3	MULTI SHEAVE PULLEY BLOCK 100T	700
4	MULTI SHEAVE PULLEY BLOCK 150T	1400
5	ELECTRIC WINCH 5T	1410
6	ELECTRIC WINCH 10T	2620
7	ELECTRIC WINCH 15 T	2390
8	PASSENGER CUM GOODS HOIST 1T	2520
9	FURNACE MAINTENANCE PLATFORM	5600
10	Gang Operated Hydraulic Jack (Set of 4 Jacks - 175 MT each)	2330
II	WELDING & HEAT TREATMENT EQUIPMENT	
1	125KW, 3KHZ, AIR-COOLED INDUCTION HEATING EQUIPMENT	18190
2	75KW, 10 KHZ, COMPACT INDUCTION HEATING EQUIPMENT	9090
3	WELDING GENERATOR 320/300 A	330
4	WELDING RECTIFIER 400A/300A	330
5	WELDING RECTIFIER 600A	440
6	DIESEL WELDING GENERATOR 400A/300A	440
7	TRANSFORMER,600A	330
8	TRANSFORMER 300/400A	220
III	SERVICE PLANTS & ALLIED EQUIPT.	
1	500KVA DIESEL GENERATOR	4220
2	TRANSFORMER OIL FILTRATION EQUIPMENT 6000LPH CAPACITY WITHOUT STORAGE TANK	7070
3	-DO-, WITH STORAGE TANK	8080
4	OIL FILTRATION M/C, 250/500 LPH (OTHER THAN SILICON OIL)	1010
5	OIL FILTRATION M/C, 250GPH/1000LPH (OTHER THAN SILICON OIL)	1510
6	OIL FILTRATION M/C, 500GPH/2500LPH (OTHER THAN SILICON OIL)	2020
7	OIL FILTRATION M/C, 1000GPH/5000LPH (OTHER THAN SILICON OIL)	4040
8	Portable Lube Oil Purification Unit (Centrifuge M/c) Capacity: 750 LPH	1410
9	Low Vacuum de-hydration unit	700
10	DIESEL GENERATING SET,250 KVA	1970
11	DIESEL GENERATING SET,25 KVA	560
12	VACUUM PUMP(ABSOLUTE V.C.)	600
13	ACID CIRCULATING PUMP WITH MOTOR 120M HEAD, 150T/HR	1210
14	ACID TRANSFER PUMP 20/50 T/HR	600
15	DEWATERING PUMP (Kirloskar make,11KW/15HP)	90
16	HP Air compressor (32 Kg/Sq. Cm, 150 CFM)	4710
17	AIR COMPRESSORS 250/300/330/360/350 CFM	3030
18	AIR COMPRESSORS 140/150/190/210 CFM	1010

RATES OF T & P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILLERS ETC. FOR OUTSIDE AGENCIES

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
19	ACID CIRCULATING PUMP WITH MOTOR & STARTER, 200T/HR, 150M, 220 HP	2020
20	Industrial Blower 2000CFM	1410
21	Air Leak Test Blower (Flow: 40000 m³/Hr)	1290
22	Air Blower (Flow: 20000 m³/Hr)	1040
IV	METAL FORMING /CUTTING EQUIPMENT	
1	TUBE EXPANDING M/C PNEUMATIC 60-100 MM	700
2	ELECTRO HYDRAULIC PIPE BENDING M/C 4"	1810
3	BOLTING MACHINE (ALCOA/AVLOCK/ HUCK)	2000
4	-do- Gun with nose Assembly only	600
V	TESTING/INSPECTION EQUIPMENT	
1	DATA LOGGER for PG TESTING	41090
2	MOTORISED HYDRAULIC TEST PUMP 250kg/cmsq	880
3	MOTORISED HYDRAULIC TEST PUMP 400-450kg/cmsq	1210
4	MOTORISED HYDRAULIC TEST PUMP 600 KG/CMSQ	1410
5	HYDRAULIC TEST PUMP 800 KG/CMSQ	1480
6	HYDRAULIC TEST PUMP 1000 KG/CMSQ	2480
7	BOLT STRETCHING DEVICE	1010
8	BOROSCOPE/FIBROSCOPE FLEXIBLE TYPE (FLEXUX) IMPORTED	4040
9	ULTRASONIC FLAW DETECTOR	3030
10	MPI TEST KIT	400
11	GAS LEAK DETECTOR	300
12	VIBRATION/SOUND LEVEL METER IRD-306	400
13	VIBRATION/SOUND LEVEL METER IRD-308	400
14	VIBRATION ANALYSER/DYNAMIC BALANCING M/C IRD 350	1610
15	VIBRATION ANALYSER/DYNAMIC BALANCING M/C IRD 360	2830
16	SHOCK PULSE METER	700
17	HV.DC TEST KIT UPTO 50 KV	600
18	HV.DC TEST KIT ABOVE 50 KV	1110
19	HV.AC TEST KIT UPTO 50KV	900
20	HV.AC TEST KIT ABOVE 50KV	3230
21	MOTORISED MEGGER 2.5KV	440
22	MOTORISED MEGGAR 5KV	500
23	OSCILLOSCOPE-DUAL BEAM INDIGENOUS	500
24	OSCILLOSCOPE-DUAL BEAM IMPORTED	1210
25	WAVEFORM ANALYSER	1010
26	OSCILLOGRAPH/UV RECORDER 24 CHANNEL	1810
27	OSCILLOGRAPH/UV RECORDER 12 CHANNEL	1210
28	OSCILLOGRAPH/UV RECORDER 6 CHANNEL	1010
29	DIGITAL LOW RESISTANCE METER	700
30	DC POTENTIOMETER	200
31	PRECISION DEAD WEIGHT TESTER	1110
32	OPTICAL ALIGNMENT KIT	1510
33	BOROSCOPE/FIBROSCOPE(NON FLEXIBLE)	1330
34	VERNIER THEODOLITE,PRECISION	1330
35	VERNIER THEODOLITE,ORDINARY	220

**RATES OF T & P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILLERS
ETC. FOR OUTSIDE AGENCIES**


SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
36	ENGINEERS PRECISION LEVEL/DUMPY LEVEL	130
37	ISKAMATIC 'A'	3550
38	CALIBRATOR '03'	1110
39	48 POLE EXTENDER CARD	220
40	MULTIJET NPM	440
41	OSCILLOMETER	11320
42	VOC EQUIPMENT	1550
43	BINARY SIGNAL GENERATOR	320
44	ELECTRIC COUNTER	760
45	FREQUENCY GENERATOR	1110
46	DBF 3 VIBRATION RECORDER/ANALYSER	3630
47	L&T GOULD OSCILLOGRAPH 2-CHANNEL	540
48	L&T GOULD OSCILLOGRAPH 6-CHANNEL	1310
49	VIBROPORT 41/FFT ANALYSER	6060
50	ELCID kit	11120
51	UNIVERSAL CALIBRATION SYSTEM	3030
52	NATURAL FREQUENCY TESTER	3230
53	DIGITAL HARDNESS TESTER	400
54	ADRE 208 VIBRATION ANALYSER	8080
55	PCB DIAGNOSTIC REPAIR KIT	2220
56	SECONDARY INJECTION RELAY TEST KIT	5860
57	MICRO OHM METER	1610
58	DIGITAL MICRO OHM METER MEASURING RANGE: 200 $\mu\Omega$ TO 20K Ω	3590
59	PMI Machine OLYMPUS make	3730
60	Mobile Lighting Mast - 9 metres (4X400 W)	960
61	10KVA RESISTANCE BRAZING MACHINE	160
62	RECURRENT SURGE OSCILLOGRAPH (RSO) TEST KIT WITH PORTABLE HANDHELD OSCILLOSCOPE.	510
63	HYDROGEN GAS LEAK DETECTOR	60
64	STATOR WEDGE ANALYZER KIT WITH COMPLETE ACCESSORIES	5530
65	WEDGE DEFLECTION KIT	90
66	TILE PRESSING MACHINE FOR GAS TURBINE	300
67	INDUCTION BRAZING MACHINE	5410
68	MAGNETIC COHESIVE FORCE (MCF) EQUIPMENT	4040
69	ULTRASONIC FLOW METER	200
70	PORTABLE VIBRATION ANALYSER (MODEL 811T)	50
71	CENTRIFUGAL PUMP SET FOR ACID CLEANING (WITH MOTOR AND PANEL) : PRESSURE -14KG/SQ CM. ; FLOW 60 M3/HR	520
72	CENTRIFUGAL PUMP SET FOR ACID CLEANING (WITH MOTOR AND PANEL) : PRESSURE -30KG/SQ CM. ; FLOW 15 M3/HR	480
73	HI SPEED MEMORY RECORDER, MAKE -YOKOGAWA, MODEL DL850E-Q-HE/B5/HD1	2010
74	TROLLEY MOUNTED HYDRAULIC JACK (100 MT)	1400
75	5KV Insulation Tester	500

**RATES OF T & P HIRE CHARGES FOR ITEMS OTHER THAN CRANES & TRAILLERS
ETC. FOR OUTSIDE AGENCIES**

SL NO.	ITEM DESCRIPTION	Revised rates (Rs./Day) valid from 01/09/2021 to 31/8/2023
76	4 Channel Digital Oscilloscope /Fast Recorder	1900
77	4 Channel Oscillographic Recorder	650
78	Sound Level Meter	260
79	Thermal Imaging Camera	860
80	Videoscope (Video Boroscope)	1680
81	DO (Dissolve Oxygen) Meter (0 to 1500 ppb)	1460
82	Conductivity Meter	90
83	Core Flux Test Kit	8090
84	Primary Current Injection Kit (2000A)	960
85	3 Phase Secondary Injection Kit (Relay Test)	4180
86	FRF Filtration Kit	1480
87	FFT Analyser	2550
88	Flue Gas Analyser	1140
89	Oil Test Kit (Mineral Oil)-Transformer	1120
90	Winding Resistance kit (R L C Load)	970
91	SFRA test Kit	1320
92	Tan Delta test Kit	4510
93	PF Meter	360
94	Ultrasonic Flow Meter	920
95	Oil Particle Counter	400
96	Plasma Cutting Machine (With complete accessories)	340
97	JCB make DG Set 80 KVA	740
98	Diesel Generating Set 82.5 KVA	680
99	Portable Jacking Oil Pump	1200
100	Alloy Analyser	1970

**HSEP14**

Health, Safety & Environment Plan for Site Operations by Subcontractors

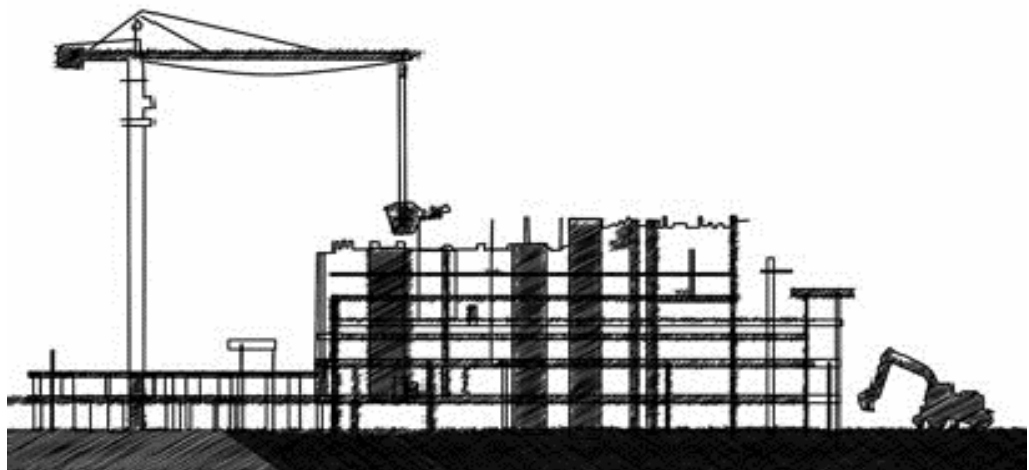

INDEX OF CONTENTS

SN	Description	Page No.
SECTION A: CRITICAL RESOURCES FOR HSE IMPLEMENTATION		
1	SHARING OF OPERATING COSTS OF FACILITIES	5
2	RESOURCES TO BE SOLELY PROVIDED BY CONCERNED SUBCONTRACTOR	5
3	ESTABLISHMENT OF COMMON FACILITIES	5
4	CRITICAL REQUIREMENTS W.R.T. EQUIPMENT & PPES	6
5	HSE PERSONNEL TO BE SOLELY PROVIDED BY THE SUBCONTRACTOR	8
6	COMPETENCY OF OPERATORS/ DRIVERS OF CRANE, WINCH, LIFTING/ CONSTRUCTION EQUIPMENT ETC.	11
7	STRINGENT REQUIREMENT OF BHEL'S CUSTOMER	11
8	REFERENCES	11
9	BHEL POWER SECTOR HSE MANAGEMENT SYSTEM	12
10	CLEARANCE OF MONTHLY RUNNING BILLS SUBJECT TO SAFETY COMPLIANCE	13
11	HSE PERFORMANCE EVALUATION	13
12	HSE PENALTIES	13
13	PUNITIVE ACTIONS ON WORKERS FOR CRITICAL SAFETY VIOLATIONS	16
14	LEGAL IMPLICATIONS	17
15	HSE REVIEW MEETING	17
16	OTHER REQUIREMENTS	18
17	MEMORANDUM OF UNDERSTANDING	19
SECTION B: OPERATIONAL REQUIREMENTS		
1	PURPOSE	22
2	SCOPE	22
3	OBJECTIVES AND TARGETS	22
4	BHEL HEALTH, SAFETY & ENVIRONMENT POLICY	23
5	ILLUSTRATIVE HSE RESPONSIBILITIES OF VARIOUS SUBCONTRACTOR OFFICIALS	24
6	HSE PLANNING BY SUBCONTRACTOR	27
7	MOBILIZATION OF MACHINERY/EQUIPMENT/TOOLS BY SUBCONTRACTOR	28
8	MOBILIZATION OF MANPOWER BY SUBCONTRACTOR	28
9	PROVISION OF PERSONAL PROTECTIVE EQUIPMENT (PPES)	29
10	ARRANGEMENT OF INFRASTRUCTURE	31
11	HSE TRAINING & AWARENESS	35
12	HSE COMMUNICATION AND PARTICIPATION	39
13	SAFETY DURING WORK EXECUTION	40

14	ENVIRONMENTAL CONTROL & SOCIAL RESPONSIBILITY	43
15	HOUSEKEEPING	44
16	WASTE MANAGEMENT	44
17	TRAFFIC MANAGEMENT SYSTEM	45
18	EMERGENCY PREPAREDNESS AND RESPONSE	48
19	HSE INSPECTION	49
20	TERMS AND DEFINITIONS	52
	ANNEXURES	
A	ANNEXURE A: Specification of Ambulance	
A.1	ANNEXURE A.1: Typical calculation for sharing of operational cost of common facilities	
B	ANNEXURE B: Specifications of HSE Displays	
C	ANNEXURE C: HSE Tools, Equipment and Devices to be Provided by the Subcontractor	
D	ANNEXURE D: Specifications of Rest Sheds	
E	ANNEXURE E: Minimum Requirements of Labor Accommodation/ Colony	
F	ANNEXURE F: Specifications & Availability for Toilets at Site	
G	ANNEXURE G: Specifications for Numbers and Types of Fire Extinguishers	
H	ANNEXURE H: HSE Compliance Certificate Sample	
I	ANNEXURE I: Detailed Safety Requirements/ Precautions for Various Hazardous Activities/ Conditions	
J	ANNEXURE J: Details & Contents of First-Aid Box	
K	ANNEXURE K: Vertigo Test Procedure	

SECTION A

CRITICAL RESOURCES FOR HSE IMPLEMENTATION

1. SHARING OF OPERATING COSTS OF FACILITIES

TABLE A.1

SN	FACILITY
1	Ambulance with 24 hr. First Aid Trained Driver (Specs in Annexure A)
2	Operation of Medical center, Nurses, Medical Consumables etc. (Specs in Annexure A)
3	Training Center Consumables
4	Water sprinkling for dust suppression
	(Others:)

Note:

- Responsibility of operation of above facilities shall rest with BHEL
- Operating cost of the above shall be deducted from subcontractors on 'proportional to contract' value basis. Sample deduction table enclosed as Annexure A.1
- "Contract value" defined above & subsequently in the document shall be considered as "Awarded contract value".
- No overhead cost/ enabling cost of BHEL shall be levied on the contractors for common facilities.
- These running costs shall be recovered from all the available subcontractors at site for the complete operational duration of the site
- No overheads shall be charged on shared operating costs

2. RESOURCES TO BE PROVIDED SOLELY BY THE SUBCONTRACTOR

TABLE A.2

SN	ITEM	SPECIFICATIONS
1.	HSE DISPLAYS, Posters and signage	Annexure B
2.	HSE Tools/ Equipment/ Devices	Annexure C
3.	Rest Sheds for Workers	Annexure D
4.	Labor Colony	Annexure E
5.	Toilets (Latrines & Urinals) - in Site and Labor Colony	Annexure F
6.	Fire Extinguishers	Annexure G

Note:

In case subcontractor fails to provide the required resources, same will be procured and deployed by BHEL with applicable overhead on total procurement cost

3. ESTABLISHMENT OF COMMON FACILITIES

In green field projects BHEL shall arrange and provide the following facilities which shall be used by all subcontractors for their employees and workers. These shall be

- Medical Centre
- Safety park with facilities of audio-visual training & vertigo test center.
- No cost shall be deducted from the subcontractors for the structure part only.
- The running cost with basic inputs already mentioned at Point 1 above shall be shared by all contractors.
- The sub-contractors shall be required to ensure participation in trainings, medical checkup and vertigo test as per the guidelines laid in this document and required as per statutory HSE requirements.

- vi. However, in projects where in these facilities are not provided by BHEL, subcontractors shall ensure the training, medical/ vertigo test of all workers at site in consultation and guidance of BHEL HSE team at site in line with provisions of this document.
- vii. The overall onus of compliance to HSE practices pertaining to training, medical checkup including vertigo test shall lie on the subcontractor only.

4. CRITICAL REQUIREMENTS W.R.T. EQUIPMENT & PPES

- i. Conventional Hydra crane with carriage in front shall not be permitted. Pick & carry tyre mounted Front Cabin mobile crane (FX or TRX/ NextGen series of 'ESCORT' or equivalent make) shall only be permitted.
- ii. Any Heavy equipment (cranes, winch machines, etc.) shall be deployed only after pre-safety Inspection by safety dept. Valid AMCs/ Fitness/ other statutory clearances as per local rules shall be required to be submitted before mobilizing the equipment at site.
- iii. All other Hand tools and power tools should not be older than 5 years.
- iv. For Chimney passenger lift, winch to have double drum rope for passenger and double safety devices must be used. Winch should not more than 3 years old and winch rope must be inspected with valid certificate from competent authority within 6 months and should meet the IS standard 9507 provision of OLR and push back button arrangement or dead man switch.
- v. Gate pass for all the lifting T&Ps and construction machinery/ equipment shall be made after obtaining written acceptance (Pre-entry Safety Clearance) from BHEL Site Safety Department after physical verification and checking all requisite documents/ compliance to Safety norms
- vi. All motor vehicles should have valid registration certificate, insurance, Pollution under control (PUC) and fitness certificate as per Motor Vehicle Act 2020. The certificates should be pasted in the glass from inside.
- vii. PPEs shall be from reputed manufactures viz. 3M, Udyogi, Karam, Frontier, Freedom, Honeywell, Liberty, Bata, Nomex, Acme, Unicare, Life Gear or equivalent. In case Subcontractor recommends any other name the same can be approved at site level by the Construction manager & Site HSE
- viii. For height work, where fall could result in death or disability, a secondary means of fall protection (Safety Net, Retractable Fall Arrestor etc.) shall be mandatorily provided by the subcontractor, failing which, a penalty of INR 10000 per case will be imposed. In addition, there should be constant supervision for such critical height work. Any non-erection activities at height eg. Housekeeping etc. shall also fall under the category of height work
- ix. **Scaffold Tagging**

Scaffolds being erected, modified or dismantled must be tagged as suitable for use. Tagging shall be done with standard tag holder. Scaffolding tag should be certified by scaffolding inspector having valid certificate.

- **GREEN** scaffold tag- shall be fixed when scaffold is complete and safe for use, signed and dated by the scaffolding competent person daily.
- **RED** scaffold tag – to be fixed if scaffold is in some way defective and cannot be used or is still under erection.
- **YELLOW** scaffold tag – to be fixed if scaffold is in under construction/ maintenance.



FIG. A.4.1 SAMPLE SCAFFOLD TAGS AND TAG HOLDER

x. **T&P Color Coding:**

- a. Inspections and tests shall be documented by means of color coding which shall verify that inspections or testing are current and that all receptacles, portable Power tools, Lifting Tools & Tackles have been inspected and tested as required. The color codes used on the project shall be:

GREEN	BLUE	YELLOW	PURPLE
January	April	July	October
February	May	August	November
March	June	September	December

TABLE. A.4.2: T&P COLOR CODES

- b. The cycle of colors shall be Quarterly as a minimum or as decided by BHEL. The color code tape / Sticker shall be clearly visible to designate the period for which the inspections and tests were conducted.
- c. Following the initial inspection, the equipment must be color-coded quarterly as per color-coding instructions that will be issued by the subcontractor.
- d. Fire extinguisher with the current month color-coding inspection sticker must be provided and secured in the platform.
- e. All slings shall be regularly inspected in accordance with the requirement of the project for frequent and periodic inspections and discard immediately if they fail to meet the minimum requirements of the project.
- f. The Subcontractor's HSE Officer shall ensure that all PPE is inspected prior to its issue. He is to ensure all subcontractor personnel are using safe and proper PPE equipment. Regular

inspections on the PPE shall be carried out and personnel not adhering to those inspections shall be removed immediately from the site.

- g. A Ten (10) day interval period shall be given into each monthly color code change. During this Ten (10) day period either color shall be acceptable.

xi. **T&P Tagging:**

All deployed Wire Rope Slings, Chain Pulley Blocks, Hooks, slings etc. shall be Tagged using aluminum or any other metal tag with punching.

5. HSE PERSONNEL TO BE PROVIDED SOLELY BY THE SUBCONTRACTOR

5.1. NUMBERS OF HSE PERSONNEL (APPLICABLE FOR EACH WORK SHIFT)

Number of HSE Officers and Supervisors shall be in proportion to number of workers as per Table A.6 below

TABLE A.5

No. of Workers	No. of HSE Supervisors	No. of HSE Officers
Up to 100	1	1
101 to 250	2	1
251 to 500	4	1
501 to 1000	6	2
1000 to 2000	6+ One additional supervisor up to every additional 250 workers	3
2000-3000	10+ One additional supervisor up to every additional 250 workers	4
3000-4000	14+ One additional supervisor up to every additional 250 workers	5

5.1.1. DEPLOYMENT PLAN

- Above requirement is for every shift for each unit.
- The dynamic deployment plan of Safety manpower at various locations containing names, areas, time periods, shifts etc. shall be submitted to BHEL for approval by subcontractor
- BHEL may modify the deployment plan based on nature and volume of jobs, Risks and hazards associated etc.
- For less than 20 workers HSE Officer is not mandatory. In case the number of workers exceed 20 for 3 consecutive months, HSE Officer is to be engaged. The HSE Officer shall be deployed for a minimum period of 6 months even if the number of workers fall below 20 in any month subsequent to deployment. If within that 6-month period, the number of workers is more than 20 for at least 3 months, the deployment duration of HSE Officer will extend further 6 months after completion of previous 6-month period.
- For Site Material Management/ Handling (Loading/ Unloading) contracts, 1 no. HSE Officer shall be required irrespective of the total manpower deployed.
- HSE Officers/Supervisors of all the vendors may be required to report directly to BHEL HSE Officer at site & shall comprise as a total team for handling all HSE issues. However, each safety officer/ agency shall be individually responsible for the safe execution of work in their respective areas.

5.2. QUALIFICATION & EXPERIENCE REQUIREMENTS OF HSE PERSONNEL

5.2.1. HSE OFFICER

First HSE Officer to be mandatorily as per Option I as under and shall be designated Senior HSE Officer. In case of non-availability of HSE Officers with Option I configuration, the subsequent HSE Officers can be as per Option II below with recorded reasons and approval of Site Construction Manager of BHEL. All these deviations should be reported to Region HSE and PSHQ HSE.

A. Option I

- i. possesses a recognized degree in any branch of engineering or technology or architecture and had a practical experience of working in a building or other construction work in a supervisory capacity for a period of not less than two years or possesses a recognized diploma in any branch of engineering or technology and has had practical experience of building or other construction work in a supervisory capacity for a period of not less than five years;
- ii. possesses a recognized degree or diploma in industrial safety with at least one paper in construction safety (as an elective subject/ part thereof);
- iii. has adequate knowledge of the language spoken by majority of building workers from the construction site in which he is to be appointed.

B. Option II:

Graduation Degree in Science with Physics & Chemistry and degree or diploma in Industrial Safety (All Degrees/ Diploma from any Indian institutes recognized by AICTE or State Council of Technical Education of any Indian State) with practical experience of working in a building, plant or other construction works (as HSE Officer, in line with Indian Factories Act, 1958 or BOCW Act, 1996) for a period of not less than five years

Note:

- i. HSE Officer as per Option II shall be valid only on availability of Senior HSE Officer as per Option I at site.
- ii. In case of resignation of the Senior HSE Officer, the same has to be replaced within 15 days else all subsequent HSE Officers as per Option II (in case of multiple HSE Officers with a single agency) shall not be considered as valid.
- iii. The penalty shall be deducted considering non-availability of any HSE Officer at site.

5.2.2. HSE SUPERVISOR: EITHER OF X OR Y BELOW

X. Recognized Degree in any branch of Engineering OR Diploma in any branch of engineering with at least one-year construction experience

OR

Y. A recognized graduation Degree in Science (with Physics & Chemistry) or a recognized diploma in Engg. or Tech.

Additional requirements for option (Y) above

Bharat Heavy Electricals Limited, Power Sector

Regd. Office: BHEL House, Siri Fort, New Delhi-110049

- i. Trained in fire-fighting as well as in safety / occupational health related subjects, with:
- ii. Minimum Two years of practical experience in construction work environment or in the field of safety and

Note:

- i. Option a above is by default, b is under special approval from Site HSE & Construction manager
- ii. In both cases the candidate should possess requisite skills to deal with construction & fire safety related day-to-day issues.

5.3. HSE IN-CHARGE

In case there is more than one HSE Officer with any subcontractor, one of them, who is senior most by experience & meets qualification as per option 1 as mentioned in clause 2.1 A above (in HSE discipline), may be designated as HSE In-charge who will be the nodal point of contact on HSE matters.

5.4. SUPPORTING STAFF TO HSE TEAM

- i. Supporting Staff shall include scaffolders, scaffolding inspectors, riggers, skilled and unskilled manpower
- ii. Subcontractor shall provide adequate number of workers as and when required, in order to attend and comply to Safety observations raised by BHEL/ Customer.

5.5. AVAILABILITY AND PENALTY FOR NON-DEPLOYMENT

- i. The subcontractor shall submit the certificates of qualification & experience of HSE manpower before deployment for BHEL to assess suitability as per requirement detailed in this document
- ii. In case of rejection, subcontractor shall arrange additional candidates and submit resume to BHEL. Penalties will be applicable during the period of non-deployment in such cases as well.
- iii. Subcontractor shall ensure physical availability of safety personnel at the place of specific work locations.
- iv. The Subcontractor shall deploy the HSE Officers as per the site's requirement. Non-deployment shall lead to stoppage of the work and final decision shall rest with Site HSE & Construction manager.
- v. The Subcontractor shall prepare an organization chart identifying the areas of operations, responsibilities and reporting structure of all safety personnel for each shift and submit the same to BHEL.
- vi. The subcontractor shall deploy sufficient HSE Officers, supervisors, as per numbers & qualifications mandated in this Section since mobilization of first batch of manpower and add more in proportion to the added strength in work force. Any delay in deployment will attract a penalty at following rates:

Non-deployment of HSE Officer –	Rs. 75,000 per man-month
Non-deployment of HSE Supervisor –	Rs. 50,000 per man-month

- vii. Penalty shall be collected for the period of non-availability of safety personnel after allowing a grace period of 15 days for finding a replacement. The same shall be deducted on pro-rata basis till the required manpower is deployed.
- viii. In case of abnormal delay & frequent rejections of candidates proposed by the subcontractor, BHEL shall exercise the right to deploy the safety manpower & deduct the amount from subcontractor's running bill with applicable overheads. In such cases also, the provision of logistics, transportation, food and other logistical support to the HSE personnel shall be in the scope of subcontractor in addition to the salary. After deployment of manpower by BHEL, the penalty for non-deployment specified above shall not be applicable.

6. COMPETENCY OF OPERATORS/ DRIVERS OF CRANE, WINCH, LIFTING/ CONSTRUCTION EQUIPMENT ETC.

- i. The Operators/ Drivers of crane, winch, construction/ lifting equipment etc. shall be experienced and have valid driving license for the class of vehicle / machinery as applicable (like Crane/ Forklift/ Rig, Construction equipment driving license etc.).
- ii. Minimum HMV driving license is required for all heavy equipment/ heavy vehicle (trailer/ Hyva /dumper /TM) operators at site.
- iii. The subcontractor shall certify competence of these persons in writing as and when they are posted at site.
- iv. Crane, Winch, Construction & lifting equipment operator should have certificate on subject course or experience certificate in employer letterhead.
- v. Where state is providing license for operating crane, tractor and other construction vehicles, same to be ensured.

Note: In case the statutory requirements i.e. State or Central Acts and / or Rules as applicable like the Building and Other Construction Workers' Regulation of Employment and Conditions of Service- Act,1996 or State Rules (wherever notified), the Factories Act, 1948 or Rules (wherever notified), etc. are more stringent than above, the same shall be followed.

- 7. In case of any stringent requirement of BHEL's customer over and above the specifications mentioned in current document, the same shall also be required to be complied at site by subcontractor.

8. REFERENCES

The Safety Rules for Construction & Erection as outlined hereunder, while setting out a broad parameter of safety norms, are not exhaustive. The subcontractor and his agencies are advised to refer to the following statutory provisions as amended from time to time for details and strict compliance therewith.

8.1.FOR GREENFIELD PROJECTS

- a) Building and Other Construction Workers (regulation of employment and conditions of service) Act, 1996 (briefly referred to as BOCW Act),
- b) Building and other construction workers (regulation of employment and conditions of service) Central Rules, 1998 (briefly referred to as BOCW Rules) as adopted by the various State Governments,

8.2. FOR EXPANSION, MODIFICATION, ALTERATION AND, OR CONSTRUCTION ACTIVITY WITHIN AN EXISTING PLANT OPERATING AS PER APPROVED SITE PLAN UNDER THE FACTORIES ACT

- a) Factories Act, 1948,
- b) Factories Rules, as adopted by the various State Governments
- c) BOCW Act
- d) BOCW Rules
- e) In case a new act/ statutory guideline/ modification/ consolidation of acts is implemented the same shall be required to be adhered by the subcontractor.
- f) The latest amendment of the above-mentioned acts/ rules shall be followed at site.

9. BHEL POWER SECTOR HSE MANAGEMENT SYSTEM

The Systems and procedures of BHEL Power Sector HSE Management System shall be implemented by the subcontractor, including:

- HSE PROCEDURE FOR REGISTER OF OHS HAZARDS AND RISKS
- HSE PROCEDURE FOR REGISTER OF ENVIRONMENTAL ASPECTS AND IMPACTS
- HSE PROCEDURE FOR REGISTER OF REGULATIONS
- HSE PROCEDURE FOR TRAINING AND AWARENESS
- HSE PROCEDURE FOR EMERGENCY PREPAREDNESS AND RESPONSE PLAN
- HSE PROCEDURE FOR PERMIT TO WORK
- HSE INSPECTION AND OTHER FORMATS

Note:

- i. BHEL reserves the right to revise/ update these systems and procedure as per requirement to address any changing HSE needs
- ii. BHEL will provide hard / soft copies of applicable HSE Procedures, Work Permits, Operational Control Procedures, Inspection/ Other Formats etc. that are necessary for ensuring safe work to the successful bidder at Site. It is the responsibility of the subcontractor to ensure availability of these documents before commencing work at site.
- iii. The subcontractor can get soft copies of these documents from respective Region SCT/ HSE for reference. The signed hard copies of the same shall not be required to be submitted along with tender document
- iv. Subcontractor shall use the Digital (Web & App-Based) HSE management Software Systems provided by BHEL whenever provided. In case not provided, hard copy systems will continue to be used. All information technology resources (Computers, mobile phones, mobile data, internet access etc.) for the use of such systems shall be ensured by the subcontractor.

10. CLEARANCE OF MONTHLY RUNNING BILLS SUBJECT TO SAFETY COMPLIANCE

- The monthly running Bills of the subcontractor shall be released subject to compliance to HSE requirements as per checklist in Annexure H
- BHEL site HSE Head and Package In-charge shall be authorized to issue the clearance
- Site Construction Manager of BHEL shall be the final authority on the matter.

11. HSE PERFORMANCE EVALUATION

- Subcontractor shall be assessed on monthly basis for HSE Compliance by BHEL Safety In-charge at site.
- The HSE evaluation shall be based on HSE Performance Evaluation System of BHEL covering the contractual, statutory and regulatory requirements of HSE.
- BHEL shall reserve the right to use these performance scores for evaluating bidder's capacity for future tenders
- If safety record of the subcontractor in execution of the awarded job is to the satisfaction of safety department of BHEL, issue of an appropriate certificate to recognize the safety performance of the subcontractor may be considered by BHEL after completion of the job, provided the execution performance is satisfactory.

12. HSE PENALTIES

- Nonconformity of safety rules and safety appliances will be viewed seriously and BHEL has right to impose fines on the subcontractor for every instance of violation noticed.
- As per contractual provision HSE penalties shall be imposed on subcontractors for non-compliance on HSE requirement as per following format.
- Following are the applicable penalties for various Safety violations:

Sub: MEMO for Penalty for non-compliances in Safety

Following lapse (tick marked) was observed and penalty (in Rs.) is imposed as stated at the bottom of this memo. It is requested that such occurrences be please avoided in future.

S. No	Nature of Non - Compliance	Penalty (in INR)	Remarks
A. System Violations			
1	Working without valid Work Permit/ HIRA/ Method Statement / JSA	2000	Per case
2	Controls as per Work Permit/ HIRA/MS/JSA not ensured	2000	Per case
3	Reported Safety Violations Not Closed within Stipulated Time	1000-10000	Per case
4	Absence of required Subcontractor Officials (Site Head, HS Head) in Safety Reviews/Meetings	5000	Per case
5	Not providing required PPEs (Safety Harness, Lifeline, Safety Net, Fall arrestor, Safety Helmet, Gloves, Shoes etc.) for the work by subcontractor	2000	Per case
B. Competency/ Training/ Induction Violations			

1	Incompetent personnel deployed for specialized jobs like height work, hot work, rigging, vehicle operation etc. (without valid license/ certificate etc.)	3000	Per case
2	Work without induction training & medical check	2000	Per case
3	Height Work without Vertigo Test and height work training	2000	Per case
C. PPE Violations – Height Work			
1	Not wearing/ hooking Double Lanyard Safety Harness while working at height (> 1.2 meters) or not anchoring to lifeline	1000	Per case
2	Not Providing Lifeline for height work	3000	
3	Unsafe platforms – without Top, Mid Rails and Toe-Guards for Height Work	3000	
4	Not providing secondary means of fall protection for height work (Safety Nets, Retractable Fall Arrestors etc.)	3000	Per case
D. PPE Violations – General			
1	Not wearing safety helmet	1000	Per case
2	Wearing of helmets without chin straps	1000	Per case
3	Not Wearing safety shoes	500	Per case
4	Not wearing gloves	500	Per case
6	Not using grinding goggles/ face shield during grinding/ cutting	2000	Per case
E. Electrical Safety Violations			
1	Broken/ exposed wires/ cables	2000	Per case per day
2	Electrical plug not used for connection/ hand machines	1000	Per case per day
3	Not using proper ELCBs for electrical equipment	2000	Per case per day
4	Improper earthing of welding & Other electrical machines (Lack of double earthing, improper/ untested earth pit etc.)	2000	Per case per day
5	Not using 24 V supply for lighting in confined spaces	2000	Per case
6	Cables haphazard/ blocking way/ not organized properly	1000	Per case per day
F. Lifting & Rigging Violations			
1	Using Sling/ Chain Pulley Block and other Small T&Ps without proper, traceable Tag and Test Certificate	2000	Per T&P per day
2	Using damaged slings or not slinging properly	2000	Per T&P per day
3	Use of lifting equipment without having valid Test certificate	5000	Per equipment per seven days
4	Lifting hooks used without latches	2000	Per hook per day
5	Not effectively barricading area below lifting activity	5000	Per case
6	Using untrained/ unqualified rigger	5000	Per case
G. Housekeeping			
1	Non-removal of scrap from platforms	5000	Per Event Per location per 7 days
2	Not conducting scheduled housekeeping drives	5000	Per drive
H. Hot Work Safety Violations			
1	Gas cutting without flash back arrestor at both ends	5000	Per machine per incidence
2	Gas cutting at height without fire blanket	2000	Per event

3	Not keeping gas cylinders vertically	2000	Per event
4	Lifting cylinders without cage or rolling of cylinders	2000	Per incidence
5	Leakage in gas cylinder	2000	Per incidence
I. Vehicle Safety/ Operation			
1	Not having valid driving license for the type of vehicle/ T&P	2000	Per driver per incidence
2	Two-wheeler entry in construction area	2000	Per vehicle
3	Using Hydra for material movement at site in unsafe manner	2000	Per case
4	Using Two Hydra in Tandem for material movement without proper precautions as per OCP	2000	Per case
5	Vehicles, Hydras, Cranes, Dumpers and Earth Movers not having automatic back horns linked to gear	2000	Per Equipment per day
6	Not providing proper hard barricades around excavations/ unpermitted areas	5000	Per location per day
7	Not using guide rope while transporting material using Hydra or Cranes	2000	Per event
8	Over speeding	5000	Per case
9	Using Conventional Hydra crane	50000	Per day /crane
J. Accidents/ Incidents/ Near Misses			
1	Non-reporting of Near Miss/ Incident	20000	Per case
2	Major Accident – Worker unable to resume work within 48 hrs	100000	Per incident
3	Fatal Accident	500000	Per incident
K. Miscellaneous			
1.	Not providing the facility (drinking water, rest shed, labor colony etc. as per the specifications/ requirement)	5000	Per month per violation
2.	Not nominating the required number of workers for training as per plan	5000	Per incidence
3.	Lack of proper arrangement for disposal of sewage/ waste water/ effluents etc.	10000	Per incidence

Details (if any) related to non- compliance (Name of persons, Nature of deficiency, etc.):

Penalty Amount:

1. Rate as per above chart
2. No. of Persons/ machine/ event/ labor
3. No. of times the same error is repeated: Repetition factor
4. Total Penalty= 1. X 2. X 3. =

Witnessed by:

(Sub- Subcontractor representative)
representative)

(BHEL

Signature

Name

Bharat Heavy Electricals Limited, Power Sector

Regd. Office: BHEL House, Siri Fort, New Delhi-110049

Distribution: 1 Copy: to Sub- subcontractor Site In-charge,
1 Copy to Site Construction Manager (BHEL)
1 Copy to Site Finance

Note:

- i. In case the amount of penalty imposed by BHEL's Client on BHEL for Safety violation/ incident due to or in the area of the subcontractor is more than those indicated above, same shall be imposed back-to-back on the subcontractor. However, in case such an amount is less than the specified above, penalty amount indicated above shall be imposed on the subcontractor.
- ii. For same violation only one penalty (higher of the two mentioned below) shall be applicable
 - a. Penalty imposed by BHEL's Customer over BHEL.
 - b. Penalty as indicated in current document.
- iii. For repeated violation for the same equipment/ location, the penalty would be double of the previous penalty. Date of "Repeated violation" will be counted from subsequent days.
- iv. For repeated fatal incident in the same Unit incremental penalty shall be imposed: The subcontractor will pay 2 times the previously paid penalty in case there is repeated major/ fatal incident under the same subcontractor for the same package in the same unit.
- v. Any other non-conformity noticed not listed above will also be fined as deemed fit by BHEL. The decision of BHEL engineer is final on the above.
- vi. If principal customer/statutory and regulatory bodies impose some penalty on HSE due to the non-compliance of the subcontractor the same shall be passed on to them.
- vii. The penalty amount shall be recovered by BHEL Finance department from subcontractors from the RA/Final bill.

13. PUNITIVE ACTIONS FOR "CRITICAL SAFETY VIOLATIONS":**"Critical Safety Violations" include:**

- i. Not wearing required PPEs when provided and not following safe work procedure
- ii. Taking unnecessary risks especially in height work, hot work, radiation work, lifting activity
- iii. Coming to work under influence of sedatives like alcohol, drugs etc.
- iv. Coming to work without ID Card/ Gate Pass (if provided)
- v. Intimidating/ threatening at work
- vi. Using cell phones during height work, hot work, lifting activity, driving.

In case any worker carries out any of the critical safety violations as above, BHEL reserves the right to enforce punitive action in following manner:

First Offence:	1 Punch on Gate Pass/ Induction Card/ ID Card etc. and 1-hour HSE Training. With one day off from duty
Second Offence:	2 Punches and 2-hours HSE Training with one day off from duty

Third Offence:	3 Punches and the worker will be dismissed. Gate pass to be confiscated
-----------------------	---

In case any employee of subcontractor carries out any of the critical safety violations as above, subcontractor Site In-charge shall issue warning letter to concerned employee with copy to BHEL

Note:

- i. For above violations, guilt of the worker/ employee has to be established through appropriate evidences and records maintained.
- ii. If worker/ employee has not been given the required PPEs and safety equipment by the agency and/or not facilitated by the agency to follow safety rules, he/ she will not be considered liable but the agency will be penalized as per penalty provision in this document. In such cases, the subcontractor shall not pass the penalty over to the worker/ employee through wage deduction etc.
- iii. These critical safety violations and their consequences shall be shared with all workers and employees during induction and other training programs/ meetings, toolbox talks etc.
- iv. Gate Pass shall have provision of Tagging as indicated above
- v. The appellate authority (only for final dismissal) in this case shall be the BHEL Site In-charge whose decision shall be final on the matter and binding on all parties.

14. LEGAL IMPLICATIONS

Any legal Costs incurred by BHEL, on account of accidents taking place in the activities of the subcontractor, shall be debited to the subcontractor on actual cost basis.

For any accident occurring at site to any worker/ employee of the subcontractor leading to legal implications to BHEL Employee/ Management shall be safeguarded by BHEL legal department. All legal expenses incurred by BHEL on this account shall be recovered from the subcontractor. The accident also includes fire, loss of property or life at site.

15. HSE REVIEW MEETING

- i. Subcontractor Site In-charge and HSE In-charge shall attend the HSE Review Meeting as and when called by BHEL.

The indicative agenda points are given below:

- a) Implementation of earlier MOM points
- b) Compliance Status of HSE Observations
- c) Incidents & Near Misses, their Root Causes and Actions Taken
- d) HSE performance review
- e) HSE inspection findings
- f) HSE audit and CAPA
- g) HSE training
- h) Health check-up camp
- i) HSE planning for the erection and commissioning and installation activities in the coming month

- j) HSE reward and promotional activities
- ii. MOM on the discussion along with HSE observations will be circulated to the subcontractor for action.
- iii. The subcontractor shall close the observations to the satisfaction of BHEL within stipulated time frame

16. OTHER REQUIREMENTS

- i. If the subcontractor fails to improve the standards of safety in its operation to the satisfaction of BHEL after being given reasonable opportunity to do so and/or if the subcontractor fails to take appropriate safety precautions or to provide necessary safety devices and equipment or to carry out instruction regarding safety issued by BHEL, BHEL shall have the right to take corrective steps and the cost shall be debited to the subcontractor with applicable overheads.
- ii. If the subcontractor succeeds in carrying out its job in time without any fatal or disabling injury incident and without any damage to property BHEL may, at its sole discretion, favorably consider to reward the subcontractor suitably for the performance.
- iii. In case of any damage to property due to lapses by the subcontractor, BHEL shall have the right to recover the cost of such damages from the subcontractor after holding an appropriate enquiry.
- iv. The subcontractor shall take all measures at the sites of the work to protect all persons from incidents and shall be bound to bear the expenses of defense of every suit, action or other proceeding of law that may be brought by any persons for injury sustained or death owing to neglect of the above precautions and to pay any such persons such compensation or which may with the consent of the subcontractor be paid to compromise any claim by any such person, should such claim proceeding be filed against BHEL, the subcontractor hereby agrees to indemnify BHEL against the same.
- v. The subcontractor shall not employ men below the age of 18 years and women on the work of painting with products containing lead in any form. Wherever men above the age of 18 are employed on the work of lead painting, overalls shall be supplied by the subcontractor to the workmen and adequate facilities shall be provided to enable the working painters to wash during the cessation of work.
- vi. The subcontractor shall notify BHEL of his intention to bring to site any equipment or material which may create hazard.
- vii. BHEL shall have the right to prescribe the conditions under which such equipment or materials may be handled and the subcontractor shall adhere to such instructions.
- viii. BHEL may prohibit the use of any construction machinery, which according to the organization is unsafe. No claim for compensation due to such prohibition will be entertained by BHEL.

17. MEMORANDUM OF UNDERSTANDING:

After award of work, subcontractors are required to enter into a memorandum of understanding as given below:

Memorandum of Understanding

BHEL, Power Sector Region is committed to Health, Safety and Environment Policy (HSE Policy).

M/s.....do hereby also commit to comply with the same HSE Policy while executing the Contract Number _____

M/s.....have gone through and understood all the HSE requirements of the contract including HSE manpower, tools & equipment, systems & procedures, and agree to fulfill the same as a minimum. Any additional resources and support required for ensuring fulfillment of HSE Objectives shall be provided by subcontractor at no extra cost.

M/s..... agree that in case they fail to comply to the HSE requirements as stipulated in the contract, BHEL shall have the right to implement the same and the cost shall be recovered from the subcontractor with applicable overheads.

M/s..... shall ensure that safe work practices as per the HSE plan. Spirit and content therein shall be imbibed in all workers and supervisors for compliance.

In addition to this, M/s.....shall comply to all applicable statutory and regulatory requirements which are in force in the place of project and any special requirement specified in the contract document of the principal customer.

M/s.....shall co-operate in HSE audits/inspections conducted by BHEL /customer/ third party and ensure to close any non-conformity observed/reported within prescribed time limit.

M/s..... agree that the subcontractor shall seek HSE clearance as per BHEL format before each RA bill as mentioned in clause no. 9. The penalty amounts for not providing Safety manpower and various Safety violations have also been reviewed and agreed.

M/s..... agree to share the HSE Costs (running costs) of common facilities created by BHEL on proportional to contract value basis as calculated at Site by BHEL.

Signed by authorized representative of M/s -----

Name :

Place & Date:

SECTION B

OPERATIONAL REQUIREMENTS

1. PURPOSE:

- 1.1. The purpose of this HSE Plan is to provide for the systematic identification, evaluation, prevention and control of general workplace hazards, specific job hazards, potential hazards and environmental impacts that may arise from foreseeable conditions during installation and servicing of industrial projects and power plants.
- 1.2. This document shall be followed by BHEL's subcontractors at all installation and servicing sites. In case customer specific documents are to be implemented, this document will be followed in conjunction with customer specific documents in complementary manner.
- 1.3. Although every effort has been made to make the procedures and guidelines in line with statutory requirements, in case of any discrepancy wherein the relevant statutory guidelines supersedes this document, the same shall be followed.
- 1.4. In case there's any specific HSE requirement from BHEL's Client, not explicitly indicated in this document the same shall be required to be fulfilled as per the decision of BHEL Site construction manager.

2. SCOPE:

The document is applicable to BHEL's Subcontractors at all installation / servicing activities of BHEL Power Sector as per the relevant contractual obligations

3. OBJECTIVES AND TARGETS:

- i. To achieve "Zero Incident at Site"
- ii. 100% compliance to all legal/statutory requirements related to EHS.
- iii. 100% Health, Safety and Environmental Induction training attendance for all workers.
- iv. 100% High Risk activities to be carried out only after approved Method Statement, HIRA / Aspect-Impact / JSA / OCP and Permit to Work are implemented.
- v. 100% PPEs compliance in high and medium risk activities.
- vi. 100% incident reporting, recording and reviewing for corrective actions.
- vii. Regular Safety Reviews to assess HSE program compliance and closure of any recognized gaps to improve safety management and incident prevention
- viii. Prevent injury and ill health of all workers at site ('Workers' refers to all personnel including managerial, supervisory, professional, technical, clerical and other workers including contract laborers)
- ix. Prevent pollution to environment
- x. Ensure the Health and Safety of all persons at work site is not adversely affected by the work.
- xi. Ensure protection of environment of the work site.
- xii. Comply at all times with the relevant statutory and contractual HSE requirements.
- xiii. Provide trained, experienced and competent personnel. Ensure medically fit personnel only are engaged at work.
- xiv. Provide and maintain plant, places and systems of work that are safe and without risk to health and the environment.

- xv. Provide all personnel with adequate information, instruction, training and supervision on the safety aspect of their work.
- xvi. Effectively control, co-ordinate and monitor the activities of all personnel on the Project sites including subcontractors in respects of HSE.
- xvii. Establish effective communication on HSE matters with all relevant parties involved in the Project works.
- xviii. Ensure that all work planning considers all persons that may be affected by the work.
- xix. Ensure fitness testing of all T&Ps/Lifting appliances like cranes, chain pulley blocks etc. are to be certified by competent person.
- xx. Ensure timely provision of resources to facilitate effective implementation of HSE requirements.
- xxi. Ensure continual improvements in HSE performance.
- xxii. Ensure conservation of resources and reduction of wastage.
- xxiii. Capture the data of all incidents including near misses, process deviation etc. Investigate and analyze the same to find out the root cause.
- xxiv. Ensure timely implementation of correction, corrective action and preventive action.
The subcontractor shall also comply with HSE Targets stipulated by BHEL from time to time.

4. BHEL HEALTH, SAFETY & ENVIRONMENT POLICY:

In BHEL, Health, Safety and Environment (HSE) responsibilities are driven by our commitment to protect our employees and people we work with, community and environment. BHEL believes in zero tolerance for unsafe work/non-conformance to safety and in minimizing environmental footprint associated with all its business activities. We commit to continually improve our HSE performance by:

- ❖ Developing safety and sustainability culture through active leadership and by ensuring availability of required resources.
- ❖ Ensuring compliance with applicable legislation, regulations and BHEL systems.
- ❖ Taking up activities for conservation of resources and adopting sound waste management by following Reduce/Recycle/Reuse approach.
- ❖ Continually identifying, assessing and managing environmental impacts and Occupational Health & Safety risks of all activities, products and services adopting approach based on elimination/ substitution/reduction/control.
- ❖ Incorporating appropriate Occupational Health, Safety and Environment criteria into business decisions, design of products & systems and for selection of plants, technologies and services.
- ❖ Imparting appropriate structured training to all persons at workplace and promoting awareness amongst customers, subcontractors and suppliers on HSE issues.
- ❖ Reviewing periodically this policy and HSE Management Systems to ensure its relevance, appropriateness and effectiveness.
- ❖ Communicating this policy within BHEL and making it available to interested parties.

Chairman & Managing Director/ BHEL

Bharat Heavy Electricals Limited, Power Sector

Regd. Office: BHEL House, Siri Fort, New Delhi-110049

5. ILLUSTRATIVE RESPONSIBILITIES OF SUBCONTRACTOR EMPLOYEES

5.1 HSE - A LINE RESPONSIBILITY

- i. HSE is a "Line Responsibility".
- ii. The term "Line" includes management, Executives, Supervisors, Foremen, and Workers who are part of the workforce. Line is to be fully involved in HSE Planning & Implementation with the aid and advice of HSE organization.
- iii. "Line", having control of resources and manpower is responsible for overall implementation of HSE Systems and closure of HSE observations.

5.2 SITE IN -CHARGE:

- i. Shall sign Memorandum of Understanding (MoU)
- ii. Shall ensure availability of all necessary resources required for implementation of HSE at Site
- iii. Shall engage qualified HSE Officer(s) and supervisors (s)
- iv. Shall adhere to the rules and regulations mentioned in this code, practice very strictly in area of work in consultation with concerned engineer and the safety coordinator.
- v. Shall screen all workmen for health and competence requirement before engaging for the job and periodically thereafter as required.
- vi. Shall not engage any employee below 18 years.
- vii. Shall arrange for all necessary PPEs like safety helmets, belts, full body harness, shoes, face shield, hand gloves etc. before starting the job.
- viii. Shall ensure that all T&Ps engaged are tested for fitness and have valid certificates from competent person.
- ix. Shall ensure closure of all HSE non-conformities reported by BHEL or observed during internal inspection by providing appropriate resources in a timely manner.
- x. Shall ensure the implementation of provisions of applicable acts and rules pertaining to HSE.
- xi. Shall ensure availability of updated (Hazard Identification and Risk Assessment) Register for the area of activity
- xii. Shall ensure availability of Method Statements & Job Safety Analysis for all hazardous activities
- xiii. Shall ensure necessary controls to minimize risk in all applicable hazardous activities including Height Work, Hot Work, Lifting & Rigging, Confined Space, Maintenance, excavation, Radiography, Loading/ Unloading, Drilling/ Blasting etc.
- xiv. Shall ensure implementation of HSE requirements mentioned in this document and as specified in the BHEL HSE management System including training, inspection, awareness, reporting etc.
- xv. Shall ensure that person working above 2.0 meter should use Safety Harness tied to a life line/stable structure.
- xvi. Shall ensure a secondary means of fall protection (Safety Net, Retractable Fall Arrestor etc.) for preventing fall from height
- xvii. Shall ensure that materials are not thrown from height. Cautions to be exercised to prevent fall of material from height.

- xviii. Shall report all incidents (Fatal/Major/Minor/Near Miss) to the Site engineer /HSE officer of BHEL.
- xix. Shall ensure that Horseplay is strictly forbidden.
- xx. Shall ensure that adequate illumination is arranged during night work.
- xxi. Shall ensure that all personnel working under subcontractor are working safely and do not create any Hazard to self and to others.
- xxii. Shall ensure display of adequate signage/posters on HSE.
- xxiii. Shall ensure that mobile phone is not used by workers while working.
- xxiv. Shall ensure conductance of HSE audit, mock drill, medical camps, induction training and training on HSE at site.
- xxv. Shall ensure full co-operation during HSE audits.
- xxvi. Shall ensure submission of look-ahead plan for procurement of HSE equipment's and PPEs as per work schedule.
- xxvii. Shall ensure good housekeeping.
- xxviii. Shall ensure adequate valid fire extinguishers are provided at the work site.
- xxix. Shall ensure availability of sufficient number of toilets (preferably bio-toilets) /restrooms and adequate drinking water at work site and labor colony.
- xxx. Shall ensure adequate emergency preparedness.
- xxxi. Shall be member of site HSE committee and attend all meetings of the committee
- xxxii. Power source for hand lamps shall be maximum of 24 v.
- xxxiii. Temporary fencing should be done for open edges if Hand – railings and Toe-guards are not available
- xxxiv. To record all incidents including near miss and report to BHEL and to ensure analysis & corrective actions for the same
- xxxv. Shall conduct weekly Safety Walks in the work area and record the findings.
- xxxvi. Construction of Canteen at Site, Office Infrastructure: Printer, PC, Fire Extinguishers etc.
- xxxvii. Shall analysis HSE Performance regularly in work area and take steps to improve the same
- xxxviii. Shall ensure stoppage of work in case of unacceptable Safety hazards

5.3 HSE OFFICER:

- i. Carry out safety inspection of Work Area, Work Method, Men, Machine & Material, P&M and other tools and tackles.
- ii. Facilitate inclusion of safety elements into Work Method Statement and creation of Job Safety Analysis (JSA)
- iii. (HSE Head) To prepare deployment plan of HSE personnel for all shifts, so as to ensure constant supervision of all areas. The plan to be submitted to BHEL
- iv. Highlight the requirements of safety through Tool-box / other meetings.
- v. Help concerned HOS to prepare Job Specific instructions/ JSA for critical jobs.
- vi. Conduct investigation of all incident/dangerous occurrences & recommend appropriate safety measures.
- vii. Advice & co-ordinate for implementation of HSE Systems & Procedures.
- viii. To stop work in case of any critical safety violation until the violation is cleared
- ix. Convene HSE meeting & minute the proceeding for circulation & follow-up action.

- x. Plan procurement of PPE & Safety devices and inspect their healthiness.
- xi. Report to BHEL on all matters pertaining to status of safety and promotional program at site level.
- xii. Facilitate administration of First Aid
- xiii. Facilitate screening of workmen and safety induction.
- xiv. Conduct fire Drill and facilitate emergency preparedness
- xv. Design campaigns, competitions & other special emphasis programs to promote safety in the workplace.
- xvi. Apprise BHEL on safety related problems.
- xvii. Notify site personnel non-conformance to safety norms observed during site visits / site inspections.
- xviii. Recommend to Site In charge, immediate discontinuance of work until rectification, of such situations warranting immediate action in view of imminent danger to life or property or environment.
- xix. To decline acceptance of such PPE / safety equipment that do not conform to specified requirements.
- xx. Encourage raising Near Miss Report on safety along with, improvement initiatives on safety.
- xxi. Shall work as interface between various agencies such customer, package-in-charges, subcontractors on HSE matters.

5.4 HSE SUPERVISOR:

- i. All requirements as per 5.1
- ii. To monitor allotted area for Safety violations, take required action and inform the concerned Safety Supervisor / Officer
- iii. To assist HSE Officer

5.5 PACKAGE IN-CHARGES, ENGINEERS & ALL EMPLOYEES:

- i. To be aware of, get involved in and ensure implementation of all HSE related Systems and Procedures including but not limited to:
 - a. BHEL HSE Management System including HSE Procedures and OCPs, HIRA, JSA etc.
 - b. Work Permit System
 - c. Emergency Preparedness Response Plans
 - d. Contractual HSE requirements
 - e. Legal Requirements
 - f. Penalty System
 - g. Training requirements
- ii. To ensure that the persons engaged in respective area follow the safety rules like using appropriate PPEs.
- iii. To develop Method Statements and ensure availability of Job Safety Analysis for all activities in scope
- iv. To ensure that the reported HSE non-conformities in the work area are resolved immediately before resuming work
- v. To record all incidents including near miss and report to BHEL.

- vi. To adopt safe working practices at all times and act as role model for Safety
- vii. To take immediate corrective action actions in case any non-conformity is observed on product / process / system with respect to Occupational Health, Safety and Environment.
- viii. In case any particular activity / work has extremely high consequential risk or high environmental impact, same shall be brought to the notice of BHEL Package In-charge before starting the work.
- ix. To interfere/ stop work as & when identified unsafe.
- x. To maintain & promote improved level of house-keeping all the time at site.
- xi. To support/co-operate with audit team members as & when safety audits are carried out.
- xii. To involve in investigation, if any incident occurs in his work area.
- xiii. To participate in safety promotional programs
- xiv. To attend the safety committee meeting, if member/invitee
- xv. To ensure that only fit T&Ps and qualified persons are engaged for all activities.
- xvi. Shall ensure that person working above 2.0 meter should use Safety Harness tied to a life line/stable structure.
- xvii. Shall ensure that materials are not thrown from height. Cautions to be exercised to prevent fall of material from height.
- xviii. Shall ensure that all T&Ps engaged are tested for fitness and have valid certificates from competent authorities.

6. HSE PLANNING BY SUBCONTRACTOR:

6.1 HAZARD ANALYSIS & RISK ASSESSMENT (HIRA), METHOD STATEMENT (MS) & JOB SAFETY ANALYSIS (JSA):

- i. Subcontractor shall identify all OHS Hazards and Risks applicable to all activities in scope and plan & implement the required control measures. HIRA Register shall be maintained.
- ii. Subcontractor shall develop Method Statements & Job Safety Analysis documents for all hazardous activities in scope and ensure the required control measures. Job Safety Analysis is to be attached along with any Work Permit request

6.2 REGISTER OF REGULATIONS:

Subcontractor shall prepare a register of applicable rules and regulations in the scope and plan to ensure compliance.

HIRA Register, Method Statements, Job Safety Analysis and Register of Regulations are dynamic documents and shall be revised (as applicable):

- i. At fixed frequency of 3 months
- ii. Addition/ deletion/ modification of a process/ activity
- iii. After an accident/ incident
- iv. After any change in applicable rules/ regulations/ laws.

6.3 MONTHLY HSE PLAN COVERING THE FOLLOWING AS A MINIMUM SHALL BE PREPARED AND SUBMITTED TO BHEL FOR APPROVAL:

- i. HSE Trainings covering all activities/ hazards/ workers
- ii. HSE Inspection Plan covering all areas/ activities/ equipment/ hazards
- iii. HSE Activities: Safety walks, Awards, housekeeping, reviews etc.

Note: Online/ App-based system shall be used for HSE Planning and Implementation/ Update whenever provided by BHEL otherwise Hard-copy based system shall continue

6.4 MONTHLY HSE PLANNING & REVIEW OF HSE ACTIVITIES ALONG WITH BHEL:

Monthly planning and review of HSE activities shall be carried out by subcontractor as per provided **format** jointly along with BHEL

7. MOBILIZATION OF MACHINERY/EQUIPMENT/TOOLS BY SUBCONTRACTOR:

- i. Subcontractor shall notify the engineer, of his intention to bring on to site any equipment or any container, with liquid or gaseous fuel or other substance which may create a hazard. The Engineer shall have the right to prescribe the condition under which such equipment or container may be handled and used during the performance of the works and the subcontractor shall strictly adhere to such instructions. The Engineer shall have the right to inspect any construction tool and to forbid its use, if in his opinion it is unsafe. No claim due to such prohibition will be entertained.
- ii. As a measure to ensure that machinery, equipment and tools being mobilized to the construction site are fit for purpose and are maintained in safe operating condition and complies with legislative and owner requirement, inspection shall be arranged by in-house competent authority for acceptance as applicable. Inspection by Third Party competent person shall be arranged:
 - a. Before first time use at site
 - b. After carrying out any modification
 - c. After repairs subsequent to involvement in any accident/ incident
- iii. As a further measure to ensure that machinery, equipment and tools being mobilized to the construction site are fit for purpose and are maintained in safe operating condition and comply with legislative and owner requirement, inspection as per provided format shall be arranged by in-house expert / competent authority (preferable) for acceptance. The equipment considered for this purpose shall include all those in the T&P list in the tender document.

8. MOBILIZATION OF MANPOWER BY SUBCONTRACTOR:

- i. As a measure to ensure that manpower being mobilized to the construction site is fit and competent for safe working, screening arrangement shall be made by the sub-subcontractor to ensure competency and fitness through following measures:
 - a) **Medical Checkup:** Examination of medical fitness shall be conducted through qualified medical professional for all workers to be deployed as per provided **format**. For height workers, vertigo (height phobia) test to be carried out as qualification criteria as per Annexure K and recorded in provided **format**.

- b) **Induction Training:** Induction training of all workers to be ensured as per **provided procedure and format**. Training evaluation to be carried out and training to be repeated if not passed
- c) Only on successfully meeting above criteria, permanent gate passes to be issued
- ii. The subcontractor shall arrange induction and regular health check of their employees as per schedule VII of BOCW rules by a registered medical practitioner.
- iii. The subcontractor shall take special care of the employees affected with occupational diseases under rule 230 and schedule II of BOCW Rules. The employees not meeting the fitness requirement should not be engaged for such job.
- iv. Ensure that the regulatory requirements of excessive weight limit (to carry/lift/ move weights beyond prescribed limits) for male and female workers are complied with.
- v. Appropriate accommodation to be arranged for all workmen in hygienic condition.
- vi. Cost of contractual, statutory and regulatory requirements like Training, medical checks, PPEs etc. shall not be transferred to the workers and such activities shall be considered as part of the job.

9. PROVISION OF PERSONAL PROTECTIVE EQUIPMENT (PPEs):

- i. Personnel Protective Equipment (PPEs), shall be provided by the subcontractor to all workers as per requirement of the job.
- ii. The choice of PPEs to ensure multiple (at least more than 1) means of protection against any hazard. All applicable safety precautions for a job shall be ensured notwithstanding the duration or perceived importance of the task.
- iii. The applicability of PPEs shall be as per the concept of Hierarchy of controls, i.e.:
- iv. Elimination->Substitution->EngineeringControls->AdministrativeControls-PPEs
- v. Relying solely on PPEs without ensuring necessary controls to be strictly avoided.
- vi. The following matrix recommends usage of minimum PPEs against the respective job.

Activity	Type of Protection						Remarks, if any
	Hand	Eye	Ear	Body	Respiratory	Others	
Gas Welding & Cutting	LG	WG	-	LA	*SCBA/ OLBA	-	* for confined space
Electric Arc Welding	LG	HMWS	-	LA	*SCBA/ OLBA	-	* for confined space
Rigging	CG	SG	-				--
Working at Height	-	SG	-	DLCBH	-	*FAS	* for vertical columns
Grinding & Chipping	CG	FS / SG	-	LA	-	-	--
Working in High Noise	-	-	EP / EM	-	-	-	--
Handling of Cement Concrete	RG	SG	-	-	DM	-	

Blasting	CG	SG	EP*	-	-	-	* at noise area
Excavation	CG	SG	-	-	DM	-	*Gum boot in place of Safety shoe for foot
Chemical Handling	PVCG	CSG	-	PVCA	-	-	*Full body rubber suit with hood
Electrical and C&I	ERG*	SG	-	-	-	-	*For high voltages
Sand/shot blasting	CG	-	EP/EM	CA	SAMH	-	

ABBREVIATIONS: FS: Face Shield, CSG: Chemical splash goggles, HMWS: Helmet mounted welder's shield, GB: gum boot, DLFH: Double lanyard full body harness, SG: Safety goggles, DM: Dust mask, SAMH L Supplied air mask/hood, EP/EM: Ear plug/Ear Muff, CG: Cotton hand gloves, LG: Leather hand gloves, LA: Leather apron, RG: Rubber gloves, PVCG: PVC Gloves, PVCA: PVC Apron, SCBA: Self-contained breathing apparatus, WG: Welding goggles, ERG: Electrical Rubber Gloves. OLBA: Online breathing apparatus

The list is not exhaustive. Additional PPEs to ensure Safe Work may need to be deployed as per the requirement of the task at no additional cost.

- vii. The PPEs shall conform to the relevant standards as below (illustrative list) and bear ISI mark.

RELEVANT IS-CODES FOR PERSONAL PROTECTION

PPEs	IS Codes
Industrial Safety Helmets.	IS: 2925 – 1984
Rubber gloves for electrical purposes.	IS: 4770 – 1968
Industrial Safety Gloves (Leather & Cotton Gloves).	IS: 6994 – 1973 (Part-I)
Leather safety boots and shoes.	IS: 1989 – 1986 (Part-I-II)
Industrial and Safety rubber knee boots.	IS: 5557 – 1969
Code of practice for selections care and repair of Safety footwear.	IS: 6519 – 1971
Leather Safety footwear having direct molding sole.	IS: 11226 – 1985
Eye protectors.	IS: 5983 – 1978
Ear protectors.	IS: 9167 – 1979
Eye & Face protection during welding	IS: 1179-1967
Industrial Safety Belts and Harness	IS: 3521 – 1983
Guide for selection of industrial Safety equipment for body protection	IS: 8519 -1977
Respiratory Protective Devices	IS: 9473-2002, 14166-1994, 14746-1999

- viii. Where workers are employed in sewers and manholes, which are in use, the subcontractor shall ensure that the manhole covers are opened and ventilated at least for an hour before the workers are allowed to get into manhole, and the manholes so opened shall be cordoned off with suitable railing and provided with warning signals or boards to prevent incident to the public

Bharat Heavy Electricals Limited, Power Sector

Regd. Office: BHEL House, Siri Fort, New Delhi-110049

- ix. All the personnel and visitors shall mandatorily use safety helmet (with company logo), safety shoe and reflective vests, in addition to any other PPEs as deemed appropriate for the area of work/ visit.
- x. Following Color scheme for Helmets shall be followed:
 - a. Workmen: Yellow
 - b. Safety staff: Green or white with green band
 - c. Electrician: Red
 - d. Others including visitors: White
 - e. For height workers, special marking on helmets besides indication on Gate Pass/ ID Card
- xi. The subcontractor shall maintain register for issue and receipt of PPEs.
- xii. All the PPEs shall be checked for quality before issue and the same shall be periodically re-checked. The users shall be advised to check the PPEs themselves for any defect before putting on. The defective ones shall be replaced.
- xiii. The Helmets shall have logo or name (abbreviation of agency name permitted) affixed or printed on the front.
- xiv. The body harnesses shall be serial numbered.

10. ARRANGEMENT OF INFRASTRUCTURE:

10.1 DRINKING WATER:

- i. Drinking water shall be provided and maintained at suitable places at different elevations such that minimum quantity of 5 liters is available for each worker during the day.
- ii. Drinking water tank shall be so installed so as to be available within 200 meters of each working area
- iii. Container should be labeled as “Drinking Water” in languages understood by the workers
- iv. Cleaning of the container shall be ensured at least once in a week. Mild cleaning detergents as used for cleaning vessels shall be applied and scrubbers (3M or equivalent) shall be used for removing scales and deposits on the inside surface. The tank shall be thoroughly cleaned with potable water only before it is refilled (also applicable to labor colony).
- v. Suitability of water source for drinking to be tested as per IS10500 at least once in six months.

10.2 WASHING FACILITIES:

- i. In every workplace, adequate and suitable facilities for washing shall be provided and maintained.
- ii. Separate and adequate cleaning facilities shall be provided for the use of male and female workers. Such facilities shall be conveniently accessible and shall be kept in clean and hygienic condition and dully illuminated for night use.
- iii. Water suitable for washing and not for drinking shall be clearly indicated as “Not for Drinking” in language understood by workers.
- iv. Overalls shall be supplied by the subcontractor to the workmen and adequate facilities shall be provided to enable the painters and other workers to wash during the cessation of work.

10.3 LATRINES AND URINALS:

- i. Latrines and urinals shall be provided in every work place as indicated in Section A
- ii. Urinals shall also be provided at different elevations.
- iii. They shall be adequately lighted and shall be maintained in a clean and sanitary condition at all times, by appointing designated person.
- iv. Separate facilities shall be provided for the use of male and female worker if any.

10.4 PROVISION OF REST SHEDS FOR WORKERS DURING REST PERIOD:

Proper Rest Shed (s) with shelter shall be provided for rest during break so as to accommodate all workers as indicated in Section A

10.5 MEDICAL FACILITIES:

10.5.1 GENERAL

- i. Provision of Medical Center, Ambulance etc. shall be as per Section A of this document
- ii. Medical waste shall be disposed as per prevailing legislation (Bio-Medical Waste – Management and Handling Rules, 1998)
- iii. Every injury shall be treated, recorded and reported.
- iv. All First Aid injuries shall be recorded as per provided Format
- v. List of qualified first aiders and their contact numbers to be displayed at conspicuous places.

10.5.2 FIRST AIDER/ FIRST AID BOX

- i. The first aider along with facilities should be available at a point nearest to the work location wherein majority of the workers are working.
- ii. The subcontractor shall provide necessary first aid facilities as per schedule III of BOCW. At every work place first aid facilities shall be provided and maintained.
- iii. The first aid box shall be kept by first aider who shall always be readily available during the working hours of the work place. His name and contact no to be displayed on the box.
- iv. The first aid boxes should be placed at various elevations so as to make them available within the reach and at the quickest possible time.
- v. The first aid box shall be distinctly marked with a Green Cross on white background.
- vi. Details of contents of first aid box is given in Annexure J
- vii. A slip of contents shall be pasted on the First Aid Box with following details
- viii. Monthly inspection of First Aid Box shall be carried out by the owner as per provided format
- ix. The subcontractor should conduct periodical first –aid classes to keep his supervisor and Engineers properly trained for attending to any emergency.

10.5.3 HEALTH CHECK UP

The persons engaged at the site shall undergo health check-up as per provided format before induction. In addition, the persons engaged in the following works shall undergo health check-up at least once in a year:

- i. Height workers
- ii. Drivers/crane operators/riggers
- iii. Confined space workers
- iv. Shot/sand blaster
- v. Welding and NDE personnel

10.5.4 HEIGHT PHOBIA/ VERTIGO TEST:

- i. The persons engaged in working at heights (above 2 meters) to be assessed for Vertigo and associated conditions and recorded as per provided format. Suggested Vertigo Test Procedure is given in Annexure K
- ii. Such workers are to be allowed only on successful completion of test, otherwise shall be allocated ground-based jobs.
- iii. IDs / Height passes shall be issued to such workers, besides special markings on helmets for easy identification.

10.5.5 PROVISION OF CANTEEN FACILITY:

- i. Canteen facilities shall be provided for the workmen of the project inside the project site where worker strength is 250 or more.
- ii. Proper cleaning and hygienic condition shall be maintained.
- iii. Proper care should be taken to prevent biological contamination.
- iv. Adequate drinking water should be available at canteen.
- v. Fire extinguisher shall be provided inside canteen.
- vi. Regular health check-up and medication to the canteen workers shall be ensured as per applicable regulations.
- vii. Canteen waste to be disposed of in hygienic manner

10.6 PROVISION OF ACCOMMODATION/LABOR COLONY FOR WORKFORCE:

- i. Proper accommodation for workforce to be provided in line with minimum requirements indicated in Section A
- ii. Labor colony shall be inspected each week by HSE Officer and report submitted to BHEL as per provided format

10.7 PEST CONTROL:

Regular pest control should be carried out at all offices, mainly laboratories, canteen, labor colony and stores.

10.8 SCRAPYARD:

- i. In consultation with customer, scrapyard shall be developed to store metal scrap, wooden scrap, waste, hazardous waste.
- ii. Scrap/Waste shall be segregated as Bio-degradable and non-bio-degradable and stored separately.

10.9 ILLUMINATION:

- i. The subcontractor shall arrange at his cost adequate lighting facilities e.g. flood lighting, hand lamps, area lighting etc. at various levels for safe and proper working operations at dark places and during night hours at the work spot as well as at the pre-assembly area.
- ii. Lamp (hand held) shall not be powered by mains supply but either by 24V or dry cells.
- iii. Lamps shall be protected by suitable guards where necessary to prevent danger, in case of breakage of lamp.
- iv. Emergency lighting provision for night work shall be made to minimize danger in case of main supply failure.
- v. Adequate and suitable light shall be provided at all work places & their approaches including passage ways as per IS: 3646 (Part-II).

SUITABLE ILLUMINATION LEVELS FOR VARIOUS AREAS SHALL BE DECIDED BASED ON BROAD GUIDELINES INDICATED BELOW:

S. No.	Location	Lux Level (lumens/sqm)
A.	Construction Site	
1	Outdoor areas like store yards, entrance and exit roads	20
2	Platforms	50
3	Entrances, corridors and stairs	100
4	General illumination of work area	150
5	Rough work like fabrication, assembly of major items	150
6	Medium work like assembly of small machined parts	300
7	Fine work like precision assembly, precision measurements etc.	700
8	Sheet metal works	200
9	Electrical and instrument labs	450
B.	Office	
1	Outdoor area like entrance and exit roads	20
2	Entrance halls	150
3	Corridors and lift cars	70
4	Lift landing	150
5	Stairs	100
6	Office rooms, conference rooms, library reading tables	300
7	Drawing table	450
8	Manual telephone exchange	200

- vi. Illuminations shall be inspected on weekly basis as per provided **format** using a calibrated lux meter.

11. HSE TRAINING & AWARENESS:

11.1 TRAINING PLAN:

- i. All training programs to be carried out in a planned manner. Monthly/ Annual Training Calendar to be submitted to BHEL for approval and shall cover HSE Training requirements of all activities, workers, hazards applicable to the area(s) of work.
- ii. Subcontractor shall nominate workers as per the schedule of specific training plan, failing which, penalty shall be imposed.
- iii. Training records of all workers along with attendance, signatures, faculty details etc. shall be maintained in soft/ hard copy as per provided **formats**.
- iv. Each labor should undergo at least 0.5% of total man-hours worked in HSE training.

11.2 HSE INDUCTION TRAINING

- i. All persons entering into project site shall be given HSE induction training by the HSE officer of BHEL /subcontractor before being assigned to work.
- ii. The induction training shall be imparted through audio-visual medium (Classroom specialized training), and shall be minimum of 1 Complete Day.
- iii. Evaluation to be carried out after training and training shall be repeated in case of failure.
- iv. Safety Induction Card shall be printed by Subcontractor and provided to all trained workers. A Safety induction book shall also be printed and issued to each worker after induction training (Format for the same may be provided by BHEL).
- v. Induction training subjects shall include but not limited to:
 - a. Briefing of the Project details.
 - b. Safety objectives and targets.
 - c. Site HSE rules.
 - d. Critical Safety Violations and consequences
 - e. Site HSE hazards and aspects.
 - f. First aid facility.
 - g. Emergency Contact No.
 - h. Incident & Near Miss reporting.
 - i. Fire prevention and emergency response.
 - j. Rules to be followed in the labor colony (if applicable)
 - k. Accident case studies
- vi. General:
 - a. Proper safety wear & gear must be issued to all the workers being registered for the induction (i.e., Shoes/Helmets/Goggles/Leg guard/Apron etc.)
 - b. They must arrive fully dressed in safety wear & gear to attend the induction.
 - c. Any one failing to conform to this safety wear& gear requirement shall not qualify to attend.

- d. On completing attending subcontractor's in-house HSE induction, each employee shall sign an induction training form to declare that he had understood the content and shall abide to follow and comply with safe work practices.
- e. They may only then be qualified to be issued with a personal I.D. card, for access to the work site subject to clearing the medical fitness test.

SAFETY INDUCTED	
Name :	
Date :	
Sign By Trainer :	

ABOVE STICKER SHALL BE PASTED ON HELMET OF WORKERS AFTER SAFETY INDUCTION TRAINING

11.3 JOB-SPECIFIC SKILL BASED HSE TRAINING

The contracting agency shall also impart job specific skill-based safety training to all its employees (Minimum one day) on various related safety topics using internal/external safety professionals/consultants as per the matrix given below. Record of such trainings and attendance particulars shall be maintained in a register for ready reference to statutory authorities/engineer-in charge as per provided format.

TRAINING MATRIX

Name of topic	Executives	Supervisors	Skilled Workmen	Other Workers
Safety Induction	Y	Y	Y	Y
Accident_ Causes, factors, cost	Y	Y	Y	-
Industrial hazards & Accident Prevention	Y	Y	Y	-
Investigating, reporting, records	Y	Y	-	-
Personal Protective Equipment	-	Y	Y	Y
Construction Safety & Role of Supervisory personnel	-	Y	-	-
Permit to Work (PTW)	-	Y	Y	y
Statutory Provisions (BOCW Act/Rules, Factories Act 1948 etc.)	Y	Y	y	y
Material handling	-	y	Y	Y
Emergency Management	Y	Y	Y	-
Electrical Safety	-	Y	Y	-
Fire safety	Y	Y	Y	Y
First Aid & CPR (cardio pulmonary resuscitation)	-	Y	Y	Y (Selected)
Safety in Welding & Cutting	-	-	Y	-
Safety Audit	Y	Y	-	-
Safety in Lifting Tools & Tackles	-	Y	Y	y

Safety in Working at height	-	Y	Y	Y
Safety in Confined space work	-	Y	Y	Y
Defensive Driving	-	Y*	Y*	Y*

*for construction vehicle operators, helpers & crane operators

Y=YES

Note:

- Subcontractor shall prepare a training plan/ matrix covering all hazards and implement the same after approval of BHEL.
- It is to be ensured that every worker undergoes Job-Specific training once every 3 months.
- Records of training programmes along with attendance shall be maintained by the subcontractor
- Each worker to be issued a Card indicating the types of trainings undergone.

11.4 HSE TOOL-BOX TALK:

- HSE tool Box talk shall be conducted by frontline foreman/supervisor of subcontractor to specific work groups prior to the start of work and shall be randomly attended by subcontractor engineers/ officials. The agenda shall consist of the following:
 - Details of the job being intended for immediate execution.
 - The relevant hazards and risks involved in executing the job and their control and mitigating measures.
 - Specific site condition to be considered while executing the job like high temperature, humidity, unfavorable weather etc.
 - Recent non-compliances observed.
 - Appreciation of good work done by any person.
 - Any doubt clearing session at the end.
- Tool box talk to be conducted before start of work in every shift.
- During toolbox talk, visual check-up of workers regarding health, any signs of fatigue, intoxication etc. shall be conducted and any suspected workers to be acted upon.
- Record of Tool box talk shall be maintained as per provided **format**

11.5 TRAINING ON HEIGHT WORK:

- Training on height work shall be imparted to all workers working at height by in-house/external faculty at least once every 3 months.
- For Height Workers Separate pass shall be provided by the subcontractor.
- The training shall be of minimum 2-hour duration, through audio-visual medium and followed by evaluation. In case of poor scoring, training shall be repeated.
- The training shall include following topics:
 - Proper use of PPEs – safety harness, lanyard, fall arrester, retractable fall arrester, life line, safety nets etc.
 - Provision of secondary means of fall protection

- c. Safe climbing through monkey ladders.
- d. Inspection of PPEs.
- e. Medical fitness requirements.
- f. Mock drill on rescue at height.
- g. Dos & Don'ts during height work.
- h. Accident case Studies

11.6 RE-INDUCTION TRAINING

The induction training shall be repeated for every worker after at least 1 year and shall be a pre-requisite for renewal of Gate Pass/ ID card.

11.7 PENALTY TRAINING

The personnel involved in Safety Violations/ Incidents shall mandatorily undertake penalty training pertaining to the violation/ incident. Penalty training shall be at least half-day duration.

11.8 HSE PROMOTION-SIGNAGE, POSTERS, COMPETITION, AWARDS ETC.:

- i. HSE Displays shall be installed as indicated in Section A
- ii. Contracting agencies shall arrange for display of safety hoardings depicting suitable safety cartoons/messages/ cautionary notices at appropriate places of project site to remind the workers to perform their duties safely.
- iii. Apart from safety hoardings, each agency should maintain a safety bulletin board at all their work locations. Such safety bulletin boards should depict the activities being planned for the day, good practices, permit details etc.
- iv. Safety suggestion boxes shall be kept at each subcontractor's office at site for obtaining safety suggestions from the workers. Best suggestions should be implemented and may be rewarded suitably to encourage the workers for safety.
- v. Safety awareness campaigns, competitions, plays, movie shows, songs etc. to be organized for workers at Site and Labor colony from time to time to enhance Safety Awareness

11.9 HSE REWARDS & INCENTIVE SCHEME

Subcontractor shall implement a reward & incentive scheme for workers & supervisors displaying adherence to safety principles. Such workers shall be felicitated in a monthly function, attended by Subcontractor top management and BHEL representatives. Suitable gift shall be given to such workers for encouragement.

11.10 HSE AWARENESS PROGRAM FOR OFFICIALS:

Subcontractor shall arrange monthly HSE awareness program on different topics including medical awareness for all engineers/ supervisors / officials working at site. This program can be part of progress/ safety review meetings.

12. HSE COMMUNICATION AND PARTICIPATION:

12.1 HSE INCIDENT REPORTING, INVESTIGATION & CORRECTIVE ACTION:

- i. All incidents (near misses, property damage, first-aid cases, minor, major and fatal incidents) shall be reported to BHEL as they happen immediately through SMS and Hard/Soft copy as per provided format
- ii. All incidents including near miss, minor, major and fatal incidents shall be recorded
- iii. All incidents shall be investigated for Root Causes and corrective actions ensured to prevent recurrence shall be implemented.
- iv. Work shall be put on hold in the area till corrective actions are verified by BHEL
- v. The Root Cause Analyses and Corrective actions taken shall be recorded

12.2 HSE EVENT REPORTING:

- i. Important HSE events like HSE training, Medical camp etc. organized at site shall be reported to BHEL site management in detail with photographs for publication in different in-house magazines
- ii. Celebration of important days like National Safety Day, World Environment Day etc. shall also be reported as mentioned above.

12.3 MONTHLY HSE REPORTING:

- i. All routine and non-routine HSE activities shall be reported to BHEL on monthly basis by the subcontractor as per provided format. The reporting medium can be hard/soft as per BHEL requirement.
- ii. The period of reporting shall be 25th of the preceding month to 24th of the present month and shall be submitted by the end of the calendar month.
- iii. Report shall include good quality images of HSE Activities

12.4 DAILY HSE ACTIVITY REPORTING:

Daily HSE activities shall be reported by subcontractor to BHEL as per provided format

12.5 HSE SUGGESTIONS:

All workers and employees shall be encouraged to provide suggestions for improvement in Health, Safety & Environment performance at site. The suggestions shall be recorded in a "Suggestions Register" as per provided format. Suggestions found suitable for implementation shall be implemented and recognition / reward to be given to the submitter.

Suggestion Register to be placed at Site and Labor Colony and shall be reviewed on periodic basis

12.6 CLIENT COMMUNICATION:

All HSE related communication from BHEL, customer / external statutory and regulatory agencies to be handled on priority. Same to be recorded and issues to be resolved in expeditious manner

13. SAFETY DURING WORK EXECUTION:

Safety during work execution shall be ensured by following appropriate Safety Rules, providing adequate resources, deploying competent and trained manpower, regular training & inspection and non-conformity resolution. Main aspects are indicated as under:

13.1 OPERATIONAL CONTROL PROCEDURES:

In order to reduce the risk associated with hazardous activities, applicable OCPs (Operational control procedures) will be followed by subcontractor as per BHEL instructions, outcomes of Hazard Analysis & other requirements. This will be done as part of normal scope of work. Illustrative list of reference OCPs is given below.

TABLE 13.1 ILLUSTRATIVE LIST OF REFERENCE OCPs

No.	Topic	No.	Topic	No.	Topic
0	General Safety	22	Steam blowing	44	Material preservation
1	Handling of chemicals	23	Working in confined area	45	Electro-resistance heating
2	Electrical safety	24	Operation of passenger lift, material hoists & cages	46	Blasting
3	Energy conservation	25	Vehicle/ Crane maintenance	47	Transformer charging
4	Welding and gas cutting operation	26	Radiography	48	Handling of battery system
5	Fire safety	27	Waste disposal	49	DG set
6	Use of hand tools	28	Handling & storage of mineral wool	50	Sanitary maintenance
7	First aid	29	Working at night	51	Piling rig operation
8	Food safety at canteen	30	Computer operation	52	Passivation
9	Use of cranes	31	Storage in open yard	53	EDTA Cleaning
10	Storage and handling of gas cylinders	32	Drilling, reaming and grinding(machining)	54	Chemical cleaning of Pre boiler system
11	Manual arc welding	33	Stress relieving	55	Boiler Light up
12	Use of helmets	34	Hydraulic test	56	Rolling and Synchronization
13	Good house keeping	35	Trial run of rotary equipment	57	Loading of Unit

14	Safe excavation	36	Batching	58	Air compressor
15	Working at height	37	Cable laying/tray work	59	Hydra Operation
16	Filling of hydrogen in cylinder	38	Spray insulation	60	Duct Pre-assembly
17	Illumination	39	Compressor operation	61	Resumption of construction activities after lockdown and prevention of coronavirus infection during site operations
18	Handling and erection of heavy metals	40	Gas distribution test		
19	Acid cleaning	41	Cleaning of Hot well / Deaerator		
20	Oil flushing	42	Electrical maintenance	61A	Prevention of Covid-19 infection in labour colony
21	Alkali boil out	43	O&M of control of AC plant & system	62	Truss/ Structure fit-up and alignment

- The reference OCPs shall be suitably modified by subcontractor as per specific requirements to control the hazards.
- In case any other OCP is found to be applicable during the execution of work at site, then subcontractor will prepare and follow those as well.

13.2 WORK PERMIT SYSTEM:

- The following activities shall be carried out by the subcontractor strictly after obtaining Permit to Work from BHEL
 - Height working
 - Hot working
 - Confined space Work
 - Excavation more than 2-meter depth
 - Radiography
 - Heavy / Complex / Critical Lifting Activity
 - Night / Holiday Work
 - Material Loading / Unloading
 - Grating, Safety Net, Safety Facility Removal
 - Live Electrical Maintenance etc. - Lockout / Tagout
 - Beam / truss/ duct/ structure alignment
- The Work Permit Formats shall be provided by BHEL at Site. It is the responsibility of the subcontractor to ensure their availability
- The above list is not exhaustive. BHEL reserves right to introduce additional Permits or modify requirements for usage of existing Permits. The conditions for using the Permit are specified in the Format (General Requirements).
- Where customer is having separate Work Permit System the same shall be followed in conjunction / merged to ensure all activities and checks are covered in all systems.
- Details of working Group to be attached along with work permit request.

- vi. All the Permits along with JSA/HIRA must be initiated by Agency Execution Team
- vii. Permit applicant shall apply for work permit of particular work activity at particular location before starting of the work with Job Hazard Analysis.
- viii. All Permit signatories (including subcontractor's package in-charge and HSE Officer) shall physically visit the work area and check that all the safety control measures necessary for the activity are in place. Only then the permit shall be issued.
- ix. Signatory shall physically visit the area of work and ensure all required safeguards before signing the Permit
- x. Signatory shall periodically visit the area to confirm the availability of required safeguards throughout the currency of the permit
- xi. In case any Permit requirement is not available, work will be stopped till it is made available
- xii. Permit holder shall implement and maintain all control measures during the period of permit. The permit will be closed after completion of the work.
- xiii. Online Work Permit System shall be used whenever provided by BHEL, otherwise hard copy shall be used

13.3 ACTIVITY-SPECIFIC PRECAUTIONS/ CONTROLS

Detailed HSE precautions for various activities undertaken at Site by the subcontractors are specified in **Annexure I**. Same are to be ensured by the Sub-subcontractor while carrying out respective activities at Site

Index of **Annexure I** is given as under

SN	Description	Page No.
1.	General	2
2.	Work at height	2
2.1	Personnel fall protection system must include	3
2.2	Working Platform	4
2.3	Scaffolding	5
2.4	Ladder Safety	7
3.	Excavation & Civil Works	8
3.1	Excavation	8
3.2	Piling	9
3.3	Batching Plant Operation	9
3.4	Mobile Plant	10
3.5	Concrete Vibrators	11
3.6	Concrete Mixers	11
4.	Welding & Gas Cutting Safety (Hot Work)	11
5.	Lifting & Rigging Safety	13
5.1	Cranes & Hoisting Equipment	15
6.	Demolition Work	20
7.	T&Ps General	20
8.	Chemical Handling	20
9.	Electrical Safety	20

10.	Use of Hand Tools and Power-Operated Tools	25
11.	Start Up, Commissioning and Testing:	27
12.	Fire Safety	27
13.	Painting	28
14.	Hazardous Energy” Control Procedure/ Lockout/Tagout (LOTO)	29
15.	Risk Assessment	36
16.	HSE Preparedness for Adverse Climates and Weather	37
16.1	Summer	37
16.2	Monsoon	38
16.3	Emergency Weather Conditions	40
16.4	Prevention of Covid-19 At Project Site & Labor Colony	41
16.5	Noise Mitigation	43

14. ENVIRONMENTAL CONTROL & SOCIAL RESPONSIBILITY

- i. Environment protection has always been given prime importance by BHEL. Environmental damage is a major concern of the principal subcontractor and every effort shall be made, to have effective control measures in place to avoid pollution of Air, Water and Land and associated life. Banned substances like asbestos and Chlorofluorocarbons such as carbon tetrachloride and trichloroethylene shall not be used. Waste disposal shall be done in accordance with the guidelines laid down in the project specification.
- ii. Any chemical including solvents and paints, required for construction shall be stored in designated bonded areas around the site as per Material Safety Data Sheet (MSDS).
- iii. In the event of any spillage, the principle is to recover as much material as possible before it enters drainage system and to take all possible action to prevent spilled materials from running off the site. The subcontractor shall use appropriate MSDS for clean-up technique
- iv. All subcontractors shall be responsible for the cleanliness of their own areas
- v. Regular dust suppression using sprinklers shall be carried out in respective area
- vi. The subcontractors shall ensure that noise levels generated by plant or machinery are as low as reasonably practicable. Where the subcontractor anticipates the generation of excessive noise levels from his operations the subcontractor shall inform to Construction Manager of BHEL accordingly so that reasonable & practicable precautions can be taken to protect other persons who may be affected.
- vii. It is imperative on the part of the subcontractor to join and effectively contribute in joint measures such as tree plantation, environment protection, contributing towards social upliftment, conversion of packing woods to school furniture, enhancing good relation with local populace etc.
- viii. The subcontractor shall carry out periodic air and water quality check and illumination level checking in his area of work place and take suitable control measure.

15. HOUSEKEEPING

- i. Keeping the work area and access roads clean/ free from debris, removed scaffoldings, scraps, insulation/sheeting wastage /cut pieces, temporary structures, packing woods etc. will be in the scope of the subcontractor. Such cleanings have to be done by subcontractor within quoted rate, on daily basis.
- ii. If such activity is not carried out by subcontractor / BHEL is not satisfied, then BHEL may get it done by other agency and actual cost along with BHEL overheads will be deducted from subcontractor's bill. Such decisions of BHEL shall be binding on the subcontractor
- iii. Dedicated Housekeeping gangs shall be deployed, who shall be provided all required PPEs and safety training
- iv. Mass housekeeping shall be carried out for half a day in a week
- v. Proper housekeeping to be maintained at work place and the following are to be taken care of on daily basis.
- vi. All surplus earth and debris are removed/disposed off from the working areas to identified locations.
- vii. Unused/Surplus cables, steel items and steel scrap lying scattered at different places/elevation within the working areas are removed to identified locations.
- viii. All wooden scrap, empty wooden cable drums and other combustible packing materials, shall be removed from workplace to identified locations.
- ix. Sufficient waste bins shall be provided at different work places for easy collection of scrap/waste. Scrap chute shall be installed to remove scrap from high locations.
- x. Access and egress (stair case, gangways, ladders etc.) path should be free from all scrap and other hindrances.
- xi. Workmen shall be educated through tool box talk about the importance of housekeeping and encourage not to litter.
- xii. Labor camp area shall be kept clear and materials like pipes, steel, sand, concrete, chips and bricks, etc. shall not be allowed in the camp to obstruct free movement of men and machineries.
- xiii. Fabricated steel structures, pipes & piping materials shall be stacked properly.
- xiv. No parking of trucks/trolleys, cranes and trailers etc. shall be allowed in the camp, which may obstruct the traffic movement as well as below LT/HT power line.
- xv. Utmost care shall be taken to ensure over all cleanliness and proper upkeep of the working areas.

16. WASTE MANAGEMENT

- i. Take suitable measures for waste management and environment related laws/legislation as a part of normal construction activities. Compliance with the legal requirements on storage/ disposal of paint drums (including the empty ones), Lubricant containers, Chemical Containers, and transportation and storage of hazardous chemicals will be strictly maintained.
- ii. Details of E-Waste, Hazardous Waste, biomedical waste etc. and their disposal plan, shall be submitted to BHEL every 6 months as per provided **formats**.

16.1 BINS AT WORK PLACE

- i. Sufficient rubbish bins shall be provided close to workplaces.
- ii. Bins should be painted yellow and numbered.
- iii. Sufficient nos. of drip trays shall be provided to collect oil and grease.
- iv. Sufficient qty. of broomsticks with handle shall be provided.
- v. Adequate strength of employees should be deployed to ensure daily monitoring and service for waste management.

16.2 STORAGE AND COLLECTION

- i. Different types of rubbish/waste should be collected and stored separately.
- ii. Paper, oily rags, smoking material, flammable, metal pieces should be collected in separate bins with close fitting lids.
- iii. Rubbish should not be left or allowed to accumulate on construction and other work places.
- iv. Do not burn construction rubbish near working site.

16.3 SEGREGATION

- i. Earmark the scrap area for different types of waste.
- ii. Store wastes away from building.
- iii. Oil spill absorbed by non-combustible absorbent should be kept in separate bin.
- iv. Clinical and first aid waste stored and incinerated separately.

16.4 DISPOSAL

- i. Sufficient containers and scrap disposal area should be allocated.
- ii. All scrap bin and containers should be conveniently located.
- iii. Provide self-closing containers for flammable/spontaneously combustible material.
- iv. Keep drainage channels free from choking.
- v. Make schedule for collection and disposal of waste.

16.5 WARNING AND SIGNS

- i. Appropriate sign to be displayed at scrap storage area
- ii. No toxic, corrosive or flammable substance to be discarded into public sewage system.
- iii. Waste disposal shall be in accordance with best practice.
- iv. Comply with all the requirements of Pollution Control Board (PCB) for storage and disposal of hazardous waste.

17. TRAFFIC MANAGEMENT SYSTEM

17.1 SAFE WORKPLACE TRANSPORT SYSTEM

- i. Traffic routes in a work place shall be suitable for the persons or vehicles using them. This shall be sufficient in number and of sufficient size. This shall reflect the suitability of traffic routes for vehicles and pedestrians.

- ii. Where vehicles and pedestrians use the same traffic routes there shall be sufficient space between them. Where necessary all traffic routes must be suitably indicated. Pedestrians or vehicles must be able to use traffic routes without endangering those at work. There must be sufficient separation of traffic routes from doors, gates and pedestrian traffic routes.
- iii. For internal traffic, lines marked on roads / access routes and between buildings shall clearly indicate where vehicles are to pass.
- iv. Temporary obstacles shall be brought to the attention of drivers by warning signs or hazard cones.
- v. Speed limits shall be clearly displayed for each kind of vehicle.
- vi. Speed ramps preceded by a warning signs or marker are necessary.
- vii. The traffic route should be wide enough to allow vehicles to pass and re-pass oncoming or parked traffic and it may be advisable to introduce on-way system or parking restrictions.
- viii. Safest route shall be provided between places where vehicles have to call or deliver.
- ix. Avoid vulnerable areas/items such as fuel or chemicals tanks or pipes, open or unprotected edges and structures likely to collapse
- x. Safe areas shall be provided for loading and unloading.
- xi. Avoid sharp or blind bends. If this is not possible hazards should be indicated e.g. blind corner.
- xii. Ensure road crossings are minimum and clearly signed.
- xiii. Entrance and gateways shall be wide enough to accommodate a second vehicle without causing obstruction.
- xiv. Set sensible speed limits which are clearly sign posted.
- xv. Where necessary ramps should be used to retard speed. This shall be preceded by a warning sign or mark on the road.
- xvi. Forklift trucks shall not pass over road hump unless of a type capable of doing so.
- xvii. Overhead electric cable, pipes containing flammable hazardous chemical shall be shielded by using goal posts height gauge posts or barriers.
- xviii. Road traffic signs shall be provided on prominent locations for prevention of incidents and hazards and for quick guidance and warning to employees and public. Safety signs shall be displayed as per the project working requirement and guideline of the state in which project is done. Vehicles hired or used shall not be parked within the 15m radius of any working area. Any vehicle, that is required to be at the immediate/near the vicinity, shall be approved by the person in-charge of the site.

17.2 TRAFFIC ROUTE FOR PEDESTRIANS

- i. Where traffic routes are used by both pedestrians and vehicles road shall be wide enough to allow vehicles and pedestrians safely.
- ii. Separate routes shall be provided for pedestrians to keep them away from vehicles. Provide suitable barriers/guard at entrances/exit and the corners or buildings.
- iii. Where pedestrian and vehicle routes cross, appropriate crossing shall be provided.

- iv. Where crowd is likely to use roadway e.g. at the end of shift, stop vehicles from using them at such times.
- v. Provide high visibility clothing for people permitted in delivery area.

17.3 WORK VEHICLE

Work vehicle shall be as safe stable efficient and roadworthy as private vehicles on public roads. Site management shall ensure that drivers are suitably trained. All vehicle e.g. heavy motor vehicle forklift trucks dump trucks mobile cranes shall ensure that the work equipment conforms to the following:

- i. A high level of stability.
- ii. A safe means of access/egress.
- iii. Suitable and effective service and parking brakes.
- iv. Windscreens with wipers and external mirrors giving optimum all round visibility.
- v. Provision of horn, vehicle lights, reflectors, reversing lights, reversing alarms.
- vi. Provision of seat belts.
- vii. Guards on dangerous parts.
- viii. Driver protection - to prevent injury from overturning and from falling objects/materials.
- ix. Driver protection from adverse weather.
- x. No vehicle shall be parked below HT/LT power lines.
- xi. Valid Pollution Under Control certification for all vehicles
- xii. Wheel stopper shall be use during the parking of vehicle
- xiii. Helper to be deployed in each vehicle as per site requirement.

17.4 DAILY CHECK BY DRIVER

- 1. There should also be daily safety checks containing below mentioned points by the driver before the vehicle is used.

Brakes	Mirrors	Warning signals
Tires	Windscreen waters	Specific safety systems i.e. controls & interlocks
Steering	Wipers	

- 2. Management should ensure that drivers carry out these checks.

17.5 TRANSPORTATION OF PERSONNEL AND MATERIALS BY VEHICLES

- i. All drivers shall hold a valid driving License for the class of vehicle to be driven and be registered as an authorized BHEL driver with the Administration Department.
- ii. Securing of the load shall be by established and approved methods, i.e. chains with patented tightening equipment for steel/heavy loads. Sharp corners on loads shall be avoided when employing ropes for securing.
- iii. All overhangs shall be made clearly visible and restricted to acceptable limits
- iv. Load shall be checked before moving off and after traveling a suitable distance.
- v. On no account is construction site to be blocked by parked vehicles Drivers of vehicles shall only stop or park in the areas designate by the stringing foreman.

- vi. Warning signs shall be displayed during transportation of material.
- vii. All vehicles used by BHEL shall be in worthy condition and in conformance to the Land Transport requirement.
- viii. Wheel stopper shall be use during the parking of vehicle
- ix. Helper to be deployed in each vehicle as per site requirement.

17.6 MAINTENANCE

All Vehicles used for transportation of man and material shall undergo scheduled inspections on frequent intervals to secure safe operation. Such inspections shall be conducted in particular for steering, brakes, lights, horn, doors etc. Site management shall ensure that work equipment is maintained in an efficient, working order and in good repair. Inspections and services carried out at regular intervals of time and or mileage. No maintenance shall be carried below HT/LT power lines.

18. EMERGENCY PREPAREDNESS AND RESPONSE

- i. Emergency preparedness and response capability of site shall be developed as per Emergency Preparedness and Response plan issued by BHEL
- ii. Availability of adequate number of first aiders and fire warden shall be ensured with BHEL and its subcontractors
- iii. All the subcontractor's supervisory personnel and sufficient number of workers shall be trained for fire protection systems. Enough number of such trained personnel must be available during the tenure of contract. Subcontractor should nominate his supervisor to coordinate and implement the safety measures.
- iv. Assembly point shall be earmarked and access to the same from different location shall be shown
- v. Fire exit shall be identified and pathway shall be clear for emergency escape.
- vi. Appropriate type and number of fire extinguisher shall be deployed as per Fire extinguisher deployment plan and validity shall be ensured periodically through inspection
- vii. Adequate number of first aid boxes shall be strategically placed at different work places to cater emergency need. Holder of the first aid box shall be identified on the box itself who will have the responsibility to maintain the same.
- viii. First aid center shall be developed at site with trained medical personnel and ambulance
- ix. Emergency contact numbers (format given in EPRP) of the site shall be displayed at prominent locations.
- x. Tie up with fire brigade shall be done in case customer is not having fire station.
- xi. Tie up with hospital shall be done in case customer is not having hospital.
- xii. Disaster Management group shall be formed at site
- xiii. Mock drill shall be arranged at regular intervals. Monthly report of the above to be given to BHEL HSE Officer as per prescribed BHEL formats
- xiv. Mock drill shall be conducted on different emergencies periodically to find out gaps in emergency preparedness and taking necessary corrective action

19. HSE INSPECTION

Inspection on HSE for different activities being carried out at site shall be done to ensure compliance to HSE requirements. The subcontractor shall maintain and ensure necessary safety measures as required for inspection and tests HV test, Pneumatic test, Hydraulic test, Spring test, Bend test as applicable, to enable inspection agency for performing Inspection. If any test equipment is found not complying with proper safety requirements then the Inspection Agency may withhold inspection, till such time the desired safety requirements are met.

Online/ App-based HSE Inspection system shall be used for inspection whenever provided by BHEL otherwise Hard-copy based system shall continue

 ☐ OK	☐ NOT OK
Contractor Name:	
Equipment Identification No :	
Inspection Date :	
Next Inspection Date :	
Inspected By :	

Every Inspected Equipment shall display above sticker

19.1 INSPECTION PLAN

Subcontractor shall prepare an inspection plan covering all areas/ activities/ equipment/ hazards and implement the same after getting approval of BHEL. Responsibility to ensure coverage of all areas/ activities rests with the subcontractor.

All Inspections shall be witnessed by BHEL – only then they shall be considered as valid

19.2 INSPECTION REPORTS

Monthly inspection reports as per plan shall be submitted to BHEL HSE Head

19.3 NON-CONFORMANCES

Any non-conformances identified during inspection observed shall be addressed on priority.

The responsibility of resolution shall rest with the Subcontractor Site In-charge

In case immediate closure of non-conformities is not possible:

- work to be halted in the area
- non-conformance to be generated and submitted to responsible person and BHEL
- non-conformance to be resolved through responsible agency / person

Only after closure of non-conformances, work to be allowed to resume

19.4 DAILY HSE CHECKS

Both the Site Supervisors and HSE Officer of Subcontractor are to conduct daily site Safety inspection around work activities and premises to ensure that work methods and the sites

are maintained to an acceptable standard. The following are to form the common subjects of a daily safety inspection:

- i. Personal Safety wears & gear compliance.
- ii. Complying with site safety rules and permit-to-work (PTW).
- iii. Positions and postures of workers.
- iv. Use of tools and equipment etc. by the workers.

The inspection should be carried out just when work starts in beginning of the day, during peak activities period of the day and just before the day's work ends.

19.5 INDICATIVE LIST OF INSPECTIONS AND PERIODICITIES

Indicative list & periodicity of Inspections is given as under. It is the responsibility of the subcontractor to develop an inspection plan covering all areas & activities in the scope.

SL. No.	Format Name	Frequency of check (if applicable)
01	Inspection of First Aid Box	Weekly
02	Inspection of PPE	Weekly
03	Inspection of T&Ps	Monthly
04	Inspection of Cranes	Monthly
05	Inspection of Winches	Monthly
06	Inspection on Height Working	Weekly
07	Inspection on Welding & Gas Cutting	Monthly
08	Inspection on Electrical Installation	Monthly
09	Inspection on Elevator	Weekly
10	Inspection of Excavation	Weekly
11	Inspection of Labor Colony	Monthly
12	Inspection of Illumination Levels	Weekly

The checklists shall be provided by BHEL at Site. It is the responsibility of the subcontractor to ensure their availability before start of work

19.5.1 INSPECTION OF PPE

- i. PPEs shall be inspected by HSE officer at random once in a week as per provided **format** for its compliance to standard and compliance to use and any adverse observation shall be recorded in the PPE register.
- ii. The applicable PPEs for carrying out particular activities are listed below.

19.5.2 INSPECTION OF TOOLS & PLANTS (T&Ps)

- i. A master list of T&Ps shall be maintained by each subcontractor in provided **format**.
- ii. All T&Ps being used at site shall be inspected by HSE officer once in a month as per provided **format** for its healthiness and maintenance.
- iii. The T&Ps which require third party inspection shall be checked for its validity during inspection. The third-party test certificate should be accompanied with a copy of the concerned competent person's valid qualification record.

- iv. BHEL shall be given advance intimation of Third-Party Inspection. BHEL shall associate with Inspection as per discretion.
- v. The validity of T&P shall be monitored as per provided **format**

19.5.3 INSPECTION OF CRANES AND WINCHES

- i. Cranes and winches shall be inspected by the operator through a daily checklist for its safe condition (as provided by the equipment manufacturer) before first use of the day.
- ii. Cranes and Winches shall be inspected by HSE officer once in a month as per provided **format** for healthiness, maintenance and validity of third-party inspection.
- iii. The date of third-party inspection and next due date shall be painted on cranes and winches.
- iv. The operators/drivers shall be authorized by sub-subcontractor based on their competency and experience and shall carry the I-card.
- v. The operator should be above 18 years of age and should be in possession of driving license of HMV man & goods), vision test certificate and should have minimum qualification so that he can read the instructions and check list.

19.5.4 INSPECTION OF HEIGHT WORKING

- i. Any activity carried out at more than 2 m height is classified as height work.
- ii. Inspection of height working shall be conducted daily by Supervisors before start of work to ensure safe working condition including provision of
 - a. Fall arrestor
 - b. Lifelines – connected to rigid & independent structure
 - c. Safety nets deployed below all height work activities
 - d. Fencing and barricading
 - e. Warning signage
 - f. Covering of opening
 - g. Proper scaffolding with access and egress.
 - h. Illumination
- iii. For full duration of height work, constant supervision to be maintained by dedicated HSE personnel
- iv. Inspection on height working shall be conducted once in a week by HSE officer as per provided **format**.
- v. Medical fitness of height worker shall be ensured.
- vi. Height working shall not be allowed during adverse weather.

19.5.5 INSPECTION OF WELDING AND GAS CUTTING OPERATION

- i. Supervisor shall ensure that no flammable items are available in near vicinity during welding and gas cutting activity.
- ii. Gas cylinders shall be kept upright.
- iii. Use of Flash back arrestor shall be ensured at both ends.

- iv. Inspection during welding and gas cutting operations shall be carried out by HSE officer once a month as per provided **format**.
- v. Use of fire blanket to be ensured to avoid falling of splatters during welding or gas cutting operation at height.
- vi. Availability of fire extinguisher at vicinity shall be ensured.

19.5.6 INSPECTION OF ELECTRICAL INSTALLATION / APPLIANCES

- i. Ensure proper earthing in electrical installation
- ii. Use ELCB at electrical booth
- iii. Electrical installation shall be properly covered at top where required
- iv. Use appropriate PPEs while working
- v. Use portable electrical light < 24 V in confined space and potentially wet area.
- vi. Inspection shall be carried out as per provided **format**.

19.5.7 INSPECTION OF ELEVATOR

- i. Elevators shall be inspected by concerned supervisors once in a week as per provided **format**
- ii. All elevators shall be inspected by competent person and validity shall be ensured.
- iii. The date of third-party inspection and next due date shall be painted on elevator.

19.5.8 INSPECTION OF EXCAVATION

Excavation activities shall be inspected as per provided **format**

19.5.9 INTERNAL/ EXTERNAL HSE AUDITS/INSPECTIONS

- i. All non-conformities and observations on HSE identified during internal or external HSE audit shall be disposed of by site in a time bound manner and reported back the implementation status.
- ii. Corrective action and Preventive action on HSE issues raised by certification body issued by BHEL shall be implemented by site and reported to Site management.

20. TERMS AND DEFINITIONS:

1. Incident

Work- related or natural event(s) in which an injury, or ill health (regardless of severity), damage to property or fatality occurred, or could have occurred.

2. Near Miss:

An incident where no ill health, injury, damage or other loss occurs, but it had a potential to cause, is referred to as "Near-Miss".

3. Man-Hours Worked:

The total number of man hours worked by all employees including subcontractors working in the premises. It includes managerial, supervisory, professional, technical, clerical and other workers including contract labors. Man-hours worked shall be calculated from the payroll or time clock recorded including overtime. When this is not feasible, the same shall be estimated by multiplying the total man-days worked for the

period covered by the number of hours worked per day. The total number of workdays for a period is the sum of the number of men at work on each day of period. If the daily hours vary from department to department separate estimate shall be made for each department and the result added together.

4. First Aid Cases:

First aids are not essentially all reportable cases, where the injured person is given medical treatment and discharged immediately for reporting on duty, without counting any lost time.

5. Lost Time Injury:

Any work injury which renders the injured person unable to perform his regular job or an alternative restricted work assignment on the next scheduled work day after the day on which the injury occurred.

6. Medical Cases:

Medical cases come under non-reportable cases, where owing to illness or other reason the employee was absent from work and seeks Medical treatment.

7. Type of Incidents & Their Reporting:

The three categories of Incident are as follows:

8. Non-Reportable Cases:

An incident, where the injured person is given medical help and discharged for work without counting any lost time.

9. Reportable Cases:

In this case the injured person is disable for 48 hours or more and is not able to perform his duty.

10. Injury Cases:

These are covered under the heading of non-reportable cases. In these cases, the incident caused injury to the person, but he still continues his duty.

11. Total Reportable Frequency Rate

Frequency rate is the number of Reportable Lost Time Injury (LTI) per one Million Man hours worked. Mathematically, the formula read as:

$$\text{Number of Reportable LTI} \times 1,000,000 / \text{Total Man Hours Worked}$$

12. Severity Rate:

Severity rate is the Number of days lost due to Lost Time Injury (LTI) per one Million Man hours worked. Mathematically, the formula reads as:

$$\text{Days lost due to LTI} \times 1,000,000 / \text{Total Man Hours Worked}$$

13. Incidence Rate:

Incidence Rate is the Number of LTI per one thousand manpower deployed. Mathematically, the formula reads as:

$$\text{Number of LTI} \times 1000 / \text{Average number of manpower deployed}$$

14. HIRA:

Hazard Identification and Risk Assessment (HIRA) is a process of identifying Hazards in work area and then assessing them properly

15. Method Statement:

A method statement is prepared by the Execution/ Engineering Department detailing the steps, equipment, competencies and safety precautions required for carrying out any activity

16. Job Safety Analysis:

A job safety analysis (JSA) is a procedure which helps integrate accepted safety and health principles and practices into a particular task or job operation. In a JSA, each basic step of the job is to identify potential hazards and to recommend the safest way to do the job. Other terms used to describe this procedure are job hazard analysis (JHA) and job hazard breakdown.

17. Safety Walk:

It's conducted periodically by an official - it's a walk through a portion or whole of a site as a HSE officer who notes down HSE observations, speak to concerned workmen and supervisor on observation, get the same corrected with personal follow up- this sends out a strong message on Management's commitment to safety.

18. Heavy & Complex Lifting:

A heavy and complex lifting activity includes:

1. Lifting above 20 Tons
2. Tandem Lifting using multiple cranes
Total load exceeding 75% of capacity of crane. Depending up the condition of cranes, hydra cranes, winch machines & other lifting accessories
3. Lift of unusual difficulty or geometry or rigging
4. Lift over operating units
5. Any other lift as decided by site HSE / Erection


19. Safety Committee:

As per the BOCW, Safety Committee shall be constituted if there are more than five hundred or more construction workers are employed at any site. As per the Factories Act, 1948 it is for 250 workers. It shall be represented by equal number of representatives of employer and construction workers.


20. Night Work:

Work conducted after sunset when only a fraction of total manpower is available



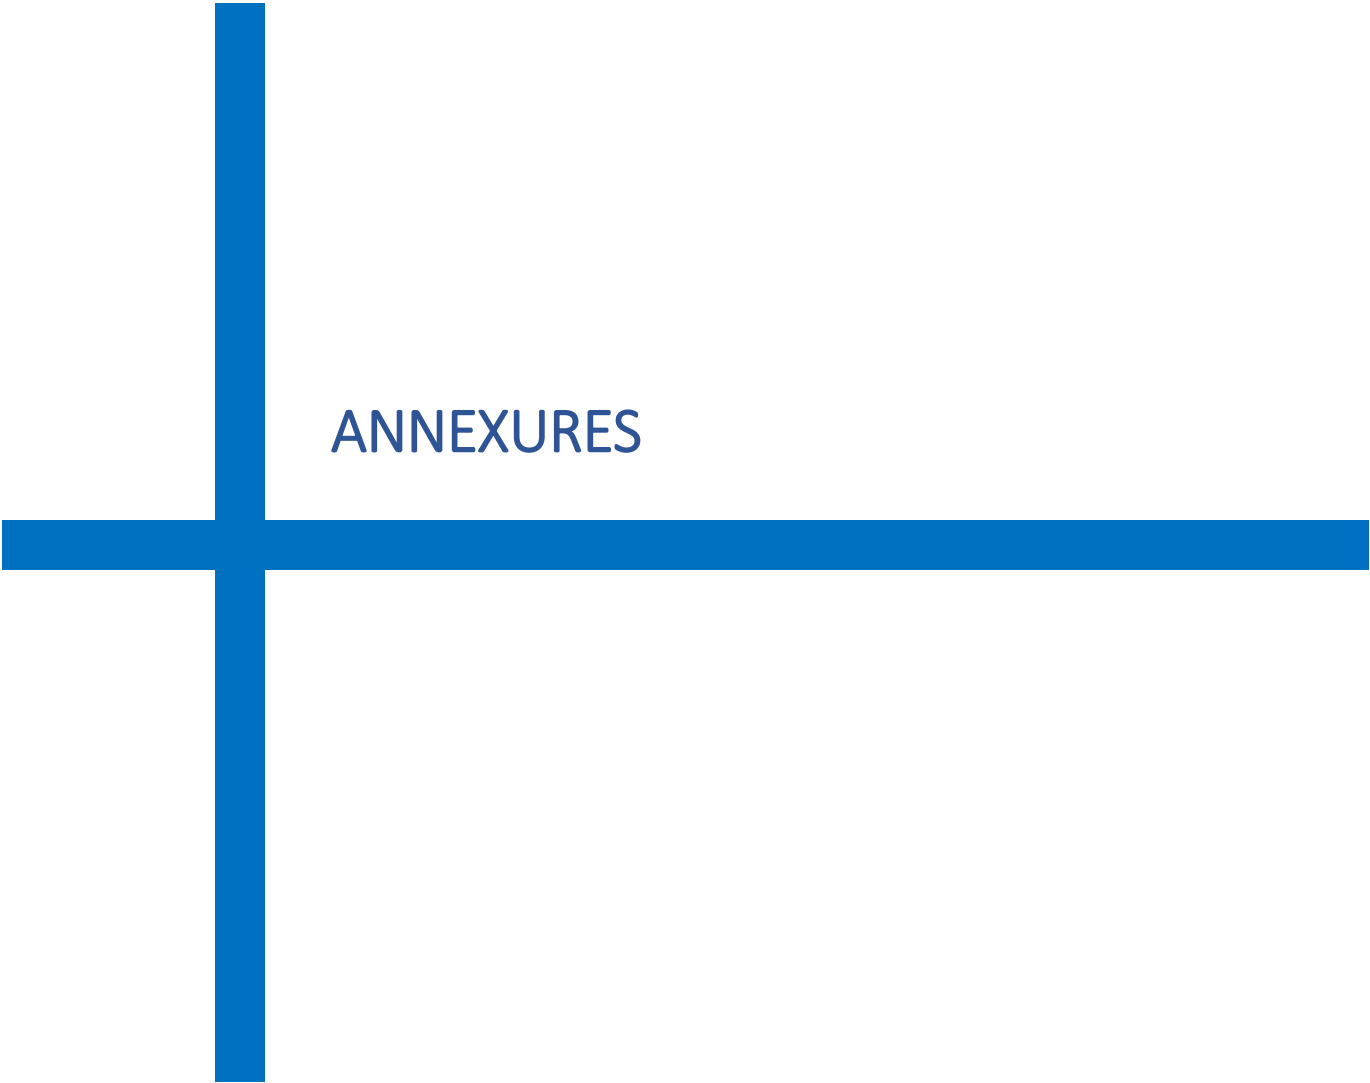

ANNEXURES

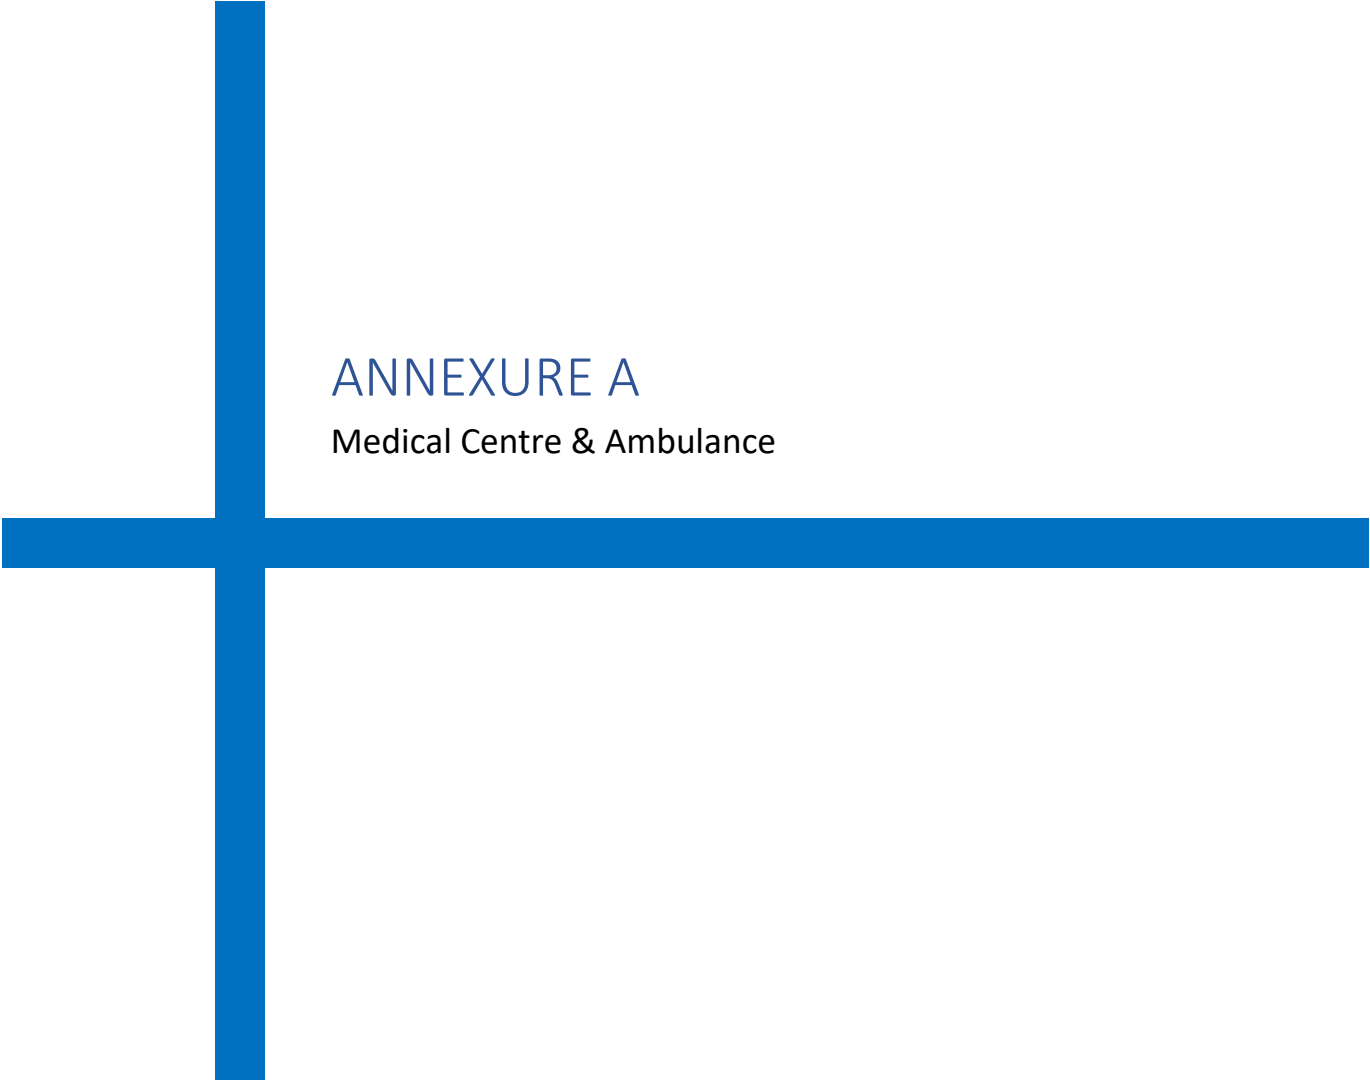

ANNEXURE A

Medical Centre & Ambulance

A. Medical Centre

1. Paramedical staff
 - a. When < 500 workers, 1 Trained Male Nurse (round the clock deployment)
 - b. When >=500 workers*:
 - i. Registered Medical Practitioner (Qualified MBBS) to be deployed for at least 8 hours in a day, 5 days per week
 - ii. 2 Trained Male Nurses (round the clock deployment)
 2. All articles as per Schedule IV of BOCW Central Rules, 1998 to be made available in the Medical Centre (given under for convenience)
 3. Basic Facilities/ Requirements to be provided as per location eg. Refrigerator, Air Conditioner, Anti Venom Serums etc.
 4. Tie-ups with speciality hospitals to be ensured for referring serious patients
- * In case the number of workers is envisaged to exceed 500, a medical practitioner is to be engaged.

SCHEDULE IV (BOCW CENTRAL RULES, 1998) ARTICLES FOR AMBULANCE ROOM [SEE RULE 226 (C)]

- i. A glazed sink with hot and cold water always available.
- ii. A table with a smooth top at least 180 cm x 105 cm.
- iii. Means for sterilising instruments.
- iv. A couch.
- v. Two stretchers.
- vi. Two buckets or containers with close fitting lids.
- vii. Two rubber hot water bags
- viii. A kettle and spirit stove or other suitable means of boiling water.
- ix. Twelve plain wooden splints 900 cm x 100 cm x 6 cm.
- x. Twelve plain wooden splints 350 cm x 75 cm x 6 cm.
- xi. Six plain wooden splints 250 cm x 50 cm x 12 cm.
- xii. Six woollen blankets.
- xiii. Three pairs of artery forceps.
- xiv. One bottle of spiritus annemias arematations (120 ml).
- xv. Smelling salt (60 gm).
- xvi. Two medium size sponges.
- xvii. Six hand towels.
- xviii. Four kidney trays.
- xix. Four cakes of toilet, preferably antiseptic soap.
- xx. Two glass tumblers and two wine glasses.
- xxi. Two clinical thermometers.
- xxii. Two tea spoons.
- xxiii. Two graduated (120 ml) measuring glasses.
- xxiv. Two minimum measuring glasses.
- xxv. One wash bottle (1000 cc) for washing eyes.
- xxvi. one bottle (one litre) carbolic lotion 1 to 20.
- xxvii. Three chairs.
- xxviii. One screen.
- xxix. One electric hand torch.
- xxx. Four first-aid boxes or cupboards stocked to the standards prescribed in
- xxxi. An adequate supply of tetanus toxoid.
- xxxii. Injections—morphia, pethidine, atrophine, adrenaline, coramine, novocaine (6 each).
- xxxiii. Cramine liquid (60 ml).
- xxxiv. Tablets—antihistaminic antispasmodic (25 each).
- xxxv. Syringes with needles—2 cc, 5 cc, 10 cc and 500 cc.

- xxxvi. Three surgical scissors.
- xxxvii. Two needle holders, big and small.
- xxxviii. Suturing needles and materials.
- xxxix. Three dissecting forceps
- xl. Three dressing forceps
- xli. Three scalpels.
- xlii. One stethoscope and a B. P. apparatus.
- xliii. Rubber bandage—pressure bandage.
- xliv. Oxygen cylinder with necessary attachments.
- xlv. Atropine eye ointments.
- xlvi. I. V. Fluids and sets 10 nos.
- xlvii. Suitable, foot operated, covered, refuse containers.
- xlvi. Adequate number of sterilised, paired, latex hand gloves.

B. Ambulance


1. When number of workers is <500:
If the distance to a major hospital capable of handling critical injuries expected at Site is ≤ 50 KM from Site, then 1 BLS (Basic Life Support)/ Type B Ambulance otherwise ALS* (Advanced Life Support)/ Type D Ambulance
2. If no. of workers increases to >2000 workers one additional BLS Ambulance to be deployed
3. Minimum Articles as per Schedule V of BOCW Central Rules to be ensured in each Ambulance. (given under for convenience)

*Final call to be taken at Site in consultation with all the contractors

SCHEDULE V (BOCW CENTRAL RULES, 1998) CONTENTS OF AMBULANCE VAN OR CARRIAGE [SEE RULE 227]

The Ambulance Van shall have equipment prescribed as under:

- a) General—a portable stretcher with folding and adjusting devices with the Head of the stretcher capable of being tilted upward. Fixed suction unit with equipment. Fixed oxygen supply with equipment. Pillow with case, sheets, blankets, towels, emergency bag, bed pan, urinal glass.
- b) Safety Equipment—Flaros with life of three thousand minutes, floor lights, flash lights, fire extinguishers (dry power type), insulated guntlets.
- c) Emergency Care Equipment—
 - i. **Resuscitation**—Portable suction unit, portable oxygen unit, bag valve mask, hand operated artificial ventilation unit, airways, mouth gag tracheostomy adapters, short spine board, I.V. FLUIDS with administration unit, B. P. manometer cuff stethoscope.
 - ii. **Immobilisation**—Long and short padded boards, wire ladder splints, triangular bandage—long and short spine boards.
 - iii. **Dressing**—Gauze pads—100 m x 100 mm universal dressing 250 x 1000 mm, roll of aluminium foils—soft roller bandages 150 mm x 5 mm yards adhesive tape in 75 mm roll safety pins, bandage sheets, burn sheets.
 - iv. **Poisoning**—Syrup of Ipecac, activated charcoal pre packeted dose, snake bit kit, drinking water.
 - v. **Emergency Medicines**—As per requirement (under the advice of construction Medical Officer).

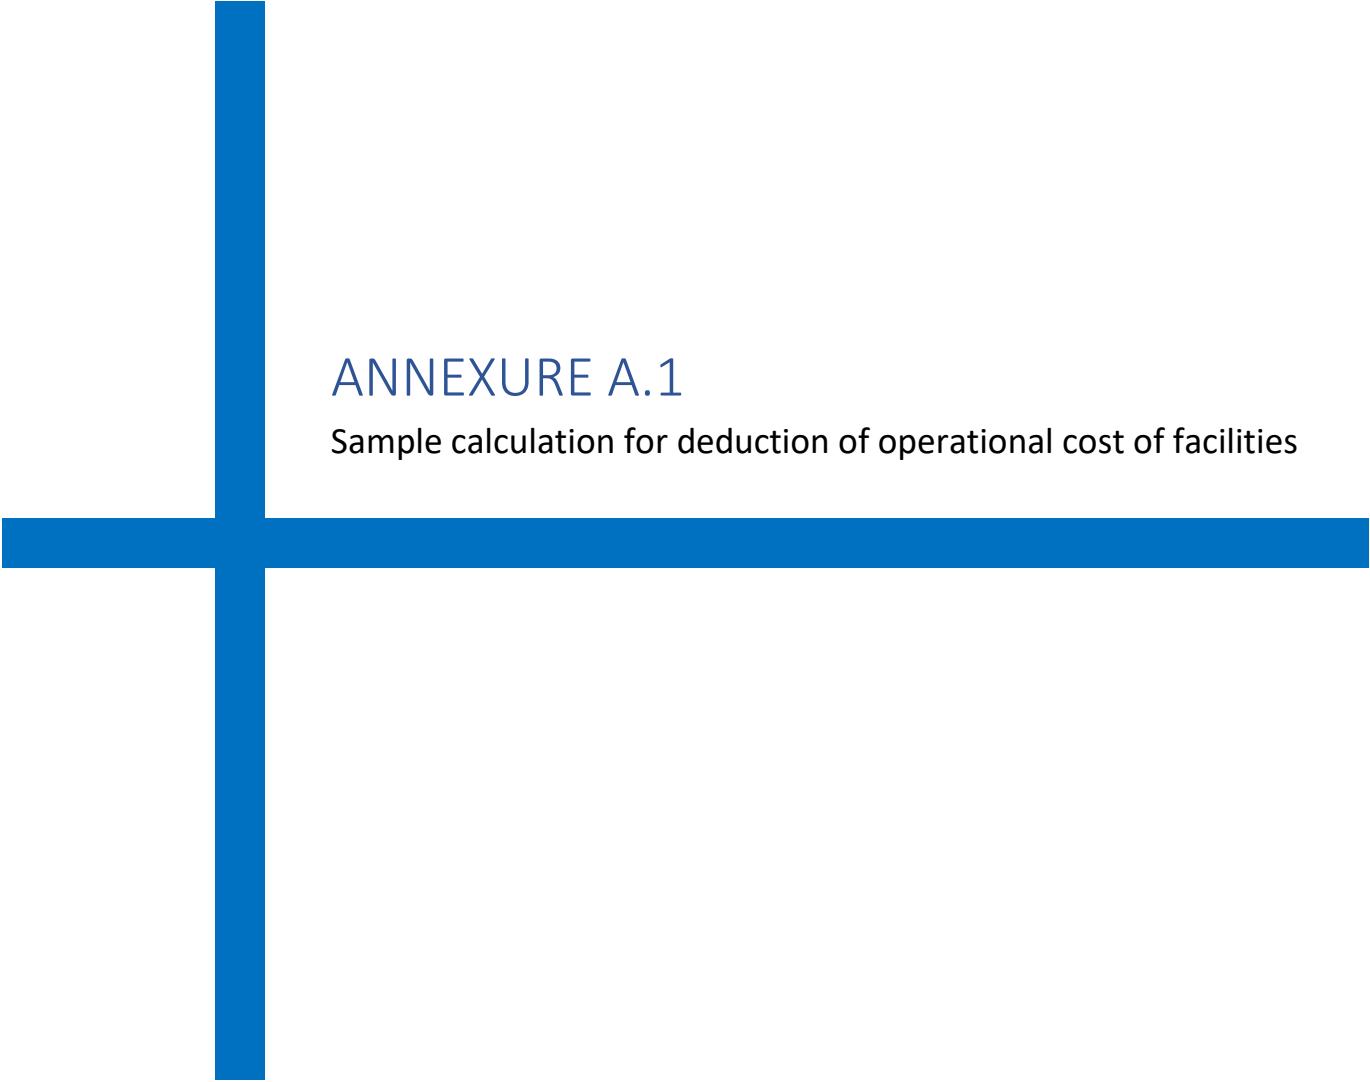

ANNEXURE A.1

Sample calculation for deduction of operational cost of facilities

Annexure A.1**Cost Calculation Methodology of Operation of Facilities (Data is indicative only)**

(Period of 48 months is considered - shall be on actual basis)

A. Project Info:

Total time of Project	48 months
Project cost	1000 Crore
No. of packages	10 (A1-A10)

B. Item-wise Calculation:

Item	Nos.	Rate	Unit	Amount
Ambulance with Driver	2		Monthly/Unit	170000
Nurse/First aider	2 X 2 shifts	15000	Per month	30000
Training center one time cost	1	100000	Once	100000
Medical center one time cost	1	200000	Once	200000
Medicines at medical center	1	10000	Monthly	10000
Dust suppression water tank	2	2000	Monthly	4000
Doctor	1	70000	Monthly	70000
Cleaning staff	1	12000	Monthly	12000
Recurring monthly expenditure				296000
Total one-time expenditure				300000

C. Package-wise Deduction Plan for a period of 48 months


Period (In Months)	6	36	6
	For 1-6 months	For 7-42 months	For 43-48 months
Cost to be incurred from contractors	7%	81%	12%
	1.17% per month	2.25% per month	2.00% per month

D. Calculation For One-Time Running Cost

Packages/ Contracts	A1	A2	A3	A4	A5	A6	A7	A8	A9	A10				
Contract Values (in Thousands)	100000	250000	2000000	200000	500000	1500000	1000000	1000000	250000	200000	7000000			
Share of common facilities one time running cost (in Thousands)	4	11	86	9	21	64	43	43	11	9	Individual Pkg value X Total one time running cost / All Pkg award values			
Timeline of work	1-6	1-8	2-48	6-36	7-15	10-48	6-48	7-40	40-48	41-48				
Month Count of work	6	8	47	31	9	39	43	34	9	8				
Deduction per month (in Thousands)	1	1	2	0	2	2	1	1	1	1	Total of One time Running cost (in thousands)	% deduction share of one time running cost per month	Nos. of active packages in month	
Month No.														
1	1	1									2	1%	2	
2	1	1	2								4	1%	3	
3	1	1	2								4	1%	3	
4	1	1	2								4	1%	3	
5	1	1	2								4	1%	3	
6	1	1	2	0			1				5	2%	5	
7		1	2	0	2		1	1			8	3%	6	
8		1	2	0	2		1	1			8	3%	6	
9			2	0	2		1	1			7	2%	5	
10			2	0	2	2	1	1			8	3%	6	
11			2	0	2	2	1	1			8	3%	6	
12			2	0	2	2	1	1			8	3%	6	
13			2	0	2	2	1	1			8	3%	6	
14			2	0	2	2	1	1			8	3%	6	
15			2	0	2	2	1	1			8	3%	6	
16			2	0		2	1	1			6	2%	5	
17			2	0		2	1	1			6	2%	5	
18			2	0		2	1	1			6	2%	5	
19			2	0		2	1	1			6	2%	5	
20			2	0		2	1	1			6	2%	5	
21			2	0		2	1	1			6	2%	5	
22			2	0		2	1	1			6	2%	5	
23			2	0		2	1	1			6	2%	5	
24			2	0		2	1	1			6	2%	5	
25			2	0		2	1	1			6	2%	5	
26			2	0		2	1	1			6	2%	5	
27			2	0		2	1	1			6	2%	5	
28			2	0		2	1	1			6	2%	5	
29			2	0		2	1	1			6	2%	5	
30			2	0		2	1	1			6	2%	5	
31			2	0		2	1	1			6	2%	5	
32			2	0		2	1	1			6	2%	5	
33			2	0		2	1	1			6	2%	5	
34			2	0		2	1	1			6	2%	5	
35			2	0		2	1	1			6	2%	5	
36			2	0		2	1	1			6	2%	5	
37			2			2	1	1			6	2%	4	
38			2			2	1	1			6	2%	4	
39			2			2	1	1			6	2%	4	
40			2			2	1	1	1		7	2%	5	
41			2			2	1		1	1	7	2%	5	
42			2			2	1		1	1	7	2%	5	
43			2			2	1		1	1	7	2%	5	
44			2			2	1		1	1	7	2%	5	
45			2			2	1		1	1	7	2%	5	
46			2			2	1		1	1	7	2%	5	
47			2			2	1		1	1	7	2%	5	
48			2			2	1		1	1	7	2%	5	
Total	4	11	86	9	21	64	43	43	11	9	300	100%		

D. Calculation For Recurring Running Cost

Packages/ Contracts	A1	A2	A3	A4	A5	A6	A7	A8	A9	A10		
Contract Values (in Thousands)	100000	250000	2000000	200000	500000	1500000	1000000	1000000	250000	200000	7000000	
Timeline of work	1-6	1-8	2-48	6-36	7-15	10-48	6-48	7-40	40-48	41-48	Total of Recurring cost (in thousands)	Nos. of active packages in month
Month No.	6	8	47	31	9	39	43	34	9	8		
1	85	211									296	2
2	13	31	252								296	3
3	13	31	252								296	3
4	13	31	252								296	3
5	13	31	252								296	3
6	8	21	167	17			83				296	5
7		15	120	12	30		60	60			296	6
8		15	120	12	30		60	60			296	6
9			126	13	31		63	63			296	5
10			95	10	24	72	48	48			296	6
11			95	10	24	72	48	48			296	6
12			95	10	24	72	48	48			296	6
13			95	10	24	72	48	48			296	6
14			95	10	24	72	48	48			296	6
15			95	10	24	72	48	48			296	6
16			104	10		78	52	52			296	5
17			104	10		78	52	52			296	5
18			104	10		78	52	52			296	5
19			104	10		78	52	52			296	5
20			104	10		78	52	52			296	5
21			104	10		78	52	52			296	5
22			104	10		78	52	52			296	5
23			104	10		78	52	52			296	5
24			104	10		78	52	52			296	5
25			104	10		78	52	52			296	5
26			104	10		78	52	52			296	5
27			104	10		78	52	52			296	5
28			104	10		78	52	52			296	5
29			104	10		78	52	52			296	5
30			104	10		78	52	52			296	5
31			104	10		78	52	52			296	5
32			104	10		78	52	52			296	5
33			104	10		78	52	52			296	5
34			104	10		78	52	52			296	5
35			104	10		78	52	52			296	5
36			104	10		78	52	52			296	5
37			108			81	54	54			296	4
38			108			81	54	54			296	4
39			108			81	54	54			296	4
40			103			77	51	51	13		296	5
41			120			90	60		15	12	296	5
42			120			90	60		15	12	296	5
43			120			90	60		15	12	296	5
44			120			90	60		15	12	296	5
45			120			90	60		15	12	296	5
46			120			90	60		15	12	296	5
47			120			90	60		15	12	296	5
48			120			90	60		15	12	296	5
Total	143	388	5676	329	235	3102	2334	1772	132	96	14208	

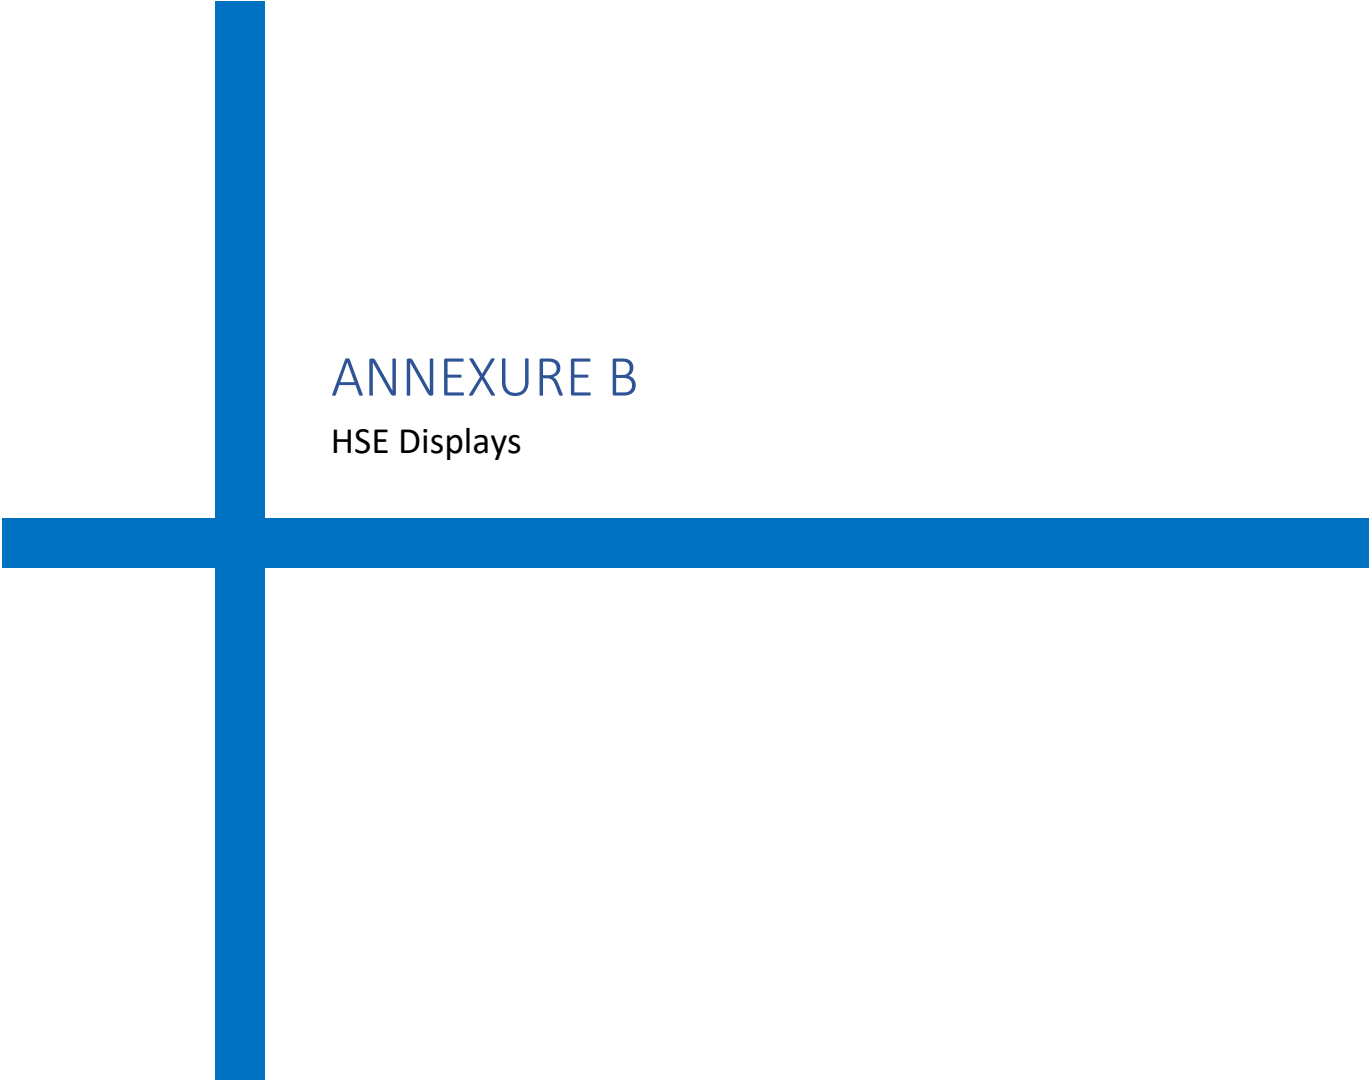

ANNEXURE B

HSE Displays

A. Types of Displays**1. Based on Content**

SN	Type
1.	HSE Hazards & Precautions Height Work, Housekeeping, Fire Safety, PPEs, Hot Work, Lifting & Rigging Activity, Site-specific Hazards – eg. for Refineries, Nuclear plants etc.; COVID Precautions; Environment Protection etc.
2.	Other Displays, Signage etc. HSE Policy, ISO Certificate, Safety Statistics, Assembly Area Location/ Route, Emergency Contact Numbers, Site Safety Rules & Regulations, Speed Limit, Work in Progress, Lock-Out Tag-Out (LOTO) Boards etc.

2. Based on Mounting

[Type 1]	[Type 2]	[Type 3]
Flex Sign Boards of Wooden Frame – directly mounted on Structures (walls, stairs, railings etc.)	Flex Sign Boards with Wooden Frame – mounted on metallic/ wooden legs – preferably double-sided	Coloured weather-proof Paintings on Walls (after due concurrence of BHEL/ Customer – Type 1 in case of no concurrence/ space)

B. General Requirements:

- Displays should be weather-proof as per installation location, i.e. rain-proof, wind-proof and sun-proof.
- Installation location and size to ensure visibility for the intended viewers (workers and moving personnel)
- Displays to have at least 50% graphical elements preferably (as applicable). Language should be understandable by majority of the workers
- Displays to be relevant to the hazards in the area
- Proper installation to ensure boards don't obstruct activities and should not be prone to fall so as to pose danger
- In case of multiple elevations (eg. Boiler, Power-house etc.), each elevation to have displays for applicable hazards including Height-Work, Housekeeping
- For temporary work locations, posters/ boards may be erected and shifted after task is over
- Minimum size of displays should be A1 unless otherwise specified
- In case of damage, displays shall be reviewed and repaired/ replaced
- In areas where night work is envisaged, fluorescent displays shall be installed and these should comprise of at least 20-30% of total displays
- Total Number of displays to be not less than 1 per 10 workers and are to be dynamically updated based on number of workers

C. Area-wise Displays

Below is list of Area-wise displays that are to be installed at Sites (Numbers, locations may be adjusted for specific requirements)

SN	Area	Suggested Subjects	Minimum Size	Minimum Quantity	Locations
1	Walls/ Foundations/ Cement Structures etc. belonging to the package area	Safety Hazards Prevention and other HSE Awareness content	[Type 3]	As per BHEL assessment from time to time	
2	Site Interior Roads belonging to the package area	At least every 20 meters: 1. Speed Limit Indication, Safe Driving board 2. Boards for hazard awareness	1.As needed [Type 2] 2. A1 or equivalent each [Type 2]	As indicated	Sides of Roads; Height to ensure good visibility
3	Specific Package Areas	A. Common At entry to respective Package/ Work Area, each contractor to put up daily updated board with following for each shift: 1. Scope of work and start date 2. Emergency Contact Numbers 3. Emergency Assembly Location, Escape Plan 4. Locations and supervisors of various gangs in the area, 5. Current Work permit Details 6. Safety Supervisor Location assignments - Names, Mobile Nos., Assigned Locations 7. Details (Name, Contact No. etc.) of Package In-charge - Contractor & BHEL 8. Details (Name, Contact No. etc.) of Safety In-charge - Contractor & BHEL 9. LTI Free Man-days & details of last LTI also to be indicated In addition, Area-Specific Displays as indicated in Table 1	A0 [Type 2]	1 per Package Area	Entry/ Ground Level


Table 1
(Area/ Package-wise HSE Display Plan – As applicable)

Prepared By (Subcontractor)				
S. No.	Area	Suggested Minimum No. of Displays & Types	Type	Numbers Installed
1	Boiler	3 per working elevation	[Type 1]	
2	Powerhouse	5 per elevation	[Type 1]	
3	ESP	5 Per Pass	[Type 1]	
4	Buildings	5 per elevation	[Type 1]	
5	Cooling Tower (NDCT/ IDCT/ ACC)	20 per Structure	[Type 1]	
6	Chimney	20 per Structure	[Type 1]	
7	Fabrication Yard	10 per Yard	[Type 2]	
8	Batching Plant	5 per Plant	[Type 1]	
9	Material Storage Yard – Open	20 per Yard	[Type 2]	
10	Material Storage Shed – Semi-Closed/ Closed	10 per Shed	[Type 1]	
11	Electrical Booths	2 per booth + Line diagram, Emergency contact details	[Type 1]	
12	Medical & First Aid Centre	2 per Centre	[Type 1]	
13	Rest Shed	2 per Shed	[Type 1]	
14	Canteen	2 per Canteen	[Type 1]	
15	Drinking Water Area	1 Per Outlet	[Type 1]	
16	Washing Water Area	1 Per Outlet	[Type 1]	
17	Training Centre	10 per room	[Type 1/2]	
18	Assembly Area	5	[Type 1/2]	
19	Stairs	1 per landing elevation	[Type 1]	
20	Cylinder Storage Area	5 + Signage: Type of Gas, Empty, Filled etc.	[Type 1/2]	
21	Labor Colony	Electrical Safety with Distribution Plan/ Line Diagram - 1 COVID Precautions Posters – 5 Safety Awareness Posters – 10 Hygiene awareness posters - 2	[Type 1]	
22	Others	As per requirement	[Type 1/2]	

Date:

Sign (Contractor)

Sign (BHEL)

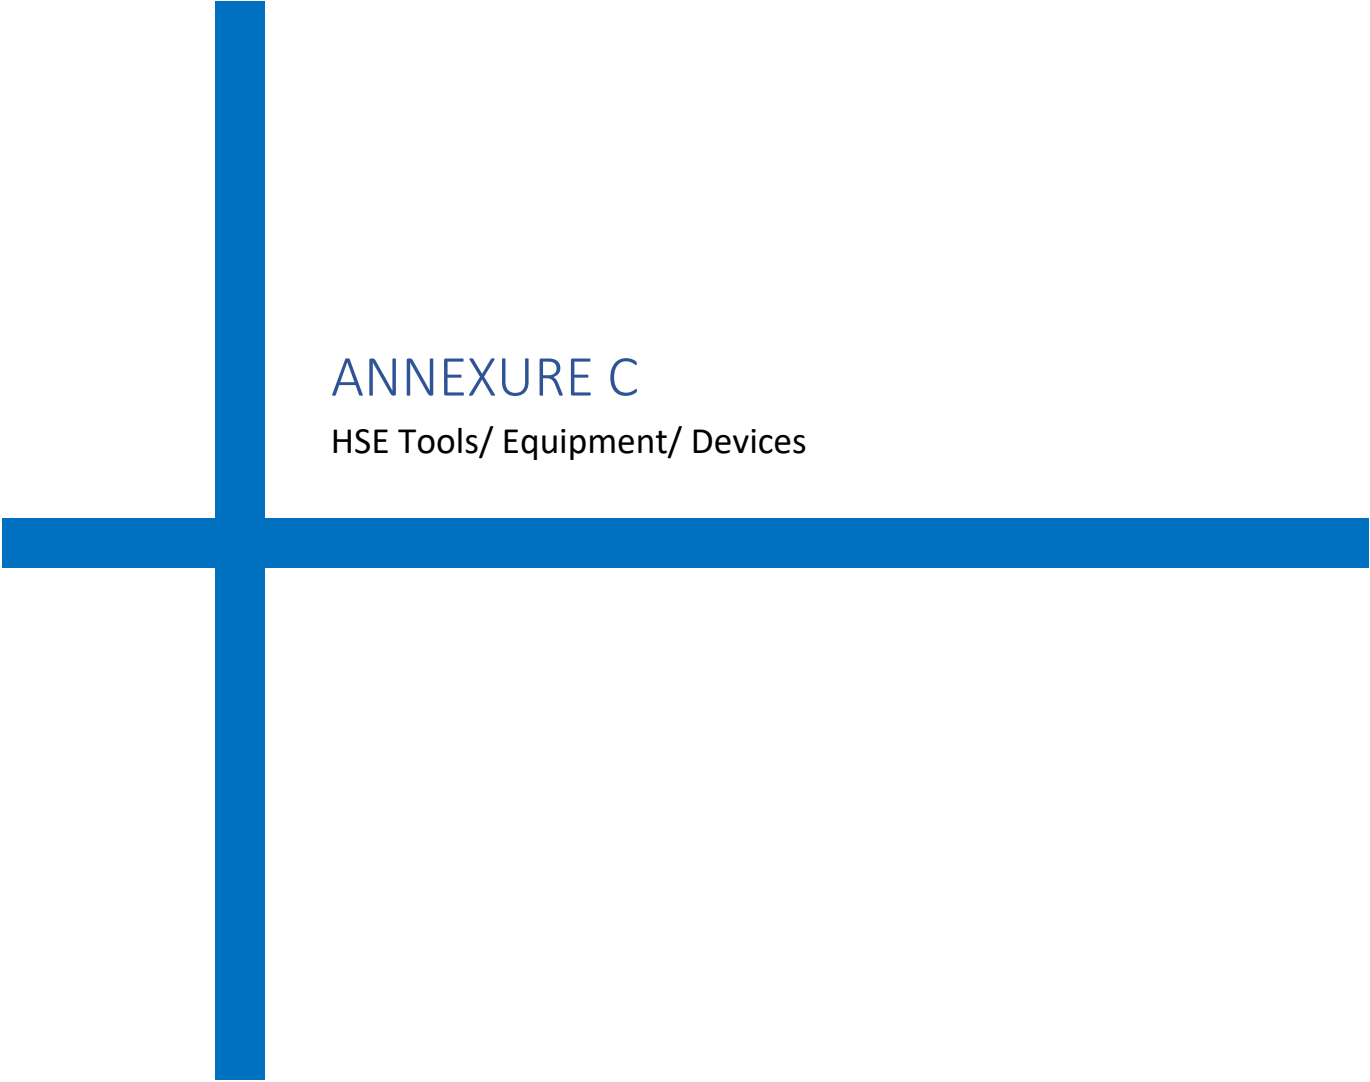

ANNEXURE C

HSE Tools/ Equipment/ Devices


Following equipment conforming to relevant IS/ISO/BS Codes/ Standards in indicated quantities shall be ensured by subcontractor. This list is tentative, not exhaustive. Quantity and date/ period of deployment shall be as per site requirement.

A. HSE Tools/ Equipment/ Devices

SN	Item
1	Lifelines
2	Retractable Fall Arrestors
3	Safety Nets (10m X 5m) fire proof double mesh
4	Sky Climbers
5	Fire Blanket
6	Honey Bee Removal Suit & Kit
7	Scaffolding Pipes
8	Flashback Arrestors
9	Barricading Tape
10	Binoculars
11	Walkie-Talkies
12	LOTO kit
13	24-Volt light
14	Sand Buckets
15	Hard barricading Pipes
16	Standby Fire kits
17	Hand-held Megaphone
18	Small Public Address System
19	Foldable Stretcher
20	Height Rescue Kit (Non-Motorized)
	(Others:)

B. Test & Measurement Devices

SN	Device
1	ELCB Tester
2	Multi meter (Light cables)
3	Earth Resistance Meter
4	Lux Meter
5	Sound Meter
6	Anemometer
7	Breath Analyzer (Alcohol)
8	Multi-gas dozi-meter/ detector
9	Gas leakage detector / alarm
10	Gas monitor (confined space)
11	Radiation meter & Badges
12	Blood Pressure Monitor
13	Fire detectors
14	Hand held signaling light
	(Others:)

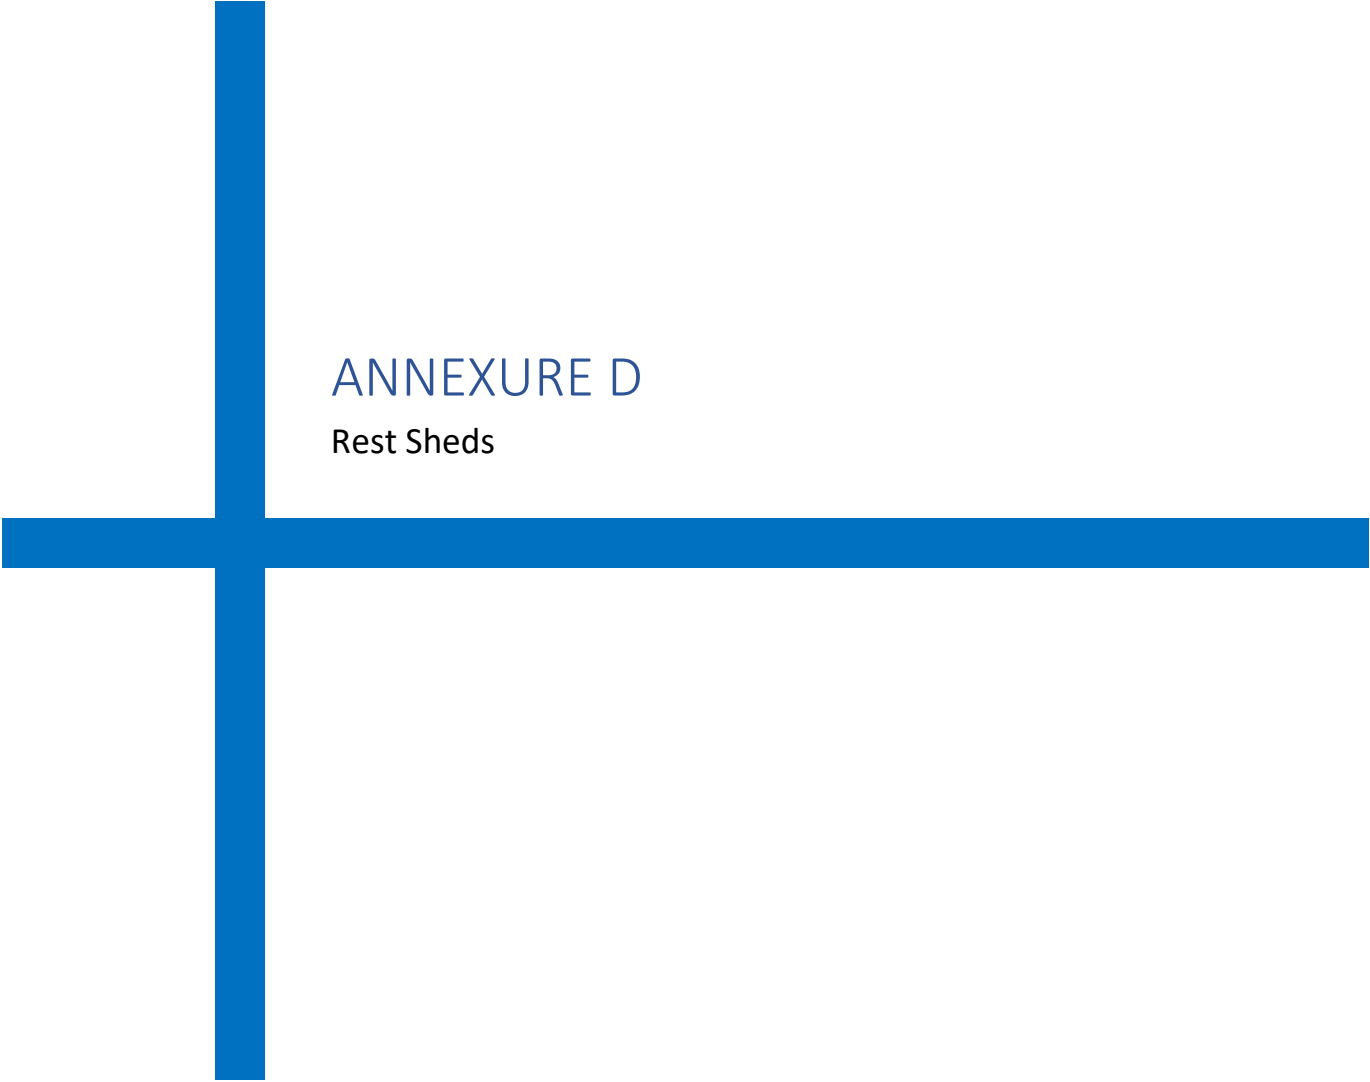

ANNEXURE D

Rest Sheds

1. Determining the Number, Sizes and Locations of Rest Shelters

i. **Numbers:**

The number of rest shelters shall be determined based on maximum number of workers at any one time (across all shifts). Formula is:

W_{max} = Maximum number of workers at any time in the Site

Space per worker = 1.1 sq meter

Total space required, $T_{space} = W_{max} \times 1.1$

Based on total space requirement calculated above, the number of rest sheds can be decided according to availability of locations and concentration of workers – so as to ensure the required space.

ii. **Locations:**

The rest sheds should be so located so as to minimize the distance to be travelled by the workers from their locations of work considering all the practical constraints

iii. **Other:**

The Rest shelter should be fenced so that it cannot be used as parking area.

2. Design & Construction of Rest Sheds

a. **Permanent/ Long duration Rest Sheds**

- i. For locations where, permanent rest sheds can be constructed without possibility of removal for relatively long period of time, a semi-closed shed can be constructed covered with tin roof and supported with well-grouted beams. The floor of the shed to be preferably cemented/ solidified.
- ii. Adequate structural requirements suitable to the local weather (wind/ rain etc.) to be ensured.
- iii. The design of the rest shed to be approved by Civil Engineering Department of BHEL Site before commencing work

b. **Temporary/ Movable/ Portable Rest Sheds**

- i. For locations where, permanent rest sheds cannot be constructed either due to non-availability of permanent location or other reasons, temporary rest shed shall be constructed.
- ii. Temporary rest sheds shall comprise of Tent arrangement carried out by professional agencies

3. Amenities in Rest Sheds

a. **Essential Amenities**

Following amenities shall be essentially ensured in a rest shed:

- i. Hygienic environment with regular cleaning and housekeeping (with records)
- ii. Adequate illumination
- iii. Adequate ventilation/ heating as per weather conditions
- iv. Clean Drinking water source
- v. Hand Washing area
- vi. Toilets & Urinals
- vii. Benches/ mats for sitting/ lying
- viii. Any other essential requirement deemed necessary by the Site
- ix. Dust bins of sufficient quantity/ size that are vacated each day/ as per requirement

b. **Additional/ Optional Amenities**

Following amenities are optional but are recommended to enhance the level of satisfaction of work force:

- i. Hot/ Cold drinks (Tea, Coffee, Glucose etc.) as per requirement
- ii. Snacks
- iii. Fans/ Coolers/ Heating arrangements as per requirement and weather conditions
- iv. A nice, welcoming interior design, music etc.
- v. Water cooler

4. Health & Safety Requirements of Rest Sheds


Use of asbestos in construction is banned and shall not be used.

In addition, following essential Safety features shall be ensured in Rest sheds:

- i. Availability of Fire extinguishers (preferably CO2 type)
- ii. Display of Safety Posters
- iii. Pest/ reptile protection
- iv. Mosquito prevention measures

5. Note:

Any suitable closed spaces/ newly constructed buildings etc. available at project may also be used for the purpose of rest shed with due concurrence of BHEL

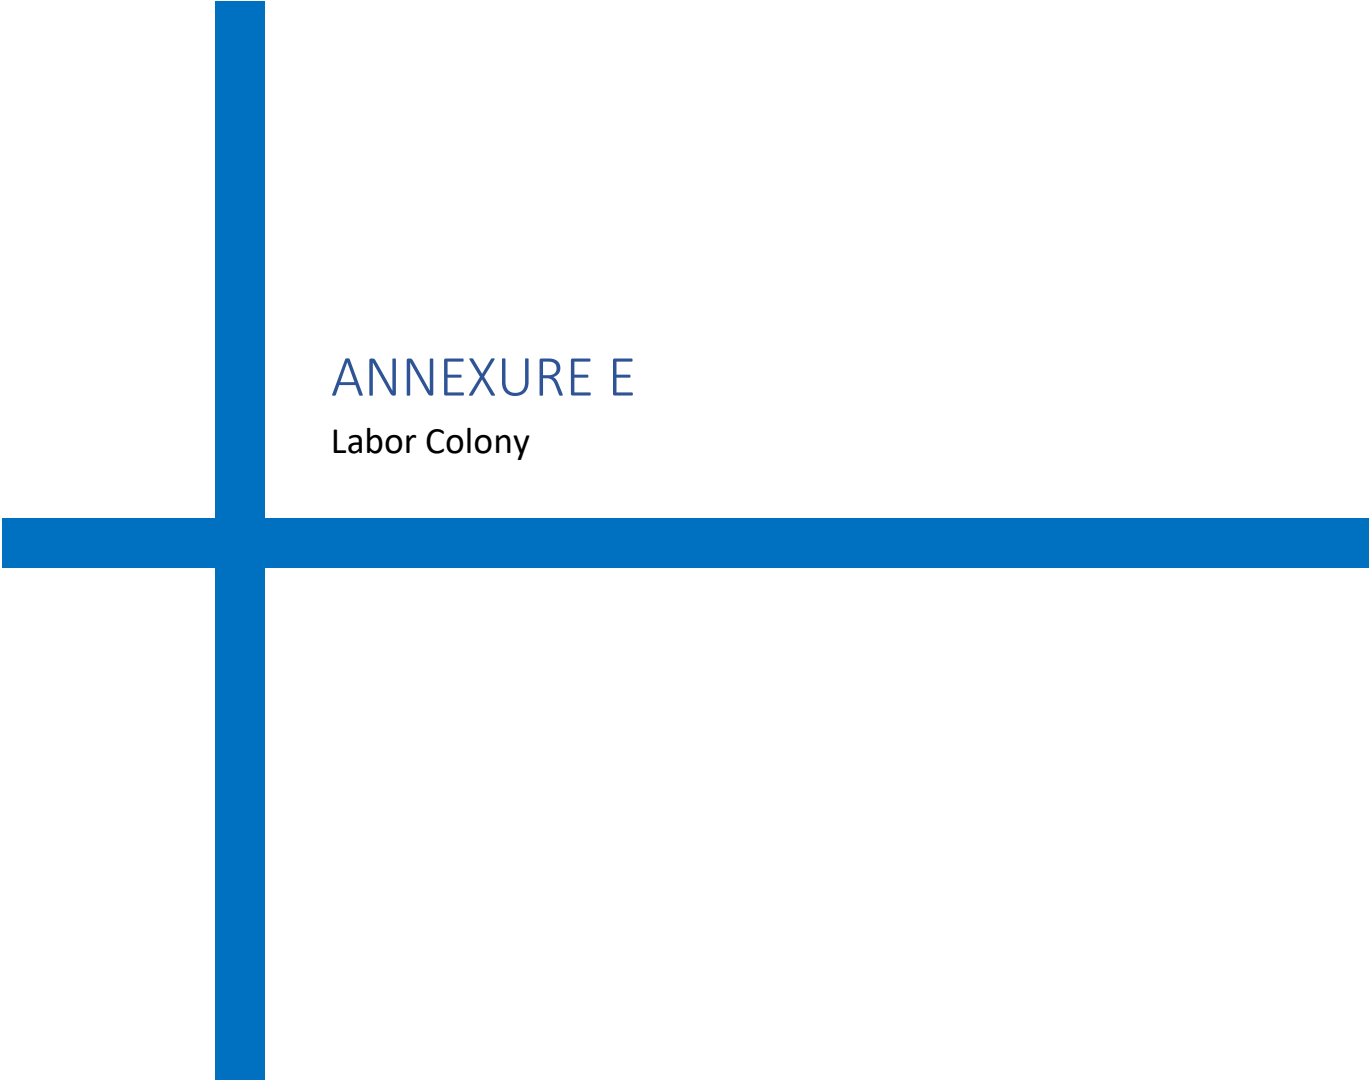

ANNEXURE E


Labor Colony

1. These Guidelines suggest minimum requirements. However, additional requirements based on feasibility and circumstances, while adhering to directions of GOI/District Administration/Local Authority guidelines to be considered
2. Norms for social distancing, training/ awareness, face masks, disinfection, sanitization, gate entry, quarantine, medical, action in case of suspect cases of COVID and other communicable diseases etc. to be followed as per Govt. and BHEL guidelines issued from time to time
3. Labor colony to be developed as close to the Site as possible to avoid lengthy commute
4. A "Suggestion Register" shall be made available at the labor colony for residents. The feedback shall be reviewed on weekly basis and acted upon by concerned Contractor. Same shall be reviewed periodically by authorized BHEL Site Official.
5. **Canteens, Latrines & Urinals, Washing Facilities, Creches, Residential Accommodation and other infrastructure/ facilities:**
Numbers/ Quantities and Features of these facilities shall be in line with the following as applicable:
 - a. BOCW Act & State Rules
 - b. The Inter-State Migrant Workmen (Regulation of Employment and Conditions of Service) Act & State Rules
 - c. Factories Act & State Rules
 - d. Other Relevant Acts & Rules
6. **Cleanliness & Hygiene/ Housekeeping:**
 - a. Regular cleaning of the labor colony to be ensured.
 - b. Daily cleaning of Sanitary facilities.
 - c. Proper drainage system to prevent water-logging
 - d. Regular fogging to prevent spread of mosquitoes
 - e. Prevention of foul smell through necessary interventions
 - f. Dust suppression as per requirement
 - g. Cutting of Grass at regular intervals and other necessary measures to prevent pests & reptiles
 - h. Stray animals to be banned from labor colony.
 - i. Outside every common facility, eg. Toilet, washroom, food hall/ canteen etc., provision of washbasin with flowing water and soap (preferably liquid soap) to be ensured
7. **Power Supply Layout:**
Electrical supply Layout of Labor Colony shall have the provision of Safety devices like MCBs, ELCBs etc. and to be clearly displayed
8. **Washing & Drinking Water Availability**
 - a. Adequate water to be provided in line with: "Estimation of Water Requirements for Drinking and Domestic Use (Source: National Building Code 2016, BIS)"
 - b. Drinking water tank to be cleaned every week and sticker for the same pasted on the tank
 - c. Drinking water source should be tested as per IS 10500
9. **Waste Disposal:** Separate bins for dry, wet and biomedical waste to be installed. These bins to be evacuated regularly
10. **Training & Awareness/ Displays**
 - a. **HSE Awareness Displays:** Posters/ banners/ boards to be displayed in labor colony. Subjects of displays shall be precautions for applicable hazards at work site.
 - b. **Emergency Contact Numbers** including that of Doctor, Hospital, Labor Colony Supervisor, HSE Officials to be displayed prominently

11. Doctor Visits:

Regular and need-based visits by Doctors to be ensured through tie-ups etc.

12. Inspection & Review: Regular inspection of labor accommodation to be carried out by the Contractor as per prescribed format. Last inspection date, inspector and next due date to be prominently indicated near main gate**13.** Provision of a Fair Price shop in the premises to be ensured as per requirement**14.** Adequate arrangements to be ensured in case of children/ families

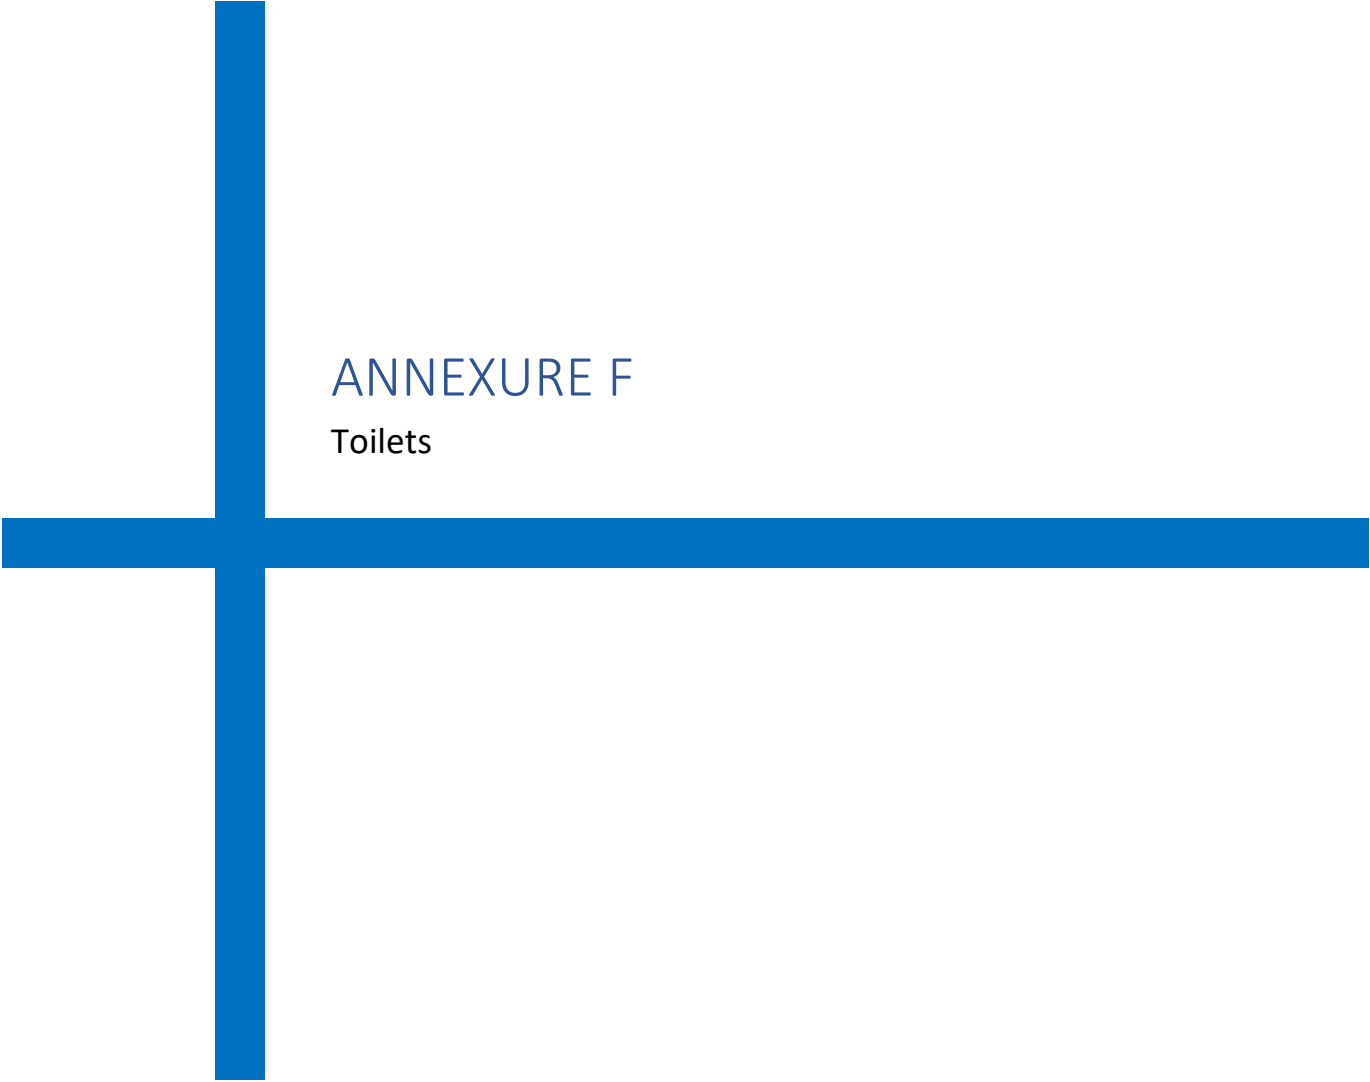

ANNEXURE F


Toilets

Toilets (Latrines and urinals shall be ensured at Site and Labor Colony in accordance with the Inter-State Migrant Workmen Act, 1979 as given below:

LATRINES	URINALS
1. Latrines shall be provided in every establishment on the following scale, namely: - - Where females are employed, there shall be at least one latrine for every 25 females; - Where males are employed, there shall be at least one latrine for every 25 males: Provided that where the number of males or females exceeds 190, it shall be sufficient if there is one latrine for 25 males or females, as the case may be, up to the first 100, and one for every 30 thereafter 2. Every latrine shall be under cover and so partitioned off as to secure privacy, and shall have a proper door and fastenings.	1. There shall be at least one urinal for male workers up to fifty and one for female up to fifty employed at a time: Provided that where the number of male or female workmen, as the case may be, exceeds 500 it shall be sufficient if there is one urinal for every fifty females up to the first 500 and one for every 100 or part thereof thereafter. 2. The urinals shall be designed and located so as to ensure privacy.

Important:

- Where workers of both sexes are employed there shall be displayed outside each block of latrine and urinal a notice in the language understood by the majority of the workers '**For Men Only**', or '**For Women Only**', as the case may be.
- The notice shall also bear the figure of a man or of a woman, as the case may be.
- The latrines and urinals shall be conveniently situated and accessible to workers at all times at the establishment.
- The latrines and urinals shall be adequately lighted and shall be maintained in a clean and sanitary condition at all times.
- Latrines and urinals other than those connected with a flush sewage system shall comply with the requirements of the public health authorities.
- Water shall be provided by the means of tap or otherwise so as to be conveniently accessible in or near the latrines and urinals.
- At Site, on ground, **Modular Bio-toilets** as per industry standard specifications and regular professional cleaning shall be ensured. The toilets should be sufficient in number and easily accessible to workers from every work area
- At Site, in various elevations, suitable urinals with proper drainage to be ensured at each elevation in line with IS 2064 (1993). Same to be cleaned regularly

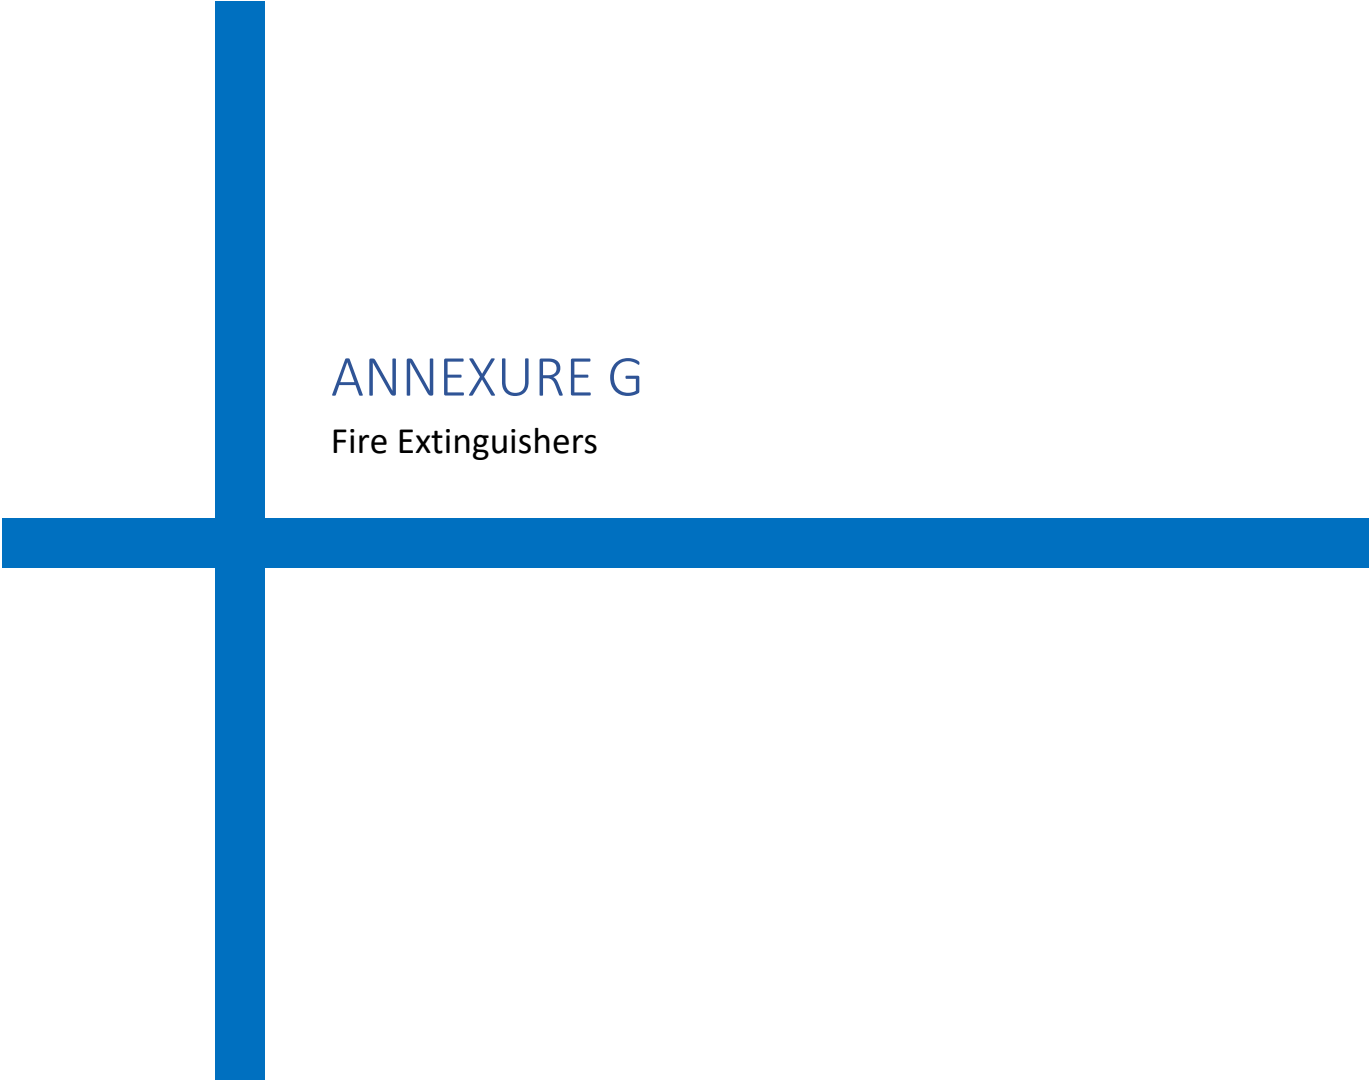

ANNEXURE G

Fire Extinguishers

SN	Type of Fire Risk (Class of Fire)	Extinguishing Medium & Relevant INDIAN STANDARD	Scale of Equipment (Minimum recommended)
1.	CLASS 'A' Fires involving ordinary combustible materials like wood, paper, textiles, rubber etc. (Ordinary hazard or low fire load)	WATER Soda acid type, water type (gas pressure) and water type (constant air pressure) IS: 934 -1976; IS: 940 -1976; IS: 6234 -1971	For every 600 square meter floor area or part, one 9-litre capacity. Minimum 4 numbers per floor or room; should not be required to travel more than 15 meter to reach any extinguisher.
2.	CLASS 'A' (Extra hazard & high fire load)	-do	-do – (Also, consult local fire authority).
3.	CLASS 'A' (Special hazards)	-do	-do – Extra provision For every 100 square meter floor area or part, one 4.5 Kg. CO ₂ ; minimum 2 numbers per room; should not be required to travel more than 10 meter to reach any extinguisher.
4.	CLASS 'B' (Fires in flammable liquids like oils, solvents, petroleum, products, varnishes, paints, etc. where blanketing effect is essential) (Storage and handling in small quantities)	FOAM / CARBON DIOXIDE / DRY CHEMICAL POWDER IS: 933 -1976; IS: 2878 1976; IS: 2171 1976; IS: 4308 -1982	For every 50 square meter floor area or part, 2 numbers 9 -liters foam or 5 kg dry powder; should not be required to travel more than 10 m in the area of storage to reach any extinguisher.
5.	CLASS 'B' (Bulk storage other than in tank form))	-do -	-do- (but minimum 3 numbers per room)
6.	CLASS 'C' (Fires involving gaseous substances under pressure where it is necessary to dilute the burning gas at a very fast rate with an inert gas or powder) (storage and handling of gas cylinders)	CARBON DIOXIDE / DRY CHEM. POWDER. The best way to extinguish such fire is by stopping the flow of fuel gas to the fire. Container is kept cool with water spray. IS: 2878 1976; IS: 2171 -1976; IS: 4308 -1982	For every 100 square meter floor area or part; 2 numbers, 10 kg powder extinguisher or 6 kg CO ₂ ; minimum 3 nos. per room; should not be required to travel more than 10 meter to reach any extinguisher.
7.	CLASS 'D' Fires involving metals like magnesium, aluminum, zinc, potassium etc. where the burning metal is reactive to water and which require special extinguishing media or technique	SPECIAL DRY POWDER IS: 2171 -1976 IS: 4861 -1968	For every 50 square meter floor area or part, 2 nos. 5 kg special dry powder; minimum 3 nos. per room; should not be required to travel more than 10 meter to reach any extinguisher.
8.	MIXED OCCUPANCY (electrical); Generators; Transformers; etc.	CARBON DIOXIDE DRY POWDER, IS: 2878 1976; IS: 2171 -1976	For every 100 square meter floor area or part one 10 kg CO ₂ . Minimum 2 numbers for every location should not be required to travel more than 10 meter to reach an extinguisher.


Note: Due to peculiarities of the power plant construction sites, there would be locations in the construction areas of Boiler, Turbine, Generator, Transformer, etc. where different types of fire risk (classes of fire) may co-exist. Special care shall be taken while selecting and installing portable fire extinguishers for such locations so that all types of fire risk that may co-exist, are adequately covered. Similar special care shall be taken for storage areas.

a. All Electrical welding booths shall be equipped with appropriate Fire Extinguisher

Bharat Heavy Electricals Limited, Power Sector

Regd. Office: BHEL House, Siri Fort, New Delhi-110049

- b. Appropriate Fire Extinguishers shall be made within easy reach of all welding operations
- c. Fire extinguishers shall be regularly tested and last checked date to be indicated on each. Master list shall be prepared with location and details
- d. Providing appropriate fire-fighting equipment at designated work place and nominate a fire officer/warden adequately trained for his job.
- e. Subcontractor shall provide enough fire protecting equipment of the types and numbers at his office, stores, temporary structure in labour colony etc. Such fire protection equipment shall be easy and kept open at all times.
- f. The fire extinguishers shall be properly refilled and kept ready which should be certified at periodic intervals. The date of changing should be marked on the Cylinders.
- g. All other fire safety measures as laid down in the “codes for fire safety at construction site” issued by safety coordinator of BHEL shall be followed.
- h. Non-compliance of the above requirement under fire protection shall in no way relieve the subcontractor of any of his responsibility and liabilities to fire incident occurring either to his materials or equipment or those of others.
- i. Emergency contacts nos. must be displayed at prominent locations
- j. Tarpaulin being inflammable should not be used (instead, only non-infusible covering materials shall be used) as protective cover while preheating, welding, stress relieving etc. at site.

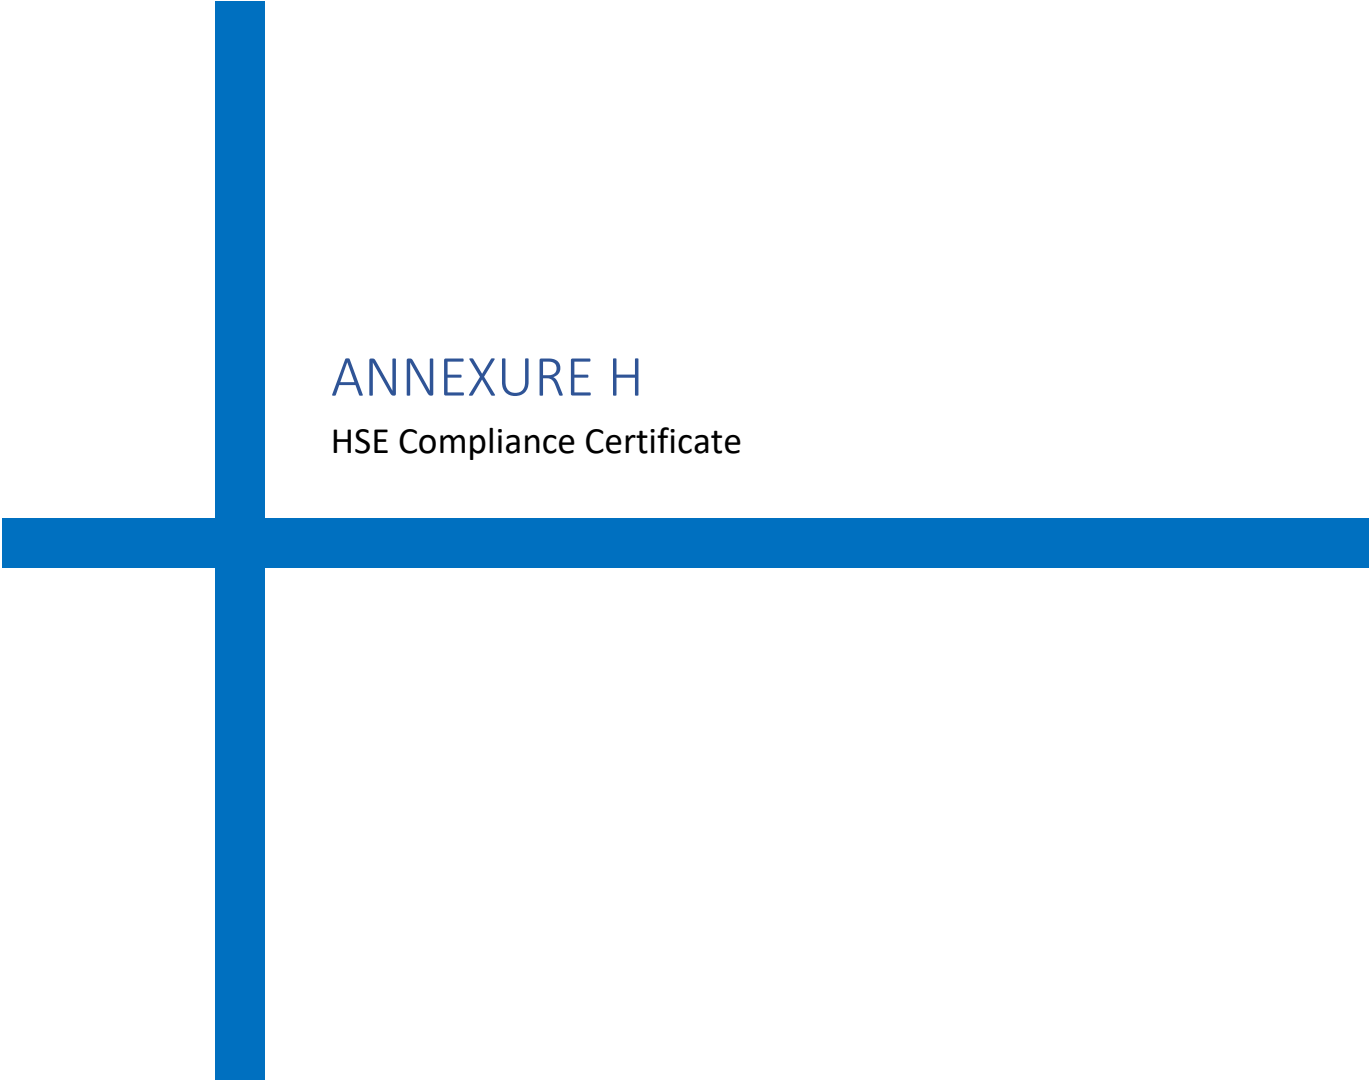

ANNEXURE H

HSE Compliance Certificate


Bill Ref no: _____ Date: _____

NAME OF THE AGENCY: _____ Work-Area/Package: _____

Sl. No.	Description	Remarks
1	<u>HOUSE KEEPING:</u>	
1.1	All working areas at site (specific to the agency) are free from garbage's, scraps & any other undesired non-plant materials. There is no encroachment in safe passage of man, material & T&P to carry out activities safely	
1.2	All the plant materials under the custody of the agency are stacked & stored properly.	
2	<u>GENERAL ILLUMINATION:</u>	
2.1	ALL the working areas at site & office of the agency including passages are having proper & sufficient illumination.	
3	<u>STATUTORY & REGULATORY REQUIREMENT:</u>	
3.1	Sufficient water for drinking & other purposes and sanitation in work area and labour colony are available.	
3.2	Periodical Medical check-up of workers & staff done regularly & report submitted to BHEL	
3.3	Regular EYE testing is done for Crane operators/Welders and data's are available with agency	
3.4	All the T&P, Cranes etc used by the agency are having proper T.Cs & Fitness certificate available from competent authority.	
4	<u>SAFETY COMPLIANCE:</u>	
4.1	Number of Tool box meetings between Safety officers, erection staff & workers of the agency held in this month with location mentioned	
4.2	All precautions & Safety measures including PPE compliances are taken before working at HEIGHT	
4.3	Permit for working at Height is taken & complied accordingly	
4.4	ELCB is used in Construction Power Supply source by the agency & Proper Distribution board and electrical cabling has been used by the agency and regularly checked by electrician & safety officer of the agency	
4.5	Unsafe areas barricaded properly & unsafe opening closed properly	
4.6	Proper Platforms & Hand-rails used In areas earmarked earlier	
4.7	Proper safety signage's, Slogans & Emergency contact phone numbers including FIRE contact nos. are made available by the agency in locations mentioned	
5	Whether any penalty imposed by BHEL towards non-compliance of above points.	

<u>VENDOR'S SIGNATURE</u>	
Erection Engineer	
HSE Officer	
Site-in-Charge	

<u>BHEL'S SIGNATURE</u>	
Erection Engineer	
HSE Officer	
Package-in-Charge	

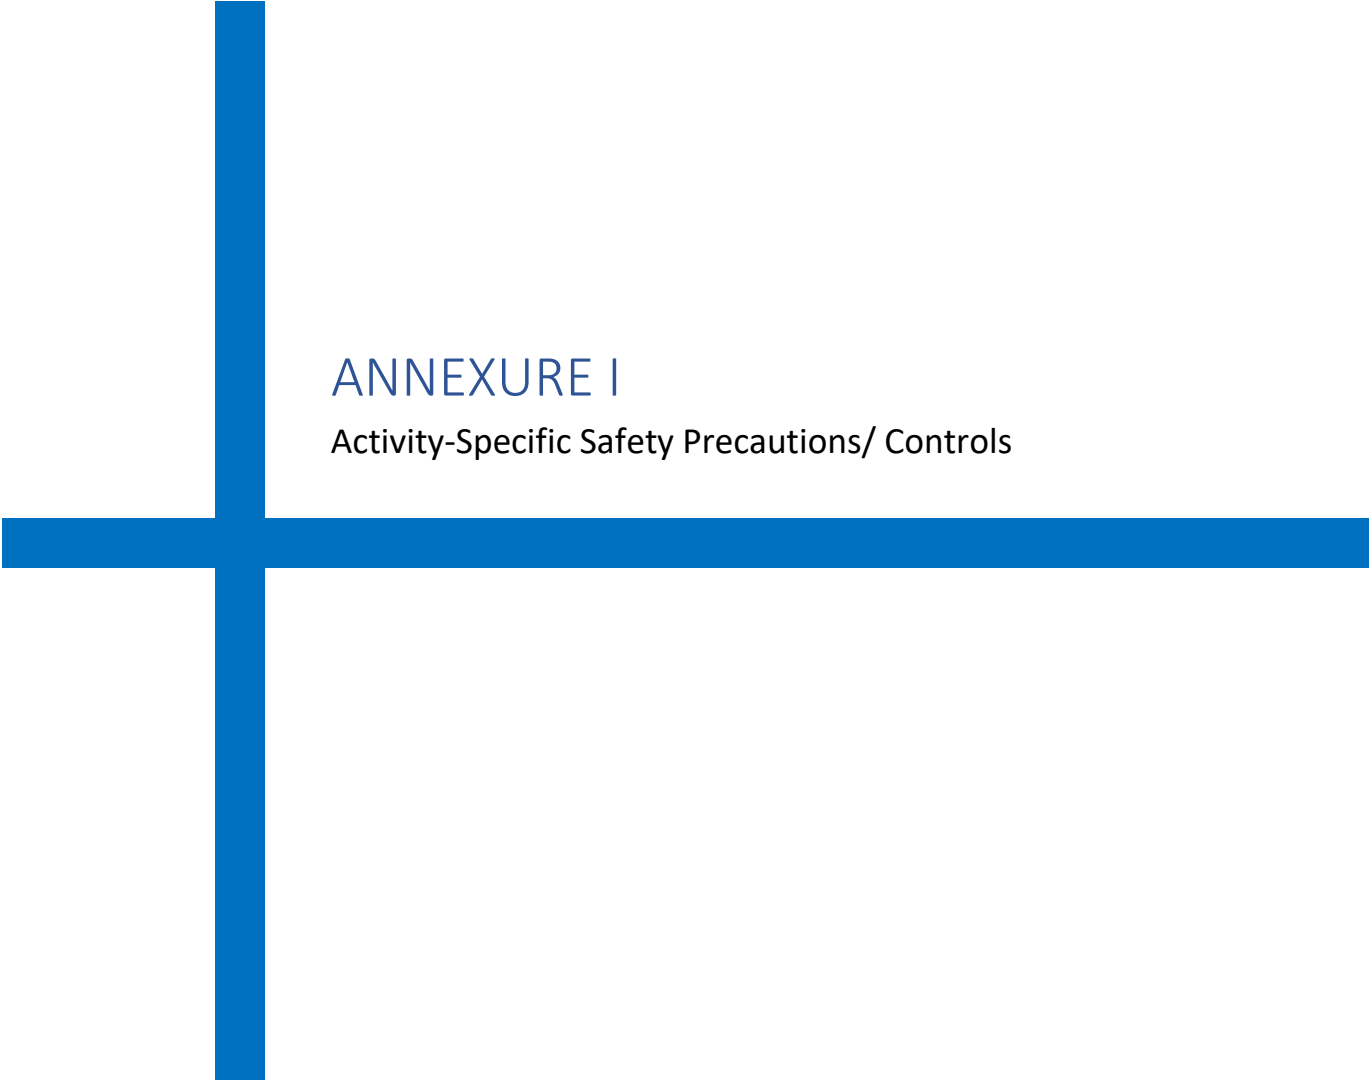

ANNEXURE I

Activity-Specific Safety Precautions/ Controls

INDEX OF CONTENTS

S. No.	Description	Page No.
1.	General	2
2.	Work at height	2
2.1	Personnel fall protection system must include	3
2.2	Working Platform	4
2.3	Scaffolding	5
2.4	Ladder Safety	7
3.	Excavation & Civil Works	8
3.1	Excavation	8
3.2	Piling	9
3.3	Batching Plant Operation	9
3.4	Mobile Plant	10
3.5	Concrete Vibrators	11
3.6	Concrete Mixers	11
4.	Welding & Gas Cutting Safety (Hot Work)	11
5.	Lifting & Rigging Safety	13
5.1	Cranes & Hoisting Equipment	15
6.	Demolition Work	20
7.	T&Ps General	21
8.	Chemical Handling	21
9.	Electrical Safety	21
10.	Use Of Hand Tools And Power-Operated Tools	25
11.	Start Up, Commissioning And Testing:	27
12.	Fire Safety	27
13.	Painting	28
14.	Hazardous Energy” Control Procedure/ Lockout/Tagout (LOTO)	30
15.	Risk Assessment	37
16.	HSE Preparedness For Adverse Climates And Weather	38
16.1	Summer	38
16.2	Monsoon	39
16.3	Emergency Weather Conditions	41
16.4	Prevention Of Covid-19 At Project Site & Labor Colony	42
16.5	Noise Mitigation	44

General

The philosophy of hierarchy of controls as below shall be followed

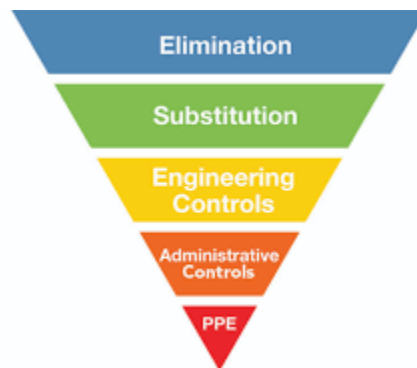


Fig. 1.1

It shall be ensured that there are multiple protections against any accident/ incident. For example, for height work there shall be safe platforms and walkways, Safety Nets and Lifelines for hooking double lanyard Safety harness by workers.

Monitoring and modifying worker behavior shall be part of ensuring safety. All personnel should be competent and trained for the job

Brief Safety guidelines for various hazardous activities are indicated below, besides the mandatory requirements based on Hazard Identification studies, HSE Procedures, Operational Control Procedures, Work Permits, applicable Indian Standard Codes and other provisions detailed in this document. Constant supervision at all times to be maintained by Execution & Safety Team to ensure implementation of these provisions.

1. WORK AT HEIGHT:

- a. All work at height above 2 meter above ground level without complete platforms, handrails and other related fall protection shall require a work permit in the prescribed form. This shall require approval by the competent authority. The HSE officer of sub-contractors shall follow the checklist religiously by physically verifying the condition of the work area before recommending for approval.
- b. Prior to the start of work at elevation, the HSE Officer involved with the work must meet the work supervisor to review the scope of work, and must review all the possible fall hazards and effective safety responses. The evaluation / analysis must be documented and kept on file and on site by the HSE Officer.
- c. Whenever a fall hazard or other exposure exists for working at heights more than 2.0m/6ft, the nature and scope of work will be evaluated for conditions and environmental factors before selecting the appropriate fall protection system (active, passive or a combination of measures, as appropriate).
- d. All Engineering and Administrative Controls including barricading, safe platform, Safety Nets etc. shall be made available at work location. Under no circumstances, there shall be total reliance on PPEs only
- e. **Safety Nets**
 - i. Contractor shall maintain sufficient stock of Safety Nets for deployment
 - ii. Safety Nets as per IS: 11057:1984 should be used extensively for prevention / arrest men and materials falling from height.
 - iii. The safety nets shall be fire resistant, duly tested and shall be of ISI marked.

- iv. Safety Nets shall be deployed below all platforms where height work is envisaged. Duration of work, delay shall be no excuses for non-installation of Safety Net
- f. Reaching beyond barricaded area without lifeline support, moving with support of bracings, walking on beams without support, jumping from one level to another, throwing objects and taking shortcut must be discouraged.
- g. Monkey Ladder shall be fitted with cages. Rope ladder should be discouraged.
- h. In case of pipe-rack, persons should not walk on pipes and walk on platforms only.
- i. In case of roof work, walking ladder/ platform should be provided along with lifeline and/ or fall arrestor.
- j. For chimney or structure painting, both hanging platform and men should be anchored separately to a firm structure along with separate fall arrestor.
- k. The procedures for the safety response to identified fall hazards developed and rescue plans must be reviewed with all individuals exposed to the hazards.
- l. The HSE Officer must establish an inspection process of fall protection systems. Some equipment requires documented inspections by its manufacture on a regular schedule. Such equipment must have evidence of the inspection and re-certification process on it. This information must be reviewed before the equipment is actually used. Individuals must visually inspect the fall protection equipment before each use. Failure to complete this inspection process could result in serious injury or death.
- m. Immediately remove from service any fall protection equipment that is identified as defective, damaged, or has been subjected to an impact. Damaged fall protective equipment must be destroyed to prevent re-use and not be discarded into trash containers, as the worn or damaged equipment could be unintentionally re-used.
- n. Aerial lifting devices, excluding scissor lifts require the use of full body harnesses and lanyards in any elevated position.
- o. Where Height related works are applicable then rescue team (consist of 5- 10 person) shall be identified and trained for potential rescue.

1.1 Personnel fall protection system must include:

a. Safety Harness

All height workers must use Full Body Safety harness with double lanyards with shock absorber (only). The primary lanyard is never unhooked until the secondary lanyard is secure. The design of the working platform should be such that under no circumstances, worker should have both lanyards unhooked while at height.

b. Lanyard

- i. The type of work and the environment conditions determine lanyard and lifeline selection. If welding, chemical cleaning that may damage lanyards, connectors or lifelines, sandblasting, etc., either protect the components or use more appropriate type of system.
- ii. Lanyards and lifelines must incorporate, or be used with, an appropriate deceleration (shock absorbing) device. Deceleration devices include rope grabs, rip-stitch lanyards, specially woven lanyards, tearing, or deforming lanyards, automatic self-retracting lifelines and lanyards which dissipate or limit the energy imposed on the employee during fall arrest.
- iii. Once in use, the system's effectiveness is to be monitored. In some cases, a program for cleaning and maintaining the system may be necessary. Lanyard and lifelines must use locking snap hooks only and under

no circumstances must two lanyard snap hooks be connected.

c. Lifeline

All lifelines in general are to be made of min 12mm dia. steel rope (plastic coated) and tied to columns with 3 clamps at each end. Wherever columns are not available to tie the lifelines, the vertical posts as per the design below are to be provided after carrying out drop load test initially. A load of 240kg to be dropped off the mid-point of lifeline in this test.

d. Lifeline Post

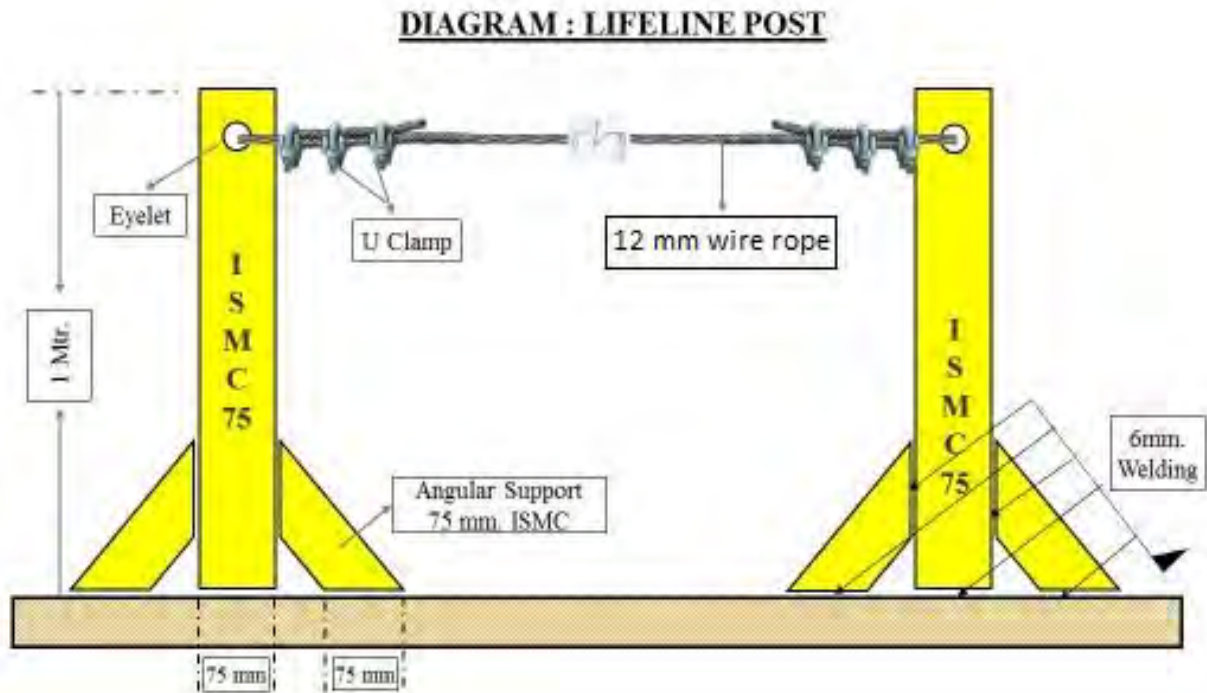


Fig. 2.1 Lifeline Post

- i. The support at vertical post shall be fixed at end-to-end (welded/ bolted). The maximum length of one end to another end shall be 6 meters
- ii. If the length of a lifeline is more than 6 meters, then intermediate vertical post(s) are to be used. Such intermediate post(s) will act as supports and the lifeline rope should simply pass through the eyelets (holes) of such supports without being anchored
- iii. The lifeline need not be wrapped / clamped to any intermediate post
- iv. Such intermediate posts must be used at an interval of every 6 meters
- v. The post(s) in which the original lifeline is to be installed should be capable of sustaining a tensile stress of 2268 Kgs.
- vi. In a horizontal lifeline installation, maximum allowable sagging is 500-600 mm
- vii. For a single spun lifeline, no more than 3(Three Nos.) persons are allowed to work; for more than two workers, another lifeline should be installed
- viii. Horizontal lifeline should be so installed that it does not impede safe movement of workers
- ix. All the installation work must be carried out by competent person with adequate knowledge

1.2 Working Platform

- a. Working platforms, gangways and stairways shall be so constructed that they do not sag unduly or unequally and if the height of the platform gangways provided is more than 3.6 m above ground level or

floor level, they shall be closely boarded and shall have adequate width, which shall not be less than 750 mm and be suitably fenced.

b. Precautions against the fall of Materials, Persons and Collapse of Structures:

- i. Every opening in the floor or a building or in a working platform shall be suitably barricaded to prevent the fall of persons by providing suitable fencing or railing whose minimum height shall be 90 cm.
- ii. Adequate precautions should be taken such as the provision of fencing, or barriers to protect any person who might be injured by the fall of materials, or tools or equipment being raised or lowered. Hard barricading shall be made at such places made of scaffolding pipe & clamps covered with reflective net. Cradle may be used for lifting materials - however this shall be made of MS angles and flats only and duly certified by the HSE officer. Operators may also use designed containers for lifting small tools.
- iii. Guardrails (including scaffolding) erected over/adjacent working areas must have the guardrails screened (opening < 0.5), to prevent material from falling outside the platform/decking.
- iv. Guardrails must be able to withstand a 200-pound force exerted in any one direction.
- v. Where necessary to prevent danger, guys, stays or supports should be used or other effective precautions should be taken to prevent the collapse of structures or parts of structures that are being erected, maintained, repaired, dismantled or demolished.
- vi. All openings through which workers are liable to fall should be kept effectively covered or fenced and indicated in the most appropriate manner.
- vii. Guardrails and toe-board/barricades and sound platform conforming to IS: 4912-1978 and other Indian laws and r

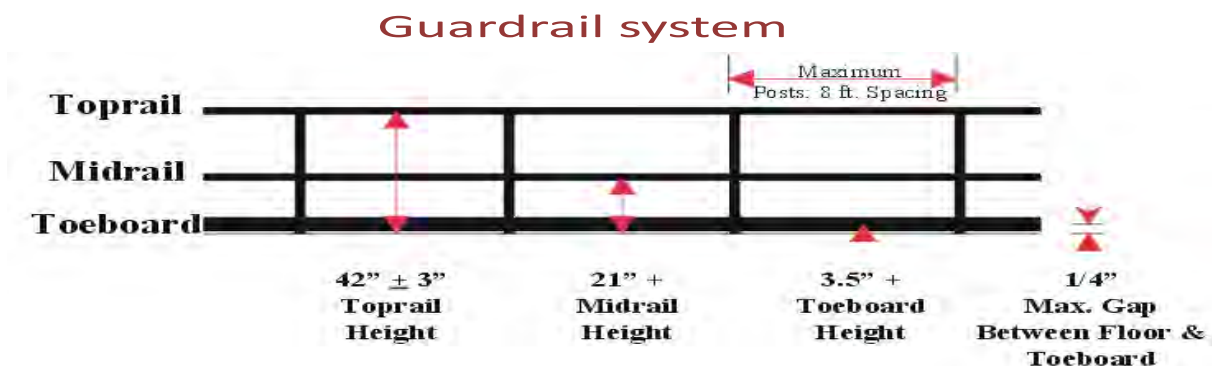


Fig. 2.2 Guard Rail System

- viii. Guardrails shall be provided to protect workers from falling from elevated work places. The rails are generally made of MS pipes of suitable dia. Rebar shall not be used for any handrails, ladder or cover purpose. Wherever the guard-rails and toe-boards cannot be provided:
 - a. adequate safety nets or safety sheets shall be erected and maintained; or
 - b. adequate safety harnesses shall be provided and used and / or
 - c. adequate fall arrestor shall be provided and used.

As mentioned under PPE clause, all these PPEs shall be defect free and regularly inspected for any defect. The full body safety harness shall have double lanyard only with max 1.8m length.

- ix. The monkey ladders shall have sufficient fall arrestors. Adequate lifelines of 8mm steel wire rope shall be provided across the work area.
- x. The HSE officer shall recommend appropriate PPEs after analyzing hazards and risks involved.

1.3 Scaffolding

All scaffolds shall be conformant to the relevant standards including IS 3696 and IS 4014 as applicable. A sketch of the scaffolds proposed to be used shall be prepared and approval of the BHEL Engineer obtained prior to construction / use. Only cup lock type scaffoldings will be allowed in site. Where cup lock type scaffolding arrangement is not feasible by the virtue of the location, in that case only pipe and clamp type scaffolding will be allowed.

- a. The scaffolding work must be carried out by a competent person, who shall train the scaffold users on safety aspects
- b. All scaffolds shall be erected / dismantled by scaffolding crew under direct supervision of competent scaffolding supervisors.
- c. All scaffolds shall be capable of supporting 4 times maximum intended load and erected on sound, rigid footing, capable of carrying the maximum intended load without settling or displacement. Bamboo scaffolding is not permitted for use on site.
- d. Each employee on the scaffold shall use an approved safety harness attached to an independent lifeline. The lifeline is to be securely attached to substantial members of the structure (not the scaffold itself) or to securely rigged lines, which shall safely suspend a worker in event of a fall.
- e. Guard rails and toe boards shall be installed on all open sides and ends of platforms more than (2) meters above ground or floor
- f. Scaffold planks must be at least 5 cm x 25 cm (2" x 10") full thickness lumber scaffold grade or better.
- g. Scaffold planks shall not span distances greater than 2.5 meters (8 feet).
- h. Scaffold planks shall extend over end supports not less than 6 inches nor more than 12 inches and be secured to the scaffold. Scaffolding and accessories with defective parts shall be immediately repaired or replaced.
- i. All scaffolding must be a minimum of two planks wide. No one may work from a single plank.
- j. Scaffold planks must be inspected before use. Planks that have been damaged must be removed from the site.
- k. Access ladders must be provided for each scaffold. Climbing the end frames is prohibited unless the design incorporates an approved ladder.
- l. Adequate mudsills or other rigid footing capable of withstanding the maximum intended load must be provided.
- m. Scaffolds more the 6 meters (20 feet) in height must be tied to the building or structure at intervals which do not exceed 4 meters (13 feet) vertically and 6 meters (20 feet) horizontally.
- n. Do not overload scaffolds. Material should be brought up as needed. Scaffolding must not be loaded in excess of its rated capacity.
- o. Barrels, boxes, kegs, blocks or similar unstable object must never be used as work platforms or to support scaffold.
- p. Where persons must work under or pass under a scaffold then a 18 gauge wire mesh screen must be installed between the toe board and guard rail.
- q. Employees exposed to overhead hazards while working on a scaffold will be protected by 5 cm (2") thick planks.
- r. Wooden/bamboo ladders shall not be allowed at any cost. Ladder's rungs shall be fitted /welded

properly. Before every use the rungs should be checked for safe use.

- s. Wooden scaffolds shall not be used in areas where fire / fire products are expected
- t. Ropes made of jute / Plastic and other fire prone material shall not be used to tie up scaffolding components together
- u. The platform should have permanent hand rail and mid rail with Toe board without fail.
- v. All platforms are to be tightly planked for the full width of the scaffold, except as may be necessary for entrance openings. Platforms shall be secured in place.
- w. On suspension scaffolds designed for a working load of 500 pounds, no more than two workers are permitted to work on the scaffold simultaneously. On suspension scaffolds with a working load of 750 pounds, no more than three workers are permitted on the scaffold simultaneously.


x. Requirements for different types of Scaffolds:

A. Suspended Scaffold


- i. Suspended scaffolds are platforms suspended by ropes, or other non-rigid means, from an overhead structure.
- ii. Requirements for use are to be preapproved by HSE Head, under a specific Permit to Work.

B. Rolling Scaffolds

- i. The height of rolling scaffolds shall not exceed three times the minimum base dimension.
- ii. The minimum base dimension of rolling scaffold will be 1.25 meters (4 feet).
- iii. Adequate help must be provided when moving a rolling scaffold.
- iv. Secure or remove all loose materials, equipment and tools before moving a rolling scaffold.
- v. No one is permitted to ride a rolling scaffold when it is being moved. Castor brakes must be locked-on when the scaffold is not being moved.

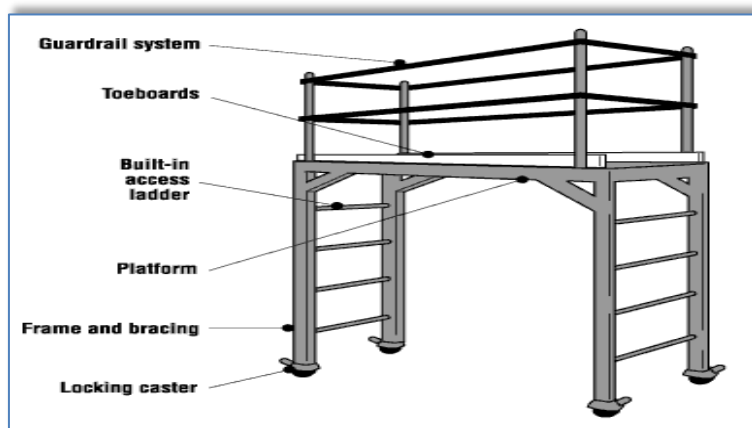

Rolling Scaffold

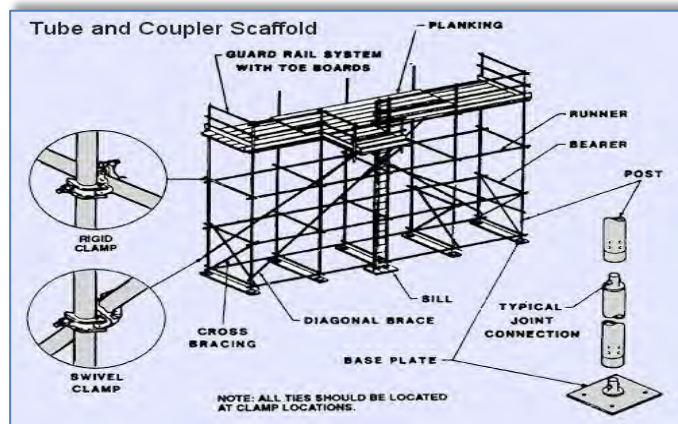

Tube & Coupler Scaffold

Fig. 2.3 Types of Scaffolds

1.4 Ladder Safety

A sketch of the ladders proposed to be used shall be prepared and approval of the BHEL Engineer obtained prior to construction / use

a. Safe Use of Ladders:

- i. Fall protection is required when working on a ladder above 2 meters and when climbing above nearby guardrails.

- ii. Ladders must be inspected prior to use and by a competent person quarterly, with documentation.
- iii. Use portable ladders for height up to 4 M only
- iv. Provide fixed ladders for height above 4 M
- v. Place the ladder at an angle of 75 degrees (approx.) from the horizontal (1:4)
- vi. Extend ladder at least 1 M above the top landing
- vii. Secure top and bottom of the ladder firmly to prevent displacement- anti skid lining at the bottom
- viii. Ensure that the width of the ladder is not less than 300 mm and distance between rungs is not more than 300 mm
- ix. Provide landings of minimum size 600 x 600 mm at intervals not more than 6 M for fixed ladders. Check the ladders daily for any defects
- x. Ensure that the areas around base and top of the ladder are clear. Getting on and off the ladder is more hazardous than using it. Use a mudsill if the ladder is to rest on soft, loose or rough soil
- xi. Do not use ladders of conducting material near power lines, and only use ladders near power line or other energize system with exposed parts if they are confirmed locked-out and de-energized.
- xii. Stand no higher than the fourth rung from the top for carrying out any job standing on a ladder.
- xiii. Never reach out from a ladder to perform work where your belt buckle protrudes past the ladder rung.
- xiv. Always face the ladder while climbing up or down
- xv. Maintain three-point contact while climbing up or down a ladder i.e. two hands and one foot or two feet and one hand on the ladder at all the times.
- xvi. Avoid climbing up or down a ladder while carrying anything in hands. Lift tools, equipment and materials with a rope.
- xvii. Work from portable and extension ladders near guardrail where fall expose exists over the guardrail regardless of height, and above 2.0 mtr. heights from the working/walking surface will require the use of personal fall arrest equipment

2. EXCAVATION & CIVIL WORKS

All safety precautions shall be taken for foundation and other excavation marks as per IS-3764.

2.1 Excavation

The following safety measures are to be ensured before and during excavation:

- a. All Excavation activities more than with depth of 1.22 meter or more shall require and Excavation Work Permit
- b. Check for underground utilities like electrical / telephone cables, sewage, water lines and proper care has to be exercised to protect and prevent damage to it.
- c. Electrical cables and service lines to be identified using cable detector/locator device before carrying out the excavation work
- d. Proper and adequate slope is maintained while excavating
- e. Adequate shoring or sheeting is done wherever require to prevent soil sliding
- f. Safe access through ladder or steps for exit & entry to excavation
- g. No material /excavated soil is kept within one meter from the edge
- h. Safe way is planned and provided for movement of HEM /transport equipment near excavation
- i. Safety helmet and shoes/gum boots are provided and worn by the workmen at excavation works

- j. Dewatering arrangement is made where water seepage is prevailed.
- k. Stop blocks are provided to avoid vehicles reversing into the excavated trenches
- l. Danger signs /Caution boards are displayed at work spot
- m. Hard Barricading is provided at excavated pits. It should be made of scaffolding pipe and clamp with reflective nets.
- n. All Excavated area of depth 3mtr or more is to be hard barricaded with pipe.

Soil Type	Height/Depth ratio	Slope Angle
Stable Rock	Vertical	90 deg.
Type A	$\frac{3}{4} : 1$	53 deg.
Type B	1 : 1	45 deg.
Type C	$1\frac{1}{2} : 1$	34 deg.

Determining Soil Type		
Type	Description	Examples
A	Cohesive soils with an unconfined compressive strength of 1.5 tons per square foot or greater.	Clay, silty clay, sandy clay, clay loam and in some cases: silty clay loam and sandy clay loam.
B	Cohesive soils with unconfined compressive strength greater than 0.5 tsf but less than 1.5 tsf.	Angular gravel (similar to crushed rock), silt, silt loam, sandy loam and, in some cases silty clay loam and sandy clay loam.
C	Cohesive soils with unconfined compressive strength greater than 0.5 tsf or less.	Granular soils such as gravel, sand and loamy sand; submerged soil or soil from which water is freely seeping; submerged rock that is not stable.

Fig. 3.1 Excavation Reference

2.2 Piling

Ensure the following precautionary measures before starting piling works:

- a. Inspection of piling equipment by responsible person for its condition before initiating piling operation.
- b. Checklist and OCP for piling to be prepared using manufacturer's instructions and used
- c. Testing and its certification wire rope, slings, D-shackles, chain pulley blocks using in the process of piling work by competent person
- d. Adequate support and secured foundation of the piling equipment to avoid toppling
- e. Hoses should be lashed and adequately secured
- f. Proper work platform is to be provided on piling frame
- g. Safe work procedures and close supervision to prevent unsafe acts of operators/any unsafe conditions that may arise
- h. Only experienced and trained operators are engaged for the piling operation
- i. Provision of Personal Protective Equipment (PPE) like safety shoes/gumshoes/safety helmet/safety belt etc. and its use by their workmen.
- j. Special care and precautions If work is near electrical live cables/ electrical equipment
- k. Cordoning of work area to prevent un authorized entry
- l. Guarding of revolving parts
- m. Specific measures to prevent over turning of pile driver/missing of hammer/ hammer movement out of range

2.3 Batching Plant Operation

Following Safety considerations for batching plant are to be ensured:

1. Modern type batching plant should be used in which all the moving parts are protected and emergency

and safety features are incorporated.

2. Installation of external Electric moto-vibrators in the feeding hopper of all batching plants to reduce human intervention.
3. Installation of safety devices like pull-chord on both the sides of conveyor for stopping the conveyor in emergency
4. Workers carrying cement / sand to be given appropriate PPEs like respiratory masks & gloves.
5. Conveyor belt/rotating parts must be guarded properly.
6. Safety awareness shall be inculcated in workmen about the risk involved in rotating parts.
7. The agency shall ensure to erect the batching plant as per drawing including installation of all safety devices as provided by manufacturer and witnessed by BHEL Engineer in charge before starting of machine in future.
8. Safety audit to also focus on Batching plant.
9. The site shall impose penalty on the agency who has violated the safety norms as per contract.

2.4 Mobile Plant

Mobile plant includes tractors, trailers, dumpers, excavators, bulldozers, road rollers etc. for earthmoving purpose and concrete mixers, concrete transit mixtures, concrete pumps etc for concreting purpose. Due to the very nature of their function and movement in difficult terrains, congested areas, working in tandem with manual work and other operations the danger is inherent.

Automatic reverse camera with reverse horn connected with reverse gear is compulsory for all moving machineries.

Following Safety measures to be ensured for Mobile Plant:

- a. Where movement around site is involved, routes should be planned, obstruction free and well maintained
- b. Observe specified speed limits
- c. Operating personnel should be aware of associated risks and its preventive measures
- d. Only experienced, trained and authorized persons with valid license (wherever applicable) should operate the mobile equipment/vehicles
- e. Provide and use Warning lights and reverse horn for cautioning the people around
- f. Operation should be on level and stable ground with adequate working clearance.
- g. Loading of out riggers/stabilizers should be well within safe ground bearing capacity
- h. No person should be on equipment or vehicle during loading and unloading of material
- i. Operators should be protected by warning barriers or switching off power when working in close proximity of overhead power lines
- j. The equipment /vehicles should be well maintained and provided with effective brake system and other safety devices (wherever require)
- k. Rotating parts of equipment should be adequately guarded
- l. Provide necessary personal protective appliances and ensure its use by the operating personnel Ensure effective measures at source to control harmful emissions, dust, fumes contaminating atmosphere and cause health hazards to the operators and people in the vicinity.
- m. No overloading/over stressing of vehicles/plant is allowed
- n. Hoses, pipes, receivers, gauges and valves involved in carrying out hydraulic fluid/ compressed air should be checked for leaks and tested prior to operation.

- o. Adequate safe clearance for swing and movement is to be judged during operation of Concrete mixer
- p. Setting of machines on firm and level ground with wheel locked to prevent movement of machine
- q. Proper instructions and Special precautions are to be ensured to prevent entry in to the danger zone of projectile of bucket while dropping bucket
- r. Operator leaving work spot should ensure that the equipment/vehicle is kept in neutral position and place on firm and level ground.
- s. The hand brake should be kept in position and block road wheels as additional safety measure
- t. Blades/buckets should be kept low while moving
- u. The dozer blades should not be used as brakes except in emergency
- v. The ground should be examined for its bearing capacity and general safety especially when operating road roller at the edges of slopes, embankments.
- w. The roller should not be moved downhill with the engine out of gear
- x. If operating near excavations the following precautionary measures are to be ensured
- y. Barricading, edge protection to prevent fall of persons/vehicles over running while reversing etc.
- z. Suitable support system and adequate allowance to avoid the danger of side collapsing
- aa. Experienced signaller /attendant should be always accompanied with operator/driver for proper direction /signal and also to caution others in the working Zone during operation of mobile plant

2.5 Concrete Vibrators

- a. Revolving parts/belt drives should be adequately guarded and Vibrating unit shall be completely enclosed and have suitable overload relays and effectively earthed
- b. Ensure sufficient length of cable to the Vibrator.
- c. Ensure electric starters and other accessories are firmly fixed adequately supported
- d. Ensure locking of needle load while inserting needle in to the vibrator,
- e. Ensure periodical lubrication and maintenance

2.6 Concrete Mixers

- a. Setting of machines on firm and level ground with wheel locked to prevent movement of machine
- b. Proper instructions and Special precautions are to be ensured to prevent entry in to the danger zone of projectile of bucket while dropping bucket

3. WELDING & GAS CUTTING SAFETY (HOT WORK)

- a. All Hot Work shall require a Hot Work Permit
- b. Inbuilt Voltage Reduction Device (VRD) equipped arc welding machine will only be allowed for work.
- c. There shall be flash-back arrestors conforming to IS-11006 at both cylinder and burner ends. Damaged tube and regulators must be immediately replaced.
- d. All safety precautions shall be taken for welding and cutting operations as per IS-818.
- e. When possible, items to be welded, cut, heated, etc. shall be moved to a safe location free of combustible or flammable material. If this is not possible, then all combustibles/ flammables that can be removed from the area shall be removed within a 35-foot circumference and a positive means of confining arcs and sparks generated by the process shall be ensured and additional person(s) shall be stationed as fire-watch for the area(s) still exposed, along with obtaining the Hot Work Permit as applicable.
- f. Appropriate fire-fighting equipment is to be available in close proximity of any welding and gas cutting operations at all times suitable for the type of Fire.

- g. Drums, tanks, and similar containers that have contained flammable or toxic material shall not be welded, cut, or heated until they have been made safe by water filling, thorough cleansing or similar accepted practices. The container shall also be ventilated during the welding, cutting, or heating process.
- h. Proper ventilation is required for any welding or torch operations performed in a confined space.
- i. Any welding or gas cutting operations performed on metals of toxic compounds or coating such as zinc, stainless steel, lead, cadmium, chromium, and beryllium shall be properly ventilated and/or proper respiratory protection shall be worn by any person that could be exposed to fumes, vapors, and gasses created by the welding and gas cutting processes.
- j. Wherever it is practical, all arc welding operations shall be shielded to prevent direct light rays or sparks from contacting persons in the vicinity or from reaching areas normally used to travel through or into the vicinity. Where this is not practical, persons who shall be in the area are to use proper eye and skin protection. Other persons who are not participating in the welding or gas cutting operations are not to be allowed into the hazard zone.
- k. Welders and other employees who are exposed to arc welding radiation shall wear suitable clothing and protective apparel to prevent burns and other types of ultraviolet radiation damage to the skin.
- l. Arc welding machines shall be shut down when being moved or when they are not in continuous use. Electrode holders left unattended shall have electrodes removed and shall not be left where they might contact employees or conducting objects.
- m. Arc welding power supply cable shall be of proper rating and material, e.g. copper.
- n. Welders shall guard against allowing materials adjacent to or behind them to reflect radiation back toward them or towards others in the area. Reflected radiation can cause skin burns and eye flash burns.
- o. Valve caps shall be in place when cylinders are not in use. Valve caps shall never be used for lifting the cylinder vertically.
- p. Torches shall only be lit by approved strikers; never with matches, cigarette lighters, or hot-work.
- q. **Splatter / Slag Collector:**

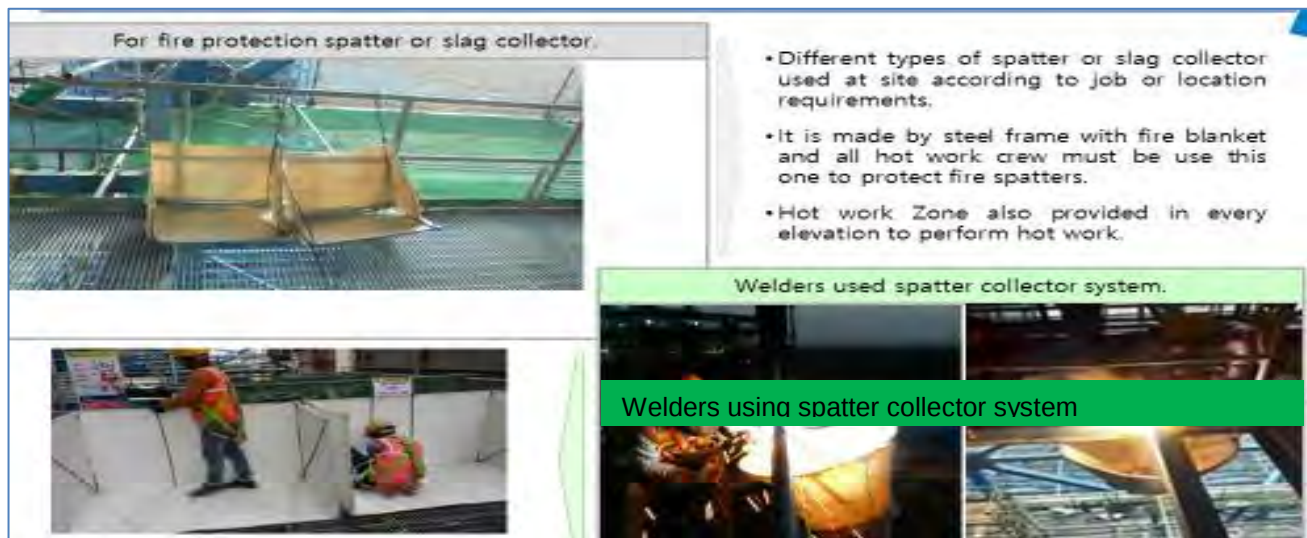


Fig. 4.1 Splatter / Slag Collector

While carrying out job at height, the sparks or molten slag shall be prevented from falling down by putting a fire-resistant (non-asbestos) sheet or patter/ slag collector or even MS Sheet. The passage of falling sparks

or molten slag shall be barricaded till ground floor and any cable/ tubes/ any other objects interfering in the passages shall either be removed or covered with Fire-resistant sheet or MS Sheet.

r. COMPRESSED GAS

- i. All cylinder valves shall be closed when any work is finished and when any Cylinders are empty or being moved. Valve protection caps shall be placed and secured properly before gas cylinders are transported, moved or stored.
- ii. Compressed gas cylinders shall be secured in an upright position with chain or appropriate means during storage & use. However, a trolley shall be used for transportation.
- iii. Compressed gas cylinders shall always be secured from tipping or falling, whether in use, in storage or in transit. The cylinders shall always be secured upright, except during times when actually being hoisted or carried.
- iv. When cylinders are transported by powered vehicle they shall be secured in a vertical position.
- v. Regulators shall be removed when cylinders are not in use or are in transit, unless the cylinder is firmly secured on a special carrier designed for this purpose.
- vi. Gas cylinders are not allowed to be used in man-basket when occupied.
- vii. Cylinders containing oxygen or fuel gasses shall not be taken into confined spaces.
- viii. Oxygen cylinders shall be stored a minimum of 6 meters from fuel gas cylinders or shall have an approved firewall between them.
- ix. All cylinders shall be kept at a safe distance from welding or cutting operations or shielded from arc/sparks / slag.
- x. All cylinders shall be placed where they cannot become part of the electrical circuit.
- xi. Oxygen and acetylene shall not be stored together. Oxygen must be separated from acetylene (or ANY fuel gas) or combustible material by at least 20ft or a barrier with a 30-minute fire resistance rating.
- xii. All Cylinders should be stored upright in a designated area with labels for the type of gas. All applicable precautions to be ensured during storage
- xiii. Oxygen and fuel gas regulators, hoses and associated equipment shall not be altered and shall be in proper working order while in use.
- xiv. Compressed air can be extremely dangerous if allowed to penetrate the skin. As such, the use of compressed air to clean off yourself or other workers shall be strictly prohibited.
- xv. All gas cylinders shall be stored in upright position. Suitable trolley shall be used for cylinder movement, the design of which shall be submitted to BHEL Engineer for approval.
- xvi. No of cylinders shall not exceed the specified quantity as per OCP
- xvii. Cylinders shall be moved by tilting and rolling them on their bottom edges. They shall not be intentionally dragged, struck or permitted to strike each other violently.
- xviii. All cylinder should be kept only in cylinder trolley.
- xix. Cylinder shall be transported in upright vertical position by suitable mean.

4. LIFTING & RIGGING SAFETY

- a. All Heavy / Complex Lifting operations as defined in Clause 6.12 shall require a Lifting Work Permit. A written rigging procedure and plan must be prepared for all individual heavy/ complex lifting operations.

- b. All the cranes and lifting tools & tackles shall be inspected on daily / weekly basis as well as monthly by expert as per applicable formats.
- c. In addition, inspection / certification as mandated by law shall be carried out wherein these shall be tested and certificates of fitness shall be obtained from 3rd party State Govt. approved competent agency before deploying at site and later periodically. BHEL shall be given advance intimation of any such inspections
- d. The last date of Third-Party Inspection and the next Due date shall be conspicuously displayed on all cranes. A copy of certificate shall be pasted on operator's cabin of all the lifting equipment.
- e. Specifically designed heavy steel plates lifting clamps shall be used for lifting heavy metal sheets. Manmade lifting clamp chapa shall not be used for lifting/shifting of plates.
- f. Following requirements shall be mandatorily followed, wherever applicable:
 - i. The manufacturer's instruction for maintenance shall also be followed. All safety measures shall be followed.
 - ii. All tools tackles, lifting appliances; material-handling equipment etc. used by the subcontractor shall be of safe design and construction.
 - iii. The operators, slingers and signalers shall be qualified as per IS 13367 (part-1):2003 "Safe use of cranes- code of practices".
 - iv. There shall be a person responsible for co-ordination among cranes where multiple cranes are used, and lifting over load chart of the crane to be avoided.
 - v. Mobile phone should be banned for crane operator and lifting operation. Only walkie talkie shall be allowed in rigging/Lifting purpose.
- g. Lifts/Movements between 5 Tons and 20 Tons:
 - i. Shall include a rigging plan, detailing schematic representation of the handling/lifting operations that must be included on the Method Statement.
 - ii. When performing similar lifts of identical items, only one rigging plan need be prepared, provided each of the lifts can be performed in accordance with the rigging plan.
- h. Lifts/Movements Less Than 5 Tons:
 - i. An equipment rigging plan is not required for lifts less than 5 tons, safety measures are covered in the JSA. This could change as per BHEL requirement

i. Personnel Lifts (Man-Basket / Jhoola):

The design of personnel man basket shall be submitted to BHEL Engineer for approval before use. Relevant permit (Height work & others as applicable) shall be completed prior to lifting any people, along with a rigging plan.

- i. A separate Lifeline / fall arrestor anchored to a fixed structure outside of Jhoola shall be provided for the workers inside the basket. All occupants of the basket shall have Safety Harnesses equipped with rope grabs, which are to be hooked to the vertical lifeline.
- ii. Man-basket shall be used where access through ladders or scaffolding is not feasible.
- iii. Man-baskets shall be designed and engineered by a manufacturer (job made man-baskets are not allowed, unless designed and tested by a certified engineer), and built robust with MS Angles and flats or plates or channels only.
- iv. Guard rails top and mid, must be in place and screened-in to avoid material from falling out of

basket. The factor of safety shall be 200%.

- v. It shall have a door with double latches and shall open inside. Anchor points shall be identified within the man-basket.
- vi. The man-basket shall be thoroughly inspected and load tested and a trial run performed without personnel before being put to job.
- vii. It shall be treated as a lifting tool (T&P Item) and shall undergo same certification cycle and inspection as other lifting equipment.
- viii. An additional sling of required lifting capacity shall be fixed the man-basket main lifting point and attached to the crane above the ball or block.
- ix. While lifting man-basket, the crane shall maintain a uniform speed of lift without any swing.
- x. Once man-basket reaches the destination, the lift brakes shall be locked as long as the basket
 - a. remains at that point. The same care shall be taken in its descent.
- xi. As for hanging man-basket, the same shall be hung off a rigid structure with help U-shaped handle welded to man-basket. This shall be tested once in a year by a competent person.
- xii. Use of Rebar steel for making and monkey-ladder must be avoided.

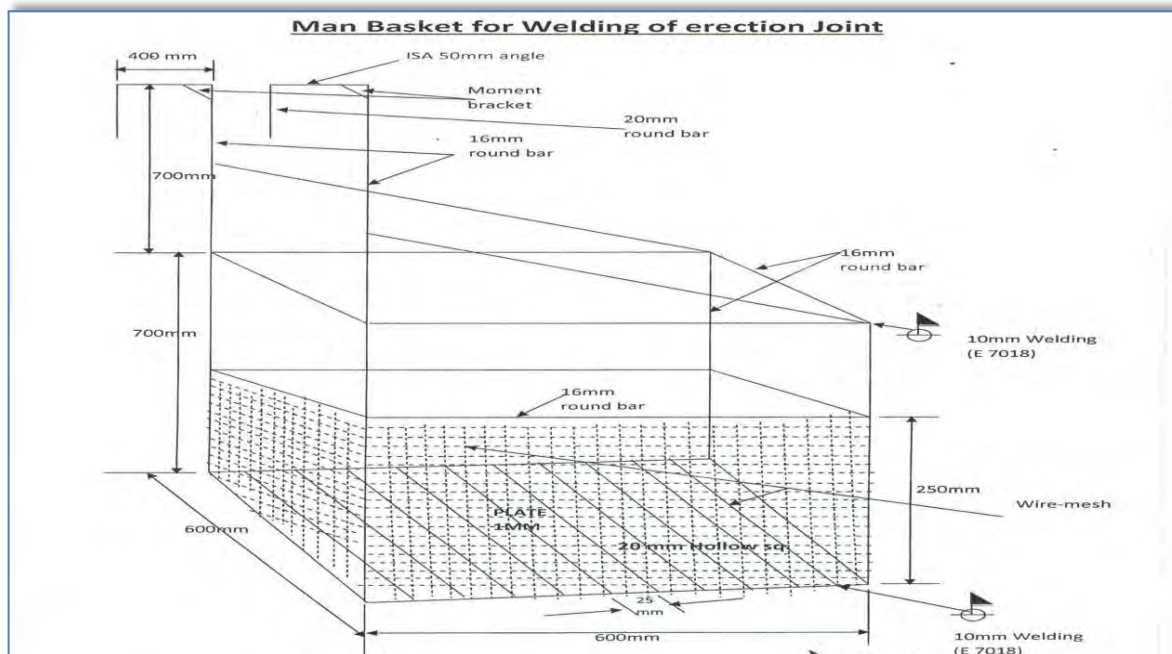


Fig. 5.1 Man Basket for Welding Erection Joint

4.1 Cranes & Hoisting Equipment:

This section provides the guidelines to ensure proper rigging and lifting activities are accomplished safely and in accordance with applicable specifications, codes, and regulations.

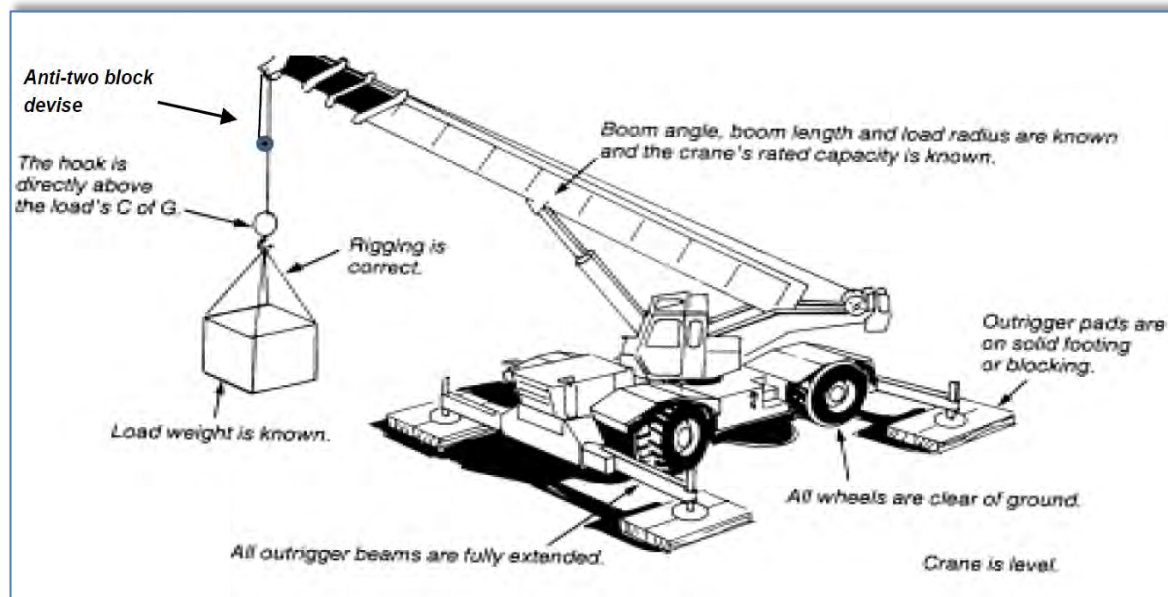


Fig. 5.2 Proper Crane Setup

- a. On every crane or piece of hoisting equipment notices of all rated load capacities, recommended operating speeds, and any hazard warnings or special instructions shall be conspicuously posted. All instructions and warning shall be visible from the equipment operator's station.
- b. Cranes shall have an Anti-Two-block safety device installed
- c. All mobile cranes shall have overload and backup alarms, load angle indicators and limit switches
- d. All areas within swing radius of cranes that are potentially accessible by pedestrian, vehicular, or equipment movement shall be barricaded to prevent anyone or any vehicle or equipment from being struck by the crane or hoisting equipment, or its load(s).
- e. No part of the lifting equipment or its load shall be within the distance as specified in the Indian Electricity Act from an energized power line
- f. Cranes shall have annual certified third-party inspection and be inspected before use by the operator. Any defects shall be corrected before use. Logs of crane inspection shall be kept with the crane.
- g. Make certain that the rigging personnel, material, and equipment have the necessary capabilities for the job and are in safe condition.
- h. Communicate with person(s) directly responsible for accomplishing the work and / or work area to establish requirements/responsibilities and make certain that all preparatory work is complete.
- i. Mats/Pads must be used on all lifting equipment, equipped with out riggers.
- j. Pick and carry must have the load secured to the rig in front.
- k. Only BHEL Approved Plate Lifting Spreader Beam configuration shall be used (Sample in Fig. 11.3.5.3)
- l. Crane operators must follow the following:
 - i. Pass an annual Operator's Physical examination
 - ii. Carry a valid training certification card at all time while operating issued by the Govt. or other recognized institute.

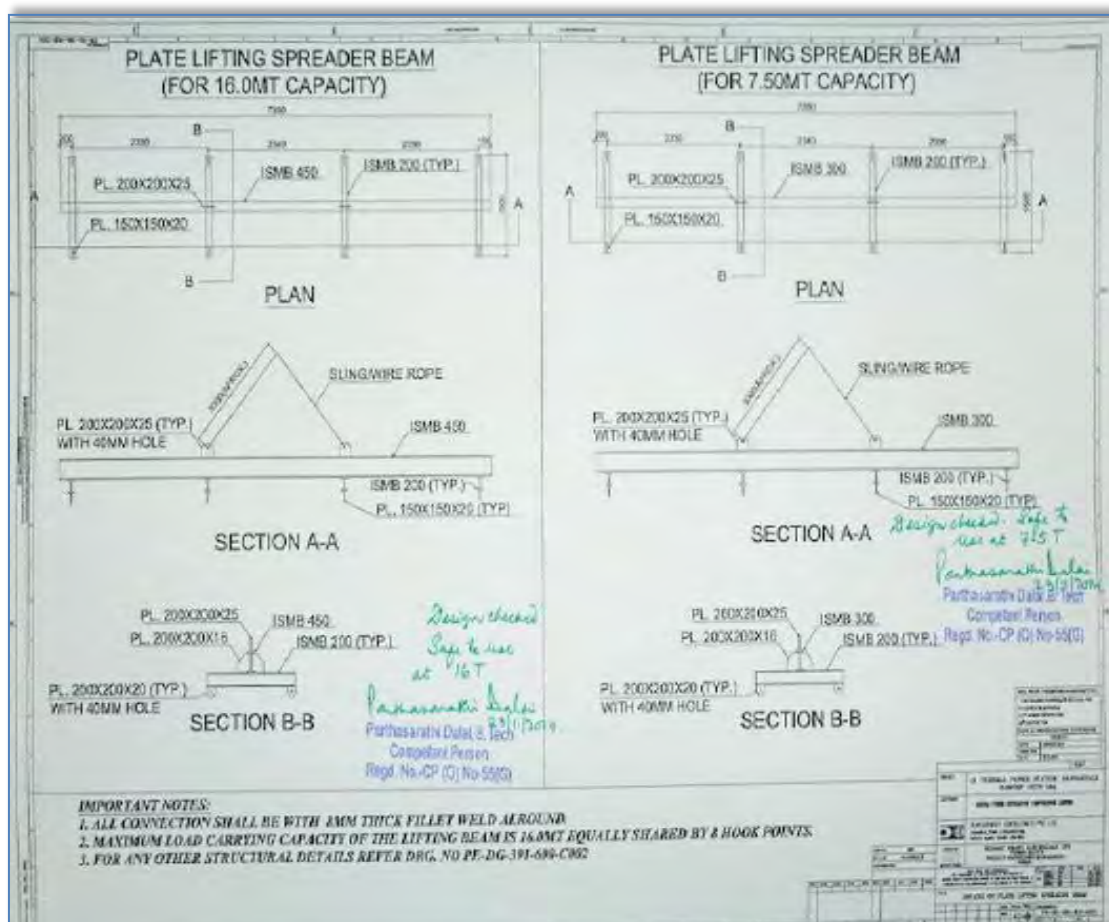


Fig. 5.3 Typical Plate Lifting Spreader Beam Configuration for 7.5 MT and 15 MT Loads

m. Safe Rigging Practices

- Review the planned operation and requirements with the operator and rigging crew.
- Ensure a pre-lift meeting is conducted with crane operator, tagline operator, signal personnel, and Safety Manager.
- Designate a qualified person from the rigging crew to observe clearance of the equipment and give timely warning for all operations where it is difficult for the operator to maintain the desired clearance by visual means.
- Clear the lift area of all unnecessary personnel.
- Hydras shall only be allowed for loading & unloading works & shall not be allowed to move with load

n. Rules for Safe Rigging

- Use loops, thimbles and corner pads to prevent damage to slings when used around corners or on cutting edges.
- Never allow wire rope to lie on the ground for any length of time or on rusty steel or near solvents, chemicals or corrosive substances.
- Slings must not be pulled from between or under loads with load resting on the sling.
- Keep all rope away from flame cutting or welding operations.
- Never use rope as sling material.
- Never wrap a wire rope completely around a hook.

- vii. Do not bend wire rope near any attached fitting.
- viii. The sling must be selected to suite the most heavily loaded leg rather than the total weight when using multi-legged sling to lift loads in which one end is heavier than the other.
- ix. When using 3 and 4-legged sling configurations, any two legs must be capable of supporting the entire load.
- x. Where possible, wire rope choker hitches must include a shackle with the eye around the shackle pin to prevent breaking wires of the choke. The choker hitch must be “snugged down” prior to lifting, not after tension is applied.
- xi. Unless authorized by the hook manufacturer when more than two rope eyes are placed over a hook, install a shackle, pin resting in the hook, and place the rope eyes in the bowl of the shackle.
- xii. Properly rig all loads to prevent dislodgment of any part.
- xiii. Use guide ropes or tag lines to prevent the rotation or uncontrolled motion of the load when necessary.
- xiv. Loads must be safely landed and properly blocked before being unhooked and unslung. Tag lines must not be used in situations that jeopardize the safety of the lift.
- xv. Lifting beams must be plainly marked with their weight and designed working load and must only be used in the manner for which they were designed.
- xvi. The hoist rope or chain must never be wrapped around the load. The load must be attached to the hook by slings or other rigging devices that are adequate for the load being lifted.
- xvii. Multiple part lines must not be twisted around each other.
- xviii. The hook must be brought over the center of gravity of load before the lift is started.
- xix. If there has been a slack rope condition, determine that the rope is properly seated on the drum and in the sheaves prior to lifting.
- xx. Keep hands away from pinch points as the slack is being taken up.
- xxi. Leather gloves are recommended when handling wire rope.
- xxii. Avoid impact loading caused by sudden jerking when lifting or lowering. Lift the load gradually until the slack is eliminated.
- xxiii. Never ride on a load that is suspended.
- xxiv. Avoid allowing the load to be carried over the heads of any personnel.
- xxv. Never work under a suspended load until the load has been adequately supported from the floor and all conditions have been approved by the supervisor in charge of the operation.
- xxvi. Never leave a load suspended unless emergency evacuation is required.
- xxvii. Never make temporary repairs to sling.
- xxviii. The capacity of a sling is determined by its angle, construction, type of hitch and size.
- xxix. Never lift loads with one leg of a multi-leg sling until the unused legs are made secure.
- xxx. Never point load a hook unless it is especially designed and rated for such use.
- xxxi. Make certain that the load is broken free before lifting and that all legs are taking the load.
- xxxii. When using two or more slings on a load make certain all slings are made from the same materials.
- xxxiii. Lower the loads on to adequate blocking to prevent damage to the slings.
- xxxiv. Materials and equipment being hoisted must be loaded and secured to prevent any movement which could create a hazard in transit.

- xxxv. The weight of the hook, load block and any material handling devices must be included when determining crane capacity.
- xxxvi. Calculated weights cannot exceed load chart without written approval.
- xxxvii. Personnel must be completely clear of loads being picked up or set down by crane. Tag lines will be used to control the loads. Loads must not be touched by hand while placing/ moving.

o. Slings

The following are rules for safe use of synthetic slings:

- i. Synthetic slings must be marked to show the rated capacity for each type of hitch and type of web material.
- ii. Nylon web slings must not be used where fumes, vapors, sprays or mists or liquids of acids or phenolic are present. Web slings with aluminum fittings must apply in this category.
- iii. **Synthetic web slings must be removed from service and destroyed if any of the following conditions are present:**
 - a. Acid or caustic burns
 - b. Melting or charring of any part of the sling surface
 - c. Snags, punctures, tears or cuts
 - d. Broken stitches
 - e. Distortion of fittings
 - f. Synthetic web slings of polyester or nylon must not be used at or come in contact with temperatures in excess of 82°C
 - g. Polypropylene web slings must not be used at or come in contact with temperatures in excess of 93°C
 - h. Insulated hooks must be tested yearly to ensure insulation integrity to at least manufacturer's specifications.

p. Wire Rope Slings must be removed from service and destroyed if any of the following conditions are present:

- i. In (10) randomly distributed wires broken in one (1) rope lay, or five (5) broken wires in one (1) strand in one (1) rope lay.
- ii. Wear or scraping of one-third the original diameter of outside wires.
- iii. Kinking, crushing, bird caging or any other damage resulting in distortion of the wire rope structure such as:
- iv. Evidence of heat damage.
- v. End attachments that are cracked, deformed worn.
- vi. Corrosion of the rope or end attachments.

q. Metal mesh slings must be immediately removed from service if any of the following conditions are present:

- i. A broken weld or broken brazed joint along the sling edge.
- ii. Reduction in wire diameter of 25 percent due to abrasion or 15 percent due to corrosion.
- iii. Lack of flexibility due to distortion or corrosion.

r. Requirements of Plate Clamps:

- i. The rated load of the plate clamp must be marked on the main structure.

- ii. Care must be taken to make certain the load is correctly distributed for the plate clamp being used.
- iii. Do not allow load or plate clamp to come into contact with any obstruction.
- iv. The plate clamp must not be used for side pulls or sliding the load.
- v. When lifting stainless steel or special alloys, ensure plate clamp is designed for use on the specific metal.

s. Signaling Practices:

- The "slinger" is responsible for attaching and detaching the load to and from the crane. He shall:
 - have received appropriate training on general safe lifting operations;
 - be capable of selecting lifting gears suitable for the loads;
 - liaise with the operator and direct the movement of the crane safely.
- The "signaller" is responsible for relaying the signal from the slinger to the crane operator. He shall:
 - have received appropriate training on general safe lifting operations;
 - be able to direct the movement of the crane and loads.

Suggested hand signals



Note: During the lifting operation, either the slinger or signaller shall communicate with the operator. Other communication methods (e.g., wireless walkie-talkies, telephones, etc.) may also be used.

Fig. 5.4 Recommended Signaling Practices

5. DEMOLITION WORK

Before any demolition work is commenced and also during the process of the work the following shall be ensured, besides using the Work Permit:

- a. All roads and open areas adjacent to the work site shall either be closed, suitably protected or restricted for movement
- b. No electric cable or apparatus which is liable to be a source of danger nor a cable or an apparatus used by the operator shall remain electrically charged.

- c. All practical steps shall be taken to prevent danger to persons employed from the risks of fire or explosion or flooding. No floor, roof or other part of the building shall be so overloaded with debris or materials as to render them unsafe.

6. T&PS GENERAL

- a. All T&Ps/ MMEs should be of reputed brand/appropriate quality & must have valid test /calibration certificates bearing endorsement from competent authority of BHEL.
- b. Subcontractor to also submit monthly reports of T&Ps deployed and validity test certificates to BHEL safety Officer as per the format/procedure of BHEL.
- c. Tagging and punching in all lifting tool is compulsory with SWL, sr. no. and due date.
- d. All T&Ps shall be inspected by authorized Third Party agency as per applicable frequency. BHEL shall be kept informed of any such scheduled inspection
- e. All T&Ps shall be internally inspected in each quarter and colour coded.

7. CHEMICAL HANDLING

- a. Displaying safe handling procedures & MSDS for all chemicals such as lube oil, acid, alkali, sealing compounds etc. at work place.
- b. Where it is necessary to provide and/or store petroleum products or petroleum mixture & explosives, the subcontractor shall be responsible for carrying out such provision / storage in accordance with the rules & regulations laid down in the relevant petroleum act, explosive act and petroleum and carbide of calcium manual, published by the chief inspector of explosives of India. All such storage shall have prior approval if necessary from the chief inspector of explosives or any other statutory authority. The subcontractor shall be responsible for obtaining the same.
- c. The used containers of chemicals shall be segregated and disposed of suitably
- d. In case the used containers need to be re-used, all traces of the chemical to be removed by thorough cleaning with detergents etc. under trained supervision

8. ELECTRICAL SAFETY

- a. Only electricians licensed by appropriate statutory authority shall be employed by the subcontractor to carry out all types of electrical works. The subcontractor shall maintain adequate number of qualified electricians to maintain his temporary electrical installations.
- b. No PDB or any other distribution board shall be more than 03 (three) years of purchase. Only modern PDB with industrial sockets as shown in layout below to be allowed to use at site.
- c. Power supply to all equipment at site to be routed through MCBs of appropriate rating. A 'Power Supply Distribution Plan' shall be prepared and submitted to BHEL Engineer for approval
- d. All power supplies through cables shall be underground or overhead with height > 3mtrs.
- e. All power distribution boxes shall be locked and the key controlled by site management of concerned subcontractor.
- f. All individual equipment & tools at site shall be powered through Earth Leakage Circuit Breakers of 30 mA sensitivity.
- g. These MCBs and ELCBs shall be regularly tested as per Clause 14
- h. All fuses and fuse wires shall be of standard size and rating.
- i. All electrical appliances used in the work shall be in good working condition and shall be properly double earthed other than armour earthing.

- j. All extension boards shall have separate switches for all sockets / connections.
- k. All portable electric tools used by the subcontractor shall have safe plugging system (industrial top & socket) to source of power and be appropriately earthed.
- l. Providing adequate no. of 24 V sources and ensure that no hand lamps are operating at voltage level above 24 Volts especially in confined spaces like inside water boxes, turbine casings, condensers etc.
- m. Electrical appliance shall have proper earthing and for appliances equal to & more than 415V shall have two separate earthing (as per IS-3043-1987)

n. Portable Electric Lights

- i. Portable electric lights used in wet or potentially wet locations must be either low voltage type (24 volts or less) or protected by a GFI (ground fault interrupter).
- ii. They must be visually checked before each use and periodically while in use to assure their original integrity is maintained.
- iii. Cords with cuts, breaks, deep abrasions, etc. shall be taken out of service immediately.
- iv. Repairs to extension cords shall only be performed by qualified/ licensed electricians.
- v. Must not be allowed to lie in wet or potentially wet areas.

o. Underground Cables:

- i. Every electric line or cable of unknown origin that is discovered or exposed during a digging, drilling, probing, or similar operation is to be considered as energized and life threatening.
 - ii. The senior company employee on the site will ensure that all necessary safety precautions are taken in order to isolate the line from all workers and the public.
 - iii. Such precautions may include halting the operation if appropriate.
 - iv. The senior company employee on the site is to then contact the proper authorities to have the line identified and either confirmed to be abandoned and/or made safe for continuing the work.
 - v. Any and all underground lines that are discovered or become severed must be considered energized on both sides, and be treated accordingly.
- p. Details of earth resource and their test date to be given to BHEL safety officer as per the prescribed formats of BHEL
 - q. The subcontractor shall use only properly insulated and armoured cables and conform to the requirement of Indian Electricity Act and Rules for all wiring, electrical applications at site.
 - r. BHEL reserves the right to replace any unsafe electrical installations, wiring, cabling etc. at the risk & cost of the subcontractor.
 - s. No maintenance work shall be carried out on live equipment
 - t. Adequate precautions shall be taken to prevent danger for electrical equipment. No materials on any of the sites of work shall be so stacked or placed as to cause danger or inconvenience to any person or the public
 - u. The subcontractor shall carefully follow the safety requirement of BHEL/ the purchaser with the regard to voltages used in critical areas.
 - v. Wiring and Branch Circuits Must be protected by a proper amperage over-current device such as a HRC fuse or circuit breaker. Such installations must be located so as to prevent physical damage to the wire conductors & panels.

- w. The sub-contractor shall supply modern power distribution board of different combination (1-phase & 3-phase). All the distribution of power should be through modern PDB. Equipment drawing is mentioned below.

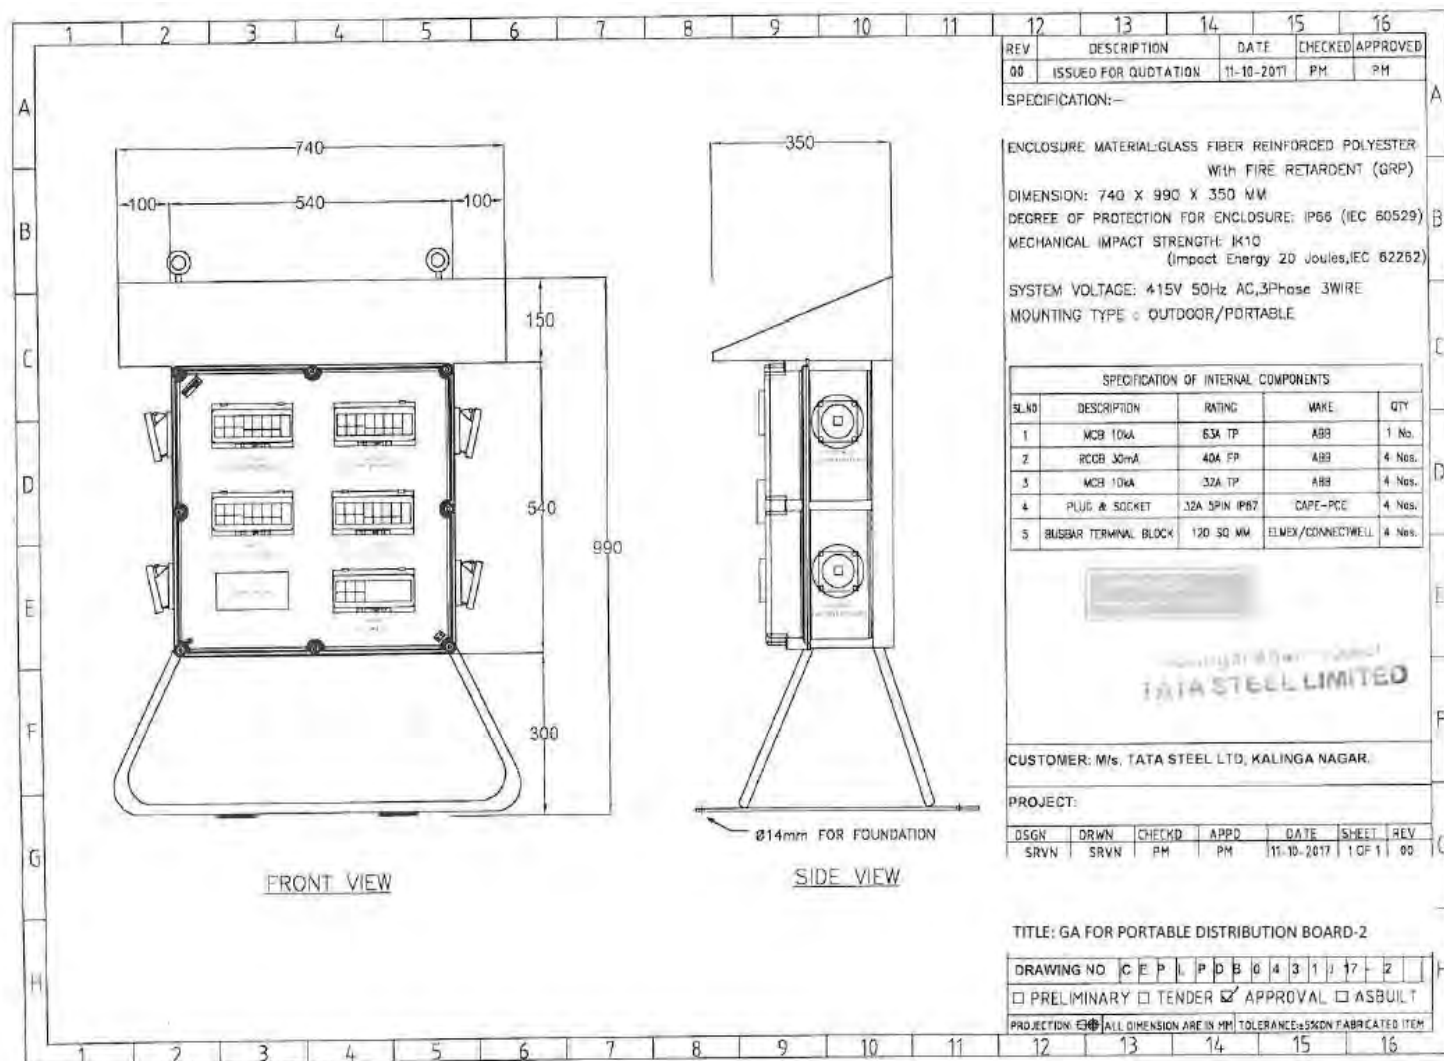


Fig. 9.1 Layout of a modern Power Distribution Board

x. General Electrical Safety

- In general, equipment or machinery being moved or transported must maintain minimum clearances of 25 ft. to all power lines.
- TAG IN/ TAG OUT must be in force in Switch Room and all Distribution Boxes for live power line. The authorized person's name and contact no shall be displayed
- Ensure "double insulated" three - core cables and three pin connectors are used and are properly ground "all insulated" types, all electrical tools and appliances must be manufactured for industrial use.
- All connections shall be electrically and mechanically sound and properly insulated. Taped joints are not permitted. Connections to socket outlets must be made with proper plugs (industrial top and socket).
- Splices in electrical cords are not permitted. Repairs must be made at the socket connection and retain the same mechanical and dielectric condition of the original connection.

- vi. Damaged or defective electric tools, equipment and extension cords, etc. must not be used and shall be tagged out of service, removed from the work area and taken back to stores.
- vii. Only licensed electricians are authorized to repair and work on electrical equipment. Tampering with electric tools or equipment by others could result in termination.
- viii. Temporary electric cabling should be elevated 2.2 meters above the floor/ground or covered for protection. It must be kept clear of walkways and other locations where it may be exposed to damage or create a tripping hazard.
- ix. Energized wiring in junction boxes, circuit breaker panels and similar places must be covered and locked at all times.
- x. Areas with live high voltage wires or terminals must be barricaded against entry and warning signs posted Danger – High Voltage and Authorized Personnel Only.
- xi. Personnel should never work on energized equipment, de-energizing (lockout/tag out) the equipment is always the first requirement.
- xii. The lockout and tag out procedure will be used when testing or working on, or around, energized installation.
- xiii. Working around energized equipment should never be done alone. A second electrician must always be available for assistance.
- xiv. If lockout/tag out of the work is infeasible (must be demonstrated), work on energized electrical circuits must be approved by the Site In-charge. All safety precautions necessary must be taken, PPE use must be evaluated per the exposure and used, i.e high/low voltage gloves, insulated shoes, overcoats/aprons, face shields, and other protective equipment like insulated tools, blankets, mats, etc. must be used.
- xv. The welding machines earth leads shall be properly fixed without loose contacts. The earth cable only has to be used. No steel members shall be used as earth leads.
- xvi. Electrical crews must be qualified for the equipment and tools they work on, including being trained in Cardio-Pulmonary Resuscitation (CPR) methods and First Aid for rendering help in the event of electric shock.

y. Qualified Persons for Electrical Works

(One who is trained and wiremen licensed to Govt. of Respective State and familiar with the construction, operation and safety hazards of the equipment upon which they are permitted to work.)

- i. Qualified persons are intended to be only those who are well acquainted/experienced with and thoroughly conversant in the electric equipment and electrical hazards involved with work being performed.
- ii. Only qualified persons may be permitted to work on or near exposed energized parts. Such persons are required to have been trained in three specific areas:
- iii. Qualified persons must be capable of working safely on energized circuits;
- iv. Must be familiar with the proper use of special precautionary techniques and procedures bases on equipment and exposure; and
- v. Must be familiar with required personal protective equipment, insulating and shielding materials, and insulated tools.

- vi. Qualified persons are expected to be able to evaluate unknown situations and adjust their activities in such a way that only safe work practices are used. Such behavior is the responsibility of the qualified person.
- vii. It is possible and likely for an individual to be 'qualified' with regard to certain equipment in the work place, and unqualified on other equipment they must know their limitation and stop work if not qualified on what equipment they were to work on.
- viii. An employee who is undergoing on-the-job training, who, in the course of such training, has demonstrated an ability to perform duties safely at his or her level of training, and who is under the direct supervision of a qualified person is considered to be a qualified person for the performance of those duties. The process must be documented as proof.

z. Mandatory PPEs of electrical work on LV & HV

- i. HV arc flash suit with protective hood (for protection of face and head) as specified for hazard risk category-4 in NFPA-70E or similar IS specification for working on HT switch gear (for all voltage >690 V) to the concerned licensed electrician or competent person.
- ii. LV arc flash jacket/FR as specified for hazard risk category-4 in NFPA-70E or similar IS specification having ATPV rating of 8.5 to 9 cal/cm² for working on LV (>260V and ≤690V) to the concerned licensed electrician or competent person.



- iii. The LV arc flash jacket as shown above shall be worn continuously while working on LV (>260V and ≤690V). The color specification of LV arc flash jacket should be blue.
- iv. Electrical hand gloves should have following specification: Flame resistance, arc flash and cut protection of voltage rating (>260V and ≤690V).
- v. Electrical safety over shoe of relevant IS make for foot protection of licensed electrician or competent person while working in HV & LV line or equipment.

9. USE OF HAND TOOLS AND POWER-OPERATED TOOLS

a. General Provisions

- i. All hands and power tools and similar equipment, shall be maintained in safe condition.
- ii. When power operated tools are designed to accommodate guards, they shall be equipped
- iii. with such guards, when in use;
- iv. Belts, gears, shafts, pulleys, sprockets, spindles, drums, fly wheels, chains and other reciprocating, rotating or moving parts of the equipment shall be similarly guarded;
- v. Personnel using hand and power tools and exposed to the hazard of falling, flying, abrasive, and splashing objects, or exposed to harmful dusts, fumes, mists, vapors, or gases shall be provided with the particular personal protective equipment necessary to protect them from the hazards;

- vi. All hand-held powered platen sanders, grinders, grinders with wheels of 5 cm or less, routers, planers, laminate trimmers, nibblers, shears, scroll saws and jigsaws with blade shanks of 0.5 cm wide or less shall be equipped with only a positive on-off control.
- vii. All hand-held powered drills, tappers, fastener drivers, horizontal, vertical or angle grinders with wheels greater than 5 cm in diameter, disc sanders, belt sanders, reciprocating saws, saber saws and other operating powered tools shall be equipped with a momentary contact on control provided that turnoff can be accomplished by a single motion of the same finger or fingers that turn it on.

b. Hand Tools

- i. The subcontractor shall not issue or permit the use of unsafe hand tools;
- ii. Wrenches including adjustable pipe end and socket wrenches shall not be used when saws are sprung to the point that slippage occurs;
- iii. Impact tools such as drift pins, wedges and chisels shall be kept free of mushroomed heads;
- iv. The wooden handles of tools shall be kept free of splinters or cracks and shall be kept tight on the tools.

c. Power Operated Tools

- i. Electric power operated tools shall be either of the approved double-insulated type or shall be grounded;
- ii. The use of electric cords for hoisting or lowering loads shall not be permitted;
- iii. Pneumatic power tools shall be secured to the hose or whip by some positive means to prevent the tool from becoming incidentally disconnected;
- iv. Safety clips or retainers shall be securely installed or maintained on pneumatic impact (percussion) tools to prevent attachments from being incidentally expelled;
- v. All pneumatically riveting machine staplers and other similar equipment provided with automatic fastener feed, which operate at more than 7 kg/cm² pressure at the tool a safety device on the muzzle to prevent the tool from ejecting the fasteners unless the muzzle is in contact with the work surface;
- vi. Compressed air shall not be used for cleaning purposes except when the pressure is reduced to less than 2 kg/cm² and that too with effective chip guarding. The 2 kg/cm² pressure requirement does not apply to concrete form, mill scale and similar cleaning purposes;
- vii. The manufacturer's safe operating for hoses, pipes, valves, filters and other fittings shall not be exceeded;
- viii. Only personnel who has been trained in the operation of the particular tool shall be allowed to operate power-actuated tools;
- ix. The tool shall be tested each day before loading to see that the safety devices are in proper working condition. The method of testing shall be accordance with the manufacturer's recommended procedure;
- x. Any tool found not in proper working order, or that which develops a defect during use, shall be immediately removed from service and not used until properly repaired;
- xi. Tools shall not be loaded until just prior to the intended firing time. Neither loaded nor empty tools are to be pointed at any other person. Hands shall be kept clear of the open barrel end;
- xii. Loaded tools shall not be left unattended;
- xiii. Fasteners shall not be driven into very hard or brittle materials including, but not limited to, cast iron, glazed tiles, surface hardened steel, glass block, live rock, face brick or hollow tiles;

- xiv. Driving into materials that can be easily penetrated shall be avoided unless backed by a
- xv. substance that will prevent the pin or fastener from passing completely through and creating a flying missile hazard on the other side;
- xvi. No fastener shall be driven into a palled area caused by an unsatisfactory fastening;
- xvii. Only non-sparking tools shall be used in an explosive or flammable atmosphere;
- xviii. All tools shall be used with the correct shield, guard or attachment as recommended by the manufacturer.

d. Abrasive Wheels and Tools

- i. All grinding wheel must be ISO certified only.
- ii. All grinding machines shall be supplied with sufficient power to maintain the spindle speed at safe levels under all conditions of normal operation;
- iii. Grinding machines shall be equipped with suitable safety guards;
- iv. The maximum angular exposure of the grinding wheel periphery and sides shall not be more than 900, except that when the work requires contact with the wheel below the horizontal plane of the spindle, the angular exposure shall not exceed 1200. In either case, the exposure shall begin not more than 8.650 above the horizontal plane of the spindle. Safety guards shall be strong enough to withstand the bursting of the wheel;
- v. Floor and bench-mounted grinders shall be work-rests, which shall be rigidly supported and readily adjustable. Such work-rests shall be kept at a distance not to exceed 5 mm from the surface of the wheel;
- vi. Cup type wheels used for external grinding shall be protected by either revolving cup guard or a band type guard;
- vii. When safety guards are required, they shall be mounted as to maintain proper alignment with the wheel and the guard and the guard and its fastening shall be adequate strength to retain the fragments of the wheel in case of incidental breakage. The maximum angular exposure of the grinding wheel periphery and sides shall not exceed 1800;
- viii. Portable abrasive wheel used for internal grinding shall be provided with suitable safety flanges;
- ix. When safety flanges are required, they shall be used only with wheels designed to fit the flanges. Only safety flanges, of a type and design and properly assembled so as to ensure that the pieces of the wheel will be retained in case of incidental breakage, shall be used;
- x. All abrasive wheels shall be closely inspected and ring tested before mounting to ensure that they are free from cracks or defects;
- xi. Grinding wheels shall fit freely on the spindle and shall not be forced on. The spindle nut shall be tightened only enough to hold the wheel in place;
- xii. All employees using abrasive wheels shall be protected by suitable eye protection equipment.

e. Wood Working Tools

- i. All fixed power-driven woodworking tools shall be provided with a disconnect switch that can either be locked or tagged in the off-position;
- ii. The operating speed shall be attached or otherwise permanently marked on all circular saws over 0.5 m in diameter or operating at over 3000 peripheral rpm. Any saw so marked shall not be operated at a speed other than that marked on the blade. When a marked saw is re-tensioned for a different speed,

the marking shall be corrected to show the new speed;

- iii. Automatic feeding devices shall be installed on machines wherever the nature of the work will permit. Feeder attachments shall have the feed rolls or other moving parts covered or guarded so as to protect the operator from hazardous points;
- iv. All portable power-driven circular saws shall be equipped with guards above and below the base plate or shoe. The upper guard shall cover the saw to the depth of the teeth, except for the minimum arc required to permit the base to be tilted for bevel cuts. The lower guard shall cover the saw to the depth of the teeth, except for the minimum arc required to allow proper retraction and contact with the work. When the tool is withdrawn from the work, the lower guard shall automatically and instantly return to the covering position.

10. START UP, COMMISSIONING AND TESTING:

There are various activities involved prior to commissioning- the major ones are -Hydraulic Test, Steam Blowing, Transformers Charging, Boiler Light Up, Rolling and Synchronisation and Full loading of unit.

- a. These activities shall be personally supervised by the site executive along with the commissioning engineer.
- b. Appropriate Work Permits shall be taken as applicable
- c. The readiness of upstream and downstream system shall be ensured before taking up.
- d. These shall be handled strictly by the authorized persons only and the team shall be suitably briefed about the activity including hazards & risks involved and control plan by the concerned executive-in-charge before start.
- e. Entry of persons to the area of activity shall be suitably restricted and the emergency functions like Ambulance, first aid center and Fire station shall be intimated about the plan well in advance.
- f. Tag-in/ Tag-out shall be in place while charging transformer and whenever necessary.
- g. Electricians with valid wiremen license only shall be permitted to work on power lines.
- h. The area and the passage shall be adequately illuminated.

11. FIRE SAFETY

- a. The Fire Prevention, Protection and Preparedness Program is an integral part of the overall HSE Program. Effort and consideration must be given to safety, life and potential for delays in construction schedules and plant startup, as well as protection of property on a given project. The purpose of which is to prevent
 - i. Inception of fire
 - ii. Loss of life or personal injury
 - iii. Loss of Property
 - iv. Interruption of operations
- b. Site-in-charge / Safety Officer will make periodical review of the site Fire Protection, Prevention Preparedness Programme, Site conditions and available fire protection equipment. It is very imperative that the Sub-contractors along with BHEL to establish good contact with Local fire station for availability of Fire tender in case of emergencies, in addition to their own fire equipment.
- c. Fire Protection, Prevention and Preparedness Inspections - The Contractor /Sub-Contractor will be required to make frequent fire prevention inspections of his work site and operating facilities. Deficiencies will be corrected at once.
- d. Area where Hot work activities are carried out (Gas cutting / Welding/ any other spark producing work)

above a working spot, a GI / fire-resistant non-asbestos sheet or suitable material shall be placed to prevent the fall of hot sparks. A bucket of water shall be kept nearby while doing hot work

- e. Hot work shall be preferably carried out in a designated area with a standing Hot Work Permit, to be renewed monthly. The designated area shall have fire extinguishers.
- f. Any hot work outside designated area shall require a Hot Work permit and fire watch. No flammable material shall be stored within 35 feet from any fire load.

12. PAINTING:

- a. Requirements provide a detailed procedure to be implemented by all concerned employees and sub-contractors involved in painting activities.
- b. Significant Environmental Hazards:
 - i. Chemical hazard due to inhalation of lead fumes (lead containing paint)
 - ii. Chemical hazard due to inhalation of VOC's from painting operations
 - iii. VOC's from painting and coating operation
 - iv. Disposal of paints and coats drums
- c. Control Procedure for Painting:
 - i. Chemical products used in painting and coating operation shall have proper MSDS sheet in place. Whenever any doubt arises with respect to handling and safety point of view it should be accessed to all concerned.
 - ii. Toxic substances and hazards relate the toxic chemicals shall be identified.
 - iii. Proper PPE shall be used including plastic gloves appropriate overall etc.,
 - iv. Arrangement for cleaning of spillage shall be ensured
- d. Only trained workers shall be allowed and proper training should be imparted to the works.
- e. Exposure limits of the toxic substances shall be checked before starting the work and nobody shall be allowed to carry the work beyond the permissible limit.
- f. Ventilation or exhaust facility shall be provided at place where painting and coating operations are carried out.
- g. Overalls shall be supplied by the contractors/subcontractors to the workmen and adequate facilities shall be provided to enable the painters to wash at the cessation of work.
- h. Smoking, open flames or sources of ignition shall not be allowed in places where paints and other flammable substances are stored.
- i. A caution board in national /regional language "**smoking strictly prohibited**" shall be displayed in the vicinity.
- j. Suitable fire extinguishers/sand buckets shall be kept available at places where flammable paints are stored, handled or used.
- k. In case of indoor painting or painting in confined spaces, exhaust ventilating shall be provided. If adequate ventilation is not provided a proper respirator shall be provided and used by persons who are trained and fit tested.
- l. The VOC's from painting and coating operations shall not exceed the permissible level of CPCB/ SPCB norms. The paints and coats must be selected as per the guidelines.
- m. Workers shall thoroughly wash their hands and feet before leaving the work.

13. “HAZARDOUS ENERGY” CONTROL PROCEDURE/ LOCKOUT/TAGOUT (LOTO)

Hazardous Energy Control Procedures, known as "Lockout/Tagout (LOTO)" refers to specific practices and procedures to safeguard employees from the unexpected energization or startup of machinery and equipment, or the release of hazardous energy during service or maintenance activities.

Contractors must develop and submit a written LOTO program. This requires that a designated qualified individual turns off and disconnects the machinery or equipment from its energy source(s) before performing service or maintenance and that the authorized employee(s) either lock and tag the energy-isolating device(s) to prevent the release of hazardous energy and test the machine or equipment to verify that the energy has been isolated effectively.

a. Minimum Requirements:

The following are minimum requirements that must be included in the Contractor's LOTO program:

- i. Inspection of equipment by a trained individual who is thoroughly familiar with the equipment operation and associated hazards.
- ii. Identification and labeling of lockout devices. Purchase of locks, tags, and blocks. Development of a standard written operating procedure, permitted through a controlling authority that is followed by all workers.

b. General Requirements

The following steps must be taken to protect workers that install or service equipment and systems:

Follow the hazardous energy procedures and statutory regulations. Follow the manufacturer's service/repair instructions. Identify and label all sources of hazardous energy. Before beginning work, accomplish the following:

- i. De-energize all sources of hazardous energy:
 - ii. Disconnect or shut down engines or motors.
 - iii. De-energize electrical circuits.
 - iv. Block fluid (gas or liquid) flow in hydraulic or pneumatic systems.
 - v. Block or secure machine parts against motion.
 - vi. Block or dissipate stored energy.
 - vii. Discharge capacitors.
 - viii. Release or block springs that are under compression or tension.
 - ix. Vent fluids from pressure vessels, tanks, or accumulators—but never vent toxic, flammable, or explosive substances directly into the atmosphere.
- c. Lockout and tag out all forms of hazardous energy including electrical breaker panels, control valves, etc. Make sure that only one key exists for each of your assigned locks and that access to the key is controlled. Verify by test and/or observation that all energy sources are de-energized.
- d. After completion of the work, accomplish the following:
- i. Inspect repair work before removing the lock and activating the equipment.
 - ii. Make sure that only the worker that installed the lock removes his/her assigned lock.
 - iii. Make sure that all workers are clear of danger points before re-energizing the system.

e. LOTO Procedure**PURPOSE AND SUMMARY**

This procedure provides the requirements and responsibilities of Hazardous Energy Control and the process for Lockout / Tag out (LOTO) of energy isolating devices (valves, circuit breakers, disconnect, etc.). Its use

shall ensure that machinery, equipment, or systems are isolated from all potentially hazardous energy to prevent unexpected energization, startup, or release of stored energy which may cause personnel injury or property damage.

This procedure applies to all BHEL personnel and subcontractors working on the WBPDC (1X660MW) STAGE-III projects where equipment must be taken out of service for the performance of work activities such as installation, maintenance, repair, construction, or equipment removal. The procedure may also be used to isolate equipment of which the energization or operation may present danger to personnel or property. Lockout / tag out are not required for electrical equipment that can be unplugged from the source and the person performing the work has control of the plug.

This procedure shall be applied to prevent injury or damage caused by the unexpected release of active or stored energy. Hazardous energy sources could be in the form of the following:

- Electrical
- Hydraulic
- Chemical
- Thermal
- Mechanical
- Pneumatic

Preplanning of work activities includes the identification of all potential hazardous energy sources so that they may be properly controlled and isolated, locked, and tagged out.

Prior to initiating work activities on or around locked out / tagged out equipment, the equipment must be tested and tried by or in the presence of the person(s) performing the work activities.

RESPONSIBILITIES

- The Engineers in Charge is responsible for implementing and enforcing this procedure and approving lockouts /tag outs that impact the operation of the project.
- The Engineer in Charge is responsible for authorizing Lockout /Tag out Requests.
- The Lockout / Tag out Coordinator is responsible for maintaining the Lockout / Tag out Log. Each shift should have a designated Lockout / Tag out Coordinator.
- The Isolator is responsible for determining the proper isolation devices and device positions required to isolate all potential energy sources so that the work stated on the Lockout /Tag out Request Permit may be safely performed. The Isolator must be familiar with the equipment and energy type(s) that require isolation. For this reason, in some cases the Isolator may be more than one person (i.e. Engineer, System Operator and/or Electrician). The Isolator shall position the specified device points, and apply locks and tags, and sign the tags and the LOTO Permit isolation point blocks.
- The Safety Manager is responsible for conducting an annual audit that is documented to ensure all procedures and requirements are current and being followed as written.

DEFINITIONS

Affected Employee: -

An employee whose job requires him/her to operate or use machinery or equipment on which servicing or maintenance is being performed under a lock out/tag out procedure or whose job requires him/her to work in an area in which servicing or maintenance is being performed under a lockout/tag out procedure

Authorized Employee: -

An employee who implements a lockout/tag out procedure on machinery, equipment, or systems in order that servicing or maintenance may be performed. Often an authorized employee and an affected employee may be the same person.

Danger “Do Not Operate” Tag

A tag used to identify energy isolation devices and specify the required position of the device. The tag should be affixed to the isolation device such that it is in plain view of anyone attempting to operate the device. The tags shall be sequentially numbered and shall specify the lockout/ tag out request number. The tag shall also state the purpose, and the expected duration of the lockout /tag out

Isolation Device

A device that is designed and intended to prevent the passage of energy. These devices, usually located at the energy source, are typically valves, circuit breakers, etc. Isolation devices should have a means of being locked in position

Lockout Device

A device that uses a positive physical means such as a lock, either key or combination type to maintain an energy isolation device in the safe position and prevent the inadvertent energization of machinery, equipment, or systems. Device locks should serve no other purpose other than hazardous energy control isolation

Lockout Tag out Request Permit

A pre-numbered form used to request that machinery, equipment or systems be taken out of service. A Lockout/Tagout Request Permit may be initiated by any one requiring energy isolation for work activities or for taking faulty equipment out of service

Lockout / Tag out Request Log

A record of all Lockout /Tag out Request Permits shall be maintained by the Lockout /Tag out Coordinator.

PROCEDURE**1. REQUESTING A LOCKOUT / TAGOUT PERMIT**

When machinery, equipment, or systems are partially or completely taken out of service for work activities or equipment protection, a lockout / tag out shall be requested. The requestor shall be familiar with scope of work required and shall provide a brief description of the work on the Lockout / Tag out Request Permit. The requestor shall also provide the proposed start time and estimated duration of lockout / tag out. If familiar with the machinery, equipment, or system to be taken out of service, the requestor may identify the devices that are required to be isolated. The LOTO Request Permit shall be forwarded to the Authorized Lockout / Tag out Coordinator for reviewed and signature, along with Permit to Work number to be entered on the LOTO Request Permit.

- a. The Lockout / Tag out Coordinator shall record the necessary information on the Lockout / Tag out Request Log and forward the request to the Engineer in Charge for approval.
- b. The Safety Manager or Engineer in Charge shall review the Lockout / Tagout Request Permit for impact on project operations. Project operations could be impacted by the equipment being taken out of service or by the required isolation to take the equipment out of service. If project operations are impacted by the Lockout / Tagout, the request shall be forwarded to the Engineer in Charge for approval.
- c. The Engineer in Charge shall provide the lockout / tag out isolation points necessary to perform the task stated on the request. The device identification, device location, device position, and locking mechanism

shall be entered into the appropriate blocks on the Lockout / Tag out Request Permit.

- d. The Engineer in Charge indicates approval of the Lockout / Tagout Request Permit by signing in the appropriate space on the request. If the Lockout /Tag out Request Permit is rejected, the Engineer in Charge shall return it to the requestor, via the Lockout / Tagout Coordinator with a written explanation of the rejection.
- e. Once approved, the Lockout / Tag out Request Permit shall be forwarded to the Lockout / Tag out Coordinator to assign tags and locks.
- f. The log shall show current status of all Lockout / Tag out Request Permits from submittal to approval, through lifting of locks and tags to final closeout. The log shall be maintained by the Lockout / Tag out Coordinator in their office.

2. PLACEMENT OF LOCKS AND TAGS

- a. The tags shall be filled out to match the information on the LOTO Request Permit. Appropriate locks for the types of isolation devices specified shall be collected and placed with the tags and the Lockout / Tag out Request Permit.
- b. The isolator(s) shall take the device locks, tags, and the Lockout / Tagout Request Permit to position the specified isolation devices, sign and hang the tags, and place the locks. If the isolator does not agree with or understand the Lockout / Tagout Request Permit, or has a problem performing the isolation, the problem should be brought to the attention of the Safety Representative or Area Supervisor immediately and the lockout / tag out should be postponed until the situation is resolved.
- c. Once the Isolator has placed all “locks” on isolation points, they will “test ”and “try” the machinery, equipment, or system to ensure all hazardous energy has been completely removed and the isolation is one totally accomplished, and has initialed and signed the Lockout /Tag out Request Permit indicating all isolation points have been confirmed. Examples of “lock”, “test” and “try”:
 - by checking that all locks on the LOTO Request Permit have been applied and are in the specified position open/closed, on/off, etc.; metering test of electrical circuits, opening of drain valves, checking pressure gauges or indicators; and try by pushing start buttons and on/off switches, etc.
 - Testing shall be performed by person(s) knowledgeable of the energy source(s) being isolated (e.g., an electrician should meter electrical circuits).
- d. A copy of the completed Lockout /Tag out Request Permit shall remain with the Work Package and used as part of the daily Pre-Job Briefings

3. WORKING UNDER A LOCKOUT / TAGOUT REQUEST

- a. Prior to starting the work activity, the person(s) performing the work shall review the Lockout / Tag out Request Permit and place the necessary tags and personal locks on the identified isolation devices. Personal locks may be placed only on devices that have already been locked and tagged in accordance with the Lockout / Tag out Request Permit.
 - All personal locks shall be accompanied by a tag that is signed and dated by the worker(s) and specifies the work activity being performed.
 - Personal locks should be of a different color than device locks for ready identification.
- b. Verification of the effectiveness of the isolation by the Isolator shall be performed for Worker’s working under the lockout / tag out, by demonstrating the checks on “lock”, “test” and “try”,
- c. When the work activity is finished, personal locks and tags shall be removed and the Safety Representative

shall be notified that the Lockout / Tagout is no longer required. If work under a lockout / tag out is to be delayed or interrupted for a period in excess of 24 hours, personal locks shall be removed until the work restarts. Personal locks shall be removed prior to the worker(s) leaving the project at the end of shift unless the key(s) are maintained at the project.

4. REMOVAL OF LOCKS AND TAGS

- a. When the lockout / tag out is no longer required, the Safety Representative or Area Supervisor shall obtain the Lockout / Tagout Request Permit from the work package for LOTO removal. Prior to removing locks or tags that may allow equipment to be energized, a check shall be made to verify that the equipment is free to safely operate (i.e., will not cause damage or injury). The locks and tags shall be removed and returned to the Lockout / Tagout Coordinator. Isolation devices may be repositioned at the discretion of the Engineer in Charge according to operational requirements. The Isolator shall complete the Lockout / Tagout Request Permit indicating each lock and tag has been removed and the Safety Representative or Area Supervisor forward to the Lockout / Tagout Coordinator.
- b. The Lockout / Tagout Coordinator shall discard the tags and maintain the completed Lockout / Tagout Request Permit for future reference.
- c. In the event that an employee leaves the job site without removing the personal lock I tag, the following measures shall be taken and documented. The measures listed below are a minimum set of guidelines and under all circumstances, refer to the site-specific safe work plan for detailed procedures:
 - Attempt calling / contacting the employee to return to the site for removal.
 - In the event an employee cannot be contacted, the Site Manager and Safety Manager shall sign an Emergency Lockout/Tagout Removal Form, which has been completed by the Area Supervisor.
 - Employee shall be notified upon returning to the site, prior to beginning any work.

5. INTERRUPTION OF A LOCKOUT / TAGOUT

Operational Emergency

The Engineer in Charge / Safety Manager /Area Supervisor may deem it necessary to temporarily remove the locks and tags from isolation devices, prior to the end of the work activity. The standard procedure for removal of locks and tags shall be followed. Extreme caution shall be taken by the Isolator removing the locks and tags to prevent personnel injury.

Testing

When the performance of a work activity requires the functional testing of a machine, component, or system, the locks and tags may be temporarily removed in accordance with the tag removal, to perform the test. As a result of the testing, if it is determined that the equipment needs further work, the locks and tags shall be positioned back on to the device. If it is not necessary to replace all the locks and tags, then the unnecessary locks and tags may be returned to the Lockout / Tagout Coordinator. The Engineer in Charge shall initial the Lockout / Tag out Request Permit in the removal block to indicate that these locks and tags have been removed. When testing has been satisfactorily completed, the locks and tags shall be removed.

ISOLATION DEVICES

- In most industrial applications, there are isolation devices that were not designed to accommodate a locking device. In these instances, an acceptable alternative that physically obstructs or prevents the use of the isolation device shall be found. Chains shall be placed on valves or electrical panels. Wires shall be determinate, pulled back, taped, and secured.

- If an isolation device does not accept a lock, a tag only is acceptable; however, all possible precautions shall be undertaken to provide a level of safety for the workers. The tag shall be readily visible to anyone attempting to operate the device.
- If more than one Lockout / Tagout Request Permit requires that a single isolation device be locked and tagged, a lock and tag for each request shall be placed. Each lock in itself prevents the inadvertent operation of the device.

GROUP / COMPLEX LOCKOUT

In a multiple lockout / tag out procedure, each person working on the machinery or equipment must place a lock or tag on the energy isolating device. If the energy isolating device will not accept multiple locks or tags, a hasp (a multiple lockout device, may be used. The locks or tags must be placed in such a way that energy cannot be restored to the machinery or equipment until every lock or tag is removed. As each employee involved no longer needs to maintain lockout / tag out protection that employee removes his - her lock and/or tag. The employee attaching the lock or tag is the only person authorized to remove the lock or tag.

6. TRAINING

The training must include recognition of hazardous energy source, type and magnitude of energy available, methods and means necessary for energy isolation and control. Each authorized employee shall receive adequate training. The training should address that all affected employees are instructed in the purpose and use of the energy control procedure. There should be training provisions included for any other employee whose work operations are or may be in an area where energy control procedures may be utilized. The employee training should also address when tag out systems are used including the limitations of a tag (tags are warning devices and do not provide physical restraint). The training should also include that a tag is not to be removed without authorization. The tag is never to be ignored or defeated in any way. Retraining is required when there is a change in job assignments, in machines, a change in the energy control procedures, or a new hazard is introduced. All training and I or retraining must be documented with employee's name and dates of training.

7. PROGRAM REVIEW

The lockout / tag out program must be reviewed at least annually. The review must ensure that procedures are being followed and that they are effective. A documented review of the inspection must include the date, the equipment, employees involved & the inspector. The inspector must be someone other than those actually using the lockout / tag out in progress.

ATTACHMENTS

#1. Danger (DO NOT OPERATE) Tags



#2. Device & Personal Locks and Multi Lock Hasp:



#3. Lockout / Tagout Request Permit

		LOCKOUT / TAGOUT REQUEST PERMIT			LOTO Request Permit No.: Work Permit No.:		
Equip. Out of Service:	LOTO Date Required by: ____ / ____ / ____	Estimated Duration:		LOTO Requested Date:			
Scope of Work:				LOTO Authorization Signed by: Date:			
				LOTO Removal Authorization Signed by: Date: Time:			
Tag No.	Device to be Tagged / Locked I.D. No.	Device Location	Device Position OPEN / CLOSE D -	Lock No.	Tag/Lock Placed by Print/Sign - Date/Time		Tag /Lock Removed by Print/Sign - Date/Time
Comments Instructions: Attachment 3.Lockout / Tag out Request Permit:							

#4. Lockout / Tag out Request Log

LOTO Permit No.	Request or Name	Equipment & Location	Est. Work Completed Date	Approval Date	LOTO Placed Date	LOTO Removed Date	Comments

14. RISK ASSESSMENT

Risk and Hazard Analysis

In order to produce an overall Project EHS Plan, a project must be assessed for its risks. There are two components to the risk and hazard analysis. The procedure used to examine and plan for the identified risks and hazards is called a General Hazard and Risk Assessment.

JSA/HIRA review

Prior to commence the following activities Method statement and JSA/HIRA to be prepared by the concern engineer in coordination with EHS officer and submit to the client for review and approval. After getting approval the work will be started under PTW after clearance. For HIRA and criteria for the defining the high, medium & low risk the relevant annexure be referred. In case any deviations required in the approved method statement the concerned engineer/supervisor has to prepare additional HIRA/JSA to cover the new activities and associated risk. Following activities to be covered,

- Deep excavation (more than 5 feet)
- Significant concrete pouring (like heavy foundation, TG deck, Slab casting etc.)
- Confined entry
- Blasting
- Working on electrical/ energized equipment's
- Steel erection more than 5-Ton weight
- Working at height prior to completion of stairs/ladders/hand railing etc.

Definition:

HAZARD - Any potential or present danger to persons or property within the project site, e.g., oil on the floor is a hazard.

INCIDENT - An unintended happening that may result in injury, loss or damage, e.g., Slipping on the oil is an Incident.

INJURY – Physical harm, the result of an Incident, e.g., a sprained wrist from the fall would be an injury.

Hazard Analysis Document

- For high risk and dangerous work identified, the Applicant shall complete and submit a Hazard Analysis Document together with the PTW request. It will be a JSA (Job Safety Analysis) or Preliminary Hazard Analysis Checklist. And it shall be reviewed and approved by respective Construction and HSE Representatives.
- Issues such as work interface, coordination, drawings, toolbox meetings and work type/duration shall be detailed and included with supporting documentation for the Applicant's request for PTW.
- If applicable, Hazard Analysis Document shall be used as the foundation for development of Safe Work Method Statement. Each hazard identified shall be addressed in the Safe Work Method Statement and be submitted as part of the Applicant's submittal package.

Evaluation of Sub-contractor Risk Assessments includes

- Experience and expertise in performing similar type work.
- Duration of work performed
- Location of the work to be performed.

- Nature of the work to be performed.
- Potential for a subcontractor performing the work to expose themselves, other persons or employees, to hazards.
- Potential for exposure to work site hazards.

Review of Subcontractor specific issues

Preventive and protective measures must be introduced according to the following order of priority

- Eliminating the hazard by removing the activity from the work process. Examples include substitution with less hazardous chemicals, using different manufacturing processes, etc.
- Controlling the hazard at its source through use of engineering controls. Examples include local exhaust ventilation, isolation rooms, machine guarding, acoustic insulating, etc.
- Minimizing the hazard through design of safe work systems and administrative or institutional control measures. Examples include job rotation, training safe work procedures, lock-out and tag-out, workplace monitoring, limiting exposure or work duration, etc.
- Providing appropriate personal protective equipment (PPE) in conjunction with training, use, and maintenance of the PPE.

15. HSE PREPAREDNESS FOR ADVERSE CLIMATES AND WEATHER

All Preventive and Precautionary measures to ensure Health & Safety of workers in all possible adverse weather conditions based on the analysis of the local area conditions to be taken by the subcontractor

15.1 SUMMER

1. The Working Time and Lunch Hour will be as per instruction of Statutory Authorities (no work between 11am to 3:30pm). However, in case temp comes down due to rain/cloudy weather work will continue as per normal routine.
2. During long lunch break, worker will be allowed to go back home for rest. Those who will like to stay back will avail at the facility of rest shed or other designed area.
3. They will be allowed to take small break during work as per their need.
4. Water sprinkling will be done on roads to reduce dust concentration.
5. Workers will be provided with adequate cool drinking water and Butter milk/Lemon water etc.
6. Adequate ORS stock will be made available at the work location in the First-Aid Box for use as needed and at First-aid Centre for emergency need.
7. Fire prevention shall be on high alert, with removal of dry grass and bushes, etc, inside and outside the surrounding work areas. No smoking, and control of open flame/sparks shall be maintained and monitored.
8. Worker will be informed about the Do's and Don'ts to be followed during summer in the Pre Job Brief.

Dos & Don'ts

1. Drink plenty of cool water and other non-alcoholic fluid and keep body well hydrated.
2. Eat salt in food to replenish loss of salt through sweating.
3. Avoid over physical exercise.
4. Have adequate sleep at night.
5. Eat light and less spicy food
6. Avoid eating food which was cooked long time ago.

7. Nobody should use small water bodies such as pits, running rain water through crevices etc. for drinking and cleaning purpose as it may be unhygienic.

Emergency Handling

In case of emergency due to heat disorder:

1. Rescue the victim from workplace and place under shed.
2. If to be rescued from height, use stoke basket or rescue kit.
3. Inform Ambulance immediately.
4. If nearby any air conditioned room/shed is available, place him inside the room/shed.
5. Administer First aid by trained First aider for Heat Disorder
6. If conscious, give him ORS solution to drink.
7. If required send the victim hospital immediately.

15.2 MONSOON**A. Height Work & Structural Safety:**

1. Ensure that all height work platforms are barricaded and avoid any highly hazardous
2. Height work.
3. Ensure that all personnel have good quality and intact safety shoes
4. Stop all dangerous height work during rain
5. Explain Do's and Don'ts to workers during Tool Box Meetings
6. Ensure that there are no weak structures, boards etc. that can fall during high winds
7. Do not allow any loose material (e.g. GI sheet, Ply board, empty cement bag, aluminium foil, foam sheets etc.) on roof sheds or top of structures.
8. Do not permit any one to ride up or come down scaffolds frame work during heavy wind or rain.
9. Provide "anchor" of adequate strength to scaffolds and other high-rise structures.
10. All rest sheds and GI sheds will be anchored into the round and wall and roof panels will be secured with J hook to prevent shed from blowing over or parts/pieces becoming airborne. Proper earthing per IS standard is also to be installed.
11. Do not go alone nor permit anyone to stay at tower-tops, roof-tops, high structures or on electrical poles during the course of stormy weather or heavy rain.

B. Electrical:

1. All electrical connections / loads have to be routed through ELCB / RCCB (residual current circuit breaker) whose rating should be 30mA.
2. RCCB operational checks need to be done DAILY / WEEKLY during monsoon season.
3. Avoid joints on power cables which need to be laid over-head or under-ground, better not to have any joint at all. In case joints become essential, such cables must be housed rigidly and insulation must be provided as per approved standard. The joint shall be suitable for outdoor use.
4. All electrical distribution board shall be properly covered at top and sides to protect from rain water. Extension boards shall be protected from rain water.
5. Ensure proper "earthing" for each and every electrical appliance.
6. Double earthing need to be provided for 3-phase power supply and for voltage more than 220V.

7. Provide lightening arrestors at the top of Boiler 3 and boiler 4 and rest sheds which are not covered by existing lightening arrestor of other installation.

C. Others:

1. Maintain smooth flow on open drains. i.e. no obstruction or blockade shall be made on storm water drains. If required, make temporary drains.
2. Arrange back-filling of excavated pits on war-footing basis.
3. Arrange bringing down booms of all cranes, hydra machines during stormy weather (wind speed 40-50 km/hr)
4. Confirm that all gantry cranes are effectively choked to prevent rolling and toppling.
5. Do not forget to deep ready a dew battery operated lights at site-offices during rainy season.
6. Avoid using wet damp clothes.
7. Hard Barricade excavated zone filled with water with scaffolding pipe & clamp with reflective net
8. Engage diesel operated water pump to dewater work area. For electrically operated water pump, the starter shall be protected from rain water. All rotating parts shall be guarded. Ensure availability of sufficient water pumps.

D. Health and hygiene:

1. Monsoon reduces the immunity of our body and makes us vulnerable to many diseases which are commonly associated with this season. It is time for us to keep our body challenging against disease by boosting our immunity and taking safety measures against these diseases.
2. The diseases associated with monsoon are Malaria, Jaundice, Gastro-intestinal infections, like typhoid, cholera etc. apart from these viral infections like cold and cough also make their presence felt. Majority of above said diseases are on account of:
3. Puddle of water formed due to rain become breeding grounds for mosquitoes which spread disease like, malaria and dengue fever. As a precautionary measure against mosquito-bite disease one can use mosquito net around the end which is better choice to mosquito repellents like mats and coils.
4. Pollution of drinking water during monsoon is very common. It is very necessary to drink clean and pure water when water-borne monsoon diseases like diarrhoea and gastro-intestinal infections threaten us.
5. Walking in dirty water during rainy season leads of numerous fungal infection which affect toes and nails. Diabetic patients have to take a special care about their feet. Keeping feet always dry and clean is very necessary. Avoid walking in dirty water. Keep shoes socks and raincoats dry and clean.

E. Workmen will be made aware of following Do's and Don'ts:

1. Do not sleep in daytime.
2. Avoid over physical exertion.
3. During lightning and thunder storm, do not take shelter under tree. Take shelter inside rest shed or store room.
4. Wash vegetables with clean water and steam them well to kill germs.
5. Avoid eating un-cooked foods and salads should be washed properly before consumption.
6. Drink plenty of water and keep body well-hydrated.
7. Always keep the surrounding area dry and clean. Don't allow to get water accumulated around.
8. Keep body warm as viruses attack immediately when body temperature goes down.

9. Do not enter air conditioned room with wet hair and damp cloths.
10. Dry your feet and webs with soft dry cloth whenever they are wet.
11. Eat light and less spicy food.
12. Avoid eating food which was cooked long time ago.
13. Eat salt in food to replenish loss of salt through sweating.

15.3 EMERGENCY WEATHER CONDITIONS

Cyclone/Severe thunder storm

In the event of Cyclone/Severe thunder storm, alert will be issued by subcontractor on notification received by Govt. authorities/Metrological departments Customer or BHEL.

The actions required during cyclone/rough weather:

1. Check and advice subcontractors to clean-up work area. Pick up all loose and unused material of respective supervisor's area.
2. Tie to secure all gas cylinders to avoid displacement and unsafe conditions which could be due to wind pressure.
3. Secure portable electricity generating sets and other equipment, pumps, hoses etc.
4. Make preparation for removal of water logging.
5. Take review of work activity and make preparation for removal of equipment and material from vulnerable areas.
6. Isolate/turn off all electrical power form the main panel/switches. Secure and anchor panels properly.
7. Recheck anchorage/tie of all temporary structures/sheds, tall objects, cranes, rigs, scaffolds etc. to avoid toppling due to wind force.
8. Cranes boom shall be secured, either locked or lowered the booms as reasonably and practicably possible and rigs to safe position for the safety point of view.
9. Group up all trash barrels, wooden pallets, forms; wooden decks etc. and anchor properly.
10. Welding machines, air compressors and such equipment are to be grouped together and secured to the stable objects. Welding leads, electrical cables, hoses are to be rolled up and secured properly.
11. Set on site vehicles on high ground in the site area with brakes set firmly.
12. Anchor all tanks, vessels, gas cylinders that may be moved by high wind and water.
13. Evacuate job site.

Personnel Evacuation:

1. Personnel Evacuation will be required if predicted wind speed and storm surge heights are beyond acceptable limits as per the instructions from Govt. Authorities/ Metrological departments or Customer.
2. Once the warning is received for personnel evacuation, an emergency response team shall be formed. The team will work with local authorities and other agencies formed/deployed to evacuate and transport all personnel involved in the project to the cyclone shelter.
3. Cyclone may be followed by the calm "EYE", be aware of it. If the wind suddenly drops, don't assume the cyclone is over. Violent wind may resume from the opposite side direction. Wait for the official "All clear Signal".

4. After the cyclone, do not go outside until officially communicated about safe situation outside. Use recommended routes for returning. Do not panic or rush while returning.
5. Checking of gas leaks and well-being of electrical appliances is essential before leaving the site.
6. Follow local communications for official warning and advice. The construction Manager shall also obtain updates from customer/metrological departments and communicate to the personnel on project site.

15.4 PREVENTION OF COVID-19 (COVID-19 HERE TO BE READ AS COVID-19 AND OTHER PANDEMICS/ COMMUNICABLE DISEASES) AT PROJECT SITE & LABOUR COLONY:

Resumption of Construction Activities after Lock Down and Prevention of Coronavirus Infection during Site Operations and OCP 61A: Prevention of COVID-19 Infection in Labor Colony will be strictly followed.

A. Preventive measures at project site:

- BHEL and Agencies shall nominate COVID Marshalls, who will be responsible for monitoring the COVID prevention measures and apprising management on the same.
- Mandatory health check-up for every worker/ official joining the site
- All activities to be carried out using least amount of paperwork and physical proximity as far as possible.
- **HSE Observer App** to be used to monitor HSE Activities and follow up with agencies for closure of non-conformities.

a. Strict Control at the Gate/ Banning Entry to Anyone Not Wearing Masks

- i. Security personnel at the gate may erect a barricade preferably approx. 10 meters from the gate and only allow personnel who are wearing proper masks inside.
- ii. Public address system may be used to warn any non-compliant visitors
- iii. Near entry gate, round markers at minimum 1-meter distance to be ensured so that distancing is ensured
- iv. A hand-wash or hand sanitiser facility is preferable at the gate to allow entry after hand wash or hand sanitisation. These are also to be provided at key locations to enable hand wash / hand sanitisation before starting work, before eating, etc.
- v. Gutkha, Paan, tobacco etc. to be banned from the site. Spitting to be strictly prohibited.

b. Screening at Gate with Contactless Thermometer & Action on Suspected Cases

- i. Security Personnel at the Gate to screen each person entering the premises using a non-contact infrared thermometer, which is duly serial numbered and calibrated.
 - ii. In case any site worker/ official is found to have fever more than 99 Degrees Fahrenheit or found coughing/ sneezing, he/she may be advised rest till recovery and entry to be permitted after obtaining clearance from medical officer/assistance/attendants.
- Parcel to be collected from gate by concerned person preferably with provision of Special Box
 - Any construction material received at site, unless properly sanitized, to be kept undisturbed for at least 3 days and to be used only after that period.
 - During Toolbox Talks, minimum 1-meter distance between any two workers to be ensured

c. During site execution activities:

For all site execution activities, social distancing is to be maintained. In case this is not possible due to nature of work, speciality of work, etc, ensure sensitisation of the labour/staff involved and use of appropriate PPEs, especially mandatory face mask. In any case, close working to be allowed only in special

circumstances and ensuring these activities are preferably time staggered to the extent possible

d. In office premises:

- i. Sharing of items like pens, water bottles etc. in office premises to be avoided
- ii. Doors preferably to be in open condition to avoid contact
- iii. All common touch points to be frequently disinfected in a day.

e. Regular disinfection of all Areas, Equipment and facilities

- i. A dedicated disinfectant gang to be identified for the task by each agency. The disinfectant gang to be provided full body suits for the task.
- ii. All areas (including office premises, site areas, chairs, tables, furniture etc.), tools & equipment to preferably be disinfected by dedicated gang every day before resumption of work.
- iv. Common touch points like handrails, lift buttons, door/window knobs or handles, vehicle door handles, taps, conference room & dining hall tables/chairs, common sofas/chairs, visitor sofa/chairs, files & folders, etc to preferably be disinfected regularly at frequent intervals every day.
- v. Pool vehicles, to be disinfected after every use. Social distancing to be maintained inside the common pool vehicles as per Govt./ statutory body guidelines.

f. Disinfecting the operator/driver touch points of Vehicles/cranes, T&Ps etc.

Disinfection to also be carried out for all Cranes, Vehicles, Equipment, consoles, T&Ps etc. which come into contact with operating personnel.

g. Posters on COVID-19

Sufficient Posters on COVID-19 to be ensured across the site in languages understood by most workers.

h. Brief guidelines for hand washing are as below:

- i. Soap to be provided at each wash basin and replenished regularly.
- ii. Washing with soap for at least 20 seconds is recommended.
- iii. As a general guideline, for every 100 workers, 1 wash-basin may be provided at site areas.
- iv. Close queue to be avoided near wash-basins and 1-meter distance to be maintained. Round markers at 1-meter distance can be ensured as guidance

Composition of Disinfectant:

- i. Readily available 1% hypochlorite solution or 4%
- ii. Liquid chlorine-1% solution
- lii. Surgical spirit-95% alcohol content
- iv. Hand sanitizer should have: Isopropyl alcohol-75%, Glycerol-1.45%, Hydrogen Peroxide-0.125%

B. Prevention of COVID-19 Infection in Labor Colony:

- Spacing of minimum 2 meters between living areas of workers inside a room may be maintained. Preferably, the living area of each worker may be partitioned using sheet of cloth, plastic etc.
- Rooms to be properly ventilated as far as possible
- Sanitation to be given prime importance and personal hygiene to be promoted
- Face masks shall be worn by everyone inside the colony premises
- Spitting of Pan. Gutkha etc. inside the colony and urinating etc. outside the toilets to be strictly avoided
- Regular visits by Doctors to the labor colony can be arranged on non-working day for check-up of all workers
- **Identification of "COVID Wardens" (CWs) by each agency for maintaining the following:**
 - i. Keeping an eye on the health of workers and report any suspected cases of fever, coughing etc. to the

management

- ii. Keeping an eye on the social distancing measures in the labor colony and report any non-conformances to the management.
- iii. Educate the workers about social distancing and COVID prevention measures.
- Training/ Awareness regarding COVID-19 to be provided to workers regularly.
- Workers to be instructed to maintain social distancing of minimum 1 m at all time
- **Posters on COVID-19:** Sufficient Posters on COVID-19 to be ensured across the labor colony in languages understood by most workers.
- All workers to be instructed to inform any suspected cases of illness (individual or others) to an emergency contact number of CW, the emergency contact numbers and CW contact numbers to be displayed at prominent locations
- **Inspection & Review**
 - i. Daily Inspection by concerned COVID Wardens and reporting to Agency
 - ii. Regular inspection by Agency & BHEL


15.5 Noise Mitigation

High noise is harmful to the human health and it can cause impairment if exposed for long duration at regular intervals, and also cause disruption in nearby communities.

- Noise monitoring shall be carried out in all construction locations periodically.
- Use of silent DG is allowed at site during construction.
- Low noise generation equipment's to be preferred.
- Work areas where noise levels exceed the 85db shall be posted as hearing protection required.
- Use of PPEs / ear plug/ear muff for personnel entering into high noise area.
- Activities generation High noise will be planned in day shift.

Noise Level Chart

Parameter	Night Noise level dBA	Daytime Noise Level dBA
At 1-meter from each piece of equipment	85	85
At Property boundary	70	70

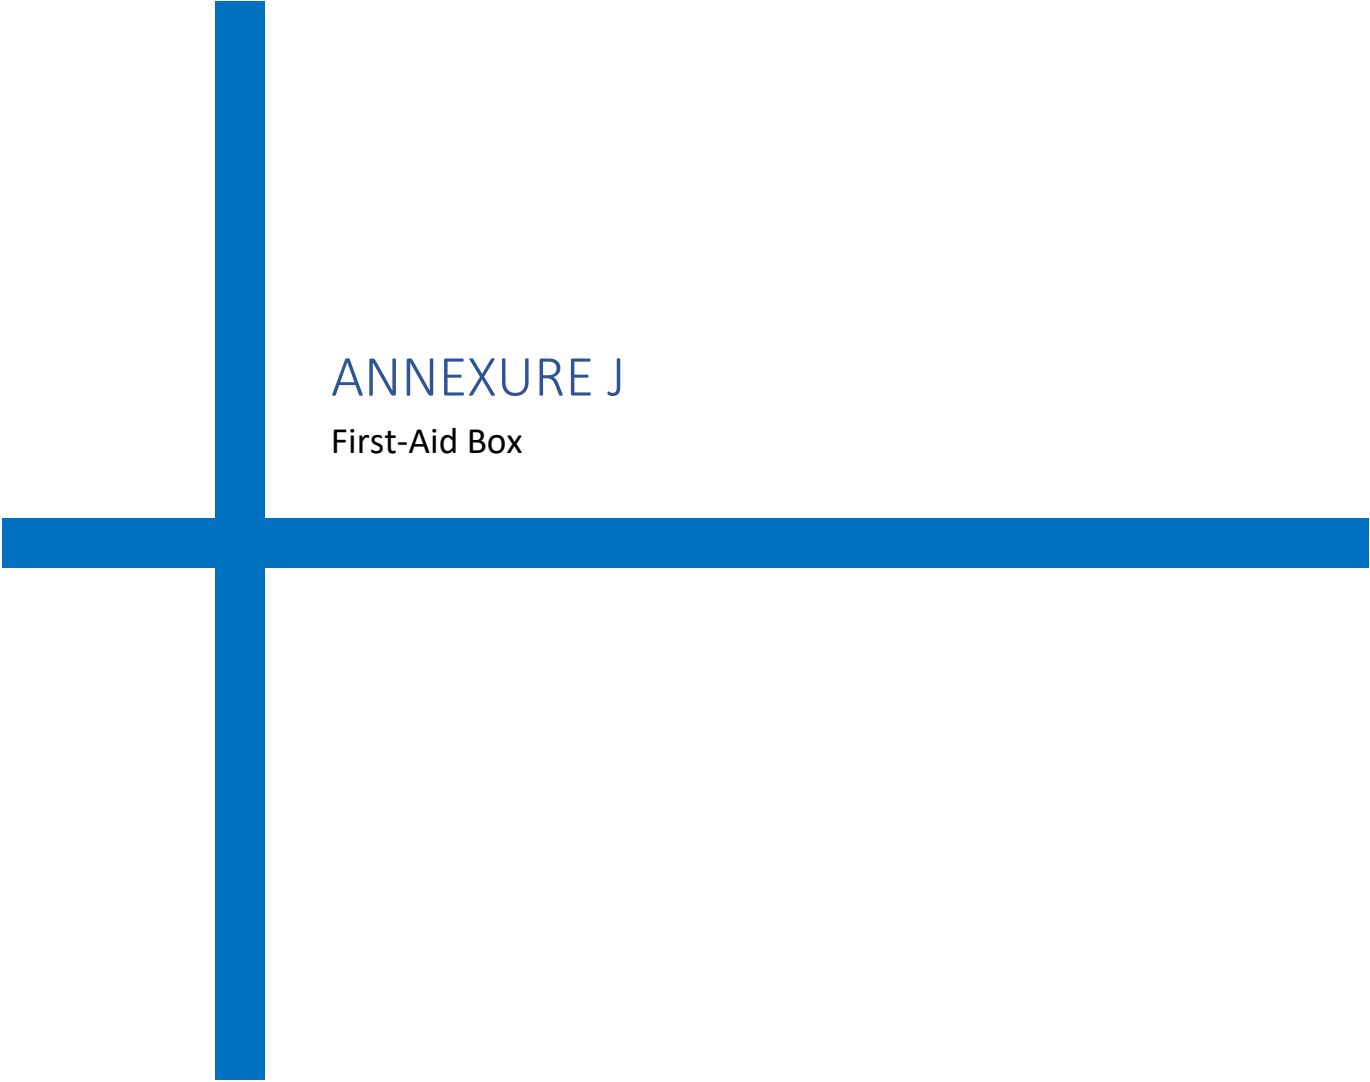

ANNEXURE J

First-Aid Box

Details & Contents of First Aid Box as per Contract Labor (Regulation & Abolition Act), Central Rules, 1971

- (1) The first-aid box shall be distinctively marked with a Red Cross on a white background and shall contain the following items, namely:


(a) For establishments in which the number of contract labor employed does not exceed fifty, each first aid box shall contain the following equipment:

(i)	6 small sterilized dressings
(ii)	3 medium size sterilized dressings
(iii)	3 large size sterilized dressings
(iv)	6 pieces of sterilized eye pads in separate sealed packets.
(v)	6 roller bandages 10 cm wide.
(vi)	6 roller bandages 5 cm wide.
(vii)	One tourniquet
(viii)	A supply of suitable splints
(ix)	Three packets of safety pins.
(x)	Kidney tray.
(xi)	3 large sterilized burn dressings.
(xii)	1 (30ml) bottle containing a two percent alcoholic solution of iodine
(xiii)	1 (30 ml) bottle containing Sal volatile having the dose and mode of administration indicated on the label
(xiv)	1 snake bite lancet
(xv)	1 (30gms) bottle of potassium permanganate crystals.
(xvi)	1 pair scissors
(xvii)	1 copy of the First-Aid leaflet issued by the Director General, Factory Advice Service and Labor Institutes, Government of India.
(xviii)	A bottle containing 100 tablets (each of 5 grains) of aspirin
(xix)	Ointment for burns
(xx)	A bottle of suitable surgical anti-septic solution

(b) For establishment in which the number of contract labor exceeds fifty each first-aid box shall contain the following equipment:

(i)	12 small sterilized dressings
(ii)	6 medium size sterilized dressings
(iii)	6 large size sterilized dressings.
(iv)	6 large size sterilized burn dressings
(v)	6 (15 grams) packets sterilized cotton wool
(vi)	12 pieces of sterilized eye pads in separate sealed packets.
(vii)	12 roller bandages 10 cm wide.
(viii)	12 roller bandages 5 cm wide.
(ix)	One tourniquet.
(x)	A supply of suitable splints.
(xi)	Three packets of safety pins.
(xii)	Kidney tray.
(xiii)	Sufficient number of eye washes bottles filled with distilled water or suitable liquid clearly indicated by a distinctive sign which shall be visible at all times.
(xiv)	4 per cent Xylocaine eye drops, and boric acid eye drops and soda by carbonate eye drops.
(xv)	1 (60ml) bottle containing a two percent alcoholic solution of iodine
(xvi)	One (two hundred ml) bottle of mercurochrome (2 per cent) solution in water.
(xvii)	1 (120ml) bottle containing Sal volatile having the dose and mode of administration indicated on the label.
(xviii)	1 roll of adhesive plaster (6 cmX1 meter)
(xix)	2 rolls of adhesive plaster (2 cmX1 meter)
(xx)	A snake bite lancet.
(xxi)	1 (30 grams) bottle of potassium permanganate crystals.
(xxii)	1 pair scissors
(xxiii)	1 copy of the First-Aid leaflet issued by the Director-General, Factory Advice service and labor Institutes, Government of India.
(xxiv)	a bottle containing 100 tablets (each of 5 grains) of aspirin
(xxv)	Ointment for burns
(xxvi)	A bottle of a suitable surgical anti septic solution.

- (2) Adequate arrangement shall be made for immediate recoupment of the equipment when necessary.

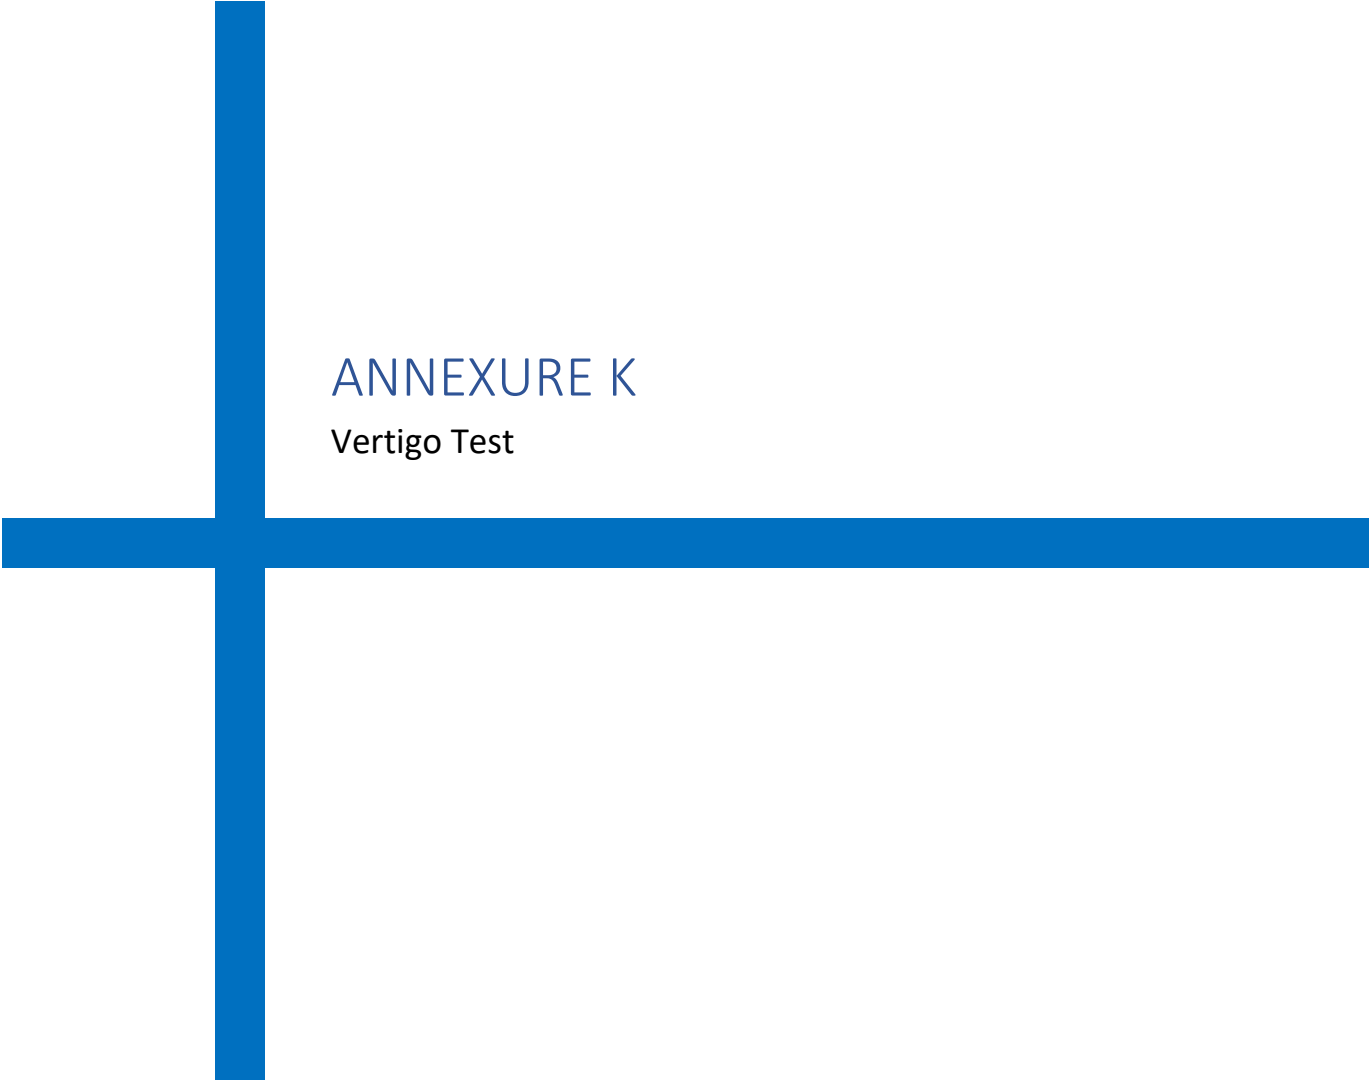

ANNEXURE K

Vertigo Test

Vertigo Test Procedure/ Guidelines

This document specifies minimum requirements for vertigo test. These may be supplemented by any additional requirements deemed fit by the medical examiner/ HSE department)

Fear of height may be physiological or psychological. Therefore, to rule out any possibility of physiological factor, detailed medical check-up of workers is carried out before vertigo test. Medical check-up of workers includes the following:

history of past illnesses (like epilepsy, drug allergy, diabetics/ hypertension, unconsciousness etc.), general physical examination (like height, weight, BMI, build and nourishment etc.), measurement of pulse rate, Blood Pressure, respiratory rate.

After this check-up, those who are found suitable for height work by examining doctor, are allowed to undergo vertigo test.

During this health check-up, psychology of workers is also studied. If any worker finds it extremely difficult/ frightening to climb the monkey ladder & walk on the beam, during/after performing vertigo test or even before performing, then he is treated as disqualified.

As per standard, during vertigo test, worker is allowed to climb on a foundation through monkey ladder, walk on a beam, then steps down at the other end of beam, through monkey ladder. Height of the beam should be at least six feet from ground level. All necessary safety precautions are taken during this test. Worker has to wear full body harness with double lanyard. A horizontal lifeline is run parallel to the beam and worker has to put his lanyards into the lifeline. Additionally, a safety net is also put below the beam for rescue of the victim in case of a fall from beam.

Following activities are suggested to be carried out during testing:

1. Walking Bench Training:

- a. Person should walk over the channel. He should maintain balance & walk without much problem.
- b. If the person has problem to balances himself on repeated chances, he may be having flat foot or some other problem. So, he may not be fit for height work.

2. Rope Climb Training:

Person should be able to climb the rope up to the top channel for ensuring that in case of fall, a person hanging on the safety harness, will be able to safely climb back to the platform within minimum time period before the safety harness start breaking down under the load.

3. Height Work Training:

Person should walk freely on the middle channel while holding the top channel with the help of safety harness.

4. Ladder for Vertical fall arrestor Training:

Vertical fall arrestor rope is fixed from top to bottom of the ladder. It will ensure:

- Usage of vertical fall arrestor.
- Usage of two lanyards of a safety harness.
- Ensure 3-point contact on the ladder while climb.

5. Chair for work at height Training:

- Climb though vertical ladder with two lanyard ropes.
- Hooking of two lanyard ropes to life line. With this safe arrangement, he can walk to chair.
- Sits in the chair safely, comes out & walks back to the vertical ladder & come down from vertical ladder. After completion of vertigo test, blood pressure of worker is again measured. If it is not within acceptable limits for any worker, concerned worker is denied height pass.

Only those who pass the above training are to be considered as fit for height work.



**TITLE: 2X660 MW ENNORE SEZ
SUPERCRITICAL TPP,
UNIT# 1 & 2**

SPECIFICATION NO. PE-TS-412-600-C002

VOLUME - II B

SECTION - C

REV.NO. 0

SHEET OF


TAMILNADU GENERATION AND DISTRIBUTION CORPORATION

ENNORE SEZ SUPERCRITICAL TPP UNITS- 1 & 2 [2 x 660 MW]

VOLUME – II B CIVIL, STRUCTURAL & ARCHITECTURAL WORKS

SPECIFICATION NO. PE-TS-412-600-C002

SECTION – C *SPECIFIC TECHNICAL REQUIRMENTS*



**Bharat Heavy Electricals Limited
Project Engineering Management
PPEI Building, Power Sector,
Plot No. 25, Sector 16A,
Noida (U.P.)-201301**

CONTENT

Sr No	TITLE	PAGE NO:
–	INTRODUCTION	2
1	CODES AND STANDARDS	4
2	SCOPE OF CIVIL & STRUCTURAL WORKS	15
3	INSTRUCTION TO BIDDERS	22
4	SUBMISSION	27
5	GEO-TECHNICAL INVESTIGATION	30
6	GENERAL REQUIREMENT OF BUILDING / STRUCTURES	35
7	MATERIAL	41
8	LOADING	42
9	STEEL STRUCTURE	48
10	REINFORCED CONCRETE STRUCTURES AND FOUNDATIONS	55
11	DESCRIPTION OF BUILDINGS, STRUCTURES AND OTHER FACILITIES	65
12	REINFORCED CONCRETE CHIMNEY	84
13	NATURAL DRAUGHT COOLING TOWER	101
14	COAL HANDLING SYSTEM	115
15	ASH HANDLING SYSTEM	125
16	PLANT WATER PRE-TREATMENT ` AND DM PLANT SYSTEM	127
17	OUT DOOR CIVIL WORKS	130
18	ARCHITECTURE	138



1 GENERAL

1.1 Intent of Specification

Contractor shall read the parts of specification relevant to contract and shall ignore other parts of specification. In case of ambiguity between BOQ, Part C and Part D of specification, the following priority for acceptance of items may be followed:

- a) BOQ
- b) Specific technical specification (Part C)
- c) General technical specification (Part D)

1.00.00 CODES AND STANDARDS

Following is a general listing of Codes and Standards to be used in the design of the Plant. Specific applicable codes and standards will be identified in System Design Descriptions / Technical Specifications as appropriate. The latest editions / revision of following codes and standards along with addendums / amendments, if any, shall be followed:

1.01.00 General

- a) Internationally accepted design Codes and Standards where Indian Codes are not available and which are equivalent to Indian Standards.
- b) National Building Code of India.
- c) "Accepted Standards" and "good Practice" listed in the appendix to National Building Code of India.
- d) IS:1200 : Method of measurement of Building and Civil Engineering Works.
- e) IS:1256 : Code of Practice for Building Byelaws.

1.02.00 Earthwork

- | | | | |
|----|---------|---|--|
| a) | IS-1498 | : | Classification and identification of soils for General Engineering purpose |
| b) | IS-3764 | : | Safety code for excavation work |
| c) | IS:7293 | : | Safety code for working with construction machinery |

1.03.00 Concrete

- | | | | |
|----|---------|---|---|
| a) | IS-269 | : | Ordinary and low heat Portland cement |
| b) | IS-383 | : | Coarse and fine aggregate from natural sources for concrete |
| c) | IS-432 | : | Mild steel and medium tensile steel bars and hard drawn steel wire for concrete reinforcement |
| d) | IS-455 | : | Portland slag cement |
| e) | IS-456 | : | Code of practice for plain and reinforced concrete |
| f) | IS-460 | : | Test Sieves (all parts) |
| g) | IS-516 | : | Methods of test for strength of concrete |
| h) | IS-1199 | : | Methods of sampling and analysis of concrete |

appliances

- dd) IS-775 : Cast iron brackets and supports for wash basins and sinks
- ee) IS-777 : Glazed earthenware wall tiles
- ff) IS-2548 : Plastic water closet seats and covers (all parts)
- gg) IS-2527 : Code of practice for fixing rainwater gutters and down pipes for roof drainage.

1.12.00 Paving & Road Works

- a) IS-73 : Paving bitumen
- b) IS-702 : Industrial bitumen
- c) IS:1201 : Method of testing tar and bituminous materials thru' 1220
- d) IRC-15 : Standard Specification and code of practice for construction of concrete roads.
- e) IRC-58 : Guidelines for the design of plain jointed rigid pavement for highways
- f) IRC-58 : Guidelines on cement fly ash concrete for rigid pavement.

1.13.00 Earthquake Resistant Design

- a) IS-1893 : Criteria for earthquake resistant design of structures
- b) IS-4326 : Code of practice for earthquake resistant design and construction of buildings

1.14.00 Chimney

- a) IS-4998 : Criteria for design of R.C. Chimneys (all parts)

1.15.00 Structural Steel Work

- a) IS-800 : Code of practice for general construction in steel
 - b) IS-802 : Code of practice for use of structural steel in overhead transmission line
- Part-I: Load and permissible stresses



Part-II: Fabrication, galvanizing, inspection and packing.

- | | | | |
|----|------------------------|---|--|
| c) | IS-806 | : | Code of practice for use of steel tubes in general building construction |
| d) | IS-808 | : | Rolled steel beams, channels and angle sections |
| e) | IS-813 | : | Scheme for symbols for welding |
| f) | IS-814 | : | Covered electrodes for manual metal arc welding for carbon and carbon manganese steel |
| g) | IS-816 | : | Code of practice for use of metal arc welding for general construction in mild steel |
| h) | IS-817 | : | Code of practice for training and testing of metal arc welders |
| i) | IS-818 | : | Code of practice for safety and health requirements in electric and gas welding and cutting operation |
| j) | IS-819 | : | Code of practice for resistance spot welding for light assemblies in mild steel |
| k) | IS-919 | : | Recommendations for limits and fits for engineering. |
| l) | IS-1024 | : | Code of practice for use of welding in bridges and structures subjected to dynamic loading |
| m) | IS-1161 | : | Steel tubes for structural purposes |
| n) | IS-1182 | : | Recommended practice for radiographic examination of fusion welded butt joints in steel plates |
| o) | IS-1200
[Part-VIII] | : | Method of measurement of steelwork and iron work |
| p) | IS-1239 | : | Mild steel tubes, tubulars and other wrought steel fittings (all parts) |
| q) | IS-1363 | : | Black hexagonal bolts, nuts and locknuts (dia. 6 to 39 mm) and black hexagon screws (dia. 6 to 24 mm) [all parts]. |
| r) | IS-1364 | : | Precision and semi-precision hexagon bolts, screws, nuts and locknuts (dia. range 6 to 39 mm) [all parts] |
| s) | IS-1365 | : | Slotted counter sunk head screws (dia range 1.6 to 20 mm) |
| t) | IS-1367 | : | Technical supply conditions for threaded steel |



			fasteners
u)	IS-1443	:	Code of practice for laying and finishing of cement concrete flooring tiles.
v)	IS-1608	:	Methods of tensile testing of steel products
w)	IS-1730	:	Dimensions for steel plate, sheet and strip for structural and general engineering purpose
x)	IS-1731	:	Dimensions for steel flats for structural and general engineering purposes
y)	IS-1852	:	Rolling and cutting tolerances for hot rolled steel products
z)	IS-1977	:	Structural steel (ordinary quality)
aa)	IS-2016	:	Plain washers
bb)	IS-2062	:	Steel for general structural purposes
cc)	IS-2074	:	Ready mixed paint, air drying, red oxide zinc-chrome, priming
dd)	IS-2633	:	Methods of testing uniformity of coating of zinc coated articles.
ee)	IS-3613	:	Acceptance test for wire-flux combinations for submerged arc welding of structural steel
ff)	IS-3664	:	Code of practice for ultrasonic pulse echo testing by contact and immersions methods
gg)	IS-3757	:	High strength structural bolts
hh)	IS-4000	:	High strength bolts in steel structures
ii)	IS-4759	:	Hot dip zinc coatings on structural steel and other allied products
jj)	IS-5334	:	Code of practice for magnetic particle flaw detection of welds
kk)	IS-7215	:	Tolerances for fabrication of steel structures
ll)	IS-7280	:	Base-wire electrodes for submerged arc welding of structural steel
mm)	IS-7318 [Part-I]	:	Approval test for welders when welding procedure approval is not required.



- nn) IS-8500 : Structural steel – micro-alloyed (medium and high strength qualities)
- oo) IS-9595 : Recommendation for metal arc welding of carbon and carbon manganese steel
- pp) AWS D.1.1 : Structural welding code.

1.16.00**Painting**

- a) IS-348 : Specification for French polish
- b) IS-427 : Specification for distemper, dry colour as required
- c) IS-428 : Specification for distemper, oil emulsion, colour as required
- d) IS-1477 (I & II) : Code of practice for painting of ferrous metal in buildings
- e) IS-2338 (I & II) : Code of practice for finishing of wood and wood based materials
- f) IS-2339 : Specification for Aluminium Paints for general purposes in dual containers
- g) IS-2395 : Code of practice for painting concrete, masonry and plaster surface
- h) IS-2932 : Specification for enamel, synthetic, exterior - (a) undercoating , (b) finishing
- i) IS-2933 : Specification for enamel, exterior – (a) undercoating, (b) finishing.
- j) IS-5410 : Specification for cement paint.

1.17.00

- a) Indian Road Congress (IRC) Bridge codes
- b) Indian Railways Standard Bridge Rules

1.18.00**Environmental Protection**

Charter on Corporate Responsibility for Environmental Protection (CREP) published in Gazette of India dated 27.08.2003.

1.19.00

Rules & Regulation of Local Authorities

1.20.00

Statutory Regulations of Tariff Regulation Commission (TAC)



7.00.00 MATERIAL**7.01.00 Structural Steel**

Steel will conform to Grade-A of IS:2062 (latest) for rolled steel members or plates upto 20 mm thickness. For plates above 20 mm thickness and welded construction steel conforming to Grade-B (killed and normalized) of IS: 2062(latest) shall be used except for crane girders where Grade-C (IS: 2062) steel shall be used. Steel shall be procured from SAIL or any other approved main producers.

Chequered plate shall conform to IS: 3502 (latest) and minimum thickness of chequered plate for floorings, covers etc shall be 8 mm O/P.

Bottom 1.0 M of cylindrical portion and entire conical portion of bunker in mill building shall be provided with lining of atleast 6mm thik SS plate grade SS 316L.

The electrodes classification as per AWS shall be as follows:-

- a) For welding of stainless steel to stainless steel : E308L
- b) For welding of stainless steel to mild steel : E309

7.02.00 Cement

Ordinary Portland Cement (OPC) shall be used for all structures except for foundations, under ground structures & structures coming in contact with sea water where in sulphate resistant cement with C3A content limited to 5% to 8% shall be used. Grade of cement shall be 43 conforming to IS: 8113.

7.03.00 Reinforcement

The reinforcement used shall be cold worked steel high strength deformed bars of grade Fe 415 / Fe 500 conforming to IS:1786 – latest.

Fusion bonded epoxy coated reinforcement steel with coating conforming to IS:13620 shall be used for the complete project.

Intermixing of different grades of rebars or rebars of different material composition in same structure shall not be allowed.

Welding of reinforcement shall not be carried out without the permission of the Owner.

Projecting reinforcement or dowel bars for future connection of the structural works shall be protected by cement paint, if they are to be left exposed for a long time.



9.00.00 STEEL STRUCTURE**9.01.00 Framing**

All steel framed structures shall be either “rigid frame” or “simple space frame” or a combination of two.

Lateral forces shall be resisted by stiff jointed moment connections in rigid frame design. The column bases shall generally be fixed to concrete foundation pedestal by providing moment resistant base detail.

The power house building design shall be a combination of rigid frame in transverse direction and simple frame in longitudinal direction.

If RCC floor / roof is assumed to act as diaphragm transmitting lateral loads to braced bays, it shall be provided with shear connectors. However, whenever large / more number of cut-outs are provided in the floor slab, horizontal floor bracings shall be provided below slab to transfer horizontal force to columns without considering diaphragm action from slab.

Floors for vibrating machines of all kind together with supporting framework shall be adequately braced in both horizontal and vertical planes. Floors or structure supporting mechanical equipment shall be designed to minimise vibration, avoid resonance and maintain alignment and level.

9.02.00 Design Concepts

Individual members of the frame shall be designed for the worst combination of forces such as bending moment, axial force, shear force, torsion, etc. Criticality of erection / maintenance loads shall also be checked separately in combination with other simultaneously occurring loads for possible design loadings.

The different load combinations shall be taken as per IS:875 (Part-5) and other relevant IS Codes.

- a. Wind and seismic forces shall not be considered to act simultaneously.
- b. For the design of main plant structures during seismic condition, the deaerator feed water tank shall be considered full upto operating level. However, for other load combinations, deaerator feed water tank in flooded condition shall also be considered.
- c. In the analysis of main plant building & bunker building, the stresses arising due to temperature shall be considered.
- d. ‘Lifted load’ of crane shall not be considered during seismic condition.
- e. In case two cranes are provided and tandem operation is not envisaged, the load shall be taken as one crane fully loaded and second crane without lifted load but standing idle adjacent to first crane.



- f. In case two cranes are provided and tandem operation is envisaged for some bays, then the load shall be taken as both the cranes fully loaded and standing side for these bays. For other bays, load shall be taken as one crane fully loaded and second crane without lifted load but standing idle adjacent to first crane.
- g. Permissible stresses for different load combinations shall be taken as per relevant IS codes.
- h. For the design of pipe / cable supporting structure, the soil weight shall be considered as backfilled upto grade level for the condition of pipe running full / cables in position.
- i. Frictional force between the pipes and supporting structure in longitudinal direction need not be considered along with seismic or wind forces.

The design of steel structures shall be done by working stress method. Design shall be as per provision of IS:800 (latest) and other relevant IS standards. For design of coal bins and loading hopper IS:9178 (Part I to III) shall be followed.

Roof decking sheets shall be designed as per IS:801 to carry the self load, dead load due to RCC slab and finishes and imposed load. The deflection of metal deck shall be limited as per BS:5950. In case composite action is considered in the design, suitable shear studs shall be provided as per BS: 5950.

Permissible stresses for different members shall be allowed to exceed upto 33.33% only under normal loads along with wind and seismic conditions. The members which are designed primarily to resist wind load such as bracing members, no increase in permissible stress will be permitted. However, permissible stresses in bolts and welds shall be allowed to exceed up to 25 % only under wind and seismic conditions.

For design which requires the use of the minimum column load (such as, uplift on anchor bolts, column axial tension, etc.) the following criteria shall be used in determining minimum load: Use 90% of the column dead load, No live load is used, Uplift forces from vertical bracing are included where applicable and Wind uplift on the roof is included where applicable.

Base plates shall be placed on foundation pedestal with grouting. For large base plates necessary grout holes shall be provided. All anchor bolts for fastening steel columns on foundation shall be embedded in foundation during concreting itself. No anchor pockets in foundation shall be allowed. Design of base plates shall be based on design pressure on foundation which shall not exceed the following:

Pedestal in concrete grade M20	5.0 N / sq.mm
Pedestal in concrete grade M25	6.25 N / sq.mm
Pedestal in concrete grade M30	7.5 N / sq.mm

The total horizontal shear force at the base of column is transferred to the column pedestals through friction between the base plate and the grout. A coefficient of



friction of 0.30 shall be used in conjunction with the minimum column load as defined above. If the horizontal shear force exceeds the frictional resistance force or if the column is subjected to a net uplift load, the total force shall then be transmitted through shear bars / shear keys welded to the base plate. Anchor bolts are not assumed to resist any horizontal shear force. Necessary recesses shall be kept in the foundation concrete for shear lugs.

Welding shall be used for fabrication and erection. Site connections shall generally be with welding. However, high Strength Structural (HSS) bolts shall be used for all important connections to be decided during detail engineering stage. In few cases, for shear connections or removable beam connections, bolted joints with MS bolts may be adopted. For HSS bolt connection, IS:4000, IS:3757, IS:6623 and IS:6649 shall be followed. IS:814, IS:816, IS:1024, IS:4353 and IS:9595 shall be followed for welding of structures.

Trestles supporting coal conveyor galleries shall be so proportioned that the transverse deflection of trestles due to wind / seismic load shall not exceed trestle height / 1000 as stipulated in IS:11592.

In the case of galleries, temperature expansion joint shall be introduced at intervals less than 90 m to divide the galleries into temperature block. In each block at least one number four legged rigid support guaranteeing stability of structure in the longitudinal direction shall be provided. This shall also take care of all longitudinal forces in the given block. Effect of wind load acting on 2-legged trestle shall also be considered while designing the 4-legged trestle.

Base plates for trestles shall be designed as gusseted bases with shear lugs to transfer horizontal forces. Anchor bolts shall be designed only for uplift forces.

Anchor fasteners shall not be used for supporting equipment imparting dynamic forces.

Pedestals supporting gravity take-up shall be designed to resist 100% impact.

For calculation of coal load on moving conveyor, a multiplication factor of 1.6 shall be used to take care of inertia force.

- a) Conveyor gallery structure & trestles shall be designed considering both conveyors operating simultaneously.
 1. Dynamic analysis of conveyor galleries and conveyor supporting system shall be carried out for spans greater than 25m.
 2. All structures close to railway line shall have clearances conforming to Railway norms.

Transverse coal pressure on Bunker/ Silo / Hopper walls shall be calculated using Walker's theory and IS:9178. The Coal Bunker / Silo / Hopper shall be designed for the following conditions.



- i) The Bunker / Silo / Hopper is full up to its full capacity with top surface nearly horizontal.
- ii) The Bunker / Silo / Hopper is partially empty with the top surface of coal at an angle of repose of 37 degrees.

Design pressure on coal bunker / hopper walls shall take into account all possible flow regimes (core flow, mass flow, etc.), and different aeration regimes (radial, diametrical, radial and core, impulsive etc.)

9.03.00 Permissible Deflections

The permissible deflections of various steel members under normal loading conditions shall be as specified below. For calculation of deflections in structures and individual members dynamic effects shall not be considered, unless specified otherwise. Also, no increase in deflection limits shall be allowed when wind or seismic load are acting concurrent with normal loading conditions.

9.04.00 Vertical Deflection

- 9.04.01**
- a) For beams supporting dynamic equipment : Span / 500
 - b) For beams supporting floors / masonry : Span / 325
 - c) For beams supporting pipes : Span / 400
 - d) For roofing and cladding components : Span / 325
 - e) For gratings and chequered plates : Span / 200 subject to a maximum of 6 mm
 - f) Coal/ Ash conveyor gallery bridges : Span / 450

9.04.02 For crane gantries or any member subjected to working loads, the maximum deflection under dead load and live load excluding impact shall not exceed the following values:

- a) For manually operated cranes & monorails : Span / 500
- b) For electric overhead cranes
 - i) Up to 50 t capacity : Span / 750
 - ii) Over 50 t capacity : Span / 1000

9.05.00 Horizontal deflections

The permissible horizontal deflections shall be as per following unless specified otherwise:

- a) Single storey building (without crane load) : Height / 325
- b) Multistoried building (without crane load) : Height / 500



c)	Pipe rack columns	:	Height / 200
d)	Crane gantry girder due to surge	:	Height/200
e)	Building main columns at crane rail level due to action of crane surge load only	:	Height / 2500 limited to maximum of 10 mm
f)	Open gantry columns at crane rail level due to action of crane surge load only	:	Height/4000 limited to maximum of 10 mm
g)	Open structures	:	Span / 2000 Limited to Maximum of 15mm
h)	Coal handling trestles	:	Height / 1000

9.06.00 Provisions of IS: 800 and relevant IS Code shall be followed for limiting deflections of structural elements not listed above.

9.07.00 MINIMUM THICKNESS OF STRUCTURAL STEEL ELEMENTS

The minimum thickness of various components of a structure and hot rolled sections shall be as follows. The minimum thickness of rolled shapes shall mean flange thickness regardless of web thickness. Structural steel members exposed to significantly corrosive environment shall be increased suitably in thickness or suitably protected otherwise as per good practice and sound engineering judgement in each instance.

a)	Trusses, purlins, girts and bracing	6mm
b)	Columns and beams	8mm
c)	Gussets	8mm
d)	Stiffeners	8mm
e)	Base plates	10mm & above
e)	Chequered plates	8 mm o/p & above
f)	Grating flats	5 mm

Minimum thickness of structural members other than gratings directly exposed to weather and inaccessible for painting and maintenance shall be 8 mm.

9.08.00 Minimum Sizes

The flange width of purlins supporting light weight concrete slab shall not be less than 65 mm and for those supporting roof sheeting and wall cladding it shall not be less than 50 mm. Width of steel rolled section connected to other member shall be at least 50 mm. The depth of beams for platform of all structures shall not be less than 125 mm.



9.09.00**Slenderness and Depth Ratio**

The slenderness ratio of main members in tension, compression or bending shall be in accordance with IS:800.

The following limiting ratios of depth to span shall be considered as a general guide.

- | | |
|--|--------|
| a) Truss | 1 / 10 |
| b) Rolled beams and girders for ordinary floors and rafters | 1 / 24 |
| c) Supporting floor beams for vibrating machinery /equipment | 1 / 15 |
| d) Roof purlins and girts | 1 / 45 |
| e) Gable columns | 1 / 30 |

9.10.00**Joints / Connections in Steel Structures:****9.10.01**

Steel structures shall be detailed and connection and joints provided as per the provisions of IS:800, IS:9595, IS:1367, IS:9178 and IS:816 and as per following requirements:

- a. Connection of vertical bracings with connection members and diagonals of truss members shall be designed for full tensile capacity of the bracings unless actual loads are indicated on the drawings.
- b. Size of fillet weld for flange to web connection for built up section shall be as follows:
 - i) For box section weld size shall be designed for 60% of full shear capacity or actual shear whichever is more. Where fillet weld is not possible, full penetration but weld shall be provided.
 - ii) For built-up I section, weld size shall be designed for 80% of full shear capacity or actual shear, (if indicated in drawings) whichever is more. However, weld size shall not be less 0.5 times the web thickness. Weld shall be double fillet.
 - iii) All welds shall be continuous unless otherwise specifically approved. The minimum size of the fillet weld shall be 6 mm.
- c. Shear connections shall be designed for 70% of section strength for rolled sections and 80% of section strength of built-up section or rolled section with cover plates. However, if actual shear load is more than above, the connection shall be designed for actual load.
- d. Moment connection between beam and column shall be designed for 100% of moment capacity of the beam section. This can be achieved either by direct butt welding of the top flange of beam with column flange or by providing top moment plate with suitable notch for additional weld length.
- e. All bolts and nuts shall have property class compatible to each other. For bolts carrying dynamic or fluctuating loads and those in direct tension



shall be provided with an additional double coil helical spring washer conforming to IS:6755. The threaded portion of the bolt shall project through the nut at least by one thread.

- f) Where a steel beam or member is to be connected on RCC structure, it shall be connected using an insert plate and preferably through shear connection.
- g) All butt welds shall be full penetration butt welds.
- h) The connection between top flange and web of crane girder shall be full penetration butt weld. Bottom flange, connection with web can be fillet weld or butt weld as directed by Purchaser. Bearing edges of crane girders shall be machine finished.
- i) Connection of base plate and associated stiffeners with the columns shall be designed considering the total load transferred through welds. However, minimum weld size (double fillet) shall not be less than 0.6 times the thickness of stiffeners.
- j) Splicing: All work shall be full strength. Field splicing shall be done with web and flange cover plates for full strength. In exceptional cases, the field splicing shall be designed for 50% of load carried by the cover plates and remaining 50% load through full penetration butt weld. Shop splicing for all sections other than rolled shall be carried out by full penetration butt welds with no cover plates. Splicing for all rolled sections shall be carried out using web and flange cover plates.

9.10.02 All bolted connections shall have bolts of minimum 16 mm dia. The connections of stairs and hand railing shall be made with 20 mm diameter threaded fasteners conforming to IS:1363. Erection bolts shall be black bolts of minimum 12 mm dia.

9.10.03 Efficiency of site welds to be considered shall be as follows:

- a) Butt weld above 25 m from ground --- 50%
- b) Others --- 80%

9.11.00 Specification for Painting of Steel Structures / Material

Refer Volume-VI, Part-B



23.00.00 FABRICATION OF STRUCTURAL STEEL WORK

23.01.00 The details of fabrication, shop testing, painting and delivery to site of structural steel work including supply of all consumable stores, bolts, nuts, washers, electrodes and other materials as required including field connections are indicated below to be performed by the contractor:

- a) Preparation & submission of complete detailed fabrication drawings and erection marking drawings as required including design calculations.
- b) Furnish all materials, labour, tools & plant and all consumables required for fabrication and supply of all necessary bolts, nuts, washers, tie rods and welding electrodes for field connections.
- c) Furnish shop painting of all fabricated steelwork as specified.
- d) Suitably mark, bundle and pack for transport all fabricated materials.
- e) Prepare and furnish detailed bill of materials, dispatch lists (including bought out items) as required for fabrication of structural steelwork.
- f) Load and transport all fabricated steelwork to site with field connection materials.
- g) Maintain a fully equipped fabrication shop at site for modification and repairs as required.

No work under this specification will be provided by any agency other than the contractor, unless specifically mentioned otherwise elsewhere in the contract.

23.02.00 Codes and standards

The work should conform to the requirements of the following latest relevant Indian standard specifications and codes of practice:

- | | | |
|----------|---|--|
| IS : 800 | - | Code of practice for general construction in steel. |
| IS : 80 | - | Code of practice for use of cold formed light gauge steel structural members in general building construction. |
| IS : 806 | - | Code of practice for use of steel tubes in general building construction. |
| IS : 808 | - | Dimensions for rolled steel beams, channels and angle sections. |



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 5 3



IS : 813	-	Scheme of symbols for welding.
IS : 814	-	Covered electrodes for metal arc welding of carbon and carbon manganese steel.
IS : 815	-	Classification coding of covered electrodes for metal arc welding of mild steel and low alloy high tensile steel.
IS : 816	-	Code of practice for use of metal arc welding for general construction in mild steel.
IS: 228	-	Method of chemical analysis of pig Iron, cast Iron & plain carbon and low alloy steel
IS: 817	-	Code of practice for use of Structural steel in General building construction.
IS: 818	-	Code of practice for use of metal arc welding for general construction in mild steel.
IS: 819	-	Code of practice of resistance spot welding for light assemblies in mild steel.
IS:823	-	Code of practice for manual metal arc welding for mild steel.
IS: 919	-	Recommendations for limits and fits for engineering.
IS 1161	-	Specifications for steel tubes for structural purposes.
IS1181	-	Qualifying test for metal arc welders
IS1599	-	Method of bend tests for steel products other than sheet strip wire & tube.
IS 1731	-	Dimension for steel flats for structural & general engineering purposes.
IS 7205	-	Safety code for erection steel work.
IS2595	-	Code of practice for radiographic testing.
IS : 822	-	Code of practice for inspection of welds.
IS : 1182	-	Recommended practice for Radiographic Examination of fusion welded butt joints in steel plates.
IS : 1200 (Part - 8)	-	Method of measurement of steel work and iron work.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 5 4



IS : 1363 (Part - 1 to 3)	-	Hexagon head bolts, screws & nuts of product grade C.
IS : 1364 (Part - 1 to 5)	-	Hexagon head bolts, screws and nuts of product grade A&B.
IS : 1367 (Part - 1 to 18)	-	Technical supply conditions for threaded steel fasteners.
IS : 1608	-	Method for tensile testing of steel products.
IS : 1730	-	Dimensions for steel plate, sheet and strip for structural and general engineering purposes.
IS : 1852	-	Rolling and cutting tolerances for hot-rolled steel product.
IS : 1977	-	Structural steel (Ordinary quality)
IS : 2016	-	Plain washer
IS : 2062	-	Steel for general structural purposes.
IS : 3644 and	-	Code of practice for ultrasonic pulse echo testing by contact immersion method.
IS : 3757	-	High Strength Structural Bolt
IS : 4000	-	High strength bolts in steel structure
IS : 5369	-	General requirements for plain washers and lock washer.
IS : 6005	-	Code of practice for phosphating of iron and steel.
IS : 6649	-	Specification for hardened and tempered washers for high strength structural bolts and nuts.
IS : 6623	-	Specification for high strength structural nuts.
IS : 7215	-	Tolerances for fabrication of steel structures.
IS : 7280	-	Bare wire electrode for submerged arc welding
IS : 8500	-	Structural steel micro alloyed (medium & high strength quality).



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 5 5



IS : 8629	-	Code of practice for protection of iron steel & structures (Part - I to III) from atmospheric corrosion.
IS : 9595	-	Recommendation for metal arc welding of carbon manganese steels.
IS : 117	-	Specification for ready mixed paint, brushing, finishing, exterior, semi-gloss, for general purposes.
IS : 128	-	Specification for ready mixed paint, brushing, finishing, semi-gloss for general purposes, black.
IS : 1477	-	Code of practice for painting of ferrous metal in building (Part - I & II).
IS : 2074	-	Ready mixed paint, air-drying red-oxide zinc chrome priming.
IS : 2339	-	Specification for aluminum paints for general purposes in dual container.
IS : 2932	-	Specification for enamel, synthetic exterior type - I.
IS : 2933	-	Specification for enamel, synthetic exterior type - II.
BS 4465	-	Specification for water cooling towers.
ACI	-	Reinforced concrete cooling towers shall – practice & Commendatory

23.03.00 Conformity with designs

The contractor shall design all connections, supply and fabricate all steelwork and furnish all connection materials in accordance with the approved drawings. The method of painting, marking, packing and delivery of all fabricated materials shall be as approved by the Engineer.

23.04.00 Materials to be used

Standard structural steel sections shall be used instead of fabricated steel sections as far as possible.

- a) All steel materials required for the work shall be supplied by the contractor.
All steel materials shall comply with the following IS:-
- i) IS:801 - Cold formed light gauge steel structural member.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 5 6



- ii) IS:2062 - Grade – A, Structural Steel for plate thickness upto 20mm
- iii) IS:2062 - Grade – B (Killed), Structural Steel for plate thickness above 20mm
- iv) IS:2062 - Grade – C, for crane gantry girder in turbine hall.
- v) IS:806 - Steel tubes in general building construction.

b) Electrodes

The arc welding electrodes shall conform to the relevant IS; and shall be of heavily coated type having uniform thickness. With each container of electrodes, the manufacturer shall furnish instructions giving recommended voltage and amperage (polarity in case of D.C. supply) for which the electrodes are suitable. All electrodes shall comply with the following IS:

- i) IS: 814 - Covered electrodes for metal arc welding structural steel.
- ii) IS:815 - Classification and coding of covered electrodes for metal arc welding of mild steel and low alloy high tensile steel.
- iii) IS:7280 - Base wire electrode for submerged arc welding.

c) Bolts and nuts

All bolts and nuts shall conform to the requirements of IS:1367 - Technical Supply Conditions for Threaded Fasteners. Materials for bolts and nuts shall comply with the following IS codes. Mild steel for bolts and nuts tested to following IS shall have a tensile strength of not less than 44 Kg/mm²; and minimum elongation of 23 per cent on a gauge length of 5.6 ÖA, where 'A' is the cross sectional area of the test specimen :

- i) IS:1367 - Technical supply conditions for threaded fasteners.
- ii) IS:1608 - Method for tensile testing of steel other than sheet, strip, wire and tube.
- iii) High tensile steel material shall have the mechanical properties as per IS:1367 or as approved by the Engineer.



d Washers

Washers shall be made of steel conforming to the following IS:

- i) IS:1977 - Structural steel (Ordinary Quality) St-39-0
- ii) IS:2062 - Steel for general structural purpose
- iii) IS:6623 - High Strength Structural Nuts
- iv) IS:6649 - Hardened and tempered washers for high strength structural bolts & nuts.

Paints for shop coat of fabricated steel shall be of epoxy based paint to withstand severe corrosive conditions prevailing at site.

23.05.00 Painting

- a) All steel structures shall receive two primer coats and two finish coats of painting. First coat of primer shall be given in shop after fabrication before dispatch to erection site after surface preparation as described below. The second coat of primer shall be applied after erection and final alignment of the erected structures. Two finish coats shall also be applied after erection.
- b) Steel surface which is to painted shall be cleaned of dust and grease and the heavier layers of rust shall be removed by chipping prior to actual surface preparation. The surface shall be abrasive blasted to Sa-2½ finish as per SIS05-5900. Primer paint shall be zinc silicate of approved brand . Dry film thickness of each primer coat shall be 50 microns.
- c) Finish paint shall be 2 coats of High built epoxy finish of approved brand. Dry film thickness of each finish coat shall be 90 microns. The undercoat and finish coat shall be of different tint to distinguish the same from finish paint. The total dry film thickness shall be 300 microns . All paints shall be of approved brand and shade as per the OWNER's requirement.
- d) Joints to be site welded shall have no paint applied within 100 mm of welding zone.

Similarly where Friction grip fasteners are to be used no painting shall be provided. On completion of the joint the surfaces shall receive the paint as specified.
- e) Surfaces inaccessible after assembly shall receive two coats of primer prior to assembly.



Surfaces inaccessible after erection including top surfaces of floor beams supporting gratings or chequered plate shall receive one additional coat of finish paint over and above number of coats specified before erection. Portion of steel member embedded / to be encased in concrete shall not be painted.

23.06.00 Storage of Materials

- a) All materials shall be stored to prevent deterioration ensuring the preservation of their quality and fitness for the work. Any material which has deteriorated or has been damaged shall be removed from the contractor's yard immediately. The contractor shall maintain upto date account in respect of receipt, use and balance of all sizes and sections of steel and other materials. In case the fabrication is carried out in contractor's fabrication shop outside the plant site where other fabrication works are also carried out, all materials shall be stacked separately with easily identifiable marks.
- b) The steel used for fabrication shall be stored in separate stacks off the ground section-wise and lengthwise so that they can be easily inspected, measured and accounted for at any time. If required by the Engineer, the materials should be stored under cover; and suitably painted for protection against weather.
- c) The electrodes for electric arc welding shall be stored in properly designed racks, separating different types of electrodes in distinctly marked compartments. The electrodes shall be kept in a dry and warm condition [if necessary by resorting to heating].
- d) Bolts, nuts, washers and other fastening materials shall be stored on racks off the ground with a coating of suitable protective oil. These shall be stored in separate gunny bags or compartments according to diameter, length and quality.
- e) Paints shall be stored under cover in airtight containers. Paints supplied in sealed containers shall be used up as soon as possible once the container is opened.

23.07.00 Quality Control

23.07.01 The contractor shall establish and maintain quality control procedures for different items of work and materials to ensure that all works are performed as per specification. As far as possible, all inspections by the Engineer shall be made at the contractor's fabrication shop. The contractor shall co-operate with the Engineer in permitting access for inspection to all places where work is being done and in providing free of cost all necessary help in respect of tools & plant, instrument, labour and materials required to carry out the inspection. The inspection shall be so scheduled as to provide the minimum interruption to the work of the contractor.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 5 9



Materials or workmanship not in reasonable conformance with the provisions of this specification would be rejected at any time during the progress of the work. The quality control procedure shall cover but not be limited to the following items of work:

- i) Steel : Quality, manufacturer's test certificates, test reports of representative samples of materials from unidentified stocks if permitted to be used.
- ii) Bolts, Nuts : Manufacturer's certificate, dimension & washers checks, material testing.
- iii) Electrodes : Manufacturer's certificate, thickness and quality of flux coating.
- iv) Welders : Qualifying tests
- v) Welding sets : Performance tests
- vi) Welds : Inspection, X-ray, Ultrasonic tests
- vii) Paints : Manufacturer's certificate, physical Inspection Reports.

23.07.02

- a) The dimensions, forms, weights and tolerances of all rolled shapes, bolts, nuts, studs, washers etc. and other members used in the fabrication shall, wherever applicable, conform to the requirements of the latest relevant IS.

b) **Fabrication Drawing**

The sequence of submission of fabrication drawings for approval shall match with the approved fabrication and erection schedule. It should be ensured that the correctness of general arrangement for centerline dimensions and levels, section sizes, and adequacy of connections including splice joints as to the number of bolts, weld length, size of gusset/end plates are maintained. The approval of the drawing however shall not relieve the contractor of his sole responsibility in carrying out the work correctly and fulfilling the complete requirements of spec.

The fabrication drawings shall include but not be limited to the following:

- i) Assembly drawings giving exact sizes of the sections to be used and identification marks of the various sections.
- ii) Dimensional drawings of base plates, foundation bolt location etc.
- iii) Details of all connections with supporting calculations.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 6 0



- iv) Any other drawings or calculations that may be required for the clarification of the works.

The fabrication drawings shall give all the necessary information for the fabrication, erection and painting of the steelwork in accordance with the provisions of this specification. Fabrication drawings shall be made in accordance with the best modern practice and with due regard to sequence, speed and economy in fabrication and erection. Fabrication drawings shall give complete information necessary for fabrication of various components of the steelwork, including the location, type, size and extent of welds. These shall also clearly distinguish between fabrication and field bolts and welds and specify the class of bolts and nuts. The drawings shall be drawn to a scale large enough to convey all the necessary information adequately. Notes on the fabrication drawings shall indicate those joints or groups of joints in which it is particularly important that the welding sequence; and technique of welding shall be carefully controlled to minimize the locked-up stresses and distortion. Welding symbols used shall be in accordance with the requirements of IS:813; and shall be consistent throughout. Weld lengths called for on the drawings shall mean the net effective length.

All steel structural wall beam/columns shall be encased with nominal reinforcement and chicken wire mesh fouling / connecting in brick masonry works. Also, chicken wire mesh shall be provided at the junction of RCC and brick work. The wall beam/tie beam shall be provided at every 2.5 meter height of the brick wall.

All columns shall be encased with RCC upto the height of 500 mm above zero level of STG power house building.

23.08.00 Workmanship

- a) All workmanship shall be equal to the best practice in modern structural shops, and shall conform to the provisions of IS:800 and other relevant Indian standards or equivalent.
- b) Rolled materials before being laid off or worked, must be clean, free from sharp kinks, bends or twists and straight within the tolerances allowed by IS:1852. If straightening is necessary, it shall be done by mechanical means or by the application of a limited amount of localized heat. The temperature of heated areas, as measured by approved methods, shall not exceed 600 Deg. C.
- c) Cutting shall be effected by shearing, cropping or sawing. Use of a mechanically controlled gas cutting torch is permitted for mild steel only. Gas cutting of high tensile steel is permitted provided special care is taken to leave sufficient metal to be removed by machining, so that all metal that has been hardened by flame is removed. Gas cutting without a mechanically



controlled torch shall be permitted if special care is taken and done under expert hand.

To determine the effective size of members cut by gas, 3 mm shall be deducted from each cut edge. Gas cut edges, subjected to substantial stress or which have weld metal deposited on them, shall be reasonably free from gouges. Occasional notches or gouges not more than 4 mm deep will be permitted. Gouges greater than 4 mm, that remain from cutting, shall be removed by grinding. All re-entrant corners shall be shaped notch-free to a radius of at least 12 mm. Shearing, cropping and gas cutting shall be clean, reasonably square and free from any distortion.

- d) Finishing of sheared or cropped edges of plates or shapes of edges gas-cut with mechanically controlled torch shall not be required, unless specifically required by design and called for on the drawings, included in a stipulation for edge preparation for welding or as may be required after the inspection of the cut surface. Surface cut with hand-flame shall generally be ground, unless specifically instructed.
- e) The erection clearance for cleated ends of members connecting steel to steel shall preferably be not greater than 2 mm at each end. The erection clearance at ends of beams without web cleats shall be not more than 3 mm at each end, but where, for practical reasons, greater clearance is necessary, suitably designed cleatings shall be provided.
- f) **Bolted construction:**
 - i) Holes through more than one thickness of material for members, such as compound stanchions and girder flanges, shall be drilled after the members are assembled and tightly clamped or bolted together. Punching shall be permitted before assembly, if the thickness of the material is not greater than the nominal diameter of bolt plus 3 mm subject to a maximum thickness of 16 mm provided that the holes are punched 3 mm less in diameter than the required size; and reamed after assembly to the full diameter.

Holes for black bolts shall be not more than 1.5 mm or 2 mm (depending on whether the diameter of the bolt is less or more than or equal to 25 mm) larger in diameter than the nominal diameter of the black bolt passing through them.

Holes for turned and fitted bolts shall be drilled to a diameter equal to the nominal diameter of the shank or barrel subject to a tolerance grade of H8 to IS:919. Parts to be connected shall be firmly held together by tacking welds or clamps and the holes drilled through all thicknesses in one operation and subsequently reamed to size. Holes not drilled through all thicknesses in one operation shall be drilled to a smaller size and reamed out after assembly. Holes for bolts shall not be formed by gas cutting process.



- ii) Drifting to enlarge unmatched holes shall not generally be permitted. In case drifting is permitted to a slight extent during assembly, it shall not distort the metal or enlarge the holes. Holes to be enlarged to admit the bolts shall be reamed. Poor matching of holes shall be cause for rejection. The component parts shall be so assembled that they are neither twisted nor otherwise damaged, and shall be so prepared that the specified cambers, if any, are maintained.

Bolted construction shall be permitted only in case of field connections if called for on the drawings and is subjected to the limitation of particular connection as may be specified.

Washers shall be tapered or otherwise suitably shaped, where necessary, to give the heads and nuts of bolts a satisfactory bearing. The threaded portion of each bolt shall project out through the nut at least one thread. In all cases, the bolt shall be provided with a washer of sufficient thickness under the nut to avoid any threaded portion of the bolt being within the thickness of the parts bolted together. In addition to the normal washer, one spring washer or lock-nut shall be provided for each bolt for connections subjected to vibrating forces or otherwise as indicated on the drawings.

g) Welded Construction

- i) Welding shall be in accordance with relevant IS. Welding shall be done by experienced and good welders qualified by tests in accordance with IS:817. Surfaces to be welded shall be free from loose scale, slag, rust, grease, paint and any other foreign material except that mill scale which withstands vigorous wire brushing may remain. Joint surfaces shall be free from fins and tears. Preparation of edges by gas-cutting shall, wherever practicable, be done by a mechanically guided torch.
- ii) Parts to be fillet welded shall be brought in as close contact as practicable and in no event shall be separated by more than 4 mm. If the separation is 1.5 mm or greater, the size of the fillet welds shall be increased by the amount of the separation. The fit of joints at contact surfaces which are not completely sealed by welds, shall be close enough to exclude water after painting. Abutting parts to be butt-welded shall be carefully aligned. Misalignments greater than 3 mm shall be corrected; and in making the correction, the parts shall not be drawn into a sharper slope than two degrees (2 Deg.). The work shall be positioned for flat welding whenever practicable.
- iii) In assembling and joining parts of a structure or of built-up members, the procedure and sequence of welding shall be such as will avoid needless distortion and minimize shrinkage stresses. Where it is impossible to avoid high residual stresses in the closing welds of a rigid assembly, such closing welds shall be made in compression elements.

In the fabrication of cover-plated beams and built-up members, all shop splices in each component part shall be made before such component part is



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 6 3



welded to other parts of the member. Long girders or girder sections shall be made by shop splicing not more than 3 sub-sections, each made in accordance with this paragraph. Welded assemblies shall be stress relieved by heat treating in accordance with the provisions of the relevant IS.

- iv) All complete penetration groove welds made by manual welding, except when produced with the aid of backing material not more than 8 mm thick with root opening not less than one-half the thickness of the thinner part joined, shall have the root of the initial layer gouged out on the back side before welding is started from that side, and shall be so welded as to secure sound metal and complete fusion throughout the entire cross-section. Groove welds made with the use of the backing of the same material as the base metal shall have the weld metal thoroughly fused with the backing material. Backing strips need not be removed. If required, they may be removed by gouging or gas cutting after welding is completed, provided no injury is done to the base metal and weld metal and the weld metal surface is left flush or slightly convex with full throat thickness.

Groove welds shall be terminated at the ends of joint in a manner ensuring soundness. Where possible, this should be done by use of extension bars or run-off plates which need not be removed upon weld completion. To get the best and consistent quality of welding, automatic submerged arc process shall be preferred. The technique of welding employed, the appearance and quality of welds made, and the methods of correcting defective work shall conform to the welds made, and the methods of correcting defective work shall conform to the relevant IS.

- v) If welding is to be undertaken at low temperature, adequate precautions as recommended in relevant IS shall be taken. When the parent material is more than 40 mm thick, the temperature of the area mentioned above shall be in no case be less than 20°C, all requirements regarding preheating of the parent material shall be in accordance with the relevant IS.
- vi) Where required, intermediate layers of multiple-layer welds shall be peened with light blows from a power hammer, using a round-nose tool. Peening shall be done after the weld is cooled to a temperature warm to the hand. Care shall be exercised to prevent scaling or flaking of weld & base metal from over peening.
- vii) The equipment shall be capable of producing proper current so that the operator may produce satisfactory welds. The welding machine shall be of type and capacity as recommended by the electrode manufacturer.
- viii) Column splices and butt joints of compression members for stress transmission shall be accurately machined and close-butted over the whole section with a clearance not exceeding 0.2 mm locally at any place. In column caps and bases, the ends of shafts together with the attached gussets, angles, channels etc., after welding together, should be accurately machined



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 6 4



so that the parts connected butt over the entire surfaces of contact. Care should be taken that those connecting angles or channels are fixed with such accuracy that they are not reduced in thickness by machining by more than 2 mm.

- ix) Bases and caps fabricated out of steel plates, except when cut from material with true surface, shall be accurately machined over the bearing surface and shall be in effective contact with the end of the stanchion. A bearing face which is to be grouted direct to a foundation need not be machined if such face is true and parallel to the upper face. To facilitate grouting, holes shall be provided, where necessary, in stanchion bases for the escape of air. The ends of lacing bars shall be neat and free from burrs. Rolled section or built-up steel separators or diaphragms shall be required for all double beams except where encased in concrete, in which case, pipe separators shall be used. Provision shall be made for all necessary steel bearing plates to take up reaction of beams & columns and the required stiffeners & gussets whether or not specified. Bearing plates and stiffener connections shall not be permitted to encroach on the designed architectural clearances.
- x) All shop connections shall be welded as specified. Certain shop connections, may be changed to field connections if desired by the Engineer for convenience of erection; and the contractor shall make the desired changes. The steelwork shall be temporarily shop-erected complete so that accuracy of fit may be checked before dispatch. The parts shall be shop-erected with a sufficient number of parallel drifts to bring and keep the parts in place. In case of parts drilled or punched using steel jigs to make all similar parts interchangeable, the steelwork shall be shop erected facilitating the check of interchangeability.

23.09.00 Shop Painting

- a) The steelwork concealed by interior building finish need not be painted; steelwork to be encased in concrete shall not be painted. All other steelwork shall be given one coat of shop paint, applied thoroughly and evenly to dry surfaces which have been cleaned as below, by brush, spray, roller coating, flow coating or dipping. Before leaving the shop, all steelwork to be painted shall be cleaned by hand- wire brushing or by other mechanical cleaning methods to remove loose mill scale, loose rust, weld slag or flux deposit, dirt and other foreign matter. Oil and grease deposits shall be removed by solvent. Steelwork having no shop paint shall, after fabrication, be cleaned of oil or grease by solvent cleaners; and shall be cleaned of dirt and other foreign material by through sweeping with a fiber brush. After completion of the pre- cleaning, the metal surface shall be immediately painted with epoxy based paint.
- b) Inaccessible surfaces after assembly, shall receive two coats of shop paint, positively of different colours to prove application of two coats before assembly. This does not apply to the interior of sealed hollow sections. Contact surfaces shall be cleaned as per para (a) above before assembly.



Machine finished surfaces shall be protected against corrosion by a rust inhibitive coating that can be easily removed prior to erection or which has characteristics that make removal unnecessary prior to erection. Surfaces within 50 mm of any field weld location shall be free of materials that would prevent proper welding or produce objectionable fumes while welding is being done.

- c) All the grills shall be galvanized

23.10.00 Testing, Acceptance Criteria and Delivery

- a) The contractor shall carry out testing as per IS. The contractor shall get the specimen tested in a laboratory approved by the Engineer and test results shall be submitted to the Engineer in triplicate within 3 days after completion of the test. All electrodes shall be procured with test certificates. The correct grade and size of electrodes not deteriorated in storage shall only be used. The testing of welding shall be performed as under with quantum of minimum non-destructive tests to be conducted during fabrication and after erection as below:
- i) Ultrasonic test should be performed on the columns; girders; Built-up beam fabricated with plates.
 - ii) Fillet welds at junction of flange & web of built-up beams, columns, all shear connections of main beams and all butt welds shall be 100% ultra sonic tested
 - iii) 100% radiographic test shall be performed for butt weld joints of crane girder & its supporting columns, deaerator supporting beams and columns. The minimum percentage of Radiographic test to be carried out at other locations shall be 25 percent.
 - iv) Dypenetration test, Ultrasonic test, Radiographic test shall be carried out at any other location also, if required as per Engineer's approval.

In cases, the test results shows deficiency, the Engineer shall have option to reject or instruct any remedial measures to be carried out by the contractor.

- b) All bolts, nuts and washers shall conform to the relevant IS. If desired by the Engineer, representative samples of these materials should be tested in an approved laboratory and in accordance with the procedures described in relevant IS. All paints and primers shall be of standard quality; and shall conform to the provisions of the relevant IS. The paint shall be epoxy based. The tolerances on the dimensions of individual rolled steel components shall be as per IS:1852. The tolerances on straightness, length etc. of various fabricated components (such as beams and girders, columns, crane gantry girder etc.) of the steel structures subjected to dynamic loading (like wind,



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 6 6



seismic etc.) and thin walled construction (like box girders) shall be as per IS:7215.

- c) Should any structure or part of a structure be found not to complying to the provisions of the specification, the same shall be liable to rejection. No structure or part of the structure, once rejected, shall be offered again for test, except in cases where the Engineer considers the defects rectifiable. The Engineer may, at his discretion, check the test results obtained at the contractor's works by independent tests at an approved laboratory and should the items, so tested, be found to be unsatisfactory.

When all tests to be performed in the contractor's shop have been successfully carried out, the steelwork will be accepted forthwith; upon receipt of which, the items shall be shop painted, packed and dispatched. No item should be delivered unless an acceptance certificate for the same has been issued. The satisfactory completion of these tests or the issue of the certificates shall not bind the Purchaser to accept the work, should it, on further tests before or after erection, be found not in compliance with spec.

- d) The contractor should deliver the fabricated structural steel materials to site with all necessary field connection materials in a sequence permitting an efficient and economical performance of the erection work. The Purchaser may prescribe or control the sequence of delivery of materials, at his own discretion. Each separate piece of fabricated steelwork shall be distinctly marked on all surfaces before delivery in accordance with the markings shown on approved erection drawings; and shall bear such other marks as will further facilitate identification and erection.

23.11.00 Inspection of Welding

The extent of quality control in respect of welds of structural elements shall be as follows:

a) Visual Examination

All welds shall be 100% visually inspected to check the following:

- i) Presence of undercuts
- ii) Surface cracks in both welds and base metals.
- iii) Unfilled craters
- iv) Improper weld profile and size
- v) Excessive reinforcement in weld



- vi) Surface porosity

Before inspection, the surface of weld metal shall be cleaned of all slag, spatter matter, scales etc. by using wire brush or chisel.

b) Dye penetration Test (DPT)

This test shall be carried out for all fillet welds and groove welds to check the following:

- i) Surface cracks
- ii) Surface porosities

c) Ultrasonic Testing

Ultrasonic test shall be conducted for all groove welds and heat affected zone in dynamically loaded structures and for other important load bearing butt welds in statically loaded structures as desired by Purchaser to detect the following:

- i) Cracks
- ii) Lack of fusion
- iii) Slag inclusion
- iv) Gas porosity

Ultrasonic testing shall be carried out in accordance with American National Standard ANSI/AWS D1.1-92 Chapter 6 Part-C.

Before Ultrasonic test is carried out, any surface irregularity like undercuts, sharp ridges etc. shall be rectified. Material surface to be used for scanning by probes must allow free movement of probes. For this purpose, surface shall be prepared to make it suitable for carrying out ultrasonic examination.

d) Radiographic Testing (X-ray and Gamma-ray Examination)

This test shall be limited to 2% of length of welds for welds made by manual or semi-automatic welding and 1% of length of weld if made by automatic welding machines. The location and extent of weld to be tested by this method shall be decided by Purchaser to detect the following defects:

- i) Gas porosity



- ii) Slag inclusion
- iii) Lack of penetration
- iv) Lack of fusion
- v) Cracks

Radiographic testing shall be conducted in accordance with American National Standard ANSI/AWSD1.1-92.

Any surface irregularity like undercuts, craters, pits, etc. shall be removed before conducting radiographic test. The length of weld to be tested shall not be more than $0.75 \times$ focal distance. The width of the radiographic film shall be equal to width of the welded joint plus 20 mm on either side of the weld.

EPC Contractor shall provide testing equipment for conducting non-destructive tests for confirming the integrity of welding wherever necessary as directed by the Purchaser.

e) Acceptable Limits of Defects of Weld

Limits of acceptability of welding defects shall be as follows:

i) Visual inspection and Dye penetration test

The limits of acceptability of weld defects detected during visual inspection and dye penetration test shall be in accordance with clause 8.15.1 and clauses 9.25.3 of American National Standard ANSI / AWS D1.1-92 respectively, for statically and dynamically loaded structures.

- ii) Ultrasonic testing The limits of acceptability of weld defects detected during ultrasonic testing shall be in accordance with clause 8.15.4 and clause 9.25.3 of American National Standard ANSI/AWS D1.1-92 respectively for statically and dynamically loaded structures.

iii) Radiographic testing:

The limits of acceptability of weld defects detected during Radiographic testing shall be in accordance with clause 8.15.3 and 9.25.2 of American National Standard ANSI/ AWS D1.1-92 respectively for statically and dynamically loaded structures.

f) Rectification of Defects in Welds

In case of detection of defects in welds, the rectification of the same shall be done as follows:



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 6 9



- i) All craters in the weld and breaks in the weld run shall be thoroughly filled with weld
- ii) Undercuts, beyond acceptable limits, shall be repaired with dressing so as to provide smooth transition of weld to parent metal.

Welds with cracks and also welds with incomplete penetration, porosity, slag inclusion etc., exceeding permissible limits shall be rectified by removing the length of weld at the location of such defects plus 10 mm from both ends of defective weld and shall be re-welded. Defective weld shall be removed by chipping hammer gouging torch wheel. Care shall be taken not to damage the adjacent material.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 0



24.00.00 ERECTION OF STRUCTURAL STEELWORK

24.01.00 The works related to the erection of structural steelwork including receiving and taking delivery of fabricated structural steel materials arriving at site, installing the same in position, painting and grouting the stanchion bases all complete are detailed below:

- a) Providing all construction & transport equipment, tools, tackles, consumables, materials, labour and supervision as required for the erection of the structural steelwork.
- b) Receiving, unloading, checking and moving to storage yard at site including prompt attendance to all insurance matters as necessary.
- c) Transportation of all fabricated structural steel materials from site storage yard, handling, rigging, assembling, bolting, welding and satisfactory installation in proper location as per approved erection drawings. If necessary suitable temporary approach roads should be built for transportation.
- d) Checking centerlines, levels of all foundation blocks including checking line, level, position and plumb of all bolts and pockets. Any defect observed in the foundation shall be brought to the notice of the Engineer. The contractor shall fully satisfy himself regarding the correctness of the foundations before installing the fabricated steel structures on the foundation blocks.
- e) Aligning, plumbing, leveling, bolting, welding and securely fixing the fabricated steel structures as per drawings.
- f) Painting of the erected steel structures.
- g) Minor modifications of the fabricated steel structures as directed by the Engineer including but not limited to the following:-
 - i) Removal of bends, kinks, twists etc. for parts damaged during transport and handling.
 - ii) Cutting, chipping, filling, grinding etc. if required for preparation and finishing of site connections.
 - iii) Reaming of holes for use of higher size bolt if required.
 - iv) Welding of connections in place of bolting for which holes are either not drilled at all or wrongly drilled during fabrication.
 - v) Refabrication of parts damaged beyond repair during transport and handling or refabrication of parts which are incorrectly fabricated.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 1



- vi) Fabrication of parts omitted during fabrication by error, or subsequently found necessary.
- vii) Drilling of holes which are either not drilled at all or drilled in incorrect location during fabrication

24.02.00

- a) The work shall conform to the latest revisions of the following IS Codes:

IS-800	:	Code of Practice for general construction in Steel
IS-456	:	Code of Practice for plain or reinforced concrete
IS-7205	:	Safety Code for erection of Structural Steel work
IS-12840	:	Tolerance for erection of Steel Structures

- b) Conformity with designs: The contractor should erect the fabricated steel structures, align all the members, complete all field connections as per approved drawings. All works shall conform to the provisions of the relevant IS. The testing and acceptance of the erected structures shall be in accordance with the provisions of this specification.

24.03.00

- a) The contractor should take delivery of all the materials at site. He shall unload the materials and perform all formalities such as checking of materials and attend to insurance matters as specified above.

Contractor shall make good any such deficiency, if detected later, either by repair or with fresh material as may be directed by the Engineer at the contractor's own cost. All field connection materials such as bolts, nuts, washers and electrodes, other consumables such as oxygen and acetylene gas, paints, fuels, lubricants, oil, grease and any other material as required for the execution of the works shall be supplied by the contractor for erection work.

- b) All materials shall be stored preventing deterioration and ensuring the preservation of their quality and fitness for use in the works. Any material which has been deteriorated or damaged beyond repairs and has become unfit for use shall be removed immediately from the site. The contractor should establish a suitable yard at site for storing the fabricated steel structures and other materials. The yard shall have proper facilities such as drainage, lighting, suitable access for large cranes, trailers and other heavy equipment. The yard shall be fenced all around with security arrangement and shall be of sufficiently large area to permit systematic storage of the fabricated steel structures without overcrowding. All field connection materials, paints, cement etc. shall be stored on well designed racks and platforms off the ground in a properly covered store building.
- c) The contractor shall establish and maintain quality control procedures for different items of work and materials; and shall submit the records of the same to the Engineer. The quality control operation shall include but not be limited to the following:



- i) Erection : Lines, levels, grades, plumbs, joint characteristics including tightness of bolts.
- ii) Painting : Preparation of surface for painting, quality of primers and paints, thinners, application and uniformity of coats.

24.04.00 Workmanship

- a) The suitability and adequacy of all erection tools and plant and equipment proposed to be used shall be efficient, dependable, in good working condition. The method and sequence of erection shall have the prior approval of the Engineer. The Erection shall arrange in most economical method; and sequence available to him consistent with the drawings.
- b) Unless adequate bracing is included as a part of the permanent framing, the erector during erection shall install, temporary guys and bracings where needed to secure the framing against loads such as wind or seismic forces comparable in intensity to that for which the structure has been designed, acting upon exposed framing as well as loads due to erection equipment and erection operations.

If additional temporary guys are required to resist wind or seismic forces acting upon components of the finished structure during the course of the erection of the steel framing, arrangement for installation by the erector shall be made.

The responsibility of the contractor in respect of temporary bracings and guys shall cease when the structural steel is once located, plumbed, leveled, aligned and grouted within the tolerances permitted under the specification and guyed and braced to the satisfaction of the Engineer. The temporary guys, braces, false work and cribbing shall be removed immediately upon completion of the erection

- c) Positioning and leveling of all steelwork, plumbing of stanchions and placing of every part of the structure with accuracy shall be as per approved drawings. Anchor bolts and other anchor steel shall be embedded. The contractor shall check the positions and levels of the anchor bolts, etc. before concreting and get them properly secured against disturbance during pouring operations. He shall remain responsible for correct positioning. For heavy columns, the contractor shall set proper screed bars to maintain proper level. Each tier of column shall be plumbed and maintained in a true vertical position subject to the limits of tolerance allowable. No permanent field connections by bolting or welding shall be carried out until proper alignment and plumbing has been attained.
- d) All relevant portions in respect of bolted construction for fabrication of



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 3



structural steelwork shall also be applicable for field bolting as below:

Bolts shall be inserted in such a way so that they may remain in position under gravity even before fixing the nut. Bolted parts shall fit solidly together when assembled; and shall not be separated by gaskets or any other interposed compressible materials. When assembled, all joint surfaces, including those adjacent to the washers shall be free of scales except light mill scales. They shall be free of dirt, loose scales, burns, and other defects that would prevent solid seating of the parts. Contact surfaces within friction-type joints shall be free of oil, paint, lacquer, or galvanizing. High tensile bolts shall be tightened to provide the required minimum bolt tension by any of the following methods:-

Turn-of-nut method: When the turn-of-nut method is used to provide the bolt tension, there shall first be enough bolts brought to a "Snug tight" condition to ensure that the parts of the joint are brought into good contact with each other. "Snug tight" is defined as the tightness attained by a few impacts of an impact wrench or the full effort of a man using an ordinary spud wrench. Following this initial operation, bolts shall be placed in any remaining holes in the connection and brought to snug tightness. All bolts in the joint shall then be tightened additionally by the applicable amount of nut rotation as below with tightening progressing systematically from the most rigid part of the joint to its free edges. During this operation, there shall be no rotation of the part not turned by the wrench.

Bolts length not Bolt length exceeding 8 times dia or 200mm	Bolts length not Bolt length exceeding 8 times dia or 200mm	Remarks
½ turn	2/3 turn	Nut rotaion is relative to bolt regardless of the element (nut or bolt) being turned. Tolerance on rotaion – 30 over or under

Bolts shall be installed without hardened washers when tightening is done by the turn-of-nut method. However, normal washers shall be used.

Bolts tightened by the turn-of-nut method may have the outer face of the nut match-marked with the protruding bolt point before final tightening, thus affording the inspector visual means of noting the actual nut rotation. Such marks shall be made by the wrench operator by suitable means after the bolts have been brought up snug tight.

Torque Wrench tightening: When torque wrenches are used to provide the



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 4



bolt tensions, the bolts shall be tightened to the torques as below. Nuts shall be in tightening motion when torque is measured. When using torque wrenches to install several bolts in a single joint, the wrench shall be returned to touch up bolts previously tightened, which may have been loosened by the tightening of subsequent bolts, until all are tightened to the required tension.

The above torque values are approximate for providing tensions of 14.7 MT for 20 mm dia; 18.2 MT for 22 mm dia; and 21.2 MT for 24 mm dia. bolts under moderately lubricated condition. The torque wrench shall be calibrated at least once daily to find out the actual torque required to produce the above required tension in the bolt by placing it in a tension indicating device. These torques shall be applied for tightening the bolts on that day with the particular torque wrench.

In either of the above two methods, if required, for bolt entering and wrench operation clearances, tightening shall be done by turning the bolt while the nut is prevented from rotating.

Impact wrenches if used shall be of adequate capacity and sufficiently supplied with air to perform the required tightening of each bolt in approximately ten seconds.

Holes for turned bolts to be inserted in the field shall be reamed in the field. All drilling and reaming for turned bolts shall be done only after the parts to be connected are assembled. Tolerances applicable in the fit of the bolts shall be as per IS.

- e) Field Welding: All field assembly and welding shall be carried out as specified for fabrication work, excepting such provisions therein which manifestly apply to shop conditions only. Where the fabricated structural steel members have been delivered painted, the paint shall be removed before field welding for a distance of at least 50 mm on either side of the joints.
- f) Holes, cutting and fitting: No cutting of sections, flanges, webs, cleats, bolts, welds etc. shall be done. The erector shall not cut, drill or otherwise alter the work of other trades, or his own work to accommodate other trades, unless such work is clearly specified. Wherever such work is specified the contractor shall obtain complete information as to size, location and number of alterations prior to carrying out any work.

24.05.00

Drifting

Correction of minor misfits and reasonable amount of reaming and cutting of excess stock shall be considered as permissible. For this, light drifting shall be used to draw holes together; and drills shall be used to enlarge holes as necessary to make connections. Reaming, that weakens the member or makes it impossible to fill the holes properly or to adjust accurately after reaming shall not be allowed.



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 5



Any shop work error which prevents the proper assembling and fitting of parts by moderate use of drift pins and reamers shall immediately be called to the attention of the Engineer and approval of the method of correction obtained. The use of gas cutting torches at erection site is prohibited.

24.06.00 Testing and Acceptance Criteria

- a) Loading tests shall be carried out on erected structures to check adequacy of fabrication and/or erection. Any structure or a part thereof found to be unsuitable for acceptance as a result of the test shall be dismantled and replaced with suitable member. On the basis of the tests, the Engineer will decide and his decision will be final. In course of dismantling, if any damage is done to any other parts of the structure or to any fixtures, the same shall be made good.

The structure or structural member under consideration shall be loaded with its actual dead load for as long a time as possible before testing; and the tests shall be conducted as indicated below:-

- i) Stiffness Test: In this test, the structure or member shall be subjected, in addition to its actual dead load, to a test load equal to 1.5 times the specified superimposed load, and this loading shall be maintained for 24 hours. The maximum deflection attained during the test shall be within the permissible limit. If, after removal of the test load, the member or structure does not show a recovery of at least 80 per cent of the maximum strain or deflection shown during 24 hours under load, the test shall be repeated. The structure or member shall be considered to have sufficient stiffness, provided that the recovery after this second test is not less than 90 per cent of the maximum increase in strain or deflection recorded during the second test.
- ii) Strength Test: The structure or structural member under consideration shall be subjected, in addition to its actual dead load, to a test load equal to the sum of the dead load and twice the specified superimposed load, and this load shall be maintained for 24 hours.

In the case of wind load, a load corresponding to twice the specified wind load shall be applied and maintained for 24 hours, either with or without the vertical test load for more severe condition in the member under consideration or the structure as a whole. Complete tests under both conditions may be necessary to verify the strength of the structure. The structure shall be deemed to have adequate strength if, during the test, no part fails and if on removal of the test load, the structure shows a recovery of at least 20 per cent of the maximum deflection or strain recorded during the 24 hours under load.



b) Structure of same design:

Where several identical same design structures exists as a prototype, one structure shall be fully tested, but in addition, during the first application of the test load, particular note shall be taken of the strain or deflection when the test load 1.5 times the specified superimposed load has been maintained for 24 hours.

When a structure of the same type is selected for a check test, it shall be subjected, in addition to its actual dead load, to a superimposed test load, equal to 1.5 time the specified live load, in a manner prescribed by the Engineer. This load shall be maintained for 24 hours, during which time, the maximum deflection shall be recorded. The check test shall be considered satisfactory, provided that the maximum strain or deflection recorded in the check test does not exceed by more than 20% of the maximum strain or deflection recorded at similar load in the test on the prototype.

- c)** Repair for subsequent test and use after strength tests: The structure passed the "Strength Test" as above and is subsequently to be erected for use, shall be considered satisfactory for use after it has been strengthened by replacing any distorted members and has subsequently satisfied the 'Stiffness Test' as specified in above.

24.07.00 Tolerances

Considering expected variation in the finished dimensions of structural steel frames, these shall be within the limits of good practice when they are not in excess of the cumulative effect of detailed erection clearances, fabrication tolerances for the finished parts; and the rolling tolerances for the profile dimensions permitted under the specification for fabrication of structural steelwork shall be as indicated below:

	Component	Description	Variation Allowed
a	For Buildings Containing Cranes		
	i) Main Column	a) Shifting of column axis at foundation level with respect to building line	
		i) In longitudinal direction	(+/-) 3.0mm
		ii) In lateral direction	(+/-) 3.0mm
		b) Deviation of both major column axis from vertical between foundation and	



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 7



Component	Description	Variation Allowed
	other member connection levels :	
	i) For a column upto including 10M	(+/-) 3.5 mm and from true height vertical
	ii) For a column greater than 10M but less than 40M height	(+/-) 3.5 mm from true vertical for length measured between connection levels, but not more than (+/-) 7.0 mm per 30 m length
	c) For adjacent pairs of columns across the width of the building prior to placing of truss.	(+/-) 9 mm on true span.
	d) For any individual column deviation of any bearing or resting level from levels shown on drawings.	(+/-) 3 mm
	e) For adjacent pairs of columns either across the width of building or longitudinally level difference allowed between bearing or seating level supposed to be at the same level.	3 mm
ii) Trusses	a) Deviation at centre of span of upper chord member from vertical plane running through centre of bottom chord	1/1500 of the span or not greater than 10 mm whichever is the least
	b) Lateral displacement of top chord at centre of span from vertical plane running through centre of supports.	1/250 of depth of truss or 20 mm whichever is the least.
iii) Cranes Girders & Tracks	a) Difference in levels of crane rail measured between adjacent columns.	2.0 mm
	b) Deviation to crane rail gauge	(+/-) 3 mm
	c) Relative shifting of ends of adjacent crane rail in plan and elevation after thermit welding.	1.0 mm



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 8



Component	Description	Variation Allowed
	d) Deviation of crane rail axis from centre line of web.	(+/-) 3.5 mm
iv) Setting of expansion gaps	At the time of setting of the expansion gaps, due regard shall be taken of the ambient temperature above or below 30°C. The coefficient of expansion or contraction shall be taken as 0.000012 per Deg.C per unit length.	
b For Buildings without Cranes		
The maximum tolerances for line and level of the steel work shall be ± 3 mm on any part of the structure. The structure shall not be out of plumb more than 3.5 mm on each 10 m section of height and not more than 7 mm per 30 m section. These tolerances shall apply to all parts of the structure unless the drawings issued for erection purposes state otherwise.		



2 x 660 MW Ennore SEZ Coal Based Supercritical Thermal Power
Project at Ash Dyke of NCTPS
Spec. No. CE/C/ P & E/ EE/ E/OT. No.03 /2013-14
Vol. VI : 7 9





TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D

SUBSECTION -D17

REV.NO. 0

DATE 13/02/2018

SHEET

1

OF

41

**SECTION - D
(PART I)**

SUB-SECTION – D 17

FABRICATION OF STRUCTURAL STEEL WORK



Bharat Heavy Electricals Limited
Project Engineering Management
PPEI Building, Power Sector,
Plot No. 25, Sector 16A,
Noida (U.P.)-201301



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D

SUBSECTION -D17

REV.NO.

0

DATE

13/02/2018

SHEET

2

OF

41

C O N T E N T

CLAUSE NO.	DESCRIPTION	SHEET NO.
1.00.00	SCOPE	3
2.00.00	GENERAL	3
3.00.00	WORKMANSHIP	19
4.00.00	INSPECTION, TESTING, ACCEPTANCE CRITERIA AND DELIVERY	29
5.00.00	INFORMATION TO BE SUBMITTED	33
6.00.00	RATES AND MEASUREMENTS	34



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D

SUBSECTION - D17

REV.NO.

0

DATE

13/02/2018

SHEET

3

OF

41

SUB-SECTION – D XVII

FABRICATION OF STRUCTURAL STEEL WORK

1.00.00 SCOPE

This specification covers supply, fabrication, testing, painting and delivery to site of structural steelwork including supply of all consumable stores and rivets, bolts, nuts, washers, electrodes and other materials required for fabrication and field connections of all structural steelwork covered under the scope of the contract.

2.00.00 GENERAL

2.01.00 Work to be provided for by the Contractor

The work to be provided for by the Contractor, unless otherwise specified elsewhere in the contract, shall include, but not be limited to the following

- a) Preparation of complete detailed fabrication drawings and erection marking drawings required for all the structures covered under the scope of the contract based on the approved design drawings. As decided by the Engineer, some or all of these detailed drawings will have to be submitted for approval.
- b) To submit revised design with calculations and detailed fabrication drawings in case any substitution of the designed sections are to be made.
- c) To submit design calculations for joints and connections developed by the contractor along with detailed fabrication drawings.
- d) Furnish all materials, labour, tools and plant and all consumables required for fabrication and supply, all necessary rivets, bolts, nuts, washers, tie rods and welding electrodes for field connections,
- e) Furnish shop painting of all fabricated steelwork as per requirements of this Specification.
- f) Suitably mark, bundle, and pack for transport all fabricated materials.
- g) Prepare and furnish detailed Bill of Materials, Drawing Office Dispatch lists, Rivet and Bolt List and any other list of bought out items required in connection with the fabrication and erection of the structural steelwork.
- h) Insure, load and transport all fabricated steelwork field connection materials to site.

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 4 OF 41
	i) Maintain a fully equipped workshop at site for fabrication, modification and repairs of steelwork at site as may be required to complete the works in accordance with the Contract. 2.02.00 Work by others No work under this specification will be provided for by any agency other than the contractor, unless specifically mentioned otherwise elsewhere in the contract. 2.03.00 Codes and standards All work under this specification shall, unless otherwise specified in the contract, conform to the requirements of the latest revision and/or replacements of the following or any other relevant Indian Standard specifications and codes of practice. In case any particular aspect of the work is not specifically covered by any Indian Standard specification, any other standard practice, as may be specified by the Engineer shall be followed: IS: 226 - Structural steel (Standard Quality) IS: 800 - Code of Practice for general construction in steel. IS: 806 - Code of practice for use of steel tubes in general building construction. IS: 808 - Rolled steel beams, channels, and angle sections IS: 813 - Scheme of symbols for welding IS: 814 - Covered electrodes for metal arc welding of structural steel IS: 815 - Classification and coding of covered electrodes for metal arc welding of structural steels. IS: 816 - Code of practice for use of metal arc welding for general construction in mild steel IS: 817 - Code of practice for training and testing metal arc welders IS: 818 - Code of practice for safety and health requirements in electric and gas welding and cutting operations IS: 822 - Code of practice for inspection of welds IS: 919 - Recommendations for limits and fits for Engineering	



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 5 OF 41

IS: 961 -	Structural Steel (High Tensile)
IS: 1148 -	Rivet bars for structural purposes
IS: 1149 -	High tensile rivet bars for structural purposes
IS: 1161 -	Steel Tubes for structural purposes
IS: 1200 -	Method of measurement of steelwork and ironwork (Part 8)
IS: 1239 -	Mild Steel Tubes
IS: 1363 -	Black hexagon bolts, nuts and lock nuts (dia. 6 to 30 mm) and black hexagon screws (Dia 6 to 24 mm)
IS: 1364 -	Precision and semi-precision hexagon bolts, screws, nuts and locknuts (Dia, range 6 to 39 mm)
IS: 1367 -	Technical supply conditions for threaded fasteners
IS: 1442 -	Covered electrodes for the metal arc welding of high tensile structural steel
IS: 1608 -	Method for tensile testing of steel products other than sheet strip, wire and tube
IS: 1730 -	Dimensions for steel plate, sheet, and strip for structural and general engineering purposes.
IS: 1731 -	Dimensions for steel flats for structural and general engineering purposes
IS: 1852 -	Rolling and cutting tolerances for hot-rolled steel products
IS: 1977 -	Structural steel (ordinary quality) St-42-0
IS: 2062 -	Steel for General Structural Purposes
IS: 2074 -	Ready mixed paint, red oxide Zinc chromate priming
IS: 2595 -	Code of Practice for Radiographic Testing
IS: 2629 -	Recommended practice for Hot-Dip Galvanizing of Iron and Steel
IS: 2633 -	Method for testing uniformity of coating on Zinc Coated Articles



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 6 OF 41

- IS: 3757 - High strength structural bolts
- IS: 4759 - Specifications for Hot-Dip Zinc Coatings on Structural Steel and other allied products
- IS: 7205 - Safety Code for Erection of Structural Steelwork
- IS: 7215 - Tolerances for fabrication of steel structures
- IS: 7280 - Bare wire electrodes for submerged arc welding of structural steels.
- IS: 9595 - Recommendations for metal arc welding of carbon and carbon manganese steels.

2.04.00 Conformity with Designs

The contractor shall design all connections, supply and fabricate all steelwork and furnish all connection materials in accordance with the approved drawings and/or as instructed by the Engineer keeping in view the maximum Utilization of the available sizes and sections of steel materials. The methods of painting, marking, packing and delivery of all fabricated materials shall be in accordance with the provisions of the contract and/or as approved by the Engineer. Provision of all relevant Indian Standard Specifications and Codes of Practice shall be followed unless otherwise specified in the contract.

2.05.00 Materials to be used

2.05.01 General

All steel materials required for the work will be supplied by the contractor unless otherwise specified elsewhere in the contract. The materials shall be free from all imperfections, mill scales, slag intrusions, laminations, fittings, rusts etc. that may impair their strength, durability, and appearance. All materials shall be of tested quality only unless otherwise permitted by the Engineer and/or Consultant. If desired by the Engineer, Test Certificates in respect of each consignment shall be submitted in triplicate. Whenever the materials are required to be used from unidentified stocks, if permitted by the Engineer, a random sample shall be tested at an approved laboratory from each lot of 50 tones or less of any particular section.

The arc welding electrodes shall be of approved reputed manufacture and conforming to the relevant Indian Standard Codes of Practice and Specifications and shall be of heavily coated type and the thickness of the coating shall be uniform and concentric. With each container of electrodes, the manufacturer shall furnish instructions giving recommended voltage and



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 7 OF 41

amperage (Polarity in case of D.C. supply) for which the electrodes are suitable.

2.05.02 Steel

All steel materials to be used in construction within the purview of this specification shall comply with any of the following Indian Standard Specifications as may be applicable:

- a) IS: 2062 - Steel for general structural purposes
- b) IS: 961 - Structural steel High Tensile
- c) IS: 1977 - Structural steel (Ordinary quality) St-42-0

In case of imported steel materials being used, these shall conform to specifications equivalent to any of the above as may be applicable.

2.05.03 Rivet Steel

All rivet steel used in construction within the purview of this Specification shall comply with one of the following Indian Standard Specifications as may be applicable:

- a) IS: 1148 - Rivet Bars for structural purpose
- b) IS: 1149 - High tensile rivet bars for structural purposes. Where high tensile steel is specified for rivets, steps shall be taken to ensure that the rivets are so manufactured that they can be driven and heads formed satisfactorily without the physical properties of steel being impaired.

2.05.04 Electrodes

All electrodes to be used under the Contract shall be of approved reputed manufacture, low hydrogen electrode and shall comply with any of the following Indian Standard Specifications as may be applicable

- a) IS: 814 - Covered electrodes for metal arc welding of structural steel
- b) IS: 815 - Classification and coding of covered electrodes for metal arc welding of mild steel and low alloy high tensile steel
- c) IS: 1442 - Covered electrodes for the metal arc welding of high tensile structural steel



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 8 OF 41

- d) IS: 7280 - Bare wire electrodes for submerged arc welding of structural steels

2.05.05 Bolts and Nuts

All bolts and nuts shall conform to the requirements of Indian Standard Specification IS: 1367 - Technical Supply Conditions for Threaded Fasteners.

Materials for Bolts and nuts under the purview of this contract shall comply with any of the following Indian Standard Specifications as may be applicable.

a) Mild Steel

All mild steel for bolts and nuts when tested in accordance with the following Indian Standard Specification shall have a tensile strength of not less than 44 Kg/mm² and a minimum elongation of 23 per cent on a gauge length of 5.6 _/A, where "A" is the cross sectional area of the test specimen

- i) IS: 1367: Technical supply conditions for threaded fasteners

- ii) IS: 1608: Method for tensile testing of steel products other than sheet, strip, wire and tube

b) High Tensile Steel

The material used for the manufacture of high tensile steel bolts and nuts shall have the mechanical properties appropriate to the particular class of steel as set out in IS: 1367 or as approved by the Engineer.

2.05.06 Washers

Washers shall be made of steel conforming to any of the following Indian Standard Specifications as may be applicable under the provisions of the Contract:

- a) IS: 2062 - Steel for general structural purposes
b) IS: 961 - Structural Steel (High Tensile Quality)
c) IS: 1977 - Structural steel (Ordinary Quality) St-42-0
d) IS: 6649 - Hardened washers

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 9 OF 41
2.05.07	Paints Paints to be used for shop coat of fabricated steel under the purview of this contract shall conform to the Indian Standard Specification IS: 2074 - Ready Mixed Paint, Red oxide Zinc Chromate Priming. 2.06.00 Coal Bin 2.06.01 Shape of bins shall be circular, polygonal, square, or rectangular in plan. Bottom hopper portion may have been conical-cum-hyperbolic or any other profile shape as shown in the drawing. Bin shall be termed as bunkers or silos according to their shape and plane of rupture of coal. 2.06.02 For general requirements, fabrication and construction details IS: 9178 (Pt. I & II) shall be followed as general guidance. The bins shall be fabricated and erected in segments. 2.06.03 The Coal bins shall be made of mild steel plates joined together with full strength butt weld and provided with stiffeners at regular interval. Stiffeners shall be provided on the external face and it may be welded with external face. 2.06.04 Bending of plates and rolled sections to the required shape for fabrication shall be done by plate bending machine or cold bending process Without resorting to heating, hammering, angle smithy and black smithy process. 2.06.05 Poking hole (manual or pneumatic) and striking plate shall be provided to facilitate coal flow. Poking holes shall have circular MS pipe and cover cap as detailed in the drawing. 2.07.00 New Erection Marks 2.07.01 Additional structures involving new erection marks may be required to be added at any stage of work. 2.07.02 All such new erection marks shall be detailed and included in marking schemes and fabrication carded out thereafter. 2.07.03 All such new erection marks shall be considered under item of original fabrication work. As a result of additional structures becoming necessary if the work is delayed beyond the time schedule stipulated, the Engineer shall give suitable extension of time provided he is satisfied about the reasonableness of the delay involved. However, no claim for extra payments or revision of rates due to delay shall be entertained.	

 Maharatna Company	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001	
		VOLUME -	
		SECTION - D	SUBSECTION -D17
		REV.NO. 0	DATE 13/02/2018
		SHEET 10	OF 41
2.08.00	ELECTRO FORGED STEEL GRATINGS		
2.08.01	Factory made fabricated electro forged gratings unit with steel conforming to IS: 2062 shall be supplied, fabricated, transported, erected and aligned in floorings, platforms, drain and trench covers, walkways, passages, staircases with edge binding strips and anti skid nosing in treads etc.		
2.08.02	All grating units shall be rectangular in pattern and electro forged. The size and the spacing of the bearing bars and cross bars shall be as detailed in fabrication drawings. The contractor shall submit the grating design for different spans and load intensities along with fabrication drawings. The depth of the grating unit shall be 40 mm, unless specified otherwise.		
2.08.03	The gratings shall be made up in panel units designed to coincide with the span of the structural steel framing or openings as indicated in the design/scope drawings. Maximum possible standardization of the grating panel sizes shall be tried and designed.		
2.08.04	The grating unit shall be accurately fabricated and finished, free from wraps, twists, or any defects that would impair their strength, serviceability, and appearance.		
2.08.05	Grating work shall include cut outs and clearance opening for all columns, pipes, ducts, conduits or any other installation penetrating through the grating work. Such cut outs and clearances shall be treated as specified in subsequent clauses.		
2.08.06	The gratings shall be notched, trimmed and neatly finished around flanges and webs of the columns, moment connections, cap plates, and such other components of the steel structures encountered during the placement of the gratings. In all such cases, the trimming shall be done to follow the profile of the components encountered. After trimming, the binding strip shall be provided on the grating to suit the profile so obtained.		
2.08.07	Opening in gratings for pipes or ducts that are 150mm in size or diameter or larger shall be provided with steel bar toe plates of not less than 5mm thickness and appropriate width, set flush with the bottom of the bearing bars.		
2.08.08	Penetrations in gratings that are more than 50mm but less than 150mm in size or diameter shall be welded with plates of size shown in the detailed drawings set flush with the bottom of the grating panel.		
2.08.09	Unless otherwise indicated on the drawings, grating units at all penetrations shall be made up in split section, accurately fitted and neatly finished to provide for proper assembly and erection at the job site.		

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001			
		VOLUME -			
		SECTION - D		SUBSECTION -D17	
		REV.NO.	0	DATE	13/02/2018
		SHEET	11	OF	41
2.08.10	Grating units shall be provided with all necessary clips, bolts, nuts and lock washers required for proper assembly and rigid installation and fastening to abutting units supporting structural steel framing members.				
2.08.11	The gratings shall be of reputed make and manufacturer, as approved by Engineer. The unit rate quoted by him for this item shall be inclusive of transport of gratings to the project site, all taxes, duties etc. He shall also provide all facilities and access to the Engineer or his representative to carry out inspection during all stages of manufacturing of gratings.				
2.08.12	Maximum deviation in linear dimension from the approved dimension shall not exceed 12mm.				
2.08.13	All fabricated grating section and accessories shall be blast cleaned to near white metal surface (Sa 2½) followed by either of the following two: (a)Two coats of red lead primer and two coats of black enamel finish paint. (b) Hot dipped galvanization at 610 gm/sq.m. in the shop prior to erection at site, as the approved drawing.				
2.08.14	Prior to finishing all surfaces shall be cleaned, free from rust, mill scale, grease, oil, or any other foreign matter by blast cleaning. BS: 4232 shall be followed for blast cleaning.				
2.08.15	Primer can be applied by spray guns or by brushes, however the finish paint shall necessarily be applied by means of spray guns. The applied coatings shall be uniform, free from voids and streaks; drilled or punched holes shall be touched up prior to erection or assembly.				
2.09.00	GALVANIZATION OF GRATINGS				
2.09.01	Purity of Zinc to be used-for galvanizing shall be 99.5% as per IS: 2 15				
2.09.02	After the shop work is complete, the structural material shall be punched with erection mark and be hot double dip galvanized. Before galvanizing the steel section shall be thoroughly blast cleaned to near white metal surface (Sa 2½).				
2.09.03	The weight of the zinc coating shall be at least 610 gm/m ² - unless noted otherwise.				
2.09.04	The galvanized surface shall consist of a continuous and uniformly thick coating of zinc, firmly adhering to the surface of steel. The finished surface shall be cleaned and smooth and shall be free from defects like discoloured patches, bare spots, unevenness of coating, spelter that is loosely attached to				

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 12 OF 41																					
	the steel, blistered surface, flaking or peeling off etc. The presence of any of these defects noticed on visual or microscopic inspection shall render the material liable to rejection. 2.09.05 There shall be no flaking or loosening when struck squarely with a chisel faced hammer. The galvanized steel member shall withstand minimum four one minute dips in copper sulphate solution as per IS: 2633. 2.09.06 When the steel section is removed from the galvanizing kettle, excess spelter shall be removed by 'bumping'. The processes known as 'wiping' or 'scrapping' shall not be used for this purpose. 2.09.07 Defects in certain members indicating presence of impurities in the galvanizing bath in quantities larger than that permitted by the specifications or lack of quality control in any manner in the galvanizing plant, shall render the entire, production in the relevant shift liable to rejection. 2.09.08 All structural steel shall be treated with sodium dichromate or an approved equivalent solution after galvanizing; so as to prevent white storage stains. 2.09.09 If the galvanizing of any member is damaged, the Engineer shall be shown of the extent of damage, if so directed the galvanizing may have to the redone in the similar manner as stated above at no extra cost to the Owner. 2.10.00 STAINLESS STEEL HOPPERS (As per BOQ item) 2.10.01 Material In case SS Hopper is to be fabricated & erected as per BOQ item with SS415M, following specification shall be followed. Stainless steel hopper of grade SS 415M as manufactured by SAIL or equivalent shall be provided in the lower portion of bunker hopper. SS 4 15M having the following chemical composition shall be used. <table> <tr> <th>Material</th><th>%</th><th>Remarks</th></tr> <tr> <td>Carbon</td><td>10.03%</td><td>Max.</td></tr> <tr> <td>Silicon</td><td>1.60%</td><td>Max.</td></tr> <tr> <td>Manganese</td><td>0.80% to 1.50%</td><td></td></tr> <tr> <td>Phosphorous</td><td>0.03%</td><td>Max.</td></tr> <tr> <td>Sulphur</td><td>0.03%</td><td>Max.</td></tr> <tr> <td>Chromium</td><td>10.80% to 12.50%</td><td></td></tr> </table>		Material	%	Remarks	Carbon	10.03%	Max.	Silicon	1.60%	Max.	Manganese	0.80% to 1.50%		Phosphorous	0.03%	Max.	Sulphur	0.03%	Max.	Chromium	10.80% to 12.50%	
Material	%	Remarks																					
Carbon	10.03%	Max.																					
Silicon	1.60%	Max.																					
Manganese	0.80% to 1.50%																						
Phosphorous	0.03%	Max.																					
Sulphur	0.03%	Max.																					
Chromium	10.80% to 12.50%																						

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 13 OF 41															
	Nickel 1.50% Max. Titanium 0.75% Max. Nitrogen 0.03% Max. The mechanical properties shall be as follows: <table> <tr> <th>Description</th><th>Value</th><th>Remarks</th></tr> <tr> <td>Hardness Rock Well B Scale</td><td>90</td><td>Max.</td></tr> <tr> <td>Tensile Strength</td><td>450 MPa</td><td>Min.</td></tr> <tr> <td>Yield Strength</td><td>300 MPa</td><td>Min.</td></tr> <tr> <td>Elongation</td><td>25%</td><td>Min.</td></tr> </table>	Description	Value	Remarks	Hardness Rock Well B Scale	90	Max.	Tensile Strength	450 MPa	Min.	Yield Strength	300 MPa	Min.	Elongation	25%	Min.	
Description	Value	Remarks															
Hardness Rock Well B Scale	90	Max.															
Tensile Strength	450 MPa	Min.															
Yield Strength	300 MPa	Min.															
Elongation	25%	Min.															
2.10.02	Fabrication The fabrication, erection, alignment and welding shall be carried out as per the accepted practice and in accordance with relevant I.S. and international specification as well as stipulations contained herein. Fabrication drawings shall be prepared by the contractor on the basis of the design / scope drawings furnished by Engineer. The fabrication and erection works shall be done as per the approved fabrication drawings.																
2.10.03	Fabrication Drawings a) Fabrication drawing shall give the cutting plan for each hopper plate. Such, cutting plan shall be based on the size of the Stainless Steel plate available at store. In order to reduce the wastage and ensure the maximum utilization of stainless steel plate, the cutting plan shall take in the consideration of the reverse curvature and place the various elements of hopper plate in opposite fashion to reduce the end wastage. Similarly, the hopper plate element having different radii shall be placed one inside the other, to optimize the stainless steel plate use. Such optimization may also require adjustment in the size of each element of hopper plate and also additional weld joints. b) The bill of material of hopper plate shall indicate the inner surface area of the hopper, weight of the hopper based on the inner surface area, weight of each of the cut plate of hopper fabrication, weight of cut and scrap pieces generated. Contractor shall return to the Owner's store all unutilized (surplus) stainless steel plates and all waste and cut pieces generated. Non return of any part of the surplus/waste steel pieces to the Owner's store																



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 14 OF 41

will call for the penal recovery at three (03) times the maximum procurement rate for the weight of stainless steel pieces not returned to the store.

- c) In case the contractor does the cutting of the stainless steel without approved cutting plan then all the wastage (i.e. the difference between the weight of stainless steel plate cuts and the actual finished weight considered for the measurement for payment) shall be subjected to the penal recovery at the rate mentioned above.

2.10.04 Cuffing

Cutting may be affected by shearing, or by using plasma. The cut edges of all plates shall be perfectly straight and uniform through out. Cutting shall be done as per the cutting plan shown in the fabrication drawing. Should the Engineer find it necessary, the edges shall be ground smooth afterwards by contractor within the unit rates quoted by him. All the edge s shall be ground smooth before they are welded.

2.10.05 Jointing

Welding shall join stainless steel. All weld joints (along the inclined plane) shall be staggered. Any common welding process can weld stainless steel viz. MIG, metal arc or plasma using the covered compatible electrodes as per IS: 5206 or by inert gas arc welding as per IS: 2811. Shielding gas shall be Argon + Hydrogen mixture or Argon + Oxygen mixture. However, Argon + Oxygen mixture shall be preferred. Carbon-di-oxide mixture shall be avoided. 308L and 315L electrodes/fillers shall be used for the welding of Stainless Steel to Stainless Steel and Stainless Steel to Mild Steel respectively. However, the welding process and the type of the electrodes to be used for welding shall be as per welding procedure, as approved by the Engineer. On the basis of the welding procedure, the Contractor shall conduct qualification test.

2.10.06 Bending

The stainless steel plates shall be subjected to cold forming and bending in order to get the desired shape and profile.

2.10.07 Welding sequence

The type of electrodes, welding sequence, preheat and interpass temperature and post weld heat treatment shall be as approved by the Engineer.

2.10.08 Acceptance Criteria of Fabricated Structures

The acceptance of the fabricated structure work shall depend upon correct dimensions and alignment, absence of distortion in the structure, satisfactory



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 15 OF 41

results from the inspection and testing of the welded structure joints and the test specimens, general workmanship being good meeting the tolerance requirements given in IS: 7215.

2.11.00 BEARINGS

2.11.01 PTFE (Poly tetra fluorethylene) slide bearing

a) General

The bearings shall consist of upper and lower units. The upper unit shall include a sole plate with mirror finish stainless steel facing bonded to the bottom surface of the sole plate. The lower unit shall consist of a relevant laminated elastomers pad surfaced with PTFE. A rigid confining medium substructure bonds the PTFE to the pad. When the upper and lower units are mated the stainless steel slides on the PTFE surface with an extremely low coefficient of friction. These bearings shall be designed as per the performance requirements. The bearing shall be of reputed make and manufacturer as approved by Engineer, for required vertical loads, as per the construction drawings and for a maximum displacement of ± 50 mm.

b) Material

PTFE bearing shall be sliding against highly polished stainless steel and the coefficient of friction between them shall be less than 0.06 at 55 kg/cm². In order to prevent cold flow in the PTFE surface it shall be rigidly bonded by a special high temperature resistant adhesive to the stainless steel sub-strata. The stainless steel surface, which slides against the PTFE, is mirror polished. The stainless steel shall be bonded to the top plate by special high strength adhesive. The thickness of the stainless steel shall be between 1.0 to 1.5mm.

The resilient bearing pad shall consist of multiple layers of lightweight fabric impregnated with a high quality elastomer compound vulcanized into slabs of uniform standard thickness as per the requirement. This shall withstand vertical (compressive) load not less than 500 kg/cm² and shear loads upto 40 kg/cm².

c) Installation

The seating area for PTFE bearing shall be prepared accurately level and furnished with a thin layer of epoxy resin mortar. The bearing will be placed on this layer while it is still workable and the bearing is levelled. The bearing should not be displaced as the beam is lowered into position. When the mortar and adhesive are fully set and the beam slightly above the top of the bearing. The upper surface of the bearing shall then be coated with sufficient thickness of epoxy resin mortar so that when the



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 16 OF 41

beam is lowered on to the temporary supports it comes into full contact with the mortar and some is squeezed out. The surplus shall be troweled off and after the mortar is fully set the temporary supports removed.

2.12.00 Storage of material

2.12.01 General

All materials shall be so stored as to prevent deterioration and to ensure the preservation of their quality and fitness for the work. Any material, which has deteriorated or has been damaged, shall be removed from the contractor's yard immediately, failing which, the Engineer shall be at liberty to get the material removed and the cost incurred thereof shall be realised from the Contractor. The Contractor shall maintain upto date accounts in respect of receipt, use, and balance of all sizes and sections of steel and other materials. In case the fabrication is carried out in contractor's fabrication shop outside the plant site where other fabrication works are also carried out, all materials meant for use in this contract shall be stacked separately with easily identifiable marks.

2.12.02 Steel

The steel to be used in fabrication and the resulting cut-pieces shall be stored in separate stacks off the ground section wise and lengthwise so that they can be easily inspected, measured, and accounted for at any time. If required by the Engineer, the materials may have to be stored under cover and suitably painted for protection against weather.

2.12.03 Electrodes

The electrodes for electric arc welding shall be stored in properly designed racks, separating different types of electrodes in distinctly marked compartments. The electrodes shall be kept in a dry and warm condition if necessary by resorting to heating.

2.12.04 Bolts, Nuts and Washers

Bolts, nuts and washers and other fastening materials shall be stored on racks off the ground with a coating of suitable protective oil. These shall be stored in separate gunny bags or compartments according to diameter, length, and quality.

2.12.05 Paints

Paints shall be stored under cover in air tight containers. Paints supplied in sealed containers shall be used up as soon as possible once the container is opened.



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 17 OF 41

2.13.00

Quality Control

The Contractor shall establish and maintain quality control procedures for different items of work and materials to the extent he deems necessary to ensure that all work is performed in accordance with this specification. In addition to the Contractor's quality control procedures, materials and workmanship at all times shall be subjected to inspection by the Engineer or Engineer's representative. As far as possible, all inspection by the Engineer or Engineer's representative shall be made at the Contractor's fabrication shop whether located at Site or elsewhere. The Contractor shall co-operate with the Engineer or Engineer's representative in permitting access for inspection to all places where work is being done and in providing free of cost all necessary help in respect of tools and plants, instrument, labour and materials required to carry out the inspection. The inspection shall be so scheduled as to provide the minimum interruption to the work of the Contractor.

Materials or workmanship not in reasonable conformance with the provisions of this Specification may be rejected at any time during the progress of the work.

The quality control procedure shall cover but not be limited to the following items of work

- a) Steel: Quality manufacturer's test certificates, test reports of representative samples of materials from unidentified stocks if permitted to be used.
- b) Rivets, Bolts, : Manufacturer's certificate, dimension checks, Nuts & Washers material testing.
- c) Electrodes : Manufacturer's certificate, thickness and quality of flux coating.
- d) Welders : Qualifying Tests
- e) Welding sets : Performance Tests
- f) Welds : Inspection, X-ray, Ultrasonic tests
- g) Paints : Manufacturer's certificate, physical inspection reports
- h) Galvanizing : Tests in accordance with IS 2633 - Method for testing uniformity of coating on Zinc Coated Articles and IS : 4759 - Specification for Hot-Dip Zinc coatings on Structural Steel and other allied products.



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D

SUBSECTION -D17

REV.NO. 0

DATE 13/02/2018

SHEET

18

OF

41

2.14.00 Standard dimensions, forms and weights

The dimensions, forms, weights and tolerances of all rolled shapes rivets, bolts, nuts, studs, washers etc. and other members used in the fabrication of any structure shall, wherever applicable, conform to the requirements of the latest relevant Indian Standards, wherever they exist, or, in the absence of Indian Standards, to other equivalent standards.

2.15.00 Fabrication Drawings

The contractor shall within thirty (30) days after the award of the Contract submit to the Engineer the Schedule of Fabrication and erection of structural Steelworks, for approval. Within one week after receipt of approval on design of any steel structure (part or full) based on the approved design. As decided by the Engineer, six (6) copies each of some or all of the detailed fabrication drawings will have to be submitted for approval.

The sequence of preparation of fabrication drawings shall match with the approved fabrication and erection schedule. The above-mentioned approval for fabrication drawings will be accorded only towards the general conformity with the design requirements as well as specifications. The approval of drawing however shall not relieve the contractor of his sole responsibility in carrying out the work correctly and fulfilling the complete requirements of contract documents.

The fabrication drawings shall include but not limited to the following:

- a) Assembly drawings giving exact sizes of the sections to be used and identification marks of the various sections.
- b) Dimensional drawings of base plates, foundation bolts location etc.
- c) Comparison sheets to show that the proposed alternative section, if any, is as strong as the original sections shown on the Design Drawings.
- d) Complete Bill of Materials and detailed drawings of all sections as also their billing weights.
- e) Any other drawings or calculations that may be required for the clarification of the works or substituted parts thereof.

These drawings shall give all the necessary information for the fabrication, erection, and painting of the steelwork in accordance with the provisions of this Specification. Fabrication drawings shall be made in accordance with the best modern practice and with due regard to sequence, speed and economy in fabrication and erection. Fabrication drawings shall give complete information



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 19 OF 41

necessary for fabrication of the various components of the steelwork, including the location, type, size, and extent of welds. These shall also clearly distinguish between shop and field rivets, bolts, and welds and specify the class of bolts and nuts. The drawings shall be drawn to a scale large enough to convey all the necessary information adequately. Notes on the fabrication drawings shall indicate those joints or groups of joints in which it is particularly important that the welding sequence and technique of welding shall be carefully controlled to minimize the locked up stresses and distortion. Welding symbols used shall be in accordance with the requirements of the Indian Standard Specification. IS: 813 - Scheme of symbols for Welding, and shall be consistent throughout. Weld lengths called for on the drawings shall mean the net effective length.

The Contractor shall be responsible for and shall carry out at his cost any alterations of the work due to any discrepancies, errors or omissions on the drawings or other particulars supplied by him, whether such drawings or other particulars have been duly approved or not in accordance with the Contract.

3.00.00 WORKMANSHIP

3.01.00 Fabrication

3.01.01 General

All workmanship shall be equal to the best practice in modern structural shops, and shall conform to the provisions of the Indian Standard IS: 800 - Code of Practice for general construction in steel and other relevant Indian Standards or equivalent.

3.01.02 Straightening Material

Rolled materials before being laid off or worked, must be clean, free from sharp kinks, bends or twists and straight within the tolerances allowed by the Indian Standard Specification on IS: 1552 - Specification for rolling and cutting tolerance for hot-rolled steel products. If straightening is necessary, it may be done by mechanical means or by the application of a limited amount of localized heat. The temperature of heated areas, as measured by approved methods, shall not exceed 600°C.

3.01.03 Cutting

Shearing, cropping, or sawing shall affect cutting. Use of a mechanically controlled gas-cutting torch may be permitted for mild steel only. Gas cutting of high tensile steel may also be permitted provided special care is taken to leave sufficient metal to be removed by machining, so that all metal that has been hardened by flame is removed. Gas cutting without a mechanically controlled torch may be permitted if special care is taken and done under



TITLE:

TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 20 OF 41

expert hand, subject to the approval of the Engineer.

To determine the effective size of members cut by gas, 3 mm shall be deducted from each cut edge. Gas cut edges, which will be subjected to substantial stress or which are to have weld metal deposited on them, shall be reasonably free from gouges, occasional notches or gouges not more than 4 mm deep will be permitted. Gouges greater than 4 mm that remain from cutting shall be removed by grinding. All re-entrant corners shall be shaped notch free to a radius of at least 12 mm. Shearing, cropping and gas cutting shall be clean, reasonably square and free from any distortion.

3.01.04 Planning of edges

Planning or finishing of sheared or cropped edges of plates or shapes or of edges gas-cut with a mechanically controlled torch shall not be required, unless specifically required by design and called for on the drawings, included in a stipulation for edge preparation for welding or as may be required after the inspection of the cut surface. Surface cut with hand-flame shall generally be ground, unless specifically instructed otherwise by the Engineer.

3.01.05 Clearances

The erection clearance for cleated ends of members connecting steel to steel shall preferably be not greater than 2 mm at each end. The erection clearance at ends of beams web shall be not more than 3 mm at each end, but where for practical reasons greater clearance is necessary, suitably designed cheatings shall be provided.

3.02.00 Riveted and bolted construction

3.02.01 Holes

Holes through more than one thickness of material for members, such as compound stanchions and girder flanges, shall be drilled after the members are assembled and tightly clamped or bolted together. Punching may be permitted before assembly, if the thickness of the material is not greater than the nominal diameter of rivet or bolt plus 3 mm subject to a maximum thickness of 16 mm provided that the holes are punched 3 mm less in diameter than the required size and reamed after assembly to the full diameter.

Holes for rivets or black bolts shall be not more than 1.5 mm or 2.0 mm (depending on whether the diameter of the rivet or bolt is less or more than or equal to 25 mm) larger in diameter than the nominal diameter of the rivet or black bolt passing through them.

Holes for turned and fitted bolts shall be drilled to a diameter equal to the nominal diameter of the shank or barrel subject to a tolerance grade of BS as



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 21 OF 41

specified in IS. 919. Parts to be connected shall be firmly held together by tacking welds or clamps and the holes drilled through all the thicknesses in one operation and subsequently reamed to size. Holes not drilled through all thickness in one operation shall be drilled to a smaller size and reamed out after assembly.

Holes for rivets or bolts shall not be formed by gas cutting process.

3.02.02

Assembly

All parts of riveted members shall be well pinned or bolted and rigidly held together while riveting. Drifting to enlarge unmatching holes shall not generally be permitted. In case drifting is permitted to a slight extent during assembly, it shall not distort the metal or enlarge the holes. Holes that must be enlarged to admit the rivets or bolts shall be reamed. Poor matching of holes shall be cause for rejection. The component parts shall be so assembled that they are neither twisted nor otherwise damaged, and shall be so prepared that the specified cambers, if any, are maintained.

Rivets shall ordinarily be hot driven, in which case their finished heads shall be approximately hemispherical in shape and shall be of uniform size throughout the work for rivets of the same size full, neatly finished and concentric with the holes. Rivets shall be heated uniformly to a temperature not exceeding 1125°C they shall not be driven after their temperature has fallen below 540°C.

Rivets shall be driven by power riveters, of either compression or manually operated type, employing pneumatic, hydraulic or electric power. Hand driven rivets shall not be allowed unless in exceptional cases specifically approved by the Engineer. After driving, rivets shall be tight, shall completely fill the holes and their heads shall be in full contact with the surface. In case of countersunk rivets, the countersinking shall be fully filled by the rivet, any proudness of the countersunk head being dressed off flush, if required.

Riveted members shall have all parts firmly drawn and held together before and during riveting and special care shall be taken in this respect for all single riveted connections. For multiple riveted connections, a service bolt shall be provided in every third or fourth hole.

All loose, burnt, or otherwise defective rivets shall be cut out and replaced and special care shall be taken to inspect all single riveted connections. Special care shall also be taken in heating and driving long rivets. The Contractor shall prove the quality of riveting by cutting some rivets chosen at random by the Engineer. No extra payment will be made to the Contractor for such cutting and replacing. Riveting work, for any particular section or group, will be considered satisfactory when at least 90% of the corresponding cut rivets is found to be sound. If the ratio is below 75%, all the rivets in the particular



TITLE:

TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 22 OF 41

section or group shall be cut, removed and replaced and tested again at the Contractor's expense. For cases between 75% and 90% the engineer shall have the option to instruct cutting and replacing any number of further rivets at the Contractor's cost as he deems necessary.

Bolted construction shall be permitted only in case of field connections if called for on the Drawings and is subjected to the limitation of particular connections as may be specified. In special cases, however, shop bolt connections may be allowed if shown on drawing or directed by the Engineer.

Washers shall be tapered or otherwise suitably shaped, where necessary, to give the heads and nuts of bolts a satisfactory bearing. The threaded portion of each bolt shall project through the nut at least one thread. In all cases the bolt shall be provided with a washer of sufficient thickness under the nut to avoid any threaded portion of the bolt being within the thickness of the parts bolted together. In addition to the normal washer one spring washer or lock nut shall be provided for each bolt for connections subjected to vibrating forces or otherwise as may be specified on the Drawings.

3.03.00 Welded Construction

3.03.01 General

Welding shall be in accordance with relevant Indian Standards and as supplemented in the Specification. Welding shall be done by experienced and good welders who have been qualified by tests in accordance with IS: 817.

3.03.02 Preparation of material

Surface to be welded shall be free from loose scale, slag, rust, grease, paint, and any other foreign material except that mill scale, which withstands vigorous wire brushing, may remain. Joint surfaces shall be free from fins and tears. Preparation of edges by gas cutting shall, wherever practicable, be done by a mechanically guided torch.

3.03.03 Assembling

Parts to be fillet welded shall be brought in, as close contact as practicable and in no event shall be separated by more than 4 mm. If the separation is 1.5 mm or greater, the size of the fillet welds shall be increased by the amount of the separation. The fit of joints at contact surfaces, which are not completely sealed by, welds, shall be close enough to exclude water after painting. Abutting parts to be butt-welded shall be carefully aligned. Misalignments greater than 3 mm shall be corrected and in making the correction the parts shall not be drawn into a sharper slope than two degrees (2°).

The work shall be positioned for flat welding whenever practicable.



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 23 OF 41

3.03.04 Welding Sequence

In assembling and joining parts of a structure or of built-up members, the procedure and sequence of welding shall be such as will avoid needless distortion and minimize shrinkage stresses in the closing welds of a rigid assembly, such closing welds shall be made in compression elements.

In the fabrication of cover-plated beams and built-up members, all shop splices in each component part shall be made before such component part is welded to other parts of the member. Long girders or girder sections may be made by shop splicing not more than three sub-sections, each made in accordance with this paragraph.

When required by the Engineer, welded assemblies shall be stress relieved by heat-treating in accordance with the provisions of the relevant Indian Standard or any other Standard approved by the Engineer.

3.03.05 Welding technique

All complete penetration groove welds made by manual welding, except when produced with the aid of backing material not more than 8 mm thick with root opening not less than one-half the thickness of the thinner part joined, shall have the root of the initial layer gouged out on the back side before welding is started from that side, and shall be so welded as to secure sound metal and complete fusion throughout the entire cross-section. Groove welds made with the use of the backing of the same material, as the base metal shall have the weld metal thoroughly fused with the backing material. Backing strips need not be removed. If required, they may be removed by gouging or gas cutting after welding is completed, provided no injury is done to the base metal and weld metal and the weld metal surface is left flush or slightly convex with full throat thickness.

Groove welds shall be terminated at the ends of a joint in a manner that will ensure their soundness. Where possible, this should be done by use of extension bars or run-off plates. Extension bars or run-off plates need not be removed upon completion of the weld unless otherwise specified elsewhere in the contract.

To get the best and consistent quality of welding, automatic submerged arc process shall be preferred. The technique of welding employed, the appearance and quality of welds made, and the methods of correcting defective work shall all conform to the relevant Indian Standards.

3.03.12 Temperature

No welding shall normally be done on parent material at a temperature below (-) 5°C. However, if welding is to undertaken at low temperature, adequate



TITLE:

TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D17

REV.NO. 0 DATE 13/02/2018

SHEET 24 OF 41

precautions as recommended in relevant Indian Standard shall be taken. When the parent material is less than 40 mm thick and the temperature is between (-) 5°C and 0°C, the surface around the joint to a distance of 100 mm or 4 times the thickness of the material, whichever is greater, shall be preheated till it is hand warm. When the parent material is more than 40 mm thick, the temperature of the area mentioned above shall be in no case be less than 20°C. All requirements regarding preheating of the parent material shall be in accordance with the relevant Indian Standard.

3.03. 13 Peening

Where required, intermediate layers of multiple-layer welds may be peened with light blows from a power hammer, using a round-nose tool, peening shall be done after the weld has cooled to a temperature warm to the hand. Care shall be exercised to prevent scaling or flaking of weld and base metal from over peening.

3.03. 14 Equipment

These shall be capable of producing proper current so that the operator may produce satisfactory welds. The welding machine shall be of a type and capacity as recommended by the manufacturers of electrodes or as may be approved by the engineer.

3.04.00 Finish

Column splices and butt joints of compression members depending on contact for stress transmission shall be accurately machined and close-butt over the whole section with a clearance not exceeding 0.1 mm locally at any place. In column caps and bases, the ends of shafts together with the attached gussets, angles, channels etc; after welding/riveting together, should be accurately machined so that the parts connected butt over the entire surfaces of contact. Care should be taken that those connecting angles of channels are fixed with such accuracy that they are not reduced in thickness by machining by more than 1.0 mm.

3.05.00 Slab bases and caps

Bases and caps fabricated out of steel slabs, except when cut material with true surface, shall be accurately machined over the bearing surface and shall be in effective contact with the end of the stanchion. A bearing face, which is to be grouted direct to a foundation, need not be machined if such face is true and parallel to the upper face.

To facilitate grouting, holes shall be provided, where necessary, in stanchion bases for the escape of air.

 Maharatna Company	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001	
		VOLUME -	
		SECTION - D	SUBSECTION -D17
		REV.NO. 0	DATE 13/02/2018
		SHEET 25	OF 41

3.12.00

Lacing bars

The ends of lacing bars shall be neat and free from burns.

3.13.00

Separators

Rolled section or built-up steel separators or diaphragms shall be required for all double beams except where encased in concrete, in which case, pipe separators shall be used.

3.14.00

Bearing Plates

Provision shall be made for all necessary steel bearing plates to take up reaction of beams and columns and the required stiffeners and gussets whether or not specified in Drawings.

3.15.00

Floor Grating

All grating units shall be rectangular in pattern and of pressure locked assembly. The size and spacing of bearing bars and cross bars shall be as approved in detailed drawings. Alternatively, diamond pattern grating if approved may be used.

The grating shall be made in panel units designed to span as indicated in structural steel framing drawing or as directed by the Engineer.

The grating units shall be finished free from warps, twists, or any other defects. Grating work shall include cutouts and clearance openings for all columns, pipes, ducts, conduits etc. The gratings shall be notched, trimmed, and neatly finished around components of the steel structures encountered. Binding strip shall be provided on the grating to suit the profile. Openings in gratings shall be provided with steel bar toe plates of not less than 5 mm thickness and 100 mm width.

Unless otherwise indicated on drawings, all penetrations of grating units shall be made up in split section, accurately fitted, and neatly finished. Grating units shall be provided with all necessary clips, bolts, lock washers etc. for proper assembly and installation on supporting steel members. Maximum deviation in linear dimension shall not exceed 12 mm.

3.10.00

Chequered Plates

Minimum thickness of chequered plate floorings, covers etc. shall be 6 mm O/P. Chequered plate shall be accurately cut to the required sizes and shapes and the cut edges properly ground. Stiffeners shall be provided wherever required from design consideration.

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 26 OF 41
3.11.00	Architectural Clearances Bearing plates and stiffener connections shall not be permitted to encroach on the designed architectural clearances. 3.11.00 Shop connections a) All shop connections shall be otherwise riveted or welded as specified on the Drawings. b) Heads of rivets on surfaces carrying brick walls shall be flattened to 10 mm thick projection. c) Certain connections, specified to be shop connections, may be changed to field connections if desired by the Engineer for convenience of erection and the contractor will have to make the desired changes at no extra cost to the exchequer. 3.13.00 Castings Steel castings shall be annealed. 3.14.00 Shop erection The steelwork shall be temporarily shop-erected complete or as directed by the Engineer so that accuracy of fit may be checked before dispatch. The parts shall be shop-erected with a sufficient number of parallel drifts to bring and keep the parts in place. In case of parts drilled or punched using steel jigs to make all similar parts interchangeable, the steelwork shall be shop erected in such a way as will facilitate the check of interchange ability.	

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 27 OF 41
3.15.00	Shop painting 3.15.01 General Unless otherwise specified, steelwork, which will be concealed by interior building finish, need not be painted; steelwork to be encased in concrete shall not be painted. Unless specifically exempted, all other steelwork shall be given one coat of shop paint, applied thoroughly and evenly to dry surfaces which have been cleaned, in accordance with the following paragraph, by brush, spray, roller coating, flow-coating or dipping as may be approved by the Engineer. After inspection and approval and before leaving the shop, all steelwork specified to be painted shall be cleaned by hand-wire brushing or by other methods of loose mill scale, loose rust, weld slag or flux deposit, dirt and other foreign matter. Oil and grease deposits shall be removed by the solvent. Steelwork specified to have no shop paint shall, after fabrication, be cleaned of oil or grease by solvent cleaners and be cleaned of dirt and other foreign material by trough sweeping with a fibre brush. 3.15.02 Inaccessible parts Surfaces not in contact, but inaccessible after assembly, shall receive two coats of shop paint, positively of different colours to prove application of two coats before assembly. This does not apply to the interior of sealed hollow sections. 3.15.03 Contact surfaces Contact surface shall be cleaned in accordance with sub-clause 3.13.1 before assembly. 3.15.04 Finished surfaces Machine finished surfaces shall be protected against corrosion by a rust inhibiting coating that can be easily removed prior to erection or which has characteristics that make removal unnecessary prior to erection. 3.15.05 Surfaces adjacent to field welds Unless otherwise provided for, surfaces within 50 of any field weld location shall be free of materials that would prevent proper welding or produce objectionable fumes while welding is being done.	



3.16.00 Galvanizing

3.16.01 General

Structural steelwork for switchyard or other structures as may be specified in the contract shall be hot dip galvanized in accordance with the American Society for Testing and Materials Specification ASTM-A 123 or IS: 2629 - Recommended practice for Hot-Dip Galvanizing of Iron and steel. Where the steel structures are required to be galvanized the field connection materials like bolts, nuts and washers shall also be galvanized.

3.16.02 Surface Preparation

All members to be galvanized shall be cleaned, by the process of pickling of rust, loose scale, oil, grease, slag and spatter of welded areas and other foreign substances prior to galvanizing. Pickling shall be carried out by immersing the steel in an acid bath containing either sulphuric or hydrochloric acid at a suitable concentration and temperature. The concentration of the acid and the temperature of the bath can be varied, provided that the pickling time is adjusted accordingly.

The pickling process shall be completed by thoroughly rinsing with water, which should preferably be warm, so as to remove the residual acid.

3.16.03 Procedure

Galvanizing shall be carried out by hot dip process in a proper and uniformly heated bath. It shall meet all the requirements when tested in accordance with IS: 2633 - Method for testing uniformity of coating on Zinc Coated Articles and IS: 4759 - Specification for Hot-dip zinc coatings on Structural Steel & other allied products.

After finishing the threads of bolts, galvanizing shall be applied over the entire surface uniformly. The threads of bolts shall not be machined after galvanizing and shall not be clogged with zinc. The threads of nuts may be tapped after galvanizing but care shall be taken to use oil in the threads of nuts during erection.

The surface preparation for galvanizing and the process of galvanizing itself, shall not adversely affect the mechanical properties of the materials to be galvanized. Where members are of such lengths as to prevent complete dipping in one operation, great care shall be taken to prevent warping.

Materials on which galvanizing has been damaged shall be acid stripped and re-galvanized unless otherwise directed, but if any member becomes damaged after leaving been dipped twice, it shall be rejected. Special care shall be taken



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 29 OF 41

not to injure the skin on galvanized surfaces during transport, handling, and erection. Damages, if occur, shall be made good in accordance or as directed by the Engineer.

4.00.00 INSPECTION, TESTING, ACCEPTANCE CRITERIA AND DELIVERY

4.01.00 Inspection

Unless specified otherwise, inspection to all, work shall be made by the or Engineer's representative at the place of manufacture prior to delivery. The Engineer or his representative shall have free access at all reasonable times to those parts of the manufacturer's works which are concerned with the fabrication of the steelwork under this Contract and he shall be afforded all reasonable facilities for satisfying himself that the fabrication is being done in accordance with the provisions of this Specification.

The Contractor shall provide free of charge, such labour, materials, electricity, fuel, water, stores, tools and plant, apparatus and instruments as may be required by the Engineer to carry out inspection and/or tests in accordance with the Contract. The Contractor shall guarantee compliance with the provisions of this Specification.

4.02.00 Testing and Acceptance Criteria

4.02.01 General

The Contractor shall carry out sampling and testing in accordance with the relevant Indian Standards and as supplemented herein for the following items at his own Cost. The Contractor shall get the specimens tested in a laboratory approved by the Engineer and submit to the Engineer the test results in triplicate within 3 (three) days after completion of the test.

4.02.02 Steel

All steel supplied by, the Contractor shall conform, to the relevant Indian Standards. Except otherwise mentioned in the contract, only tested quality steel having mill test reports shall be used. In case unidentified steel materials are permitted to be used by the Engineer, random samples of materials will be taken from each unidentified lot of 50 M.T or less of any particular section for tests to conform to relevant Indian Standards. Cost of all tests shall be born by the contractor.

All material shall be free from all imperfections, mill scales, slag intrusions, laminations, fittings, rusts etc. that may impair their strength, durability, and appearance.



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D

SUBSECTION - D17

REV.NO.

0

DATE

13/02/2018

SHEET

30

OF

41

4.02.02

Welding

- a) The weld surface shall be cleaned with steel wire brush to remove spatter metal, slag etc. and 100% of welds shall be inspected visually for size, length of weldment and external defects. Weld gauges shall be used for checking weld sizes. The surface shall be clean with regular beads and free from slags, cracks, blow-holes etc.
- b) Non-destructive examination shall be carried out to determine soundness of weldments as follows:
 - i) 10% at random on fillet-joints.
 - ii) 100% on all butt-joints.
- c) Should the ND tests indicate defects like improper root penetration, extensive blowholes, slag intrusion etc., such welds shall be back gauged, joints prepared again and rewelded. All defects shall be rectified by the Contractor at no extra costs.
- d) All electrodes shall be procured from approved reputed manufacturers with test certificates. The correct grade and size of electrode, which has not deteriorated in storage, shall be used. The inspection and testing of welding shall be performed in accordance with the provisions of the relevant Indian Standards or other equivalents. For every 50 tones of welded fabrication, the Engineer may ask for 1(one) test-destructive or non-destructive including X -ray, ultrasonic test or similar, the cost of which shall be borne by the Contractor.

4.02.04

Rivets, bolts, nuts and washers

All rivets, bolts, nuts, and washers shall be procured from M/s. Guest Keen William Ltd. or equivalent and shall confirm to the relevant Indian Standards. If desired by the Engineer, representative samples of these materials may have to be tested in an approved laboratory and in accordance with the procedures described in relevant Indian Standards. Cost of all such testing shall have to be borne by the Contractor. In addition to testing the rivets by hammer, 2% (two per cent) of the rivets done shall have to be cut off by chisels to ascertain the fit, quality of material and workmanship. The removal of the cut rivets and re-installing new rivets shall be done by the Contractor at his own cost.

4.02.05

Shop painting

All paints and primers shall be of standard quality and procured from approved manufacturers and shall conform to the provisions of the relevant Indian Standards.

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 31 OF 41
4.02. 12	Galvanizing All galvanizing shall be uniform and of standard quality when tested in accordance with IS: 2633 - Method for testing uniformity of coating on Zinc Coated Articles and 15: 4759 - specification for Hot-Dip Zinc Coatings on Structural Steel & other allied products. 4.03.00 Tolerance The tolerances on the dimensions of individual rolled steel components shall be as specified in IS: 1852 - specification for rolling and Cutting Tolerances for Hot-rolled Steel Products. The tolerances on straightness, length etc. of various fabricated components (such as beams and girders, columns, crane gantry girder etc.) of the steel structures shall be as specified in IS: 721 - Tolerances for Fabrication of Steel Structures. 4.04.00 Acceptance Should any structure or part of a structure be found not to comply with any of the provisions of this specification, the same shall be liable to rejection. No Structure or part of the structure once rejected, shall be offered again for test, except in cases where the Engineer considers the defects rectifiable. The Engineer may, at his discretion, check some of the tests at an appropriate laboratory at the contractors cost. When all tests to be performed in the Contractor's shop under the terms of this contract have been successfully carried out, the steelwork will be accepted forthwith and the Engineer will issue acceptance certificate, upon receipt of which, the items will be shop painted, packed and dispatched. No item to be delivered unless an acceptance certificate for the same has been issued. The satisfactory completion of these tests or the issue of the certificates shall not bind the Owner to accept the work, should it, on further tests before or after erection, be found not in compliance with the Contract. 4.05.00 Delivery of materials 4.05.01 General The Contractor will deliver the fabricated structural steel materials to site with all necessary field connection materials in such sequence as will permit the most efficient and economical performance of the erection work. The Owner may prescribe or control the sequence of delivery of materials, at his own discretion.	

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 32 OF 41
4.05.02	Marking Each separate piece of fabricated steelwork shall be distinctly marked on all surfaces before delivery in accordance with the markings shown on approved erection drawings and shall bear such other marks as will further facilitate identification and erection. 4.05.03 Shipping Shipping shall be strictly in accordance with the sequence stipulated in the agreed Programme. Contractor shall dispatch the materials to the e worksite securely protecting and packing the materials to avoid loss or damage during transport by rail, road or water. All parts shall be adequately braced to prevent damage in transit. Each bundle, bale or package delivered under this contract shall be marked on as many sides as possible and such distinct marking (all previous irrelevant markings being carefully obliterated) shall show the following: a) Name and address of the consignee b) Name and address of the consignor c) Gross weight of the package in tonnes and its dimensions d) Identification marks and/or number of the package e) Custom registration number, if required All markings shall be carried out with such materials as would ensure quick drying and indelibility. Each component or part or piece of material when shipped, shall be indelibly marked and/or tagged with reference to assembly drawings and corresponding piece numbers. Each packing case shall contain in duplicate in English a packing list pasted on to the inside of the cover in a water-proof envelope, quoting especially - a) Name of the Contractor b) Number and date of the Contract c) Name of the office placing the contract d) Nomenclature of stores	



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 33 OF 41

- e) A schedule of parts or pieces, giving the parts or piece number with reference to assembly drawings and the quantity of each.

The shipping dimensions of each packing shall not exceed the maximum dimensions permissible for transport over the Indian Railways/Roads.

After delivery of the materials at site, all packing materials shall automatically become the property of the Owner.

Notwithstanding anything stated hereinbefore, any loss or damage resulting from inadequate packing shall be made good by the Contractor at no additional cost to the Owner. When facilities exist, all shipments shall be covered by approved Insurance Policy for transit at the cost of the Contractor.

The contractor shall ship the complete materials or part on board a vessel belonging to an agency approved by the Owner or on rail and/or road transport as directed. The Contractor shall take all reasonable steps to ensure correct appraisal of freight rates, weights and volumes and in no case will the Owner be liable to pay any warehouse, wharfage, demurrage and other charges.

If, however, the Owner has to make payment of any of the above-mentioned charges, the amount paid will be deducted from the bills of the Contractor.

Necessary advice regarding the shipment with relevant details shall reach the Engineer at least a week in advance.

5.00.00 INFORMATION TO BE SUBMITTED

5.01.00 With Tender

The following information is required to be submitted with the Tender:

- a) Progress Schedule

The Contractor shall quote in his Tender a detailed schedule of progress of work and total time of completion, itemizing the time required for each of the following aspects of work.

- i) Preparation and approval of fabrication drawing
- ii) Procurement of Materials
- iii) Fabrication and shipping of all anchor bolts
- iv) Fabrication and shipping of main steelwork.



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 34 OF 41

v) Fabrication and shipping of steelwork for bunkers, tanks and/or silos as applicable.

vi) Fabrication and shipping of all other remaining steelwork including miscellaneous steelwork.

vii) Final date of completion of all shipments.

b) Shop

Location of the Tenderer's fabrication workshop giving details of equipment, manpower, the total capacity, and the capacity that will be available exclusively for this contract shall be submitted.

5.02.00

After Award

After award of the Contract the successful Tenderer is to submit the following:

- a) Complete fabrication drawings, material lists, cutting lists, rive and bolt lists, field welding schedules based on the approved design drawings prepared by him in accordance with the approved schedule.
- b) Monthly Progress Report with necessary photographs in six (6) copies to reach the Engineer on or before the 7th day o. each month, giving the up-to-date status of preparation of detailed shop drawings, bill of materials, procurement of materials, actual fabrication done, shipping and all other relevant information.
- c) Detailed monthly material reconciliation statements relevant to the Work done and reported in the Progress Report, giving the stock at hand of raw steel, work in progress, finished materials.
- d) Results of any test as and when conducted and as require by the engineer.
- e) Manufacturer's mill test report in respect of steel materials, rivets, bolts, nuts, and electrodes as may be applicable.

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 35 OF 41
6.00.00	RATES AND MEASUREMENT	
6.01.00	Rates	
6.01.01	The items of work in the Schedule of items describe the work in brief. The various items of the Schedule of items shall be read in conjunction with these specifications including amendments and additions, general conditions of contract, special conditions of contracts, and other tender documents, if any. For each item of Schedule of Items, the bidder's rates shall include the activities covered in the description of the item as well as all necessary operations described in the Specifications.	
6.01.02	The bidder's rates shall include cost of all minor details which are obviously and fairly intended and which may not have been included in the description in these documents but are essential for the satisfactory completion of the work. Rates shall also include for taking all safety measures.	
6.01.03	The bidder's -rates for all items of schedule of items shall include complete cost towards plant, equipment, erection and dismantling of scaffolding, men, materials and consumables, skilled and unskilled labour, levies, taxes, royalties, duties, transport, storage, repair/rectification/maintenance until handing over, contingencies, overhead and all incidental items not specifically mentioned but reasonably implied and necessary to complete the work.	
6.01.04	No claims shall be entertained, if the details shown on the 'Released for Construction' drawings differ from those shown on the bid/tender drawings.	
6.01.05	Rates shall be inclusive of all leads and lifts/elevation.	
6.01.06	The bidder's rates for Structural Steel shall include for fabrication and erection, transportation to site, preparation checking collecting and distributing of the fabrication drawings and design calculations, erection scheme, alignment, welding, including preheating and post heating, testing of welders, inspection of welds, visual inspection, non destructive and special testing, rectification and correction of defective welding works, production test plate, inspection and testing, erection scheme, protection against damage in transit, stability of structures, etc. The rates shall also be inclusive of providing and installing temporary structures, transport of Owner issue material from store, return of surplus/waste steel materials including cut pieces'/waste steel, provision of additional butt/weld joint to reduce the wastage and all other general, special, such requirements as may be required, for the successful completion of the work.	

 BHEL Bharat Heavy Electricals Limited	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 36 OF 41
	The rates for fabrication are inclusive of all tests on welds and material and no extra shall be payable for quality tests specified for fabrication of structure in shop or at site. Separate BOQ items for test on welds like radiography or Ultrasonic, DPT, magnetic particle tests are kept for tests on material/fabrication not covered under regular fabrication item of BOQ. 6.01.07 The bidder's rates for foundation bolts assembly shall include fabrication, threading, heat treatment, erection, installation, and alignment of complete bolt assembly with nuts, locknuts, anchor plates, stiffener plates, protective tape, etc. This shall also include the cost of all materials not issued by the Owner. Material issued by Owner will be specified in GCC. 6.01.08 The bidder's rates for application of inorganic primer shall include surface preparation to near white metal surface by blast cleaning, abrasives, touch up painting, suitable enclosure to avoid contamination and the necessary statutory approval from the factory inspector/pollution control board etc. regarding the method of blast cleaning and abrasives used, and getting approval of the specialized agency supplying the primer specified. 6.01.09 The bidder's rates for application of finish painting system shall include surface preparation, application of intermediate (under) coat, finish coat and final finish coat, and getting approval of the specialized agency supplying the finish paint. 6.01.10 The bidder's rates for electro-forged gratings (if specified) shall include supply, fabrication, transportation to the site, erection and alignment of factory made electro-forged gratings, all taxes, duties thereon etc. The rates shall also include preparation of grating design for different spans and load intensifies, preparation of design and fabrication drawings, edge preparation, blast cleaning followed by finish paint. 6.01.11 The bidder's rates for galvanization of factory made electro-forged gratings (if specified) shall include the application of hot dipped galvanization as finish over the fabricated gratings and the treatment to be given for prevention of white storage stains, as per the technical Aspiration. 6.01.12 The bidder's rates for permanent mild steel bolts, nuts and washers shall include the supply and fixing of such bolts, nuts and washers in position, for various types of Structural Steel works, as per the technical specification. 6.01.13 The bidder's rates for high strength structural bolts, nuts and washers shall include the supply and fixing of such bolts, nuts and washers in position, for various types, of Structural Steel works, as per the technical specification.	

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 37 OF 41
6.01.14	The bidder's rates for dismantling, additions to, alterations in and/or modifications shall be inclusive of all operations such as lowering of material, carriage etc., as mentioned in the technical specification. Unutilised steel pieces cut/removed shall be returned to the project stores free of charge. Non-return of unutilized steel pieces to the Owner's store would be considered as wastage and recovery would be affected as per the provision of contract for structural steel consumption. This shall not include the weight of temporarily dismantled/supported members, connected member. The bidder should prepare an optimised cutting plan as per fabrication drawing to utilise the steel material upto maximum extent and minimise the wastage/scrap. Quantity of wastage/scrap of material should be limited to the percentage mentioned elsewhere in the conditions of tender/contract specifications. 6.01.15 The bidder's rates for re-erection of erection marks after additions to, alterations in and/or modifications shall be inclusive of all operations mentioned in technical specification for the calculated weight of the rectified/modified erection mark rejected at site. This shall not include the weight of temporarily dismantled/supported members, connected member. All the operations mentioned above for restoring such members shall be carried out at no extra cost. The work of erection of any erection mark which has not been dismantled but have been modified/rectified before erection shall not be paid under this item but shall be paid under relevant item of fabrication and erection of steel work of Schedule of items for the modified weight. 6.01.16 The bidder's rates for PTFE shall include design, supply, transportation of the complete assembly with guides and dust protection cover and installation of bearings in position drilling, bolting, erecting aligning etc. along with any taxes, duties thereon etc. 6.01.17 The bidder's rates for Stainless Steel hopper (if specified) shall include fabrication and erection, transportation to site, preparation checking collecting and distributing of the fabrication drawings and design calculations, all other operations mentioned in the technical specification. The rates shall also include for erection scheme, alignment, making cutting plan, cutting, jointing, bending, rolling, grinding, drilling, bolting, assembly, edge preparation, welding including pre-heating, post-heating, testing of welders, inspection of welds, inspection and testing, protection against damage in transit, stability of structures, installation of temporary structures etc. The rates shall also be inclusive of providing and installing temporary structures, transport of Owner issue material from store, return of surplus / waste steel materials including cut pieces/waste steel, provision of additional butt / weld joint to reduce the wastage and all other general, special, such requirements as may be required, for the successful completion of the work.	

	TITLE: TECHNICAL SPECIFICATION FOR FABRICATION OF STRUCTURAL STEEL WORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION -D17 REV.NO. 0 DATE 13/02/2018 SHEET 39 OF 41
	from assumed minimum circumscribing rectangular area for the purpose of payment. 6.02.07 No deduction shall be made for the hole in the members, if the area of individual hole is less than 0.05 sq.m. The weight shall be calculated by deducting the area of holes, if area of individual hole is more than 0.05 sq.m. 6.02.08 All cut-pieces and scrap generated due to cutting of holes, skew-cuts of plates, gussets, brackets, stiffeners, etc. shall be stacked separately and handed over to the project stores without being considered for material accounting as the circumscribing rectangle has been considered for payment. 6.02.09 The splice plate shown in the fabrication drawing or approved by the Engineer shall only be measured for payment. 6.02.10 The weight of permanent bolts, washers and nuts and welds shall not be included in the weights of the members. No extra payment shall be made for welding/bolting. 6.02.11 The bolts and nuts required for erection purpose shall not be paid for and may be taken away by the Contractor after final welding for members. Erection boltholes left after removal of erection bolts shall be suitably plugged with welds. 6.02.12 The measurement for the item of application of inorganic primer including blast cleaning of steel surfaces shall be based on the weight on which the zinc silicate primer is applied, after blast cleaning in Metric Tonne, corrected to third place of decimal. The weight shall be the weight as approved, for erection mark/element of the mark painted, for payment of the item of fabrication and erection of structural steel works. 6.02.13 The measurement for the item of application of finish primer system shall be based on the weight on which the epoxy based finish primer is applied in Metric Tonne, corrected to third place of decimal. The weight shall be the weight as approved, for erection mark/element of the mark painted, for payment of the item of fabrication and erection of structural steel works. 6.02.14 The measurement for the item of gratings shall be based on the actual weight in Kgs, corrected to second place of decimal, as supplied by the Contractor, and accepted by the Engineer. Nothing extra shall be payable for making cutouts, notches, openings of any profile, trimming profiles etc. in the grating units. 6.02.15 The measurement for the item of hot dipped galvanization of gratings shall be based on the actual weight in Kgs, corrected to second place of decimal of gratings galvanized by the Contractor and accepted by the Engineer.	



TITLE:

**TECHNICAL SPECIFICATION FOR
FABRICATION OF STRUCTURAL
STEEL WORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION -D17

REV.NO. 0 DATE 13/02/2018

SHEET 41 OF 41

6.02.26

The measurement for the item of Stainless Steel Hand Railing shall be based on finished weight of handrail in Kgs corrected to second place of decimal. The weight shall also include the weight of Stainless Steel fasteners, Stainless Steel beading, Stainless Steel cleats etc. The weight shall be the finished weight of Hand Rail, as accepted by the Engineer.



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 1 OF 17

**SECTION - D
(PART I)**

SUB-SECTION – D 18

ERECTION OF STRUCTURAL STEELWORK



Bharat Heavy Electricals Limited
Project Engineering Management
PPEI Building, Power Sector,
Plot No. 25, Sector 16A,
Noida (U.P.)-201301



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 2 OF 17

C O N T E N T

CLAUSE NO.	DESCRIPTION	SHEET NO.
1.00.00	SCOPE	3
2.00.00	GENERAL	3
3.00.00	WORKMANSHIP	6
4.00.00	TESTING AND ACCEPTANCE CRITERIA	12
5.00.00	INFORMATION TO BE SUBMITTED	16



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 3 OF 17

SUB-SECTION – D 18

ERECTION OF STRUCTURAL STEELWORK

1.00.00 SCOPE

This specification covers the erection of structural steelwork including receiving and taking delivery of fabricated structural steel materials arriving at site, installing the same in position, painting and grouting the stanchion bases all complete as per Drawings, this Specification and other provision of the Contract.

2.00.00 GENERAL

2.01.00 Work to be provided for by the Contractor, unless otherwise specified in the Contract, shall include but not be limited to the following:

- a) The Contractor shall provide all construction and transport equipment, tools, tackle, consumables, materials, labour, and supervision required for erection of the structural steelwork.
- b) Receiving, unloading, checking, and moving to storage yard at Site including prompt attendance to all insurance matters as necessary for all fabricated steel materials arriving at Site. The Contractor shall pay all demurrage and/or wharfage charges etc. on account of default on his part.
- c) Transportation of all fabricated structural steel materials from Site storage yard, handling, rigging, assembling, riveting, bolting, welding and satisfactory installation of all fabricated structural steel materials in proper location according to approved erection drawings and/or as directed by the Engineer. If necessary suitable temporary approach roads to be built for transportation of fabricated steel structures.
- d) Checking centre lines, levels of all foundation blocks including checking line, level, position and plumb of all bolts and pockets. Any defect observed in the foundation shall be rectified with Engineer's approval. The Contractor shall fully satisfy himself regarding the correctness of the foundations before installing the fabricated steel structures on the foundation blocks.
- e) Aligning, plumbing, levelling, riveting, bolting, welding and securely fixing the fabricated steel structures including floor gratings, chequered plates etc. in accordance with the Drawings or as directed by the Engineer.
- f) Painting of the erected steel structures.



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 4 OF 17

g) All minor modifications of the fabricated steel structures as directed by the Engineer including but not limited to the following:

- i) Removal of bends, kinks, twists etc. for parts damaged during transport and handling.
- ii) Cutting, chipping, filling, grinding, etc. if required for preparation and finishing of site connections.
- iii) Reaming of holes for use of higher size rivet or bolt if required.
- iv) Refabrication of parts damaged beyond repair during transport and handling or refabrication of parts, which are incorrectly fabricated.
- v) Fabrication of parts omitted during fabrication by error, or subsequently found necessary.
- vi) Drilling of holes which are either not drilled at all or are drilled in incorrect location during fabrication.
- vii) Carry out tests in accordance with this specification.

2.02.00 Work by Others

No work under this Specification will be provided for by any agency other than the Contractor unless specifically mentioned elsewhere in the contract.

2.03.00 Codes and Standards

All work under this Specification shall, unless specified otherwise, conform to the latest revisions and/or replacements of the following or any other Indian Standard Specification and codes of Practice of equivalent:

IS: 800 - Code of practice for general construction in steel.

IS: 456 - Code of practice for main or reinforced concrete.

2.04.00 Conformity with Designs

The Contractor will erect the entire fabricated steel structure, align all the members, complete all field connections and grout the foundations all as per the provisions of this specification and the sequence and the design criteria laid down by the Engineer. All work shall conform to the provisions of this specification and /or instructions of the engineer. The testing and acceptance of the erected structures shall be in accordance with the provisions of this Specifications and/or the instructions of the Engineer.

	TITLE: TECHNICAL SPECIFICATION FOR ERECTION OF STRUCTURAL STEELWORK	SPECIFICATION NO. PE-TS-635-600-C001 VOLUME - SECTION - D SUBSECTION – D18 REV.NO. 0 DATE 13/02/2018 SHEET 5 OF 17
2.05.00	Material	
2.05.01	General	
	All fabricated steel structures and connection materials shall be supplied by the Contractor to the site. The Contractor shall take delivery from railway wagons or trucks at site, and unload the materials and perform all formalities like checking of materials and attend to insurance matters in accordance with Sub-Clause 2.01.00 and as specified hereinbefore.	
2.05.02	Materials to conform to Indian standards	
	All materials required to be supplied by the Contractor under this contract shall conform to the relevant Indian Standard specifications.	
2.06.00	Storage of Materials	
2.06.01	General	
	All material shall be so stored as to prevent deterioration and to ensure the preservation of their quality and fitness for use in the works. Any material which has been deteriorated or damaged beyond repairs and has become unfit for use shall be removed immediately from the site, failing which, the engineer shall be at liberty to get the materials removed by agency and the cost incurred thereof shall be realised from the Contractor's dues.	
2.06.02	Yard	
	The Contractor will have to establish a suitable yard in an approved location at site for storing the fabricated steel structures and other raw steel materials such as structural sections and plates as required. The yard shall have facilities like drainage, lighting, and suitable access for large cranes, trailers, and other heavy equipments. The yard shall be fenced all around with security arrangement and shall be of sufficiently large area to permit systematic storage of the fabricated steel structures without overcrowding and with suitable access for cranes, trailers and other equipment for use in erection work in proper sequence in accordance with the approved Programme of work.	
	The Tenderer must visit the site prior to submission of his tender to acquaint himself with the availability of land and the development necessary by way of filling, drainage, access roads, fences, sheds etc. all of which shall be carried out by the Contractor at his own cost as directed by the Engineer.	



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 6 OF 17

2.06.03 Covered Store

All field connection materials, paints, cement etc. shall be stored on well designed racks and platforms off the ground in a properly covered store building to be built at the cost of the Contractor.

2.07.00 Quality Control

The contractor shall establish and maintain quality control procedures for different items of work and materials as may be directed by the Engineer to assure compliance with the provisions of the Contract and shall submit the records of the same to the Engineer. The quality control operation shall include but not be limited to the Following items of work:

- i) Erection: Lines, levels, grades, plumbs, joint characteristics including tightness of bolts.
- ii) Grouting: Cleaning and roughness of foundation, quality of materials used for grouting, admixtures, consistency, and strength of grout.
- iii) Painting: Preparation of surface for painting, quality of primers and paints, thinners, application and uniformity of coats.

2.08.00 Taking Delivery

The Contractor shall take delivery of fabricated structural steel and necessary connection materials from railhead/trucks as may be necessary and as directed by the Engineer. He shall check, unload; transport the materials to his stores for proper storing at his own cost. The Contractor shall submit claims to insurance or other authorities and pursue the same in case of loss or damage during transit and handling and all loss thereof shall be borne by him.

The Contractor shall also take all precautions against damage of the materials in his custody after taking delivery and till the same are erected in place and accepted. The Contractor shall salvage, collect, and deliver all the packing materials to the Owner free of charge.

3.00.00 WORKMANSHIP

3.01.00 Erection

3.01.01 Plant and Equipment

The suitability and adequacy of all erection tools and plant and equipment proposed to be used shall be thoroughly verified. They shall be efficient, dependable, in good working condition and shall have the approval of the Engineer.



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 7 OF 17

3.01.02 Method and sequence of erection

The method and sequence of erection shall have the prior approval of the Engineer. The Contractor shall arrange for most economical method and sequence available to him consistent with the drawings and specifications and other relevant stipulations of the contract.

3.01.03 Temporary Bracing

Unless adequate bracing is included as a part of the permanent framing, the erector during erection shall install, free of cost to the Owner, temporary guys and bracings where needed to secure the framing against loads such as wind or seismic forces comparable in intensity to that for which the structure has been designed, acting upon exposed framing as well as loads due to erection equipment and erection operations.

If additional temporary guys are required to resist wind or seismic forces acting upon components of the finished structure installed by others during the course of the erection of the steel framing, arrangement for their installation by the erector shall be made free of cost to the Owner.

The requirement of temporary bracings and guys shall cease when the structural steel is once located, plumbed, levelled, aligned, and grouted within the tolerances permitted under the specification and guyed and braced to the satisfaction of the Engineer.

The temporary guys, braces, false work, and cribbing shall not be the property of the Owner and they may be removed immediately upon completion of the steel erection.

3.01.04 Temporary Floors for Buildings

It shall be the responsibility of the Contractor to provide free of cost planking and to cover such floors during the work in progress as may be required by any Act of Parliament and/or bylaws of state, Municipal or other local authorities.

3.01.05 Setting Out

Positioning and levelling of all steelwork, plumbing of stanchions and placing of every part of the structure with accuracy shall be in accordance with the approved Drawings and to the satisfaction of the Engineer. For heavy columns, etc. the Contractor shall set proper screed bars to maintain proper level. No extra payment shall be made for this.



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 8 OF 17

Each tier of column shall be plumbed and maintained in a true vertical position subject to the limits of tolerance under this Specification.

No permanent field connections by riveting, bolting or shall be carried out until proper alignment and plumbing has been attained.

3.01.06 Field Riveting

All rivets shall be heated and driven with pneumatic tools. Hand passing or "throwing" of rivets are desirable. Any other method of conveying hot rivets from the furnace to the driving point must be approved by the engineer. No-cold rivets shall be driven. All other requirements of riveting including quality and acceptance criteria shall be in accordance with the relevant portions of the Specification for Fabrication of Structural Steelwork of the Project.

3.01.07 Field Bolting

All relevant Portions in respect of bolted construction of the Specification for Fabrication of Structural Steelwork applicable to the Project shall also be applicable for field bolting in addition to the following:

Bolts shall be inserted in such a way so that they may remain in position under gravity even before fixing the nut. Bolted parts shall fit solidly together when assembled and shall not be separated by gaskets or any other interposed compressible materials. When assembled, all joint surfaces, including those adjacent to the washers shall be free of scales except tight mill scales. They shall be free of dirt, loose scales, burns, and other, defects that would prevent solid seating of the parts. Contact surfaces within friction type joints shall be free of oil, paint, lacquer, or galvanizing.

All high tensile bolts shall be tightened to provide, when all fasteners in the joint are tight, the required minimum bolt tension by any of the following methods.

a) Turn-of-nut Method

When the turn-of-nut method is used to provide the bolt tension, there shall first be enough bolts brought to a "snug tight" condition to ensure that the parts of the Joint are brought into good contact with each other. 'Snug tight' is defined as the tightness attained by a few impacts of an impact wrench or the full effort of a man using an ordinary spud wrench. Following this initial operation, bolts shall be placed in any remaining holes in the connection and brought to snug tightness. All bolts in the joint shall then be tightened additionally by the applicable amount of nut rotation specified in Table-I with tightening progressing systematically from the most rigid part of the joint to its free edges. During this operation



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 9 OF 17

there shall be no rotation of the part not turned by the wrench.

TABLE-I

Bolts length not exceeding 8 times Dia or 200 mm	Bolt length exceeding 8 times Dia or 200 mm	Remarks
1/2 turn	2/3 turn	Nut rotation is relative to bolt regardless of the element (nut or bolt) being turned. Tolerance on rotation-30° over or under.

Bolts may be installed without hardened washers when tightening is done by the turn -of-nut -method. However, normal washers shall be used.

Bolts tightened by the turn-of-nut method may have the outer face of the match-marked with the protruding bolt point before final tightening, thus affording the inspector visual means of noting the actual nut rotation. Such marks can be made by the wrench operator by suitable means after the bolts have been brought up snug tight.

b) Torque Wrench Tightening

When torque wrenches are used to provide the bolt tensions, the bolts shall be tightened to the torques specified in TABLE-II (See Note below the Table). Nuts shall be in tightening motion when torque is measured. When using torque wrenches to install several bolts in a single joint, the wrench shall be returned to touch up bolts previously tightened, which may have been loosened by the tightening of subsequent bolts, until all are tightened to the required tension.

TABLE-II

Nominal Bolt Diameter (mm) (Kg.M) of IS:1367	Torque to be applied for bolt class 8.8
20	59.94
22	81.63
24	103.73



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 10 OF 17

Note: The above torque values are approximate for providing tensions of 14.7 T for 20 mm dia.; and 21.2 T for 24 mm dia. bolts under moderately lubricated condition. The torque wrench shall be calibrated at least once daily to find out the actual torque required to produce the above required tension in the bolt by placing it in a tension indicating device. These torques shall be applied for tightening the bolts on that day with the particular wrench.

In either of the above two methods, if required, for bolt entering and wrench operation clearances, tightening may be done by turning the bolt while the nut is prevented from rotating.

Impact wrenches if used shall be of adequate capacity and sufficiently supplied with air to perform the required tightening of each bolt in approximately ten seconds. Holes for turned bolts to be inserted in the field shall be reamed in the field. All drilling and reaming for turned bolts shall be done only after the parts to be connected are assembled. Tolerances applicable in the fit of the bolts shall be in accordance with relevant Indian Standard Specifications. All other requirements regarding assembly and bolt tightening shall be in accordance with this sub clause.

3.01.08 Field Welding

All field assembly and welding shall be carried out in accordance with the requirements of the specification for fabrication work applicable to the project, excepting such provisions therein which manifestly apply to shop conditions only. Where the fabricated structural steel members have been delivered painted, the paint shall be removed before field welding for a distance of at least 50 mm on either side of the joints.

3.01.09 Holes, Cutting and Fitting

No cutting of sections, flanges, webs, cleats, rivets, bolts, welds etc. shall be done unless specifically approved and /or instructed by the Engineer.

The erector shall not cut, drill, or otherwise alter the work of other trades, unless such work is clearly specified in the Contract or directed by the Engineer. Wherever such work is obtain specified the Contractor shall obtain complete information as to size, location and number of alterations prior to carrying out any work. The Contractor shall not be entitled for any payment on account of any such work.

3.02.00 Drifting

Correction of minor misfits and reasonable amount of reaming and cutting of excess stock from rivets will be considered as permissible. For this, light drifting may be used to draw holes together and drills shall be used to enlarge



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 11 OF 17

holes as necessary to make connections. Reaming, that weakens the member or makes it impossible to fill the holes properly or to adjust accurately after reaming, shall not be allowed.

Any error in shop work which prevents the proper assembling and fitting of parts by moderate use of drift pins and reamers shall immediately be called to the attention of the Engineer and approval of the method of correction obtained. The use of gas cutting torches at erection site is prohibited.

3.03.00 Grouting of stanchion bases and bearings of beams and girders on stone, brick or concrete (Plain or reinforced)

Grouting shall be carried out with Ordinary Cement grout as described below:

The mix shall be one (1) part cement and one (1) part sand and just enough water to make it workable. The positions to be grouted shall be cleaned thoroughly with compressed air jet and wetted with water and any accumulated water shall be removed. These shall be placed under expert supervision, taking care to avoid air locks. Edges shall be finished properly. If the thickness of grout is 25 mm or more, two (2) parts of 6 mm down graded stone chips may be added to the above noted cement-sand grout mix, if required, by the Engineer or shown on the drawings.

No grouting shall be carried out until a sufficient number of bottom lengths of stanchions have been properly lined, leveled, and plumbed and sufficient floor beams are tied in position.

Whatever method of grouting is employed, the operation shall not be carried out until the steelwork has been finally levelled and plumbed, the stanchion bases being supported meanwhile by steel wedges, and immediately before grouting, the space under steel shall be thoroughly cleaned.

If required by the Engineer, certain admixtures like aluminium powder, "ironite" or equivalent, may be required to be added to the grout to enhance certain desirable properties of the grout. Approved non-shrink pre-mixed grout having required flowability and compressive strength may also be used with Engineer's approval.

3.04.00 Painting after Erection

Field painting shall only be done after the structure is erected, levelled, plumbed, aligned and grouted in its final position, tested and accepted by the Engineer. Normally, final painting shall be done only after the floor slabs are concreted and masonry walls are built. However, touch up painting, making good any damaged shop painting and completing any unfinished portion of the shop coat shall be carried out by the Contractor free of cost to the Owner. The materials and specification for such painting in the field shall be in accordance



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 12 OF 17

with the requirements of the specification for fabrication of structural steelwork applicable for the project.

Painting shall not be done in frosty or foggy weather or when humidity is such as to cause condensation on the surfaces to be painted. Before painting of steel, which is delivered unpainted, is commenced, all surfaces to be painted shall be dried and thoroughly cleaned from all loose scale and rust.

All field rivets, bolts, welds, and abrasions to the shop coat shall be spot painted with the same paint used for the shop coat. Where specified, surfaces, which will be in contact after site assembling, shall receive a coat of paint (in addition to the shop coat, if any) and shall be brought together while the paint is still wet.

Surface, which will be inaccessible after field assembly shall receive the full, specified protective treatment before Bolts and fabricated steel members who are galvanized or otherwise treated and steel members to be encased shall not be painted.

The final painting shall be of tow coats of Synthetics Enamel painting or Aluminium paint of approved manufacture as per the approved "Schedule of Painting". The shades shall also be as per the approved schedule. Synthetic enamel paint shall conform to IS: 2932.

3.05.00 Final cleaning up

Upon completion of erection and before final acceptance of the work by the Engineer, the contractor shall remove free of cost all false work, rubbish and all Temporary Works resulting in connection with the performance of his work.

4.00.00 TESTING AND ACCEPTANCE CRITERIA

4.01.00 General

Loading tests shall be carried out on erected structures, if required by the Engineer, to check adequacy of fabrication and/or erection. Any structure or a part thereof found to be unsuitable for acceptance as a result of the test shall have to be dismantled and replaced with suitable member as per the Contract and no payment towards the cost of the dismantled portion and any connected work shall be made to the contractor. In course of dismantling, if any damage is done to any other parts of the structure or to any fixtures, the same shall be made good free of cost by the Contractor, to the satisfaction of the Engineer. The Cost of the tests specified hereinafter shall be borne by the Owner; but if the structure fails to pass the tests, the cost of the tests shall be recovered from the Contractor. Any extra claim due to loss of time, idle labour, etc. arising out of these testing operations shall not be entertained, however, only reasonable



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 13 OF 17

and appropriate time extensions will be allowed.

The structure or structural member under consideration shall be loaded with its actual dead load for as long a time as possible before testing and the tests shall be conducted as indicated in the following sub-clauses 4.01.01, 4.01.02 and 4.01.03. The method of testing and application of loading shall be as approved by the Engineer.

4.01.01 Stiffness Test

In this test, the structure or member shall be subjected, addition to its actual dead load, to a test load equal to 1.5 times the specified superimposed load, and this loading shall be maintained for 24 hours. The maximum deflection attained during the test shall be within the permissible limit. If, after removal of the test load, the member or structure does not show a recovery of at least 80 per cent of the maximum strain or deflection shown during 24 hours under load, the test shall be repeated. The structure or member shall be considered to have sufficient stiffness, provided that the recovery after this second test is not less than 90 per cent of the maximum increase in strain or deflection recorded during the second test.

4.01.02 Strength Test

The structure or structural member under consideration shall be subjected, in addition to its actual dead load, to a test load equal to the sum of the dead load and twice the specified superimposed load, and this load shall be maintained for 24 hours.

In the case of wind load, a load corresponding to twice the specified wind load shall be applied and maintained for 24 hours, either with or without the vertical test load for more severe condition in the member under consideration or the structure as a whole. Complete tests under both conditions may be necessary to verify the strength of the structure. The structure shall be deemed to have adequate strength if, during the test, no part fails and if on the removal of the test load, the structure shows a recovery of at least 20 per cent of the maximum deflection or strain recorded during the 24 hours under load.

4.01.03 Structure of same design

Where several structures are built to the same design and it is considered unnecessary to test all of them, one structure, as a prototype, shall be fully tested, as described in previous Sub-clauses, but in addition, during the first application of the test load, particular note shall be taken of the strain or deflection when the test load 1.5 times the specified superimposed load has been maintained for 24 hours. This information is required as a basis of comparison in any check test carried out on samples of the structure.



TITLE:

TECHNICAL SPECIFICATION FOR ERECTION OF STRUCTURAL STEELWORK

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 14 OF 17

When a structure of the same type is selected for a check test, it shall be subjected, in addition to its actual dead load, to a superimposed test load, equal to 1.5 time the specified live load, in a manner and to an extent prescribed by the Engineer. This load shall be maintained for 24 hours, during which time, the maximum deflection shall be recorded. The check test shall be considered satisfactory, provided that the maximum strain or deflection recorded in the check test does not exceed by more than 20% of the maximum strain or deflection recorded at similar load in the test on the prototype.

4.01.04 Repair for subsequent test and use after strength tests

An actual structure which has passed the "Strength Test" as specified in Sub-clause 4.1.2 hereinbefore and is subsequently to be erected for use, shall be considered satisfactory for use after it has been strengthened by replacing any distorted members and has subsequently satisfied the 'Stiffness Test' as specified in Sub-clause 4.01.01 hereinbefore.

4.02.00 Tolerances

Some variation is to be expected in the finished dimensions of structural steel frames. Unless otherwise specified, such variations are deemed to be within the limits of good practice when they are not in excess of the cumulative effect of detailed erection clearances, fabricating tolerances for the finished parts and the rolling tolerances for the profile dimensions permitted under the Specifications for fabrication of structural steel work applicable to this Project and as specified below: The specified tolerance is mainly for welded erection. In case of bolted erection, no tolerance is desired so that all prefabricated bolt holes are matched on erection.

I. For Buildings Containing Cranes

Component	Description	Variation Allowed
1.	2.	3.
Main columns	a) shifting of column axis at foundation level with respect to building line	
	i) In longitudinal direction	i) ± 3.0 mm
	ii) In lateral direction	ii) ± 3.0 mm
	b) Deviation of both major column axis from vertical between foundation and	



TITLE:

TECHNICAL SPECIFICATION FOR ERECTION OF STRUCTURAL STEELWORK

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 15 OF 17

other member connection
levels:

i) For a column upto and including 10M height i) ± 3.5 mm from true vertical

ii) For a column greater than 10M but less than 40M height ii) ± 3.5 mm from true vertical for any 10 M length measured between connection levels, but not more than ± 7 mm per 30m length.

c) For adjacent pairs of columns across the width of the building prior to placing of truss ± 9.0 mm on true span.

d) For any individual column deviation of any bearing or resting level from levels shown on drawings. ± 3.0 mm

e) For adjacent pairs of columns either across the width of building or longitudinally level difference allowed between bearing or seating 3.0 mm

Trusses a) Deviation at centre of span of upper chord member from vertical plane running through least. centre of bottom chord. 1/1500 of the span or greater than 10mm whichever is the

Trusses b) Lateral displacement of top chord at center of span from vertical plane running through center of supports. 1/250 of depth of truss or 20 mm which ever is the - least.

Crane Cirders a) Difference in levels of crane rail measured between adjacent columns. 2.0 mm.

b) Deviation to crane rail-gauge ± 3.0 mm



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 16 OF 17

c) Relative shifting of ends of adjacent crane rail in plan and elevation after thermite welding. 1.0 mm.

d) Deviation of crane rail axis from centre line of web. ± 3.5 mm

Setting of
Expansion
gaps

At the time of setting of the expansion gaps, due regard shall be taken of the ambient temperature above or below 30°C. The coefficient of expansion or contraction shall be taken as 0.000012 per °C per unit length.

iv) For Building without Cranes

The maximum tolerances for line and level of the steel work shall be ± 3.0 mm on any part of the structure. The structure shall not be Out of Plumb more than 3.5 mm on each lox section of height and not more than 7.0 mm per 30 m section.

These tolerances shall apply to all parts of the structure unless the drawings issued for erection purposes state otherwise.

4.03.00 Acceptance

Structures and members have passed the tests and conform to all requirements specified in the foregoing Sub-clause 4.01.00, 4.01.01, 4.01.02, 4.01.03 and 4.01.04 and other applicable provisions of this specification and are within the limits of tolerances specified in Sub-clause 4.02.00 and/or otherwise approved by the Engineer shall be treated as approved and accepted for the purpose of fulfillment of the provisions of this contract.

5.00.00 INFORMATION TO BE SUBMITTED

5.01.00 Before Tender

5.01.01 Tentative Programme

The Tenderer shall submit a tentative programme based on the information available in the Tender Document and visit to site indicating the structure-wise erection schedule proposed to be maintained by the Contractor to complete the job in time in accordance with the Contract.



TITLE:

**TECHNICAL SPECIFICATION FOR
ERECTION OF STRUCTURAL
STEELWORK**

SPECIFICATION NO. PE-TS-635-600-C001

VOLUME -

SECTION - D SUBSECTION - D18

REV.NO. 0 DATE 13/02/2018

SHEET 17 OF 17

5.01.02

Constructional Plant and Equipment, Tools, Temporary works & manpower A detailed list of all constructional plant and equipment like cranes, derricks, winches, welding sets, erection tools etc. along with their make, model, present condition and location available with the Tenderer which he will be able to employ on the job to maintain the progress of work in accordance with the Contract shall be submitted along with the Tender. The total number of each category of experienced personnel like fitters, welders, riggers etc. that he will be able to employ on the job shall also be indicated.

5.01.03

Erection Yard

A site plan showing the layout and location of the erection yard proposed to be established by the tenderer shall also be attached with the tender indicating the storage space for fabricated steel materials, site-fabrication and repair shop, covered stores, offices, locations of erection equipments and other facilities. The Engineer shall have the right to modify the arrangement and location of the proposed yard to suit site conditions and the Contractor shall comply with the same without any claim whatsoever.

5.02.00

After award of the Contract

After award of the contract, the Contractor shall submit the following:

5.02.01

Detailed Programme

The Contractor shall submit a detailed erection programme within a month of the award of the Contract for completion of the work in time in accordance with the Contract. This will show the target programme, with details of erection proposed to be carried out in each fortnight, details of major equipment required, and an assessment of required strength of various categories of workers in a proforma approved by the Engineer.

5.02.02

Fortnightly Progress Report

The Contractor shall submit fortnightly progress reports in triplicate to the Engineer showing along with necessary photographs, 125 mm x 90 mm size, and all details of actual achievements against the target programme specified in Sub-clause 5.02.01 above. Any shortfall in the achievement in a particular fortnight must be made up within the next fortnight. Along with this report, the Contractor shall also furnish details of fabricated materials in hand at site and the strength of his workers.