

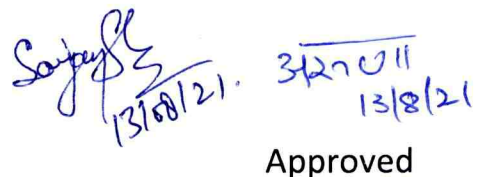
TECHNICAL PRE-QUALIFYING REQUIREMENTS
FOR 360KV LIGHTNING ARRESTER

400kV Surge Arrestors/Lightning Arresters being offered should be from manufacturer who has manufactured and supplied minimum fifteen (15) nos. of single phase Surge Arrestors of offered voltage class or higher, suitable for air insulated substation/ switchyard and which must have been in successful operation# for a minimum period of two (2) years as on date of Notice to Proceed i.e. 01.07.2020.

#Manufacturer must provide performance certificates issued by the employer/utility certifying the successful operation of above Surge Arrestors / Lightning Arresters without any adverse remark.


Prepared


Checked


Approved