

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)	ST45009
		<b>PRODUCT PURCHASE SPECIFICATION (HEEP: HARIDWAR)</b>	पृष्ठ 6 का 1 Page 1 of 6

Based on standard : ASME PTC 6 2004

**TECHNICAL SPECIFICATION FOR CALIBRATED FLOW NOZZLES**  
( 800 MW )

**1.0 GENERAL**

This specification calls for supply of calibrated long radius, low beta ratio throat tap flow nozzle assembly(ies) for the accurate determination of primary flow in the Performance Guarantee test on the TG set of the project indicated in sheet-5

**2.0 SCOPE**

Supply of calibrated flow nozzle assembly(ies) comprising primary flow element, flow straightener(s), end (& middle) flanges, gaskets (including one extra set for future use), requisite zinc plated bolts/studs & nuts, upstream and downstream pipe sections and suitable root valves for tap sets Each of the four pressure tap sets shall be 90° apart and calibrated as per ASME PTC-6-2004

**3.0 TECHNICAL REQUIREMENTS**

Long Radius, low beta ratio throat tap flow nozzle assembly is to be designed as per para 4 8 4 to 4.8 11 of "ASME PTC-6 2004", "ASME PTC 19 5 -Flow Measurement" along with data in Sheet No 5. The overall dimensions & design of the flow meter(s) should match with those indicated in sketch in sheet No 6 Major technical requirements are reproduced as follows.

- a) The flow nozzle(s) shall be designed, manufactured and calibrated as per ASME PTC-6 2004
- b) The supplier should calibrate the nozzle(s) preferably by Weigh tank method with Reynolds number, Water Temperature & other flow conditions as close to test conditions as possible When it is not possible to calibrate at the test Reynolds number, the calibration Reynolds number should be obtained in accordance with para 4 8 16 of ASME PTC-6-2004 While calibrating, the transition region from 1 0 million to 4 0 million should be established It is recommended that the value of the coefficient be established at the highest Reynolds No possible, to minimize the effects of the transition region (in accordance with para 4 8 13 of ASME-PTC-6-2004) It is recommended that nozzles be sized to produce throat Reynolds Nos beyond this range if possible to avoid effects of the Transition region as described in para 4 8.17, pg 37 of ASME-PTC-6-2004
- c) The supplier should get the flow nozzle calibrated only at a recognized facility having international repute Calibration should be separately conducted on each pairs of four taps & preferably consist of at least 20 separate acceptable points over a wide range of Reynolds Nos For each set of selected taps, the calibration curve shall be within 0 25% of the reference curve and shall have the same slope The reference curve is given in fig 4 10 & table 4 2 on pg 37 of ASME PTC-6-2004. The calibration of the flow nozzle shall comply with the conditions listed in clause 4-8 14 and 4-8 15 on pg 36 & 37 of ASME PTC-6-2004

SUPERSEDES INVENTORY NO


COPYRIGHT AND CONFIDENTIAL  
The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company

स्वाधिकार एवं गोपनीय  
सर्व प्रथम में ही यह सूचना प्राप्त होनी चाहिए कि इस दस्तावेज की सम्पत्ति है उक्त दस्तावेज का प्रयोग के बिना किसी भी तरह प्रयोग के बिना के बिना में हानिकारक हो न किया जाए।

दिनांक एवं हस्ताक्षर  
SIGN & DATE

सम्पत्ति सूची संख्या  
INVENTORY NO  
P-6412

TSX	LALIT KUMAR	Lalit Kumar	अनुवादक BY	TRANSLATED	नाम NAME	दिनांक एवं हस्ताक्षर SIGNATURE & DATE
MEMBER-PSC	NEELU GARG	Neelu	निर्माणाकर्ता WORKED BY	POORAN CHANDRA VERMA		
QAX	SK CHAUHAN	SK Chauhan	जांचकर्ता CHECKED BY	PRABHAT SINGH		
सहमत विभाग AGREED DEPTT	नाम NAME	दिनांक एवं हस्ताक्षर DATE & SIGNATURE	पर्यवेक्षणकर्ता SUPERVISED BY			
REAFFIRMED - 2025			स्वीकृति	S. BHATTACHARYA AGM (STE)		Gr NO. 2.83
REV NO	01		निर्माण	PREPARED	STE-TC	दिनांक DATE
DI	26/07/2017		ISSUED	TSX		01 09 2011
CHANGE ADVICE NO	STE-25-03	15/01/25				

चिह्नक एवं तारीख SIGN & DATE		<h2 style="margin:0;">उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)</h2> <h3 style="margin:0;">PRODUCT PURCHASE SPECIFICATION</h3> <p style="margin:0;">(HEEP: HARIDWAR)</p>	ST45009
			पृष्ठ 6 का 2 Page 2 of 6

SUPERSEDES  
INVENTORY

सामग्री सूची सत्यापन  
अधिकारिता प्रस्ताव है

d) The flow nozzle(s) shall be made from corrosion resistant material with known thermal expansion coefficient (as per clause 10 on page 5 of 6 of this document). Its surface should be hydraulically smooth and have a 0.4 microns or better finish and shall be free from all burrs, scratches, imperfections or ripples. For additional requirements on the design and manufacture of the nozzle(s) and its pressure taps, refer paras. 5.1, 5.2, 5.3, 5.4 of ASME PTC 19.5-Flow Measurement & paras 4.8.6 & 4.8.7 of ASME PTC-6-2004.

e) The flow straightener shall be of Perforated or tubed plate design with non-uniform hole distribution (*also called Gallagher Straightener*) as shown in Fig 4.5 & described in Para 4.8 4 & Table 4.1 on Pg. 30 & 32 of ASME PTC-6-2004.

f) The bidder should confirm that in case the calibration curves are not within the limits prescribed in ASME PTC-6, they will manufacture fresh flow nozzle(s) and calibrate it to achieve the calibration regimes of ASME PTC-6 and supply the new piece(s) without any price / delivery implications.

g) The total length of the flow assembly including flow straighteners; upstream & downstream machined pipe length; flanges of size Nb450 CL400 RF Weld neck type as per ANSI-B16.5 etc. is to be exactly as indicated in the sketch in sheet No.6 of this document The upstream & downstream pipe should be without any weld joint and should be internally machined for a length of 4D & 2D respectively in accordance with clause no: 5-3 of ASME PTC-19.5 For ease of transportation and installation, it is proposed to provide an interlocking flange joint near the center of assembly & this joint should have a failsafe arrangement (like pin etc) to be assemble it exactly as it was during calibration This joint to be opened for shipping after calibration.

h) The external surfaces of the assembly shall be suitably painted with one coat of rust preventive primer and minimum one coat of heat resistive paint suitable for 160 Deg C application, to avoid rusting due to sea transportation (if applicable) and open storage at site for period up to one year. **The end faces shall be provide with suitable covers and conservation shall be done by filling Nitrogen and blanking the nozzle at the ends to avoid rusting/ damage of the pipe internals. The nozzle shall remain filled with nitrogen until installation for Performance Test. Alternatively if supplier is not able to provide Nitrogen filling then the internals of the pipe should be provided with suitable conservation (like Volatile Corrosion Inhibitor).**

Open ends of upstream and downstream taps should be sealed with covers to prevent damages to thread. The nozzles shall be packed in suitable seaworthy crates to avoid damage during transport and temporary storage before use at site.

i) Serial No. of the nozzle, tag **FP01 should be clearly indicated on a name plate permanently affixed to the assembly. Tap set identification mark(s) shall also be hard punched as well as painted in large letters on the assembly so that they can be easily identified by the customer at site These should also be clearly indicated in the assembly drawing.**

j) The nozzle should be placed in box with name plate facing upward. The box should have arrow mark indicating upper direction and should at least carry **name of supplier, S.No. of nozzle, Name of the project, package size, gross weight and net weight.**

k) To avoid loss of Root Valves and/ or Spare Gaskets packed with nozzles, Supplier should tie these loose items to the pipe body using wire or other suitable sturdy material

COPYRIGHT AND CONFIDENTIAL  
 The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company

चिह्नक एवं तारीख SIGN & DATE		स्वत्वाधिकार एवं गोपनीयता इस प्रलेख में की गई सूचना भारत के बिरो अतिरिक्त किसी भी व्यक्ति के हित में इस्तेमाल नहीं की जा सकती है।	INVENTORY NO <b>P-6412</b>	REV NO 01	निर्माणकर्ता WORKED BY POORAN CHANDRA VERMA	जांचकर्ता CHECKED BY PRABHAT SINGH	26/07/17
---------------------------------	---	--	-------------------------------	--------------	---	--	----------


निष्ठा एवं हस्ताक्षर SIGN & DATE		<h2 style="margin:0;">उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)</h2> <h3 style="margin:0;">PRODUCT PURCHASE SPECIFICATION</h3> <p style="margin:0;">(HEEP: HARIDWAR)</p>	ST45009  पृष्ठ 6 का 3 Page 3 of 6
-------------------------------------	---	---	--



सुपरसेडस INVENTORY	सामग्री सूची संख्या को अधिकृतित करना है	<p><b>4.0 DOCUMENTS TO BE SUBMITTED WITH OFFER</b></p> <ol style="list-style-type: none"> <li>1) A copy of the design calculation for the nozzle(s) indicating clearly the calculation formula &amp; the various correction factors like Buoyancy factor, Density correction, scale expansion etc the bidder intends to apply in the calculations</li> <li>2) A typical flow calibration curve for a flow nozzle supplied earlier as per ASME PTC-6 2004 requirements.</li> <li>3) Preliminary drawing of nozzle assembly and nozzle cross sectional drawing</li> <li>4) A quality plan on prescribed format.</li> <li>5) Details of Manufacturing, testing &amp; calibration facilities</li> <li>6) Experience list of supply of flow nozzle for similar rating supercritical thermal sets</li> </ol>
-----------------------	--	--


COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company	<p><b>5.0 DOCUMENTS TO BE SUBMITTED FOR DESIGN APPROVAL (after Placement of order)</b></p> <ol style="list-style-type: none"> <li>1) Drawings of the flow section with details of different components, material details and dimensions</li> <li>2) Final flow calculation as per ASME PTC-6 2004</li> <li>3) An assembly drawing showing the location and assembly of all major components including the location of the marks showing tap set Nos</li> <li>4) Quality plan</li> <li>5) Supplier shall not make any changes in drawings &amp; materials after approval of documents without permission of BHEL.</li> </ol>
---	---

स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत के ही एलेक्ट्रिकल लिमिटेड की सम्पत्ति है इसका प्रयुक्त एवं आरक्षक रूप से किसी भी तरह प्रयोग को कि कम्पनी के हित में दुष्प्रभाव हो न किनाया जाए।	<p><b>5.1</b> Flow nozzle assembly should be manufactured based on drawings approved by BHEL as per 5 0 above.</p>
---	--

स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत के ही एलेक्ट्रिकल लिमिटेड की सम्पत्ति है इसका प्रयुक्त एवं आरक्षक रूप से किसी भी तरह प्रयोग को कि कम्पनी के हित में दुष्प्रभाव हो न किनाया जाए।	<p><b>5.2 INSPECTION &amp; TEST CERTIFICATES</b></p> <p>The following minimum tests shall be carried out as per BHEL approved drawings/ and applicable standards 3 hard copies of test certificates and 1 soft copy in pdf format shall be submitted for all the tests listed below <b>before packing and dispatch of nozzles.</b></p> <ol style="list-style-type: none"> <li>1) Material tests for all major components (i e ) Nozzle, Steel pipes, Flanges, fittings, etc</li> <li>2) Magnetic particle or liquid penetrant examination for each pressure taps as per ASME Sect.V</li> <li>3) 100 % Radiographic examination of butt welds as per ASME Sect.VIII.</li> <li>4) Hydrostatic pressure test of complete meter run at 1.5 times of design pressure for minimum 30 minutes with proof of test.</li> <li>5) Surface finish measurement for Nozzles satisfying the requirements of ASME PTC-6 2004 and ASME PTC-19 5 as stated in para 3(d) above</li> </ol>
---	--

निष्ठा एवं हस्ताक्षर SIGN & DATE   23/7/17	<p><b>5.3 WET CALIBRATION</b></p> <p>Calibrations on nozzle as per ASME PTC-6 2004. Copies of calibration for each tap set indicating nozzle/pipe diameter and calibration conditions, including curves and calculation data shall be submitted for review and acceptance <b>before packing and dispatch of nozzles.</b></p>
---	--

सामग्री सूची संख्या INVENTORY NO  P-64/12	REV NO 01		निर्माणकर्ता WORKED BY POORAN CHANDRA VERMA	 26/07/17	
			जांचकर्ता CHECKED BY PRABHAT SINGH	 26/07/17	

चिह्न एवं तिथि SIGN & DATE		<h2 style="margin:0;">उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)</h2> <h3 style="margin:0;">PRODUCT PURCHASE SPECIFICATION</h3> <p style="margin:0;">(HEEP: HARIDWAR)</p>	<b>ST45009</b>  पृष्ठ 6 का 4 Page 4 of 6
-------------------------------	---	---	---

सुपरसेडस INVENTORY	<h3 style="margin:0;"><u>PRESCRIBED FORMAT FOR QUALITY PLAN</u></h3>																																								
सामग्री सूची सत्यापन को अधिकृतित करता है	<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th style="width:5%;">S No</th> <th style="width:15%;">COMPONENT OPERATION</th> <th style="width:15%;">CHARACTERISTICS</th> <th style="width:15%;">CLASSIFICATION</th> <th style="width:10%;">TYPE OF CHECK</th> <th style="width:10%;">QUANTUM</th> <th style="width:10%;">REFERENCE DOCUMENT</th> <th style="width:10%;">ACCEPTANCE NORMS</th> <th style="width:10%;">FORMAT OF RECORDS</th> <th colspan="3" style="width:15%;">AGENCY P   W   V</th> <th style="width:10%;">REMARKS</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> <th>5</th> <th>6</th> <th>7</th> <th>8</th> <th>9</th> <th>10</th> <th>11</th> <th>12</th> <th>13</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>	S No	COMPONENT OPERATION	CHARACTERISTICS	CLASSIFICATION	TYPE OF CHECK	QUANTUM	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY P   W   V			REMARKS	1	2	3	4	5	6	7	8	9	10	11	12	13														
S No	COMPONENT OPERATION	CHARACTERISTICS	CLASSIFICATION	TYPE OF CHECK	QUANTUM	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY P   W   V			REMARKS																													
1	2	3	4	5	6	7	8	9	10	11	12	13																													

**INSTRUCTIONS FOR FILLING QUALITY PLAN**

The quality plan shall include all the quality control measures and check adopted by the vendor to ensure that the material/ components/ assembly/ services supplied by the vendor meet /will meet the requirements as per specifications and good practices. They shall include all stages of operation such as **materials, process, machining, assembly, calibration, painting, packing & dispatch**. The following guidelines for filling the Quality plan may be noted:

Column 1- Serial Number

Column 2- Component / operation. The component and / or operation being checked shall be given here

Column 3-Characteristics - The characteristic being checked shall be given here (e.g.) Chemical composition, mechanical properties, leak tightness, surface defects, etc.

Column 4- Category CR stands for critical characteristic affecting the safety of equipment and personnel. MA stands for major characteristic affecting performance, reduction in life, large down time.M1 stands for minor characteristic affecting appearance.

Column 5-Type of check like chemical analysis, tensile testing, hydraulic test, visual examination, radiography, etc


Column 6- Quantum of check such as 100%, 10%, 1 per Heat, etc.

Column 7- Reference documents - Documents such as Technical specifications, drawings, standard specifications (BS, ANSI, ASME, DIN, IS, etc ), procedure etc. according to which the checks are done.

Column 8- Acceptance norms-BHEL approved drawings, Standards etc. according to which the acceptability or otherwise of the characteristics being checked is decided.

Column 9- Format of Records - Formats, log sheets, reports, etc. in which the observations are recorded. Standard log sheets, reports, format, etc. of the vendor shall be numbered and such reference numbers shall be included here.

Column 10-12 -Agency - The agency which performs the test/inspection shall be written in the sub-column P The agency which witnesses the tests shall be written in the sub-column W & the agency which verifies the tests certificates/inspection records shall be written in the sub-column V

चिह्न एवं तिथि SIGN & DATE		REV NO 01	निमगकर्ता WORKED BY POORAN CHANDRA VERMA	जाचकर्ता CHECKED BY PRABHAT SINGH	26/07/17
-------------------------------	---	-----------	---	--------------------------------------	----------

स्वत्वाधिकार एवं गोपनीयता  
 इस प्रलेख में दी गई सूचना भारत के लिए एलियुट्रियमस विनिर्देश की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग को कि सम्पत्ती के हित में हानिकारक हो न किया जाए।

COPYRIGHT AND CONFIDENTIAL  
 The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company

दिनांक एवं हस्ताक्षर SIGN & DATE		<h2 style="margin:0;">उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)</h2> <h3 style="margin:0;">PRODUCT PURCHASE SPECIFICATION</h3> <p style="margin:0;">(HEEP: HARIDWAR)</p>	ST45009  पृष्ठ 6 का 5 Page 5 of 6
-------------------------------------	---	---	--

SUPERSEDES INVENTORY	सामग्री सूची संख्या को प्रतिबिम्बित करता है	<h3 style="margin:0;">DATA SHEET FOR FLOW MEASURING DEVICE</h3> <h4 style="margin:0;">800 MW THERMAL POWER PLANT</h4>
----------------------	---	---

- 1) SERVICE : CONDENSATE FLOW TO DEAERATOR
- 2) TAG NO : FP01
- 3) QUANTITY : 1 NO
- 4) LINE FLUID : CONDENSATE (DM WATER)
- 5) OPERATING DATA

	100 % LOAD (Design Point)	80 % LOAD	MAXIMUM LOAD
FLOW ( T /Hr )	1769 46	1415 712	1908.260
PRESSURE(Kg/cm <sup>2</sup> abs)	11 90	9 93	12 63
TEMPERATURE (°C)	150 3	143 8	152 5

- 6) PIPE SIZE : O.D. = 457 00 mm  
I.D. = 431 60 mm  
Thickness = 12 70 mm
- 7) PIPE MATERIAL : SA106 Gr C.
- 8) PIPE STANDARD : ANSI B 36.10
- 9) TYPE OF FLOW ELEMENT : LOW BETA RATIO THROAT TAP NOZZLE
- 10) MATERIAL OF FLOW ELEMENT : 316L/321 SS or Equivalent
- 11) TYPE OF MOUNTING : Flanged (WNRF)
- 12) TYPE OF TAPPING : Throat Taps
- 13) NO OF TAPPING POINTS : FOUR Pairs
- 14) TYPE OF FLOW STRAIGHTENER : Perforated or Tubed Plate  
(As per Fig 4.5, ASME PTC-6-2004)
- 15) GRADIENT : Horizontal
- 16) ALLOWABLE PRESSURE LOSS : Approx 1 0 Kg/cm<sup>2</sup> at 100 % load
- 17) DESIGN & CALCULATIONS : As per ASME PTC-6-2004 & ASME PTC 19 5-2004 Flow Measurement
- 18) CALIBRATION CURVES & DATA : Required for each pair of tapings  
Data indicating Cd<sub>theo</sub> & Cd<sub>practical</sub> to be furnished
- 19) DIFFERENTIAL AT 100% LOAD : Preferably 1 5 Kg/cm<sup>2</sup>
- 20) INSTRUMENT RANGE : 0-2 5 Kg/cm<sup>2</sup> Dp transmitter
- 21) LIST OF REFERRED STANDARD : ASME PTC-6, ASME PTC-19 5, ANSI-B16.5, ANSI B36 1, ASME Sect V, ASME Sect VIII

**COPYRIGHT AND CONFIDENTIAL**  
The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company

**स्वाधिकार एवं गोपनीय**  
इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स लिमिटेड की सम्पत्ति है। इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह का उपयोग जो कि कम्पनी के हित में हानिकारक हो न किताब आया।

दिनांक एवं हस्ताक्षर  
SIGN & DATE  
*[Signature]* 31/12/17

सामग्री सूची संख्या INVENTORY NO <i>P-642</i>	REV NO 01		निर्माणकर्ता WORKED BY POORAN CHANDRA VERMA	<i>[Signature]</i> 26/07/17
			जांचकर्ता CHECKED BY PRABHAT SINGH	<i>[Signature]</i> 26/07/17



उत्पाद क्रय विनिर्देश (हीप : हरिद्वार)  
**PRODUCT PURCHASE SPECIFICATION**  
 (HEEP: HARIDWAR)

ST45009

पृष्ठ 6 का 6  
 Page 6 of 6

दिनांक एवं हस्ताक्षर  
 SIGN & DATE

SUPERSEDES  
 INVENTORY

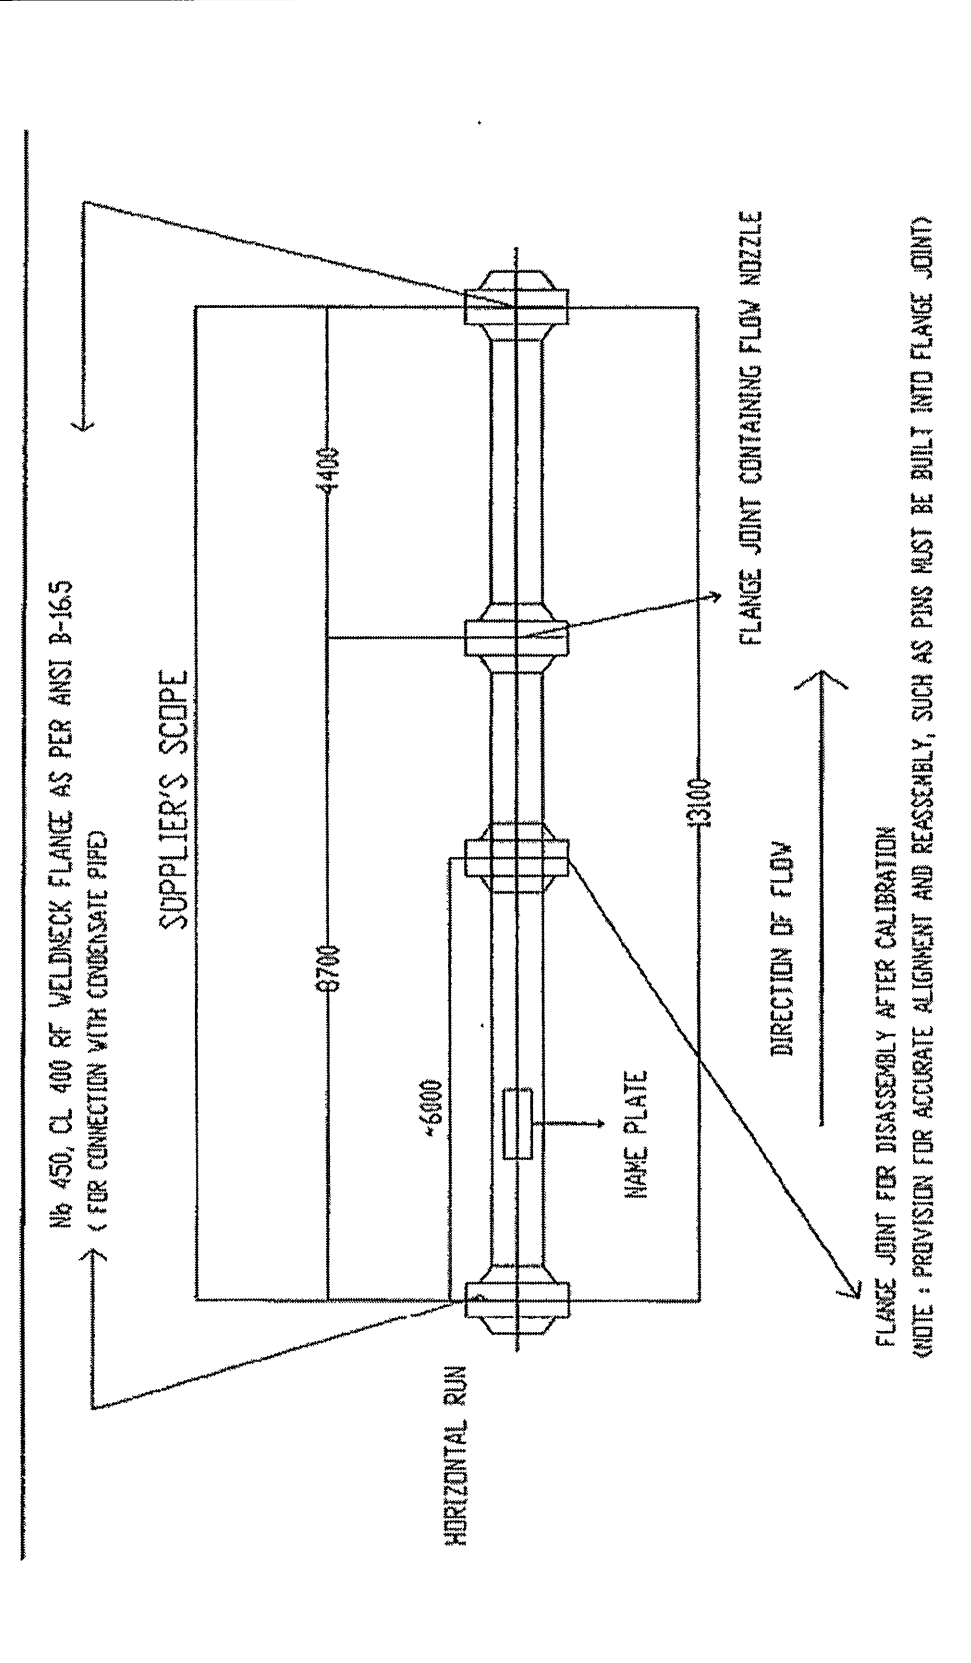
सामग्री सूची संख्या को  
 अभिज्ञानित करता है

**COPYRIGHT AND CONFIDENTIAL**  
 The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company

स्वत्व अधिकार एवं गोपनीय  
 इस दस्तावेज में दी गई सूचना भारत हेवी एलेक्ट्रिकल लिमिटेड की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी को प्रकट प्रयोग को कि सम्पत्ती के हित में हानिकारक हो न सिका जाय।

दिनांक एवं हस्ताक्षर  
 SIGN & DATE

सामग्री सूची संख्या  
 INVENTORY NO



DESIGN DATA						
PIPE O.D.	PIPE THICKNESS	PIPE MATERIAL	DESIGN PRESSURE	TEST PRESSURE	DESIGN TEMP.	DESIGN CODE
457.00	12.70	SA 106 GrC	48 Kg/cm <sup>2</sup>	720 kg/cm <sup>2</sup>	160 Deg C	ANSI B36.1

All Dimensions in mm

REV NO 01

निर्माणकर्ता WORKED BY  
 जाचकर्ता CHECKED BY

POORAN CHANDRA VERMA  
 PRABHAT SINGH

26/07/17  
 26/07/17