

Bid Corrigendum

GEM/2023/B/2938750-C4

Following terms and conditions supersede all existing "Buyer added Bid Specific Terms and conditions" given in the bid document or any previous corrigendum. Prospective bidders are advised to bid as per following Terms and Conditions:

Buyer Added Bid Specific Additional Terms and Conditions

1. OPTION CLAUSE: The Purchaser reserves the right to increase or decrease the quantity to be ordered up to 25 percent of bid quantity at the time of placement of contract. The purchaser also reserves the right to increase the ordered quantity by up to 25% of the contracted quantity during the currency of the contract at the contracted rates. Bidders are bound to accept the orders accordingly.

2. Buyer Added text based ATC clauses

Additional Terms and conditions are as per attached Annexure-A. bidders shall submit the filled up & signed Annexure-A along with the offer.

TYPICAL GA OF FRP BOX WITH PN & ELECTRICAL FITTINGS IS ATTACHED IN THE BUYER UPLOADED ATC DOCUMENT (LAST PAGE OF THE WORD DOCUMENT)

3. Buyer uploaded ATC document [Click here to view the file](#).
4. Buyer Organization specific Integrity Pact shall have to be complied by all bidders. Bidders shall have to upload scanned copy of signed integrity pact as per Buyer organizations policy along with bid. [Click here to view the file](#)

Disclaimer

The additional terms and conditions have been incorporated by the Buyer after approval of the Competent Authority in Buyer Organization, whereby Buyer organization is solely responsible for the impact of these clauses on the bidding process, its outcome, and consequences thereof including any eccentricity / restriction arising in the bidding process due to these ATCs and due to modification of technical specifications and / or terms and conditions governing the bid. Any clause(s) incorporated by the Buyer regarding following shall be treated as null and void and would not be considered as part of bid:-


1. Definition of Class I and Class II suppliers in the bid not in line with the extant Order / Office Memorandum issued by DPIIT in this regard.
2. Seeking EMD submission from bidder(s), including via Additional Terms & Conditions, in contravention to exemption provided to such sellers under GeM GTC.
3. Publishing Custom / BOQ bids for items for which regular GeM categories are available without any Category item bunched with it.
4. Creating BoQ bid for single item.
5. Mentioning specific Brand or Make or Model or Manufacturer or Dealer name.
6. Mandating submission of documents in physical form as a pre-requisite to qualify bidders.
7. Floating / creation of work contracts as Custom Bids in Services.
8. Seeking sample with bid or approval of samples during bid evaluation process.

9. Mandating foreign / international certifications even in case of existence of Indian Standards without specifying equivalent Indian Certification / standards.
10. Seeking experience from specific organization / department / institute only or from foreign / export experience.
11. Creating bid for items from irrelevant categories.
12. Incorporating any clause against the MSME policy and Preference to Make in India Policy.
13. Reference of conditions published on any external site or reference to external documents/clauses.
14. Asking for any Tender fee / Bid Participation fee / Auction fee in case of Bids / Forward Auction, as the case may be.

Further, if any seller has any objection/grievance against these additional clauses or otherwise on any aspect of this bid, they can raise their representation against the same by using the Representation window provided in the bid details field in Seller dashboard after logging in as a seller within 4 days of bid publication on GeM. Buyer is duty bound to reply to all such representations and would not be allowed to open bids if he fails to reply to such representations.



*This document shall overwrite all previous versions of Bid Specific Additional Terms and Conditions.

[This Bid is also governed by the General Terms and Conditions](#)

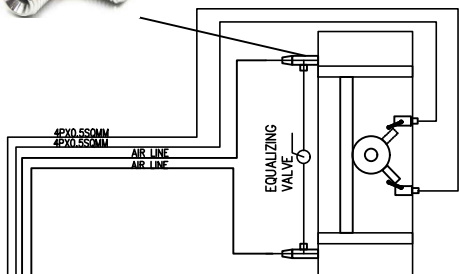


TYPICAL ACTUATOR TERMINALS

Sl.No	VALVE SIZE	LENGTH FLEXIBLE HOSE & CABLE	QTY FLEXIBLE HOSE & CABLE
1	DN 50-150	1 M	2 SET
2	DN 200-350	1.5 M	2 SET
3	DN 400 & ABOVE	2 M	2 SET

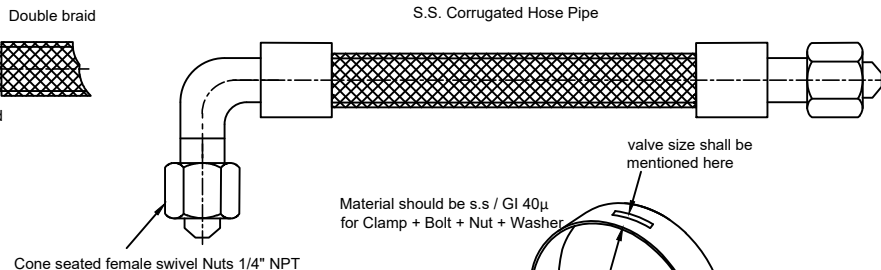


Cone seated female swivel Nuts 1/4" NPT

Material should be s.s / GI 40µ for Clamp + Bolt + Nut + Washer

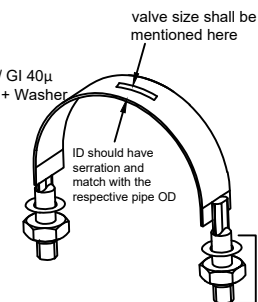


Sufficient Stud length shall be as per respective pipe OD

TYPICAL CLAMP

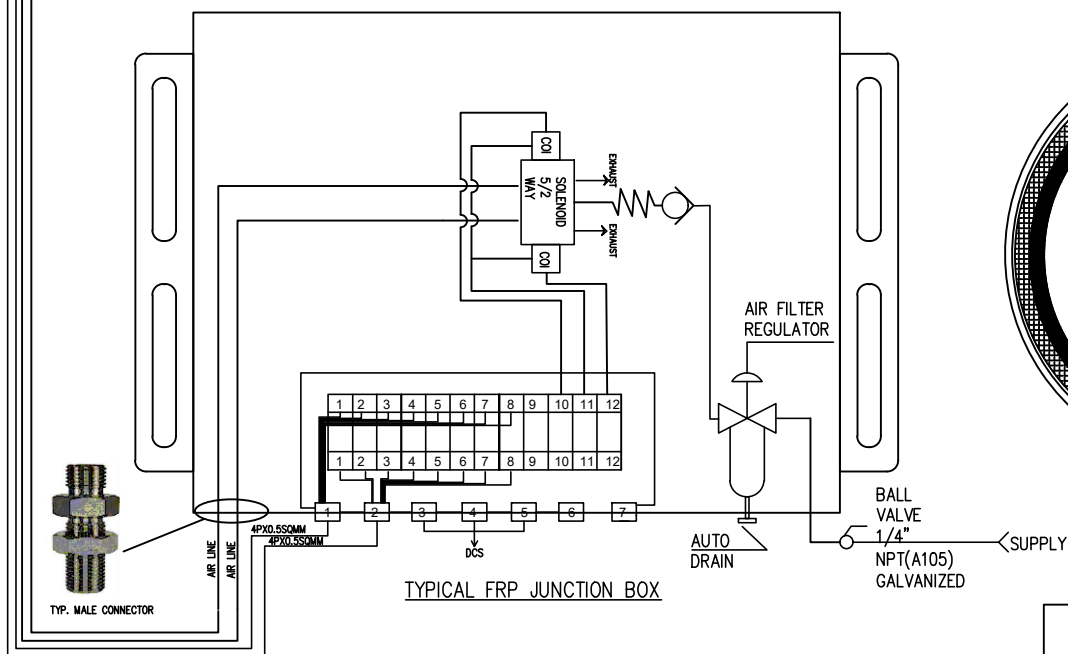

TYPICAL FRP JUNCTION BOX

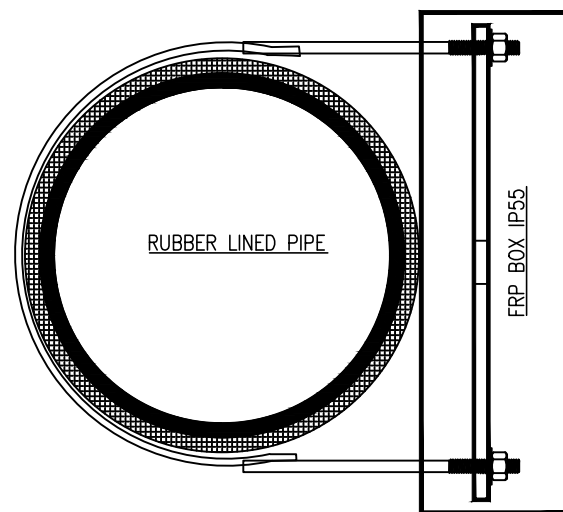

TYPICAL FRP JUNCTION BOX SIDE VIEW

NOTE:

1) FOR SCREENED CABLES:

- (a) CONDUCTOR : ANNEALED BARE COPPER
- (b) INNER SHEATH : PVC
- (c) SCREENING : ALUMINIUM MYLAR TAPE
- (d) OUTER SHEATH : EXTRUDED FRLS PVC SHEATH

(e) FOR CABLE 4P X 0.5SQMM :

- (i) OD OF THE CABLE : 10±2MM
- (ii) 4NO. CABLE GLAND : DOUBLE COMPRESSION BRASS BRACO MODEL NO. CBW01SS OR EQUIVALENT OF OTHER MAKE

(f) FOR CABLE 3C X 2.5SQMM :

- (i) OD OF THE CABLE : 13±2MM
- (ii) 3NO. CABLE GLAND : DOUBLE COMPRESSION BRACO OR EQUIVALENT BRASS GLAND CBW01S

2) WIRING FROM LIMIT SWITCH TO JUNCTION BOX TB

VENDOR SCOPE. TWO LENGTH OF 2 METRE 4X0.5 Sq.mm CABLE BOTH END SHALL BE CRIMPED WITH SUITABLE LUGS, ROLLED AND KEPT INSIDE JB.

WIRING FROM SOLENOID VALVE TO JUNCTION BOX TB TO BE CARRIED OUT AT VENDOR WORKS.

3) ALL WIRING ARE USED WITH ATC LUGS (24NOS.) WITH FERRULES.

4) ALL FITTINGS ARE 1/4" NPT

5) ALL TUBINGS & FITTINGS MATERIALS ARE SS304

6) ALL TUBE SIZE DN8 SCH10

HOSE SIZE	WORKING PRESSURE	TEST PRESSURE	BEND RADIUS	END CONNECTIONS (BOTH ENDS)
DN 8	9 Kg/sq.cm	14 Kg/sq.cm	229	DN8 SS 304 DOUBLE BRAIDED FLEXIBLE HOSE FEMALE SWIVEL NUT (1/4" NPT) WITH CONE SEAT NIPPLE WITH DUMMY CAP (BOTH ENDS)

TYPICAL GA OF FRP BOX WITH PN & ELEC. FITTINGS