
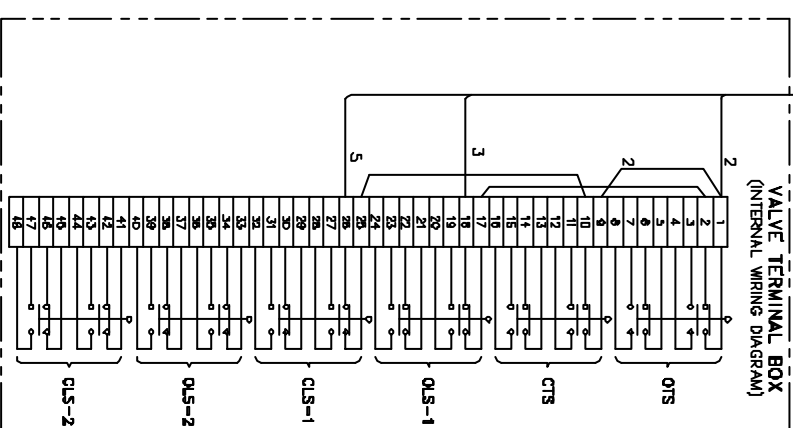


CTS - TORQUE SWITCH FOR C.W. ROTATION (CLOSE)  
OTS - TORQUE SWITCH FOR C.W. ROTATION (OPEN)  
CLS1 & CLS2 - LIMIT SWITCHES FOR OPEN POSITION  
CLS1 & CLS2 - LIMIT SWITCHES FOR CLOSE POSITION

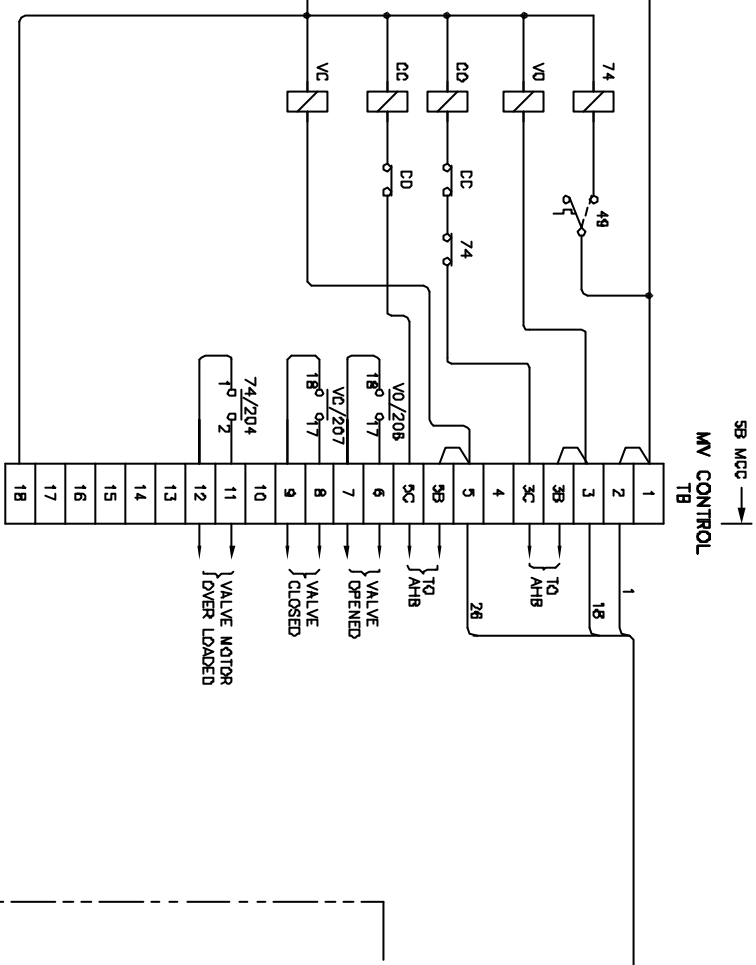

REV	DATE	ALTERED :
		CHD./APPD. :
<div> </div>		
<b>PATRATU T.P.S., 2x110MW, R&amp;M,</b> STAGE IV, UNIT 9 & 10, CUSTOMER No. D113 & D114		
DEPT. : D&I	TITLE	SHEET NO. 19/23
CODE : 382	SB AIR HEATER CONTROL VALVE INTERCONNECTION DIAGRAM	
DRN. : D-01-08	NAME : D-01-08	SCALE : 02-01-08
CHD. : SDA/interm	DATE : 02-01-08	NTS
APPD. : R.Ah/borgu	DATE : 02-01-08	
DRAWING NO. : 3-96-186-90100	REV : 00	