

2 X 660 MW KHURJA STPP

TECHNICAL SPECIFICATION

FOR

SCREENED CONTROL CABLE

SPECIFICATION NO.: *PE - TS - 475 - 507 - E004*

REVISION : 0



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA, UP (INDIA) - 201301**

558761/2021/PS-PEM-EL



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION -

REVISION 0

DATE: 04.10.2021

SHEET 1 OF 1

CONTENTS

<u>S. NO.</u>	<u>DESCRIPTION</u>	<u>NO. OF SHEETS</u>
01	CONTENTS	01
02	SECTION – 'I'	
	a) COMPLIANCE CERTIFICATE	01
	b) SPECIFIC TECHNICAL REQUIREMENTS	02
	c) DATA SHEET-A	05
	d) DATA SHEET-C (GUARANTEED TECHNICAL PARTICULARS)	04
03	SECTION – 'II'	
	a) GENERAL TECHNICAL SPECIFICATION	01
	b) ANNEXURE- A CORE IDENTIFICATION / PAIR IDENTIFICATION	02
	c) ANNEXURE-B – STEEL DRUM DRAWING	02
	d) STANDARD QUALITY PLAN	08
	e) ANNEXURE- C TO QP	04
	TOTAL NO. OF SHEETS (INCLUDING COVER/SEPARATOR SHEETS)	= 34

558761/2021/PS-PEM-EL



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS- 475-507-E004

VOLUME II

REVISION 00

DATE: 04.10.2021

SHEET 1 of 1

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance to the following by signing/ stamping this compliance certificate and furnishing same with the offer.

1. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same
2. There are no deviation with respect to specification other than those furnished in the 'schedule of deviations'
3. Only those technical submittals which are specifically asked for in NIT to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of offer.
4. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
5. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in BOQ-Cum-Price schedule of the specification shall not be considered (i.e., technical description & quantities as per specification shall prevail).

BIDDER'S STAMP & SIGNATURE

558761/2021/PS-PEM-EL



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS- 475-507-E004

VOLUME II

SECTION I

REVISION - 0

DATE: 04.10.2021

SHEET -

SECTION – I

SPECIFIC TECHNICAL REQUIREMENTS



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS- 475-507-E004

VOLUME II

SECTION I

REVISION - 0

DATE: 04.10.2021

SHEET 1 OF 13

1.0 SCOPE


- 1.1 Design, Manufacture, Inspection and testing at manufacture's works, proper packing and delivery to site of **Screened Control cables** conforming to this specification.
- 1.2 General technical requirements of the Screened Control cables are indicated in Data Sheet-A & Section-II. Project specific technical/ quality requirements / changes are listed in Section-I.
- 1.3 The stipulations of Section-I, followed by those of Data Sheet-A shall prevail in case of any conflict between the stipulations of Section-I, Data Sheet - A & Section-II.
- 1.4 The documents shall be in English Language and MKS system of units.

2.0 BILL OF QUANTITIES:

- 2.1 Quantity requirements shall be as per BOQ-cum-price schedule enclosed in NIT. Bidder to take care of the notes mentioned in price schedule.

3.0 SPECIFIC TECHNICAL REQUIREMENTS

<u>S.No.</u>	<u>Reference Clause No. of Section- II</u>	<u>Specific Requirement/ Change</u>
1	3.1	The standard quality plan no. shall be read as 0000-999-QOI-S-035 in place of PE-QP-999-507-E004.
2	3.3	Shall be read as "Type test report requirements, routine / acceptance testing and special testing requirements shall be as per Annexure – C of QP. All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.
3	3.4	This clause is null & void.
4	3.7 (clause is added)	All cables to be supplied shall be of type tested quality. During detailed engineering, the successful bidder shall submit for BHEL/NTPC approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening (05.04.2019). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a process plant/refinery/power plant/nuclear plant client or client representatives.
5	3.8 (clause is added)	However, if the successful bidder is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the successful bidder shall conduct all such

	DOCUMENT TITLE		SPECIFICATION NO. PE-TS- 475-507-E004	
	2X660MW KHURJA STPP		VOLUME II	
	TECHNICAL SPECIFICATION FOR SCREENED CONTROL CABLES		SECTION I	
	REVISION - 0	DATE: 04.10.2021		
	SHEET 1 OF 13			

		tests under this contract at no additional cost to the BHEL either at third party lab or in presence of BHEL/NTPC and submit the reports for approval.
6	3.9 (clause is added)	The type test reports (for type tests carried out within last ten years from the date of bid opening (05.04.2019) once approved for any project of NTPC shall be treated as reference. For KHURJA STPP, an endorsement sheet will be furnished by the manufacturer confirming similarity and “No design Change”. Minor changes if any shall be highlighted on the endorsement sheet.
7	3.10 (clause is added)	If a cable drum fails in site testing then that drum shall be supplied again by vendor free of cost to BHEL.

4.0 DRAWINGS & DOCUMENTS TO BE SUBMITTED

4.1 Documents required along with the technical offer: -


- a) Signed & Stamped copy of Compliance certificate.
- b) Signed & stamped copy of unpriced price schedule with “quoted” word indicated against all items.
- c) Deviation Sheet (Cost of withdrawal) with bidder’s signature and company stamp.
- d) Annexure-A: PQR Assessment Sheet

4.2 Documents/drawings shall be submitted after placement of order for BHEL & customer’s approval as specified in NIT.

Notes:

1. Vendor shall submit the dates for drawing/document submission/BHEL comments / resubmission after approval of documents.
2. In BOM each of the item to be uniquely identified with item code no. or item Sl. No. Supplier to ensure that all the items which will find separate mention in the packing list are covered in detailed BOM. Supplier to give following undertaking in BOM: " The BOM provided here completes the scope (in content and intent) of material supply under PO no. ---- dtd ---- Any additional material which may become necessary for the intended application of supplied item/package will be supplied free of cost in most reasonable time."

4.3 Documents/drawings shall be submitted through BHEL’s Document Management System (DMS).

	DESIGN CALCULATIONS FOR LV CABLE SELECTION & SIZING	Doc. No. PE-DC-434-507-E002
	NTPC LIMITED	Rev No. 0'
	2X660MW KHURJA STPP	04.10.2021

DATA SHEET-A**CABLE DETAILS OF INSTRUMENTATION CABLES (AS PER VDE)**


- 1.0 Voltage grade : 225 V (Peak)
- 2.0 Type of cable : FRLS SCREENED CONTROL CABLES
- 3.0 Standards Applicable :

1	VDE 0815, VDE 0816, VDE 0472	General Construction & tests for cables.
2	VDE 0207, Part-4, Part-5, Part-6	For insulation thickness.
3	SEN-SS-424-1475, IEC-60332 Part-3 Cat-B	Flammability Tests
4	ASTMD-2843, ASTMD-2863, IEC-754 Part-1	FRLS Tests
5	IS-8784	SPECIFICATION FOR THERMOCOUPLE COMPENSATING CABLES
6	IS-10810	METHODS OF TEST FOR CABLES
7	ANSI MC-96.1	Thermocouple cable color codes

4.0 CONDUCTOR

- a) Material : Annealed bare copper
- b) Grade : Electrolytic
- c) Standard applicable : VDE 0815
- d) Min number of strands, Dia : 7, 0.3 mm (nom), 0.5 sq.mm
and cross sectional area
- e) Maximum Conductor loop
resistance/km (in ohm) at 20 : 73.4
degrees celsius
- f) Continuous operation suitability : 70 DEG. C

5.0 INSULATION

	DESIGN CALCULATIONS FOR LV CABLE SELECTION & SIZING	Doc. No. PE-DC-434-507-E002
	NTPC LIMITED	Rev No. 0
	2X660MW KHURJA STPP	04.10.2021

- a) Material : PVC as per VDE 0207 Part 4, compound Y I3
- b) Application : Extruded
- c) Insulation thickness
- Min / Max : 0.25/ 0.35 (for 0.5 sq mm)
- d) Volume resistivity (Min) : 1×10^{14} at 20 deg .C & 1×10^{11} at 70 deg. C in ohm-cm

6.0 LAYING OF CORES

- a) Min. number of twist per Metre for paired cables. : 20 (For 0.5 Sqmm)
- b) Maximum lay of individual twisted pair : 50 mm (For 0.5 Sqmm)
- c) Diameter of core : In accordance with clause 5 (c)


7.0 IDENTIFICATION OF CORES : Band marking

8.0 INDIVIDUALLY SCREENED (F TYPE CABLE)

- a) Material : Aluminium-Mylar tape
- b) Coverage : 100%
- c) Overlap : Minimum 20%
- d) Min thickness (Micron) : 28
- e) Binder : Polyester tape.

9.0 OVERALL SCREENED (G TYPE CABLE)

- a) Material : Aluminium-Mylar tape
- b) Coverage : 100%
- c) Overlap : Minimum 20%
- d) Min. thickness (Micron) : 55

	DESIGN CALCULATIONS FOR LV CABLE SELECTION & SIZING	Doc. No. PE-DC-434-507-E002
	NTPC LIMITED	Rev No. 0
	2X660MW KHURJA STPP	04.10.2021

e) Binder : Polyester tape.

10.0 DRAIN WIRE

To be provided separately for individual pair shield (wherever applicable) and overall shield.

a) Material : Annealed Tin coated copper conductor as per VDE: 0815

b) Min number of strands, Dia : 7, 0.3 mm (nom), 0.5 sq.mm
and cross sectional area

11.0 ACCESSORIES (BEDDING, BINDER, TAPE REQ.)

a) Material : Mylar Tape

12.0 OUTER SHEATH

a) Material : Extruded PVC (compound YM1) as per VDE 0207 Part-5

b) Thickness : As per VDE 0816 and VDE207 Part-5

Minimum Thickness at any point : 1.8 mm for unarmoured Cable / as per IS-1554-I for armoured cable

Nominal Thickness at any point : >1.8 mm for unarmoured Cable / as per IS-1554-I for armoured cable

c) Application : Extruded

d) Colour : Blue

e) Whether FRLS : YES

f) Other : Resistant to water, Fungus, Termite & rodent attack.


g) filler : Non-hygroscopic, flame retardant

13.0 FRLS/ FLAMMABILITY TESTS

a) Oxygen Index : 29% Minimum as per ASTM D 2863

b) Temperature Index : 250 °C Minimum as per ASTM D 2863

c) Acid gas generation : less than 20% by weight (As per IEC-

	DESIGN CALCULATIONS FOR LV CABLE SELECTION & SIZING		Doc. No. PE-DC-434-507-E002
	NTPC LIMITED		Rev No. 0
	2X660MW KHURJA STPP		04.10.2021

754-1)

d) Smoke density rating : Not more than 60% (As per ASTM D 2843) Defined as average area under curve when the results of smoke density plotted on a curve indicating light absorption v/s time as ASTM D 2843

e) Flammability Test : IEEE-383

f) Swedish Chimney Test : As SEN-SS-424-1475 Class F3,

14.0 TOLERANCE ON OVERALL DIAMETER : ± 2 mm max. over the declared value in Technical Data Sheet

15.0 VARIATION IN DIA & OVALITY AT ANY CROSS-SECTION : Maximum 1 mm
Not more than 1mm.

Cage clam suitability – to be provided

16.0 CABLE DRUM DETAILS

a) Material Type & Construction: Wooden as per IS 10418 / Steel

b) Standard drum length : 1000 metres: up to and including 12 Pairs.
500 metres: above 12 pairs

c) Tolerance on drum length : $\pm 5\%$

d) Painting : Entire surface to be painted


e) Outermost Layer : To be covered with waterproof

17.0 RIP CORD : A non-hygroscopic and non-wicking non metallic cord polyethylene.

18.0 Markings on Outer Sheath

a) Progressive sequential Length marking to be provided : @ 1M by Embossing / Printing

b) Durable marking @ 625 mm (max.): : Manufacturer's name, type of insulation,

	DESIGN CALCULATIONS FOR LV CABLE SELECTION & SIZING	Doc. No. PE-DC-434-507-E002
	NTPC LIMITED	Rev No. 0
	2X660MW KHURJA STPP	04.10.2021

FRLS, conductor size, no. of pairs, voltage grade, type of cable, year of manufacture, Customer name i.e. 'BHEL-PEM' & 'NTPC' shall also be marked @5m.

19.0 TECHNICAL PARAMETERS (C & I) As per Table below

STANDARD CABLE PARAMETERS FOR INSTRUMENTATION CABLE

Parameter	0.5 mm ² (I & OS) type-F	0.5 mm ² (OS) type-G
Mutual Capacitance (max.) at 0.8 kHz, nF/Km	120	100
Conductor Loop Resistance (max.), Ohm/Km	73.4 (Plain)	73.4 (Plain)
Insulation Resistance (min), M Ohm/ Km	100	100
Cross Talk Figure (min) at 0.8kHz, dB	60	60
Characteristic impedance(max.) at 1 kHz	320	340
Attenuation(max.) at 1 kHz db/Km	1.2	1.2

Note:

1. Cable parameters indicated above are at 20 degC (+/- 3 degC)

20.0 TEST VOLTAGE

Core – Core

Core- shield

- a) High voltage test : 2kV RMS for 1 min 0.5kV RMS for 1 min
- b) Resistance to direct current test: 0.22kV DC for 240 hrs/ 10 days

Note : Repaired Cables shall not be acceptable.



DOCUMENT TITLE
2X660MW KHURJA STPP
 TECHNICAL SPECIFICATION FOR
 SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION - I

REVISION 0

DATE: 04.10.2021

Page 1

DATA SHEET-C

S.No.	Particulars	Unit	Description
1	Manufacturer's name	-	
2	Reference design standards	-	
3	Conductor size	sq. mm	
4	Rated Voltage	V	
5	Number of pairs	No.	
6	Cable suitable for both earthed & unearthed system	-	
7	Conductor		
	a) Material	-	
	b) Reference Standard	-	
	c) Grade	-	
	d) No. of strands	No.	
	e) Diameter of strands (nom.)	mm	
	f) Approx. dia of conductor	mm	
	g) Cross Section area	sq. mm	
	h) Maximum conductor resistance per Km at 20°C	ohm	
8	Insulation		
	a) Reference Standard	-	
	b) Material composition	-	
	c) Application	-	
	d) Minimum thickness	mm	
	e) Nom. Thickness	mm	
	f) Max. thickness	mm	
	g) Minimum volume resistivity as per IS 5831	Ohm cm	
	h) Dielectric constant	-	
	i) Maximum conductor temperature withstand capacity	°C	
j) Core diameter including insulation	mm		
9	Core laying		
	a) Whether cores are twisted.	-	
	b) Maximum lay of twist	mm	
	c) Identification of cores	-	
10	Individual Shield		
	a) Material	-	



DOCUMENT TITLE
2X660MW KHURJA STPP
 TECHNICAL SPECIFICATION FOR
 SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION - I

REVISION 0

DATE: 04.10.2021

Page 2

	b) Thickness of tape	micron	
	c) Coverage/ Overlap	%	
	d) Noise interference better than	dB	
11	Drain wire for individual shield		
	a) Reference standard	-	
	b) Size (No. of strands/ dia. of each strand)	sq. mm (no./mm)	
	c) Material	-	
	d) Resistance of drain wire per km at 20 deg.C	ohm	
12	Overall shield		
	a) Material	-	
	b) Thickness of tape	mm	
	c) Coverage/Overlap	%	
	d) Noise interference better than	dB	
13	Drain wire for overall shield		
	a) Reference standard	-	
	b) Size/ No.of strands	sq. mm/ no.	
	c) Material	-	
	d) Resistance per Km (with shield) at 20°C	Ohm/ km	
14	a) Fillers: Material (if applicable)		
	b) Bedding Material		
15	Inner sheath		
	a) Material, type and standard	-	
	b) Whether FRLS	-	
	c) Colour	-	
	d) Method of application	-	
	e) Thickness (min)	mm	
16	Armour		
	a) Material,	-	
	b) Formed wire / round wire		
	c) Minimum Coverage	%	
	d) Method of jointing	-	
	e) Breaking load of joint	-	
	f) Size (approx.)	mm	
	g) Dia of armour	mm	
	h) No. of wires	mm	
17	Outer sheath		
	a) Reference standard	-	
	b) Material	-	
	c) Minimum thickness of sheath	mm	
	d) Calculated dia under outersheath	mm	



DOCUMENT TITLE
2X660MW KHURJA STPP
 TECHNICAL SPECIFICATION FOR
 SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION - I

REVISION 0

DATE: 04.10.2021

Page 3

	e) Oxygen index (as per ASTM D 2863)	-	
	f) Temperature index (in deg. C as per ASTM D 2863)	-	
	g) Maximum acid gas generation as per IEC754-1	%	
	h) Maximum smoke density rating as per ASTM D 2843	%	
	i) Colour of outer sheath	-	
18	Dia over laid-up core	mm	
19	Dia under armour	mm	
20	Dia above armour	mm	
21	Overall diameter of cable	mm	
22	Tolerance on overall diameter	mm	
23	Weight of		
	Copper (conductor & drain wire)	MT. / km	
	PVC (insulation, sheath & fillers)	MT. / km	
	Armour	MT. / km	
	Cable (approx.)	MT. / km	
24	Cable parameters at 20°C(+/-3 deg. C)		
	a) Conductor resistance (max)	Ohm/ km	
	b) Insulation resistance (min)	M-Ohm	
	c) Mutual capacitance at 0.8KHz (max)	nF/ km	
	d) Cross talk at 0.8KHz (min)	dB	
	e) Attenuation at 1 KHz (max)	dB/ km	
	f) Characteristic impedance at 1 KHz (max)	Ohm	
25	Continuous operating temp. (deg.C)	deg. C	
26	(a) Relevant IS standard including Part & category for Flame retardance of complete cable	-	
	(b) Relevant IEC standard including Part & category for Flammability of complete cable		
27	Whether complete cable passes Swedish Chimney test as per SEN 4241475 (F3)	-	
28	Identification		
	a) Length of cable marked at every mtr.	-	
	b) FRLS marked at every 5 mtrs	-	
	c) Each core of the pair numbered	-	
	d) Conductor identification details for pairs	-	
	e) Details of cable markings	-	
29	Test voltage		
	a) High voltage test/ Dielectric Strength		
	i) Voltage (KV), Core - Core	kV	
	ii) Duration	min	
	b) High Voltage test		
	i) Voltage (KV), Core - Screen	V	



DOCUMENT TITLE
2X660MW KHURJA STPP
 TECHNICAL SPECIFICATION FOR
 SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION - I

REVISION 0

DATE: 04.10.2021

Page 4

	ii) Duration	min	
	c) Resistance to direct current test (applicable for 225 V cable as per VDE)	-	
	Voltage	V	
	Duration	hrs/days	
30	Min bending radius	mm	
31	Ovality at any cross section	mm	
32	Variation of dia through out cable length		
33	Cable cross-sectional drawings for each type of cable furnished		
34	i) Length of single coil in a drum	M	
	ii) Marking on drum	-	
	iii) Seasoned wood drum provided	-	
	iv) Both ends of cable to be sealed with PVC/ Rubber caps to prevent water/ moisture ingress		
	v) Gross weight (approx.)	kg.	
	vi) Net weight (approx.)	kg	
35	Type test procedures as per BHEL Technical Spec. and other relevant standards enclosed.		
36	Anti termite & rodent test		

558761/2021/PS-PEM-EL



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-TS-475-507-E004

VOLUME II

SECTION II

REVISION -0

DATE: 04.10.2021

SHEET -

SECTION-'II'

GENERAL TECHNICAL SPECIFICATION



DOCUMENT TITLE
2X660MW KHURJA STPP

TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO. PE-SS-000-507-E016B

VOLUME II

SECTION II

REVISION

DATE: 10.05.2016

SHEET 1 OF 1

1.0 TECHNICAL REQUIREMENTS

- 1.1 Technical requirements for SCREENED CONTROL CABLES shall be as indicated in this section, in addition to those specified in Datasheet-A.
- 1.2 It is not the intent to specify herein all the details of design & manufacture. However, the equipment shall conform in all respects to high standards of design engineering and workmanship and shall be capable of performing in continuous commercial operation at site conditions.

2.0 CODES & STANDARDS

- 2.1 The design, material, construction, manufacture, inspection and testing of Screened control cables shall conform to the latest revision of relevant standards and codes of practices mentioned in Data Sheet - A.
- 2.2 In case of conflict between the applicable reference standard and this specification, this specification shall govern.

3.0 QUALITY ASSURANCE REQUIREMENTS

- 3.1 Bidder shall confirm compliance with the BHEL Standard Quality Plan (PE-QP-999-507-E004) as attached with the specification without any deviations. At contract stage, the successful bidder shall submit the same QP for BHEL/ ultimate customer's approval. In case bidder has reference QP agreed with ultimate customer, same can be submitted for specific project after award of contract for BHEL/ultimate customer's approval. There shall be no commercial implication to BHEL on account of minor changes in QP during contract stage.
- 3.2 All materials shall be procured, manufactured, inspected and tested by vendor/ sub-vendor as per approved Quality Plan.
- 3.3 Type testing requirements, routine/ acceptance testing and special testing requirements shall be as per Annexure –C to QP. Charges for all these tests for all the equipments & components shall be deemed to be included in the bid price (except UV Radiation & Hydraulic Stability test).
- 3.4 The charges of UV Radiation test & Hydrolytic Stability test (if applicable) shall be reimbursed extra at actual against original money receipt of Govt. Lab. (CPRI/ ERDA etc).
- 3.5 Cost of cables consumed for testing shall be to bidder's account.
- 3.6 Type Test Reports for Tests conducted shall be submitted for BHEL's/ Customer's review/approval.

4.0 Packing

- 4.1 Cables shall be supplied in non-returnable drums. Material of cable drum shall be as specified in Datasheet-A.
- 4.2 In case of wooden drums, all wooden parts shall be manufactured from seasoned wood treated with copper naphthenates/ zinc naphthenates (refer IS: 401). Dimensions of wooden drums shall be as per IS 10418. All ferrous parts shall be treated with suitable rust protective finish or coating to avoid rusting during transit and storage. BIS certification mark shall be stamped on each cable drum. Over the cables polyethylene sheet shall be wrapped and then sealed properly.
- 4.3 In case of Steel drums, new or practically new cable drums made of steel and painted with epoxy resin paint are to be used. Cable ends are carefully protected before packing. Over the cables polyethylene sheet shall be wrapped and then sealed properly. For Typical details of Steel drums, Annexure-B to Section-II, may be referred by the bidder. Bidder may modify, to choose appropriate dimensions of steel drums to suite various sizes/weight/ lengths.

558761/2021/PS-PEM-EL

TITLE :



TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO.

PE-TS-475-507-E004

VOLUME NO. IIB

SECTION: C

REV NO. : 0 DATE 04.10.2021

SHEET: 1 OF 2

ANNEXURE : A

CORE IDENTIFICATION / PAIR IDENTIFICATION



TECHNICAL SPECIFICATION FOR
SCREENED CONTROL CABLES

SPECIFICATION NO.

PE-TS-475-507-E004

VOLUME NO. IIB

SECTION: C

REV NO. : 0 DATE 04.10.2021

SHEET: 2 OF 2

ANNEXURE : B-I

The cable cores shall be colour coded as mentioned below:

PAIR	CORE	COLOUR
1 st	1 st	Blue
1 st	2 nd	Red
2 nd	1 st	Grey
2 nd	2 nd	Yellow
3 rd	1 st	Green
3 rd	2 nd	Brown
4 th	1 st	White
4 th	2 nd	Black

Each four pair is laid to form one unit and wound with Mylar tape. The cores of each unit shall then be identified by colour bands for cables of more than 4-pair. eg. All eight cores of the first unit shall have a single band of pink colour (preferably rose pink).

Unit No No.	COLOUR OF BANDS	BAND MARKS
1.	PINK	= === ==
2.		= ===== ==
3.		= === ==
4.		= === ==
5.	ORANGE	= === ==
6.		= ===== ==
7.		= === ==
8.		= === ==
9.	VIOLET	= === ==
10.		= ===== ==
11.		= === ==
12.		= === ==



The dimension L (distance between the marking) shall be limited to 60mm. The bands shall be neat and cover at least 2/3 of the periphery of the core.
eg: A grey wire having 3 orange bands is the first core of the second pair of the seventh unit.

ANNEXURE-B

STEEL DRUM DRAWING (TYPICAL)



Annexure-B to Section II

(Sheet 1 of 2)

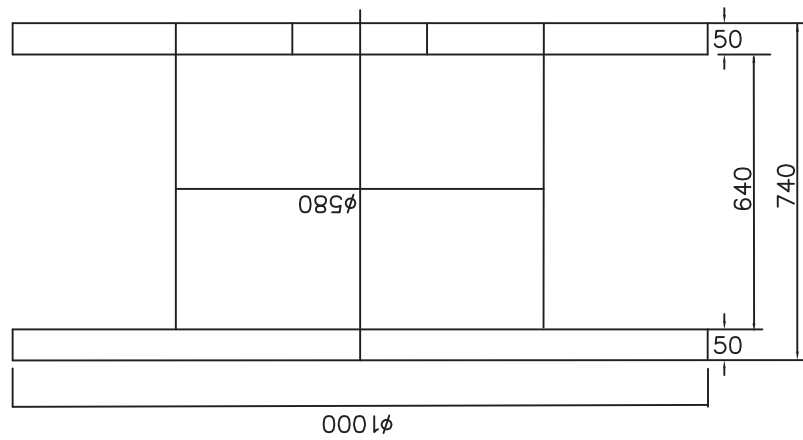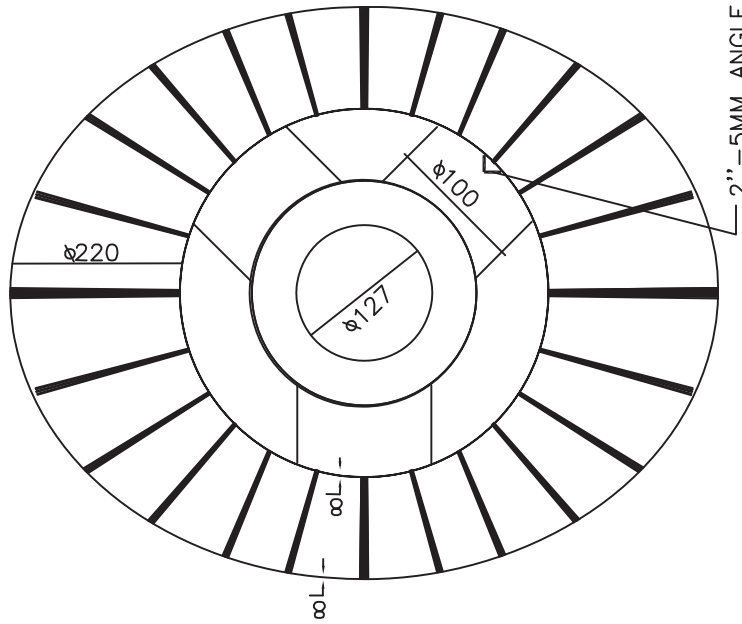

Annexure-B to Section II

(Sheet 2 of 2)

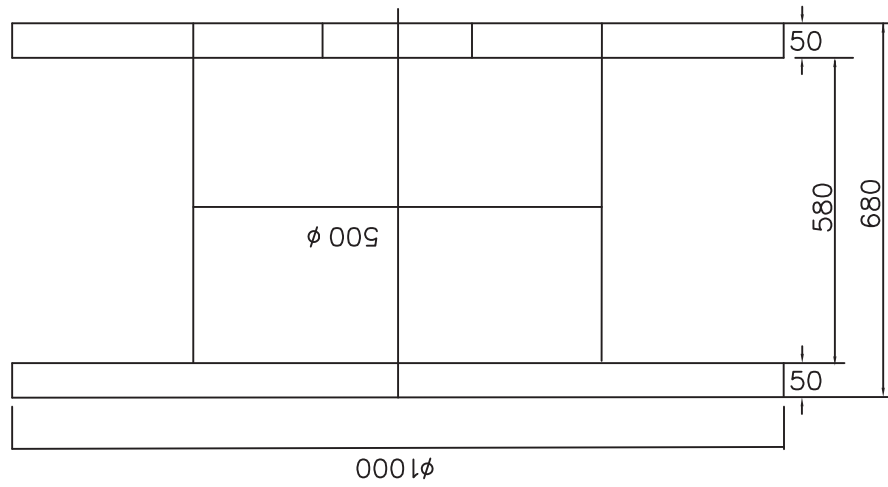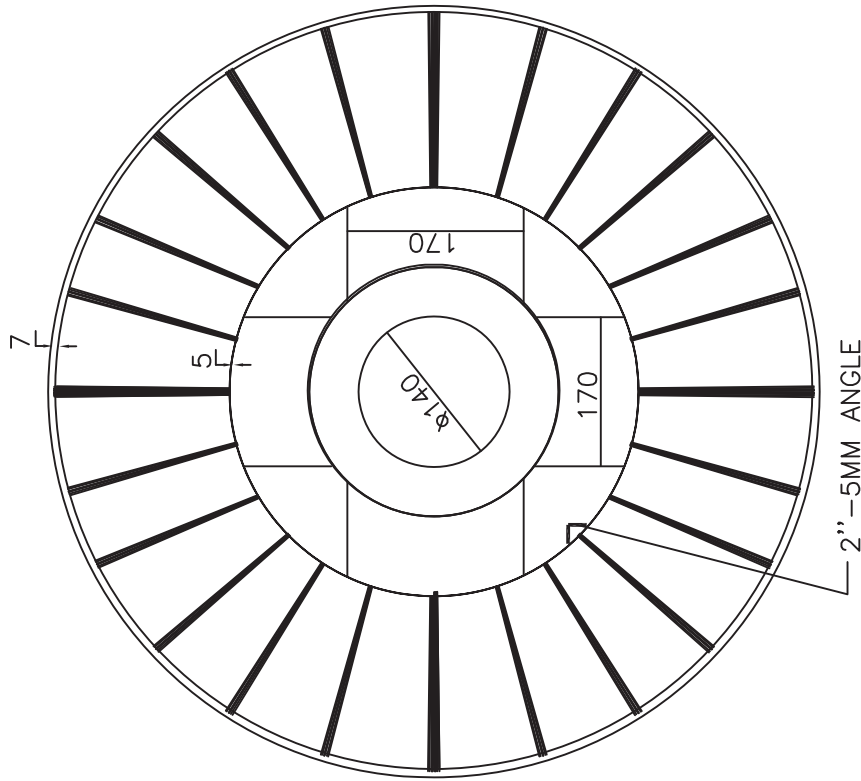

DIMENSION in mm

BHARAT HEAVY ELECTRICALS LTD
PROJECTS ENGINEERING MANAGEMENT
(ELECTRICAL)

This approval status shall be interpreted as laid down in the contract and it shall not relieve the contractor from his contractual obligations.

APPROVAL CATEGORY AWARDED

CAT I Approved
 CAT II Approved with comments as noted
 CAT III Not Approved
 CAT IV Reference Drawing

Name: Prayanshu Agrawal Signature: [Signature]
 Date: _____

Quality Plan - Screen control cable

NTPC Doc. no : 9585-001-215-QVE-Q-107

BHEL Doc. no. : PE-V0-434-507-E916

CUSTOMER		NTPC Limited (A GOVERNMENT UNDERTAKING) NTPC BHARAT HEAVY ELECTRICALS LTD POWER SECTOR PROJECT ENGINEERING MANAGEMENT NOIDA		NTPC Logo	
PROJECT		NTPC PATRATU SUPEI I		NTPC Logo	
APPROVED BY		[Signature]		NTPC Logo	
DATE		2020.06.06		NTPC Logo	
REASON		CAT I		NTPC Logo	
REV	DATE	ALTD	CHD	APPD	APPD
JOB NO.		434		CONTRACT	
STATUS		DISTRIBUTION		TO	
NO.				NO.	
DOC. NO.		9585-001-215-QVE-Q-107		SHEET	
REASON		CAT I		REV. 0	



ITEM : Instrumentation Cables. SUB SYSTEM : Shielded Instrument/ TC extension/ Compensating PVC FRLS Cable/ Instrumentation Cable		STANDARD QUALITY PLAN				To be filled by NTPC QP No.: 0000-999-QOI-S-035 Revision:01 Date:24.09.2018 Page:1 OF 5		Reviewed By: Approved By: Checked Verified Alok Shrivastava S K Lal		Agency M C N 10		Remarks 11	
Sl No	Component & Operations	Class	Type of check	Quantum of check	Reference Document	Acceptance Norms	Format of record	M	C	N	D*		
1	2	3	4	5	6	7	8	9			10		
A. CONDUCTOR													
A1	COPPER ROD For Conductor/ Drain wire	Maj.	Measu.	1 sample/lot	IS 613/IS:12444	IS 613/IS:12444	IMR/TC	✓	V	-	-	-	-
	a) Dimension												
	b) Conductivity/ Resistivity	Cri.	Elec.	1 sample/lot	IS 613/IS:12444	IS 613/IS:12444	IMR/TC	✓	V	V	-	-	-
A2	Conductor for compensating cable	Min	Dimen	1 Sample / lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	-	-	-	-
	a) Size												
	b) Resistance check	Maj	Elec	1 Sample / lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	-	-	-	-
	c) Thermo emf	Cri	Elec	1 Sample / lot	ANSI MC 96.1	ANSI MC 96.1	IMR/TC	✓	P	-	-	-	-
	d) Specific resistance, Temp. coefficient.	Maj	Elec/Mech	1 Sample / lot	MFR CATALOGUE	MFR CATALOGUE	IMR/TC	✓	V	V	-	-	-
	e) Conductor Grade	Maj	Chem	1 Sample / lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	V	V	-	-	-
B. PVC COMPOUND													
B1	PVC Compound (Insulation & Sheath) Type of compound as per NTPC Spec.	Maj	Therm.	1 sample/lot	VDE 207 Part -4/5	VDE 207 Part -4/5	IMR/TC	✓	P	V	-	-	-
	a) Thermal stability (for Insulation)												
	b) TS & % Elongation Before and After aging and variation.	Maj	Mech.	1 sample/lot	VDE 207 Part -4/5	VDE 207 Part -4/5	IMR/TC	✓	P	V	-	-	-
	c) Loss of Mass (Sheath)	Maj	Therm.	1 sample/lot	VDE 207 Part -4/5	VDE 207 Part -4/5	IMR/TC	✓	P	V	-	-	-
B2	FR Properties for Filler Compound	Cri.	Chem	1 sample/lot	ASTMD2863/ NTPC Approved Datasheet	ASTMD2863/ NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	a) Oxygen index												
	b) Temperature index deg. C	Cri.	Chem	1 sample/lot	ASTMD2863/ NTPC Approved Datasheet	ASTMD2863/ NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	a) Oxygen index												
	b) Temperature index	Cri.	Chem	1 sample/lot	ASTMD2863/ NTPC Approved Datasheet	ASTMD2863/ NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	c) Smoke density rating	Cri.	Chem	1 sample/lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	d) HCL Emission	Cri.	Chem	1 sample/lot	IEC754-1/ NTPC Approved Datasheet	IEC754-1/ NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
C	Tapes / Binders (Aluminium Mylar)	Maj	Mesu.	1 Sample/ Lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	a) Thickness												
	b) Size	Maj	Mesu.	1 Sample/ Lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	a) Dimension												
	b) TS & %Elongation	Maj	Mesu.	1 Sample/ Lot	NTPC Approved Datasheet	NTPC Approved Datasheet	IMR/TC	✓	P	V	-	-	-
	c) Zn Coating	Maj	Mech	1 Sample/ Lot	IS 3975	IS 3975	IMR/TC	✓	P	V	-	-	-
	d) Resistivity	Maj	Chem	1 Sample/ Lot	IS 3975	IS 3975	IMR/TC	✓	P	V	-	-	-
D	Armour (if applicable)	Maj	Elect	1 Sample/ Lot	IS 3975	IS 3975	IMR/TC	✓	P	V	-	-	-

LEGEND: * RECORDS IDENTIFIED WITH "TICK" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION
 ** M- MANUFACTURER/ SUB-SUPPLIER, C- SUPPLIER/ NOMINATED INSPECTION AGENCY, NE- NTPCEMPLOYER, P- PERFORM, W- WITNESS AND V- VERIFICATION
 APPROPRIATE CHP- NTPC SHALL IDENTIFY IN COLUMN "N" AS "W" \$-IRRESPECTIVE OF SIZE AND TYPE
 ADS - APPROVED DATA SHEET, SPEC. - CONTRACT SPECIFICATION, TC - TEST CERTIFICATE, COC - CERTIFICATE OF COMPLIANCE
 IMR - INWARD MATERIAL REGISTER, FIR- FINAL INSPECTION REPORT

FORMAT NO.: QS-01-QAI-P-07A/F3

ENGINEERING DIV./QA&I



SUB SYSTEM : Shielded Instrument/ TC extension/ Compensating PVC FRLS Cable/ Instrumentation Cable

STANDARD QUALITY PLAN

As Per latest Standards VDE 0815, VDE 0207 part 4, 5, 6, VDE 0816, VDE 0472, Sen 4241475, ANSI MC 96.1, ASTM D 2883, IEC 754-1, IS 3975, IS-8784 and IS 10810

QP No.: 0000-999-QOI-S-035

Revision: 01
Date: 24.09.2018
Page: 2 OF 5

Reviewed By: *[Signature]*
Approved By: *[Signature]*
Chancellor: *[Signature]*
Alok Shrivastava
S K Lal

SI No	Component & Operations	Characteristics	Class	Type of check	Quantum of check	Reference Document	Acceptance Norms	Format of record	Agency	Remarks
1	Wooden Drums	a) Dimension	Minor	Measure ment	Sample	As per Mir sid	NTPC Tech Specification /Approved Datasheet	IMR/ TC	M C N	10
2	Steel Drum (if applicable)	b) Anti termite treatment	Minor	Chemical	As per Mir sid	As per Mir sid	NTPC Tech Specification /Approved Datasheet	COC	P V	11
3		c) Marking	Minor	visual	As per Mir sid	As per Mir sid	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P V	
4		(If a) Dimension	Minor	measure ment	Sample	As per Mir sid	As per Mir sid	IMR/ TC	P -	
5		b) Surface Finish	Minor	visual	-	As per Mir sid	As per Mir sid	IMR/ TC	P -	
6		c) Marking	Minor	visual	As per Mir sid	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P V	

II INPROCESS INSPECTION										
A	Wire Drawing & Annealing	a) Size	Major	Dimn	1 Sample at Start and 1 Sample at End	Approved Datasheet	Approved Datasheet	IMR/ TC	P -	-
B	Tinning (Only for Drain wire)	a) Size	Major	Mech	1 Sample/ Lot	IS 10810	IS 10810	IMR/ TC	P -	-
B		b) Percentage of Elongation	Major	Dimn	1 Sample/ Lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		a) Surface finish	Major	Mech	1 Sample/ Lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		b) Core Diameter	Major	Measu.	1 Sample/ Lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		c) Radial Thickness (Min & Max)	Major	Measu.	1 Sample/ Lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		d) Spark Test	Major	Elec	100%	IS 10810 (With 3KV ac)	No Spark failure is allowed	IMR/ TC	P V	V
B		e) Volume Resistivity/ Insulation Resistance	Major	Elec	1 Sample/ Lot	VDE -0207/ Approved Datasheet	VDE -0207/ Approved Datasheet	IMR/ TC	P V	V
B		f) Colour, Marking/ Identification	Major	Visual	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P V	-
B		g) TS & %Elongation	Major	Mech	1 Sample/ Lot	IS 10810	IS 10810	IMR/ TC	P -	-
B		a) Lay length and Direction	Major	Measu. & Visual	1 Sample at Start and 1 Sample at	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		b) Size/ Dimension	Major	Measu	1 Sample/ Lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-
B		c) Pair Colour	Major	Visual	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P -	-

LEGEND: * RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M. MANUFACTURER/ SUB-SUPPLIER, C. SUPPLIER/NOMINATED INSPECTION AGENCY, NE. NTPC/EMPLOYER, P. PERFORM, W. WITNESS AND V. VERIFICATION
 APPROPRIATE CHP- NTPC SHALL IDENTIFY IN COLUMN "W" AS "W" \$-RESPECTIVE OF SIZE AND TYPE
 ADS - APPROVED DATA SHEET, SPEC - CONTRACT SPECIFICATION, TC - TEST CERTIFICATE, COC - CERTIFICATE OF COMPLIANCE
 IMR - INWARD MATERIAL REGISTER, FIR - FINAL INSPECTION REPORT

ITEM : Instrumentation Cables. SUB SYSTEM : Shielded Instrument/ TC extension/ Compensating PVC FRLS Cable		STANDARD QUALITY PLAN				To be filled by NTPC QP No.: 0000-999-QOI-S-035 Revision:01 Date:24.09.2018 Page:3 OF 5		Reviewed By Chanchal Verma Alok Shrivastava S.K. Jai	Approved By K.K. Ojha	Remarks	
SI No	Component & Operations	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Format of record	Agency	Remarks	
1	2	3	4	M	C.N	7	8	9	M C N	10	
E	Laying of Pairs/ Taping/ Shielding (Wherever Applicable)	Maj.	Visu.	100%	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	11
	b) Dimension	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	c) Coverage/ Overlap	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	d) Continuity	Maj.	Dimn.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	e) Bunching (for >4P)	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
F	Sheathing (Inner - if applicable)	Maj.	Visual	100%	-	Smooth, free from visual defects #	Smooth, free from visual defects #	IMR/ TC	P	-	# Porosity, Burnt particles, Pimples (Repairs are not allowed)
	b) Colour	Maj.	Visual	100%	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	c) Diameter / Thickness	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	e) Surface Finish	Maj.	Visual	100%	-	Smooth, free from visual defects#	Smooth, free from visual defects#	IMR/ TC	P	-	# Porosity, Burnt particles, Pimples (Repairs are allowed)
	b) Colour/ Marking/ Embossing	Maj.	Visual	100%	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	c) Overall Diameter, Thickness	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	d) TS & %Elongation	Maj.	Mech.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
H	Armouring (if applicable)	Maj.	Visual	100%	-	Smooth, free from visual defects like rusting etc.	Smooth, free from visual defects like rusting etc.	IMR/ TC	P	-	Min coverage shall be 90 %. Gap should not be more than 1 wire/ Strip dimension.
	b) Direction of Lay & Coverage	Maj.	Visual	100%	-	Smooth, free from visual defects like rusting etc.	Smooth, free from visual defects like rusting etc.	IMR/ TC	P	-	
	c) Size of Wire/ Strip	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
	d) Diameter over Armouring	Maj.	Measu.	1 Sample/ Lot	-	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	-	
III. FINAL INSPECTION											
Type test as per agreement with NTPC Engg. Review of type test clearance from NTPC Engg. before final inspection - CHP											
A.	TYPE TEST	Cri.	Elec.	100%	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	V	V
B.	ROUTINE TEST	Cri.	Elec.	100%	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	V	V
		Cri.	Elec.	100%	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	V	V
		Cri.	Elec.	100%	100%	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	V	V
LEGEND: * RECORDS IDENTIFIED WITH "TICK" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** M- MANUFACTURER/ SUB-SUPPLIER, C- SUPPLIER/ NOMINATED INSPECTION AGENCY, NE- NTPC/EMPLOYER, P- PERFORM, W- WITNESS AND V- VERIFICATION APPROPRIATE CHP- NTPC SHALL IDENTIFY IN COLUMN "N" AS "W" \$-IRRESPECTIVE OF SIZE AND TYPE ADS - APPROVED DATA SHEET, SPEC. - CONTRACT SPECIFICATION, TC - TEST CERTIFICATE, COC - CERTIFICATE OF COMPLIANCE IMR - INWARD MATERIAL REGISTER, FIR- FINAL INSPECTION REPORT FORMAT NO.: QS-01-QM/P-07/M/3 ENGINEERING DIV./QA&I											



SUB SYSTEM : Shielded Instrument/ TC extension/ Compensating PVC FRLS Cable
Instrumentation Cable

STANDARD QUALITY PLAN

As Per latest Standards VDE 0815, VDE 0207 part 4.5, VDE 0816, VDE 0472, Sen 4241475, ANSI MC 96.1, ASTM D 2893, IEC 754-1, IS 3976, IS-8784 and IS 10810

QP No.: 0000-999-QOI-S-035

Revision: 01
Date: 24/09/2018
Page: 4 Of 5

Reviewed By: Approved By

Chancellor
S K Laha
K K Ojha

Sl No	Component & Operations	Characteristics	Class	Type of check	Quantum of check	Reference	Acceptance Norms	Format of record	Agency	Agency	Remarks	
1	2	3	4	5	M	C/N	7	8	9	10	11	
IV ACCEPTANCE TEST												
A	Constructional Details & Dimensions of complete cable	a) Constructional Details (CONDUCTOR, DRAIN WIRE, SHIELDING ETC.)	Mej.	Visual	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		b) Shield Al-mylar thickness	Mej.	Measu.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		c) Insulation thickness	Mej.	Measu.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		d) Inner/ Outer sheath thickness (as applicable)	Mej.	Measu.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		e) Diameter over outer sheath	Mej.	Measu.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		f) Outer sheath - Colour, Marking/ Embossing & End sealing	Mej.	Visual	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		g) Length checking	Mej.	Measu.	1 No. of each size & type per lot	1 No. of each size & type per lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		h) Core - Band marking/ Numbering, Colour	Mej.	Visual	1 No. of each size & type per lot	1 No. of each size & type per lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		i) Overall Coverage/overlap of shield & Continuity of drain wire	Mej.	Visual	1 No. of each size & type per lot	1 No. of each size & type per lot	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		j) Visual & Surface Finish	Mej.	Visual	1 No. of each size & type per lot	1 No. of each size & type per lot	Smooth, free from visual defects #	Smooth, free from visual defects #	FIR	P	W	W
B	Insulation	a) Volume Resistivity (At room and Elevated Temperature)	Mej.	Elec.	1 No / Complete lot offered \$	1 No / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		b) IR Test	Cr.	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		c) TS & %Elongation test of Insulation (Before & After aging)	Mej.	Mech	1 No / Complete lot offered \$	1 No / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		d) Thermal Stability	Mej.	Chem.	1 No. of each size & type per lot	1 No. of each size & type per lot	VDE 207 Part -4/5	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
C	Sheath	a) TS & %Elongation test of Sheath (Before & After aging)	Mej.	Mech	1 No / Complete lot offered \$	1 No / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		b) Thermal Stability	Mej.	Chem.	1 No. of each size & type per lot	1 No. of each size & type per lot	VDE 207 Part -4/5	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W
		c) FRLS Test for outer sheath for OI(Oxygen Index), TI(Temperature Index), SDRI(Smoke Density Rating) & HCL Emission.	Mej.	Chem	1 No / Complete lot offered \$	1 No / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W

FORMAT NO.: QSDI-QAI-F-01/03

ENGINEERING DIV. QAI

ITEM : Instrumentation Cables, SUB SYSTEM : Shielded Instrument/ TC extension/ Compensating PVC FRLS Cable/ Instrumentation Cable		STANDARD QUALITY PLAN				To be filled by NTPC		Reviewed By:		Approved By:	
QIP No.: 0000-999-QOI-S-035		Revision: 01		Date: 24.09.2018		Page: 5 OF 5		Chanchal Verma		K.K. Ojha	
As Per latest Standards VDE 0815, VDE 0207 part 4, 5, 6, VDE 0816, VDE 0472, Sen 4241475, ANSI MC 96.1, ASTM D 2863, IEC 754-1, IS 3975, IS-8784 and IS 10810		Reference Document		Acceptance Norms		Format of record		Agency		Remarks	
Class		Type of check		Quantum of check		Document		M		C	
3		4		6		7		10		11	
Characteristics		5		M		C.N		D		N	
1	a) Surface finish	Cri	Visual	Samples as per IS 1554/8784	Samples as per IS 1554/8784	Smooth, free from visual defects like rusting etc.	IMR/ TC	P	W	W	
2	b) Direction of Lay & Coverage	Cri	Visual	Samples as per IS 1554/8784	Samples as per IS 1554/8784	Smooth, free from visual defects like rusting etc.	IMR/ TC	P	W	W	Min coverage shall be more than 1 wire/ Strip dimension.
D	c) Size of Wire/ Strip	Cri	Measu	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	d) Diameter over Armouring	Cri	Measu	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	e) Resistance Test	Cri	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	f) Wrapping Test	Cri	Mech	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	g) Tensile Test	Cri	Mech	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	h) Elongation Test	Cri	Mech	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	IMR/ TC	P	W	W	
	i) Electrical Parameters (Mutual capacitance, Cross talk, Attenuation, Characteristic impedance as applicable)	Maj.	Elec.	1 No. of each size & 1 No. of each size & type per Lot	1 No. of each size & 1 No. of each size & type per Lot	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
E	j) Swidosh chimney test (overall cable)	Maj.	Chem	1 No. / Complete lot offered \$	1 No. / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	k) Armouring Dimension & Zn coating. (If applicable)	Maj.	Measu.	1 No. / Complete lot offered \$	1 No. / Complete lot offered \$	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	l) Cond resistance (Cable & Drain wire)	Cri.	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	m) Flammability test	Cri.	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	n) HV Test	Cri.	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	o) IR test	Cri.	Elec.	Samples as per IS 1554/8784	Samples as per IS 1554/8784	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	p) Thermal EMF test (For compensating cable only)	Maj.	Elec.	Sample as per IS 8784	Sample as per IS 8784	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
F	q) Persulphate Test (For Drain wire only)	Maj.	Chem.	1 No. of each size & type per Lot	1 No. of each size & type per Lot	NTPC Tech Specification /Approved Datasheet	FIR	P	W	W	
	r) Stenciling, sealing, completeness & Verification with offered list.	Maj.	Visual.	100%	1 No. of each size & type per Lot	NTPC Tech Specification /Approved Datasheet	Sealing shall be visible	P	W	V	
	s) Identification	Maj.	Visual	100%	100%	NTPC Tech Specification /Approved Datasheet	Sealing shall be visible	P	V	V	


LEGEND : * RECORDS IDENTIFIED WITH "TICK" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: MANUFACTURER/ SUB SUPPLIER, C: SUPPLIER/NOMINATED INSPECTION AGENCY, NE: NTPC/EMPLOYER, P: PERFORM, W: WITNESS AND V: VERIFICATION
 APPROPRIATE CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W" \$-IRRESPECTIVE OF SIZE AND TYPE

ADS - APPROVED DATA SHEET, SPEC. - CONTRACT SPECIFICATION, TC - TEST CERTIFICATE, COC - CERTIFICATE OF COMPLIANCE
 IMR - INWARD MATERIAL REGISTER, FIR - FINAL INSPECTION REPORT

NOTE 1 : Where witnessing and verification of records is done only by main contractor (Colour "C"), NTPC Inspection Engineer may do a surveillance Verification/ Witnessing as per his discretion.
 NOTE 2 : NTPC Inspection Engineer to check approval date, revision no of reference documents at the time of inspection.

FORMIAT NO.: QS-01-QALP-07A/F3

ENGINEERING DIV./QA&I

		CUSTOMER : PROJECT : 3 X 800 MW PATRATU TPS TITLE		SPECIFICATION : PE-TS-434-507-E004 NUMBER :	
		BIDDER/ VENDOR :		SPECIFICATION : TITLE	
QUALITY PLAN NUMBER: PE-QP-999-507-E004, REV 0.		QUALITY PLAN ITEM: INSTRUMENTATION CABLES		SECTION VOLUME III	
SHEET 5 OF 5		CAT. TYPE/ METHOD OF CHECK		REFERENCE DOCUMENT	
COMPONENT/OPERATION CHECK		EXTENT OF CHECK		ACCEPTANCE NORM	
SL. NO.		3		7	
1		2		10	
3.0		Final Inspection Type Tests (Refer Note-A)		9	
NOTES:- (A) FOR LIST OF TYPE TESTS, ROUTINE TESTS & ACCEPTANCE TESTS; REFER ANNEXURE-C TO QAP.		CR		Appd. Data sheet	
LEGEND : P : PERFORMER W: WITNESS V: VERIFIER TC : Test Certificates, Spec. : Specification Mfg. : Manufacturer.		1- BHEL/CUSTOMER 2-VENDOR 3 SUB VENDOR CHP: CUSTOMER HOLD POINT		Appd. Data sheet -do-	
BHEL		PARTICULARS		BIDDER/VENDOR	
NAME		SIGNATURE		BIDDER'S/VENDORS COMPANY SEAL	
DATE		DATE		DATE	

11


Refer Annexure-C to QP enclosed

BIDDER/VENDOR

BIDDER/VENDOR

BIDDER/VENDOR

BIDDER/VENDOR

	ANNEXURE C TO QP	CUSTOMER: NTPC	PROJECT TITLE: 3X800 MW PATRATU TPS	SPECIFICATION NUMBER: PE-TS-434-507-E004
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E004, R0	SPECIFICATION TITLE: TECHNICAL SPECIFICATION FOR SCREENED CONTROL CABLE
	SHEET	1 of 4	ITEM: SCREENED CONTROL CABLES (AS PER VDE)	DOC. NO.

TYPE/ ACCEPTANCE/ ROUTINE TEST REQUIREMENTS (AS PER VDE)

A. Type Test Conduction:

1. Tests for which "T" is indicated in the 'Test Conduction Required As' column below shall be conducted as Type Test.
2. Sampling:
 - a) Type tests (except for Sl. no. b & c below) to be conducted on one size (2P, 4P etc.) of each type (F or G type)/ lot.
 - b) Electrical & C&I tests to be conducted on each size of each type of cables /lot.
 - c) FRLS & Flammability tests to be conducted only on one sample/ lot, irrespective of size/type.

B. Acceptance Test Conduction:

1. Tests for which "A" is indicated in the 'Test Conduction Required As' column below shall be conducted as Acceptance tests.
2. Sampling:
 - a) Acceptance tests (except for Sl. no. b & c below) for every lot shall be as per Appendix-B (Clause 15.2.2) of IS: 1554 Part-I.
 - b) Electrical & C&I tests to be conducted on each size of each type of cables /lot.
 - c) FRLS & Flammability tests to be conducted only on one sample/ lot, irrespective of size/type.

C. Routine Test Conduction:


1. Tests for which "R" is indicated in the 'Test Conduction Required As' column below shall be conducted as Routine tests.
2. Sampling:
Routine testing shall be conducted in line with the applicable standards and as per the Manufacturing Quality Plan approved for the project for every lot offered for inspection.

D. ADS: Approved datasheet.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
1.0	Tests for Conductor				
I.	Annealing test	For copper conductor only	T, A	IS 10810 Pt 1	<i>Internal in process Test Report to be furnished for both type & acceptance tests</i>
II.	Tin coating test (for tinned copper)	For copper conductor only	T, A	IS 10810 Pt 4	
III.	Resistance test	For Al/Cu	T, A, R	VDE 0815	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL


558761/2021/PS-PEM-EL

	ANNEXURE C TO QP	CUSTOMER: NTPC	PROJECT TITLE: 3X800 MW PATRATU TPS	SPECIFICATION NUMBER: PE-TS-434-507-E004
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E004, R0	SPECIFICATION TITLE: TECHNICAL SPECIFICATION FOR SCREENED CONTROL CABLE
	SHEET	2 of 4	ITEM: SCREENED CONTROL CABLES (AS PER VDE)	DOC. NO.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
IV.	Diameter test	For conductor	T, A	ADS	
2.0	Tests for Armour Wires/Strips				
I.	Measurement of dimensions	Applicable for Aluminium wire & GS wire/Strip	T,A	IS 10810 Pt 36	
II.	Tensile test	Applicable for Aluminium wire & GS wire/Strip	T, A	IS 10810 Pt 37	
III.	Elongation at break test	Applicable for GS wire/Strip only	T, A	IS 10810 Pt 37	
IV.	Torsion test	For GS round wire only	T, A	IS 10810 Pt 38	
V.	Winding test	For GS strip only	T, A	IS 10810 Pt 39	
VI.	Resistivity test	Applicable for Aluminium wire & GS wire	A	IS 10810 Pt 42	
VII.	Uniformity of Zinc coating test	For G. S. wires/Strip only	A	IS 10810 Pt 40	
VIII.	Mass of Zinc coating test	For G. S. wires/Strip only	A	IS 10810 Pt 41	
IX.	Wrapping Test	For Aluminium wires only	A	IS 10810 Pt 3	
3.0	Physical Tests for PVC Insulation & PVC sheath				
I.	Test for thickness & Eccentricity	Applicable for PVC insulation, PVC inner sheath & PVC outer sheath	T, A	VDE 0472	
II.	Tensile strength and elongation test at break	Applicable for PVC insulation, PVC inner sheath & PVC outer sheath		VDE 0472	
(a)	Before ageing		T, A		
(b)	After ageing		T, A		
III.	Ageing in air oven	Applicable for PVC insulation & PVC outer sheath	T	VDE 0472	
IV.	Loss of mass in air oven test	For PVC insulation, PVC inner & PVC outer sheath	T	VDE 0472	
V.	Hot deformation test	For PVC insulation, PVC inner & PVC outer sheath	T	VDE 0472	
VI.	Heat shock test	For PVC insulation, PVC inner & PVC outer sheath	T	VDE 0472	
VII.	Shrinkage test	For PVC insulation, PVC inner & PVC outer sheath.	T	VDE 0472	
VIII.	Thermal stability test	For PVC insulation, PVC inner & PVC outer sheath	A	VDE 207	
IX.	Bleeding & Blooming Test	For PVC insulation & outer sheath.	T	IS 10810 Pt 19	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL


558761/2021/PS-PEM-EL

	ANNEXURE C TO QP	CUSTOMER: NTPC	PROJECT TITLE: 3X800 MW PATRATU TPS	SPECIFICATION NUMBER: PE-TS-434-507-E004
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E004, R0	SPECIFICATION TITLE: TECHNICAL SPECIFICATION FOR SCREENED CONTROL CABLE
	SHEET	3 of 4	ITEM: SCREENED CONTROL CABLES (AS PER VDE)	DOC. NO.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
X.	Cold Bend & Cold Impact test	For PVC inner & outer sheath.	T	VDE 0472	
XI.	Core marking, end sealing	For PVC insulation, PVC inner & PVC outer sheath	A	VDE-207	
4.0	Tests for Al-Mylar Shield				
I.	Continuity test	For Al-Mylar shield	T, A	Plant Standard	
II.	Shield thickness	For Al-Mylar shield	A	ADS	
III	Overlap test	For Al-Mylar shield	A	ADS	
IV	Constructional details, dimensions	For Al-Mylar shield	A	ADS	
V	Visual, surface finish+	For Al-Mylar shield	A	Plant Standard	
VI	Overall coverage	For Al-Mylar shield	A	Plant Standard	
VII	Noise interference test.	For Al-Mylar shield	T,A	ADS	
5.0	Tests for Drain Wire				
I.	Annealing test	For copper conductor only	T, A	IS 10810 Pt 1	<i>Internal in process Test Report to be furnished for both type & acceptance tests</i>
II.	Tin coating test (for tinned copper)	For copper conductor only	T, A	IS 10810 Pt 4	
III.	Resistance test	For Al/Cu	T, A, R	VDE 0815	
IV.	Diameter test	For conductor	T, A	ADS	
V.	Continuity test	For Al-Mylar shield	T, A	Plant Standard	
6.0	FRLS Tests				
I.	Oxygen index test	For PVC outer sheath & Filler	T, A	IS 10810 Pt 58 / ASTM D 2863	<i>Applicable for Inner Sheath if the same is indicated in Datasheet-A</i>
II.	Smoke density test	For PVC outer sheath only	T, A	ASTMD 2843	
III.	Acid gas generation test	For PVC outer sheath only & Filler	T, A	IS 10810 Pt 59 / IEC-754-1	
IV.	Temperature Index Test	For PVC outer sheath only	T	IS 10810 Pt 64 / ASTM D 2863	
7.0	Flammability Tests				

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

558761/2021/PS-PEM-EL

	ANNEXURE C TO QP	CUSTOMER: NTPC	PROJECT TITLE: 3X800 MW PATRATU TPS	SPECIFICATION NUMBER: PE-TS-434-507-E004
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : PE-QP-999-507-E004, R0	SPECIFICATION TITLE: TECHNICAL SPECIFICATION FOR SCREENED CONTROL CABLE
	SHEET	4 of 4	ITEM: SCREENED CONTROL CABLES (AS PER VDE)	DOC. NO.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
I.	Flammability test for bunched cables	For complete cable	T,A	IS 10810 Pt 62/ IEC-60332 (Part-3-23, CAT A/ CAT B.	Test & Category applicable as indicated in Datasheet-A
II.	Flammability test for single cable	For complete cable	T,A	IS: 10810 Pt 61 / IEC:60332 Part-1	
III.	Swedish chimney test	For complete cable	T,A	SEN SS 424 1475 (Class F3)	
IV.	Flammability test	For complete cable	T,A	IEEE: 383	
8.0	Electrical Tests				
I.	High Voltage Test	For complete cable	T, A, R	VDE 0815	
II.	Insulation Resistance Test (Volume resistivity method)	For complete cable	T, A, R	IS 10810 Pt 43	
III.	Conductor resistance	For complete cable	A,R	VDE 0815	
IV.	Spark test	Insulation	R	VDE 0207	
9.0	C&I Tests				
I.	Cross talk	For complete cable	T, A	ADS	
II.	Attenuation	For complete cable	T, A	ADS	
III.	Characteristic Impedance	For complete cable	T, A	ADS	
IV.	Mutual capacitance	For complete cable	T, A	ADS	
V.	Noise interference	For complete cable	T, A	ADS	
10	Complete Cable				
I.	Visual , surface Finish	Overall Cable	A	Plant Standard	
II.	Volume resistivity at room and elevated temperature	Overall Cable	A	IS 10810 Pt43/ ADS	
III.	Construction details, dimensions	Overall Cable	T, A	ADS	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

INSTRUMENTATION CABLE															
ITEMS	TESTS														
	Conductor Resistance ® & (A)	High Voltage ® & (A)	Insulation Resistance ® & (A)	Constructional detail, dimensions (A)	Outer-Sheathe/core marking, end sealing (A)	Thermal Stability (A) +	Visual, Surface finish (A) +	Electrical Parameters ** (A) +	Persulphate Test (A) +	Overall/Coverage/Continuity (A)	Swidesh chimney Test (SS-4241475) (A) ++	FRLS Test * (A) ++	Tensile & Elongation before & after aging (A) ++	Vol. Resistivity. at room & Elevated Temp. (A) ++	Spark test report review ®
1. Instrument cable twisted and shielded															
Conductor(IS-8130)	Y			Y			Y								
Insulation(VDE-207)				Y	Y	Y	Y						Y		Y
Pairing/Twisting				Y	Y		Y								
Shielding				Y			Y			Y					
Drain wire	Y			Y			Y		Y	Y					
Inner Sheath				Y	Y	Y	Y					Y	Y		
Outer Sheath				Y	Y	Y	Y					Y	Y		
Over all cable	Y	Y	Y	Y	Y		Y	Y			Y			Y	
Cable Drums(IS-10418)				Y			Y								
<p>Note : High Temp. cables shall be subjected to tests as per VDE-207(Part-6) Compensating cables shall be checked for Thermal EMF/Endurance test as per IS 8784.</p> <p>Note : This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating his practice & Procedure along with relevant supporting documents during QP finalization for all items.</p> <p>Note : ® - Routine Test A - Acceptance Test Y - Test Applicable</p> <p>Note : Sampling Plan for Acceptance test shall be as per IS 8784 (As applicable)</p> <ul style="list-style-type: none"> * FRLS Tests: Oxygen / Temp Index (ASTM D-2863), Smoke Density Rating (ASTM – D 2843), HCL Emission (IEC-754-1) ** Characterisitic Impedence, Attenuation, Mutual Capacitance, Cross Talk (As applicable) <p>+ Sample size will be One No. of each size/type per lot.</p> <p>++ Sample size will be One No. sample for complete lot offered irrespective of size/type.</p>															

Annexure-A:**Delivery Schedule of Screened Control Cable of Khurja TG**

For Main supply: Within Four (04) months from date of CAT-1 approved Primary drawing/documents provided by BHEL's Purchase Dept., subjected to drawing/document submission/re-submission schedule as stipulated below, in case of any delay by vendor in submission/re-submission of Primary drawing/documents, then same shall be reduced from the given delivery period (of 4 months).

Sl. no.	BHEL Drawing No	Drawing Title	Primary/ Secondary	Drg. Sch for Vendors
1	PE-V0-XXX-507-E143	CROSS SECTION DRGS. - SCREENEDCONTROL CABLES	Primary	R-0 within 14 days from PO & subsequent revisions within 10 days of comments received from BHEL. BHEL shall furnish comments / approval on each submission within 18 days from receipt.
2	PE-V0-XXX-507-E916	QUALITY PLAN - SCREENEDCONTROL CABLES	Primary	
3	PE-V0-XXX-507-E141	TECHNICAL DATA SHEET - SCREENEDCONTROL CABLES	Primary	
4	PE-V0-XXX-507-E144	TYPE TEST CERTIFICATES - SCREENEDCONTROL CABLES	Secondary	Within 1 week after conduction of type test

Additional Qty. (if provided separately under Qty. var. clause of contract): Supply within Four (4) months from the date of Quantity clearance by BHEL.

Mandatory Spares: Supply within three (3) months from manufacturing clearance by BHEL. Separate clearance shall be issued for same.

Notes:

1. The end period specified above is for completion of the deliveries. Deliveries to start progressively so as to meet the above completion schedule.
2. The delivery conditions specified above are for contractual LD purposes, however BHEL may ask for early deliveries without any compensation thereof.
3. Wherever schedule of drawings/documents submission / re-submission is stipulated in the Technical Specifications, same shall be superseded by delivery specified in NIT.



**PROJECT
ENGINEERING
MANAGEMENT**

ANNEXURE- B

INTEGRITY PACT

Between

Bharat Heavy Electricals Ltd. (BHEL), a company registered under the Companies Act 1956 and having its registered office at "BHEL House", Siri Fort, New Delhi – 110049 (India) hereinafter referred to as "The Principal", which expression unless repugnant to the context or meaning hereof shall include its successors or assigns of the ONE PART

and

_____, (description of the party along with address), hereinafter referred to as "The Bidder/ Contractor" which expression unless repugnant to the context or meaning hereof shall include its successors or assigns of the OTHER PART

Preamble

The Principal intends to award, under laid-down organizational procedures, contract/s for

_____. The Principal values full compliance with all relevant laws of the land, rules and regulations, and the principles of economic use of resources, and of fairness and transparency in its relations with its Bidder(s)/ Contractor(s).

In order to achieve these goals, the Principal will appoint Independent External Monitor(s), who will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

Section 1 – Commitments of the Principal

1.1 The Principal commits itself to take all measures necessary to prevent corruption and to observe the following principles: -

1.1.1 No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.

1.1.2 The Principal will, during the tender process treat all Bidder(s) with equity and reason. The Principal will in particular, before and during the tender process, provide to all Bidder(s) the same information and will not provide to any Bidder(s) confidential / additional information through which the Bidder(s) could obtain an advantage in relation to the tender process or the contract execution.

1.1.3 The Principal will exclude from the process all known prejudiced persons.

1.2 If the Principal obtains information on the conduct of any of its employees which is a penal offence under the Indian Penal Code 1860 and Prevention of Corruption Act 1988 or any other statutory penal enactment, or if there be a substantive suspicion in this regard, the Principal will inform its Vigilance Office and in addition can initiate disciplinary actions.

Section 2 – Commitments of the Bidder(s)/ Contractor(s)

2.1 The Bidder(s)/ Contractor(s) commit himself to take all measures necessary to prevent corruption. He commits



PROJECT ENGINEERING MANAGEMENT

himself to observe the following principles during his participation in the tender process and during the contract execution.

2.1.1 The Bidder(s)/ Contractor(s) will not, directly or through any other person or firm, offer, promise or give to the Principal or to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material, immaterial or any other benefit which he / she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.

2.1.2 The Bidder(s)/ Contractor(s) will not enter with other Bidder(s) into any illegal or undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.

2.1.3 The Bidder(s)/ Contractor(s) will not commit any penal offence under the relevant IPC/ PC Act; further the Bidder(s)/ Contractor(s) will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.

2.1.4 Foreign Bidder(s)/ Contractor(s) shall disclose the name and address of agents and representatives in India and Indian Bidder(s)/ Contractor(s) to disclose their foreign principals or associates. The Bidder(s)/ Contractor(s) will, when presenting his bid, disclose any and all payments he has made, and is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.

2.2 The Bidder(s)/ Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.

2.3 The Bidder(s)/ Contractor(s) shall not approach the Courts while representing the matters to IEMs and will await their decision in the matter.

Section 3 – Disqualification from tender process & exclusion from future contracts

If the Bidder(s)/ Contractor(s), before award or during execution has committed a transgression through a violation of Section 2 above, or acts in any other manner such as to put his reliability or credibility in question, the Principal is entitled to disqualify the Bidder(s)/ Contractor(s) from the tender process or take action as per the separate "Guidelines on Banning of Business dealings with Suppliers/ Contractors". framed by the Principal.

Section 4 – Compensation for Damages

4.1 If the Principal has disqualified the Bidder from the tender process prior to the award according to Section 3, the Principal is entitled to demand and recover the damages equivalent Earnest Money Deposit/Bid Security.

4.2 If the Principal has terminated the contract according to Section 3, or if the Principal is entitled to terminate the contract according to section 3, the Principal shall be entitled to demand and recover from the Contractor liquidated damages equivalent to 5% of the contract value or the amount equivalent to Security Deposit/Performance Bank Guarantee, whichever is higher.

Section 5 – Previous Transgression

5.1 The Bidder declares that no previous transgressions occurred in the last 3 years with any other company in any country conforming to the anti-corruption approach or with any other Public Sector Enterprise in India that could justify his exclusion from the tender process.



PROJECT ENGINEERING MANAGEMENT

5.2 If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason.

Section 6 – Equal treatment of all Bidders/ Contractors/ Sub-contractors

6.1 The Principal will enter into agreements with identical conditions as this one with all Bidders and Contractors. In case of sub-contracting, the Principal contractor shall be responsible for the adoption of IP by his sub-contractors and shall continue to remain

responsible for any default by his sub-contractors.

6.2 The Principal will disqualify from the tender process all bidders who do not sign this pact or violate its provisions.

Section 7 – Criminal Charges against violating Bidders / Contractors / Sub-contractors

If the Principal obtains knowledge of conduct of a Bidder, Contractor or Subcontractor, or of an employee or a representative or an associate of a Bidder, Contractor or Subcontractor which constitutes corruption, or if the Principal has substantive suspicion in this regard, the Principal will inform the Vigilance Office.

Section 8 –Independent External Monitor(s)

8.1 The Principal appoints competent and credible Independent External Monitor for this Pact. The task of the Monitor is to review independently and objectively, whether and to what extent the parties comply with the obligations under this agreement.

8.2 The Monitor is not subject to instructions by the representatives of the parties and performs his functions neutrally and independently. He reports to the CMD, BHEL.

8.3 The Bidder(s)/ Contractor(s) accepts that the Monitor has the right to access without restriction to all contract documentation of the Principal including that provided by the Bidder(s)/ Contractor(s). The Bidder(s)/ Contractor(s) will grant the monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his contract documentation. The same is applicable to Sub-contractor(s). The Monitor is under contractual obligation to treat the information and documents of the Bidder(s)/ Contractor(s) / Sub-contractor(s) with confidentiality in line with Non-disclosure agreement.

8.4 The Principal will provide to the Monitor sufficient information about all meetings among the parties related to the contract provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the Monitor the option to participate in such meetings.

8.5 The role of IEMs is advisory, would not be legally binding and it is restricted to resolving issues raised by an intending bidder regarding any aspect of the tender which allegedly restricts competition or bias towards some bidders. At the same time, it must be understood that IEMs are not consultants to the Management. Their role is independent in nature and the advice once tendered would not be subject to review at the request of the organization.

8.6 For ensuring the desired transparency and objectivity in dealing with the complaints arising out of any tendering process, the matter should be examined by the full panel of IEMs jointly as far as possible, who would look into the records, conduct an investigation, and submit their joint recommendations to the Management.

8.7 The IEMs would examine all complaints received by them and give their recommendations/ views to CMD, BHEL, at the earliest. They may also send their report directly to the CVO and the Commission, in case of suspicion of serious



PROJECT ENGINEERING MANAGEMENT

irregularities requiring legal! administrative action. IEMs will tender their advice on the complaints within 10 days as far as possible.

8.8 The CMD, BHEL shall decide the compensation to be paid to the Monitor and its terms and conditions.

8.9 IEM should examine the process integrity, they are not expected to concern themselves with fixing of responsibility of officers. Complaints alleging mala fide on the part of any officer of the organization should be looked into by the CVO of the concerned organization.

8.10 If the Monitor has reported to the CMD, BHEL, a substantiated suspicion of an offence under relevant Indian Penal Code! Prevention of Corruption Act, and the CMD, BHEL has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Office, the Monitor may also transmit this information directly to the Central Vigilance Commissioner, Government of India.

8.11 The number of Independent External Monitor(s) shall be decided by the CMD, BHEL.

8.12 The word 'Monitor' would include both singular and plural.

Section 9 – Pact Duration

9.1 This Pact shall be operative from the date IP is signed by both the parties till the final completion of contract for successful bidder and for all other bidders 6 months after the contract has been awarded. Issues like warranty! guarantee etc. should be outside the purview of IEMs.

9.2 If any claim is made / lodged during this time, the same shall be binding and continue to be valid despite the lapse of this pact as specified as above, unless it is discharged/ determined by the CMD, BHEL.

Section 10 – Other Provisions


10.1 This agreement is subject to Indian Laws and jurisdiction shall be registered office of the Principal, i.e. New Delhi.

10.2 Changes and supplements as well as termination notices need to be made in writing. Side agreements have not been made.

10.3 If the Contractor is a partnership or a consortium, this agreement must be signed by all partners or consortium members.

10.4 Should one or several provisions of this agreement turn out to be invalid, the remainder of this agreement remains valid. In this case, the parties will strive to come to an agreement to their original intentions.

10.5 Only those bidders/ contractors who have entered into this agreement with the Principal would be competent to participate in the bidding. In other words, entering into this agreement would be a preliminary qualification.


For & On behalf of the Principal
(Office Seal)

धीरज सिंह / Dheeraj Singh
उप-प्रबन्धक (पी.जी.-II) / Dy. Manager (P.G.-II)
भारत हेवी इलेक्ट्रिकल्स लिमिटेड / Bharat Heavy Electricals Ltd.
पावर सेक्टर-परियोजना अभियंता/प्रबन्धक
Power Sector-Project Engineering Management
पीपीईआई भवन, एच.एच.ई.सी. कॉम्प्लेक्स, नई दिल्ली-110029
PPEI Bldg, H.R. Cpt. & CSEI-Complex,
प्लॉट नं. 25, सेक्टर-11, एच.एच.ई.सी. कॉम्प्लेक्स
Plot No. 25, Sector-11, H.R. Cpt. & CSEI-Complex

For & On behalf of the Bidder/ Contractor
(Office Seal)

Place Noida
Date 30.11.21

Witness: 
(Name & Address) _____

रोहित जुनेजा / Rohit Juneja
उप-प्रबन्धक (पी.जी.-II) / Dy. Manager (P.G.-II)
भारत हेवी इलेक्ट्रिकल्स लिमिटेड / Bharat Heavy Electricals Ltd.
पावर सेक्टर-परियोजना अभियंता/प्रबन्धक
Power Sector-Project Engineering Management
पीपीईआई भवन, एच.एच.ई.सी. कॉम्प्लेक्स, नई दिल्ली-110029
PPEI Bldg, H.R. Cpt. & CSEI-Complex,
प्लॉट नं. 25, सेक्टर-11, एच.एच.ई.सी. कॉम्प्लेक्स
Plot No. 25, Sector-11, H.R. Cpt. & CSEI-Complex

Witness: _____
(Name & Address) _____

1) OBJECTIVE

To lay down the procedure for carrying out Remote Inspection of Bought-out Items (BOIs) for PEM suppliers wherever applicable.

2) SCOPE

It will cover suppliers for packages of PEM BOIs for various project requirements.

Invitation is sent to the suppliers for remote inspection on applications like MS Teams, Webex, etc. by BHEL.

3) MINIMUM REQUIREMENTS AT SUPPLIER'S WORKS:

- i. Uninterrupted internet services
- ii. Good internet bandwidth (Min 100 Mbps)
- iii. Good resolution camera (2 nos) – one preferably CCTV (static at one place) and one hand hold (moving)
- iv. Smart phone with minimum 8MPi camera front and back both with optical zoom facility suitable for using web applications like Webex, MicroSoft (MS) Teams, etc.
- v. Computer and Scanner with good resolution
- vi. Digital signatures of supplier's Quality Engineer
- vii. Availability of web applications like Webex, MicroSoft (MS) Teams, as required.
- viii. All Test certificates, internal test reports, calibration reports, etc. for the items offered for inspection.
- ix. Availability of the above to be submitted to BHEL two days in advance before inspection.
- x. Dedicated team from supplier side for facilitating inspection requirements.
- xi. For ensuring proper visibility, the suggested Portable lighting sources (torch/ electric LED bulb of minimum 15 W) with no glare is to be ensured at offered job, location for remote inspection/testing. This is to be verified before start of the inspection.
- xii. The GPS location co-ordinates or any method to locate inspection location shall be captured indicating the location of the Vendor-Premises of remote inspection/testing.

4) REQUIREMENTS AT VENDOR AND CUSTOMER LOCATION

- i. Uninterrupted internet services
- ii. Suitable internet bandwidth
- iii. Digital signatures wherever required.
- iv. Availability of web applications like Webex, MS Teams, etc. as required.
- v. Clearance from customer for conducting remote inspection

5) ROLES

- i. Supplier will raise the inspection call in BHEL - CQIR portal.
- ii. Supplier shall ensure availability of minimum requirements at supplier's works as mentioned above at point 3.

570518/2021/PS-PEM-PGII

- iii. Before starting the inspection, the supplier shall submit the documents (TCs, internal test reports and calibration certificates as per approved QAP) two days before the date of inspection for review by BHEL and supplier shall coordinate with BHEL and if found satisfactory, inspection shall be considered for remote.
 - iv. Prior to commencement of remote inspection a pre inspection meeting shall be organised by BHEL inspector with supplier to ascertain the readiness for remote inspection.
- 6) During inspection, supplier shall share the location on Google maps for verifying the address of the manufacturer. Location may be captured by BHEL as screenshot.
- i. Inspection shall be on the basis of approved Quality Plans and associated reference documents mentioned.
 - ii. For witnessing inspection, supplier shall bring the mobile video camera near to the surface of the equipment or as per requirement of the inspector for clarity in viewing the test/ equipment which shall be the responsibility of supplier. Supplier shall ensure that proper lighting is available during live video streaming.
 - iii. Before start of the inspection, inspector shall ensure that all instruments shall have valid calibration report. Supplier shall ensure use of digital instruments preferably for inspection to the extent possible.
 - iv. Details of suppliers's dedicated team handling the remote inspection shall also be incorporated in the CQIR.
 - v. All details of inspection/ testing referred documents shall be mentioned in the CQIR. Recording of remote inspection shall be maintained by the BHEL inspector and this recording (unedited) shall be maintained at BHEL system for a minimum period of 3 years or till the warranty period whichever is later.
 - vi. PEM (Engineering) shall accord final technical clearance, in case of any deviation in inspected item noticed during inspection.
 - vii. Inspection shall be conducted by PEM-Q&BE assigned inspector along with PEM-Engg (if required). CQIR shall be prepared and maintained by PEM-Q&BE.
 - viii. PG will issue MDCC on the basis of acceptance of inspected items along with accepted packing photographs as per contract provisions.
- 7) **UN ERTA NG EN OR** Material inspected through remote inspections is meeting all technical requirements of BHEL. In case of any discrepancy from the above procedure/ material inspected, if found later, vendor will replace the materials without any cost implication to BHEL.
- 8) Vendor shall provide the signed and stamped of the above guidelines to BHEL as a token of acceptance.

530930/2021/PS-PEM-EGII



**PRE-QUALIFICATION REQUIREMENTS FOR
SCREENED CONTROL CABLE**

PE-PQ-999-507-E016




REVISION NO. 04 DATE 29/09/2017

SHEET NO. 1 OF 1

ITEMS : Screened Control Cable	
SCOPE : Supply : YES; Erection & Commissioning : NO;	
1.0	Vendor should be a manufacturer of screened/ instrumentation control cables.
2.0	Availability of test reports of tests on FRLS screened control cables to establish in-house Capability to carry out all routine, type acceptance as per relevant IS/ International Standards (except UV radiation & hydrolytic stability Test which can be conducted at Govt. Lab/ Govt. approved Independent lab).
3.0	Capacity of manufacturing 200 km of screened control cables per month.
4.0	Manufactured and supplied at least one (1) km of FRLS cables.
5.0	Manufactured and supplied screened control cables up to 20 pairs.
6.0	Manufactured and supplied at least 1000 Km of Screened Control cables in one or more orders and at least 200 Km in one single order.
7.0	Minimum two (2) nos. purchase orders for screened control cables shall be submitted which should not be more than five (5) years old from the date of application for registration or date of techno-commercial bid opening (as applicable) for establishing continuity in business.

Notes (General points):

1. Consideration of offer shall be subject to customer's approval of bidders, if applicable.
2. Bidder to submit all supporting documents in English. If documents submitted by bidder are in language other than English, a self-attested English translated document should also be submitted.
3. Any other project specific requirement shall be as per Annexure-I and bidder shall submit relevant supporting documents.
4. Notwithstanding anything stated above, BHEL reserves the right to assess the capabilities and capacity of the bidder to perform the contract, should the circumstances warrant such assessment in the overall interest of BHEL.
5. After satisfactory fulfillment of all the above criteria/ requirement, offer shall be considered for further evaluation as per NIT and all the other terms of the tender.

PREPARED BY  ABHISHEK, MANAGER (CONVENOR) 29/9/17	REVIEWED BY  MANISH SHUKLA, DGM (APPROVER) 29/9/17	APPROVED BY  MEENA KESRI, GM (DH) 29.9.17
---	--	---

**BHEL PEM ELECTRICAL
PRE-QUALIFYING REQUIREMENTS FOR SCREENED CONTROL CABLE
ANNEXURE – I
PROJECT SPECIFIC CRITERIA AGAINST ENQUIRY
PROJECT: 2X660 MW THDC KHURJA-TG**

-NIL-

Anjali
Anjali
[Sr. Engineer]

Digitally signed by Anjali
DN: cn=Anjali, o=BHEL, ou=PS-PEM,
email=anjali@bhel.in, c=IN
Date: 2021.09.22 14:16:41 +05'30'

**KAVITA
GUPTA**
Kavita Gupta
[Manager]

Digitally signed by
KAVITA GUPTA
DN: cn=KAVITA GUPTA,
o=BHEL, ou=BHEL-PEM,
email=kavitagupta@bhel.in, c=IN
Date: 2021.09.22
14:56:53 +05'30'

okumar
Omkar Kumar
[Section Head]

Digitally signed by okumar
DN: cn=okumar, o=bhel, ou=bhel,
email=okumar@bhel.in, c=IN
Date: 2021.09.22 15:44:24 +05'30'

**DEBASISA
RATH**
Debasisa Rath
[DH-Electrical]

Digitally signed by DEBASISA RATH
DN: cn=DEBASISA RATH, o=BHEL PEM ELECTRICALS
LIMITED, ou=BHEL PS PEM No50,
serialNumber=201101, c=IN, email=DEBASISA.RATH@bhel.in,
2.5.4.20=66a81891e6a423b350e4779a79a76760563
2964F007a205c0a8a2310150a7676,
cn=DEBASISA RATH
Date: 2021.09.23 11:02:12 +05'30'

Ref: PW/PE/CMM-PVC Cables Packages (Rev-02)

Dated:19/02/2019

Note: Applicable for cable tenders released on or after 14/01/2019.

Price Variation Formulae for cables -Annexure-I

1. Prices shall be variable as per price variation formulae given below (basis IEEMA).
The price variation shall be limited to + 20% of total ex-works price actually supplied (cable size wise) and -ve price variation shall be unlimited. Rates for working out price variation shall be as per rates published by IEEMA for the factors given in Annexure-II

2. Base date for prices:

Initial Price (As per IEEMA) for- Alo, Cuo, CCo, PVCCo & Feo:

Base Date shall be- 1st working day of the previous month to the date of issue of tender enquiry.

Final Price (as per IEEMA) for- AI, Cu, Cc, PVCC & Fe:

1st working day of month, one month prior to the date on which cable is notified as being ready for inspection i.e TPIA inspection call raise date on web portal.

3. Variation factor value for ALF, CuF, CCFAL, CCFCu, XLFAL, XLFCu, FeF & FeW as applicable shall be as per Technical Specification.

4. PVC shall be payable within contractual delivery period (including any extension thereto).

IEEMA table for Price variation cause for various type of cable

1. Aluminium conductor cable

S.No	Cable Type	AIF (Single core unarmoured & Multi core armoured)	AIF (Single core armoured)	CCFAI	XLFAL (Single core)	XLFAL (Multi core)	FeF	FeW	IEEMA Formula
1.	HT XLPE Power cable	ALP	H1	H2	XL3	XL4	H3	H5	$P=Po+AIF(AL-Alo) + XLFAL(CC-CCo) +CCFAI(PVCC-PVCCo) + FeF(Fe-Feo)$
2.	LT XLPE Power Cable	ALP	P1	L2	XL1	XL1	P3	P3 (Additional)	$P=Po+AIF(AL-Alo) + XLFAL(CC-CCo) +CCFAI(PVCC-PVCCo) + FeF(Fe-Feo)$
3.	LT PVC Power Cable	ALP	P1	P2	-	-	P3	P3 (Additional)	$P=Po+AIF(AL-Alo) + CCFAI(PVCC-PVCCo) + FeF(Fe-Feo)$
4.	LT HRPVC Power Cable	ALP	P1	P2	-	-	P3	P3 (Additional)	$P=Po+AIF(AL-Alo) + CCFAI(PVCC-PVCCo) + FeF(Fe-Feo)$

2. Copper conductor cable

S no.	Cable type	CuF	AIF (single core armou red)	CCFCu	XLFCU (Single core)	XLFCU (Multi core)	FeF	FeW	IEEMA Formula
1	HT XLPE Power cable	CUP	H4	H2	XL3	XL4	H3	H5	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) +CCFCu(PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
2	LT XLPE Power Cable	CUP	P4	L2	XL1	XL1	P3	P3 (Addit ional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$

S no.	Cable type	CuF	AIF (single core armou red)	CCFCu	XLFCU (Single core)	XLFCU (Multi core)	FeF	FeW	IEEMA Formula
3	LT PVC Power Cable	CUP	P4	P2	--	--	P3	P3 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
4	LT HRPVC Power Cable	CUP	P4	P2	--	--	P3	P3 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
5	LT XLPE Control Cable	CUC	--	P5	--	XL2	P6	P6 (Addit ional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
6	LT PVC Control Cable	CUC	--	P5	--	--	P6	P6 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
7	LT HRPVC Control Cable	CUC	--	P5	--	--	P6	P6 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu(PVCC-PVCCo) + FeF(Fe-Feo)$
8	LT XLPE Fire Survival Power Cable	CUP	P4	L2	XL1	XL1	P3	P3 (Addit ional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
9	LT XLPE Fire Survival Control	CUC	--	P5	--	XL2	P6	P6 (Addit ional)	$P=Po+CuF(Cu-Cuo) + XLFCU(CC-CCo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
10	LT EPR Fire Survival Power Cable	CUP	P4	L2	--	--	P3	P3 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo) + AIF(AL-Alo)$
11	LT EPR Fire Survival Control cable	CUC	--	P5	--	--	P6	P6 (Addit ional)	$P=Po+CuF(Cu-Cuo) + CCFCu (PVCC-PVCCo) + FeF(Fe-Feo)$
12	Screened control Cable (Overall screen)	Cu POS	--	--	--	--	Fe POS	Fe POS	$P=Po+CuF(Cu-Cuo) + FeF(Fe-Feo)$
13	Screened control Cable (Individual	Cu PIS	--	--	--	--	Fe PIS	Fe PIS	$P=Po+CuF(Cu-Cuo) + FeF(Fe-Feo)$

Annexure-II

IEEMA Table for Price Variation Clause for various types of Cables**Notes:-**

(i) Cu POS, Cu PIS, Fe POS & Fe PIS tables shall be as per IEEMA circular No. IEEMA (PVC) /Instrumentation Cable/2014 effective from dtd 01.07.2014.

(ii) All other tables shall be as per IEEMA circular No. 35//DIV/CAB/05/ dated 24.04.2018.

Terms used in PVC formulae:

P = Price payable as adjusted in accordance with above appropriate formula (In Rs./Km).

Po= Price quoted/confined (in Rs./km).

1. ALUMINIUM

ALF Variation factor for aluminium.

Al =Price of aluminium.

Alo = Price of aluminium.

2 COPPER

CuF =Variation factor for copper.

Cu = Price of CC copper rods.

Cuo = Price of CC copper rods.

3.PVCC COMPOUND/POLYMER

PVCC = Price of PVC compound.

PVCCo= Price of PVC compound.

CCFAL= Variation factor for PVC compound/Polymer for aluminium conductor cable.

CCFCu =Variation factor for PVC compound/Polymer for copper conductor cable.

4. XLPE COMPOUND

Cc = Price of XLPE compound.

Cco= Price of XLPE compound.

XLFAL= Variation factor for XLPE compound for aluminium conductor cable.

XLFCu =Variation factor for XLPE compound for copper conductor cable.

5.STEEL

Fe= Price of steel strips/steel wire.

Feo= Price of steel strips/steel wire.

FeF =Variation factor for steel.

FeW=Variation factor for round wire steel armouring.



501, Kakad Chambers
132, Dr. Annie Besant Road, Worli
Mumbai 400018
India

P: +91 22 2493 0532
F: +91 22 2493 2705
E: mumbai@ieema.org
www.ieema.org

IEEMA (PVC)/Instrumentation Cable/2014

Effective from: 1st July 2014

Material Price Variation Clause For Instrumentation Cables

The Price quoted/confirmed is based on the input cost of raw materials/components as on the date of quotation, and the same is deemed to be related to the prices of raw materials as specified in the price variation clause given below. In case of any variation in these prices, the price payable shall be subject to adjustment up or down in accordance with the formulae provided in this document.

Terms used in price variation formulae:

P Price payable as adjusted in accordance with above appropriate formula (in Rs/Km)

P₀ Price quoted/confirmed (in Rs/Km)

COPPER

CuF Variation factor for copper

Cu Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cu₀ Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of tendering.

STEEL

FeF Variation factor for steel

Fe Price of Steel Strips/steel wire. This price is as applicable on the first working day of the month, one month prior to the date of delivery.

Fe₀ Price of steel strips/steel wire. This price is as applicable on first working day of the month, one month prior to the date of tendering.

The above prices and indices are as published by IEEMA vide Circular reference IEEMA(PVC)/CABLE/--/-- prevailing as on 1st working day of the month i.e. one month prior to the date of tendering.

The date of delivery is the date on which the cable is notified as being ready for inspection/dispatch (in the absence of such notification, the date of manufacturer's dispatch note is to be considered as the date of delivery) or the contracted delivery date (including any agreed extension thereto), whichever is earlier.

Page 1 of 2

New Delhi	Bangalore	Kolkata
Rishyamook Building, First Floor 85 A, Panchkuian Road New Delhi 110001, India P: +91 11 2336 3013/14 F: +91 11 2336 3015 E: delhi@ieema.org	204, Swiss Complex 33, Race Course Road Bangalore 560001, India P: +91 80 2220 1316/18 F: +91 80 2220 1317 E: bangalore@ieema.org	503 A, Oswal Chambers 2, Church Lane Kolkata 700001, India P: +91 33 6510 7855 F: +91 33 2213 1326 E: kolkata@ieema.org

Indian Electrical & Electronics Manufacturers' Association

**IEEMA (PVC)/Instrumentation Cable/2014****Effective from: 1st July 2014****Notes**

- (a) All prices of raw materials are exclusive of modvatable excise/CV duty amount and exclusive of any other central, state or local taxes, octroi, etc.
- (b) All Prices are as on first working day of the month.
- (c) The details of prices are as under:
1. Price of CC copper rods (in Rs/MT) is ex-works price as quoted by the primary producer.
 2. Price of galvanized steel strip / steel wire (in Rs/MT) is ex-works price as quoted by the manufacturer for Round steel Wire and Flat steel strip (the relevant price of steel strip or steel wire is to be selected depending upon the type of armouring of the cable).

Price variation formula for 'Instrumentation Cables'

$$P = P_o + CuF (Cu - Cuo) + FeF (Fe - Feo)$$

1. For Pair Instrumentation Over all Screen CablesTables References:

Cu POS Copper Factor
 Fe POS Steel Factor

2. For Pair Instrumentation Individual and Over all Screen CablesTables References:

Cu PIS Copper Factor
 Fe PIS Steel Factor

3. For Triad Instrumentation Over all Screen CablesTables References:

Cu TOS Copper Factor
 Fe TOS Steel Factor

4. For Triad Instrumentation Individual & Overall Screen CablesTables References:

Cu TIS Copper Factor
 Fe TIS Steel Factor


 Deputy Director General
 Page 2 of 2

Copper Factors for Instrumentation Cables - CuF

Cu POS

Pair Instrumentation Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.0142	0.0185	0.0233	0.0326	0.0500
2	0.0258	0.0345	0.0440	0.0625	0.0978
3	0.0353	0.0484	0.0626	0.0904	0.1433
4	0.0448	0.0623	0.0811	0.1183	0.1888
5	0.0578	0.0800	0.1022	0.1467	0.2356
6	0.0662	0.0926	0.1210	0.1768	0.2829
7	0.0756	0.1067	0.1378	0.2000	0.3245
8	0.0852	0.1204	0.1582	0.2327	0.3741
9	0.0933	0.1334	0.1734	0.2534	0.4134
10	0.1046	0.1485	0.1959	0.2893	0.4665
11	0.1111	0.1600	0.2089	0.3067	0.5023
12	0.1236	0.1764	0.2333	0.3452	0.5580
13	0.1289	0.1867	0.2445	0.3600	0.5912
14	0.1378	0.2000	0.2623	0.3867	0.6356
15	0.1467	0.2134	0.2800	0.4134	0.6801
16	0.1618	0.2322	0.3080	0.4573	0.7409
17	0.1645	0.2400	0.3156	0.4667	0.7690
18	0.1734	0.2534	0.3334	0.4934	0.8134
19	0.1822	0.2667	0.3512	0.5201	0.8579
20	0.1911	0.2800	0.3689	0.5467	0.9023
21	0.2000	0.2934	0.3867	0.5734	0.9468
22	0.2089	0.3067	0.4045	0.6001	0.9912
23	0.2178	0.3200	0.4223	0.6267	1.0357
24	0.2381	0.3437	0.4575	0.6813	1.1068
25	0.2356	0.3467	0.4578	0.6801	1.1246
26	0.2445	0.3600	0.4756	0.7068	1.1690
27	0.2534	0.3734	0.4934	0.7334	1.2135
28	0.2623	0.3867	0.5112	0.7601	1.2579
29	0.2711	0.4001	0.5290	0.7868	1.3024
30	0.2800	0.4134	0.5467	0.8134	1.3468
31	0.2889	0.4267	0.5645	0.8401	1.3913
32	0.2978	0.4401	0.5823	0.8668	1.4357
33	0.3067	0.4534	0.6001	0.8934	1.4802
34	0.3156	0.4667	0.6179	0.9201	1.5246
35	0.3245	0.4801	0.6356	0.9468	1.5691
36	0.3334	0.4934	0.6534	0.9735	1.6135
37	0.3423	0.5067	0.6712	1.0001	1.6580
38	0.3512	0.5201	0.6890	1.0268	1.7024
39	0.3600	0.5334	0.7068	1.0535	1.7469
40	0.3689	0.5467	0.7245	1.0801	1.7913
41	0.3778	0.5601	0.7423	1.1068	1.8358
42	0.3867	0.5734	0.7601	1.1335	1.8802
43	0.3956	0.5867	0.7779	1.1601	1.9247
44	0.4045	0.6001	0.7957	1.1868	1.9691
45	0.4134	0.6134	0.8134	1.2135	2.0136
46	0.4223	0.6267	0.8312	1.2402	2.0580
47	0.4312	0.6401	0.8490	1.2668	2.1025
48	0.4710	0.6759	0.9010	1.3410	2.2009

Copper Factors for Instrumentation Cables - CuF

Cu PIS

Pair Instrumentation Individual and Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.0133	0.0178	0.0222	0.0311	0.0489
2	0.0349	0.0437	0.0531	0.0717	0.1069
3	0.0490	0.0621	0.0763	0.1041	0.1570
4	0.0630	0.0806	0.0994	0.1389	0.2071
5	0.0800	0.1022	0.1245	0.1689	0.2578
6	0.0937	0.1200	0.1484	0.2042	0.3103
7	0.1067	0.1378	0.1689	0.2311	0.3556
8	0.1218	0.1569	0.1948	0.2692	0.4107
9	0.1334	0.1734	0.2134	0.2934	0.4534
10	0.1503	0.1943	0.2417	0.3349	0.5122
11	0.1600	0.2089	0.2578	0.3556	0.5512
12	0.1785	0.2313	0.2882	0.4001	0.6128
13	0.1867	0.2445	0.3023	0.4178	0.6490
14	0.2000	0.2623	0.3245	0.4489	0.6979
15	0.2134	0.2800	0.3467	0.4801	0.7468
16	0.2350	0.3053	0.3812	0.5305	0.8141
17	0.2400	0.3156	0.3912	0.5423	0.8446
18	0.2534	0.3334	0.4134	0.5734	0.8934
19	0.2667	0.3512	0.4356	0.6045	0.9423
20	0.2800	0.3689	0.4578	0.6356	0.9912
21	0.2934	0.3867	0.4801	0.6668	1.0401
22	0.3067	0.4045	0.5023	0.6979	1.0890
23	0.3200	0.4223	0.5245	0.7290	1.1379
24	0.3479	0.4535	0.5673	0.7911	1.2165
25	0.3467	0.4578	0.5690	0.7912	1.2357
26	0.3600	0.4756	0.5912	0.8223	1.2846
27	0.3734	0.4934	0.6134	0.8534	1.3335
28	0.3867	0.5112	0.6356	0.8846	1.3824
29	0.4001	0.5290	0.6579	0.9157	1.4313
30	0.4134	0.5467	0.6801	0.9468	1.4802
31	0.4267	0.5645	0.7023	0.9779	1.5291
32	0.4401	0.5823	0.7245	1.0090	1.5780
33	0.4534	0.6001	0.7468	1.0401	1.6269
34	0.4667	0.6179	0.7690	1.0712	1.6758
35	0.4801	0.6356	0.7912	1.1024	1.7247
36	0.4934	0.6534	0.8134	1.1335	1.7736
37	0.5067	0.6712	0.8357	1.1646	1.8225
38	0.5201	0.6890	0.8579	1.1957	1.8713
39	0.5334	0.7068	0.8801	1.2268	1.9202
40	0.5467	0.7245	0.9023	1.2579	1.9691
41	0.5601	0.7423	0.9246	1.2891	2.0180
42	0.5734	0.7601	0.9468	1.3202	2.0669
43	0.5867	0.7779	0.9690	1.3513	2.1158
44	0.6001	0.7957	0.9912	1.3824	2.1647
45	0.6134	0.8134	1.0135	1.4135	2.2136
46	0.6267	0.8312	1.0357	1.4446	2.2625
47	0.6401	0.8490	1.0579	1.4757	2.3114
48	0.6887	0.8936	1.1186	1.5587	2.4186

Steel Factors for Instrumentation Cables - FeF					
Fe POS					
Pair Instrumentation Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.1490	0.1565	0.1635	0.1735	0.1930
2	0.2190	0.2335	0.2470	0.2665	0.2595
3	0.2360	0.2545	0.2690	0.2900	0.2680
4	0.2390	0.2580	0.2715	0.2945	0.2830
5	0.2630	0.2820	0.2420	0.2805	0.3155
6	0.2840	0.3160	0.2805	0.2995	0.3430
7	0.2840	0.2595	0.2805	0.2995	0.3430
8	0.3235	0.2930	0.3030	0.3315	0.3780
9	0.2805	0.3180	0.3290	0.3590	0.4205
10	0.2970	0.3215	0.3455	0.3755	0.4385
11	0.3005	0.3255	0.3490	0.3805	0.4435
12	0.3055	0.3440	0.3680	0.3880	0.4520
13	0.3265	0.3530	0.3780	0.4105	0.4785
14	0.3265	0.3530	0.3780	0.4105	0.4785
15	0.3490	0.3765	0.4015	0.4365	0.5195
16	0.3490	0.3765	0.4015	0.4365	0.5195
17	0.3590	0.4005	0.4140	0.4635	0.5470
18	0.3590	0.4005	0.4265	0.4635	0.5470
19	0.3590	0.4005	0.4265	0.4635	0.5470
20	0.3830	0.4240	0.4535	0.4920	0.5760
21	0.3830	0.4240	0.4535	0.4920	0.5760
22	0.4065	0.4520	0.4785	0.5310	0.6190
23	0.4065	0.4520	0.4810	0.5310	0.6190
24	0.4305	0.4770	0.5070	0.5595	0.6475
25	0.4305	0.4770	0.5070	0.5595	0.6475
26	0.4305	0.4770	0.5070	0.5595	0.6475
27	0.4355	0.4820	0.5245	0.5660	0.6700
28	0.4570	0.5045	0.5345	0.5895	0.6950
29	0.4570	0.5045	0.5345	0.5895	0.6950
30	0.4570	0.5045	0.5345	0.5895	0.6950
31	0.4795	0.5285	0.5595	0.6150	0.7225
32	0.4820	0.5285	0.5595	0.6150	0.7225
33	0.4820	0.5285	0.5595	0.6150	0.7225
34	0.4920	0.5520	0.5835	0.6410	0.7500
35	0.4920	0.5520	0.5835	0.6410	0.7500
36	0.4920	0.5520	0.5835	0.6410	0.7500
37	0.4920	0.5520	0.5835	0.6410	0.7500
38	0.5145	0.5760	0.6225	0.6550	0.7805
39	0.5145	0.5760	0.6225	0.6550	0.7805
40	0.5145	0.5760	0.6225	0.6550	0.7805
41	0.5395	0.6025	0.6475	0.6975	0.8230
42	0.5395	0.6025	0.6475	0.6975	0.8230
43	0.5395	0.6025	0.6475	0.6975	0.8230
44	0.5635	0.6265	0.6735	0.7250	0.8540
45	0.5835	0.6265	0.6760	0.7250	0.8540
46	0.5635	0.6265	0.6760	0.7250	0.8540
47	0.5635	0.6265	0.6760	0.7250	0.8540
48	0.5635	0.6265	0.6760	0.7375	0.8665

Steel Factors for Instrumentation Cables - FeF					
Fe PIS					
Pair Instrumentation Individual and Over all Screen Cables					
No. of Pairs Cable size in sq.mm	0.5 sq.mm	0.75 sq.mm	1.0 sq.mm	1.5 sq.mm	2.5 sq.mm
1	0.1880	0.1980	0.2070	0.2220	0.2410
2	0.2315	0.2460	0.2595	0.2815	0.2755
3	0.2505	0.2690	0.2820	0.2495	0.2830
4	0.2645	0.2830	0.2420	0.2805	0.3155
5	0.2895	0.2730	0.2805	0.3005	0.3430
6	0.2755	0.2980	0.3005	0.3280	0.3730
7	0.2755	0.2980	0.3005	0.3280	0.3730
8	0.2980	0.3215	0.3455	0.3740	0.4230
9	0.3230	0.3490	0.3730	0.4040	0.4685
10	0.3405	0.3655	0.3765	0.4215	0.4885
11	0.3430	0.3690	0.3815	0.4265	0.4945
12	0.3490	0.3765	0.4015	0.4470	0.5160
13	0.3715	0.3990	0.4255	0.4720	0.5420
14	0.3715	0.3990	0.4255	0.4720	0.5420
15	0.3955	0.4240	0.4510	0.5020	0.5720
16	0.3955	0.4240	0.4510	0.5020	0.5720
17	0.4190	0.4495	0.4795	0.5295	0.6150
18	0.4190	0.4495	0.4795	0.5295	0.6150
19	0.4190	0.4495	0.4795	0.5295	0.6150
20	0.4445	0.4770	0.5060	0.5570	0.6450
21	0.4445	0.4895	0.5060	0.5695	0.6450
22	0.4695	0.5045	0.5345	0.5870	0.6885
23	0.4695	0.5045	0.5345	0.5870	0.6885
24	0.4970	0.5310	0.5620	0.6285	0.7210
25	0.4970	0.5310	0.5620	0.6285	0.7210
26	0.4970	0.5310	0.5620	0.6285	0.7210
27	0.5035	0.5495	0.5810	0.6360	0.7410
28	0.5135	0.5610	0.6050	0.6610	0.7690
29	0.5135	0.5610	0.6050	0.6610	0.7690
30	0.5260	0.5610	0.6050	0.6610	0.7690
31	0.5495	0.5845	0.6300	0.6885	0.7990
32	0.5495	0.5845	0.6300	0.6885	0.7990
33	0.5495	0.5845	0.6300	0.6885	0.7990
34	0.5735	0.6225	0.6585	0.7285	0.8405
35	0.5735	0.6225	0.6585	0.7285	0.8405
36	0.5735	0.6225	0.6585	0.7285	0.8405
37	0.5735	0.6225	0.6585	0.7285	0.8405
38	0.5990	0.6485	0.6850	0.7575	0.8740
39	0.5990	0.6485	0.6850	0.7575	0.8740
40	0.5990	0.6485	0.6850	0.7575	0.8740
41	0.6250	0.6775	0.7135	0.7880	0.9180
42	0.6250	0.6775	0.7135	0.7880	0.9180
43	0.6250	0.6775	0.7135	0.7880	0.9180
44	0.6485	0.7050	0.7410	0.8165	0.9495
45	0.6485	0.7050	0.7410	0.8165	0.9495
46	0.6485	0.7050	0.7410	0.8165	0.9495
47	0.6485	0.7050	0.7410	0.8165	0.9495
48	0.6485	0.7050	0.7535	0.8290	0.9620

CIN No. U99999MH1970GAP014629



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

Cir. No. 35/DIV/CAB/05/

24th April 2018

To Members of the Cable Division, Utilities, Railways & Listed purchasing organizations

Sub: Correction in PV formulae of LT XLPE Power Cable and addition of factors for HT XLPE Power Cables

We have recently published revised Price Variation Clause for LT&HT XLPE Power Cables and made it effective from 1st November 2017 vide Cir. No.111/DIV/CAB/05 dated 5th December 2017

While replying to a query of a buyer it is observed that the polymer factor for LT XLPE Power Cables (both aluminium and copper) was incorrectly represented by Table P2.

We have now corrected the anomaly by correcting the PV formulae of LT XLPE Aluminium and Copper Insulated Cables (Sl. No. D & E) by representing Polymer factor by Table L2.

We have also worked out factors for XLPE, Copper and Steel for 3 core HT XLPE Power Cables for 500 and 630 sq.mm.

We now enclose complete PV clause of Cable by including all the PV formulae of different types of power cable (Sl. No. A to I), polymer factor Table L2 and updated XL4, H2 and H5 Table of factors for your perusal & record.

We request to replace PV clause of Cable already circulated vide Cir. 111/DIV/CAB/05 dated 5th December 2017 with the enclosed PV clause in your records for future use.



Senior Director

Encl: as above

prasad partners in implementation



HEAD OFFICE - DELHI
 Rishyamook Building, First Floor, 85 A, Panchkuian Road, New Delhi – 110001, INDIA.
 P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 2017

Material Price Variation Clause For PVC And XLPE Insulated Cables

The Price quoted/confirmed is based on the input cost of raw materials/components as on the date of quotation, and the same is deemed to be related to the prices of raw materials as specified in the price variation clause given below. In case of any variation in these prices, the price payable shall be subject to adjustment up or down in accordance with the formulae provided in this document.

Terms used in price variation formulae:

P Price payable as adjusted in accordance with above appropriate formula (in Rs/Km)

Po Price quoted/confirmed (in Rs/Km)

ALUMINIUM

AIF Variation factor for aluminium

AI Price of Aluminium. This price is as applicable of first working day of the month, one month prior to the date of delivery.

Alo Price of aluminium. This price is as applicable on first working day of the month, one month prior to the date of tendering.

COPPER

CuF Variation factor for copper

Cu Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cuo Price of CC copper rods. This price is as applicable on first working day of the month, one month prior to the date of tendering.

PVC COMPOUND

PVCc price of PVC compound. This price is as applicable on first working day of the month, one month prior to the date of delivery.

PVCco Price of PVC compound. This price is as applicable on first working day of the month, one month prior to the date of tendering.

CCFAI Variation factor for PVC compound/Polymer for aluminum conductor cable.

CCFCu Variation factor for PVC compound/Polymer for copper conductor cable.

proud partners in implementation



HEAD OFFICE - DELHI

Rishyamook Building, First Floor, 85 A, Panchsuan Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

**IEEMA (PVC)/CABLE(R-1)/2017
 XLPE COMPOUND**

Effective from: 1st November 217

Cc price of XLPE compound. This price is as applicable on first working day of the month, one month prior to the date of delivery.

Cco Price of XLPE compound. This price is as applicable on first working day of the month, one month prior to the date of tendering.

XLFAL Variation factor for XLPE compound for aluminum conductor cable.

XLFCU Variation factor for XLPE compound for Copper conductor cable.

STEEL

FeF Variation factor for steel

FeW Variation factor for round wire steel armouring

Fe Price of Steel Strips/steel wire. This price is as applicable on the first working day of the month, one month prior to the date of delivery.

Feo Price of steel strips/steel wire. This price is as applicable on first working day of the month, one month prior to the date of tendering.

The above prices and indices are as published by IEEMA vide Circular reference IEEMA (PVC)/CABLE R(1)/--/-- prevailing as on 1st working day of the month i.e. one month prior to the date of tendering.

The date of delivery is the date on which the cable is notified as being ready for inspection/dispatch (in the absence of such notification, the date of manufacturer's dispatch note is to be considered as the date of delivery) or the contracted delivery date (including any agreed extension thereto), whichever is earlier.

Notes

- (a) All prices of raw materials are exclusive of GST amount.
- (b) All prices excluding Aluminium & Copper are as on first working day of the month.
- (c) The details of prices are as under:
 1. Price of Aluminium is LME average Cash SELLER Settlement price of Primary Aluminium in US\$ per MT as published by London Metal Bulletin (LME) including Premium for Aluminium Ingot in US\$ per MT is converted in Indian Rs./MT.
 2. Price of PVC Compound (in Rs/MT) is the ex-works price, as quoted by the manufacturer.
 3. Price of XLPE Compound (in Rs/MT) is the ex-works price, as quoted by the manufacturer
 4. Price of CC copper rods (in Rs/MT) is ex-works price as quoted by the primary producer.
 5. Price of galvanized steel strip / steel wire (in Rs/MT) is ex-works price as quoted by the manufacturer for Round steel Wire and Flat steel strip (the relevant price of steel strip or steel wire is to be selected depending upon the type of armouring of the cable).

proud partners in implementation



HEAD OFFICE - DELHI

Rishyamook Building, First Floor, 85 A, Panchsukian Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

Price variation formulae for 'Power Cables'

A. Aluminum conductor PVC insulated 1.1 kV power cables

$$P = P_o + AIF (AL - ALo) + CCFAl (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
P1	Aluminium conductor aluminium armour in single core armoured cables
P2	PVC compound
P3	Steel armour

B. Copper conductor PVC insulated 1.1 kV power cables

$$P = P_o + CuF (Cu - Cuo) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo) + AIF (Al - ALo)$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0

For unarmoured cables; FeF, AIF = 0

Tables References:

CUP	Copper conductor
P2	PVC compound
P3	Steel armour
P4	Aluminium armour

C. Copper conductor PVC insulated 1.1 kV control cables

$$P = P_o + CuF (Cu - Cuo) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured cables; FeF = 0

Tables References:

CUC	Copper conductor
P5	PVC compound
P6	Steel armour

D. Aluminum conductor XLPE insulated 1.1 kV power cables

$$P = P_o + AIF (AL - ALo) + XLFAL(CC-Cco) + CCFAl (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
P1	Aluminium conductor aluminium armour in single core armoured cables
L2	Polymer (CCFAl)
P3	Steel armour
XL1	XLPE Compound (XLFAL)

E. Copper conductor XLPE insulated 1.1 kV power cables

$$P = P_o + CuF (Cu - Cuo) + XLFCU (CC-Cco) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo) + AIF (Al - ALo)$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0

proud partners in implementation



HEAD OFFICE - DELHI

Rishyamook Building, First Floor, 85 A, Panchkuian Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org



Indian Electrical & Electronics Manufacturer's Association
 501, Kakad Chambers P +91 22 2493 0532
 132, Dr. A. B. Road, Worli, F +91 22 2493 2705
 Mumbai - 400 018. E mumbai@ieema.org
 INDIA. W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

For unarmoured cables; FeF, AIF = 0

Tables References:

CUP	Copper conductor
L2	Polymer (CCFCu)
P3	Steel armour
P4	Aluminium armour
XL1	XLPE Compound (XLFCu)

F. Copper conductor XLPE insulated 1.1 kV control cables

$$P = P_o + CuF (Cu - C_uo) + XLFCU (CC-Cco) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured cables; FeF = 0

Tables References:

CUC	Copper conductor
P5	PVC compound
P6	Steel armour
XL2	XLPE Compound

G. For Aluminium conductor XLPE insulated 3.3 to 33 kV power cables

$$P = P_o + AIF (Al - A_lo) + XLFAL (CC-Cco) + CCFAI (PVCc - PVCco) + FeF (Fe - Feo)$$

For unarmoured multicore cables (without steel armour); FeF = 0

Table References:

ALP	Aluminium conductor in single core unarmoured & multicore cables
H1	Aluminium conductor + aluminium armour in single core armoured cables
H2	Polymer
H3/H5	Steel armour (Flat/Round)
XL3/XL4	XLPE Compound (Single core /Multicore)

H. Copper conductor XLPE Insulated 3.3 to 33 kV power cables

$$P = P_o + CuF (Cu - C_uo) + XLFCU (CC-Cco) + CCFCu (PVCc - PVCco) + FeF (Fe - Feo) + AIF (Al - A_lo)$$

For steel armoured cables; AIF = 0 For aluminium armoured cables; FeF = 0

For unarmoured cables; FeF, AIF = 0

Table References:

CUP	Copper conductor
H2	Polymer
H3/H5	Steel armour (Flat/Round)
H4	Aluminium armour
XL3/XL4	XLPE Compound (Single core /Multicore)

I. Copper conductor XLPE insulated 1.0 and 1.5 kV Solar PV DC cables

$$P = P_o + CuF (Cu - C_uo)$$

Table CUscd Copper Conductor


 Authorized Signatory

proud partners in implementation



HEAD OFFICE - DELHI

Rishyamook Building, First Floor, 85 A, Panchkuian Road, New Delhi - 110001, INDIA.

P +91 11 2336 3013 / 14 • F +91 11 2336 3015 • E delhi@ieema.org • W www.ieema.org

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE ALP

 VARIATION FACTOR FOR ALUMINIUM (AIF)
 POWER CABLES WITH ALUMINIUM CONDUCTOR
 (EXCLUDING SINGLE CORE ARMoured CABLES)

Nominal Cross Sectional Area (in Sq. mm.)	1 core	2 core	3 core	3.5 core	4 core
2.5	0.007	0.014	0.021	-	0.028
4	0.011	0.023	0.034	-	0.046
6	0.017	0.034	0.052	-	0.069
10	0.029	0.053	0.087	-	0.116
16	0.046	0.091	0.137	-	0.183
25/16	0.073	0.146	0.219	0.262	0.292
35/16	0.101	0.202	0.302	0.345	0.404
50/25	0.137	0.273	0.410	0.478	0.547
70/35	0.197	0.395	0.593	0.687	0.791
95/50	0.274	0.548	0.821	0.949	1.095
120/70	0.346	0.691	1.036	1.221	1.382
150/70	0.425	0.853	1.279	1.464	1.706
185/95	0.533	1.070	1.605	1.861	2.140
225/120	0.655	1.310	1.965	2.287	2.620
240/120	0.703	1.400	2.099	2.421	2.799
300/150	0.879	1.757	2.635	3.033	3.514
400/185	1.126	2.249	3.374	3.873	4.498
500	1.418	2.838	4.256	-	5.675
630	1.828	3.663	5.494	-	7.326
800	2.340	4.679	7.018	-	9.357
1000	2.951	5.890	8.834	-	11.779

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE CUP

 VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
 POWER CABLES WITH COPPER CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm.)	1 core	2 core	3 core	3.5 core	4 core
2.5	0.023	0.046	0.069	-	0.092
4	0.036	0.076	0.112	-	0.151
6	0.056	0.112	0.171	-	0.227
10	0.095	0.174	0.286	-	0.382
16	0.151	0.299	0.451	-	0.602
25/16	0.240	0.480	0.720	0.862	0.960
35/16	0.332	0.664	0.993	1.135	1.329
50/25	0.451	0.898	1.348	1.572	1.799
70/35	0.648	1.299	1.950	2.260	2.602
95/50	0.901	1.802	2.700	3.121	3.601
120/70	1.138	2.273	3.407	4.016	4.545
150/70	1.398	2.806	4.207	4.815	5.611
185/95	1.753	3.519	5.279	6.121	7.038
225/120	2.154	4.309	6.463	7.522	8.617
240/120	2.312	4.605	6.904	7.963	9.206
300/150	2.891	5.779	8.667	9.976	11.558
400/185	3.703	7.397	11.097	12.738	14.794
500	4.664	9.334	13.998	-	18.665
630	6.012	12.048	18.070	-	24.095
800	7.696	15.389	23.082	-	30.775
1000	9.706	19.372	29.055	-	38.741

TABLE CUscd

 VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
 1.0 & 1.5KV Solar PV DC Cables with Copper Conductor

Cable Size in sq.mm.	Copper content in MT/km
2.5	0.023
4	0.038
6	0.058
10	0.090

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE CUC

 VARIATION FACTOR FOR COPPER CONDUCTOR (CUF)
 CONTROL CABLES WITH COPPER CONDUCTOR

No of Cores	Core size 1.5 sq mm	Core size 2.5 sq mm
2	0.026	0.047
3	0.039	0.070
4	0.052	0.094
5	0.065	0.117
6	0.078	0.141
7	0.091	0.164
8	0.110	0.182
9	0.117	0.205
10	0.130	0.235
12	0.157	0.282
14	0.183	0.329
16	0.209	0.376
18	0.246	0.410
19	0.248	0.446
20	0.260	0.456
24	0.313	0.563
27	0.352	0.634
30	0.391	0.704
37	0.483	0.869
44	0.573	1.033
52	0.678	1.221
61	0.796	1.432

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P1

VARIATION FACTOR FOR ALUMINIUM (AIF)
 ALUMINIUM ARMoured SINGLE CORE PVC INSULATED 1.1 KV CABLES

Nominal cross sectional area (in Sq.mm)	Aluminium factor for Aluminium armoured cable with aluminium conductor
4	0.0685
6	0.0795
10	0.1017
16	0.1303
25	0.1693
35	0.2090
50	0.2597
70	0.3360
95	0.4567
120	0.5443
150	0.6427
185	0.7743
240	0.9737
300	1.2582
400	1.5502
500	1.8958
630	2.3650
800	2.9306
1000	3.7666

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P2

VARIATION FACTOR FOR PVC COMPOUND (CCFAl/CCFCu)
 PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal cross Sectional Area (in Sq. mm)	1 core		2 core		3 core		3.5 core		4 core	
	Unarm	Unarm	arm	Unarm	arm	Unarm	arm	Unarm	arm	
2.5	0.079	0.125	0.139	0.141	0.157	-	-	0.161	0.179	
4	0.094	0.140	0.156	0.164	0.182	-	-	0.188	0.209	
6	0.101	0.154	0.171	0.179	0.199	-	-	0.198	0.220	
10	0.114	0.194	0.216	0.214	0.238	-	-	0.249	0.277	
16	0.142	0.234	0.246	0.279	0.290	-	-	0.328	0.345	
25	0.171	0.288	0.303	0.364	0.383	0.422	0.444	0.443	0.466	
35	0.189	0.321	0.338	0.403	0.429	0.489	0.515	0.498	0.524	
50	0.211	0.411	0.433	0.508	0.535	0.613	0.645	0.647	0.681	
70	0.241	-	-	0.613	0.645	0.707	0.744	-	-	
95	0.284	-	-	0.795	0.811	0.908	0.927	-	-	
120	0.339	-	-	0.866	0.884	1.024	1.045	-	-	
150	0.388	-	-	1.070	1.092	1.289	1.315	-	-	
185	0.450	-	-	1.310	1.337	1.499	1.530	-	-	
225	0.521	-	-	1.586	1.618	1.840	1.878	-	-	
240	0.534	-	-	1.649	1.683	1.990	2.031	-	-	
300	0.653	-	-	2.007	2.048	2.361	2.409	-	-	
400	0.770	-	-	2.437	2.487	2.616	2.669	-	-	
500	0.936	-	-	3.117	3.181	3.687	3.762	-	-	
630	1.175	-	-	-	-	-	-	-	-	
800	1.433	-	-	-	-	-	-	-	-	
1000	1.642	-	-	-	-	-	-	-	-	

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P3

VARIATION FACTOR FOR STEEL (FeF)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal Cross sectional Area (in Sq. mm)	2 core	Shape	3 core	Shape	3 ½ core	Shape	4 core	Shape
4	0.305	W	0.335	W	-	-	0.363	W
6	0.348	W	0.363	W	-	-	0.407	W
10	0.392	W	0.407	W	-	-	0.293	F
16	0.235	F	0.293	F	-	-	0.323	F
25	0.293	F	0.352	F	0.382	F	0.382	F
35	0.323	F	0.382	F	0.411	F	0.440	F
50	0.382	F	0.440	F	0.469	F	0.499	F
70	0.411	F	0.499	F	-	F	0.587	F
95	0.499	F	0.587	F	0.616	F	0.645	F
120	0.528	F	0.616	F	0.675	F	0.731	F
150	0.587	F	0.675	F	0.731	F	0.790	F
185	0.645	F	0.761	F	0.820	F	0.879	F
240	0.731	F	0.879	F	0.937	F	0.996	F
300	0.820	F	0.966	F	1.055	F	1.113	F
400	0.937	F	1.083	F	1.172	F	1.231	F
500	1.055	F	1.231	F	1.348	F	1.406	F
630	1.172	F	-	-	-	-	-	-

IEEMA (PVC)/CABLE(R-1)/2017
 TABLE P3 (Additional)

Effective from: 1st November 217

VARIATION FACTOR FOR ROUND WIRE 'W' STEEL (FeF)
 PVC INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in sq. mm)	2 Core	3 Core	3.5 Core	4 Core
1.5	0.247	0.259		0.288
2.5	0.273	0.289		0.329
4	0.305	0.335		0.363
6	0.348	0.363		0.407
10	0.392	0.407		0.533
16	0.439	0.523	0.014	0.573
25	0.526	0.625	0.664	0.685
35	0.591	0.685	0.729	0.761
50	0.661	0.790	0.864	1.108
70	0.745	1.122	1.200	1.256
95	1.085	1.286	1.376	1.443
120	1.147	1.386	1.479	1.562
150	1.267	1.526	1.684	2.173
185	1.403	2.090	2.315	2.421
240	1.994	2.397	2.641	2.722
300	2.180	2.642	3.670	3.842
400	2.987	3.728	4.126	4.292
500	3.517	4.226	5.958	6.301
630	4.774	6.018	6.737	7.141

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P4

VARIATION FACTOR FOR ALUMINIUM (AIF)
PVC INSULATED 1.1 KV POWER CABLES WITH COPPER CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	Aluminium Factor for Aluminium armoured cable with copper conductor
4	0.058
6	0.063
10	0.073
16	0.084
25	0.096
35	0.108
50	0.123
70	0.139
95	0.183
120	0.198
150	0.218
185	0.241
240	0.271
300	0.379
400	0.424
500	0.478
630	0.537
800	0.591
1000	0.816

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE P5

VARIATION FACTOR FOR PVC COMPOUND (CCFCu)
 PVC INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm		Core size 2.5 sq mm	
	Unarm	Arm	Unarm	Arm
2	0.118	0.121	0.125	0.139
3	0.121	0.131	0.141	0.157
4	0.137	0.152	0.161	0.179
5	0.157	0.174	0.187	0.206
6	0.179	0.199	0.234	0.260
7	0.179	0.199	0.234	0.260
8	0.193	0.215	0.292	0.325
9	0.216	0.241	0.300	0.335
10	0.236	0.262	0.303	0.337
12	0.249	0.277	0.334	0.371
14	0.311	0.327	0.389	0.409
16	0.344	0.362	0.435	0.458
18	0.352	0.371	0.474	0.500
19	0.375	0.395	0.476	0.501
20	0.391	0.412	0.519	0.546
24	0.457	0.481	0.584	0.615
27	0.491	0.517	0.631	0.664
30	0.529	0.557	0.706	0.743
37	0.615	0.647	0.835	0.879
44	0.739	0.778	1.019	1.026
52	0.845	0.889	1.100	1.158
61	0.952	1.002	1.246	1.312

IEEMA (PVC)/CABLE(R-1)/2017
 TABLE P6
Effective from: 1st November 2017
 VARIATION FACTOR FOR STEEL (FeF)
 PVC INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm	Shape of armour	Core size 2.5 sq mm	Shape of armour
2	0.243	W	0.277	W
3	0.257	W	0.289	W
4	0.277	W	0.314	W
5	0.303	W	0.342	W
6	0.329	W	0.379	W
7	0.329	W	0.379	W
8	0.341	W	0.456	W
9	0.383	W	0.275	F
10	0.408	W	0.325	F
12	0.289	F	0.342	F
14	0.306	F	0.360	F
16	0.317	F	0.372	F
18	0.332	F	0.350	F
19	0.343	F	0.397	F
20	0.368	F	0.400	F
24	0.398	F	0.475	F
27	0.414	F	0.478	F
30	0.425	F	0.503	F
37	0.461	F	0.548	F
44	0.507	F	0.601	F
52	0.556	F	0.641	F
61	0.585	F	0.685	F

IEEMA (PVC)/CABLE(R-1)/2017
 TABLE P6 (Additional)
Effective from: 1st November 217
 VARIATION FACTOR FOR ROUND WIRE 'W' STEEL (FeF)
 PVC INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No. of Cores	Core size 1.5 sq mm	Core size 2.5 sq mm
2	0.243	0.273
3	0.257	0.289
4	0.277	0.314
5	0.303	0.342
6	0.329	0.379
7	0.329	0.379
8	0.341	0.456
9	0.383	0.508
10	0.408	0.535
12	0.510	0.572
14	0.546	0.625
16	0.581	0.660
19	0.608	0.696
24	0.714	0.819
25	0.679	0.798
27	0.732	0.837
28	0.696	0.815
30	0.758	0.881
33	0.747	0.883
37	0.820	1.217
44	0.926	1.355
48	1.122	1.308
50	1.122	1.308
52	1.149	1.361
56	1.202	1.388
61	1.299	1.520

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE L2

VARIATION FACTOR FOR POLYMER (CCFAI / CCFCu)
 XLPE INSULATED 1.1 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	1 core	2 core		3 core		3.5 core		4 core	
	Unarm	Unarm	Arm	Unarm	Arm	Unarm	Arm	Unarm	Arm
2.5	0.055	0.163	0.175	0.166	0.177	-	-	0.177	0.188
4	0.075	0.201	0.204	0.205	0.213	-	-	0.218	0.213
6	0.085	0.213	0.234	0.205	0.230	-	-	0.242	0.232
10	0.082	0.252	0.280	0.217	0.251	-	-	0.285	0.298
16	0.089	0.278	0.341	0.289	0.246	-	-	0.300	0.279
25	0.101	0.307	0.278	0.276	0.247	0.295	0.264	0.331	0.290
35	0.109	0.330	0.319	0.305	0.270	0.328	0.292	0.368	0.319
50	0.124	0.482	0.685	0.348	0.311	0.372	0.335	0.422	0.394
70	0.146	0.354	0.335	0.469	0.397	0.489	0.420	0.528	0.464
95	0.163	0.436	0.389	0.504	0.441	0.544	0.471	0.591	0.523
120	0.176	0.475	0.421	0.556	0.498	0.599	0.538	0.722	0.656
150	0.217	0.510	0.490	0.690	0.611	0.717	0.633	0.840	0.762
185	0.236	0.631	0.608	0.836	0.738	0.854	0.756	1.007	0.899
240	0.273	0.750	0.726	1.002	0.842	1.079	0.952	1.238	1.119
300	0.303	0.919	0.887	1.161	1.012	1.170	1.031	1.457	1.414
400	0.372	1.093	1.040	1.376	1.283	1.545	1.379	1.778	1.626
500	0.413	1.342	-	1.568	1.400	1.806	1.456	-	-
630	0.469	1.546	-	-	-	-	-	-	-
800	0.569	-	-	-	-	-	-	-	-
1000	0.667	-	-	-	-	-	-	-	-

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE XL1
 VARIATION FACTOR FOR XLPE COMPOUND (XLFAL/XLFUCU)
 XLPE INSULATED 1.1 KV POWER CABLES WITH COPPER/ALUMINIUM CONDUCTOR

Nominal cross Sectional Area (in Sq. mm)	1 core		2 core		3 core		3.5 core		4 core	
	Unarm	Arm	Unarm	Arm	Unarm	arm	Unarm	Arm	Unarm	arm
2.5	0.007	0.010	0.014	0.014	0.021	0.021			0.028	0.028
4	0.009	0.012	0.018	0.018	0.027	0.027			0.036	0.036
6	0.010	0.015	0.022	0.022	0.033	0.033			0.043	0.043
10	0.013	0.018	0.025	0.025	0.039	0.039			0.053	0.053
16	0.016	0.023	0.034	0.034	0.049	0.049			0.065	0.065
25	0.021	0.030	0.048	0.048	0.070	0.070	0.084	0.084	0.093	0.093
35	0.025	0.035	0.059	0.059	0.084	0.084	0.099	0.099	0.112	0.112
50	0.033	0.044	0.075	0.075	0.108	0.108	0.130	0.130	0.144	0.144
70	0.042	0.054	0.095	0.095	0.137	0.137	0.160	0.160	0.179	0.179
95	0.048	0.062	0.110	0.110	0.160	0.160	0.190	0.190	0.211	0.211
120	0.060	0.076	0.138	0.138	0.200	0.200	0.239	0.239	0.266	0.266
150	0.078	0.095	0.180	0.180	0.259	0.259	0.296	0.296	0.344	0.344
185	0.097	0.116	0.224	0.224	0.324	0.324	0.369	0.369	0.430	0.430
240	0.116	0.137	0.266	0.266	0.388	0.388	0.446	0.446	0.518	0.518
300	0.138	0.164	0.325	0.325	0.467	0.467	0.540	0.540	0.620	0.620
400	0.175	0.214	0.357	0.357	0.536	0.536	0.619	0.619	0.714	0.714
500	0.217	0.260	0.440	0.440	0.660	0.660	0.769	0.769	0.880	0.880
630	0.265	0.318	0.542	0.542	0.814	0.814	0.941	0.941	1.085	1.085
800	0.323	0.389								
1000	0.375	0.444								

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE XL2
 VARIATION FACTOR FOR XLPE COMPOUND (XLFCU)
 XLPE INSULATED CONTROL CABLES WITH COPPER CONDUCTOR

No of cores	Core size 1.5 sq mm		Core size 2.5 sq mm	
	Unarm	Arm	Unarm	Arm
2	0.010	0.010	0.012	0.012
3	0.016	0.016	0.018	0.018
4	0.021	0.021	0.025	0.025
5	0.026	0.026	0.031	0.031
6	0.031	0.031	0.037	0.037
7	0.036	0.036	0.043	0.043
8	0.036	0.036	0.043	0.043
9	0.042	0.042	0.049	0.049
10	0.052	0.052	0.061	0.061
12	0.062	0.062	0.074	0.074
14	0.073	0.073	0.086	0.086
16	0.083	0.083	0.098	0.098
18	0.094	0.094	0.110	0.110
19	0.099	0.099	0.116	0.116
20	0.104	0.104	0.123	0.123
24	0.125	0.125	0.147	0.147
27	0.140	0.140	0.165	0.165
30	0.156	0.156	0.184	0.184
37	0.192	0.192	0.227	0.227
44	0.229	0.229	0.270	0.270
52	0.270	0.270	0.319	0.319
61	0.317	0.317	0.374	0.374

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE XL3

VARIATION FACTOR FOR XLPE(XLFAL/XLFCU)

SINGLE CORE ARMoured /UNARMoured XLPE INSULATED 3.3 to 33 KV POWER CABLES WITH
CU / AL CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm.)	XLPE Factor for Armoured/ Unarmoured Cable with AL /CU Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	0.110	0.131	0.170	0.279		
35	0.122	0.137	0.175	0.284	0.317	0.522
50	0.135	0.151	0.191	0.307	0.341	0.563
70	0.155	0.172	0.215	0.342	0.379	0.615
95	0.174	0.193	0.241	0.377	0.417	0.670
120	0.192	0.212	0.262	0.407	0.449	0.713
150	0.209	0.229	0.283	0.437	0.481	0.757
185	0.228	0.250	0.308	0.471	0.518	0.809
240	0.255	0.279	0.343	0.519	0.569	0.883
300	0.280	0.322	0.372	0.560	0.613	0.943
400	0.326	0.392	0.420	0.625	0.683	1.041
500	0.388	0.461	0.469	0.694	0.757	1.142
630	0.467	0.520	0.529	0.777	0.845	1.265
800	0.567	0.593	0.602	0.874	0.949	1.407
1000	0.656	0.665	0.660	0.955	1.036	1.525

Note : XLPE factors include Semicons for Conductor & Insulation screen

TABLE - XL4

VARIATION FACTOR FOR XLPE (CCF1A/ / CCF1Cu)

3 CORE XLPE INSULATED 3.3 to 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	3.3 KV ARM	6.6 KV (E) ARM	6.6 KV (UE) / 11 KV (E) ARM	11 KV (UE) ARM	22 KV (E) ARM	33 KV (E) ARM
25	0.315	0.394	0.511	0.838		
35	0.339	0.427	0.545	0.880	0.982	1.638
50	0.378	0.474	0.600	0.957	1.065	1.751
70	0.435	0.541	0.679	1.067	1.183	1.916
95	0.489	0.604	0.755	1.171	1.295	2.071
120	0.537	0.661	0.822	1.265	1.396	2.210
150	0.585	0.719	0.890	1.359	1.497	2.350
185	0.642	0.784	0.968	1.468	1.614	2.513
240	0.717	0.873	1.074	1.615	1.773	2.732
300	0.781	1.006	1.167	1.744	1.928	2.919
400	0.886	1.227	1.314	1.948	2.130	3.229
500	0.956	1.421	1.446	2.148	2.381	3.538
630	1.129	1.582	1.609	2.382	2.630	3.940

Note : XLPE factors include Semicons for Conductor & Insulation screen

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE H1
VARIATION FACTOR FOR ALUMINIUM (AIF)
 ALUMINIUM ARMoured SINGLE CORE XLPE INSULATED 3.3 TO 33 KV CABLES

Nominal Cross Sectional Area (in Sq. mm.)	Aluminium Factor for Aluminium Armoured Cable with Aluminium Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
35	0.251	0.284	0.301	0.344	0.358	0.473
50	0.312	0.336	0.352	0.397	0.408	0.672
70	0.385	0.409	0.423	0.469	0.501	0.723
95	0.476	0.500	0.518	0.637	0.656	0.856
120	0.561	0.586	0.601	0.726	0.744	0.949
150	0.653	0.678	0.696	0.823	0.842	1.050
185	0.773	0.797	0.893	0.949	0.965	1.183
240	0.997	1.063	1.083	1.139	1.154	1.387
300	1.209	1.271	1.283	1.333	1.307	1.753
400	1.438	1.556	1.565	1.620	1.636	2.046
500	1.873	1.901	1.910	2.110	2.128	2.484
630	2.337	2.361	2.369	2.580	2.595	2.978
800	3.007	3.071	3.080	3.145	3.163	3.588
1000	3.737	3.741	3.749	3.804	3.822	4.565

TABLE H2
VARIATION FACTOR FOR POLYMER (CCFAI / CCFCu)
 3 CORE XLPE INSULATED 3.3 to 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm)	3.3 KV ARM	6.6 KV (E) ARM	6.6 KV (UE) / 11 KV (E) ARM	11 KV (UE) ARM	22 KV (E) ARM	33 KV (E) ARM
35	0.374	0.990	1.142	1.604	1.782	-
50	0.445	1.119	1.260	1.834	2.046	2.864
70	0.547	1.290	1.396	2.011	2.284	3.219
95	0.594	1.440	1.647	2.269	2.428	3.367
120	0.732	1.692	1.877	2.498	2.715	3.646
150	0.812	1.906	2.061	2.767	2.931	3.927
185	0.960	2.086	2.406	3.028	3.180	4.166
240	1.130	2.484	2.744	3.398	3.580	4.589
300	1.219	2.912	3.161	3.840	4.016	5.029
400	1.313	3.530	3.664	4.353	4.666	5.736
500	1.652	3.925	3.971	4.621	4.878	5.913
630	1.949	4.487	4.982	5.225	5.477	6.696

Fillers added in PVC consumption

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE H3
 VARIATION FACTOR FOR STEEL (FeF)
 XLPE INSULATED 3.3 TO 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area Sq. mm.	3.3 KV	6.6 KV (E)	11 KV (E) / 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	0.551	0.604	0.656	0.814		
35	0.645	0.645	0.731	0.879	0.937	-
50	0.675	0.703	0.761	0.937	0.966	1.181
70	0.761	0.761	0.849	0.996	1.055	1.289
95	0.820	0.849	0.907	1.083	1.113	1.348
120	0.879	0.907	0.966	1.142	1.172	1.406
150	0.966	0.966	1.055	1.201	1.259	1.494
185	1.025	1.055	1.113	1.259	1.318	1.553
240	1.142	1.142	1.231	1.377	1.406	1.641
300	1.231	1.259	1.318	1.465	1.524	1.758
400	1.348	1.406	1.435	1.582	1.641	1.876

IEEMA (PVC)/CABLE(R-1)/2017

Effective from: 1st November 217

TABLE H4
VARIATION FACTOR FOR ALUMINIUM (AIF)
 XLPE INSULATED SINGLE CORE 3.3 TO 33 KV POWER CABLES WITH COPPER CONDUCTOR

Nominal Cross Sectional Area (in Sq. mm.)	Aluminium Factor for Aluminium Armoured Cable with Copper Conductor					
	3.3 KV	6.6 KV (E)	11 KV (E)/ 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
35	0.153	0.187	0.204	0.247	0.258	0.372
50	0.179	0.203	0.220	0.262	0.275	0.425
70	0.196	0.219	0.233	0.278	0.311	0.444
95	0.213	0.237	0.254	0.373	0.392	0.470
120	0.228	0.253	0.268	0.393	0.410	0.488
150	0.243	0.269	0.287	0.414	0.432	0.504
185	0.261	0.285	0.381	0.437	0.455	0.526
240	0.324	0.389	0.410	0.465	0.480	0.556
300	0.365	0.428	0.440	0.490	0.510	0.737
400	0.432	0.471	0.480	0.536	0.552	0.783
500	0.489	0.517	0.526	0.726	0.744	0.844
630	0.544	0.568	0.572	0.787	0.801	0.902
800	0.706	0.787	0.797	0.862	0.880	0.982
1000	0.824	0.865	0.867	0.923	0.940	1.324

TABLE - H5
VARIATION FACTOR FOR STEEL (FeW)
 XLPE INSULATED 3.3KV TO 33 KV POWER CABLES WITH COPPER / ALUMINIUM CONDUCTOR

Nominal Cross Sectional Area in Sq. mm	3.3/3.3 KV	3.3/6.6 KV	11 KV (E) / 6.6 KV (UE)	11 KV (UE)	22 KV (E)	33 KV (E)
25	1.258	1.457	1.612	2.509	1.503	--
35	1.361	1.569	1.853	2.644	2.797	2.517
50	1.682	1.687	2.321	2.800	2.921	4.569
70	2.033	1.979	2.503	3.219	3.347	4.809
95	2.202	2.507	2.718	4.019	4.200	5.437
120	2.371	2.675	2.882	4.241	4.416	6.713
150	2.870	2.847	3.265	4.447	4.621	6.976
185	3.121	3.309	4.148	4.726	5.289	7.356
240	3.758	4.227	4.442	5.442	6.651	7.718
300	4.099	5.024	5.182	6.894	7.084	8.187
400	5.750	6.572	6.658	7.433	7.657	8.760
500	6.716	6.777	6.861	7.588	7.797	8.830
630	7.492	7.465	7.477	8.209	8.386	9.413

Annexure-F

DEFAULT/ BREACH OF CONTRACT, INSOLVENCY AND RISK PURCHASE

In case of delays (beyond the maximum late delivery period as per LD clause) in supplies, or if there be defective supplies or non-fulfilment of any other terms and conditions of the Contract as enumerated subsequently in this clause, then, without prejudice to its right to recover any expenses, losses or damages to which the Buyer may be put to incur or sustain by reason of the Seller/Contractor's default or breach of Order/Contract or to suspend business dealings with the Seller/Contractor in terms of the Buyers' Guidelines for Suspension of Business Dealings as applicable from time to time, the Buyer shall also be entitled to cancel the Order/ Contract either in whole or portion thereof without compensation to Seller. On the occurrence of any of the acts/omissions mentioned below, the Buyer may if it so desires, procure upon such terms and in such manner as deemed appropriate, plant/ equipment/ stores not so delivered or others of similar description where plant/ equipment/ stores exactly complying with particulars are not, in the opinion of the Buyer (which shall be final), readily procurable, at the risk and cost of the Seller.

The Seller shall be liable to the Buyer for any excess costs incurred thereof and the Seller shall continue the performance of the Order/Contract to the extent not cancelled under the provisions of this clause. The Seller shall on no account be entitled to any gain on such repurchases. If the Bidder does not agree to this Risk Purchase clause, BHEL reserves the right to reject the bid/offer of the Bidder.

The order/contract may be cancelled in whole or part thereof and Risk & Cost Clause in line with terms and conditions of PO/Contract may be invoked by the Buyer in any of the following cases:

- i. If the Seller/Contractor fails to deliver the goods or materials or any installment thereof within the period(s) fixed for such delivery or the Seller's poor progress of the supply/services vis-à-vis delivery/execution timeline as stipulated in the contract, backlog attributable to the Seller including unexecuted portion of supply does not appear to be executable within balance period available;
- ii. delivers goods or materials not of the contracted quality and failing to adhere to the contract specifications/execution methodology;
- iii. withdrawal from or repudiation/abandonment of the supply/services by the Seller before completion as per contract or if the Seller refuses or is unable to supply goods or materials covered by the order/Contract either in whole or in part or otherwise fails to perform the Order/Contract.
- iv. Non supply by the Seller within scheduled completion/delivery period as per contract or as extended from time to time for reasons attributable to the Seller;
- v. Termination of Contract on account of any other reason(s) attributable to the Seller.
- vi. Assignment, transfer, sub-letting of Contract without BHEL's written permission resulting in termination of Contract or part thereof by BHEL.
- vii. If the Seller be an individual or a Sole Proprietorship, in the event of death or insanity of the Seller.
- viii. If the Seller/Contractor being an individual or if a partnership firm thereof, shall at any time be adjudged insolvent or shall have a receiving order for administration of his estate made against him or shall take any proceeding for composition under any Insolvency Act for the time being in force or make any assignment of the order/Contract or enter into any arrangement or composition with his creditors or suspend payment or if the firm dissolved under the Partnership Act;
- ix. If the Seller/Contractor being a Company is wound up voluntarily or by order of a Court or a Receiver, Liquidator or Manager on behalf of the debenture holders and creditors is appointed or circumstances have arisen which entitles the Court of debenture holder and creditors to appoint a receiver, liquidator or manager
- x. Non- Compliance to any contractual condition or any other default attributable to the Seller.

Such defaulting vendor/Seller shall not be eligible to participate in re-tendering conducted on account of risk purchase made due to fault of such vendor/Seller.

BHEL's right to go for Risk and Cost, Calculation of Risk and Cost amount & LD, recovery options to BHEL are given in detail in Annexure-V hereto.

(RISK AND COST CLAUSE)

1. BHEL reserves the right to terminate the contract or withdraw portion of work and get it done through other agency, at the risk and cost of the contractor *after due notice of a period of 14 days' by BHEL* in any of the following cases:
 - i) If the Seller/Contractor fails to deliver the goods or materials or any instalment thereof within the period(s) fixed for such delivery or the Seller's poor progress of the supply/ services vis-a-vis delivery/execution timeline as stipulated in the Contract, backlog attributable to seller including unexecuted portion of supply does not appear to be executable within balance available period;
 - ii) Delivers goods or materials not of the contracted quality and failing to adhere to the contract specifications;
 - iii) Withdrawal from or repudiation/ abandonment of the supply/ services by Seller before completion as per contract or if the Seller refuses or is unable to supply goods or materials covered by the Order/Contract either in whole or in part or otherwise fails to perform the Order/Contract;
 - iv) Non-supply by the Seller within scheduled completion/delivery period as per Contract or as extended from time to time, for the reasons attributable to the Seller;
 - v) Termination of Contract on account of any other reason (s) attributable to Seller.
 - vi) Assignment, transfer, subletting of Contract without BHEL's written permission resulting in termination of Contract or part thereof by BHEL.
 - vii) If the Seller be an individual or a sole proprietorship Firm, in the event of the death or insanity of the Seller;
 - viii) If the Seller/Contractor being an individual or if a firm on a partnership thereof, shall at any time, be adjudged insolvent or shall have a receiving order for administration of his estate made against him or shall take any proceeding for composition under any Insolvency Act for the time being in force or make any assignment of the Order/Contract or enter into any arrangement or composition with his creditors or suspend payment or if the firm dissolved under the Partnership Act;
 - ix) If the Seller/Contractor being a company is wound up voluntarily or by order of a Court or a Receiver, Liquidator or Manager on behalf of the debenture holders and creditors is appointed or circumstances shall have arisen which entitles the Court of debenture holder and creditors to appoint a receiver, liquidator or manager;
 - x) Non-compliance to any contractual condition or any other default attributable to Seller.

1.1 Risk & Cost Amount against Balance Work:

Risk & Cost amount against balance work shall be calculated as follows:

$$\text{Risk \& Cost Amount} = [(A-B) + (A \times H/100)]$$

Where,

A= Value of Balance scope of Work (*) as per rates of new contract

B= Value of Balance scope of Work (*) as per rates of old contract being paid to the contractor at the time of termination of contract i.e. inclusive of PVC & ORC, if any.

H = Overhead Factor to be taken as 5

In case (A-B) is less than 0 (zero), value of (A-B) shall be taken as 0 (zero).

1.2 * Balance scope of work (in case of termination of contract):

Difference of Contract Quantities and Executed Quantities as on the date of issue of Letter for 'Termination of Contract', shall be taken as balance scope of Work for calculating risk & cost amount.

Contract quantities are the quantities as per original contract. If, Contract has been amended, quantities as per amended Contract shall be considered as Contract Quantities.

Items for which total quantities to be executed have exceeded the Contract Quantities based on drawings issued to contractor from time to time till issue of Termination letter, then for these items total Quantities as per issued drawings would be deemed to be contract quantities.

Substitute/ extra items whose rates have already been approved would form part of contract quantities for this purpose.

Substitute/ extra items which have been executed but rates have not been approved, would also form part of contract quantities for this purpose and rates of such items shall be determined in line with contractual provisions.

However, increase in quantities on account of additional scope in new tender shall not be considered for this purpose.

NOTE: In case portion of work is being withdrawn at risk & cost of contractor instead of termination of contract, contract quantities pertaining to portion of work withdrawn shall be considered as 'Balance scope of work' for calculating Risk & Cost amount.

1.3 LD against delay in executed work in case of Termination of Contract:

LD against delay in executed work shall be calculated in line with LD clause no. 16 of GCC, for the delay attributable to contractor. For limiting the maximum value of LD, contract value shall be taken as Executed Value of work till termination of contract.

Method for calculation of LD against delay in executed work in case of termination of contract" is given below.

- i. Let the time period from scheduled date of start of work till termination of contract excluding the period of Hold (if any) not attributable to contractor = T1
- ii. Let the value of executed work till the time of termination of contract = X
- iii. Let the Total Executable Value of work for which inputs/fronts were made available to contractor and were planned for execution till termination of contract = Y
- iv. Delay in executed work attributable to contractor i.e. T2 = $[1-(X/Y)] \times T1$
- v. LD shall be calculated in line with LD clause (clause 16) of the Contract for the delay attributable to contractor taking "X" as Contract Value and "T2" as period of delay attributable to contractor.

2. Recoveries arising out of Risk & Cost and LD or any other recoveries due from Contractor

Without prejudice to the other means of recovery of such dues from the Seller recoveries from the Seller on whom risk & cost has been invoked shall be made from the following:

- a) Dues available in the form of Bills payable to seller, SD, BGs against the same contract.
- b) Dues payable to seller against other contracts in the same Region/Unit/ Division of BHEL.
- c) Dues payable to seller against other contracts in the different Region/Unit/ division of BHEL.

In-case recoveries are not possible with any of the above available options, Legal action shall be initiated for recovery against contractor.

2X660 MW KHURJA STPP

ANNEXURE-G

Price Schedule (SCREENED CONTROL CABLES)-MAIN SUPPLY

A.O) MAIN SUPPLY

1.1) Individual & Overall Screened Cable (Type-F)-Unarmoured cable

Multi pair (twisted) individual & overall shielded instrumentation cables. (Type-F)

Multi pair (twisted) individual & overall shielded instrumentation cables. (Type-F)

S.No.	Item code	HSN CODE	Item name	UOM	Ordered Quantity	UNIT EX-WORKS PRICE (DULY PACKED) (INR)	TOTAL EX-WORKS PRICE(DULY PACKED) (INR)	FREIGHT CHARGES WITHOUT GST @....% OF TOTAL EX WORKS (INR)	TOTAL PRICES (Total Ex works + Freight(as applicable)) (INR)	APPLICABLE GST RATE% ON(TOTAL EX WORKS + FREIGHT) (INR)	TOTAL PRICE F.O.R SITE PRICE (INR)
1	507-31081-A	8544	225V TYPE F(I/O) 2P - 0.5 UNARMOURED	MTR	3000						
2	507-31046-A	8544	225V TYPE F(I/O) 4P - 0.5 UNARMOURED	MTR	58000						
3	507-31050-A	8544	225V TYPE F(I/O) 8P - 0.5 UNARMOURED	MTR	11000						
4	507-31038-A	8544	225V TYPE F(I/O) 12P - 0.5 UNARMOURED	MTR	10000						

1.2) Overall Screened Cable (Type-G)-Unarmoured cable

Multi pair (twisted) overall shielded instrumentation cables. (Type-G)

S.No.	Item code	HSN CODE	Item name	UOM	Ordered Quantity	UNIT EX-WORKS PRICE (DULY PACKED) (INR)	TOTAL EX-WORKS PRICE(DULY PACKED) (INR)	FREIGHT CHARGES WITHOUT GST @....% OF TOTAL EX WORKS (INR)	TOTAL PRICES (Total Ex works + Freight(as applicable)) (INR)	APPLICABLE GST RATE% ON(TOTAL EX WORKS + FREIGHT) (INR)	TOTAL PRICE F.O.R SITE PRICE (INR)
1	507-31062-A	8544	225V TYPE G(O) 2P - 0.5 UNARMOURED	MTR	4000						
2	507-31066-A	8544	225V TYPE G(O) 4P - 0.5 UNARMOURED	MTR	120000						
3	507-31070-A	8544	225V TYPE G(O) 8P - 0.5 UNARMOURED	MTR	38000						
4	507-31054-A	8544	225V TYPE G(O) 12P - 0.5 UNARMOURED	MTR	13000						

NOTES :

1	Quantities indicated above shall be known as Order Quantities. Quantity variation shall be as per NIT.
2	The bidder shall indicate the unit price of each type and size of cables listed as per the BOQ-Cum-Price Schedule. The unit prices shall apply for adjustment of variation in quantity as stipulated above.
3	Manufacturing of the cables shall be taken up by the successful bidder only after approval of technical and quality documentation. Subsequent Quantity shall be cleared for manufacture based on progress of engineering & site requirements.
4	Delivery schedule of Quantities shall be as per NIT.
5	Unit price of cables quoted by bidder shall be inclusive of type test charges. No separate charges shall be payable for type tests.
6	The standard drum length shall be 1000 meters as indicated above. Tolerance on individual drum length shall be $\pm 5\%$.
7	Overall tolerance on total dispatched quantity of each size shall be (-) 2% and (+) 0% except where the total ordered quantity is one single drum length of 1000m, in which case it shall be -5%/0%. Cables consumed for testing and inspection shall be to bidders account.
8	For each individual cable size, one short length of not less than 200m may be accepted only in the final drum length to complete the supply (except where the total ordered quantity is one single drum length of 1000m). The overall tolerance limits stipulated above shall continue to apply (in case short lengths are accepted).

2X660 MW KHURJA STPP

Price Schedule (SCREENED CONTROL CABLES)-MANDATORY SPARES

A.O) MANDATORY SPARES

1.1) Individual & Overall Screened Cable (Type-F)-Unarmoured cable

Multi pair (twisted) individual & overall shielded instrumentation cables. (Type-F)

Multi pair (twisted) individual & overall shielded instrumentation cables. (Type-F)

S.No.	Item code	HSN CODE	Item name	UOM	Ordered Quantity	UNIT EX-WORKS PRICE (DULY PACKED) (INR)	TOTAL EX-WORKS PRICE(DULY PACKED) (INR)	FREIGHT CHARGES WITHOUT GST @....% OF TOTAL EX WORKS (INR)	TOTAL PRICES (Total Ex works + Freight(as applicable)) (INR)	APPLICABLE GST RATE ...% ON(TOTAL EX WORKS + FREIGHT) (INR)	TOTAL PRICE F.O.R SITE PRICE (INR)
1	507-31081-A	8544	225V TYPE F(IO) 2P - 0.5 UNARMOURED	MTR	1000						
2	507-31046-A	8544	225V TYPE F(IO) 4P - 0.5 UNARMOURED	MTR	3000						
3	507-31050-A	8544	225V TYPE F(IO) 8P - 0.5 UNARMOURED	MTR	1000						
4	507-31038-A	8544	225V TYPE F(IO) 12P - 0.5 UNARMOURED	MTR	1000						

1.2) Overall Screened Cable (Type-G)-Unarmoured cable

Multi pair (twisted) overall shielded instrumentation cables. (Type-G)

S.No.	Item code	HSN CODE	Item name	UOM	Ordered Quantity	UNIT EX-WORKS PRICE (DULY PACKED) (INR)	TOTAL EX-WORKS PRICE(DULY PACKED) (INR)	FREIGHT CHARGES WITHOUT GST @....% OF TOTAL EX WORKS (INR)	TOTAL PRICES (Total Ex works + Freight(as applicable)) (INR)	APPLICABLE GST RATE ...% ON(TOTAL EX WORKS + FREIGHT) (INR)	TOTAL PRICE F.O.R SITE PRICE (INR)
1	507-31062-A	8544	225V TYPE G(O) 2P - 0.5 UNARMOURED	MTR	1000						
2	507-31066-A	8544	225V TYPE G(O) 4P - 0.5 UNARMOURED	MTR	6000						
3	507-31070-A	8544	225V TYPE G(O) 8P - 0.5 UNARMOURED	MTR	2000						
4	507-31054-A	8544	225V TYPE G(O) 12P - 0.5 UNARMOURED	MTR	1000						

NOTES :

1	Quantities indicated above shall be known as Order Quantities. Quantity variation shall be as per NIT.
2	The bidder shall indicate the unit price of each type and size of cables listed as per the BOQ-Cum-Price Schedule. The unit prices shall apply for adjustment of variation in quantity as stipulated above.
3	Manufacturing of the cables shall be taken up by the successful bidder only after approval of technical and quality documentation. Subsequent Quantity shall be cleared for manufacture based on progress of engineering & site requirements.
4	Delivery schedule of Quantities shall be as per NIT.
5	Unit price of cables quoted by bidder shall be inclusive of type test charges. No separate charges shall be payable for type tests.
6	The standard drum length shall be 1000 meters as indicated above. Tolerance on individual drum length shall be $\pm 5\%$.
7	Overall tolerance on total dispatched quantity of each size shall be (-) 2% and (+) 0% except where the total ordered quantity is one single drum length of 1000m, in which case it shall be -5%/0%. Cables consumed for testing and inspection shall be to bidder 's account.
8	For each individual cable size, one short length of not less than 200m may be accepted only in the final drum length to complete the supply (except where the total ordered quantity is one single drum length of 1000m). The overall tolerance limits stipulated above shall continue to apply (in case short lengths are accepted).