



# BHARAT HEAVY ELECTRICALS LIMITED

## TRANSMISSION BUSINESS HVDC ENGINEERING & SYSTEMS

**COPYRIGHT AND CONFIDENTIALITY**  
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.  
 It must not be used directly or indirectly in anyway detrimental to the interest of the company

DOCUMENT No.	<b>TB-418-316-025</b>	Rev. No.	<b>00</b>	Prepared	Checked	Approved	
TYPE OF DOC.	<b>TECHNICAL SPECIFICATION</b>	SIGN					
TITLE	<b>LT Switchgear (AC &amp; DC Boards)</b>	NAME	<b>MSP</b>	<b>NK</b>	<b>SKS</b>		
		DATE	04.01.23	04.01.23	04.01.23		
		GROUP	<b>TBEM</b>	W.O. No			
Customer	<b>POWERGRID CORPORATION OF INDIA LIMITED</b>						
PROJECT	<b>NEEMUCH 400/220KV SUBSTATION</b>						
LOA NO.	<b>TBCB/Neemuch REZ/400kV AIS/SS01/G5/NOA-I/05 dtd. 23/09/2022</b> <b>TBCB/Neemuch REZ/400kV AIS/SS01/G5/NOA-II/06 dtd. 23/09/2022</b>						
<b>CONTENTS</b>							
<b>Section</b>	<b>Description</b>					<b>No of Sheets</b>	
1	Section-1: Scope, Bill of Quantity (Annexure-1), Specific Technical Requirement Enclosed : Single Line Diagram of LT AC & DC Boards					8	
2	Section-2: Equipment Specifications					28	
3	Section-3: General Technical Requirements					66	
4	Section-4: Schedule of Guaranteed Technical Particulars					6	
5	Section-5: Checklist Annexure-C: Schedule of Technical Deviation					4	
<b>REVISION DETAILS</b>							
Distribution			To	TBEM	TBMM	TBQM	Vendor
			Copies	1	1	1	4

## SECTION 1

### SCOPE, SPECIFIC TECHNICAL REQUIREMENTS & QUANTITIES

#### 1.0 SCOPE

This technical specification covers the requirements of design, manufacture, assembly, testing and inspection at works, packing, loading at works and transport to *site*, supervision of erection- testing & commissioning of metal enclosed , indoor floor mounted, compartmentalised double front construction and free standing type LT Switchgear (AC & DC distribution boards) as listed in Annexure-1 of Section-1as per specification complete in all respects and including all fittings and accessories required for efficient and trouble-free operation.

The scope shall encompass and include all the activities listed above.

This section covers the scope and quantities of LT AC & DC DB. The specific technical requirements for the above item as specified by the customer are given in Section-2. The offered equipment shall also comply with the General Technical Requirements for the project as detailed under section-3 of this specification.

The equipment is required for the following project:

**Name of customer:** POWERGRID CORPORATION OF INDIA LIMITED

**Name of Projects:** NEEMUCH 400/220KV SUBSTATION

The fitment and equipments offered shall be of approved make of POWERGRID or its subsequent approval from POWERGRID shall be bidder's responsibility with no commercial implications to BHEL. If any of the make offered by the bidder is not acceptable to M/s POWERGRID, the bidder has to supply alternate POWERGRID approved make, meeting the specification, with no commercial implications to BHEL.

#### 1.1 **CODES & STANDARDS:**

The equipment and accessories covered under this specification shall be designed, manufactured and tested in accordance with latest editions of standard listed in Section-2 and other relevant standards.

The specification comprise of following sections:

Section-1: Scope, Specific Technical Requirements and Quantities

Section-2: POWERGRID Equipment Specification

Section-3: Project Details & General Specification

Section-4: Guaranteed Technical particulars (GTP)

Section-5: Checklist

In case of any conflict between various sections, **order of precedence** shall be in the same order as listed above.

**Note:** The term 'Owner' appearing in this specification shall refer to POWERGRID, the term 'Purchaser' shall refer to BHEL and the term 'Contractor' shall refer to the successful Bidder.

### **1.1 SPECIFIC TECHNICAL REQUIREMENTS:**

Please refer enclosed SLD for LT AC & DC system (Doc no: TB-1-418-316-006 rev.00)

Refer Section-2 for other technical requirements.

Refer Section - 3 for Project Details and General Specifications.

### **1.2 Bill of Quantities:**

#### **(A) Bill of quantities for main items**

<b>Sl. No</b>	<b>Item Description</b>	<b>Units</b>	<b>Qty</b>
1	3-phase, 4-wire, 1000A, 25kA for 1 sec , <b>415 V Main Switchboard-1A</b>	Set	1
2	3-phase, 4-wire, 400A, 20kA for 1 sec , <b>415V AC Distribution Board-2A</b>	Set	1
3	3-phase, 4-wire, 400A, <b>415V Main Lighting DB-3A</b> (including 2 no. 100kVA, 415/415V Lighting Transformer)	Set	1
4	3-phase, 4-wire, 63A, <b>415V Emergency Lighting DB-4A</b> (including 1 no. 25kVA, 415/415V Lighting Transformer)	Set	1
5	220V, 400A, 20kA (DC) for 1 sec, <b>220V DCDB-1D /2D</b>	Set	2
6	48V, 400A, 20kA (DC) for 1 sec, <b>48V DCDB-3D/4D</b>	Set	2

Note: For details of fitments of each module, refer Section 2 and Single Line diagram as per 1.1 above.

#### **(B) Bill of quantities for Services:**

<b>Sl. No</b>	<b>Item Description</b>	<b>Units</b>	<b>Qty</b>
1	Supervision of Erection Testing & Commissioning for <b>415 V Main Switchboard-1A</b>	Set	1
2	Supervision of Erection Testing & Commissioning for <b>415V AC Distribution Board-2A</b>	Set	1
3	Supervision of Erection Testing & Commissioning for <b>415V Main Lighting DB-3A</b>	Set	1
4	Supervision of Erection Testing & Commissioning for <b>415V Emergency Lighting DB-4A</b>	Set	1
5	Supervision of Erection Testing & Commissioning for <b>220V DCDB-1D/2D</b>	Set	2
6	Supervision of Erection Testing & Commissioning for <b>48V DCDB-3D/4D</b>	Set	2

**(C) Unit Rate items:**

Sl. No	Item Description	Units	Qty
1.	415V, MSB-Module Type E-400A O/G Feeder	No.	1
2.	415V, MSB-Module Type E-250A O/G Feeder	No.	1
3.	415V, ACDB-Module Type E-100A O/G Feeder	No.	1
4.	415V, ACDB/MLDB-Module Type E-63A O/G Feeder	No.	1
5.	415V, ACDB-Module Type E-32A O/G Feeder	No.	1
6.	415V, ACDB-Module Type E (Single phase)-32A O/G Feeder	No.	1
7.	220V, DCDB- Module Type X-32A O/G Feeder	No.	1
8.	48V, DCDB- Module Type X-32A O/G Feeder	No.	1

- a) Unit prices for addition/ deletion of feeders are required for any addition/ deletion of equipment/ feeder during detailed engineering and replacement of damaged items during contract period. Vendor to ensure that the unit prices have a logical relationship with prices of assemblies in main panels/ switchboards, and hence shall be considered for commercial evaluation.  
The unit rate shall include associated engineering, services, wiring, mounting accessories and associated enclosures etc. complete in all respect.
- b) Quoting for each line item is mandatory and shall be considered for evaluation. If any other item is not quoted, but is required due to damages, theft, replacement, change in feeder rating etc. or any other reason during execution, the required quantity shall be supplied free of cost within guarantee period/ defect liability period.
- c) One set shall be treated as the total quantity required for one panel.
- d) Relay setting calculations shall be provided by bidder.
- e) It will be vendor's responsibility to organize deputation of OEM of protection relays and devices. Instruments/ testing kit required for testing of protection relays is also in vendor's scope.
- f) Provisions for all digital and analogue signals for SS/ SCADA as per aux. SLD shall be in bidder's scope.
- g) BHEL reserves the right for overall contract value variation up to  $\pm 25\%$  due to any reason at the same unit rates, terms & conditions during execution of contract.
- h) For details of the components/fitments in the module, refer Section-2 & Single Line diagram.
- i) Rated capacity, type & fault ratings of boards shall be as per SLD.
- j) The types of modules as required in the LT AC/DC Boards is as below:
- (i) Module Type AE : Refer clause 1.25.4 of Section 2

(ii)	Module Type M1	:	Refer clause 1.24.5 of Section 2
(iii)	Module Type E	:	Refer clause 1.24.6 of Section 2
(iv)	Module Type G - 1	:	Refer clause 1.24.7 of Section 2
(v)	Module Type G - 2	:	Refer clause 1.24.8 of Section 2
(vi)	Module Type H & H (BC)	:	Refer clause 1.24.9 of Section 2
(vii)	Module Type S	:	Refer clause 1.24.10 of Section 2
(viii)	Module Type X	:	Refer clause 1.24.11 of Section 2
ix)	Module Type DC	:	Refer clause 1.24.12 of Section 2
x)	Module Type DG - 1	:	Refer clause 1.24.13 of Section 2
xi)	Module Type H1	:	Refer clause 1.24.14 of Section 2
xii)	Module Type EL	:	Refer clause 1.24.15 of Section 2

**1.3 DRAWINGS DOCUMENTS REQUIRED FOR ENGINEERING MANUFACTURING CLEARANCE:**

The following drawings/ documents shall be used for providing engineering manufacturing clearance of LT Switchgear and its accessories and furthermore, it shall be used for delay analysis, if any from bidder. The schedule for submission and resubmission shall be in line with details provided in section-3.

1.	LT Switchgears- SLD, Schematics & GA Drawing (GA, BOM & make List) with Guaranteed Technical particulars
2.	LT Switchgears- Type Test Reports
3.	LT Switchgears- Quality Assurance Plan

Date of Submission of first lot of drawings/ documents shall be counted from the date of submission of reasonably correct drawings/ documents only.

The successful bidder shall have to extend all possible supports like timely submission/resubmission of drawings, visit to end customer to facilitate documents approval without any commercial implications to BHEL. Acceptance of bidder's documents shall be subject to end customer approval.

**1.4 TYPE TESTS**

- a. Type tests shall be in line with Clause 1.21 of Section 2.
- b. Commissioning check tests shall be as per clause 1.23 of Section 2.
- c. All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under respective sections.

The reports for all type tests as per technical specification shall be furnished by the Bidder along with equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all projects with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID/representative authorized by POWERGRID/representative of Utility /representative of accredited test lab/ representative of The National Accreditation Board for Certification Bodies (NABCB) certified agency shall also be acceptable.

Unless otherwise specified elsewhere, the type test reports submitted shall be of the tests conducted within 10 years from the date of NOA (23.09.2022). In case the test reports are of the test conducted earlier than the years specified from the date of NOA, the contractor shall repeat these test(s) at no extra cost to the Employer.

Further, in the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost implication to the Employer.

The Contractor shall intimate the Employer the detailed program about the type tests at least two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

The Employer reserves the right to witness any or all the type tests. The Employer shall bear all expenses for deputation of Employer's representative(s) for witnessing the type tests except in the case of re-deputation if any, necessitated due to no fault of the Employer.

## **1.5 DEVIATIONS**

The bidder shall list all the deviation from the specification separately. Offers without specific deviation will be deemed to be totally in compliance with the specification and NO DEVIATION on any account will be entertained at a later date.

## **1.6 PACKING**

**1.6.1** All equipment shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and outdoor storage (for a minimum period of 1 year) at site till the time of erection. While packing all the materials, the limitations from the point of view of availability of transportation facilities in India should be taken into account. The Bidder shall be responsible for any loss or damage during transportation, handling and storage.

**1.6.2** The Bidder shall include and provide for security, protection and packing the equipment so as to avoid loss or damage during transport by any mode.

**1.6.3** All packing shall allow for easy removal and checking at site. Wherever necessary, proper arrangement for attaching slings for lifting shall be provided. All packages shall be clearly marked for with signs showing 'UP' and 'DOWN' side of boxes, and handling and unpacking instructions as considered necessary. Special precautions shall be taken to prevent rusting of steel and iron parts during transit and storage. Gas seals or other methods proposed to be adopted for protection against moisture during transit shall be to the satisfaction of the purchaser.

**1.6.4** The cases containing easily damageable material shall be very carefully packed and marked with appropriate caution symbols i.e. FRAGILE, HANDLE WITH CARE, USE NO HOOKS etc.

**1.6.5** Each package delivered under the contract shall be marked by the Bidder at his expense and such marking must be distinct (all previous irrelevant marking being carefully obliterated). Such marking shall show the description and quantity of contents, the name of consignee and address,

the gross and net weights of the package, the name of Bidder with a distinctive number of mark sufficient for purpose of identification. All markings shall be carried out with such materials as to ensure quickness of drying, fastness and legibility.

**1.6.6** Each Package shall contain a note quoting specifically the name of the Bidder, the number and date of contract or order and the name of office placing the contract, nomenclature of the stores and include a schedule of parts for each complete equipment giving the parts number with reference to the General Arrangement/ Assembly drawing and the quantity of each part, drawing number and tag numbers.

**1.6.7** All equipment/ material shall be suitably packed for transport, carriage at site and outdoor storage during transit. The Bidder shall be responsible for any damage to the equipment during transit. The contents of each package shall bear marking that can be readily identified from the package list and packing shall provide complete protection from moisture, termites and mechanical shocks etc.

**1.6.8** Any material found short inside the packing cases shall be supplied by the Bidder without any extra cost.

**1.6.9** Notwithstanding anything stated in this clause the Bidder shall be entirely responsible for any loss, damage or depreciation to the stores.

#### **1.7 MANUFACTURING QUALITY PLAN**


Bidder shall follow POWERGRID approved Quality Plan at contract stage.

**ANNEXURE-A: TECHNICAL REQUIREMENT**

SR. No.	Description	Supporting Documents to be attached	Reference of Docs. attached																
01	<p>The manufacturer whose LT Switchgear(s) are offered, must be a manufacturer of LT Switchboards of the type and rating being offered. He must have designed, manufactured, tested and supplied at least 50 nos. draw out circuit breaker panels, out of which at least 5 nos. should have been with relay and protection schemes with current transformer. He must have also manufactured at least 50 nos. MCC panels comprising of MCCBs (i.e. Moulded Case Circuit Breakers) modules of the type offered which must be in satisfactory operation# as on the date of NOA (23.09.2022).</p> <p>The Switchgear items (such as circuit breakers, fuse switch units, contactors etc.), may be of his own make or shall be procured from reputed manufacturers and of proven design. At least one hundred circuit breakers of the make and type being offered must have been in satisfactory operation# as on the date of NOA (23.09.2022).</p> <p>#: satisfactory operation means certificate issued by the Employer/Utility certifying the operation without any adverse remark.</p>	<p>1. Bidder to Provide Compliance/Confirmation of fulfilling SL No.1 Technical Requirement.  2. Performance certificate /Letter /MOM etc. issued by end customer for Satisfactory operation  3. PO Copy / PO list in following format</p> <table border="1" data-bbox="1032 676 2013 834"> <thead> <tr> <th>Sl. No.</th> <th>Items Supplied to</th> <th>Order ref.</th> <th>Items</th> <th>Qty</th> <th>Order fully executed</th> <th>Status if order under execution</th> <th>Remarks if any</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table> <p>4. Type test certificates  5. Dispatch instructions/ Material receipt at site/ lorry receipt details etc.  6. Factory License and certificate</p>	Sl. No.	Items Supplied to	Order ref.	Items	Qty	Order fully executed	Status if order under execution	Remarks if any									
Sl. No.	Items Supplied to	Order ref.	Items	Qty	Order fully executed	Status if order under execution	Remarks if any												

THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANYWAY DETRIMENTAL TO THE INTEREST OF THE COMPANY.

COMPUTER DRG. PATH NAME : INVENTORY No. SIGN. & DATE REF. DRG. No.

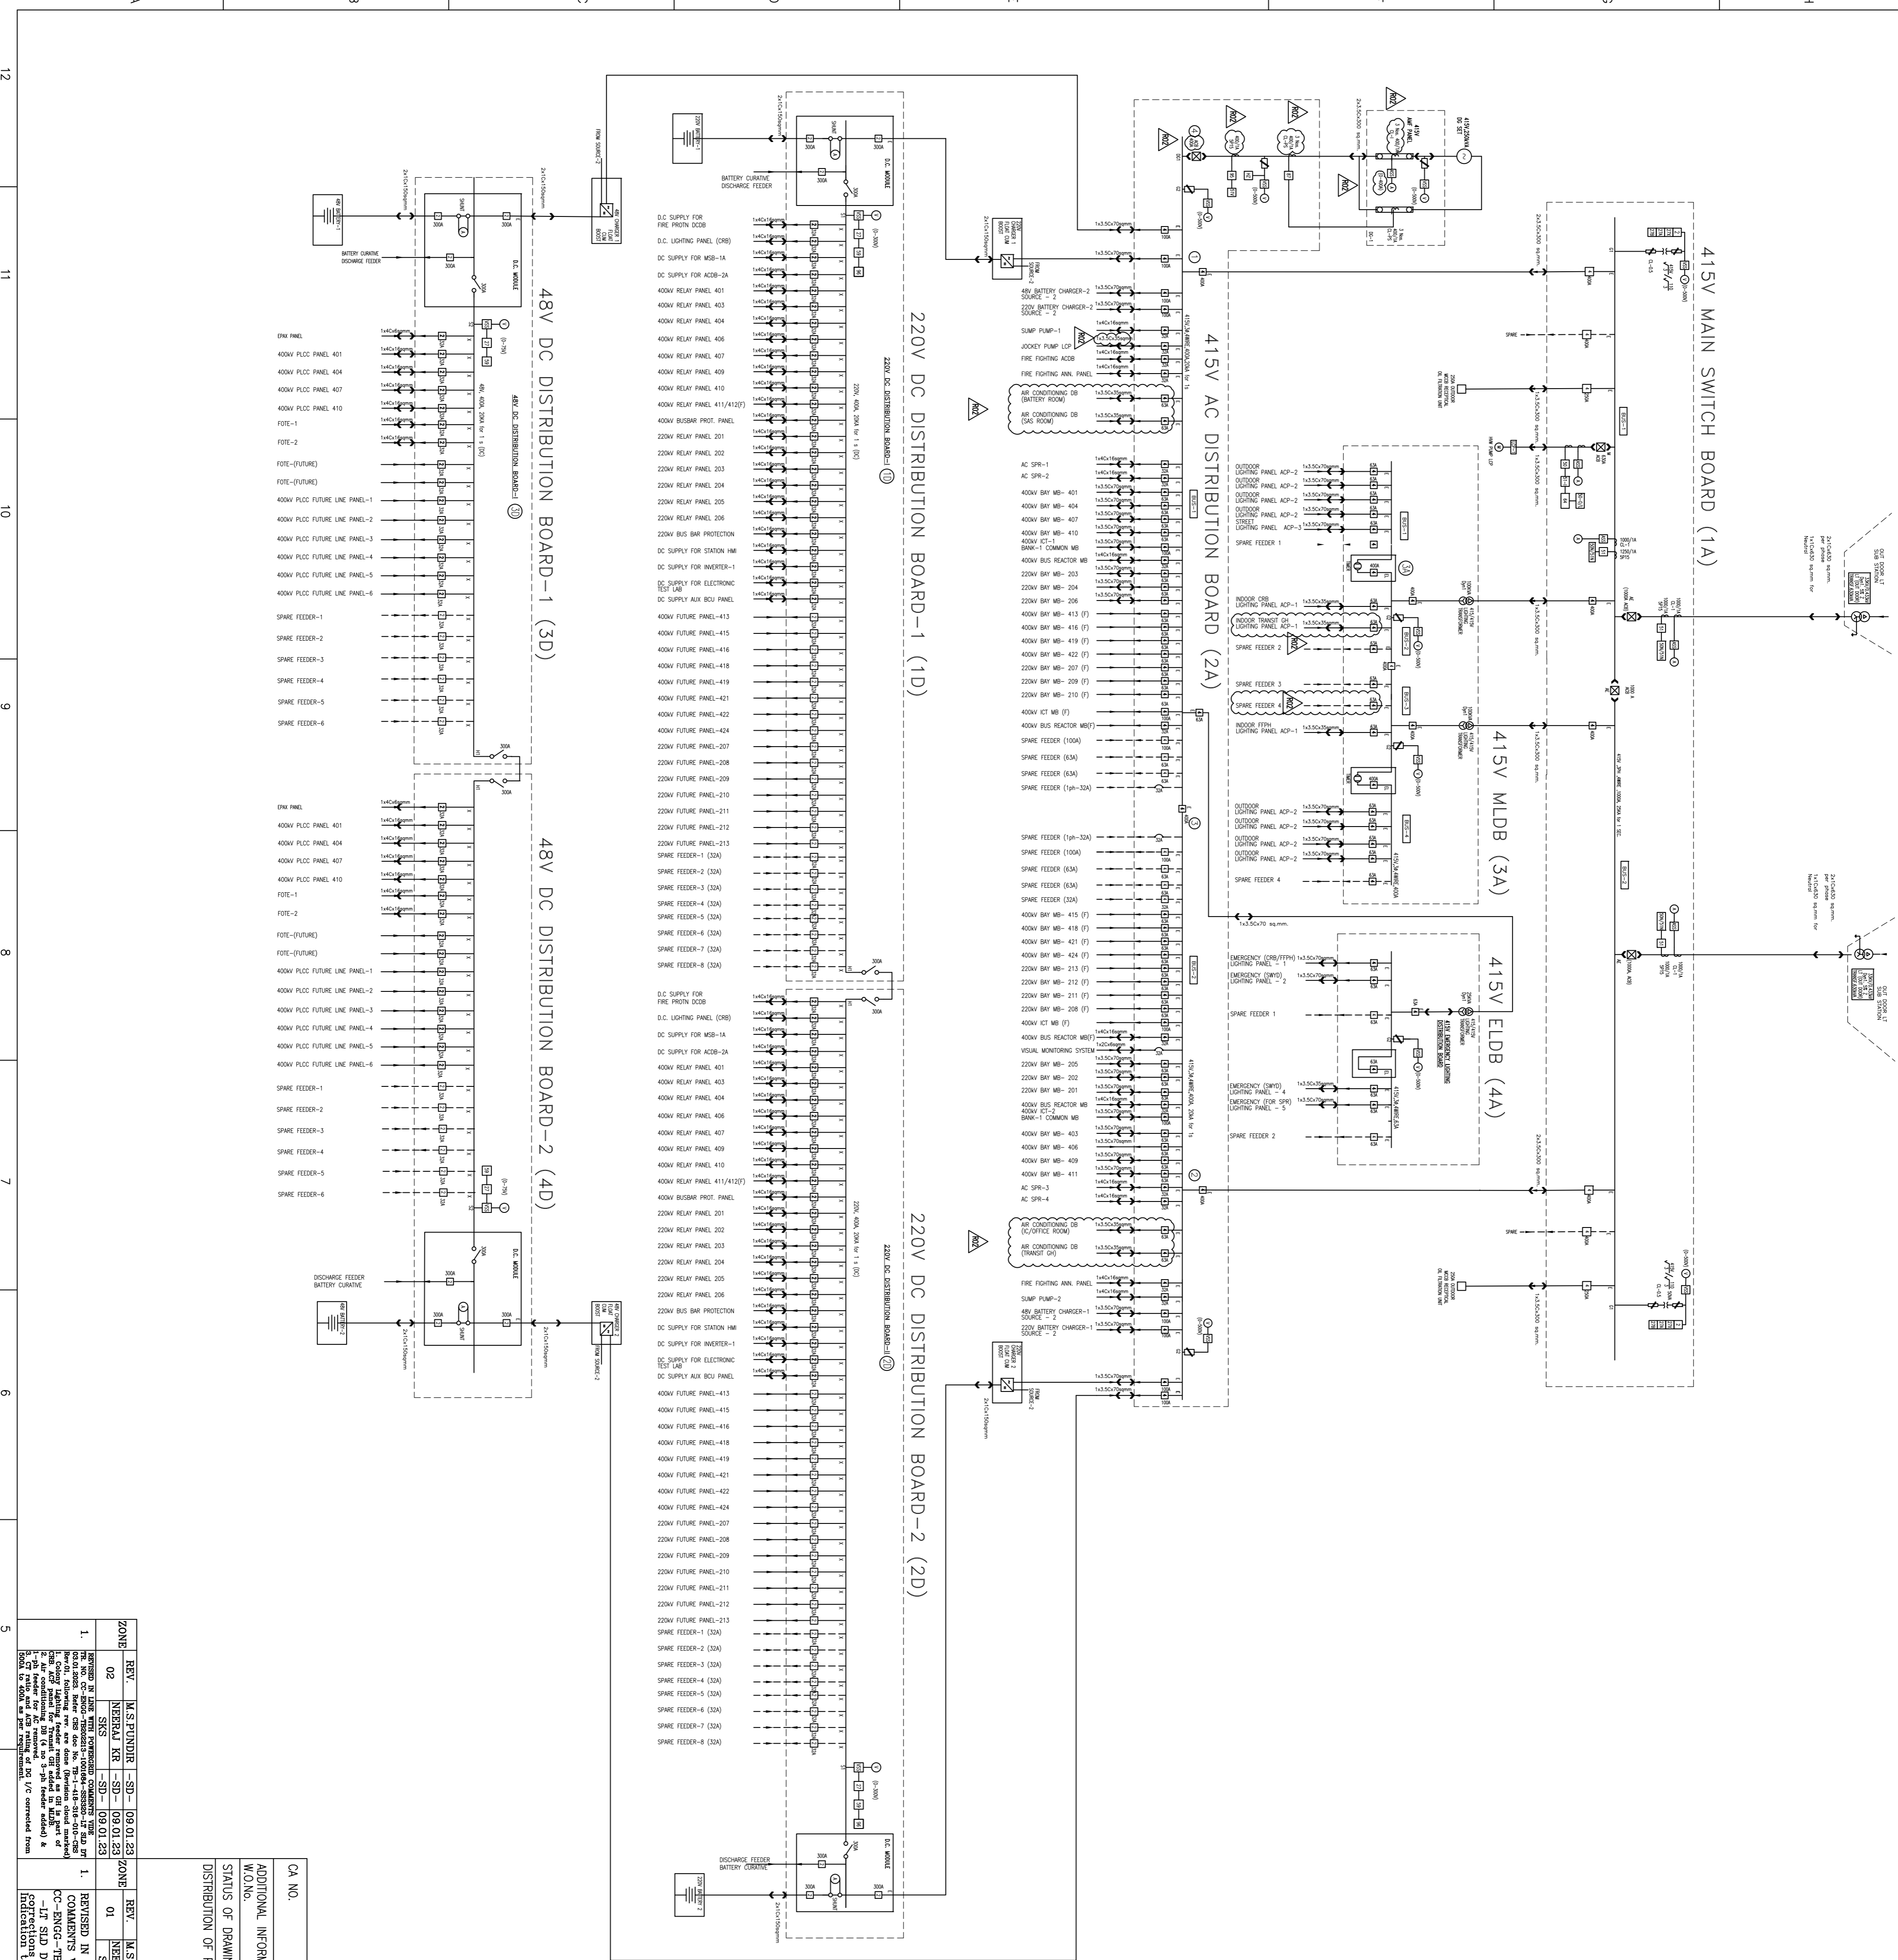

**LEGEND:-**

50V/51V : INSTANTANEOUS EARTH FAULT RELAY (Triple pole)  
 50 : TRIPLE POLE INSTANTANEOUS OVER CURRENT RELAY  
 51 : DOUBLE POLE INVERSE DEFINITE TIME RELAY  
 50-0/L : SINGLE POLE ADJUSTABLE DEFINITE TIME DELAY RELAY FOR MOTOR OVERLOAD ALARM  
 2 : 4C DOUBLE POLE INSTANTANEOUS UNDER VOLTAGE RELAY  
 27 : DC INSTANTANEOUS UNDER VOLTAGE RELAY  
 59 : EARTH LEAKAGE RELAY  
 S1V : THREE POLE VOLTAGE CONTROLLED DEFINITE TIME DELAY OVER CURRENT RELAY  
 87 : THREE POLE DIFFERENTIAL PROTECTION RELAY  
 95 : SINGLE POLE DEFINITE TIME OVER CURRENT RELAY  
 64 : SINGLE POLE INSTANTANEOUS E/F RELAY

**LEGEND:-**

⊗ DRAW OUT TYPE  
 ⊗ AIR PROTECT BREAKER  
 ⊗ NON DRAW OUT TYPE  
 ⊗ 2-POLE BREAKER  
 ⊗ NON DRAW OUT TYPE  
 ⊗ 4-POLE WCB  
 ⊗ NON DRAW OUT TYPE  
 ⊗ 2-POLE WCB  
 ⊗ CONTROL FUSE  
 ⊗ BATTERY LINKS/FUSES  
 ⊗ TIMER  
 ⊗ CABLE FEEDER

**NOTES:-**

- NO TWO AC SOURCE SHALL BE PARALLELED AT ANY STAGE.
- EACH BAY MB & TRANSFORMER MB SHALL BE FED BY ATLEAST ONE SOURCE FROM 415V AC BUS. SECOND SOURCE SHALL BE LOADED FROM NEAREST BAY MB & TRANSFORMER MB.
- MECHANICAL INTERLOCK SHALL BE PROVIDED TO ENSURE BREAKER OF DC SET WILL CLOSE ONLY WHEN SWITCHES X & Y ARE OPEN.
- OPERATION OF SUPPLY AND BUS BAY THE TECHNICAL SPECIFICATION.
- ALL THE FEEDERS SHOWN IN THE STD INCLUDING FEEDER/ SPARE ARE INCLUDED IN SCOPE OF SUPPLY.
- INTERVAL START OF LT AC/DC BAYERS.
- ONE DC 'X' TYPE MODULE IN EACH 48V DCDB SHALL BE PROVIDED FOR EACH BAY AS SHOWN IN SUBSTATION SLIP. BC & BUS-SECTION BAY FOR PRESENT & FUTURE BAYS AS 10 ONE DC 'X' TYPE MODULE IN EACH 48V DCDB SHALL BE PROVIDED FOR EACH LINE BAY.
- MODULE 'X' REFERRED ABOVE IS APPLICABLE WITH GP WCB. VANAMAM SING. OF GP WCB SHALL BE CONNECTED IN ONE MODULE OF OFFERED PANEL. SHALL BE COMPRESSED.
- CABLE PLATE SHALL BE OF NON WOODEN TYPE. SINGLE CORE POWER CABLE ARE USED TO BAY LOOPING SHALL BE DONE WITH 1.56-20 SQ.MM ALT POWER CABLE.
- UNLESS SPECIFIED, SOURCE '1' WILL BE FED FROM BUS '1' AND SOURCE '2' FROM BUS '2'.
- INSIST ON PANEL OR EQUIPMENT LIGHTING IN CASE OF FAILURE OF STD FEEDER.
- INSIST ON PANEL OR EQUIPMENT LIGHTING IN CASE OF FAILURE OF STD FEEDER.
- AMBURE-1 ENCLOSED WITH THIS DOCUMENT.

**REVISIONS:**

NO.	REV.	DESCRIPTION	DATE
1	02	ISSUED FOR THE S/S	09.01.23
1	01	REVISED IN LNB WITH POWERGRID COMMENTS AND TRANSMISSION CO. COMMENTS	21.12.22

**CA NO.** 7830/Neemuch REZ/400KV AIS/SS01/GS/NOA-1/06 dtd. 23/09/2022  
 7830/Neemuch REZ/400KV AIS/SS01/GS/NOA-1/06 dtd. 23/09/2022

**NAME OF CUSTOMER/PROJECT** POWER GRID CORPORATION OF INDIA LIMITED  
 NEEMUCH S/S - LT STD

**DESIGNER** M.S.PUNDIR  
**CHECKER** M.S.PUNDIR  
**APPROVED** M.S.PUNDIR

**DATE** 12.12.22

**SCALE** 1:1

**DRWING NO.** TB-1-418-316-010

**SHEET NO.** 00

**SECTION -2 of TB-418-316-025, Rev.00**

**MODEL TECHNICAL SPECIFICATION**  
**SECTION: LT SWITCHGEAR**

# SECTION: LT SWITCHGEAR

## Table of contents

Clause No.	Description	Page No.
1.1	CONSTRUCTIONAL DETAILS OF SWITCHBOARDS AND DISTRIBUTION BOARDS	1
1.2	DERATING OF EQUIPMENTS	4
1.3	POWER BUS BARS AND INSULATORS	4
1.4	EARTH BUS	4
1.5	AIR CIRCUIT BREAKERS	4
1.6	MOULDED CASE CIRCUIT BREAKER (MCCB) and MCB	7
1.7	RELAYS	7
1.8	CONTACTORS	8
1.9	INSTRUMENT TRANSFORMERS	8
1.10	INDICATING INSTRUMENTS	9
1.11	CONTROL & SELECTOR SWITCHES	9
1.12	AIR BREAK SWITCHES	10
1.13	PUSH BUTTONS	10
1.14	INDICATING LAMPS	10
1.15	FUSES	11
1.16	TERMINAL BLOCKS	11
1.17	NAME PLATES AND LABELS	12
1.18	SPACE HEATER	12
1.19	CONTROL AND SECONDARY WIRING	12
1.20	POWER CABLES TERMINATION	13
1.21	TYPE TESTS	13
1.22	ERECTION, TESTING AND COMMISSIONING	13
1.23	COMMISSIONING CHECK TESTS	14
1.24	SPECIAL TOOLS AND TACKLES	16
1.25	EQUIPMENT TO BE FURNISHED	16
1.26	PARAMETERS	21
1.27	AUTOMATIC CONTROL OF OUTDOOR LIGHTING	25
1.28	AUTOMATIC SUPPLY CHANGEOVER	25
1.29	ANALOGUE INPUTS	26
1.30	DIGITAL (POTENTIAL FREE INPUTS)	26

# SECTION: LT SWITCHGEAR

## 1.1. CONSTRUCTIONAL DETAILS OF SWITCHBOARDS AND DISTRIBUTION BOARDS

- 1.1.1. All boards shall be of metal enclosed, indoor floor mounted, compartmentalised double front construction and freestanding type.
- 1.1.2. All board frames, shall be fabricated using suitable mild steel structural sections or pressed and shaped cold-rolled sheet steel of thickness not less than 2.0 mm. Frames shall be enclosed in cold-rolled sheet steel of thickness not less than 1.6 mm. Doors and covers shall also be of cold rolled sheet steel of thickness not less than 1.6 mm. Stiffeners shall be provided wherever necessary. ***Gland plate shall be cold rolled sheet steel having thickness not less than 3 mm in all cases. However, in case of termination of single core power cables, gland plate shall be of non-magnetic material of at least 4mm thickness.***
- 1.1.3. All panel edges and cover/door edges shall be reinforced against distortion by rolling, bending or by the addition of welded reinforcement members.
- 1.1.4. The complete structures shall be rigid, self-supporting, and free from flaws, twists and bends. All cut-outs shall be true in shape and devoid of sharp edges.
- 1.1.5. All boards shall be of dust and vermin proof construction and shall be provided with a degree of protection of IP: 52, ***for category I enclosure*** as per IS 13947 (Part-1). However, the busbar chambers having a degree of protection of IP: 42, in accordance with IS 13947 (Part-1), are also acceptable where continuous busbar rating exceeds 1000 Amp. Provision shall be made in all ***draw out Air Circuit Breaker*** compartments for providing IP: 52 degree of protection, when Circuit breaker trolley, has been removed. ***Panels with lighting transformers shall have IP 31 degree of protection in accordance with IS 13947 (Part-1). Door frame of panels, meters, relays, Breaker cut-outs shall be provided with neoprene rubber gaskets generally conforming to Type-II, Class 2A as per IS: 11149.***
- 1.1.6. Provision of louvers on boards would not be preferred. However, louvers backed with metal screen are acceptable on the busbar chambers where continuous busbar rating exceeds 1000 Amps. ***Panels with lighting transformers in lighting distribution boards shall have louvers.***
- 1.1.7. All boards shall be of uniform height not exceeding 2450 mm.
- 1.1.8. Boards shall be easily extendible on both sides, by the addition of the vertical sections after removing the end covers ***of bus bar chambers.***

- 1.1.9. Boards shall be supplied with base frames made of structural steel sections, alongwith all necessary mounting hardware required for welding the base frames to the insert plates.
- 1.1.10. a) All boards shall be of double front construction and shall have :
- (i) A completely enclosed busbar compartment for running horizontal busbars and vertical busbars. Busbar chambers shall be completely enclosed with metallic portions. Bolted covers shall be provided for access to horizontal and Vertical busbars for repair and maintenance, which shall be feasible without disturbing feeder compartment. Vertical bus bar chambers shall be accessible from front as well as back side of the panel **and shall be of at least 350 mm width**. One set of vertical busbars shall be used in between two adjacent sections for switchgear connections. In case of ACB feeders, **the panel shall have single front without any vertical busbar chamber, however** vertical busbars **associated with ACBs shall be** located in rear side **and** shall be additionally covered with metallic perforated/ **transparent acrylic or polyvinyl** bolted sheets to avoid direct access after opening rear door of chamber.
  - (ii) Completely enclosed switchgear compartment(s) one for each circuit for housing circuit breaker or MCCB or motor starter.
  - (iii) A distinct compartment or alley for power and control cables on each side of panel. Cable alley compartment shall have a through metallic partition for segregating cables on both sides. Cable alley door shall preferably be hinged. Cable alley shall have no exposed live parts. Any live terminals shall be fully shrouded/insulated from safety aspects. However, it shall be of atleast 350mm width.
  - (iv) A compartment for relays and other control devices associated with a circuit breaker.
- b) ***Lighting transformers shall be supplied in separate and distinct panel completely assembled for incoming cable connection from bottom and outgoing connection through busbar with adjacent associated lighting distribution board. Lighting transformers shall have provision of base channel with rollers for taking in and out from the panel in case of maintenance after disconnecting incoming and outgoing connections. Provision of single phase fans at least two (2) numbers of suitable ratings shall be made in the panel for ventilation. These fans shall run in sequential mode at suitable time interval to be controlled by thermostat and timer. The offered design of panel should be such that in no case, temperature rise of lighting transformers shall exceed the permissible limits for the class of insulation of lighting transformer.***
- 1.1.11. Sheet steel barriers shall be provided between two adjacent vertical panels running to the full height of the switchboard, except for the horizontal busbar compartment. Each shipping section shall have full metal sheets at both ends for transport and storage.
- 1.1.12. All equipments associated with a single circuit except MCB circuits shall be housed in a separate compartment of the vertical section. The Compartment shall be sheet steel enclosed on all sides with the withdrawal units in position or removed. The front of the compartment shall be provided with the hinged single leaf door, with locking facilities. In case of circuits controlled by MCBs, group of MCB feeders can be offered in common compartment. In such case number of MCB feeder to be used in a common compartment shall not exceed 4 (four) and front of MCB compartment, shall have a viewing port of

toughen glass sheet for viewing and sheet steel door of module shall be lockable with star knob/panel key.

- 1.1.13. After isolation of power and control circuit connections it shall be possible to safely carryout maintenance in a compartment with the busbar and adjacent circuit live. Necessary shrouding arrangement shall be provided for this purpose over the cable terminations located in cable alley.
- 1.1.14. The minimum clearance in air between phases and between phase and earth for the entire run of horizontal and vertical busbars, shall be 25 mm. For all other components, the clearance between "two live parts", " A live part and an earthed part" and isolating distance shall be atleast ten (10) mm throughout. Wherever it is not possible to maintain these clearances, insulation shall be provided by sleeving or barriers. However, for horizontal run of busbar minimum clearance of 25 mm should be maintained even if they are sleeved.
- 1.1.15. The temperature rise of horizontal & vertical busbars when carrying rated current along its full run shall in no case exceed 55°C, with silver plated joints and 40°C with all other type of joints over an outside ambient temperature of 50°C.
- 1.1.16. All busbar chambers shall be provided with removable bolted covers . The covers shall be provided with danger labels.
- 1.1.17. All identical circuit breakers and module chassis of same test size shall be fully interchangeable without having to carryout modifications.
- 1.1.18. All Circuit breaker boards shall be of Single Front type, with fully drawout circuit breakers, which can be drawn out without having to unscrew any connections. The circuit breakers shall be mounted on rollers and guides for smooth movement between SERVICE, TEST and ISOLATED positions and for withdrawal from the Switchboard. Testing of the breaker shall be possible in the TEST position.
- 1.1.19. Wherever two breaker compartments are provided in the same vertical section, insulating barriers and shrouds shall be provided in the rear cable compartment to avoid accidental touch with the live parts of one circuit when working on the other circuit.
- 1.1.20. All disconnecting contacts for power circuits shall be of robust design and fully self aligning. Fixed and moving contacts of the power drawout contact system shall be silver plated. Both fixed and moving contacts shall be replaceable.
- 1.1.21. All AC & DC boards shall be of double Front type.
- 1.1.22. All module shall be fixed type except air circuit breaker module, which shall be drawout type.
- 1.1.23. The connections from busbars to the main switch shall be fully insulated/shrouded, and securely bolted. The partition between the feeder compartment and cable alley may be non-metallic and shall be of such construction as to allow cable cores with lugs to be easily inserted in the feeder compartment for termination.
- 1.1.24. All equipment and components shall be neatly arranged and shall be easily accessible for operation and maintenance. The internal layout of all modules shall be subject to PURCHASER approval. Bidder shall submit dimensional drawings showing complete internal details of Busbars and module components, for each type and rating for approval.

- 1.1.25. The tentative power and control cable entries shall be from bottom. However, Purchaser reserves the right to alter the cable entries, if required, during detailed engineering, without any additional commercial implication.
- 1.1.26. Adopter panels and dummy panels required to meet the various busbar arrangements and layouts required shall be included in Bidder's scope of work.

## 1.2. **DERATING OF EQUIPMENTS**

- 1.2.1. The current ratings of all equipments as specified in the ***Single Line Diagram For AC & DC System*** are the minimum standards current ratings at a reference ambient temperature as per relevant Indian Standards.

## 1.3. **POWER BUS BARS AND INSULATORS**

- 1.3.1. All AC Distribution Boards shall be provided with three phase buses and a neutral bus bars and the DC Distribution Boards shall be provided with two busbars.
- 1.3.2. All busbars and jumper connections shall be of high conductivity aluminium/copper of adequate size.
- 1.3.3. The Cross-Section of the busbars shall be uniform through out the length of Switchgear and shall be adequately supported and braced to withstand the stresses due to the specified short circuit currents.
- 1.3.4. All busbars shall be adequately supported by ***adequate numbers of*** high strength type Polyester fibre glass Moulded Insulators ***to withstand short circuit withstand capability of panel***. Separate supports shall be provided for each phase and neutral busbar. If a common support is provided anti-tracking barriers shall be provided between the supports.
- 1.3.5. All busbars joints shall be provided with high tensile steel bolts. Belleville/spring washers and nuts, so as to ensure good contacts at the joints. Non-silver plated Busbars joints shall be thoroughly cleaned at the joint locations and a suitable contact grease shall be applied just before making a joint.
- 1.3.6. All busbars shall be colour coded as per IS: 11353-1985: ***Guide for Uniform System of Marking and Identification of Conductors and Apparatus Terminals***.
- 1.3.7. The Bidder shall furnish calculations, establishing the adequacy of busbar sizes for specified current ratings, On the basis of short circuit current and temperature rise consideration at specified ambient temp.

## 1.4. **EARTH BUS**

- 1.4.1. A galvanised steel earthing shall be provided at the bottom of each panel and shall extend throughout the length of each switchboard. It shall be welded/bolted to the frame work of each panel and breaker earthing contact bar vertical bus shall be provided in each vertical section which shall in turn be bolted/welded to main horizontal ground bus.
- 1.4.2. The earth bus shall have sufficient cross-section to carry the momentary short circuit and short time fault currents to earth without exceeding the allowable temperature rise.

- 1.4.3. Suitable arrangements shall be provided at each end of the horizontal earth bus for bolting to Purchaser's earthing conductors. The horizontal earth bus shall project out the switchboard ends and shall have predrilled holes for this connection. A joint spaced and taps to earth bus shall be made through at least two bolts.
- 1.4.4. All non-current metal work of the Switchboard shall be effectively bonded to the earth bus. Electrical conductivity of the whole switchgear enclosures frame work and the truck shall be maintained even after painting.
- 1.4.5. The truck and breaker frame shall get earthed while the truck is being inserted in the panel and positive earthing of the truck and breaker frame shall be maintained in all positions. SERVICES & ISOLATED, as well as through out the intermediate travel.
- 1.4.6. **Air Circuit Breaker (ACB)** module frame shall get engaged to the vertical earth bus, before the disconnecting contacts on these module are engaged to the vertical busbar.
- 1.4.7. All metallic cases of relays, instruments and other panel mounted equipments shall be connected to earth by independent stranded copper wires of size not less than 2.5 mm<sup>2</sup>. Insulation colour code of earthing wires shall be green. Earthing wires shall be connected to terminals with suitable clamp connectors and soldering is not acceptable. Looping of earth Connection which would result in loss of earth connection to the devices when a device is removed is not acceptable. However, looping of earth connections between equipment to provide alternative paths or earth bus is acceptable.
- 1.4.8. VT and CT secondary neutral point earthing shall be at one place only, on the terminal block. Such earthing shall be made through links so that earthing of one secondary circuit shall be removed without disturbing the earthing of other circuit.
- 1.4.9. All hinged doors shall be earthed through flexible earthing braid.
- 1.4.10. Caution nameplate 'Caution-Live Terminals' shall be provided at all points where the terminals are like to remain live and isolation is possible only at remote end.
- 1.5. **AIR CIRCUIT BREAKERS**
- 1.5.1. Circuit breakers shall be three-pole air break horizontal drawout type and shall have inherent fault making and breaking capacities as specified in "Technical Parameters". The circuit breakers which meet specified parameter only after provision of releases or any other devices shall not be acceptable.
- 1.5.2. Circuit breakers shall be mounted along with its operating mechanism on a wheeled carriage. Suitable guides shall be provided to minimise misalignment of the breaker.
- 1.5.3. There shall be 'Service', 'Test' and 'Fully withdrawn' positions for the breakers. In 'Test' position the circuit breaker shall be capable of being tested for operation without energising the power circuits i.e. the power Contacts shall be disconnected while the Control circuits shall remain undisturbed. Locking facilities shall be provided so as to prevent movement of the circuit breaker from the 'SERVICE', 'TEST' OR FULLY WITHDRAWN' position. It shall be possible to close the door in TEST position.
- 1.5.4. All circuit breakers shall be provided with 4 NO and 4 NC potentially free auxiliary contacts. These contacts shall be in addition to those required for internal mechanism of the breaker. Separate limit switches each having required number of contacts shall be

provided in both 'SERVICE' & 'TEST' position of the breaker. All contacts shall be rated for making continuously carrying and breaking 10 Amps at 240V AC and 1 Amp (Inductive) at 220V DC.

- 1.5.5. Suitable mechanical indications shall be provided on all circuit breakers to show 'OPEN', 'CLOSE', 'SERVICE', 'TEST' and 'SPRING CHARGED' positions.
- 1.5.6. Main poles of the circuit breakers shall operate simultaneously in such a way that the maximum difference between the instants of contacts touching during closing shall not exceed half cycle of rated frequency.
- 1.5.7. All circuit breakers shall be provided with the interlocks as explained in further clauses.
- 1.5.8. Movement of a circuit breaker between SERVICE AND TEST positions shall not be possible unless it is in OPEN position. Attempted with drawl of a closed circuit breaker shall trip the circuit breaker.
- 1.5.9. Closing of a circuit breaker shall not be possible unless it is in SERVICE, TEST POSITION or in FULLY WITHDRAWN POSITION.
- 1.5.10. Circuit breaker cubicles shall be provided with safety shutters operated automatically by the movement of the circuit breaker carriage to cover the stationary isolated contacts when the breaker is withdrawn. It shall however, be possible to open the shutters intentionally, against spring pressure for testing purpose.
- 1.5.11. A breaker of particular rating shall be prevented from insertion in a cubicle of a different rating.
- 1.5.12. Circuit breakers shall be provided with electrical anti-pumping and trip free feature, even if mechanical antipumping feature is provided.
- 1.5.13. Mechanical tripping shall be possible by means of front mounted RED 'Trip' push-button. In case of electrically operated breakers these push buttons shall be shrouded to prevent accidental operation.
- 1.5.14. Breaker controlled motors shall operate satisfactorily under the following conditions:
  - (i) Direct on-line starting of Induction Motors rated 110 kW to 220 kW with a locked rotor current of seven times the rated current, and starting time of up to 30 seconds.
  - (ii) Breaking on-load, full load and locked rotor currents of Induction Motors for rated 100 kW to 220 kW.
- 1.5.15. Means shall be provided to slowly close the circuit breaker in withdrawn position. If required for inspection and setting of Contacts, in service position slow closing shall not be possible.
- 1.5.16. Power operated mechanism shall be provided with a universal motor suitable for operation 220V DC Control supply with voltage variation from 90% to 110% rated voltage. Motor insulation shall be class 'E' or better.
- 1.5.17. The motor shall be such that it requires not more than 30 seconds for fully charging the closing spring.

- 1.5.18. Once the closing springs are discharged, after the one closing operation of circuit breaker, it shall automatically initiate, recharging of the spring.
- 1.5.19. The mechanism shall be such that as long as power is available to the motor, a continuous sequence of closing and opening operations shall be possible. After failure of power supply at least one open-close-open operation shall be possible.
- 1.5.20. Provision shall be made for emergency manual charging and as soon as this manual charging handle is coupled, the motor shall automatically get mechanically decoupled.
- 1.5.21. All circuit breakers shall be provided with closing and trip coils. The closing coils shall operate correctly at all values of Voltage between 85% to 110% at rated control voltage. The trip coil shall operate satisfactorily under all values of supply voltage between 70% to 110% of rated control voltage.
- 1.5.22. Provision for mechanical closing of the breaker only in 'TEST' and 'WITHDRAWN' positions shall be made.
- 1.5.23. **PROTECTION CO-ORDINATION**
- 1.5.23.1. It shall be the responsibility of the Contractor to fully co-ordinate the overload and short circuit tripping of the circuit breakers with the upstream and down stream circuit breakers/fuses/motor starters, to provide satisfactory discrimination.
- 1.6. MOULDED CASE CIRCUIT BREAKER (MCCB) and MCB**
- 1.6.1.** MCCB shall in general conform to IS: 13947 Part-2. All MCCB *offered* shall *have Ics = 100% Icu rating. Type test reports for offered model of MCCB shall be submitted during detailed engineering for owner's acceptance.*
- 1.6.2.** MCCB shall be flush mounted on the AC/DC distribution boards *and shall have extended handle.*
- 1.6.3 MCCBs shall be provided with thermo-magnetic type release for over current and short circuit protection. The setting of the thermal release shall be adjustable between **80%** to 100% of the rated current. The MCCB shall have breaking capacity not less than 20kA.
- 1.6.4** MCCBs used for ACDB incomers and Bus coupler shall be equipped with stored energy mechanism for electrical closing and tripping. All other MCCBs shall be manually operated. The operating handle should give a clear trip indication.
- 1.6.5 Miniature circuit breaker (MCB) shall conform to IEC: 898-1987 and IS: 8828.
- 1.7 RELAYS**
- 1.7.1 All relays and timers in protective circuits shall be flush mounted on panel front with connections from the inside. They shall have transparent dust tight covers removable from the front. All protective relays shall have a drawout construction for easy replacement from the front. They shall either have built-in test facilities, or shall be provided with necessary test blocks and test switches located immediately below each relay. The auxiliary relays and timers may be furnished in non-drawout cases.

- 1.7.2 All AC relays shall be suitable for operation, at 50 Hz with 110 volts VT secondary and 1 amp or 5 amp CT secondary.
- 1.7.3 All protective relays and timers shall have at least two potentially free output contacts. Relays shall have contacts as required for protection schemes. Contacts of relays and timers shall be silver faced and shall have a spring action. Adequate number of terminals shall be available on the relay cases for applicable relaying schemes.
- 1.7.4 All protective relays auxiliary relays and timers shall be provided with hand reset operation indicators (Flags) for analysing the cause of operation.
- 1.7.5 All relays shall withstand a test voltage of 2 KV (rms) for one minute.
- 1.7.6 Motor starters shall be provided with three element, ambient temperature compensated, time lagged, hand reset type overload relays with adjustable settings. The setting ranges shall be properly selected to suit the motor ratings. These relays shall have a separate black coloured hand reset push button mounted on compartment door and shall have at least one changeover contact.
- 1.7.7 All fuse-protected contactor-controlled motors shall have single phasing protection, either as a distinct feature in the overload relays (by differential movement of bimetallic strips), or as a separate device. The single phasing protection shall operate even with 80% of the set current flowing in two of the phases.
- 1.8 **CONTACTORS**
- 1.8.1 Motor starter contactors shall be of air break, electromagnetic type rated for uninterrupted duty as per IS:13947 (Part 4).
- 1.8.2 Contactors shall be double break, non-gravity type and their main contacts shall be silver faced.
- 1.8.3 Direct on line starter contactors shall be of utilisation category AC2. These contactors shall be as per IS:13947 (Part 4).
- 1.8.4 Each contactor shall be provided with two (2) normally open (NO) and two (2) normally close (NC) auxiliary contacts.
- 1.8.5 Operating coils of contactors shall be of 240V AC Unless otherwise specified elsewhere. The Contactors shall operate satisfactorily between 85% to 110% of the rated voltage. The Contactor shall drop out at 70% of the rated voltage.
- 1.9 **INSTRUMENT TRANSFORMERS**
- 1.9.1 All current and voltage transformers shall be completely encapsulated cast resin insulated type suitable for continuous operation at the temperature prevailing inside the switchgear enclosure, when the switchboard is operating at its rated condition and the outside ambient temperature is 50°C.
- 1.9.2 All instrument transformers shall be able to withstand the thermal and mechanical stresses resulting from the maximum short circuit and momentary current ratings of the associated switchgear.

- 1.9.3 All instrument transformer shall have clear indelible polarity markings. All secondary terminals shall be wired to a separate terminal on an accessible terminal block where star-point formation and earthing shall be done.
- 1.9.4 Current transformers may be multi or single core type. All voltage transformers shall be single phase type. The Bus VTs shall be housed in a separate compartment.
- 1.9.5 All VTs shall have readily accessible **MCBs** on both primary and secondary sides.

1.10 **INDICATING INSTRUMENTS**

- 1.10.1 All indicating and integrating meters shall be flush mounted on panel front. The instruments shall be of at least 96 mm square size with 90 degree scales, and shall have an accuracy class of 2.5 or better. The covers and cases of instruments and meters shall provide a dust and vermin proof construction.
- 1.10.2 All instruments shall be compensated for temperature errors and factory calibrated to directly read the primary quantities. Means shall be provided for zero adjustment without removing or dismantling the instruments.
- 1.10.3 All instruments shall have white dials with black numerals and lettering. Black knife edge pointer with parallax free dials will be preferred.
- 1.10.4 Ammeters provided on Motor feeders shall have a compressed scale at the upper current region to cover the starting current.
- 1.10.5 Watt-hour meters shall be of 3 phase three element type, Maximum demand indicators need not be provided.

1.11 **CONTROL & SELECTOR SWITCHES**

- 1.11.1 Control & Selector switches shall be of rotary type with escutcheon plates clearly marked to show the function and positions. The switches shall be of sturdy construction suitable for mounting on panel front. Switches with shrouding of live parts and sealing of contacts against dust ingress shall be preferred.
- 1.11.2 Circuit breaker selector switches for breaker Controlled motor shall have three stay put positions marked 'Switchgear', 'Normal' and 'Trial' respectively. They shall have two contacts of each of the three positions and shall have black shade handles.
- 1.11.3 Ammeter and voltmeter selector switches shall have four stayput position with adequate number of contacts for three phase 4 wire system. These shall have oval handles Ammeter selector switches shall have make before break type contacts to prevent open circuiting of CT secondaries.
- 1.11.4 Contacts of the switches shall be spring assisted and shall be of suitable material to give a long trouble free service.
- 1.11.5 The contact ratings shall be at least the following :
 

(i)	Make and carry continuously	10 Amp.
(ii)	Breaking current at 220V DC	1 Amp (Inductive)
(iii)	Breaking current at 240V AC	5 Amp (at 0.3 pf lagging)

## 1.12 AIR BREAK SWITCHES

- 1.12.1 Air breaker switch shall be of the heavy duty, single throw group operated, load break, fault make type complying with IS:13947,Part-3.
- 1.12.2 The Bidder shall ensure that all switches are adequately rated so as to be fully protected by the associated fuses during all abnormal operating conditions such as overload, locked motor, short circuit etc.
- 1.12.3 Switch operating handles shall be provided with padlocking facilities to lock them in 'OFF' position.
- 1.12.4 Interlocks shall be provided such that it is possible to open the cubicle door only when the switch is in 'OFF' position and to close the switch only when the door is closed. However suitable means shall be provided to intentionally defeat the interlocks explained above.
- 1.12.5 Switches and fuses for AC/DC control supply and heater supply wherever required shall be mounted inside and cubicles.

## 1.13 PUSH BUTTONS

- 1.13.1 Push-buttons shall be of spring return, push to actuate type. Their contacts shall be rated to make, continuously carry and break 10A at 240V and 0.5A (inductive) at 220V DC.
- 1.13.2 All push-buttons shall have one normally open and one normally closed contact, unless specified otherwise. The contact faces shall be of silver or silver alloy.
- 1.13.3 All push-buttons shall be provided with integral escutcheon plates marked with its function.
- 1.13.4 The colour of the button shall be as follows :
- |       |       |   |                                |
|-------|-------|---|--------------------------------|
| (i)   | GREEN | : | For motor START, Breaker CLOSE |
| (ii)  | RED   | : | For motor TRIP, Breaker OPEN   |
| (iii) | BLACK | : | For overload reset.            |
- 1.13.5 All push-buttons on panels shall be located in such a way that Red-push-buttons shall always be to the left of green push-buttons.

## 1.14 INDICATING LAMPS

- 1.14.1 Indicating lamps shall be of the panel mounting cluster LED type. The lamps shall have escutcheon plates marked with its function, wherever necessary.
- 1.14.2 Lamps shall have translucent lamp-covers of the following colours, as warranted by the application :
- |       |       |   |   |
|-------|-------|---|---|
| (i)   | RED   | : | For motor ON, Breaker CLOSED  |
| (ii)  | GREEN | : | For motor OFF, Breaker OPEN   |
| (iii) | WHITE | : | For motor Auto-Trip   |
| (iv)  | BLUE  | : | For all healthy conditions (e.g. control supply, and also for 'SPRING CHARGED') |

(v) AMBER : For all alarm conditions (e.g. overload) Also for 'SERVICE' and 'TEST' positions indicators.

1.14.3 Lamps shall be easily replaceable from the front of the cubicle.

1.14.4 Indication lamps should be located just above the associated push buttons/control switches. Red lamps shall invariably be located to the right of green lamps. In case a white lamp is also provided, it shall be placed between the red and green lamps along with the centre line of control switch/push button pair. Blue and Amber lamps should normally be located above the Red and Green lamps.

1.14.5 When associated with push-buttons, red lamps shall be directly above the green push button, and green lamps shall be directly above the red push-button. All indicating lamps shall be suitable for continuous operation at 90 to 110% of their rated voltage.

## 1.15 FUSES

1.15.1 All fuses shall be of HRC cartridge fuse link type. Screw type fuses shall not be accepted. Fuses for AC Circuits shall be of class 2 type, 20 kA (RMS) breaking current at 415 AC, and for DC circuits Class 1 type 4 kA breaking current.

1.15.2 Fuses shall have visible operation indicators.

1.15.3 Fuses shall be mounted on fuses carriers, which are mounted on fuse bases, wherever it is not possible to mount fuses on carriers fuses shall be directly mounted on plug in type of bases. In such cases one set of insulated fuse pulling handles shall be supplied with each switchgear.

1.15.4 Fuse rating shall be chosen by the Bidder depending upon the circuit requirements and these shall be subject to approval of PURCHASER.

## 1.16 TERMINAL BLOCKS

1.16.1 Terminal blocks shall be of 750 volts grade and have continuous rating to carry the maximum expected current on the terminals. It shall be complete with insulating barriers, clip-on-type/stud type terminals for Control Cables and identification strips. Marking on terminal strip shall correspond to the terminal numbering on wiring on diagrams. It shall be similar to 'ELEMEX' standard type terminals, cage clamp type of Phoenix or WAGO or equivalent

1.16.2 Terminal blocks for CT and VT secondary leads shall be provided with test links and isolating facilities. CT secondary leads shall be provided with short circuiting and earthing facilities. It shall be similar to 'Elem.' 'CATD' - Type.

1.16.3 In all circuit breaker panels at least 10% spare terminals for external connections shall be provided and these spare terminals shall be uniformly distributed on all terminal blocks. Space for adding another 10% spare terminals shall also be available.

1.16.4 All terminal blocks shall be suitable for terminating on each side, two (2) Nos. of 2.5 mm square size standard copper conductors.

1.16.5 All terminals shall be numbered for identification and grouped according to the function. Engraved white-on-black labels shall be provided on the terminal blocks.

1.16.6 Wherever duplication of a terminal block is necessary it shall be achieved by solid bonding links.

1.16.7 Terminal blocks shall be arranged with at least 100 mm clearance between two sets of terminal block. The minimum clearance between the first row of terminal block and the associated cable gland plate shall be 250 mm.

#### 1.17 **NAME PLATES AND LABELS**

1.17.1 All switchgears, AC/DC distribution boards, shall be provided with prominent, engraved identification plates. The module identification plate shall clearly give the feeder number and feeder designation. For single front switchboards, similar panel and board identification labels shall be provided at the rear also.

1.17.2 All name plates shall be of non-rusting metal or 3-ply lamincoid with white engraved lettering on black back ground. Inscriptions and lettering sizes shall be subject to PURCHASER approval.

1.17.3 Suitable plastic sticker labels shall be provided for easy identification of all equipments, located inside the panel/module. These labels shall be positioned so as to be clearly visible and shall give the device number as mentioned in the module wiring drawings.

#### 1.18 **SPACE HEATER**

1.18.1 Space heater shall be provided in all the boards for preventing harmful moisture condensation.

1.18.2 The space heaters shall be suitable for continuous operation on 240V AC, 50 Hz, single phase supply, and shall be automatically controlled by thermostats. Necessary isolating switches and fuses shall also be provided.

#### 1.19 **CONTROL AND SECONDARY WIRING**

1.19.1 All switchboards shall be supplied completely wired internally upto the terminal blocks ready to receive Purchaser's control cables.

1.19.2 All inter cubicle and inter panel wiring and connections between panels of same switchboard including all bus wiring for AC and DC supplies shall be provided by the bidder.

1.19.3 All internal wiring shall be carried out with 1100 V grade, single core, 1.5 square mm or larger stranded copper wires having colour coded, PVC insulation. CT circuits shall be wired with 2.5 square mm copper wires. Voltage grade and insulation shall be same as above.

1.19.4 Extra-flexible wires shall be used for wiring to device mounted on moving parts such as hinged doors.

1.19.5 All wiring shall be properly supported, neatly arranged, readily accessible and securely connected to equipment terminals and terminals blocks.

#### 1.20 **POWER CABLES TERMINATION**

- 1.20.1 Cable termination compartment and arrangement for power cables shall be suitable for stranded aluminium conductor, armoured XLPE/PVC insulated and sheathed, single core/three core, 1100 V grade cables.
- 1.20.2 All necessary cable terminating accessories such as Gland plates, supporting clamps and brackets, power cable lugs, hardware etc. shall be provided by the successful bidder, to suit the final cable sizes which would be advised later.
- 1.20.3 The gland plate shall be of removable type and shall cover the entire cable alley. Bidder shall also ensure that sufficient space is provided for all cable glands. For all single core cables, gland plates shall be of non-magnetic Material.
- 1.21 **TYPE TESTS**
- 1.21.1 Type tests reports on Panels (Switchgear and Control gear assemblies) as per IS 8623 Part-I shall be submitted for the following tests in line with clause 9.0 of Section-3:
- i) Verification of temperature rise limits
  - ii) Verification of the dielectric properties
  - iii) Verification of short circuit strength
  - iv) Verification of the continuity of the protective circuit
  - v) Verification of clearances and creepage distances
  - vi) Verification of mechanical operation
  - vii) Verification of degree of protection
- 1.21.2 Contractor shall submit type test reports for the following Switchgear and Control gears before the fabrication of switchgear is started:
1. Circuit breakers/MCCB as per IS 13947 Part-II
  2. Protective Relays as per IEC: 60255.
  3. ***Lighting transformers as per IS:2026***
- For above equipments, test conducted once are acceptable (i.e. The requirement of test conducted within last *ten* years shall not be applicable)
- 1.22 **ERECTION, TESTING AND COMMISSIONING**
- 1.22.1 The Contractor shall unload, erect, install, test and put into commercial use all electrical equipment included in this specification.
- 1.22.2 Equipment shall be installed in a neat, workman like manner so that it is level, plumb, square and properly aligned and oriented. Tolerance shall be as established in Contractor's drawings or as stipulated by purchaser. No equipment shall be permanently bolted down to foundations until the alignment has been checked and found acceptable by the purchaser.
- 1.22.3 Contractor shall furnish all supervision, labour tools equipment rigging materials, bolts, wedges, anchors, concrete inserts etc. in proper time required to completely install, test and commission the equipment.
- 1.22.4 Manufacturer's and purchaser's instructions and recommendations shall be correctly followed in handling, setting, testing and commissioning of all equipment.

- 1.22.5 Contractor shall move all equipment into the respective room through the regular door or openings specifically provided for this purpose. No part of the structure shall be utilised to lift or erect any equipment without prior permission of Purchaser.
- 1.22.6 All boards shall be installed in accordance with *relevant code of practices* and at Purchaser's instructions. All boards shall be installed on finished surfaces, concrete or steel stills. Contractor shall be required to install and align any channel sills which form part of foundations. In joining shipping sections of switchboards together adjacent housing of panel sections or flanged throat sections shall be bolted together after alignment has been completed. Power bus, enclosures ground and control splices of conventional nature shall be cleaned and bolted together being drawn up with torque spanner of proper size or by other approved means.
- 1.22.7 All boards shall be made completely vermin proof.
- 1.22.8 Contractor shall take utmost care in holding instruments, relaying and other delicate mechanism wherever the instruments and relays are supplied separately they shall be mentioned only after the associated panels have been erected and aligned. The packing materials employed for safe transit of instrument and relays shall be removed after ensuring that panel have been completely installed and to further movement of the same should be necessary. Any damage shall be immediately reported to Purchaser.
- 1.22.9 Equipment furnished with finished coats of paint shall be touched by up Contractor if their surface is specified or marred while handling.
- 1.22.10 After installation of panels, power and control wiring and connections, Contractor shall perform operational tests on all switchboards, to verify proper operation of switchboards/panels and correctness of all equipment in each and every respect. The cable opening and cables entries for cables terminating to the panels shall be sealed with fire sealing materials.

## 1.23 **COMMISSIONING CHECK TESTS**

The Contractor shall carry out the following commissioning checks, in addition to the other checks and tests recommended by the manufacturers.

### 1.23.1 **General**

- 1.23.1.1 Check name plate details according to the specification.
- 1.23.1.2 check for physical damage.
- 1.23.1.3 Check tightness of all bolts, clamps, joints connecting terminals.
- 1.23.1.4 Check earth connection.
- 1.23.1.5 Check cleanliness of insulators and bushings.
- 1.23.1.6 Check all moving parts for proper lubrication.
- 1.23.1.7 Check settings of all the relays.

### 1.23.2 **Circuit Breakers**

- 1.23.2.1 Check alignment of breaker truck for free movement.
- 1.23.2.2 Check correct operation of shutters.
- 1.23.2.3 Check control wiring for correctness of connections, continuity and IR values.
- 1.23.2.4 Manual operation of breaker completely assembled.
- 1.23.2.5 Power closing/opening operation, manually and electrically.
- 1.23.2.6 Breaker closing and tripping time.
- 1.23.2.7 Trip free and anti-pumping operation.
- 1.23.2.8 IR values, minimum pick up voltage and resistance of coils.
- 1.23.2.9 Contact resistance
- 1.23.2.10 Simultaneous closing of all the three phases.
- 1.23.2.11 Check electrical & mechanical interlocks provided.
- 1.23.2.12 Check on spring charging motor, correct operation of limit switches, and time of charging.
- 1.23.2.13 All functional checks.
- 1.23.3 **Current Transformers**
- 1.23.3.1 Megger between winding and winding terminals to body.
- 1.23.3.2 Polarity test
- 1.23.3.3 Ratio identification checking of all ratios on all cores by primary injection of current.
- 1.23.3.4 Spare CT cores, if available, to be shorted and earthed.
- 1.23.4 **Voltage Transformer**
- 1.23.4.1 Insulation resistance test
- 1.23.4.2 Ratio test on all cores.
- 1.23.4.3 Polarity test.
- 1.23.4.4 Line connections as per connection diagram.
- 1.23.5 **Cubicle Wiring**
- 1.23.5.1 Check all switch developments.
- 1.23.5.2 Each wire shall be traced by continuity tests and it should be made sure that the wiring is as per relevant drawing. All interconnections between panels/equipment shall be similarly checked.

- 1.23.5.3 All the wires shall be meggered to earth.
- 1.23.5.4 Functional checking of all control circuit e.g. closing, tripping control, interlock, supervision and alarm circuit.
- 1.23.6 **Relays**
- 1.23.6.1 Check connections and wiring.
- 1.23.6.2 Megger all terminals to body.
- 1.23.6.3 Megger AC to DC terminals.
- 1.23.6.4 Check operating characteristics by secondary injection.
- 1.23.6.5 Check minimum pick up voltage of DC coils.
- 1.23.6.6 Check operation of electrical/mechanical targets.
- 1.23.6.7 Relays settings.
- 1.23.6.8 Check CT and VT connections with particular reference to their polarities for directional relays, wherever required.
- 1.23.7 **Meters**
- 1.23.7.1 Check calibration by comparing it with a sub-standard.
- 1.23.7.2 Megger all insulated portions.
- 1.23.7.3 Check CT and VT connections with particular reference to their polarities for power type meters.
- 1.24 **SPECIAL TOOLS AND TACKLES**
- 1.24.1 The Bidder shall include in his proposal any special tools and tackles required for erection, testing commissioning and maintenance of the equipments offered.
- 1.24.2 The list of these special tools and tackles shall be given in the bid proposal sheets alongwith their respective prices.
- 1.24.3 The total price of the special tools and tackles shall be included in proposal sheets.
- 1.25 **EQUIPMENT TO BE FURNISHED**
- 1.25.1 The Bidder shall quote for various AC/DC distribution boards in accordance with this specification.
- 1.25.2 Standard scheme of interconnection of switchboards and distribution boards alongwith tentative feeder disposition for each board is indicated in Standard SLD of AC & DC system enclosed alongwith bid documents. The bidder shall quote board prices on the basis of standard SLD and their estimation of feeders for entire present and future bays

requirement. Any other feeder required as per system requirement for efficient and reliable operation shall be deemed to be included in bidder's scope.

1.25.3 The Bill of Materials for each type of module shall be as under. These are minimum indicative requirement of the system. The necessary auxiliary relays, push buttons and indicating lamps shall be provided as per scheme requirement. Any other item/component required with in a module for efficient and reliable operation shall be deemed to be included in bidder's scope.

1.25.4 Module Type AE (Electrically controlled circuit breaker for incoming and Bus Coupler Circuit).

- (i) One (1) Triple pole air circuit breaker complete with all accessories and power operated mechanism as specified.
- (ii) Two (2) Neutral link.
- (iii) Three (3) Current Transformer for metering.
- (iv) One (1) Ammeter with selector switch.
- (v) Three (3) Current Transformer for relaying.
- (vi) One (1) Triple pole instantaneous over-current relay having the setting range of 200-800% or 500-2000% of CT secondary and adjustable definite minimum time.
- (vii) One (1) Instantaneous earth fault relay having an adjustable setting range of 10-40% or 20 - 80% of CT secondary current and adjustable definite minimum time. The earth fault relay shall be provided with a stabilising resistor.
- (viii) One(1) set Current and Voltage transducers.*
- (ix) One(1) set High speed tripping relays.*

1.25.5 **Module Type - M1 (Circuit Breaker Controlled Motor Feeder)**

- (i) One (1) Triple pole Air Circuit Breaker complete with accessories, and power operated mechanism as specified.
- (ii) One (1) Three position 6 pole selector switch  
'SWITCHGEAR/NORMAL /TRIAL'.
- (iii) Three (3) Current Transformer for metering.
- (iv) One (1) Ammeter with Ammeter Selector Switch
- (v) Three (3) Current Transformer for relaying.
- (vi) One (1) Triple pole instantaneous over-current relay for providing positive sequence current protection in all the three phases. The relay setting range shall be continuously adjustable between 200-800% or 400-1600% of CT secondary rated current as required.

- (vii) One (1) Double pole inverse definite minimum time over current relays connected in R & B phases for over current protection of motor rated 110 kW - 200 kW. The relay shall have an adjustable setting range of 50% - 200% of CT Secondary current and time setting range of 0-30 Second. The relay shall be CDGM-22 of EE or equivalent.
- (viii) One (1) Single pole adjustable definite time delay relay for motor overload alarm connected in Y-phase only. The relay shall have resetting ratio of not less than 90%. The relay shall have continuously adjustable time delay range of 2.5 to 25 Sec.
- (ix) One (1) Instantaneous earth fault relay having an adjustable setting range of 10-40% or 20-80% of CT secondary current. The earth fault relay shall be provided with a stabilising resistor.
- (x) **One(1) set** *Current and Voltage transducers.*
- (xi) **One(1) set** *High speed tripping relay.*

1.25.6 **Module Type E**

- (i) One (1) Four pole MCCB

1.25.7 **Module G-1 (VT Module with under Voltage Relay)**

- (i) Three (3)  $\frac{415}{\sqrt{3}} / \frac{110}{\sqrt{3}}$  volts single phase voltage transformer star/star connect with star point solidly earthed mounted on common draw out chassis. Accuracy Class 0.5 for protection and metering with 50VA Burden.
- (ii) Six (6) HRC Fuses mounted on the above chassis.
- (iii) One (1) Four position voltmeter selector switch.
- (iv) One (1) Voltmeter (0-500V)
- (v) One (1) Double pole instantaneous under voltage relays with continuous variable setting range of 40-80% of 110 Volts.
- (vi) One (1) Time delay pick up relay having a time setting range of 0.5 to 3 secs. with 3 'NO'. Self reset contacts, suitable for 220V DC.
- (vii) One (1) Auxiliary relay 220V DC with 2 NO. self reset contacts.
- (viii) Three (3) Indicating lamps with series resistor and colour lenses (Red, Blue & Yellow).

1.25.8 **Module Type G-2**

- (i) Three (3) HRC Fuse
- (ii) One (1) Voltmeter (0-500V)
- (iii) One (1) Voltmeter selector switch four position (R-Y, Y-B, B-R OFF).
- (iv) Three (3) Indication lamps (Red, Blue & Yellow)

1.25.9 **Module Type H & H (BC) (Isolating Switch Controlled Incoming Circuit)**

- (i) One (1) Four pole MCCB
- (ii) One (1) Red Indicating lamp to indicate isolating switch closed position.

1.25.10 **Module Type S : (DC Metering and Protection Module)**

- (i) One (1) Voltmeter 300-0-300V DC for 220V DC DB/Voltmeter 0-75V DC for 50V DCDB
- (ii) One (1) Three (3) position voltmeter selector switch
- (iii) One (1) Instantaneous under voltage relay with 95% of 220V DC. The resetting ratio of relay of relay should not be more than 1.25. The relay shall be provided with a series resistor and a push button across if for resetting (pick up) the relay at about 105% of the drop out voltage.
- (iv) One (1) Instantaneous over voltage relay with setting range of 110% of 220V DC. The resetting ratio of relay should not be less than 0.8. The relay shall have a push button in series of resetting the relay at about 95% of the operating voltage.
- (v) One (1) Earth leakage relay only for 220V DC system having adjustable pick up range between 3 to 7 milliamps the relay shall be suitable for 220V DC/240V AC Auxiliary supply.

1.25.11 **Module Type X**

- One (1) Double pole 250 V MCB

1.25.12 **Module Type-DC (Incomer from Battery & Chargers)**

- (i) One (1) Double pole 250V DC MCCB for incomer from Battery.
- (ii) One (1) DC ammeter with shunt and range of 90-0-400 Amps. For 220V DC DB and 90-0-200 Amp for 50V DC DB.
- (iii) Two (2) Double pole 250V DC MCCB/MCB
- (iv) One (1) Double pole single throw 250V DC air break switch connecting battery & charger sections to DC DB.

(v) **One(1) set Voltage and Current Transducers**

1.25.13 **Module Type DG-1 (Electrically Controlled Circuit Breaker for Incomer from DG Set)**

- a) One (1) Triple pole circuit breaker complete with all accessories and power operated mechanism as specified.
- b) One (1) Frequency meter.
- c) One (1) Voltmeter with selector switch.
- d) One (1) Remote/Local Selector switch.
- e) Three (3) Current transformer for metering.
- f) Six (6) Current Transformers for differential protection (out of this 3 Nos. will be supplied loose for mounting in DG set panel).
- g) Three (3) Current transformer for relaying.
- h) One (1) Ammeter Selector Switch.
- i) One (1) Ammeter
- j) One (1) Wattmeter of range 0-300 KW.
- k) One (1) Three pole voltage controlled definite time delay relay having current setting range of 50-200% of CT secondary current and adjustable time delay 0.3 to 3 secs.
- l) One (1) Watt hour meter with six (6) digits and minimum count of one (1) kwh.
- m) One (1) Single pole definite time over current relay having a continuous setting range of 50-200% of CT secondary current and a time delay of 2.5-25 secs connected in CT of Y phase for overload alarm. The relay shall have a setting ratio of not less than 90%.
- n) One (1) Three pole differential protection relay having an operating current setting range of 10-40% of generator full load current. The relay shall be of high impedance type, with necessary stabilizing resistors.
- o) Two (2) Push buttons for Remote starting & stopping of DG Set (Red, Green).
- p) **One(1) set Current and Voltage transducers.**
- q) **One(1) set High speed tripping relays.**

1.25.14 **Module Type H1**  
One (1) Double pole DC Switch with pad locking facility in off position.

1.25.15 **Module Type EL**

- (i) One (1) Four pole MCCB
- (ii) One (1) Contactor
- (iii) Electronic Timer suitable for continuous operation, push button and selector switch be as per scheme requirement

1.26 **PARAMETERS**

1.26.1 **Power Supply**

1.26.1.1 AC System 3 phase, 4 wire, solidly earthed

- a) Voltage 415 Volts,  $\pm 10\%$
- b) Frequency 50 Hz  $\pm 5\%$
- c) Combined variation  $\pm 10\%$  Absolute Sum in Voltage & frequency
- d) Fault Level 20 kA (rms)

1.26.1.2 **DC System** 2 Wire, unearthed

- a) System voltage 220V  $\pm 10\%$
- b) Fault Level 4 kA
- c) System Voltage **48** V  $\pm 10\%$
- d) Fault Level --

1.26.2 **Control Supply Voltage**

- a) Trip and closing coils 220V DC Unearthed
- b) Spring charging 220V DC Unearthed

1.26.3 **Cubicle Data**

1.26.3.1 **Busbar Rating**

- a) Continuous As specified in *Standard SLD*

	for Vertical panels.	<i>For AC &amp; DC system.</i>
b)	Short time (1 sec. kA (rms))	20 kA
c)	Momentary (kA) PEAK	45 kA
d)	<b>Ambient Temperature</b>	<b>50°C</b>
e)	<b>One Minute Power Frequency Withstand</b>	
	I. Power Circuit	2500 Volts (rms)
	II. Control Circuit	2500 Volts (rms)

#### 1.26.3.2 **Cubicle Colour Finish**

a)	Interior	Smoke Grey shade No.692 of IS:5
b)	Exterior	Smoke Grey shade No.692 of IS:5

#### 1.26.4 **Circuit Breaker**

a)	Type	Air Break
b)	No. of poles	3
c)	Voltage & Frequency	415 ± 10%, 50 HZ + 5%
d)	Rated Operating Duty	As per IS
e)	Rated service short-circuit Breaking capacity (Ics)	20 kA (RMS)
f)	Short Circuit making current	45 kA (Peak)
g)	Short time withstand current for 1 sec. duration.	20 kA (RMS) for 1 sec.
h)	Operating Mechanism current for 1 sec. duration.	20 kA (RMS) for 1 sec.
i)	No. of auxiliary contacts	4 NO & 4 NC contacts for Purchaser's use on fixed portion of the cubicle
j)	Short Circuit breaking current	
	I. AC Component	20 kA (RMS)
	II. DC Component	As per IS: 13947 (Part 2)

1.26.5		<b>MOULDED CASE CIRCUIT BREAKER</b>	
		AC System	DC System
a)	No. of poles	4	2
b)	Voltage & Frequency	415 ± 10%, 50 HZ ± 5%	250V
c)	Rated Operating Duty	As per IS	
d)	Rated service short-circuit Breaking capacity (Ics)	20 kA (RMS)	4 kA
e)	Short Circuit making current	45 kA (Peak)	-
f)	No. of auxiliary Contacts ( <i>only for incomer And bus-coupler MCCBs</i> )	1 NO & 1 NC	1 NO & 1 NC
g)	<b>Rated Ultimate Short Circuit breaking capacity</b>		
	I. AC Component	20 kA (RMS)	As per IS
	II. DC Component	As per IS 13947	As per IS 13947

1.26.6 **Meters**

a)	Accuracy class	2.5
b)	One minute power frequency withstand test voltage in KV	2.0

1.26.7 **Current Transformers**

a)	Type	Cast resin, Bar primary
b)	Voltage class and frequency	650V, 50 Hz
c)	Class of Insulation	E or better
d)	Accuracy class metering CT	Class 1, VA adequate for application but not less than 7.5 VA.
e)	Accuracy class protection CT	5 P 15, VA adequate for application, but not less than 7.5 VA.
f)	Accuracy class differential protection	PS, KPV = 300V

- g) Short Time Current Rating  
(for CTs Associated with  
circuit breakers)
- |      |  |              |
|------|--|--------------|
| I.   | Current  | 20 kA (RMS)  |
| II.  | Duration   | One Second   |
| III. | Dynamic Rating   | 45 kA (Peak) |
| IV.  | One minute power<br>frequency withstand<br>test voltage. | 2.5 kV (rms) |

1.26.8 **Voltage Transformer**

- |    |  |                                   |
|----|--|-----------------------------------|
| a) | Type   | Cast Resin                        |
| b) | Rated Voltage                                      |                                   |
|    | Primary  | 415/ $\sqrt{3}$ V                 |
|    | Secondary  | 110/ $\sqrt{3}$ V                 |
| c) | Method of connection                               |                                   |
|    | Primary  | Star                              |
|    | Secondary  | Star                              |
| d) | Rated voltage factor                               | 1.1 continuous, 1.5 for 3 seconds |
| e) | Class of insulation                                | E or better                       |
| f) | One minute power<br>frequency withstand<br>voltage | 2.5 KV (RMS)                      |
| g) | Accuracy class                                     | 0.5, not less than 20VA           |

1.26.9 **Relay**

- |    |  |            |
|----|--|------------|
| a) | One minute power<br>Frequency withstand test | 2 kV (rms) |
|----|--|------------|

1.26.10 **Transducers (1 phase)**

	<b>Current</b>	<b>Voltage</b>
<b>a) Operating Voltage</b>	<b>220 V DC</b>	<b>220V DC</b>
<b>b) I/P</b>	<b>1A.</b>	<b>110V AC</b>
<b>c) O/P</b>	<b>4-20 mA</b>	<b>4-20 mA</b>
<b>d) Type</b>	<b>Analogue</b>	<b>Analogue</b>

### 1.26.11 *Lighting Transformers*

*Lighting transformers shall be of 300 KVA rating ( in case of substations where highest voltage is 765 kV)/ 100 KVA rating ( in case of substations where highest voltage is 400 kV)/ 25 KVA rating (in case of substations where highest voltage level is 132kV), 415/415 V, 3 phase, 50 Hz Dry type natural air cooled **type**. The technical parameters of these lighting transformers are as follows:*

#### Technical Parameters of Lighting Transformer

Type of transformer	:	Dry type natural air cooled
Rating	:	<b>300 KVA</b> , 100 KVA or 25 KVA (as applicable)
Voltage ratio	:	415/415 volts
No. of phases	:	Three
Frequency	:	50 Hz
Winding connection	:	Dyn-1
Class of insulation	:	'B' class
Impedance	:	4% $\pm$ 10%
No. of taps & steps	:	5, $\pm$ 5% in steps of 2.5%
Ref. standard	:	IS:2026

### 1.27 **AUTOMATIC CONTROL OF OUTDOOR LIGHTING**

1.27.1 EL-type module of 415V Main lighting distribution board and Emergency lighting distribution board and shall be controlled by timer and contactor module to facilitate its operation automatically.

### 1.28 **AUTOMATIC SUPPLY CHANGEOVER**

Automatic changeover between Incomer I, Incomer II, and DG set is to be carried out during the failure of supply in one/or both the incomers. After the restoration of the supply, system shall be restored to normal condition automatically. The requirement of changeover under various conditions are as below:

- (i) Under normal conditions i.e. when supply is available in both the incomers, incomers I&II of 415 V Main switchboard, ACDB shall be in closed condition and Bus couplers and DG set breaker shall be in open condition.
- (ii) In case of failure of either of the sources, the incomer of that source shall trip and Bus coupler shall get closed. On restoration of supply, normal conditions described above are to be established automatically.
- iii) In case of failure of supply in both the sources, both incomers, incomers of ACDBs and ACDB Bus coupler shall trip and DG set breaker switched on. On restoration of one or both sources, DG set breaker shall trip, DG set stopped and conditions described in paragraph (i)/(ii) shall be restored.

To avoid unnecessary operation of switchgear for momentary disturbances all changeovers from one state to another shall be initiated after a time delay, after the conditions warranting such change has been detected.

### **1.29 ANALOGUE INPUTS**

*LT System shall have provision of following analogue inputs for owner's substation automation purpose. These analogue inputs shall be generated by distinct transducers to be provided in respective modules. These inputs shall be wired up to respective terminal blocks.*

#### **ANALOGUE INPUTS:**

- i) Voltage R-Y, Y-B, B-R of Main Switch Board section-I*
- ii) Voltage R-Y, Y-B, B-R of Main Switch Board section-II*
- iii) Current from LT transformer-I*
- iv) Current from LT transformer-II*
- v) Voltage of 220V DCDB-I*
- vi) Voltage of 220V DCDB-II*
- vii) Current from 220V Battery set-I*
- viii) Current from 220V Battery set-II*
- ix) Voltage of 48V DCDB-I*
- x) Voltage of 48V DCDB-II*
- xi) Current from 48V Battery set-I*
- xii) Current from 48V Battery set-II*

### **1.30 DIGITAL (Potential Free) INPUTS:**

*LT System shall have provision of following digital inputs for owner's substation automation purpose. These digital inputs shall be made available in the form of potential free contacts to be provided in respective modules. These potential free contacts shall be wired up to respective terminal blocks.*

- i) Main (MSB) Incomer-I breaker On/Off*
- ii) Main (MSB) Incomer-II breaker On/Off*
- iii) Main(MSB) 415V Bus-I/II U/V*
- iv) Main (MSB) bus coupler breaker on/off*
- v) DG set breaker on/off*
- vi) LT transformer-I Buchholz Alarm & trip*
- vii) LT transformer-II Buchholz Alarm & trip*
- viii) LT transformer-I WTI Alarm & trip*
- ix) LT transformer-II WTI Alarm & trip*
- x) LT transformer-I OTI Alarm & trip*
- xi) LT transformer-II OTI Alarm & trip*
- xii) 220 V DC-I earth fault*
- xiii) 220V DC-II earth fault*



BHARAT HEAVY ELECTRICALS LIMITED  
TRANSMISSION BUSINESS ENGINEERING MANAGEMENT

COPYRIGHT AND CONFIDENTIALITY

The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.  
It must not be used directly or indirectly in anyway detrimental to the interest of the company

DOCUMENT No.	<b>TB-418-316-000</b>	Rev. No.	<b>00</b>	Prepared	Checked	Approved		
TYPE OF DOC.	<b>TECHNICAL SPECIFICATION</b>			SIGN	<i>Satyaki Chaudhary</i>	<i>Vijay</i> <i>Sankar</i>		
TITLE	<b>GENERAL TECHNICAL REQUIREMENTS-SECTION 3</b>			NAME	SC	NK	SKS	
				DATE	15.10.22	15.10.22	15.10.22	
				GROUP	TBEM	W.O.	Awaited	
CUSTOMER	Powergrid Corporation of India Ltd. (POWERGRID)							
PROJECT	Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route							
NOA NO.	TBCB/Neemuch REZ/400kV AIS/SS01/G5/NOA-I/05 dtd. 23/09/2022 & TBCB/Neemuch REZ/400kV AIS/SS01/G5/NOA-II/06 dtd. 23/09/2022							
Station	400/220kV AIS Neemuch New S/S, Madhya Pradesh Extension of 400kV Chittorgarh S/S, Rajasthan Extension of 400kV Mandsaur S/S , Madhya Pradesh							
<b>S.No.</b>	<b>Description</b>					<b>Sheet</b>		
1	General Technical Requirements – Site Information					2,3		
2	General Technical Requirements					4-32		
3	Annexure -A					2 Sheets		
4	Annexure -B					1 Sheets		
5	Annexure -C					23 Sheets		
6	Annexure -G					6 Sheets		
7	Annexure -K					2 Sheets		
RevNo.	Date	Altered	Checked	Approved	REVISION DETAILS			
Distribution				To	TBEM	TBMM	TBQM	Supplier
				Copies	1	1	1	4



Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.

General Technical Requirements- Section 3

Doc. No. : TB-418-316-000 Rev 00

## GENERAL TECHNICAL REQUIREMENTS-SECTION 3

### Site Information

S.No.	Particular	Details
a)	Owner	Neemuch Transmission Limited - a 100% wholly owned subsidiary of Power Grid Corporation of India Limited
b)	Customer	Neemuch Transmission Limited - a 100% wholly owned subsidiary of Power Grid Corporation of India Limited
c)	Project Title	Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route
d)	Location	Neemuch, MP Chittorgarh, Rajasthan Mandsaur, MP
e)	Transport Facilities	Road/Train Nearest Rail Head For Neemuch: Neemuch Nearest Rail Head For Chittorgarh: Chittorgarh Nearest Rail Head For Mandsaur: Mandsaur Nearest Airport : Udaipur
SITE CONDITIONS		
a)	Max. ambient air temp.	50°C
b)	Min. ambient air temp.	0°C
c)	Max. design ambient temp.	50°C
d)	Design reference temp.	50°C
e)	Average Humidity	Max. 100%
f)	Special corrosion conditions	No
g)	Solar Radiation	2 kW/sqmtr
h)	Atmospheric UV radiation	High
i)	Altitude above sea level	Less than 1000 meter above mean sea level (MSL)
j)	Pollution Severity	High Pollution level



Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.

General Technical Requirements- Section 3

Doc. No. : TB-418-316-000 Rev 00

k)	Seismic Zone	Zone-II
<b>WIND DATA</b>		
	Wind Zone	47m/sec
	Average No. of thunderstorm days per annum	As per IS
Main Electrical Parameters:		
	Fault Levels:	400kV: 63kA for 1 sec. 220kV : 50kA for 1 sec.
	Creepage Distance	25mm/kV for All Equipment i.e BPI/Bushings, CB, Isolator, CT, CVT, LA, WT etc. 31mm/kV for string insulators



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

## **GENERAL TECHNICAL REQUIREMENTS-SECTION 3**

### **1.0 FOREWORD**

The provisions under this section are intended to supplement requirements for the materials, equipment's and services covered under other sections of tender documents and are not exclusive.

The Supplier shall note that the standards mentioned herein are not mutually exclusive or complete in themselves, but are intended to complement each other, with minimum repetition, to define the requirements of the Specification. In the event of a conflict between requirements of any two clauses of the Specification/ documents or requirements of different codes/ standards specified, the more stringent requirement as per the interpretation of the owner shall apply, unless confirmed otherwise by the owner in writing based on a written request from the Supplier.

In case of conflicting requirements between this document (General Technical Requirement Section 3) and equipment specification (Section 1 & Section 2), equipment specification shall prevail.

When specific requirements stipulated in the Specification exceed or change those required by the applicable standards, the stipulations of the Specification shall take precedence.

Unless specifically agreed to by the Purchaser prior to Award of Contract, the Work shall be in accordance with the standards indicated and the requirements of the Specification. The Supplier shall be held responsible for any deviation.

In case of conflict between the various standards, the decision of owner shall be binding & final.

The following words and expressions shall have the meanings hereby assigned to them throughout this document

"Employer/Owner" means Power Grid Corporation of India Ltd.

"Purchaser" means Bharat Heavy Electricals Limited

"Supplier/Manufacturer/Bidder" means the person or persons, firm or company assigned to execute the works as defined by the scope of supply, described here.

"Specification" refers to this document.

The supplier should be approved by Power Grid. If not, it is the responsibility of the vendor to be assessed and approved by Power Grid, before placement of order by BHEL. Any cost involved in vendor assessment/approval must be borne by the vendor himself.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**2.0 GENERAL REQUIREMENT**

2.1 a) All equipment/materials/items, as per Annexure-K, as applicable under present scope of works, shall be supplied by domestic manufacturers only.

Any imported equipment/material/item/parts/component (comprising of embedded systems) to be supplied under the contract shall be tested in the certified laboratories to check for any kind of embedded malware/trojans/cyber threats and for adherence to Indian Standards as per the directions issued by Ministry of Power/Govt. of India from time to time. In case of such import from specified "prior reference" countries, the requirement of prior permission from the Govt. of India including protocol for testing in certified and designated laboratories by Ministry of Power/Govt. of India shall also be complied with by the Bidder.

The bidder/contractor shall list out the products and components producing Toxic e-waste under the contract and shall furnish to the Employer the procedure of safe disposal at the time of closing of the contract.

2.1 b) The Supplier/Manufacturer shall furnish catalogues, engineering data, technical information, design documents, drawings etc., fully in conformity with the technical specification during detailed engineering.

2.2 It is recognised that the Bidder may have standardised on the use of certain components, materials, processes or procedures different from those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered provided such proposals meet the specified designs, standard and performance requirements and are acceptable to Employer.

2.3 Wherever a material or article is specified or defined by the name of a particular brand, Manufacturer or Vendor, the specific name mentioned shall be understood as establishing type, function and quality and not as limiting competition.

2.4 Equipment furnished shall be complete in every respect with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or needed for erection, completion and safe operation of the equipment as required by applicable codes though they may not have been specifically detailed in the Technical Specifications unless included in the list of exclusions. Materials and components which are minor in nature and incidental to the requirement but not specifically stated in the specification, which are necessary for commissioning and satisfactory operation of the switchyard/ substation unless specifically excluded shall be deemed to be included in the scope of the specification and shall be supplied without any extra cost. All similar standard components/parts of similar standard equipment provided, shall be interchangeable with one another.

2.5 Deleted.

2.6 Deleted.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**3.0 STANDARDS**

- 3.1 The works covered by the specification shall be designed, engineered, manufactured, built, tested and commissioned in accordance with the Acts, Rules, Laws and Regulations of India.
- 3.2 The equipment offered by the Bidder shall at least conform to the requirements specified under relevant IS standard. In case of discrepancy between IS and other international standard, provisions of IS shall prevail. The Bidder shall also note that the list of standards presented in Annexure-C is not complete. Whenever necessary, the list of standards shall be considered in conjunction with specific IS. If the IS standard is not available for an equipment/material, then other applicable International standard (IEC/Equivalent), as per the specification, shall be accepted.
- 3.3 The Bidder shall note that standards mentioned in the specification are not mutually exclusive or complete in themselves, but intended to complement each other.
- 3.4 When the specific requirements stipulated in the specifications exceed or differ than those required by the applicable standards, the stipulation of the specification shall take precedence.
- 3.5 Other internationally accepted standards which ensure equivalent or better performance than that specified in the standards specified under Annexure-C / individual sections for various equipments shall also, be accepted, however the salient points of difference shall be clearly brought out during detailed engineering along with English language version of such standard. The equipment conforming to standards other than specified under Annexure-C /individual sections for various equipments shall be subject to Employer's approval.

**4.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT BEING FURNISHED**

- 4.1 Switching surge over voltage and power frequency over voltage is specified in the system parameters below. In case of the 400kV system, the initial value of the temporary overvoltages could be 2.0 p.u. for 1-2 cycles. The equipment furnished under this specification shall perform all its functions and operate satisfactorily without showing undue strain, restriking etc under such over voltage conditions.
- 4.2 All equipments shall also perform satisfactorily under various other electrical, electromechanical and meteorological conditions of the site of installation.
- 4.3 All equipment shall be able to withstand all external and internal mechanical, thermal and electromechanical forces due to various factors like wind load, temperature variation, ice & snow, (wherever applicable) short circuit etc. for the equipment.
- 4.4 The Bidder shall design terminal connectors of the equipment taking into account various forces as above at Sl.No.4.3 that are required to withstand.
- 4.5 The equipment shall also comply to the following:
  - a) To facilitate erection of equipment, all items to be assembled at site shall be "match marked".
  - b) All piping, if any between equipment control cabinet/operating mechanism to marshalling box of the equipment, shall bear proper identification to facilitate the connection at site.



Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.

General Technical Requirements- Section 3

Doc. No. : TB-418-316-000 Rev 00

#### 4.6 System Parameter

##### 400kV & 220kV System

SL No	Description of parameters	400kV System	220kV System
1.	System operating voltage	400kV	220kV
2.	Maximum operating voltage of the system (rms)	420kV	245kV
3.	Rated frequency	50Hz	50Hz
4.	No. of phase	3	3
5.	Rated Insulation levels		
i)	Full wave impulse withstand voltage (1.2/50 microsec.)	1550kVp	1050 kVp
ii)	Switching impulse withstand voltage (250/2500 micro sec.) dry and wet	1050kVp	-
iii)	One minute power frequency dry withstand voltage (rms)	630kV	-
iv)	One minute power frequency dry and wet withstand voltage (rms)	-	460kV
6.	Corona extinction voltage	320kV	-
7.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	1000 $\mu$ V at 266kV rms	1000 $\mu$ V at 156kV rms
8.	Minimum creepage distance - for Equipment other than Insulator string	10500 mm	6125 mm
	Minimum creepage distance - for Insulator String	13020 mm	7595 mm
9.	Min. clearances		



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

i.	Phase to phase	4000mm (for conductor conductor configuration) 4200mm (for rod - conductor configuration)	2100 mm
ii.	Phase to earth	3500 mm	2100 mm
iii)	Sectional clearances	6500 mm	5000 mm
10.	Rated short circuit current for 1 sec. duration	63 kA	50kA
11.	System neutral earthing	Effectively earthed	Effectively earthed

**66kV, 52kV, 33kV System**

SL No	Description of parameters	66kV System	52 kV System	33 kV System
1.	System operating voltage	66kV	52kV	33kV
2.	Maximum operating voltage of the system(rms)	72.5kV	52kV	36kV
3.	Rated frequency	50Hz	50Hz	50Hz
4.	No. of phase	3	3	3
5.				
i)	Full wave impulse withstand voltage (1.2/50 microsec.)	325 kVp	250 kVp	170 kVp
ii)	One minute power frequency dry and wet withstand voltage (rms)	140kV	95kV	70kV



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

6.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	-	-	-
7.	Minimum creepage distance	1813 mm (2248mm for coastal area)	1300mm (1612 mm for coastal area)	900 mm (1116m m for coastal area)
8.	Min. Clearance			
i.	Phase to phase	750 mm	530mm	320 mm
ii.	Phase to earth	630 mm	480mm	320 mm
iii.	Sectional clearances	3100 mm	3100mm	2800 mm
9.	Rated short circuit current	25kA for 3 Sec*	25kA for 1 Sec	25 kA for 3 sec
10.	System neutral earthing	Effectively earthed	Effectively earthed	Effectively earthed

Notes:

1. The above parameters are applicable for installations up to an altitude of 1000m above mean sea level. For altitude exceeding 1000m, necessary altitude correction factor shall be applicable as per relevant IEC/IS.
2. The insulation and RIV levels of the equipments shall be as per values given in the Technical Specification of respective equipment.
3. Corona and radio interference voltage test and seismic withstand test procedures for equipments shall be in line with the procedure given at **Annexure-A** and **Annexure-B** respectively.
4. "\*" For tertiary loading Equipment's fault level shall be 25kA for 3 Sec.

## 5.0 ENGINEERING DATA AND DRAWINGS

5.1 Deleted.

5.2 Deleted.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**5.3 Drawings**

- 5.3.1 All drawings submitted by the Bidder shall be in sufficient detail to indicate the type, size, arrangement, material description, Bill of Materials, weight of each component, break-up for packing and shipment, dimensions, internal & the external connections, fixing arrangement required and any other information specifically requested in the specifications.
- 5.3.2 Drawings submitted by the Bidder shall be clearly marked with the name of the Employer, the unit designation, the specifications title, the specification number and the name of the Project. POWERGRID has standardized a large number of drawings/documents of various make including type test reports which can be used for all projects having similar requirements and in such cases no project specific approval (except for list of applicable drawings alongwith type test reports) is required. However, distribution copies of standard drawings/documents shall be submitted as per provision of the contract. All titles, noting, markings and writings on the drawing shall be in English. All the dimensions should be in SI units.
- 5.3.3 The review of these data by the Employer will cover only general conformance of the data to the specifications and documents, interfaces with the equipment provided under the specifications, external connections and of the dimensions which might affect substation layout. This review by the Employer may not indicate a thorough review of all dimensions, quantities and details of the equipment, materials, any devices or items indicated or the accuracy of the information submitted. This review and/or approval by the Employer shall not be considered by the Contractor, as limiting any of his responsibilities and liabilities for mistakes and deviations from the requirements, specified under these specifications and documents.
- 5.5 All manufacturing and fabrication work in connection with the equipment prior to the approval of the drawings shall be at the Bidder's risk. The Bidder may make any changes in the design which are necessary to make the equipment conform to the provisions and intent of the Contract and such changes will again be subject to approval by the Employer. Approval of Bidder's drawing or work by the Employer shall not relieve the bidder of any of his responsibilities and liabilities under the Contract.
- 5.6 All engineering data submitted by the Bidder after final process including review and approval by the Employer shall form part of the Contract Document and the entire works performed under these specifications shall be performed in strict conformity, unless otherwise expressly requested by the Employer in Writing.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**5.7 Approval Procedure**

The following schedule shall be followed generally for approval and for providing final documentation.

- |      |  |   |
|------|--|---|
| i)   | Approval/comments/ by Employer on initial submission   | 15 days   |
| ii)  | Resubmission (whenever required)   | Within 3 (three) weeks from date of comments      |
| iii) | Approval or comments   | Within 3 (three) weeks of receipt of resubmission |
| iv)  | Furnishing of distribution copies (2 hard copies to each substation and one scanned copy (pdf format)                                      | Within 3 (three) weeks of receipt of resubmission |
| v)   | Furnishing of distribution copies of test reports  |   |
|      | a) Type test reports (one scanned softcopy in pdf format to each substation plus one for corporate centre & one hardcopy per substation)   | 2 weeks from the date of final approval           |
|      | b) Routine Test Reports (one copy for each substation)   | -do-  |
| vi)  | Furnishing of instruction/ operation manuals (2 copies per substation and one softcopy (pdf format) for corporate centre & per substation) | On completion of Engineering                      |



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- |      |   |                               |
|------|---|-------------------------------|
| vii) | As built drawings (two sets of hardcopy per substation & one softcopy (pdf format) for corporate centre & per substation) | On completion of entire works |
|------|---|-------------------------------|

**NOTE :**

- (1) The bidder may please note that all resubmissions must incorporate all comments given in the earlier submission by the Employer or adequate justification for not incorporating the same must be submitted failing which the submission of documents is likely to be returned.
- (2) Deleted.
- (3) The instruction Manuals shall contain full details of drawings of all equipment being supplied under this contract, their exploded diagrams with complete instructions for storage, handling, erection, commissioning, testing, operation, trouble shooting, servicing and overhauling procedures.
- (4) If after the commissioning and initial operation of the substation, the instruction manuals require any modifications/additions/changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer.
- (5) The Bidder shall furnish to the Employer catalogues of spare parts.
- (6) Deleted.
- 5.8 Deleted.

**6.0 MATERIAL/ WORKMANSHIP**

**6.1 General Requirement**

- 6.1.1 Where the specification does not contain references to workmanship, equipment, materials and components of the covered equipment, it is essential that the same must be new, of highest grade of the best quality of their kind, conforming to best engineering practice and suitable for the purpose for which they are intended.
- 6.1.2 In case where the equipment, materials or components are indicated in the specification as "similar" to any special standard, the Employer shall decide upon the question of similarity. When required by the specification or when required by the Employer the Contractor shall submit, for approval, all the information concerning the materials or components to be used in manufacture. Machinery, equipment, materials and components supplied, installed or used without such approval shall run the risk of subsequent rejection, it is to be understood that the cost as well as the time delay associated with the rejection shall be borne by the Bidder.
- 6.1.3 The design of the Works shall be such that installation, future expansions, replacements and general maintenance may be undertaken with a minimum of time and expenses. Each component shall be designed to be consistent with its duty and suitable factors of safety, subject to mutual agreements. All joints and fastenings shall be devised, constructed and documented so that the component parts shall be accurately positioned and restrained to fulfil their required function. In general, screw threads shall be standard metric threads. The use of other thread forms will only be permitted when prior approval has been obtained from the Employer.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 6.1.4 Whenever possible, all similar part of the Works shall be made to gauge and shall also be made interchangeable with similar parts. All spare parts shall also be interchangeable and shall be made of the same materials and workmanship as the corresponding parts of the Equipment supplied under the Specification. Where feasible, common component units shall be employed in different pieces of equipment in order to minimize spare parts stocking requirements. All equipment of the same type and rating shall be physically and electrically interchangeable.
- 6.1.5 Deleted.
- 6.1.6 The Bidder shall apply oil and grease of the proper specification to suit the machinery, as is necessary for the installation of the equipment. Lubricants used for installation purposes shall be drained out and the system flushed through where necessary for applying the lubricant required for operation. The Bidder shall apply all operational lubricants to the equipment installed by him.
- 6.1.7 All oil, grease and other consumables used in the Works/Equipment shall be purchased in India unless the Bidder has any special requirement for the specific application of a type of oil or grease not available in India. If such is the case, he shall declare source of oil/grease /other consumables in the GTP/Drawings, where such oil or grease is available. He shall help Employer in establishing equivalent Indian make and Indian Contractor. The same shall be applicable to other consumables too.
- 6.2 Provisions For Exposure to Hot and Humid climate**
- Outdoor equipment supplied under the specification shall be suitable for service and storage under tropical conditions of high temperature, high humidity, heavy rainfall and environment favourable to the growth of fungi and mildew. The indoor equipments located in non-air conditioned areas shall also be of same type.
- 6.2.1 Space Heaters**
- 6.2.1.1 The heaters shall be suitable for continuous operation at 240V as supply voltage. Onoff switch and fuse shall be provided.
- 6.2.1.2 One or more adequately rated thermostatically connected heaters shall be supplied to prevent condensation in any compartment. The heaters shall be installed in the compartment and electrical connections shall be made sufficiently away from below the heaters to minimize deterioration of supply wire insulation. The heaters shall be suitable to maintain the compartment temperature to prevent condensation.
- 6.2.2 FUNGI STATIC VARNISH**
- Besides the space heaters, special moisture and fungus resistant varnish shall be applied on parts which may be subjected or predisposed to the formation of fungi due to the presence or deposit of nutrient substances. The varnish shall not be applied to any surface of part where the treatment will interfere with the operation or performance of the equipment. Such surfaces or parts shall be protected against the application of the varnish.
- 6.2.3 Ventilation opening**
- Wherever ventilation is provided, the compartments shall have ventilation openings with fine wire mesh of brass to prevent the entry of insects and to reduce to a minimum the entry of dirt and dust.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**6.2.4 Degree of Protection**

The enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc. to be installed shall comply with following degree of protection as detailed here under:

- a) Installed out door: IP- 55
- b) Installed indoor in air conditioned area: IP-31
- c) Installed in covered area: IP-52
- d) Installed indoor in non-air conditioned area where possibility of entry of water is limited: IP-41.
- e) For LT Switchgear (AC & DC distribution Boards): IP-52

The degree of protection shall be in accordance with IS/IEC60947; IS/IEC/60529 . Type test report for of relevant Degree of Protection test, shall be submitted for approval.

**6.3 RATING PLATES, NAME PLATES AND LABELS**

6.3.1 Each main and auxiliary item of substation is to have permanently attached to it in a conspicuous position a rating plate of non-corrosive material upon which is to be engraved manufacturer's name, Customer Name, year of manufacture, equipment name, type or serial number together with details of the loading conditions under which the item of substation in question has been designed to operate, and such diagram plates as may be required by the Employer. The rating plate of each equipment shall be according to IS/ IEC requirement.

6.3.2 All such nameplates, instruction plates, rating plates of transformers, reactors, CB, CT, CVT, SA, Isolators, C & R panels and PLCC equipments shall be bilingual with Hindi

inscription first followed by English. Alternatively two separate plates one with Hindi and the other with English inscriptions may be provided.

**6.4 FIRST FILL OF CONSUMABLES, OIL AND LUBRICANTS**

All the first fill of consumables such as oils, lubricants, filling compounds, touch up paints, soldering/brazing material for all copper piping of circuit breakers and essential chemicals etc. which will be required to put the equipment covered under the scope of the specifications, into operation, shall be furnished by the Bidder unless specifically excluded under the exclusions in these specifications and documents.

**7.0 DESIGN IMPROVEMENTS / COORDINATION**

7.1 Deleted.

7.2 Deleted.

7.3 The Bidder shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic design requirements are detailed out in this Specification. The design of various components, sub-assemblies and assemblies shall be so done that it facilitates easy field assembly and maintenance.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 7.4 The Bidder has to coordinate designs and terminations with the agencies (if any) who are Consultants/Bidder for the Employer. The names of agencies shall be intimated to the successful bidders.
- 7.5 The Bidder will be called upon to attend design co-ordination meetings with the Engineer, other Contractor's and the Consultants of the Employer (if any) during the period of Contract. The Bidder shall attend such meetings at his own cost at POWERGRID Corporate Centre, Gurgaon (Haryana) or at mutually agreed venue as and when required and fully cooperate with such persons and agencies involved during those discussions.

**8.0 QUALITY ASSURANCE PROGRAMME**

- 8.1 To ensure that the equipment and services under the scope of this Contract, whether manufactured or performed within the Bidder's Works or at his Sub-Bidder's premises or at the Employer's site or at any other place of Work as applicable, are in accordance with the specifications, the Contractor shall ensure suitable quality assurance programme to control such activities at all points necessary. A quality assurance programme of the Contractor shall be in line with ISO requirements & shall generally cover the following:
- a) The organisation structure for the management and implementation of the proposed quality assurance programme.
  - b) System for Document and Data Control.
  - c) Qualification and Experience data of Bidder's key personnel.
  - d) The procedure for purchases of materials, parts, components and selection of sub-Bidder's services including vendor analysis, source inspection, incoming raw material inspection, verification of material purchases etc.
  - e) System for shop manufacturing and site erection controls including process controls, fabrication and assembly control.
  - f) System for Control of non-conforming products including deviation dispositioning, if any and system for corrective and preventive actions based on the feedback received from the Customers and also internally documented system for Customer complaints.
  - g) Inspection and test procedure both for manufacture and field activities.
  - h) System for Control of calibration of testing and measuring equipment and the indication of calibration status on the instruments.
  - i) System for indication and appraisal of inspection status.
  - j) System of Internal Quality Audits, Management review and initiation of corrective and Preventive actions based on the above.
  - k) System for authorising release of manufactured product to the Employer.
  - l) System for maintenance of records.
  - m) System for handling, storage and delivery.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- n) A quality plan detailing out the specific quality control measures and procedure adopted for controlling the quality characteristics relevant to each item of equipment furnished and /or service rendered.
- o) System for various field activities i.e. unloading, receipt at site, proper storage, erection, testing and commissioning of various equipment and maintenance of records. In this regard, the Employer has already prepared Standard Field Quality Plan for transmission line/substation equipments as applicable, Civil/erection Works which is required to be followed for associated works.

The Employer or his duly authorised representative reserves the right to carry out quality audit and quality surveillance of the system and procedure of the Bidder/his vendor's quality management and control activities.

## 8.2 **Quality Assurance Documents**

The Bidder shall ensure availability of the following Quality Assurance Documents:

- i) All Non-Destructive Examination procedures, stress relief and weld repair procedure actually used during fabrication, and reports including radiography interpretation reports.
- ii) Welder and welding operator qualification certificates.
- iii) Welder's identification list, welding operator's qualification procedure and welding identification symbols.
- iv) Raw Material test reports on components as specified by the specification and in the quality plan.
- v) The Manufacturing Quality Plan(MQP) indicating Customer Inspection Points (CIPs) at various stages of manufacturing and methods used to verify that the inspection and testing points in the quality plan were performed satisfactorily.
- vi) Factory test results for testing required as per applicable quality plan/technical specifications/GTP/Drawings etc.
- vii) Stress relief time temperature charts/oil impregnation time temperature charts, wherever applicable.

## 8.3 **INSPECTION, TESTING & INSPECTION CERTIFICATE**

8.3.1 The responsibility and the basis of inspection for various items & equipment is placed at **Annexure-G** along with the requirement of MQP (Manufacturing Quality Plan), ITP(Inspection & Test Plan), FAT(Factory Acceptance Test) which should be valid & POWERGRID approved and Level of inspection envisaged against each item.

Bidder shall ensure that order for items where MQP/ITP/FAT is required will be placed only on vendors having valid MQP/ITP/FAT and where the supplier's MQP/ITP/FAT is either not valid or has not been approved by POWERGRID, MQP shall be generally submitted as per POWERGRID format before placing order.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

Items not covered under MQP/ITP/FAT shall be offered for inspection as per POWERGRID LOA/technical Specifications/POWERGRID approved data sheets/ POWERGRID approved drawings and relevant Indian/International standards.

**Inspection Levels:** For implementation of projects in a time bound manner and to avoid any delay in deputation of POWERGRID or its authorized representative, involvement of POWERGRID for inspection of various items / equipment will be based on the level below:

**Level – I:** Bidder to raise all inspection calls and review the report of tests carried out by the manufacturer, on his own, as per applicable standards/ POWERGRID specification, and submit to concerned POWERGRID inspection office/Inspection Engineer. CIP/MICC will be issued by POWERGRID based on review of test reports/certificates of manufacturers.

**Level – II:** Bidder to raise all inspection calls and carry out the inspection on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during inspection, the same would be intimated to Bidder and CIP/MICC will be issued by POWERGRID. Else, Bidder would submit their test reports/certificates to POWERGRID. CIP/MICC will be issued by POWERGRID based on review of test reports/ certificates.

**Level - III:** Bidder to raise inspection calls for both, stage (as applicable) & final inspection and carry out the stage inspections (if applicable) on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during stage inspection, the same would be intimated to Bidder and CIP will be issued by POWERGRID. Else, Bidder would submit the test reports / certificates of stage inspection after their own review and CIP will be issued by POWERGRID based on review of test reports / certificates. Final inspection will be carried out by POWERGRID and CIP/MICC will be issued by POWERGRID.

**Level – IV:** Bidder to raise inspection calls for both, stage (as applicable) & final inspections. POWERGRID will carry out the inspection for both stage & final inspection as per applicable standards/specification and CIP/MICC will be issued by POWERGRID.

8.3.2 Bidder shall ensure that to implement the above inspection levels, particularly for the quality control and inspection at sub-vendor's works, they would depute sufficient qualified & experienced manpower in their Quality Control and Inspection department. Further, to assure quality of construction, Bidder shall have a separate workforce having appropriate qualification & experience and deploy suitable tools and plant for maintaining quality requirement during construction in line with applicable Field Quality Plan (FQP).

8.3.3 The Employer, his duly authorised representative and/or outside inspection agency acting on behalf of the Employer shall have at all reasonable times access to the Bidder's premises or Works and shall have the power at all reasonable times to ensure that proper Quality Management practices / norms are adhered to, inspect and examine the materials & workmanship of the Works, to carry out Quality/Surveillance Audit during manufacture or erection and if part of the Works is being manufactured or assembled at other premises or works. The Bidder shall obtain for the



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

Employer and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Bidder's own premises or works. The item/equipment, if found unsatisfactory with respect to workmanship or material is liable to be rejected. The observations for improvements during product/ process inspection by POWERGRID shall be recorded in Quality Improvement Register (available & maintained at works) for review & timely compliance of observations.

- 8.3.4 Bidder shall submit inspection calls over internet through POWERGRID website. The required vendor code and password to enable raising inspection call will be furnished to the main Contractor within 30 days of award of contract on submission of documents by Contractor. After raising the inspection calls, Contractor shall then proceed as per the message of that particular call which is available on the message board.
- 8.3.5 The Employer reserves the right to witness any or all type, acceptance and routine tests specified for which the Bidder shall give the Employer/Inspector Twenty one (21) days written notice of any material being ready for testing for each stage of testing as identified in the approved quality plan as customer inspection point (CIP) for indigenous inspections. All inspection calls for overseas material shall be given at least forty five (45) days in advance. Such tests shall be to the Bidder's account except for the expenses of the Inspection Engineer. The Employer/inspector, unless witnessing of the tests is waived by Employer, will attend such tests within Twenty one (21) days of the date of which the equipment is notified as being ready for test/inspection, failing which the Bidder may proceed with the test which shall be deemed to have been made in the Inspector's presence and he shall forthwith forward to the Inspector three copies of tests, duly certified. Bidder shall ensure, before giving notice for type test, that all drawings and quality plans have been got approved. The equipment shall be dispatched to site only after approval of Routine and Acceptance test results and Issuance of Dispatch Clearance in writing by the Employer. CIP/Material Inspection clearance certificate (MICC) shall be issued by the Employer after inspection of the equipment or review of test reports as applicable. Employer may waive off the presence of Employer's inspecting engineer. In that case test will be carried out as per approved QP and test certificate will be furnished by the supplier for approval. CIP/MICC will be issued only after review and approval of the test reports.
- 8.3.6 Bidder shall generally offer material for inspection as per supply bar chart approved by POWERGRID and not before 30 days from schedule indicated in the bar chart. In case Bidder offers material(s) for inspection prior to 30 days from the scheduled date with necessary approval of POWERGRID, POWERGRID shall inspect the material and issue CIP only. However, in such an exceptional case, MICC shall be issued only as per provision of original / revised approved supply schedule.
- 8.3.7 Bidder shall minimize the number of inspection calls by offering optimum quantities in each inspection call at the respective manufacturer's works.
- 8.3.8 Bidder shall inspect the material themselves and only after they are fully convinced about the Quality, they shall offer the material for POWERGRID inspection and shall also ensure that relevant portion of LOA/NOA, approved drawing and data sheets along with applicable Quality Plans are available at the works of Contractor or their Sub-vendor before the material is offered for inspection.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 8.3.9 Bidder shall ensure that material which has been cleared for dispatch after inspection will be dispatched within 30 days in case of domestic supplies and within 60 days in case of Off-shore supplies from the date of issuance of CIP. Material which is not dispatched within stipulated time as above will be reoffered for POWERGRID inspection or specific approval of POWERGRID QA&I shall be obtained for delayed dispatch.
- 8.3.10 The Employer or IE shall give notice in writing to the Bidder, of any objection either to conformance to any drawings or to any equipment and workmanship which in his opinion is not in accordance with the Contract. The Bidder shall give due consideration to such objections and shall either make the modifications that may be necessary to meet the said objections or shall confirm in writing to the Employer/Inspection Engineer giving reasons therein, that no modifications are necessary to comply with the Contract.
- 8.3.11 All Test Reports and documents to be submitted in English during final inspection of equipment by POWERGRID or as and when required for submission.
- 8.3.12 When the factory tests have been completed at the Bidder's or Sub-Bidder's works, the Employer/Inspection Engineer(IE) shall issue a certificate to this effect within fifteen (15) days after completion of tests & submission of documents by Bidder/manufacturer but if the tests are not witnessed by the Employer/IE, the certificate shall be issued within fifteen (15) days of receipt of the Bidder's Test certificate by the Employer/IE. Bidder shall, on completion of all tests, submit test reports within Ten (10) days to POWERGRID IE. Failure of the Employer/IE to issue such a certificate shall not prevent the Contractor from proceeding with the Works. The completion of these tests or the issue of the certificate shall not bind the Employer to accept the equipment should, it, on further tests after erection, be found not to comply with the Contract.
- 8.3.13 In all cases, where the Contract provides for tests whether at the premises or works of the Bidder or of any Sub-Bidder, the Bidder, except where otherwise specified, shall provide free of charge such items as labour, materials, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Employer/Inspector or his authorised representative to carry out effectively such tests of the equipment in accordance with the Contract and shall give facilities to the Employer/Inspection Engineer or to his authorised representative to accomplish testing.
- 8.3.14 The inspection and acceptance by Employer and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed quality assurance programme forming a part of the Contract, or if such equipment is found to be defective at a later stage.
- 8.3.15 The Employer will have the right of having at his own expenses any other test(s) of reasonable nature carried out at Contractor's premises or at site or in any other place in addition of aforesaid type and routine tests, to satisfy that the material comply with the specification.
- 8.3.16 The Employer reserves the right for getting any additional field tests conducted on the completely assembled equipment at site to satisfy that material complies with specifications.
- 8.3.17 Rework/ Re-engineering, if any, on any item/equipment shall be carried out only after mutual discussions and in accordance with mutually agreed procedure. Bidder shall submit Joint Inspection Report of equipments under Re-Work/Re-Engineering alongwith procedure for the



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

same to POWERGRID for approval, before taking up the Re-Work/Re-Engineering, failing which POWERGRID reserves the right to reject the equipment.

- 8.3.18 Bidder may establish a field test Laboratory to execute Civil Construction testing requirements at site with the condition that all testing equipment shall be calibrated from POWERGRID approved accredited Testing laboratories, with calibration certificates kept available at site and all testing personnel employed in the Field Testing Laboratories to be qualified and experienced Engineers or testing to be carried out at POWERGRID approved Third Party Laboratories.
- 8.3.19 Bidder shall ensure that all possible steps are taken to avoid damages to the equipment during transport, storage and erection.
- 8.3.20 Deleted.
- 8.3.21 Bidder shall ensure commissioning of all CSDs along with Circuit Breakers wherever applicable.

**8.3.22 For EHV transformers/reactors:**

Insulation oil shall be as per POWERGRID Technical specifications and same grade shall be used for impregnation of the active part & testing at the works of Transformer/Reactor Manufacturer and as well as for filling the Transformer/Reactors at site. Bidder to ensure that windings for Transformer/Reactors are made in air conditioned environment. Core-coil assembly shall be performed in positive pressurized dust controlled environment. Dust measurements shall be monitored regularly at Transformer / Reactor Manufacturer works. Contractor shall ensure that respective civil foundations & Fire walls for Transformer/Reactors units to be commissioned, shall be made ready at concerned sites before receipt of Transformer/Reactors units.

- 8.3.23 The Employer reserves the right to increase or decrease their involvement in inspections at Bidder's Works or at his Sub-Bidder's premises or at the Employer's site or at any other place of Work based on performance of Bidder/sub-bidder.

**9.0 TYPE TESTING & CLEARANCE CERTIFICATE**

- 9.1 Deleted.
- 9.2 Deleted.
- 9.3 The Employer intends to repeat those type tests which are indicated in the price schedule and the same shall be payable as per provision of contract. The price of conducting type tests shall be included in Bid price and break up of these shall be given in the relevant schedule of Bid Proposal Sheets. These Type test charges would be considered in bid evaluation. In case Bidder does not indicate charges for any of the type tests or does not mention the name of any test in the price schedules, it will be presumed that the particular test has been offered free of charge. Further, in case any Bidder indicates that he shall not carry out a particular test, his offer shall be considered incomplete and shall be liable to be rejected. The Employer reserves the right to waive the repeating of type tests partly or fully and in case of waiver, test charges for the same shall not be payable.
- 9.4 The Employer reserves the right to witness any or all the type tests. The Employer shall bear all expenses for deputation of Employer's representative(s) for witnessing the type tests except in the case of re-deputation if any, necessitated due to no fault of the Employer.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandasaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

9.5 The list of makes of various items, for which Type test reports are not required to be submitted are specified at Annexure-J.

10.0 Deleted.

**11.0 PACKAGING & PROTECTION**

11.1 All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. On request of the Employer, the Bidder shall also submit packing details/associated drawing for any equipment/material under his scope of supply, to facilitate the Employer to repack any equipment/material at a later date, in case the need arises. While packing all the materials, the limitation from the point of view of availability of Railway wagon sizes in India should be taken into account. The Bidder shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Contractor. Employer/BHEL takes no responsibility of the availability of the wagons.

11.2 All coated surfaces shall be protected against abrasion, impact, discolouration and any other damages. All exposed threaded portions shall be suitably protected with either a metallic or a non-metallic protecting device. All ends of all valves and pipings and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage.

**12.0 FINISHING OF METAL SURFACES**

12.1 All metal surfaces shall be subjected to treatment for anti-corrosion protection. All ferrous surfaces for external use unless otherwise stated elsewhere in the specification or specifically agreed, shall be hot-dip galvanized after fabrication. All steel conductors including those used for earthing/grounding (above ground level) shall also be galvanized according to IS: 2629.

**12.2 HOT DIP GALVANISING**

12.2.1 The minimum weight of the zinc coating shall be 610 gm/sq.m and minimum average thickness of coating shall be 86 microns for all items having thickness 6mm and above. For items lower than 6mm thickness requirement of coating thickness shall be as per relevant ASTM. For surface which shall be embedded in concrete, the zinc coating shall be 610 gm/sq.m minimum.

12.2.2 The galvanized surfaces shall consist of a continuous and uniform thick coating of zinc, firmly adhering to the surface of steel. The finished surface shall be clean and smooth and shall be free from defects like discoloured patches, bare spots, unevenness of coating, spelter which is loosely attached to the steel globules, spiky deposits, blistered surface, flaking or peeling off, etc. The presence of any of these defects noticed on visual or microscopic inspection shall render the material liable to rejection.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 12.2.3 After galvanizing, no drilling or welding shall be performed on the galvanized parts of the equipment excepting that nuts may be threaded after galvanizing. Sodium dichromate or alternate approved treatment shall be provided to avoid formation of white rust after hot dip galvanization.
- 12.2.4 The galvanized steel shall be subjected to four numbers of one minute dips in copper sulphate solution as per IS-2633.
- 12.2.5 Sharp edges with radii less than 2.5 mm shall be able to withstand four immersions of the Standard Preece test. All other coatings shall withstand six immersions. The following galvanizing tests should essentially be performed as per relevant Indian Standards.
- Coating thickness
  - Uniformity of zinc
  - Adhesion test
  - Mass of zinc coating
- 12.2.6 Galvanised material must be transported properly to ensure that galvanised surfaces are not damaged during transit. Application of touch-up zinc rich paint at site shall be allowed with approval of Engineer Incharge.

**12.3 PAINTING**

- 12.3.1 All sheet steel work shall be degreased, pickled, phosphated in accordance with the IS6005 "Code of practice for phosphating iron and sheet". All surfaces, which will not be easily accessible after shop assembly, shall beforehand be treated and protected for the life of the equipment. The surfaces, which are to be finished painted after installation or require corrosion protection until installation, shall be shop painted with at least two coats of primer. Oil, grease, dirt and swaf shall be thoroughly removed by emulsion cleaning. Rust and scale shall be removed by pickling with dilute acid followed by washing with running water, rinsing with slightly alkaline hot water and drying.
- 12.3.2 Hot Phosphating shall be done for phosphating process under pretreatment of sheets After phosphating, thorough rinsing shall be carried out with clean water followed by final rinsing with dilute dichromate solution and oven drying. The phosphate coating shall be sealed with application of two coats of ready mixed, stoving type zinc chromate primer. The first coat may be "flash dried" while the second coat shall be stoved.
- 12.3.3 After application of the primer, two coats of finishing synthetic enamel paint shall be applied, each coat followed by stoving. The second finishing coat shall be applied after inspection of first coat of painting.
- 12.3.4 The exterior and interior colour of the paint in case of new substations shall preferably be RAL 7032 for all equipment, marshalling boxes, junction boxes, control cabinets, panels etc. unless specifically mentioned under respective sections of the equipments. Glossy white colour inside the equipments /boards /panels/junction boxes is also acceptable. The exterior colour for panels shall be matching with the existing panels in case of extension of a substation. Each coat of primer and finishing paint shall be of slightly different shade to enable inspection of the painting. A small quantity of finishing paint shall be supplied for minor touching up required at site after installation of the equipments.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

12.3.5 In case the contractor proposes to follow his own standard surface finish and protection procedures or any other established painting procedures, like electrostatic painting etc., the procedure shall be submitted during detailed engineering for Employer's review & approval.

12.3.6 The colour scheme as given below shall be followed for Fire Protection and Air Conditioning systems

S.No.	PIPE LINE	Base colour	Band colour
<b><u>Fire Protection System</u></b>			
1	Hydrant and Emulsifier system pipeline/NIFPS	FIRE RED	-
2	Emulsifier system detection line – water	FIRE RED	Sea Green
3	Emulsifier system detection line –Air	FIRE RED	Sky Blue
4	Pylon support pipes	FIRE RED	
<b><u>Air Conditioning Plant</u></b>			
5	Refrigerant gas pipeline – at compressor suction	Canary Yellow	-
6	Refrigerant gas pipeline – at compressor discharge	Canary Yellow	Red
7	Refrigerant liquid pipeline	Dark Admiralty Green	-
8	Chilled water pipeline	Sea Green	-
9	Condenser water pipeline	Sea Green	Dark Blue

The direction of flow shall be marked by → (arrow) in black colour.



Base Colour Direction of flow Band Colour

12.3.7 For aluminium casted surfaces, the surface shall be with smooth finish. Further, in case of aluminium enclosures, the surface shall be coated with powder (coating thickness of 60 microns) after surface preparation for painting. For stainless steel surfaces, no painting is envisaged.

12.3.8 Band colour is required for Emulsifier system detection line only if both water and air detection lines are present at the same substation. Further, band colour shall be applied at an interval of 2 meters approx. along the length and minimum width of band shall be 25mm.

13.0 Deleted.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**14.0 TOOLS**

**14.1 Deleted.**

**14.2 SPECIAL TOOLS AND TACKLES**

The bidder shall supply all special tools and tackles required for Operation and maintenance of equipment. The special tools and tackles shall only cover items which are specifically required for the equipment offered and are proprietary in nature. The list of special tools and tackles, if any, shall be finalized during detail engineering and the same shall be supplied without any additional cost implication to the Employer.

**14.3 Deleted.**

**15.0 AUXILIARY SUPPLY**

**15.1** The auxiliary power for station supply, including the equipment drive, cooling system of any equipment, air-conditioning, lighting etc shall be designed for the specified Parameters as under. The DC supply for the instrumentation and PLCC system shall also conform the parameters as indicated in the following table:

<b>Normal Voltage</b>	<b>Variation in Voltage</b>	<b>Frequency in HZ</b>	<b>Phase/Wire</b>	<b>Neutral connection</b>
415V	$\pm 10\%$	$50 \pm 5\%$	3/4 Wire	Solidly Earthed.
240V	$\pm 10\%$	$50 \pm 5\%$	1/2 Wire	Solidly Earthed.
220V	190V to 240V	DC	Isolated 2 wire System	-
110V	95V to 120V	DC	Isolated 2 wire System	-
48V	--	DC	2 wire system (+) earthed	-

Combined variation of voltage and frequency shall be limited to  $\pm 10\%$ .

**15.2** Pickup value of binary input modules of Intelligent Electronic Devices, Digital protection couplers, Analog protection couplers shall not be less than 50% of the specified rated station auxiliary DC supply voltage level.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandasaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**16.0 SUPPORT STRUCTURE (ONLY OF CIRCUIT BREAKER)**

- 16.1 The equipment support structures shall be suitable for equipment connections at the first level i.e 14.0 meter, 8.0 meter, 5.9 meter and 4.6 meter from plinth level for 765kV, 400kV, 220kV and 132kV substations respectively. All equipment support structures shall be supplied alongwith brackets, angles, stools etc. for attaching the operating mechanism, control cabinets & marshalling box (wherever applicable) etc.
- 16.2 The minimum vertical distance from the bottom of the lowest porcelain/polymer part of the bushing, porcelain/polymer enclosures or supporting insulators to the bottom of the equipment base, where it rests on the foundation pad shall be 2.55 metres.

**17.0 CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS (For Lightning Arrester & Wave Trap only)**

- 17.1 All power clamps and connectors shall conform to IS:5561 or other equivalent international standard and shall be made of materials listed below :

Sl. No.	Description	Materials
a)	For connecting ACSR conductors/AAC conductors/ Aluminium tube	Aluminum alloy casting, conforming to designation <b>4600</b> of IS:617 and all test shall conform to IS:617
b)	For connecting equipment terminals mad of copper with ACSR conductors/AAC conductors/ Aluminium tube	Bimetallic connectors made from aluminum alloy casting, conforming to designation <b>4600</b> of IS:617 with 2mm thick bimetallic liner/strip and all test shall conform to IS:617
c)	For connecting G.I	Galvanised mild steel shield wire
d)	Bolts, nuts & plain washers	Electro-galvanised for sizes below M12, for others hot dip galvanised.
e)	Spring washers	Electro-galvanised mild steel suitable for atleast service condition-3 as per IS:1573

- 17.2 Necessary clamps and connectors shall be supplied for all equipment and connections. If corona rings are required to meet these requirements they shall be considered as part of that equipment and included in the scope of work.
- 17.3 Where copper to aluminum connections are required, bi-metallic clamps shall be used, which shall be properly designed to ensure that any deterioration of the connection is kept to a minimum and restricted to parts which are not current carrying or subjected to stress.
- 17.4 Low voltage connectors, grounding connectors and accessories for grounding all equipment as specified in each particular case, are also included in the scope of Work.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 17.5 No current carrying part of any clamp shall be less than 10 mm thick. All ferrous parts shall be hot dip galvanised. Copper alloy liner/strip of minimum 2 mm thickness shall be cast integral with aluminum body or 2 mm thick bi-metallic liner/strips shall be provided for Bi-metallic clamps.
- 17.6 All casting shall be free from blow holes, surface blisters, cracks and cavities. All sharp edges and corners shall be blurred and rounded off.
- 17.7 Flexible connectors, braids or laminated straps made for the terminal clamps for bus posts shall be suitable for both expansion or through (fixed/sliding) type connection of IPS AL tube as required. In both the cases the clamp height (top of the mounting pad to centre line of the tube) should be same.
- 17.8 Current carrying parts (500A and above) of the clamp/connector shall be provided with minimum four numbers of bolts preferably for 132kV and above.
- 17.9 All current carrying parts shall be designed and manufactured to have minimum contact resistance.
- 17.10 Power Clamps and connectors shall be designed to control corona as per requirement.

**17.11 Tests**

Clamps and connectors should be type tested on minimum three samples as per IS:5561 and shall also be subjected to routine tests as per IS:5561. Following type test reports shall be submitted for approval. Type test once conducted shall hold good. The requirement of test conducted within last ten years, shall not be applicable.

- i) Temperature rise test (maximum temperature rise allowed is 35°C over 50°C ambient)
- ii) Short time current test
- iii) Corona (dry) and RIV (dry) test [for 132kV and above voltage level clamps]
- iv) Resistance test and Pullout strength test
- v) Cantilever Strength test on bus support clamps & connectors

vi)

**18.0 CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES MARSHALLING BOXES FOR OUTDOOR EQUIPMENT**

- 18.1 All types of boxes, cabinets etc. shall generally conform to & be tested in accordance with IS/IEC 61439-0, as applicable, and the clauses given below:
- 18.2 Control cabinets, junction boxes, Marshalling boxes & terminal boxes, Out door ACDB cum DCDB panels shall be made of stainless steel of atleast 1.5 mm thick or aluminum enclosure of atleast 1.6 mm thick and shall be dust, water and vermin proof. Stainless steel used shall be of grade SS304 (SS316 for coastal area) or better. The box shall be properly braced to prevent wobbling. There shall be sufficient reinforcement to provide level surfaces, resistance to vibrations and rigidity during transportation and installation. In case of aluminum enclosed box the thickness of aluminum shall be such that it provides adequate rigidity and long life as comparable with sheet steel of specified thickness.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

Control cabinets, junction boxes, marshalling boxes & terminal boxes, out-door ACDB cum DCDB panels shall have adequate space/clearance as per guidelines/technical specifications to access/replace any component. Necessary component labelling to be also done on non-conducting sheet.

For CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES MARSHALLING BOXES FOR OUTDOOR EQUIPMENT Junction Box, wire should be as per IS or equivalent IEC with FRLS grade

Machine laid PU Foam gasket may be permitted for use in Control Cabinets etc.

- 18.3 A canopy and sealing arrangements for operating rods shall be provided in marshalling boxes / Control cabinets to prevent ingress of rain water.
- 18.4 Cabinet/boxes with width more than 700 mm shall be provided with double hinged doors with padlocking arrangements. The distance between two hinges shall be adequate to ensure uniform sealing pressure against atmosphere.
- 18.5 All doors, removable covers and plates shall be gasketed all around with suitably profiled EPDM/Neoprene/PU gaskets. The gasket shall be tested in accordance with approved quality plan, IS:11149 and IS:3400. Ventilating Louvers, if provided, shall have screen and filters. The screen shall be fine wire mesh made of brass.
- Further, the gasketing arrangement shall be such that gaskets are pasted in slots (in door fabrication/gasket itself) in order to prevent ingress of dust and moisture inside the panels so that no internal rusting occurs in panels during the operation of the equipment.
- 18.6 All boxes/cabinets shall be designed for the entry of cables by means of weather proof and dust-proof connections. Boxes and cabinets shall be designed with generous clearances to avoid interference between the wiring entering from below and any terminal blocks or accessories mounted within the box or cabinet. Suitable cable gland plate above the base of the marshalling kiosk/box shall be provided for this purpose along with the proper blanking plates. Necessary number of cable glands shall be supplied and fitted on this gland plate. Gland plate shall have provision for some future glands to be provided later, if required. The Nickel plated glands shall be dust proof, screw on & double compression type and made of brass. The gland shall have provision for securing armour of the cable separately and shall be provided with earthing tag. The glands shall conform to BS:6121.
- 18.7 A 240V, single phase, 50 Hz, 15 amp AC plug and socket shall be provided in the cabinet with ON-OFF switch for connection of hand lamps. Plug and socket shall be of industrial grade.
- 18.8 LED based illumination of minimum 9 watts shall be provided. The switching of the fittings shall be controlled by the door switch.
- For junction boxes of smaller sizes such as lighting junction box, manual operated earth switch mechanism box etc., plug socket, heater and illumination is not required to be provided.
- 18.9 All control switches shall be of MCB/rotary switch type and Toggle/piano switches shall not be accepted.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 18.10 Earthing of the cabinet shall be ensured by providing two separate earthing pads. The earth wire shall be terminated on to the earthing pad and secured by the use of self etching washer. Earthing of hinged door shall be done by using a separate earth wire.
- 18.11 The bay marshalling kiosks shall be provided with danger plate and a diagram showing the numbering/connection/feruling by pasting the same on the inside of the door.
- 18.12 The following routine tests alongwith the routine tests as per IS:5039 shall also be conducted:
- i) Check for wiring
  - ii) Visual and dimension check
- 18.13 The enclosure of bay marshalling kiosk, junction box, terminal box and control cabinets shall conform to IP-55 as per IS/IEC60947 including application of 1kV rms for 1 (one) minute, after IP-55 test.
- 19.0 Deleted.**

**20.0 TERMINAL BLOCKS AND WIRING**

- 20.1 Control and instrument leads from the switchboards or from other equipment will be brought to terminal boxes or control cabinets in conduits. All interphase and external connections to equipment or to control cubicles will be made through terminal blocks.
- 20.2 Terminal blocks shall be 650V grade and have continuous rating to carry the maximum expected current on the terminals and non-breakable type. These shall be of moulded piece, complete with insulated barriers, stud type terminals, washers, nuts and lock nuts. Screw clamp, overall insulated, insertion type, rail mounted terminals can be used in place of stud type terminals. But the terminal blocks shall be non-disconnecting stud type except for the secondary junction boxes of Current Transformer and Voltage Transformer.
- 20.3 Terminal blocks for current transformer and voltage transformer secondary leads shall be provided with test links and isolating facilities. The current transformer secondary leads shall also be provided with short circuiting and earthing facilities.
- 20.4 The terminal shall be such that maximum contact area is achieved when a cable is terminated. The terminal shall have a locking characteristic to prevent cable from escaping from the terminal clamp unless it is done intentionally.
- 20.5 The conducting part in contact with cable shall preferably be tinned or silver plated however Nickel plated copper or zinc plated steel shall also be acceptable.
- 20.6 The terminal blocks shall be of extensible design, multilayer terminal arrangement is not allowed in any junction box (Common MB, Individual MB, JB etc.). There should be sufficient space at both sides of terminals so that ferrule number of wires / TB numbers are clearly visible during wire removal or insertion.
- 20.7 The terminal blocks shall have locking arrangement to prevent its escape from the mounting rails.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandasaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

- 20.8 The terminal blocks shall be fully enclosed with removable covers of transparent, nondeteriorating type plastic material. Insulating barriers shall be provided between the terminal blocks. These barriers shall not hinder the operator from carrying out the wiring without removing the barriers.
- 20.9 Unless otherwise specified terminal blocks shall be suitable for connecting the following conductors on each side.
- |                                       |   |
|---------------------------------------|---|
| a) All circuits except CT/PT circuits | Minimum of two of<br>2.5 sq mm copper<br>flexible.    |
| b) All CT/PT circuits                 | Minimum of 4 nos. of<br>2.5 sq mm copper<br>flexible. |
- 20.10 The arrangements shall be in such a manner so that it is possible to safely connect or disconnect terminals on live circuits and replace fuse links when the cabinet is live.
- 20.11 Atleast 20 % spare terminals shall be provided on each panel/cubicle/box and these spare terminals shall be uniformly distributed on all terminals rows.
- 20.12 There shall be a minimum clearance of 250 mm between the First/bottom row of terminal block and the associated cable gland plate for outdoor ground mounted marshalling box and the clearance between two rows of terminal blocks shall be a minimum of 150 mm.
- 20.13 The Contractor shall furnish all wire, conduits and terminals for the necessary interphase electrical connections (where applicable) as well as between phases and common terminal boxes or control cabinets

## **21.0 LAMPS & SOCKETS**

### **21.1 Lamps & Sockets**

All lamps shall use a socket base as per IS-1258, except in the case of signal lamps.

All sockets (convenience outlets) shall be suitable to accept both 5 Amp & 15 Amp pin round Standard Indian plugs. They shall be switched sockets with shutters.

### **21.2 Hand Lamp:**

A 240 Volts, single Phase, 50 Hz AC plug point shall be provided in the interior of each cubicle with ON-OFF Switch for connection of hand lamps.

### **21.3 Switches and Fuses:**

- 21.3.1 Each panel shall be provided with necessary arrangements for receiving, distributing, isolating and fusing of DC and AC supplies for various control, signaling, lighting and space heater circuits. The incoming and sub-circuits shall be separately provided with miniature circuit breaker / switch fuse units. Selection of the main and Sub-circuit fuse ratings shall be such as to ensure selective



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

clearance of sub-circuit faults. Potential circuits for relaying and metering shall be protected by HRC fuses.

- 21.3.2 All fuses shall be of HRC cartridge type conforming to relevant IS mounted on plug-in type fuse bases. Miniature circuit breakers with thermal protection and alarm contacts will also be accepted. All accessible live connection to fuse bases shall be adequately shrouded. Fuses shall have operation indicators for indicating blown fuse condition. Fuse carrier base shall have imprints of the fuse rating and voltage.

**22.0 BUSHINGS, HOLLOW COLUMN INSULATORS, SUPPORT INSULATORS:**

- 22.1 Bushings shall be manufactured and tested in accordance with IS:2099 & IEC-60137 while hollow column insulators shall be manufactured and tested in accordance with IEC-62155/IS:5621. The support insulators shall be manufactured and tested as per IS:2544/IEC-60168 and IEC-60273. The insulators shall also conform to IEC-60815 as applicable.

The bidder may also offer composite hollow insulators, conforming to IEC-61462.

- 22.2 Support insulators, bushings and hollow column insulators shall be manufactured from high quality porcelain. Porcelain used shall be homogeneous, free from laminations, cavities and other flaws or imperfections that might affect the mechanical or dielectric quality and shall be thoroughly vitrified tough and impervious to moisture.

- 22.3 Glazing of the porcelain shall be uniform brown in colour, free from blisters, burrs and similar other defects.

- 22.4 Support insulators/bushings/hollow column insulators shall be designed to have ample insulation, mechanical strength and rigidity for the conditions under which they will be used.

- 22.5 When operating at normal rated voltage there shall be no electric discharge between the conductors and bushing which would cause corrosion or injury to conductors, insulators or supports by the formation of substances produced by chemical action. No radio interference shall be caused by the insulators/bushings when operating at the normal rated voltage.

- 22.6 Bushing porcelain shall be robust and capable of withstanding the internal pressures likely to occur in service. The design and location of clamps and the shape and the strength of the porcelain flange securing the bushing to the tank shall be such that there is no risk of fracture. All portions of the assembled porcelain enclosures and supports other than gaskets, which may in any way be exposed to the atmosphere shall be composed of completely non hygroscopic material such as metal or glazed porcelain.

- 22.7 All iron parts shall be hot dip galvanised and all joints shall be air tight. Surface of joints shall be trued up porcelain parts by grinding and metal parts by machining. Insulator/bushing design shall be such as to ensure a uniform compressive pressure on the joints.

- 22.8 Void

- 22.9 Deleted.



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

**23.0 MOTORS**

Motors shall be "Squirrel Cage" three phase induction motors of sufficient size capable of satisfactory operation for the application and duty as required for the driven equipment and shall be subjected to routine tests as per applicable standards. The motors shall be of approved make.

**23.1 Enclosures**

- a) Motors to be installed outdoor without enclosure shall have hose proof enclosure equivalent to IP-55 as per IS: 4691. For motors to be installed indoor i.e. inside a box, the motor enclosure, shall be dust proof equivalent to IP-44 as per IS: 4691.
- b) Two independent earthing points shall be provided on opposite sides of the motor for bolted connection of earthing conductor.
- c) Motors shall have drain plugs so located that they will drain water resulting from condensation or other causes from all pockets in the motor casing.
- d) Motors weighing more than 25 Kg. shall be provided with eyebolts, lugs or other means to facilitate lifting.

**23.2 Operational Features**

- a) Continuous motor rating (name plate rating) shall be at least ten (10) percent above the maximum load demand of the driven equipment at design duty point and the motor shall not be over loaded at any operating point of driven equipment that will rise in service.
- b) Motor shall be capable at giving rated output without reduction in the expected life span when operated continuously in the system having the particulars as given in Clause 15.0 of this Section.

**23.3 Starting Requirements:**

- a) All induction motors shall be suitable for full voltage direct-on-line starting. These shall be capable of starting and accelerating to the rated speed alongwith the driven equipment without exceeding the acceptable winding temperature even when the supply voltage drops down to 80% of the rated voltage.
- b) Motors shall be capable of withstanding the electrodynamic stresses and heating imposed if it is started at a voltage of 110% of the rated value.
- c) The locked rotor current shall not exceed six (6) times the rated full load current for all motors, subject to tolerance as given in IS:325.
- d) Motors when started with the driven equipment imposing full starting torque under the supply voltage conditions specified under Clause 15.0 shall be capable of withstanding atleast two successive starts from cold condition at room temperature and one start from hot condition without injurious heating of winding. The motors shall also be suitable for three equally spread starts per hour under the above referred supply condition.
- e) The locked rotor withstand time under hot condition at 110% of rated voltage shall be more than starting time with the driven equipment of minimum permissible voltage by at least two seconds or 15% of the accelerating time whichever is greater. In case it is not possible to meet the above requirement, the Bidder shall offer centrifugal type speed switch mounted on the motor shaft



**Substation Package SS01 for (i) 400/220kV AIS Neemuch New S/S including 400kV class Transformer & Bus Reactor, (ii) Extension of 400kV Chittorgarh S/S and (iii) Extension of 400kV Mandsaur S/S associated with Transmission system for evacuation of power from Neemuch REZ through TBCB route.**

**General Technical Requirements- Section 3**

**Doc. No. : TB-418-316-000 Rev 00**

which shall remain closed for speed lower than 20% and open for speeds above 20% of the rated speed. The speed switch shall be capable of withstanding 120% of the rated speed in either direction of rotation.

**23.4 Running Requirements:**

- a) The maximum permissible temperature rise over the ambient temperature of 50 degree C shall be within the limits specified in IS:325 (for 3-phase induction motors) after adjustment due to increased ambient temperature specified.
- b) The double amplitude of motor vibration shall be within the limits specified in IS: 4729. Vibration shall also be within the limits specified by the relevant standard for the driven equipment when measured at the motor bearings.
- c) All the induction motors shall be capable of running at 80% of rated voltage for a period of 5 minutes with rated load commencing from hot condition.

**23.5 TESTING AND COMMISSIONING**

An indicative list of tests is given below. Contractor shall perform any additional test based on specialities of the items as per the field Q.P./Instructions of the equipment Contractor or Employer without any extra cost to the Employer. The Contractor shall arrange all instruments required for conducting these tests alongwith calibration certificates and shall furnish the list of instruments to the Employer for approval.

- (a) Insulation resistance.
- (b) Phase sequence and proper direction of rotation.
- (c) Any motor operating incorrectly shall be checked to determine the cause and the conditions corrected

**CORONA AND RADIO INTERFERENCE VOLTAGE (RIV) TEST**

**1. General**

Unless otherwise stipulated, all equipment together with its associated connectors, where applicable, shall be tested for external corona (for 400kV & above) both by observing the voltage level for the extinction of visible corona under falling power frequency voltage and by measurement of radio interference voltage (RIV) for 132kV and above.

**2. Test Levels:**

The test voltage levels for measurement of external RIV and for corona extinction voltage are listed under the relevant clauses of the specification.

**3. Test Methods for RIV:**

3.1 RIV tests shall be made according to measuring circuit as per International Special-Committee on Radio Interference (CISPR) Publication 16-1(1993) Part -1. The measuring circuit shall preferably be tuned to frequency with 10% of 0.5 Mhz but other frequencies in the range of 0.5 MHz to 2 MHz may be used, the measuring frequency being recorded. The results shall be in microvolts.

3.2 Alternatively, RIV tests shall be carried out in accordance with relevant IEC of respective equipment or NEMA standard Publication No. 107-1964.

3.3 In measurement of, RIV, temporary additional external corona shielding may be provided. In measurements of RIV only standard fittings of identical type supplied with the equipment and a simulation of the connections as used in the actual installation will be permitted in the vicinity within 3.5 meters of terminals.

3.4 Ambient noise shall be measured before and after each series of tests to ensure that there is no variation in ambient noise level. If variation is present, the lowest ambient noise level will form basis for the measurements. RIV levels shall be measured at increasing and decreasing voltages of 85%, 100%, and 110% of the specified RIV test voltage for all equipment unless otherwise specified. The specified RIV test voltage for 765kV, 400 kV, 220 KV is listed in the detailed specification together with maximum permissible RIV level in microvolts.

3.5 The metering instruments shall be as per CISPR recommendation or equivalent device so long as it has been used by other testing authorities.

3.6 The RIV measurement may be made with a noise meter. A calibration procedure of the frequency to which noise meter shall be tuned shall establish the ratio of voltage at the high voltage terminal to voltage read by noise meter.

**4. Test Methods for Visible Corona**

The purpose of this test is to determine the corona extinction voltage of apparatus, connectors etc. The test shall be carried out in the same manner as RIV test described above with the exception that RIV measurements are not required during test and a search technique shall be used near the onset and extinction voltage, when the test voltage is raised and lowered to determine their precise values. The test voltage shall be raised to 110% of specified corona extinction voltage and maintained there for five minutes. In case corona inception does not take place at 110%, test shall be stopped,

## **SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

### **ANNEXURE-A**

otherwise test shall be continued and the voltage will then be decreased slowly until all visible corona disappears. The procedure shall be repeated at least 3 times with corona inception and extinction voltage recorded each time. The corona extinction voltage for purposes of determining compliance with the specification shall be the lowest of the three values at which visible corona (negative or positive polarity) disappears.

The test to determine the visible corona extinction voltage need not be carried out simultaneously with test to determine RIV levels.

However, both test shall be carried out with the same test set up and as little time duration between tests as possible. No modification on treatment of the sample between tests will be allowed. Simultaneous RIV and visible corona extinction voltage testing may be permitted at the discretion of Employer's inspector if, in his opinion, it will not prejudice other test

#### **5. Test Records:**

In addition to the information previously mentioned and the requirements specified as per CISPR or NEMA 107-1964 the following data shall be included in test report:

- a) Background noise before and after test.
- b) Detailed procedure of application of test voltage.
- c) Measurements of RIV levels expressed in micro volts at each level.
- d) Results and observations with regard to location and type of interference sources detected at each step.
- e) Test voltage shall be recorded when measured RIV passes through 100 microvolts in each direction.
- f) Onset and extinction of visual corona for each of the four tests required shall be recorded.

**SEISMIC WITHSTAND TEST PROCEDURE**

The seismic withstanding test on the complete equipment (for 400kV and above) shall be carried out along with supporting structure. Seismic Withstand Test carried out using either lattice or pipe structure is acceptable.” **Seismic Calculations certified by NABL Labs shall also be acceptable**

The Bidder shall arrange to transport the structure from his Contractor’s premises/ POWERGRID sites for the purpose of seismic withstand test only.

The seismic level specified shall be applied at the base of the structure. The accelerometers shall be provided at the Terminal Pad of the equipment and any other point as agreed by the Employer. The seismic test shall be carried out in all possible combinations of the equipment. The seismic test procedure shall be furnished for approval of the Employer.

The frequency range for the earthquake spectra shall be as per IEC-62271-300.

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**LIST OF GENERAL STANDARDS AND CODES**

<b>CODES</b>	<b>TITLE</b>
--	India Electricity Rules
--	Indian Electricity Act
--	Indian Electricity (Supply) Act
--	Indian Factories Act
IS-5	Colors for Ready Mixed Paints and Enamels
IS-335	New Insulating Oils
IS-617	Aluminium and Aluminium Alloy Ingots and Castings for General Engineering Purposes
IS-1448 (P1 to P 145)	Methods of Test for Petroleum and its Products
IS-2071 (P1 to P3)	Methods of High Voltage Testing
IS-12063	Classification of degrees of protection provided by enclosures of electrical equipment
IS-2165 ; P1:1997, P2:1983	Insulation Coordination
IS-3043	Code of Practice for Earthing
IS-6103	Method of Test for Specific Resistance (Resistivity) of Electrical Insulating Liquids
IS-6104	Method of Test for Interfacial Tension of Oil against Water by the Ring Method
IS-6262	Method of test for Power factor & Dielectric Constant of Electrical Insulating Liquids
IS-6792	Method for determination of electric strength of insulating oils
IS-5578	Guide for marking of insulated conductors
IS-11353	Guide for uniform system of marking & identification of conductors & apparatus terminals.
IS-8263	Methods for Radio Interference Test on High voltage Insulators
IS-9224 (Part 1,2&4)	Low Voltage Fuses
IEC-60060 (Part 1 to P4)	High Voltage Test Techniques
IEC 60068	Environmental Test
IEC-60117	Graphical Symbols
IEC-60156	Method for the Determination of the Electrical Strength of Insulation Oils
IEC-60270	Partial Discharge Measurements
IEC-60376	Specification and Acceptance of New Sulphur Hexafluoride
IEC-60437	Radio Interference Test on High Voltage Insulators
IEC-60507	Artificial Pollution Tests on High Voltage Insulators to be used on AC Systems
IEC-62271-1	Common Specification for High Voltage Switchgear & Control gear Standards
IEC-60815	Guide for the Selection of Insulators in respect of Polluted Conditions

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
IEC-60865 (P1 & P2)	Short Circuit Current - Calculation of effects
ANSI-C.1/NFPA.70	National Electrical Code
ANSI-C37.90A	Guide for Surge Withstand Capability (SWC) Tests
ANSI-C63.21, C63.3	Specification for Electromagnetic Noise and Field Strength Instrumentation 10 KHz to 1 GHZ
C36.4ANSI-C68.1	Techniquet for Dielectric Tests
ANSI-C76.1/EEE21	Standard General Requirements and Test Procedure for Outdoor Apparatus Bushings
ANSI-SI-4	Specification for Sound Level Meters
ANSI-Y32-2/C337.2	Drawing Symbols
ANSI-Z55.11	Gray Finishes for Industrial Apparatus and Equipment No. 61 Light Gray
NEMA-107T	Methods of Measurements of RIV of High Voltage Apparatus
NEMA-ICS-II	General Standards for Industrial Control and Systems Part ICSI-109
CISPR-1	Specification for CISPR Radio Interference Measuring Apparatus for the frequency range 0.15 MHz to 30 MHz
CSA-Z299.1-1978h	Quality Assurance Program Requirements
CSA-Z299.2-1979h	Quality Control Program Requirements
CSA-Z299.3-1979h	Quality Verification Program Requirements
CSA-Z299.4-1979h	Inspection Program Requirements
<b>TRANSFORMERS AND REACTORS</b>	
IS:10028 (Part 2 & 3)	Code of practice for selection, installation & maintenance of Transformers (P1:1993), (P2:1991), (P3:1991)
IS-2026 (P1 to P4)	Power Transformers
IS-3347 (part 1 to Part 8)	Dimensions for Porcelain transformer Bushings for use in lightly polluted atmospheres
IS-3639	Fittings and Accessories for Power Transformers
IS-6600	Guide for Loading of oil immersed Transformers
IEC-60076 (Part 1 to 5)	Power Transformers
IEC-60214	On-Load Tap-Changers
IEC-60289	Reactors
IEC- 60354	Loading Guide for Oil - Immersed power transformers
IEC-60076-10	Determination of Transformer and Reactor Sound Levels
ANSI-C571280	General requirements for Distribution, Power and Regulating Transformers
ANSI-C571290	Test Code for Distribution, Power and Regulation Transformers
ANSI-C5716	Terminology & Test Code for Current Limiting Reactors
ANSI-C5721	Requirements, Terminology and Test Code for Shunt Reactors Rated Over 500 KVA
ANSI-C5792	Guide for Loading Oil-Immersed Power Transformers upto and including 100 MVA with 55 deg C or 65 deg C Winding Rise

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
ANSI-CG,1EEE-4	Standard Techniques for High Voltage Testing
IEC 60076	Power transformers
IEC 60076-1	Part 1: General
IEC 60076-2	Part 2: Temperature rise
IEC 60076-3	Part 3: Insulation levels, dielectric tests and external clearances in air
IEC 60076-4	Part 4: Guide to the lightning impulse and switching impulse testing - Power transformers and reactors
IEC 60076-3-1	Part 3-1: Insulation Levels and Dielectric Tests –External Clearances in Air
IEC 60076-5	Part 5: Ability to withstand short circuit
IEC 60076-6	Part 6: Reactors
IEC 60076-7	Part 7: Loading guide for oil-immersed power transformers
IEC 60076-8	Part 8: Application guide
IEC 60076-10	Part 10: Determination of sound levels
IEC 60076-10-1	Part 10-1: Determination of sound levels - Application guide
IEC 60076-11	Part 11: Dry-type transformers
IEC 60076-12	Part 12: Loading guide for dry-type power transformers
IEC 60076-13	Part 13: Self-protected liquid-filled transformers
IEC 60076-14	Part 14: Design and application of liquid-immersed power transformers using high-temperature insulation materials
IEC 60076-15	Part 15: Gas-filled power transformers
IEC 60076-16	Part 16: Transformers for wind turbine applications
IEC 60076-18	Part 18: Measurement of frequency response
IEC 60076-19	Part 19: Rules for the determination of uncertainties in the measurement of losses in power transformers and reactors
IEC 60076-21	Part 21: Standard requirements, terminology, and test code for step-voltage regulators
IEC 60044, BS 3938	Current transformers
IEC 60050	International Electrotechnical Vocabulary
IEC 60050(421)	International Electrotechnical vocabulary- Chapter 421 : Power Transformers and Reactors
IEC 60060	High Voltage test techniques
IEC 60060-1	General definitions and test requirements
IEC 60060-2	Measuring systems
IEC 60071	Insulation co-ordination
IEC 60071-1	Part 1: Definitions, principles and rules
IEC 60071-2	Part 2 : Application guide
IEC 60137	Bushing for alternating voltage above 1000V
IEC 60214	On-Load Tap changers
IEC 255-21-3	Relays vibration

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IEC 60270	Partial discharge measurements
IEC 60296	Specification for Unused Mineral Oil for Transformers and Switchgear
IEC 60422	Supervision and Maintenance guide for Mineral Insulating Oil in Electrical Equipment
IEC 60475	Method of Sampling Liquid dielectrics
IEC 60529	Classification of Degrees of Protection provided by Enclosures
IEC 60542	Application Guide for On-Load Tap-Changers
IEC 60567	Guide for the Sampling of Gases and of Oil from Oil-filled Electrical Equipment for the Analysis of Free and Dissolved Gases
IEC 60651	Sound Level Meters
IEC 61083	Digital Recorders and Software for High Voltage Impulse testing
IEC 61083-1	Part 1: Requirements for digital recorders in high voltage impulse tests
IEC 61083-2	Part 2: Evaluation of software used for the determination of the parameters of impulse waveforms
CISPR 16	Specification for radio disturbance and immunity measuring apparatus
CISPR 16-1	Radio disturbance and immunity measuring apparatus
CISPR-18	Radio Interference Characteristics of Power Lines and High Voltage Equipment
ISO 9001	Quality system-Model for Quality Assurance in Design /development
Cigre Publication 202	Guidelines for conducting design reviews for transformers 100 MVA and 123 kV and above. August 2002-Cigre Working Group 12.22
WG 12-15	Guide for Customers Specifications for Transformers 100 MVA and 123 kV and above
WG 12 19	Short Circuit Performance of Transformers.
BS-4360	Specification for weldable structural steel
BS-5135	Specification for arc welding of carbon and carbon manganese steels
BS-5500	Specification for unfired fusion welded pressure vessels
IS-3618	Specification for phosphate treatment of iron & steel for protection against corrosion
IS-6005	Code of practice for phosphating of Iron and Steel
ISO-8501	Preparation of steel surface before application of Paints and related product
IEC-60599	Mineral oil impregnated electrical equipment in service – guide to the interpretation of dissolved and free gases analysis
IS-10593	Method of evaluating the analysis of gases in oil filled electrical equipment in service
IS-2099	Bushings for alternating voltages above 1000 volts

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS-3347 Part I to 8	Dimension for porcelain transformer bushing
DIN-42530	Bushing up to 1000kV from 250A-5000A for liquid filled Transformer
IS-2026 Part 1 to 5	Power transformer
IS-4691	Degrees of protection provided by enclosure for rotating electrical machinery
IEC-60034-5	Degrees of protection provided by integral design of rotating electrical machines(IP Code) classification
IS:325 / IEC -60034	Performance of cooling fan / oil pump motor
IS-13947 part 1 to 5	Specification for low voltage switchgear and control gear
IS:3400	Methods of test for vulcanised rubber
IS:7016 part 1 to 14	Methods of test for coated and treated fabrics
IS:803	Code of practice for design, fabrication and erection of vertical mild steel cylindrical welded oil storage tanks.
IS:3637	Gas operated Relays
IS:335	New Insulating oils – Specification
IEC-62271-203	Gas insulated metal enclosed switchgear for rated voltage above 52kV
IEC-61639	Direct connection between power transformers and gas-insulated metal enclosed switchgear for rated voltages of 52.5 kV and above.
IS:3400 / BS 903 / IS:7016	Air cell ( Flexible Air Separator)
IEC 60529 / IP : 55	Degree of protection for cooler control cabinet , MOLG, Cooling fan , oil pump, Buchholz Relay
IEC 60529 / IP : 56	Degree of protection for Pressure Relief Device
IEC 60529 / IP : 43	Degree of protection for Remote tap Changer cubicle (RTCC)
<b>CIRCUIT BREAKERS</b>	
IEC-62271-100	High-voltage switchgear and control gear - Part 100: Alternating current circuit-breakers
IEC-62271-101	High-voltage switchgear and control gear - Part 101: Synthetic testing
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1000 V
IEC-62271-110	High-voltage switchgear and control gear - Part 110: Inductive load switching
IEC-62271-109	High-voltage switchgear and control gear - Part 110: Inductive load switching
<b>CURRENT TRANSFORMERS, VOLTAGE TRANSFORMERS AND COUPLING CAPACITOR VOLTAGE TRANSFORMERS</b>	
IS-2705- (P1 to P4)	Current Transformers

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:3156- (P1 to P4)	Voltage Transformers
IS-4379	Identification of the Contents of Industrial Gas Cylinders
IEC-61869 (Part-1)	Instrument transformers - Part 1: General requirements
IEC-61869 (Part-2)	Instrument transformers - Part 2: Additional requirements for current transformers
IEC-61869 (Part-3)	Instrument transformers - Part 3: Additional requirements for inductive voltage transformers
IEC-61869 (Part-4)	Instrument transformers - Part 4: Additional requirements for combined transformers
IEC-61869 (Part-5)	Instrument transformers - Part 5: Additional requirements for capacitor voltage transformers
IEC-61869 (Part-6)	Instrument transformers - Part 6: Additional general requirements for low-power instrument transformers
IEC-61869 (Part-9)	Instrument transformers - Part 9: Digital interface for instrument transformers
IEC-61869 (Part-102)	Instrument transformers - Part 102: Ferroresonance oscillations in substations with inductive voltage transformers
IEC-61869 (Part-103)	Instrument transformers - The use of instrument transformers for power quality measurement
<b>BUSHING</b>	
IS-2099	Bushings for Alternating Voltages above 1000V
IEC-60137	Insulated Bushings for Alternating Voltages above 1000V
<b>SURGE ARRESTERS</b>	
IS-3070 (PART2)	Lightning arresters for alternating current systems : Metal oxide lightning arrestors without gaps
IEC-60099-4	Metal oxide surge arrestors without gaps
IEC-60099-5	Selection and application recommendation
ANSI-C62.1	IEE Standards for S A for AC Power Circuits
NEMA-LA 1	Surge Arresters
<b>CUBICLES AND PANELS &amp; OTHER RELATED EQUIPMENTS</b>	
IS-722, IS-1248	Electrical relays for power system
IS-3231, 3231 (P-3)	Protection
IS:5039	Distributed pillars for Voltages not Exceeding 1000 Volts
IEC-60068.2.2	Basic environmental testing procedures Part 2: Test B: Dry heat
IEC-60529	Degree of Protection provided by enclosures
IEC-60947-4-1	Low voltage switchgear and control gear
IEC-61095	Electromechanical Contactors for household and similar purposes
IEC-60439 (P1 & 2)	Low Voltage Switchgear and control gear assemblies
ANSI-C37.20	Switchgear Assemblies, including metal enclosed bus
ANSI-C37.50	Test Procedures for Low Voltage Alternating Current Power

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
	Circuit Breakers
ANSI-C39	Electric Measuring instrument
ANSI-C83	Components for Electric Equipment
IS: 8623: (Part I to 3)	Specification for Switchgear & Control Assemblies
NEMA-AB	Moulded Case Circuit and Systems
NEMA-CS	Industrial Controls and Systems
NEMA-PB-1	Panel Boards
NEMA-SG-5	Low voltage Power Circuit breakers
NEMA-SG-3	Power Switchgear Assemblies
NEMA-SG-6	Power switching Equipment
NEMA-5E-3	Motor Control Centers
1248 (P1 to P9)	Direct acting indicating analogue electrical measuring instruments & their accessories
<b>Disconnecting switches</b>	
IEC-62271-102	High-voltage switchgear and control gear - Part 102: Alternating current disconnectors and earthing switches
IEC-60265 (Part 1 & 2)	High Voltage switches
ANSI-C37.32	Schedule of preferred Ratings, Manufacturing Specifications and Application Guide for high voltage Air Switches, Bus supports and switch accessories
ANSI-C37.34	Test Code for high voltage air switches
NEMA-SG6	Power switching equipment
<b>PLCC and line traps</b>	
IS-8792	Line traps for AC power system
IS-8793	Methods of tests for line traps
IS-8997	Coupling devices for PLC systems
IS-8998	Methods of test for coupling devices for PLC systems
IEC-60353	Line traps for A.C. power systems
IEC-60481	Coupling Devices for power line carrier systems
IEC-60495	Single sideboard power line carrier terminals
IEC-60683	Planning of (single Side-Band) power line carrier systems
CIGRE	Teleprotection report by Committee 34 & 35
CIGRE	Guide on power line carrier 1979
CCIR	International Radio Consultative Committee
CCITT	International Telegraph & Telephone Consultative Committee
EIA	Electric Industries Association
<b>Protection and control equipment</b>	
IEC-60051: (P1 to P9)	Recommendations for Direct Acting indicating analogue electrical measuring instruments and their accessories
IEC-60255 (Part 1 to 23)	Electrical relays
IEC-60297 (P1 to P4)	Dimensions of mechanical structures of the 482.6mm (19 inches)

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
	series
IEC-60359	Expression of the performance of electrical & electronic measuring equipment
IEC-60387	Symbols for Alternating-Current Electricity meters
IEC-60447	Man machine interface (MMI) - Actuating principles
IEC-60521	Class 0.5, 1 and 2 alternating current watt hour metres
IEC-60547	Modular plug-in Unit and standard 19-inch rack mounting unit based on NIM Standard (for electronic nuclear instruments)
ANSI-81	Screw threads
ANSI-B18	Bolts and Nuts
ANSI-C37.1	Relays, Station Controls etc
ANSI-C37.2	Manual and automatic station control, supervisory and associated telemetering equipment
ANSI-C37.2	Relays and relay systems associated with electric power apparatus
ANSI-C39.1	Requirements for electrical analog indicating instruments
<b>MOTORS</b>	
IS-325	Three phase induction motors
IS-4691	Degree of protection provided by enclosure for rotating electrical machinery
IEC-60034 (P1 to P19:)	Rotating electrical machines
IEC-Document 2	Three phase induction motors
(Central Office) NEMA-MGI	Motors and Generators
<b>Electronic equipment and components</b>	
MIL-21B, MIL-833 & MIL-2750	Environmental testing
EC-60068 (P1 to P5)	Printed boards
IEC-60326 (P1 to P2)	Material and workmanship standards
IS-1363 (P1 to P3)	Hexagon head bolts, screws and nuts of product grade C
IS-1364 (P1 to P5)	Hexagon head bolts, screws and nuts of products grades A and B
IS-3138	Hexagonal Bolts and Nuts (M42 to M150)
ISO-898	Fasteners: Bolts, screws and studs
ASTM	Specification and tests for materials
<b>Clamps &amp; connectors</b>	
IS-5561	Electric power connectors
NEMA-CC1	Electric Power connectors for sub station
NEMA-CC 3	Connectors for Use between aluminium or aluminum-Copper Overhead Conductors
<b>Bus hardware and insulators</b>	
IS: 2121	Fittings for Aluminum and steel cored Al conductors for overhead

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
	power lines
IS-731	Porcelain insulators for overhead power lines with a nominal voltage greater than 1000 V
IS-2486 (P1 to P4)	Insulator fittings for overhead power lines with a nominal voltage greater than 1000 V
IEC-60120	Dimensions of Ball and Socket Couplings of string insulator units
IEC-60137	Insulated bushings for alternating voltages above 1000 V
IEC-60168	Tests on indoor and outdoor post insulators of ceramic material or glass for Systems with Nominal Voltages Greater than 1000 V
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1 000 V
IEC-60273	Characteristics of indoor and outdoor post insulators for systems with nominal voltages greater than 1000V
IEC-61462	Pressurized and un-pressurized insulator for use in electrical equipment with rated voltage greater than 1000V – Definitions, Test methods, acceptance criteria and design recommendations
IEC-60305	Insulators for overhead lines with nominal voltage above 1000V-ceramic or glass insulator units for ac systems Characteristics of String Insulator Units of the cap and pin type
IEC-60372 (1984)	Locking devices for ball and socket couplings of string insulator units : dimensions and tests
IEC-60383 (P1 and P2)	Insulators for overhead lines with a nominal voltage above 1000 V
IEC-60433	Characteristics of string insulator units of the long rod type
IEC-60471	Dimensions of Clevis and tongue couplings of string insulator units
ANSI-C29	Wet process porcelain insulators
ANSI-C29.1	Test methods for electrical power insulators
ANSI-C92.2	For insulators, wet-process porcelain and toughened glass suspension type
ANSI-C29.8	For wet-process porcelain insulators apparatus, post-type
ANSI-G.8	Iron and steel hardware
CISPR-7B	Recommendations of the CISPR, tolerances of form and of Position, Part 1
ASTM A-153	Zinc Coating (Hot-Dip) on iron and steel hardware
<b>Strain and rigid bus-conductor</b>	
IS-2678	Dimensions & tolerances for Wrought Aluminum and Aluminum Alloys drawn round tube
IS-5082	Wrought Aluminum and Aluminum Alloy Bars. Rods, Tubes and Sections for Electrical purposes
ASTM-B 230-82	Aluminum 1350 H19 Wire for electrical purposes

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
ASTM-B 231-81	Concentric - lay - stranded, aluminum 1350 conductors
ASTM-B 221	Aluminum - Alloy extruded bar, rod, wire, shape
ASTM-B 236-83	Aluminum bars for electrical purpose (Bus-bars)
ASTM-B 317-83	Aluminum-Alloy extruded bar, rod, pipe and structural shapes for electrical purposes (Bus Conductors)
<b>Batteries</b>	
IS:1651	Stationary Cells and Batteries, Lead-Acid Type (with Tubular Positive Plates)
IS:1652	Stationary Cells and Batteries, Lead-Acid Type (with Plante Positive Plates)
IS:1146	Rubber and Plastic Containers for Lead-Acid Storage Batteries
IS:6071	Synthetic Separators for Lead-Acid Batteries
IS:266	Specification for Sulphuric Acid
IS:1069	Specification for Water for Storage Batteries
IS:3116	Specification for Sealing Compound for Lead-Acid Batteries
IS:1248	Indicating Instruments
IS:10918	Vented type nickel Cadmium Batteries
IEC:60896-21&22	Lead Acid Batteries Valve Regulated types – Methods of Tests & Requirements
IEC: 60623	Vented type nickel Cadmium Batteries
IEC:60622	Secondary Cells & Batteries – Sealed Ni-Cd rechargeable single cell
IEC:60623	Secondary Cells & Batteries – Vented Ni-Cd rechargeable single cell
IEC:60896-11	Stationary Lead Acid Batteries – Vented Type – General requirements & method of tests
IEEE-485	Recommended practices for sizing of Lead Acid Batteries
IEEE-1115	Sizing of Ni-Cd Batteries
IEEE-1187	Recommended practices for design & installation of VRLA Batteries
IEEE-1188	Recommended practices for design & installation of VRLA Batteries
IEEE-1189	Guide for selection of VRLA Batteries
<b>Battery Charger</b>	
IS:3895	Mono-crystalline Semiconductor Rectifier Cells and Stacks
IS:4540	Mono-crystalline Semiconductor Rectifier Assemblies and Equipment
IS:6619	Safety Code for Semiconductor Rectifier Equipment
IS:2026	Power Transformers

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
IS:2959	AC Contactors for Voltages not Exceeding 1000 Volts
IS:1248	Indicating Instruments
IS:2208	HRC Fuses
IS:13947 (Part-3)	Air break switches, air break disconnectors & fuse combination units for voltage not exceeding 1000V AC or 1200V DC
IS:2147	Degree of protection provided by enclosures for low voltage switchgear and control gear
IS:6005	Code of practice for phosphating of Iron and Steel
IS:3231	Electrical relays for power system protection
IS:3842	Electrical relay for AC Systems
IS:5	Colours for ready mix paint
IEEE-484	Recommended Design for installation design and installation of large lead storage batteries for generating stations and substations
IEEE-485	Sizing large lead storage batteries for generating stations and substations
<b>Wires and cables</b>	
ASTMD-2863	Measuring the minimum oxygen concentration to support candle like combustion of plastics (oxygen index)
IS-694	PVC insulated cables for working voltages upto and including 1100 Volts
IS-1255	Code of practice for installation and maintenance of power cables, upto and including 33 kV rating
IS-1554 (P1 and P2)	PVC insulated (heavy duty) electric cables (part 1) for working voltage upto and including 1100 V Part (2) for working voltage from 3.3 kV upto and including 11kV
IS:1753	Aluminium conductor for insulated cables
IS:2982	Copper Conductor in insulated cables
IS-3961 (P1 to P5)	Recommended current ratings for cables
IS-3975	Mild steel wires, formed wires and tapes for armouring of cables
IS-5831	PVC insulating and sheath of electric cables
IS-6380	Elastometric insulating and sheath of electric cables
IS-7098	Cross linked polyethylene insulated PVC sheathed cables for working voltage upto and including 1100 volts
IS-7098	Cross-linked polyethylene insulated PVC sheathed cables for working voltage from 3.3kV upto and including 33 kV
IS-8130	Conductors for insulated electrical cables and flexible cords
IS-1753	Aluminum Conductors for insulated cables
IS-10418	Specification for drums for electric cables
IEC-60096 (part 0 to p4)	Radio Frequency cables
IEC-60183	Guide to the Selection of High Voltage Cables

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IEC-60189 (P1 to P7)	Low frequency cables and wires with PVC insulation and PVC sheath
IEC-60227 (P1 to P7)	Polyvinyl Chloride insulated cables of rated voltages up to and including 450/750V
IEC-60228	Conductors of insulated cables
IEC-60230	Impulse tests on cables and their accessories
IEC-60287 (P1 to P3)	Calculation of the continuous current rating of cables (100% load factor)
IEC-60304	Standard colours for insulation for low-frequency cables and wires
IEC-60331	Fire resisting characteristics of Electric cables
IEC-60332 (P1 to P3)	Tests on electric cables under fire conditions
IEC-60502	Extruded solid dielectric insulated power cables for rated voltages from 1 kV upto to 30 kV
IEC-754 (P1 and P2)	Tests on gases evolved during combustion of electric cables
<b>AIR conditioning and ventilation</b>	
IS-659	Safety code for air conditioning
IS-660	Safety code for Mechanical Refrigeration
ARI:520	Standard for Positive Displacement Refrigeration Compressor and Condensing Units
IS:4503	Shell and tube type heat exchanger
ASHRAE-24	Method of testing for rating of liquid coolers
ANSI-B-31.5	Refrigeration Piping
IS:2062	Steel for general structural purposes
IS:655	Specification for Metal Air Dust
IS:277	Specification for Galvanised Steel Sheets
IS-737	Specification for Wrought Aluminium and Aluminium Sheet & Strip
IS-1079	Hot rolled cast steel sheet & strip
IS-3588	Specification for Electrical Axial Flow Fans
IS-2312	Propeller Type AC Ventilation Fans
BS-848	Methods of Performance Test for Fans
BS-6540 Part-I	Air Filters used in Air Conditioning and General Ventilation
BS-3928	Sodium Flame Test for Air Filters (Other than for Air Supply to I.C. Engines and Compressors)
US-PED-2098	Method of cold DOP & hot DOP test
MIL-STD-282	DOP smoke penetration method
ASHRAE-52	Air cleaning device used in general ventilation for removing particle matter
IS:3069	Glossary of Terms, Symbols and Units Relating to Thermal Insulation Materials

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:4671	Expanded Polystyrene for Thermal Insulation Purposes
IS:8183	Bonded Mineral Wool
IS:3346	Evaluation of Thermal Conductivity properties by means of guarded hot plate method
ASTM-C-591-69	Standard specification for rigid preformed cellular urethane thermal insulation
IS:4894	Centrifugal Fans
BS:848	Method of Performance Test for Centrifugal Fans
IS:325	Induction motors, three-phase
IS:4722	Rotating electrical machines
IS:1231	Three phase foot mounted Induction motors, dimensions of
IS:2233	Designations of types of construction and mounting arrangements of rotating electrical machines
IS:2254	Vertical shaft motors for pumps, dimensions of
IS:7816	Guide for testing insulation resistance of rotating machines
IS:4029	Guide for testing three phase induction motors
IS: 4729	Rotating electrical machines, vibration of, Measurement and evaluation of
IS:4691	Degree of protection provided by enclosures for rotating electrical machinery
IS:7572	Guide for testing single-phase ac motors
IS:2148	Flame proof enclosure for electrical apparatus
BS:4999(Part-51)	Noise levels
<b>Galvanizing</b>	
IS-209	Zinc Ingot
IS-2629	Recommended Practice for Hot-Dip galvanizing on iron and steel
IS-2633	Methods for testing uniformity of coating of zinc coated articles
ASTM-A-123	Specification for zinc (Hot Galvanizing) Coatings, on products Fabricated from rolled, pressed and forged steel shapes, plates, bars and strips
ASTM-A-121-77	Zinc-coated (Galvanized) steel barbed wire
<b>Painting</b>	
IS-6005	Code of practice for phosphating of iron and steel
ANSI-Z551	Gray finishes for industrial apparatus and equipment
SSPEC	Steel structure painting council
<b>Fire protection system</b>	
--	Fire protection manual issued by tariff advisory committee (TAC) of India
<b>HORIZONTAL CENTRIFUGAL PUMPS</b>	
IS:1520	Horizontal centrifugal pumps for clear, cold and fresh water
IS:9137	Code for acceptance test for centrifugal & axial pumps

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:5120	Technical requirement – Rotodynamic special purpose pumps
API-610	Centrifugal pumps for general services Hydraulic Institutes Standards
BS:599	Methods of testing pumps
PTC-8.2	Power Test Codes - Centrifugal pumps
<b>DIESEL ENGINES</b>	
IS:10000	Methods of tests for internal combustion engines
IS:10002	Specification for performance requirements for constant speed compression ignition engines for general purposes (above 20 kW)
BS:5514	The performance of reciprocating compression ignition (Diesel) engines, utilizing liquid fuel only, for general purposes
ISO:3046	Reciprocating internal combustion engines performance
IS:554	Dimensions for pipe threads where pressure tight joints are required on threads
ASME Power Test Code	Internal combustion engine PTC-17
--	Codes of Diesel Engine Manufacturer's Association, USA
<b>PIPING VALVES &amp; SPECIALITIES</b>	
IS:636	Non percolating flexible fire-fighting delivery hose
IS:638	Sheet rubber jointing and rubber inserting jointing
IS:778	Gun metal gate, globe and check valves for general purpose
IS:780	Sluice valves for water works purposes (50 to 300 mm)
IS:901	Couplings, double male and double female instantaneous pattern for fire fighting
IS:902	Suction hose couplings for fire-fighting purposes
IS:903	Fire hose delivery couplings branch pipe nozzles and nozzle spanner
IS:1538	Cast iron fittings for pressure pipes for water, gas and sewage
IS:1903	Ball valve (horizontal plunger type) including floats for water supply purposes
IS:2062	SP for weldable structural steel
IS:2379	Colour Code for the identification of pipelines
IS:2643	Dimensions of pipe threads for fastening purposes
IS:2685	Code of Practice for selection, installation and maintenance of sluice valves
IS:2906	Sluice valves for water-works purposes (350 to 1200 mm size)
IS:3582	Basket strainers for fire-fighting purposes (cylindrical type)
IS:3589	Electrically welded steel pipes for water, gas and sewage (150 to 2000 mm nominal diameter)
IS:4038	Foot valves for water works purposes
IS:4927	Unlined flax canvas hose for fire fighting

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:5290	Landing valves (internal hydrant)
IS:5312 (Part-I)	Swing check type reflex (non-return) valves
IS:5306	Code of practice for fire extinguishing installations and equipment on premises
Part-I	Hydrant systems, hose reels and foam inlets
Part-II	Sprinkler systems
BS:5150	Specification for cast iron gate valves
<b>MOTORS &amp; ANNUNCIATION PANELS</b>	
IS:325	Three phase induction motors
IS:900	Code of practice for installation and maintenance of induction motors
IS:996	Single phase small AC and universal electric motors
IS:1231	Dimensions of three phase foot mounted induction motors
IS:2148	Flame proof enclosure of electrical apparatus
IS:2223	Dimensions of flange mounted AC induction motors
IS:2253	Designations for types of construction and mounting arrangements of rotating electrical machines
IS:2254	Dimensions of vertical shaft motors for pumps
IS:3202	Code of practice for climate proofing of electrical equipment
IS:4029	Guide for testing three phase induction motors
IS:4691	Degree of protection provided by enclosure for rotating electrical machinery
IS:4722	Rotating electrical machines
IS:4729	Measurement and evaluation of vibration of rotating electrical machines
IS:5572	Classification of hazardous areas for electrical (Part-I) installations (Areas having gases and vapours)
IS:6362	Designation of methods of cooling for rotating electrical machines
IS:6381	Construction and testing of electrical apparatus with type of protection 'e'
IS:7816	Guide for testing insulation for rotating machine
IS:4064	Air break switches
IEC DOCUMENT 2 (Control Office) 432	Three Phase Induction Motor
VDE 0530 Part I/66	Three Phase Induction Motor
IS:9224 (Part-II)	HRC Fuses
IS:6875	Push Button and Control Switches
IS:694	PVC Insulated cables
IS:1248	Indicating instruments
IS:375	Auxiliary wiring & busbar markings

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:2147	Degree of protection
IS:5	Colour Relay and timers
IS:2959	Contactors
<b>PG Test Procedures</b>	
NFPA-13	Standard for the installation of sprinkler system
NFPA-15	Standard for water spray fixed system for the fire protection
NFPA-12A	Standard for Halong 1301 Fire Extinguishing System
NFPA-72E	Standard on Automatic Fire Detectors
--	Fire Protection Manual by TAC (Latest Edition)
NFPA-12	Standard on Carbon dioxide extinguisher systems
IS:3034	Fire of industrial building
--	Electrical generating and distributing stations code of practice
IS:2878	CO2 (Carbon dioxide) Type Extinguisher
IS:2171	DC (Dry Chemical Powder) type
IS:940	Pressurised Water Type
<b>D.G. SET</b>	
IS:10002	Specification for performance requirements for constant speed compression ignition (diesel engine) for general purposes
IS:10000	Method of tests for internal combustion engines
IS:4722	Rotating electrical machines-specification
IS:12063	Degree of protection provided by enclosures
IS:12065	Permissible limit of noise levels for rotating electrical machines
--	Indian Explosive Act 1932
<b>Steel structures</b>	
IS-228 (1992)	Method of Chemical Analysis of pig iron, cast iron and plain carbon and low alloy steels.
IS-802 (P1 to 3)	Code of practice for use of structural steel in overhead transmission line towers
IS-806	Code of practice for use of steel tubes in general building construction
IS-808	Dimensions for hot rolled steel beam, column channel and angle sections
IS-814	Covered electrodes for manual arc welding of carbon of carbon manganese steel
IS-816	Code of Practice for use of metal arc welding for general construction in Mild steel
IS-817	Code of practice for training and testing of metal arc welders. Part 1 : Manual Metal arc welding
IS-875 (P1 to P4)	Code of practice for design loads (other than earthquake) for buildings and structures
IS-1161	Steel tubes for structural purposes

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS-1182	Recommended practice for radiographic examination of fusion welded butt joints in steel plates
IS-1363 (P1 to P3)	Hexagonal head bolts, screws & nuts of products grade C
IS-1364	Hexagon head bolts, screws and nuts of product grades A and B
IS-1367 (P1 to P18)	Technical supply condition for threaded steel fasteners
IS-1599	Methods for bend test
IS-1608	Method for tensile testing of steel products
IS-1893	Criteria for earthquake resistant design of structures
IS-1978	Line Pipe
IS-2062	Steel for general structural purposes
IS-2595	Code of practice for Radiographic testing
IS-3063	Single coil rectangular section spring washers for bolts, nuts and screws
IS-3664	Code of practice for ultrasonic pulse echo testing by contact and immersion methods
IS-7205	Safety code for erection of structural steel work
IS-9595	Recommendations for metal arc welding of carbon and carbon manganese steels
ANSI-B18.2.1	Inch series square and Hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
ANSI-G8.14	Round head bolts
ASTM-A6	Specification for General Requirements for rolled steel plates, shapes, sheet piling and bars of structural use
ASTM-A36	Specifications of structural steel
ASTM-A47	Specification for malleable iron castings
ASTM-A143	Practice for safeguarding against embilement of Hot Galvanized structural steel products and procedure for detaching embriement
ASTM-A242	Specification for high strength low alloy structural steel
ASTM-A283	Specification for low and intermediate tensile strength carbon steel plates of structural quality
ASTM-A394	Specification for Galvanized steel transmission tower bolts and nuts
ASTM-441	Specification for High strength low alloy structural manganese vanadium steel
ASTM-A572	Specification for High strength low alloy colombium-Vanadium steel of structural quality
AWS D1-0	Code for welding in building construction welding inspection
AWS D1-1	Structural welding code
AISC	American institute of steel construction
NEMA-CG1	Manufactured graphite electrodes

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
<b>Piping and pressure vessels</b>	
IS-1239 (Part 1 and 2)	Mild steel tubes, tubulars and other wrought steel fittings
IS -3589	Seamless Electrically welded steel pipes for water, gas and sewage
IS-6392	Steel pipe flanges
ASME	Boiler and pressure vessel code
ASTM-A120	Specification for pipe steel, black and hot dipped, zinc-coated (Galvanized) welded and seamless steel pipe for ordinary use
ASTM-A53	Specification for pipe, steel, black, and hot-dipped, zinc coated welded and seamless
ASTM-A106	Seamless carbon steel pipe for high temperature service
ASTM-A284	Low and intermediate tensile strength carbon-silicon steel plates for machine parts and general construction
ASTM-A234	Pipe fittings of wrought carbon steel and alloy steel for moderate and elevated temperatures
ASTM-S181	Specification for forgings, carbon steel for general purpose piping
ASTM-A105	Forgings, carbon steel for piping components
ASTM-A307	Carbon steel externally threaded standard fasteners
ASTM-A193	Alloy steel and stainless steel bolting materials for high temperature service
ASTM-A345	Flat rolled electrical steel for magnetic applications
ASTM-A197	Cupola malleable iron
ANSI-B2.1	Pipe threads (Except dry seal)
ANSI-B16.1	Cast iron pipe flanges and flanged fitting. Class 25, 125, 250 and 800
ANSI-B16.1	Malleable iron threaded fittings, class 150 and 300
ANSI-B16.5	Pipe flanges and flanged fittings, steel nickel alloy and other special alloys
ANSI-B16.9	Factory-made wrought steel butt welding fittings
ANSI-B16.11	Forged steel fittings, socket-welding and threaded
ANSI-B16.14	Ferrous pipe plug, bushings and locknuts with pipe threads
ANSI-B16.25	Butt welding ends
ANSI-B18.1.1	Fire hose couplings screw thread
ANSI-B18.2.1	Inch series square and hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
ANSI-B18.21.1	Lock washers
ANSI-B18.21.2	Plain washers
ANSI-B31.1	Power piping
ANSI-B36.10	Welded and seamless wrought steel pipe
ANSI-B36.9	Stainless steel pipe
<b>Other civil works standards</b>	

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS-269	33 grade ordinary portland cement
IS2721	Galvanized steel chain link fence fabric
IS-278	Galvanized steel barbed wire for fencing
IS-383	Coarse and fine aggregates from natural sources for concrete
IS-432 (P1 and P2)	Mild steel and medium tensile steel bars and hard-dawn steel wire for concrete reinforcement
IS-456	Code of practice for plain and reinforced concrete
IS-516	Method of test for strength of concrete
IS-800	Code of practice for general construction in steel
IS-806	Steel tubes for structural purposes
IS-1172	Basic requirements for water supply, drainage and sanitation
IS-1199	Methods of sampling and analysis of concrete
IS-1566	Hard-dawn steel wire fabric for concrete reinforcement
IS-1742	Code of Practice for Building drainage
IS-1785	Plain hard-drawn steel wire for pre-stressed concrete
IS-1786	High strength deformed Steel Bars and wires for concrete reinforcement
IS-1811	Methods of sampling Foundry sands
IS-1893	Criteria for earthquake resistant design of structures
IS-2062	Steel for general structural purposes
IS-2064	Selection, installation and maintenance of sanitary appliances- code of practices
IS-2065	Code of practice for water supply in buildings
IS-2090	High tension steel bars used in pre-stressed concrete
IS-2140	Standard Galvanized steel wire for fencing
IS-2470 (P1 & P2)	Code of practice for installation of septic tanks
IS-2514	Concrete vibrating tables
IS-2645	Integral cement waterproofing compounds
IS-3025 (Part 1 to Part 48)	Methods of sampling and test (Physical and chemical) for water and waste water
IS-4091	Code of practice for design and construction of foundations for transmission line towers and poles
IS-4111 (Part 1 to P5)	Code of practice for ancillary structures in sewerage system
IS-4990	Plywood for concrete shuttering work
IS-5600	Sewage and drainage pumps
<b>National building code of India 1970</b>	
USBR E12	Earth Manual by United States Department of the interior Bureau of Reclamation
ASTM-A392-81	Zinc/Coated steel chain link fence fabric
ASTM-D1557-80	test for moisture-density relation of soils using 10-lb (4.5 kg)

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
	rame land 18-in. (457 mm) Drop
ASTM-D1586(1967)	Penetration Test and Split-Barrel Sampling of Soils
ASTM-D2049-69	Test Method for Relative Density of Cohesionless Soils
ASTM-D2435	Test method for Unconsolidated, (1982) Undrained Strengths of Cohesive Soils in Triaxial Compression
BS-5075	Specification for accelerating Part I Admixtures, Retarding Admixtures and Water Reducing Admixtures
CPWD	Latest CPWD specifications
<b>ACSR MOOSE CONDUCTOR</b>	
IS:6745 BS:443-1969	Methods for Determination of Mass of zinc coating on zinc coated Iron and Steel Articles
IS:8263	Methods for Radio Interference
IEC:437-1973 NEMA:107-1964 CISPR	Test on High Voltage Insulators
IS:209, BS:3436-1961	Zinc Ingot
IS:398 Part - V IEC:209-1966	Aluminum Conductors for Overhead Transmission Purposes
BS:215(Part-II), IEC:209-1966	Aluminium Conductors galvanized steel reinforced extra high voltage (400 kV and above)
IS:1778, BS:1559-1949	Reels and Drums for Bare Conductors
IS:1521, ISO/R89-1959	Method for Tensile Testing of steel wire
IS:2629	Recommended practice for Hot dip Galvanising on Iron and Steel
IS:2633	Method for Testing Uniformity of coating of zinc Coated Articles
IS:4826/ ASTMA-472-729	Hot dip galvanised coatings on round steel wires
<b>GALVANISED STEEL EARTHWIRE</b>	
IS:1521, ISO/R:89-1959	Method for Tensile Testing of Steel Wire
IS:1778	Reels and Drums for Bare Conductors
IS:2629	Recommended practice for Hot Dip Galvanising on Iron and Steel
IS:2633	Methods for testing Uniformity of Coating of Zinc Coated Articles
IS:4826/ ASTM: A 475-72a BS:443-1969	Hot dip Galvanised Coatings on Round Steel Wires
IS:6745/ BS:443-1969	Method for Determination of mass of Zinc Coating on Zinc coated Iron and Steel Articles.
IS:209/ BS:3463-1961	Zinc ingot
IS:398 (Pt. I to P5:1992)/ BS:215 (Part-II	Aluminum Conductors for overhead transmission purposes

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
<b>Lighting Fixtures and Accessories</b>	
IS:1913	General and safety requirements for electric lighting fittings
IS:3528	Water proof electric lighting fittings
IS:4012	Dust proof electric lighting fittings
IS:4013	Dust tight proof electric lighting fittings
IS:10322	Industrial lighting fittings with metal reflectors
IS:10322	Industrial lighting fittings with plastic reflectors
IS:2206	Well glass lighting fittings for use under ground in mines (non-flameproof type)
IS:10322	Specification for flood light
IS:10322	Specification for decorative lighting outfits
IS:10322	Luminaries for street lighting
IS:2418	Tubular fluorescent lamps
IS:9900	High pressure mercury vapour lamps
IS:1258	Specification for Bayonet lamp fluorescent lamp
IS:3323	Bi-pin lamp holder tubular fluorescent lamps
IS:1534	Ballasts for use in fluorescent lighting fittings. (Part-I)
IS:1569	Capacitors for use in fluorescent lighting fittings
IS:2215	Starters for fluorescent lamps
IS:3324	Holders for starters for tubular fluorescent lamps
IS:418	GLS lamps
IS:3553	Water tight electric fittings
IS:2713	Tubular steel poles
IS:280	MS wire for general engg. Purposes
<b>Conduits, Accessories and Junction Boxes</b>	
IS:9537	Rigid steel conduits for electrical wiring
IS:3480	Flexible steel conduits for electrical wiring
IS:2667	Fittings for rigid steel conduits for electrical wiring
IS:3837	Accessories for rigid steel conduits for electrical wiring
IS:4649	Adaptors for flexible steel conduits
IS:5133	Steel and Cast Iron Boxes
IS:2629	Hot dip galvanising of Iron & Steel
<b>Lighting Panels</b>	
IS:13947	LV Switchgear and Control gear(Part 1 to 5)
IS:8828	Circuit breakers for over current protection for house hold and similar installations
IS:5	Ready mix paints
IS:2551	Danger notice plates
IS:2705	Current transformers

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C

<b>CODES</b>	<b>TITLE</b>
IS:9224	HRC Cartridge fuse links for voltage above 650V(Part-2)
IS:5082	Wrought aluminium and Al. alloys, bars, rods, tubes and sections for electrical purposes
IS:8623	Factory built Assemblies of Switchgear and Control Gear for voltages upto and including 1000V AC and 1200V DC
IS:1248	Direct Acting electrical indicating instruments
<b>Electrical Installation</b>	
IS:1293	3 pin plug
IS:371	Two to three ceiling roses
IS:3854	Switches for domestic and similar purposes
IS:5216	Guide for safety procedures and practices in electrical work
IS:732	Code of practice for electrical wiring installation (system voltage not exceeding 650 Volts.)
IS:3043	Code of practice for earthing
IS:3646	Code of practice of interior illumination part II & III
IS:1944	Code of practice for lighting of public through fares
IS:5571	Guide for selection of electrical equipment for hazardous areas
IS:800	Code of practice for use of structural steel in general building construction
IS:2633	Methods of Testing uniformity of coating on zinc coated articles
IS:6005	Code of practice for phosphating iron and steel
	INDIAN ELECTRICITY ACT
	INDIAN ELECTRICITY RULES
<b>LT SWITCHGEAR</b>	
IS:8623 (Part-I)	Specification for low voltage switchgear and control gear assemblies
IS:13947 (Part-I)	Specification for low voltage switchgear and control gear, Part 1 General Rules
IS:13947 (part-2)	Specification for low voltage switchgear and control gear, Part 2 circuit breakers
IS:13947 (part-3)	Specification for low voltage switchgear and control gear. Part 3 Switches, Disconnectors, Switch-disconnectors and fuse combination units
IS:13947 (part-4)	Specification for low voltage switchgear and control gear. Part 4 Contactors and motors starters
IS:13947 (part-5)	Specification for low voltage switchgear and control gear. Part 5 Control-circuit devices and switching elements
IS:13947 (part-6)	Specification for low voltage switchgear and control gear. Part 6 Multiple function switching devices
IS:13947 (part-7)	Specification for low voltage switchgear and control gear. Part 7 Ancillary equipments
IS:12063	Degree of protection provided by enclosures

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

**ANNEXURE-C**

<b>CODES</b>	<b>TITLE</b>
IS:2705	Current Transformers
IS:3156	Voltage Transformers
IS:3231	Electrical relays for power system protection
IS:1248	Electrical indicating instruments
IS:722	AC Electricity meters
IS:5578	Guide for Marking of insulated conductors of apparatus terminals
IS:13703 (part 1)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 1 General Requirements
IS:13703 (part 2)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 2 Fuses for use of authorized persons
IS:6005	Code of practice of phosphating iron and steel
IS:5082	Wrought Aluminum and Aluminum alloys for electrical purposes
IS:2633	Hot dip galvanising

Note: If any standard is expired or does not exist anymore than other standard which has substituted it, shall be applicable.

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****Annexure-G****MQP & INSPECTION LEVEL REQUIREMENT**

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
A.01	LT Transformer /Power Transformer/ Reactor/ Converter Transformer/ Filter Reactor	MQP/ITP	IV
A.02	Bushing	MQP	IV
A.03	Insulating Oil	POWERGRID TS	III
A.04	Oil storage tank for transformers	MQP	III
A.05	Nitrogen injection based explosion prevention system	FAT/ITP	III
A.06	On Line oil drying system for transformers	POWERGRID TS	II**
A.07	On Line DGA and moisture monitoring system	POWERGRID TS	II**
A.08	Flow sensitive conservator isolation valve	POWERGRID TS	II**
A.09	Oil Filtration Machine	MQP	III
B.01	Circuit Breakers	MQP	IV
B.02	Current Transformers	MQP/ITP	IV
B.03	CVT/PT/IVT	MQP	IV
B.04	Isolators	MQP/ITP	IV
B.05	Surge Arrestors	MQP/ITP	III
B.06	Line Trap & Air Core Reactor	MQP/ITP	III
B.07	Point On switching device (CSD) for Circuit Breaker (wherever required)	FAT/ITP	IV
C.01	STATCOM including Valve, valve base electronics, DC capacitor, series reactor and all accessories	ITP	IV
C.02	Mechanically switched Reactor bank (3-ph) including all accessories (MSR Branches)	ITP	IV
C.03	Mechanically switched Capacitor bank (3-ph) including all accessories (MSC Branches)	ITP	IV
C.04	Harmonic Pass filters	ITP	IV
C.05	HT Capacitor	MQP	IV
D.01	Thyristor Valve	FAT/ITP	III
D.02	PLC Capacitors for HVDC	FAT/ITP	III
D.03	Valve Cooling system for	FAT/ITP	III

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

**Annexure-G**

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
	HVDC		
D.04	AC/DC Filter Resistors	ITP	III
D.05	DC Current and Voltage measuring device for HVDC	FAT/ITP	III
D.06	Maintenance platform for valve hall	POWERGRID TS	II
D.07	Optical signal column for FSC	FAT/ITP	II
E.01	GIS including spares	MQP/ITP	IV
E.02	Dew Point Meter for GIS	POWERGRID TS	I*
E.03	Portable Partial Discharge monitoring system for GIS	POWERGRID TS	I*
E.04	Partial Discharge Monitoring System (Online) for GIS	ITP	III
E.05	PEB Structure and Puf Panels	MQP	III
F.01	Substation Automation system	FAT/MQP	III
F.02	Event Logger	POWERGRID TS	III
F.03	PLCC equipment Viz PLCC Terminal ,Carrier equipment, Protection Coupler , Coupling Device but excluding EPAX / HF Cable	MQP	III
F.04	Control & Relay Panels	MQP	III
G.01	EHV Cables	MQP/ITP	III
G.02	Power Cables & Control Cables	MQP	III
G.03	Cable Joints (11 kV and above)	POWERGRID TS	II
G.04	Cable Lugs & Glands / Clamps/Terminations	POWERGRID TS	I
H.01	LT Switchgear & ACDB/DCDB/MLDB/ELDB	MQP	III
H.02	Battery	POWERGRID TS	II
H.03	Battery Charger	MQP	III
H.04	UPS & Voltage Stabilizer	MQP/FAT	III
H.05	D. G. Set	FAT/ITP	III
H.06	Lighting Panel	POWERGRID TS	II
H.07	Lighting Poles	POWERGRID TS	II
H.08.1	Lighting Fixtures, Lighting Earthwire, Switches / sockets, Conduits, Lamps & fans including exhaust fans	POWERGRID TS	I
H.8.2	Solar based LEDs System including street light/pole solar panel, Inverter controller/LED fixture	FAT	III
H.09	MS/GI /PVC Pipes for cable	POWERGRID TS	I

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****Annexure-G**

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
	trenches and lighting		
H.10	Outdoor Receptacle	POWERGRID TS	I
H.11	Split A.C/window A.C./ precision AC/ Kiosk AC/ Cascade AC/ Tower AC	POWERGRID TS	I
H.12	Occupancy sensors for control of lighting	POWERGRID TS	I
H.13	Solar based street lighting pole including Solar Panel, Inverter, Controller, etc.	POWERGRID TS	III
H.14	Junction Box / Lighting Switch Boards / Bay MB / Portable Flood Light Panel	POWERGRID TS	II
H.15	Lighting transformer	POWERGRID TS	II
I.01	SF6 gas processing unit, SF6 gas Leakage detector, SF6 gas Analyzer	POWERGRID TS	I*
I.02	SF6 Gas	POWERGRID TS	I
I.03	Spark Gap	FAT/ITP	III
I.04	Time synchronizing Equipment (GPS Clock)	POWERGRID TS	I
I.05	Galvanized Cable trays	POWERGRID TS	II
I.06	Video Monitoring System	FAT/ITP	I
I.07	Public Address System (All Components)	POWERGRID TS	I
I.08	Building Management System (All components)	POWERGRID TS	I
I.09	Access Control System (All Components)	POWERGRID TS	I
I.10	Video Display system/ Video Projection system	POWERGRID TS	I
I.11	VESDA (smoke detector)	POWERGRID TS	I
I.12	High Mast Pole	MQP	III
J.01	Aluminium ladder	POWERGRID TS	I
J.02	Hume Pipes	POWERGRID TS	I
J.03	Castle Key	POWERGRID TS	I
J.04	Water Treatment plant (All components).	POWERGRID TS	I
J.05	Furniture	POWERGRID TS	I
J.06	DOL Starter	POWERGRID TS	I
J.07	Oil Sample Bottles and Syringe	POWERGRID TS	I
J.08	Test & Measuring Equipment, T&P	POWERGRID TS	I*
K.01	EOT Crane	POWERGRID TS	II

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****Annexure-G**

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
K.02	Boom Crane/Golf Cart/Platform Truck/Man Lift/ Fork Lift/ Lifts	POWERGRID TS	II
L.00	Fire Protection System		
L.001	Panels, Hydro pneumatic tank for fire protection system.	POWERGRID TS	III
L.002	Deluge valve, Strainers, MS/GI pipes, Pumps, motors, air compressor, and other valves, Diesel Engines	POWERGRID TS	II
L.003	Others	POWERGRID TS	I
M.00	HVAC SYSTEM		
M.001	Air Cooled Chiller	POWERGRID TS	III
M.002	Pump	POWERGRID TS	II
M.003	Air Handling Unit	POWERGRID TS	II
M.004	Fan Filter Unit With Centrifugal Blower	POWERGRID TS	II
M.005	Axial Flow Fan	POWERGRID TS	II
M.006	Main Climate Control Unit (Dehumidifier)	POWERGRID TS	I
M.007	Dampers	POWERGRID TS	II
M.008	Fire Dampers	POWERGRID TS	II
M.009	Pressure Gauge, Thermometers, Other Instruments / Sensors	POWERGRID TS	I
M.010	Grill, Diffuser, Jet Nozzle, Louvers etc	POWERGRID TS	I
M.011	Ducting	POWERGRID TS	III
M.012	M S Pipe	POWERGRID TS	II
M.013	Pipe Insulation Material	POWERGRID TS	I
M.014	Duct Insulation Material	POWERGRID TS	I
M.015	Underdeck Insulation Material	POWERGRID TS	I
M.016	Gate Valve & Non Return valve	POWERGRID TS	I
M.017	Y Strainer	POWERGRID TS	II
M.018	Ball Valve/ Motorised Butterfly Valve/ Balancing Valve	POWERGRID TS	I
M.019	Closed Expansion Tank	POWERGRID TS	II
M.020	Air Separator	POWERGRID TS	I
M.021	MCC /PLC /Electrical Panels	POWERGRID TS	III
M.022	Propeller Fan/ Conduit	POWERGRID TS	II
M.023	Air Filter/ Mixing Valve with Thermostat	POWERGRID TS	I

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)****Annexure-G**

Sl. No	Item / Equipment	Reference document for inspection	Inspection Level
N.01	SDH Equipment	FAT/ITP	IV
N.02	Termination Equipment Primary/ DI Multiplexer	FAT/ITP	IV
N.03	DACS	FAT/ITP	IV
N.04	Optical Amplifier	FAT/ITP	IV
N.05	FODP including pigtail, Joint Box, FDMS	FAT/ITP	II
N.06	IMPS	FAT/ITP	IV
N.07	Optical bypass switch	FAT/ITP	IV
N.08	Air Purifier	FAT/ITP	I
N.09	Patch cord & connector	FAT/ITP	I
N.10	NMS	FAT/ITP	IV
N.11	OPGW Cable	MQP/ITP/FAT	III
N.12	Hardware Fittings for OPGW cable	MQP/ITP	III
N.13	DCPS	FAT/ITP	III
N.14	Radio Links	FAT/ITP	III
N.15	SMPS based DC Power Supply (DCPS) system	FAT/ITP	III
N.16	WAMS (PMU & Accessories)	FAT/ITP	III
N.17	PUF Shelter	FAT/ITP	III
N.18	Aerial OFC/UGOFC/ADSS/FO Cable	FAT/ITP	III
N.19	DWDM	FAT/ITP	III
N.20	OTN	FAT/ITP	III
N.21	MPLS-TP Equipment	FAT/ITP	III
N.22	L2 Switch	FAT/ITP	III
N.23	IP-MPLS Router	FAT/ITP	III
N.24	HDPE Pipes	POWERGRID TS	II
N.25	Equipment Cabinets	POWERGRID TS	II
N.26	Main Distribution Frame	POWERGRID TS	I
N.27	Telephone system, EPAX, Telephone wires, Telephone sockets	POWERGRID TS	I
N.28	Fibre Optic Cable	MQP	III
N.29	Hardware Fittings for Fibre Optic cable	MQP	III
O.01	Re-rollers of MS/HT Angle Section and galvanized tower parts.	MQP	IV
O.02	Conductor	MQP	IV
O.03	Hardware fittings and Conductor & Earthwire Accessories	MQP	IV
O.04	Earth wire	MQP	IV

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**

**Annexure-G**

<b>Sl. No</b>	<b>Item / Equipment</b>	<b>Reference document for inspection</b>	<b>Inspection Level</b>
O.05	Insulator	MQP	IV
O.06	Bolts & Nuts of Gr 8.8 / 8	MQP	IV
O.07	Mono Pole	MQP	IV
O.08	Foundation Bolts & Anchor Bolts	POWERGRID TS	III
O.09	D-shackle/ Hanger / Links and associated Special bolt/nuts	MQP	III
O.10	Span Marker, Obstruction lights and Wind Measuring Equipment	POWERGRID TS	III
O.11	MS ROD rolled by Approved Re-roller of POWERGRID	MQP	III
O.12	MS ROD rolled by Approved steel producers of POWERGRID	POWERGRID TS	I
O.13	Spring Washers & Pack washers	POWERGRID TS	II
O.14	Bolts & Nuts Gr up to 5.6/5	POWERGRID TS	II
O.15	ACD & Barbed wire for ACD/Bird guard	POWERGRID TS	II
O.16	Danger Plate /Phase Plate / Number Plate / Circuit plate	POWERGRID TS	I
O.17	Sub Station Structure (lattice/pipe type)	MQP	III
O.18	Clamps & Connecters (including equipment connectors)	MQP	III
O.19	MS/ GI Flat, rod type, pipe type and other earthing material.	POWERGRID TS	II
O.20	Aluminium Tube & Busbar materials	POWERGRID TS	II
O.21	Pipe Type & Counter Poise Earthing	POWERGRID TS	II
O.22	DTS System	POWERGRID TS	II

For Equipment where requirement of MQP is envisaged, ITP/FAT will be followed If sourced from off shore. For items required in S/S or T/L or TELECOM/LD&C , same inspection level as specified shall be followed for all the cases.

\* MICC for test and measuring equipment (inspection level I or II) shall be issued only after actual verification/ demonstration of satisfactory performance at site.

\*\* Though level-2 items, CIP/MICC can be issued also on review of TCs and visual inspection of these item.

Sl. No.	Power System Equipment	Minimum Local Content (%)
1	Power Transformers (up to 765 kV, including Generator Transformers)	60
2	Instrument Transformer (up to 765 kV)	60
3	Transformer Oil Dry Out System (TODOS)	60
4	Reactors up to 765 kV	60
5	Oil Impregnated Bushing (Up to 400kV)	60
6	Resin Insulated Paper (RIP) bushings (up to 145 kV)	50
7	Circuit Breakers (up to 765kV AC-Alternating Current)	60
8	Disconnectors/ Isolators (up to 765kV AC)	60
9	Wave Trap (up to 765kV AC)	60
10	Oil Filled Distribution Transformers up to & including 33kV [Cold Rolled Grain Oriented (CRGO)/Amorphous, Aluminium/Copper wound]	60
11	Dry type Distribution Transformers up to & including 33kV (CRGO/Amorphous, Aluminium/Copper wound)	60
12	Conventional conductor	60
13	Accessories for conventional conductors	60
14	High Temperature/High Temperature Low Sag (HTLS) conductors (such as Composite core, GAP, ACSS, INVAR, AL59) and accessories	60
15	Optical ground wire (OPGW)- all designs	60
16	Fiber Optic Terminal Equipment (FOTE) for OPGW	50
17	OPGW related Hardware and accessories	60
18	Remote Terminal Unit (RTU)	50
19	Power Cables and accessories up to 33kV	60
20	Control cables including accessories	60
21	XLPE cables up to 220kV	60
22	Substation Structures	60
23	Transmission Line Towers	60
24	Porcelain (Disc/Long Rod) Insulators	60
25	Bus Post Insulators (Porcelain)	60
26	Porcelain Disc Insulators with Room Temperature Vulcanisation (RTV) coating	50
27	Porcelain Long Rod Insulators with Room temperature Vulcanisation (RTV) coating	50
28	Hardware Fittings for porcelain Insulators	60
29	Composite/Polymeric Long Rod Insulators	60
30	Hardware Fittings for Polymer Insulators	60
31	Bird Flight Diverter (BFD)	60
32	Power Line Carrier Communication (PLCC) system (up to 800kV)	60
33	Gas Insulated Switchgear (up to 400kV AC)	60
34	Gas Insulated Switchgear (above 400kV AC)	50
35	Surge/Lightning Arrester (up to 765kV AC)	60
36	Power Capacitors	60
37	Packaged Sub-station (6.6kV to 33kV)	60
38	Ring Main Unit (RMU) (up to 33kV)	60

**SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR) Annexure K (Rev 01)**

39	Medium Voltage (MV) GIS panels (up to 33kV)	60
40	Automation and Control system/Supervisory Control and Data Acquisition (SCADA) system in Power system	50
41	Control and Relay panel (including Digital/Numerical relays)	50
42	Electrical motors 0.37kW to 1MW	60
43	Energy meters excluding smart meters	50
44	Control and Power cables and accessories (up to 1.1kV)	60
45	Diesel Generating (DG) set	60
46	DC system (DC Battery & Battery Charger)	60
47	AC and DC Distribution board	60
48	Indoor Air Insulated Switchgear (AIS) up to 33kV	60
49	Poles (PCC, PSCC, Rolled Steel Joist, Rail Pole, Spun, Steel Tubular)	60
50	Material for Grounding/earthing system	60
51	Illumination system	60
52	Overhead Fault Sensing Indicator (FSI)	50
53	Power Quality Meters	50
54	Auxiliary Relays	50
55	Load Break Switch	50
56	Cranes, EOT cranes, gantry crane & chain pulley blocks, etc	60
57	Elevator	60
Fire Protection and Detection system		
58	Motor driven fire water pumps	60
59	Diesel engine driven fire water pumps	60
60	Hydrant system	60
61	High velocity water spray system	60
62	Medium velocity water spray system	60
63	Foam Protection system	60
64	Inert gas flooding system	60
65	Fire tenders	60
66	Portable fire-extinguishers	60

**SECTION IV**

**GUARANTEED TECHNICAL PARTICULARS FOR  
AC-DC DISTRIBUTION BOARDS**

For each type and rating of board proposed, the bidder shall provide the following information.

S.No.	PARTICULAR	Unit	AC BOARD	DC BOARD
<b>1.00</b>	<b>GENERAL</b>			
	a) Manufacturer's Designation			
	b) Type Designation			
1.1	Rated Voltage			
1.2	a) Symmetrical Short Circuit withstand current at rated voltage of switchgear/ MCC cubicle			
	b) Peak short circuit withstand current			
	c) Rated current at 50°C			
1.3	Degree of protection as per IS 13947 ( IS 13947 )			
	a) Breaker / MCC Cubicle			
	b) Busbar Chamber			
1.4	Cubicle sheet metal details			
	a) Cold rolled/ hot rolled			
	b) Thickness, structural & load bearing members			
	c) Thickness front and rear			
	d) Thickness, sides and top			
	e) Thickness of gland plates			
1.5	Painting shade and thickness of as per IS 5			
	a) External Surface			
	b) Internal Surface			
1.6	Minimum clearance in air (busbars)			
<b>2.0</b>	<b>POWER BUSBARS &amp; INSULATORS</b>			
2.1	Material & applicable standards			
2.2	Bare/ painted/ epoxy/ insulated/ sleeved			
2.3	Bus joints silver faced			
2.4	Minimum Clearance			
	a) Phase to Phase			
	b) Phase to Earth			
2.5	Continuous Current Rating			
	a) at 40 deg C ambient			

Technical Specification  
**AC & DC BOARD**

---

	b) at 50 deg C ambient			
2.6	Temperature rise over design ambient temperature of 50 deg C for continuous current rating ( deg. C)			
2.7	Cross sectional area per phase for different ratings			
	a) Horizontal Busbars			
	b) Vertical Busbars			
2.8	Material of the Support Insulators			
2.9	Tracking Index of Insulators			
2.10	One Second Current rating			
<b>3.0</b>	<b>AIR BREAK SWITCHES</b>			
3.1	Make			
3.2	Type			
3.3	Applicable Standards			
3.4	Rated current at design ambient temperature			
3.5	Design Ambient temperature in deg C			
3.6	Derating factor for use under site ambient conditions			
3.7	Rated breaking current			
3.8	Maximum through fault withstand current			
3.9	Maximum size of fuse recommended			
3.10	Temp. rise of contacts when carrying continuous rated current			
3.11	Door interlock as specified has been provided			
3.12	No. of auxiliary contacts and its rating			
<b>4.0</b>	<b>CONTACTOR</b>			
4.1	Make			
4.2	Type and applicable standards			
4.3	No. of poles			
4.4	No. and configuration of auxiliary contacts			
4.5	Rated Voltage of coils			
4.6	Limits of operation			
	a) Supply Voltage Variation ( ± ) %			
	b) Supply frequency variation ( ± ) %			
	c) Drop off Voltage %			
4.7	Rated (thermal) current			
4.8	Rated Duty			
4.9	Rated Utilization Category as per IS 2459 ( IS 13947 )			

Technical Specification  
**AC & DC BOARD**

---

4.10	Rated breaking capacity			
4.11	Rated making capacity			
4.12	Coil winding insulation			
4.13	Rated making capacity			
4.14	Max. Recommended back up HRC fuse size			
4.15	Coil VA burden			
<b>5.0</b>	<b>AUXILIARY CONTACTOR</b>			
5.1	Make			
5.2	Type			
5.3	Coil Burden (VA)			
5.4	Operating Time (ms)			
5.5	No. of contacts			
	a) Normally Open			
	b) Normally Closed			
5.6	Contact rating			
<b>6.0</b>	<b>FUSES ( FOR EACH TYPE &amp; RATING )</b>			
6.1	Make			
6.2	Type			
6.3	Applicable Standards			
6.4	Rated Voltage			
6.5	Prospective Breaking Current			
6.6	Peak cut-off current			
6.7	Whether mounted on an insulated carrier			
<b>7.0</b>	<b>SPACE HEATER</b>			
7.1	Make			
7.2	Type Designation			
7.3	Rated Voltage			
7.4	Heater Output (W)			
7.5	Thermostat - Type , Make and Setting range (°C)			
<b>8.0</b>	<b>WIRING &amp; TERMINAL BLOCKS</b>			
8.1	Voltage grade of wires			
8.2	Insulation of wires			
8.3	Minimum size of conductor for			
	a) Power Wiring ( sq. mm )			
	b) Control wiring ( sq. mm )			
8.4	Type of control wiring terminal blocks on			

Technical Specification  
**AC & DC BOARD**

---

	a) fixed portion and draw-out portion of draw-out MCC modules			
	b) switchgear panels			
	c) for CTs			
8.5	Make & type of terminal blocks			
8.6	Minimum current rating of terminal blocks			
8.7	Suitable for 2x2.5 sq. mm cable termination on each side			
<b>9.0</b>	<b>MCB/ MCCB/</b>			
9.1	Maker's name & country of manufacture			
9.2	Applicable standards			
9.3 a)	Nominal voltage class			
b)	Rated maximum voltage			
9.4	Number of poles			
9.5	Rated normal current			
a)	Under normal conditions			
b)	Under site conditions			
9.6	Rated frequency			
9.7	Rated short circuit breaking current			
a)	RMS value of a. c. component			
b)	Duration of short circuit			
c)	Rated short circuit making current			
9.8	Rated operating sequence			
9.9 a)	Opening time at 100% rated breaking current			
b)	Arcing time at 100% rated breaking current			
c)	Closing time			
9.10	Maximum rise of temperature over ambient for current rating under item 5 (b) above.			
9.11	No of auxiliary contacts provided for owner's use			
9.12	Number of breaks in series per pole			
9.13	Type of main contact			
9.14	Type of arcing contacts / or arc control device			
9.15	Material of contacts			
a)	Main			
b)	Arcing			
c)	If silver plated, thickness of coating			
9.16	Insulation level of breaker One minute power frequency withstand voltage			

Technical Specification  
**AC & DC BOARD**

---

9.17	Clearances			
a)	Between phases			
b)	Between live part and earth			
c)	Centre to centre distance between phases			
d)	Safety boundaries during the breaking operation			
9.18	Whether circuit breaker is fixed trip or free			
9.19	Method of closing			
a)	Normal			
b)	Emergency			
9.20	Type of closing mechanism			
9.21a	Normal voltage of closing coil			
b)	Pick up range			
9.22a	Auxiliary power at normal voltage of closing mechanism			
b)	Power at 85%of normal voltage			
9.23	Type of tripping mechanism			
9.24	Normal voltage of tripping coil			
9.25a	Power at normal voltage for tripping coils			
b)	Power at 85% of normal voltage for tripping coils			
<b>10.0</b>	<b>INSTRUMENTS</b>			
10.1	Make			
10.2	Type			
10.3	Dial Size			
<b>11.0</b>	<b>INSTRUMENT TRANSFORMERS</b>			
11.1	Make			
11.2	Type			
11.3	Rated Voltage			
11.4	Ratio			
11.5	Accuracy and Limit factor			
11.6	Rated Burden			
<b>12.0</b>	<b>RELAYS</b>			
12.1	Make			
12.2	Type			
12.3	Rated Voltage			
12.4	Accuracy and Limit factor			
12.5	Rated Burden			
12.6	1 min power frequency withstand voltage			

Technical Specification  
**AC & DC BOARD**

---

12.7	Power supply required			
------	-----------------------	--	--	--

**SECTION-5**  
**CHECKLIST**

**FURNISH THIS CHECKLIST AS PART OF THE OFFER DULY SIGNED**

PLEASE NOTE:

a) The offer may not be considered if the following information and this Checklist are not enclosed with the Offer.

b) The evaluation of bidder against technical requirement criteria specified under Annexure-A of Section –I of technical specification shall be based on the documentary proof submitted by bidder along with the offer.

Hence bidder shall ensure the completeness of their offer in this regard.

BHEL ENQUIRY NO.:

BIDDER OFFER REFERENCE:

EQUIPMENT: LT AC / DC Boards

S.No.	Qualifying criteria (Annexure-A of Section-I)	Documentary proof required	Yes/No	Remarks
1	The Manufacturer whose LT Switchgear are offered, should be a manufacturer of LT Switchboards of the type and rating being offered. He should have designed manufactured, tested and supplied at least 50 nos. draw out circuit breaker panels, out of which at least 5 nos. should have been with relay and protection schemes with current transformer. He should have also manufactured at least 50 nos. MCC panels comprising of MCCBs (i.e. Moulded Case Circuit Breakers) modules of the type offered which should be in successful operation as on date of bid opening i.e 23.09.2022	Documentary proof attached	Yes	
2	The Switchgear items (such as circuit breakers, fuse switch units, contactors etc.), may be of his own make or shall be procured from reputed manufacturers and of proven design. At least one hundred circuit breakers of the make and type being offered shall be operating satisfactory as on date of bid opening i.e 23.09.2022	Documentary proof attached	Yes	

S. No.	Parameters	Data	Yes/No	Remarks
1.	Applicable Standards	IS 8623, IS 13947 PART-II , IEC 60255, IS 2026	Yes	
2.	Type of Boards	Metal enclosed, indoor floor mounted , compartmentalized double front construction and free standing	Yes	
3	Module type	All modules shall be fixed type except air circuit breaker module ,which shall be draw out type	Yes	
4	Ingress Protection requirement	Shall be as per clause 6.1.5 of Section 2	Yes	
5	Lightning Transformer	Shall meet requirements mentioned in Annexure-2	Yes	
6	Special tools & tackles	List of special tools and tackles (which are proprietary in nature) is attached	Yes	
6	Offered Boards	Bidder has quoted for the AC/DC distribution boards in line with the specification	Yes	
7	Addition / deletion	Bidder has quoted addition /deletion prices for each and every type of complete module (as mentioned in BOQ. Annex-1)	Yes	
8	Automatic Control of Outdoor lighting	In line with clause 6.28 of Section 2 , EL-Type module of 415V MLDB and ELDB shall be controlled by timer and contactor module to facilitate its operation automatically	Yes	
9	Automatic changeover	Automatic changeover as per clause 6.29 of Section 2 shall be met.	Yes	
10	Analogue Input for SAS interface	Shall meet requirements mentioned in Annexure-2	Yes	
11	Digital Input for SAS interface	Shall meet requirements mentioned in Annexure-2	Yes	
12.	Cubicle Colour finish	a) Interior: Glossy White b) Exterior: Smoke grey shade No. 692 of IS:5	Yes	
13.	Type test reports	Type test reports furnished shall be in line with clause 6.22 of Section-2	Yes	
14.	Type test	The type test reports submitted shall be of tests conducted after <b>07.09.2013</b> . If type test reports are	Yes	

		not acceptable to UPPTCL /BHEL then above tests shall be conducted by the bidder free of cost		
15	Conformation to the Minimum indicative requirement of Analog signals, Potential Free contacts & Command signals. Refer Signal Chart mentioned in SLD drawing.	This should be available at respective equipment for remote indication & control from Auxiliary BCU located in S/s control room.		
16.	Quotation for items	Bidder has also quoted for Unit Rate items and Mandatory spare items mentioned in BOQ.	Yes	
17.	Supervision of ETC	Bidder has quoted for Supervision of Erection Testing & Commissioning of LT Switchboards.	Yes	
18	Control Wiring	2.5sqmm., 1100V grade, PVC insulated stranded Cu cable	Yes	
19	Supply of unit rate items, if not quoted	If any of the unit rate items is not quoted, but is required due to damages, theft, replacement, change in feeder rating etc. or any other reason during execution, the required quantity shall be supplied free of cost within guarantee period.	Yes	

**ANNEXURE - C**  
**SCHEDULE OF TECHNICAL DEVIATIONS**

Bidder shall list below all technical deviation clause wise w.r.t. tender specifications:

<u>S.No.</u>	<u>Page No.</u>	<u>Clause No.</u>	<u>Deviation</u>	<u>Reason / Justification</u>
--------------	-----------------	-------------------	------------------	-------------------------------

---

Any deviation not specifically brought out in this section shall not be admissible for any commercial implication at later stage. Except to the technical deviations listed in this schedule, bidder's offer shall be considered in full compliance to the tender specifications irrespective of any such deviation indicated / taken elsewhere in the submitted offer.

Date:

Tenderer's Stamp & Signature