


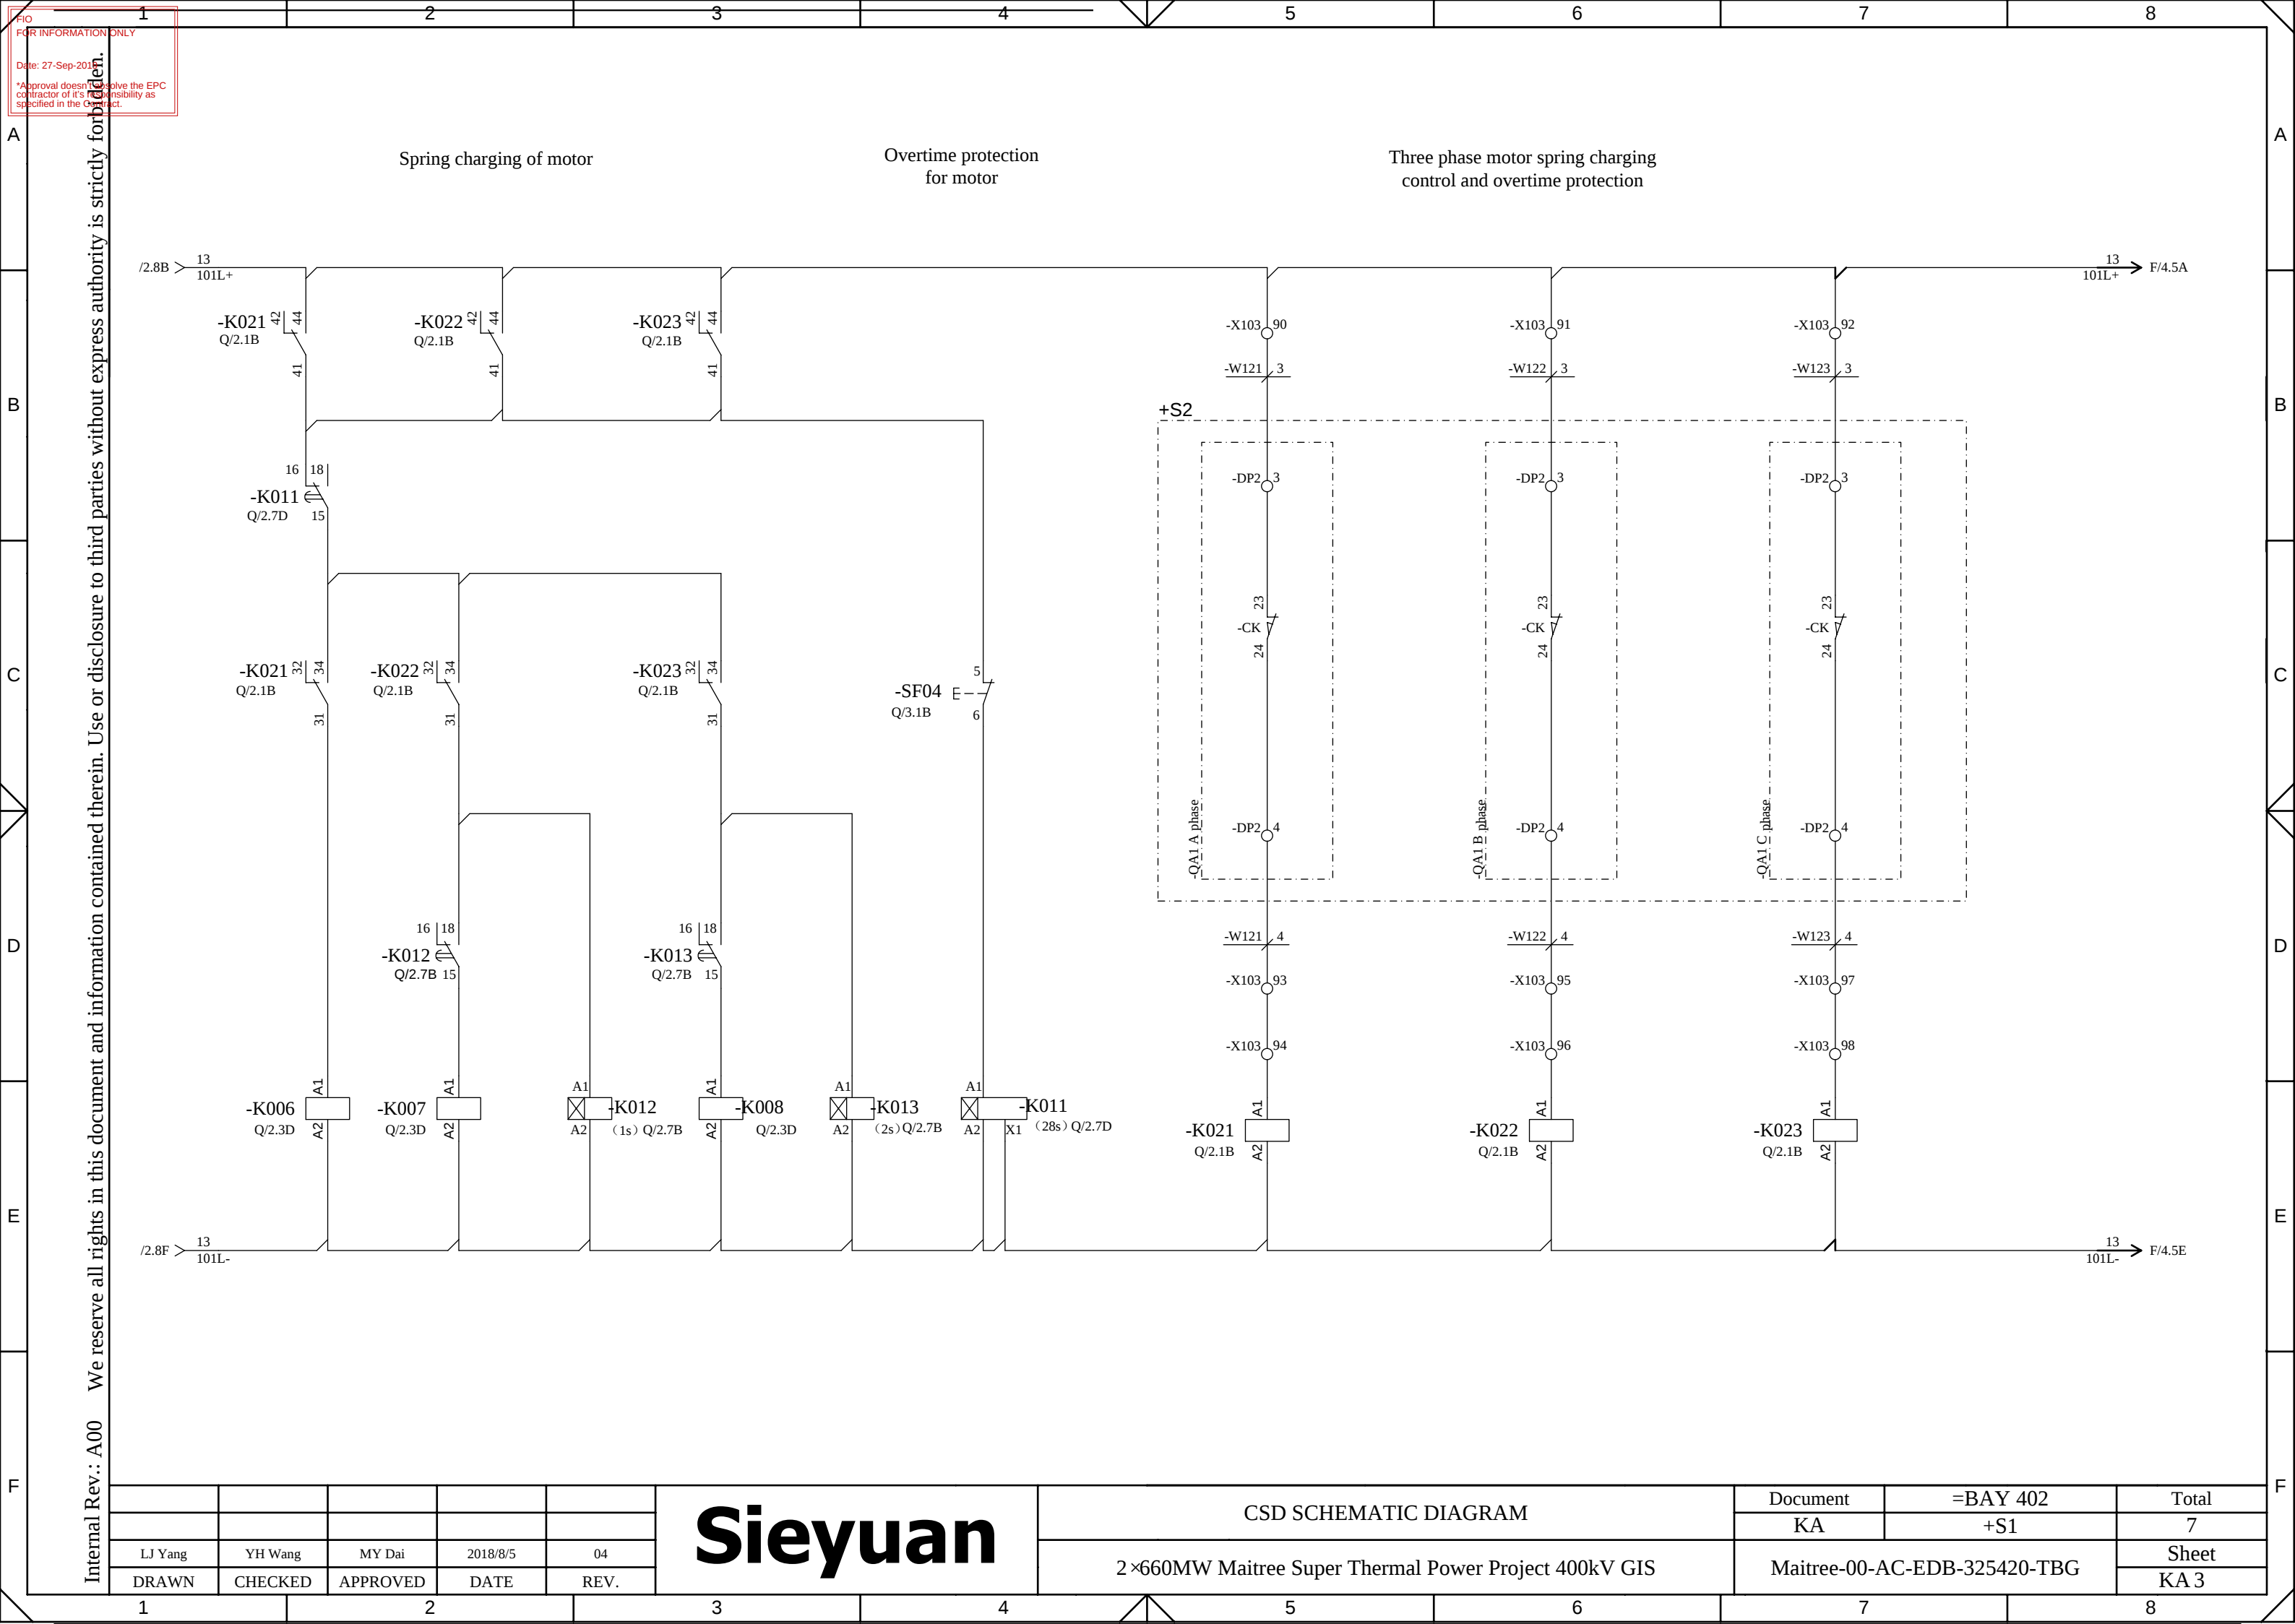



Sieyuan

CSD SCHEMATIC DIAGRAM

2×660MW Maitree Super Thermal Power Project 400kV GIS



Document	=BAY 402	Total
KA	+S1	7
Maitree-00-AC-EDB-325420-TBG		Sheet
		KA 3

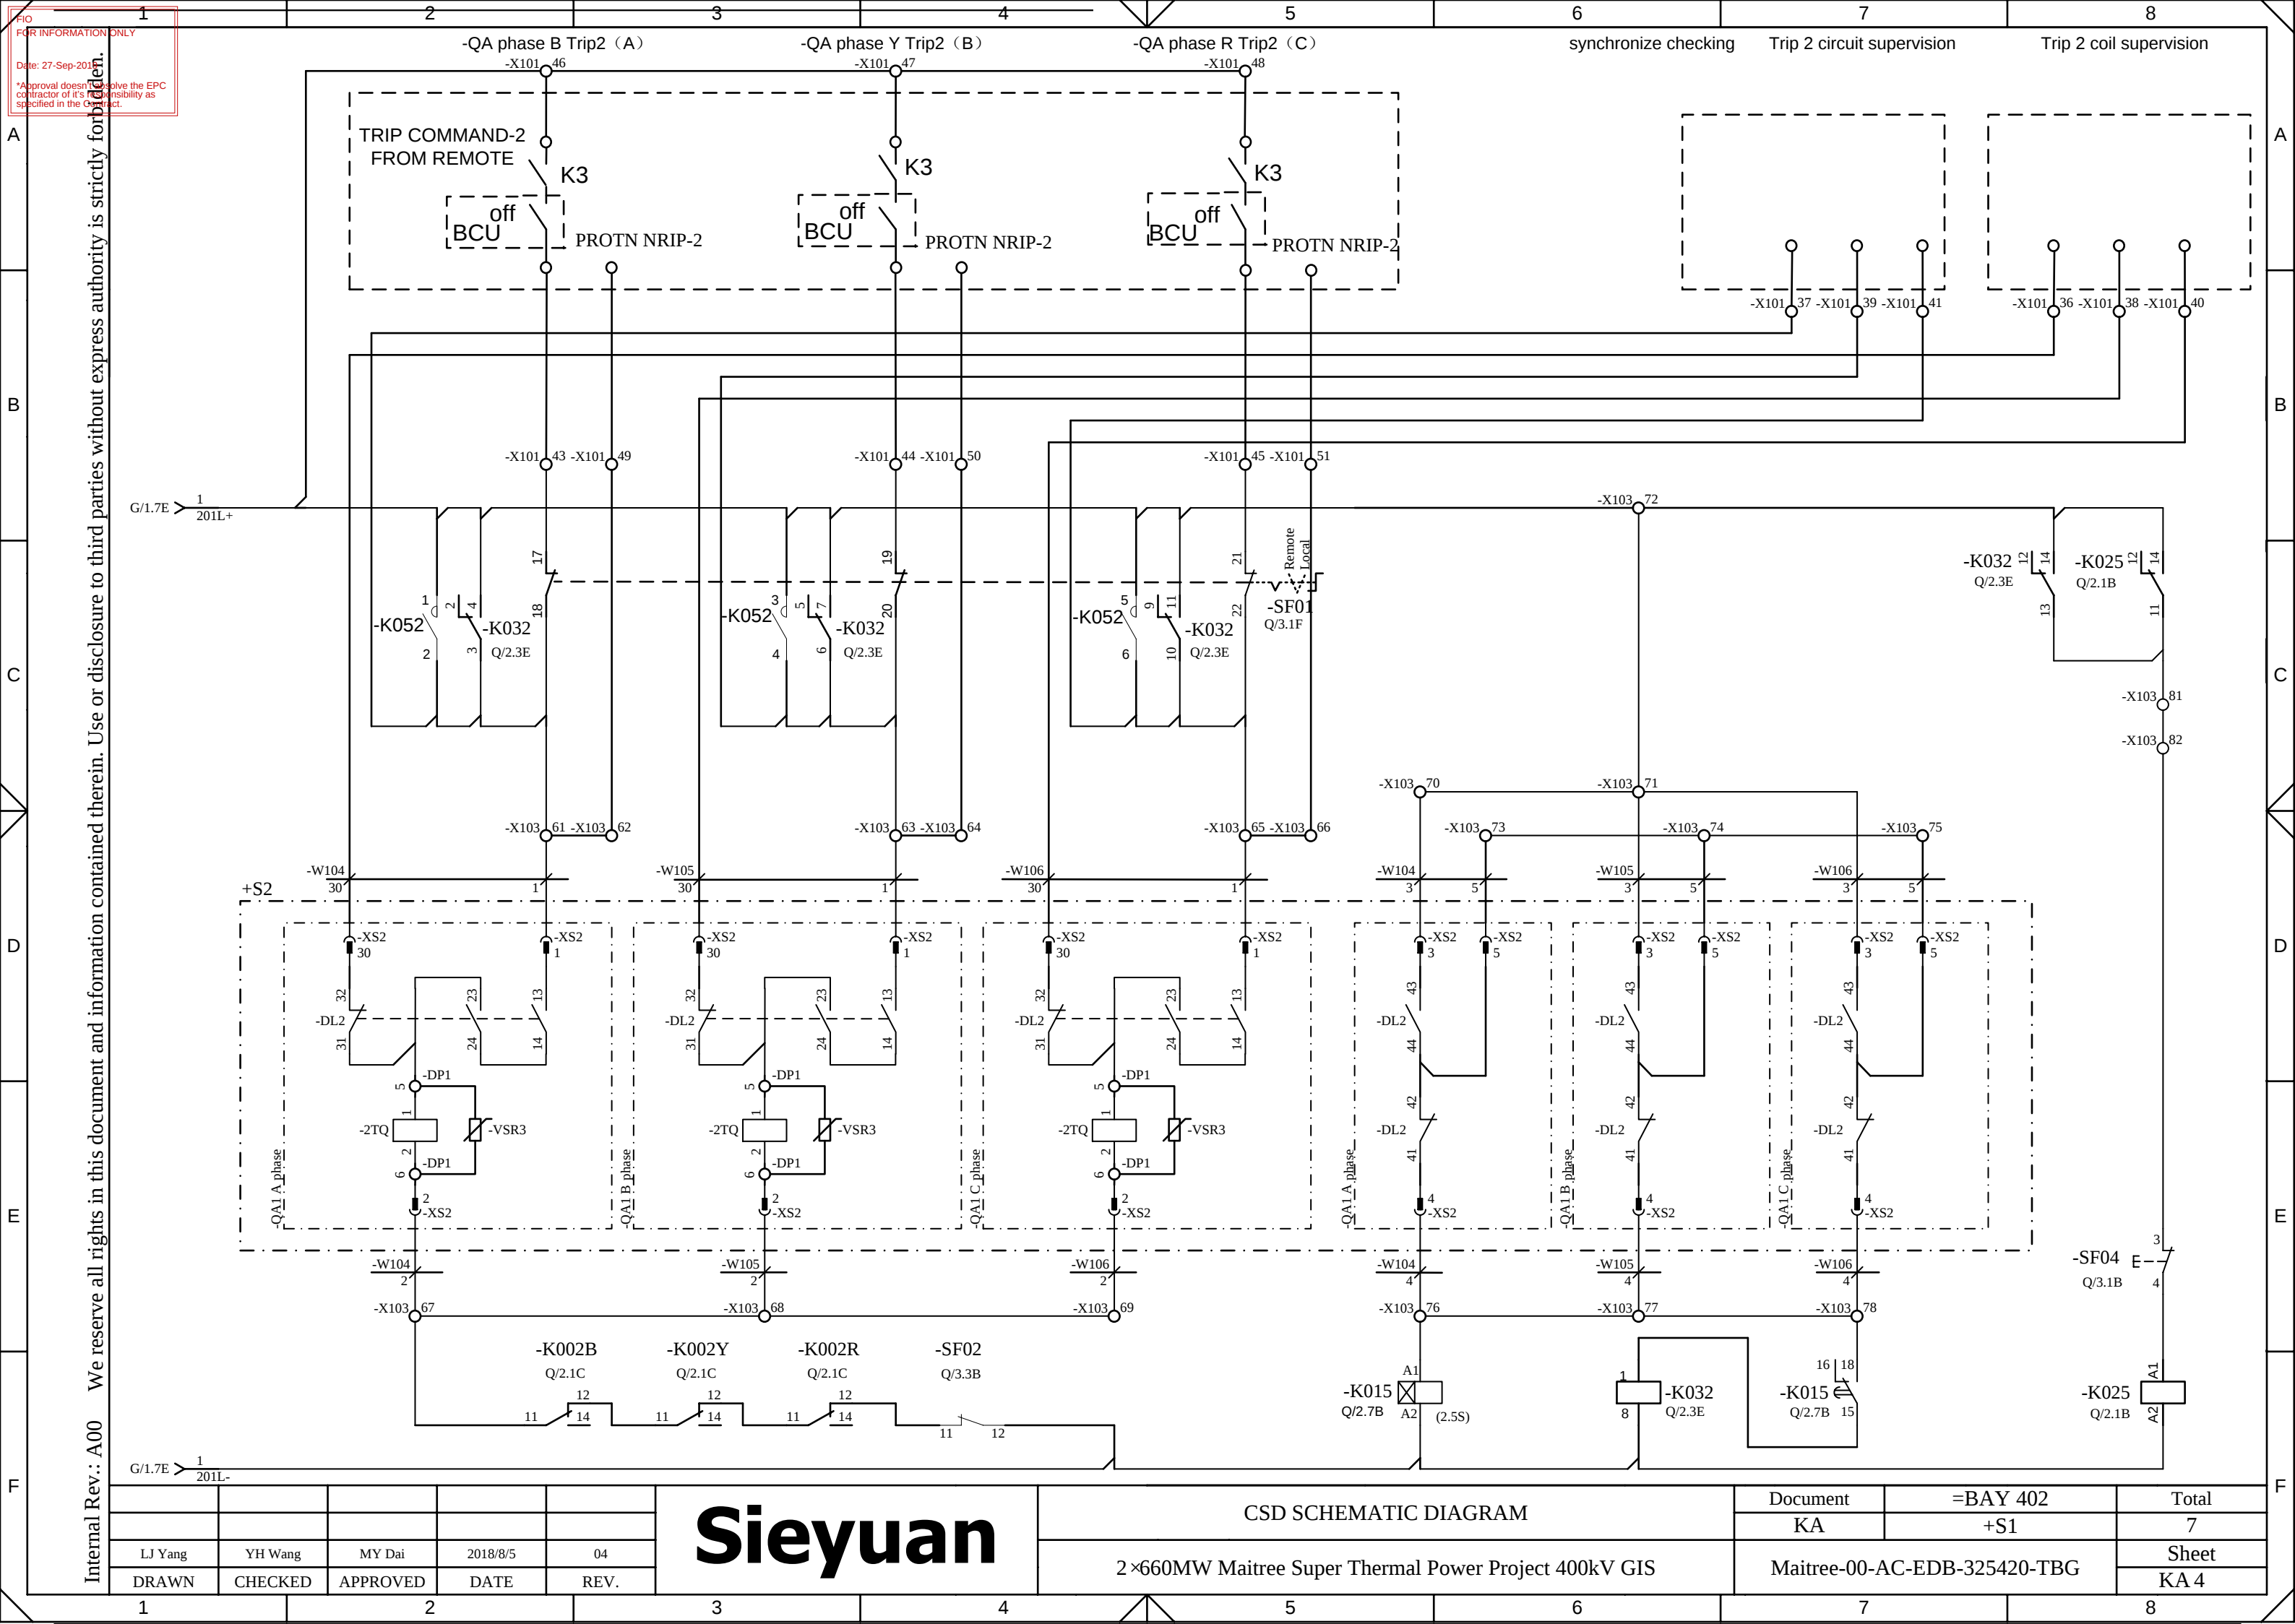

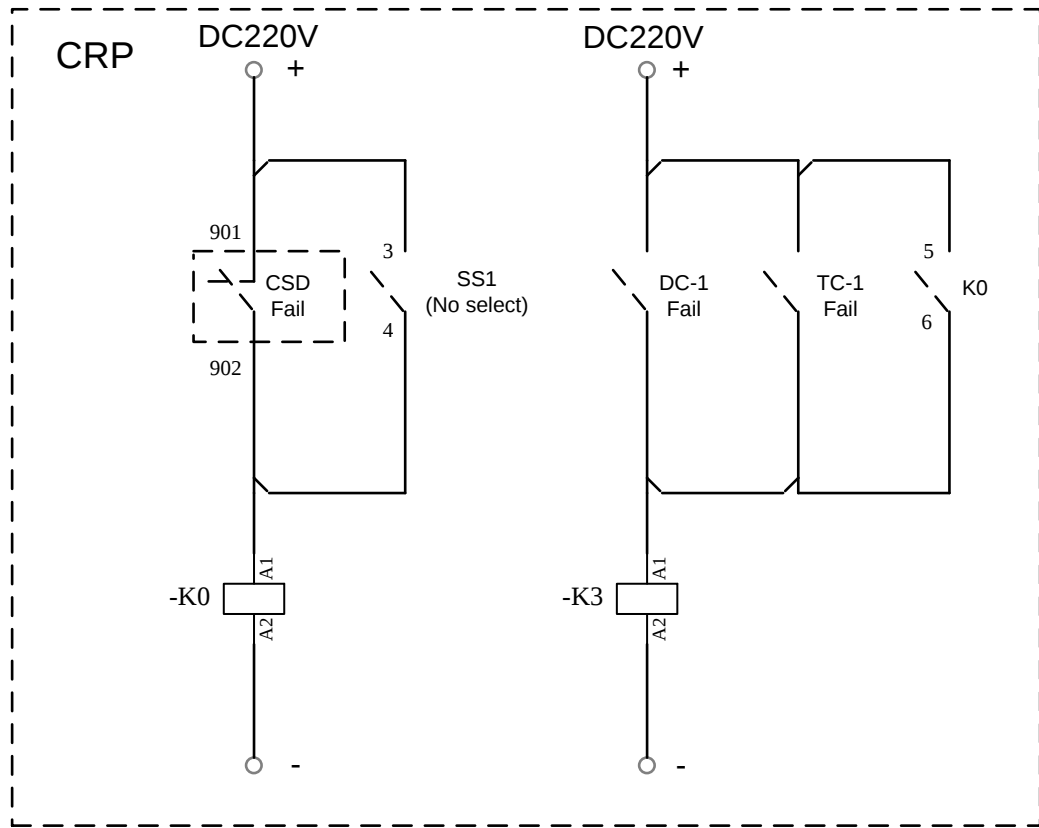

Note:
1.RELAY K0 ,K1,K2,K3,selector switch SS1 shall be supplied loose by SIEYUAN and mounted in C&R panel; but wiring and cables are not by SIEYUAN scope.

2.B0Q List of CSD


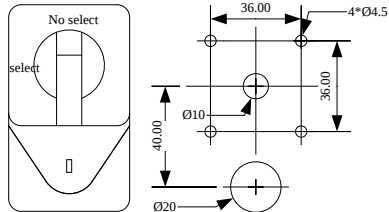

BILL OF QUANTITY																														
No.	SYMBOL	DESCRIPTION	TYPE	QTY.		MAKE																								
1	-SS1	SELECT SWITCH	LW38D-209C5938/3Y	1	<table border="1"><tr><th>Position</th><th>select</th><th>No select</th></tr><tr><td>Contacts</td><td>-90°</td><td>0°</td></tr><tr><td>1 - 2</td><td>X</td><td>X</td></tr><tr><td>3 - 4</td><td>X</td><td>X</td></tr><tr><td>5 - 6</td><td>X</td><td>X</td></tr><tr><td>7 - 8</td><td>X</td><td>X</td></tr><tr><td>9 - 10</td><td>X</td><td>X</td></tr><tr><td>11 - 12</td><td>X</td><td>X</td></tr></table> 	Position	select	No select	Contacts	-90°	0°	1 - 2	X	X	3 - 4	X	X	5 - 6	X	X	7 - 8	X	X	9 - 10	X	X	11 - 12	X	X	CHANGJIANG ELECTRICAL
Position	select	No select																												
Contacts	-90°	0°																												
1 - 2	X	X																												
3 - 4	X	X																												
5 - 6	X	X																												
7 - 8	X	X																												
9 - 10	X	X																												
11 - 12	X	X																												
2	K0 ,K1,K2,K3	CONTACTOR	LP1-K0901MD	4		SCHNEIDER																								
3		TEMPERATURE TRANSDUCER	T310	1	LOCATION OF TEMPERATURE TRANSDUCER SHALL BE IN GIS.	NR Electric																								

					Sieyuan	CSD SCHEMATIC DIAGRAM	Document	=BAY 402	Total
							KA	+S1	7
LJ Yang	YH Wang	MY Dai	2018/8/5	04		2 ×660MW Maitree Super Thermal Power Project 400kV GIS	Maitree-00-AC-EDB-325420-TBG	Sheet	
DRAWN	CHECKED	APPROVED	DATE	REV.				KA 5	

FOR INFORMATION ONLY
Date: 27-Sep-2018
*Approval doesn't involve the EPC contractor of it's responsibility as specified in the Contract.

Internal Rev.: A00 We reserve all rights in this document and information contained therein. Use or disclosure to third parties without express authority is strictly forbidden.

2. CSD GA Drawings.

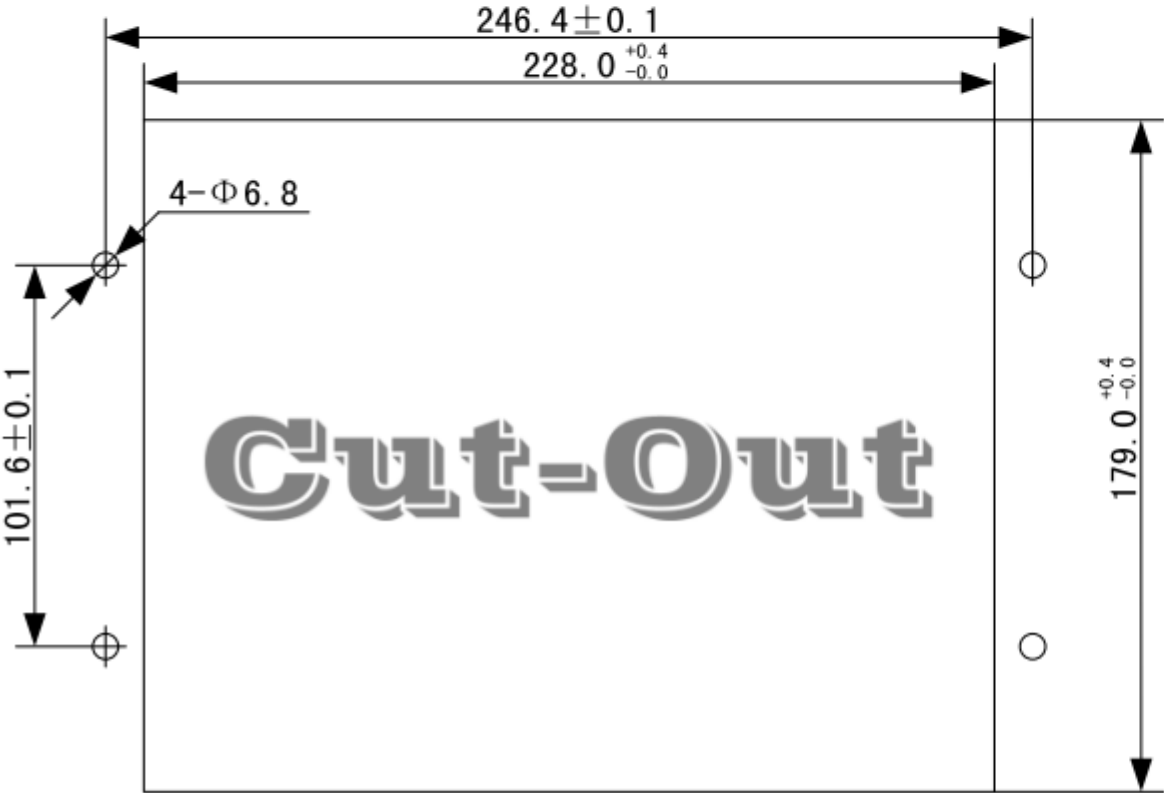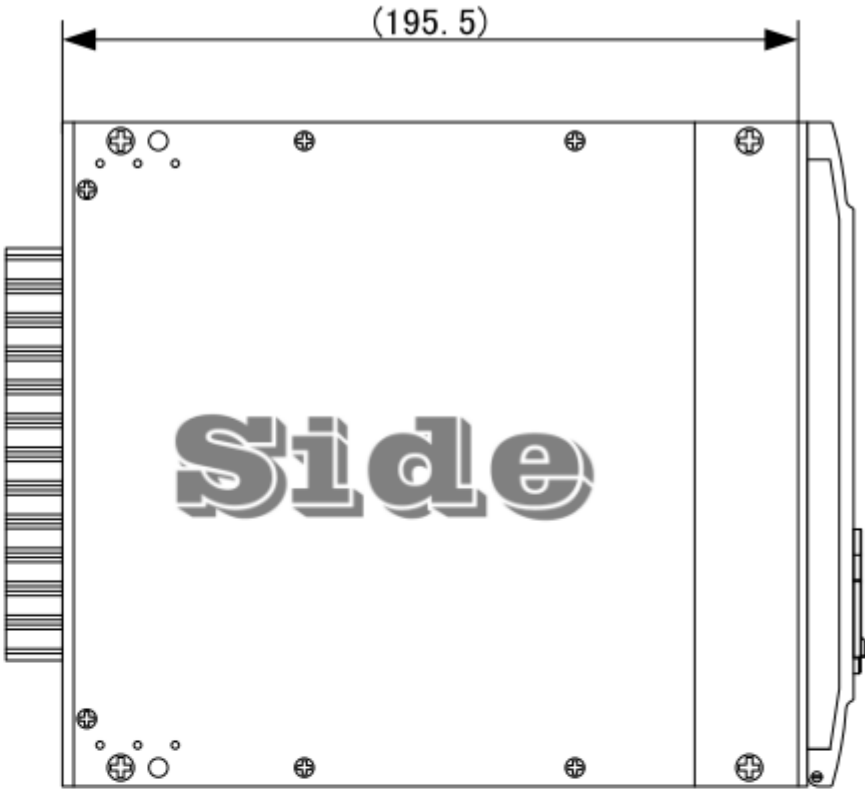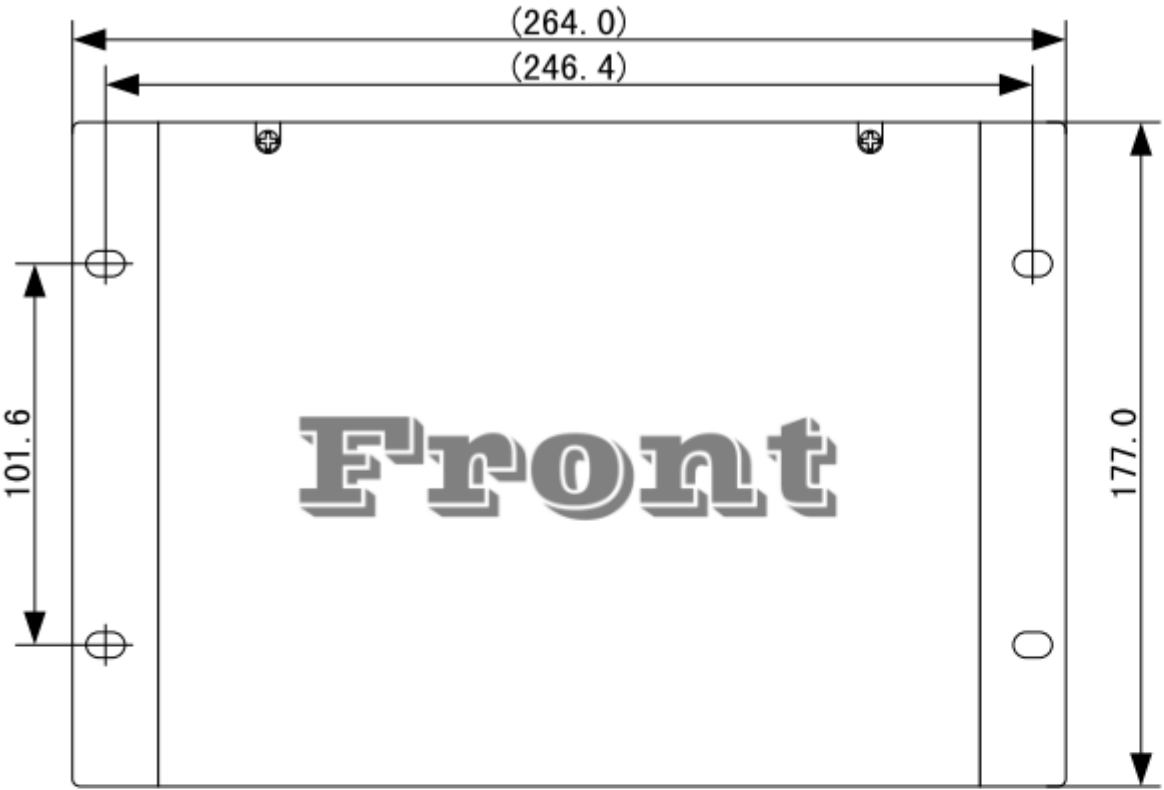

LJ Yang	YH Wang	MY Dai	2018/8/5	04
DRAWN	CHECKED	APPROVED	DATE	REV.

Sieyuan

CSD SCHEMATIC DIAGRAM
2×660MW Maitree Super Thermal Power Project 400kV GIS

Document	=BAY 402	Total
KA	+S1	7
Maitree-00-AC-EDB-325420-TBG		Sheet
		KA 6

