


TELENGANA STATE POWER GEN. CO. LTD

4X270 MW BHADRADRI TPS FGD PACKAGE

TECHNICAL SPECIFICATION

MISCELLANEOUS PUMPS

Specification No.: PE-TS- 440-100-N001

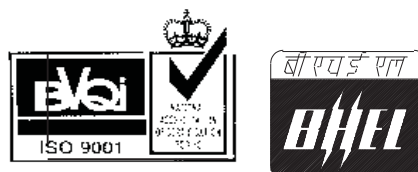

**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
PPEI BLDG., SEC-16A, PLOT NO. 25
NOIDA – 201301 (UP)**

506723/2021/PS-PEM-MSE



TITLE:

TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS

SPEC. NO.: PE-TS-440-100-N001

SECTION:

SUB-SECTION:

REV. NO. 00 DATE 10.08.2021

SHEET 1 OF 1

INDEX

THIS TECHNICAL SPECIFICATION CONSISTS OF FOLLOWING SECTIONS:

CONTENTS

| SECTION | TITLE |
|---------|---|
| I | Specific Technical Requirements |
| IA | Specific Technical Requirements (Mechanical) |
| IB | Specific Technical Requirements (Elec.) |
| IC | Specific Technical Requirements (C&I) |
| ID | Data Sheet – A |
| II | Standard Technical Specifications |
| IIA | Standard Technical Specifications (Mechanical) |
| IIB | Standard Technical Specifications (Elec.) |
| III | Documents to be submitted by Bidder |
| IIIA | Guarantee Schedule (To be submitted along with the Bid by all Bidders) |
| IIIB | Compliance Certificate (To be submitted along with the Bid by all Bidders) |
| IIIC | Deviation schedule (To be submitted along with the Bid by all Bidders) |
| IIID | Data Sheet – B and Other documents (To be submitted by successful Bidder after award of Contract) |

Notes:

1) For detailed list of documents to be submitted by bidder in their technical offer, please refer cl. no. 15.00.00 of Section-IIA.

2) For detailed list of documents to be submitted by vendor after award of contract, please refer Datasheet-C of Section-IIA.

3) In case there is conflict in different clauses of specification, most stringent clause (as decided by BHEL / end customer) shall be followed, if no specific deviation is taken by bidder and accepted by BHEL during tender stage in that regard.

506723/2021/PS-PEM-MSE



FILE:

TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS

SPECIFIC TECHNICAL REQUIREMENTS

SPEC. NO.: **PE-TS-440-100-N001**SECTION: **I**

SUB-SECTION:

REV. NO. **00** DATE 10.08.2021SHEET **1** OF **1**


SECTION - I

SPECIFIC TECHNICAL REQUIREMENTS

- SUB-SECTION IA** - Specific Technical Requirements (Mech.)
- SUB-SECTION IB** - Specific Technical Requirements (Electrical)
- SUB-SECTION IC** - Specific Technical Requirements (C & I)
- SUB-SECTION ID** – Datasheet-A

SUB-SECTION – IA

SPECIFIC TECHNICAL REQUIREMENTS (MECHANICAL)

| TECHNICAL SPECIFICATIONS | | Specification No. : PE-TS-440-100-N001, Rev0 | |
|---|----------|--|------------------|
|  MISCELLANEOUS PUMPS SPECIFIC TECHNICAL REQUIREMENTS | SECTION: | | IA |
| | REV. NO. | 0 | DATE: 10.08.2021 |

1.0 SCOPE

1.1 This enquiry covers the design, manufacture, assembly, inspection and testing at manufacturer's and/or his sub-contractors works, proper packing for delivery and installation checks and supervision of replacement of gland packing with Mechanical Seal arrangement (if applicable) at site for Miscellaneous Pumps along with mandatory spares complete with all accessories as per the requirements specified in this specification and any other services, etc. if called for in the succeeding sections of the specification for following project:

A. 4X270 MW BHADRADRI - FGD PACKAGE (TSGENCO)

The above project is referred as '4X270 MW BHADRADRI - FGD PACKAGE' elsewhere in the Specification for ease of reference.

1.2 The miscellaneous pumps covered under this specification shall be grouped under various group as under:

- Horizontal Pumps
- Vertical Pumps

NOTE:-

1. The bidder shall include complete supplies for Pump Group as above in his scope. Part supplies offered for the Pump Group shall disqualify the bidder's offer for that Pump Group.

2. Pump details shall be as per Data Sheet-A at Section-ID.

3. If stated specifically in NIT, bidder shall include complete supplies for Project/Group as above in his scope. Part supplies offered for the Project/Group shall disqualify the bidder's offer for that Project/Group.

1.3 The miscellaneous pumps and drives covered under this specification for various projects are as per Annexure-1 of this section. HT drives, wherever applicable and irrespective of motor ratings, shall be issued free of cost by BHEL. The details of pumps with HT drives shall be as per Annexure-2 of this section.

1.4 The Capacity, Head, Materials of construction, Mandatory spares and other particulars of these pumps, are detailed in Data Sheet-A at Section-ID of the specification.

1.5 For detailed scope of supply & services for Horizontal pumps, refer Standard technical Specification for Horizontal Centrifugal pumps specified under Section-II of this specification.

1.6 For detailed scope of supply & services for Vertical pumps, refer Standard technical Specification for Vertical pumps specified under Section-II of this specification.

1.7 Electrical scope between BHEL and Vendor for Miscellaneous pumps and drives of this specification shall be as per Annexure-1 of Section-IB of this specification.

LT drives shall be energy efficient as per subsequent clauses mentioned elsewhere in the specification. **However wherever IE2 or EFF1 compliant motors are applicable same shall be provided with IE3 compliance.**

1.8 **DELIVERY AND DOCUMENTATION:**
Delivery and documentation schedule of miscellaneous pumps shall be as per NIT requirement.

1.9 Evaluation and LD criterion w.r.t. Auxiliary Power is defined at clause 4.0 of Section IIA of this specification. In case bidder quotes Aux. power less than Benchmark Auxiliary Power, then quoted Aux. power shall be replaced with Benchmark Auxiliary Power for both evaluation as well as LD purposes.

2.0 Additional requirements for Pumps:

2.1 Deleted.

2.2 Deleted.

2.3 For Horizontal Pumps:

2.3.1 For Horizontal Pumps, in case, shaft sleeve is threaded, a water slinger shall be provided on the Pump Shaft to avoid ingress of leaked water (if any due to failure of sealing arrangement for shaft sleeve) to Bearing.

2.3.2 In case of axial split casing Multistage pumps, minimum factor of safety of '2' times shall be considered for Pump bearing capacity selection and pump design.

2.4 For Vertical Pumps:


2.4.1 All Vertical pump motors shall be designed/capable of withstanding max. run away speed during reverse flow.

2.4.2 For Vertical pumps no thrust block is being provided. Bidder to design the pump foundation system (base plate/ sole plate, discharge head, foundation bolts etc.) capable of transferring the pump thrust to the concrete pump foundation itself.

2.4.3 **Bare Civil Foundation for the Vertical pump is already prepared at site and foundation details is attached as Annexure - A in this section. Bidder to check the same and design base plate and foundation bolts suitably so that offered pump shall use the existing foundation.**

| TECHNICAL SPECIFICATIONS | | Specification No. : PE-TS-440-100-N001, Rev0 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|--------------------|---|------------|--------------------------|--------------------|--|--------------------|---|--------------------|--|--------------------|---------------|--------------------|------------|--------------------|-------------------------------------|--------------------|--------------------------|------------------------|--------------------|--|--------------------|---|--------------------|--|--------------------|---------------|--------------------|------------|--------------------|-------------------------------------|--------------------|--------------------------|
| MISCELLANEOUS PUMPS | | SECTION: IA | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SPECIFIC TECHNICAL REQUIREMENTS | | REV. NO. | DATE: | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 0 | 10.08.2021 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <p>3.0 Additional Dispatch Requirements:</p> <p>MDCC after final inspection shall be provided to vendor on the basis of following:-</p> <p>3.1 List of items packed in each box with description & quantity.</p> <p>3.2 Photograph of each box in open & closed condition.</p> <p>3.3 Bidder to include handling instructions in engineering drg/doc and packing to be done in such a way to avoid damage of items in transit and long storage at site and same shall be approved in contract stage by BHEL/Customer</p> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <p>4.0 Drawing/Document Submission Schedule:</p> <table border="1"> <tr> <td rowspan="7">MISC. PUMPS (HORIZONTAL)</td> <td>PE-V7-440-100-N001</td> <td>TDS AND PERFORMACE CURVES- MISC. PUMPS</td> </tr> <tr> <td>PE-V7-440-100-N002</td> <td>GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS</td> </tr> <tr> <td>PE-V7-440-100-N003</td> <td>TDS AND CURVES OF MOTORS FOR MISC. PUMPS</td> </tr> <tr> <td>PE-V7-440-100-N004</td> <td>QP-MISC PUMPS</td> </tr> <tr> <td>PE-V7-440-100-N005</td> <td>QP- MOTORS</td> </tr> <tr> <td>PE-V7-440-100-N006</td> <td>MOTOR TYPE TEST DOC (if applicable)</td> </tr> <tr> <td>PE-V7-440-100-N007</td> <td>O& M MANUAL -HORZ. PUMPS</td> </tr> </table> <table border="1"> <tr> <td rowspan="7">MISC. PUMPS (VERTICAL)</td> <td>PE-V6-440-100-N001</td> <td>TDS AND PERFORMACE CURVES- MISC. PUMPS</td> </tr> <tr> <td>PE-V6-440-100-N002</td> <td>GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS</td> </tr> <tr> <td>PE-V6-440-100-N003</td> <td>TDS AND CURVES OF MOTORS FOR MISC. PUMPS</td> </tr> <tr> <td>PE-V6-440-100-N004</td> <td>QP-MISC PUMPS</td> </tr> <tr> <td>PE-V6-440-100-N005</td> <td>QP- MOTORS</td> </tr> <tr> <td>PE-V6-440-100-N006</td> <td>MOTOR TYPE TEST DOC (if applicable)</td> </tr> <tr> <td>PE-V6-440-100-N007</td> <td>O& M MANUAL -VERT. PUMPS</td> </tr> </table> <p>Drawings submitted shall be complete in all respects with revised drawing submitted incorporating all comments. Any incomplete drawing submitted shall be treated as non-submission with delays to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall himself depute his personal to BHEL for across the table discussions/ finalizations/ submissions of drawings.</p> | | | | MISC. PUMPS (HORIZONTAL) | PE-V7-440-100-N001 | TDS AND PERFORMACE CURVES- MISC. PUMPS | PE-V7-440-100-N002 | GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS | PE-V7-440-100-N003 | TDS AND CURVES OF MOTORS FOR MISC. PUMPS | PE-V7-440-100-N004 | QP-MISC PUMPS | PE-V7-440-100-N005 | QP- MOTORS | PE-V7-440-100-N006 | MOTOR TYPE TEST DOC (if applicable) | PE-V7-440-100-N007 | O& M MANUAL -HORZ. PUMPS | MISC. PUMPS (VERTICAL) | PE-V6-440-100-N001 | TDS AND PERFORMACE CURVES- MISC. PUMPS | PE-V6-440-100-N002 | GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS | PE-V6-440-100-N003 | TDS AND CURVES OF MOTORS FOR MISC. PUMPS | PE-V6-440-100-N004 | QP-MISC PUMPS | PE-V6-440-100-N005 | QP- MOTORS | PE-V6-440-100-N006 | MOTOR TYPE TEST DOC (if applicable) | PE-V6-440-100-N007 | O& M MANUAL -VERT. PUMPS |
| MISC. PUMPS (HORIZONTAL) | PE-V7-440-100-N001 | TDS AND PERFORMACE CURVES- MISC. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N002 | GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N003 | TDS AND CURVES OF MOTORS FOR MISC. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N004 | QP-MISC PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N005 | QP- MOTORS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N006 | MOTOR TYPE TEST DOC (if applicable) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V7-440-100-N007 | O& M MANUAL -HORZ. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| MISC. PUMPS (VERTICAL) | PE-V6-440-100-N001 | TDS AND PERFORMACE CURVES- MISC. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N002 | GENERAL ARRANGEMENT AND CROSS SECTIONAL-PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N003 | TDS AND CURVES OF MOTORS FOR MISC. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N004 | QP-MISC PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N005 | QP- MOTORS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N006 | MOTOR TYPE TEST DOC (if applicable) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PE-V6-440-100-N007 | O& M MANUAL -VERT. PUMPS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <p>5.0 BIDDER TO COMPLY FOLLOWING AFTER PLACEMENT OF PO :</p> <p>1) Supplier to submit detailed ' Bill of Material ' (BOM) at the time of drawing/document submission after placement of PO. Each item of the BOM to be uniquely identified with item code no. or item serial no.</p> <p>2) Supplier to ensure that all items which will find separate mention in the packing list are covered in this detailed BOM.</p> <p>3) Supplier to also give the following undertaking in the BOM :</p> <p>" The BOM provided herewith completes the scope (in content and intent) of material supply under PO No., dated</p> <p>Any additional material which may become necessary for the intended application of the supplied item(s)/package will be supplied free of cost in most reasonable time. "</p> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

506723/2021/PS-PEM-MSE

| | | | | |
|--|---------------------------------|--|--|------------------|
|  | TECHNICAL SPECIFICATIONS | | Specification No. : PE-TS-440-100-N001, Rev0 | |
| | MISCELLANEOUS PUMPS | | SECTION: IA | |
| | SPECIFIC TECHNICAL REQUIREMENTS | | REV. NO. 0 | DATE: 10.08.2021 |


Annexure-1

List of Miscellaneous Pumps and drives for :

A. 4X270 MW BHADRADRI - FGD PACKAGE (TSGENCO)

| Sl. No. | Pump Description | Total Qty. | |
|---------|-------------------------|------------|--|
| | Horizontal Pumps | | |
| 1 | ECW PUMPS | 4 nos. | |
| 2 | ACW PUMPS | 4 nos. | |
| | | | |
| | Vertical Pumps | | |
| 1 | FGD PUMPS | 2 nos. | |

506723/2021/PS-PEM-MSE

| | | | | |
|---|---------------------------------|--|--|------------------|
|  | TECHNICAL SPECIFICATIONS | | Specification No. : PE-TS-440-100-N001, Rev0 | |
| | MISCELLANEOUS PUMPS | | SECTION: IA | |
| | SPECIFIC TECHNICAL REQUIREMENTS | | REV. NO. 0 | DATE: 10.08.2021 |

Annexure-2

Following HT drives for 4X270 MW BHADRADRI - FGD PACKAGE (TSGENCO), irrespective of Motor ratings shall be issue free, by BHEL:


Horizontal Pumps

NIL


Vertical Pumps :

NIL

ANNEXURE – A (Foundation Detail for FGD Pump)

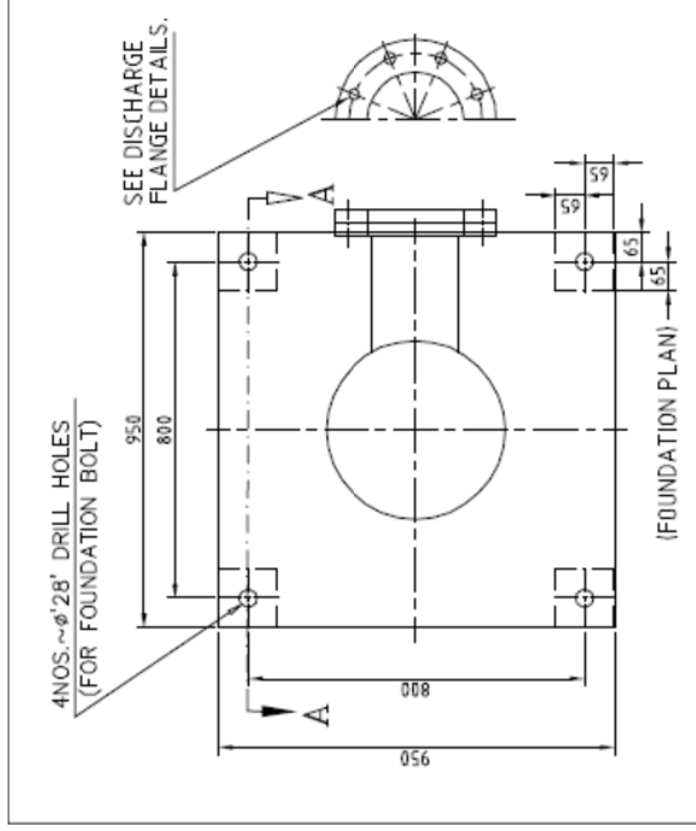

506723/2021/PS-PEM-MSE

| | | | |
|--|--|--------------------------------------|-----------------|
|  | TITLE: TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS SPECIFIC TECHNICAL REQUIREMENTS | SPEC. NO.: PE-TS-440-100-N001 | |
| | | SECTION: IB | |
| | | SUB-SECTION: | |
| | | REV. NO. 00 | DATE 10.08.2021 |
| | | SHEET 1 | OF 1 |

SUB-SECTION – IB**SPECIFIC TECHNICAL REQUIREMENTS (ELECTRICAL)**



**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
MISC PUMP
4X270 MW BHADRADRI TPS**

| |
|--|
| SPECIFICATION NO. |
| VOLUME NO. : II-B |
| SECTION : C |
| REV NO. : 00 DATE : 27.07.2015 |
| SHEET : 1 OF 3 |

1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for MISC PUMPS
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:

Refer “Electrical Scope between BHEL and Vendor”.

3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID

- 3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.

4.0 List of enclosures :

- a) Electrical scope between BHEL & vendor (Annexure –I)

506723/2021/PS-PEM-MSE :




**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
MISC PUMP
4X270 MW BHADRADRI TPS**

SPECIFICATION NO.


VOLUME NO. : **II-B**SECTION : **C**REV NO. : **00** DATE : **27.07.2015**

SHEET : 2 OF 3

- b) Technical specification for motors.
- c) Datasheets & quality plan for motors.
- d) Electrical Load data format (Annexure –II)
- e) BHEL cable listing format (Annexure –III)

| | | | |
|---|---|--------------------------|------------------------|
|  | TITLE LV MOTORS DATA SHEET-A 4 X 270 MW TSGENCO MANUGURU TPS | SPECIFICATION NO. | |
| | | VOLUME | II B |
| | | SECTION | D |
| | | REV NO. | DATE 27.07.2015 |
| | | SHEET 1 | OF 2 |

| | | | |
|------|--|---|---|
| 1.0 | Design ambient temperature | : | 50 °C |
| 2.0 | Maximum acceptable kW rating of LV motor | : | 160KW * |
| 3.0 | Installation (Indoors/ Outdoors) | : | As required |
| 4.0 | Details of supply system | | |
| | a) Rated voltage (with variation) | : | 415V ± 10% |
| | b) Rated frequency (with variation) | : | 50 Hz + 3 % to - 5% |
| | c) Combined voltage & freq. variation | : | 10% (sum of absolute values) |
| | d) System fault level at rated voltage | : | 50 kA for 1 sec |
| | e) Short time rating for terminal boxes | | |
| | o 110 kW and above (Breaker : Controlled) | : | 50 KA for 0.20 sec.. |
| | o Below 110 kW (Contactor : Controlled) | : | 50 KA protected by HRC fuse |
| | f) LV System grounding | : | Solidly |
| 5.0 | Class of insulation | : | Class 'F', with temp rise limited to class B. |
| 6.0 | Minimum voltage for starting (As percentage of rated voltage) | : | (a) 85% below 110KW (b) 80% from 110KW to 160KW (c) 85% above 160KW to 1000KW (d) 80% from 1001 KW to 4000KW (e) 75% > 4000KW |
| 7.0 | Power cables data | : | Shall be given during detailed engg. |
| 8.0 | Earth Conductor Size & Material | : | As per attached Datasheet of Earthing. |
| 9.0 | Space heater supply | : | 240 V, 1ϕ, 50 Hz (for motors above 30 Kw) |
| 10.0 | Rating up to which Single phase motor | : | Acceptable below 0.20 kW |
| 11.0 | Locked rotor current | | |
| | a) Limit as percentage of FLC | : | As per IS 12615* |
| 12.0 | Flame-proof motor | | |
| | a) Enclosure suitable (As per IS: 2148) | : | As per requirement |
| | b) Classification of Hazardous area (As per IS: 5572 part-I) | : | As per requirement |
| 13.0 | Makes | : | BHEL/ Customer approval |
| 14.0 | Paint shade | : | Shall be given during detailed engg |
| 15.0 | Degree Of protection for motor/ terminal box | : | IP 54/ IP 55 |

| | | | |
|---|---|-------------------|-----------------|
|  | TITLE LV MOTORS <u>DATA SHEET-A</u> 4 X 270 MW TSGENCO MANUGURU TPS | SPECIFICATION NO. | |
| | | VOLUME | II B |
| | | SECTION | D |
| | | REV NO. | DATE 27.07.2015 |
| | | SHEET 1 | OF 2 |

* Continuous duty LT motors up to 160 KW Output rating (at 50 deg.C ambient temperature), shall be High efficiency **IE3** as per IEC: 60034-30/ IS:12615

16.0 TESTING

16.1 Type Tests

For LT Motors above 55kW, type test reports for type tests as per IS: 325/ IS: 12615 conducted on equipment similar to those proposed to be supplied and carried out within last five years from the date of bid opening shall be submitted. However, if such reports are not available, one motor of each type shall be subjected to type tests for free of cost.

16.2 Routine Tests

All motors shall be subjected to routine tests as per IS: 325/ IS: 12615 in the presence of customer or customer representative.

REV: 0 DATE: 27.07.2015

STANDARD ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGE: MISC. PUMP (Supply Package)

PROJECT: 4X270 MW BHADRADRI TPS

ANNEXURE-I

| <u>S.NO</u> | <u>DETAILS</u> | <u>SCOPE SUPPLY</u> | <u>SCOPE E&C</u> | <u>REMARKS</u> |
|-------------|--|---------------------|----------------------|---|
| 1 | 415 V MCC | BHEL | BHEL | 240 V AC (supply feeder)/415 V AC (3 PHASE 4 WIRE) supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor. |
| 2 | Local Push Button Station (for motors) | BHEL | BHEL | Located near the motors. |
| 3 | Power cables, control cables and screened control cables | BHEL | BHEL | Incoming cable from BHEL supplied MCC will be informed by BHEL. Screened control cable between DCS & field equipment will also be informed by BHEL. Vendor shall provide lugs & glands accordingly. |
| 4 | Cable trays, accessories & cable trays supporting system | BHEL | BHEL | |
| 5 | Cable glands and lugs for equipments supplied by Vendor | Vendor | BHEL | 1. Double compression Ni-Cr plated brass cable glands 2. Solder less crimping type heavy duty tinned copper lugs for power and control cables. |
| 6 | Conduit and conduit accessories for cabling between equipments supplied by vendor | BHEL | BHEL | |
| 7 | Equipment grounding & lightning protection | BHEL | BHEL | |
| 8 | Below grade grounding | BHEL | BHEL | |
| 9 | LT Motors with base plate and foundation hardware | Vendor | BHEL | Makes shall be subject to BHEL approval at contract stage. |
| 10 | Mandatory spares | Vendor | - | Vendor to quote as per specification. |
| 11 | Recommended O & M spares | Vendor | - | As per specification |
| 12 | Any other equipment/material/service required for completeness of system but not specified above (to ensure trouble free and efficient operation of the system). | Vendor | BHEL | |
| 13 | Electrical equipment GA drawing | Vendor | - | For necessary interface review. |

NOTES:

1. Make of all electrical equipments/items supplied shall be reputed make & shall be subject to approval of BHEL after award of contract.
2. All QPs shall be subject to approval of BHEL after award of contract without any commercial implication.

506723/2021/PS-PEM-MSE



FILE:

**TECHNICAL SPECIFICATION
MISCELLANEOUS PUMPS**

SPECIFIC TECHNICAL REQUIREMENTS

SPEC. NO.: **PE-TS-440-100-N001**SECTION: **IC**


SUB-SECTION:

REV. NO. **00** DATE 10.08.2021SHEET **1** OF **2**

SUB-SECTION – IC


SPECIFIC TECHNICAL REQUIREMENTS (C&I)

506723/2021/PS-PEM-MSE

| | | | |
|--|---|--------------------------------------|-----------------|
|  | FILE: TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS SPECIFIC TECHNICAL REQUIREMENTS | SPEC. NO.: PE-TS-440-100-N001 | |
| | | SECTION: IC | |
| | | SUB-SECTION: | |
| | | REV. NO. 00 | DATE 10.08.2021 |
| | | SHEET 2 | OF 2 |

NOT APPLICABLE

506723/2021/PS-PEM-MSE

| | | | |
|--|---|--------------------------------------|-----------------|
|  | FILE: TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS SPECIFIC TECHNICAL REQUIREMENTS | SPEC. NO.: PE-TS-440-100-N001 | |
| | | SECTION: ID | |
| | | SUB-SECTION: | |
| | | REV. NO. 00 | DATE 10.08.2021 |
| | | SHEET 1 | OF 1 |

SUB-SECTION – ID**DATASHEET-A**



| | | | | | | |
|---------|--|--|----------------------|--|--|-------------------|
| | | DATA SHEET - A | | SPECIFICATION NO.: PE-TS-440-100-N001 | | 29506 |
| | | MISCELLANEOUS PUMPS (HORIZONTAL) | | REV. NO.: 00 | | DATE : 10.08.2021 |
| | | 4X270 MW BHADRADRI-FGD PACKAGE | | SECTION: | | I D |
| Sl. No. | DESCRIPTION | ECW PUMPS | ACW PUMPS | | | |
| | | HORIZONTAL PUMPS | | | | |
| 1.0 | SERVICE | | | | | |
| 1.1 | Total no. of pumps for Project | 4 | 4 | | | |
| 1.2 | No. of working & standby pumps | (2W+2S) for Station | (2W+2S) for Station | | | |
| 1.3 | Liquid Handled (ref. water analysis enclosed herein) | pH corrected DM Water | Clarified Water | | | |
| 1.4 | Location (Indoor / Outdoor) | Indoor | Indoor | | | |
| 1.5 | Duty | Continuous | Continuous | | | |
| 1.6 | No. of pumps working in parallel | 2 | 2 | | | |
| 1.7 | Specific gravity | 1 | 1 | | | |
| 1.8 | System design pressure (kg/sqcm), g | 10 | 7.5 | | | |
| 2.0 | DESIGN PARAMETERS | | | | | |
| 2.1 | Design capacity each, M ³ /hr | 540 | 540 | | | |
| 2.2 | Total dynamic head (MWC) | 60 | 30 | | | |
| 2.3 | Suction Pressure(MWC) | Flooded Suction | Flooded Suction | | | |
| 2.4 | Design Temperature (°C) | 60 | 60 | | | |
| 2.5 | Maximum permissible speed of pump (RPM) | 1500 | 1500 | | | |
| 2.6 | Max. limit on shut off head Corresponding to pump TDH (MWC) at 51.5 Hz | Not to exceed 80 MWC | Not to exceed 60 MWC | | | |
| 2.7 | Operating range | -----30-130% of design duty point flow----- | | | | |
| 2.8 | Motor rating | Motor rating at ambient temperature of 50 Deg.Cel. (including voltage and frequency variations) shall be the maximum of the following requirements: a) 15% margin over the pump shaft input power at the rated duty point. b) 10% margin over the maximum pump shaft input power required within the entire characteristic curve of the pump. c) Pump shaft input power required considering the overloading of the pump assuming single pump operation in the event of tripping of one or more of the pumps operating in parallel. | | | | |
| 2.9 | Permissible tolerance in rated capacity & TDH | no negative tolerance | | | | |
| 2.10 | Permissible tolerance in efficiency at rated capacity(%) | no negative tolerance | | | | |
| 2.11 | Performance/Design Standard | HIS / EQUIVALENT | | | | |



| | | | | | | | |
|-------------|--|---|--|--|-------------------|----|-----|
| <div></div> | | DATA SHEET - A | | SPECIFICATION NO.: PE-TS-440-100-N001 | | 30 | 506 |
| | | MISCELLANEOUS PUMPS (HORIZONTAL) | | REV. NO.: 00 | DATE : 10.08.2021 | | |
| | | 4X270 MW BHADRADRI-FGD PACKAGE | | SECTION: | I D | | |
| Sl. No. | DESCRIPTION | ECW PUMPS | | ACW PUMPS | | | |
| 3.0 | CONSTRUCTION FEATURES | | | | | | |
| 3.1 | Pump type | Horizontal centrifugal type Between Bearing Pump | | Horizontal centrifugal type Between Bearing Pump | | | |
| 3.2 | Impeller type | Closed | | Closed | | | |
| 3.3 | Casing type | Horizontal split type | | Horizontal split type | | | |
| 3.4 | Coupling type | Flexible type | | Flexible type | | | |
| 3.5 | Sealing arrangement | Gland packing initially & Mechanical seal finally after commissioning | | Gland packing | | | |
| 3.6 | Type of Lubrication | Self Liquid/Grease | | Self Liquid/Grease | | | |
| 3.7 | Pump characteristics | Non Overloading type & stable | | Non Overloading type & stable | | | |
| 3.8 | Drain Plugs, vent with valve, lifting lugs, priming connection | | | Required | | | |
| 4.0 | MATERIALS OF CONSTRUCTION | | | | | | |
| 4.1 | Casing | 2.5% Ni Cl to IS 210 GR FG-260 | | 2.5% Ni Cl to IS 210 GR FG-260 | | | |
| 4.2 | Impeller | SS316/ CF8M | | SS316/ CF8M | | | |
| 4.3 | Shaft | SS 410 | | SS 410 | | | |
| 4.4 | Shaft Sleeves | SS 316 | | SS 316 | | | |
| 4.5 | Impeller Wearing rings | SS 316 | | SS 316 | | | |
| 4.6 | Bolts & Nuts - Non Wetted | High tensile Steel | | High tensile Steel | | | |
| 4.7 | Gland/Seal Cover | SS 316 | | 2.5% Ni Cl to IS 210 GR FG-260 | | | |
| 4.9 | Lantern Ring | SS 316 | | SS | | | |
| 4.10 | Mech. seal | As per Manufacturer standard | | N.A. | | | |
| 4.10 | Gland Packing | Teflon Impregnated /Manufacturer's standard (Non-Asbestos type) | | | | | |
| 4.11 | Base Plate | MS fabricated IS-2062 (min. thk.-6 mm) Epoxy Coated | | MS fabricated IS-2062 (min. thk.-6 mm) Epoxy Coated | | | |
| 4.12 | Stuffing Box | 2.5% Ni Cl to IS 210 GR FG-260 | | 2.5% Ni Cl to IS 210 GR FG-260 | | | |
| 4.13 | Casing Wearing rings (If applicable) | SS 316 | | SS 316 | | | |
| 4.14 | Coupling | SS | | SS | | | |
| 4.15 | Connecting Pipe material (for deciding counterflange material) | Carbon Steel as per IS:2062, Plates rolled & welded as per IS 3589 | | Carbon Steel as per IS:2062, Plates rolled & welded as per IS 3589 | | | |
| 4.16 | Fasteners - Wetted | SS | | SS | | | |



| | | | | |
|--|--------------------------------|--|-------------------|-----|
| DATA SHEET - A | | SPECIFICATION NO.: PE-TS-440-100-N001 | | 31 |
| MISCELLANEOUS PUMPS (HORIZONTAL) | | REV. NO.: 00 | DATE : 10.08.2021 | 506 |
| 4X270 MW BHADRADRI-FGD PACKAGE | | SECTION: | I D | |
| Sl. No. | DESCRIPTION | ECW PUMPS | ACW PUMPS | |
| 5.0 | MANDATORY SPARES FOR PUMP SET | | | |
| 5.1 | Key for impeller | 2Nos. for each application and ratings of Pumps | - | |
| 5.2 | Bearings | 2Sets (comprising of Drive & Non-drive end) for each application and ratings of Pumps | - | |
| 5.3 | Wear Ring for Shaft & Impeller | 2Sets for each application and ratings of Pumps | - | |
| 5.4 | Mechanical seal with Sleeves | 2Sets for each application and ratings of Pumps | - | |
| 5.5 | Coupling | 2Nos. for each application and ratings of Pumps | - | |
| 5.6 | Shaft Sleeve | - | 2 Nos. | |
| 5.7 | Impeller wear ring | - | 2 Nos. | |
| 5.8 | Casing wear ring | - | 2 Nos. | |
| 5.9 | Gland Packing | - | 2 Nos. | |
| 5.10 | Lantern Ring | - | 2 Nos. | |
| 5.11 | Coupling | - | 2 Nos. | |
| Mandatory Spare Note: 1. Wherever quantity has been specified as percentage (%), it shall mean percentage (%) of the total population of the item in the station (project), unless specified otherwise and the fraction will be rounded off to the next higher whole number. 2. Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc. these shall cover all the items supplied and installed and the break up for these shall be furnished in the bid. 3. In case spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered design with quantities generally in line with the approach followed as above. 4. Each spare shall be clearly marked and labeled on the outside of the packing with its description. When more than one spare part is packed in single case, a general description of the contents shall be shown on the outside of such case and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purpose of identification. | | | | |




| | | | | | | |
|----------------------------------|---|-----------------|--|-------------------|------|-----|
| DATA SHEET - A | | | SPECIFICATION NO.: PE-TS-440-100-N001 | | 32 | 506 |
| MISCELLANEOUS PUMPS (HORIZONTAL) | | | REV. NO.: 00 | DATE : 10.08.2021 | | |
| 4X270 MW BHADRADRI-FGD PACKAGE | | | SECTION: | I D | | |
| SI. No. | DESCRIPTION | ECW PUMPS | ACW PUMPS | | | |
| 6.0 | BID EVALUATION RATE | | | | | |
| 6.1 | Bid evaluation rate | Rs.2.52 Lacs/KW | | | | |
| 6.2 | Maximum permissible efficiency for Bid evaluation | | | | | |
| 6.2.1 | Pump Efficiency | 82 | | | 84 | |
| 6.2.2 | Motor Efficiency | 95.1 | | | 94.5 | |
| Notes : | | | | | | |
| 1 | Material of construction for other components not specified above shall be similarly selected in line with the above for the duty intended and subject to approval. | | | | | |
| 2 | For items stated as not applicable by bidder, shall have to be supplied without any cost implication to BHEL in the event they are found to be applicable during detail engineering stage. | | | | | |
| 3 | For all HT motor driven pumps (wherever applicable), bidder shall provide flat surface with dimensions 60 MM x60 MM on bearing Housing for mounting vibration measuring block and a key slots of dimensions 30MM (L) X 15 MM (W) X 3 MM (D) on each pump shaft or some other suitable location which shall be confirmed during detail engineering by BHEL for Phase Marker. | | | | | |
| 4 | Wherever SS material is coming in contact with non SS material, suitable isolation (rubber etc.) shall be provided to avoid galvanic corrosion. | | | | | |

506723/2021/PS-EM-MSE

| DATA SHEET - A | | SPECIFICATION NO.: | PE-TS-440-100-N001 |
|--------------------------------------|--|--|--------------------|
| MISCELLANEOUS PUMPS (Vertical Pumps) | | REV. NO.: 00 | DATE : 10.08.2021 |
| 4X270MW BHADRADRI TPS - FGD PACKAGE | | SECTION: | I D |
| Sl. No. | DESCRIPTION | FGD PUMPS | |
| 1.0 | SERVICE | | |
| 1.1 | Total no. of pumps for Project | 2 | |
| 1.2 | No. of working & standby pumps | (1W+1S) for station | |
| 1.3 | Liquid Handled (ref. water analysis enclosed herein) | Clarified Water | |
| 1.4 | Location | Clarified Water P/H | |
| 1.4.1 | Indoor / Outdoor | Indoor | |
| 1.5 | Duty | Continuous | |
| 1.6 | Specific gravity | 1 | |
| 1.7 | No. of pumps working in parallel | 1 | |
| 1.8 | System design pressure (kg/sqcm) | 10 | |
| 2.0 | DESIGN PARAMETERS | | |
| 2.1 | Design capacity each, M ³ /hr | 230 | |
| 2.2 | Total dynamic head (MWC) (At Bowl, excluding Pumps Internal frictional losses upto discharge) | 55 | |
| 2.3 | <ul style="list-style-type: none"> Suction Pressure(MWC) Floor Level- for Pump Mounting Min. W.L. Max. W.L. Sump Invert Level Crane Hook Level Crane Capacity Available | Submerged Suction EL (-) 0.50 M EL (-) 3.35 M EL (-) 1.50 M EL (-) 6.00 M EL (+) 4.90 M 10 Ton | |
| 2.4 | Design Temperature (°C) | 60 | |
| 2.5 | Maximum permissible speed of pump (RPM) | 1500 | |
| 2.6 | Max. limit on shut off head Corresponding to pump TDH (MWC) at 51.5 Hz | Not to exceed 85 MWC | |
| 2.7 | Pump Discharge - above floor / below floor | Above Floor | |
| 2.8 | Discharge pipe (OD X THK), (mm x mm) | 219.1 X 6.0 | |
| 2.9 | Operating range | 30-130% of design duty point flow | |
| 2.10 | Motor rating | Motor rating at ambient temperature of 50 Deg.Cel. (including voltage and frequency variations) shall be the maximum of the following requirements: a) 15% margin over the pump shaft input power at the rated duty point. b) 10% margin over the maximum pump shaft input power required within the entire characteristic curve of the pump. c) Pump shaft input power required considering the overloading of the pump assuming single pump operation in the event of tripping of one or more of the pumps operating in parallel. | |
| 2.11 | Permissible tolerance in rated capacity & TDH | No negative tolerance | |
| 2.12 | Permissible tolerance in efficiency at rated capacity(%) | No negative tolerance | |
| 2.13 | Performance/Design Standard | HIS/Equivalent | |
| 3.0 | CONSTRUCTION FEATURES | | |
| 3.1 | Pump type | Vertical Wet Pit Type | |
| 3.2 | Impeller type | Closed | |
| 3.3 | Casing type | Vertical Type | |
| 3.4 | Coupling type | Flexible | |
| 3.5 | Sealing arrangement | Self Water/Gland packing | |
| 3.6 | Type of Lubrication | Self Water | |
| 3.7 | Pump characteristics | Non Overloading type & stable | |
| 3.8 | Reverse flow through pump to be considered for pump design | YES | |
| 3.9 | Drain Plugs, vent, lifting lugs, etc. | YES | |
| 4.0 | MATERIALS OF CONSTRUCTION | | |
| 4.1 | Casing & Suction Bell | 2.5% Ni Cl IS 210 Gr. FG 260 | |
| 4.2 | Column Pipe/Discharge Elbow | CS to IS 2062 Gr.B | |
| 4.3 | Minimum column pipe/Discharge elbow thickness, mm | 10 mm | |
| 4.4 | Impeller | ASTM-A-351 Gr.CF8M | |
| 4.5 | Shaft/ Line Shaft | SS-410 | |
| 4.6 | Shaft Sleeves | SS-410 (Hardened) | |
| 4.7 | Shaft Coupling | SS-316 | |
| 4.8 | Gland / cover plate | SS-316 | |
| 4.9 | Wearing rings | SS-316 | |
| 4.10 | Wetted fasteners | SS-316 | |
| 4.11 | Non wetted fasteners | High Tensile Steel / IS Grade | |
| 4.12 | Stuffing Box | 2.5% Ni Cl IS 210 Gr. FG 260 | |
| 4.13 | Lantern Ring | SS-316 | |
| 4.14 | Intermediate stage bearings | Cutless rubber/Thordon Type | |
| 4.15 | Gland Packing (Asbestos Free) | Braided Impregnated Teflon (Asbestos Free) | |
| 4.16 | Base/ Sole Plate | MS to IS 2062 Gr. B (min. 10 mm thk) | |
| 4.17 | Connecting Pipe material (for deciding counterflange material) | Piping shall be Carbon Steel (IS:2062, Gr B), rolled and welded conforming to IS:3589 . | |

506723/2021/PS-1/EM-MSE

| | | | | | | | |
|---------|--|--|--|---|--|--------------------|--|
| | | DATA SHEET - A | | SPECIFICATION NO.: | | PE-TS-440-100-N001 | |
| EM-MSE | | | | MISCELLANEOUS PUMPS (Vertical Pumps) | | REV. NO.: 00 | |
| | | | | 4X270MW BHADRADRI TPS - FGD PACKAGE | | DATE : 10.08.2021 | |
| | | | | | | SECTION: | |
| | | | | | | I D | |
| SI. No. | | DESCRIPTION | | FGD PUMPS | | | |
| 5.0 | | MANDATORY SPARES | | | | | |
| 5.1 | | Casing wear rings | | 2 Sets for each type | | | |
| 5.2 | | Impeller wear rings | | 2 Sets for each type | | | |
| 5.3 | | Shaft sleeves | | 2 Sets for each type | | | |
| 5.4 | | Shaft coupling | | 2 Sets for each type | | | |
| 5.5 | | Shaft nuts and keys | | 2 Sets for each type | | | |
| 5.6 | | Lantern rings | | 2 Sets for each type | | | |
| 5.7 | | Bearings Various types as applicable | | Complete 2 Sets (1 set means total requirements for one Pump) for each type | | | |
| 5.8 | | Coupling set (between pump and motor) with accessories | | 2 Sets for each type | | | |
| | | Mandatory Spare Note: 1. Wherever quantity has been specified as percentage (%), it shall mean percentage (%) of the total population of the item in the station (project), unless specified otherwise and the fraction will be rounded off to the next higher whole number. 2. Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc. these shall cover all the items supplied and installed and the break up for these shall be furnished in the bid. 3. In case spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered design with quantities generally in line with the approach followed as above. 4. Each spare shall be clearly marked and labeled on the outside of the packing with its description. When more than one spare part is packed in single case, a general description of the contents shall be shown on the outside of such case and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purpose of identification. | | | | | |
| 7.0 | | Bid Evaluation | | | | | |
| 7.1 | | Bid evaluation rate | | Rs.2.52 Lacs/KW | | | |
| 7.2 | | Maximum permissible efficiency for Bid evaluation | | | | | |
| 7.2.1 | | Pump Efficiency | | 80 | | | |
| 7.2.2 | | Motor Efficiency | | 94 | | | |
| | | | | | | | |
| Notes : | | | | | | | |
| 1 | | Material of construction for other components not specified above shall be similarly selected in line with the above for the duty intended and subject to approval. | | | | | |
| 2 | | For items stated as not applicable by bidder, shall have to be supplied without any cost implication to BHEL in the event they are found to be applicable during detail engineering stage. | | | | | |
| 3 | | For all HT motor driven pumps (wherever applicable), bidder shall provide flat surface with dimensions 60 MM x60 MM on bearing Housing for mounting vibration measuring block and a key slots of dimensions 30MM (L) X 15 MM (W) X 3 MM (D) on each pump shaft or some other suitable location which shall be confirmed during detail engineering by BHEL for Phase Marker. | | | | | |
| 4 | | Wherever SS material is coming in contact with non SS material, suitable isolation (rubber etc.) shall be provided to avoid galvanic corrosion. | | | | | |

| | | | | | | |
|---|--------------------------|----------|--|----------|------------|--|
|  | TECHNICAL SPECIFICATIONS | | Specification No. : PE-TS-440-100-N001, Rev0 | | | |
| | MISCELLANEOUS PUMPS | VOLUME: | IIB | SECTION: | 1 D | |
| | | REV. NO. | 0 | DATE: | 10.08.2021 | |

A. DM WATER ANALYSIS:

Conductivity: Less than 0.1 microS/cm
 Total silica: 0.01 to 0.02 ppm
 pH: 6.8 to 7.2

B. PASSIVATED DM WATER ANALYSIS:

Conductivity: Less than 0.1 microS/cm
 Total silica: 0.01 to 0.02 ppm
 pH: 8.5 to 9.5



TITLE

4 X 270 MW BHADRADRI TPS

MISCELLANEOUS PUMPS

SPECIFICATION NO.

PE-TS-440-100-N001

VOLUME: II B, SECTION: I D

REV 00

RAW WATER ANALYSIS

| Sr.No | Parameters | Unit | Results |
|-------|--------------------------|--------------------------|---------|
| 1. | Physical characteristics | | |
| | Colour | Hazen | 8.0 |
| | pH at 25 °C | -- | 7.79 |
| | Conductivity at 25 °C | μs/cms | 400 |
| | Dissolved solids | ppm | 282 |
| 2. | Cations | | |
| | Calcium Hardness | ppm as CaCO ₃ | 96 |
| | Magnesium Hardness | ppm as CaCO ₃ | 52 |
| | Sodium + Potassium | ppm as CaCO ₃ | 76.6 |
| | Iron | ppm as CaCO ₃ | Traces |
| | Total Cations | ppm as CaCO ₃ | 224.6 |
| 3. | Anions | | |
| | M- Alkalinity | ppm as CaCO ₃ | 136.0 |
| | Chlorides | ppm as CaCO ₃ | 72.0 |
| | Sulphate | ppm as CaCO ₃ | 15.0 |
| | Nitrates | ppm as CaCO ₃ | 1.6 |
| | Total Anions | ppm as CaCO ₃ | 224.6 |
| 4. | Total Hardness | ppm as CaCO ₃ | 148 |
| 5. | P - Alkalinity | ppm as CaCO ₃ | Nil |
| 6. | Dissolved Silica | ppm as SiO ₂ | 1.1 |
| 7. | Colloidal Silica | ppm as SiO ₂ | 2.0 |
| 7. | Turbidity | NTU | 250 |
| 8. | Total suspended solids | ppm | 500 |

Note: Other parameters not indicated in Raw Water Analysis shall be considered as Nil

CLARIFIED WATER ANALYSIS

| Sl.No. | Constituent | Units | Values |
|--------|--|-------|--------|
| 1. | Total Suspend Solids at outlet of clarifier. | ppm | 10 |
| 2. | Turbidity | NTU | 10 |

Note: The other parameters in Clarified water shall be remaining unchanged as present in Raw Water.

506723/2021/PS-PEM-MSE

| | | | |
|--|--|--------------------------------------|-----------------|
|  | FILE: TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS STANDARD TECHNICAL SPECIFICATION | SPEC. NO.: PE-TS-440-100-N001 | |
| | | SECTION: II | |
| | | SUB-SECTION: | |
| | | REV. NO. 00 | DATE 10.08.2021 |
| | | SHEET 1 | OF 1 |

SUB-SECTION - II**STANDARD TECHNICAL SPECIFICATION**

506723/2021/PS-PEM-MSE



FILE:

TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS

STANDARD TECHNICAL SPECIFICATION

SPEC. NO.: PE-TS-440-100-N001

SECTION: IIA

SUB-SECTION:


REV. NO. 00 DATE 10.08.2021

SHEET 1 OF 1

SUB-SECTION - IIA

STANDARD TECHNICAL SPECIFICATION (MECHANICAL)

- STANDARD TECHNICAL SPECIFICATION FOR MISC. PUMPS (HORIZONTAL AND VERTICAL) INCLUDING DATASHEET-C
- STANDARD QUALITY PLANS

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 1 of 16 | |

1.00.00

GENERAL INFORMATION

1.01.0

The general guidelines as illustrated in the subsequent clauses of this section shall be applicable for horizontal centrifugal pumps to be procured under the scope of this package.

1.02.0

It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to high standards of design, engineering and workmanship, and shall be capable of performing the required duties in a manner acceptable to Engineer/Owner who will interpret the meaning of drawings and specifications and shall be entitled to reject any component or material, which in his judgement is not in full accordance herewith.

1.03.0

The omission of specific reference to any component/accessory necessary for the proper performance of Miscellaneous Pumps and drives shall not relieve the bidder of the responsibility of providing such facilities to complete the supply of equipment at quoted prices.

1.04.0

BHEL's / Customer's representative shall be given full access to the shop in which the equipment are being manufactured or tested and all test records shall be made available to him.

1.05.0

The equipment covered under this specification shall not be dispatched unless the same have been finally inspected, accepted and shipping release issued by BHEL/Customer.

2.00.00

CODES AND STANDARDS

2.01.00

In addition to the requirements spelt out elsewhere in the specification, the equipment to be provided under this section shall specifically conform to the following codes, standards, specifications and regulations, as applicable, including all the latest amendments subsequent to the year of publication as mentioned below.

2.01.01

IS-1520/1980:

Horizontal Centrifugal pumps for clear, cold and fresh water.

2.01.02

IS-5120/1977:

Technical requirements for Rotodynamic special Purpose pumps.

2.01.03

IS-5639/1970:

Pumps for handling chemicals & corrosive liquids.

2.01.04

IS-5659/1970:

Pumps for process water.

2.01.05


IS-6536/1972:


Pumps for handling volatile liquids.


2.01.06

IS-9137/1978:

Code for acceptance tests for centrifugal, mixed flow and axial flow pumps- Class 'C'.

| | | | |
|---|--|--|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 2 of 16 | |
| 2.01.07 | ISO 3555/1977: BS 5316/1977 Part 2 | Acceptance test for centrifugal, mixed flow and axial flow pumps - Class 'B' tests. | |
| 2.01.08 | ISO 2548/1973: BS 5316/1976 Part 1 | - Do - Class 'C' tests. | |
| 2.01.09 | API-610/1989: | Centrifugal pumps for general refinery services. | |
| 2.01.10 | HIS | Hydraulic Institute Standards, USA | |
| 2.01.11 | PTC 8.2/1965: | Power Test Codes - Centrifugal pumps. | |
| 2.01.12 | ASTM-1-165-55 | Standard Methods for Liquid Penetration Inspection. | |
| 2.02.00 | In case of any contradiction with the above standards and annexure, the stipulations in the annexure shall prevail and shall be binding on the bidder. | | |
| 3.00.00 | SCOPE OF SUPPLY & SERVICES: | | |
| 3.01.00 | The miscellaneous pumps and drives scope shall be as specified in Data Sheet A /Section IA. | | |
| 3.02.00 | The Capacity, Head, Materials of construction and other particulars of pumps are detailed in Data Sheet A of the specification. | | |
| 3.03.00 | Accessories: All the pumps under this specification shall be complete with following standard/special accessories. | | |
| 3.03.01 | Standard accessories: a) LT Electric drives/motors (as applicable) with cable gland and lugs at motor end. (The bare HT drive motors and LT motors not in bidder's scope of supply, wherever required supplied as free issue by BHEL refer Cl. 5.08.00). b) Pump motor coupling along with coupling guard. c) Common base plate for pumps and motor. d) Self contained lubrication system along with all internal piping, valves, fittings, specialties etc. as required. | | |

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 3 of 16 | |
| <p>e) Counter flanges for suction/ discharge nozzles along with fixing nuts, bolts and gaskets.</p> <p>f) Anchor bolts, nuts, seating steel works, shims etc. as necessary for mounting the pump-motor unit on civil foundations.</p> <p>g) Suitable vent (with valves)/ lifting/ handling attachments for the pump/ motor/ accessories.</p> <p>h) Suitable drain connections with isolating valves as applicable.</p> <p>i) Supply of first fill of lubricants with topping requirements for one year of operation after commissioning and handing over of equipment.</p> <p>j) Set of “Special” Tools & Tackles for Pumps and motors, if any.</p> <p>k) Erection and commissioning spares, “on as required” basis.</p> <p>l) Bidder shall provide various drawings, data, calculations, test reports/ certificates, operation and maintenance manuals, As-built drawings, etc. as specified and as necessary.</p> <p>m) Mandatory spares as specified in respective Data Sheet-A of this section.</p> | | | |
| 3.04.00 | Services included in Bidder’s Scope: | | |
| 3.04.01 | The pumps shall be guaranteed to meet the performance requirements specified vide Data Sheet -A and also for trouble free operation after commissioning. Schedule of performance guarantees (Section-IIIA) duly filled and signed shall be furnished with the bid. | | |
| 3.04.02 | Pumps with Mechanical seal shall be supplied with gland packing arrangement initially to site and gland packing arrangement shall be replaced by vendor with mechanical seal arrangement at site after commissioning of the pumps with gland packing. However Mechanical seal shall be dispatched along with main supply for this purpose. Shaft sleeve and any other item required for satisfactory operation of Mechanical seal after replacement at site shall be provided by the pump supplier without any cost implication to BHEL. | | |
| 3.04.03 | The pumps erected by the purchaser shall be checked by the bidder for correctness of their installation, alignment, etc. at site prior to their commissioning. | | |
| 3.04.04 | After commissioning of pumps at site, site performance test for Noise, vibration and parallel running of pumps of all pumps for each unit/project shall be conducted by pump vendor at project site to ensure that the pumps meet the specified requirements. Pump vendor shall bring necessary instruments for conductance of site performance test. | | |

| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 4 of 16 | |

If the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, without any commercial implication to BHEL

Note: Applicability of conducting PG test at site by vendor as per above clause shall be applicable if indicated in Section-1A.

If conductance of PG test of pumps at site for Noise, vibration and parallel running of pumps of all pumps for each unit/project is not in bidders scope and same is conducted by BHEL/ customer. In such cases also, if the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, without any commercial implication to BHEL.

3.04.05 Performance Guarantees for pumps shall stand valid till the satisfactory completion of performance testing by BHEL and its acceptance by purchaser / customer.

3.05.00 Works excluded from Bidder's Scope:

- All HT motors and those LT Motors which are specifically excluded.
- Civil foundation
- Suction/ discharge pipe works
- MCC/ Switchgear/Power supply
- Power and Control Cables, unless specifically specified in Electrical/ Systems portion of the specification.
- Erection of equipments.

4.00.00 BID EVALUATION CRITERIA & LIQUIDATED DAMAGES FOR SHORTFALL:


4.01.00 The bids received shall be evaluated for power consumption at inlet to the motors, in respect of pumps specified in Data Sheet-A (working pump only viz. not the standby), for the purpose of price comparisons as briefed below:


The bid evaluation shall be done at the rate as specified in Data Sheet A per one (1) KW Power consumption, per working pump as follows.


$$KW = \frac{Q \times H \times S}{P \times M \times 367.2}$$

Where Q = Rated capacity M³/hr
H = Rated TDH, MWC
P = Pump Efficiency
M = Motor Efficiency.
S = Specific Gravity of fluid handled


4.02.00 The efficiencies for pumps and motors for arriving at benchmark power for Bid Evaluation shall be as indicated in Data Sheet A for various pumps.


| | | | |
|--|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 5 of 16 | |
| <p>No advantage shall be given to the bidder for Aux. Power quoted lower than the Bench mark values calculated with KW calculation formula at Cl. 4.01.00 <i>above, considering the bid evaluation efficiencies for pump and motor as indicated in Data Sheet-A.</i> However the bids shall be evaluated as above if the Aux. Power quoted are higher than Bench mark values.</p> <p>NOTE:</p> <ol style="list-style-type: none">Efficiencies for HT motors and LT motors not in bidder's scope, for bid evaluation purpose shall be taken based on the maximum value as furnished in Data Sheet A.During contract stage the Guaranteed power consumption of Pumps with BHEL supplied drives (HT/LT) for successful bidder shall be reworked by BHEL as below: <p>Revised guarantee power consumption shall be as per KW calculation formula at Cl. 4.01.00 <i>above, where P = pump efficiency guaranteed by bidder and M = motor efficiency as per approved datasheet of the supplied HT/LT motor.</i></p> <p>4.03.00 Liquidated damages for shortfall in Guaranteed KW</p> <p>The above guaranteed power consumption shall be demonstrated by the successful bidder during performance testing at works/ site.</p> <p>For pumps with BHEL supplied drives, the power consumption shall be compared with the reworked guarantee power consumption, defined as per note no. 2 of Cl. 4.02.00 above for the purpose of shortfall.</p> <p>The liquated damages @ twice the bid evaluation rate as above per KW per working pump shall be levied in the event of failure of bidder to demonstrate the guaranteed power consumption.</p> <p>5.00.00 TECHNICAL REQUIREMENTS:</p> <p>5.01.00 The pumps shall meet the technical requirements of Section-I as well as Section-II. In the event of any contradiction of Section-II with Section-I, the Section-I will prevail.</p> <p>5.02.00 The pumps shall be Electric motor driven.</p> <p>5.03.00 The Pumps shall conform to HIS. It is bare minimum requirement, however, any other equivalent or stringent standard is also acceptable, if, all the requirements of HIS are also met.</p> <p>5.04.00 The horizontal pumps shall be Horizontal split casing type with speeds not exceeding 1500 RPM or as indicated in Data Sheet-A.</p> <p>5.05.00 No negative tolerance shall be permitted in rated capacity & TDH.</p> <p>5.06.00 No negative tolerance shall be permitted in efficiency at rated capacity.</p> | | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 6 of 16 | |
| 5.07.00 | The shut off head of pumps shall be more than pump rated TDH and percentage variation may vary depending on the specific speed of the pump as under: i. 10-15% for pumps of specific speed up to 1000 US units, ii. 15-20% for pumps of specific speed in the range of 1000 to 2000 US units, iii. 20-40% for pumps of specific speed in the range of 2000 to 4000 US units, iv. Above 50% for pumps of specific speed in the range of 4000 to 7000 US units. | | |
| 5.08.00 | All HT motors and those LT motors which are not in bidder's scope of supply: bare motors only, shall be supplied as free issue by BHEL through BHEL, based on ratings and TS (Torque - Speed) curve selected and furnished by the bidders along with their un-priced bid. The responsibility for satisfactory operation for combined performance of pumps & motors shall rest with the bidder only as if, the drive motors also have been supplied by the bidder. Couplings, base plate, foundation bolts, any other fittings, etc. as required shall be supplied by the bidders only. BHEL shall supply one number of each type of drive motors (where drive motor is not in bidder's scope of supply) for shop testing of pumps with job motors. All other motors shall be dispatched by BHEL directly to project sites. | | |
| 5.09.00 | For all HT motor driven pumps, BHEL has envisaged vibration-monitoring system in their own scope. The bidder shall make provisions for mounting following on the pump/ pump shaft: <ul style="list-style-type: none">• Purchaser's probes in both DE/NDE bearings of pumps• Key slots on pump shaft and flat surface on bearing housing for mounting vibration measuring block with dimensions as specified in Data Sheet A.• Other components as finalized during detailing.• For mounting of above on the HT motors & specifically excluded LT motors, same shall be taken care by BHEL. | | |
| 5.10.00 | The pumps shall be capable of developing the required total head at rated capacity for continuous operation. The pumps shall operate satisfactorily at any point on the Q-H characteristic curve over a range of 0% to 130% capacity and shall be suitable for continuous operation between 30% to 130% capacity. | | |
| 5.11.00 | Selection of the pumps shall be such that the design point shall be met even with negative manufacturing tolerance. | | |
| 5.12.00 | The total head capacity curve shall be continuously rising towards the shut off, the pumps shall preferably be non-overloading type and stable. | | |
| 5.13.00 | The pumps shall be capable of running over the entire range of NPSH conditions required without any noise, vibration or cavitations. The prevailing suction pressures for various pumps are indicated in Data Sheet-A for suitable mechanical design of pumps. | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 7 of 16 | |
| 5.14.00 | The pumps shall be of stiff shaft design. The minimum internal clearances should be sufficiently more than the maximum static deflection of the shaft. Shaft size selected must take into consideration the critical speed as specified in API-610. | | |
| 5.15.00 | Pumps and motors shall run smooth without undue noise and vibration. The vibration shall be within vibration norms for testing as per American National Standard for 'Rotodynamics Pump' for Vibration Measurement and allowable values, Doc. ANSI/ HIS 9.6.4-2009. The applicable vibration limits for each pump, shall be indicated in the Technical Data sheet to be furnished by the successful bidder after award of LOI/ PO. The noise level shall be limited to 85 dB at distance of 1.0M. | | |
| 5.16.00 | Pumps of a particular category shall be identical and shall be suitable for parallel operation with equal load division. Components of identical pumps shall be interchangeable. | | |
| 5.17.00 | After installation, the guaranteed values of noise, vibration and parallel operation of pumps shall be tested and verified. If the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, at his own cost. | | |
| 5.18.00 | High reliability of the pumps is an essential requirement and therefore it gets weightage over its efficiency. It is therefore essential that the bidder choose a standard proven model from the range of pumps manufactured. | | |
| 5.19.00 | The offered pumps shall be of proven design meeting the experience-qualifying requirement of their operation at two sites for a minimum period of one year or as specified in technical PQR. Any deviation to this criterion shall be suitably highlighted in the deviations schedule. | | |
| 5.20.00 | The bearings shall be self-water lubricated, no external water supply shall be available. The cooling/ lubrication water for bearings, etc. shall be tapped from the pump discharge and supplied thru' bidder's integral pipe work. If water handled by pump is dirty/ not suitable for lubrication/ cooling, the bidder shall provide requisite strainer/ filters, tanks, motorized valves, etc. after the tap off for the required service, the arrangement provided shall be subject to Purchaser's approval. | | |
| 6.00.00 | MANDATORY SPARES: | | |
| 6.01.00 | Bidder to provide the Mandatory spares listed vide Data Sheet-A. Unit price of mandatory spares shall be furnished in price Schedule. | | |
| 6.02.00 | Bidder shall include the cost of Mandatory Spares, unless specified otherwise in Sec-IA of the specification or NIT. | | |


| | | | |
|---|---|-------------------------------------|-------------------------|
| | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 8 of 16 | |
| <p>7.00.00 OTHER REQUIREMENTS:</p> <p>7.01.00 The quality of water handled by various pumps shall be as per Data Sheet-A.</p> <p>7.02.00 The materials of construction for various components specified are the minimum requirements and materials of construction for other components not specified shall be similarly selected by the bidder for the intended duty.</p> <p>7.03.00 The makes of various bought out items of bidder (i.e. motor, bearings, mechanical seal etc.) shall be subject to purchaser's approval in the event of order.</p> <p>7.04.00 Painting for Pumps</p> <p>a) The surface of SS, Gun metal, brass, bronze and non-metallic component shall not be applied with any painting.</p> <p>b) The Steel surface to be applied with painting shall be thoroughly cleaned before applying painting by brushing, shop blasting etc. as per the agreed procedure.</p> <p>c) For all the steel surfaces inside the (indoor installation) building, a coat of red oxide primes of min. thickness DFT of 50 microns followed up with under coat of Synthetic Enamel paint of min. thickness DFT of 50 microns shall be applied. The top coat shall consist of two coats each of min. thickness DFT of 50 microns of synthetic enamel paint and thus total DFT shall be min. 200 microns.</p> <p>d) For all the steel surfaces exposed to (outdoor installation) atmosphere, a coat of chlorinated rubber based zinc phosphate primer of min. thickness DFT of 50 microns followed up with under coat of chlorinated rubber paint of min. thickness DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with min. thickness DFT of 50 microns and top coat shall consist of two coats each of min. thickness DFT of 50 microns of chlorinated rubber paint shall be provided. Total DFT of paint system shall be min. 200 microns.</p> <p>7.05.00 It is mandatory for the bidder to submit along with the bid, the deviations if any – whether major or minor in the schedule of deviations only. In the absence of deviations listed in the “Schedule of deviations, the offer shall be deemed to be full conformity with the specification, “not-withstanding” anything else stated elsewhere in bidder’s offer. The implied/indirect deviations shall not be binding on the purchaser.</p> | | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 9 of 16 | |
| 8.00.00 | PERFORMANCE REQUIREMENTS | | |
| 8.01.00 | Performance requirements for the pumps shall be as guided in Data sheet - A enclosed with Section-I. | | |
| 8.02.00 | Pump(s) shall preferably be designed to have the best efficiency at flow within $\pm 10\%$ of the specified duty point flow. The pumps shall be suitable for continuous operation at any point within the "Range of Operation" as stipulated in the Data Sheet - A attached with Section-I. | | |
| 8.03.00 | Pump(s) shall preferably have a continuously rising head-capacity characteristics from the specified duty point towards shut-off point, the maximum being at shut-off to enable parallel operation. Under all circumstances, the 'range of operation' of the pumps shall exclude any unstable operating zone of the head-capacity curve. | | |
| 8.04.00 | Wherever specified in the Data Sheet - A, pumps of each category shall be suitable for parallel operation. The head vs. capacity, the BHP vs. capacity characteristics etc. shall be identical to ensure equal load sharing and trouble-free operation of any pump when the other pump(s) working in parallel with it trip. | | |
| 8.05.00 | The pump set along with drive motor shall run smooth without undue noise and vibration. Acceptable vibration limits shall be guided by the HIS of USA. Refer clause 5.15.00 above for permissible limits. | | |
| 9.00.00 | DESIGN AND CONSTRUCTION | | |
| 9.01.00 | Pump Casing | | |
| 9.01.01 | Pump casing shall be provided with adequate number of vents and priming connections with valves unless the pump is made self-venting and priming. Casing drain, as required, shall be provided complete with drain valves. It shall be provided with a connection for suction and discharge pressure gauge as standard feature. | | |
| 9.01.02 | Pump design must ensure that the nozzles are capable of withstanding external reactions not less than those specified in API-610. | | |
| 9.01.03 | In case where an expansion joint is located at pump discharge, the pump assembly will be subjected to an additional thrust which will be transmitted to the foundation. This additional thrust shall be taken into the consideration of pump design. | | |
| 9.02.00 | Impeller | | |
| 9.02.01 | The Impeller assembly shall be dynamically balanced and designed with critical speed substantially above the operating speed. | | |

| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 10 of 16 | |
| 9.03.00 | Wearing Rings | | |
| 9.03.01 | Replaceable type wearing rings shall be furnished to prevent damage to impeller and casing. | | |
| 9.04.00 | Shaft | | |
| 9.04.01 | Shaft size shall be selected considering that the critical speed shall be away from the operating speed as recommended in applicable Code/Standard. The critical speed shall be at least 30% higher than the rated speed. | | |
| 9.05.00 | Shaft Sleeves | | |
| 9.05.01 | Renewable type fine finished shaft sleeves shall be provided at the stuffing boxes/mechanical seals. Length of the shaft sleeves must extend beyond the other faces of gland packing or seal end plate so as to distinguish between the leakage past Shaft and shaft sleeve and that past the seals/glands. | | |
| 9.05.02 | Shaft sleeves shall be properly fastened to the shaft to prevent any leakage or loosening. Shaft sleeve assembly should ensure concentric rotation. | | |
| 9.06.00 | Bearings | | |
| 9.06.01 | Bearings shall be easily accessible without disturbing the pump assembly. A drain shall be provided at the bottom of each bearing housing. | | |
| 9.06.02 | Heavy-duty sleeve/ball/roller type bearings shall be provided to take care of the radial loads. | | |
| 9.06.03 | In case of sleeve type radial, axial thrust shall be absorbed in suitable hydraulic devices and/or thrust bearings. | | |
| 9.06.04 | Bearings and hydraulic devices (if provided for balancing axial thrust) shall be of adequate design for taking the entire pump load arising from all probable conditions of continuous operation. Life of the bearings shall be guided by the design standard of the pump. Antifriction bearings of standard type, if provided, shall be selected for a minimum life 20,000 hrs. of continuous operation at maximum axial and radial loads at rated speed. Thrust bearing shall be capable of running continuously at maximum load. | | |
| 9.06.05 | The bearing shall be oil/grease lubricated. Suitable lubricating arrangement for the bearings shall be furnished with the pump complete with all accessories like pump, filters, piping, fittings, valves, interlocking and supervising instruments etc. as necessary. The design shall be such that the bearing lubricant does not contaminate the liquid being pumped. | | |
| 9.06.06 | Bearing housing for HT motor driven pumps shall have provision for mounting temperature measuring device. | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 11 of 16 | |
| 9.06.07 | Bearings of reputed makes are to be provided, same shall be indicated in Technical Data sheet to be furnished by the successful bidder after award of LOI/ PO, subject to acceptance of BHEL/ end customer, without any price implication to BHEL. | | |
| 9.07.00 | Stuffing Boxes | | |
| 9.07.01 | Stuffing box design shall permit replacement of packing without removing any part other than the gland. | | |
| 9.07.02 | Stuffing boxes shall be sealed/cooled by the fluid being pumped/external clear water, as specified in the Annexure. All necessary pumps, piping, fittings, valves, instruments etc. as required for safe and trouble-free operation of the pumps and as specified in the Annexure shall be included in the scope of supply. | | |
| 9.08.00 | Mechanical Seals | | |
| 9.08.01 | Mechanical seals (cartridge type) shall be provided if specified in the Data Sheet-A of this section. The pump supplier shall co-ordinate with the seal maker in establishing the direct circulation rate for maintaining a stable film at the seal in the chamber. The seal piping system shall form an integral part of the pump assembly. | | |
| 9.08.02 | When handling liquids near boiling point, suitable arrangement for external cooling shall be provided so as to prevent flashing at the seal faces. | | |
| 9.08.03 | For the seals under vacuum service, the seal design must ensure sealing against atmospheric pressure, even when the pumps are not operating. | | |
| 9.08.04 | Pumps with Mechanical seal shall be supplied with gland packing arrangement initially to site and gland packing arrangement shall be replaced by vendor with mechanical seal arrangement at site after commissioning of the pumps with gland packing. However Mechanical seal shall be dispatched along with main supply for this purpose. The special tools (if any) required for above shall be arranged by bidder. | | |
| 9.08.05 | Mechanical seals of reputed makes are to be provided, same shall be indicated in Technical Data sheet to be furnished by the successful bidder after award of LOI/ PO, subject to acceptance of BHEL/ end customer, without any price implication to BHEL. | | |
| 9.09.00 | Drive Unit | | |
| 9.09.01 | The pumps shall be driven by electric motor directly coupled as specified in the Data Sheet-A of this section. A heavy duty coupling along with coupling guard shall be provided between the pump and drive unit. | | |
| 9.09.02 | Unless otherwise specified in Data Sheet-A of this section, drive unit power rating shall be the maximum of the following requirements. | | |

| | | | |
|--|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 12 of 16 | |
| <p>a) 16% margin over the pump shaft input power at the rated duty point.</p> <p>b) 10% margin over the maximum pump shaft input power required within the 'Range of Operation'.</p> <p>c) Pump shaft input power required considering the overloading of the pump assuming single pump operation in the event of tripping of one or more of the pumps operating in parallel.</p> | | | |
| 9.10.00 | Coupling for pump & Motor Shaft | | |
| 9.10.01 | The pump and motor shafts shall be connected with adequately sized flexible coupling of proven design with spacer to facilitate dismantling of the pump without disturbing the motor. Necessary coupling guard shall be provided. | | |
| 9.10.02 | No. of coupling holes for joining coupling hubs shall be even in number and preferably in multiples of four. | | |
| 10.00.00 | INSPECTION AND TESTING | | |
| 10.01.00 | The Quality Plans enclosed in the specification are for bidder's guidance only. The bidder shall comply with these and other minimum requirements specified in the specification and shall furnish his own quality plan in the event of order based on the guidance given as above, for approval by BHEL/Customer. | | |
| 10.02.00 | The Bidder shall carry out the following specific tests inspections to ensure that the equipment furnished lies in strict conformance with the specification and also in accordance with applicable codes/standards and good engineering practice. | | |
| <p>a) Identification and Testing</p> <p>i) All materials used for pump construction shall be of tested quality. Material shall be tested as per the relevant standard and test certificates shall be made available to the Owner.</p> <p>ii) 100% PMI (Positive Material Identification) inspection for material grade of pump casing, shaft and impeller shall be done by vendor & certification shall be submitted for review of BHEL. Further BHEL reserves the right to conduct random & independent PMI inspection on pump casing, shaft and impeller to ascertain the grade of material during inspection at vendor works.</p> <p>iii) Tests for each pump included under this section shall include but not be limited to the following:</p> | | | |

| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 13 of 16 | |
| <ul style="list-style-type: none"> - The entire surface of the impeller / casing / diffuser castings shall be subjected to Dye Penetration Test as per ASTM Specification no.:1-165-65. - Shaft coupling & other active components shall be subjected to Dye Penetration and Ultrasonic Tests. - Wearing rings, shaft sleeves shall be subjected to Dye Penetration Test. - Fabricated components of pumps shall be subjected to Dye Penetration test on weld. - Verification of material, witnessing of pouring, casting and inspection of finished fabricated/castings. - Inspection of finished castings for impeller and verification of materials. - Inspection of pump shaft and verification of material. - Witnessing of NDT/review of NDT reports. - Static balancing test for impeller and dynamic balancing of complete rotating parts as per ISO- 1940 to grade 6.3 or better. - Complete Inspection of assembled pump. | | | |
| b) Hydraulic Testing | | | |
| <p>The pump casing shall be hydrostatically tested at maximum of the following:</p> <ul style="list-style-type: none"> i. 2 times the TDH (Total Dynamic Head) at rated capacity (or) ii. 1.5 times the shut-off pressure (or) iii. System Design pressure indicated in Data Sheet-A of Section-I. | | | |
| <p>The HT pressure shall be maintained for a period of not less than 30 minutes. During testing there should not be any pressure drop & leakage.</p> | | | |
| c) Performance Test at Shop | | | |
| <ul style="list-style-type: none"> i) Each pump shall have to be tested to determine the performance curves of the pumps. These tests are to be conducted in presence of Owner's representative as per the requirements of the Standards of Hydraulic Institute of USA (ASME-Power Test Code PTC 8.2/BS-599) or any other equivalent standard. ii) Performance tests are to be conducted to cover the entire range of operation of the pumps at rated speed. These shall be carried out to span 130% of rated capacity up to pump shut-off condition. A minimum of five combinations of | | | |

| | | | |
|--|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 14 of 16 | |
| <p>head and capacity are to be achieved during testing to establish the performance curves, including the design capacity point, shut-off point and the two extremities of the range of operation as specified in the annexure. After completion of performance test, all pumps shall be stripped down for inspection of internals.</p> | | | |
| <p>iii) Tests shall be conducted with actual drive motors being furnished.</p> | | | |
| <p>iv) NPSH tests are to be conducted for each type at 3% head drop conditions, if specified in the pump approved QP.</p> | | | |
| <p>v) All rotating components of the pumps shall be subjected to static and dynamic balancing tests. The assembled rotor will be subjected to dynamic balancing tests.</p> | | | |
| <p>vi) Mechanical run test shall be carried out on all pumps to determine the vibration levels, noise levels etc. This test shall be conducted at site also. However, test value at site shall be used for the acceptance of the equipment.</p> | | | |
| 10.03.00 | Inspection of Mandatory/ Recommended spares shall be in line with approved QP for main supply. | | |
| 11.00.00 | DRAWINGS/ DOCUMENTS DISTRIBUTION SCHEDULE | | |
| 11.01.00 | After award of LOI, the successful bidder shall submit drawings/documents as per Data Sheet-C. | | |
| 11.02.00 | The no. of drawings/documents to be submitted shall be as per Data Sheet-C. | | |
| 12.00.00 | The various Sections-I's & II's along with Data Sheets attached in this specification together with the specification for Miscellaneous Pumps shall be complied with by the bidders. | | |
| 13.00.00 | Bidder to submit all drawing/ documents in soft as well as hard copy in the event of order as per schedule indicated in section-IA. | | |
| <p>Within one (1) week of receipt of BHEL comments a technical representative from Bidder's works shall come for meeting with BHEL along with revised documents to resolve all issues and incorporate all comments in the soft copy here only for further submission to customer.</p> | | | |
| <p>Further on receipt of customer's comments on the documents a technical representative from Bidder's works shall come for meeting with Customer to resolve all issues and incorporate all comments in the soft copy here only and further resubmission of same to Customer. The representative shall be available here till Category-I approval of all the drawings and documents.</p> | | | |


| | | | |
|----------|---|-------------------------------------|-------------------------|
| | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 15 of 16 | |
| 14.00.00 | Guarantee for all pumps shall at least remain valid for 18 months from the Unit commissioning date or as specified in NIT. | | |
| 15.00.00 | <p>The following documents only shall be furnished by the bidder with his offer:</p> <ul style="list-style-type: none"> a) Compliance certificate duly signed and stamped (enclosed at Section-IIIB). b) GA drawings of pumps and motors with following: (shall be only for reference purpose, same shall not be reviewed/commented by purchaser at this stage and shall be subject to approval only during contract). <ul style="list-style-type: none"> • Civil static & dynamic loads. • Foundation details. c) Guarantee Schedule duly signed and stamped (enclosed at Section-IIIA). d) Technical deviation schedule (if reqd.) (enclosed at Section-IIIC). e) Data for drive Motor (HT/LT- which is not in bidder's scope of supply - as applicable): Load torque speed curves of the pumps, selected motor rating, rpm, GD^2 of driven equipment. f) Unpriced copy of the price bid shall be furnished along with the technical bid. <p>Apart from above no other Drgs./Docs./Data sheets etc. are required to be submitted at bid stage and even if furnished shall not be taken cognizance of.</p> <p>In case of any deviation from this technical specification, the same shall be indicated in the schedule of deviations as per Section-IIIC or NIT. In the absence of duly filled schedules it will be assumed that the bid strictly conforms to the specification.</p> | | |

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION HORIZONTAL PUMPS | SPECIFICATION NO. PES-179-06 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 16 of 16 | |


DATA SHEET – C**Drawings / documents distribution schedule to be followed by successful Bidder:**


- 1.0** Drawings/documents submission schedule, shall be as per Section-IA.
The successful bidder shall submit at least following drawings/ documents:
- 1.1** Fully dimensioned outline general arrangement drawings of the pump and motor assembly. This drawing should include foundation base plate/sole plate details as applicable, civil foundation, anchor bolt details, loading data (Static and Dynamic), points of connections of external piping, cables and mounting of devices furnished by the supplier and details for Gap between Coupling Shafts, Float & details for axial/radial tolerance allowed etc. which are required for erecting agency during erection of pump.
- 1.2** Cross sectional drawing of the equipment showing the details of assembly of components and their material of construction with standard applicable codes.
- 1.3** Technical datasheet as per Datasheet-B (Section-IIID) including characteristic curves of pumps showing the following:
- Flow Vs Head
 - Flow Vs Power
 - Flow Vs Efficiency
 - Flow Vs NPSHR/ minimum submergence
- 1.4** QAP for pump and QAP for motors (if applicable).
- 1.5** GA, Datasheet, Curves etc. for drive motor (as applicable).
- 1.6** Operation and maintenance manual.
- 1.7** Lubrication arrangement drawings for external lubrication (if applicable).
- 1.8** PG test procedure as per clause 3.04.04 (if applicable).
- 1.9** Motor type test document (if applicable).
- 2.0** Within the stipulated time period as per vendor's drawings/ documents schedule as per NIT, the O&M Manual comprising of minimum following shall be submitted:
- Drawings of components & details as deemed necessary.
 - Instruction manual for erection, operation & maintenance.
 - Storage instruction.
- 3.0** Before dispatch of the equipment the bidder shall furnish the following.
- Material test certificates.
 - Shop test reports & certificates.
 - Fulfilment of packing instructions as indicated in Section-IA of this specification.
- 4.0** Distribution of drawings / documents for all projects:


The no. of copies of drawing/ documents to be submitted by the successful bidder, after the award of the contract shall be as per Section-IA or as specified in NIT.

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 1 of 18 | |

| | |
|---------|--|
| 1.00.00 | GENERAL INFORMATION |
| 1.01.0 | The general guidelines as illustrated in the subsequent clauses of this section shall be applicable for vertical pumps to be procured under the scope of this package. |
| 1.02.0 | It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to high standards of design, engineering and workmanship, and shall be capable of performing the required duties in a manner acceptable to Engineer/Owner who will interpret the meaning of drawings and specifications and shall be entitled to reject any component or material, which in his judgement is not in full accordance herewith. |
| 1.03.0 | The omission of specific reference to any component/accessory necessary for the proper performance of Miscellaneous Pumps and drives shall not relieve the bidder of the responsibility of providing such facilities to complete the supply of equipment at quoted prices. |
| 1.04.0 | BHEL's / Customer's representative shall be given full access to the shop in which the equipment are being manufactured or tested and all test records shall be made available to him. |
| 1.05.0 | The equipment covered under this specification shall not be dispatched unless the same have been finally inspected, accepted and shipping release issued by BHEL/Customer. |
| 2.00.00 | CODES AND STANDARDS |
| 2.01.00 | In addition to the requirements spelt out elsewhere in the specification, the equipment to be provided under this section shall specifically conform to the following codes, standards, specifications and regulations, as applicable, including all the latest amendments subsequent to the year of publication as mentioned below. |
| 2.01.01 | IS-1710/1989: Vertical Turbine Pumps for Clear, Cold and Fresh Water. |
| 2.01.02 | IS-5120/1977: Technical requirements for Rotodynamic special purpose pumps. |
| 2.01.03 | IS-5639/1970: Pumps for handling chemicals & corrosive liquids. |
| 2.01.04 | IS-5659/1970: Pumps for process water. |
| 2.01.05 | IS-6536/1972: Pumps for handling volatile liquids. |
| 2.01.06 | IS-9137/1978: Code for acceptance tests for centrifugal, mixed flow and axial flow pumps- Class 'C'. |

| | | | |
|---|--|---|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 2 of 18 | |
| 2.01.07 | BS 5316 | Acceptance tests for Centrifugal, mixed flow Part-I/1976 and axial flow pumps - Class 'C' Tests (ISO 2548/1973) | |
| 2.01.08 | BS 5316 | Acceptance tests for Centrifugal, mixed flow Part-II/1977 and axial flow pumps - Class 'B' Tests (ISO 3555/1977) | |
| 2.01.09 | ANSI B 73.2M 1984 | Vertical inline centrifugal pumps for chemical process | |
| 2.01.10 | API-610/1989: | Centrifugal pumps for general refinery services. | |
| 2.01.11 | HIS | Hydraulic Institute Standards, USA | |
| 2.01.12 | PTC 8.2/1965: | Power Test Codes - Centrifugal pumps. | |
| 2.01.13 | ASTM-1-165-55 | Standard Methods for Liquid Penetration Inspection. | |
| 2.02.00 | In case of any contradiction with the above standards and annexure, the stipulations in the annexure shall prevail and shall be binding on the bidder. | | |
| 3.00.00 | SCOPE OF SUPPLY & SERVICES: | | |
| 3.01.00 | The miscellaneous pumps and drives scope shall be as specified in Data Sheet-A /Section IA. | | |
| 3.02.00 | The Capacity, Head, Materials of construction and other particulars of pumps are detailed in Data Sheet-A of the specification. | | |
| 3.03.00 | Accessories: | | |
| | All the pumps under this specification shall be complete with following standard/special accessories. | | |
| 3.03.01 | Standard accessories: | | |
| | a) | LT Electric drives/motors (as applicable) with cable gland and lugs at motor end. (The bare HT drive motors and LT motors not in bidder's scope of supply, wherever required supplied as free issue by BHEL refer Cl. 5.08.00). | |
| | b) | Pump motor coupling along with coupling guard. | |
| | c) | Common base/sole plate for pumps and motor. | |
| | d) | Thrust block assembly (Thrust pads, attachments) for transferring the pump thrust to concrete thrust block (concrete thrust block in purchaser scope), as per clause 5.23.00. | |

| | | | |
|--|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 3 of 18 | |
| <p>e) Thrust bearing temperature measurement devise to be provided.</p> <p>f) Self contained lubrication system along with all internal piping, valves, fittings, specialties etc. as required.</p> <p>g) Counter flanges for suction/ discharge nozzles along with fixing nuts, bolts and gaskets.</p> <p>h) Anchor bolts, nuts, seating steel works, shims etc. as necessary for mounting the pump-motor unit on Civil foundations.</p> <p>i) Suitable vent (with valves)/ lifting/ handling attachments for the pump/ motor/ accessories.</p> <p>j) Suitable drain connections with isolating valves as applicable.</p> <p>k) Supply of first fill of lubricants with toping requirements for one year of operation after commissioning and handing over of equipment.</p> <p>l) Set of “Special” Tools & Tackles for Pumps and motors, if any.</p> <p>m) Erection and commissioning spares, “on as required” basis.</p> <p>n) Bidder shall provide various drawings, data, calculations, test reports/ certificates, operation and maintenance manuals, As-built drawings, etc. as specified and as necessary.</p> <p>o) Mandatory spares as specified in respective Data Sheet-A of this section.</p> | | | |
| 3.04.00 | Services included in Bidder's Scope: | | |
| 3.04.01 | The pumps shall be guaranteed to meet the performance requirements specified vide Data Sheet -A and also for trouble free operation after commissioning. Schedule of performance guarantees (Section-IIIA) duly filled and signed shall be furnished with the bid. | | |
| 3.04.02 | The pumps erected by the purchaser shall be checked by the bidder for correctness of their installation, alignment, etc. at site prior to their commissioning. | | |
| 3.04.03 | After commissioning of pumps at site, site performance test for Noise, vibration and parallel running of pumps of all pumps for each unit/project shall be conducted by pump vendor at project site to ensure that the pumps meet the specified requirements. Pump vendor shall bring necessary instruments for conductance of site performance test. If the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, without any commercial implication to BHEL. | | |

| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 4 of 18 | |

Note: Applicability of conducting PG test at site by vendor as per above clause shall be applicable if indicated in Section-1A.

If conductance of PG test of pumps at site for Noise, vibration and parallel running of pumps of all pumps for each unit/project is not in bidders scope and same is conducted by BHEL/ customer. In such cases also, if the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, without any commercial implication to BHEL.

3.04.04 Performance Guarantees for pumps shall stand valid till the satisfactory completion of performance testing by BHEL and its acceptance by purchaser / customer.

3.05.00 Works excluded from Bidder's Scope:

- All HT motors and those LT Motors which are specifically excluded
- Civil foundation
- Suction/ discharge pipe works
- MCC/ Switchgear/Power supply
- Power and Control Cables, unless specifically specified in Electrical/ Systems portion of the specification.
- Erection of equipments.

4.00.00 BID EVALUATION CRITERIA & LIQUIDATED DAMAGES FOR SHORTFALL:

4.01.00 The bids received shall be evaluated for power consumption at inlet to the motors, in respect of pumps specified in Data Sheet-A (working pump only viz. not the standby), for the purpose of price comparisons as briefed below:


The bid evaluation shall be done at the rate as specified in Data Sheet A per one (1) KW Power consumption, per working pump as follows.


$$KW = \frac{Q \times H \times S}{P \times M \times 367.2}$$


Where Q = Rated capacity M³/hr
H = Rated TDH, MWC
P = Pump Efficiency
M = Motor Efficiency.
S = Specific Gravity of fluid handled


4.02.00 The efficiencies for pumps and motors for arriving at benchmark power for Bid Evaluation shall be as indicated in Data Sheet A for various pumps.


No advantage shall be given to the bidder for Aux. Power quoted lower than the Bench mark values calculated with KW calculation formula at Cl. 4.01.00 above, considering the bid evaluation efficiencies for pump and motor as indicated in Data Sheet-A. However the


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 5 of 18 | |
| bids shall be evaluated as above if the Aux. Power quoted are higher than Bench mark values. | | | |
| NOTE: | | | |
| 1. Efficiencies for HT motors and LT motors not in bidder's scope, for bid evaluation purpose shall be taken based on the maximum value as furnished in Data Sheet A. | | | |
| 2. During contract stage the Guaranteed power consumption of Pumps with BHEL supplied drives (HT/LT) for successful bidder shall be reworked by BHEL as below: | | | |
| Revised guarantee power consumption shall be as per KW calculation formula at Cl. 4.01.00 above, where <i>P</i> = pump efficiency guaranteed by bidder and <i>M</i> = motor efficiency as per approved datasheet of the supplied HT/LT motor. | | | |
| 4.03.00 | Liquidated damages for shortfall in Guaranteed KW | | |
| The above guaranteed power consumption shall be demonstrated by the successful bidder during performance testing at works/ site. | | | |
| For pumps with BHEL supplied drives, the power consumption shall be compared with the reworked guarantee power consumption, defined as per note no. 2 of Cl. 4.02.00 above for the purpose of shortfall. | | | |
| The liquidated damages @ twice the bid evaluation rate as above per KW per working pump shall be levied in the event of failure of bidder to demonstrate the guaranteed power consumption. | | | |
| 5.00.00 | TECHNICAL REQUIREMENTS: | | |
| 5.01.00 | The pumps shall meet the technical requirements of Section-I as well as Section-II. In the event of any contradiction of Section-II with Section-I, the Section-I will prevail. | | |
| 5.02.00 | The pumps shall be Electric motor driven. | | |
| 5.03.00 | The Pumps shall conform to HIS. It is bare minimum requirement, however, any other equivalent or stringent standard is also acceptable, if, all the requirements of HIS are also met. | | |
| 5.04.00 | The type of Vertical pumps shall be as follows (if specifically not indicated otherwise in Data Sheet-A): a) Vertical turbine type pumps with 1500rpm. (if no. of stages <=5) shall be preferred. b) If stages of vertical turbine pumps are more than 5, then sump pump construction shall be preferred with 1500 rpm speeds. c) For pumps with maximum speed 3000rpm, sump pump construction is also acceptable. | | |
| 5.05.00 | No negative tolerance shall be permitted in rated capacity & TDH. | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 6 of 18 | |
| 5.06.00 | No negative tolerance shall be permitted in efficiency at rated capacity. | | |
| 5.07.00 | The shut off head of pumps shall be more than pump rated TDH and percentage variation may vary depending on the specific speed of the pump as under: i. 10-15% for pumps of specific speed up to 1000 US units, ii. 15-20% for pumps of specific speed in the range of 1000 to 2000 US units, iii. 20-40% for pumps of specific speed in the range of 2000 to 4000 US units, iv. Above 50% for pumps of specific speed in the range of 4000 to 7000 US units. | | |
| 5.08.00 | All HT motors and those LT motors which are not in bidder's scope of supply: bare motors only, shall be supplied as free issue by BHEL through BHEL, based on ratings and TS (Torque - Speed) curve selected and furnished by the bidders along with their un-priced bid. The responsibility for satisfactory operation for combined performance of pumps & motors shall rest with the bidder only as if, the drive motors also have been supplied by the bidder. Couplings, base plate, foundation bolts, any other fittings, etc. as required shall be supplied by the bidders only. BHEL shall supply one number of each type of drive motors (where drive motor is not in bidder's scope of supply) for shop testing of pumps with job motors. All other motors shall be dispatched by BHEL directly to project sites. | | |
| 5.09.00 | For all HT motor driven pumps, BHEL has envisaged vibration-monitoring system in their own scope. The bidder shall make provisions for mounting following on the pump/ pump shaft: <ul style="list-style-type: none">Purchaser's probes in both DE/NDE bearings of pumpsKey slots on pump shaft and flat surface on bearing housing for mounting vibration measuring block with dimensions as specified in Data Sheet A.Other components as finalized during detailing.For mounting of above on the HT motors & specifically excluded LT motors, same shall be taken care by BHEL. | | |
| 5.10.00 | The pumps shall be capable of developing the required total head at rated capacity for continuous operation. The pumps shall operate satisfactorily at any point on the Q-H characteristic curve over a range of 0% to 130% capacity and shall be suitable for continuous operation between 30% to 130% capacity. | | |
| 5.11.00 | Selection of the pumps shall be such that the design point shall be met even with negative manufacturing tolerance. | | |
| 5.12.00 | The total head capacity curve shall be continuously rising towards the shut off, the pumps shall preferably be non-overloading type and stable. | | |
| 5.13.00 | The pumps shall be capable of running over the entire range of submergence/ NPSH requirement conditions required without any noise, vibration or cavitations. | | |


| | | | |
|--|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 7 of 18 | |
| <p>The prevailing suction pressures for various pumps are indicated in Data Sheet-A for suitable mechanical design of pumps.</p> | | | |
| 5.14.00 | <p>The pumps shall be of stiff shaft design. The minimum internal clearances should be sufficiently more than the max. static deflection of the shaft. Shaft size selected must take into consideration the critical speed as specified in API-610.</p> | | |
| 5.15.00 | <p>Pumps and motors shall run smooth without undue noise and vibration.</p> <p>The vibration shall be within vibration norms for testing as per American National Standard for 'Rotodynamics Pump' for Vibration Measurement and allowable values, Doc. ANSI/ HIS 9.6.4-2009. The applicable vibration limits for each pump, shall be indicated in the Technical Data sheet to be furnished by the successful bidder after award of LOI/ PO.</p> <p>The noise level shall be limited to 85 dB at distance of 1.0M.</p> | | |
| 5.16.00 | <p>Pumps of a particular category shall be identical and shall be suitable for parallel operation with equal load division. Components of identical pumps shall be interchangeable.</p> | | |
| 5.17.00 | <p>After installation, the guaranteed values of noise, vibration and parallel operation of pumps shall be tested and verified. If the site performance is found not meeting the requirements in any respect as specified, then the equipment shall be rectified or replaced by the vendor, at his own cost.</p> | | |
| 5.18.00 | <p>High reliability of the pumps is an essential requirement and therefore it gets weightage over its efficiency. It is therefore essential that the bidder choose a standard proven model from the range of pumps manufactured.</p> | | |
| 5.19.00 | <p>The offered pumps shall be of proven design meeting the experience-qualifying requirement of their operation at two sites for a minimum period of one year or as specified in technical PQR. Any deviation to this criterion shall be suitably highlighted in the deviations schedule.</p> | | |
| 5.20.00 | <p>The bearings shall be self-water lubricated, no external water supply shall be available. The cooling/ lubrication water for bearings, etc. shall be tapped from the pump discharge and supplied thru' bidder's integral pipe work.</p> | | |
| 5.21.00 | <p><u>If water handled by pump is sea water/ dirty/ not suitable for lubrication/ cooling:</u></p> | | |
| 5.21.01 | <p>The bearing lubrication/cooling may be specifically reviewed by bidders for the suitability with water analysis enclosed with Data Sheet-A of this section.</p> <p>These pumps shall necessarily be provided with Thordan type line shaft bearings even if the other type of bearings are claimed suitable by the manufacturers.</p> | | |


| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 8 of 18 | |
| <p>The bidder's shall satisfactorily establish the adequacy of self water lubrication if provided, for similar rating pumps installed for the duty condition in the event of order. In absence of adequate documentary evidence to the satisfaction level of BHEL, the bidder shall provide force water lubrication as per clause 5.21.02 below without any cost implication.</p> | | | |
| 5.21.02 | <p>In the event, the forced water lubrication is envisaged by the bidder, the following minimum requirements shall be complied with further details subject to Purchaser's approval during detailed engineering after the award of order.</p> <p>One set of common water lubrication system shall be provided separately for each type of pumps. The lubricating system shall provide continuous lubrication to all the pumps during operation and the minimum requirements shall be as follows:</p> <ul style="list-style-type: none">• 2X100 % duty self cleaning strainers of suitable size and mesh opening shall be installed on the common pump discharge and outlet shall be led to 1 no. 6 hrs. storage or min. 10 M3 capacity tank of carbon steel MOC, to be placed on roof of pump house .• 2X100 % duty horizontal centrifugal lubricating pumps with TDH more than the shut off head of the subject pumps shall be provided. The capacity of each pump shall be sufficient to lubricate all of the subject pumps including 10% margin on capacity and head to suit requirement with 10 % margin with head.• These horizontal pumps shall take suction from the overhead Sintex tank as explained above.• Associated piping, fittings, Tank inlet motor operated valve, lubricating pumps suction & discharge isolating valves, motorised/ solenoid valves (as per purchaser's approval), lubricating pumps discharge check valves and lubricating pipe isolating valve at inlet to each of subject pump, etc. as required shall be provided.• Instrumentation – Level Gauge, high level & low level switches for tank, pressure gauges at suction & discharge of each lubricating water pumps, low pressure switch on lubricating pipe at inlet to each of subject pump for subject pump start interlock, pressure switch on lubricating pipe at common discharge of subject pump for start up of stand by pump etc., as required subject to purchaser's approval shall be provided. | | |


| | | | |
|--|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 9 of 18 | |
| <ul style="list-style-type: none">Bidder shall supply any other equipment/ instrument required for proper functioning of the lubricating system, as deemed necessary during contract without any price implication to BHEL.Bidder shall also provide a relay based local control panel for proper functioning of the above system. The system shall be suitable for fully automatic operation as per approved write-up during detailed stage.Subject pumps shall be provided with shaft enclosing tube in the event above Lubrication system is envisaged by bidder. MOC for shaft enclosing tube shall be equivalent/ superior to MOC for column pipe for subject pump. <p>The complete forced water lubrication as above – if applicable, shall be in bidder's scope. Bidder to inform in schedule of deviation at bid submission stage, if fresh water is required for forced water lubrication system.</p> | | | |
| 5.22.00 | For Vertical pumps no thrust block is being provided except for pumps of projects, specified in Sec-IA of this specification. Bidder to design the pump foundation system (base plate/ sole plate, discharge head, foundation bolts etc.) capable of transferring the pump thrust to the concrete pump foundation itself. | | |
| 5.23.00 | If specified in Sec-IA of specification, thrust block assembly (Thrust pads, attachments) for transferring the pump thrust to concrete thrust block (concrete thrust block in purchaser scope) to be provided by bidder. | | |
| 6.00.00 | MANDATORY SPARES: | | |
| 6.01.00 | Bidder to provide the Mandatory spares listed vide Data Sheet-A. Unit price of mandatory spares shall be furnished in price Schedule. | | |
| 6.02.00 | Bidder shall include the cost of Mandatory Spares, unless specified otherwise in Sec-IA of the specification or NIT. | | |
| 7.00.00 | OTHER REQUIREMENTS: | | |
| 7.01.00 | The quality of water handled by various pumps shall be as per Data Sheet-A. | | |
| 7.02.00 | The materials of construction for various components specified are the minimum requirements and materials of construction for other components not specified shall be similarly selected by the bidder for the intended duty. | | |


| | | | |
|---|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 10 of 18 | |
| 7.03.00 | The makes of various bought out items of bidder (i.e. motor, bearings etc.) shall be subject to purchaser's approval in the event of order. | | |
| 7.04.00 | Painting for Pumps | | |
| | a) The surface of SS, Gun metal, brass, bronze and non-metallic component shall not be applied with any painting. | | |
| | b) The Steel surface to be applied with painting shall be thoroughly cleaned before applying painting by brushing, shop blasting etc. as per the agreed procedure. | | |
| | c) For all the steel surfaces inside the (indoor installation) building, a coat of red oxide primes of min. thickness DFT of 50 microns followed up with under coat of Synthetic Enamel paint of min. thickness DFT of 50 microns shall be applied. The top coat shall consist of two coats each of min. thickness DFT of 50 microns of synthetic enamel paint and thus total DFT shall be min. 200 microns. | | |
| | d) For all the steel surfaces exposed to (outdoor installation) atmosphere, a coat of chlorinated rubber based zinc phosphate primer of min. thickness DFT of 50 microns followed up with under coat of chlorinated rubber paint of min. thickness DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with min. thickness DFT of 50 microns and top coat shall consist of two coats each of min. thickness DFT of 50 microns of chlorinated rubber paint shall be provided. Total DFT of paint system shall be min. 200 microns. | | |
| 7.05.00 | It is mandatory for the bidder to submit along with the bid, the deviations if any – whether major or minor in the schedule of deviations only. In the absence of deviations listed in the “Schedule of deviations, the offer shall be deemed to be full conformity with the specification, “not-withstanding” anything else stated elsewhere in bidder’s offer. The implied/indirect deviations shall not be binding on the purchaser. | | |
| 8.00.00 | PERFORMANCE REQUIREMENTS | | |
| 8.01.00 | Performance requirements for the pumps shall be as guided in Data sheet - A enclosed with Section-I. | | |
| 8.02.00 | Pump(s) shall preferably be designed to have the best efficiency at flow within ± 10% of the specified duty point flow. The pumps shall be suitable for continuous operation at any point within the “Range of Operation” as stipulated in the Data Sheet - A attached with Section-I. | | |


| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 11 of 18 | |
| 8.03.00 | <p>Pump(s) shall preferably have a continuously rising head-capacity characteristics from the specified duty point towards shut-off point, the maximum being at shut-off to enable parallel operation.</p> <p>Under all circumstances, the ‘range of operation’ of the pumps shall exclude any unstable operating zone of the head-capacity curve.</p> | | |
| 8.04.00 | <p>Wherever specified in the Data Sheet - A, pumps of each category shall be suitable for parallel operation. The head vs. capacity, the BHP vs. capacity characteristics etc. shall be identical to ensure equal load sharing and trouble-free operation of any pump when the other pump(s) working in parallel with it trip.</p> | | |
| 8.05.00 | <p>The pump set along with drive motor shall run smooth without undue noise and vibration. Acceptable vibration limits shall be guided by the HIS of USA. Refer clause 5.15.00 above for permissible limits.</p> | | |
| 9.00.00 | DESIGN AND CONSTRUCTION <p>Pumps shall be of vertical shaft, complete with bowl, column pipe, discharge head and base plate with all accessories. General design and constructional features of the pumps shall be as follows:</p> | | |
| 9.01.00 | Bowl Assembly | | |
| 9.01.01 | <p>This will be either a single or multi-stage centrifugal, mixed flow or axial flow type with discharge co-axial with shaft. Type of impeller shall be chosen on the basis of the pump specific speed and the characteristics of handling fluid.</p> | | |
| 9.01.02 | <p>Pumps (s) shall have provision for adjustment of impellers in vertical direction from an accessible location, preferably at the housing (where separate thrust bearing for the pump is provided). The adjustment mechanism must take into consideration the extension of the line shaft due to hydraulic down thrust, weight of the shaft and impeller.</p> | | |
| 9.02.00 | Discharge Head | | |
| 9.02.01 | <p>Pump (s) shall have above/below floor discharge, as specified in the Data Sheet-A, attached to this section.</p> | | |
| 9.03.00 | Column pipe | | |
| 9.03.01 | <p>Column pipe shall be flanged and of bolted connection. Column pipes shall be designed for full internal vacuum.</p> | | |
| 9.03.02 | <p>In case of multi-piece column pipe and shaft assembly, the design shall permit raising/lowering of the pump assembly piece by piece without any difficulty. Any fixtures, clamps, etc. necessary for such purpose shall be supplied by the Bidder under this section.</p> | | |


| | | | |
|--|---|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 12 of 18 | |
| The bidder shall also submit a write-up describing clearly the procedure of handling the pump. | | | |
| 9.04.00 | Impeller shaft, line shaft and head shaft | | |
| 9.04.01 | Shaft size shall be selected on the basis of maximum torque to be applied on the pump shaft. | | |
| | The critical speed shall be at least 30% higher than the rated speed. | | |
| 9.04.02 | Impeller shaft shall be guided by bearings provided in each bowl or above and below the impeller shaft assembly. The butting faces of the shaft shall be machined square to the assembly and the shaft shall chamfered at the edges. | | |
| 9.04.03 | Line shaft may be single or multiple pieces as required. In case of multiple pieces, line shaft shall be coupled as per the standard practice of the manufacture. For screwed coupling, directions shall permit tightening of the joint during pump operation. | | |
| 9.04.04 | Replaceable shaft sleeves shall be furnished at applicable location, particularly under stuffing box and at other locations, as considered necessary. | | |
| 9.05.00 | Shaft enclosing tube | | |
| | Shaft enclosing tube shall be required, unless self lubricated (and cooled) type of shaft bearings are asked for. Length of the shaft enclosing tube shall be in conformity with the shaft piece lengths. | | |
| 9.06.00 | Seal rings | | |
| | Replaceable seal/wear rings both on impeller and on casing shall be provided in case it is asked for in this specification. | | |
| 9.07.00 | Bearings | | |
| 9.07.01 | Shaft bearings | | |
| | Adequate number of properly designed bearings shall be provided for smooth and trouble free operation of the pump. Number of bearings shall consider the number of shaft pieces used and the critical speed of the shaft. Bearings shall be either lubricated by external clear water/oil/grease or self lubricated as specified in the Data Sheet-A of this section. | | |
| | In case of external water/oil lubrication, complete lubrication arrangement shall be furnished with the pump. In case of forced water lubrication of the shaft bearings, the system and other accessories shall be in the scope of supply of Bidder as per clause 5.21.02. | | |
| 9.07.02 | Thrust Bearing | | |

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 13 of 18 | |
| <p>Thrust bearing of adequate size and capacity shall be provided to take the vertical thrust of the impeller arising out of the pump operation and dead weight of the rotating components. Life of the thrust bearing shall be guided by the design standard of the pump. Thrust bearing shall be capable of running continuously at maximum load.</p> <p>Thrust bearing shall be either grease or oil lubricated. Lubrication arrangement shall be such that the lubricant does not contaminate the handling fluid. The arrangement shall also be adequate to protect the bearing, while the pump coast down to stop in case of power failure of the station. Pre-lubrication of the thrust bearing, if recommended by the pump manufacturer, shall be taken care of in designing the lubrication system.</p> <p>For thrust bearing, provision for temperature measurement shall be provided.</p> <p>Cooling of the thrust bearing, if necessary, shall be done by the handling fluid/external water, depending on the fluid handled.</p> <p>Location of the thrust bearing may be at the pump body or at the driver, or at both depending on the requirement indicated in this specifications or as per the recommendation of the pump manufacturer (and approved by Purchaser).</p> | | | |
| 9.07.03 | Bearings of reputed makes are to be provided, same shall be indicated in Technical Data sheet to be furnished by the successful bidder after award of LOI/ PO, subject to acceptance of BHEL/ end customer, without any price implication to BHEL. | | |
| 9.08.00 | Reverse Rotation | | |
| 9.08.01 | If indicated at Section-IA of the specification, the pump impeller and other rotating components shall be designed for reverse rotation, when subject to reverse flow at rated pump discharge head. | | |
| 9.09.00 | Drive Unit | | |
| 9.09.01 | The pumps shall be driven by electric motor directly coupled as specified in the Data Sheet-A of this section. A heavy duty coupling along with coupling guard shall be provided between the pump and drive unit. | | |
| 9.09.02 | Unless otherwise specified in Data Sheet-A of this section, drive unit power rating shall be the maximum of the following requirements. | | |
| | a) 16% margin over the pump shaft input power at the rated duty point. | | |
| | b) 10% margin over the maximum pump shaft input power required within the ‘Range of Operation’. | | |
| | c) Pump shaft input power required considering the overloading of the pump assuming | | |

| | | | |
|---|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 14 of 18 | |
| single pump operation in the event of tripping of one or more of the pumps operating in parallel. | | | |
| 9.09.03 | All Vertical pump motors shall be designed/capable of withstanding max. run away speed during reverse flow through pump. | | |
| 10.00.00 | INSPECTION AND TESTING | | |
| 10.01.00 | The Quality Plans enclosed in the specification are for bidder's guidance only. The bidder shall comply with these and other minimum requirements specified in the specification and shall furnish his own quality plan in the event of order based on the guidance given as above, for approval by BHEL/Customer. | | |
| 10.02.00 | The Bidder shall carry out the following specific tests inspections to ensure that the equipment furnished lies in strict conformance with the specification and also in accordance with applicable codes/standards and good engineering practice. | | |
| a) Identification and Testing | | | |
| i) All materials used for pump construction shall be of tested quality. Material shall be tested as per the relevant standard and test certificates shall be made available to the Owner. Material identification and testing shall include, but shall not be limited to the following components: | | | |
| <ul style="list-style-type: none">• Bowls and suction bells• Impeller and wearing rings• Shafts and shaft sleeves• Couplings• Bearings• Column pipes• Discharge heads• Bowl Assembly | | | |
| ii) 100% PMI (Positive Material Identification) inspection for material grade of pump casing, shaft and impeller shall be done by vendor & certification shall be submitted for review of BHEL. Further BHEL reserves the right to conduct random & independent PMI inspection on pump casing, shaft and impeller to ascertain the grade of material during inspection at vendor works. | | | |
| iii) Tests for each pump included under this section shall include but not be limited to the following: | | | |
| <ul style="list-style-type: none">- The entire surface of the impeller / casing / diffuser castings shall be subjected to Dye Penetration Test as per ASTM Specification no.:1-165-65. | | | |

| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 15 of 18 | |
| <ul style="list-style-type: none">- Shaft coupling & other active components shall be subjected to Dye Penetration and Ultrasonic Tests.- Wearing rings, shaft sleeves shall be subjected to Dye Penetration Test.- Fabricated components of pumps shall be subjected to Dye Penetration test on weld.- Verification of material, witnessing of pouring, casting and inspection of finished fabricated/castings.- Inspection of finished castings for impeller and verification of materials.- Inspection of pump shaft and verification of material.- Witnessing of NDT/review of NDT reports.- Static balancing test for impeller and dynamic balancing of complete rotating parts as per ISO- 1940 to grade 6.3 or better.- Complete Inspection of assembled pump. | | | |
| b) Hydraulic Testing | | | |
| <p>Bowls/ Suction bells, Columns pipe, Discharge head and any other applicable pressure parts shall be hydrostatically tested at maximum of the following:</p> <ul style="list-style-type: none">i. 2 times the TDH (Total Dynamic Head) at rated capacity (or)ii. 1.5 times the shut-off pressureiii. System Design pressure indicated in Data Sheet-A of Section-I. <p>The HT pressure shall be maintained for a period of not less than 30 minutes. During testing there should not be any pressure drop & leakage.</p> | | | |
| c) Performance Test at Shop | | | |
| <ul style="list-style-type: none">i) Each pump shall have to be tested to determine the performance curves of the pumps. These tests are to be conducted in presence of Owner's representative as per the requirements of the Standards of Hydraulic Institute of USA (ASME-Power Test Code PTC 8.2/BS-599) or any other equivalent standard.ii) Performance tests are to be conducted to cover the entire range of operation of the pumps at rated speed. These shall be carried out to span 130% of rated capacity up to pump shut-off condition. A minimum of five combinations of head and capacity are to be achieved during testing to establish the performance curves, including the design capacity point, shut-off point and the two extremities of the range of operation as specified in the annexure. After | | | |

| | | | |
|--|--|------------------------------|------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 16 of 18 | |
| <p>completion of performance test, all pumps shall be stripped down for inspection of internals.</p> <p>iii) Tests shall be conducted with actual drive motors being furnished.</p> <p>iv) Minimum submergence/ NPSH required tests are to be conducted for each type at 3% head drop conditions, if specified in the pump approved QP.</p> <p>v) All rotating components of the pumps shall be subjected to static and dynamic balancing tests. The assembled rotor will be subjected to dynamic balancing tests.</p> <p>vi) Mechanical run test shall be carried out on all pumps to determine the vibration levels, noise levels etc. This test shall be conducted at site also. However, test value at site shall be used for the acceptance of the equipment.</p> | | | |
| 10.03.00 | Inspection of Mandatory/ Recommended spares shall be in line with approved QP for main supply. | | |
| 11.00.00 | DRAWINGS/ DOCUMENTS DISTRIBUTION SCHEDULE | | |
| 11.01.00 | After award of LOI, the successful bidder shall submit drawings/documents as per Data Sheet-C. | | |
| 11.02.00 | The no. of drawings/documents to be submitted shall be as per Data Sheet-C. | | |
| 12.00.00 | The various Sections-I's & II's along with Data Sheets attached in this specification together with the specification for Miscellaneous Pumps shall be complied with by the bidders. | | |
| 13.00.00 | Bidder to submit all drawing/ documents in soft as well as hard copy in the event of order as per schedule indicated in section-IA. | | |
| | <p>Within one (1) week of receipt of BHEL comments a technical representative from Bidder's works shall come for meeting with BHEL along with revised documents to resolve all issues and incorporate all comments in the soft copy for further submission to customer.</p> <p>Further on receipt of customer's comments on the documents a technical representative from Bidder's works shall come for meeting with Customer to resolve all issues and incorporate all comments in the soft copy and further resubmission of same to Customer. The representative shall be available here till category I approval of all the drawings and documents.</p> | | |
| 14.00.00 | Guarantee for all pumps shall at least remain valid for 18 months from the Unit commissioning date or as specified in NIT. | | |


| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 17 of 18 | |

15.00.00 The following documents only shall be furnished by the bidder with his offer:

- a) Compliance certificate duly signed and stamped (enclosed at Section-IIIB).
- b) GA drawings of pumps and motors with following: (shall be only for reference purpose, same shall not be reviewed/commented by purchaser at this stage and shall be subject to approval only during contract).
 - Civil static & dynamic loads.
 - Foundation details.
 - Minimum Submergence required.
 - Clearances - Side, Back & Bottom
 - Min. Recommended crane capacity
- c) Guarantee Schedule duly signed and stamped (enclosed at Section-IIIA).
- d) Technical deviation schedule (if reqd.) (enclosed at Section-IIIC).
- e) Data for drive Motor (HT/LT- which is not in bidder's scope of supply - as applicable):
Load torque speed curves of the pumps, selected motor rating, rpm, GD^2 of driven equipment.
- f) Unpriced copy of the price bid shall be furnished along with the technical bid.

Apart from above no other Drgs./Docs./Data sheets etc. are required to be submitted at bid stage and even if furnished shall not be taken cognizance of.

In case of any deviation from this technical specification, the same shall be indicated in the schedule of deviations as per Section-IIIC or NIT. In the absence of duly filled schedules it will be assumed that the bid strictly conforms to the specification.

| | | | |
|---|---|-------------------------------------|-------------------------|
|  | TITLE: STANDARD TECHNICAL SPECIFICATION VERTICAL PUMPS | SPECIFICATION NO. PES-179-07 | |
| | | VOLUME: | |
| | | SECTION: IIA | |
| | | REV. NO. 04 | DATE: 01/07/2016 |
| | | SHEET 18 of 18 | |

DATA SHEET – C

Drawings / documents distribution schedule to be followed by successful Bidder:

- 1.0 Drawings/documents submission schedule, shall be as per Section-IA.
The successful bidder shall submit at least following drawings/ documents:
- 1.1 Fully dimensioned outline general arrangement drawings of the pump and motor assembly. This drawing should include foundation base plate/sole plate details as applicable, civil foundation, anchor bolt details, loading data (Static and Dynamic), points of connections of external piping, cables and mounting of devices furnished by the supplier and details for Gap between Coupling Shafts, Float & details for axial/radial tolerance allowed etc. which are required for erecting agency during erection of pump.
- 1.2 Cross sectional drawing of the equipment showing the details of assembly of components and their material of construction with standard applicable codes.
- 1.3 Technical datasheet as per Datasheet-B (Section-IIID) including characteristic curves of pumps showing the following:
 - a) Flow Vs Head
 - b) Flow Vs Power
 - c) Flow Vs Efficiency
 - d) Flow Vs NPSHR/ minimum submergence
- 1.4 QAP for pump and QAP for motors (if applicable).
- 1.5 GA, Datasheet, Curves etc. for drive motor (as applicable).
- 1.6 Operation and maintenance manual.
- 1.7 Lubrication arrangement drawings for external lubrication (if applicable).
- 1.8 PG test procedure as per clause 3.04.03 (if applicable).
- 1.9 Motor type test document (if applicable).
- 1.10 Test Procedure for Sump Model Study (if applicable).
- 2.0 Within the stipulated time period as per vendor's drawings/ documents schedule as per NIT, the O&M Manual comprising of minimum following shall be submitted:
 - a) Drawings of components & details as deemed necessary.
 - b) Instruction manual for erection, operation & maintenance.
 - c) Storage instruction.
- 3.0 Before dispatch of the equipment the bidder shall furnish the following.
 - a) Material test certificates.
 - b) Shop test reports & certificates.
 - c) Fulfilment of packing instructions as indicated in Section-IA of this specification.
- 4.0 Distribution of drawings / documents for all projects:

The no. of copies of drawing/ documents to be submitted by the successful bidder, after the award of the contract shall be as per Section-IA or as specified in NIT.

| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | QUALITY PLAN | | | SPEC. NO. PE-TS-XXX-100-N001 | | | DATE | | |
|---|---|---|--|---|-------------------------------------|--|--|---|-------------------------|---|---|
| CUSTOMER: | | | PROJECT: | | | QF NO.: PE-QP-999-100-N004 | | | DATE | | |
| ITEM: MISC. PUMPS (HORIZONTAL/VERTICAL) | | | SYSTEM: CW/ACW/DWC/PLANT/COMMON | | | PO NO.: | | | DATE | | |
| TYPE OF CHECK | | | QUANTITY OF CHECK | | | ACCEPTANCE NORMS | | | REMARKS | | |
| CLASS | | | MECHANICAL AND CHEM. ANALYSIS | | | REFERENCE DOCUMENTS | | | FORMAT OF RECORD | | |
| CHARACTERISTIC | | | MECHANICAL AND CHEM. ANALYSIS | | | APPROVED CS DRAWING/DATA SHEET | | | LAB REPORT/ MTC | | |
| COMPONENT & OPERATION | | | MECHANICAL AND CHEM. ANALYSIS | | | APPROVED CS DRAWING/DATA SHEET | | | LAB REPORT/ MTC | | |
| 2 | | | LAB. TEST | | | APPROVED CS DRAWING/DATA SHEET | | | LAB. REPORT | | |
| 3 | | | 1. MECHANICAL & CHEMICAL ANALYSIS. | | | APPROVED CS DRAWING/DATA SHEET | | | MILL T.C. OR LAB REPORT | | |
| 4 | | | 2. MEASUREMENT | | | MFR. DRAWING | | | INSPECTION REPORT | | |
| 5 | | | 3. ULTRA SONIC TEST | | | DEFECT ECHO MAX 20% OF B.W.E. LOSS OF BACK WALL ECHO 20% MAX | | | NOT CERTIFICATE | | |
| 6 | | | VERIFICATION OF SPRT CHART | | | RELEVANT MATERIAL SPECN. | | | CORRELATED SPRT CHARTS | | |
| 7 | | | LAB. TEST | | | ASTM A 262 | | | LAB. REPORT | | |
| 8 | | | 1. MECH & CHEM. TEST 2. MEASUREMENT 3. VISUAL EXAM | | | APPROVED GA DRG/DATA SHEET | | | MFR T.C. OR LAB. REPORT | | |
| 9 | | | | | | | | | | | |
| 10 | | | | | | | | | | | |
| 11 | | | | | | | | | | | |
| RAW MATERIALS | | | | | | | | | | | |
| 1.1 | CASINGS (INCLUDING BOWLS DIFFUSERS, STAGE BODIES, DISCH HEAD (IF CAST), ETC. - (AS APPLICABLE) AND IMPELLER | MECHANICAL AND CHEMICAL PROPS | CR | MECHANICAL AND CHEM. ANALYSIS | ONE/HEAT/BATCH | APPROVED CS DRAWING/DATA SHEET | RELEVANT MATERIAL SPECN. | LAB REPORT/ MTC | P | V | V |
| 1.2 | STUFFING BOX, SUCTION BELL, WEARING RINGS, NECK RINGS, SHAFT SLEEVES | MECHANICAL AND CHEMICAL PROPS | MA | MECHANICAL AND CHEM. ANALYSIS | ONE/HEAT/BATCH | APPROVED CS DRAWING/DATA SHEET | RELEVANT MATERIAL SPECN. | LAB REPORT/ MTC | P | V | V |
| 1.3 | BARS/FORGINGS FOR SHAFTS, LINE SHAFTS | 1. PHYSICAL & CHEMICAL PROPS 2. DIMENSIONS 3. INTERNAL DEFECTS FOR 40MM & ABOVE DIA. SHAFTS | OR | 1. MECHANICAL & CHEMICAL ANALYSIS. 2. MEASUREMENT 3. ULTRA SONIC TEST | 1/CAST OR 1/BARS 100% 100% | APPROVED CS DRAWING/DATA SHEET MFR. DRAWING | RELEVANT MATERIAL SPECN. DEFECT ECHO MAX 20% OF B.W.E. LOSS OF BACK WALL ECHO 20% MAX | MILL T.C. OR LAB REPORT INSPECTION REPORT NOT CERTIFICATE | P | V | V |
| 1.4 | STRESS RELIEVING/ HEAT TREATMENT OF CASTING OF ALL ABOVE (IF APPLICABLE) / SOLUTION ANNEALING OF SS CASTING | 1. VARIIFICATION OF HT CHART 2. IGC TEST FOR SS CASTING | MA | VERIFICATION OF SPRT CHART LAB. TEST | ALL BATCHES ONE SAMPLE/ HT BATCH | RELEVANT MATERIAL SPECN. ASTM A 262 | RELEVANT MATERIAL SPECN. ASTM A 262 Gr A | CORRELATED SPRT CHARTS LAB. REPORT | P | V | V |
| 1.5 | SHAFT ENCLISING TUBES, COLUMN PIPES & DISCHARGE ELBOW | 1. MECHANICAL & CHEMICAL PROPS. 2. DIMENSIONS. 3. SURFACE FINISH | MA | 1. MECH & CHEM. TEST 2. MEASUREMENT 3. VISUAL EXAM | 1/BATCH 100% 100% | APPROVED GA DRG/DATA SHEET | RELEVANT MATERIAL SPECN./MFG. APPROVED DOCS | MFR T.C. OR LAB. REPORT | P | V | V |
| FOR CUSTOMER REVIEW & APPROVAL | | | | | | | | | | | |
| Doc No.: | | | | | | | | | | | |
| Sign & Date | | | | | | | | | | | |
| Name | | | | | | | | | | | |
| Seal | | | | | | | | | | | |
| Reviewed by: | | | | | | | | | | | |
| Approved by: | | | | | | | | | | | |

ENGINEERING

Sign & Date

03/02/2020

TANUJ MATTA

Checked by:

03/02/2020

MOHIT KUMAR

Reviewed by:

03/02/2020

RAJESH KUMAR JAISWAL

BHEL

Sign & Date

03/02/2020

RAJESH KUMAR JAISWAL

Checked by:


03/02/2020

MOHIT KUMAR


Reviewed by:











03/02/2020








RAJESH KUMAR JAISWAL


| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | | QUALITY PLAN | | | | SPEC NO. PE-TS-XXX-100-NH | | DATE | | | | | | | |
|---|---|---|-------|---|------------------------|-------------------------------------|---|-----------------------------------|--------|-----------------------|--------------------------------|---|--|------------------|--|------------------|--|
|  | | | | CUSTOMER | | | | QIP NO. PE-QIP-100-NH04 | | DATE | | | | | | | |
| | | | | PROJECT : | | | | PO NO.: | | DATE | | | | | | | |
| | | | | ITEM: MISC PUMPS (HORIZONTAL/VERTICAL) | | | | SYSTEM: CW/ACW/DMC/WPLANT/COMMON | | SECTION: SHEET 2 OF 6 | | | | | | | |
| | | | | CLASS | | | | TYPE OF CHECK | | QUANTUM OF CHECK | | REFERENCE DOCUMENTS | | ACCEPTANCE NORMS | | FORMAT OF RECORD | |
| S. No. | COMPONENT & OPERATION | CHARACTERISTIC | CLASS | TYPE OF CHECK | QUANTUM OF CHECK | REFERENCE DOCUMENTS | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS | | | | | | | |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | | | | | | | |
| 1.6 | PLATE FLANGE, C/FLANGE | 1. MECHANICAL & CHEMICAL PROS. 2. DIMENSIONS. 3. SURFACE FINISH | MA | 1. MECH & CHEM TEST 2. MEASUREMENT 3. VISUAL EXAM | 1/CAST 100% 100% | APPROVED GA DRG DATA SHEET | RELEVANT MATERIAL SPECN/ M.P. DRG/ APPROVED DOC | MILL TC/ LAB REPORT | P | V | V | CORRELATION REQ. FOR MAT. OTHER THAN IS 2062 | | | | | |
| 1.7 | SUCTION STRAINER (IF APPLICABLE) | MECHANICAL & CHEMICAL PROS. | MI | MECH. & CHEMICAL TEST | 1/HEAT | APPROVED GA DRG DATA SHEET | RELEVANT MATERIAL SPECN/ M.P. DRG/ APPROVED DOC | MILL TC/ LAB REPORT | P | V | V | | | | | | |
| 1.8 | MECHANICAL SEAL (IF APPLICABLE) | TYPE, SIZE, MFRS. NO., MAKE | MA | VISUAL EXAM | 100% | APPROVED DATASHEET/ GA MECH. SEAL | APPROVED DATASHEET | | P | V | V | COMPLIANCE TC FOR APPROVED MAKE | | | | | |
| 1.9 | PUMP BEARINGS | TYPE, SIZE, MFRS. NO., MAKE | MA | VISUAL EXAM | 100% | APPROVED DATASHEET | APPROVED DATASHEET | | P | V | V | COMPLIANCE TC FOR APPROVED MAKE | | | | | |
| IN PROCESS CONTROL | | | | | | | | | | | | | | | | | |
| 2.1 | ALL COMPONENTS UNDER 1.00 ABOVE | VISUAL DEFECTS, DIMENSIONS | MA | VISUAL EXAM, MEASUREMENT | 100% | MFG. DRAWING | MFG. DRAWING | COMPLIANCE TC | P | V | V | | | | | | |
| 2.2 | IMPELLER | CLEANING AND DEBURRING | MA | VISUAL | 100% | MFG. DRAWING | MFG. DRAWING | | P | V | V | | | | | | |
| 2.3 | IMPELLER | DYNAMIC BALANCING | CR | DYNAMIC BALANCING | 100% | ISO 1940 | ISO 1940 Gr 6.3 | BALANCING CERTIFICATE | P | W | V | WITNESSING ONLY FOR SIZE GREATER THAN 10KW | | | | | |
| 2.4 | IMPELLER-ALL ACCESSIBLE SURFACES, WEARING RING, SHAFT SLEEVES, CASING | DP TEST | MA | DP TEST ON MCD AREA | 100% | APPENDIX 8 OF ASME SEC. VIII DIV. 1 | APPENDIX 8 OF ASME SEC. VIII DIV. 1 | NDT CERTIFICATE | P | W | V | | | | | | |
| 2.5 | SHAFT | DP TEST | MA | DP TEST ON MCD AREA | 100% | ASTM E 165 | NO RELEVANT INDICATION ALLOWED | NDT CERTIFICATE | P | W | V | | | | | | |
| 2.6 | CASINGS/ BOWLS, STAGE BODIES, DISCHARGE HEAD (IF CAST), SUCTION HOUSING, COLUMN PIPE DISCHARGE PIPE ETC | LEAK TIGHTNESS | CR | VISUAL | 100% | TECHNICAL DATA SHEET AND NOTE 2 | NO LEAKAGE FOR TEST DURATION OF 30 MIN. | HT CERTIFICATE | P | W | V | HAMMERING OF CASTINGS WITH WOODEN RUBBER Mallet before HYDRO TEST | | | | | |
| BIDDER/ SUPPLIER | | | | | | | | | | | FOR CUSTOMER REVIEW & APPROVAL | | | | | | |
| Name | | | | Sign & Date | | | | Doc No. | | | | Sign & Date | | Name | | Seal | |
| Prepared by: TANUJ MATTA | | | | Checked by: MOHIT KUMAR | | | | Reviewed by: RITESH KUMAR JAISWAL | | | | Approved by: | | | | | |

| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | QUALITY PLAN | | | | SPEC NO.-PE-TS-XXX-100-N001 | | DATE | | |
|---|--|--|-------|--|------------------|-----------------------------|-------------------|-----------------------|--------|---------|
|  | | CUSTOMER: PROJECT ITEM: MISC PUMPS (HORIZONTAL/VERTICAL) SYSTEM: CW/ACW/DMCW/PLANT/COMMON | | | | QP NO.: PE-QP-999-100-NI-01 | | DATE | | |
| | | | | | | PO NO.: | | DATE | | |
| | | | | | | SECTION: | | SHEET 3 OF 6 | | |
| S. No. | COMPONENT & OPERATION | CHARACTERISTIC | CLASS | TYPE OF CHECK | QUANTUM OF CHECK | REFERENCE DOCUMENTS | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | M C N | 10 |
| 2.7 | FABRICATED COMPONENTS | | MA | | 100% | | | | | |
| 2.7.1 | WELDING PROCEDURE SPECIFICATION | CORRECTNESS | MA | EXAM. | 100% | ASME SEC IX | ASME SEC IX | QW 482 OF ASME SEC IX | P V | V |
| 2.7.2 | WELDING PROCEDURE QUALIFICATION RECORD | WELD SOUNDNESS | MA | VISUAL, PHYS. TESTS RT (AS APPLICABLE) | 100% | ASME SEC IX | ASME SEC IX | QW 483 OF ASME SEC IX | P V | V |
| 2.7.3 | WELDER PERFORMANCE QUALIFICATION | WELD SOUNDNESS | MA | VISUAL, PHYS. TESTS RT (AS APPLICABLE) | 100% | ASME SEC IX | ASME SEC IX | QW 484 OF ASME SEC IX | P V | V |
| 2.7.4 | WELD FITUPS | DIMENSION & ALIGNMENT | MA | MEAS/VISUAL EXAM | 100% | WPS, MFG. DRAWING | WPS, MFG. DRAWING | IR LOGBOOK | P V | V |
| 2.7.5 | ROOT RUNS | SURFACE DEFECTS | MA | PENETRANT TEST | 100% | ASTM E 165 | NO SURFACE DEFECT | IR LOGBOOK | P V | V |
| 2.7.6 | WELDMENTS | SURFACE DEFECTS | MA | PENETRANT TEST | 100% | ASTM E 165 | ASME-VI DIV I | INSPN REPORT | P W | V |
| WELDING PROCEDURE APPROVAL BY BHEL ALT. 3RD PARTY (LLYODS.BVQI OR EQ.) IS ACCEPTABLE. | | | | | | | | | | |
| WITNESS BY BHEL & VERIFICATION BY CUSTOMER | | | | | | | | | | |

| BHEL | | BIDDER/ SUPPLIER | | FOR CERTIFYING REVIEW & APPROVAL | |
|--|------------|---|--------------|----------------------------------|------|
| Sign & Date | Name | Sign & Date | Name | Sign & Date | Name |
|  03/02/2020 Tanuj Matta | TANUJ MATT |  03/02/2020 Mohit Kumar | MOHIT KUMAR | | |
|  03/02/2020 Ajay Jain | AJAY JAIN |  03/02/2020 Ritesh Kumar | RITESH KUMAR | | |

| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | QUALITY PLAN | | | SPEC NO.: PE-TS-XXX- (00-N001) | | | DATE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|---|---|---|--|----------------------|---|------------------------------------|--------------------------|--------------------------------|--|--------|--|--|----------|--|--|----------|--|--|--------------------------------|--|--|-------------|------|-------------|------|-------------|------|---------|-------------|------|------|--|------------|---|--------------|--|----------------------|--|--|--|--|
|  | | | CUSTOMER: | | | QP NO.: PE-QP-999-100-N004 | | | DATE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | PROJECT : | | | PO NO.: | | | DATE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | ITEM: MISC. PUMPS (HORIZONTAL/VERTICAL) | | | SYSTEM: CW/ACW/MC/WPLANT/ (COMMON) | | | SECTION: SHEET 4 OF 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S. No. | COMPONENT & OPERATION | CHARACTERISTIC | CLASS | TYPE OF CHECK | QUANTUM OF CHECK | REFERENCE DOCUMENTS | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2.7.7 | BUTT WELDS | INTERNAL DEFECT | MA | UT/RT | 100% | ASME SEC. V | ASME-VIII DIV I | IR | P W V | WITNESSING OF U.T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2.7.8 | DISCHARGE HEAD, COLUMN PIPE, DISCHARGE PIPE, ETC. | 1. LEAK TIGHTNESS 2. DIMENSION | CR | 1. HYDROTEST 2. MEASUREMENT | 100% | APPROVED DATA SHEET/ APPROVED OP APPROVED GA- CS DRG/MFR DRG. | 1. NO LEAKAGE 2. MFR. DRAWING | IR | P W V | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3.0 | SUB-ASSEMBLY CONTROL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3.1 | ROTOR ASSEMBLY | ECCENTRICITY | MA | MEASUREMENT | 100% | APPROVED GA DRG/ MFR.DRAWING | APPROVED GA DRG/ MFR.DRAWING | IR/LOG BOOK | P V V | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3.2 | ROTOR ASSEMBLY RESIDUAL UNBALANCE | STATIC & DYNAMIC | CR | STATIC & DYNAMIC BALANCING | 100% | ISO 1940 | ISO1940 Gr.6.3 | BALANCING CERTIFICATE | P W V | WITNESSING ONLY FOR SIZE GREATER THAN 10KW | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3.3 | COMPLETE PUMP ASSEMBLY | COMPLETENESS, CORRECTNESS, CLEANLINESS, CLEARANCES, FREEDNESS, ALIGNMENT | MA | VISUAL EXAM MEASUREMENT | 100% | APPROVED DRG & MFG STANDARDS | APPROVED DRG & MFG STANDARDS | I.R. & CHECK LISTS | P V V | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <table border="1"> <thead> <tr> <th colspan="3">BIDDER</th> <th colspan="3">ENGINEER</th> <th colspan="3">QUANTITY</th> <th colspan="3">FOR CUSTOMER REVIEW & APPROVAL</th> </tr> <tr> <th>Sign & Date</th> <th>Name</th> <th>Sign & Date</th> <th>Name</th> <th>Sign & Date</th> <th>Name</th> <th>Doc No.</th> <th>Sign & Date</th> <th>Name</th> <th>Seal</th> </tr> </thead> <tbody> <tr> <td>Prepared by: </td> <td>TANUJ MATT</td> <td>Checked by: </td> <td>MOCHIT KUMAR</td> <td>Reviewed by: </td> <td>RITESH KUMAR JAISWAL</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> | | | | | | | | | | | BIDDER | | | ENGINEER | | | QUANTITY | | | FOR CUSTOMER REVIEW & APPROVAL | | | Sign & Date | Name | Sign & Date | Name | Sign & Date | Name | Doc No. | Sign & Date | Name | Seal | Prepared by:  | TANUJ MATT | Checked by:  | MOCHIT KUMAR | Reviewed by:  | RITESH KUMAR JAISWAL | | | | |
| BIDDER | | | ENGINEER | | | QUANTITY | | | FOR CUSTOMER REVIEW & APPROVAL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Sign & Date | Name | Sign & Date | Name | Sign & Date | Name | Doc No. | Sign & Date | Name | Seal | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Prepared by:  | TANUJ MATT | Checked by:  | MOCHIT KUMAR | Reviewed by:  | RITESH KUMAR JAISWAL | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |


| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | QUALITY PLAN | | SPEC NO.: PE-TS-XXX-1000-0001 | | DATE | | | | | |
|---|--|--|-------|---|-------------------|---|--------------------|---|--------|---------------|--|
|  | | CUSTOMER: | | QP NO.: PE-QP-099-100-N004 | | DATE | | | | | |
| | | PROJECT : | | PO NO. | | DATE | | | | | |
| | | ITEM: MISC. PUMPS (HORIZONTAL/VERTICAL) | | SYSTEM: CUMCINDMC/PLANT/COMMON | | SECTION: SHEET 5 OF 6 | | | | | |
| S. No. | COMPONENT & OPERATION | CHARACTERISTIC | CLASS | TYPE OF CHECK | QUANTITY OF CHECK | REFERENCE DOCUMENTS | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS | |
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | M C N | 10 | |
| 4 | FINAL INSPECTION, TESTS & PACKING DESPATCH CONTROL | | | | | | | | | | |
| 4.1 | PUMP WITH JOB/SHOP MOTOR ASSEMBLED ON INDIVIDUAL BASE FRAME | 1. Q/V/S HEAD. 2. Q/V/S POWER. 3. Q/V/S PUMP EFF. 4. VIBRATION 5. NOISE 6. BEARING TEMP. 7. LEAKAGES | CR | PERFORMANCE TEST | 100% | APPD. PERFORMANCE TEST PROCEDURE/ APPD. DATA SHEET/APPD. CURVES FOR VIBRATIONS - AS PER ANSI/HIS 9.6.4-2009 (VALUES AS PER APPROVED DATA SHEET) FOR BEARING TEMP. - BEARING HOUSING SHOULD NOT BE UNTOUCHABLY HOT. FOR LEAKAGE - MINOR LEAKAGE (DROP BY DROP) IN CASE OF GLAND PACKING ARRANGEMENT. | | I.R. PERF. TEST RECORD. PLOTTED CURVES | ✓ P W | W | * MINIMUM 7 POINTS FROM SHUT-OFF TO MAX. OPERATING FLOW COVERING ENTIRE OPERATION RANGE OF PUMP SHALL BE TAKEN. * CUSTOMER HOLD POINT |
| 4.2 | STRIP DOWN AFTER PERFORMANCE TEST | NPSH REQUIRED | CR | NPSH TEST | 1/MODEL | APPD. PERFORMANCE TEST PROCEDURE/ APPD. DATA SHEET/APPD. CURVES | | I.R. NPSH TEST RECORD. PLOTTED CURVES | ✓ P W | W | IF SPECIFIED or INSISTED BY CUSTOMER. |
| 4.3 | COMPLETE PUMP WITH UNIT MOTOR BASE FRAME COUNTER FLANGES ETC. INCLUDING ALL ACCESSORIES AS PER SECTION C OF SPECN. | UNIQUE WEAR TEAR AND RUBBING | MA | VISUAL EXAM AFTER STRIPPING | 1/MODEL | NO UNIQUE WEAR TEAR & RUBBING ON IMPELLER & WEAR RING | | INSP. REPORT | ✓ P W | W | WITNESS REQUIRED ONLY WHEN ABNORMAL SOUND OBSERVED DURING PERFORMING TEST. |
| | | COMPLETENESS, CLEANLINESS, OVERALL DIMENSIONS ORIENTATION, WORKMANSHIP AND FINISH | MA | VISUAL EXAM MEASUREMENT | 100% | APPD. G.A. DRAWING | APPD. G.A. DRAWING | INSP. REPORT | ✓ P W | V | |
| BIDDER/ SUPPLIER | | | | | | | | | | | |
| FOR CUSTOMER REVIEW & APPROVAL | | | | | | | | | | | |
| Sign & Date | | Name | | Sign & Date | | Name | | Sign & Date | | Name | |
| Prepared by:  03/02/2020 | | Tanuj Matta | | Checked by:  03/02/2020 | | Mohit Kumar | | Reviewed by:  03/02/2020 | | Pritesh Kumar | |
| Reviewed by:  03/02/2020 | | Ajay Jain | | Reviewed by:  03/02/2020 | | Pritesh Kumar | | Approved by:  03/02/2020 | | Pritesh Kumar | |

| MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | QUALITY PLAN | | | | SPEC NO. PE-TS-XXX-100-N001 | | DATE | | |
|--|-----------------------|--|-------------|-----------------------------------|------------------|--|--|--------------------------------|--------|---|
|  | | CUSTOMER: | | QP NO.: PE-QP-999-100-N004 | | DATE | | | | |
| | | PROJECT : | | PO NO.: | | DATE | | | | |
| | | ITEM: MISC PUMPS (HORIZONTAL VERTICAL) | | SYSTEM: CW/AC/DMC/W/PLANT/COMMON | | SECTION: | | SHEET 6 OF 6 | | |
| S. No. | COMPONENT & OPERATION | CHARACTERISTIC | CLASS | TYPE OF CHECK | QUANTUM OF CHECK | REFERENCE DOCUMENTS | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS |
| 1 | | 3 | 4 | 5 | 6 | 7 | 8 | 9 | M C N | 11 |
| 4.4 | PAINTING | 1. SURFACE FINISH, DFT, MARKINGS ETC. | MA | VISUAL EXAM MEASUREMENT AESTHETIC | 100% | APPD.DRG. | APPD.DGCS | IR | V P V | |
| 4.5 | PACKING, MARKING | SOUNDNESS OF PACKING | MI | VISUAL AESTHETIC | 100% | TECHNICAL SPECIFICATION/ MFG. STANDARD | TECHNICAL SPECIFICATION/ MFG. STANDARD | PHOTOGRAPHS | V P V | PHOTOGRAPHS OF PACKED MATERIAL TO BE VERIFIED BY BHEL BEFORE ISSUING MDCC |
| <p>NOTES:</p> <p>1. AS CAST HEAT MARKS SHALL BE PROVIDED ON CI CASTING LIKE TOP & BOTTOM CASING.</p> <p>2. HYDRO TEST PRESSURE SHALL BE AT LEAST 2(TWO) TIMES THE DUTY POINT (OR) 1.5 TIMES OF SHUT OFF HEAD (OR) SYSTEM DESIGN PRESSURE, WHICHEVER IS HIGHER.</p> <p>3. THIS QAP IS ALSO APPLICABLE FOR SPARES.</p> <p>4. NO WELD REPAIRS PERMISSIBLE ON CI CASTING.</p> <p>5. MATERIAL SHALL BE AS PER APPROVED CROSS SECTION DRG. / DATA SHEET.</p> <p>6. STRIP TEST- INCASE OF ABNORMAL NOISE OBSERVED DURING PERF. TEST, THOSE PUMP WILL BE STRIPPED DOWN FOR VISUAL INSPECTION OF IMPELLER & WEAR SHALL BE OFFERED FOR VISUAL INSPECTION FOR WEAR / RUBBING MARKS.</p> <p>7. PUMPS WITH MECHANICAL SEAL ARRANGEMENT TO BE TESTED AND SUPPLIED WITH GLAND PACKING ARRANGEMENT. HOWEVER MANUFACTURER TO ENSURE DIMENTIONAL MATCHING OF MECHANICAL SEAL WITH PUMP GA DRAWING.</p> <p>8. BHEL RESERVES THE RIGHT FOR CONDUCTING REPEAT TEST IF REQUIRED.</p> <p>9. PMI (POSITIVE MATERIAL IDENTIFICATION) INSPECTION WITNESS BY "C"/"N" FOR MATERIAL GRADE OF PUMP CASING/BOWL ASSEMBLY, SHAFT, SHAFT SLEEVE, IMPELLER AND COLUMN PIPE (FOR VERTICAL PUMPS) ON RANDOM SAMPLE BASIS. HOWEVER, VENDOR TO CONDUCT 100% PMI AND PROVIDE PMI CERTIFICATES FOR REVIEW BY "C"/"N" DURING INSPECTION AT VENDOR WORKS.</p> | | | | | | | | | | |
| <p>LEGEND : - * RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.</p> <p>** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, C: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, N: CUSTOMER</p> <p>P- PERFORM, W- WITNESS, V- VERIFICATION, AS APPROPRIATE</p> <p>MA- MAJOR, MI- MINOR, CR- CRITICAL, MTC- Mill Test Certificate, TC- Test Certificate, IGC- Inter Granular Corrosion.</p> <p>GA- GENERAL ARRANGEMENT DRAWING, CS- CROSS-SECTIONAL DRAWING</p> | | | | | | | | | | |
| BHEL | | | | | BIDDER/SUPPLIER | | | FOR CUSTOMER REVIEW & APPROVAL | | |
| ENGINEERING: | | QUALITY | | SIGNATURE | | SIGNATURE | | SIGNATURE | | |
| Prepared by: | Sign & Date | Name | Checked by: | Sign & Date | Name | Reviewed by: | Sign & Date | Name | Seal | |
| Reviewed by: | Sign & Date | Name | Checked by: | Sign & Date | Name | Reviewed by: | Sign & Date | Name | Seal | |

506723/2021/PS-PEM-MSE

| | | | |
|--|--|--------------------------------------|-----------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS | SPEC. NO.: PE-TS-440-100-N001 | |
| | | SECTION: IIB | |
| | | SUB-SECTION: | |
| | | REV. NO. 00 | DATE 10.08.2021 |
| | | SHEET 1 | OF 1 |

STANDARD TECHNICAL REQUIREMENTS**SUB-SECTION – IIB****STANDARD TECHNICAL REQUIREMENTS (ELECTRICAL)**


| | | |
|---|--------------------------------|--------------------------------|
|  | TITLE : | SPECIFICATION NO. |
| | GENERAL TECHNICAL REQUIREMENTS | |
| | FOR | VOLUME NO. : II-B |
| | LV MOTORS | SECTION : D |
| | | REV NO. : 00 DATE : 27.07.2015 |
| | | SHEET : 1 OF 1 |

GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

4 X 270 MW MANU GURU TPS

| | | |
|---|--------------------------------|--------------------------------|
|  | TITLE : | SPECIFICATION NO. |
| | GENERAL TECHNICAL REQUIREMENTS | |
| | FOR | VOLUME NO. : II-B |
| | LV MOTORS | SECTION : D |
| | | REV NO. : 00 DATE : 27.07.2015 |
| | | SHEET : 1 OF 4 |

1.0

INTENT OF SPECIFIATION

The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer’s work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station.

Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.

2.0

CODES AND STANDARDS

Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards:

| | |
|-----------|--|
| IS:325 | Three phase Induction motors |
| IS : 900 | Code of practice for installation and maintenance of induction motors |
| IS: 996 | Single phase small AC and universal motors |
| IS: 4722 | Rotating Electrical machines |
| IS: 4691 | Degree of Protection provided by enclosures for rotating electrical machines |
| IS: 4728 | Terminal marking and direction of rotation rotating electrical machines |
| IS: 1231 | Dimensions of three phase foot mounted induction motors |
| IS: 8789 | Values of performance characteristics for three phase induction motors |
| IS: 13555 | Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment |
| IS: 2148 | Flame proof enclosures for electrical appliance |
| IS: 5571 | Guide for selection of electrical equipment for hazardous areas |
| IS: 12824 | Type of duty and classes of rating assigned |
| IS: 12802 | Temperature rise measurement of rotating electrical machines |
| IS: 12065 | Permissible limits of noise level for rotating electrical machines |
| IS: 12075 | Mechanical vibration of rotating electrical machines |

In case of imported motors, motors as per IEC-34 shall also be acceptable.

3.0

DESIGN REQUIREMENTS

3.1

Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A

3.2

Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information
Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.

3.3


Starting Requirements


3.3.1


Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.




3.3.2

Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.

| | | |
|---|--|--|
|  | TITLE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS | SPECIFICATION NO. VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 27.07.2015 SHEET : 2 OF 4 |
| | <p>The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors.</p> <p>3.3.3 The following frequency of starts shall apply</p> <ul style="list-style-type: none"> i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature. ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour) iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor <p>3.4 Running Requirements</p> <p>3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor.</p> <p>3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs.</p> <p>3.5 Stress During bus Transfer</p> <p>3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer.</p> <p>3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition.</p> <p>3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065.</p> <p>3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075.</p> <p>4.0 CONSTRUCTIONAL FEATURES</p> <p>4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy</p> <p>4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362.</p> <p>Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled</p> <p>4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.</p> | |


| | | |
|---|---|---------------------------------------|
|  | TITLE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS | SPECIFICATION NO. |
| | | VOLUME NO. : II-B |
| | | SECTION : D |
| | | REV NO. : 00 DATE : 27.07.2015 |
| | | SHEET : 3 OF 4 |
| 4.4. | Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors. | |
| 4.5 | Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point. | |
| 4.6 | <p>In case Class 'F' insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class 'B' insulation.</p> <p>In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.</p> | |
| 4.7 | Terminals and Terminal Boxes | |
| 4.7.1 | <p>Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A.</p> <p>Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet "A".</p> | |
| 4.7.2 | Unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end. | |
| 4.7.3 | Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or V W & V respectively. | |
| 4.7.4 | Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation. | |
| 4.7.5 | Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A. | |
| 4.7.6 | Degree of protection for terminal boxes shall be IP 55 as per IS 4691. | |
| 4.7.7 | Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes. | |
| 4.7.8. | Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors. | |
| 4.7.9 | Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type. | |
| 4.8 | Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal. | |
| 4.9 | General | |
| 4.9.1 | Motors provided for similar drives shall be interchangeable. | |

| | | |
|---|--|---------------------------------------|
|  | TITLE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS | SPECIFICATION NO. |
| | | VOLUME NO. : II-B |
| | | SECTION : D |
| | | REV NO. : 00 DATE : 27.07.2015 |
| | | SHEET : 4 OF 4 |
| <p>4.9.2 Suitable foundation bolts are to be supplied alongwith the motors.</p> <p>4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above.</p> <p>4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956.</p> <p>4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz.</p> <p>4.9.6 Name plate with all particulars as per IS: 325 shall be provided</p> <p>4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions.</p> <p>5.0 INSPECTION AND TESTING</p> <p>5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied.</p> <p>5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser.</p> <p>5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan.</p> <p>5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A.</p> <p>6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT</p> <p>a) OGA drawing showing the position of terminal boxes, earthing connections etc.</p> <p>b) Arrangement drawing of terminal boxes.</p> <p>c) Characteristic curves: (To be given for motor above 55 kW unless otherwise specified in Data Sheet).</p> <p>i) Current vs. time at rated voltage and minimum starting voltage.</p> <p>ii) Speed vs. time at rated voltage and minimum starting voltage.</p> <p>iii) Torque vs. speed at rated voltage and minimum voltage. For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling.</p> <p>iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.</p> | | |

| | | | | | | | | |
|---|---|--|---|--|--|--|---------------------------------|------------------|
|  | MANUFACTURER/ SUPPLIER NAME & ADDRESS | | BIDDER/ ADDRESS | | STANDARD QUALITY PLAN | | SPEC. NO : | DATE: |
| |  | |  | | CUSTOMER : | | QP NO.: PE-QP-999-Q-006, REV-02 | DATE: 17.04.2020 |
| | | | | | PROJECT: | | PO NO.: | DATE: |
| | | | | | ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V)) | | SYSTEM: | SECTION: II |

| S. NO. | COMPONENT & OPERATIONS | CHARACTERISTICS | CLASS | TYPE OF CHECK | QUANTUM OF CHECK | | REFERENCE DOCUMENT | ACCEPTANCE NORMS | FORMAT OF RECORD | AGENCY | REMARKS |
|--------|------------------------|---|-------|----------------------|------------------|------|--|--|---------------------|--------|---------|
| 1 | 2 | 3 | 4 | 5 | M | C/ N | 7 | 8 | 9 | ** | |
| | | 1.WORKMANSHIP | MA | VISUAL | 100% | - | MFG. SPEC. | MFG. SPEC. | LOG BOOK | P - | - |
| | | 2.DIMENSIONS | MA | VISUAL | 100% | - | MFG. DRG./ MFG. SPEC. | MFG. DRG./ MFG. SPEC. | LOG BOOK | P - | - |
| 1.0 | ASSEMBLY | 3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE | MA | VISUAL | 100% | - | MFG.SPEC./ | MFG.SPEC. | LOG BOOK | P - | - |
| 2.0 | PAINTING | 1.SHADE | MA | VISUAL | SAMPLE | - | MFG. SPEC/ APPROVED DATASHEET | MFG. SPEC/ APPROVED DATASHEET | LOG BOOK | ✓ P | V - |
| 3.0 | TESTS | 1.ROUTINE TEST INCLUDING SPECIAL TEST | MA | VISUAL | 100% | - | IS-325 / IS-12615/ APPROVED DATA SHEET | IS-325 / IS-12615/ APPROVED DATA SHEET | TEST/ INSPN. REPORT | ✓ P | V - |
| | | 2.OVERALL DIMENSIONS & ORIENTATION | MA | MEASUREMENT & VISUAL | 100% | - | APPROVED DRG/ DATA SHEET | APPROVED DRG/ DATA SHEET | TEST/ INSPN. REPORT | ✓ P | V - |

| BHEL | | | | BIDDER/ SUPPLIER | | | | FOR CUSTOMER REVIEW & APPROVAL | | | |
|--------------|---------------|---------|--------------|------------------|------|--------------|-------------|--------------------------------|------|-------------|--|
| ENGINEERING | | QUALITY | | Sign & Date | | Sign & Date | | Doc No: | | Sign & Date | |
| Prepared by: | Sign & Date | Name | Checked by: | Sign & Date | Name | Reviewed by: | Sign & Date | Name | Seal | | |
| Reviewed by: | HEMA KUSHWAHA | | Reviewed by: | RITESH KUMAR | | Approved by: | | | | | |

| | | | | | | | | | | | | |
|---|--|--|------------------------------|--|--|--|--|--|---------------------------------|--|------------------|--|
|  | MANUFACTURER/ SUPPLIER NAME & ADDRESS | | STANDARD QUALITY PLAN | | | | SPEC. NO. : | | DATE: | | | |
| | | | | | | | CUSTOMER : | | QP NO.: PE-QP-999-Q-006, REV-02 | | DATE: 17.04.2020 | |
| | | | | | | | PROJECT: | | PO NO.: | | DATE: | |
| | | | | | | | ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V)) | | SYSTEM: | | SECTION: II | |
| SHEET 2 of 2 | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|------------------|---------|-------------------------------|----|--------|------|------|---|-----------------------------|---------------------|---|---|---|---|
| | | 3.NAMEPLATE DETAILS | MA | VISUAL | 100% | - | IS-325 / IS-12615 / APPROVED DATA SHEET | SAME AS COL. 7 | TEST/ INSPN. REPORT | ✓ | P | V | - |
| 4.0 | PACKING | SURFACE FINISH & COMPLETENESS | MA | VISUAL | 100% | 100% | AS PER MFG. STANDARD / (#). | AS PER MFG. STANDARD / (#). | INSPC. REPORT | ✓ | P | W | - |
| (# REFER NOTE-8) | | | | | | | | | | | | | |

NOTES:

1. Routine tests on 100% motors shall be done by the vendor. However, BHEL/ Customer shall witness routine tests on random samples. The sampling plan shall be mutually agreed upon.
2. For exhaust/ventilation fan motors of rating up to 1.5 KW, only routine test certificates shall be furnished for scrutiny.
3. In case test certificates for these tests on similar type, size and design of motor from independent laboratory are available, the same is valid for 5 years.
4. BHEL reserves the right to perform repeat test, if required.
5. After packing and prior to issue MDCC, photographs of items to be despatched shall be sent to BHEL for review.
6. In case of any changes in QP commented by customer at contract stage, same shall be carried out by bidder without any implication to BHEL/ Customer.
7. Project specific QP to be developed based on customer requirement.
8. For export job, BHEL technical specification for seaworthy packing to be followed.
9. Packing shall be suitable for storage at site in tropical climate conditions.
10. Latest revision/ year of issue of all the standards (IS/ ASME/ IEC etc.) indicated in QP shall be referred.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION,


** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,

P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE


MA: MAJOR, MI: MINOR, CR: CRITICAL

D: DOCUMENTATION

| BHEL | | | | BIDDER/ SUPPLIER | | | | FOR CUSTOMER REVIEW & APPROVAL | | | |
|--------------|---------------|-------------|--------------|------------------|----------------|--------------|--------------|--------------------------------|----------|------|--|
| ENGINEERING | | QUALITY | | Sign & Date | | Sign & Date | | Doc No: | | Name | |
| Prepared by: | HEMA KUSHWAHA | Checked by: | KUNAL GANDHI | Reviewed by: | PRAYVEEN DUTTA | Reviewed by: | RITESH KUMAR | Approved by: | JAISSWAL | Seal | |

| | | | | | | | | |
|---|---|--|--|--|--|--|--|--|
|  | MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | | STANDARD QUALITY PLAN | | | |
| | | | | | SPEC. NO. : | | | |
| | | | | | CUSTOMER : QP NO. : PE-QP-999-Q-007, REV-04 | | | |
| | | | | | DATE: 17.04.2020 | | | |
| PROJECT: | | | | | PO NO.: | | | |
| | | | | | SECTION: II | | | |
| ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | | | | SYSTEM: | | | |
| | | | | | SHEET 1 OF 9 | | | |

| SI No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | | Reference Document | Acceptance NORMS | FORMAT OF RECORD | | AGENCY | | |
|--------|---------------------------------------|----------------------------------|-------|------------------|------------------|-----|--------------------------|--|------------------|---|--------|---|---|
| | | | | | M | C/N | | | D | * | M | C | N |
| 1 | 1.0 RAW MATERIAL & BOUGHT OUT CONTROL | | | | | | | | 9 | | ** | | |
| 1.1 | SHEET STEEL PLATES, SECTION, EYEBOLTS | 1.SURFACE CONDITION | MA | VISUAL | 100% | - | - | FREE FROM BLINKS, CRACKS, WELDFISSURES ETC | LOG BOOK | | P | - | - |
| | | 2.DIMENSIONS | MA | MEASUREMENT | SAMPLE | - | MANUFACTURER'S DRG./SPEC | MANUFACTURER'S DRG./SPEC | LOG BOOK | | P | - | - |
| | | 3.PROOF LOAD TEST (ETE BOLT) | MA | MECH. TEST | SAMPLE | - | MANUFACTURER'S DRG./SPEC | MANUFACTURER'S DRG./SPEC | TEST REPORT | | PV | - | - |
| 1.2 | HARDWARES | 1.SURFACE CONDITION | MA | VISUAL | 100% | - | - | FREE FROM CRACKS, UN-EVENNESS ETC. | TEST REPORT | | P | - | - |
| | | 2.PROPERTY CLASS | MA | VISUAL | SAMPLES | - | MANUFACTURER'S DRG./SPEC | MANUFACTURER'S DRG./SPEC | TC | | PV | - | - |
| 1.3 | CASTING | 1.SURFACE CONDITION | MA | VISUAL | 100% | - | MANUFACTURER'S DRG./SPEC | FREE FROM CRACKS, BLOW HOLES ETC. | LOG BOOK | | PV | - | - |
| | | 2.CHEM. & PHY. PROP. | MA | CHEM & MECH TEST | 1*HEAT NO. | - | MANUFACTURER'S DRG./SPEC | MANUFACTURER'S DRG./SPEC | TC | | PV | - | - |
| 1.4 | PANT & VARNISH | 3.DIMENSIONS | MA | MEASUREMENT | 100% | - | MANUFACTURER'S DRG. | MANUFACTURER'S DRG. | LOG BOOK | | PV | - | - |
| | | 1.MAKE, SHADE, SHELF LIFE & TYPE | MA | VISUAL | 100% CONTINUOUS | - | MANUFACTURER'S DRG./SPEC | MANUFACTURER'S DRG./SPEC | LOG BOOK | | PV | - | - |

| | | | |
|----------------------------|----------------|---|--------------|
| BHEL | | | |
| ENGINEERING | | QUALITY | |
| Sign & Date | Name | Sign & Date | Name |
| HEMA KUSHWAHA | HEMA KHUSHWAHA |  | KUNAL GANDHI |
| Prepared by: | | Checked by: | |
| Reviewed by: PRAVEEN DUTTA | | Reviewed by: R K JAISWAL | |

| | |
|------------------|--|
| BIDDER/ SUPPLIER | |
| Sign & Date | |
| Seal | |


| | | | |
|--------------------------------|--|-------------|------|
| FOR CUSTOMER REVIEW & APPROVAL | | | |
| Doc No: | | Sign & Date | Seal |
| Reviewed by: | | | |
| Approved by: | | | |

| STANDARD QUALITY PLAN | | SPEC. NO. : | | | | | | | |
|--|---|-------------------------------------|-------|------------------------|---------------------------------------|----------------------------|----------------------------|-------------------|--------|
| CUSTOMER : | | QP NO. : PE-QP-999-Q-007, REV-04 | | | | | | | |
| PROJECT: | | PO NO.: | | | | | | | |
| ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | SYSTEM: II | | | | | | | |
| DATE: 17.04.2020 | | SHEET 2 OF 9 | | | | | | | |
| SI No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | Reference Document | Acceptance NORMS | FORMAT OF RECORD | AGENCY |
| 1 | | 3 | 4 | 5 | 6 | 7 | 8 | 9 | |
| 1.5 | SHAFT (FORGED OR ROLLED) | 1. SURFACE COND. | MA | VISUAL | 100% | - | FREE FROM VISUAL DEFECTS | LOG BOOK | P |
| | | 2. CHEM. & PHYSICAL PROPERTIES | MA | CHEM. & PHYSICAL TESTS | 1/HEAT NO. OR HEAT TREATMENT BATCH NO | MANUFACTURER'S DRG / SPEC. | MANUFACTURER'S DRG / STD. | TC | PV |
| | | 3. DIMENSIONS | MA | MEASUREMENT | 100% | - | MANUFACTURER'S DRG / SPEC. | LOG BOOK | PV |
| | | 4. INTERNAL FLAWS | CR | ULTRASONIC TEST | 100% | - | ASTM-A388 | INSPECTION REPORT | PW |
| 1.6 | SPACE HEATERS, CONNECTORS, TERMINAL BLOCKS, CABLES, CABLE LUGS, CARBON BRUSH TEMP. DETECTORS, RTD, BTDS | 1. MAKE & RATING | MA | VISUAL | 100% | - | MANUFACTURER'S DRG / STD. | INSPECTION REPORT | PV |
| | | 2. PHYSICAL COND. | MA | VISUAL | 100% | - | MANUFACTURER'S DRG / STD. | INSPECTION REPORT | PV |
| | | 3. DIMENSIONS (WHEREVER APPLICABLE) | MA | MEASUREMENT | SAMPLE | - | MANUFACTURER'S DRG / STD. | INSPECTION REPORT | PV |
| | | 4. PERFORMANCE/ CALIBRATION | MA | TEST | 100% | - | MANUFACTURER'S DRG / STD. | TEST REPORT | PV |

| BHEL | | | |
|----------------------------|---------------|-----------------------------------|--------------|
| ENGINEERING | | QUALITY | |
| Sign & Date | Name | Sign & Date | Name |
| HEMA KUSHWAHA | HEMA KUSHWAHA | | KUNAL GANDHI |
| Prepared by: | | Checked by: | |
| Reviewed by: PRAVEEN DUTTA | PRAVEEN DUTTA | Reviewed by: RITESH KUMAR JAISWAL | R K JAISWAL |


| BIDDER/ SUPPLIER | |
|------------------|--|
| Sign & Date | |
| Seal | |

| FOR CUSTOMER REVIEW & APPROVAL | | |
|--------------------------------|-------------|------|
| Doc No: | Sign & Date | Seal |
| Reviewed by: | | |
| Approved by: | | |

| | | | | | | | | | | |
|---|---|--|--|--|--|--|---------------------------------|--|-----------------|--|
|  | MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | STANDARD QUALITY PLAN | | | SPEC. NO. : | | DATE:17.04.2020 | |
| | | | | CUSTOMER : | | | QP NO.: PE-QP-999-Q.007, REV.04 | | | |
| | | | | PROJECT: | | | PO NO.: | | | |
| | | | | ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | | SYSTEM: | | | |
| | | | | | | | SECTION: II | | | |
| SHEET 3 OF 9 | | | | | | | | | | |

| Sl No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | | | Reference Document | Acceptance NORMS | FORMAT OF RECORD | | | AGENCY | | | | |
|---|--|---|-------|---------------------|------------------|---|-----|------------------------------------|---------------------------|------------------------------|----|---|--------|---|---|---|---|
| 1 | | 3 | 4 | 5 | 6 | | | 7 | 8 | 9 | . | * | ** | | | | |
| | | | | | | M | C/N | | | | | | | M | C | N | |
| 1.7 | OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC. | 1. SURFACE COND. ETC. 2.DIMENSION(BORE DIA, WALL THICKNESS, BDV AS RECEIVED, BDV AFTER FOLDING AT 180° | MA | VISUAL | 100% | - | - | - | NO VISUAL DEFECTS | TEST REPORT | PV | - | - | - | - | - | |
| 1.8 | SHEET STAMPING (PUNCHED) | 1. SURFACE COND. 2.DIMENSIONS INCLUDING BURS HEIGHT 3.ACCEPTANCE TESTS | MA | TEST | SAMPLE | - | - | MANUFACTURER'S STD. | MANUFACTURER'S STD. | LOG BOOK AND OR SUPPLIERS TC | PV | - | - | - | - | - | |
| | | | MA | VISUAL | 100% | - | - | NO VISUAL DEFECTS (FREE FROM BURS) | LOG BOOK | P | - | - | - | - | - | - | - |
| | | | MA | MEASUREMENT | SAMPLE | - | - | MANUFACTURER'S DRG. . | MANUFACTURER'S DRG. | LOG BOOK | PV | - | - | - | - | - | - |
| 1.9 | CONDUCTORS | 1. SURFACE FINISH 2.ELECT. PROP. & MECH. PROP | MA | ELECT. & MECH TESTS | SAMPLE | - | - | MANUFACTURER'S DRG./ STD. | MANUFACTURER'S DRG./ STD. | TC | PV | - | - | - | - | - | |
| | | | MA | VISUAL | 100% | - | - | FREE FROM VISUAL DEFECTS | LOG BOOK | *PV | - | - | - | - | - | - | - |
| | | | MA | ELECT. & MECH.TEST | SAMPLES | - | - | MANUFACTURER'S DRG./ SPEC. | MANUFACTURER'S / SPEC. | TC & VENDORS TEST REPORTS | PV | - | - | - | - | - | - |
| * MOTOR MANUFACTURER TO CONDUCT VISUAL CHECK FOR SURFACE FINISH ON RANDOM BASIS (10% SAMPLE) AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY | | | | | | | | | | | | | | | | | |

| | | | | | | | |
|----------------------------|----------------|------------------|--------------|--------------------------------|-------------|------|------|
| BHEL | | | | QUALITY | | | |
| ENGINEERING | | BIDDER/ SUPPLIER | | FOR CUSTOMER REVIEW & APPROVAL | | | |
| Sign & Date | Name | Sign & Date | Name | Doc No: | Sign & Date | Name | Seal |
| Prepared by: HEMA KUSHWAHA | HEMA KHUSHWAHA | Checked by: | KUNAL GANDHI | Reviewed by: | | | |
| Reviewed by: PRAVEEN DUTTA | PRAVEEN DUTTA | Reviewed by: | R K JAISWAL | Approved by: | | | |


| | | | | | | | | | |
|---|--|--|---|--|--|--|---|--|-------------------------|
|  | MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | STANDARD QUALITY PLAN | | | | SPEC. NO. : | | |
| | | | CUSTOMER : | | | | QP NO. : PE-QP-999-Q-007, REV-04 | | DATE: 17.04.2020 |
| | | | PROJECT: | | | | PO NO.: | | |
| | | | ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | | | SYSTEM: II | | SHEET 4 OF 9 |

| Sl No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | | | Reference Document | Acceptance NORMS | FORMAT OF RECORD | AGENCY | | | |
|--------|--------------------------------|---|-------|--|----------------------------------|------------------|------------------|--|---|--|----------------------|------------------|------------------|---|
| 1 | 2 | 3 | 4 | 5 | 6 | | | 7 | 8 | 9 | 10 | | | |
| | | | | | M | | C/N | | | | D | M | C | N |
| 1.10 | BEARINGS | 3.DIMENSIONS 1.MAKE & TYPE 2.DIMENSIONS 3.SURFACE FINISH | MA | MEASUREMENT VISUAL MEASUREMENT VISUAL | SAMPLE 100% SAMPLE 100% | - - - - | - - - - | MANUFACTURER'S DRG./ SPEC. MANUFACTURER'S DRG./ APPROVED DATASHEET APPROVED DATASHEET - | MANUFACTURERS / SPEC. MANUFACTURERS DRG./ APPROVED DATASHEET APPROVED DATASHEET/ MANUFACTURERS CATALOGUES FREE FROM VISUAL DEFECTS | LOG BOOK LOG BOOK LOG BOOK LOG BOOK | PV PV PV PV | - - - - | - - - - | |
| 1.11 | SUP RING (WHEREVER APPLICABLE) | 1.SURFACE COND. 2.DIMENSIONS 3.TEMP WITH STAND CAPACITY | MA | VISUAL MEASUREMENT ELECT.TEST | 100% SAMPLE SAMPLE | - - - | - - - | - MANUFACTURER'S DRG MANUFACTURER'S STD./APPROVED DATASHEET | FREE FROM VISUAL DEFECTS FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG | LOG BOOK LOG BOOK LOG BOOK | P P PV | - - - | - - - | |
| 1.12 | OIL SEALS & GASKETS | 1.MATERIAL OF GASKET 2.SURFACE COND. 3.DIMENSIONS | MA | -DO- VISUAL VISUAL MEASUREMENT | 100% 100% 100% SAMPLE | - - - - | - - - - | MANUFACTURER'S STD./APPROVED DATASHEET MANUFACTURER'S DRG/SPEC - MANUFACTURER'S DRG | MANUFACTURERS STD./APPROVED DATASHEET MANUFACTURERS DRG/ SPEC. FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG | LOG BOOK LOG BOOK LOG BOOK LOG BOOK | PV P P P | - - - - | - - - - | |


| | | | | | | | | | | | |
|-----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|---------------------------------|---------------------------------|---------------------------------|----------------|--|--|--|
| ENGINEERING | | | | BHEL | | | | QUALITY | | | |
| Sign & Date | Name | Sign & Date | Name | Sign & Date | Name | Sign & Date | Name | | | | |
| Prepared by: HEMA KUSHWAHA | Checked by: HEMA KUSHWAHA | Reviewed by: PRAVEEN DUTTA | Reviewed by: PRAVEEN DUTTA | Reviewed by: R K JAISWAL | Reviewed by: R K JAISWAL | Reviewed by: R K JAISWAL | Reviewed by: R K JAISWAL | | | | |

| | |
|-------------------------|-------------|
| BIDDER/ SUPPLIER | |
| Sign & Date | Seal |

| | |
|---|------------------------|
| FOR CUSTOMER REVIEW & APPROVAL | |
| Doc No: | Sign & Date |
| Reviewed by: | Name |
| Approved by: | Seal |



| | | | | | | | | | |
|---|--|--|--|--|--|----------------------------------|--|------------------|--|
|  | MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | STANDARD QUALITY PLAN | | | SPEC. NO. : | | | |
| | | | CUSTOMER : | | | QP NO. : PE-QP-999-Q-007, REV-04 | | DATE: 17.04.2020 | |
| | | | PROJECT: | | | PO NO.: | | | |
| | | | ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | | SYSTEM: | | SECTION: II | |
| | | | | | | SHEET 5 OF 9 | | | |

| Sl No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | | Reference Document | Acceptance NORMS | FORMAT OF RECORD | AGENCY | | | |
|--------|---|---|-------|---------------------------|------------------|-----|--|--|------------------|--------|----|---|---|
| 1 | 2 | 3 | 4 | 5 | 6 | | 7 | 8 | 9 | 10 | | | |
| | | | | | M | C/N | | | | D | M | C | N |
| 2.0 | IN PROCESS | 1.WORKMANSHIP & CLEANNESS | MA | VISUAL | 100% | - | MANUFACTURER'S DRG | GOOD FINISH | LOG BOOK | | PW | - | - |
| 2.1 | STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR) | 2.DIMENSIONS | MA | MEASUREMENT | 100% | - | MANUFACTURER'S DRG | MANUFACTURER'S DRG | LOG BOOK | | P | - | - |
| 2.2 | MACHINING | 1.FINISH | MA | VISUAL | 100% | - | -DO- | GOOD FINISH | LOG BOOK | | P | - | - |
| | | 2.DIMENSIONS | MA | MEASUREMENT | 100% | - | MANUFACTURER'S DRG | MANUFACTURER'S DRG | LOG BOOK | | P | - | - |
| | | 3.SHAFT SURFACE FLOWS | MA | PT | 100% | - | MANUFACTURER'S STD / APPROVED DATASHEET. ASTM E165 | MANUFACTURER'S STD / APPROVED DATASHEET. | LOG BOOK | ✓ | P | V | - |
| 2.3 | PAINING | 1.SURFACE PREPARATION | MA | VISUAL | 100% | - | MANUFACTURER'S STD / APPROVED DATASHEET | MANUFACTURER'S STD / APPROVED DATASHEET | LOG BOOK | | P | - | - |
| | | 2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT) | MA | MEASUREMENT BY ELCOMETER | SAMPLE | - | MANUFACTURER'S STD / APPROVED DATASHEET | MANUFACTURER'S STD / APPROVED DATASHEET | LOG BOOK | | P | - | - |
| | | 3.SHADE | MA | VISUAL | SAMPLE | - | MANUFACTURER'S STD / APPROVED DATASHEET | MANUFACTURER'S STD / APPROVED DATASHEET | LOG BOOK | | P | - | - |
| | | 4.ADHESION | MA | CROSS CUTTING & TAPE TEST | SAMPLE | - | MANUFACTURER'S STD / APPROVED DATASHEET | MANUFACTURER'S STD / APPROVED DATASHEET | LOG BOOK | | P | - | - |

| BHEL | | | |
|---|----------------|---|--------------|
| ENGINEERING | | QUALITY | |
| Sign & Date | Name | Sign & Date | Name |
| HEMA KUSHWAHA <small>Asst. Engrg. (QA/QC) BHEL Ltd., Hyderabad</small> | HEMA KHUSHWAHA |  RITESH KUMAR <small>Asst. Engrg. (QA/QC) BHEL Ltd., Hyderabad</small> | KUNAL GANDHI |
| Prepared by: | | Checked by: | |
| Reviewed by: PRAVEEN DUTTA | PRAVEEN DUTTA | Reviewed by: | R K JAISWAL |


| BIDDER/ SUPPLIER | |
|------------------|--|
| Sign & Date | |
| Seal | |

| FOR CUSTOMER REVIEW & APPROVAL | | | |
|--------------------------------|--|-------------|------|
| Doc No: | | Sign & Date | Seal |
| Reviewed by: | | | |
| Approved by: | | | |


| BHEL | | | | |
|--------------|---------------|---------------|--|--------------|
| ENGINEERING | | | QUALITY | |
| | Sign & Date | Name | Sign & Date | Name |
| Prepared by: | HEMA KUSHWAHA | HEMA KUSHWAHA |  <small>For the use of the Engineer only</small> | KUNAL GANDHI |
| Reviewed by: | PRAVEEN | PRAVEEN DUTTA |  <small>For the use of the Engineer only</small> | R K JAISWAL |

| BIDDER/ SUPPLIER | | | | |
|------------------|-------------|--|--|--|
| | Sign & Date | | | |
| | Seal | | | |

| FOR CUSTOMER REVIEW & APPROVAL | | | | |
|--------------------------------|--------------|-------------|------|------|
| | Doc No: | Sign & Date | Name | Seal |
| | Reviewed by: | | | |
| | Approved by: | | | |

| | | | | | | | | |
|---|---|--|--|--|--|--|----------------------------------|--|
|  | MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS | | | STANDARD QUALITY PLAN | | | SPEC. NO. : | |
| | | | | CUSTOMER : | | | Qp NO. : PE-QP-999-Q-007, REV-04 | |
| | | | | PROJECT: | | | PO NO.: | |
| | | | | ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V)) | | | SYSTEM: II | |
| | | | | | | | DATE:17.04.2020 | |
| | | | | | | | SHEET 7 OF 9 | |

| SI No. | Component & Operations | Characteristics | Class | Type of Check | Quantum Of check | | Reference Document | Acceptance NORMS | FORMAT OF RECORD | AGENCY | | |
|--------|---------------------------|---|-------|-------------------------|------------------|-----|---|-------------------------|--------------------|--------|----|----|
| 1 | 2 | 3 | 4 | 5 | 6 | | 7 | 8 | 9 | 10 | 11 | 12 |
| | | | | | M | C/N | | | | | | |
| 2.7 | COMPLETE STATOR ASSEMBLY | 4.DURATION 1.COMPACTNESS & CLEANLINESS | MA | PROCESS CHECK VISUAL | CONTINUOUS | - | MANUFACTURER'S STANDARD | MANUFACTURER'S STANDARD | LOG BOOK | ✓ | P | V |
| 2.8 | BRAZING/COMPRESSION JOINT | 1.COMPLETENESS | CR | VISUAL | 100% | - | MANUFACTURER'S STANDARD | MANUFACTURER'S STANDARD | LOG BOOK | | P | - |
| | | 2.SOUNDNESS | CR | MALLET TEST & UT | 100% | - | MANUFACTURER'S STANDARD | MANUFACTURER'S STANDARD | LOG BOOK | | P | - |
| | | 3.HV | MA | ELECT. TEST | 100% | - | MANUFACTURER'S STANDARD | MANUFACTURER'S STANDARD | TEST/INSPC. REPORT | ✓ | P | V |
| 2.9 | COMPLETE ROTOR ASSEMBLY | 1.RESIDUAL UNBALANCE | CR | DYN. BALANCE | 100% | - | MANUFACTURER'S SPEC / ISO 1940 | MANUFACTURER'S DWG. | TEST/INSPC. REPORT | ✓ | P | - |
| | | 2.SOUNDNESS | CR | ELECT. OVERHEATER TEST | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | | P | - |
| 2.10 | ASSEMBLY | 1.ALIGNMENT | MA | MEAS. | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | TEST/INSPC. REPORT | ✓ | P | V |
| | | 2.WORKMANSHIP | MA | VISUAL | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | | P | - |
| | | 3.AXIAL PLAY | MA | MEAS. | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | | P | - |
| | | 4.DIMENSIONS | MA | MEAS. | 100% | - | MANUFACTURER'S DRG / MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | ✓ | P | V |
| | | 5.CORRECTNESS, COMPLETENESS TERMINATIONS/ COLOUR CODE | MA | VISUAL | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | | P | - |
| | | 6. RTD, BTD & SPACE HEATER MOUNTING. | MA | VISUAL | 100% | - | MANUFACTURER'S SPEC. | MANUFACTURER'S SPEC. | LOG BOOK | ✓ | P | V |

| ENGINEERING | | | QUALITY | | |
|---------------|---------------|-------------|---|--------------|--|
| Sign & Date | Name | | Sign & Date | Name | |
| HEMA KUSHWAHA | HEMA KUSHWAHA | Checked by: |  | KUNAL GANDHI | |
| Prepared by: | | | Reviewed by: | | |
| PRAVEEN | PRAVEEN DUTTA | | RITESH | R K JAISWAL | |

DUITA

| BIDDER/ SUPPLIER | |
|------------------|--|
| Sign & Date | |
| Seal | |

| FOR CUSTOMER REVIEW & APPROVAL | | | |
|--------------------------------|--|-------------|------|
| Doc No: | | Sign & Date | Seal |
| Reviewed by: | | | |
| Approved by: | | | |

SI No.

| | | |
|-------------|---|---|
| ENGINEERING | Sign & Date | <p>HEMA KUSHWAHA</p> <p>PRAVEEN DUTTA</p> |
| | <p>Signature of the student</p> <p>Signature of the teacher</p> | <p>Signature of the student</p> <p>Signature of the teacher</p> |

| | |
|-------------------------|--|
| BIDDER/ SUPPLIER | |
| Sign & Date | |
| Seal | |

| FOR CUSTOMER REVIEW & APPROVAL | | | |
|--------------------------------|--|-------------|-----------|
| Doc No: | | Sign & Date | Name Seal |
| Reviewed by: | | | |
| Approved by: | | | |

506723/2021/PS-PEM-MSE




TITLE:

**TECHNICAL SPECIFICATION
MISCELLANEOUS PUMPS**
**DOCUMENTS TO BE SUBMITTED BY
BIDDER**
SPEC. NO.: **PE-TS-440-100-N001**SECTION: **III**

SUB-SECTION:

REV. NO. **00** DATE 10.08.2021SHEET **1** OF **1**
SECTION III
DOCUMENTS TO BE SUBMITTED BY BIDDER

506723/2021/PS-PEM-MSE

| | | |
|--|--|--------------------------------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS DOCUMENTS TO BE SUBMITTED BY BIDDER | SPEC. NO.: PE-TS-440-100-N001 |
| | | SECTION: IIIA |
| | | SUB-SECTION: |
| | | REV. NO. 00 DATE 10.08.2021 |
| | | SHEET 1 OF 1 |

SECTION IIIA

**GUARANTEE SCHEDULE
(TO BE SUBMITTED ALONG WITH THE BID BY ALL BIDDERS)**

| | | | | |
|---|--|-------------|----------------------------|----------------------------|
|  | | SPECN. NO.: | PE-TS-440-100-N001, Rev-00 | |
| | SCHEDULE OF PERFORMANCE GUARANTEES 4X270 MW BHADRADRI - FGD PACKAGE (TSGENCO) | VOLUME: | -- | SECTION: IIIA Sheet 1 of 2 |
| | | REV. NO. | 00 | DATE: |

Following parameters are guaranteed for following pumps

| Sl. No. | Pump Description | Guaranteed Capacity | Guaranteed TDH | Guaranteed Pump Eff. | Guaranteed Motor Eff. | Guaranteed Power consumption at inlet to motor terminals | Motor Rating | Pump GD ² Value for HT motor only | Pump RPM | T/S Curve attached for HT motor |
|---------|-------------------------|---------------------|----------------|----------------------|-----------------------|--|--------------|--|----------|---------------------------------|
| | | (M3/Hr) | (MWC) | % | % | (KW) | (KW) | | | |
| | Horizontal pumps | | | | | | | | | |
| 1 | # ECW PUMPS | 540 | 60 | | | | | | | |
| 2 | # ACW PUMPS | 540 | 30 | | | | | | | |

Note: 1 # Bid evaluation and LD is applicable for these pumps only as per clause 4.00.00 of Section-IIA & Data Sheet-A of Section-ID of Technical Specification for pumps.

We the undersigned hereby undertake to meet the performance guarantees as listed in the table above on the conditions as elsewhere specified. Any variation of the specified conditions during official tests will be taken in account by the customer

PARTICULARS OF BIDDER/ AUTHORISED REPRESENTATIVE

| NAME | DESIGNATION | SIGNATURE | DATE | COMPANY SEAL |
|------|-------------|-----------|------|--------------|
|------|-------------|-----------|------|--------------|



SPECN. NO.:

PE-TS-440-100-N001, Rev-00

SCHEDULE OF PERFORMANCE GUARANTEES

4X270 MW BHADRADRI - FGD PACKAGE (TSGENCO)

VOLUME:

--

SECTION:

IIIA

Sheet 2 of 2

REV. NO.

00

DATE:

10.08.2021

Following parameters are guaranteed for following pumps

| Sl. No. | Pump Description | Guaranteed Capacity | Guaranteed TDH | Guaranteed Pump Eff. | Guaranteed Motor Eff. | Guaranteed Power consumption at inlet to motor terminals | Motor Rating | Pump GD ² Value for HT motor only | Pump RPM | T/S Curve attached for HT motor |
|---------|------------------|---------------------|----------------|----------------------|-----------------------|--|--------------|--|----------|---------------------------------|
| | | (M3/Hr) | (MWC) | % | % | (KW) | (KW) | | | |
| 1 | Vertical pumps | | | | | | | | | |
| | # FGD PUMPS | 230 | 55 | | | | | | | |


Note: 1 # Bid evaluation and LD is applicable for these pumps only as per clause 4.00.00 of Section-IIA & Data Sheet-A of Section-ID of Technical Specification for pumps.

We the undersigned hereby undertake to meet the performance guarantees as listed in the table above on the conditions as elsewhere specified. Any variation of the specified conditions during official tests will be taken in account by the customer

PARTICULARS OF BIDDER/ AUTHORISED REPRESENTATIVE

| | | | | |
|------|-------------|-----------|------|--------------|
| NAME | DESIGNATION | SIGNATURE | DATE | COMPANY SEAL |
|------|-------------|-----------|------|--------------|


506723/2021/PS-PEM-MSE

| | | |
|--|--|--------------------------------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS DOCUMENTS TO BE SUBMITTED BY BIDDER | SPEC. NO.: PE-TS-440-100-N001 |
| | | SECTION: IIID |
| | | SUB-SECTION: |
| | | REV. NO. 00 DATE 10.08.2021 |
| | | SHEET 1 OF 1 |

SECTION IIIB

COMPLIANCE CERTIFICATE
(TO BE SUBMITTED ALONG WITH THE BID BY ALL BIDDERS)

506723/2021

| | | | | | |
|--|--------------------------|-------------|---------------------------|----------|------------|
|  | TECHNICAL SPECIFICATIONS | SPECN. NO.: | PE-TS-440-100-N001, Rev.0 | | |
| | MISCELLANEOUS PUMPS | VOLUME: | -- | SECTION: | IIIB |
| | COMPLIANCE CERTIFICATE | REV. NO. | 0 | DATE: | 10.08.2021 |

The bidder shall confirm compliance with following by signing/ stamping this compliance certificate and furnish same with the offer.

- The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions/ deviations with regard to same.
- QP/ test procedures shall be submitted in the event of order based on the guidelines given in the specification & QP enclosed therein.

QP will be subject to BHEL/ CONSULTANT/ CUSTOMER approval in the event of order & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc.
- All drawings/data – sheets etc. to be submitted during contract shall be subject to BHEL/ CONSULTANT/ CUSTOMER approval.
- There are no other deviation with respect to specification other than those furnished in the 'Schedule of Deviations'.
- Bidder shall include the cost of Mandatory Spares, unless specified otherwise in Sec-IA of the specification or NIT.


Any mandatory spares stated as not applicable, shall have to be supplied without any cost implication to BHEL in the event they are found to be applicable during detail engineering stage.
- The offered materials should be either equivalent or superior to those specified. Also for components where material is not specified it shall be suitable for intended duty. All materials shall be subject to approval in the event of order.
- Prices for recommended spares (if any) for 3 years operation shall be furnished separately & not included in the base price.
- The commissioning spares (if any) are supplied on 'As Required Basis' & prices for same included in the base price (If bidders reply to this is "No commissioning spares are required" and if some spares are actually required during commissioning same shall be supplied by bidder without any cost to BHEL).
- All sub vendors shall be as per BHEL/CONSULTANT/CUSTOMER approved list.
- Tests for noise, vibration, parallel running etc. for pumps shall be conducted at site by Pump Vendor/BHEL as per cl. no. 3.04.00 of Section-IIA and if the site performance is found not meeting the requirements in any respect as specified, than the equipment shall be rectified or replaced by the vendor, at his own cost.
- Any special tools & tackles, if required, shall be in bidder's scope.
- All models offered have been supplied by bidder in the past and are meeting the experience qualifying criteria of BHEL/CONSULTANT/CUSTOMER (viz. offered model is successfully operating in two separate stations for at least one year or as specified in technical PQR). Any deviation to this criteria shall be suitably highlighted in deviation schedule.
- All selected motor ratings have minimum margins as per Datasheet A, Section ID.

We the undersigned hereby undertake to meet the compliance requirements as listed above on the conditions as elsewhere specified.

PARTICULARS OF BIDDER/ AUTHORISED REPRESENTATIVE

| | | | | |
|------|-------------|-----------|------|--------------|
| | | | | |
| NAME | DESIGNATION | SIGNATURE | DATE | COMPANY SEAL |


506723/2021/PS-PEM-MSE

| | | |
|--|--|--------------------------------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS DOCUMENTS TO BE SUBMITTED BY BIDDER | SPEC. NO.: PE-TS-440-100-N001 |
| | | SECTION: IIIC |
| | | SUB-SECTION: |
| | | REV. NO. 00 DATE 10.08.2021 |
| | | SHEET 1 OF 2 |

SECTION IIIC


DEVIATION SCHEDULE
(TO BE SUBMITTED ALONG WITH THE BID BY ALL BIDDERS)

506723/2021/PS-PEM-MSE

| | | |
|--|--|--------------------------------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS DOCUMENTS TO BE SUBMITTED BY BIDDER | SPEC. NO.: PE-TS-440-100-N001 |
| | | SECTION: IIIC |
| | | SUB-SECTION: |
| | | REV. NO. 00 DATE 10.08.2021 |
| | | SHEET 2 OF 2 |

REFER NIT

506723/2021/PS-PEM-MSE

| | | |
|--|--|--------------------------------------|
|  | TECHNICAL SPECIFICATION MISCELLANEOUS PUMPS DOCUMENTS TO BE SUBMITTED BY BIDDER | SPEC. NO.: PE-TS-440-100-N001 |
| | | SECTION: IIID |
| | | SUB-SECTION: |
| | | REV. NO. 00 DATE 10.08.2021 |
| | | SHEET 1 OF 1 |

SECTION IIID

DATA SHEET – B FOR PUMPS

ELECTRICAL LOAD DATA FORMAT

CABLE SCHEDULE

MOTOR DATASHEET-C

**(TO BE SUBMITTED BY SUCCESSFUL BIDDER AFTER AWARD OF
CONTRACT)**

| PROJECT: MISCELLANEOUS PUMPS DATASHEET - B | | | |
|--|--|--------------------|--------------|
| SL. | DESCRIPTION | UOM | PUMP DATA |
| 1.0 | GENERAL | | |
| 1.1 | Designation of the Pump | | |
| 1.2 | Manufacturer | | |
| 1.3 | Model No. | | |
| 1.4 | No. of pumps | Nos. | |
| 1.5 | System Design Pressure | Kg/cm ² | |
| 1.6 | Specific Gravity of fluid to be handled | - | |
| 2.0 | PERFORMANCE PARAMETERS | | |
| 2.1 | Performance standard | | |
| 2.2 | Rated capacity. (No negative tolerance) | M ³ /hr | |
| 2.3 | Total Dynamic Head (TDH) at rated capacity (No negative tolerance) | MWC | |
| 2.4 | Shut off head | MWC | |
| 2.5 | Range of Operation of the Pump | | |
| | a) Min.Flow | M ³ /hr | |
| | b) Max.Flow | M ³ /hr | |
| 2.6 | The pumps offered have continuously rising head capacity curves from the duty point towards shut off point. | | |
| 2.7 | The pumps offered have stable rising H-Q curves within the "Range of Operation" | | |
| 2.8 | Pump rated speed | RPM | |
| 2.9 | Vibration measurements (2.9.2 is applicable in addition to 2.9.1 for Pumps with speed less than 600 RPM) | | |
| 2.9.1 | Max.value of vibration on any pump /motor bearing w.r.t. velocity (Vrms) as per ANSI/ HIS 9.6.4 for speed > 600 RPM | | |
| | a) Guaranteed at manufacturer's works | mm/s | |
| | b) Guaranteed at site | mm/s | |
| 2.9.2 | Max.value of vibration on any pump /motor bearing w.r.t. peak to peak amplitude as per ANSI/ HIS 9.6.4 for speed <= 600 RPM | | |
| | a) Guaranteed at manufacturer's works | microns | |
| | b) Guaranteed at site | microns | |
| 2.10 | Max. noise Level (Guaranteed at site) | dB | |
| 2.11 | Guaranteed Pump efficiency at rated head & rated capacity without -ve tolerance | % | |
| 2.12 | Power consumption | | |
| | a) Guaranteed pump input power at duty point | KW | |
| | b) Guaranteed max. Pump input power within range of operation. | KW | |
| | c) Max. pump input power at shut off | KW | |
| | d) Guranteed power at motor input | KW | |
| 2.13 | NPSH required at rated capacity | MWC | |
| 3.0 | DESIGN & CONSTRUCTION FEATURES | | |
| 3.1 | Type of pump casing | | |
| 3.2 | Pump duty | | |
| 3.3 | Type of Impeller | | |
| 3.4 | Location | | |
| 3.5 | Pump suitable for parallel operation | | |
| 3.6 | Torque speed curve of the pump & drive motor furnished for pumps with drive motor rating of 100 KW and above. | | |
| 3.7 | Pump number of stages | | |
| 3.8 | Specific speed N = RPM x (Flow in USGPM) ^{1/2} (Head in Ft.) ^{3/4} | | |
| 3.9 | Minimum suction head required in MLC for pump operation at maximum discharge point within the 'Range of Operation' specified (NPSHR at max. flow). | | |

| PROJECT: | | | |
|---------------------|--|--------------------|-----------|
| MISCELLANEOUS PUMPS | | | |
| DATASHEET - B | | | |
| SL. | DESCRIPTION | UOM | PUMP DATA |
| 3.10 | Whether pump is suitable/designed so that pump internals can be attended without disturbing suction and discharge piping. | | |
| 3.11 | Type of coupling between pump & motor | | |
| 3.12 | Bearing (DE & NDE) | | |
| | a) Type and manufacturer | | |
| | b) Bearing no. | | |
| | c) Type of lubrication | | |
| | d) Design life (Hrs.) | | |
| 3.13 | Shaft Sealing arrangement | | |
| | a) Type and manufacturer | | |
| | b) Sealing liquid | | |
| | c) Requirement of external water if any | | |
| | i) Quality | | |
| | ii) Quantity/ Pump | M ³ /hr | |
| 3.14 | In case separate oil/grease/water pump or any such equipment required for bearing lubrication/stuffing box gland sealing, furnish full technical details of these equipment and their drive. | | |
| 4.0 | MATERIAL OF CONSTRUCTION (Indicate applicable code/ standard) | | |
| 4.1 | Casing | | |
| 4.2 | Impeller | | |
| 4.3 | Shaft | | |
| 4.4 | Shaft sleeves | | |
| 4.5 | Wear ring | | |
| 4.6 | fasteners | | |
| 4.7 | Gland | | |
| 4.8 | Lantern ring | | |
| 4.9 | Mechanical seals (faces)/ | | |
| | Gland packing | | |
| 4.10 | Base plate | | |
| 5.0 | CONNECTIONS AND OTHER DIMENSIONAL DETAILS | | |
| 5.1 | Impeller diameter | mm | |
| 6.0 | DRIVE DATA | | |
| 6.1 | Drive unit output at 50°C ambient condition | KW/ P | |
| 7.0 | INSPECTION & TESTING | | |
| 7.1 | Material test | | |
| 7.2 | Hydrostatic test pressure | Kg/cm ² | |
| 7.3 | Hydrostatic test duration | Min. | |
| 7.4 | Performance test on pump at shop | | |
| 7.5 | Dyanamic balance test | | |
| 8.0 | WEIGHT AND LOADING DATA | | |
| 8.1 | Weight of the pump & drive assembly | Kg | |
| 8.2 | Weight of the heaviest piece to be handled | Kg | |
| 8.3 | Size of base plate (length x width) | mm | |
| 9.0 | ADDITIONAL INFORMATION FOR VERTICAL PUMPS | | |
| 9.1 | Type of pump | | |
| 9.2 | No. of stages for Vertical Turbine Pump | Nos. | |
| 9.3 | Bowl Head | MLC | |
| 9.4 | Bowl Efficiency | % | |
| 9.5 | Setting Length | m | |
| 9.6 | Column pipe OD X Thickness | mm X mm | |
| 9.7 | No of column pieces | Nos. | |
| 9.8 | No of intermediate shafts | Nos. | |
| 9.9 | No of bearings | Nos. | |
| 9.10 | Type & make of Bearing | | |
| 9.11 | Sealing/lubrication arrangement of bearings | | |
| 9.12 | Capacity of overhead forced lubrication tank | m ³ | |
| 9.13 | Nos of forced lubrication pumps | Nos. | |
| 9.14 | Capacity of forced lubrication pumps | m ³ /Hr | |
| 9.15 | TDH of forced lubrication pumps | MLC | |

[illegible]

[illegible]

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

1. For the purpose of clarity, it may please be noted that the information given in regard to the cables to be routed through WinPath as per the system elaborated below is called "Cable List", while the term "Cable Schedule" applies to the cable list with routing information added after routing has been carried out.
2. The cable list shall be entered as an MS Excel file in the format as per enclosed template EXT_CAB_SCH_FORMAT.XLS. No blank lines, special characters, header, footer, lines, etc. shall be introduced in the file. No changes shall be made in the title line (first line) of the template.
3. The field properties shall be as under:
 - a. UNITCABLENO: A/N, up to sixteen (16) characters; each cable shall have its own unique, unduplicated cable number. In case this rule is violated, the cable cannot be taken up for routing.
 - b. FROM: A/N, up to sixty (60) characters; the "From" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - c. TO: A/N, up to sixty (60) characters; the "To" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - d. PURPOSE: A/N, up to sixty (60) characters; the purpose (i.e. power cable/ indication/ measurement, etc.) to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - e. REMARKS: A/N, up to forty (40) characters; Any information pertinent to routing to be specified here (e.g., cable number of the cable redundant to the cable number being entered). Information in excess of 40 characters will be truncated after 40 characters.
 - f. CABLESIZE: A/N, 7 characters exactly as per the codes indicated below shall be specified here. The program cannot route cables described in any other way/ format.
 - g. PATHCABLENO: Field reserved for utilization by the program. User shall not enter any information here.
4. One list shall be prepared for each system/ equipment (i.e., separate and unique cable lists shall be prepared for each system).
5. The cables shall be described as per the scheme listed below:

| | | | |
|--------------------|---------------------|---------------|-------------------------|
| A | NN | A | NNN |
| | | | |
| Cable | No. of cores | Cable code | Cable size |
| Voltage | (e.g. 01,03,3H, 07) | (See C below) | (e.g. 035,185,2.5, 0.5) |
| Code (see B below) | | | |

(A) SYSTEM VOLTAGE CODES:

(ac) A = 11KV, B = 6.6KV, C = 3.3KV, D = 415V, E = 240V, F = 110V

(dc) G = 220V, H = 110V, J = 48V, K = +24V, L = -24V

(B) CABLE VOLTAGE CODES:

A = 11KV (Power cables)

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

B = 6.6KV (Power cables)
 C = 3.3KV (Power cables)
 D = 1.1KV (LV & DC system power & control cables)
 E = 0.6KV (0.5 sq. mm. Control cables)

(C) CABLE CODES

PVC Copper

| | |
|---------------------|-------------------------|
| A = Armoured FRLS | B = Armoured Non-FRLS |
| C = unarmoured FRLS | D = Unarmoured Non-FRLS |

PVC Aluminium

| | |
|---------------------|-------------------------|
| E = Armoured FRLS | F = Armoured Non-FRLS |
| G = unarmoured FRLS | H = Unarmoured Non-FRLS |

XLPE Copper

| | |
|---------------------|-------------------------|
| J = Armoured FRLS | K = Armoured Non-FRLS |
| L = unarmoured FRLS | M = Unarmoured Non-FRLS |

XLPE Aluminium

| | |
|---------------------|-------------------------|
| N = Armoured FRLS | P = Armoured Non-FRLS |
| Q = unarmoured FRLS | R = Unarmoured Non-FRLS |

S = FIRE SURVIVAL CABLES
 T = TOUGH RUBBER SHEATH
 U = OVERALL SCREENED
 V = PAIRED OVERALL SCREENED
 W = PAIRED INDIVIDUAL SCREENED
 Y = COMPENSATING CABLES
 I = PRE-FABRICATED CABLES
 Z = JELLY FILLED CABLES

| | | |
|--|-----------------------------|-------------------|
| | TITLE | SPECIFICATION NO. |
| | MOTOR DATA SHEET - C | VOLUME II B |
| | | SECTION D |
| | | REV NO. 00 DATE |
| | | SHEET 1 OF 2 |

| S. No. | Description | Data to be filled by successful bidder |
|-----------|--|--|
| A. | General | |
| 1 | Manufacturer & country of origin | |
| 2 | Motor type | |
| 3 | Type of starting | |
| 4 | Name of the equipment driven by motor & Quantity | |
| 5 | Maximum Power requirement of driven equipment | |
| 6 | Rated speed of Driven Equipment | |
| 7 | Design ambient temperature | |
| B. | Design and Performance Data | |
| 1 | Frame size & type designation | |
| 2 | Type of duty | |
| 3 | Rated Voltage | |
| 4 | Permissible variation for | |
| 5 | a Voltage | |
| 6 | b Frequency | |
| 7 | c) Combined voltage & frequency | |
| 8 | Rated output at design ambient temp (by resistance method) | |
| 9 | Synchronous speed & Rated slip | |
| 10 | Minimum permissible starting voltage | |
| 11 | Starting time in sec with mechanism coupled | |
| 12 | a) At rated voltage | |
| 13 | b) At min starting voltage | |
| 14 | Locked rotor current as percentage of FLC (including IS tolerance) | |
| 15 | Torque | |
| | a) Starting | |
| | b) Maximum | |
| 16 | Permissible temp rise at rated output over ambient temp & method | |
| 17 | Noise level at 1.0 m (dB) | |
| 18 | Amplitude of vibration | |
| 19 | Efficiency & P.F. at rated voltage & frequency | |
| | a) At 100% load | |
| | c) At 75% load | |

| | | | | | |
|----------------|-----------|------|------|------|--|
| NAME OF VENDOR | | | SEAL | REV. | |
| | | | | | |
| NAME | SIGNATURE | DATE | | | |

| | | |
|--|-------|-------------------|
| | TITLE | SPECIFICATION NO. |
| | | VOLUME II B |
| | | SECTION D |
| | | REV NO. 00 DATE |
| | | SHEET 2 OF 2 |

| S. No. | Description | Data to be filled by successful bidder |
|--------|---|--|
| | c) At starting | |
| C. | Constructional Features | |
| 1 | Method of connection of motor driven equipment | |
| 2 | Applicable Standard | |
| 3 | DOP of Enclosure | |
| 4 | Method of cooling | |
| 5 | Class of insulation | |
| 6 | Main terminal box | |
| | a) Type | |
| | b) Power Cable details (Conductor, size, armour/unarmour) | |
| | c) Cable Gland & lugs details (Size, type & material) | |
| | d) Permissible Fault level (kArms & duration in sec) | |
| 7 | Space heater details (Voltage & watts) | |
| 8 | Flame proof motor details (if applicable) | |
| | a) Enclosure | |
| | b) suitability for hazardous area | |
| | i Zone | O / I / II |
| | ii Group | IIA / IIB / IIC |
| 9 | No. of Stator winding | |
| 10 | Winding connection | |
| 11 | Kind of rotor winding | |
| 12 | Kind of bearings | |
| 13 | Direction of rotation when viewed from NDE | |
| 14 | Paint Shade & type | |
| 15 | Net weight of motor | |
| 16 | Outline mounting drawing No (To be enclosed as annexure) | |
| D. | Characteristic curves/ drawings (To be enclosed for motors of rating $\geq 55\text{KW}$) | |
| | a) Torque speed characteristic | |
| | b) Thermal withstand characteristic | |
| | c) Current vs time | |
| | d) Speed vs time | |

| | | | | | |
|----------------|-----------|------|------|------|--|
| NAME OF VENDOR | | | SEAL | REV. | |
| | | | | | |
| NAME | SIGNATURE | DATE | | | |