

	STANDARD QUALITY PLAN	SPEC. NO.:	DATE: 27.02.2020
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		GP NO.: PED-506-00-0-007, REV.04	
PROJECT:		PO NO.:	
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SECTION: II	SHEET 3 OF 9


Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY					
					M	C/N				D	M	C	N		
1			4	5	100%		7	8	9						
1.7	OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC.	1. SURFACE COND. ETC. 2. OTHER CHARACTERISTICS	MA	VISUAL	SAMPLE		MANUFACTURERS STD	NO VISUAL DEFECTS	TEST REPORT	P/W					
1.8	SHEET STAMPING (PUNCHED)	1. SURFACE COND 2. DIMENSIONS INCLUDING BURS HEIGHT 3. ACCEPTANCE TESTS	MA	VISUAL	100%		MANUFACTURERS DRG	NO VISUAL DEFECTS (FREE FROM BURS)	LOG BOOK AND OR SUPPLIERS TC	P/W					
1.9	CONDUCTORS	1. SURFACE FINISH 2. ELECT. PROF. & MECH PROP	MA	MEASUREMENT ELECT & MECH TESTS VISUAL	100%		MANUFACTURERS DRG / STD	MANUFACTURERS DRG / STD FREE FROM DEFECTS	LOG BOOK SUPPLIERS TC	P/W					
			MA	ELECT & MECH TEST	SAMPLES		MANUFACTURERS DRG / SPEC	MANUFACTURERS / SPEC	SUPPLIERS TC & VENDORS TEST REPORTS	P/W					

* MOTOR MANUFACTURERS TO CHECK THE MOTOR FOR SURFACE FINISH ON RANDOM BASIS (10% SAMPLE) AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY BHEL/CUSTOMER.

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

BHEL			
ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
Prepared by: <i>Hitesh</i>	<i>Hitesh</i>	Checked by: <i>Hitesh</i>	<i>Hitesh</i>
Reviewed by: <i>P. Datta</i>	<i>P. Datta</i>	Reviewed by:	


		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS STANDARD QUALITY PLAN		SPEC. NO.	
				QP NO.: PED-506-00-Q-007, REV.04 DATE: 27.02.2020	
PROJECT:		SYSTEM:		SECTION: II	
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))				SHEET 4 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY					
					M	CN			D	M	C	N				
1			4	5			7	8								
1.10	BEARINGS	3.DIMENSIONS	MA	MEASUREMENT	-DO-		-DO-	-DO-	Log Book		PV					
		1.MAKE & TYPE	MA	VISUAL	100%		MANUFACTURER'S DRG / APPROVED DATASHEET	MANUFACTURER'S DRG / APPROVED DATASHEET			PV					
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE		APPROVED DATASHEET	APPROVED DATASHEET / BEARING MANUF'S CATALOGUES			PV					
1.11	SLIP RING (WHEREVER APPLICABLE)	3 SURFACE FINISH	MA	VISUAL	100%			FREE FROM VISUAL DEFECTS			PV					
		1.SURFACE COND.	MA	VISUAL	100%			-DO-			P					
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG	MANUFACTURER'S DRG			P					
1.12	OIL SEALS & GASKETS	3 TEMP WITH STAND CAPACITY	MA	ELECT TEST	-DO-		MANUFACTURER'S STD / APPROVED DATASHEET	MANUFACTURER'S STD / APPROVED DATASHEET			PV					
		4.H/IR	MA	-DO-	100%		-DO-	-DO-			PV					
		1.MATERIAL OF GASKET	MA	VISUAL	100%		MANUFACTURER'S DRG/SPECS	MANUFACTURER'S DRG / SPECS			P					
		2 SURFACE COND.	MA	VISUAL	100%		FREE FROM VISUAL DEFECTS			P						
		3.DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG	MANUFACTURER'S DRG			P					

Doc No:		FOR CUSTOMER REVIEW & APPROVAL	
Sign & Date	Name	Sign & Date	Seal
Reviewed by:		Reviewed by:	
Approved by:		Approved by:	


Sign & Date		BIDDER/SUPPLIER	
Sign & Date		Sign & Date	
Seal		Seal	

ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
Prepared by: <i>[Signature]</i>	H.P. 1712 A. K.	Checked by: <i>[Signature]</i>	<i>[Signature]</i>
Reviewed by: <i>[Signature]</i>	P. Dutta	Reviewed by: <i>[Signature]</i>	<i>[Signature]</i>

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN
CUSTOMER :		SPEC. NO
PROJECT :		OP NO.: PED-506-00-0-007, REV.04
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		DATE: 27.02.2020
SYSTEM:		PO NO.:
SECTION: II		SHEET 5 OF 9


SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N				M	C	N		
1	IN PROCESS		4	5	100%	6	7	8	9					
2.0	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNESS 2.DIMENSIONS	MA	VISUAL	100%		-DO-	GOOD FINISH	LOG BOOK		PW			
2.1			MA	MEASUREMENT	-DO-		MANUFACTURERS DRG	MANUFACTURERS DRG	-DO-		P			
2.2	MACHINING	1.FINISH 2.DIMENSIONS	MA	VISUAL	100%		-DO-	GOOD FINISH	LOG BOOK		P			
			MA	MEASUREMENT	-DO-		MANUFACTURERS DRG	MANUFACTURERS DRG	-DO-		P			
2.3	PANTING	3.SHAFT SURFACE FLOWS 1.SURFACE PREPARATION 2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT) 3.SHADE 4.ADHESION	MA	PT	100%		MANUFACTURERS STD./ASTM-E165	MANUFACTURERS STD./APPROVED DATASHEET	-DO-		P	V		
			MA	VISUAL	100%		MANUFACTURERS STD./APPROVED DATASHEET	SAME AS CCL7	LOG BOOK		P			
			MA	MEASUREMENT BY ELCOMETER	SAMPLE		-DO-	-DO-	-DO-		P			
			MA	VISUAL	-DO-		-DO-	-DO-	LOG BOOK		P			
			MA	CROSS CUTTING & TAPE TEST	-DO-		-DO-	-DO-	LOG BOOK		P			

BHEL		QUALITY	
ENGINEERING	BIDDER/ SUPPLIER	FOR CUSTOMER REVIEW & APPROVAL	
Sign & Date	Name	Sign & Date	Name
Prepared by: <i>[Signature]</i>	Name: <i>Hemant K.</i>	Reviewed by:	Seal
Reviewed by: <i>[Signature]</i>	Checked by: <i>[Signature]</i>	Approved by:	Seal
	Reviewed by: <i>[Signature]</i>		

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS PROJECT:		STANDARD QUALITY PLAN		SPEL. NO.:	
				CUSTOMER:		DATE: 27.02.2020	
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		SECTION: II		SHEET 6 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY					
					M	C/N				D	M	C	N		
1			4	5			7	8							
2.4	SHEET STACKING	1. COMPLETENESS 2. COMPRESSION & TIGHTENING	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S STD	MANUFACTURERS STD	LOG BOOK		P				
2.5	WINDING	1. COMPLETENESS 2. CLEANLINESS 3. IR-HV-IR 4. RESISTANCE 5. INTERTURN INSULATION	MA MA CR CR CR CR	MEASUREMENT VISUAL -DO- ELECT. TEST -DO- -DO-	100% 100% -DO- 100% 100% -DO-		MANUFACTURERS STD/APPROVED DATASHEET	MANUFACTURERS STD/APPROVED DATASHEET	LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK		P P P P P P				
2.6	IMPREGNATION	1. VISCOSITY 2. TEMP. PRESSURE 'VACUUM' 3. NO. OF DIPS	MA MA MA	PHY. TEST PROCESS CHECK -DO-	AT STARTING CONTINUOUS CONTINUOUS		MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD	MANIFUR'S STANDARD MANUFACTURER'S STANDARD MANUFACTURERS STANDARD	LOG BOOK LOG BOOK LOG BOOK		P P P				THREE DIPS TO BE GIVEN

ENGINEERING Sign & Date: <i>[Signature]</i> / <i>[Date]</i> Prepared by: <i>[Signature]</i> Reviewed by: <i>[Signature]</i>		BHEL Name: <i>[Name]</i> Checked by: <i>[Signature]</i> Reviewed by: <i>[Signature]</i>		BIDDER/ SUPPLIER Sign & Date: _____ Seal: _____	
FOR CUSTOMER REVIEW & APPROVAL Doc No: _____ Sign & Date: _____ Reviewed by: _____ Approved by: _____		Name: _____ Seal: _____		Name: _____ Seal: _____	

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN
CUSTOMER: PED-506-00-Q-007, REV-04		SPEC. NO.:
PROJECT: AC ELECT. MOTORS 55 KW & ABOVE (LV 415V)		DATE: 27.02.2020
SYSTEM: II		PO NO.:
SECTION: II		SHEET 7 OF 9


Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check			Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N					D	M	C	N	
1			4	5	100%	CONTINUOUS		8							
2.7	COMPLETE STATOR ASSEMBLY	4 DURATION 1 COMPACTNESS & CLEANLINESS	MA	DO- VISUAL	100%	CONTINUOUS	-DO- -DO-	-DO- -DO-	LOG BOOK LOG BOOK	✓	P	V	-		
2.8	BRAZING/COMPRESSION JOINT	1 COMPLETENESS 2 SOUNDNESS	CR	-DO- MALLETT TEST & UT	100%	100%	-DO- -DO-	-DO- -DO-	LOG BOOK LOG BOOK	✓	P	V	-		
2.9	COMPLETE ROTOR ASSEMBLY	3 HV 1 RESIDUAL UNBALANCE	MA	ELECT. TEST DYN. BALANCE	100%	100%	-DO- -DO-	-DO- MANUFACTURER'S DWG ISO 1940	LOG BOOK LOG BOOK	✓	P	V	-		
2.10	ASSEMBLY	2 SOUNDNESS OF DIE CASTING 1 ALIGNMENT 2 WORKMANSHIP 3 AXIAL PLAY 4 DIMENSIONS 5 CORRECTNESS, COMPLETENESS, TERMINATIONS/ MARKING/ COLOUR CODE	CR	ELECT (GROWLER TEST) MEAS VISUAL MEAS -DO- VISUAL	100%	100%	MANUFACTURER'S SPEC -DO- -DO- -DO- MANUFACTURER'S SPEC	MANUFACTURER'S SPEC -DO- -DO- -DO- MANUFACTURER'S DRG/ RELEVANT IS MANUFACTURER'S SPEC	LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK	✓	P	V	-		

FOR CUSTOMER REVIEW & APPROVAL		
Doc No:	Sign & Date	Seal
Reviewed by:	Name	
Approved by:		

BIDDER/ SUPPLIER	
Sign & Date	Seal

BHEL			
ENGINEERING		QUALITY	
Prepared by:	Sign & Date	Checked by:	Sign & Date
Reviewed by:	Name	Reviewed by:	Name

Prepared by: *[Signature]* Name: **Hema K. P. Dutta**
 Checked by: *[Signature]* Name: **KUNAL GANDHI**
 Reviewed by: *[Signature]* Name: **[Signature]**

	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
	CUSTOMER:		QP NO.: PED-506-00-Q-007, REV-04		
	PROJECT:		PO NO.:		
	ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		SECTION: II

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check	Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY
1	2	3	4	5	6	7	8	9	
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	M 100% C/N 100%	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING	INSPEC REPORT	M P W N

NOTES:

- 1 DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
- 2 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
- 6 IN CASE, ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER.


LEGENDS:

- *RECORDS, IDENTIFIED WITH 'TICK'(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
- ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRDO PARTY INSPECTION AGENCY, C: CUSTOMER, P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
- MA: MAJOR, MI: MINOR, CR: CRITICAL
- D: DOCUMENT

ENGINEERING		BHEL		QUALITY	
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
<i>[Signature]</i>	Heena K.	<i>[Signature]</i>		<i>[Signature]</i>	Kumar
<i>[Signature]</i>	P. Dutta				Gautam
Prepared by:		Checked by:		Reviewed by:	
Reviewed by:		Reviewed by:		Reviewed by:	

BIDDER/SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
	Reviewed by:		
	Approved by:		


	STANDARD QUALITY PLAN		SPEC. NO. :	
	CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02	
	PROJECT:		DATE: 27.02.2020	
	ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		SECTION: II	
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		SYSTEM:		SHEET 1 OF 2

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check	Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY
1		3	4	5	6	7	8	9	**
1.0	ASSEMBLY	1.WORKMANSHIP 2.DIMENSIONS 3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOUR CODE	MA	VISUAL	100%	MFG. SPEC.	MFG. SPEC.	-DO-	P
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	MFG. SPEC/ APPROVED DATASHEET	SAME AS COL 7	LOG BOOK	P
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST 2.OVERALL DIMENSIONS & ORIENTATION	MA	-DO- MEASUREMENT & VISUAL	100% 100%	IS-325 / IS-12615/ APPROVED DATA SHEET APPROVED DRG/DATA SHEET	SAME AS COL 7 APPROVED DRG/DATA SHEET	TEST/ INSPN REPORT TEST/ INSPN REPORT	P P

BHEL	
ENGINEERING	
Prepared by: <i>[Signature]</i>	Checked by: <i>[Signature]</i>
Reviewed by: <i>[Signature]</i>	Reviewed by: <i>[Signature]</i>

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL	
Doc No:	Seal
Reviewed by: <i>[Signature]</i>	Reviewed by: <i>[Signature]</i>
Approved by: <i>[Signature]</i>	Approved by: <i>[Signature]</i>

	STANDARD QUALITY PLAN		SPEC. NO.:	
	CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02	
	PROJECT:		DATE: 27.02.2020	
	ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		SECTION: II	
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		SYSTEM:		SHEET 2 OF 2

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD			AGENCY
					M	C/N						
1	2	3	4	5	100%	6	7	8	9			
		3.NAMEPLATE DETAILS	MA	VISUAL	100%		IS-325 / IS-12815 / APPROVED DATA SHEET	SAME AS COL.7	TEST/INSPN. REPORT	D	M	C N
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%		AS PER MFG STANDARD / APPROVED PACKING DRAWING (#)	AS PER MFG. STANDARD / APPROVED PACKING DRAWING (#)	INSPC. REPORT	P	P	W

- NOTES:**
- 1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON
 - 2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW, ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.
 - 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
 - 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
 - 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL FOR REVIEW.
 - 6 IN CASE, ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER.

LEGENDS:
 *RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

FOR CUSTOMER REVIEW & APPROVAL		
Doc No:	Sign & Date	Name
	Reviewed by:	
	Approved by:	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

BHEL			
ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
<i>[Signature]</i>	Hema K.	<i>[Signature]</i>	Kunal
	P. Dulha		GRANDE
Prepared by:		Checked by:	
Reviewed by:		Reviewed by:	

MOTOR

TESTS/CHECKS TEMS/COMPONENTS	Visual	Dimensional	Make/Type/Rating /General Physical Inspection	Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment
Plates for stator frame, end shield, spider etc.	Y	Y	Y	Y	Y				Y
Shaft	Y	Y	Y	Y	Y	Y			Y
Magnetic Material	Y	Y	Y	Y			Y		
Rotor Copper/Aluminium	Y	Y	Y	Y			Y		Y
Stator copper	Y	Y	Y	Y			Y		Y
SC Ring	Y	Y	Y	Y	Y		Y	Y	Y
Insulating Material	Y		Y	Y			Y		
Tubes, for Cooler	Y	Y	Y	Y	Y				Y
Sleeve Bearing	Y	Y	Y	Y	Y				Y
Stator/Rotor, Exciter Coils	Y	Y	Y				Y	Y	
Castings, stator frame, terminal box and bearing housing etc.	Y	Y	Y	Y	Y			Y	
Fabrication & machining of stator, rotor, terminal box	Y	Y			Y			Y	Y
Wound stator	Y	Y					Y	Y	
Wound Exciter	Y	Y					Y	Y	
Rotor complete	Y	Y					Y		
Exciter, Stator, Rotor, Terminal Box assembly	Y	Y					Y		
Accessories, RTD, BTD,CT, Space heater, antifriction bearing, gaskets etc.	Y	Y	Y						
Complete Motor	Y	Y	Y						
<p>Note:</p> <ol style="list-style-type: none"> 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW. 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard 3. Makes of major bought out items for HT motors will be subject to NTPC approval. <p>Y1 = for HT Motor / Machines only.</p>									

MOTOR

TESTS/CHECKS / ITEMS/ COMPONENTS	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034/IEC 60079-1	vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
Plates for stator frame, end shield, spider etc.										
Shaft										
Magnetic Material	Y		Y							
Rotor Copper/Aluminium										
Stator copper			Y							
SC Ring										
Insulating Material			Y							
Tubes for Cooler		Y								
Sleeve Bearing		Y								
Stator/Rotor, Exciter Coils										
Castings, stator frame, terminal box and bearing housing etc.										
Fabrication & machining of stator, rotor, terminal box										
Wound stator										
Wound Exciter										
Rotor complete				Y	Y					
Exciter, Stator, Rotor, Terminal Box assembly										
Accessories, RTD, BTD,CT, , Space heater, antifriction bearing, gaskets etc.										
Complete Motor						Y	Y	Y	Y1	Y
<p>Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW.</p> <p>2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard</p> <p>3. Makes of major bought out items for HT motors will be subject to NTPC approval. Y1 = for HT Motor / Machines only.</p>										

LV MOTORS

DATA SHEET-A

SPECIFICATION NO.

VOLUME II B

SECTION D

REV NO. 00 DATE 30.05.2018


SHEET 1 OF 1

- | | | | |
|------|--|---|--|
| 1.0 | Design ambient temperature | : | 50 °C |
| 2.0 | Maximum acceptable kW rating of LV motor | : | ≤200KW |
| 3.0 | Installation (Indoors/ Outdoors) | : | As required |
| 4.0 | Degree Of Protection (Indoor/Outdoor) | : | IP54/IP55 |
| 5.0 | Type of Cooling | : | TEFC/CACA/TETV |
| 6.0 | Details of supply system | | |
| | a) Rated voltage (with variation) | : | 415V ± 10% |
| | b) Rated frequency (with variation) | : | 50 Hz (Variation: +3% TO -5%) |
| | c) Combined voltage & freq. variation | : | 10% |
| | d) System fault level at rated voltage | : | 50 kA for 1 sec |
| | e) Short time rating for terminal boxes | | |
| | o 110kW & Above
(Breaker controlled) | : | 50 kA for 1 sec |
| | o Below 110kW (SFU+
Contactor controlled) | : | 50 KA for 0.20 sec. |
| | f) LV System grounding | : | Solidly |
| 7.0 | Class of insulation | : | Refer clause 7.03.00 of Customer Motor Specification |
| 8.0 | Minimum voltage for starting
(As percentage of rated voltage) | : | Refer clause 6.03.00 of Customer Motor Specification |
| 9.0 | Power cables data | : | Shall be given during Detailed engg. |
| 10.0 | Earth Conductor Size & Material | : | Shall be given during Detailed engg. |
| 11.0 | Space heater supply | : | 240 V, 1Φ , 50 Hz |
| 12.0 | Rating up to which Single phase motor | : | Acceptable upto 0.20 kW |
| 13.0 | Tests | : | As per Customer motor spec. (enclosed) |
| 14.0 | Energy efficient/ Flame proof motor | : | As per Customer spec. requirement |


- **Also detail Customer spec. for Motors to be referred as enclosed with the specification.**

748359/2022/PS-PEM-MAX

Vendor to refer to this list for items in their scope only (as indicated in Electrical scope sheet between BHEL & Vendor)

		PROJECT : PATRATU STPS (3X800 MW) PACKAGE : EPC Sub Package: MOTORS & VVF Drive Panels CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR ; CONTRACTOR-M/S BHEL			REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 20 th April 2017	
Sl. No.	ITEM	QP / INS CAT.	QP No:- 9585- 001- QVE.	QP SUB. SCH.	QP APPL SCHE DULE	SUB-SUPPLIERS	PLACE	SUB- SUPPLIER APPL STATUS AS PER NTPC	SC APPL SCHE DULE	REMARKS
1)	L T (415 V) Motors	Refer Note 1				ABB ABB BHARAT BIJLEE CGL. JYOTI KEC KEC LHP MARATHON NGEF SIEMENS	FARIDABAD BANGALORE MUMBAI AHMEDNAGAR BARODA BANGALORE HUBLI SOLAPUR KOLKATA BANGALORE MUMBAI	A A A A A A A A A A A A		UPTO 55KW 55KW - 200KW RQP. FOR FLAME PROOF ALSO FOR FLAME PROOF ALSO FOR FLAMEVPROOF ALSO UPTO 90KW: FOR FLAME PROOF ALSO UPTO 200KW FOR FLAME PROOF ALSO UPTO 15KW
2)	HT MOTOR					BHEL	BIOPAL	A		



		PROJECT : PATRATU STPS (3x800 MW) PACKAGE : EPC Sub Package: MOTORS & VVVF Drive Panels CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR ; CONTRACTOR-M/S BHEL			REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 20 th April 2017	
Sl. No.	ITEM	QP/INS CAT.	QP No:- 9585-001-QVE-	QP SUB. SCH.	QP APPL SCHE DULE	SUB-SUPPLIERS	PLACE	SUPP. APPL. STATUS AS PER NTPC	SC APPL SCHE DULE	REMARKS

NOTE 1 : FOR LT MOTORS

a) Less than 30 KW


Acceptance of Motor less than 30 KW is based on COC of the manufacturer & the contractor confirming as follows:
 It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp., voltage & frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud & gland plate and tested in accordance with approved drawing /data sheets.

b) 30 KW -50KW

Acceptance of Motor rating between 30 KW & 50 KW is based on NTPC review of Routine Test inspection report as per IS 325 witnessed by main contractor along with COC of the manufacturer & the contractor confirming as follows:
 It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp., voltage & frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud & gland plate, spacer heater and tested in accordance with approved drawing /data sheets.
 c) Above 50 KW as per NTPC approved quality plan


Approval Conditions attached to above vendors-as applicable shall prevail.
 General Notes:

- 1) Vendor list & category of the mandatory spares shall be as mentioned above.
- 2) For item not appearing in the above list, main contractor to approach NTPC for acceptable vendors & inspection categorization of the same.
- 3) NTPC Approval conditions to above identified vendors shall be adhered to. Vendor's approval conditions will be informed on specific request of Main Contractor.





748359/2022/PS-PEM-MAX

Vendor to refer to this list for items in their scope only(as indicated in Electrical scope sheet between BHEL & Vendor)


		PROJECT: Patratu STPP (2X660 MW) PACAKGE: EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2		LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL		REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017			
		ITEM	QP / INS CAT	QP No:- 9578- 001- QVE-	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLI ER APPL STATUS AS PER NTPC

10.	GI cable trays, fitting	I	Inar Profiles Ltd	Enkapalli	A
-----	-------------------------	---	-------------------	-----------	---

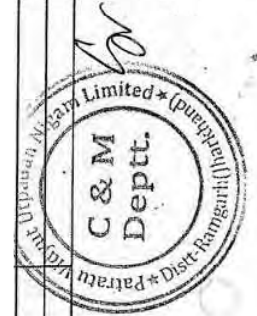


[Handwritten signature]


[Handwritten signature]



		PROJECT : Patratu STPP (2x660 MW) PACAKGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017			
Sl. No.	ITEM	QP/INS CAT	QP No:- 9578-001-QVE-	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER STATUS AS PER NTPC	SC AP PL SC HE DU LE	REMARKS			

	& accessories including bends					Vatco	Mumbai	A		Galvanization at Sigma Mumbai
						Indiana cable trays	Mumbai	A		Galvanization at Karamtara galvaniser
						Industrial Perforation	Kolkata	A		
						Ratan Engineering	Kolkata	A		Galvanization at B.P. Projects
						India Electric Syndicate	Kolkata	A		Galvanization at BMW Industries/B.P Projects
						Steelite cugg.	Mumbai	A		
						Premier Power Products	Kolkata	A		Galvanising at Ncha Galvaniser
						Indiana Gratings	Pune	A		Galvanization at Poona Galvanizer/ Anand Yeknow Aids Engg
						M.J. Engineering	Okhla/ Bhiwadi	A		
						Jamma Metal	Delhi/ Kundli	A		
						T.R.G	Chennai	A		Galvanization at TM Radhakrishna Chetty & Co
						Amtech	Pune	A		Galvanization at B.G. Shirke - Pune
						Kannade Anand Udyog	Mumbai	A		Fabrication at their units: Plot No. 42, District Thane & Plot No.: D-35 Anand Nagar MIDC, Addl. Ambernath, Dist. Thane
										Galvanization and offer the galvanized cable trays for inspection at D-34 Anand Nagar MIDC, Addl. Ambernath, Dist. Thane.
						Rukmani	Raipur	A		Ladder type cable trays only
						Passive Infra	Hasangarh (Rohtak)	A		
						Unitech Fabricators &	Howrah/	A		




748359/2022/PS-PEM-MAX

		PROJECT : Patratu STPP (2X660 MW) PACKAGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2			LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL			REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017		
Sl. No.	ITEM	QP/INS CAT	QP No:- 9578-001-QVE	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER STATUS AS PER NTPC	SC AP PL SC HE DU LE	REMARKS
						Engineers	Hoogly (Kolkata)			
						Patny System	Hyderabad	A		Galvanisation at Gurpreet galvaniser - Hyderabad
						Rabi Engg	Kolkata	A		Galvanizing from NTPC approved sources
						Advance Power Products	Howrah	A		
						Maheswari Electricals	Noida	DR		
						Saral Industries	Raibareli	DR		
						Parmar Mctal	Rajkot	DR		
						Pentax	Mumbai	DR		
						Eros metal	Nagpur	DR		
						Vinifab	Thane	DR		
						Namdhari	Ludhiana	DR		
						Indmark Formtech	PUNE	DR		
						Valco	Mumbai	A		Galvanising at Sigma Mumbai
						Inar profiles	Enkapalli	A		
						Industrial perforations	Kolkata	A		
						Premier power products	Kolkata	A		Galvanising at Neha Galvaniser
						Steelite engg.	Mumbai	A		
						Indiana gratings	Pune	A		Galvanising at Poona Galvaniser
						Arntech	Pune	A		Galvanising at B.G. Shirke
						Ratan Projects	Kolkata	A		Galvanization at NTPC approved sources
						Indmark Formtech	PUNE	DR		
						M/s PLICA	Ghaziabad	A		
						M/s Lapp	Germany	DR		
						M/s Bansal Labs	Bhopal	A		
11.	Cable tray flexible support system (GI)	I	9							
12.	Lead coated steel flexible conduits	III								


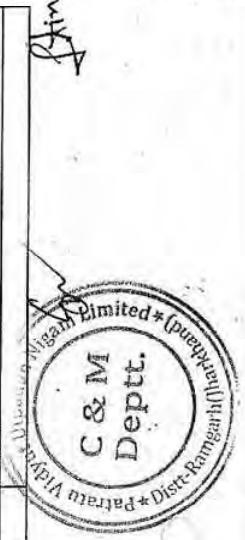


195

		PROJECT : Patratu STPP (2X660 MW) PACAKGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017	
		Sl. No.	ITEM	QP / INS CAT	QP No:- 9578-001-QVE-	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER STATUS ASPER NTPC	SC AP PL SC HE DU LE

13.	Junction boxes / Link Boxes/ Test Link Box/ Adopter box, Switch Boxes, Pull Boxes (Hot Dip Galvanized)	III				Main contractor approved sources with galvanization from NTPC approved sources (Note-2)		Noted		
14.	FRP Junction boxes	II	10			Main Contractor approved sources		Noted		

16.	Cable glands	III				Main contractor approved sources		Noted		
17.	Cable lugs	III				M/s Dowell M/s Billeis Elektro Werke Ltd.	Mumbai Umbergaon	A A		




748359/2022/PS-PEM-MAX



Sl. No.		ITEM	PROJECT : Patratu STPP (2X660 MW) PACAKGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017	
			QP / INS CAT	QP No:- 9578-001-QVE-	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER APPL STATUS AS PER NTPC	SC AP PL SC HE DU LE	REMARKS	
			(3 D)									
			M/s Chelna Nasik									
			Additionally Any make's model with VDE or CE or UL or CSA marking or BIS approved with CML no. Refer Note-3									
												Noted



Handwritten signature

		PROJECT : Patratu STPP (2X660 MW) PACKAGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017	
		Sl. No.	ITEM	QP/INS CAT	QP No:- 9578-001-QVE	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER STATUS ASPER NTPC	SC AP PL SC HE DU LE


26.	PVC conduit/hume pipe/lighting wire/GI pipes/HIDPE pipe/Structural Steel	III										
27.	GI steel rigid conduit/ epoxy conduit	III										



Handwritten signature

Handwritten signature

748359/2022/PS-PEM-MAX

		PROJECT : Patratu STPP (2X660 MW) PACAKGE :EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017	
		ITEM No.	QP / INS CAT	QP No:- 9578-001-QVE-	QP SUB. SCH.	QP APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUR-SUPPLIER APPL STATUS AS PER NTPC	SC AP PL SC HE DU I.E	REMARKS

NB:

Under Sub Supplier approval status as per NTPC column:

A: mean that vendor for this item is acceptable to NTPC.

Under QP / INSPN CATEGORY column:

CAT-I : For these items the Quality Plans approved by NTPC & final acceptance will be on physical inspection & witness by NTPC


CAT-II : For these items the Quality Plans approved by NTPC. However no physical inspection shall be done by NTPC. The final acceptance by NTPC shall be on basis of verification of documents as per approved QP


CAT-III : For these items Main supplier approves the Quality Plans. The final acceptance by NTPC shall be on basis of certificate of conformance by the main supplier.

@ : Vendors acceptance is subject to sub-QR clearance.

Note-1- Approval conditions attached to above identified vendors, as applicable shall be adhered to.

Note-2 – List of NTPC acceptable galvanizers




		PROJECT : Patratu STPP (2X660 MW) PACAKGE : EPC Sub Package: Electrical Equipment Supply & Erection CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR Contractor-M/S BHEL				REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 24 th April 2017	
		SI. No.	ITEM	QP / INS CAT	QP No:- 9578-001-QVE-	QP SUB. SCH.	APP L SCH EDU LE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER APPL STATUS AS PER NTPC	SC AP PL SC HE DU LE

1. M/s M J Engg, Delhi 2. M/s Jamma Metal, Delhi 3. M/s A. V. Engg, Kolkata 4. M/s Inar Profiles, Vishakapatnam 5. M/s Anand Udyog, Mumbai 6. M/s Techno Engg, Chandigarh 7. M/S Steelite Engg, Mumbai	8. M/s National Galvanizer, Kolkata 9. M/s Unistar Galvanizer, Kolkata 10. M/s B.P. Project, Kolkata 11. M/s Bajaj Pune 12. M/s Electrocare Industries, Mumbai 13. M/s B.G. Shirke, Pune 14. M/s Gurpreet Galvanizer, Hyderabad 15. M/s Sigma, Mumbai	16. M/s Radhakrishnan Shetty, Chennai 17. Karamlara Mumbai 18. Poona Galvanizers Pune 19. Neha Galvanizer- Kolkata 20. Unitech galvanizers- Hoogly 21. Gurpreet galvanizers- Hyderabad 22- DMP Projects- Kolkata	Additional galvanizers, if any, proposed by manufacturer through main contractor during detailed engineering shall be reviewed & assessed by NTPC as per the merits of the case.
--	--	--	--


Note-3 : VDE / CE / UL / CSA MARKING FOR PRODUCT QUALITY: SELF CERTIFICATION/VALID CERTIFICATION FROM THIRD PARTY AGENCY OR BIS APPROVAL LETTER WITH CML NO. FOR PRODUCT QUALITY SHALL BE SUBMITTED FOR NTPC'S INFORMATION


Handwritten signature
NTPC




Handwritten signature
JATIN GAHLANAT
BHEL





CLAUSE NO.	Bidder's Name		
	PART-II		
	TECHNICAL INFORMATION AND DATA TO BE SUBMITTED AFTER AWARD OF CONTRACT		
	DE-1A	HT MOTORS	
	A.	GENERAL	
	5.	Manufacturer & Country of origin.(Shall be as per approved QA make)	
	6.	Equipment driven by motor	
	7.	Motor type	
	8.	Quantity	
	B.	DESIGN AND PERFORMANCE DATA	
	17.	Frame size	
	18.	Type of duty	
	19.	Type of enclosure /Method of cooling/ Degree of	
	20.	Applicable standards to which motor generally	
	21.	(a)Whether motor is flame proof	Yes/No
		(b)If yes, the gas group to which it conforms as per IS:2148	
	22.	Type of mounting	
	23.	Direction of rotation as viewed from DE END	
	24.	Standard continuous rating at 40 deg.C. ambient temp. as per Indian Standard (KW)	
	25.	Derated rating for specified normal condition i.e. 50 deg. C ambient temperature (KW)	
	26.	Maximum continuous load demand at design duty point of driven equipment in KW	
	27.	Rated Voltage (volts)	
	28.	Permissible variation of :	
	d.	Voltage (Volts)	
	e.	Frequency (Hz)	
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS PAGE 6 OF 17


CLAUSE NO.	Bidder's Name	
f.	Combined voltage and frequency	
29.	Rated speed at rated voltage and frequency	
30.	At rated Voltage and frequency:	
c.	Full load current	
d.	No load current	
31.	Power Factor at	
d.	100% load	
e.	NO load	
f.	Starting.	
32.	Efficiency at rated voltage and frequency	
d.	100% load	
e.	75% load	
f.	50% load	
33.	Starting current (amps) at	
a.	100 % voltage	
b.	85% voltage	
c.	80% voltage	
34.	Minimum permissible starting Voltage (Volts)	
35.	Starting time with minimum permissible voltage	
a.	Without driven equipment coupled	
b.	With driven equipment coupled	
36.	Safe stall time with 100% and 110% of rated voltage	
a.	From hot condition	
b.	From cold condition	
37.	Torques :	
a.	Starting torque at min. permissible voltage(kg-mtr.)	
b.	Pull up torque at rated voltage.	
c.	Pull out torque	
d.	Min accelerating torque (kg.m) available	


EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 7 OF 17
--	--	--------------	-----------------


CLAUSE NO.	Bidder's Name		
e.	Rated torque (kg.m)		
38.	Stator winding resistance per phase (ohms at 20 Deg.C.)		
39.	GD ² value of motors		
40.	No of permissible successive starts when motor is in		
41.	Locked Rotor KVA Input		
42.	Locked Rotor KVA/KW		
43.	Vibration limit		
a.	Velocity (mm/s)		
b.	Displacement (microns)		
44.	Noise level limit (dBA)		
C.	CONSTRUCTIONAL FEATURES		
1.	Stator winding insulation		
	a. Class & Type		
	b. Winding Insulation Process shall be VPI	Yes/No	
	c. Tropicalised (Yes/No)		
	d. Temperature rise over specified max.		
	i. Cold water temperature of 38 DEG. C.		
	ii. Ambient Air 50 DEG. C.		
	e. Method of temperature measurement		
	f. Stator winding connection		
	g. Number of terminals brought out		
2.	Type of terminal box for following:		
	a. Stator leads		
	b. Space heater		
	c. Temperature detectors(RTDs,BTDs)		
	d. Instrument switch etc.		
3.	Bearing		
	a. Type DE/NDE		
	b. Manufacturer		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS PAGE 8 OF 17


CLAUSE NO.	Bidder's Name		
	c. Self Lubricated or forced Lubricated		
	d. Recommended lubricant		
	e. Oil quantity		
	f. Max cold oil temp. to bearing		
	g. Guaranteed life in Hrs		
	h. Lubrication type		
4.	Oil pressure gauge/ switch		
	a. Range		
	b. Contact Nos. & ratings		
	c. Accuracy		
5.	Type of cooler (CACA/CACW)/ Number		
6.	Cooling water requirements		
	a. Quantity required		
	b. Maximum permissible inlet water temp. in deg.C		
	c. Pressure of water at inlet to coolers		
	d. Outlet temperature of water at full load		
	e. Cold air temp. at outlet		
7.	Paint shade		
8.	Max. permissible temperature of rotor (deg.C)		
9.	Temp. Rise of rotor during 1 st start (deg.C)		
10.	Temp. rise of rotor during 2 nd start (deg.C)		
11.	Surge withstand voltage (stator winding) as per IEC-		
	a. Lightning impulse withstand level (1.2/50 micro sec surge)(KVp)		
	b. Interturn insulation surge withstand level (KVp)		
12.	Weight of		
	a. Motor stator (KG)		
	b. Motor Rotor (KG)		
	c. Total weight (KG)		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS
			PAGE 9 OF 17

CLAUSE NO.	Bidder's Name		
D.	List of accessories.		
1.	RTDs for winding(Type/Nos/Leads/Location/make/Res.at 0 Deg.C)		
2.	RTDs for bearing(Type/Nos/Leads location/make/Res.at 0 Deg.C)		
3.	RTDs for Hot Air (Type/No/Leads)		
4.	RTDs for Cold Air (Type/No./Leads)		
5.	Space Heaters		
	i) Nos.		
	ii) Total Power (Watts)		
	iii) Supply Voltage		
6.	Stator Terminal Box		
	i) Type		
	ii) Fault Level (MVA)/Fault Level duration (secs)		
	iii) Location(viewed from NDE side)		
	iv) Entry of cables (bottom/side)		
	v) Recommended cable size(To be matched with cable size envisaged by owner)		
7.	Cable glands & lugs details (shall be suitable for power cable)		
8.	Neutral Terminal box Type		
9.	Current Transformer		
	i) Nos.		
	ii) Ratio		
	iii) Accuracy Class		
	iv) Knee Point Voltage-Vk (Volts)		
	v)Exciting Current		
	vi) Max Secondary Resistance		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS PAGE 10 OF 17


CLAUSE NO.	Bidder's Name		
10.	Dial Type Thermometer		
	i) For Bearings (Nos.)		
	ii) For Air Temp (Nos.)		
	a. Hot Air		
	b. Cold Air		
	iii) Contact Rating		
	iv) Range		
	v) Supply Voltage		
11.	Rotor Terminal Box		
12.	TBs for RTDs, BTDs & Space Heater (Yes/No)		
13.	Sole Plate (Yes/No)		
14.	Foundation & Anchoring bolts (Yes/No)		
15.	Base Frame (Yes/No)		
16.	Speed switch (Yes/No)		
	i) No of contacts and contact ratings of speed		
17.	Insulation of bearing (Yes/No)		
18.	Forced oil lubrication (Yes/No)		
19.	Oil level indicator (Yes/No)		
20.	Noise reducer(Yes/No)		
21.	Flow switch for CACW motor (Quantity)		
	i) No of contacts and contact ratings		
22.	Water leakage detector		
	i) No of contacts and contact ratings		
23.	Grounding pads		
	i) No and size on motor body		
	ii) Nos on terminal Box		
24.	Vibration pads		
	i) Nos and size		
	ii) Location		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS PAGE 11 OF 17

CLAUSE NO.	Bidder's Name			
	25.	Any other fitments		
	E.	List of curves.		
	1.	Torque speed characteristic of the motor		
	2.	Calibration characteristic of platinum type resistance temperature detector		
	3.	Calibration characteristic of platinum BTD		
	4.	Thermal withstand characteristic		
	5.	Starting. current Vs. Time		
	6.	Starting. current Vs speed		
	7.	Neg. sequence current vs Time..		
	8.	P.F. and Effi. Vs Load		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2		DB07: MOTORS
				PAGE 12 OF 17


CLAUSE NO.	Bidder's Name					
	DE-1B LT MOTORS					
	A. GENERAL					
5.	Manufacturer & Country of origin. (Shall be as per approved QA make)					
6.	Equipment driven by motor					
7.	Motor type					
8.	Quantity					
	B. DESIGN AND PERFORMANCE DATA					
18.	Frame size					
19.	Type of duty					
20.	Type of enclosure /Method of cooling/ Degree of					
21.	Applicable standard to which motor generally					
22.	Efficiency class as per IS 12615					
23.	(a)Whether motor is flame proof	Yes/No				
	(b)If yes, the gas group to which it conforms as per IS:2148					
24.	Type of mounting					
25.	Direction of rotation as viewed from DE END					
26.	Standard continuous rating at 40 deg.C. ambient temp. as per Indian Standard (KW)					
27.	Derated rating for specified normal condition i.e. 50 deg. C ambient temperature (KW)					
28.	Maximum continuous load demand of driven					
29.	Rated Voltage (volts)					
30.	Permissible variation of :					
	a. Voltage (Volts)					
	b. Frequency (Hz)					
	c. Combined voltage and frequency					
31.	Rated speed at rated voltage and					
32.	At rated Voltage and frequency:					
	a. Full load current					
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%; text-align: center;">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)</td> <td style="width: 33%; text-align: center;">TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2</td> <td style="width: 15%; text-align: center;">DB07: MOTORS</td> <td style="width: 19%; text-align: center;">PAGE 13 OF 17</td> </tr> </table>			EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 13 OF 17
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 13 OF 17			


CLAUSE NO.	Bidder's Name	
	b. No load current	
33.	Power Factor at	
	a. 100% load	
	b. NO load	
	c. Starting.	
34.	Efficiency at rated voltage and frequency,	
	a. 100% load	
	b. 75% load	
	c. 50% load	
35.	Starting current (amps) at	
	a. 100 % voltage	
	b. 85% voltage	
	c. 80% voltage	
36.	Minimum permissible starting Voltage (Volts)	
37.	Starting time with minimum permissible voltage	
	a. Without driven equipment coupled	
	b. With driven equipment coupled	
38.	Safe stall time with 100% and 110% of rated	
	a. From hot condition	
	b. From cold condition	
39.	Torques :	
	a. Starting torque at min. permissible voltage(kg-	
	b. Pull up torque at rated voltage.	
	c. Pull out torque	
	d. Min accelerating torque (kg.m) available	
	e. Rated torque (kg.m)	
40.	Stator winding resistance per phase (ohms at 20	
41.	GD ² value of motors	

EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 14 OF 17
--	--	--------------	------------------


CLAUSE NO.	Bidder's Name		
42.	No of permissible successive starts when motor is in hot condition		
43.	Locked Rotor KVA Input		
44.	Locked Rotor KVA/KW		
45.	Vibration limit :Velocity (mm/s)		
46.	Noise level limit (dBA)		
C.	CONSTRUCTIONAL FEATURES		
1.	Stator winding insulation		
	a. Class & Type		
	b. Winding Insulation Process		
	c. Tropicalised (Yes/No)		
	d. Temperature rise over specified maximum ambient temperature of 50 deg C		
	e. Method of temperature measurement		
	f. Stator winding connection		
2.	Main Terminal Box		
	a. Type		
	b. Location(viewed from NDE side)		
	c. Entry of cables(bottom/side)		
	d. Recommended cable size(To be matched with cable size envisaged by owner)		
	e. Fault level (MVA),Fault level duration(sec)		
	f. Cable glands & lugs details (shall be suitable for		
3.	Type of DE/NDE Bearing		
4.	Motor Paint shade		
5.	Weight of		
	a. Motor stator (KG)		
	b. Motor Rotor (KG)		
	c. Total weight (KG)		
D.	List of accessories.		

EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 15 OF 17
--	--	--------------	------------------

CLAUSE NO.	Bidder's Name	
1.	3 Space Heaters (Applicable for 30 KW & above motor) (Nos./Power in watts/supply voltage)	
2.	Terminal Box for Space Heater (Yes/No)	
3.	Speed switch (Yes/No)	
4.	Insulation of bearing (Yes/No)	
5.	Noise reducer(Yes/No)	
6.	Grounding pads	
	i) No and size on motor body	
	ii) Nos on terminal Box	
7.	Vibration pads	
	i) Nos and size	
	ii) Location	
8.	Any other fitments	
E.	List of curves.	
1.	Torque speed characteristic of the motor	
2.	Thermal withstand characteristic	
3.	Starting. current Vs. Time	
4.	Starting. current Vs speed	
5.	P.F. and Effi. Vs Load	
F.	Additional Data to be filled for each rating of DC Motor	
1.	Rated armature voltage (Volt)	
2.	Rated field excitation (Amp)	
3.	Permissible % variation in voltage	
4.	Minimum Permissible Starting voltage (volt)	
5.	At rated voltage	
	i)Full load Armature current.(Amp)	
	ii)Full load Field current (Amp)	
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)		
TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2		
DB07: MOTORS		
PAGE 16 OF 17		

CLAUSE NO.	Bidder's Name	
	iii) No load Armature current (Amp)	
6.	Full load Field current (Amp)	
7.	No load Armature current (Amp)	
8.	Minimum permissible field current(Amp) to avoid	
	i) Maximum permissible voltage	
	ii) Rated voltage	
	iii) Minimum Permissible Voltage	
9.	Resistance (indicative Values) in ohm	
	i) Armature winding(Arm + IP + Series) at 25	
	ii) Field Winding at 25 deg. C	
10..	Inductance (indicative values)	
	i) Armature winding	
	ii) Field winding	
11	Value of trimmer resistance (ohm) to be connected in series with the shunt field to	
	i) 220 V DC	
	ii) 250 V DC	
	iii) 187 V DC	
12	Value of the external resistance (ohm)required to be connected in series with armature during starting only	
13	Technical data sheet for external resistance box	
14	GA drawing of motor	
15	Starting time calculation	
16	Starter resistance design calculation	
17	Electrical connection diagram of motor	
<p>EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X800 MW)</p>		
<p>TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2</p>		
<p>DB07: MOTORS</p>		
<p>PAGE 17 OF 17</p>		

748359/2022/PS-PEM-MAX

	3x800 MW PATRATU TPS	SPECIFICATION No: PE-TS-434-571-A901	
	GYPSUM DEWATERING EQUIPMENT TECHNICAL SPECIFICATION (C&I PORTION)	SECTION : I	
		SUB-SECTION : C-4	
		REV. 00	

SECTION: I


SUB-SECTION: C-4

TECHNICAL SPECIFICATION (C&I PORTION)

748359/2022/PS-PFM-MAX

	3 x 800 MW PVUNL PATRATU TPP PHASE-I	SECTION: C4
	TECHNICAL REQUIREMENTS (C&I) GYPSUM DEWATERING EQUIPMENT	

**CONTROL AND INSTRUMENTATION
FOR
GYPSUM DEWATERING EQUIPMENT**

				
	3 x 800 MW PVUNL PATRATU TPP PHASE-I	DESG	ATR	
	JOB NO: 434	CHKD	MK	
	REV. NO. 00	DATE: 21.03.2022	APPD	SC



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

INDEX

S. No.	DESCRIPTION
1	TITLE SHEET
2	INDEX SHEET
3	C&I SPECIFIC TECHNICAL REQUIREMENTS
4	GENERAL TECHNICAL SPECIFICATION
5	LIST OF DOCUMENTS/DELIVERABLES
6	MEASURING INSTRUMENTS (PRIMARY & SECONDARY)
7	DATA SHEETS FOR MOTORISED VALVE ACTUATOR
8	SIGNL EXCHANGE BETWEEN DRIVES & DCS
9	DRIVE AND INSTRUMENT INTERFACE DIAGRAM
10	INSTRUMENT CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY
11	QUALITY ASSURANCE
12	TYPE TEST REQUIREMENT
13	INSTRUMENT STUB DETAILS
14	INSTRUMENT INSTALLATION DRAWING
15	SUB VENDOR LIST
16	FORMAT FOR PROVENNESS CERTIFICATE



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

**C&I SPECIFIC TECHNICAL REQUIREMENT
FOR DCS BASED
GYPSUM DEWATERING EQUIPMENT**



C&I SPECIFICATION FOR GYPSUM DEWATERING EQUIPMENT

SECTION: C4
SUB SECTION: C&I

Specific Technical Requirements (C&I):

1. GYPSUM DEWATERING EQUIPMENT (GDE) shall be operated from DCS (BHEL's scope).
2. The Contractor shall provide complete Instrumentation for control, monitoring and operation of entire GDE except marked as BHEL's scope in P&ID attached in specification. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre- bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of customer shall prevail without any commercial implication.
3. The make/model of various instruments/items/systems shall be as per NTPC approved vendor list. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
4. All instruments and control elements shall be terminated on JB/LCP in field. JB/LCP is in bidder's scope for bidder's supplied instrument and in BHEL's scope for BHEL's supplied instrument. Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 12-15 meter) and trunk cable.
5. For cable scope refer to electrical scope between BHEL and vendor defined in electrical specification.
6. Bidder to provide mandatory spares as per mandatory spares list.
7. Electrical Actuators with integral starter shall be provided for all on/off and inching type valves along with necessary interface units for linking to corresponding Control System as applicable, typical Hook-up diagram of drives is included for reference.
8. The specifications for instruments mentioned in the specification are minimum requirements. The detail specifications shall be finalized during detail engineering.
9. The bidders shall specifically mention any deviation they would like to take on the C&I specification. In absence of only deviation, a No deviation certificate is to be furnished.
10. The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.



C&I SPECIFICATION FOR GYPSUM DEWATERING EQUIPMENT

SECTION: C4
SUB SECTION: C&I

11. Bidder to provide input/output list, drives list, junction box schedule and termination details, recommended control logics / write-up etc. the list of documents to be submitted after award of contract is to be referred by bidder.
12. All the transmitters supplied by Bidder shall be rack mounted. The transmitter racks shall be in Bidder's scope of supply. All transmitters shall be HART compatible.
13. Bidder to perform tests of C&I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to perform by Bidder without any cost implication. The make/model of various instruments/items/systems shall be as per customer/BHEL approved vendor list. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
14. Instrument installation and accessories required for the same shall be in Bidder's scope and shall be submitted after award of contract. However, any instrument/ analyser installation not covered in the same shall be subject to customer and BHEL approval during detailed engineering.
15. All Temperature sensors shall be Duplex type and temperature transmitter shall be provided for all temperature measurement applications. Bidder to provide temperature transmitter, JB/Rack & other erection hardware.
16. Bidder to provide temperature sensor along with temperature transmitter for HT drives i.e. Pump and Motor for BRG and winding temp measurement.
17. Vibration Monitoring System, is envisaged for HT Motor, which is in BHEL scope. However, for mounting of vibration sensors/probe, vendor to provide vibration pad (of dimension of 80mm x 80mm x 10mm each) for mounting of sensors and a notch/slot for mounting of key phasor.
18. Bidder to provide Flow measuring device suitable for the service condition, which shall be decided by BHEL/customer during detail engineering. Bidder to comply the requirement without any commercial implication.
19. Bidder to furnish electrical load/UPS load data during detailed engineering. UPS Power supply shall be provided by BHEL at a single point, further distribution to various instruments/equipment of the system shall be in bidder scope. Bidder to include necessary power distribution board in his scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
20. Interface of MCC, HT SWGR, Solenoid valves, field instruments, Actuators etc. with DDCMIS based control system shall be as per Drive Control Philosophy enclosed in specification.
21. Local control panel if any required for operation shall be in bidder scope.




**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

22. The solenoid operated valves/Dampers/Gate shall have a limit switch for open/close feedback. Solenoid Valve shall be rated for 24V Dc only.
23. All field instruments enclosure shall be IP65 local panel/cabinet enclosure shall be IP 55, unless otherwise specified.
24. Diaphragm seal shall be provided with Instruments having contact with corrosive media.
25. Redundancy of sensors shall be provided by bidder
 - (i) Triple redundancy for all Analog and binary inputs required for protection of system/drives.
 - (ii) For all other control functions dual redundancy of the sensors shall be provided by the bidder.
26. Double root valve shall be provided for all pressure tapings where the pressure exceeds 40kg/cm².
27. Use of process actuated shall be avoided unless unavoidable.
28. Number of pairs to be selected for Screen /Control cable
 - a) F-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - b) G-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - c) Core Cable: 3CX2.5sqmm²/ 5CX2.5sqmm²/ 12CX1.5sqmm²
29. Instrument installation shall be as per the attached "Standard Hook-up diagram of instrument."
30. In addition to requirements specified here, all C&I systems/ sub-systems/ equipment/ devices shall also meet other requirements stipulated under other Sub-sections/ parts/ sections of specification.
31. In case of any conflict and repetition of clauses in the specification, BHEL discretion will prevail.
32. Measuring instruments (primary & secondary), analysers offered for this package shall have at least one year's satisfactory operation in one power station having unit rating of 200 MW or above. Provenness certificate shall be provided as per the attached format (Annexure - 1).
33. All the outdoor field instruments such as analysers/transmitters/meters etc. shall be provided with suitable Free standing cabinet(s)/panel/rack so that the equipments are protected against rain/ sunlight etc.
34. Contractor shall furnish Instrument Schedule, I/O list, Drive list, Cable Schedule, Cable interconnection (DCS end terminal details shall be provided to vendor during detail engineering to incorporate in cable interconnection), JB grouping, Annunciation list, SOE list, List of Instruments/devices for HART in BHEL approved format. Also reusable database format like MS Excel, MS Access etc. of these documents shall also be provided by Contractor in BHEL approved format. Soft copy of the formats shall be provided to the successful bidder.

**GENERAL TECHNICAL
SPECIFICATION
CONTROL & INSTRUMENTATION**

FORM NO. PEM-666-0

	SPECIFICATION FOR CONTROL & INSTRUMENTATION FOR AUX PACKAGES	SPECIFICATION NO.:	
		VOLUME	
		SUB SECTION	
		REV. NO.	DATE :
		SHEET	OF
<p>GENERAL REQUIREMENT</p> <p>1.0 Bidder shall provide complete and independent control & instrumentation system with all accessories, auxiliaries and associated equipments for the safe, efficient and reliable operation of auxiliary systems.</p> <p>2.0 The quantity of instruments for auxiliary system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.</p> <p>3.0 Measuring instruments/equipment and subsystems offered by the bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Further all the instruments shall be of proven reliability, accuracy, and acceptable international standards and shall be subject to employer's approval. All instrumentation equipment and accessories under this specification shall be furnished as per technical specification, ranges, makes/ numbers as approved by the employer' during detail engineering.</p> <p>4.0 The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifold and all the other accessories required for mounting/ erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments; sensors, switches etc for external connection including spare contacts shall be wired out to suitably located junction boxes.</p> <p>5.0 The customer specification attached as Specific Technical Requirement will supercede the Data sheets, if there is any mismatch.</p>			



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

LIST OF DOCUMENTS/DELIVERABLES



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

LIST OF DELIVERABLES OF PEM - C&I DEPARTMENT

Sl. No.	DRAWING NO.	DRAWING/DOCUMENT TITLE	CATEGORY
1	PE-V4-434-145-I901	CONTROL & OPERATIONAL WRITE-UP FOR THE SYSTEM WITH SET POINTS	A
2	PE-V4-434-145-I902	CONTROL SCHEME/LOGIC DIAGRAM (TO BE IMPLEMENTED IN DDCMIS)	A
3	PE-V4-434-145-I903	HMI PICTURES/PLANT SCHEMATICS	A
4	PE-V4-434-145-I904	INSTRUMENT SCHEDULE WITH SET POINTS	A
5	PE-V4-434-145-I905	I/O LIST (ANALOG & BINARY)	A
6	PE-V4-434-145-I906	DRIVE LIST/SOLENOID/ACTUATOR VALVE LIST WITH LOCATION DATA	A
7	PE-V4-434-145-I907	FIELD JB/LIE/LIR,DRIVES TERMINATIONS	A
8	PE-V4-434-145-I908	DATASHEETS FOR INSTRUMENTS, JBs, etc.	A
9	PE-V4-434-145-I909	QUALITY PLANS (INSTRUMENTS, VMS, etc.)	A
10	PE-V4-434-145-I910	INSTRUMENT HOOK-UP DRAWING	A
11	PE-V4-434-145-I911	THERMOWELL SIZING CALCULATION	A
12	PE-V4-434-145-I913	CABLE SCHEDULE & INTERCONNECTION	A
13	PE-V4-434-145-I914	ANNUNCIATION & SOE LIST	A

NOTES:

ANY OTHER DOCUMENT DECIDED DURING DETAILED ENGINEERING SHALL BE PROVIDED BY BIDDER WITHOUT ANY COMMERCIAL/TECHNICAL IMPLICATION.


CONTRACTOR TO SUBMIT REUSABLE DATABASE FORMATS IN BHEL/CUSTOMER APPROVED FORMATS LIKE MS EXCEL, MS ACCESS OF DOCUMENTS LIKE INSTRUMENT SCHEDULE, I/O LIST, DRIVE LIST, FIELD JB TERMINATIONS, CABLE SCHEDULE & INTERCONNECTION, etc. SOFT COPY OF FORMATS SHALL BE PROVIDED TO SUCCESSFUL BIDDERS.





**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**


SECTION: C4
SUB SECTION: C&I


**MEASURING INSTRUMENTS
(PRIMARY & SECONDARY)
&
SPECIFICATION FOR ELECTRONIC
TRANSMITTERS**


CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.00.00	MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)			
1.01.00	<p>Measuring instruments/equipment and subsystems offered by the Bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Refer Sub-section Basic Design Criteria. Further, all instruments shall be of proven reliability, accuracy, and repeatability requiring a minimum of maintenance and shall comply with the acceptable international standards and shall be subject to Employer's approval.</p>			
1.02.00	<p>Every panel-mounted instrument requiring power supply shall be provided with easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a grounding terminal and shall be suitably connected to the panel grounding bus.</p>			
1.03.00	<p>All transmitters, sensors, switches and gauges for parameters like pressure, temperature, level, flow etc. as required for the safe and efficient operation and maintenance as well as for operator and management information (including all computation) of equipment in the system under the scope of specification shall be provided on as required basis with in quoted lump sum price. The Contractor shall furnish all Instrumentation / Control equipment & accessories under this specification as per technical specification, ranges, makes & model as approved by the Employer during detailed engineering.</p>			
1.04.00	<p>The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting/erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments, sensors, switches etc. for external connection including spare contacts shall be wired out in flexible/rigid conduits, independently to suitably located common junction boxes. The proposal shall include the necessary cables, flexible conduits, junction boxes and accessories for the above purpose. Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kg./sq.cm.</p>			
1.05.00	<p>All instruments envisaged for sea water applications, shall be provided with wetted parts made of Monel/ Hastelloy C or any other material (if provenness experience of the proposed material for such applications is established by contractor).</p> <p>For Chlorine application: Instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Hastelloy C. Also, filled liquid shall be Fluorolube oil/ Inert Hydrocarbon / CTFE etc., for these applications.</p> <p>For applications of FECL3 solution: Instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Tantalum.</p>			
1.06.00	<p>For coastal areas, all instruments shall be provided with durable epoxy coating for housings and all exposed surfaces of the instruments.</p>			
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>		<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 1 OF 46</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS																																																										
2.00.00	SPECIFICATION FOR ELECTRONIC TRANSMITTERS																																																										
2.01.00	SPECIFICATION FOR ELECTRONIC TRANSMITTER FOR PRESSURE, DIFF PRESS AND DP BASED FLOW / LEVEL MEASUREMENTS <table border="1" data-bbox="375 409 1284 1841"> <thead> <tr> <th data-bbox="375 409 487 441">SI.No.</th> <th data-bbox="490 409 747 441">Features</th> <th colspan="2" data-bbox="750 409 1284 441">Essential/Minimum Requirements</th> </tr> </thead> <tbody> <tr> <td data-bbox="375 493 487 556">1.</td> <td data-bbox="490 493 747 556">Type of Transmitter</td> <td colspan="2" data-bbox="750 493 1284 556">Microprocessor based 2 wire type (loop powered), Hart protocol compatible.</td> </tr> <tr> <td data-bbox="375 577 487 609">2.</td> <td data-bbox="490 577 747 609">Accuracy</td> <td colspan="2" data-bbox="750 577 1284 609">± 0.1% of calibrated span (minimum)</td> </tr> <tr> <td data-bbox="375 630 487 693">3.</td> <td data-bbox="490 630 747 693">Output signal range</td> <td colspan="2" data-bbox="750 630 1284 693">4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol)</td> </tr> <tr> <td data-bbox="375 735 487 819">4.</td> <td data-bbox="490 735 747 819">Turn down ratio (minimum)</td> <td colspan="2" data-bbox="750 735 1284 934"> 10:1 for vacuum/very low pressure applications (i.e. pressure ≤ 200 mmWC) 5:1 for very high pressure application (i.e. pressure ≥ 200 Kg/cm²) 30:1 for other applications </td> </tr> <tr> <td data-bbox="375 945 487 1092">5.</td> <td data-bbox="490 945 747 1092">Stability</td> <td colspan="2" data-bbox="750 945 1284 1092"> ± 0.1% of calibrated span for six months for Ranges up to and including 70 Kg/cm² ± 0.25% of calibrated span for six months for Ranges more than 70 Kg/cm² </td> </tr> <tr> <td data-bbox="375 1102 487 1186">6.</td> <td data-bbox="490 1102 747 1186">Zero and span drift</td> <td colspan="2" data-bbox="750 1102 1284 1186"> +/- 0.015% per deg.C at max span +/-0.11% per deg.C at min. Span </td> </tr> <tr> <td data-bbox="375 1197 487 1228">7.</td> <td data-bbox="490 1197 747 1228">Load impedance</td> <td colspan="2" data-bbox="750 1197 1284 1228">500 ohm (minimum)</td> </tr> <tr> <td data-bbox="375 1249 487 1312">8.</td> <td data-bbox="490 1249 747 1312">Housing</td> <td colspan="2" data-bbox="750 1249 1284 1312">Weather proof as per IP-65, metallic housing with durable corrosion resistant coating</td> </tr> <tr> <td data-bbox="375 1323 487 1354">9.</td> <td data-bbox="490 1323 747 1354">Over Pressure</td> <td colspan="2" data-bbox="750 1323 1284 1354">150% of max. Operating pressure</td> </tr> <tr> <td data-bbox="375 1375 487 1438">10.</td> <td data-bbox="490 1375 747 1438">Connection (Electrical)</td> <td colspan="2" data-bbox="750 1375 1284 1438">Plug and socket type</td> </tr> <tr> <td data-bbox="375 1449 487 1480">11.</td> <td data-bbox="490 1449 747 1480">Process connection</td> <td colspan="2" data-bbox="750 1449 1284 1480">1/2 inch NPT (F)</td> </tr> <tr> <td data-bbox="375 1501 487 1596">12.</td> <td data-bbox="490 1501 747 1596">Span and Zero</td> <td colspan="2" data-bbox="750 1501 1284 1596">Continuous, tamper proof, Remote as well as manual adjustability from instrument with zero suppression and elevation facility.</td> </tr> <tr> <td data-bbox="375 1606 487 1841">13.</td> <td data-bbox="490 1606 747 1841">Accessories</td> <td colspan="2" data-bbox="750 1606 1284 1841"> -Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & Gauge pressure transmitters, 3-valve and 5 valve manifold for DP/Level/Flow applications. The valve manifold shall be non integral type (except Fuel Oil area). </td> </tr> </tbody> </table>			SI.No.	Features	Essential/Minimum Requirements		1.	Type of Transmitter	Microprocessor based 2 wire type (loop powered), Hart protocol compatible.		2.	Accuracy	± 0.1% of calibrated span (minimum)		3.	Output signal range	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol)		4.	Turn down ratio (minimum)	10:1 for vacuum/very low pressure applications (i.e. pressure ≤ 200 mmWC) 5:1 for very high pressure application (i.e. pressure ≥ 200 Kg/cm ²) 30:1 for other applications		5.	Stability	± 0.1% of calibrated span for six months for Ranges up to and including 70 Kg/cm ² ± 0.25% of calibrated span for six months for Ranges more than 70 Kg/cm ²		6.	Zero and span drift	+/- 0.015% per deg.C at max span +/-0.11% per deg.C at min. Span		7.	Load impedance	500 ohm (minimum)		8.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistant coating		9.	Over Pressure	150% of max. Operating pressure		10.	Connection (Electrical)	Plug and socket type		11.	Process connection	1/2 inch NPT (F)		12.	Span and Zero	Continuous, tamper proof, Remote as well as manual adjustability from instrument with zero suppression and elevation facility.		13.	Accessories	-Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & Gauge pressure transmitters, 3-valve and 5 valve manifold for DP/Level/Flow applications. The valve manifold shall be non integral type (except Fuel Oil area).	
SI.No.	Features	Essential/Minimum Requirements																																																									
1.	Type of Transmitter	Microprocessor based 2 wire type (loop powered), Hart protocol compatible.																																																									
2.	Accuracy	± 0.1% of calibrated span (minimum)																																																									
3.	Output signal range	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol)																																																									
4.	Turn down ratio (minimum)	10:1 for vacuum/very low pressure applications (i.e. pressure ≤ 200 mmWC) 5:1 for very high pressure application (i.e. pressure ≥ 200 Kg/cm ²) 30:1 for other applications																																																									
5.	Stability	± 0.1% of calibrated span for six months for Ranges up to and including 70 Kg/cm ² ± 0.25% of calibrated span for six months for Ranges more than 70 Kg/cm ²																																																									
6.	Zero and span drift	+/- 0.015% per deg.C at max span +/-0.11% per deg.C at min. Span																																																									
7.	Load impedance	500 ohm (minimum)																																																									
8.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistant coating																																																									
9.	Over Pressure	150% of max. Operating pressure																																																									
10.	Connection (Electrical)	Plug and socket type																																																									
11.	Process connection	1/2 inch NPT (F)																																																									
12.	Span and Zero	Continuous, tamper proof, Remote as well as manual adjustability from instrument with zero suppression and elevation facility.																																																									
13.	Accessories	-Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & Gauge pressure transmitters, 3-valve and 5 valve manifold for DP/Level/Flow applications. The valve manifold shall be non integral type (except Fuel Oil area).																																																									
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 2 OF 46																																																								


CLAUSE NO.	TECHNICAL REQUIREMENTS		
2.02.00	14. Diagnostics & display 15. Power supply 16. Adjustment/calibration/maintenance	<p>-For hazardous area, explosions proof enclosure as described in NEC article 500</p> <p>Mounting: 2 inch pipe mounting.</p> <p>Self-Indicating feature and digital display on transmitter</p> <p>24V DC \pm 10%.</p> <p>From hand held HART calibrator/ centralized PC based system (as applicable).</p>	
	<p>Notes</p> <ul style="list-style-type: none"> - For primary air/ secondary air/flue gas applications, DP type transmitters shall be provided for pressure measurement. - LVDT type is not acceptable. - Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 		
	GUIDED WAVE RADAR TYPE LEVEL TRANSMITTER		
Type	Microprocessor based 2 wire type (loop powered), HART protocol compatible Guided wave radar transmitter.		
Principle	TDR (Time domain reflectometry)		
Probe Type & Material	(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.		
Output signal	4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.		
Accuracy	+/- 0.5% of calibrated span or minimum 5mm.		
Power supply	24 VDC +/- 10%.		
Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 3 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS													
2.03.00	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%; padding: 5px;">Adjustment/ calibration</td> <td style="padding: 5px;">Using hand held HART calibrator/ centralized PC based system (as applicable).</td> </tr> <tr> <td style="padding: 5px;">Zero & span adjustment</td> <td style="padding: 5px;">Continuous, temper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.</td> </tr> <tr> <td style="padding: 5px;">Display</td> <td style="padding: 5px;">Integral digital display.</td> </tr> <tr> <td style="padding: 5px;">Load Impedance</td> <td style="padding: 5px;">500 ohms (minimum).</td> </tr> <tr> <td style="padding: 5px;">Electromagnetic compatibility</td> <td style="padding: 5px;">Shall meet EN 61326-1 (1997) and AmdtA1, class A equipment/EN 50081-2 & EN 5008 1-2 & EN 50082-2</td> </tr> <tr> <td style="padding: 5px;">Mounting</td> <td style="padding: 5px;"> (i) External cage shall be provided where ever side mounting is required. External cage and other mounting accessories to be provided by the contractor. (ii) Where ever top mounting is required, all mounting accessories, stilling well (as required) etc., shall be provided by the contractor. (iii) All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations. </td> </tr> </table>		Adjustment/ calibration	Using hand held HART calibrator/ centralized PC based system (as applicable).	Zero & span adjustment	Continuous, temper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.	Display	Integral digital display.	Load Impedance	500 ohms (minimum).	Electromagnetic compatibility	Shall meet EN 61326-1 (1997) and AmdtA1, class A equipment/EN 50081-2 & EN 5008 1-2 & EN 50082-2	Mounting	(i) External cage shall be provided where ever side mounting is required. External cage and other mounting accessories to be provided by the contractor. (ii) Where ever top mounting is required, all mounting accessories, stilling well (as required) etc., shall be provided by the contractor. (iii) All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations.
	Adjustment/ calibration	Using hand held HART calibrator/ centralized PC based system (as applicable).												
	Zero & span adjustment	Continuous, temper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.												
	Display	Integral digital display.												
	Load Impedance	500 ohms (minimum).												
	Electromagnetic compatibility	Shall meet EN 61326-1 (1997) and AmdtA1, class A equipment/EN 50081-2 & EN 5008 1-2 & EN 50082-2												
	Mounting	(i) External cage shall be provided where ever side mounting is required. External cage and other mounting accessories to be provided by the contractor. (ii) Where ever top mounting is required, all mounting accessories, stilling well (as required) etc., shall be provided by the contractor. (iii) All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations.												
<p>Note: Four wire type transmitters can also be provided for applications where 2- wire transmitter has some technical limitations, subject to employer's approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC.</p>														
Ultrasonic Type level Transmitter														
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 10%;">S.No.</th> <th style="width: 40%;">Features</th> <th style="width: 50%;">Essential/Minimum requirement</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">1.</td> <td>Type of Transmitter</td> <td>Non-contact Microprocessor based 2 wire type (loop powered), HART protocol compatible Ultrasonic transmitter.</td> </tr> <tr> <td style="text-align: center;">2.</td> <td>Output signal</td> <td>4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).</td> </tr> </tbody> </table>		S.No.	Features	Essential/Minimum requirement	1.	Type of Transmitter	Non-contact Microprocessor based 2 wire type (loop powered), HART protocol compatible Ultrasonic transmitter.	2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).				
S.No.	Features	Essential/Minimum requirement												
1.	Type of Transmitter	Non-contact Microprocessor based 2 wire type (loop powered), HART protocol compatible Ultrasonic transmitter.												
2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).												
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 4 OF 46										


CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.	Accuracy	+/- 0.5% of calibrated span or minimum 5mm.		
4.	Power supply	24 V DC +/- 10%.		
5.	Temperature compensation	To be provided within transducer.		
6.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.		
7.	Adjustment/calibration/ maintenance	Using hand held HART calibrator/ centralized PC based system (as applicable).		
8.	Zero and Span adjustment	Continuous, tamper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.		
9.	Sensor Material	Corrosion resistant material to suit individual application requirement.		
10.	False signal tolerance	Transmitter shall be capable of ignoring false echoes from internal tank/sumps obstructions such as pipes, heating coils or agitator blades. Also transmitter shall have adjustable damping circuitry.		
11.	Range	Range of transmitter shall be capable of covering the complete level span of tank taking care of blocking distance, frequency attenuation due to surface, obstructions, vapors etc.		
12.	Display	Integral digital display		
13.	Diagnostics	Loss of echo alarm etc.		
14.	Load Impedance	500 ohms (minimum).		
15.	Electrical Connection	Plug and socket		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 5 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS			
2.04.00	16.	Accessories	<ul style="list-style-type: none"> • All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations. • All mounting accessories required for erection and commissioning shall be provided. • For hazardous area, explosion proof enclosure as described in NEC article 500 	
	<p>Note:</p> <p>1) Contractor can also provide Radar type transmitter as per above specification in place of ultrasonic transmitter subject to approval by Employer during detailed Engineering. Sonic frequency based transmitters can also be provided under “ultrasonic transmitters” category for fly ash silo level.</p> <p>2) Four wire type transmitters can also be provided for applications where 2- wire transmitter has some technical limitations, subject to employer’s approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC.</p> <p>3) For applications where transmitter location is not accessible, the transmitter shall have separate sensor unit and electronic unit for such applications. It shall be possible to mount the electronic unit at accessible location.</p>			
HART Hand Held calibrator		<p>Hand held calibrator shall be provided for adjustment/calibration/maintenance of the HART compatible transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided for that specific type of transmitter.</p>		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-III-C-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 6 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS					
3.00.00	Temperature Elements and accessories					
3.01.00	Thermocouple					
	<table border="0"> <thead> <tr> <th data-bbox="375 315 454 399">Sr. No.</th> <th data-bbox="457 315 860 399">Features</th> <th data-bbox="863 315 1281 399">Essential/Minimum Requirements</th> </tr> </thead> </table>	Sr. No.	Features	Essential/Minimum Requirements		
Sr. No.	Features	Essential/Minimum Requirements				
	1	Type of Thermocouple.	: 16 AWG wire of Chromel-Alumel (Type K) or 24 AWG wire Pt-Rhodium Pt (Type R) depending on operating temperature Range (ungrounded separate junction type).			
	2	No. of element	: Duplex			
	3	Housing/Head	: IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well.			
	4	Insulation and Sheathing of Thermocouple	: Swaged type mineral (magnesium oxide) insulation and SS316 sheath.			
	5	Calibration and accuracy	: As per IEC-584/ ANSI-MC-96.1 (special limits of errors/ class1) for T/C.			
	6	Accessories	: Thermo well and associated fittings			
	7	Standard	: IEC-584/ ANSI MC 96.1 for Thermocouple and ASME PTC-19.3 for Thermo-well			
3.02.00	Resistance Temperature Detector (RTD)					
	<table border="0"> <thead> <tr> <th data-bbox="375 1390 454 1474">Sr. No.</th> <th data-bbox="457 1390 860 1474">Features</th> <th data-bbox="863 1390 1281 1474">Essential/Minimum Requirements</th> </tr> </thead> </table>	Sr. No.	Features	Essential/Minimum Requirements		
Sr. No.	Features	Essential/Minimum Requirements				
	1	Type of RTD.	: Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).			
	2	No. of element	: Duplex			
	3	Housing/Head	: IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be			
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 7 OF 46			


CLAUSE NO.	TECHNICAL REQUIREMENTS		
		<p>provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well</p> <p>4 Insulation and sheathing of RTD : Mineral (magnesium oxide) insulation and SS316 sheath,</p> <p>5 Calibration and accuracy : As per IEC-751/ DIN-43760 Class-A for RTD</p> <p>6 Accessories : Thermo well and associated fittings</p> <p>7 Standard : IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.</p> <p>NOTES :</p> <p>1) The specifications for RTDs of winding/ bearings of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However the type of RTD shall be Pt100.</p> <p>2) The specifications of temp elements for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice.</p>	
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 8 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS		
<p>3.04.00</p> <p>3.05.00</p> <p>3.06.0</p>	<p>Thermo well (for all process temp. elements)</p> <p>(a) Shall be one piece solid bored type of 316 SS of step-less tapered design. (As per ASME PTC 19.3, 1974)</p> <p>(b) For Mill classifier outlet long life solid sintered tungsten carbide material of high abrasion resistance shall be provided.</p> <p>(c) For Air & Flue gas 316 SS protecting tube with welded cap. (However contractor shall provide better material for Flue gas service if required based on the specified boiler design parameters).</p> <p>(d) For furnace zone, impervious ceramic protecting tube of suitable material along with Incoloy supporting tubes and adjustable flanges.</p> <p>Not Used</p> <p>TEMPERATURE TRANSMITTER (TT)</p> <p>Following types of 2-wire (loop powered) temperature transmitter (directly powered from 4-20mA input cards of DDCMIS/PLC) shall be provided. The temperature transmitter shall be fully compatible with thermocouples and RTDs being provided by the contractor. Temperature compensation of the thermocouples shall be performed in the temperature transmitter itself.</p> <p>a. Single Input Head mounted Temperature Transmitter</p> <p>These shall be suitable for mounting in the head of temperature element itself. Temperature transmitter and associated temperature element shall be factory fitted.</p> <p>b. Single Input DIN-rail mounted Temperature Transmitter</p> <p>These shall be suitable for mounting on DIN-rails in JB's. The specifications of the JB's shall be same as indicated in Subsection INST CABLE with additional DIN-rails and IP 65 Protection class. This temperature transmitter shall be the ones which are</p>		
<p>EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p>SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p>PAGE 9 OF 46</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>especially designed for DIN-rail mounting with IP 20 protection class. These shall have terminals for input/output provided on front side when mounted on DIN-rail. Head mounted temperature transmitter with clamps to make it suitable for DIN-rail mounting shall not be acceptable under this category.</p> <p>c. Dual-input Temperature Transmitter With integral Indicator:</p> <p>These shall be suitable for mounting on pipes/ support. Both elements of the duplex thermocouple/ RTD shall be wired to a single transmitter. Integral indicator shall be provided with these transmitters. These transmitters shall have bump less change over facility to second sensor in case first sensor fails .This change-over is to be alarmed. Protection class shall be IP65 minimum.</p> <p>d. Common requirements for each of the above type of temperature transmitters.</p> <p>Output : 2-wire (power supply from input card of Control System) with 4-20mA output with superimposed HART protocol signal.</p> <p>Input : Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K & R types (input type to be selectable at site through HART terminal).</p> <p>Isolation : Min. 500 V AC.</p> <p>EMC compatibility : As per EN 61326.</p> <p>Operating ambient temperature : 0 to 85 deg C (without indicator). 0 to 70 deg C (with indicator).</p> <p>Power supply : 24V DC +/- 10%.</p> <p>Accessories : Mounting arrangements including clamps etc.</p> <p>Composite Accuracy (i) For head mounted and DIN-rail mounted types: (Refer note 2) RTD =<0.4% of 0-250 deg C span T/C-K type =<0.4% of 0-600 deg C span T/C-R type =<0.4% of 0-1000 deg C span CJC accuracy (for thermocouples) shall be =< 1 deg C</p> <p>(ii) For dual-input type: RTD =<0.25% of 0-250 deg C span T/C-K type =<0.2% of 0-600 deg C span CJC accuracy (for thermocouples) shall be =< 1 deg C</p> <p>e. Field bus compatible temperature transmitters</p> <p>Temperature transmitters of this category shall be field mounting type & shall be capable of withstanding operating ambient temperature upto 85 deg C. These modules shall be connected to DDCMIS through field bus such as Profibus, Foundation Field bus etc directly from the transmitter. Maximum Number of inputs per such temperature transmitter shall be eight. These shall be mounted in cabinets/enclosures/JBs in non-AC areas.</p>		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 10 OF 46</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>As an alternate, these signals from temperature transmitters can be connected to DDCMIS through standard remote I/O modules of the DCS, in which case, the temperature transmitter signals will be acquired through 4-20mA input modules in the remote I/O cabinet for connecting to DDCMIS through remote I/O bus.</p> <p>Air conditioned panel shall be provided for remote I/O.</p> <p>Notes (Common for a) to d) above):-</p> <ol style="list-style-type: none"> 1. In case of failure (open or burn-out) of RTD/thermocouple, temp. Transmitter shall provide low temperature output. 2. Composite Accuracy is to be calculated as summation of all applicable accuracies of temp transmitter, for converting sensor input to output in 4-20 mA (e.g., basic accuracy, digital accuracy, D/A accuracy, etc.) and temperature effect on these accuracies at ambient temperature of 50 deg C, based on the figure/ formula given in the standard product catalogue for span as specified above for various types of Temperature Elements specified. All such accuracy/ temp effect figures in catalogue shall be first converted to deg C, and then percentage of this converted accuracy in specified span shall be calculated to compare with the specified composite accuracy figures. All temperature transmitters are to be interchangeable (i.e. can be used for either RTD or thermocouple) and composite accuracy shall be met for each type of input specified in (i) & (ii). 		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-III-C-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 11 OF 46</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS																																																														
8.00.00	<p data-bbox="396 428 570 455">E-P Converter</p> <p data-bbox="396 476 1398 537">E-P converters and associated accessories shall be furnished in accordance with the specifications given below :</p> <p data-bbox="396 569 781 596">A. Fail Freeze Type E/P convertes</p> <table border="1" data-bbox="412 613 1357 1528"> <tbody> <tr> <td>1</td> <td>Air supply Pressure</td> <td>:</td> <td>2 kg/sq. cm.</td> </tr> <tr> <td>2</td> <td>Input signal</td> <td>:</td> <td>4-20mA DC</td> </tr> <tr> <td>3</td> <td>Output signal</td> <td>:</td> <td>0.2 to 1.0 kg/sq. cm</td> </tr> <tr> <td>4</td> <td>Linearity</td> <td>:</td> <td>0.5% of span or better.</td> </tr> <tr> <td>5</td> <td>Span/Zero Adjustment</td> <td>:</td> <td>To be provided</td> </tr> <tr> <td>6</td> <td>Hysteresis</td> <td>:</td> <td>0.5% of span or better.</td> </tr> <tr> <td>7</td> <td>Fail Freeze Feature</td> <td>:</td> <td>Stay put at last position on failure of 4 –20mA signal.</td> </tr> <tr> <td>8</td> <td>Allowable drift rate</td> <td>:</td> <td>Maximum 2% set point/ hour.</td> </tr> <tr> <td>9</td> <td>Ambient Temperature Effect</td> <td>:</td> <td>less than 0.02% of span per deg C between -</td> </tr> <tr> <td>10</td> <td>Mounting</td> <td>:</td> <td>Surface/Pipe/Bracket Mounting.</td> </tr> <tr> <td>11</td> <td>Protection class</td> <td>:</td> <td>IP 65.</td> </tr> <tr> <td>12</td> <td>Connection Port Sizes</td> <td>:</td> <td>¼ inch NPT (F)</td> </tr> <tr> <td>13</td> <td>Electrical Cable Entry</td> <td>:</td> <td>½ inch NPT</td> </tr> <tr> <td>14</td> <td>Output Pressure Gauge</td> <td>:</td> <td>1/4 inch NPT connection, 2 inch dial.</td> </tr> <tr> <td>15</td> <td>Accessories</td> <td>:</td> <td>All accessories like mounting brackets, fittings etc. required for installation is to be supplied.</td> </tr> </tbody> </table>			1	Air supply Pressure	:	2 kg/sq. cm.	2	Input signal	:	4-20mA DC	3	Output signal	:	0.2 to 1.0 kg/sq. cm	4	Linearity	:	0.5% of span or better.	5	Span/Zero Adjustment	:	To be provided	6	Hysteresis	:	0.5% of span or better.	7	Fail Freeze Feature	:	Stay put at last position on failure of 4 –20mA signal.	8	Allowable drift rate	:	Maximum 2% set point/ hour.	9	Ambient Temperature Effect	:	less than 0.02% of span per deg C between -	10	Mounting	:	Surface/Pipe/Bracket Mounting.	11	Protection class	:	IP 65.	12	Connection Port Sizes	:	¼ inch NPT (F)	13	Electrical Cable Entry	:	½ inch NPT	14	Output Pressure Gauge	:	1/4 inch NPT connection, 2 inch dial.	15	Accessories	:	All accessories like mounting brackets, fittings etc. required for installation is to be supplied.
1	Air supply Pressure	:	2 kg/sq. cm.																																																												
2	Input signal	:	4-20mA DC																																																												
3	Output signal	:	0.2 to 1.0 kg/sq. cm																																																												
4	Linearity	:	0.5% of span or better.																																																												
5	Span/Zero Adjustment	:	To be provided																																																												
6	Hysteresis	:	0.5% of span or better.																																																												
7	Fail Freeze Feature	:	Stay put at last position on failure of 4 –20mA signal.																																																												
8	Allowable drift rate	:	Maximum 2% set point/ hour.																																																												
9	Ambient Temperature Effect	:	less than 0.02% of span per deg C between -																																																												
10	Mounting	:	Surface/Pipe/Bracket Mounting.																																																												
11	Protection class	:	IP 65.																																																												
12	Connection Port Sizes	:	¼ inch NPT (F)																																																												
13	Electrical Cable Entry	:	½ inch NPT																																																												
14	Output Pressure Gauge	:	1/4 inch NPT connection, 2 inch dial.																																																												
15	Accessories	:	All accessories like mounting brackets, fittings etc. required for installation is to be supplied.																																																												
<p data-bbox="245 1856 602 1948">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p data-bbox="672 1856 964 1934">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p data-bbox="1008 1856 1279 1927">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p data-bbox="1305 1856 1403 1906">PAGE 23 OF 46</p>																																																												


CLAUSE NO.	TECHNICAL REQUIREMENTS		
B. Fail Safe type E/P converters			
1	Air supply Pressure	:	2 kg/sq. cm.
2	Input signal	:	4-20mA DC
3	Output signal	:	0.2 to 1.0 kg/sq. cm
4	Linearity	:	0.5% of span or better.
5	Span/Zero Adjustment	:	To be provided.
6	Hysteresis	:	0.5% of span or better.
7	Fail Safe Feature	:	Output shall drive to minimum on failure of either 4-20mA signal or air supply.
8	Mounting	:	Surface/Pipe/Bracket Mounting.
9	Ambient Temperature Effect	:	less than 0.02% of span per deg C between -20 to +60 deg C.
10	Protection class	:	IP 65.
11	Connection Port Sizes	:	¼ inch NPT (F)
12	Electrical Cable Entry	:	½ inch NPT
13	Output Pressure Gauge	:	1/4 inch NPT connection, 2 inch dial.
14	Accessories	:	All accessories like mounting brackets, fittings etc. required for installation is to be supplied.
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 24 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>Power Supply 230 VAC or 24VDC operated</p> <p>Process Temperature range 0-200 degree Celsius</p> <p>Others Drain / purging arrangement shall be provided as per standard practice.</p> <p>Viscosity range of Fluid 0-500cst for HFO</p> <p>The offered Coriolis type flow transmitter shall be suitable for intended application. Contractor shall submit flow and sizing calculation for Employer's approval. For each type of Coriolis type flow transmitter general arrangement and assembly drawing and cable wiring diagram shall be submitted for Employer's approval.</p>		
13.00.00	SPECIFICATION FOR FLOW ELEMENTS		
13.01.00	<p>Orifice Plate</p> <p>Features Essential/Minimum Requirements</p> <p>Type Concentric as per ASME PTC-19.5 (Part-II), ISA RP-3.2, 1960 or BS-1042, ISO 5167</p> <p>Material 316 SS</p> <p>Thickness 3 mm for main pipe diameter up to 300 mm and 6 mm for main pipe dia above 300 mm.</p> <p>Material of branch pipe Same as main pipe</p> <p>Root valve type Globe</p> <p>Root valve material Same as pipe material</p> <p>Root valve size 1 / 2 inch or 1 inch (as applicable)</p> <p>Impulse pipe of same material up to root valve Required</p> <p>Tappings Flanged weld neck or D & D/2 with 3 pairs of tapping (as applicable). Root valves to be provided in all the tappings.</p> <p>Beta Ratio 0.34 to 0.7</p> <p>Beta Ratio calculation to be submitted Yes</p> <p>Assembly drg. and flow Vs DP Curves Yes</p> <p>Accessories Root valves, flanges, Vent/drain hole(As required)</p> <p>Contractor shall submit certified flow calculation and differential pressure vs. flow curves for each element for Employer's approval. Sizing calculation, precise flow calculation for all the flow elements, fabrication and assembly drawings and installation drawings shall be submitted for Employer's approval.</p>		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-III-C-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 35 OF 46</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS			
15.00.00	PROCESS ACTUATED SWITCHES			
	FEATURES	ESSENTIAL / MINIMUM REQUIREMENTS		
		Pressure/ Draft Switches/ DP Switches	Temperature switches	Level switches
	Sensing Element	Piston actuated for high pressure and diaphragm or bellows for low pr./ vacuum	Vapor pressure sensing, liquid filled bellow type with SS bulb and capillary (5 m minimum, to suit application)	Capacitance types, float type, conductivity type, RF type, Ultrasonic type as per suitability to the application. .
	Material	316 SS	Bulb 316 SS/ capillary 304 SS	316 SS
	End connection	½ inch NPT (F)	½ inch NPT (F)	Manufacturer standard
	Over range/ proof pressure	150% of maximum operating pr.	-	150% of maximum operating pr.
	Repeatability	+/- 0.5% of full range		
	No. of contacts	2 No.+2NC. SPDT snap action dry contact		
	Rating of contacts	60 V DC, 6 VA (or more if required by DDCMIS)		
	Elect. Connection	Plug in socket.		
	Set point adjustment	Provided over full range.		
	Dead band adjustment	Adjustable/ fixed as per requirement of application.		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 38 OF 46


CLAUSE NO.	TECHNICAL REQUIREMENTS			
	Enclosure	Weather and dust proof as per IP-55, metallic housing.		
	Accessories	Siphon, snubber, chemical seal, pulsation dampeners as required by process	Thermo well of 316 SS and packing glands	All mounting accessories
	Mounting	Suitable for enclosure/ rack mounting or direct mounting	Suitable for rack mounting or direct mounting	-
	Power Supply (wherever required)	As per Contractor's Standard practice.		
	<p>Notes :-</p> <ol style="list-style-type: none"> 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. 			
16.00.00	NOT USED			
17.00.00	SOLENOID VALVES			
	<p>Solenoid valves shall fulfil the following requirements:</p> <ol style="list-style-type: none"> a. Type 2/3/4 way SS 316/Forged Brass (depending on the application subject to Employer's approval during detailed Engg.) b. Power supply : 24 V DC \pm 10%. c. Plug and socket electrical connection. d. Insulation : Class 'H' 			
18.00.00	REVERSE ROTATION INDICATOR (RRI)			
	Reverse rotation indicator comprising of proximity sensors, processing electronics with output of 4-20mA (corresponding to speed) interconnecting cables, speed display in rpm,			
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)	PAGE 39 OF 46	


CLAUSE NO.	TECHNICAL REQUIREMENTS			
	<p>normal, reverse indication and required channel alarm contact shall be provided. The contact rating shall be 60VDC, 6VA (or more if required by Control system). The exact details of the RRI shall be strictly as approved by Employer during detailed engineering. The power supply of RRI is to be arranged by the Bidder</p>			
19.03.00	<p>All the outdoor field instruments such as analysers/transmitters/meters etc. shall be provided with suitable Free standing cabinet(s)/panel/rack so that the equipments are protected against rain/ sunlight etc.</p>			
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 40 OF 46</p>	

CLAUSE NO.	TECHNICAL REQUIREMENTS																							
19.04.00	<p>Parshall Flume</p> <p>The Bidder shall provide all the control and Instrument devices including primary sensors, transmitters, flow indicator cum integrator / totaliser and shall include all required accessories for the flow measurement of raw water through the clarifier. The system shall be of reputed make and acceptable to the owner.</p> <p>Level measurement shall be based on ultrasonic/radon technology. The flow compensation is to be implemented in the transmitter itself. The transmitter shall provide 4-20 mA DC in direct proportion to flow and shall be able to drive a load impedance of 500 ohms minimum</p> <p>Accuracy shall be +/- 1 % or better.</p> <p>All the mounting hardware and accessories required for erection and commissioning of the same are to be provided by the contractor. Mounting fittings material shall be SS316. All weather canopy is to be provided for electronics/sensor to protect the same from rain/sunlight etc.</p> <p>The Type makes and models no. shall be subject to Owner's approval.</p>																							
19.05.00	<p>Electronic Flow-Meter</p> <p>The electronic flow meter shall include flow sensor and flow indicator cum integrator / totaliser and shall include all required accessories for satisfactory operation. The flow meter shall be based on full bore electromagnetic principle and shall be electronic type of proven design, make and model acceptable to the owner.</p> <p>The Bidder shall submit all necessary technical literature and details of selection criteria of the instrument offered to substantiate the model selected. The Bidder shall also furnish list of similar installation along with feed back on satisfactory performance of the instruments.</p> <p>The flow meter shall meet or exceed the following requirement :</p> <table border="0" data-bbox="397 1060 1414 1381"> <tr> <td>(a) Output</td> <td>:</td> <td>4-20 mA DC Isolated output</td> </tr> <tr> <td>(b) Accuracy</td> <td>:</td> <td>± 0.5% of calibrated span or better *</td> </tr> <tr> <td>(c) Repeatability</td> <td>:</td> <td>± 0.2% of calibrated span or better</td> </tr> <tr> <td>(d) Power Supply</td> <td>:</td> <td>240V AC ± 10%, 50 HZ ± 5%/ 24 V DC, to be arranged by the contractor.</td> </tr> <tr> <td>(f) Protection class</td> <td>:</td> <td>IP-55</td> </tr> <tr> <td>(e) Flow tube</td> <td>:</td> <td>SS304</td> </tr> <tr> <td>(f) liner</td> <td>:</td> <td>Hard Rubber</td> </tr> </table> <p>The flow meter shall provide local indication for instantaneous flow. It should also be possible to get local display for daily and monthly discharge. The flow meter shall indicate totaliser/ integrator to get the daily and monthly discharge as stated above.</p>	(a) Output	:	4-20 mA DC Isolated output	(b) Accuracy	:	± 0.5% of calibrated span or better *	(c) Repeatability	:	± 0.2% of calibrated span or better	(d) Power Supply	:	240V AC ± 10%, 50 HZ ± 5%/ 24 V DC, to be arranged by the contractor.	(f) Protection class	:	IP-55	(e) Flow tube	:	SS304	(f) liner	:	Hard Rubber		
(a) Output	:	4-20 mA DC Isolated output																						
(b) Accuracy	:	± 0.5% of calibrated span or better *																						
(c) Repeatability	:	± 0.2% of calibrated span or better																						
(d) Power Supply	:	240V AC ± 10%, 50 HZ ± 5%/ 24 V DC, to be arranged by the contractor.																						
(f) Protection class	:	IP-55																						
(e) Flow tube	:	SS304																						
(f) liner	:	Hard Rubber																						
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 41 OF 46</p>																					

CLAUSE NO.	TECHNICAL REQUIREMENTS			
21.00.00	<p>Limit switches</p> <p>For offsite plant application Limit switches shall be gold plated with high conductivity and non corrosive type. Contact rating shall be sufficient to meet the requirement of DDCMIS subject to a minimum of 60 V, 6 VA rating. Protection class shall be IP 55.</p> <p>For main plant application limit switches are to be provided as per contractor standard and proven practice.</p>			
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-04 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)</p>	<p align="center">PAGE 42 OF 46</p>	


CLAUSE NO.	<div style="text-align: center;">  TECHNICAL REQUIREMENTS </div>		
CONTROL VALVES, ACTUATORS & ACCESSORIES			
1.00.00	CONTROL VALVES, ACTUATORS & ACCESSORIES		
1.01.00	General Requirements		
1.01.01	The control valves and accessories equipment furnished by the Bidder shall be designed, constructed and tested in accordance with the latest applicable requirements of code for pressure piping ANSI B 31.1, the ASME Boiler & pressure vessel code, Indian Boiler Regulation (IBR), ISA, and other standards specified elsewhere as well as in accordance with all applicable requirements of the "Federal Occupational Safety and Health Standards, USA" or acceptable equal standards. All the Control Valves, their actuators and accessories to be furnished under this Sub-section will be fully suitable and compatible with the modulating loops covered under the Specification.		
1.01.02	All the control valves and accessories offered by the Bidder shall be from reputed, experienced manufacturers of specified type and range of valves.		
1.01.03	For special type of control valves such as combined pressure and temperature control valves for Aux PRDS application, separator drain control valves, refer to the corresponding mechanical sections.		
1.01.04	Specification for control valves in this Sub-section has to be read in conjunction with other relevant Sub-sections of this specification.		
1.02.00	CONTROL VALVE SIZING & CONSTRUCTION		
1.02.01	The design of all valve bodies shall meet the specification requirements and shall conform to the requirements of ANSI (USA) for dimensions, material thickness and material specification for their respective pressure classes.		
1.02.02	The valve sizing shall be suitable for obtaining maximum flow conditions with valve opening at approximately 80% of total valve stem travel and minimum flow conditions with valve stem travel not less than 10% of total valve stem travel. All the valves shall be capable of handling at least 120% of the required maximum flow. Further, the valve stem travel range from minimum flow condition to maximum flow condition shall not be less than 50% of the total valve stem travel. The sizing shall be in accordance with the latest edition of ISA handbook on control valves. While deciding the size of valves, Bidder shall ensure that valves outlet velocity as defined in ISA handbook does not exceed 8 m/sec for liquid services, 150 m/sec. for steam services and 50% of sonic velocity for flashing services. Bidder shall furnish the sizing calculations clearly indicating the outlet velocity achieved with the valve size selected by him as well as noise calculations, which will be subject to Employer's approval during detailed engineering.		
1.02.03	Control valves for steam and water applications shall be designed to prevent cavitation, wire drawing, flashing on the downstream side of valve and down stream piping. Thus for cavitation/flashing service, only valve with anti cavitation trim shall be provided. Detailed calculations to establish whether cavitation will occur or not for any given application shall be furnished.		
1.02.04	Control valves for application such as SH Spray Control, RH spray Control, Heavy Oil Heating, pressurizing and Control system, HP/LP heater Emergency level control, Emergency Make-up to condenser hotwell, GSC minimum flow, Deaerator Drain to Condenser Hotwell, Condensate spill to condensate reserve tank, condenser normal make-up and valve gland sealing supplying pressure control, CEPS minimum flow control, BFP circulation control valve shall have permissible leakage rate as per leakage Class V. All other control valves shall have leakage rate as per leakage Class-IV as per ANSI / FCI /70.2,2006 or equivalent.		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES	PAGE 1 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS															
1.02.05	The control valve induced noise shall be limited to 85 dBA at 1 meter from the valve surface under actual operating conditions. The noise abatement shall be achieved by valve body and trim design and not by use of silencers except for few cases as per contractor's standard and proven practice subject to employer's approval.															
1.02.06	Control valves for steam and water application shall be provided with rangability of 30:1 for all services except for applications wherein control valves are envisaged to be operated in lower range like Reheater spray and superheater spray system wherein control valve with rangability of 50:1 shall be provided															
2.00.00	VALVE CONSTRUCTION															
2.01.00	All valves shall be of globe body design & straightaway pattern with single or double port, unless other wise specified or recommended by the manufacturer to be of angle body type. Rotary valve may alternatively be offered when pressure and pressure drops permit.															
2.02.00	Valves with high lift cage guided plugs & quick-change trims shall be supplied.															
2.03.00	Cast Iron valves are not acceptable.															
2.04.00	Bonnet joints for all control valves shall be of the flanged and bolted type or other construction acceptable to the Employer. Bonnet joints of the internal threaded or union type will not be acceptable.															
2.05.00	Plug shall be of one-piece construction cast, forged or machined from solid bar stock. Plug shall be screwed and pinned to valve stems or shall be integral with the valve stems.															
2.06.00	All valves connected to vacuum on down stream side shall be provided with packing suitable for vacuum applications (e.g. double vee type chevron packing)															
2.07.00	Valve characteristic shall match with the process characteristics.															
2.08.00	Extension bonnets shall be provided when the maximum temperature of flowing fluid is greater than 280 deg. C.															
2.09.00	Flanged valves shall be rated at no less then ANSI press class of 300 lbs.															
3.00.00	VALVE MATERIALS															
	<table border="1"> <thead> <tr> <th data-bbox="391 1165 446 1228">Sr. No.</th> <th data-bbox="472 1165 576 1197">Service</th> <th data-bbox="673 1165 852 1197">Body material</th> <th data-bbox="1063 1165 1226 1197">Trim Material</th> </tr> </thead> <tbody> <tr> <td data-bbox="391 1249 414 1281">1</td> <td data-bbox="472 1249 657 1428">Non-corrosive, non-flashing and non-cavitation service except DM water</td> <td data-bbox="673 1249 1047 1491">Carbon steel ASTM-A216 Gr. WCB for design fluid temperature below 275 Deg. C Alloy steel ASTM-A217Gr. WC6 for design fluid temperature above 275 Deg. C and upto 400 Deg. C Alloy steel ASTM-A217Gr. WC9 for design fluid temperature above 400 Deg. C</td> <td data-bbox="1063 1249 1404 1344">316SS stellited with stellited faced guide posts and bushings.</td> </tr> <tr> <td data-bbox="391 1617 414 1648">2.</td> <td data-bbox="472 1617 657 1701">Severe flashing/cavitation on services</td> <td data-bbox="673 1617 1047 1648">Alloy steel ASTM-A217 Gr. WC9</td> <td data-bbox="1063 1617 1144 1648">440 C</td> </tr> </tbody> </table>	Sr. No.	Service	Body material	Trim Material	1	Non-corrosive, non-flashing and non-cavitation service except DM water	Carbon steel ASTM-A216 Gr. WCB for design fluid temperature below 275 Deg. C Alloy steel ASTM-A217Gr. WC6 for design fluid temperature above 275 Deg. C and upto 400 Deg. C Alloy steel ASTM-A217Gr. WC9 for design fluid temperature above 400 Deg. C	316SS stellited with stellited faced guide posts and bushings.	2.	Severe flashing/cavitation on services	Alloy steel ASTM-A217 Gr. WC9	440 C			
Sr. No.	Service	Body material	Trim Material													
1	Non-corrosive, non-flashing and non-cavitation service except DM water	Carbon steel ASTM-A216 Gr. WCB for design fluid temperature below 275 Deg. C Alloy steel ASTM-A217Gr. WC6 for design fluid temperature above 275 Deg. C and upto 400 Deg. C Alloy steel ASTM-A217Gr. WC9 for design fluid temperature above 400 Deg. C	316SS stellited with stellited faced guide posts and bushings.													
2.	Severe flashing/cavitation on services	Alloy steel ASTM-A217 Gr. WC9	440 C													
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2</p>	<p align="center">SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES</p>	<p align="center">PAGE 2 OF 6</p>													

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
<p>4.00.00</p> <p>5.00.00</p>	<p>3. Low flashing/cavitation on service Alloy steel ASTM-A217 Gr. WC6 17-4 PH SS</p> <p>4. DM water service 316 SS 316 SS</p> <p>NOTE: (a) Valve body rating shall meet the process pressure and temperature requirement as per ANSI B16.34.</p> <p>(b) Severe flashing / cavitation services includes as a minimum all control valves whose downstream piping is connected to condenser or flash tank.</p> <p>However, Bidder may offer valves with body and trim materials better than specified materials and in such cases Bidder shall furnish the comparison of properties including cavitation resistance, hardness, tensile strength, strain energy, corrosion resistance and erosion resistance etc. of the offered material vis-a-vis the specified material for Employer's consideration and approval.</p> <p>Contractor shall ensure that all required measures like proper selection of anti-corrosive/erosive material along with durable epoxy coating with polyurethane finish shall be provided for all the C&I equipment/ devices being supplied in this contract, which are mounted in non-AC areas (prone to sea water environment corrosion / erosion) like measuring instruments, control valves & actuators, JBs, LIEs / LIRs, impulse pipes, sample pipes, fittings, conduits, cable trays and accessories, local control panels, erection hardware items etc. Contractor shall furnish their comprehensive proposal regarding the anti-corrosion/ erosion measures for protection against sea water environment which shall be finalized during detailed engineering subject to Employer's approval.</p> <p>4.00.00 END PREPARATION</p> <p>Valve body ends shall be either butt welded/socket welded, flanged (Rubber lined for condensate service) or screwed as finalized during detailed engineering and as per Employer's approval. The welded ends wherever required shall be butt welded type as per ANSI B 16.25 for control valves of sizes 65 mm and above. For valves size 50 mm and below welded ends shall be socket welded as per ANSI B 16.11. Flanged ends wherever required shall be of ANSI pressure-temperature class equal to or greater than that of the control valve body.</p> <p>5.00.00 VALVE ACTUATORS</p> <p>All control valves shall be furnished with pneumatic actuators except for pressure and temperature control valve for auxiliary PRDS application (electro-hydraulic / pneumatically operated) and separator drain control valve (electro-hydraulic type).The Bidder shall be responsible for proper selection and sizing of valve actuators in accordance with the pressure drop and maximum shut off pressure and leakage class requirements. The valve actuators shall be capable of operating at 60 deg.C continuously.</p> <p>Valve actuators and stems shall be adequate to handle the unbalanced forces occurring under the specified flow conditions or the maximum differential pressure specified. An adequate allowance for stem force, at least 0.15 Kg/sq.cm. per linear millimeter of seating surface, shall be provided in the selection of the actuator to ensure tight seating unless otherwise specified.</p> <p>The travel time of the pneumatic actuators shall not exceed 10 seconds.</p>		
<p>EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)</p>	<p>TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2</p>	<p>SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES</p>	<p>PAGE 3 OF 6</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS		
6.00.00	CONTROL VALVE ACCESSORY DEVICES		
6.01.00	All pneumatic actuated control valve accessories such as air locks, hand wheels/hand-jacks, limit switches, microprocessor based electronic Positioner, diffusers, external volume chambers, position transmitters (capacitance or resistance type only), reversible pilot for Positioner, tubing and air sets, solenoid valves and junction boxes etc. shall be provided as per the requirements.		
7.00.00	SPECIFICATIONS FOR MICROPROCESSOR BASED ELECTRONIC POSITIONER		
1	Electrical	a) Input Demand Signal	4-20 mA
		b) Power Supply	Loop Powered from the output card of Control System.
		c) HART Protocol	Compatibility for Remote Calibration & Diagnostics (Super-imposed HART signal on input Signal (4-20 mA))
		d. Valve position sensing	Position sensing, 4-20 mA output signal to be provided for control system.
2	Environment	a) Operating temp.	(-)30 To 80 Deg. C
		b) Humidity	0-95 %
		c) Protection class	IP-65 Minimum
3	Software for Configuration and Diagnostics	Software	Software shall meet the requirements for Configuration, Diagnostics, Calibration and Testing of the actuator.
		Diagnostic/Test features	Advanced diagnostic features like Stroke counter or Travel counter, Leakage in actuators, Valve Signature analysis, Step Response test, Valve friction /Jamming detection etc to be provided.
4	Test reports/ Certificates	Factory Valve Signature Tests Reports (Pr Vs Valve travel and Travel Vs I/P signal) are to be provided.	
		Test certificates as per Manufacture Standard/Relevant Standard are to be submitted.	
5	Configuration/ Calibration.	Remote & Local Calibration, Auto & Manual Calibration shall be possible.	
6	Operating Range	Full range/ Split range.	
7	Modes	Valve Action	Direct / Reverse Valve Action
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES
PAGE 4 OF 6			

CLAUSE NO.	TECHNICAL REQUIREMENTS		
		Flow Characterization	Possible to fit Valve Characteristic Curves-Linear , Equal percentage etc.
8	Fail Safe/Fail Freeze	Fail Safe/Fail Freeze feature is to be provided. (In case the fail freeze feature is not intrinsic to the positioner, Bidder shall achieve the same externally through solenoid valve connected in the pneumatic circuit).	
9	Pneumatic	Air capacity	Sufficient to handle the valves & actuators selected/ Boosters to be supplied, if required.
		Air pressure	To suit the air supply pressure/quality available.
		Process connection	1/4" NPT
10	Performance	Characteristic deviation	<=0.5 % of span.
		Ambient temp effect	<=0.01 %/ deg C or better.
10	EMC & CE Compliance	Required to International Standard like EN/IEC.	EN50081-2 & EN50082 or equivalent.
11	Accessories	In-built Operator Panel	Display with push buttons for configuration and display on the positioner itself (Password protected/Hardware lock).
		Hand Held Hart Calibrator	Universal Hart Calibrator to be provided (for quantity, refer Part-A: Contract quantities of the specification).
		Press Gauge Block	For supply & output pressures, Air Filter Regulator and other accessories shall be provided on as required basis for making system complete.
		Electrical Cable Entry	1/2"NPT, side or bottom entry to avoid water
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES PAGE 5 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS			
			ingress.	
		Valves Mounting Assembly	For Sliding Stem/Rotary/Single acting/Double acting actuators on as required basis	
8.00.00	<p>* Note:</p> <p>The HART signals shall be picked up from marshalling terminals of DDCMIS (SG/TG DDCMIS as well as BOP DDCMIS), as applicable. The details of the above mentioned HART management system specification are mentioned in HART system (Annexure IIIC-02C to DDCMIS).</p> <p>The positioners shall be monitored from this HART management system .To achieve this, Bidder shall provide the necessary software to achieve the functionalities described above under " Software for Configuration and Diagnostics", and this software shall be loaded in the HART management system.</p> <p>TEST AND EXAMINATION</p> <p>All valves shall be tested in accordance with the quality assurance programme agreed between the Employer and Contractor, which shall meet the requirements of IBR and other applicable codes mentioned elsewhere in the specifications. The tests shall include but not be limited to the following:</p> <p>8.01.00 Non Destructive Test as per ANSI B-16.34.</p> <p>8.02.00 Hydrostatic shell test in accordance with ANSI B 16.34 prior to seat leakage test.</p> <p>8.03.00 Valve closure test and seat leakage test in accordance with ANSI-B 16.34/ FCI 70.2 standard and as per the leakage class indicated above</p> <p>8.04.00 Functional Test: The fully assembled valves including actuators control devices and accessories shall be functionally tested to demonstrate times from open to close position.</p> <p>8.05.00 CV Test: Please refer CI No. 1.00.00 & 3.00.00 OF Sub-section- IIIC-10 (Type test requirements), Control Valves.</p> <p>Bidder shall furnish all the control valves under this main plant package as finalized during detailed engineering stage without any price repercussions whatsoever depending on the process requirements. All the control valves provided by the Bidder for this project shall meet the specifications requirements specified herein. Specification for control valves in this Sub-section has to be read in conjunction with other relevant Sub-sections of this specification.</p>			
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I (3X 800MW)	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS:9585-001-2	SUB-SECTION-IIIC-08 CONTROL VALVES, ACTUATORS & ACCESSORIES	PAGE 6 OF 6	





SUB-SECTION – B-23


VFD


EPC PACKAGE FOR
PATRATU SUPER THERMAL POWER STATION EXPANSION
PHASE –I (3X 800MW)


TECHNICAL SPECIFICATION
SECTION – VI, PART-B
BID DOC NO. : CS-9585-001-2


CLAUSE NO.	TECHNICAL REQUIREMENTS		
1.00.00	<p>CODES AND STANDARDS</p> <p>DC Reactor IEC: 60289</p> <p>Motor IS: 4722/IS: 325/IEC: 60034/NEMA 30 & 31</p> <p>Transformer IEC: 60076/IS: 2026, IEC: 61378</p> <p>Dry transformer IS: 11171</p> <p>VFD IEC: 60034/ IEC: 61800</p> <p>Harmonics & EM compatibility IEEE: 519/IEC: 61000</p> <p>Contactors/Switches/Fuses etc. IEC: 60947, IS: 13947</p>		
2.00.00	<p>OPERATING CONDITIONS</p> <p>2.01.00 For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% shall be considered.</p> <p>2.02.00 All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.</p> <p>2.03.00 All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.</p> <p>2.04.00 The auxiliary AC voltage supply arrangement shall have 11/6.6/3.3kV and 415V systems (as applicable). It shall be designed to limit voltage variations as given below under worst operating condition:</p> <ol style="list-style-type: none"> 1. 11kV/ 3.3 kV/ 6.6 KV : +/- 6% 2. 415V : +/- 10% <p>Note: The Voltage level mentioned above is the Nominal Voltage available at the input of the VFD System from the MCC/ Switchgear/transformer, based on the system requirement/Availability.</p> <p>The voltage level for the VFD shall be as follows:-</p> <ol style="list-style-type: none"> 1. Upto 400 kW : 415V/690V, Low Voltage, Three Phase AC 2. Above 400kW and upto 700 KW : 690V, Low Voltage, Three Phase AC 3. Above 700KW and upto 1500 KW : Medium Voltage, Three Phase AC <p>Note: The voltage level mentioned above is the Nominal Voltage which is fed to the motor from the VFD.</p> <p>From here onwards in the specifications all the VFD Systems consisting of either 415 V or 690 V may be termed as LV VFD while the higher rated VFD System shall be termed as MV VFD. If nothing is mentioned than the Clause is applicable for both the LV and the MV VFD until deliberated otherwise.</p> <p>2.05.00 For Power Cables & Control Cables, please refer technical specification given elsewhere in the document.</p>		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 1 OF 10</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
3.00.00	SYSTEM DESCRIPTION		
3.01.00	<p>The VFD System shall include the following equipment for each drive.</p> <ol style="list-style-type: none"> Power/control panels consisting of line converters, inverters and control system for drive including complete control & protection of drive and the motor. VFD transformer on the source side, as per system requirement. Breaker/Contactor on the VFD/Motor/Transformer/CT/PT/Meters/Bypass (if applicable) side with complete Control, Protection and Diagnostics features of the VFD, as per system requirement. Bypass Arrangement of the VFD system if specified. DC air core reactor or capacitor, as per the system requirement. Inverter Duty Motor suitable for VFD application Power & control cables and cabling as required under the scope of supply in the technical specifications. 		
4.00.00	GENERAL REQUIREMENTS		
4.01.00	<p>Medium Voltage VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum eighteen (18) pulse design.</p>		
4.02.00	<p>415 V/690 V LV VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum Twelve (12) pulse design. For drives less than 100 KW Six (6) pulse can be offered meeting all other requirements.</p>		
4.03.00	<p>The system shall be fully digital, PLC/Microprocessor based, energy efficient, and shall provide very high reliability, high power factor, low harmonic distortion and low vibration and wear and noise. It shall be easy to install in minimum time and expense and no special tools shall be required for routine maintenance.</p>		
4.04.00	<p>The offered equipment shall be with state of art technology and proven field track record. No prototype equipment shall be offered.</p>		
4.05.00	<p>The VFD model offered shall be from the existing VFD model series in the regular manufacturing range of the manufacturer. Along with the offer the Vendor shall submit the supply record and satisfactory performance record for 2 (two) years running of the offered VFD supplied in India or abroad.</p>		
4.06.00	<p>The VFD manufacturer shall ensure the proper coordination of their VFD with the Driven Motor and the Employer's system. All the Motors which are to be driven by VFDs will be of Inverter duty type. The VFD operation shall have no inherent detrimental impact on the Motors/ cables & employer's system.</p>		
4.07.00	<p>Vendor shall ensure availability of spare parts and maintenance support services for the offered equipment for at least for 15 years from the date of supply. After this period, if vendor</p>		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 2 OF 10</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>discontinues the production of spare parts, vendor shall give at least twelve (12) months' notice prior to such discontinuation so that owner may order his requirements of spares in one lot. The offered VFD manufacturer should have their maintenance service & spares supply network in India to provide quick maintenance service & Spares supply support. The vendor shall indicate the source for supply of spares & Maintenance service location in India.</p>		
5.00.00	TECHNICAL AND OPERATIONAL REQUIREMENTS		
5.01.00	The system shall be designed to deliver the motor input current and torque for the complete speed torque characteristics of the driven equipment, with maximum input supply voltage and frequency variation. The system shall be suitable for the load characteristics and the operational duty of the driven equipment.		
5.02.00	The overload capacity of the controller shall be 150% of the rated current of the motor for one minute for constant torque applications and 110% of rated current for one minute for variable torque applications at rated voltage. If the motor load exceeds the limit, the drive shall automatically reduce the frequency and voltage to the motor to guard against overload.		
5.03.00	<p>The drive system shall be designed to operate in one or more of the following operating modes as to suit characteristics of the driven equipment or specified by the load:</p> <p>a. Variable torque changing as a function of speed.</p> <p>b. Constant torque over a specific speed range.</p> <p>c. Constant power over a specific speed range.</p> <p>d. Any other as specified in data-sheet</p>		
5.04.00	VFDs shall comply with the latest edition of IEEE 519 & IEC 61000 for both individual as well as total harmonic voltage and current distortion limits. The Voltage and Current limits shall be applicable at the Point of Common Coupling (PCC), which shall be the MCC/ Switchgear/ from which the VFD system is fed.		
5.05.00	The compliance shall be verified by the contractor by Harmonic studies conducted with maximum and minimum fault level, cable capacitance, system equipment reactance etc. Finally, the compliance shall be verified by the field measurements of harmonics at the PCC with and without VFDs operation.		
5.06.00	VFD shall be capable of withstanding the thermal and dynamic stresses and the transient mechanical torque, resulting from short circuit. Any damage resulting from such a short circuit or internal fault shall be limited to the component concerned.		
5.07.00	The system shall be suitable to maintain speed variation within range 10-110% with speed set accuracy of +1% of rated maximum speed and steady state regulation of +0.5% of rated speed as per system requirement.		
5.08.00	The VFD System shall maintain a power factor of 0.95 (minimum) from 25 % to 100 % of rated speed.		
5.09.00	Maximum allowable audible noise from the VFD system will be 85 dB (A) at a distance of one meter under rated loaded with all cooling fan operating conditions.		
6.00.00	VFD COMPATIBILITY WITH THE MOTOR		
6.01.00	For MV VFD Drives, to ensure that there are no problems with motor heating, VFD output current waveform, as measured at the motor, shall be inherently sinusoidal at nominal loads,		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 3 OF 10</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>with a total harmonic current and voltage distortion within acceptable/standard limits. VFD utilizing output transformers are not acceptable.</p>		
6.02.00	<p>The system design shall not have any inherent output harmonic resonance in the operating speed range.</p>		
6.03.00	<p>VFD shall provide stable operation of motor from high-voltage dv/dt stress, regardless of cable length to motor. The vendor shall clearly state the limitations in the motor cable distance in his proposal. However, due to system requirements & constraints if the cable length becomes critical, filters/ chokes etc. shall be provided by the VFD manufacturers as an integral part of the VFD to mitigate the reflected wave effect of harmonics.</p>		
7.00.00	BYPASS ARRANGEMENT (OPTIONAL, IF SPECIFIED)		
7.01.00	<p>The VFD System shall have an optional feature to run the motor under bypass arrangement for operation of Motor with VFD bypassed. During starting (under rated conditions) the motor will be switched on in VFD Mode to limit the starting current and after gaining speed, the load would be switched over to bypass mode.</p>		
7.02.00	<p>Comprehensive motor protection scheme for protection and control for operation VFD during bypass mode shall be finalized during detailed engineering.</p>		
8.00.00	STANDBY VFD ARRANGEMENT (OPTIONAL, IF SPECIFIED)		
8.01.00	<p>A Common standby arrangement with auto/manual switchover shall be provided in case of failure of any VFD in a group of drives. Complete protection, interlocks & control required shall be provided in the changeover module.</p>		
9.00.00	EFFICIENCY		
9.01.00	<p>Efficiency (Drive only) shall be minimum 98% for both MV VFD and LV VFD. Overall efficiency shall be minimum 96.5% for both MV and LV VFD at rated load and speed. Overall Efficiency evaluation shall include input transformer, harmonic filters and power factor correction (if applicable), VFD converters, cooling fans and output filter, as applicable in the system. Auxiliary controls, such as internal VFD control boards, cooling fans/pumps.</p>		
9.02.00	<p>In absence of valid test report, a factory test shall be performed at the VFD manufacturer's facility verifying the efficiencies. Manufactures who are supplying Drive and transformer from different locations, efficiency test will be conducted separately for Drive and transformer.</p>		
10.00.00	COOLING SYSTEM		
10.01.00	<p>The VFD shall be designed to operate indoor under temperature range of 0 deg C to 50 deg C and relative humidity of 95%.</p>		
10.02.00	<p>VFD manufacturer to primarily offer Air cooled Design. However in case of large ratings, liquid cooled drives may be accepted subject to employer's approval. In case of liquid cooled system, there shall be no necessity of continuous water supply system.</p>		
10.03.00	<p>In case of Air cooled design, the VFD Cooling system shall be such that it puts minimum heat load inside the room and preferably throw the hot air outside the room with ventilation ducts. The Cooling system shall be designed in such a way that the Air Conditioning & Ventilation Air requirements are kept to minimum. The VFD Manufacturer shall furnish the data regarding heat load, air flow requirements during the detailed engineering.</p>		
10.04.00	<p>Air cooled VFDs shall be provided with cooling fans mounted integral to the VFD/ enclosure. The VFD shall include air-flow pressure switches and temperature detectors to monitor</p>		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 4 OF 10</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>proper operation of the air cooling system. If the fan fails, the system must generate the alarm/trip for the fan failure.</p>		
11.00.00	VFD TRANSFORMER:		
11.01.00	Type: Out door, Mineral oil filled ONAN type or Indoor natural air-cooled Dry type, Three phase unit, rectifier/converter duty type transformer.		
11.02.00	Transformer shall be suitable for operation with non-sinusoidal wave shape and DC components under normal and abnormal conditions of the system without exceeding the temperature.		
11.03.00	Suitable Design Margin as per applicable standards shall be taken for purpose of sizing of the transformer.		
11.04.00	All other components, technical parameters shall be as per applicable IEC/IS.		
12.00.00	POWER CONVERTER:		
12.01.00	The static power converter shall consist of a line side converter for operation as a rectifier and a load side power converter for operation as a fully controller inverter. Power converter shall be fast switching, most efficient and low loss type.		
12.02.00	The converter shall be co-ordinated with the transformers. The converter shall be able to withstand a three phase short circuit current until interrupted by normal breaker operation.		
12.03.00	Adequate short circuit and over voltage protection shall be provided for the converter and inverter system.		
12.04.00	All power converter devices shall include protective devices, snubber networks and dv/dt networks as required.		
12.05.00	The current rating of the converter's semi-conductor components shall not be less than 120% of the nominal current flowing through the elements at full load of the VFD through the whole speed range. If the parallel connection of semiconductor is applied, the above current rating shall not be less than 140% of the above values.		
12.06.00	All power diodes shall be of silicon type with minimum VBO rating at 2.5 times the rated operating voltage.		
12.07.00	The power converter circuit shall be designed so that motor can be powered at its full nameplate rating continuously without exceeding its rated temperature rise nor reducing its service factor due to harmonic currents generated by the inverter operation. The conversion devices and associated heat sinks shall be assembled such that individual devices can be replaced without requiring the use of any special precautions / tools.		
12.08.00	The cooling system of the electronic components, if provided, shall be monitored and necessary alarms shall be provided to prevent any consequential damage to the power control devices.		
13.00.00	OUTPUT FILTER (AS APPLICABLE):		
13.01.00	Output/ du/dt filter shall be provided, if required. It shall be an integral part of the VFD system and included within the VFD enclosure. It shall inherently protect motor from high voltage dv/dt stress.		
14.00.00	DC LINK CAPACITOR (AS APPLICABLE):		
14.01.00	Capacitor shall be of self-healing film or electrolytic type having high life time. The capacitor shall be an integral part of VFD system. DC link Capacitors shall have discharge resistors		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 5 OF 10</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>which shall be capable of reducing the residual charges to zero just after the capacitor is disconnected from the supply source. The capacitor shall be suitable for high ripple currents.</p>		
15.00.00	ENCLOSURE		
15.01.00	<p>Enclosure frames and load bearing members shall be fabricated using suitable mild steel structural sections or pressed and shaped cold-rolled sheet steel of thickness 2.0 mm. Frames shall be enclosed in cold-rolled sheet steel of thickness 1.6 mm. Doors and covers shall also be of cold rolled sheet steel of thickness 1.6 mm. Stiffeners shall be provided wherever necessary. The gland plate thickness shall be 3.0 mm for hot / cold-rolled sheet steel and 4.0 mm for non-magnetic material.</p>		
15.02.00	<p>The cable entry shall be from the bottom of the panel and a removable bolted un-drilled gland plate.</p>		
15.03.00	<p>All Panels shall be of dust-proof and vermin-proof construction and shall be provided with a degree of protection of IP: 4X as per IS/IEC 60947.</p>		
15.04.00	<p>Enclosures must be designed to avoid harmonic and inductive heating effects and to shield any outside equipment from interference, enclosing and shielding the complete to eliminate any radio frequency interference. The construction of the panel shall provide effective protection against electromagnetic emissions.</p>		
15.05.00	<p>Each panel shall be provided with illuminating lamp, space heater with switch fuse and variable setting thermostat.</p>		
16.00.00	PAINTING		
	<p>Paint shade shall be as follows</p>		
	<p>a) VFD transformer : RAL 9002 (Grey), legend in black letter</p>		
	<p>b) Motors : RAL 5012 (Blue)</p>		
	<p>c) VFD Panels : Front and rear panels in Grey (RAL9002). End panel sides in blue (RAL 5012)</p>		
	<p>d) VFD reactor enclosure : RAL 5012 (Blue), legend in black letter</p>		
17.00.00	BREAKER/CONTACTOR		
17.01.00	<p>Type: Shall be SF6 or Vacuum type or air-break restrike free, stored energy operated and with electrical anti-pumping features.</p>		
17.02.00	<p>These shall be electrically operated, mechanically latched type & shall have protection against over load, all AC/DC transients and voltage surges etc. Electronic control module shall be electrically isolated.</p>		
17.03.00	<p>All other components, technical parameters shall be as per applicable IEC/IS.</p>		
18.00.00	MOTORS		
18.01.00	<p>VFD shall be used to drive three (3) phase squirrel cage inverter duty Induction motor with VPI insulation (Resin poor) suitable for VFD application. These motors shall be provided with insulated bearing on at least one side.</p>		
18.02.00	<p>Motors shall also meet the requirements mentioned in subsection for motors and relevant IS/IEC.</p>		
<p>EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p>SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p>PAGE 6 OF 10</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS		
18.03.00	Motor shall be suitable for operation with a solid state power supply consisting of an adjustable frequency inverter for speed control & shall be suitable for the current waveforms produced by the power supply including the harmonics generated by the drive.		
18.04.00	Motor insulation shall be designed to accept the applied voltage waveform, within the Vpeak and dv/dt limits as per IEC-61800.		
18.05.00	Drive manufacturer shall coordinate with the motor manufacturer for proper selection of the motor for the given load application and the output characteristics of the drive.		
19.00.00	CABLES & CABLING		
19.01.00	All the power cable for the VFD System shall have sufficient current capacity and shall be suitably sized to meet the load demand on the motor.		
19.02.00	VFD Manufacturer shall submit cable sizing & selection criteria of drive cables including grounding/ earthing philosophy to address all the key issues such as EM Noise emissions, Common mode noise, voltage reflections, stray capacitances etc., for owner's review and approval.		
19.03.00	Cables shall be suitable for laying on racks, in ducts, trenches, conduits and underground buried installation with chances of flooding by water. The instrumentation and other control cables susceptible to interference shall be routed separately from the Power Cables.		
19.04.00	For other control/instrumentation Cables and other components, technical parameters shall be as per applicable IEC/IS/Mentioned Elsewhere in the specifications.		
20.00.00	CONTROL AND PERFORMANCE REQUIREMENTS		
20.01.00	The VFD to provide an automatic current limiting feature to control motor currents during startup and provide a "soft start" torque profile for the motor load combination. Current and torque limit adjustments shall be provided to limit the maximum VFD output current and the maximum torque produced by the motor.		
20.02.00	It shall be possible to vary the speed of the drive and control it in either Local or Remote mode. Local / Remote selection shall be done from VFD panel unless otherwise specified.		
20.03.00	Provision shall be kept for exchange of information between different VFD control system parameters thru PLC/DDCMIS.		
20.04.00	Drive shall be equipped with a front mounted operator console panel consisting of a backlit alphanumeric display and a keypad with keys for parameterization and adjusting parameter. Control panel shall be operable with password for changing the protection setting, safety interlock etc.		
20.05.00	Operator console/Main Control Card shall have facility / port to connect external hardware such as Lap-Top etc. Console shall have facility for upload and download of all parameter settings from one drive to another drive for start up and operation.		
20.06.00	User-friendly licensed software for operation and fault diagnostic shall be loaded in the drive system panel before commissioning.		
21.00.00	PROTECTION FEATURES		
21.01.00	The system offered shall incorporate adequate protection features, properly coordinated for the drive control and for motor including following:		
EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)	TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2	SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES	PAGE 7 OF 10

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<ul style="list-style-type: none"> i) Converter transformer: short circuit, over current, earth fault & winding temperature high protection. ii) Incoming and outgoing line surge protection. iii) Under / over voltage protection iv) Phase loss, phase reversal, overload, negative phase sequence, locked rotor protection. v) Instantaneous Over current & Earth fault protection vi) Converter/Inverter module failure indication. vii) Over frequency/speed protection. viii) Ventilation failure indication & alarm. ix) Over temperature of VFD x) Bearing temperature protection. xi) System earth fault protection. xii) Speed reference loss protection. 		
21.02.00	Under VFD Bypass Mode (if applicable) all the electrical protections related to the Motor shall remain applicable.		
22.00.00	CONTROL FEATURES		
22.01.00	<p>Following controls shall be provided as a part of the Operator Control Panel or through separate switches on the front panel door.</p> <ul style="list-style-type: none"> i) Start / stop (in local/remote mode) ii) Speed control (Raise / lower) iii) Acknowledge/Accept/ Test Push Button for annunciation iv) Auto / Manual / Test Mode select v) Emergency stop vi) Trip-Remote Breaker 		
22.02.00	DIAGNOSTIC FEATURES		
22.02.01	The VFD shall include a microprocessor/PLC based digital diagnostic system which monitors its own control functions and displays faults and operating conditions.		
22.02.02	Fault diagnostic shall be built into the system to supervise the operation and failure of the system. The information regarding failure of any of the system including shut down of the system shall be available. It shall be possible to retrieve the record of events prior to tripping of the system or de-energization. Auxiliary supply to the system components or to the		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 8 OF 10</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	<p>electronics (firmware) for the diagnostics / display shall be taken care of by the manufacturer for this purpose.</p>	
22.03.00	<p>SERVICEABILITY / MAINTAINABILITY</p>	
22.03.01	<p>Front Access: VFD system should be designed for front access only. Manufacturer shall state in his proposal if rear access is provided.</p>	
22.03.02	<p>Power Component Accessibility: All power components in the converter sections shall be designed for rack-out accessibility for ease of maintenance and to minimize repair downtime.</p>	
22.03.03	<p>Marking / Labeling: Sleeve type wire marker tags or other acceptable means of permanent identification shall be applied to power and control wiring. Individual labels shall be provided for all major components of the VFD system.</p>	
23.00.00	<p>STORAGE AND PRESERVATION</p>	
23.01.00	<p>The Contractor shall be responsible for the storage and preservation of all the equipments to be supplied under the VFD System, till the time of successful installation and commissioning. The equipment should be suitable for storage for long periods before installation. Contractor should take adequate measures to ensure that no damage happens to the VFD System due to storage and preservation. Vendor shall submit powering requirement (if any) during storage.</p>	
24.00.00	<p>TESTS</p>	
24.01.00	<p>ROUTINE TESTS</p>	
	<p>All acceptance and routine tests as per the specification and standard IEC -61800-2 and IEC 61800-4 shall be carried out.</p>	
24.02.00	<p>TYPE TESTS</p>	
	<p>The Contractor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening. These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. In case the Contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in case the type test report(s) are not found to be meeting the specification requirements, the Contractor shall conduct all such tests under this contract free of cost to the Employer and submit the reports for approval.</p>	
24.02.01	<p>LIST OF TYPE TESTS</p>	
	<p>a) VFD panels (For LV VFD)</p> <ul style="list-style-type: none"> i. Rated Current/ Output ii. Temperature rise test iii. Surge withstand capability test iv. Noise level test v. Power Loss Determination Test vi. Power factor measurement. 	
<p>EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE -I (3X 800MW)</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p>SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>
<p>PAGE 9 OF 10</p>		

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<ul style="list-style-type: none"> vii. Degree of Protection Test viii. EMC Test b) VFD Panels (For MV VFD) <ul style="list-style-type: none"> i. Rated Current/ Output ii. Current Sharing iii. Voltage Division iv. Temperature rise test v. Surge withstand capability test vi. Noise level test vii. Power Loss Determination Test viii. Power factor measurement. ix. Degree of Protection Test c) AC/DC Reactor (If applicable) <ul style="list-style-type: none"> i. Lightning impulse test ii. Heat run test iii. Short time current test iv. Noise level test d) Induction motors <ul style="list-style-type: none"> i. As per requirements mentioned in subsection for motor. e) VFD transformers <ul style="list-style-type: none"> i. As per requirements mentioned in subsection for Transformer/ IEC 60076/IS 2026 		
<p align="center">EPC PACKAGE FOR PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE –I (3X 800MW)</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION-VI, PART-B BID DOC.NO.:CS:9585-001-2</p>	<p align="center">SUB-SECTION B-23 VARIABLE FREQUENCY DRIVES</p>	<p align="center">PAGE 10 OF 10</p>



**C&I SPECIFICATION FOR
GYPSUM DEWATERING EQUIPMENT**

SECTION: C4
SUB SECTION: C&I

**DATA SHEETS FOR MOTORISED VALVE
ACTUATOR**



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

REV. NO. 01	DATE: 11.05.2018
SHEET 1 OF	4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

GENERAL*	* PROJECT	3 x 800 MW PATRATU TPP	
	OFFER REFERENCE		
	* TAG NO. SERVICE		
	* DUTY	<input type="checkbox"/> ON / OFF	<input type="checkbox"/> INCHING
	* LINE SIZE (inlet/outlet): MATERIAL		
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY	
	* OPENING / CLOSING TIME		
	* WORKING PRESSURE		
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%	
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY	
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY	
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY	
CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, WEATHER PROOF, IP:55	
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL	
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.	
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.	
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING /REGULATING SERVICE - 150 STARTS/HR MINIMUM.	
HANDWHEEL	* REQUIRED	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED <input type="checkbox"/> SIDE MOUNTED	
	*TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.		
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY	
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY	
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT- INCLUSIVE OF I.S. TOLERANCE	
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED (BIDDER TO CONFIRM) A: <input type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 B: <input type="checkbox"/> DRG. NO. 3-V-MISC-24550 R00 C: <input type="checkbox"/> DRG. NO. 3-V-MISC-24283 R00 D: <input type="checkbox"/> DRG. NO. 4-V-MISC-90271 R11 E: <input type="checkbox"/> For Thyristor based Integral starter, Bidder/Vendor to furnish wiring diagram	
	COLOUR SHADE	<input checked="" type="checkbox"/> BLUE (RAL 5012) ENAMEL <input type="checkbox"/>	
	PAINT TYPE (## Refer Notes)	<input type="checkbox"/> ENAMEL <input type="checkbox"/> EPOXY <input type="checkbox"/>	
	SHAFT RPM	BIDDER TO SPECIFY	
	OLR SET VALUE	BIDDER TO SPECIFY	
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY	
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY	
	@ PWR SUPP TO MTR / STARTER	415V +/- 10 % , 3PH,3 W, AC 50 HZ +/- 5 %	
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER <input type="checkbox"/> 230 V <input checked="" type="checkbox"/> 110 V AC/24V DC	

FORM NO. PEM-6666-0



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

REV. NO.	01	DATE:	11.05.2018
SHEET	2 OF		4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

	MOTOR BEARING WITH 2 EARTH TERMINALS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI FRICTION	
	@ ENCLOSURE CLASS OF MOTOR	IP 67 FOR OUTDOOR & IP 55 FOR INDOOR(TOTALLY ENCLOSED SELF VENTILATED)	
	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B	
	@ WINDING TEMP PROTECTION	<input checked="" type="checkbox"/> THERMOSTAT (3 Nos., 1 IN EACH PHASE) <input type="checkbox"/>	
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	<input checked="" type="checkbox"/> CONTACTORS <input type="checkbox"/> THYRISTORS	
	TYPE	<input checked="" type="checkbox"/> CONVENTIONAL <input type="checkbox"/> SMART (NON-INTRUSIVE)	
	IF SMART	(NOT APPLICABLE)	
	a) SERIAL LINK INTERFACE	<input type="checkbox"/> INTEGRAL <input type="checkbox"/> FIELD MOUNTED	
	b) SERIAL LINK PROTOCOL	<input type="checkbox"/> FOUNDATION FIELD-BUS <input type="checkbox"/> PROFI-BUS <input type="checkbox"/> DEVICE NET <input type="checkbox"/>	
	c) SERIAL LINK MEDIA	<input type="checkbox"/> TWISTED PAIR Cu-CBL <input type="checkbox"/> CO-AXIAL Cu-CBL <input type="checkbox"/> OFC	
	d) HAND HELD PROGRAMMER	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	e) TYPE OF HAND HELD PROGRAMMER	<input type="checkbox"/> BLUETOOTH <input type="checkbox"/> INFRARED <input type="checkbox"/>	
	f) MASTER STATION	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	g) MASTER STN INTRFACE WITH DCS	<input type="checkbox"/> MODBUS <input type="checkbox"/> TCP/IP	
	h) DETAILS OF SPECIAL CABLE	<input type="checkbox"/> ENCLOSED <input type="checkbox"/> NOT REQUIRED	
	STEP DOWN CONT. TRANSFORMER	<input checked="" type="checkbox"/> REQUIRED	
	OPEN / CLOSE PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	STOP PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INDICATING LAMPS	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	LOCAL REMOTE S/S	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
STATUS CONTACTS FOR MONITORING	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT./POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)		
INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	<input checked="" type="checkbox"/> INTERPOSING RELAY <input type="checkbox"/> OPTO COUPLER <input type="checkbox"/> EITHER	
	QUANTITY	<input checked="" type="checkbox"/> 2 NOs. <input type="checkbox"/> 3 NOs.	
	DRIVING VOLTAGE	<input checked="" type="checkbox"/> 20.5 – 24V DC <input type="checkbox"/> _____ V DC	
	DRIVING CURRENT	<input checked="" type="checkbox"/> 125mA MAX <input type="checkbox"/> _____ mA MAX	
	LOAD RESISTANCE	<input checked="" type="checkbox"/> > 192 ohms - <25 k ohms <input type="checkbox"/> > _____ ohms - < _____ ohms	
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos. / <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	<input type="checkbox"/> 1 No. <input checked="" type="checkbox"/> 2 Nos. <input type="checkbox"/> 1 No. <input checked="" type="checkbox"/> 2Nos.	
	CONTACT TYPE	2 NO + 2 NC	

748359/2022/PS-PEM-MAX

FORM NO. PEM-6666-0



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

REV. NO. 01	DATE: 11.05.2018
SHEET 3 OF	4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

Refer Notes

RATING (AC / DC)

5A 240V AC AND 0.5A 220V DC

Limit switches shall be silver plated with high conductivity and non-corrosive type. Contact rating shall be sufficient to meet the requirement of control system subject to a minimum of 60 V, 6 VA rating. Protection class shall be IP 55.

POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty applications)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	MFR & MODEL NO.	BIDDER TO SPECIFY	
	TYPE	<input type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) CONTACTLESS INDUCTIVE TYPE ,EXTERNAL 24 V DC OPERATED ,SUITABLE FOR STABILISED 4-20 mA SIGNAL	
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/>	
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA	
	ACCURACY	\pm 1% FS	
SPACE HEATER	@SPACE HEATER	REQUIRED	
	@ POWER SUPPLY (NON INTEGRAL)	230V AC,1 PH.,50 Hz	
	@ POWER SUPPLY (INTEGRAL)	POWER SUPPLY DERIVED FROM MAIN POWER SUPPLY AVAILABLE AT ACTUATOR END.	
	@ RATING		
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED	
	ENCL CLASS ACTUATOR/MOTOR T.B.	<input checked="" type="checkbox"/> IP 68 @ <input type="checkbox"/>	
	@ EARTHING TERMINAL	REQUIRED	
	PLUG & SOCKET(9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED <input type="checkbox"/> <input checked="" type="checkbox"/> 2 NOS. PRE WIRED <input type="checkbox"/>	
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:-----	
	@ SPACE HEATER CABLE GLAND	SIZE:-----	
	OTHER CONTROL CABLE GLANDS-1	2 NOS SUITABLE FOR 4P,0.5SQ MM	
	OTHER CONTROL CABLE GLAND	1 No. for BFV of CW PUMP(Cable size 2Px1.5mm ²)	