













| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                          |
|--|---|---|--------------------------|
| 9.03.03  | (i.) MDCC<br>NOT USED.  |   |                          |
| 9.03.04  | NOT USED.   |   |                          |
| 9.03.05  | Similarly, the contractor shall be required to submit two sets (two hard copies and two CD ROMs), containing QA Documentation pertaining to field activities as per Approved Field Quality Plans and other agreed manuals/ procedures, prior to commissioning of individual system.   |   |                          |
| 9.03.06  | <p>Before despatch / commissioning of any equipment, the Supplier shall make sure that the corresponding quality document or in the case of protracted phased deliveries, the applicable section of the quality document file is completed. The supplier will then notify the Inspector regarding the readiness of the quality document (or applicable section) for review.</p> <p>(a.) If the result of the review carried out by the Inspector is satisfactory, the Inspector shall stamp the quality document (or applicable section) for release.</p> <p>(b.) If the quality document is unsatisfactory, the Supplier shall endeavor to correct the incompleteness, thus allowing to finalize the quality document (or applicable section) by time compatible with the requirements as per contract documents. When it is done, the quality document (or applicable section) is stamped by the Inspector.</p> <p>(c.) If a decision is made for despatch, whereas all outstanding actions cannot be readily cleared for the release of the quality document by that time, the supplier shall immediately, upon shipment of the equipment, send a copy of the quality document Review Status signed by the Supplier Representative to the Inspector and notify of the committed date for the completion of all outstanding actions &amp; submission. The Inspector shall stamp the quality document for applicable section when it is effectively completed. The submission of QA documentation package shall not be later than 3 weeks after the despatch of equipment.</p> |   |                          |
| 9.03.07  | <p><b>TRANSMISSION OF QA DOCUMENTATION</b></p> <p>On release of QA Documentation by Inspector, one set of quality document shall be forwarded to Corporate Quality Assurance Department and other set to respective Project Site of Employer.</p>   |   |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>40 OF 89</b> |



| CLAUSE NO.  |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                                 |
|---|---|---|---------------------------------|
| 9.04.00   | <p>For the particular case of phased/part derivatives of equipment, the complete quality document of that particular equipment to the Employer shall be issued not later than 3 weeks after the date of the last delivery of equipment.</p> <p><b>Project Manager's Supervision</b></p>   |   |                                 |
| 9.04.01   | <p>To eliminate delays and avoid disputes and litigation, it is agreed between the parties to the Contract that all matters and questions shall be referred to the Project Manager and without prejudice to the provisions of 'Arbitration' clause in Section GCC of Vol.I, the Contractor shall proceed to comply with the Project Manager's decision.</p>   |   |                                 |
| 9.04.02   | <p>The work shall be performed under the supervision of the Project Manager. The scope of the duties of the Project Manager pursuant to the Contract, will include but not be limited to the following:</p> <ul style="list-style-type: none"> <li>(a.) Interpretation of all the terms and conditions of these documents and specifications:</li> <li>(b.) Review and interpretation of all the Contractor's drawing, engineering data, etc:</li> <li>(c.) Witness or his authorised representative to witness tests and trials either at the manufacturer's works or at site, or at any place where work is performed under the contract :</li> <li>(d.) Inspect, accept or reject any equipment, material and work under the contract:</li> <li>(e.) Issue certificate of acceptance and/or progressive payment and final payment certificates</li> <li>(f.) Review and suggest modifications and improvement in completion schedules from time to time, and</li> <li>(g.) Supervise Quality Assurance Programme implementation at all stages of the works.</li> </ul> |   |                                 |
| 9.05.00   | <p><b>INSPECTION, TESTING AND INSPECTION CERTIFICATES</b></p>   |   |                                 |
| 9.05.01   | <p>The word 'Inspector' shall mean the Project Manager and/or his authorised representative and/or an outside inspection agency acting on behalf of the Employer</p>  |   |                                 |
| <p><b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b></p> | <p><b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b></p>  | <p><b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b></p> | <p><b>PAGE<br/>41 OF 89</b></p> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |  |                          |
|--|---|--|--------------------------|
| 9.05.02  | <p>to inspect and examine the materials and workmanship of the works during its manufacture or erection.</p> <p>The Project Manager or his duly authorised representative and/or an outside inspection agency acting on behalf of the Employer shall have access at all reasonable times to inspect and examine the materials and workmanship of the works during its manufacture or erection and if part of the works is being manufactured or assembled on other premises or works, the Contractor shall obtain for the Project Manager and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works.</p>  |  |                          |
| 9.05.03  | <p>The Contractor shall give the Project Manager/Inspector ten (10) working days written notice of any material being ready for testing. Such tests shall be to the Contractor's account except for the expenses of the Inspector's. The Project Manager/Inspector, unless the witnessing of the tests is virtually waived and confirmed in writing, will attend such tests within ten (10) working days of the date on which the equipment is noticed as being ready for test/inspection failing which the contractor may proceed with test which shall be deemed to have been made in the inspector's presence and he shall forthwith forward to the inspector duly certified copies of test reports in two (2) copies.</p>   |  |                          |
| 9.05.04  | <p>The Project Manager or Inspector shall within ten (10) working days from the date of inspection as defined herein give notice in writing to the Contractor, or any objection to any drawings and all or any equipment and workmanship which is in his opinion not in accordance with the contract. The Contractor shall give due consideration to such objections and shall either make modifications that may be necessary to meet the said objections or shall inform in writing to the Project Manager/Inspector giving reasons therein, that no modifications are necessary to comply with the contract.</p>   |  |                          |
| 9.05.05  | <p>When the factory tests have been completed at the Contractor's or sub-contractor's works, the Project Manager /Inspector shall issue a certificate to this effect ten (10) working days after completion of tests but if the tests are not witnessed by the Project Manager /Inspectors, the certificate shall be issued within ten (10) working days of the receipt of the Contractor's test certificate by the Project Manager /Inspector. Project Manager /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the works. The completion of these tests or the issue of the certificates shall not bind the Employer to accept the equipment should it, on further tests after erection be found not to comply with the contract.</p> |  |                          |
| 9.05.06  | <p>In all cases where the contract provides for tests whether at the premises or works of the Contractor or any sub-contractor, the Contractor, except where otherwise specified shall provide free of charge such items as labour, material, electricity, fuel,</p>  |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>42 OF 89</b> |



| CLAUSE NO.  |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                                 |
|---|---|---|---------------------------------|
|   | <p>water, stores, apparatus and instruments as may be reasonably demanded by the Project Manager /Inspector or his authorised representatives to carry out effectively such tests on the equipment in accordance with the Contractor and shall give facilities to the Project Manager/Inspector or to his authorised representative to accomplish testing.</p>  |   |                                 |
| 9.05.07   | <p>The inspection by Project Manager / Inspector and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed Quality Assurance Programme forming a part of the contract.</p>  |   |                                 |
| 9.05.08   | <p>To facilitate advance planning of inspection in addition to giving inspection notice as specified at clause no 9.05.03- of this chapter, the Contractor shall furnish quarterly inspection programme indicating schedule dates of inspection at Customer Hold Point and final inspection stages. Updated quarterly inspection plans will be made for each three consecutive months and shall be furnished before beginning of each calendar month.</p>                                     |   |                                 |
| 9.05.09   | <p>All inspection, measuring and test equipment used by contractor shall be calibrated periodically depending on its use and criticality of the test/measurement to be done. The Contractor shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by NTPC. Wherever asked specifically, the contractor shall re-calibrate the measuring/test equipment in the presence of Project Manager / Inspector.</p> |   |                                 |
| 9.06.00   | <p><b>ASSOCIATED DOCUMENT FOR QUALITY ASSURANCE PROGRAMME:</b></p>  |   |                                 |
| 9.06.01   | <p>List of items requiring Quality Plan &amp; Sub-supplier approval.<br/>Format No. QS-01-QAI-P-01/F3-R0</p>  |   |                                 |
| 9.06.02   | <p>Status of Quality Plan and Sub-supplier approval<br/>Format No. QS-01-QAI-P-02/F1-R0</p>   |   |                                 |
| 9.06.03   | <p>Field Welding Schedule Format No.: QS-01-QAI-P-02/F2-R0</p>  |   |                                 |
| 9.06.04   | <p>Manufacturing Quality Plan Format No.: QS-01-QAI-P-09/F1-R0</p>  |   |                                 |
| 9.06.05   | <p>Field Quality Plan Format No.: QS-01-QAI-P-09/F2-R0<br/>The above formats are enclosed as Annexure-III to VII</p>  |   |                                 |
| 10.00.00  | <p><b>PRE-COMMISSIONING AND COMMISSIONING FACILITIES</b></p> <p>(a.) As soon as the facilities or part thereof has been completed operationally and structurally and before start-up, each item of the equipment and systems</p>  |   |                                 |
| <p><b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b></p> | <p><b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b></p>  | <p><b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b></p> | <p><b>PAGE<br/>43 OF 89</b></p> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |  |                          |
|--|---|--|--------------------------|
|  | <p>forming part of facilities shall be thoroughly cleaned and then inspected jointly by the Employer and the Contractor for correctness of and completeness of facility or part thereof and acceptability for initial pre-commissioning tests, commissioning and start-up at Site. The list of pre-commissioning tests to be performed shall be as mutually agreed and included in the Contractor's quality assurance programme as well as those included in Part-D, Section-VI and elsewhere in the Technical Specifications.</p> <p>(b.) The Contractor's pre-commissioning/ commissioning/start-up engineers, specially identified as far as possible, shall be responsible for carrying out all the pre-commissioning tests at Site. On completion of inspection, checking and after the pre-commissioning tests are satisfactorily over, the commissioning of the complete facilities shall be commenced during which period the complete facilities, equipments shall be operated integral with sub-systems and supporting equipment as a complete plant.</p> <p>(c.) All piping system shall be flushed, steam blown, air blown as required and cleanliness demonstrated using acceptable industry standards. Procedures to accomplish this work shall be submitted for approval to the Employer six months prior to the respective implementations. The Employer will approve final verification of cleanliness.</p> <p>(d.) The time consumed in the inspection and checking of the units shall be considered as a part of the erection and installation period.</p> <p>(e.) The check outs during the pre - commissioning period should be programmed to follow the construction completion schedule. Each equipment/system, as it is completed in construction and turned over to Employer's commissioning (start-up) Engineer(s), should be checked out and cleaned. The checking and inspection of individual systems should then follow a prescribed schedule to be agreed by the Employer.</p> <p>(f.) The Contractor during initial operation and performance testing shall conduct vibration testing to determine the 'base line' of performance of all plant rotating equipment. These tests shall be conducted when the equipment is running at the base load, peak load as well as lowest sustained operating condition as far as practicable.</p> <p>(g.) Contractor shall furnish the commissioning organization chart for review &amp; acceptance of employer at least eighteen months prior to the schedule date of synchronization of 1st unit. The chart should contain:</p> <p>(1.) Biodata including experience of the Commissioning Engineers.</p> |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>44 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|--|--|--------------------------|
| 10.02.00   | <p>(2.) Role and responsibilities of the Commissioning Organisation members.</p> <p>(3.) Expected duration of posting of the above Commissioning Engineers at site.</p> <p><b>Initial Operation</b></p> <p>a) On completion of all pre-commissioning activities / tests and as a part of commissioning the complete facilities shall be put on 'Initial Operation' during which period all necessary adjustments shall be made while operating over the full load range enabling the facilities to be made ready for the Guarantee Tests.</p> <p>b) The 'Initial Operation' of the complete facility as an integral unit shall be conducted for 720 continuous hours. During the period of initial operation of 720 hours, the unit shall operate continuously at full rated load for a period not less than 72 hours.</p> <p>The Initial Operation shall be considered successful, provided that each item/ part of the facility can operate continuously at the specified operating characteristics, for the period of Initial Operation with all operating parameters within the specified limits and at or near the predicted performance of the equipment/ facility.</p> <p>The Contractor shall intimate the Employer about the commencement of initial operation and shall furnish adequate notice to the Employer in this respect.</p> <p>c) Any loss of generation due to constraints attributable to the Employer shall be construed as Deemed Generation.</p> <p>In the event of test interruptions as a result of Force Majeure or Employer-Caused-Delay during Initial Operation test, where.</p> <p>(i) The total cumulative interrupted time during the test is more than twenty-four (24) hours.</p> <p>(ii) The total number of interruptions during the test is more than four (4).</p> <p>The test shall not be deemed a successful Initial Operation Test.</p> |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>45 OF 89</b> |



|  |   |  |                  |
|--|---|--|------------------|
| CLAUSE NO.   |   <p style="text-align: center;"><b>GENERAL TECHNICAL REQUIREMENTS</b></p>  |  |                  |
| 11.00.00   | <p>The interrupted test resulting from Force Majeure or Employer-Caused-Delay shall be extended by an amount of time equal to the cumulative length of the interruptions, including time to return to steady-state operation; the test data for the period of interruptions shall be excluded from analysis; and the test data that were collected both before and after the interruptions shall be included in the analysis.</p> <p>d) An Initial Operation report comprising of observations and recordings of various parameters to be measured in respect of the above Initial Operation shall be prepared by the Contractor. This report, besides recording the details of the various observations during initial operation shall also include the dates of start and finish of the Initial Operation and shall be signed by the representatives of both the parties. The report shall have sheets, recording all the details of interruptions occurred, adjustments made and any minor repairs done during the Initial Operation. Based on the observations, necessary modifications/repairs to the plant shall be carried out by the Contractor to the full satisfaction of the Employer to enable the latter to accord permission to carry out the Guarantee tests on the facilities. However, minor defects which do not endanger the safe operation of the equipment, shall not be considered as reasons for with holding the aforesaid permission.</p> <p>(g) <b>Grid Restriction</b></p> <p>Any loss in generation in terms of power (KW) or energy (KWH) during Initial operation Test due to grid restrictions shall be treated as deemed generation. however, the total cumulative deemed generation shall not exceed 5% of the total generation during the test period failing which the test shall be extended to limit the deemed generation to 5% of the total generation.</p> <p><b>GUARANTEE TESTS</b></p> <p>a) The final test as to prove the Functional Guarantees shall be conducted at Site by the Contractor in presence of the Employer. The contractor's Commissioning, Start-up Engineer shall make the unit ready to conduct such test before start of initial operation. Such test shall be conducted along with Initial Operations.</p> <p>b) These tests shall be binding on both the parties of the Contract to determine compliance of the equipment with the functional guarantee.</p> <p>c) For performance/ demonstration tests instrumentations, accuracy class shall be as per specified test codes. The numbers and location of the instruments shall be as per the specified test codes. In addition the values of parameters</p> |  |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>46 OF 89 |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |   |  |
|--|---|---|--|
| 12.00.00   | <p>shall be logged from the information system provided under Employer's Distributed Digital Control Monitoring and Information system. Test will be conducted at specified load points.</p> <p>d) Any special equipment, tools and tackles required for the successful completion of the Guarantee Tests shall be provided by the Contractor, free of cost.</p> <p>e) The Guarantee tests and specific tests to be conducted on equipments have been brought out in detail elsewhere in the specification.</p> <p><b>TAKING OVER</b></p> <p>Upon successful completion of Initial Operations and all the tests conducted to the Employer's satisfaction, the Employer shall issue to the Contractor a Taking over Certificate as a proof of the final acceptance of the equipment. Such certificate shall not unreasonably be with held nor will the Employer delay the issuance thereof, on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the equipment. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issuance of such certificate.</p> |   |  |
| 13.00.00   | <p><b>TRAINING OF EMPLOYER'S PERSONNEL</b></p>  |   |  |
| 13.01.00   | <p>The scope of service under training of Employer's engineers shall include a training module in the areas of Operation &amp; Maintenance.</p> <p>Such training should cover the following areas as a minimum in order to enable these personnel to individually take the responsibility of operating and maintaining the power station in a manner acceptable to the Employer:</p> <p>(a.) Training for TG and related equipments.</p> <p>(b.) TG related C&amp;I system like turbine supervisory system (TSS) etc.</p> <p>(c.) DDCMIS as detailed in Part-B</p> <p>(d.) Training for Electric Power Supply systems</p> <p>(e.) Training for power cycle piping / critical piping</p>   |   |  |
| 13.02.00   | <p>The scope of services under training shall also necessarily include training of Employer's Engineering personnel covering entire scope for the package This shall</p>  |   |  |
| <p><b>KHURJA SUPER THERMAL POWER PROJECT</b><br/>(2X660 MW)<br/><b>TURBINE GENERATOR AND ASSOCIATED PACKAGES</b></p> | <p><b>TECHNICAL SPECIFICATION</b><br/><b>SECTION – VI, PART-C</b><br/><b>BID DOC. NO.:</b><br/><b>THDC/RKSH/CC-9915-371</b></p>   | <p><b>GENERAL TECHNICAL</b><br/><b>REQUIREMENTS (GTR)</b></p> | <p><b>PAGE</b><br/><b>47 OF 89</b></p> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |   |                      |      |                          |                       |                  |  |  |  |  |
|--|--|---|----------------------|------|--------------------------|-----------------------|------------------|--|--|--|--|
|  | <p>cover all disciplines viz, Mechanical, Electrical, C&amp;I, &amp; QA etc and shall include all the related areas like Design familiarization, training on product design features and product design softwares of major equipment and systems, engineering, manufacturing, erection, commissioning, training on operating features of equipment, quality assurance and testing, plant visits and visits to manufacturer's works, exposure to various kinds of problems which may be encountered in fabrication, manufacturing, erection, welding etc.</p> <p>13.03.00 Contractor shall also arrange for training of Employer's personnel in respect of fire detection and protection systems and other Balance of Plant equipments.</p> <p>13.04.00 Exact details, extent of training and the training schedule shall be finalised based on the Bidder's proposal within two (2) months from placement of award.</p> <p>13.05.00 In all the above cases, the lodging and boarding of the Employer's personnel shall be at the cost of Bidder. The Bidder shall make all necessary arrangements towards the same.</p> <p>13.06.00 Take off prices (product wise) should be indicated by the Bidder in the Bid Proposal Sheets. Employer reserves the right to include or exclude these item(s) during placement of Award.</p> <p><b>Note:</b></p> <ol style="list-style-type: none"> <li>For training purposes, one (1) man month implies 30 working days (excluding all intervening holidays) per person.</li> <li>The total man months in each area shall be divided into suitable number of modules which shall be discussed and finalized during post award stage.</li> <li>Duration of each module shall not be less than 10 (ten) working days out of which 20 % shall be for plant/manufacturers' works visits and 80% shall be class room training.</li> <li>A) Location of class room training for engineering shall be at Design/Engineering office.<br/>B) Class room training for erection/O&amp;M shall be at location of Manufacturers' works.</li> </ol> <p><b>TRAINING REQUIRED IN MAN MONTH</b></p> <table border="1" data-bbox="428 1608 1326 1692"> <thead> <tr> <th>Area</th> <th>Engineering (Man months)</th> <th>Erection (Man months)</th> <th>O&amp;M (Man months)</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table> |   |                      | Area | Engineering (Man months) | Erection (Man months) | O&M (Man months) |  |  |  |  |
| Area   | Engineering (Man months)   | Erection (Man months)                       | O&M (Man months)     |      |                          |                       |                  |  |  |  |  |
|  |  |   |                      |      |                          |                       |                  |  |  |  |  |
| <b>KHURJA SUPER THERMAL POWER PROJECT (2X660 MW) TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO.: THDC/RKSH/CC-9915-371</b>  | <b>GENERAL TECHNICAL REQUIREMENTS (GTR)</b> | <b>PAGE 48 OF 89</b> |      |                          |                       |                  |  |  |  |  |



| CLAUSE NO.  |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |  |                  |   |        |         |   |   |          |     |    |              |  |  |  |
|---|---|--|------------------|---|--------|---------|---|---|----------|-----|----|--------------|--|--|--|
|   | <table border="1" data-bbox="428 228 1325 495"> <tr> <td data-bbox="428 228 672 359">Steam Turbine Generator and its Auxiliaries including electricals</td> <td data-bbox="672 228 831 359">6.5</td> <td data-bbox="831 228 1102 359">9.0</td> <td data-bbox="1102 228 1325 359">23</td> </tr> <tr> <td data-bbox="428 359 672 468">Station C&amp;I (Control and Instrumentation)</td> <td data-bbox="672 359 831 468">3.5</td> <td data-bbox="831 359 1102 468">5.5</td> <td data-bbox="1102 359 1325 468">10</td> </tr> <tr> <td data-bbox="428 468 672 495"><b>Total</b></td> <td data-bbox="672 468 831 495"></td> <td data-bbox="831 468 1102 495"></td> <td data-bbox="1102 468 1325 495"></td> </tr> </table>  |  |                  | Steam Turbine Generator and its Auxiliaries including electricals | 6.5    | 9.0     | 23                                      | Station C&I (Control and Instrumentation)   | 3.5      | 5.5 | 10 | <b>Total</b> |  |  |  |
| Steam Turbine Generator and its Auxiliaries including electricals                             | 6.5   | 9.0                                    | 23               |   |        |         |   |   |          |     |    |              |  |  |  |
| Station C&I (Control and Instrumentation)   | 3.5   | 5.5                                    | 10               |   |        |         |   |   |          |     |    |              |  |  |  |
| <b>Total</b>  |   |  |                  |   |        |         |   |   |          |     |    |              |  |  |  |
|   | <table border="1" data-bbox="386 569 1414 1352"> <thead> <tr> <th data-bbox="386 569 618 600">Area</th> <th data-bbox="618 569 1219 600">Topics</th> <th data-bbox="1219 569 1414 600">MANDAYS</th> </tr> </thead> <tbody> <tr> <td data-bbox="386 600 618 1352"> <b>Condensate Polishing Plant (CPU)</b> </td> <td data-bbox="618 600 1219 1352"> <b>System/Product Design</b><br/>           - Basic design features including Pre-filters<br/>           - Theory &amp; principle of operation<br/>           - Latest technological trends in CPU &amp; Pre-filters and design aspects &amp; Selection criteria.<br/><br/> <b>Plant Visit</b><br/>           - Operational feedback<br/>           - O&amp;M history / problems related to CPU plant<br/><br/> <b>Visit to Manufacturer's Work</b><br/>           -Manufacturing process of pre-filters and major equipment<br/><br/>           -Testing facilities<br/><br/> <b>Operation &amp; Maintenance of Plant</b><br/>           -Trouble shooting and fault analysis<br/><br/>           -Familiarization of special maintenance techniques<br/><br/>           -Special tool and tackles familiarization         </td> <td data-bbox="1219 600 1414 1352"> <b>3</b> </td> </tr> </tbody> </table> |  |                  | Area  | Topics | MANDAYS | <b>Condensate Polishing Plant (CPU)</b> | <b>System/Product Design</b><br>- Basic design features including Pre-filters<br>- Theory & principle of operation<br>- Latest technological trends in CPU & Pre-filters and design aspects & Selection criteria.<br><br><b>Plant Visit</b><br>- Operational feedback<br>- O&M history / problems related to CPU plant<br><br><b>Visit to Manufacturer's Work</b><br>-Manufacturing process of pre-filters and major equipment<br><br>-Testing facilities<br><br><b>Operation &amp; Maintenance of Plant</b><br>-Trouble shooting and fault analysis<br><br>-Familiarization of special maintenance techniques<br><br>-Special tool and tackles familiarization | <b>3</b> |     |    |              |  |  |  |
| Area  | Topics  | MANDAYS                                |                  |   |        |         |   |   |          |     |    |              |  |  |  |
| <b>Condensate Polishing Plant (CPU)</b>   | <b>System/Product Design</b><br>- Basic design features including Pre-filters<br>- Theory & principle of operation<br>- Latest technological trends in CPU & Pre-filters and design aspects & Selection criteria.<br><br><b>Plant Visit</b><br>- Operational feedback<br>- O&M history / problems related to CPU plant<br><br><b>Visit to Manufacturer's Work</b><br>-Manufacturing process of pre-filters and major equipment<br><br>-Testing facilities<br><br><b>Operation &amp; Maintenance of Plant</b><br>-Trouble shooting and fault analysis<br><br>-Familiarization of special maintenance techniques<br><br>-Special tool and tackles familiarization   | <b>3</b>                               |                  |   |        |         |   |   |          |     |    |              |  |  |  |
| 14.00.00  | <p data-bbox="386 1461 1198 1493"><b>SAFETY ASPECTS DURING CONSTRUCTION AND ERECTION</b></p> <p data-bbox="386 1535 1422 1598">In addition to the requirements given in Erection Conditions of Contract (ECC) the following shall also cover:</p> <p data-bbox="386 1604 1325 1635">(a.) Working platforms should be fenced and shall have means of access.</p>   |  |                  |   |        |         |   |   |          |     |    |              |  |  |  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>49 OF 89 |   |        |         |   |   |          |     |    |              |  |  |  |

| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|---|--|--------------------------|
| 15.00.00   | <p>(b.) Ladders in accordance with Employer's safety rules for construction and erection shall be used. Rungs shall not be welded on columns. All the stairs shall be provided with handrails immediately after its erection.</p> <p><b>NOISE LEVEL</b></p> <p>The equivalent 'A' weighted sound pressure level measured at a height of 1.5 m above floor level in elevation and at a distance of one (1) metre horizontally from the nearest surface of any equipment / machine, furnished and installed under these specifications, expressed in decibels to a reference of 0.0002 microbar, shall not exceed 85 dBA except for</p> <p>(a.) Safety valves and associated vent pipes for which it shall not exceed 105 dBA-115 dBA.</p> <p>(b.) Regulating drain valves in which case it shall be limited to 90 dBA-115dBA.</p> <p>(c.) TG unit in which case it shall not exceed 90 dBA.</p> <p>(d.) For HP-LP bypass valves and other intermittantly operating control valves, the noise level shall be within the limit of 90 dBA.</p> <p>(e) For BFP motor, the noise level shall be within the limit of 90 dBA</p>                |  |                          |
| 16.00.00   | <p><b>PACKAGING AND TRANSPORTATION</b></p> <p>All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. While packing all the materials, the limitation from the point of view of the sizes of railway wagons available in India should be taken account of. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. The Contractor shall ascertain the availability of Railway wagon sizes from the Indian Railways or any other agency concerned in India well before effecting despatch of equipment. Before despatch it shall be ensured that complete processing and manufacturing of the components is carried out at shop, only restricted by transport limitation, in order to ensure that site works like grinding, welding, cutting &amp; preassembly to bare minimum. The Employer's Inspector shall have right to insist for completion of works in shops before despatch of materials for transportation.</p> |  |                          |
| 17.00.00   | <p><b>ELECTRICAL ENCLOSURE</b></p>  |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>50 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |  |                          |
|--|---|--|--------------------------|
| 18.00.00   | <p>All electrical equipments and devices, including insulation, heating and ventilation devices shall be designed for ambient temperature and a maximum relative humidity as specified elsewhere in the specification,</p> <p><b>INSTRUMENTATION AND CONTROL</b></p> <p>All instrumentation and control systems/ equipment/ devices/ components, furnished under this contract shall be in accordance with the requirements stated herein, unless otherwise specified in the detailed specifications.</p>   |  |                          |
| 18.01.00   | <p>All instrument scales and charts shall be calibrated and printed in metric units and shall have linear graduation. The ranges shall be selected to have the normal reading at 75% of full scale.</p> <p>All scales and charts shall be calibrated and printed in Metric Units as follows:</p> <ul style="list-style-type: none"> <li>a) Temperature - Degree centigrade (deg C)</li> <li>b) Pressure - Kilograms per square centimetre (Kg/cm<sup>2</sup>). Pressure instrument shall have the unit suffixed with 'a' to indicate absolute pressure. If nothing is there, that will mean that the indicated pressure is gauge pressure.</li> <li>c) Draught - Millimetres of water column (mm wc).</li> <li>d) Vacuum - Millimeters of mercury column (mm Hg) or water column (mm Wcl).</li> <li>e) Flow (Gas) - Tonnes/ hour</li> <li>f) Flow (Steam) - Tonnes/ hour</li> <li>g) Flow (Liquid) - Tonnes / hour</li> <li>h) Flow base - 760 mm Hg. 15 deg.C</li> <li>i) Density - Grams per cubic centimetre.</li> </ul> |  |                          |
| 18.02.00   | <p>All instruments and control devices provided on panels shall be of miniaturized design, suitable for modular flush mounting on panels with front draw out facility and flexible plug-in connection at rear.</p>  |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>51 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|--|--|--------------------------|
| 18.03.00   | <b>NOT USED.</b>   |  |                          |
| 19.00.00   | <b>ELECTRICAL NOISE CONTROL</b><br><br>The equipment furnished by the Contractor shall incorporate necessary techniques to eliminate measurement and control problems caused by electrical noise. Areas in Contractor's equipment which are vulnerable to electrical noise shall be hardened to eliminate possible problems. Any additional equipment, services required for effectively eliminating the noise problems shall be included in the proposal.   |  |                          |
| 20.00.00   | <b>INSTRUMENT AIR SYSTEM</b><br><br>The instrument air supply system as supplied by the Contractor for various pneumatic control & instrumentation devices like pneumatic actuators, power cylinders, E/P converters, piping / tubing etc. shall be as per the details furnished elsewhere.<br><br>Each pneumatic instrument shall have an individual air shut - off valve. The pressure regulating valve shall be equipped with an internal filter, a 50 mm pressure gauge and a built-in filter housing blow down valve.   |  |                          |
| 21.00.00   | <b>TAPPING POINTS FOR MEASUREMENTS</b><br><br>Tapping points shall include probes, wherever applicable, for analytical measurements and sampling.<br><br>For direct temperature measurement of all working media, one stub with internal threading of approved pattern shall be provided along with suitable plug and washer. The Contractor will be intimated about thread standard to be adopted.<br><br>The following shall be provided on equipment by the Contractor. The standard which is to be adopted, will be intimated to the Contractor.<br><br>(a.) Temperature test pockets with stub and thermowell<br><br>(b.) Pressure test pockets |  |                          |
| 22.00.00   | <b>SYSTEM DOCUMENTATION</b><br><br>The Bidder shall provide drawings, system overview & description, hardware/software details, technical literature, functional & hardware schemes, bill of material, parts list, interconnection diagrams, data sheets, erection/ installation/  |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>52 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |   |                          |
|--|---|---|--------------------------|
|  | <p>commissioning procedures, instruction/ operating manuals, etc. for each of the C&amp; I system / sub-systems/ equipment supplied under this package. The documentation shall include complete details of the C&amp;I systems/ sub-systems/ equipment to enable review by Employer during detailed engineering stage and to provide information to plant personnel for operation &amp; Maintenance (including quick diagnostics &amp; trouble shooting) of these C&amp;I systems/ sub-systems/ equipment at site. The minimum documentation requirements for C&amp;I systems shall be as stipulated under C&amp;I "Technical Data Sheets" Part of specifications. In addition to this, system documentation for DDCMIS shall include as a minimum to that specified elsewhere in the Technical Specification.</p> <p>The exact format, submission schedule and contents of various documents shall be as finalised during detailed engineering stage.</p> |   |                          |
| 22.01.00   | <p>Bill of material (instrument list) for all C&amp;I equipment/ devices shall be furnished by the bidder in standard formats as approved by the Employer.</p>  |   |                          |
| 23.00.00   | <p><b>MAINTENANCE MANUALS OF ELECTRONIC MODULES</b></p> <p>The Contractor shall have to furnish two (2) sets of all maintenance manual of each and every electronic card/module as employed on the various systems and equipment including peripherals etc., offered by him. The Contractor will also have to furnish the data regarding the expected failure rate of various modules and other system components. Further, the contractor shall furnish a set of operating manuals which should include block diagrams, make, model/type, details wiring and external connection drawings etc as required to do the testing and maintenance of the electronic modules.</p>   |   |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>53 OF 89</b> |



| CLAUSE NO.        |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |              |                |
|-------------------|---|--------------|----------------|
| <b>ANNEXURE-I</b> |   |              |                |
| S.NO.             | DESCRIPTION OF DOCUMENTS  | NO OF PRINTS | NO. OF CD-ROMs |
| 1.                | PLANT DEFINITION MANUAL-  | 2 sets       | 4 CD-ROMs      |
| 2.                | Drawings "FOR APPROVAL"   |              |                |
|                   | i) Layout drawings / P&IDs  | 6            | 2 CD - ROMs    |
|                   | ii) Other drawings  | 2            | 2 CD - ROMs    |
| 3.                | Drawings "FOR INFORMATION"  | 2            | 2 CD - ROMs    |
| 4.                | Drawings "FINAL DRAWING"  | 15           | 4 CD-ROMs      |
| 5.                | Drawings "AS BUILT "  | 15           | 4 CD-ROMs      |
| 6                 | DATASHEETS, DESIGN CALCULATIONS, PURCHASE SPECIFICATIONS, etc. and Other type of documents  |              |                |
|                   | i) For Approval   | 2            | 2 CD - ROMs    |
|                   | ii) FINAL   | 15           | 4 CD-ROMs -    |
|                   | iii) Analysis reports of equipments/ piping/ structures components/ systems employing software packages as detailed in the specifications   | 2            | 2 CD - ROMs    |
| 7.                | Erection manual "1st Submission"  | 4 Sets       | 2 CD - ROMs    |
| 8                 | Erection manual "FINAL "  | 4 Sets       | 4 CD ROMs      |
| 9                 | Operation & Maintenance manual "1st submission"   | 4            | 2 CD - ROMs    |



|  |   |  |                          |
|--|---|--|--------------------------|
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b> | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>54 OF 89</b> |
|--|---|--|--------------------------|



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                      |
|--|---|--|----------------------|
| S.NO.  | DESCRIPTION OF DOCUMENTS  | NO OF PRINTS                               | NO. OF CD-ROMs       |
| 10   | Operation & Maintenance manual "FINAL"  | 4 Sets                                     | 4 CD-ROMs            |
| 11   | Plant Hand Book "1st Submission"  | 4 Sets                                     | 2 CD ROMs            |
| 12   | Plant Hand Book "FINAL"   | 4 Sets                                     | 4 CD ROMs            |
| 13   | Commissioning and Performance Procedure manual "1st Submission"   | 4 Sets                                     | 2 CD-ROMs            |
| 14   | Commissioning and Performance Procedure manual "FINAL"  | 4 Sets                                     | 4 CD ROMs            |
| 15   | Performance and Functional GURANTEES TEST REPORT  | 4 Sets                                     | 4 CD ROMs            |
| 16   | Project completion report   | 15   | 4 CD ROMs            |
| 17   | QA programme including Organisation for implement-ation and QA systemmanual (with revision-servicing)   | 1  | 1 CD ROM             |
| 18   | Vendor details in respect of proposed vendors including contractor's evaluation report.   | 1  | 1 CD ROM             |
| 19   | Manufacturing QPs, Field QPs, Field welding schedules and their reference documents like test procedures, WPS, PQR etc.   |  |                      |
|  | (i) For review/comment  | 2  | 2 CD-ROMs            |
|  | (ii) For final approval   | 2  | 2 CD ROMs            |
| <b>KHURJA SUPER THERMAL POWER PROJECT (2X660 MW) TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO.: THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL REQUIREMENTS (GTR)</b> | <b>PAGE 55 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| S.NO.  | DESCRIPTION OF DOCUMENTS  | NO OF PRINTS                                   | NO. OF CD-ROMs           |
| 20   | Welding Manual, HeatTreatment Manuals, Storage & preservation manuals   |  |                          |
|  | 1st Submission  | 4 Sets   | 2 CD ROMs sets           |
|  | Final   | 4 sets   | 4 CD ROMs                |
| 21   | QA Documentation Package for items / equipment manufactured and and despatched to site  | 2 sets   | 4 CD ROMs                |
| 22   | QA Documentation Package for field activities on equipment / systems at site  | 2 sets   | 4 CD ROMS                |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>56 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b> |  |                          |
|--|---|--|--------------------------|
|  |   |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>57 OF 89</b> |



| CLAUSE NO.  |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |   |
|---|---|---|---|
|   | <b>ANNEXURE-II</b>  |   |   |
|   | <b>LIST OF CODES AND STANDARDS</b>  |   |   |
|   | <b>Indian Standards</b>   | <b>Title</b>  | <b>International and Internationally recognised standards</b>                   |
|   | IS:277  | Galvanised steel sheets (plain or corrugated)   |   |
|   | IS:655  | Specification for metal air duct  |   |
|   | IS:800  | Code of practice for use of structural steel in general building construction   | BS 449:1969<br>BS 5950<br>ASA A57, 1-1952                                       |
|   | IS:807  | Code of practice for design, manufacture, erection and testing (Structural portion) of cranes and hoists 6588 (Issued by Standards Association of Australia).<br>DIN 120:1936 (Sheet 1)<br>DIN 120:1936 (Sheet 2)<br>327 part-I, 1951<br>BS 466 part-II, 1960<br>BS 644:1960<br>BS 1757:1951<br>BS 2573:part-I:1960 | Draft Revision of A.S. NO. CS.2<br>SAA Crane and Hoist code<br>Doc:No. BU/4 Rev |
|   | IS:875  | Code of practice for design loads (other than earthquake) for buildings and structures<br>Leading standards (issued by Canadian Standard)<br>DIN-1055-1955 (Issued by ASA)  | National Building code of Canada (1953)-Part-IV<br><br>Design section 4.1       |
| KHURJA SUPER THERMAL POWER PROJECT (2X660 MW) TURBINE GENERATOR AND ASSOCIATED PACKAGES | TECHNICAL SPECIFICATION SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371  | GENRAL TECHNICAL REQUIREMENTS (GTR)   | PAGE<br>58 OF 89  |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |                  |
|--|---|---|------------------|
| IS:1239<br>Part-I  | Mild steel tubes  | (ISO/R 65-1957)<br>(ISO/R-64-1958)<br>(ISO/R-65-1958)<br>(BS 1387 : 1957) |                  |
| IS:1239<br>Part-II   | Mild steel tubulars and other wrought steel pipe fittings   | BS 1387 : 1967<br>BS 1387 :1967<br>BS 1740 :1965                          |                  |
| IS:2825  | Code for unfired vessels  |   |                  |
| IS:1520  | Horizontal centrifugal pumps for clear cold and fresh water   |   |                  |
| IS:1600  | Code for practice for performance of constant speed IC Engines for general purpose  |   |                  |
| IS:1601  | Specification for performance of constant speed IC Engines for general Purpose  |   |                  |
| IS:1893  | Criteria for earthquake resistant design of structures  |   |                  |
| IS1978-1971  | Line Pipe April 1969.   | API Standards 5L  |                  |
| IS:2254-1970   | Dimensions of vertical shaft motor for pumps  | IEC Pub 72-1 part I<br>NEMA Pub MG 1<br>1954                              |                  |
| IS:2266  | Steel wire ropes for general engineering purposes   | BS :302 : 1968  |                  |
| IS:2312  | Propellant type<br>Ventilation fans   |   |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR)                                    | PAGE<br>59 OF 89 |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |   |
|--|---|---|---|
| IS:2365  | Steel wire suspension ropes for lifts and hoists  | BS : 1957   |   |
| IS:3346  | Method for the determination of thermal conductivity of thermal insulation materials (two slab guarded hot plate method)  | DIN 52612 (Deutscher Normenausschuss)                                   | ASTM C 163-1964 (American Society of Testing and materials)<br>ASTM C 167-1974<br>ASTM C 177-1963 |
| IS:3354  | Outline dimensions for electric lifts.  |   |   |
| IS:3401  | Silica gel  |   |   |
| IS:3588  | Specification for electrical axial flow fans  |   |   |
| IS:3589  | Electrically welded steel pipes for water, gas and sewage (200mm to 2000 mm Nominal Diametre)   |   |   |
| IS:3677  | Unbonded rock and slag wool for thermal insulation  |   |   |
| IS:3815  | Point hook with shank for general engineering purposes  | BS 482 - 1968<br>Doc.:67/3 1284<br>(Revision of BS 2903)<br>(Issued BS) |   |
| IS:3895  | Specification for monocrystallines semiconductor rectifier cells and stacks   |   |   |
| IS:3963  | Roof extractor unit   |   |   |
| IS:3975  | Mild steel wires, strips and tapes for armouring cables   |   |   |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>                          | <b>PAGE<br/>60 OF 89</b>  |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |                          |
|--|---|---|--------------------------|
| IS:4503  | Shell and tube type heat Exchanger  |   |                          |
| IS:4540  | Specification for monory-stallines rectifire assembly equipment   |   |                          |
| IS:4671  | Expanded polystyrene for thermal insulation purpose   |   |                          |
| IS:4736  | Hot dip zinc coating on steel tubes   |   |                          |
| IS:4894  | Centrifugal fans  |   |                          |
| IS:5456  | Code of practice for testing of positive displacement type air compressors and exhauster (For Test Tolerance Only)  |   |                          |
| IS:5749  | Forged ramshorn hooks   | Entwurf DIN 15402<br>Blett 1<br>Entwurf DIN 15402<br>BS 3017-1958 |                          |
| IS:6392  | Steel pipe flanges  | BS 4504 : 1969  |                          |
| IS:6524<br>Part-I  | Code of practice for design of tower cranes<br>Static and rail mounted  | BS 2799 : 1956  |                          |
| IS:7098  | Cross linked Polyethylene insulated PVC sheathed cables   | Standard No. 1 to IPCEA (USA) Pub. No. 5-66-524                   |                          |
| IS:7373  | Specification for wrought aluminium and aluminium sheet and strips  |   |                          |
| IS:7938  | Air receivers for compressed air installation   |   |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>                    | <b>PAGE<br/>61 OF 89</b> |



| CLAUSE NO.  |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                                 |
|---|--|--|---------------------------------|
|   | <p>ISO:1217</p> <p>ASHRAE-33<br/>and air heating coils.</p> <p>ASHRAE-52-76</p> <p>ASHRAE-22-72</p> <p>ASHRAE 23-67</p> <p>ARI-450-6</p> <p>ARI-550</p> <p>ARI-410</p> <p>ARI-430/435<br/>BS:848<br/>(Part-1,2)</p> <p>BS:400</p> <p>BS:401</p> <p>CTI Code<br/>ACT-105</p> <p>ANSI-31.5</p> <p>ASME-PTC-<br/>23-1958</p> <p>AMCA A-21C</p> <p>API:618</p> <p>HYDRAULIC INSTITUTE STANDARDS.</p> | <p>Displacement compressor-Acceptance test</p> <p>Methods of testing for rating of forced circulation air cooling</p> <p>Air cleaning device used in general ventilation for removing particle matter.</p> <p>Method of testing for rating of water cooled refrigerant condensers.</p> <p>Methods of testing for rating of positive displacement refrigerant compressors.</p> <p>Standard for water cooled refrigerant condensers.</p> <p>Standard for centrifugal water chilling packages.</p> <p>Standard for forced circulation air cooling and air heating coils</p> <p>Central station AHU/Application of Central Station AHU Fans</p> <p>Low carbon steel cylinders for the storage &amp; transport of permanent gases.</p> <p>Low carbon steel cylinders for the storage &amp; transport of liquified gases.</p> <p>Acceptance test code for Water Cooling Tower.</p> <p>Refrigerant piping</p> <p>Atmospheric Water Cooling Equipment</p> <p>Test Code for air moving devices</p> <p>Reciprocating Compressor for general refinery services.</p> |                                 |
| <p><b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b></p> | <p><b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b></p>   | <p><b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b></p>  | <p><b>PAGE<br/>62 OF 89</b></p> |



|  |   |  |                  |
|--|---|--|------------------|
| CLAUSE NO.   |   <p style="text-align: center;"><b>GENERAL TECHNICAL REQUIREMENTS</b></p>  |  |                  |
|  | <p>HYDRANT SYSTEM MANUALS OF TAC.</p> <p>TAC MANUALS OF SPRAY SYSTEM</p> <p>NFPA USA/ NSC UK/ UL USA/ FM USA STANDARDS.</p> <p>INDIAN EXPLOSIVES ACT.</p> <p>INDIAN FACTORIES ACT.</p> <p>STANDARD OF TUBULAR EXCHANGER MANUFACTURER'S ASSOCIATION.</p> <p><b>CODE AND STANDARD FOR CIVIL WORKS</b></p> <p>Some of the applicable Standards, Codes and references are as follows:</p> <p><b>Excavation &amp; Filling</b></p> <p>IS: 2720 (Part-II, IV TO VIII, XIV, XXI, XXIII, XXIV, XXVII TO XXIX, XL) Methods of test for soils-determination for water content etc.</p> <p>IS: 4701                      Code of practice for earth work on canals.</p> <p>IS: 9758                      Guide lines for Dewatering during construction.</p> <p>IS: 10379                      Code of practice for field control of moisture and compaction of soils for embankment and sub-grade.</p> <p><b>Properties, Storage and Handling of Common Building Materials</b></p> <p>IS: 269                      Specification for ordinary Portland cement, 33 grade.</p> <p>IS: 383                      Specification for coarse and fine aggregates from natural sources for concrete.</p> <p>IS: 432                      Specification for mild steel and (Parts 1&amp;2) medium tensile steel bars and hard-drawn steel wires for concrete reinforcement.</p> <p>IS: 455                      Specification for Portland slag cement.</p> <p>IS: 702                      Specification for Industrial bitumen.</p> <p>IS: 712                      Specification for building limes.</p> |  |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>63 OF 89 |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| IS: 808  |   | Rolled steel Beam channel and angle sections.                              |                          |
| IS: 1077   |   | Specification for common burnt clay building bricks.                       |                          |
| IS: 1161   |   | Specification of steel tubes for structural purposes.                      |                          |
| IS: 1363   |   | Hexagon head Bolts, Screws and nuts of production grade C.                 |                          |
| IS: 1364   |   | Hexagon head Bolts, Screws and Nuts of Production grade A & B.             |                          |
| IS: 1367   |   | Technical supply conditions for Threaded fasteners.                        |                          |
| IS: 1489   |   | Specification for Portland-pozzolana cement:                               |                          |
| (Part-I)   |   | Fly ash based.   |                          |
| (Part-II)  |   | Calcined clay based.   |                          |
| IS: 1542   |   | Specification for sand for plaster.  |                          |
| IS: 1566   |   | Specification for hard-drawn steel wire fabric for concrete reinforcement. |                          |
| IS: 1786   |   | Specification for high strength deformed bars for concrete reinforcement.  |                          |
| IS: 2062   |   | Specification for steel for general structural purposes.                   |                          |
| IS: 2116   |   | Specification for sand for masonry mortars.                                |                          |
| IS: 2386   |   | Testing of aggregates for concrete.  |                          |
| (Parts-I to VIII)  |   |  |                          |
| IS: 3150   |   | Hexagonal wire netting for general purpose.                                |                          |
| IS: 3495   |   | Methods of tests of burnt clay building bricks.                            |                          |
| (Parts-I to IV)  |   |  |                          |
| IS: 3812   |   | Specification for fly ash, for use as pozzolana and admixture.             |                          |
| IS: 4031   |   | Methods of physical tests for hydraulic cement.                            |                          |
| IS: 4032   |   | Methods of chemical analysis of hydraulic cement.                          |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>                             | <b>PAGE<br/>64 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b> |   |                          |
|--|---|---|--------------------------|
| IS: 4082   |   | Recommendations on stacking and storage of construction materials at site.  |                          |
| IS: 8112   |   | Specification for 43 grade ordinary portland cement.  |                          |
| IS: 8500   |   | Medium and high strength structural steel.  |                          |
| IS: 12269  |   | 53 grade ordinary portland cement.  |                          |
| IS: 12894  |   | Specification for Fly ash lime bricks.  |                          |
| <b>Cast-In-Situ Concrete and Allied Works</b>  |   |   |                          |
| IS: 280  |   | Specification for mild steel wire for general engineering purposes.   |                          |
| IS: 456  |   | Code of practice for plain and reinforced concrete.   |                          |
| IS: 457  |   | Code of practice for general construction of plain & reinforced concrete for dams & other massive structures.                     |                          |
| IS: 516  |   | Method of test for strength of concrete.  |                          |
| IS: 650  |   | Specification for standard sand for testing of cement.  |                          |
| IS: 1199   |   | Methods of sampling and analysis of concrete.   |                          |
| IS: 1791   |   | General requirements for batch type concrete mixers.  |                          |
| IS: 1838<br>(Part-I)   |   | Specification for preformed fillers for expansion joints in concrete pavements and structures (non-extruding and resilient type). |                          |
| IS: 2204   |   | Code of practice for construction of reinforced concrete shell roof.  |                          |
| IS: 2210   |   | Criteria for the design of reinforced concrete shell structures and folded plates.  |                          |
| IS: 2438   |   | Specification for roller pan mixer.   |                          |
| IS: 2502   |   | Code of practice for bending and fixing of bars for concrete reinforcement.   |                          |
| IS: 2505   |   | General requirements for concrete vibrators, immersion type.  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>  | <b>PAGE<br/>65 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| IS: 2506   | General requirements for concrete vibrators, screed board type.   |  |                          |
| IS: 2514   | Specification for concrete vibrating tables.  |  |                          |
| IS: 2645   | Specification for Integral cement water proofing compounds.   |  |                          |
| IS: 2722   | Specification for portable swing weigh batches for concrete. (single and double bucket type)  |  |                          |
| IS: 2750   | Specification for Steel scaffolding.  |  |                          |
| IS: 2751   | Code of practice for welding of mild steel plain and deformed bars for reinforced concrete construction.  |  |                          |
| IS: 3025   | Methods of sampling and test waste water.   |  |                          |
| IS: 3366   | Specification for Pan vibrators.  |  |                          |
| IS: 3370<br>(Part I to IV)   | Code of practice for concrete structures for the storage of liquids.  |  |                          |
| IS: 3414   | Code of practice for design and installation of joints in buildings.  |  |                          |
| IS: 3550   | Methods of test for routine control for water used in industry.   |  |                          |
| IS: 3558<br>concrete.  | Code of practice for use of immersion vibrators for consolidating concrete.   |  |                          |
| IS: 4014<br>(Parts I & II)   | Code of practice for steel tubular scaffolding.   |  |                          |
| IS: 4326<br>of buildings.  | Code of practice for earthquake resistant design and construction of buildings.   |  |                          |
| IS: 4461   | Code of practice for joints in surface hydro-electric power stations.   |  |                          |
| IS: 4656   | Specification for form vibrators for concrete.  |  |                          |
| IS: 4925   | Specification for batching and mixing plant.  |  |                          |
| IS: 4990   | Specification for plywood for concrete shuttering work.   |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>66 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |   |                          |
|--|--|---|--------------------------|
|  | IS: 4995<br>(Parts I & II)<br><br>IS: 5256<br><br>IS: 5525<br>concrete work.<br><br>IS: 5624<br><br>IS: 6461<br><br>IS: 6494<br><br>IS: 6509<br><br>IS: 7861<br><br>IS: 9012<br><br>IS: 9103<br><br>IS: 9417<br><br>IS: 10262<br><br>IS: 11384<br><br>IS: 11504<br><br>IS: 12118<br><br>IS: 12200<br><br>IS: 13311<br>Part-1 | Criteria for design of reinforced concrete bins for the storage of granular and powdery materials.<br><br>Code or practice for sealing joints in concrete lining on canals.<br><br>Recommendations for detailing of reinforcement in reinforced concrete work.<br><br>Specification for foundation bolts.<br><br>Glossary of terms relating to cement concrete.<br><br>Code of practice for water proofing of underground water reservoirs and swimming pools.<br><br>Code of practice for installation of joints in concrete pavements.<br><br>Code of practice for extreme weather concreting. (Parts I & II)<br><br>Recommended practice for shot concreting.<br><br>Specification for admixtures for concrete.<br><br>Recommendations for welding cold worked steel bars for reinforced concrete construction.<br><br>Recommended guidelines for concrete mix design.<br><br>Code of practice for composite construction in structural steel and concrete.<br><br>Criteria for structural design of reinforced concrete natural draught cooling towers.<br><br>Specification for two-parts poly sulphide.<br><br>Code of practice for provision of water stops at transverse contraction joints in masonry and concrete dams.<br><br>Method of non-destructive testing of concrete.<br><br>Ultrasonic pulse velocity. |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>67 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                  |
|--|--|--|------------------|
|  | Part-2<br><br>SP:23<br><br>SP: 24<br><br>SP: 34<br><br><b>Precast Concrete Works</b><br><br>SP: 7(PartVI/<br><br>IS: 10297<br><br>IS: 10505<br><br><b>Masonry and Allied Works</b><br><br>IS: 1905<br><br>IS: 2212<br><br>IS: 2250<br><br>SP: 20<br><br><b>Sheeting Works</b><br><br>IS:277<br><br>IS: 459<br><br>IS: 513<br><br>IS: 730 | Rebound hammer.<br><br>Handbook of concrete mixes<br><br>Explanatory Handbook on IS: 456-1978<br><br>Handbook on concrete reinforcement and detailing.<br><br>National Building Code- Structural design of prefabrication and Sec.7) systems building.<br><br>Code of practice for design and construction of floors and roofs using precast reinforced/prestressed concrete ribbed or cored slab units.<br><br>Code of practice for construction of floors and roofs using pre-cast reinforced concrete units.<br><br>Code of Practice for Structural Safety of Buildings-Masonry walls.<br><br>Code of Practice for Brickwork.<br><br>Code of Practice for Preparation and use of Masonry Mortar.<br><br>Explanatory hand book on masonry code.<br><br>Galvanised steel sheets (plain or corrugated).<br><br>Unreinforced corrugated and semi-corrugated asbestos cement sheets.<br><br>Cold-rolled carbon steel sheets.<br><br>Specification for fixing accessories for corrugated sheet roofing. |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371  | GENRAL TECHNICAL<br>REQUIREMENTS (GTR)   | PAGE<br>68 OF 89 |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|--|--|--------------------------|
|  | IS: 1626<br>IS: 2527<br>IS: 3007<br>IS: 5913<br>IS: 7178<br>IS: 8183<br>IS: 8869<br>IS: 12093<br>IS: 12866<br>IS: 14246<br><br><b>Fabrication and Erection of Structural Steel Work</b><br>IS: 2016<br>IS: 814<br>IS: 1852<br>IS: 3502<br>IS: 6911<br>IS: 3757<br>IS: 6623 | Specification for Asbestos cement building pipes and pipe fittings, gutters and gutter fittings and roofing fittings.<br>Code of practice for fixing rain water gutters and down pipe for roof drainage.<br>Code of practice for laying of asbestos cement sheets.<br>Methods of test for asbestos cement products.<br>Technical supply conditions for tapping screw.<br>Bonded mineral wool.<br>Washers for corrugated sheet roofing.<br>Code of practice for laying and fixing of sloped roof covering using plain and corrugated galvanised steel sheets.<br>Plastic translucent sheets made from thermosetting polyster resin (glass fibre reinforced).<br>Specification for continuously pre-painted galvanised steel sheets and coils. |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>69 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| IS: 6649   | High Tensile friction grip washers.   |  |                          |
| IS: 800  | Code of practice for use of structural steel in general building construction.  |  |                          |
| IS: 816  | Code of practice for use of Metal Arc Welding for General Construction.   |  |                          |
| IS: 4000   | Code of practice for assembly of structural joints using high tensile friction grip fasteners.  |  |                          |
| IS: 9595   | Code of procedure of Manual Metal Arc Welding of Mild Steel.  |  |                          |
| IS: 817  | Code of practice for Training and Testing of Metal Arc Welders.   |  |                          |
| IS: 1811   | Qualifying tests for Metal Arc Welders (engaged in welding structures other than pipes).  |  |                          |
| IS: 9178   | Criteria for Design of steel bins for storage of Bulk Materials.  |  |                          |
| IS: 9006   | Recommended Practice for Welding of Clad Steel.   |  |                          |
| IS: 7215   | Tolerances for fabrication steel structures.  |  |                          |
| IS: 12843  | Tolerance for erection of structural steel.   |  |                          |
| IS: 4353   | Recommendations for submerged arc welding of mild steel and low alloy steels.   |  |                          |
| SP: 6<br>(Part 1 to 7)   | ISI Hand book for structural Engineers.   |  |                          |
| IS: 1608   | Method of Tensile Testing of Steel products other than sheets, strip, wire and tube.  |  |                          |
| IS: 1599   | Method of Bend Tests for Steel products other than sheet, strip, wire and tube  |  |                          |
| IS : 228   | Methods of chemical Analysis of pig iron, cast iron and plain carbon and low alloy steel.   |  |                          |
| IS : 2595  | Code of Practice for Radio graphic testing.   |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>70 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                          |
|--|---|---|--------------------------|
|  | IS : 1182<br><br>IS : 3664<br><br>IS : 3613<br><br>IS : 3658<br><br>IS : 5334<br><br><b>Plastering and Allied Works</b><br><br>IS : 1635<br><br>IS : 1661<br><br>IS : 2333<br><br>IS : 2402<br><br>IS : 2547<br><br>IS : 3150<br><br><b>Acid and Alkali Resistant Lining</b><br><br>IS : 158<br><br>IS : 412<br><br>IS : 4441<br><br>IS : 4443<br><br>IS : 4456 | Recommended practice for Radiographic Examination of fusion welded butt joints in steel plates.<br><br>Code of practice for Ultra sonic Testing by pulse echo method.<br><br>Acceptance tests for wire flux combination for submerged Arc Welding.<br><br>Code of practice for Liquid penetrant Flaw Detection.<br><br>Code of practice for Magnetic Particle Flaw Detection of Welds.<br><br>Code of practice for field slaking of Building lime and preparation of putty.<br><br>Application of cement and cement lime plaster finishes.<br><br>Plaster-of-paris.<br><br>Code of practice for external rendered finishes.<br><br>Gypsum building plaster.<br><br>Hexagonal wire netting for general purpose.<br><br>Ready mixed paint, brushing, bituminous, black, lead free, acid, alkali & heat resisting.<br><br>Specification for expanded metal steel sheets for general purpose.<br><br>Code of practice for use of silicate type chemical resistant mortars.<br><br>Code of practice for use of resin type chemical resistant mortars.<br><br>Method of test for chemical resistant tiles.<br>(Part I & II) |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>  | <b>PAGE<br/>71 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b> |   |                          |
|--|---|---|--------------------------|
| IS : 4457  | Specification for ceramic unglazed vitreous acid resistant tiles.   |   |                          |
| IS : 4832  | Specification for chemical resistant mortars.   |   |                          |
|  | Part I Silicate type  |   |                          |
|  | Part II Resin type  |   |                          |
|  | Part III Sulphur type   |   |                          |
| IS : 4860  | Specification for acid resistant bricks.  |   |                          |
| IS : 9510  | Specification for bitumasitic, Acid resisting grade.  |   |                          |
| <b>Water Supply, Drainage and Sanitation</b>   |   |   |                          |
| IS : 458   | Specification for concrete pipes.   |   |                          |
| IS : 554   | Dimensions for pipe threads, where pressure tight joints are made on thread.  |   |                          |
| IS : 651   | Specification for salt glazed stoneware pipes.  |   |                          |
| IS : 774   | Flushing cisterns for water closets and urinals.  |   |                          |
| IS : 775   | Cast iron brackets and supports for wash basins and sinks.  |   |                          |
| IS : 778   | Copper alloy gate, globe and check valves for water works purposes.   |   |                          |
| IS : 781   | Cast copper alloy screw down bib taps and stop valves for water services.   |   |                          |
| IS : 782   | Caulking lead.  |   |                          |
| IS : 783   | Code of practice for laying of concrete pipes.  |   |                          |
| IS : 1172  | Basic requirements for water supply, drainage and sanitation.   |   |                          |
| IS : 1230  | Cast iron rain water pipes and fittings.  |   |                          |
| IS : 1239  | Mild steel tubes, tubulars and other wrought steel fittings.  |   |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>72 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| IS : 1536  |   | Centrifugally cast (Spun) iron pressure pipes for water, gas and sewage.                       |                          |
| IS : 1537  |   | Vertically cast iron pressure pipes for water, gas and sewage.                                 |                          |
| IS : 1538  |   | Cast iron fittings for pressure pipe for water, gas and sewage.                                |                          |
| IS : 1703  |   | Ball valves (horizontal plunger type) including float for water supply purposes.               |                          |
| IS : 1726  |   | Cast iron manhole covers and frames.   |                          |
| IS : 1729  |   | Sand cast iron spigot and socket, soil, water and ventilating pipes, fittings and accessories. |                          |
| IS : 1742  |   | Code of practice for building drainage.  |                          |
| IS : 1795  |   | Pillar taps for water supply purposes.   |                          |
| IS : 1879  |   | Malleable cast iron pipe fittings.   |                          |
| IS : 2064  |   | Code of practice for selection, installation and maintenance of sanitary appliances.           |                          |
| IS : 2065  |   | Code of practice for water supply in building.   |                          |
| IS : 2326  |   | Automatic flushing cisterns for urinals.   |                          |
| IS : 2470<br>(Part-I & II)   |   | Code of practice for installation of septic tanks.   |                          |
| IS : 2501  |   | Copper tubes for general engineering purposes.   |                          |
| IS : 2548  |   | Plastic seat and cover for water-closets.  |                          |
| IS : 2556<br>(Part 1 to 15)  |   | Vitreous sanitary appliances (vitreous china).   |                          |
| IS : 2963  |   | Non-ferrous waste fittings for wash basins and sinks.  |                          |
| IS : 3114  |   | Code of practice for laying of cast iron pipes.  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>  | <b>PAGE<br/>73 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|---|--|--------------------------|
| IS : 3311  | Waste plug and its accessories for sinks and wash basins.   |  |                          |
| IS : 3438  | Silvered glass mirrors for general purposes.  |  |                          |
| IS : 3486  | Cast iron spigot and socket drain pipes.  |  |                          |
| IS : 3589  | Electrically welded steel pipes for water, gas and sewage (200mm to 2000mm nominal diameter).   |  |                          |
| IS : 3989  | Centrifugally cast (Spun) iron spigot and socket soil, waste and ventilating pipes, fittings and accessories.   |  |                          |
| IS : 4111  | Code of practice for ancillary structure in sewerage system.  |  |                          |
| (Part I to IV)   |   |  |                          |
| IS : 4127  | Code of practice for laying of glazed stone-ware pipes.   |  |                          |
| IS : 4764  | Tolerance limits for sewage effluents discharged into inland-surface waters.  |  |                          |
| IS : 4827  | Electro plated coating of nickel and chromium on copper and copper alloys.  |  |                          |
| IS : 5329  | Code of practice for sanitary pipe work above ground for buildings.   |  |                          |
| IS : 5382  | Rubber sealing rings for gas mains, water mains and sewers.   |  |                          |
| IS : 5822  | Code of practice for laying of welded steel pipes for water supply.   |  |                          |
| IS : 5961  | Cast iron grating for drainage purpose.   |  |                          |
| IS : 7740  | Code of practice for road gullies.  |  |                          |
| IS : 8931  | Cast copper alloy fancy bib taps and stop valves for water services.  |  |                          |
| IS : 8934  | Cast copper alloy fancy pillar taps for water services.   |  |                          |
| IS : 9762  | Polyethylene floats for ball valves.  |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>74 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|---|--|--------------------------|
|  | IS : 10446<br>IS : 10592<br>IS : 12592<br>IS : 12701<br>SP: 35<br>-<br><br><b>Doors, Windows and Allied Works</b><br><br>IS : 204<br>Part-I<br>Part-II<br>IS : 208<br>IS : 281<br>IS : 362<br>IS : 420<br>IS : 1003<br>Part-I door<br>IS : 1038<br>IS : 1081<br>IS : 1341<br>IS : 1361<br>IS : 1823 | Glossary of terms for water supply and sanitation.<br>Industrial emergency showers, eye and face fountains and combination units.<br>Specification for precast concrete manhole covers and frames.<br>Rotational moulded polyethylene water storage tanks.<br>Hand book on water supply and drainage.<br>Manual on Sewerage and sewage treatment (Published by CPH & EEO) As updated.<br><br>Tower Bolts<br>Ferrous metals.<br>Nonferrous metals.<br>Door Handles.<br>Mild steel sliding door bolts for use with padlocks.<br>Parliament Hinges.<br>Specification for putty, for use on metal frames.<br>Specification for timber panelled and glazed shutters- (Part-I) shutters.<br>Steel doors, windows and ventilators.<br>Code of practice for fixing and glazing of metal (steel and aluminium) doors, windows and ventilators.<br>Steel butt hinges.<br>Steel windows for industrial buildings.<br>Floor door stoppers. |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>75 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                          |
|--|--|--|--------------------------|
|  | IS : 1868<br><br>IS : 2202<br>(Part-II)<br><br>IS:2209<br><br>IS:2553<br><br>IS:2835<br><br>IS:3548<br><br>IS:3564<br><br>IS : 3614<br><br>IS:4351<br><br>IS:5187<br><br>IS:5437<br><br>IS:6248<br><br>IS:6315<br><br>IS:7196<br><br>IS:7452<br><br>IS:10019<br><br>IS:10451<br><br>IS:10521<br><br><b>Roof Water Proofing and Allied Works</b><br><br>IS:1203 | Anodic coatings on Aluminium and its alloys.<br><br>Specification for wooden flush door shutters (solid core type);<br>particle board face panels and hard board face panels<br><br>Mortice locks (vertical type).<br><br>Safety glass<br><br>Flat transparent sheet glass.<br><br>Code of practice for glazing in buildings.<br><br>Door closers (Hydraulically regulated).<br><br>Fire check doors; plate, metal covered and rolling type.<br><br>Steel door frames.<br><br>Flush bolts.<br><br>Wired and figured glass<br><br>Metal rolling shutters and rolling grills.<br><br>Floor springs (hydraulically regulated) for heavy doors.<br><br>Hold fasts.<br><br>Hot rolled steel sections for doors, windows and ventilators.<br><br>Mild steel stays and fasteners.<br><br>Steel sliding shutters (top hung type).<br><br>Collapsible gates.<br><br>Methods of testing tar and bitumen. |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>76 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |  |
|--|---|---|--|
|  | IS:1322   | Specification for bitumen felts for water proofing and damp proofing.   |  |
|  | IS:1346   | Code of practice for water proofing of roofs with bitumen felts.  |  |
|  | IS:1580   | Specification for bituminous compound for water proofing and caulking purposes.                                     |  |
|  | IS:3067   | Code of practice for general design details and preparatory work for damp proofing and water proofing of buildings. |  |
|  | IS:3384   | Specification for bitumen primer for use in water proofing and damp proofing.                                       |  |
|  | <b>Floor Finishes and Allied Works</b>  |   |  |
|  | IS:1237   | Specification for cement concrete flooring tiles.   |  |
|  | IS:1443   | Code of practice for laying and finishing of cement concrete flooring tiles.  |  |
|  | IS:2114   | Code of practice for laying in-situ terrazzo floor finish.  |  |
|  | IS:2571   | Code of practice for laying in-situ cement concrete flooring.   |  |
|  | IS:3462   | Specification for unbacked flexible PVC flooring.   |  |
|  | IS:4971   | Recommendations for selection of industrial floor finishes.   |  |
|  | IS:5318   | Code of practice for laying of flexible PVC sheet and tile flooring.  |  |
|  | IS:8042   | Specification for white portland cement.  |  |
|  | IS:13801  | Specification for chequered cement concrete flooring tiles.   |  |
|  | <b>Painting and Allied Works</b>  |   |  |
|  | IS:162  | Specification for fire resisting silicate type, brushing, for use on wood, colour as required.                      |  |
|  | IS:1477   | Code of practice for painting of ferrous metals in buildings.   |  |
|  | Part-I  | Pretreatment.   |  |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> |   | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>                 | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b><br><br><b>PAGE<br/>77 OF 89</b> |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|--|--|--------------------------|
|  | Part-II<br><br>IS:1650<br><br>IS:2074<br><br>IS:2338<br><br>Part-I<br>Part-II<br><br>IS:2395<br><br>Part-I<br>Part-II<br><br>IS:2524<br><br>Part-I<br>Part-II<br><br>IS:2932<br><br>IS:2933<br>IS:4759<br><br>IS:5410<br>IS:5411<br>(Part-I)<br>IS:6278<br>IS:10403<br><br><b>Piling and Foundation</b><br><br>IS:1080 | Painting.<br><br>Specification for colours for building and decorative finishes.<br><br>Specification for red oxide-zinc chrome, priming, ready mixed paint air drying.<br><br>Code of practice for finishing of wood and wood based materials.<br><br>Operations and workmanship<br>Schedules<br><br>Code of practice for painting concrete, masonry and plaster surfaces.<br><br>Operations and workmanship.<br>Schedule.<br><br>Code of practice for painting of nonferrous metals in buildings.<br><br>Pretreatment.<br><br>Painting.<br><br>Specification of synthetic enamel paint, exterior, under-coating and finishing.<br><br>Specification enamel paint, under coating and finishing.<br><br>Code of practice for hot dip zinc coating on structural steel and other allied products.<br><br>Specification for cement paint<br>Specification for plastic emulsion paint-for exterior use<br><br>Code of practices for white washing and colour washing.<br><br>Glossary of terms relating to building finishes.<br><br>Code of practice for design and construction of simple spread foundations. |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>78 OF 89</b> |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |   |   |
|--|---|---|---|
|  | IS:1904<br>IS:2911<br>IS:2950<br>IS:2974<br>(Part-I TO V)<br>IS:6403<br>IS:8009<br>Part-I<br>Part-II<br>IS:12070<br>DIN:4024<br>VDI:2056<br>VDI:2060<br><b>Stop Log and Trash Rack</b><br>IS:4622<br>IS:5620<br>IS:11388<br>IS:11855<br><b>Roads</b><br>IRC:5<br>IRC:14<br>IRC:16 | Code of practice for design and construction of foundations in Soils; General Requirements.<br>Code of practice for designs and construction of Pile foundations (Relevant Parts).<br>Code of practice for designs and construction of Raft (Part-I) foundation.<br>Code of practice for design and construction of machine foundations.<br>Code of practice for determination of Allowable Bearing pressure on Shallow foundation.<br>Code of practice for calculation of settlement of foundation subjected to symmetrical vertical loads.<br>Shallow foundations.<br>Deep foundations.<br>Code of practice for design and construction of shallow foundations on rocks.<br>Flexible supporting structures for machines with rotating machines.<br>Criteria for assessing mechanical vibrations of machines.<br>Criteria for assessing rotating imbalances in machines. | Recommendations for fixed - wheel gates structural design.<br>Recommendations for structural design criteria for low head slide gates.<br>Recommendations for design of trash rack for intakes.<br>General requirements for rubber seals for hydraulic gates. |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR)  | PAGE<br>79 OF 89  |



| CLAUSE NO.  |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                  |
|---|---|---|------------------|
|   | IRC:19<br>IRC:21<br>IRC:34<br>IRC:36<br>IRC:37<br>IRC:56<br>IRC:73<br>IRC:86<br>IRC:SP:13<br>IRC - Publication<br>IS:73<br><b>Loadings</b><br>IS:875<br>(Pt. I to V)<br>IS:1893<br>IS:4091<br>IRC:6<br>M.O.T.<br><b>Safety</b><br>IS:3696<br>(Part I & II)<br>IS:3764<br>IS:4081<br>IS:4130 | Standard specifications and code of practice for water bound macadam.<br>Standard specifications and Code of practice for road bridges, section-III - Cement concrete (plain and reinforced).<br>Recommendations for road construction in waterlogged areas.<br>Recommended practice for the construction of earth embankments for road works.<br>Guidelines for the Design of flexible pavements.<br>Recommended practice for treatment of embankment slopes for erosion control.<br>Geometric design standards for rural (non-urban) highways.<br>Geometric Design standards for urban roads in plains.<br>Guidelines for the design of small bridges & culverts.<br>Ministry of Surface Transport (Roads Wing), Specifications for road and bridge works.<br>Specification for paving bitumen<br>Code of practice for design loads other than earthquake) for buildings and structures.<br>Criteria for earthquake resistant design of structures.<br>Code of Practice for design and construction of foundation for transmission line towers & poles.<br>Standard specifications & code of practice for road bridges, Section-II Loads and stresses.<br>Deptt. of railways Bridge Rules.<br>Safety code for scaffolds and ladders.<br>Safety code for excavation work.<br>Safety code for blasting and related drilling operations.<br>Safety code for demolition of buildings. |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR)  | PAGE<br>80 OF 89 |



| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |   |
|--|---|---|---|
|  | IS:5121<br>IS:5916<br>IS:7205<br>IS:7293<br>IS:7969<br>IS:11769<br>- Indian Explosives Act. 1940 as updated.<br><br><b>Architectural design of buildings</b><br><br>SP:7<br>SP:41<br><br><b>Miscellaneous</b><br><br>IS:802<br>(Relevant parts)<br>IS:803<br>IS:10430<br>IS:11592<br>IS:12867<br>CIRIA<br><br>Publication | Safety code for piling and other deep foundations.<br>Safety code for construction involving use of hot bituminous materials.<br>Safety code for erection on structural steelwork.<br>Safety code for working with construction machinery.<br>Safety code for handling and storage of building materials<br>Guidelines for safe use of products containing asbestos.<br><br>National Building Code of India<br>Hand book on functional requirements of buildings (other than industrial buildings)<br><br>Code of practice for use of structural steel in<br>overhead transmission line towers.<br>Code of practice for design, fabrication and erection of vertical mild steel cylindrically welded in storage tanks.<br>Criteria for design of lined canals and liner for selection of type of lining.<br>Code of practice for selection and design of belt conveyors.<br>PVC handrails covers.<br>Design and construction of buried thin-wall pipes. | <b>REFERENCE CODES AND STANDARDS FOR CONTROL AND INSTRUMENTATION</b><br><br>The design, manufacture, inspection, testing & installation of all equipment and system covered under this specification shall conform to the latest editions of codes and standards mentioned below and all other applicable VDE, IEEE, ANSI, ASME, NEC, NEMA, ISA AND Indian Standards and their equivalents. |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENERAL TECHNICAL<br/>REQUIREMENTS (GTR)</b>   | <b>PAGE<br/>81 OF 89</b>  |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |                  |
|--|--|---|------------------|
|  | <p><b>Temperature Measurements</b></p> <ol style="list-style-type: none"> <li>1. Instrument and apparatus for temperature measurement - ASME PTC 19.3 (1974).</li> <li>2. Temperature measurement - Thermocouples ANSI MC 96.1 - 1982.</li> <li>3. Temperature measurement by electrical Resistance thermometers - IS:2806.</li> <li>4. Thermometer - element - Platinum resistance - IS:2848.</li> </ol> <p><b>Pressure Measurements</b></p> <ol style="list-style-type: none"> <li>1.               <ol style="list-style-type: none"> <li>a) Instruments and apparatus for pressure measurement - ASME PTC 19.2 (1964).</li> <li>b) Electronic transmitters BS:6447.</li> </ol> </li> <li>2. Bourdon tube pressure and vacuum gauges - IS:3624 - 1966.</li> <li>3. Process operated switch devices (Pr. Switch) BS-6134.</li> </ol> <p><b>Flow Measurements</b></p> <p>Instruments and apparatus for flow measurements - ASME PTC 19.5 (1972) Interim supplement, Part-II.</p> <p>Measurement of fluid flow in closed conduits - BS-1042.</p> <p><b>Electronic Measuring Instrument &amp; Control Hardware/ Software</b></p> <ol style="list-style-type: none"> <li>1. Automatic null balancing electrical measuring instruments - ANSI C 39.4 (Rev. 1973): IS:9319.</li> <li>2. Safety requirements for electrical and electronic measuring and controlling instrument - ANSI C 39.5 - 1974.</li> <li>3. Compatibility of analog signals for electronic industrial process instruments - ISA - S 50.1 (1982) ANSI MC 12.1 - 1975.</li> <li>4. Dynamic response testing of process control instrumentation ISA - S 26 (1968).</li> <li>5. Surge Withstand Capability (SWC) tests - ANSI C 37.90 a/IEEE-472 or suitable class of IEC-255-4 equivalent to ANSI C37.90a/IEEE-472.</li> <li>6. Printed circuit boards - IPC TM - 650, IEC 326 C.</li> </ol> |   |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371  | GENERAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>82 OF 89 |



| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|---|--|--------------------------|
|  | <p>7. General requirement and tests for printed wiring boards - IS 7405 (Part-I) 1973.</p> <p>8. Edge socket connectors - IEC 130-11.</p> <p>9. Requirements and methods of testing of wire wrap terminations DIN 41611 Part-2.</p> <p>10. Dimensions of attachment plugs &amp; receptacles - ANSI C 73 - 1973 (Supplement ANSI C 73 a - 1980).</p> <p>11. Direct acting electrical indicating instrument - IS:1248 - 1968 (R).</p> <p>12. Standard Digital Interface for Programmable Instrumentation - IEEE-488.2 - 1990.</p> <p>13. Information Processing Systems - Local Area Networks - Part 2 : Logical Link Control - IEEE-802.2 - 1989.</p> <p>14. Standard for Local Area Networks : Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1985.</p> <p>15. Supplements A, B, C and E to Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1988.</p> <p>16. Standard for Local Area Networks : Token - Passing Bus Access Method - IEEE-802.4 - 1985.</p> <p>17. Standard for Local Area Networks : Token - Ring Access Method and Physical Layer Specification - IEEE-802.5 - 1985.</p> <p>18. IEEE Guide to Software Requirements Specifications - IEEE-830 - 1984.</p> <p>19. Hardware Testing of Digital Process Computers - ISA RP55.1 - 1983.</p> <p>20. Electromagnetic Susceptibility of Process Control Instrumentation - SAMA PMC 33.1 - 1978.</p> <p>21. Interface Between the Data Terminal Equipment and Data Circuit - Terminating Equipment Employing Serial Binary Data Interchange - EIA-232-D-1987.</p> <p>22. Electromagnetic Compatibility for Industrial Process Measurement and Control Equipment, Part 3 : Radiated Electromagnetic Field Requirements - IEC 801-3-1984.</p> <p><b>Instrument Switches and Contact</b></p> |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>83 OF 89</b> |

| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                  |
|--|---|--|------------------|
|  | <p>1. Contact rating - AC services NEMA ICS 2 - 1978 (with revision through May 1983), Part - 2-125, A6000.</p> <p>2. Contact rating - DC services NEMA ICS 2-1978 Part-2 125, N600.</p> <p><b>Enclosures</b></p> <p>1. Type of Enclosures - NEMA ICS Part - 6 - 1978 (with Rev. 1 4/80) through 110.22 (Type 4 to 13).</p> <p>2. Racks, panels and associated equipment - EIA : RS - 310 C- 1983 (ANSI C 83.9 - 1972).</p> <p>3. Protection class for Enclosures, cabinets, control panels &amp; desks - IS:2147 - 1962.</p> <p><b>Apparatus, enclosures and installation practices in hazardous area</b></p> <p>1. Classification of hazardous area - NFPA 70 - 1984, Article 500.</p> <p>2. Electrical Instruments in hazardous dust location - ISA - 512.11, 1973.</p> <p>3. Intrinsically safe apparatus - NFPA 493 1978.</p> <p>4. Purged and pressurised enclosure for electrical equipment in hazardous location - NFPA 496-1982.</p> <p>5. Enclosures for Industrial Controls and Systems - NEMA IS 1.1 - 1977.</p> <p><b>Sampling System</b></p> <p>1. Stainless steel material of tubing and valves for sampling system - ASTM 296-82, Grade 7 P 316.</p> <p>2. Submerged helical coil heat exchangers for sample coolers ASTM D11 92-1977.</p> <p>3. Water and steam in power cycle - ASME PTC 19.11.</p> <p>4. Standard methods of sampling system - ASTM D 1066-99.</p> <p><b>Annunciators</b></p> <p>1. Specifications and guides for the use of general purpose annunciators - ISA S 19.1, 1979.</p> <p>2. Surge withstand capability tests - ANSI C 37.90a - 1989/IEEE-472 or suitable class of IEC 255-4 equivalent to ANSI C37.90a 1989/IEEE-472</p> |  |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>84 OF 89 |

| CLAUSE NO.   |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |  |                  |
|--|--|--|------------------|
|  | <p>3. Damp heat cycling test - IS:2106</p> <p>4. Specification for Electromagnetic Susceptibility - SAMA DMC 33, 1/78</p> <p><b>Protections</b></p> <p>1. Relays and relay system associated with electric power apparatus. ANSI C 37.90, 1 - 1989.</p> <p>2. General requirements &amp; tests for switching devices for control and auxiliary circuits including contactor relays - IS:6875 (Part-I) - 1973.</p> <p>3. Turbine water damage prevention - ASME TDP-1-1980.</p> <p>4. Boiler safety interlocks - NFPA Section 85 B - 1984, 85 C - 1991.</p> <p><b>UPS System</b></p> <p>1. Practices and requirements for semi-conductor power rectifiers - ANSI C 34.2, 1973.</p> <p>2. Relays and relays system associated with electrical power apparatus - ANSI C 3.90 - 1983.</p> <p>3. Surge withstand capability test - ANSI C 37.90 1 -1989.</p> <p>4. Performance testing of UPS - IEC 146.</p> <p>5. Stationary cells &amp; Batteries Lead Acid type (with tubular positive plates) specification IS-1651-1991.</p> <p>6. Recommended practice for sizing large lead storage batteries for generating stations &amp; sub-stations - IEEE-485-1985.</p> <p>7. Printed Circuit Board - IPC TM 650, IEC 326C.</p> <p>8. General Requirements &amp; tests for printed wiring boards, IS:7405 (Part-I) 1973.</p> <p><b>Control Valves</b></p> <p>1. Control valve sizing - Compressible &amp; Incompressible fluids - ISA S 75.01-1985.</p> <p>2. Face to face dimensions of control valves - ANSI B 16.00 - 1973.</p> |  |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371  | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>85 OF 89 |

| CLAUSE NO.  |   <b>GENERAL TECHNICAL REQUIREMENTS</b>  |   |                                |
|---|--|---|--------------------------------|
|   | <p>3. ISA Hand Book of Control Valves - (ISBN : B: 1047-087664-234-2).</p> <p>4. Codes for pressure piping - ANSI B 31.1</p> <p>5. Control Valve leak class - ISA RP 39.6</p> <p><b>Process Connection &amp; Piping</b></p> <p>1. Codes for pressure piping "power piping" - ANSI B 31.1.</p> <p>2. Seamless carbon steel pipe ASTM - A - 106.</p> <p>3. Forged &amp; Rolled Alloy steel pipe flanges, forged fittings and valves and parts - ASTM - A - 182.</p> <p>4. Material for socket welded fittings - ASTM - A - 105.</p> <p>5. Seamless ferritic alloy steep pipe - ASTM - A - 335.</p> <p>6. Pipe fittings of wrought carbon steel and alloy steel - ASTM - A - 234.</p> <p>7. Composition bronze of ounce metal castings - ASTM - B - 62.</p> <p>8. Seamless Copper tube, bright annealed - ASTM - B - 168.</p> <p>9. Seamless copper tube - ASTM - B - 75.</p> <p>10. Dimension of fittings - ANSI - B - 16.11.</p> <p>11. Valves flanged and butt welding ends - ANSI - B - 16.34.</p> <p><b>Instrument Tubing</b></p> <p>1. Seamless carbon steel pipe - ASTM - A 106.</p> <p>2. Material of socketweld fittings - ASTM - A105.</p> <p>3. Dimensions of fittings - ANSI - B - 16.11.</p> <p>4. Code for pressure piping, welding, hydrostatic testing - ANSI B 31.1.</p> <p><b>Cables</b></p> <p>1. Thermocouples extension wires/cables - ANSI MC 96.1 - 1992.</p> <p>2. Requirements for copper conductor-Wiring cables for telecommunications &amp; information processing system - VDE:0815.</p> |   |                                |
| <b>KHURJA SUPER THERMAL POWER PROJECT</b><br>(2X660 MW)<br><b>TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION</b><br><b>SECTION – VI, PART-C</b><br><b>BID DOC. NO.:</b><br><b>THDC/RKSH/CC-9915-371</b>  | <b>GENERAL TECHNICAL</b><br><b>REQUIREMENTS (GTR)</b> | <b>PAGE</b><br><b>86 OF 89</b> |

| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>    |   |                  |
|--|---|---|------------------|
|  | <p>3. Colour coding of single or multi-pair cables - ICEA - S - 61-402 (third edition) NEMA WCS - 1979 with revisions through 2/83.</p> <p>4. Insulation &amp; Sheathing compounds for cables : VDE 0207 (Part-4, 5 &amp; 6).</p> <p>5. Guide design and installation of cable systems in power generating stations ( insulation, jacket materials) - IEEE Std. 422-1977.</p> <p>6. Rules for Testing insulated cables and flexible cables : VVDE - 0472</p> <p>7. Requirements of vertical flame propagation test - IEEE 383 - 1974 (R 1980)</p> <p>8. Standard specification for tinned soft or annealed copper wire for electrical purpose - ASTM B-33-81.</p> <p>9. Oxygen index and temperature index test - ASTM D - 2863.</p> <p>10. Smoke density measurement test - ASTM D - 2843.</p> <p>11. Acid gas generation test - IEC - 754 - 1.</p> <p>12. Swedish Chimney test - SEN - 4241475 (F3).</p> <p>13. Teflon (FEP) insulation &amp; sheath test - ASTM D - 2116.</p> <p>14. Thermocouple compensating cables - Testing requirements &amp; sampling plan IS:8784.</p> <p>15. PVC insulated electric cables for working voltage upto and including 1100 V - IS:1554 (Part-I).</p> <p><b>Cable Trays, Conduits</b></p> <p>1. Guide for design and installation of cable systems in power generating station (Cable trays, support systems, conduits) - IEEE Std. 422, 1977, NEMA VE-1 1979, NFPA 70-1984.</p> <p>2. -do- Test Standards. NEMA VE-1-1979.</p> <p>3. Zinc coating "hot dip" on assembled products for galvanising of carbon steel cable trays - ASTM A - 386-78.</p> <p><b>Public Address System</b></p> <p>1. Specifications for loud speakers - IS:7741 (Part-I, II and III)</p> <p>2. Code of safety requirement for electric mains operated audio amplifiers - IS:1301</p> |   |                  |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | GENERAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>87 OF 89 |

| CLAUSE NO.   |  <b>GENERAL TECHNICAL REQUIREMENTS</b>   |  |                          |
|--|--|--|--------------------------|
|  | <p>3. Specification for Public Address Amplifiers - IS:10426.</p> <p>4. Code of practice for outdoor installation of PA system - IS:1982.</p> <p>5. Code of practice for installation for indoor amplifying and sound distribution system - IS:1881.</p> <p>6. Basic environmental testing procedures for electronic and electrical items - IS:9000.</p> <p>7. Characteristics and methods of measurements for sound system equipment - IS:9302</p> <p>8. Code of practice of electrical wiring installations (System voltage not exceeding 650 volts) - IS:732</p> <p>9. Rigid steel conduits for electric wiring - IS:9537 (Part-I and II)</p> <p>10. Fittings for rigid steel conduits for electrical wiring - IS:2667</p> <p>11. Degree of protection provided by enclosure for low voltage switchgear and control gear - IS:2147.</p> <p><b>Vibration Monitoring System</b></p> <p>1. API 670 - 1994</p> <p>2. BS : 4675 Part-2</p> |  |                          |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-C<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>GENRAL TECHNICAL<br/>REQUIREMENTS (GTR)</b> | <b>PAGE<br/>88 OF 89</b> |







ANNEXURE - V

| Sl. No.  |  | DRG No. for Weld Location and identification mark |  | Description of parts to be welded |  | Mtl. Spec. |  | Dimensions |  | Process of welding |  | Type of weld |  | Electrode filler spec. |  | WPS No. |  | Min. pre-heat |  | Heat treatment Temp. Holding time |  | NDT method/ Quantum |  | RFF       |               | Remarks |  |
|--|--|---|--|-----------------------------------|--|------------|--|------------|--|--------------------|--|--------------|--|------------------------|--|---------|--|---------------|--|-----------------------------------|--|---------------------|--|-----------|---------------|---------|--|
|  |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  | Spec. No. | ACC Norm Ref. |         |  |
|  |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| <p>Project : Stage :<br/>                     Contractor :<br/>                     Contractor No. :<br/>                     System :</p> |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| <p>FIELD WELDING SCHEDULE<br/>                     (To be raised by the contractor)<br/>                     Welding Code .....</p>        |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| <p>DOC. NO. :<br/>                     REV. NO. :<br/>                     DATE :<br/>                     PAGE : OF</p>                   |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| NOTES:   |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| SIGNATURE  |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| FORMAT NO.: QS-01-QAI-P-02/F2-R0   |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| 1/1  |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |
| Engg. Div./QA&I  |  |   |  |                                   |  |            |  |            |  |                    |  |              |  |                        |  |         |  |               |  |                                   |  |                     |  |           |               |         |  |

|   |  |  |                  |
|---|--|--|------------------|
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/IRKSHICC-9915-371 | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>87 OF 89 |
|---|--|--|------------------|





| Supplier's Name & Address                       |   | FIELD QUALITY PLAN  |                 |                  |                  |                    |                  |                  | PROJECT : |           |
|---|---|---|-----------------|------------------|------------------|--------------------|------------------|------------------|-----------|-----------|
|   |   | ITEM  | Q.P. NO. :      | PACKAGE :        | CONTRACT NO. :   | MAIN-SUPPLIER :    | REV.NO. :        | DATE :           | OF        | PROJECT : |
| SUB-SYSTEM                                      |   | CHARACTERISTICS/INSTRUMENTS   | CLASS# OF CHECK | TYPE OF CHECK    | QUANTUM OF CHECK | REFERENCE DOCUMENT | ACCEPTANCE NORMS | FORMAT OF RECORD | REMARKS   |           |
| 1   | 2 | 3   | 4               | 5                | 6                | 7                  | 8                | 9                | D*        | 10.       |
| <b>MANUFACTURER / SUB-SUPPLIER</b><br>SIGNATURE |   | <b>LEGEND :</b> * RECORDS, IDENTIFIED WITH "TICK" ( ) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION<br>LEGEND TO BE USED : CLASS # : A - CRITICAL, B = MAJOR, C = MINOR; 'A' SHALL BE WITNESSED BY NTPC FQA, 'B' SHALL BE WITNESSED BY NTPC ERECTION / CONSTRUCTION DEPTT. AND 'C' SHALL BE WITNESSED BY ERECTION SUPPLIER (A & B CHECK SHALL BE NTPC 'CHP STAGE) |                 |                  |                  |                    |                  |                  |           |           |
|   |   | DOC. NO. :  |                 | <br>FOR NTPC USE |                  | REV.....CAT.....   |                  |                  |           |           |
| ENGINEERING DIV. / QA&I                         |   | REVIEWED BY   |                 | APPROVED BY      |                  | APPROVAL SEAL      |                  |                  |           |           |
| FORMAT - Q5-01-QAI-P-09/F2-R0                   |   | 1/1   |                 |                  |                  |                    |                  |                  |           |           |

|   |  |  |                  |
|---|--|--|------------------|
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-C<br>BID DOC. NO.:<br>THDC/IRKSHICC-9915-371 | GENRAL TECHNICAL<br>REQUIREMENTS (GTR) | PAGE<br>89 OF 89 |
|---|--|--|------------------|

985824/2022/PS-PEM-MAX



TITLE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT

SECTION -I

SUB SECTION -IA

REV. NO. 00

DATE :

**DRAWINGS**



TITLE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT


SECTION -I


SUB SECTION -IA

REV. NO. 00

DATE :

## PROCESS FLOW BLOCK DIAGRAM (APPLICABLE FOR RW & CW AREA STP)

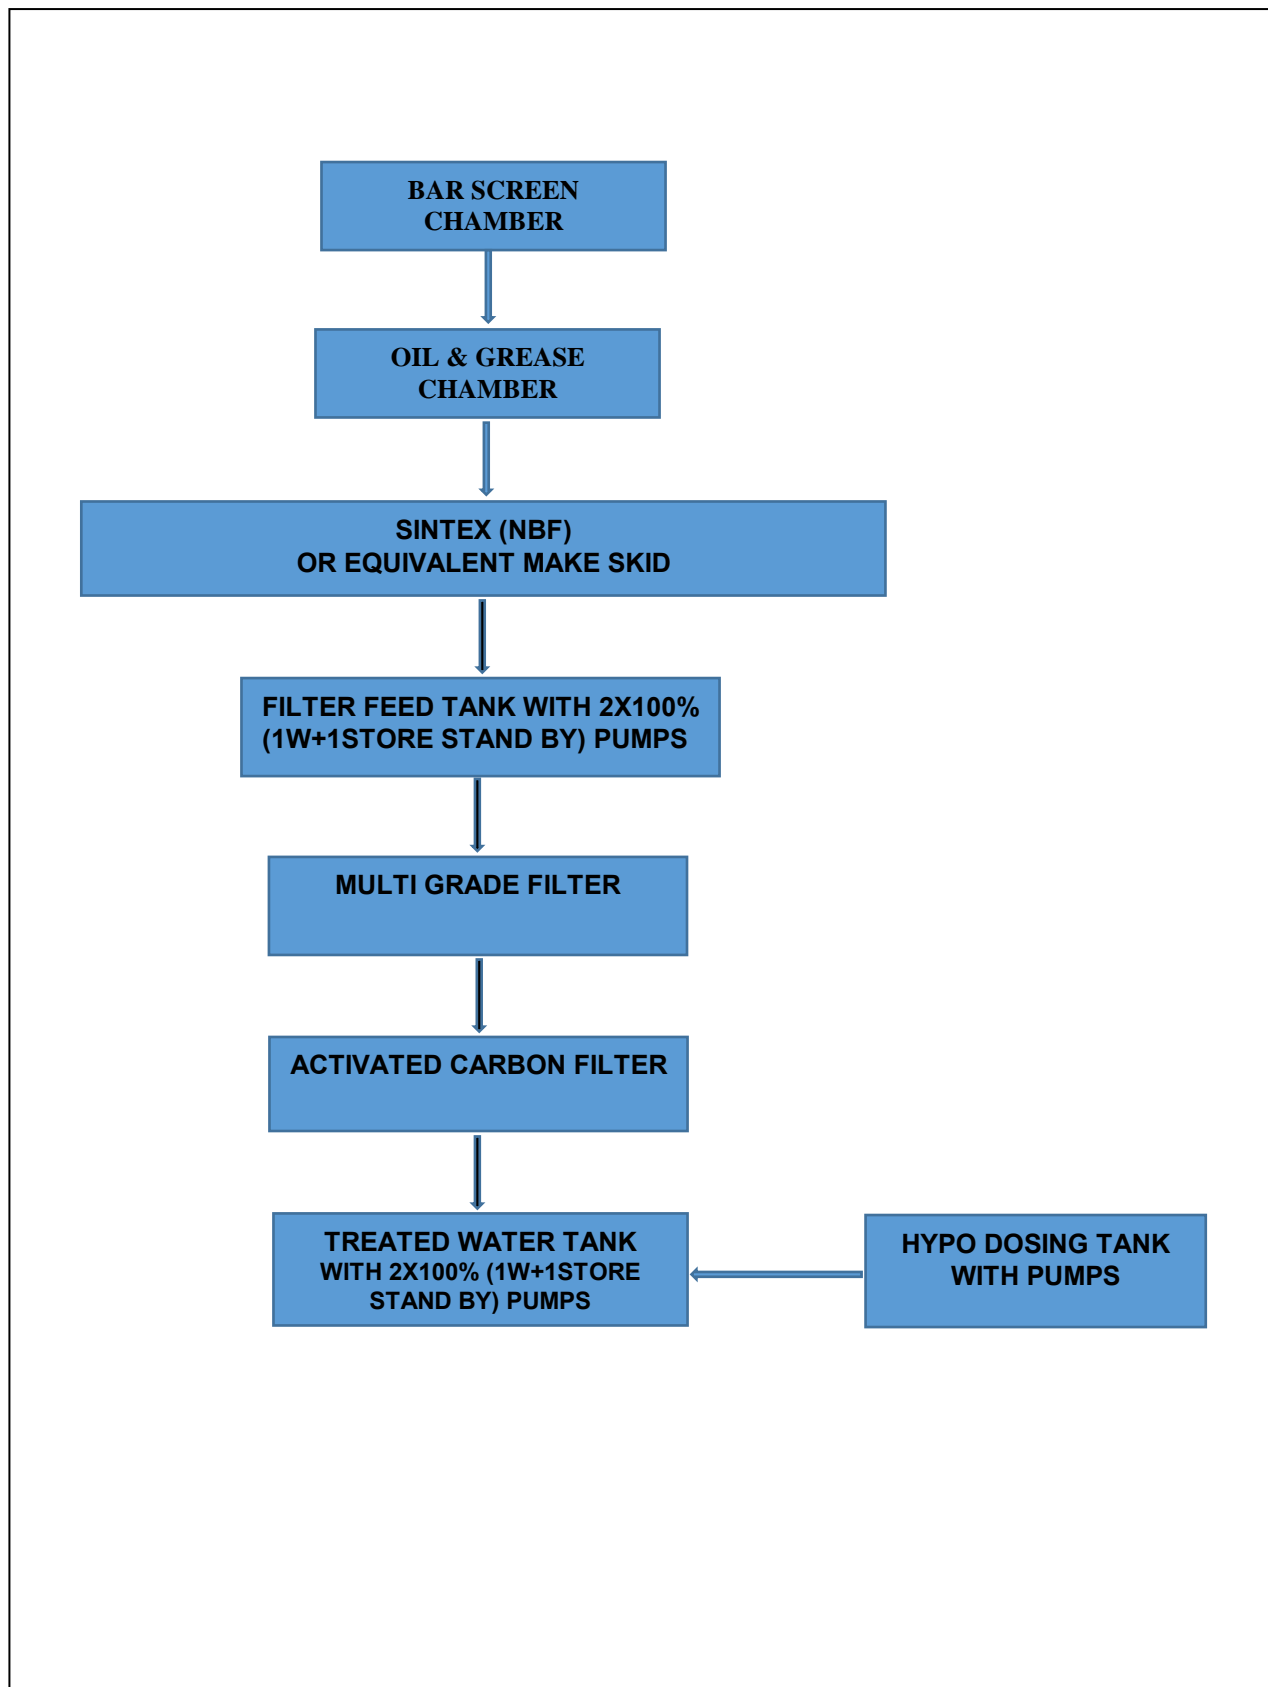

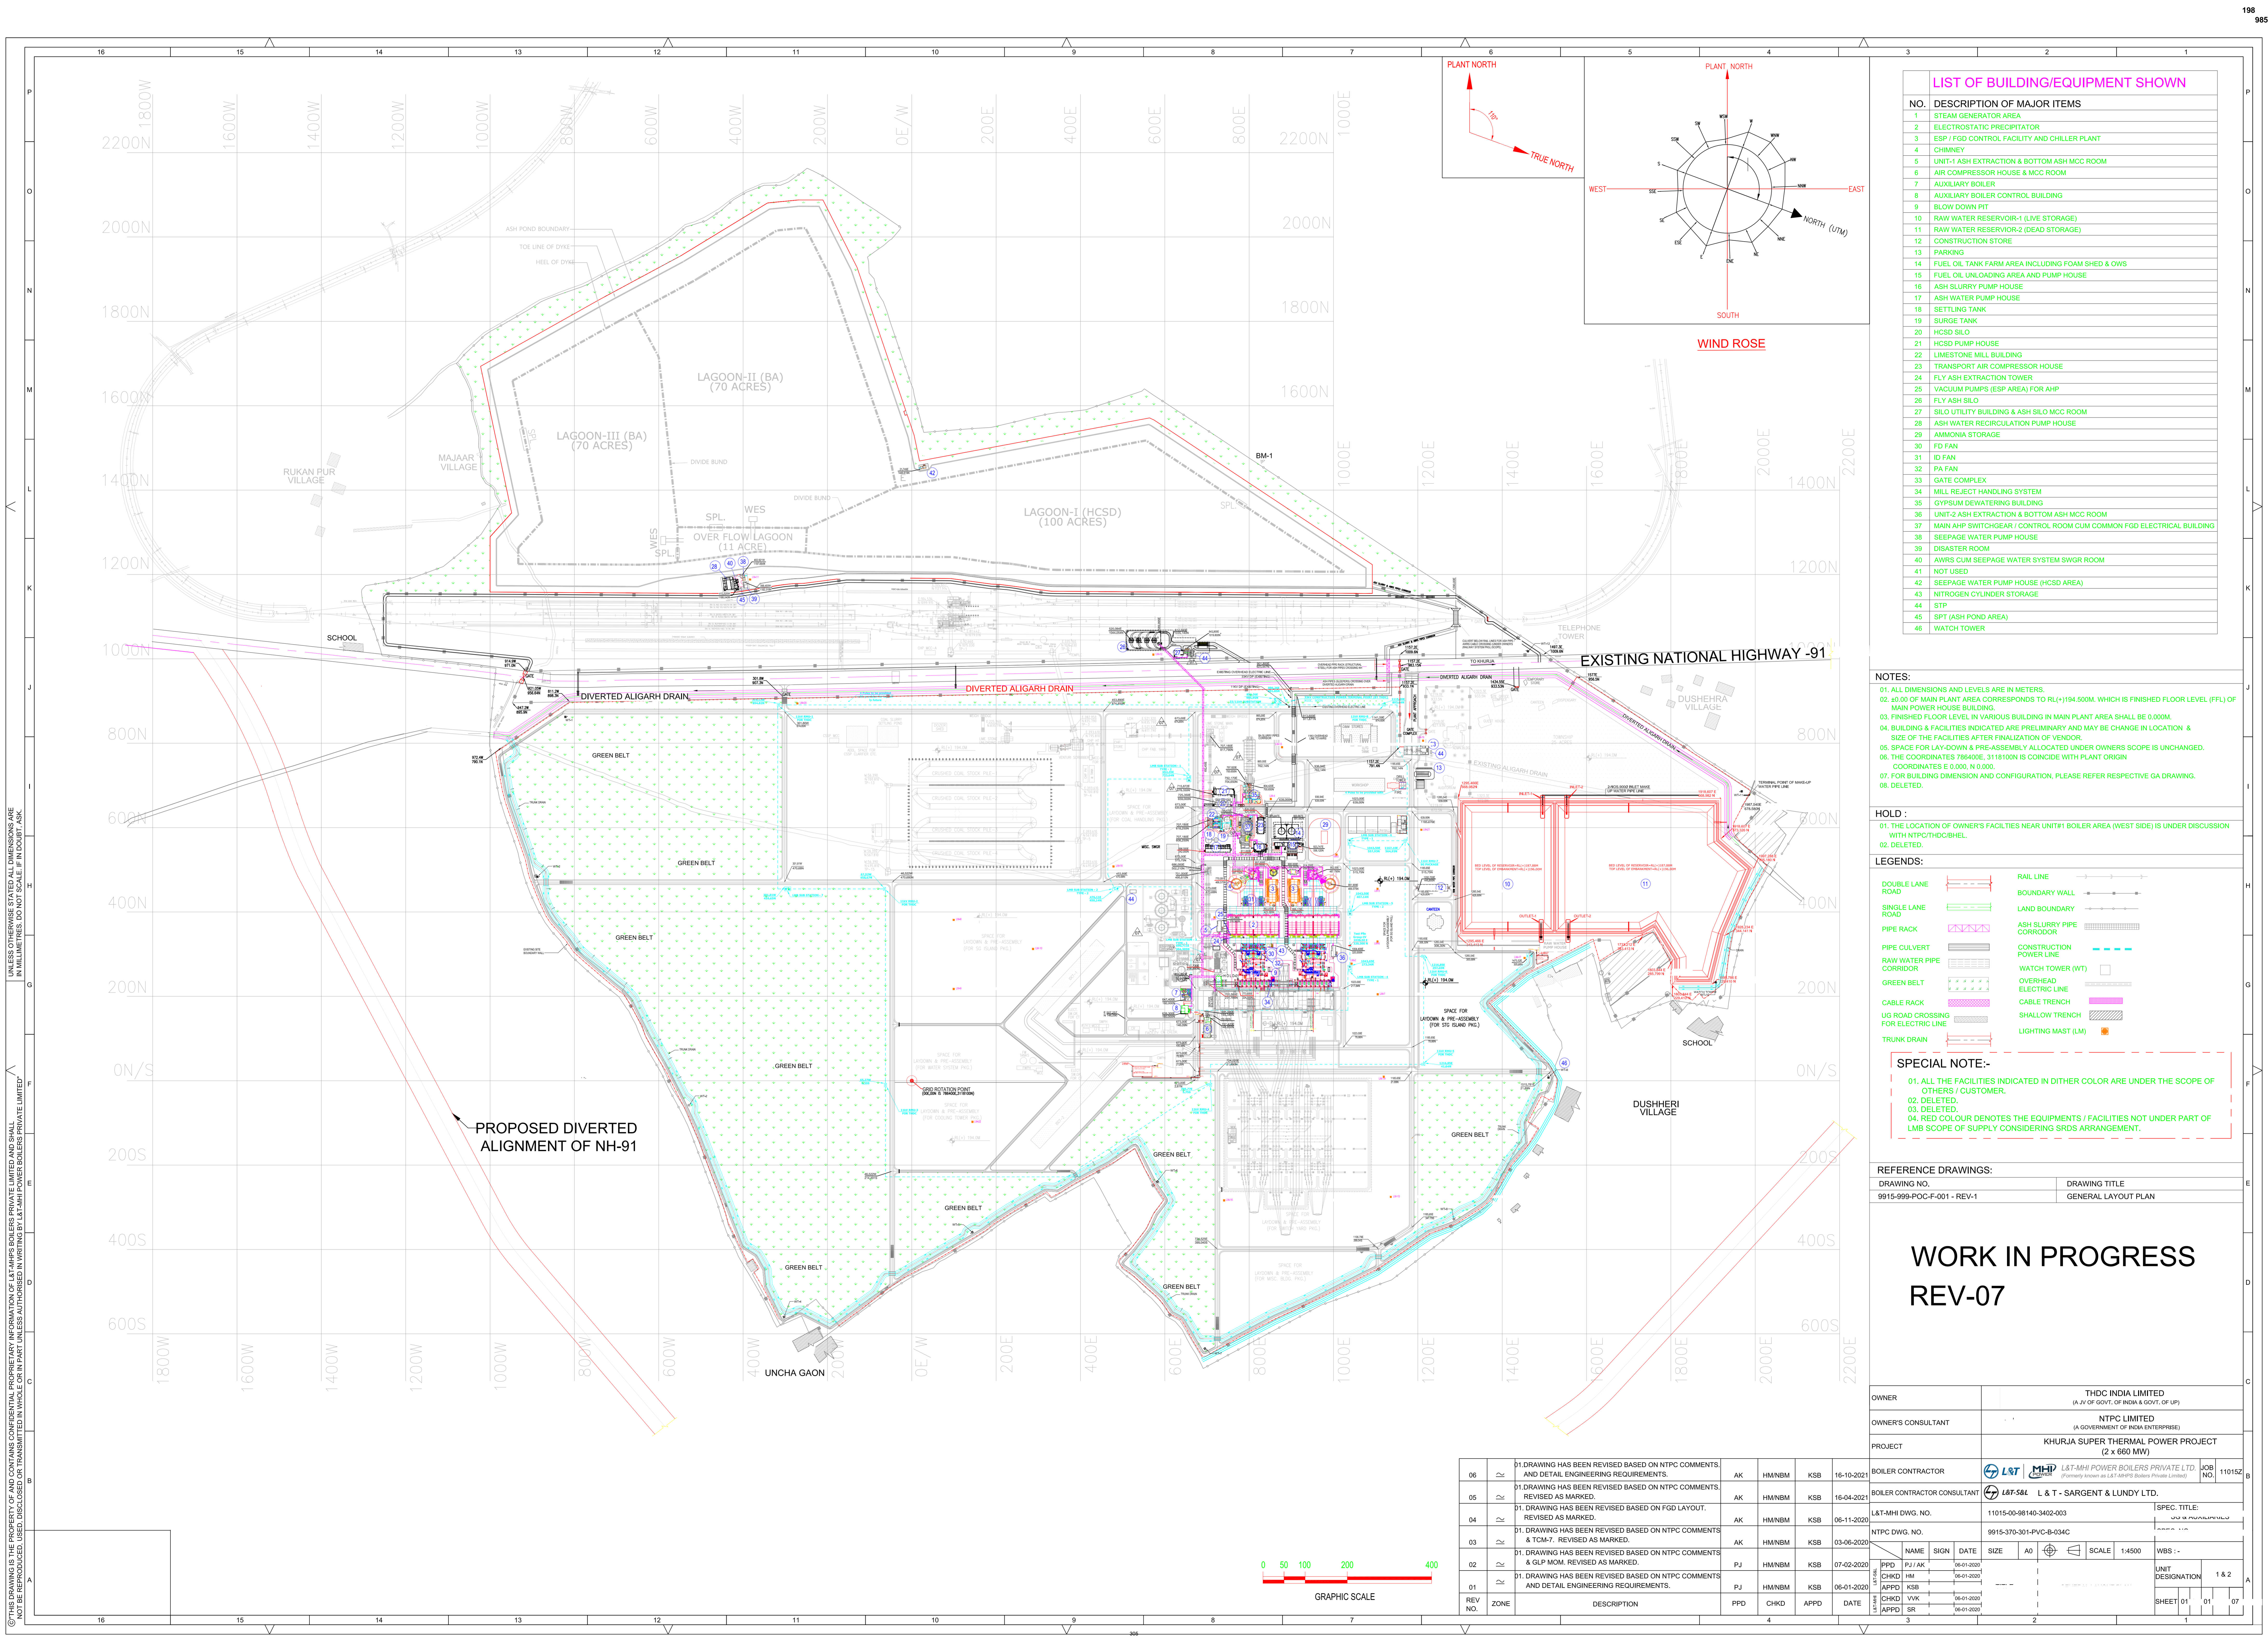

**LIST OF BUILDING/EQUIPMENT SHOWN**

| NO. | DESCRIPTION OF MAJOR ITEMS  |
|-----|---|
| 1   | STEAM GENERATOR AREA  |
| 2   | ELECTROSTATIC PRECIPITATOR  |
| 3   | ESP / FGD CONTROL FACILITY AND CHILLER PLANT                          |
| 4   | CHIMNEY   |
| 5   | UNIT-1 ASH EXTRACTION & BOTTOM ASH MCC ROOM                           |
| 6   | AIR COMPRESSOR HOUSE & MCC ROOM                                       |
| 7   | AUXILIARY BOILER  |
| 8   | AUXILIARY BOILER CONTROL BUILDING                                     |
| 9   | BLOW DOWN PIT   |
| 10  | RAW WATER RESERVOIR-1 (LIVE STORAGE)                                  |
| 11  | RAW WATER RESERVOIR-2 (DEAD STORAGE)                                  |
| 12  | CONSTRUCTION STORE  |
| 13  | PARKING   |
| 14  | FUEL OIL TANK FARM AREA INCLUDING FOAM SHED & OWS                     |
| 15  | FUEL OIL UNLOADING AREA AND PUMP HOUSE                                |
| 16  | ASH SLURRY PUMP HOUSE   |
| 17  | ASH WATER PUMP HOUSE  |
| 18  | SETTLING TANK   |
| 19  | SURGE TANK  |
| 20  | HCSO SILO   |
| 21  | HCSO PUMP HOUSE   |
| 22  | LIMESTONE MILL BUILDING   |
| 23  | TRANSPORT AIR COMPRESSOR HOUSE  |
| 24  | FLY ASH EXTRACTION TOWER  |
| 25  | VACUUM PUMPS (ESP AREA) FOR AHP                                       |
| 26  | FLY ASH SILO  |
| 27  | SILO UTILITY BUILDING & ASH SILO MCC ROOM                             |
| 28  | ASH WATER RECIRCULATION PUMP HOUSE                                    |
| 29  | AMMONIA STORAGE   |
| 30  | FD FAN  |
| 31  | ID FAN  |
| 32  | PA FAN  |
| 33  | GATE COMPLEX  |
| 34  | MILL REJECT HANDLING SYSTEM   |
| 35  | GYPHUM DEWATERING BUILDING  |
| 36  | UNIT-2 ASH EXTRACTION & BOTTOM ASH MCC ROOM                           |
| 37  | MAIN AHP SWITCHGEAR / CONTROL ROOM CUM COMMON FGD ELECTRICAL BUILDING |
| 38  | SEEPAGE WATER PUMP HOUSE  |
| 39  | DISASTER ROOM   |
| 40  | AWRS CUM SEEPAGE WATER SYSTEM SWGR ROOM                               |
| 41  | NOT USED  |
| 42  | SEEPAGE WATER PUMP HOUSE (HCSO AREA)                                  |
| 43  | NITROGEN CYLINDER STORAGE   |
| 44  | STP   |
| 45  | SPT (ASH POND AREA)   |
| 46  | WATCH TOWER   |

- NOTES:**
01. ALL DIMENSIONS AND LEVELS ARE IN METERS.
  02. ±0.00 OF MAIN PLANT AREA CORRESPONDS TO RL(+194.500M, WHICH IS FINISHED FLOOR LEVEL (FFL) OF MAIN POWER HOUSE BUILDING.
  03. FINISHED FLOOR LEVEL IN VARIOUS BUILDING IN MAIN PLANT AREA SHALL BE 0.000M.
  04. BUILDING & FACILITIES INDICATED ARE PRELIMINARY AND MAY BE CHANGE IN LOCATION & SIZE OF THE FACILITIES AFTER FINALIZATION OF VENDOR.
  05. SPACE FOR LAY-DOWN & PRE-ASSEMBLY ALLOCATED UNDER OWNERS SCOPE IS UNCHANGED.
  06. THE COORDINATES 18640E, 311910N IS COINCIDE WITH PLANT ORIGIN COORDINATES E 0.000, N 0.000.
  07. FOR BUILDING DIMENSION AND CONFIGURATION, PLEASE REFER RESPECTIVE GA DRAWING.
  08. DELETED.

- HOLD :**
01. THE LOCATION OF OWNER'S FACILITIES NEAR UNIT#1 BOILER AREA (WEST SIDE) IS UNDER DISCUSSION WITH NTPC/HDCHBEL.
  02. DELETED.

**LEGENDS:**

|                                    |                          |
|------------------------------------|--------------------------|
| DOUBLE LANE ROAD                   | RAIL LINE                |
| SINGLE LANE ROAD                   | BOUNDARY WALL            |
| PIPE RACK                          | LAND BOUNDARY            |
| PIPE CULVERT                       | ASH SLURRY PIPE CORRIDOR |
| RAW WATER PIPE CORRIDOR            | CONSTRUCTION POWER LINE  |
| GREEN BELT                         | WATCH TOWER (WT)         |
| CABLE RACK                         | OVERHEAD ELECTRIC LINE   |
| UG ROAD CROSSING FOR ELECTRIC LINE | CABLE TRENCH             |
| TRUNK DRAIN                        | SHALLOW TRENCH           |
|                                    | LIGHTING MAST (LM)       |

**SPECIAL NOTE:-**


01. ALL THE FACILITIES INDICATED IN DITHER COLOR ARE UNDER THE SCOPE OF OTHERS / CUSTOMER.
02. DELETED.
03. DELETED.
04. RED COLOUR DENOTES THE EQUIPMENTS / FACILITIES NOT UNDER PART OF LMB SCOPE OF SUPPLY CONSIDERING SRDS ARRANGEMENT.

**REFERENCE DRAWINGS:**

| DRAWING NO.                | DRAWING TITLE       |
|----------------------------|---------------------|
| 9915-999-POC-F-001 - REV-1 | GENERAL LAYOUT PLAN |

**WORK IN PROGRESS  
REV-07**

|                              |  |  |  |
|------------------------------|--|--|--|
| OWNER                        | THDC INDIA LIMITED<br>(A JV OF GOVT. OF INDIA & GOVT. OF UP) |  |  |
| OWNER'S CONSULTANT           | NTPC LIMITED<br>(A GOVERNMENT OF INDIA ENTERPRISE)           |  |  |
| PROJECT                      | KHURJA SUPER THERMAL POWER PROJECT<br>(2 x 660 MW)           |  |  |
| BOILER CONTRACTOR            | L&T  | M&P  | L&T-MHI POWER BOILERS PRIVATE LTD<br>(FORMERLY KNOWN AS L&T M&P BOILERS PRIVATE LIMITED) |
| BOILER CONTRACTOR CONSULTANT | L&T-5&L  | L & T - SARGENT & LUNDY LTD.   | JOB NO. 110152   |
| L&T-MH DWG. NO.              | 11015-200-98140-3402-003                                     | SPEC. TITLE:   |  |
| NTPC DWG. NO.                | 9915-370-301-PVC-B-034C                                      |  |  |
| NAME                         | SIGN   | DATE   | SCALE  |
| PPD                          | PJJ/AK   | 06-01-2020   | 1:4500   |
| CHKD                         | HM   | 06-01-2020   |  |
| APPD                         | KSB  | 06-01-2020   |  |
| CHKD                         | VVK  | 06-01-2020   |  |
| APPD                         | SR   | 06-01-2020   |  |
| REV. NO.                     | ZONE   | DESCRIPTION  | DATE   |
| 06                           | AK   | D1. DRAWING HAS BEEN REVISED BASED ON NTPC COMMENTS AND DETAIL ENGINEERING REQUIREMENTS. | 16-10-2021   |
| 05                           | AK   | D1. DRAWING HAS BEEN REVISED BASED ON NTPC COMMENTS, REVISED AS MARKED.                  | 16-04-2021   |
| 04                           | AK   | D1. DRAWING HAS BEEN REVISED BASED ON FGD LAYOUT, REVISED AS MARKED.                     | 06-11-2020   |
| 03                           | AK   | D1. DRAWING HAS BEEN REVISED BASED ON NTPC COMMENTS & TO M7, REVISED AS MARKED.          | 03-06-2020   |
| 02                           | PJ   | D1. DRAWING HAS BEEN REVISED BASED ON NTPC COMMENTS & GLP MOM, REVISED AS MARKED.        | 07-02-2020   |
| 01                           | PJ   | D1. DRAWING HAS BEEN REVISED BASED ON NTPC COMMENTS AND DETAIL ENGINEERING REQUIREMENTS. | 06-01-2020   |
| PPD                          | CHKD   | APPD   | DATE   |
|                              |  |  |  |

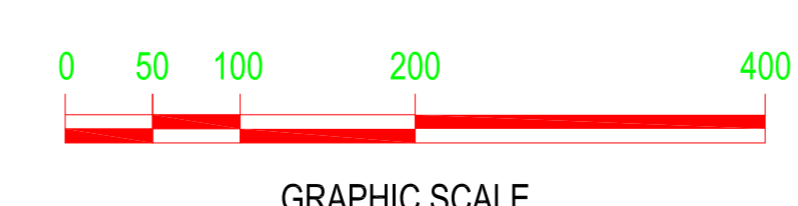

UNLESS OTHERWISE STATED ALL DIMENSIONS ARE IN MILLIMETRES. DO NOT SCALE IF IN DOUBT. ASK


**DATASHEET-A FOR STP**

| S.No.      | DESCRIPTION   |  |
|------------|---|--|
|            | <b>• CW AREA STP</b>  |  |
| <b>1.0</b> | <b>Capacity of STP</b>  | 10 m <sup>3</sup> /day   |
| <b>2.0</b> | <b>Bar Screen Chamber</b>                                       |  |
| 2.1        | <b>Chamber</b>  |  |
| 2.1.1      | Quantity  | 1no. (1W)  |
| 2.1.2      | MOC   | RCC (Civil by BHEL)  |
| 2.1.3      | Type  | Below ground /above ground   |
| 2.1.4      | Capacity  | As per system requirement  |
| <b>2.2</b> | <b>Bar Screen</b>   |  |
| 2.2.1      | Quantity  | 1no. (1W)  |
| 2.2.2      | MOC   | SS316  |
| 2.2.3      | Type  | Below ground /above ground   |
| 2.2.4      | Capacity  | As per system requirement  |
| <b>3.0</b> | <b>Oil &amp; Grease chamber</b>                                 |  |
| 3.1        | Quantity  | 1 no. oil & grease chamber ( if required 1 no. oil skimmer shall be provided by bidder)    |
| 3.2        | Oil & grease chamber MOC  | RCC (Civil by BHEL)  |
| 3.3        | Oil & grease chamber capacity                                   | As per process requirement   |
| <b>4.0</b> | <b>Oil &amp; Grease Trap</b>                                    |  |
| 4.1        | Numbers Required  | One (1) no.  |
| 4.2        | Flow (m <sup>3</sup> /hr)                                       | As per process requirement   |
| 4.3        | MOC   | RCC with baffle arrangements   |
| 4.4        | Perforated pipe MOC   | CPVC/CS  |
| <b>5.0</b> | <b>Sintex (NBF-10) or equivalent make sewage treatment skid</b> |  |
| 5.1        | Capacity  | 10 m <sup>3</sup> /day   |
| 5.2        | MOC   | As per system requirement  |
| <b>6.0</b> | <b>Sludge recirculation pump</b>                                |  |
| <b>6.1</b> | <b>Option -I</b>  |  |
| 6.1.1      | Type  | Submersible type   |
| 6.1.2      | Quantity  | 2 Nos. (1W+1Store stand by)  |
| 6.1.3      | Suction condition   | Flooded.   |
| 6.1.4      | Capacity  | As per process requirement   |
| 6.1.5      | Head  | As per process requirement   |
| 6.1.6      | MOC   |  |
|            | • MOC casing  | Cast Iron  |
|            | • MOC impeller  | Stainless Steel AISI 304   |
|            | • MOC shaft   | SS 410   |
| 6.1.7      | Drive motor   | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>6.2</b> | <b>Option -II</b>   |  |
| 6.2.1      | Type  | Horizontal Centrifugal type  |
| 6.2.2      | Quantity  | 2 Nos. (1W+1S), all connected.   |
| 6.2.3      | Suction condition   | Flooded.   |
| 6.2.4      | Capacity  | As per process requirement   |
| 6.2.5      | Head  | As per process requirement   |
| 6.2.6      | MOC   |  |
|            | • Casing  | Cast Iron IS:210 Gr FG 260   |
|            | • Impeller  | Stainless steel CF 8M  |
|            | • Shaft & Shaft sleeve material                                 | Stainless steel SS Gr. 304 & SS316   |
|            | • Packing seal  | Mechanical type  |
|            | • Common base plate   | Carbon steel IS:2062   |



2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT

SECTION -I

SUB SECTION -IA

REV. NO. 00

DATE :

|             |  |  |
|-------------|--|--|
| 6.2.7       | Drive motor                                    | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>7.0</b>  | <b>Air Blowers for sewage treatment skid</b>   |  |
| 7.1         | Numbers Required                               | 2 nos. (1W+1S)   |
| 7.2         | Type of Blower                                 | Twin lobe type   |
| 7.3         | Flow   | As per process requirement   |
| 7.4         | Head   | As per process requirement   |
| 7.5         | MOC  | CI to IS 210 Gr. FG 260  |
| 7.6         | Accessories                                    | NRV, Pressure Gauge, Safety valves, Silencer, PRV, Filter, etc                             |
| 7.7         | Drive Motor                                    | Induction motor, 415V, 3 Φ, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615    |
| 7.8         | Common Base plate/<br>mounting plate           | MS as per IS 2062  |
| <b>8.0</b>  | <b>Filter Feed Tank</b>                        |  |
| 8.1         | Numbers Required                               | One (1) no. and shall be in bidder's scope   |
| 8.2         | Effective Capacity                             | 6 hrs storage  |
| 8.3         | MOC  | As per supplier's recommendation   |
| <b>9.0</b>  | <b>Hypo Dosing System</b>                      |  |
| <b>9.1</b>  | <b>Hypo Dosing Tank</b>                        |  |
| 9.1.1       | Numbers Required                               | One (1) no.  |
| 9.1.2       | Effective Capacity                             | 100 liters OR+ 24 hour storage requirement @ suitable dosing rate whichever is higher      |
| 9.1.3       | MOC  | FRP/HDPE/GRP   |
| <b>9.2</b>  | <b>Hypo Dosing Pump for treated water tank</b> |  |
| 9.2.1       | Quantity                                       | Two (1W+1S) no.  |
| 9.2.2       | Capacity                                       | As per process requirement.  |
| 9.2.3       | Type   | Electronic dosing pump with auto stroke controller   |
| 9.2.4       | MOC  | PP   |
| <b>10.0</b> | <b>Filter Feed Pumps</b>                       |  |
| <b>10.1</b> | <b>Option -I</b>                               |  |
| 10.1.1      | Type   | Submersible type   |
| 10.1.2      | Quantity                                       | 2 Nos. (1W+1Store stand by)  |
| 10.1.3      | Suction condition                              | Flooded.   |
| 10.1.4      | Capacity                                       | As per process requirement   |
| 10.1.5      | Head   | As per process requirement   |
| 10.1.6      | MOC  |  |
|             | • MOC casing                                   | Cast Iron  |
|             | • MOC impeller                                 | Stainless Steel AISI 304   |
|             | • MOC shaft                                    | SS 410   |
| 10.1.7      | Drive motor                                    | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>10.2</b> | <b>Option -II</b>                              |  |
| 10.2.1      | Type   | Horizontal Centrifugal type  |
| 10.2.2      | Quantity                                       | 2 Nos. (1W+1S), all connected.   |
| 10.2.3      | Suction condition                              | Flooded.   |
| 10.2.4      | Capacity                                       | As per process requirement   |
| 10.2.5      | Head   | As per process requirement   |
| 10.2.6      | MOC  |  |
|             | • Casing                                       | Cast Iron IS:210 Gr FG 260   |
|             | • Impeller                                     | Stainless steel CF 8M  |
|             | • Shaft & Shaft sleeve material                | Stainless steel SS Gr. 304 & SS316   |
|             | • Packing seal                                 | Mechanical type  |
|             | • Common base plate                            | Carbon steel IS:2062   |
| 10.2.7      | Drive motor                                    | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |



**2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS**

SPECIFICATION NO. PE-TS-492-673-A001

**TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT**

SECTION -I

SUB SECTION -IA

REV. NO. 00

DATE :

|             |                                     |  |
|-------------|-------------------------------------|--|
| <b>11.0</b> | <b>Multi Grade Filter</b>           |  |
| 11.1        | Quantity                            | 1 no.  |
| 11.2        | Capacity                            | As per system requirement  |
| 11.3        | Design pressure                     | Shut off head of Filter feed pump + 5% margin  |
| 11.4        | MOC                                 | As per supplier's recommendation   |
| 11.5        | Media                               | To suit system requirement   |
| <b>12.0</b> | <b>Activated Carbon Filter</b>      |  |
| 12.1        | Quantity                            | 1 no.  |
| 12.2        | Capacity                            | As per system requirement  |
| 12.3        | Design pressure                     | Shut off head of Filter feed pump + 5% margin  |
| 12.4        | MOC                                 | As per supplier's recommendation   |
| 12.5        | Media                               | Activated Carbon   |
| <b>13.0</b> | <b>Treated Water Tank</b>           |  |
| 13.1        | Number required                     | 1 no. and shall be in bidder's scope   |
| 13.2        | Capacity                            | 6hrs storage   |
| 13.3        | MOC of tank                         | As per supplier's recommendation   |
| <b>14.0</b> | <b>Treated Water Disposal Pumps</b> |  |
| <b>14.1</b> | <b>Option -I</b>                    |  |
| 14.1.1      | Type                                | Submersible type   |
| 14.1.2      | Quantity                            | 2 Nos. (1W+1Store stand by)  |
| 14.1.3      | Suction condition                   | Flooded.   |
| 14.1.4      | Capacity                            | 1.0 m <sup>3</sup> /h (Minimum)  |
| 14.1.5      | Head                                | 20 mWC (Minimum)   |
| 14.1.6      | MOC                                 |  |
|             | • MOC casing                        | Cast Iron  |
|             | • MOC impeller                      | Stainless Steel AISI 304   |
|             | • MOC shaft                         | SS 410   |
| 14.1.7      | Drive motor                         | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>14.2</b> | <b>Option -II</b>                   |  |
| 14.2.1      | Type                                | Horizontal Centrifugal type  |
| 14.2.2      | Quantity                            | 2 Nos. (1W+1S), all connected.   |
| 14.2.3      | Suction condition                   | Flooded.   |
| 14.2.4      | Capacity                            | 1.0 m <sup>3</sup> /h (Minimum)  |
| 14.2.5      | Head                                | 20 mWC (Minimum)   |
| 14.2.6      | MOC                                 |  |
|             | • Casing                            | Cast Iron IS:210 Gr FG 260   |
|             | • Impeller                          | Stainless steel CF 8M  |
|             | • Shaft & Shaft sleeve material     | Stainless steel SS Gr. 304 & SS316   |
|             | • Packing seal                      | Mechanical type  |
|             | • Common base plate                 | Carbon steel IS:2062   |
| 14.2.7      | Drive motor                         | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
|             | <b>• RW AREA STP</b>                |  |
| <b>1.0</b>  | <b>Capacity of STP</b>              | 10 m3/day  |
| <b>2.0</b>  | <b>Bar Screen Chamber</b>           |  |
| <b>2.1</b>  | <b>Chamber</b>                      |  |
| 2.1.1       | Quantity                            | 1no. (1W)  |
| 2.1.2       | MOC                                 | RCC (Civil by BHEL)  |
| 2.1.3       | Type                                | Below ground /above ground   |
| 2.1.4       | Capacity                            | As per system requirement  |
| <b>2.2</b>  | <b>Bar Screen</b>                   |  |
| 2.2.1       | Quantity                            | 1no. (1W)  |

985824/2022/PS-PEM-MAX



**2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS**

SPECIFICATION NO. PE-TS-492-673-A001

**TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT**

SECTION -I

SUB SECTION -IA

REV. NO. 00

DATE :

|            |   |  |
|------------|---|--|
| 2.2.2      | MOC   | SS316  |
| 2.2.3      | Type  | Below ground /above ground   |
| 2.2.4      | Capacity  | As per system requirement  |
| <b>3.0</b> | <b>Oil &amp; Grease chamber</b>                                 |  |
| 3.1        | Quantity  | 1 no. oil & grease chamber ( if required 1 no. oil skimmer shall be provided by bidder)    |
| 3.2        | Oil & grease chamber MOC  | RCC (Civil by BHEL)  |
| 3.3        | Oil & grease chamber capacity                                   | As per process requirement   |
| <b>4.0</b> | <b>Oil &amp; Grease Trap</b>                                    |  |
| 4.1        | Numbers Required  | One (1) no.  |
| 4.2        | Flow (m <sup>3</sup> /hr)                                       | As per process requirement   |
| 4.3        | MOC   | RCC with baffle arrangements   |
| 4.4        | Perforated pipe MOC   | CPVC/CS  |
| <b>5.0</b> | <b>Sintex (NBF-10) or equivalent make sewage treatment skid</b> |  |
| 5.1        | Capacity  | 10 m3/day  |
| 5.2        | MOC   | As per system requirement  |
| <b>6.0</b> | <b>Sludge recirculation pump</b>                                |  |
| <b>6.1</b> | <b>Option -I</b>  |  |
| 6.1.1      | Type  | Submersible type   |
| 6.1.2      | Quantity  | 2 Nos. (1W+1Store stand by)  |
| 6.1.3      | Suction condition   | Flooded.   |
| 6.1.4      | Capacity  | As per process requirement   |
| 6.1.5      | Head  | As per process requirement   |
| 6.1.6      | MOC   |  |
|            | • MOC casing  | Cast Iron  |
|            | • MOC impeller  | Stainless Steel AISI 304   |
|            | • MOC shaft   | SS 410   |
| 6.1.7      | Drive motor   | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>6.2</b> | <b>Option -II</b>   |  |
| 6.2.1      | Type  | Horizontal Centrifugal type  |
| 6.2.2      | Quantity  | 2 Nos. (1W+1S), all connected.   |
| 6.2.3      | Suction condition   | Flooded.   |
| 6.2.4      | Capacity  | As per process requirement   |
| 6.2.5      | Head  | As per process requirement   |
| 6.2.6      | MOC   |  |
|            | • Casing  | Cast Iron IS:210 Gr FG 260   |
|            | • Impeller  | Stainless steel CF 8M  |
|            | • Shaft & Shaft sleeve material                                 | Stainless steel SS Gr. 304 & SS316   |
|            | • Packing seal  | Mechanical type  |
|            | • Common base plate   | Carbon steel IS:2062   |
| 6.2.7      | Drive motor   | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>7.0</b> | <b>Air Blowers for sewage treatment skid</b>                    |  |
| 7.1        | Numbers Required  | 2 nos. (1W+1S)   |
| 7.2        | Type of Blower  | Twin lobe type   |
| 7.3        | Flow  | As per process requirement   |
| 7.4        | Head  | As per process requirement   |
| 7.5        | MOC   | CI to IS 210 Gr. FG 260  |
| 7.6        | Accessories   | NRV, Pressure Gauge, Safety valves, Silencer, PRV, Filter, etc                             |
| 7.7        | Drive Motor   | Induction motor, 415V, 3 Φ, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615    |
| 7.8        | Common Base plate/<br>mounting plate                            | MS as per IS 2062  |

985824/2022/PS-PEM-MAX



**2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS**

SPECIFICATION NO. PE-TS-492-673-A001

**TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT**

SECTION -I

SUB SECTION -IA

REV. NO. 00

DATE :

|             |  |  |
|-------------|--|--|
| <b>8.0</b>  | <b>Filter Feed Tank</b>                        |  |
| 8.1         | Numbers Required                               | One (1) no. and shall be in bidder's scope   |
| 8.2         | Effective Capacity                             | 6 hrs storage  |
| 8.3         | MOC  | As per supplier's recommendation   |
| <b>9.0</b>  | <b>Hypo Dosing System</b>                      |  |
| <b>9.1</b>  | <b>Hypo Dosing Tank</b>                        |  |
| 9.1.1       | Numbers Required                               | One (1) no.  |
| 9.1.2       | Effective Capacity                             | 100 liters OR+ 24 hour storage requirement @ suitable dosing rate whichever is higher      |
| 9.1.3       | MOC  | FRP/HDPE/GRP   |
| <b>9.2</b>  | <b>Hypo Dosing Pump for treated water tank</b> |  |
| 9.2.1       | Quantity                                       | Two (1W+1S) no.  |
| 9.2.2       | Capacity                                       | As per process requirement.  |
| 9.2.3       | Type   | Electronic dosing pump with auto stroke controller   |
| 9.2.4       | MOC  | PP   |
| <b>10.0</b> | <b>Filter Feed Pumps</b>                       |  |
| <b>10.1</b> | <b>Option -I</b>                               |  |
| 10.1.1      | Type   | Submersible type   |
| 10.1.2      | Quantity                                       | 2 Nos. (1W+1Store stand by)  |
| 10.1.3      | Suction condition                              | Flooded.   |
| 10.1.4      | Capacity                                       | As per process requirement   |
| 10.1.5      | Head   | As per process requirement   |
| 10.1.6      | MOC  |  |
|             | • MOC casing                                   | Cast Iron  |
|             | • MOC impeller                                 | Stainless Steel AISI 304   |
|             | • MOC shaft                                    | SS 410   |
| 10.1.7      | Drive motor                                    | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>10.2</b> | <b>Option -II</b>                              |  |
| 10.2.1      | Type   | Horizontal Centrifugal type  |
| 10.2.2      | Quantity                                       | 2 Nos. (1W+1S), all connected.   |
| 10.2.3      | Suction condition                              | Flooded.   |
| 10.2.4      | Capacity                                       | As per process requirement   |
| 10.2.5      | Head   | As per process requirement   |
| 10.2.6      | MOC  |  |
|             | • Casing                                       | Cast Iron IS:210 Gr FG 260   |
|             | • Impeller                                     | Stainless steel CF 8M  |
|             | • Shaft & Shaft sleeve material                | Stainless steel SS Gr. 304 & SS316   |
|             | • Packing seal                                 | Mechanical type  |
|             | • Common base plate                            | Carbon steel IS:2062   |
| 10.2.7      | Drive motor                                    | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615 |
| <b>11.0</b> | <b>Multi Grade Filter</b>                      |  |
| 11.1        | Quantity                                       | 1 no.  |
| 11.2        | Capacity                                       | As per system requirement  |
| 11.3        | Design pressure                                | Shut off head of Filter feed pump + 5% margin  |
| 11.4        | MOC  | As per supplier's recommendation   |
| 11.5        | Media  | To suit system requirement   |
| <b>12.0</b> | <b>Activated Carbon Filter</b>                 |  |
| 12.1        | Quantity                                       | 1 no.  |
| 12.2        | Capacity                                       | As per system requirement  |
| 12.3        | Design pressure                                | Shut off head of Filter feed pump + 5% margin  |
| 12.4        | MOC  | As per supplier's recommendation   |
| 12.5        | Media  | Activated Carbon   |
| <b>13.0</b> | <b>Treated Water Tank</b>                      |  |



**2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS**

SPECIFICATION NO. PE-TS-492-673-A001

**TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT**

SECTION -I


SUB SECTION -IA

REV. NO. 00

DATE :

|  |  |   |
|--|--|---|
| 13.1   | Number required  | 1 no. and shall be in bidder's scope  |
| 13.2   | Capacity   | 6hrs storage  |
| 13.3   | MOC of tank  | As per supplier's recommendation  |
| <b>14.0</b>                                      | <b>Treated Water Disposal Pumps</b>                              |   |
| <b>14.1</b>                                      | <b>Option -I</b>   |   |
| 14.1.1   | Type   | Submersible type  |
| 14.1.2   | Quantity   | 2 Nos. (1W+1Store stand by)   |
| 14.1.3   | Suction condition  | Flooded.  |
| 14.1.4   | Capacity   | 1.0 m <sup>3</sup> /h (Minimum)   |
| 14.1.5   | Head   | 20 mWC (Minimum)  |
| 14.1.6   | MOC  |   |
|  | • MOC casing   | Cast Iron   |
|  | • MOC impeller   | Stainless Steel AISI 304  |
|  | • MOC shaft  | SS 410  |
| 14.1.7   | Drive motor  | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615  |
| <b>14.2</b>                                      | <b>Option -II</b>  |   |
| 14.2.1   | Type   | Horizontal Centrifugal type   |
| 14.2.2   | Quantity   | 2 Nos. (1W+1S), all connected.  |
| 14.2.3   | Suction condition  | Flooded.  |
| 14.2.4   | Capacity   | 1.0 m <sup>3</sup> /h (Minimum)   |
| 14.2.5   | Head   | 20 mWC (Minimum)  |
| 14.2.6   | MOC  |   |
|  | • Casing   | Cast Iron IS:210 Gr FG 260  |
|  | • Impeller   | Stainless steel CF 8M   |
|  | • Shaft & Shaft sleeve material                                  | Stainless steel SS Gr. 304 & SS316  |
|  | • Packing seal   | Mechanical type   |
|  | • Common base plate  | Carbon steel IS:2062  |
| 14.2.7   | Drive motor  | Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615  |
| <b>MOC (Applicable for CW &amp; RW STP AREA)</b> |  |   |
| <b>1.0</b>                                       | <b>MATERIAL OF CONSTRUCTION OF PIPING AND FITTINGS</b>           |   |
| 1.1  | MOC of Piping and fittings of handling sewage and treated sewage | HDPE as per ASTM D3350 CL 34543C, FM Class 150/ IS: 4984 or Equivalent for buried portion.  |
| 1.2  | MOC of Piping and fittings of Chemical dosing                    | CPVC as per ASTM F441 CPVC 4120 Schedule 80/equivalent.   |
| 1.3  | MOC of service water piping                                      | IS-2062 Gr.-E-250B/ ASTM A-36/ASTM A-53 type 'E' Gr.B/ IS-3589 Gr. 410 /IS-1239 Heavy.  |
| 1.4  | MOC of compressed air piping (non submerged)                     | ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 3589 Gr 410 galvanized. Galvanized shall be to IS- 4736 or equivalent |
| 1.5  | MOC of compressed air piping (submerged)                         | CPVC as per ASTM F441 CPVC 4120 Schedule 80/ equivalent.  |
| <b>2.0</b>                                       | <b>Material of Construction valves</b>                           |   |
| 2.1  | MOC of valves (sewage water, treated water and chemical dosing)  | CPVC as per ASTM F441 CPVC 4120 Schedule 80/ equivalent.  |
| 2.2  | MOC of compressed air valves                                     | Cast iron for sizes 65NB and above; gunmetal for sizes 50 NB and below.   |
| 2.3  | MOC of service water   | Cast carbon steel or forged carbon steel for sizes 65 mm NB & above and Gun metal for sizes 50 NB and below.                            |
| <b>3.0</b>                                       | <b>Chain Pulley Block</b>  |   |
| 3.1  | Quantity   | 1 No. Chain Pulley Block Each for CW and RW STPs, of  |

985824/2022/PS-PEM-MAX

|   |   |  |                                      |                 |
|---|---|--|--------------------------------------|-----------------|
|  | 2X660 MW THDC KHURJA STPP- CW<br>SYSTEM CIVIL WORKS   |  | SPECIFICATION NO. PE-TS-492-673-A001 |                 |
|   | TECHNICAL SPECIFICATION FOR SEWAGE<br>TREATMENT PLANT |  | SECTION -I                           | SUB SECTION -IA |
|   |   |  | REV. NO. 00                          | DATE :          |

|     |               |   |
|-----|---------------|---|
|     |               | adequate capacity with tripod arrangement, to meet the erection and maintenance requirements are to be provided by bidder |
| 3.2 | Specification | Chain Pulley block shall be designed to duty class 2 as per IS 3832.  |

### PUMPS AND PIPE SELECTION CRITERIA

Pump and Pipeline carrying water and chemicals etc. shall generally be sized on the following velocities. However wherever minimum pipe sizes are defined in the drawing/datasheets, the selected size shall not be less than the specified size.

|                                      | VELOCITY IN m/sec.  |           |                  |
|--------------------------------------|---|-----------|------------------|
|                                      | BELOW 50 MM.  | 50-150 MM | 200 MM AND ABOVE |
| Pump Suction for water               | -----   | 1.2-1.5   | 1.2-1.8          |
| Pump discharge for water             | 1.2-1.8   | 1.8-2.4   | 2.1-2.5          |
| Header for water                     | -----   | 1.5-2.4   | 2.1-2.4          |
| Pump Suction for chemical solution   | 1.0-1.2   | 1.1-1.3   | -----            |
| Pump discharge for chemical solution | 1.2-1.4   | 1.3-1.5   | -----            |
| Gravity flows                        | Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec. |           |                  |

Note 1- All piping system shall be capable of withstanding the maximum pressure in the corresponding line.

Note 2- TDH of all pumps shall be decided by the supplier assuming the following 'C' values in Hazen & Williams equation for calculation of friction loss.

- a) Carbon steel pipes – 100
- b) CI Pipes/ Ductile Iron pipes –100
- c) Rubber lined steel pipe – 120
- d) CPVC/ HDPE pipes – 140
- e) Stainless steel pipes -100

For calculating the required pump head for pump selection, at least 10% margin shall be taken over the pipe friction losses and static head shall be calculated from the minimum water level of the tank/sump/reservoir from which the pumps draw water.

985824/2022/PS-PEM-MAX



FILE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR  
SEWAGE TREATMENT PLANT

SECTION -I

SUB SECTION -IB

REV. NO. 00

DATE :

**SUBSECTION-IB**  
**SPECIFIC TECHNICAL REQUIREMENTS (ELECTRICAL)**

985824/2022/PS-PEM-MAX



**ELECTRICAL EQUIPMENT SPECIFICATION  
FOR  
STP-CW & RW**

2X660MW KHURJA STPP-TG

SPECIFICATION NO.

VOLUME NO. : **II-B**SECTION: **C**REV NO. : **00** DATE: 05/07/2022

SHEET: 1 OF 1

**CONTENTS**

| SECTION | TITLE   | NO OF SHEETS |
|---------|---|--------------|
| C       | TECHNICAL SPECIFICATION                               | 1            |
| C       | ELECTRICAL SCOPE BETWEEN BHEL & VENDOR                | 2            |
| C       | LOAD DATA FORMAT                                      | 1            |
| C       | CABLE SCHEDULE FORMAT & NOTES                         | 3            |
| C       | TECHNICAL REQUIREMENTS-MOTORS                         | 9            |
| D       | GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS          | 5            |
| D       | LV MOTORS DATA SHEET-A                                | 1            |
| D       | LV MOTOR DATA SHEET-C                                 | 2            |
| D       | CABLING EARTHING LIGHTNING AND PROTECTION             | 55           |
| D       | GENERAL TECHNICAL REQUIREMENTS FOR CONDUITS AND PIPES | 6            |
| D       | QUALITY PLAN (FOR MOTORS BELOW 55 KW)                 | 2            |
| D       | QUALITY PLAN (FOR MOTORS ABOVE & 55 KW)               | 9            |
| D       | SUB VENDOR LIST-MOTORS                                | 1            |

The requirements mentioned in Section **B** shall prevail and govern in case of conflict between the same and the corresponding requirements mentioned in the descriptive portion in Section- **II-B**



**ELECTRICAL EQUIPMENT SPECIFICATION  
FOR  
STP-CW & RW  
2X660MW KHURJA STPP  
(TG AND ASSOCIATED PACKAGES)**

SPECIFICATION NO.  
VOLUME NO. : **II-B**  
SECTION: **C**  
REV NO. : **00** DATE: 05/07/2022  
SHEET: 1 OF 1

**1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:**

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for STP-CW & RW.
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL.
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc. shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “both end equipment in vendor’s scope” shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

**2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:**

Refer “Electrical Scope between BHEL and Vendor”.

**3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID**

- 3.1 Bidder shall confirm total compliance to the electrical specification without any deviation from the technical/quality assurance requirements stipulated. In line with this, the bidder shall furnish two signed and stamped copies of the following:
  - a) A copy of this sheet “Electrical Equipment Specification for STP Plant Package and sheet Electrical scope between BHEL and Vendor” with bidder’s signature and company stamp.
  - b) Electrical load requirement in the load data format.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc. is required during tender stage. Any such submission even if made, shall not be considered as part of offer.

**4.0 List of enclosures:**

1. Electrical Scope Between BHEL & Vendor.
2. Electrical Load Data Format.
3. Cable Schedule Format.
4. Technical Requirements-Motors.
5. Data Sheet-A & C
6. Standard Quality Plan
7. Motor Sub Vendor List

REV: 0 DATE: 05.07.22

**ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR****PACKAGE: STP-CW & RW****SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT****PROJECT: 2X660MW KHURJA STPP-TG**

SECTION-C

| S.NO | DETAILS  | SCOPE SUPPLY         | SCOPE E&C              | REMARKS  |
|------|--|----------------------|------------------------|--|
| 1    | 415V MCC   | BHEL                 | BHEL                   | 1. 415 V AC (3 Phase, 4 Wire) /240 V AC supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.<br>2. Interposing relays (RE 302 of Jyoti make or equivalent), if required for PLC and microprocessor based systems, shall be provided by BHEL in MCCs. Requirement of these relays shall be furnished by vendor during detailed engineering stage. |
| 2    | Local Push Button Station (for motors)   | BHEL                 | BHEL                   | Located near the motor.  |
| 3    | Power cables, control cables and screened control cables for<br>a) both end equipment in BHEL's scope<br>b) both end equipment in vendor's scope<br>c) one end equipment in vendor's scope | BHEL<br>BHEL<br>BHEL | BHEL<br>Vendor<br>BHEL | 1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly.<br>2. Termination at BHEL equipment terminals by BHEL.<br>3. Termination at Vendor equipment terminals by Vendor.   |
| 4    | Junction box for control & instrumentation cable   | Vendor               | Vendor                 | Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling ( max 10-12 mtrs) and trunk cable.  |
| 5    | Any special type of cable like compensating, co-axial, prefab, MICC, fibre optical etc.  | Vendor               | Vendor                 | Refer C&I portion of specification for scope of fibre Optical cables if used between PLC/ microprocessor & DCS.  |
| 6    | Cable trays, accessories & cable trays supporting system<br><br>100/ 50 mm cable trays/ Conduits/ Galvanised steel cable troughs for local cabling   | BHEL<br><br>Vendor   | BHEL<br><br>Vendor     | Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs, as per approved layout drawing during contract stage.  |
| 7    | Cable glands ,lugs and bimetallic strip for equipment supplied by Vendor   | Vendor               | Vendor                 | 1. Double compression Ni-Cr plated brass cable glands<br>2. Solder less crimping type heavy duty tinned copper lugs for power and control cables.  |
| 8    | Conduit and conduit accessories for cabling between equipments supplied by vendor  | Vendor               | Vendor                 | Conduits shall be medium duty, hot dip galvanised cold rolled mild steel rigid conduit as per IS: 9537.  |
| 9    | Lighting   | BHEL                 | BHEL                   |  |
| 10   | Equipment grounding & lightning protection   | BHEL                 | BHEL                   | Refer note no. 4 for electronic earthing   |

REV: 0 DATE: 05.07.22

**ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR****PACKAGE: STP-CW & RW****SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT****PROJECT: 2X660MW KHURJA STPP-TG**

SECTION-C

| S.NO | DETAILS  | SCOPE SUPPLY               | SCOPE E&C   | REMARKS  |
|------|--|----------------------------|-------------|--|
| 11   | Below grade grounding  | BHEL                       | BHEL        |  |
| 12   | LT Motors with base plate and foundation hardware  | Vendor                     | Vendor      | Makes shall be subject to customer/ BHEL approval at contract stage.   |
| 13   | Mandatory spares   | Vendor                     | -           | Vendor to quote as per specification.  |
| 14   | Recommended O & M spares   | Vendor                     | -           | As specified elsewhere in specification  |
| 15   | Any other equipment/material/service required for completeness of system but not specified above (to ensure trouble free and efficient operation of the system). | Vendor                     | Vendor      |  |
| 16   | a) Input cable schedules (Control & Screened Control Cables)<br>b) Cable interconnection details for above<br>c) Cable block diagram                             | Vendor<br>Vendor<br>Vendor | -<br>-<br>- | Cable listing for Control and Instrumentation Cable (excluding power cables) in enclosed excel format shall be submitted by vendor during detailed engineering stage.  |
| 17   | Electrical Equipment & cable tray layout drawings  | Vendor                     | -           | For ensuring cabling requirements are met, vendor shall furnish Electrical equipment layout & cable tray layout drawings (both in print form as well as in AUTOCAD) of the complete plant (including electrical area) indicating location and identification of all equipment requiring cabling, and shall incorporate cable trays routing details marked on the drawing as per PEM interface comments. Cabling arrangement of the same (wherever overhead cable trays, trenches, cable ducts, conduits etc.) shall be decided during contract stage. Electrical equipment layout & cable tray layout drawing shall be subjected to BHEL/ customer approval without any commercial implications to BHEL. |
| 18   | Electrical Equipment GA drawing  | Vendor                     | -           | For necessary interface review.  |

NOTES:

1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.
3. In case the requirement of Junction Box arises on account of Power Cable size mis-match due to vendor engineering at later stage, vendor shall supply the Junction Box for suitable termination.
4. Vendor shall indicate location of Electronic Earth pit in their Civil assignment drawing.





**Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.**

1. For the purpose of clarity, it may please be noted that the information given in regard to the cables to be routed through WinPath as per the system elaborated below is called "Cable List", while the term "Cable Schedule" applies to the cable list with routing information added after routing has been carried out.
2. The cable list shall be entered as an MS Excel file in the format as per enclosed template EXT\_CAB\_SCH\_FORMAT.XLS. No blank lines, special characters, header, footer, lines, etc. shall be introduced in the file. No changes shall be made in the title line (first line) of the template.
3. The field properties shall be as under:
  - a. UNITCABLENO: A/N, up to sixteen (16) characters; each cable shall have its own unique, unduplicated cable number. In case this rule is violated, the cable cannot be taken up for routing.
  - b. FROM: A/N, up to sixty (60) characters; the "From" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
  - c. TO: A/N, up to sixty (60) characters; the "To" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
  - d. PURPOSE: A/N, up to sixty (60) characters; the purpose (i.e. power cable/ indication/ measurement, etc.) to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
  - e. REMARKS: A/N, up to forty (40) characters; Any information pertinent to routing to be specified here (e.g., cable number of the cable redundant to the cable number being entered). Information in excess of 40 characters will be truncated after 40 characters.
  - f. CABLESIZE: A/N, 7 characters exactly as per the codes indicated below shall be specified here. The program cannot route cables described in any other way/ format.
  - g. PATHCABLENO: Field reserved for utilization by the program. User shall not enter any information here.
4. One list shall be prepared for each system/ equipment (i.e., separate and unique cable lists shall be prepared for each system).
5. The cables shall be described as per the scheme listed below:

|                    |                     |               |                         |
|--------------------|---------------------|---------------|-------------------------|
| A                  | NN                  | A             | NNN                     |
|                    |                     |               |                         |
| Cable              | No. of cores        | Cable code    | Cable size              |
| Voltage            | (e.g. 01,03,3H, 07) | (See C below) | (e.g. 035,185,2.5, 0.5) |
| Code (see B below) |                     |               |                         |

(A) SYSTEM VOLTAGE CODES:

(ac) A = 11KV, B = 6.6KV, C = 3.3KV, D = 415V, E = 240V, F = 110V

(dc) G = 220V, H = 110V, J = 48V, K = +24V, L = -24V

(B) CABLE VOLTAGE CODES:

A = 11KV (Power cables)

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

- B = 6.6KV (Power cables)  
 C = 3.3KV (Power cables)  
 D = 1.1KV (LV & DC system power & control cables)  
 E = 0.6KV (0.5 sq. mm. Control cables)

(C) CABLE CODES

PVC Copper

- |                     |                         |
|---------------------|-------------------------|
| A = Armoured FRLS   | B = Armoured Non-FRLS   |
| C = unarmoured FRLS | D = Unarmoured Non-FRLS |

PVC Aluminium

- |                     |                         |
|---------------------|-------------------------|
| E = Armoured FRLS   | F = Armoured Non-FRLS   |
| G = unarmoured FRLS | H = Unarmoured Non-FRLS |



XLPE Copper



- |                     |                         |
|---------------------|-------------------------|
| J = Armoured FRLS   | K = Armoured Non-FRLS   |
| L = unarmoured FRLS | M = Unarmoured Non-FRLS |



XLPE Aluminium



- |                     |                         |
|---------------------|-------------------------|
| N = Armoured FRLS   | P = Armoured Non-FRLS   |
| Q = unarmoured FRLS | R = Unarmoured Non-FRLS |



- S = FIRE SURVIVAL CABLES  
 T = TOUGH RUBBER SHEATH  
 U = OVERALL SCREENED  
 V = PAIRED OVERALL SCREENED  
 W = PAIRED INDIVIDUAL SCREENED  
 Y = COMPENSATING CABLES  
 I = PRE-FABRICATED CABLES  
 Z = JELLY FILLED CABLES



| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                                    |                         |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
|--|--|------------------------------------|-------------------------|---|-------|-----|----------------|---|-------|------|-----------------------|---|-------|-----|------------------------|---|-------|----|------------------------------|---|--------------|----|------------------------|---|--------------|----|-------------------|---|-----------------------|----|----------------------|---|--------------|----|-------------------------|---|-------------------------|
|  | <p style="text-align: center;"><b>MOTORS</b></p> <p><b>1.00.00 GENERAL REQUIREMENTS</b></p> <p>1.01.00 For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.</p> <p>1.02.00 All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% &amp; -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.</p> <p>1.03.00 Contractor shall provide fully compatible electrical system, equipment, accessories and services.</p> <p>1.04.00 All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes &amp; Standards, especially the Indian Statutory Regulations.</p> <p>1.05.00 Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.</p> <p>1.06.00 The responsibility of coordination with electrical agencies and obtaining all necessary clearances for contractors equipment and systems shall be under the contractor scope.</p> <p>1.07.00 Degree of Protection</p> <p>Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-</p> <table border="0" style="width: 100%;"> <tr> <td style="width: 5%;">i)</td> <td style="width: 45%;">Indoor motors</td> <td style="width: 10%;">-</td> <td style="width: 40%;">IP 54</td> </tr> <tr> <td>ii)</td> <td>Outdoor motors</td> <td>-</td> <td>IP 55</td> </tr> <tr> <td>iii)</td> <td>Cable box-indoor area</td> <td>-</td> <td>IP 54</td> </tr> <tr> <td>iv)</td> <td>Cable box-Outdoor area</td> <td>-</td> <td>IP 55</td> </tr> </table> <p><b>2.00.00 CODES AND STANDARDS</b></p> <table border="0" style="width: 100%;"> <tr> <td style="width: 5%;">1)</td> <td style="width: 45%;">Three phase induction motors</td> <td style="width: 10%;">:</td> <td style="width: 40%;">IS/IEC:60034</td> </tr> <tr> <td>2)</td> <td>Single phase AC motors</td> <td>:</td> <td>IS/IEC:60034</td> </tr> <tr> <td>3)</td> <td>Crane duty motors</td> <td>:</td> <td>IS:3177, IS/IEC:60034</td> </tr> <tr> <td>4)</td> <td>DC motors/generators</td> <td>:</td> <td>IS/IEC:60034</td> </tr> <tr> <td>5)</td> <td>Energy Efficient motors</td> <td>:</td> <td>IS 12615, IEC: 60034-30</td> </tr> </table> | i)                                 | Indoor motors           | - | IP 54 | ii) | Outdoor motors | - | IP 55 | iii) | Cable box-indoor area | - | IP 54 | iv) | Cable box-Outdoor area | - | IP 55 | 1) | Three phase induction motors | : | IS/IEC:60034 | 2) | Single phase AC motors | : | IS/IEC:60034 | 3) | Crane duty motors | : | IS:3177, IS/IEC:60034 | 4) | DC motors/generators | : | IS/IEC:60034 | 5) | Energy Efficient motors | : | IS 12615, IEC: 60034-30 |
| i)   | Indoor motors  | -                                  | IP 54                   |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| ii)  | Outdoor motors   | -                                  | IP 55                   |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| iii)   | Cable box-indoor area  | -                                  | IP 54                   |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| iv)  | Cable box-Outdoor area   | -                                  | IP 55                   |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| 1)   | Three phase induction motors   | :                                  | IS/IEC:60034            |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| 2)   | Single phase AC motors   | :                                  | IS/IEC:60034            |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| 3)   | Crane duty motors  | :                                  | IS:3177, IS/IEC:60034   |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| 4)   | DC motors/generators   | :                                  | IS/IEC:60034            |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| 5)   | Energy Efficient motors  | :                                  | IS 12615, IEC: 60034-30 |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION B-02<br/>MOTORS</b> | <b>PAGE<br/>1 OF 9</b>  |   |       |     |                |   |       |      |                       |   |       |     |                        |   |       |    |                              |   |              |    |                        |   |              |    |                   |   |                       |    |                      |   |              |    |                         |   |                         |



| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                            |                |
|--|--|----------------------------|----------------|
| <b>3.00.00</b>   | <b>TYPE</b>  |                            |                |
| 3.01.00  | <b>AC Motors:</b> <ol style="list-style-type: none"> <li>Squirrel cage induction motor suitable for direct-on-line starting.</li> <li>Continuous duty LT motors upto 200 KW Output rating (at 50 deg.C ambient temperature), shall be Premium Efficiency class-IE3, conforming to IS 12615, or IEC:60034-30. HT motors shall have minimum design efficiency of 95 % Tolerance on efficiency value applicable as per IEC 60034.</li> <li>Crane duty motors shall be squirrel cage Induction motor as per the requirement.</li> <li>Motor operating through variable frequency drives shall be suitable for inverter duty with VPI insulation. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable.</li> <li>Motors operating through variable frequency drives shall also meet the requirements mentioned in subsection for VFD.</li> </ol> |                            |                |
| 3.02.00  | DC Motors  | Shunt wound                |                |
| <b>4.00.00</b>   | <b>RATING</b>  |                            |                |
| 5.00.00  | <b>TEMPERATURE RISE</b> <p><b>Air cooled motors</b></p> <p>70 deg. C by resistance method for both thermal class 130(B) &amp; 155(F) insulation.</p> <p><b>Water cooled</b></p> <p>80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for both thermal class 130(B) &amp; 155(F) insulation.</p> <p>41 deg.C over inlet cooling water maximum temperature of 39 deg.C for thermal class 90 (Y) wet wound Boiler circulation pump motor.</p>  |                            |                |
| <b>6.00.00</b>   | <b>OPERATIONAL REQUIREMENTS</b>  |                            |                |
| KHURJA SUPER THERMAL POWER PROJECT<br>(2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-B<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371  | SUB-SECTION B-02<br>MOTORS | PAGE<br>2 OF 9 |



| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>    |  |                              |
|--|---|--|------------------------------|
| 6.01.00  | <b>Starting Time</b>  |  |                              |
| 6.01.01  | For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.   |  |                              |
| 6.01.02  | For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.  |  |                              |
| 6.01.03  | For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.  |  |                              |
| 6.01.04  | Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.  |  |                              |
| 6.02.00  | <b>Torque Requirements</b>  |  |                              |
| 6.02.01  | Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor full load torque.   |  |                              |
| 6.02.02  | Pull out torque at rated voltage shall not be less than 205% of full load torque. It shall be 275% for crane duty motors.   |  |                              |
| 6.03.00  | <b>Starting voltage requirement</b> <ul style="list-style-type: none"> <li>(a) Up to 85% of rated voltage for ratings below 110 KW</li> <li>(b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW</li> <li>(c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW</li> <li>(d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW</li> <li>(e) Up to 75 % of rated voltage for ratings above 4000KW</li> </ul> <p>Except AOP &amp; JOP motors running on D.G emergency supply, starting voltage shall be 80%.</p> |  |                              |
| 7.00.00  | <b>DESIGN AND CONSTRUCTIONAL FEATURES</b>   |  |                              |
| 7.01.00  | Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable.   |  |                              |
| 7.02.00  | All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement  |  |                              |
| <b>KHURJA SUPER THERMAL POWER PROJECT</b><br><b>(2X660 MW)</b><br><b>TURBINE GENERATOR AND ASSOCIATED</b><br><b>PACKAGES</b> | <b>TECHNICAL SPECIFICATION</b><br><b>SECTION – VI, PART-B</b><br><b>BID DOC. NO.:</b><br><b>THDC/RKSH/CC-9915-371</b>   | <b>SUB-SECTION B-02</b><br><b>MOTORS</b> | <b>PAGE</b><br><b>3 OF 9</b> |



| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                                    |                        |
|--|--|------------------------------------|------------------------|
| 7.03.00  | <p>of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS: 2148 as detailed below</p> <p>(a) Fuel oil area : Group – IIB</p> <p>(b) Hydrogen generation : Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA / IEC60034)</p> <p>Winding and Insulation</p> <p>(a) Type : Non-hygroscopic, oil resistant, flame resistant</p> <p>(b) Starting duty : Two hot starts in succession, with motor initially at normal running temperature.</p> <p>(c) 11kV &amp; 3.3 kV AC motors : Thermal class 155 (F) insulation.<br/>The winding insulation process shall be Global Vacuum Pressure Impregnated i.e. resin poor method. The lightning Impulse &amp; interturn insulation surge withstand level shall be as per IEC-60034 part-15.<br/><br/>However winding insulation for wet wound Boiler circulation pump motor shall be thermal class 90 (Y) or better.</p> <p>(d) 240VAC, 415V AC &amp; 220V DC motors : Thermal Class ( B ) or better</p> |                                    |                        |
| 7.04.00  | Motors rated above 1000KW shall have insulated bearings/housing to prevent flow of shaft currents.   |                                    |                        |
| 7.05.00  | Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature.  |                                    |                        |
| 7.06.00  | Noise level for all the motors shall be limited to 85dB (A) except for BFP motor for which the maximum limit shall be 90 dB(A). Vibration shall be limited within the limits prescribed in IS/IEC 60034-14. Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.  |                                    |                        |
| 7.07.00  | In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer and 2 numbers duplex platinum resistance type temperature detectors.   |                                    |                        |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION B-02<br/>MOTORS</b> | <b>PAGE<br/>4 OF 9</b> |


| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>    |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
|--|---|--|------------------------------|------|-------------------------------|---|-----|--------------------------------|---|------|-------------------------------|---|-----|------------------|---|----------|
| 7.08.00  | Motor body shall have two earthing points on opposite sides.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.09.00  | 11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.   |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.10.00  | 3.3 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Suitable termination kit shall be provided for the offered Terminal box. The offered Terminal Box shall be suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non-magnetic material for single core cables) shall be provided.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.11.00  | The spacing between gland plate & center of bottom terminal stud shall be as per Table-I.   |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.12.00  | All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.13.00  | The motors shall be suitable for bus transfer schemes provided on the 11kV, 3.3 kV /415V systems without any injurious effect on its life.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.14.00  | For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 7.15.00  | The size and number of cables (for HT and LT motors) to be intimated to the successful bidder during detailed engineering and the contractor shall provide terminal box suitable for the same.  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 8.00.00  | <p>The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance) except for BFP motor.</p> <table border="0" data-bbox="422 1239 1104 1533"> <tr> <td>(a) From 50KW &amp; upto 110KW</td> <td>:</td> <td>11.0</td> </tr> <tr> <td>(b) From 110 KW &amp; upto 200 KW</td> <td>:</td> <td>9.0</td> </tr> <tr> <td>(c) Above 200 KW &amp; upto 1000KW</td> <td>:</td> <td>10.0</td> </tr> <tr> <td>(d) From 1001KW &amp; upto 4000KW</td> <td>:</td> <td>9.0</td> </tr> <tr> <td>(e) Above 4000KW</td> <td>:</td> <td>6 to 6.5</td> </tr> </table> | (a) From 50KW & upto 110KW               | :                            | 11.0 | (b) From 110 KW & upto 200 KW | : | 9.0 | (c) Above 200 KW & upto 1000KW | : | 10.0 | (d) From 1001KW & upto 4000KW | : | 9.0 | (e) Above 4000KW | : | 6 to 6.5 |
| (a) From 50KW & upto 110KW   | :   | 11.0                                     |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| (b) From 110 KW & upto 200 KW  | :   | 9.0                                      |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| (c) Above 200 KW & upto 1000KW   | :   | 10.0                                     |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| (d) From 1001KW & upto 4000KW  | :   | 9.0                                      |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| (e) Above 4000KW   | :   | 6 to 6.5                                 |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 9.00.00  | CW motor shall be designed with minimum power factor of 0.8 at design duty point.   |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| <b>10.00.00</b>  | <b>TYPE TEST</b>  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 10.01.00   | <b>HT MOTORS</b>  |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| 10.01.01   | The contractor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The bidder shall indicate the charges for each of these type   |  |                              |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |
| <b>KHURJA SUPER THERMAL POWER PROJECT</b><br><b>(2X660 MW)</b><br><b>TURBINE GENERATOR AND ASSOCIATED</b><br><b>PACKAGES</b> | <b>TECHNICAL SPECIFICATION</b><br><b>SECTION – VI, PART-B</b><br><b>BID DOC. NO.:</b><br><b>THDC/RKSH/CC-9915-371</b>   | <b>SUB-SECTION B-02</b><br><b>MOTORS</b> | <b>PAGE</b><br><b>5 OF 9</b> |      |                               |   |     |                                |   |      |                               |   |     |                  |   |          |

| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                                    |                        |
|--|--|------------------------------------|------------------------|
|  | <p>tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the employer's engineer.</p>   |                                    |                        |
| 10.01.02   | <p>The type tests shall be carried out in presence of the employer's representative, for which minimum 15 days notice shall be given by the contractor. The contractor shall obtain the employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.</p>  |                                    |                        |
| 10.01.03   | <p>In case the contractor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the contractor.</p>   |                                    |                        |
| 10.01.04   | <p>Further the Contractor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED "and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the employer either at third party lab or in presence of client/ employer's representative and submit the reports for approval.</p> |                                    |                        |
| 10.01.05   | <p><b>LIST OF TYPE TESTS TO BE CONDUCTED</b></p> <p><b>The following type tests shall be conducted on each type and rating of HT motor</b></p> <p>(a) No load saturation and loss curves upto approximately 115% of rated voltage.</p> <p>(b) Measurement of noise at no load.</p> <p>(c) Momentary excess torque test (subject to test bed constraint).</p> <p>(d) Full load test (subject to test bed constraint)</p> <p>(e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp., coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the</p>   |                                    |                        |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION B-02<br/>MOTORS</b> | <b>PAGE<br/>6 OF 9</b> |

| CLAUSE NO.  |  <b>TECHNICAL REQUIREMENTS</b>   |   |                               |
|---|--|---|-------------------------------|
| 10.01.06  | <p>test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose.</p> <p><b>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</b></p> <p><b>The following type test reports shall be submitted for each type and rating of HT motor</b></p> <p>(a) Degree of protection test for the enclosure followed by IR, HV and no load run test.</p> <p>(b) Terminal box-fault level withstand test for each type of terminal box of HT motors only.</p> <p>(c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15</p> <p>(d) Surge-withstand test on interturn insulation shall be as per clause no. 4.2 of IEC 60034, part-15</p> |   |                               |
| 10.02.00  | <p><b>LT Motors</b></p>  |   |                               |
| 10.02.01  | <p>LT Motors supplied shall be of type tested design. During detailed engineering, the contractor shall submit for employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p>   |   |                               |
| 10.02.02  | <p>However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the employer either at third party lab or in presence of client/ employer's representative and submit the reports for approval.</p>   |   |                               |
| 10.02.03  | <p><b>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</b></p> <p><b>The following type test reports shall be submitted for each type and rating of LT motor of above 100 KW only</b></p> <ol style="list-style-type: none"> <li>1. Measurement of resistance of windings of stator and wound rotor.</li> <li>2. No load test at rated voltage to determine input current power and speed</li> <li>3. Open circuit voltage ratio of wound rotor motors ( in case of Slip ring motors)</li> <li>4. Full load test to determine efficiency power factor and slip.</li> <li>5. Temperature rise test.</li> <li>6. Momentary excess torque test.</li> </ol>  |   |                               |
| <p><b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b></p> | <p><b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b></p>   | <p><b>SUB-SECTION B-02<br/>MOTORS</b></p> | <p><b>PAGE<br/>7 OF 9</b></p> |

| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
|--|--|------------------------------------|--|-------------------|--|------------------------|----|-------------------------|-----|--------------------------|-----|--------------------------|-----|--------------------------|-----|--------------------------|-----|---------------------------|-----|--------------------------|---------------------------------------|
| 7.<br>8.<br>9.<br>10.<br>11.<br>12.  | High voltage test.<br>Test for vibration severity of motor.<br>Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section)<br>Test for degree of protection and<br>Over speed test.<br>Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| 10.03.00   | All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| 10.04.00   | The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.<br><br><p style="text-align: center;"><b>TABLE - I</b></p> <p style="text-align: center;"><b>DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS</b></p> <table border="0" style="width: 100%;"> <thead> <tr> <th style="text-align: left;"><b>Motor MCR in KW</b></th> <th style="text-align: right;"><b>Minimum distance between centre of bottom terminal stud and gland plate in mm</b></th> </tr> </thead> <tbody> <tr> <td><b>UP to 3 KW</b></td> <td style="text-align: right;"><b>As per manufacturer's practice.</b></td> </tr> <tr> <td>Above 3 KW - upto 7 KW</td> <td style="text-align: right;">85</td> </tr> <tr> <td>Above 7 KW - upto 13 KW</td> <td style="text-align: right;">115</td> </tr> <tr> <td>Above 13 KW - upto 24 KW</td> <td style="text-align: right;">167</td> </tr> <tr> <td>Above 24 KW - upto 37 KW</td> <td style="text-align: right;">196</td> </tr> <tr> <td>Above 37 KW - upto 55 KW</td> <td style="text-align: right;">249</td> </tr> <tr> <td>Above 55 KW - upto 90 KW</td> <td style="text-align: right;">277</td> </tr> <tr> <td>Above 90 KW - upto 125 KW</td> <td style="text-align: right;">331</td> </tr> <tr> <td>Above 125 KW-upto 200 KW</td> <td style="text-align: right;">385/203 (For Single core cables only)</td> </tr> </tbody> </table> | <b>Motor MCR in KW</b>             | <b>Minimum distance between centre of bottom terminal stud and gland plate in mm</b> | <b>UP to 3 KW</b> | <b>As per manufacturer's practice.</b> | Above 3 KW - upto 7 KW | 85 | Above 7 KW - upto 13 KW | 115 | Above 13 KW - upto 24 KW | 167 | Above 24 KW - upto 37 KW | 196 | Above 37 KW - upto 55 KW | 249 | Above 55 KW - upto 90 KW | 277 | Above 90 KW - upto 125 KW | 331 | Above 125 KW-upto 200 KW | 385/203 (For Single core cables only) |
| <b>Motor MCR in KW</b>   | <b>Minimum distance between centre of bottom terminal stud and gland plate in mm</b>   |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| <b>UP to 3 KW</b>  | <b>As per manufacturer's practice.</b>   |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 3 KW - upto 7 KW   | 85   |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 7 KW - upto 13 KW  | 115  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 13 KW - upto 24 KW   | 167  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 24 KW - upto 37 KW   | 196  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 37 KW - upto 55 KW   | 249  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 55 KW - upto 90 KW   | 277  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 90 KW - upto 125 KW  | 331  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| Above 125 KW-upto 200 KW   | 385/203 (For Single core cables only)  |                                    |  |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION B-02<br/>MOTORS</b> | <b>PAGE<br/>8 OF 9</b>   |                   |  |                        |    |                         |     |                          |     |                          |     |                          |     |                          |     |                           |     |                          |                                       |

| CLAUSE NO.   |  <b>TECHNICAL REQUIREMENTS</b>   |                                    |                        |           |              |      |                              |        |              |      |
|--|--|------------------------------------|------------------------|-----------|--------------|------|------------------------------|--------|--------------|------|
|  | <p>For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm.</p> <p><b>PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE:</b></p> <p>NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows:</p> <table border="1" data-bbox="423 520 998 766"> <thead> <tr> <th>Motor MCR in KW</th> <th>Clearance</th> </tr> </thead> <tbody> <tr> <td>UP to 110 KW</td> <td>10mm</td> </tr> <tr> <td>Above 110 KW and upto 150 KW</td> <td>12.5mm</td> </tr> <tr> <td>Above 150 KW</td> <td>19mm</td> </tr> </tbody> </table> |                                    | Motor MCR in KW        | Clearance | UP to 110 KW | 10mm | Above 110 KW and upto 150 KW | 12.5mm | Above 150 KW | 19mm |
| Motor MCR in KW  | Clearance  |                                    |                        |           |              |      |                              |        |              |      |
| UP to 110 KW   | 10mm   |                                    |                        |           |              |      |                              |        |              |      |
| Above 110 KW and upto 150 KW   | 12.5mm   |                                    |                        |           |              |      |                              |        |              |      |
| Above 150 KW   | 19mm   |                                    |                        |           |              |      |                              |        |              |      |
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION B-02<br/>MOTORS</b> | <b>PAGE<br/>9 OF 9</b> |           |              |      |                              |        |              |      |

|   |   |                              |                  |
|---|---|------------------------------|------------------|
|  | DOCUMENT TITLE<br><br><b>CONDUITS AND PIPES</b> | SPECIFICATION NO. PES-507-27 |                  |
|   |   | VOLUME II B                  |                  |
|   |   | SECTION D                    |                  |
|   |   | REVISION 0                   | DATE: 27/10/2010 |
|   |   | SHEET 6                      | OF 6             |

DATASHEET A

SPECIFIC TECHNICAL REQUIREMENTS

- 1.0 APPLICABLE STANDARDS: IS:9537,IS: 1239, IS:3480
- 2.0 RIGID STEEL CONDUITS & STEEL PIPES
- a) Material: Cold rolled mild steel to IS:226
- b) Applicable standard
- i) Upto 63mm OD: IS:9537 Part I & II
- ii) Above 63mm OD: IS:1239
- c) Surface treatment: Hot dip galvanizing inside & outside as per IS:2629
- d) Wt. of zinc: as per IS 4759
- e) Duty: Medium
- f) Fittings: Screw type as per IS:2667
- 3.0 FLEXIBLE CONDUITS:
- a) Material: Strip steel cold rolled and annealed
- b) Standard applicable: IS: 3480
- c) Surface treatment: Electro galvanized as per IS: 3480
- d) Whether lead coated: YES
- e) Minimum thickness: 25 microns  
of zinc coating
- 4.0 PVC CONDUITS
- a) Material: PVC
- b) Applicable standard: IS: 9537 (Part I & III)



## LV MOTORS DATA SHEET-A

**2X660 MW KHURJA STPP-TG**

SPECIFICATION NO.

VOLUME II B

SECTION D

REV NO. 00 DATE 29.09.20

SHEET 1 OF 1

|      |  |   |  |
|------|--|---|--|
| 1.0  | Design ambient temperature                                       | : | 50 °C  |
| 2.0  | Maximum acceptable kW rating of LV motor                         | : | Upto 200KW   |
| 3.0  | Installation (Indoors/ Outdoors)                                 | : | As required  |
| 4.0  | Details of supply system   |   |  |
| a)   | Rated voltage (with variation)                                   | : | 415V ± 10%   |
| b)   | Rated frequency (with variation)                                 | : | 50 Hz (Variation: ± 5%)  |
| c)   | Combined voltage & freq. variation                               | : | 10% (sum of absolute values)   |
| d)   | System fault level at rated voltage                              | : | 50 kA for 1 sec  |
| e)   | Short time rating for terminal boxes                             |   |  |
|      | * 110 kW and above (Breaker Controlled) :                        |   | 50 KA for 0.25 sec.  |
|      | * Below 110 kW (Contactor Controlled) :                          |   | 50 KA protected by HRC fuse  |
| f)   | LV System grounding  | : | Solidly  |
| 5.0  | Class of insulation  | : | Refer clause 7.03.00 of Motor cust. spec.  |
| 6.0  | Minimum voltage for starting<br>(As percentage of rated voltage) | : | Refer clause 6.03.00 of Motor cust. spec.  |
| 7.0  | Power cables data  | : | Shall be given during Detailed engg.   |
| 8.0  | Earth Conductor Size & Material                                  | : | Shall be given during Detailed engg.   |
| 9.0  | Space heater supply ( <b>30KW &amp; ABOVE</b> )                  | : | 240 V, 1Φ , 50 Hz  |
| 10.0 | Rating up to which Single phase motor                            | : | Acceptable below 0.20 Kw   |
| 11.0 | Locked rotor current   |   |  |
| a)   | Limit as percentage of FLC                                       | : | As per IS 12615  |
| 12.0 | Makes  | : | BHEL/ Customer approval (Package owner to take care)   |
| 13.0 | Paint shade  | : | Blue (RAL 5012)  |
| 14.0 | Additional tests   | : | As per QP  |
| 15.0 | Degree Of protection for motor/ terminal box                     | : | Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-<br>i) Indoor motors - IP 54<br>ii) Outdoor motors - IP 55<br>iii) Cable box-indoor area - IP 54<br>iv) Cable Box-Outdoor area - IP 55 |
| 16.0 | Type of starter provided in MCC                                  | : | As per IS/IEC: IEC-60947-4-1, DOL  |
| 17.0 | Cooling  | : | As per Specification   |

\* LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615

18.0 TESTING REQUIREMENTS: IN LINE WITH SPECIFICATION

➤ **Also detailed Customer spec. for Motors is to be referred as enclosed with technical spec.**

985824/2022/PS-PEM-MAX



TITLE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR  
SEWAGE TREATMENT PLANT

SECTION -I

SUB SECTION -IC

REV. NO. 00

DATE :

## SUBSECTION-IC

### SPECIFIC TECHNICAL REQUIREMENTS (C&I)




**C&I SPECIFICATION FOR  
SEWAGE TREATMENT PLANT CW & RW)**

**THDC INDIA LTD.  
2X660 MW STPP  
KHURJA – CW & RW STP**

**Specific Technical Requirements (C&I)**

- 1.0 Supply of local control panel for SEWAGE TREATMENT PLANT, along with its instrumentation shall be under bidder's scope. Local control panel shall have provision for START/ STOP and indication lamps for automatic operation of individual pumps and the complete system.
- 2.0 415V AC Power supply shall be provided by BHEL at a single point. Further distribution to various instruments/equipment of the system shall be in bidder's scope. Bidder to include necessary UPS/ 24 V DC charger, power distribution board, changeover circuit in their scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
- 3.0 All the transmitters (PT/DPT/Temp Transmitters) and motor operated valve actuators (as applicable) shall be provided by the bidder and shall be PROFIBUS based.
- 4.0 Items not specifically mentioned however required for the completeness of the system shall be supplied by bidder without any commercial implication.
- 5.0 The Contractor shall provide complete Instrumentation for control, monitoring and operation of entire system. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre- bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of customer shall prevail without any commercial implication.
- 6.0 Bidder shall include in his proposal all the instruments and devices that are needed for completeness of the plant auxiliary system/ equipment supplied by the bidder. During detail engineering, if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any commercial implication.
- 7.0 All field instruments enclosure shall be IP65, local panel/cabinet enclosure shall be IP 55, unless otherwise specified. Canopy shall be provided for panels, cabinet enclosures, Junction Boxes etc.

|              | <b>C&amp;I SPECIFICATION FOR<br/>SEWAGE TREATMENT PLANT CW &amp; RW)</b>   | <b>THDC INDIA LTD.<br/>2X660 MW STPP<br/>KHURJA – CW &amp; RW STP</b> |
|---|--|---|
| <p>8.0</p> <p>9.0</p> <p>10.0</p> <p>11.0</p> <p>12.0</p> <p>13.0</p> <p>14.0</p> <p>15.0</p> | <p>The make of the items shall be from sub-vendor list. However, in case of any additional make/model of various instruments/items/systems (apart from Sub-vendor list), same shall be subject of approval of owner/purchaser during detailed engineering stage. No commercial implication in this regard shall be acceptable. In case of any conflict or repetition of clauses in the specification, the more stringent requirements among them are to be complied with.</p> <p>The design, manufacture, inspection, testing, site calibration and installation of all C&amp;I equipment and systems covered under this specification shall conform to the latest editions of applicable codes and standards.</p> <p>Bidder to perform tests of C&amp;I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&amp;C equipment included elsewhere in specification will have to perform by Bidder without any cost implication. The make/model of various instruments/items/systems shall be subject to approval of owner/purchaser during detailed engineering stage. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.</p> <p>The scope of cable shall be referred in Electrical scope split sheet in Electrical portion of the specification.</p> <p>Instrument installation and accessories required for the same shall be in Bidder's scope. However, any instrument/ analyzer installation not covered in the specification, same shall be subject to customer and BHEL approval during detailed engineering. All instruments required for the package shall be supplied, mounted on the gauge board racks, along with accessories like impulse pipe, fittings &amp; valve manifolds etc.</p> <p>Epoxy coated painting is required for all I&amp;C Equipment &amp; Instruments.</p> <p>All the instruments PG/DPG/DPT/PT etc. (as applicable) having contact with corrosive media, water with oil traces, shall be provided with chemical/diaphragm seal.</p> <p>Number of pairs to be selected for Screen/ Control cable</p> <p>(a) F-Type: 2P/4P/8P/12P(Size : 0.5 mm<sup>2</sup>)<br/> (b) G-Type: 2P/4P/8P/12P(Size : 0.5 mm<sup>2</sup>)<br/> (c) Core Cable: 3CX2.5 mm<sup>2</sup>/ 5CX2.5 mm<sup>2</sup>/ 12CX1.5 mm<sup>2</sup></p> |   |



**C&I SPECIFICATION FOR  
SEWAGE TREATMENT PLANT (CW & RW)**

**THDC INDIA LTD.  
2X660 MW STPP  
KHURJA – CW & RW STP**

**Note:-**

1. All equipment items shall be of latest design with proven on track record.
2. The above given scope is indicative & minimum. Any item/ equipment not indicated above however required for the completeness of the system is to be supplied by bidder without any technical, commercial and delivery implication to BHEL.
3. Documents of C&I System shall be submitted to end user/owner for approval during detail engineering. Changes, if any, shall be accommodated by the bidder without any price/time implication.

985824/2022/PS-PEM-MAX



TITLE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT

SECTION -II

SUB SECTION

REV. NO. 00

DATE :

## SECTION-II

### GENERAL TECHNICAL REQUIRMENT

SUB SECTION- II A GENERAL TECHNICAL REQUIRMENT-MECHANICAL

SUB SECTION- II B GENERAL TECHNICAL REQUIRMENT-ELECTRICAL

SUB SECTION- IIC GENERAL TECHNICAL REQUIRMENT-CONTROL & INSTRUMENTATION

985824/2022/PS-PEM-MAX



TITLE:

2X660 MW THDC KHURJA STPP- CW  
SYSTEM CIVIL WORKS

SPECIFICATION NO. PE-TS-492-673-A001

TECHNICAL SPECIFICATION FOR SEWAGE  
TREATMENT PLANT

SECTION -II

SUB SECTION -IIA

REV. NO. 00

DATE :

## SUB SECTION-II A

### GENERAL TECHNICAL REQUIRMENT (MECHANICAL)







## **SUB-SECTION – A-6**



### **LOW PRESSURE PIPING**



KHURJA SUPER THERMAL POWER PROJECT  
(2X660 MW)  
TURBINE GENERATOR AND ASSOCIATED PACKAGES  
BID DOC. NO.: THDC/RKSH/CC-9915-371



SEPARATOR



| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>    |  |                   |
|--|---|--|-------------------|
| 1.00.00  | <b><u>LOW PRESSURE PIPING</u></b>   |  |                   |
| 1.01.00  | <p>The Scope of Low Pressure (LP) piping systems for the following services shall be as defined in various tender drawings &amp; the sub section pertaining to “Terminal points and exclusions” and shall include the following systems:</p> <p>(a.) Circulating water piping (non encased portion).</p> <p>(b.) DM water normal make-up piping (condenser makeup, ECW makeup for ECW tanks, make up to CPU regeneration plant, make up to condensate storage tank etc..)</p> <p>(c.) DM Emergency make up piping (emergency make up to condenser, ECW tanks emergency make-up and condensate storage &amp; transfer system.</p> <p>(d.) Boiler (Steam Generator) and Deaerator fill piping.</p> <p>(e.) Equipment Cooling Water (ECW) piping including its chemical dosing system for primary circuit.</p> <p>(f.) Auxiliary cooling water piping.</p> <p>(g.) HVAC make-up piping</p> <p>(h.) Service water piping.</p> <p>(i.) Instrument Air piping.</p> <p>(j.) Service (plant) Air piping</p> <p>(k.) Potable water system (including tank).</p> <p>(l.) TG sump pit discharge, CW pit discharge and Atmospheric drain Vessel discharge piping.</p> <p>(m.) Drain &amp; vent piping, recirculation piping , Valves, breakdown orifices wherever required and any other piping system required to make the Low Pressure (LP) piping systems in the bidder’s scope complete</p> <p>(n.) Tanks as described elsewhere in the specification for the above systems. (Including condensate storage tanks etc.).</p> |  |                   |
| 1.02.00  | <p>The scope covers the following for the complete LP piping systems mentioned above:</p> <p>a) Design, engineering, manufacturing, supply, fabrication , testing packaging, transportation to site, storage, taking delivery of Employer</p>   |  |                   |
| <b>KHURJA SUPER THERMAL POWER PROJECT (2X660 MW) TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.: THDC/RKSH/CC-9915-371</b>   | <b>SUB-SECTION- A6 LOW PRESSURE PIPING</b> | <b>PAGE1 OF 6</b> |

| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>    |  |                       |
|--|---|--|-----------------------|
|  | <p>supplied equipment from site stores, in plant transportation, erection, cleaning, testing and commissioning of all items i.e., piping fittings, supports/ hangers, valves, actuators, motors, specialities, tanks, chemical dosing system for Equipment Cooling Water System, instruments, drains, vent including drain/ vent valves, air release valves (if applicable) etc.</p> <p>The items though not specifically mentioned or indicated here in but are needed to make the system / equipment complete shall also be furnished and treated as if included in the specification unless otherwise specifically excluded.</p> <p>b) Surface preparation, priming and painting of all non-insulated above ground piping and equipment except galvanized steel piping &amp; surfaces , stainless steel piping &amp; surfaces and gun metal surfaces.</p> <p>Paints and varnishes, primers, thinners etc. as required for anti-corrosive protection of piping &amp; equipment above ground.</p> <p>c) Bidder shall provide anti-corrosive protection (coating &amp; wrapping or anticorrosive tape) on the external surfaces of pipes to all directly buried piping including galvanized carbon steel piping.</p> <p>On the internal surface of all pipes 1000 mm and above, a coat of primer followed by a hot coat of coal tar enamel paint or coal tar epoxy paint shall be applied.</p> <p>Bidder's scope of supply/ work shall include but not be limited to items such as, Pipes, headers and manifolds, bends, elbows, returns, tees, laterals, crosses, reducers/ expanders, caps and closures, couplings, plugs, sleeves, and saddles, stubs and bosses, unions and other similar fittings, flanges, gaskets, fasteners and sealants, ring joints, backing rings, all types of valves including drain/ vent/ air release valves, 3-way valves(where applicable) with test connection for instruments/ manifolds etc.actuators, specialties, orifices, flow nozzles, etc. as per finalized single line flow diagrams and layout drawings/ isometric drawings.</p> <p>Bidder's scope shall also cover distribution of service air , service water and potable water to various facilities/buildings ( under contractor scope)</p> |  |                       |
| <b>KHURJA SUPER THERMAL POWER<br/>PROJECT (2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-A<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>SUB-SECTION- A6<br/>LOW PRESSURE PIPING</b> | <b>PAGE2<br/>OF 6</b> |

| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>   |  |                       |
|--|--|--|-----------------------|
| 1.03.00  | <p>including providing tap offs at various floors of TG building.</p> <p>The scope also covers the following:</p> <ul style="list-style-type: none"> <li>a) Complete assemblies of hangers, secondary supports ( channels/angles etc. taking support from main beam) , anchor, guides, restraints, etc. including welded attachments, clamps, devices tie-rods, turn-buckles, springs and spring cages, shoes, rollers, trapezes etc.</li> <li>b) Weather hoods for pipes crossing ceilings and walls.</li> <li>c) Instrument tapping and stub connections, root valves, 3-way valves (where applicable) with test connections, drains and vent valves &amp; expanders / reducers as required and instruments as indicated else where for instruments supplied by the Contractor..</li> <li>d) Drain funnels, drip pans, moisture traps etc. where ever required shall be provided.</li> <li>e) Instrument tapping, stub connections, root valves and instrument tubing up to root valves for instruments supplied by the Employer for onward connections by the Employer. Contractor shall furnish the list of all such tapping with their X, Y, Z co-ordinates.</li> <li>f) All supporting attachments like plates, saddles, stools, shoes, base plate, saddle plates, angles, channels, I-beams, trapeze, cantilevers, brackets, sways, braces, nuts, bolts, cleats, clamps, needed to complete the erection of piping system covered under this specification.</li> </ul> <p>Anchor bolts, bed &amp; foundation plates, pipe sleeves and Nuts to be embedded in concrete for piping where ever indicated in the drawing. All grouting and chipping work (including supply of cement, sand and stone chips) for equipment foundations, pipe supporting etc.</p> <p>Reinforced concrete valve chambers wherever required for underground piping.</p> <ul style="list-style-type: none"> <li>g) Excavation, preparation of bed, backfilling with compaction of soil and removal of extra-earth to designated places in case of pipes to be buried.</li> </ul> |  |                       |
| <b>KHURJA SUPER THERMAL POWER<br/>PROJECT (2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-A<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION- A6<br/>LOW PRESSURE PIPING</b> | <b>PAGE3<br/>OF 6</b> |

| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>    |  |                       |
|--|---|--|-----------------------|
|  | <p>h) Bidder shall also design, supply, fabricate, erect, set and commission all hangers, tie-rods, turn-buckles, supports, guides, restraints, anchors, etc. as required for the, piping system. This includes the provision of all associated steel work including brackets, cradle supports, duck feet, channels, angles, etc. It is Bidder's responsibility to estimate these requirements and include them in their offer price. Whenever, straight run of the yard pipes are more than 300 meters, flexibility analysis shall be conducted by the contractor to identify the requirement of loops, type of supports etc.</p> <p>.i) In covered concrete trenches bidder shall supply necessary supporting materials such as stools, saddles, base plates, clamps, U-bolts, angles, clips etc.</p> <p>j) Bidder shall supply all necessary drains and vents with drain &amp; vent valves including anti-flash funnels and moisture traps for compressed air system as required for the safe and effective draining-venting of the piping systems based on the approved flow scheme / single line diagram. It is bidder's responsibility to identify the requirements of drains, vents, and supply the necessary pipe work, fittings, hangers and supports etc. for the same.</p> <p>k) Bidder shall supply and install necessary matching pieces as may be needed for connection of piping systems with equipment terminals, valves and specialties.</p> <p>l) Bidder shall erect all instrument impulse piping and fittings from the tap-off point of the last root valve including the root valve and instruments.</p> <p>m) Bidder shall perform necessary internal machining of pipe for installing orifices, flow nozzles, straightening vanes etc.</p> <p>n) The Bidder shall prepare the flow diagrams, detailed dimensional piping layout/ Isometric/ fabrication/ As built drawings of all the systems along with Cross sectional drawings, showing all supports and equipment as required.</p> |  |                       |
| <b>KHURJA SUPER THERMAL POWER<br/>PROJECT (2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-A<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b>   | <b>SUB-SECTION- A6<br/>LOW PRESSURE PIPING</b> | <b>PAGE4<br/>OF 6</b> |

| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>   |  |                   |
|--|--|--|-------------------|
| 1.04.00  | <p>o) In addition to submission of drawings as stipulated above bidder shall also furnish the data/ documents with respect to following:</p> <p>1) Thickness calculation of CW duct/large diameter buried pipes as per AWWA-M-11.</p> <p>p) Bidder's scope of supply for fabrication, erection, cleaning, testing and commissioning of the piping systems installed by him shall include the following:-</p> <p>All welding consumables like welding electrodes, filler rods and wires; gases like oxygen, acetylenes, argon, carbon-dioxide, propane, backing rings etc.</p> <p>Films for radiographic examination of welds.</p> <p>X-ray and Gamma -ray equipment including isotopes, dye penetrants, and other required non-destructive testing materials and equipment (all to be taken back by the Bidder after completion of work).</p> <p>All heating and stress relieving equipment, thermocouples asbestos blankets, cables, temperature recorders, charts heat sensitive chalks and crayons etc. (All to be taken back by bidder after completion of work).</p> <p>All machinery, equipment tools and tackles as required for transportation handling, fabrication and erection (All to be taken back by Bidder after completion of work).</p> <p>All equipment/ materials as required for cleaning, flushing, blowing out and hydro testing of the piping systems; these shall include but not be limited to pumps and compressors with prime movers, instruments, pipe work with supports, valves, strainers and other specialities, blanks, plugs, spool pieces, dummy plates, electrical accessories, etc. (All to be taken back by Bidder after completion of work). All scaffolding materials and false work (To be taken back by Bidder after completion of work).</p> <p>The contractor shall provide Services of erection superintendent and foremen, fitters and riggers, welders, transport and crane operators and other skilled and unskilled labour.</p> |  |                   |
| <b>KHURJA SUPER THERMAL POWER PROJECT (2X660 MW) TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.: THDC/RKSH/CC-9915-371</b>  | <b>SUB-SECTION- A6 LOW PRESSURE PIPING</b> | <b>PAGE5 OF 6</b> |

| CLAUSE NO.   |  <b>SCOPE OF SUPPLY &amp; SERVICES</b>    |  |               |
|--|---|--|---------------|
|  | <p>The design engineering and providing all temporary pipe work as required for erection, cleaning, flushing, blowing out, testing and commissioning of the piping system is the responsibility of the Bidder.</p> <p>The Bidder's scope shall include design, supply of required structural steel (except those which are specifically excluded), their fabrication and erection where ever required.</p> <p>The Bidder shall include in his offer a complete set of special tools and tackles required for handling the various equipment / piping system during maintenance.</p> <p>Bidder scope of services shall include the following also.</p> <ol style="list-style-type: none"> <li>i) Obtaining approval from Chief Inspector of Boiler as per Indian Boiler Regulation, (IBR - 1950) for design/ fabrication/ erection / testing of piping / fittings / valves and specialties coming under the purview of IBR, if any.</li> <li>ii) The bidder shall also identify and satisfy all other statutory code requirement as may be necessary for the piping systems covered in this specification.</li> <li>iii) Certified copies of test reports for all tests and examinations specified in the specification shall be furnished to the Project Manager. Cost of meeting all statutory requirements and furnishing the required certificates shall be deemed included in the proposal price.</li> </ol> <p><b>Note:</b><br/> <b>Bidder to refer Specific Technical Requirements/ Sub Section IA/ Data Sheet-A for minimum technical requirements of the piping, fittings, valves, strainers etc. However, bidder to refer this chapter for other technical requirements of the piping, fittings, valves, strainers etc..</b></p> |  |               |
| KHURJA SUPER THERMAL POWER<br>PROJECT (2X660 MW)<br>TURBINE GENERATOR AND ASSOCIATED<br>PACKAGES | TECHNICAL SPECIFICATION<br>SECTION – VI, PART-A<br>BID DOC. NO.:<br>THDC/RKSH/CC-9915-371   | SUB-SECTION- A6<br>LOW PRESSURE PIPING | PAGE6<br>OF 6 |

985824/2022/PS-PEM-MAX



## TECHNICAL REQUIREMENTS

**LOW PRESSURE PIPING**

1.00.00

**EQUIPMENT SIZING CRITERIA**

1.01.00

All the piping systems and equipment supplied under this package shall be designed to operate without replacement and with normal maintenance for a plant service life of 30 years, and shall withstand the operating parameter fluctuations and cycling which can be normally expected during this period.

1.02.00

For all Low Pressure piping systems covered under this specification, sizing and system design shall be to the requirements of relevant codes and standard indicated. In addition to this, requirements of any statutory code as applicable shall also be taken into consideration.

1.03.00

Inside diameters of piping shall be calculated for the flow requirements of various systems. The velocities for calculating the inside diameters shall be limited to the following:

**a) Water Application**

|     | Pipe Size                        | Water Velocity in m/sec |           |                |
|-----|----------------------------------|-------------------------|-----------|----------------|
|     |                                  | Below 50 mm             | 50-150 mm | 200 mm & above |
| (a) | Pump suction                     | -----                   | 1.2-1.5   | 1.2-1.8        |
| (b) | Pump discharge and recirculation | 1.2-1.8                 | 1.8-2.4   | 2.1-2.5        |
| (c) | Header                           | -----                   | 1.5-2.4   | 2.1-2.4        |

Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally. Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec.

WILLIAM & HAZEN formula shall be used for calculating the friction loss in piping systems with the following "C" value:

|       |                         |     |
|-------|-------------------------|-----|
| (i)   | Carbon steel pipe       | 100 |
| (ii)  | Ductile Iron.           | 140 |
| (iii) | Rubber lined steel pipe | 120 |
| (iv)  | Stainless steel pipe    | 100 |

For calculating the required pump head for pump selection, at least 10% margin shall be taken over the pipe friction losses and static head shall be calculated from the minimum water level of the tank/ sump/ reservoir from which the pumps draw water.

**(b) Compressed Air Application**

Compressed air 15.0 m/sec.(under Average Pressure & Temp. conditions)

|  |   |  |                     |
|--|---|--|---------------------|
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b> | <b>SUB-SECTION- A6<br/>(LOW PRESSURE<br/>PIPING)</b> | <b>PAGE 1 OF 21</b> |
|--|---|--|---------------------|

985824/2022/PS-PEM-MAX



## TECHNICAL REQUIREMENTS



| 1.04.00           | The pipes shall be sized for the worst (i.e. maximum flow, temp. and pressure values) operating conditions.   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
|-------------------|---|--------|-----------------|-------|------|------|--|--|-----------|------|-------|-------|------|------|-------|---|---|---|---|---|--|-----|--|---|---|---|---|--|----------------|--|---|---|---|--|--|-------------------|--|---|---|---|---|---|
| 1.05.00           | Based on the inside dia. so established, thickness calculation shall be made as per ANSI B 31.1 OD and thickness of pipes shall than be selected as per ANSI B 36.10/IS-1239 Heavy grade/IS-3589/ASTM-A-53/API-5L/ANSI B 36.19 as the case may be.  |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.06.00           | Corrosion allowance of 1.6 mm will be added to the calculated thickness being considered (except stainless steel piping).   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.07.00           | Bend thinning allowance/manufacturing allowance etc. shall be as per the requirement of the design code provision.  |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.08.00           | High points in piping system shall be provided with vents along with valves as per the system requirement. Low points shall be provided with drains along with drain valves as per the system requirement. Drain lines shall be adequately sized so as to clear condensate in the lines. Material for drain and vent lines shall be compatible with that of the parent pipe material.   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.09.00           | Material of construction for pipes carrying various fluids shall be as specified elsewhere.   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.10.00           | Compressed air pipe work shall be adequately drained to prevent internal moisture accumulation and moisture traps shall be provided at strategic locations in the piping systems.   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.11.00           | Depending upon the size and system pressure, joints in compressed air pipe work shall be screwed or flanged. The flange shall be welded with the parent pipe at shop and shall be hot dip galvanized before dispatch to site. Alternatively, the flanges on GI pipes may be screwed-on flanges also.  |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.12.00           | Threaded joints shall be provided with Teflon sealant tapes.  |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.13.00           | Following types of valves shall be used for the system/service indicated.   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
|                   | <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2" style="text-align: left;">SYSTEM</th> <th colspan="6" style="text-align: center;">TYPES OF VALVES</th> </tr> <tr> <th style="text-align: center;">Butterfly</th> <th style="text-align: center;">Gate</th> <th style="text-align: center;">Globe</th> <th style="text-align: center;">Check</th> <th style="text-align: center;">Ball</th> <th style="text-align: center;">Plug</th> </tr> </thead> <tbody> <tr> <td>Water</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td></td> </tr> <tr> <td>Air</td> <td></td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td></td> </tr> <tr> <td>Drains &amp; vents</td> <td></td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td></td> <td></td> </tr> <tr> <td>Fuel oil (if any)</td> <td></td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> <td style="text-align: center;">x</td> </tr> </tbody> </table> | SYSTEM | TYPES OF VALVES |       |      |      |  |  | Butterfly | Gate | Globe | Check | Ball | Plug | Water | x | x | x | x | x |  | Air |  | x | x | x | x |  | Drains & vents |  | x | x | x |  |  | Fuel oil (if any) |  | x | x | x | x | x |
| SYSTEM            | TYPES OF VALVES   |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
|                   | Butterfly   | Gate   | Globe           | Check | Ball | Plug |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| Water             | x   | x      | x               | x     | x    |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| Air               |   | x      | x               | x     | x    |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| Drains & vents    |   | x      | x               | x     |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| Fuel oil (if any) |   | x      | x               | x     | x    | x    |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |
| 1.14.0            | Recirculation pipes along with valves, breakdown orifices etc. shall be provided for important pumping systems as indicated in respective process and instrumentation diagrams (P&IDs). The recirculation pipe shall be sized for minimum 30% design flow of single pump operation or the recommended flow of the pump manufacturer whichever is higher.  |        |                 |       |      |      |  |  |           |      |       |       |      |      |       |   |   |   |   |   |  |     |  |   |   |   |   |  |                |  |   |   |   |  |  |                   |  |   |   |   |   |   |

|   |   |  |                     |
|---|---|--|---------------------|
| <b>KHURJA SUPER THERMAL POWER PROJECT</b><br>(2X660 MW)<br><b>TURBINE GENERATOR AND ASSOCIATED PACKAGES</b> | <b>TECHNICAL SPECIFICATION</b><br><b>SECTION – VI, PART-B</b><br><b>BID DOC. NO.:</b><br><b>THDC/RKSH/CC-9915-371</b> | <b>SUB-SECTION- A6</b><br><b>(LOW PRESSURE PIPING)</b> | <b>PAGE 2 OF 21</b> |
|---|---|--|---------------------|

985824/2022/PS-PEM-MAX



## TECHNICAL REQUIREMENTS



|         |   |
|---------|---|
| 2.00.00 | <b>TECHNICAL SPECIFICATION</b>  |
| 2.01.00 | <b>GENERAL</b>  |
|         | Specific technical requirements of low-pressure piping, fittings, supports, valves, specialties and tanks etc. have been covered under this Sub-section. It includes details pertaining to design and material of construction for piping, fittings, valves, equipment, etc. cleaning/surface preparation application of primer and painting on over ground piping. It also includes detailed technical requirement of laying underground/buried piping including water proofing/anti corrosive protection. It also covers design, engineering, manufacturing, fabrication, technical details of piping, valves, specialties, piping hangers / supports, tanks etc. |
| 2.02.00 | <b>Pipes and fittings</b>   |
| 2.02.01 | All low pressure piping systems shall be capable of withstanding the maximum pressure in the corresponding lines at the relevant temperatures. However, the minimum thickness as specified in the following clauses and or respective codes for pipes and fittings shall be adhered to. The bidder shall furnish the pipe sizing/ thickness calculation as per the criteria mentioned above under LP piping equipment sizing criteria of this Technical Specification.  |
| 2.02.02 | Piping and fittings coming under the purview of IBR shall be designed satisfying the requirements of IBR as a minimum.  |
| 2.02.03 | Supporting arrangement of piping systems shall be properly designed for systems where hydraulic shocks and pressure surges may arise in the system during operation. Bidder should provide necessary protective arrangement like anchor blocks/anchor bolt etc. for the safeguard of the piping systems under above mentioned conditions. The requirement will be, however, worked out by the contractor and he will submit the detailed drawings for thrust/anchor block to the Employer. External, and internal, attachments to piping shall be designed so as not to cause flattening of pipes and excessive localized bending stresses.                         |
| 2.02.04 | Bends, loops, off sets, expansion or flexible joints shall be used as required in order to prevent overstressing the piping system and to provide adequate flexibility. Flexibility analysis (using software packages such as Caesar-II etc.) shall be carried out for sufficiently long piping (straight run more than 300M).  |
| 2.02.05 | Wherever Bidder's piping coming under this specification, terminates at an equipments or terminal point not included in this specification, the reaction and the thermal movement imposed by bidder's piping on equipment terminal point shall be within limits to be approved by the Employer.   |
| 2.02.06 | The hot lines shall be supported with flexible connections to permit axial and lateral movements. Flexibility analysis shall be carried out for pipelines which have considerable straight run as indicated above and necessary loops/ expansion joint etc. shall be provided as may be necessary depending on layout.  |
| 2.02.07 | Piping and fittings shall be manufactured by an approved manufacturer of repute. They should be truly cylindrical of clear internal diameter, of uniform thickness, smooth and strong, free from dents, cracks and holes and other defects.   |
| 2.02.08 | For rubber lined ERW pipes, beads shall be removed for pipe size 80 NB and above.   |
| 2.02.09 | Inspection holes shall be provided at suitable locations for pipes 800 Nb and above as required for periodic observations and inspection purposes.  |

|  |   |  |                     |
|--|---|--|---------------------|
| <b>KHURJA SUPER THERMAL POWER PROJECT<br/>(2X660 MW)<br/>TURBINE GENERATOR AND ASSOCIATED<br/>PACKAGES</b> | <b>TECHNICAL SPECIFICATION<br/>SECTION – VI, PART-B<br/>BID DOC. NO.:<br/>THDC/RKSH/CC-9915-371</b> | <b>SUB-SECTION- A6<br/>(LOW PRESSURE<br/>PIPING)</b> | <b>PAGE 3 OF 21</b> |
|--|---|--|---------------------|