


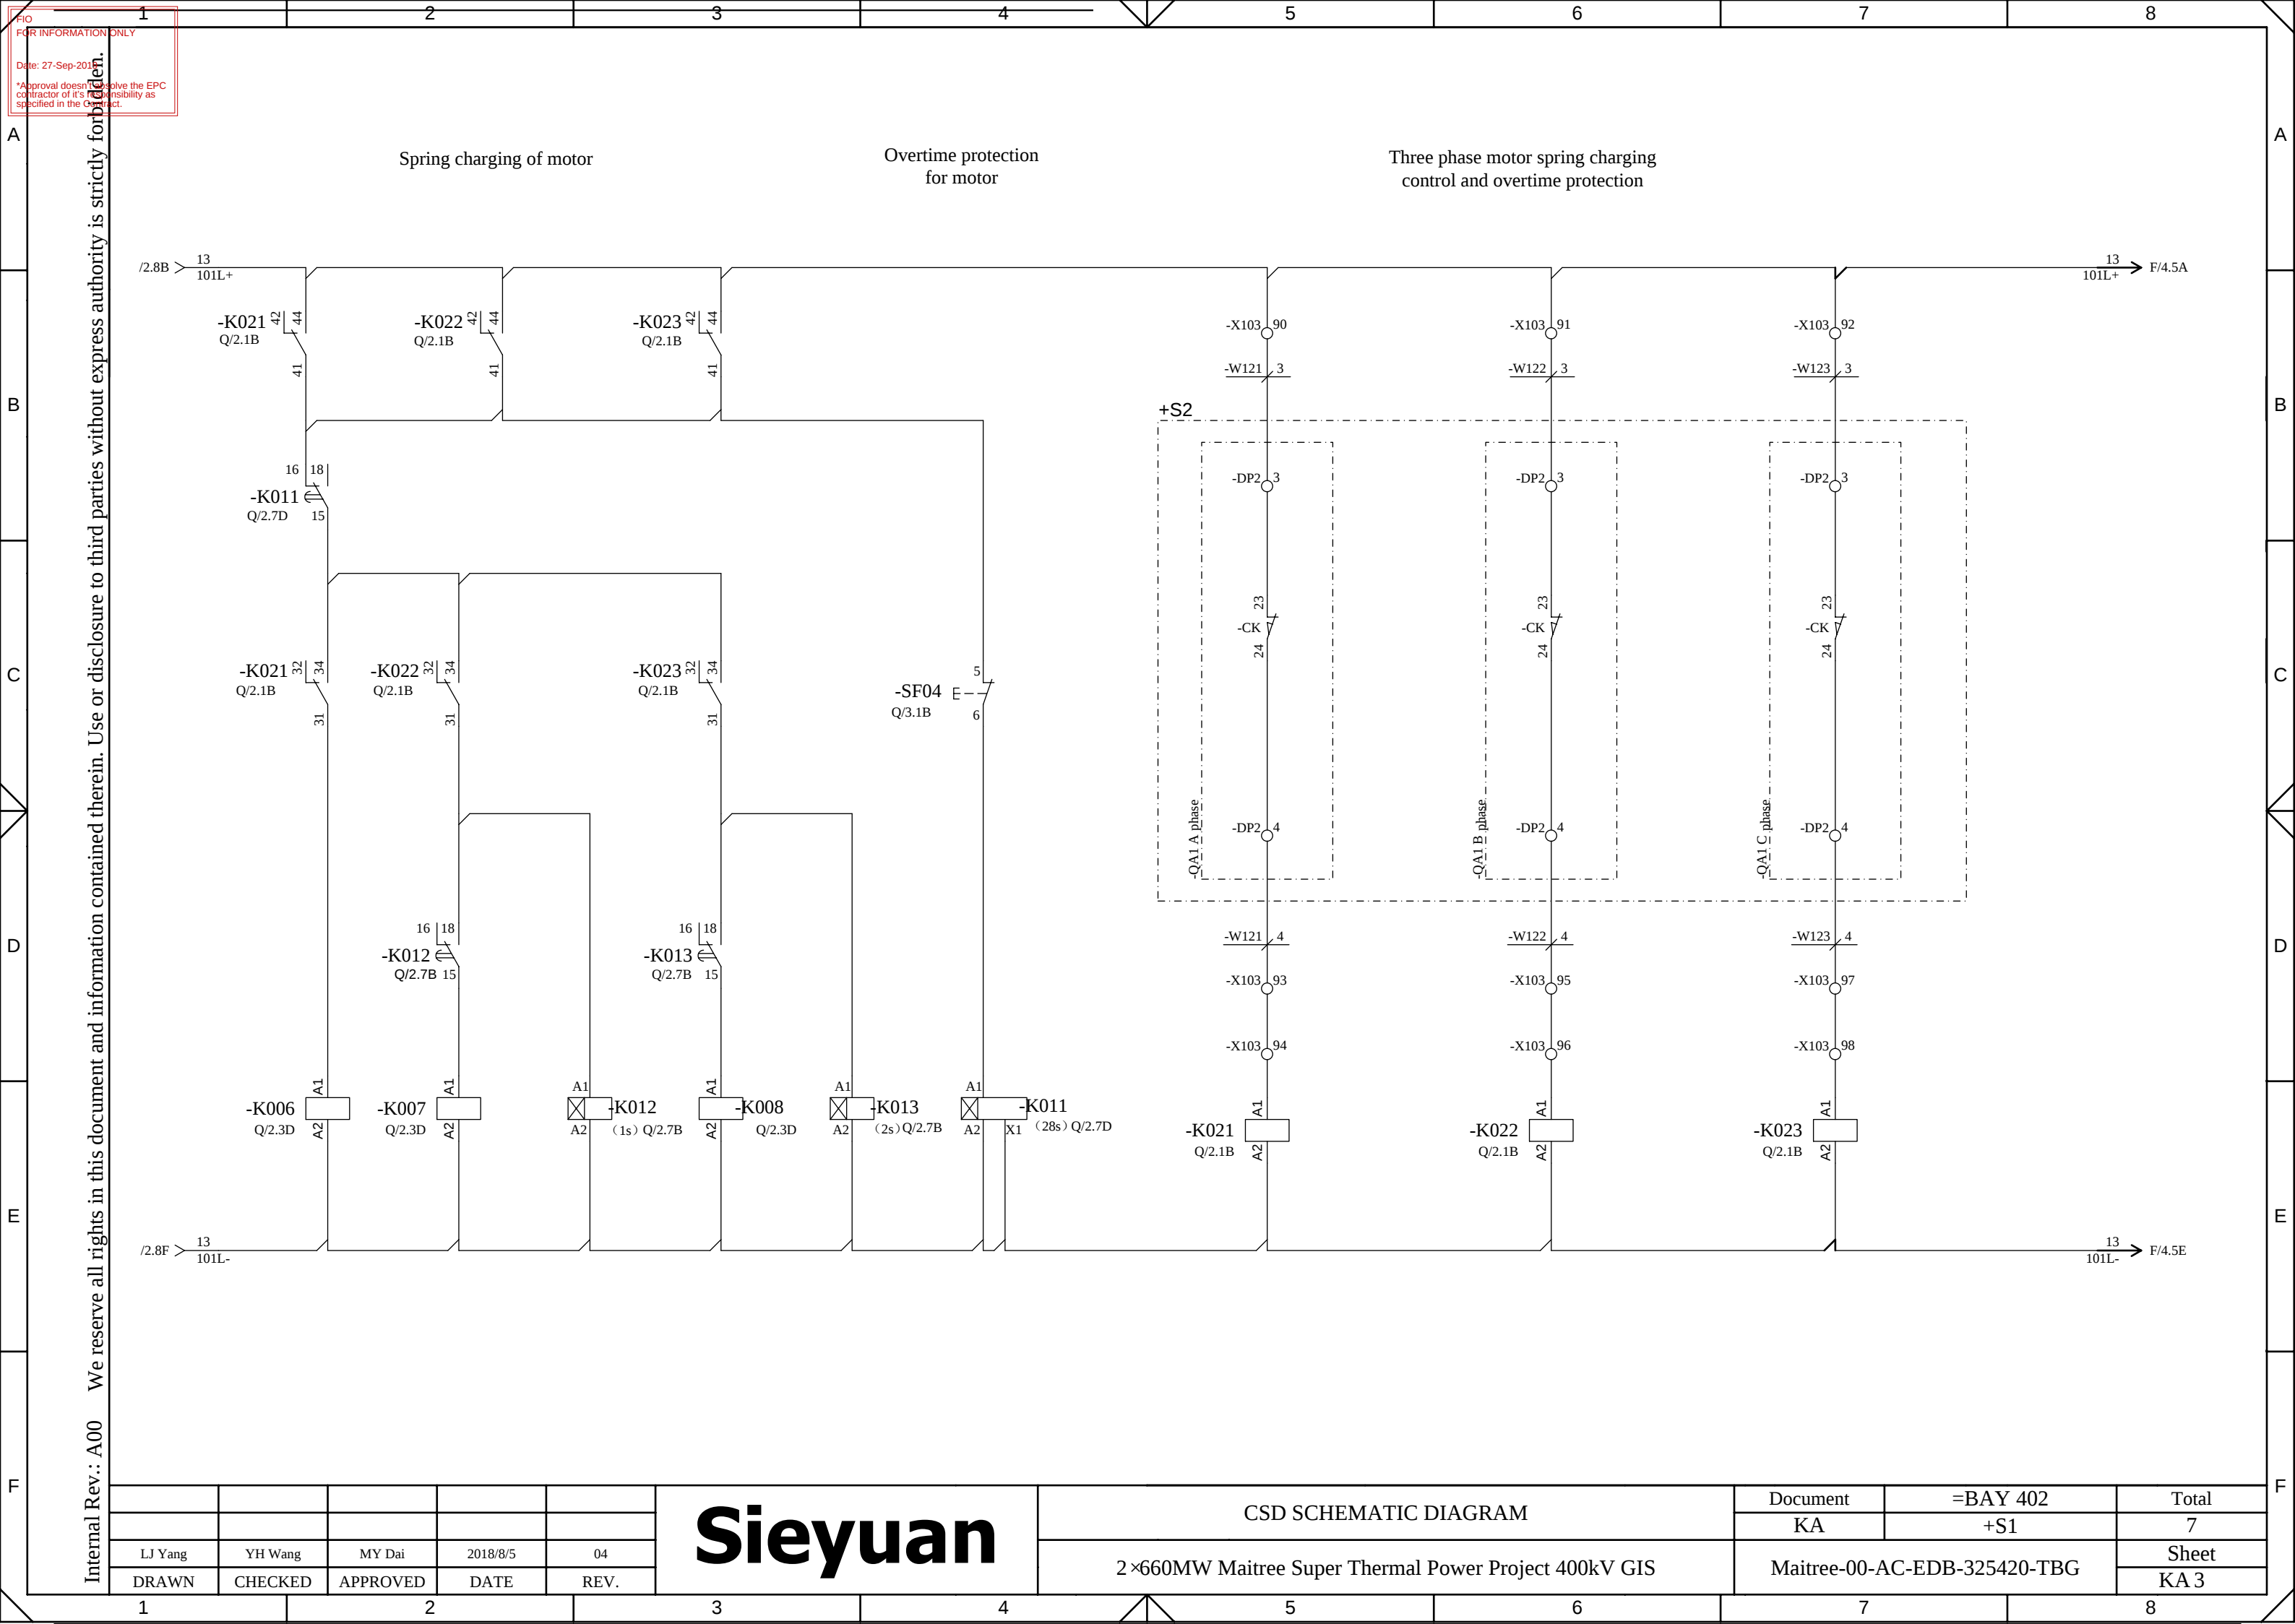

Sieyuan

CSD SCHEMATIC DIAGRAM

2×660MW Maitree Super Thermal Power Project 400kV GIS

Document

=BAY 402

Total

KA

+S1

7

Maitree-00-AC-EDB-325420-TBG

Sheet

KA 3

1

2

3

4

5

6

7

8

LJ Yang

YH Wang

MY Dai

2018/8/5

04

DRAWN

CHECKED

APPROVED




DATE

REV.

FOR INFORMATION ONLY
Date: 27-Sep-2018
*Approval doesn't involve the EPC contractor of it's responsibility as specified in the Contract.

Internal Rev.: A00 We reserve all rights in this document and information contained therein. Use or disclosure to third parties without express authority is strictly forbidden.

2. CSD GA Drawings.

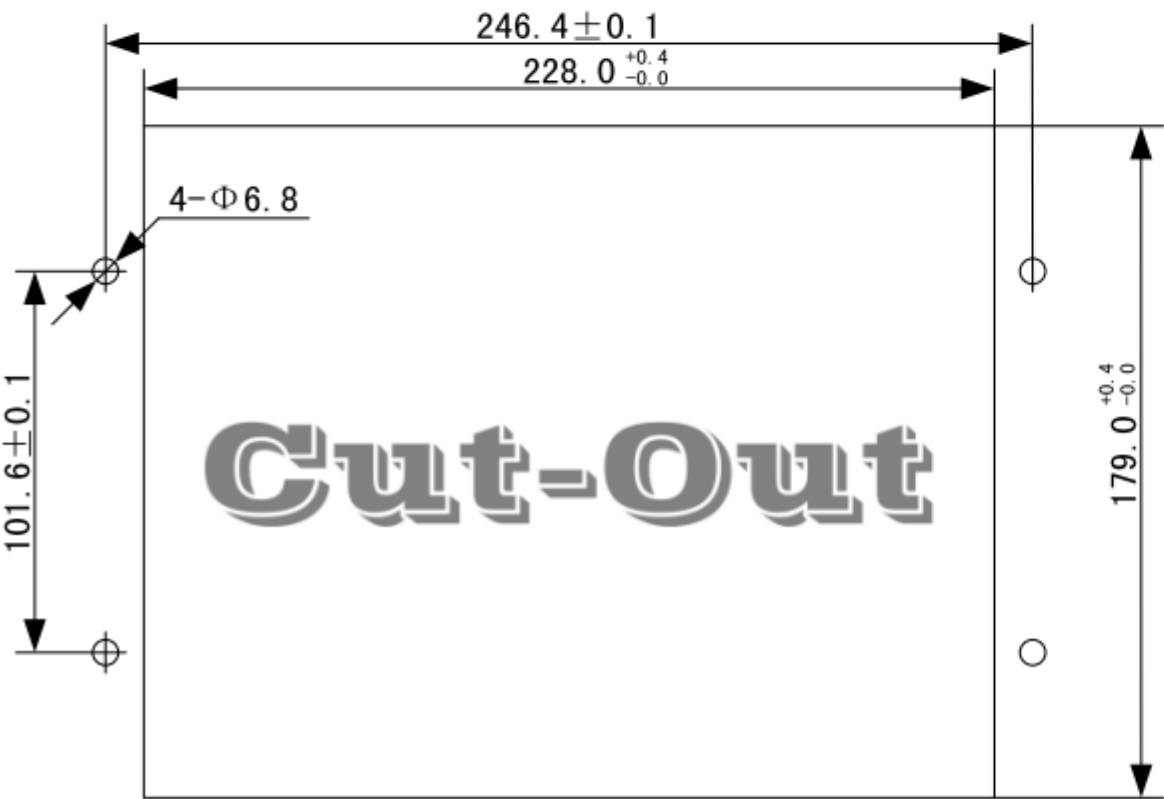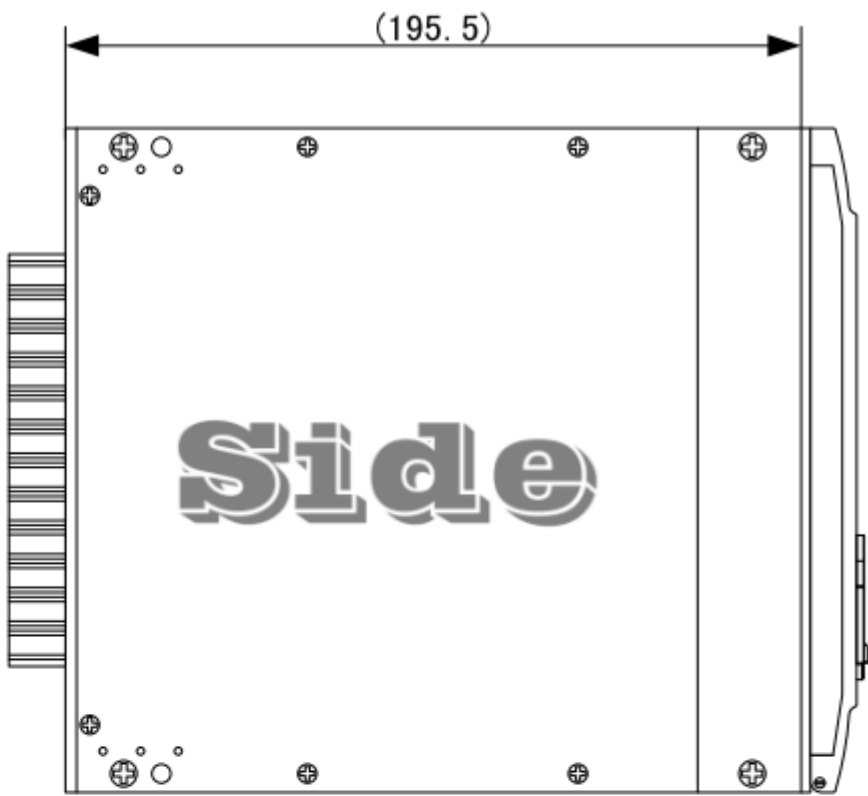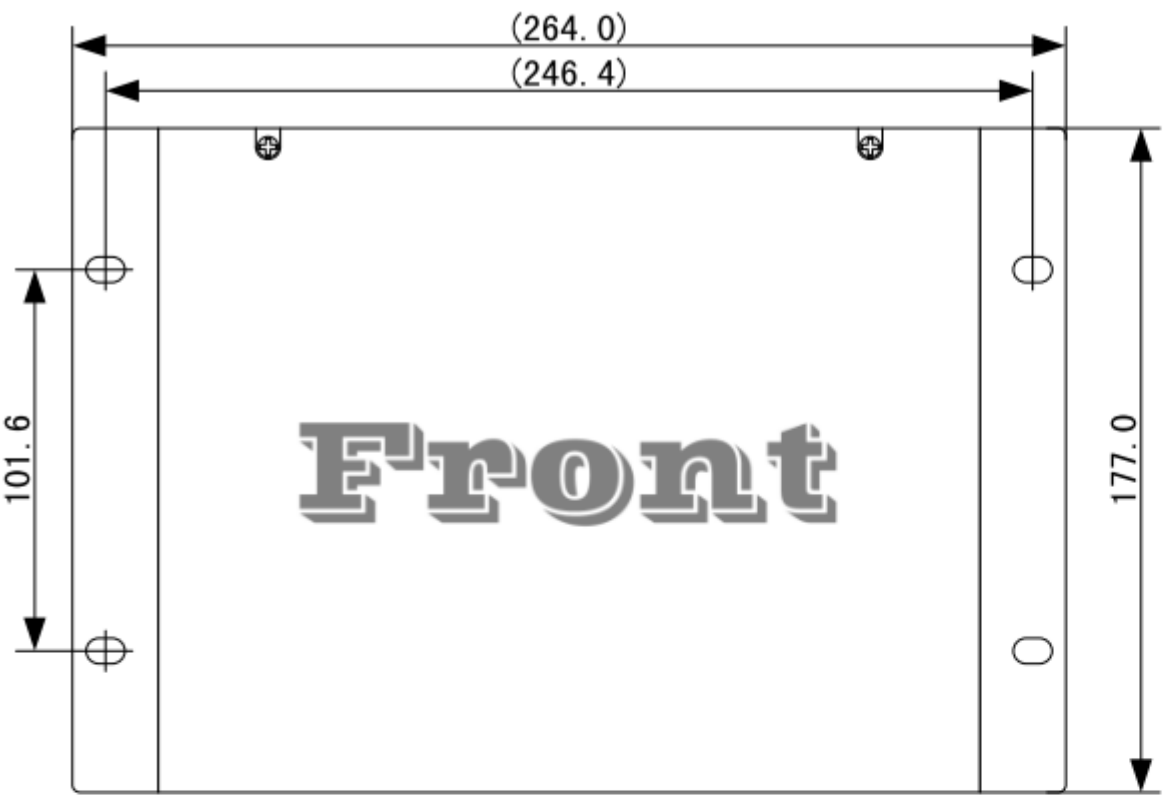

Sieyuan

CSD SCHEMATIC DIAGRAM


2×660MW Maitree Super Thermal Power Project 400kV GIS

Document	=BAY 402	Total
KA	+S1	7
Maitree-00-AC-EDB-325420-TBG		Sheet
		KA 6

Internal Rev.: A00 We reserve all rights in this document and information contained therein. Use or disclosure to third parties without express authority is strictly forbidden.

2. CSD terminal number

- Note:
- 1.CSD Device shall be mounted in CRP.
 - 2.CSD Bypass circuit components shall be mounted & wired up in CRP.
 - 3.Wiring between CSD & Circuit breaker is in scope of BHEL Ltd.

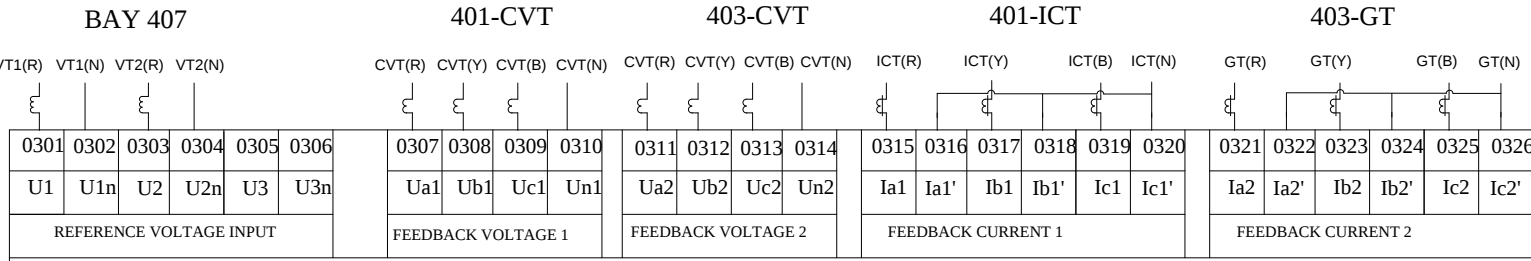


PCS-9830 Switching Controller

B01	B02	B03/4	B05	B06	B07	B08	B09
NR4106MA	NR4138A	NR4412	NR4524A	NR4524A	NR4501	NR4410C	NR4304

0901	SIG_COM	
0902	BO_Fail_	
0903	BO_Alarm_Abn	
0904		
0905		
0906		
0907		
0908		
0909		
0910		
0911		
0912		
0913		
0914		
0915		
0916		
0917		
0918		
0919		
0920	POWER SUPPLY DC220+	
0921	POWER SUPPLY DC220-	
0922	GND	

0801	ENVIRONMENT TEMPERATURE +
0802	ENVIRONMENT TEMPERATURE -
0803	
0804	
0805	
0806	
0807	
0808	
0809	
0810	
0811	
0812	
0813	
0814	
0815	
0816	
0817	
0818	
0819	
0820	
0821	
0822	

SIEYUAN SCOPE

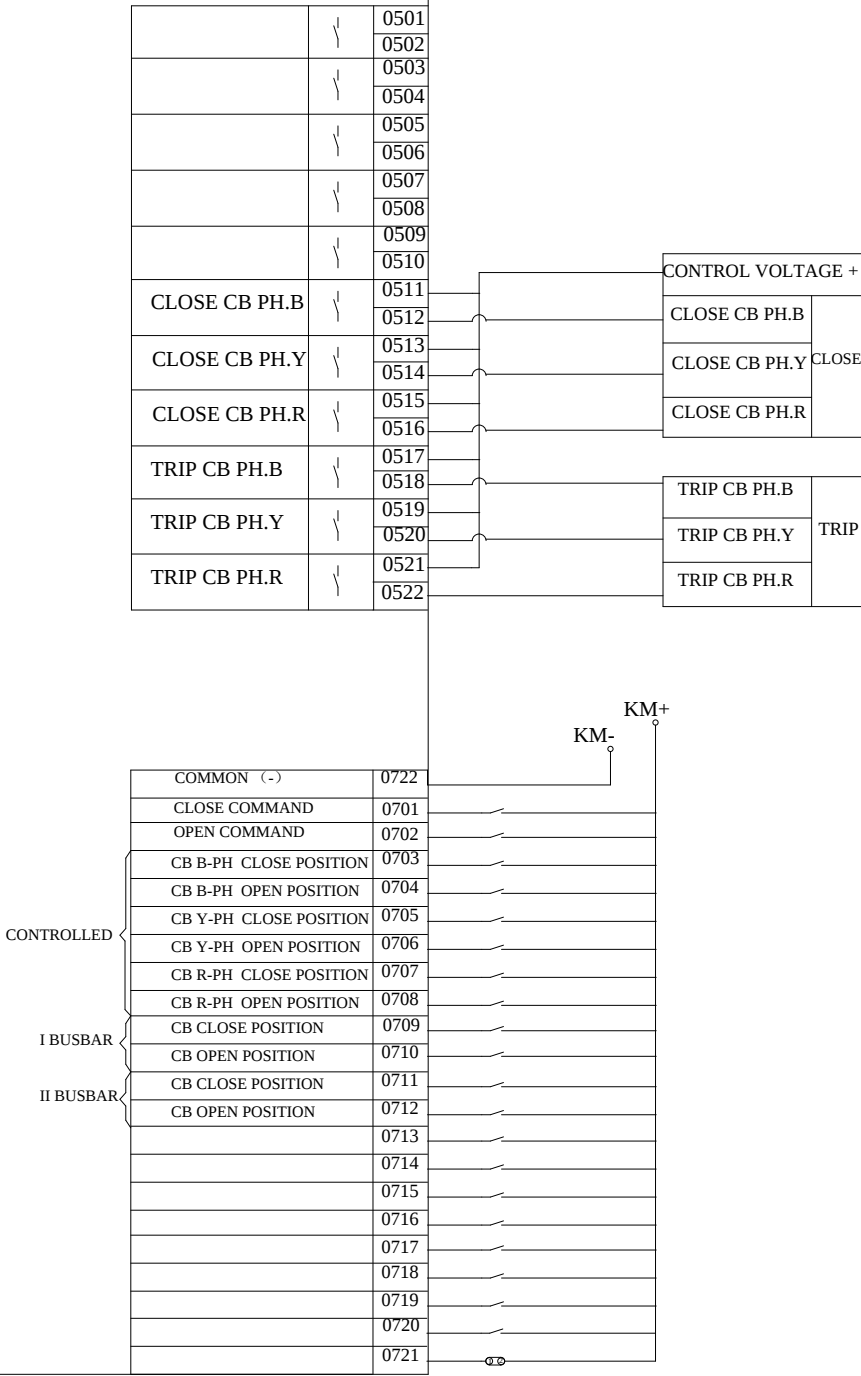

LJ Yang	YH Wang	MY Dai	2018/8/5	04
DRAWN	CHECKED	APPROVED	DATE	REV.

Sieyuan

CSD SCHEMATIC DIAGRAM			Document	=BAY 402	Total
2×660MW Maitree Super Thermal Power Project 400kV GIS			KA	+S1	7
			Maitree-00-AC-EDB-325420-TBG		Sheet
					KA 7

Puneet Chawla

From: skhaldar <skhaldar@bhel.in>
Sent: 04 May 2022 13:22
To: 'Puneet Chawla'
Cc: vivekk@bhel.in; 'Ranajit Dey'
Subject: RE: Guarantee/ Warrantee period requirement for CSD::BIFPCL Maitree

Warrantee clause : 24 months from the date of provisional acceptance. As per site progress, please take provisional acceptance date is August'22.

Regards,
Sandip Kr Haldar
Manager/TBCM
0120-6748556

From: Puneet Chawla [mailto:puneet.chawla@bhel.in]
Sent: 04 May 2022 11:37
To: 'skhaldar'
Cc: vivekk@bhel.in; 'Ranajit Dey'
Subject: Guarantee/ Warrantee period requirement for CSD::BIFPCL Maitree

Dear Sir,

We are raising the Single Tender Purchase Indent for procurement of CSD required at BIFPCL Maitree project.

Please mention Guarantee/Warrantee period (screenshot below) requirement for the respective item.

Technical PQR	v		☒
Technical Specification	v		☒
Estimate ref no generated through e-office	v		☒
Gurantee/Warantee period	v		☒
Single Tender Certificate	v Available Not Applicable		☒

Regards
Puneet Chawla
Dy.Manager-TBEM

 [+91-120-6748499](tel:+91-120-6748499)

Follow us on:

