



 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
32	Limestone silo structures Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 730	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
33	Limestone Silo- Outside surfaces Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240


 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	


34	Limestone Silo- Inside surfaces (Conical portion) (For temporary protection, until erection only)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm conforming to ISO 8501-1	Primer: Two coats of Red Oxide Zinc phosphate primer to IS: 12744 (SS lining is inside the Limestone silo conical portion, hence primer is only envisaged; SS lining will be done at shops itself)	60	NIL	--	60
35	Limestone Silo- Inside surfaces (Cylindrical portion) (For temporary protection, until erection only)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 µm per coat (min.) Zinc dust composition shall be Type-II as per ASTM D520-00	70	--	--	70
36	Air cannon silo, Bag filter & Fan assy, Nozzles& Flanges; FIXING COMP FOR DUCT; TEMPLATE-MISC; SHIM PLATE FOR PIPE RACK (Clause 20.03.00 of Part- C Section VI)	FW 723 FW 724 FW 725 FW 268 FW789 FW711	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
37	Limestone silo approach platform, Platform for Pipe racks & Sub pipe racks (Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767 FW297 FW298	Blast cleaning to Sa 2½/ Acid pickling	Hand rails, Gratings- Hot dip galvanizing to 610gms/sq.m (minimum) as per IS: 4736 and to a coating thickness of 87µm (min).				

 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
38	Limestone silo approach platform, Pipe racks, Sub pipe racks platform- Structures other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767 FW297 FW298	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
39	Limestone Mill – Outside surfaces (Clause 1.04.00 of Part- A Section VI)	FW 735	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with TiO2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint with glossy finish to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
40	Limestone mill- Inside surfaces (For temporary protection, until erection only)	FW 735	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 µm per coat (min.)	70	--	--	70

 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
43	Limestone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydrocyclone waste water tank, Neutralization tank, Process Water tank, Belt filter washing tank, Primary Hydrocyclone feed tank, Clarified water tank, Tank internal structure Inside surfaces - (For temporary protection, until erection only)	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 749 FW 800 FW 802	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) (Liner is inside the tank, hence primer is only envisaged; Protection till erection only)	60	NIL	--	60
44	Process water pipe accessories, Cooling pipe accessories (CI 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	FW 751 FW 752 FW 860 TO FW 871	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) DFT- 25µ / Coat; Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site): Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	200
45	Slurry pipe accessories (CI 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	FW 753 FW 860 TO FW 871	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) DFT- 25µ / Coat; Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site):: Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	200


		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020				
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
46	Service Air pipe accessories (CI 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	FW 754 FW 860 TO FW 871	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site): Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	100	200
47	Instrument air pipe accessories; Absorber Miscellaneous (CI 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	FW 755; FW 307 FW 860 TO FW 871	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site): Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	100	200

 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
48	All valves (Temp <95°C) (Clause 20.03.00 of Part- C Section VI)	FW 815 to FW 854	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) DFT- 25µ / Coat; Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site): Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002	100	200
49	Structure for Pipe racks, Sub pipe racks Trestle for pipe racks, Structures inside Gypsum dewatering building & Ball mill building, TRESTLE MAIN PIPE R-STRETCH-II (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 761 FW 765 FW 768 FW 769 FW 787 FW 791	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
50	Supports for cable trays, Air receivers, commissioning& Mandatory spares, Tools & tackles (Clause 20.03.00 of Part- C Section VI)	FW 779 FW 798 FW 988 FW 996	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100

	BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020					
	Project FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)							
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

1. Gates & Dampers


01	Gates & Dampers > 95° C Insulated Surfaces & Uninsulated surfaces (Cl 1.04.03 of Part- A Section VI, Sub-section III)	57 540 57 550 57 583	Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C) Two coats; 20 µ minimum per coat.	40	--	--	40
02	Seal air piping (Cl 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	57 141	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
03	Blower with Motor, Knife Gate valve, Mounting bracket, Mandatory spares (Cl 10.00.00 of Section-VI, Part-B, Sub-section: I-M3)	57 491 57 497 57 209	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) DFT- 25µ / Coat; Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	50 50	Finish(at site): Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002	100	200
04	Ladder, Cage for Ladder Toe Guard, Plate Floor Grill, Hand Rails, Hand Rail Post Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D	57 466 57 566	Blast cleaning to Sa 2½/ Acid Pickling	Hand rails, Gratings- Hot dip galvanizing to 610gms/sq.m (minimum) as per IS: 4736 and to a coating thickness of 87µm (min).				
05	Other Structural Items- Other than sl.no. 3 of above	57 466 57 566	Blast cleaning to Sa 2½ (Near white metal) with	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane	70	240

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020				
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
	(Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)		surface profile 40-60µm conforming to ISO 8501-1	80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		

2. Painting of Damaged Areas


For areas where paint has deteriorated badly by erosion and areas where the paint film has lost its adhesion property and where the steel has got rusted appreciably: These areas are to be repainted as per the following procedure:

SI No	Surface Location	Surface Preparation	Primer, Intermediate & Finish
1	Paint damaged Components falling under SI.no. 04,05,06,09,10,11 of Fans, SI no.02,03,04, 05,06,07, 09, 13,19,20,21,23,25,27, 29, 31,32 33,38,39,41,42, 49 of FGD and SI no. 5 of GAD.	Hand/ Power Tool cleaning to Bare metal to minimum 6 inches peripheral area adjoining to damaged area	Primer: Zinc rich epoxy to IS 14589 or suitable primer with existing paint scheme, DFT-70µ (If Metal surface exposed) followed by intermediate & finish coat as per respective schemes. If primer is intact- Intermediate & finish as per respective schemes.
2	Paint damaged components failing under other SI Nos of Fans, FGD& GAD	Power Tool Cleaning to Bare metal	Primer and Finish: As given in respective scheme


	BHEL, Ranipet - 632 406, India.			BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020				
	Quality Assurance Department.			NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019				
Painting Scheme			NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020					
Project	FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)							
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

General Notes:

- No painting is required for Galvanized, non-ferrous & stainless steel items, except as indicated above.
- Machined items are to be applied with coat of temporary rust preventive oil.
- PGMAs covered in sub-supplier (ie., Purchased) items viz., Agitator / slide bearing and other sub-delivery components etc., are not indicated in the above list. However, the Painting Schedule for all items supplied by all sub-suppliers and BOI under the scope of BHEL shall be same as for main equipment covered in this document.
- In sub-assy, wherever plates / sheets of thickness less than or equal to 5mm and rods are used, very minor items like clamps, small items etc.- Power Tool or Hand Tool Cleaning to SSPC - SP 3 / SP 2 shall be followed and painting under SI no:01 of Fans shall be followed.
- Ground shade/colour of finish paints and identification tag/band for equipment, fans, piping, pipe services, supporting structures and other components is followed as per NTPC doc no: QS-01-DIV-W-4 at site.
- All components covered under different PGMAs are to be painted. In case any component is left out, the same shall deemed to be included under the relevant section.
- All threaded and other surfaces of foundation bolts and its materials, insulation pins, Anchor channels, Sleeves shall be coated with temporary rust preventive fluid and during execution of civil works; the dried film of coating shall be removed using organic solvents.
- Painting requirement for all electrical equipment shall be as per the details identified in specification for the respective equipment.
- All steel structures shall be provided with painting as given in the specification. Further, painting system shall also meet the requirements of corrosivity category C3 (durability high) as per ISO 12944.
- Finish coat to be applied after an interval of min 10 hrs and within 6 months (after completion of intermediate coat).
- Primer coat on steel shall be applied in shop immediately after blast cleaning by airless spray technique.
- For the portion of steel surfaces embedded in concrete, the surface shall be prepared by Manual cleaning and provided with Primer coat of Chlorinated Rubber based Zinc Phosphate Primer of Minimum 50 Micron DFT.


	BHEL, Ranipet - 632 406, India.		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020					
	Quality Assurance Department.		NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019					
Painting Scheme		NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

Painting Scheme - Details of Procurement & Application Processes							
Sl No	Type of Paint	Specification of Paint	No of Packs	Volume of Solids (% Min)	Mode of Application	Min. Over Coating Interval (Hours)	Shade
01	Epoxy Zinc phosphate primer	IS 13238	2	40	Spray	24	Grey
02	Zinc Ethyl silicate primer (% Zn on dry film= 80 (min))	IS 14946	2	60	Airless Spray only At Shop	24	Grey
03	Epoxy High solid-Polyamide cured Epoxy based MIO pigmented intermediate coat	--	2	80	Airless Spray only At Shop	16	Brown
04	Aliphatic isocyanate acrylic polyurethane paint	IS 13213	2	55	Spray At Shop	16	Windows Grey RAL 7040
05	Heat resistant aluminum paint	IS 13183 Grade II	1	--	Brush/ Spray	24	--
06	Long oil alkyd Synthetic enamel finish paint	IS 2932	1	35	Brush/ Spray	12	Corresponding shade no
07	Synthetic Enamel Intermediate coat	IS 2932	1	40	Brush/ Spray	12	--
08	Red oxide Zinc phosphate primer	IS 12744	1	--	Brush/ spray	12	--


	BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020					
	Project	FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

PGMA Description & Product Details

SI No	PGMA	PGMA Description	Product / Items Details
01	FW 212	Slurry recirculation pump system	RC Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Gear Box, Expansion Bellow, Anchor Bolts & Fasteners, Special Tools
02	FW 219	Absorber system base	Absorber tank bottom plate
03	FW 220	Absorber system structures	Absorber tank structure, Absorber tower structure, Spray headers structure
04	FW 221	Absorber system casing bottom	Absorber tank wall casing- bottom
05	FW 222	Absorber system casing top	Absorber Tank wall casing –Top, Mist Eliminator supports, Spray pipe supports, Internal Beam, Shim plates in Absorber area, Internal Struts
06	FW 223	Absorber system accessories	Nozzles and flanges, Inspection doors & Man holes, Viewing ports, Antifoam dosing equipment, Suction strainers- FRP
07	FW 226	Emergency Quench water tank	Base Plate & its supports, Roof, Shell
08	FW 227	Emergency Quench System	Emergency Quenching Spray Pipe, Nozzle for Emergency Pipe, Fasteners, Gaskets
09	FW 230	Air oxidation System	Oxidation Blowers, Common Base Plate, Coupling and Guard, Anchor Bolts & Fasteners, Expansion Bellow, Special Tools, Suction & Discharge Silencers, Acoustic Enclosure, Water Injection cooling system, Pipe, Valves & Instruments
10	FW 239	Viewing Ports	Viewing Ports
11	FW 244	Oxidation air distribution System	Pipe & Fittings, Flanges, Pipe Hanger, Bottom Elbow, Bottom sliding supports
12	FW 249	Handling Equip- RC Pump	Handling Equip- RC Pump
13	FW 251	Expansion joint between bypass	Expansion joints, Seal Plates & Fasteners
14	FW 252	Expansion joint between scrubbers	Fabric & its fixing fasteners, Sleeves & Flanges, Gaskets
15	FW 255	Ducts between bypass duct inlet & booster fan	Plates & Stiffeners, Guide Vanes
16	FW 256	Ducts between Booster fan & Absorber	Plates & Stiffeners, Guide Vanes
17	FW 257	Ducts between Absorber & stack	Plates & Stiffeners, Guide Vanes
18	FW 260	Duct structure between bypass duct& Booster fan	Duct Supports, Gusset Plate, Divider plate, Internal Struts, Support bearings
19	FW 261 FW 262	Duct structure between booster fan& absorber & Absorber and Stack	Duct Supports, Gusset Plate, Divider plate, Internal Struts, Support bearings
20	FW 292	Structures for Elevator	Columns, Seal Plate, Bracings, Enclosure (Purlin& sheeting)
21	FW 293	Elevator and accessories	Base Frame, Buffer Spring, Mast Section, Cage, Control Panel & AC, Mandatory Spares
22	FW 301	Absorber Beams & Bracings	Absorber Beams & Bracings
23	FW 302, FW 303	Absorber Lower, Upper Floors	Absorber Lower, Upper Floors : R4P9-P4Q0

	BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020					
	Project	FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

SI No	PGMA	PGMA Description	Product /Items Details
24	FW 304, FW 305	Absorber Floor Grills, Stairs & Handrails	Absorber Floor Grills, Stairs & Handrails
25	FW 307	Absorber Miscellaneous	Absorber Miscellaneous
26	FW 380; FW 381; FW 382;	Elevator Column; Elevator Beam And Bracing; Elevator Floors;	Elevator Column; Elevator Beam And Bracing; Elevator Floors;
27	FW 383; FW 384	Elevator Stair and Hand Rail; Elevator Floor Grill	Elevator Stair and Hand Rail; Elevator Floor Grill
28	FW 385;FW 386	Elevator M/C Room & Guide; Inter-Connecting Platform to Absorber	Elevator M/C Room & Guide; Inter-Connecting Platform to Absorber
29	FW 310	Structures for booster fan handling	Columns, Beams, Bracings, Seal plate
30	FW 322	Absorber system casing intermediate	Absorber system casing intermediate panels
31	FW 610 FW 722	Galleries & railings for Scrubbers, Tank	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
32	FW 701	Slurry pumps & accessories	Slurry Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Belt & Pulley, Expansion Bellow, Anchor Bolts & Fasteners, Motor & accessories, Sump Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Belt & Pulley, Anchor Bolts & Fasteners, Motor & accessories
33	FW 710	Monorail for hoist& cranes	Insert Plate, Stiffener plate, Monorail beam
34	FW 721	Agitator support	Channels & Beams
35	FW 730	Limestone silo structures	Columns, Beams, Bracings, Seal plate, Angles, channels
36	FW 731	Limestone silo	Base plate & its supports, Shell, Roof
37	FW 723 FW 724 FW 725	Air cannon Bag filter Nozzles & flanges	Bag filter, Air cannon bin activator, Nozzles & Flanges
38	FW 733	Limestone silo approach platforms	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
39	FW 734	Limestone mill	Wet ball mill, Hydro cyclone- Mill area, Mill circuit pump, Mill separator tank with Agitator
40	FW 742	Lime stone slurry storage tank	Base plate & its supports, Shell, Roof
41	FW 743	Auxiliary Absorber tank	Base plate & its supports, Shell, Roof
42	FW 744	Filtrate tank	Base plate & its supports, Shell, Roof
43	FW 745	Wastage water tank	Base plate & its supports, Shell, Roof
44	FW 747	Hydro cyclone waste water tank	Base plate & its supports, Shell, Roof

 BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:KORB:FGD:G205 Rev: 03 Dt: 15/09/2020 NTPC Contract No: CS-2100-109(3)-9-FC-NOA-6843 Dt: 22/08/2019 NTPC Doc No: 2100-109-PVM-H-001 Rev: 03 Dt: 15/09/2020						
Project		FGD Package of Korba STPS Stage-I, II & III - BHEL Cust Nos: G205-G207 (3x200 MW) & G505-G508 (4x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

SI No	PGMA	PGMA Description	Product /Items Details
45	FW 748 FW 785 FW 786	Process Water tank Belt filter washing tank Primary Hydro cyclone feed tank	Base plate & its supports, Shell, Roof
46	FW 751 FW 752	Process water pipe accessories Cooling water pipe accessories	CS/FRP Pipes & Fittings, Sight Glass, R Orifice, Gaskets & Fasteners
47	FW 753	Slurry pipe accessories	CSRL/FRP Pipes & Fittings, Strainer (Cone), Expansion Joint-Rubber, R Orifice, Gaskets & Fasteners
48	FW 754	Service air pipe accessories	GI Pipes & Fittings, Flexible Hose, Expansion Joint (Metallic), Hose connector, R Orifice, Gaskets & Fasteners
49	FW 755	Instrument air pipe accessories	SS Pipes & Fittings, Strainer(Y Type), Gaskets & Fasteners
50	FW 815 to FW 851	Valves and fittings	Globe valves, Ball Valves, Butterfly Valves, Diaphragm Valves, Gate Valves, Check Valves, Pinch Valves, Knife Gate Valves, Control Valves, Relief Valves
51	FW 761 FW 765	Structures for Pipe racks Structures for Sub pipe racks	Bracings Columns
52	FW 280 FW 281 FW 282 FW 283 FW 740 FW 760 FW 763	Foundation material for duct structure Foundation material for absorber Foundation material for Tanks Foundation material for Pipe racks Foundation material for Elevator Foundation material for RC pump shed	Foundation bolts Template
53	FW 766	Platforms for Pipe rack	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
54	FW 768 FW 769	Trestle for Main & sub Pipe racks	Truss, Beams, Supports for all Pipes
55	FW 779	Supports for cable tray	Double Sup Channel & Base plates, Single Sup Channel & Base plates Cantilever Arm, Fasteners & clamps, Brackets
56	FW 996	Tools	Erection , commissioning, special tools
57	FW 798	Air receivers	Instrument Air receivers, Any Instruments/Valves
58	FW 800	Clarified water tank	Base plate & its supports, Shell, Roof
59	FW 802	Neutralization tank & accessories	Base plate & its supports, Shell, Roof
60	FW 988; FW 997 FW 999	Commissioning spares & Mandatory spares	Startup & commissioning spares, Mandatory spares



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION-C3

REV. 00

DATE: OCT 2021

SHEET : 1 OF 1

TECHNICAL SPECIFICATION OF AGITATORS (ELECTRICAL PORTION)



TITLE:
**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
AGITATOR SYSTEM**

KORBA STPP STAGE – I, II & III

SPECIFICATION NO.
VOLUME NO. :
SECTION:
REV NO. : **00** DATE: 13.05.2020
SHEET: 1 OF 1

CONTENTS

S.No.	TITLE	NO OF SHEETS
1	TITLE SHEET	1
2	CONTENT SHEET	1
3	SPECIFIC TECHNICAL REQUIREMENTS	3
4	ELECTRICAL SCOPE BETWEEN BHEL & VENDOR	1
5	TECHNICAL SPECIFICATION FOR MOTORS, CABLE LUGS AND GLAND	11
6	STANDARD SPECIFICATION FOR LV MOTORS	5
7	REFERENCE QUALITY PLAN	14
8	MOTOR DATASHEET-A (ANNEXURE-I)	1
9	MOTOR DATASHEET-C (ANNEXURE-I)	5
10	ELECTRICAL LOAD DATA FORMAT (ANNEXURE-II)	1
11	CABLE SCHEDULE FORMAT (ANNEXURE-III)	1



TITLE : ELECTRICAL EQUIPMENT SPECIFICATION FOR AGITATOR SYSTEM KORBA STPP STAGE-I, II & III	SPECIFICATION NO.
	VOLUME NO. :
	SECTION :
	REV NO. : 00 DATE : 13.05.2020
	SHEET : 2 OF 3

1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for AGITATOR SYSTEM (all AC & DC loads at different voltage levels like 415V AC, 240 V AC, 220 V DC etc).
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:

Refer “Electrical Scope between BHEL and Vendor”.

3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID

- 3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.



TITLE :
**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
AGITATOR SYSTEM

KORBA STPP STAGE-I, II & III**

SPECIFICATION NO.
VOLUME NO. :
SECTION :
REV NO. : **00** DATE : 13.05.2020
SHEET : 3 OF 3

4.0 List of enclosures :

- a) Electrical scope between BHEL & Vendor
- b) Customer (NTPC) specification for Motors
- c) Customer (NTPC) specification for Cable lugs and glands
- d) Quality plan for Motors and NTPC quality assurance
- e) Datasheets A and C (Annexure-I)
- f) Electrical Load data format (Annexure –II)
- g) BHEL cable listing format (Annexure –III)

STANDARD ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGE: AGITATOR SYSTEM
SCOPE OF VENDOR: SUPPLY PACKAGE
PROJECT: KORBA STPP STAGE – I, II & III

<u>S.NO</u>	<u>DETAILS</u>	<u>SCOPE SUPPLY</u>	<u>SCOPE E&C</u>	<u>REMARKS</u>
1	415 V MCC	BHEL	BHEL	415 V AC (3 PHASE 4 WIRE) supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motors.
3	Power cables, control cables and screened control cables	BHEL	BHEL	Incoming cable from BHEL supplied MCC will be informed by BHEL. Vendor shall provide lugs & glands accordingly.
4	Cable trays, accessories & cable trays supporting system	BHEL	BHEL	
5	Cable glands and Lugs for equipment supplied by Vendor	Vendor	BHEL	a. Double compression Ni-Cr plated brass cable glands b. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
6	Conduit and conduit accessories for cabling between equipment supplied by vendor	BHEL	BHEL	
7	Equipment grounding & lightning protection	BHEL	BHEL	
8	Below grade grounding	BHEL	BHEL	
9	LT Motors with base plate and foundation hardware.	Vendor	BHEL	Makes shall be subject to BHEL approval at contract stage.
10	Mandatory spares	Vendor	-	Vendor to quote as per specification.
11	Recommended O & M spares	Vendor	-	As per specification
12	Any other equipment/ material/ service required for completeness of system but not specified above (to ensure trouble free and efficient operation of the system).	Vendor	BHEL	
13	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:


1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL after award of contract.
2. All QPs shall be subject to approval of BHEL after award of contract without any commercial implication.


SUB-SECTION-II-E2


MOTORS


**LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(3)-9**


CLAUSE NO.	TECHNICAL REQUIREMENTS			
MOTORS				
1.00.00	GENERAL REQUIREMENTS			
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.			
1.02.00	All equipment's shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.			
1.03.00	Contactor shall provide fully compatible electrical system, equipment's, accessories and services.			
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.			
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.			
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for Contactors equipment and systems shall be under the Contactor scope.			
1.07.00	Degree of Protection Degree of protection for various enclosures as per IEC60034-05 shall be as follows :- i) Indoor motors - IP 54 ii) Outdoor motors - IP 55 iii) Cable box-indoor area - IP 54 iv) Cable box-Outdoor area - IP 55			
2.00.00	CODES AND STANDARDS			
1) Three phase induction motors : IS/IEC:60034				
2) Single phase AC motors : IS/ IEC:60034				
3) Crane duty motors : IS:3177, IS/IEC:60034				
4) DC motors/generators : IS:4722, IS/IEC:60034				
5) Energy Efficient motors : IS 12615, IEC:60034-30				
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 1 OF 9	


CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.00.00	TYPE			
3.01.00	AC Motors: <ol style="list-style-type: none"> a) Squirrel cage induction motor suitable for direct-on-line starting. b) Continuous duty LT motors upto 200 KW Output rating (at 50 deg.C ambient temperature), shall be Premium Efficiency class-IE3, conforming to IS 12615, or IEC:60034-30. HT motors shall have minimum design efficiency of 95 %. However, tolerance on this efficiency value shall be applicable as per IEC 60034 c) Crane duty motors shall be slip ring/ squirrel cage Induction motor as per the requirement. d) Motor operating through variable frequency drives shall be suitable for inverter duty with VPI insulation. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable. e) Motors operating through variable frequency drives shall also meet the requirements mentioned in subsection for VFD. 			
3.02.00	DC Motors	Shunt wound.		
4.00.00	RATING			
	(a) Continuously rated (S1). However, crane motors shall be rated for S4 duty, 40% cyclic duration factor.			
	(b) Whenever the basis for motor or driven equipment ratings are not specified in the corresponding mechanical specification sub-sections, maximum continuous motor ratings shall be at least 10% above the maximum load demand of the driven equipment under entire operating range including voltage and frequency variations.			
5.00.00	TEMPERATURE RISE			
	Air cooled motors 70 deg. C by resistance method for both thermal class 130(B) & 155(F) insulation.			
	Water cooled 80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for both thermal class 130(B) & 155(F) insulation.			
6.00.00	OPERATIONAL REQUIREMENTS			
6.01.00	Starting Time			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 2 OF 9	


CLAUSE NO.	TECHNICAL REQUIREMENTS 		
6.01.01	For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.		
6.01.02	For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.		
6.01.03	For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.		
6.01.04	Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.		
6.02.00	Torque Requirements		
6.02.01	Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor rated torque.		
6.02.02	Pull out torque at rated voltage shall not be less than 205% of rated torque. It shall be 275% for crane duty motors.		
6.03.00	Starting voltage requirement (a) Up to 85% of rated voltage for ratings below 110 KW (b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW (c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW (d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW (e) Up to 75 % of rated voltage for ratings above 4000KW		
7.00.00	DESIGN AND CONSTRUCTIONAL FEATURES		
7.01.00	Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable.		
7.02.00	All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACWA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS:2148 as detailed below		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 3 OF 9


CLAUSE NO.	TECHNICAL REQUIREMENTS			
7.03.00	(a) Fuel oil area	:	Group – IIB	
	(b) Hydrogen generation	:	Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA /IEC60034)	
	Winding and Insulation			
	(a) Type	:	Non-hygroscopic, oil resistant, flame resistant	
	(b) Starting duty	:	Two hot starts in succession, with motor initially at normal running temperature.	
	(c) 11kV, 6.6 KV & 3.3 kV AC motors	:	Thermal class 155 (F) insulation.	
			The winding insulation process shall be total Vacuum Pressure Impregnated i.e resin poor method. The lightning Impulse & interturn insulation surge withstand level shall be as per IEC-60034 part-15.	
	(d) 240VAC, 415V AC & 220V DC motors	:	Thermal Class (B) or better	
7.04.00	Motors rated above 1000KW shall have insulated bearings/housing to prevent flow of shaft currents.			
7.05.00	Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature.			
7.06.00	Noise level for all the motors shall be limited to 85 dB(A) except for BFP motor for which the maximum limit shall be 90dB(A). Vibration shall be limited within the limits prescribed in IS:12075 / IEC 60034-14 . Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.			
7.07.00	In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer and minimum 2 numbers duplex platinum resistance type temperature detectors.			
7.08.00	Motor body shall have two earthing points on opposite sides.			
7.09.00	11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.			
7.10.00	3.3/6.6 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Contractor shall provide termination kit for the offered Terminal box. The offered Terminal Box shall be			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 4 OF 9	


CLAUSE NO.	TECHNICAL REQUIREMENTS			
	suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non magnetic material for single core cables) shall be provided.			
7.11.00	The spacing between gland plate & centre of bottom terminal stud shall be as per Table-I.			
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.			
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 6.6 KV, 3.3 kV /415V systems without any injurious effect on its life.			
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.			
7.15.00	The size and number of cables (for HT motors) to be intimated to the successful Contactor during detailed engineering and the Contactor shall provide terminal box suitable for the same.			
8.00.00	<p>The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance):</p> <p>(a) From 50KW & upto 110KW : 11.0</p> <p>(b) From 110 KW & upto 200 KW : 9.0</p> <p>(c) Above 200 KW & upto 1000KW : 10.0</p> <p>(d) From 1001KW & upto 4000KW : 9.0</p> <p>(e) Above 4000KW : 6 to 6.5</p>			
10.00.00	TYPE TEST			
10.01.00	HT MOTORS			
10.01.01	The Contactor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The Contactor shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the Employer's engineer.			
10.01.02	The type tests shall be carried out in presence of the Employer's representative, for which minimum 15 days notice shall be given by the Contactor. The Contactor shall obtain the Employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 5 OF 9	

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
<p>10.01.03</p> <p>10.01.04</p> <p>10.01.05</p>	<p>parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.</p> <p>In case the Contactor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contactor.</p> <p>Further the Contactor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.</p> <p>LIST OF TYPE TESTS TO BE CONDUCTED</p> <p>The following type tests shall be conducted on each type and rating of HT motor</p> <ul style="list-style-type: none"> (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test(subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp.,coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose. 		
<p>LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9</p>	<p>SUB SECTION-II-E2 MOTORS</p>	<p>PAGE 6 OF 9</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS			
10.01.06	<p>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</p> <p>The following type test reports shall be submitted for each type and rating of HT motor</p> <ul style="list-style-type: none"> (a) Degree of protection test for the enclosure followed by IR, HV and no load run test. (b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on inter-turn insulation shall be as per clause no. 4.2 of IEC 60034, part-15 			
10.02.00	LT Motors			
10.02.01	<p>LT Motors supplied shall be of type tested design. During detailed engineering, the Contactor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p>			
10.02.02	<p>However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.</p>			
10.02.03	<p>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</p> <p>The following type test reports shall be submitted for each type and rating of LT motor of above 100 KW only</p> <ul style="list-style-type: none"> 1. Measurement of resistance of windings of stator and wound rotor. 2. No load test at rated voltage to determine input current power and speed 3. Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) 4. Full load test to determine efficiency power factor and slip 5. Temperature rise test 			
<p align="center">LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9</p>	<p align="center">SUB SECTION-II-E2 MOTORS</p>	<p align="center">PAGE 7 OF 9</p>	

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	<p>6. Momentary excess torque test.</p> <p>7. High voltage test</p> <p>8. Test for vibration severity of motor.</p> <p>9. Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section)</p> <p>10. Test for degree of protection and</p> <p>11. Overspeed test.</p> <p>12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1</p> <p>10.03.00 All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.</p> <p>10.04.00 The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.</p>			
<p align="center">LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9</p>	<p align="center">SUB SECTION-II-E2 MOTORS</p>	<p align="center">PAGE 8 OF 9</p>	

CLAUSE NO.	TECHNICAL REQUIREMENTS																															
	<p style="text-align: center;">TABLE - I</p> <p style="text-align: center;">DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS</p> <table border="0" style="width: 100%;"> <thead> <tr> <th style="text-align: left;">Motor MCR in KW</th> <th style="text-align: left;">Minimum distance between centre of bottom terminal stud and gland plate in mm</th> </tr> </thead> <tbody> <tr> <td>UP to 3 KW</td> <td>As per manufacturer's practice.</td> </tr> <tr> <td>Above 3 KW - upto 7 KW</td> <td style="text-align: right;">85</td> </tr> <tr> <td>Above 7 KW - upto 13 KW</td> <td style="text-align: right;">115</td> </tr> <tr> <td>Above 13 KW - upto 24 KW</td> <td style="text-align: right;">167</td> </tr> <tr> <td>Above 24 KW - upto 37 KW</td> <td style="text-align: right;">196</td> </tr> <tr> <td>Above 37 KW - upto 55 KW</td> <td style="text-align: right;">249</td> </tr> <tr> <td>Above 55 KW - upto 90 KW</td> <td style="text-align: right;">277</td> </tr> <tr> <td>Above 90 KW - upto 125 KW</td> <td style="text-align: right;">331</td> </tr> <tr> <td>Above 125 KW-upto 200 KW</td> <td style="text-align: right;">385/203 (For Single core cables only)</td> </tr> </tbody> </table> <p>For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm.</p> <p>PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE:</p> <p>NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows:</p> <table border="0" style="width: 100%;"> <thead> <tr> <th style="text-align: left;">Motor MCR in KW</th> <th style="text-align: left;">Clearance</th> </tr> </thead> <tbody> <tr> <td>UP to 110 KW</td> <td style="text-align: right;">10mm</td> </tr> <tr> <td>Above 110 KW and upto 150 KW</td> <td style="text-align: right;">12.5mm</td> </tr> <tr> <td>Above 150 KW</td> <td style="text-align: right;">19mm</td> </tr> </tbody> </table>				Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm	UP to 3 KW	As per manufacturer's practice.	Above 3 KW - upto 7 KW	85	Above 7 KW - upto 13 KW	115	Above 13 KW - upto 24 KW	167	Above 24 KW - upto 37 KW	196	Above 37 KW - upto 55 KW	249	Above 55 KW - upto 90 KW	277	Above 90 KW - upto 125 KW	331	Above 125 KW-upto 200 KW	385/203 (For Single core cables only)	Motor MCR in KW	Clearance	UP to 110 KW	10mm	Above 110 KW and upto 150 KW	12.5mm	Above 150 KW	19mm
Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm																															
UP to 3 KW	As per manufacturer's practice.																															
Above 3 KW - upto 7 KW	85																															
Above 7 KW - upto 13 KW	115																															
Above 13 KW - upto 24 KW	167																															
Above 24 KW - upto 37 KW	196																															
Above 37 KW - upto 55 KW	249																															
Above 55 KW - upto 90 KW	277																															
Above 90 KW - upto 125 KW	331																															
Above 125 KW-upto 200 KW	385/203 (For Single core cables only)																															
Motor MCR in KW	Clearance																															
UP to 110 KW	10mm																															
Above 110 KW and upto 150 KW	12.5mm																															
Above 150 KW	19mm																															
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9	SUB SECTION-II-E2 MOTORS	PAGE 9 OF 9																													

CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.05.03	1.1 KV grade Straight Through Joint shall be of proven design.			
3.06.00	Cable glands			
3.06.01	Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.			
3.07.00	Cable lugs/ferrules			
3.07.01	Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to IS/DIN standards.			
3.08.00	Trefoil clamps			
3.08.01	Trefoil clamps for single core cables shall be pressure die cast aluminum or fibre glass or nylon and shall include necessary fixing accessories like G.I. nuts, bolts, washers, etc. Trefoil clamps shall have adequate mechanical strength, when installed at 1 mtr intervals, to withstand the forces generated by the peak value of maximum system short circuit current.			
3.09.00	Cable Clamps & Ties			
3.09.01	The cable clamps/ties required to clamp multicore cables shall be of SS-316 material, 12mm wide, polyester coated ladder lock type. The clamps/ties shall have self locking arrangement & shall have sufficient strength. The cable clamps/ties shall be supplied in finished individual pieces of suitable length to meet the site requirements.			
3.10.00	Receptacles			
3.10.01	Receptacles boxes shall be fabricated out of MS sheet of 2mm thickness and hot dipped gavanised or of die-cast aluminium alloy of thickness not less than 2.5 mm. The boxes shall be provided with two nos. earthing terminals, gasket to achieve IP55 degree of protection, terminal blocks for loop-in loop-out for cable of specified sizes, mounting brackets suitable for surface mounting on wall/column/structure, gland plate etc. The ON-OFF switch shall be rotary type heavy duty, double break, AC23 category, suitable for AC supply. Plug and Socket shall be shrouded Die-cast aluminium. Socket shall be provided with lid safety cover. Robust mechanical interlock shall be provided such that the switch can be put ON only when the plug is fully engaged and plug can be withdrawn only when the switch is in OFF position. Also cover can be opened only when the switch is in OFF position. Wiring shall be carried out with 1100 V grade PVC insulated stranded aluminium/copper wire of adequate size. The Terminal blocks shall be of 1100 V grade. The Terminal blocks shall be of 1100 V grade made up of unbreakable polymide 6.6 grade with adequate current rating and size. The welding receptacles shall be provided with RCCB/RCD of 30mA sensitivity having facility for manual testing/checking of operation of RCCB/RCD.			
3.11.00	Cable Drum Lifting Jack			
	The jack for cable drum lifting shall be of screw type with 10 ton capacity. The cable drum jacks shall be manufactured from fabricated steel. The spindles supplied with the cable drum jack shall be manufactured using BSEN-24 grade steel bar with locking collars. Jack			
<p align="center">LOT-3 PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(3)-9</p>	<p align="center">SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p align="center">Page 7 of 23</p>	



TITLE :
GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101
VOLUME NO. :
SECTION :
REV NO. : **00** DATE : 29/08/2005
SHEET : 1 OF 1

GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.: PE-SS-999-506-E101 Rev 00



TITLE :
GENERAL TECHNICAL REQUIREMENTS
FOR
LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101
VOLUME NO. : **II-B**
SECTION : **D**
REV NO. : **00** DATE : 29/08/2005
SHEET : 1 OF 4

1.0 INTENT OF SPECIFICATION

The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer's work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station.

Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.

2.0 CODES AND STANDARDS

Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards:

IS:325	Three phase Induction motors
IS : 900	Code of practice for installation and maintenance of induction motors
IS: 996	Single phase small AC and universal motors
IS: 4722	Rotating Electrical machines
IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines
IS: 4728	Terminal marking and direction of rotation rotating electrical machines
IS: 1231	Dimensions of three phase foot mounted induction motors
IS: 8789	Values of performance characteristics for three phase induction motors
IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment
IS: 2148	Flame proof enclosures for electrical appliance
IS: 5571	Guide for selection of electrical equipment for hazardous areas
IS: 12824	Type of duty and classes of rating assigned
IS: 12802	Temperature rise measurement for rotating electrical machines
IS: 12065	Permissible limits of noise level for rotating electrical machines
IS: 12075	Mechanical vibration of rotating electrical machines

In case of imported motors, motors as per IEC-34 shall also be acceptable.

3.0 DESIGN REQUIREMENTS

3.1 Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A

3.2 Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information
Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.

3.3 Starting Requirements

3.3.1 Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.

3.3.2 Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.



TITLE :
GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101
VOLUME NO. : **II-B**
SECTION : **D**
REV NO. : **00** DATE : 29/08/2005
SHEET : 2 OF 4

The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors.

3.3.3 The following frequency of starts shall apply

- i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature.
- ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour)
- iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor

3.4 **Running Requirements**

3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor.

3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs.

3.5 **Stress During bus Transfer**

3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer.

3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition.

3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065.

3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075.

4.0 **CONSTRUCTIONAL FEATURES**

4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy

4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362.

Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled

4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.



TITLE :
GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101
VOLUME NO. : **II-B**
SECTION : **D**
REV NO. : **00** DATE : 29/08/2005
SHEET : 3 OF 4

- 4.4. Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.
- 4.5. Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.
- 4.6. In case Class 'F' insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class 'B' insulation.
In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.
- 4.7. **Terminals and Terminal Boxes**
- 4.7.1 Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A.

Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet "A".
- 4.7.2 unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.
- 4.7.3 Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.
- 4.7.4 Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.
- 4.7.5 Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.
- 4.7.6 Degree of protection for terminal boxes shall be IP 55 as per IS 4691.
- 4.7.7 Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.
- 4.7.8. Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.
- 4.7.9 Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.
- 4.8 Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.



TITLE :
GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101
VOLUME NO. : **II-B**
SECTION : **D**
REV NO. : **00** DATE : 29/08/2005
SHEET : 4 OF 4

- 4.9.1 Motors provided for similar drives shall be interchangeable.
- 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors.
- 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above.
- 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956.
- 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz.
- 4.9.6 Name plate with all particulars as per IS: 325 shall be provided
- 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions.

5.0 INSPECTION AND TESTING


- 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied.
- 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser.
- 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan.
- 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A.

6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT

- a) OGA drawing showing the position of terminal boxes, earthing connections etc.
- b) Arrangement drawing of terminal boxes.
- c) Characteristic curves:
(To be given for motor above 55 kW unless otherwise specified in Data Sheet).
- i) Current vs. time at rated voltage and minimum starting voltage.
- ii) Speed vs. time at rated voltage and minimum starting voltage.
- iii) Torque vs. speed at rated voltage and minimum voltage.
For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling.
- iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.

SUB-SECTION-V-QE1

MOTORS


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :	
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02	DATE:27.02.2020
		PROJECT:		PO NO.:	
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))	SYSTEM:	SECTION: II	SHEET 1 OF 2

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
					M	C/N				7	8	9	D
1.0	ASSEMBLY	1.WORKMANSHIP	MA	VISUAL	100%	-	MFG. SPEC.	MFG. SPEC.	-DO-	P	-	-	
		2.DIMENSIONS	MA	-DO-	-DO-	-	MFG. DRG./ MFG. SPEC.	MFG. DRG./ MFG. SPEC.	-DO-	P	-	-	
		3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOUR CODE	MA	VISUAL	100%	-	MFG. SPEC./	MFG. SPEC.	-DO-	P	-	-	
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	-	MFG. SPEC/ APPROVED DATASHEET	SAME AS COL.7	LOG BOOK	P	-	-	
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	IS-325 / IS-12615/ APPROVED DATA SHEET	SAME AS COL.7	TEST/ INSPN. REPORT	P	W	W	NOTE -1 & NOTE-2
		2.OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET	TEST/ INSPN. REPORT	P	W	W	NOTE -1 & NOTE-2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. Dutta	Reviewed by:	<i>[Signature]</i>	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		DATE: 27.02.2020 SHEET 2 OF 2
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		SYSTEM:	SECTION: II	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					M	C/N			9	D	M	C	N	
1	2	3	4	5	6		7	8	9	-	**			
4.0	PACKING	3.NAMEPLATE DETAILS SURFACE FINISH & COMPLETENESS	MA MA	VISUAL VISUAL	100% 100%	100% 100%	IS-325 / IS-12615 / APPROVED DATA SHEET AS PER MFG. STANDARD / APPROVED PACKING DRAWING. (#)	SAME AS COL.7 AS PER MFG. STANDARD / APPROVED PACKING DRAWING. (#).	TEST/ INSPN. REPORT INSPC. REPORT		P P	W W	W -	(#) APPLICABLE FOR EXPORT JOBS

NOTES:

- 1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON
- 2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW , ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL FOR REVIEW.
- 6 IN CASE , ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.

LEGENDS:


*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. Dutt	Reviewed by:		

02/3/2020

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:	DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04	
		PROJECT:		PO NO.:	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
					M	C/N				D	M	C	N
10	RAW MATERIAL & BOUGHT OUT CONTROL												
1.1	SHEET STEEL PLATES, SECTION, EYEBOLTS	1.SURFACE CONDITION	MA	VISUAL	100%			FREE FROM BLENKS, CRACKS, WAVINESS ETC	LOG BOOK		P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	-DO-		P	-	-
		3.PROOF LOAD TEST (EYE BOLT)	MA	MECH. TEST	-DO-		-DO-	-DO-	TEST REPORT		PV	-	-
1.2	HARDWARES	1.SURFACE CONDITION	MA	VISUAL	100%			FREE FROM CRACKS, UN-EVENNESS ETC.	-DO-		P	-	-
		2.PROPERTY CLASS	MA	VISUAL	SAMPLES		MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	SUPPLIERS TC & LOG		PV	-	-
1.3	CASTING	1 SURFACE CONDITION	MA	VISUAL	100%			FREE FROM CRACKS, BLOW HOLES ETC.	LOG BOOK		PV	-	-
		2.CHEM & PHY. PROP.	MA	CHEM & MECH TEST	1/HEAT NO.		MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	SUPPLIERS TC		PV	-	-
		3.DIMENSIONS	MA	MEASUREMENT	100%		MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	LOG BOOK		PV	-	-
1.4	PAINT & VARNISH	1.MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100% CONTINUOUS		MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK		PV	-	-

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. DUTTA	Reviewed by:	<i>[Signature]</i>	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

CUSTOMER :

PROJECT:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SPEC. NO :

QP NO.: PED-506-00-Q-007, REV-04

PO NO.:

SECTION: II

DATE: 27.02.2020

SHEET 2 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					M	C/N			9	10	11	12	13	
15	SHAFT (FORGED OR ROLLED)	1. SURFACE COND. 2. CHEM. & PHYSICAL PROPERTIES	MA MA	VISUAL CHEM. & PHYSICAL TESTS	100% 1/HEAT NO. OR HEAT TREATMENT BATCH NO	-	MANUFACTURER'S DRG / SPEC.	FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG / STD.	-DO- SUPPLIER'S TC	-	P PV	- -	- -	VENDOR'S APPROVAL IDENTIFICATION SHALL BE MAINTAINED
16	SPACE HEATERS, CONNECTORS, TERMINAL BLOCKS, CABLES, CABLE LUGS, CARBON BRUSH TEMP DETECTORS, RTD, STD'S	3. DIMENSIONS	MA	MEASUREMENT	100%	-	-DO-	MANUFACTURER'S DRG.	LOG BOOK	-	PV	-	-	FOR DIA OF 55 MM & ABOVE
		4. INTERNAL FLAWS	CR	ULTRASONIC TEST	100%	100%	ASTM-A388	MANUFACTURER'S STD.	-DO-	✓	PW	V	-	
		1. MAKE & RATING	MA	VISUAL	-DO-	-	MANUFACTURER'S DRG./STD.	MANUFACTURER'S DRG./STD.	-DO-	-	PV	-	-	
		2. PHYSICAL COND.	MA	-DO-	-DO-	-	-	NO PHYS. DAMAGE, NO ELECTRICAL DISCONTINUITY	-DO-	-	PV	-	-	
		3. DIMENSIONS (WHEREVER APPLICABLE)	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG / STD	MANUFACTURER'S DRG / STD.	-DO-	-	PV	-	-	
		4. PERFORMANCE/ CALIBRATION	MA	TEST	100%	-	-DO-	-DO-	TEST REPORT	-	PV	-	-	

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by: <i>[Signature]</i>	Hema K.	Checked by: <i>[Signature]</i>	<i>[Signature]</i>	KUNAL GANDHI	
Reviewed by: <i>[Signature]</i>	P. Dutt	Reviewed by:			

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

SPEC. NO.:

CUSTOMER :

QP NO.: PED-506-00-Q.007, REV-04

DATE: 27.02.2020

PROJECT:

PO NO.:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SECTION: II

SHEET 3 OF 9

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
					M	CN			D	M	C	N	
1.7	OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC.	1 SURFACE COND. ETC.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS	TEST REPORT	PV	-	-	* MOTOR MANUFACTURER TO CONDUCT VISUAL CHECK FOR SURFACE FINISH ON RANDOM BASIS (10% SAMPLE) AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY BHEL/CUSTOMER.
		2. OTHER CHARACTERISTICS	MA	TEST	SAMPLE	-	MANUFACTURER'S STD	MANUFACTURER'S STD.	LOG BOOK AND OR SUPPLIER'S TC	PV	-	-	
1.8	SHEET STAMPING (PUNCHED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS (FREE FROM BURR)	LOG BOOK	P	-	-	
		2. DIMENSIONS INCLUDING BURR HEIGHT	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	-DO-	PV	-	-	
		3. ACCEPTANCE TESTS	MA	ELECT & MECH TESTS	-DO-	-	MANUFACTURER'S DRG./ STD.	MANUFACTURER'S DRG./ STD.	SUPPLIER'S TC	PV	-	-	
1.9	CONDUCTORS	1. SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK	PV	-	-	
		2. ELECT. PROP. & MECH. PROP	MA	ELECT. & MECH TEST	SAMPLES	-	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S / SPEC.	SUPPLIER'S TC & VENDOR'S TEST REPORTS	PV	-	-	

BHEL				
ENGINEERING		QUALITY		
Sign & Date	Name	Sign & Date	Name	
Prepared by: <i>H.K. 21/3/2020</i>	Hema K.	Checked by: <i>K. Singh 21/3/20</i>	KUNAL G. ANANDH	
Reviewed by: <i>As 02/3/2020</i>	P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
Sign & Date	Name	Seal	
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

CUSTOMER :

PROJECT:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SPEC. NO.:

QP NO.: PED-506-00-Q-007, REV-04

PO NO.:

SECTION: II

DATE: 27.02.2020

SHEET 4 OF 9

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
					M	C/N			D	M	C	N	
1.10	BEARINGS	3.DIMENSIONS 1.MAKE & TYPE 2.DIMENSIONS	MA MA MA	MEASUREMENT VISUAL MEASUREMENT	-DO- 100% SAMPLE		-DO- MANUFACTURER'S DRG / APPROVED DATASHEET APPROVED DATASHEET	-DO- MANUFACTURER'S DRG / APPROVED DATASHEET APPROVED DATASHEET/ BEARING MANUF'S CATALOGUES	Log Book -DO- -DO-	PV PV PV	- - -	- - -	
1.11	SLIP RING (WHEREVER APPLICABLE)	3.SURFACE FINISH 1 SURFACE COND. 2.DIMENSIONS 3.TEMP WITH- STAND CAPACITY	MA MA MA	VISUAL VISUAL MEASUREMENT ELECT TEST	100% 100% SAMPLE -DO-		-DO- MANUFACTURER'S DRG MANUFACTURER'S STD./ APPROVED DATASHEET	-DO- MANUFACTURER'S DRG MANUFACTURER'S STD./ APPROVED DATASHEET	-DO- -DO- -DO- -DO-	P P PV	- - -	- - -	
1.12	OIL SEALS & GASKETS	4.HWIR 1.MATERIAL OF GASKET 2.SURFACE COND. 3.DIMENSIONS	MA MA MA	-DO- VISUAL VISUAL MEASUREMENT	100% 100% SAMPLE		-DO- MANUFACTURER'S DRG/SPECS MANUFACTURER'S DRG	-DO- MANUFACTURER'S DRG / SPECS. FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG	-DO- -DO- -DO- -DO-	P P P	- - -	- - -	

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:
<i>[Signature]</i> 27/02/2020	Hemra K.	<i>[Signature]</i>	<i>[Signature]</i> 27/02	KUNAL	<i>[Signature]</i>
<i>[Signature]</i> 02/03/2020	P. Dutta				

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
Sign & Date	Name	Seal	
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

SPEC. NO.:

CUSTOMER :

QP NO.: PED-508-00-Q-007, REV-04

DATE: 27.02.2020

PROJECT:

PO NO.:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SECTION: II

SHEET 5 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY				
					M	C/N			D	M	C	N			
2.0	IN PROCESS														
2.1	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNES	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK			P/W	-	-	
		2.DIMENSIONS	MA	MEASUREMENT	-DO-	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-			P	-	-	
2.2	MACHINING	1.FINISH	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK			P	-	-	
		2.DIMENSIONS	MA	MEASUREMENT	-DO-	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-			P	-	-	
		3.SHAFT SURFACE FLOWS	MA	PT	100%	100%	MANUFACTURER'S STD./ ASTM-E165	MANUFACTURER'S STD./ APPROVED DATASHEET.	-DO-	✓		P	V	-	
2.3	PAINING	1.SURFACE PREPARATION	MA	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	SAME AS COL.7	LOG BOOK			P	-	-	
		2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MA	MEASUREMENT BY ELCOMETER	SAMPLE	-	-DO-	-DO-	-DO-			P	-	-	
		3.SHADE	MA	VISUAL	-DO-	-	-DO-	-DO-	LOG BOOK			P	-	-	
		4.ADHESION	MA	CROSS CUTTING & TAPE TEST	-DO-	-	-DO-	-DO-	LOG BOOK			P	-	-	

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:
<i>[Signature]</i>	Hema R.	<i>[Signature]</i>	<i>[Signature]</i>	KUNAL CHANDHI	
<i>[Signature]</i>	P. Dutta				

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

SPEC. NO.:

CUSTOMER :

QP NO.: PED-306-00-Q-007, REV-04

DATE: 27.02.2020

PROJECT:

PO NO.:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SECTION: II

SHEET 6 OF 9

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					M	C/N			D	M	C	N		
2.4	SHEET STACKING	1.COMPLETENESS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-	
		2.COMPRESSION & TIGHTENING	MA	MEASUREMENT	100%	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.5	WINDING	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-	
		2.CLEANLINESS	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		3.IR-HV-IR	CR	ELECT. TEST	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		4.RESISTANCE	CR	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		5.INTERTURN INSULATION	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.6	IMPREGNATION	1.VISCOSITY	MA	PHY. TEST	AT STARTING	-	MANUFACTURER'S STANDARD	MANUFRR'S STANDARD	LOG BOOK		P	-	-	
		2.TEMP. PRESSURE VACCUUM	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		3.NO. OF DIPS	MA	-DO-	CONTINUOUS	CONTINUOUS	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-	THREE DIPS TO BE GIVEN

BHEL

BIDDER/ SUPPLIER

FOR CUSTOMER REVIEW & APPROVAL

ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
Prepared by: <i>[Signature]</i>	Hema K.	Checked by: <i>[Signature]</i>	KUNAL GANDHI
Reviewed by: <i>[Signature]</i>	P. DUTTA	Reviewed by:	

Sign & Date	
Seal	

Doc No:	
Sign & Date	Name
Reviewed by:	
Approved by:	

02/3/2020



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

CUSTOMER :

PROJECT:

ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))

SYSTEM:

SPEC. NO :

QP NO.: PED-508-00-Q-007, REV-04

PO NO.:

SECTION: II

DATE: 27.02.2020

SHEET 7 OF 9

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
					M	C/N				D	M	C	N
2.7	COMPLETE STATOR ASSEMBLY	4.DURATION 1.COMPACTNESS & CLEANLINESS	MA MA	-DO- VISUAL	CONTINUOUS 100%	CONTINUOUS	-DO- -DO-	-DO- -DO-	LOG BOOK LOG BOOK	✓ -	P P	V -	- -
2.8	BRAZING/COMPRESSION JOINT	1.COMPLETENESS 2.SOUNDNESS	CR CR	-DO- MALLETT TEST & UT	-DO- 100%	100%	-DO- -DO-	-DO- -DO-	LOG BOOK LOG BOOK	- ✓	P P	- V	- -
2.9	COMPLETE ROTOR ASSEMBLY	3.HV 1.RESIDUAL UNBALANCE	MA CR	ELECT. TEST DYN. BALANCE	100% -DO-	100%	-DO- MANUFACTURER'S SPEC/ ISO 1940	-DO- MANUFACTURER'S DWG.	LOG BOOK LOG BOOK	✓ -	P P	V -	- -
2.10	ASSEMBLY	2.SOUNDNESS OF DIE CASTING 1.ALIGNMENT 2.WORKMANSHIP 3.AXIAL PLAY 4.DIMENSIONS 5.CORRECTNESS, COMPLETENESS, TERMINATIONS/ MARKING/ COLOUR CODE 6. RTD, RTD & SPACE HEATER MOUNTING.	CR MA MA MA MA MA MA	ELECT (GROWLER TEST) MEAS. VISUAL MEAS. -DO- VISUAL	100% -DO- -DO- 100% -DO- 100%	100%	MANUFACTURER'S SPEC. -DO- -DO- -DO- MANUFACTURER'S DRG/ MANUFACTURER'S SPEC. MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC. -DO- -DO- -DO- MANUFACTURER'S DRG/ RELEVANT IS MANUFACTURER'S SPEC.	LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK	✓ - - ✓ - - ✓	P P P P P P	V - - V - -	- - - -

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:
<i>[Signature]</i>	Hema K.	<i>[Signature]</i>	<i>[Signature]</i>	KUNAL GANDHI	
<i>[Signature]</i>	P. DUTTA				

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
Sign & Date	Name	Seal	
Reviewed by:			
Approved by:			



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS


STANDARD QUALITY PLAN		SPEC. NO.	DATE: 27.02.2020
CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04	
PROJECT:		PO NO.:	
ITEM: AC ELECT. MOTORS 85 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 8 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N				D	M	C	N	
3.0	TESTS	1. TYPE TESTS INCLUDING SPECIAL TESTS	MA	ELECT TEST	1/TYPE/SIZE	1/TYPE/SIZE	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	P	W ¹	W ¹	* NOTE - 1	
		2. ROUTINE TESTS INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	-DO-	-DO-	-DO-	P	V/W ²	V/W ²	* NOTE - 2	
		3. VIBRATION & NOISE LEVEL	MA	-DO-	100%	100%	IS: 12075 / IEC 60034-14 & IS-12065	IS: 12075 / IEC 60034-14 & IS-12065	-DO-	P	V/W ²	V/W ²	* NOTE - 2	
		4. OVERALL DIMENSIONS AND ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET &	TEST/NSPC REPORT	P	W	-		
		5. DEGREE OF PROTECTION	MA	ELECT. & MECH. TEST	1/TYPE/SIZE	1/TYPE/SIZE	IEC 60034-5/IS-12615	APPROVED DATASHEET	TC	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		6. MEASUREMENT OF RESISTANCE OF RTD & BTD	MA	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1/IS-12602	IS-325/IS-12615/IEC-60034 PART-1/IS-12602	-DO-	P	V/W ²	V/W ²	* NOTE - 2	
		7. MEASUREMENT OF RESISTANCE, IR OF SPACE HEATER	MA	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	-DO-	P	V/W ²	V/W ²	* NOTE - 2	
		8. NAME PLATE DETAILS	MA	VISUAL	100%	100%	IS-325/IS-12615 & DATA SHEET	IS-325/IS-12615 & DATA SHEET	TEST/NSPC REPORT	P	V/W ²	V/W ²	* NOTE - 2	
		9. EXPLOSION FLAME PROOF NESS (IF SPECIFIED)	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	1/TYPE	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		10. PAINT SHADE, THICKNESS & FINISH	MA	VISUAL & MEASUREMENT BY ELKOMETER	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC	P	WS	WS	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY * NOTE - 2	

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i> 3/27/2020	Hema K.	Checked by:	<i>[Signature]</i> 3/27/2020	KUNAL GADHVI
Reviewed by:	<i>[Signature]</i> 03/27/2020	P. Datta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO:		
		CUSTOMER :		QP NO.: PED-508-00-Q-007, REV-04		DATE: 27.02.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 9 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					M	C/N			S	D	M	C	N	
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING.	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING.	INSPC. REPORT		P	W		IF APPLICABLE, REFER SEAWORTHY PACKING ALSO.

NOTES:

- 1 DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
- 2 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
- 6 IN CASE , ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, S: MAIN SUPPLIER/ BHEL/ THRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM. W: WITNESS. V: VERIFICATION. AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i> 27/3/2020	Hema K.	Checked by:	<i>[Signature]</i> 27/3/20	KUNAL GRANDHI
Reviewed by:	<i>[Signature]</i> 02/3/2020	P. Datta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			



MOTOR

TESTS/CHECKS TEMS/COMPONENTS	Visual	Dimensional	Make/Type/Rating Physical Inspection	General Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034/IEC 60079-1/ IS-12615	Vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
	Plates for stator frame, end shield, spider etc.	Y	Y	Y	Y	Y				Y									
Shaft	Y	Y	Y	Y	Y	Y			Y										
Magnetic Material	Y	Y	Y	Y			Y			Y		Y							
Rotor Copper/Aluminium	Y	Y	Y	Y			Y		Y			Y							
Stator copper	Y	Y	Y	Y			Y		Y			Y							
SC Ring	Y	Y	Y	Y	Y		Y	Y	Y										
Insulating Material	Y		Y	Y			Y					Y							
Tubes, for Cooler	Y	Y	Y	Y	Y				Y		Y								
Sleeve Bearing	Y	Y	Y	Y	Y				Y		Y								
Stator/Rotor, Exciter Coils	Y	Y	Y				Y	Y											
Castings, stator frame, terminal box and bearing housing etc.	Y	Y	Y	Y	Y			Y											
Fabrication & machining of stator, rotor, terminal box	Y	Y			Y			Y	Y										

CLAUSE NO.

QUALITY ASSURANCE



Wound stator	Y	Y					Y	Y											
Wound Exciter	Y	Y					Y	Y											
Rotor complete	Y	Y					Y						Y	Y					
Exciter, Stator, Rotor, Terminal Box assembly	Y	Y					Y												
Accessories, RTD, BTD, CT, Space heater, antifriction bearing, gaskets etc.	Y	Y	Y																
Complete Motor	Y	Y	Y												Y	Y	Y	Y1	Y

Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW.
 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard
 3. Makes of major bought out items for HT motors will be subject to NTPC approval.
 4. Y1 = for HT Motor / Machines only.



TITLE :
ELECTRICAL EQUIPMENT SPECIFICATION
FOR
AGITATOR SYSTEM
KORBA STPP, STAGE-I,II & III

SPECIFICATION NO.
VOLUME NO. : II-B
SECTION :
REV NO. 00 : DATE : 13.05.2020
SHEET : 1 OF 1

DATASHEET-A


ANNEXURE-I


- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : 200KW *
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Details of supply system
 - a) Rated voltage (with variation) : 415V ± 10%
 - b) Rated frequency (with variation) : 50 Hz + 3 % to - 5%
 - c) Combined voltage & freq. variation : 10% (sum of absolute values)
 - d) System fault level at rated voltage : 50 kA for 1 sec
 - e) Short time rating for terminal boxes
 - o 110 kW and above (Breaker : 50 KA for 0.25 sec. Controlled)
 - o Below 110 kW (Contactor : 50 KA protected by HRC fuse Controlled)
 - f) LV System grounding : Solidly
- 5.0 Winding & Insulation : Class F with temp rise limited to class B
- 6.0 Minimum voltage for starting : 85% for motor ratings below 110kW
(As percentage of rated voltage) 80% for motor ratings from 110kW to 200kW.
- 7.0 Power cables data : Shall be given during detailed engg.
- 8.0 Earth Conductor Size & Material : Shall be given during detailed engg.
- 9.0 Space heater supply (for motors >=30kw) : 240 V, 1ϕ, 50 Hz
- 10.0 Rating up to which Single phase motor : Acceptable below 0.2 kW
- 11.0 Locked rotor current
 - a) Limit as percentage of FLC : As per IS 12615
- 12.0 Makes : BHEL/ Customer approval (Package owner to take care)
- 13.0 Paint shade : Blue (RAL 5012) – Corrosion proof
- 14.0 Degree Of protection for motor/ terminal box : Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-
 - i) Indoor motors - IP 54
 - ii) Outdoor motors - IP 55
 - iii) Cable box-indoor area - IP 54
 - iv) Cable Box-Outdoor area - IP 55


*** LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615**


15.0 TESTING REQUIREMENTS: IN LINE WITH SPECIFICATION


DATASHEET- C

CLAUSE NO.	Bidder's Name			
	DE-1B	LT MOTORS		
	A.	GENERAL		
	5.	Manufacturer & Country of origin. (Shall be as per approved QA make)		
	6.	Equipment driven by motor		
	7.	Motor type		
	8.	Quantity		
	B.	DESIGN AND PERFORMANCE DATA		
	18.	Frame size		
	19.	Type of duty		
	20.	Type of enclosure /Method of cooling/ Degree of		
	21.	Applicable standard to which motor generally		
	22.	Efficiency class as per IS 12615		
	23.	(a)Whether motor is flame proof	Yes/No	
		(b)If yes, the gas group to which it conforms as per IS:2148		
	24.	Type of mounting		
	25.	Direction of rotation as viewed from DE END		
	26.	Standard continuous rating at 40 deg.C. ambient temp. as per Indian Standard (KW)		
	27.	Derated rating for specified normal condition i.e. 50 deg. C ambient temperature (KW)		
	28.	Maximum continuous load demand of driven		
	29.	Rated Voltage (volts)		
	30.	Permissible variation of :		
		a. Voltage (Volts)		
		b. Frequency (Hz)		
		c. Combined voltage and frequency		
	31.	Rated speed at rated voltage and		
	32.	At rated Voltage and frequency:		
		a. Full load current		
		TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 13 OF 17

CLAUSE NO.	Bidder's Name						
	b. No load current						
33.	Power Factor at						
	a. 100% load						
	b. NO load						
	c. Starting.						
34.	Efficiency at rated voltage and frequency,						
	a. 100% load						
	b. 75% load						
	c. 50% load						
35.	Starting current (amps) at						
	a. 100 % voltage						
	b. 85% voltage						
	c. 80% voltage						
36.	Minimum permissible starting Voltage (Volts)						
37.	Starting time with minimum permissible voltage						
	a. Without driven equipment coupled						
	b. With driven equipment coupled						
38.	Safe stall time with 100% and 110% of rated						
	a. From hot condition						
	b. From cold condition						
39.	Torques :						
	a. Starting torque at min. permissible voltage(kg-						
	b. Pull up torque at rated voltage.						
	c. Pull out torque						
	d. Min accelerating torque (kg.m) available						
	e. Rated torque (kg.m)						
40.	Stator winding resistance per phase (ohms at 20						
41.	GD ² value of motors						
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 40%;"></td> <td style="width: 20%; text-align: center;"> TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2 </td> <td style="width: 20%; text-align: center;"> DB07: MOTORS </td> <td style="width: 20%; text-align: center;"> PAGE 14 OF 17 </td> </tr> </table>					TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 14 OF 17
	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 14 OF 17				

CLAUSE NO.	Bidder's Name		
	42.	No of permissible successive starts when motor is in hot condition	
	43.	Locked Rotor KVA Input	
	44.	Locked Rotor KVA/KW	
	45.	Vibration limit :Velocity (mm/s)	
	46.	Noise level limit (dBA)	
	C.	CONSTRUCTIONAL FEATURES	
	1.	Stator winding insulation	
		a. Class & Type	
		b. Winding Insulation Process	
		c. Tropicalised (Yes/No)	
		d. Temperature rise over specified maximum ambient temperature of 50 deg C	
		e. Method of temperature measurement	
		f. Stator winding connection	
	2.	Main Terminal Box	
		a. Type	
		b. Location(viewed from NDE side)	
		c. Entry of cables(bottom/side)	
		d. Recommended cable size(To be matched with cable size envisaged by owner)	
		e. Fault level (MVA),Fault level duration(sec)	
		f. Cable glands & lugs details (shall be suitable for	
	3.	Type of DE/NDE Bearing	
	4.	Motor Paint shade	
	5.	Weight of	
		a. Motor stator (KG)	
		b. Motor Rotor (KG)	
		c. Total weight (KG)	
	D.	List of accessories.	
	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2		DB07: MOTORS
			PAGE 15 OF 17

CLAUSE NO.	Bidder's Name			
	1.	Space Heaters (Applicable for 30 KW & above motor) (Nos./Power in watts/supply voltage)		
	2.	Terminal Box for Space Heater (Yes/No)		
	3.	Speed switch (Yes/No)		
	4.	Insulation of bearing (Yes/No)		
	5.	Noise reducer(Yes/No)		
	6.	Grounding pads		
		i) No and size on motor body		
		ii) Nos on terminal Box		
	7.	Vibration pads		
		i) Nos and size		
		ii) Location		
	8.	Any other fitments		
	E.	List of curves.		
	1.	Torque speed characteristic of the motor		
	2.	Thermal withstand characteristic		
	3.	Starting. current Vs. Time		
	4.	Starting. current Vs speed		
	5.	P.F. and Effi. Vs Load		
	F.	Additional Data to be filled for each rating of DC Motor		
	1.	Rated armature voltage (Volt)		
	2.	Rated field excitation (Amp)		
	3.	Permissible % variation in voltage		
	4.	Minimum Permissible Starting voltage (volt)		
	5.	At rated voltage		
		i)Full load Armature current.(Amp)		
		ii)Full load Field current (Amp)		
			TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS
				PAGE 16 OF 17

CLAUSE NO.	Bidder's Name						
	iii)No load Armature current (Amp)						
6.	Full load Field current (Amp)						
7.	No load Aramature current (Amp)						
8.	Minimum permissible field current(Amp) to avoid						
	i) Maximum permissible voltage						
	ii) Rated voltage						
	iii) Minimum Permissible Voltage						
9.	Resistance (indicative Values) in ohm						
	i)Armature winding(Arm + IP + Series) at 25						
	ii) Field Winding at 25 deg. C						
10..	Inductance (indicative values)						
	i) Armature winding						
	ii) Field winding						
11	Value of trimmer resistance (ohm) to be connected in series with the shunt field to						
	i) 220 V DC						
	ii) 250 V DC						
	iii) 187 V DC						
12	Value of the external resistance (ohm)required to be connected in series with armature during starting only						
13	Technical data sheet for external resistance box						
14	GA drawing of motor						
15	Starting time calculation						
16	Starter resistance design calculation						
17	Electrical connection diagram of motor						
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:40%;"></td> <td style="width:30%; text-align: center;"> TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2 </td> <td style="width:20%; text-align: center;"> DB07: MOTORS </td> <td style="width:10%; text-align: center;"> PAGE 17 OF 17 </td> </tr> </table>					TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 17 OF 17
	TECHNICAL DATA SHEETS SECTION – VI, PART-G BID DOC. NO:CS-9585-001-2	DB07: MOTORS	PAGE 17 OF 17				



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION-D

REV. 00


DATE: OCT 2021

SHEET : 1 OF 1



ANNEXURE-I

LIST OF MAKES OF SUB-VENDOR ITEMS

Sl.no.	Item	Category of Inspection	Sub-vendor	Place	Remarks
1.	PAINT	III	ASIAN PAINT		
		III	BERGER		
		III	KANSAI NEROLAC		
		III	JOTUN		
		III	SHALIMAR		
		III	JENSON & NICHOLSON (I) LTD		
		III	CDC CARBOLINE (I) LTD.		
		III	ADDISON PAINTS LTD		
		III	GRAND POLYCOAT		
NOTES: INSPECTION CATEGORIZATION					
CAT I: INSPECTION BY OWNER, BHEL/BHEL NOMINATED TPIA & VENDOR. MDCC WILL BE ISSUED BASED ON INSPECTION REPORT IN LINE WITH APPROVED QAP.					
CAT II: INSPECTION BY BHEL/BHEL NOMINATED TPIA & VENDOR. MDCC WILL BE ISSUED BASED ON INSPECTION REPORT IN LINE WITH APPROVED QAP.					
CAT III: MDCC WILL BE ISSUED BASED COC & MTC ISSUED BY VENDOR AND VERIFICATION BY BHEL / OWNER IN LINE WITH APPROVED QAP/CHECK LIST					


		PROJECT : PACKAGE : EPC Sub Package: MOTORS & VVF Drive Panels CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR ; CONTRACTOR-M/S BHEL			REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 20th April 2017	
		Sl. No.	ITEM	QP / INS CAT.	QP No:- 9585-001-QVE-	QP SUB. SCH.	QP APPL SCHE DULE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER APPL STATUS AS PER NTPC

1)	L T (415 V) Motors	Refer Note 1				ABB	FARIDABAD	Λ		UPTO 55KW
						ABB	BANGALORE	Λ		55KW – 200KW
						BHARAT BIJLEE	MUMBAI	Λ		RQP, FOR FLAME PROOF ALSO
						CGL	AHMEDNAGAR	Λ		FOR FLAME PROOF ALSO
						JYOTI	BARODA	Λ		
						KEC	BANGALORE	Λ		FOR FLAMEVPROOF ALSO
						KEC	HUBLI	Λ		UPTO 90KW: FOR FLAME PROOF ALSO
						LHP	SOLAPUR	Λ		UPTO 200KW
						MARATHON	KOLKATA	Λ		FOR FLAME PROOF ALSO
						NGEF	BANGALORE	Λ		UPTO 15KW
			SIEMENS	MUMBAI	Λ					
2)	HT MOTOR					BHEL	BIHOPAL	Λ		
3)	DC MOTOR	Refer Note 1				BHEL	HARIDWAR	Λ		
						CGL	AHMEDNAGAR	Λ		
						KEC	BANGLORE / HUBLI	DR		
4)	VARIABLE FREQUENCY DRIVES PANELS	1				L&T-YASHKAWA	INDIA	Λ		
						DANFOSS	CHENNAI	Λ		
						SCHNEIDER	NASHIK	Λ		
						ROCKWELL ALLEN BRADLEY	DELHI- SHAHIBABAD	Λ		Dir for HT
						ABB	BANGALORE	Λ		
						SIEMENS	NASHIK	Λ		
			GE		DR					



169

Signature
NTPC

		PROJECT : PACKAGE : EPC Sub Package: MOTORS & VVF Drive Panels CONTRACTOR : M/S BHEL CONT. NO. CS-9585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR ; CONTRACTOR-M/S BHEL			REF NO : 9585-001-QOE-R-01 REVISION NO. 00 DATE 20 th April 2017	
		Sl. No.	ITEM	QP / INS CAT.	QP No:- 9585-001-QVE-	QP SUB. SCH.	QP APPL SCHE DULE	SUB-SUPPLIERS	PLACE	SUB-SUPPLIER APPL STATUS AS PER NTPC

						HITACHI-HIREL	GANDHINAGAR/SANAND	DR		
						INGE TEAM TECHNOLOGIES	SPAIN	DR		
						NIDEC(ANSALDO)	ITALY	DR		
						FUJI ELECTRIC SYSTEMS	JAPAN	DR		
						TMEIC	BANGALORE	DR		
						L&T	MUMBAI	DR		

NOTE 1 : FOR LT MOTORS

a) Less than 30 KW

Acceptance of Motor less than 30 KW is based on COC of the manufacturer & the contractor confirming as follows:
 It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp., voltage & frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud & gland plate and tested in accordance with approved drawing /data sheets.

b) 30 KW -50KW

Acceptance of Motor rating between 30 KW & 50 KW is based on NTPC review of Routine Test inspection report as per IS 325 witnessed by main contractor along with COC of the manufacturer & the contractor confirming as follows:
 It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp., voltage & frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud & gland plate, space heater and tested in accordance with approved drawing /data sheets.


c) Above 50 KW as per NTPC approved quality plan

Approval Conditions attached to above vendors-as applicable shall prevail.

General Notes:

- 1) Vendor list & category of the mandatory spares shall be as mentioned above.
- 2) For item not appearing in the above list, main contractor to approach NTPC for acceptable vendors & inspection categorization of the same.
- 3) NTPC Approval conditions to above identified vendors shall be adhered to. Vendor's approval conditions will be informed on specific request of Main Contractor.

[Signature]



[Signature]
JATIN GAHLAWAT
 BHEL
 Deptt.
 Utpadan
 Dist-Rampurh (Hareband)

170


NTPC		PROJECT : PACKAGE : EPC (FGD) Package MAIN CONTRACTOR : M/s BHEL CONTRACT NO : CS-5585-001-2				LIST OF ITEMS REQUIRING QP APPROVAL & ACCEPTABLE VENDOR AS APPROVED BY			REF. NO : REVISION NO : 00 DATE : 16-05-17		
No.	Major Equipment	QP Inspection Category	QP No.	QP Sub mission on SCH	QP Appr oval SCH	Proposed Sub Supplier	Place	SS Approv al Status	SS Data II Sub. SCH	SS Approval SCH	Remark
23	Hydro Cyclone	I				FL Smldth	Chennai	DR			
						Weir Minerals	Bangalore	A			
						Multo Tech	S.Africa	A			
						McNally Bharat	Bangalore	DR			
24	Rubber Lining of Pipes	I				Jasmino Polymertech	Taloja	A			
						CORI Engineers	Chennai	A			
						Western Rubber	Mumbai	A			
						Elastomer Lining	Ambarnath	A			
						Emkay Rubber	Mumbai	A			
						Rishi	Bahalgarh	A			
						Poly Rubber	Mumbai	A			
						Temsec Rubber	Kolkata	A			
						Presidency Rubber	Howrah	A			
						Arul Rubber Pvt.Ltd	Hosur	A			
						Industrial Moulders	Vadodara	A			
						MILL Industries	Chennai	DR			
						Lebracs rubber	Pondicherry	DR			
25	FRP PIPE with fittings	III				Main contractor approved source		A		upto 3"	
26	Rubber Lining for Tank and absorber	III				MIL Industries	Chennai	A			
		III				TIP TOP	Germany	A			
		III				Stealuer	Germany	A			
		III				Arul Rubber	Hosur	A			
		III				Temsec Rubber	Kolkata	A			
						Lebracs Rubber	Pondicherry	DR			
						CORI Engineers	Chennai	DR			
27	Ventilation Fans	I				Patel Air	Ahmedabad	A			
						Merathan Electric	Kolkata	A			
						Howden	Kolkata / Chennai	A			
						SK System	Sonepat	A			
						Andrew Yule	Kalyan	A			



69

Handwritten signature

Handwritten signature



BHEL
Handwritten signature





Project :
 Package : EPC
 Contractor : BHEL, Hyderabad
 Contract No.:

**LIST OF ITEMS REQUIRING QUALITY PLAN AND
 SUBCONTRACTOR APPROVAL**

**SUB SYSTEM: BFP, Drive Turbine, Heaters (HP, LP)
 Drain Cooler and Deaerator**

Ref No.: 9585-001-02
 Revision No.: 00
 Date: 05.04.2017

SN	ITEM	QP/ INS- PN CAT *	QP No. xxxx-110	QP SUB- MISSIO N SCHED ULE	QP APPL SCHE DULE	PROPOSED SUB SUPPLIER	PLACE	SS APPL STATU S/ CAT	SS DETAIL SUB- SCHEDU LE	SC APPL SCHEDU LE	REMARKS
						EDELSTAHLWERKE	GERMANY	A			
						GROEDITZ	GERMANY	DR			
						PILSON STEEL (VHS,SKODA)	CZECKSLOVAKIA	A			
						JCFC	JAPAN	A			
						JSC ENERGOMASH	UKRAIN	DR			
						JSW	JAPAN	A			
						KOBE STEEL	JAPAN	A			
						CRUIST FORGE	FRANCE	A			
						PETRO ROSA	GERMANY	A			
						FINE FORGE	HYDERABAD	A			
33	PRECISION BLADE FORGINGS		QVM-Q-308			C BLADE	ITALY	A			
						WUXI	CHINA	A			AS PER NTPC APPROVAL CONDITIONS
						AZAD ENGG	HYDERABAD	A			FOR MACHINING ONLY
34	BAR STOCK FOR BLADES		QVM-Q-308			WALZWERK EINSL	GERMANY	A			
						BOEHLER	AUSTRIA	A			
						BGH	GERMANY	A			
						BREITENFIELD	AUSTRALIA	A			
						STARWIRE	BALLABHGARH	A			
35	DRAWN PROFILE FOR GUIDE BLADES (DRIVE TURBINE)		QVM-Q-308			FIAV	ITALY	A			
						LEISTRITZ	GERMANY	A			
36	GEAR BOX		QVM-Q-308			BOEHLER	AUSTRIA	A			
						TRIVENI ENGG	MYSORE	A			
						FLENDER		A			
						GRAFFENSTADEN	FRANCE	A			



ENGINEERING DIV / QAI-NTPC,NOIDA

BHEL

105

20

Appendix B, Page 105 of 278

Page 260 of 337
 05/04/2017



Project :
 Package : EPC
 Contractor : BHEL, Hyderabad
 Contract No.:

**LIST OF ITEMS REQUIRING QUALITY PLAN AND
 SUBCONTRACTOR APPROVAL**


Ref No.: 9585-001-02

Revision No.: 00

Date: 05.04.2017

**SUB SYSTEM: BFP, Drive Turbine, Heaters (HP, LP)
 Drain Cooler and Deerator**

SN	ITEM	QP/ INS- PN CAT *	QP No. xxxx-110	QP SUB- MISSIO N SCHU LE	QP APPL SCHE DULE	PROPOSED SUB SUPPLIER	PLACE	SS APPL STATU S/CAT	SS DETAIL SUB- SCHU LE	SC APPL SCHU LE	REMARKS
		I				LUFKIN	USA/FRANCE	A#			
		I				RENK TACKE GMBH	GERMANY	A#			
		I				WALCHANDNAGAR	PUNE	A#			
						WINENERGY	CHENNAI	DR			
37	DRIVE TURBINE	I	QVM-Q-308			BHEL	HYDERABAD	A			
38	CONNECTING COUPLING (GEAR TYPE) CONNECTING COUPLING (MEMBRANE)	I	QVM-Q-308			RENK TACKE GMBH	GERMANY	A			
		I				LUFKIN	USA/FRANCE	A			
		I				FLENDER	GERMANY	A			
		I				WALCHANDNAGAR	WALCHANDNAGAR	A			
		I	QVM-Q-308			EUROFLEX LTD.,	HYDERABAD	A			
		I				JOHN CRANE	UK	A			
		I				AMERDRIVES	USA	A			
39	AUX. CONTROL VALVE BODY & COVER	I	QVM-Q-309			RATHI TURBOFLEX	PUNE	A			
		I				CFFP	HARDWAR	A			
		I				KOLHAPUR STEELS	KOLHAPUR	A			
		I				UP STEELS	MUJAFARNAGAR	A			
40	LUBE OIL CENTRIFUGAL PUMP	I				STAR WIRES	BALLABGARH	A			
		II	QVM-Q-310			RRAKASH SPECTRO	VUJAYAWADA	DR			
		II				KSB	PUNE	A			
41	LUBE OIL PUMP (SCREW PUMP)	II				KIRLSOKAR EBARA	KIRLOSARWADI	A			
		II	QVM-Q-311			SULZER	MUMBAI	A			
		II				ALLWEILER	GERMANY	A			
		II				TUSHACO PUMP	DAMAN	A			
42	DISCONNECTING COUPLING	II				LEISTRITZ	GERMANY	A			
		II	QVM-Q-312			IMOPUMP	USA	A			
43	CENTRIFUGE	I	QVM-Q-313			AMER DRIVES	USA	A			
						ALFALAVAL	PUNE/SWEDEN	A			



ENGINEERING DIV / QAI-NTPC,NOIDA

BHEL

741

Handwritten signature and initials

ANNEXURE-A

- The list of all bought out items like gearbox, coupling, bearings etc. with makes and country of origin and contact details of the manufacturers to be mentioned along with offer to be submitted in the format attached in section II Annexure-6 as an information to BHEL.
- Bidder has to submit the sub-vendor questionnaire (attached herewith) along with necessary credentials in case the proposed sub-vendor is not as per the list provided.
- Acceptance of makes shall be subject to BHEL/ End customer acceptance during the detailed engineering without cost and delivery implication to BHEL.
- The complete list will be necessarily submitted within one month of placement of LOI to ensure timely placement of order for BOIs. Bidder to assess the capability of their proposed sub-vendors in terms of preparation of drawings, calculations, documents, quality assurance, supply of material etc. as per project schedule before placing the order on them.



CORPORATE QUALITY ASSURANCE
SUB-VENDOR QUESTIONNAIRE

i.	Item/Scope of Sub-contracting	
ii.	Address of the registered office	Details of Contact Person (Name, Designation, Mobile, Email)
iii.	Name and Address of the proposed Sub-vendor's works where item is being manufactured	Details of Contact Person: (Name, Designation, Mobile, Email)
iv.	Annual Production Capacity for proposed item/scope of sub-contracting	
v.	Annual production for last 3 years for proposed item/scope of sub-contracting	
vi.	Details of proposed works	
1.	Year of establishment of present works	
2.	Year of commencement of manufacturing at above works	
3.	Details of change in Works address in past (if any)	
4.	Total Area	
	Covered Area	
5.	Factory Registration Certificate	Details attached at Annexure – F2.1
6.	Design/ Research & development set-up (No. of manpower, their qualification, machines & tools employed etc.)	Applicable / Not applicable if manufacturing is as per Main Contractor/purchaser design) Details attached at Annexure – F2.2 (if applicable)
7.	Overall organization Chart with Manpower Details (Design/Manufacturing/Quality etc)	Details attached at Annexure – F2.3
8.	After sales service set up in India, in case of foreign sub-vendor (Location, Contact Person, Contact details etc.)	Applicable / Not applicable Details attached at Annexure – F2.4
9.	Manufacturing process execution plan with flow chart indicating various stages of manufacturing from raw material to finished product including outsourced process, if any	Details attached at Annexure – F2.5



**CORPORATE QUALITY ASSURANCE
SUB-VENDOR QUESTIONNAIRE**

10.	Quality Control exercised during receipt of raw material/BOI, in-process , Final Testing, packing			Details attached at Annexure – F2.6		
11.	Manufacturing facilities (List of machines, special process facilities, material handling etc.)			Details attached at Annexure – F2.7		
12.	Testing facilities (List of testing equipment)			Details attached at Annexure – F2.8		
13.	If manufacturing process involves fabrication then-			Applicable / Not applicable		
	List of qualified Welders			Details attached at Annexure – F2.9		
	List of qualified NDT personnel with area of specialization			(if applicable)		
14.	List of out-sourced manufacturing processes with Sub-Vendors' names & addresses			Applicable / Not applicable Details attached at Annexure. –F2.10 (if applicable)		
15.	Supply reference list including recent supplies			Details attached at Annexure – F2.11 (as per format given below)		
<i>Project/ package</i>	<i>Customer Name</i>	<i>Supplied Item (Type/Rating/Model /Capacity/Size etc)</i>	<i>PO ref no/date</i>	<i>Supplied Quantity</i>	<i>Date of Supply</i>	
16.	Product satisfactory performance feedback letter/certificates/End User Feedback			Attached at annexure - F2.12		
17.	Summary of Type Test Report (Type Test Details, Report No, Agency, Date of testing) for the proposed product (similar or higher rating) Note:- Reports need not to be submitted			Applicable / Not applicable Details attached at Annexure – F2.13 (if applicable)		
18.	Statutory / mandatory certification for the proposed product			Applicable / Not applicable Details attached at Annexure – F2.14 (if applicable)		
19.	Copy of ISO 9001 certificate (if available)			Attached at Annexure – F2.15		
20.	Product technical catalogues for proposed item (if available)			Details attached at Annexure – F2.16		
Name: _____						
Desig: _____			Sign: _____		Date: _____	

Company's Seal/Stamp:-



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION-I Sub Section-D

REV. 00

DATE: OCT 2021

SHEET : 1 OF 1

ANNEXURE-II
MANDATORY SPARE LIST

TECHNICAL SPECIFICATION FOR AGITATOR (3 x200 + 3 X 500 + 1 X500) MW KORBA STPP		SPECIFICATION NO. :PE-TS-466-571-18000-A002
		ANNEXURE-II
SI. No.	PARTICULARS	Unit /Quantity (Nos./SET/%)
1	AGITATORS	
1.1	AUXILIARY ABSORBENT TANK AGITATOR	
1	Impeller Assembly	1 no. of each type and size
2	Bearing Assembly	1 no. of each type and size
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type and size
5	Gear Box Assembly (If Applicable)	1 no. of each type and size
6	Agitator shaft assembly	1 no. of each type and size
7	Shaft Seal	1 no. of each type and size
8	Complete Agitator Assembly	1 no. of each type and size
1.2	LIMESTONE SLURRY STORAGE TANK AGITATORS	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.3	PRIMARY HYDRO-CYCLONE FEED TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.4	SECONDARY HYDROCYCLONE FEED TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size

TECHNICAL SPECIFICATION FOR AGITATOR (3 x200 + 3 X 500 + 1 X500) MW KORBA STPP		SPECIFICATION NO. :PE-TS-466-571-18000-A002
		ANNEXURE-II
SI. No.	PARTICULARS	Unit /Quantity (Nos./SET/%)
7	Complete Agitator Assembly	1 no. of each type and size
1.5	FILTRATE WATER TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.6	WASTE WATER TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.7	AGITATOR FOR DRAIN PIT (FOR ABSORBER AREA,GYPSUM AREA AND LIMESTONE AREA)	
1	Impeller Assembly	1 no. of each type and size
2	Bearing Assembly	1 no. of each type and size
3	Motor	1 no. of each type and size
4	Belt and Pulley (If applicable)	1 no. of each type and size
5	Gear Box Assembly (If Applicable)	1 no. of each type and size
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
Note:		
1)One set means 100% complete replacement of the particular component/equipment, as mentioned i.e., Set for the particular equipment, would include all components required to replace the item. For example, a set of bearing shall include all hardware normally required while replacing the bearings. It is further, intended that the assembly / sub-assembly which have different orientation (like left hand or right hand, top or bottom), different direction of rotation or mirror image positioning or any other reasons which result in maintaining two different sets of the spares to be used for the subject assembly / sub-assembly, these shall be considered as different types of assembly/sub-assembly.		
2) Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc. these shall cover all the items supplied and installed.		

TECHNICAL SPECIFICATION FOR AGITATOR (3 x200 + 3 X 500 + 1 X500) MW KORBA STPP		SPECIFICATION NO. :PE-TS-466-571-18000-A002
		ANNEXURE-II
SI. No.	PARTICULARS	Unit /Quantity (Nos./SET/%)
	3) In case spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered design with quantities generally in line with the approach followed in the above list.	
	4) Any item which is quoted as "not applicable" in the above list and is found to be "applicable" at a later date shall be supplied by the bidder without any commercial implications. The Bidder shall note that if there in any change/ variation in equipment/ system during detail engineering which causes any change/ variation in the essential spares quantity, the same shall be supplied without any commercial implications. The price indicated for the mandatory spares shall be considered for the purpose of evaluation.	
	5) Mandatory spares shall not be dispatched before dispatch of corresponding main equipment. Pls. refer NIT for delivery schedule. The spares shall be treated and packed for a long storage under the climatic condition prevailing at site.	
	6) All spares supplied under this contract shall be strictly interchangeable with parts for which they are intended for replacements. These spares should include all mounted accessories like components, boards, add or items, fitting, connectors etc. and be complete in all respects so that the replacement of the main items by these spares does not require any additional item. The vendors must conform the pair to pair compatibility of each electrical spares modules with the modules supplied in the original package. All electronic modules should be pre-set and/or pre-programmed for ready use at site. Alternatively, suitable instruction sheet indicating the details of required PCB jumper position, BCD which is setting, EPROM/PROM listing etc should be packed along with each module. Also a caution mark sign should be put on all such module which needs pre-setting/pre-programming before putting them in to service. The spare shall be treated and properly packed for long term storage.	
	7) Each spare shall be clearly marked and labelled on the outside of the packing with its description. When more than one spare part is packed in single case, a general description of the contents shall be shown on the outside of such case and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purpose of identification.	
	8) Set for the particular equipment, would include all components required to replace the item, for example a set of bearing shall include all hardware normally required while replacing the bearings. It is further intended that the assembly / sub-assembly which have different orientation (like left hand or right hand, top or bottom), different direction of rotation or mirror image positioning or any other reasons which result in maintaining two different sets of the spares to be used for the subject assembly / sub-assembly, these shall be considered as different types of assembly/sub-assembly.	
	9)All the spares shall be manufactured along with the main equipment components as a continuous operation as per same specification and quality plan.	
	10)The Contractor shall warrant that all spares supplied will be new and in accordance with the Contract Documents and will be free from defects in design, material and workmanship.	
	11) Any cell left blank in the unpriced schedule shall be teated as "Quoted"	
	12) Bidder to provide mandatory spares as asked above for each type of tank separately ,even in case type & size of tank of agitator is similar.	



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002


SECTION-I Sub Section-D

REV. 00


DATE: OCT 2021

SHEET : 1 OF 1

ANNEXURE-III
INPUT DRAWINGS OF TANKS

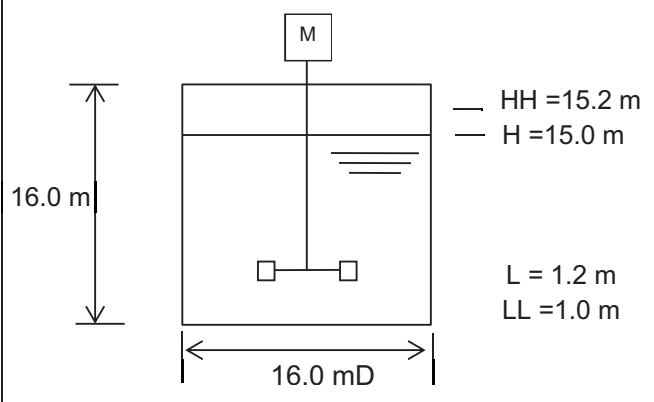S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
5	00HTK0 3BB001/ 002	Lime stone slurry storage Tank	16000 mmD X 16000mmH Quantity = 2 no. (1W+1S) (Common for all units)	Process Capacity for each tank	a) Limestone required = 12.537 + (4*9.263) TPH from (Stream No: <501> x 5 Units) b) 20% (w/w) Limestone slurry = 49.589 TPH / 20% mass flow rate = 247.945 TPH c) 20%(w/w) Limestone slurry density = 1.130 t/m3 d) 20% (w/w) Limestone slurry = 247.945 TPH / 1.130 volume flow rate = 218.8394 m3/hr	
				Retention Time	12.0 hr	
				Required volume	218.8394 m3/h x 12 hr = 2626.07 m3	
					Tank Level is designated as follows	
					Top	16.0
					HH	15.2
					H	15.0
					L	1.2*
					LL	1.0*
<p>Circular Tank</p> <p>Effective volume $= 16.0 \text{ m } \Phi^2 / 4 \times \pi \times (15.0 - 1.2) \text{ m}$ $= 2774.6 \text{ m}^3 > 2626.07 \text{ m}^3$</p> <p>Hold Volume $= 16.0 \text{ m } \Phi^2 / 4 \times \pi \times 15.2 \text{ m}$ $= 3056 \text{ m}^3$</p>						

*L and LL level is finalized by vendor's information of Limestone slurry Feed pump and agitator.

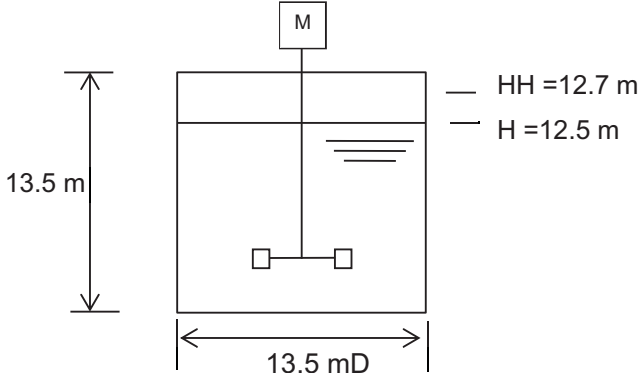S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
6	00HTK0 0BB001	Auxiliary Absorbent Tank	13500mmD x 13500mmH Quantity = 1 no (Common for three units)	Process Capacity	Absorber Tank Volume = 1759.26 m ³ (with 20% margin) (3X200MW Absorber tank Size – 26.9mX10.9mX5.0m= 1466.05 m ³ 20 % margin =1466.05 X 1.2=1759.26 m ³)	
				Retention Time	Batch Operation	
				Required volume	1759.26 m ³	
 <p style="text-align: right;">— HH =12.7 m — H =12.5 m</p>					Tank Level is designated to be empty during normal operation. Therefore the volume from bottom to HH is considered as hold volume of tank.	
					Top	13.5
					HH	12.7
					H	12.5
					L	1.2*
					LL	1.0*
<p>Circular Tank</p> <p>Effective volume</p> $= 13.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times 12.5 \text{ m}$ $= 1789.23 \text{ m}^3 > 1759.26 \text{ m}^3$ <p>Hold Volume</p> $= 13.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times 12.7 \text{ m}$ $= 1817.9 \text{ m}^3$						

*L and LL level is finalized by vendor's information of Auxiliary Absorbent tank pump and agitator.

S.No	Item No	Service	Design Spec	Process Parameter	Design Basis
2	00HTM00 BB001	Primary Hydro cyclone feed Tank	8000 mm D x 8900 mm H Quantity = 1 no.	Process Capacity	289.407 m ³ /h (Stream No: <201> x 5 absorber units)
				Retention Time	1 Hour
				Required volume	289.407 m ³ /h x 1 hr = 289.407 m ³
					Tank Level is designated as follows
	Top	8.9			
	HH	8.4			
	H	8.2			
	L	1.2*			
	LL	1.0*			
<p>Circular Tank</p> <p>Effective volume $= 8.0 \text{ m } \Phi ^ 2 / 4 \times \pi \times (8.2-1.2)$ $m = 351.8 \text{ m}^3 > 289.407 \text{ m}^3$</p> <p>Hold Volume $= 8.0 \text{ m } \Phi ^ 2 / 4 \times \pi \times 8.4 \text{ m}$ $= 422 \text{ m}^3$</p>					

*L and LL level is finalized by vendor's information of Waste water hydro cyclone feed pump and agitator.

S.No	Item No	Service	Design Spec	Process Parameter	Design Basis										
3	00HTM04 BB001	Secondary Hydro cyclone feed Tank	6500 mm D X 7300mm H Quantity = 1 no.	Process Capacity	167.2 m3/h (31.17 X4 + 42.52) (Design point- 4X500MW- Stream No: <202> x 4 Units + Design point 3X200MW - Stream No: <202>)										
				Retention Time	1 Hours										
				Required volume	167.2 m3/h x 1 hr = 167.2 m3										
<p>Diagram showing a circular tank with dimensions and levels:</p> <ul style="list-style-type: none"> HH = 6.8 m H = 6.6 m L = 1.2 m LL = 1.0 m Total height = 7.3 m Diameter = 6.5 mD 					<p>Tank Level is designated as follows</p> <table border="1"> <tr> <td>Top</td> <td>7.3</td> </tr> <tr> <td>HH</td> <td>6.8</td> </tr> <tr> <td>H</td> <td>6.6</td> </tr> <tr> <td>L</td> <td>1.2*</td> </tr> <tr> <td>LL</td> <td>1.0*</td> </tr> </table>	Top	7.3	HH	6.8	H	6.6	L	1.2*	LL	1.0*
Top	7.3														
HH	6.8														
H	6.6														
L	1.2*														
LL	1.0*														
<p>Circular Tank</p> <p>Effective volume $= 6.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times (6.6-1.2)$ $\text{m} = 179.2 \text{ m}^3 > 167.2 \text{ m}^3$</p> <p>Hold Volume $= 6.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times 6.8 \text{ m}$ $= 225.6 \text{ m}^3$</p>															

*L and LL level is finalized by vendor's information of Waste water hydro cyclone feed pump and agitator.

Tank Sizing Basis

Tank size is decided as per the following

LL – Pump LL level m

L – LL + 0.2 m

H - Effective height m


HH - H + 0.2 m

Top - HH + 0.5 m

Effective volume = $3.14 / 4 \times \Phi^2 \times (H-L)$

Hold volume = $3.14 / 4 \times \Phi^2 \times (HH)$

H/D ratio = 1 - 1.2

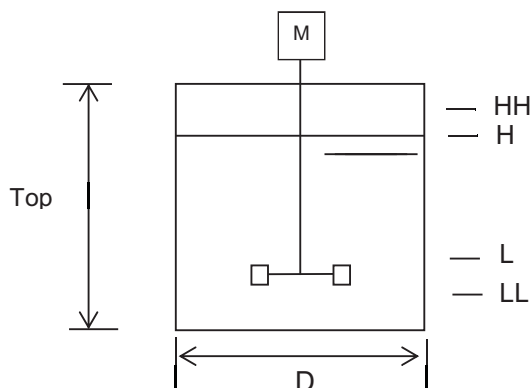


S. No	Item No	Service	Design Spec	Process Parameter	Design Basis										
1	00HTM 03 BB001	Filtrate water Tank	6500 mm D X 7000mm H Quantity = 1 no (Common for all units)	Process Capacity	259.943 m ³ /h (Stream No: <402> x 5 absorber units)										
				Retention Time	0.5 Hr										
				Required volume	259.943 m ³ /h x 0.5 hr =129.9715 m ³										
					Tank Level is designated as follows										
					<table border="1"> <tr> <td>Top</td> <td>7.0</td> </tr> <tr> <td>HH</td> <td>6.5</td> </tr> <tr> <td>H</td> <td>6.3</td> </tr> <tr> <td>L</td> <td>1.2*</td> </tr> <tr> <td>LL</td> <td>1.0*</td> </tr> </table>	Top	7.0	HH	6.5	H	6.3	L	1.2*	LL	1.0*
Top	7.0														
HH	6.5														
H	6.3														
L	1.2*														
LL	1.0*														
<p>The diagram shows a cross-section of a tank with a diameter of 6.5 m and a total height of 7.0 m. A pump 'M' is at the top. The liquid level is at height H = 6.3 m. Other levels are HH = 6.5 m, L = 1.2 m, and LL = 1.0 m. The effective height is H - L = 5.1 m.</p>					<p>Circular Tank</p> <p>Effective volume = $6.5 \text{ m} \times \Phi^2 / 4 \times \pi \times (6.3 - 1.2) \text{ m}$ = 169.2 m³ > 129.9715 m³</p> <p>Hold Volume = $6.5 \text{ m} \times \Phi^2 / 4 \times \pi \times 6.5 \text{ m}$ = 215.69 m³</p>										

*L and LL level is finalized by vendor's information of filtrate water pump and agitator.

S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
4	00HTM 05BB0 01	Waste water storage Tank	8500 mmD X 9700 mmH Quantity = 1 no.	Process Capacity	50.982 m ³ /h (Stream No: <205> x 5 Absorber units)	
				Retention Time	8.0 Hours	
				Required volume	50.982 m ³ /h x 8.0 hr = 407.856 m ³	
<p>Diagram of a circular tank with the following dimensions and levels:</p> <ul style="list-style-type: none"> HH = 9.2 m H = 9.0 m L = 1.2 m LL = 1.0 m Total height = 9.7 m Diameter = 8.5 mD 					Tank Level is designated as follows	
					Top	9.7
					HH	9.2
					H	9.0
					L	1.2*
					LL	1.0*
					<p><u>Circular Tank</u></p> <p>Effective volume $= 8.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times (9.0-1.2) \text{ m}$ $= 442.6 \text{ m}^3 > 407.856\text{m}^3$</p> <p>Hold Volume $= 8.5 \text{ m } \Phi ^ 2 / 4 \times \pi \times 9.2 \text{ m}$ $= 522 \text{ m}^3$</p>	


*L and LL level is finalized by vendor's information of Waste water pump and agitator.

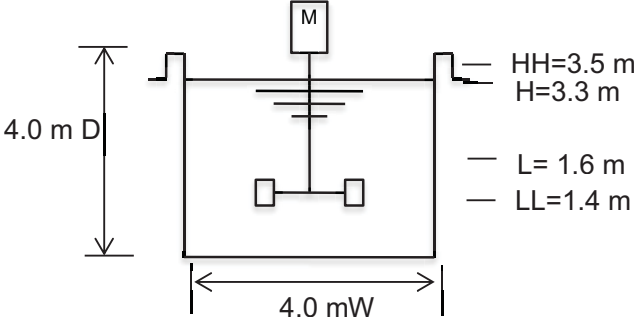S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
9	00HTT02 BB001	Lime Stone Area Drain Sump	4000mmW X 4000mmL X 4000mmH Quantity = 1 no.(Common for all units)	Process Capacity	25 m3	
				Retention Time	Batch Operation	
				Required volume	25 m3	
 <p>4.0 m D</p> <p>4.0 m W</p> <p>HH=3.5 m H=3.3 m L= 1.6 m LL=1.4 m</p>					Tank Level is designated as follows	
					Top	4.0
					HH	3.5
					H	3.3
					L	1.6*
					LL	1.4*
<p>Rectangular Tank</p> <p>Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m3 >25 m3</p> <p>Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m3</p>						

*L and LL level is finalized by vendor's information of Sump pump and agitator.

S. No	Item No	Service	Design Spec	Process Parameter	Design Basis										
7	10/30HTT 00BB001	Absorber Area Drain Sump	4000mmW X 4000mmL X 4000mmH Quantity = 5 nos. for five absorber Units	Process Capacity for each Sump	25 m ³										
				Retention Time	Batch Operation										
				Required volume	25 m ³										
					Tank Level is designated as follows										
					<table border="1"> <tr> <td>Top</td> <td>4.0</td> </tr> <tr> <td>HH</td> <td>3.5</td> </tr> <tr> <td>H</td> <td>3.3</td> </tr> <tr> <td>L</td> <td>1.6*</td> </tr> <tr> <td>LL</td> <td>1.4*</td> </tr> </table>	Top	4.0	HH	3.5	H	3.3	L	1.6*	LL	1.4*
Top	4.0														
HH	3.5														
H	3.3														
L	1.6*														
LL	1.4*														
<p>Diagram of a rectangular tank with dimensions and levels:</p> <ul style="list-style-type: none"> Width: 4.0 mW Depth: 4.0 m D Motor (M) on top Levels: HH=3.5 m, H=3.3 m, L=1.6 m, LL=1.4 m 					<p>Rectangular Tank</p> <p>Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m³ > 25 m³</p> <p>Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m³</p>										

*L and LL level is finalized by vendor's information of Sump pump and agitator.

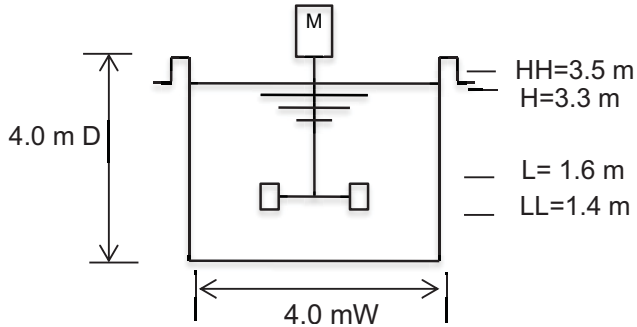S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
8	00HTT01 BB001	Gypsum Area Drain Sump	4000mmW X 4000mmL X 4000mmH Quantity = 1 no. (Common for all units)	Process Capacity	25 m3	
				Retention Time	Batch Operation	
				Required volume	25 m3	
					Tank Level is designated as follows	
					Top	4.0
					HH	3.5
					H	3.3
					L	1.6*
					LL	1.4*
					<p>Rectangular Tank</p> <p>Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m3 >25 m3</p> <p>Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m3</p>	

*L and LL level is finalized by vendor's information of Sump pump and agitator.



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D

REV. 00

DATE: OCT 2021

SHEET : 1 OF 1

ANNEXURE-IV

MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION



TITLE:

KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPEC. NO.: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D, ANNEXURE-IV

REV. NO.: 0

DATE OCT 2021

DRAWINGS/ DOCUMENTS REQUIRED DURING DETAIL ENGINEERING

The successful bidder shall submit the following drawings / documents during detail engineering for approval / information / reference (as the case may be): -

Sl. No.	BHEL Drawing / Document No.	Title	Schedule Date	Drawing Classification
1	PE-V0-466-571-A001	GA drawing, Exploded view, sectional view with Material of construction, mechanical seal , gearbox for all Agitator models	2 weeks from LOI	Primary
2	PE-V0-466-571-A002	Data sheet for all Agitator	2 weeks from LOI	Primary
3	PE-V0-466-571-A003	Agitator Performance curve of all Agitators	2 weeks from LOI	Primary
4	PE-V0-466-571-A004	Electrical motor GA drawing & Data sheet and performance curves of all motors	2 weeks from LOI	Primary
5	PE-V0-466-571-A005	Quality plan & Inspection and Test Procedure	2 weeks from LOI	Primary
6	PE-V0-466-571-A006	Agitator and Motor Sizing Calculation	2 weeks from LOI	Primary
7	PE-V0-466-571-A007	O&M Manual for Agitator	4 weeks from LOI	Secondary
8	PE-V0-466-571-A008	Utility Consumption	4 weeks from LOI	Secondary
9	PE-V0-466-571-A009	Foundation Data including Anchor plan	4 weeks from LOI	Secondary
10	PE-V0-466-571-A010	Lubricating oil list	4 weeks from LOI	Secondary
11	PE-V0-466-571-A011	Special tools list, Start-up & Commissioning Spares	4 weeks from LOI	Secondary
12	PE-V0-466-571-A012	Installation and assembly procedure including Pre Commissioning Check List	4 weeks from LOI	Secondary



TITLE:

KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPEC. NO.: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D, ANNEXURE-IV

REV. NO.: 0

DATE OCT 2021

NOTES:

1. Bidder to note that BHEL reserves the right for drawing/document submission through web based document management system. Bidder would be provided access to the DMS for drawing/document approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.
 - a) internet explorer version – minimum internet explorer 7.
 - b) Internet speed – 2 mbps (minimum preferred).
 - c) Pop ups from our external DMS IP (124.124.36.198) should not be blocked.
 - d) Vendor's internal proxy setting should not block DMS application's link (<http://dmserver.bhelpem.com/wrench%20web%20access/login.aspx>).
2. The above drawing list is tentative and shall be finalized with the successful bidder after placement of order. While some of the drawings indicated above may not be applicable, some additional drawings may also be required based on scope of work.
3. Drawings shall be prepared in Auto-Cad latest edition. Required no. of hard and soft copies (editable) of the drawings shall be furnished as per requirement specified elsewhere in the specification.
4. Only manual calculation with authentic supporting literature (e.g. extracts of hand Book/ standard/codes) shall be acceptable. All design calculations and drawings shall be in SI system only.
5. All the drawings and documents including general arrangement drawing, data sheet, calculation etc. to be furnished to the customer during detailed engineering stage shall include / indicate the following details for clarity w.r.t. Inspection, construction, erection and maintenance etc.:
 - a) All drawings and documents shall indicate the list of all reference drawings including General Arrangement.
 - b) All drawings shall include / show plan, elevation, side view, cross-section, skin section, blow-up view; all major self-manufactured and bought out items shall be labelled and included in BOQ / BOM in tabular form.
 - c) Painting schedule shall also be made as a part of general arrangement drawing of each equipment / items indicating at least 3 trade names.
 - d) All the drawings required to be furnished to customer during detailed engineering stage shall include technical parameters, details of paints and lubrication, hardness and BOQ / BOM in tabular form indicating all major components including bought out items and their quantity, material of construction indicating its applicable code / standard, weight, make etc.



TITLE:

KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPEC. NO.: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D, ANNEXURE-IV

REV. NO.: 0

DATE OCT 2021

- e) Void.
- f) Drawings and documents not covered above but required to check safety of machines/ system, shall be submitted during detailed engineering stage without any commercial implication.
- g) All drawings shall include "B.O.M" and indicate quantity, material of construction, make along with IS/BS No., Technical parameters, dimensions, hardness, machining symbol and tolerance, requirement of radiography and hydraulic tests, painting details, elevation, side view, plan, skin section and blow-up view for clarity.
- h) All drawings shall be prepared as per BHEL's title block and shall bear BHEL's drawing No. Documents marked for submission to BHEL's Customer shall also bear BHEL's Customer's drawing No.
- i) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's/ Customer's/ Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- j) Bidder to follow the following the drawing submission schedule.
- k) 1st submission of drawings from date of LOI as per the submission schedule.
- l) Every revised submission incorporating comments – within 7 days.
- m) Bidder to submit revised drawings complete in all respects incorporating all comments.
- n) The primary drawings are to be considered as the basic engineering drawings.

Any incomplete drawing submitted shall be treated as non-submission with delays attributable to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall depute his personal to BHEL for across the table discussions/ finalizations/ submissions of drawings.

COMPANY SEAL

SIGNATURE: _____

NAME : _____



TITLE:

KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPEC. NO.: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D, ANNEXURE-IV

REV. NO.: 0

DATE OCT 2021

DESIGNATION: _____

COMPANY: _____



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION-I, SUB-SECTION- D

REV. 00

DATE: OCT 2021

SHEET : 1 OF 1

ANNEXURE-V

SEA-WORTHY PACKING PROCEDURE

SEAWORTHY PACKING

(PACKING INSTRUCTIONS FOR GENERAL COMPONENTS / ASSEMBLIES / EQUIPMENT)

1 GENERAL

This standard lays down packing instructions for seaworthy packing of Components /Assemblies/ Equipment to be dispatched against Customer's contracts, for which there are no special instructions issued by the Engineering Departments.

The Components/Assemblies need to be packed suitably to avoid physical damage & corrosion during transit for storage. For specific applications the concerned engineering department shall issue a product standard. Reference of this standard, must appear in the Shipping list/Packing List.

2 SCOPE

This procedure gives minimum guidelines for seaworthy packing to be complied with for packing of Components /Assemblies / Equipment. This packing shall be suitable for different handling operations and for the adverse conditions during transportation and during indoor / outdoor storage for periods more than one year.

3 CROSS REFERRED SPECIFICATION

- | | |
|---|----------------|
| – Multi-layered cross laminated plastic film | : AA51420 |
| – Packing Wood | : AA51401 |
| – Silica gel | : AA55619 |
| – Thermocole | : AA51416 |
| – Packing slip holders | : AA7240901 |
| – Corrugated Fibre Board | : AA51414 |
| – Rubber sheet | : AA59001 |
| – VCI paper | : AA51406 |
| – High quality full glossy out door finishing paint | : AA56126 |
| – Polyethylene air bubble film | : IS 12787 |
| – Structural steel - standard quality (plates, sections, strips flats & bars) | : AA10108 |
| – International Standards For Phytosanitary Measures No. 15 | : ISPM-15:2009 |

4 WOOD SPECIFICATION FOR PACKING

The wood shall conform to specification AA51401.

For export packing wood in addition to the above the following has to be met:

The standard requires the use of debarked wood in the construction of compliant wood packaging material. Debarked wood is defined in the ISPM 5.

5 TYPE OF PACKING

The following 5 types of packings have been standardized for packing of General Components /Assemblies.

- ‘OP’ - Open Type
- ‘PP’ - Partially Packed
- ‘CP’ - Crate Packing - Components/Equipment requiring physical protection
- ‘CQ’ - Case Packing - Small medium Components/ Assemblies/ Equipment which require corrosion & physical protection
- ‘CR’ - Case Packing - Electrical Components/Assemblies which require special packing viz. Water Proof, Shock Proof, etc.

6 DESCRIPTION OF TYPES OF PACKING

The various types of packing, as standardized above, are described below.

6.1 ‘OP’ - Open Type

In case, of components which are not affected by water & dust & do not require special protection &, are generally not machined, shall be sent as open packages. However these components may be sent in crates, wherever necessary.

6.2 ‘PP’ - Partially Packed

Components which need special protection, at selected portions only, shall be dispatched partially packed. Machined surfaces should not be allowed to come directly in contact with the wood. Such surfaces after application of TRP should be protected with Multi-layered cross laminated plastic film to AA51420.

6.3 ‘CP’ - Crate Packing – General

Assemblies/Components which need only physical protection from the point of view of handling shall be dispatched duly packed in crates.

6.4 ‘CQ’ - Case Packing - Machined Components/Assemblies/Equipment

- a) Small & Medium sized components/assemblies/equipment due to size/weight & to avoid handling, and pilferage, problems shall be packed in Case/Containers.
- b) Wherever required adequate quantity of silica gel to AA55619 or VCI Powder/ Tablets, packed in thin muslin cloth cotton bags shall be suitably placed.
- c) Small machines/components of less weight shall be provided with suitable cushioning. Wood Wool/Expanded Polyethylene Foam Sheet, if used, shall be sandwiched between polyethylene sheets and sealed.
- d) The components inside the case shall be entirely covered with Multi-layered cross laminated plastic film to AA51420, where-ever required.

6.5 ‘CR’ - Case Packing - Electrical & Electronic Components/Assemblies

Delicate components likely to be damaged e.g. Gauges, Instruments etc. are to be wrapped in waxed paper or polyethylene air bubble film and packed in cartons.

- a) Adequate quantity of Silica gel to AA55619 packed in cotton bags, of 100 grams each are to be suitably placed in the cartons. The cartons shall be entirely covered with Multi-layered cross laminated plastic film to AA51420, before being packed in the cases.
- b) VCI Powder/Tablets can be used as an alternative to Silica Gel to AA55619.
- c) Empty space in the cartons shall be filled with small chips of Expanded Polystyrene (Thermocole), Wood Wool etc. Polyethylene air bubble film shall conform to IS 12787/AA51420 Expanded polystyrene (Thermocole) shall conform to AA51416.
- d) The cartons shall be manufactured from corrugated Fibre Board, meeting requirements of AA51414.

6.6 Special Packing

Components requiring special packing (as per customer/contractual/ engineering requirements) not included in this specification shall be covered by product standards.

7 PREPARATION OF PACKING CASE

- 1) Cases and crates with gross weight up to 1,000 kgs. shall be provided with bottom cleats of min. 40 mm thicknesses to ensure clearance for handling by forklift. Cases and crates exceeding gross weight of 1,000 kgs. shall be provided with skid runners, number and size according to weight of package.
- 2) The base of the case shall be made of wooden batons for planks giving necessary reinforcement, such that the bottom of the equipment is at a height of 100 to 200 mm from the ground level depending upon size & weight of equipment. However for packing cases of smaller size equipment can be at a height of 40 mm from the ground level.
- 3) In case of 'CR1 - Packing Viz. Electrical & Electronic components for instruments/assemblies, a rubber sheet, Self-expanded polyethene foam sheet, preferably 10 mm thick, shall be fixed on to the base to act as cushioning to the equipment.
- 4) The four sides, shall be lined, from inside with multi-layered cross-laminated polyethylene sheet of 90GSM as per AA51420 and tacked at suitable places.

Whenever specified the top cover will have a layer of multi-layered cross laminated polyethylene sheet of 90 GSM over the cover. This should project about 100 - 250mm on all sides.

It is preferable to have a single piece of the above Multi-layered cross laminated polyethylene sheet fixed on the four sides. In case jointing is unavoidable, it should be done by overlapping of approximately 100mm.

- 5) Place the Components/cartons with corrosion inhibitors duly applied wherever necessary for place suitably, thin muslin cloths bags containing 100 grams (approx.) of activated Blue Silica Gel to AA55619, wherever necessary. Alternatively VCI Powder or Tablet may be used.
- 6) In case, depression is formed, at the top, after the equipment is lowered, provide ply board/wooden batons.
- 7) Cover the whole equipment with polyethylene sheet of at least 100 micron thickness, on all sides preferably by a single piece.
- 8) For indoor panels/equipment, provide suitable packing batons with covering of Thermocole/expanded soft polyethylene foam/polyethylene air bubble film wrapped with suitable cords, to avoid cutting of the polyethylene sheet so that finished surface is not damaged.
- 9) Empty space in the box shall be filled with adequate cushioning material e.g. Thermocole Chips, Wood Wool etc. to avoid movement for shocks. Alternatively put wooden blocks/batons wherever necessary.
- 10) The inner side of the top cover shall be lined with polyethylene sheet, of at least
- 11) 100 micron thickness, which shall project approximately 25 to 150 mm depending upon the size of the case on all sides of the top cover shall be provided below the top cover. This projection, after nailing the top cover, shall be folded over, on the sides of the crates & tacked, to, prevent ingress of water from the top.
- 12) For specific requirement of packing the cases are to be provided with Tongue and Groove joints.

8 STEEL CONTAINERS

Steel containers for packing can be used in case of repeated supplies of the same equipment. Empty steel containers are to be returned back from customer's end and to be reused for the next supplies.

The containers are to be made of structural steel as per AA10108 with proper reinforcement with I, C and T Sections.

Following precautions are to be taken during packing:

- Put the Components/Assemblies/Equipment in the steel container properly. Cover the Components/Assemblies/Equipment with polythene.
- To arrest the movement in the steel container necessary wooden Blocks/Batons may be put.
- Put cover on steel, container and Bolt Properly.

9 SEALED PACKING

Components sub-assemblies and assemblies sensitive to climatic conditions shall be packed seal tight. All the openings of the sensitive components, sub-assemblies and assemblies shall be blanketed to prevent the ingress of dust and moisture.

The components sub-assemblies and assemblies are completely covered with 2 layers of polyethylene sheet. All sharp corners and edges are to be protected by rubber mats to prevent the polyethylene sheet from damage. Top surface of the case shall be free from dents to prevent rain water pockets.

10 SLING PLATE

Sling plate shall be provided to prevent damage to the packing box during lifting. Size of the sling plate shall be selected depending upon the net weight of the consignment.

11 PACKING SLIP HOLDERS

Two nos. steel packing slip holders, specification no. AA7240901 containing the packing list, sealed in thick polyethylene film, shall be fixed one inside and the other outside the packing box.

12 Volatile Corrosion Inhibitor (VCI) Paper

- a) Un-protected surfaces of steel and cast iron components, tools bearing, shaft seals etc. are covered with VCI paper. VCI paper has been impregnated with corrosion inhibitors which by evaporation and chemical conversion protect metals in an enclosed area against corrosion.
- b) 7 m³ VCI paper is necessary for 1 m³ of packed item approximately as per AA51406.

Application Limitation:

VCI paper shall not be used for components made of aluminium, aluminium alloys as well as Zinc, copper, brass, cadmium and silver.

VCI powder is sprinkled inside the piping components ends shall be protected with end cover as specified in plant standards, drawings.

13 Moisture Absorber

Silica gel is used for this purpose to protect the contents over sufficiently long time from corrosion. At the time of use, silica gel should be so dried that its colour becomes dark blue. These shall be filled in small cotton bags. Before sealing the equipment, the silica gel bags should be kept inside the polyethylene film cover at different locations. The quantity of silica gel should not be less than 1.0 kg per cubic metre volume of the packing box

14 GENERAL PRECAUTIONS


- a) While fixing nails during packing, necessary care shall be taken to ensure that materials used for protection inside the case e.g. paper, polyethylene sheet, coir etc. do not get damaged.
- b) Sling protection brackets to be provided on cases wherever required.
- c) It shall be ensured that all stencil marks external, front & rear sides of the casing shall be of water proof Material to prevent obliteration in transit.
- d) The various caution signs shall be marked with stencil on both sides of the packing box.
- e) Do not pack any other Mechanical items with this case (do not use any other non-permitted packing materials).

THE FOLLOWING DETAILS ARE TO BE MARKED ON THE PACKING CASES.

- a) Address of consignee.
- b) Purchase Order No./ SO No/WO No.
- c) Description of item or title of packing list.
- d) Case identification Number/ Packing List No.
- e) Net Weight.
- f) Gross Weight.
- g) Dimensions of box
- h) Marking showing upright position.
- i) Marking showing sling position.
- j) Marking showing umbrella (i.e. for machines/components to be stored under covered storage.
- k) Loading and unloading precautions

MARKINGS ON PACKING CASE S

1. THIS PLANT STANDARD PRESCRIBES THE VARIOUS CAUTION SIGNS AND OTHER MARKINGS ON PACKING CASES.
2. DIMENSIONS IN THE TABLE 1 SHALL BE USED FOR MAKING STENCILS ONLY.

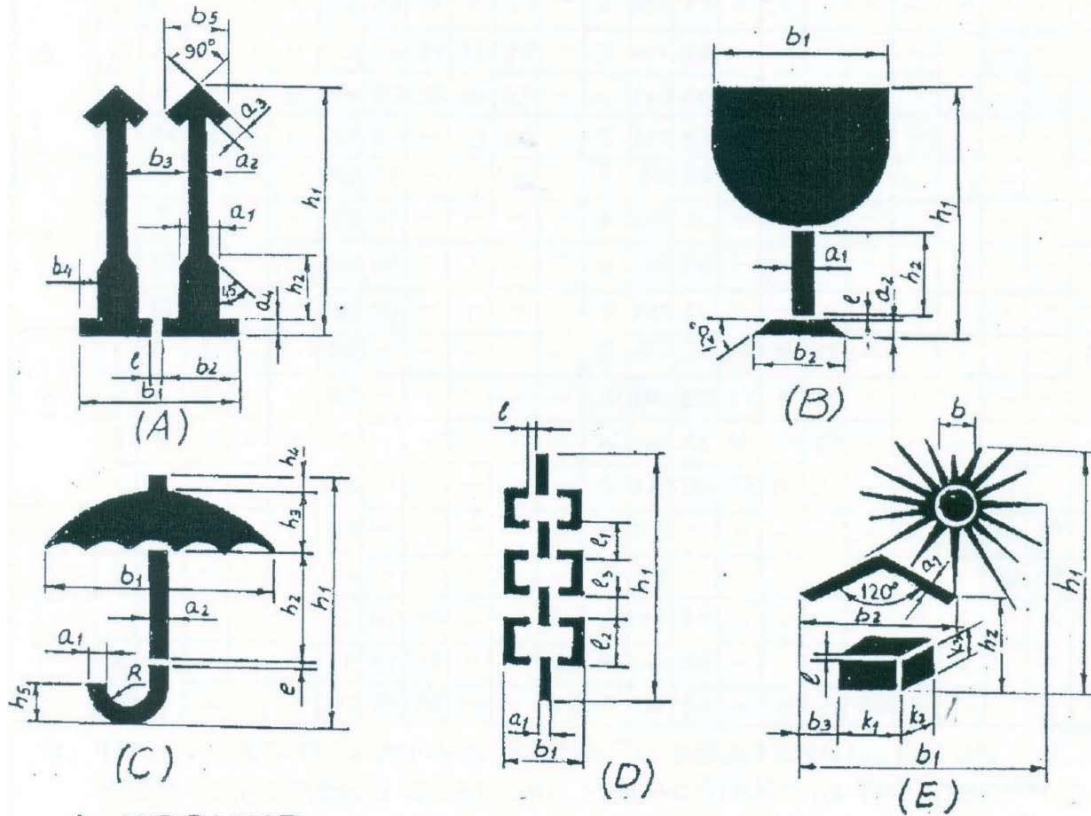

- A. UPRIGHT
 B. FRAGILE
 C. PROTECTION FROM FALLING OR CONDENSING MOISTURE.
 D. SLINGING POSITION
 E. PROTECTION FROM DIRECT RADIATIONS.

Figure 1



Figure 2

Table 1

DESIGNATION	DIMENSIONS IN mm.																								
	a ₁	a ₂	a ₃	a ₄	b ₁	b ₂	b ₃	b ₄	b ₅	b	ℓ	h ₁	h ₂	h ₃	h ₄	h ₅	K ₁	K ₂	K ₃	ℓ ₁	ℓ ₂	ℓ ₃	R		
A	1	12	5	5	4	52	25	19	8	21	-	2	84	23	-	-	-	-	-	-	-	-	-	-	
	2	17	7	7	6	75	36	29	11	30	-	3	119	33	-	-	-	-	-	-	-	-	-	-	
	3	24	10	10	8	104	50	38	16	42	-	4	168	46	-	-	-	-	-	-	-	-	-	-	
	4	34	14	14	11	147	71	59	23	60	-	5	239	65	-	-	-	-	-	-	-	-	-	-	
B	1	5	5	-	-	50	33	-	-	-	-	2	84	25	-	-	-	-	-	-	-	-	-	-	
	2	7	7	-	-	71	47	-	-	-	-	3	119	36	-	-	-	-	-	-	-	-	-	-	
	3	10	10	-	-	100	66	-	-	-	-	4	168	50	-	-	-	-	-	-	-	-	-	-	
	4	14	14	-	-	142	94	-	-	-	-	5	239	71	-	-	-	-	-	-	-	-	-	-	
C	1	4	3	-	-	66	-	-	-	-	-	2	80	39	19	5	11	-	-	-	-	-	-	6	
	2	6	4	-	-	85	-	-	-	-	-	3	114	55	27	7	16	-	-	-	-	-	-	9	
	3	8	6	-	-	120	-	-	-	-	-	4	160	78	38	10	22	-	-	-	-	-	-	12	
	4	11	9	-	-	170	-	-	-	-	-	5	227	110	54	14	31	-	-	-	-	-	-	17	
D	1	6	-	-	-	30	-	-	-	-	-	4	148	-	-	-	-	-	-	-	-	30	30	10	-
	2	9	-	-	-	42	-	-	-	-	-	5	209	-	-	-	-	-	-	-	-	42	42	14	-
E	1	3	-	-	-	69	47	10	-	-	16	2	91	26	-	-	-	17	8	11	-	-	-	-	
	2	4	-	-	-	98	67	15	-	-	23	3	128	33	-	-	-	24	11	16	-	-	-	-	
	3	6	-	-	-	138	94	20	-	-	32	4	182	62	-	-	-	34	16	22	-	-	-	-	

Black and Red Marking Ink to IS: 1234 "Ink, Stencil, Oil Base, For Marking Porous Surfaces" or duplicating ink stencilling, oil base for marking porous surfaces.

All cases containing fragile items are to be stencilled with red marking and stencilling paint/ink.

"HANDLE WITH CARE", "FRAGILE DO NOT TURN OVER".

Besides the caution signs the product information shall be stencilled of letters with 13mm to 50mm height.

In case of consignment consists of more than one package, each package shall carry its Package No. as given in shipping list. All caution signs shall be stencilled in higher quality full glossy out door finishing paint red in colour (AA56126). All other markings shall be carried out in black enamel (AA56126).

Caution signs & other markings shall be stencilled on both the end shooks & the side shooks. Caution sign (for slinging) shall be stencilled only on side shooks at the appropriate place.

Note: In case the size of package is small for using the stencils, then hand written letters/figures shall be allowed.

15 PROCEDURE FOR HANDLING OF COMPONENTS

The purpose of this procedure is to protect the quality of the components/equipment while handling in various stages of manufacturing packing & despatching.

- 15.1** Adequate care shall be taken in handling the material, and components to avoid damage during receipts, storage issue manufacture & despatch operations.
- 15.2** Appropriate material handling equipment like fork lifters, cranes etc. Shall be used where needed.
- 15.3** Lifting by crane and transportation by trolley of critical items and large components like rotors castings etc. Shall be done carefully.
- 15.4** For critical items, where specified, special handling fixtures shall be used for lifting.
- 15.5** Slings and shackles used for lifting the components/equipment shall be checked for fitness and suitability before use.
- 15.6** Slings used on machined surfaces shall be suitably padded. No slings shall be used on journal surfaces.
- 15.7** Precision machined components like blades, catches, rollers etc. Shall be lifted using suitable wooden pallets.

15.8 HANDLING OF COMPONENTS ON RECEIPT/DESPATCH:

Before loading/unloading a packing case from the carrier look for the following shipping instructions painted on the packing case.

- The markings showing the upright position.
- The markings showing the sling position
- Markings showing the fragile contents.
- Other required markings as per Clause No. 12

- 15.8.1** Appropriate cranes and slings should be used for different components/ cases. Slings should normally make an angle as minimum as possible (width wise) but in no case more than 15°.
- 15.8.2** Handling and lifting should be done without jerks or impacts.
- 15.8.3** Immediately after receipt of the goods, the packing should be examined all-round for any sign of damage. If necessary, lift the cover or a number of boards of the case so as to make the contents visible. In the event of sealed packing being used the plastic sheeting should not be damaged. It is imperative that the packing material is restored in original condition after the inspection.
- 15.8.4** On receipt of the equipment it should be checked with the shipping list and missing or damage if any should be reported immediately. It is important to arrange for immediate examination to determine the extent of the damage, the cause of the damage and where applicable the person or persons responsible for the damage. According to general practice when transporting by railway or by road vehicle the carrier concerned should be immediately called upon (within specified periods) for jointly establishing a statement of the damage. This is essential as a basis for a subsequent claim and possible damage report to the insurance company.
- 15.8.5** Protective coating applied on machined surfaces should not be disturbed. The plastic covering should be put back carefully so that it prevents ingress of dust and moisture. Some packing may have vapour phase inhibitor (VPI) paper enclosed inside the packing cases. This should be restored to its original place as far as possible.
- 15.8.6** Silica gel and such other chemicals kept in the box as desiccants and indicators should also be left in the box itself.

16 GI SHEET

The packing cases are covered with GI sheet on outside for sides and top; inside for bottom as per the Figure-3 (GI sheet covering is applicable for all closed type of wooden packing).

17 Treatment of Wood & Application and use of the mark

For seaworthy export packing, treatment of wood has to be carried out as below subject to BHEL Engg & QC approval.

As per customer requirement for export packing, wood to be treated as applicable should be done as per International Standards for Phytosanitary Measures ISPM: 15 to control the growth stages viz. egg to adult of structural insects (beetles, borers, bugs, fleas, flies, lice, moths, roaches, termites) and other pests (mice, rats, spiders) etc. in stored products.

The specified marks applied to wood packaging material treated in accordance with ISPM 15 must conform to the requirements described in Annex 2 of ISPM 15.

17.1 Heat treatment using a conventional steam or dry kiln heat chamber (treatment code for the mark: HT)

When using conventional heat chamber technology, the fundamental requirement is to achieve a minimum temperature of 56 °C for a minimum duration of 30 continuous minutes throughout the entire profile of the wood (including its core).

This temperature can be measured by inserting temperature sensors in the core of the wood. Alternatively, when using kiln-drying heat chambers or other heat treatment chambers, treatment schedules may be developed based on a series of test treatments during which the core temperature of the wood at various locations inside the heat chamber has been measured and correlated with chamber air temperature, taking into account the moisture content of the wood and other substantial parameters (such as species and thickness of the wood, air flow rate and humidity). The test series must demonstrate that a minimum temperature of 56 °C is maintained for a minimum duration of 30 continuous minutes throughout the entire profile of the wood.

Treatment schedules should be specified or approved by the National Plant Protection Organisation (NPPO). Treatment providers should be approved by the NPPO.

17.2 Heat treatment using dielectric heating (treatment code for the mark: DH)

Where dielectric heating is used (e.g. microwave), wood packaging material composed of wood not exceeding 20 cm when measured across the smallest dimension of the piece or the stack must be heated to achieve a minimum temperature of 60 °C for 1 continuous minute throughout the entire profile of the wood (including its surface). The prescribed temperature must be reached within 30 minutes from the start of the treatment.

Treatment schedules should be specified or approved by the NPPO.

17.3 Methyl bromide treatment (treatment code for the mark: MB)

Wood packaging material containing a piece of wood exceeding 20 cm in cross-section at its smallest dimension must not be treated with methyl bromide.

The fumigation of wood packaging material with methyl bromide must be in accordance with a schedule specified or approved by the NPPO (National Plant Protection Organisation) that achieves the minimum concentration-time product (CT) over 24 hours at the temperature and final residual concentration specified in Table 1. This CT must be achieved throughout the profile of the wood, including its core, although the concentrations would be measured in the ambient atmosphere. The minimum temperature of the wood and its surrounding atmosphere must not be less than 10 °C and the minimum exposure time must not be less than 24 hours. Monitoring of gas concentrations must be carried out at a minimum at 2, 4 and 24 hours from the beginning of the treatment. In the case of longer exposure times and weaker concentrations, additional measurement of the gas concentrations should be recorded at the end of fumigation.

If the CT is not achieved over 24 hours, corrective action needs to be taken to ensure the CT is reached; for example, the treatment is restarted or the treatment time extended for a maximum of 2 hours without adding more methyl bromide to achieve the required CT (see the footnote to Table 2).

Table 2 – Minimum CT over 24 hours for wood packaging material fumigated with methyl bromide

Temperature (°C)	CT (g·h/m ³) over 24 h	Minimum final concentration (g/m ³) after 24 h#
21.0 or above	650	24
16.0 – 20.9	800	28
10.0 – 15.9	900	32

In circumstances when the minimum final concentration is not achieved after 24 hours, a deviation in the concentration of ~5% is permitted provided additional treatment time is added to the end of the treatment to achieve the prescribed CT.

One example of a schedule that may be used for achieving the specified requirements is shown in Table 3.

Table 3 – Example of a treatment schedule that achieves the minimum required CT for wood packaging material treated with methyl bromide (initial doses may need to be higher in conditions of high sorption or leakage)

Temperature (°C)	Dosage (g/m ³)	Minimum concentration (g/m ³) at:		
		2 h	4 h	24 h
21.0 or above	48	36	31	24
16.0 – 20.9	56	42	36	28
10.0 – 15.9	64	48	42	32

Treatment providers should be approved by the NPPO.


17.4 Marking

The specified marks applied to wood packaging material treated in accordance with ISPM 15 must conform to the requirements described in ISPM 15.

18 PROVISION FOR INSPECTION

This clause is applicable only where contractual requirement of customer is there. For other packings this is not applicable.

Each transportable packing's shall have provision for inspection by customer authority etc. during transport from origin of dispatched till destination. This inspection may require opening of the package and subsequently closing it again. For this purpose suitable designed opening with bolted cover shall be provided. Such an opening shall be clearly marked as "OPENING" with clear instruction for opening & closing written on this cover. For large consignment the size of the opening shall be suitable to facilitate entry of personnel.

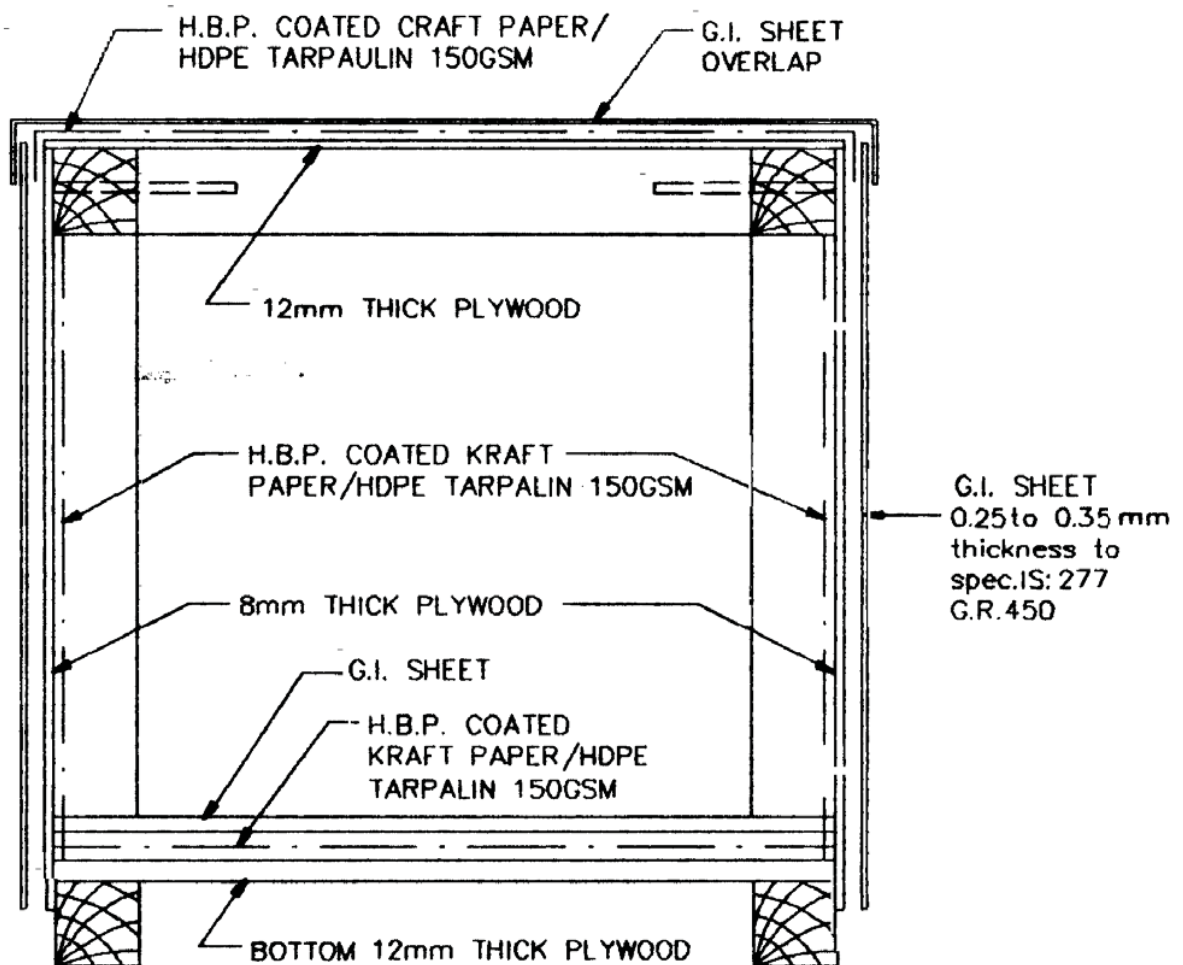

CLOSED PACKING CASE WITH
 G.I.SHEET SHOWING LAYERS
 OF PACKING MATERIALS

Figure 3



**KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATION FOR
AGITATORS OF FGD SLURRY TANKS**

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION : II

REV: 00

DATE: OCT 21

SHEET 1 OF 1

SECTION - II



**KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS**

SPECIFICATION No: PE-TS-466-571-18000-A002

SECTION : II

ANNEXURE-1

**LIST OF DOCUMENTS TO BE SUBMITTED WITH
BID**

REV: 00

DATE: OCT 2021

SHEET 1 OF 1

**BIDDER SHOULD SUBMIT THE SIGNED AND STAMPED COPY OF THE
FOLLOWING DOCUMENTS:**

Document for Evaluation:

1. Compliance cum confirmation certificate (Refer Annexure-2 of section-II).
2. Pre-bid clarification, if any, as per format given under Section-II (Annexure-3)
3. Amendment to specification, if any, issued by BHEL dully signed and stamped.
4. Deviation schedule as per format given under Section-II (Annexure-4), in case of any deviations by bidder.
5. Documents for meeting the Pre-Qualification Requirement (3K format has to be submitted along with supporting documents as given under Annexure-10, section-II).
6. List of special tools and tackles (Refer Annexure-7 of section-II).
7. Dully filled Guaranteed power consumption format (In the format attached with the price schedule) declaring guaranteed power consumption value in KW along with the Technical offer.

Document for Reference:

1. Agitator Schedule filled up by the bidder (Refer Annexure-8 of section-II).
2. GA drawing, Exploded view with Material of construction, total weight of all Agitators models offered.
3. Agitator Motor Sizing Calculation.
4. Electrical Load data filled up by the bidder (Refer Annexure-5 of section-II).
5. Test arrangement at shop
5. Product catalogue for offered agitators

Details mentioned under reference documents are subject finalization during detail engineering meeting requirements mentioned in various parts of the specification.



KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS
**COMPLIANCE CUM CONFIRMATION
CERTIFICATE**

SPECIFICATION No:PE-TS-466-571-18000-A002
SECTION : II
ANNEXURE-2
REV. NO. 00 **OCT 2021**
SHEET: 1 OF 2

COMPLIANCE CUM CONFIRMATION CERTIFICATE

The bidder shall confirm compliance with following by signing / stamping this compliance certificate (every sheet) and furnish same with the offer.

- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions, other than those mentioned under "exclusion and those resolved as per 'Schedule of Deviations', with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the 'Schedule of Deviations'. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the 'Schedule of Deviations'
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL / CUSTOMER approval & customer hold points for inspection / testing shall be marked in the QP at the contract stage. Inspection / testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc. This is within the contracted price without any extra implications to BHEL after award of the contract.
- d) All drawings/ data-sheets / calculations etc. submitted along with the offer shall not be taken cognizance off.
- e) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified / intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements then same shall be resolved by the bidder with BHEL during the pre-bid discussions, otherwise BHEL / Customer's decision shall be binding on the bidder whenever the deficiency is pointed out.

For components where materials are not specified, same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- f) The commissioning spares shall be supplied on 'As Required Basis' & prices for same included in the base price itself.
- g) All sub vendors shall be subject to BHEL / CUSTOMER approval in the event of order.
- h) Guarantee for plant/equipment shall be as per relevant clause of GCC / SCC / Other Commercial Terms & Conditions
- i) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break up, approved drawing or approved Bill of quantities within the scope of work as tender specification. This clause will apply in case during site commissioning, additional requirements emerges due to customer and / or consultant's comments. No extra claims shall be put on this account



KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS
COMPLIANCE CUM CONFIRMATION
CERTIFICATE

SPECIFICATION No:PE-TS-466-571-18000-A002

SECTION : II

ANNEXURE-2

REV. NO. 00

OCT 2021

SHEET: 2 OF 2

- j) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's / Customer's / Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- k) As built drawings shall be submitted as and when required during the project execution.
- l) The bidder has not tempered with this compliance cum confirmation certificate and if at any stage any tempering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.
- m) Successful bidder shall furnish detailed erection manual for each of the equipment supplied under this contract at least 3 months before the scheduled erection of the concerned equipment / component or along with supply of concerned equipment / component whichever is earlier.
- n) Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations of completing the work as per specification requirement. Any deviation from specified requirement shall be reported by the vendor in writing and require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.
- o) In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor's account and shall not be used as a reason for extension in contract completion.



KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION NO. PE-TS-466-571-18000-A002

SECTION-II

ANNEXURE-4

REV: 00

OCT 2021

ANNEXURE-4

**SCHEDULE OF TECHNICAL
DEVIATION**

(PLEASE REFER GCC FOR THE FORMAT OF DEVIATION)

LOAD TITLE	RATING (KW / A)		UNIT (U)/STN (S)	Nos.		VOLTAGE CODE*	FEEDER CODE**	EMER. LOAD (Y)	CONT.(C)/INTT.(I)	STARTING TIME >5 SEC (Y)	LOCATION	BOARD NO.	CABLE		BLOCK CABLE DRG. No.	CONTROL CODE	REMARKS	LOAD No.
	NAME PLATE	MAX. CONT. DEMAND (MCR)		RUNNING	STANDBY								SIZE CODE	NOs				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19

ANNEXURE-5

Filtrate Water Tank Agitator				1	0				C									
Secondary Waste Water Hydro-cyclone Feed Tank Agitator				1	0				C									
Waste Water Tank Agitator				1	0				C									
Limestone Slurry Storage Tank Agitator				2	0				C									
Gypsum Area Drain Sump Agitator				1	0				C									
Limestone Area Drain Sump Agitator				1	0				C									
Auxiliary Absorbent Tank Agitator				3	0				C									
Primary hydro cyclone feed tank Agitator				1	0				C									
Absorber Area Drain Sump Agitator -1				1	0				C									
Absorber Area Drain Sump Agitator -2				1	0				C									
Absorber Area Drain Sump Agitator -3				1	0				C									
Absorber Area Drain Sump Agitator -4				1	0				C									
Absorber Area Drain Sump Agitator -5				1	0				C									

NOTES: 1. COLUMN 1 TO 12 & 18 SHALL BE FILLED BY THE REQUISITIONER (ORIGINATING AGENCY); REMAINING COLUMNS ARE TO BE FILLED UP BY PEM (ELECTRICAL)/ CUSTOMER
2. ABBREVIATIONS : * VOLTAGE CODE (7):- (ac) A=11 KV, B=6.6 KV, C=3.3 KV, D=415 V, E=240 V (1 PH), F=110 V (cc): G=220 V, H=110 V, J=48 V, K=+24V, L=-24 V
: ** FEEDER CODE (8):- U=UNIDIRECTIONAL STARTER, B=BI-DIRECTIONAL STARTER, S=SUPPLY FEEDER, D=SUPPLY FEEDER (CONTACTER CONTROLLED)

ANNEXURE-5 LOAD DATA (ELECTRICAL)	JOB NO.	466	ORIGINATING AGENCY		PEM (ELECTRICAL)	
	PROJECT TITLE	KORBA STPP	NAME			
	SYSTEM	AGITATOR	SIGN.			
	DEPTT. / SECTION	MAUX	SHEET 1 OF 1	REV. 00	DATA FILLED UP ON	
					DATA ENTERED ON	
					DE'S SIGN. & DATE	



**KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS**

SUB-VENDOR LIST

SPECIFICATION NO. PE-TS-466-571-18000-A002

SECTION : II

ANNEXURE : 6

REV 00

DATE: OCT 2021

SHEET 1 OF 1

LIST OF MAKES OF ITEMS

<u>S.N.</u>	<u>ITEM NAME</u>	<u>MANUFACTURER</u>	<u>LOCATION</u>



TITLE:
KORBA SUPER THERMAL POWER PLANT
TECHNICAL SPECIFICATIONS FOR
AGITATORS OF FGD SLURRY TANKS

SPECIFICATION NO. PE-TS-466-571-18000-A002

SECTION : II

ANNEXURE-7

REV 00

DATE: OCT 2021

SHEET: 1 OF 1

LIST OF SPECIAL TOOLS AND TACKLES

Bidder shall supply a set of special tools and tackles required either for erection or operation or maintenance of the agitator units. A list of such tools and tackles shall be submitted along with the offer in the format below.

Sl.no.	Description of item	Quantity

In case bidder indicates that no special tools and tackles are required but the same is found applicable during detailed engineering the same shall be supplied by the bidder without any commercial and delivery implications.

SIGNATURE: _____

NAME : _____

DESIGNATION: _____

COMPANY: _____

DATE: _____

COMPANY SEAL

ANNEXURE-8

KORBA TPS - AGITATOR SCHEDULE (To be submitted with the offer by Bidder)

REV-0

Sl.No.	Description	Auxiliary Absorbent Tank Agitator	Limestone Slurry Storage tank Agitator	Primary Hydrocyclone feed tank Agitator	Secondary Hydrocyclone feed tank Agitator	Filtrate water tank Agitator	Waste water Tank Agitator	Absorber Area Drain Pit Agitator	Gypsum Dewatering Area Drain Pits Agitator	Ball Mill Area Drain Pit Agitator
1	Agitator Sl No.	1	2	3	4	5	6	7	8	9
2	Type	Marine Propeller – Horizontal Type (Side Entry),	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)
3	Medium to be handled	Gypsum slurry	Limestone slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Limestone slurry
4	Seal Type	Mechanical Seal (Flushless)	Not required	Not required	Not required	Not required	Not required	Not required	Not required	Not required
5	Duty	Intermittent- Whenever FGD is under maintenance	Continuous	Continuous	Continuous	Continuous	Continuous	Intermittent	Intermittent	Intermittent
6	Agitator Location	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor
7	Tank details									
a)	Tank Shape	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Rectangular	Rectangular	Rectangular
b)	Tank name	Auxiliary Absorbent Tank	Limestone Slurry Storage tank	Primary Hydrocyclone feed tank	Secondary Hydrocyclone feed tank	Filtrate water tank	Waste water Tank	Absorber Area Drain Pit	Gypsum Dewatering Area Drain Pits	Ball Mill Area Drain Pit
c)	Capacity of Slurry (in m3)	1817.9	3056	422	225.6	215.69	522	56	56	56
	Dimension (in m)									
d)	Diameter	13.5	16.0	8.0	6.5	6.5	8.5	-	-	-
e)	Length	-	-	-	-	-	-	4	4	4
f)	Breadth	-	-	-	-	-	-	4	4	4
g)	Height	13.5	16.0	8.9	7.3	7.0	9.7	4	4	4
8	MOC of Agitator	Refer Clause no 3.2, Material of construction in SECTION-4, SUB SECTION-C1 of Specific technical requirement (Mechanical)								
9	Quantity of Agitator per tank	3 (Refer note-2)	1	1	1	1	1	1	1	1
10	Total quantity of agitators (for three units)	3 (Refer note-2)	2	1	1	1	1	5	1	1
11	Slurry Analysis									
a)	Slurry to be handled	Gypsem slurry	Limestone slurry	Gypsem slurry	Gypsem slurry	Gypsem slurry	Gypsem slurry	Gypsem slurry	Gypsem slurry	Limestone slurry
b)	Maximum solid particle size	200 mesh (74 μ)	200 mesh (74 μ)	200 mesh (74 μ)	200 mesh (74 μ)	6-7 mm	200 mesh (74 μ)	6-7 mm	6-7 mm	6-7 mm
c)	Normal solid particle size, d50	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)	325 mesh (44 μ)
d)	Solid to be handled	gypsum along with Limestone & other impurities	Limestone + impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	Limestone + impurities
e)	Chloride concentration	max 26000 ppm	max 1000 ppm	max 26000 ppm	max 26000 ppm	max 26000 ppm	max 26000 ppm	max 26000 ppm	max 26000 ppm	max 1000 ppm
f)	Hardness of particle	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale	5-7 mohs scale
g)	Slurry concentration, wt%	30 wt%	30 wt%	30 wt%	16.60%	11%	3%	30%	30%	30 wt%
h)	Sp. Gravity of slurry	1.216	1.215	1.216	1.112	1.067	1.023	1.216	1.216	1.215
i)	Sp. Gravity of Lime Stone & Gypsum	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)
j)	Viscosity of Slurry	10 cP	30 cP	10 cP	4 cP	4 cP	3 cP	10 cP	10 cP	30 cP
k)	pH	4 to 8	5 to 8	4 to 8	4 to 8	4 to 8	4 to 8	4 to 8	4 to 8	5 to 8

l) SiO ₂ Content	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l
m) Temperature	Normal -62 deg C; Design-70 deg C.	Normal -45 deg C; Design-55 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -58 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -45 deg C; Design-55 deg C.
12 Motor										
a) Total Power consumed	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
b) Motor Rating	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
c) Motor Explosion Proof Class	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof
d) Motor Protection Class	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor
e) Motor Efficiency Class	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3
13 Tank Levels										
a) Minimum Liquid level In the tank (in M)	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.4	1.4	1.4
b) Normal Liquid Level in the tank (in M)	12.5	15.0	8.2	6.6	6.3	9.0	3.3	3.3	3.3	3.3
c) Maximum Liquid Level in the Tank (in M)	12.7	15.2	8.4	6.8	6.5	9.2	3.5	3.5	3.5	3.5
14 Impeller										
a) Type of impeller	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
b) No. of impeller stages per agitator	-	2	2	1	1	2	1	1	1	1
c) Impeller diameter	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
d) Impeller tip speed (Refer S.N. 19 c)	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
e) Operating speed	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
f) Agitator Pumping Capacity	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
g) Volume/Agitator	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
h) Power Number for Agitator	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
15 Baffle Plates (not in bidder's scope)										
a) No. & size of baffle plates	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
c) Thickness of baffle plates (mm)	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
d) Distance from Bottom of the tank	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
16 Nozzle (not in bidder's scope)										
a) Size of the nozzle on which agitator frame is mounted	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	NA	NA	NA
17 Loads										
a) Static Load	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
b) Dynamic load	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
c) Torsional Moment (Nm)	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
d) Bending Moment (Nm)	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
18 Power loading for Auxiliary power consumption	Not applicable	Applicable	Applicable	Applicable	Applicable	Applicable	Applicable	Not applicable	Not applicable	Not applicable
19 Parameters to be considered compulsarily by bidder for design of Agitators										
a) Uniform suspension of solids by Agitators	The agitators shall keep the solid particles in suspended mode in liquid slurry with "Full off-Bottom Suspension" of solid particles to 98% of liquid column to virtually "Uniform Solid Concentration".									
b) Mounting of Agitaor (For Vertical Agitators)	The Agitators shall be mounted on the Agitator platform which shall be approximately at a height of 1.0 m from the tank roof. However, the Agitator platform is excluded from bidder's scope.									

c)	Maximum permitted impeller tip speed	12 m/s							
d)	Impeller tip dia/ tank dia	-	1/3 (approx)	1/3 (approx)	1/3 (approx)	1/3 (approx)	1/3 (approx)	1/3 (approx)	1/3 (approx)
Notes									
1	There shall be complete re-suspension of all solids after a 24 hour outage. Accumulation of solids shall not prevent agitator restart.								
2	Agitation shall be provided to prevent settlement of slurry by side entry agitators . All the side-entry agitators shall be similar								
3	Maximum Sound Pressure Level at a height of 1.5 m above floor level in elevation, and at a distance of 1.0 m horizontally shall be 85 dBA.								
4	Although the height of all tanks is fixed above, same may vary slightly during detailed engineering as per design calculation of tanks.								
5	Normal solid particle size shall be used for design of all Agitators in tanks and sumps.								
6	Slope of roof shall be considered approximate 5 deg for all the tanks.								

**FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE
FOR
LOT-3 PROJECTS
BIDDING DOCUMENT NO. CS-0011-109(3)-9**

Bidder's Name and Address:

To
Contract Services-III
NTPC Limited
Noida-201301

Summary of Critical Equipment indicated under clause 4.01.00, sub-section-I, Part-A of Section-VI.

Equipment Name	Sub-Vendor Name	Collaborator's Name, if applicable	Seeking Qualification as per clause..... Sub-Section-I, Part-A of Section-VI
Booster Fans			*4.01.01 / *4.01.02 / *4.01.03
*Slurry Recirculation Pumps			*4.01.01 / *4.01.03 / *4.01.07
Oxidation Blowers			*4.01.01 / *4.01.03 / *4.01.04
Wet limestone Grinding mills			*4.01.01 / *4.01.03 / *4.01.05 (i) / 4.01.05 (ii)
Slurry Pumps			*4.01.01 / *4.01.03
Agitators			*1.2, *1.4, *1.7
Vacuum Belt filters			*4.01.01 / *4.01.03

Note : *Strike-off whichever is not applicable.

1. If qualification sought as per clause *1.2 sub-section-I-A, Part-A of Section-VI then the details of the sub vendor (manufacturer) shall be filled by the bidder in the format A to G.
- ~~2. If the qualification sought as per the clause 4.01.02, sub-section-I-A, Part-A of Section-VI, then the details of proposed sub vendor (i.e manufacturer of such equipment for at least *195/*250/*500/*660 MW unit rating) shall be filled individually by the bidder in the format A and the details of collaborator who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI shall also be filled by the bidder in the format A separately. Further, in case of qualification vide clause 4.01.02, sub-section-I-A, Part-A of Section-VI a copy of valid ongoing collaboration and technology transfer agreement for design, engineering, manufacturing, supply of such equipment in India with the collaborator who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI shall also be furnished.~~
3. If the qualification sought as per the clause *1.4 sub-section-I-A, Part-A of Section-VI then the details of JV/Subsidiary Company formed for manufacturing of such equipment in India shall be furnished individually for each equipment by the bidder such as,
 - i) Copy of document of incorporation of JV/Subsidiary company in India
 - ii) Copy of valid ongoing collaboration and technology transfer agreement for design, engineering, manufacturing, supply of such equipment in India with the collaborator who meets the requirement stipulated at *1.2, sub-section-I-A, Part-A of Section-VI.
 - iii) Copy of document of at least 26% equity participation of qualified equipment manufacturer in the Indian JV company/subsidiary company directly or indirectly through its holding company /Subsidiary company, which shall be maintained for a lock -in period of seven (7) years from the date of incorporation of such JV/subsidiary or up to the end of defect liability period of the contract which ever is later.

Further, the details of collaborator or technology provider of the qualified equipment manufacturer who meets the requirement stipulated at *1.2, sub-section-I-A, Part-A of Section-VI shall be filled by the Bidder in the format A to G (format given at 1.00.00). In addition to that, the sub vendor along with the Indian JV company/subsidiary company, qualified equipment manufacturer and its holding company/subsidiary company as applicable shall furnish the Letter of Support as per the format enclosed at Annexure-I.

*** strike out whichever is not applicable.**

- 1.00.00 (Applicable for Bidder/his sub vendors seeking qualification as per clause no. *1.2 , Sub section-I, Part-A of Section-VI. Bidder shall furnish the required data only for those equipments / auxiliaries which are proposed to be sourced under this route.)

We, hereby furnish the data on proveness criteria for critical equipment, auxiliaries, systems and Bought Out Items such as ~~Booster Fans, *Slurry Recirculation Pumps, Oxidation Blowers, Wet Limestone Grinding Mills, Slurry Pumps, & Agitators~~ which have been designed (either by self manufacturer or under valid ongoing collaboration and technology transfer agreement), *manufactured/ *got manufactured and supplied by us /Manufacturer (or manufactured/ got manufactured & supplied by our proposed sub-vendors) and these are in successful operation in at least one (1) plant for a period not less than one year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder. The details of type and minimum equipment rating of such equipment are given below :

~~A. **For Booster Fans:** We declare that, we/our Sub-Vendor, have designed (either by itself or under collaboration / licensing agreement),*manufactured/*got manufactured and supplied at least one (1) number of Booster Fan of required flow & head of the offered Booster Fan with Fan Speed 900 rpm (maximum), Axial type with variable pitch control working in a Coal fired power plant and which has been in successful operation for minimum one(1) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder, as per the details furnished below:~~

Sl. No.	Description	Reference Work
1.	Name of the reference plant & location:	
2.	Client name and his address:	
3.	No. of units and capacity in MW of unit:	
4.	Whether equipment operating in a coal fired power plant	- *Yes/*No
5.	Name of equipment manufacturer & address:	

F. Agitators: We declare that, we/our Sub-Vendor, have designed (either by itself or under collaboration / licensing agreement),*manufactured/*got manufactured and supplied at least one (1) number of Agitators with rating not less than that supplied for 500 MW or higher size unit for similar application, Vertical/Horizontal type working in Wet Limestone based FGD application in Coal fired power plant and which has been in successful operation for minimum one(1) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder, as per the details furnished below::

Sl. No.	Description	Reference Work
1.	Name of the reference plant & location:	
2.	Client name and his address:	
3.	No. of units and capacity in MW of unit:	
4.	Whether power plant is coal fired	-*Yes/*No
5.	Whether operating in a Wet Limestone based FGD application in coal fired power plant	-*Yes/*No
6.	Name of equipment manufacturer & address:	
7.	Date of commission of the equipments:	
8.	Model no. of the equipment:	
9.	Brief Technical particulars of the equipments:	
10.	Agitators supplied forMW unit size

Sl. No.	Description	Reference Work
11.	Whether the equipment(s) are in successful operation in atleast one(01) plant for a period not less than one(01) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder	-*Yes/*No
12.	Flue gas Desulphurization system details:	*Technical extract/ *paper letter/ *email/ *Drwaing from user or *contract document or *scheme or *any document in public domain enclosed at annexure....to Attachment-3K
13.	Scope of Work:	*Letter of Award or *Contract or *P.O. enclosed at Annexure.....to Attachment-3K
14.	Performance details:	*Certificate/*Letter/*E-mail from End user enclosed at Annexure.....to Attachment-3K

*** Strike off whichever is not applicable.**

***7.00.00** **Applicable for Bidder/his sub vendors seeking provenness criteria as per clause no. *1.7 , Sub section-I, Part-A of Section-VI.**

7.01.00 We, hereby confirm that *we/*our sub-vendors is a manufacturer of a manufacturer of Agitators for similar process/duty application in petrochemical or metals and mining industry. (Details of references enclosed at Annexure)

(Data to be furnished in line with format given at 1.00.00 of this Attachment))

7.02.00 We further confirm that details in respect of collaboration / valid licencing agreement for the Agitator between *us/*our sub-vendors, as per 6.01.00 above, and with qualified Agitator manufacturer, who meets the requirement stipulated at clause *1.2 , sub-section-I, Part-A, Section-VI are enclosed at **Annexure-.....** to this Attachment. The data in respect of provenness criteria for the qualified Agitator manufacturer, which is in successful operation in at least one (1) plant for a period not less than one reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder are furnished below.

We further confirm that before taking up the manufacturing of such Agitator, *we/ *our sub vendor(s) *will create /*have created manufacturing facilities at his works as per collaborator's/licenser's design, manufacturing and quality control system.

(Data to be furnished in line with format given at 1.00.00 of this Attachment)

***3.00.00** **Applicable for JV Company/Subsidiary Company meeting provenness criteria as per clause no. *1.2, Sub section-IA, Part-A of Section-VI.**

3.01.00 We, hereby confirm that JV company/ Subsidiary company (Strike off whichever is not applicable) formed for manufacturing and supply of equipment(s) (~~*Booster Fans, *Slurry Recirculation Pumps, *Oxidation Blowers, *Wet Limestone Grinding Mills, *Slurry Pumps, *Agitators, *Vacuum Belt Filters~~) has a valid ongoing collaboration and technology transfer agreement for design, engineering, manufacturing of such equipment(s) in India with a qualified equipment manufacturer who meets the requirements stipulated at clause 4.01.01 of sub-section-I, Part-A, Section VI of bidding documents (or the technology provider of the qualified equipment manufacturer). Further, in such a case, such qualified equipment manufacturers is having, directly or indirectly through its holding company/subsidiary company, at least 26% equity participation in the Indian Joint Venture Company/subsidiary company, which shall be maintained for a lock-in period of seven (7) years from the date of incorporation of such Joint Venture / Subsidiary or up to the end of defect liability period of the contract, whichever is later. Before taking up the manufacturing of such equipment(s) (~~*Booster Fans, *Slurry Recirculation Pumps, *Oxidation Blowers, *Wet Limestone Grinding Mills, *Slurry Pumps, *Agitators, *Vacuum Belt Filters~~), we/ our sub vendor(s) *will create /*have created manufacturing facilities at his works as per collaborator's/licenser's design, manufacturing and quality control system.

We further confirm that details in respect of collaboration / valid licencing agreement for the aforesaid equipment(s) (~~*Booster Fans, *Slurry Recirculation Pumps, *Oxidation Blowers, *Wet Limestone Grinding Mills, *Slurry Pumps, *Agitators, *Vacuum Belt Filters~~) who meets the requirement stipulated at clause *1.2, sub-section-I, Part-A, Section-VI for are enclosed at **Annexure-.....** to this Attachment.



SECTION-B

PROVENNESS

The Bidder / Bidder's sub-vendor(s) is required to meet the provenness criteria and/or qualification requirement for the items/ services listed below as per the stipulated criteria indicated in the respective clauses. For the purpose of qualification of Bidders / Sub-vendor(s), experience shall be reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder unless otherwise specified in the respective clauses.

1.0 Provenness Criteria/Qualifying Requirements for Equipments/Systems

1.1 The Bidder / Bidder's sub-vendor(s) is required to meet the provenness criteria and/or qualification requirement for critical equipments, auxiliaries, systems and bought out items as per criteria stipulated below:

1.2 ~~Booster Fans, Slurry Recirculation Pumps, Oxidation Blowers, Wet Limestone Grinding Mills, Slurry Pumps, Agitators & Vacuum Belt Filters~~ for the Wet Limestone based Flue Gas Desulphurisation (FGD) System offered by the Bidder shall be only from such manufacturer(s) who has previously designed (either by itself or under collaboration / licensing agreement), manufactured / got manufactured the respective equipment(s) of the type, application and minimum equipment rating as stipulated below such that the respective equipment(s) should have been in successful operation in at least one (1) plant for a period not less than one(1) year.

Type and Rating for Qualification

Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating
(a)	Booster Fans	Axial type with variable pitch control	Coal fired power plant	Unit size of 500 MW – Flow 490 m ³ /s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)
				Unit size of 210 MW & Below – Flow 225 m ³ /s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)
(b)	Slurry Recirculation Pumps	Centrifugal type	Wet Limestone based FGD application in Coal fired	Unit size of 500 MW & Above - Flow 10200 m ³ /hr (min.) with Head 16

CLAUSE NO.

INTENT OF SPECIFICATION



Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating
			power plant	Meters of Liquid Column (min.) Unit size of 210 MW & Below – Flow 5680 m3/hr (min.) with Head 16 Meters of Liquid Column (min.)
(c)	Oxidation Blowers	Centrifugal/ positive displacement type blower	Wet Limestone based FGD application in Coal fired power plant or any other process application	Unit size of 500 MW & Above - Flow 7300 Nm3/hr Dry Basis (min.) with Head 8500 mmwc (min.) for spray tower process Or Head 3500 mmwc (min.) for bubbling type process Unit size of 210 MW & Below - Flow 5000 Nm3/hr Dry Basis (min.) with Head 6500 mmwc (min.) for spray tower process Or Head 3500 mmwc (min.) for bubbling type process
(d)	Wet limestone Grinding mills	Horizontal Wet Ball mill	Wet Limestone based FGD application in Coal fired power plant	Station size of 2001 MW – 2600 MW Capacity 40 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh Station size of 1501 MW – 2000 MW - Capacity 30 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION – VI, PART-A
BID DOC. NO.:CS-0011-109(3)-9

SUB-SECTION-I
INTENT OF
SPECIFICATION

PAGE
8 OF 19


CLAUSE NO.


INTENT OF SPECIFICATION




Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating
				Station Size of 1000 MW -1500 MW Capacity 20 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh
(e)	Slurry Pumps	Centrifugal type	Wet Limestone based FGD application or ash slurry application in Coal fired power plant	Unit size of 500 MW & Above - Flow 50 m3/hr (min.) with head 30 Meters of Liquid Column (min.) Unit size of 210 MW & Below - Flow 25 m3/hr (min.) with head 30 Meters of Liquid Column (min.)
(f)	Agitators	Vertical/Horizontal	Wet Limestone based FGD application in Coal fired power plant	Agitator rating not less than that supplied for 500 MW or higher size unit for similar application
(g)	Vacuum Belt filters	Belt type	Wet Limestone based FGD application in Coal fired power plant or in any other process application	Station size of 2001 MW- 2600 MW-Capacity 65 T/hr (min.) Station size of 1501 MW-2000 MW-Capacity 50 T/hr (min.) Station Size of 1000 MW – 1500 MW-Capacity 35 T/hr (min.)

The provenness criteria for equipment (Booster Fans) stipulated at Sl. No. 1.2 (a) above shall also be considered acceptable provided the rating parameters (i.e., flow, head and rated rpm) is covered within the operating regime of the respective fan performance curve of the reference plant equipment.

CLAUSE NO.	INTENT OF SPECIFICATION									
1.3	<p>The provenness criteria for equipment (Slurry Recirculation Pumps) stipulated at Sl. No. 1.2 (b) above shall also be considered acceptable provided the rating parameters (i.e., flow and head) is covered within the operating regime of the respective Slurry Recirculation Pump performance curve of the reference plant equipment.</p> <p>In case the Bidder or the proposed sub-vendor is not manufacturer of proven Booster Fans as per clause 1.2 (a) above but is a manufacturer of such equipment for units of at least * MW rating, the Bidder or the proposed sub vendor shall be considered qualified for manufacturing such equipment for ** MW units also, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such equipment in India with such manufacturer who meets the requirements stipulated at clause 1.2 (a) above for the Booster Fans.</p> <p>For value of * and ** refer table below.</p> <table border="1" data-bbox="386 716 1307 816"> <thead> <tr> <th data-bbox="386 716 565 747">*</th> <th data-bbox="565 716 1307 747">**</th> </tr> </thead> <tbody> <tr> <td data-bbox="386 747 565 779">195 MW</td> <td data-bbox="565 747 1307 779">195 MW – 500 MW</td> </tr> <tr> <td data-bbox="386 779 565 816">500 MW</td> <td data-bbox="565 779 1307 816">660 MW</td> </tr> </tbody> </table>			*	**	195 MW	195 MW – 500 MW	500 MW	660 MW	
*	**									
195 MW	195 MW – 500 MW									
500 MW	660 MW									
1.4	<p>A JV / Subsidiary Company formed for manufacturing and supply of equipment(s) as listed at clause no. 1.2 above in India, shall also be considered qualified for manufacturing such equipment(s), provided that it has a valid collaboration or licensing agreement for design, engineering, manufacturing of such equipment(s) in India with a qualified equipment manufacturer who meets the requirements stipulated at clause 1.2 above (or the technology provider of the qualified equipment manufacturer) for the respective equipment(s). Before taking up the manufacturing of such equipment(s), the bidder/ his sub-vendor(s) must create /have created manufacturing facilities at his works as per collaborator's/licenser's design, manufacturing and quality control system for such equipment(s).</p> <p>Further, in such a case, such qualified equipment manufacturers should have, directly or indirectly through its holding company/ subsidiary company, at least 26% equity participation in the Indian Joint Venture Company/ Subsidiary Company, which shall be maintained for a lock-in period of seven (7) years from the date of incorporation of such Joint Venture/ Subsidiary or upto the end of defect liability period of the contract, whichever is later.</p>									
1.5	<p>In case the Bidder or the proposed sub-vendor is not manufacturer of proven Oxidation Blowers as per clause 1.2 (c) above but is a manufacturer of Blowers/compressors for minimum 50 NM³/min capacity, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Oxidation Blowers, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Oxidation Blowers in India with such manufacturer who meets the requirements stipulated at clause 1.2 (c) above for the Oxidation Blowers. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments.</p>									
<p align="center">LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9</p>	<p align="center">SUB-SECTION-I INTENT OF SPECIFICATION</p>	<p align="center">PAGE 10 OF 19</p>							

CLAUSE NO.	INTENT OF SPECIFICATION		
1.6	<p>(i) In case the Bidder or the proposed sub-vendor is not manufacturer of proven Wet limestone Grinding mills as per clause 1.2 (d) above but is a manufacturer of dry Grinding mills for power or cement industry of minimum 20 T/h capacity, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Wet limestone Grinding mills, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Wet limestone Grinding mills in India with such manufacturer who meets the requirements stipulated at clause 1.2 (d) above for the Wet limestone Grinding mills. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments.</p> <p>In addition, the Bidder shall be required to furnish a letter of support from Collaborator(s) / Licensor / Technology provider for successful performance of the equipment valid up to the end of defect liability period of the contract as per the format enclosed in the bidding documents, at the time of placement of order on the approved sub-vendor.</p> <p>OR</p>		
1.6	<p>(ii) In case, the bidder or proposed sub vendor is not a manufacturer of proven Wet Limestone Grinding Mills as per clause 1.2 (d) above, but have designed, manufactured & supplied dry Grinding Ball Tube mills for at least 500 MW pulverized coal fired power plant, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Wet limestone Grinding Mills provided it has a licensing agreement with a Wet limestone Grinding mills manufacturer who meets the requirements stipulated at clause 1.2 (d) above for the Wet limestone Grinding mills and provides extended warranty of three (3) years for the Wet Limestone Grinding Mills.</p>		
1.7	<p>In case the Bidder or the proposed sub-vendor is not manufacturer of proven Agitators as per clause 1.2 (f) above but is a manufacturer of Agitators for similar process/duty application in petrochemical or metals and mining industry, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Agitators, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Agitators in India with such manufacturer who meets the requirements stipulated at clause 1.2 (f) above for the Agitators. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments.</p>		
1.8	<p>In case the Bidder or the proposed sub-vendor is a manufacturer of Slurry Pumps who meets the requirements stipulated at clause 1.2 (e) above, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Slurry Recirculation Pumps, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such equipment in India with such manufacturer who meets the requirements stipulated at clause 1.2 (b) above for the Slurry Recirculation Pumps. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his</p>		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 11 OF 19

CLAUSE NO.	INTENT OF SPECIFICATION		
<p>1.9</p> <p>1.10</p> <p>1.11</p> <p>2.0</p> <p>2.1</p> <p>2.2</p> <p>2.3</p>	<p>works as per collaborator's /licenser's design, manufacturing and quality control system for such equipment.</p> <p>Before taking up the manufacturing of such equipment(s) as per clause 1.3, 1.4, 1.5, 1.6(i), 1.7 & 1.8 above, the Bidder / its sub vendor(s) must create (or should have created) manufacturing and testing facilities at its works as per Collaborator / licenser's design, manufacturing and quality control system for such equipments duly certified by the Collaborator / licensor. Further, the Collaborator / Licensor shall provide (or should have provided) all design, design calculation, manufacturing drawings and must provide (or should have provided) technical and quality surveillance assistance and supervision during manufacturing, erection, testing, commissioning of equipments.</p> <p>Bidder shall offer and supply only the type of the above equipment(s) for which it, itself or the manufacturer / Collaborator(s) / Licenser(s) proposed by the Bidder for the above equipment(s) is qualified.</p> <p>The Employer reserves the right to fully satisfy himself regarding capability and capacity of Bidder / its sub-vendor(s) and the proposed arrangement and may prescribe additional requirement before allowing manufacture of the equipment listed above for this contract.</p> <p>Note to clause 1.2</p> <p>(1) Whenever the term 'coal fired' is appearing above, "Coal" shall be deemed to also include bituminous coal/brown coal/Anthracite Coal/lignite.</p> <p>Sub QR for Civil Works:</p> <p>Bidder or its agency should have in past executed civil and structural works for * or higher capacity (applicable for project having ** MW unit rating) coal based/Lignite based power plant including earthwork in filling involving mechanical compaction and cutting in hard rock, piling, foundations, Bulk material handling plant involving underground storage hopper and underground tunnels.</p> <p>Bidder can engage more than one agency, in case the Bidder itself is not able to meet the requirement at 2.1. The agency being engaged for a particular work should have in the past executed such works of * or higher capacity plant (applicable for project having ** MW unit rating).</p> <p>For Chimney, Bidder or its agency should have in the past built at least one (1) reinforced concrete chimney of minimum 100m height.</p>		
<p>LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9</p>		<p>SUB-SECTION-I INTENT OF SPECIFICATION</p>

KORBA SUPER THERMAL POWER PLANT					REV-00,
ANNEXURE-11: GUARANTEED POWER CONSUMPTION FORMAT					
Sl.No.	Description / Item	Quantity (working)	Power Consumption (KW) (at motor input terminal)	Duty Factor	Power Consumption (KW)
1	2	3	4	5	6 = 3 x 4 x 5
A)	Limestone slurry storage tank agitator	2	To be filled by Bidder	1	To be filled by Bidder
B)	Primary hydro-cyclone feed tank agitator	1	To be filled by Bidder	1	To be filled by Bidder
C)	Secondary hydrocyclone feed tank agitator	1	To be filled by Bidder	1	To be filled by Bidder
D)	Filtrate water Tank Agitator	1	To be filled by Bidder	1	To be filled by Bidder
E)	Waste Water Tank Agitator	1	To be filled by Bidder	1	To be filled by Bidder
F)			Total Guaranteed power (KW)		To be filled by Bidder
Notes					
1	Power consumption (KW) of motors shall be measured at motor input terminals when the system operating at the rated capacity.				
2	Total Estimated Power Consumption Figure for the above mentioned Agitators is considered as 233.5 KW which is to be treated as base power. Declared Guaranteed Power Consumption in this Format duly signed and stamped shall be submitted along with technical bid. Total GPC given by the bidder shall not exceed 233.5 kW failing which offer of bidder will not be considered for evaluation.				
3	Total power (@ S.No. F above) and not individual power quoted by bidder shall be termed as 'Guaranteed Power consumption' (GPC) and bidder shall be liable to demonstrate compliance to GPC value during PG test/ Demonstration test at site. If the actual power consumption exceeds 233.5 kW , liquidated damages shall be payable by the successful bidder at the rate of INR 191661/- per KW excess power consumption over 233.5 kW. Such liquidated damages may be recovered by the BHEL by deduction from the contract price or by enforcing the contract performance guarantee or in any other manner deemed fit by the BHEL. Acceptable short fall limit for GPC <u>WITH LD</u> will be (+1%) of base power (233.5 kW).				