

Technical Specification

Sl.No	BHEL Scope			Bidder Reply
1.	<p>Supply and Installation of Motorized Variac - 28Amps Double coil with Balancing Transformer and MCCB - 250Amps for existing 100kVA, 3 Phase, 415V, 139A, Servo Stabilizer cum Isolation Transformer.</p> <p>Make of Variac: Servo max/ Takhi/ NEEL or equivalent make acceptable by BHEL.</p> <p>Make of MCCB: LT/ Siemens or equivalent make acceptable by BHEL</p>	Qty: 1SET	Bidder to Confirm	
2.	<p>Offered Motorized Variac with balancing transformer circuit should be matching with Main control PCB of existing Stabilizer.</p>	Please Refer Annexure-I	Bidder to Confirm	

3.	Fixing, setting of MCCB and proved out of working of existing servo stabilizer are under scope of vendor.		Bidder to Confirm	
4.	For physical dimension of existing servo stabilizer with isolation transformer	Please Refer Annexure-II & III	Bidder to Note	


GNANA SUBRAMANIAN R

Digitally signed by GNANA SUBRAMANIAN R

Date: 2023.10.18 10:13:21 +05'30'

ANNEXURE-I

MAIN CONTROL PCB

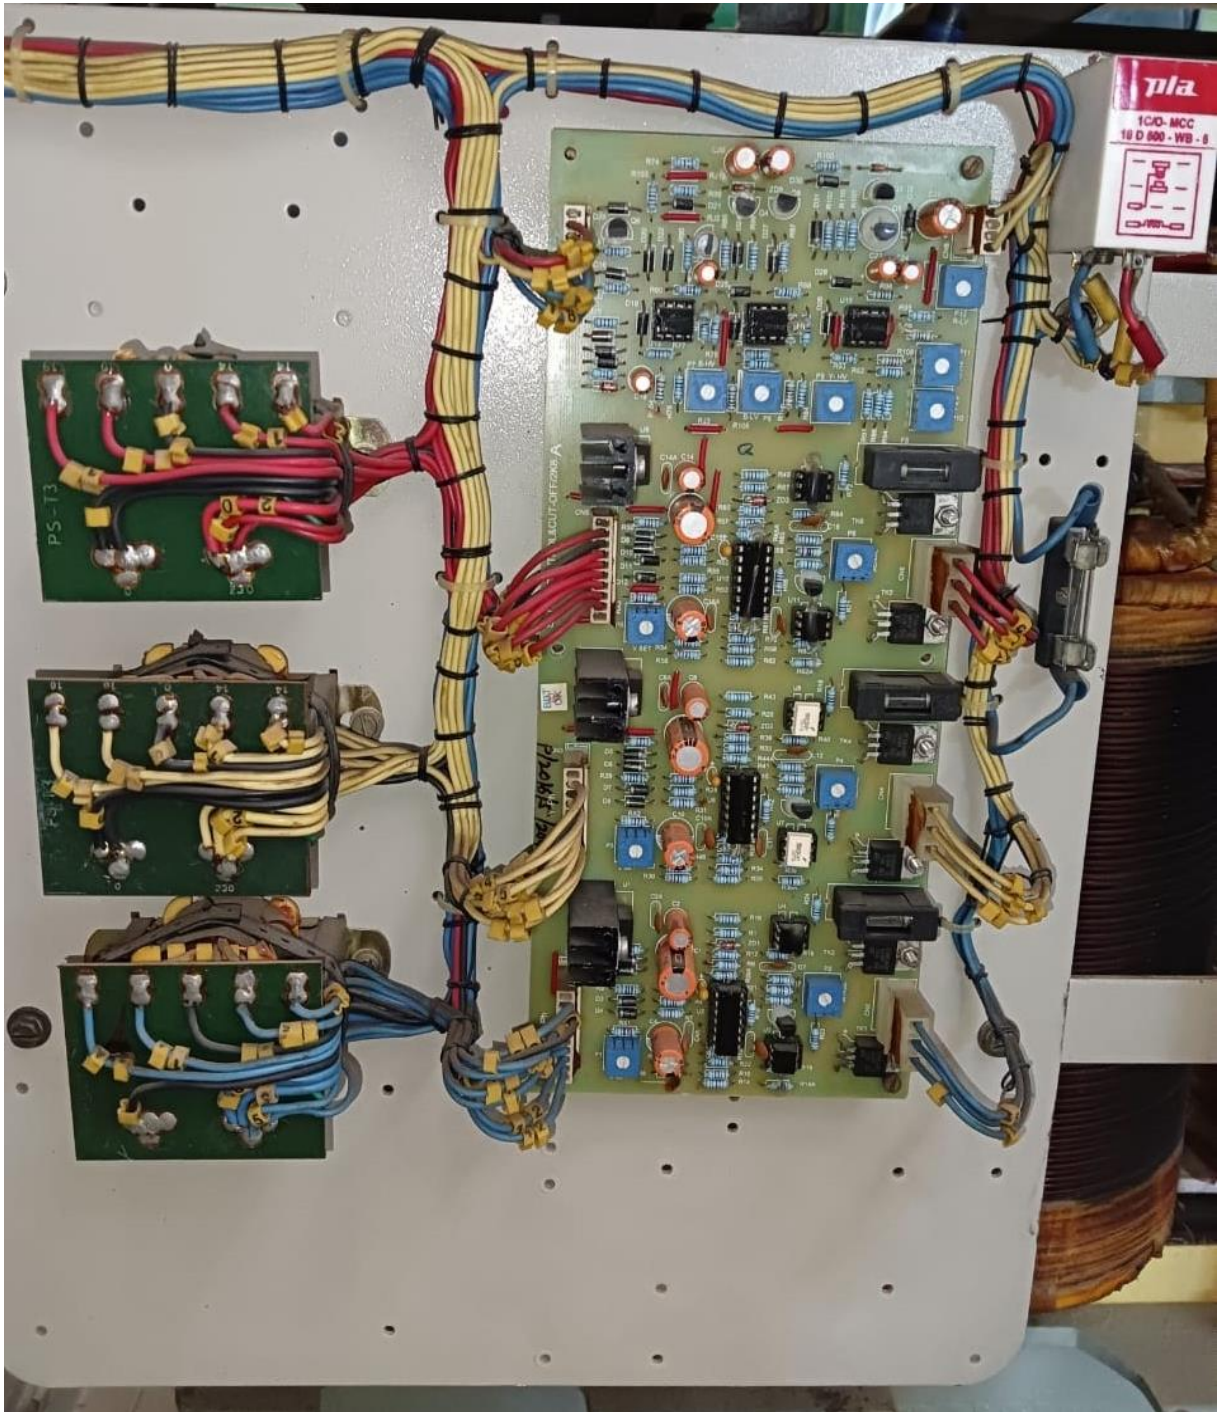


Reference: Part. No: SERVO MAX/2K8A PCB

GNANA SUBRAMANIAN R

Digitally signed by GNANA SUBRAMANIAN R
Date: 2023.10.18 09:56:43 +05'30'

ANNEXURE II
STABILIZER 100KVA
WITH ISOLATION TRANSFORMER

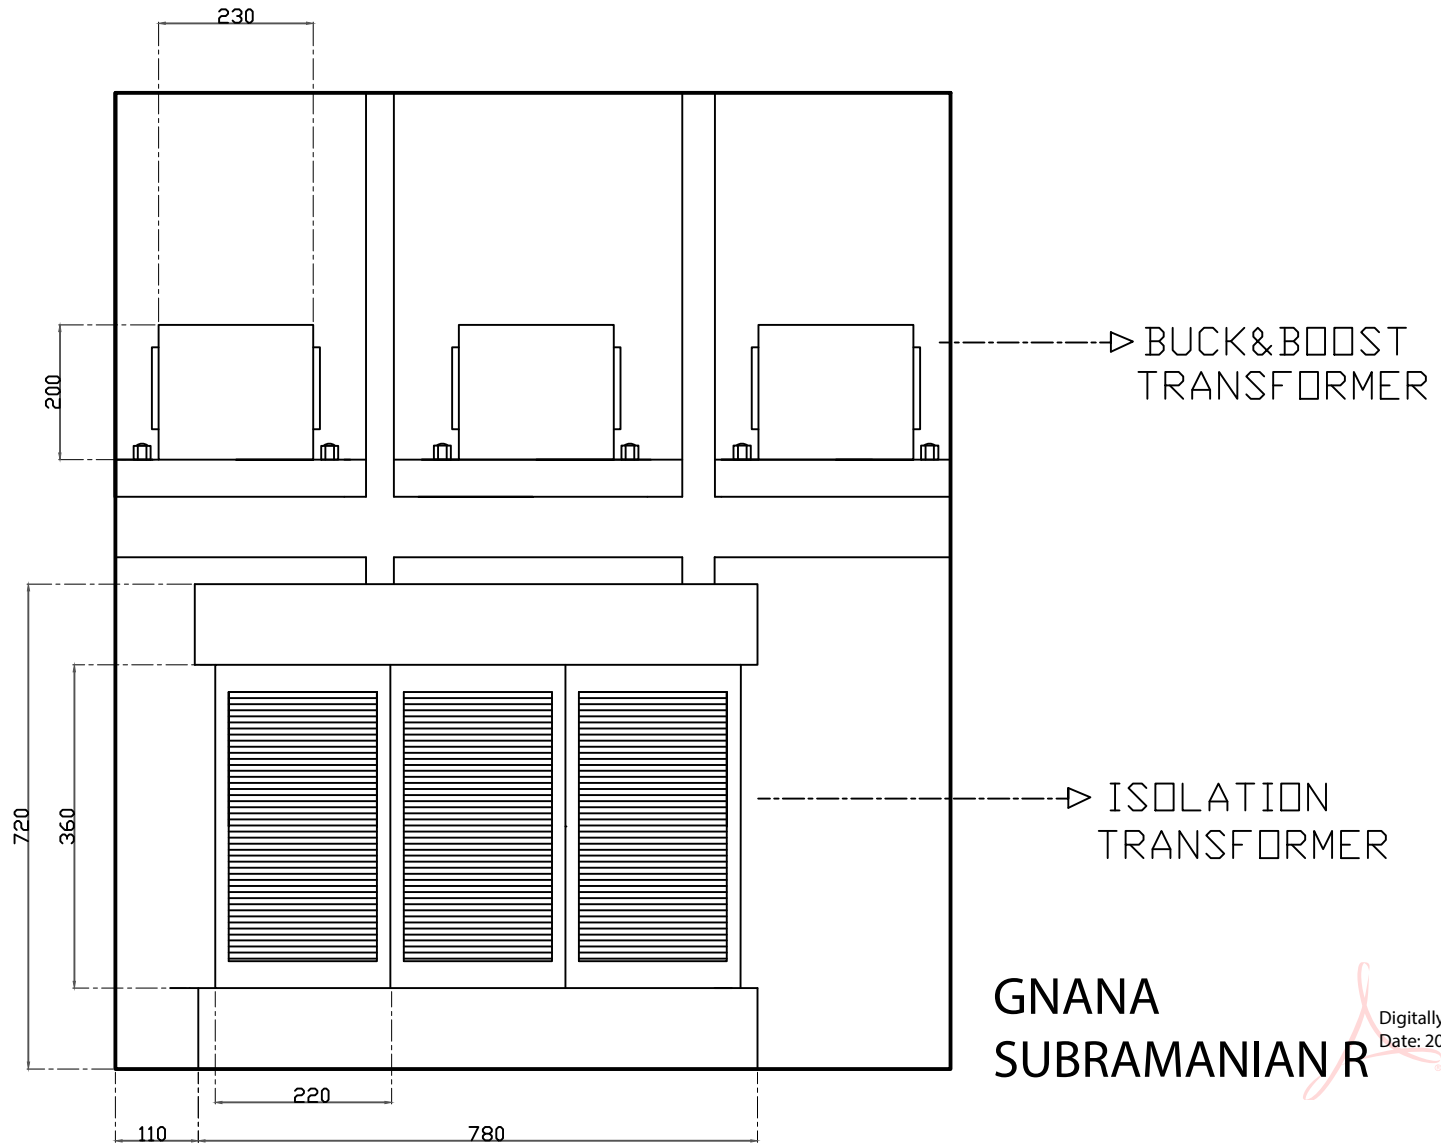


FRONT VIEW

GNANA
SUBRAMANIAN R

Digitally signed by GNANA SUBRAMANIAN R
Date: 2023.10.18 10:02:29 +05'30'

ANNEXURE III

STABILIZER 100KVA
WITH ISOLATION TRANSFORMER

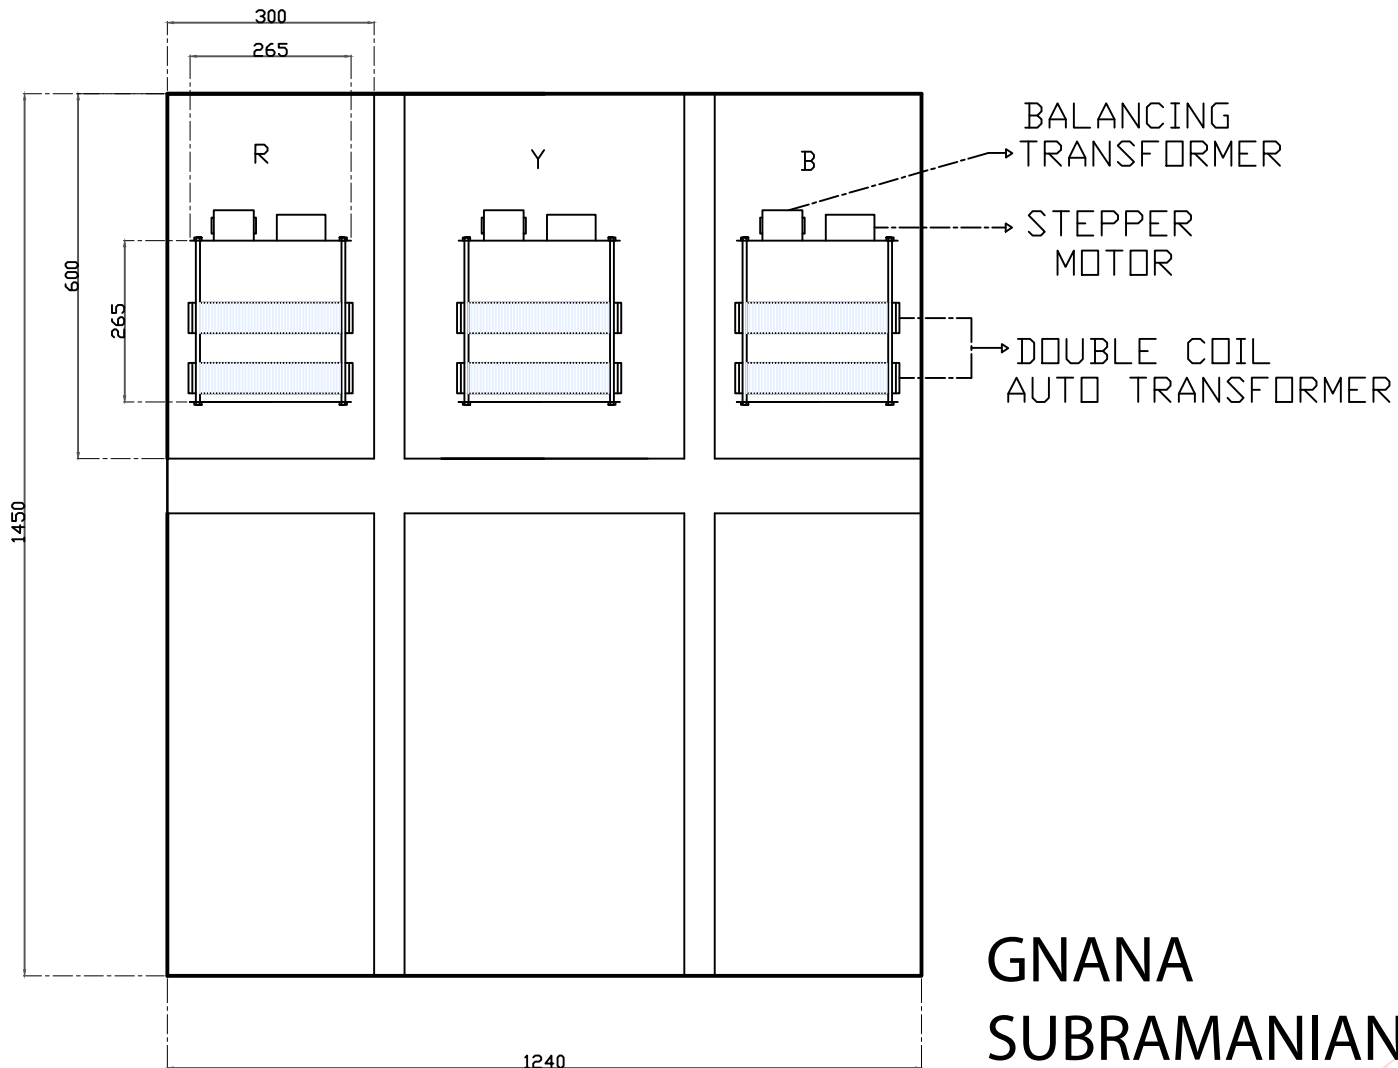

BACK VIEW

ALL DIMENSION ARE IN MM

GNANA

SUBRAMANIAN R

Digitally signed by GNANA
SUBRAMANIAN R

Date: 2023.10.18 10:01:18
+05'30'