

VOLUME: II B & III

**TECHNICAL SPECIFICATION
FOR
EFFLUENT TREATMENT PLANT
&
SEWAGE TREATMENT PLANT**

SPECIFICATION NO.: PE-TS-435-164-A001



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA, INDIA**

615965/2021/PS-PEM-MAX



TITLE:

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION:

REV NO: 00

DATE:

CONTENTS
VOLUME-II B & III

VOLUME-II B

SECTION	DESCRIPTION	PAGE NO
SECTION – A	SCOPE OF ENQUIRY	1
SECTION – B	PROJECT INFORMATION	3
SECTION – C	SPECIFIC TECHNICAL REQUIREMENTS	7
SECTION – C1	SPECIFIC TECHNICAL REQUIREMENTS (MECHANICAL)	8
	➤ FUNCTIONAL GUARANTEE FOR ETP [TABLE-1A]	13
	➤ FEED WATER ANALYSIS FOR ETP [TABLE-1B]	14
	➤ FUNCTIONAL GUARANTEE FOR STP [TABLE-1C]	20
	➤ FEED WATER ANALYSIS FOR STP [TABLE-1D]	20
	➤ SUB VENDORS LIST [TABLE-2]	21
	➤ DRAWING DOCUMENTS SUBMISSION PROCEDURE [TABLE-3]	34
	➤ LIST OF MANDATORY SPARES FOR ETP [TABLE-4A].	35
	➤ LIST OF MANDATORY SPARES FOR STP [TABLE-4B].	36
	➤ PAINTING SPECIFICATION	37
	➤ QUALITY PLAN	68
	➤ DATA SHEET – A FOR ETP	70
	➤ DATA SHEET – A FOR STP	77
SECTION – C2	SPECIFIC TECHNICAL REQUIREMENTS (ELECTRICAL)	85
	➤ ELECTRICAL EQUIPMENT SPECIFICATION	86
	➤ ELECTRICAL LOAD DATA FORMAT	89
	➤ ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR	91
SECTION – C3	SPECIFIC TECHNICAL REQUIREMENTS (CONTROL & INSTRUMENTATION) FOR ETP	94
	➤ SPECIFIC TECHNICAL REQUIREMENTS (CONTROL & INSTRUMENTATION) FOR STP	99
DRAWINGS (PART OF SECTION-C)	➤ P&ID (PE-DG-435-164-A001) FOR ETP	105
	➤ P&ID (PE-DG-435-673-A001) FOR STP	107
	➤ KEY PLAN	109
SECTION – D	GENERAL TECHNICAL REQUIREMENT	111
SECTION – D1	➤ GENERAL TECHNICAL REQUIREMENT (MECHANICAL) FOR ETP	112
	➤ GENERAL TECHNICAL REQUIREMENT (MECHANICAL) FOR STP	116
	➤ PUMPS AND PIPE SELECTION CRITERIA	119
SECTION – D2	GENERAL TECHNICAL REQUIREMENT (ELECTRICAL)	120
	➤ DATA SHEET A – MOTORS	135
	➤ DATA SHEET C – MOTORS	140
	➤ QUALITY PLAN (MOTOR)	143
	➤ ELECTRICAL ACTUATOR DETAILS	155
	➤ CABLE SCHEDULE FORMAT	159
SECTION – D3	GENERAL TECHNICAL REQUIREMENT (CONTROL AND INSTRUMENTATION)	163
	➤ DESIGN REQUIREMENT OF C&I	164
	➤ FIELD INSTRUMENT DATA SHEET	174
	➤ MOTORIZED VALVE ACTUATOR DETAILS	220
	➤ INSTRUMENT HOOK UP DIAGRAM	230
	➤ INSTRUMENT ERECTION DETAIL	242
	➤ DCS INTERFACE FOR DRIVE	252
VOLUME-III		
	LIST OF SCHEDULE	256
	➤ MASTER DRAWING LIST FOR ETP	257
	➤ MASTER DRAWING LIST FOR STP	259
	➤ SCHEDULE OF PRE BID CLARIFICATIONS	261
	➤ SCHEDULE OF DEVIATION WITH COST OF WITHDRAWAL	262
	➤ COMPLIANCE CUM CONFIRMATION SCHEDULE	264
	➤ SCHEDULE OF DECLARATION	265

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: A

REV NO: 00

DATE:

SECTION – A
SCOPE OF ENQUIRY



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: A

REV NO: 00

DATE:

1. SCOPE OF INQUIRY/ INTENT OF SPECIFICATION

- 1.1 The specification is intended to cover design, engineering, manufacture, fabrication, assembly, inspection and testing at vendor's & sub-vendor's works, painting, **Mandatory spares** along with spares for erection and commissioning, startup and commissioning as required, forwarding, proper packing, shipment and delivery at site, unloading, handling & transportation at site, Erection & Commissioning, trial run, on FOR site basis, preparation & submission of "As Built" drawings, PG test at site and handing over of **Effluent Treatment Plant (ETP) and Sewage Treatment Plant (STP)** as per the details in different sections / volumes of this specification for **2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1**.
- 1.2 The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve them of the responsibility of providing such facilities to complete the supply, erection and commissioning of **Effluent Treatment Plant (ETP) and Sewage Treatment Plant (STP)**.
- 1.3 It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to high standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgment is not in full accordance herewith.
- 1.4 The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing.
- 1.5 The general terms and conditions, instructions to tenderer and other attachment referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification are subject to compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.
- 1.6 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under Vol-III of the specification. In absence of any such clarifications, in case of any contradictory requirement, the more stringent requirement as per interpretation of BHEL/Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by BHEL/ Customer as and when brought to their notice either by the bidder or by BHEL/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.
- 1.7 Deviations, if any, should be very clearly brought out clause by clause in the enclosed schedule; otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.
- 1.8 In case all above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.
- 1.9 Unless specified otherwise, all through the specification, the word contractor shall have same meaning as successful bidder/vendor and Customer/Purchaser/Employer will mean BHEL and/or Customer including their consultant as interpreted by BHEL in the relevant context. Bidder to refer GCC/SCC for more clarity.
- 1.10 The equipment covered under this specification shall not be dispatched unless the same have been finally inspected, accepted and dispatch release issued by BHEL/Customer.
- 1.11 BHEL's/Customer's representative shall be given full access to the shop in which the equipments are being manufactured or tested and all test records shall be made available to him.
- 1.12 The effluent treatment Plant (ETP) and Sewage Treatment Plant (STP) shall fully comply to meet all the requirements and limits specified in Environmental (Protection) Rules, 1986 along with all latest amendments, Requirements and stipulations of Central pollution control Board (CPCB), Ministry of Environment & Forests (MOEF), State Pollution Control Board (SPCB) and any other central or local statutory requirements regarding environmental pollution and its abatement.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: B

REV NO: 00

DATE:

**SECTION – B
PROJECT INFORMATION**

1.0.0 SITE CONDITION

1.1.0 Location and existing Infrastructure

The plant location details are as follows:

Country	: India
State	: Tamil Nadu
Administrative district	: Thoothukudi
Next big cities to site	: Thoothukudi (approx.45 kms from site)
Road access	: East Coast Road – State high way (176)
Nearest Railway Station	: Thiruchendur (approx.12 kms from site)
Nearest Airport	: Vagaikulam (approx.60 kms from site)
Nearest Harbour	: Tuticorin (approx.45 kms from site)

The proposed power project will be located at Udangudi in Tamil Nadu. The proposed power project site is located at about 45km South of Thoothukudi. The proposed marine facilities for the power project will be built on the coast adjoining the power project. The site is accessible by well developed roads.

The town of Tuticorin has all infrastructural facilities and has number of Industries. Tuticorin is well connected by both state highways, National highways and has direct rail link with State Capital Chennai.

1.1.1 Soil Profile

A Preliminary soil investigation report and topographical survey has been carried out by Owner. The results are furnished in a separate annexure.

The Detailed geotechnical Investigation and Setting out survey will be performed by the EPC contractor, and will be the basis for the detailed engineering for the project. The geotechnical report shall contain recommendations for foundation design during detailed engineering.

1.1.2 Seismic intensity

Seismic Intensity	: As per IS : 1893 Latest
Zone	: II
Intensity	: As per IS:1893-Latest

1.1.3 Tide Levels

The recorded tide levels with respect to the Chart Datum (CD) near the identified intake point are as follows:

Mean high water-Spring	CD + 0.99 m
Mean high Water-Neap	CD + 0.71 m
Mean low Water-Neap	CD + 0.55 m
Mean low water-Spring	CD + 0.29m
Mean sea level	CD + 0.64 m
Highest High Tide Level	CD+ 1.026 m
Lowest Low Tide Level	CD + 0.110 m

1.2.0 Meteorological conditions

Ambient Air Temperature

Maximum dry bulb temperature : 41 °C

Minimum dry bulb temperature : 17 °C

Relative humidity

Mean Maximum humidity (Summer) : 84%

Mean Minimum humidity (Summer) : 62%

Maximum humidity (Monsoon) : 97%

Minimum humidity (Monsoon) : 45%

Rainfall

Annual rainfall (Maximum) : 718.2 mm

Annual Rain fall (Minimum) : 384.1 mm

Twenty four (24) Hour max : 138.2 mm

High Flood Level

High Flood Level for site : RL 2.450 m

Wind

Mean Wind Speed (max) : 20.6 km/h

Wind direction : North, North East, North West, East

The details given are arbitrary and may vary. The contractor should collect the actual data from the Meteorological Department pertaining to the site location and design the plant accordingly.

Meteorological data corresponding to Tuticorin observatory station shall be adopted. These data can be collected from Regional Meteorological Centre, India Meteorological Dept, 50, College Road, Chennai – 600 006.

1.3.0 Design Requirements related to site conditions

1.3.1 Design Ambient Data

Rainfall data:

The maximum rainfall in a year to be considered for design is 718.2 mm. 24 hours maximum to be considered is 138.2 mm. Area drainage study as required is in Contractor's scope of work.

Wind data

Wind loads to be considered for design of structures shall be based on the design wind speeds arrived at based on IS : 875 (Part -3) – Latest Edition. The parameters for calculation of design wind speed as per IS : 875 (Part -3) – Latest Edition are elaborated under Volume II, Section 5 of Detailed Technical Specification - Civil.

1.3.2 Seismic Data

Seismic loads to be considered for design of structures shall be as per as per IS : 1893. Seismic design criteria are elaborated under Volume - II, Section 5 of Detailed Technical Specification- Civil.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SECTION: C

TECHNICAL SPECIFICATIONS

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SECTION – C1

**(SPECIFIC TECHNICAL REQUIREMENTS FOR MECHANICAL)
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]**



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

**SPECIFIC TECHNICAL REQUIREMENTS FOR MECHANICAL
FOR EFFLUENT TREATMENT PLANT (ETP)**



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

1.0 GENERAL

The Effluent Treatment Plant and associated accessories shall conform to the technical specification.

2.0 SCOPE OF SUPPLY FOR EFFLUENT TREATMENT PLANT:

Broad scope of work of this package includes all equipment and accessories and shall be as per the following (please refer P&ID: PE-DG-435-164-A001). Please also refer Electrical (Section-C2) and C&I (Section-C3) for respective scopes.

- Entire Effluent Treatment Plant as per P&ID (PE-DG-435-164-A001) and Data Sheet-A.
- Two numbers TG Area Oily Waste Transfer Pumps for Unit-1 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers TG Area Oily Waste Transfer Pumps for Unit-2 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Transformer Area Oily Waste Transfer Pumps for Unit-1 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Transformer Area Oily Waste Transfer Pumps for Unit-2 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Fuel Oil OWS Waste Transfer Pumps with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Coal Mill Waste Transfer Pumps for Sump-1 for Unit-1 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Coal Mill Waste Transfer Pumps for Sump-2 for Unit-1 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Coal Mill Waste Transfer Pumps for Sump-1 for Unit-2 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Coal Mill Waste Transfer Pumps for Sump-2 for Unit-2 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Boiler Area Floor Wash Pit Transfer Pumps for Unit-1 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Boiler Area Floor Wash Pit Transfer Pumps for Unit-2 with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers OWS Feed Pumps with instrumentation, piping, fittings, Valves, Motors and other accessories.
- One number Oil Water Separator (OWS) with skimmer and accessories.
- Two numbers slop oil tank with accessories.
- Two numbers Tube Settler Feed Pumps with instrumentation, piping, fittings, Valves, Motors and other accessories.
- One number Flash Mixer with motor, reduction gear and other accessories.
- One number Flocculation Tank with accessories.
- One number Tube Settler with accessories.
- Two numbers Sludge Transfer Pumps with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Air blower for Sludge Collection Pit with accessories.
- PE Dosing Systems including PE Dosing tanks two numbers and PE dosing pumps two numbers with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Lime Dosing Systems including Lime Dosing tanks two numbers and Lime dosing pumps two numbers with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Alum Dosing Systems including Alum Dosing tanks two numbers and Alum dosing pumps two numbers with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Effluent Transfer Pump-1 for CHP Dust Suppression/Horticulture with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Two numbers Effluent Transfer Pump-2 for CW Blowdown Line with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Acid Dosing Systems including Acid dosing tank one number and Acid dosing pumps two numbers with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Alkali Dosing Systems including Alkali dosing tank one number and Alkali dosing pumps two numbers with instrumentation, piping, fittings, Valves, Motors and other accessories.
- Electrical motors for pumps, blower, agitator, etc as per requirement.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

- Safety equipment as indicated elsewhere in this technical specification.
- Chain pulley block (2 Nos each of 1 Ton Capacity) and Electrical hoist (2 Nos each of 2 Ton Capacity) with monorail for handling equipment.
- Electric hoist with monorail and weighing scale (1 No each of 1 Ton Capacity) with accessories in chemical house for chemical handling.
- All tanks and vessels complete with inlet and outlet connections, bed support cum under drain system, inlets water distributors, all fittings and appurtenances etc. as specified and as required.
- Inlet and outlet pipes for each equipment tanks with pipe connections to the respective equipment.
- Necessary pipe and piping inside and outside the Effluent Treatment Plant as specified elsewhere.
- All necessary valves (manual and actuated), actuators and fittings for the installations with the actuators necessary for their remote operation.
- All necessary drains, vents and sampling points, with valves, as specified and as required.
- Hangers and supports as per the requirement.
- All pipes, fittings etc as required, hand railing, mono rail for hoist and chain pulley block, platforms and ladders shall be in the scope of bidder. All insert plates, embedded plates, rung ladder, nuts and bolts, and matching counter flanges wherever applicable.
- Instrumentation (minimum) as per the enclosed P&ID (PE-DG-435-164-A001) and as per system requirement with accessories.
- All necessary structural steel for pipe supporting structure, platforms, walkways / pathways and access stairs, mechanical plant and equipment, mechanical services and pipe work associated with Effluent Treatment Plant.
- Start-up and commissioning spares as required.
- Mandatory spares as indicated in Technical Specification (PE-TS-435-164-A001).
- All special tools necessary for proper maintenance or adjustment of the equipment packed in permanent box.
- Finish paints for touch up painting of equipments after erection at site in sealed container.
- Initial charge of all lubricants and grease.
- Monitoring gadgets, instruments and equipments required for monitoring (till PG test and plant handover).
- First fill of all chemical including top up chemicals and all required chemicals for pre-commissioning, commissioning, trial run and PG test+3 months of chemical after successful commissioning at rated capacity are in bidder scope.
- Permanent ladder (not rungs) for approaching the sludge pits/sumps, valves for opening/maintenance purpose.
- All steel inserts with lugs, plates, bolts, nuts, sleeves, edge angles and all other embedding components etc as required to grout in civil works and to support/hold the equipments being supplied under this specification.
- All auxiliary steel structures (U-clamps, nuts, bolts, channels etc.) for fixing the pipe on the pedestal or trestles.
- Arrangement of all instruments/lab facilities at non-returnable basis to carry out trial run/commissioning and PG test is in bidder scope.
- Coating, rapping and protection of buried piping.
- Suitable size and numbers hume pipe for road crossing, (for 100 NB pipe- 20 nos each for 6 meter road crossing, for 80 NB pipe-16 nos).

3.0 SCOPE OF SERVICE FOR EFFLUENT TREATMENT PLANT:

The bidder's scope also includes following services for scope under this specification:

- 1) Erection and Commissioning of Effluent Treatment Plant.
- 2) Arrangement of all instruments and lab facilities to carry out trial run/commissioning and PG test.
- 3) All personnel required during pre - commissioning, commissioning and PG Test.
- 4) Performance testing.
- 5) Painting as per enclosed painting schedule. However, any variation in the painting schedule as finally approved by BHEL/TCE/TANGEDCO shall be taken care by the bidder without any commercial and delivery implication. Color-coding scheme shall be intimated to vendor during detailed engineering.

4.0 TERMINAL POINT FOR EFFLUENT TREATMENT PLANT:

- a. Effluent from respective collection pit to ET plant area, refer P&ID (PE-DG-435-164-A001) for details.
- b. Service water and portable water & Service air and instrument air: At ET Plant boundary at a distance of 20 meter (it may be at any direction, shall be decided during detailed engineering).
- c. Other TP as marked in P&ID (PE-DG-435-164-A001).

Note: Bidder to note that the pipe length indicated in the specification may vary by +/-10% for which no extra claim shall be applicable.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

5.0 EXCLUSIONS FOR EFFLUENT TREATMENT PLANT:

- Service air, Instrument air, upto the terminal point.
- Fire fighting and Ventilation facilities.
- Drinking water and service water.
- Total Civil work is in BHEL Scope of work, however Civil Input drawing shall be provided by bidder.
- Excavation/back filling for underground piping.
- Pipe trestles and pedestals.
- Acid/alkali resistant lining on RCC.

6.0 QP AND SUBVENDOR APPROVAL FOR EFFLUENT TREATMENT PLANT:

- a) Final quality plans and inspection criteria for all the items shall be subject to approval by BHEL/TCE/TANGEDCO during detail engineering. Any additional vendors (not listed in the sub-vendor list as enclosed with Technical Specification-PE-TS-435-164-A001)) shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering without any price/delivery implication.

7.0 DESIGN/CONSTRUCTION FOR EFFLUENT TREATMENT PLANT:

In addition to the requirements of Section-C & D the following shall also be complied under scope of this specification:

The P&ID (PE-DG-435-164-A001) is enclosed herein in this section for bidder's compliance.

The material of construction specified in Data Sheet-A are minimum requirements and material of construction for other components not specified shall be similarly selected by the bidder for intended duty which shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering.

8.0 DRAWING/DOCUMENTS REQUIREMENT (FOR MECHANICAL/ELECTRICAL/C&I/CIVIL/ETC) FOR EFFLUENT TREATMENT PLANT:

After award of LOI, following drawing/documents shall be submitted by the bidder for BHEL/TCE/TANGEDCO approval. However, any additional drawing/document if found necessary for completion of the engineering, the same shall be submitted by bidder without any commercial implication.

- a) Detailed piping and instrument for process and utility, showing all equipments, machinery, piping and instruments. All pipes should be indicated with diameter, pipe class, pipe number, fluid flowing through it as per the Employer's legend to be furnished later.
- b) Detailed configuration drawings, BOMs, Data Sheets, General arrangements and cross-sectional/assembly drags, along with the manufacturer's catalogue for all the items/equipment including control & instrumentation supplied by the bidder.
- c) Detailed installation drawings for all instruments and instrumentation schedule.
- d) Preparation and finalization of functional write-up and detailed logic diagram, for all control system, electrical wiring and schematic drgs for the development of logic diagrams, GA and layout drgs of control panels (as applicable), bill of material for panel drgs and terminal (as applicable), junction boxes, inter connection diagram for cabling, cable schedule, earthing layout and cable tray layout drawings..
- e) Design calculation of process and mechanical design, equipments and systems. The bidder shall show, explain and prove the validity of the basis/procedures and methods used in these calculations.
- f) Details civil scope/assignment drawing for all civil works.
- g) Detailed piping layout drawings, pipe support drawings, complete bill of materials of the piping, valve schedule etc.
- h) Submission of O&M manual.
- i) PG Test procedure shall be submitted by bidder during detail engineering and shall be subject to approval by BHEL/TCE/TANGEDCO.
- j) Against BHEL/TCE/TANGEDCO comments bidder has to give replies point wise during detailed engineering after award of contract.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

9.0 DRAWING/DOCUMENTS REQUIRED ALONG WITH BID FOR EFFLUENT TREATMENT PLANT:

- Deviation/clarification, if any, in the BHEL format.
- Compliance certificate.
- Unpriced schedule and unit price schedule.

10.0 ENVIRONMENTAL STIPULATIONS FOR EFFLUENT TREATMENT PLANT:

The Waste Water Treatment System shall fully comply with all requirements and limits specified in Environmental (Protection) Rules, 1986, along with all latest amendments to it, requirements and stipulations of the Central Pollution Control Board (CPCB), Ministry of Environment and Forests (MOEF); Government of India for the project, and any other central or local statutory requirements regarding environmental pollution and its abatement. As regards cases for which no Indian Standard exists, internationally accepted standards like the World Bank's standard, OSHA standards etc. shall be applicable. The Purchaser will decide such applications.

11.0 FUNCTIONAL GUARANTEES FOR EFFLUENT TREATMENT PLANT:

Following effluent quality (from Central Monitoring Basin) shall be guaranteed: -

FUNCTIONAL GUARANTEES FOR EFFLUENT TREATMENT PLANT (TABLE-1A)	
✓	TSS < 100 ppm
✓	Oil & Grease < 20 ppm
✓	pH < 6.5- 8.5

Note-1: Any item/work either supply of equipment or erection material which have not been specifically mentioned in but are necessary to complete the works for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The bidder without any extra charge shall provide the same.

Note-2: All major drawings/documents/Sub vendors shall be approved by BHEL/TCE/TANGEDCO during detailed engineering. Stage. Successful vendor shall comply with the comment of the BHEL/TCE/TANGEDCO without price & delivery implication.

Note-3: All sump pumps/drives shall be provided with electrically operated monorail hoist for weights weighing 500 kg.

Note-4: Bidder shall perform the guarantee parameters as per the specification requirement to the satisfaction of Owner. The exact modalities of verifying guarantee for the parameters indicated in the specification shall be finally as agreed with the Owner during detailed engineering & mutually agreed.

Note-5: The Bidder shall arrange all the monitoring gadgets / instruments / equipment required for performing guarantee parameters (returnable after PG test). Site facility as available or as extended by Owner shall only be provided.

Note-6: All equipments shall be dimensioned to provide as undisturbed space, free of pipes or similar obstacles of at least 1000 mm between installed equipment and surrounding enclosures or walkway to ensure proper access for maintenance and operation.

Note-7: Wherever pipe racks are not available, pipes shall run on pedestals or below ground. All auxiliary structure & fixing items such as U clamps, nuts, bolts, channels, insert plates etc. required to lay the pipes on pedestals shall be in bidder's scope of work. Wrapping, coating and protection of all the buried pipe is also in bidder's scope.

Note-8: The above Note-1 to 7 shall be applicable for Electrical and C&I also.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

FEED WATER ANALYSIS FOR EFFLEUNT TREATMETN PLANT DESIGN PURPOSE [TABLE-1B]

SI no.	Particulars	Units	Maximum (approx.)
A	TG AREA OILY WASTE (PIT NO E1 AND E2)		
1	TDS	ppm	220
2	TSS	ppm	100
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	200
B	TRANSFORMER AREA OILY WASTE (BURNT OIL) (PIT NO E3 AND E4)		
1	TDS	ppm	220
2	TSS	ppm	100
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	1000
C	FUEL OIL OWS WASTE (FROM FUEL OIL AREA) (PIT NO E5)		
1	TDS	ppm	220
2	TSS	ppm	100
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	1000
D	COAL MILL WASTE (FROM FUEL OIL AREA) (PIT NO E6, E7, E8 AND E9)		
1	TDS	ppm	220
2	TSS	ppm	50
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	NIL
E	BOILER AREA FLOOR WASH (PIT NO E10 AND E11)		
1	TDS	ppm	220
2	TSS	ppm	100
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	NIL
F	REGENERATION WASTE FROM N-PIT (CPU AND DM PLANT) (AT T1)		
1	TDS	ppm	3500
2	TSS	ppm	100
3	PH	--	7.2-8.0
4	Temperature	--	32 Deg C.
5	OIL	PPM	NIL.
F	BWRO REJECT FROM RODM (AT T2)		
1	TDS	ppm	2500
2	TSS	ppm	NIL
3	PH	--	5.0-6.5
4	Temperature	--	32 Deg C.
5	OIL	PPM	NIL.
G	TREATED COAL PILE RUN OFF WATER (AT T3)		
1	TDS	ppm	100
2	TSS	ppm	200
3	PH	--	8-8.4
4	Temperature	--	32 Deg C.
5	OIL	PPM	NIL.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

**SPECIFIC TECHNICAL REQUIREMENTS FOR MECHANICAL
FOR SEWAGE TREATMENT PLANT (STP)**



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

1.0 GENERAL

The Sewage Treatment Plant and associated accessories shall conform to the technical specification.

2.0 SCOPE OF SUPPLY FOR SEWAGE TREATMENT PLANT:

Broad scope of work of this package includes all equipment and accessories and shall be as per the following (please refer P&ID (PE-DG-435-673-A001)). Please also refer Electrical (Section-C2) and C&I (Section-C3) for respective scopes.

- Entire Sewage Treatment Plant as per P&ID (PE-DG-435-673-A001) and Data Sheet-A.
- Two (2) nos. submersible grinding type sewage transfer pumps for sewage sump (S1) complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. submersible grinding type sewage transfer pumps for sewage sump (S2) complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. submersible grinding type sewage transfer pumps for sewage sump (S3) complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. submersible grinding type sewage transfer pumps for sewage sump (S4) complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. submersible grinding type sewage transfer pumps for sewage sump (S5) complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. submersible grinding type sewage transfer pumps for equalization tank complete with all instrumentation, valves, piping, motor, etc.
- Two (2) nos. horizontal centrifugal type pumps for recirculation of activated sludge (RAS Pump) complete with all instrumentation, valves, piping, motor, etc.
- All instrumentation and accessories in equalization tank, MBBR tank, Anoxic tank, Flash mixer, flocculation chamber, Tube settler, Oil & Grease trap, filter feed tank, treated water tank, ACF & PSF, sludge sump and Sodium Hypo chlorite tank & Polyelectrolyte tank etc located in STP area. All instruments and accessories for any other tank in STP area related to Sewage treatment plant shall be in bidder's scope.
- Two (2) nos. oil free type air blowers with electric motor and accessories for supplying air required for sludge sump & equalization tank.
- Two (2) nos. oil free type air blowers with electric motor and accessories for supplying air required for MBBR Tank & Pressure Sand Filter.
- One (1) no. bar screen chamber of each sewage collection sump pits with bars/coarse screen (MOC: **SS-304 fitted with SS 304 frame**) inclined at 60° and spacing between bars shall be 10 mm for screening of incoming sewage shall be provided by bidder.
- One (1) no. oil & grease chamber shall be provided with oil & grease trap, Oil Skimmer, Trolley Mounted Drum for removal of oil & grease from the incoming sewage shall be provided by bidder. Mechanical items Baffle arrangement and perforated pipes etc. shall be provided by bidder. Also One (1) no. bar screen chamber with bars/coarse screen (MOC: **SS-304 fitted with SS 304 frame**) inclined at 60° and spacing between bars shall be 10 mm for screening of incoming sewage shall be provided by bidder.
- Two (2) nos. vertical submersible grinding type MBBR feed pumps for equalization tank complete with all instrumentation, valves, piping, motor, etc.
- One (1) no. above ground MBBR reactor (Capacity as per process requirement) with accessories.
- One no. above ground tube settler (Lamella Clarifier) with accessories.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

- Two (2) nos. horizontal centrifugal type filter feed pumps for filter feed tank complete with all instrumentation, valves, piping etc. for feeding water to pressure sand filter & activated carbon filter for tertiary treatment.
- One (1) no. Sodium hypochlorite dosing tank with agitator and accessories.
- Two (2) nos. Sodium hypochlorite dosing pumps complete with all instrumentation and accessories, valves, piping, motor, etc with accessories.
- One (1) no. Pressure Sand filter along with filter media, piping, valves, fittings, instrumentation and accessories associated with the same.
- One (1) no. Activated Carbon Filter along with media, carbon trap, piping, valves, fittings, instrumentation and accessories associated with the same.
- Two (2) nos. horizontal centrifugal type treated water disposal pumps for treated water tank complete with all instrumentation, valves, piping etc.
- Two (2) nos. vertical screw type sludge transfer pumps for sludge sump complete with all instrumentation, valves, piping etc.
- Two (2) no. centrifuge with accessories.
- One (1) no. Polyelectrolyte dosing tank with agitator and accessories.
- Two (2) nos. Polyelectrolyte dosing pumps complete with all instrumentation and accessories, valves, piping, motor, etc with accessories.
- Media, bar screen chamber, oil & grease trap, media for MBBR tank, media for Tube settler, media for Pressure sand filter, media for activated carbon filter & air grid arrangement for common collection sump, equalization tank, MBBR tank & Sludge pit.
- One (1) No. safety shower along instrumentation and accessories as per P&ID of sewage treatment plant.
- 2 no. sludge handling trolley for manual disposal of sludge cake.
- Necessary piping, valves, fitting, instruments etc. as per P&ID for sewage treatment plant enclosed with this technical specification.
- **For Sewage treatment plant, required/necessary EQMS instruments and its panel (not limited to, but including analysers for pH, BOD, COD, conductivity, oil in water, TM) shall be provided by bidder** with provision for bidirectional connectivity over ModBus/RS-232/RS-485 or any other (shall be informed to successful bidder) with Employer's central cloud server/EQMS for real time data monitoring, remote diagnostics & remote calibration checks, etc. All necessary hardware and software required at instrument end shall be provided by the Bidder. The finally treated sewage shall meet the norms of environment protection rules 1986 and its amendments and the rules of State Pollution Control Board.
- Electrical motors for pumps, blower, agitator, etc as per requirement.
- Safety equipment as indicated elsewhere in this technical specification.
- Chain pulley block (2 Nos each of 1 Ton Capacity) and Electrical hoist (2 Nos each of 2 Ton Capacity) with monorail for handling equipment.
- All tanks and vessels complete with inlet and outlet connections, bed support cum under drain system, inlets water distributors, all fittings and appurtenances etc. as specified and as required.
- Inlet and outlet pipes for each equipment tanks with pipe connections to the respective equipment.
- Necessary pipe and piping inside and outside the Effluent Treatment Plant as specified elsewhere.
- All necessary valves (manual and actuated), actuators and fittings for the installations with the actuators necessary for their remote operation.
- All necessary drains, vents and sampling points, with valves, as specified and as required.
- Hangers and supports as per the requirement.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

- All pipes, fittings etc as required, hand railing, mono rail for hoist and chain pulley block, platforms and ladders shall be in the scope of bidder. All insert plates, embedded plates, rung ladder, nuts and bolts, and matching counter flanges wherever applicable.
- Instrumentation (minimum) as per the enclosed P&ID (PE-DG-435-673-A001) and as per system requirement with accessories.
- All necessary structural steel for pipe supporting structure, platforms, walkways / pathways and access stairs, mechanical plant and equipment, mechanical services and pipe work associated with Sewage Treatment Plant.
- Start-up and commissioning spares as required.
- Mandatory spares as indicated in Technical Specification (PE-TS-435-164-A001).
- All special tools necessary for proper maintenance or adjustment of the equipment packed in permanent box.
- Finish paints for touch up painting of equipments after erection at site in sealed container.
- Initial charge of all lubricants and grease.
- Monitoring gadgets, instruments and equipments required for monitoring (till PG test and plant handover).
- First fill of all chemical including top up chemicals and all required chemicals for pre-commissioning, commissioning, trial run and PG test+3 months of chemical after successful commissioning at rated capacity are in bidder scope.
- Permanent ladder (not rungs) for approaching the sludge pits/sumps, valves for opening/maintenance purpose.
- All steel inserts with lugs, plates, bolts, nuts, sleeves, edge angles and all other embedding components etc as required to grout in civil works and to support/hold the equipments being supplied under this specification.
- All auxiliary steel structures (U-clamps, nuts, bolts, channels etc.) for fixing the pipe on the pedestal or trestles.
- Arrangement of all instruments/lab facilities at non-returnable basis to carry out trial run/commissioning and PG test is in bidder scope.
- Coating, rapping and protection of buried piping.
- Suitable size and numbers hume pipe for road crossing, (for 100 NB pipe- 20 nos each for 6 meter road crossing, for 80 NB pipe-16 nos).

3.0 SCOPE OF SERVICE FOR SEWAGE TREATMENT PLANT:

The bidder's scope also includes following services for scope under this specification:

- 1) Erection and Commissioning of Sewage Treatment Plant.
- 2) Arrangement of all instruments and lab facilities to carry out trial run/commissioning and PG test.
- 3) All personnel required during pre - commissioning, commissioning and PG Test.
- 4) Performance testing.
- 5) Painting as per enclosed painting schedule. However, any variation in the painting schedule as finally approved by BHEL/TCE/TANGEDCO shall be taken care by the bidder without any commercial and delivery implication. Color-coding scheme shall be intimated to vendor during detailed engineering.

4.0 TERMINAL POINT FOR SEWAGE TREATMENT PLANT:

- a. Sewage from respective collection pit to Sewage Treatment plant area, refer P&ID (PE-DG-435-673-A001) for details.
- b. Service water and portable water & Service air and instrument air: At Sewage Treatment Plant boundary at a distance of 20 meter (it may be at any direction, shall be decided during detailed engineering).
- c. Piping from treated water disposal pumps up to horticulture network 500 meters shall be in bidder's scope.
- d. Other TP as marked in P&ID (PE-DG-435-673-A001).
- e.

Note: Bidder to note that the pipe length indicated in the specification may vary by +/-10% for which no extra claim shall be applicable.

5.0 EXCLUSIONS FOR SEWAGE TREATMENT PLANT:

- Service air, Instrument air, upto the terminal point.
- Fire fighting and Ventilation facilities.
- Drinking water and service water.
- Total Civil work is in BHEL Scope of work, however Civil Input drawing shall be provided by bidder.
- Excavation/back filling for underground piping.
- Pipe trestles and pedestals.
- Acid/alkali resistant lining on RCC.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

6.0 QP AND SUBVENDOR APPROVAL FOR SEWAGE TREATMENT PLANT:

- b) Final quality plans and inspection criteria for all the items shall be subject to approval by BHEL/TCE/TANGEDCO during detail engineering. Any additional vendors (not listed in the sub-vendor list as enclosed with Technical Specification-PE-TS-435-164-A001)) shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering without any price/delivery implication.

7.0 DESIGN/CONSTRUCTION FOR SEWAGE TREATMENT PLANT:

In addition to the requirements of Section-C & D the following shall also be complied under scope of this specification:

The P&ID (PE-DG-435-673-A001) is enclosed herein in this section for bidder's compliance.

The material of construction specified in Data Sheet-A are minimum requirements and material of construction for other components not specified shall be similarly selected by the bidder for intended duty which shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering.

8.0 DRAWING/DOCUEMNTS REQUIREMENT (FOR MECHANICAL/ELECTRICAL/C&I/CIVIL/ETC) FOR SEWAGE TREATMENT PLANT:

After award of LOI, following drawing/documents shall be submitted by the bidder for BHEL/TCE/TANGEDCO approval. However, any additional drawing/document if found necessary for completion of the engineering, the same shall be submitted by bidder without any commercial implication.

- k) Detailed piping and instrument for process and utility, showing all equipments, machinery, piping and instruments. All pipes should be indicated with diameter, pipe class, pipe number, fluid flowing through it as per the Employer's legend to be furnished later.
- l) Detailed configuration drawings, BOMs, Data Sheets, General arrangements and cross-sectional/assembly drags, along with the manufacturer's catalogue for all the items/equipment including control & instrumentation supplied by the bidder.
- m) Detailed installation drawings for all instruments and instrumentation schedule.
- n) Preparation and finalization of functional write-up and detailed logic diagram, for all control system, electrical wiring and schematic drgs for the development of logic diagrams, GA and layout drgs of control panels (as applicable), bill of material for panel drgs and terminal (as applicable), junction boxes, inter connection diagram for cabling, cable schedule, earthing layout and cable tray layout drawings..
- o) Design calculation of process and mechanical design, equipments and systems. The bidder shall show, explain and prove the validity of the basis/procedures and methods used in these calculations.
- p) Details civil scope/assignment drawing for all civil works.
- q) Detailed piping layout drawings, pipe support drawings, complete bill of materials of the piping, valve schedule etc.
- r) Submission of O&M manual.
- s) PG Test procedure shall be submitted by bidder during detail engineering and shall be subject to approval by BHEL/TCE/TANGEDCO.
- t) Against BHEL/TCE/TANGEDCO comments bidder has to give replies point wise during detailed engineering after award of contract.

9.0 DRAWING/DOCUEMNTS REQUIRED ALONG WITH BID FOR SEWAGE TREATMENT PLANT:

- Deviation/clarification, if any, in the BHEL format.
- Compliance certificate.
- Unpriced schedule and unit price schedule.

10.0 ENVIRONMENTAL STIPULATIONS FOR SEWAGE TREATMENT PLANT:

The Waste Water Treatment System shall fully comply with all requirements and limits specified in Environmental (Protection) Rules, 1986, along with all latest amendments to it, requirements and stipulations of the Central Pollution Control Board (CPCB), Ministry of Environment and Forests (MOEF); Government of India for the project, and any other central or local statutory requirements regarding environmental pollution and its abatement. As regards cases for which no Indian Standard exists, internationally accepted standards like the World Bank's standard, OSHA standards etc. shall be applicable. The Purchaser will decide such applications.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

11.0 FUNCTIONAL GUARANTEES FOR SEWAGE TREATMENT PLANT:

Following effluent quality (from outlet of Sewage Treatment plant) shall be guaranteed: -

FUNCTIONAL GUARANTEES FOR EFFLUENT TREATMENT PLANT (TABLE-1C)

✓	pH	:	7.5 – 8.5
✓	BOD	:	Less than or equal to 20 ppm
✓	COD	:	Less than or equal to 100 ppm
✓	Oil & Grease	:	Less than or equal to 5 ppm
✓	Coliform count	:	Less than or equal to 100 MPN / 100 ml
✓	TSS	:	Less than or equal to 20 ppm
✓	NH ₄ -N	:	Less than 5mg/l
✓	N Total	:	Less than 10mg/l
✓	Residual chlorine	:	Not exceeding 0.5 mg/l
✓	Temperature	:	Ambient

Note-1: Any item/work either supply of equipment or erection material which have not been specifically mentioned in but are necessary to complete the works for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The bidder without any extra charge shall provide the same.

Note-2: All major drawings/documents/Sub vendors shall be approved by BHEL/TCE/TANGEDCO during detailed engineering. Stage. Successful vendor shall comply with the comment of the BHEL/TCE/TANGEDCO without price & delivery implication.

Note-3: All sump pumps/drives shall be provided with electrically operated monorail hoist for weights weighing 500 kg.

Note-4: Bidder shall perform the guarantee parameters as per the specification requirement to the satisfaction of Owner. The exact modalities of verifying guarantee for the parameters indicated in the specification shall be finally as agreed with the Owner during detailed engineering & mutually agreed.

Note-5: The Bidder shall arrange all the monitoring gadgets / instruments / equipment required for performing guarantee parameters (returnable after PG test). Site facility as available or as extended by Owner shall only be provided.

Note-6: All equipments shall be dimensioned to provide as undisturbed space, free of pipes or similar obstacles of at least 1000 mm between installed equipment and surrounding enclosures or walkway to ensure proper access for maintenance and operation.

Note-7: Wherever pipe racks are not available, pipes shall run on pedestals or below ground. All auxiliary structure & fixing items such as U clamps, nuts, bolts, channels, insert plates etc. required to lay the pipes on pedestals shall be in bidder's scope of work. Wrapping, coating and protection of all the buried pipe is also in bidder's scope.

Note-8: The above Note-1 to 7 shall be applicable for Electrical and C&I also.

FEED WATER ANALYSIS FOR SEWAGE TREATMENT PLANT DESIGN PURPOSE [TABLE-1D]

Sl no.	Particulars	Units	Maximum (approx.)
1	BOD	ppm	300
2	COD	ppm	600
3	pH	--	7.0-8.0
4	Temperature	--	32 Deg C.
5	OIL & Grease	PPM	50
6	Coliform Count	--	10 ⁶ to 10 ⁷
7	TSS	ppm	300
8	NH ₄ -N	ppm	As actual
9	N Total	ppm	As actual



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SUB VENDORS LIST [TABLE-2]

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
1.	PRESSURE VESSELS	GLOBAL STRUCTURES & COMPOSITE LTD	-	
		JASMINO POLYMERTECH	TALOJA	
		SYSCON ENGINEERS	AMBERNATH	
		S.V. FABRICATORS	NAVI MUMBAI	
		SPARK FABRICATORS / STEELCON	-	
		ANUP ENGINEERING	AHMEDABAD	
		MURTHAL TANKS & VESSELS	SONEPAT	
		TITAN ENGG.	DURGAPUR	
		RISHI INDUSTRIES	BAHALGARH	
		UNIVERSAL HEAT EXCHANGERS	-	
		ATS CHEM	SALEM/HOSUR	
		CHEM PROCESS SYSTEM	SANAND	
		PROGEN	CHENNAI	
		CRYSTAL ENGINEERING	HOSUR	
ISHAN EQUIPMENTS	VADODARA			
2.	ATMOSPHERIC/ STORAGE TANKS	GLOBAL STRUCTURES & COMPOSITE LTD	-	
		JASMINO POLYMERTECH	TALOJA	
		SYSCON ENGINEERS	AMBERNATH	
		S.V. FABRICATORS	NAVI MUMBAI	
		SPARK FABRICATORS / STEELCON	-	
		ANUP ENGINEERING	AHMEDABAD	
		MURTHAL TANKS & VESSELS	SONEPAT	
		TITAN ENGG.	DURGAPUR	
		RISHI INDUSTRIES	BAHALGARH	
		UNIVERSAL HEAT EXCHANGERS	-	
		ATS CHEM	SALEM/HOSUR	
		CHEM PROCESS SYSTEM	SANAND	
		PROGEN	CHENNAI	
		CRYSTAL ENGINEERING	HOSUR	
ISHAN EQUIPMENTS	VADODARA			
3.	RUBBER LINING (AT SHOP)	TEMSEC	KOLKATA	
		RISHI INDUSTRIES	SONEPAT	
		CORI ENGINEERS	CHENNAI	
		POLY RUBBER	MUMBAI	
		INDUSTRIAL LINING	VADODARA	
		ARUL RUBBERS	CHENNAI	
		JASMINO POLYMERTECH	TALOJA	
		WESTERN RUBBER	NAVI MUMBAI	
		ELASTOMER LINNING	AMBERNATH	
		EMKAY RUBBER	MUMBAI	
4.	AIR BLOWERS (TWIN LOBE TYPE)	SWAN PNEUMATIC	NOIDA	
		EVEREST TRANSMISSION	NEW DELHI	
		KAY INTERNATIONAL	NEW DELHI / SONEPAT	
		EVEREST BLOWER	BAHADURGARH	
		KULKARNI POWER TOOLS	KOLHAPUR/ PUNE	
5.	METERING PUMPS	VK PUMPS	NASIK	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		MILTON ROY INDIA	CHENNAI	
		SWELLORE	AHMEDABAD	
		DENCIL PUMP	MUMBAI	
		METACHEM	MUMBAI	
6.	AGITATOR	REMI PEOCESS PLANT & M/C	MUMBAI	
		FIBRE & FIBRE	MUMBAI / SILVASA	
		CEECONS	CHENNAI	
		STANDARD ENGINEERS	MUMBAI	
7.	HORIZONTAL CENTRIFUGAL PUMPS	BEST AND CROMPTON ENGG LTD.	CHENNAI	
		BHARAT PUMPS & COMPRESSORS LTD	ALLAHABAD	
		FLOWMORE LTD.	GURGAON	
		FLOWSERVE INDIA CONTROLS PVT. LTD.	COIMBATORE	
		JYOTI LTD.	VADODARA	
		KIRLOSKAR BROTHERS LTD	PUNE	
		WILO MATHER & PLATT PUMPS PVT. LTD.	PUNE	
		V-FLO PUMPS & SYSTEMS CO. LTD.,	BEIJING-CHINA	
8.	VERTICAL CENTRIFUGAL PUMPS	WPIL LIMITED	KOLKATA	
		BHARAT PUMPS & COMPRESSORS LTD	ALLAHABAD	
		FLOWMORE LTD.	GURGAON	
		FLOWSERVE INDIA CONTROLS PVT. LTD.	COIMBATORE	
		JYOTI LTD.	VADODARA	
		WILO MATHER & PLATT PUMPS PVT. LTD.	PUNE	
9.	SCREW PUMP	SULZER PUMPS INDIA LTD.	THANE	
		WPIL LIMITED	KOLKATA	
		UT PUMP		
10.	HORIZONTAL CENTRIFUGAL PUMPS (RUBBER LINED)	ROTO PUMPS		
		TUSHACO		
		KISHORE PUMPS	PUNE	
11.	NON METALLIC (PP/FRP) HORIZONTAL CENTRIFUGAL PUMPS	SU MOTORS	MUMBAI	
		ENGINEERS COMBINE	THANE	
		ANTICORROSIVE	VALSAD	
12.	MISC. PUMP VERTICAL TURBINE TYPE	LEAK PROOF PUMPS PVT. LTD. (RAJEDIA)	-	
		KBL	PUNE	
		M&P	PUNE	
		WPIL	GHAZIABAD	
		KISHORE PUMPS	PUNE	
13.	BATTERY CHARGER FOR PLC	FLOWMORE	SAHIBABAD	
		AMARA RAJA POWER SYSTEMS LIMITED	TRIPUTI	
		CHHABI ELECTRICALS PVT.LTD.	JALGAON	
		CHLORIDE POWER SYSTEMS & SOLUTIONS LIMITED	KOLKATA	
		DUBAS ENGG PVT LTD	BANGALORE	
		HBL POWER SYSTEMS LTD	HYDERABAD	
		JEMA ENERGY	SPAIN	
		MASS-TECH CONTROLS PVT.LTD.	MUMBAI	
STATCON POWER CONTROLS LTD	NOIDA			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
14.	UNDER BED NOZZLE	JONSONS SCREEN	AUSTRALIA/ IRELAND	
15.	COATING & WRAPPING MATERIAL TAPE	IWL LTD.	CHENNAI	
		MP TAR PRODUCT	BHILAI	
		PORWAL INDUSTRIES	RAIPUR	
		RUSTECH	KOLKATA	
		STP	JAMSHEDPUR	
16.	HEATER	ESCORTS	FARIDABAD	
		RACOLDS	FARIDABAD	
17.	CLARIFIER/ THICKENER MECHANISM	CLEAR WATER	DELHI	
		TRIVENI	NOIDA	
		PBJ ASSOCIATE	PUNE	
18.	CENTRIFUGE	HUMBOLT	-	
		HILLER	-	
19.	CAST IRON GATE/GLV/NRV/SRV	A.V. VALVES LTD	AGRA	
		ATAM VALVES PVT. LTD.	JALANDHAR	
		FLUIDLINE VALVES COMPANY PVT.LTD.	GHAZIABAD	
		G.M. DALUI AND SONS PVT.LTD.	HOWRAH	
		H.SARKER AND COMPANY	HOWRAH	
		LEADER VALVES LTD.	JALANDHAR	
		VENUS PUMPS AND ENGG. WORKS	KOLKATA	
20.	BALL VALVE (MANUAL /PNEUMATIC/ ELECTRIC) CLASS 150	A.V. VALVES LTD	AGRA	
		AKAY INDUSTRIES PVT.LTD.	DHARWAD	
		BELGAUM AQUA VALVES PVT. LTD.	BELGAUN	
		ASIAN INDUSTRIAL VALVES & INSTRUMENTS.	CHENNAI	
		ATAM VALVES PVT. LTD.	JALANDHAR	
		DEMBLA VALVES LTD.	THANE	
		M/S GM ENGINEERING	RAJKOT	
		HAWA VALVES (INDIA) PVT. LTD.	NAVI MUMBAI	
		INTERVALVE (INDIA) LTD.	PUNE	
		LEADER VALVES LTD.	JALANDHAR	
		MICROFINISH VALVES PVT LTD.	HUBLI	
		NILON VALVES PRIVATE LIMITED	AHMEDABAD	
		SURYA VALVES AND INSTRUMENTS MFG CO.	CHENNAI	
		UNIFLOW	CHENNAI	
		VALTECH INDUSTRIES	MUMBAI	
		VAAS AUTOMATION PVT. LTD.	NEW DELHI	
WEIR BDK VALVES- A UNIT OF WEIR INDIA PVT. LTD.	NEW DELHI			
21.	ELECTRIC MOTOR	CROMPTON GREAVES	AHMEDNAGAR	
		LAXMI HYDRAULICS PVT. LTD	BANGALORE / HUBLI*	
		RAJINDRA ELECT INDUSTRIES	FARIDABAD* / BANGALORE	
		GE-POWER		
		BHARAT BIJLEE	MUMBAI	
		SIEMENS	MUMBAI	
		NGEF	BANGALORE	
KIRLOSKAR ELECTRIC CO LTD.				



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		ASEA BROWN BOVERI		
		MARATHON	KOLKATA	
22.	BUTTER-FLY VALVE	ADVANCE VALVES PVT. LTD.	NOIDA	
		TECHNO VALVE	NASHIK	
		FLUIDLINE VALVES COMPANY PVT.LTD.	GHAZIABAD	
		INSTRUMENTATION LTD.	PALAKKAD	
		INTERVALVE (INDIA) LTD.	PUNE	
		R AND D MULTIPLES (METAL CAST) PVT LTD	MUMBAI	
		SURYA VALVES AND INSTRUMENTS MFG CO.	CHENNAI	
		PENTAIR VALVES AND CONTROLS INDIA PRIVATE LIMITED	NAVI MUMBAI	
		UPADHAYA VALVES MANUFACTURERS PRIVATE LIMITED,	KOLKATA	
		VENUS PUMPS AND ENGG. WORKS	KOLKATA	
		WEIR BDK VALVES- A UNIT OF WEIR INDIA PVT. LTD.	NEW DELHI	
23.	DIAPHRAGM VALVE	WEIR BDK	HUBLI	
		TECHNO VALVE	NASHIK	
		CRANE FLOW PROCESS	SATARA	
		PROCON	MUMBAI	
		MAJESTIC VALVES (LABLINE)	-	
		HAWA ENGINEERS	AHMEDABAD	
24.	DUAL PLATE CHECK VALVES	ADVANCE VALVES PVT. LTD.	NOIDA	
		FLUIDLINE VALVES COMPANY PVT.LTD.	GHAZIABAD	
		TECHNO VALVE	NASHIK	
		R AND D MULTIPLES (METAL CAST) PVT LTD	MUMBAI	
		VENUS PUMPS AND ENGG. WORKS	KOLKATA	
25.	Y-TYPE STRAINER	OTOKLIN GLOBAL BUSINESS LIMITED	MUMBAI	
		GRAND PRIX	NEW DELHI	
		JAYPEE	NEW DELHI	
		GREAVES COTTON	MUMBAI	
		MULTITEX FILTRATION ENGINEERS LIMITED,	NEW DELHI / NOIDA	
		FILTRATION ENGINEERS (I) PVT. LTD	MUMBAI	
		FLUIDNYE	-	
		SUNGOV ENGINEERING PVT. LTD.	DELHI	
		GRAND PRIX	FARIDABAD	
		JAYPEE INDUSTRIES PVT. LTD.	DELHI	
BHATIA ENGINEERING CO.	DELHI			
26.	RUBBER FLAP TYPE CHECK VALVES	ASHVIK VALVES	-	
		FLOW WAY VALVES	-	
		TECHNO VALVE	NASHIK	
		BDK	-	
		MAJESTIC VALVES (LABLINE INST)	-	
		ADVANCE VALVES	-	
27.	SOLENOID VALVES	ROTEX	-	
		AVCON	-	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
28.	PRESSURE GAUGE/ DIFFERENTIAL PRESSURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	KOLKATA	
		ASHCROFT INDIA PVT LTD.	GUJARAT	
		BOSE PANDA INSTRUMENTS PVT.LTD.	KOLKATA	
		FORBES MARSHALL (HYD) LTD.	HYDERABAD	
		GAUGE BOURDON INDIA PVT. LTD.	MUMBAI	
		H.GURU INDUSTRIES	KOLKATA	
		H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	BANGALORE	
		BAUMER TECHNOLOGIES INDIA PVT. LTD.	MUMBAI	
29.	CHAIN PULLEY BLOCK	ARMSEL MHE PVT. LTD	BANGALORE	
		CENTURY CRANE ENGINEERS PVT. LTD.	FARIDABAD	
		HERCULES HOISTS LTD.	RAIGAD	
		LIFTING EQUIPMENTS AND ACCESSORIES	DELHI	
		TUOBRO FURGUSON (INDIA) PVT LTD	KOLKATA	
		TRACTEL TIRFOR INDIA PVT. LTD.	FARIDABAD	
		TECHNO INDUSTRIES	AHMEDABAD	
		ARMSEL MHE PVT. LTD	BANGALORE	
		ALPHA SERVICES	BHIWADI	
		CONSOLIDATED HOISTS PVT LTD	PUNE	
		CENTURY CRANE ENGINEERS PVT. LTD.	FARIDABAD	
		EDDY CRANES PVT. LTD.	MUMBAI	
		GRIP ENGINEERS PVT. LTD.,	FARIDABAD,	
		GLOBAL TECHNOLOGIES	HYDERABAD	
		HERCULES HOISTS LTD.	RAIGAD	
		LIFTING EQUIPMENTS AND ACCESSORIES	DELHI	
		MANGLA HOISTS PVT LTD	NEW DELHI	
		MEEKA MACHINERY PVT. LTD.	AHMEDABAD	
		REVA INDUSTRIES LTD.	FARIDABAD	
		ROCKWELL HOISTO CRANES PVT. LTD.	BAHADURGARH	
SAFEX ENERGY PVT. LTD.	AHMEDABAD			
TUOBRO FURGUSON (INDIA) PVT LTD	KOLKATA			
TECHNO INDUSTRIES	AHMEDABAD			
30.	ELECTRIC HOIST	ARMSEL MHE PVT. LTD	BANGALORE	
		ALPHA SERVICES	BHIWADI	
		CONSOLIDATED HOISTS PVT LTD	PUNE	
		CENTURY CRANE ENGINEERS PVT. LTD.	FARIDABAD	
		EDDY CRANES PVT. LTD.	MUMBAI	
		GRIP ENGINEERS PVT. LTD.,	FARIDABAD,	
		GLOBAL TECHNOLOGIES	HYDERABAD	
		HERCULES HOISTS LTD.	RAIGAD	
		LIFTING EQUIPMENTS AND ACCESSORIES	DELHI	
		MANGLA HOISTS PVT LTD	NEW DELHI	
		MEEKA MACHINERY PVT. LTD.	AHMEDABAD	
		REVA INDUSTRIES LTD.	FARIDABAD	
		ROCKWELL HOISTO CRANES PVT. LTD.	BAHADURGARH	
		SAFEX ENERGY PVT. LTD.	AHMEDABAD	
		TUOBRO FURGUSON (INDIA) PVT LTD	KOLKATA	
TECHNO INDUSTRIES	AHMEDABAD			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
31.	CONTROL VALVE	SPX CORPORATION, USA	AHMEDABAD	
		CONTROL COMPONENT INC.	CALIFORNIA	
		DRESSER VALVE INDIA PVT. LTD	COIMBATORE	
		DAUME REGELARMATUREN GMBH,	GERMANY	
		EMERSON PROCESS MANAGEMENT CHENNAI LIMITED	CHENNAI	
		WEIR VALVES & CONTROLS UK LTD.	U.K	
		HOLTER REGELARMATUREN GMBH & CO.KG	GERMANY	
		INSTRUMENTATION LTD.	KERALA	
		KOSO INDIA PRIVATE LIMITED,	NASHIK	
		LESLIE CONTROLS, INC	USA	
		MIL CONTROLS LTD.	KERALA	
		METSO SINGAPORE PTE. LTD.,	SINGAPORE	
		PARCOL S.P.A	ITALY	
		R.K.CONTROL INSTRUMENTS PVT. LTD.	THANE	
		RINGO VALVULAS S.L,	SPAIN	
		SHENJIANG VALVE CO. LTD.	CHINA	
VALVITALIA S.P.A. ,	ITALY			
WALDEMAR PRUSS ARMATURENFABRIK GMBH	GERMANY			
32.	PRESSURE/DP/VACUUM SWITCH	INDFOSS	GHAZIABAD	
		SOR	USA	
		DRESSOR	USA	
		DELTA CONTROL	UK	
		TRAFAG	RANIPET	
		GIC(GAUGES BOURDON)	PANVEL	
		ASHCROFT INDIA PVT LTD.	USA/GERMANY	
		SWITZER	CHENNAI	
33.	TEMPERATURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	KOLKATA	
		ASHCROFT INDIA PVT LTD.	GUJARAT	
		BUDENBERG GUAGE CO.LTD.	UK	
		FORBES MARSHALL (HYD) LTD.	HYDERABAD	
		GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	GOA	
		GOA THERMOSTATIC INSTRUMENTS PVT.LTD.		
		GAUGE BOURDON INDIA PVT. LTD.	MUMBAI	
		H.GURU INDUSTRIES	KOLKATA	
		H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	BANGALORE	
BAUMER TECHNOLOGIES INDIA PVT. LTD.	MUMBAI			
34.	LEVEL GAUGE (F&B, TUBULAR, REFLEX)	SBEM		
		CHEMTROL		
		PUNE TECHTROL		
		SIGMA		
		V AUTOMAT		
		GENERAL INSTRUMENTS		
35.	ROTAMETER	EUREKA INDUSTRIAL EQUIPMENTS PVT.LTD.	PUNE	
		FLOW STAR ENGINEERING PVT. LTD.,	FARIDABAD	
		FLOWTECH INSTRUMENTS SERVICRS	VADODARA	
		INSTRUMENTATION ENGINEERS PVT LTD	TELANGANA	
		SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	NAVI MUMBAI	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
36.	LEVEL SWITCH- CONDUCTIVITY TYPE	BLISS ANAND PVT. LTD.	GURGAON	
		FLOWTECH INSTRUMENTS SERVICRS	VADODARA	
		HI-TECH SYSTEMS & SERVICES LTD.	KOLKATA-	
		LEVCON INSTRUMENTS PVT. LTD.	KOLKATA	
		RAMAN INSTRUMENTS PVT.LTD.	MUMBAI	
		SIGMA INSTRUMENTS CO.	MUMBAI	
		SOR INC.	USA	
		SAPCON INSTRUMENT PVT LTD.	INDORE	
37.	LEVEL SWITCH (ALL TYPES)	V. AUTOMAT & INSTRUMENTS (P) LTD.	NEW DELHI	
		LEVCON		
		CHEMTROLS SAMIL (INDIA) PVT LTD.		
		SWITZER		
		WAAREE (BAUMER INSTRUMENTS)		
38.	MAGNETIC FLOW METER	V AUTOMAT		
		PUNE TECHTROL		
		ABB	-	
		WAAREE (BAUMER INSTRUMENTS)	-	
		EUREKA	-	
		EMERSON	-	
		YOKOGAWA	-	
39.	FLOW ELEMENT - NOZZLE	HACH (POTENSE)	-	
		KROHNE MARSHALL	-	
		HYDROPNEUMATICS PVT. LTD.	GOA	
		INSTRUMENTATION LTD.	PALAKKAD	
		MICRO PRECISION PRODUCTS PVT. LTD.	FARIDABAD	
		MINCO (INDIA) FLOW ELEMENTS PVT. LTD.	GOA	
40.	FLOW ELEMENT - ORIFICE	STAR-MECH CONTROLS (I) PVT.LTD.	PUNE	
		SEIKO FLOW CONTROL GMBH	AUSTRIA	
		FLOW STAR ENGINEERING PVT. LTD.,	FARIDABAD	
		HYDROPNEUMATICS PVT. LTD.	GOA	
		INSTRUMENTATION LTD.	PALAKKAD	
		INSTRUMENTATION ENGINEERS PVT LTD	HYDERABAD	
41.	FLOW TRANSMITTERS (ALL TYPES)	MICRO PRECISION PRODUCTS PVT. LTD.	FARIDABAD	
		MINCO (INDIA) PRIVATE LIMITED	GOA	
		STAR-MECH CONTROLS (I) PVT.LTD.	PUNE	
		E & H	-	
		KHRONE MARSHALL	-	
		EMERSON	-	
42.	LEVEL TRANSMITTERS (ALL TYPES)	ABB	-	
		HONEYWELL	-	
		YOKOGAWA	-	
		EMERSON	-	
		E & H	-	
		ABB	-	
		HONEYWELL	-	
V AUTOMAT	-			
YOKOGAWA	-			
SIEMENS	-			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		KROHNE MARSHALL	-	
43.	PRESSURE TRANSMITTERS (ALL TYPES)	EMERSON	USA/PAWANE	
		LAXONS AUTOMATION	DAMAN	
		YIL	BANGALORE	
		SIEMENS	THANE	
		FUJI	CHINA	
		YOKOGAWA	JAPAN	
		HONEYWELL	USA/PUNE	
44.	TEMPERATURE TRANSMITTERS	EMERSON	-	
		E & H	-	
		ABB	-	
		HONEYWELL	-	
		V AUTOMAT	-	
		YOKOGAWA	-	
		SIEMENS	-	
		FORBES MARSHALL	-	
45.	PH TRANSMITTERS	EMERSON	-	
		YOKOGAWA	-	
		HONEYWELL	-	
		ABB	-	
		HACH	-	
		FORBES MARSHALL	-	
46.	ANALYSERS (ALL TYPES)	ABB	-	
		EMERSON	-	
		YOKOGAWA	-	
		HONEYWELL	-	
		HACH POLYMETRON	-	
		SIEMENS	-	
47.	PROGRAMMABLE LOGIC CONTROLLER	GE INTELLIGENT PLATFORMS PRIVATE LIMITED	BANGALORE	
		HONEYWELL AUTOMATION INDIA LIMITED ,	PUNE	
		ROCKWELL AUTOMATION INDIA LTD	SAHIBABAD	
		SIEMENS LIMITED	MUMBAI	
		SCHNEIDER ELECTRIC INDIA PVT.LTD.	NEW DELHI	
48.	UPS	HITACHI-HIREL	GANDHINAGAR	
		APC	BANGALORE	
		DELTA	GURGAON	
		EMERSON	MUMBAI	
		DB POWER	PUNE	
		APLAB	MUMBAI	
49.	INSTRUMENT FITTINGS	AURA INCORPORATED	NEW DELHI	
		ASTEC VALVES & FITTINGS PVT. LTD.,	MUMBAI	
		ARYA CRAFTS & ENGINEERING PVT. LTD.	MUMBAI	
		COMFIT & VALVE PVT. LTD.	GUJARAT	
		FLUIDFIT ENGINEERS PVT. LTD.	MUMBAI	
		FLUID CONTROLS PVT. LTD.	MUMBAI	
		HP VALVES & FITTINGS INDIA PVT. LTD.	CHENNAI	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		PRECISION ENGINEERING INDUSTRIES	MUMBAI	
		PANAM ENGINEERS,	MUMBAI	
		PERFECT INSTRUMENTATION CONTROL (INDIA) PVT. LTD.	MUMBAI	
		VIKAS INDUSTRIAL PRODUCTS	NOIDA	
50.	JUNCTION BOX	AJMERA INDUSTRIAL & ENGINEERING WORKS	MUMBAI	
		FLEXPRO ELECTRICALS PVT. LTD.		
			GUJARAT	
		K.S.INSTRUMENTS PVT.LTD.	BANGALORE	
		SUCHITRA INDUSTRIES	BANGALORE	
		SHRENIK & COMPANY,	AHMEDABAD	
51.	CABLE GLAND	COMET	-	
		DOWELL	-	
		CHETNA	-	
52.	CABLE LUGS	ELECTRO BILLETS	-	
		COMET	-	
		DOWELL	-	
		CHETNA	-	
53.	MS PLATES	SAIL		
		ESSAR STEEL		
		TISCO		
		RINL		
		JINDAL		
		LLOYD		
		ISPAT		
		INDIAN IRON & STEEL CO. LTD		
54.	CS PIPE (ASTM A 106 GR. B)	INDIAN SEAMLESS METAL TUBES	AHMEDABAD	
		MAHARASHTRA SEAMLESS	RAIGAD	
55.	MS PIPES (IS: 1239 & 3589)	SAIL	ROURKELA	
		JINDAL	GHAZIBAD/HISSAR	
		SURYA ROSHNI	BAHADUR GARH	
		TATA TUBE	JAMSHEDPUR	
		PSL	CHENNAI/VIZAG/KU TCH/DAMAN	
		LALIT PROFILE	THANE	
		SAMSHI PIPES INDUSTRIES	VADODARA	
		MUKUT PIPES	RAJPURA	
		INDUS TUBES	G B NAGAR	
		MANN IND	INDORE	
		SURENDRA ENGG	RAJPURA	
		PRATIBHA PIPES & STRUCTURE PVT LTD	THANE	
		JCO GAS PIPE	CHINDWARA	
		NUKAT TANKS AND VESSELS	TARAPUR	
		DADU PIPES	SIKRANRABAD	
GOOD LUCK TUBES	SIKANDRABAD			
ADVANCE STEEL TUBES	SAHIBABAD			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		BIHAR TUBES	SIKANDRABAD	
		HI TECH PIPES	SIKANDRABAD	
		RATNAMANI	KUTCH/AHMEDABA D/CHHATRAL	
		MAHARASHTRA SEAMLESS	RAIGAD	
		WELSPUN	ANJAR/BHARUCH	
56.	SS PIPES / TUBES	APEX TUBES	BEHROR (ALWAR)	
		RATNAMANI	CHATRAL	
		REMI	TARAPUR	
		PRAKASH STEELAGE	-	
57.	POWER/CONTROL/INSTRUMENT CABLE	CORDS CABLE	BHIWADI	
		RADIANT CABLES	HYDERABAD	
		POLYCAB	DAMAN	
		KEI	BHIWADI	
		NICCO	KOLKATA	
		RAVIN CABLES	PUNE	
		INCAB	PUNE	
		HVPL	FARIDABAD	
		TORRENT CABLE	NADIAD	
		HAVELLS	ALWAR	
		PARAMOUNT	KHUSHKHERA	
		SRI RAM CABLES	BHIWADI	
		THERMOCABLES	HYDERABAD	
		TORRENT CABLE	NADIAD	
		UNIVERSAL CABLES	SATNA	
		GEMSCAB	BHIWADI	
		DELTON	FARIDABAD	
58.	SAFETY SHOWER	UNICARE	-	
		MOHAN INDUSTRIES	-	
		SUPER SAFETY SERVICES	-	
59.	FRP TANKS & FITTINGS	GLOBAL COMPOSITE	-	
		EPP	-	
		DEEPA COMPOSITE	-	
		COROSEAL INDUSTRIES	-	
		CHEMICAL PROCESS & EQUIPMENT PVT LTD	-	
		J.R FIBRE INDUSTRIES PVT LTD	-	
		POLYPLAST	-	
60.	EJECTOR	ESSEM TECHNOLOGIES	-	
		RATNA PRASAD	-	
61.	LOCAL CONTROL PANEL	INDUSTRIAL SWITCHGEAR & CONTROL	-	
		POSITRONICS	-	
		DELTA CONTROL	-	
		L & T	-	
		GE POWER	-	
		PYROTECH	-	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		C& S	-	
62.	TANK (FRP)	INDUSTRIAL SERVICE	KOLKATA	
		SUNRISE	BARODA	
		GANDHI & ASSOCIATES	AHMEDABAD	
		MODERN EQUIPMENTS	CHENNAI	
		EAGLE PLAST	PUNE	
		OMEGA PLAST	MUMBAI	
63.	STROKE CONTROLLER	V K PUMPS	NASIK	
		METACHEM	MUMBAI	
		SWELORE	AHMEDABAD	
		MILTON ROY INDIA	CHENNAI	
64.	SAFETY VALVES/RELIEF VALVES	METACHEM	MUMBAI	
		KEYSTONE	BARODA	
		V K PUMPS	NASIK	
		MILTON ROY	CHENNAI	
65.	DUPLEX STRAINER	JAYPEE INDUSTRIES PVT. LTD.	NEW DELHI	
		MULTITEX FILTRATION ENGINEERS LIMITED,	NEW DELHI	
		OTOKLIN GLOBAL BUSINESS LIMITED	MUMBAI	
		SUNGOV ENGINEERING PVT. LTD.	CHENNAI	
66.	ORIFICE PLATE	MICRO PRECISION	FARIDABAD	
		INSTRUMENTAION LTD	PALGHAT	
		CARLO DYNAMICS	HYDERABAD	
67.	STEEL GATE/GLOBE/NR VALVES	A.V. VALVES LTD	AGRA	
		TECHNO VALVE	NASHIK	
		ATAM VALVES PVT. LTD.	JALANDHAR	
		FLUIDLINE VALVES COMPANY PVT.LTD.	KAUSHAMBI	
		M/S GM ENGINEERING	RAJKOT	
		INTERVALVE (INDIA) LTD.	PUNE	
		LEADER VALVES LTD.	JALANDHAR	
		NITON VALVE INDUSTRIES PVT LTD	MUMBAI	
		NSSL LIMITED.	NAGPUR	
		STEEL STRONG VALVES (I) PVT.LTD.,	NAVI MUMBAI	
		VENUS PUMPS AND ENGG. WORKS	KOLKATA	
		VALTECH INDUSTRIES	MUMBAI	
		V.K. VALVES PVT. LTD.,	JALANDHAR	
WEIR BDK VALVES- A UNIT OF WEIR INDIA PVT. LTD.	NEW DELHI			
68.	SLUICE GATE	H SARKAR	KOLKATA	
		JASH ENGINEERING	-	
		YASHWANT INDUSTRIES	-	
69.	3 WAY VALVE	HI TECH	AHMEDABAD	
		ADVANCE VALVES PVT.LTD	NOIDA	
		BDK	HUBLI	
		TECHNO VALVE	NASHIK	
		FOURESS ENGG.INDIA LTD.	MUMBAI	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		FLUIDLINEVALVES COMPANY PRIVATE LTD.,	MUMBAI	
		INSTRUMENTATION LTD.	PALAKAD	
		KIRLOSKAR BROTHERS LTD.	PUNE	
		VENUS PUMP & ENGG. WORKS	KOLKATA	
		SURYA VALVES AND INSTRUMENTS MANUFACTURING COMPANY	CHENNAI	
		STAFFORD CONTROLS LIMITED	PUNE	
		MICON VALVES (INDIA) PVT.LTD	MUMBAI	
70.	PLUG VALVE(MANUAL)	BDK	HUBLI	
		HAWA ENGINEERS / MARCK & CARE	-	
		MICON VALVES	-	
		TECHNO VALVE	NASHIK	
		MICON VALVES (INDIA) PVT.LTD	MUMBAI	
71.	FITTINGS (CS/SS)	M.S. FITTINGS	KOLKATA	
		RELIANCE FORGE	MUMBAI	
72.	FLANGES (SS/CS)	M.S. FITTINGS	KOLKATA	
		RELIANCE FORGE	MUMBAI	
73.	PIPE & FILLTING (PP,HDPE,PVC & CPVC)	GEROGE FISHCHER	DELHI	
		ASTROL PLYTECHINC LTD	AHMEDABAD	
74.	VALVES (GATE/GLOBE/NRV /BALL)- (PP,HDPE,PVC & CPVC)	GEROGE FISHCHER IPING SYSTEMS PVT LTD	DELHI	
		ASTROL PLYTECHINC LTD	AHMEDABAD	
		ASAHI	-	
75.	AIR FILTER REGULATOR	SHAVO NORGEN	-	
		PLACKA INSTRUMENTS	-	
76.	FILTER MEDIA	GLOBAL ABSORBENT	KOLKATA	
		BHARAT MINERALS		
77.	DC LEAD ACID / NI-CD BATTERIES	AMCO SAFT INDIA LTD	BANGALORE	
		EXIDE INDUSTRIES LTD	NEW DELHI	
		HBL POWER SYSTEMS LTD	HYDERABAD	
		HOPPECKE BATTERIEN GMBH & CO.KG,	GERMANY	
78.	DC LEAD ACID BATTERIES	EXIDE INDUSTRIES LTD	NEW DELHI	
		HBL POWER SYSTEMS LTD	HYDERABAD	
		HOPPECKE BATTERIEN GMBH & CO.KG,	GERMANY	
79.	DC NI CD BATTERIES	AMCO SAFT INDIA LTD	BANGALORE	
		HBL POWER SYSTEMS LTD	HYDERABAD	
		HOPPECKE BATTERIEN GMBH & CO.KG,	GERMANY	
80.	SIGHT FLOW INDICATORS	B.K.EQUIPMENTS PVT.LTD.	CHENNAI	
		BLISS ANAND PVT. LTD.	GURGAON	
		FLOWTECH INSTRUMENTS SERVICRS	VADODARA	
		INSTRUMENTATION ENGINEERS PVT LTD	TELANGANA	
		SIGMA INSTRUMENTS CO.	MUMBAI	
		SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	NAVI MUMBAI	
		TELACE EQUIPMENT PVT.LTD.	CHENNAI	
81.	PAINT	ASIAN PAINTS (I) LTD.		



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

SR. NO.	ITEM	SUPPLIERS	PLACE	REMARKS
		BERGER PAINTS INDIA LTD		
		GOODLASS NEROLAC		
		JENSON & NICHOLSON (I) LTD		
		CDC CARBOLINE (I) LTD.		
		SHALIMAR PAINTS LTD.		
		ADDISON PAINTS LTD		
		GRAND POLYCOAT		
		BOMBAY PAINTS		
		HEMPLE PAINTS (SINGAPORE)		
		JOTUN PAINTS		
82.	PNEUMATIC ACTUATOR	PROCON ENGINEERS	-	
		TYCO	-	
		CRANE PROCESS	-	
		BDK	-	
		INTERVALVE	-	
		BRAY CONTROL	-	
83.	MOTORISED ACTUATOR	ROTARK	-	
		AUMA	-	
		LIMITORK	-	
84.	MBBR	Shall be procured from OEM only and credential shall be submitted during detailed engineering.		

Notes: -

- a) All the finally selected sub vendors shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering without any delivery/ commercial implications to BHEL/ TCE/TANGEDCO.
- b) This vendor list applicable for Mechanical, electrical and C&I items.
- c) **Any other sub vendors not listed in above list, but, required to complete the system shall be subject to BHEL/TCE/TANGEDCO approval during detailed engineering without any delivery/ commercial implications to BHEL/ TCE/TANGEDCO. The same shall be proposed by main vendor during detailed engineering.**



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

DRAWING/DOCUMENT DISTRIBUTION SCHEDULE [TABLE-3]
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

Documents:	PEM-Engineering	CONSULTANT/ CUSTOMER	BHEL SITE OFFICE	CUSTOMER SITE OFFICE
Documents for approval (1 st submission and resubmission)	2+SOFT COPY	6+SOFT COPY	0	0
Documents for information (1 st submission and resubmission)	2+SOFT COPY	6+SOFT COPY	0	0
Schedules, diagrams, lists, tables, calculation, specifications and other documents	2+SOFT COPY	6+SOFT COPY	0	0
Final & as-built drawings				
Final as-built drawings and final approved documents	2+SOFT COPY+2CD	5+SOFT COPY+2CD	6+SOFT COPY+2CD	6+SOFT COPY+2CD
Final O&M manuals	2+SOFT COPY+2CD	5+SOFT COPY+2CD	6+SOFT COPY+2CD	6+SOFT COPY+2CD
Detailed project time schedules	2+SOFT COPY	2+SOFT COPY	2+SOFT COPY	2+SOFT COPY

Note:

- Quantity of prints may change during detailed engineering stage based on BHEL / Customer requirement. However the same will be adhered by the bidder without any delivery/commercial implication to BHEL.
- All the drawing documents along with the O&M manual (of all the revisions) are necessarily to be submitted in soft copies in addition to hard copies.
- Bidder to submit soft copies of all the drawing and document along with quality plans for BHEL review and approval (P&ID in A2 size, Layout (electrical/piping/equipment) in A1/A0, QAP/Data Sheet in A4 size).
- The date of submission of drawing documents shall be considered as the date of submission of hard and soft copies whichever is later.
- All the drawings shall be prepared on computer auto cad and other documents (like datasheet etc.) on MS office software. Bidder not complying to the requirement shall not be considered. For the execution of the contract regular meeting (generally once in 15 days or as per project requirement) is required.
- Bidder has to come for meeting with the concerned dealing persons as per BHEL or customer requirement in a short notice.
- Bidder to submit instrument schedule, cable schedule and valve schedule in MS- Excel format during detailed engineering.
- Bidder to also furnish the auto cad copy / MS-word (as applicable)/MS-Excel (as applicable) of the following documents after award of contract. However, any other auto cad copy/MS-Excel/MS-word of any other document as per the insistence of BHEL / customer will also be submitted by the bidder without any delivery/commercial implication to BHEL.
 - P&IDs.
 - Equipment lay out.
 - Equipment Cable tray layout.
 - Equipment earthing layout.
 - Civil scope drawings.
 - Piping lay out drawing.
 - Valve schedule.
 - Instrument schedule.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

LIST OF MANDATORY SPARES FOR EFFLUENT TREATMENT PLANT [TABLE-4A]

S.no.	Mandatory Spares	Total Quantity
1.0	Spares for Horizontal Centrifugal Pumps for each type and model of pump	
1.1	Bearing	2 Sets.
1.2	Thrust Pads	1 Set.
1.3	Shaft Sleeves	1 Set.
1.4	Fasteners	1 Set for complete one pump assembly.
2.0	Spares for Fuel Oil OWS Waste Transfer pump	
2.1	Bearing or bearing metals and wearing parts for each rotating unit	1 complete set
2.2	Connecting coupling for each rotating units (coupling assembly)	1 set
2.3	Packing and gaskets of total installed	100%
2.4	Inner wear and tear parts for each size and type of pump	1 set
3.0	LT Motors of Each Type and Rating	
3.1	Driving end bearing	1 Set.
3.2	Non Driving end bearing	1 Set.
3.3	Terminal Block for Motors upto 30 kW	10 Nos
3.4	Terminal Block for Motors above 30 kW	5 Nos
3.5	Motor of each type and rating	10% of installed quantity or 1 No which ever is higher.
4.0	Spares for C&I items	
4.1	Electromatic Safety Valves Pressure switches, local PB stations and solenoid valves.	10% or 2 nos. of each type whichever is more.
4.2	Local Indicators like temperature gauges, pressure gauges, differential pressure gauges, flow gauges, flow metres etc.	10% or 2 nos. of each make, model and type whichever is more and for each plant (to be divide to various ranges in proportion to main of all make, model, type population)
4.3	Process Actuated Switch Devices Includes all type of Pressure, differential pressure, flow, temperature, differential temperature, level switch devices.	5% or 1 no, of each type and model whichever is more
4.4	PD Type Flow Transmitters	1 no. of each type and model
4.5	Water Analysers- pH Transmitter Cell Electronic cards	2 nos. or 20% of each type whichever is more 1 no. of each type
4.6	Transmitter Electronic Unit	1 no. of each type model
4.7	Electronic modules for analysers	1 no. for each type
5.0	Electrical actuator, complete assembly, of each rating	2 Nos.
6.0	INSTRUMENTATION CABLE, INTERNET WIRING & ELECTRICAL FIELD (Applicable where main supply is under Effluent Treatment Plant supplier scope).	
6.1	Pre fabricated cable of each type.	10% of installed quantity
6.2	Pre fabricated cable connector of each type	10% or 1 no. of each type and model, whichever is more
6.3	Other cables	5% of each type, pair and size of actual installed quantity

Notes-1: Only applicable items shall be considered. Applicable items are those which are installed in the system.

Notes-2: Wherever quantity has been specified as percentage (%), it shall mean percentage (%) of the total population of the item in the station (project), unless specified otherwise and the fraction will be rounded off to the next higher whole number.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

LIST OF MANDATORY SPARES FOR SEWAGE TREATMENT PLANT [TABLE-4B]

SI No	Equipment	Unit	Qty
1.0	Horizontal centrifugal pump for each type		
a.	Bearings	Set	2
b.	Thrust pads	Set	1
c.	Shaft sleeves	Set	1
d.	Fasteners	Set	1 set reqd for assembling one pump
2.0	Sump pump for each type		
a.	Complete pump assembly with pump, motor, coupling base etc	set	1 set
b.	Impeller with key & nut	set	2 set of each size & type
c.	Oil seal	no	2 nos. of each size
d.	Coupling bolt with bushes	set	2 sets of each type
e.	Pump shaft	no	2 nos. of each size
f.	Shaft sleeve	set	2 sets of each size
g.	Bearing bush	set	2 sets of each size
h.	Set of bearings	set	2 set
i.	Valves	no	2 nos. of each size & type
3.0	LT Motors of each type and rating		
a.	Driving end bearing	Set	1
b.	Non driving end bearing	Set	1
c.	Terminal block for motors up to 30 Kw each rating	Nos.	10
d.	Terminal block for motors above 30 Kw each rating	Nos.	5
e.	Motors of each type & rating	Nos.	10% of installed quantity or 1 –no is higher whichever is higher
4.0	Electric hoists (As Applicable)		
a.	Brake linings	set	2 sets of each type
b.	Brake coil	set	2 sets of each type
c.	Rope guide & rope tightner	No	1no. of each type
d.	Limit switch	set	2sets of each type & size
e.	Gear box / gear set	set	2 sets of each type
f.	Motor / geared motor	No	1no of each type & rating
g.	Drum bearing	set	1set of each type & rating
5.0	CONTROL & INSTRUMENTATION		
a.	Local Indicators like temperature gauges, pressure gauges, differential pressure gauges, flow gauges, flow meters etc.,		10% or 2 no. of each make, model and type whichever is more and for each plant (to be divided to various ranges in proportion to main of all make, model, type population)
b.	Process Actuated Switch Devices Includes all types of Pressure, differential pressure, flow, temperature, differential temperature, level switch Devices		5% or 1 no. of each type and model whichever is more
c.	Water Analysers – pH Transmitter Cell Electronic cards		2 nos. Or 20% of each type whichever is more 1 no. of each type

Notes-1: Only applicable items shall be considered. Applicable items are those which are installed in the system.

Notes-2: Wherever quantity has been specified as percentage (%), it shall mean percentage (%) of the total population of the item in the station (project), unless specified otherwise and the fraction will be rounded off to the next higher whole number.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

PAINING SPECIFICATION

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

CLEANING, PROTECTIVE COATING AND PAINTING

1.0.0 GENERAL

This specification covers the general requirements related to the cleaning protective coating and painting of equipment, components and systems that are covered under main equipment / system specifications for 2x660 MW Supercritical Thermal Power Plant. The components and/or equipment shall be mechanically and /or chemically cleaned during the following stages of the Contract.

- Cleaning in workshop
- Cleaning before painting and/or corrosion protection (application of prime coat)
- Cleaning before erection and during installation.

Cleaning of fabricated component items shall be carried out after fabrication and final heat treatment or welding at manufacturer's works or at site, as appropriate. No paint shall be applied surfaces within 75 mm of field welded connections. These surfaces shall be coated with a consumable preservative and marked.

For cleaning in workshop and before painting, mechanical cleaning by power tool and scrapping with steel wire brushes shall be adopted to clear the surfaces. However, in certain locations where power tool cleaning cannot be carried out, hand scrapping may be permitted with steel wire brushes and/or abrasive paper. Cleaning with solvents shall be resorted to only in such areas where other methods specified above have not achieved the desired results. Cleaning with solvents shall be adopted only after written approval of the Owner / Engineer.

Machined surfaces shall be protected during the cleaning operations.

In the event of the surfaces not being cleaned to the Owner's satisfaction, such parts of the cleaning procedures or agreed alternatives as are deemed necessary to overcome the deficiencies shall be carried out at the supplier's sole expense.

For reclining small areas, hand cleaning by wire brushing may be permitted.

2.0.0 CODES AND STANDARDS

Painting of equipment shall be carried out as per the Codes indicated below and shall conform to the relevant IS Code for the material and workmanship.

The following codes and standards shall be followed for the surface preparation, surface protection and painting works.

IS: 5	Colors for ready mixed paints and enamels.
IS: 101	Methods of test for ready mixed paints and enamels.
IS: 104	Ready mixed paint, brushing, Zinc Chrome, priming.
IS: 158	Ready mixed paint, brushing, bituminous, black, lead free, acid, alkali, water and heat resisting.
IS: 161	Heat resistant paints
IS: 1303	Glossary of terms relating to paints.
IS: 1477	Code of practice for painting of ferrous metals in buildings (Parts I & II).
IS: 2074	Specifications for ready mixed paint, Air drying, red oxide zinc chrome priming.
IS: 2338	Code of practice for finishing of wood and wood based materials: Parts 2 schedules

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

IS: 2339	Aluminum paint for general purposes, in dual container.
IS: 2395	Code of practice for painting of concrete, masonry and plaster surfaces: Part 2 schedules.
IS: 2524	Code of practice for painting of non-ferrous metals in buildings (Parts I & II).
IS: 2932	Specification for enamel, synthetic, exterior (a) undercoating, (b) Finishing
IS: 3140	Code of practice for painting asbestos cement building products.
IS: 6158	Recommended practice for design safeguarding against Embrittlement of hot dip Galvanized Iron & steel products.
IS: 6159	Recommended practice for design & fabrication of Iron & steel products prior to Galvanizing & metal spraying.
IS: 6278	Code of practice for white washing and Color - Washing.
IS: 10221	Code of practice for coating & wrapping of underground mild steel pipelines.
IS: 33	Inorganic pigments and extenders for paints –Methods of sampling & test.
IS: 13183	Aluminum paint, Heat resistant - specifications.
IS: 144	Specification for ready mixed paint brushing, petrol resisting, Air drying for Interior paints of tanks and containers, Red oxide.
IS: 9954	Pictorial surface preparation standards for painting of steel surfaces.
IS: 11883	Specification for Ready Mixed Paint, Air Drying, Red Oxide Priming for metals.
IS: 9404	Color code for identification of pipelines used in the Thermal Power Plants.
IS: 12744	Specification for Ready Mixed Paint, Air Drying, Red Oxide-Zinc Phosphate Priming.
BS: 2015	Glossary of paint selected terms.
BS: 5252	Final coat color.
BS: 7079A1/S1	Specification for rust grades and preparation grades of uncoated substrates after overall removal of previous coating.
BS: 7079A2	Preparations grades of previously coated steel substrates.
BS: 7079GrC	Surface roughness characteristics of blast cleaned steel substrates.
BS: 7079GrD	Methods for surface preparation.
BS-4232	Surface Finish of Blast cleaned steel for painting.
ASTM	American Standard for Testing Material.
ASTM A 780	Standard practice for repair of damaged galvanized coatings.
AWWA	American Water Works Association.
ASA-A-13.1-1981	Scheme for identification of piping system (American National Standard Institution).
DIN	Deutshes Institute for Normung
S1S-055900-1967	Surface preparation standards for painting steel surfaces. (Swedish standard Institution)
SSPC-SP	Preparation Specifications (Steel structures painting council, U.S.A.).
	National Association of Corrosion Engineers, U.S.A. (NACE).

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

3.0.0 SCOPE OF WORK AND GENERAL REQUIREMENTS

This specification covers the surface preparation, method of application and material to be used for all coating of equipment, steel structures and piping. Steel material subjected to surface preparation on shop/site shall have minimum requirements in accordance with Rust Grade B (SSPC/SSPM Volume-2).

Coating materials according to SSPC, EN ISO, ASTM, BIS or DIN standards, shall be used. The paint shall comply with applicable laws, regulations, ordinances etc., of the local authority, state or the nation pertains to the work. The materials shall be matched with each other so that they are compatible. Coatings deviating this specification shall be subject to approval.

Standards of surface preparation and painting shall give a time to first maintenance of minimum 10 years.

The paint to be applied shall be approved by Owner.

All paints & paint material used shall be procured from approved manufacturers. Paint shall be supplied in manufacturers original containers with the description of content, specification No., colour, ref no, date of manufacture, shelf life expiry date & pot life.

The paint manufacturers shall provide coating system data sheet for each coating system to be used containing the following information

- a. Surface preparations
- b. Film thickness (min and max)
- c. Min and max recoating intervals at relevant temperatures
- d. Mixing ratio, thinner details and coating repair systems

The sample for testing the paint being used may be taken by the Owner at any time.

In general Shop fabricated equipment will be delivered to the site coated with a shop applied system or the manufacturer's standard finish in accordance with the requirements of this specification.

For equipment that has received shop prime coat, all touch-up prime coat and additional coats shall be applied in accordance with the coating schedule. It is responsibility of the vendor to ensure compatibility between shop and field applied paint systems.

Necessary precautions shall be provided to all equipment, structures to protect other surfaces from abrasive blasting, coating over spray and spatter. Damage to other surfaces or equipment shall be repaired by the vendor.

The Contractor shall submit the following for review and approval by the Owner:

- a. Manufacturer's recommended paint scheme for the project
- b. Latest published product & instructions for application data,
- c. Procedures for surface preparation and application.
- d. Pre qualification for equipments and blasting materials, product, procedure and personnel qualifications for the paint and painting systems.
- e. Painting repair procedures

Painting records shall contain:

- Equipment/components/location painted
- Date of painting
- Paint details such as specification No, colour, date of manufacture, shelf life, expiry date
- Application equipments

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- Ambient conditions at the time of painting
- Surface temperature
- Drying time between coating, DFT and number of coatings
- Appropriate work plan for painting.

The supply of all necessary equipments, weather protection, and scaffolding for painting to ensure work is carried out in accordance with the specification and agreed programme.

Maintenance of the paint work until completion of the contract, this shall include repair of any damaged areas caused by third party.

Disposal of painting waste resulting from painting, shall comply with applicable laws, regulations, ordinances etc., of the local authority, state or the nation pertains to the work and coating materials.

It is a mandatory requirement that all operatives working to this procedure take full cognizance and implement necessary safety precautions.

4.0.0 CLEANING AT MANUFACTURER'S WORKS

Mechanical cleaning shall preferably be carried out by abrasive blasting. The Owner is prepared to consider alternative methods such as chemical cleaning provided they achieve the necessary surface condition.

In case of chemical cleaning, the detailed procedure for chemical cleaning as well as the system for which chemical cleaning is required shall be submitted by the contractor for Owner's approval. The procedure shall comprise of pre-treatment and acid treatment to achieve cleanliness equivalent to that specified for mechanical cleaning.

Surface condition:

The Metal surfaces shall be clean and free of mil scale, rust, dirt, grease and any other deleterious matter.

Where metal surfaces are to be painted the surface profiles shall conform to the painting specification requirements.

Where this does not apply, surfaces shall have a surface texture not coarser than Grade 80 abrasive paper.

Abrasives:

Abrasives containing silica, silicates or slag residues shall not be used for water/steam side surfaces of plant except for cleaning sand castings, where hydro blasting may be employed.

For austenitic materials only, abrasives containing 98% or more of alumina, Al_2O_3 , shall be used.

Removal of abrasive and debris:

After cleaning, abrasive and debris shall be thoroughly removed for components.

5.0.0 PROTECTION AT MANUFACTURER'S WORKS

As soon as all items have been cleaned and within four hours of the subsequent drying, they shall be given suitable anti-corrosion protection.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

All water, air and steam side surfaces shall be protected by the application of approved water soluble corrosion inhibitors, or vapor phase inhibitors that can be subsequently removed by site water washing or steam blowing.

The gas side of steam generating plant items shall be protected by the application of temporary protective that do not require to be removed before commissioning, but which are removed during initial firing.

The rate of application of volatile corrosion inhibitors shall be at least 10 grams per square meter or 35 grams per cubic metre, whichever is the greater, except for pipes up to 300 mm diameter for which the minimum application rates shall be 5 grams per square metre.

Immediately after the protective treatment has been applied all vessels and pipes shall be suitably sealed off by discs or caps or approved alternatives to prevent ingress from the surroundings. Cylindrical plugs shall not be driven into the ends of pipes. These protective covers shall not be removed until immediately before final connection is made to the associated equipment.

6.0.0 WEATHER CONDITIONS

Painting shall be done only when the surface temperature is above 5°C. Surface temperature must be at least 3°C above dew point to ensure that condensation does not occur on the surface.

Reasonable protection against precipitation and seawater spray shall be exercised for the painting of outdoor parts.

Precautions shall also be taken against solar radiation to ensure that the specified dry film thickness of priming or finish coats is obtained.

Any prime coat exposed to excess humidity, rain, dust etc., before drying, shall be permitted to dry and the damaged area of primer shall be removed and the surface prepared and primed again.

Sheltered or unventilated horizontal surfaces on which dew may collect require more protection, and to achieve this additional top coat of paint shall be applied.

The temperature quoted as "normal" in the "Paint System Tables" refers to the average local climatic conditions.

7.0.0 SURFACE PREPARATION

In preparing any surface to be coated, all loose paint, dirt, grease, rust, scale, weld slag or spatter or any other extraneous material shall be removed and defects repaired, so as to obtain a clean, dry, even surface to receive the priming or finishing coat (s) as called for in the painting schedules. Sharp edges should be rounded, especially when tank linings have to be applied.

All machined surfaces, including flange faces, shall be suitably covered to prevent damage during surface preparation.

All surfaces should be blast cleaned whenever possible.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Surface preparation methods:

Bare steel surfaces should be prepared by one of the methods described below in order of preference and in accordance with Swedish Standard SIS 05 59 00 or Steel Structures Painting Council, SSPC, Vis 1, or DIN 55928, section 4.

The relative humidity level should not be more than 60% & the steel surface temperature at least 3° C above the dew point during dry blast cleaning operations.

a. White metal blast cleaning Sa 3 or SSPC - SP 5

Sa 3 Blast cleaning to bare metal. Mill scale, rust and foreign matter must be removed completely. Subsequently, the surface is cleaned with vacuum cleaner, clean dry compressed air or a clean brush. It must then have a uniform metallic color and correspond in appearance to the prints designated Sa 3.

b. Near white metal blast cleaning Sa 2 1/2 or SSPC - SP 10

Sa 2 1/2. very thorough blast cleaning. Mill scale, rust and foreign matter shall be removed to the extent that the only traces remaining are slight imperfections in the form of spots or stripes. Subsequently, the surface is cleaned with a vacuum cleaner, clean dry compressed air or a clean brush. It must then correspond in appearance to the prints designated Sa 2 1/2.

Mechanical cleaning should only be used when procedures (a) and (b) are not practicable.

c. Near white metal blast cleaning P Sa 2 1/2 DIN 55928

Very thorough blast cleaning. Very adhesive coatings remain. From all other surface mill scale and rust are to be removed to such an extent that the only traces remaining are slight imperfections in the form of spots or stripes. Further treatments see Sub b).

The adhesivity of residual coatings in the transition zone has to be tested even after the application of the primer.

d. Very thorough mechanical scraping and wire brushing St 3

St 3 very thorough scraping and wire-brushing - machine brushing - grinding - etc. are to be preferred. Surface preparation as for St 2. But much more thoroughly. After the removal of dust, the surface must have a pronounced metallic sheen and correspond to the prints designated St. 3.

e. Thorough scraping and wire brushing St 2

St 2 Thorough scraping and wire-brushing - machine brushing - grinding - etc. The treatment shall remove loose mill scale, rust and foreign matter. Subsequently, the surface is cleaned with a vacuum cleaner, clean dry compressed air or a clean brush. It should then have a faint metallic sheen. The appearance must correspond to the prints designated St 2.

f. Air Blasting with Non-Metallic Abrasives Powder

Whenever the "Duplex"-process is to be applied (hot dip galvanising followed by painting), prepare the hot dip galvanised surface by water washing to remove flux residues and careful air blasting with non-metallic abrasive powder. Use an abrasive with grain size from 0.1 to 0.5 mm, at a greatly reduced air pressure, max. 2 bar (g) (28 psig).

This procedure also applies to stainless steel and aluminium surfaces to be coated.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Surface preparation methods	SIS 055900	DIN 55928 Part-4	BS 4232 only for blasting	SSPC-Vis
Blasting acc to item (a),(b),(c),	Sa 3		First quality	White metal SP 5
Blasting acc to item (b)	Sa 2 1/2		Second quality	near White SP 10
Blasting acc to item (c)	Sa 2		Third quality	Commercial blast SP 6
Hand/or power tool derusting acc to item (e)	St 2		--	Hand tool cleaning SP 2
acc to items (d) and (e)	St 3		--	Power tool cleaning SP 3
Flame jet cleaning		F1	--	Flame cleaning SP 4
Pickling		Be	--	Pickling

Steel structures to be blast cleaned have to be free of pitting and other severely corroded places in accordance with B.S. 4232 and SIS 055900.

The abrasives used for blast-cleaning shall be graded flint, grit, shot or silica sand and shall be such that they will produce an average keying profile on the blast-cleaned surface of not more than 40 microns.

An air pressure of 7 bar g at the nozzle shall be used.

After blast-cleaning, all accumulated grit, dust, etc., must be removed leaving the surface clean, dry and free of mill scale, rust grease and other foreign matter.

In the event of rusting after completion of the surface preparation, the surface must be cleaned again in the manner specified.

Oil, grease, soil, cement, salts, acids or other corrosive chemicals shall be cleaned from steel surfaces, by the use of solvents, emulsions or cleaning compounds. The final wiping shall be with clean solvent and clean rags or brushes. There shall be no detrimental residue left on the surface.

Primed areas which suffer damage must be spot blasted on site to a degree of cleanliness Sa 2 1/2 before, touching up.

Protective coating must be applied as quickly as possible after the completion of surface preparation no matter what cleaning method has been used.

No blast-cleaned surface shall be allowed to remain uncoated overnight.

Steel work protected by shop primer after arrival on site must be cleaned of salt, sand, oil etc. Before the first coat of paint is applied on site. Shop primer damaged during transport must be rectified by blast-cleaning and coating before application of the site coats.

Wood surfaces shall be sanded clean. All nail holes shall be puttied and sanded before priming.

Concrete: If a protective coating is required, concrete shall be allowed to cure before painting.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

8.0.0 PREPARATION OF COATING MATERIALS

All containers shall remain un-opened until required for use.

Primers and paints which have livered, gelled or otherwise deteriorated shall not be used.

The oldest primer or paint of each kind shall be used first.

All ingredients in any container shall be thoroughly mixed before use, and shall be agitated frequently during application to keep the primer in suspension.

Primer or paint mixed in the original container shall not be transferred until all settled pigment is incorporated into the body of liquid.

Mixing in open containers shall be done in a well ventilated area.

Primer or paint shall be mixed in a manner ensuring the breakdown of all lumps, complete dispersion of pigment and uniform composition.

Two-component primers shall be mixed in accordance with the manufacturer's instructions. Thinners shall not be added to primers or paints unless necessary for proper application according to the manufacturer's instructions. When use of thinners is permitted, it must be added to the primer or paint during mixing.

8.1.0 Primer Paint

After the surface is prepared, one coat of suitable primer shall be applied. After this first coat is dried up completely, second coat of primer shall be applied.

Primer shall be applied by brushing to ensure a continuous film without 'holidays'. The dry film thickness of each coat shall be as specified in the Annex- ANNEX 25.1.2 -Paint System of this specification.

The primer should be worked by brush application to cover the crevices, corners, sharp edges etc. in the presence of inspector.

The shades of successive coats should be slightly different in color in order to ensure application of individual coats, the thickness of each coat and complete coverage should be checked as per specification approved by Engineer before application of successive coats.

The contractor shall provide standard thickness measurement instrument with appropriate range(s) for measuring.

Elko meter for measuring the Dry film thickness of each coat, surface profile gauge for checking of surface profile in case of sand blasting. Holiday detectors and pinhole detectors for checking the painted surface discontinuities should be provided by the contractor.

The contractor shall make arrangements for paint manufacturer to provide expert technical service at site as and when required free of cost and without any obligation to the Owner, as it would be in the interest of the manufacturer to ensure that both surface preparation and application are carried out as per their recommendations.

Final inspection shall include measurement of paint dry film thickness, check of finish and workmanship.

8.2.0 Rub down and Touch Up of Primer

The shop coated surfaces shall be rubbed down thoroughly with emery paper to remove all dust, rust and other foreign matters, washed, degreased, then cleaned with warm fresh water and air dried.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

The portions, from where the shop coat has peeled off, shall be touched up and allowed to dry before applying a coat of primer.

The compatibility between shop coat and field primer shall be ascertained from the paint manufacturer. In case degreasing with white spirit is not effective, the surface shall be finally wiped clean with aromatic solvent like xylol or light naphtha.

8.3.0 Non Compatible Shop Coat Primer

- a) The compatibility of finishing coat shall be confirmed from the paint manufacturer. In the event of use of primer such as zinc rich epoxy, inorganic zinc silicate etc., the paint system shall depend on condition of shop coat. If the shop coat is in satisfactory condition showing no major defect, the shop coat shall not be removed. The touch up primer and finishing coat(s) shall be identified for application by Engineer. Shop coated (coated with primer & finishing coat) equipment shall not be repainted unless paint is damaged.
- b) Shop primed equipment and surfaces shall only be 'spot cleaned' in damaged areas by means of power tool brush cleaning or hand tool cleaning and then spot primed before applying one coat of field primer unless otherwise specified. If shop primer is not compatible with field primer then shop coated primer shall be completely removed before application of selected paint system for particular environment. For package units/equipment, shop primer shall be as per the paint system given for particular environment.
- c) In case of existing paint, compatibility between finishing coat and new selected finish coat shall be ascertained before application of finish coat. In case, the coat is selected for upgrading existing alkyd coating to high performance coating then, surface preparation shall be by manual/mechanical means to remove loose rust, peeled off/damaged paint, but sound old coating need not be removed. It shall be touched with suitable primer wherever it has peeled off before application of tie coat. The tie coat shall be applied after 7 days of curing of the primer. If, new paint system is not suitable to upgrade existing coating then complete paint shall be removed by mechanical or blast cleaning before application of new coating system.

8.4.0 Finish Paint

Suitable Finish paints as per the schedule shall be applied for the jobs. The color/shade shall be as approved by the Owner. After cleaning the dust on the dried up primer, first coat of finished paint shall be applied. After this first coat dries up hard, the surface is wet scrubbed cutting down to a smooth finish and ensuring that at no place the first coat is completely removed. After applying second coat, allowing the water to get evaporated completely, third finish coat of finish paint may be applied(if applicable).

9.0.0 STEEL STRUCTURES PAINTING

Generally, all steel structures shall receive two primer coats and two finish coats of painting. First coat of primer shall be given in shop after fabrication before dispatch to erection site after surface preparation as described below. The second coat of primer shall be applied (if required) after erection and final alignment of the erected structures. Two finish coats shall also be applied after erection.

Steel surface which is to painted shall be cleaned off dust and grease and the heavier layers of rust shall be removed by chipping to grade ST-2 as per SIS05-5900 or as per IS: 1477 (part -I) prior to actual surface preparation. Suitable primer of required DFT shall be applied as specified in the Paint system of this document- Annex-25.1.1.

Suitable finish paint of required DFT shall be applied as specified in the Paint system of this document- Annex-25.1.1. The undercoat and finish coat shall be of different tint to distinguish

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

the same from finish paint. All paints shall be of approved brand and shade as per the Owner's requirement.

Joints to be site welded shall have no paint applied within 100 mm of welding zone. Similarly where Friction grip fasteners are to be used no painting shall be provided. On completion of the joint the surfaces shall receive the paint as specified.

Surfaces inaccessible after assembly shall receive two coats of primer prior to assembly. Surfaces inaccessible after erection including top surfaces of floor beams supporting gratings or chequered plate shall receive one additional coat of finish paint over and above number of coats specified before erection. Portion of steel member embedded / to be encased in concrete shall not be painted.

10.0.0 PAINT MATERIALS

The paints shall conform to the specifications given in this Annex and class - 1 quality in the products range of any of the following manufacturers:

- a. Asian Paints (India) Ltd.
- b. Bombay Paints
- c. Berger Paints India Ltd.,
- d. Good lass Nerolac Paints Ltd.,
- e. Garware Paints
- f. Jenson & Nicholson
- g. Shalimar Paints
- h. Equivalent other country manufacturer after prior approval of Owner.

11.0.0 STORAGE

All paints and painting material shall be stored only in rooms to Engineer's approval. All necessary precautions shall be taken to prevent fire. The storage building shall preferably be separated from adjacent buildings. A signboard bearing the words "PAINT STORAGE - NO NAKED LIGHT - HIGHLY INFLAMMABLE - DANGER - NO SMOKING" shall be clearly displayed outside. All paints shall be stored in the safest manner so that no container rolls down and causes accidents. The shelf life of the paints shall be ensured so that the paint materials are not in storage and use after the date of expiry.

12.0.0 APPLICATION

Health and safety of work

The supplier has to check all painting work to be carried out according to the specification of the paint supplier further to all relevant prescriptions and regulations concerning the health and safety of work.

The paint supplier has to present a written specification including at least the flash point of the paints, ventilation requirements, handling precautions such as inhalation, eye and skin protection, and first aid procedure, storage requirements, spill or leak procedure, fire precaution, waste disposal.

Methods

Quality of the surface to be painted or coated has to be tested acc. to DIN 55928 and DIN 8202.

Temporary corrosion protections are to be completely removed prior to applying the definite one, in acc. with DIN 55928.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

All prime coatings shall be applied by brush or airless spray or a combination of these methods, as approved by the coating manufacturer.

All doors, windows, stairways, handrails (if painted), bolts, flanges and equipment supports shall be finish painted by brush.

Spray guns should not be used outside in windy weather or near surfaces of a contrasting colour unless the latter is properly protected.

All cold-spray painting shall be done using standard equipment in accordance with accepted standards and methods.

Care has to be taken not to connect spraying devices for nitro and backelite paints simultaneously to oil based paints.

Paint applied to items that are not being painted shall be removed at the supplier's expense, leaving the surface clean, unstained and undamaged.

Dry film thickness (DFT)

To the maximum extent practicable the coats shall be applied as a continuous film of uniform thickness and free of pores. Overspray, skips, runs, sags and drips should be avoided. The different coats shall not be of the same colour.

For a composite paint or coating system consisting of several coats, the total DFT must be at least equal to the sum of the minimal DFT's for the individual coats. If, the paint system does not have the required minimum DFT those areas should be marked & repainted. If the occurrence of those areas is high, the complete surface must be repainted. It is also critically important to check the DFT of primers and intermediate coats and to correct them where necessary.

For paintings based on Zinc silicate the DFT is limited as well on minimum DFT as on maximum (150µm) because of the risk of mud cracking.

Consumption of paints

Has to be evaluated according to DIN 53220. The paints shall be tested as per IS - 101.

Each coat of paint shall be allowed to harden before the next is applied. For epoxy paint the hardening time normally is 12-14 hours. Suppliers' recommendations regarding hardening time of epoxy paints must be followed.

Particular attention must be paid to full film thickness at edges.

The minimum total dry film thickness of the paint systems shall be as recommended in the **Annex 25.1.2**. The DFT is given in microns (millionths of a metre).

13.0.0 PROTECTIVE COATINGS AND PAINT SYSTEMS

The colour coding for identification of pipelines should comply with IS-2379 & IS -9404.

The type and number of protective coats for any item requiring painting are to be in accordance with DIN 55928 and are to be at least of a quality as shown in the attached Annex-25.1.1- Paint System.

Alternative to the Annex-25.1.1- Paint System specified, are to be presented on the schedule Departure from Specification, as indicated elsewhere.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Generally, all parts shall receive the specified prime coat (s) at the supplier's works to ensure that no corrosion occurs during transport to the site and storage at the site.

Parts which cannot be damaged during transport shall receive the full number of coats.

Types of Substrate, Base metal:

- Ferrous (Surface Temperature during operation < 120° C, EN ISO 12944:1998)

To this group belongs carbon steel, low alloyed steel & high alloyed steel. All paint systems are inevitable for corrosion protection.

- Hot dip galvanized surfaces.

Hot dip galvanized surfaces do require painting in a wet, industrial, chemicals and/or marine environment

- SS (EN ISO 12944:1998 conditionally applicable)

In general, SS surfaces do not require painting unless in a chemical and/or marine environment. In case of chemical and/or marine environments determination of whether or not the surface requires painting depends on the chemical content of the base metal.

The following formula applies:

$$W = Cr + 3.3 \times Mo + 22.45 N_2$$

If $W < 23$, then the surface has to be painted.

If $W < 28$ & $W > 23$, then the surface to be painted if splash contact with the media (i.e. sea) is possible. This may also occur if there is a strong wind carrying drops to the surface.

If $W > 28$, then the surface need not be painted.

- Aluminium

By default such surfaces/components will not be painted. Exceptions are architectural/aesthetic reasons and high corrosive conditions, which shall be evaluated separately depending on aluminum alloys.

14.0.0 GALVANIZING

Galvanizing works shall conform in all respect to B.S. 729, B.S. 3083 and B.S.C.P. 2008 and to DIN 50976 whatever requires the higher quality and shall be performed by the hot dip process, unless otherwise specified.

It is essential that details of steel members and assemblies which are to be hot-dip galvanized should be designed in accordance with B.S 4479.

Vent-holes and drain-holes should be provided to avoid high internal pressures and air-locks during immersion, which may cause explosions, and to ensure that molten zinc is not retained in pockets during withdrawal.

Careful cleaning of welds is necessary before welded assemblies are dipped. The welds and the surrounding metal should be cleaned separately, preferably be blast-cleaning, because the usual preliminary pickling cannot be relied on to remove the welding slag.

All defects of the steel surface including cracks, surface laminations, laps and folds shall be removed in accordance with B.S. 4360. All drilling, cutting, welding, forming and final

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

fabrication of unit members and assemblies shall be completed, where feasible, before the structures are galvanized. The surface of the steelwork to be galvanized shall be free from paint, oil, grease and similar contaminants in accordance with DIN 55928, part 4 and DIN 50976. The weight of zinc coating per unit area has to be noted in the manufacturing documents in accordance with DIN 50976.

The minimum average coating weight shall be as specified in Table 1 of B.S. 729 or Table 2, DIN 50976, whatever requires higher quality.

Structural steel items shall be initially grit-blasted to B.S. 4232, second quality, (Sa 21/2) or by pickling in a bath and the minimum average coating weight on steel sections 5 mm thick and over shall be 610 g/m² (DFT = 85μ) .

On removal from the galvanizing bath, the resultant coating shall be smooth, continuous, free from gross surface imperfections such as bare spots, lumps, blisters and inclusions of flux, ash or dross.

Galvanized contact surfaces to be joined by high-tensile friction-grip bolts shall be roughened before assembly so that the required slip factor (defined in B.S. 3294, part 1 and B.S. 4604, part 1) is achieved. Care shall be taken to ensure that the roughening is confined to the area of the mating faces.

Bolts, nuts and washers, including general grade high-tensile friction grip bolts (referred to in B.S. 3139, and B.S.4395 part 1) shall be hot dip galvanized and subsequently centrifuged (according to B.S. 729). Nuts shall be tapped up to 0.4 mm oversize after galvanizing and the threads oiled to permit the nuts to be finger-turned on the bolt for the full depth of the nut. No lubricant, applied to the projecting threads of galvanized high-tensile friction-grip bolt after the bolt has been inserted through the steelwork, must be allowed to come into contact with the mating faces of the steelwork,. A local remelting of the galvanized parts to achieve the nuts to be finger turned on the bolt is possible in accordance with DIN 50976.

Protected slings must be used for offloading and erection. Galvanized work which is to be stored at the works or on site shall be stacked so as to provide adequate ventilation to all surfaces to avoid wet storage staining (white rust).

Small areas of the galvanized coating damaged in any way shall be restored in accordance with DIN 55928, part A and DIN 50976 by:

- Cleaning the area of any weld slag rust and other impurities and by thorough wire brushing to give a metallic clean surface.
- Application of suitable number of coats of zinc-rich paint containing more than 90 % w/w of zinc in dried film. The dry film thickness shall exceed at least 50 % the thickness of the desired galvanization. In case of application of a low melting point zinc alloy repair rod, the rods shall be in accordance with DIN1707, the thickness of the alloy shall be at least as of the desired galvanization.

The restored area is not to exceed 1 % of the galvanized surface.

Surface restoration of parts in contact with drinking water is not allowed and the quality of the galvanization is to be in accordance with DIN 2444.

After fixing, bolt heads, washers and nuts shall receive two coats of zinc-rich paint. Connections between galvanized surfaces and copper, copper alloy or aluminum surfaces shall be protected by suitable preferably hydrophobe tape wrappings to the owner's approval.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

15.0.0 SPRAYED METAL COATINGS

Corrosion protection may be also achieved by spraying of suitable metals as zinc and/or aluminum on the surfaces of structures. For special cases tin, copper, lead can be used as well. Methods of surface preparation have to conform to B.S. 2569 or to DIN 8567. A proper treatment of the surface followed by an immediate spraying is to apply to ensure adhesion of the sprayed metal. The surface has to be clean, free of impurities, rust, mill scale and rough enough to have binding properties to ensure good enticulation with the sprayed layer. Suitable roughness can be achieved by blast cleaning acc. to BS 4232 or DIN 8567. Welds are to be cleaned and prepared with special care. All surfaces to be treated have to be dry and accessible.

Application of coatings, requirements for thickness, adhesion, composition of coating metals, and subsequent treatment have to conform to BS 2569, DIN 8565 and 8567.

Testing of the spray coated layers are to be carried out in accordance with DIN 8565.

The contractor has to specify the type, composition and thickness of the sprayed metal and of the sealing coating according to DIN 8565 including the corresponding warranties and tests if, sprayed metal coating will be applied.

Safety of work:

All precautions connected with this type of application of corrosion protection have to be in accordance with German regulation DVS 2307, page 1. 2.

Sprayed, unfused coating of metals and metallic compounds applied by combustion gas flame, plasma arc, detonation and similar processes, and the preparation of components, spraying techniques, sealing, finishing and inspection shall be according to B.S. 4761.

The hot galvanized surface has to be cleaned before the application of the coats to remove corrosion products, dirt, dust, grease.

The cleaning can be achieved by

- brush off
- washing with 1 - 1.5 % ammonia water with up to 0.1 % detergent added and followed by wet grinding to turn the foam to grey color,
- steam blasting.

16.0.0 WARNING NOTES / SIGNALS

This Instruction serves the identification of the coated surfaces that are received from shop in assembled condition / module wise.

The warning note shall prevent any possible damage to the coated surfaces during transportation / assembly at site.

Eg.: Welding work OR Heat treatment work on the outside of coated or lined surfaces is prohibited.

17.0.0 COLOUR CODE FOR PIPING

- a. The colour code scheme is intended for identification of the individual group of the pipeline. The system of colour coding consists of a ground colour and colour bands superimposed on it. The colour coding for the identification of pipelines shall comply with **Annex – 25.1.1** of this specification.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Ground Colour shall be applied throughout the entire length for un insulated pipes. For insulated pipes, on the metal cladding or on the pipes of material such as non-ferrous metals, austenitic stainless steel etc., ground colour coating of minimum 2m length or of adequate length not to be mistaken as colour band shall be applied at places requiring colour bands. Colour band(s) shall be applied at the following location.

- i. At battery limit points
 - ii. Intersection points & change of direction points in piping ways.
 - iii. Other points, such as midway of each piping way, near valves, junction joints of service appliances, walls, on either side of pipe culverts.
 - iv. For long stretch/yard piping at 50 M interval.
 - v. At start and terminating points.
- b. Flow direction shall be indicated by an arrow in the location stated above and as directed by Engineer. Colors of arrows shall be black or white and in contrast to the color on which they are superimposed. The size of the arrows shall conform to IS:2379. Product names shall be marked at pump inlet, outlet and battery limit in a suitable size as approved by Engineer. As a rule minimum width of color band shall conform to 75 mm up to 300 NB and to 100 mm over 350 NB. Whenever it is required by the Engineer to indicate that a pipeline carries a hazardous material, a hazard marking of diagonal stripes of red and golden yellow as per IS:2379 shall be painted on the ground color.
- c. All uninsulated piping systems, hangers and supports shall have two coats of suitable primer coats and with suitable finish paints as per Annex 25.1.2 Painting system. Shades shall be as per IS 5 or as indicated by Owner /Engineer. Service of the pipe/line designations shall be painted on all pipes at visible locations.

18.0.0 IDENTIFICATION OF VESSELS, PIPING ETC.

Equipment number shall be stenciled in black or white on each vessel, column, equipment and machinery after painting.

Line number in black or white shall be stenciled on all the pipelines of more than one location as directed by Engineer; size of letters printed shall be 150 mm (high) for column & vessels. 50 mm (high) for pump compressor and other machinery and shall be as per IS: 9404 for piping. The storage tanks shall be marked as detailed in the respective drawing.

19.0.0 INSPECTION AND TESTING

- a) All painting materials including primers and thinners brought to site for application shall be procured directly from manufacturer as per specifications and shall be accompanied by manufacturer's test certificates. Paint formulations without certificates are not acceptable. Engineer at his discretion, may call for tests for paint formulations. Contractor shall arrange to have such tests performed including batch wise test of wet paints for physical & chemical analysis. All costs thereof shall be borne by the contractor. The paints shall be tested as per IS: 101 / equivalent international standard and approved by the Owner.
- b) The painting work shall be subject to inspection by Engineer at all times. In particular, following stage wise inspection shall be performed and contractor shall offer the work for inspection and approval of every stage before proceeding with the next stage. The record of inspection shall be maintained in the registers. Stages of inspection shall be surface preparation, primer application and each coat of paint. In addition to above, record shall include type of shop primer already applied on equipment e.g. red oxide zinc chromate or zinc phosphate or Silicate primer etc.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- c) Any defect noticed during the various stages of inspection shall be rectified by the contractor to the entire satisfaction of Engineer before proceeding further. Irrespective of the inspection, repair and approval at intermediate stages of work, contractor shall be responsible for making good of any defects found during final inspection/guarantee period/defect liability period as defined in general condition of contract. Dry film thickness (DFT) shall be checked and recorded after application of each coat and extra coat of paint shall be applied to make-up the DFT specified without any extra coat to the Owner.

20.0.0 GUARANTEE

The contractor shall guarantee that the chemical and physical properties of paint materials used are in accordance with the specifications contained herein/to be provided during execution of work. The contractor shall produce test reports from the manufacturer regarding the quality of the particular batch of paint supplied. The Engineer shall have the right to test wet samples of paint at random for quality of the same. Batch test reports of the manufacturer's for each batch of paints supplied shall be made available by the contractor.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX-25.1.1

STANDARD FINAL COLOUR OF EQUIPMENT AND PIPING

1.0.0 STANDARD COLOUR CODE FOR MECHANICAL EQUIPMENT

Sl. No.	Description	Ground Colour
A	CLOSED COOLING WATER SYSTEM	
1	Closed cooling water pumps	Sea Green
2	Plate heat exchanger	Sea Green
3	Closed Cycle cooling Water (CCCW) pumps	Sea Green
4	CCCW Expansion tank	Sea Green
5	CCCW chemical dosing tank	Sea Green
B	WATER TREATMENT PLANT	
1	Raw water	
a	Raw water pump	Sea Green
b	Clarifier	Sea Green
c	- Raw / Fire water storage tank	Sea Green
d	DM plant supply pump	Sea Green
e	Filter air blower	Sea Green
f	Filter back wash pump	Sea Green
g	Lime slaking tank & agitator	Sea Green
h	Lime slurry transfer pump	Sea Green
l	Lime solution tank	Sea Green
j	Lime solution dosing pump	Sea Green
k	Alum solution tank	Sea Green
l	Alum solution metering pump	Sea Green
m	Polyelectrolyte solution tank	Sea Green
n	Polyelectrolyte solution metering pump	Sea Green
o	Sludge feed pump	Sea Green
p	Filter press	Sea Green
q	Service water tank for DM building	Sea Green
r	Service water tank for control annex	Sea Green
2	Demineralization system	
a	Activated carbon filter	Sea Green
b	Cation exchanger	Sea Green
c	Anion exchanger	Sea Green
d	Degasser tower	Sea Green
e	Air blower for degasser tower	Sea Green
f	Strong base anion exchanger	Sea Green
g	Degassed water transfer pump	Sea Green
h	Strong base anion exchanger	Sea Green
l	Mixed bed polisher	Sea Green
j	Air blower for mixed bed polisher	Sea Green
k	DM Water Storage tank	Sea Green
l	DM water transfer pump	Sea Green
m	Acid unloading cum transfer pump	Dark Admiralty Grey
n	Bulk acid storage tank	Dark Admiralty Grey
o	Acid measuring tank for SAC	Dark Admiralty Grey
p	Acid measuring tank for MB	Dark Admiralty Grey
q	Regeneration water pump	Dark Admiralty Grey
r	Caustic Lye unloading cum transfer pump	Dark Violet
s	Bulk caustic storage tank	Dark Violet
t	Caustic regeneration tank & agitator	Dark Violet

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Sl. No.	Description	Ground Colour
u	Caustic solution filter	Dark Violet
v	Caustic dilution tank for SBA/WBA	Dark Violet
w	Caustic dilution tank for MB	Dark Violet
x	Caustic pump for regeneration for WBA/SBA	Dark Violet
y	Waste water recirculation cum disposal pump	Sea Green
C	CRANE & HOIST	
1	Power house EOT crane	Canary Yellow
2	CW pump house EOT crane	Canary Yellow
D	COMPRESSED AIR PLANT	
1	Air compressor	Sky Blue
2	Compressed air dryer	Sky Blue
3	Air receiver	Sky Blue
E	Chemical Dosing	
1	Hydrazine preparation tank	Dark Admiralty Grey
2	Ammonia preparation tank	Dark Admiralty Grey
3	Hydrazine & ammonia dosing tank	Dark Admiralty Grey
4	Hydrazine & ammonia dosing pump	Dark Admiralty Grey
5	Phosphate preparation tank	Dark Admiralty Grey
6	Phosphate dosing tank	Dark Admiralty Grey
7	Phosphate dosing pump	Dark Admiralty Grey
8	Sampling system	Dark Admiralty Grey
F	FIRE PROTECTION SYSTEM	
1	Diesel engine driven pump	Fire Red
2	Fuel tank for diesel engine driven pump	Fire Red
3	Main hydrant pump (Electrical)	Fire Red
4	Jockey pump	Fire Red
5	Fire Water Storage tank	Fire Red
6	CO2 cylinder	Fire Red
G	FUEL OIL SYSTEM	
1	Fuel oil pumps skid	Light Brown
2	Fuel oil Storage tank	Light Brown
3	Fuel oil strainer	Light Brown
H	ASH DISPOSAL SYSTEM	
1	Ash transmitting vessel	Aluminium
I	AIR CONDITIONING AND VENTILATION SYSTEM	
1	Refrigerant compressor	Sky Blue
2	Chilled / condenser pumps	Sea Green
3	Condenser water pipe	Sea Green
4	Fans	Grey

Notes:

1. This color code basically refers to IS:2379 for piping with necessary modifications
2. For any item left out, color coding will be decided after Owner's approval.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

2.0.0 STANDARD COLOUR CODE FOR ELECTRICAL EQUIPMENT

	Description	Colour	Colour No.
1	Generator	Two undercoats of high quality epoxy based primer followed by two coats of epoxy painting	
2	Generator circuit breaker	-	RAL 7032
	a) Outdoor		
	b) Indoor	Glossy white	-
3	Transformers	Pebble grey	RAL 7032
4	Bus ducts	Pebble grey	RAL 7032
5	Junction boxes.	Pebble grey	RAL 7032
6	HT/LT Switchboards, Distribution boards, Control & Relay panels		
	a) Indoor	Pebble grey	RAL 7032
	b) Outdoor	Pebble grey	RAL 7032
7	UPS Panel, charger panels	Pebble grey	RAL 7032
8	DG Alternator	Onan Green	-
9	NGR	Pebble grey	RAL 7032
10	Motor	Pebble grey	RAL 7032
11	Lighting fittings	As per manufacturer's standard	As per manufacturer's standard
12	Cable trays	Galvanized	
13	Elevator	Red oxide primer paint	

1. For interior coating, manufacturer's standard can be adopted subject to Owner's approval.
2. All panels that are to be erected at CCR floor shall be painted using RAL 7032 (exterior colour). All Electrical, C&I, Fire alarm or any other panel shall have this colour.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

3.0.0 COLOUR CODING FOR IDENTIFICATION OF PIPELINES USED IN THERMAL POWER PLANTS

Sl.No	Medium	Ground Shade		Band Shade		Remarks
		Color	Color No. as per IS:5	Color	Color No. as per IS:5	
1	Water system					
a)	Untreated or raw / service	Sea green	217	White	-	White is not included in IS - 5-2007
b)	Treated/dematerialized	Sea green	217	Light orange	557	
c)	Condensate	Sea green	217	Light brown	410	
d)	Potable water	Sea green	217	French blue	166	
e)	RO water	Sea green	217	Light orange	557	
f)	Service & clarified water	Sea green	217	French blue	166	
2	Steam system					
a)	Auxiliary steam	Aluminum	-	Signal red	537	with aluminum
3	Air system					
a)	Instrument	Sky Blue	101	White	-	
b)	Service/Plant	Sky Blue	101	White	-	White not included in IS- 5 - 2007
c)	Vacuum pipes	Sky Blue	101	Black	-	Black not included in
4	Gas system					
a)	Hydrogen	Canary yellow	309	Signal red	537	
b)	Chlorine	Canary yellow	309	Dark violet	796	
c)	Carbon dioxide	Canary yellow	309	Light grey	631	
d)	Oxygen	Canary yellow	309	White	218	White is not included in
5	Oils					

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Sl.No	Medium	Ground Shade		Band Shade		Remarks
		Color	Color No. as per IS:5	Color	Color No. as per IS:5	
a)	LDO/HFO	Light brown	410	Brilliant green	221	
b)	Transformer oil	Light brown	410	Light orange	557	
6	Chemical feed					
a)	Acid piping (in water treatment plant)	Dark admiralty grey	632	Signal red	537	Hazard mark is given
b)	Alkali Piping (in water treatment plant)	Dark violet	796	Golden yellow	356	Hazard mark is given
7	Fire services	Fire red	536	-	-	-
8	Effluent pipes	Black	-	-	-	-

4.0.0 COLOUR CODE FOR STRUCTURAL STEEL

SL. NO	ITEAM/SERVICE	COLOR	COLOR No. as per IS:5
1	Gantry girder & monorail	Brilliant green	221
2	Gantry girder & monorail stopper	Signal red	537
3	Building structural steel columns brackets, beams bracings, roof truss, purloin, side grit, louvers, stringers	Dark admiralty grey	632
4	Pipe rack structure & trestle	Dark admiralty grey	632
5	Chequered plate (Plain Face)	Black	-
6	Grating	Black	-
7	Ladder	Dark admiralty grey	632
8	Hand railing Hand rail	Signal red	537
9	Middle rail	Signal red	537
10	Toe Plate	Signal red	537
11	Vertical post	Black	-
12	Structural steel for Silo	Smoke grey	692

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Notes

1. Covering capacity and DFT depends on method of application. Covering capacity specified above is theoretical. Allowing the losses during application, min specified DFT shall be maintained.
2. All primers and finish coats shall be cold cured and air dried unless otherwise specified.
3. All paints shall conform to relevant Indian Standard and shall be applied in accordance with manufacturer's instructions for surface preparation, intervals, curing and application. The surface preparation, quality and workmanship shall be ensured.
4. Technical data sheets for all paints shall be supplied at the time of submission of quotations.
5. In case of use of epoxy tie coat, manufacturer shall demonstrate satisfactory test for inter coat adhesion. In case of limited availability of epoxy tie coat, alternate system may be used taking into consideration the service requirement of the system.
6. Contractor will submit the final colour shade for all equipments & piping under his scope for final approval by client / consultant.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat
Structural Steel work, piping (Oil + Water), tanks outside surface, transmission towers cranes, steel floors, galleries, stairways, Outdoor.	< 130 Deg	SA 2 1/2	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1	75
			Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Mid coat	1	2 pack High build High Solid Lamellar MIO based Epoxy Mid coat.	200
			Finish	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of at least 90% on QUVB exposure of minimum 1000 hrs.	75
					Total	350
Structural Steelwork, piping, indoor and outdoor	130 to 200 Deg	SA 2 1/2	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75
			Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Sealer	1	Single pack Heat Resistant Silicon Acrylic Finish paint.	25
			Finish	2	Single pack Heat Resistant Silicon Acrylic Finish paint.	25
					Total	150
Alternative -2		SA 2 1/2	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75
				1	Single pack Moisture Cured, Inorganic Silicate based heat resisting finish up to 400 Deg - Grey shade./ white/ Aluminium.	50
			Finish	1		50
					Total	175
Alternative-3			Finish	1	Single pack Heat Resistant Silicon Acrylic Finish paint. - either Aviation White/ Aviation Orange.	80
					Total	155
Structural Steel work Piping, Un-insulated	200 to 400	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs	75

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS						
Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.						
Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat
Carbon Steel Indoor and Outdoor	Deg C.				/ 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	
			Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level 2.	(75)
			Finish	2	Heat Resisting Silicon Aluminium Paint. VS to be min 28%.	20
					Total	115
Carbon steel surfaces subjected to temperature up to 400°C. But Under Thermal Insulation.	< 400°C	Power tool cleaning to St 2 /3		2	Red-oxide Zinc phosphate primer to IS 12744	30
						60
Components coming in the gas path (other than Coils), including water walls, SH panels, SH Headers, Hot air ducts etc.		Power tool cleaning		2	Red-oxide Zinc phosphate primer to IS 12744	30
						60
Structural Steel work, Piping (Oil + water) , Tanks Indoor.	<130 Deg.C	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75
			Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Mid coat	2	2 pack High build High Solid Lamellar MIO based Epoxy Mid coat.	100
			Finish	2	Two component Polyamide Cured Epoxy Coating.	25
					Total	325
Structural Steel work in the battery rooms, chlorination plant and	Ambient	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance	75

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat
water treatment plant, (extremely aggressive atmosphere)					specifications for SSPC Paint 20 , Level 1	
			Touch up		Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Mid coat	1	Two component, high build rust encapsulating, aluminium pigmented modified epoxy coating.	125
			Finish	1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%	150
					Total	350
Steel Tanks inside Surface (Total) for Oil Storage	Normal	SA 2.5	Primer	1	Two component high build amine cured epoxy Primer with zinc phosphate pigment.	75
			Finish	2	Two component Self priming High Build Polyamine adduct cured epoxy coating.	125
					Total	325
Alternative-1			Finish	3	Two component Self priming High Build Polyamine adduct cured epoxy coating. (No primer required. Self priming coating post blasting)	125
					Total	375
Alternative-2			Finish	2	Two component High build high solid Solvent free epoxy coating - certified by CFTRI for Potable water usage. (Primer same as above)	150
					Total	300
Steel Tanks inside Surface (Total) for Water Storage (Potable and Distilled Water)	Ambient	SA 3	Primer	1	Two component high build polyamide cured zinc phosphate Primer	75
			Finish	2	Two component Self priming High Build Polyamine adduct cured epoxy coating - certified by CFTRI for Potable water usage.	125
					Total	325
Alternative 1			Finish	2	Two component High build high solid Solvent free epoxy coating - certified by CFTRI for Potable water usage. (No primer required. Self priming coating post blasting)	200
					Total	400
Steelwork immersed in	< 60	SA 3	Primer	1	Two component High Build High Solid Rapid Curing Epoxy	75

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT

SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat	
seawater such as inlet/ outlet structures, dolphins, sheet piling	Deg C				Zinc Phosphate Primer.		
			Finish	1	Two component High build High Solid Modified Epoxy coating.	500	
					Total	575	
			Wherever TAR based product is not to be recommended.				
			Finish	1	Two component High build High Solid Modified Epoxy coating	500	
					Total	500	
		Finish	1	Two component High build High Solid Modified Epoxy coating with Glass Flake.	500		
				Total	500		
Alternative 1							
Cast Iron Water pipelines - Outside surface, buried in Soil	< 60 Deg C	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1	75	
			Finish	2	Polyamide Cured Coal Tar Epoxy, Vs min 65% black.	200	
					Total	475	
Alternate-1			Finish	1	Two component High build High Solid Modified Epoxy coating	500	
Alternate -2			Finish	1	Two component High build High Solid Modified Epoxy coating with Glass Flake	500	
Steel Pipes - Inside surfaces such as cooling water lines.	< 60 Deg C	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75	
			Finish	2	Coal Tar Epoxy, Vs min 65% black.	225	
					Total	525	
Water Pipelines - Outside Surface, Indoor	< 60 Deg C	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75	
			Touch	1	Two component Zinc rich Primer meeting performance and	(75)	

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat
			up		compositional specifications of SSPC Paint 20 Level2	
			Finish	2	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%	100
					Total	275
Oil pipelines - Outside surface, above ground	< 100 Deg C	SA 3	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75
			Touch up		Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Mid coat	2	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%	100
			Finish	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of at least 90% on QUUVB exposure of minimum 1000 hrs.	75
					Total	350
Pumps, Motors, Turbine, Claddings, Steam Turbine Condenser, Indoor	Up to 90 Deg	SA 2.5	Primer	1	Catalysed Zn rich Primer with a VS of 60% min, complying to SSPC Paint 20 level 2.	75
			Finish	2	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%.	100
					Total	275
Alternative 1		SA 2.5	Primer	1	Catalysed Zn rich Primer with a VS of 60% min, complying to SSPC Paint 20 level 2.	75
			Mid coat	1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%.	100
			Finish	2	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of at least 90% on QUUVB exposure of minimum 1000 hrs.	75
					Total	250
Heat Exchangers - Inside Surface.	Up to 60 Deg	SA 2.5	Primer	1	Solvent based IZS - VS of 60%. Zn Dust - 1.77 kg/ltr minimum. Zn dust by weight - minimum 85%. Pot life 12 hrs / 21 Deg.- Paint to meet compositional & performance specifications for SSPC Paint 20 , Level 1.	75
			Finish	2	Coal Tar Epoxy, Vs min 65% black.	200

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS						
Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.						
Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat
					Total	475
Heat exchanger Coils coming in the gas path . (Eco, SH, RH coils & Loose tubes etc.)		Power tool cleaning			One coat of dip-coat paint -Red-oxide Zinc phosphate primer	35
Instrument panels, Electrical cubicles and similar steel sheet – indoor (Can be used on Aluminium, steel, stainless steel and galvanized substrates.)	Ambient	Oil grease and contaminants must be removed	Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	75
			Mid coat	1	Two component High Build Surface Tolerant Epoxy coating pigmented with Aluminium and Lamellar Micaceous iron oxide	100
			Top coat	1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%	100
					Total	275
Instrument panels, Electrical cubicles and similar steel sheet – outdoor (Can be used on Aluminium, steel, stainless steel and galvanized substrates.)	Ambient	Oil grease and contaminants must be removed	Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	100
			Mid coat	1	Two component High Build Surface Tolerant Epoxy coating pigmented with Aluminium and Lamellar Micaceous iron oxide.	150
			Top coat	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of atleast 90% on QUVB exposure of minimum 1000 hrs.	75
					Total	325
Substrate, base metal: Carbon steel, HDG acc ISO 1461 Or. Equiv. Non Insulated. - Outdoor	<120 Deg	Air blasting with Nonmetallic abrasive Powder	Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)
			Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	50
			Mid coat	1	Two component High Build Surface Tolerant Epoxy coating pigmented with Aluminium and Lamellar Micaceous iron oxide	150

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat		
			Finish	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of atleast 90% on QUVB exposure of minimum 1000 hrs.	75		
					Total	275		
Substrate, base metal: Carbon steel, HDG acc ISO 1461 Or. Equiv. Non Insulated.- Indoor	<120 Deg	Air blasting with Nonmetall ic abrasive Powder	Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level 2.	75		
			Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	125		
	Finish		1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%.	100			
				Total	225			
				For Outdoor Application				
				Touch up	1	Two component Zinc rich Primer meeting performance and compositional specifications of SSPC Paint 20 Level2	(75)	
				Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	125	
				Finish	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of at least 90% on QUVB exposure of minimum 1000 hrs.	75	
				Total	200			
				For Indoor Application				
Substrate, Stainless Steel - Non insulated.	< 120 Deg	Air blasting with Nonmetall ic abrasive Powder	Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	125		
			Finish	1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%	100		
				Total	225			
				For Outdoor Application				
				Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	125	
		Finish	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of atleast 90% on QUVB exposure of minimum 1000 hrs.	75			
				Total	200			
Applicable for Water -				For Indoor Application				

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1

VOLUME: II B

TECHNICAL SPECIFICATION FOR

EFFLUENT TREATMENT PLANT

SPECIFICATION NO.: PE-TS-435-164-A001

ANNEX 25.1.2 PAINTING SYSTEMS

Cleaning, Protective Coating and Painting - Systems designed as per ISO 12944 with service life of 10 yrs.

Surface/ Location	Temp	Surface prep	Coat	No. of coats	Generic Type	Dft/Coat	
Water Cooled heat Exchangers like Condensers, Flash box, Water - Water coolers etc.	< 120 Deg	Air blasting with Nonmetallic abrasive Powder	Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	75	
			Top coat	2	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%.	100	
			Total			275	
For Outdoor installations in corrosive atmosphere - like Chemical/ Marine.		Air blasting with Nonmetallic abrasive Powder	For Outdoor Application				
			Primer	1	Two pack , high build siloxane modified epoxy primer with zinc phosphate pigment.	125	
			Mid coat	1	Two component High Build high Solid Aliphatic Amine Cured Epoxy coating. - Min VS 85%.	100	
			Top coat	1	2 pack Acrylic Aliphatic Polyurethane top coat - with Gloss retention of at least 90% on QUVB exposure of minimum 1000 hrs.	75	
			Total			300	

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

QUALITY PLAN
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

Items / Components	Tests	Material Test	WPS/PQR/Welder Qualification	DPT/MPI	UT	RT	Hydraulic / Water Fill	Balancing	Type test	Performance Test	All test as per relevant Std/ Appd. Data Sheets	Visual & Dimension	Remarks
A	Centrifugal pumps												<p>LEGENDS:</p> <ol style="list-style-type: none"> 1 As per AWWA C 504 2 One per heat/heat treatment batch. 3 On machined surface only. 4 Only DPT on root run after back gauging and finish weld. 5 For shaft ≥ 50 mm 6 For plates ≥ 25mm 7 For pipes weld thickness ≥ 20mm 8 As per HIS, USA 9 Void 10 On welds for dished ends manufactured with plates having weld joint. On vessel/tank as per design code. 11 Seat leakage test for actuator-operated valves shall be checked for seat leakage by closing the valve with actuator. 12 Pipes and fittings for rubber lining shall be free from internal weld bead.
I	Casing	Y ²	-	Y ³	-	-	Y	-	-	-	-	Y	
II	Impeller	Y ²	-	Y ³	-	-	-	Y	-	-	-	Y	
III	Shaft	Y ²	-	Y ³	Y ⁵	-	-	-	-	-	-	Y	
IV	Fabricated components	Y	Y	Y ³	-	-	Y	-	-	-	-	Y	
V	Assembled Pumps	-	-	-	-	-	-	-	-	Y ⁸	-	-	
B	Tanks & vessels	Y	Y	Y ⁴	Y ⁶	Y ¹⁰	Y	-	-	-	Y	Y	
C	R&W pipes	Y	Y	Y ⁴	-	Y ⁷	Y	-	-	-	Y	Y	
D	RE joint	Y	-	-	-	-	Y	-	-	Y	-	Y	
E	Rubber lining	Y	-	-	-	-	-	-	-	-	Y	Y	
F	Pipes & Fittings	Y ²	Y	-	-	-	Y	-	-	-	-	Y ¹ 2	
G	Gear box	Y	-	Y	Y	-	-	-	-	Y	Y	Y	
H	Gate/Globe/ Check valve	Y	-	Y	-	-	Y ¹ 1 1	-	-	-	Y	Y	
<p>NOTE-1: - The above are minimum quality checks to be carried out at manufacturers works. The detailed quality plan based on above is to be developed by the main vendor incorporating witness stage for approval by BHEL/Customer.</p> <p>NOTE-2: Butt welds, if any on-dished ends, shall be radio graphed after dishing. All dished ends for pressure vessels shall be stress relieved after dishing.</p> <p>NOTE-3: Also refer data sheet-A for inspection for testing.</p>													



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

DATA SHEET-A (FOR EFFLUENT TREATMENT PLANT)

1.0	TG AREA OILY WASTE PIT (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
1.1	Quantity	One Number
1.2	Capacity (each)	5 m³
1.3	Material	RCC
1.4	Type	Underground with single compartment.
1.5	Instruments	As per P&id.
2.0	TG AREA OILY WASTE TRANSFER PUMP (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
2.1	Quantity	Two (1W+1S)
2.2	Capacity (each)	5 m³/Hr.
2.3	Head	As per System Requirement.
2.4	Type	Horizontal, Screw Type
2.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
2.6	Shaft sealing	Mechanical seal
2.7	Instruments and valves	As per P&id.
3.0	TG AREA OILY WASTE PIT (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
3.1	Quantity	One Number
3.2	Capacity (each)	5 m³
3.3	Material	RCC
3.4	Type	Underground with single compartment.
3.5	Instruments	As per P&id.
4.0	TG AREA OILY WASTE TRANSFER PUMP (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
4.1	Quantity	Two (1W+1S)
4.2	Capacity (each)	5 m³/Hr.
4.3	Head	As per System Requirement.
4.4	Type	Horizontal, Screw Type
4.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
4.6	Shaft sealing	Mechanical seal
4.7	Instruments and valves	As per P&id.
5.0	TRANSFORMER AREA OILY WASTE PIT (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
5.1	Quantity	One Number
5.2	Capacity (each)	Minimum 85 m³
5.3	Material	RCC
5.4	Type	Underground with single compartment.
5.5	Instruments	As per P&id.
6.0	TRANSFORMER AREA OILY WASTE TRANSFER PUMP (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
6.1	Quantity	Two (1W+1S)
6.2	Capacity (each)	10 m³/Hr.
6.3	Head	As per System Requirement.
6.4	Type	Horizontal, Screw Type
6.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
6.6	Shaft sealing	Mechanical seal
6.7	Instruments and valves	As per P&id.
7.0	TRANSFORMER AREA OILY WASTE PIT (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
7.1	Quantity	One Number
7.2	Capacity (each)	Minimum 85 m³
7.3	Material	RCC
7.4	Type	Underground with single compartment.
7.5	Instruments	As per P&id.
8.0	TRANSFORMER AREA OILY WASTE TRANSFER PUMP (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

8.1	Quantity	Two (1W+1S)
8.2	Capacity (each)	10 m ³ /Hr.
8.3	Head	As per System Requirement.
8.4	Type	Horizontal, Screw Type
8.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
8.6	Shaft sealing	Mechanical seal
8.7	Instruments and valves	As per P&id.
9.0	FUEL OIL OWS WASTE PIT (COMMON FOR TWO UNITS) [LOCATED OUTSIDE ETP AREA]	
9.1	Quantity	One Number
9.2	Capacity (each)	5 m ³
9.3	Material	RCC
9.4	Type	Underground with single compartment.
9.5	Instruments	As per P&id.
10.0	FUEL OIL OWS WASTE TRANSFER PUMP (COMMON FOR TWO UNITS) [LOCATED OUTSIDE ETP AREA]	
10.1	Quantity	Two (1W+1S)
10.2	Capacity (each)	5 m ³ /Hr.
10.3	Head	As per System Requirement.
10.4	Type	Horizontal, Screw Type
10.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
10.6	Instruments and valves	As per P&id.
11.0	COAL MILL WASTE SUMP-1 AND 2 (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
11.1	Quantity	One Number
11.2	Capacity	5 m ³
11.3	Material	RCC
11.4	Type	Underground with single compartment.
11.5	Instruments	As per P&id.
12.0	COAL MILL WASTE TREANSFER PUMP (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
12.1	Quantity	Two (1W+1S) per sump/pit.
12.2	Capacity (each)	5 m ³ /Hr.
12.3	Head	As per System Requirement.
12.4	Type	Vertical, Centrifugal Type (Self lubricants type).
12.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 410, Impeller-Stainless Steel Gr. 316/CF8M.
12.6	Shaft sealing	Mechanical seal
12.7	Instruments and valves	As per P&id.
13.0	COAL MILL WASTE SUMP-1 AND 2 (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
13.1	Quantity	Two Numbers per Unit.
13.2	Capacity (each)	5 m ³
13.3	Material	RCC
13.4	Type	Underground with single compartment.
13.5	Instruments	As per P&id.
14.0	COAL MILL WASTE TREANSFER PUMP (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
14.1	Quantity	Two (1W+1S) per sump/pit.
14.2	Capacity (each)	5 m ³ /Hr.
14.3	Head	As per System Requirement.
14.4	Type	Vertical, Centrifugal Type (Self lubricants type).
14.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 410, Impeller-Stainless Steel Gr. 316/CF8M.
14.6	Shaft sealing	Mechanical seal
14.7	Instruments and valves	As per P&id.
15.0	BOILER AREA FLOOR WASH PIT (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
15.1	Quantity	Two Numbers per Unit.
15.2	Capacity (each)	5 m ³
15.3	Material	RCC

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

15.4	Type	Underground with single compartment.
15.5	Instruments	As per P&id.
16.0	BOILER AREA FLOOR WASH PIT TRANSFER PUMP (FOR UNIT-1) [LOCATED OUTSIDE ETP AREA]	
16.1	Quantity	Two (1W+1S)
16.2	Capacity (each)	5 m ³ /Hr.
16.3	Head	As per System Requirement.
16.4	Type	Vertical, Centrifugal Type (Self lubricants type).
16.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 410, Impeller-Stainless Steel Gr. 316/CF8M.
16.6	Instruments and valves	As per P&id.
17.0	BOILER AREA FLOOR WASH PIT (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
17.1	Quantity	Two Numbers per Unit.
17.2	Capacity (each)	5 m ³
17.3	Material	RCC
17.4	Type	Underground with single compartment.
17.5	Instruments	As per P&id.
18.0	BOILER AREA FLOOR WASH PIT TRANSFER PUMP (FOR UNIT-2) [LOCATED OUTSIDE ETP AREA]	
18.1	Quantity	Two (1W+1S)
18.2	Capacity (each)	5 m ³ /Hr.
18.3	Head	As per System Requirement.
18.4	Type	Vertical, Centrifugal Type (Self lubricants type).
18.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 410, Impeller-Stainless Steel Gr. 316/CF8M.
18.6	Instruments and valves	As per P&id.
19.0	COMMON OILY WASTE COLLECTION PIT (COMMON FOR UNIT-1 & 2) [LOCATED INSIDE ETP AREA]	
19.1	Quantity	Two Numbers per Unit.
19.2	Capacity (each)	50 m ³ [Considering one hour flow from each source at a time {5 M ³ /Hr TG Area Oily Waste (2 Nos, for 1 Hours in a day) + 10 M ³ /Hr for 4 Hrs oily waste from Transformer Yard from one Transformer in case of Fire/bursting of transformer} = (5x2+10)=20 m ³].
19.3	Material	RCC
19.4	Type	Above ground with single compartment.
19.5	Instruments	As per P&id.
20.0	OWS FEED PUMP (FOR UNIT-2) [LOCATED INSIDE ETP AREA]	
20.1	Quantity	Two (1W+1S)
20.2	Capacity (each)	5 m ³ /Hr. [m ³ [Average taken Considering 5 M ³ /Hr TG Area Oily Waste (2 Nos, for 1 Hours in a day) + 10 M ³ /Hr for 4 Hrs oily waste from Transformer Yard from one Transformer in case of Fire/bursting of transformer = (5x2x1+10X4X1)/24 = 2.08 m ³].
20.3	Head	As per System Requirement.
20.4	Type	Horizontal, Screw Type
20.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
20.6	Instruments and valves	As per P&id.
21.0	OIL WATER SEPARATOR (COMMON FOR UNIT-1 & 2) [LOCATED INSIDE ETP AREA]	
21.1	Quantity	One Number
21.2	Capacity (each)	5 m ³ /Hr.
21.3	Type	Plate or Tube with Counter Flow / Cross Flow.
21.4	Material of Construction	Body: Carbon Steel. Plate: UV inhibited virgin FRP or GRP or PVC.
21.5	Treated water quality	Free Oil content not to exceed 10 ppm for free oil concentration 1000 ppm max. in feed waste to the Separator.
21.6	Oil Skimmer System	Shall be provided.
21.6	Instruments and valves	As per P&id.
22.0	SLOP OIL STORAGE TANK [LOCATED INSIDE ETP AREA]	
22.1	Quantity	Two (2)
22.2	Type	Vertical Cylindrical.
22.3	Type of fluid to be handled	Slop Oil.

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

22.4	Capacity (each)	1000 Ltrs.
22.5	Material of Construction	GRP/HDPE/PP
23.0	COMMON COLLECTION PIT (COMMON FOR UNIT-1 & 2) [LOCATED INSIDE ETP AREA]	
23.1	Quantity	One Number
23.2	Capacity (each)	One hour holding time for peak condition, 450 m³ [Considering 2.08 M ³ /Hr from OWS continuous + 419.33 from Coal Pile Runoff (from entire coal pile run off pond During Peak Manson time) [Refer Note below] + 2 M ³ /Hr per Coal Mill Waste Sump (4 Nos) continuous + 5 M ³ /Hr per Boiler Area Floor Wash Pit (2 Nos, for 1 Hours in a day) = {2.08+419.3+2X4+5x2} = 439.38 m ³ . Note: Total Coal pile area (Unit-I + Unit-II) =780m X 280m = 218,400 SqM. As per GTS, Volume-II, Section-1, Page 28 of 191, Maximum Rainfall per day = 138.2 mm, i.e, 138.2/24 mm/hr = 5.76 mm/Hr. Total rain water for 20 minutes heavy rainfall coming from entire coal pile area (Unit-I + Unit-II) to be considered for ETP sizing calculation = 5.76/1000x218,400x20/60 CuM =419.33 CuM.
23.3	Material	RCC
23.4	Type	Above ground with single compartment.
23.5	Instruments	As per P&id.
24.0	TUBE SETTLER FEED PUMP [LOCATED INSIDE ETP AREA]	
24.1	Quantity	Two (1W+1S)
24.2	Capacity (each)	30 m³/Hr. [Average Taken from sl no 23.2 above, (2.08X24+419.33+2x4x24+5x2x1)/24 m ³ /Hr = 27.96 m ³ /Hr].
24.3	Head	As per System Requirement.
24.4	Type	Horizontal, Centrifugal.
24.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 410, Impeller-Stainless Steel Gr. 316/CF8M.
24.6	Instruments and valves	As per P&id.
25.0	FLASH MIXER [LOCATED INSIDE ETP AREA]	
25.1	Quantity	One Number
25.2	Type	Flash mixer with circular/rectangular shape.
25.3	Design residence time	60 sec
25.4	Material of Construction	MS (Epoxy Painted)
25.5	Agitator	SS 316; Motor driven with reduction gear.
26.0	FLOCCULATION TANK [LOCATED INSIDE ETP AREA]	
26.1	Quantity	One Number
26.2	Type	Flocculation Tank with circular/rectangular shape.
26.3	Design residence time	30 min
26.4	Material of Construction	MS (Epoxy Painted)
26.5	Material of Construction	MS (Epoxy Painted)
26.6	Material of Construction	RCC
26.7	Agitator	MS with Epoxy painted or SS 316, Motor driven with reduction gear.
27.0	TUBE SETTLER [LOCATED INSIDE ETP AREA]	
27.1	Quantity	One Number
27.2	Capacity	30 m³/Hr.
27.3	Type	Plate Type Lamella clarifier.
27.4	Output Capacity for each at rated condition, m ³ /hr	30 m³/Hr.
27.5	Surface flow rate	Not exceed to 1.2 m ² /m ³ /hr (based on Projected Effective Surface Area)
27.6	Material of Construction	Body: MS with epoxy paint, Plate: FRP
28.0	SLUDGE COLLECTION PIT [LOCATED INSIDE ETP AREA]	
28.1	Quantity	One Number
28.2	Capacity (each)	5 m³
28.3	Material	RCC



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

28.4	Type	Underground with single compartment.
28.5	Instruments	As per P&id.
29.0	SLUDGE TRANSFER PUMP [LOCATED INSIDE ETP AREA]	
29.1	Quantity	Two (1W+1S)
29.2	Capacity (each)	4 m ³ /Hr.
29.3	Head	As per system requirement.
29.4	Type	Horizontal, Screw Type
29.5	Material of Construction	Casing and Rotor Housing: Cast Iron as per IS 210 FG 260; Rotor & Shaft: CF 8M/SS 316, Driving Gear- Hardened and tempered alloy steel with machine cut teeth and ground finish.
29.6	Instruments and valves	As per P&id.
30.0	AIR BLOWER FOR SLUDGE COLLECTION PIT [LOCATED INSIDE ETP AREA]	
30.1	Quantity	Two (1W+1S)
30.2	Capacity (each)	4 m ³ /Hr (minimum) or Suitable to meet 100% of system requirement.
30.3	Head	As per system requirement.
30.4	Type	Rotary, twin lobe
30.5	Purpose	Sludge mixing in Sludge Pit.
30.6	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Lobes: CS to BS 970, EN9 Forged, Shaft: CS to BS 970, EN9 Forged .
30.7	Instruments and valves	As per P&id.
31.0	PE DOSING FOR LAMELLA CLARIFIER [LOCATED INSIDE ETP AREA]	
31.1	Number of Tanks	Two (1W+1S)
31.2	Capacity (each) of tank	100 Ltrs (considering 2 ppm dosing and 5% dilution in tank).
31.3	Material of Construction of Tank	SS 304
31.4	Agitator per tank	1 No (MOC: SS 316)
31.5	Number of Dosing Pumps	Two (1W+1S)
31.6	Capacity (each) of Pump	5 LPH.
31.7	Head of Pump	As per system requirement.
31.8	Type of pump	Positive Displacement Plunger Type.
31.9	Material of Construction of Pump	Wetted parts PP, Casing: CI, Plunger: EN8.
31.10	Strainer for Pump	1 No per Pump, 'Y' Type, MOC: PP.
32.0	LIME DOSING FOR LAMELLA CLARIFIER [LOCATED INSIDE ETP AREA]	
32.1	Number of Tanks	Two (1W+1S)
32.2	Capacity (each) of tank	250 Ltrs (considering 25 ppm dosing and 10% dilution in tank).
32.3	Material of Construction of Tank	SS 304
32.4	Agitator per tank	1 No (MOC: SS 316)
32.5	Number of Dosing Pumps	Two (1W+1S)
32.6	Capacity (each) of Pump	20 LPH.
32.6	Head of Pump	As per system requirement.
32.6	Type of pump	Positive Displacement Plunger Type.
32.6	Material of Construction of Pump	Wetted parts PP, Casing: CI, Plunger: EN8.
32.6	Strainer for Pump	1 No per Pump, 'Y' Type, MOC: PP.
33.0	ALUM DOSING FOR LAMELLA CLARIFIER [LOCATED INSIDE ETP AREA]	
33.1	Number of Tanks	Two (1W+1S)
33.2	Capacity (each) of tank	600 Ltrs (considering 50 ppm dosing and 6% dilution in tank).
33.3	Material of Construction of Tank	SS 304
33.4	Agitator per tank	1 No (MOC: SS 316)
33.5	Number of Dosing Pumps	Two (1W+1S)
33.6	Capacity (each) of Pump	50 LPH.
33.7	Head of Pump	As per system requirement.
33.8	Type of pump	Positive Displacement Plunger Type.
33.9	Material of Construction of Pump	Wetted parts PP, Casing: CI, Plunger: EN8.
33.10	Strainer for Pump	1 No per Pump, 'Y' Type, MOC: PP.
34.0	CENTRAL MONITORING BASIN (CMB) [LOCATED INSIDE ETP AREA]	
34.1	Quantity	One Number with two compartments.
34.2	Capacity (each compartment)	460 m ³ [Considering 30 M ³ /Hr from Tube settler continuous +120 M ³ /Hr from N-Pit for 2 Hours in a day + BWRO reject (provisional) 20 M ³ /Hr 4 Hours in a day = {(25x24+120x2 +20x4)/2=920/2=460}].

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

34.3	Material	RCC
34.4	Type	Above ground with two compartments.
34.5	Instruments	As per P&id.
35.0	EFFLUENT TRANSFER PUMP-1 FOR CHP DUST SUPPRESION/HORTICULTURE [LOCATED INSIDE ETP AREA]	
35.1	Quantity	Two (1W+1S)
35.2	Capacity (each)	22 m ³ /Hr. [Selected as per Water Balance Diagram PE-DG-435-172-N110].
35.3	Head	As per System Requirement.
35.4	Type	Horizontal, Centrifugal.
35.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 316/CF8M. Impeller-Stainless Steel Gr. 316/CF8M.
35.6	Instruments and valves	As per P&id.
36.00	EFFLUENT TRANSFER PUMP-2 FOR CW BLOW DOWN LINE [LOCATED INSIDE ETP AREA]	
36.1	Quantity	Two (1W+1S)
36.2	Capacity (each)	50 m ³ /Hr. [Refer sl no 34.2 above: 920 CuM/24 Hrs=38.33 Cum/Hr]
36.3	Head	As per System Requirement.
36.4	Type	Horizontal, Centrifugal.
36.5	Material of Construction	Casing: Cast Iron as per IS 210 FG 260; Shaft: Stainless Steel Gr. 316/CF8M. Impeller-Stainless Steel Gr. 316/CF8M.
36.6	Instruments and valves	As per P&id.
37.0	ACID DOSING FOR CMB [LOCATED INSIDE ETP AREA]	
37.1	Number of Tanks	One Number
37.2	Capacity (each) of tank	250 Ltrs
37.3	Material of Construction of Tank	HDPE
37.4	Number of Dosing Pumps	Two (1W+1S)
37.5	Capacity (each) of Pump	5 LPH.
37.6	Head of Pump	As per System Requirement.
37.7	Type of pump	Positive Displacement Plunger Type.
37.8	Material of Construction of Pump	Wetted parts PP, Casing: CI, Plunger: CF8M.
37.9	Strainer for Pump	1 No per Pump, 'Y' Type, MOC: PP.
38.0	ALKALI DOSING FOR CMB [LOCATED INSIDE ETP AREA]	
38.1	Number of Tanks	One Number
38.2	Capacity (each) of tank	250 Ltrs
38.3	Material of Construction of Tank	HDPE
38.4	Agitator per tank	1 No (MOC: SS 316)
38.5	Number of Dosing Pumps	Two (1W+1S)
38.6	Capacity (each) of Pump	5 LPH.
38.7	Head of Pump	As per System Requirement.
38.8	Type of pump	Positive Displacement Plunger Type.
38.9	Material of Construction of Pump	Wetted parts PP, Casing: CI, Plunger: CF8M.
38.10	Strainer for Pump	1 No per Pump, 'Y' Type, MOC: PP.
39.00	CHEMICAL STORAGE AND HANDLING AREA [LOCATED INSIDE ETP AREA]	
39.1	Number	One (1).
39.2	Type	Single storied building cum Industrial Shed Comprising One chemical store room for 30 days storage capacity, dosing system area under shed.
39.3	Building dimensions	Shall be decided during detailed engineering
40.00	PIPE	
		Refer P&ID.
41.0	VALVES	
		Material of Construction
41.1	Raw water/filter water/plant effluent water (non-corrosive)	Butterfly Butterfly valves shall be of double flanged conforming to AWWA-C-504 class 150 (min.) or BS:5155 PN 10 (min.) Body: cast Iron IS:210 Gr. FG 260 Disc: cast Iron IS:210 Gr. FG 260 Shaft: ASTM.A296 Gr. CF8M Seat rings: Nitrilerubber, EPDM, Hypalon All the butterfly valves shall be provided with Hand wheel or lever as per the requirements. All the butterfly valves shall be provided with an indicator to show the position of the disc. Flanges shall conform to ANSI B 16.5 Cl.150 (min.)



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

		<p><u>GATE VALVE</u> Type: Outside screw and rising stem type Stem, seat ring and wedge facing ring: SS, Rating: PN 10 (min). Other parts of the valve: As per IS:14846.</p> <p><u>BALL VALVE</u> Type: Full bore. Rating: PN 10 (min). Body: cast Iron/carbon steel. Ball: stainless steel. Seat ring: PTFE. Stem: Stainless steel Seat: Nitrile rubber, PTFE</p> <p><u>GLOBE</u> Type: Double flanged or wafer type. Rating: PN 10 (min). Body: Cast iron: IS 210 Gr FG260. Stem: Stainless steel Disc: Cast iron.</p> <p><u>NON RETURN VALVE</u> These valves shall be swing check type or dual plate type. Body and disc: Cast iron. Hinge pin and door/disc pin: SS 304. Disc facing ring: SS 304. Body Seat ring: SS 304.</p>
41.2	Corrosive application (CMB and onwards application).	<p><u>Butterfly Valve</u> The butterfly valves shall conform to CL No. 41.1 above except for the following requirements: a) Body shall be lined (minimum 3 mm) with natural rubber, ebonite, polypropylene or PVDF. b) Disc shall be lined with PVDF, Polypropylene or natural rubber. c) Seat rings shall be of Nitrile rubber or Hypalon.</p> <p><u>NON RETURN VALVE</u> These valves shall be swing check type or dual plate type. Body and disc: Cast iron lined (minimum 3 mm) with natural rubber, ebonite, polypropylene or PVDF. Hinge pin and door/disc pin: SS 316L. Disc facing ring: SS 316L. Body Seat ring: SS 316L.</p>
41.3	Acid and alkali service	All parts of the valves shall be SS 316 (except hand wheel).
41.4	ISOLATION GATE (SLUICE GATE)	<p>GATE FRAME & SHUTTER: MILD STEEL IS:2062 Gr 'B' with FRP coated both side. BOTTOM RUBBER SEAL: EPDM RUBBER STEM/SPINDLE: MILD STEEL IS:2062 Gr 'A'. HEADSTOCK: CAST IRON IS :210 FG 200 STEM BLOCK/THRUST NUT: CF8 ASSEMBLY FASTNERS: ASTM A276 TYPE 304 YOKE: MILD STEEL IS:2062 Gr 'A'</p>
42.0	SAFETY EQUIPMENTS	Four sets of safety equipment comprising PVC protection suits with hoods, rubber boots, face visors and thick PVC gauntlets shall also be provided. A personnel water drench shower and eye bath shall be provided.
43.0	FASTENERS	For corrosive application SS 316L (CMB and onwards application). and for normal application SS 316.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

DATA SHEET-A (FOR SEWAGE TREATMENT PLANT)

Sl. No.						
1.0	Capacity of STP	40 m3/day				
2.0	Sewage Sumps (Outside STP Area)					
i)	Description	Sewage Sump S-1	Sewage Sump S-2	Sewage Sump S-3	Sewage Sump S-4	Sewage Sump S-5
ii)	Effective Capacity (m3)	25	60	30	25	20
iii)	MOC	RCC				
iv)	Type	Covered at top, below ground				
v)	Accessories	Coarse bar screen (MOC : SS-304) at each sump location				
vi)	Handrail	To be provided by bidder				
vii)	No. of chain pulley block/electric hoist and capacity	One no EH/manual hoist shall be provided for the outside STP area Pit/sumps pump maintenance.				
3.0	Sewage Transfer Pumps (Outside STP Area)					
i)	Description	Sewage Transfer Pumps for S-1	Sewage Transfer Pumps for S-2	Sewage Transfer Pumps for S-3	Sewage Transfer Pumps for S-4	Sewage Transfer Pumps for S-5
ii)	Number	Two (1W+1S)	Two (1W+1S)	Two (1W+1S)	Two (1W+1S)	Two (1W+1S)
iii)	Capacity (m3/h)	3	3	3	3	3
iv)	Type	Vertical Submersible grinder type				
v)	MOC	CI with SS impellers				
vi)	Head	As per process requirement				
vii)	Particle Size	Up to 20 mm				
viii)	MOC casing	Cast Iron to IS 210 FG 260				
ix)	MOC impeller	Stainless Steel AISI 304				
x)	MOC shaft	SS 410				
4.0	Screen Chamber					
i)	Numbers required	1 no. (1W+0S)				
ii)	Bar screen chamber MOC	RCC				
iii)	Bar screen chamber capacity	As per process requirement				
iv)	Type	Perforated sheet				
v)	Cleaning	Manual				
vi)	Angle of inclination	60°				
vii)	Bar MOC	SS-304 fitted with MS frame				
viii)	Velocity	<1.0 m/sec				



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

ix)	Spacing of bar`	10 mm
5.0 Oil & Grease chamber		
i)	Numbers required	1 no.
ii)	Oil & grease chamber MOC	RCC
iii)	Oil & grease chamber capacity	As per process requirement
iv)	Oil Skimmer	1 no.
v)	Trolley Mounted Drum	1 no.
6.0 Oil & Grease Trap		
i)	Numbers Required	One (1) no.
ii)	Flow (m3/hr)	3 m3/hr
iii)	MOC	RCC with baffle arrangements
iv)	Perforated pipe MOC	PVC/CS
7.0 Equalization Tank		
i)	Numbers Required	1 no.
ii)	Capacity	40 m3/hr
iii)	Detention Time	24 hours (min)
iv)	MOC of Tank	RCC
v)	Depth	2.5 -4.0 m
vi)	Type of Aeration	Coarse Bubble Diffused Aeration Type
vii)	Type of Diffusers	Coarse bubble diffusers with retrievable arrangement
viii)	No. of Diffusers	As per system requirement
ix)	No. of chain pulley block/electric hoist and capacity	One no., chain pulley bock or electrical hoist as per specification requirement, capacity as per specification requirement.
x)	Handrail	To be provided by bidder
8.0 Common Air Blowers for Sludge Sump /Common Collection Sump		
i)	Numbers Required	2 nos. (1W+1S)
ii)	Type of Blower	Twin lobe type
iii)	Flow	To cater Air requirement for Sludge Sump & Common Collection Sump
iv)	Head	As per process requirement
v)	MOC	CI to IS 210 Gr. FG 260
vi)	Accessories	NRV, Pressure Gauge, Safety valves, Silencer, PRV, Filter, etc.
vii)	Common Base plate/ mounting plate	MS as per IS 2062



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

9.0 MBBR Feed Pumps		
i)	Numbers Required	2 nos. (1W+1S)
ii)	Type	Vertical Submersible Grinder type Pumps
iii)	Flow	3.0 m3/hr (min.)
iv)	Head	As per process requirement
v)	MOC	Casing – Cast Iron to IS 210 FG 260 Impeller & shaft - SS304
vi)	Particle Size	Up to 20 mm
10.0 Anoxic Tank		
i)	Numbers Required	One(1) no.
ii)	Flow (m3/hr)	3 m3/hr
iii)	Food to Microorganism(F/M) Ratio	0.1-0.15 Kg BOD/ Kg MLSS/ day
iv)	MLSS (Mixed Liquor Suspended Solids)	3000-6000 mg/l
v)	MOC of Tank	RCC
11.0 Agitator for Anoxic Tank		
i)	Numbers Required	One(1) no.
ii)	Flow (m3/hr)	3 m3/hr
iii)	Food to Microorganism(F/M) Ratio	0.1-0.15 Kg BOD/ Kg MLSS/ day
iv)	MLSS (Mixed Liquor Suspended Solids)	3000-6000 mg/l
v)	MOC of Tank	RCC
12.0 MBBR Reactor		
i)	Numbers Required	One(1) no.
ii)	Flow (m3/hr)	3 m3/hr
iii)	Food to Microorganism(F/M) Ratio	0.1-0.15 Kg BOD/ Kg MLSS/ day
iv)	MLSS (Mixed Liquor Suspended Solids)	3000-6000 mg/l
v)	MOC of Tank	RCC
vi)	Depth	Minimum 4-5 m
vii)	Type of Aeration	Fine Bubble Diffused Aeration Type
viii)	Type of Diffusers	Silicon based fine bubble diffusers with retrievable arrangement
ix)	No. of Diffusers	As per system requirement
x)	Media	PVC
xi)	Media Qty	As per system requirement
xii)	Free Board	500 mm
xiii)	Volume (in m3)	As per process requirement
13.0 RAS Pump (For recirculation of activated sludge)		
i)	Quantity	Two (2X100%) nos. (1W+1S)
ii)	Type & Operation	Horizontal Centrifugal, Continuous
iii)	Suction condition	Flooded.
iv)	Capacity	As per process requirement



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

v)	Head	As per process requirement
vi)	Material of Construction	
	• Casing	Cast Iron IS:210 Gr FG 260
	• Impeller	Stainless steel CF 8M
	• Shaft & Shaft sleeve material	Stainless steel SS Gr. 304 & SS316
	• Packing seal	Mechanical type
	• Common base plate	Carbon steel IS:2062
vii)	Noise level	85 DBA
viii)	Vibration	As per HIS
ix)	RPM	As per requirement
x)	Interconnecting Piping Material	Carbon Steel with Rubber lining.
14.0 Air Blowers for MBBR Tank & PSF		
i)	Numbers Required	2 nos. (1W+1S)
ii)	Type of Blower	Twin lobe type
iii)	Flow	To cater Air requirement for aeration
iv)	Head	As per process requirements
v)	MOC	CI to IS 210 Gr. FG 260
vi)	Accessories	NRV, Pressure Gauge, Safety valves, Silencer, PRV, Filter etc.
viii)	Common Base plate/ mounting plate	MS as per IS 2062
14.0 Tube settler / Lamella Clarifier		
i)	Numbers Required	One (1) no.
ii)	Flow (m ³ /hr)	3 m ³ /hr (min)
iii)	Surface flow rate	3 m ³ / m ² /hr.
iv)	MOC of settler	RCC
iv)	Quantity of tube settler media	As per process requirement
v)	MOC of media	PVC
vi)	Free board	500 mm
15.0 Filter Feed Tank		
i)	Numbers Required	One (1) no.
ii)	Capacity	As per Process requirement
iii)	MOC	RCC
iv)	Handrail	To be provided by bidder
16.0 Hypo Dosing System		
16.1 Hypo Dosing Tank		
i)	Numbers Required	One (1) no. (For Hypo contact Filter Feed tank/Treated Water Tank)
ii)	Capacity	As per process requirement. 200 liters OR 24 hour storage requirement @ suitable dosing rate whichever is higher
iii)	MOC	HDPE
iv)	Agitator	One no of MOC : SS-316



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

16.2	Hypo Dosing Pump	
i)	Quantity	Two (2) no. (1W + 1S for Hypo contact Filter Feed tank/Treated Water Tank)
ii)	Capacity	As per process requirement. 0-6 LPH or 2 ppm continuous dosing rate requirement whichever is higher
iii)	Type	Positive Displacement Plunger Type.
iv)	Make	As per approved vendor
iv)	MOC	PP
17.0	Polyelectrolyte Dosing System	
	Polyelectrolyte Dosing Tank	
i)	Numbers Required	One (1) no. (For Filter Feed water tank/Treated Water Tank & Centrifuge)
ii)	Capacity	As per process requirement. 200 liters OR 24 hour storage requirement @ suitable dosing rate whichever is higher
iii)	MOC	MSRL
iv)	Agitator	One no of MOC : SS-316
	Polyelectrolyte Dosing Pump	
i)	Quantity	Two (2) no. (1W + 1S for For Filter Feed water tank/Treated Water Tank & Centrifuge)
ii)	Capacity	As per process requirement. 0-6 LPH or 2 ppm continuous dosing rate requirement whichever is higher
iii)	Type	Positive Displacement Plunger Type.
iv)	Make	As per approved vendor
iv)	MOC	PP
18.0	Filter Feed Pumps	
i)	Quantity	Two (2X100%) nos. (1W+1S)
ii)	Type & Operation	Horizontal Centrifugal, Continuous
iii)	Suction condition	Flooded.
iv)	Capacity	3.0 m ³ /hr / as per process requirement
v)	Head	As per process requirement
vi)	Material of Construction	
	• Casing	Cast Iron IS:210 Gr FG 260
	• Impeller	Stainless steel CF 8M
	• Shaft & Shaft sleeve material	Stainless steel SS Gr. 304 & SS316
	• Packing seal	Mechanical type
	• Drive motor	Induction motor, 415V, 3 Φ, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615
	• Common base plate	Carbon steel IS:2062
vii)	Noise level	85 DBA
viii)	Vibration	As per HIS
ix)	RPM	1500 approx.
x)	Drive motor	Induction Motor 415V, 3 Phase, 50 Hz, TEFC, Energy Efficiency Class IE-3 as per IS : 12615
xi)	Interconnecting Piping Material	Carbon Steel with Rubber lining.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

19.0 Pressure Sand Filter		
i)	Quantity	1 no.
ii)	Capacity	3 m3/hr.
iii)	Surface flow rate	10 m3/hr./m2
iv)	Size	As per process requirement
v)	Design pressure	Shut off head of pump + 5% margin
vi)	MOC	Epoxy Coated carbon steel
vii)	Media	Graded quartz sand free from carbonates/other foreign material and Anthracite.
viii)	Rising Space(Free board)	100 %
ix)	Make	As per approved vendor
20.0 Activated Carbon Filter		
i)	Quantity	1 no.
ii)	Capacity	3 m3/hr.
iii)	Surface flow rate	15 m3/hr./m2
iv)	Size	As per process requirement
v)	Design pressure	Shut off head of pump + 5% margin
vi)	MOC (Shell & Dish)	Epoxy Coated carbon steel
vii)	Media	Activated Carbon
viii)	Supporting Media	Graded Gravel
ix)	Minimum Bed depth	1200 mm
x)	Rising Space(Free board)	100 %
21.0 Treated Water Tank		
i)	Number required	1 no.
ii)	Capacity (Effective)	As per system requirement
iii)	Flow	3 m3/hr (min)
iv)	Detention Time	4 Hrs.
v)	MOC of tank	RCC
vi)	Depth	2.5 m- 4 m
vii)	Handrail	To be provided by bidder
22.0 Treated Water Disposal Pumps		
i)	Quantity	Two (2) nos. (1W+1S) 100%
ii)	Type & Operation	Horizontal Centrifugal, Continuous
iii)	Suction condition	Flooded.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

iv)	Capacity	3.0 m3/hr.
v)	Head	As per process requirement
vi)	Material of Construction	
	• Casing	Cast Iron IS:210 Gr FG 260
	• Impeller	Stainless steel CF 8M
	• Shaft & Shaft sleeve material	Stainless steel SS Gr. 304 & SS316
	• Packing seal	Mechanical type
	• Common base plate	Carbon steel IS:2062
vii)	Noise level	85 DBA
viii)	Vibration	As per HIS
ix)	RPM	1480
x)	Interconnecting Piping Material	Carbon Steel with Rubber lining.
23.0	Sludge Sump	
i)	Number required	1 no.
ii)	MOC & type	RCC, Under Ground, Outdoor Location
iii)	Capacity (Effective)	As per Process requirement
iv)	Instrumentation	Level Switch with indication on Panel /As per P&ID
v)	Inside Protection	5 mm thick coal tar epoxy screened lining
vi)	No. of chain pulley block/electric hoist and capacity	One no., chain pulley block or electrical hoist as per specification requirement, capacity as per specification requirement.
vii)	Handrail	To be provided by bidder
24.0	Sludge transfer Pumps	
i)	Quantity	Two (2) nos. (1W+1S) 100%
ii)	Type	Vertical/Horizontal Screw Pumps
iii)	Location	Outdoor
iv)	Service	Intermittent
v)	Suction condition	Flooded.
vi)	Rated Flow	As per process requirement approx. 3 m3/hr whichever is higher.
vii)	Head	As per process requirement
viii)	Type of fluid handled	Sludge from Clarifier
ix)	Material of Construction	
	• Casing	2% Ni-CI to IS:210 Gr FG 260
	• Rotor	SS-316
	• Stator	Nitrile/EPDM
	• Shaft	SS-316
x)	Noise level	85 DBA
xi)	Vibration	As per HIS
xii)	RPM	1500 Approx.
25.0	Centrifuge	



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00

DATE:

i)	Quantity	Two (2) numbers
ii)	Type	Decanter
iii)	Inlet concentration	2% / As per Process Requirements
iv)	Outlet concentration	20% (min.)
v)	Capacity	As per process requirements
vi)	Liquid handled	Secondary sludge
vii)	Material of construction	Wetted parts: SS304 Other parts : MSEP/CI
viii)	Base Frame	MS Fabricated
ix)	Accessories	Screening at inlet, Suitable piping, valves, pressure gauge at delivery pulley, V-belt drive, foundation bolts etc.
x)	Sludge handling trolley	2 nos. (MOC: MSEP) for manual disposal of sludge cake.
26.0	PIPE MATERIAL: Pipe handling sewage will be Heavy Duty UPVC and air application of MOC GI only. Filtered Water & service water shall be IS-2062 Gr. B/ASTM-A-36/ASTM A-53 type 'E' Gr. B/IS-3589 Gr. 410/IS-1239 Heavy, 150 NB & above pipes shall be spiral welded.	
27.0	VALVES MATERIAL: All valves shall be of CPVC, PN 10.	
28.0	SAFETY EQUIPMENTS: Four sets of safety equipment comprising PVC protection suits with hoods, rubber boots, face visors and thick PVC gauntlets shall also be provided. A personnel water drench shower and eye bath shall be provided.	



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00 DATE:

SECTION – C2

(SPECIFIC TECHNICAL REQUIREMENTS FOR ELECTRICAL)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001


VOLUME: II-B


SECTION: C

REV NO: 00 DATE:

ELECTRICAL EQUIPMENT SPECIFICATION

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

	TITLE:	SPECIFICATION NO.
	ELECTRICAL EQUIPMENT SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT	
	2 X 660 MW UDANGUDI STPP STAGE-I	VOLUME NO. : II-B
		SECTION: C
		REV NO. : 00 DATE: 04/01/2021
		SHEET: 1 OF 2
<p>SPECIFIC TECHNICAL REQUIREMENTS:</p> <p>1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:</p> <p>The equipment and services to be provided by bidder under this specification shall be as detailed here below but shall not be limited to the following:</p> <ol style="list-style-type: none"> Services and Equipment as per “Electrical Scope between BHEL and Vendor”. Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The bidder without any extra charge shall provide the same. Supply of mandatory spares as specified in the specifications of mechanical equipments. Electrical load requirement for Effluent Treatment Plant & Sewage Treatment Plant. All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information. Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer / BHEL approval without any commercial and delivery implications to BHEL. Various drawings including GA drg, data sheet as per required format, quality plans, calculations, test reports, test certificates, operation and maintenance manuals, characteristic curves, wiring diagrams/schemes etc. shall be furnished as specified at contract stage. All documents shall be subject to customer / BHEL approval without any commercial implications to BHEL. The sub-vendor list for various electrical items is subject to BHEL/Customer approval without any commercial implications. Motors shall meet minimum requirement of Electric motor specification. Purchaser will furnish data sheets to the vendor after award of contract. Vendor shall furnish filled in data sheets meeting the specification requirements. Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL. Cable BOQ worked out based on routing of cable listing provided by the vendor for “both end equipment in vendor’s scope” shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages. <p>2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS: Refer “Electrical Scope between BHEL and Vendor”.</p> <p>3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID</p>		

	TITLE: ELECTRICAL EQUIPMENT SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT 2 X 660 MW UDANGUDI STPP STAGE-I	SPECIFICATION NO.
		VOLUME NO. : II-B
		SECTION: C
		REV NO. : 00 DATE: 04/01/2021
		SHEET: 2 OF 2
<p>3.1 Bidder shall confirm total compliance to the electrical specification without any deviation from the technical / quality assurance requirements stipulated. In line with this, the bidder as technical offer shall furnish two signed and stamped copies of the following:</p> <p>3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.</p> <p>4.0 LIST OF ENCLOSURES</p> <p>4.1 Electrical scope between BHEL & vendor</p> <p>4.2 Technical specification – Specification for Electric Motors/Actuators</p> <p>4.3 Standard Technical specification – LV Motors</p> <p>4.4 Datasheets & quality plan for motors.</p> <p>4.5 Load Data Format. (Annexure – II)</p> <p>4.6 BHEL Cable listing format (Annexure – III)</p>		



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

ELECTRICAL LOAD FORMAT

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00 DATE:

ELECTRICAL SCOPE FOR VENDOR AND BHEL

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

REV-0, DATE: 07.01.2020

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)**PACKAGE: EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT****SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT****PROJECT: 2 X 660 MW UDANGUDI STPP STAGE-I**

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	415V MCC	BHEL	BHEL	415 V AC, 3 phase, 3 wire supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motor.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL Vendor BHEL	1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by Vendor.
4	Junction box for control & instrumentation cable	Vendor	Vendor	Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 10-12 mtrs) and trunk cable.
5	Any special type of cable like compensating, co-axial, prefab, MICC, optical fibre etc.	Vendor	Vendor	Refer C&I portion of specification for scope of fibre Optical cables if used between PLC/ microprocessor & DCS.
6	Cable trays, accessories & cable trays supporting system 100/ 50 mm cable trays/ Conduits/ Galvanised steel cable troughs for local cabling	BHEL Vendor	BHEL Vendor	Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs, as per approved layout drawing during contract stage. However, any steel structure required for mounting of cable tray support shall be in vendor's scope.
7	Cable glands ,lugs and bimetallic strip for equipment supplied by Vendor	Vendor	Vendor	1. Double compression Ni-Cr plated brass cable glands 2. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
8	Conduit and conduit accessories for cabling between equipment supplied by vendor	Vendor	Vendor	Conduits shall be medium duty, hot dip galvanised cold rolled mild steel rigid conduit as per IS: 9537.
9	Lighting	BHEL	BHEL	
10	Equipment grounding (including electronic earthing) & lightning protection	BHEL	BHEL	Refer note no. 4 for electronic earthing
11	Below grade grounding	BHEL	BHEL	
12	LT Motors with base plate and foundation hardware	Vendor	Vendor	Makes shall be subject to customer/ BHEL approval at contract stage.

REV-0, DATE: 07.01.2020

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)**PACKAGE: EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT****SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT****PROJECT: 2 X 660 MW UDANGUDI STPP STAGE-I**

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
13	Mandatory spares	Vendor	-	Vendor to quote as per specification.
14	Recommended O & M spares	Vendor	-	As specified elsewhere in specification
15	Any other equipment/ material/ service required for completeness of system based on system offered by the vendor (to ensure trouble free and efficient operation of the system).	Vendor	Vendor	
16	a) Input cable schedules (Control & Screened Control Cables) b) Cable interconnection details for above c) Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for Control and Instrumentation Cable and electronic earthing cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.
17	Electrical Equipment & cable tray layout drawings	Vendor	-	For ensuring cabling requirements are met, vendor shall furnish Electrical equipment layout & cable tray layout drawings (both in print form as well as in AUTOCAD) of the complete plant (including electrical area) indicating location and identification of all equipment requiring cabling, and shall incorporate cable trays routing details marked on the drawing as per PEM interface comments. Cabling arrangement of the same (wherever overhead cable trays, trenches, cable ducts, conduits etc.) shall be decided during contract stage. Electrical equipment layout & cable tray layout drawing shall be subjected to BHEL/ customer approval without any commercial implications to BHEL.
18	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.
3. In case the requirement of Junction Box arises on account of Power Cable size mis-match due to vendor engineering at later stage, vendor shall supply the Junction Box for suitable termination.
4. Vendor shall indicate location of Electronic Earth pit in their Civil assignment drawing.



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: C

REV NO: 00 DATE:

SECTION – C3

(SPECIFIC TECHNICAL REQUIREMENTS FOR C&I)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



**C&I SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

SECTION: C
SUB SECTION: C&I

**C&I SPECIFIC TECHNICAL REQUIREMENT
FOR DCS BASED
EFFLUENT TREATMENT PLANT**



**C&I SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

SECTION: C
SUB SECTION: C&I

Specific Technical Requirements (C&I):

1. Effluent Treatment Plant (ETP) shall be operated from DCS (BHEL's scope).
2. The Contractor shall provide complete Instrumentation for control, monitoring and operation of entire ETP. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre- bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of customer shall prevail without any commercial implication.
3. The make/model of various instruments/items/systems shall be as per customer's approved vendor list. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
4. All instruments and control elements shall be terminated on JB/LCP in field and both instrument and JB/LCP are in bidder scope. Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 12-15 mtrs) and trunk cable.
5. For cable scope refer to electrical scope between BHEL and vendor defined in electrical specification.
6. Bidder to provide mandatory spares as per mandatory spares list.
7. Electrical Actuators with integral starter shall be provided for all on/off and inching type valves along with necessary interface units for linking to corresponding Control System as applicable, typical Hook-up diagram of drives is included for reference.
8. The specifications for instruments mentioned in the specification are minimum requirements. The detail specifications shall be finalized during detail engineering.
9. The bidders shall specifically mention any deviation they would like to take on the C&I specification. In absence of only deviation, a No deviation certificate is to be furnished.
10. The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.
11. Bidder to terminate all instrumentation and control elements in junction boxes. Bidder to provide input/output list, drives list, junction box schedule and termination details, recommended control logics / write-up etc. the list of documents to be submitted after award of contract is to be referred by bidder.



**C&I SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

SECTION: C
SUB SECTION: C&I

12. All the transmitters supplied by Bidder shall be rack mounted. The transmitter racks shall be in Bidder's scope of supply. All transmitters shall be HART compatible.
13. Bidder to perform tests of C&I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to perform by Bidder without any cost implication. The make/model of various instruments/items/systems shall be as per customer/BHEL approved vendor list. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
14. Instrument installation and accessories required for the same shall be in Bidder's scope and shall be submitted after award of contract. However, any instrument/ analyser installation not covered in the same shall be subject to customer and BHEL approval during detailed engineering.
15. Bidder to furnish electrical load/UPS load data during detailed engineering.
16. UPS Power supply shall be provided by BHEL at a single point, further distribution to various instruments/equipment of the system shall be in bidder scope. Bidder to include necessary power distribution board in his scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
17. Bidder's presence is required for 3 Man days (Excluding travel time) at EDN Bangalore during FAT of DDCMIS for certifying correctness & completeness of implementation of Control logic. Intimation to attained FAT shall be informed in 2 days advance. All the expenses like boarding, lodging and travel, Air fare etc. shall be in bidder's scope.
18. Bidder's presence is required for 9 Man days (in three visit) at site during commissioning of DDCMIS for assistance related to process correctness. Three visit with total 15 Man days (Excluding travel time) in which one visit shall be of 3 Man days each. All the expenses like boarding, lodging and travel, Air fare etc. shall be in bidder's scope.
19. Contractor shall furnish Instrument Schedule, I/O list, Drive list, Cable Schedule, Cable interconnection (DCS end terminal details shall be provided to vendor during detail engineering to incorporate in cable interconnection), JB grouping, Annunciation list, SOE list, List of Instruments/devices for HART in BHEL approved format. Also reusable database format like MS Excel, MS Access etc. of these documents shall also be provided by Contractor in BHEL approved format. Soft copy of the formats shall be provided to the successful bidder.
20. Interface of MCC, HT SWGR, Solenoid valves, field instruments, Actuators etc. with DDCMIS based control system shall be as per Drive Control Philosophy enclosed in specification.
21. Local control panel if any required for operation shall be in bidder scope.



**C&I SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

SECTION: C
SUB SECTION: C&I

22. The solenoid operated valves/Dampers/Gate shall have a limit switch for open/close feedback. Solenoid Valve shall be rated for 24V Dc only.
23. All field instruments enclosure shall be IP65 local panel/cabinet enclosure shall be IP 55, unless otherwise specified.
24. Diaphragm seal shall be provided with Instruments having contact with corrosive media.
25. Redundancy of sensors shall be provided by bidder
 - (i) Triple redundancy for all analog and binary inputs required for protection of system/drives.
 - (ii) For all other control functions dual redundancy of the sensors shall be provided by the bidder.
26. Double root valve shall be provided for all pressure tapings where the pressure exceeds 40kg/cm².
27. Use of process actuated shall be avoided unless unavoidable.
28. Number of pairs to be selected for Screen /Control cable
 - a) F-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - b) G-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - c) Core Cable: 3CX2.5sqmm²/ 5CX2.5sqmm²/ 12CX1.5sqmm²
29. Instrument installation shall be as per the attached "Standard Hook-up diagram of instrument."
30. In addition to requirements specified here, all C&I systems/ sub-systems/ equipment/ devices shall also meet other requirements stipulated under other Sub-sections/ parts/ sections of specification.
31. In case of any conflict and repetition of clauses in the specification, BHEL discretion will prevail.
32. All the outdoor field instruments such as analysers/transmitters/meters etc. shall be provided with suitable Free standing cabinet(s)/panel/rack so that the equipment are protected against rain/ sunlight etc.
33. Material described in the specification (for instrument, equipment, accessories etc.) are the minimum requirements, which shall be complied by bidder. Any other better material shall also be considered to suit the process and environmental conditions at site subject to owner's approval. Material, if found not suitable shall be changed without any price implication.
34. Painting Process/procedure & Painting material shall be suitable for sea water and saline conditions at site in line with national and international standards like ASTM, ISO etc.
35. Epoxy coated painting is required for all I & C Equipment & Instruments.

NOTE-1: The overall operation & control of entire ETP shall be through standalone control system of DDCMIS family, located in ETP Control Room near Central Monitoring Basin (CMB). Other sumps outside ETP area shall be controlled from nearby control system (BHEL scope).

Note-2: DCS/DDCMIS is in BHEL scope of supply.

	2x660 MW UDANGUDI STPP (UNIT#1&2)	
	TECHNICAL SPECIFICATION (C&I) FOR SEWAGE TREATMENT PLANT	
SPECIFIC TECHNICAL REQUIREMENTS (C&I)		

SPECIFIC C&I TECHNICAL REQUIREMENTS
FOR SEWAGE TREATMENT PLANT
FOR 2X660 MW UDANGUDI STPP

SPECIFIC TECHNICAL REQUIREMENTS (C&I)

- 1.1 Sewage treatment plant (STP) shall be operated from DCS (BHEL Scope) through operator work stations located in the local control room.
- 1.2 The Contractor shall provide complete Instrumentation for control, monitoring and operation of entire STP. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same or different section, the more stringent requirement as per interpretation of BHEL/customer shall prevail without any commercial implication.
- 1.3 The make/model of various instruments/items/systems shall be subject to approval of BHEL/Customer. The Vendor list/ sub-vendor list shall be subject to BHEL / Customer approval during contract stage. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
- 1.4 Number of pairs to be selected for instrumentation cables (Size: 0.5 mm²):
G type: 2P/4P/8P/12P
F type: 4P/8P/12P/20P
Core Cable: 3CX2.5mm²/ 12CX1.5mm²/ 5CX1.5mm²
(tentative).

For cable scope, please refer 'Electrical scope between BHEL and vendor' in electrical portion of the technical specification.
- 1.5 Drawings/Documents and data to be furnished after award of contract as per deliverables list attached elsewhere in the specification.
- 1.6 Bidder to provide mandatory spares as per List of Mandatory Spares attached in the specification.
- 1.7 The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price/ time implication.
- 1.8 All instruments and control elements shall be terminated on junction boxes/local panel in field and both instrument and JB/Local panel are in bidder scope. Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 12-15 mtrs.) and trunk cable.

SPECIFIC C&I TECHNICAL REQUIREMENTS
FOR SEWAGE TREATMENT PLANT
FOR 2X660 MW UDANGUDI STPP

- 1.9 Instrument installation shall be as per the attached 'Instrument installation drawings' attached in the specification. Instrument installation and accessories required for the same shall be in Bidder's scope and shall be submitted after award of contract. However, any instrument installation not covered in the same shall be subject to customer and BHEL approval during detailed engineering.
- 1.10 All local gauges as well as transmitters and sensors for parameters like pressure, temperature, flow etc. as required for the safe and efficient operation and maintenance under the scope of specification shall be provided. The necessary root valves, impulse piping, drain cock, gauge-zeroing cocks, valve manifolds, instrument racks and all the other accessories required for mounting / erection of these local instruments, transmitters and sensors shall be supplied by bidder even if not specifically asked for. Also the proposal shall include the necessary cables, flexible conduits, instrument racks, junction boxes and accessories for the above purpose.
- 1.11 Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kg / cm².
- 1.12 All local gauges, transmitters and sensors shall be mounted on suitable enclosures, Instrument racks (LIR) in bidder's scope subject to Customer's approval. All the transmitters supplied by Bidder shall be LIR mounted. The transmitter racks/ enclosure shall be in Bidder's scope of supply. The contacts of equipment mounted instruments, sensors etc. for external connection including spare contacts shall be wired out to suitably located junction boxes by bidder.
- 1.13 Use of process actuated switches shall be avoided.
- 1.14 Bidder to perform tests of C&I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to be performed by Bidder without any cost implication.
- 1.15 Local panel required for operation shall be in bidder scope of supply.
- 1.16 Push buttons and indication lamps for Open/Close and Start/Stop of drives/equipment's shall be provided on the local panel. Remote and local indication, indicating lamps / LED cluster for instruments/drives/equipment's status and critical alarms shall be provided on the local panel. Nos. shall be decided during detailed engineering.
- 1.17 All field instruments shall be weatherproof, drip tight, dust tight and splash proof suitable for use under outdoor ambient conditions prevalent in the subject plant. All field-mounted instruments shall be mounted in suitable locations where maximum accessibility for maintenance is achieved. All transmitters & electronics items will be explosion proof / intrinsically safe as per hazardous area classification. An anticorrosive paint shall be applied to the field mounted enclosures / instruments

SPECIFIC C&I TECHNICAL REQUIREMENTS
FOR SEWAGE TREATMENT PLANT
FOR 2X660 MW UDANGUDI STPP

suitable for sea water and saline conditions at site. All the field instruments shall also be provided with SS tag nameplate and double compression type Nickel-plated brass cable gland. Gaskets, Fasteners, Counter and mounting flange shall also be included wherever required with the field instruments.

- 1.18 Epoxy coated painting is required for all I & C equipment.
- 1.19 Painting process / procedure and painting material shall be suitable for sea water and saline conditions at site in line with national and international standards like ASTM, ISO etc.
- 1.20 Electrical actuators with integral starter shall be provided for all ON/OFF and inching type valves along with necessary interface units for linking to corresponding control system as applicable, typical hook-up diagram of drives is included for reference. Non-contact type electronic 2-wire position transmitters shall be provided for all inching type motorized valves and dampers. The detailed specification of actuator is given elsewhere in the specification.
- 1.21 Differential pressure indicators & Differential pressure Transmitters shall be provided with independent impulse & isolation valves. Remote & Local indication DP transmitters & gauge shall be provided.
- 1.22 All Temperature sensors shall be Duplex type and temperature transmitters shall be provided for all temperature measuring applications.
- 1.23 All the instruments PG/DPG/DPIT/PT/LT etc. as applicable shall have chemical/diaphragm seal having 15m capillary length minimum.
- 1.24 The solenoid operated valves / dampers / gate shall have a limit switch for open/ close feedback. Solenoid valve shall be rated for 24V DC only.
- 1.25 Bidder to furnish electrical load/UPS load data during detailed engineering.
- 1.26 All the instruments/equipment's/electrical items shall be provided & designed with maximum star rating as available in line with energy conservation policies notified by BEE, GOI at the time of supply.
- 1.27 All primary instruments shall be with protection class of IP 65 or better.
- 1.28 All field instruments enclosure shall be IP 65, Local panel/ cabinet enclosure shall be IP 55, unless otherwise specified.
- 1.29 Transmitter should not be mounted directly on the manifold; Manifold shall be non-integral and standalone type.
- 1.30 LVDT type instrument is not acceptable.

SPECIFIC C&I TECHNICAL REQUIREMENTS
FOR SEWAGE TREATMENT PLANT
FOR 2X660 MW UDANGUDI STPP

- 1.31 All limit switch shall be conforming to IEC-60947-5-1.
- 1.32 Each switching element including the limit and torque switches of valve actuators shall be provided with minimum two SPDT OR DPDT contacts each for close, open and adjustable.
- 1.33 All transmitters shall be smart and electronic type, microprocessor based and HART compatible. All instruments should be supplied with valid calibration and test certificates provided by OEM.
- 1.34 For plug in type instruments, the plug & sockets shall be polarized to prevent wrong connections and have facility for secure coupling in plug-in position to prevent loose connections.
- 1.35 Bidder shall provide Ultrasonic/Radar type level transmitters depending upon the functional suitability for different sumps.
- 1.36 Interface of MCC, HT SWGR, solenoid valves, field instruments, actuators etc. with DDCMIS based control system shall be as per Drive Control Philosophy enclosed in specification.
- 1.37 Power Supply Requirement:
 415 V, 3 phase AC power supply shall be provided at a single point. Further any electrical distribution shall be in bidder's scope. Bidder to include necessary power distribution board, changeover circuit in his scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
- 1.38 Bidder must offer general tools and tackles and special calibration instruments required during start-up, trial run, operation and maintenance of the system.
- 1.39 The technical requirements for instruments/ equipment's/panels mentioned in the specification are minimum requirements. Items not specifically mentioned and required for the completeness of the system shall be supplied by bidder.

2.0 **Requirements for flanged remote seal diaphragm:**

Maximum pressure rating: To meet 200 percent of process pressure,
 Availability of seals: for both high and low pressure sides with capillary connection in case of differential pressure measurements.
 Single Capillary connection for pressure transmitters.
 Capillary length: 15.0 m
 Fill fluid: Suitable oil
 Process connection size: 1 inch

SPECIFIC C&I TECHNICAL REQUIREMENTS
FOR SEWAGE TREATMENT PLANT
FOR 2X660 MW UDANGUDI STPP

Flange size and Accessories: As per process requirement.

Flange pressure rating: Required Class (ANSI)

Process fluid temperature: 25°C to 60°C

Diaphragm and wetted part material: Suitable for sea water (Duplex SS or better)

Flushing option: To be made available with 1/4 inch (necessary drain and gasket suitable for sea water application to be provided).

Snubbers /Pulsation dampeners shall be used where the process media is unstable for measurement such as the discharge of a pump.

NOTE-1: Sewage transfer pumps installed in various sewage lifting sumps located outside boundary of STP area shall be controlled through self-standing local control panel. Self-standing local control panel shall be in bidder's scope.

NOTE-2: DCS/DDCMIS is in BHEL scop of supply.




**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

P&ID FOR EFFLUENT TREATMENT PLANT

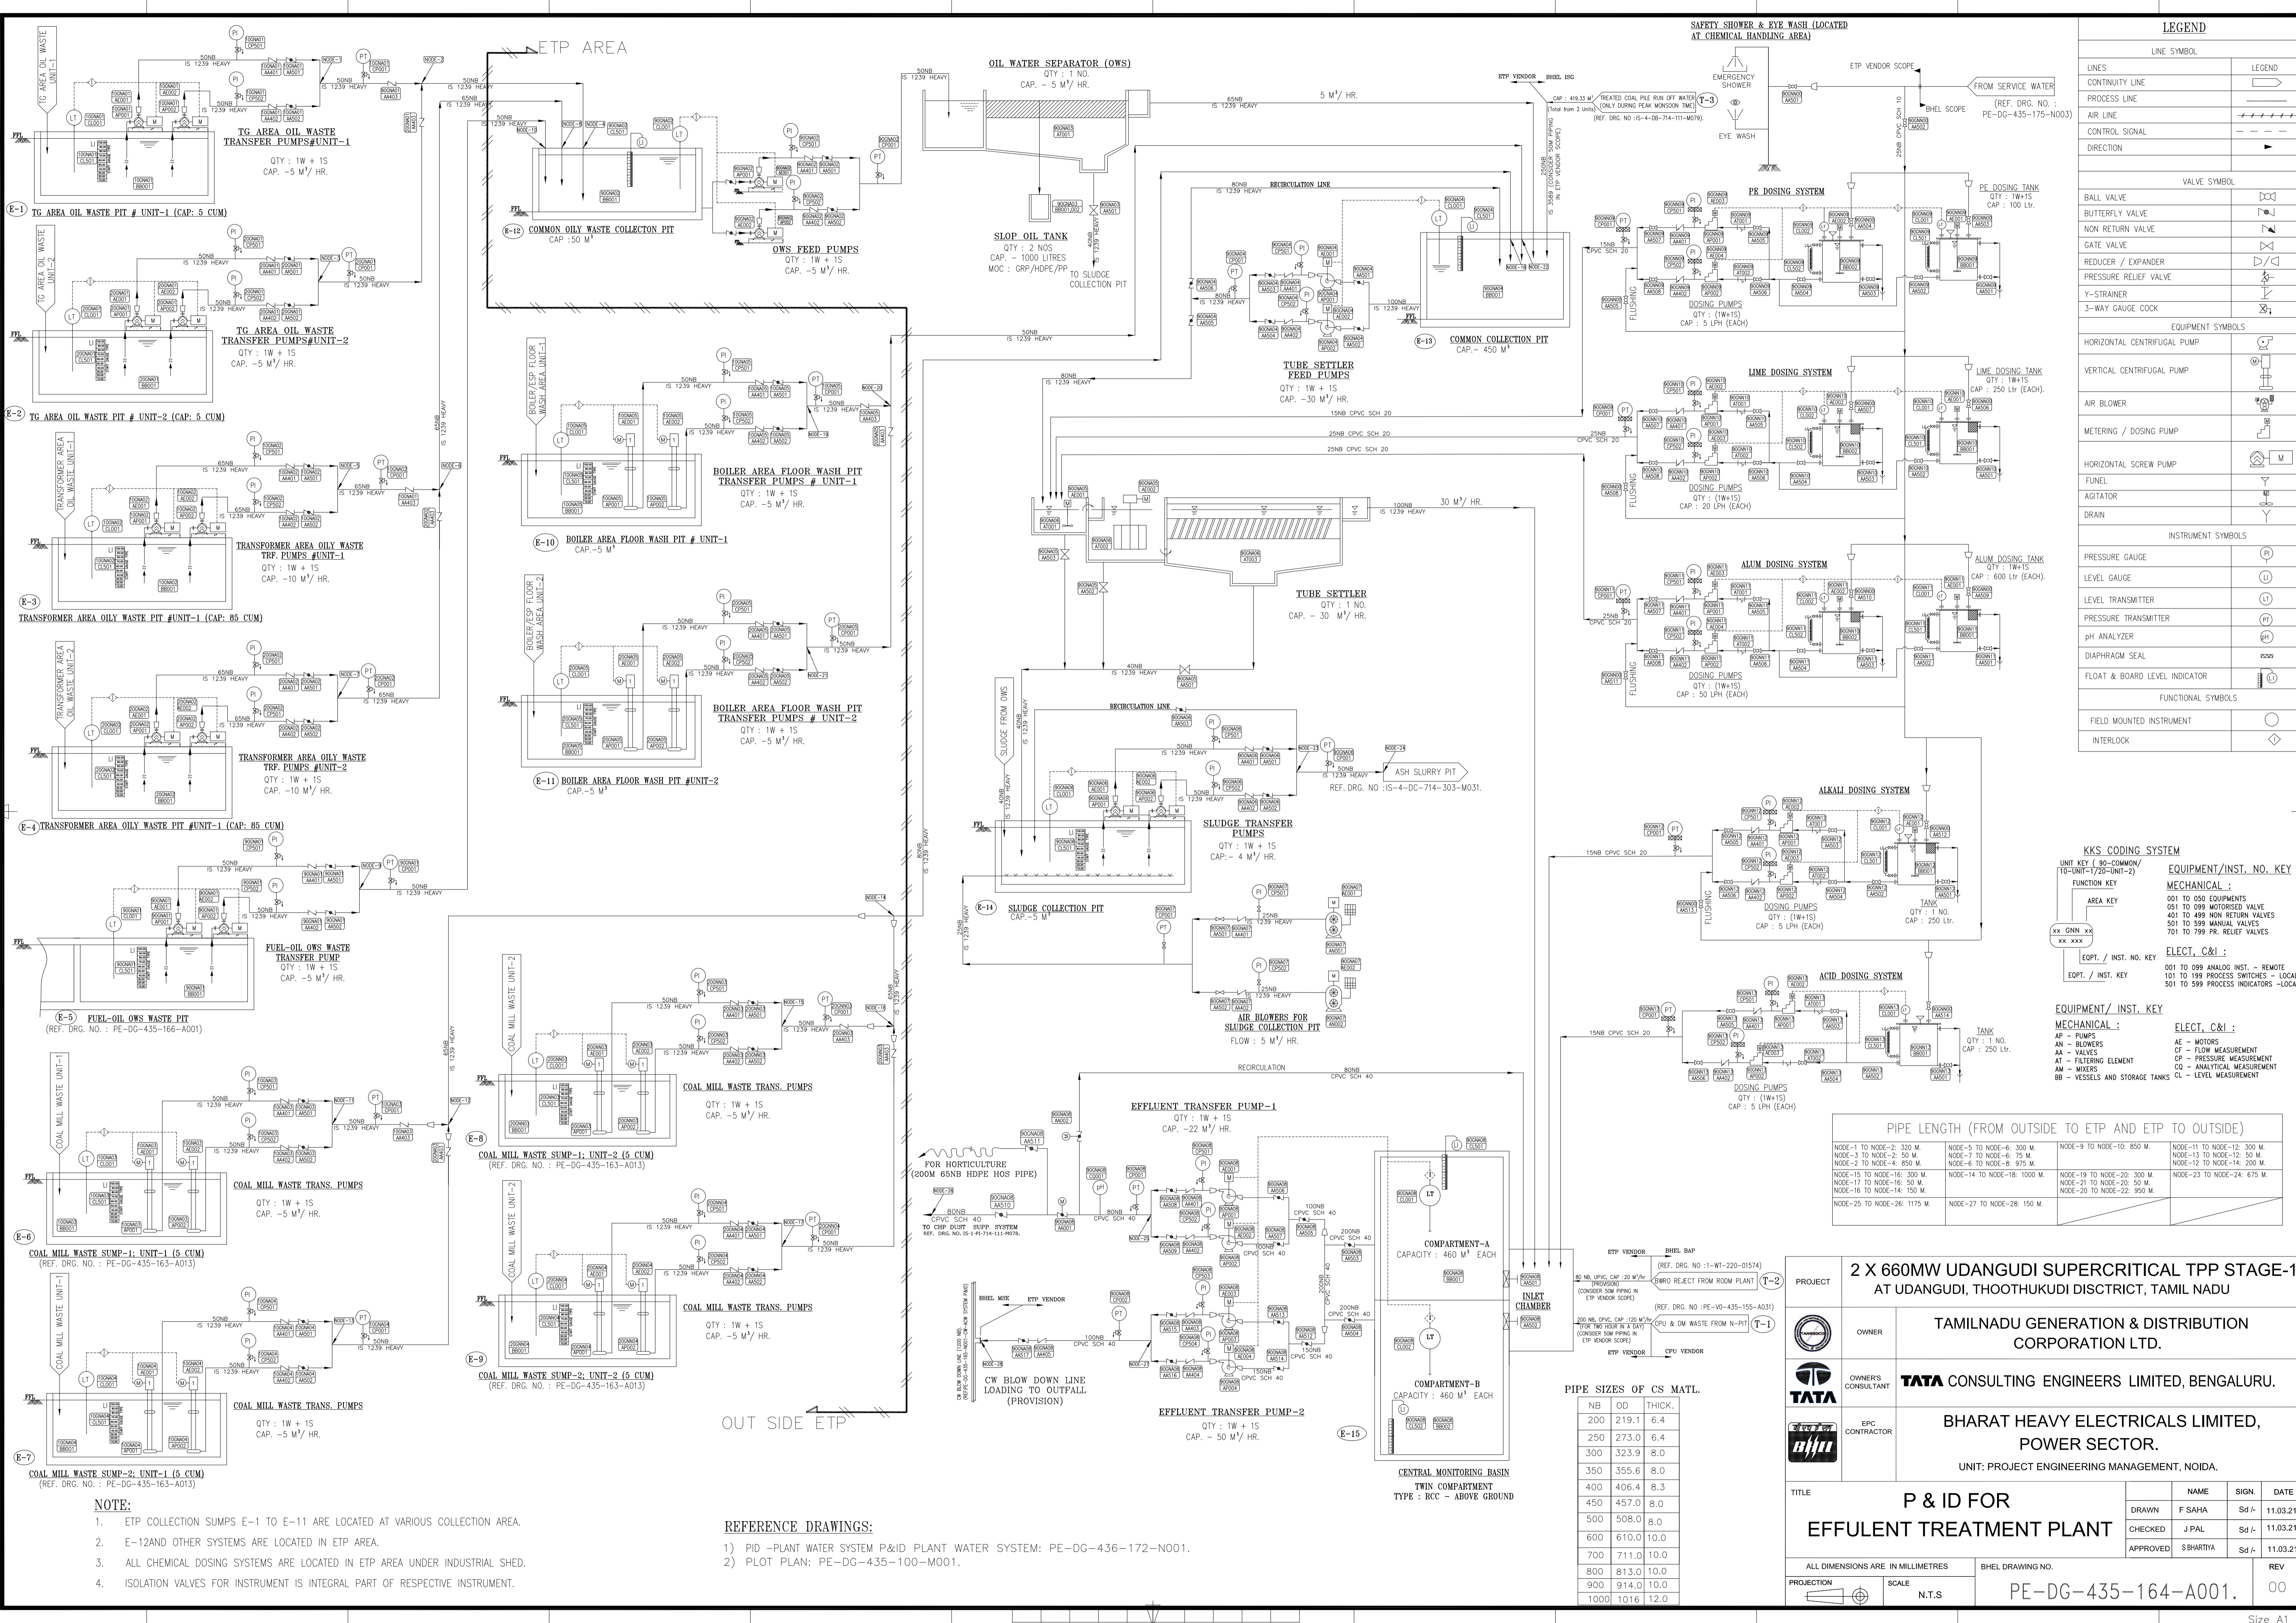

LEGEND	
LINE SYMBOL	
LINES	CONTINUITY LINE
PROCESS LINE	AIR LINE
CONTROL SIGNAL	DIRECTION
VALVE SYMBOL	
BALL VALVE	BUTTERFLY VALVE
NON RETURN VALVE	GATE VALVE
REDUCER / EXPANDER	PRESSURE RELIEF VALVE
Y-STRAINER	3-WAY GAUGE COCK
EQUIPMENT SYMBOLS	
HORIZONTAL CENTRIFUGAL PUMP	VERTICAL CENTRIFUGAL PUMP
AIR BLOWER	METERING / DOSING PUMP
HORIZONTAL SCREW PUMP	FUNNEL
AGITATOR	DRAIN
INSTRUMENT SYMBOLS	
PRESSURE GAUGE	LEVEL GAUGE
LEVEL TRANSMITTER	PRESSURE TRANSMITTER
pH ANALYZER	DIAPHRAGM SEAL
FLOAT & BOARD LEVEL INDICATOR	
FUNCTIONAL SYMBOLS	
FIELD MOUNTED INSTRUMENT	INTERLOCK

KKS CODING SYSTEM	
UNIT KEY: 90-COMMON/10-UNIT-1/20-UNIT-2	EQUIPMENT/INST. NO. KEY
FUNCTION KEY	MECHANICAL:
AREA KEY	001 TO 050 EQUIPMENTS
	051 TO 099 MOTORISED VALVE
	100 TO 149 NON RETURN VALVES
	150 TO 199 MANUAL VALVES
	200 TO 249 RELIEF VALVES
	250 TO 299 PR. RELIEF VALVES
	300 TO 349 INSTRUMENTS
	350 TO 399 ELECTRICAL INSTRUMENTS
	400 TO 449 LOCAL ELECTRICAL INSTRUMENTS
	450 TO 499 REMOTE ELECTRICAL INSTRUMENTS
	500 TO 549 LOCAL ELECTRICAL INSTRUMENTS
	550 TO 599 REMOTE ELECTRICAL INSTRUMENTS
	600 TO 649 LOCAL ELECTRICAL INSTRUMENTS
	650 TO 699 REMOTE ELECTRICAL INSTRUMENTS
	700 TO 749 LOCAL ELECTRICAL INSTRUMENTS
	750 TO 799 REMOTE ELECTRICAL INSTRUMENTS
	800 TO 849 LOCAL ELECTRICAL INSTRUMENTS
	850 TO 899 REMOTE ELECTRICAL INSTRUMENTS
	900 TO 949 LOCAL ELECTRICAL INSTRUMENTS
	950 TO 999 REMOTE ELECTRICAL INSTRUMENTS

PIPE LENGTH (FROM OUTSIDE TO ETP AND ETP TO OUTSIDE)			
NODE-1 TO NODE-2: 320 M.	NODE-5 TO NODE-6: 300 M.	NODE-9 TO NODE-10: 850 M.	NODE-11 TO NODE-12: 300 M.
NODE-3 TO NODE-2: 50 M.	NODE-7 TO NODE-8: 75 M.	NODE-13 TO NODE-14: 200 M.	NODE-15 TO NODE-16: 300 M.
NODE-2 TO NODE-4: 850 M.	NODE-6 TO NODE-8: 975 M.	NODE-17 TO NODE-18: 1000 M.	NODE-19 TO NODE-20: 300 M.
NODE-15 TO NODE-16: 300 M.	NODE-14 TO NODE-18: 1000 M.	NODE-21 TO NODE-22: 50 M.	NODE-23 TO NODE-24: 675 M.
NODE-17 TO NODE-18: 50 M.	NODE-18 TO NODE-14: 150 M.	NODE-20 TO NODE-22: 950 M.	
NODE-25 TO NODE-26: 1175 M.	NODE-27 TO NODE-28: 150 M.		

PIPE SIZES OF CS MATL.		
NB	OD	THICK.
200	219.1	6.4
250	273.0	6.4
300	323.9	8.0
350	355.6	8.0
400	406.4	8.3
450	457.0	8.0
500	508.0	8.0
600	610.0	10.0
700	711.0	10.0
800	813.0	10.0
900	914.0	10.0
1000	1016	12.0

PROJECT
2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1 AT UDANGUDI, THOOTHUKUDI DISTRICT, TAMIL NADU

OWNER
TAMILNADU GENERATION & DISTRIBUTION CORPORATION LTD.

OWNER'S CONSULTANT
TATA CONSULTING ENGINEERS LIMITED, BENGALURU.

EPC CONTRACTOR
BHARAT HEAVY ELECTRICALS LIMITED, POWER SECTOR.

UNIT: PROJECT ENGINEERING MANAGEMENT, NOIDA.

TITLE
P & ID FOR EFFLUENT TREATMENT PLANT

NAME	SIGN.	DATE
F SAHA	Sd/-	11.03.21
J PAL	Sd/-	11.03.21
S BHARITHA	Sd/-	11.03.21

ALL DIMENSIONS ARE IN MILLIMETRES
BH&L DRAWING NO. PE-DG-435-164-A001

- NOTE:**
- ETP COLLECTION SUMPS E-1 TO E-11 ARE LOCATED AT VARIOUS COLLECTION AREA.
 - E-12 AND OTHER SYSTEMS ARE LOCATED IN ETP AREA.
 - ALL CHEMICAL DOSING SYSTEMS ARE LOCATED IN ETP AREA UNDER INDUSTRIAL SHED.
 - ISOLATION VALVES FOR INSTRUMENT IS INTEGRAL PART OF RESPECTIVE INSTRUMENT.

- REFERENCE DRAWINGS:**
- PID - PLANT WATER SYSTEM P&ID PLANT WATER SYSTEM: PE-DG-436-172-N001.
 - PLOT PLAN: PE-DG-435-100-M001.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B


SECTION: C

REV NO: 00 DATE:

P&ID FOR SEWAGE TREATMENT PLANT

COPY RIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED
it must not be used directly or indirectly in any way detrimental to the interest of the company.

LEGEND	
	SPRING LOADED RELIEF VALVE
	GATE VALVE
	HORIZONTAL CENTRIFUGAL PUMP
	NON RETURN VALVE
	BUTTERFLY VALVE
	PRESSURE GAUGE
	DIAPHRAM VALVE
	FLOW INDICATOR
	FLOW TRANSMITTER
	FLOW ELEMENT
	BALL VALVE
	TEMPERATURE INDICATOR
	PH INDICATOR
	DIAPHRAGM SEAL
	BLOWER
	SUBMERSIBLE PUMP
	METERING PUMP
	MOTOR
	LEVEL INDICATOR
	TURBIDITY METER
	RCC
	'Y' TYPE STRAINER
	PNEUMATIC OPERATED
	OPEN CLOSE LIMIT SWITCH
	3-WAY GAUGE COCK
	PRESSURE GAUGE
	PRESSURE TRANSMITTER
	LEVEL TRANSMITTER
	AIR DIFFUSER
	MEDIA MBBR
	FLOCCULATOR
	CONDUCTIVITY METER
	COD ANALYSER
	BOD ANALYSER
	DIFFERENTIAL PRESSURE INDICATOR
	DIFFERENTIAL PRESSURE TRANSMITTER
	FILLING CONNECTION
	VERTICAL SCREW PUMP

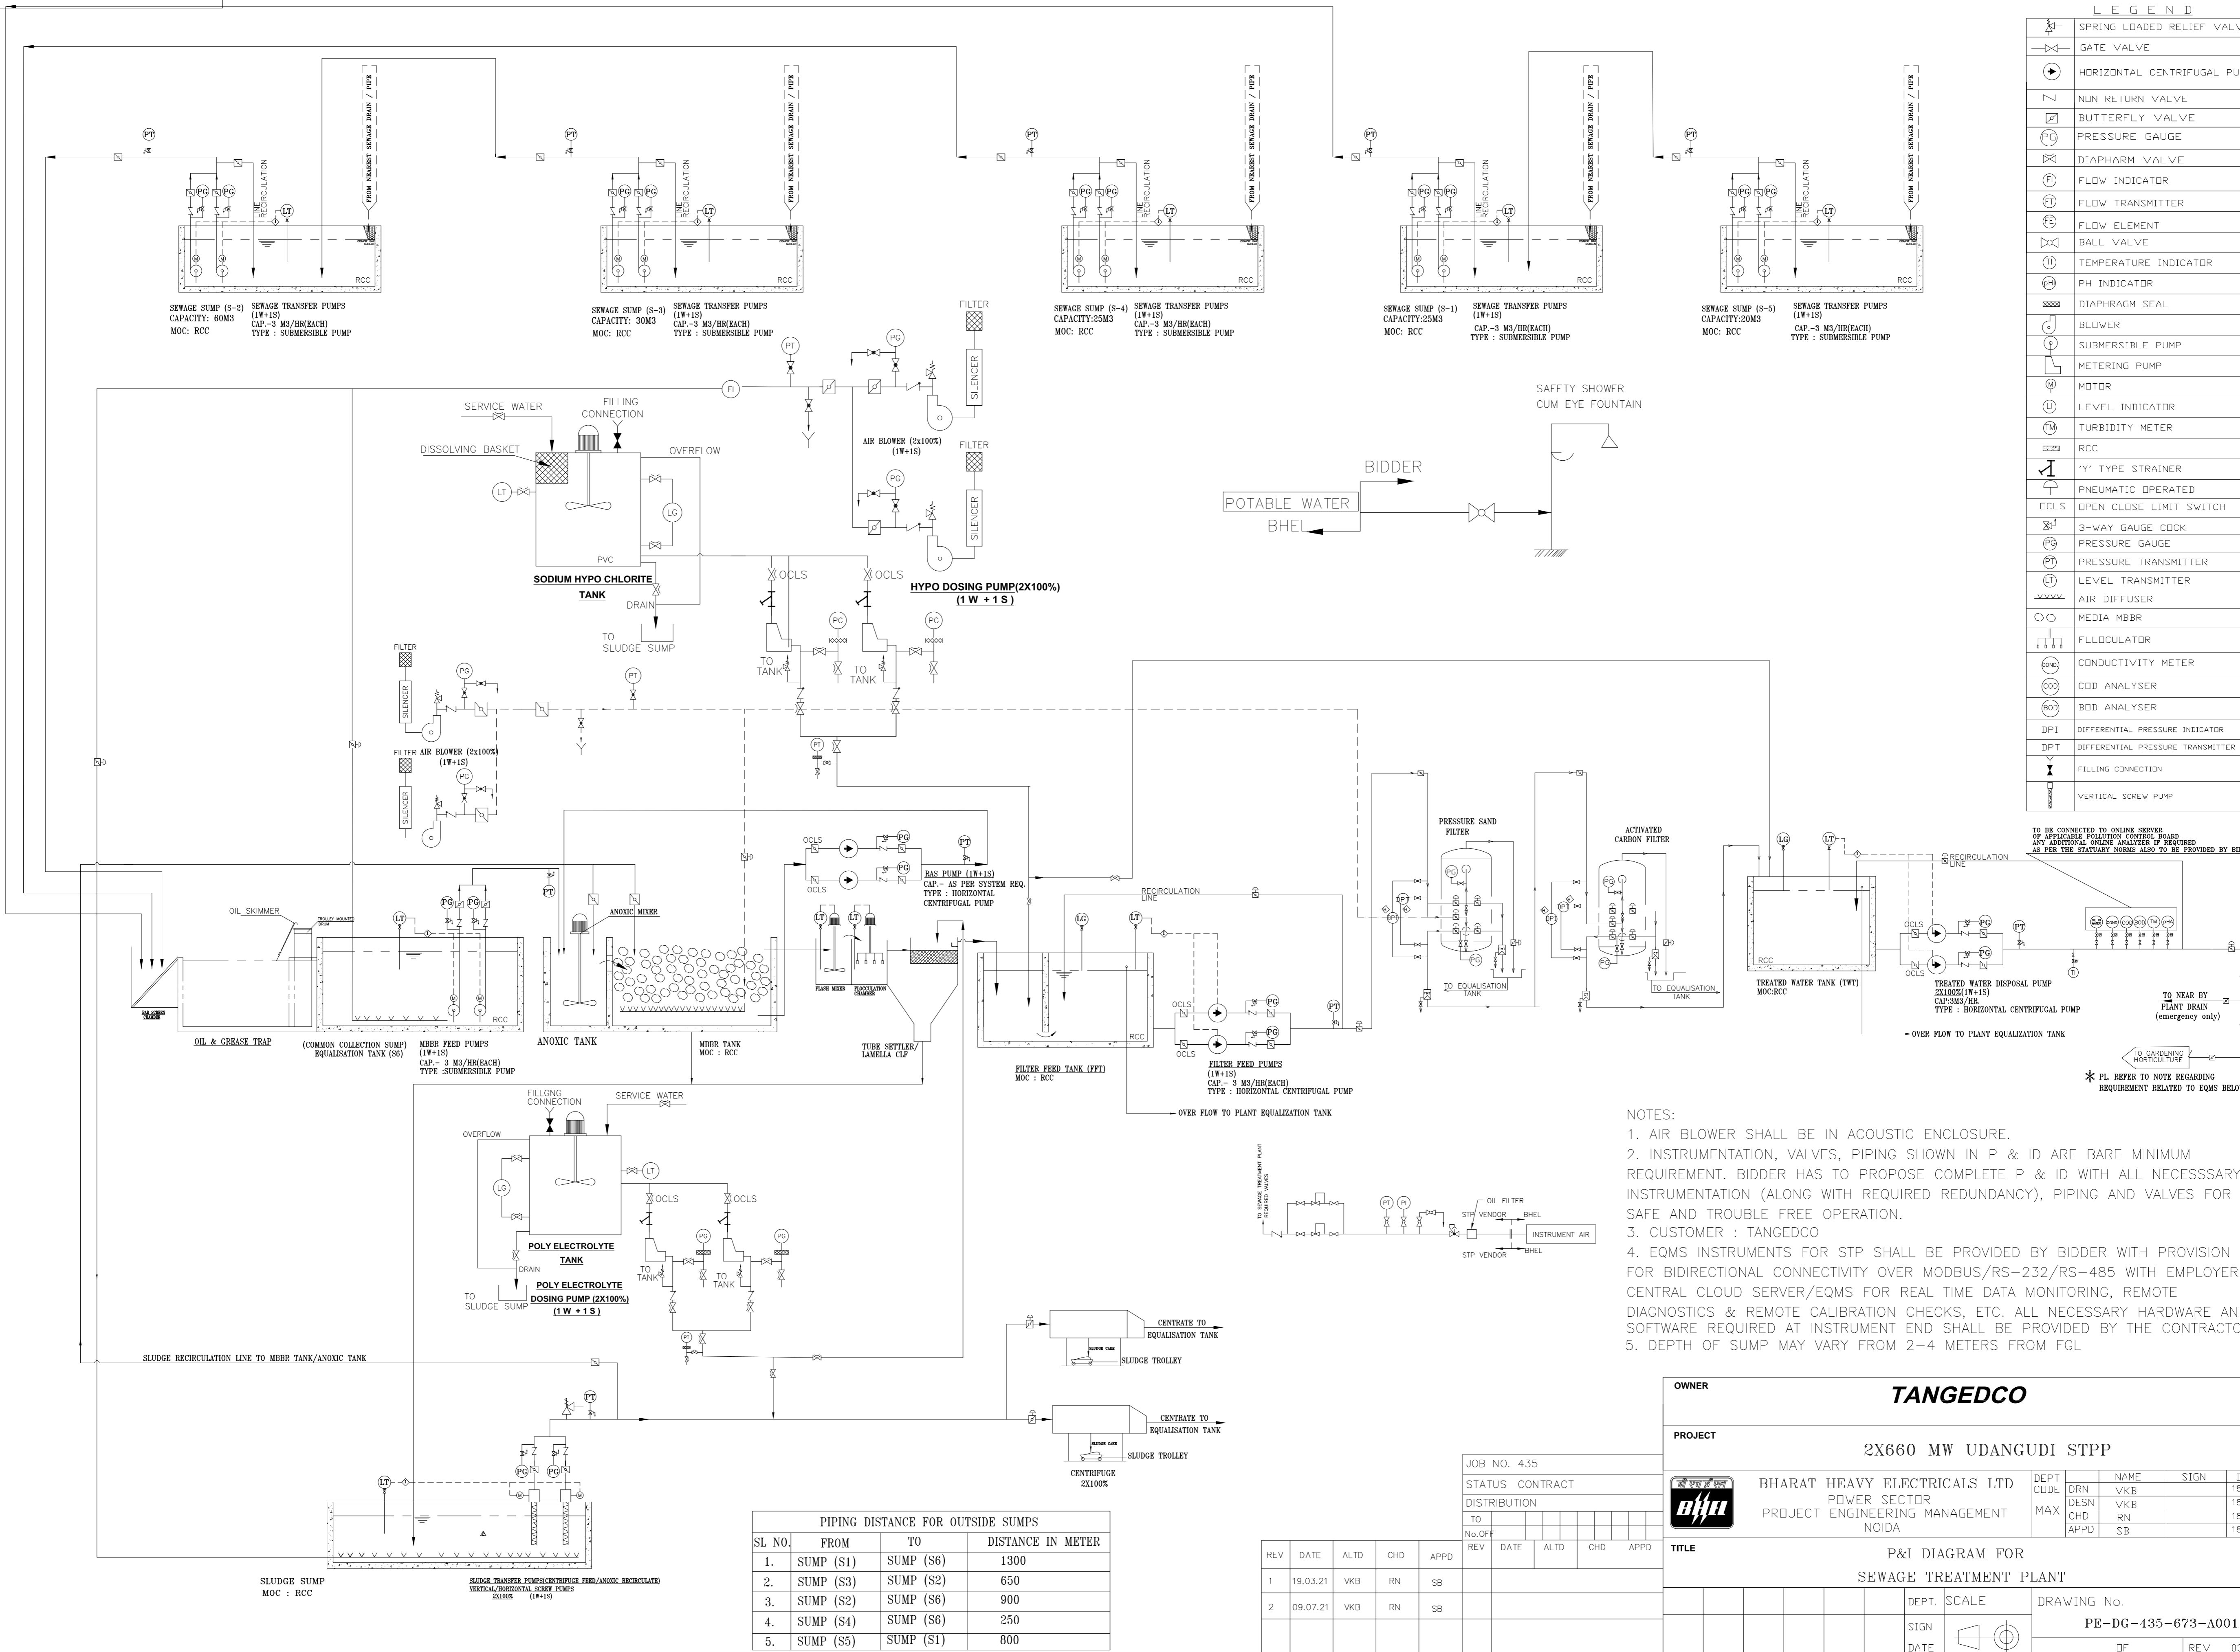

TO BE CONNECTED TO ONLINE SERVER OF APPLICABLE POLLUTION CONTROL BOARD ANY ADDITIONAL ONLINE ANALYZER IF REQUIRED AS PER THE STATUTORY NORMS ALSO TO BE PROVIDED BY BIDDER.

* PL REFER TO NOTE REGARDING REQUIREMENT RELATED TO EQMS BELOW.

- NOTES:
- AIR BLOWER SHALL BE IN ACOUSTIC ENCLOSURE.
 - INSTRUMENTATION, VALVES, PIPING SHOWN IN P & ID ARE BARE MINIMUM REQUIREMENT. BIDDER HAS TO PROPOSE COMPLETE P & ID WITH ALL NECESSARY INSTRUMENTATION (ALONG WITH REQUIRED REDUNDANCY), PIPING AND VALVES FOR SAFE AND TROUBLE FREE OPERATION.
 - CUSTOMER : TANGEDCO
 - EQMS INSTRUMENTS FOR STP SHALL BE PROVIDED BY BIDDER WITH PROVISION FOR BIDIRECTIONAL CONNECTIVITY OVER MODBUS/RS-232/RS-485 WITH EMPLOYER'S CENTRAL CLOUD SERVER/EQMS FOR REAL TIME DATA MONITORING, REMOTE DIAGNOSTICS & REMOTE CALIBRATION CHECKS, ETC. ALL NECESSARY HARDWARE AND SOFTWARE REQUIRED AT INSTRUMENT END SHALL BE PROVIDED BY THE CONTRACTOR.
 - DEPTH OF SUMP MAY VARY FROM 2-4 METERS FROM FGL

SL NO.	FROM	TO	DISTANCE IN METER
1.	SUMP (S1)	SUMP (S6)	1300
2.	SUMP (S3)	SUMP (S2)	650
3.	SUMP (S2)	SUMP (S6)	900
4.	SUMP (S4)	SUMP (S6)	250
5.	SUMP (S5)	SUMP (S1)	800

REV	DATE	ALTD	CHD	APPD
1	19.03.21	VKB	RN	SB
2	09.07.21	VKB	RN	SB

OWNER		TANGEDCO			
PROJECT		2X660 MW UDANGUDI STPP			
JOB NO. 435		STATUS CONTRACT DISTRIBUTION			
TO		STP VENDOR - BH&EL			
No. OFF		INSTRUMENT AIR			
REV		DATE			
1		19.03.21			
2		09.07.21			
TITLE		P&I DIAGRAM FOR SEWAGE TREATMENT PLANT			
DEPT.		SCALE			
SIGN		DRAWING No.			
DATE		PE-DG-435-673-A001			
		DF REV 03			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**


2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: C	
REV NO: 00	DATE:

KEY PLAN

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

KEY PLAN FOR ETP AND STP

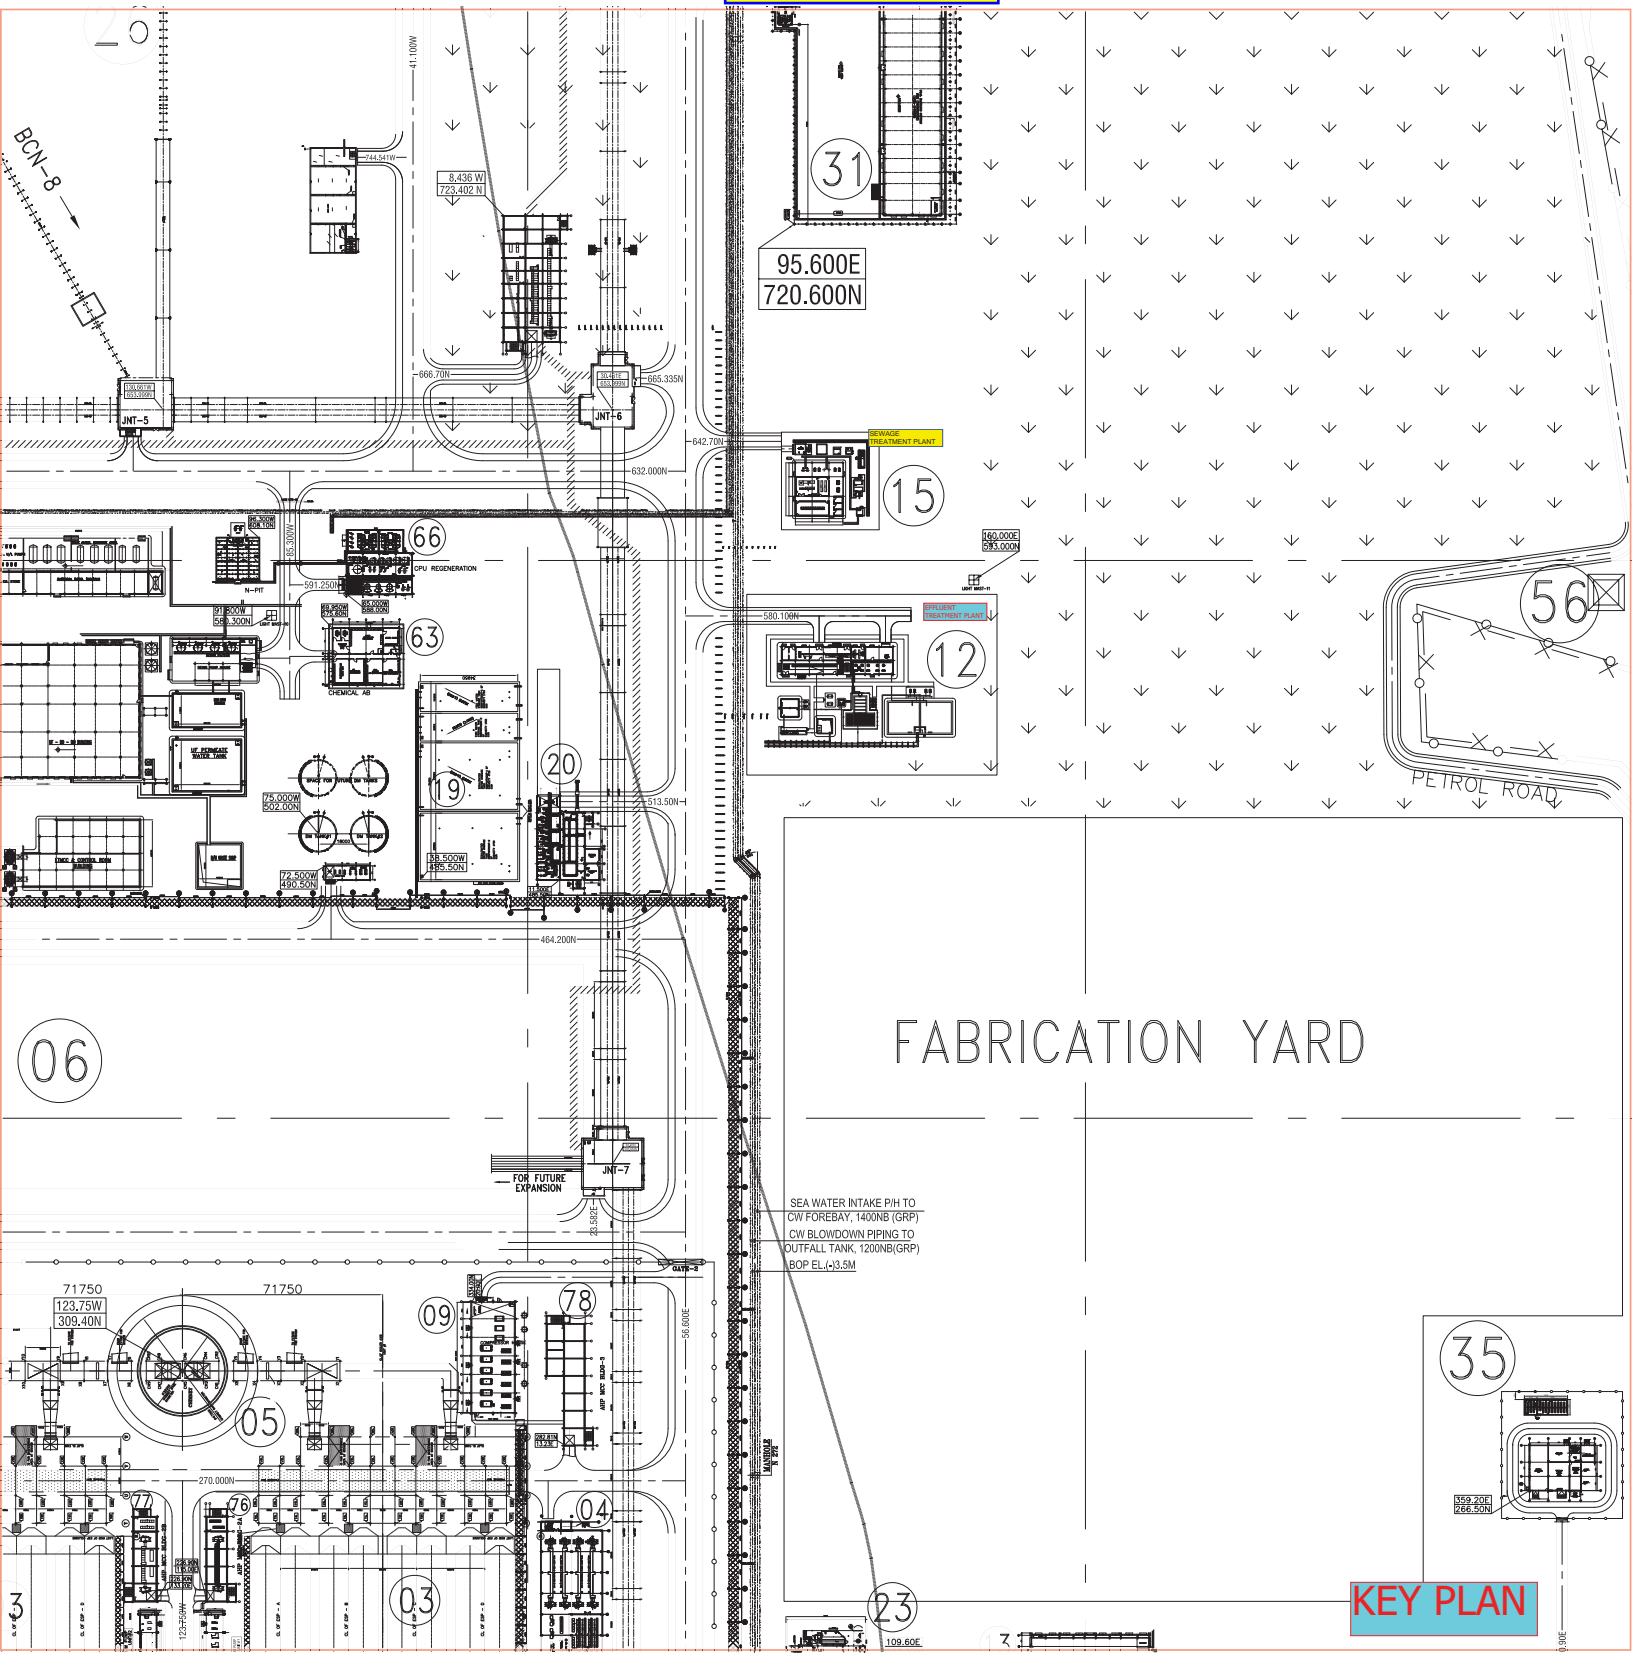



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

SECTION-D

(GENERAL TECHNICAL REQUIREMENT)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

SECTION-D1

(GENERAL TECHNICAL REQUIREMENT FOR MECHANICAL)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

GENERAL TECHNICAL REQUIREMENT FOR MECHANICAL FOR EFFLUENT TREATMENT PLANT

A. DESIGN CRITERIA (REFER THE ENCLOSED P&I DIAGRAM: PE-DG-435-164-A001).

Following effluents will be transferred/ collected/ treated in the Effluent Treatment Plant of capacity 30 Cum/Hr:

- ETP sludge.
- N-PIT Waste from CPU and RO-DM Plant.
- Coal Mil Area Waste Water
- Boiler and ESP Area **Floor** Wash Water.
- Oily Effluent and floor Wash Water from Power House Area.
- Burnt oil from transformer yard.
- Treated Oily Waste Water from Fuel Oil Pump House.
- Coal Mil Area Waste Water
- Coal pile runoff water.

B. DESCRIPTION FOR FACILITIES LOCATED OUTSIDE EFFLEUNT TREATMENT PLANT AREA.

a) N-PIT Waste from RO-DM and CPU.

The neutralized regeneration waste/effluent from RO-DM shall be pumped to CPU N-Pit for further pumping to ETP (CMB-Central Monitoring Basin) for further disposal after neutralization in CPU N-pit. The total effluent will come from CPU N-pit 120 CuM/Hr for two hours in a day. This effluent is intermittent in nature.

b) BWRO Reject.

BWRO Reject shall be suitably used back in the Desalination Plant or shall be pumped to CMB located at ETP for CHP dust suppression/ green belt development as a provisional arrangement

c) Boiler and ESP Area Floor Wash Water.

Boiler & ESP area floor washing drain having high TSS will be led to a respective Boiler Area Waste Water Pit for further pumping to common collection pit located in Effluent Treatment Plant for further treatment through Tube Settler for TSS removal. The clear water/treated water shall be collected in CMB for further use in CHP Dust Suppression, Horticulture or Pumping to sea through CW Blow Down Line (optional). This effluent is intermittent in nature.

The trench that will convey boiler and ESP area wash water may receive huge rainfall runoff during heavy down pour. During such condition of continuous heavy rains, the total quantity of waste water at the trench leading to the respective pit will be so high that it cannot be handled in the respective pit and Tube Settler. In fact, after initial few minutes of heavy rains the rainfall runoff is not expected to contain any suspended solids. Hence, an overflow weir controlled by-pass system is proposed before the respective pit to divert such rainfall runoff to the nearby storm drain.

d) Oily Effluent and floor Wash Water from Power House Area.

Power House Area (TG area) Effluent generated from floor washings, leakages from bearing and turbine cooling systems, leakage from pumps, hydraulic couplings, oil leakage from oil burners etc. containing suspended solids and some oil and grease will be channelized to a respective unit's TG Area Oily Waste Pit for further pumping to Common Oily Waste Collection Pit located in Effluent Treatment Area for further treatment through Oil Water Separator (OWS). The normal effluent coming to these pits due to washing and the total effluent quantity shall be around 5 CuM per day. This effluent is intermittent in nature.

e) Transformer Yard Oily Waste Water.

In the event of fire and/ or bursting of transformer causing loss of containment of transformer oil, spilled oil is collected in respective unit's Retention Pit for Oily Waste Water (Total 2 nos. for station) [Each Pit Cap (min): 85 m³] for further pumping to Common Oily Waste Collection Pit located in Effluent Treatment Area for further treatment through Oil Water Separator (OWS). The



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

oil shall be floated over water in respective Retention Pit and the bottom water shall be pumped to ETP for oil removal. The water quantity is approximately 30 to 40 CuM. This effluent is intermittent in nature.

f) Oily Waste from Fuel Oil Handling & Storage System.

Oily effluent from Fuel Oil Pump House and Fuel Oil Storage Unloading Area after its collection in Oil Water Separation Pit shall be pumped to Common Oily Waste Collection Pit for further treatment through Oil Water Separator. Expected effluent quantity is around 5 CuM/day in case of rain. This effluent is intermittent in nature.

g) Coal Mil Area Waste Water.

Coal Mil Area Effluent containing slight suspended solids will be channelized unit wise to respective Coal Mil Oily Waste Water Sumps (2 nos. per unit, each of 5 m³ cap.) from where it will be pumped to Common Collection Pit. The actual waste to be collected in each pit is 2.0 CuM/Hr. This effluent is continuous in nature.

h) Coal Pile Area Run Off System.

Coal Pile Area Run Off shall completely be taken care (handling/ treatment/ transfer) by BHEL's Coal Handling Plant agency. However, provision for storing treated coal pile runoff water during peak rainy season has been envisaged in CMB for further disposal to Sea. In fact, after initial few minutes of heavy rains the coal pile runoff is not expected to contain any suspended solids, hence, taken for maximum initial Twenty (20) minute rain fall and remaining portion of rain water after the specified period shall be bypassed to nearby storm water drain line. This effluent is intermittent in nature.

Note: following shall be taken care by BHEL respective group of coal handling system (**Ref. IS-4-DB-714-111-M079**): -

- Settling pond with overflow sump.
- Coal pile runoff Pumps.

C. DESCRIPTION FOR FACILITIES LOCATED INSIDE EFFLEUNT TREATMENT PLANT AREA.

a) Common Oily Waste Collection Pit.

The Common collection pit is designed to store the oily effluent from various sources like TG Area Oily waste (intermittent), Oily Waste from Transformer (intermittent) and Fuel Oil Area Oil Water Separator pit (continuous) to equalize the effluent for further treatment through Oil Water Separator located in Effluent Treatment area.

b) Oil Water Separator.

One number Oil Water Separator has been envisaged to remove oil from oily waste collected in Common Oily Waste Collection Pit.

The treated water shall be collected in Common Collection Pit for further treatment through Tube Settler and sludge shall be collected in Sludge Collection Pit for further disposal to Ash Slurry Pit. The separated oil shall be collected in Slop Oil Tank.

c) Common Collection Pit.

The Common collection pit is designed to store treated oil free water from Oil Water Separator (Continuous), Boiler & ESP Area Floor wash water (Intermittent) and Coal Mil waste (Continuous) and and Coal Pile Runoff during peak rainy season (for one hour) for further treatment through Tube Settler. Water recirculation line also envisaged for mixing.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

d) Tube Settler.

One number Tube Settler has been envisaged to remove the suspended solids of effluent water collected in Common Collection Pit.

The sludge from Tube settler shall be collected in Sludge Collection Pit for further disposal to Ash Slurry Pit. The clear water from Tube settler shall be collected in Central Monitoring Basin for further use like Horticulture and CHP dust suppression.

Lime, Alum and PE dosing shall be done in Tube settler for enhancing the settlement of suspended partials.

i) Sludge Collection Pit.

The sludge from Tube Settler and Oil Water Separator shall be collected in Sludge Collection Pit for further disposal to Ash Slurry Pit. The pit size considered 5 CuM.

To avoid settling of sludge air blower and recirculation line has been envisaged.

e) Central Monitoring Basin

The Central Monitoring Basin is designed with two compartment to store treated water from Tube Settler, CPU/DM Plant N-pit waste and BWRO reject (provisional). Also in case of excess water from Tube settler and/or CPU/DM Plant N-pit waste and/or BWRO Reject the same shall be routed through Cooling Tower Blow Down water for further disposal.

Dosing facility for pH correction envisaged for CMB. In case the final outlet pH is not under limit then the water shall be recycled back to CMB for pH treatment.

C. OPERATION & CONTROL PHILOSOPHY

The overall operation & control of entire ETP shall be through standalone control system of DDCMIS/DCS family (In BHEL Scope of Supply), located in ETP Control Room near Central Monitoring Basin (CMB). Other sumps outside ETP area shall be controlled from nearby control system (In BHEL scope of supply).

All sump pumps will be operated by level controls (low/ high) at the sump & pump discharge pressure (low/ high).

For auto operation, one pump shall be kept in Auto running and the other pump shall be kept in Auto standby. The pump selected in Auto running shall start at high level LT and trip at low level LT.

All controls, fault indications/ alarms, interlocks, logics shall be implemented in standalone control system of DDCMIS family.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

GENERAL TECHNICAL REQUIREMENT FOR MECHANICAL FOR SEWAGE TREATMENT PLANT

1.0 DESIGN CRITERIA (REFER THE ENCLOSED P&I DIAGRAM: PE-DG-435-673-A001).

Average design flow shall be 40 Cum/day. **However, bidder to design the equipment for peak load requirements also as per CPHEEO manual requirements.**

2.0 BASIS

Sewage treatment plant shall be designed for inlet and outlet quality of sewage by the bidder. Further Zero discharge condition must be achieved within the plant boundary.

3.0 SEWAGE QUALITY INLET TO SEWAGE TREATMENT PLANT

Sewage Treatment Plant is designed for the following sewage flow rate and characteristics:

Flow Rate	:	40 M ³ /day
pH	:	7.0 – 8.0
BOD	:	300 ppm
COD	:	600 ppm
Oil & Grease	:	50 ppm
Coliform count	:	10 ⁶ to 10 ⁷
TSS	:	300 ppm
NH4-N	:	As actual
N Total	:	As actual
Temperature	:	Ambient

4.0 SEWAGE TREATMENT OUTLET QUALITY

Treated sewage will conform to the following quality standards, however the treated sewage water qualities shall have to meet the all applicable statutory requirement including TNPCB and CPCB also, whichever is stringent.

pH	:	7.5 – 8.5
BOD	:	Less than or equal to 20 ppm
COD	:	Less than or equal to 100 ppm
Oil & Grease	:	Less than or equal to 5 ppm
Coliform count	:	Less than or equal to 100 MPN / 100 ml
TSS	:	Less than or equal to 20 ppm
NH4-N	:	Less than 5mg/l
N Total	:	Less than 10mg/l
Residual chlorine	:	Not exceeding 0.5 mg/l
Temperature	:	Ambient

NOTES: -

The treated sewage quality standards shall be achieved at average sewage flow rates as well as peak sewage flow rates.

5.0 PROCESS DESCRIPTION

The sewage treatment plant shall be designed as per guidelines of CPHEEO Manual. The sewage treatment plant shall be designed to handle a flow of 40 m³/day.

The Sewage Treatment Plant treatment scheme shall be modular type based on MBBR (Moving Bed Biofilm Reactor) technology followed by disinfection by Hypo and necessary tertiary treatment prior to reuse in horticulture purpose. Aerobic biological sludge generated shall be thickened in the tube settler and aerobically digested/dried in a sludge sump and then transferred to filter press. The dry sludge shall be disposed manually by Customer.

The Process Flow Diagram / P & ID is enclosed for reference.

The sewage treatment plant shall consist of following treatment components:



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

- 1) Pre-Treatment, which consists of raw sewage collection and pumping & screening of incoming sewage & oil & grease removal from the collected sewage.

Preliminary Treatment:

- Coarse screens for screening incoming sewage
- Oil & Grease Trap
- Equalization cum holding tank

- 2) **Biological Treatment**, comprising of aeration followed by clarification and Dosing of sodium hypochlorite in the hypo contact cum filter feed tank.

Aeration System:

- Aerobic Biological treatment in the MBBR Tank with fine bubble diffused aeration.
- Transfer of treated partially treated sewage to the Clarification system.

Clarification System:

- Settling of digested sludge in the Tube Settler.
- Transfer & storage of clarified water to the Hypo Contact Cum Filter Feed Tank.
- Dosing of Sodium Hypochlorite in the Hypo Contact Cum Filter Feed Tank.

3) **Sludge Handling System**

- Transfer of sludge to the sludge sump from MBBR tank & tube settler.
- Transfer of sludge to centrifuge through sludge transfer pumps.
- Transfer a part of sludge to MBBR tank to maintain MLSS through discharge line of sludge transfer pumps.
- Transfer of centrate or filtrate to the equalization tank.
- Transfer of waste water generated through PSF & ACF to the equalization tank/CCS.
- Disposal of sludge as cakes by sludge trolley.

4) **Tertiary Treatment:**

- Polishing of treated sewage by PSF& ACF.
- Transfer of Polished sewage water for horticulture.

Detailed description of each treatment step is given below:

The various raw sewages shall be collected by gravity at local sewage sumps at different areas and the same to be pumped by using Sewage transfer Pumps to the equalization Tank after passing through the bar screen chamber & oil grease chamber provided with oil & grease trap. In bar screen chamber (MOC: RCC) the coarse screens present in the raw incoming sewage shall be subject to screening & oil & grease chamber (MOC: RCC) shall be provided with Oil & grease trap for removal of oil & grease from the raw incoming sewage.

The Sewage transfer Pumps shall be of submersible type. The Sewage transfer Pumps shall automatically START at high level in the Sewage Collection Pit and STOP at low level.

The Equalisation tank shall also be provided with a coarse air bubble diffuser and an airline tapping from the Air Blower delivery header so as to allow continuous aeration in order to protect the STP Package against unpleasant odours.

2 numbers (1W+1S) Air Blowers common for common collection sump/Equalization tank & sludge sump shall be provided to supply air through an underwater piping grid and fine air bubble membrane diffusers. Centrate produced from centrifuge shall be transferred to Equalization tank.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

2 numbers (1W+1S) vertical submersible MBBR feed pumps shall be provided in equalization tank to transfer sewage from equalization tank to MBBR reactor. 1 no. MBBR reactor of RCC construction along with 2 numbers (1W+1S) Air Blowers for MBBR tank to supply air through an underwater piping grid and fine air bubble membrane diffusers to MBBR reactor.

1 number tube settler of RCC construction for Settling of digested sludge in the Tube Settler.

1 number filter feed tank of MOC RCC shall be provided for storage of clarified water after clarification process.

Further 1 no. hypo dosing system consists of 1 number Hypo dosing tank of MOC PVC along with 1 number hypo dosing pump shall be provided for dosing of sodium hypo chloride inside the hypo contact cum filter feed tank. Over flow connection from the Hypo contact cum filter feed tank shall be connected through pipe to plant drain.

Further 2 numbers (1W+1S) horizontal centrifugal type filter feed pumps shall be provided for feeding clarified water after clarification process for tertiary treatment through Pressure sand Filter & activated carbon filter.

1 number Pressure Sand Filter & 1 no. Activated carbon filter shall be provided for the tertiary treatment of clarified water after clarification process. Backwash & waste water generated from Pressure Sand Filter & activated carbon filter shall be transferred to the equalization tank. 1 number treated water tank over ground (MOC RCC) shall be there for storage of final treated water after tertiary treatment.

Further 2 numbers (1W+1S) horizontal centrifugal type treated water disposal pumps shall be provided for transferring the treated water for gardening purpose.

1 number sludge sump of (MOC RCC underground) for storage of sludge generated from MBBR tank & tube settler shall be provided. 2 nos. (1W+1S) of vertical/horizontal screw type sludge transfer pumps for feeding sludge from sludge sump to centrifuge.

Further 1 number hypo dosing system consists of 1 number Hypo dosing tank along with 1 number hypo dosing pump shall be provided for dosing of sodium hypo chloride during feeding of sludge to centrifuge.

Sodium hypochlorite solution dosing shall be carried out into the hypo contact cum filtered feed tank & feeding line to centrifuge to control the BOD.

Further 1 number trolley mounted arrangement for each centrifuge shall be provided for disposal of sludge cake generated from centrifuge.

The stabilized sludge shall be free of offensive odours.

6.0 OPERATION AND CONTROL PHILOSOPHY

The MBBR based sewage treatment plant operation & control shall be carried out from the DCS based control system (BHEL Scope). Control of sewage sumps located outside boundary of STP common area shall be through self-standing local control panel (Bidder scope).

Sewage treatment plant (STP) shall be operated from DCS through operator work stations located in the local control room. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. All sump pumps will be operated by level controls (low/ high) at the sump & pump discharge pressure (low/ high). For auto operation, one pump shall be kept in Auto running and the other pump shall be kept in Auto standby. The pump selected in Auto running shall start at high level LT and trip at low level LT.

All controls, fault indications/ alarms, interlocks, logics shall be implemented in standalone control system of DDCMIS family.

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

PUMPS AND PIPE SELECTION CRITERIA [COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

Pump and Pipeline carrying water and chemicals etc. shall generally be sized on the following velocities. However wherever minimum pipe sizes are defined in the drawing/datasheets, the selected size shall not be less than the specified size.

	VELOCITY IN m/sec.		
	BELOW 50 MM.	50-150 MM	200 MM AND ABOVE
Pump Suction for water	-----	1.2-1.5	1.2-1.8
Pump discharge for water	1.2-1.8	1.8-2.4	2.1-2.5
Header for water	-----	1.5-2.4	2.1-2.4
Pump Suction for chemical solution	1.0-1.2	1.1-1.3	-----
Pump discharge for chemical solution	1.2-1.4	1.3-1.5	-----
Gravity flows	Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec.		

Note 1- All piping system shall be capable of withstanding the maximum pressure in the corresponding line.

Note 2- TDH of all pumps shall be decided by the supplier assuming the following 'C' values in Hazen & Williams equation for calculation of friction loss.

- a) Carbon steel pipes – 100
- b) CI Pipes /Ductile Iron pipes –100
- c) Rubber lined steel pipe – 120
- d) U[VC/CPVC/PVC/HDPE pipes – 140
- e) Stainless steel pipes -100

For calculating the required pump head for pump selection, at least 10% margin shall be taken over the pipe friction losses and static head shall be calculated from the minimum water level of the tank/sump/reservoir from which the pumps draw water.



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

SECTION-D2

(GENERAL TECHNICAL REQUIREMENT FOR ELECTRICAL)


[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

615965/2021/PS-PEM-MAX:

**GENERAL TECHNICAL REQUIREMENTS****FOR****LV MOTORS**SPECIFICATION NO.
PE-SS-999-506-E101VOLUME NO. : **II-B**SECTION : **D**REV NO. : **00** DATE : 29/08/2005

SHEET : 1 OF 1

GENERAL TECHNICAL REQUIREMENTS**FOR****LV MOTORS****SPECIFICATION NO.: PE-SS-999-506-E101 Rev 00**

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 1 OF 4

1.0 INTENT OF SPECIFICATION

The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer's work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station.

Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.

2.0 CODES AND STANDARDS

Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards:

IS:325	Three phase Induction motors
IS : 900	Code of practice for installation and maintenance of induction motors
IS: 996	Single phase small AC and universal motors
IS: 4722	Rotating Electrical machines
IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines
IS: 4728	Terminal marking and direction of rotation rotating electrical machines
IS: 1231	Dimensions of three phase foot mounted induction motors
IS: 8789	Values of performance characteristics for three phase induction motors
IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment
IS: 2148	Flame proof enclosures for electrical appliance
IS: 5571	Guide for selection of electrical equipment for hazardous areas
IS: 12824	Type of duty and classes of rating assigned
IS: 12802	Temperature rise measurement for rotating electrical machines
IS: 12065	Permissible limits of noise level for rotating electrical machines
IS: 12075	Mechanical vibration of rotating electrical machines

In case of imported motors, motors as per IEC-34 shall also be acceptable.

3.0 DESIGN REQUIREMENTS

3.1 Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A

3.2 Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information
Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.

3.3 Starting Requirements

3.3.1 Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.

3.3.2 Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.



GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101

VOLUME NO. : **II-B**

SECTION : **D**

REV NO. : **00** DATE : 29/08/2005

SHEET : 2 OF 4

The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors.

3.3.3 The following frequency of starts shall apply

- i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature.
- ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour)
- iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor

3.4 Running Requirements

3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor.

3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs.

3.5 Stress During bus Transfer

3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer.

3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition.

3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065.

3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075.


4.0 CONSTRUCTIONAL FEATURES

4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy


4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362.

Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled

4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 3 OF 4
<p>4.4. Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.</p> <p>4.5. Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.</p> <p>4.6. In case Class ‘F’ insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class ‘B’ insulation. In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.</p> <p>4.7. Terminals and Terminal Boxes</p> <p>4.7.1. Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A.</p> <p>Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet “A”.</p> <p>4.7.2. unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.</p> <p>4.7.3. Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.</p> <p>4.7.4. Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.</p> <p>4.7.5. Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.</p> <p>4.7.6. Degree of protection for terminal boxes shall be IP 55 as per IS 4691.</p> <p>4.7.7. Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.</p> <p>4.7.8. Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.</p> <p>4.7.9. Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.</p> <p>4.8. Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.</p> <p>4.9. General</p>		

615965/2021/PS-PEM-MAX:

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 4 OF 4

- 4.9.1 Motors provided for similar drives shall be interchangeable.
- 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors.
- 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above.
- 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956.
- 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz.
- 4.9.6 Name plate with all particulars as per IS: 325 shall be provided
- 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions.

5.0 INSPECTION AND TESTING

- 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied.
- 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser.
- 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan.
- 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A.

6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT

- a) OGA drawing showing the position of terminal boxes, earthing connections etc.
- b) Arrangement drawing of terminal boxes.
- c) Characteristic curves:
(To be given for motor above 55 kW unless otherwise specified in Data Sheet).
 - i) Current vs. time at rated voltage and minimum starting voltage.
 - ii) Speed vs. time at rated voltage and minimum starting voltage.
 - iii) Torque vs. speed at rated voltage and minimum voltage.
For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling.
 - iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.

VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

1.0.0 INTENT OF SPECIFICATION

This section covers the technical requirements of HT motors, LT Motors and DC motors.

2.0.0 CODES AND STANDARDS

The equipment to be furnished under this specification shall be in accordance with the applicable section of the latest edition (including amendments) of the following Indian Standards (IS), IEC publications and other codes except where modified and /or supplemented by this specification.

- | | |
|-----------------|--|
| a) IS: 325 | Three phase induction motors |
| b) IS: 12615 | Energy efficient induction motors |
| c) IS: 900 | Code of practice for installation and maintenance of induction motors |
| d) IS: 996 | Single-phase AC induction motor for general purpose |
| e) IS: 1231 | Dimensions of three-phase foot-mounted induction motors |
| f) IS: 2223 | Dimensions of flange mounted AC induction motors |
| g) IS: 4029 | Guide for testing three-phase induction motors |
| h) IS: 8789 | Values of performance characteristics for three-phase induction motors |
| i) IS: 13555 | Guide for selection and application of 3-phase AC induction motors for different types of driven equipment |
| j) IS: 5571 | Guide for selection of electrical equipment for hazardous areas |
| k) IS: 12065 | Permissible limits of noise level for rotating electrical machines |
| l) IS: 12075 | Mechanical vibration of rotating electrical machines |
| m) IS 60034-5 | Degree of protection provided by Integral design of rotating electrical machines |
| n) IS 60034-8 | Terminal marking and direction of rotation |
| o) IS 60079-1 | Equipment protection by flame proof enclosure |
| p) IS 60034-1 | Rotating electrical machines. |
| q) IS 60079 | Explosive atmospheres |
| r) IS/IEC 60529 | Degrees of protection provided by enclosures (IP code) |
| s) IEC 60034 | Rotating electrical machines. |
| t) IS 3177 | Code of practice for Design, Manufacture, Erection and testing of Cranes and Hoists |

3.0.0 TECHNICAL REQUIREMENTS**3.1.0 Design ambient temperature**

Motors shall be suitable for an ambient temperature of 50 degree C and relative humidity of 95% and shall deliver the rated output without exceeding its guaranteed temperature limits.

3.2.0 Supply voltage

Motors rated up to and including 415 V are termed as LT motors and the motors rated higher than 415 V are termed as HT motors.

Motors shall be capable of delivering the rated output under following voltage and frequency variations without exceeding its guaranteed temperature limits.

VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- Frequency variation : (+) 3% and (-) 5%
- Voltage variation for LT motors : (±) 10%
- Voltage variation for HT motors : (±) 6%
- Combined variation of voltage and frequency : 10% (absolute sum)

All the motors shall be so designed that maximum inrush currents, locked rotor torque and pullout torque developed at extreme voltage and frequency variations do not endanger the motor and the driven equipment.

3.3.0 System Parameters

Sl. No.	Description	11 kV and 6.6 kV System	LT System
1.	Voltage level	6.6 kV : Above 200 kW and upto 2000 kW 11 kV: Above 2000 kW	240 V : up to 0.2 kW 415 V: >0.2 kW and up to 200 kW.
2.	System earthing	Earthed through resistance, limiting earth fault current to 300 Amps	415 V system solidly grounded.
3.	Fault withstand rating of motor terminal box (Breaker operated)	50 kA for 0.2 sec for 11 kV and 31.5 kA for 0.2 sec for 6.6 kV	415 V system : 50/65 kA for 0.2 second

3.4.0 Type

AC Motors shall be squirrel cage induction type unless otherwise it is specified.

3.5.0 Duty

- All AC motors shall be squirrel cage three phase/single phase induction motors. All the motor shall be designed for bi-directional rotation.
- All the motors shall be rated for S1 duty for continuous operation. Motors of crane and hoist application shall be intermittent duty.
- DC motor shall generally be of shunt wound type rated for 220 V DC.
- Motors shall be suitable for installation in hot, humid and tropical atmosphere and polluted at places with coal ash and or fly ash.
- The motors shall be suitable for bus transfer schemes provided on the 11 kV/6.6 kV/415 V systems without any injurious effect on its life.

3.6.0 Design margin

Whenever the basis for motor rating are not specified in the corresponding mechanical specification section maximum continuous motor rating shall be atleast 10% above the maximum load derived of the driven equipment under entire operating range including voltage & frequency variation.

The motor characteristics shall match the requirements of the driven equipment so that adequate starting, accelerating; pull up, breakdown and full load torques are available for the intended service.

Service shall be considered as 1.0 only.

VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

3.7.0 Method of Starting

- All the motors shall be suitable for direct on-line starting on full load. Where variable voltage and variable frequency (VVFD) operation is envisaged through VVFD drives, motors shall be specially designed for such application.
- LT motors rated up to 125 kW shall be controlled through MPCB/MCCB and contactor. LT motors rated more than 125 kW shall be controlled through air circuit breaker.
- HT Motors shall be controlled through vacuum circuit breaker.

3.8.0 Efficiency

All the duty motors shall be energy efficient type. For HT and LT motors, it shall be IE3 class as per IS 12615. For VFD controlled HT and LT motors, it shall be IE2 class as per IS 12615.

3.9.0 Temperature rise

- Winding Insulation shall be Class F.
- Temperature rise of air cooled motors shall not exceed 70°C over air temperature of 50°C by resistance method, while delivering its maximum rated output.
- Temperature rise of water cooled motors shall not exceed 80°C over inlet cooling water temperature by resistance method, while delivering its maximum rated output.

3.10.0 Starting voltage

- a) Motors shall be capable of starting and accelerating the load at following starting voltage, with direct on-line starting, without exceeding specified winding temperatures.
 - HT Motors (up to 1000 kW) : 85% of rated voltage
 - HT Motors (> 1000 kW up to 4000 kW) : 80% of rated voltage
 - HT Motors (> 4000 kW) : 75% of rated voltage
 - LT motors : 80% of rated voltage
- b) During fast changeover of power supply source, vector difference between the motor residual voltage and the incoming supply voltage shall be about 150% of the rated voltage and the motors shall withstand voltage stress and torque stress developed during that time, which may last for a period of one (1) second.
- c) The motor shall be capable of operating at full load at a supply voltage of 75% of the rated voltage for 5 minutes.

3.11.0 No. of Starts

Continuous duty motors shall be suitable for the following starting requirements under the specified conditions of load, torque and inertia.

- No. of consecutive hot starts shall be 2 (with initial temperature of the motor at full load operating level).
- No. of consecutive cold starts shall be 3 (with initial temperature of the motor at ambient temperature).
- For conveyor motors, no. of consecutive hot starts shall be 3 (with initial temperature of the motor at full load operating level).

VOLUME: II B
**TECHNICAL SPECIFICATION FOR
 EFFLUENT TREATMENT PLANT
 SPECIFICATION NO.: PE-TS-435-164-A001**

3.12.0 Starting current

- Locked rotor current of HT motors for applications other than listed below shall be limited to 600% of the full load current, and is subject to IS tolerance.
- For energy efficient LT motors, locked rotor current shall be as per IS: 12615.
- Locked rotor current of the VFD controlled AC motors shall be limited to 300% of the full load current, and is subject to IS tolerance.
- Locked rotor current of the BFP motors shall be limited to 450% of the full load current of the motor, and is subject to IS tolerance.

3.13.0 Locked rotor withstand time

- The locked rotor withstand time for HT motors under hot conditions at 110% rated voltage shall be more than the starting time at minimum permissible voltage specified above by atleast three seconds or 15% of the accelerating time whichever is greater. Provision of speed switch shall be avoided to the extent possible. In case the speed switch is required, it shall be indicated by the bidder in his offer
- For the LT motors having starting time up to 20 seconds at minimum permissible voltage, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 seconds more than the starting time.
- For the motors having starting time more than 20 seconds and up to 45 seconds at minimum permissible voltage, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 seconds more than the starting time.
- For motors having starting time more than 45 seconds at minimum permissible voltage, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.
- Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.
- When a speed switch is mounted on the motor shaft, the same shall remain closed for speeds lower than 20% and open for speeds above 20% of the rated speed. The speed switch shall be capable of withstanding 120% over speed in either direction of rotation.

3.14.0 Torque Requirements

- Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor full load torque.
- Pull out torque at rated voltage shall not be less than 205% of full load torque.
- Motors subjected to reverse rotation shall be designed to withstand the stresses encountered when starting with non-energized shaft rotating at 125% of rated speed in reverse direction.

3.15.0 Enclosure

- a) Motors shall have IP 55 degree of protection.
- b) For hazardous location, the enclosure of motors shall following have flame proof construction conforming to applicable standard.
 - Fuel oil area Group – IIB
 - Hydrogen generation plant area : Group – IIC)

3.16.0 Cooling

- LT motors shall be totally enclosed fan cooled (TEFC), type IC411. The cooling shall be effected by self-driven bi-directional centrifugal fan protected by fan cover.
- HT motors can be totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or closed air circuit air cooled (CACA-IC6A1A1) type.
- Motors rated >3000 kW can be closed air circuit water cooled (CACW).
- Motors with CACA/CACW heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate the following:
 - Hot and cold air temperatures of the closed air circuit for CACA motors.
 - Hot and cold, air and water temperatures for CACW motors.
- The Alarm switch contact rating shall be minimum 0.5 A at 220 V DC and 10 A at 230 V AC.

3.17.0 Winding

- Winding shall be class F insulation with temperature limited to class B. Insulation shall be Non-hygroscopic, oil resistant, and flame resistant. Winding, fittings and hardware shall be corrosion resistant. Winding shall be tropicalized and suitably varnished, baked and treated for operating satisfactorily in humid and corrosive atmosphere.
- For the VFD operated drives, insulation shall be designed to take care of stresses due to high DV/DT. Motors shall be wound with dual coated winding wires and impregnated with VPI process. Further for such application, insulated bearings shall be provided to avoid circulating current caused by shaft induced voltages.
- Space heaters rated for 240 V AC, 50 Hz supply shall be provided for motors rated 30 kW and above to maintain windings in dry condition when motor is standstill.
- For HT motors, insulation shall be Vacuum Impregnated (VPI).
- HT motors shall withstand one minute power frequency voltage test or 1.2/50 micro sec lightning impulse Voltage wave of $4U+5$ kV (U =Line voltage in kV) test on main insulation as per IEC 600034-15. The coil inter-turn insulation shall withstand steep front impulse withstand voltage as per IEC 600034-15.
- For HT motors, 12 nos. simplex or 6 nos. duplex RTDs (two per phase), each having D.C. resistance of 100 ohms at 0°C, embedded in the stator winding at locations where highest temperatures may be expected, shall be provided. The material of the ETD's shall be platinum.

3.18.0 Bearings

- Motor shall be provided with antifriction bearings, unless sleeve bearings are required by the motor application. Bearings shall be provided with seals to prevent leakage of lubricant or entrance of foreign matters like dirt, water etc. into the bearing area.
- Sleeve bearings shall be split type, ring oiled with permanently aligned, close running shaft sleeves. Grease lubricated bearings shall be pre-lubricated and shall have provisions for in-service positive lubrication with grease nipple and relief holes. For sleeve bearings, the bearing housing shall be preferably in end shield itself.
- Vertical shaft motors shall be provided with thrust and guide bearings. Thrust bearing of tilting pad type is preferred. However, if anti-friction bearings can take vertical thrust, thrust and guide bearings are not required.

- Lubricant shall not deteriorate under all service conditions. The lubricants shall be limited to normally available types. For motors rated 30 kW and above re-lubrication facility shall be provided.
- For motor with forced lubrication, a shaft driven oil pump shall be provided along with an electrical auxiliary pump. Alternatively, two motor driven pumps may be provided, one working and one standby. All necessary auxiliaries and accessories shall be provided to complete the system. A pressure gauge and pressure switch for low oil pressure warning and to start the standby oil pump automatically shall also be provided. A motor driven jacking oil pump may be provided, for heavy shaft loads.
- Flow switches shall be provided for monitoring oil flow of forced lubrication bearings, if used. Alarm switch contact rating shall be minimum 0.5 A at 220 V DC and 10 A at 230 V AC.
- For bearing temperature measurement, duplex RTDs shall be provided for each bearing and shall be wired up to the terminal box.
- Each bearing shall be provided with dial type thermometer.
- For all VFD operated motors shall have insulated bearings to prevent flow of shaft currents.
- For motors rated above 1000 KW having shaft length more than 1.5 M shall have insulated bearings to prevent flow of shaft currents.
- All the motors rated <15 kW shall be provided with sealed ZZ bearings.
- Lub oil pressure transmitters shall be provided to DCS for remote monitoring. Lub oil pressure very low trip to HT equipment shall be 2 out of 3 logic.

3.19.0 Terminal Boxes

- Separate terminal boxes of IP 55 degree of protection shall be provided for stator leads. For single core cables, gland plate shall be non-magnetic material. Terminal box of HT motors shall be capable of being turned 360° in steps of 180°. Terminal box of LT motors shall be capable of being turned 360° in steps of 90°. The terminal boxes shall be split type with removable cover with access to connections.
- Terminals for motors shall be stud type, thoroughly insulated from the frame. The terminals shall be clearly identified by phase markings, with corresponding direction of rotation marked on the non-driving end of the motor.
- The terminal box shall be capable of withstanding maximum system fault current for 0.2 sec for all breaker operated motors and shall be provided with explosion vent.
- For contactor operated LT motors, the terminal box shall be capable of withstanding the fault current for 0.2 sec minimum and operating time of MPCB/MCCB.
- Removable gland plates of thickness not less than 2.5 mm sheet steel or 3 mm aluminium (for single core cables) shall be provided for cable boxes.
- Cable spreader box shall be provided for larger cable sizes.
- Cable boxes of HT motors shall be phase segregated type. The terminals of three phases shall be segregated by barriers of metal or fiber glass. For HT motors, cable box design shall be suitable for accommodating cable termination kits.
- Separate terminal box for space heaters shall be provided.
- A separate terminal box of IP 55 degree of protection shall be provided for temperature detectors.
- Motors rated >1000 kW shall be provided with neutral current transformers of PS class on each phase for differential protection in neutral side terminal box. The three phases shall be connected to form the star point after passing through the CTs. The CT details shall be

VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

finalized during detail engineering. Neutral terminal box shall have IP 55 degree of protection.

- The secondary leads of CT shall be wired to separate auxiliary terminal box of IP 55 degree of protection
- All the accessory terminal boxes shall be located on the same side of the main (power) terminal box.
- For LT motors, terminal box shall be located on top, unless otherwise specified.

3.20.0 Earthing Terminals

The frame of each motor shall be provided with two separate and distinct grounding pads complete with tapped hole, GI bolts and washer. The terminal box shall have a separate grounding terminal.

3.21.0 Noise and Vibration

- Motors shall be selected with low noise levels in accordance with IS 12065.
- The peak amplitude of the vibration shall also be within the specified limits of IS: 12075.
- All HT motors shall be provided with vibration pads for mounting vibration detectors.

3.22.0 Name Plates

Motor shall have stainless steel nameplate(s) showing diagram of connections, all particulars as per IS: 325 / IS: 12615 and shall also have 'BEE' marking.

In addition to the minimum information required by IEC/IS, the following information shall be shown on motor rating plate:

- Temperature rise in °C under rated condition and method of measurement.
- Degree of protection.
- Bearing identification no. and recommended lubricant.
- Location of insulated bearings.

3.23.0 Canopy

Canopy shall be provided for all the motors located outdoor. For details, please refer Civil section.

4.0.0 DC MOTORS

DC motors shall be provided where specified/required. DC Motors shall be sized for operation with fixed resistance starting for reliability. DC motors shall be shunt wound type. Motors shall be capable of delivering the rated output at 220 V DC with (+) 10% and (-) 15% variations without exceeding its guaranteed temperature limits. 220 V DC system shall be unearthed. Starting current of the DC motors shall be limited to 200% of the full load current of the motor, and is subject to IS tolerance. DC Motors shall be similar to AC Motors with respect to other features like enclosure type, cooling and class of insulation.

5.0.0 INSTALLATION

Installation shall be carried out as per IS: 900.

6.0.0 PAINTING

Painting shall be carried out by an approved process. Pretreatment shall conform to applicable standard. The equipment shall be subject to a coat of red oxide primer paint. All inside and

VOLUME: II B
TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

outside surface shall be painted with epoxy based paint. The final thickness of paint film on steel shall not be less than 100 microns. Finish shade shall be 631 of IS: 5 (smoke grey).

7.0.0 TESTING AND INSPECTION

7.1.0 Equipment offered shall be of type tested and proven type. Type test certificates for test conducted earlier on similar rating shall be furnished for the motors rated 30 kW and above.

7.2.0 The following type tests shall be conducted on LT motors.

- Measurement of resistance of windings of stator and wound rotor.
- No load test at rated voltage to determine input current power and speed
- Full load test to determine efficiency power factor and slip.
- Temperature rise test.
- Momentary excess torque test.
- High voltage test.
- Test for vibration severity of motor.
- Test for noise levels of motor
- Test for degree of protection
- Over speed test.

7.3.0 The following additional type tests shall be conducted on HT motors.

- No load saturation and loss curves up to approximately 115% of rated voltage
- Measurement of noise at no load.
- Momentary excess torque test
- Full load test
- Temperature rise test at rated conditions.
- Lightning Impulse withstand test on the sample coil shall be as per IEC-60034, part-15
- Surge-withstand test on interturn insulation shall be as per clause no. 5.1.2 of IEC 60034, part-15
- Degree of protection test for the enclosure followed by IR, HV and no load run test.
- Terminal box-fault level withstand test for each type of terminal box.

7.4.0 The following routine tests shall be carried out for the motors as per applicable standards.

- IR of Winding before and after HV tests
- HV test on main winding space heater, RTD, BTD
- Resistance measurement
- No load run test Major Electrical
- Phase sequence and direction of rotation
- Vibration check Major Electrical
- Reduced voltage running test
- Locked rotor test at reduced voltage
- Record of RTD & BTD resistance at the end of no load test
- Test on space heater & RTD
- Visual Control of terminal box and verification of construction with respect to short tested terminal box

7.5.0 The following minimum tests/ checks shall be conducted at site. Any other tests/ checks as per the manufacturer's recommendation shall also be carried out

- Measurement of vibration.
- Measurement of insulation resistance and polarization index.
- Measurement of full load current.
- Test running of the motors, checking the temperature rise and identifying the hot spot etc.

8.0.0 DRAWINGS & DOCUMENTS

The following drawings and documents shall be submitted for approval during detail engineering stage.

- Motor sizing calculation
- Technical particulars
- General arrangement drawings
- Performance curves (Efficiency, power factor, starting current)
- Characteristic curves (Speed torque, Hot/cold with stand time, Negative sequence current)
- Terminal box details
- Test reports
- Sub-vendor list
- Manufacturing quality plan
- Field quality plan



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

DATA SHEET A – MOTORS

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

VOLUME: II B

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

DATA SHEET-A

SL NO.	DESCRIPTION	2X660 MW UDANGUDI SUPERCRITICAL
		STPP
A	General	
1	Manufacturer & country of origin	
2	Motor type	Squirrel cage induction AC motors
3	Efficiency class	For all LT motors, it shall be IE3 class as per IS 12615 except for VFD controlled LT motors, it shall be IE2 class as per IS 12615
4	Type of starting	DOL
5	Maximum acceptable kW rating of LV motor	>0.2 kW and up to 200 kW. LT motors rated up to 125 kW shall be controlled through MPCB/MCCB and contactor. LT motors rated more than 125 kW shall be controlled through air circuit breaker.
6	Rating up to which Single phase motors permitted.	up to 0.2 Kw
7	Installation (Indoors/ Outdoors)	indoor/outdoor
8	Degree Of Protection	IP 55
9	Name of the equipment driven by motor & Quantity	
10	Maximum Power requirement of driven equipment	
11	Rated speed of Driven Equipment	As per system requirement
12	Design ambient temperature	50 deg C
B	Design and Performance Data	
1	Frame size & type designation	DURING DETAILED ENGINEERING
2	Type of duty	All the motors shall be rated for S1 duty for continuous operation. Motors of crane and hoist application shall be intermittent duty. The motors shall be suitable for bus transfer schemes provided on the 11 kV/6.6 kV/415 V systems without any injurious effect on its life.
3	Rated Voltage	240/415 V
4	Rated Frequency	50 Hz
5	System fault level at rated voltage	50 kA for 1 sec.
6	LV System grounding	solidly grounded
7	Permissible variation for	
a	Voltage	±10%
b	Frequency	+3% to -5%
c	Combined voltage & frequency	10%
8	Rated output at design ambient temp (by resistance method)	As per system requirement
9	Synchronous speed & Rated slip	As per system requirement
10	Minimum permissible starting voltage	80% of rated voltage During fast changeover of power supply source, vector difference between the motor residual voltage and the incoming supply voltage shall be about 150% of the rated voltage and the motors shall withstand voltage stress and torque stress developed during that time, which may last for a period of one (1) second. c) The motor shall be capable of operating at full load at a supply voltage of 75% of the rated voltage for 5 minutes.

VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

11	TYPE OF STARTER PROVIDED IN MCC	DOL
12	Starting time in sec with mechanism coupled	
a	At rated voltage	As per manufacturers standard
b	At min starting voltage	
13	Locked rotor current as percentage of FLC (including IS tolerance)	For energy efficient LT motors, locked rotor current shall be as per IS: 12615. Locked rotor current of the VFD controlled AC motors shall be limited to 300% of the full load current, and is subject to IS tolerance
14	Torque	
a	Starting	Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor full load torque. <ul style="list-style-type: none"> • Pull out torque at rated voltage shall not be less than 205% of full load torque. • Motors subjected to reverse rotation shall be designed to withstand the stresses encountered when starting with non-energized shaft rotating at 125% of rated speed in reverse direction.
b	Maximum	
15	Permissible temp rise at rated output over ambient temp & method	Winding shall be class F insulation with temperature limited to class B
16	Noise level at 1.0 m (dB)	Motors shall be selected with low noise levels in accordance with IS 12065.
17	Amplitude of vibration	The peak amplitude of the vibration shall also be within the specified limits of IS: 12075.
18	Efficiency & P.F. at rated voltage & frequency	
a	At 100% load	Premium efficiency (IE3) IS: 12615 .
b	At 75% load	
c	At starting	
C	Constructional Features	
1	Method of connection of motor driven equipment	As per system requirement
2	Applicable Standard	as per relevant standard
3	DOP of Enclosure	IP55
4	Method of cooling	LT motors shall be totally enclosed fan cooled (TEFC), type IC411. The cooling shall be effected by self-driven bi-directional centrifugal fan protected by fan cover. The Alarm switch contact rating shall be minimum 0.5 A at 220 V DC and 10 A at 230 V AC.
5	Class of insulation	All motors shall have class F insulation but limited to class B temperature rise
6	Main terminal box	

VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

a	Type	Separate terminal boxes of IP 55 degree of protection shall be provided for stator leads. For single core cables, gland plate shall be non-magnetic material. Terminal box of LT motors shall be capable of being turned 360° in steps of 90°. The terminal boxes shall be split type with removable cover with access to connections.
b	Power Cable details (Conductor, size, armour/unarmour)	DURING DETAILED ENGINEERING
c	Cable Gland & lugs details (Size, type & material)	DURING DETAILED ENGINEERING The frame of each motor shall be provided with two separate and distinct grounding pads complete with tapped hole, GI bolts and washer. The terminal box shall have a separate grounding terminal.
d	Permissible Fault level (kArms & duration in sec)	Fault withstand rating of motor terminal box (Breaker operated): 415 V system : 50/65 kA for 0.2 second
7	Earth Conductor Size & Material	DURING DETAILED ENGINEERING
8	Space heater details (30KW & ABOVE) (Voltage & watts)	Space heaters rated for 240 V AC, 50 Hz supply shall be provided for motors rated 30 kW'and above to maintain windings in dry condition when motor is standstill.
9	Flame proof motor details (if applicable)	For hazardous location: the enclosure of motors shall following have flame proof construction conforming to applicable standard. <ul style="list-style-type: none"> • Fuel oil area Group – IIB • Hydrogen generation plant area : Group – IIC)
a	Enclosure	
b	suitability for hazardous area	
i	Zone O / I / II	
ii	Group IIA / IIB / IIC	
c	Degree of Protection	
9	No. of Stator winding	As per manufacturers standard
10	Winding connection	As per system requirement
11	Kind of rotor winding	As per manufacturers standard

VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

12	Kind of bearings	<p>Motor shall be provided with antifriction bearings, unless sleeve bearings are required by the motor application. Bearings shall be provided with seals to prevent leakage of lubricant or entrance of foreign matters like dirt, water etc. into the bearing area.</p> <ul style="list-style-type: none"> • Sleeve bearings shall be split type, ring oiled with permanently aligned, close running shaft sleeves. Grease lubricated bearings shall be pre-lubricated and shall have provisions for inservice positive lubrication with grease nipple and relief holes. For sleeve bearings, the bearing housing shall be preferably in end shield itself. • Vertical shaft motors shall be provided with thrust and guide bearings. Thrust bearing of tilting pad type is preferred. However, if anti-friction bearings can take vertical thrust, thrust and guide bearings are not required. • Lubricant shall not deteriorate under all service conditions. The lubricants shall be limited to normally available types. For motors rated 30 kW and above re-lubrication facility shall be provided. <p>For bearing temperature measurement, duplex RTDs shall be provided for each bearing and shall be wired up to the terminal box.</p> <ul style="list-style-type: none"> • Each bearing shall be provided with dial type thermometer. • For all VFD operated motors shall have insulated bearings to prevent flow of shaft currents. <p>Lub oil pressure transmitters shall be provided to DCS for remote monitoring. Lub oil pressure very low trip to HT equipment shall be 2 out of 3 logic.</p>
13	Direction of rotation when viewed from NDE	motor shall be bi-directional
14	Paint Shade & type	Painting shall be carried out by an approved process. Pretreatment shall conform to applicable standard. The equipment shall be subject to a coat of red oxide primer paint. All inside and outside surface shall be painted with epoxy based paint. The final thickness of paint film on steel shall not be less than 100 microns. Finish shade shall be 631 of IS: 5 (smoke grey).
15	Net weight of motor	
16	Outline mounting drawing No (To be enclosed as annexure)	DURING DETAILED ENGINEERING
D	Characteristic curves/ drawings	
1	(To be enclosed for motors of rating >55KW)	
2	Torque speed characteristic	
3	Thermal withstand characteristic	
4	Current vs time	
5	Speed vs time	
E	Tests on motors	

NOTE:

- 1 Please write "As per manufacturers standard" where data is not defined in the project specification.
- 2 Please mention any project specific requirement if any in the datasheet (Add extra row).
- 3 For details which is not applicable please write "NA"

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**


2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

DATA SHEET C- MOTORS

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]


615965/2021/PS-PEM-MAX

	MOTORS	SPECIFICATION NO.
	DATA SHEET – C	VOLUME II B
	2 x 660MW UDANGUDI STPP	SECTION D
		REV NO. 00 DATE 21.05.18
		SHEET 1 OF 2

S. No.	Description	Data to be filled by successful bidder
A.	General	
1	Manufacturer & country of origin	
2	Motor type	
3	Type of starting	
4	Name of the equipment driven by motor & Quantity	
5	Maximum Power requirement of driven equipment	
6	Rated speed of Driven Equipment	
7	Design ambient temperature	
B.	Design and Performance Data	
1	Frame size & type designation	
2	Type of duty	
3	Rated Voltage	
4	Permissible variation for	
5	a) Voltage	
6	b) Frequency	
7	c) Combined voltage & frequency	
8	Rated output at design ambient temp (by resistance method)	
9	Synchronous speed & Rated slip	
10	Minimum permissible starting voltage	
11	Starting time in sec with mechanism coupled	
12	a) At rated voltage	
13	b) At min starting voltage	
14	Locked rotor current as percentage of FLC (including IS tolerance)	
15	Torque	
	a) Starting	
	b) Maximum	
16	Permissible temp rise at rated output over ambient temp & method	
17	Noise level at 1.0 m (dB)	
18	Amplitude of vibration	
19	Efficiency & P.F. at rated voltage & frequency	
	a) At 100% load	
	c) At 75% load	

NAME OF VENDOR			SEAL	REV.
NAME	SIGNATURE	DATE		

615965/2021/PS-PEM-MAX

	MOTORS	SPECIFICATION NO.
	DATA SHEET – C	VOLUME II B
	2 x 660MW UDANGUDI STPP	SECTION D
		REV NO. 00 DATE 21.05.18
		SHEET 2 OF 2

S. No.	Description	Data to be filled by successful bidder
	c) At starting	
C.	Constructional Features	
1	Method of connection of motor driven equipment	
2	Applicable Standard	
3	DOP of Enclosure	
4	Method of cooling	
5	Class of insulation	
6	Main terminal box	
	a) Type	
	b) Power Cable details (Conductor, size, armour/unarmour)	
	c) Cable Gland & lugs details (Size, type & material)	
	d) Permissible Fault level (kArms & duration in sec)	
7	Space heater details (Voltage & watts)	
8	Flame proof motor details (if applicable)	
	a) Enclosure	
	b) suitability for hazardous area	
	i Zone	O / I / II
	ii Group	IIA / IIB / IIC
9	No. of Stator winding	
10	Winding connection	
11	Kind of rotor winding	
12	Kind of bearings	
13	Direction of rotation when viewed from NDE	
14	Paint Shade & type	
15	Net weight of motor	
16	Outline mounting drawing No (To be enclosed as annexure)	
D.	Characteristic curves/ drawings (To be enclosed for motors of rating $\geq 55KW$)	
	a) Torque speed characteristic	
	b) Thermal withstand characteristic	
	c) Current vs time	
	d) Speed vs time	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B


SECTION: D

REV NO: 00

DATE:

QUALITY PLAN (MOTOR)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :	DATE:
		CUSTOMER :		QP NO.: PE-QP-999-Q-006, REV-02	DATE: 17.04.2020
		PROJECT:		PO NO.:	DATE:
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))	SYSTEM:	SECTION: II	SHEET 1 of 2

S. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY				REMARKS
					6	C/ N				*	**			
1	2	3	4	5			M	C/ N	7		8	9	D	M
1.0	ASSEMBLY	1.WORKMANSHIP	MA	VISUAL	100%	-	MFG. SPEC.	MFG. SPEC.	LOG BOOK		P	-	-	
		2.DIMENSIONS	MA	VISUAL	100%	-	MFG. DRG./ MFG. SPEC.	MFG. DRG./ MFG. SPEC.	LOG BOOK		P	-	-	
		3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE	MA	VISUAL	100%	-	MFG.SPEC./	MFG.SPEC.	LOG BOOK		P	-	-	
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	-	MFG. SPEC/ APPROVED DATASHEET	MFG. SPEC/ APPROVED DATASHEET	LOG BOOK	✓	P	V	-	
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST	MA	VISUAL	100%	-	IS-325 / IS-12615/ APPROVED DATA SHEET	IS-325 / IS-12615/ APPROVED DATA SHEET	TEST/ INSPN. REPORT	✓	P	V*	-	* NOTE -1
		2.OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	-	APPROVED DRG/ DATA SHEET	APPROVED DRG/ DATA SHEET	TEST/ INSPN. REPORT	✓	P	V*	-	* NOTE -1 & NOTE-2

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by:	HEMA KUSHWAHA		Checked by:	KUNAL GANDHI	
Reviewed by:	PRAVEEN DUTTA		Reviewed by:	RITESH KUMAR JAISWAL	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
Sign & Date	Name		Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :	DATE:
		CUSTOMER :		QP NO.: PE-QP-999-Q-006, REV-02	DATE: 17.04.2020
		PROJECT:		PO NO.:	DATE:
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))	SYSTEM:	SECTION: II	SHEET 2 of 2

		3.NAMEPLATE DETAILS	MA	VISUAL	100%	-	IS-325 / IS-12615 / APPROVED DATA SHEET	SAME AS COL. 7	TEST/ INSPN. REPORT	✓	P	V	-	
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MFG. STANDARD / (#)	AS PER MFG. STANDARD / (#).	INSPC. REPORT	✓	P	W	-	(#) REFER NOTE-8

NOTES:

1. Routine tests on 100% motors shall be done by the vendor. However, BHEL/ Customer shall witness routine tests on random samples. The sampling plan shall be mutually agreed upon.
2. For exhaust/ventilation fan motors of rating up to 1.5 KW, only routine test certificates shall be furnished for scrutiny.
3. In case test certificates for these tests on similar type, size and design of motor from independent laboratory are available, the same is valid for 5 years.
4. BHEL reserves the right to perform repeat test, if required.
5. After packing and prior to issue MDCC, photographs of items to be despatched shall be sent to BHEL for review.
6. In case of any changes in QP commented by customer at contract stage, same shall be carried out by bidder without any implication to BHEL/ Customer.
7. Project specific QP to be developed based on customer requirement.
8. For export job, BHEL technical specification for seaworthy packing to be followed.
9. Packing shall be suitable for storage at site in tropical climate conditions.
10. Latest revision/ year of issue of all the standards (IS/ ASME/ IEC etc.) indicated in QP shall be referred.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION,


** **M:** SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, **B:** MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, **C:** CUSTOMER,

P: PERFORM, **W:** WITNESS, **V:** VERIFICATION, AS APPROPRIATE

MA: MAJOR, **MI:** MINOR, **CR:** CRITICAL

D: DOCUMENTATION

BHEL					BIDDER/ SUPPLIER		FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING			QUALITY		Sign & Date		Doc No:			
	Sign & Date	Name		Sign & Date	Name	Seal		Sign & Date	Name	Seal
Prepared by:		HEMA KUSHWAHA	Checked by:		KUNAL GANDHI					
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		RITESH KUMAR JAISWAL					


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		DATE: 17.04.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		SECTION: II

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY		
					M	C/N				D	M	C
1.0	RAW MATERIAL & BOUGHT OUT CONTROL											
1.1	SHEET STEEL, PLATES, SECTION, EYEBOLTS	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM BLINKS, CRACKS, WAVINESS ETC	LOG BOOK	P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK	P	-	-
		3.PROOF LOAD TEST (EYE BOLT)	MA	MECH. TEST	SAMPLE	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TEST REPORT	P/V	-	-
1.2	HARDWARES	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM CRACKS, UN-EVENNESS ETC.	TEST REPORT	P	-	-
		2.PROPERTY CLASS	MA	VISUAL	SAMPLES	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TC	P/V	-	-
1.3	CASTING	1.SURFACE CONDITION	MA	VISUAL	100%	-	MANUFACTURER'S DRG./SPEC	FREE FROM CRACKS, BLOW HOLES ETC.	LOG BOOK	P/V	-	-
		2.CHEM. & PHY. PROP.	MA	CHEM & MECH TEST	1/HEAT NO.	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TC	P/V	-	-
		3.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	LOG BOOK	P/V	-	-
1.4	PAINT & VARNISH	1.MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100%	CONTINUOUS	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK	P/V	-	-

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by:	HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI	
Reviewed by:	PRAVEEN DUTTA	Reviewed by:		R K JAISWAL	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE:17.04.2020 SHEET 2 OF 9
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N				D	M	C	N	
1.5	SHAFT (FORGED OR ROLLED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		P	-	-	VENDOR'S APPROVAL IDENTIFICATION SHALL BE MAINTAINED
		2. CHEM. & PHYSICAL PROPERTIES	MA	CHEM. & PHYSICAL TESTS	1/HEAT NO. OR HEAT TREATMENT BATCH NO	-	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S DRG./ STD.	TC		P/V	-	-	
		3. DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S DRG.	LOG BOOK		P/V	-	-	
		4. INTERNAL FLAWS	CR	ULTRASONIC TEST	100%	-	ASTM-A388	MANUFACTURER'S STD.	INSPECTION REPORT	✓	P/W	V	-	FOR DIA OF 55 MM & ABOVE
1.6	SPACE HEATERS, CONNECTORS, TERMINAL BLOCKS, CABLES, CABLE LUGS, CARBON BRUSH TEMP. DETECTORS, RTD, BTD'S	1. MAKE & RATING	MA	VISUAL	100%	-	MANUFACTURER'S DRG./STD.	MANUFACTURER'S DRG./STD.	INSPECTION REPORT		P/V	-	-	
		2. PHYSICAL COND.	MA	VISUAL	100%	-	MANUFACTURER'S DRG./STD.	NO PHYS. DAMAGE, NO ELECTRICAL DISCONTINUITY	INSPECTION REPORT		P/V	-	-	
		3. DIMENSIONS (WHEREVER APPLICABLE)	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG./ STD	MANUFACTURER'S DRG. / STD.	INSPECTION REPORT		P/V	-	-	
		4. PERFORMANCE/ CALIBRATION	MA	TEST	100%	-	MANUFACTURER'S DRG./ STD	MANUFACTURER'S DRG. / STD.	TEST REPORT		P/V	-	-	

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		DATE:17.04.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		SECTION: II

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY							
					6					7	8	9	.	**			
					M	C/N									D	M	C
1.7	OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC.	1. SURFACE COND. ETC.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS	TEST REPORT		P/V	-	-				
		2.DIMENSION(BORE DIA, WALL THICKNESS, BDV AS RECEIVED, BDV AFTER FOLDING AT 180°	MA	TEST	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK AND OR SUPPLIER'S TC		P/V	-	-				
1.8	SHEET STAMPING (PUNCHED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS (FREE FROM BURS)	LOG BOOK		P	-	-				
		2.DIMENSIONS INCLUDING BURS HEIGHT	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG. .	MANUFACTURER'S DRG.	LOG BOOK		P/V	-	-				
		3. ACCEPTANCE TESTS	MA	ELECT. & MECH TESTS	SAMPLE	-	MANUFACTURER'S DRG./ STD.	MANUFACTURER'S DRG./ STD.	TC		P/V	-	-				
1.9	CONDUCTORS	1. SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		*P/V	-	-	* MOTOR MANUFACTURER TO CONDUCT VISUAL CHECK FOR SURFACE FINISH ON RANDOM BASIS (10% SAMPLE) AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY			
		2.ELECT. PROP. & MECH. PROP	MA	ELECT. & MECH.TEST	SAMPLES	-	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S / SPEC.	TC & VENDOR'S TEST REPORTS		P/V	-	-				

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		DATE:17.04.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	SECTION: II	SHEET 4 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY								
					6	C/N				7	8	9	.	**	D	M	C	N
1.10	BEARINGS	3.DIMENSIONS 1.MAKE & TYPE 2.DIMENSIONS	MA MA MA	MEASUREMENT VISUAL MEASUREMENT	SAMPLES 100% SAMPLE	- - -	MANUFACTURER'S DRG/ SPEC. MANUFACTURER'S DRG/ APPROVED DATASHEET APPROVED DATASHEET	MANUFACTURER'S / SPEC. MANUFACTURER'S DRG./ APPROVED DATASHEET APPROVED DATASHEET/ BEARING MANUF'S CATALOGUES	LOG BOOK LOG BOOK LOG BOOK	P/V P/V P/V	- - -	- - -	- - -					
1.11	SLIP RING (WHEREVER APPLICABLE)	1.SURFACE COND. 2.DIMENSIONS 3.TEMP.WITH- STAND CAPACITY	MA MA MA	VISUAL MEASUREMENT ELECT.TEST	100% SAMPLE SAMPLE	- - -	- MANUFACTURER'S DRG MANUFACTURER'S STD./ APPROVED DATASHEET	FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG	LOG BOOK LOG BOOK LOG BOOK	P P P/V	- - -	- - -	- - -					
1.12	OIL SEALS & GASKETS	1.MATERIAL OF GASKET 2.SURFACE COND. 3.DIMENSIONS	MA MA MA	VISUAL VISUAL MEASUREMENT	100% 100% SAMPLE	- - -	MANUFACTURER'S DRG/SPECS - MANUFACTURER'S DRG	MANUFACTURER'S DRG./ SPECS, FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG	LOG BOOK LOG BOOK LOG BOOK	P P P	- - -	- - -	- - -					

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		DATE: 17.04.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	SECTION: II	SHEET 5 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY							
					M	C/N			9	*	**	D	M	C	N			
2.0	IN PROCESS																	
2.1	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNESS	MA	VISUAL	100%	-	MANUFACTURER'S DRG	GOOD FINISH	LOG BOOK		P/W	-	-					
		2.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-					
2.2	MACHINING	1.FINISH	MA	VISUAL	100%	-	-DC-	GOOD FINISH	LOG BOOK		P	-	-					
		2.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-					
		3.SHAFT SURFACE FLOWS	MA	PT	100%	-	MANUFACTURER'S STD./ASTM-E165	MANUFACTURER'S STD./APPROVED DATASHEET.	LOG BOOK	✓	P	V	-					
2.3	PAINING	1.SURFACE PREPARATION	MA	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-					
		2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MA	MEASUREMENT BY ELCOMETER	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-					
		3.SHADE	MA	VISUAL	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-					
		4.ADHESION	MA	CROSS CUTTING & TAPE TEST	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-					

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		DATE: 17.04.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	SECTION: II	SHEET 6 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					M	C/N			9	.	**	D	M	C
2.4	SHEET STACKING	1.COMPLETENESS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-	
		2.COMPRESSION & TIGHTENING	MA	MEASUREMENT	100%	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-	
2.5	WINDING	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-	
		2.CLEANLINESS	CR	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-	
		3.IR-HV-IR	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT	✓	P	V	-	
		4.RESISTANCE	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT	✓	P	V	-	
		5.INTERTURN INSULATION	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT		P	-	-	
2.6	IMPREGNATION	1.VISCOSITY	MA	PHY. TEST	AT STARTING	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		2.TEMP. PRESSURE VACCUM	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		3.NO. OF DIPS	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-	THREE DIPS TO BE GIVEN

BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by:	HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI	
Reviewed by:	PRAVEEN DUTTA	Reviewed by:		R K JAISWAL	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE:17.04.2020 SHEET 7 OF 9
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT, MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
					M	C/N				D	M	C	N
2.7	COMPLETE STATOR ASSEMBLY	4.DURATION 1.COMPACTNESS & CLEANLINESS	MA MA	PROCESS CHECK VISUAL	CONTINUOUS 100%	- -	MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD	LOG BOOK LOG BOOK	✓ -	P P	V -	- -
2.8	BRAZING/COMPRESSION JOINT	1.COMPLETENESS 2.SOUNDNESS	CR CR	VISUAL MALLETT TEST & UT	100% 100%	- -	MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD MANUFACTURER'S STANDARD	LOG BOOK TEST INSPC. REPORT	- ✓	P P	- V	- -
2.9	COMPLETE ROTOR ASSEMBLY	3.HV 1.RESIDUAL UNBALANCE	MA CR	ELECT. TEST DYN. BALANCE	100% 100%	- -	MANUFACTURER'S STANDARD MANUFACTURER'S SPEC./ ISO 1940	MANUFACTURER'S STANDARD MANUFACTURER'S DWG.	TEST INSPC. REPORT LOG BOOK	✓ -	P P	V -	- -
2.10	ASSEMBLY	2.SOUNDNESS OF DIE CASTING 1.ALIGNMENT 2.WORKMANSHIP 3.AXIAL PLAY 4.DIMENSIONS 5.CORRECTNESS, COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE 6. RTD, BTD & SPACE HEATER MOUNTING.	CR MA MA MA MA MA	ELECT. (GROWLER TEST) MEAS. VISUAL MEAS. MEAS. VISUAL VISUAL	100% 100% 100% 100% 100% 100%	- - - - - -	MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S DRG./ MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S DRG./ MANUFACTURER'S SPEC. MANUFACTURER'S SPEC. MANUFACTURER'S SPEC.	TEST INSPC. REPORT LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK	✓ - - ✓ - - ✓	P P P P P P	V - - V - - V	- - - - - -

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :	
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04	DATE:17.04.2020
		PROJECT:		PO NO.:	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 8 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N				D	M	C	N	
3.0	TESTS	1.TYPE TESTS INCLUDING SPECIAL TESTS	MA	ELECT.TEST	1/TYPE/SIZE	1/TYPE/SIZE	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	✓	P	W*	-	* NOTE - 1
		2.ROUTINE TESTS INCLUDING SPECIAL TEST	MA	ELECT.TEST	100%	-	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	✓	P	√ [§]	-	§ NOTE - 2
		3.VIBRATION & NOISE LEVEL	MA	ELECT.TEST	100%	-	IS: 12075 / IEC 60034-14 & IS-12065	IS: 12075 / IEC 60034-14 & IS-12065	TEST REPORT	✓	P	√ [§]	-	§ NOTE - 2
		4.OVERALL DIMENSIONS AND ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET &	TEST/INSPC. REPORT	✓	P	W	-	
		5.DEGREE OF PROTECTION	MA	ELECT. & MECH. TEST	1/TYPE/ SIZE	-	IEC 60034-5/IS-12615	APPROVED DATASHEET	TC	✓	P	V	-	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		6. MEASUREMENT OF RESISTANCE OF RTD & BTD	MA	ELECT. & MECH. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1/IS: 12802	IS-325/IS-12615/IEC-60034 PART-1/IS: 12802	TC	✓	P	√ [§]	-	§ NOTE - 2
		7. MEASUREMENT OF RESISTANCE, IR OF SPACE HEATER	MA	ELECT. & MECH. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TC	✓	P	√ [§]	-	§ NOTE - 2
		8. NAME PLATE DETAILS	MA	VISUAL	100%	-	IS-325/IS-12615& DATA SHEET	IS-325/IS-12615 & DATA SHEET	TEST/INSPC. REPORT	✓	P	√ [§]	-	§ NOTE - 2
		9.EXPLOSION FLAME PROOF NESS (IF SPECIFIED)	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	-	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	-	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		10. PAINT SHADE, THICKNESS & FINISH	MA	VISUAL & MEASUREMENT BY ELKOMETER	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC	✓	P	W [§]	-	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY § NOTE - 2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		DATE:17.04.2020 SHEET 9 OF 9
		CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II		

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
1	2	3	4	5	6		7	8	9	10				
					M	C/N				D	M	C	N	
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MANUFACT. STANDARD / (#)	AS PER MANUFACT. STANDARD / (#)	INSPC. REPORT	✓	P	W	-	(#) REFER NOTE-8

NOTES:

- 1 DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
- 2 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR, HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES, THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THE SAME IS VALID FOR 5 YEARS.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
- 6 IN CASE , ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.
- 7 PROJECT SPECIFIC QP TO BE DEVELOPED BASED ON CUSTOMER REQUIREMENT.
- 8 FOR EXPORT JOB, BHEL TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING TO BE FOLLOWED.
- 9 PACKING SHALL BE SUITABLE FOR STORAGE AT SITE IN TROPICAL CLIMATE CONDITIONS.
- 10 LATEST REVISION/ YEAR OF ISSUE OF ALL THE STANDARDS (IS/ ASME/ IEC ETC.) INDICATED IN QP SHALL BE REFERRED.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(v) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

ELECTRICAL ACTUATOR DETAILS

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

ELECTRICAL ACTUATORS

1.0.0 INTENT OF SPECIFICATION

This section covers the requirements of motor operated electrical actuators.

2.0.0 CODES AND STANDARDS

The equipment to be furnished under this specification shall be in accordance with the applicable section of the latest edition (including amendments) of the applicable Indian Standards (IS), IEC publications and other codes except where modified and /or supplemented by this specification.

3.0.0 TECHNICAL REQUIREMENTS

3.1.0 Electric actuators shall be provided as specified in Mechanical and C&I section. It shall be equipped with 3 phase induction motor, rated for S2-15 minutes duty for ON/OFF valve and intermittent duty for inching duty

3.2.0 Motor shall be class F insulated with temperature rise limited to class B. Motor shall be of class H insulation with temperature limited to class B used for high pressure and high temperature valves.

3.3.0 Motor shall be surface cooled designed for enclosure protection class of IP 67. Motor shall be suitable for starting direct on-line.

3.4.0 For installation in potentially hazardous areas, the actuators shall have suitable explosion proof / flame proof type enclosure.

3.5.0 Actuators shall be suitable for operation at an ambient temperature of 50 degree C and relative humidity of 95%.

3.6.0 Maximum continuous motor rating shall be atleast 10% above the maximum load derived of the driven equipment under entire operating range including voltage & frequency variation.

3.7.0 Motors shall be capable of operating under following supply variations without exceeding its guaranteed temperature limits.

- Frequency variation : (+) 3% and (-) 5% of 50 Hz
- Voltage variation for LT motors : (±) 10% of 415 V
- Combined variation of voltage and frequency: 10% (absolute sum)

3.8.0 All actuators shall be of integral type. Duty cycle of actuators shall suit the system requirement. The actuators shall be capable of giving the required torque at the output shaft. The actuators shall be designed to take the full thrust.

3.9.0 Electrical Actuators of Inching type position transmitters of non contact type shall be interfaced to DCS.

3.10.0 Actuators shall be of totally enclosed weather proof and dust proof construction with NEMA-6/IP 65 enclosure and shall be suitable for outdoor application without the necessity for a canopy. The actuator shall be suitable for mounting directly on the valve. The actuator shall be capable of giving the required torque, rpm and thrust without the help of any spur gear arrangement. The actuator shall be suitable for mounting in any position. Actuators shall be provided with integral starters.

TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- 3.11.0 The actuator shall be complete with motor, reduction gears, change gears, terminal compartment, switch compartment with limit switches and torque switches, local position indicator, position transmitter for remote position indicator, thermistor, space heaters, cable glands, mechanical position indicator, hand wheel for manual operation, valve attachment etc.
- 3.12.0 Each actuator shall have a hand wheel fitted on it for emergency operation. The hand wheel shall be designed such that it is declutched automatically when the power supply to the motor is restored. The material of the hand wheel shall be either malleable iron or steel. The hand wheel shall have adequate clearance from housing for each gripping and operation. Actuators offered shall be with self-locking worm.
- 3.13.0 Two number adjustable torque switches (one for open and one for close) each with 2 NO and 2 NC potential free contacts shall be provided. It is required to have calibration for the torque switches so that the switches can be easily set to any value desired.
- 3.14.0 Two numbers of position limit switches (one for open and one for close) each with 2 NO and 2 NC potential free contacts shall be provided. Two auxiliary limit switches (one for open and one for close) with 2 NO and 2 NC potential free contacts shall also be provided. The limit switches shall be of independently adjustable type. Limit switches and actuating mechanism shall be rust proof suitable for damp atmospheres. Limit switch compartment shall be weather proof and spacious enough for easy setting. The limit switches shall be suitable for the following ratings, both 240 Volts AC, 10 A and 220 V DC, 0.5 Amps.
- 3.15.0 Each actuator shall have a space heater in the limit switch compartment suitable for 240 V AC 50 Hz single phase supply.
- 3.16.0 The wiring from the limit switches, torque switches etc. shall be brought out in a separate terminal box of adequate size, so as to easily terminate the control cables.
- 3.17.0 Actuators shall be supplied with integral starter which shall have sophisticated electronic controls with field programming feature. It shall be designed for remote control from DCS/Respective control system. Required interposing relays for receiving open/close/stop command from DCS/Respective control system shall be provided. Potential free contacts and transducers shall be provided to provide status indication at remote DCS/Respective control system..
- 3.18.0 A three position selector switch (marked as LOCAL-OFF-REMOTE) and push buttons OPEN-STOP-CLOSE (for local operation) with indication lamps for running OPEN and running CLOSE shall be provided.
- 3.19.0 The Remote command signal (OPEN-STOP-CLOSE) from DCS/Respective control system/Control panel shall be isolated from control electronics through opto-isolator.
- 3.20.0 The following individual sStatus annunciation LED's and fault annunciation LED's shall be provided locally (Integral to actuator) to annunciate the following for easy local monitoring.
- Actuator in local mode
 - Actuator in remote mode
 - Actuator running in OPEN direction
 - Actuator running in CLOSE direction
 - Actuator in inching mode.
 - Actuator in self-retaining mode
 - Limit switch OPEN trip
 - Limit switch CLOSE trip
 - Control voltage availability
- 3.21.0 The following individual fault annunciation LED's (Colour-Red) shall be provided locally. (Integral to Actuator)

TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- Torque switch OPEN
- Torque switch CLOSE
- Thermo switch trip
- Electronic overload relay trip
- Motor single phasing
- Common fault (Inclusive of any one or combination of above fault)

3.22.0 View port shall be provided on integral starter unit to monitor the above status annunciation and fault annunciation.

3.23.0 Electronic Overload relay shall be provided to trip actuator in case of overload. Plug in connections/design shall be provided between:-

- Integral starter unit and basic actuator
- Between external customer connections and actuator.

3.24.0 OPEN-CLOSE indication /LED shall be provided for indication of full open/close position.

3.25.0 Automatic phase correction facility and potential free contact for annunciation of power failure shall be provided.

3.26.0 The following individual potential free relay contacts shall be provided in the actuator for remote annunciation to facilitate continuous monitoring of the actuator.

- Actuator (valve) running in OPEN direction.
- Actuator (valve) running in CLOSE direction.
- Actuator in remote mode.
- Actuator in local mode.
- Actuator power switched off /single phasing.
- Torque switch trip, thermo switch trip and overload relay trip

4.0.0 TESTING AND INSPECTION

Equipment offered shall be of type tested and proven type. Routine tests shall be carried out for all the equipment as per applicable standards. Copies of certified reports of all tests carried out at the works shall be furnished.

The following minimum tests/ checks shall be conducted at site. Any other tests/ checks as per the manufacturer's recommendation shall also be carried out.

- Measurement of insulation resistance.
- Measurement of full load current.
- Test running of the motors.

5.0.0 DRAWINGS & DOCUMENTS

The following drawings and documents shall be submitted for approval during detail engineering stage.

- Integral starter details
- Technical particulars of actuator
- Wiring diagram
- General arrangement drawings
- Test reports
- Manufacturing quality plan
- Field quality plan

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001	
VOLUME: II-B	
SECTION: D	
REV NO: 00	DATE:

CABLE SCHEDULE FORMAT

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

1. For the purpose of clarity, it may please be noted that the information given in regard to the cables to be routed through WinPath as per the system elaborated below is called "Cable List", while the term "Cable Schedule" applies to the cable list with routing information added after routing has been carried out.
2. The cable list shall be entered as an MS Excel file in the format as per enclosed template EXT_CAB_SCH_FORMAT.XLS. No blank lines, special characters, header, footer, lines, etc. shall be introduced in the file. No changes shall be made in the title line (first line) of the template.
3. The field properties shall be as under:
 - a. UNITCABLENO: A/N, up to sixteen (16) characters; each cable shall have its own unique, unduplicated cable number. In case this rule is violated, the cable cannot be taken up for routing.
 - b. FROM: A/N, up to sixty (60) characters; the "From" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - c. TO: A/N, up to sixty (60) characters; the "To" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - d. PURPOSE: A/N, up to sixty (60) characters; the purpose (i.e. power cable/ indication/ measurement, etc.) to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - e. REMARKS: A/N, up to forty (40) characters; Any information pertinent to routing to be specified here (e.g., cable number of the cable redundant to the cable number being entered). Information in excess of 40 characters will be truncated after 40 characters.
 - f. CABLESIZE: A/N, 7 characters exactly as per the codes indicated below shall be specified here. The program cannot route cables described in any other way/ format.
 - g. PATHCABLENO: Field reserved for utilization by the program. User shall not enter any information here.
4. One list shall be prepared for each system/ equipment (i.e., separate and unique cable lists shall be prepared for each system).
5. The cables shall be described as per the scheme listed below:

A	NN	A	NNN
Cable	No. of cores	Cable code	Cable size
Voltage	(e.g. 01,03,3H, 07)	(See C below)	(e.g. 035,185,2.5, 0.5)
Code (see B below)			

(A) SYSTEM VOLTAGE CODES:

(ac) A = 11KV, B = 6.6KV, C = 3.3KV, D = 415V, E = 240V, F = 110V
(dc) G = 220V, H = 110V, J = 48V, K = +24V, L = -24V

(B) CABLE VOLTAGE CODES:

A = 11KV (Power cables)

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

- B = 6.6KV (Power cables)
- C = 3.3KV (Power cables)
- D = 1.1KV (LV & DC system power & control cables)
- E = 0.6KV (0.5 sq. mm. Control cables)

(C) CABLE CODES

PVC Copper

- A = Armoured FRLS
- B = Armoured Non-FRLS
- C = unarmoured FRLS
- D = Unarmoured Non-FRLS

PVC Aluminium

- E = Armoured FRLS
- F = Armoured Non-FRLS
- G = unarmoured FRLS
- H = Unarmoured Non-FRLS

XLPE Copper

- J = Armoured FRLS
- K = Armoured Non-FRLS
- L = unarmoured FRLS
- M = Unarmoured Non-FRLS

XLPE Aluminium

- N = Armoured FRLS
- P = Armoured Non-FRLS
- Q = unarmoured FRLS
- R = Unarmoured Non-FRLS

- S = FIRE SURVIVAL CABLES
- T = TOUGH RUBBER SHEATH
- U = OVERALL SCREENED
- V = PAIRED OVERALL SCREENED
- W = PAIRED INDIVIDUAL SCREENED
- Y = COMPENSATING CABLES
- I = PRE-FABRICATED CABLES
- Z = JELLY FILLED CABLES



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

SECTION-D3

(GENERAL TECHNICAL REQUIREMENT FOR C&I)

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

DESIGN REQUIREMENT OF C&I

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

DESIGN REQUIREMENT

1.0.0 DESIGN REQUIREMENT

- 1.1.0 The Instrumentation and control systems shall be provided for safe, reliable and efficient operation of the thermal power project. In general a consistent control and instrumentation philosophy is to be applied throughout the power project. Adequate redundancy are to be ensured, so that no single point failure of the I&C systems/ equipments in the power project does not result in the overall reduction of the plant output. In general all I&C systems/ equipments should be of modern and compact design, incorporating proven technology and modern industrial practice.
- 1.1.1 The minimum target reliability of each piece of equipment like each electronic module/card, Power supply, Peripheral etc. considering its failure rate/mean time between failures (MTBF), meantime to repair (MTTR), such that the availability of the complete C&I system is assured for 99.7%.
- 1.1.2 The design of the control systems and related equipments shall adhere to the principle of 'Fail Safe' operation wherever safety of personnel / plant equipment is involved. 'Fail Safe' operation signifies that the loss of signal, loss of excitation or failure of any component shall not cause a hazardous condition. However, it shall also be ensured that the C&I system design with respect to control and protection functions is 'Fault Tolerant' to single faults such that the occurrence of false trips and degradation of functions are avoided / minimised. The types of failure which shall be taken into account for ensuring operability of the plant shall include but not limited to;
- a) Failure of sensor or transmitter,
 - b) Failure of main and/or redundant controller, other electronic modules,
 - c) Loss of motive power to final control element,
 - d) Loss of control power.
 - e) Loss of instrument air
- 1.1.3 Standardization concepts shall be applied wherever possible to rationalize operation, maintenance and reduce spare parts The choice of hardware shall also take into account for sound maintainability principles and techniques. The same shall include but shall not be limited to the following:
- a) Standardization of parts.
 - b) Minimum use of special tools.
 - c) Grouping of functions.
 - d) Interchangeability.
 - e) Malfunction identification facility/self surveillance facility.
 - f) Easy modular replacement.
 - g) Fool proof design providing proper identification and other features to preclude
 - h) Improper mounting and installation.
 - i) Appropriate derating of electronic components and parts.
- 1.1.4 The design, manufacture, assembly, testing as well as performance of the equipment shall conform to the latest edition of relevant IEC/ISA and other international codes/specifications. The I & C equipment and systems shall be designed, manufactured & installed to meet the specification requirements, and perform accurately and safely under the operating and environmental conditions existing in the power project. The Instrumentation and control equipment shall be designed suitably that are subjected to saline atmosphere.

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- 1.1.5 All control and instrumentation functions shall be shown on the piping and instrumentation diagrams. The symbols to be used shall be in accordance with ISA / ISO standard. The identification system (tag numbers) shall be in accordance with the KKS identification system, and shall be subject to approval by the Owner. All measurements and alarms shall be listed. Complete schematic control diagrams shall be provided for all instrumentation. Functional application and also specific control (modulating/interlock) application (by short text) for each measurement along with signal destination shall be indicated in Process and Instrumentation Diagram (P&ID). All reference engineering documents shall also be indicated in the P&ID.
- 1.1.6 Automatic single push button start facility from the plant DCS to be provided for the main plant equipments such as BMS, BPS, STG, and other DCS controlled systems. For balance of plant systems such as water treatment plant, Instrument and service air compressor, seawater system etc the controls are to be designed such that fully automatic operation should be possible from the plant DCS and minimum local intervention.
- 1.1.7 The system will have 1:1 redundancy with respect to the processor modules, power supply modules, communication modules and network interface.
- The system will be designed in such a manner that in the event of failure of the primary controller, the entire configuration of the failed controller will be instantaneously and automatically transferred to the back-up controller without operator's intervention. Mode changeover in either direction will be bumpless.
- Dual redundant power supplies to be provided for all the I&C panels. Loss of single power supply shall be alarmed in DCS for corrective action by the operator
- 1.1.8 Measurement system (MS), Closed Loop Control System (CLCS) and Open Loop Control System (OLCS) will all be configured with redundancy at processor modules, communication modules, data bus and power supply modules.
- 1.1.9 Redundant Input and output modules shall be provided for all the drive level interface (both OLCS/CLCS). For the inputs, dual or triple measurement as described in clause 2.1.0 of Section 4.8 and Clause 2.1.0 of Section 4.9 shall be provided and the individual measurements (dual or triple) shall be wired to separate input modules. No redundancy at I/O card level is required which are executing purely Data acquisition/Monitoring functions. I/O's redundancy shall be truly redundant and not engineered I/O redundancy. For measurement system, redundancy at sensor level and I/O module level is not envisaged. Logics for the redundant drives shall not be in the same processor.
- 1.1.10 The Measurement system shall have the following features:
- a) Linearization for temperature measurement i.e. mv Vs Deg. C
 - b) Square root extraction for flow measurement, where the measurement is in differential pressure.
 - c) Integration for totalizing the flow measurement, whenever applicable.
 - d) Compensation for variation in pressure or temperature or density for flow/ level measurement. E.g.: Feed water flow.
 - e) Limit value monitor for generation of contacts for alarm/interlock purpose. Eg.: Boiler Tube metal, Bearing, winding temperature measurements
 - f) Each of the analog transmitters shall be Smart type with the following:
 - (i) 4-20mA DC signal with 24V DC interrogation.
 - (ii) HART protocol based digital communication
 - g) All these Transmitters shall be hooked up to a PC based Centralised Calibration system (HART System), which shall have Diagnostic and Configuration software. This system shall be located in Computer room.
 - f) All contact inputs shall be interrogated with 24 / 48 V DC

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- 1.1.11 Where redundant sensors are provided redundancy at I/O card level is not required. Redundant sensors will be provided for all control applications.
- 1.1.12 The communication sub system will be a real time reliable communication network between control processors, operator stations, printers and engineering station.
- 1.1.13 The plant bus and communication bus shall have dual redundancy
- 1.1.14 Triple Sensors for unit/equipment and protection trip are applicable for main plant equipments and equipments which will affect plant availability.
- 1.1.15 Dual redundant sensors shall be provided as a minimum in 1 out of 2 logic for all other closed loop and open loop controls used for protection.
- 1.1.16 Sequence of event recording system shall be integral to DCS
- 1.1.17 A consistent control and instrumentation philosophy shall be applied throughout the plant and be implemented in terms of a range of equipment exhibiting a minimum diversity of type and manufacture. Range of the instrument shall be so selected that max. operating value lies in 65-75% of the full scale range.
- 1.1.18 Control & Instrumentation shall be provided such that no single failure can cause a unit trip, loss of load/overall power output or even a forced outage of the power station. Modular redundant control systems shall be provided for all plant safety critical control and protection systems.
- 1.1.19 For hazardous area, the I & C systems to be designed as per the relevant area classification and applicable standards.
- 1.1.20 In the interest of a neat and clear, space-saving layout of the installation, easy maintenance, simple starting-up, operational checks and fault-recognition, a system made up of standard sub-assemblies with plug-in modules design shall be provided. The Systems shall have a decentralized design to a large extent. In the case of power supply failure no reprogramming shall be necessary and no controller parameter shall be lost.
- 1.1.21 To ensure smooth and optimal maintenance including efficient spare parts management of various I&C instruments/equipments like vibration monitoring analysis systems, all 4-20mA electronic transmitters/ transducers, control hardware, control valves, actuators and other instruments/ local devices etc. being furnished by the Bidder for SG, TG, BOP including its auxiliaries and systems like fuel system, circulating water system, chemical dosing system, Hydrogen Generation Plant (if applicable), Desal/WTP, cooling water system, electro chlorination system, effluent treatment plant, compressed air system, fire protection system, mill reject system, HVAC, potable water system, emergency DG facility etc. and other plant auxiliaries for similar applications, the Bidder shall ensure that they are of the same make, series and family of hardware. Bidder shall furnish a composite list of bought-out items along with proposed sub-vendors for each of the same.
- 1.1.22 The operator stations in the local and remote control rooms shall be housed in the enclosed control desk with interior lighting, louvers with brass mesh, space heater and telephones. The control desk shall be constructed of 2mm thick CRCA with IP 32 protection class for air conditioned environment and IP-44 for other indoor applications.

5.0.0 GENERAL TECHNICAL REQUIREMENTS

5.1.0 As a minimum the following pressure measurement points are to be provided by the Bidder,

Pressure gauges at the suction, discharge of the pumps, compressors and fans, common header of pumps and fans, inlets and outlet of heat exchangers, de-super heaters, pressurized vessels, and other main equipment outlet and inlet.

Pressure gauges at the discharge of compressors and at the air receiver tank.

Pressure switches at suction, permissive and trip of pumps and fans/blowers, discharge pressure low for auto-start of standby pumps and pre-trip alarm conditions.

Pressure switches at the discharge of the compressor and in the lube oil circuit. Differential pressure switches across the inlet air filters.

Differential pressure indicators across filters (Gas, water, oil service, air), strainers (Gas, water, oil service, air), cooling water line of the condensers, seal oil and hydrogen gas of generator.

Differential pressure switches across filters (Gas, water, oil service, air), strainers (Gas, water, oil service, air) & cooling water line of the condensers for high and high high alarm.

Differential pressure switches across bag filters.

Pressure transmitters at the suction and discharge of main process / pumps / compressors, for all controlled parameters, inlet and outlet of cooling water line of the condenser, flue gas line at inlet / outlet of various pressure parts, pressure conditions of major vessels like separator, de-aerator etc.

Pressure transmitter at the Compressor outlet, lube oil pressure, instrument air header and at the inter stages of the compressor

Pressure transmitters at HP/LP water pumps discharge, Water/Oil pumps. Vacuum transmitters at the vacuum pump discharge.

On both left and right sides of furnace, separate lines shall be laid and provided with furnace pressure transmitters. Independent impulse lines shall be installed to the transmitter in case of dual/trip redundant with double isolation.

Differential pressure transmitter across RO-Skid, Oil/Water strainers

Differential pressure transmitters for all level measurements, differential pressure measurements, flow measurements of condensate, steam, feed-water, air, seal oil and hydrogen gas of generator, across APH for flue gas, PA & SA paths, across membrane sections of RO plant etc.

DP Type flow transmitter shall be used at MB outlet.

DP Type level transmitter shall be used at PSF backwash tank and DG water storage tank.

Redundant pressure transmitters shall be provided when it is used for compensation algorithms.

5.2.0 As a minimum the following temperature measurement points to be provided by the Bidder,

Temperature gauges at main process pump discharge, where there is a change of temperature in the process, inlet / outlet of heat exchangers, de-super heaters etc.

Temperature switches to be provided wherever temperature abnormality to be alarmed if RTD and T/C is not provided, wherever equipment / system to be tripped on high temperature if RTD and T/C is not provided.

RTD for measuring the motor winding/bearing & bearing temperatures of compressors. Also installed at the interstages of the compressors and cooling water inlet and outlets

Temperature switches shall be of liquid filled or vapor actuated system. The bulb shall be of stainless steel with SS armored capillary tube of adequate length for installation.

Temperature gauges at the Cooling water inlet and outlet and interstages of the Compressor

Temperature gauge at the silo fluidizing blower common discharge header.

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

RTD is used for measuring the motor winding /bearing & bearing temperatures of ash slurry pumps, HP pumps.

Temperature gauge at the inlet of RO skid.

RTD is used for measuring the motor winding /bearing & bearing temperatures of RO HP pumps.

Temperature transmitter at the inlet of RO HPP/ Inlet of cartridge filter.

Temperature transmitters shall be provided for all control applications.

Resistance temperature detector shall be provided for monitoring points where temperature changes occur, bearing/ winding temperature.

Thermocouple for monitoring points shall be provided where temperature changes occur.

Metal temperature measurement shall be provided for super-heater, re-heater and Boiler drum.

Thermo-wells for performance test point, RTD, thermocouple, temperature switch, temperature indicators.

Redundant temperature transmitters shall be provided when it is used for compensation algorithms.

For SH/RH temperatures, the temperature sensors wires having SS shrouding are laid up to the Junction box and the terminal head shall be placed nearer to the JB.

For measurement of boiler metal temperature, flue gas temperature, air pre-heater grid temperature etc., the bidder shall provide permanent/removable duplex type mineral insulated thermo-couples terminated in junction boxes at boiler platforms. Compensating cable connecting metal temperature sensor shall be SS shrouded till the JB with Teflon coating

For measurement of turbine metal temperature turbine casing temperatures, stator winding temperature, Generator seal oil system, Turbine bearing temperature, Turbine oil temperature, Turbine bearing drain oil temperature, BFP turbine measurement parameters, MDBFP measurement parameters etc., the bidder shall provide permanent/ removable duplex type mineral insulated thermocouple/ RTD terminated in junction boxes at respective turbine side floors.

5.3.0 Flow nozzles will be used for main steam flow, feed-water flow and other critical measurements where weld-in construction is required. Orifice plates will be used for other liquid flow measurements where flanged construction is acceptable.

As for the water flow/steam flow measurements, necessary flow elements/transmitters are chosen in the process line and supplied such that their algebraic summation shall be mass balanced for calculating the system efficiency.

Venturi arrangement for PA flow for each pulverizer. Triple impulse lines + one spare impulse line to be provided in HP&LP of venturi arrangement provided for the PA flow of each pulverizer.

Coriolis mass flow meter to be used for Fuel oil and Ultrasonic flow meters for CW.

Flow glass to be provided for coolant from equipment, coolant from the coolers.

Flow switches shall be installed at the cooling water outlet flow.

Flow switches at the ejector outlet line.

Rotameter at the Pressure Sand Filter inlet, cartridge filter inlet Side Stream Filter inlet, service inlet of mixed bed and outlet of MCF – RO cleaning

Ultrasonic type flow meter shall be used for parshall flume flow, common outlet of SSF, RO module permeate line.

Electro magnetic flow meter shall be used at the inlet of PSF outlet and RO high pressure pump inlet.

Flow glasses are installed at water/oil line to the compressors & at slurry lines of bottom ash handling

Flow switches at cooling water return line/oil line to the compressors.

Flow transmitter cum switch to be provided for lube oil flow to the bearings of all HT drives, APH bearings etc

Vortex flow meter at the discharge of the compressors

Desal product to RO/DM plant (WT Plant) shall be provided with the flow transmitters.

RO plant outlet, RO plant inlet and CST inlet shall be provided with flow meters

Variable area flow indicators to be provided at the common outlet header of the identical equipment, CW blow-down etc.

Flow switches to be provided at the common outlet header of the identical equipment.

5.4.0 Guided wave radar type level transmitters shall be used for condenser hotwell level, LP heaters, Deareators, CBD and low pressure applications.

Radar type level transmitters shall be used for condensate storage tank

Non contact redundant ultrasonic type level transmitters for CW forebay, RW reservoir etc

Differential pressure transmitters will be used for general service level measurement of all separators, feed-water heaters, de-aerators and other pressurised and vented tanks.

Transparent gauge glasses will be used for low-pressure applications. Level gauges shall be provided for all surface mounted overhead tanks, hotwell, de-aerator and any other storage tanks.

Level switches shall be provided for lube oil reservoir of HT drives, for all tanks/sumps for low and high alarm, for all tanks /sumps for low low signal used for tripping the pump, for all tanks/sumps for adequate signal used for starting the pumps.

Level switch shall be used in the water cooling tower and expansion tank level.

Level transmitters shall be provided for hotwell, de-aerator feed tanks, blowdown tank, turbine main oil tank, condensate storage tank, DM storage tank, clarified water storage tank, sumps, Stator water tanks, expansion tanks etc.

Ultrasonic type level transmitters are used for clarified water storage tank, chemical storage and dosing tanks, DM water storage tank, sludge pit, RO Reject water storage tank and neutralization pit.

Radar Level transmitters are installed at the bulk acid storage, acid dosing tank.

Non contact type Ultrasonic level transmitters shall be used for CW sump level, CW fore bay, Raw water reservoir, water sump/tank etc

Level indicator at the ash conditioner water /drain sumps, ash water tanks

Level switch at the ash conditioner water /drain sumps
Level switch at the sump, tank of the dust suppression system.

Ultrasonic type level transmitters for ash slurry sump, ash water tank application.

Radar Level transmitters are installed at the fly ash silo

Continuous level measurement for unit coal bunker and other bunkers of Coal handling system shall be provided with two (2) numbers of radar type level transmitters for each bunkers with IP 65 protection for each bunker level measurement. Bunker level shall be monitored in Travelling tippler floor and CHP control room/ DCS. Radar type level transmitters shall be FMCWR type with drop in antenna and being operated at 24-26GHz.

RF Level switch are installed at the hoppers, fly ash silo

Open channel flow measurement at upstream of RO/Water treatment plant (before stilling chamber)

5.5.0 The following analyzers to be provided as a minimum in the pre-treatment/ RO-water treatment and other services.

Turbidity and free residual chlorine at the clarifier outlet

ORP, pH, SDI at RO plant inlet

Conductivity at RO membrane outlet

Chlorine analyser at pressure sand filter and degasser outlet.

Cation conductivity, specific conductivity, pH at SAC/SBA outlet

Conductivity, Silica, pH at Mixed bed outlet.

Dew point meter shall be installed at the outlet of air dryer to measure the quality of air.

pH at Cooling tower blow down to sea

Chloride and other requirements as per the statutory norms at Cooling tower blow down to sea

Vibration switch shall be provided to monitor vibration of Axial Flow Fan-Gear box assembly of wet cooling tower.

Airstat (Flow switch) is used to measure the air flow in the supply duct.

Humidistat used to measure the return air humidity.

Zero speed switches shall be provided for protection of the rotary vane feeder

Pull cord switches shall be provided for the conveyor protection

TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Zero speed switches shall be provided for protection of the conveyor

The belt sway switches to identify the misalignment of conveyor

Speed measurements for all HT drives having hydraulic coupling

Speed measurements for all HT drives having hydraulic coupling and VFD equipments.

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

FIELD INSTRUMENT DATA SHEET

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

FIELD INSTRUMENTS SPECIFICATION

FIELD INSTRUMENTS SPECIFICATION

1.0.0 TECHNICAL REQUIREMENT FOR INSTRUMENTATION

1.1.0 Field Instruments

- a) Analog outputs signals from field instrumentation to the control systems are 4-20 Ma DC signals. Instrumentation can be self-powered, or loop powered from the control systems. Self-powered analog signals shall be true "isolated from ground" signals.
- b) Field switches will be micro switch type with auto reset. Switches will have NO and NC contacts. Switch contacts shall be snap acting, 2 Nos of SPDT, hermetically sealed, potential-free with a minimum contact rating of 230 V AC 5A/ 24V DC 1A.
- c) Transmitters will be used to provide the required 4 to 20Ma signals for all controllers and receivers. Transmitters will be of the electronic, two-wire type, capable of driving an output impedance of 600 ohms minimum at 24 V dc, and will be generally powered from the control system I/O cards. All the transmitters supplied shall be SMART type with HART capability. All the transmitter shall be provided with 5 digit local indicators
- d) SMART transmitters' calibration shall be carried out through a PC based system to be located in the computer room.
- e) Pressure and differential pressure transmitters accuracy shall be within + 0.04% or better of FSR for BTG package, + 0.065% or better of FSR for BOP packages and + 0.2% for remote seal type transmitter. Repeatability shall be +0.05% of span or better. Errors caused by change in ambient temperature shall not exceed 0.01% of span per °C change. Stability 0.15% for five years.
- f) The plant instrument air supply pressure shall be:
 1. Maximum supply pressure 7 kg/cm²
 2. Minimum supply pressure 4.5 kg/cm²
- g) All instruments and analyzers shall employ EMI,RF protection in the system design.
- h) Instrument tags should be permanently attached to the device. If this is not possible, the instrument tag should be fastened to the instrument with stainless steel wire.
- i) Speed switches and the actual device should drive transducers, if possible.
- j) All instrumentation mounted inside, away from direct exposure to the elements, shall be as a minimum IP-44 construction unless it is in an environmentally controlled environment (e.g the control room). If the instrument is mounted in an environmentally controlled environment the instrument shall be as a minimum IP-32 construction.
- k) All instrumentation mounted outside shall be as a minimum IP-65 construction. IBR certification shall be provided for instruments / valve / Erection hardware wherever applicable.
- l) Vibration switch (alarm, trip) and oil level switch to be provided for the cooling towers.
- m) Transmitters and switches shall be grouped depending on the location. Individual instruments shall be mounted on stanchion or pipe mounted.

- n) For saline applications and other applications which are corrosive in nature, the wetted part material to be selected which shall meet the process applications, preferably diaphragm seal to be used. Hastelloy C wetted part material and SS316L impulse piping / root valve material to be considered for the above applications.
- o) All field instruments junctions boxes & local panels located in hazardous area shall be explosion proof as per the relevant applicable standards.
- p) Reverse rotation switches to be provided for High Pressure Boiler Feed pumps, Main condenser cooling Water pumps, Condensate extraction pumps and sea water intake pumps
- q) The following metric engineering units shall be used for all instrumentation devices :
1. Pressure – kg/cm²g
 2. Temperature - °C
 3. Steam flow – kg/hr / T/hr
 4. Liquid flow – m³/hr (Feed Water flow (in kg/hr or T/hr)
 5. Distance – meters (m) or millimeters (mm)
 6. Differential pressure – mmH₂O
- r) For speed varying pumps/fans, speed measurement in 4 – 20 mA shall be connected to DCS.
- s) Required Water analyzers for ACW pump discharge header mainly FRC (Free residual chlorine) analyzers shall be considered at CW /ACW common header return line.
- t) Wireless transmitters :
For CW sump level, Raw water reservoir level, Turbine oil tank, coal bunkers, Ash Silo, LDO/HFO tank, DM water tanks, CS tank, Acid and alkali applications, only non contact type level transmitters like Ultrasonic or Radar based shall be provided by the bidders as per the specification and as approved by owner.

Considering the type of application, wireless technology to bring signals to DDCMIS may be adopted by interfacing with OPC gateway to avoid cabling from smart level transmitters as specified above. And for other applications, if any shall be decided during Detailed Engineering. However Wireless technology as adopted by Bidder shall be reliable and field proven in power plants and same shall be approved by Owner.

1.1.1 Pressure Instrumentation

- a) Pressure transmitters are electronic, analog 2-wire transmitters with isolated 4-20Ma DC output signals.
- b) Pressure transmitters will be supplied with integral mounted two valve manifolds.
- c) All pressure transmitters shall be capable of withstanding their body rating conditions without permanent damage or loss of calibration.
- d) Differential pressure transmitters of the capacitance type, regardless of the applied service, shall be capable of withstanding a differential pressure equal to full process

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

pressure on either side of the measurement element without damage or loss of calibration.

- e) Differential pressure transmitters will be supplied with integral mounted three valve manifolds for air service and 5 way valve manifold for steam & water service. For pressure and differential pressure transmitters, overall Accuracy: + 0.04% or better of FSR for BTG package & + 0.065% or better of FSR for BOP packages. Accuracy shall be + 0.2% for remote seal type transmitter.
- f) Pressure gauges will be generally 150mm dial, solid front safety case type with blowout back, ½" NPT bottom connection, drawn stainless steel case, 316SS bourdon and socket, stainless steel movement, micrometer pointer. Pulsation dampers will be provided for pulsating pressure services. Liquid filled gauges shall be used for all pump discharges, vibrating or pulsating services. Pigtail ressu shall be used for the steam service where gauges are mounted close to the tap.
- g) Pressure switches will generally be snap acting type, DPDT action, with individual "on" and "off" points to be on a calibrated scale or dial. Pressure switches will have amphoral connection. Repeatability shall be +/- 0.5% or better. Pressure sensor shall be 316 SS with over range protection. Die cast aluminum with stored enamel black finish and epoxy coating for corrosive atmosphere.
- h) Dual type control switches such as pressure switches having two sets of contacts with independently adjustable set points shall not be used where set point adjustment and deadband are a problem (e.g. low pressure and vacuum applications). If a potential problem exists, two single purpose switches shall be used. Switch differential shall be adjustable.
- i) The indicating type switches are not acceptable. If application requires indication and switching function, then a separate blind switch and a gauge to be used.
- j) All the switches are internally connected and brought to the surface with Amphenol male/female connection. Cabling need not be terminated inside the switch. Cable ends are to be soldered in connector and to be inserted for easy maintenance.
- k) Condensate pots for pressure transmitters and siphons for gauges shall be used for steam and high temperature applications. Chemical seals to be used for highly corrosive and viscosity applications
- l) The switches shall have the following:

Contact rating	:	230V AC, 5A / 24V DC 1A.
Repeatability	:	±0.5% FSR
- m) Turn down ratio to be 100:1
- n) Response time for pressure and differential pressure transmitter shall be 100 ms.
- o) Protection for gauges fitted in the vibration lines/equipments shall be provided

1.1.2 Temperature Instrumentation

- a) For temperature up to 300°C 3-wire RTD duplex type, PT 100 type shall be used. For temperature beyond 300°C thermocouples shall be used. Thermocouples shall be manufactured in accordance with the ISA Standard MC96.1, Temperature Measurement Thermocouples. All thermocouples shall be Chromel Alumel (Type K) for 300°C ≤ T < 850°C. R or S type for T > 850°C.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- b) The Mv signal of thermocouple shall be used as input to the DCS. Cold junction compensation shall be achieved in the DCS
- c) Thermocouples shall have duplex elements and ungrounded measuring junction.
- d) An extension nipple / union / nipple of sufficient length to extend beyond lagging and connection head shall be furnished for each thermocouple assembly. Terminal blocks shall be marked with polarity and connectors shall be resistant to heat, vibration and galling. The cap shall provide a weather tight enclosure and a chain shall be provided to prevent loss of cap. The cap shall be made of cast aluminium.
- e) RTDs of Duplex type furnished by the Supplier shall be of the three-wire type made with 100 ohm platinum resistance elements. They shall be certified to meet the requirements of the International Temperature Scale, calibrated to the IEC-751 standard (Alpha = 0.00385 Ohms/Ohm/°C). The RTDs shall be contained in an insulated material and a sheath or sleeve of stainless steel SS-316 and shall be so mounted that they can withstand the greatest shocks and vibrations that can be imposed upon them in the system piping without deterioration. Specific information shall be furnished concerning type and accuracy of bridge circuits to be used with the RTDs. RTDs shall be directly connected to DCS without any transmitters
- f) Unless specified otherwise, each temperature element and thermometer shall be provided with a 1" socket weld type, 316 stainless steel tapered thermowell suitable for the requirements of the given application. Temperature element process connection shall be ½ NPTM.
- g) Temperature transmitters of SMART type are to be provided for all temperature measurements that are used in any CLCS. For thermocouple, cold junction compensation shall be implemented within the transmitter.
- h) Thermocouples will be of duplex MI type in ISA, K(chromel-Alumel), Platinum-Rhodium/Platinum with sheath OD 6 mm. RTD will be Duplex, Pt 100 ohm, 3 wire type as per DIN standard 43760 or equivalent. Thermo wells will be ASME PTC 19.3 latest revision with process connection M 33x2 for threaded connection and flanged connection for Air and Gas system & tanks.
- i) Thermowell immersion length will generally be between 1/3 and ½ the distance to the center of the pipe. Where thermo wells are installed in lines smaller than 4 inches, the piping shall be expanded to 4 inch size to accommodate the thermo well. Thermowell shall be drilled from solid bar stock.
- j) All thermo well in a high velocity line or duct shall have an ASME PTC 19.3 calculation for determination of the wells resonant frequency. Thermo wells that do not meet the acceptance criteria shall be resized or relocated as necessary.
- k) Thermocouple extension wire is to be solid, shielded, twisted pairs.
- l) If intermediate terminal blocks are required in a thermocouple measuring circuit, they need not be the same material as the thermocouple.
- m) Dial thermometers shall be bimetallic, minimum 150mm dial, every angle form, hermetically sealed with external recalibration adjustment, ¼" OD SS stem, ½" NPT connection and SS case.
- n) Temperature switches shall be actuated by filled bulb-type elements equipped with standard-length armored capillary tubing. All the switches are internally connected and brought to the surface with Amphenol male/female connection.
- o) Temperature gauges shall have ±1% accuracy and overage protection of 125%

p) Switches shall have the following:

Max. contact rating	:	230V AC, 5A
Repeatability	:	±0.5% FSR
Contact type	:	snap acting
Over all accuracy 0.1% of calibrated span		

q) Protection for gauges fitted in the vibration lines/equipments shall be provided

r) For measurement of pulverizer outlet temperature, tungsten carbide block thermowell aborium resistant shall be used instead of tungsten carbide coated thermowell. And for sea water titanium sleeve thermowell or better shall be used

s) Switch differential shall be adjustable. Fan DE/NDE, motor DE/NDE temperature are to be fitted with capillary type dial thermometers with standard length.

1.1.3 Flow Instrumentation

- a) Flow nozzles will be used for main steam flow, feed-water flow and other critical measurements where weld-in construction is required. Orifice plates will be used for other liquid flow measurements where flanged construction is acceptable. Accuracy of the measuring orifice plates, nozzles and annubar shall be minimum $\pm 1\%$. Ultrasonic type flow meter shall be used for cooling water flow application with an accuracy of minimum $\pm 0.4\%$ of measured flow or better and haste alloy C wetted part material to be used if insertion type is provided.
- b) Flow elements will be accompanied by IBR certification.
- c) Flow nozzles and orifice plates shall conform to requirements of ASME "Fluid Meters".
- d) Flow nozzles shall be of the weld-in holding ring type ASME long radius, with dual wall taps and shall be of stainless steel. Flow nozzles shall be furnished complete with metered runs in accordance with ASME PTC 6.1. Metered pipe run and nozzle shall match the pipe material and size that metered section is to be installed in.
- e) Orifice plates shall be 316SS, sharp square edge thin plate, and paddle type suitable for installation between raised face orifice flanges. Orifice flanges, gaskets and jacketing screws shall be furnished by the Supplier. Paddle shall be stamped with the orifice ID bore diameter on the upstream side. Orifice flanges will be of the raised face, weld-neck type with dual 2 sets of taps as required for redundancy.
- f) Beta ratios shall be between 0.3 and 0.7. Flow elements (flow nozzle & orifice) sizing shall as per BS-1042/ISO-5167.
- g) Differential type flow transmitters shall be supplied with three valve manifolds directly mounted to the transmitter for gas applications and five valve manifolds directly mounted to the transmitter for steam and liquid applications
- h) Differential type flow transmitters shall be electronic, analog 2-wire transmitters with isolated 4-20 Ma dc output signals.
- i) Square root extraction of the flow signal is performed in the DCS.
- j) The flow sight glass shall be of rotary type with tempered glass, carbon steel body and bronze wetted parts.

TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- k) Variable area flow indicators to be provided at the common outlet header of the identical equipment, CW blow-down etc. Carbon steel body with SS 316 float and scale shall be provided. Accuracy shall be minimum +-1%.
- l) Flow switches to be provided at the common outlet header of the identical equipment. Carbon steel body with SS 316 element and contacts shall be provided.
- m) Algebraic summation of steam flow and water flow shall be mass balanced for calculating the system efficiency by providing necessary required flow transmitters and process lines
- n) Accuracy for mass flow shall be 0.15% of measured value for liquid.
- o) Accuracy for Vortex flow meter and turbine flow meter shall be 0.5% of full scale range.

1.1.4 Level Instrumentation

- a) Differential pressure type level transmitters are electronic, analog 2-wire transmitters with isolated 4-20 Ma dc output signals. Radar and ultrasonic level transmitters will be 24V DC powered, with isolated 4-20 Ma dc output signals powered from the transmitters.
- b) Constant head chambers shall be furnished for all differential pressure-type level transmitters used with pressurized vessels. Reservoir piping connections shall be ½ inch outlet and a ½ inch inlet socket-welded type suitable for the pressure and temperature encountered.
- c) Transparent gauge glasses will be used for low-pressure applications. Transparent or reflex gauges will be used for high-pressure applications. All gauge glasses will be equipped with gauge valves, including a safety ball check.
- d) Level switches shall generally be cage float / Displacer type, rated for ANSI B31.1 requirements.
- e) Non contact type level measurement shall be provided for CW sumps and for CW make-up applications.
- f) Electronic level indicator of discrete type based on electric conductivity of water and steam with 50mm gap between successive electrodes in the measuring range shall be provided in addition to level transmitter. The **vessel** holding electrodes **shall be IBR certified**.

1.1.14 Turbidity Analyzer

Turbidity analyzers shall be continuous type with accuracy of $\pm 2\%$ of reading or ± 0.2 NTU whichever is better, response time of 2 sec of full scale. Operating principle shall be alternating light source and self cleaning facility shall be available.

The analyzer shall also include features such as auto temperature compensation, auto calibration, zero check and self cleaning system for electrode. The analyzer shall be provided with integral indicator. Housing for analyzer shall be waterproof with IP65 protection. Output shall be isolated 4-20 mA DC linear signal. Fault diagnosis data shall include faults in analog/digital circuits, contamination detection on optical window, failure of cleaning system, calibration fault and power supply failure.

1.1.16 Vortex flow meter

Transmitter type shall be capacitance / piezoelectric , microprocessor based electronics. Reynolds's no. shall be at least 20000 and minimum flow velocity shall be as specified by the manufacturer. For gas/air application, the bluff body shall be in horizontal position to avoid condensate and for liquids in vertical lines the flow shall be upwards to keep the line full. A location with minimum pipe vibration shall be selected. The pipe shall be supported at both ends, as necessary. If pressure and temperature compensation are required for gas/air flow application, the pressure taping shall be placed as close as possible to upstream of flow meter. The temperature tapping point shall be located at least 5D on the down stream of the flow meter. Straight length requirement shall be as specified by manufacturer. If meter is smaller than the line size, concentric pipe reducers shall be used. Eccentric reducers shall not be used as they disturb the flow profile.

1.1.17 Solenoid Valves

On line two (2) way solenoid valves shall be provided, where process line of less than 2 inch with low pressure & temperature application is involved.

Three (3) way solenoid valves shall be provided commonly, where the pressure is admitted or exhausted from a diaphragm valve or single acting cylinder.

Four (4) way solenoid valve shall be provided for operating double acting cylinders. If applicable.

Dual coil Solenoid valves shall be supplied for equipment trips and single coil for balance.

Body material of bronze, plug material of SS316 shall be provided with a leakage class of class IV.

All single coil solenoids shall be of continuous duty operating on 24V DC, 230 V AC and insulation class shall be H.

Double coil solenoid valve shall be provided for BMS services..For operation of the fuel oil corner nozzle valves, fuel oil trip valves etc., double coil solenoid valve (latch coil & relatch coil) shall be adopted.

Single coil usage requires always power and loss of power leads to closure of above valves resulting the unit trip or loss of generation.

On collection of water in the drains of instrument air lines, mechanical automatic drains and periodically solenoid operated drains (with electronic timer - 15m, 30m, 60m and 2 Hours & Timing adjustable) are to be provided.

For mechanical type & Electrical type, the locations to be provided in the instrument air lines of boiler area, Chimney area, turbine area etc., and same shall be decided during detailed Engineering.

For mechanical type & Electrical type, the locations to be provided in the instrument air lines of boiler area, Chimney area, turbine area etc., and same shall be decided during detailed Engineering.

Individual Moisture separator in the instrument air lines for vital final control elements or oxygen analysers shall be provided to enhance the cell life of oxygen probe or continuous operation of final control elements. The numbers and locations shall be finalized during the detailed engineering.

1.1.18 Position Transmitters / Positioners

Position Transmitters shall be provided for all motorized inching valves and control valves. Position transmitters shall be 24 VDC, 2 wire, system. SMART Positioners with HART communication shall be provided for all pneumatically operated control valves, power cylinders etc., for converting controller output of 4-20 Ma to 3-15 PSI (0.2 -1 kg/cm²) for interfacing with pneumatic actuators. Separate moisture separator unit for ensuring dryness of air entering Positioners/ E/P converters as well as the power cylinder is to be supplied. The I to P converters shall retain the pneumatic signal (last value) even in failure of control signal and shall have self volume boosters. The Positioners/ E/P converters shall retain the pneumatic signal (last value) even in failure of control signal and shall have self volume boosters.

1.1.19 I/P Converter

Two wire type I/P convertors with an accuracy of +0.25% accepting 4-20 mA dc signals from control system and converting to 0.2 to 1 kg/cm² air pressure to operate valve positioner of all final control elements; Housed in cast aluminum casing (with polyurethane paint); NEMA 4 or equivalent degree of protection for enclosure. Material of accessories will be SS. I/P convertors shall have fail freeze (stay put) feature also. Process connection shall be 1/4" NPT (F) and Electrical connection shall be 1/2" NPT (F). Zero/span adjustment facility shall be provided. The I to P converters shall retain the pneumatic signal (last value) even in failure of control signal and shall have self volume boosters. Necessary air lock devices and pressure switches for air pressure low alarming shall be provided.

1.1.20 Air Filter Regulators

Air filter regulator along with gauges shall be provided in each of the

- a) Air supply line to valve positioners /power cylinders
- b) Air supply line to electric to pneumatic converters
- c) Air supply line to pneumatic interlocked block valves

VOLUME: II B
 TECHNICAL SPECIFICATIONS FOR
 EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
 SPECIFICATION NO.: PE-TS-435-164-A001

D. CONTROL BOARD**I. Control Desk / Console / Panel Construction**

- | | | |
|--------------------------------|---|--|
| 01. Applicable for | : | Indoor Panel, Desk & console. |
| 02. Material of construction | : | Cold rolled steel sheet (Metal and plastic - Heat resistant, shrinkage free for mosaic tiles). |
| 03. Thickness of Sheet | : | a) 3.2 mm for faces supporting instruments / terminals.
b) 2 mm for other sides and top. |
| 04. Construction | : | Welded throughout as per (metallic parts) approved National Standards. |
| 05. i) Corners | : | 7 mm inner radius |
| ii) Dimensional Tolerances | : | a) In height & length - 3 mm
b) In height between adjacent sections - 2 mm.
c) Total for a group - 6 mm |
| 06. Doors | : | Double, recessed, turned back edges |
| i) Thickness of Sheet | : | 2 mm |
| ii) Hinges | : | Stainless steel |
| iii) Door latches | : | Three point type |
| iv) Door gaskets | : | Neoprene rubber on fixed frame to result dust proof / weatherproof enclosure. |
| v) Opening of the doors | : | Outward |
| vi) Louvers | : | With removable wire mesh to ensure dust and vermin proof. |
| 07. Color of interior | : | Glossy white |
| 08. Colour external | : | IS 5 No. 628 (Typical) [To be decided later] |
| 09. Protection of painting | : | Plastic peel coating |
| 10. Gland plates | : | Removable 4 mm thick (bottom) |
| 11. Cable entry | : | Bottom |
| 12. Hardware | : | a) Vibration dampeners
b) Predrilled base channel ISMC - 100 or equivalent for all sides.
c) Stainless steel buff- finished 2 mm thick kick plate for all sides.
d) Stainless steel scratch strips along desk edges fixed with pan-head recessed screws.
e) Rubber strips to ensure air tightness between kick plate and finished floor.
f) Power supply points 5/15 A plug point with indication lamp 5 Nos. |
| 13. Enclosure Protection Class | : | IP-42 or as per environment condition. |
| 14. Earthing | : | 4 per standards |

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

E. FIELD INSTRUMENTS**I. PRESSURE**

This section provides general hardware guidelines for field instruments and equipment to be supplied under this specification.

Field transmitters shall be smart type with **HART** protocol. Temperature & Pressure switches shall be of Dual Snap type for vibration prone areas.

A. Pressure Transmitter

- | | | | |
|-----|------------------------------------|---|---|
| 01. | Working Principle | : | Smart |
| 02. | Type | : | 2 - Wire |
| 03. | Output Signal | : | Simultaneous transmission of digital and 4-20 mA DC signal isolated linear standard protocol (HART). |
| 04. | Signal Processing | : | Silicon solid state electronic circuitry |
| 05. | Measuring Element | : | Capsule / Diaphragm |
| 06. | Measuring element | : | AISI-316 (Stainless Steel) Diaphragm material |
| 07. | Static Pressure | : | 150 % of maximum span continuously, without affecting the calibration. |
| 08. | Turn-down ratio | : | 100 : 1 minimum. |
| 09. | Span and Zero | : | Locally adjustable with interacting facility or remotely accessible with HART based communicator for elevation and suppression by 100% of span |
| 10. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 11. | Output Indicator (Digital display) | : | LCD type in % and engineering unit and LCD failure shall not affect the transmitter operation. |
| 12. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 13. | Body | : | Forged Carbon Steel (SS for DM Water). |
| 14. | Operating Voltage | : | 18 - 36 Volts D.C. |
| 15. | Load | : | 750 Ohms (min.) at 24 Volts D.C. |
| 16. | Ambient Temperature | : | 0 - 85 °C |
| 17. | Performance: | : | |
| | i) Accuracy | : | + 0.04% or better of FSR for BTG package, + 0.065% or better of FSR for BOP packages and + 0.2% for remote seal type transmitter. |
| | ii) Repeatability | : | ± 0.05% of calibrated Span or better |
| | iii) Warranty & stability | : | min. of 5 yrs or better |
| 18. | Sealing/Isolation | : | 10 meters SS armoured capillary with suitable fill fluid and flange remote seal diaphragm of SS 316 or suitable material as per application, for corrosive, viscous and dirty fluid application. Flange size and pressure rating as per application. |
| 19. | Accessories | : | a) Universal mounting bracket suitable for 2" pipe and wall mounting.
b) High tensile carbon steel U- bolts.
c) Installation accessories as per relevant installation drawing.
d) Syphons for steam and hot water services.
e) ½" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock. |

VOLUME: II B
**TECHNICAL SPECIFICATIONS FOR
 EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
 SPECIFICATION NO.: PE-TS-435-164-A001**

- f) Companion flange with nuts, bolts and gaskets.
- g) Hand held configuration kit for diagnostics and calibration of Smart Transmitter locally or in remote.
- h) ¾" ET cable gland
- i) Flushing facility at process end diaphragm.
- j) Reverse polarity protection required.
- k) Three way SS manifold for (gauge) vacuum

B. Differential Pressure Transmitter

- | | | | |
|-----|---------------------------------------|---|--|
| 01. | Working Principle | : | Smart |
| 02. | Type | : | 2-Wire |
| 03. | Output signal | : | Simultaneous transmission of digital and 4-20 mA DC signal isolated linear standard protocol -HART. |
| 04. | Signal Processing Unit | : | Silicon solid-state electronic circuitry |
| 05. | Measuring element | : | Capsule/Diaphragm |
| 06. | Measuring element Material | : | AISI-316 (Stainless Steel) |
| 07. | Static Pressure/
Overload Pressure | : | Maximum line (or static) pressure on either side without permanent deformation or loss of accuracy |
| 08. | Turn-down ratio | : | 100: 1 minimum |
| 09. | Span and Zero | : | Locally adjustable, non-interacting |
| 10. | Enclosure class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 11. | Zero suppression /
Elevation | : | At least 100% of Span |
| 12. | Output Indicator
(Digital display) | : | LCD type in % and Engineering units |
| 13. | Nameplate | : | Tag number and Service engraved in stainless steel tag plate |
| 14. | Body | : | Forged Carbon Steel (SS for DM Water) |
| 15. | Ambient temperature | : | 0 - 85 ° C |
| 16. | Operating Voltage | : | 18 - 36 Volts DC |
| 17. | Load | : | 750 Ohms at 24 Volts DC |
| 18. | Performance:- | | |
| | i) Accuracy | : | ± 0.025 % of calibrated span or better |
| | ii) Repeatability | : | ± 0.05 % of calibrated span or better |
| 19. | Sealing/Isolation | : | 6 meters SS armoured capillary with suitable fill fluid and flange remote seal diaphragm of SS 316 or suitable material as per application, for corrosive, viscous and dirty fluid application. Flange size and pressure rating as per application. |
| 20. | Accessories | : | <ul style="list-style-type: none"> a) Universal mounting bracket suitable for 2" pipe and wall mounting. b) High tensile carbon steel U-bolts. c) Installation accessories as per relevant installation drawing. d) Syphons for steam and hot water services. l) ½" NPT 5-valve stainless steel manifold, constructed from SS316 bar stock. e) Companion flange with nuts, bolts and gaskets. f) Hand held configurator kit for diagnosis and calibration of Smart Transmitter. g) ¾" ET cable gland |

- h) Flushing facility at process end diaphragm.
- i) Reverse polarity protection required.

C. Pressure Switch

- 01. Type : Seal diaphragm, piston actuated.
- 02. Sensing element material : AISI SS-316 diaphragm / piston. All other wetted part SS316.
- 03. Case Material : Epoxy coated steel plate or die-cast aluminum alloy with neoprene gasket and clear glass where applicable.
- 04. Setter Scale : Black graduation on white liner scale. Graduation 0-100% with red pointer for set points.
- 05. Over range : 150 % of maximum pressure
- 06. Process Connection : 1/2" NPT (M) bottom connected
- 07. Switch configuration : Two SPDT
Lead wires (3+3 Nos.) are to be brought externally to the male connector wherein the female pug connector will be inserted to connect the control room cables for easy removal & re - calibration
- 08. Switch Rating : 240V, 5A AC/220V, 0.5A DC
- 09. Switch Type : Dual Snap acting, shock & vibration proof
- 10. Adjustability : a) Set-point adjustable over span range.
b) Differential adjustable by 10 percent of span (minimum).
- 11. Sealing Ring : Viton, Buna-N
- 12. Terminal Block : Suitable for full ring lugs for cable connection.
- 13. Cable connection : 3/4" ET compression gland.
- 14. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area).
- 15. Performance : a) Accuracy $\pm 1.0\%$
b) Accuracy of Setting Indication of $\pm 1.5\%$
- 16. Ambient temperature : 0 – 50 Deg.C
- 17. Nameplate : Tag number, service engraved in stainless steel tag plate
- 18. Accessories : a) Remote diaphragm seal with SS-316 armored capillary for typical application. MOC of seal material shall be as per process fluid requirement.
b) Snubbers for pulsating fluid application.
c) Retention ring and screws for surface mounting.
d) 1/2" NPT 2 Valve SS-316 manifold constructed from bar stock
e) 3/4" ET cable gland

D. Differential Pressure Switch

- 01. Type : Bellows / Diaphragm / Piston actuated
- 02. Sensing element material : AISI SS-316. For all other wetted part SS 316
- 03. Case Material : Epoxy coated steel plate or die-cast aluminum alloy with neoprene gasket and clear glass where applicable.
- 04. Setter Scale : Black graduation on white scale with 0-100% graduation and provided with red pointer for set point adjustment
- 05. Over range : Static pressure on any one side, the other side being open to atmosphere.
- 06. Process Connection : 1/2" NPT (M) bottom connected / back connected.

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- | | | | |
|-----|--|---|--|
| 07. | Switch configuration | : | Two SPDT
Lead wires (3+3 Nos.) are to be brought externally to the male connector wherein the female pug connector will be inserted to connect the control room cables for easy removal & re - calibration |
| 08. | Switch rating | : | 240V, 5A AC/220V, 0.5A DC. |
| 09. | Switch type | : | Dual Snap acting type contacts, shock and vibration proof. |
| 10. | Adjustability | : | a) Set point adjustable over span range.
b) Differential adjustable by 10 % of span (minimum). |
| 11. | Terminal Blocks | : | Suitable for full ring lugs for cable connection. |
| 12. | Cable Connection | : | 3/4" ET compression gland. |
| 13. | Performance | : | a) Accuracy of repeatability: $\pm 1.0\%$ of span.
b) Accuracy of set point Indication: $\pm 1.5\%$ |
| 14. | Operating Ambient Temperature | : | 0 - 50 ° C (Maximum Continuous) |
| 15. | Enclosure | : | IP – 65 (Explosion proof for NEC Class-1, Division 1 area). |
| 16. | Accessories | : | a) Snubbers for pulsating fluid application.
b) Retention ring and screws for surface mounting.
c) 1/2" NPT 5 Valve SS-316 manifold constructed from bar stock
d) 3 / 4" Cable gland |
| 17. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 18. | Preferred Features | : | Free floating bellows attached to high-pressure bellows for temperature compensation. |
| 19. | Remote Seal type for special application | : | a) Silicone oil / fluorolube filled remote diaphragm seal for dirty / viscous / corrosive fluid.
b) SS armored capillary at least 3 meters each.
c) Adapter flanges with nuts, bolts and gaskets for instrument and process side |

E. Pressure Gauge and Differential Pressure Gauge

- | | | | |
|-----|-----------------------|---|--|
| 01. | Type | : | Bourdon/Bellows/Diaphragm |
| 02. | MOC Sensing & Socket | : | AISI-316 SS |
| 03. | Movement Material | : | AISI-304 SS |
| 04. | Case Material | : | Stainless steel casing bayonet type. Enclosure IP-65. |
| 05. | Dial Size | : | Generally 150 mm (100 mm for SWAS gauges) |
| 06. | Scale | : | Black lettering on white background in 270 Deg. arcs. |
| 07. | Window | : | shatterproof toughened glass |
| 08. | Range Selection | : | Normal process pressure – 50 ~ 70 % of range (approximately). |
| 09. | Over-range Protection | : | 125% of maximum range by internal stop. External stop at zero |
| 10. | Adjustment | : | Micrometer screw for zero adjustment. Internal micrometer screw for range adjustment. |
| 11. | Element Connection | : | Argon welding |
| 12. | Process Connection | : | 1/2" NPT (M) Bottom connection for local mounting, back connection for panel mounting. |
| 13. | Performance | : | Accuracy of $\pm 1.0\%$ of span or better for Pressure gauge |

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

		Accuracy of ± 1.6 % of span or better for Differential Pressure gauge
14.	Operating ambient Temperature	: 0 - 50 °C
15.	Safety Feature	: Blow out disc. /diaphragm at the back
16.	Accessories	: a) Snubbers and Glycerin filled for pulsating fluid applications and at pump discharge. b) Stainless steel 316 Diaphragm with Teflon coated seals for corrosive, viscous and solid-bearing or slurry type process fluids. c) 3-Way stainless steel Gauge cock for pressure gauges. Process connection 1/2" NPT. d) 5-valve SS316 manifold constructed from barstock for differential pressure gauge. Process connection 1/2" NPT. e) Union, nut & tail piece and other Installation accessories as required.
17.	Applicable standard	: IS-3624 / 1996
18.	Electrical Contact rating	: 240V, 5A AC/ 220V, 0.5A DC (for gauges with alarm contact). Number of Contacts:2 SPDT
19.	Nameplate	: Tag number, service engraved in stainless steel tag plate

II. LEVEL**A. Radar Level Transmitters**

01.	a) Type	: 1. Guided wave Radar type transmitter of TDR type 2-10 GHz for liquids 2. Radar type transmitter of FMCWR type 24-26 GHz, drop in antenna for coal level
	b) Probe	: Coaxial
	c) Probe material	: SS 316 / SS 316L
02.	calibration range	: as per application
03.	Process medium	: as per application
04.	Process temperature	: as per application
05.	Static Pressure	: Capable of working in vacuum also
06.	Power supply	: range to be specified by the bid (Loop power available = 24V DC)
07.	Reverse polarity protection	: required
08.	Output	: 4 to 20mA, 2wire & HART
09.	Accuracy	: $\pm .03\%$ of measure distance or ± 3 mm
010.	Stability	: Contractor specify
011.	Communication	: Communication / configuration shall be possible either through integral key pad and display or through hand communicator. If integral key pad is not available, one number hand held communicator common for all the transmitters shall be supplied
012.	Load limitation	: max 600 ohm at 24V
013.	Span & zero	: adjustable
014.	Flange mounting	: yes
015.	Environmental protection	: IP 66 or better
016.	Process connection	: traditional flange with 1/4" – 18 NPT on flange with process adapters (Flange & drain vent- 316SST)
017.	Electronic housing	: Aluminium alloy
018.	Electrical connection	: Preferably 1/2" – 14 NPT with gland.

B. Capacitance Type Level Transmitter

The total system shall consist of capacitance probe, pre-amplifier and transmitter

- | | | | |
|-----|--------------------------|---|---|
| 01. | Type | : | Capacitance type |
| 02. | Probe | : | a) Rod or suspended electrode.
b) Rope type probes may be used only where required probe length is greater than 3 meters |
| 03. | Probe Mounting : | : | Stainless steel 1-1/2 ANSI RF Flange / 3/4" NPT (M) |
| 04. | Material of construction | : | 316 SS |
| 05. | Insulation | : | PTFE Part/Full as per service. |
| 06. | Transmitter | : | The transmitter shall receive output of the preamplifier and convert it into 4-20 mA DC output signals. |
| 07. | Accuracy | : | ±0.1% |
| 08. | Load | : | 750 Ohms or more |
| 09. | Enclosure | : | Powder/Epoxy coated Die cast aluminium. with neoprene gasket conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 10. | Ambient temperature | : | 0-60 °C. |
| 11. | Mounting | : | Wall / Surface |
| 12. | Supply voltage | : | (90-250) V AC, 50 Hz / (18-36) V DC |
| 13. | Response time | : | 100 msec or better |
| 14. | Cable connection | : | 3/4" ET Compression gland |
| 15. | Accessories | : | Counter flange, Cable gland, prefab cable if any |
| 16. | Preferable features | : | Alarm output contacts with adjustable set point facility |

C. Ultrasonic Level Transmitter

- | | | | |
|-----|--------------------------|---|---|
| 01. | Type of Transmitter | : | Non contact Microprocessor based 2 wire type, HART protocol Compatible |
| 02. | Output Signal | : | Galvanically isolated 4 – 20 mA DC along with superimposed digital signal (HART protocol) |
| 03. | Sensor Accuracy | : | ± 0.25% of calibrated span |
| 04. | Sensor Repeatability | : | 3 mm or better |
| 05. | Power Supply | : | 18 - 36V DC |
| 06. | Temperature Compensation | : | To be provided within transducer |
| 07. | Configuration | : | Sensor and electronic unit are separate. Electronic unit shall be possible to mount on the accessible location near the transducer. All cables, weather proof fittings for connection between transducer and electronic unit. |
| 08. | Housing | : | IP 55 with durable corrosion resistant Epoxy coating |
| 09. | Calibration | : | Through HART communicator |
| 10. | Zero and Span adjustment | : | Continuous, Tamper proof, Remote as well as manual adjustability. Provision to calibrate the instrument without any level in the tank or sump etc. |
| 11. | Sensor Material | : | Corrosion resistant to suit the individual application |
| 12. | False signal tolerance | : | Facility to be provided. Shall have adjustable damping circuitry. |
| 13. | Range | : | To be decided during detail Engg, with a facility to take care of frequency attenuation due to different obstructions (Surface, vapor) |

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- | | | | |
|-----|-----------------------|---|--|
| 14. | Display | : | Minimum 4 character display with integral key pad, access protected features. |
| 15. | Diagnostics | : | Loss of echo alarm |
| 16. | Load impedance | : | 500 Ω minimum or as per vendor specification. |
| 17. | Electrical connection | : | Plug and socket |
| 18. | Accessories | : | Canopy for protection sunlight and rain
Mounting hardware's and accessories shall be SS 316 |

D. Level Switch

- | | | | |
|-----|------------------------------|---|--|
| 01. | Type | : | External cage float operated. Magnetically coupled. |
| 02. | Float Material | : | AISI-316 stainless steel |
| 03. | Other wetted parts | : | AISI-316 stainless steel |
| 04. | External Cage | : | Carbon steel / Stainless steel as per process requirements, welded type / flanged construction. Cage pressure rating shall equal or exceed the rating of the main vessel. |
| 05. | External cage mounting | : | Side – Side with drain valve. |
| 06. | External cage connection | : | 25 NB socket weld to vessel or RF flanged. |
| 07. | Switch housing | : | Epoxy coated die-cast aluminum alloy with neoprene gasket conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 08. | Type of switch Configuration | : | 2 SPDT (two nos.) Snap acting magnetically operated hermetically sealed. |
| 09. | Contact rating | : | 5A, 240V/AC, 0.5A, 220V DC |
| 10. | Accessories | : | a) Counter flange, nuts & bolts, suitable gasket etc.
b) Steel globe type drain valve.
c) $\frac{3}{4}$ " ET cable gland
d) Stainless steel alpha-numeric engraved for service and tag. |
| 11. | Preferred feature | : | Switch operating point marked on cage |
| 12. | Temperature rating | : | As per application |

E. Conductivity Type Level Switch

- | | | | |
|-----|-----------------------|---|--|
| 01 | Type | : | Conductivity discrimination. |
| 03 | Mounting | : | Flanged – on standpipe. |
| 04 | Probe MOC | : | Stainless steel with high purity ceramic. |
| 05 | Probe rating | : | > Maximum design pressure of vessel. |
| 06 | Input | : | four independent channels with selectable switching threshold for water conductivity. |
| 07 | Relay Output | : | Four isolated output relays for HI, LO, HI-HI, LO-LO. |
| 08 | Contact type & rating | : | 2SPDT @ 0.5A 220V DC / 5 A 240V AC |
| 09 | Local Display | : | Colored LEDs for HI, LO, HI-HI, LO-LO. Power & fault. |
| 10 | Power supply | : | Dual (90-250) V AC, 50 Hz, 1Ph. |
| 11 | Enclosure | : | IP-65, corrosion resistant & wall mounting type (Explosion proof for NEC Class-1, Division-1 area). |
| 12 | Accessories | : | Teflon (PTFE) cable having Teflon wrapped individual cores and necessary sheathing shall be used to connect the probe with electronics |
| 13 | Test pressure | : | Two times rated pressure |
| 14. | Cable connection | : | $\frac{3}{4}$ " ET Compression gland |

F. Capacitance Type Level Switch

01	Type	:	Capacitance type
02	Probe	:	a) Rod or suspended electrode b) Rope type probes may be used only where required probe length is greater than 3 meters.
03.	Probe Mounting	:	Stainless steel 1 1/2" ANSI RF Flange / 3/4 "NPT (M)
04.	Material of construction	:	316 SS
05.	Insulation	:	PTFE Part/Full as per service.
06.	Enclosure	:	Powder/Epoxy coated Die cast Aluminium with neoprene gasket conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area).
07.	Ambient temperature	:	0-60 °C.
08.	Mounting	:	On Tap
09.	Supply voltage	:	(90-250) V AC, 50 Hz / 18-36 V DC
10.	Relay output	:	2 SPDT @ 0.5 A 220V DC / 5A 240V AC
11.	Response time	:	100 msec or better
12.	Cable connection	:	3/4" ET Compression gland
13.	Accessories	:	Counter flange, Cable gland, prefab cable and stainless steel name plate engraved with alpha-numeric.

G. Level Switch (Ultrasonic Type)

Ultrasonic type level switch, IP-65 protection; Switch with 2 nos. of SPDT contacts (1 NO and 1 NC) rated for 0.2 A, 220 V DC; Accuracy $\pm 0.25\%$; Resolution 1mm; Repeatability $\pm 0.1\%$; Linearity $\pm 1\%$; Response time 150ms; Beam angle $< 12^\circ$; Auto false echo-suppression; Accessories like integral cable between sensor and transmitter unit with connectors on both side, gasket and cable gland, digital panel meter, name plate & metal tag; the material of accessories will be SS.

H. Level Switch (Radar Type)

Radar type level switch, top mounted, IP-65 protection; Switch with 2 nos. of SPDT contacts (1 NO and 1 NC) rated for 0.2 A, 220 V DC, Accuracy $\pm 1\%$; Resolution 0.04"; Repeatability $\pm 0.04\%$; Linearity $\pm 0.01\%$; Beam angle $< 20^\circ$; Accessories like integral cable between sensor and transmitter unit with connectors on both side, gasket and cable gland, name plate & metal tag; the material of accessories will be SS.

I. Conductivity Type Electronic Level Indicator

01	Type	:	Conductivity discrimination.
02	No. of Probes	:	14, 16 or 32 as per application.
03	Probe Mounting	:	Screw type / Flanged – on standpipe.
04	Probe MOC	:	Stainless steel with high purity ceramic.
05	Probe rating	:	> Maximum design pressure of vessel.
06	Input	:	Independent channel with selectable switching threshold for water conductivity.
07	Relay Output	:	Four isolated output relays for Hi, Lo, Hi-Hi, Lo-Lo.
08	Contact type & rating	:	2 SPDT @ 0.5 A 220V DC / 5A 240V AC
09	Current output	:	Isolated 4-20 mA DC & HART
10	Local Display	:	Red, Green and flashing yellow LED's for steam, water and fault indication respectively.
11	Remote Display	:	Red, Green & flashing yellow LEDs for steam, Water & Fault indication respectively.
12	Power supply	:	Dual (90-250) V AC, 50 Hz, 1Ph.

VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- | | | | |
|-----|---------------|---|---|
| 13 | Enclosure | : | i) IP-65, corrosion resistant & wall mounting type for local electronics. |
| | | | ii) IP-42 for remote indicator |
| 14 | Accessories | : | i) PTFE cable from probe to electronics |
| | | | ii) Mounting accessories. |
| | | | iii) Standpipe |
| | | | iv) Washer & gaskets |
| 15 | Test pressure | : | Two times design pressure |
| 16. | Alarm levels | : | Probe number shall be selectable for HI, LO, HIHI, LOLO |

J. Level Gauge (Float & Tape)

- | | | | |
|-----|------------------|---|------------------------------|
| 01. | Type | : | Float and Tape |
| 02. | Float & Tape MOC | : | AISI 316 |
| 03. | Pulley material | : | Aluminium |
| 04. | Guide wire | : | SS 316 Stainless steel |
| 05. | Accuracy | : | +/- 2 mm |
| 06. | Indication | : | On circular or vertical dial |
| 07. | Rating | : | Twice the design pressure |

K. Silo pilot

- | | | | |
|-----|--------------------|---|--|
| 01. | Application | : | Solid material in Material bins, silos, etc. |
| 02. | Power supply | : | (90-250) V AC, + 10%, 50 Hz selectable. |
| 03. | Mounting | : | Top with ANSI RF Flange |
| 04. | Protection class | : | IP-65. |
| 05. | Ambient | : | 65 ° C (Max.) dust laden atmosphere |
| 06. | Housing | : | Cast aluminum with sun Cover |
| 07. | Measuring rope | : | Corrosion resistant steel |
| 08. | Counting step | : | 1 pulse/1-10cm depending on application |
| 09. | Output from sensor | : | Change over contact |
| 10. | Motor | : | 1 phase |

Electronics

- | | | | |
|-----|---------------------|---|---|
| 01. | Type | : | Microprocessor based |
| 02. | A/M Switch | : | Yes, in auto mode level measurement in regular interval as set in the instrument. |
| 03. | Output | : | a) 4-20 mA DC (stored D/A) & if applicable HART protocol
b) 2 nos. SPDT contacts |
| 04. | No. of set points | : | 2 nos. |
| 05. | Min. counting pulse | : | 20 mins. |
| 06. | Mounting | : | Wall or 19" rack |
| 07. | Enclosure | : | IP 65 |

III. FLOW INSTRUMENTS**1. Mass Flow Meter****A Sensor**

- | | | | |
|-----|---------------------------------|---|---|
| 01. | Measuring Principle | : | Coriolis Mass flow. |
| 02. | Primary Element | : | Flow Tube of 316SS or better (Suitable for the process fluid) |
| 03. | Heating Arrangement | : | Integral with Flow Element. |
| 04. | Temperature Control For Heating | : | To be provided. |
| 05. | Process Connection | : | ANSI RF Flanged and rating as per process requirement. |
| 06. | Drain | : | Self-draining facility |

07. Accessories : Counter flanges, Mounting nuts, bolts, gaskets etc.

B Transmitter

01. Measured quantities : Mass Flow rate, Total Mass Flow, Density, Temperature as minimum.
02. Input Signal Processing : Digital Processing.
03. Display : Digital Display (LCD).
04. Output : 2 Nos. isolated output of 4-20mA DC selectable from four measured quantities.
05. Load : < 750 ohms.
06. Power supply : (90-250) V AC, 50 Hz.
07. Turn Down : 100:1
08. Accuracy : $\pm 0.2\%$ of measured value
09. Ambient Temperature : 85°
10. Repeatability : $\pm 0.05\%$
11. Housing : IP 65 (Explosion proof for NEC Class-1, Division 1 area)
12. Hazardous duty Version : FM Standards.
13. Nameplate : Tag number, service engraved in stainless steel tag plate
14. Accessories : a) As required for field mounting
b) Handheld configurator
c) Mounting U-bolts, nuts, bolts, prefab cable etc.
d) $\frac{3}{4}$ " ET cable gland

2. Turbine Flow Meter

A. Sensor

01. Type : Turbine (in line full-bore, based on magnetic pick of pulses)
02. Output Signal : Pulse
03. Material of Construction : a) Body : AISI 316
b) Rotor: AISI 431 or 410
c) Bearings: Tungsten Carbide / Stellite Sleeve
04. Flow rate range : As required.
05. Linearity : $\pm 0.25\%$ or better.
06. Repeatability : $\pm 0.02\%$ or better.
07. Ambient temperature : 50°C
08. Mounting : On-Line mounting with ANSI RF flanges of stainless steel.
09. Enclosure : IP 65

B. Transmitter

01. Electronics : Solid State
02. Power Supply : (90-250) V AC, 50 Hz.
03. Input : Input from Sensor
04. Display : 4 1/2 digit LCD
05. Output : Isolated 4-20mA DC & HART
06. Measuring Accuracy : $\pm 0.5\%$ of full scale range
07. Totalized Value : Required
08. Housing : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
09. Nameplate : Tag number, service engraved in stainless steel tag plate
10. Accessories : a) clamping strip, bracket, prefab cable etc.
b) Calibration or configurator kit.
c) $\frac{3}{4}$ " ET cable gland

3. Vortex Flow Meter**A. Sensor**

01. Type	:	Vortex
02. Output Signal	:	Pulse
03. Material of Construction	:	AISI 316
04. Sensor Seal	:	PTFE / higher based on temperature
05. Flow range	:	As required.
06. Linearity	:	$\pm 0.25\%$ or better.
07. Repeatability	:	± 0.1 of actual flow rate or better.
08. Ambient temperature	:	85 °C
09. Mounting	:	On-Line mounting with flanges of stainless steel.
10. Enclosure	:	IP 65
11. Accessories	:	Nuts, bolts, gaskets etc.

B. Transmitter

01. Electronics	:	Solid State
02. Power Supply	:	(90-250) V AC, 50 Hz.
03. Input	:	Input from Sensor
04. Display	:	4 ½ digit LCD
05. Output	:	Isolated 4-20mA DC & HART
06. Measuring Accuracy	:	$\pm 0.025\%$ of span
07. Totalized Value	:	Required
08. Housing	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
09. Nameplate	:	Tag number, service engraved in stainless steel tag plate
10. Accessories	:	a) Clamping strip, bracket, prefab cable etc. b) Special tool kit for calibration / configuration. c) ¾" ET cable gland

4. Electro-Magnetic Flow Meter**A. Sensor**

01. Measuring Principle	:	Faraday's law of Electro-magnetic induction.
02. Primary Element	:	Flow Tube of 316SS or better
03. Service	:	Conductive Liquids and Slurries
04. Sensor type	:	Insertion style / Wafer style
05. Process Connection	:	ANSI RF Flanged and rating as per process requirement.
06. Accessories	:	Counter flanges, Mounting nuts, bolts, gaskets etc.

B. Transmitter

01. Measured quantity	:	Volumetric Flow rate
02. Input Signal Processing	:	Digital Processing.
03. Display	:	Digital Display (LCD).
04. Output	:	Isolated output of 4-20mA DC & HART
05. Load	:	< 750 ohms.
06. Power supply	:	(90-250) V AC, 50 Hz.
07. Turn Down	:	100:1
08. Ambient Temperature	:	74 °C
09. Accuracy	:	$\pm 0.25\%$ of measured value
10. Repeatability	:	$\pm 0.1\%$ of Reading.
11. Housing	:	IP 65 (Explosion proof for NEC Class-1, Division 1 area)
12. Hazardous duty Version	:	FM Standards.

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

13. Nameplate : Tag number, service engraved in stainless steel tag plate
14. Accessories : a) As required for field mounting
e) Handheld configurator
f) Mounting U-bolts, nuts, bolts, prefab cable etc.
g) 3/4" ET cable gland

5. Ultra sonic type Flow Meter

Ultra sonic type flow elements shall be provided for measurement of CW flow.

- i) Ultrasonic Flow meter shall be dual path transit time clamp-on type.
- ii) The flow meters shall be of proven reliability, accuracy and repeatability requiring a minimum of maintenance. They shall comply with relevant international standards and shall be subject to approval.
- iii) All accessories required for mounting/erection of these instruments shall be furnished, erected and installed as necessary for completeness of the system though not specifically asked for. Also the equipment shall include necessary cables, flexible conduits, junction boxes required for the purpose.
- iv) Flow meters shall be provided with suitable environment protection devices/structures such that they shall be suitable for continuous operation in the operating environment of a coal fired utility station without any loss of function or departure from the specification requirements.

Type	Transit time Clamp On Ultrasonic meter
Mounting Style	Dual path with two sets of transducers on the same pipe
Flow measurement	Instantaneous Flow rate as well as totalized flow
Power supply	230 V AC
Outputs :	
Analog Current	Isolated 4-20mA linear outputs for each path
Binary	Contact relay outputs, 2 NO + 2 NC for alarm
Communication ports	RS 232 C digital Hand held terminal port
Display/Indication	Flow meter with LCD screen backlight based local display and keypad. If required, transmitter shall be suitably located away from the sensor for better access and visibility.
Recording / Totalizing /Logging Facilities	Yes. Should be able to compute cumulative flow over intervals selectable by owner i.e., daily, weekly, monthly etc. The data shall be stored in the memory of flow computer for access in future
Software features	Compensation for any cross path errors Programming, configuration, shall be possible from front panel.
Diagnostics	False signal tolerance , power supply failure etc
Protection class	IP-65 or better, Weather protection against direct sunlight, rain etc for Flow meter and suitable for Cooling water for Transducer
Accuracy	+/- 1%
Electrical connection	Plug and socket
Accessories	All mounting hardware required like clamping fixtures, mechanism to remove the transducers online, interconnecting cables etc All weather canopy for protection from direct sunlight and direct rain. Material of all fittings shall be SS316.

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

6. Rotameter

- | | | |
|-------------------------|---|---|
| 01. Type | : | On-line and by-pass |
| 02. Metering tube | : | Borosilicate glass |
| 03. Float | : | AISI 316-SS unless the process fluid demands some other material. |
| 04. Packing material | : | Teflon |
| 05. Body MOC | : | CS or SS as per fluid condition. |
| 06. Scale | : | Graduated- Engraved black on white background. |
| 07. Process connection | : | Flanged (RF) to line size as per ANSI standards. |
| 08. Accuracy | : | ± 2% of full scale detection or better for on-line type and ±4% of full-scale detection or better for by-pass type. |
| 09. Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 10. Accessories | : | Slip-on orifice plate of 316-SS and taps of CS / SS as per application requirements. Applicable CS / SS Isolation valves and SS Range Orifice - for bypass type rotameters. |
| 11. Pressure Rating | : | As per application |
| 12. Flow & Scale length | : | To be decided by Contractor. |

7. Orifice Plate

- | | | |
|-----------------------|---|--|
| 01. Type | : | Ring joint / Flange type or other required type (To be decided by Contractor) |
| 02. Material I | : | 316 SS connection office |
| 03. Application | : | Low fluid velocity flow measurement |
| 04. Design Standard | : | BS-1042, Part-I |
| 05. Number of Tapings | : | One additional pair of taps for performance test. (i.e. for control measurement, 3+1 pair of taps to be provided, for monitoring measurement, 2+1 pair of taps to be provided) |
| 06. Diameter Ratio | : | Between 0.4 to 0.7 |
| 07. Accessories | : | Flanges, gaskets, nuts & bolts, root valves jack screw etc. |

8. Flow Nozzle

- | | | |
|-----------------------|---|---|
| | : | flow element shall have 3 pair of differential pressure tapping |
| 01. Application | : | High fluid velocity flow measurement |
| 02. Design Standard | : | ASME PTC 19.5 |
| 03. Number of Tapings | : | One additional pair of taps for performance evaluation (i.e. for control measurement, 3+1 pair of taps to be provided, for monitoring measurement, 2+1 pair of taps to be provided) |
| 04. Diameter Ratio | : | Between 0.4 and 0.7 |
| 05. Accessories | : | Meter run pipe, nipples and root valves. (Inspection port assembly for nozzles used in plant performance purpose) |

9. Sight Glass

- | | | |
|--------------------|---|------------------------|
| 01. Type | : | Flap-type |
| 02. End connection | : | Screwed / Flanged |
| 03. Material: | | |
| a) Body | : | SS-304 |
| b) Cover Plate | : | SS-304 |
| c) Indicator | : | SS-316 |
| 04. Sight Glass | : | Toughened Borosilicate |
| 05. Gasket | : | Neoprene |
| 06. Bolts & Nuts | : | High tensile steel |

07. Hydraulic Test Pressure : 1.5 times maximum working pressure
 08. Accessories : As required

- 10. Gauge Glass** : flow element shall have 3 pair of differential pressure tapping
01. Type : Reflex
 02. Glass : Toughened borosilicate. Resistant to mechanical and thermal shocks.
 03. Body material : SS-304 / 316 / Carbon steel – As per process requirements (Flanged Connection)
 04. Pressure rating : Twice the maximum working pressure
 05. Temperature rating : 300 ° C
 06. Bolts and nuts : Rust proof alloy steel
 07. Accessories : Suitable ball check valves of SS- 304/316 body, gaskets, companion flange etc.

11. Flow Switches

Indicating, Differential pressure, flapper type on line flow switches for line sizes up to 80 mm with an accuracy of +/-0.5% of span and dial size of min. 50 mm having 316 SS flapper/SS 316 bellows housed in die cast aluminium. Micro switch with adjustable range with 2 SPDT contacts rated for 0.2 A, 220 V DC. IP 65 or equivalent degree of protection for enclosure. The material of accessories shall be SS. Repeatability shall be +/-0.5% of span. Over range protection shall be 50% above maximum flow. Setting shall be tamper proof external adjustment & scale shall be provided for setting. Range spring & orifice plate shall be SS 316 for DP type. NPT for sizes below 2" & for sizes above 2" ANSI 150 RF shall be provided. Accessories like nameplate, mating flanges with gaskets, bolts & nuts, pipe assembly with orifice plate, etc. 5 way manifold, pipe, fittings (DP type), etc. shall be supplied

IV TEMPERATURE INSTRUMENTS

1. Thermocouples

01. Type : a) Type-T (Copper Constantan) or Type-K (Chromel Alumel) [As per specification requirement]
 b) Duplex
 c) Ungrounded
02. Wire gauge : 16 AWG
 03. Standard : ANSI-MC 96.1.
 04. Protecting Tube:-
 i) O.D. : 8 mm (approx.)
 ii) Material : 316-SS Seamless
 iii) Filling : Magnesium Oxide (Purity above 99.4%)
 05. Response time : a) Less than 2 to 6 seconds. .
 b) Less than 10 seconds for control.
06. Head:
 i) Type : IP-65 universal screwed type. (Explosion proof for NEC Class-1, Division 1 area)
 ii) Material : Die cast aluminum or better
 iii) Terminal blocks : Nickel plated Brass - screw type / silver plated
 iv) Cable connection : 3/4" ET gland and grommet.
 v) Others : Terminal head cover with SS chain and suitable gasket
 07. Accessories : a) Adjustable nipple-union-nipple with thermowell connection

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- b) Compression fittings/unions
c) Flanges etc. (for flanged connections only)
c) SS 316 forged thermowell as per ASME PTC code.
08. Nameplate : Tag number, service engraved in stainless steel tag plate
09. Static Pressure Limit : As per application.
10. Length : As per application
11. Limits of error @ 0 Deg Ref.: For K type + 1 Deg C or 0.4% (Greater Value)
For T type + 0.5 Deg C or 0.4% (Greater Value)

2. Resistance Temperature Detector

01. Type : Platinum (Duplex), ungrounded class 'A'
02. Resistance : 100 ohm at 0 °C
03. Base : Wound on ceramic (anti-inductive)
04. Wiring : 3 Wire
05. Protecting Tube :-
i) O.D. : 8 mm (approx).
ii) Material : SS-316, Seamless
iii) Filling : Magnesium oxide (Purity above 99.4%).
iv) Length : As per application
06. Response time : a) 1 to 2 seconds
07. Head:
i) Type : IP-65 universal screwed type. (Explosion proof for NEC Class-1, Division 1 area)
ii) Material : Die cast aluminum or better
iii) Terminal blocks : Nickel plated Brass-screw type / silver plated
iv) Cable connection : 3/4" ET gland and grommet.
v) Others : Terminal head cover with SS chain and suitable gasket
08. Accessories : a) Adjustable nipple-union-nipple with thermowell connection
b) Compression fittings/unions
c) Flanges etc. (for flanged connections only)
d) SS 316 forged thermowell as per ASME PTC code.
09. Nameplate : Tag number, service engraved in stainless steel tag plate
10. Standard : Standard DIN 43760
11. Limit of error : @ 0 Deg C ± 0.06 Ohm
@ 100 Deg C + 0.13 Ohm
@ 200 Deg C ± 0.20 Ohm
@ 300 Deg C ± 0.27 Ohm

3. Field Mounted Temperature Transmitters

01. Working Principle : Smart
02. Type : Two wire
03. Input : Universal (T/C of different types, PT 100 RTD and other RTDs)
03. Output Signal : Simultaneous transmission of digital and 4-20 mA DC signal with HART.
04. Signal Processing Circuitry : Microprocessor based Solid State Electronic
05. Span and Zero : Adjustable in field, Non-interacting facility for elevation and suppression of zero.
06. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
07. Output Indicator : LCD type

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- | | | | |
|-----|---------------------------------|---|--|
| 08. | Span Adjustability | : | Yes |
| 09. | Nameplate | : | Tag number to be engraved on metallic tag plate rigidly fixed to the body. |
| 10. | Body | : | Die Cast aluminum |
| 11. | Operating Voltage | : | 18-36 V DC |
| 12. | Load | : | 600 Ohms at 24V DC (Min.) |
| 13. | Performance | | |
| | i) Accuracy | : | 0.2% of span |
| | ii) Repeatability | : | ±0.05% of span |
| | iii) Cold Junction Compensation | : | Built-in |
| | iv) Calibration | : | As per N.I.S.T Monograph 125 for T/C and European Curve Alpha = 0.00385 for RTD |
| 14. | Accessories | : | a) Universal mounting bracket suitable for pipe and surface mounting.
b) Hi-tensile Carbon Steel U-bolts. |

4. Thermo Well

Thermo wells Pipe/equipment mounted temperature test wells of 316 SS with a process connection of M33x2 thread or 150 RF flanged and instrument connection of ½" NPT (F) in general or 150 RF flanged.. Accessories like name plate, plug with chain, etc. shall be provided. Material of accessories shall be SS. Thermowell shall be hex head of barstock assembly. In case flanged wells are required for any specific application, the same shall be supplied as required. The thermo well construction shall meet the ANSI 19.3 (latest) requirements. Thermo well shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid. All Test thermo well shall have the plug of SS316.

For measurement of pulveriser outlet temperature tungsten carbide block thermowells abrasion resistant not tungsten carbide coated thermowell shall be used. Also the terminals of Thermocouple shall not be at the top of Mills itself. The thermocouple wires are to be laid up to JB through SS tubing of required diameter and the head shall be placed nearer to the JB. Compensating cable exposed to atmosphere in the conventional method melts away due to high temperature at the top of Mill.

For measurement of sea water temperature SS with titanium sleeve thermo wells or better, shall be used.

5. Temperature Switch

- | | | | |
|-----|--------------------------|---|--|
| 01. | Type | : | Mercury filled-in |
| 02. | Sensing Element Material | : | Bellow / Bourdon AISI SS-316 |
| 03. | Bulb Material | : | AISI SS-316 |
| 04. | Capillary | : | Stainless steel armored |
| 05. | Movement Material | : | AISI SS-304 |
| 06. | Case material | : | Epoxy coated steel plate or die-cast aluminum alloy with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 07. | Scale | : | Black lettering on white background |
| 08. | Over range Protection | : | 120 % |
| 09. | Instrument connection | : | Bottom |
| 10. | Switch configuration | : | Two SPDT |
- Lead wires (3+3 Nos.) are to be brought externally to the male connector wherein the female pug connector will be inserted to connect the control room cables for easy removal & re - calibration

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- | | | | |
|-----|--------------------|---|---|
| 11. | Switch rating | : | 240V, 5A AC/220V, 0.5A DC |
| 12. | Switch type | : | Snap acting, shock and vibration-proof. |
| 13. | Adjustability | : | a) Internal Set point adjustable over span range
b) Differential adjustable by 10% of span (minimum) |
| 14. | Cable connection | : | 3/4" ET compression gland. |
| 15. | Compensation | : | a) Capillary compensation with invar wire throughout the capillary length.
b) Case compensation |
| 16. | Performance: | | |
| | i) Scale Accuracy | : | ±1.0 % of full scale |
| | ii) Repeatability | : | < 0.5 % of full range |
| | iii) Response time | : | Less than 40 seconds with thermowell |
| 17. | Capillary length | : | 5 meters (minimum) for local mounting/15 meters for local panel mounting. |
| 18. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 19. | Accessories | : | Mounting accessories, 3/4"ETcable gland |

6. Temperature Gauge

- | | | | |
|-----|--------------------------|---|--|
| 01. | Type | : | Mercury filled-in remote mounting system
Capillary armoured / rigid system type (backward entry / bottom entry) |
| 02. | Sensing Element Material | : | Bourdon - AISI-316 SS |
| 03. | Capillary Armoring | : | Stainless steel flexible |
| 04. | Movement Material | : | AISI 304 SS / Direct Bourdon tip connection to pointer spindle |
| 05. | Bulb Diameter and Length | : | As required |
| 06. | Bulb Material | : | AISI 316 |
| 07. | Capillary | : | Stainless Steel |
| 08. | Thermometer | : | M 20 x 1.5 Male adjustable gland on stem to suit associated Thermowell |
| 09. | Case Material | : | Stainless steel bayonet type with clear glass cover conforming to IP-65. |
| 10. | Dial Size | : | 150 mm in general (100 mm for SWAS gauges) |
| 11. | Scale | : | Black lettering on white background in 270 Deg. arc. |
| 12. | Mounting | : | Surface/Panel |
| 13. | Over range Protection | : | 125 % of range or more |
| 14. | Instrument connection | : | Bottom connection for local mounting and back connection for panel mounting. |
| 15. | Range | : | 50% ~ 70% range of operating temperature of application approximately. |
| 16. | Compensation | : | Case compensation |
| 17. | Zero adjuster | : | Micrometer screw adjustable from front. |
| 18. | Window | : | Shatterproof toughened glass. |
| 19. | Performance | : | Accuracy of ± 1 % of full-scale deflection or better. |
| 20. | Enclosure Class | : | IP-65 |
| 21. | Capillary | : | 5 meters (local)/15.0 meters (local panel) - armored stainless steel |
| 22. | Preferred Feature | : | Capillary Compensation |
| 23. | Accessories | : | a) Forged SS 316 thermowell weldable or screwed as per ASME PTC code
b) Installation accessories as required. |
| 24. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 25. | Immersion length | : | Adjustable up to 300 mm including bulb length or as per application |

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- | | | |
|------------------------------|---|--|
| Analyzer | | |
| 20. Error code | : | To be indicated in LCD display for correction |
| 21. Instrument Configuration | : | Through HART configuration and through the keyboard. |

2. PH Analyser

A. SENSOR

- | | | |
|---|---|--|
| 01. Type of Cell | : | Flow through type and maintenance free |
| 02. Process Connection | : | Screwed |
| 03. Type of measurement | : | General purpose |
| 04. Temperature Compensation | : | Automatic (Integral) upto 0-120°C with PT-100 Sensor |
| 05. Preamplifier | : | Integrated not be separate |
| 06. Range | : | 0-14 pH |
| 07. Measuring Electrode and Liquid Junction | : | Cartridge type |
| 08. Pressure Rating | : | 10 kg/cm ² |
| 09. Accessories | : | Tee / Vessel (PVC or HASTALLOY) |
| 10. Cable | : | Upto transmitter in flexible conduct |

B. TRANSMITTER

- | | | |
|------------------------------|---|---|
| 01. Type | : | Microprocessor based & Smart |
| 02. Mounting | : | Flush Panel |
| 03. Protection Class | : | IP – 65 or better |
| 04. Output | : | Simultaneous transmission of digital and 4-20 mA DC (isolated) , HART protocol for recorder for configuration and diagnosis |
| 05. Display | : | <ul style="list-style-type: none"> i) 3½" Digit LCD display of process variable in Engineering unit, Temperature, Alarm status, Units of measurements etc. ii) Character Height 18 mm |
| 06. Calibration | : | Two-point calibration with standard buffer solutions. |
| 07. Temperature Compensation | : | Manual or Automatic - selectable through keyboard |
| 08. Diagnostic | : | Self diagnostic for "Calibration required"/ "Calibration O.K.", electrode checking etc. |
| 09. Alarm | : | Dual alarm set point, hysteresis and time delay adjustable on membrane keyboard.
2Nos. SPDT potential free contacts rated 5A 240V AC / 0.5A 220V DC
Set point programmable through keyboard |
| 10. Enclosure | : | Polypropylene , Weather proof corrosion resistant NEMA 4X |
| 11. Cable Termination | : | Internal (cable entry through conduit) |
| 12. Accuracy | : | ± 0.02 pH or better |
| 13. Repeatability | : | ± 0.1% or better |
| 14. Response Time | : | 7 seconds for FSD or better |
| 15. Stability | : | ± 0.01 pH/month/non-cumulative |
| 16. Power Supply | : | 240 V AC, 50 Hz |
| 17. Operating Temp. | : | 0 - 50°C |
| 18. Accessories | : | <ul style="list-style-type: none"> a) Ultrasonic Electrode Cleaner. b) Phenolic nameplate giving tag number, service, etc. |

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- c) Pre-amplifier, special cable, ultrasonic cleaner, etc.
- d) Buffer tablets.
- 19. Load : 500 ohms or more at 24V DC
- 20. Software security lock for programming the Analyzer : To be provided
- 21. Error code : To be indicated in LCD display for correction
- 22. Instrument Configuration : Through HART configuration and through the keyboard.

3. Silica Analyzer

- 01. Type : Colorimetric monitor, gravity / pumped feed Microprocessor based (With auto request shut of feature case of sample loss or power loss built in phosphate inhibit feature).
- 02. Operating range : 0-50/500/5000µg/liter (field adjustable).
- 03. Output : Simultaneous transmission of digital and 4-20 mA DC (isolated), with load 500 ohms & HART for for configuration and diagnosis
- 04. Display : 5½" Digit LCD display of process variable in engineering unit
- 05. Accuracy : ± 1 % of span
- 06. Repeatability : ± 2% of F.S.D. or better
- 06A sensitivity : 0.2 Micrograms /litre
- 07. Calibration : Manual & automatic
- 08. Operating ambient Temperature : 0-50 °C
- 09. Ambient humidity : Up to 95% relative humidity
- 10. Mounting : Flush panel
- 11. Life of light source : 10,000 hours (min.)
- 12. Power supply : (90-250) V, 50 Hz, 1 Phase
- 13. Alarm Facility : 2 SPDT potential free contacts rated 5 A 230V AC / 0.5A 220V DC. Alarm set points independently programmable through keypad. (Snap action micro switch)
- 14. Alarm for :
 - a) Monitor mal-function
 - b) Monitor on standby
 - c) Monitor auto-zeroing
 - d) Concentration high
 - e) Loss of sample
 - f) Concentration low
 - g) Loss of reagent
- 15. Preferred features :
 - a) HI and LO alarm in LCD display.
 - b) Power supply on/failure LED visible from front.
 - d) 3 channel instrument is preferred. Auto sampling facility with necessary valves & solenoids in the sample lines shall be provided
- 16. Accessories :
 - a) Reagent cabinet
 - b) Sample strainer
 - c) Solenoid valves, pressure gauges
 - d) Phenolic name plate
 - e) Reagents & consumables

G. ELECTRICAL SYSTEMS METERS AND ACCESSORIES

A. Push Button

01. Type	:	Shrouded square format
02. Face Dimension	:	32 x 32 mm (maximum)
03. Contact Configuration	:	2 NO + 2 NC
04. Contact Addition	:	Add-on block up to 4 each with 2 pairs of contacts
05. Contact Material	:	Hard Silver Alloy
06. Contact Rating	:	500V / 10 A

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

07.	Utilization Category	:	AC11 / DC11
08.	Insulation Voltage	:	2 KV for 1 minute between terminals and earth
09.	Mechanical Life	:	1 million operations
10.	Construction	:	Aluminum shrouding with plastic lens
11.	Colors	:	Red, Green, Yellow, Black, etc.
12.	Connection	:	Screw terminals
13.	Enclosure Class	:	IP-52
14.	Legend	:	Engraving

B. Illuminated Push Button

01.	Type	:	Square format
02.	Face Dimension	:	32 x 32 mm (maximum)
03.	Contact Configuration	:	2 NO + 2 NC (minimum)
04.	Contact Addition	:	Add-on-Block up to 4 each with 2 pairs of contacts
05.	Contact Material	:	Hard Silver Alloy
06.	Contact Rating	:	500 V/ 10A
07.	Utilization Category	:	A C11 / DC11
08.	Insulation Voltage	:	2 KV for 1 minute between terminals and earth
09.	Mechanical Life	:	1 Million Operations
10.	Lamp	:	LED with built-in resistors as required
11.	Lamp Rating:-		
	a) Voltage	:	240 V AC
	b) Watt	:	2 Watt (approx.)
12.	Lamp and Lens Replacement	:	From front
13.	Construction	:	Transparent Plastic Lens
14.	Color	:	Red, Green, Amber, Yellow etc.
15.	Connection	:	Screw terminals
16.	Enclosure Class	:	IP-52
17.	Legend	:	Engraving

C. Selector Switch

01.	Type	:	2/3/4 position stay put type with rotary lever actuator.
02.	Face Dimension	:	32 x 32 mm (maximum)
03.	Contact Configuration	:	4 pair of contacts
04.	Contact Addition	:	Add-on-Block up to 4 each with 2 pairs of contact
05.	Contact Material	:	Hard silver Alloy
06.	Contact Rating	:	500 V / 10 A
07.	Utilization Category	:	AC11 / DC11
08.	Insulation Voltage	:	2 KV for 1 minute between terminals and earth
09.	Mechanical Life	:	1 million operation
10.	Construction	:	Aluminum shrouding
11.	Connection	:	Screw terminals
12.	Enclosure Class	:	IP-52

D. Indicating Lamp

01.	Type	:	LED with built-in resistor (LED must not glow if the voltage is less than 180 V)
02.	Face Dimension	:	32 x 32 mm (maximum)
03.	Voltage	:	230 V, 50 Hz, 1 Phase
04.	Watt	:	2.5 Watt (approximate)
05.	Lamp and Lens Replacement	:	From front
06.	Construction	:	Transparent Plastic lens
07.	Color	:	Red, Green, Amber, Yellow etc.
08.	Connection	:	Screw terminals

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

I. Distribution Boards

- | | | |
|------------------------|---|-------------------|
| 01. Type | : | Fixed, Modular. |
| 02. Power distribution | : | Through MCCB |
| 02. Enclosure | : | Sheet Steel, IP54 |
| 03. Mounting | : | Free standing |
- (Can be attended from both front & back)

J. Electrical Junction Box

- | | | |
|---------------------------|---|--|
| 01. Type of Enclosure | : | Dust tight, Weatherproof and Waterproof, generally conforming to IP 65. |
| 02. Material | : | 16 SWG sheet steel hot-dip galvanized / Cast aluminum LM6. |
| 03. Type of Cover | : | Solid unhinged with retention chain |
| 04. Number of Paint | : | One base + two finish coatings of anti corrosive epoxy |
| 05. Mounting | : | Surface |
| 06. Cable Entry | : | Conduit Knockout/Threaded Hub |
| 07. Gasket | : | Neoprene |
| 08. Grounding | : | Brass earth lug with green screw head
External-2 Nos, Internal-1 no.M6. |
| 09. Number of Drain Holes | : | Two at bottom capped. |
| 10. Tag Plate | : | a) JB Number
b) Cable Numbers on top
c) Cable numbers with ferrules (side) |
| 11. Accessories | : | a) Rail mounted Terminal blocks with makers
b) Cable gland |

K. Cable Gland

- | | | |
|------------------|---|--|
| 01. Type | : | Double compression |
| 02. Entry Thread | : | ET |
| 03. Material | : | Brass |
| 04. Finish | : | Cadmium Plated. |
| 05. Protection | : | IP – 54 or better |
| 06. Accessories | : | Neoprene gasket, locknuts, reducers etc. |

L. Cable Tray

- | | | |
|-----------------|---|----------------------|
| 01. Material | : | Mild steel |
| 02. Thickness | : | not less than 2.5 mm |
| 03. Finish | : | Hot dip galvanized |
| 04. Perforation | : | As per MFR standard. |
| 05. Cover | : | Suitable for tray |

M. Digital Display Unit

To display the digital value of any analog process parameter with sign and decimal point of any analog input assigned though operator. Accuracy shall be $\pm 0.25\%$ of reading; type of display – LED; Seven segment or dot matrix as option; five digits, sign and decimal point; Range & offset – programmable or configurable digit size shall be minimum of 50mm; colour of display shall be Red or Green; enclosure shall be IP32 or equal; all DDUs shall be mounted on the Unit Control Panel. The DDUs common for both Units shall be mounted in the Center of Control room with suitable arrangement. Which will be decided during detail engineering

N. Hybrid Recorders

Microprocessor based Chartless Hybrid Recorder with an accuracy of $\pm 0.2\%$; response time of 0.5sec (for 10% to 100% change); data storage in Hard disk – Hard disk shall have a capacity to store data of all points, at an average interval of 30 secs (settable), for one week. data retrieval through USB port or RS232/485/ethernet with associated software (to be loaded in the PC); Alarms for each Channel; no. of Channels

shall be 48; shall accept universal inputs (T/C, RTD, DC volts, 4-20mA, etc); scan rate of 20 ms scanning with 48 channel (1 Nos.) for boiler parameters, 20 ms scanning with 48 channel (3 Nos.) for generator, 20 ms scanning with 48 channel (2 Nos.) for turbine parameters ; display shall be coloured LCD or fluorescent tube with user selectable span; programmability (selection of input & scan/storage rate) shall be through Front panel keyboard; the recorder shall have the capability of being drawn out from the front side of the housing for maintenance and shall have electrical connection of plug-in type; material of casing shall be die-cast aluminium with epoxy coating and with a non-glare shatter proof Glass; enclosure shall be IP32 The quantity of Hybrid recorders shall be decided during detail engineering. The recorders are all to be connected through Ethernet cable to a PC with necessary software for downloading the data from recorder and also the PC shall be capable of viewing the data / uploading the configuration on the recorder. The Ethernet cable of sufficient quantity with necessary connectors, windows based software for file transfer from recorder to PC are also to be supplied.

O. Interposing Relays (IPR)

Electro magnetic type IPRs with plug-in type connections, suitable for channel / rail mounting in cabinets; coil rating 24V D.C; 2 set of silver plated Change over contacts rated for 0.2A 220VDC. Freewheeling diode across relay coil (copper) and self reset type status indicator flag (electronic) shall be provided. All relays shall be mounted in IPR cabinet & relay base (silver plated) internally wired to the external cabling termination block in IPR cabinet. Wiring connection shall be cage-clamp & termination shall be suitable for 0.5 sq. mm to 2.5 sq. mm size wiring. Facility to simulate relay operation manually shall be provided. Relays of different contact interrogation voltages shall be separated by a barrier in IPR cabinet. Accessories like name plate (SS) with tag & service inscription, relay base mounting rail/channel, nuts & bolts, etc. shall be supplied. In each cabinet, a DC Voltmeter shall be provided to check the Field Interrogation voltage.

H. CONTROL VALVE, FITTINGS AND ACCESSORIES

1. Control Valve

01. Pipe material	:	Contractor to furnish
02. Pipe size	:	Contractor to furnish
03. Pipe thickness	:	Contractor to furnish
04. Fluid	:	Contractor to furnish
05. Flow	:	As per application
06. Inlet pressure	:	As per application
07. Outlet pressure	:	As per application
08. Inlet Temperature	:	As per application
09. Specific Gravity	:	As per application
10. Viscosity	:	As per application
11. C _v Calculated	:	As per application
12. C _v Selected	:	As per application
13. % opening	:	As per application
14. Vapor pressure @ inlet temperature	:	As per application
15. Noise	:	As per application
16. Valve type	:	Globe
17. Valve model	:	Contractor to furnish
18. Body size	:	Contractor to furnish
19. Port size	:	Contractor to furnish
20. Body material / Rating	:	Contractor to furnish
21. End Connection	:	Contractor to furnish
22. Bonnet type	:	Contractor to furnish
23. Packing Material	:	Contractor to furnish
24. Trim material / type	:	Contractor to furnish

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

25.	Characteristics	:	Contractor to furnish
26.	Plug / Ball / Disk material	:	Contractor to furnish
27.	Seat / Stem material	:	Contractor to furnish
28.	Actuator type	:	Pneumatic Diaphragm
29.	Actuator model	:	Contractor to furnish
30.	Supply air / Power fail condition	:	FO / FC / FL
31.	Positioner type	:	E / P Positioner (Digital smart position)
32.	Opening / Closing time	:	Contractor to furnish
33.	Actuator bench range	:	Contractor to furnish
34.	Position transmitter	:	To be provided
35.	Limit switch	:	To be provided
36.	Air lock relay	:	To be provided
37.	Handwheel	:	To be provided
38.	Air set	:	To be provided
39.	Solenoid valve	:	To be provided
40.	Solenoid valve model	:	Contractor to furnish
41.	Local control station	:	To be provided
42.	Junction box	:	To be provided
43.	ANSI / FCI leakage class	:	Class IV
44.	IBR certificate	:	To be provided

2. Solenoid Valve

01.	Operating Principle	:	Electromagnetic (noiseless) Latch / release coil shall be used in the required application where the safety is to be ensured.
02.	Coil voltage rating	:	240 V AC / 110V AC / 24 V DC / 48 V DC / 220 V DC (As required).
03.	Ways	:	3 ways (normally open + normally closed) [general], other depending on requirement
04.	Port size	:	1/2" NPT / As per site requirement
05.	Body	:	SS Bar Stock
06.	Trim	:	AISI SS-316
07.	Manual Operator	:	In built
08.	Duty	:	Suitable for continuous energization
09.	Sealing	:	Airtight and leak proof
10.	Ambient Temperature	:	0 - 50 ° C
11.	Fluid Temperature	:	0-150 ° C or as per application
12.	Coil Enclosure	:	Stainless Steel
13.	Insulation	:	Class-H
14.	Coil Casing	:	IP-65 (Explosion proof for NEC Class-1, Division-1 area)
15.	Mounting	:	On pipe or on panel
16.	Cable Connection	:	3/4" ET Compression gland
17.	Accessories	:	Mounting brackets, nuts and bolts
18.	Special feature	:	i) Temperature operated fuse at Explosion proof enclosure. ii) Solenoid valve directly integral to actuator body shall have NAMOOR interface.
19.	Pressure Rating	:	As per application

3. Power Cylinders (Pneumatic)

01.	Mounting Type	:	a) Fixed position mounting (End mounting). b) Trunnion mounting
02.	Control Signal	:	0.2 to 1 Kg/Sq. cm. from I/P converter for modulating purposes. 24V/48VDC operated solenoid valve operating on pneumatic line. The

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- Pilot solenoid will have separate coils for open closing purpose.
03. Supply Air : 0-7 Kg / Cm².
04. Selection : Based upon thrust / torque, stroke length, angular movement, full-scale travel time, repeatability, space factor etc. Provision for air-to-open and air-to-close operation.
05. Casing : IP-65.
06. Accessories (as required) :
- a) Air lock relay
 - b) Hand wheel.
 - c) Air filter regulator with gauge.
 - d) Volume Booster.
 - e) Limit Switches.
 - f) Positioner with Input, Output and supply pressure gauges.
 - g) Pilot Solenoid Valve (Double Coil type)
 - h) Position Transmitter (4-20 mA DC linear output).
07. Fail-safe operation : Stay put, open or close position on pneumatic / electrical power supply failure as per process safety criteria.
08. Repeatability : Better than 0.5% of full travel.
09. Hysteresis : Less than $\pm 1\%$ of full travel.
- 4. Air Filter Regulator**
01. Filter Element : Sintered Bronze
02. Filter Size : 5 microns
03. Input Air : 10.0 Kg/Sq. cm (maximum)
04. Output : Adjustable from 0-2.0 Kg / Sq. cm or 0-7.0 Kg / Sq. cm (continuous) as applicable.
05. Effect of Supply : Maximum 0.02 Kg/Sq. cm for a change pressure variation in supply pressure of 4 Kg/Sq. cm
06. Bowl Material : Metallic cover around high temperature area/clear transparent polycarbonate with metallic cover for ordinary applications.
07. Accessories : 2" dial size output pressure gauge
08. Desirable Feature : No perceptible drop of pressure on opening the drain port.
- 5. Seamless Stainless Steel Tube**
01. Reference : ASTM A-312 TP 304
02. Size : 12 mm OD /10 mm ID
03. Materials : AISI 304 SS
04. Type : Cold drawn fully solution annealed, pickled passivated, de-scaled, hydraulically cleaned
05. Properties : The tube shall be suitable for bending and capable of being flared by hardened and tapered steel pin. The expanded tube shall show no cracking or rupture.
06. Test Pressure : Burst pressure 400 Kg/Sq. Cm
07. Tolerance : ± 0.13 mm for outside diameter
 $\pm 15\%$ for wall thickness
08. Test : Flare, Hardness, Ball and Bubble Test
- 6. Stainless Steel Tube Fittings**
01. Reference : ASTM-A-182
02. Type : Double Compression

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

03.	Material	:	316 Stainless Steel Forgings (as per process hook-up drawing)
04.	Ferrule	:	316 Stainless Steel
05.	Pressure Rating	:	250 Kg/Sq. cm
06.	Temperature Rating	:	-100 to +400 °C
07.	Type of Fittings	:	Male / Female connector, elbow, cross, equal tee, straight connector, bulkhead union, ferrule etc. as required to suit installation.
08.	Size	:	To suit SS tubing and end connection

7. G.I. Pipe

01.	Reference	:	IS-1239, Part-I
02.	Type	:	Medium grade, threaded at both ends protected with end caps
03.	Material	:	Continuous ERW galvanized MS pipe
04.	General	:	Pipe shall be galvanized both inside and outside
05.	Size	:	1/2", 3/4", 1" as required

8. G.I. Pipe Fittings

01.	Reference	:	IS-1239, Part-II for material, dimension, thread etc.
02.	Style	:	Threaded
03.	Type of Fittings	:	Equal tee, three piece union, unequal tee, straight socket, 90 Deg. elbow, reducing socket cap. etc. to suit installation.
04.	Size	:	1/2", 3/4", 1" as required

9. C.S. Pipe

01.	Reference	:	ASTM-A 106 Gr. B / Gr. C for Material ANSI B36.10 for dimensions
02.	Material	:	Cold drawn seamless black C.S.
03.	Type	:	Plain ends
04.	Schedule	:	160, 80 as required
05.	Size	:	15 NB, 25 NB etc.

10. C.S. Pipe fittings

01.	Reference	:	ASTM-A 105 for Material ANSI B 16.11 for Dimensions
02.	Material	:	Carbon Steel
03.	Type	:	Socket Weld / Screwed
04.	Ratings	:	3000 lbs / 6000 lbs / 9000 lbs
05.	Size	:	As required to suit relevant Process Hook-up drawings(1/2", 1").
06.	Type of Fittings	:	Reducing coupling, male-female reducer, straight coupling, equal tee, three piece union, elbow, cap etc.

11. A.S. Pipe

01.	Reference	:	ASTM-A 335 Gr. P22 for Material ANSI B36.10 for dimensions
02.	Material	:	Cold drawn seamless A.S.
03.	Type	:	Plain ends
04.	Schedule	:	XXS,80,160 as required
05.	Size	:	15 NB, 25 NB etc.

12. A.S. Pipe Fittings

01.	Reference	:	ASTM-A 182 F22 for Material ANSI B 16.11 for Dimensions
02.	Material	:	Alloy Steel

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- | | | |
|----------------------|---|--|
| 03. Type | : | Socket Weld / Screwed |
| 04. Ratings | : | 3000 lbs / 6000 lbs / 9000 lbs |
| 05. Size | : | 1/2" , 1". |
| 06. Type of Fittings | : | Reducing coupling, male-female reducer, straight coupling, equal tee, three piece union, elbow, cap etc. |

13. C.S. Globe Valve

- | | | |
|-------------------------------------|---|---|
| 01. Reference | : | ASTM A-105 for material |
| 02. Type | : | Globe |
| 03. Pattern | : | Straight through |
| 04. Construction | : | Forged Body Cadmium Plated |
| 05. End Connection | : | Socket Weld / Screwed |
| 06. Proof Pressure | : | 400 Kg/Cm ² |
| 07. Material | : | Body - CS or equivalent (Cadmium plated)
Stem - Hardened Steel
Plug - AISI 316 SS |
| 08. Packing | : | Teflon Bush |
| 09. Bonnet | : | Inside screw, same as body material. |
| 10. Bar Handle | : | Aluminum |
| 11. Basic Specification and Testing | : | As per ANSI B 16.34 |
| 12. Accessories | : | Plugs for all ports |

14. S.S. Globe Valve

- | | | |
|-------------------------------------|---|---|
| 01. Reference | : | ASTM A-105 for material |
| 02. Type | : | Globe |
| 03. Pattern | : | Straight through |
| 04. Construction | : | Forged Body |
| 05. End Connection | : | Screwed / Double Compression Fitted |
| 06. Proof Pressure | : | 400 Kg/Cm ² |
| 07. Material | : | Body - SS 316
Stem - 410SS
Plug - AISI 316 SS |
| 08. Packing | : | Teflon Bush |
| 09. Bonnet | : | Inside screw, same as body material. |
| 10. Bar Handle | : | Aluminum |
| 11. Basic Specification and Testing | : | As per ANSI B 16.34 |
| 12. Accessories | : | Plugs for all ports |

15. Condensate Pot

Fabricated from 4" Sch.160, Alloy Steel pipe with 3 nos. 1/2" SW connection, one in the side and other two are on top and bottom. Condensate pot shall be used for steam services.

16. Instrument Manifolds**Technical Particulars**

- | | | |
|------------------|---|---|
| 01. Type | : | a) Two valve manifold
b) Five valve manifold |
| 02. Mounting | : | Remote 2" Pipe Mounting |
| 03. Construction | : | Single block (bar stock) |
| 04. Material | : | Forged body and bonnet AISI 316 stainless steel |
| 05. Ports | : | 1/2 " NPT (F) |
| 06. Rating | : | 420 Kg/Sq. cm at ambient |

- | | | |
|---------------------------|---|---|
| 07. Operating Temperature | : | (-) 30 to (+) 170 Deg C |
| 08. Packing | : | PTFE Wafer |
| 09. Seat & Stem | : | AISI 316 SS |
| 10. Plug | : | AISI 316 SS free to turn on stem / 17-4 PH |
| 11. Handle Bar | : | AISI 316 SS |
| 12. Connection | : | Straight |
| 13. Accessories | : | i) Plugs for all ports
ii) Mounting Bracket, bolts, nuts |

17. Air Header**TECHNICAL PARTICULARS**

		<u>For Panel</u>	<u>For Field</u>
01. Material of Construction	:	Cast Brass	Cast Brass
02. Inlet Connection	:	2" NPT (M)	1" NPT (M)
03. Header Take-off	:	Brazed Brass Port	Brazed Brass Port
04. Take off connection	:	1 / 2" NPT (M)	1/ 2" NPT (M)
05. Take-off Valves	:	Brass Valves on Nipple	Brass Valves on Nipple
06. Tube Take-off	:	Tube Adapter on Valve	Tube Adapter on Valve
07. Drain	:	Drain valve at Lowest Point	Brass Drain Valve

18. S.S. Pipe

- | | | |
|---------------|---|------------------------------|
| 01. Reference | : | ASTM-A 312 TP316 ANSI B36.10 |
| 02. Material | : | SS 316 cold drawn seamless |
| 03. Type | : | Plain ends |
| 04. Schedule | : | 80S,40S as required |
| 05. Size | : | 15 NB, 25 NB etc. |

9. Conductor Identification : See "Cable Details" as below
10. Armour : Galvanised steel wire/strip to IS:3975
11. Multiple pair identification : Each pair numbered every 250 mm

Power Cylinders (Pneumatic)

- Mounting Type : a) Fixed position mounting (End mounting).
: b) Trunnion mounting
- Control Signal : 0.2 to 1 Kg/Sq. cm. from I/P converter for modulating purposes. 24V/48VDC operated solenoid valve operating on pneumatic line. The Pilot solenoid will have separate coils for open closing purpose.
- Supply Air : 0-7 Kg / Cm².
Selection : Based upon thrust / torque, stroke length, angular movement, full-scale travel time, repeatability, space factor etc. Provision for air-to-open and air-to-close operation.
- Casing : IP-65.
- Accessories (as required) : a) Air lock relay
b) Hand wheel.
c) Air filter regulator with gauge.
d) Volume Booster.
e) Limit Switches.
f) Positioner with Input, Output and supply pressure gauges.
g) Pilot Solenoid Valve (Double Coil type)
h) Position Transmitter (4-20 mA DC linear output, LVDT or non contact type).
- Fail-safe operation : Stay put, open or close position on pneumatic / electrical power supply failure as per process safety criteria.
- Repeatability : Better than 0.5% of full travel.
Hysteresis : Less than 0.1% of full travel

J. Miscellaneous Instruments

01. Nucleonic Type Density Meter (For Ash Handling Plant):-

- Type : Nuclear type radiation
- Application : Abrasive Slurries & Corrosive Chemicals
- Accuracy : < 1% of Span
- Orientation : As per requirement.
- System Type : Radiation Source & Scintillation Detector
- Meter Material : SS 316L/ Aluminum with PVC coating
- Connection material : SS 316L
- Compensation : Temp. Compensation required
- Type (Transmitter) : SMART, 2 Wire HART based
- Operating Principle : As the density increase, the lower the radiation field at detector and vice versa.
- Output : With photomultiplier, 4-20 mA, DC
- Electrical Connection : 1/2" NPT
- Enclosure Class : IP 66
- Local Display : Provided

Accessories : Radiation Survey Meter and all erection/installation hardware

02. Non - Nucleonic (Vibration) Type Density Meter (For DM & AHP Plant):-

Application : Liquid Density measurement

Detector

1. Orientation : As per requirement.

2. Case Material : SS 316/ Cast Aluminum alloy

3. Wetted part material : SS 316

4. Operating Principle : Vibration Density measurement

Convertor

1. Output : 4-20 mA DC isolated.

2. Electrical Connection : ½" NPT

3. Enclosure Class : IP 65

4. Local Display : Digital 5 digit, density display with temp. compensation.

5. Accuracy : +/- 1%

6. Response time : < 1 minute.

7. Power Supply : 240 V AC, +/- 10%, 50 Hz. From UPS

03. Pull Chord switch

Type : Addressable Type

Body : Cast Iron

Contact rating : Continuous 10 Amp, Breaking 2 Amp. (240 V AC)

No. of contact : 2 NO + 2 NC

Reset facility : Manual Reset

Type of enclosure : Die Cast Aluminum

Degree of protection : Explosion proof for NEC class 1, Division 1 area

Local trip indication : Required

Accessories : 1. Canopy over lever of pull Cord switch.
2. Linking of switchesthrough a single cable for each section.
3. Each pull cord switch shall be provided with red LED indication lamp for prominent visible indication of tripping.
4. "One number indicator panel which shall display the exact number of safety switches (pull cord and belt sway switches) operated in a loop of conveyor. It shall also monitor the condition of field cable connecting the switches in series & generate signal if field cable is found broken or short. The indicator panel shall display the operated switch number. The same indication shall also be available in CHP operator station.

04. Belt Sway Switch

Type : Addressable Type

Body : Cast Iron

Contact rating : Continuous 10 Amp, Breaking 2 Amp. (240 V AC)

No. of contact : 2 NO + 2 NC

Reset facility : Auto Reset

Type of enclosure : Die Cast Aluminum

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

Degree of protection : Explosion proof for NEC class 1, Division 1 area
Accessories : 1. Canopy
2. The belt sway switches shall be provided with a common bridging push button which may be kept pressed to bypass the limit switch before restarting the conveyor.

05. Zero Speed Switch

Type : Microprocessor Based
Body : Cast Iron
Contact rating : Continuous 10 Amp. (240 V AC)
No. of contact : 2 NO + 2 NC
Reset facility : Manual Reset
Type of enclosure : Die Cast Aluminum
Degree of protection : Explosion proof for NEC class 1, Division 1 area
Accuracy : +/- 5%
Repeatability : +/- 1%
Differential : +/- 5%
Accessories : Canopy

06. Chute Block Switch

Type : RF Based
Sensor Material : SS 316
Mounting : Flanged
Insulation Material : PTFE
Contacts : 2 NO + 2 NC
Type of enclosure : Die Cast Aluminum
Degree of protection : IP 66
Electrical Connection : ¾ " ET
Repeatability : 0.05%
Local Indication : To be provided
Accessories : a) Neoprene Gasket and Stud Bolt
b) SS Tag plate, Nickel plated brass double Compression type cable gland

07. Dew Point meter

Type : 2 Wire Loop Powered Dew point Transmitter
Overall Range : -60°C to +20°C Dew point
Accuracy : ± 2°C Dew point
Material : SS316 (wetted parts)
Features : AUTOMATIC CALIBRATION
• Can be Configured for Linear 4-20mA signal in °C & °F Dew point, ppm(v), ppb(v), g/m3
• Temperature Compensation
• Failure Diagnostics
• Long Term Stability
• Fast Response
• IP 66 / NEMA4X Protection
• Supplied with Calibration Certificate Traceable to National & International Humidity Standards
• Sensor protection with sintered filter
• Local LCD Display for Dew Point

08. Junction Boxes

Type : Flame proof/weather proof
Enclosure : IP-65/Explosion/Flame Proof as per area classification.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Material	:	FRP with protective Coating
Cable entry	:	Bottom or Side
Cable glands	:	Double compression type – Nickel plated brass with PVC hoods.
Mounting	:	Indoor/Outdoor
No. of terminals	:	As required with standardization with 20% spare of each size & type.
Terminals	:	Phoenix/Wago (screw less cage clamp type spring loaded)
Grounding	:	Two terminals for body and shield ground
Door	:	Hinged, lockable type.

Suitable mounting clamps and other accessories shall be in scope of bidder.

The brackets, bolts, nuts, screws, glands, lugs required for erection shall be of brass, included in bidder scope of supply. High voltage & insulation resistance test shall also be conducted.

M6 Ni plated Brass earthing stud shall be provided (external 2 nos. internal 1 no.)
 Gasket (Normal)- Neoprene thickness 6.0 mm

09. Recorders (Chartless)

Type	:	Micro-processor based, Digital TFT display type
No. of Channels	:	Forty Eight (48) point).

- 6 Nos. of recorders** shall be supplied for BTG and the parameters shall be decided during detailed Engineering. Quantities of recorders for BOP packages shall be decided during detailed Engineering. (Simultaneous parameter display preferred)

Input Signal	:	Fully configurable multi range (Programmable) universal (input)
Recording method	:	Continuous with different colour, for each channel
Display colour	:	Selectable from 30 Colours
Bar graph facility	:	To be provided
Digital indication	:	To be provided
Accuracy	:	+/- 0.1 % for reading for DCV Input And 0.1 Deg for TC/RTD input
Programmability	:	Front key board
Data Storage	:	hard disk/ Flash Memory
Data Retrieval	:	Compact 4 GB flash Memory card and USB port with 8 GB USB drive.
Scan rate	:	< 20 m second for individual channel.

Selection of scan time for individual channel is required.

Power Supply	:	240 VAC 1 Phase UPS
Ambient Temperature	:	0-50 Degrees
Mounting	:	Front panel mounted weather & Dust proof IP 65
Application software	:	Yes, To be provided
Internal Memory	:	400 MB or more
Screen	:	> 10.5" colour LCD TFT
Resolution	:	> 640 X 480 Pixels
Type of Display	:	i) Trends
ii) Bar Graph		
iii) Digital display/ values		
Event Sampling	:	1/2/5/10/30/60/120 sec.
Zoom & Scroll Facility	:	Required

VOLUME: II B
**TECHNICAL SPECIFICATIONS FOR
 EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
 SPECIFICATION NO.: PE-TS-435-164-A001**

OWS and printer connectivity port	:	Required
	:	Necessary software shall be supplied for uploading the data.
Communication	:	MODBUS/PROFIBUS ports connectivity between recorder and third party systems

10. Digital Indicator

Type	:	Programmable electronic digital indicator with floating point decimal.
Input	:	4-20 mA DC/1-5V DC/RTD/T/C.
Number of inputs	:	One
Range	:	As per requirement/adjustable by end user through key pad available on the indicator.
Number of digits	:	Four plus sign
Digit height	:	20 mm or larger
Display	:	Fluorescent red
Input over range/open	:	All digits to flash sensor (T/C)
Input hold time	:	0.7 seconds max.
Accuracy	:	+0.05% of span
Power supply	:	240V AC, 50Hz
Mounting	:	Flush panel, compatible for mounting on mosaic grid panel
Size	:	96x48 mm
Other Particular	:	Indicator receiving thermocouple signal shall have automatic cold junction compensation.
	:	Retransmission Output 4-20 mA isolated required.
	:	24 V DC inbuilt power supply
	:	Alarm contact with 2 NO/NC contact (rating 5A/230 V AC)

11. Receiver Indicators (Single/Dual Channel)

Type	:	Analogue indicator
Input Signal	:	Universal input (T/C, RTD, 4-20 mA, Voltage)
Scale	:	Range fully configurable and programmable
Measurement Accuracy	:	+ 0.2% of span + 1 count
Resolution	:	0.5% Span
Dead band	:	+ 0.2% of span
Repeatability	:	0.2% of span
Full scale response time	:	Less than two(2)seconds
Power Supply	:	240V AC, 50 Hz
Connection	:	Plug in type
Accessories	:	Mounting Bracket for Bins
Other Particulars	:	Indicator receiving thermocouple Signal shall have automatic cold junction compensation.
	:	Retransmission Output 4-20 mA isolated required.

12. Temperature Scanner

Type	:	Microprocessor based Electronic Digital Scanner.
No. of channels	:	16/24 (as per the application)
Input	:	RTD /Thermocouple/4-20mA
Accuracy	:	+ 0.1 of FS + 1 count
Number of digits	:	4 digit (7 segment display with Engg. Units)
Digit height	:	12 mm or larger

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

MOTORIZED VALVE ACTUATOR DETAILS

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

MOTORISED VALVE ACTUATORS'
SPECIFICATION & DATA SHEET

|

SECTION-3.17: ELECTRICAL ACTUATORS

1.0.0 INTENT OF SPECIFICATION

This section covers the requirements of motor operated electrical actuators.

2.0.0 CODES AND STANDARDS

The equipment to be furnished under this specification shall be in accordance with the applicable section of the latest edition (including amendments) of the applicable Indian Standards (IS), IEC publications and other codes except where modified and /or supplemented by this specification.

3.0.0 TECHNICAL REQUIREMENTS

3.1.0 Electric actuators shall be provided as specified in Mechanical and C&I section. It shall be equipped with 3 phase induction motor, rated for S2-15 minutes duty for ON/OFF valve and intermittent duty for inching duty

3.2.0 Motor shall be class F insulated with temperature rise limited to class B. Motor shall be of class H insulation with temperature limited to class B used for high pressure and high temperature valves.

3.3.0 Motor shall be surface cooled designed for enclosure protection class of IP 67. Motor shall be suitable for starting direct on-line.

3.4.0 For installation in potentially hazardous areas, the actuators shall have suitable explosion proof / flame proof type enclosure.

3.5.0 Actuators shall be suitable for operation at an ambient temperature of 50 degree C and relative humidity of 95%.

3.6.0 Maximum continuous motor rating shall be atleast 10% above the maximum load derived of the driven equipment under entire operating range including voltage & frequency variation.

3.7.0 Motors shall be capable of operating under following supply variations without exceeding its guaranteed temperature limits.

- Frequency variation : (+) 3% and (-) 5% of 50 Hz
- Voltage variation for LT motors : (±) 10% of 415 V
- Combined variation of voltage and frequency: 10% (absolute sum)

3.8.0 All actuators shall be of integral type. Duty cycle of actuators shall suit the system requirement. The actuators shall be capable of giving the required torque at the output shaft. The actuators shall be designed to take the full thrust.

3.9.0 Electrical Actuators of Inching type position transmitters of non contact type shall be interfaced to DCS.

3.10.0 Actuators shall be of totally enclosed weather proof and dust proof construction with NEMA-6/IP 65 enclosure and shall be suitable for outdoor application without the necessity for a canopy. The actuator shall be suitable for mounting directly on the valve. The actuator shall be capable of giving the required torque, rpm and thrust without the help of any spur gear arrangement. The actuator shall be suitable for mounting in any position. **Actuators shall be provided with integral starters.**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

- 3.11.0 The actuator shall be complete with motor, reduction gears, change gears, terminal compartment, switch compartment with limit switches and torque switches, local position indicator, position transmitter for remote position indicator, thermistor, space heaters, cable glands, mechanical position indicator, hand wheel for manual operation, valve attachment etc.
- 3.12.0 Each actuator shall have a hand wheel fitted on it for emergency operation. The hand wheel shall be designed such that it is declutched automatically when the power supply to the motor is restored. The material of the hand wheel shall be either malleable iron or steel. The hand wheel shall have adequate clearance from housing for each gripping and operation. Actuators offered shall be with self-locking worm.
- 3.13.0 Two number adjustable torque switches (one for open and one for close) each with 2 NO and 2 NC potential free contacts shall be provided. It is required to have calibration for the torque switches so that the switches can be easily set to any value desired.
- 3.14.0 Two numbers of position limit switches (one for open and one for close) each with 2 NO and 2 NC potential free contacts shall be provided. Two auxiliary limit switches (one for open and one for close) with 2 NO and 2 NC potential free contacts shall also be provided. The limit switches shall be of independently adjustable type. Limit switches and actuating mechanism shall be rust proof suitable for damp atmospheres. Limit switch compartment shall be weather proof and spacious enough for easy setting. The limit switches shall be suitable for the following ratings, both 240 Volts AC, 10 A and 220 V DC, 0.5 Amps.
- 3.15.0 Each actuator shall have a space heater in the limit switch compartment suitable for 240 V AC 50 Hz single phase supply.
- 3.16.0 The wiring from the limit switches, torque switches etc. shall be brought out in a separate terminal box of adequate size, so as to easily terminate the control cables.
- 3.17.0 Actuators shall be supplied with integral starter which shall have sophisticated electronic controls with field programming feature. It shall be designed for remote control from DCS/Respective control system. Required interposing relays for receiving open/close/stop command from DCS/Respective control system shall be provided. Potential free contacts and transducers shall be provided to provide status indication at remote DCS/Respective control system..
- 3.18.0 A three position selector switch (marked as LOCAL-OFF-REMOTE) and push buttons OPEN-STOP-CLOSE (for local operation) with indication lamps for running OPEN and running CLOSE shall be provided.
- 3.19.0 The Remote command signal (OPEN-STOP-CLOSE) from DCS/Respective control system/Control panel shall be isolated from control electronics through opto-isolator.
- 3.20.0 The following individual sStatus annunciation LED's and fault annunciation LED's shall be provided locally (Integral to actuator) to annunciate the following for easy local monitoring.
- Actuator in local mode
 - Actuator in remote mode
 - Actuator running in OPEN direction
 - Actuator running in CLOSE direction
 - Actuator in inching mode.
 - Actuator in self-retaining mode
 - Limit switch OPEN trip
 - Limit switch CLOSE trip
 - Control voltage availability
- 3.21.0 The following individual fault annunciation LED's (Colour-Red) shall be provided locally. (Integral to Actuator)

**TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

- Torque switch OPEN
- Torque switch CLOSE
- Thermo switch trip
- Electronic overload relay trip
- Motor single phasing
- Common fault (Inclusive of any one or combination of above fault)

3.22.0 View port shall be provided on integral starter unit to monitor the above status annunciation and fault annunciation.

3.23.0 Electronic Overload relay shall be provided to trip actuator in case of overload. Plug in connections/design shall be provided between:-

- Integral starter unit and basic actuator
- Between external customer connections and actuator.

3.24.0 OPEN-CLOSE indication /LED shall be provided for indication of full open/close position.

3.25.0 Automatic phase correction facility and potential free contact for annunciation of power failure shall be provided.

3.26.0 The following individual potential free relay contacts shall be provided in the actuator for remote annunciation to facilitate continuous monitoring of the actuator.

- Actuator (valve) running in OPEN direction.
- Actuator (valve) running in CLOSE direction.
- Actuator in remote mode.
- Actuator in local mode.
- Actuator power switched off /single phasing.
- Torque switch trip, thermo switch trip and overload relay trip

4.0.0 TESTING AND INSPECTION

Equipment offered shall be of type tested and proven type. Routine tests shall be carried out for all the equipment as per applicable standards. Copies of certified reports of all tests carried out at the works shall be furnished.

The following minimum tests/ checks shall be conducted at site. Any other tests/ checks as per the manufacturer's recommendation shall also be carried out.

- Measurement of insulation resistance.
- Measurement of full load current.
- Test running of the motors.

5.0.0 DRAWINGS & DOCUMENTS

The following drawings and documents shall be submitted for approval during detail engineering stage.

- Integral starter details
- Technical particulars of actuator
- Wiring diagram
- General arrangement drawings
- Test reports
- Manufacturing quality plan
- Field quality plan



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:

VOLUME II B

SECTION D

REV. NO. 02

DATE: 22.07.2019

SHEET 1 OF

4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

GENERAL*	* PROJECT	2 X 660 MW UDANGUDI TPP	
	OFFER REFERENCE		
	* TAG NO. SERVICE		
	* DUTY	<input type="checkbox"/> ON / OFF <input type="checkbox"/> INCHING	
	* LINE SIZE (inlet/outlet): MATERIAL		
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY	
	* OPENING / CLOSING TIME		
	* WORKING PRESSURE		
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF -20 to 70 DEG C AND RELATIVE HUMIDITY OF 0-95% IN HOT HUMID AND TROPICAL ATMOSPHERE AND HIGHLY POLLUTED AT PLACES OF COAL DUST AND FLY DUST	
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY	
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY	
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY	
CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, WEATHER PROOF, DUST TIGHT SUITABLE FOR OUTDOOR USE WITHOUT CANOPY, NEMA6/IP:68	
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL	
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.	
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.	
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING SERVICE - 150 STARTS/HR MINIMUM.	
HANDWHEEL	* REQUIRED	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED <input type="checkbox"/> SIDE MOUNTED	
	*TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.		
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY	
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY	
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT-INCLUSIVE OF I.S. TOLERANCE	
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED (BIDDER TO CONFIRM) A: <input type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 B: <input type="checkbox"/> DRG. NO. 3-V-MISC-24550 R00 C: <input checked="" type="checkbox"/> DRG. NO. 3-V-MISC-24283 R00 D: <input type="checkbox"/> DRG. NO. 4-V-MISC-90271 R11 E: <input type="checkbox"/> For Thyristor based Integral starter, Bidder/Vendor to furnish wiring diagram	
	COLOUR SHADE	<input type="checkbox"/> BLUE (RAL 5012) <input checked="" type="checkbox"/> SIEMENS GRAY RAL 7030	
	PAINT TYPE (## Refer Notes)	<input type="checkbox"/> ENAMEL <input checked="" type="checkbox"/> EPOXY <input type="checkbox"/>	
	SHAFT RPM	BIDDER TO SPECIFY	
	OLR SET VALUE	BIDDER TO SPECIFY	
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY	
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY	
	@ PWR SUPP TO MTR / STARTER	415V +/- 10%, 3 Phase, 3 Wire 50HZ +/-5%	
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER <input type="checkbox"/> 230 V <input checked="" type="checkbox"/> 110 V	

FORM NO. PEM-6666-0



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:	
VOLUME II	B
SECTION D	
REV. NO. 02	DATE: 22.07.2019
SHEET 2 OF	4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

	@ ENCLOSURE CLASS OF MOTOR	<input type="checkbox"/> IP 68 <input type="checkbox"/> FLAME PROOF	
	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B	
	@ WINDING TEMP PROTECTION	<input checked="" type="checkbox"/> THERMOSTAT (3 Nos., 1 IN EACH PHASE) <input type="checkbox"/> -----	
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	<input checked="" type="checkbox"/> CONTACTORS(Reversing type) <input type="checkbox"/> THYRISTORS	
	TYPE	<input checked="" type="checkbox"/> CONVENTIONAL <input type="checkbox"/> SMART (NON-INTRUSIVE)	
	IF SMART		
	a) SERIAL LINK INTERFACE	<input type="checkbox"/> INTEGRAL <input type="checkbox"/> FIELD MOUNTED	
	b) SERIAL LINK PROTOCOL	<input type="checkbox"/> FOUNDATION FIELD-BUS <input type="checkbox"/> PROFI-BUS <input type="checkbox"/> DEVICE NET <input type="checkbox"/>	
	c) SERIAL LINK MEDIA	<input type="checkbox"/> TWISTED PAIR Cu-CBL <input type="checkbox"/> CO-AXIAL Cu-CBL <input type="checkbox"/> OFC	
	d) HAND HELD PROGRAMMER	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	e) TYPE OF HAND HELD PROGRAMMER	<input type="checkbox"/> BLUETOOTH <input type="checkbox"/> INFRARED <input type="checkbox"/>	
	f) MASTER STATION	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	g) MASTER STN INTRFACE WITH DCS	<input type="checkbox"/> MODBUS <input type="checkbox"/> TCP/IP	
	h) DETAILS OF SPECIAL CABLE	<input type="checkbox"/> ENCLOSED <input type="checkbox"/> NOT REQUIRED	
	STEP DOWN CONT. TRANSFORMER	<input checked="" type="checkbox"/> REQUIRED	
	OPEN-STOP-CLOSE PB(running open/close LED) THREE POSITION SELECTOR SWITCH	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INDICATING LAMPS	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	LOCAL-OFF- REMOTE S/S(THREE POSITION SELECTOR SWITCH)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
STATUS CONTACTS FOR MONITORING	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (MOTOR THERMOSTAT TRIP/O/L RELAY OPERATED, CONT. /POWER SUPPLY FAILED, S/S IN LOCAL/REMOTE/OFF MODE, TORQUE SWITCH OPEN/CLOSE CUT OFF/STOP PB OPTD.)		
INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	<input type="checkbox"/> INTERPOSING RELAY <input checked="" type="checkbox"/> OPTO COUPLER <input type="checkbox"/> EITHER	
	QUANTITY	<input checked="" type="checkbox"/> 2 NOs. <input type="checkbox"/> 3 NOs.	
	DRIVING VOLTAGE	<input checked="" type="checkbox"/> 20.5 – 24V DC <input type="checkbox"/> _____ V DC	
	DRIVING CURRENT	<input checked="" type="checkbox"/> 125mA MAX <input type="checkbox"/> _____ mA MAX	
	LOAD RESISTANCE	<input checked="" type="checkbox"/> > 192 ohms - <25 k ohms <input type="checkbox"/> > _____ ohms - < _____ ohms	
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos. / <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	10A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	<input checked="" type="checkbox"/> 2 Nos.	2 nos(adj) <input type="checkbox"/> 1 No. <input checked="" type="checkbox"/> 2Nos.
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	10A 240V AC AND 0.5A 220V DC	

FORM NO. PEM-6666-0



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:	
VOLUME II	B
SECTION D	
REV. NO. 02	DATE: 22.07.2019
SHEET 3 OF	4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty & other specific applications)	REQUIRED for regulating/inching duty only.	
	MFR & MODEL NO.	BIDDER TO SPECIFY	
	TYPE	<input type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) contactless inductive type	
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/>	
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA	
	ACCURACY	± 1% FS	
SPACE HEATER	@SPACE HEATER	REQUIRED	
	@ POWER SUPPLY (NON INTEGRAL)	240V AC, 1 PH., 50 Hz	
	@ POWER SUPPLY (INTEGRAL)	BIDDER TO SPECIFY	
	@ RATING		
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED	
	ENCL CLASS ACTUATOR/MOTOR T.B.	@ <input checked="" type="checkbox"/> IP 68 @ <input type="checkbox"/> NEMA6	
	@ EARTHING TERMINAL	REQUIRED	
	PLUG & SOCKET(9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED <input checked="" type="checkbox"/> 2 NOS. <input type="checkbox"/>	
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:-----	
	@ SPACE HEATER CABLE GLAND	SIZE:-----	
	OTHER CONTROL CABLE GLANDS-1	<input type="checkbox"/> 1No. for BFV of CW PUMP(Cable size 2Px1.5mm2)	
	OTHER CONTROL CABLE GLANDS-2	1 no suitable for 8P X 0.5 sq mm Additional 1 no suitable for 2P X 0.5 sq mm(inching duty only)	

FORM NO. PEM-6666-0



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:	
VOLUME II	B
SECTION D	
REV. NO. 02	DATE: 22.07.2019
SHEET 4 OF	4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.
---------------	---------------------------------------	-------------------	-----------



NOTES:

1. **SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
 2. **CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH: IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
 3. TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
 4. CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED.
 5. THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
 6. THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
 7. THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.
- \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE.**
- ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS.**
8. IT SHOULD BE POSSIBLE TO OPERATE THE ACTUATOR LOCALLY. LOCKABLE LOCAL/REMOTE SELECTION SHALL BE PROVIDED ON THE ACTUATOR.
 9. POSITION INDICATOR SHALL BE PROVIDED FOR 0 TO 100 % TRAVEL
 10. WIRING SHALL BE SUITABLE VOLTAGE GRADE COPPER WIRE 1.5 SQ. MM.
 11. THE MOTOR SHALL BE CAPABLE OF STARTING AT 85 PERCENT OF RATED VOLTAGE AND RUNNING AT 80 PERCENT OF RATED VOLTAGE AT RATED TORQUE AND 85 PERCENT RATED VOLTAGE AT 33 PERCENT EXCESS RATED TORQUE FOR A PERIOD OF 5 MINUTES EACH.
 12. THE ACTUATORS SHALL BE DESIGNED TO BE SELF-LOCKING UPON LOSS OF POWER. MOTOR SHALL BE DESIGNED TO CLOSE IN 30 SECS. FROM FULL OPEN POSITION AND SHALL HAVE ADEQUATE CAPACITY TO OPEN AND CLOSE UNDER FULL UNBALANCED DESIGN PRESSURE.
 13. THE INTEGRAL STARTER WHICH SHALL HAVE SOPHISTICATED ELECTRONIC CONTROLS WITH FIELD PROGRAMMING FEATURE. IT SHALL BE DESIGNED FOR REMOTE CONTROL FROM DCS/RESPECTIVE CONTROL SYSTEM. REQUIRED INTERPOSING RELAYS FOR RECEIVING OPEN/CLOSE/STOP COMMAND FROM DCS/RESPECTIVE CONTROL SYSTEM SHALL BE PROVIDED. POTENTIAL FREE CONTACTS AND TRANSDUCERS SHALL BE PROVIDED TO PROVIDE STATUS INDICATION AT REMOTE DCS/RESPECTIVE CONTROL SYSTEM.
 14. THE REMOTE COMMAND SIGNAL (OPEN-STOP-CLOSE) FROM DCS/RESPECTIVE CONTROL SYSTEM/CONTROL PANEL SHALL BE ISOLATED FROM CONTROL ELECTRONICS THROUGH OPTO-ISOLATOR.
 15. THE FOLLOWING INDIVIDUAL STATUS ANNUNCIATION LED'S (COLOUR-GREEN) SHALL BE PROVIDED LOCALLY (INTEGRAL TO ACTUATOR) TO ANNUNCIATE THE FOLLOWING FOR EASY LOCAL MONITORING.
 ACTUATOR IN LOCAL MODE
 ACTUATOR IN REMOTE MODE
 ACTUATOR RUNNING IN OPEN DIRECTION
 ACTUATOR RUNNING IN CLOSE DIRECTION
 ACTUATOR IN INCHING MODE.
 ACTUATOR IN SELF-RETAINING MODE
 LIMIT SWITCH OPEN TRIP
 LIMIT SWITCH CLOSE TRIP
 CONTROL VOLTAGE AVAILABILITY
 16. AUTOMATIC PHASE CORRECTION FACILITY AND POTENTIAL FREE CONTACT FOR ANNUNCIATION OF POWER FAILURE SHALL BE PROVIDED.

NOTES* = TO BE FILLED BY MPL (LEAD AGENCY). @= TO BE FILLED BY ES

ALL DIMENSIONS ARE IN MILLIMETRES. FOR TOLERANCES OF UNTOLERANCED DIMENSIONS DURING MANUFACTURE REFER RELEVANT QCP / QP.

3-V-MISC-24283
DRAWING NO.

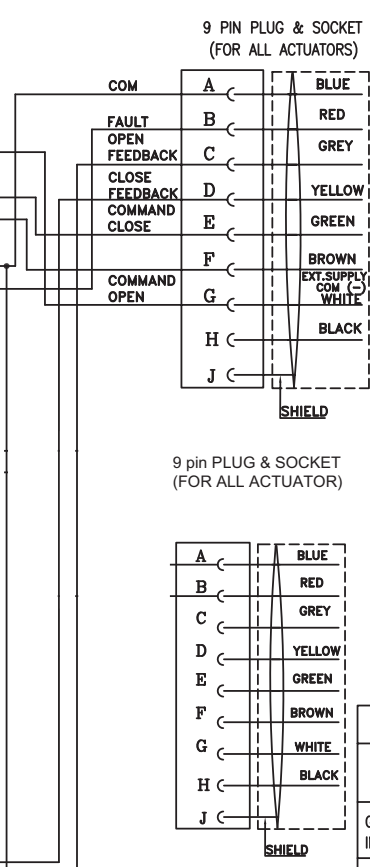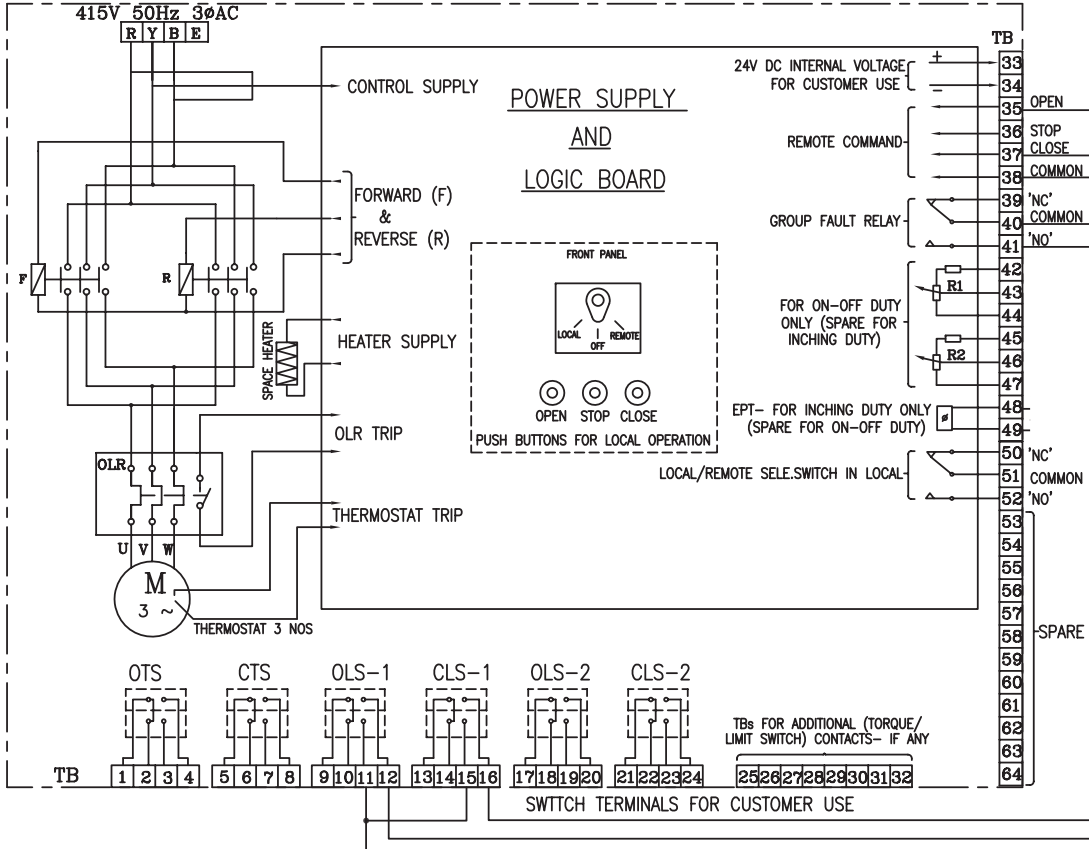

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL
OLS-1	9-10	---
	11-12	---
CLS-1	13-14	---
	15-16	---
OLS-2	17-18	---
	19-20	---
CLS-2	21-22	---
	23-24	---
SWITCH	TERMINAL NO.	FULL OPEN
		INTERMEDIATE
		FULL CLOSE
		VALVE POSITION

--- INDICATES CONTACT CLOSED
 - - - - - INDICATES CONTACT OPEN
 CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#

- CLS NOT TO BE CONNECTED IN TRIP CIRCUIT
 * - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)

- NOTE:-
- ALL TORQUE AND LIMIT SWITCHES (OTS,CTS,OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
 ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
 - CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
 - OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
 - OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
 - CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
 - EPT - ELECTRONIC POSITION TRANSMITTER (CONTACTLESS TYPE, FOR INCHING DUTY)
 - R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
 - FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
 - M - MOTOR 3φ 415V 50 Hz AC SUPPLY
 - TORQUE SWITCH BYPASS WITH LIMITSWITCH BOTH ON OPEN & CLOSE DIRECTION TO BE DONE INTERNALLY.

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS
 2 X 800 MW UPPUR TPP
 (DRAWN FOR INTERMEDIATE POSITION OF VALVES)

	BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT. TIRUCHIRAPALLI-620014.	DRN N.P.ESWAR	NAME D.DINAKARAN	SIGN N.P	DATE 17.03.05	NO.OF VAR.
DEPT VL	SCALE NTS	WEIGHT (KG).	REFERENCE INFORMATIONS			NO.OF TRIMS
CODE			CARD CODE	DRAWING NO.		REV
TITLE WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER WITH PLUG & SOCKET			U 01	3-V-MISC-24283		0

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:


INSTRUMENT HOOK UP DIAGRAM

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

INSTRUMENT INSTALLATION DRAWING
& STUB DETAILS

|

NOTES :-

1. IMPULSE PIPES SHALL BE OF SEAMLESS AND ANNEALED CONFORMING TO ANSI B36.10 IN LINE WITH THE MAIN PIPE MATERIAL.
2. PIPE FITTINGS SHALL BE OF FORGED MATERIAL CONFORMING TO ANSI B16.11-1991.
3. SNUBBER SHALL BE PROVIDED FOR PUMP DISCHARGE PRESS MEASUREMENTS.
4. IN CASE OF STEAM SERVICE SYPHON SHALL BE MADE BY BENDING THE TUBE OR PIPE.
5. VALVE MANIFOLDS & SNUBBER SHALL BE OF FORGED SS-316.
6. FOR SEA WATER APPLICATION SS316L FITTINGS TO BE PROVIDED.
7. 25NB x 15NB WELDED REDUCER SHALL BE USED FOR ROOT VALVE OF 25NB SIZE.
8. ROOT VALVES SHALL BE AS FOLLOWS:
 - i) FOR PRESS <40 ATA & TEMP <425 DEG C, ONE(1) NO. 15Nb, ROOT VALVE OF SUITABLE CLASS SHALL BE USED.
 - ii) FOR PRESS >40 ATA & TEMP <425 DEG C, TWO(2) NO. 15Nb, ROOT VALVE OF SUITABLE CLASS SHALL BE USED.
 - iii) FOR PRESS >40 ATA & TEMP >425 DEG C, TWO(2) NO. 25Nb, ROOT VALVES OF SUITABLE CLASS SHALL BE USED.
9. HORIZONTAL PIPE RUNS SHOULD HAVE A SLOPE IN THE DIRECTION  SHOWN OF 1:20 AS MINIMUM.
10. FOR PRESSURISED STEAM & WATER SERVICE THE ASSOCIATED INSTRUMENT SHOULD BE MOUNTED BELOW THE TAPPING POINT. FOR VACUUM/AIR/GAS SERVICE, THE ASSOCIATED INSTRUMENT SHOULD BE MOUNTED ABOVE THE TAPPING POINT.
11. SEAMLESS PIPE/SEAMLESS TUBE/CAPILLARY LENGTH SHALL BE SUCH THAT THE GAUGES/TRANSMITTERS/SWITCHES ARE MOUNTED IN ACCESSIBLE AREA.

LEGEND :-


A/R – AS REQUIRED

NPTF – NATIONAL PIPE THREAD FEMALE


NPTM – NATIONAL PIPE THREAD MALE

SW – SOCKET WELD


	TITLE :-		
	INSTRUMENT INSTALLATION DIAGRAM		
	NOTES		
DRG. NO.	PE-DG-999-145-XXXX		
REV. NO.	00	DATE	05.11.13
SHT	2	OF	9

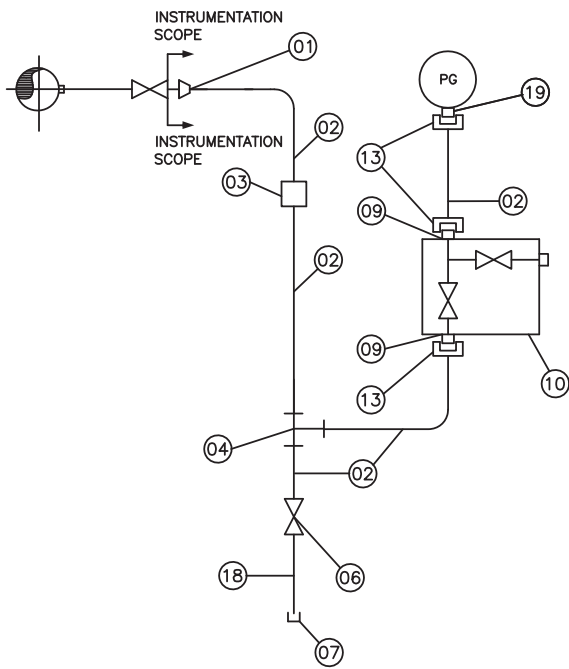

WATER SERVICE

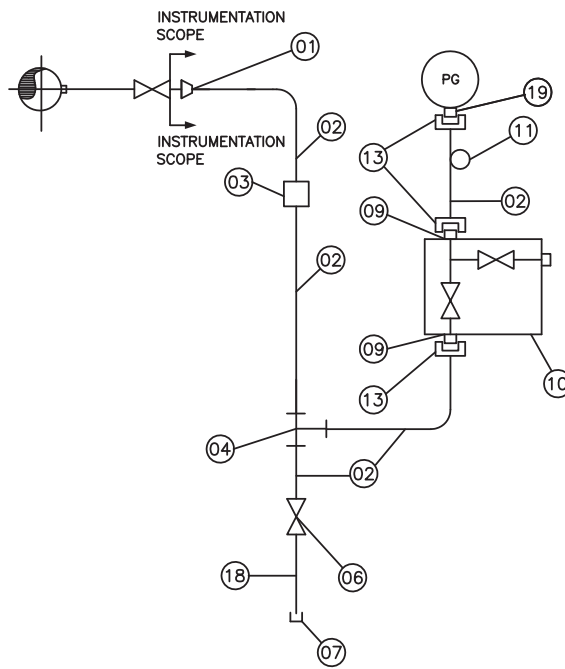

STEAM SERVICE

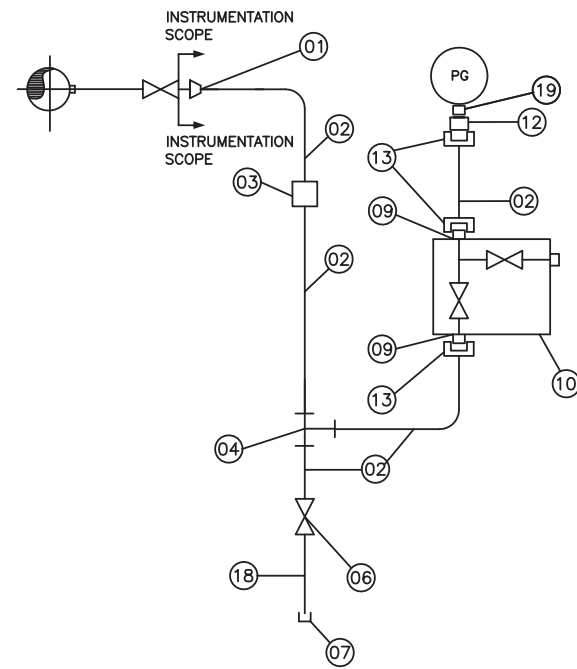

PULSATING SERVICE




TITLE :-

INSTRUMENT INSTALLATION DIAGRAM

PRESSURE GAUGES

DRG. NO.	PE-DG-999-145-XXXX		
REV. NO.	00	DATE	05.11.13
SHT	3	OF	9

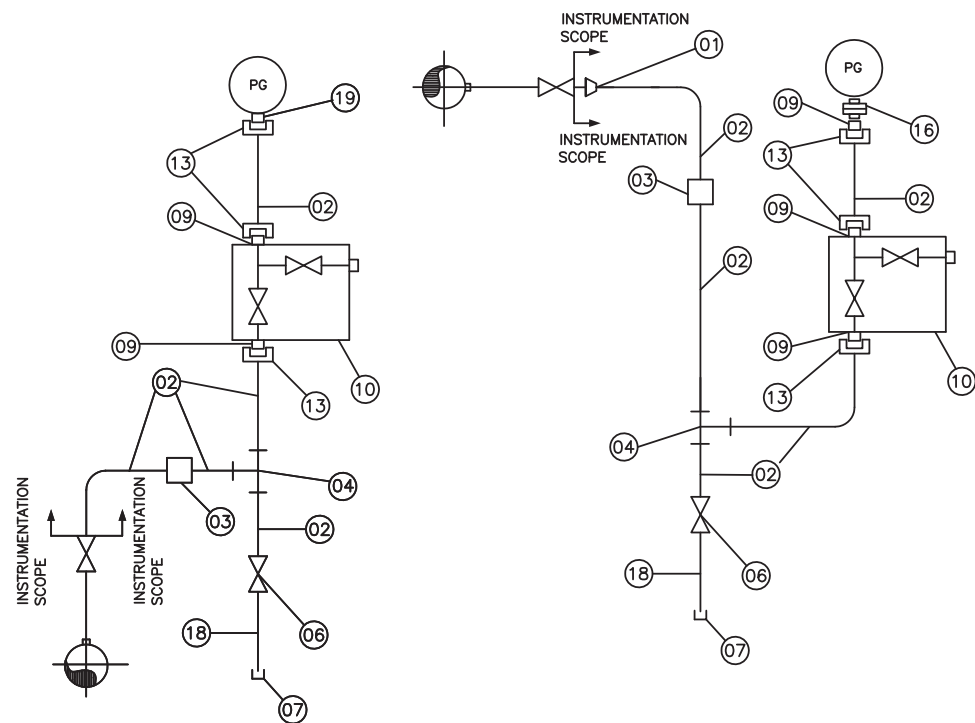

AIR SERVICE


WITH CHEMICAL SEAL
(FOR VISCOUS NON-CORROSIVE FLUID ONLY)

ITEM NO	ITEM/DESCRIPTION	MATERIAL	SIZE	QTY				
				WATER	STEAM	PULSATING	AIR	CHEMICAL
01	REDUCER (IF APPLICABLE)	SAME AS MAIN PIPE	1" X 1/2"SW	01	01	01	00	01
02	SEAMLESS PIPE	SAME AS MAIN PIPE	1/2"	A/R	A/R	A/R	A/R	A/R
03	FORGED COUPLING	SAME AS MAIN PIPE	1/2" SW	A/R	A/R	A/R	A/R	A/R
04	FORGED TEE	SAME AS MAIN PIPE	1/2" SW	01	01	01	01	01
06	FORGED GLOBE VALVE	SAME AS MAIN PIPE	1/2" SW	01	01	01	01	01
07	CAP	SAME AS MAIN PIPE	1/2" NPTF	01	01	01	01	01
09	ADAPTER - M TO M	SS316	M20X1.5M X 1/2" NPTM	02	02	02	02	03
10	TWO VALVE 3 WAY MANIFOLD WITH VENT PLUG	SS316	1/2" NPTF	01	01	01	01	01
11	SYPHON	SS316	1/2" SW	00	01	00	00	00
12	SNUBBER	SS316	M20X1.5M X M20X1.5F	00	00	01	00	00
13	NUT & TAIL PIECE WITH ANNEALED COPPER/SS304 WASHER	SS316	NUT SIZE : M20 X 1.5 WITH 100MM TAIL	03	03	03	03	03
16	CHEMICAL SEAL	SS316	1/2" NPTF X 1/2" NPTF	00	00	00	00	01
18	NIPPLE	SAME AS MAIN PIPE	1/2" NPTM X 1/2" SW	01	01	01	01	01
19	ADAPTER - M TO F	SS316	M20X1.5M X 1/2" NPTF	01	01	01	01	00




TITLE :-
INSTRUMENT INSTALLATION DIAGRAM
PRESSURE GAUGES

DRG. NO.	PE-DG-999-145-IXXX		
REV. NO.	00	DATE	05.11.13
SHT	4	OF	9

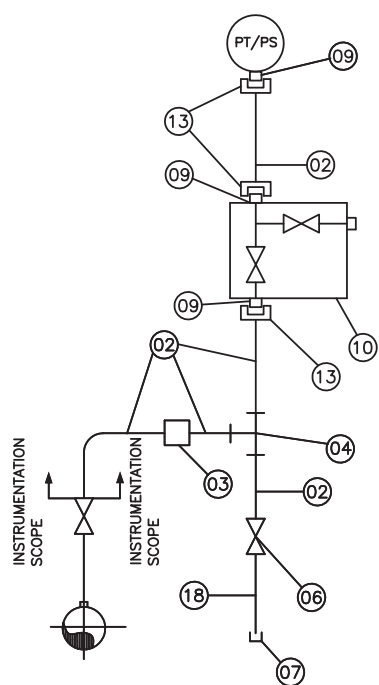

AIR SERVICE

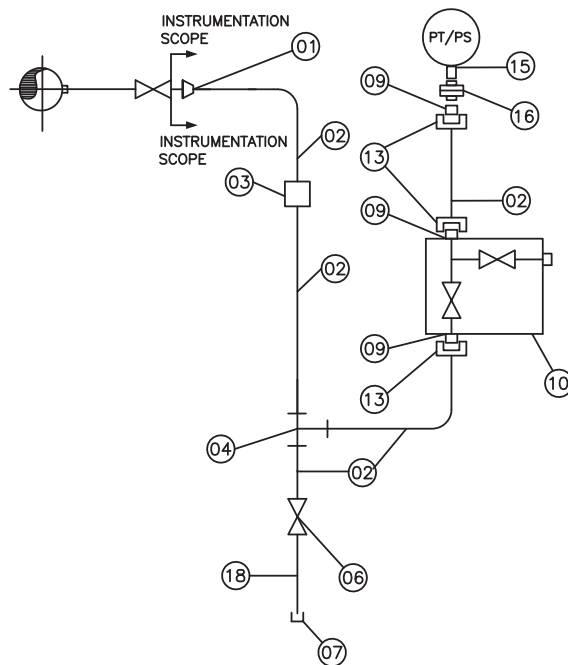

WITH CHEMICAL SEAL
(FOR VISCOUS NON-CORROSIVE FLUID ONLY)

ITEM NO	ITEM/DESCRIPTION	MATERIAL	SIZE	QTY				
				WATER	STEAM	PULSA TING	AIR	CHEM ICAL
01	REDUCER (IF APPLICABLE)	SAME AS MAIN PIPE	1" X 1/2"SW	01	01	01	00	01
02	SEAMLESS PIPE	SAME AS MAIN PIPE	1/2"	A/R	A/R	A/R	A/R	A/R
03	FORGED COUPLING	SAME AS MAIN PIPE	1/2" SW	A/R	A/R	A/R	A/R	A/R
04	FORGED TEE	SAME AS MAIN PIPE	1/2" SW	01	01	01	01	01
06	FORGED GLOBE VALVE	SAME AS MAIN PIPE	1/2" SW	01	01	01	01	01
07	CAP	SAME AS MAIN PIPE	1/2" NPTF	01	01	01	01	01
09	ADAPTOR - M TO M	SS316	M20X1.5M X 1/2" NPTM	03	03	03	03	03
10	TWO VALVE 3 WAY MANIFOLD WITH VENT PLUG	SS316	1/2" NPTF	01	01	01	01	01
11	SYPHON	CS	1/2" SW	00	01	00	00	00
12	SNUBBER	SS316	M20X1.5M X M20X1.5F	00	00	01	00	00
15	CONNECTOR - M TO M	SS316	1/2" NPTM X 1/2" NPTM	00	00	00	00	01
16	CHEMICAL SEAL	SS316	1/2" NPTF X 1/2" NPTF	00	00	00	00	01
13	NUT & TAIL PIECE WITH ANNEALED COPPER/SS304 WASHER	SS316	NUT SIZE : M20 X 1.5 WITH 100MM TAIL	03	03	03	03	03
18	NIPPLE	SAME AS MAIN PIPE	1/2" NPTM X 1/2" SW	01	01	01	01	01




TITLE :-


INSTRUMENT INSTALLATION DIAGRAM

PRESSURE SWITCHES/TRANSMITTERS

DRG. NO.	PE-DG-999-145-IXXX		
REV. NO.	00	DATE	05.11.13
SHT	6	OF	9

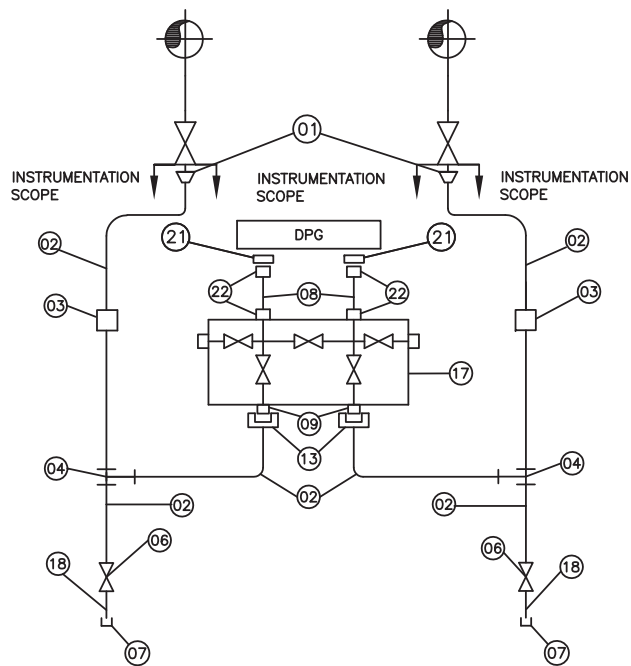

WATER SERVICE

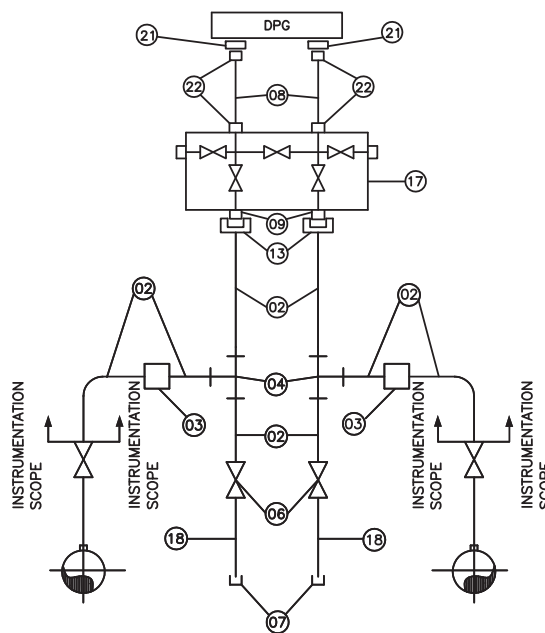


AIR SERVICE

ITEM NO	ITEM/DESCRIPTION	MATERIAL	SIZE	QTY	
				WATER	AIR
01	REDUCER (IF APPLICABLE)	SS316	1" X 1/2"SW	02	00
02	SEAMLESS PIPE	SAME AS MAIN PIPE	1/2"	A/R	A/R
03	FORGED COUPLING	SAME AS MAIN PIPE	1/2" SW	A/R	A/R
04	FORGED TEE	SAME AS MAIN PIPE	1/2" SW	02	02
06	FORGED GLOBE VALVE	SAME AS MAIN PIPE	1/2" SW	02	02
07	CAP	SAME AS MAIN PIPE	1/2" NPTF	02	02
08	SEAMLESS TUBE	SS316	1/2" OD	A/R	A/R
09	ADAPTOR - M TO M	SS316	M20X1.5M X 1/2" NPTM	02	02
17	FIVE VALVE MANIFOLD WITH DRAIN PLUG	SS316	1/2" NPTF	01	01
16	CHEMICAL SEAL	SS316	1/2" NPTF X 1/2" NPTF	00	00
13	NUT & TAIL PIECE WITH ANNEALED COPPER/SS304 WASHER	SS316	NUT SIZE : M20 X 1.5 WITH 100MM TAIL	02	02
18	NIPPLE	SAME AS MAIN PIPE	1/2" NPTM X 1/2" SW	02	02
22	TUBE FITTING DFDC	SS316	1/2" NPTM X 1/2"OD TUBE	04	04
21	CONNECTOR - F TO F	SS316	1/2" NPTF X 1/2" NPTF	02	02




TITLE :-
INSTRUMENT INSTALLATION DIAGRAM
 DIFFERENTIAL PRESSURE GAUGES

DRG. NO.	PE-DG-999-145-IXXX		
REV. NO.	00	DATE	05.11.13
SHT	7	OF	9

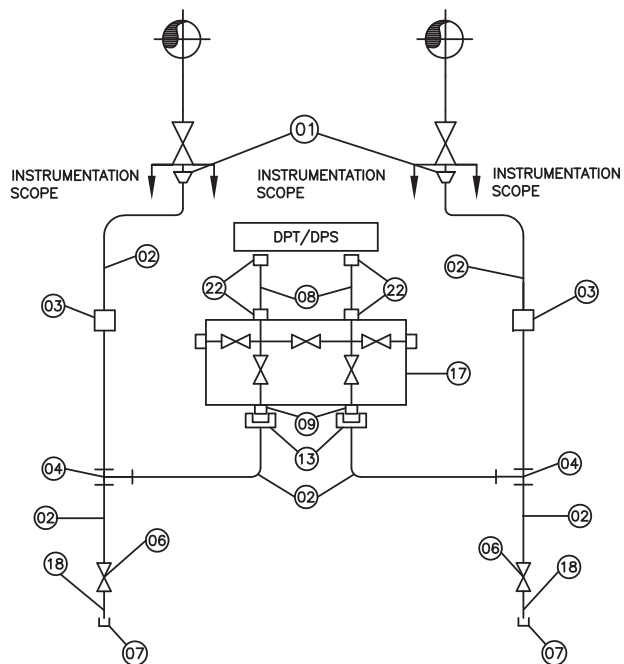

WATER SERVICE

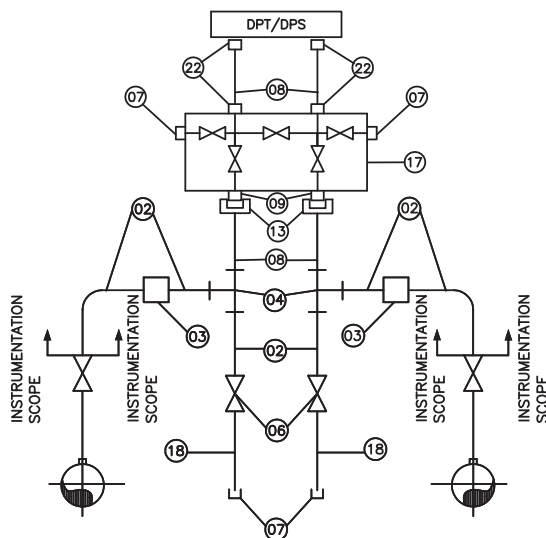

AIR SERVICE

ITEM NO	ITEM/DESCRIPTION	MATERIAL	SIZE	QTY	
				WATER	AIR
01	REDUCER (IF APPLICABLE)	SS316	1" X 1/2"SW	02	00
02	SEAMLESS PIPE	SAME AS MAIN PIPE	1/2"	A/R	A/R
03	FORGED COUPLING	SAME AS MAIN PIPE	1/2" SW	A/R	A/R
04	FORGED TEE	SS316	1/2" SW	02	02
06	FORGED GLOBE VALVE	SS316	1/2" SW	02	02
07	CAP	CS	1/2" NPTF	02	02
08	SEAMLESS TUBE	SS316	1/2" OD	A/R	A/R
09	ADAPTER - M TO M	SS316	M20X1.5M X 1/2" NPTM	02	02
17	FIVE VALVE MANIFOLD WITH DRAIN PLUG	SS316	1/2" NPTF	01	01
16	CHEMICAL SEAL	SS316	1/2" NPTF X 1/2" NPTF	00	00
15	CONNECTOR - M TO M	SS316	1/2" NPTM X 1/2" NPTM	00	00
13	NUT & TAIL PIECE WITH ANNEALED COPPER/SS304 WASHER	SS316	NUT SIZE : M20 X 1.5 WITH 100MM TAIL	02	02
18	NIPPLE	SAME AS MAIN PIPE	1/2" NPTM X 1/2" SW	02	02
21	CONNECTOR - F TO F	SS316	1/2" NPTF X 1/2" NPTF	00	00
22	TUBE FITTING DFDC	SS316	1/2" NPTM X 1/2"OD TUBE	04	04






TITLE :-


INSTRUMENT INSTALLATION DIAGRAM
DIFFERENTIAL PRESSURE SWITCHES/TRANSMITTERS

DRG. NO.	PE-DG-999-145-IXXX		
REV. NO.	00	DATE	05.11.13
SHT	8	OF	9

ITEM NO	ITEM/DESCRIPTION	MATERIAL	SIZE	QTY	
				PG/PS/PT	DPG/DPS/DPT
24	FLANGE SUPPLIED WITH PG/PS PT/DPG/DPS/DPT TO SUIT 1/2" OR 1" NB PIPE	SAME AS MAIN PIPE	1/2" SW	01	02
08	SEAMLESS PIPE	SAME AS MAIN PIPE	1/2"	A/R	A/R
25	SS ARMORED CAPILLARY TUBE (MINIMUM 5M IN LENGTH)	SS316	-	A/R	A/R

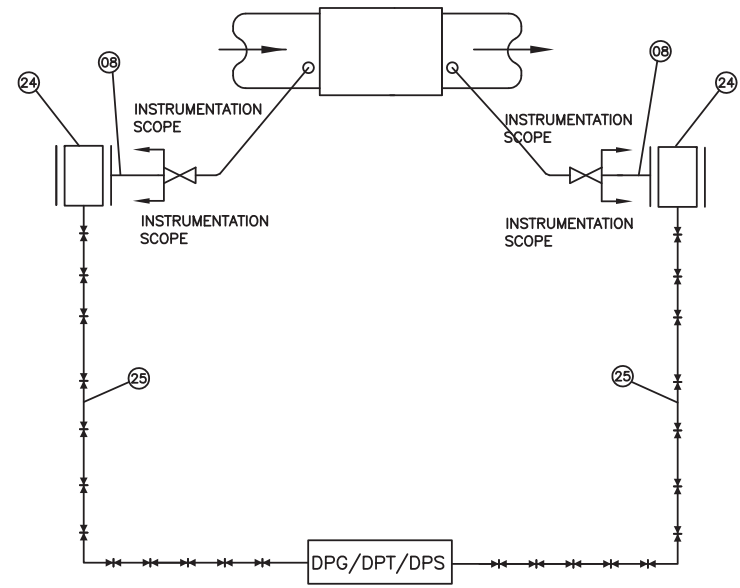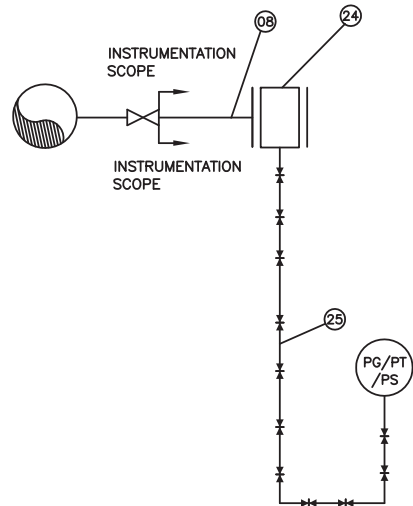

	TITLE :-			DRG. NO.	PE-DG-999-145-XXXX					
	INSTRUMENT INSTALLATION DIAGRAM						REV. NO.	00	DATE	05.11.13
	WITH CAPILLARY TUBES						SHT	9	OF	9

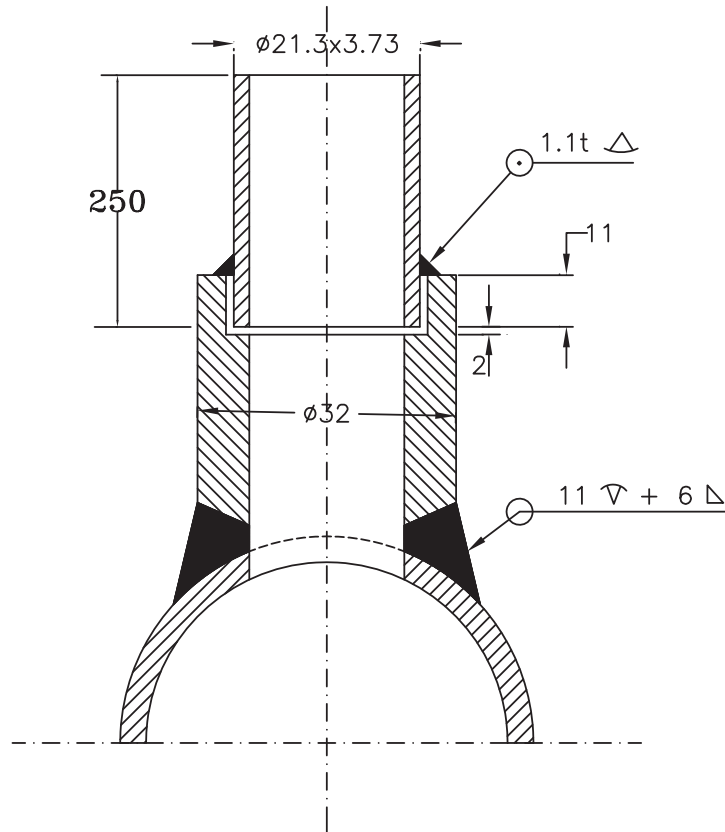


NOTE :

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFORM TO ANSI B16.11.
2. THE LENGTH OF NIPPLE SHALL BE 250 MM.
3. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE INDICATED
4. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY (1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES
5. FOR PU COATED PIPE REFER SHT NO-9.



TITLE :
INSTRUMENT STUB DETAILS
FOR PRESSURE MEASUREMENT
(PRESS UPTO 40 Kg/cm², TEMP < 400 DEG C
AND CLASS 3000#)

DRG. NO.
PE-DG-435-145-1101
REV. 01
SH. 4 OF 10

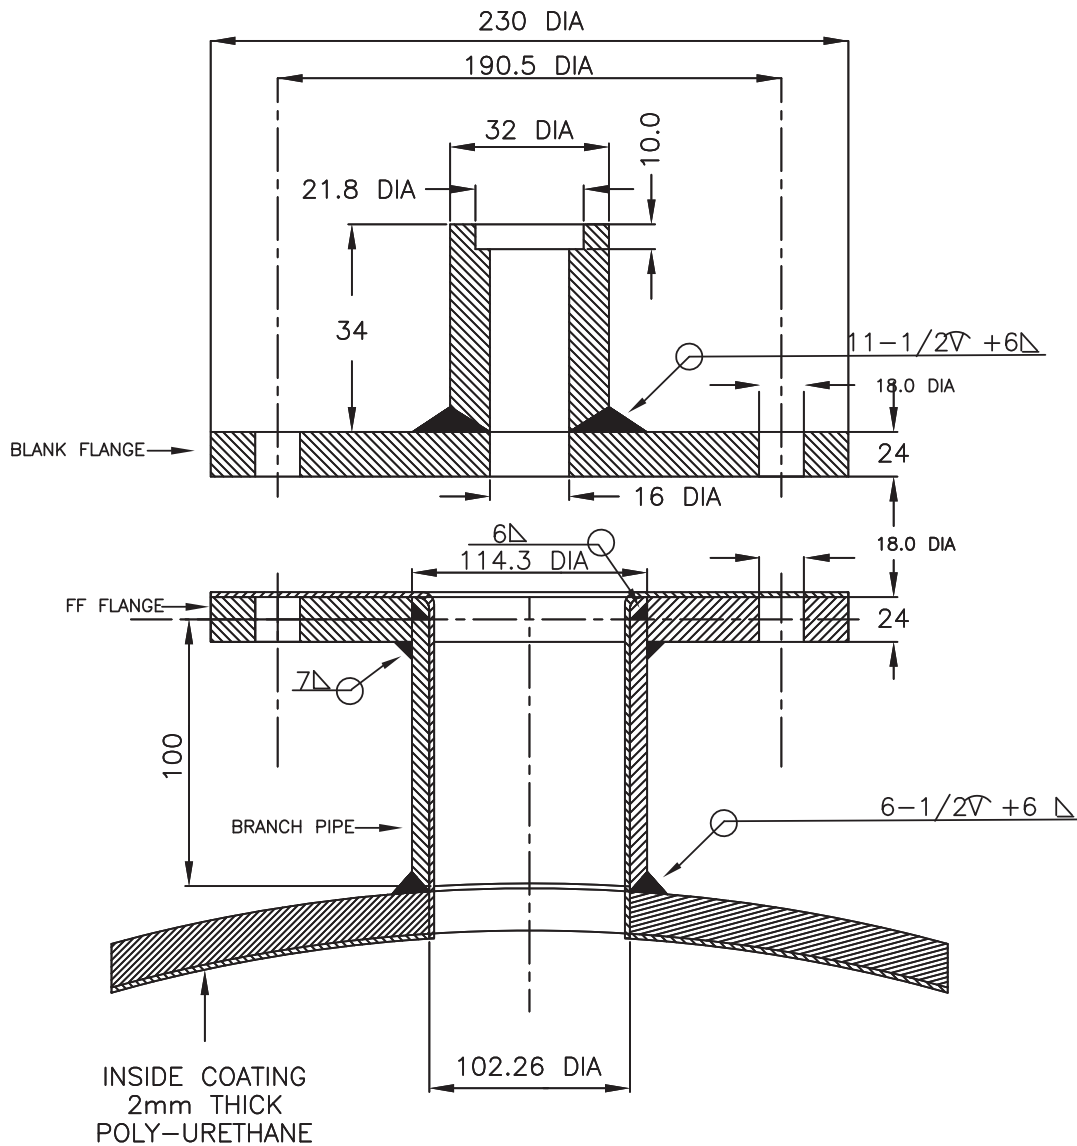

NOTES :-

1. THIS TYPE OF PRESSURE TAPPING IS APPLICABLE FOR PU COATED PIPING.
2. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE INDICATED.
3. MATERIAL OF BLANK FLANGE, BOSS WILL BE OF SS316L.
4. BRANCH PIPE MATERIAL SHALL BE SAME AS MAIN PIPE MATERIAL.
5. FF FLANGE SHALL BE NB100, CLASS 150 AND OF THE SAME MATERIAL AS THAT OF MAIN PIPE.
6. FOR LOW PRESS APPLICATION, MOC OF IMPULSE TUBING & IMPULSE PIPE SHALL BE CPVC(3/8") SCH 80 OR BETTER, INDUSTRIAL GRADE UPTO MANIFOLD. MOC OF IMPULSE TUBING, FITTINGS(FROM MANIFOLD TO INST) & MANIFOLD SHALL BE SUPER DUPLEX SS.



TITLE :
INSTRUMENT STUB DETAILS
INST. STUB DETAILS (PRESS)
 APPLICABLE FOR PU COATED PIPES
 (CW/ACW SYS, SEA WATER INTAKE SYS)

DRG. NO.
PE-DG-435-145-1101
 REV. 01
 SH. 9 OF 10

615965/2021/PS-PEM-MAX



TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D

REV NO: 00

DATE:

INSTRUMENT ERECTION DETAIL

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]



C&I SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE
TREATMENT PLANT

SECTION: C
SUB SECTION: C&I

C&I ERECTION

VOLUME II

SUB-SECTION 4.21

C&I ERECTION

1.0.0 TECHNICAL REQUIREMENT

1.1.0 Panels

Panels and control desk shall be freestanding type and fabricated preferably from 2.5 mm thick cold rolled steel sheet. Angle iron framework shall use a minimum section of 50 × 50 × 6 mm angle. The finish shall include sand blasting, grinding, chemical cleaning, and surface finishing by suitable filter and two coats of high-grade lacquer with wet sanding between coats. Two coats of paint in panel color shall be given for non-glossy high stain finish. Panel face final color in general shall be RAL 7035. A final coat of paint shall be given at site.

Panels and control desk shall have removable hinged doors, generally at the back for easy maintenance and accessibility of the instruments. Doors shall be double leaved type with handle and shall be provided with lock and key. Adequate illumination shall be provided inside the panel. All light fittings shall be suitable for 230V, 50Hz A.C.

The local panel construction shall be suitable for the site condition and shall meet IEC requirements in accordance with electrical area classification. Pressurization or purging shall be as per NFPA 496 or equivalent.

No process fluid except air shall be piped to the control panel.

Mounting heights

1. Annunciators (top row)
2. Miniature and subminiature instruments (next 3 rows)
3. Electric push buttons (last row)

Control room panels shall have IP protection of IP 32 if mounted in an air- conditioning room and IP-45 if mounted inside a room and IP-55 if mounted outside.

1.2.0 Cable Trays

All I&C cables / tubes shall run on perforated cable trays. These cable trays shall be made out of galvanized MS and shall be of sheet steel of 2.5 mm thick. The width shall be so selected that 60% of tray space is available for future use of the complete installation.

Suitable cable clamps shall be supplied for binding the cables / tubes at every 500 mm. Cable tray shall be provided with Hot dip galvanized finish. Cable tray shall be provided with the perforation as per manufacture standards. Suitable cable tray cover shall be provided for all trays.

Cable tray shall be continuous and solid grounded. Cable tray shall not have sharp edges, Burrs or projection which is injurious to insulation or outer sheath of the cable.

The supporting arrangement of cable tray system shall be able to withstand the weight of the cable and cable tray system. The supporting interval shall not be more than the recommended span for the above loading for the type cable tray selected. The tray shall not overhang by more than one meter from the support at the dead end.

1.3.0 Process Impulse Lines /Tubes & Fittings

Impulse lines for instruments shall be ½" OD tubing of SS316 material according to ASTM A-269. All fittings to be used for tubing shall also be SS316, double compression type of standard make. Impulse pipes for high pressure applications shall be used with material and rating as same as that of the process line. Size and thickness of piping/tubing shall be suitable for the design pressure and temperature conditions as per ANSI16.11. Compression tube fittings are used in low pressure process systems. Socket weld tube fittings shall be used in high pressure process systems

For impulse pipes/tubes and fittings, IBR certificate shall be provided as applicable. The bidder shall provide thermal insulation (preferably mineral wool) for sampling pipes for the purpose of personnel protection so that temperature outside the insulation is 60 deg. C. Tubing shall be complete with union connections and end fittings at supply and receiving ends. Nipple shall be provided for root valves size more than ½" and the nipple size shall be same as the root valve size. Reducer / adapter shall be provided to suit instrument connection, where nipple, root valve size is more than ½". Bulk head fitting socket welded type to be provided at instrument rack/enclosure.

Impulse pipes, fittings and air supply and signal piping/tubing shall be supplied for all the instruments under the scope of this specification. Instrument piping shall be designed for maximum design pressure and temperature of the process. Pressure measurement connection shall be ½" or 12mm pipe depending on the temperature and pressure conditions of the fluid. Instrument on Vacuum system at CEP inlet should have vent lines connected to high point in the condenser. Instrument air tubing shall be SS.

Minimum bending radius of instrument sensing line is 3 times the tube diameter. Independent impulse lines shall be installed between the flow elements and the transmitter in case of dual/triple redundant

Instrument sensing lines are sloped in their horizontal runs, a minimum of ½" per foot. In general, liquid and steam lines slope from their process tap connection down to the instrument. In general, gas and non-condensing vapor lines slope from their process tap connection up to the instrument.

Instrument sensing lines shall be routed as directly as practicable from the process root valve to the instrument. The length of instrument tubing from the root valve to the instrument shall be limited to maximum of 12 meters for compressible fluids and 15 meters for non-compressible fluids. Wherever it is not possible to access the main root valve a additional root valve shall be provided near to the instrument.

Instrument sensing lines shall be grouped together as much as possible to benefit from the use of common support members and to present a finished installation that is routed in a neat and orderly manner.

The maximum process temperature for all transmitters shall be limited to 80°C. To dissipate the excess heat, a minimum of 1 meter of tubing for each 30°C of excess heat shall be installed to isolate the process media from the instrument. An additional isolation valve shall be used at the instrument for isolation on those instruments without valve manifolds

Funnel with drain header shall be provided in the racks for blowing/draining out the process fluid in the impulse tubings. The size of the drain header shall be 1". When instruments are mounted local to the tapping point and are not mounted in the rack, or panel or enclosure, the drains shall be connected to the nearest floor level or plant drain.

VOLUME: II B
**TECHNICAL SPECIFICATIONS FOR
 EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
 SPECIFICATION NO.: PE-TS-435-164-A001**

The erection hardware shall meet the following specifications:-

Item	Specification
a) Impulse Piping	
i) High pressure and high temperature services (Medium: Steam & Water and furnace region)	Seamless Alloy Steel Piping to ASTM A335 GR.P22 (schedule 160 for high pressure & high temperature)
ii) Low pressure and low temperature services Gr.B (Medium: Steam & Water)	Seamless carbon steel piping to ASTM A106
iv) Steam and Water Analysis system	Seamless stainless steel piping to ASTM A312 Gr. TP-321
v) Seamless copper tubing	ASTM B-75
b) Fittings	
i) Material for socket weld fittings	ASTM A105 ASTM A182 Gr. F22 6000/3000 lbs
ii) Dimensions of fittings	ANSI B16.11
iii) Fittings for steam and water analysis	ASTM A182 Gr. F-321

1.4.0 Instrument Valves and Manifolds

Bidder shall supply instrument valves (miniature type) and valve manifolds as per the Instrument Installation / Mounting diagrams.

Body material and rating shall be SS316 whichever is better and shall be forged type. Valve trim material shall be SS316.

Double root valve shall be provided under the conditions of pressure ≥ 40 bar.

a) Valves	
i) 3-way valves	SS body/Forged CS body stellited internals and SW ends as per requirement for 2500 lb/600 lb ASA ratings.
ii) 3-valve/5- valve manifolds	FAS body/FCS body 316SS stellited internals with NPT(F) SCRCD ends for 2500 lb/1500 lb/600 lb ASA ratings.
iii) 2-valve manifolds	FCS body, 316SS stellited internals, NPT (F) SCRCD ends.

- | | | |
|----|---|---|
| b) | Isolation and drain valves | Globe valves with FAS body/FCS body, 316SS stellited internals, SW ends for 2500 lb/1500 lb/600 lb ASA ratings. |
| c) | Condensation vessels | FAS/FCS body with NPT (F) SCRD connection and vent plugs for 2500/600 lb ASA ratings. |
| d) | Dust separating chambers | ERW carbon steel pipe to IS-1239 Heavy Class |
| e) | Racks and Associated Equipment | ANSI C83.9-1972 |
| f) | Code for pressure piping, welding and Hydrostatic testing | ANSI B-31.1 |
| g) | Flexible conduits with fittings | Lead coated, paper insulated, heat resistant flexible metallic conduits with necessary fittings |

1.5.0 Instrument Support / Structural Steel

Bidder shall supply instrument stands (stanchions) and other structural steel material required for supporting the Junction boxes, cable trays, impulse lines and instruments.

All field mounted instrument tubing shall be supported with steel angles/channels of a minimum 1/8" thickness fabricated to present a neat appearance. Sharp corners in the support material to be avoided

1.6.0 Transmitter Enclosures

- a) Transmitter Enclosures shall be free standing, enclosed type offering protection against dust, moisture and vermin. Enclosures shall be suitable for outdoor installations, in Udangudi Supercritical Thermal Power Project.
- b) The enclosures shall comprise of rigid welded structural frames enclosed with cold rolled sheet steel of thickness not less than 3 mm.
- c) Instrument piping inside the enclosure shall conform to the specification and in line with typical installation drawings enclosed with the specification.
- d) Blow down header shall be provided inside the enclosure as called for.
- e) Bulkhead connection shall be provided to receive and terminate the impulse pipes from root valves.
- f) Instrument tubing, fittings and isolation, drain valves shall be to ANSI code for pressure piping. Piping/tubing shall be subjects to hydrostatic tests at 1.5 times maximum system pressure.
- g) Support angles shall be provided for valve manifolds, wiring trays etc. Enclosures shall be complete with necessary bulk head fittings, junction boxes, drain header and other accessories as needed on the basis of approved hook up drawings.
- h) Sufficient spacing among adjacent transmitters shall be maintained to offer easy accessibility and operational convenience. The enclosure shall be designed with sizes to suit the grouping and to completely include all the hardware for hooking up the transmitters to the process on the basis of approved installation diagrams. A maximum of five (5) transmitters are envisaged to be grouped in one enclosure.

- i) Hydrostatic tests for piping/tubing and functional checks for correct wiring shall be carried out.
- j) The doors shall be the three-point locking type constructed of not less than 10 gauge steel. Doors shall have concealed quick removal type pinned hinges and locking handles. Doors locks shall accept the same key. Module assemblies shall be fabricated by bolting together two or more modules to form one continuous rigid structure. End covers shall then be added to complete the end closure. Gaskets shall be used between all mating sections to achieve NEMA type-12 dust proof enclosure rating for the modules and a NEMA type-4 water proof and dust tight rating on the terminal boxes. All enclosures shall have access doors on front and backsides.
- k) The quality of the erection hardware/equipment used for complete instrumentation and control equipment shall meet all the requirements indicated in the other clauses.

1.7.0 Mountings for Vibration Transducers

Vibration transducer mounting design and location shall be acceptable to the Owner and to the vibration transducer manufacturer and shall be installed in accordance with API 670. The Bidder shall provide drawings to the vibration monitoring system supplier to indicate the arrangement and dimensions of bearing housings, shaft supports, reinforcing struts, ribs, and adjacent structures. These drawings shall be in sufficient detail to allow the vibration monitoring system supplier to select and locate the vibration transducers.

1.8.0 Junction Boxes

Bidder shall supply junction boxes wherever required. These shall be of Industrial grade Fibre glass Reinforced Polyester (FRP) to weather proof, with cable entering on bottom and side entry shall be provided.

These boxes shall have terminals suitable for min 2.5 mm² cable termination (klip on) mounted on rails. 30% spare terminals shall be supplied in each junction box.

Junction box shall be provided with double compression glands.

Telephone socket shall be provided in junction boxes. Each junction box shall have a minimum of 20% or 2 nos., whichever is more, spare entry duly provided with plugs (weather proof/explosion proof, as applicable). Protection class shall be IP-65 minimum for JB and enclosures.

In general junction boxes shall be designed in accordance with NEC, Article 370, paragraphs 18, 19 and 20 or equivalent standards. Junction boxes for use in outdoor or damp locations shall be galvanized malleable iron or steel coated inside and outside. The enclosure shall conform to NEMA-4 with hinged door lockable type. Conduit and cable shall enter the lower portion of the box in such a manner that all terminals strips are above conduit entry points.

2.0.0 ERECTION SERVICES

2.1.0 Instrument Air Supply System

Dry instrument air shall be distributed to various equipments of I&C system like control valves, Analyzer purging, pneumatic On-Off dampers. The Bidder shall supply total Instrument air requirement Calculations, and design of Air compressor system along with the bid. On collection of water in the drains of instrument air lines, mechanical automatic drains and periodically solenoid operated drains (with electronic timer - 15m, 30m, 60m and 2 Hours & Timing adjustable) are to be provided.

For mechanical type & Electrical type, the locations to be provided in the instrument air lines of boiler area, Chimney area, turbine area etc., shall be decided during detailed Engineering

2.2.0 Installation of Instruments

All electronic instruments shall be generally installed on supports as per installation standards. No instrument shall be installed in such a way that it depends for support on the impulse pipes, hand rails, floor grills, process pipes or structure in the passage.

Field mounted instruments shall be mounted on brackets, subpanels, or placed on a suitable pedestal. They shall be easily accessible from grade, ladder or platform. All local indicators shall be readable from grade or operating level and if used for manual control, shall be visible from the related valve.

Wherever possible, local mounted instruments shall be mounted at approximately 1.35 meters above the platform or floor in an accessible position. Instruments shall be mounted as close to the sensing points as possible (<15 mtrs).

2.3.0 Instrument Tubing Installation

All primary piping / tubing shall be installed in the best workman-like manner and shall follow installation standard in each case. Where there is no installation standard, the decision of the Engineer-in-Charge shall be followed.

Horizontal and vertical lines shall be installed using spirit levels and plumb and shall be supported to permanent structure at every 1.5 meters.

All threaded joints shall be jointed using Teflon tapes and no other tube-jointing compound shall be used except on higher temperature services where graphited sealing compounds shall be used. Brand of Teflon tape, insulation tape, graphite compound is to be approved by the engineer in charge.

Tubing shall be bent with correct size tubing bender wherever possible to avoid the use of fittings. Tubing cutter shall always be used to cut tubing. The use of short length of tubing in long runs shall be avoided. Wherever required coils shall be provided.

All tubing shall be run in such a manner as to give the maximum protection against mechanical damage. Tubing runs shall be grouped together where possible. Tubing shall be arranged so that couplings can be tightened without disturbing lines.

Tubes installed but not connected, shall have the ends closed in an approved fashion to prevent the entry of foreign material. For a period of up to one-week, adhesive tape may be used for longer periods, caps or plugs shall be used.

All reasonable precautions shall be taken to prevent foreign material entering pipelines before and during erection. All lines shall be blown through with filtered air before connection to instruments.

No tube shall be left with mechanical strain on it.

On tubing to pipe connections and in making up screwed pipe joints, Teflon tape shall be applied to make thread in a manner to insure tape is not over the end of the male fittings.

2.4.0 Piping Supports

Piping and tubing shall be adequately supported and fixed at distances not exceeding those in the following table:

VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

Single Tubing / Pipe Maximum distance between Supports 3/8" OD and less Continuous to 3/4" Nom. size 2 Meters (6 ft.) 3/4" to 1" Nom. size 3 Meters (9 ft.). All field mounted instrument tubing shall be supported with steel angles/channels of a minimum 1/8" thickness fabricated to present a neat appearance. Sharp corners in the support material to be avoided.

2.5.0 Process Connection and Installation

Installation of pressure instruments at locations subject to excessive vibration shall be avoided. An additional block valve and vent valve shall be required adjacent to the transmitter. Means shall be provided for venting pressure from the line and gauge, so that gauges may be removed safely. Primary injection testing shall be incorporated together in a manifold.

Approved ball valves shall be used where temperature conditions permit. The valves shall be rated for not less than the line pressure on the main pipeline. If the pressure piping is of such length that the isolating valve is inaccessible from the instrument location, a suitable valve shall also be fitted at the instrument itself.

All pressure instruments shall be installed vertically. Those for steam must be tapped directly from above, for pressure transmitters and switches, there shall also be a condensing leg. The same applies to gas and vacuum measurements, but adequate provision should be made to ensure no condensation can take place along the line, i.e. The slope shall be adequate to drain any condensate back to the main lines (sloping upwards from the sensing point). Tapping points for liquids shall be made at an angle of 45° from the bottom of the main pipe and these are to be sloped downwards from the sensing point.

SIZE OF TAPPING POINT STUB, NO. AND SIZE OF ROOT VALVES FOR DIFFERENT TYPE OF MEASUREMENTS

Sl. No	Qty. Of Root	Root Valve Size	Root Valve Service Conditions
A. Pressure & Differential Pressure Measurement			
(i)	2	25	>=62 bar OR 425 degree C
(ii)	1	15	< 62 bar AND 425 degree C
B. Level Measurement			
B1-Level Gauge and Switch			
(i)	2	25	>=62 bar OR 425 degree C
(ii)	1	15	< 62 bar AND 425 degree C
B2-Level Transmitter (Displacement Type)			
	2	25	>=62 bar OR 425 degree C
	1	15	< 62 bar AND 425 degree C
B3-Standpipe For Level Measuring Instrument			
	2	25	>=62 bar OR 425 degree C
	1	15	< 62 bar AND 425 degree C
C-Flow Measurement			
	2	25	>=62 bar OR 425 degree C
	1	15	< 62 bar AND 425 degree C
D. Sampling System Measurement (Steam & Water Service)			
	2	25	>=62 bar OR 425 degree C
	1	15	< 62 bar AND 425 degree C

Transmitters, temperature switches, pressure switches and the like shall be supported independent of the pressure connection; the type of support shall depend upon the make of instrument and location. When installing pressure instruments, care must be taken to avoid the possibility of imposing stresses from the pressure piping, conduit etc. which may cause malfunction.

When the pressure impulse line is liquid filled, the measuring unit shall be compensated for static head. The head correction shall be stated on the all process connections, pressure impulse lines and instrument arrangements shall be fully detailed and to the approval of the Engineer-in-charge.

2.6.0 Laying and Termination of cables

Multicore / multipair cables shall always be installed on trays or ducts and properly clamped. At every vertical drop to/from junction boxes they shall be clamped at frequent intervals as per instruction of Engineer in charge. They shall be connected inside the junction boxes strictly according to the numbering systems mentioned in the junction box schedule.

The accessories like double compression cable glands, cable lugs, cable tags (SS), cable ties and accessories required for the cable termination shall be included in scope of supply. Insulated lugs and ferrules with proper identification shall be used for all I&C cables.

At bends, minimum radius shall be maintained as per manufacturer's standard. Multicore/Multipair cables to be laid from instrument location to control room as per required standard. Identification tags shall be provided on either end of individual cores, Multicore/paircables including unused cores as per wiring diagram/cable/junction boxes schedules. PVC ferrules shall be used, for identification of cores. SS tag plates shall be used for identification of cable/junction boxes.

All cables shall be cut, after the exact site measurements are taken, between ends and the cable drums shall be so selected before cutting the lengths, as to avoid any wastage. Meggering should be done for each drum and length. While terminating the leads at the field instruments, a 300mm length loop shall be provided to facilitate easy removal of instruments.

In the field, the cables shall be laid in the overhead ducts / trays as per layout drawings. While laying cables in ducts/trenches or burying them, care shall be taken to ensure that two signal cables like alarm, analyzer cables, special cables compensating cables, etc. are separated from other power supply cables. Separation of low signal cables and power supply cables in trays/ducts shall be done as shown in the tray/duct drawing. Jointing of cables are not permitted.

At each road crossing and other places where cables enter pipe sleeves, adequate bed of sand shall be given so that the cables do not slack and get damaged by pipe ends after pack filling. All cables shall be laid in accordance with the layout drawings and cable schedule and tubing schedule. Multicore/Multipair cables shall be bent in a large radius as per manufacturer's standards.

Cables shall be rigidly supported on structural steel and masonry individually or in groups as required using individual cast or malleable iron galvanized clips, multiple cable supports or cable trays. If drilling of steel must be resorted to, approval must be secured and steel must be drilled where the weakening of the structure will be minimum. Cable shall be supported at every 500mm. In case no such supports are available, the bidder shall provide suitable supports for the cable wherever required.

No cable shall be terminated or left with mechanical strain on it in any conduit or trenching. Where cables are run through conduit the entry and exit shall be smooth and free from burrs. The use of conduits shall be kept to a minimum, as far as possible. Cables must be pulled into ducts/conduit in a way that ensures there is no damage to the cable.

All multicables laid in ducts shall be properly dressed and tied with nylon wire of 3 mm diameter. All cables finally entering JB/cabinets shall run through flexible PVC conduits for approximately 500mm.

615965/2021/PS-PEM-MAX



**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

SPEC NO: PE-TS-435-164-A001

VOLUME: II-B

SECTION: D


REV NO: 00

DATE:

DDCMIS/DCS INTERFACE FOR DRIVE

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

DCS INTERFACE FOR BIDIRECTIONAL DRIVE(WITH INTEGRAL STARTER)

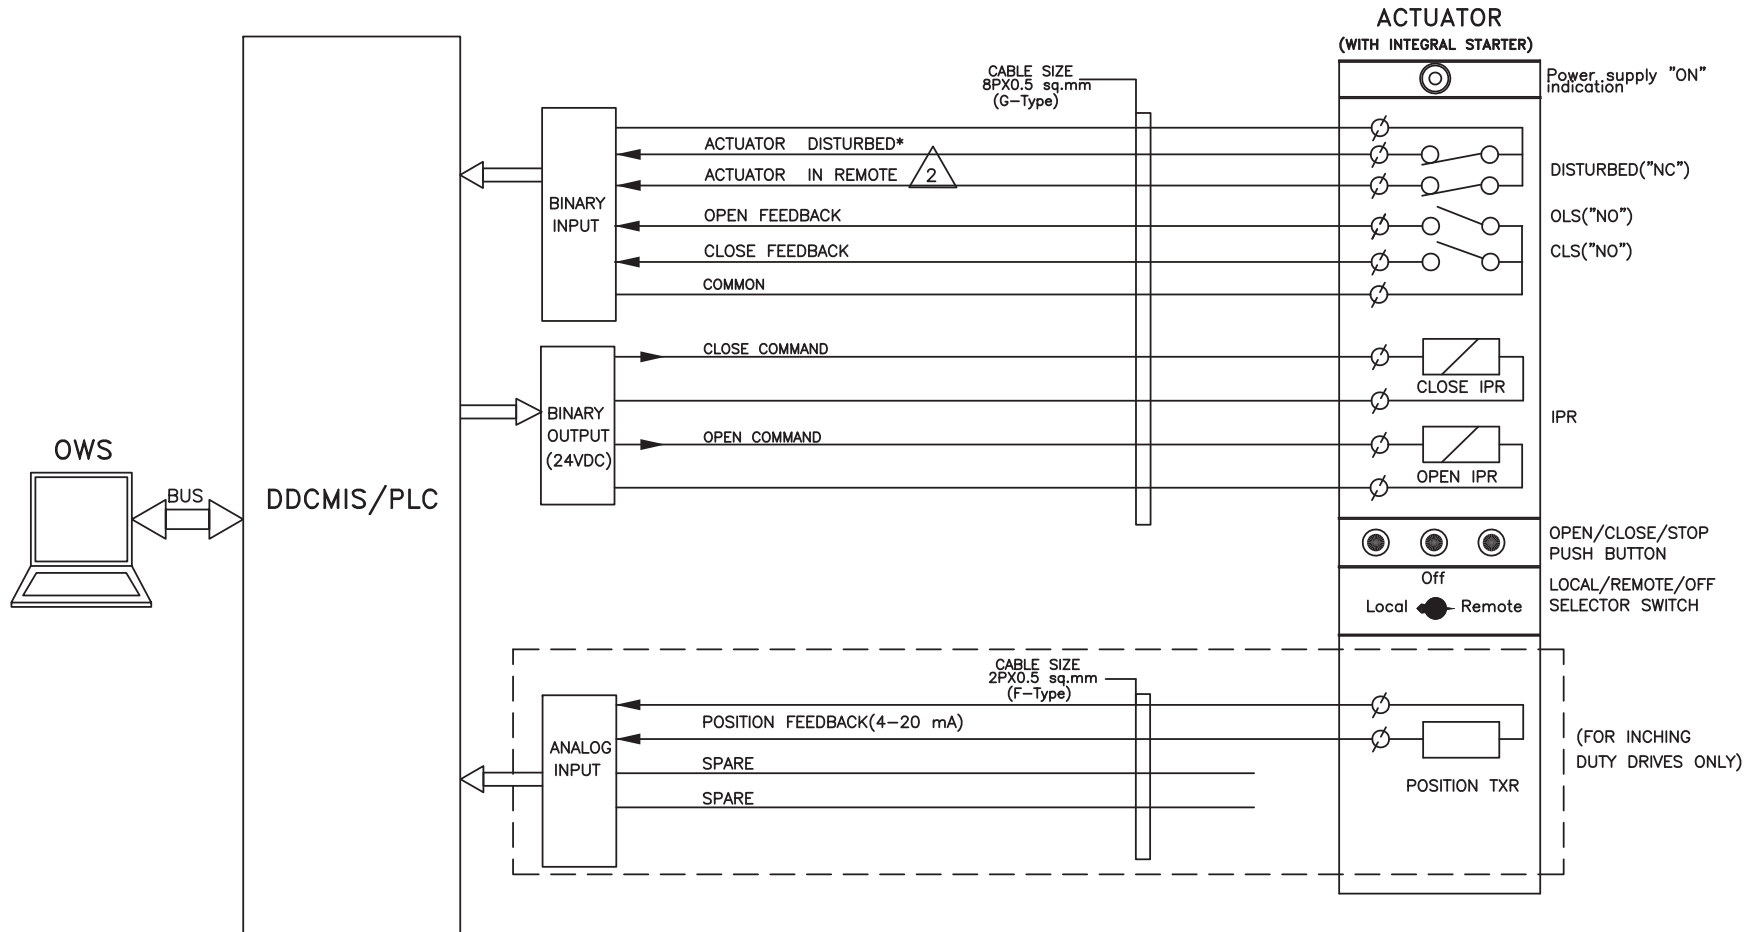

NOTE:


- 1) Position Feedback of Bidirectional Inching duty drives in vicinity may be grouped together in the field during cable engineering. Junction Boxes and Single Trunk cable of higher size may be used to connect.
- 2) Redundancy of I/Os shall be as per contract specification requirement. 1
- 3) Two Nos of 9 pin plug in connectors, type connection shall be provided for interfacing with DDCMIS. 2

* DISTURBED= Loss of Power supply (1 Phase/3 Phase)/
 Loss of control supply / Motor thermostat trip /
 Thermal over load / Local/Off/Remote Sel. switch in
 local or off mode / Torque open/close cut off / Stop
 PB optd.

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

	PROJECT: 2X660 MW TANGEDCO UDANGUDI STAGE I STPP		DRG.NO.	PE-DM-435-145-1002
	TITLE		DATE	05.11.2019
	DDCMIS INTERFACE FOR BIDIRECTIONAL DRIVE		REV.NO.	07
			SHT	7 OF 11

DCS INTERFACE FOR UNIDIRECTIONAL LT DRIVE

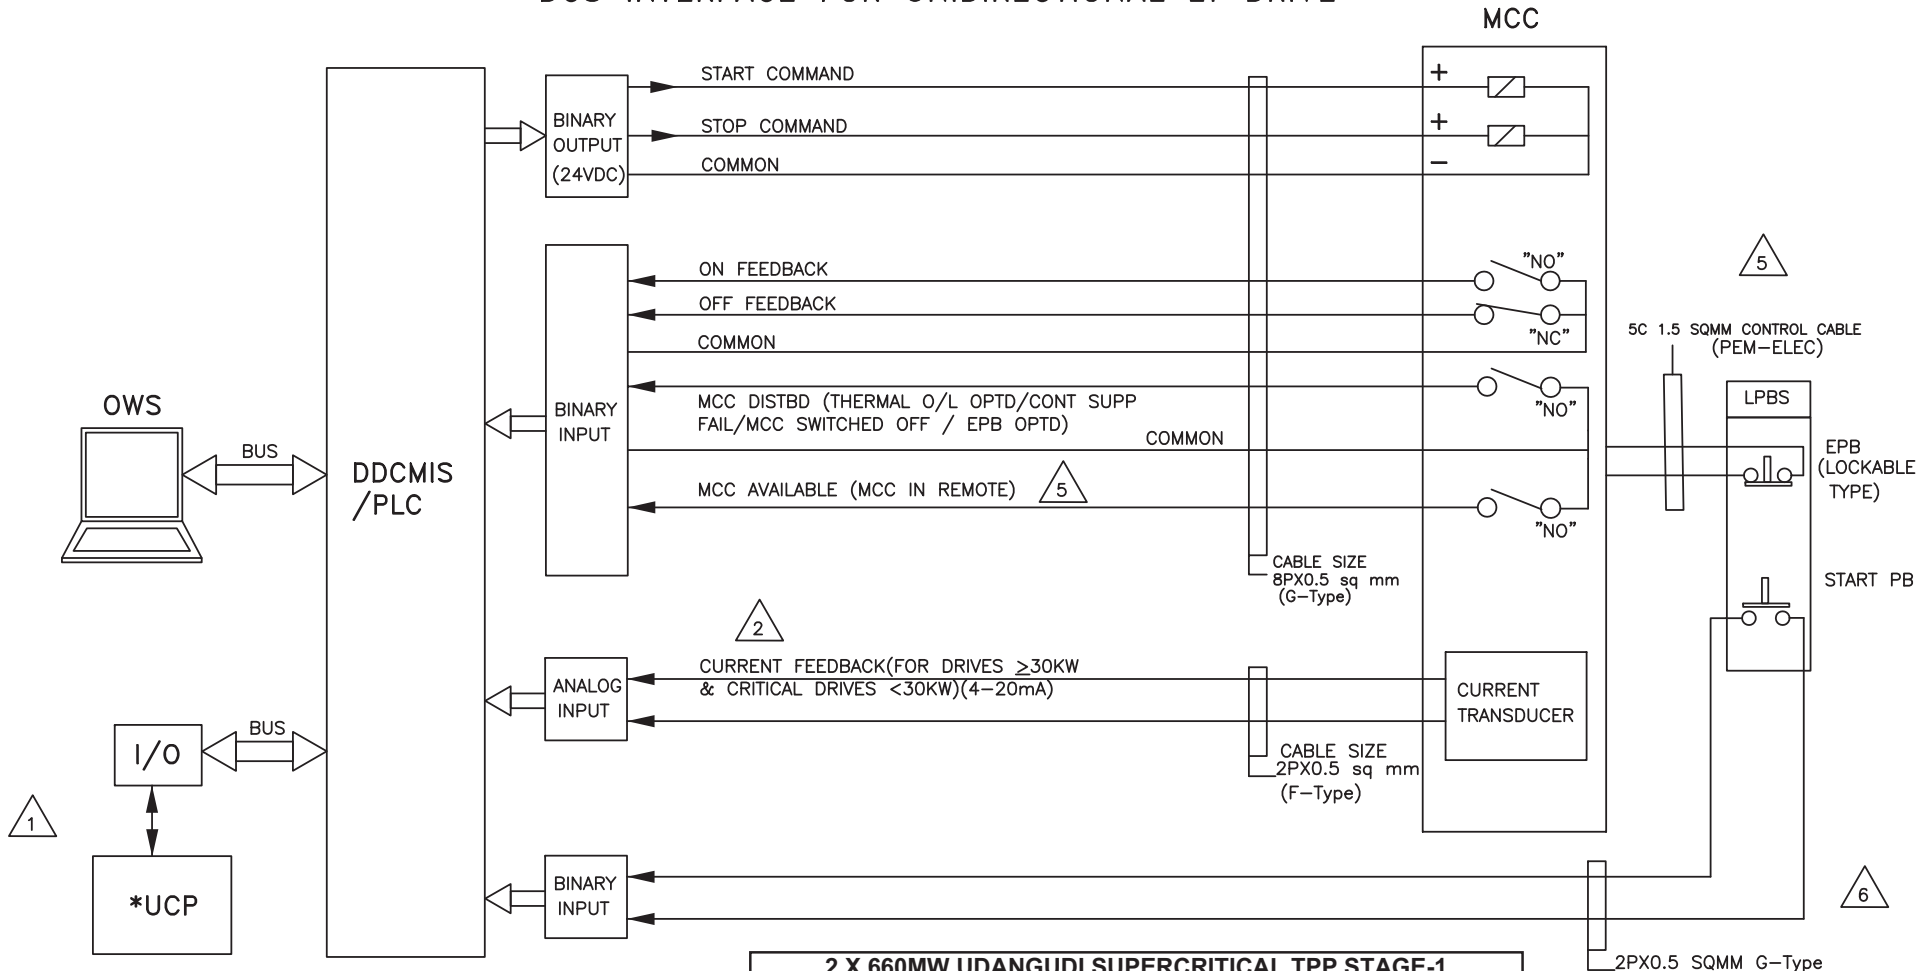

* As Applicable

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT
SPECIFICATION NO.: PE-TS-435-164-A001

NOTE:


1) Redundancy of I/Os shall be as per contract specification requirement.



	PROJECT: 2X660 MW TANGEDCO UDANGUDI STAGE I STPP	DRG.NO. PE-DM-435-145-1002
	TITLE DDCMIS INTERFACE FOR UNIDIRECTIONAL LT DRIVE	DATE 05.11.2019
		REV.NO. 07
		SHT 8 OF 11

DCS INTERFACE FOR SOLENOID DRIVE (220V DC/ 24V DC / 240V AC UPS)

**2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1
VOLUME: II B
TECHNICAL SPECIFICATIONS FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT
PLANT
SPECIFICATION NO.: PE-TS-435-164-A001**

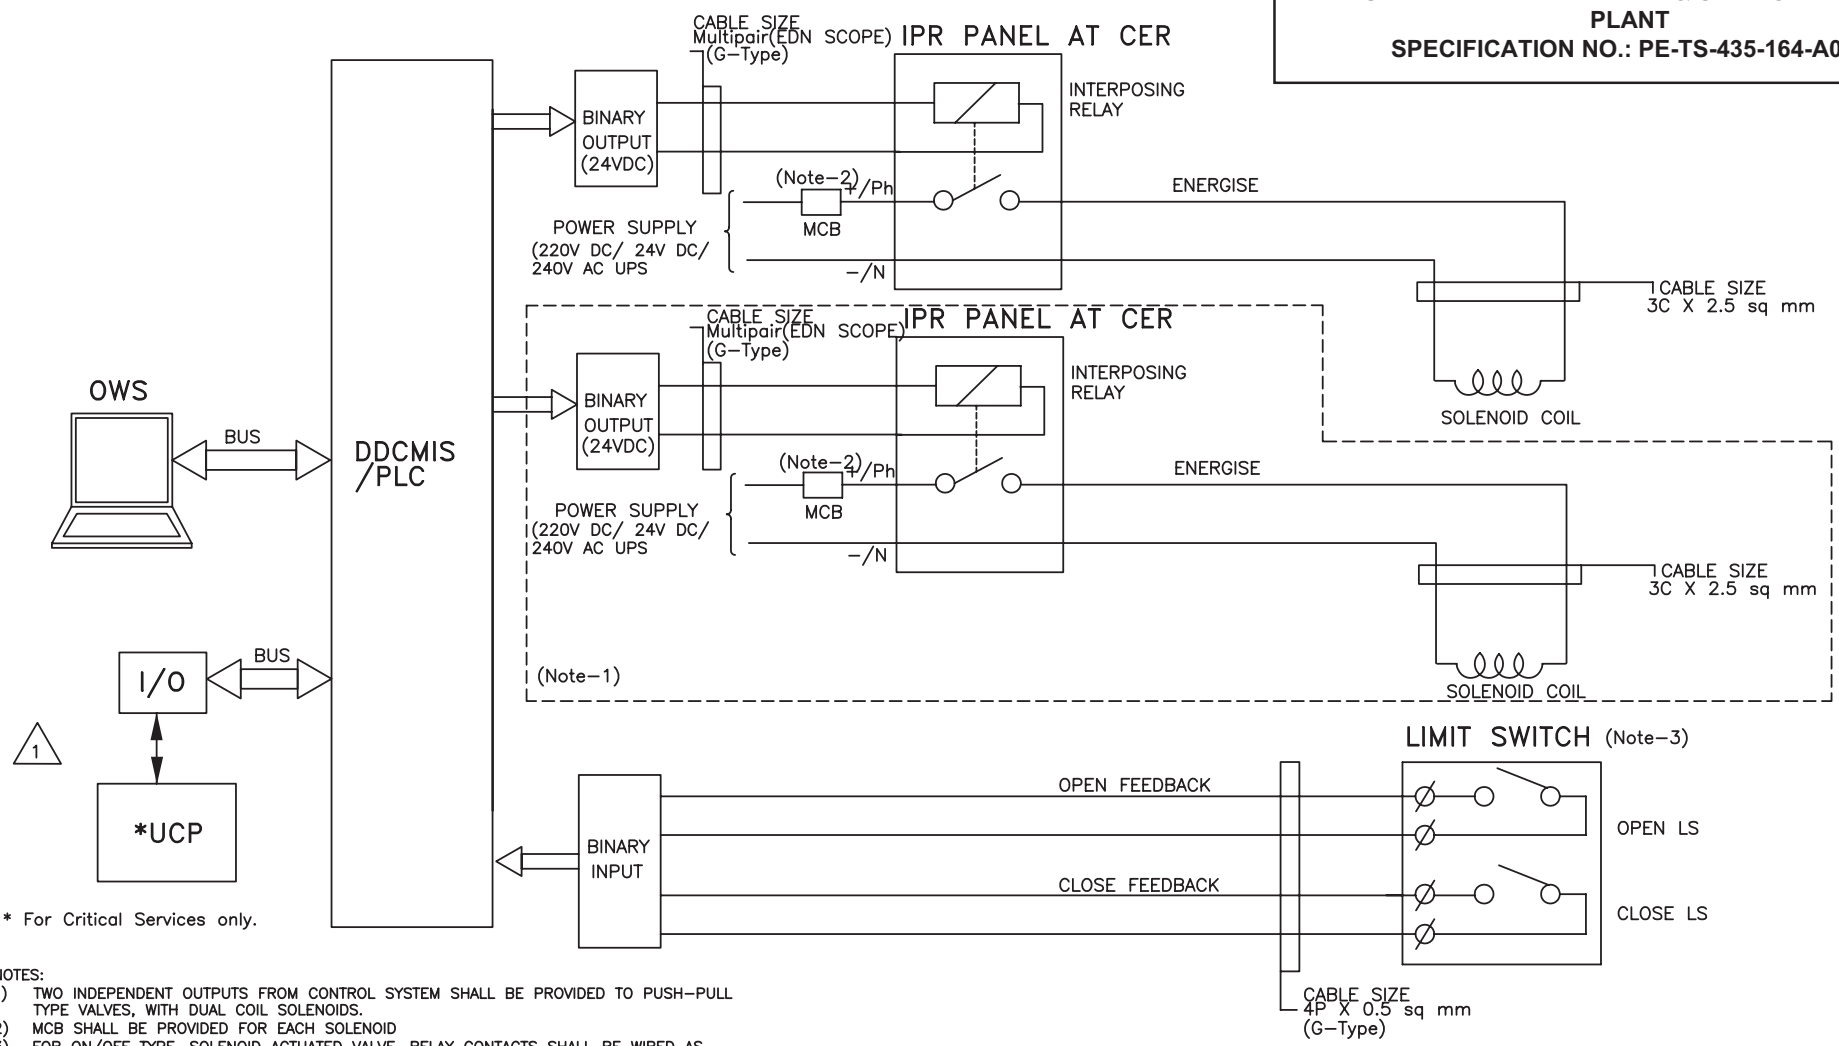

* For Critical Services only.

- NOTES:
- 1) TWO INDEPENDENT OUTPUTS FROM CONTROL SYSTEM SHALL BE PROVIDED TO PUSH-PULL TYPE VALVES, WITH DUAL COIL SOLENOIDS.
 - 2) MCB SHALL BE PROVIDED FOR EACH SOLENOID
 - 3) FOR ON/OFF TYPE, SOLENOID ACTUATED VALVE. RELAY CONTACTS SHALL BE WIRED AS FEEDBACK WHEREVER LIMIT SWITCH FEEDBACKS ARE NOT AVAILABLE. 1 CONTACT FOR SINGLE COIL & 2 CONTACT FOR DUAL COIL (OPEN LIMIT SWITCH & CLOSED LIMIT SWITCH.
 - 4) BHEL WILL TAKE CARE OF DE-ENERGISE TO TRIP PHILOSOPHY FOR FAIL SAFE CONTROL SYSTEM (WHEREVER REQUIRED)
 - 5) REDUNDANCY OF IO SHALL BE AS PER SPECIFICATION REQUIREMENT.
 - 6) FEEDBACK OF SOLENOID DRIVES IN VICINITY MAY BE GROUPED TOGETHER IN THE FIELD USING JUNCTION BOXES & SINGLE TRUNK CABLE OF HIGHER SIZE MAY BE USED TO CONNECT TO THE DCS.



PROJECT: 2X660 MW TANGEDCO UDANGUDI STAGE I STPP	DRG.NO.	PE-DM-435-145-1002
	DATE	05.11.2019
TITLE DDCMIS INTERFACE FOR SOLENOID DRIVE	REV.NO.	07
	SHT	9 OF 11

615965/2021/PS-PEM-MAX



TITLE:

**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.


BHEL DOCUMENTS NO.: PE-TS-435-164-A001

VOLUME **III**

REV. NO. 00


LIST OF SCHEDULES

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-435-164-A001	
		VOLUME III	
		REV. NO. 00	
	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT 2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		

MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION FOR EFFLUENT TREATMENT PLANT

SL. No	DOCUMENT / DRAWING NO.	DRAWING / DOCUMENT TITLE	SCHEDULE OF SUBMISSION FROM LOI (WEEK)	SIZE
1.	PE-V0-435-164-A001	P&I DIAGRAM FOR EFFLUENT TREATMENT PLANT	4	A1
2.	PE-V0-435-164-A002	LAYOUT PLAN FOR EFFLUENT TREATMENT PLANT INCLUDING SUMPS	4	A0
3.	PE-V0-435-164-A003	PROCESS SIZING CALCULATIONS FOR EFFLUENT TREATMENT PLANT	4	A4
4.	PE-V0-435-164-A004	SUB VENDOR LIST FOR EFFLUENT TREATMENT PLANT	10	A4
5.	PE-V0-435-164-A005	CONTROL PHILOSOPHY FOR EFFLUENT TREATMENT PLANT	10	A4
6.	PE-V0-435-164-A006	QAP FOR VALVES OF EFFLUENT TREATMENT PLANT	12	A4
7.	PE-V0-435-164-A007	QAP FOR HORIZONTAL / VERTICAL CENTRIFUGAL/SCREW PUMPS WITH MOTOR OF EFFLUENT TREATMENT PLANT	14	A4
8.	PE-V0-435-164-A008	QAP FOR METERING PUMPS WITH MOTOR OF EFFLUENT TREATMENT PLANT	12	A4
9.	PE-V0-435-164-A009	QAP FOR BLOWERS WITH MOTOR OF EFFLUENT TREATMENT PLANT	10	A4
10.	PE-V0-435-164-A010	QAP FOR ATMOSPHERIC TANKS OF EFFLUENT TREATMENT PLANT	12	A4
11.	PE-V0-435-164-A011	QAP / ICL OF EFFLUENT TREATMENT PLANT (FOR BALANCE OF ITEMS)	8	A4
12.	PE-V0-435-164-A012	ELECTRICAL LOAD LIST FOR EFFLUENT TREATMENT PLANT	10	A4
13.	PE-V0-435-164-A013	GA DRAWINGS FOR TANKS FOR EFFLUENT TREATMENT PLANT	24	A4
14.	PE-V0-435-164-A014	TECHNICAL DATASHEET OF VALVES FOR EFFLUENT TREATMENT PLANT	8	A4
15.	PE-V0-435-164-A015	TECHNICAL DATASHEET FOR INSTRUMENTS FOR EFFLUENT TREATMENT PLANT	20	A4
16.	PE-V0-435-164-A016	TECHNICAL DATA SHEET OF HORIZONTAL / VERTICAL CENTRIFUGAL/SCREW PUMPS FOR EFFLUENT TREATMENT PLANT	10	A4
17.	PE-V0-435-164-A017	TECHNICAL DATA SHEET FOR METERING PUMPS FOR EFFLUENT TREATMENT PLANT	12	A4
18.	PE-V0-435-164-A018	TECHNICAL DATA SHEET OF BLOWERS FOR EFFLUENT TREATMENT PLANT	10	A4
19.	PE-V0-435-164-A019	TECHNICAL DATASHEET FOR MOTORS	8	A4
20.	PE-V0-435-164-A020	TECHNICAL DATASHEET FOR AGITATORS FOR EFFLUENT TREATMENT PLANT	10	A4
21.	PE-V0-435-164-A022	MECH. GA OF SUMPS AND GUARD POND	10	A4
22.	PE-V0-435-164-A023	MECH. GA OF OIL WATER SEPARATOR AND INCLINED SURFACE SETTLERS	16	A4
23.	PE-V0-435-164-A024	PIPING LAYOUT FOR EFFLUENT TREATMENT PLANT	16	A0
24.	PE-V0-435-164-A025	YARD PIPING LAYOUT FOR EFFLUENT TREATMENT PLANT	16	A0
25.	PE-V0-435-164-A026	INSTRUMENT SCHEDULE FOR EFFLUENT TREATMENT PLANT	10	A3
26.	PE-V0-435-164-A027	VALVE SCHEDULE FOR EFFLUENT TREATMENT PLANT	10	A3
27.	PE-V0-435-164-A028	INSTRUMENT INSTALLATION/ HOOK UP DIAGRAMS	16	A4
28.	PE-V0-435-164-A029	FIELD JB TERMINATIONS /GROUPING DOCUMENT	16	A4
29.	PE-V0-435-164-A031	BLOCK LOGIC DIAGRAM	14	A4
30.	PE-V0-435-164-A032	MECHANICAL GA OF CHEMICAL HOUSE	14	A1
31.	PE-V0-435-164-A033	CABLE SCHEDULE (IN BHEL EXCEL FORMAT) & CABLE INTERCONNECTION DETAILS	16	A4
32.	PE-V0-435-164-A035	CABLE TRAY/TRENCH & CONDUIT ROUTING DIAGRAM AND EARTHING LAYOUT OF EFFLUENT TREATMENT PLANT	16	A1
33.	PE-V0-435-164-A036	QAP FOR PIPES	8	A4

	TITLE:	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT		BHEL DOCUMENTS NO.: PE-TS-435-164-A001	
		2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		VOLUME III	
				REV. NO. 00	


34.	PE-V0-435-164-A037	PG TEST PROCEDURE FOR EFFLUENT TREATMENT PLANT	16	A4
35.	PE-V0-435-164-A038	O&M MANUAL FOR EFFLUENT TREATMENT PLANT	20	A4
36.	PE-V0-435-164-A039	DATA SHEET AND GA FOR ISOLATION GATE	10	A4
37.	PE-V0-435-164-A040	PAINTING SPECIFICATION	8	A4
38.	PE-V0-435-164-A041	DATA SHEET FOR MOTORISED VALVE ACTUATOR	10	A4
39.	PE-V0-435-164-A042	QAP FOR OIL WATER SEPARATOR	12	A4
40.	PE-V0-435-164-A044	QAP FOR ISOLATION GATE	14	A4
41.	PE-V0-435-164-A045	QAP FOR FM, FLOCC, TUBE SETTLER FOR EFFLUENT TREATMENT PLANT	14	A4
42.	PE-V0-435-164-A046	SKID GA	12	A2
43.	PE-V0-435-164-A048	GA FOR SLOP OIL TANK	12	A3
44.	PE-V0-435-164-A049	QAP FOR SLOP OIL TANK	14	A4

1. Any additional drawings-documents required during detailed engineering stage shall be provided by bidder without any commercial, technical and delivery implication to BHEL and customer.

2. Bidder to note that the successful bidder, during detail engineering, will submit the drg/doc through web based Document Management System in addition to hard copies to be submitted as per the Annexure IV of this specification. Bidder would be provided access to the DMS for drg/doc approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.


- Internet explorer version – Minimum Internet Explorer 7
- Internet speed – 2 mbps (Minimum preferred)
- Pop ups from our external DMS IP (124.124.36.198) should not be blocked
- Vendor's internal proxy setting should not block DMS application's link (<http://124.124.36.198/wrenchwebaccess/login.aspx>)
- DMS user manuals to be used by BHEL PEM vendors for uploading, viewing, revising, commenting and tracking documents on PEM's DMS have been uploaded on PEM internet website (www.bhelpem.com) under the Vendor session.
- For quick access bidder may refer the link <http://bhelpem.com/DMSManuals/DMSManuals.html>

3. Re-submission of drawing/document shall be done within 10 days by supplier.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-435-164-A001	
		VOLUME III	
		REV. NO. 00	
	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT 2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		

MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION FOR SEWAGE TREATMENT PLANT

Sl. No.	DOCUMENT / DRAWING NO.	DRAWING / DOCUMENT TITLE	SCHEDULE OF SUBMISSION FROM LOI (WEEK)	SIZE
1	PE-V0-435-673-A001	P&I Diagram for Sewage Treatment Plant	4	A1
2	PE-V0-435-673-A002	PROCESS DESIGN AND SIZING CALCULATION INCLUDING PRESSURE DROP CALCULATIONS (STP)	4	A4
3	PE-V0-435-673-A003	Layout of Sewage Treatment Plant	4	A1
4	PE-V0-435-673-A004	Operation & Control Philosophy SEWAGE TREATMENT PLANT	6	A4
5	PE-V0-435-673-A005	Sub Vendor List & inspection criteria for SEWAGE TREATMENT PLANT	4	A4
6	PE-V0-435-673-A006	Data Sheet of Agitator for Sewage treatment plant	10	A4
7	PE-V0-435-673-A007	GA DRAWINGS OF ALL SEWAGE SUMPS FOR SEWAGE TREATMENT PLANT	10	A1
8	PE-V0-435-673-A008	GA DRAWING FOR ATMOSPHERIC TANK FOR SEWAGE TREATMENT PLANT	10	A1
9	PE-V0-435-673-A009	GA DRAWING FOR PRESSURE VESSEL FOR SEWAGE TREATMENT PLANT	10	A1
10	PE-V0-435-673-A010	MECH. GA DRAWINGS OF STP BUIDLING	10	A1
11	PE-V0-435-673-A011	MECH. GA OF LAMELLA TUBE SETTLER CLARIFIER FOR SEWAGE TREATMENT PLANT	10	A1
12	PE-V0-435-673-A012	DATA SHEET OF INSTRUMENTS FOR SEWAGE TREATMENT PLANT	10	A4
13	PE-V0-435-673-A013	DATA SHEET OF VALVES SEWAGE FOR TREATMENT PLANT	10	A4
14	PE-V0-435-673-A014	DATA SHEET OF MOTOR FOR SEWAGE TREATMENT PLANT	10	A4
15	PE-V0-435-673-A015	DATA SHEET OF SUBMERSIBLE PUMPS FOR SEWAGE TREATMENT PLANT	10	A4
16	PE-V0-435-673-A016	DATA SHEET OF SCREW PUMPS FOR SEWAGE TREATMENT PLANT	10	A4
17	PE-V0-435-673-A017	DATA SHEET OF CENTRIFUGAL PUMPS FOR SEWAGE TREATMENT PLANT	10	A4
18	PE-V0-435-673-A018	DATA SHEET FOR METERING PUMPS FOR SEWAGE TREATMENT PLANT	10	A4
19	PE-V0-435-673-A019	QAP FOR SUBMERSIBLE PUMPS WITH MOTOR FOR SEWAGE TREATMENT PLANT	10	A4
20	PE-V0-435-673-A020	QAP FOR SCREW PUMPS WITH MOTOR FOR SEWAGE TREATMENT PLANT	10	A4
21	PE-V0-435-673-A021	QAP FOR CENTRIFUGAL PUMPS WITH MOTOR FOR SEWAGE TREATMENT PLANT	10	A4
22	PE-V0-435-673-A022	QAP FOR METERING PUMP WITH MOTOR SEWAGE TREATMENT PLANT	10	A4
23	PE-V0-435-673-A023	QAP FOR VALVES SEWAGE TREATMENT PLANT	10	A4
24	PE-V0-435-673-A024	QAP FOR BLOWERS WITH MOTOR FOR SEWAGE TREATMENT PLANT	10	A4
25	PE-V0-435-673-A025	QAP FOR LAMELLA CLARIFIER TUBE SETTLER FOR SEWAGE TREATMENT PLANT	10	A4
26	PE-V0-435-673-A026	TECHNICAL DATA SHEET OF BLOWERS SEWAGE TREATMENT PLANT	10	A4
27	PE-V0-435-673-A027	YARD PIPING LAYOUT OF STP	16	A1

	TITLE:	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT		BHEL DOCUMENTS NO.: PE-TS-435-164-A001	
		2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		VOLUME III	
				REV. NO. 00	

28	PE-V0-435-673-A028	PIPING LAYOUT OF STP (INSIDE AREA)	10	A1
29	PE-V0-435-673-A029	Instrument Schedule SEWAGE TREATMENT PLANT	12	A4
30	PE-V0-435-673-A030	Valve Schedule SEWAGE TREATMENT PLANT	12	A4
31	PE-V0-435-673-A031	ELECTRICAL LOAD DATA SEWAGE TREATMENT PLANT	8	A4
32	PE-V0-435-673-A032	Cable Schedule FOR SEWAGE TREATMENT PLANT	16	A4
33	PE-V0-435-673-A033	Painting Schedule FOR SEWAGE TREATMENT PLANT	10	A4
34	PE-V0-435-673-A034	INSTRUMENT INSTALLATION/ HOOK-UP DRAWING	6	A4
35	PE-V0-435-673-A035	DRIVE LIST FOR SEWAGE TREATMENT PLANT	10	A4
36	PE-V0-435-673-A036	I/O LIST FOR SEWAGE TREATMENT PLANT	10	A4
37	PE-V0-435-673-A037	DATA SHEET AND GA FOR MBBR FOR SEWAGE TREATMENT PLANT	6	A4
38	PE-V0-435-673-A038	QAP FOR MBBR FOR SEWAGE TREATMENT PLANT	6	A4
39	PE-V0-435-673-A039	QAP FOR ATMOSPHERIC TANKS AND PRESSURE VESSELS FOR SEWAGE TREATMENT PLANT	6	A4
40	PE-V0-435-673-A040	CABLE SCHEDULE & CABLE INTERCONNECTION DETAILS FOR SEWAGE TREATMENT PLANT	10	A4
41	PE-V0-435-673-A041	PG TEST FOR SEWAGE TREATMENT PLANT	20	A4
42	PE-V0-435-673-A042	O & M Manual FOR SEWAGE TREATMENT PLANT	24	A4


1. Any additional drawings-documents required during detailed engineering stage shall be provided by bidder without any commercial, technical and delivery implication to BHEL and customer.

2. Bidder to note that the successful bidder, during detail engineering, will submit the drg/doc through web based Document Management System in addition to hard copies to be submitted as per the Annexure IV of this specification. Bidder would be provided access to the DMS for drg/doc approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.

- Internet explorer version – Minimum Internet Explorer 7
- Internet speed – 2 mbps (Minimum preferred)
- Pop ups from our external DMS IP (124.124.36.198) should not be blocked
- Vendor's internal proxy setting should not block DMS application's link (<http://124.124.36.198/wrenchwebaccess/login.aspx>)
- DMS user manuals to be used by BHEL PEM vendors for uploading, viewing, revising, commenting and tracking documents on PEM's DMS have been uploaded on PEM internet website (www.bhelpem.com) under the Vendor session.
- For quick access bidder may refer the link <http://bhelpem.com/DMSManuals/DMSManuals.html>

3. Re-submission of drawing/document shall be done within 10 days by supplier.

615965/2021/PS-PEM-MAX


	TITLE:	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT		BHEL DOCUMENTS NO.: PE-TS-435-164-A001
		2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		VOLUME III
				REV. NO. 00

SCHEDULE OF PRE-BID CLARIFICATION
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

All clarification from the Technical Specification shall be filled in by the BIDDER clause by clause in this format only.

VOLUME	SECTION	CLAUSE NO.	PAGE NO.	SPECIFICATION REQUIREMENT	CLARIFICATION	REASONS FOR CLARIFICATION

PARTICULARS OF BIDDER / AUTHORISED REPRESENTATIVE				
NAME	DESIGNATION	SIGNATURE	DATE	

	TITLE: TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT 2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.	BHEL DOCUMENTS NO.: PE-TS-435-164-A001 VOLUME III REV. NO. 00

SCHEDULE OF DEVIATION WITH COST OF WITHDRAWL
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

TENDER ENQUIRY REFERENCE:-

NAME OF BIDDER:-

SL NO	VOULME/ SECTION	PAGE NO.	CLAUSE NO.	TECHNICAL SPECIFICATION/ TENDER DOCUMENT	COMPLETE DESCRIPTION OF DEVIATION	COST OF WITHDRAWL OF DEVIATION	REFERENCE OF PRICE SCHEDULE ON WHICH COST OF WITHDRAWL OF DEVIATION IS APPLICABLE	NATURE OF COST OF WITHDRAWL OF DEVIATION (POSITIVE/ NEGATIVE)	REASON FOR QUOTING DEVIATION
-------	-----------------	----------	------------	--	-----------------------------------	--------------------------------	---	---	------------------------------

TECHNICAL DEVIATIONS

COMMERCIAL DEVIATIONS


PARTICULARS OF BIDDERS/ AUTHORISED REPRESENTATIVE

NAME	DESIGNATIONS	SIGN & DATE	

NOTES:

1. Cost of withdrawal of deviation will be applicable on the basic price (i.e, excluding taxes, duties & freight) only.
2. All the bidders has to list out all their Technical and Commercial Deviations (if any) in detail in the above format.

PARTICULARS OF BIDDER / AUTHORISED REPRESENTATIVE				
NAME	DESIGNATION	SIGNATURE	DATE	
				COMPANY SEAL

	TITLE:	TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT		BHEL DOCUMENTS NO.: PE-TS-435-164-A001
		2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.		VOLUME III
				REV. NO. 00

3. Any deviation not mentioned above and shown separately of found hidden in offer, will not be taken cognizance of.
4. Bidder shall submit duly filled unpriced copy of above format indicating "quoted" in "cost of withdrawal of deviation" column of the schedule above along with their Techno-commercial offer, wherever applicable. in the absence of same, such deviation(s) shall not be considered and offer shall be considered in total compliance to NIT
5. Bidder shall furnish price copy of above format along with price bid.
6. The final decision of acceptance/ rejection of the deviations quoted by the bidder shall be at discretion of the Purchaser.
7. Bidders to note that any deviation (technical/commercial) not listed in above and asked after Part-I opening shall not be considered.
8. For deviations w.r.t. Credit Period, Liquidated damages, Firm prices if a bidder chooses not to give any cost of withdrawal of deviation loading as per **Annexure-VII of GCC, Rev-07** will apply. For any other deviation mentioned in un-priced copy of this format submitted with Part-I bid but not mentioned in priced copy of this format submitted with Priced bid, the cost of withdrawal of deviation shall be taken as NIL.
9. Any deviation mentioned in priced copy of this format, but not mentioned in the un-priced copy, shall not be accepted.
10. All techno-commercial terms and conditions of NIT shall be deemed to have been accepted by the bidder, other than those listed in un-priced copy of this format.
11. Cost of withdrawal is to be given separately for each deviation. In no event bidder should club cost of withdrawal of more than one deviation else cost of withdrawal of such deviations which have been clubbed together shall be considered as NIL.
12. In case nature of cost of withdrawal (positive/negative) is not specified it shall be assumed as positive.
13. In case of discrepancy in the nature of impact (positive/ negative), positive will be considered for evaluation and negative for ordering.

PARTICULARS OF BIDDER / AUTHORISED REPRESENTATIVE				
NAME	DESIGNATION	SIGNATURE	DATE	COMPANY SEAL

615965/2024/PS-PEM-MAX



TITLE:

**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT**

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

BHEL DOCUMENTS NO.: PE-TS-435-164-A001

VOLUME **III**REV. NO.
00

**COMPLIANCE CUM CONFIRMATION SCHEDULE
[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]**

The bidder shall confirm compliance with following by signing/ stamping this compliance certificate and furnishing same with the offer:

- a.) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions/ deviations with regard to same.
- b.) QP/ test procedures shall be submitted in the event of order based on the guidelines given in the specification & QP enclosed therein.
QP will be subject to BHEL/TCE/TANGEDCO approval in the event of order & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc.
The charges for 3rd party inspection (Lloyds, TUV or equivalent) for imported components shall be included in the base price of the equipment by the bidder
- c.) All drawings/data – sheets etc. to be submitted during contract shall be subject to BHEL/TCE/TANGEDCO review/ approval. GA drawings, as submitted with offer at tender stage are for reference purpose only and shall be subject to approval during contract stage.
- d.) There are no other deviations with respect to specification other than those furnished in the 'Schedule of Deviations'
- e.) The offered materials shall be either equivalent or superior to those specified. Also for components where material is not specified it shall be suitable for intended duty, materials shall be subject to approval in the event of order.
- f.) The commissioning spares (if any) are supplied on 'As Required Basis' & prices for same included in the base price (If bidders reply to this is "No commissioning spares are required" and if some spares are actually required during commissioning same shall be supplied by bidder without any cost to BHEL/TCE/TANGEDCO).
- g.) All sub vendors shall be subject to BHEL/TCE/TANGEDCO approval
- h.) Any special tools & tackles, if required, shall be in bidder's scope.
- i.) Demonstration parameters shall stand valid till the satisfactory completion of demonstration test and its acceptance by BHEL/TCE/TANGEDCO.



TITLE:

TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT & SEWAGE TREATMENT PLANT

2 X 660MW UDANGUDI SUPERCRITICAL TPP STAGE-1.

BHEL DOCUMENTS NO.: PE-TS-435-164-A001

VOLUME III

REV. NO. 00

* Bidder shall include this schedule both in technical and Price offers

DECLARATION

[COMMON FOR EFFLUENT TREATMENT PLANT AND SEWAGE TREATMENT PLANT]

Icertify that all the technical data and information pertaining to this specification are correct and are true representation of the equipment/system covered by our format proposal number Dated and there is no deviation to the specification (except indicated in the deviation sheet (cost of withdrawal).

I hereby certify that I am duly authorized representative of the Bidder's company whose name appears above my signature.

Bidders Company Name

Authorised representative's
Signature

Name

Bider's Name

The bidder hereby agrees to fully comply with the requirements and intent of this specification for the price indicated.