

KAHALGAON TPS - FGD (4 X 210 + 3 X 500 MW)

OF
NTPC Limited
(A Government of India Enterprise)

TECHNICAL SPECIFICATION FOR COMPRESSED AIR SYSTEM

SPECIFICATION NO.: PE-TS-481-555-A001



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA (INDIA)**



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO: PE-TS-481-555-A001
VOLUME: II B & III
REV: 00
DATE: Nov. 20
SHEET: 1 OF 1

VOLUME – IIB

SECTIONS	TITLE	Page No
SECTION-A	INTENT OF SPECIFICATION	03
SECTION-B	PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA	06
SECTION-C	TECHNICAL SPECIFICATIONS	
SECTION-C1	SCOPE OF SUPPLY & SERVICES, TERMINAL POINTS, EXCLUSIONS AND OTHER PROJECT SPECIFIC DETAILS	19
SECTION-C2	CUSTOMER SPECIFICATION	
C2 - A	TECHNICAL REQUIREMENT	27
C2 - B	PROJECT SPECIFIC GENERAL REQUIREMENTS	56
C2 - C	PERFORMANCE GUARANTEE TESTS	169
C2 - D	QUALITY ASSURANCE	179
SECTION-C3	TECHNICAL SPECIFICATION (ELECTRICAL PORTION)	225
SECTION-C4	TECHNICAL SPECIFICATION (C&I PORTION)	261
SECTION-E	ANNEXURE-I	LIST OF MAKES OF SUB-VENDOR ITEMS
	ANNEXURE-II	PAINTING & COLOUR SCHEME
	ANNEXURE-III	MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION
	ANNEXURE-IV	SITE STORAGE AND PRESERVATION
	ANNEXURE-V	PACKING PROCEDURE
	ANNEXURE-VI	LIST OF OPERATIONAL SPARES

VOLUME-III

SECTIONS	TITLE	Page No
1	LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	409
2	COMPLIANCE CUM CONFIRMATION CERTIFICATE	411
3	PRE BID CLARIFICATION SCHEDULE	414
4	ELECTRICAL LOAD DATA	416
5	LIST OF DRAWINGS	
	DRG TITLE	DRG NO
	A SCHEMATIC DRAWING OF COMPRESSED AIR SYSTEM	0011-109-POM-A-006
6	Guaranteed Power Consumption for Compressed Air System	420 – 421.

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION NO: PE-TS-481-555-A001

VOLUME: II B

SECTION: A

REV: 00

DATE: Nov. 20

Sheet: 1 OF 3

SECTION-A

INTENT OF SPECIFICATION



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION NO: PE-TS-481-555-A001

VOLUME: II B

SECTION: A

REV: 00

DATE: Nov. 20

Sheet: 2 OF 3

1.0 INTENT OF SPECIFICATION

- 1.1 The specification is intended to cover design, engineering, manufacture, inspection and testing at vendor's/ sub-vendor's works, painting, forwarding, proper packing and shipment and delivery at site, unloading, handling & transportation at site, Erection & Commissioning, minor civil works as required on FOR site basis, Performance and guarantee testing and handing over of Compressed Air System as per details in different sections / volumes of this specification for 4 X 210 MW + 3 X 500 MW KAHALGAON TPS – FGD.
- 1.2 The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve the contractor of the responsibility of providing such facilities to complete the supply of Compressed Air System within quoted price.
- 1.3 It is not the intent to specify herein all the details of design and manufacturing. However, the equipment shall conform in all respects to highest standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance herewith.
- 1.4 The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing. Similarly, the extent of supply also includes all items required for completion of the system and not withstanding that they may have been omitted in drawings / specifications or schedules.
- 1.5 The general term and conditions, instructions to tenderers and other attachment referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification is subject to compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.
- 1.6 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under Vol-III of the specification **within 10 days of receipt of tender documents**. In absence of any such clarifications, in case of any contradictory requirement, the more stringent requirement as

**KAHALGAON TPS – FGD****COMPRESSED AIR SYSTEM****SPECIFICATION NO: PE-TS-481-555-A001****VOLUME: II B****SECTION: A****REV: 00****DATE: Nov. 20****Sheet: 3 OF 3**

per interpretation of Purchaser / Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.

- 1.7 The bidder's offer shall not carry any sections like clarification, interpretations and /or assumptions.
- 1.8 Deviations, if any, should be very clearly brought out clause by clause in the enclosed schedule; otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.
- 1.9 In case all above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.
- 1.10 Unless specified otherwise in GCC, all through the specification, the word contractor shall have same meaning as successful bidder /vendor and Customer/ Purchaser/Employer will mean BHEL and /or NTPC including their consultant as interpreted by BHEL in the relevant context.

247927/2021/PS-PEM-MAX



**KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM**

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : B

REV. 00

DATE: Nov. 20

SHEET : 1 OF 1

SECTION: B

**PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN
CRITERIA**

CLAUSE NO.	PROJECT INFORMATION
1.00.00 1.01.00 ~~1.02.00~~ ~~1.03.00~~ 1.04.00 ~~1.05.00~~ ~~1.06.00~~	 BACKGROUND Kahalgaon Super Thermal Power Station, KhSTPP was conceived as a Load Centre coal based Power Station of 1000 MW capacity by NTPC. The land for the project was acquired and Stage-I (4x210 MW) was implemented by NTPC. Thereafter, NTPC implemented Stage-II Phase –I (2x500 MW) and Stage-II Phase-2 (1x500 MW). Hence, the present capacity of the plant is 2340 MW. LOCATION AND APPROACH The plant is located in Bhagalpur district of Bihar, having latitude and longitude of 25° 15'N and 87°15'E respectively. Bhagalpur town is located at a distance of about 30 kms from the plant. Colgong (Kahalgaon) railway station on Patna Kolkatta broad (BG) section of Eastern Railway (NR) is 2 kms away. The nearest airport is located at Patna at a distance of approximately 250 km from the project site. ~~LAND~~ ~~A total area of about 3360 acres of land has been acquired for the project in Stage-I. The Stage-II Phase I & Phase –II is also located in the existing area as no additional land is acquired for these stages.~~ ~~WATER~~ ~~The project is located near river ganges. The make up water requirement for the plant is proposed to be drawn from river ganges. As per agreement between NTPC & Irrigation department, 180 Cusec (drawl) and 80 cusec (consumptive) water for both the stages of the project is available.~~ ~~Coal Quality Parameters / Fuel Oil Characteristics & Plant Water details:~~ ~~(i) The Coal quality parameters and Fuel Oil characteristics are indicated in Table-1 & Table-2 respectively below.~~ ~~(ii) Process water:~~ ~~Process water quality is CW Blowdown based on the COC indicated in Table-4.~~ ~~(iii) Clarified water:~~ ~~Clarified water quality is indicated in Table-4.~~ (iv) DM water for Equipment cooling water system. DM water quality is indicated in Table-5. ~~Steam Generator and ESP data: refer Table-6.~~ ~~Drawings are enclosed as per Table 7 for initial overview to the Bidder.~~
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9 SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II PAGE 1 OF 33

CLAUSE NO.	PROJECT INFORMATION			
2.00.00	NOT USED			
3.00.00	Capacity Stage-I 4 x 210 MW Stage-II 2 x 500 MW PHASE-I Stage-II 1 x 500 MW PHASE-II			
4.00.00	Metrological Data Not Used			
5.00.00	Criteria for Earthquake Resistant Design of Structures and Equipment All structures and equipment shall be designed for seismic forces adopting the site specific seismic information provided in this document and using the other provisions in accordance with IS:1893 (Part 1 to Part 4). Pending finalization of Part 5 of IS:1893, provisions of part 1 shall be read along with the relevant clauses of IS:1893:1984, for embankments. A site specific seismic study has been conducted for the project site. The peak ground horizontal acceleration for the project site, the site specific acceleration spectral coefficients (in units of gravity acceleration ‘g’) in the horizontal direction for the various damping values and the multiplying factor (to be used over the spectral coefficients) for evaluating the design acceleration spectra are as given at Appendix-I. Vertical acceleration spectral values shall be taken as 2/3rd of the corresponding horizontal values. The site specific design acceleration spectra shall be used in place of the response acceleration spectra, given at figure-2 in IS:1893 (Part 1) and Annex B of IS:1893 (Part 4). The site specific acceleration spectra along with multiplying factors specified in Appendix-I includes the effect of the seismic environment of the site, the importance factor related to the structures and the response reduction factor. Hence, the design spectra do not require any further consideration of the zone factor (Z), the importance factor (I) and response reduction factor (R) as used in the IS:1893 (Part 1 to Part 4).			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II	PAGE 2 OF 33

CLAUSE NO.	PROJECT INFORMATION			एनटीपीसी NTPC
	Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: a) Steel structures : 2% b) Reinforced Concrete structures : 5% c) Reinforced Concrete Stacks : 3% d) Steel stacks : 2%			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II	PAGE 3 OF 33

CLAUSE NO.	PROJECT INFORMATION		
	Method of Analysis Since most structures in a power plant are irregular in shape and have irregular distribution of mass and stiffness, dynamic analysis for obtaining the design seismic forces shall be carried out using the response spectrum method. The number of vibration modes used in the analysis should be such that the sum total of modal masses of all modes considered is at least 90 percent of the total seismic mass and shall also meet requirements of IS:1893 (Part 1). Modal combination of the peak response quantities shall be performed as per Complete Quadratic Combination (CQC) method or by an acceptable alternative as per IS:1893 (Part 1). In general, seismic analysis shall be performed for the three orthogonal (two principal horizontal and one vertical) components of earthquake motion. The seismic response from the three components shall be combined as specified in IS:1893 (Part 1). The spectral acceleration coefficient shall get restricted to the peak spectral value if the fundamental natural period of the structure falls to the left of the peak in the spectral acceleration curve. For buildings, if the design base shear (V_B) obtained from modal combination is less than the base shear ($\bar{V}_B$) computed using the approximate fundamental period (T_a) given in IS:1893:Part 1 and using site specific acceleration spectra with appropriate multiplying factor, the response quantities (e.g. member forces, displacements, storey forces, storey shears and base reactions) shall be enhanced in the ratio of $\bar{V}_B / V_B$. However, no reduction is permitted if $\bar{V}_B$ is less than V_B. Design/Detailing for Ductility for Structures The site specific design acceleration spectra is a reduced spectra and has an in-built allowance for ductility. Structures shall be engineered and detailed in accordance with relevant Indian/International standards to achieve ductility.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II	PAGE 4 OF 33

CLAUSE NO.	PROJECT INFORMATION 
	APPENDIX – I SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT The various site specific seismic parameters for the project site shall be as follows: 1) Peak ground horizontal acceleration : 0.28g 2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra a) for special moment resisting steel frames designed and detailed as per IS:800 : 0.07 b) For special concentrically braced steel frames designed and detailed as per IS:800 : 0.053 c) for special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.042 d) for RCC chimney, RCC Natural Draft Cooling Tower : 0.14 e) For Liquid retaining tanks : 0.084 f) for Steel chimney, Absorber tower, Vessels : 0.105 g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below, in general (excluding special structure/ configuration/materials) : 0.07 3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.14 Note: g = Acceleration due to gravity The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9 SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II PAGE 5 OF 33

CLAUSE NO.	PROJECT INFORMATION																																																																																																																																																																																																																																											
	 ANNEXURE-A <u>HORIZONTAL SEISMIC ACCELERATION SPECTRAL</u> <u>COEFFICIENTS</u> <u>In units of 'g' for KAHALGAON STPP</u> <table border="1"> <thead> <tr> <th rowspan="2">Period (Sec)</th> <th colspan="6">Damping Factor (as a percentage of critical damping)</th> </tr> <tr> <th>0.80%</th> <th>1%</th> <th>1.50%</th> <th>2%</th> <th>3%</th> <th>5%</th> </tr> </thead> <tbody> <tr><td>0.000</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td></tr> <tr><td>0.030</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td><td>1.000</td></tr> <tr><td>0.050</td><td>1.796</td><td>1.760</td><td>1.686</td><td>1.626</td><td>1.537</td><td>1.416</td></tr> <tr><td>0.050</td><td>1.796</td><td>1.760</td><td>1.686</td><td>1.626</td><td>1.537</td><td>1.416</td></tr> <tr><td>0.100</td><td>3.974</td><td>3.792</td><td>3.427</td><td>3.146</td><td>2.753</td><td>2.270</td></tr> <tr><td>0.100</td><td>3.974</td><td>3.792</td><td>3.427</td><td>3.146</td><td>2.753</td><td>2.270</td></tr> <tr><td>0.119</td><td>4.842</td><td>4.597</td><td>4.094</td><td>3.713</td><td>3.186</td><td>2.556</td></tr> <tr><td>0.120</td><td>4.842</td><td>4.627</td><td>4.130</td><td>3.742</td><td>3.209</td><td>2.570</td></tr> <tr><td>0.122</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.802</td><td>3.254</td><td>2.600</td></tr> <tr><td>0.125</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.321</td><td>2.643</td></tr> <tr><td>0.129</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.700</td></tr> <tr><td>0.134</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.150</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.200</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.250</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.300</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.350</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.400</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.450</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.500</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.550</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.594</td><td>4.842</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.598</td><td>4.806</td><td>4.627</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.600</td><td>4.793</td><td>4.615</td><td>4.206</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.611</td><td>4.707</td><td>4.532</td><td>4.205</td><td>3.879</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.632</td><td>4.551</td><td>4.381</td><td>4.065</td><td>3.878</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.654</td><td>4.395</td><td>4.231</td><td>3.926</td><td>3.745</td><td>3.340</td><td>2.776</td></tr> <tr><td>0.671</td><td>4.286</td><td>4.127</td><td>3.829</td><td>3.653</td><td>3.258</td><td>2.776</td></tr> <tr><td>0.700</td><td>4.109</td><td>3.956</td><td>3.670</td><td>3.501</td><td>3.123</td><td>2.661</td></tr> <tr><td>0.750</td><td>3.835</td><td>3.692</td><td>3.425</td><td>3.268</td><td>2.915</td><td>2.484</td></tr> <tr><td>0.800</td><td>3.595</td><td>3.461</td><td>3.211</td><td>3.064</td><td>2.733</td><td>2.329</td></tr> </tbody> </table>						Period (Sec)	Damping Factor (as a percentage of critical damping)						0.80%	1%	1.50%	2%	3%	5%	0.000	1.000	1.000	1.000	1.000	1.000	1.000	0.030	1.000	1.000	1.000	1.000	1.000	1.000	0.050	1.796	1.760	1.686	1.626	1.537	1.416	0.050	1.796	1.760	1.686	1.626	1.537	1.416	0.100	3.974	3.792	3.427	3.146	2.753	2.270	0.100	3.974	3.792	3.427	3.146	2.753	2.270	0.119	4.842	4.597	4.094	3.713	3.186	2.556	0.120	4.842	4.627	4.130	3.742	3.209	2.570	0.122	4.842	4.627	4.206	3.802	3.254	2.600	0.125	4.842	4.627	4.206	3.879	3.321	2.643	0.129	4.842	4.627	4.206	3.879	3.340	2.700	0.134	4.842	4.627	4.206	3.879	3.340	2.776	0.150	4.842	4.627	4.206	3.879	3.340	2.776	0.200	4.842	4.627	4.206	3.879	3.340	2.776	0.250	4.842	4.627	4.206	3.879	3.340	2.776	0.300	4.842	4.627	4.206	3.879	3.340	2.776	0.350	4.842	4.627	4.206	3.879	3.340	2.776	0.400	4.842	4.627	4.206	3.879	3.340	2.776	0.450	4.842	4.627	4.206	3.879	3.340	2.776	0.500	4.842	4.627	4.206	3.879	3.340	2.776	0.550	4.842	4.627	4.206	3.879	3.340	2.776	0.594	4.842	4.627	4.206	3.879	3.340	2.776	0.598	4.806	4.627	4.206	3.879	3.340	2.776	0.600	4.793	4.615	4.206	3.879	3.340	2.776	0.611	4.707	4.532	4.205	3.879	3.340	2.776	0.632	4.551	4.381	4.065	3.878	3.340	2.776	0.654	4.395	4.231	3.926	3.745	3.340	2.776	0.671	4.286	4.127	3.829	3.653	3.258	2.776	0.700	4.109	3.956	3.670	3.501	3.123	2.661	0.750	3.835	3.692	3.425	3.268	2.915	2.484	0.800	3.595	3.461	3.211	3.064	2.733	2.329
Period (Sec)	Damping Factor (as a percentage of critical damping)																																																																																																																																																																																																																																											
	0.80%	1%	1.50%	2%	3%	5%																																																																																																																																																																																																																																						
0.000	1.000	1.000	1.000	1.000	1.000	1.000																																																																																																																																																																																																																																						
0.030	1.000	1.000	1.000	1.000	1.000	1.000																																																																																																																																																																																																																																						
0.050	1.796	1.760	1.686	1.626	1.537	1.416																																																																																																																																																																																																																																						
0.050	1.796	1.760	1.686	1.626	1.537	1.416																																																																																																																																																																																																																																						
0.100	3.974	3.792	3.427	3.146	2.753	2.270																																																																																																																																																																																																																																						
0.100	3.974	3.792	3.427	3.146	2.753	2.270																																																																																																																																																																																																																																						
0.119	4.842	4.597	4.094	3.713	3.186	2.556																																																																																																																																																																																																																																						
0.120	4.842	4.627	4.130	3.742	3.209	2.570																																																																																																																																																																																																																																						
0.122	4.842	4.627	4.206	3.802	3.254	2.600																																																																																																																																																																																																																																						
0.125	4.842	4.627	4.206	3.879	3.321	2.643																																																																																																																																																																																																																																						
0.129	4.842	4.627	4.206	3.879	3.340	2.700																																																																																																																																																																																																																																						
0.134	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.150	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.200	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.250	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.300	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.350	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.400	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.450	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.500	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.550	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.594	4.842	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.598	4.806	4.627	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.600	4.793	4.615	4.206	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.611	4.707	4.532	4.205	3.879	3.340	2.776																																																																																																																																																																																																																																						
0.632	4.551	4.381	4.065	3.878	3.340	2.776																																																																																																																																																																																																																																						
0.654	4.395	4.231	3.926	3.745	3.340	2.776																																																																																																																																																																																																																																						
0.671	4.286	4.127	3.829	3.653	3.258	2.776																																																																																																																																																																																																																																						
0.700	4.109	3.956	3.670	3.501	3.123	2.661																																																																																																																																																																																																																																						
0.750	3.835	3.692	3.425	3.268	2.915	2.484																																																																																																																																																																																																																																						
0.800	3.595	3.461	3.211	3.064	2.733	2.329																																																																																																																																																																																																																																						
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9		SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II		PAGE 6 OF 33																																																																																																																																																																																																																																						

CLAUSE NO.	PROJECT INFORMATION			एनटीपीसी NTPC												
6.00.00	<u>CRITERIA FOR WIND RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT</u> All structures shall be designed for wind forces in accordance with IS:875 (Part-3) and as specified in this document. See Annexure – B for site specific information. Along wind forces shall generally be computed by the Peak (i.e. 3 second gust) Wind Speed method as defined in the standard. Along wind forces on slender and wind sensitive structures and structural elements shall also be computed, for dynamic effects, using the Gust Factor or Gust Effectiveness Factor Method as defined in the standard. The structures shall be designed for the higher of the forces obtained from Gust Factor method and the Peak Wind Speed method. Analysis for dynamic effects of wind must be undertaken for any structure which has a height to minimum lateral dimension ratio greater than “5” and/or if the fundamental frequency of the structure is less than 1 Hz. Susceptibility of structures to across-wind forces, galloping, flutter, ovalling etc. should be examined and designed/detailed accordingly following the recommendations of IS:875(Part-3) and other relevant Indian standards. It should be estimated if size and relative position of other structures are likely to enhance the wind loading on the structure under consideration. Enhancement factor, if necessary, shall suitably be estimated and applied to the wind loading to account for the interference effects. Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: <table><tr><td>a) Welded steel structures</td><td>:</td><td>1.0%</td></tr><tr><td>b) Bolted steel structures/RCC structures</td><td>:</td><td>2.0%</td></tr><tr><td>c) Prestressed concrete structures</td><td>:</td><td>1.6%</td></tr><tr><td>d) Steel stacks</td><td>:</td><td>As per IS:6533 & CICIND Model Code whichever is more critical.</td></tr></table>				a) Welded steel structures	:	1.0%	b) Bolted steel structures/RCC structures	:	2.0%	c) Prestressed concrete structures	:	1.6%	d) Steel stacks	:	As per IS:6533 & CICIND Model Code whichever is more critical.
a) Welded steel structures	:	1.0%														
b) Bolted steel structures/RCC structures	:	2.0%														
c) Prestressed concrete structures	:	1.6%														
d) Steel stacks	:	As per IS:6533 & CICIND Model Code whichever is more critical.														
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II	PAGE 9 OF 33												

CLAUSE NO.	PROJECT INFORMATION	एनटीपीसी NTPC	
	ANNEXURE-B SITE SPECIFIC DESIGN PARAMETERS The various design parameters, as defined in IS: 875 (Part-3), to be adopted for the project site shall be as follows: a) The basic wind speed “V_b” at ten metres above the mean ground level : 47 metres/second b) The risk coefficient “K₁” : 1.07 c) Category of terrain : Category-2		
7.00.0	FOUNDATION SYSTEM AND GEOTECHNICAL DATA		
7.00.01	Employer had carried out geotechnical investigation in the vicinity of proposed structures during the plant construction stage. The available boreholes in the vicinity of proposed structures are enclosed at Annexure-IV. The provided soil data is limited and the proposed foundation system is with the best efforts based on the available data. The onus of correct assessment / interpretation and understanding of the existing subsoil condition is on the Bidder. Owner is not responsible for any variation in the provided soil data and foundation system.		
7.00.02	The available soil data is of the vicinity of the proposed structures, therefore, bidder shall carryout his own detailed soil investigation for facilities under this package and shall be as per the scheme approved by owner. The scheme for geotechnical investigation shall be as given at Clause 7.07.00 and shall be approved by owner before execution. Geotechnical investigation work shall got executed by the Contractor through the agencies as mentioned in Clause No. 7.07.03. However, no time extension shall be given on account of soil investigation carried out by the Bidder. The geotechnical investigation report shall be prepared with detailed recommendations regarding type of foundation and allowable bearing pressure for various structures/ facilities and other soil parameters. The report shall be submitted for Owner’s approval prior to commencement of design of foundation.		
7.00.03	The furnished borelog details are specific to the co-ordinates where the boreholes have been carried out and are provided for bidder’s information only. Soil profile in the proposed area may vary with respect to the borelogs enclosed for bidder’s information. Bidder has to consider all such variations in his estimation, over the extent of the work to be carried out. The Bidder should note that nothing extra whatsoever on account of variation between soil data provided by Owner and that found by the Bidder during geotechnical investigation by him or during execution of works, shall be Payable		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II
		PAGE 10 OF 33	

CLAUSE NO.	PROJECT INFORMATION			एनटीपीसी NTPC																		
	TABLE-5 ANALYSIS OF DM WATER <table><tr><th>Sl.No.</th><th>Characteristics</th><th>Value</th></tr><tr><td>1.</td><td>Silica (Max.)</td><td>0.02 ppm as SiO2</td></tr><tr><td>2.</td><td>Iron as Fe</td><td>Nil</td></tr><tr><td>3.</td><td>Total hardness</td><td>Nil</td></tr><tr><td>4.</td><td>pH value</td><td>6.8 to 7.2</td></tr><tr><td>5.</td><td>Conductivity</td><td>Not more than 0.1 µs/cm</td></tr></table>				Sl.No.	Characteristics	Value	1.	Silica (Max.)	0.02 ppm as SiO2	2.	Iron as Fe	Nil	3.	Total hardness	Nil	4.	pH value	6.8 to 7.2	5.	Conductivity	Not more than 0.1 µs/cm
	Sl.No.	Characteristics	Value																			
	1.	Silica (Max.)	0.02 ppm as SiO2																			
	2.	Iron as Fe	Nil																			
	3.	Total hardness	Nil																			
	4.	pH value	6.8 to 7.2																			
	5.	Conductivity	Not more than 0.1 µs/cm																			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-II-A3 PROJECT INFORMATION KHSTPP-I& II	PAGE 30 OF 33																		

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C

REV. 00

DATE: Nov. 20

Sheet: 1 of 1

SECTION: C

TECHNICAL SPECIFICATIONS



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C1

REV. 00

DATE: Nov. 20

SHEET 1 OF 1

VOLUME - II B

SECTION: C1

**SCOPE OF SUPPLY & SRVICES, TERMINAL
POINTS, EXCLUSIONS AND OTHER PROJECT
SPECIFIC DETAILS**

	KAHALGAON TPS – FGD		SPECIFICATION No: PE-TS-481-555-A001	
			VOLUME - IIB	
	COMPRESSED AIR SYSTEM		SECTION C1	
			REV.00	DATE: Nov. 20
			SHEET: 1 OF 7	

1. SCOPE OF WORK:

The specification covers Supply part, Services part and Mandatory Spares comprising of design (i.e. preparation and submission of drawing /documents including "As Built" drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor's works, painting, maintenance tools & tackles, fill of lubricants & consumables, Mandatory spares along with spares for erection, start up and commissioning as required, forwarding, proper packing, shipment and delivery at site, unloading, handling, transportation & storage at site, in-site transportation, assembly, erection & commissioning, final painting at site, minor civil work, trial run at site, preparation of layout drawings and carrying out Performance guarantee tests at site, training of customer/client and O&M staff and handover in flawless condition of the package to the end customer complete with all accessories for the total scope defined as per BHEL NIT & tender technical specification, amendment & agreements till placement of order for 4 X 210 MW + 3 X 500 MW KAHALGAON TPS - FGD.

Items not specifically mentioned but deemed necessary by the Tenderer for making the system completely reliable and efficient shall also be considered as if included.

2. SCOPE OF SUPPLY:

Scope of supply by bidder shall include but not limited to the following:

- 2.1 Two (2) Nos. Air Compressors (Oil Free Screw type) each of minimum 15 NM³/Min capacity at 8.5 Kg/cm² (g) discharge pressure, along with motor, suction filter with silencer, inter cooler and after cooler with moisture separators, automatic drain traps, instruments, control system and other accessories.
- 2.2 Two (2) Nos. Air Drying Plants Heat of Compression (HOC) - Rotary / Twin tower type of min. 15 NM³/min. capacity with all instruments, control panels and other accessories as specified.
- 2.3 Two (2) nos air receivers of 02 cu.m capacity located near the compressor house building.
- 2.4 Sequential panel for ensuring equal no. of running hours of each compressor – 1 No.
- 2.5 Online Electronic Dew point meter.
- 2.6 Pipes & fittings for compressed air line, cooling water & drain line including hanger/supports, auxiliary structural members etc. inclusive of all fittings, flanges & Counter flanges, bolts, nuts, gaskets etc. at all piping terminals.
- 2.7 All airline valves, cooling water valves, drain valves etc.– 1 Lot.
- 2.8 Necessary instruments for control and interlocks, instruments indicated in the P&I Diagram for the compressed air system to be considered as a minimum. Any additional instrument / valves required for successful operation of the system, to the discretion of BHEL, shall be provided to BHEL by successful bidder without any price implication.
- 2.9 Access platform required for the maintenance of instruments/valves on the towers of HOC type air drier, air receiver shall be in bidder's scope of supply.
- 2.10 Maintenance tools and tackles, consumables, first fill of lubricants inclusive of packing – 1 Lot.
- 2.11 Commissioning spares with proper packing suitable for long duration storage – 1 Lot (refer Annexure-VI).

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME - IIB	
		SECTION C1	
		REV.00	DATE: Nov. 20
		SHEET: 2 OF 7	

2.12 Mandatory Spares as specified in the price schedule inclusive of proper packing for long duration storage purpose – 1 Lot.

2.13 Compressor & Dryer mounted local control panel.

2.14 Erection, start up and commissioning consumable & spares as required for completing these activities.

2.15 All flanges, fasteners and counter flanges at all TPs.

2.16 Pipe supporting structure over the insert plate for pedestal supported pipe, wall supported pipe, insert plate and supporting structure for floor supported pipe.

2.17 All MS structures for cross overs, valve, instrument, equipment operating and maintenance platform; approach ladder for access to pit/ trench.

2.18 All Equipment base plate, foundation anchor bolts.

2.19 Grout for civil work grouting below base plate for all structures/equipment & for grouting of foundation / anchor bolt.

2.20 Paint required for painting of all items under the package for corrosion protection and to meet color coding required by customer.

2.21 Hoses for O&M purpose etc and other accessories as required - 1 no.

2.22 Any other item mentioned under NTPC specification and enclosed under Section SECTION-C2 of this Specification

2.23 Any other item covered under the price format.

2.24 Electrical scope as per details furnished under Section – C3: TECHNICAL SPECIFICATION (ELECTRICAL PORTION).

2.25 Instrumentation & control System including instruments, interlocking & protection devices with bare minimum instrumentation as shown in P&I Diagram of Compressed Air System (SCHEMATIC DRAWING OF COMPRESSED AIR SYSTEM) and any other instruments required for safe, efficient and reliable operation of the system and to be read in conjunction with C&I portion of specification (Refer Section – C4).

2.26 Any other item required for making the installation complete in all respect and for satisfactory operation of the system , meet layout and accessibility & operability requirements for the scope within the terminal point , for compliance to GTR (General Technical Requirement), GCC (General Condition of Contract) , SCC (Special Condition of Contract), ECC (Erection condition of contract) as relevant to Compressed Air System as well as to meet any statutory requirement relevant to the package, unless specifically EXCLUDED from scope of supply.

3. SCOPE OF SERVICES:

Scope of services by bidder shall include but not necessarily limited to the following:

3.1 Erection & Commissioning of Compressed Air System.

3.2 Unloading, Storage, handling and transportation at site (Pl. refer Section-E, Annexure - IV).

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME - IIB	
		SECTION C1	
		REV.00	DATE: Nov. 20
		SHEET: 3 OF 7	

3.3 Minor civil work like requirement of wall opening (if applicable), grouting below base plate for all structures, equipment, grouting of anchor bolts wherever these are not placed in the foundation during casting of foundation itself.

3.4 Pre- Commissioning work such as flushing, hydraulic testing etc. Necessary consumables and instrumentation as required for inspection and testing at works as well as at site including pre-commissioning activities shall be arranged by the successful bidder at their own cost.

3.5 Performance Guarantee test (Refer Section C2-C).

3.6 Painting of all items within bidder's scope of supply equipment within the battery limit.

3.7 Electrical scope as per enclosure elsewhere in the specification.

3.8 Preparation of drawing showing common facilities, if any, between BHEL & Vendor supplied equipment.

3.9 Supply of temporary equipment and services for Erection, commissioning and test etc. as applicable.

3.10 Making good/ repairing/ replacement of any damage done by the bidder to adjacent structures, pipes, etc. while erecting and commissioning equipment related to Compressed Air System

3.11 Site support during DCS commissioning.

3.12 Any other services mentioned under NTPC specification and enclosed under SECTION-C2 of this Specification.

3.13 Any other service covered under the price format.

3.14 Preparation of civil assignment drawings i.e. pedestals details, insert plates / embedment's plates required for supporting pipes and equipment etc. and review of civil drawing prepared by customer based on civil assignment drawing of bidder. In case any modification is required in the civil work already done based on civil inputs given by vendor, rework shall be done at the cost and risk of the vendor.

3.15 Training of plant Owner's personnel, O&M operators' personnel on plant and Equipment operation and maintenance.

3.16 Any other services required for making the installation complete in all respect and for satisfactory operation of the system , meet layout and accessibility & operability requirements for the scope within the terminal point , for compliance to GTR (General Technical Requirement), GCC (General Condition of Contract) , SCC (Special Condition of Contract), ECC (Erection condition of contract) as relevant to Compressed Air System as well as to meet any statutory requirement relevant to the package, unless specifically EXCLUDED from scope of supply.

4. EQUIPMENT SELECTION & DESIGN CRITERIA

The minimum design criteria/ technical details to be followed for various equipment shall be as per Data Sheets / Design criteria under Section – C2 including NTPC specification and other details placed elsewhere in the specification. In case of any contradictory requirement for specification of particular equipment, and clarifications not having been sought by the bidders, the most stringent requirement as per interpretation of the BHEL will prevail. Successful bidder will furnish detailed data sheets/ specifications / design calculations for various equipment for customer's/ consultant's approval during detail engineering. For items

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME - IIB	
		SECTION C1	
		REV.00	DATE: Nov. 20
		SHEET: 4 OF 7	

for which specific technical specification is not enclosed, data sheet / dwgs / design calculations for such items shall be subject to customer/ consultant approval during detail engineering. All comments made by customer/ consultant shall be incorporated by the successful bidder without any commercial and delivery implication.

5. TERMINAL POINTS:

5.1 Bidder shall terminate compressed air piping, common for IA and SA at outlet of air receiver (100 NB header), approx. 5M away from vicinity of Compressor house.

5.2 Cooling water supply will be provided by the purchaser outside the compressor house (5m within vicinity of Compressor house). The return hot water shall be terminated by the contractor at the same location. Parameters at T.P. shall be as below:
INLET TEMP. TO PHE :38 °C
DESIGN PRESSURE = 10 KG/SQ.CM(G)
Pipe Size at cooling water T.P. = 100 NB (both for inlet & outlet)

5.3 All the drains shall be terminated to plant garland drain outside compressor house by bidder.

6. EXCLUSIONS:

6.1 MCC / Switchgear for power supply to Air Compressors and other drives and panels.

6.2 Civil works like construction of compressor house, foundation of all compressor, air dryer and air receiver, pipe/cable trenches.

6.3 Lighting and ventilation of compressor house.

6.4 Fire protection & Detection system of Compressor House.

6.5 Monorail with Electric Hoists as necessary for handling of equipment after erection.

6.6 DCS control. However, all logic for implementation of control and monitoring from DCS shall be provided by successful bidder during detail engineering.

6.7 Relevant exclusion as per GTR, GCC, SCC & ECC.

6.8 Exclusions, if any, indicated in Electrical and C&I portion of the technical specification.

7. SERVICES TO BE PROVIDED BY THE CUSTOMER

Relevant services as per GCC, SCC & ECC.

8. PERFORMACE GUARANTEES

Performance test for CAS shall be carried as per Section – C2-C.

All consumable and instruments required during PG Test will be arranged by the bidder. Instruments will be duly calibrated from customer authorised/ approved laboratory.

9. QUALITY ASSURANCE, QUALITY PLANS, INSPECTION & TESTING PROCEDURE



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001	
VOLUME - IIB	
SECTION C1	
REV.00	DATE: Nov. 20
SHEET: 5 OF 7	

For Quality assurance, Quality Plans and Inspection & Testing, pl. refer Section – C2-D.
The quality requirements specified are only indicative, any additional test, as required by NTPC shall be provided by bidder without any commercial and delivery implication to BHEL.

10. SUB-VENDOR ITEMS

The make of Sub-vendor items shall be generally as per enclosed sub vendor list, which is subject to customer approval during detail engineering (Refer).

The tentative make of Sub-vendor items shall be generally as per Section-E, Annexure-I enclosed which is subject to NTPC approval during detail engineering. Make of any unlisted items shall be subject to NTPC approval during detail engineering. For such items, bidder to furnish list of sub-vendors during detail engineering stage for BHEL's review and approval. Bidder shall furnish the following supporting documentation within 1 month of placement of LOI. Thereafter no request for additional sub-vendor shall be entertained.

- a) Documentation to show that the equipment /system has been supplied for a plant of similar or higher capacity.
- b) Documentation in the form of certificate that the equipment/system has been operating satisfactorily for one year.
- c) Filled NTPC sub-questionnaire with complete credentials.

The successful bidder will get the makes of all items approved from Customer/ Consultant during detail engineering within two months of placement of LOI. The complete list of sub vendors will necessarily be submitted by the successful bidder within one month of placement of LOI.

Bidder to assess the capability of their proposed sub-vendors in terms of preparation of drawings, calculations, documents, quality assurance, supply of material etc. as per project schedule before placing the order on them.

Dealers are not acceptable for any item of the package. Bidder shall procure all items including plates, structural, flanges, counter flanges etc. from approved sub vendor only.

11. DRAWINGS AND DOCUMENTS TO BE SUBMITTED WITH THE BID

The drawings and documents to be submitted with the bid shall strictly be as mentioned under Volume III (section-1). Any documents other than those indicated in Volume III (Section-1) will not be reviewed and will not form part of contract.

12. DRAWINGS/ DOCUMENTS REQUIRED DURING DETAIL ENGINEERING

Tentative list of drawing / document required during detail engineering is attached in Volume-II (Refer Section-E, Annexure-III). Any other drawings and documents as required by BHEL / Customer / Consultant shall be furnished by the successful bidder during detail engineering stage for which no commercial implication shall be entertained by BHEL.

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME - IIB	
		SECTION C1	
		REV.00	DATE: Nov. 20
		SHEET: 6 OF 7	

13. DRAWINGS DISTRIBUTION SCHEDULE

Vendor needs to submit drawing/document during detail engineering along with editable soft copy of the same (Refer Section C2-B).

14. DRAWINGS ENCLOSED WITH THE SPECIFICATION

Following drawings enclosed will form part of the specification.

- 1) SCHEMATIC DRAWING OF COMPRESSED AIR SYSTEM (Pl. refer section 5, Vol.-III).

The P&I diagrams are indicative and show the minimum requirement to be followed including minimum requirement of instruments. Any other item and instruments required (within the terminal points) to make the system complete in all respect and for satisfactory operation of the system shall also deemed to have been included by the bidder in their scope. The detailed P&I diagrams for compressed air system in line with specification requirement shall be developed by the vendor during detail engineering for customer's approval and without any commercial implication to customer. Bidder to note that the while preparing PIDs after placement of order, successful bidder shall incorporate line numbers Instrument tag nos., KKS Numbering, equipment no, Line Spec, Line MOCs, legend / symbol chart, equipment capacity, relief valve capacity and set pressure, control valve capacity, range, fail position etc. in these drawing and same are subject to the customer approval.

15. ADDITIONAL POINTS TO BE NOTED BY BIDDER

- 15.1 Compressed Air system shall be offered as turnkey basis meeting specification requirements.
- 15.2 Basis of design, all calculations, equipment selection criterion, layout drawings/schemes/G.A. drg. and documents like data sheet/Technical particulars etc. are subject to Customer & BHEL approval during detail engineering stage.
- 15.3 All commissioning spares & consumables for trouble free operation shall be provided, with minimum to what specified elsewhere in the specification.
- 15.4 Performance test for compressors shall be carried out at shops with job motor only.
- 15.5 Compressor and air dryer shall be designed for cooling water (passivated DM water) with inlet temp of thermal 38 deg C (max.). Further the temperature of the air at the outlet of after cooler shall be limited to 7 deg.C above cooling water inlet temperature i.e. outlet air temperature from air dryer in any case shall not be more than 45 deg. C. The Compressors coolers, dryer's coolers & / or after coolers shall be designed to withstand 10 kg/cm² i.e., shutoff head of BHEL DM cooling water pumps. The pressure drop across the complete cooling water circuit shall be 10 MWC. Successful bidder shall furnish break-up of pressure drop for individual components and compressors as a whole in the datasheet to be submitted for approval at the time of detail engineering.
- 15.6 Corrosion allowance of 3 mm shall be provided for air receiver.
- 15.7 Only KKS tagging shall be used in all document/drawings and in the field for all items/equipment/signals etc. No other tagging method is acceptable. The successful bidder shall provide detailed drawing with KKS only. Operational write up of the system should strictly contain KKS code for identification and description.
- 15.8 Packaging of items / equipment and mandatory spares (Pl. refer Section-E, Annexure - V).

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME - IIB	
		SECTION C1	
		REV.00	DATE: Nov. 20
		SHEET: 7 OF 7	

15.9 Inspection & testing (Refer Section C2-D).

16. LAYOUT CONSIDERATIONS

16.1 A separate Compressed Air System building, housing compressors with drives, air drying units, headers, piping, supports, valves etc. has been envisaged.

16.2 The air receivers will be located outdoors adjacent to the compressor room.

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C2

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C2

CUSTOMER SPECIFICATIONS

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C2-A

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C2-A

TECHNICAL REQUIREMENT

CLAUSE NO.	SCOPE OF SUPPLY & SERVICES			
3.00.00	~~g) Contractor shall provide microprocessor/PLC/GIU based control system for control and monitoring of ventilation system as per manufacturer's standard practice. Control and monitoring of ventilation system from FGD control system is also acceptable.~~			
	COMPRESSED AIR SYSTEM a) Two (2) numbers (1 working+ 1 standby) oil free, rotary screw type air compressors for Instrument air and service air applications for FGD plant each of adequate capacity & adequate pressure, with their motor drives and other accessories as per equipment sizing criteria mentioned in Part A, Sub-section 'Salient design data' of technical specification. However, minimum capacity of each air compressor shall be 15Nm³/min at discharge pressure of 8.5 Kgf/cm² (g). b) Two (2) numbers (1 working+ 1 standby) Air Drying Plants (one for each air compressor) of adequate capacity with all interconnecting piping, valves, fittings, etc. c) Two number Air Receiver each of capacity 2 m³ (normal) at the discharge of each Air compressor. ~~d) Monorail with electric hoist of minimum 2 tons or 125% of heaviest parts of equipment to be lifted whichever is more.~~ e) Complete instruments, control system with panels as required for compressed air system. f) Complete compressed air and piping network for service air and instrument air application in FGD system shall be as per Tender drawing of compressed air system. g) Supply of Mandatory spares as specified. h) Any additional items required to make the system complete.			
4.00.00	General i. All associated Civil & structural work for air conditioning and Ventilation system and compressed air system. ii. Set of commissioning spares as may be required during erection and commissioning. iii. One (1) set Special tools and tackles required for maintenance of all the Mechanical, Electrical and C & I equipment under the scope of bidder. iv. All steel / cast iron inserts, plates, bolts, nuts, sleeves, metallic-fasteners etc. to be grouted in concrete work and used to hold/ support the equipment/piping / ducting being supplied and erected under this specifications. v. Any additional items required to make the system complete.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM & COMPRESSED AIR SYSTEM	Page 3 of 4

CLAUSE NO.	SCOPE OF SUPPLY & SERVICES	एनटीपीसी NTPC		
	vi. Initial charge of all lubricants and grease, etc. Further, all consumables required for PG tests shall also be in Bidder's scope of supply. Grouting, dressing and final finishing of all foundations of various equipment, etc. vii. Repairing and making good/ sealing of cutouts / openings in floors, roofs and walls, for executing the works under this system and making them water tight as directed by the engineer. Corrosion protection painting for all equipment / items by Bidder as detailed in relevant clauses of technical specification.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM & COMPRESSED AIR SYSTEM	Page 4 of 4	

CLAUSE NO.	SALIENT DESIGN DATA	एनडीपीसी NTPC		
~~7.04.00~~ Fire Detection, Alarm and Control System Design Philosophy (Fire Alarm and Detection System) i. The addressable type panels at FGD Control equipment rooms shall receive signal from sensors from various areas/ equipments of the respective units. This shall give audio-visual annunciations for fire in each of the risk area / equipment / status of the fire protection system as well as system operator open / short circuit status of detector or control cabling, etc. Further, this shall activate a hooter/sounder in each of the area provided with fire/smoke detection system ii. Alarms from the FGD fire alarm panel shall be repeated simultaneously in repeater panel at Fire station. Also the fire alarms of this area has to be communicated to the main plant Fire alarm control panel through potential free contacts. iii. The addressable panel shall evaluate the signals received from the detectors, transmit the fire or trouble alarms (audio-visual) to prearranged points, supervise and monitor the complete fire detection & extinguishing circuits, initiate control functions like shutdown of draft fans, air-conditioning and ventilation plant/equipment, closure of Fire dampers in A/C & Ventilation system etc. Opening smoke extraction vents, switching on smoke extraction equipment emergency lighting, tripping of transformer lockout relays etc. iv. All the circuits from the detectors to the panels and the circuits from the panels to the actuating devices (such as solenoid valves, deluge valves, push buttons etc.) shall be closed loop type and shall be supervised for open and short circuiting. The trouble signal also be annunciated in the respective panels. v. Facilities shall be provided on the fire alarm panel for simulating fire conditions, sensitivity adjustment, isolation of detectors etc. from the panel. 8.00.00 Compressed Air System DESIGN CRITERIA / BASIS AND PERFORMANCE GUARANTEE 1. All the equipments shall be designed for continuous duty and as well as for intermittent operation. Frequent start/stop of the system shall not result deterioration in performance nor damage to the equipment. 2. The compressors and Air Drying plants shall operate under the following ambient conditions. i. Minimum temperature : 10 deg.C ii. Maximum temperature : 50 deg. C iii. Design condition (temperature & Relative humidity) : 45 deg.C& 75% RH iv. Height above MSL (m) : (+) 35 M 3. The design ambient conditions for the motors shall be as mentioned in relevant Electrical sub-sections.				
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-V SALIENT DESIGN DATA	PAGE 21 OF 23	

CLAUSE NO.	SALIENT DESIGN DATA			एनटीपीसी NTPC																				
8.01.00 a)	Selection of Capacity of Air Compressor Air Compressor Air Compressor shall be designed to meet the Instrument air and service air requirement of all the equipments/plant/systems to be supplied by the Contractor for FGD Plant as follows:- <table><thead><tr><th>Sl. No.</th><th>Continuous Requirement</th><th colspan="2">Quantity (in NM³/min)</th></tr></thead><tbody><tr><td>1.</td><td>Instrument air requirement for FGD plant (Continuous)</td><td colspan="2">A</td></tr><tr><td>2.</td><td>Service air requirement for FGD plant</td><td colspan="2">B</td></tr><tr><td>3.</td><td>Total Air requirement</td><td>=</td><td>A+B</td></tr><tr><td>4.</td><td>Capacity of air compressor</td><td>=</td><td>2(A+B)</td></tr></tbody></table> Notes: While calculating the air requirement of Bidder's equipments/plant/systems, for continuous requirements of instrument air and service air, no diversity factor shall be considered and they are to be assumed to be of "Simultaneous Requirements". The intermittent requirement of instrument air and service air, if any shall be converted into continuous requirement by considering frequency of such requirements or selecting an appropriate diversity factor and such diversity factor shall not be less than 0.4. 1. The capacity of air drying plant shall be equal to the capacity of the individual air compressors. The Air drying plant, at its rated capacity, shall be designed to deliver continuously air at dew point of minus (-) 40 deg C at atmospheric pressure and the Quality of dry outlet air to conform to Instrument Society of American Standard S7.3 "Quality Standard for Instrument Air". 2. Discharge pressure available at the outlet of Air drying Plant shall be minimum 7.5 Kg/cm2 (g) or more as per the requirement of Contractor. 3. The discharge pressure of compressor shall be minimum 8.5 Kg/cm² (g). 4. The heat exchangers are DMCW cooled and the maximum cooling water temperature at compressor coolers inlet to be considered same as that of PHE outlet cooled DMCW temperature. 5. The temperature rise of cooling water in the heat exchangers of the Compressed air system shall be limited to 5-10 deg C. 6. Noise level shall not exceed 85 dBA to a reference level of 0.0002 microbar when measured at a distance of 1.5 meter above the floor. Required acoustic enclosures may be provided to meet the above condition. The discharge blow-off silencer and intake silencers shall be designed to meet the above noise limitation level. 7. Parallel operation of compressors shall be possible without any undue vibration and noise.				Sl. No.	Continuous Requirement	Quantity (in NM ³ /min)		1.	Instrument air requirement for FGD plant (Continuous)	A		2.	Service air requirement for FGD plant	B		3.	Total Air requirement	=	A+B	4.	Capacity of air compressor	=	2(A+B)
Sl. No.	Continuous Requirement	Quantity (in NM ³ /min)																						
1.	Instrument air requirement for FGD plant (Continuous)	A																						
2.	Service air requirement for FGD plant	B																						
3.	Total Air requirement	=	A+B																					
4.	Capacity of air compressor	=	2(A+B)																					
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-V SALIENT DESIGN DATA	PAGE 22 OF 23																				

CLAUSE NO.	SALIENT DESIGN DATA			
	8. The flow in compressed air piping shall be designed for the design capacity of each compressor and the flow in header and ring mains to be designed for the total capacity of working compressors. 9. All hot vessels/pipelines/ valves shall be insulated to restrict the outside temperature within 60 deg.C or less with mineral wool (or equivalent), GI wire netting and aluminum cladding/cover. ~~9.00.00 LIMESTONE AND GYPSUM HANDLING PLANTS~~ ~~9.01.00 Refer Part B section I M6 of technical specification.~~			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-V SALIENT DESIGN DATA	PAGE 23 OF 23	

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	COMPRESSED AIR SYSTEM			
1.00.00	SYSTEM DESCRIPTION			
1.01.00	The compressed air system shall consist of Air compressors & their motor drives, Air Drying (ADPs) Plants, air receivers for each Air compressors, instrumentation and control, control panels, compressed air piping, Instrument Air Piping network, service air piping network etc.			
1.02.00	Air from air compressors shall be dried in respective Air Drying Plants in compressor house and delivered to the Air receivers. From the Compressed air piping header at the downstream of Air receivers, one common header to be provided to meet the service and instrument air requirement for FGD Plant.			
2.00.00	SCREW AIR COMPRESSORS			
	The minimum requirements of design and construction features of various components of Compressed air system (screw type air compressor, air dryer, air receiver, etc.) are described below.			
2.01.00	CODES AND STANDARDS			
2.01.01	The design, manufacture, testing and performance of the various components of the Rotary Screw type Air Compressors shall comply with the requirements of relevant codes (IS-5456, IS-10431 [part -1], ASME PTC-9, IS-6206, IS-5727 and CAGI).			
2.01.02	Other International Standards like American/BS/DIN etc. equivalent or superior to above mentioned standards are acceptable. Where IS specification is not available, the equipment shall conform to one such International Standard, which shall be indicated in the proposal.			
2.01.03	The materials of the various components shall conform to the applicable IS/BS/ASTM/DIN Standards.			
2.02.00	DESIGN AND CONSTRUCTION			
2.02.01	The compressor shall be oil free multistage, horizontal, water cooled, rotary screw type, heavy duty, rugged construction. Their speed shall be so selected as to result in low maintenance and trouble-free operation under specified conditions.			
2.02.02	The rotor and shaft shall be of single piece construction, made of forged steel (AISI C1141 or equivalent). The stator (casing) shall be of Cast-Iron (IS-210 grade) Construction with integral jacket cooling. The rotors shall be dynamically balanced to reduce vibration.			
2.02.03	The seal rings and retainers shall be of stainless steel construction and be free for radial self adjustment along the rotor shafts.			
2.02.04	Bearings shall be high precision antifriction type IS- 25 Grade 84). The axial thrust load shall be minimized by dividing the axial load of compression on the main and auxiliary bearings through suitable balancing arrangement.			
2.02.05	Lubrication system shall be as per manufacturer standard practices			
2.03.00	Gear Box			
2.03.01	Gears shall have a rating of AGMA-12 or equivalent. Speed increasing gears between the motor and compressor stages shall consist of a common helical gear driving the pinion of each stage. Helical timing gears shall be mounted on the rotor shafts to maintain accurate relative rotor position.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM	PAGE 1 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
3.00.00	PERFORMANCE REQUIREMENT		
3.01.00	Air Compressors (screw type) shall be designed for continuous operation with high efficiency to satisfy the performance requirement as per approved data sheet submitted by the bidder during detailed engineering.		
3.02.00	The power rating of the driver shall be selected such that a minimum margin of 10% is available over the power required to deliver rated capacity against rated pressure.		
3.03.00	As more than one compressor with drive is specified, satisfactory operation in parallel shall be ensured without any uneven load sharing, undue vibration, keeping noise level within permissible limits for a number of compressors working simultaneously in the same room.		
4.00.00	INTERCOOLER, AFTERCOOLER & OIL COOLERS (FOR SCREW)		
4.01.00	Intercoolers, After coolers and Oil coolers shall be of water cooled & shell-and-tube type with water on the tube side. Intercoolers & after coolers shall be designed in accordance with Section VIII, Division 1 of ASME Code or equivalent.		
4.02.00	Outlet temperature of air from intercooler shall be suitable to suit the equipment and outlet temperature of air from the compressor house outlet header shall be limited to 45 deg.C. However, the instruments or the pneumatic devices requires air temperature less than 45 deg.C., the same shall be achieved at the outlet header.		
4.03.00	Coolers shall be provided with removable tube bundle design in accordance with design code TEMA Class C and shall be constructed with removable shell cover.		
4.04.00	Oil Coolers shall be equipped with vent & drain connections on oil and water sides. Oil temperature control valve with manual override feature or bypass construction shall be provided to maintain constant temperature. Vent & drain connections for intercoolers and aftercoolers shall be provided.		
4.05.00	Design pressure shall be 8 Kg/cm2 (g) or based on shut-off head of cooling water pumps.		
4.06.00	The coolers shall be designed for maximum heat load and atleast 10 percent design margin shall be provided in the number of tubes.		
4.07.00	Adequately sized safety valves shall be provided for both intercoolers and after coolers.		
4.08.00	Each intercooler and aftercooler shall be provided with moisture separator units with suitable baffling. Moisture separator units shall be equipped with a level gauge glass with isolating cock.		
4.09.00	Electrically operated automatic drain trap stations with bypass and isolating valves shall be provided for moisture separators for automatically draining of condensed moisture. The drain trap shall be timer based. Manual draining facility shall also be provided in the drain trap.		
4.10.00	Cooler shells, channels and covers shall be of carbon steel (SA 285 Gr C / SA 516 Gr 70 / equivalent).Tube sheet shall be of Brass or SS and the tubes shall be of Admiralty brass or Aluminium brass or Copper or SS 304.		
4.11.00	For the instrument air compressors offered with "Heat of compression" type air drying plants, the after coolers shall be provided at downstream of Air Drying Plant.		
5.00.00	AIR RECEIVERS		
5.01.00	The design pressure and temperature shall be minimum 10 Kg/cm ² (g) and 50 deg.C respectively. Receivers shall be designed in accordance with Section VIII, Division 1 of ASME Code or equivalent.		
5.02.00	Air receivers are to be provided with gasketed inspection manhole of minimum 500 mm diameter with cover plate, lifting handle, davit cap etc.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM
			PAGE 2 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS		
5.03.00	Receivers shall be of welded construction with minimum number of joints. Longitudinal seam in adjacent sections shall not be in same line. Welding shall be as per relevant codes. Filler material to have composition & structure as that of material welded. Welding electrodes to be approved by Employer. Electrodes to be dried before use.		
5.04.00	Relief valves shall be provided to suit compressor capacity and set pressure of the same shall be atleast 10% above working pressure. The spring in relief valve shall not reset for any pressure more than 10% above or below the design set pressure.		
5.05.00	Each receiver shall be provided with drain connection with electrically operated automatic drain trap arrangement with isolation and bypass valves.		
5.06.00	The material of construction of shell, dished ends, flanges, etc of the air receivers shall be of carbon steel as per IS:2062 or equivalent.		
6.00.00	INTAKE AIR FILTER AND SILENCER		
6.01.00	Filters with multiple elements quick removal type for easy cleaning shall be provided at suction of each air compressor and also be of heavy-duty dry type.		
6.02.00	The filters shall be complete with integral silencers. Separate silencers, if specified, shall be provided. The filtering elements shall be easily removable for cleaning.		
6.03.00	The filters shall be designed for an efficiency of not less than 99% for particles 2 microns and larger.		
7.00.00	AIR DRYING PLANTS		
7.01.00	One number Air drying plant shall be provided for each air compressor. Drying shall be by adsorption process through a desiccant medium.		
7.02.00	Air Drying (ADP) Plant may be of "Open Through type (Blower reactivated)" OR "Heat of (HOC) Compression type".		
7.03.00	Regeneration of desiccant shall be achieved by "open through" or "Heat of compression" method without any air purge loss.		
7.04.00	Hot unsaturated compressed air shall be used for regeneration of exhausted desiccant in case of "Heat of compression type ADP" and air from blower shall be used for regeneration after heating by electrical heater in case of "Open through type ADP".		
7.05.00	Each ADP shall be provided with two adsorber towers each sized for design drying cycle of minimum 8 hours. After this period, the adsorber tower which was under drying mode shall be put under regeneration/reactivation mode while the other tower will take over the drying duty. The change of drying mode to reactivation mode or vice-versa shall be automatic with provision for manual operation also. The change over from one mode to another shall be through automatic solenoid operated valves.		
7.06.00	In "Open Through" type ADP, for regeneration of desiccant, atmospheric air shall be filtered, heated through an electric heater and passed through the desiccant before exhausted to atmosphere. The reactivated desiccant shall be cooled through same atmospheric air without heater in operation. In case of HOC type drier, the reactivation shall be achieved by the heat of the compressed air itself. The hot unsaturated compressed air from the outlet of last stage of compressor shall be passed through the adsorber tower. The moist air shall be cooled in dehumidifier and passed through the second adsorber for final drying. The design reactivation cycle/period of the tower shall be less than 8 hours including cooling period for desiccant for both the types of ADP.		
7.07.00	Each ADP shall be provided with two (2) numbers of 100 percent capacity pre-filters and two (2) numbers of 100 percent capacity after-filters at the upstream & downstream of towers.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM PAGE 3 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
7.08.00	The filtering media shall be of ceramic candle type elements designed to withstand atleast 50% of static pressure as differential pressure. The pre-filters shall be provided with automatic electrically operated drain trap arrangement with isolation and bypass valves.		
7.09.00	The electric heaters (if required) (2x100% capacity for each ADP) shall be provided with thermostatic control for heater and relief valve for safety and shall be flanged type to facilitate easy replacement of element.		
7.10.00	Each electric motor driven blower (2x100% capacity for each ADP) shall be provided with individual dry type filters at inlet.		
7.11.00	The adsorber tower shall be designed with sufficient cross sectional area resulting low air velocity and pressure drop. Minimum 20% of desiccant depth shall be provided as free board in adsorber vessels. Adsorber vessels to be provided with suitable number of inspection/sight windows of "Persplex" for observation of adsorbent condition. Desiccant filling and removal connections shall be provided for the adsorber vessels.		
7.12.00	The coolers/heat exchangers/ dehumidifiers of ADP shall be designed & constructed as per the requirements specified for "Intercoolers, After coolers & Oil coolers" above.		
7.13.00	All pressure vessels such as pre-filters, after-filters, adsorber vessels, heaters, heat exchangers/de-humidifiers / coolers etc associated with ADP shall be designed in accordance with Section VIII, Division 1, of ASME Code or equivalent. The pressure vessels shall be provided with air tight gasketed manholes/handholes and relief valves.		
7.14.00	Quantity of desiccant to be calculated shall take into account residual moisture content at the end of regeneration cycle.		
7.15.00	Adsorption capacity and density to be considered for silica gel shall not be more than 10% and 550 kg/m ³ respectively. In case of activated alumina the same shall be 8% (max) and 900 kg/m ³ (max.) respectively.		
7.16.00	In case of Heat of compression type, adsorbers shall be sized so that even when the compressor is operating at part load, complete regeneration shall be achieved within the cycle time and quality of air (dew point) shall be maintained throughout the design cycle period.		
7.17.00	Complete ADP equipment shall preferably be mounted on a skid.		
7.18.00	Required sample connections in piping be provided for sampling of air at desired locations.		
7.19.00	Non-lubricated two way / three way / four way valves ball valves with pneumatic actuators be provided.		
7.20.00	The material of Construction for various components of ADP shall be as as per manufacturer's proven standard.		
8.00.00	HOC dryers of single rotating drum type design using packed dessicant with in-built regeneration and adsorption compartments are also acceptable in place of specified twin-tower type dryers, if the design ensures specified performance guarantee. In case, the Contractor offers such a type, the same shall be of proven design.		
8.00.00	INTERCONNECTING PIPING, FITTING AND VALVES The interconnecting piping & valves within compressor house for compressed air & cooling water etc shall be designed in line with the specification furnished in subsection titled "Low Pressure Piping" of Part-B of this Technical Specification.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM
			PAGE 4 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
9.00.00	CONTROL PHILOSOPHY			
9.01.00	GENERAL			
9.01.01	The minimum requirements are specified herein and the same shall be elaborated by contractor. The Contractor shall include controls & instrumentation to facilitate safe, reliable and efficient operation for the system. The controls, protection, interlock and instrumentation system offered by the contractor shall be subjected to approval of the Employer during post award engineering stage.			
9.01.02	Any of the compressor and Air drying Plant may be selectable for "shutdown", "working" or "standby" duty.			
9.01.03	On tripping of working equipment, the standby equipment shall come into operation automatically in case of very low air pressure in the system.			
9.01.04	All abnormal conditions used for tripping the compressor or any other equipment shall be provided with pre-trip audio-visual indication/annunciation in the control panel.			
9.01.05	An electrically operated automatic valve shall be provided on cooling water supply line of each compressor & dryer (if applicable) which will automatically shut off the cooling water supply, in case any of the compressor/dryer is not running for more than set time duration. Suitable interlock shall also be provided for opening the valve before starting of any of the compressor.			
9.01.06	The following indications shall be made available in the control panels for repeating the same in main plant Control System / Panels. (a) Status of each compressor (b) Instrument air pressure low/high (c) Service air pressure low/high (d) Dew point of instrument air (e) Status of each ADP			
9.01.07	Lube oil pressure and temperature in the oil circuit of compressor shall be automatically controlled.			
9.01.08	Unless otherwise mentioned in the relevant electrical sub-section, automatic motor overload control system shall be included to permit continuous operation of compressors at minimum ambient air without exceeding the name plate rating of the motor.			
9.02.00	Screw Compressor			
9.02.01	Each compressor shall be in the control panel to operate either in Base duty (Auto Load-Unload) or Standby duty (Auto On-Off) mode in case of Screw and ~~unload/modulate/energy optimization (Auto Dual Mode) in case of centrifugal~~			
9.02.02	In "Base duty" mode, whenever air supply from compressors exceeds the demand, control system shall operate the load-unload circuit at a predetermined set pressure, throttle the inlet valve and open the blow off valve. The compressor shall run in unloaded condition. When system pressure drops due to more demand, the load-unload circuit shall operate again to bring the compressor to 100% load after closing the blow -off valve.			
9.02.03	In "Stand-by" mode the compressor shall automatically assist base load compressors during periods of peak air demand. When air pressure in the system reaches a pre-set lower limit, compressor should start in unloaded condition and the compressor shall be fully loaded. When the pressure in the system rises to pre-set high value, the compressor shall be unloaded and shall run in idling mode for a specific period (set by a timer). The compressor may be loaded to full load in case of drop in system pressure or compressor may be stopped			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM	PAGE 5 OF 6

CLAUSE NO.	TECHNICAL REQUIREMENTS		
9.02.04	in case the system pressure does not drop and compressor continues to idle for more than a pre-set time.		
9.02.05	The control system shall provide warning to the operator that a hot-start condition exists for the motor driver and adequate cool-down period has not occurred after the motor was shut down.		
9.02.05	The alarms and shutdown scheme mentioned below are suggestive and shall be provided as per manufacturer's standard practice meeting the safe operational requirement of the equipment/system each compressor:-		
	(a)	"Air temperature high" at inlet to last stage	Alarm & trip
	(b)	"Low lube oil pressure"	Alarm & trip
	(c)	"High Lube oil supply temperature"	Alarm & trip
	(d)	"High oil filter differential pressure"	Alarm
	(e)	"Low lube oil level in lube oil sump"	Alarm
	(f)	"High inlet air filter differential pressure"	Alarm & trip
	(g)	"Low cooling water flow to air compressor"	Alarm
9.03.00	Air Drying Plant		
9.03.01	Sequential operation of the adsorber towers & air compressors shall be controlled automatically with a provision for manual take over.		
9.03.02	Change over of tower from drying mode to regeneration mode shall happen automatically if the dew point is high at the outlet of ADP sensed by the dew point (using aluminium oxide probe) meter/sensor. Automatic operation during regeneration, starting and stopping of blowers, starting and stopping of heaters, etc shall be timer controlled. During the process, in case, operation is taken over manually from the panel through push button or selector switch, the sequential operation shall start with the manual initiation for each of the steps.		
9.02.03	The control system shall provide the (as minimum) alarms, "High Reactivation air temperature", "Low Reactivation air temperature", "Low cooling water flow", "Low air pressure at the outlet of ADP" and "High dew point at the outlet of ADP". Adequate number of temperature elements etc. shall be provided for measurement and monitoring of the same.		
9.02.04	For rotary drum type Air drying plant, control philosophy as per manufacture's standard and proven practice is also acceptable.		
10.00.00	PAINTING		
	All the equipments shall be protected against external corrosion by providing suitable painting.		
	The surface of SS, galvanized steel, Gun metal, Brass, Bronze and non-metallic components shall not be applied with any painting.		
	The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by brushing, shot blasting etc as per standard procedure.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM
PAGE 6 OF 6			

21/PS-PEM-MAX				एनटीपीसी NTPC
CLAUSE NO.	TECHNICAL REQUIREMENTS			
	<u>LOW PRESSURE PIPING</u>			
1.00.00	EQUIPMENT SIZING CRITERIA			
1.01.00	All the piping systems and equipment supplied under this package shall be designed to operate without replacement and with normal maintenance for a plant service life of 30 years, and shall withstand the operating parameter fluctuations and cycling which can be normally expected during this period.			
1.02.00	For all Low Pressure piping systems covered under this specification, sizing and system design shall be to the requirements of relevant codes and standard indicated. In addition to this, requirements of any statutory code as applicable shall also be taken into consideration.			
1.03.00	Inside diameters of piping shall be calculated for the flow requirements of various systems. The velocities for calculating the inside diameters shall be limited to the following:			
a)	Water Application			
		Water Velocity in m/sec		
	Pipe Size	Below 50 mm	50-150 mm	200 mm & above
(a)	Pump suction	-----	1.2-1.5	1.2-1.8
(b)	Pump discharge and recirculation	1.2-1.8	1.8-2.4	2.1-2.5
(c)	Header	-----	1.5-2.4	2.1-2.4
	Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally. Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec.			
	WILLIAM & HAZEN formula shall be used for calculating the friction loss in piping systems with the following "C" value:			
(i)	Carbon steel pipe	100		
(ii)	Ductile Iron.	140		
(iii)	Rubber lined steel pipe	120		
(iv)	Stainless steel pipe	100		
	For calculating the required pump head for pump selection, at least 10% margin shall be taken over the pipe friction losses and static head shall be calculated from the minimum water level of the tank/ sump/ reservoir from which the pumps draw water.			
b)	Compressed Air Application			
	Compressed air	15.0 m/sec.(under Average Pressure & Temp. conditions)		
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING) PAGE 1 OF 16



21/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC																																										
1.04.00	The pipes shall be sized for the worst (i.e. maximum flow, temp. and pressure values) operating conditions.																																											
1.05.00	Based on the inside dia. so established, thickness calculation shall be made as per ANSI B 31.1 OD and thickness of pipes shall than be selected as per ANSI B 36.10/IS-1239 Heavy grade/IS-3589/ASTM-A-53/API-5L/ANSI B 36.19 as the case may be.																																											
1.06.00	Corrosion allowance of 1.6 mm will be added to the calculated thickness being considered (except stainless steel piping).																																											
1.07.00	Bend thinning allowance/manufacturing allowance etc. shall be as per the requirement of the design code provision.																																											
1.08.00	High points in piping system shall be provided with vents along with valves as per the system requirement. Low points shall be provided with drains along with drain valves as per the system requirement. Drain lines shall be adequately sized so as to clear condensate in the lines. Material for drain and vent lines shall be compatible with that of the parent pipe material.																																											
1.09.00	Material of construction for pipes carrying various fluids shall be as specified elsewhere.																																											
1.10.00	Compressed air pipe work shall be adequately drained to prevent internal moisture accumulation and moisture traps shall be provided at strategic locations in the piping systems.																																											
1.11.00	Depending upon the size and system pressure, joints in compressed air pipe work shall be screwed or flanged. The flange shall be welded with the parent pipe at shop and shall be hot dip galvanized before dispatch to site. Alternatively, the flanges on GI pipes may be screwed-on flanges also.																																											
1.12.00	Threaded joints shall be provided with Teflon sealant tapes.																																											
1.13.00	Following types of valves shall be used for the system/service indicated. <table><tr><th>SYSTEM</th><th colspan="6">TYPES OF VALVES</th></tr><tr><th></th><th>Butterfly</th><th>Gate</th><th>Globe</th><th>Check</th><th>Ball</th><th>Plug</th></tr><tr><td>Water</td><td>x</td><td>x</td><td>x</td><td>x</td><td>x</td><td></td></tr><tr><td>Air</td><td></td><td>x</td><td>x</td><td>x</td><td>x</td><td></td></tr><tr><td>Drains & vents</td><td></td><td>x</td><td>x</td><td>x</td><td></td><td></td></tr><tr><td>Fuel oil (if any)</td><td></td><td>x</td><td>x</td><td>x</td><td>x</td><td>x</td></tr></table>	SYSTEM	TYPES OF VALVES							Butterfly	Gate	Globe	Check	Ball	Plug	Water	x	x	x	x	x		Air		x	x	x	x		Drains & vents		x	x	x			Fuel oil (if any)		x	x	x	x	x	
SYSTEM	TYPES OF VALVES																																											
	Butterfly	Gate	Globe	Check	Ball	Plug																																						
Water	x	x	x	x	x																																							
Air		x	x	x	x																																							
Drains & vents		x	x	x																																								
Fuel oil (if any)		x	x	x	x	x																																						
1.14.0	Recirculation pipes along with valves, breakdown orifices etc. shall be provided for important pumping systems as indicated in respective process and instrumentation diagrams (P&IDs). The recirculation pipe shall be sized for minimum 30%design flow of single pump operation or the recommended flow of the pump manufacturer whichever is higher.																																											
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 2 OF 16																																								

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.00.00	TECHNICAL SPECIFICATION			
2.01.00	GENERAL Specific technical requirements of low-pressure piping, fittings, supports, valves, specialties and tanks etc. have been covered under this Sub-section. It includes details pertaining to design and material of construction for piping, fittings, valves, equipment, etc. cleaning/surface preparation application of primer and painting on over ground piping. It also includes detailed technical requirement of laying underground/buried piping including water proofing/anti corrosive protection. It also covers design, engineering, manufacturing, fabrication, technical details of piping, valves, specialties, piping hangers / supports, tanks etc.			
2.02.00	Pipes and fittings			
2.02.01	All low pressure piping systems shall be capable of withstanding the maximum pressure in the corresponding lines at the relevant temperatures. However, the minimum thickness as specified in the following clauses and or respective codes for pipes and fittings shall be adhered to. The bidder shall furnish the pipe sizing/ thickness calculation as per the criteria mentioned above under LP piping equipment sizing criteria of this Technical Specification.			
2.02.02	Piping and fittings coming under the purview of IBR shall be designed satisfying the requirements of IBR as a minimum.			
2.02.03	Supporting arrangement of piping systems shall be properly designed for systems where hydraulic shocks and pressure surges may arise in the system during operation. Bidder should provide necessary protective arrangement like anchor blocks/anchor bolt etc. for the safeguard of the piping systems under above mentioned conditions. The requirement will be, however, worked out by the contractor and he will submit the detailed drawings for thrust/anchor block to the Employer. External, and internal, attachments to piping shall be designed so as not to cause flattening of pipes and excessive localized bending stresses.			
2.02.04	Bends, loops, off sets, expansion or flexible joints shall be used as required in order to prevent overstressing the piping system and to provide adequate flexibility. Flexibility analysis (using software packages such as Caesar-II etc.) shall be carried out for sufficiently long piping (straight run more than 300M).			
2.02.05	Wherever Bidder's piping coming under this specification, terminates at an equipments or terminal point not included in this specification, the reaction and the thermal movement imposed by bidder's piping on equipment terminal point shall be within limits to be approved by the Employer.			
2.02.06	The hot lines shall be supported with flexible connections to permit axial and lateral movements. Flexibility analysis shall be carried out for pipelines which have considerable straight run as indicated above and necessary loops/ expansion joint etc. shall be provided as may be necessary depending on layout.			
2.02.07	Piping and fittings shall be manufactured by an approved manufacturer of repute. They should be truly cylindrical of clear internal diameter, of uniform thickness, smooth and strong, free from dents, cracks and holes and other defects.			
2.02.08	For rubber lined ERW pipes, beads shall be removed for pipe size 80 NB and above.			
2.02.09	Inspection holes shall be provided at suitable locations for pipes 800 Nb and above as required for periodic observations and inspection purposes.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 3 OF 16



21/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS													
2.02.10	At all intersection joints, it is Contractor's responsibility to design and provide suitable reinforcements as per the applicable codes and standards.													
2.02.11	For large size pipes/ducts, at high point and bends/change of direction of flow, air release valves shall be provided as dictated by the system requirement and operation philosophy & tripping conditions of pumping system. Sizing criteria for air release valves shall be generally on the basis of valve size to pipe diameter ratio of 1:8. Requirement shall be decided as per relevant code. Transient analysis /surge analysis where ever specified and required shall be conducted in order to determine the location , number and size of the Air-Release valve on certain long distance/high volume piping systems, if applicable within the scope of work of the package.													
2.03.00	Material													
2.03.01	Alternate materials offered by Bidder against those specified. shall either be equal to or superior to those specified, The responsibility for establishing equality or superiority of the alternate materials offered rests entirely with the Bidder and any standard code required for establishing the same shall be in English language.													
2.03.02	No extra credit would be given to offers containing materials superior to those specified. Likewise no extra credit would be given to offers containing pipe thickness more than specified.													
2.03.03	All materials shall be new and procured directly from the manufacturers. Materials procured from traders or stockists are not acceptable.													
2.03.04	All materials shall be certified by proper material test certificates. All material test certificates shall carry proper heat number or other acceptable references to enable identification of the certificate that certifies the material.													
2.03.05	Material of construction for pipes carrying various fluids shall be as follows: <table><tr><th>SI No</th><th>Type of Fluid</th><th>Material</th></tr><tr><td>1.</td><td>i) Ordinary Water (Raw Water, Clarified Water, etc.) ii) Equipment cooling water including Both primary & secondary circuit (DMCW pH-corrected & ACW drain water)</td><td>IS-2062 Gr.-E-250B/ASTM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.</td></tr><tr><td>2.</td><td>i) Demineralised water, ii)Alkaline solution (ECW system chemical dosing)</td><td>Stainless Steel to ASTM A312, Gr. 304 welded for sizes 65 mm NB and above. Stainless steel to ASTM A312, Gr. 304 sch.40s seamless for sizes 50mm and below</td></tr><tr><td>3.</td><td>i) Drinking (potable) water ii)Compressed air (Instrument & service air)</td><td>ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 3589 Gr 410 galvanized. Galvanized shall be to IS- 4736 or equivalent.</td></tr></table>	SI No	Type of Fluid	Material	1.	i) Ordinary Water (Raw Water, Clarified Water, etc.) ii) Equipment cooling water including Both primary & secondary circuit (DMCW pH-corrected & ACW drain water)	IS-2062 Gr.-E-250B/ASTM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.	2.	i) Demineralised water, ii)Alkaline solution (ECW system chemical dosing)	Stainless Steel to ASTM A312, Gr. 304 welded for sizes 65 mm NB and above. Stainless steel to ASTM A312, Gr. 304 sch.40s seamless for sizes 50mm and below	3.	i) Drinking (potable) water ii)Compressed air (Instrument & service air)	ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 3589 Gr 410 galvanized. Galvanized shall be to IS- 4736 or equivalent.	
SI No	Type of Fluid	Material												
1.	i) Ordinary Water (Raw Water, Clarified Water, etc.) ii) Equipment cooling water including Both primary & secondary circuit (DMCW pH-corrected & ACW drain water)	IS-2062 Gr.-E-250B/ASTM A-36/ASTM A-53 type 'E'Gr.B/IS-3589 Gr. 410 /IS-1239 Heavy.												
2.	i) Demineralised water, ii)Alkaline solution (ECW system chemical dosing)	Stainless Steel to ASTM A312, Gr. 304 welded for sizes 65 mm NB and above. Stainless steel to ASTM A312, Gr. 304 sch.40s seamless for sizes 50mm and below												
3.	i) Drinking (potable) water ii)Compressed air (Instrument & service air)	ASTM A-53 type E Gr. B galvanized/ IS 1239 Gr heavy galvanized/IS 3589 Gr 410 galvanized. Galvanized shall be to IS- 4736 or equivalent.												
2.03.06	In water lines, pipes upto 150mm Nb shall conform to ANSI B36.10/ASTM-A-53, Type-E Gr.B /IS:1239 Gr. Heavy and minimum selected thickness shall not be less than IS:1239 Grade Heavy except for demineralized water, drinking water .													
<table><tr><td>LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE</td><td>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9</td><td>SUB-SECTION-I-M7 (LOW PRESSURE PIPING)</td><td>PAGE 4 OF 16</td></tr></table>			LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 4 OF 16								
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 4 OF 16											

21/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.03.07	Pipes of above 150mm Nb shall be to AWWA-C200/ANSI B 36.10/ASTM A-53/IS 3589 Gr.410. Pipe to be fabricated by the bidder shall be rolled and butt welded from plates conforming to ASTM A-53 type 'E' Gr. B/IS 2062 Gr.E-250B/ASTM-A-36. However, larger pipes, i.e. 1000mm Nb and above shall be made from plates conforming to ASTM A 36/IS 2062 Gr.E-250B and shall meet the requirements of AWWA-M-11 (for deflection & buckling criteria considering water filled pipe as well as vacuum condition that may prevail during transient/surge conditions, truck-load, rail-load and weight density for compacted soil or any other load as the case may be).			
2.03.08	In demineralised water service, the pipes upto 50 Nb shall be of stainless steel ASTM A 312, Gr. 304 sch. 40 Seamless. The size for these pipes shall be to ANSI B 36.19. These shall be socket welded. The material for pipe from 65mm NB upto and including 400 NB shall be to ASTM A 312, Gr. 304 (welded). In no case the thickness of fittings shall be less than parent pipe thickness. Bidder/Contractor shall note that pipes offered as per a particular code shall conform to that code in all respects i.e. Dimension, tolerances, manufacturing methods, material, heat treatment, testing requirements, etc. unless otherwise mentioned elsewhere in the specification.			
2.03.09	Instrument air, Plant (service) air lines and Drinking water lines shall be to ASTM A 53 type E grade B/ANSI B 36. 10/IS 3589, Gr. 410 / IS: 1239 Heavy (in case thickness calculated is more than gr. Heavy, ANSI B 36.10 Schedule numbers shall be followed) and galvanized to IS 4736 or any equivalent internationally reputed standard. The material of the pipes shall be to ASTM A 53 type 'E' Gr. B / IS: 3589, Gr. 410 / IS: 1239 Gr. Heavy. The fittings shall be of either same as parent material or malleable iron to IS-1879 (galvanized).			
2.03.10	Spiral welded pipes as per API-5L/IS-3589 are also acceptable for pipe of size above 150 NB. However minimum thickness of the pipes shall be as elaborated in above clauses.			
2.03.11	Condensate lines shall be to ASTM A 106 Gr. B and dimension to ANSI B 36.10 schedule "standard" as minimum to be maintained.			
2.03.12	If carbon steel plates of thickness more than 12 mm are used for manufacture of pipes, fittings and other appurtenances, then the same shall be control-cooled or normalized as the case may be following the guidelines of the governing code.			
2.04.00	Field routed pipes:			
2.04.01	Pipe lines of NB 50 size and below are regarded as field run piping. It is Bidder's responsibility to plan suitable layouts for these system insitu. Bidder shall prepare drawings indicating the layout of field run pipe work. These drawings shall be approved by Project Manager to the installation of the field run pipe work. Based on these approved layouts the Bidder shall prepare the BOQ of field run-pipes and submit to Employer for approval.			
2.05.00	Slope/Drains and Vents			
2.05.01	Suitable slope shall be provided for all pipelines towards drain points. It is Bidder responsibility to identify the requirements of drains and vents, and supply the necessary pipe work, valves, fittings, hangers and supports etc. As per the system requirement low points in the pipelines shall be provided with suitable draining arrangement and high points shall be provided with vent connections where air or gas pockets may occur. Vent for use during hydrostatic test shall be plugged after the completion of the test. Vent shall not be less than 15mm size. Drains shall be provided at low points and at pockets in piping such that complete drainage of all systems is possible. Drain shall not be less than 15mm for line size up to 150mm, not less than 20mm up to 300mm and not less than 25mm for 350mm to 600mm pipes and not less than 50mm for 600mm and above pipes.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 5 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.05.02	Air piping shall be sloped so that any part of the system can be drained through the shut-off drain valve or drain plugs.			
2.06.00	Pipe Joints In general all water lines 65mm NB and above, are to be joined generally by butt welding except the locations where valves/fittings are to be installed with flanged connections and 50mm and below by socket welding unless mentioned otherwise specifically. All air lines shall be of screwed connection and rubber lined pipes of flanged connections.			
2.06.01	Screwed Joints (a) Threading of pipes shall be carried out after bending, heat treatment etc. If not possible, threading may be done prior to these operations but proper care should be taken to protect them from damage. Threads shall be to ANSI B 2.1 (taper) NPT/ ANSI B1.20.1 (taper) NPT / IS: 554 unless specified otherwise. (b) Galvanized pipe shall generally be joined by screwing into sockets. The exposed threaded portion on the outside of the pipes shall be given a zinc silicate coating. Galvanized pipes shall not be field joined by welding for protection of Galvanising Zinc layer. Screwed ends of GI pipes shall be thoroughly cleaned and painted with a mixture of red and white lead before jointing. For galvanized pipe sizes above 150 mm NB, screw & socket jointing as per ASTM-A-865 shall be employed for both pipe-to-pipe and pipe-to-fitting jointing. For pipe to fitting connection since no direct threading can be done on the fittings (supplied as per ASTM-A-234 Gr. WPB and ANSI B-16.9) necessary straight pipe lengths acting as match pieces shall be welded to the fitting at both ends and subsequently the free ends of the straight lengths shall be threaded as per ASTM A-865 for jointing with main pipe. Once welding of fittings with match pieces and threading of free ends of match pieces are over, the entire fabricated piece shall be galvanized, or in case match pipes and fittings are already galvanized before the above mentioned fabrication then suitable application of Zinc-Silicate paste adequately at the welded surface (both in side & out side) after welding with zinc rich electrode, along with the nascent threaded metal portions at both free ends given the same application of Zinc Silicate paste. Alternatively flanged jointing may be employed for pipe sizes 100 NB and above. However, the bidder shall ensure the galvanized pipe joints do not fail during hydro test. (c) Teflon tapes shall be used to seal out screwed joints and shall be applied to the male threads only. Threaded parts shall be wiped clean of oil or grease with appropriate solvent if necessary and allowing proper time for drying before applying the sealant. Pipe ends shall be reamed and all chips shall be removed. Screwed flanges shall be attached by screwing the pipe through the flange and the pipe and flange shall be refaced accurately. (d) For pipe sizes from 350 mm NB to 550 mm NB (including 350 NB & 550 NB) the GI pipes shall be of flanged connection. However, the pipes after welding of flanges shall be completely galvanized. Any site welding done on galvanized pipes shall be done with zinc-rich special electrodes and the welded surfaces whether inside or outside shall be coated with zinc-silicate paste. Seal welding of flanges with zinc-rich electrode will be permitted only when any flange is leak-prone during hydro testing. (e) For pipe sizes 600 mm NB and above, the GI pipes shall be of welded connection (with zinc-rich special electrodes) followed by application of zinc silicate coating at welded surfaces both inside and outside the pipe, except for the last blank/blind flange, or, equipment connection where application of zinc-silicate paste after welding cannot be done due to inaccessibility of the inside welded surface and where galvanic protection has been impaired due to welding of pipe-to-pipe joint. Thus the last erection joint shall be flanged joint.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 6 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.06.02	Welded Joints (a) For making up welded joints (butt weld or socket weld) the welding shall be performed by manual shielded metal arc process in accordance with the requirements specified elsewhere in the spec. Any welder employed for carrying butt welding shall be qualified as per ASME section IX for the type of joints he is going to weld. Jointing by butt weld, or socket weld shall depend upon the respective piping material specifications.			
2.06.03	Flanged Joints (a) Flanged connections for pipes are to be kept to the minimum and used only for connections to vessel, equipments, flanged valves and other fittings like strainer/traps/orifices etc. for ease of connection and maintenance etc. Rubber lined pipes shall be flange joined only. (b) All flanged valves intended for installation on steel piping system, shall have their flanges drilled to ANSI B 16.5 (or equivalent) and according to the pressure class stated in their respective piping material specification. (c) Drilling on flanges of flanged valves must correspond to the drilling of flanges on the piping system on which the valves are installed.			
2.07.00	Bends/elbows/mitre bends/ Tees/ Reducers & other fittings			
2.07.01	For pipe fittings such as elbows (long radius), reducers, tees, etc. the material shall be to ASTM-A-234 Gr. WPB/ASTM-105 up to 300 NB. For pipe fittings above 300 NB, the fittings may be fabricated conforming to parent pipe material. Provision of compensation pads shall be kept as per ANSI B 31.1. The fitting shall conform to the dimensional standard of ANSI B-16.9/ 16.11. Further branching in pipes for sizes 65nb and above is also acceptable (ANSI B 31.1). However, for pipes up to 150 NB, pipe fittings may be supplied with material and dimension conforming to IS 1239 in case parent pipes also conform to IS 1239.			
2.07.02	For pipe size 350Nb and above mitre bends may be used for all pipes except rubber lined pipes. However, mitre bends are also acceptable for rubber lined pipes above 1200 NB. The bend radius shall be 1½ times the nominal pipe diameter. 90 deg. bends (mitre) shall be in 4 pieces (3 cuts) and 45 deg. mitre bends shall be in 3 pieces 22½ deg. Fabrication of mitre bends shall be as detailed in BS 2633/BS534.			
2.07.03	For pipes, above 1200 NB, reducer and tees shall be to dimensional standard of AWWA-C-208.			
2.07.04	Stainless steel fittings shall conform to either ASTM-A-182 Gr. 304 or ASTM-A-403 Grade WP. 304 Class-S, for sizes upto and including 50 mm NB, i.e. the fittings shall be of seamless construction. However, for stainless fittings above 50 mm NB, the same shall conform to ASTM-A-403 Gr. WP 304 Class W i.e. the fittings shall be of welded construction strictly in accordance with ASTM-A-403.			
2.07.07	In no case, the thickness of fittings shall be less than the thickness of parent pipe, irrespective of material of construction.			
2.08.00	Flanges			
2.08.01	Flanges shall be slip on type or weld neck type. Welding of flanges in tension is not permitted.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 7 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
2.08.02	All flanges and-flanged drilling shall be to ANSI B 16.5 / BS EN-1092 / AWWA C - 207 of relevant pressure/temperature class. Flanges shall be fabricated from steel plates conforming to ASTM A 105/IS 2062 Gr. E-250B. However stainless steel flanges shall be fabricated from SS plates to ASTM-A-240, Gr. 304 or equivalent.	
2.09.00	Specific technical requirement of laying buried pipe with anti-corrosive treatment The pipe in general shall be laid with the top of the pipe minimum 1.0 (one) meter below finished general ground level.	
2.09.01	Trenching (a) The trench shall be cut true to the line and level and shall follow the gradient of the pipeline. The width of the trench shall be sufficient to give free working space on each side of the pipe. Trenches shall conform to IS 5822 or any international standard.	
2.09.02	Preparation and cleaning of piping (a) The pipeline shall be thoroughly cleaned of all rust, grease, dirt, weld scales and weld burrs etc. moisture or other foreign matter by power cleaning method such as sand or grit blasting, power tool cleaning, etc. Grease or heavy oil shall be removed by washing with a volatile solvent such as gasoline. Certain inaccessible portions of the pipeline (which otherwise not possible to be cleaned by power cleaning methods) may be scrubbed manually with a stiff wire brush and scrapped where necessary with specific permission of the Project Manager. (b) On the internal surface for pipes 1000 Nb and above, a coat of primer followed by a hot coal-tar enamel or coal tar epoxy painting (cold) shall be applied.	
2.09.03	Coating and wrapping/ Anti corrosive Protection Coal tar tape a. Buried piping shall be coated and wrapped, as per specification, after completion of welded and/or flanged connections, and after completion and approval of Hydro testing. Materials to be used for coating and wrapping of underground pipelines are: (1) Coating primer (coal tar primer) (2) Coating enamel (coal tar enamel) (3) Wrapping materials. All primer/coating/wrapping materials and methods of application shall conform to IS: 10221 except asphalt/bitumen material. Materials (primer/coating/wrapping) as per AWWA-C-203 are also acceptable. Protective coating shall consist of coal tar primer, coal tar enamel coating, glass fiber, tissue inner wrap followed by glass fiber or coal tar impregnated Kraft outer wrap or finish coat. Number of coats and wraps, minimum thickness for each layer of application shall be as per IS-10221. Number of. Coats and wraps shall be decided based on soil corrosivity/resistivity as indicated in IS-10221. Soil data for this purpose shall be made available. Total thickness of completed coating and wrapping shall not be less than 4.0 mm. b. Alternatively, the anti-corrosive protection for buried pipes can consist of anti-corrosive protection Coal-tar tapes. Material and application of tapes shall conform to IS 15337 or equivalent. These-tapes shall be applied hot over the cold coal tar	
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)
PAGE 8 OF 16		



21/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
2.09.04	~~primer in steps of 2mm thickness so as to cover the spiral edges of the first tape by the application of second tape. The total thickness of the finished protective coating shall be 4.0 mm minimum.~~ Trench bed preparation and back filling Prior to lowering and laying pipe in any excavated trench, the bottom of the trench may require to be back filled and compacted (or as the case may be) to provide an acceptable bed for placing the pipe. Bed preparation in general shall be as per IS: 5822.			
2.09.05	Laying of galvanized steel (GI) pipes All the joints shall be screwed with socket or flanged. Screwed ends of GI pipes shall be thoroughly cleaned and painted with a mixture of red and white lead before jointing Threaded portion on either side of the socket joint shall be applied with Zinc silicate paste. All the provisions for trenching' bed preparation' laying the pipe application of primer' coating' wrapping with tapes and back filling etc. as indicated for "laying of buried piping" and " anti corrosive protection for buried piping" are applicable for buried galvanized steel (GI) pipes also.			
2.10.00	Cleaning and flushing			
2.10.01	All piping shall be cleaned by the Bidder before and after erection to remove grease, dirt, dust, scale and welding slag.			
2.10.02	Before erection all pipe work, assemblies, sub-assemblies, fittings, and components, etc. shall be thoroughly cleaned internally and externally by blast cleaning or by power driven wire brushes and followed by air-blowing . However for pipe sizes below 100nb the pipes may be cleaned internally by compressed air blowing as an alternative to internal blast cleaning. The brushes shall be of the same or similar material as the metal being cleaned. Cleaning of Galvanized pipes shall be done by air blowing only.			
2.10.03	After erection, all water lines shall be mass flushed with water. The cleaning velocities in water lines shall be 1.2-1.5 times the operating velocities in the pipelines.			
2.10.04	All compressed air pipe work shall be cleaned by blowing compressed air.			
2.11.00	Specification for hangers and supports			
2.11.01	All supports and parts shall conform to the requirement of power piping code ANSI B 31.1 or approved equivalent.			
2.11.02	The maximum spans of the supports of straight length shall not exceed the recommended values indicated in ANSI B 31.1.			
2.11.03	At all sliding surfaces of supports suitable arrangement is to be provided to minimize sliding friction.			
2.12.00	Design/Construction/Material Particulars of Gate/ Globe /Check /Butterfly / Ball / Air release /Float valves / Moisture Traps.			
2.12.01	GENERAL (a) All valves shall have indicators or direction clearly marked on the hand-wheel so that the valves opening/closing can be readily determined.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 9 OF 16

21/PS-PEM-MAX			
CLAUSE NO.		TECHNICAL REQUIREMENTS	
		एनटीपीसी NTPC	
		(b) Special attention shall be given to operating mechanism for large size valves with a view to obtaining quick and easy operation ensuring that a minimum of maintenance is required. (c) The valves coming in vacuum lines shall be of extended gland type and/or water sealed. (d) The actuator-operated valves shall be designed on the basis of the following: (1) The internal parts shall be suitable to support the pressure caused by the actuators; (2) The valve-actuator unit shall be suitably stiff so as not to cause vibrations, misalignments, etc. (3) All actuator-operated valves shall be provided with hand operated gearing mechanism also. (4) All actuators operated valves shall open/ close fully within time required by the process. (e) Valves coming under the purview of IBR shall meet IBR requirements. (f) All valves shall be provided with embossed name plate giving details such as tag number, type, size etc. (g) Wherever required valves shall be provided with chain operator, extension spindles and floor stands or any other arrangement approved by employer so that they can be operated with ease from the nearest operating floor. Wherever necessary for safety purpose locking device shall be provided. Further, necessary small platforms for facilitating easy valve operation shall be provided by the contractor wherever necessary in consultation with project manager within the bid price at no extra cost to employer	
2.12.02	VALVE BODY MATERIAL Valve body material for various services shall be as follows: Valve body material for water application like Secondary circuit auxiliary cooling water of ECW system, clarified water, DM cooling water (pH corrected) , drinking water etc. shall be cast iron for sizes 65NB and above; gun-metal for sizes 50 Nb and below. For compressed air application, valve body material shall be cast carbon steel or forged carbon steel for sizes 65 mm NB & above and Gun metal for sizes 50 NB and below. DM water: SS body and disc along with SS internals. However for butterfly valves, Cast Iron /Ductile Iron/SG iron/carbon steel body and disc with elastomer lining are also acceptable.		
2.12.03	The design, material, construction, manufacture, inspection, testing and performance of valves shall comply with all currently applicable statutes, regulations and safety codes in the locality where the valves will be installed. The valves shall conform to the latest editions of applicable codes and standards as mentioned elsewhere. Nothing in this specification shall be construed to relieve the Bidder of his responsibility. Valves in general shall conform to the requirements of the following standards.		
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)
PAGE 10 OF 16			

21/PS-PEM-MAX				एनटीपीसी NTPC		
CLAUSE NO.		TECHNICAL REQUIREMENTS				
2.12.04	Standards and Codes					
	AWWA-C-504		Rubber seated butterfly valves.			
	BS-5155/EN-593		Cast iron and steel body butterfly valves for general purpose.			
	IS-778		Gun-metal gate, globe and check valves for general purpose.			
	BS-5154		Copper alloy globe/globe stop and check and gate valves for general purpose.			
	IS-780		Sluice valves for water works purpose (50-300 mm size)			
	IS-2906		Sluice valves for water works purpose (350-1200 mm size)			
	IS-5150		Cast iron wedge and double disc gate for general purpose.			
	BS-5152		Specification for cast iron globe valves.			
	BS-5153		Cast iron check valves for general purpose.			
	IS-5312		Swing check type reflux (non-return) valves.			
	ANSI B 16.34		Standard for valves.			
	API-594		Standard for Dual-check valves.			
	API-600		Steel gate valves.			
	ANSI-B-16.10		Valves face to face and other relevant dimension.			
	API-598		Valves inspection test.			
	2.13.00	End Connections				
		The end connections, shall comply with the following:				
		Socket welding (SW) - ANSI B 16.11				
		Butt Welding (BW) - ANSI B 16.25.				
Threaded (SC) - ANSI B 2.1						
Flanged (FL) - ANSI B 16.5& AWWA-C-207 (steel flanges), ANSI B 16.1 (Cast Iron flanges).						
2.13.00	Gate/Globe/Check Valves					
	(a) All cast iron body valves (gate, globe and non-return) shall have flanged end connections; (screwed ends for Ductile D.2NI body valves are not acceptable).					
	(b) All steel and stainless steel body valves of sizes 65 mm and above shall have flanged or butt welding ends. Valves of sizes below 65mm shall have flanged or socket welded ends. Compatibility of welding between valve body material and connecting pipe material is a pre-requisite in case of butt-welded joints.					
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)		PAGE 11 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	(c) All gun metal body valves shall have screwed ends. (d) All flanged end valves/specialties. shall be furnished along with matching counter flanges, fasteners, gaskets etc. as required to complete the joints. (e) Gate/sluice valves shall be used for isolation of flow. All gate valves shall be of the full-way type, and when in the full open position the bore of the valve shall not be constricted by any part of the gate. Gate valves shall be of the solid/elastic or articulated wedge disc. Gate valves shall be provided with the following accessories in addition to other standard items: (1) Hand wheel (2) Position indicator (for above 50 mm NB valve size) (3) Draining arrangement wherever required. (f) Globe valves shall be used for regulation purposes. They shall be provided with hand wheel, position indicator, draining arrangement (wherever required) and arrow indicating flow direction. Preferably, the valves shall be of the vertical stem type. Globe valves shall preferably have radiused or spherical seating and discs shall be free to revolve on the spindle. The pressure shall preferably be under the disc of the valve. However, globe valves, with pressure over the disc shall also be accepted provided (i) no possibility exists that flow from above the disc can remove either the disc from stem or component from disc (ii) manual globe valves can easily be operated by hand. If the fluid load on the top of the disc is higher than 40-60 KN, bypass valve shall be provided which permits the downstream system to be pressurized before the globe valve is opened. (g) Check valves shall be used for non-return service. They shall be swing. check type or double door (Dual plate) check type with a permanent arrow inscription on the valve body indicating the fluid flow direction. In long distance pipes lines with possibility of surge-occurrence, dual plate check valves are preferable for its spring controlled opening /closing of flaps/doors against flow reversals. However, dual plate check valves shall not be used for sizes more than 600mm NB. (h) For bore greater than 2" the valves must be swing check type or dual plate check type suitable for installation in all positions (vertical and horizontal); (i) For bore smaller than or equal to 2" the valves must be of the piston type to be installed, in horizontal position. (j) All gate and globe valves shall be provided with back seating arrangement to enable on line changing of gland packing. The valves shall be preferably outside screw & yoke type. (k) All gate and globe valves shall be rising stem type and shall have limit switches for full OPEN and full CLOSED indication wherever required. This will include motor-operated valves also wherever required. In such cases the limit switches shall form an integral part of the valve. Stop-gap arrangement in this respect is not acceptable. (l) All valves except those with rising stems shall be provided with continuous mechanical position indicators; rising stem valves shall have only visual indication through plastic/metallic stem cover for sizes above 50 mm nominal bore. (m) For CI gate, globe and check valves wherever thickness of body/bonnet is not mentioned in the valves standards, thickness mentioned in IS- 1538 for fitting shall be applicable.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 12 OF 16

21/PS-PEM-MAX				एनटीपीसी NTPC	
CLAUSE NO.		TECHNICAL REQUIREMENTS			
2.13.01	MATERIAL OF CONSTRUCTION (GATE/GLOBE/CHECK VALVE)				
	(a) The materials shall generally comply with the following:				
	(1) Cast Steel Valves				
	Body & bonnet		ASTM A 216 Gr. WCB/ ASTM A 105		
	Disc for non-return Valves		ASTM A 216 Gr. WCB/ ASTM A 105		
	Trim.		ASTM A 182 Gr. F6 or Equivalent		
	(2) Stainless steel valves				
	Body & Bonnet		SS 304		
	Disc		-do-		
	Trim.		SS 316		
	(3) Cast iron valves				
	Body & bonnet		BS 1452 Gr. 14/ IS-210 Gr. FG 260		
	Seating surfaces and rings		13% chromium steel/ 13% Chrome overlay		
	Disc for non-return valves		BS 1452 Gr. 14/IS-210 Gr FG 260		
	Hinge pin for non-return valves		AISI 316		
	Stem for gate globe valves		13% chromium steel or Equivalent		
	Back seat		13 % chromium steel / 13% Chrome overlay		
2.14.00	(4) Gun Metal valves				
	Body and bonnet		IS 318 Gr. 2/ Equivalent Standard		
	Trim.		-do-		
	(b) Cast iron body valves shall have high alloy steel stem and seat.				
	(c) Material for counter flanges shall be the same as for the piping.				
	(d) Forged carbon steel valves are also acceptable in place of Gun metal valves.				
	Air Release Valve				
	(a) The air release valves shall be of automatic double air valve with two orifices and two floats. The float shall not close the valve at higher air velocities. The orifice contact joint with the float shall be leak tight joint.				
	LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)
					PAGE 13 OF 16

21/PS-PEM-MAX				एनटीपीसी NTPC	
CLAUSE NO.		TECHNICAL REQUIREMENTS			
		(b) The valve shall efficiently discharge the displaced air automatically from ducts/pipes while filling them and admit air automatically into the ducts/pipes while they are being emptied. The valve shall also automatically release trapped air from ducts/pipes during operation at the normal working pressure. (c) Body material of automatic air release valves shall comply generally with BS 1452 Gr. 14/IS: 210 Gr. FG 260. and spindle shall conform to high tensile brass. (d) Air release valves shall not have any integral isolation device within them. Each Air release valve shall be mounted, preceded by a separate isolation gate/ butterfly valve.			
2.15.00		Butterfly valves			
2.15.01		Design/Construction			
		(a) The valves shall be designed for the design pressure/temperature of the system on which it is installed and in accordance with AWWA-C-504, EN-593 or any other approved equivalent standard latest edition. Fabricated steel (IS: 2062 GR. E-250B) butterfly valves instead of cast iron body valves are also acceptable for size above 300 mm nb diameter. (b) The valves shall be suitable for installation in any position (horizontal/vertical etc.) and shall be generally of double-flanged construction. However for sizes 600 NB and below the valves of Wafer construction are also acceptable (c) Valves-350Nb and above shall have pressure equalizing bypass valves, wherever system parameters warrant the same. (d) Valves-200Nb and above shall also be provided with gear operator arrangement as a standard practice suitable for manual operation. Manual operation of valve shall be through gear arrangement having totally enclosed gearing with hand wheel diameter and gear ratio designed to meet the required operating torque It shall be designed to hold the valve disc in intermediate position between full open and full closed position without creeping or fluttering. Adjustable stops shall be provided to prevent over travel in either direction.			
		Limit and torque switches (if applicable) shall be enclosed in water tight enclosures along with suitable space heaters for motor actuated valves, which may be either for On-Off operation or inching operation with position transmitter.			
2.15.02		Material of Construction (Butterfly Valves)			
		Materials and other design details shall be as indicated below :			
		(a) Cast Iron Butterfly Valves Body & Disc ASTM A48, Gr. 40 with 2% Ni / IS: 210. Gr. FG-260, with 2% Ni / SG iron BSEN 1563, Gr EN GJS-400-15 with 2%Ni and epoxy coated Shaft BS 970 431 S: 291 / EN 57, or AISI-410 or AWWA-permitted shaft material equivalent to EN-57/AISI-410 or better. Seat ring 18-8 Stainless steel			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9		SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	
				PAGE 14 OF 16	



CLAUSE NO.	TECHNICAL REQUIREMENTS
2.15.03	Seal Nitrile Rubber (b) Stainless Steel Butterfly Valves Body & Disc SS 304 Shaft SS 316 Seat Rings EPT/BUNA-N/Neoprene (c) Carbon steel Butterfly Valves Body & Disc ASTM A 216, Gr. WCB Shaft SS 304 Disc & Seat Rings EPT/BUNA-N/Neoprene (d) Elastomer lined Butterfly Valves Body & Disc ASTM A48, Gr. 40 / IS: 210. Gr. FG-260 / SG Iron (ductile iron) IS 1865 Gr 400-15 or BSEN 1563, Gr EN GJS-400-15 / ASTM A 216, Gr. WCB with elastomer lining. Shaft SS 316 Proof of Design Test (Type Test) for Butterfly Valves Proof of Design (P.O.D.) test certificates shall be furnished by the bidder for all applicable size-ranges and classes of Butterfly valves supplied by him, in the absence of which actual P.O.D. test shall be conducted by the bidder. All valves that are designed and manufactured as per AWWA-C-504 / AWWA-C-516 shall be governed by the relevant clauses of P.O.D test in AWWA-C-504/AWWA-C-516. For Butterfly valves, designed and manufactured to EN-593 or equivalent, the P.O.D. test methods and procedures shall generally follow the guidelines of AWWA-C-504 in all respect except that Body & seat hydro test and disc-strength test shall be conducted at the pressures specified in EN-593 or the applicable code. Actuators shall also meet requirements of P.O.D. test of AWWA-C-504/AWWA-C-516.
2.16.00	Float operated valves (a) Valve shall automatically control the rate of filling and will shut off when a predetermined level is reached and close to prevent over flow on pre-set maximum water level. Valve shall also open and close in direct proportion to rise or fall of water level. (b) DESIGN AND CONSTRUCTION FEATURES The following design and construction feature of the valve shall be the minimum acceptable. (c) Valves shall be right-angled or globe pattern. (d) Valves shall be balance piston type with float ball. (e) Leather liner shall not be provided.
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9
SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 15 OF 16

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	(f) ~~The body and cover material shall be cast iron conforming to ASTM-A 126 Grade 'B' or IS: 210 Grade 200 or equivalent, and Float shall be of copper with epoxy painting of two (2) coats.~~ (g) Valves shall be suitable for flow velocities of 2 to 2.5 m/sec. (h) The valves shall have flanged connections. 2.17.00 Surface preparation and Painting for external piping surfaces (non-coastal projects) a) Surface preparation - Power tool cleaning / Shot blasting/ abrasive blasting b) Type of Primer - Red Oxide Zinc Phosphate primer (Alkyd base) to IS 12744 (2 X 25 microns) c) Intermediate Coat – Synthetic Enamel (long oil alkyd) to IS2932 (1 X 30 microns) d) Final Coat - Synthetic Enamel (long oil alkyd) to IS2932 (2 X 35 microns) Min. Total DFT (Microns) to be maintained – 150 (Min) and Color shall be as per NTPC Color Coding Scheme Note: No painting is required on Galvanized, Stainless Steel, Gun Metal surfaces 2.18.00 Surface preparation and Painting for external piping surfaces (coastal projects) a) Surface preparation - Near white metal blast cleaning with surface profile 35-50 microns as per surface preparation specification SSPC.SP10 of Society of Protective coatings , USA b) Type of Primer – Inorganic zinc (ethyl) silicate primer coat(1 X 70 microns): Self-curing Inorganic Zinc (ethyl) Silicate Primer Coat (having minimum 80% of metallic Zinc content in dry film , Solid by Volume Minimum 60% ±2%) to be applied over blast cleaned surface. c) Intermediate Coat (2 X 90 microns)– Polyamide Cured pigmented Micaceous Iron Oxide Epoxy based Paint (containing lamellar MIO minimum 30% on pigment, Solid by Volume Minimum 80% ±2%) Polyamide Cured pigmented Micaceous Iron Oxide Epoxy based Paint (containing lamellar MIO minimum 30% on pigment, Solid by Volume Minimum 80% ±2%). d) Final Coat (1 X 70 microns) - Acrylic Aliphatic Polyurethane, two pack, isocyanate based color pigmented Paint (Solid by Volume Minimum 55% ±2%) Min. Total DFT (Microns) to be maintained – 320 (Min) and Color shall be as per NTPC Color Coding Scheme Note: 1.) For external surfaces (galvanized steel), proper surface preparation with power tool cleaning up to grade ST2, ISO:8501-01 followed by zinc phosphate primer with 50 microns DFT, again followed by Acrylic Aliphatic Polyurethane coat of 40 microns DFT. 2.) If final shade of 9002 (off white) is required then Micaceous Iron Oxide (MIO) color shall be grey. 3.) No painting is required on Stainless Steel, Gun Metal surfaces.			
LOT-4 PROJECTS FLUEGAS DESULPHURISATION(FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.: CS-0011-109(4)-9	SUB-SECTION-I-M7 (LOW PRESSURE PIPING)	PAGE 16 OF 16	

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C2-B

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C2-B

PROJECT SPECIFIC GENERAL REQUIREMENTS

GENERAL TECHNICAL REQUIREMENTS

PART - C

CONTENTS

Clause No.	Description	Page No.
1.00.00	Introduction	1
2.00.00	Brand Name	1
3.00.00	Base Offer & Alternate Proposals	1
4.00.00	Completeness of Facilities	1
5.00.00	Codes & Standards	2
6.00.00	Equipment Functional Guarantee	4
7.00.00	Design of Facilities/ Maintenance & Availability Considerations	5
8.00.00	Documents, Data and Drawings to be furnished by Contractor	5
9.00.00	Technical Co-ordination Meeting	21
10.00.00	Design Improvements	22
11.00.00	Equipment Bases	22
12.00.00	Protective Guards	22
13.00.00	Lubricants, Servo fluids and Chemicals	23
14.00.00	Lubrication	23
15.00.00	Material of Construction	23
16.00.00	Rating Plates, Name Plates & Labels	23
17.00.00	Tools and Tackles	25
18.00.00	Welding	25

Clause No.	Description	Page No.
19.00.00	Colour Code for All equipments/Pipings/PlpeServices	25
20.00.00	Protection and Preserveative shop Coating	25
21.00.00	Quality Assurance Programme	26
22.00.00	General Requirements - Quality Assurance	27
23.00.00	Quality Assurance Documents	32
24.00.00	Project Manager's Supervision	34
25.00.00	Inspection, Testing and Inspection Certificates	34
26.00.00	Pre-commissioning and Commissioning Facilities	37
27.00.00	Taking over	40
28.00.00	Training of Employer's Personnel	40
29.00.00	Safety Aspects during Construction and Erection	41
30.00.00	Noise Level	42
31.00.00	Packaging and Transportation	42
32.00.00	Electrical Equipments/Enclosures	42
33.00.00	Instrumentation and Control	42
34.00.00	Electrical Noise Control	43
35.00.00	Surge protection for solid state equipment	44
36.00.00	Instrument Air System	44
37.00.00	Tapping Points for Measurements	44
38.00.00	System Documentation	44
39.00.00	Maintenance Manuals of Electronic Modules	45
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(4)-9



Clause No.	Description	Page No.
	Annexure - I	76
	Annexure - II	77
	Annexure - III	78
	Annexure - IV	79
	Annexure - V	80
	Annexure - VI	81
	Annexure - VII	83
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(4)-9

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
1.00.00	INTRODUCTION This part covers technical requirements which will form an integral part of the Contract. The following provisions shall supplement all the detailed technical specifications and requirements brought out in Section-VI, the Technical Specification and the Technical Data Sheets.			
2.00.00	BRAND NAME Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific item mentioned shall be understood to be indicative of the function and quality desired, and not restrictive; other manufacturer's products may be considered provided sufficient information is furnished to enable the Employer to determine that the products proposed are equivalent to those named.			
3.00.00	BASE OFFER & ALTERNATE PROPOSALS The Bidder's proposal shall be based upon the use of equipment and material complying fully with the requirements specified herein. It is recognised that the Contractor may have standardized on the use of certain components, materials, processes or procedures different than those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered, provided the base offer is in line with technical specifications and such proposals meet the specified design standards and performance requirement and are acceptable to the Employer. Sufficient amount of information for justifying such proposals shall be furnished to Employer alongwith the bid to enable the Employer to determine the acceptability of these proposals.			
4.00.00	COMPLETENESS OF FACILITIES			
4.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant shall be engineered and designed in accordance with the specification requirement. All engineering and associated services are required to ensure a completely engineered plant shall be provided.			
4.02.00	All equipments furnished by the Contractor shall be complete in every respect, with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or those needed for erection, completion and safe operation of the equipment and for the safety of the operating personnel, as required by applicable codes, though they may not have been specifically detailed in the respective specifications, unless included in the list of exclusions. All same standard components/ parts of same equipment provided, shall be interchangeable with one another.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 1 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
4.03.00	For the C&I systems, the Contractor shall be required to provide regular information about future upgrades and migration paths to the Employer.			
5.00.00	RULES, REGULATIONS, CODES & STANDARDS			
5.01.00	In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India, NTPC rules/codes of practices as well as of the locality where they will be installed, including the following: a) Indian Electricity Act b) Indian Electricity Rules c) Indian Explosives Act d) Indian Factories Act and State Factories Act e) Indian Boiler Regulations (IBR) f) Regulations of the Central Pollution Control Board, India g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India h) Pollution Control Regulations of Department of Environment, Government of India i) State Pollution Control Board. (j.) Rules for Electrical installation by Tariff Advisory Committee (TAC). (k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996 (l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998 (m.) Explosive Rules, 1983 (n.) Petroleum Act, 1984 (o.) Petroleum Rules, 1976,			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 2 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
5.02.00	(p.) Gas Cylinder Rules, 1981 (q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981 (r.) Workmen's Compensation Act, 1923 (s.) Workmen's Compensation Rules, 1924 (t.) NTPC Safety Rules for Construction and Erection (u.) NTPC Safety Policy (v.) Any other statutory codes / standards / regulations, as may be applicable. Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply: a) Bureau of Indian standards (BIS) b) Japanese Industrial Standards (JIS) c) American National Standards Institute (ANSI) d) American Society of Testing and Materials (ASTM) e) American Society of Mechanical Engineers (ASME) f) American Petroleum Institute (API) g) Standards of the Hydraulic Institute, U.S.A. h) International Organisation for Standardisation (ISO) i) Tubular Exchanger Manufacturer's Association (TEMA) j) American Welding Society (AWS) k) National Electrical Manufacturers Association (NEMA) l) National Fire Protection Association (NFPA) m) International Electro-Technical Commission (IEC)/European Norm (EN) n) Expansion Joint Manufacturers Association (EJMA) o) Heat Exchange Institute (HEI)	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
		PAGE 3 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
5.03.00	p) IEEE standard q) JEC standard Other International/ National standards such as DIN, JIS, VDI, EN, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English.			
5.04.00	Not used.			
5.05.00	In the event of any conflict between the codes and standards referred to in the above clauses and the requirement of this specification, the requirement of Technical Specification shall govern.			
5.06.00	Two (2) English language copies of all national and international codes and/or standards used in the design of the plant, equipment, civil, structural and architectural works shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award.			
5.07.00	In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the Employer shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of the Employer such changes and advise Employer of the resulting effect.			
5.08.00	A detailed list of standards apart from those mentioned in the respective detailed specifications in other parts of Section-VI to which all equipment/systems/civil works should conform as indicated in this Part C and elsewhere in the specification.			
6.00.00	EQUIPMENT FUNCTIONAL GUARANTEE			
6.01.00	The functional guarantees of the equipment under the scope of the Contract is given in ~~Section-VI Part A of~~ Technical Specifications. These guarantees shall supplement the general functional guarantee provisions covered under Defect liabilities Section-IV, General Conditions of Contract.			
6.02.00	Liquidated damages for shortfall in meeting functional guarantee(s) during the performance and guarantee tests shall be assessed and recovered from the Contractor as specified elsewhere in this specification.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 4 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
7.00.00	DESIGN OF FACILITIES/ MAINTENANCE & AVAILABILITY CONSIDERATIONS	
7.01.00	DESIGN OF FACILITIES	
	All the design procedures, systems and components proposed shall have already been adequately developed and shall have demonstrated good reliability under similar conditions elsewhere. The Contractor shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic requirements are detailed out in various clauses of the Technical Specifications. The design of various components, assemblies and subassemblies shall be done so that it facilitates easy field assembly and dismantling. All the rotating components shall be so selected that the natural frequency of the complete unit is not critical or close to the operating range of the unit.	
7.02.00	MAINTENANCE AND AVILABILITY CONSIDERATIONS	
	Equipment/works offered shall be designed for high availability, low maintenance and ease of maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability/ availability and ease of maintenance. The Bidder shall also furnish details of availability records in the reference plants stated in his experience list. Bidder shall state in his offer the various maintenance intervals, spare parts and man-hour requirement during such operation. The intervals for each type of maintenance namely inspection of the furnace, inspection of the entire hot gas path and the minor and major overhauls shall be specified in terms of fired hours , clearly defining the spare parts and man-hour requirement for each stage. ~~Lifting devices i.e. hoists and chain pulley jacks ,etc. shall be provided by the contractor for handling of any equipment or any of its part having weight in excess of 500 Kgs during erection and maintenance activities.~~ ~~Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist / crane shall be provided by the contractor for lifting the equipment and accessories covered under the specification.~~	
8.00.00	DOCUMENTS, DATA AND DRAWINGS TO BE FURNISHED BY CONTRACTOR	
8.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant and equipment shall be fully integrated, engineered and designed to perform in accordance with the technical specification. All engineering and technical services required to ensure a completely	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
PAGE 5 OF 83		

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	engineered plant shall be provided in respect of mechanical, electrical, control & instrumentation, civil & structural works as per the scope. Each main and auxiliary equipment/item of the plant including instruments shall be assigned a unique tag number. The assignment of tag numbers shall be in accordance with KKS system. In all drawings/documents/data sheet etc. KKS tag number of the equipment/item/instrument etc. shall be indicated. The Contractor shall furnish engineering data /drawings in accordance with the schedule of information as specified in Technical Data Sheets and Technical Specification. A comprehensive engg and quality coordination procedure shall be finalized with the successful bidder covering salient features as described in this section of specifications.			
8.02.00	The number of copies/prints/CD-ROMs/manuals to be furnished for various types of document is given in Annexure-VI to this Part-C, ~~Section VI~~ of the Technical Specification.			
8.03.00	The ~~documentation~~ that shall be provided by the Contractor is indicated in the various sections of specification. This documentation shall include but not be limited to the following:			
8.03.01	A) BASIC ENGINEERING DOCUMENTATION Prior to commencement of the detailed engineering work, the Contractor shall furnish a Plant Definition Manual within 12 weeks from the date of the Notification of Award. This manual shall contain the following as a minimum: i) System description of all the mechanical, electrical, control & instrumentation & civil systems. ii) Technology scan for each system / sub-system & equipment. iii) Selection of appropriate technology / schemes for various systems/ subsystems including techno-economic studies between various options. iv) Optimisation studies including thermal cycle optimisation. v) Sizing criteria of all the systems, sub-systems/ equipments/ structures/ equipment foundations alongwith all calculations justifying and identifying the sizing and the design margins. vi) Schemes and Process & Instrumentation diagrams for the various systems/ sub-system with functional write-ups.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 6 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	x) Mass Balance Diagram xi) Characteristic Curves/ Performance Correction Curves. xii) Comprehensive list of all terminal points which interface with Employer's facilities, giving details of location, terminal pressure, temperature, fluid handled & end connection details, forces, moments etc. xiii) Power supply single line diagram, block logics, control schematics, electrical schematics, etc. xiv) Protection system diagrams and relay settings. xv) Cables schedules and interconnection diagrams. xvii) Cable routing plan. xviii) Instrument schedule, measuring point list, I/O list, Interconnection & wiring diagram, functional write-ups, and installation drawings for field mounted instruments, logic diagrams, control schematics, wiring and tubing diagrams of panels and enclosures etc. Drawings for open loop and close loop controls (both hardware and software). Motor list and valve schedule including type of actuator etc. xix) Alarm and annunciation/ Sequence of Event (SOE) list and alarms & trip set points. xx) Sequence and protection interlock schemes. xxi) Type test reports, insulation co-ordination study report xxii) Control system configuration diagrams and card circuit diagrams and maintenance details. xxiii) Detailed Control system manuals. xxiv) Detailed flow chart for digital control system. xv) Mimic diagram layout, Assignment for other application engg. drawings and documents. xxvi) Civil and Structural works drawings and documents for all structures, facilities, architectural works, foundations underground and overground works and super-structural works as included in the			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 8 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.03.02	scope of the bidder civil calculation sheets including structural analysis and design alongwith output results. xxvii) Underground facilities, levelling, sanitary, land scaping drawings. xxviii) Geotechnical investigation and site survey reports (if and as applicable). xxix) Model study reports wherever applicable. xxx) Functional & guarantee test procedures and test reports. xxxi) Documentation in respect of Quality Assurance System, and Documentation in respect of Commissioning, as listed out elsewhere in this specification. xxxii) Maintenance schedule for Absorber & auxiliaries clearly indicating interval, duration if shutdown required, manhours required and tools & tackles required for maintenance. The Contractor's while submitting the above documents/ drawings for approval/ reference as the case may be, shall mark on each copy of submission the reference letter alongwith the date vide which the submissions are made.			
	INSTRUCTION MANUALS The Contractor shall make first submission of instruction manual for all the equipments covered under the Contract as per agreed engineering information schedule. The Instruction manuals shall contain full details required for erection, commissioning, operation and maintenance of each equipment. The manual shall be specifically compiled for this project. After finalisation and approval of the Employer the Instruction Manuals shall be submitted as indicated in Annexure-IV. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals have been supplied to the Employer. The Instruction Manuals shall comprise of the following. A) ERECTION MANUALS The erection manuals shall be submitted atleast three (3) months prior to the commencement of erection activities of particular equipment/system. The erection manual should contain the following as a minimum. a) Erection strategy. b) Sequence of erection.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 9 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	c) Erection instructions. d) Critical checks and permissible deviation/tolerances. e) List of tool, tackles, heavy equipments like cranes, dozers, etc. f) Bill of Materials g) Procedure for erection and General Safety procedures to followed during erection/installation. h) Procedure for initial checking after erection. i) Procedure for testing and acceptance norms. j) Procedure / Check list for pre-commissioning activities. k) Procedure / Check list for commissioning of the system. l) Safety precautions to be followed in electrical supply distribution during erection. B) OPERATION & MAINTENANCE MANUALS a) The manual shall be a two rim PVC bound stiff sided binder able to withstand constant usage or where a thicker type is required it shall have locking steel pins, the size of the manual shall not be larger than international size A3. The cover shall be printed with the Project Name, Services covered and Volume / Book number Each section of the manual shall be divided by a stiff divider of the same size as the holder. The dividers shall clearly state the section number and title. All written instructions within the manual not provided by the manufacturers shall be typewritten with a margin on the left hand side. b) The arrangement and contents of O & M manuals shall be as follows: 1) Chapter 1 - Plant Description: To contain the following sections specific to the equipment/system supplied (a) Description of operating principle of equipment / system with schematic drawing / layouts.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 10 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(b) Functional description of associated accessories / controls. Control interlock protection write up. (c) Integrated operation of the equipment alongwith the intended system. (This is to be given by the supplier of the Main equipment by taking into account the operating instruction given by the associated suppliers). (d) Exploded view of the main equipment, associated accessories and auxiliaries with description. Schematic drawing of the equipment alongwith its accessories and auxiliaries. (e) Design data against which the plant performance will be compared. (f) Master list of equipments, Technical specification of the equipment/ system and approved data sheets. (g) Identification system adopted for the various components, (it will be of a simple process linked tagging system). (h) Master list of drawings (as built drawing - Drawings to be enclosed in a separate volume). 2) <u>Chapter 2.0 - Plant Operation</u>: To contain the following sections specific to the equipment supplied (a) Protection logics provided for the equipment alongwith brief philosophy behind the logic, Drawings etc. (b) Limiting values of all protection settings. (c) Various settings of annunciation/interlocks provided. (d) Startup and shut down procedure for equipment alongwith the associated systems in step mode. (e) Do's and Don'ts related to operation of the equipment. (f) Safety precautions to be take during normal operation. Emergency instruction on total power failure condition/lubrication failure/any other conditions. (g) Parameters to be monitored with normal value and limiting values. (h) Equipment isolating procedures.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 11 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(i) Trouble shooting with causes and remedial measures. (j) Routine testing procedure to ascertain healthiness of the safety devices alongwith schedule of testing. (k) Routine Operational Checks, Recommended Logs and Records (l) Change over schedule if more than one auxiliary for the same purpose is given. (m) Preservation procedure on long shut down. (n) System/plant commissioning procedure. 3) <u>Chapter 3.0 - Plant Maintenance</u>- To contain the following sections specific to the equipment supplied. (a) Exploded view of each of the equipments. Drawings alongwith bill of materials including name, code no. & population. (b) Exploded view of the spare parts and critical components with dimensional drawings (In case of Electronic cards, the circuit diagram to be given) and spare parts catalogue for each equipment. (c) List of Special T/ P required for Overhauling /Trouble shooting including special testing equipment required for calibration etc. (d) Stepwise dismantling and assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained etc. Clearance to be maintained etc. (e) Preventive Maintenance schedules linked with running hours/calendar period alongwith checks to be carried out. (f) Overhauling schedules linked with running hours/calendar period alongwith checks to be done. (g) Long term maintenance schedules (h) Consumables list alongwith the estimated quantity required during normal running and during maintenance like Preventive Maintenance and Overhauling. (i) List of lubricants with their Indian equivalent, Lubrication Schedule including charts showing lubrication checking, testing and replacement procedure to be carried daily, weekly, monthly & at			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 12 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	longer intervals to ensure trouble free operation and quantity required for complete replacement. (j) Tolerance for fitment of various components. (k) Details of sub vendors with their part no. in case of bought out items. (l) List of spare parts with their Part No, total population, life expediency & their interchangeability with already supplied spares to NTPC. (m) List of mandatory and recommended spare list along with manufacturing drawings, material specification & quality plan for fast moving consumable spares. (n) Lead time required for ordering of spares from the equipment supplier, instructions for storage and preservation of spares. (o) General information on the equipment such as modification carried out in the equipment from its inception, equipment population in the country / foreign country and list of utilities where similar equipments have been supplied.			
8.03.03	After finalization and approval of the Employer, the O & M Manuals shall be submitted as indicated in Annexure-VI. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals (both erection and O & M manuals have been supplied to the Employer. If after the commissioning and initial operation of the plant, the instruction manuals (Erection and /or O &M manuals) require modifications/additions/ changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer for records and number of copies shall be as mentioned in Annexure-VI.			
8.03.03	PLANT HANDBOOK AND PROJECT COMPLETION REPORT			
8.03.03.01	PLANT HANDBOOK			
	The Contractor shall submit to the Employer a preliminary plant hand book preferably in A-4 size sheets which shall contain the design and performance data of various plants, equipments and systems covering the complete project including i) Design and performance data. ii) Process & Instrumentation diagrams. iii) Single line diagrams.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 13 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	iv) Sequence & Protection Interlock Schemes. v) Alarm and trip values. vi) Performance Curves. vii) General layout plan and layout of main plant building and auxiliary buildings viii) Important Do's & Don't's The plant handbook shall be submitted within twelve (12) months from the date of award of contract. After the incorporation of Employer's comments, the final plant handbook complete in all respects shall be submitted three (3) months before start-up and commissioning activities.		
8.03.03.02	PROJECT COMPLETION REPORT The Contractor shall submit a Project Completion Report at the time of handing over the plant.		
8.03.04	DRAWINGS a) i) All the FGD plant layouts shall be made in computerised 3D modelling system. The Employer reserves the right to review the 3D model at different stages during the progress of engineering. The layout drawings submitted for Employer's review shall be fully dimensioned and extracted from 3D model after interference check. ii) All documents submitted by the Contractor for Employer's review shall be in electronic form (soft copies) along with the desired number of hard copies as per Annexure-VI of Part-C. The soft copies shall be uploaded by the vendors in C-folders, a Web-based system of NTPC ERP, for which a username and password will be allotted to the new vendor by NTPC. Similarly, the vendor can download the drawings/documents, approved/ commented by NTPC, through above site. The soft copies of identified drawings/documents shall be in pdf format, whereas the attachments/reply to the submitted document(s) can be in .doc, .xls, .pdf, .dwg or .std formats. iii) Final copies of the approved drawings along with requisite number of hard copies shall be submitted as per Annexure-VI of Part-C. iv) Contractor shall prepare the model of all the facilities located in FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE (including all		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 14 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	facilities), and any other facility in an integrated & intelligent 3D software solution using rule-based, data centric 3D Design software with equipment drawings, data sheets, intelligent P&ID correlated with intelligent 3D Model, BOQ, schematics and logic diagrams etc. attached to the respective equipment / systems in the aforesaid 3D model. Contractor shall make a presentation on 3D model every 3 months from LOA to enable NTPC to review the progress of engineering. After the completion of engineering the corresponding complete 3D review model shall be handed over to the employer for its reference. Contractor shall provide 3D model (which shall include visual interference check, walk-through animation, video simulation for major equipment placement and removal, visual effect, photo realism etc), which is extracted from intelligent 3D model, for employer's review as & when desired by employer. However, all piping layouts, equipment layouts, floor plans, ducting layout (Air/flue gas, A/C, Ventilation etc.), General Arrangement drawings of major buildings, structural arrangement drawings and RCC layout drawings shall necessarily be extracted from the aforesaid 3D model and submitted for employer's review along with the 3D review model to enable NTPC to review and approve these drawings. b) All documents/text information shall be in latest version of MS Office / MS Excel / PDF FORMAT as applicable. c) All drawings submitted by the Contractor including those submitted at the time of bid shall be in sufficient detail indicating the type, size, arrangement, weight of each component for packing and shipment, the external connection, fixing arrangement required, the dimensions required for installation and interconnections with other equipments and materials, clearance and spaces required between various portions of equipment and any other information specifically requested in the drawing schedules. d) Each drawing submitted by the Contractor (including those of subvendors) shall bear a title block at the right hand bottom corner with clear mention of the name of the Employer, the system designation, the specifications title, the specification number, the name of the Project, drawing number and revisions. If standard catalogue pages are submitted the applicable items shall be indicated therein. All titles, notings, markings and writings on the drawing shall be in English. All the dimensions should be in metric units. e) The drawings submitted by the Contractor (or their subvendors) shall bear Employer's drawing number in addition to contractor's (their sub-vendor's) own drawing number. Employer's drawing numbering system shall be made available to the successful bidder so as to enable him to assign Employer's drawing numbers to the drawings to be submitted by him during the course of execution of the Contract.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 15 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	The Contractor shall also furnish a "Master Drawing List" which shall be a comprehensive list of all drawings/ documents/ calculations envisaged to be furnished by him during the detailed engineering to the Employer. Such list should clearly indicate the purpose of submission of these drawings i.e. "FOR APPROVAL" or "FOR INFORMATION ONLY". Similarly, all the drawings/ documents submitted by the Contractor during detailed engineering stage shall be marked "FOR APPROVAL" or "FOR INFORMATION" prior to submission. Further, space shall be identified on each drawing for Approval stamp and electronic signature. f) The furnishing of detailed engineering data and drawings by the Contractor shall be in accordance with the time schedule for the project. The review of these documents/ data/ drawings by the Employer will cover only general conformance of the data/ drawings/ documents to the specifications and contract, interfaces with the equipments provided by others and external connections & dimensions which might affect plant layout. The review by the Employer should not be construed to be a thorough review of all dimensions, quantities and details of the equipments, materials, any devices or items indicated or the accuracy of the information submitted. The review and/ or approval by the Employer/ Project Manager shall not relieve the Contractor of any of his responsibilities and liabilities under this contract. g) After the approval of the drawings, further work by the Contractor shall be in strict accordance with these approved drawings and no deviation shall be permitted without the written approval of the Employer. h) All manufacturing, fabrication and execution of work in connection with the equipment / system, prior to the approval of the drawings, shall be at the Contractor's risk. The Contractor is expected not to make any changes in the design of the equipment /system, once they are approved by the Employer. However, if some changes are necessitated in the design of the equipment/system at a later date, the Contractor may do so, but such changes shall promptly be brought to the notice of the Employer indicating the reasons for the change and get the revised drawing approved again in strict conformance to the provisions of the Technical Specification. i) Drawings shall include all installations and detailed piping layout drawings. Layout drawings for all piping of 65 mm and larger diameter shall be submitted for review/ approval of Employer prior to erection. Small diameter pipes shall however be routed as per site conditions in consultation with site authority/ representative of Employer based on requirements of such piping indicated in approved/ finalised Flow Scheme/ Process & Instrumentation Diagrams and/or the requirements cropping up for draining & venting of larger diameter piping or otherwise after their erection as per actual physical condition for the entire scope of work of this package.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 16 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Assessing & anticipating the requirement and supply of all piping and equipment shall be done by the contractor well in advance so as not to hinder the progress of piping & equipment erection, subsequent system charging and its effective draining & venting arrangement as per site suitability. j) As Built Drawings After final acceptance of individual equipment / system by the Employer, the Contractor will update all original drawings and documents for the equipment / system to “as built” conditions and submit no. of copies as per Annexure VI. k) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to Engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data/ drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. l) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The Employer shall review the drawings and return soft copy to the Contractor authorizing either to proceed with manufacture or fabrication, or marked to show changes desired. When changes are required, drawings shall be re-submitted promptly, with revisions clearly marked, for final review. Any delays arising out of the failure of the Contractor to submit/rectify and resubmit in time shall not be accepted as a reason for delay in the contract schedule. m) All engineering data submitted by the Contractor after final process including review and approval by the Project Manager/ Employer shall form part of the contract documents and the entire works covered under these specification shall be performed in strict conformity with technical specifications unless otherwise expressly requested by the Project Manager in writing. n) The Contractor shall submit drawings in line with the suggestive MDL covered in Part-B, Section-VI of Technical Specification and which shall be duly integrated with approved PERT network.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 17 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
8.04.00	ENGINEERING INFORMATION SUBMISSION SCHEDULE Prior to the award of Contract, a Detailed Engineering Information Submission Scheduler/Master Drawing List duly integrated with approved PERT network shall be tied up with the Employer. For this, the bidder shall furnish a detailed list of engineering information alongwith the proposed submission schedule. This list would be a comprehensive one including all engineering data / drawings / information for all bought out items and manufactured items. The information shall be categorized into the following parts. i) Information that shall be submitted for the approval to the Employer before proceeding further, and ii) Information that would be submitted for Employer's information only. The Master Drawing List (MDL) shall be updated periodically and submitted to the employer, highlighting the changes made in MDL. The schedule should allow adequate time for proper review and incorporation of changes/ modifications, if any, to meet the contract without affecting the equipment delivery schedule and overall project schedule. The early submission of drawings and data is as important as the manufacture and delivery of equipment and hardware and this shall be duly considered while determining the overall performance and progress.		
8.05.00	ENGINEERING PROGRESS AND EXCEPTION REPORT		
8.05.01	The Contractor shall submit every month an Engineering progress and Exception Report giving the status of each engineering information including a) A list of drawings/engineering information which remains unapproved for more than four (4) weeks after the date of first submission b) Drawings which were not submitted as per agreed schedule.		
8.05.02	The draft format for this report shall be furnished to the Employer within four (4) weeks of the award of the contract, which shall then be discussed and finalised with the Employer.		
8.06.00	Engineering Co-ordination Procedure		
8.06.01	The following principal coordinators will be identified by respective organizations at time of award of contract: NTPC Engineering Coordinator (NTPC EC):		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 18 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE : Contractor's/ Vendor's Engineering Coordinator (VENDOR EC): Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE :			
8.06.02	All engineering correspondence shall be in the name of above coordinators on behalf of the respective organizations.			
8.06.03	Contractor's/Vendor's Drawing Submission and Approval Procedure: a) All data/information furnished by Vendor in the form of drawings/ documents/catalogues or in any other form for NTPC's information/ interface and or review and approval are referred by the general term "drawings". b) The 'Master drawings list' indicating titles, Drawing Number, Date of submission and approval etc. shall be finalised mutually between Contractor and Employer before the award of contract. This list shall be updated if required at suitable interval during detailed engineering. c) All drawings (including those of subvendor's) shall bear at the right hand bottom corner the 'title plate' with all relevant information duly filled in. The Contractor shall furnish this format to his subvendor along with his purchase order for subvendor's compliance.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 19 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	d) Employer and contractor shall follow their own numbering systems for the drawings. However, Employer shall intimate the contractor, NTPC drawing number on receipt of the first submission of each drawing. Vendor, thereafter, shall indicate NTPC's drawing number in subsequent Submission, in the space provided for this purpose in title plate, in addition to his own drawing number. e) The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data / drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. f) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper endorsement for checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. g) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The drawings submitted by the Contractor/vendor shall be reviewed by NTPC and their comments shall be forwarded within four (4) weeks of receipt of drawings. Upon review of each drawing, depending on the correctness and completeness of the drawing, the same will be categorized and approval accorded in one of the following categories : CATEGORY- I: Approved CATEGORY- II Approved, subject to incorporation of comments/ modification as noted. Resubmit revised drawing incorporating the comments. CATEGORY –III Not approved. Resubmit revised drawings for approval after incorporating comments/ modification as noted. CATEGORY -IV For information and records. h) Contractor shall resubmit the drawings approved under Category II, III & IV within three (3) weeks of receipt of comments on the drawings, incorporating all comments. Every revision of the drawing shall bear a revision index wherein such revisions shall be highlighted in the form of description or marked up in the drawing identifying the same with relevant revision Number			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 20 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	enclosed in a triangle (eg. 1, 2, 3 etc). Contractor shall not make any changes in the portions of the drawing other than those commented. If changes are required to be made in the portions already approved, the Contractor shall resubmit the drawing identifying the changes for Employer's review and approval. Drawings resubmitted shall show clearly the portions where the same are revised marking the relevant revision numbers and Employer shall review only such revised portion of documents. i) In case, the Contractor/ Vendor does not agree with any specific comment, he shall furnish the explanation for the same to NTPC for consideration. In all such cases the Contractor shall necessarily enclose explanations along with the revised drawing (taking care of balance comments) to avoid any delay and/or duplication in review work. j) It is responsibility of the Contractor/ Vendor to get all the drawings approved in the Category I & IV (as the case may be) and complete engineering activities within the agreed schedule. Any delay arising out of submission and modification of drawings shall not alter the contract completion schedule. k) If Contractor/ Vendor fails to resubmit the drawings as per the schedule, construction work at site will not be held up and work will be carried out on the basis of comments furnished on previous issues of the drawing. l) These comments will be taken care by the contractor while submitting the revised drawing. The contractor shall use a single transmittal for drawings. Submission. This shall include transmittal numbers and date, number of copies being sent, names of the agencies to whom copies being sent, drawing number and titles, remarks or special notes if any etc.		
9.00.00	TECHNICAL CO-ORDINATION MEETING		
9.01.00	The Contractor shall be called upon to organise and attend monthly Design/ Technical Co-ordination Meetings (TCMs) with the Employer/Employer's representatives and other Contractors of the Employer during the period of contract. The Contractor shall attend such meetings at his own cost at NEW DELHI / NOIDA or at mutually agreed venue as and when required and fully co-operate with such persons and agencies involved during the discussions.		
9.02.00	The Contractor should note that Time is the essence of the contract. In order to expedite the early completion of engineering activities, the Contractor shall submit all drawings as per the agreed Engineering Information Submission Schedule. The drawings submitted by the Contractor will be reviewed by the Employer as far as practicable within three (3) weeks from the date of receipt of the drawing .The		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 21 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनडीपीसी NTPC		
	comments of the Employer shall then be discussed across the table during the above Technical Co-ordination Meeting (s) wherein best efforts shall be made by both sides to ensure the approval of the drawing.			
9.02.01	The Contractor shall ensure availability of the concerned experts / consultants/ personnel who are empowered to take necessary decisions during these meetings. The Contractor shall be equipped with necessary tools and facilities so that the drawings/documents can be resubmitted after incorporating necessary changes and approved during the meeting itself.			
9.02.02	Should any drawing remain unapproved for more than six (6) weeks after it's first submission ,this shall be brought out in the monthly Engineering Progress and Exception Report with reasons thereof.			
9.03.0	Any delays arising out of failure by the Contractor to incorporate Employer's comments and resubmit the same during the TCM shall be considered as a default and in no case shall entitle the Contractor to alter the Contract completion date.			
10.00.00	DESIGN IMPROVEMENTS The Employer or the Contractor may propose changes in the specification of the equipment or quality thereof and if the parties agree upon any such changes the specification shall be modified accordingly. If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any changing the price and/or schedule of completion before the Contractor proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.			
11.00.00	EQUIPMENT BASES A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base, unless otherwise specifically agreed to by the Employer. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.			
12.00.00	PROTECTIVE GUARDS Suitable guards shall be provided for protection of personnel on all exposed rotating and/or moving machine parts. All such guards shall be designed for easy installation and removal for maintenance purpose.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 22 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
13.00.00	LUBRICANTS, SERVO FLUIDS AND CHEMICALS			
13.01.00	I. All the first fills of consumables and one years topping requirement of consumables such as greases, oil, lubricants, servo fluids / control fluids, gases and essential chemicals etc. which will be required to put the equipment covered under the scope of specifications, into successful commissioning / initial operation and to establish completion of facilities shall be supplied by the Contractor. Suitable standard lubricants as available in India are desired. Efforts should be made to limit the variety of lubricants to minimum. Bidder shall supply a quantity not less than 10 % of the full charge or one (1) year topping requirement mentioned above (whichever is higher) of each variety of lubricants, servo fluids, gases, chemicals etc (as detailed above) which is expected to be utilized during the first year of operation. The additional quantity shall be supplied in separate container.			
13.02.00	As far as possible lubricants marketed by the Indian Oil Corporation shall be used. The variety of lubricants shall be kept to a minimum possible. Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals etc. required for the complete plant covered herein shall be furnished. On completion of erection, a complete list of bearings/ equipment giving their location and identification marks shall be furnished to the Employer alongwith lubrication requirements.			
14.00.00	LUBRICATION			
14.01.00	Equipment shall be lubricated by systems designed for continuous operation. Lubricant level indicators shall be furnished and marked to indicate proper levels under both standstill and operating conditions.			
15.00.00	MATERIAL OF CONSTRUCTION			
15.01.00	All materials used for the construction of the equipment shall be new and shall be in accordance with the requirements of this specification. Materials utilised for various components shall be those which have established themselves for use in such applications.			
16.00.00	RATING PLATES, NAME PLATES & LABELS			
16.01.00	Each main and auxiliary item of plant including instruments shall have permanently attached to it in a conspicuous position, a rating plate of non-corrosive material upon which shall be engraved manufacturer's name, equipment, type or serial number together with details of the ratings, service conditions under which the item of plant in question has been designed to operate, and such diagram plates as may be required by the Employer.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 23 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
16.02.00	Each item of plant shall be provided with nameplate or label designating the service of the particular equipment. The inscriptions shall be approved by the Employer or as detailed in appropriate section of the technical specifications.			
16.03.00	Such nameplates or labels shall be of white nonhygroscopic material with engraved black lettering or alternately, in the case of indoor circuit breakers, starters, etc. of transparent plastic material with suitably coloured lettering engraved on the back. The name plates shall be suitably fixed on both front and rear side.			
16.04.00	Items of plant such as valves, which are subject to handling, shall be provided with an engraved chromium plated nameplate or label with engraving filled with enamel. The name plates for valves shall be marked in accordance with MSS standard SP-25 and ANSI B 16.34 as a minimum.			
16.05.00	Hanger/ support numbers shall be marked on all pipe supports, anchors, hangers, snubbers and restraint assemblies. Each constant and variable spring support shall also have stamped upon it the designed hot and cold load which it is intended to support. Suitable scale shall also be provided to indicate load on support or hanger.			
16.06.00	Valves, steam traps and strainers shall be identified by Employer's tag number of a metal tap permanently attached to non pressure parts such as the yoke by a stainless steel wire. The direction of flow shall also be marked on the body.			
16.07.00	Safety and relief valves shall be provided with the following: a) Manufacturer's identification. b) Nominal inlet and outlet sizes in mm. c) Set pressure in Kg/cm² (abs). d) Blowdown and accumulation as percentage of set pressure. e) Certified capacity in Kg of saturated steam per hour or in case of liquid certified capacity in litres of water per minute.			
16.08.00	All such plates, instruction plates, etc. shall be bilingual with Hindi inscription first, followed by English. Alternatively, two separate plates one with Hindi and the other with English inscriptions may be provided.			
16.09.00	All segregated phases of conductors or bus ducts, indoor or outdoor, shall be provided with coloured phase plates to clearly identify the phase of the system.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 24 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनडीपीसी NTPC		
17.00.00	TOOLS AND TACKLES The Contractor shall supply with the equipment one complete set of all special tools and tackles and other instruments required and other instruments for the erection, assembly, disassembly and proper maintenance of the plant and equipment and systems (including software). These special tools will also include special material handling equipment, jigs and fixtures for maintenance and calibration / readjustment, checking and measurement aids etc. A list of such tools and tackles shall be submitted by the Bidder alongwith the offer. The price of each tool / tackle shall be deemed to have been included in the total bid price. These tools and tackles shall be separately packed and sent to site. The Contractor shall also ensure that these tools and tackles are not used by him during erection, commissioning and initial operation. For this period the Contractor should bring his own tools and tackles. In case these tools and tackles are used by the Contractor during erection, commissioning or initial operation the same shall be refurbished repaired/replaced as required to the satisfaction of the Employer before handing over to the Employer. All the tools and tackles shall be of reputed make acceptable to the Employer.			
18.00.00	WELDING			
18.01.00	If the manufacturer has special requirements relating to the welding procedures for welds at the terminals of the equipments to be per formed by others the requirements shall be submitted to the Employer in advance of commencement of erection work.			
19.00.00	COLOUR CODE FOR ALL EQUIPMENTS/ PIPINGS/ PIPE SERVICES			
19.01.00	All equipment/ piping/ pipe services are to be painted by the Contractor in accordance with Employer's standard colour coding scheme, which will be furnished to the Contractor during detailed engineering stage.			
20.00.00	PROTECTION AND PRESERVATIVE SHOP COATING			
20.01.00	PROTECTION All coated surfaces shall be protected against abrasion, impact, discoloration and any other damages. All exposed threaded portions shall be suitably protected with either metallic or a nonmetallic protection device. All ends of all valves and piping and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage. The parts which are likely to get rusted, due to exposure to weather, should also be properly treated and protected in a suitable manner. All primers/paints/coatings shall take into account the hot humid, corrosive & alkaline, subsoil or over ground environment as the case may be. The requirements for			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 25 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
	painting specification shall be complied with as detailed out in Part-A & B of the Technical Specification.	
20.02.00	PRESERVATIVE SHOP COATING All exposed metallic surfaces subject to corrosion shall be protected by shop application of suitable coatings. All surfaces which will not be easily accessible after the shop assembly, shall be treated beforehand and protected for the life of the equipment. All surfaces shall be thoroughly cleaned of all mill scales, oxides and other coatings and prepared in the shop. The surfaces that are to be finish-painted after installation or require corrosion protection until installation, shall be shop painted as per the requirements covered in the relevant part of the Technical Specification.	
	Transformers and other electrical equipments, if included shall be shop finished with one or more coats of primer and two coats of high grade resistance enamel. The finished colors shall be as per manufacturer's standards, to be selected and specified by the Employer at a later date.	
20.03.00	Shop primer for all steel surfaces which will be exposed to operating temperature below 95 degrees Celsius shall be selected by the Contractor after obtaining specific approval of the Employer regarding the quality of primer proposed to be applied. Special high temperature primer shall be used on surfaces exposed to temperature higher than 95 degrees Celsius and such primer shall also be subject to the approval of the Employer.	
20.04.00	All other steel surfaces which are not to be painted shall be coated with suitable dust preventive compound subject to the approval of the Employer.	
20.05.00	All piping shall be cleaned after shop assembly by shot blasting or other means approved by the Employer. Lube oil piping or carbon steel shall be pickled.	
20.06.00	Painting for Civil structures and equipment/system covered under this package shall be done as specified under technical requirements on civil works in relevant part of this specifications.	
21.00.00	QUALITY ASSURANCE PROGRAMME	
21.01.00	To ensure that the equipment and services under the scope of contract whether manufactured or performed within the Contractor's works or at his sub-contractor's premises or at the Employer's site or at any other place of work are in accordance with the specifications, the Contractor shall adopt suitable quality assurance programme to control such activities at all points, as necessary. Such programmes shall be outlined by the Contractor and shall be finally accepted by the Employer/authorised representative after discussions before the award of the contract. The QA programme shall be generally in line with ISO-9001/IS-14001. A	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 26 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	quality assurance programme of the contractor shall generally cover the following: a) His organisation structure for the management and implementation of the proposed quality assurance programme b) Quality System Manual c) Design Control System d) Documentation Control System e) Qualification data for Bidder's key Personnel. f) The procedure for purchase of materials, parts, components and selection of sub-contractor's services including vendor analysis, source inspection, incoming raw-material inspection, verification of materials purchased etc. g) System for shop manufacturing and site erection control including process controls and fabrication and assembly controls. h) Control of non-conforming items and system for corrective actions. i) Inspection and test procedure both for manufacture and field activities. j) Control of calibration and testing of measuring testing equipments. k) System for Quality Audits. l) System for indication and appraisal of inspection status. m) System for authorising release of manufactured product to the Employer. n) System for handling storage and delivery. o) System for maintenance of records, and p) Furnishing of quality plans for manufacturing and field activities detailing out the specific quality control procedure adopted for controlling the quality characteristics relevant to each item of equipment/component as per formats enclosed as Annexure-I and Annexure-II respectively.			
22.00.00	GENERAL REQUIREMENTS - QUALITY ASSURANCE			
22.01.00	All materials, components and equipment covered under this specification shall be procured, manufactured, erected, commissioned and tested at all the stages, as per a comprehensive Quality Assurance Programme. An indicative programme of			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 27 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	inspection/tests to be carried out by the contractor for some of the major items is given in the respective technical specification. This is, however, not intended to form a comprehensive programme as it is the contractor's responsibility to draw up and implement such programme duly approved by the Employer. The detailed Quality Plans for manufacturing and field activities shall be drawn up by the Bidder and will be submitted to Employer for approval. Schedule of finalisation of such quality plans will be finalised before award on enclosed format No. QS-01-QAI-P-1/F3-R0. Monthly progress reports shall be furnished.		
22.02.00	Manufacturing Quality Plan will detail out for all the components and equipment, various tests/inspection, to be carried out as per the requirements of this specification and standards mentioned therein and quality practices and procedures followed by Contractor's/ Sub-contractor's/ sub-supplier's Quality Control Organisation, the relevant reference documents and standards, acceptance norms, inspection documents raised etc., during all stages of materials procurement, manufacture, assembly and final testing/performance testing. The Quality Plan shall be submitted on electronic media through C-folders, a web based system of NTPC ERP in addition to hard copy, for review and approval. After approval the same shall be submitted in compiled form on CD-ROM (As per format at Annexure-I)		
22.03.00	Field Quality Plans will detail out for all the equipment, the quality practices and procedures etc. to be followed by the Contractor's "Site Quality Control Organisation", during various stages of site activities starting from receipt of materials/equipment at site (As per format at Annexure – II).		
22.04.00	The Bidder shall also furnish copies of the reference documents/plant standards/acceptance norms/tests and inspection procedure etc., as referred in Quality Plans along with Quality Plans. These Quality Plans and reference documents/standards etc. will be subject to Employer's approval without which manufacturer shall not proceed. These approved documents shall form a part of the contract. In these approved Quality Plans, Employer shall identify customer hold points (CHP), i.e. test/checks which shall be carried out in presence of the Employer's Project Manager or his authorised representative and beyond which the work will not proceed without consent of Employer in writing. All deviations to this specification, approved quality plans and applicable standards must be documented and referred to Employer along with technical justification for approval and dispositioning.		
22.05.00	The contractor shall submit to the Employer Field Welding Schedule for field welding activities in the format enclosed at Annexure-V. The field welding schedule shall be submitted to the Employer along with all supporting documents, like welding procedures, heat treatment procedures, NDT procedures etc. at least ninety days before schedule start of erection work at site.		
22.06.00	The contractor shall have suitable Field Quality Organization with adequate manpower at Employer's site, to effectively implement the Field Quality Plan (FQP)		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
			PAGE 28 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	and Field Quality Management System for site activities. The contractor shall submit the details of proposed FQA setup (organizational structure and manpower) for employer's approval. The FQA setup shall be in place at least one month before the start of site activities.			
22.07.00	No material shall be despatched from the manufacturer's works before the same is accepted by Employer's Project Manager/Authorised representative and duly authorised for despatch by issuance of Material Despatch Clearance Certificate(MDCC / CHP Clearance.			
22.08.00	All material used for equipment manufacture including casting and forging etc. shall be of tested quality as per relevant codes/standards. Details of results of the tests conducted to determine the mechanical properties; chemical analysis and details of heat treatment procedure recommended and actually followed shall be recorded on certificates and time temperature chart. Tests shall be carried out as per applicable material standards and/or agreed details			
22.09.00	All welding and brazing shall be carried out as per procedure drawn and qualified in accordance with requirements of ASME Section IX/BS-4870 or other International equivalent standard acceptable to the Employer. All welding/brazing procedures shall be submitted to the Employer or its authorized representative prior to carrying out the welding/brazing.			
22.10.00	All brazers, welders and welding operators employed on any part of the contract either in Contractor's/his sub-contractor's works or at site or elsewhere shall be qualified as per ASME Section-IX or BS-4871 or other equivalent International Standards acceptable to the Employer.			
22.11.00	Welder qualification test results shall be furnished to the Employer for approval. However, where required by the Employer, tests shall be conducted in presence of Employer/authorized representative.			
22.12.00	For all IBR pressure parts and high pressure piping welding, the latest applicable requirements of the IBR (Indian Boiler Regulations) shall also be essentially complied with. However, other piping system ASME B31.1 or other relevant code as applicable shall be followed. Similarly, any other statutory requirements for the equipment/systems shall also be complied with. On all back-gauged welds MPI/LPI shall be carried before seal welding			
22.13.00	All the heat treatment results shall be recorded on time temperature charts and verified with recommended regimes.			
22.14.00	No welding shall be carried out on cast iron components for repair.			
22.15.00	Unless otherwise proven and specifically agreed with the Employer, welding of dissimilar materials and high alloy materials shall be carried out at shop only.			
22.16.00	All non-destructive examination shall be performed in accordance with written			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 29 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	procedures as per International Standards. The NDT operator shall be qualified as per SNT-TC-1A (of the American Society of non-destructive examination) or equivalent. NDT shall be recorded in a report, which includes details of methods and equipment used, result/evaluation, job data and identification of personnel employed and details of co-relation of the test report with the job. In general all plates of thickness greater than 40mm & for pressure parts plates of thickness equal to or greater than 25mm shall be ultrasonically tested otherwise as specified in respective equipment specification. All bar stock/Forging of diameter equal to or greater than 40 mm shall be ultrasonically tested. 22.17.00 The Contractor shall list out all major items/ equipment/ components to be manufactured in house as well as procured from sub-contractors (BOI). All the sub-contractor proposed by the Contractor for procurement of major bought out items including castings, forging, semi-finished and finished components/equipment etc., list of which shall be drawn up by the Contractor and finalised with the Employer, shall be subject to Employer's approval on enclosed format No. QS-01-QAI-P-01/F3. The contractor's proposal shall include vendor's facilities established at the respective works, the process capability, process stabilization, QC systems followed, experience list, etc. along with his own technical evaluation for identified sub-contractors enclosed and shall be submitted to the Employer for approval within the period agreed at the time of pre-awards discussion and identified in "DR" category prior to any procurement. Monthly progress reports on sub-contractor detail submission / approval shall be furnished preferably on enclosed format at Annexure-IV. Such vendor approval shall not relieve the contractor from any obligation, duty or responsibility under the contract. 22.17.00.a An indicative list of sub-vendors accepted by NTPC in the past for Corporate Awarded similar packages is enclosed for reference purpose as Indicative Sub-vendors List. The bidders' specific attention is drawn to the 'Disclaimer for the Indicative Vendor List' placed at the start of the Indicative Sub-vendor List. This is attached separately with the QA specification. 22.18.00 For components/equipment procured by the contractors for the purpose of the contract, after obtaining the written approval of the Employer, the contractor's purchase specifications and inquiries shall call for quality plans to be submitted by the suppliers. The quality plans called for from the sub-contractor shall set out, during the various stages of manufacture and installation, the quality practices and procedures followed by the vendor's quality control organisation, the relevant reference documents/standards used, acceptance level, inspection of documentation raised, etc. Such quality plans of the successful vendors shall be finalised with the Employer and such approved Quality Plans shall form a part of the purchase order/contract between the Contractor and sub-contractor. With in three weeks of the release of the purchase orders /contracts for such bought out items /components, a copy of the			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 30 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनडीपीसी NTPC	
	same without price details but together with the detailed purchase specifications, quality plans and delivery conditions shall be furnished to the Employer on the monthly basis by the Contractor along with a report of the Purchase Order placed so far for the contract.		
22.19.00	Employer reserves the right to carry out quality audit and quality surveillance of the systems and procedures of the Contractor's or their sub-contractor's quality management and control activities. The contractor shall provide all necessary assistance to enable the Employer carry out such audit and surveillance.		
22.20.00	The contractor shall carry out an inspection and testing programme during manufacture in his work and that of his sub-contractor's and at site to ensure the mechanical accuracy of components, compliance with drawings, conformance to functional and performance requirements, identity and acceptability of all materials parts and equipment. Contractor shall carry out all tests/inspection required to establish that the items/equipment conform to requirements of the specification and the relevant codes/standards specified in the specification, in addition to carrying out tests as per the approved quality plan.		
22.21.00	Quality audit/surveillance/approval of the results of the tests and inspection will not, however, prejudice the right of the Employer to reject the equipment if it does not comply with the specification when erected or does not give complete satisfaction in service and the above shall in no way limit the liabilities and responsibilities of the Contractor in ensuring complete conformance of the materials/equipment supplied to relevant specification, standard, data sheets, drawings, etc.		
22.22.00	For all spares and replacement items, the quality requirements as agreed for the main equipment supply shall be applicable.		
22.23.00	Repair/rectification procedures to be adopted to make the job acceptable shall be subject to the approval of the Employer/ authorised representative.		
22.24.00	Environmental Stress Screening Environmental stress screening test process / procedure for eliminating infant mortile components for DDCMIS / PLC based system & for other systems having substantial electronics components (as determined by employer) like Electronic transmitter, CCTV components, PA systems etc. shall be furnished for owner acceptance		
22.25.00	The Contractor / Sub-contractor shall carry out routine test on 100% item at contractor / sub-contractor's works. The quantum of check / test for routine & acceptance test by employer shall be generally as per criteria / sampling plan defined in referred standards. Wherever standards have not been mentioned quantum of check / test for routine / acceptance test shall be as agreed during detailed engineering stage.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 31 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.26.00	Software Reliability / Quality Certification Certification from OEM's authorized signatory that software offered with DDCMIS, PLC, CCTV, PA, Pyrometer, CEMS, AAQMS, EQMS, BHMS etc. declaring that the all the offered software(s) had gone through the established software quality test and offered software is not of β-version and offered software is also free from all known bugs as on date of approval of systems documents by NTPC as a part of quality documentation review and approval process during detail engineering.			
23.00.00	QUALITY ASSURANCE DOCUMENTS			
23.01.00	The Contractor shall be required to submit the QA Documentation in two hard copies and two CD ROMs, as identified in respective quality plan with tick (✓)mark.			
23.01.01	Each QA Documentation shall have a project specific Cover Sheet bearing name & identification number of equipment and including an index of its contents with page control on each document. The QA Documentation file shall be progressively completed by the Supplier's sub-supplier to allow regular reviews by all parties during the manufacturing. The final quality document will be compiled and issued at the final assembly place of equipment before despatch. However CD-Rom may be issued not later than three weeks.			
23.02.00	Typical contents of QA Documentation is as below:- (a.) Quality Plan (b.) Material mill test reports on components as specified by the specification and approved Quality Plans. (c.) Manufacturer / works test reports/results for testing required as per applicable codes and standard referred in the specification and approved Quality Plans. (d.) Non-destructive examination results /reports including radiography interpretation reports. Sketches/drawings used for indicating the method of traceability of the radiographs to the location on the equipment. (e.) Heat Treatment Certificate/Record (Time- temperature Chart) (f.) All the accepted Non-conformance Reports (Major/Minor)/deviation, including complete technical details / repair procedure). (g.) CHP / Inspection reports duly signed by the Inspector of the Employer and Contractor for the agreed Customer Hold Points.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 32 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	(h.) Certificate of Conformance (COC) wherever applicable. (i.) MDCC	
23.03.00	Similarly, the contractor shall be required to submit two sets (two hard copies and two CD ROMs), containing QA Documentation pertaining to field activities as per Approved Field Quality Plans and other agreed manuals/ procedures, prior to commissioning of individual system.	
23.04.00	Before despatch / commissioning of any equipment, the Supplier shall make sure that the corresponding quality document or in the case of protracted phased deliveries, the applicable section of the quality document file is completed. The supplier will then notify the Inspector regarding the readiness of the quality document (or applicable section) for review.	
	(a.) If the result of the review carried out by the Inspector is satisfactory, the Inspector shall stamp the quality document (or applicable section) for release. (b.) If the quality document is unsatisfactory, the Supplier shall endeavor to correct the incompleteness, thus allowing to finalize the quality document (or applicable section) by time compatible with the requirements as per contract documents. When it is done, the quality document (or applicable section) is stamped by the Inspector. (c.) If a decision is made for despatch, whereas all outstanding actions cannot be readily cleared for the release of the quality document by that time, the supplier shall immediately, upon shipment of the equipment, send a copy of the quality document Review Status signed by the Supplier Representative to the Inspector and notify of the committed date for the completion of all outstanding actions & submission. The Inspector shall stamp the quality document for applicable section when it is effectively completed. The submission of QA documentation package shall not be later than 3 weeks after the despatch of equipment.	
23.05.00	TRANSMISSION OF QA DOCUMENTATION On release of QA Documentation by Inspector, one set of quality document shall be forwarded to Corporate Quality Assurance Department and other set to respective Project Site of Employer. For the particular case of phased deliveries, the complete quality document to the Employer shall be issued not later than 3 weeks after the date of the last delivery of equipment.	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		PART-C GENERAL TECHNICAL REQUIREMENTS
TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9		PAGE 33 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
24.00.00	PROJECT MANAGER'S SUPERVISION	
24.01.00	To eliminate delays and avoid disputes and litigation, it is agreed between the parties to the Contract that all matters and questions shall be referred to the Project Manager and without prejudice to the provisions of 'Arbitration' clause in Section GCC, the Contractor shall proceed to comply with the Project Manager's decision.	
24.02.00	The work shall be performed under the supervision of the Project Manager. The scope of the duties of the Project Manager pursuant to the Contract, will include but not be limited to the following: (a.) Interpretation of all the terms and conditions of these documents and specifications (b.) Review and interpretation of all the Contractor's drawing, engineering data, etc (c.) Witness or his authorised representative to witness tests and trials either at the manufacturer's works or at site, or at any place where work is performed under the contract (d.) Inspect, accept or reject any equipment, material and work under the contract (e.) Issue certificate of acceptance and/or progressive payment and final payment certificates (f.) Review and suggest modifications and improvement in completion schedules from time to time, and (g.) Supervise Quality Assurance Programme implementation at all stages of the works.	
25.00.00	INSPECTION, TESTING AND INSPECTION CERTIFICATES	
25.01.00	The word 'Inspector' shall mean the Project Manager and/or his authorised representative and/or an outside inspection agency acting on behalf of the Employer to inspect and examine the materials and workmanship of the works during its manufacture or erection.	
25.02.00	The Project Manager or his duly authorised representative and/or an outside inspection agency acting on behalf of the Employer shall have access at all reasonable times to inspect and examine the materials and workmanship of the works during its manufacture or erection and if part of the works is being manufactured or assembled on other premises or works, the Contractor shall obtain	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
PAGE 34 OF 83		

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	for the Project Manager and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works.		
25.03.00	The Contractor shall give the Project Manager/Inspector fifteen (15) days written notice of any material being ready for testing. Such tests shall be to the Contractor's account except for the expenses of the Inspector's. The Project Manager/Inspector, unless the witnessing of the tests is virtually waived and confirmed in writing, will attend such tests within fifteen (15) days of the date on which the equipment is noticed as being ready for test/inspection failing which the contractor may proceed with test which shall be deemed to have been made in the inspector's presence and he shall forthwith forward to the inspector duly certified copies of test reports in two (2) copies.		
25.04.00	The Project Manager or Inspector shall within fifteen (15) days from the date of inspection as defined herein give notice in writing to the Contractor, or any objection to any drawings and all or any equipment and workmanship which is in his opinion not in accordance with the contract. The Contractor shall give due consideration to such objections and shall either make modifications that may be necessary to meet the said objections or shall inform in writing to the Project Manager/Inspector giving reasons therein, that no modifications are necessary to comply with the contract.		
25.05.00	When the factory tests have been completed at the Contractor's or sub-contractor's works, the Project Manager /Inspector shall issue a certificate to this effect Ten (10) days after completion of tests but if the tests are not witnessed by the Project Manager /Inspectors, the certificate shall be issued within Ten (10) days of the receipt of the Contractor's test certificate by the Project Manager /Inspector. Failure on the part of Project Manager /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the works. The completion of these tests or the issue of the certificates shall not bind the Employer to accept the equipment should it, on further tests after erection be found not to comply with the contract.		
25.06.00	In all cases where the contract provides for tests whether at the premises or works of the Contractor or any sub-contractor, the Contractor, except where otherwise specified shall provide free of charge such items as labour, material, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Project Manager /Inspector or his authorised representatives to carry out effectively such tests on the equipment in accordance with the Contractor and shall give facilities to the Project Manager/Inspector or to his authorised representative to accomplish testing.		
25.07.00	The inspection by Project Manager / Inspector and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed Quality Assurance Programme forming a part of the contract.		
25.08.00	To facilitate advance planning of inspection in addition to giving inspection notice as specified at clause no 25.03.00 of this chapter, the Contractor shall furnish quarterly inspection programme indicating schedule dates of inspection at Customer Hold		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 35 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	Point and final inspection stages. Updated quarterly inspection plans will be made for each three consecutive months and shall be furnished before beginning of each calendar month.		
25.09.00	All inspection, measuring and test equipment used by contractor shall be calibrated periodically depending on its use and criticality of the test/measurement to be done. The Contractor shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by NTPC. Wherever asked specifically, the contractor shall re-calibrate the measuring/test equipment in the presence of Project Manager / Inspector.		
25.10.00	Associated document for Quality Assurance programme		
25.10.01	Manufacturing Quality Plan Format No. : QS-01-QAI-P-09/F1-R1 enclosed at Annexure-I.		
25.10.02	Field Quality Plan Format No.: QS-01-QAI-P-09/F2-R1 enclosed at Annexure-II.		
25.10.03	List of items requiring quality plan and sub supplier approval. Format No.: QS-01-QAI-P-01/F3-R0 (Annexure-III).		
25.10.04	Status of items requiring Quality Plan and sub supplier approval. Format enclosed at Annexure-IV.		
25.10.05	Field Welding Schedule Format enclosed at Annexure-V.		
25.11.00	Not Used		
25.12.00	DEMONSTRATION OF APPLICATION ENGINEERING		
25.12.01	Based on NTPC inputs, the Contractor shall prepare and submit typical implemented scheme in their system (Control system & HMI) on sample basis. The typical cases to be covered shall include but not be limited to the following. (i) Logics/Loops: a) Drive logics implementation for each type of binary drive along with its display in HMI. b) Sequence implementation along with its display in HMI. c) Single non-cascade controller implementation. d) Cascade loop implementation. e) Master slave implementation with different slave combination.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 36 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
25.12.02	f) Temperature & pressure compensation for flow signals & pressure compensation for level signals as applicable. (ii) HMI Functions: a) LVS Annunciation. b) Graphics. c) HSR d) Logs/Reports. e) Calculations (Basic & Performance Calculations). The above typical cases shall be finalized with the Employer through Technical Co-ordination meetings. After review and finalization of the typical cases, the implementation of each logic & control loop shall be carried out by the Contractor based on NTPC inputs. After implementation of these logics & loops, the Contractor shall test each logic /loop and record the observations in a format to be provided by the Employer and demonstrate to Employer at Employer premises during engineering finalization. Any modifications as a result of the demonstration shall be done and documented as part of the test report along with the final scheme. Similarly, HMI functions shall also be demonstrated by the Contractor at Employer premises & the results shall be documented as part of test report.		
	25.12.03		
	26.00.00		
26.01.00	PRE-COMMISSIONING AND COMMISSIONING FACILITIES (a) As soon as the facilities or part thereof has been completed operationally and structurally and before start-up, each item of the equipment and systems forming part of facilities shall be thoroughly cleaned and then inspected jointly by the Employer and the Contractor for correctness of and completeness of facility or part thereof and acceptability for initial pre-commissioning tests, commissioning and start-up at Site. The list of pre-commissioning tests to be performed shall be as mutually agreed and included in the Contractor's quality assurance programme as well as those included in Part-D, Section-VI and elsewhere in the Technical Specifications. (b) The Contractor's pre-commissioning/ commissioning/start-up engineers, specially identified as far as possible, shall be responsible for carrying out all the pre-commissioning tests at Site. On completion of inspection, checking		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 37 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	and after the pre-commissioning tests are satisfactorily over, the commissioning of the complete facilities shall be commenced during which period the complete facilities, equipments shall be operated integral with sub-systems and supporting equipment as a complete plant. (c) All piping system shall be flushed, steam blown, air blown as required and cleanliness demonstrated using acceptable industry standards. Procedures to accomplish this work shall be submitted for approval to the Employer six months prior to the respective implementations. The Employer will approve final verification of cleanliness. (d) The time consumed in the inspection and checking of the units shall be considered as a part of the erection and installation period. (e) The check outs during the pre - commissioning period should be programmed to follow the construction completion schedule. Each equipment/system, as it is completed in construction and turned over to Employer's commissioning (start-up) Engineer(s), should be checked out and cleaned. The checking and inspection of individual systems should then follow a prescribed commissioning documentation [SLs(standard check list)/TS(testing schedule)/CS(commissioning schedule)] approved by the employer. (f) The Contractor during initial operation and performance testing shall conduct vibration testing to determine the 'base line' of performance of all plant rotating equipment. These tests shall be conducted when the equipment is running at the base load, peak load as well as lowest sustained operating condition as far as practicable.			
26.01.00	Contractor shall furnish the commissioning organization chart for review & acceptance of employer at least twelve months prior to the schedule date of commissioning of 1st unit. The chart should contain: (1.) Biodata including experience of the Commissioning Engineers. (2.) Role and responsibilities of the Commissioning Organisation members. (3.) Expected duration of posting of the above Commissioning Engineers at site.			
26.02.00	Initial Operation (a) On completion of all pre-commissioning activities/ tests and as a part of commissioning the complete facilities shall be put on 'Initial Operation' during which period all necessary adjustments shall be made while operating over the full load range enabling the facilities to be made ready for the Guarantee Tests.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 38 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
26.03.00	(b) The 'Initial Operation' of the complete facility as an integral unit shall be conducted for 720 continuous hours. During the period of initial operation of 720 hours, the FGD System shall operate continuously at full load for a period not less than 72 hours. The Initial Operation shall be considered successful, provided that each item/ part of the facility can operate continuously at the specified operating characteristics, for the period of Initial Operation with all operating parameters within the specified limits and at or near the predicted performance of the equipment/ facility. The Contractor shall intimate the Employer about the commencement of initial operation and shall furnish adequate notice to the Employer in this respect. (c) Any operational interruption in the FGD System due to constraints attributable to the Employer shall be construed as Deemed to be in operation. (d) An Initial Operation report comprising of observations and recordings of various parameters to be measured in respect of the above Initial Operation shall be prepared by the Contractor. This report, besides recording the details of the various observations during initial operation shall also include the dates of start and finish of the Initial Operation and shall be signed by the representatives of both the parties. The report shall have sheets, recording all the details of interruptions occurred, adjustments made and any minor repairs done during the Initial Operation. Based on the observations, necessary modifications/repairs to the plant shall be carried out by the Contractor to the full satisfaction of the Employer to enable the latter to accord permission to carry out the Guarantee tests on the facilities. However, minor defects which do not endanger the safe operation of the equipment, shall not be considered as reasons for with- holding the aforesaid permission. Guarantee Tests a) The final test as to prove the Functional Guarantees shall be conducted at Site by the Contractor in presence of the Employer. The contractor's Commissioning, start-up Engineer shall make the unit ready to conduct such test before start of initial operation. Such test shall be conducted along with the Initial Operations. b) These tests shall be binding on both the parties of the Contract to determine compliance of the equipment with the functional guarantee.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 39 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	c) For performance/ demonstration tests instrumentations, of accuracy class shall be as per specified test codes. The numbers and location of the instruments shall be as per the specified test codes. In addition the values of parameters shall be logged from the information system provided under Employer's Distributed Digital Control Monitoring and Information system. Test will be conducted at specified load points. d) Any special equipment, tools and tackles required for the successful completion of the Guarantee Tests shall be provided by the Contractor, free of cost. e) The Guarantee tests and specific tests to be conducted on equipments have been brought out in detail elsewhere in the specifications.			
27.00.00	TAKING OVER Upon successful completion of Initial Operations and all the tests conducted to the Employer's satisfaction, the Employer shall issue to the Contractor a Taking over Certificate as a proof of the final acceptance of the equipment. Such certificate shall not unreasonably be with held nor will the Employer delay the issuance thereof, on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the equipment. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issuance of such certificate.			
28.00.00	TRAINING OF EMPLOYER'S PERSONNEL			
28.01.00	Training for Employers O&M Personnel The scope of service under training of Employer's engineers shall include a training module covering upto six (6) man months in the areas of Operation & Maintenance. Such training should enable the personnel to individually take the responsibility of operating and maintaining the FGD system in a manner acceptable to the Employer.			
28.02.00	Training for Employers Engineering Personnel The scope of services under training for Employer's engineering personnel shall also necessarily include three (3) man months. This shall cover all disciplines viz, Mechanical, Electrical, C&I, & QA etc. and shall include all the related areas like Design familiarization, training on product design features and product design softwares of major equipment and systems, engineering, manufacturing, erection, commissioning, training on operating features of equipment, quality assurance and			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 40 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	testing, plant visits and visits to manufacturer's works, exposure to various kinds of problems which may be encountered in fabrication, manufacturing, erection, welding etc. An indicative module of the training requirement of Employer's Engineering personnel is attached as Annexure-VII.			
28.03.00	Bidder shall furnish in his offer, details of training module(s) covering above requirements which shall be subject to Employer's approval. Consolidated training period included above (i.e. 6 man months and 3 man months respectively for O&M and Engineering) is indicative only. Employer reserves the right to re appropriate the training period between O&M and engineering depending upon the details of training module proposed by the Bidder.			
28.04.00	Exact details, extent of training and the training schedule shall be finalised based on the Bidder's proposal within two (2) months from placement of award.			
28.05.00	In all the above cases, wherever the training of Employer's personnel is arranged at the works of the manufacturer's it shall be noted that the lodging and boarding of the Employer's personnel shall be at the cost of Contractor. The Contractor shall make all necessary arrangements towards the same.			
28.06.00	Take off prices (product wise) should be indicated by the Bidder in the Bid Proposal Sheets. Employer reserves the right to include or exclude these item(s) during placement of Award. Note: For training purposes, one (1) man month implies 30 working days (excluding all intervening holidays) per person.			
29.00.00	SAFETY ASPECTS DURING CONSTRUCTION AND ERECTION In addition to the requirements given in Erection Conditions of Contract (ECC) the following shall also cover: i) Working platforms should be fenced and shall have means of access. ii) Ladders in accordance with Employer's safety rules for construction and erection shall be used. Rungs shall not be welded on columns. All the stairs shall be provided with handrails immediately after its erection.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 41 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
30.00.00	NOISE LEVEL The equivalent 'A' weighted sound pressure level measured at a height of 1.5 m above floor level in elevation and at a distance of one (1) metre horizontally from the nearest surface of any equipment/machine, furnished and installed under these specifications, expressed in decibels to a reference of 0.0002 microbar, shall not exceed 85 dBA . However for Ball Mills the noise levels as per following shall also be acceptable: a) Ball Mill < 90 Dba b) The layouts selected by the bidder shall be such that the noise levels of equipment covered under FGD Package do not exceed the standards specified by CPCB (i.e. 55 dBA in day time and 45 dBA in night time) in order to meet the ambient noise standards specified by CPCB for residential areas such as Township etc.			
31.00.00	PACKAGING AND TRANSPORTATION All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. While packing all the materials, the limitation from the point of view of the sizes of railway wagons available in India should be taken account of. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. The Contractor shall ascertain the availability of Railway wagon sizes from the Indian Railways or any other agency concerned in India well before effecting despatch of equipment. Before despatch it shall be ensured that complete processing and manufacturing of the components is carried out at shop, only restricted by transport limitation, in order to ensure that site works like grinding, welding, cutting & preassembly to bare minimum. The Employer's Inspector shall have right to insist for completion of works in shops before despatch of materials for transportation.			
32.00.00	ELECTRICAL EQUIPMENTS/ENCLOSURES			
32.01.00	All electrical equipments and devices, including insulation, heating and ventilation devices shall be designed for ambient temperature and a maximum relative humidity as specified elsewhere in the specifications.			
33.00.00	INSTRUMENTATION AND CONTROL All instrumentation and control systems/ equipment/ devices/ components, furnished under this contract shall be in accordance with the requirements stated herein, unless otherwise specified in the detailed specifications.			
33.01.00	All instrument scales and charts shall be calibrated and printed in metric units and shall have linear graduation. The ranges shall be selected to have the normal reading at 75% of full scale.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 42 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनडीपीसी NTPC	
	All scales and charts shall be calibrated and printed in Metric Units as follows: 1. Temperature - Degree centigrade (deg C) 2. Pressure - Kilograms per square centimetre (Kg/cm²). Pressure instrument shall have the unit suffixed with 'a' to indicate absolute pressure. If nothing is there, that will mean that the indicated pressure is gauge pressure. 3. Draught - Millimetres of water column (mm wc). 4. Vacuum - Millimeters of mercury gauge (mm Hg) or water column (mm Wcl). 5. Flow (Gas) - Tonnes/ hour 6. Flow (Steam) - Tonnes/ hour 7. Flow (Liquid) - Tonnes / hour 8. Flow base - 760 mm Hg. 0 deg.C 9. Density - Grams per cubic centimeter.		
33.02.00	All instruments and control devices provided on panels shall be of miniaturized design, suitable for modular flush mounting on panels with front draw out facility and flexible plan-in connection at rear.		
33.03.00	All electronic modules shall have gold plated connector fingers and further all input and output modules shall be short circuit proof. These shall also be tropicalised & components shall be of industrial grade or better.		
34.00.00	ELECTRICAL NOISE CONTROL The equipment furnished by the Contractor shall incorporate necessary techniques to eliminate measurement and control problems caused by electrical noise. Areas in Contractor's equipment which are vulnerable to electrical noise shall be hardened to eliminate possible problems. Any additional equipment, services required for effectively eliminating the noise problems shall be included in the proposal. The equipment shall be protected against ESD as per IEC-61000-2. Radio Frequency interference (RFI) and Electro Magnetic Interference (EMI) protection against hardware damage and control system mal-operations/errors shall be provided for all systems as per EN-50082-2 (1995).		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 43 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
35.00.00	SURGE PROTECTION FOR SOLID STATE EQUIPMENT All solid state systems /equipment shall be able to withstand the electrical noise and surge as encountered in actual service conditions and inherent in a power plant and shall meet the requirements of surge protection as defined in ANSI C37.90.1-1989 on its suitable equivalent class of IEC 254-4. Details of the features incorporated and relevant tests carried out. The test certificates. etc. shall be submitted by the Bidder.		
36.00.00	INSTRUMENT AIR SYSTEM The instrument air supply system as supplied by the Bidder for various pneumatic control & instrumentation devices like pneumatic actuators, power cylinders, E/P converters, piping / tubing etc. Each pneumatic instrument shall have an individual air shut - off valve. The pressure regulating valve shall be equipped with an internal filter, a 50 mm pressure gauge and a built-in filter housing blow down valve.		
37.00.00	TAPPING POINTS FOR MEASUREMENTS Tapping points shall include probes, wherever applicable, for analytical measurements and sampling. For direct temperature measurement of all working media, one stub with internal threading of approved pattern shall be provided along with suitable plug and washer. The Contractor will be intimated about thread standard to be adopted. The following shall be provided on equipment by the Bidder. The standard which is to be adopted, will be intimated to the Contractor. i) Temperature test pockets with stub and thermowell ii) Pressure test pockets		
38.00.00	SYSTEM DOCUMENTATION The Bidder shall provide drawings, system overview & description, hardware/ software details, technical literature, functional & hardware schemes, bill of material, parts list, interconnection diagrams, data sheets, erection/ installation/ commissioning procedures, instruction/ operating manuals, etc. for each of the C& I system / sub-systems/ equipment supplied under this package. The documentation shall include complete details of the C&I systems/ sub-systems/ equipment to enable review by Employer during detailed engineering stage and to provide information to plant personnel for operation & Maintenance (including quick diagnostics & trouble shooting) of these C&I systems/ sub-systems/ equipment at site. The minimum documentation requirements for C&I systems shall be as stipulated under C&I		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 44 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	"Techncial Data Sheets" Part of specifications. In addition to this, system documentation for control system shall include as a minimum to that specified elsewhere in the Technical Specification. The exact format, submission schedule and contents of various documents shall be as finalised during detailed engineering stage.			
38.01.00	Bill of material (instrument list) for all C&I equipment/ devices shall be furnished by the bidder in standard formats as approved by the Employer.			
39.00.00	MAINTENANCE MANUALS OF ELECTRONIC MODULES The Contractor shall have to furnish two (2) sets of all maintenance manual of each and every electronic card/module as employed on the various systems and equipment including peripherals etc., offered by him. The Contractor will also have to furnish the data regarding the expected failure rate of various modules and other system components. Further , the contractor shall furnish a set of operating manuals which should include block diagrams ,make, model/type ,details wiring and external connection drawings etc as required to do the testing and maintenance of the electronic modules.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 45 OF 83

ANNEXURE-I

MFGR.'s LOGO	MANUFACTURER'S NAME AND ADDRESS	MANUFACTURING QUALITY PLAN		PROJECT :
		ITEM :	QP NO.:	PACKAGE :
		SUB-SYSTEM:	REV.NO.:	CONTRACT NO. :
			DATE:	MAIN-SUPPLIER:
			PAGE: OF....	

SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					M	C / N				D*	M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	**	10.		11.

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** M: MANUFACTURER/SUB-SUPPLIER C: MAIN SUPPLIER, N: NTPC P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS 'W'	 FOR NTPC USE	DOC. NO.:		REV..... CAT.....	
MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER						
SIGNATURE				REVIEWED BY	APPROVED BY	APPROVAL SEAL	

FORMAT NO.: QS-01-QAI-P-09/F1-R1

1/1

ENGG. DIV./QA&I

LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 76 OF 83

ANNEXURE-II

SUPPLIER'S LOGO	SUPPLIER'S NAME AND ADDRESS	FIELD QUALITY PLAN		PROJECT :
		ITEM :	QP NO.:	PACKAGE :
		SUB-SYSTEM:	REV. NO.:	CONTRACT NO. :
			DATE:	MAIN-SUPPLIER:
			PAGE: OF....	

SL. NO	ACTIVITY AND OPERATION	CHARACTERISTICS / INSTRUMENTS	CLASS OF CHECK #	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		REMARKS
1.	2.	3.	4.	5.	6.	7.	8.	9.	D*	10.

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. LEGEND TO BE USED: CLASS # : A = CRITICAL, B=MAJOR, C=MINOR; 'A' SHALL BE WITNESSED BY NTPC FQA, 'B' SHALL BE WITNESSED BY NTPC ERECTION / CONSTRUCTION DEPTT. AND 'C' SHALL BE WITNESSED BY MAIN SUPPLIER (A & B CHECK SHALL BE NTPC CHP STAGE)	 FOR NTPC USE	DOC. NO.:		REV.....	
MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER						
SIGNATURE				REVIEWED BY	APPROVED BY	APPROVAL SEAL	

FORMAT NO.: QS-01-QAI-P-09/F2-R1

1/1

ENGG. DIV./QA&I

LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 77 OF 83

ANNEXURE-III

	Project :	Stage :	LIST OF ITEMS REQUIRING QUALITY PLAN AND SUB-SUPPLIER APPROVAL					DOC. NO.:		
	Package :							REV. NO.:		
	Supplier :							DATE :		
	Contractor No. :		SUB-SYSTEM :					PAGE : OF		
S. N.	Item	QP/ Insp. Cat.	QP No.	QP Sub. Schedule	QP approval schedule	Proposed sub-supplier	Place	Sub-suppliers approval status / category	Sub-supplier Details submission on schedule	Remarks

LEGENDS

SYSTEM SUPPLIER/SUB-SUPPLIER APPROVAL STATUS CATEGORY (SHALL BE FILLED BY NTPC)

A – For these items proposed vendor is acceptable to NTPC. To be indicated with letter “A” in the list alongwith the condition of approval, if any.

DR – For these items “Detailed required” for NTPC review. To be identified with letter “DR” in the list.

NOTED – For these items vendors are approved by Main Supplier and accepted by NTPC without specific vendor approval from NTPC. To be identified with “NOTED.”

QP/INSPN CATEGORY:

CAT-I : For these items the Quality Plans are approved by NTPC and the final acceptance will be on physical inspection witness by NTPC.

CAT-II : For these items the Quality Plans approved by NTPC. However no physical inspection shall be done by NTPC. The final acceptance by NTPC shall be on the basis review of documents as per approved QP.

CAT-III : For these items Main Supplier approves the Quality Plans. The final acceptance by NTPC shall be on the basis certificate of conformance by the main supplier.

UNITS/WORKS : Place of manufacturing Place of Main Supplier of multi units/works.

FORMAT NO.: QS-01-QAI-P-1/F3-R0

1/1

Engg. Div. / QA&I

LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 78 OF 83

ANNEXURE-IV

	Project :		Stage :		STATUS OF ITEM REQUIRING QP& SUB-SUPPLIER APPROVAL				DOC. NO.:			
	Package :								REV. NO.:			
	Contractor :								DATE :			
	Contractor No. :								PAGE : OF			
S. N.	Item / Service	QP/ Insp. Cat.	QP Sub. Schedule Approval schedule	Date of submission	Date of comm t Appl.	Status Code C/II/I	Proposed Sub-suppliers	Place of manufacturing works	Approval Status	Sub-supplier detail submission schedule	Remarks	
FORMAT						1/1	Engg. Div. / QA&I					

LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 79 OF 83

ANNEXURE-V

	Project :		Stage :		FIELD WELDING SCHEDULE (To be raised by the contractor)								DOC. NO.:			
	Contractor :												REV. NO.:			
	Contractor No. :				Welding Code:								DATE :			
	System :												PAGE : OF			
Sl. No.	DRG No. for Weld Location and Identification mark	Description of parts to welded	Matl. Spec.	Dimensions		Process of welding	Type of Weld	Electrode filler spec.	WPS. No.	Min. pre-heat	Heat treatment		NDT method/ Quantum	REF		Remarks
											Temp.	Holding time		Spec. No.	ACC Norm Ref.	
NOTES:																
SIGNATURE																
FORMAT						1/1						Engg. Div. / QA&I				

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)				एनटीपीसी NTPC																																																																						
	<table><tr><th>S.No</th><th>Description of Drgs/Docs</th><th>No of Prints</th><th>No of ROMs/DVDs/Portable Hard Disk</th><th>CD</th></tr><tr><td rowspan="8">1</td><td>Drawings, Data sheets, Design calculations, Purchase specifications and other documents</td><td></td><td></td><td></td></tr><tr><td>First submission and submission with major changes</td><td></td><td></td><td></td></tr><tr><td>▪ Layout (A0&A1 sizes)</td><td>4</td><td>-</td><td></td></tr><tr><td>▪ Other Drawings/Documents (A0&A1 sizes)</td><td>2</td><td>-</td><td></td></tr><tr><td>▪ P&ID (All sizes)</td><td>4</td><td>-</td><td></td></tr><tr><td>a) Final drawings/documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr><tr><td>b) "As Built" Drawing/Documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr><tr><td>c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.</td><td>2</td><td>2</td><td></td></tr><tr><td>2</td><td>Erection Manual (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr><tr><td rowspan="2">3</td><td>Operation & Maintenance manual</td><td rowspan="2">1 set</td><td rowspan="2">--</td><td rowspan="2"></td></tr><tr><td>i) First Submission</td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr><tr><td rowspan="2">4</td><td>Plant Hand Book</td><td rowspan="2">1</td><td rowspan="2">1</td><td rowspan="2"></td></tr><tr><td>i) First Submission</td></tr><tr><td rowspan="2">5</td><td>Commissioning and Performance Test Procedure manual</td><td rowspan="2">1 set</td><td rowspan="2">--</td><td rowspan="2"></td></tr><tr><td>i) First Submission</td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr></table>				S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD	1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents				First submission and submission with major changes				▪ Layout (A0&A1 sizes)	4	-		▪ Other Drawings/Documents (A0&A1 sizes)	2	-		▪ P&ID (All sizes)	4	-		a) Final drawings/documents (Directly to site)	6	2		b) "As Built" Drawing/Documents (Directly to site)	6	2		c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2		2	Erection Manual (Directly to site)	4 sets	2		3	Operation & Maintenance manual	1 set	--		i) First Submission		ii) Final Submission (Directly to site)	4 sets	2		4	Plant Hand Book	1	1		i) First Submission	5	Commissioning and Performance Test Procedure manual	1 set	--		i) First Submission		ii) Final Submission (Directly to site)	4 sets	2	
S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD																																																																							
1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents																																																																										
	First submission and submission with major changes																																																																										
	▪ Layout (A0&A1 sizes)	4	-																																																																								
	▪ Other Drawings/Documents (A0&A1 sizes)	2	-																																																																								
	▪ P&ID (All sizes)	4	-																																																																								
	a) Final drawings/documents (Directly to site)	6	2																																																																								
	b) "As Built" Drawing/Documents (Directly to site)	6	2																																																																								
	c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2																																																																								
2	Erection Manual (Directly to site)	4 sets	2																																																																								
3	Operation & Maintenance manual	1 set	--																																																																								
	i) First Submission																																																																										
	ii) Final Submission (Directly to site)	4 sets	2																																																																								
4	Plant Hand Book	1	1																																																																								
	i) First Submission																																																																										
5	Commissioning and Performance Test Procedure manual	1 set	--																																																																								
	i) First Submission																																																																										
	ii) Final Submission (Directly to site)	4 sets	2																																																																								
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9		PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI	PAGE 81 OF 83																																																																						

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)				एनटीपीसी NTPC
	S.No	Description of Drgs/Docs	No of Prints	No of CD ROMs/DVDs/Portable Hard Disk	
	6	Performance and Functional Guarantee Test Report i) First Submission	2 sets	—	
		ii) Approved Copies (Direct to Site)	4 sets	2	
	7	Project Completion Report (Directly to site)	6 sets	2	
	8	QA programme including Organisation for implementation and QA system manual(with revisions)	1	—	
	9	Vendor details in respect of proposed vendors including contractor's evaluation report.	2	—	
	10	Manufacturing QPs, Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc i) For review/comment	1	—	
		ii) Approved final copies of Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc (Direct to Site)	4	2	
	11	Welding Manual, Heat Treatment Manuals, Storage & preservation manuals i) For review/comment	1 set	—	
		ii) Approved copies (Direct to Site)	4 sets	2	
	12	QA Documentation Package for items / equipment manufactured and despatched to site	2 sets	2	
	13	QA Documentation Package for field activities on equipment/systems at site	2 sets	2	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9		PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI	
				PAGE 82 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	ANNEXURE-VII			
PRODUCT	AREAS OF TRAINING REQUIREMENT			
	PRODUCT DESIGN	Plant Visit	Visit to Manufacturer's Work	Operation & Maintenance of Plant
FGD	Layout & model of FGD area, cable & piping trestles etc. FGD • Mass balance, Design, selection and sizing calculations of FGD • Training on factors affecting sizing/ efficiency of FGD system, equipments & auxiliaries • Materials for FGD & selection • Basic concepts, Design and sizing calculations on slurry systems including piping, valves, etc.. • FGD electrical system • FGD control system Erection strategies, erection procedures Performance as per applicable code and demonstration tests.	Familiarization with various system and equipment Performance, data collection analysis and review O&M feed back Operation history of various equipments and system Failure analysis	Manufacturing process of Absorber and equipments Welding process Testing facilities Product development in process Future plan for technology induction R&D work in progress	Control philosophy operation, notices, logic & protection schemes, O&M manual familiarization O&M issues. Familiarization of special maintenance techniques Special tool and tackles familiarization
MANMONTH	2	0.5	0.5	6
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9		PART-C GENERAL TECHNICAL REQUIREMENTS ANNEXURE-VII
PAGE 83 OF 83				

ERECTION CONDITIONS OF CONTRACT

~~PART - D~~

CONTENTS

Clause No.	Description	Page No.
1.00.00	General	1
2.00.00	Regulation of Local Authorities and Statutes	1
3.00.00	Welding of Pressure Parts and High Pressure Piping	1
4.00.00	Heat Treatment	2
5.00.00	Weld Edge Preparation	3
6.00.00	Cleaning and Servicing	3
7.00.00	Field Welding Schedule	3
8.00.00	Site Run Miscellaneous Piping	4
9.00.00	Thermal Expansions	4
10.00.00	Piping Supports	4
11.00.00	Pressure Testing	5
12.00.00	Thermowells and Flow Nozzles	5
13.00.00	Insulation, Lagging and Cladding	5
14.00.00	Code Requirements	7
15.00.00	Electrical safety regulations	7
16.00.00	Removal of Material	8
17.00.00	Inspection, Testing and Inspection Certificates	8
18.00.00	Access to site and Works on Site	8
19.00.00	Contractor's Site Office Establishment	8
20.00.00	Co-operation with other contractors	9

Clause No.	Description	Page No.
21.00.00	Discipline of Workmen	9
22.00.00	Contractor's Field Operation	9
23.00.00	Photographs and Progress Report	10
24.00.00	Man-Power Report	10
25.00.00	Protection of Work	10
26.00.00	Employment of Labour	10
27.00.00	Facilities to be provided by the Employer	11
28.00.00	Facilities to be provided by the Contractor	12
29.00.00	Lines and Grades	13
30.00.00	Fire Protection	13
31.00.00	Security	13
32.00.00	Contractor's Area Limits	14
33.00.00	Contractor's Co-operation with the Employer	14
34.00.00	Pre-commissioning and Commissioning Activities	14
35.00.00	Materials Handling and Storage	16
36.00.00	Construction Management	18
37.00.00	Field Office Records	21
38.00.00	Contractor's Materials Brought on to Site	21
39.00.00	Protection of Property and Contractor's Liability	21
40.00.00	Painting	22
41.00.00	Insurance	22
42.00.00	Unfavourable Working Conditions	23
43.00.00	Protection of Monuments and Reference Points	23
44.00.00	Work & Safety Regulations	23
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-D BID DOC NO: CS-0011-109(4)-9



Clause No.	Description	Page No.
45.00.00	Foreign Personnel	33
46.00.00	Foundation Dressing & Grouting for Equipment/Equipment Bases	34
47.00.00	Shaft Alignments	35
48.00.00	Dowelling	35
49.00.00	Check Out of Control Systems	35
50.00.00	Commissioning Spares	36
51.00.00	Cabling	36
52.00.00	Equipment Delivery and Erection	37
53.00.00	Welding-Special Requirements	43
54.00.00	Deviations Dispositioning	44
55.00.00	Non-Destructive Testing (NDT)	44
56.00.00	Testing Equipment & Facilities	44
Annexure-I	Standard Check List	45
Annexure-II	Brief Write-up on the contents of testing schedule/commissioning schedule	52
Annexure-III	Safety Plan	53

LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-D BID DOC NO: CS-0011-109(4)-9

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
1.00.00	GENERAL		
1.01.00	The following provisions shall supplement the conditions already contained in the other parts of these specifications and documents and shall govern that portion of the work of this contract which is to be performed at site. The erection requirements and procedures not specified in these documents shall be in accordance with the recommendations of the equipment manufacturer, or as mutually agreed to between the Employer and the Contractor prior to commencement of erection work.		
1.02.00	The Contractor upon signing of the Contract shall, in addition to a Project Co-ordinator, nominate another responsible officer as his representative at Site suitably designated for the purpose of overall responsibility and co-ordination of the Works to be performed at Site. Such a person shall function from the Site office of the Contractor during the pendency of Contract.		
2.00.00	REGULATION OF LOCAL AUTHORITIES AND STATUTES		
2.01.00	In addition to the local laws and regulations, the Contractor shall also comply with the Minimum Wages Act and the Payment of Wages Act (both of the Government of India) and the rules made there under in respect of its labour and the labour of its sub-contractors currently employed on or connected with the contract.		
2.02.00	All registration and statutory inspection fees, if any, in respect of his work pursuant to this Contract shall be to the account of the Contractor. However, any registration, statutory inspection fees lawfully pay-able under the provisions of the Indian Boiler Regulations and any other statutory laws and its amendments from time to time during erection in respect of the plant equipment ultimately to be owned by the Employer, shall be to the account of the Employer. Should any such inspection or registration need to be re-arranged due to the fault of the Contractor or his Sub-Contractor, the additional fees for such inspection and/or registration shall be borne by the Contractor.		
3.00.00	WELDING OF PRESSURE PARTS AND HIGH PRESSURE PIPING		
	The welding of all pressure parts and high pressure piping shall be in accordance with the following requirements:		
3.01.00	Qualification of Weld Procedures Only qualified welding procedures as per ASME Section IX shall be used by contractor at site. Procedure qualification records along with WPS shall be submitted to NTPC for review. Welding procedure shall indicate all essential and non-essential parameters as per ASME Section IX. Makes of welding consumables shall be subject to employer's approval.		
3.02.00	Welder's Qualification Only welders who are qualified in accordance with the latest applicable requirements of the Indian Boiler Regulations, shall be permitted to perform any welding work on the pressure parts and its attachment welding. In addition to such statutory qualification requirements, the welders shall also undergo a satisfactory		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 1 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	pre-production qualification test to be conducted by the Contractor at site as per ASME Sec IX in presence of employer's representative(s), prior to performing work under these specifications. The services of an independent testing laboratory shall be retained by the Contractor to perform welder qualification tests for welders. All the welders carrying out welding at site shall carry an identification badge, which shall indicate the category and the grade of welding for which they have been tested and authorised to carry out welding.		
3.03.00	Records Welders performance shall be monitored regularly and record of their performance shall be maintained by contractor in a manner acceptable to the employer. Contractor shall maintain such records including record of procedure qualification & welder qualification and hand-over to the employer at the end of work.		
3.04.00	MARKING On completion of each welded joint, the welder shall mark his regularly assigned identification mark near the joint. The welder's identification numbers, inspection stamps or code symbol stamps and any other information shall not be directly stamped on any alloy steel piping. In alloy steel piping, all such information shall be stamped on separate marking plate which shall be tack welded on pipe near the weld.		
4.00.00	HEAT TREATMENT		
4.01.00	Pre-heating, post-heating and post-weld stress relief operations of all welds, shall be performed in accordance with the requirements of applicable code. Local post weld stress relieving heat treatments shall be adopted only in cases where it is normally impracticable to subject the entire assembly as such for stress relieving operations. Heating may be by means of electric induction coils or electric resistance coils. Oxy-acetylene flame heating or exothermic chemical heating methods will not be permitted. Complete recording of the temperatures through out the stress relieving cycle of the material and the weld subjected to heat treatment shall be made by means of a potentiometric recorder. Recorders other than those of potentiometric type shall not be used for such temperature recording during stress relieving operations. The contractor & employer's representative, at start and at the end of HT Cycle shall sign the time and temperature charts for heat-treatment.		
4.02.00	Not Used.		
4.03.00	After setting up the weld joint for heat treatment operation, the Employer's signature shall be obtained on the strips chart of the recorder prior to starting of heat treatment cycle. The right hand corner of the strip chart at the starting point of the heat treatment cycle shall contain details like the weld number, material, diameter and thickness, method of heating adopted, prescribed ranges of heat treatment temperatures, date of heat treatment, reference to item number of the Field welding Schedule (as specified at clause no 7.00.00- of this chapter) etc.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 2 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनडीपीसी NTPC
5.00.00	WELD EDGE PREPARATION Preparation at site of weld joint shall be in accordance with details acceptable to the Employer. Wherever possible, machining or automatic flame cutting shall be used for edge preparation. Hand flame cutting will be permitted only where edge preparation otherwise is impractical. All slag shall be removed from cuts and all the hand cuts shall be ground smooth to the satisfaction of the Employer. Flame cutting of alloy steel pipe shall be avoided. Wherever such cutting is done, a 200mm length at the cut face shall be removed by machining. Pneumatic hand tools such as edge preparation, tube cutting machine can be used.	
6.00.00	CLEANING AND SERVICING	
6.01.00	The inside of all tubes, pipes, valves and fittings shall be free from dirt, and loose scales before being erected. All the pipelines shall be thoroughly blown and/or flushed. Each steam and water tubes shall be blown with compressed air and shall be subjected to 'ball test' before erection to ensure that no obstructions exist. A system for recording of all such operations shall be developed and maintained in a manner to ensure that no obstructions are left inside the tubes and no tubes are left uncleaned and untested.	
6.02.00	All valves and valve actuators, and dampers and damper actuators, if any, shall be thoroughly cleaned and serviced prior to pre-commissioning tests and/or Initial Operations of the plant. A system for recording of such servicing operation shall be developed and maintained in a manner acceptable to the Employer and to ensure that no valves or dampers including their actuators are left unserviced.	
6.03.00	All interior surfaces of the turbine shall be thoroughly cleaned prior to boxing - up to remove all traces of oil preservations.	
7.00.00	FIELD WELDING SCHEDULE The Contractor shall submit to the Employer, a certified and complete field welding schedule for all the field welding activities to be carried out in respect of the pressure parts involved in the equipment furnished and erected by him, at least 90 days prior to the scheduled start of erection work at site. Such schedule will be strictly followed by the Contractor during the process of erection. The above field-welding schedule to be issued by the Contractor shall contain the following: (a.) Drawing No (s) (b.) Location of the weld (c.) Size of the weld (outside diameter and thickness) (d.) Type of joints (e.) Material specifications (f.) Size of fillet on backing ring, when the type of joint is with backing ring (g.) Electrode/ filler metal specifications	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 3 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	(h.) Number of welds per unit (i.) Quantity of filler metal per weld (j.) Indication of required Non-destructive Examination (NDE) for each weld (k.) Pre-heat temperatures for welding (l.) Process of welding (m.) Post-welding heat treatment temperature ranges, duration, under as specified at clause no 4.00.00 of this chapter entitled "Heat Treatment". (n.) Qualification details of weld procedures to be adopted as specified at clause no 3.01.00 of this chapter entitled 'Qualification of Weld Procedures'.			
8.00.00	SITE RUN MISCELLANEOUS PIPING Sketches or diagrams of the proposed routings of all piping, not already indicated and routed on the shop drawings which were reviewed by the Employer, shall be submitted to the Employer for review, Employer's acceptance of such site routings shall be obtained before the piping is erected. All these site run piping shall be installed in such a manner as to present an orderly and neat installation. They shall be located as to avoid obstruction of access and passages. Valves, instruments or any other special items shall be located convenient for operation by the operating personnel. Pipe runs shall be plumb or level except where pitch for drainage is required. Pipe runs that are not parallel to the building structure, walls or column rows shall be avoided so that deflection of pipes between hangers does not exceed 6 mm. No miscellaneous pipe shall be routed and installed above or adjacent to electrical equipment.			
9.00.00	THERMAL EXPANSIONS All piping installation shall be such that no excessive or destructive expansion forces exist either in the cold condition or under condition of maximum temperature. All bends, expansion joints and any other special fittings, necessary to provide proper expansion, shall be incorporated. During installation of expansion joints and anchors, care must be taken to make sure that full design movement is available at all times for maximum to minimum temperature and vice-versa.			
10.00.00	PIPING SUPPORTS			
10.01.00	Hangers, supports and anchors shall be installed as required to obtain a safe, reliable and complete pipe installation. All supports shall be properly levelled and anchored when installed. The anchors shall be so placed that thermal expansion will be absorbed by bends without subjecting the valves or equipment to excessive strains.			
10.02.00	The hanger assemblies shall not be used for the attachment of rigging to hoist the pipe into place. Other means shall be used to securely hold the pipe in place till the pipe support is completely assembled and attached to the pipe and building			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 4 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	structures and spring support is set to accommodate the pipe way. All temporary rigging shall be removed in such a way that the pipe support is not subjected to any sudden load. All piping, having variable spring type supports, shall be held securely in place by temporary means during the hydraulic test of pipe system. Constant support type spring hangers used during hydraulic test shall be pinned or blocked solid during the test. After complete installation and insulation of the piping and filling of the piping with its normal operating medium, the pipe support springs shall be adjusted to the cold positions. If necessary, the spring support shall be re-adjusted to the hot positions after the line has been placed for service at its normal maximum operating temperature conditions. Electric arc welding only shall be used to weld all pipe supports to structural steel members that form part of the building supporting structure. The structural beams shall not be heated more than necessary during welding of supports and such welds shall run parallel to the axis of the span. All lugs or any other attachments welded to the piping shall be of the same material as the pipe.			
11.00.00	PRESSURE TESTING			
11.01.00	On completion of erection of pressure parts, a hydraulic test in accordance with the requirements of the Indian Boiler Regulations shall be performed by the Contractor.			
11.02.00	All the valves, high pressure pipes and inter-connected pipes connecting the pressure parts shall be tested along with pressure parts. All blank flanges or any removable plugs required for openings not closed by the valves, and piping provided, shall be furnished by the Contractor. The pressurization equipment including water piping from the supply, needed for the above test shall also be furnished by the Contractor. Any defects noticed during the testing are to be rectified and the unit re-tested. If any welding is done on the pressure parts after the Hydraulic test, the Hydraulic test for that portion of pressure parts shall be repeated. Water as required for such pressure testing shall be provided by the employer.			
11.03.00	Thy hydraulic test shall be considered successful only on certification to that effect by the concerned inspecting Authority as per the provisions of the Indian Boiler Regulations and the Employer.			
12.00.00	THERMOWELLS AND FLOW NOZZLES			
12.01.00	All the thermowells and flow nozzles in the equipment furnished under the technical specifications shall be installed as a part of this work.			
12.02.00	All thermowell connections incorporated in the steam service shall be plugged during the pressure testing and the blow out of steam piping systems. Upon completion of the blow out operation, all thermowells shall be installed and seam welded. Similarly, all flow nozzles in the steam lines shall also be installed only on completion of steam blowing operations unless otherwise agreed to by the Employer, depending upon the sequence of cleaning and purging operations to be adopted by the Contractor at the field.			
13.00.00	INSULATION, LAGGING AND CLADDING The provision of insulation, lagging and cladding of the various equipments and portion of the equipment covered under the Contract, shall be furnished by the			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 5 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
13.01.00	Contractor as specified elsewhere or agree to separately in writing. Welds required for holding insulation on pressure parts shall be carried out by IBR qualified welder. Piping, Pipe Fittings & Valves All piping insulation and metal cladding furnished with the equipment to be erected shall be applied as specified herein.		
13.01.01	Piping The insulation on piping shall be applied using wire loops on 150mm centres. These wire loops shall be thoroughly embedded into the outer insulation surface and all cracks, voids and depressions shall be filled with insulating cement suitable for the piping temperature so as to form a smooth base for application of cladding. The wires used for piping insulation shall be of 16 SWG. The surface shall be smooth and uniform before applying the outer covering. All piping insulation ends shall be terminated at a sufficient distance from flanges to facilitate removal of bolts.		
13.01.02	Flanges Insulation on flanges shall be by means of blocks of insulating material securely bound to the flange by wire loops. Such blocks of insulation shall be long enough to overlap the adjacent pipe insulation by an amount equal to the thickness of adjacent pipe insulation. Smooth finish shall be obtained by the application of insulating cement. Alternatively, sectional pipe insulation of proper diameter may be used. Insulation on flanges shall not be done until the pipe and equipment have been in service during the initial operation and till all the flange bolts have been retightened.		
13.01.03	Bends and Elbows Insulation on bends and elbows shall be cut into sections sufficiently short to form a reasonable smooth external surface. After the application of insulation material in place, it shall be smoothly coated with insulating cement. Elbows may be insulated as above or alternatively by means of specially moulded insulation enclosures.		
13.01.04	Cladding Cladding shall be of aluminium sheet of thickness as per details given in detail Technical Specification or will be provided during detail engineering shall be machine rolled and formed to accurately fit insulation curvatures. Cladding shall be secured using self-tapping screws. Screws shall be adequate number and so located as to produce tight joints. The spacing of screws shall be as far as possible uniform and on centres not exceeding 150 mm. For outside diameters less than 230 mm, spacing of screws shall be on centres not exceeding 100 mm. adequate number of screws shall be provided for fixing the cladding and be so placed in such locations, as to produce a smooth cladding finish without bellying'. Insulated elbows having insulated diameters less than 330 mm shall be provided with preformed smooth aluminium elbow jackets. Wherever possible, all joints should be lapped a minimum of 50 mm with joints facing downwards and so placed that they are obscured from normal points of vision. All the joints in the cladding shall be made with suitable provisions for expansions. All butt joints such as those at piping tees		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 6 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	shall be made using rolled seams. In addition, to prevent galvanic corrosion, suitable action, as specified at clause no 13.02.00 of this chapter, shall be taken.			
13.01.05	Valves and Fittings All valves and fittings (above valve size of 2 inches) installed in the steam pipelines shall also be applied with insulation and furnished with suitably shaped boxes so as to facilitate easy dismantling of the fittings. The insulation thickness for valves, valve fittings etc., shall be same as that used on the line on which they are installed. All voids shall be properly filled up with insulating material and as per the directions of the Employer.			
13.02.00	Protection of Equipment during Insulation Applications All equipment and structures shall be suitably protected from damage while applying insulation after completion of insulation. All equipment and structures shall be thoroughly cleaned and remove insulating materials which might have fallen on them.			
14.00.00	CODE REQUIREMENTS The erection requirements and procedures to be followed during the installation of the equipment shall be in accordance with the relevant Indian Electricity Rules & Codes, Indian Boiler Regulations, ASME codes and accepted good practices, the Employer's Drawings and other applicable Indian recognised codes and laws and regulations of the Government of India.			
15.00.00	ELECTRICAL SAFETY REGULATIONS			
15.01.00	In no circumstances will the Contractor interfere with fuses and electrical equipment belonging to the other Contractor or Employer.			
15.02.00	Before the Contractor connects any electrical appliances to any plug or socket belonging to the other Contractor or Employer, he shall: (a) Satisfy the Employer that the appliance is in good working condition. (b) Inform the Employer of the maximum current rating, voltage and phase of the appliances. (c) Obtain permission of the Employer detailing the socket to which the appliances may be connected. The Employer will not grant permission to connect until he is satisfied that (d) The appliance is in good condition and is fitted with suitable plug. (e) The appliance is fitted with a suitable cable having two earth conductors, one of which shall be an earthed metal sheath surrounding the cores.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 7 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
15.03.00	No electric cable in use by the other Contractor/Employer will be disturbed without permission. No weight of any description will be imposed on any such cable and ladder or similar equipment will rest against or to be attached with it.			
15.04.00	No reapir work shall be carried out on any live equipment. The equipment must be declared safe by the Employer and a permit to work issued before any work is carried out.			
15.05.00	The Contractor shall employ the necessary number of qualified, full time electricians to maintain his temporary electrical installation.			
16.00.00	REMOVAL OF MATERIAL No material brought to the Site shall be removed from the Site by the Contractor and/or his Sub-Contractors without the prior written approval of the Employer.			
17.00.00	INSPECTION, TESTING AND INSPECTION CERTIFICATES The provisions of the clause entitled Inspection, Testing and Inspection Certificates given in Part - C of the Technical Specification, shall also be applicable to the erection portion of the Works. The Employer shall have the right to re-inspect any equipment though previously inspected and approved by him at the Contractor's works, before and after the same are erected at Site. If by the above inspection, the Employer rejects any equipment, the Contractor shall make good for such rejections either by replacement or modification/ repairs as may be necessary to the satisfaction of the Employer. Such replacements will also include the replacements or re-execution of such of those works of other Contractors and/or agencies, which might have got damaged or affected by the replacements or re-work done to the Contractor's work.			
18.00.00	ACCESS TO SITE AND WORKS ON SITE			
18.01.00	Suitable access to site and permission to work at the Site shall be accorded to the Contractor by the Employer in reasonable time.			
18.02.00	In the execution of the Works, no person other than the Contractor or his duly appointed representative, Sub-Contractor and workmen, shall be allowed to do work on the Site, except by the special permission, in writing by the Employer or his representative.			
19.00.00	CONTRACTOR'S SITE OFFICE ESTABLISHMENT The Contractor shall establish a Office at the Site and keep posted an authorised representative for the purpose of the Contract. Any written order or instruction of the Employer or his duly authorised representative, shall be communicated to the said authorised resident representative of the Contractor and the same shall be deemed to have been communicated to the Contractor at his legal address.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 8 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	
20.00.00	CO-OPERATION WITH OTHER CONTRACTORS	
20.01.00	Employer, who may be performing other works on behalf of the Employer and the workmen who may be employed by the Employer and doing work in the vicinity of the works under the Contract. The Contractor shall also arrange to perform his work as to minimise, to the maximum extent possible, interference with the work of other Contractors and their workmen. Any injury or damage that may be sustained by the employees of the other Contractors and the Employer, due to the Contractor's work shall promptly be made good at his own expense. The Employer shall determine the resolution of any difference or conflict that may arise between the Contractor and other Contractors or between the Contractor and the workmen of the Employer in regard to their work. If the work of the Contractor is delayed because of the any acts of omission of another Contractor, the Contractor shall have no claim against the Employer on that account other than an extension of time for completing his works. Employer shall have full access to visit the contractor's site at any time for inspection and surveillance checks.	
20.02.00	The Employer shall be notified promptly by the Contractor of any defects in the other Contractor's works that could affect the Contractor's Works. The Employer shall determine the corrective measures if any, required to rectify this situation after inspection of the works and such decisions by the Employer shall be binding on the Contractor.	
21.00.00	DISCIPLINE OF WORKMEN	
	The Contractor shall adhere to the disciplinary procedure set by the Employer in respect of his employees and workmen at Site. The Employer shall be at liberty to object to the presence of any representative or employee of the Contractor at the Site, if in the opinion of the Employer such employee has misconducted himself or is incompetent, negligent or otherwise undesirable then the Contractor shall remove such a person objected to and provide in his place a competent replacement.	
22.00.00	CONTRACTOR'S FIELD OPERATION	
22.01.00	The Contractor shall keep the Employer informed in advance regarding his field activity plans and schedules for carrying out each part of the works. Any review of such plan or schedule or method of work by the Employer shall not relieve the Contractor of any of his responsibilities towards the field activities. Such reviews shall also not be considered as an assumption of any risk or liability by the Employer or any of his representatives and no claim of the Contractor will be entertained because of the failure or inefficiency of any such plan or schedule or method of work reviewed. The Contractor shall be solely responsible for the safety, adequacy and efficiency of plant and equipment and his erection methods.	
22.02.00	The Contractor shall have the complete responsibility for the conditions of the Work-Site including the safety of all persons employed by him or his Sub-Contractor and all the properties under his custody during the performance of the work. This requirement shall apply continuously till the completion of the Contract and shall not be limited to normal working hours. The construction review by the Employer is not intended to include review of Contractor's safety measures in, on or near the Work-Site, and their adequacy or otherwise.	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9
PART-D ERECTION CONDITIONS OF CONTRACT		PAGE 9 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
23.00.00	PHOTOGRAPHS AND PROGRESS REPORT			
23.01.00	The Contractor shall furnish three (3) prints each to the Employer of progress photographs of the work done at Site. Photographs shall be taken as and when indicated by the Employer or his representative. Photographs shall be adequate in size and number to indicate various stages of erection. Each photograph shall contain the date, the name of the Contractor and the title of the photograph.			
23.02.00	The above photographs shall accompany the monthly progress report detailing out the progress achieved on all erection activities as compared to the schedules. The report shall also indicate the reasons for the variance between the scheduled and actual progress and the action proposed for corrective measures, wherever necessary.			
23.03.00	The Contractor shall submit the progress of work in soft and hard form (as decided by employer) quarterly highlighting the progress and constraints at site.			
24.00.00	MAN-POWER REPORT			
24.01.00	The Contractor shall submit to the Employer, on the first day of every month, a man hour schedule for the month, detailing the man hours scheduled for the month, skill-wise and area-wise.			
24.02.00	The Contractor shall also submit to the Employer on the first day of every month, a man power report of the previous month detailing the number of persons scheduled to have been employed and actually employed, skill- wise and the areas of employment of such labour.			
25.00.00	PROTECTION OF WORK			
	The Contractor shall have total responsibility for protecting his works till it is finally taken over by the Employer. No claim will be entertained by the Employer or the representative of the Employer for any damage or loss to the Contractor's works and the Contractor shall be responsible for complete restoration of the damaged works to original conditions to comply with the specification and drawings. Should any such damage to the Contractor's Works occur because of other party not being under his supervision or control, the Contractor shall make his claim directly with the party concerned. If disagreement or conflict or dispute develops between the Contractor and the other party or parties concerned regarding the responsibility for damage to the Contractor's Works the same shall be resolved as per the provisions of the as specified at clause no 21.00.00 of this chapter entitled "Co-operation with other Contractors." The Contractor shall not cause any delay in the repair of such damaged Works because of any delay in the resolution of such disputes. The Contractor shall proceed to repair the Work immediately and no cause thereof will be assigned pending resolution of such disputes.			
26.00.00	EMPLOYMENT OF LABOUR			
26.01.00	In addition to all local laws and regulations pertaining to the employment of labour to be complied with by the Contractor pursuant to GCC, the Contractor will be expected to employ on the work only his regular skilled employees with experience of the			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 10 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT
	 particular work. No female labour shall be employed after darkness. No person below the age of eighteen years shall be employed.
26.02.00	All travelling expenses including provisions of all necessary transport to and from Site, lodging allowances and other payments to the Contractor's employees shall be the sole responsibility of the Contractor.
26.03.00	The hours of work on the Site shall be decided by the Employer and the Contractor shall adhere to it. Working hours will normally be eight (8) hours per day - Monday through Saturday.
26.04.00	Contractor's employees shall wear identification badges while on work at Site.
26.05.00	In case the Employer becomes liable to pay any wages or dues to the labour or any Government agency under any of the provisions of the Minimum Wages Act, Workmen Compensation Act, Contract Labour Regulation Abolition Act or any other law due to act of omission of the Contractor, the Employer may make such payments and shall recover the same from the Contractor's Bills.
27.00.00	FACILITIES TO BE PROVIDED BY THE EMPLOYER
~~27.01.00~~	~~Electricity~~
	~~Refer clause 1.14.00 (Construction Power) Sub-Section III B, Part A, Section VI of Technical Specification.~~
~~27.02.00~~	~~Water~~
	~~Contractor shall make all arrangements himself for the supply of construction water as well as potable water for labour and other personnel at the worksite/colony. However, drawl of construction/potable water from bore-well shall be permitted if found suitable. Any statutory clearance required shall be obtained by the contractor. Assistance, if required shall be provided by the owner.~~
27.03.00	Communication The Employer will extend the telephone facilities, if available at Site, for purposes of Contract. The Contractor shall be charged at actuals for such facilities.
27.04.00	Railway Siding Railway siding shall be provided by owner (up to plant entry point) for coal transportation to site. However the same may not be available to the bidder for material/supplies transport etc. Bidder has to plan its own arrangement for movement of ODC consignment to plant site.
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9
PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 11 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	
28.00.00	FACILITIES TO BE PROVIDED BY THE CONTRACTOR	
28.01.00	Contractor's site office Establishment The Contractor shall establish a site office at the site and keep posted an authorized representative for the purpose of the contract, pursuant to GCC. The site office will include one conference meeting room for site meetings between the Contractor and the Employer.	
28.02.00	Tools, tackles and scaffoldings The Contractor shall provide all the construction equipments, tools, tackles and scaffoldings required for pre-assembly, installation, testing, commissioning and conducting Guarantee tests of the equipments covered under the Contract. He shall submit a list of all such materials to the Employer before the commencement of pre-assembly at Site. These tools and tackles shall not be removed from the Site without the written permission of the Employer. The Contractor shall arrange Dozer, Hydra, Cranes, Trailer, etc. for the purpose of fabrication, erection and commissioning.	
28.03.00	Testing Equipment and Facilities: The contractor shall provide the necessary testing, equipment and facilities.	
28.04.00	Site laboratory for civil works: Contractor shall provide and maintain a site laboratory for the testing of construction material under the direction and general supervision of employer.	
28.05.00	First-aid	
28.05.01	The Contractor shall provide necessary first-aid facilities for all his employees, representatives and workmen working at the Site. Enough number of Contractor's personnel shall be trained in administering first-aid.	
28.05.02	The Employer will provide the Contractor, in case of any emergency, the services of an ambulance for transportation to the nearest hospital.	
28.06.00	Cleanliness	
28.06.01	The Contractor shall be responsible for keeping the entire area allotted to him clean and free from rubbish, debris etc. during the period of Contract. The Contractor shall employ enough number of special personnel to thoroughly clean his work-area at least once in a day. All such rubbish and scrap material shall be stacked or disposed in a place to be identified by the Employer. Materials and stores shall be so arranged to permit easy cleaning of the area. In areas where equipment might drip oil and cause damage to the floor surface, a suitable protective cover of a flame resistant, oil proof sheet shall be provided to protect the floor from such damage.	
28.06.02	Similarly the offices shall be kept clean and neat to the entire satisfaction of the Employer. Proper sanitary arrangements shall be provided by the Contractor, in the work-areas and office areas of the Contractor.	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9
PART-D ERECTION CONDITIONS OF CONTRACT		PAGE 12 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
29.00.00	LINES AND GRADES All the Works shall be performed to the lines, grades and elevations indicated on the drawings. The Contractor shall be responsible to locate and layout the Works. Basic horizontal and vertical control points will be established and marked by the Employer at Site at suitable points. These points shall be used as datum for the works under the Contract. The Contractor shall inform the Employer well in advance of the times and places at which he wishes to do work in the area allotted to him so that suitable datum points may be established and checked by the Employer to enable the Contractor to proceed with his works. Any work done without being properly located may be removed and/or dismantled by the Employer at Contractor's expense.		
30.00.00	FIRE PROTECTION		
30.01.00	The work procedures that are to be used during the erection shall be those which minimise fire hazards to the extent practicable. Combustible materials, combustible waste and rubbish shall be collected and removed from the Site at least once each day. Fuels, oils and volatile or flammable materials shall be stored away from the construction and equipment and materials storage areas in safe containers. Untreated canvas, paper, plastic or other flammable flexible materials shall not at all be used at Site for any other purpose unless otherwise specified. If any such materials are received with the equipment at the Site, the same shall be removed and replaced with acceptable material before moving into the construction or storage area.		
30.02.00	Similarly corrugated paper fabricated cartons etc. will not be permitted in the construction area either for storage or for handling of materials. All such materials used shall be of water proof and flame resistant type. All the other materials such as working drawings, plans etc. which are combustible but are essential for the works to be executed shall be protected against combustion resulting from welding sparks, cutting flames and other similar fire sources.		
30.03.00	All the Contractor's supervisory personnel and sufficient number of workers shall be trained for fire-fighting and shall be assigned specific fire protection duties. Enough of such trained personnel must be available at the Site during the entire period of the Contract.		
30.04.00	The Contractor shall provide enough fire protection equipment of the types and number for the warehouses, office, temporary structures, labour colony area etc. Access to such fire protection equipment, shall be easy and kept open at all time.		
31.00.00	SECURITY The Contractor shall have total responsibility for all equipment and materials in his custody stores, loose, semi-assembled and/or erected by him at Site. The Contractor shall make suitable security arrangements including employment of security personnel to ensure the protection of all materials, equipment and works from theft, fire, pilferage and any other damages and loss. All materials of the Contractor shall enter and leave the Employer Site only with the written permission of the Employer in the prescribed manner.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 13 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
32.00.00	CONTRACTOR'S AREA LIMITS The Employer will mark-out the boundary limits of access roads, parking spaces, storage and construction areas for the Contractor and the Contractor shall not trespass the areas not so marked out for him. The Contractor shall be responsible to ensure that none of his personnel move out of the areas marked out for his operations. In case of such a need for the Contractor's personnel to work out of the areas marked out for him the same shall be done only with the written permission of the Employer.			
33.00.00	CONTRACTOR'S CO-OPERATION WITH THE EMPLOYER In case where the performance of the erection work by the Contractor affects the operation of the system facilities of the Employer, such erection work of the Contractor shall be scheduled to be performed only in the manner stipulated by the Employer and the same shall be acceptable at all times to the Contractor. The Employer may impose such restrictions on the facilities provided to the Contractor such as electricity, etc. as he may think fit in the interest of the Employer and the Contractor shall strictly adhere to such restrictions and co-operate with the Employer. It will be the responsibility of the Contractor to provide all necessary temporary instrumentation and other measuring devices required during start-up and operation of the equipment systems which are erected by him. The Contractor shall also be responsible for flushing and initial filling of all the oil and lubricants required for the equipment furnished and installed by him, so as to make such equipment ready for operation. The Contractor shall be responsible for supplying such flushing oil and other lubricants unless otherwise specified elsewhere in documents and specifications.			
34.00.00	PRE-COMMISSIONING AND COMMISSIONING ACTIVITIES			
34.01.00	GENERAL			
34.01.01	The Contractor upon completion of installation of equipments and systems, shall conduct pre-commissioning and commissioning activities, to make the equipment/systems ready for safe, reliable and efficient operation on sustained basis. All pre-commissioning/commissioning activities considered essential for such readiness of the equipment/systems including those mutually agreed and included in the Contractor's quality assurance programme as well as those indicated in clauses elsewhere in the technical specifications shall be performed by the contractor.			
34.01.02	The pre-commissioning and commissioning activities including Guarantee/ demonstration/ acceptability tests, checks and trial operations of the equipment/systems furnished and installed by the contractor shall be the responsibility of the Contractor as detailed in relevant clauses in Technical Specification. The Contractor shall provide, in addition, test instruments, calibrating devices etc. and labour required for successful performance of these operations. If it is anticipated that the above test may prolong for a long time, the Contractor's workmen required for the above test shall always be present at site during such operations.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 14 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनटीपीसी NTPC		
34.01.03	The following activities shall be carried out by the contractor, 18 month prior to schedule date of commissioning of the equipment/systems installed by him. (a.) The contractor shall furnish the organization chart of his operation and commissioning engineers for the acceptance of employer. Adequate number of operation and commissioning engineers shall be deployed by the contractor to effectively meet the requirement of round the clock operation in shifts also, till the plant is taken over by the employer. (b.) The contractor shall submit the bio-data containing the details of experience of his operation and commissioning engineers for the acceptance of employer. (c.) The contractor shall furnish the deployment schedule of his operation and commissioning engineers for the acceptance of the employer. (d.) Apart from above, contractor shall ensure deployment of sufficient skilled/semi-skilled/unskilled manpower during pre-commissioning and commissioning activities.			
34.01.04	It shall be the responsibility of the Contractor to provide all necessary temporary instrumentation and other measuring devices required during start-up and initial operation of the equipment/systems which are installed by him.			
34.01.05	The Contractor shall also be responsible for flushing and initial filling of all oils and lubricants required for the equipment furnished and installed by him so as to make such equipment ready for operation. The Contractor shall be responsible for supplying such flushing oil and other lubricants unless otherwise specified elsewhere in these specifications and documents.			
34.02.00	COMMISSIONING DOCUMENTATION			
34.02.01	The contractor shall submit the commissioning documentation, comprising of Standard checklists, pre-commissioning procedures, testing schedules, commissioning schedules and commissioning networks for various equipment/systems covered under the contract, for the approval of employer.			
34.02.02	Standard checklist, as the name suggests, shall be a fairly general documents, containing the list of all checks required to be carried out for similar and repetitive type of equipment to ensure consistent and thorough checking. An indicative list of such equipment is enclosed as Annexure I.			
34.02.03	The testing schedule is a document, designed for safe and systematic commissioning of individual equipment/sub-system (for example compressor etc.) Commissioning schedule is a document envisaged for commissioning of a system (for example Compressed Air system, Unit commissioning etc.). The testing/Commissioning schedule shall have a standard format in order to maintain consistency of presentation, content and reporting. A brief write up on the contents of the Testing Schedule/Commissioning Schedule is enclosed as Annexure-II.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 15 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
34.02.04	The contractor shall submit the list of commissioning documentation to be submitted by him, along with their submission schedule for various equipment/systems covered under the contract, with in 6(six) month from the date of award of contract, for the acceptance of employer.		
34.02.05	The Contractor shall submit the commissioning documentation, for various equipment/covered under the contract, for the approval of employer, at least 18 months before the scheduled date of commissioning of the equipment/systems.		
34.03.00	COMMISSIONING ACTIVITIES		
34.03.01	Upon completion of pre-commissioning activities/tests, the contractor shall initiate commissioning of facilities. During commissioning the Contractor shall carry out system checking and reliability trials on various parts of the facilities.		
34.03.02	Contractor shall carry out the checks/tests at site to prove to the Employer that each equipment of the supply complies with requirements stipulated and is installed in accordance with requirements specified.		
34.03.03	Before the plant is put into initial operation the Contractor shall be required to conduct test to demonstrate to the Employer that each item of the plant is capable of correctly performing the functions for which it was specified and its performance, parameters etc. are as per the specified/approved values. These tests may be conducted concurrently with those required under commissioning sequence.		
34.03.04	The Contractor shall also demonstrate the performance of all C&I equipment, the tests on main equipment of prior to that as the case may be.		
34.03.05	Other tests shall be conducted, if required by the Employer, to establish that the plant equipment are in accordance with requirements of the specifications.		
34.03.06	The Contractor shall conduct all the commissioning tests and undertake commissioning activities pertaining to all other auxiliaries and equipments including all electrical and C&I equipment/systems not specifically brought out above but are within the scope of work and facilities being supplied and installed by the Contractor and follow the guidelines indicated above or elsewhere in these technical specifications.		
34.05.00	Initial Operation Upon completion of system checking/Tests as above and as a part of commissioning of facilities, complete plant/facilities shall be put on initial operation as stipulated in General Technical Requirements.		
35.00.00	MATERIALS HANDLING AND STORAGE		
35.01.00	All the equipments furnished under the Contract and arriving at Site shall be promptly received, unloaded and transported and stored in the storage spaces by the Contractor.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 16 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
35.02.00	Contractor shall be responsible for examining all the shipment and notify the Employer immediately of any damage, shortage, discrepancy etc. for the purpose of Employer's information only. The Contractor shall submit to the Employer every week a report detailing all the receipts during the week. However, the Contractor shall be solely responsible for any shortages or damage in transit, handling and / or in storage and erection of the equipment at Site. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Contractor.			
35.03.00	The Contractor shall maintain an accurate and exhaustive record detailing out the list of all equipment received by him for the purpose of erection and keep such record open for the inspection of the Employer.			
35.04.00	All equipment shall be handled very carefully to prevent any damage or loss. No bare wire ropes, slings, etc. shall be used for unloading and/or handling of the equipment without the specific written permission of the Employer. The equipment stored shall be properly protected to prevent damage either to the equipment or to the floor where they are stored. The equipment from the store shall be moved to the actual location at the appropriate time so as to avoid damage of such equipment at Site.			
35.05.00	All electrical panels, controls gear, motors and such other devices shall be properly dried by heating before they are installed and energised. Motor bearings, slip rings, commutators and other exposed parts shall be protected against moisture ingress and corrosion during storage and periodically inspected. Heavy rotating parts in assembled conditions shall be periodically rotated to prevent corrosion due to prolonged storage.			
35.06.00	All the electrical equipment such as motors, etc. shall be tested for insulation resistance at least once in three months from the date of receipt till the date of commissioning and a record of such measured insulation values maintained by the Contractor. Such records shall be open for inspection by the Employer.			
35.07.00	The Contractor shall ensure that all the packing materials and protection devices used for the various equipments during transit and storage are removed before the equipment are installed.			
35.08.00	The consumables and other supplies likely to deteriorate due to storage must be thoroughly protected and stored in a suitable manner to prevent damage or deterioration in quality by storage.			
35.09.00	All the materials stored in the open or dusty location must be covered with suitable weatherproof and flame-proof covering material wherever applicable.			
35.10.00	If the materials belonging to the Contractor are stored in areas other than those earmarked for him, the Employer will have the right to get it moved to the area earmarked for the Contractor at the Contractor's cost.			
35.11.00	The Contractor shall be responsible for making suitable indoor storage facilities to store all equipment which require indoor storage. Normally, all the electrical equipments such as motors, control gear, generators, exciters and consumables like			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 17 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	electrodes, lubricants etc. shall be stored in the closed storage space. The Employer, in addition, may direct the Contractor to move certain other materials, which in his opinion will require indoor storage, to indoor storage areas which the Contractor shall strictly comply with.		
36.00.00	CONSTRUCTION MANAGEMENT		
36.01.00	The field activities of the Contractors working at Site, will be coordinated by the Employer and the Employer decision shall be final in resolving any disputes or conflicts between the Contractor and other Contractors and tradesmen of the Employer regarding scheduling and co- ordination of work. Such decision by the Employer shall not be a cause for extra compensation or extension of time for the Contractor.		
36.02.00	The Employer shall hold weekly meetings of all the Contractors working at Site, at a time and place to be designated by the Employer. The Contractor shall attend such meetings and take notes of discussions during the meeting and the decisions of the Employer and shall strictly adhere to those decisions in performing his Works. In addition to the above weekly meeting, the Employer may call for other meeting either with individual Contractors or with selected number of Contractors and in such a case the Contractor if called, will also attend such meetings.		
36.03.00	Time is the essence of the Contract and the Contractor shall be responsible for performance of his works in accordance with the specified construction schedule. If at any time, the Contractor is falling behind the schedule, he shall take necessary action to make good for such delays by increasing his work force or by working overtime or otherwise accelerate the progress of the work to comply with the schedule and shall communicate such actions in writing to the Employer, satisfying that his action will compensate for the delay. The Contractor shall not be allowed any extra compensation for such action.		
36.04.00	The Employer shall however not be responsible for provision of additional labour and/or materials or supply or any other services to the Contractor except for the co- ordination work between various Contractors as set out earlier.		
36.05.00	Site management during construction phase till handing over of plant Bidder shall ensure that the plant site within the plant boundary is managed in a coordinated and professional way all through the construction phase till handing over of plant, ensuring safe, easy & unhindered working conditions and a healthy & hygienic working environment at site. He shall ensure the following measures at site while executing the project. a) Proper housekeeping by systematic and proper disposal of earth from excavations (separately for usable & surplus earth), muck (from pile bores or otherwise), wastes (from dismantling of pile tops, concrete works etc), packing & insulation wastes, steel scrap, cable wastes etc generated during construction / erection works. Suitable disposal sites for each of above shall be identified in the layout and at site in the beginning of the project itself. It shall be ensured that all agencies engaged by the bidder follow the discipline to dispose off of earth spoils and wastes at the		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 18 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	designated places. Preferably once in a week suitable time slot will be identified for housekeeping by all agencies and suitable instructions shall be issued in this regard. Bidder may engage a separate agency or identify a gang for collection of wastes and disposal to designated places. Suitable arrangement / tieup will also be made for periodic disposal of wastes/ scrap from the designated places. b) All fabrication areas shall be suitably hard crusted to provide a water free and proper working platforms. Suitable sheds preferably pre engineered structures to be provided for paint shops, fabrication workshops etc for ensuring all weather work conditions for onsite structural works. For the main plant and auxiliary buildings, bidder should preferably plan the works in such a way that structural fabrication is done in suppliers' offsite works / workshops and onsite fabrication works are avoided / kept minimum. c) Suitable onsite maintenance workshop for day to day breakdown maintenance heavy plant and equipment like batching plants, cranes, earth moving equipment, poclains, welding equipment etc. The workshop shall have stock of frequently needed spares and suitable repair facilities with experienced technicians/mechanics. A central test laboratory equipped with test equipment for routine tests like tests on soil, concrete, bricks, aggregates, welds etc with experienced staff shall be established at the start of the project itself. d) All office and covered store buildings of the bidder and its agencies shall be of prefab/ pre-engineered / porta cabin construction. Shabby semi finished constructions in brickwork/ GI / asbestos roof etc shall not be permitted. e) First aid facilities and amenities like rest rooms, suitable pre engineered toilets (separate for men and women), drinking water fountains/tanks, canteen, crèche for women workers shall be planned and established at the beginning of the project itself. These facilities shall be located distributed over the plant area to enable easy access by the construction workers and staff and shall be marked on the plant layout. Suitable treatment for toilet discharge, like bio digesters etc shall be planned and conventional septic tanks / soak pits etc shall be avoided. f) Proper lighting of all construction / erection areas. Bidder shall erect adequate number of high lighting masts in main plant, offsite, office and store areas for lighting during night. DG sets of adequate capacity shall be provided for emergency backup. The street lighting along the roads shall also be prioritised along with road construction. The construction power ring main shall be planned and erected immediately after the award. g) Well planned and coordinated storage and movement of plant, equipment and construction materials. System wise / agency wise storage / laydown areas shall be planned and marked on the plant layout at the beginning itself. Bidder shall ensure that all its agencies comply to the areas allocated to them and follow the designated storage and movement plans. Adequate covered storage shall be constructed for storage of critical equipments like switchgears, MCCs, insulation etc. h) Proper access control for construction workers, staff and visitors. Bidder shall ensure that suitable electronic based gate pass system is in place from start of project itself			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 19 OF 53	

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	to keep record and track of all workers, staff and visitors entering/exiting the plant premises shift wise on daily basis. i) Compliance to all safety requirements as specified elsewhere in the tender documents. Bidders shall establish a safety centre at the start of the project itself. It shall have a 24X7 manned safety control room in addition to a permanent safety equipment display room, separate training / lecture hall with AV facilities for safety training, store room with adequate stock of specified safety equipment, a first aid room and other amenities. Bidder shall install CCTV cameras at all strategic locations in the plant area which shall be linked to the safety control room. j) Compliance to all environment and other conditions stipulated by the concerned statutory authorities while according clearance / NOC to the project. Bidder shall ensure adequate sprinkling of water by deploying water tankers to prevent the fugitive dust nuisance during construction. k) Development of suitable landscape & green belt areas and rainwater harvesting within the plant premises. Bidder shall plan to develop the landscape & green belt areas and rainwater harvesting from the start of the project itself. The landscape and rainwater harvesting plan shall be finalized immediately after award of work and suitable work plan with priority and schedule shall also be finalized thereafter. Top soil before excavation shall be suitably preserved and stacked for landscape and green belt development. l) Provision of adequate shelters, water supply, sanitation and lighting in construction workers and staff camps. No camps for workers and staff shall be permitted within the plant premises and Bidder shall make separate arrangement outside the plant premises for locating and development of camps for construction workers and staff. The designated areas shall be suitably developed with infrastructure like roads, drains, water supply and sewerage and shall be free from water logging. Suitable low cost shelters will be provided for the workers. Complete area shall be secured by fencing and shall be provided adequate area lighting. Suitable waste disposal, shopping and recreation facilities will be developed in these camps. Contractor shall ensure that due importance is given to site management as discussed above and a detailed work plan considering the above aspects is finalized immediately after the award. A senior level executive shall be identified who shall be responsible for implementation of the work plan. Suitable format for progress reporting on site management plan shall be developed and made part of the project progress report. The progress on implementation of above work plan shall be reviewed along with project progress in the monthly project review meetings with owner. In case the progress on site management plan is unsatisfactory, Engineer-in Charge may withhold upto 1% of the monthly running bill (for civil and site erection works) till such time the required progress is demonstrated. Incase in the opinion of Engineer-in-charge, bidder's actions on site management aspects is not adequate, Engineer-in- charge may get the relevant work executed through a separate agency and deduct the expenses incurred from Bidder's bill along with overheads @10 %.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 20 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
37.00.00	FIELD OFFICE RECORDS The Contractor shall maintain at his Site Office up-to- date copies of all drawings, specifications and other Contract Documents and any other supplementary data complete with all the latest revisions thereto. The Contractor shall also maintain in addition the continuous record of all changes to the above Contract Documents, drawings, specifications, supplementary data, etc. effected at the field and on completion of his total assignment under the Contract shall incorporate all such changes on the drawings and other Engineering data to indicate as installed conditions of the equipment furnished and erected under the Contract. Such drawings and Engineering data shall be submitted to the Employer in required number of copies.			
38.00.00	CONTRACTOR'S MATERIALS BROUGHT ON TO SITE			
38.01.00	The Contractor shall bring to Site all equipment, components, parts, materials, including construction equipment, tools and tackles for the purpose of the Works under intimation to the Employer. All such goods shall, from the time of their being brought vest in the Employer, but may be used for the purpose of the Works only and shall not on any account be removed or taken away by the Contractor without the written permission of the Employer. The Contractor shall nevertheless be solely liable and responsible for any loss or destruction thereof and damage thereto.			
38.02.00	The Employer shall have a lien on such goods for any sum or sums which may at any time be due or owing to him by the Contractor, under, in respect of or by reasons of the Contract. After giving a fifteen (15) days notice in writing of his intention to do so, the Employer shall be at liberty to sell and dispose off any such goods, in such manner as he shall think fit including public auction or private treaty and to apply the proceeds in or towards the satisfaction of such sum or sums due as aforesaid.			
38.03.00	After the completion of the Works, the Contractor shall remove from the Site under the direction of the Employer the materials such as construction equipment, erection tools and tackles, scaffolding etc. with the written permission of the Employer. If the Contractor fails to remove such materials, within fifteen (15) days of issue of a notice by the Employer to do so then the Employer shall have the liberty to dispose off such materials as detailed under as specified at clause no 39.02.00 of this chapter and credit the proceeds thereto to the account of the Contractor.			
39.00.00	PROTECTION OF PROPERTY AND CONTRACTOR'S LIABILITY			
39.01.00	The Contractor shall be responsible for any damage resulting from his operations. He shall also be responsible for protection of all persons including members of public and employees of the Employer and the employees of other Contractors and Sub- Contractors and all public and private property including structures, building, other plants and equipments and utilities either above or below the ground.			
39.02.00	The Contractor will ensure provision of necessary safety equipment such as barriers, sign - boards, warning lights and alarms, etc. to provide adequate protection to persons and property. The Contractor shall be responsible to give reasonable notice to the Employer and the Employers of public or private property and utilities when			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 21 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT												
40.00.00	such property and utilities are likely to get damaged or injured during the performance of his Works and shall make all necessary arrangements with such Employers, related to removal and/or replacement or protection of such property and utilities. PAINTING For painting refer Part-A, sub section-III, Section VI of Technical specification. Painting for structures shall conform to the painting specification specified in Part-B under Civil. Painting for Electrical equipments/systems shall conform to the painting specification given in Electrical portion of Part-A and Part-B of technical specifications.												
41.00.00	INSURANCE												
41.01.00	In addition to the conditions covered under the Clause entitled "Insurance" in Section General Conditions of Contract (GCC), the following provisions will also apply to the portion of works to be done beyond the Contractor's own or his Sub-Contractor's manufacturing Works.												
41.02.00	Workmen's Compensation Insurance This insurance shall protect the Contractor against all claims applicable under the Workmen's Compensation Act, 1948 (Government of India). This policy shall also cover the Contractor against claims for injury, disability disease or death of his or his Sub-Contractor's employees, which for any reason are not covered under the Workmen's Compensation Act, 1948. The liabilities shall not be less than the following: <table><tr><td>Workmen's Compensation</td><td>-</td><td>As per Statutory Provisions</td></tr><tr><td>Employee's Liability</td><td>-</td><td>As per Statutory Provisions</td></tr></table>				Workmen's Compensation	-	As per Statutory Provisions	Employee's Liability	-	As per Statutory Provisions			
Workmen's Compensation	-	As per Statutory Provisions											
Employee's Liability	-	As per Statutory Provisions											
41.03.00	Comprehensive Automobile Insurance This insurance shall be in such a form to protect the Contractor against all claims for injuries, disability, disease and death to members of public including the Employer's men and damage to the property of other arising from the use of motor vehicles during on or off the Site operations, irrespective of the Ownership of such vehicles. The liability covered shall be as herein indicated : <table><tr><td>Fatal Injury</td><td>:</td><td>Rs.100,000 each person</td></tr><tr><td></td><td>:</td><td>Rs.200,000 each occurrence</td></tr><tr><td>Property Damage</td><td>:</td><td>Rs.100,000 each occurrence</td></tr></table>				Fatal Injury	:	Rs.100,000 each person		:	Rs.200,000 each occurrence	Property Damage	:	Rs.100,000 each occurrence
Fatal Injury	:	Rs.100,000 each person											
	:	Rs.200,000 each occurrence											
Property Damage	:	Rs.100,000 each occurrence											
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 22 OF 53									

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
41.04.00	~~Comprehensive General Liability Insurance~~		
41.04.01	~~The insurance shall protect the Contractor against all claims arising from injuries, disabilities, disease or death of members of public or damage to property of others, due to any act or omission on the part of the Contractor, his agents, his employees, his representatives and Sub-Contractors or from riots, strikes and civil commotion. This insurance shall also cover all the liabilities of the Contractor arising out of the Clause entitled "Defence of Suits" in Section General Conditions of Contract (GCC).~~		
41.04.02	~~The hazards to be covered will pertain to all the Works and areas where the Contractor, his Sub-Contractors, his agents and his employees have to perform work pursuant to the Contract.~~		
41.05.00	~~The above are only illustrative list of insurance covers normally required and it will be the responsibility of the Contractor to maintain all necessary insurance coverage to the extent both in time and amount to take care of all his liabilities either direct or indirect, in pursuance of the Contract.~~		
42.00.00	UNFAVOURABLE WORKING CONDITIONS The Contractor shall confine all his field operations to those works which can be performed without subjecting the equipment and materials to adverse effects during inclement weather conditions, like monsoon, storms, etc. and during other unfavourable construction conditions. No field activities shall be performed by the Contractor under conditions which might adversely affect the quality and efficiency thereof, unless special precautions or measures are taken by the Contractor in a proper and satisfactory manner in the performance of such Works and with the concurrence of the Employer. Such unfavourable construction conditions will in no way relieve the Contractor of his responsibility to perform the Works as per the schedule.		
43.00.00	PROTECTION OF MONUMENTS AND REFERENCE POINTS The Contractor shall ensure that any finds such as relic, antiquity, coins, fossils, etc. which he may come across during the course of performance of his Works either during excavation or elsewhere, are properly protected and handed over to the Employer. Similarly the Contractor shall ensure that the bench marks, reference points, etc., which are marked either with the help of Employer or by the Employer shall not be disturbed in any way during the performance of his Works. If, any work is to be preformed which disturb such reference, the same shall be done only after these are transferred to other suitable locations under the direction of the Employer. The Contractor shall provide all necessary materials and assistance for such relocation of reference points etc.		
44.00.00	WORK & SAFETY REGULATIONS		
44.01.00	General i) The contractor shall comply with all the requirements of "The Building and Other Construction Workers (Regulation of Employment & Conditions of		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 23 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	Service) Act," 1996 and its Central Rule 1998 / State Rules and any other statutory requirements as applicable. ii) The Contractor shall follow NTPC Safety Rules as issued from time to time with respect to safety in construction & erection. iii) The contractor shall have the approved Safety, Health and Environment (SHE) Policy in respect of Safety and health of Building Workers and it shall be circulated widely and displayed at conspicuous place in Hindi and local language understood by the majority of the workers. A copy of the safety policy should be submitted to Engineer in charge. iv) The contractor shall submit the safety plan comprising of methods to implement the Safety Policy/ Rules, Risk assessment and ensuring Safety at work areas, Safety audits, inspections and its compliance, Supervision and responsibility to ensure Safety at various levels, Safety training to employees, review of Safety and accident analysis, ensure Health and Safety Procedures to prevent accidents to Engineer I/c for approval as per the format of Safety plan as annexed at Annexure - III. v) The Contractors shall ensure proper safety of all the workmen, materials, plant and equipment belonging to him or to the Employer or to others, working at the Site. vi) All equipments used in construction and erection by the contractor shall meet BIS / International Standards and where such standards do not exist, the Contractor shall ensure these to be absolutely safe. All equipments shall be strictly operated and maintained by the contractor in accordance with manufacturer's operation manual. The contractor should also follow Guidelines / Rules of the Employer in this regard. vii) The Contractors shall provide suitable latest Personal Protective Equipments of prescribed standard to all their employees and workmen according to the need. The Engineer I/c shall have the right to examine these safety equipments to determine their suitability, reliability, acceptability and adaptability. The contractor should also ensure these before their use at worksite. viii) The Contractor shall provide safe working conditions to all workmen and employees at his workplace including safe means of access, railings, stairs, and ladders, scaffolding, work platforms, toe boards etc. The scaffoldings shall be erected under the control and supervision of an experienced and competent person. For erection of scaffolds, access, work platforms etc. shall be good and the contractor shall use standard quality of material. ix) The Contractor shall follow and comply with all the Safety Rules, standards, code of practices of NTPC and relevant provisions of applicable laws pertaining to the safety of workmen, employees, plant and equipment as may be prescribed from time to time without any protest or contest or reservation. In case of any unconformity between statutory requirement and the Safety Rules of the Employer referred above, the latter shall be binding on the		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 24 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	Contractor unless the statutory provisions are more stringent. As and when required he can refer / obtain copy of NTPC safety documents as stated above. x) The contractor shall have his own arrangements with nearby hospitals for shifting and treatment of sick and injured. The medical examination of the workers employed in hazardous areas shall be conducted as per Rule 223 Of The Building and Other Construction Worker (Regulation of Employment and Condition of Service) Central Rule 1998 Their health records shall be maintained accordingly and to be submitted to Engineer I/c when asked for. If any worker found suffering from occupational health hazard, the worker should be shifted to suitable place of working and properly treated under intimation to Engineer I/c. The medical fitness certificate to be submitted to Engineer (I/c). xi) First Aid boxes equipped with requisite articles as specified in the Rule 231 of The Building and Other Construction Worker (Regulation of Employment and Condition of Service) Central Rule 1998 shall be provided at construction sites for the use of workers. Training has to be provided on first aid to workmen & office bearers working at site. xii) Bidder also requested to refer the safety rules under http://www.ntpctender.com/ applicable for FGD package. Safety rules shall be followed as per the safety rules indicated under http://www.ntpctender.com/			
44.01.01	Emergency Action Plan The contractor shall prepare an emergency action plan approved by his competent authority to handle any emergency occurred during construction work. Regular mock drills shall be organized to practice this emergency plan. The Emergency Action Plan should be widely circulated to all the employees and suitable infrastructure shall be provided to handle the emergencies.			
44.01.02	Scaffolding The contractor shall take all precautions to prevent any accidental collapse of scaffolding or fall of persons from scaffolding. The contractor should ensure that scaffolding are designed by a competent person and its erection and repairs should be done under the expert supervision. The scaffolding shall meet the required strength and other requirements for the purpose for which the scaffold is erected. The material used for scaffold should conform to the BIS / International standards.			
44.01.03	Opening The contractor shall ensure that there is no opening in any working platform/any floor of the building, which may cause fall of workers or material. When ever an opening on a platform/any floor of the building is unavoidable, the opening should be suitably fenced and necessary measures for protection against falling objects or building workers from such platform are taken by providing suitable safety nets, safety belts or other similar means.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 25 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनटीपीसी NTPC
44.01.04	Explosives The contractor shall take all precautions while handling, using, storing or transporting of all explosives. Before usage of any explosive necessary warning / danger signals be erected at conspicuous places to warn the workers and general public. The contractor should strictly ensure that all measures and precautions required to be complied for use, handling, storing or transportation of explosives under the rules framed under the Explosives Act, 1884.	
44.02.00	Fencing of Machinery The contractor shall provide suitable fencing or guard to all dangerous and moving parts of machinery. The contractor shall not allow any of the employees to clean, lubricate, repair, adjust or examine during machinery in motion, which may cause injury to the person.	
44.03.00	Carrying of Excessive Weight by a Worker The worker shall not be allowed to lift by hand or carry over his head, back or shoulder more than the maximum limit set by the prescribed rules for the construction Workers.	
44.04.00	Dangerous and Harmful Gases / Equipment The contractor shall ensure that the workers are not exposed to any harmful gases during any construction activity including excavation, tunneling, confined spaces etc. The contractor should not allow any worker to go into the confined space unless it is certified by Engineer (I/c) to be safe and fit for the entry to such work place. Proper record and work permits should be followed to carry out such works.	
44.05.00	Overhead Protection The contractor shall ensure that any area exposed to risk of falling materials, articles or objects is roped off or cordoned off or otherwise suitably guarded from inadvertent entry of any person. Wherever there is a possibility of falling of any material, equipment or construction workers while working at heights, a suitable and adequate safety net should be provided. The safety net should be in accordance with BIS Standards.	
44.06.00	Working at Heights All working platforms, ways and other places of construction work shall be free from accumulations of debris or any other material causing obstructions and tripping. Wherever workers are exposed to the hazard of falling into water, the contractor shall provide adequate equipment for saving the employees from drowning and rescuing from such hazards. The contractor shall provide boat or launch equipped with sufficient number of life buoys, life jackets etc. manned with trained personnel at the site of such work.	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT
PAGE 26 OF 53		

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
44.07.00	Every opening at elevation from ground level through which a building worker, vehicle, material equipment etc. may fall at a construction work shall be covered and/or guarded suitably by the contractor to prevent such falls. Wherever the workers are exposed to the hazards of falling from height, the contractor shall provide full harness safety belts fitted with fall arresting systems to all the employees working at higher elevations and life line of 8 mm diameter wire rope with turn buckles for anchoring the safety belts while working or moving at higher elevations. Safety nets shall also be provided for saving them from fall from heights and such equipment should be in accordance with BIS standards. Wherever there is a possibility of falling of any material, equipment or construction workers while working at heights, a suitable and adequate safety net should be provided. The safety net should be in accordance with BIS Standards. The contractor shall provide standard prefabricated ladders on the columns where the workers are required to use them as an access for higher elevations till permanent staircase is provided. The workers shall be provided with safety belts fitted with suitable fall arresting system (Fall arrestors) for climbing/getting down through ladders to prevent fall from height.			
	Handling of Hazardous Chemicals The Contractor will notify well in advance to the Engineer I/c of his intention to bring to the Site any container filled with liquid or gaseous fuel or explosive or petroleum substance or such chemicals which may involve hazards. NTPC shall have the right to prescribe the conditions, under which such container is to be stored, handled and used during the performance of the works and the Contract shall strictly adhere to and comply with such instructions. The Engineer I/c shall have the right at his sole discretion to inspect any such container or such construction plant / equipment for which material in the container is required to be used and if in his opinion, its use is not safe, he may forbid its use. No claim due to such prohibition shall be entertained by NTPC and NTPC shall not entertain any claim of the Contractor towards additional safety provisions / conditions to be provided for / constructed. Further, any such decision of the Engineer I/c shall not, in any way, absolve the Contractor of his responsibilities and in case, use of such a container or entry thereof into the Site area is forbidden by NTPC, the Contractor shall use alternative methods with the approval of the NTPC without any cost implication to the NTPC or extension of work schedule. Where it is necessary to provide and / or store petroleum products or petroleum mixtures and explosives, the Contractor shall be responsible for carrying-out such provision and / or storage in accordance with the rules and regulations laid down in Petroleum Act 1934, Explosives Act 1948, and Petroleum and Carbide of Calcium Manual published by the Chief Inspector of Explosives of India. All such storage shall have prior approval of the Engineer I/c. In case any approvals are necessary from the Chief Inspector (Explosives) or any statutory authorities, the Contractor shall be responsible for obtaining the same.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 27 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
44.08.00	The Contractor shall be fully responsible for the safe storage of his and his Sub-contractor's radio-active sources in accordance with BARC/DAE (Bhabha Atomic Research Centre/ Department of Atomic Energy, Govt. of India) Rules and other applicable provisions. All precautionary measures stipulated by BARC/DAE in connection with use, the contractor would take storage and handling of such material. The contractor shall provide suitable personal protective equipments to the workers who are handling the hazardous and corrosive substances including alkalis and acids. As a precautionary measure the contractor should keep the bottles filled with distilled water in cupboard / Boxes near work place for emergency eye wash by worker exposed to such hazardous chemicals.		
	Eye Protection The contractor shall provide suitable personal protective equipment to his workmen depending upon the nature of hazards and ensure their usage by the workers engaged in operations like welding, cutting, chipping, grinding or similar operations which may cause injuries to his eyes.		
	Excavation The contractor shall take all necessary measures during excavation to prevent the hazards of falling or sliding material or article from any bank or side of such excavation which is more than one and a half meter above his footing by providing adequate piling, shoring, bracing etc. against such bank or sides. Adequate and suitable warning signs shall be put up at conspicuous places at the excavation work to prevent any persons or vehicles falling into the excavation trench. No worker should be allowed to work where he may be stuck or endangered by excavation machinery or collapse of excavations or trenches. Electrical Hazards The contractor should ensure that all electrical installations at the construction work comply with the requirements of latest electricity acts / rules. The contractor shall take all adequate measures to prevent any worker from coming into physical contact with any electrical equipment or apparatus, machines or live electrical circuits which may cause electrical hazards during the construction work. The contractor shall provide the sufficient ELCBs / RCCBs for all the portable equipments, electrical switchboards, distribution panels etc. to prevent electrical shocks. The contractor should ensure use of single / double insulated hand tools or low voltage i.e., 110 volts hand tools. The contractor should also ensure that all temporary electrical installations at the construction works are provided with earth leakage circuit breakers.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 28 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
44.11.00	Vehicular Traffic The contractor should employ vehicle drivers who hold a valid driving license under the Motor Vehicles Act, 1988.		
44.12.00	Lifting Appliances, Tools & Tackles, Lifting Gear And Pressure Plant & Equipment etc. The contractor shall ensure all the lifting appliances, tools & tackles including cranes etc., lifting gear including fixed or movable and any plant or gear, hoists, Pressure Plant and equipment etc. are in good condition and shall be examined by competent person and only certified shall be used at sites. Periodical Examination and the tests for all lifting / hoisting equipment & tackles shall be carried out. A register of such examinations and tests shall be properly maintained by the Contractor and will be promptly produced as and when desired by the Engineer I/c or by the person authorized by him.		
44.13.00	Excessive Noise, Vibration The contractor shall take adequate measures to protect the workers against the harmful effect of excessive noise or vibration. The noise should not exceed the limits prescribed under the concerned rules, Noise Pollution (Regulation and Control) Rules, 2000.		
44.14.00	Electrical Installations		
44.14.01	The Contractor shall not interfere or disturb electric fuses, wiring and other electrical equipment belonging to the Employer or other contractors under any circumstances, whatsoever, unless expressly permitted in writing by the Engineer I/c to handle such fuses, wiring or electrical equipment. Before the Contractor connects any electrical appliances to any plug or socket belonging to the other contractor or the NTPC, he shall - Satisfy the Engineer I/C that the appliance is in good working condition; - Inform the Engineer I/C of the maximum current rating, voltage and phases of the appliances; - Obtain permission of the Engineer I/C detailing the sockets to which the appliances may be connected. The Engineer I/C will not grant permission to connect until he is satisfied that: The appliance is in good condition and is fitted with suitable plug; having earth connection with the body. Wherever armored / metallic sheathed multi core cable is used, the same armored / sheathed should be connected to earth. - No repair work shall be carried out on any live equipment. The Engineer I/c must declare the equipment safe and a permit to work shall be issued by the		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 29 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	NTPC / contractor as the case may be to carry out any repair / maintenance work. While working on electric lines / equipments whether live or dead, suitable type and sufficient quantity of tools will have to be provided by the contractor to electricians / workmen / Officers. v) The contractor shall employ necessary number of qualified, full time Electricians / Electrical Supervisors to maintain his temporary electrical installation. The installations are provided with suitable ELCBs and RCCBs wherever required.		
44.15.00	Safety Organisation		
44.15.01	The contractor employing more than 250 workmen whether temporary, casual, probationary, regular or permanent shall employ at least one full time safety officer exclusively to supervise safety aspects of the equipments and workmen, who will coordinate with the NTPC Safety Officer. Further requirement of safety officers, if any, shall be guided by Rule 209 of The Building and Other Construction Worker (Regulation of Employment and Conditions of Service) Central Rule 1998. In case the work is being carried out through subcontractor, the employees / workmen of the sub contractor shall also be considered as the contractor's employees/workmen for the above purpose. In case of contractor deploying less than 250 workmen he should designate one of his Engr / supervisor or the contractor himself (if he is directly supervising the work) as safety officer in addition to his existing responsibilities. The Engr./ supervisor should get atleast 2days safety training from any reputed organization or from NTPC before resuming the work. If already trained in past the declaration along with trg. certificate to be furnished to NTPC safety officer.		
44.15.02	The name and address of such Safety Officer of the Contractor will be promptly informed in writing to the EIC with a copy to the Project Safety Officer before he starts work or immediately after any change of the incumbent is made during currency of the Contract.		
44.16.00	Reporting of Accident and Investigation In case any accident occurs during the construction / erection or other associated activities undertaken by the Contractor thereby causing any near miss, minor or major or fatal injury to his employees due to any reason, whatsoever, it shall be the responsibility of the Contractor to promptly inform the same to the Engineer I/C, NTPC Safety Officer with a copy to NTPC Head of Project in the prescribed form and also to all the authorities envisaged under the applicable laws.		
44.17.00	Right to stop Work		
44.17.01	The Engineer I/C shall have the right at his sole discretion to stop the work, if in his opinion the work is being carried out in such a way that it may cause accidents and endanger the safety of the persons and / or property, and / or equipments. In such cases, the contractor shall be informed in writing about the nature of hazards and		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 30 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	possible injury / accident and he shall comply to remove shortcomings promptly. The Contractor after stopping the specific work can, if felt necessary appeal against the order of stoppage of work to the Project Manager within 3 days of such stoppage of work and decision of the Project Manager in this respect shall be conclusive and binding on the Contractor.		
44.17.02	The Contractor shall not be entitled for any damages / compensation for stoppage of work, {Sub-Clause XVIII (I)} due to safety reasons and the period of such stoppage of work shall not be taken as an extension of time for Completion of the Facilities and will not be the ground for waiver of levy of liquidated damages.		
44.18.00	Fire Protection The contractor shall provide sufficient fire extinguishers at place /s of work. The fire extinguishers shall be properly maintained as per relevant BIS Standards. The employees shall be trained to operate the fire extinguishers / equipment.		
44.19.00	Penalties I If the Contractor fails in providing safe working environment as per the Safety Rules of NTPC or continues the work even after being instructed to stop the work by the Engineer I/C as provided in Clause XVIII (1) above, the Contractor shall be penalized at the rate of Rs. 25,000/- per day or part thereof till the instructions are complied with and so certified by the Engineer I/C. However, in case of accident, the provisions contained in Sub-Clause XX (II) below shall also apply in addition to the penalties mentioned in this sub-clause. II If the Contractor does not take all safety precautions and / or fails to comply with the Safety Rules as prescribed by the Employer or under the applicable law for the safety of the plant and equipment and for the safety of personnel and the contractor does not prevent hazardous conditions which cause injury to this own employees or employees of other contractors, or NTPC's employees or any other person who are at the Site or adjacent thereto, the Contractor shall be responsible for payment of penalty to NTPC as per the following schedule:- a) Fatal injury or accident causing death: Penalty @10% of contract value or Rs. 5,00,000/- per person, which ever is less. b) Major injuries or accident causing 25% or more permanent disablement to workmen or employees: Penalty @2.5% of contract value or Rs. 1,00,000/- per person which ever is less Permanent disablement shall have the same meaning as indicated in The Workmen's Compensation Act' 1923. The penalty mentioned above shall be in addition to the compensation payable to the workmen / employees under the relevant provisions of the Workmen's		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 31 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	Compensation Act' 1923 and rules framed there under or any other applicable laws as applicable from time to time. III If any contractor worker found working without using the safety equipment like safety helmet, safety shoes, safety belts, etc. or without anchoring the safety belts while working at height the Engineer I/c / Safety Officer of NTPC shall have the right to penalize the contractor for Rs. 200/- per person per day and such worker shall be sent out of the workplace immediately and shall not be allowed to work on that day. Engineer I/c / Safety Officer of NTPC will also issue a notice in this regard to the contractor. IV If two or more fatal accidents occur at same NTPC site under the control of contractor during the period of contract and he has (1) not complied with keeping adequate PPEs in stock or (2) defaulted in providing PPEs to his workmen (3) not followed statutory requirements / NTPC safety rules (4) been issued warning notice/s by NTPC head of the project on non observance of safety norms (5) not provided safety training to all his workmen, the contractor can be debarred from getting tender documents in NTPC for two years from the date of last accident. The safety performance will also be one of the overriding criteria for evaluation of overall performance of the contractors by NTPC. The contractor shall submit the accident data including fatal / non-fatal accidents for the last 3 years where he has undertaken the construction activities Projects-wise along with the tender documents. This will also be considered for evolution of tender documents. If the information given by the contractor found incorrect, his contract will be liable to be terminated.			
44.20.00	The Contractor will make available minimum quantity of all safety equipments and safety personal protection equipments (PPEs) of required specifications as per suggestive list included bidding documents as a part of "List of minimum T & P". Further Contractor will ensure availability of additional requirement for individual worker and safety equipment as per site requirement during execution of the contract till its completion.			
44.21.00	Award If the Contractor's performance on safety front is found satisfactory i.e. without any fatal/reportable accident in the year of consideration; he may be considered for suitable award "ACCIDENT FREE SAFETY MERITORIOUS AWARD" as per scheme of the employer.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 32 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनटीपीसी NTPC		
44.22.00	The Contractor shall abide by the following during Construction and Erection activities: I. Chain pulley block shall not be used for loads more than 2 (Two) tonne. II. Hydra shall not be used for material transport. III. Cage shall necessarily be provided to Monkey ladders of height more than 4 m. IV. Fencing shall be provided to all Electrical Distribution boards and transformers etc.			
45.00.00	FOREIGN PERSONNEL			
45.01.00	The Contractor shall submit to the Employer data on all personnel he proposes to bring into India from abroad for the performance of the Works under the Contract, at least sixty (60) days prior to their departure to India. Such data will include for each person the name, his present address, his assignment and responsibility in connection with the works, and a short resume of his qualification, experience etc. in relation to the work to be performed by him.			
45.02.00	Any person unsuitable and unacceptable to the Employer shall not be brought to India. Any person brought to India, if found unsuitable or unacceptable by the Employer, the Contractor shall within a reasonable time make alternate arrangements for providing a suitable replacement and repatriation of such unsuitable personnel.			
45.03.00	No person brought to India for the purposes of the works shall be repatriated without the consent of the Employer in writing, based on a written request from the Contractor for such repatriation giving reasons for such an action to the Employer. The Employer may give permission for such repatriation provided he is satisfied that the progress of work will not suffer due to such repatriation.			
45.04.00	The cost of passports, visas and all other travel expenses to and from India, incurred by the Contractor shall be to his account. The Employer will not provide any residential accommodation and/or furniture for any of the Contractor's personnel including foreign personnel and Contractor shall make his own arrangements for such facilities in the area allotted at Site, to him by the Employer for that purpose.			
45.05.00	The Contractor and his expatriate personnel shall respect all Indian Acts, Laws, rules and regulations and shall not in any way interfere with Indian political and religious affairs and shall conform to any other rules and regulations which the Government of India and the Employer may establish from time to time, on them. The Contractor's expatriate personnel shall work and live in close co-operation and coordination with their co-workers and the community and shall not engage themselves in any other employment neither part-time nor full-time nor shall they take part in any local politics.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 33 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
45.06.00	The Employer shall assist the Contractor, to the extent possible, in obtaining necessary permits to travel to India and back, by issue of necessary certificates and other information needed by the Government agencies.			
46.00.00	FOUNDATION DRESSING & GROUTING FOR EQUIPMENT/ EQUIPMENT BASES			
46.01.00	~~The surfaces of foundations shall be dressed to bring the top surface of the foundations to the required level, prior to placement of equipment/equipment bases on the foundations.~~			
46.02.00	~~All the equipment/ equipment bases, shall be grouted and finished by bidder as per these specifications unless otherwise recommended by the equipment manufacturer.~~			
46.03.00	~~The concrete foundation surfaces shall be properly prepared by bidder by chipping, grinding as required to bring the top of such foundation to the required level, to provide the necessary roughness for bondage and to assure enough bearing strength.~~			
46.04.00	Grout The grout for equipment foundation shall be high strength grout having a minimum characteristic compressive strength of 60 N/mm2 at 28 days. The grout shall be ready mix non-shrink, chloride - free, cement based, free flowing, non-metallic grout as recommended by equipment manufacturer. The ready mix grout shall be of reputed make as approved by the Employer. The Grout shall have good flowability even at very low water/ grout powder ratio. The Grout shall have characteristics of controlled expansion to be able to occupy its original volume to fill the voids and to compensate for shrinkage. Grout shall be of pre-mix variety so that only water needs to be added before use. The mixing of the Grout shall conform to the recommendations of the manufacturer of the Grout.			
46.05.00	Placing of Grout			
46.05.01	After the base has been prepared, its alignment and level has been checked and approved and before actually placing the grout, a low dam shall be set around the base at a distance that will permit pouring and manipulation of the grout. The height of such dam shall be at least 25mm above the bottom of the base. Suitable size and number of chains shall be introduced under the base before placing the grout, so that such chains can be moved back & forth to push the grout into every part of the space under the base.			
46.05.02	The grout shall be poured either through grout holes if provided or shall be poured at one side or at two adjacent sides to make the grout move in a solid mass under the base and out in the opposite side. Pouring shall be continued until the entire space below the base is thoroughly filled and the grout stands at least 25 mm higher all			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 34 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
	around than the bottom of the base. Enough care should be taken to avoid any air or water pockets beneath the bases.		
46.05.03	In addition to the above, recommendations of Grout manufacturer shall also be followed.		
46.06.00	Finishing of the Edges of the Grout		
	The poured grout should be allowed to stand undisturbed until it is well set. Immediately thereafter, the dam shall be removed and grout which extends beyond the edges of the structural or equipment base plates shall be cut off, flushed and removed. The edges of the grout shall then be pointed and finished with 1:2 cement mortar pressed firmly to bond with the body of the grout and smoothed with a tool to present a smooth vertical surface. The work shall be done in a clean and scientific manner and the adjacent floor spaces, exposed edges of the foundations, and structural steel and equipment base plates shall be thoroughly cleaned of any spillage of the grout.		
46.07.00	Checking of Equipment After Grouting		
	After the grout is set and cured, the Contractor shall check and verify the alignment of equipments, alignment of shafts of rotating machinery, the slopes of all bearing pedestals, centering of rotors with respect to their sealing bores, couplings, etc. as applicable and the like items to ensure that no displacement had taken place during grouting. The values recorded prior to grouting shall be used during such post grouting check- up and verifications. Such pre and post grout records of alignment details shall be maintained by the Contractor in a manner acceptable to the Employer.		
47.00.00	SHAFT ALIGNMENTS		
	All the shafts of rotating equipment shall be properly aligned to those of the matching equipments to as perfect an accuracy as practicable. The equipment shall be free from excessive vibration so as to avoid overheating of bearings or other conditions which may tend to shorten the life of the equipment. The vibration level of rotating equipments measured at bearing housing shall conform to Zone A of ISO 10816. All bearings, shafts and other rotating parts shall be thoroughly cleaned and suitably lubricated before starting.		
48.00.00	DOWELLING		
	All the motors and other equipment shall be suitably doweled after alignment of shafts with tapered machined dowels as per the direction of the Employer.		
49.00.00	CHECK OUT OF CONTROL SYSTEMS		
	After completion of wiring, cabling furnished under separate specification and laid and terminated by the Employer, the Contractor shall check out the operation of all control systems for the equipment furnished and installed under these specifications and documents.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 35 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
50.00.00	COMMISSIONING SPARES			
50.01.00	It will be the responsibility of the Contractor to provide all commissioning spares including consumable spares required for initial operation till the Completion of Facilities. The Contractor shall furnish a list of all commissioning spares within 60 days from the date of Notification of Award and such list shall be reviewed by the Employer and mutually agreed to. However, such review and agreement will not absolve the Contractor of his responsibilities to supply all commissioning spares so that initial operation do not suffer for want of commissioning spares. All commissioning spares shall be deemed to be included in the scope of the Contract at no extra cost to the Employer.			
50.02.00	These spare will be received and stored by the Contractor atleast 3 months prior to the schedule date of commencement of initial operation of the respective equipment and utilised as and when required. The unutilised spares and replaced parts, if any, at the end of successful completion of guarantee tests shall be the property of the Contractor and he will be allowed to take these parts back at his own cost with the permission of Employer.			
51.00.00	CABLING			
51.01.00	All cables shall be supported by conduits or cable tray run in air or in cable channels. These shall be installed in exposed runs parallel or perpendicular to dominant surfaces with right angle turn made of symmetrical bends or fittings. When cables are run on cable trays, they shall be clamped at a minimum intervals of 2000mm or otherwise as directed by the Employer.			
51.02.00	Each cable, whether power or control, shall be provided with a metallic or plastic tag of an approved type, bearing a cable reference number indicated in the cable and conduit list (prepared by the Contractor), at every 5 meter run or part thereof and at both ends of the cable adjacent to the terminations. Cable routing is to be done in such a way that cables are accessible for any maintenance and for easy identification.			
51.03.00	Sharp bending and kinking of cables shall be avoided. The minimum radii for PVC insulated cables 1100 V grade shall be 15 D where D is the overall diameter of the cable. Installation of other cables like high voltage, coaxial, screened, compensating, mineral insulated shall be in accordance with the cable manufacturer's recommendations. Wherever cables cross roads and water, oil, sewage or gaslines, special care should be taken for the protection of the cables in designing the cable channels.			
51.04.00	In each cable run some extra length shall be kept at a suitable point to enable one or two straight through joints to be made, should the cable develop fault at a later date.			
51.05.00	Control cable terminations shall be made in accordance with wiring diagrams, using identifying codes subject to the Employer's approval. Multicore control cable jackets shall be removed as required to train and terminate the conductors. The cable jacket shall be left on the cable, as far as possible, to the point of the first conductor branch. The insulated conductors from which the jacket is removed shall be neatly twined in bundles and terminated. The bundles shall be firmly but not tightly tied			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 36 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
51.06.00	utilising plastic or nylon ties or specifically treated fungus protected cord made for this purpose. Control cable conductor insulation shall be securely and evenly cut. The connectors for control cables shall be covered with a transparent insulating sleeve so as to prevent accidental contact with ground or adjacent terminals and shall preferably terminate in Elmex terminals and washers. The insulating sleeve shall be fire resistant and shall be long enough to over pass the conductor insulation. All control cables shall be fanned out and connection made to terminal blocks and test equipment for proper operation before cables are corded together.			
52.00.00	EQUIPMENT DELIVERY AND ERECTION			
52.01.00	General Requirements (a.) This part covers Contractor's responsibilities for packing, shipping, warehousing and the installation of all equipment and materials furnished and installed under this specification. (b.) The Contractor shall submit for Employer's approval draft manual for Equipment Delivery and Erection (EDE Manual) covering detailed instructions, write up, technical data, drawings, check-lists, documentation formats for all activities after equipment manufacture upto installation of equipment. This manual shall cover general instructions for all equipment and specific instructions for individual equipment wherever required and shall include at least the following : (1.) Instructions for packing, shipping, receiving handling, warehousing and storage. (2.) Instructions for location and installation of equipment furnished by this specification. (3.) Installation drawings for field mounted equipment, panels, cubicles and other equipment covered under this specification. (4.) Instruction relating installation of piping/ tubing, support and routing drawings of impulse pipes/signal tubes and tube/cable trays. (5.) Check lists and quality assurance hold points. (6.) Format for all related documentation. (c.) The EDE Manual shall conform to the requirements of this specification, all applicable codes and standards, recommendations of equipment manufacturers and accepted good engineering practices and shall be subject to Employer approval during detailed engineering. (d.) The Contractor shall ensure that all work under this part shall be performed as per the requirements of this specification, Employer approved EDE Manual and drawing/documents approved by the Employer during detailed engg.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 37 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
52.02.00	Crating (a.) All equipment and materials shall be suitably coated, wrapped, or covered and boxed or crated for moist humid tropical shipment and to prevent damage or deterioration during handling and storage at the site. (b.) Equipment shall be packed with suitable desiccants, sealed in water proof vapour-proof wrapping and packed in lumber of plywood enclosures, suitably braced, tied and skidded. Lumber enclosures shall be solid, not slatted. (c.) Desiccants shall be either silica gel or calcium sulphate, sufficiently ground to provide the required surface area and activated prior to placing in the packaging. Calcium sulphate desiccants shall be of a chemical nature to absorb moisture. In any case, the desiccant shall not be of a type that will absorb enough moisture to go into solution. Desiccants shall be packed in porous containers, strong enough to withstand handling encountered during normal shipment. Enough desiccant shall be used for the volumes enclosed in wrapping. (d.) Review by the Employer of the Contractor's proposed packaging methods shall not relieve the Contractor of responsibility for damage or deterioration to the equipment and materials specified. (e.) All accessory items shall be shipped with the equipment. ; Boxes and crates containing accessory items shall be marked so that they are identified with the main equipment. The contents of each box and crates shall be indicated by markings on the exterior. (f.) All boxes, crates, cases bundles, loose pieces, etc. shall be marked consecutively from No.1 upward throughout all shipments from a given port to completion of the order without repeating the same number. (g.) An itemized list of contents shall be enclosed inside each case and one other copy securely fastened to the outside of the case in a tin or light weight sheet metal envelope or pocket. The lists shall be plainly marked and placed in accessible locations to facilitate receipt and inspection. The packing list shall indicate whether shipment is partial or complete and shall incorporate the following information on each container, etc., according to its individual shipping number: a) Export case markings b) Case number c) Gross weight and net weight in Kilograms d) Dimensions in centimeters e) Complete description of material		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 38 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT		
52.03.00	(h.) Packaging or shipping units shall be designed within the limitations of unloading facilities and the equipment which will be used for transport. Complications involved with ocean shipment and the limitations of ports, railways and roads shall be considered. It shall be the Contractor's responsibility to investigate these limitations and to provide suitable packaging to permit safe handling during transit and at the job site. (i.) Electrical equipment, control and instrumentation shall be protected against moisture and water damage. All external gasket surfaces and flange faces, couplings, motor pump shafts, bearing and like items shall be thoroughly cleaned and coated with rust preventive compound as specified above and protected with suitable wood, metal or other substantial type covering to ensure their full protection. (j.) Equipment having antifriction or sleeve bearings shall be protected by weather tight enclosures. (k.) Coated surfaces shall be protected against impact, abrasion, discolouration and other damage. Surfaces which are damaged shall be repaired. (l.) All exposed threaded parts shall be greased and protected with metallic or other substantial type protectors. All female threaded openings shall be closed with forged steel plugs. All pipings, tubing, and conduit equipment and other equipment openings shall be sealed with metallic or other rough usage covers and tapped to seal the interior of the equipment piping, tubing, or conduit. (m.) Provisions shall be made to ensure that water does not enter any equipment during shipment or in storage at the plant site. (n.) Returnable containers and special shipping devices shall be returned by the manufacturer's field representative at the Contractor's expense. (o.) While packaging the material, care shall be taken for the limitation from the point of view of availability of railway wagon sizes in India.		
	Factory Assembly (a.) Instrument enclosures shall be supplied and erected completely in the factory with instrument, air supply and blow down piping with necessary valves, fittings, etc. and also all electrical wiring between the instruments and the enclosure terminal blocks. Control panel and cubicles shall also be fully wired in the factory. Control panel mounted equipments are to be dismounted from the panels before shipment and individually packed for shipment. Electronic control modules of the plug-in type are to be removed from equipment racks after factory checkout are individually packed for shipment. Other equipment shall be fully assembled at the factory, except for necessary shipping splits in panels. (b.) All separately packaged accessories items and parts shall be shipped with the equipment. Containers for separately packaged items shall be marked		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 39 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			एनडीपीसी NTPC
52.04.00	so that they are identified with the main equipment. An itemized packing slip, indicating what is in that carton only, shall be attached to the outside and inside of each container used for packing. A master packing slip covering all accessories items for a given piece of equipment which are shipped in separate containers, shall be attached to one container. Equipment Installation (a.) General Requirements (1.) The Contractor shall furnish all construction materials, tools and equipment and shall perform all work required for complete installation of all control and instrument equipment furnished under this specification. (2.) Contractor shall prepare detailed installation drawings for each equipment furnished under this specification for Employer's approval. Installation of all equipment/systems furnished by this specification shall be as per Employer's approval. (3.) Erection procedures not specified herein shall be in accordance with the recommendations of the equipment manufacturers. The procedures shall be acceptable to the Employer. (4.) The Contractor shall coordinate his work with other suppliers where their instruments and devices are to be installed under specifications. (b.) Installation Materials All materials required for installation, testing and commissioning of the equipment shall be furnished by the Contractor. (c.) Regulatory Requirements All installation procedures shall confirm with the accepted good engineering practice and with all applicable governmental laws, regulations and codes. (d.) Cleaning All equipment shall be cleaned of all sand, dirt and other foreign materials immediately after removal from storage and before the equipment is brought inside the power plant building or to other installation sites. All piping and tubes shall be air blown. (e.) Equipment Assembly Equipment installed under these specifications shall be assembled if shipped unassembled. The equipment shall be dismantled and reassembled as			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 40 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनटीपीसी NTPC	
	required to perform the installation and commissioning work described in these specifications. (f.) Equipment Setting Field mounted instruments and accessories shall be bracket or sub panel mounted on the nearest suitable firm steel work or masonry. The brackets, stands, supports and other miscellaneous hardware required for mounting instruments and accessories such as receiver gauge, air set, valve manifold, purge-meter etc. shall be furnished and installed. No field mounted instruments shall be installed such that it depends for support or rigidity on the impulse piping or on electrical connection to it. Indicating type field mounted instruments shall be installed in such a way that centre of indicating dial shall be about 1600-1800mm from operating floor level. Non-indicating type field instruments shall be installed such that operating handle of manifold block / isolating cock comes within 1600 mm from operating floor level. (g.) Free-Standing Equipment Free-standing Cabinets shall be attached to the floor, concrete equipment bases or supporting steel as indicated on the manufacturer's drawings and the Employer's Plant Arrangement Drawings. The cabinets shall be shimmed for proper alignment before bolting them to the floor. Adjacent enclosures shall be shimmed to maintain mutually level appearance before they are attached to floor. Vibration dampening mounts shall be installed between supporting structures and panels when specified. (h.) Non-free Standing Equipment (1.) Non-free standing local enclosures and cabinets shall be mounted in accessible locations on columns, walls, or stands in locations as indicated on the Employer's Plant Arrangement Drawings. Bracket and stands shall be fabricated as required to install the local enclosures and cabinets in a workman like manner. (2.) Rough edges and welds on all fabricated supports shall be ground smooth. The supports shall be finished with two coats of primer and two coats of paint as specified in this part. (i.) Equipment Location (1.) All individual items of equipment not located in cabinets or on panels and racks are located approximately according to the floor elevation and the nearest building column designated by the Employer. (2.) Solenoid valves not located in enclosures or mounted on valves shall be mounted in easily accessible protected locations near the components with which they are associated.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 41 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	(3.) All brackets, stands, supports and other miscellaneous hardware required for mounting devices shall be furnished and installed. (4.) Thermometers shall be installed in the process lines and ducts as required and adjusted for ease in reading. (5.) Permanent temperature wells on the main steam, hot reheat and cold reheat piping shall not be installed until steam blowing has been completed. Temporary temperature wells shall be installed in the main and reheat steam piping during steam blow and discarded after completion. (6.) Any required adapting hardware such as pipe bushings, nipples, drilled caps and the like shall be provided for complete installation of control devices into process connections. For location of C&I related equipment/devices, the requirement specified elsewhere in the technical specification may be referred. (j.) Installation of Field Mounted Instruments and Devices The Contractor shall submit installation drawings for all field mounted equipment furnished under this specification for Employer's approval. These drawings shall meet the requirements of this specification, installation drawings, applicable codes and standards and recommendations of manufacturers of instruments/devices. All installation work under this specification shall be strictly as per installation drawings approved by the Employer during detailed engineering stage. In addition to above relevant Portion as specified elsewhere in technical specification may be referred. (k.) Piping Connections (1.) All equipment having piping connections shall be levelled, aligned and wedged in place but shall not be grouted or bolted prior to the initial fitting and alignment of connecting piping. All equipment shall, however, be grouted or bolted to its foundation prior to final bolting or welding of the connection piping. (2.) All flanged joints shall be checked and retightened after approximately 10 days of operation at normal operating temperature. (l.) Equipment Checkout (1.) All equipment shall be cleaned after installation. Equipment subject to pressure differentials shall be checked for leakage. (2.) After erection, all equipment having moving parts, having electrical apparatus, or subject to pressure differentials shall be trial-operated.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 42 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT
53.00.00	एनडीपीसी NTPC (m.) Defects (1.) All defects in erection shall be corrected to the satisfaction of the Employer and the Project Manager. The dismantling and reassembly of Contractor furnished equipment to remove defective parts, replace parts, or make adjustments shall be included as a part of the work under these specifications. (2.) The removal of control and instrument equipment in order to allow bench calibration, if required, and the re-installation of the said equipment after calibration shall also be included as a part of the work under these specifications. (n.) Equipment Protection (1.) All equipment to be erected under these specifications shall be protected from damage of any kind from the time of contract award until commissioning of each unit. (2.) The equipment shall be protected during storage as described herein. (3.) Equipment shall be protected from weld spatter during construction. (4.) Suitable guards shall be provided for protection of personnel on all exposed rotating or moving machine parts. All such guards with necessary spares and accessories shall be designed for easy removal and maintenance. (5.) Equipment having glass components such as gauges, or equipment having other easily breakable components, shall be protected during the construction period with plywood enclosures or other suitable means. Broken, stolen, or lost components shall be replaced by the Contractor. (6.) Machine finished surfaces, polished surfaces, or other bare metal surfaces which are not to be painted, such as machinery shafts and couplings shall be provided temporary protection during storage and constructional periods by a coating of a suitable non- drying, oily type, rust preventive compound. WELDING - SPECIAL REQUIREMENTS If the manufacturer has special requirements relating to the welding procedures for welds at the terminals of the equipments to be performed under separate specifications, the requirements shall be submitted to the Project Manager in advance of commencement of erection work.
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9
PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 43 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT
54.00.00 55.00.00 56.00.00	DEVIATIONS DISPOSITIONING: Any deviation to the contract and employer approved documents shall be properly recorded in the format prescribed by NTPC. All the deviations shall be brought to the knowledge of employer's representative for suitable dispositioning. NON-DESTRUCTIVE TESTING (NDT): The contractor shall record results of NDTs carried out at site in the format acceptable to employer. All the radiographs & its report duly signed & correlated to the job shall be handed over to the employer. Sensitivity of all the test equipment shall be compatible to the job & acceptance norms agreed. TESTING EQUIPMENT & FACILITIES: Contractor shall provide the testing equipment and facilities necessary to carry out tests & inspections.
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9 PART-D ERECTION CONDITIONS OF CONTRACT PAGE 44 OF 53



CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			एनटीपीसी NTPC
	ANNEXURE-I			
	STANDARD CHECKLIST This is an indicative list of items. The actual list shall depend on the Equipment / System being supplied by the contractor. MECHANICAL VALVES 1. Manually Operated Valve 2. Electrically Operated Valve 3. Pneumatically Actuated Valve 4. Hydraulically Actuated Valve 5. Safety Valve 6. Electromatic Relief Valve 7. Steam Trap 8. Non Return Valve (including Hydraulic/ Pneumatic QCNRVS) 9. Control Valve 10. Relief Valve 11. Differential Pressure Regulating Valve 12. Pinch valve TANKS & PRESSURE VESSELS 1. Limestone silos 2. Gypsum storage silos 3. Limestone slurry tanks 4. Filtrate tank 5. Waste water tank			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 45 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT
	एनडीपीसी NTPC 6. Secondary hydrocyclone feed tank 7. Lime dosing tank 8. Process water tank 9. Absorber 10. Auxiliary absorbent tank 11. Mill circuit tank 12. Any other tank not covered above 13. Vacuum tanks 14. Air Receiver(if any) <u>PUMPS</u> 1. Slurry recirculation pumps 2. Gypsum bleed pumps 3. Limestone slurry pumps 4. Process water pumps 5. All other slurry pumps 6. Vacuum pumps 7. Sump pumps <u>PIPE WORK SYSTEM</u> 1. Steam services 2. Water services 3. Slurry services 4. Air services 5. Constant load support 6. Spring supports 7. Hangers and other Supports
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9 PART-D ERECTION CONDITIONS OF CONTRACT PAGE 46 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	3. Passenger cum goods elevator <u>POWER TRANSMISSION</u> 1. Power Transmission Gear Box 2. Bearings 3. Couplings <u>FGD & AUX.SYSTEM</u> 1. Agitators 2. Air Motor 3. Process trustle 4. Limestone feeder 5. Vacuum belt filter 6. Limestone ball mill 7. Limestone Hydrocyclones 8. Primary Hydrocyclones 9. Secondary Hydrocyclones 10. Absorber internals 11. Absorber Auxiliaries <u>ELELCTRICAL</u> 1. D.C. Motor 2. HV Squirrel Cage Induction Motor 3. 415 V Squirrel Cage Induction Motor 4. Motor Operated Actuators 5. Soot Blower (GGH) 6. Aux. Control and Relay Panel Desk 7. SWITCHGEARS/MCC			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 48 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			एनटीपीसी NTPC
	(I.) STANDARD CHECLISTS FOR ALL TYPES OF RELAYS USED IN SWITCHGEARS PROTECTION SYSTEM (II.) PT CARRIAGE AND CUBICLES (III.) CABLE/BUS DUCT/BUS BARS (IV.) CONTRACTOR MODULE (V.) SWITCH FUSE MODULE (VI.) MASTER PANEL OF LUBE OIL PANEL (VII.) FEEDER PANEL OF LUBE OIL PANEL (VIII.) SPACE HEATER AND CABLE MODULE (IX.) HT CIRCUIT BREAKER (X.) 415 V CIRCUIT BREAKER POWER CABLE AUXILIARY CABLE D.C. CABLE EXPLOSION PROOF ELECTRICAL EQUIPMENT JUNCTION BOX CONTROL TRANSFORMER MODULE BRUSH GEAR ASSEMBLY AUX. CONTROL AND RELAY PANEL DESK INDICATING INSTRUMENT RECORDING INSTRUMENT INTEGRATING INSTRUMENT <u>CONTROL & INSTRUMENTATION</u> 1. Conductivity Measuring Equipment Including Test Procedures 2. pH Analyser Including Test procedure			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 49 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनडीपीसी NTPC
	3. Silica Analyser 4. Level Switch (Float Actuated) 5. Level Switch (Electrode Type) 6. Level Switch (Displacer Actuated) 7. Transmitter (Float Operated Pneumatic Output including Testing procedures) 8. Level indicator (Float/Pulley Type) 9. Local Temperature Indicator Including Test Procedure 10. Resistance Thermometer Element Including Test procedure 11. Thermocouple Element and Connecting Cable 12. Thermocouple and Resistance Thermometer Convertor/Transmitter Including Test Procedures 13. Temperature Switch Including Test Procedure 14. Cold Junction Boxes 15. O₂Analyser 16. SO₂ analyzer 17. O₂ in Hydrogen including Test procedures 18. Pressure and Vacuum Gauge 19. Pressure and Vacuum Switch Including Test procedures 20. Differential Pressure Transmitter including Test Procedures 21. Differential pressure switch including Test procedures 22. Flow indicator (Variable Area) 23. Orifice plate 24. Flow Switch 25. Nozzle 26. Flow Integrator (pneumatic input) including test procedure	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT PAGE 50 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT	एनडीपीसी NTPC	
	27. Flow indicator (Float Operated) Including Test Procedure 28. Venturi (Fluid) 29. Flow Switch (Magnetic Type) 30. Limit Switches 31. Turbine Supervisory Measuring System 32. Position Measurement & Indication Including Test procedures 33. Vibration Measurement 34. Digital Indicator 35. Moving Coil Indicator Including Test Procedures 36. Recorder Including Test procedure 37. Flame Scanner 38. Electrical Auto Manual Control Station 39. Push Button Module 40. Test Procedure for Electronic Modules of DDCMIS 41. Alarm Annunciator Equipment Including Test Procedure 42. Test procedure for Adjustment of Modulating Controller-PID Term 43. Test Procedure Indicating Controller-Electrical Input & Pneumatic Output 44. Density monitors Note: The items which are not part of this specification may be considered as not applicable.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 51 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT 		
	ANNEXURE-II BRIEF WRITE UP ON THE CONTENTS OF TESTING SCHEDULE / COMMISSIONING SCHEDULE Testing Schedules should be designed to ensure that the plant area, equipment or apparatus are tested and commissioned and will operate as per the employer's specifications and good engineering practices. Testing Schedule/Commissioning Schedule is required to be of a standard format in order to maintain consistency of presentation, content and reporting. Testing Schedule/Commissioning Schedule should contain the following sections to make the document a self contained one: 1. Plant Details/Design data 2. Testing Objective/Proposals 3. State of the Plant a) Erection Status with respect to Mech. Elect and C&I b) Availability of the services required c) Safety requirements as per Manufacturer's 4. Test method including completion/acceptance criteria 5. Results 6. Appendix a) Testing Programme b) Mech/Elect/C&I -Plant item completing list c) List of Drawing/documents required for carrying out the testing.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT
			PAGE 52 OF 53

CLAUSE NO.	ERECTION CONDITIONS OF CONTRACT			
	ANNEXURE - III SAFETY PLAN 01. Safety Policy of the Contractor to be enclosed: 02. When was the Safety Policy last reviewed: 03. Details of implementation procedure / methods to implement Safety Policy / Safety Rules: 04. Name, Qualification, experience of Safety Officer 05. Review of Accidents Analysis Method, Methods to ensure Safety and Health: 06. Unit executive responsible to ensure Safety at various levels in work area: 07. List of employees trained in safety employed before execution of the job. Give the details of training: 08. Safety Training Targets, Schedules, methods Adopting to providing safety training to all employees: 09. Details of checklist for different jobs / work and responsible person to ensure compliance (copy of checklist to be enclosed): 10. Regular Safety Inspection Methods and Periodicity and list of members to be enclosed: 11. Risk Assessment, Safety Audit by Professional Agencies, Periodicity: 12. Implementation of Recommendations of Audit / Inspections. Procedures for implementation and follow up: 13. Provision for treatment of injured persons at work site: 14. Review of overall safety by top Management and Periodicity: 15. System for Implementation of Statutory legislations: 16. Issue of PPEs to employees, Periodicity / stock on hand etc: Signature Head of the Organisation with date & stamp			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO. CS-0011-109(4)-9	PART-D ERECTION CONDITIONS OF CONTRACT	PAGE 53 OF 53	

247927/2021/PS-PEM-MAX



4 X 250 MW NABINAGAR FGD
COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-463-555-A001

VOLUME: II B

SECTION : C2-C

REV. 00

DATE: Dec., 19

SHEET: 1 OF 1

SECTION: C2-C
PERFROMANCE GUARANTEE TESTS

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC	
	FUNCTIONAL GUARANTEES, LIQUIDATED DAMAGES FOR SHORTFALL IN PERFORMANCE AND PERFORMANCE GUARANTEE TESTS 1.00.00 GENERAL The term “Performance Guarantees” wherever appears in the Technical Specifications shall have the same meaning and shall be synonymous to “Functional Guarantees”. Similarly the term “Performance Tests” wherever appears in the Technical Specifications shall have the same meaning and shall be synonymous to “Guarantee Test(s)”. 2.00.00 PERFORMANCE GUARANTEES / PERFORMANCE TESTS 2.01.00 General Requirements 2.01.01 The Contractor shall guarantee that the equipment offered shall meet the ratings and performance requirements stipulated for various equipment covered in these specifications. 2.01.02 The guaranteed performance parameters furnished by the Bidder in his offer, shall be without any tolerance values whatsoever. All margins required for instrument inaccuracies and other uncertainties shall be deemed to have been included in the guaranteed figures. No tolerance or allowance on the test result will be permitted for instrument errors or inaccuracy, the method of testing or any other causes. 2.01.03 The Contractor shall conduct performance test and demonstrate all the guarantees covered herein. The various tests which are to be carried out during performance guarantee tests are listed in this Sub-section. The guarantee tests shall be conducted by the Contractor at site in presence of Employer on each unit individually. 2.01.04 All costs associated with the tests including cost associated with the supply, calibration, installation and removal of the test instrumentation shall be included in the contract price. 2.01.05 The performance tests shall be performed using only the normal number of Employer supplied operating staff. Contractor, vendor or other subcontractor personnel shall be used only for instructional purposes or data collection. At all times during the Performance Tests the emissions and effluents from the Plant shall not exceed the Guaranteed Emission and Effluent Limits. 2.01.06 It shall be responsibility of the Contractor to make the plant ready for the performance guarantee tests.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 1 OF 25

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
2.02.00	Test Instrumentation, Flow Measurement and their Calibration			
2.02.01	All instruments required for performance testing shall be of the type and accuracy required by the code and prior to the test, the Contractor shall get these instruments calibrated in an independent test Institute approved by the Employer and submit the same to Employer prior to commencement of test. All test instrumentation required for performance tests shall be supplied by the Contractor and shall be retained by him upon satisfactory completion of all such tests at site. All calibration procedures and standards shall be subject to the approval of the Employer prior to commencement of test. The protecting tubes, pressure connections and other test connections required for conducting guarantee test shall conform to the relevant codes. Tools and tackles, thermowells (both screwed and welded) instruments/devices including flow devices, matching flanges, impulse piping & valves etc. and any special equipment, required for the successful completion of the tests, shall be provided by the Contractor free of cost. The Performance test shall be carried out as per the agreed procedure. The detailed PG test procedure shall be submitted within 90 days of the date of Notification of Award and finalization of the PG test procedure shall be done within 180 days from the date of Notification of Award.			
2.02.02	The P&G test procedures shall be submitted for equipments/system & subsystem under Contractor's scope for all Guarantees as mentioned below, as per latest International codes / standard including correction curves, meeting the specification requirements along with sample calculations & detailed activity plan of preparation (including test instrumentation), conductance and evaluation of Guarantees.			
2.02.03	The Contractor shall submit for Employer's approval the detailed Performance Test procedure containing the following: (a) Object of the test. (b) Various guaranteed parameters & tests as per contract. (c) Method of conductance of test and test code. (d) Duration of test, frequency of readings & number of test runs. (e) Method of calculation. (f) Correction calculations & curves. (g) Instrument list consisting of range, accuracy, least count, and location of instruments.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 2 OF 25

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	
	(h) Scheme showing measurement points. (i) Sample calculation. (j) Acceptance criteria. (k) Any other information required for conducting the test.	
2.03.00	Test Reports After the conductance of Performance test, the Contractor shall submit the test evaluation report of Performance test results to Employer promptly but not later than one month from the date of conductance of Performance test. Preliminary test reports shall be submitted to the Employer after completing each test run. Four (4) hard copies and two (2) soft copies on CD-ROM of each test report of final conducted test on each equipment/plant/system shall be submitted to Employer for approval.	
2.03.01	Performance Guarantee Tests on the equipments/systems not covered in this Sub-section shall be carried out as per the procedure/test codes specified in respective detailed specifications.	
2.04.00	Acceptance of Guarantee Test Results (i) For Category-I Guarantees In case during performance guarantee test(s) it is found that the equipment/system has failed to meet the guarantees, the Contractor shall carry out all necessary modifications and/or replacements to make the equipment/system comply with the guaranteed requirements at no extra cost to the Employer and re-conduct the performance guarantee test(s) with Employer's consent. In case the specified performance guarantee(s) are still not met but are achieved within the Acceptable Shortfall Limit as specified at clause 3.00.00 of this sub-section, Employer will accept the equipment/system/plant after levying liquidated damages as per clause 3.00.00 of this sub-section. However, if, the demonstrated performance guarantee(s) continue to be beyond the stipulated Acceptable Shortfall Limit, even after the above modifications/replacements within ninety (90) days or a reasonable period allowed by the Employer, after the tests have been completed, the Employer will have the right to either of the following: Reject the equipment / system / plant and recover from the Contractor the payments already made OR	
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9
		SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES
		PAGE 3 OF 25

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	Accept the equipment /system/ plant after levying Liquidated Damages. The liquidated damages for shortfall in performance indicated in clause 3.00.00 of this sub-section shall be levied separately for each unit. The rates indicated in clause 3.00.00 of this sub-section are on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units where common absorber has been specified for two / three units based on scope of supply, LD values are applicable for combination of units as indicated in the clause 3.00.00 The liquidated damages shall be pro-rated for the fractional parts of the deficiencies. (ii) For Category-II Guarantees In case during performance guarantee test(s) it is found that the equipment/ system has failed to meet the guarantees, the Contractor shall carry out all necessary modifications and/or replacements to make the equipment/system comply with the guaranteed requirements at no extra cost to the Employer and re-conduct the performance guarantee test(s) with Employer's consent. In case the specified performance guarantee(s) are still not met even after the above modifications/replacements within ninety (90) days or a reasonable period allowed by the Employer, after the tests have been completed, the Employer will have the right to either of the following: Reject the equipment /system / plant and recover from the Contractor the payments already made. OR Accept the equipment/system after assessing the deficiency in respect of the various ratings, performance parameters and capabilities and recover from the contract price an amount equivalent to the damages as determined by the Employer. Such damages shall, however be limited to the cost of replacement of the equipment(s)/system(s), replacement of which shall remove the deficiency so as to achieve the guaranteed performance. These parameters/capacities shall be termed as "Category-II" Guarantees. 3.00.00 ~~AMOUNT OF LIQUIDATED DAMAGES (LD) APPLICABLE FOR GUARANTEES FOR EACH PROJECT~~ The rate of liquidated damages and acceptable ~~shortfall~~ limits for different guarantees shall be as under and such liquidated damages shall be ~~deducted~~ from the Contract Price of the project.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 4 OF 25	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
4.00.00 4.01.00	NOTES APPLICABLE FOR EACH PROJECT: i) Each of the liquidated damages specified above shall be independent and these liquidated damages shall be levied concurrently as applicable. ii) All these liquidated damages for short fall in performance shall be deducted from the contract price as detailed in accompanying General Conditions of Contract (GCC)/ Special Conditions of Contract (SCC) iii) Contractor's aggregate liability to pay Liquidated Damages (LD) for failure to attain the functional guarantee shall not exceed twenty five percent (25%) of the Contract Price. iv) The LD values are applicable on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units common absorber has been specified for two / three units based on scope of supply and LD values are applicable for combination of units as indicated in the clause 3.00.00 GUARANTEES PARAMETERS Guarantees Under Category-I The Performance Guarantees which attract Liquidated Damages (LD) are as follows: The following shall be guaranteed by the Bidder under guarantee point condition of Sub- Section-V, Part-A of section- VI: (i) SO₂ removal Efficiency The Contractor shall guarantee that SO₂ removal efficiency shall not be less than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (To be conducted as per the stipulation of Cl. no. 6.00.00 of this sub-section.) (ii) Limestone Consumption The Contractor shall guarantee that limestone consumption of FGD system in kg/hr shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (iii) Auxiliary Power Consumption The Contractor shall guarantee that total auxiliary power consumption for the unit in normal operation shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 16 OF 25	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
4.02.00	Sub-section-V, Part-A of Section-VI applicable for complete scope of work for the respective project), inline with the requirements stipulated in clause 5.00.00 of this Sub-Section. Guarantees Under Category-II The parameters/capabilities shall be demonstrated for various systems/equipments shall include but not limited to the following:- (i) Wet ball Mill capacity at rated fineness The contractor shall demonstrate the guaranteed capacity of each limestone pulverizer under the following conditions: i) Limestone Output fineness : 90% or higher (as per the requirement of the absorber) through 325 mesh (for spray tower process) (OR) 90% or higher (as per the requirement of the absorber) through 200 mesh (for bubbling process) ii) Limestone Quality : All available quality from the specified range. (ii) Wet ball Mill wear parts guarantee Contractor shall demonstrate the life of wet ball Mill wear parts in line with requirements stipulated in Part B of the Technical Specification. The establishment of the above guarantee shall be based on the operating records available at the Power station and will be computed for each pulverizer based on actual total hours of operation. (iii) Wet ball Mill ball consumption Contractor shall guarantee ball consumption per ton of limestone throughput in line with requirements stipulated in Part B of the Technical Specification. Contractor shall furnish the minimum ball diameter below which the balls shall be replaced. (iv) Vacuum Belt Filter Capacity Contractor shall demonstrate the Designed Capacity of the Vacuum Belt Filters to dewater the quantity of gypsum with the specified purity and moisture content as specified in Part B of the Technical Specification.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 17 OF 25	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES																																			
	(v) Gypsum Purity The contractor shall demonstrate that the purity of the gypsum produced shall not be less than 90%, chloride content shall not be more than 100ppm and the moisture content shall not be more than 10% for guarantee point condition. (vi) The contractor guarantees that the maximum purge rate to waste water treatment system shall not be more than 10 m3/hr for 500 MW unit and for combine 200 and 210 MW units shall not be more than as specified in the Table -1, averaged over a 24 hour period. Table-1 <table><tr><th>S.No</th><th>Project</th><th>Capacity (MW)</th><th>Concept</th><th>Waste water (m3/hr)</th></tr><tr><td rowspan="2">1.</td><td rowspan="2">FGUTPP St-I, II & III (2 X 210 + 2 X 210 + 1 X 210)</td><td rowspan="2">1050</td><td>Stage-I two units flue gas combined</td><td>8</td></tr><tr><td>Stage-II & III three units flue gas combined</td><td>12</td></tr><tr><td>2.</td><td>Farakka St-I (3 X 200)</td><td>600</td><td>Stage-I three units Flue gas combined</td><td>12</td></tr><tr><td>3.</td><td>Kahalgaon St-I (2 X 210)</td><td>420</td><td>Stage-I two units Flue gas combined</td><td>8</td></tr><tr><td>4.</td><td>Kahalgaon St-I (2 X 210)</td><td>420</td><td>Stage-I two units Flue gas combined</td><td>8</td></tr><tr><td rowspan="2">5.</td><td rowspan="2">Singrauli St-I (5 X 200)</td><td rowspan="2">1000</td><td>Stage-I two units Flue gas combined</td><td>8</td></tr><tr><td>Stage-I three units flue gas combined</td><td>12</td></tr></table> (vii) Performance characteristics of fans (capacity, head developed, etc.). (viii) Margins on fans in case Booster Fan is provided by the Contractor. Booster Fans - As specified in Part B of Technical Specifications (ix) Passenger cum Goods Elevator for FGD absorber & Limestone Grinding Building: Over load tests, travel and hoist speed checks. (x) Noise All the plant, equipment and systems covered under this specification shall perform continuously without exceeding the noise level over the entire range	S.No	Project	Capacity (MW)	Concept	Waste water (m3/hr)	1.	FGUTPP St-I, II & III (2 X 210 + 2 X 210 + 1 X 210)	1050	Stage-I two units flue gas combined	8	Stage-II & III three units flue gas combined	12	2.	Farakka St-I (3 X 200)	600	Stage-I three units Flue gas combined	12	3.	Kahalgaon St-I (2 X 210)	420	Stage-I two units Flue gas combined	8	4.	Kahalgaon St-I (2 X 210)	420	Stage-I two units Flue gas combined	8	5.	Singrauli St-I (5 X 200)	1000	Stage-I two units Flue gas combined	8	Stage-I three units flue gas combined	12	
S.No	Project	Capacity (MW)	Concept	Waste water (m3/hr)																																
1.	FGUTPP St-I, II & III (2 X 210 + 2 X 210 + 1 X 210)	1050	Stage-I two units flue gas combined	8																																
			Stage-II & III three units flue gas combined	12																																
2.	Farakka St-I (3 X 200)	600	Stage-I three units Flue gas combined	12																																
3.	Kahalgaon St-I (2 X 210)	420	Stage-I two units Flue gas combined	8																																
4.	Kahalgaon St-I (2 X 210)	420	Stage-I two units Flue gas combined	8																																
5.	Singrauli St-I (5 X 200)	1000	Stage-I two units Flue gas combined	8																																
			Stage-I three units flue gas combined	12																																
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 18 OF 25																																	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	of output and operating frequency specified in Part-C of Section-VI of the technical specifications. Noise level measurement shall be carried out using applicable and internationally acceptable standards. The measurement shall be carried out with a calibrated integrating sound level meter meeting the requirement of IEC 651 or BS 5969 or is 9779. Sound pressure shall be measured all around the equipment at a distance of 1.0 m horizontally from the nearest surface of any equipment/ machine and at a height of 1.5 m above the floor level in elevation. A minimum of 6 points around each equipment shall be covered for measurement. additional measurement points shall be considered based on the applicable standards and the size of the equipment. the measurement shall be done with slow response on the a - weighting scale. the average of a-weighted sound pressure level measurements expressed in decibels to a reference of 0.0002 micro bar shall not exceed the guaranteed value. corrections for background noise shall be considered in line with the applicable standards. all the necessary data for determining these corrections, in line with the applicable standards, shall be collected during the tests. (xi) Mist Outlet Droplet Content The mist eliminator outlet droplet content shall be guaranteed to be ≤ 20 mg/Nm³ at absorber outlet measured over a period of 24 hrs continuous operation. Mist outlet-droplet content shall be measured as per applicable clauses in VDI Norm 3679 and the Contractor shall carry out the tests as per the test procedure approved by the Employer. (xii) Availability of FGD Plant The Contractor shall guarantee the maximum availability of FGD Plant for the range of coal and limestone specified inline with the requirements stipulated in clause 7.00.00 of this Sub-Section (xiii) Air Conditioning System A. Following shall be demonstrated at Shop 1) Capacity and static pressure of AHU fans at its rated duty point. B. Following shall be demonstrated at Site 1) Capacity (TR) of air cooled condensing units (D-X type) for A/C system of FGD control room building.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 19 OF 25	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	2) Guaranteed room conditions during summer for all the Air conditioned areas. 3) Vibration and noise level of condensing units & centrifugal fans of AHUs. (xiv) Ventilation System A. Following shall be demonstrated at Shop 1) Capacity and discharge pressure of pumps of UAF units at its rated duty point of Ventilation system. 2) Capacity and static pressure of UAF fans at its rated duty point of Ventilation system. B. Following shall be demonstrated at Site 1) Vibration & Noise level of centrifugal fans & pumps of UAF units. (xv) Compressed Air System a) Following shall be demonstrated at shop: i) Capacity and discharge pressure of each air compressor. b) Following shall be demonstrated at site: ii) Dew point of air at the outlet of air drying plants of air compressor. iv) Pressure drop across air drying plant . v) Vibration and noise level of air compressors, blowers of air drying plant (if applicable) (xvi) Equipment Cooling Water System i) For pumps under ECW system -Vibration, noise and parallel operation without hunting & abnormal noise with flow sharing within 10% of each other at the rated duty point shall be demonstrated at site. ii) Heat transfer coefficient determining the performance under design heat load of plate type heat exchangers and Inlet & Outlet temperatures of the Plate type heat exchangers on the primary and secondary side to be demonstrated at site. Pressure drop across the Plate type heat exchanger on the primary & secondary water circuit to be demonstrated at site. (xvii) Limestone Handling System and Gypsum Handling System a) Limestone Handling Plant (i) The Bidder shall demonstrate the unloading at truck tippler, crushing and conveying to storage shed/silo and then reclaim from storage shed/silos and conveying to mill bunker at the guaranteed capacity including all intermediate equipment & conveyors.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(4)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 20 OF 25

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C2-D

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C2-D
QUALITY ASSURANCE

Introduction to the Quality Assurance Specification:

For fulfilment of the relevant clauses (regarding Testing,Inspection etc.) of the General Conditions of Contract and General Technical Requirements of Contract, the Quality Assurance Specification acts as a part of the Technical Specification and is included in the Contract.

This part of the Technical Specification shall be read in conjunction with other parts of the technical specifications, General Technical Requirements and Erection Conditions of the Contract.

This document specifies the quality requirements, to be detailed in terms of Tests/Checks/Procedures to be followed at the times of manufacturing,Testing, Inspection and also during installation of various Equipment / Components at the place of manufacturer and / or on the site.

Various standards referred in this document shall be the latest revisions.

The quality requirements are spelt out in the following ways;

- 1) Through description
- 2) In tabular form

In either of the above two formats the tests /checks / procedures that are required to be performed are mentioned against particular item/ equipment/ component/ system etc.

This specification also contains the Indicative vendor list (with disclaimer) mentioned against particular item/ equipment/ component/ system etc.

The quality requirements specified in this document and also the vendor list are only indicative and not exhaustive.

ZIPS-PEM-MAX		QUALITY ASSURANCE		एनटीपीसी NTPC	
1.00.00	<u>AIR COMPRESSOR SYSTEM</u>				
1.01.00	AIR COMPRESSORS:				
	a) All pressure parts shall be hydraulically tested at not less than 150% of design pressure prior to painting and lining, if applicable. The test pressure will be maintained for 30 minutes. b) All other parts including inter-connecting piping shall be hydraulically tested wherever possible, as per relevant codes. c) Ultrasonic testing shall be carried out on all forgings and shafts (if dia.> 40mm). MPI/DP test will be done on machined areas of the above components. e) Rotor shall be statically and dynamically balanced.				
1.01.01	PERFORMANCE TEST (SHOP TEST) :				
	a) Performance test on the compressors shall be carried out in accordance relevant standard. The test shall also include demonstration of loading and unloading mechanism (Capacity control) and operation of safety valves. b) Power consumption at motor input terminal at rated capacity as well as at fully unloaded condition of all the compressor shall be measured. c) Vibration and noise level measurement will be done during shop performance test. d) Test shall be carried out on all compressors with contract drive motor where power consumption for compressors has been indicated as a guaranteed parameter				
1.02.00	AIR RECEIVER, HEAT EXCHANGERS, MOISTURE SEPERATORS, AIR DRYING PLANT:				
	a) Each finished vessel shall be hydraulically tested to 150% of the design pressure for a duration of 30 minutes. b) NDT on weld joints shall be as per respective code requirements or the minimum as specified below: (i) 100 % DPT on root run of butt welds. (ii) 100% DPT on all finished butt welds and fillet welds (iii) 10% RT on butt welds which shall include all T- joints. c) Tube to Tube sheet joint of the heat exchangers shall be subject to Mock-up test as per the relevant standards.				
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9		PART-B SUB-SECTION –V-QM5 COMPRESSED AIR SYSTEM	
				Page 1 of 2	

ZIPS-PEM-MAX			
CLAUSE NO.	QUALITY ASSURANCE	एनटीपीसी NTPC	
	d) Reactivation blowers shall be tested for FAD, temp. rise noise & vibration. Rotating parts shall be dynamically balanced. e) Completely assembled ADP shall be pneumatically tested at design pressure for a duration of 5 minutes. Functional and sequential operation testing of the completely assembled ADP shall be demonstrated at shop. Other accessories shall be tested as per relevant code and sections. Dew point measurement shall be done.		
1.04.00	~~E.O.T. CRANE:~~ ~~a) Chain pulley Blocks shall be tested as per IS: 3832.~~ ~~b) Following NDT requirements shall be met:~~ ~~(i) 100% RT of Butt welds in tension and 10% RT of butt welds in compression.~~ ~~(ii) DP at random on all weldments.~~ ~~Deflection, load, overload & travel check on HOT crane assembly shall be carried out as per IS: 3177.~~		
1.05.00	PIPINGS, VALVES, AND FITTINGS a. All pipes and fittings shall be tested as per applicable code. b. All valves shall be hydraulically tested for body, seat and back-seat (if applicable) as per relevant standard. Check valves shall also be tested for leak tightness test at 25% of the specified seat test pressure. c. Valves shall be offered for hydro test in unpainted condition. d. Functional checks of the valves for smooth opening and closing shall also be done. All bar stocks/ forgings, dia ≥ 40 mm shall be Ultrasonic Tested irrespective of the type, size & rating of the valve.		
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION –V-QM5 COMPRESSED AIR SYSTEM
			Page 2 of 2

CLAUSE NO.		QUALITY ASSURANCE																	
MOTOR																			
TESTS/CHECKS TEMS/COMPONENTS	Visual	Dimensional	Make/Type/Rating Physical Inspection	Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034\IEC 60079-1/ IS-12615	vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
	Plates for stator frame, end shield, spider etc.	Y	Y	Y	Y	Y			Y										
	Shaft	Y	Y	Y	Y	Y	Y		Y										
	Magnetic Material	Y	Y	Y	Y			Y		Y		Y							
	Rotor Copper/Aluminium	Y	Y	Y	Y			Y	Y										
	Stator copper	Y	Y	Y	Y			Y	Y			Y							
	SC Ring	Y	Y	Y	Y	Y		Y	Y			Y							
	Insulating Material	Y		Y	Y			Y					Y						
	Tubes, for Cooler	Y	Y	Y	Y	Y				Y		Y							
	Sleeve Bearing	Y	Y	Y	Y	Y				Y		Y							
	Stator/Rotor, Exciter Coils	Y	Y	Y				Y	Y										
	Castings, stator frame, terminal box and bearing housing etc.	Y	Y	Y	Y	Y			Y										
	Fabrication & machining of stator, rotor, terminal box	Y	Y			Y			Y	Y									
	LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE					TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9					PART-B SUB-SECTION-V-QE1 MOTORS					PAGE 1 OF 2			

CLAUSE NO.		QUALITY ASSURANCE																			
Wound stator		Y	Y					Y	Y												
Wound Exciter		Y	Y					Y	Y												
Rotor complete		Y	Y					Y						Y	Y						
Exciter, Stator, Rotor, Terminal Box assembly		Y	Y					Y													
Accessories, RTD, BTDC, CT, Space heater, antifriction bearing, gaskets etc.		Y	Y	Y																	
Complete Motor		Y	Y	Y											Y		Y	Y	Y1	Y	
Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, following methodology to be followed for Inspection Categorisation: a) Up to 50 KW: Cat-III: Acceptance of Motor up to 50 KW is based on COC of the manufacturer & the Main Contractor confirm specifications. b.i) Above 50 KW and up to 75KW: Cat-III : For manufacturers who have already supplied this range of motors to NTPC which have had no adverse feedback has been reported from RIO/project-site AND for skid mounted motor supplied with the driven equipment. Acceptance of Routine Test Inspection report as per IS-325 along with COC of the Manufacturer and Main Contractor confirming NTPC's technical specifications. b.ii) Above 50 KW and up to 75KW: Cat-I: For Other Manufacturers, as per NTPC approved Quality Plan c) Above 75 KW: Cat-I: as per NTPC approved Quality Plan 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard 3. Makes of major bought out items for HT motors will be subject to NTPC approval. 4. Y1 = for HT Motor / Machines only.																					
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE							TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(4)-9							PART-B SUB-SECTION-V-QE1 MOTORS				PAGE 2 OF 2			

CLAUSE NO.	TECHNICAL REQUIREMENTS 
	TYPE TEST REQUIREMENTS
1.00.00	TYPE TEST REQUIREMENTS
1.01.00	General Requirements
1.01.01	The Contractor shall furnish the type test reports of all type tests as per relevant standards and codes as well as other specific tests indicated in this specification. A list of such tests are given for various equipment in table titled 'TYPE TEST REQUIREMENT FOR C&I SYSTEMS' at the end of this chapter and under the item Special Requirement for Solid State Equipments/Systems. For the balance equipment instrument, type tests may be conducted as per manufactures standard or if required by relevant standard. (a) Out of the tests listed, the Bidder/ sub-vendor/ manufacturer is required to conduct certain type tests specifically for this contract (and witnessed by Employer or his authorized representative) even if the same had been conducted earlier, as clearly indicated subsequently against such tests. (b) For the rest, submission of type test results and certificate shall be acceptable provided. i. The same has been carried out by the Bidder/ sub-vendor on exactly the same model /rating of equipment. ii. There has been no change in the components from the offered equipment & tested equipment. iii. The test has been carried out as per the latest standards alongwith amendments as on the date of Bid opening but not more than five (5) year back. (c) In case the approved equipment is different from the one on which the type test had been conducted earlier or any of the above grounds, then the tests have to be repeated and the cost of such tests shall be borne by the Bidder/ sub-vendor within the quoted price and no extra cost will be payable by the Employer on this account.
1.01.02	As mentioned against certain items, the test certificates for some of the items shall be reviewed and approved by the main Bidder or his authorized representative and the balance have to be approved by the Employer.
1.01.03	The schedule of conduction of type tests/ submission of reports shall be submitted and finalized during pre-award discussion.

CLAUSE NO.	TECHNICAL REQUIREMENTS 
1.01.04	For the type tests to be conducted, Contractor shall submit detailed test procedure for approval by Employer. This shall clearly specify test setup, instruments to be used, procedure, acceptance norms (wherever applicable), recording of different parameters, interval of recording precautions to be taken etc. for the tests to be carried out.
1.01.05	The Bidder shall indicate in the relevant BPS schedule, the cost of the type test for each item only for which type tests are to be conducted specifically for this project. The cost shall only be payable after conduction of the respective test in presence of authorize representative of Employer. If a test is waived off, then the cost shall not be payable.
2.00.00	SPECIAL REQUIREMENT FOR SOLID STATE EQUIPMENTS/ SYSTEMS
2.01.00	The minimum type test reports, over and above the requirements of above clause, which are to be submitted for each of the major C&I systems Analyzer instruments, various PLCs etc. shall be as indicated below: i) Surge Protections for Solid State Equipments/ Systems All solid state systems/ equipments shall be able to withstand the electrical noise and surges as encountered in actual service conditions and inherent in a power plant. All the solid state systems/ equipments shall be provided with all required protections that needs the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Hence, all front end cards which receive external signals like Analog input & output modules, Binary input & output modules etc. including power supply, data highway, data links shall be provided with protections that meets the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Complete details of the features incorporated in electronics systems to meet this requirement, the relevant tests carried out, the test certificates etc. shall be submitted alongwith the proposal. As an alternative to above, suitable class of IEC-60255-4 which is equivalent to ANSI 37.90a/ IEEE-472 may also be adopted for SWC test. ii) Dry Heat test as per IEC-68-2-2 or equivalent. iii) Damp Heat test as per IEC-68-2-3 or equivalent. iv) Vibration test as per IEC-68-2-6 or equivalent. v) Electrostatic discharge tests as per IEC 61000-4-2 or equivalent. vi) Radio frequency immunity test as per EN 50082-2 or equivalent.

CLAUSE NO.	TECHNICAL REQUIREMENTS
	The logo of NTPC (National Thermal Power Corporation) is located in the top right corner of the table header. It consists of a square frame containing the letters 'NTPC' in a bold, sans-serif font, with a stylized flame or sun-like symbol above the letters. vii) Electromagnetic immunity as per EN 61131-2 or equivalent. Test listed at item no. v, vi, vii, above are applicable for front end cards only as defined under item (i) above.

3.00.00 TYPE TEST REQUIREMENT FOR C&I SYSTEMS

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
1	Elect. Metering instruments	As per standard (col 4)	IS-1248	No	Yes	
2	Electronic transmitter	As per standard (col 4)	BS-6447 / IEC-60770	No	Yes	
3	INSTRUMENTATION CABLES TWISTED & SHIELDED			No	Yes	
4	Pressure gauge	Degree of protection test	IS-2147	No	No	
		Temp interference test	IS -3624	No	No	
5	Temperature gauge	Degree of protection test	IS-2147	No	No	
6	Pressure & DP switch	Degree of protection test	IS-2147	No	No	
		As per standard (col 4)	BS 6134	No	No	
7	Level switch	Degree of protection test	IS-2147	No	No	
8	Control valves	CV Test	ISA 75.02	No	Yes	
9	Flow Nozzles & Orifice plate	Calibration	ASME PTC , BS 1042	No	Yes	
10	PLCs	All tests as per IEC-1131	IEC-601131	No	Yes	

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
11	Junction Box	Degree of protection test	IS-13947	No	Yes	
12	Battery charger (Not required for inbuilt chargers)	Degree of protection test	IS-13947	No	No	
		Short circuit current capability	IEC-60146-2	No	Yes	
		Temp rise test without redundant fans	Approved procedure, IEC 60146-2	No	Yes	
		SWC test	Approved procedure	No	Yes	
		Burn-in-test	Approved procedure	No	Yes	
		Efficiency	IEC-60146-2,	No	Yes	
		Audible Noise Test	IEC 60146-2	No	Yes	
		Fuse Clearing Capability	Approved procedure	No	Yes	
		Relative harmonic content	Approved procedure	No	Yes	

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		ESD immunity test	IEC-61000-4-2-9(1)	No	Yes	
		Radio interference	IEC 60146-2	No	Yes	
		Over Load Test on Inverter & charger	Approved procedure	No	Yes	
		Restart Test	IEC 60146-2	No	Yes	
		Output voltage tolerance	Approved	No	Yes	
		Output voltage Harmonic content	Approved procedure	No	Yes	
		Insulation test	IEC 60146	No	Yes	
		Load Tests	Approved procedure	No	Yes	
		Preliminary light load test	IEC 60146	No	Yes	
		Current division / Voltage division	IEC 60146-2	No	Yes	
13	Battery	As per standard (col 4)	IEC –623 / IS 10918 for Ni-Cd IS-1652 for Plante Lead Acid	No	Yes	
14	Voltage stabilizers	Over Load Test	Approved procedure	No	Yes	

Sl No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		Temp rise test without redundant fans	Approved procedure	No	Yes	

CLAUSe NO.	QUALITY ASSURANCE & INSPECTION	एनटीपीसी NTPC
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)		
TESTS		
ITEMS	Dimensions (R)	Make, Model, Type, Rating (R)
	Process / Electrical connection (R)	Calibration (R)
	Test as per standard (R)	Insulation Resistance (R)
	IBR Certification (if applicable) (R)	Hydro Test (R)
	Material Test certificate ®	
1. PR Gauge (IS-3624)	Y	Y
2. Temp. Gauge (BS-5235)	Y	Y
3. Pr./D.P.Switch (BS-6134)	Y	Y
4. Electronic Transmitter (IEC-60770)	Y	Y
5. Temp. Switch	Y	Y
6. Recorder (IS-9319/ANSI C-39.4)	Y	Y
7. Vertical indicators	Y	Y
8. Digital Indicators	Y	Y
9. Integrators	Y	Y
10. Electrical Metering Instrument (IS-1248)	Y	Y
11. Transducer (IEC-688)	Y	Y
12. Thermocouples (IEC – 754 / ANSI-MC-96.1)	Y	Y
13. RTD (IEC-751)	Y	Y
14. Thermowell	Y	Y
R-Routine Test A- Acceptance Test Y – Test applicable		
: Note: 1) Detailed procedure of Environmental Stress Screening shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization		
2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.		

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION												
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)													
TESTS ITEMS		Dimensions (R)	Make, Model, Type, Rating (R)	Process / Electrical connection (R)	Calibration (R)	Requirement as per standard (R)	WPS approval (A)	Non-destructive testing (R)	Calculation for accuracy (R)	Insulation Resistance (R)	IBR Certification as applicable (R)	Hydro test (R)	Material test certificate (A)
15. Cold junction compensation box		Y	Y	Y	Y					Y			
16. Orifice plate(BS-1042)		Y	Y	Y	Y	Y	Y	Y			Y	Y	Y
					*		**	**				**	
17. Flow nozzle(BS-1042)		Y	Y	Y	Y	Y	Y	Y			Y	Y	Y
					*								
18. Impact head type element		Y	Y	Y					Y				Y
19. Level transmitter/float type switch		Y	Y	Y	Y					Y	Y	Y	Y
20. Analysers		Y	Y	Y	Y								
21. Dust emission monitors		Y	Y	Y	Y								
*Calibration to be carried out on one flow element of each type and size if calibration carried out as type test same shall not be repeated.													
** If applicable													
R-Routine Test		A- Acceptance Test				Y – Test applicable							
Note: 1) Detailed procedure of Environmental Stress screening test shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization													
2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.													

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION															एनटीपीसी NTPC		
Process, Connection & piping FOR C&I SYSTEMS																		
ITEMS	TESTS	Visual ®	GA, BOM, Layout of component & construction feature®	Dimension ®	Paint Shade/thickness ®	Flattening, flaring, hydrotest, hardness check as per ASTM standard	Component Ratings ®	Wiring ®	Make, Model, Type, Rating®	IR & HV ®	Review of TC for instrument/devices (R)	Accessibility of TBs/Devices ®	Illumination/grounding ®	Tubing ®	Leak/Hydro test(A)	Chemical/physical properties of material (A)	Proof pressure test,Dismantling & reassembly test,Hydraulic impulse and vibration test (R)	Tests as per standards & specification
Local Instrument enclosure		Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Local instruments racks		Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Junction Box		Y	Y	Y	Y	*	Y		Y	Y								
Gauge Board		Y	Y	Y	Y		Y		Y		Y			Y	Y			
Impulse pipes and tubes		Y		Y		Y			Y							Y		
Socket weld fittings ANSI B-16.11		Y		Y					Y							Y		Y
Compression fittings		Y		Y					Y						Y	Y	Y	
Instrument valves & Valve manifolds		Y		Y					Y						Y	Y		
Copper tubings ASTM B75		Y							Y									Y
*-applicable for painted junction boxes.																		
Note: R-Routine Test A- Acceptance Test Y – Test applicable																		
Note: This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted alongwith relevant supporting documents.																		

CLAUSE NO.		QUALITY ASSURANCE & INSPECTION														एनटीपीसी NTPC	
INSTRUMENTATION CABLE																	
ITEMS	TESTS	Conductor Resistance ® & (A)	High Voltage ® & (A)	Insulation Resistance ® & (A)	Constructional detail, dimensions (A)	Outer-Sheath/core marking, end sealing (A)	Thermal Stability (A) +	Visual, Surface finish (A) +	Electrical Parameters ** (A) +	Persulphate Test (A) +	Overall/Coverage/Continuity (A)	Swidesh chimney Test (SS-4241475) (A) ++	FRLS Test * (A) ++	Tensile & Elongation before & after aging (A) ++	Vol. Resistivity. at room & Elevated Temp. (A) ++	Spark test report review ®	
1. Instrument cable twisted and shielded																	
Conductor(IS-8130)		Y			Y			Y									
Insulation(VDE-207)					Y	Y	Y	Y						Y		Y	
Pairing/Twisting					Y	Y		Y									
Shielding					Y			Y			Y						
Drain wire		Y			Y			Y		Y	Y						
Inner Sheath					Y	Y	Y	Y					Y	Y			
Outer Sheath					Y	Y	Y	Y					Y	Y			
Over all cable		Y	Y	Y	Y	Y		Y	Y			Y				Y	
Cable Drums(IS-10418)					Y			Y									
Note : High Temp. cables shall be subjected to tests as per VDE-207(Part-6) Compensating cables shall be checked for Thermal EMF/Endurance test as per IS 8784. Note : This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating his practice & Procedure along with relevant supporting documents during QP finalization for all items. Note : ® - Routine Test A - Acceptance Test Y - Test Applicable Note : Sampling Plan for Acceptance test shall be as per IS 8784 (As applicable) • * FRLS Tests: Oxygen / Temp Index (ASTM D-2863), Smoke Density Rating (ASTM – D 2843), HCL Emission (IEC-754-1) • ** Characteristic Impedance, Attenuation, Mutual Capacitance, Cross Talk (As applicable) + Sample size will be One No. of each size/type per lot. ++ Sample size will be One No. sample for complete lot offered irrespective of size/type.																	

MANUFACTURE'S NAME & ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT							
				ITEM : BALL VALVE		QP NO.		CONTRACT NO.							
				P.O. NO. :		REV. NO. :		DATE :		END USER :					
				P.O. DATE :		W.O. NO. :		CONTRACTOR : BHARAT HEAVY ELECTRICAL LIMITED							
				PAGE : 1 OF 1											
SL. NO.	COMPONENTS & OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE NORMS	FORMATS OF RECORDS		AGENCY			REMARKS	
					M	C/N					M	C	N		
1.0	MATERIALS														
1.1	BODY, END PIECES, BALL & FASTNERS	Chemical Composition	Critical	Chemical Testing	One /Heat	One / Heat	Appd /Drgs Tech Spec	Appd Drgs / DS/MFG STD	Foundry TC	√	P	V	V		
		Mechanical Properties	Critical	Mechanical Testing	One / Heat / Heat Treatment Batch			-	-	Foundry TC	√	P	V	V	
		Heat Treatment (Only For Casting)	Critical	Heat treatment	100%	100%	-	-	Report	√	P	V	V		
		Surface Defects	Major	Visual	100%	100%	MSS -SP-55	MSS-SP-55	Inspection report	-	P	-	-		
1.2	BALL, STEM AND GLAND (BAR STOCK)	Chemical Composition	Critical	Chemical Testing	One /Heat	One / Heat	ASTM STD	ASTM STD	Foundry TC & Lab Reports	√	P	V	V		
		Mechanical Properties	Critical	Mechanical Testing	One / Heat / Batch	One / Heat / Batch	ASTM STD	ASTM STD	Foundry TC & Lab Reports	√	P	V	V		
	STEM	Ultrasonic Test for Stem	Critical	Ultrasonic Test	100%	100%	ASTM B 16.34	ASTM B 16.34 & ASME B 16.34 ANNEXURE E	UT REPORT	√	P	V	V	For dia>50mm above only.	
1.3	Body Seat & Seal (as applicable)	Hardness	Critical	Hardness Test	100%	100%	Tech. Spec/Applicable Std	Tech. Spec. / Applicable Std	Test Certificate	√	P	V	V		
1.4	QT	Functional port leakage test	Major	Review of Manufacturer TC	100%	100%	Apprd. Drg/DS/Mfg	Apprd. Drg / DS / Mfg Std.	Test Certificate	√	P	V	V		
2.0	INPROCESS INSPECTION														
2.1	MACHINING OF BODY, END PIECES, BALL & STEM	Dimension	Major	Measurement	100%	100%	Mfg Drgs	Mfg Drgs	Inspection report	√	P	V	-		
2.2	Ball & Seat	Blue Matching (For Metal Seat)	Critical	Visual	100%	100%	The Surface shall be smooth and shall have uniform contact with seating surface.		IR	√	-	P	-		
3.0	ASSEMBLY	Dimension	Major	Measurement	10%	10%	Appd Drgs	Appd Drgs	-	√	P	V	V		
4.0	TESTING														
4.1	SHELL	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS / Ref. standard	No Leakage	Test Certificate	√	P	W	W		
4.2	HYDRO SEAT	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS / Ref. standard	No Leakage	Test Certificate	√	P	W	W		
4.3	PNEUMATIC SEAT	Leakage	Critical	Air Pressure	100%	10%	Approved Drawings / DS / Ref. standard	No Leakage	Test Certificate	√	P	W	W		
4.4	PERFORMANCE / FUNCTIONAL CHECK	Operation (Opening & Closing)	Major	Visual	100%	10%	Drawing & Technical Spec.	Smooth Operation	Inspection report	√	P	W	W		
5.0	FINAL INSPECTION	Cleanliness Completeness &	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	√	P	V	V		
5.1	PAINTING	DFT CHECK	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	√	P	V	V		
6.0	PROVISION OF NAME PLATE	As Per Spec	Major	Visual	As per Specification	As per Specification	As per Specification	As per Specification	Inspection report	-	P	V	V		
NOTE:- SS.PARTS SHALL BE CHECKED AT 10% POSITIVE MATERIAL IDENTIFICATION (PMI) GRADE ANALYSER															
MANUFACTURER/SUB-SUPPLIER/MAIN SUPPLIER SIGNATURE				LEGEND: *RECORDS IDENTIFIED WITH TICK(*) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. M: MANUFACTURER / SUB-SUPPLIER C: MAIN SUPPLIER N: END USER & BHEL P: PERFORMANCE W: WITNESS V: VERIFICATION AS APPROPRIATE				DOC. NO. :							
								REVIEWED BY		APPROVED BY		APPROVAL SEAL			

MANUFACTURE'S NAME & ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT							
ITEM : CHECK VALVE				ACIQP NO. :				CONTRACT NO. :							
P.O.NO. :				REV.NO. : DATE :				END USER :							
P.O. DATE :				W.O. NO. :				CONTRACTOR : BHARAT HEAVY ELECTRICAL LIMITED							
PAGE : 1 OF 1															
SL. NO.	COMPONENTS & OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE NORMS	FORMATS OF RECORDS	AGENCY			REMARKS		
					M	C/N					M	C	N		
1.0	MATERIALS														
1.1	BODY, COVER, DISC, SEATRING & FASTNERS	Chemical Composition	Critical	Chemical Testing	One / Heat	One / Heat	Appd./Drgs Tech Spec	Appd Drgs / DS/MFG STD.	Foundry TC	✓	P	V	V		
Mechanical Properties		Critical	Mechanical Testing	One / Heat / Heat Treatment Batch			-	-	Foundry TC	✓	P	V	V		
Heat Treatment (Only For Casting)		Critical	Heat treatment	100%	100%			-	-	Report	✓	P	V	V	
Surface Defects		Major	Visual	100%	100%	MSS-SP-55	MSS-SP-55	Inspection report	-	P	-	-	-		
1.2	HINGE PIN (BAR STOCK)	Chemical Composition	Critical	Chemical Testing	One / Heat	One / Heat	ASTM STD	ASTM STD	Foundry TC & Lab Reports	✓	P	V	V		
Mechanical Properties		Critical	Mechanical Testing	One / Heat / Batch	One / Heat / Batch	ASTM STD	ASTM STD	Foundry TC & Lab Reports	✓	P	V	V			
	HINGE PIN	Ultrasonic Test for Stern	Critical	Ultrasonic Test	100%	100%	ASTM B 16.34	ASTM B 16.34 & ASME B 16.34 ANNEXURE E	UT REPORT	✓	P	V	V	For dia>50mm above only.	
2.0	INPROCESS INSPECTION														
2.1	MACHINING OF BODY, COVER, DISC	Dimension	Major	Measument	100%	100%	Mfg Drgs	Mfg Drgs	Inspection report	✓	P	V	-		
2.2	DISC & SEATRING	Blue Matching (For Metal Seat)	Critical	Visual	100%	100%	The Surface shall be smooth and shall have uniform contact with seating surface.		IR	✓	-	P	-		
3.0	ASSEMBLY	Dimension	Major	Measument	10%	10%	Appd Drgs	Appd Drgs	-	✓	P	V	V		
4.0	TESTING														
4.1	SHELL	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref.standard	No Leakage	Test Certificate	✓	P	W	V		
4.2	HYDRO SEAT	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref.standard	No Leakage	Test Certificate	✓	P	W	V		
5.0	FINAL INSPECTION	Cleanliness Completeness &	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	✓	P	V	V		
5.1	PAINTING	DFT CHECK	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	✓	P	V	V		
6.0	PROVISION OF NAME PLATE	As Per Spec	Major	Visual	As per Specification	As per Specification	As per Specification	As per Specification	Inspection report	-	P	V	V		
NOTE:- SS PARTS SHALL BE CHECKED AT 10% POSITIVE MATERIAL IDENTIFICATION (PMI) GRADE ANALYSER															
MANUFACTURER/SUB-SUPPLIER		MAIN SUPPLIER		LEGEND: *RECORDS, IDENTIFIED WITH TICK(*) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. M : MANUFACTURER / SUB-SUPPLIER C : MAIN SUPPLIER N : END USER & BHEL P : PERFORMANCE W : WITNESS V : VERIFICATION AS APPROPRIATE				DOC. NO. :							
SIGNATURE								REVIEWED BY			APPROVED BY			APPROVAL SEAL	

MANUFACTURE'S NAME & ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT									
				ITEM : GATE VALVE		ACILQP NO. :		CONTRACT NO. :									
				P.O.NO. :		REV.NO. :		DATE :		END USER :							
				P.O. DATE :		W.O. NO. :				CONTRACTOR : BHARAT HEAVY ELECTRICAL LIMITED							
						PAGE : 1 OF 1											
SL. NO.	COMPONENTS & OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE NORMS	FORMATS OF RECORDS			AGENCY			REMARKS		
					M	C/N							M	C	N		
1.0	MATERIALS																
1.1	BODY, BONNET, WEDGE, SEATRING & FASTNERS	Chemical Composition	Critical	Chemical Testing	One / Heat	One / Heat	Appd /Drgs Tech Spec	Appd Drgs / DS/MFG STD	Foundry TC	√	P	V	V				
Mechanical Properties		Critical	Mechanical Testing	One / Heat / Heat Treatment Batch			-	-	Foundry TC	√	P	V	V				
Heat Treatment (Only For Casting)		Critical	Heat treatment	100%	100%			-	-	Report	√	P	V	V			
Surface Defects		Major		Visual	100%	100%	MSS-SP-55	MSS-SP-55	Inspection report	-	P	-	-				
1.2	STEM AND GLAND (BAR STOCK)	Chemical Composition	Critical	Chemical Testing	One /Heat	One / Heat	ASTM STD	ASTM STD	Foundry TC & Lab Reports	√	P	V	V				
Mechanical Properties		Critical	Mechanical Testing	One / Heat / Batch	One / Heat / Batch	ASTM STD	ASTM STD	Foundry TC & Lab Reports	√	P	V	V					
	STEM	Ultrasonic Test for Stem	Critical	Ultrasonic Test	100%	100%	ASTM B 16.34	ASTM B 16.34 & ASME B 16.34 ANNEXURE E	UT REPORT	√	P	V	V			For dia>50mm above only.	
2.0	INPROCESS INSPECTION																
2.1	MACHINING OF BODY, BONNET, WEDGE & STEM	Dimension	Major	Measument	100%	100%	Mfg Drgs	Mfg Drgs	Inspection report	√	P	V	-				
2.2	WEDGE & SEATRING	Blue Matching (For Metal Seat)	Critical	Visual	100%	100%	The Surface shall be smooth and shall have uniform contact with seating surface.		IR	√	-	P	-				
3.0	ASSEMBLY	Dimension	Major	Measument	10%	10%	Appd Drgs	Appd Drgs	-	√	P	V	V				
4.0	TESTING																
4.1	SHELL	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref.standard	No Leakage	Test Certificate	√	P	W	V				
4.2	HYDRO SEAT	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref.standard	No Leakage	Test Certificate	√	P	W	V				
4.3	PNEUMATIC SEAT	Leakage	Critical	Air Pressure	100%	10%	Approved Drawings / DS/ Ref.standard	No Leakage	Test Certificate	√	P	W	V				
4.4	PERFORMANCE / FUNCTIONAL CHECK	Operation (Opening & Closing)	Major	Visual	100%	10%	Drawing & Techical Spec.	Smooth Operation	Inspection report	√	P	W	V				
5.0	FINAL INSPECTION	Cleanliness Completeness &	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	√	P	V	V				
5.1	PAINTING	DFT CHECK	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	√	P	V	V				
6.0	PROVISION OF NAME PLATE	As Per Spec	Major	Visual	As per Specification	As per Specification	As per Specification	As per Specification	Inspection report	-	P	V	V				
NOTE:- SS PARTS SHALL BE CHECKED AT 10% POSITIVE MATERIAL IDENTIFICATION (PMI) GRADE ANALYSER																	
MANUFACTURER/SUB-SUPPLIER				MAIN SUPPLIER		LEGEND: *RECORDS IDENTIFIED WITH TICK(*) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. M : MANUFACTURER / SUB-SUPPLIER C : MAIN SUPPLIER N : END USER & BHEL P : PERFORMANCE W : WITNESS V : VERIFICATION AS APPROPRIATE				DOC. NO. :							
SIGNATURE										REVIEWED BY			APPROVED BY			APPROVAL SEAL	

MANUFACTURE'S NAME & ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT							
				ITEM : BUTTERFLY VALVE	ACILQP NO. :		CONTRACT NO. :								
				P.O.NO. :	REV.NO. : DATE :		END USER :								
				P.O. DATE :	W.O. NO. :		CONTRACTOR : BHARAT HEAVY ELECTRICAL LIMITED								
				PAGE. : 1 OF 1											
SL. NO.	COMPONENTS & OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE NORMS	FORMATS OF RECORDS	AGENCY			REMARKS		
1	2	3	4	5	M	C/N	7	8	9	10	M	C	N	11	
1.0	MATERIALS														
1.1	BODY & DISC	Chemical Composition	Critical	Chemical Testing	One / Heat	One / Heat	Appd / Drgs Tech Spec	Appd Drgs / DS/MFG STD	Foundry TC	✓	P	V	V		
		Mechanical Properties	Critical	Mechanical Testing	One / Heat / Heat Treatment Batch					Foundry TC	✓	P	V	V	
		Heat Treatment (Only For Casting)	Critical	Heat treatment	100%	100%				Report	✓	P	V	V	
		Surface Defects	Major	Visual	100%	100%	MSS -SP-55	MSS-SP-55	Inspection report	✓	P	V	V		
1.2	SHAFT (BAR STOCK)	Chemical Composition	Critical	Chemical Testing	One / Heat	One / Heat	ASTM STD	ASTM STD	Foundry TC & Lab Reports	✓	P	V	V		
		Mechanical Properties	Critical	Mechanical Testing	One / Heat / Batch	One / Heat / Batch	ASTM STD	ASTM STD	Foundry TC & Lab Reports	✓	P	V	V		
	SHAFT (BAR STOCK)	Ultrasonic Test for Stem	Critical	Ultrasonic Test	100%	100%	ASTM B 16.34	ASTM B 16.34 & ASME B 16.34 ANNEXURE E	UT REPORT	✓	P	V	V	For dia>50mm above only.	
1.3	Body / Disc Seat	Physical & Ozone Test	Critical	Physical & Ozone Test	One sample / Lot	One sample / Lot	Material specification	Relevant Material Std.	Test report	✓	P	V	V		
2.0	INPROCESS INSPECTION														
2.1	MACHINING OF BODY & DISC	Dimension	Major	Measurement	100%	100%	Mfg Drgs	Mfg Drgs	Inspection report	✓	P	V	V		
3.0	ASSEMBLY	Dimension	Major	Measurement	10%	10%	Appd Drgs	Appd Drgs		✓	P	V	V		
4.0	TESTING														
4.1	SHELL	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref standard	No Leakage	Test Certificate	✓	P	W	V		
4.2	HYDRO SEAT	Leakage	Critical	Hydrostatic Pressure	100%	10%	Approved Drawings / DS/ Ref standard	No Leakage	Test Certificate	✓	P	W	V		
4.3	PERFORMANCE / FUNCTIONAL CHECK	Operation (Opening & Closing)	Major	Visual	100%	10%	Drawing & Technical Spec.	Smooth Operation	Inspection report	✓	P	W	V		
5.0	FINAL INSPECTION	Cleanliness Completeness &	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	✓	P	V	V		
5.1	PAINTING	DFT CHECK	Major	Visual	100%	10%	As per Drg/ Tech Spec.	As per Drg/ Tech Spec.	Inspection report	✓	P	V	V		
6.0	PROVISION OF NAME PLATE	As Per Spec	Major	Visual	As per Specification	As per Specification	As per Specification	As per Specification	Inspection report	✓	P	V	V		
NOTE:- SS PARTS SHALL BE CHECKED AT 10% POSITIVE MATERIAL IDENTIFICATION (PMI) GRADE ANALYSER															
MANUFACTURER/SUB-SUPPLIER		MAIN SUPPLIER		LEGEND: *RECORDS IDENTIFIED WITH TICK(*) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION M : MANUFACTURER / SUB-SUPPLIER C : MAIN SUPPLIER N : END USER & BHEL P : PERFORMANCE W : WITNESS V : VERIFICATION AS APPROPRIATE				DOC. NO. :							
SIGNATURE								REVIEWED BY		APPROVED BY		APPROVAL SEAL			

		MANUFACTURE'S NAME & ADDRESS		REFERENCE QUALITY PLAN									
				ITEM : AIR DRYER		QIP NO. _____ Rev : _____ Date : _____ Page : _____		Sign of MFG GR : _____		Qp No : _____ Rev No : _____ Date : _____ Page : _____		Reviewed By : _____	
SR. NO.	COMPONENTS AND OPERATORS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE	FORMAT OF RECORD	AGENCY			REMARKS
1	2	3	4	5	6	7	8	9	10	11	12	13	14
					M	C/N							
A MATERIAL INSPECTION													
1.1	ROTOR DRUM	CHEMICAL	MAJOR	CHEMICAL ANALYSIS	100%		APPROVED DATASHEET	APPROVED DATASHEET	COC	✓	V	V	V
1.2	DRYER VESSEL COMPLETE	DIMENSIONS MECHANICAL	MAJOR	DIMENSIONS MECH. PROPERTIES	100%		MFG DRG APPROVED DATASHEET	MFG DRG	COC	✓	V	V	V
1.3	REGEN. COOLERS	MECHANICAL CHEMICAL	MAJOR	CHEMICAL & MECH.	100%		APPROVED DATASHEET	APPROVED DATASHEET	COC	✓	V	V	V
B INPROCESS INSPECTION													
2.1	REGEN. COOLERS	TIGHTNESS	MAJOR	HYDROSTATIC	100%		1.5 X DESIGN PRESSURE FOR NO LEAKAGE 5 MIN.		COC [SEE NOTE 1]	✓	P	V	V
2.2	DRYER VESSEL WATER SEPARATOR	TIGHTNESS	MAJOR	HYDROSTATIC	100%		1.5 X DESIGN PRESSURE FOR NO LEAKAGE 5 MIN.		COC [SEE NOTE 1]	✓	P	V	V
2.3	WATER SEPARATOR GEAR BOX DRAIN VALVES MOTOR	FUNCTIONAL	MAJOR	FUNCTIONAL	100%		MFG DRAWING	MFG DRAWING	COC	✓	P	V	V
C FINAL INSPECTION AT ATLAS COPCO AIRPOWER, BELGIUM													
3.1	ASSEMBLY AND TESTING	DIMENSIONAL APPEARANCE & COMPLETENESS	MAJOR	MEASUREMNT VISUAL	100%		APPROVED DRAWING	APPROVED DRAWING	INSP REPORT	✓	P	V	V
		MECH. RUN TEST TIGHTNESS	MAJOR	FUNCTIONAL TEST HYDROSTATIC			APPROVED DRAWING 1.5 X DESIGN PRESSURE	APPROVED DRAWING NO LEAKAGE	COC COC [SEE NOTE 1]	✓	P	V	V
LEGEND: * Records identified with " Tick" (✓) shall be essentially included by supplier in QA documentation. ** M: Manufacturer / Sub Supplier, C: Supplier nominated inspection agency, P: Perform, W: Witness and V: Verification. N: END USER & BHEL													

		MANUFACTURE'S NAME & ADDRESS		REFERENCE QUALITY PLAN						To be Filled				
				ITEM : AIR DRYER		QP NO. : Rev : Date : Page :		Sign of INSPGR's/		Qp No : Rev No : Date : Page : 2 OF 2 Valid Upto :		Reviewed By :		
SR. NO.	COMPONENTS AND OPERATORS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENTS	ACCEPTANCE	FORMAT OF RECORD	AGENCY				REMARKS
					M	C/N				D	M	C	N	
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
					M	C/N								
	D FINAL INSPECTION													
4.1	FINAL INSPECTION AT ATLAS COPCO INDIA	MECH RUN TEST OF COMPLETE DRYER TIGHTNESS OF COMPLETE DRYER	MAJOR	DRUM ROTATION CHECK PNEUMATIC TEST	100%	100%	APPROVED DRAWING/ APPROVED DATASHEET 1.1 X WORKING PRESSURE	SMOOTH OPERATION NO LEAKAGE	INSP.REPORT	✓	P	W	W	
	E PACKING AND DESPATCH													
5.1	PACKING SHIPPING	CHECK DOC. SEA WORTHY PACKING	MAJOR	VERIFICATION	100%		AS PER PACKING PROCEDURE	AS PER PACKING PROCEDURE	ALL SHIPPING DOCUMENTS		P/V	V		
NOTE : 1		SPECIFIC CONFIRMATION FROM AIRPOWER REGARDING THE HYDROTEST PRESSURE												
NOTE : 2		MATERIAL SHALL BE AS PER APPROVED DRG/TDS. INCASE NOT MENTIONED IN APPROVED DRG/TDS THEN AC STANDARDS SHALL BE APPLICABLE												

LEGEND : * Records identified with "Tick" () shall be essentially included by supplier in QA documentation

** M : Manufacturer / Sub-Supplier C : Supplier nominated inspection agency, P : Perform; W : Witness and V : Verification

N : END USER & BHEL

Note : # NTPC inspection engineer to check, approval date of reference document viz, a viz approval date of RQP at the time of inspection.

MANUFACTURER'S NAME AND ADDRESS		MANUFACTURING QUALITY PLAN							OWNER :						
		ITEM	AIR RECEIVER		Q.P. NO.			CONSULTANT :							
					REV			PROJECT :							
		SUB SYSTEM	COMPRESSED AIR SYSTEM.		DATE			PACKAGE VENDOR :							
					PAGE	Page 1 OF 2		BHEL DOC NO :							
SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS		
1.	2.	3.	4.	5.	M	C/N	7.	8.	9.	D	10.		11.		
1.0 RAW MATERIAL INSPECTION															
1.1	MS PLATE FOR SHELL, DISHED END, FLANGES, SOCKET / PIPE FOR NOZZLES	CHEMICAL PROPERTIES	B	CHEMICAL ANALYSIS	1 SAMPLE / HEAT		RELEVANT MATERIAL SPECIFICATION AS PER APPROVED DATA SHEET / APPROVED DRAWING		MILL TC / LAB TC	✓	P	V	V	REFER NOTE 1	
		MECHANICAL PROPERTIES	B	MECHANICAL TESTS	1 SAMPLE / HEAT										
		INTERNAL DEFECTS	B	U. T. (32 MM & ABOVE THICK)	100 %		ASME SEC. V / ASTM A 435	ASTM A 435	U. T. REPORT	✓	P	V	V		
2.0 IN PROCESS INSPECTION															
2.1	DISHED END	CORRECT DIMENSIONS	B	MEASURE	100%		APPROVED DRAWING/MANUFACTURING DRAWING		DO	✓	P	V	V	IN CASE OF JOINT IN DISH END, 100% RT ON JOINT TO BE DONE.	
		DPT ON KNUCKLE	B	DP TEST	100%		ASME SEC. V	ASME SEC. V	✓	✓	P	V	V		
		THICKNESS THINNING	B	MEASURE	100%		APPROVED DRAWING/MANUFACTURING DRAWING / TECHNICAL SPECIFICATION		DO	✓	P	V	V		
2.2	FABRICATION OF AIR RECEIVER	CUTTING OF PLATES	B	VISUAL & MEASURE	100%	-	CUTTING PLAN / MANUFACTURING DRAWINGS		REGISTER		P	-	-		
		EDGE PREPARATION AND FIT UP	B	VISUAL & MEASURE	100 %	-	APPROVED WPS / FABRICATION DRAWING		REGISTER		P	-	-		
		WPS / WELDER QUALIFICATION	B	VISUAL & MECHANICAL TEST	100 %			ASME SEC. IX	ASME SEC. IX	QW 482, 483, 484	✓	P	V	V	REFER NOTE : 3
		NDT ON BUTT WELDS (LONGITUDINAL & CIRCUMFERENTIAL WELD JOINT FOR ADSORPTION TOWERS) AFTER BACK GOUGING & FINAL WELDING	B	DPT AFTER BACK GOUGING	100 %			ASME SEC. V	ASME SEC. VIII DIV. 1 APPENDIX 8	NDT REPORT	✓	P	V	V	
		NDT ON BUTT WELDS & FILLET JOINTS IN SHELL & DISH AFTER FINAL WELDING	B	RT AFTER FINAL WELDING	10 % ON BUTT JOINT INCLUDING 100% CROSS JOINT			ASME SEC. V	ASME SEC VIII DIV.1-UW-52	RT REPORT	✓	P	V	V	RT FILMS & REPORT WILL BE REVIEWED BY NTPC. CHP.
		BOD SHELL STRENGTH TEST	B	DPT	100 %			ASME SECTION V	ASME SEC. VIII DIV. 1 APPENDIX 8	NDT REPORT	✓	P	V	V	CHP, NTPC. SHALL WITNESS DPT DURING FINAL INSPECTION
3.0 FINAL INSPECTION															
3.1	FINAL INSPECTION	DIMENSION, ORIENTATION	A	VISUAL & MEASURE	100%		APPROVED DRAWING		IR	✓	P	W	W		
3.2	PAINTING	DFT / SURFACE FINISH	B	VISUAL & MEASURE	100%		AS PER MANUFACTURING STANDARDS,		IR	✓	P	V	-	REFER NOTE 4	
		LEGEND : CL: (ACRITICAL, B:MAJOR C:MINOR) ** M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER, P: PERFORM, W: WITNESS AND V: VERIFICATION, ND: NDT LAB R: TEST / DIMENSIONAL REPORT ✓ RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER CH QA DOCUMENTATION.													
MANUFACTURERS / SUB-SUPPLIER		SIGNATURE _____ Page 1 OF 4													
		DOC NO : _____ REVISED BY _____ APPROVED BY _____ APPROVAL SEAL _____													

MANUFACTURER'S NAME AND ADDRESS		MANUFACTURING QUALITY PLAN							OWNER :					
		ITEM	AIR RECEIVER	QP NO			CONSULTANT :							
				REV			PROJECT :							
				DATE			PACKAGE VENDOR :							
SUB SYSTEM		COMPRESSED AIR SYSTEM.		PAGE	Page 2 OF 2		BHEL DOC NO :							
SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS	
1.	2.	3.	4.	5.	M	C/N	7.	8.	9.	D	M	C	N	11.
3.3	PACKING / AVAILABILITY OF ACCESSORIES	VISUAL	B	VISUAL	100%	—	APPROVED DRAWING		IR/CALIBRATION REPORT	✓	P	V	-	

NOTE

- MS PLATES USED SHALL BE REPUTED MANUFACTURERS ONLY & BEING THE TOTAL PLATES QTY IS LESS. THESE PLATES SHALL BE SOURCED FROM AUTHORIZED DEALERS LIKE SAIL, JINDAL, ESSAR, LLOYD, & WELLSPUN, ETC.
- THE MS PLATES SHALL BE CUT ACCORDING TO CUTTING PLAN AND HEAT NO, PLATE NO OF EACH PLATE SHALL BE TRANSFERRED BY PUNCHING ON EACH PIECE FOR PROPER CORRELATION& TRACEABILITY. THE CUTTING PLAN SHALL INCLUDE COMPLETE DETAILS OF HEAT NO, PLATE NO,OF EACH CUT PIECE.
 - THE WELDING PLAN OF EACH FABRICATED PIECE SHALL INCLUDE JOINT NUMBER, WELDER NO, WHO CARRY OUT WELDING FOR COMPLETE TRACEABILITY.
- BHEL APPROVED WPS WILL BE USED, QUALIFIED WELDERS WILL BE DEPLOYED, IF WELDERS ARE ALREADY QUALIFIED BY NTPC / LLOYDS/BVQI/BSI/BHEL/TUV AND DOING THE SIMILAR JOBS THEN SAME SHALL BE VERIFIED IN PLACE OF WITNESSING. RECORD WILL BE VERIFIED BY NTPC DURING INSPECTION.
- INSIDE PAINTING IS APPLICABLE & SHALL BE DONE AS PER MANUFACTURING STANDARDS.

ABBREVIATIONS:-
M.T.C. – MANUFACTURER'S TEST CERTIFICATE, L.T.C. – LAB TEST CERTIFICATE, IR – INSPECTION REPORT, UT REPORT – ULTRASONIC TEST REPORT, RT REPORT – RADIOGRAPHICREPORT, NDT – NON DESTRUCTIVE TESTING

MANUFACTURERS / SUB-SUPPLIER		SIGNATURE	LEGEND : CL: (A:CRITICAL, B:MAJOR C:MINOR) M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER, W: WITNESS AND V: VERIFICATION. ND:NDT LAB R:TEST / DIMENTIONAL REPORT RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER QA DOCUMENTATION.	DOC NO :		
				REVISED BY	APPROVED BY	APPROVAL SEAL

Page 2 OF 4

MANUFACTURER'S NAME AND ADDRESS		MANUFACTURING QUALITY PLAN							OWNER :						
		ITEM	HEAT OF COMPRESSION AIR DRYER	QP NO				CONSULTANT :							
				REV				PROJECT :							
		SUB SYSTEM	COMPRESSED AIR SYSTEM.	DATE				PACKAGE VENDOR :							
						PAGE	Page 1 OF 4			BHEL DOC NO :					
SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD		AGENCY			REMARKS	
						M	C/N					M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D	10.			11.	
1.0	RAW MATERIAL INSPECTION														
1.1	MS PLATE FOR SHELL & DISHED END,	CHEMICAL PROPERTIES	B	CHEMICAL ANALYSIS	1 SAMPLE / HEAT		RELEVANT MATERIAL SPECIFICATION AS PER APPROVED DATA SHEET / APPROVED DRAWING		MILL TC / LAB TC	√	P	V	V	REFER NOTE 1	
		MECHANICAL PROPERTIES	B	MECHANICAL TESTS	1 SAMPLE / HEAT										
		INTERNAL DEFECTS	B	U. T. (32 MM & ABOVE THICK	100 %		ASME SEC. V / ASTM A 435	ASTM A 435	U. T. REPORT	√	P	V	V		
1.2	PIPES	CHEMICAL PROPERTIES	B	CHEMICAL ANALYSIS	1 SAMPLE / HEAT		RELEVANT MATERIAL SPECIFICATION AS PER APPROVED DATA SHEET / APPROVED DRAWING		MILL TC / LAB TC	√	P	V	V	REFER NOTE 2	
		MECHANICAL PROPERTIES	B	MECHANICAL TESTS	1 SAMPLE / HEAT										
1.3	BOUGHT OUT ITEMS	VISUAL, DIMENSIONAL	B	ITEM, MAKE, RANGE, DIMENSIONAL	100%		APPROVED DATA SHEET / APPROVED DRAWING		MTC / CALIBRATION REPORT	√	P	V	V	REFER NOTE - 6	
2.0	IN PROCESS INSPECTION														
2.1	DISHED END	CORRECT DIMENSIONS	B	MEASURE	100%		MANUFACTURING DRAWING		IR	√	P	V	V	IN CASE OF JOINT IN DISH END, 100% RT ON JOINT TO BE DONE.	
		RT ON DISHED ENDS (IF APPLICABLE)	B	RT AFTER FINAL WELDING	100%		ASME SEC. V	ASME SEC. VIII DIV.1-UW-51	RT FILM, RT REPORT	√	P	V	V		
		DPT ON KNUCKLE	B	DP TEST	100%		ASME SEC. V	ASME SEC. V	DPT REPORT	√	P	V	V		
		THICKNESS THINNING	B	MEASURE	100%		APPROVED DRAWING/MANUFACTURING DRAWING / TECHNICAL SPECIFICATION		I.R.	√	P	V	V		
2.2	FABRICATION OF AIR DRYER	CUTTING OF PLATES	B	VISUAL & MEASURE	100%	-	CUTTING PLAN / MANUFACTURING DRAWINGS		REGISTER		P	-	-		
		EDGE PREPARATION AND FIT UP	B	VISUAL & MEASURE	100 %	-	APPROVED WPS / FABRICATION DRAWING		REGISTER		P	-	-		
		WPS / WELDER QUALIFICATION	B	VISUAL & MECHANICAL TEST	100 %		ASME SEC. IX	ASME SEC. IX	QW 482, 483, 484	√	P	V	V	REFER NOTE : 3	
		NDT ON BUTT WELDS (LONGITUDINAL & CIRCUMFERENTIAL WELD JOINT FOR ADSORPTION TOWERS) AFTER BACK GOUGING & FINAL WELDING	B	DPT AFTER BACK GOUGING	100 %		ASME SEC. V	ASME SEC. VIII DIV. 1 APPENDIX 8	NDT REPORT	√	P	V	V		
			B	RT AFTER FINAL WELDING	10 % ON BUTT JOINT INCLUDING 100% CROSS JOINT		ASME SEC. V	ASME SEC. VIII DIV.1-UW-52	RT REPORT	√	P	V	V	RT FILMS & REPORT WILL BE REVIEWED	
		NDT ON BUTT WELDS & FILLET JOINTS IN SHELL & DISH AFTER FINAL WELDING	B	DPT	100 %		ASME SECTION V	ASME SEC. VIII DIV. 1 APPENDIX 8	NDT REPORT	√	P	V	V		
		LEGEND : Records, indentified with "Tick" () shall be essentially included by SUPPLIER in QA documentation. ** M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER , P: PERFORM, W: WITNESS AND V: VERIFICATION. ND: NDT LAB R: TEST / DIMENTIONAL REPORT * RECORDS, INDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.													
MANUFACTURERS / SUB-SUPPLIER		MAIN SUPPLIER													
SIGNATURE		Page 1 OF 4													
		REVIWED BY APPROVED BY APPROVAL SEAL													

MANUFACTURER'S NAME AND ADDRESS		MANUFACTURING QUALITY PLAN							OWNER :						
		ITEM	HEAT OF COMPRESSION AIR DRYER		QP NO				CONSULTANT :						
					REV				PROJECT :						
		SUB SYSTEM	COMPRESSED AIR SYSTEM.		DATE	Page 2 OF 4			PACKAGE VENDOR :						
PAGE	BHEL DOC NO :														
SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD		AGENCY			REMARKS	
1.	2.	3.	4.	5.	M	C/N	6.	7.	8.	9.	D	10.			11.
2.3	WELD QUALITY OF PIPE WELD & FILTERS WELD	DPT ON ROOT RUN & FINAL OF BUTT WELD	B	NDT - DPT	100%		ASME SEC V	ASME SEC. VIII DIV. 1 APPENDIX 8	IR	√	P	V	V		
2.4	HEAT EXCHANGER	TUBE TO TUBE SHEET FILLET WELD JOINT	B	NDT - DPT	100%		ASME SEC V	ASME SEC. VIII DIV. 1 APPENDIX 8	IR	√	P	V	V		
2.5	VESSEL (TOWER) MOISTURE SEPARATOR & HEAT EXCHANGERS	BOD SHELL STRENGTH TEST	B	HYDRO TEST	100 %		HYDRO TEST PRESSURE @ 1.3 TIMES OF DESIGN PRESSURE FOR 30 MIN	NO LEAKAGE & NO PRESSURE DROP	IR	√	P	V	V		
2.6	PNEUMATIC TEST	FOR COMPLETE ASSEMBLY OF AIR DRYER	B	PNEUMATIC TEST WITH SOAP BUBBLE	100%		PNEUMATIC TEST PRESSURE @ 1.1 TIMES OF DESIGN PRESSURE FOR 30MIN	NO LEAKAGE & NO PRESSURE DROP	IR	√	P	W	W	CHP 'W' AT THE TIME OF FINAL INSPECTION	
3.0	FINAL INSPECTION														
3.1	FINAL INSPECTION	DIMENSION, ORIENTATION	B	VISUAL	100%		AS PER APPROVED GA DRAWING / DATA SHEET		IR	√	P	W	W		
3.2	FUNCTIONAL TEST	PERFORMANCE TEST AT NO LOAD CONDITIONS	B	FUNCTIONAL / OPERATION OF VALVES & AUTO DRAIN TRAP	100%		APPROVED FUNCTIONAL TEST PROCEDURE (ENCLOSED) / APPROVED DRAWING / DATASHEET		IR	√	P	W	W		
3.2	CONTROL PANEL	WORKMANSHIP FINISH, SHADE	B	VISUAL	100%	100%	AS PER ELECTRICAL DRAWING / APPROVED DATA SHEET / MFG STANDARD		IR		P	W	W		
		DRY FILM THICKNESS	B	MEASURE	100%	RANDOM	MINIMUM 50 MICRONS (POWDER COATED), 70 MICRONS (PAINTED)		IR		P	W	W		
		ADHESION TEST (PEEL OFF TEST)	B	MEASURE	100%	1 PANEL (RANDOM)	ASTM D 3359	NO PEEL OFF	IR		P	W	W		
		WIRING & COMPONENT LAYOUT, FITTING ACCESSIBILITY & SAFETY	B	VERIFICATION	100%	RANDOM	AS PER ELECTRICAL DRAWING / APPROVED DATA SHEET		IR		P	V	V		
		COMPONENTS MAKE IDENTIFICATION (MARKING / NAME PLATES)	B	VERIFICATION	100%	100%	AS PER ELECTRICAL DRAWING / APPROVED DATA SHEET		IR	√	P	V	V		
		PROPER WIRE TERMINATION	B	VERIFICATION	100%	RANDOM	NO LOOSE CONNECTIONS. ALL TERMINATIONS TO BE LUGGED		IR		P	V	V		
		DOOR AND LOCK FUNCTIONING	B	FUNCTIONAL	100%	RANDOM	PROPER OPENING & CLOSING, NO MISMATCH		IR		P	W	W		
		EARTHING CHECK	B	VERIFICATION	100%	RANDOM	APPROVED DRAWING / AS PER ELECTRICAL DRAWING		IR		P	V	V		
		LEGEND : Records, identified with "Tick" () shall be essentially included by SUPPLIER in QA documentation. ** M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER , P: PERFORM, W: WITNESS AND V: VERIFICATION. ND: NDT LAB R: TEST / DIMENTIONAL REPORT * RECORDS, IDENTIFIED WITH "TICK" () SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.													
MANUFACTURERS / SUB-SUPPLIER		MAIN SUPPLIER													
SIGNATURE		Page 2 OF 4													
		QC NO : 0370-102-PE-PVM-Q-003 REVIWED BY APPROVED BY APPROVAL SEAL													

	MANUFACTURER'S NAME AND ADDRESS	MANUFACTURING QUALITY PLAN				OWNER :
		ITEM	HEAT OF COMPRESSION AIR DRYER	QP NO		CONSULTANT :
				REV		PROJECT :
		SUB SYSTEM	COMPRESSED AIR SYSTEM.	DATE		PACKAGE VENDOR :
				PAGE	Page 3 OF 4	BHEL DOC NO :

SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD		AGENCY			REMARKS
					M	C/N				D	M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.		10.			11.
		OVERALL DIMENSIONS	B	MEASURE	100%	RANDOM	AS PER ELECTRICAL DRAWING / DATA SHEET		IR		P	V	V	
		DEGREE OF PROTECTION BY PAPER INSERTION	A	MEASURE	100%	100%	AS PER ELECTRICAL DRAWING / DATA SHEET		IR	√	P	V	V	
		IR TEST & HIGH VOLTAGE TEST	A	MEASURE	100%	100%	HV TEST AT 1.5 KV FOR ONE MINUTE IR TEST FOR 500V	WITH STOOD More than 50 MOhms	IR	√	P	W	W	
		FUNCTIONAL TEST	A	VISUAL, MEASURE, VERIFICATION	100%	1 PANEL RANDOMLY SELECTED	AS PER ELECTRICAL DRAWING / DATA SHEET/ FINCTION TEST PROCEDURE		IR		P	W	W	
3.4	PAINTING	DFT / SURFACE FINISH	B	VISUAL & MEASURE	100%		AS PER MANUFACTURING STANDARDS,		IR	√	P	V	-	
3.5	INSULATION / CLADDING (AS APPLICABLE)	COMPLETENESS	B	VARIFICATION	100%		APPROVED DRAWING / DATASHEET		IR	√	P	V	-	
3.3	PACKING / AVAILABILITY OF ACCESSORIES	VISUAL	B	VISUAL	100%	--	MANFACTURER PROCEDURE.		IR	√	P	V	-	

NOTE

1	MS PLATES USED SHALL BE REPUTED MANUFACTURERS ONLY & BEING THE TOTAL PLATES QTY IS LESS. THESE PLATES SHALL BE SOURCED FROM AUTHORIZED DEALERS LIKE SAIL, JINDAL, ESSAR, LLOYD, & WELLSPUN, ETC.													
2	ALL THE INTERCONNECTING PIPING USED SHALL BE REPUTED MAKES & BEING THE TOTAL PIPE QTY IS LESS. THESE PIPES SHALL BE SOURCED FROM AUTHORIZED DEALERS OF TATA, JINDAL, SURYA ROSHINI & WELLSPUN													
3	LLOYDS/BVQI/BSI/BHEL/TUV APPROVED WPS WILL BE USED, QUALIFIED WELDERS WILL BE DEPLOYED. IF WELDERS ARE ALREADY QUALIFIED BY LLOYDS/BVQI/BSI/BHEL/TUV AND DOING THE SIMILAR JOBS THEN SAME SHALL BE VERIFIED IN PLACE OF WITNESSING.													
4	MEASUREMENT OF DEW POINT AND PERFORMANCE TEST DURING FINAL INSPECTION IS DEMONSTRATIVE AND INDICATIVE ONLY AND WILL BE DONE AT NO-LOAD AND THE SAME WILL BE ACCEPTED.FINAL DEW POINT & PERFORMANCE PARAMETER WILL BE DEMONSTRATED AT SITE ONLY.													
5.	BOUGHT OUT ITEMS													

Records, indentified with "Tick" () shall be essentially included by SUPPLIER in QA documentation.

		LEGEND ** M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER , P: PERFORM, W: WITNESS AND V: VERIFICATION. ND:NDT LAB R:TEST / DIMENTIONAL REPORT * RECORDS, INDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.		DOC NO :		
MANUFACTURERS / SUB-SUPPLIER	MAIN SUPPLIER					
SIGNATURE		Page 3 OF 4		REVIWED BY	APPROVED BY	APPROVAL SEAL

		MANUFACTURER'S NAME AND ADDRESS		MANUFACTURING QUALITY PLAN						OWNER :			
				ITEM	HEAT OF COMPRESSION AIR DRYER	QP NO		CONSULTANT :					
						REV		PROJECT :					
				SUB SYSTEM	COMPRESSED AIR SYSTEM.	DATE		PACKAGE VENDOR :					
PAGE	Page 4 OF 4	BHEL DOC NO :											
SLNO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS
					M	C/N				M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D	10.		11.
	SN	ITEM		MAKE				REMARKS					
	1.	PRESSURE GAUGE		BHEL APPROVED MAKE				VERIFICATION OF MANUFACTURER'S CALIBRATION REPORT, TYPE, MAKE, RANGE, ACCURACY					
	2.	TEMPERATURE GAUGE		BHEL APPROVED MAKE				VERIFICATION OF MANUFACTURER'S CALIBRATION REPORT, TYPE, MAKE, RANGE, ACCURACY					
	3.	CYCLE CHANGE OVER VALVE		BHEL APPROVED MAKE				MANUFACTURER'S TEST CERTIFICATE FOR PNEUMATIC TEST OF BODY AND SEAT & MATERIAL					
	4.	BUTTERFLY VALVE		BHEL APPROVED MAKE				MANUFACTURER'S TEST CERTIFICATE FOR PNEUMATIC TEST OF BODY AND SEAT & MATERIAL					
	5.	5/2 WAY SOLENOID VALVES		BHEL APPROVED MAKE				MANUFACTURER'S TEST CERTIFICATE / INSPECTION REPORT					
	6.	DEW POINT METER		BHEL APPROVED MAKE				MANUFACTURER'S TEST CERTIFICATE /CALIBRATION REPORT					
	7.	AUTO DRAIN VALVE		BHEL APPROVED MAKE				MANUFACTURER'S TEST CERTIFICATE					
	8.	DIFFERENTIAL PRESSURE GAUGE		BHEL APPROVED MAKE				VERIFICATION OF MANUFACTURER'S TEST CERTIFICATE, TYPE, MAKE, RANGE, ACCURACY					
	9.	DIFFERENTIAL PRESSURE SWITCH		BHEL APPROVED MAKE				VERIFICATION OF MANUFACTURER'S TEST CERTIFICATE, TYPE, MAKE, RANGE, ACCURACY					
	10.	TEMPERATURE ELEMENT		BHEL APPROVED MAKE				VERIFICATION OF MANUFACTURER'S TEST CERTIFICATE, TYPE, MAKE, RANGE, ACCURACY					
6.	Note : As per SL NO.5 , the bought out items vendor makes are as per approved data sheet. (Enclosed Documents for reference)												
ABBREVIATIONS:- M.T.C. – MANUFACTURER'S TEST CERTIFICATE, L.T.C. – LAB TEST CERTIFICATE, IR – INSPECTION REPORT, UT REPORT – ULTRASONIC TEST REPORT, RT REPORT – RADIOGRAPHICREPORT, NDT – NON DESTRUCTIVE TESTING, HV – HIGH VOLTAGE TEST													

Records, indentified with "Tick" () shall be essentially included by SUPPLIER in QA documentation.

		LEGEND :		DOC NO :	
		** M: MANUFACTURER/SUB-SUPPLIER, C: NOMINATED INSPECTION AGENCY N: CUSTOMER , P: PERFORM, W: WITNESS AND V: VERIFICATION. ND: NDT LAB R: TEST / DIMENTIONAL REPORT * RECORDS, INDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.			
MANUFACTURERS / SUB-SUPPLIER	MAIN SUPPLIER			REVIWED BY	APPROVED BY
SIGNATURE		Page 4 OF 4		APPROVAL SEAL	

		QUALITY PLAN		CUSTOMER: M/S GSECL		PROJECT:		SPEC. NO.: PE-TS-436-555-A001		
				BIDDER/VENDOR:		QP NO. PE-QP-408-555-M001		REV. 00 DT: 20.02.2018		
		SHEET 1 OF 3		SYSTEM SERVICE AIR/ INSTRUMENT AIR		ITEM: BALL FLOAT AIR TRAP		SECTION VOLUME		
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY P W V	REMARKS

1.0	MATERIALS											
1.1	BODY, COVER	1. PHYSICAL & CHEM. PROPERTIES	MA	PHYS.&CHEM. TEST	ONE /HEAT / HEAT BATCH	APPROVED DRAWING / TECH. SPEC.	APPROVED DRAWING/ TECH. SPEC.	TEST CERT.	3/2	2	1	- CO-RELATED TCs SHALL BE FURNISHED.
		2.SURFACE DEFECTS	MA	VISUAL	100%	MSS-SP-55	MSS-SP-55	LOG BOOK	3/2	2	1	
1.2	FLOAT UNIT ASSEMBLY, VALVE SEAT, PIVOT FRAME, SUPPORT FRAME, PIVOT PIN ,GASKET	1. PHYS., CHEM. PROPERTIES	MA	PHYS., CHEM. TEST	ONE /HEAT / HEAT BATCH	APPD. DRG	APPD. DRG	TEST CERT	3/2	2	1	
		2. SURFACE DEFECTS	MA	VISUAL	100%	MSS-SP-55	MSS-SP-55	INSPN. REPORT	3/2	2	1	
1.3	FASTENERS	1. PHYS., CHEM. PROPERTIES	MA	PHYS., CHEM. TEST	ONE PER TYPE	APPD. DRG	APPD. DRG	TEST CERT	3/2	2	1	
2.0	IN-PROCESS											
2.1	ALL COMPONENTS	1.DIMENSIONS	MA	MEASUREMENT	100%	MFG. DRAWING	MFG. DRAWING	INT. INSPN. REPORT	3/2	-	2	
		2. SURFACE DEFECTS	MA	VISUAL	100%	-DO-	-DO-	INSPN. REPORT	3/2	-	2	
2.2	VALVE, VALVE SEAT	1.SURFACE DEFECTS	CR	PENETRANT TEST	100%	ASTME-165	NO DEFECTS	INT. INSPN. REPORT	2	2	1	
		2. HARDNESS	MA	TESTING	100%	APPD. DRG.	APPD. DRG.	INT. INSPN. REPORT	2	2	1	
		3. BALL IMPRES	MA	BY AIR	100%	SEAT SURFACE SHALL HAVE METAL TO METAL CONTACT		INT. INSPN. REPORT	2	2	1	
3.0	SUB- ASSEMBLY											
3.1	VALVE & VALVE SEAT	1. LEAK TIGHTNESS	CR	AIR/HYDRO	100%	APPD. DRG	APPD. DRG.	INT. INSPN. REPORT	2	2	1	

BHEL	PARTICULARS	BIDDER/VENDOR	BIDDER'S/ VENDOR'S COMPANY SEAL
	NAME		
	SIGNATURE		
	DATE		

		QUALITY PLAN		CUSTOMER: M/S GSECL		PROJECT:		SPEC. NO : PE-TS-436-555-A001		
		SHEET 2 OF 3		BIDDER/VENDOR:		QP NO. PE-QP-408-555-M001		REV. 00 DT: 20.02.2018		
		SYSTEM		SERVICE AIR/ INSTRUMENT AIR		ITEM: BALL FLOAT AIR TRAP		SECTION VOLUME		
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY P W V	REMARKS

3.2	COVER	1. ALIGNMENT	MA	VISUAL	100%	-DO-	PROPER FITTING	INT. INSPN. REPORT	2	2	1	The minimum thickness of galvanizing shall be minimum 40 microns.
4.0	HYDRAULIC TEST (FOR CCS MATERIAL, TEST TO BE CONDUCTED BEFORE GALVANISING)											
4.1	BODY COVER SHELL TEST	LEAK TIGHTNESS OF BODY	CR	HYDRO. TEST AT 1.5 TIMES OF TRAP DESIGN PRESSURE	100%	APPD. DRG./TECH. SPEC./DATA SHEET	NO LEAKAGE	TEST CERT	2	2	1	
5.0	GALVANISING (APPLICABLE FOR CCS MATERIAL ONLY)											
5.1	HOT DIP GALVANISING OF BODY, COVER	1. SURFACE PREPARATION & THICKNESS OF GALVANISING & UNIFORMITY.	MA	VISUAL & MEASURE-MENT	100%	IS:2629	IS:2629	INSPN REPORT	2	2,1*	-	
6.0	ASSEMBLY (FOR CCS MATERIAL, TEST TO BE CONDUCTED AFTER GALVANISING)											
6.1	COMPLETE ASSEMBLY	1. CLEANLINESS & COMPLETENESS, DIMENSIONS, THREADING ENDS, ARROW MARKING ETC.	MA	VISUAL & MEASURE-MENT	100%	APPROVED DRAWING	APPROVED DRAWING	INSPN REPORT	2	2,1*	-	
		2.LEAK TIGHTNESS OF BODY	CR	HYDRO. TEST AT 1.5 TIMES OF TRAP DESIGN PRESSURE	100%	APPD. DRG./TECH. SPEC./DATA SHEET	NO LEAKAGE	TEST CERT	2	1*	-	
		3.FUNCTIONAL TEST	CR	FUNCTIONAL TEST AT MINIMUM 6Kg/cm ² PRESSURE (VISUAL DISCHARGE OF CONDENSATE)	100 %	APPD DRG./ GIVEN PROCEDURE ON PAGE 3/3 OF THIS QP.	NO AIR LEAKAGE	TEST CERT.	2	1*	-	

BHEL		PARTICULARS		BIDDER/VENDOR	
		NAME			
		SIGNATURE			
		DATE			
				BIDDER'S/ VENDOR'S COMPANY SEAL	

		QUALITY PLAN		CUSTOMER: M/S GSECL			PROJECT:			SPEC. NO. PE-TS-436-555-A001		
		SHEET 3 OF 3		BIDDER/VENDOR:			QP NO. PE-QP-408-555-M001		REV. 00 DT: 20.02.2018		SPEC. TITLE AIR TRAPS	
				SYSTEM SERVICE AIR/ INSTRUMENT AIR			ITEM: BALL FLOAT AIR TRAP			SECTION VOLUME		
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS
									P	W	V	
6.2	FLOW CAPACITY TEST (TYPE TEST)	CONDENSATE DISCHARGE	CR	DISCHARGE FLOW	1 PER PRESSURE RATING & ORIFICE SIZE TRAP	APPD. FLOW CAPACITY	APPD. FLOW CAPACITY	TYPE TEST CERTIFICA TE	3/2	2	1	
7.0	END CONN.	DIMENSIONS	CR	MEASUREMENT	100%	APPD. DRG./ TECH. SPEC	APPD.DRG/ TECH.SPEC	INSPN REPORT	3/2	2,1*	-	
8.0	PROVISION OF NAME PLATE WITH PURCHASER'S TRAP TAG NOS. & PACKING IN WOODEN CASES	AS PER TECHNICAL SPECIFICATION	MA	VISUAL	100%	--DO--	--DO--	(Soft copy of photographs)	2	2	1	Vendor to provide the following: Photographs of traps duly placed inside the wooden box just before final packing. Photographs of the wooden box in which the traps have been finally packed just before dispatch. Clearance for dispatch of traps will be given only after receiving the photos of traps in satisfactory condition as mentioned in the condition stated above.

FUNCTIONAL TEST PROCEDURE.

1. COMPRESSED AIR (MINIMUM AT 6 Kg/cm² PRESSURE) TO BE SUPPLIED IN A MIXING CHAMBER.
 2. WATER IS ADDED IN THE SAME CHAMBER SO THAT AIR IN THE CHAMBER HAS SUFFICIENT MOISTURE
 3. TRAP IS INSTALLED AT THE BOTTOM OF THIS CHAMBER AND ITS PERFORMANCE IS CHECKED.
- A GOOD PERFORMING TRAP DRAINS OUT ONLY WATER DROPLETS AND RETAINS COMPRESSED AIR BACK IN THE SYSTEM.

NOTE:-

CR- MEANS CRITICAL ACTIVITY
1 = PURCHASER (BHEL/CUSTOMER)
P = PERFORMED BY

MA- MEANS MAJOR ACTIVITY
2 = VENDOR
W = WITNESSED BY

MI- MEANS MINOR ACTIVITY
3 = SUB VENDOR OF THE VENDOR
V = VERIFIED BY

* The Quantum of check to be witnessed is 10% of quantity or Min. 2 Nos. at random by BHEL/Customer & 100 % by Vendor for each type, Size & Rating.

BHEL		PARTICULARS	BIDDER/VENDOR
		NAME	
		SIGNATURE	
		DATE	
			BIDDER'S/ VENDOR'S COMPANY SEAL

		QUALITY PLAN		CUSTOMER: M/S GSECL		PROJECT:			SPEC. NO : PE-TS-436-555-A001			
				BIDDER/VENDOR:		QP NO.. PE-QP-408-555-M016		REV.00 DT: 20.02.2018		SPEC. TITLE AIR TRAPS		
		SHEET 1 OF 3		SYSTEM SERVICE/ INSTRUMENT AIR		ITEM: EXTERNAL Y-TYPE AIR STRAINER			SECTION VOLUME			
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS
									P	W	V	

1.0	MATERIAL CONTROL											
1.1	BODY, CAP	1 PHYS & CHEM PROPERTIES	MA	PHYS TESTS CHEM TESTS	ONE/HEAT/ BATCH	APPD. DATA SHEET/ TECH.SPEC.	APPD,DATA SHEET/ TECH.SPEC	TEST CERT.	3/2	2	1	CORRELATION REQD.
		2. SURFACE DEFECTS	MA	VISUAL	100%	—DO—	—DO—	INSPN. REPORT	3/2	2	1	
1.2	MESH	1. CHEM PROPERTIES	MA	CHEM. TESTS	1/SHEET	APPD. DATA SHEET/ TECH.SPEC.	APPD,DATA SHEET/ TECH. SPEC	TEST CERT	3/2	2	1	
		2. MESH SIZE/ PERFORATION DIA	MA	MEASUREMENT	SAMPLE PIECE	—DO—	—DO—	INSPN REPORT	3/2	2	1	
2.0	IN PROCESS CONTROL											
2.1	ALL COMPONENTS	1.WORKMANSHIP & FINISH	MA	VISUAL	100%	MFG DRG	MFG DRG	INSP REPORT	2	2	1	
		2.DIMENSIONS	MA	MEASUREMENT	100%	MFG DRG	MFG DRG	MFG DRG	2	2	1	
3.0	HYDRAULIC TEST (FOR CCS MATERIAL, TEST TO BE CONDUCTED BEFORE GALVANISING)											
3.1	BODY CAP	LEAK TIGHTNESS OF BODY	CR	HYDROTEST AT 1.5 TIMES OF STRAINER DESIGN PRESSURE	100%	APPD.DRG/T ECH. SPEC	NO LEAKAGE	TEST CERT	2	2	1	
4.0	GALVANISING (APPLICABLE FOR CCS MATERIAL ONLY)											

BHEL		PARTICULARS	BIDDER/VENDOR	
		NAME		
		SIGNATURE		
		DATE		
				BIDDER'S/ VENDOR'S COMPANY SEAL

		QUALITY PLAN		CUSTOMER: M/S GSECL		PROJECT:				SPEC. NO : PE-TS-436-555-A001	
				BIDDER/VENDOR:		QP NO.. PE-QP-408-555-M016		REV.00 DT: 20.02.2018		SPEC. TITLE AIR TRAPS	
		SHEET 2 OF 3		SYSTEM SERVICE/ INSTRUMENT AIR		ITEM: EXTERNAL Y-TYPE AIR STRAINER				SECTION VOLUME	
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY		REMARKS
									P	W	V

4.1	HOT DIP GALVANISING OF BODY,COVER	1. SURFACE PREPARATION & THICKNESS OF GALVANISING& UNIFORMITY.	MA	VISUAL & MEASURE-MENT	100%	IS:2629	IS:2629	INSPN REPORT	2	2,1 *	-	The minimum thickness of galvanizing shall be minimum 40 microns.
5.0	ASSEMBLY CONTROL (FOR CCS MATERIAL, TEST TO BE CONDUCTED AFTER GALVANISING)											
5.1	COMPLETE STRAINER	1. WORKMANSHIP AND FINISH	MA	VISUAL	100%	APPD.DRG	APPD.DRG	INSPN. REPORT	2	2	1	
		2. OVERALL DIMENSIONS	CR	MEASUREMENT	100%	--DO--	DO--	--DO--	2	2,1 *	1	
		3. LEAK TIGHTNESS OF BODY	CR	HYDROTEST AT 1.5 TIMES OF STRAINER DESIGN PRESSURE	100%	APPD.DRG/T ECH. SPEC	NO LEAKAGE	TEST CERT	2	2,1 *	1	
6.0	END CONN.	DIMENSIONS	CR	MEASUREMENT	100%	APPD DRG/ TECH SPEC.	APPD DRG/ TECH SPEC	INSPN REPORT	2	2,1 *	-	
7.0	PROVISION OF NAME PLATE WITH PURCHASER'S STRAINER TAG NOS IF ANY & PACKING IN WOODEN CASES	AS PER TECH. SPEC	MA	VISUAL	100%	TECH. SPEC	TECH. SPEC	(Soft copy of photographs)	3/2	2	1	Vendor to provide the following: a) Photographs of strainer duly placed inside the wooden box just before final packing. b) Photographs of the wooden box in which the strainer have been finally packed just before dispatch. Clearance for dispatch of valves/traps will be given

BHEL		PARTICULARS	BIDDER/VENDOR
		NAME	
		SIGNATURE	
		DATE	
		BIDDER'S/ VENDOR'S COMPANY SEAL	

		QUALITY PLAN		CUSTOMER: M/S GSECL		PROJECT:				SPEC. NO : PE-TS-436-555-A001	
				BIDDER/VENDOR:		QP NO.. PE-QP-408-555-M016		REV.00 DT: 20.02.2018		SPEC. TITLE AIR TRAPS	
		SHEET 3 OF 3		SYSTEM SERVICE/ INSTRUMENT AIR		ITEM: EXTERNAL Y-TYPE AIR STRAINER				SECTION VOLUME	
S.NO.	COMPONENT/ OPERATION	CHARACTERISTICS CHECKED	CATE- GORY	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY P W V		REMARKS
											only after receiving the photos of valves/traps in satisfactory condition as mentioned in the condition stated above.

NOTE: CR = CRITICAL ACTIVITY

MA = MAJOR ACTIVITY

MI = MINOR ACTIVITY

1 = PURCHASER (BHEL/CUSTOMER) 2 = VENDOR

3 = SUB VENDOR OF THE VENDOR

P = PERFORMED BY

W = WITNESSED BY



V = VERIFIED BY

* The Quantum of check to be witnessed is 10% of quantity or Min. 2 Nos. at random by BHEL/Customer & 100 % by Vendor for each type, Size & Rating.

BHEL	PARTICULARS	BIDDER/VENDOR	BIDDER'S/ VENDOR'S COMPANY SEAL
	NAME		
	SIGNATURE		
	DATE		

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		DATE:27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		SYSTEM:	SECTION: II	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	*	**		
					M	C/N				D	M	C	N
1.0	ASSEMBLY	1.WORKMANSHIP	MA	VISUAL	100%	-	MFG. SPEC.	MFG. SPEC.	-DO-		P	-	-
		2.DIMENSIONS	MA	-DO-	-DO-	-	MFG. DRG./ MFG. SPEC.	MFG. DRG./ MFG. SPEC.	-DO-		P	-	-
		3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOUR CODE	MA	VISUAL	100%	-	MFG.SPEC./	MFG.SPEC.	-DO-		P	-	-
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	-	MFG. SPEC/ APPROVED DATASHEET	SAME AS COL.7	LOG BOOK		P	-	-
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	IS-325 / IS-12615/ APPROVED DATA SHEET	SAME AS COL.7	TEST/ INSPN. REPORT		P	W	W
		2.OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET	TEST/ INSPN. REPORT		P	W	W
													NOTE -1 & NOTE-2
													NOTE -1 & NOTE-2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		Kunal Gandhi
Reviewed by:		P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-006, REV-02		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		SYSTEM:	SECTION: II	



SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	*	**			
					M	C/N				D	M	C	N	
4.0	PACKING	3.NAMEPLATE DETAILS	MA	VISUAL	100%	100%	IS-325 / IS-12615 / APPROVED DATA SHEET	SAME AS COL.7	TEST/ INSPN. REPORT		P	W	W	(#) APPLICABLE FOR EXPORT JOBS
		SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MFG. STANDARD / APPROVED PACKING DRAWING.(#)	AS PER MFG. STANDARD / APPROVED PACKING DRAWING.(#).	INSPC. REPORT		P	W	-	

NOTES:

- 1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON
- 2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW , ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL FOR REVIEW.
- 6 IN CASE , ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		KUNAL GANDHI
Reviewed by:		P. DUTTA	Reviewed by:		

02/3/2020

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 1 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	-	10		
					M	C/N				D	M	C	N
1.0	RAW MATERIAL & BOUGHT OUT CONTROL												
1.1	SHEET STEEL, PLATES, SECTION, EYEBOLTS	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM BLINKS, CRACKS, WAVINESS ETC	LOG BOOK		P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	-DO-		P	-	-
		3.PROOF LOAD TEST (EYE BOLT)	MA	MECH. TEST	-DO-	-	-DO-	-DO-	TEST REPORT		P/V	-	-
1.2	HARDWARES	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM CRACKS, UN-EVENNESS ETC.	-DO-		P	-	-
		2.PROPERTY CLASS	MA	VISUAL	SAMPLES	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	SUPPLIERS TC & LOG		P/V	-	-
1.3	CASTING	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM CRACKS, BLOW HOLES ETC.	LOG BOOK		P/V	-	-
		2.CHEM. & PHY. PROP.	MA	CHEM & MECH TEST	1/HEAT NO.	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	SUPPLIER'S TC		P/V	-	-
		3.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	LOG BOOK		P/V	-	-
1.4	PAINT & VARNISH	1.MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100% CONTINUOUS	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK		P/V	-	-

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. DUTTA	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO. :		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-508-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 2 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	.	..			
					M	C/N				D	M	C	N	
15	SHAFT (FORGED OR ROLLED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	-DO-		P	-	-	VENDOR'S APPROVAL IDENTIFICATION SHALL BE MAINTAINED
		2. CHEM. & PHYSICAL PROPERTIES	MA	CHEM. & PHYSICAL TESTS	1/HEAT NO. OR HEAT TREATMENT BATCH NO	-	MANUFACTURER'S DRG / SPEC.	MANUFACTURER'S DRG / STD.	SUPPLIER'S TC		PV	-	-	
		3. DIMENSIONS	MA	MEASUREMENT	100%	-	-DO-	MANUFACTURER'S DRG.	LOG BOOK		PV	-	-	
		4. INTERNAL FLAWS	CR	ULTRASONIC TEST	100%	100%	ASTM-A388	MANUFACTURER'S STD.	-DO-	✓	PW	V	-	FOR DIA OF 55 MM & ABOVE
16	SPACE HEATERS, CONNECTORS, TERMINAL BLOCKS, CABLES, CABLE LUGS, CARBON BRUSH TEMP. DETECTORS, RTD, BTD'S	1. MAKE & RATING	MA	VISUAL	-DO-	-	MANUFACTURER'S DRG./STD.	MANUFACTURER'S DRG./STD.	-DO-		PV	-	-	
		2. PHYSICAL COND.	MA	-DO-	-DO-	-	-	NO PHYS. DAMAGE, NO ELECTRICAL DISCONTINUITY	-DO-		PV	-	-	
		3. DIMENSIONS (WHEREVER APPLICABLE)	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG. / STD	MANUFACTURER'S DRG. / STD.	-DO-		PV	-	-	
		4. PERFORMANCE/ CALIBRATION	MA	TEST	100%	-	-DO-	-DO-	TEST REPORT		PV	-	-	

BHEL					
ENGINEERING			QUALITY		
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
Reviewed by:			Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
Reviewed by:	Sign & Date	Name	Seal
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:	DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04	
		PROJECT:		PO NO.:	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	.	..		
					M	C/N				D	M	C	N
1.7	OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC.	1. SURFACE COND. ETC.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS	TEST REPORT		P/V	-	-
		2. OTHER CHARACTERISTICS	MA	TEST	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK AND OR SUPPLIER'S TC		P/V	-	-
1.8	SHEET STAMPING (PUNCHED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS (FREE FROM BURS)	LOG BOOK		P	-	-
		2. DIMENSIONS INCLUDING BURS HEIGHT	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	-DO-		P/V	-	-
		3. ACCEPTANCE TESTS	MA	ELECT. & MECH TESTS	-DO-	-	MANUFACTURER'S DRG./ STD.	MANUFACTURER'S DRG./ STD.	SUPPLIER'S TC		P/V	-	-
1.9	CONDUCTORS	1. SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		*P/V	-	-
		2. ELECT. PROP. & MECH. PROP	MA	ELECT. & MECH TEST	SAMPLES	-	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S / SPEC.	SUPPLIERS TC & VENDOR'S TEST REPORTS		P/V	-	-

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hema K.	Checked by:	<i>[Signature]</i>	KUNAL GANDHI
Reviewed by:	<i>[Signature]</i>	P. Dutta	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	SECTION: II	SHEET 4 OF 9

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9				
					M	C/N				D	M	C	N
1.10	BEARINGS	3.DIMENSIONS	MA	MEASUREMENT	-DO-	-	-DO-	-DO-	Log Book		P/V	-	-
		1.MAKE & TYPE	MA	VISUAL	100%	-	MANUFACTURER'S DRG / APPROVED DATASHEET	MANUFACTURER'S DRG / APPROVED DATASHEET	-DO-		P/V	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	APPROVED DATASHEET	APPROVED DATASHEET / BEARING MANUF'S CATALOGUES	-DO-		P/V	-	-
		3.SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	-DO-		P/V	-	-
1.11	SLIP RING (WHEREVER APPLICABLE)	1.SURFACE COND.	MA	VISUAL	100%	-	-	-DO-	-DO-		P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-		P	-	-
		3.TEMP WITH-STAND CAPACITY	MA	ELECT.TEST	-DO-	-	MANUFACTURER'S STD / APPROVED DATASHEET	MANUFACTURER'S STD / APPROVED DATASHEET	-DO-		P/V	-	-
		4.HWIR	MA	-DO-	100%	-	-DO-	-DO-	-DO-		P/V	-	-
1.12	OIL SEALS & GASKETS	1.MATERIAL OF GASKET	MA	VISUAL	100%	-	MANUFACTURER'S DRG/SPECS	MANUFACTURER'S DRG / SPECS.	-DO-		P	-	-
		2.SURFACE COND.	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	-DO-		P	-	-
		3.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-		P	-	-




BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Hemant K.	Checked by:	<i>[Signature]</i>	RUNAL
Reviewed by:	<i>[Signature]</i>	P. Dutt	Reviewed by:	<i>[Signature]</i>	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 5 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	.	..			
					M	C/N				D	M	C	N	
2.0	IN PROCESS													
2.1	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNES	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK		P/W	-	-	
		2.DIMENSIONS	MA	MEASUREMENT	-DO-	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-		P	-	-	
2.2	MACHINING	1.FINISH	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK		P	-	-	
		2.DIMENSIONS	MA	MEASUREMENT	-DO-	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	-DO-		P	-	-	
		3.SHAFT SURFACE FLOWS	MA	PT	100%	100%	MANUFACTURER'S STD./ ASTM-E165	MANUFACTURER'S STD./ APPROVED DATASHEET.	-DO-	✓	P	V	-	
2.3	PAINTING	1.SURFACE PREPARATION	MA	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	SAME AS COL.7	LOG BOOK		P	-	-	
		2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MA	MEASUREMENT BY ELCOMETER	SAMPLE	-	-DO-	-DO-	-DO-		P	-	-	
		3.SHADE	MA	VISUAL	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		4.ADHESION	MA	CROSS CUTTING & TAPE TEST	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema R.	Checked by:		KUNAL CHANDNI
Reviewed by:		P. Dutt	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO :		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 6 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	.	..			
					M	C/N				D	M	C	N	
2.4	SHEET STACKING	1.COMPLETENESS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-	
		2.COMPRESSION & TIGHTENING	MA	MEASUREMENT	100%	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.5	WINDING	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-	
		2.CLEANLINESS	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		3.IR-HV-IR	CR	ELECT. TEST	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		4.RESISTANCE	CR	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	LOG BOOK	✓	P	V	-	
		5.INTERTURN INSULATION	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.6	IMPREGNATION	1.VISCOSITY	MA	PHY. TEST	AT STARTING	-	MANUFACTURER'S STANDARD	MANUFN'S STANDARD	LOG BOOK		P	-	-	THREE DIPS TO BE GIVEN
		2.TEMP. PRESSURE VACCUM	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		3.NO. OF DIPS	MA	-DO-	CONTINUOUS	CONTINUOUS	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-	




BHEL					
ENGINEERING			QUALITY		
Sign & Date	Name		Sign & Date	Name	
Prepared by: <i>Hu</i>	Hema K.		Checked by: <i>P.D. H</i>	KYNALE GANDHI	
Reviewed by: <i>02/3/2020</i>	P.D. H		Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-508-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 7 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	-	--			
					M	C/N				D	M	C	N	
2.7	COMPLETE STATOR ASSEMBLY	4.DURATION	MA	-DO-	CONTINUOUS	CONTINUOUS	-DO-	-DO-	LOG BOOK	✓	P	V	-	
		1.COMPACTNESS & CLEANLINESS	MA	VISUAL	100%	-	-DO-	-DO-	LOG BOOK		P	-	-	
2.8	BRAZING/COMPRESSION JOINT	1.COMPLETENESS	CR	-DO-	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		2.SOUNDNESS	CR	MALLET TEST & UT	100%	100%	-DO-	-DO-	LOG BOOK	✓	P	V	-	
		3.HV	MA	ELECT. TEST	100%	100%	-DO-	-DO-	LOG BOOK	✓	P	V	-	
2.9	COMPLETE ROTOR ASSEMBLY	1.RESIDUAL UNBALANCE	CR	DYN. BALANCE	-DO-	-	MANUFACTURER'S SPEC./ ISO 1940	MANUFACTURER'S DWG.	LOG BOOK		P	-	-	
		2.SOUNDNESS OF DIE CASTING	CR	ELECT. (GROWLER TEST)	100%	100%	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK	✓	P	V	-	
2.10	ASSEMBLY	1.ALIGNMENT	MA	MEAS.	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		2.WORKMANSHIP	MA	VISUAL	-DO-	-	-DO-	-DO-	LOG BOOK		P	-	-	
		3.AXIAL PLAY	MA	MEAS.	100%	100%	-DO-	-DO-	LOG BOOK	✓	P	V	-	
		4.DIMENSIONS	MA	-DO-	-DO-	-	MANUFACTURER'S DRG./ MANUFACTURER'S SPEC.	MANUFACTURER'S DRG/ RELEVANT IS	LOG BOOK		P	-	-	
		5.CORRECTNESS, COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE	MA	VISUAL	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK		P	-	-	
		6. RTD, 8TD & SPACE HEATER MOUNTING.	MA	VISUAL	100%	100%	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK	✓	P	V	-	

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hema K.	Checked by:		KUNAL GANDHI
Reviewed by:		P. Dutt	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 8 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	.	**			
					M	C/N				D	M	C	N	
3.0	TESTS	1.TYPE TESTS INCLUDING SPECIAL TESTS	MA	ELECT.TEST	1/TYPE/SIZE	1/TYPE/SIZE	IS-325//IS-12615/APPROVED DATASHEET	IS-325//IS-12615/APPROVED DATASHEET	TEST REPORT		P	W*	W*	* NOTE - 1
		2.ROUTINE TESTS INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	-DO-	-DO-	-DO-		P	V/W ⁵	V/W ⁵	*NOTE - 2
		3.VIBRATION & NOISE LEVEL	MA	-DO-	100%	100%	IS: 12075 / IEC 60034-14 & IS-12065	IS: 12075 / IEC 60034-14 & IS-12065	-DO-		P	V/W ⁴	V/W ⁵	*NOTE - 2
		4.OVERALL DIMENSIONS AND ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET &	TEST/INSPC. REPORT		P	W	-	
		5.DEGREE OF PROTECTION	MA	ELECT. & MECH. TEST	1/TYPE/ SIZE	1/TYPE/ SIZE	IEC 60034-5//IS-12615	APPROVED DATASHEET	TC	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		6. MEASUREMENT OF RESISTANCE OF RTD & BTD	MA	-DO-	100%	100%	IS-325//IS-12615//IEC-60034 PART-1//S: 12802	IS-325//IS-12615//IEC-60034 PART-1//S: 12802	-DO-		P	V/W ⁵	V/W ⁵	* NOTE - 2
		7. MEASUREMENT OF RESISTANCE, IR OF SPACE HEATER	MA	-DO-	100%	100%	IS-325//IS-12615//IEC-60034 PART-1	IS-325//IS-12615//IEC-60034 PART-1	-DO-		P	V/W ⁵	V/W ⁵	* NOTE - 2
		8. NAME PLATE DETAILS	MA	VISUAL	100%	100%	IS-325//IS-12615& DATA SHEET	IS-325//IS-12615 & DATA SHEET	TEST/INSPC. REPORT		P	V/W ⁵	V/W ⁵	* NOTE - 2
		9.EXPLOSION FLAME PROOF NESS (IF SPECIFIED)	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	1/TYPE	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	V	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		10. PAINT SHADE, THICKNESS & FINISH	MA	VISUAL & MEASUREMENT BY ELKOMETER	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC		P	WS	WS	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY * NOTE - 2

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	<i>Hema R.</i>	Checked by:	<i>[Signature]</i>	<i>Kunal</i>
Reviewed by:	<i>[Signature]</i>	<i>P. Datta</i>	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	SHEET 9 OF 9	




SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	.	..		
					M	C/N				D	M	C	N
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING.	AS PER MANUFACT. STANDARD / APPROVED CROSS SECTION DRAWING.	INSPC. REPORT		P	W	.

NOTES:

- 1 DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
- 2 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
- 6 IN CASE , ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.

LEGENDS:

*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, S: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM. W: WITNESS. V: VERIFICATION. AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:		Hemma K.	Checked by:		KUNAL
Reviewed by:		P. Dutt	Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C-3

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C-3

TECHNICAL SPECIFICATION (ELECTRICAL PORTION)

247927/2021/PS-PEM-MAX



**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
COMPRESSED AIR SYSTEM
KAHALGAON TPS – FGD**

SPECIFICATION NO.

VOLUME NO. : II-B

SECTION: I

REV NO. : 00 DATE:

SHEET: 1 OF 1

CONTENTS

SECTION	TITLE	NO OF SHEETS
I	SPECIFIC TECHNICAL REQUIREMENTS	3
I	ELECTRICAL SCOPE BETWEEN BHEL & VENDOR (ANNEURE-I)	2
I	ELECTRICAL LOAD DATA FORMAT (ANNEXURE-II)	1
I	CABLE SCHEDULE FORMAT (ANNEXURE-III)	1
I	TECHNICAL SPECIFICATION FOR MOTORS	10
I	MOTOR DATASHEET-A	1
I	MOTOR DATASHEET-C	2
II	STANDARD SPECIFICATION FOR LV MOTORS	5
~~II~~	~~REFERENCE QUALITY PLAN~~	~~3~~
II	TECHNICAL SPECIFICATION FOR CABLE TRAYS & ACCESSORIES	9

The requirements mentioned in Section-I shall prevail and govern in case of conflict between the same and the corresponding requirements mentioned in the descriptive portion in Section-II.

247927/2021/PS-PEM-MAX:



**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
COMPRESSED AIR SYSTEM
KAHALGAON TPS – FGD**

SPECIFICATION NO.

VOLUME NO. : **II-B**SECTION : **I**REV NO. : **00** DATE :

SHEET : 1 OF 3

**TECHNICAL SPECIFICATION
FOR
COMPRESSED AIR SYSTEM
(ELECTRICAL PORTION)**

247927/2021/PS-PEM-MAX:

2021/PS-PEM-MAX: 07/05/17		SPECIFICATION NO.	
	ELECTRICAL EQUIPMENT SPECIFICATION FOR COMPRESSED AIR SYSTEM KAHALGAON TPS – FGD	VOLUME NO. : II-B	
		SECTION : I	
		REV NO. : 00 DATE :	
		SHEET : 2 OF 3	
1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:			
a) Services and equipment as per “Electrical Scope between BHEL and Vendor”. b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge. c) Supply of mandatory spares as specified in the specifications of mechanical equipments. d) Electrical load requirement for COMPRESSED AIR SYSTEM (all AC & DC loads at different voltage levels like 415V AC, 240 V AC, 220 V DC etc). e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information. f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL. h) Motor shall meet minimum requirement of motor specification. i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL. j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.			
2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:			
Refer “Electrical Scope between BHEL and Vendor”.			
3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID			
3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate. 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.			

247927/2021/PS-PEM-MAX:



**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
COMPRESSED AIR SYSTEM
KAHALGAON TPS – FGD**

SPECIFICATION NO.

VOLUME NO. : **II-B**SECTION : **I**REV NO. : **00** DATE :

SHEET : 3 OF 3

4.0 List of enclosures :

- a) Electrical scope between BHEL & vendor (Annexure –I)
- b) Electrical Load data format (Annexure –II)
- c) BHEL cable listing format (Annexure –III)
- d) Technical specification for motors.
- e) Datasheets & quality plan for motors.

ANNEXURE-I

REV-0

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)

PACKAGE: COMPRESSED AIR SYSTEM

SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT: KAHALGAON TPS – FGD

<u>S.NO</u>	<u>DETAILS</u>	<u>SCOPE SUPPLY</u>	<u>SCOPE E&C</u>	<u>REMARKS</u>
1	11 kV/ 6.6 KV / 3.3 KV / 415 V Switchgear	BHEL	BHEL	240 V AC (supply feeder)/415 V AC (3 PHASE 4 WIRE) supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motors.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL Vendor BHEL	1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by Vendor.
4	Junction box for control & instrumentation cable	Vendor	Vendor	Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 10-12 mtrs) and trunk cable.
5	Any special type of cable like compensating, co-axial, prefab, MICC, etc.	Vendor	Vendor	Refer C&I portion of specification for scope of fibre Optical cables if used between PLC/ microprocessor & DCS.
6	Cable trays, accessories & cable trays supporting system. 100/50 mm cable trays/Conduits/Galvanised steel cable troughs for local cabling	BHEL Vendor	BHEL Vendor	Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs as per approved layout drawing during contract stage.
7	Cable glands, lugs & bimetallic strip for equipments supplied by Vendor	Vendor	Vendor	1. Double compression Ni-Cr plated brass cable glands 2. Solder less crimping type heavy duty tinned copper lugs for power & control cables.
8	Conduit and conduit accessories for cabling between equipments supplied by vendor.	Vendor	Vendor	Conduits shall be medium duty, hot dip galvanised cold rolled mild steel rigid conduit as per IS: 9537.
9	Lighting	BHEL	BHEL	--
10	Equipment grounding (including electronic earthing) & lightning protection	BHEL	BHEL	Refer note no. 4 for electronic earthing
11	Below grade grounding	BHEL	BHEL	--
12	Motors with base plate and foundation hardware	Vendor	Vendor	Makes shall be subject to customer/ BHEL approval at contract stage.
13	Mandatory spares	Vendor	-	Vendor to quote as per specification.
14	Recommended O & M spares	Vendor	-	As specified elsewhere in specification

ANNEXURE-I

REV-0

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)

PACKAGE: COMPRESSED AIR SYSTEM

SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT: **KAHALGAON TPS – FGD**

15	Any other equipment/material/service required for completeness of system based on the system offered by vendor (to ensure trouble free and efficient operation of the system).	Vendor	Vendor	--
16	a. Input cable schedules (C & I) b. Cable interconnection detail for the above c. Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for Control and Instrumentation Cable and electronic earthing cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.
17	Cabling layout drawings	BHEL/ Vendor	-	a. In case of Compressor are HT motors, cable tray/trench layout inside compressed air building shall be prepared by BHEL. Vendor to furnish drawing (both in print form as well as in AUTOCAD) of compressor room layout clearly indicating all motors, panels, JB's etc. which require cabling along with their terminal box/location/ Foundation etc. b. In case of Compressor are LT motors, for ensuring cabling requirements are met, vendor shall prepare & submit cable tray/trench & equipment layout (both in print form as well as in AUTOCAD) of the complete plant (including electrical area) indicating location and identification of all equipment requiring cabling for BHEL review & approval.
18	Electrical equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipments/items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.
3. In case the requirement of junction box arises on account of power cable size mismatch due to vendor engineering at later stage, vendor shall supply the junction box for suitable termination.
4. Vendor shall indicate location of Electronic Earth pit in their Civil assignment drawing.

[illegible]

ANNEXURE III

CABLE SCHEDULE FORMAT

[illegible]

SECTION-I



SUB-SECTION-II-E2

MOTORS

LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(1A)-2

SECTION-I



SECTION-I

एनटीपीसी
NTPC

CLAUSE NO.	TECHNICAL REQUIREMENTS												
	MOTORS												
1.00.00	GENERAL REQUIREMENTS												
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.												
1.02.00	All equipment's shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.												
1.03.00	Contactor shall provide fully compatible electrical system, equipment's, accessories and services.												
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.												
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.												
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for Contactors equipment and systems shall be under the Contactor scope.												
1.07.00	Degree of Protection Degree of protection for various enclosures as per IEC60034-05 shall be as follows :- <table style="width: 100%; margin-top: 10px;"> <tr> <td>i) Indoor motors</td><td style="text-align: center;">-</td><td style="text-align: right;">IP 54</td></tr> <tr> <td>ii) Outdoor motors</td><td style="text-align: center;">-</td><td style="text-align: right;">IP 55</td></tr> <tr> <td>iii) Cable box-indoor area</td><td style="text-align: center;">-</td><td style="text-align: right;">IP 54</td></tr> <tr> <td>iv) Cable box-Outdoor area</td><td style="text-align: center;">-</td><td style="text-align: right;">IP 55</td></tr> </table>	i) Indoor motors	-	IP 54	ii) Outdoor motors	-	IP 55	iii) Cable box-indoor area	-	IP 54	iv) Cable box-Outdoor area	-	IP 55
i) Indoor motors	-	IP 54											
ii) Outdoor motors	-	IP 55											
iii) Cable box-indoor area	-	IP 54											
iv) Cable box-Outdoor area	-	IP 55											
2.00.00	CODES AND STANDARDS												
	1) Three phase induction motors : IS/IEC:60034 2) Single phase AC motors : IS/ IEC:60034 3) Crane duty motors : IS:3177, IS/IEC:60034 4) DC motors/generators : IS:4722, IS/IEC:60034 5) Energy Efficient motors : IS 12615, IEC:60034-30												
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2												
	SUB SECTION-II-E2 MOTORS												
	PAGE 1 OF 9												

CLAUSE NO.	TECHNICAL REQUIREMENTS			
3.00.00	TYPE			
3.01.00	AC Motors: a) Squirrel cage induction motor suitable for direct-on-line starting. b) Continuous duty LT motors upto 200 KW Output rating (at 50 deg.C ambient temperature), shall be Premium Efficiency class-IE3 , conforming to IS 12615, or IEC:60034-30. c) Crane duty motors shall be slip ring/ squirrel cage Induction motor as per the requirement. d) Motor operating through variable frequency drives shall be suitable for inverter duty. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable.			
3.02.00	DC Motors	Shunt wound.		
4.00.00	RATING (a) Continuously rated (S1). However, crane motors shall be rated for S4 duty, 40% cyclic duration factor. (b) Whenever the basis for motor or driven equipment ratings are not specified in the corresponding mechanical specification sub-sections, maximum continuous motor ratings shall be at least 10% above the maximum load demand of the driven equipment under entire operating range including voltage and frequency variations.			
5.00.00	TEMPERATURE RISE Air cooled motors 70 deg. C by resistance method for both thermal class 130(B) & 155(F) insulation. Water cooled 80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for both thermal class 130(B) & 155(F) insulation.			
6.00.00	OPERATIONAL REQUIREMENTS			
6.01.00	Starting Time			
6.01.01	For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.			
6.01.02	For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.			
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2	SUB SECTION-II-E2 MOTORS	PAGE 2 OF 9

SECTION-I

CLAUSE NO.	TECHNICAL REQUIREMENTS
6.01.03	For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.
6.01.04	Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.
6.02.00	Torque Requirements
6.02.01	Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor full load torque.
6.02.02	Pull out torque at rated voltage shall not be less than 205% of full load torque. It shall be 275% for crane duty motors.
6.03.00	Starting voltage requirement (a) Up to 85% of rated voltage for ratings below 110 KW (b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW (c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW (d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW (e) Up to 75 % of rated voltage for ratings above 4000KW
7.00.00	DESIGN AND CONSTRUCTIONAL FEATURES
7.01.00	Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable.
7.02.00	All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS:2148 as detailed below (a) Fuel oil area : Group – IIB (b) Hydrogen generation : Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA /IEC60034)
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2
SUB SECTION-II-E2 MOTORS	PAGE 3 OF 9



SECTION-I

CLAUSE NO.	TECHNICAL REQUIREMENTS
7.03.00 (a) Type (b) Starting duty (c) 11kV & 3.3 kV AC motors (d) 240VAC, 415V AC & 220V DC motors 7.04.00 7.05.00 7.06.00 7.07.00 7.08.00 7.09.00 7.10.00	Winding and Insulation Non-hygroscopic, oil resistant, flame resistant Two hot starts in succession, with motor initially at normal running temperature. Thermal class 155 (F) insulation. The winding insulation process shall be total Vacuum Pressure Impregnated i.e resin poor method. The lightning Impulse & interturn insulation surge withstand level shall be as per IEC-60034 part-15. Thermal Class (B) or better Motors rated above 1000KW shall have insulated bearings to prevent flow of shaft currents. Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature. Noise level for all the motors shall be limited to 85 dB(A) except for BFP motor for which the maximum limit shall be 90dB(A). Vibration shall be limited within the limits prescribed in IS:12075 / IEC 60034-14 . Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads. In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer with adjustable alarm contact and preferably 2 numbers duplex platinum resistance type temperature detectors. Motor body shall have two earthing points on opposite sides. 11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds. 3.3 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Employer shall provide termination kit for the offered Terminal box. The offered Terminal Box shall be suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non magnetic material for single core cables) shall be provided.
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 SUB SECTION-II-E2 MOTORS PAGE 4 OF 9



SECTION-I

CLAUSE NO.	TECHNICAL REQUIREMENTS
7.11.00	The spacing between gland plate & centre of terminal stud shall be as per Table-I.
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 3.3 kV /415V systems without any injurious effect on its life.
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.
7.15.00	The size and number of cables (for HT motors) to be intimated to the successful Contactor during detailed engineering and the Contactor shall provide terminal box suitable for the same.
8.00.00	The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance): (a) From 50KW & upto 110KW : 11.0 (b) From 110 KW & upto 200 KW : 9.0 (c) Above 200 KW & upto 1000KW : 10.0 (d) From 1001KW & upto 4000KW : 9.0 (e) Above 4000KW : 6 to 6.5
10.00.00	TYPE TEST
10.01.00	HT MOTORS
10.01.01	The Contactor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The Contactor shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the Employer's engineer.
10.01.02	The type tests shall be carried out in presence of the Employer's representative, for which minimum 15 days notice shall be given by the Contactor. The Contactor shall obtain the Employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.
10.01.03	In case the Contactor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2
SUB SECTION-II-E2 MOTORS	PAGE 5 OF 9

SECTION-I

CLAUSE NO.	TECHNICAL REQUIREMENTS
10.01.04 10.01.05 10.01.06	the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contactor. Further the Contactor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval. LIST OF TYPE TESTS TO BE CONDUCTED The following type tests shall be conducted on each type and rating of HT motor (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test(subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp., coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose. LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of HT motor (a) Degree of protection test for the enclosure followed by IR, HV and no load run test.
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 SUB SECTION-II-E2 MOTORS PAGE 6 OF 9

SECTION-I

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
	(b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on inter-turn insulation shall be as per clause no. 4.2 of IEC 60034, part-15	
10.02.00	LT Motors	
10.02.01	LT Motors supplied shall be of type tested design. During detailed engineering, the Contactor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.	
10.02.02	However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.	
10.02.03	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of LT motor of above 50 KW only 1. Measurement of resistance of windings of stator and wound rotor. 2. No load test at rated voltage to determine input current power and speed 3. Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) 4. Full load test to determine efficiency power factor and slip 5. Temperature rise test 6. Momentary excess torque test. 7. High voltage test 8. Test for vibration severity of motor. 9. Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section)	
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2
SUB SECTION-II-E2 MOTORS		PAGE 7 OF 9

एनटीपीसी
NTPC

CLAUSE NO.		TECHNICAL REQUIREMENTS			
		10. Test for degree of protection and 11. Overspeed test. 12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1			
10.03.00		All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.			
10.04.00		The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.			
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2		SUB SECTION-II-E2 MOTORS	
				PAGE 8 OF 9	

CLAUSE NO.	TECHNICAL REQUIREMENTS		SECTION-I	एनटीपीसी NTPC																												
	TABLE - I DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS <table><tr><th>Motor MCR in KW of</th><th>Minimum distance between centre stud and gland plate in mm As per manufacturer's practice.</th></tr><tr><td>UP to 3 KW</td><td></td></tr><tr><td>Above 3 KW - upto 7 KW</td><td>85</td></tr><tr><td>Above 7 KW - upto 13 KW</td><td>115</td></tr><tr><td>Above 13 KW - upto 24 KW</td><td>167</td></tr><tr><td>Above 24 KW - upto 37 KW</td><td>196</td></tr><tr><td>Above 37 KW - upto 55 KW</td><td>249</td></tr><tr><td>Above 55 KW - upto 90 KW</td><td>277</td></tr><tr><td>Above 90 KW - upto 125 KW</td><td>331</td></tr><tr><td>Above 125 KW-upto 200 KW</td><td>203</td></tr></table> For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm. PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE: NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows: <table><tr><th>Motor MCR in KW</th><th>Clearance</th></tr><tr><td>UP to 110 KW</td><td>10mm</td></tr><tr><td>Above 110 KW and upto 150 KW</td><td>12.5mm</td></tr><tr><td>Above 150 KW</td><td>19mm</td></tr></table>				Motor MCR in KW of	Minimum distance between centre stud and gland plate in mm As per manufacturer's practice.	UP to 3 KW		Above 3 KW - upto 7 KW	85	Above 7 KW - upto 13 KW	115	Above 13 KW - upto 24 KW	167	Above 24 KW - upto 37 KW	196	Above 37 KW - upto 55 KW	249	Above 55 KW - upto 90 KW	277	Above 90 KW - upto 125 KW	331	Above 125 KW-upto 200 KW	203	Motor MCR in KW	Clearance	UP to 110 KW	10mm	Above 110 KW and upto 150 KW	12.5mm	Above 150 KW	19mm
Motor MCR in KW of	Minimum distance between centre stud and gland plate in mm As per manufacturer's practice.																															
UP to 3 KW																																
Above 3 KW - upto 7 KW	85																															
Above 7 KW - upto 13 KW	115																															
Above 13 KW - upto 24 KW	167																															
Above 24 KW - upto 37 KW	196																															
Above 37 KW - upto 55 KW	249																															
Above 55 KW - upto 90 KW	277																															
Above 90 KW - upto 125 KW	331																															
Above 125 KW-upto 200 KW	203																															
Motor MCR in KW	Clearance																															
UP to 110 KW	10mm																															
Above 110 KW and upto 150 KW	12.5mm																															
Above 150 KW	19mm																															
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2	SUB SECTION-II-E2 MOTORS	PAGE 9 OF 9																													

247927/2021/PS-PEM-MAX



LV MOTORS DATA SHEET-A

**2X660 MW NTPC BARH STPP STAGE II (FGD System
Package)**

SPECIFICATION NO.

VOLUME

II B

SECTION

D

REV NO.

DATE:

SHEET

1

OF

1

- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : 200KW *
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Details of supply system
 - a) Rated voltage (with variation) : 415V $\pm$ 10%
 - b) Rated frequency (with variation) : 50 Hz + 3 % to - 5%
 - c) Combined voltage & freq. variation : 10% (sum of absolute values)
 - d) System fault level at rated voltage : 50 kA for 1 sec
 - e) Short time rating for terminal boxes
 - o 110 kW and above (Breaker : 50 KA for 0.25 sec.
Controlled)
 - o Below 110 kW (Contactor : 50 KA protected by HRC fuse
Controlled)
 - f) LV System grounding : Solidly
- 5.0 Winding & Insulation : Class F with temp rise limited to class B
- 6.0 Minimum voltage for starting : 85% for motor ratings below 110kW
(As percentage of rated voltage) 80% for motor ratings from 110kW to 200kW.
- 7.0 Power cables data : Shall be given during detailed engg.
- 8.0 Earth Conductor Size & Material : Shall be given during detailed engg.
- 9.0 Space heater supply (for motors $\geq$ 30kW) : 240 V, 1 ϕ , 50 Hz
- 10.0 Rating up to which Single phase motor : Acceptable below 0.2 kW
- 11.0 Locked rotor current
 - a) Limit as percentage of FLC : As per IS 12615
- 12.0 Makes : BHEL/ Customer approval (Package owner to take care)
- 13.0 Paint shade : Blue (RAL 5012) – Corrosion proof
- 14.0 Degree Of protection for motor/ terminal box : Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-
 - i) Indoor motors - IP 54
 - ii) Outdoor motors - IP 55
 - iii) Cable box-indoor area - IP 54
 - iv) Cable Box-Outdoor area - IP 55

*** LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615**

15.0 TESTING REQUIREMENTS: IN LINE WITH SPECIFICATION

247927/2021/PS-PEM-MAX

	MOTORS DATA SHEET – C 2X660 MW NTPC BARH STPP STAGE II (FGD System Package)	SPECIFICATION NO.
		VOLUME II B
		SECTION D
		REV NO. 00 DATE
		SHEET 1 OF 2

S. No.	Description		Data to be filled by successful bidder
A.	General		
1	Manufacturer & country of origin		
2	Motor type		
3	Type of starting		
4	Name of the equipment driven by motor & Quantity		
5	Maximum Power requirement of driven equipment		
6	Rated speed of Driven Equipment		
7	Design ambient temperature		
B.	Design and Performance Data		
1	Frame size & type designation		
2	Type of duty		
3	Rated Voltage		
4	Permissible variation for		
5	a	Voltage	
6	b	Frequency	
7	c)	Combined voltage & frequency	
8	Rated output at design ambient temp (by resistance method)		
9	Synchronous speed & Rated slip		
10	Minimum permissible starting voltage		
11	Starting time in sec with mechanism coupled		
12	a) At rated voltage		
13	b) At min starting voltage		
14	Locked rotor current as percentage of FLC (including IS tolerance)		
15	Torque		
	a) Starting		
	b) Maximum		
16	Permissible temp rise at rated output over ambient temp & method		
17	Noise level at 1.0 m (dB)		
18	Amplitude of vibration		
19	Efficiency & P.F. at rated voltage & frequency		
	a) At 100% load		
	c) At 75% load		

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

247927/2021/PS-PEM-MAX

	MOTORS DATA SHEET – C 2X660 MW NTPC BARH STPP STAGE II (FGD System Package)	SPECIFICATION NO.
		VOLUME II B
		SECTION D
		REV NO. 00 DATE
		SHEET 2 OF 2

S. No.	Description	Data to be filled by successful bidder
	c) At starting	
C.	Constructional Features	
1	Method of connection of motor driven equipment	
2	Applicable Standard	
3	DOP of Enclosure	
4	Method of cooling	
5	Class of insulation	
6	Main terminal box	
	a) Type	
	b) Power Cable details (Conductor, size, armour/unarmour)	
	c) Cable Gland & lugs details (Size, type & material)	
	d) Permissible Fault level (kArms & duration in sec)	
7	Space heater details (Voltage & watts)	
8	Flame proof motor details (if applicable)	
	a) Enclosure	
	b) suitability for hazardous area	
	i Zone	O / I / II
	ii Group	IIA / IIB / IIC
9	No. of Stator winding	
10	Winding connection	
11	Kind of rotor winding	
12	Kind of bearings	
13	Direction of rotation when viewed from NDE	
14	Paint Shade & type	
15	Net weight of motor	
16	Outline mounting drawing No (To be enclosed as annexure)	
D.	Characteristic curves/ drawings (To be enclosed for motors of rating $\geq 55\text{KW}$)	
	a) Torque speed characteristic	
	b) Thermal withstand characteristic	
	c) Current vs time	
	d) Speed vs time	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

247927/2021/PS-PEM-MAX:



GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.
PE-SS-999-506-E101

VOLUME NO. : II-B

SECTION : D

REV NO. : 00 DATE : 29/08/2005

SHEET : 1 OF 1

GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.: PE-SS-999-506-E101 Rev 00

247927/2021/PS-PEM-MAX:

2021/PS-PEM-MAX : 07/11/2021		SPECIFICATION NO. PE-SS-999-506-E101																															
		VOLUME NO. : II-B																															
		SECTION : D																															
		REV NO. : 00 DATE : 29/08/2005																															
GENERAL TECHNICAL REQUIREMENTS		SHEET : 1 OF 4																															
FOR																																	
LV MOTORS																																	
1.0 INTENT OF SPECIFIATION																																	
The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer’s work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station. Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.																																	
2.0 CODES AND STANDARDS																																	
Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards: <table><tr><td>IS:325</td><td>Three phase Induction motors</td></tr><tr><td>IS : 900</td><td>Code of practice for installation and maintenance of induction motors</td></tr><tr><td>IS: 996</td><td>Single phase small AC and universal motors</td></tr><tr><td>IS: 4722</td><td>Rotating Electrical machines</td></tr><tr><td>IS: 4691</td><td>Degree of Protection provided by enclosures for rotating electrical machines</td></tr><tr><td>IS: 4728</td><td>Terminal marking and direction of rotation rotating electrical machines</td></tr><tr><td>IS: 1231</td><td>Dimensions of three phase foot mounted induction motors</td></tr><tr><td>IS: 8789</td><td>Values of performance characteristics for three phase induction motors</td></tr><tr><td>IS: 13555</td><td>Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment</td></tr><tr><td>IS: 2148</td><td>Flame proof enclosures for electrical appliance</td></tr><tr><td>IS: 5571</td><td>Guide for selection of electrical equipment for hazardous areas</td></tr><tr><td>IS: 12824</td><td>Type of duty and classes of rating assigned</td></tr><tr><td>IS: 12802</td><td>Temperature rise measurement for rotating electrical machines</td></tr><tr><td>IS: 12065</td><td>Permissible limits of noise level for rotating electrical machines</td></tr><tr><td>IS: 12075</td><td>Mechanical vibration of rotating electrical machines</td></tr></table> In case of imported motors, motors as per IEC-34 shall also be acceptable.				IS:325	Three phase Induction motors	IS : 900	Code of practice for installation and maintenance of induction motors	IS: 996	Single phase small AC and universal motors	IS: 4722	Rotating Electrical machines	IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines	IS: 4728	Terminal marking and direction of rotation rotating electrical machines	IS: 1231	Dimensions of three phase foot mounted induction motors	IS: 8789	Values of performance characteristics for three phase induction motors	IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment	IS: 2148	Flame proof enclosures for electrical appliance	IS: 5571	Guide for selection of electrical equipment for hazardous areas	IS: 12824	Type of duty and classes of rating assigned	IS: 12802	Temperature rise measurement for rotating electrical machines	IS: 12065	Permissible limits of noise level for rotating electrical machines	IS: 12075	Mechanical vibration of rotating electrical machines
IS:325	Three phase Induction motors																																
IS : 900	Code of practice for installation and maintenance of induction motors																																
IS: 996	Single phase small AC and universal motors																																
IS: 4722	Rotating Electrical machines																																
IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines																																
IS: 4728	Terminal marking and direction of rotation rotating electrical machines																																
IS: 1231	Dimensions of three phase foot mounted induction motors																																
IS: 8789	Values of performance characteristics for three phase induction motors																																
IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment																																
IS: 2148	Flame proof enclosures for electrical appliance																																
IS: 5571	Guide for selection of electrical equipment for hazardous areas																																
IS: 12824	Type of duty and classes of rating assigned																																
IS: 12802	Temperature rise measurement for rotating electrical machines																																
IS: 12065	Permissible limits of noise level for rotating electrical machines																																
IS: 12075	Mechanical vibration of rotating electrical machines																																
3.0 DESIGN REQUIREMENTS																																	
3.1 Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A																																	
3.2 Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information ~~Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.~~																																	
3.3 Starting Requirements																																	
3.3.1 Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.																																	
3.3.2 Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.																																	

247927/2021/PS-PEM-MAX:

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101 VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 29/08/2005 SHEET : 2 OF 4
	The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors. 3.3.3 The following frequency of starts shall apply i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature. ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour) iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor 3.4 Running Requirements 3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor. 3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs. 3.5 Stress During bus Transfer 3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer. 3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition. 3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065. 3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075. 4.0 CONSTRUCTIONAL FEATURES 4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy 4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362. Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled 4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.	

247927/2021/PS-PEM-MAX:

2021/PS-PEM-MAX : 07/05/2021		SPECIFICATION NO. PE-SS-999-506-E101	
	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	VOLUME NO. : II-B	
		SECTION : D	
		REV NO. : 00 DATE : 29/08/2005	
		SHEET : 3 OF 4	
4.4.	Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.		
4.5	Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.		
4.6	In case Class ‘F’ insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class ‘B’ insulation. In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.		
4.7	Terminals and Terminal Boxes		
4.7.1	Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A. Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet “A”.		
4.7.2	unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.		
4.7.3	Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.		
4.7.4	Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.		
4.7.5	Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.		
4.7.6	Degree of protection for terminal boxes shall be IP 55 as per IS 4691.		
4.7.7	Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.		
4.7.8.	Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.		
4.7.9	Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.		
4.8	Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.		
4.9	General		

247927/2021/PS-PEM-MAX:

	GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101 VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 29/08/2005 SHEET : 4 OF 4
	4.9.1 Motors provided for similar drives shall be interchangeable. 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors. 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above. 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956. 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz. 4.9.6 Name plate with all particulars as per IS: 325 shall be provided 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions. 5.0 INSPECTION AND TESTING 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied. 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser. 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan. 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A. 6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT a) OGA drawing showing the position of terminal boxes, earthing connections etc. b) Arrangement drawing of terminal boxes. c) Characteristic curves: (To be given for motor above 55 kW unless otherwise specified in Data Sheet). i) Current vs. time at rated voltage and minimum starting voltage. ii) Speed vs. time at rated voltage and minimum starting voltage. iii) Torque vs. speed at rated voltage and minimum voltage. For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling. iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.	

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
2.01.06	Boiler Area Cable trays in boiler & ESP area shall be supported from the boiler and ESP structures. The same shall be coordinated with SG/ESP contractor. Cable trays in these areas shall be in vertical formation to avoid dust accumulation. No cable trenches shall be provided in boiler/ESP area.		
2.01.07	Two separate cable routes shall be provided for cable routing of working and standby drives or different set/group (say 50% capacity) of auxiliaries.		
2.01.08	OffSite Area For feeder in bidder's scope for offsite areas, overhead cable tray arrangement shall be followed. However cable trenches/slit may also be acceptable, for some areas, if found to be required during detailed engineering. Cable trenches provided shall be separated from fuel oil area to avoid oil accumulation.		
2.01.09	The cable slits to be used for motor/equipment power/control supply shall be sand filled & covered with PCC after cabling.		
2.01.10	Sizing criteria, derating factors for the cables shall be met as per respective chapters. However for the power cables, the minimum conductor size shall be 6 sq.mm. for aluminium conductor and 2.5 sq.mm. for copper conductor cable.		
2.01.11	Conscious exceptions to the above guidelines may be accepted under special conditions but suitable measures should be taken at such location to: • Meet all safety requirements • Safeguard against fire hazards, mechanical damage, flooding of water, oil accumulation, electrical faults/interferences, etc		
3.00.00	EQUIPMENT DESCRIPTION		
3.01.00	Cable trays, Fittings & Accessories		
3.01.01	Cable trays shall be ladder/perforated type as specified complete with matching fittings (like brackets, elbows, bends, reducers, tees, crosses, etc.) accessories (like side coupler plates, etc. and hardware (like bolts, nuts, washers, G.I. strap, hook etc.) as required. Cable tray shall be ladder type for power & control cables and perforated for instrumentation cables.		
3.01.02	Cable trays, fittings and accessories shall be fabricated out of rolled mild steel sheets free from flaws such as laminations, rolling marks, pitting etc. These (including hardware) shall be hot dip galvanized as per Clause No. 3.13.00 of this chapter.		
3.01.03	Cable trays shall have standard width of 150 mm, 300 mm & 600 mm and standard lengths of 2.5 metre. Thickness of mild steel sheets used for fabrication of cable trays and fittings shall be 2 mm. The thickness of side coupler plates shall be 3 mm.		
3.01.04	Cable troughs shall be required for branching out few cables from main cable route. These shall be U-shaped, fabricated of mild steel sheets of thickness 2 mm and shall be hot dip galvanized as per Clause No. 3.13.00 of this chapter. Troughs shall be standard width of 50 mm & 75 mm with depth of 25 mm.		
3.01.05	The tolerance for cable tray and accessories shall be as per IS 2102 (Part-1). Tolerance Class: - Coarse		
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 3 of 69

247927/2021/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
3.02.00 3.02.01 3.02.02 3.02.03	Support System for Cable Trays Cable tray support system shall be pre-fabricated out of single sheet as per enclosed tender drawings. Support system for cable trays shall essentially comprise of the two components i.e. main support channel and cantilever arms. The main support channel shall be of two types : (i) C1:- having provision of supporting cable trays on one side and (ii) C2:-having provision of supporting cable trays on both sides. The support system shall be the type described hereunder - Cable supporting steel work for cable racks/cables shall comprise of various channel sections, cantilever arms, various brackets, clamps, floor plates, all hardwares such as lock washers, hexagon nuts, hexagon head bolt, support hooks, stud nuts, hexagon head screw, channel nut, channel nut with springs, fixing studs, etc. - The system shall be designed such that it allows easy assembly at site by using bolting. All cable supporting steel work, hardwares fittings and accessories shall be prefabricated factory galvanised. - The main support and cantilever arms shall be fixed at site using necessary brackets, clamps, fittings, bolts, nuts and other hardware etc. to form various arrangements required to support the cable trays. Welding of the components shall not be allowed. However, welding of the bracket (to which the main support channel is bolted) to the overhead beams, structural steel, insert plates or reinforcement bars will be permitted. Any cutting or welding of the galvanised surface shall be brushed and red lead primer, oil primer & aluminium paint shall be applied - All steel components, accessories, fittings and hardware shall be hot dip galvanised after completing welding, cutting, drilling and other machining operation. - The typical arrangement of flexible support system is shown in the enclosed drawings and described briefly below: The main support channel and cantilever arms shall be fabricated out of 2.5 thick rolled steel sheet conforming to IS 1079. - Cantilever arms of 320 mm, 620mm and 750 mm in length are required, and shall be as shown in the enclosed drawing. The arm portion shall be suitable for assembling the complete arm assembly on to component constructed of standard channel section. The back plate shall allow sufficient clearance for fixing bolt to be tightened with tray in position. - Support system shall be able to withstand - weight of the cable trays - weight of the cables (75 Kg/Metre run of each cable tray) - Concentrated load of 75 Kg between every support span. - Factor of safety of minimum 1.5 shall be considered. The size of structural steel members or thickness of sheet steel of main support channel and cantilever arms and other accessories as indicated above or in the enclosed drawings are indicative only. Nevertheless, the support system shall be designed by the bidder to fully meet the requirements of type tests as specified. In case the system fails in the tests, the components design modification shall be done by the Bidder without any additional cost to	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
Page 4 of 69		

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	the Employer. The bidder shall submit the detailed drawings of the system offered by him alongwith the bid.		
3.02.04	Four legged structure shall be provided wherever there is change in elevation and change in direction		
3.02.05	FOR COAL HANDLING PLANT/FGD PLANT AREA THE FOLLOWING SHALL ALSO BE APPLICABLE: a) All overhead cable routes shall be along the route of the conveyor gallery on separate supporting structures and cables shall be laid in vertical trays. The bottom of the steel shall be such that the existing facilities, movement of trucks/human beings etc. does not get affected. The cable trestle shall have a minimum 600mm clear walk way and shall have maintenance platforms as required. The bottom of the steel supporting structure shall be generally at 3.0M above the grade level except for rail/road crossings where it shall be at 8.0M above grade level. Tap offs from the overhead cable trestle can be through shallow trenches with prior approval of the Employer. Directly buried cable, if essential, shall not have concentration of more than 4 cables on one route. b) Cable trenches shall be provided only in Switchgear/MCC rooms. c) Cables shall not be routed through the conveyor galleries except for the equipment located in the conveyor galleries for a particular conveyor i.e. protection switches, receptacles etc. d) Cables for PCS and BSS shall be routed along the conveyors through GI conduits.		
3.03.00	Pipes, Fittings & Accessories		
3.03.01	Pipes offered shall be complete with fittings and accessories (like tees, elbows, bends, check nuts, bushings, reducers, enlargers, coupling caps, nipples etc.) The size of the pipe shall be selected on the basis of maximum 40% fill criteria		
3.03.02	GI Pipes shall be of medium duty as per IS: 1239		
3.03.03	Duct banks shall be High Density PE pipes encased in PCC (10% spare of each size, subject to minimum one) with suitable water-proof manholes.		
3.03.04	Hume pipes shall be NP3 type as per IS 458.		
3.03.05	TERNE Coated Flexible Steel Conduits shall be water proof and rust proof made of heat resistant lead coated steel. Conduit diameter shall be uniform throughout its length. Internal surface of the conduit shall be free from burrs and sharp edges. Conduits shall be complete with necessary accessories for proper termination of the conduit with junction boxes and lighting fixtures		
3.03.06	HDPE pipes and conduits shall be PE-80, PN-10 type as per IS 4984/IS 8008 part-I.		
3.04.00	Junction Boxes		
3.04.01	Junction box shall be made of Fire retardant material. Material of JB shall be Thermoplastic or thermosetting or FRP type. The box shall be provided with the terminal blocks, mounting bracket and screws etc. The cable entry shall be through galvanized steel conduits of		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 5 of 69

247927/2021/PS-PEM-MAX

H2021/PS-PEM-MAX		CLAUSE NO.		TECHNICAL REQUIREMENTS			
				suitable diameter. The JB shall have suitable for installing glands of suitable size on the bottom of the box. The JB shall be suitable for surface mounting on ceiling/structures. The JB shall be of grey color RAL 7035. All the metal parts shall be corrosion protected. Junction box surface should be such that it is free from crazings, blisterings, wrinkling, colour blots/striations. There should not be any mending or repair of surface. JB's will be provided with captive screws so that screws don't fall off when cover is opened. JB's mounting brackets should be of powder coated MS. Type test reports for the following tests shall be furnished:- (a) Impact resistance for impact energy of 2 Joules (IK07)as per BS EN50102 (b) Thermal ageing at 70deg C for 96 hours as per IEC60068-2-2Bb. (c) Class of protection shall be IP 55. (d) HV test.			
3.04.02				Terminal blocks shall be 1100V grade, of suitable current rating, made up of unbreakable polyamide 6.6 grade. The terminals shall be screw type or screw-less (spring loaded) / cage clamp type with lugs. Marking on terminal strips shall correspond to the terminal numbering in wiring diagrams. All metal parts shall be of non-ferrous material. In case of screw type terminals the screw shall be captive, preferably with screw locking design. All terminal blocks shall be suitable for terminating on each side the required cables/wire size. All internal wiring shall be of cu. Conductor PVC wire.			
3.05.00				Terminations & Straight Through Joints			
3.05.01				Termination and jointing kits for 33kV, 11 kV, 6.6 KV and 3.3 kV grade XLPE insulated cables shall be of proven design and make which have already been extensively used and type tested. Termination kits and jointing kits shall be Pre-moulded type or heat shrinkable type. Further Cold shrinkable type termination and jointing kits are also acceptable. The Cold shrinkable type kits shall be type tested as per relevant standards. Calculation to withstand the required fault level shall also be furnished in case of cold shrinkable type kits. 33 kV, 11 kV, 6.6 KV and 3.3kV grade joints and terminations shall be type tested and Type test reports as per IS:13573 Part-II and IEC60502 shall be furnished. Also, heat shrink material shall comply with requirements of ESI 09-13 (external tests). Critical components used in cable accessories shall be of tested and proven quality as per relevant product specification/ESI specification. Cable joints and terminations should be with FRLS properties as per IEC 60754-1&2. Kit contents shall be supplied from the same source as were used for type testing. The kit shall be complete with the tinned copper solderless crimping type cable lugs & ferrule or mechanical connectors (wherein bolts are tightened that shear off at an appropriate torque) as per DIN standard suitable for aluminium compacted conductor cables. (Tender drg. no 0000-211-POE –A-51-RA of cable lug attached at the end of this chapter).			
3.05.02				Straight through joint and termination shall be capable of withstanding the fault level of 21 KA for 0.12 Sec. with dynamic peak of 52 KA for 33 KV system & of 40 kA for 0.12 sec with a dynamic peak of 100 kA for 11 kV, 6.6 KV & 3.3 KV system. Straight through joints shall have provisions for shield connection and earthing wherever required and complete with all accessories and consumables suitable for storage without deterioration at a temperature of 50 deg. C with shelf life of more than five years. 1.1 kV grade straight through joints shall also be of proven design			
3.05.03				1.1 KV grade Straight Through Joint shall be of proven design.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2		SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION		Page 6 of 69	

247927/2021/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
3.06.00	Cable glands	
3.06.01	Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.	
3.07.00	Cable lugs/ferrules	
3.07.01	Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to IS/DIN standards.	
3.08.00	Trefoil clamps	
3.08.01	Trefoil clamps for single core cables shall be pressure die cast aluminum or fibre glass or nylon and shall include necessary fixing accessories like G.I. nuts, bolts, washers, etc. Trefoil clamps shall have adequate mechanical strength, when installed at 1 mtr intervals, to withstand the forces generated by the peak value of maximum system short circuit current.	
3.09.00	Cable Clamps & Ties	
3.09.01	The cable clamps/ties required to clamp multicore cables shall be of SS-316 material, 12mm wide, polyester coated ladder lock type. The clamps/ties shall have self locking arrangement & shall have sufficient strength. The cable clamps/ties shall be supplied in finished individual pieces of suitable length to meet the site requirements.	
3.10.00	Receptacles	
3.10.01	Receptacles boxes shall be fabricated out of MS sheet of 2mm thickness and hot dipped gavanised or of die-cast aluminium alloy of thickness not less than 2.5 mm. The boxes shall be provided with two nos. earthing terminals, gasket to achieve IP55 degree of protection, terminal blocks for loop-in loop-out for cable of specified sizes, mounting brackets suitable for surface mounting on wall/column/structure, gland plate etc. The ON-OFF switch shall be rotary type heavy duty, double break, AC23 category, suitable for AC supply. Plug and Socket shall be shrouded Die-cast aluminium. Socket shall be provided with lid safety cover. Robust mechanical interlock shall be provided such that the switch can be put ON only when the plug is fully engaged and plug can be withdrawn only when the switch is in OFF position. Also cover can be opened only when the switch is in OFF position. Wiring shall be carried out with 1100 V grade PVC insulated stranded aluminium/copper wire of adequate size. The Terminal blocks shall be of 1100 V grade. The Terminal blocks shall be of 1100 V grade made up of unbreakable polyimide 6.6 grade with adequate current rating and size. The welding receptacles shall be provided with inbuilt ELCB rated for suitable mA sensitivity ranging from 30-300 mA .	
3.11.00	Cable Drum Lifting Jack The jack for cable drum lifting shall be of screw type with 10 ton capacity. The cable drum jacks shall be manufactured from fabricated steel. The spindles supplied with the cable drum jack shall be manufactured using BSEN-24 grade steel bar with locking collars. Jack nests shall be of SG cast steel. Cable drum jack supplied shall have undergone load testing and reports for the same shall be submitted. At least Two Nos. of jacks shall be supplied for	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION
Page 7 of 69		





247927/2021/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	NTPC use. Contractor has to make arrangements for his own jacks for cable reeling/unreeling under his scope of installation.	
3.12.00	Galvanising	
3.12.01	Galvanising of steel components and accessories shall conform to IS:2629 , IS4759 & IS:2633. Additionally galvanising shall be uniform, clean smooth, continuous and free from acid spots.	
3.12.02	The amount of zinc deposit over threaded portion of bolts, nuts, screws and washers shall be as per IS:1367 . The removal of extra zinc on threaded portion of components shall be carefully done to ensure that the threads shall have the required zinc coating on them as specified	
3.13.00	Welding	
3.13.01	The welding shall be carried out in accordance with IS:9595. All welding procedures and welders qualification shall also be followed strictly in line with IS:9595	
4.00.00	INSTALLATION	
4.01.00	Cable tray and Support System Installation	
4.01.01	Cables shall run in cable trays mounted horizontally or vertically on cable tray support system which in turn shall be supported from floor, ceiling, overhead structures, trestles, pipe racks, trenches or other building structures.	
4.01.02	Horizontally running cable trays shall be clamped by bolting to cantilever arms and vertically running cable trays shall be bolted to main support channel by suitable bracket/clamps on both top and bottom side rails at an interval of 2000 mm in general. For vertical cable risers/shafts cable trays shall be supported at an interval of 1000mm in general. Fixing of cable trays to cantilever arms or main support channel by welding shall not be accepted. Cable tray installation shall generally be carried out as per the approved guidelines/ drawings. Vendor shall design the support system along with tray, spacing etc in line with tray loadings/drawings.	
4.01.03	The cantilever arms shall be positioned on the main support channel with a minimum vertical spacing of 300 mm unless otherwise indicated.	
4.01.04	The contractor shall fix the brackets/ clamps/ insert plates using anchor fasteners. Minimum size of anchor fasteners shall be M 8 X 50 and material shall be stainless steel grade 316 or better. Anchor fastener shall be fixed as recommended by manufacturer and as approved by site engineer. For brick wall suitable anchor fasteners shall be used as per the recommendations of manufacturer. Make of anchor fasteners subject to QA approval and the same shall be finalized at pre-award stage.	
4.01.05	All cable way sections shall have identification, designations as per cable way layout drawings and painted/stenciled at each end of cable way and where there is a branch connection to another cable way. Minimum height of letter shall be not less than 75 mm. For long lengths of trays, the identification shall be painted at every 10 meter. Risers shall additionally be painted/stenciled with identification numbers at every floor.	
4.01.06	In certain cases it may be necessary to site fabricate portions of trays, supports and other non standard bends where the normal prefabricated trays, supports and accessories may not be suitable. Fabricated sections of trays, supports and accessories to make the installation complete at site shall be neat in appearance and shall match with the	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 8 of 69

247927/2021/PS-PEM-MAX

7/2021/PS-PEM-MAX		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC											
CLAUSE NO.															
		prefabricated sections in the dimensions. They shall be applied with one coat of red lead primer, one coat of oil primer followed by two finishing coats of aluminium paint.													
4.02.00		Conduits/Pipes/Ducts Installation													
4.02.01		The Contractor shall ensure for properly embedding conduit pipe sleeves wherever necessary for cabling work. All openings in the floor/roof/wall / cable tunnel/cable trenches made for conduit installation shall be sealed and made water proof by the Contractor.													
4.02.02		GI pull wire of adequate size shall be laid in all conduits before installation. Metallic conduit runs at termination shall have two lock nuts wherever required for junction boxes etc.													
4.02.03		Conduit runs/sleeves shall be provided with PVC bushings having round edge at each end. All conduits/pipes shall have their ends closed by caps until cables are pulled. After cables are pulled, the ends of conduits/pipes shall be sealed with Glass wool/Cement Mortar/Putty to prevent entrance of moisture and foreign material													
4.02.04		Exposed conduit/pipe shall be adequately supported by racks, clamps, straps or by other approved means. Conduits /pipe support shall be installed square and true to line and grade with an average spacing between the supports as given below, unless specified otherwise													
		<table><tr><td>Conduit /pipe size (dia).</td><td>Spacing</td></tr><tr><td>Upto 40 mm</td><td>1 M</td></tr><tr><td>50 mm</td><td>2.0 M</td></tr><tr><td>65-85 mm</td><td>2.5 M</td></tr><tr><td>100 mm and above</td><td>3.0 M</td></tr></table>				Conduit /pipe size (dia).	Spacing	Upto 40 mm	1 M	50 mm	2.0 M	65-85 mm	2.5 M	100 mm and above	3.0 M
Conduit /pipe size (dia).	Spacing														
Upto 40 mm	1 M														
50 mm	2.0 M														
65-85 mm	2.5 M														
100 mm and above	3.0 M														
4.02.05		For bending of conduits, bending machine shall be arranged at site by the contractor to facilitate cold bending. The bends formed shall be smooth.													
4.03.00		Junction Boxes Installation													
4.03.01		Junction boxes shall be mounted at a height of 1200mm above floor level or as specified in the drawings and shall be adequately supported/mounted on masonry wall by means of anchor fasteners/ expandable bolts or shall be mounted on an angle, plate or other structural supports fixed to floor, wall, ceiling or equipment foundations.													
4.04.00		Cable Installation													
4.04.01		Cable installation shall be carried out as per IS:1255 and other applicable standards.													
4.04.02		For Cable unloading, pulling etc following guidelines shall be followed in general:													
		a) Cable drums shall be unloaded, handled and stored in an approved manner on hard and well drained surface so that they may not sink. In no case shall be drum be stored flat i.e. with flange horizontal. Rolling of drums shall be avoided as far as possible. For short distances, the drums may be rolled provided they are rolled slowly and in proper direction as marked on the drum. In absence of any indication, the drums may be rolled in the same direction as it was rolled during taking up the cables. For unreeling the cable, the drum shall be mounted on suitable jacks or on cable wheels and shall be rolled slowly so that cable comes out over the drum and not from below. All possible care shall be taken during unreeling and laying to avoid damage due to twist, kink or sharp bends. Cable ends shall be provided with sealed plastic caps to prevent damage and ingress of moisture.													
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2		SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION											
				Page 9 of 69											

247927/2021/PS-PEM-MAX

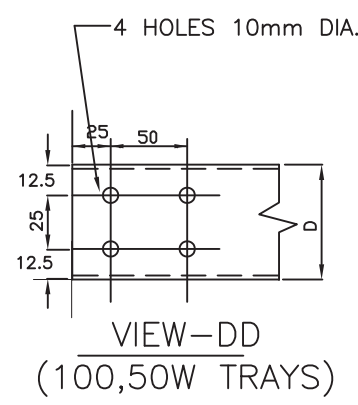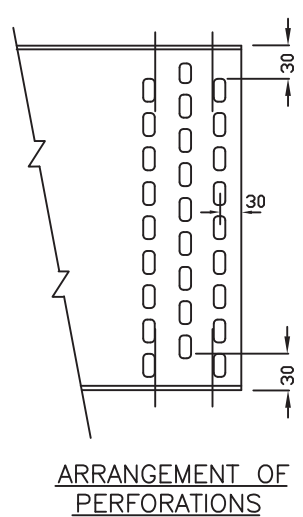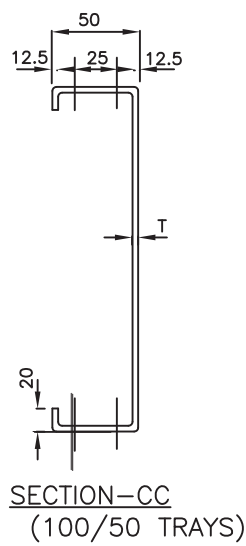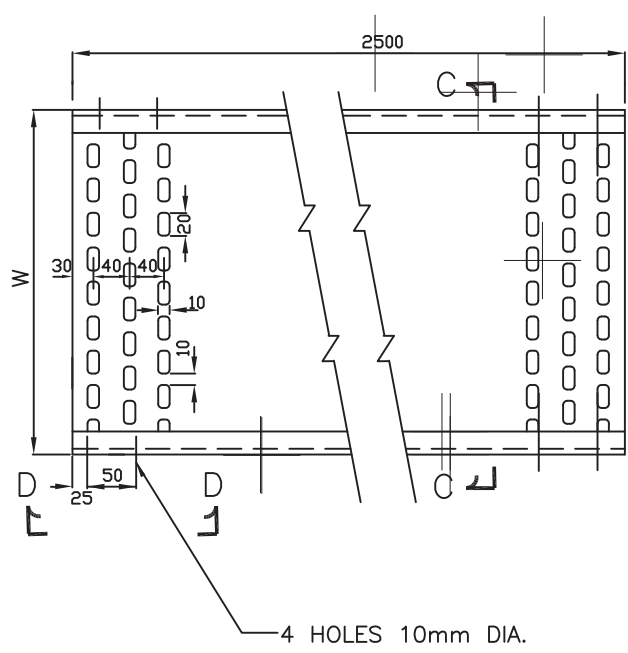


TRAY WIDTH W (mm)	100	50
TRAY DEPTH D (mm)	50	50
T (mm)	2	2

PERFORATED TYPE TRAY



TYPICAL DETAILS OF CABLE TRAYS AND ACCESSORIES

DWG. NO.

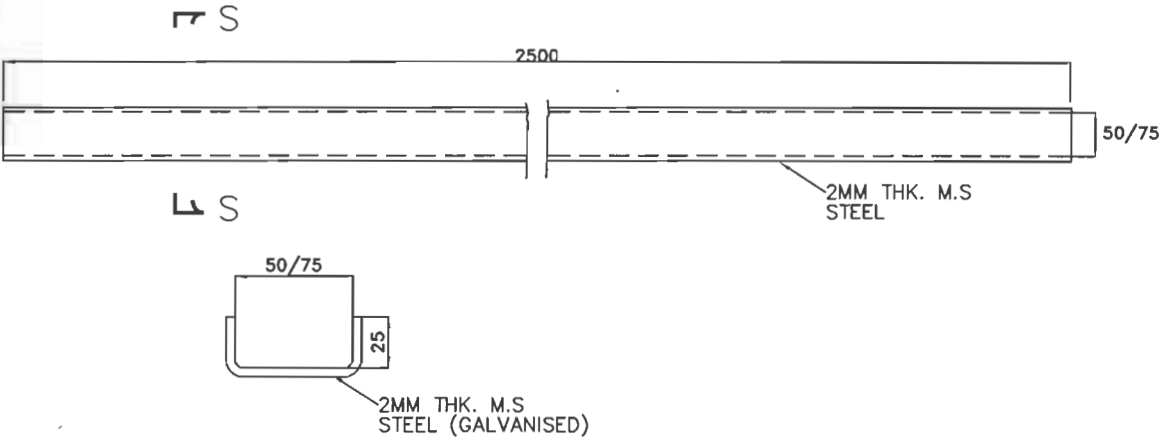

SECTION S-S

CABLE TROUGHS

SEE GENERAL NOTES IN SHEET 11.



TYPICAL DETAILS OF
CABLE TRAY AND ACCESSORIES

BHEL DRAWING NO.
PE-DG-427-507-E005

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: II B

SECTION : C-4

REV. 00

DATE: Nov. 20

SHEET: 1 OF 1

SECTION: C-4

TECHNICAL SPECIFICATION (C&I PORTION)

247927/2021/PS-PEM-MAX

	4X210 + 3X500 MW NTPC KAHALGAON TPP STAGE I & II- FGD	
	TECHNICAL SPECIFICATION (C&I) FOR COMPRESSED AIR SYSTEM	

INDEX

S. No.	DESCRIPTION
1	TITLE SHEET
2	INDEX SHEET
3	SPECIFIC TECHNICAL REQUIREMENTS (C&I)
4	INSTRUMENTS & VALVES SPECIFICATIONS
5	SIGNAL EXCHANGE BETWEEN DRIVES & DCS (DCP)
6	INSTRUMENT STUB DETAILS
~~7~~	~~QUALITY ASSURANCE FOR INSTRUMENTS~~
~~8~~	~~SUB VENDOR LIST~~
9	INSTRUMENT INSTALLATION DRAWINGS
10	CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY
~~11~~	~~MANDATORY SPARES~~
~~12~~	~~CODES AND STANDARDS~~

**C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM**SECTION: C
SUB SECTION: C&I**SPECIFIC TECHNICAL REQUIREMENT(C&I)**



**4X210 + 3X500 MW NTPC
KAHALGAON TPP STAGE I & II-
FGD**

**Specific Technical Requirement
For
Compressed Air System**

1. Complete C&I system for Compressed Air System is in bidder scope of supply. The Contractor shall provide complete Instrumentation for control, monitoring and operation of entire CAS.
2. Integrated microprocessor based control system along with suitable operator interface shall be provided for each Instrument Air Compressor, Service Air Compressor & their Dryers. All PT, DPT, TE, and other instruments inside & outside the compressor skid shall also be hooked-up to this system. Compressors connectivity to FGD DCS shall be provided for information and overall control. Soft signal exchange between the microprocessor to FGD DCS (FGD DCS in BHEL scope) shall be through Modbus on RS485 via twisted pair cable. In addition to the soft link, Critical signals exchange among the compressors shall be hardwired (START, STOP and LOAD & UNLOAD commands). The Dew point measurement from FGD DCS to all the compressors & their status feedbacks to FGD DCS shall also be provided. Bidder to furnish the configuration diagram of control system of compressor showing communication with FGD DCS along with the bid. Bidder to furnish signal exchange list between FGD DCS and compressed air system in BHEL format attached elsewhere.
3. Time synchronization of compressor microprocessor system with the DCS has to be done. Bidder to provide necessary hardware/software at their end.
4. All the Electronic Transmitter for Temperature, Pressure, Differential Pressure and DP based Flow /Level measurements shall be genuine, verifiable PROFIBUS PA compatible instruments. The transmitters shall be connected to DDCMIS through PROFIBUS PA protocol complying to IEC 61158 directly from transmitter. This is subject to customer approval and BHEL decision shall be final.
5. The PROFIBUS design shall be further validated by BHEL and approved by NTPC during detailed engineering and any variation/ changes required based on DDCMIS system requirements and actual field installation, operational philosophy etc. shall be considered by bidder without any cost & delivery implication.
6. Junction boxes specially designed for PROFIBUS application shall be provided on as required basis. These SS JB's shall house field mounted PROFIBUS components. These SS JB's shall have suitable cover and gasket and shall have protection class of IP-66 or better. SS Cable glands and blind plugs shall be provided by the bidder.
7. All transmitters (except PROFIBUS PA compatible transmitters) shall be smart type and shall have 4-20mA DC signal with superimposed digital communication (HART).
8. The requirements given are to be read in conjunction with detailed Technical specification enclosed. Further in case of any discrepancy in the requirement within the same Section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the Form of pre bid clarification. In absence of any pre bid clarification, the more stringent requirement as per interpretation of customer/BHEL shall prevail without any cost & delivery implication.



**4X210 + 3X500 MW NTPC
KAHALGAON TPP STAGE I & II-
FGD**

**Specific Technical Requirement
For
Compressed Air System**

9. The scope of C&I cable shall be referred in Electrical scope split sheet in Electrical portion of the specification.
10. Bidder to include all the instruments required for the package along with fittings, accessories and valve manifold. All instruments shall be provided with durable epoxy coating for housing and all exposed surfaces of the instruments.
11. Bidder to provide mandatory spares as per mandatory spares list mentioned elsewhere in the specification.
12. All Temperature sensors shall be Duplex type and temperature transmitter shall be provided for all temperature measurement applications. compensating cable, JB/rack & other erection hardware as required.
13. All the transmitters supplied by Bidder shall be rack mounted. The transmitter racks shall be in Bidder's scope of supply. All transmitters shall be suitably grouped together and mounted inside (i) Local Instruments Enclosures (LIEs) in case of open areas of the plant and (ii) In Local Instrument Racks (LIRs) in case of covered areas.
14. All field instruments enclosure shall be IP65 local panel/cabinet enclosure shall be IP 55, unless otherwise specified.
15. The solenoid operated valves shall have limit switches for open/close feedback. Solenoid valve shall be rated for 24 V DC only
16. The junction boxes for termination of instruments /actuator limit switches/solenoid valve limit switches etc. are in bidder's scope.
17. 230V AC Redundant UPS supply shall be provided by BHEL at a single point, further distribution to various instruments/equipment's of the CAS shall be in Bidder's scope. Bidder to include the necessary power distribution board in his scope. Any power supply other than the above, if required for any instrument/equipment has to be derived from the above supply & all the necessary hardware for the same shall be in Bidder's scope. Static Switch based Changeover scheme for redundant UPS Feeders shall be used by bidder. It shall be ensured that changeover time between feeders shall be such that that compressor Controller Failure shall not take place during changeover.
18. Bidder to furnish electrical/UPS load data during detailed engineering.
19. Power supply derived for Transmitters, contact interrogation, interposing relay and solenoid shall generally be ungrounded 24V D.C only. In all cases redundancy in power modules shall be considered.
20. Instrument installation and accessories required and same shall be in Bidder's scope and shall be subject to customer/BHEL approval during detailed engineering.



**4X210 + 3X500 MW NTPC
KAHALGAON TPP STAGE I & II-
FGD**

**Specific Technical Requirement
For
Compressed Air System**

21. Bidder to provide erection hardware including junction boxes, canopies, structural steel as required.
22. The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant and meeting redundancy requirement under technical specification subject to Employers approval, bidder shall supply the same without any cost & delivery implication.
23. For other critical binary and analog inputs required for protection and interlock purpose of other equipment (e.g. those interlocks which may result in loss of production, non-availability of a major equipment etc.), triple sensors shall be provided. For all control functions dual redundancy of the sensors shall be provided by the bidder.
24. Temperature elements, electronic transmitters etc. are to be provided for all the cases. Use of process actuated switches is acceptable only in the cases as indicated in the tender drawings.
25. Process connection & piping including, all impulse piping, pneumatic piping/tubing, valves, valve manifolds, fittings and all other accessories shall be provided on as required basis for proper installation & completeness of impulse piping system and air supply system,
26. All the DM water wetted parts of the instruments including the accessories like root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting/erection of these local instruments as well as valves shall be of SS-316 material, suitable pressure class and same shall be in bidder's scope
27. The system shall be arranged so that the failure of any monitoring device or control components or spurious intermediate grounding in the signal path shall not open the signal loop nor cause the loss or malfunction of signal to other devices using the same signal.
28. To ensure availability, adequate redundancy in system design shall be provided at hardware, software and sensor level. For the protection system, independent sensing device shall be provided to ensure adequate safety of plant equipment.
29. The design of the control systems and related equipments shall adhere to the principle of 'Fail Safe' Operation wherever safety of personnel / plant equipment is involved and shall not cause a hazardous condition. However, it shall also be ensured that occurrence of false trips are avoided / minimized.



**4X210 + 3X500 MW NTPC
KAHALGAON TPP STAGE I & II-
FGD**

**Specific Technical Requirement
For
Compressed Air System**

30. Bidder to perform tests of C&I items/instruments/systems as per quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to performed by the bidder without any cost & delivery implication.
31. The equipment shall be of modern, compact design incorporating the latest developments in proven technology. All instruments whether for local indication or remote transmission shall be of good quality and shall have an accuracy and repeatability appropriate to their duty.
32. Bidder shall provide Cable Schedule in BHEL excel format which shall be provided during detailed engineering. Also, Cable Interconnections for Complete System shall be in Bidders' scope. DCS side details for hardwired signals shall be furnished by BHEL during detailed engineering.
33. The make/model of various instruments/items/systems shall be subject to approval of owner/purchaser during detailed engineering stage. No cost/time implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with. In case of any contradiction most stringent clause/condition shall prevail without any cost & delivery implication.
34. Bidder's presence is required for 3 Man days (in one visit) at site during commissioning of DDCMIS for assistance related to process correctness. All the expenses like boarding, lodging and travel, Air fare etc. shall be in bidder's scope.
35. Typical hardwired scheme as provided shall be used by bidder for deciding signal interface between Microprocessor panel & MCC/DCS/Solenoid valve /Field instruments etc.
36. The design, manufacture, inspection, testing, site calibration and installation of all C&I equipment and systems covered under this specification shall conform to the latest editions of applicable codes and standards
37. Local control panel if any required for operation shall be in bidder scope.
38. All instruments should be supplied with valid calibration and test certificates provided by OEM.
39. Diaphragm seal shall be provided with instruments having contact with corrosive media. Double root valves shall be provided for all pressure tapings where the pressure exceeds 40 kg/cm².



**4X210 + 3X500 MW NTPC
KAHALGAON TPP STAGE I & II-
FGD**

**Specific Technical Requirement
For
Compressed Air System**

- 40.** All field instruments shall be weatherproof, drip tight, dust tight and splash proof suitable for use under outdoor ambient conditions prevalent in the subject plant. All field-mounted instruments shall be mounted in suitable locations where maximum accessibility for maintenance is achieved. All the field instruments shall also be provided with SS tag nameplate and double compression type Nickel-plated brass cable gland. Gaskets, Fasteners, Counter and mating flange (SS316 material), nuts & bolts etc. shall also be included, wherever required with the field instruments.
- 41.** For instruments which are not located inside covered building, suitable canopy/ protective arrangement shall be provided which shall be approved during detail engineering.
- 42.** Number of pair to be selected for screen control cable (size : 0.5 mm²)
F-type: 2P/4P/8P/12P
G-type: 2P/4P/8P/12P
- 43.** Instrument installation and accessories required shall be in Bidder's scope. Vendor submitted 'Instrument Installation Diagram' shall be subject to customer approval during detail engineering without any cost & delivery implication. For instruments for which Installation Diagram is not attached, vendor's Installation Diagram for such items will also be subject to customer approval during detail engineering without any cost & delivery implication.

Note:

1. All equipment items shall be of latest design with proven on track record.
2. The above given scope is indicative & minimum. Any item/ equipment not indicated above however required for the completeness of the system is to be supplied by bidder without any cost & delivery implication to BHEL.
3. Documents of C&I System shall be submitted to end user/owner for approval during detail engineering. Changes, if any, shall be accommodated by the bidder without any cost & delivery implication.

	SPECIFICATION FOR CONTROL & INSTRUMENTATION FOR AUX PACKAGES	SPECIFICATION NO.:	
		VOLUME	
		SUB SECTION	
		REV. NO.	DATE :
		SHEET	OF

GENERAL REQUIREMENT

1.0 Bidder shall provide complete and independent control & instrumentation system with all accessories, auxiliaries and associated equipments for the safe, efficient and reliable operation of auxiliary systems.

2.0 The quantity of instruments for auxiliary system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.

3.0 Measuring instruments/equipment and subsystems offered by the bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Further all the instruments shall be of proven reliability, accuracy, and acceptable international standards and shall be subject to employer's approval. All instrumentation equipment and accessories under this specification shall be furnished as per technical specification, ranges, makes/ numbers as approved by the employer' during detail engineering.

4.0 The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifold and all the other accessories required for mounting/ erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments; sensors, switches etc for external connection including spare contacts shall be wired out to suitably located junction boxes.

5.0 The customer specification attached as Specific Technical Requirement will supercede the Data sheets, if there is any mismatch.

247927/2021/PS-PFM-MAX

**C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM**SECTION: C
SUB SECTION: C&I**INSTRUMENT & VALVE SPECIFICATIONS**

|

CLAUSE NO.	TECHNICAL REQUIREMENTS	Annexure-IIIC	
1.00.00	MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)		
1.01.00	Measuring instruments/equipment and subsystems offered by the Bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Further, all instruments shall be of proven reliability, accuracy, and repeatability requiring a minimum of maintenance and shall comply with the acceptable international standards and shall be subject to Employer's approval.		
1.02.00	Every panel-mounted instrument requiring power supply shall be provided with easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a grounding terminal and shall be suitably connected to the panel grounding bus.		
1.03.00	All transmitters, sensors, switches and gauges for parameters like pressure, temperature, level, flow etc. as required for the safe and efficient operation and maintenance as well as for operator and management information (including all computation) of equipment in the system under the scope of specification shall be provided on as required basis with in quoted lump sum price. The Contractor shall furnish all Instrumentation / Control equipment & accessories under this specification as per technical specification, ranges, makes & model as approved by the Employer during detailed engineering.		
1.04.00	The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting/erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments, sensors, switches etc. for external connection including spare contacts shall be wired out in flexible/rigid conduits, independently to suitably located common junction boxes. The proposal shall include the necessary cables, flexible conduits, junction boxes and accessories for the above purpose. Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kd./sq.cm.		
1.07.00	The instruments, for which technical specification is not attached, shall be supplied as per the standard and proven practice of the contractor. The same shall be established by the contractor during detailed engineering by providing detailed explanation/concepts, if required by the employer, of such implementation along with standard documentation.		

CLAUSE NO.	TECHNICAL REQUIREMENTS 
3.05.00	TEMPERATURE TRANSMITTER (TT) Following specifications are applicable for Dual input/ Single input temperature transmitter. Temperature transmitter shall be 2-wire (loop powered) directly powered from 4-20mA input cards of DDCMIS. TT shall be fully compatible with thermocouples and RTDs being

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	provided by the contractor. Temperature compensation for thermocouples shall be performed in the temperature transmitter itself.		
	S No.	Features	Essential/Minimum Requirements
	1.	Output	2-wire (power supply from input card of control system) with 4-20mA output with superimposed HART protocol signal
	2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types (Selectable through HART terminal/calibrator)
		Isolation	Min 500 VAC
		EMC compatibility	As per EN 61326
		Power supply	24 V C +/- 10%
	3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating
	4.	Electrical connection	Plug and Socket connector except hazardous area
	5.	Diagnostics display	& Self-Indicating feature and digital display on transmitter
	6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.
	7.	Mounting	2 inch pipe mounting with Canopy.
	8.	Accessories	As required by service and operating condition.
	9.	Composite Accuracy	(Refer note 2) RTD =<0.25% of 0-250 deg C span T/C-K type =<0.2% of 0-600 deg C span CJC accuracy (for thermocouples) shall be =< 1 deg C
	Notes:		
	1. In case of failure (open or burn-out) of RTD/thermocouple, transmitter shall provide low temperature output.		
	2. Dual input temperature transmitter shall have bump less changeover facility to second sensor in case first sensor fails. This changeover is to be alarmed in control system.		
	3. Composite accuracy is to be calculated as summation of all applicable accuracies of temperature transmitter for converting sensor input to output (e.g., A/D accuracy, basic accuracy, digital accuracy, etc.) and temperature effect on these		

CLAUSE NO.	TECHNICAL REQUIREMENTS 
	accuracies at ambient temperature of 50 deg C, based on the figure/ formula given in the standard product catalogue for span as specified above for various types of temperature elements specified. All such accuracy/ temperature effect figures in catalogue shall be first converted to deg C, and then percentage of this converted accuracy in specified span shall be calculated to compare with the specified composite accuracy figures. All temperature transmitters shall be interchangeable (i.e. can be used for either RTD or thermocouple) and composite accuracy shall be met for each type of input as specified above. 4. Above mentioned parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only. 5. Dual input temperature transmitters can also be accepted in place of single input TT.

CLAUSE NO.	TECHNICAL REQUIREMENTS							
16.00.00	FIELD INSTRUMENTS BASED ON FIELDBUS The following instruments shall be connected to DDCMIS through fieldbus i.e. FOUNDATION Fieldbus/PROFIBUS PA protocol complying to IEC 61158 directly from transmitter.							
16.01.00	Electronic Transmitter for Pressure, Differential Pressure and DP based Flow / Level measurements. <table><tr><th>S No.</th><th>Features</th><th>Essential/Minimum Requirements</th></tr><tr><td>1.</td><td>Type of Transmitter</td><td>FOUNDATION Fieldbus/PROFIBUS PA based output</td></tr></table>	S No.	Features	Essential/Minimum Requirements	1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output	
S No.	Features	Essential/Minimum Requirements						
1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output						

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	2 Accuracy 3. Stability 4 Turn down 5 Housing 6. Electrical connection 7. Process connection 8. Operating Ambient temperature Overpressure 9 Accessories	± 0.060 % of calibrated range (minimum) for calibrated range greater than 400 mmwc. +0.065% of calibrated range (minimum) for calibrated range greater than 250 kg/cm². ± 0.10 % of calibrated range (minimum) for calibrated range less than 400 mmwc. 0.25 % of calibrated range for 10 years for calibrated range greater than equal to 400 mmwc on standard conditions of manufacturer. 0.2 % of calibrated range for 1 years for calibrated range less than 400 mmwc on standard conditions of manufacturer. 0.15% of calibrated range for 5 years for DPT with static pressure greater than 250 kg/cm². 50:1 for greater than or equal to span of 400mmwc. 20:1 for span below 400mmwc. 10:1 for span greater than 250 kg/cm² (Above mentioned (2,3,4) parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only). Weather proof as per IP-67, metallic housing with durable corrosion resistant coating ½" NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible ½" NPT (F) 85 deg C without display. 70 deg C with display. 150% of max operating pressure -Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & gauge pressure transmitters, -3-valve for DP and 5 valve manifold for level/flow applications. -The valve manifold shall be non-integral type. -For hazardous area, enclosure as described in NEC article 5.	

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	10.	Mounting	2 inch pipe mounting with Enclosure/Rack/Canopy.
	11.	Diagnostics & display	Self-Indicating feature and digital display on transmitter
	Notes		
	- For primary air/ secondary air/flue gas/ furnace pressure applications, DP type transmitters shall be provided for pressure measurement below 2000 mmwc. - LVDT type is not acceptable. - Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.		
16.02.00	Temperature Transmitter		
16.02.01	Single Input /Dual Input Temperature transmitter		
	Temperature transmitter shall be provided which shall be fully compatible with thermocouples and RTDs being provided by the contractor. Temperature compensation for thermocouples shall be performed in the temperature transmitter itself. Transmitters shall be capable of withstanding ambient temperature up to 85 deg C. Following specifications are applicable for dual input/single input temperature transmitter.		
	S No.	Features	Essential/Minimum Requirements
	1.	Output	FOUNDATION fieldbus /PROFIBUS PA
	2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types
	3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating
	4.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible
	5.	Diagnostics & display	Self-Indicating feature and digital display on transmitter
	6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.

CLAUSE NO.	TECHNICAL REQUIREMENTS 
	7. Mounting 2 inch pipe mounting with Canopy. 8. Accessories As required by service and operating condition. 9. Composite Accuracy (Refer note 2) RTD $\leq 0.25\%$ of 0-250 deg C span T/C-K type $\leq 0.2\%$ of 0-600 deg C span CJC accuracy (for thermocouples) shall be ≤ 1 deg C Notes: 1. In case of failure (open or burn-out) of RTD/thermocouple, transmitter shall provide low temperature output. 2. Dual input temperature transmitter shall have bump less changeover facility to second sensor in case first sensor fails. This changeover is to be alarmed. 3. Composite accuracy is to be calculated as summation of all applicable accuracies of temperature transmitter for converting sensor input to output (e.g., basic accuracy, digital accuracy, etc.) and temperature effect on these accuracies at ambient temperature of 50 deg C, based on the figure/ formula given in the standard product catalogue for span as specified above for various types of temperature elements specified. All such accuracy/ temperature effect figures in catalogue shall be first converted to deg C, and then percentage of this converted accuracy in specified span shall be calculated to compare with the specified composite accuracy figures. All temperature transmitters shall be interchangeable (i.e. can be used for either RTD or thermocouple) and composite accuracy shall be met for each type of input as specified above. 3. Above mentioned parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only. 4. Dual input temperature transmitters can also be accepted in place of single input TT.

CLAUSE NO.	TECHNICAL REQUIREMENTS																																																				
4.00.00																																																					
SPECIFICATIONS FOR PR. GAUGE, D.P. GAUGE, TEMP. GAUGE AND LEVEL GAUGE.																																																					
<table><tr><th>SI. No</th><th>FEATURES</th><th colspan="4">ESSENTIAL/MINIMUM REQUIREMENTS</th></tr><tr><td></td><td></td><td>Pr. Gauge/ DP Gauge/ Draught gauges</td><td>Temperature Gauge</td><td colspan="2">Level Gauge</td></tr><tr><td>1</td><td>Sensing Element</td><td>Bourdon for high pressure, Diaphragm/ Bellow for low pr.</td><td>Inert gas actuated/ Liquid filled other than mercury</td><td colspan="2">Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.</td></tr><tr><td>2</td><td>Material of sensing element</td><td>SS 316</td><td>SS 316</td><td colspan="2"></td></tr><tr><td>3</td><td>Material of movement</td><td>SS 304</td><td>SS 304</td><td colspan="2"></td></tr><tr><td>4</td><td>Body material</td><td>Die-cast aluminium</td><td>Die-cast aluminium</td><td colspan="2">Forged carbon steel/304 SS</td></tr><tr><td>5</td><td>Dial size</td><td>150mm</td><td>150 mm</td><td colspan="2">Tubular covering entire range</td></tr><tr><td>6</td><td>End connection</td><td>1/2 inch NPT (M)</td><td>1/2 inch or 3/4 inch NPT (M).</td><td colspan="2">Process connection as per ASME PTC and drain/vent 15 NB</td></tr></table>						SI. No	FEATURES	ESSENTIAL/MINIMUM REQUIREMENTS						Pr. Gauge/ DP Gauge/ Draught gauges	Temperature Gauge	Level Gauge		1	Sensing Element	Bourdon for high pressure, Diaphragm/ Bellow for low pr.	Inert gas actuated/ Liquid filled other than mercury	Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.		2	Material of sensing element	SS 316	SS 316			3	Material of movement	SS 304	SS 304			4	Body material	Die-cast aluminium	Die-cast aluminium	Forged carbon steel/304 SS		5	Dial size	150mm	150 mm	Tubular covering entire range		6	End connection	1/2 inch NPT (M)	1/2 inch or 3/4 inch NPT (M).	Process connection as per ASME PTC and drain/vent 15 NB	
SI. No	FEATURES	ESSENTIAL/MINIMUM REQUIREMENTS																																																			
		Pr. Gauge/ DP Gauge/ Draught gauges	Temperature Gauge	Level Gauge																																																	
1	Sensing Element	Bourdon for high pressure, Diaphragm/ Bellow for low pr.	Inert gas actuated/ Liquid filled other than mercury	Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.																																																	
2	Material of sensing element	SS 316	SS 316																																																		
3	Material of movement	SS 304	SS 304																																																		
4	Body material	Die-cast aluminium	Die-cast aluminium	Forged carbon steel/304 SS																																																	
5	Dial size	150mm	150 mm	Tubular covering entire range																																																	
6	End connection	1/2 inch NPT (M)	1/2 inch or 3/4 inch NPT (M).	Process connection as per ASME PTC and drain/vent 15 NB																																																	

CLAUSE NO.	TECHNICAL REQUIREMENTS 				
	7	Accuracy	±1% of span	± 1% of span	± 2%
	8	Scale	Linear, 270° arc graduated in metric units	Linear, 270° arc graduated in °C	Linear vertical
	9	Range selection	Shall cover 125% of max. operating press	Shall cover 125% of max. operating temp	Shall cover max. Operating level.
	10	Over range	125% of FSD	125% of FSD	-
	11	Housing	Weather and dust proof as per IP-55	Weather and dust proof as per IP-55	CS/304 SS leak proof
	12	Zero/span adjustment	Provided	Provided	—
	13	Identification	Engraved with service legend or laminated phenolic name plate		
	14	Accessories	Blow out disc, siphon, snubber, pulsation dampener, chemical seal (if required by process) gauge isolation valve	SS Thermowell	Gasket for all KEL-F shield for transparent type vent and drain valves of Steel/SS as per CS/Alloy process Requirement.
	Notes:-				
	*Bicolour type level gauges will be provided for applications involving steam and water except for condensate and feed water services.				
	Length of gauge glass shall not be more than 1400 mm. If the vessel is higher, multiple gauge glasses with 50 mm overlapping shall be provided.				
	Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.				

CLAUSE NO.	TECHNICAL REQUIREMENTS 
10.00.00	FIELD MOUNTED LOCAL JUNCTION BOXES (i) No. of ways 12/24/36/48/64/72/96/128 with 20% spares terminals. (ii) Material and Thickness 4mm thick Fiberglass Reinforced Polyester (FRP). (iii) Type Screwed at all four corners for door. Door gasket shall be of synthetic rubber. (iv) Mounting clamps and accessories Suitable for mounting on walls, columns, structures etc. The brackets, bolts, nuts, screws, glands required for erection shall be of SS, included in Bidders scope of supply. (v) Type of terminal blocks Rail mounted cage-clamp type suitable for conductor size upto 2.5 mm². A M6 earthing stud shall be provided. (vi) Protection Class IP: 55 minimum for indoor & IP-65 minimum for outdoor applications. (vii) Grounding To be provided. (viii) Color RAL 7035

एनटीपीसी
NTPC

(e)	Flow Switch (to be provided with isolating valves)	
(i)	Body	Forged steel
(ii)	Extension Rod/wire	SS-304
(iii)	Sleeve and Sleeve pipe	SS-304
(iv)	Cover	Die cast aluminum
(v)	Max. working pressure	10 kg/sq.cm
(vi)	Repeatability	± 0.5%
(vii)	No. of contacts	2 NO + 2 NC
(viii)	Type of contact	Adjustable throughout the range.
(ix)	Protection class	IP – 65

8.00.00 DEW POINT METER

1. Type : Direct Mounting Capacitance type with change in output proportional to moisture present.
2. Sensing Element : Ceramic / Aluminum Oxide sensor
3. Service : Dry Air
4. Range : -90 Deg.C to 10 Deg.C Dew Point Temperature
5. Sensor Accuracy : ± 2 Deg. C Dew Point
6. Repeatability : 0.5 Deg. C Dew Point
7. Operating Ambient Temperature : -40 Deg C to 50 Deg C
8. Operating Pressure : 0- 10 kg/ Sq. cm
9. Display : Combined enclosure with 5 Digit seven segments LED display.
10. Element Filter : 80 micron sintered stainless steel
11. Output : 4- 20 mA DC Loop powered
12. Power Supply : 24 VDC nominal
13. Enclosure class : IP 65
14. Interchangeability : Fully Interchangeable transmitters
15. Accessories : Sampling system, cables, sensor holder, desiccant chambers, double compression fittings, $\frac{3}{4}$ " Cable gland, mounting fixture etc.

SIGHT GLASS

Sr. No.	Description	
1.	Make	-
2.	Type	Double Window
3.	Connection	Flanged
4.	Flow Directions	Horizontal
5.	Indicator	Bi- Directional Flapper
6.	Body	A106 Gr B
7.	Cover Plates	IS2062
8.	Bolts/Studs and Nuts	GI
9.	Gaskets	NON CAF
10.	Glass	Toughened
11.	Flapper	AISI 304
12.	Process Flanges	IS2062 / A105
13.	Flange rating	150#RF ANSI B16.5
14.	Tag plate	SS




**C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM**

SECTION: C
SUB SECTION: C&I

**SIGNAL EXCHANGE BETWEEN DRIVES &
DCS(DCP)**

ANNEXURE-1

STANDARD HARDWIRED INTERFACE BETWEEN COMPRESSOR CONTROL SYSTEM, DCS AND MCC

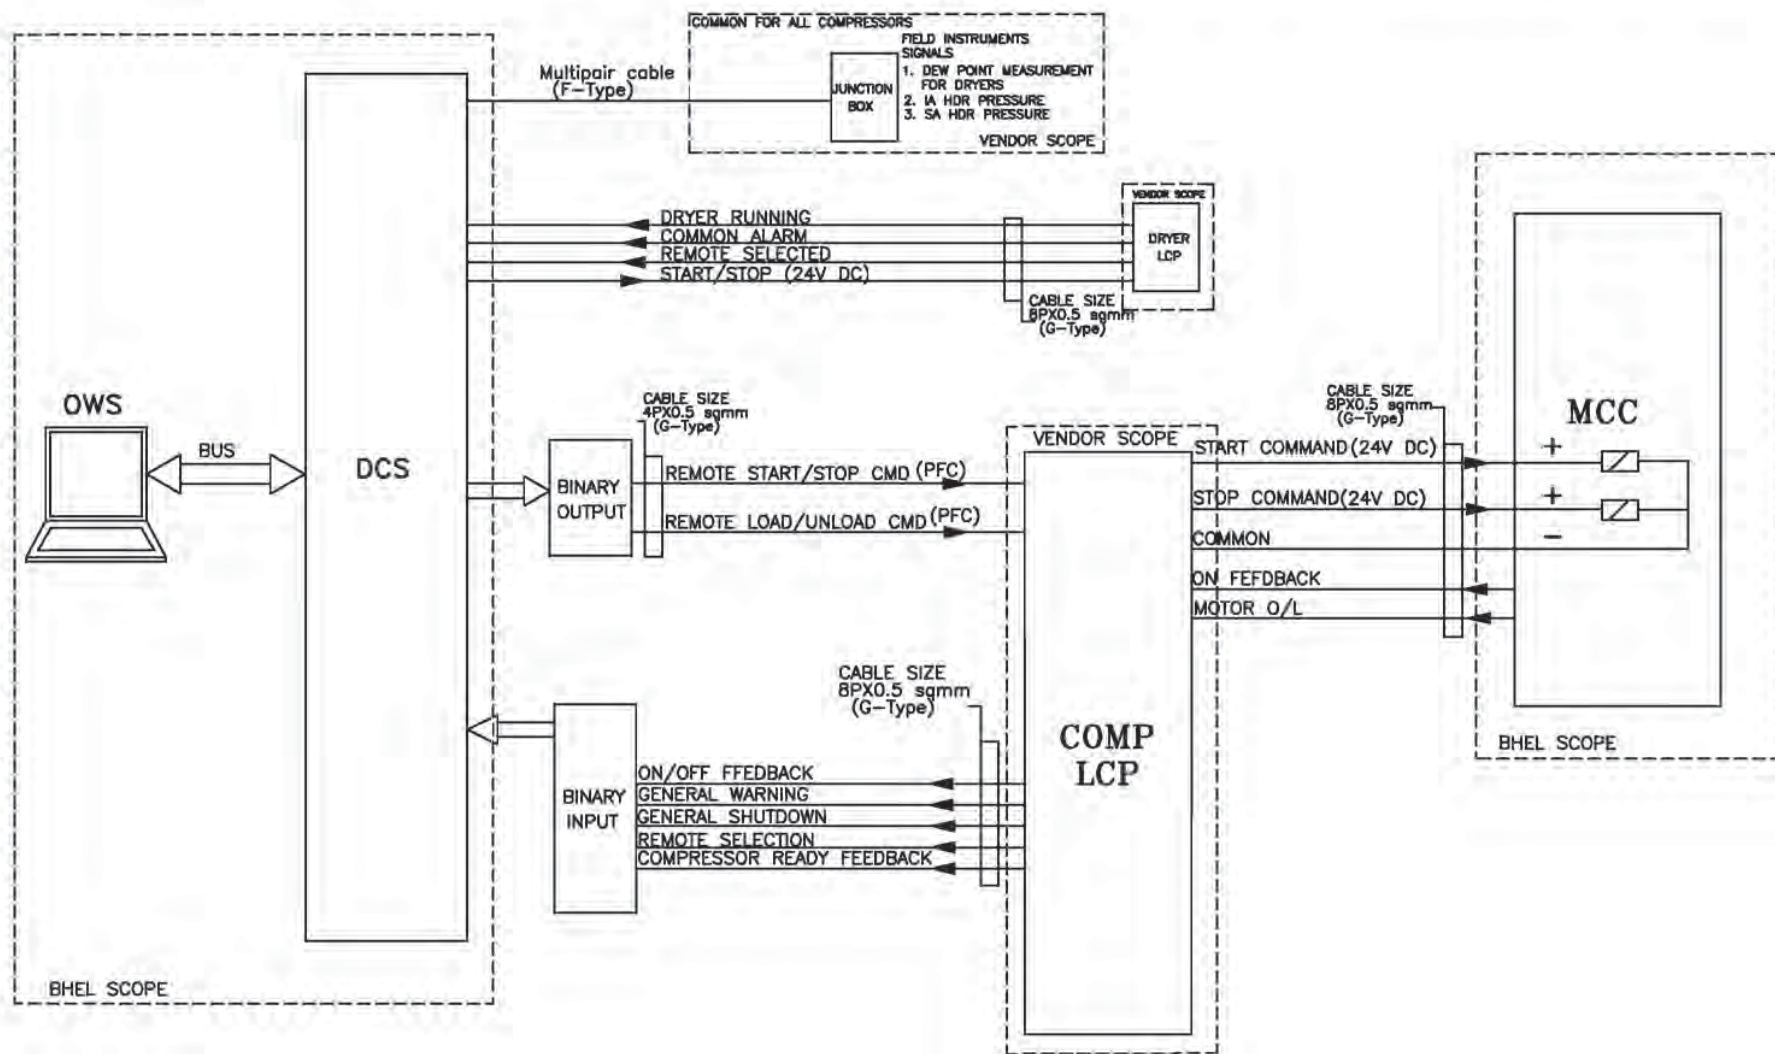

NOTE:

1. CABLE SCOPE SHALL BE AS PER ELECTRICAL SCOPE MATRIX.



PROJECT: STANDARD HARDWIRE INTERFACE

TITLE

DDCMIS/LCP/MCC INTERFACE FOR
INDIVIDUAL COMPRESSOR/DRYER

DRG.NO.

DATE

23.02.2018

REV.NO.

00

SHT

[illegible]



C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM




SECTION: C
SUB SECTION: C&I

INSTRUMENT STUB DETAILS

|

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

PRESS. MEASUREMENT

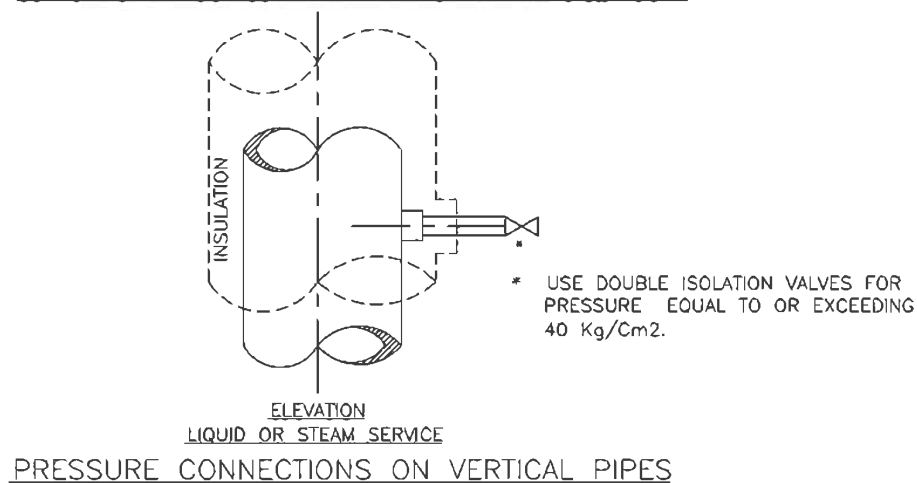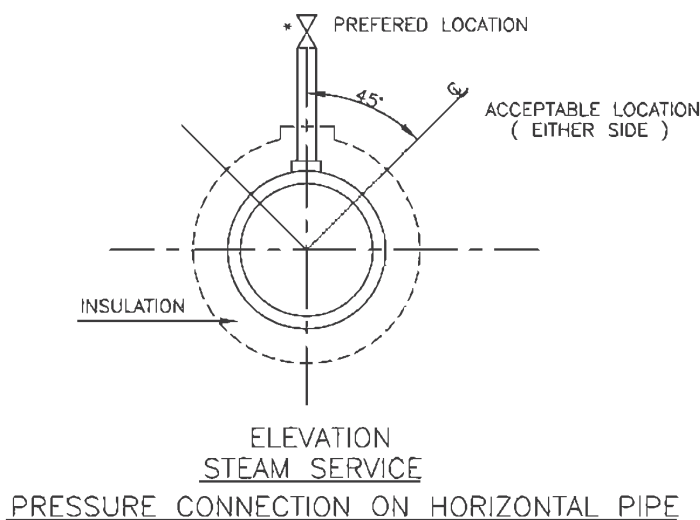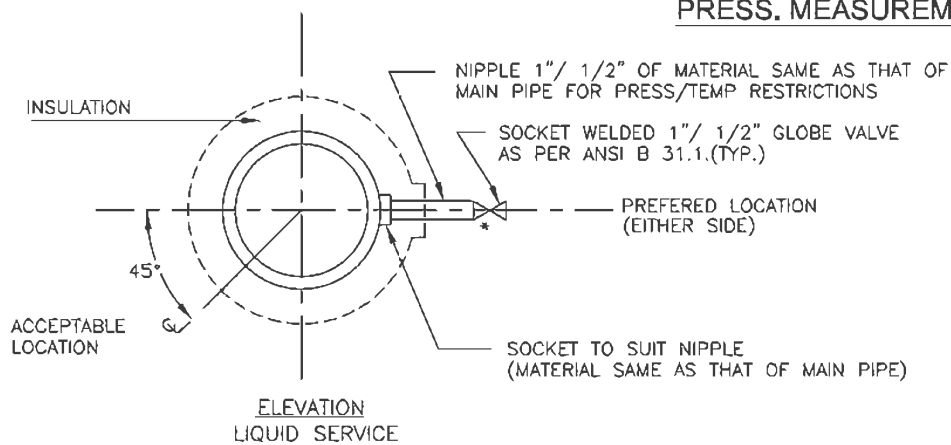


FOR TENDER PURPOSE ONLY

एन टी पी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION															
PROJECT TYPICAL THERMAL POWER PROJECT															
TITLE INSTRUMENT SOURCE CONNECTION DETAILS															
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	CLD	ARCH.	APPD.	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE											A4	N.T.S.	0000-999-POI-A-035	A
Cleared by												Sh-1 of 14			


This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

PRESSURE MEASUREMENT


(SYSTEM PR. >40Kg/Sq Cm CL 9000)

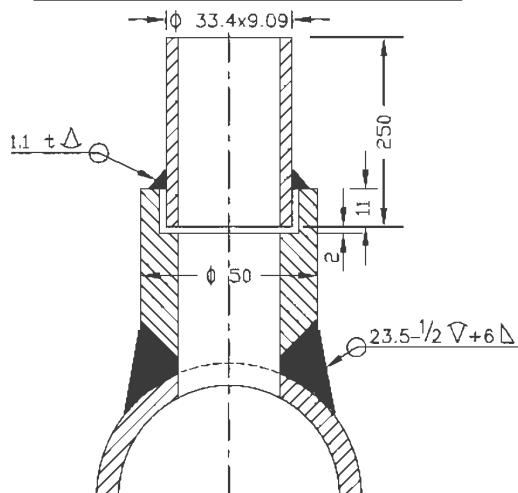


(SYSTEM PR. >40Kg/Sq Cm CL 6000)

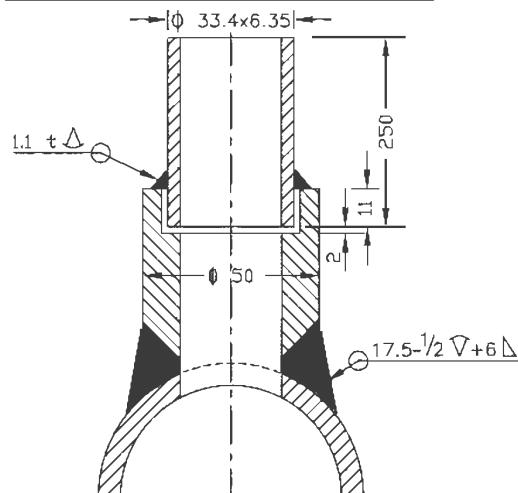

(SYSTEM PR. <40Kg/Sq cm Nb 25 CL 3000)

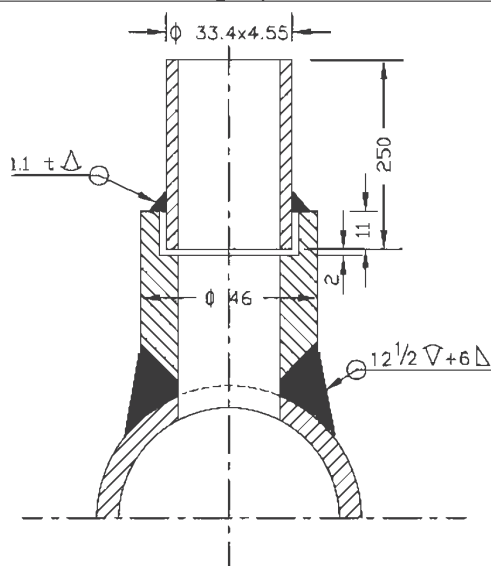

(SYSTEM PR. <40Kg/Sq cm Nb 15 CL 3000)

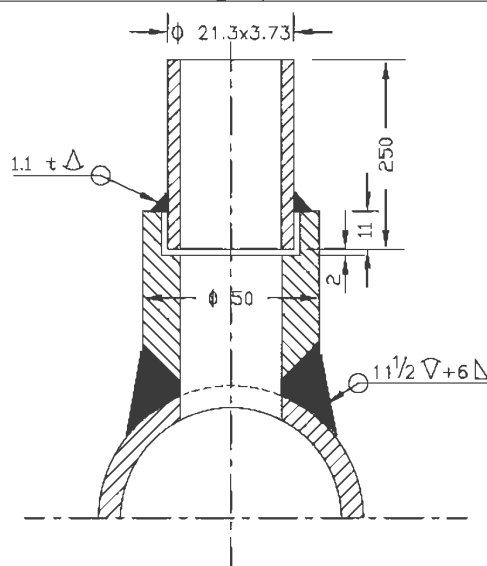


NOTES:-

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFIRM TO ANSI B 16.11.
2. THE LENGTH OF THE NIPPLE SHOULD BE 250mm.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 16.1.
4. TWO ISOLATED VALVES ARE TO BE USED FOR PRESSURE = >40 Kg/Cm².
5. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY (1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.
6. ORIENTATION OF TAP WILL BE VARY WITH TYPE OF PROCESS FLUID AND NATURE OF RUN OF THE PIPE.
7. ACTIVITIES TO BE COMPLETED AT THE SHOP, WELD THE COUPLING (OR BOSS) ON THE PIPE AND DRILL PRESSURE CONNECTION HOLE (SAME AS I D OF NIPPLE) IN THE PIPE IN ALIGNMENT WITH HOLE IN THE COUPLING.
8. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.

FOR TENDER PURPOSE ONLY


												एन टी सी लि NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION						
												PROJECT	TYPICAL THERMAL POWER PROJECT					
												TITLE	INSTRUMENT SOURCE CONNECTION DETAILS					
A	FIRST ISSUE							T.G.			Sh-2-10							
REV. NO.	DESCRIPTION		DRAWN	DESIGN	CHKD.	M	E	C	CL	ARCH.	APPD.	DATE	SIZE	SCALE	DRG. NO.	0000-999-POI-A-035	REV. NO.	
												Cleared by						

Sh-2 Of 14

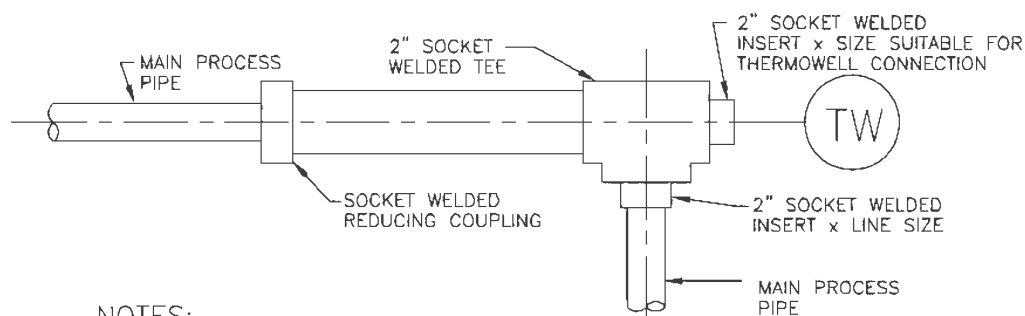TEMP. MEASUREMENT**NOTES:-**

1. THIS TYPE OF THERMOWELL INSTALLATION IS SUITABLE FOR THE PROCESS PIPE OF 2" NPS AND SMALLER.
2. FOR STEAM SERVICE THIS TYPE OF THERMOWELL INSTALLATION 90° BEND MAY BE USED ONLY IN VERTICAL PLANE.
3. THE LENGTH OF THE LARGER PIPE SECTION SHALL BE MINIMUM 150mm (IT MUST BE GREATER THAN THERMOWELL LENGTH).

THERMOWELL SUITABLE FOR THE BOSS

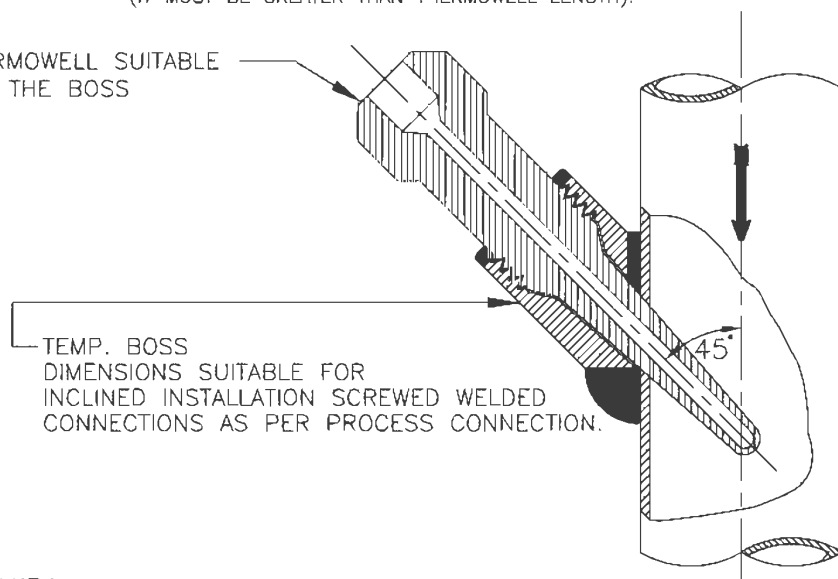**NOTES:-**


1. INCLINED INSTALLATION OF THERMOWELL SHALL BE APPLICABLE FOR 4" AND SMALLER LINE SIZE BUT LIMITED TO MIN. 3" LINE SIZE.
2. FOR 2" AND SMALLER LINE SIZE NECESSARY EXPANDER OF MIN. 3" SIZE OF MAIN PIPING SPECIFICATION SHALL BE USED.
3. THIS TYPE OF INSTALLATION IS APPLICABLE FOR HORIZONTAL AND VERTICAL PIPE SECTION.
4. FOR STEAM SERVICES EXPANDER SECTION MAY BE USED ONLY IN VERTICAL RUN.
5. THE EXPANDER SECTION SHALL BE OF ADEQUATE LENGTH (ATLEAST 3-4 TIMES DIA OF THE MAIN PROCESS PIPE AT BOTH SIDE OF THE INSTALLED THERMOWELL).

FOR TENDER PURPOSE ONLY

NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION PROJECT TYPICAL THERMAL POWER PROJECT (SG PACKAGE) TITLE INSTRUMENT SOURCE CONNECTION DETAILS									

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

TEMP. MEASUREMENT

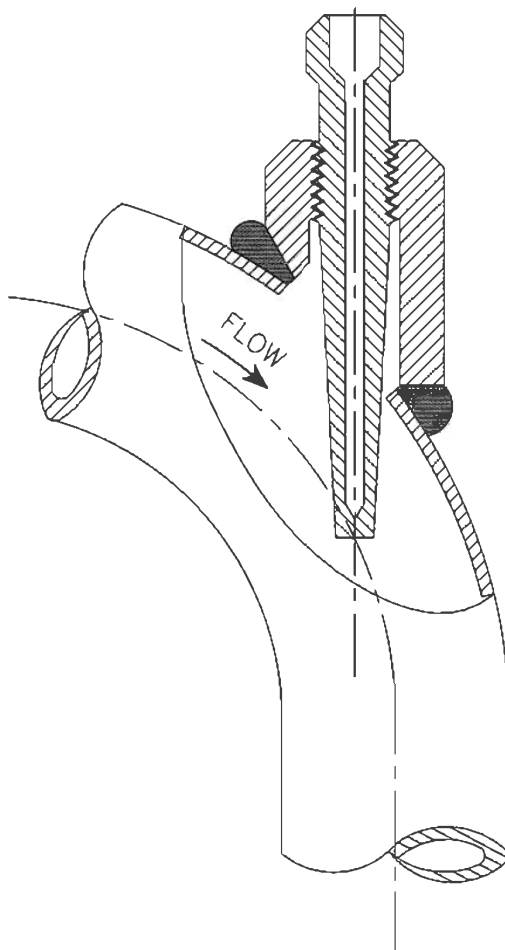


NOTES:—

1. FLOW INSTALLATION OF THERMOWELL SHALL BE APPLICABLE FOR 4" AND SMALLER LINE SIZE BUT LIMITED TO MINIMUM 3" LINE SIZE.
2. FOR 2" AND SMALLER LINE SIZE NECESSARY EXPANDER OF ELBOW FORM (AS SHOWN) OF MINIMUM 3" SIZE SHALL BE USED.
3. ELBOW EXPANDER SECTION IN HORIZONTAL PLANE MAY BE USED FOR LIQUID SERVICES. ONLY STEAM SERVICES EXPANDER SECTION MAY BE USED IN VERTICAL PLAN.

FOR TENDER PURPOSE ONLY

एन टी पी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION															
PROJECT TYPICAL THERMAL POWER PROJECT TITLE INSTRUMENT SOURCE CONNECTION DETAILS															
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	CLD	ARCH.	APPD.	DATE	SIZE A4	SCALE N.T.S.	DRG. NO. 0000-999-POI-A-035	REV. NO. A
		Cleared by												Sh-5 of 14	

TEMP. MEASUREMENT

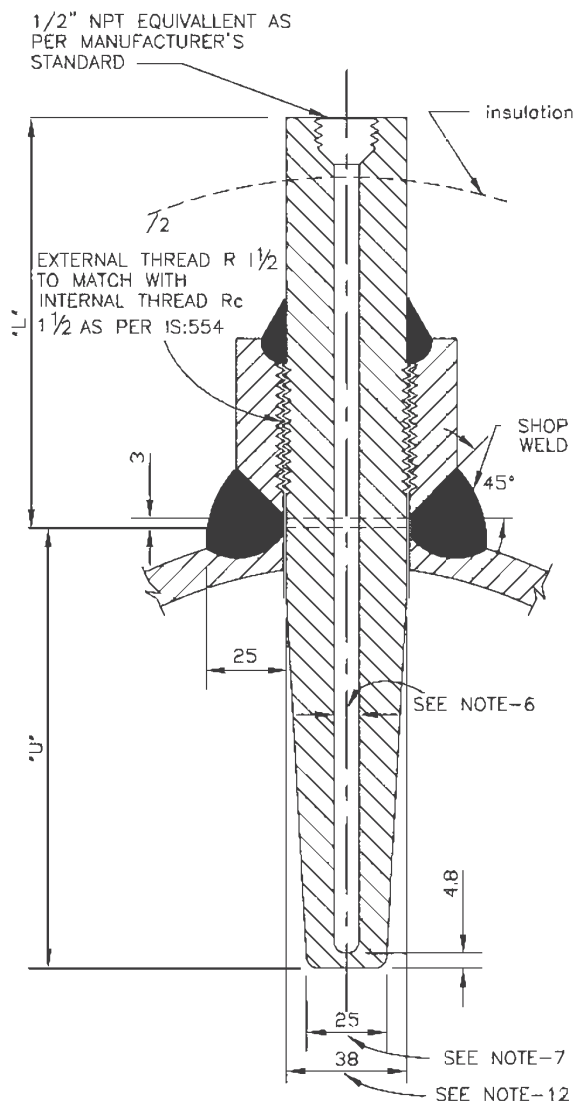


NOTES:-

1. THIS TYPE OF TEMPERATURE BOSS SHALL BE USED FOR THE PROCESS PRESS EQUAL/ABOVE 40 Kg/Cm2(g).
2. THE MATERIAL OF THE BOSS SHOULD BE SIMILAR TO THAT OF PIPING MATERIAL OF SPECIFICATION.
3. ALL WELD TO BE TESTED IN ACCORDANCE WITH APPLICABLE CODES BY MANUFACTURER.
4. MATERIAL OF THE THERMOWELL SHALL BE OF 316SS.
5. THERMOWELL SHALL BE DRILLED BARSTOCK TYPE.
6. INTERNAL BORE OF THE THERMOWELL SHOULD BE SELECTED BASED ON THE NORMAL SIZE OF THE SENSING ELEMENT AS PER ASME,PTC-19.3.
7. THE BOTTOM DIAMETER OF THE THERMOWELL TYPICALLY SHOWN HERE SHALL BE SUBJECT TO VARIATION BASED ON THE INTERNAL BORE OF THERMOWELL AND THICKNESS OF THERMOWELL MATERIAL TO WITHSTAND THE PROCESS PRESS.AND TEMP.,AS PER ASME,PTC-19.3
8. THE TYPE OF TAPERED THERMOWELL SHALL BE USED FOR LIQUID VELOCITIES UP TO 92M.P.S.(300F.T.P.S.).
9. THERMOWELL WITH THE INSULATION LAG EXTENSIONS SHALL BE USED WHEREVER APPLICABLE.
10. ACTIVITIES TO BE COMPLETED AT THE SHOP. WELD THE BOSS ON THE PIPE AND DRILL THE HOLE IN THE PIPE IN ALIGNMENT WITH HOLE IN THE BOSS. PROVIDE INTERNAL THREAD AS PER IS:554 TO MATCH WITH THE THERMOWELL EXTERNAL THREAD.
11. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED.
12. WILL BE SUITABLE TO MATCH THE STUB DIMENSIONS AS PER RC 1 1/2
13. THE "U" & "L" DIMENSIONS SHALL BE BE SELECTED BASED ON PARTICULAR APPLICATION AND THE SAME SHALL BE SUBJECT TO OWNER'S APPROVAL DURING DETAILED ENGINEERING.
14. ALL DIMENSIONS ARE INDICATIVE ONLY.

FOR TENDER PURPOSE ONLY

NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION PROJECT TYPICAL THERMAL POWER PROJECT TITLE INSTRUMENT SOURCE CONNECTION DETAILS																																	
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 10%;">REV. NO.</td> <td style="width: 30%;">DESCRIPTION</td> <td style="width: 10%;">DRAWN</td> <td style="width: 10%;">DESIGN</td> <td style="width: 10%;">CHKD.</td> <td style="width: 10%;">M</td> <td style="width: 10%;">E</td> <td style="width: 10%;">C</td> <td style="width: 10%;">C/L</td> <td style="width: 10%;">ARCH.</td> <td style="width: 10%;">APPD.</td> <td style="width: 10%;">DATE</td> </tr> <tr> <td>A</td> <td>FIRST ISSUE</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </table>										REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C/L	ARCH.	APPD.	DATE	A	FIRST ISSUE										
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C/L	ARCH.	APPD.	DATE																						
A	FIRST ISSUE																																
SIZE A4 SCALE N.T.S. DRG. NO. 0000-999-POI-A-035 Sh-8 Of 14 REV. NO. A																																	

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

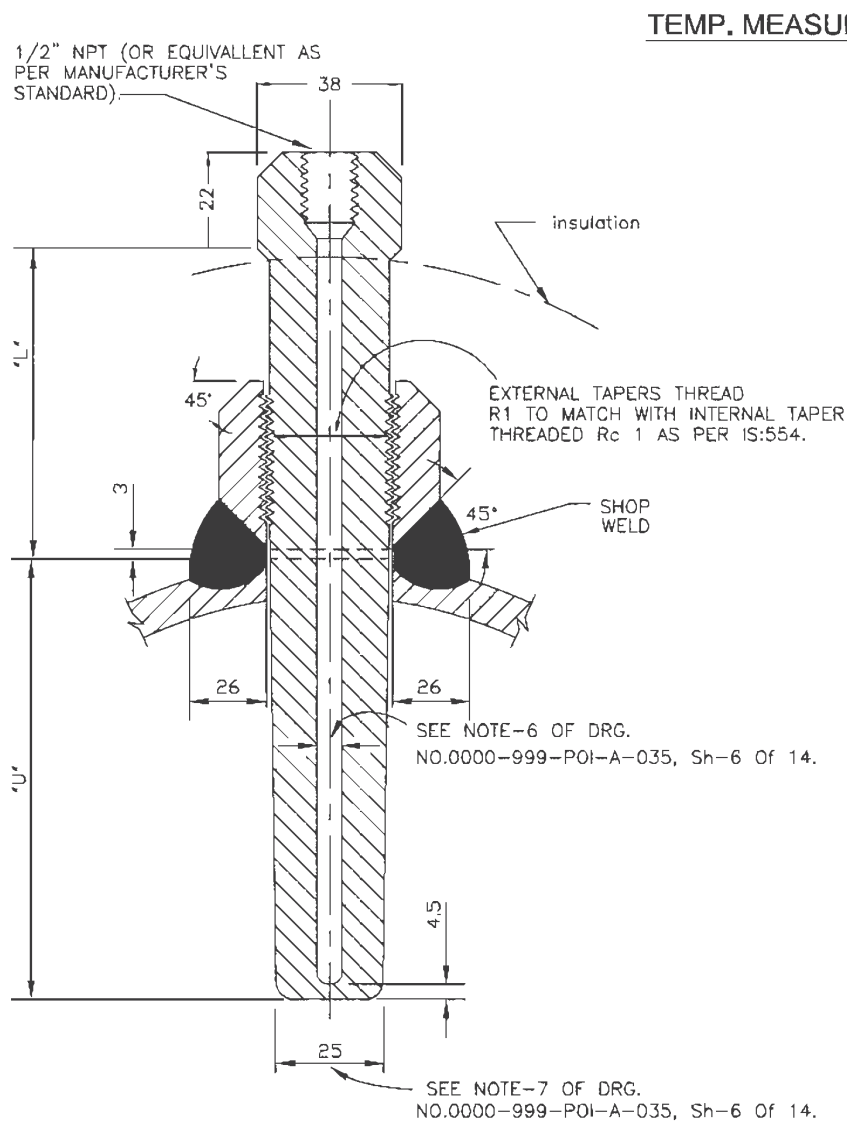


NOTES:-

1. THIS TYPE OF TEMPERATURE BOSS IS APPLICABLE FOR THE PROCESS PRESSURE/TEMPERATURE BELOW 40 Kg/Cm2(g)/400°C
2. FOR PRESSURE TIGHT JOINTS THE BOSS SHOULD HAVE INTERNAL TAPERED PIPE THREAD Rc 1 AS PER IS:554. THE LENGTH OF THREAD ENGAGEMENT SHOULD BE AS PER ABOVE STANDARD.
3. PIPES HAVING PROBABILITY OF PROLONGED VIBRATION SEAL WELDING MAY BE DONE ALL AROUND AFTER TIGHTENING THERMOWELL WITHIN THE BOSS.
4. SEE NOTES-2 TO 14 OF DRG. NO. 0000-999-POI-A-035, Sh-6 Of 14.

FOR TENDER PURPOSE ONLY

										एन टी सी NTPC		NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION	
										PROJECT		TYPICAL THERMAL POWER PROJECT	
										TITLE		INSTRUMENT SOURCE CONNECTION DETAILS	
A	FIRST ISSUE							T.G.		SH. NO. 10			
REV. NO.	DESCRIPTION		DRAWN	DESIGN	CHKD.	M	E	C	CM	ARCH.	APFD.	DATE	SIZE
													A4
			Cleared by										SCALE
													N.T.S.
													DRG. NO.
													0000-999-POI-A-035
													REV. NO.
													A

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

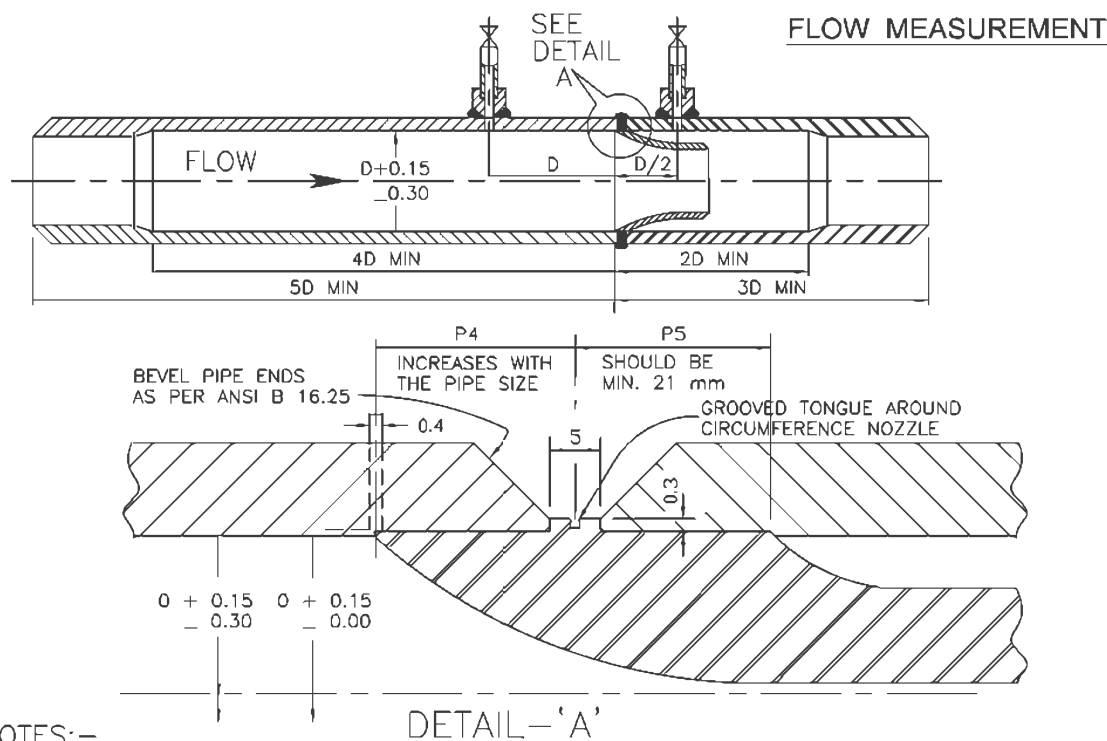

NOTES:-


1. COMPLETE FLOW NOZZLE BRANCH ASSEMBLY ALONG WITH NIPPLES AND SOURCE ISOLATION VALVES SHALL BE SUPPLIED BY THE BIDDER. THE BIDDER ALSO TO INSTALL FLOW NOZZLE WITHIN THE MACHINED BRANCH, PRESSURE STUBS ON THE BRANCH PIPE (FOR ORIENTATION OF PRESSURE TAP REF. NOTE-3) ALONG WITH NIPPLE AND SOURCE ISOLATION VALVES.
2. THE MACHINING OF BRANCH PIPE SHOULD BE DONE AFTER PRESSURE CONNECTIONS HAVE BEEN WELDED TO PIPE AND ALSO EXTEND FOR ATLEAST 4D IN THE INLET SECTION, 2D IN THE OUTLET SECTION, MEASURED FROM THE INLET FACE OF FLOW NOZZLE. TOTAL BRANCH PIPE ASSEMBLY SHOULD BE ATLEAST A LENGTH OF 8D/5D IN THE INLET SECTION AND 3D IN THE OUTLET SECTION, MEASURED FROM THE INLET FACE OF THE FLOW NOZZLE AS SHOWN ABOVE.
3. ON HORIZONTAL PIPE RUN PRESSURE CONNECTIONS ARE TO BE LOCATED ON SIDES OF THE PIPE FOR LIQUID AND STEAM SERVICE AND ON THE TOP FOR DRY GAS SERVICE FOR PROCESS LIQUIDS, INSTALLATION OF PRESS. TAPS MAY BE ALLOWED WITHIN AN ANGLE OF 45° ELBOW HORIZONTAL FOR SPECIAL CASES BUT NO BOTTOM CONNECTIONS ARE ALLOWED.
4. THE LOCATION OF PRESSURE TAPS MUST BE WITHIN 1.5 mm (1/16") OF DISTANCE SPECIFIED AND NUMBER OF PAIRS OF PRESSURE TAPS TO BE PROVIDED WILL BE AS PER FLOW MEASUREMENT DATA SHEET.
5. PRESSURE TAPS SHOULD BE DRILLED RADIALLY WITH RESPECT TO PIPE AND THIS DRILLING SHOULD BE DONE AFTER ANY COUPLING FOR ATTACHING THE PRESSURE TUBING HAS BEEN WELDED TO THE PIPE. THE HOLE WHERE IT BREAKS THROUGH THE INNER SURFACE OF THE PIPE MUST BE FREE OF BURRS OR WIRE EDGE AND CORNER OF EDGE HOLE LEFT ROUNDED VERY SLIGHTLY (1/64" RADII).
6. RECOMMENDED MAXIMUM DIAMETERS OF PRESSURE TAP HOLES IN THE BRANCH PIPES WILL BE AS PER EN ISO 5167:2003. THE DIAMETER FOR HOLE SHOULD REMAIN SAME FOR DISTANCE NOT LESS THAN 2.5 TIME OF DIA FROM THE INNER SURFACE OF THE PIPE.
7. FLOW NOZZLE SHALL BE CENTRED IN THE PIPE WITHIN 0.8 mm (1/32") OF THE PIPE AXIS. INSIDE DIAMETER MEASURED AT FOUR POINTS AT ANY CROSS SECTION SHALL NOT DIFFER BY MORE THAN 1%.
8. BRANCH PIPE SHALL BE AS PER MAIN PIPING MATERIAL SPECIFICATION. INTERNAL SURFACE OF BORED SECTIONS MUST BE SMOOTH AND STRAIGHT, FREE FROM SCALES, PITS, BURRS OR ANY IRREGULARITIES.
9. FLOW NOZZLE MATERIAL SHALL BE 316 SS AND THE DESIGN AS PER ASME.
10. MAXIMUM UPSTREAM AND DOWN STREAM STRAIGHT LENGTH REQUIRED FROM INLET FACE OF FLOW NOZZLE SHALL BE AS PER EN ISO 5167:2003.

FOR TENDER PURPOSE ONLY

प न टी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION															
PROJECT TYPICAL THERMAL POWER PROJECT															
TITLE INSTRUMENT SOURCE CONNECTION DETAILS															
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	CLD	ARCH.	APPD.	DATE	SIZE A4	SCALE N.T.S.	DRG. NO. 0000-999-POI-A-035	REV. NO. A
Cleared by														Sh-11 of 14	

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

FLOW MEASUREMENT

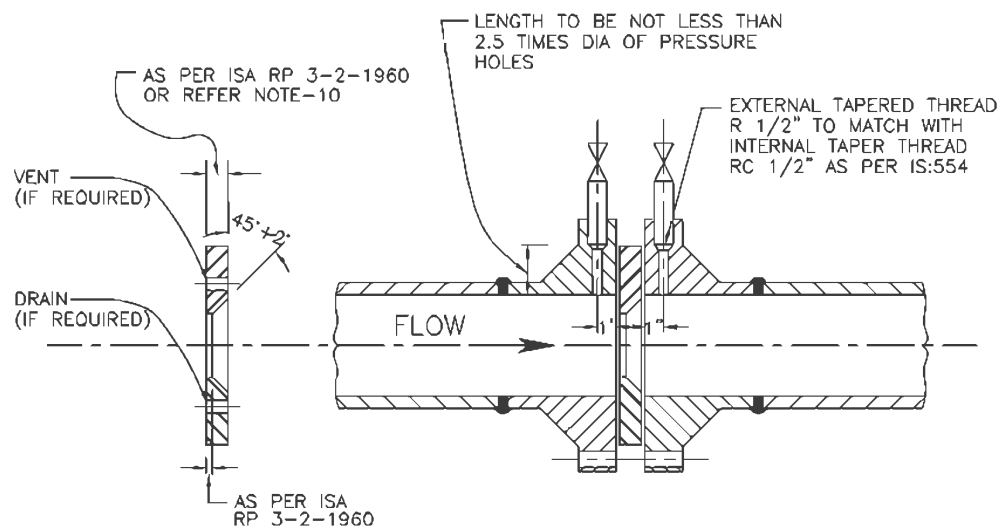



NOTES:—

1. ORIFICE PLATE MOUNTED BETWEEN FLANGES WITH FLANGE TAPPING (AS SHOWN ABOVE) SHOULD BE LIMITED TO PIPE SIZES OF 2" OR LARGER.
2. ORIFICE PLATE SHALL BE MOUNTED BETWEEN PIPING FLANGES WITH THE SHARP EDGE FACING UPSTREAM SUCH THAT CENTRE OF THE CONCENTRIC ORIFICE SHOULD BE WITHIN 0.79 mm (1/32") OF THE AXIS OF THE PIPE.
3. TWO GASKETS SHALL BE INSERTED BETWEEN THE PLATE AND THE FLANGES AND INSIDE DIAMETER OF THE GASKETS SHOULD BE ATLEAST 1.5 mm (1/16") GREATER THAN THE INSIDE DIAMETER OF THE PIPE SO THAT THEY DO NOT PROTRUDE INTO THE PIPE.
4. PIPING FLANGES SHALL BE ANSI WELD NECK, RAISED FACE TYPE. THE FLANGE IS TO BE ALIGNED WITH THE FACE PERPENDICULAR TO THE FLOW AXIS.
5. BIDDER TO SUPPLY ORIFICE PLATE SPECIAL TYPE (HAVING PRESS. CONNECTIONS) OF FLANGES ALONG WITH GASKETS, NIPPLES AND SOURCE VALVES.
6. ON HORIZONTAL PIPE RUN PRESSURE CONNECTIONS ARE TO BE TAKEN FROM SIDES FOR LIQUID AND STEAM SERVICE AND FROM TOP FOR DRY GAS SERVICE. FOR PROCESS LIQUIDS INSTALLATION OF PRESSURE TAPS MAY BE ALLOWED WITHIN AN ANGLE OF 45° ELBOW THE HORIZONTAL IN SPECIAL CASES BUT NO BOTTOM CONNECTIONS ARE ALLOWED.
7. THE LOCATION OF PRESSURE TAPS MUST BE WITHIN 1.5 mm (1/16") OF THE DISTANCE SPECIFIED.
8. MAXIMUM DIAMETER OF PRESS. CONNECTION HOLES SHALL BE AS PER RECOMMENDATIONS OF ASME PTC 19.5. THE DIAMETER OF THE HOLE SHOULD REMAIN THE SAME FOR A DISTANCE NOT LESS THAN 2.5 TIMES OF THE DIAMETER BEFORE EXPANDING INTO THE PRESSURE PIPE.
9. THERE MUST BE NO BURRS WIRE EDGES OR OTHER IRREGULARITIES ALONG THE EDGE OF THE HOLE AND IT MUST BE SQUARE AND ROUNDED SLIGHTLY (1/64" RADIUS).
10. ORIFICE PLATE SHOULD BE FLAT WITHIN 0.02 mm (0.001") AND THE SURFACE ROUGHNESS SHOULD NOT EXCEED 20 MICRO INCH. THE THICKNESS OF THE ORIFICE PLATE SHOULD BE AS PER EN ISO 5167:2003.
11. FOR HORIZONTAL PIPE RUN DRAIN HOLES IN ORIFICE PLATES ARE AT THE BOTTOM (APPROX. TANGENT TO INSIDE DIA OF PIPE) FOR STEAM OR GAS SERVICE. VENT HOLES SHOULD BE LOCATED ON UPPER SIDE FOR INCOMPRESSIBLE FLUID.
12. ORIFICE PLATE SHOULD BE OF 316 SS (ASTM A167-54 GRADE-II).
13. RECOMMENDED MINIMUM LENGTHS OF STRAIGHT PIPE PRECEDING AND FOLLOWING ORIFICES SHALL BE AS PER EN ISO 5167:2003.
14. THREE PAIRS OF PRESSURE TAPS SHALL BE PROVIDED WITH NIPPLES OF REQUIRED LENGTH AND SOURCE VALVES AND THE UN-USED TAPS ARE PLUGGED.
15. THE INTERNAL TAPERED CONNECTION WITHIN THE FLANGE FOR PRESSURE TAPS SHOULD BE RC 1/2" AND THE NIPPLE SHOULD ALSO OF EXTERNAL THREADED R 1/2" AS PER IS:554. THE LENGTH OF THREADED ENGAGEMENT SHALL BE AS PER ABOVE STANDARD.

FOR TENDER PURPOSE ONLY

एन टी पी सी NTPC NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION																
PROJECT TYPICAL THERMAL POWER PROJECT																
TITLE INSTRUMENT SOURCE CONNECTION DETAILS																
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHD.	M	E	C	CHK	ARCH.	APPD.	DATE	SIZE A4	SCALE N.T.S.	DRG. NO. 0000-999-POI-A-035	REV. NO. A	
Cleared by										Sh-12 of 14						

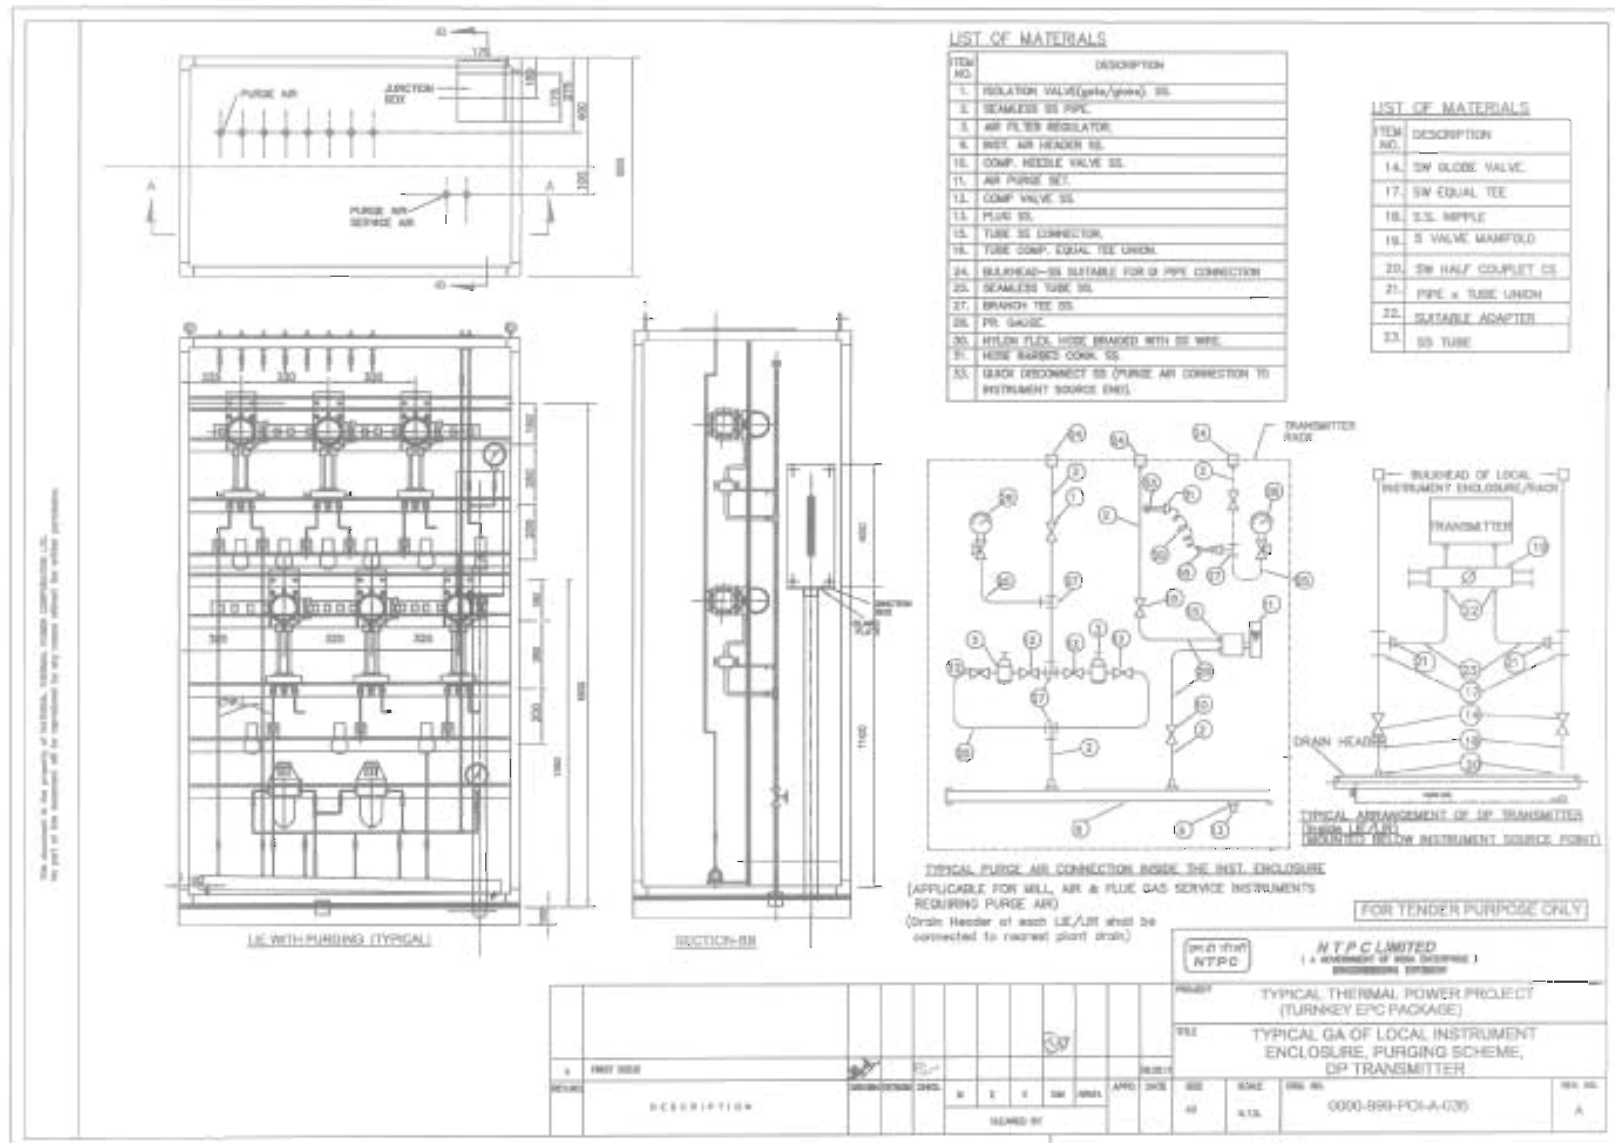



NOTES:—

1. JUNCTION BOXES SHALL HAVE GLAND PLATES AT THE BOTTOM OF THE BOX ONLY.
2. TUBULAR TYPE GASKETS WILL BE USED.
3. FRP JUNCTION BOXES, SHALL BE PROVIDED WITH POLYEUTHERENE COATING. ALSO REFER SUB SECTION INST CABLE, PART-8 SECTION-VI FOR DETAILS.
4. DIMENSION OF 'C' SHALL BE BASED ON NO. OF TERMINAL BLOCKS.
5. THE EXACT TYPE & DIMENSION OF JUNCTION BOXES TO BE USED FOR A PARTICULAR APPLICATION SHALL BE AS DECIDED DURING DETAIL ENGG. STAGE AND SHALL BE SUBJECT TO EMPLOYER'S APPROVAL WITHOUT ANY PRICE REPERCUSSION.
6. THE KNOB FOR ALL THE JUNCTION BOXES SHALL BE IDENTICAL.
7. ANY TYPE OF SEALED FIXING ARRANGEMENT AS PER MANUFACTURER'S STANDARD CAN ALSO BE PROVIDED SUBJECT TO EMPLOYER'S APPROVAL.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

												PROJECT TYPICAL THERMAL POWER PLANT			
D	GENERALLY REVISED		JM	KS							21.08.12	TITLE G.A. OF JUNCTION BOX			
C	GENERALLY REVISED		JM	KS							04.08.06				
B	GENERALLY REVISED	S.K.	A.R	PS											
A	FIRST ISSUE	S.K.	A.R	PS							04.05.05				
REV.NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
					CLEARED BY				A4			N.T.S.	0000-999-POI-A-017	D	


247927/2021/PS-PFM-MAX


**C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM**SECTION: C
SUB SECTION: C&I**INSTRUMENT INSTALLATION DRAWINGS**

CLAUSE NO.	TECHNICAL REQUIREMENTS 								
	PROCESS CONNECTION AND PIPING								
1.01.01	IMPULSE PIPING, TUBING, FITTINGS, VALVES AND VALVE MANIFOLDS								
1.01.02	All impulse pipes shall be of seamless type conforming to ANSI B36.10 for schedule numbers. The size of impulse pipe shall be ½" for Steam & Water Application and ¾" for Air & Flue Gas applications. The rating of material of impulse pipes, tubes, fittings, valves and their installation thereof shall conform to the latest edition of standards as per following table: <table border="1" data-bbox="418 680 1359 819"> <tr> <td>Impulse Pipes, Tubes (Material, Rating)</td><td>ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70</td></tr> <tr> <td>Valves (Material, Pr. Class, Size)</td><td>ASTM A182/ASTM A105 as per ASME 16.34</td></tr> <tr> <td>Fittings (Size, Rating, Material)</td><td>ANSI B31.1, ANSI B31.1a, ASME B16.11-2009</td></tr> <tr> <td>Installation Schemes</td><td>BS 6739-2009, ANSI/ISA 77.70</td></tr> </table> Stainless steel tube shall be provided inside enclosures & racks from tee connection to valve manifold and then to instrument. The source shut-off (primary process root valve) and blow down valve shall be of 1/2 inch size globe valve type for all applications except for air and flue gas service wherein no source shut-off valves are to be provided. Two root valves are to be used wherever pressure is more than 40 Kg/cm² or Temp>280 °C. The end connections of valves shall be of socket welded type. Typical installation scheme of DP Transmitter (inside LIE/LIR) mounted below instrument source point is indicated in Drg. No. 0000-999-POI-A-036. Same scheme with necessary changes shall be applied for other instruments.	Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70	Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34	Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009	Installation Schemes	BS 6739-2009, ANSI/ISA 77.70
Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70								
Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34								
Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009								
Installation Schemes	BS 6739-2009, ANSI/ISA 77.70								
1.01.03	The valve manifolds of 316 SS with pressure rating suitable for intended application shall be provided as given below: <table border="1" data-bbox="418 1142 1359 1255"> <tr> <th>Manifold</th><th>Application/Masurement</th></tr> <tr> <td>2 Valve</td><td>Pressure measurements using pressure transmitters/pressure switches</td></tr> <tr> <td>3 Valve</td><td>Pressure measurements using differential pressure transmitter/ switches</td></tr> <tr> <td>5 Valve</td><td>Differential Pressure, Flow and Level Measurements</td></tr> </table> For Pr./D.P gauges, two-way globe/gate valve shall be provided on each impulse line to the instrument in Fluid/Air & Flue Gas applications respectively .	Manifold	Application/Masurement	2 Valve	Pressure measurements using pressure transmitters/pressure switches	3 Valve	Pressure measurements using differential pressure transmitter/ switches	5 Valve	Differential Pressure, Flow and Level Measurements
Manifold	Application/Masurement								
2 Valve	Pressure measurements using pressure transmitters/pressure switches								
3 Valve	Pressure measurements using differential pressure transmitter/ switches								
5 Valve	Differential Pressure, Flow and Level Measurements								
2.00.00	AIR SUPPLY PIPING								
2.01.01	All pneumatic piping, fittings, valves, air filter cum regulator, purge rotameter and other accessories required for instrument air for the various pneumatic devices/ instruments shall be provided. This will include as a minimum air supply to pneumatically operated control valves, actuators, instruments, continuous and intermittent purging requirements etc.								
2.02.00	Instrument air and Service air supply shall be provided for continuous and intermittent purging respectively for all transmitters of mill, dirty air and flue gas applications. Purging Scheme shall be as per Drg. No. 0000-999-POI-A-036.								
2.03.00	The Contractor shall also provide SS Tubing and associated fittings (screwed type) of suitable sizes for all pneumatic equipments/actuators (including supply air, signal air and output to actuators) conforming to ANSI 31.1 and 31.3 standard. All other air supply lines shall be of mild steel hot dipped galvanized inside and outside as per IS-1239, heavy duty								


CLAUSE NO.	TECHNICAL REQUIREMENTS 
	with threaded ends. Fittings for air supply line shall be of forged carbon steel A234 Gr. WPB galvanized inside and outside, screwed as per ASA B2.1. Dimensions of fittings shall be as per ASA B16.11 of rating 3000 lbs. Air supply piping shall be adequately sloped to prevent accumulation of condensed water within the pipe. The air supply headers, sub-headers and branch pipes shall be supported properly by clamps or supports.
2.04.00	The instrument/service air supply to each equipment/devices requiring air supply shall be provided by a well designed air distribution scheme comprising of 2" GI Pipe Header feeding 1" GI Pipe sub-header feeding 1/2" pipe at each equipment/device. Instrument air filters cum regulator set with mounting accessories shall be provided for each pneumatic device requiring air supply except for Ash Handling System wherein it shall be provided on instrument air header at each location.
2.05.00	All the isolation valves in the air supply line shall be gate valves as per ASTM B62 inside screw rising stem, screwed female ends as per ASA B2.1. Valve bonnet shall be union type & trim material shall be stainless steel, body rating 150 pounds ASA. The valve sizes shall be 1/2 inch to 2 inch.
2.06.00	Instrument air filters cum regulator set with mounting accessories shall be provided for pneumatic device requiring air supply. The filter regulators shall be suitable for 10-kg/ sq.cm max. Inlet pressure. The filter shall be of size 5 microns and of material sintered bronze. The air set shall have 2-inch size pressure gauge and built in filter housing blowdown valve. The end connection shall be as per the requirement to be finalized during detailed engineering.
3.00.00	INSTALLATION AND ROUTING
3.01.01	All instrument piping, tubing and its accessories shall be supported in a safe manner to prevent excessive vibrations and anchored sufficiently to prevent undue strain on connected equipment. Impulse piping shall be supported at an interval not exceeding 1.5 meters. The slope of the impulse pipe from the process connection to the instrument shall be as per ANSI/ISA 77.70 latest edition and BS 6739-2009. All impulse piping shall be installed to permit free movement due to thermal expansion. Wherever required expansion loops shall be provided. Condensate pots shall be provided for all level measurements in steam and water services, all flow measurement in steam services and for flow measurements in water services above 120 Deg. C. Colour coding of all impulse pipes shall be done by the Contractor in line with the colour coding being followed for the parent pipes.
4.00.00	SHOP AND SITE TESTS
4.01.01	The equipment and work performed as per this Sub-section shall be subject to shop and site test as per requirements of Sub-section-IIIIE-04 (Quality Assurance & Inspection) other applicable clauses of this Sub-section and Employer approved quality assurance plan.
4.01.02	Hydrostatic and Pneumatic leakage tests shall be performed on all pipes, tubing and systems and shall conform to ANSI B31.1.
5.00.00	LOCAL INSTRUMENT ENCLOSURE AND RACKS All transmitters, switches etc. for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) local instruments enclosures in case of open areas of the plant and (ii) In local instrument racks in case of covered areas. The GA of LIE with purging indicated in the Drg. No. 0000-999-POI-A-036 is to be followed by contractor. The GA of LIR shall be similar to LIE except for front/rear doors and side panels.

CLAUSE NO.	TECHNICAL REQUIREMENTS 
5.01.00	The internal layout shall be such that the impulse piping/ blow down lines are accessible from back side of the enclosure / rack and the transmitters etc. are accessible from front side for easy maintenance. Bulkheads, especially designed to provide isolation from process line vibration shall be installed on instrument enclosures/racks to meet the process sensing line connection requirement. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of LIE and JB of LIE/LIR shall be IP-55. The enclosures shall be constructed of 3 mm sheet plate and shall be of modular construction with one or more modules and two end assemblies bolted together to form an enclosure. Double inter locking doors shall be provided. The doors shall be the three-point locking type constructed of not less than 1.6 mm thick steel. Doors shall have concealed quick removal type pinned hinges and locking handles. Door locks shall accept the same key. The instrument racks shall be free standing type constructed of suitable 5 mm thick channel frame of steel and shall be provided with a canopy to protect the equipment mounted in racks from falling objects, water etc. The canopy shall not be less than 3 mm thick steel, and extended beyond the ends of the rack. Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein. Centre posts or any member which would reduce access shall not be provided. Contractor shall provide not more than three variants for LIE/LIR with respect to max. no. transmitters mounted in each LIE/LIR. ENCLOSURE / RACKS FOR DUAL I/P TEMPERATURE TRANSMITTERS All Dual Input temperature transmitters for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) Enclosures in case of open areas of the plant and (ii) Racks in case of covered areas. Integral JB shall be provided with each Enclosure and Rack. The internal layout shall be such that the transmitters are accessible from both front and back side of the enclosure / rack for easy maintenance. Enclosure/ Racks shall be of robust and rugged design. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of Enclosure and JB shall be IP-55. Enclosure and Racks shall be free standing type. Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein. Contractor shall provide not more than five variants for Enclosure/ Rack with respect to max. no. transmitters mounted in each Enclosure/ Rack. However, the maximum number of Transmitters that can be grouped in one Enclosure/ Rack shall be decided during detail Engineering.






This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

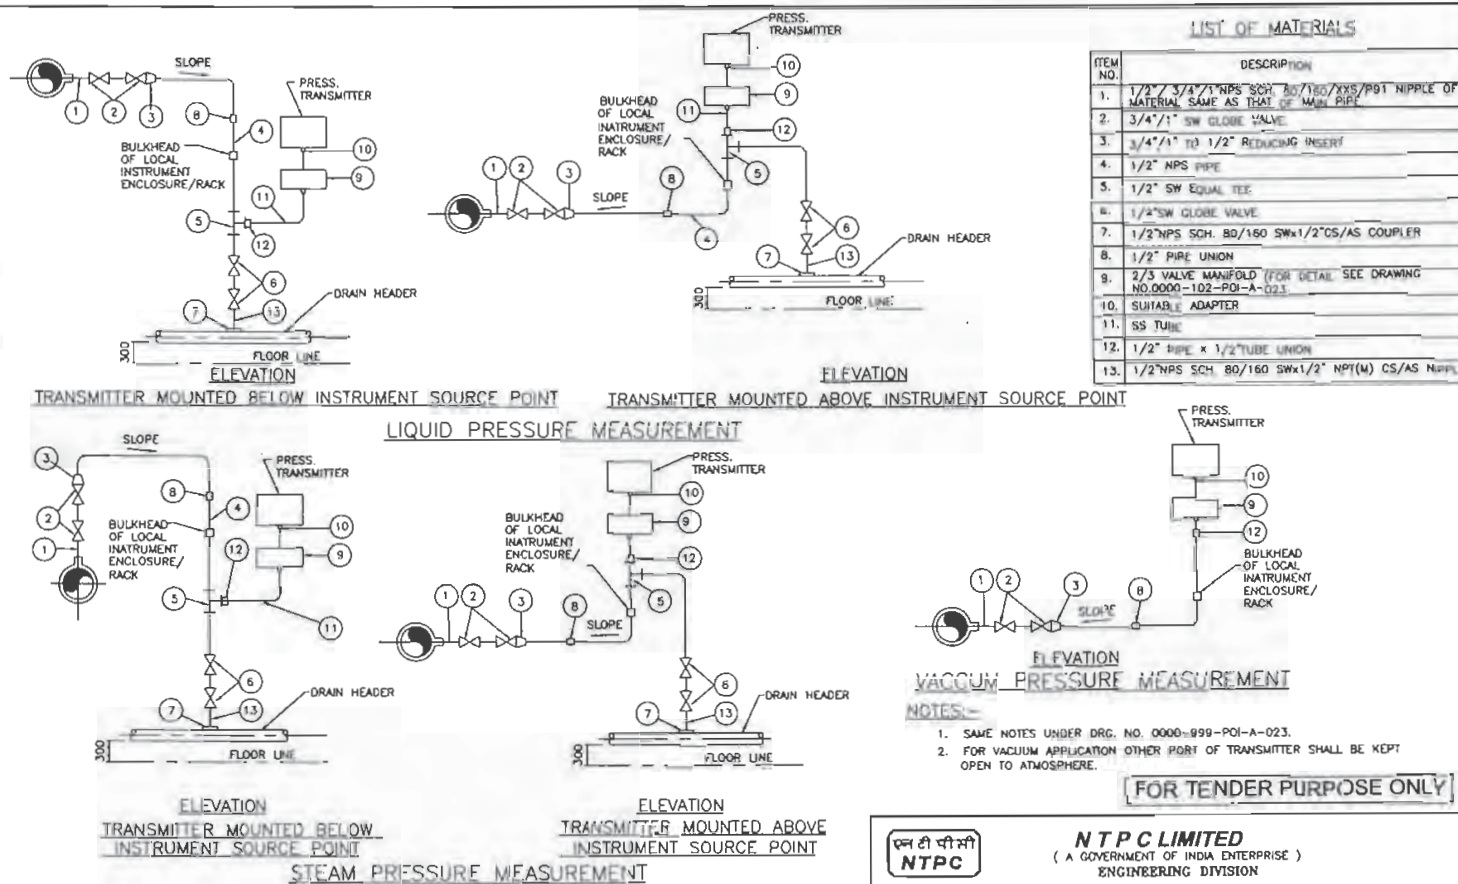


PROJECT										TYPICAL THERMAL POWER PROJECT			
TITLE										INSTRUMENT INSTALLATION DIAGRAM (PRESSURE MEASUREMENT USING PRESS /DP TRANSMITTERS STEAM/LIQUID VACUUM)			
REV. NO.										0000-999-POI-A-025			
DESCRIPTION										A			
Cleared by										A3			
DATE										21.06.12			
DESIGN										N.T.S.			
M										A			
E										A			
C										A			
C&I										A			
ARCH.										A			


This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

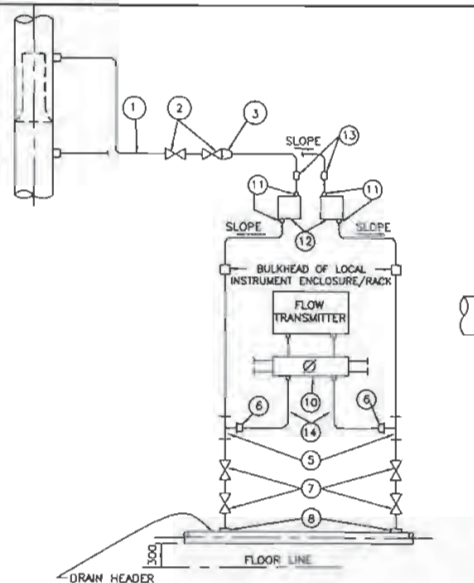


ELEVATION
FEED/ATTEMPERATION WATER FLOW MEASUREMENT IN VERTICAL
PIPE-TRANSMITTER MOUNTED BELOW INSTRUMENT SOURCE POINT



DETAIL OF 5 VALVE MANIFOLD
(ITEM NO. 10)

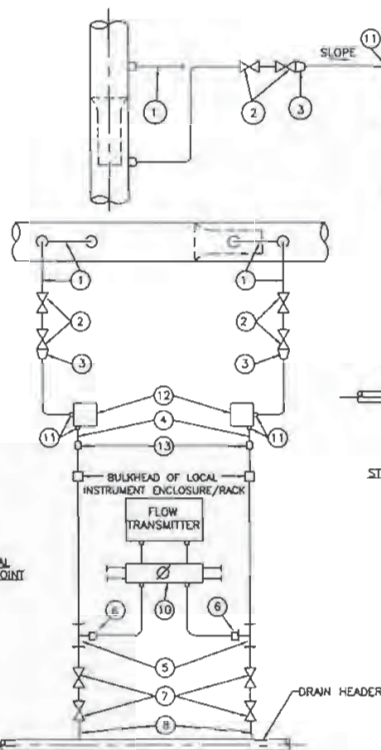

ELEVATION
FEED/ATTEMPERATION WATER FLOW MEASUREMENT IN HORIZONTAL
PIPE-TRANSMITTER MOUNTED BELOW INSTRUMENT SOURCE POINT

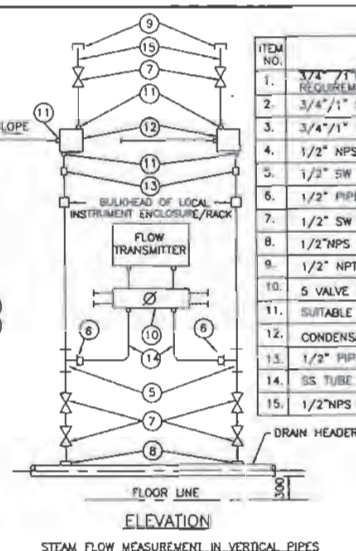

ELEVATION
STEAM FLOW MEASUREMENT IN VERTICAL PIPES

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	3/4" / 1" NPS SCH. 80/160/XXS/PS1 (AS PER PROCESS REQUIREMENT) NIPPLE OF MATERIAL SAME AS THAT OF MAIN PIPE
2.	3/4"/1" SW GLOBE VALVE.
3.	3/4"/1" TO 1/2" REDUCING INSERT
4.	1/2" NPS PIPE
5.	1/2" SW EQUAL TEE
6.	1/2" PIPE x 1/2" TUBE UNION
7.	1/2" SW GLOBE VALVE.
8.	1/2"NPS SCH. 80/160 SWx1/2" SW CS/AS COUPLER
9.	1/2" NPT (F) CAP
10.	5 VALVE MANIFOLD
11.	SUITABLE ADAPTER
12.	CONDENSATE POT (RESERVOIR)
13.	1/2" PIPE UNION
14.	SS TUBE
15.	1/2"NPS SCH. 80/160 SWx1/2" NPT (M) CS/AS NIPPLE

NOTES:-

1. SAME NOTES UNDER DRG. NO. 0000-999-POI-A-023.
2. CONDENSATE POTS SHALL BE PROVIDED FOR ALL STEAM SERVICES.
3. FOR WATER SERVICES CONDENSATE POTS SHALL BE PROVIDED ONLY IN THOSE CASES WHERE TEMP. > 120°C

FOR TENDER PURPOSE ONLY

NTPC

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT **TYPICAL THERMAL POWER PROJECT**

TITLE **INSTRUMENT INSTALLATION DIAGRAM
FLOW MEASUREMENT (USING FLOW NOZZLES)
STEAM & FEEDWATER**

REV. NO. **A** FIRST ISSUE

DESCRIPTION

DRAWN DESIGN CHKD.

M E C C&I ARCH.

CLEARED BY

APPO

DATE

21.08.12

SIZE

A3

SCALE

N.T.S.


DRG. NO.

0000-999-POI-A-026

REV. NO.

A

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.

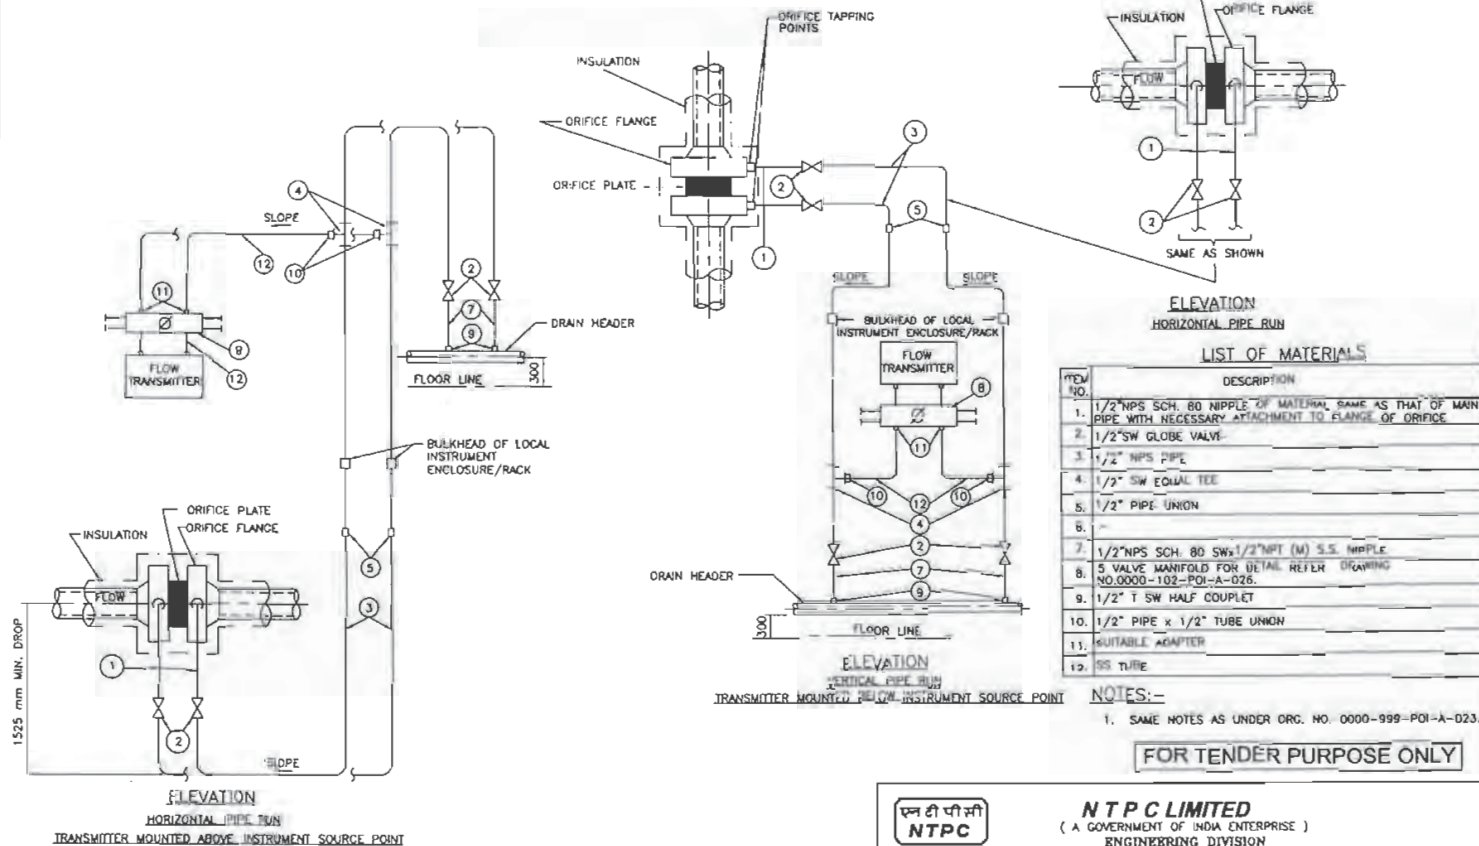

एन टी पी सी
NTPC

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT TYPICAL THERMAL POWER PROJECT

TITLE INSTRUMENT INSTALLATION DIAGRAM
FLOW MEASUREMENT (USING ORIFICE PLATES)
CONDENSATE & SERVICE WATER

A FIRST ISSUE

REV. NO

DESCRIPTION

DRAWN

DESIGN

CHKD.

M

E

C

C&I

ARCH

APPD

DATE

SIZE

SCALE

DRG. NO.

REV. NO.

0000-999-POI-A-027



REV. NO.

A

CLEARED BY

21.08.12

T.G.



ITEM NO.	DESCRIPTION
1.	42x4.50mm U.S. BLACK PIPE
2.	M 42x2 TO 3/4"SW REDUCING INSULT.
3.	3/4" SW GLOBE VALVE
4.	3/4" PIPE
5.	3/4" SW EQUAL TEE
6.	5/4" SCH. 80 SW 3/4" NPT (M) CS/AS NIPPLE
7.	3/4" NPT (F) CAP.
8.	3/4" PIPE UNION
9.	5 VALVE MANIFOLD FOR DETAIL REFER DRAWING NO.0000-102-P01-A-028.
10.	5/4" SW EQUAL TEE
11.	3/4" SW GATE VALVE
12.	3/4" PIPE x 1/2" TUBE UNION
13.	DRAIN POT.
14.	1/2" GI FITTING
15.	1/2" REG. ON PIPE
16.	SUITABLE ADAPTER
17.	SS TUBE
18.	QUICK DISCONNECT FITTINGS.
19.	3/4" SW x WAY VALVE
20.	3/4" x 1/2" REDUCER.

1. SAME NOTES AS UNDER DRG. NO. 0000-999-POI-A-023.

एन टी पी सी
NTPC

CLEARED BY

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written permission.



LIST OF MATERIALS	
ITEM NO.	DESCRIPTION
1.	42x2 to 3/4" SW REDUCING INSERT.
2.	3/4" SW GLOBE VALVE.
3.	1/2" SW GLOBE VALVE FOR LIQUID APPLICATION & 3/4"/1" IN GAS/AIR APPLICATION.
4.	1/2" NPS 40/80/180 (AS PER PROCESS REQUIREMENT) CARBON/ALLOY STEEL PIPE
5.	1/2" SW EQUAL TEE.
6.	1/2" NPS SW x 1/2" NPT (M) NIPPLE.
7.	1/2" NPT (F) CAP.
8.	1/2" PIPE x 1/2" PIPE UNION.
9.	5 VALVE MANIFOLD (FOR DETAIL REFER DRAWING NO.00000-999-POI-A-028.
10.	3/4" SCH 80 CARBON/ALLOY STEEL PIPE.
11.	3/4"/1/2" SW EQUAL TEE.
12.	3/4"x1/2" TUBE UNION.
13.	1/2" SCREWED GLOBE VALVE.
14.	1/2" NPT (M) PLUG.
15.	3/4" SW GATE VALVE.
16.	3/4" SW EQUAL CROSS.
17.	WAFFER ELEMENT FOR USE WITH 3"ANSI R.F. VALVE.
18.	3"BLIND 300lbs R.F. WELD NECK FLANGE DRILLED FOR 1" SCH. 40/80 PIPE
19.	3" BLIND FLANGE.
20.	1"NPS SCH. 40/80 (AS PER PROCESS REQUIREMENT) CS PIPE.
21.	1" SW EQUAL TEE.
22.	3/4" x 1/2"SW REDUCING INSERT.
23.	3/4" SW x 3/4" NPT (M) CS/AS NIPPLE
24.	3/4" NPT (F) CS/AS CAP.
25.	1/4" NPS ALLOY STEEL PIPE.
26.	1" x 3/4" SW REDUCING INSERT.
27.	3/4" SW x 1/2" PSW BRANCH TEE.
28.	3/4" PIPE UNION
29.	1/2" CLAMP UNION (THREADED) SUITABLE FOR FLEXIBLE CONNECTION CW NYLON REINFORCED PVC TUBE
30.	SS TUBE
31.	3/4" SW 4 WAY VALVE.
32.	QUICK DISCONNECT FITTINGS.
33.	1/4" SW ISOLATION VALVE 316SS
34.	1/2" x 1/2" SS PIPE UNION.

एन टी पी सी
NTPC

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT	TYPICAL THERMAL POWER PROJECT

TITLE	INSTRUMENT INSTALLATION DIAGRAM
DIFF. PRESS. MEASUREMENT (LIQUID, OIL, AIR/GAS SERVICE)	

A	FIRST ISSUE	~~REV. A~~					T.G.		21.08.12	DIFF. PRESS. MEASUREMENT (LIQUID, OIL, AIR GAS SERVICE)					
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD	DATE	SIZE A3	SCALE N.T.S.	DRG. NO. 0000-999-POI-A-030	REV. NO. A
					CLEARED BY										



**C&I SPECIFICATION FOR
COMPRESSED AIR SYSTEM**

SECTION: C
SUB SECTION: C&I


**CABLE INTERCONNECTION & TERMINATION
PHILOSOPHY**

CLAUSE NO.	TECHNICAL REQUIREMENTS				
5.00.00	INSTRUMENTATION CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY				
	The cable interconnection philosophy to be adopted shall be such that extensive grouping of signals by large scale use of field mounted Group Junction Boxes (JBs) at strategic locations (where large concentration of signals are available, e.g. valves limit & torque switches, switchgear) is done and consequently cable with higher number of pairs are extensively used. The details of termination to be followed are mentioned in the given Table A.				
	TABLE A: CABLE TERMINATION TO BE FOLLOWED				
	Application		Type Of Termination		Type Of Cable
	FROM (A)	TO (B)	END A	END B	
	Valves/dampers drives (Integral Junction box)	Marshalling / Marshalling – cum Termination Cubicle / local group JB	Plug in connector	Post mount cage clamp type.	G
	Transmitters, Process Actuated switches mounted in LIE/LIR	Integral Junction box of LIE/LIR	Plug in connector	Cage clamp (Rail mount) type.	F,G
	RTD heads	Local junction box	Plug in connector	Cage clamp (Rail mount) type.	F
	Thermocouple	Local junction box / CJC box (if applicable)	Plug in connector	Cage clamp (Rail mount) type.	A, B, C*
	Other Field mounted Instrument	Local JB / Group JB	Plug in connector	Cage clamp (Rail mount) type.	F,G
RTD	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	F	
Thermocouple	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	A, B, C*	
Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR	Group JB	Cage clamp (Rail mount) type.	Cage clamp (Rail mount) type.	F,G	

CLAUSE NO.	TECHNICAL REQUIREMENTS				
	Application		Type Of Termination		Type Of Cable
	FROM (A)	TO (B)	END A	END B	
	Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ Group JB / MCC/SWGR	Marshalling / Marshalling – cum Termination Cubicle	Cage clamp (Rail mount) type.	Cage clamp (Post mounted) type.	F,G
	Marshalling cubicle/ Termination Cabinet	Electronic system cabinet	Cage clamp (Post mounted) type.	Plug-in connector / other system as per Mfr.'s Standard	Internal wiring
	Marshalling/ Termination System Cabinets	UCD mounted equipments	Cage clamp (Post mounted) type.	Plug in connector / Cage clamp type (rail mounted).	F,G (with plug-in connect or at one end)
	DDCMIS/PLC cabinets	PC, Printers etc.	Plug in connector	Plug in connector	Mfr.'s Standard
Notes 1 Normally 10% spare cores shall be provided when the numbers of pairs of cables are more than four pairs, except for pre-fabricated cables which shall be as per manufacturer's standard. 2 For analog signals, individual pair shielding & overall shielding & for Binary signals, only overall shielding of instrumentation cables shall be provided. 3 * For high temperature applications only. 4 . For connection between field/JB and DDCMIS marshalling cabinet Minimum 4 pair instrumentation cable shall be used. 5 All the spare cores of instrumentation cable have to be terminated in Marshalling cabinets/ DCS panel end. 6 Not used.					
6.00.00	TERMINAL BLOCKS				
6.01.00	All terminal blocks shall be rail mounted/post mounted, cage clamp type with high quality non-flammable insulating material of melamine suitable for working temperature of 105 deg. C. The terminal blocks in field mounted junction boxes, temperature transmitters, instrument enclosures/racks, etc., shall be suitable for cage clamp connections. The terminal blocks in Control Equipment Room logic/termination/marshalling cubicles shall be suitable for post				

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	mounted cage clamp connection at the field input end. The exact type of terminal blocks to be provided by the Bidder and the technical details of the same including width etc. shall be subject to Employer's approval.	
6.02.00	All the terminal blocks shall be provided complete with all required accessories including assembly rail, locking pin and section, end brackets, partitions, small partitions, transparent covers, support brackets, distance sleeves, warning label, marking, etc.	
6.03.00	The marking on terminal strips shall correspond to the terminal numbering on wiring diagrams. At least 20% spare unused terminals shall be provided everywhere including local junction boxes, instrument racks/enclosures, termination/marshalling cabinets, etc. All terminal blocks shall be numbered for identification and grouped according to the function. Engraved labels shall be provided on the terminal blocks.	
6.04.00	For terminating each process actuated switches, drive actuators, control valves, Thermocouple, RTD, etc. in Local Junction Boxes, etc, refer Drg no. 0000-999-POI-A-065.	
6.05.00	The terminal blocks shall be arranged with at least 100 mm clearance between two sets of terminal blocks and between terminal blocks and junction box walls.	
7.00.00	INTERNAL PANELS/ SYSTEM CABINETS WIRING	
7.01.00	Internal panel/cabinet wiring shall be of multi-stranded copper conductor with FRLS PVC insulation without shield and outer sheath meeting the requirements of VDE 0815.	
7.02.00	All internal wires shall be provided with tag and identification nos. etched on tightly fitted ferrules at both ends. All wires directly connected to trip devices shall be distinguished by one additional red colour ferrule.	
7.03.00	All external connection shall be made with one wire per termination point. Wires shall not be tapped or spliced between terminal points.	
7.04.00	All floor slots of desk/panels/cabinets used for cable entrance shall be provided with removable gasketed gland plates and sealing material. Split type grommets shall be used for prefabricated cables.	
7.05.00	All the special tools as may be required for solder less connections shall be provided by Bidder.	
7.06.00	Wire sizes to be utilised for internal wiring. (i) Current (4-20 mA), low voltage signals (48V); Ammeter/Voltmeter circuit, control switches etc. for electrical system. (ii) Power supply and internal illumination.	0.5 Sq.mm. 2.5Sq.mm. minimum (shall be as per load requirement.)
8.00.00	INSTRUMENTATION CABLE INSTALLATION AND ROUTING	
8.01.00	All cables assigned to a particular duct/conduit shall be grouped and pulled in simultaneously using cable grips and suitable lubricants. Cables removed from one duct/conduit shall not be reused without approval of Employer.	

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
No part of this document will be reproduced by any means without the written

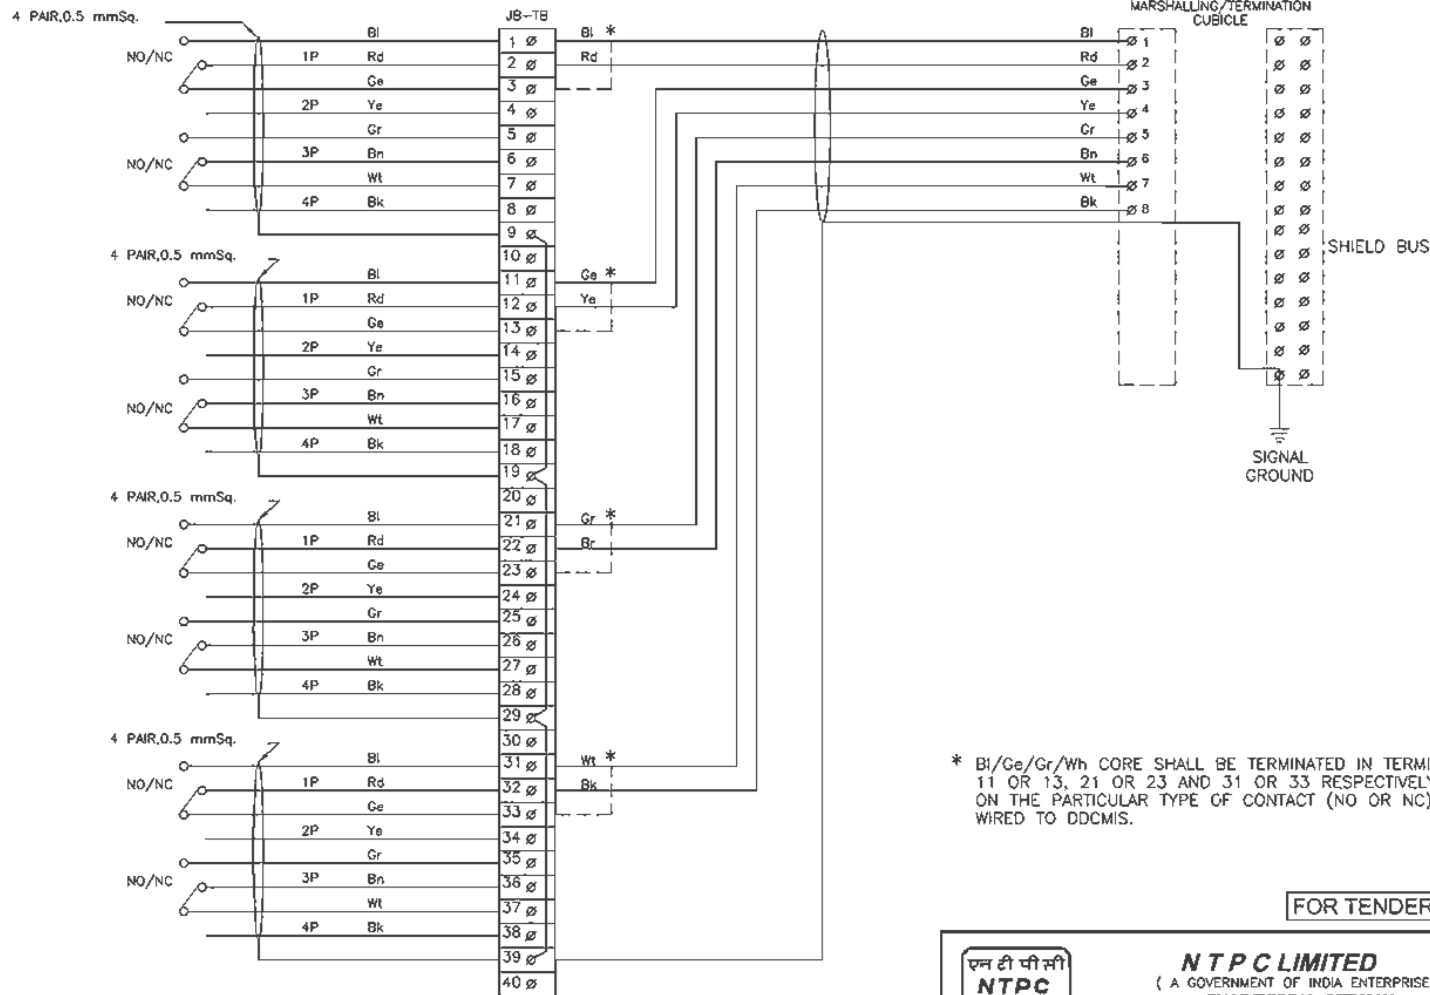

* Bi/Ge/Gr/Wh CORE SHALL BE TERMINATED IN TERMINAL 1 OR 3, 11 OR 13, 21 OR 23 AND 31 OR 33 RESPECTIVELY DEPENDING ON THE PARTICULAR TYPE OF CONTACT (NO OR NC) IS TO BE WIRED TO DDCMIS.

FOR TENDER PURPOSE ONLY





NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

												PROJECT TYPICAL THERMAL POWER PROJECT			
												TITLE INTERFACING OF FIELD INSTRUMENTS SWITCH TERMINATION DETAILS NO/NC			
A	FIRST ISSUE										21.08.12				
REV.NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&d	ARCH.	APPD	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
		Cleared By									A3	NTS	0000-999-POI-A-065	A	
SH 02 OF 15															



												PROJECT TYPICAL THERMAL POWER PROJECT			
B	INTERNAL WIRING FOR LIE/LIR MOUNTED SHOWN WIRING OF STAND ALONE TXTR SHOWN										21.08.12	TITLE INTERFACING OF FIELD INSTRUMENTS 4-20mA			
A	FIRST ISSUE										12.1.05				
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD	DATE	SIZE A3	SCALE NTS	DRG. NO. 0000-999-POI-A-065	REV. NO. B
					CLEARED BY										
															SH 04 OF 15


[illegible]

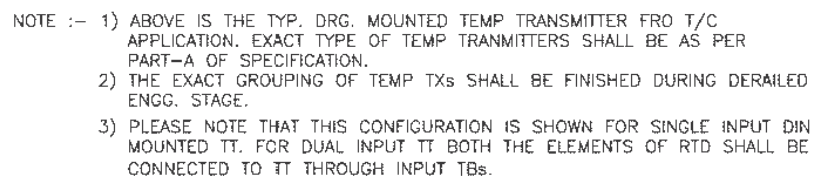

एन टी पी सी
NTPC

PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACING OF FIELD INSTRUMENTS TYPICAL RTD CONNECTION WITH TEMP TRANSMITTERS IN JBS	
SIZE	SCALE	DRG. NO.	REV. NO.
A3	NTS	0000-999-POI-A-065	A
		SH 06 OF 15	

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

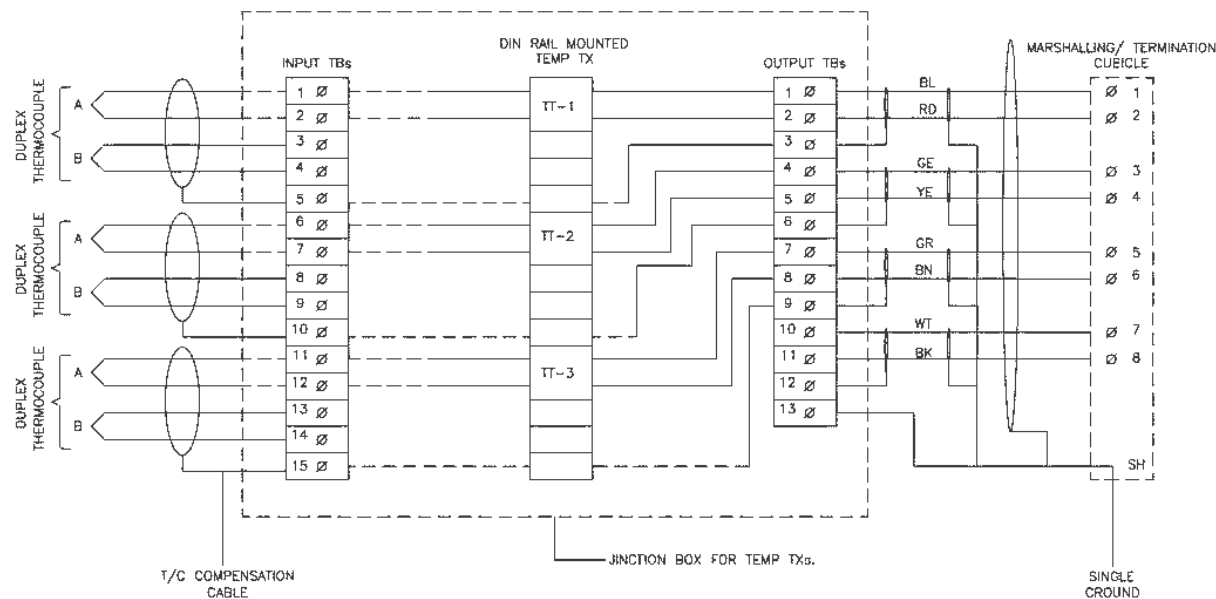

- NOTE :-
- 1) ABOVE IS THE TYP. DRG. MOUNTED TEMP TRANSMITTER FRO T/C APPLICATION. EXACT TYPE OF TEMP TRANSMITTERS SHALL BE AS PER PART-A OF SPECIFICATION.
 - 2) THE EXACT GROUPING OF TEMP TXs SHALL BE FINISHED DURING DERAILED ENGG. STAGE.
 - 3) AFTER GLADDING OF T/C CABLES ON JB. THE CABLE PAIR OF FIRST ELEMENT WILL BE DIRECTLY CONNECTED TO TT AND THE CABLE PAIR OF SECOND ELEMENT SHALL BE WIRED TO INPUT TBs FOR FUTURE USE.
 - 4) PLEASE NOTE THAT THIS CONFIGURATION IS SHOWN FOR SINGLE INPUT DIN RAIL MOUNTED TT. FOR DUAL INPUT TT BOTH THE ELEMENT OF T/C SHALL BE CONNECTED DIRECTLY TO TT WITHOUT INPUT TBs. HOWEVER 5 NOS OF INPUTS TBs ARE TO PROVIDED FOR EACH T/C FOR FUTURE USE.

FOR TENDER PURPOSE ONLY

एन टी पी सी
NTPC

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

											PROJECT TYPICAL THERMAL POWER PROJECT				
B	CABLING OF 2ND RTD CHANGED TO MATCH COLOR CODE									21.08.12	TITLE INTERFACING OF FIELD INSTRUMENTS TYPICAL T/C CONNECTION WITH TEMP TXs IN JB's				
A	FIRST ISSUE									29.04.06					
REV.NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD	DATE	SIZE	SCALE	DRG. NO.	REV NO
		CLEARED BY										A3	NTS	0000-999-POI-A-065	B
SH 15 OF 15															

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : II B

SECTION : E / ANNEXURE-I

REV 00

DATE: Nov. 20

SHEET: 1 OF 1


ANNEXURE-I

LIST OF MAKES OF SUB-VENDOR ITEMS

247927/2021/PS-PEM-MAX

CAS SUB-VENDOR LIST.xls

 SUB VENDOR LIST & INSPECTION CATEGORISATION (ANNEXURE- II) COMPRESSED AIR SYSTEM						
SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
1	AIR DRYING PLANT (HOC TYPE)	I	ACIL	BELGIUM	ROTARY DRUM	Testing at Atlas Copco Works Pune
			MELLCON	Delhi	Twin Tower type	
			DELAIR	Gurgaon	Twin Tower type	
			SUMMITS	Coimbatore	Twin Tower type	
			Shakot	Noida	Twin Tower type	
2	AIR DRYING PLANT (REFRIGERANT TYPE)	I	ACIL	BELGIUM		
			MELLCON	Delhi		
			DELAIR	Gurgaon		
			SUMMITS	Coimbatore		
			Shakot	Noida		
			Savroe	Germany		
			MTA	Italy		
			Dominic Hunter	U.K		
3	MS/GI Pipes –ERW IS 1239 / IS 3589	III	SAIL	Rourkela		1) Quantity < 200 meters Assorted sizes) 2) Material will be accepted on the basis of Main contractor COC supported by manufacturer TC as per relevant Code. In addition to above main contractor will certify availability of correlated identification marks on pipe wrt Manf TC and will also certify that pipes are free from rust
			Jindal	Ghaziabad/Hissar	upto 350NB	
			Surya Roshni	Bahadurgarh	upto 400 NB	
			Tata IS 1239 Pipes	Jamshedpur	upto 150NB	
			Maharashtra seamless IS 3589	Raigad	200 to 500 NB	
			PSL	Chennai/Vizag/Kutch/Daman	Spiral Weld SAW as per IS 3589	
			Lalit Profile	Thane	Spiral Weld SAW as per IS 3589	
			Samshi Pipes Industries	Vadodara	Spiral Weld SAW as per IS 3589	
			Mukut Pipes	Rajpura	Longitudinal SAW (Single side weld) as per IS 3589	
			Indus Tubes	G B Nagar	Upto 300 NB ERW Pipes as per IS 1239/3589	
			Mann Ind	Indore	Spiral Weld SAW as per IS 3589	
			Surendra Engg	Rajpura	Spiral Weld SAW as per IS 3589	


 07.07.15
 (Harish Kumar)

247927/2021/PS-PEM-MAX


CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			Pratibha Pipes & Structure Pvt Ltd	Thane	Spiral Weld SAW as per IS 3589	
			JCO Gas Pipe	Chindwara	Spiral Weld SAW as per IS 3589	
			Nukat Tanks and Vessels	Tarapur	Longitudinal SAW (Single side weld) as per IS 3589	
			DADU Pipes	Sikandrabad	Upto 300 NB ERW Pipes as per IS 1239/3589	
			Good Luck Tubes	Sikandrabad	Upto 300 NB	
			Advance Steel Tubes	Sahibabad	Upto 300 NB	
			APL APPOLO Tubes	Sikandrabad	Upto 300 NB	
			Hi Tech Pipes	Sikandrabad	Upto 300 NB	
			Ratnamani	Kutch/Ahmedabad/Chhatral	Upto 400 NB ERW Pipes as per IS 3589 and SAW as per IS 3589	
			Welspun	Anjar/Bharuch	Upto 400 NB ERW Pipes as per IS 1239/3589 and SAW as per IS 3589	
4	Forged/Formed fittings	III	EBY	Taloja		
			Siddarth & Gautam	Faridabad		
			Pipefit	Baroda		
			MS Fittings	Kolkata		
			Tube Products	Baroda		
			Bharat Forge	Pune		
			NL Hazra	Kolkata		
5	Ball Valve	I	Precision Engg	Nasik	upto 400NB 150 class	
			Microfinish Valves Ltd	Hubli		
			Weir BDK engg Industries	NEW DELHI		
			Flow chem. Industries	Ahemdabad	upto 50 NB 800 Class: 350NB 150 class	
			Audco	Chennai		
			Akay India	Hubli	upto 50NB 800 class	
			A V Valves	Agra		
			Asian Industrial valves & Instruments Ltd.	Chennai		
			ATAM Valves	Jalandhar	(1) BALL VALVES: FCS/FSS - 1/2" to 2" #800 & CCS/CSS - 2 1/2" to 4" # 150 (2) BALL VALVES: CUN METAL VALVES: SIZE 15 NB TO 80 NB - UPTO PN16.0	
			GM ENGINEERING	Rajkot		
			Hawa Valves (India) Pvt. Ltd.	Navi Mumbai	Size up to 2" & #800 with MOC as FCS & FSS and for size from 65 NB to 150 NB & #150 with MOC as CCS and CSS.	


 07.07.15
 (Harish Kumar)

CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			INTERVALVE (INDIA) LTD.	Pune	Steel ball Valves upto 50NB, #800 and 65NB to 150NB, #150	
			NILON VALVES PRIVATE LIMITED	Ahmedabad		
			LEADER VALVES LTD.	Jalandhar	CAST STEEL UPTO 200 MM, CLASS 150/300.	
			DEMBLA VALVES LTD.	Thane		
			SURYA VALVES AND INSTRUMENTS MFG CO.	Chennai	FOR CARBON STEEL/STAINLESS STEEL UPTO SIZE 200NB.	
			UNIFLOW	Chennai		
			VALTECH INDUSTRIES	Mumbai	FORGED CARBON & ALLOY STEEL BALL VALVES, SCREWED TYPE BALL VALVES RATING 800, SIZES UPTO 50 & CC& ALLOY STEEL BALL VALVES RATING 150, SIZES 65 TO 200 FLANGED TYPE.	
			VAAS AUTOMATION	NEW DELHI		
			Belgaum Aqua Valve	Belgaum		
6	CS/FS Gate/Globe/Check valves	III	Fouress	Mumbai/ Aurangabad		
			Weir BDK	NEW DELHI		
			L & T Valves	Coimbatore/ Kancheepuram		
			Leader	Jalandhar		
			KSB	Coimbatore		
			A V Valves	Agra		
			ATAM Valves	Jalandhar	(1) Carbon Steel Gate Valves & non return valves: 15 NB to 50 NB (#800) & 65 NB to 300 NB (#150) (2) Carbon Steel Globe Valves: 15 NB to 50 NB (#800) & 65 NB to 200 NB (#150)	
			Fluidline valves	Ghaziabad		
			GM ENGINEERING	Rajkot		
			INTERVALVE (INDIA) LTD.	Pune	a) Steel Gate Valves: upto 50NB, #800 and 65NB to 150NB, #150 b) Steel Globe Valves: upto 50NB, #800 and 65NB to 100NB, #150 c) Supplier not registered for NR Valves.	
			Nilon Valves	Mumbai		
			NSSL Ltd.	Nagpur		
			Steel Strong valves Ltd.	Navi Mumbai		


 07.07.15
 (Harish Kumar)

247927/2021/PS-PEM-MAX

CAS SUB-VENDOR LIST.xls


SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			VENUS PUMPS AND ENGG. WORKS	Kolkata	CC/CSS-GATE-BBT-UPTO600NB CL UPTO300,GATE-PSBT UPTO250NB CL 1500,GLV-BBT-UPTO300NB CL UPTO600,SCNRV-BBT-UPTO600NB CL UPTO150,SCNRV-BBT-UPTO300NB CL 300,SCNRV-PSBT-UPTO150NB CL UPTO900	
			VALTECH INDUSTRIES	Mumbai	CAST CARBON & ALLOY STEEL - VALVE/RATING/SIZE- GV/150/900,GV/300/400, GV/600/300, GV/GLV/NRV/900/250, GLV/300/300,GLV/150/350/ SCNRV/150/700, SCNRV/300/350, SCNRV/600/250.	
			V K Valves Ltd.	Jalandhar		
			KBL	Kondhapuri		
			KBL	Kondhapuri		
7	Butterfly Valve	II	Fouress	Bangalore		
			Audco	Chennai		
			Weir BDK	NEW DELHI		
			Tyco	Halol		
			Inter Valve	Pune		
			Advance Valves	Noida		
			Fluidline valves	Ghaziabad		
			Instrumentation Ltd.	Palakkad		
			R and D Multiples (Metal Cast) Pvt. Ltd.	Mumbai		
			SURYA VALVES AND INSTRUMENTS MFG CO.	Chennai	FOR CI, CCS & CSS UPTO SIZE 750 NB.	
			PENTAIR VALVES AND CONTROLS INDIA PRIVATE LIMITED	Navi Mumbai		
			UPADHAYA VALVES MANUFACTURERS PRIVATE LIMITED,	Kolkata	MOC-Cast Iron, size from 65 NB to 350 NB having rating of PN10 as per BS EN 593.	
			VENUS PUMPS AND ENGG. WORKS	Kolkata		

Handwritten signature
07-07-15
(Harish Kumar)

247927/2021/PS-PEM-MAX

CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
8	Air Receiver	I	Integrated Engineers	Mumbai		
			Diamond Fabricators	Pune		
			Parkaire	Delhi		
			Temasme Vesselex	Noida		
			United Engineering Works	Nasik		
9	Safety Relief Valve	III	LEADER	JALANDHAR		
			SPIRAX MARSHALL	PUNE		
			FISCHER SANMAR	CHENNAI		
10	Pr./Vacuum/Dp Gauges	III	Auxitrol	U.K		
			Switzer (for DP gauge)	Chennai		
			Budenburg	U.K		
			A.N.Instruments	Kolkata		
			Bells Control	Kolkata		
			Manometer India	Mumbai		
			H Guru Industries	Kolkata		
			Ashcroft India	Kalol		
			General Inst.	Mumbai/Goa		
			Gluck India	Mumbai		
			BOSE PANDA INSTRUMENTS PVT.LTD.	Kolkata		
			Forbs Marshall	Hyderabad		
			Gauge Bourdon	Mumbai		
			H Guru Instruments	Bangalore		
			Baumer Technologies	Mumbai		
11	Pr./Vacuum/DP.switch	III	Barton Inst.system	USA		* If the total Quantity is <= 10, then inspection category III. However, manufacturer TC to be submitted
			Indfoss	Ghaziabad		
			SOR	USA		
			Dressor	USA		
			Delta control	UK		
			Trafag	Ranipet		
			GiC(Gauges Bourdon)	Parvel		
			ASHCROFT INDIA PVT LTD.	USA/GERMANY		
			Switzer	Chennai		
12	Temperature Gauge	III	Budenburg	U.K		
			A.N.Instruments	Kolkata		
			Bells Control	Kolkata		
			H Guru Industries	Kolkata		
			General Inst.	Mumbai/Goa		
			H Guru Instruments	Bangalore		
			Forbs Marshall	Hyderabad		
			Goa Instruments	Goa		
			Goa Thermostatics Instruments Pvt. Ltd.	Goa		
			Gauge Bourdon	Mumbai		
			Baumer Technologies	Mumbai		


 07.07.21
 (Harish Kumar)

CAS SUB-VENDOR LIST.xls


SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			Ashcroft India	Kalol		
13	Transmitters (PT, TT, DPT, LT)	II	ABB	Fandabad	PRESSURE TRANSMITTER, DP TRANSMITTER and TEMP TRANSMITTER	* if the total Quantity is <= 10, then inspection category III. However, manufacturer TC to be submitted
			Yokogawa	Bangalore		
			Emerson	Mumbai		
			(ABB) -2600T series	Fandabad/Italy		
			Pune Techrol Pvt. Ltd.	Pune	Only for capacitance Type Level Transmitter	
			SIEMENS LIMITED	Mumbai		
			SMART INSTRUMENTS LTD, BRAZIL	Mumbai	LD-301 & T-301 TRANSMITTER FROM M/S SMART EQUIPMENTS BRAZIL.	
			SBEM PVT. LTD.	Pune	Only for capacitance Type Level Transmitter	
			TOSHNIWAL INDUSTRIES PVT. LTD.,	Ajmer		
			V. AUTOMAT & INSTRUMENTS (P) LTD.	NEW DELHI	a)DISPLACEMENT TYPE TRANSMITTERS. b)PRESSURE AND DP TRANSMITTERS	
			Honeywell Automation	NEW DELHI		
			Fuji	Japan		
			NIVO CONTROLS PVT. LTD.	Indore	For Capacitance type only	
			Moore Industries International Inc.	CALIFORNIA, USA	Indian Associate - Chemtrol	
			Endress + Hauser (India) Pvt. Ltd.,	NEW DELHI	TEMP TRANSMITTER ONLY	
14	HT Motor for Air compressor	I	CGL	Mandideep	Upto 1600 KW, 6.6 KV; Upto 1310 KW, 11 KV	
			Marathon Electric	Kolkata	Upto 6.6 KV, 750 KW	
			BHEL	Bhopal		
			SIEMENS	Germany		
			Hyosung	Korea		
			Hyundai	Korea		
15	Flow Switch	III	Switzer	Chennai		
			Levecon	Kolkata		
			DK Instruments	Kolkata		
			Delta	UK		
			ITT Barton	USA		
16	Temp Sensor	III	Pyro Electric	Mumbai		
			Detrv	Mumbai		
17	Flow Indicator	III	Sigma	Mumbai		
			Eureca	Pune		
18	Auto Drain Trap	III	Pennant	Pune		
			Forbes Marshall	Pune		
19	Dew point meter	III	GE Sensing	Ireland		

07.07.15
(Haish Kumar)

247927/2021/PS-PEM-MAX

CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			Michell Instruments	UK		
			XENTAUR	USA		
			Shaw	UK		
20	Flow Meter / Rota Meter	III	Trac	Hyderabad		
			Eureca	Pune	Rota Meter only	
			Flow Star Engg.	Faridabad	Rota Meter only	
			Flow Tech instruments	Vadodara	Rota Meter only	
			Instruments Engineers Pvt. Ltd.	Hyderabad	Rota Meter only	
			Scientific Devices (Bombay) Pvt. Ltd.	Mumbai	Rota Meter only	
			Emerson Process Management	singapore	Vortex Type	
			ABB Ltd.	India	Vortex Type	
			Krohne Marshall Pvt. Ltd.	India	Vortex Type	
			Endress + Hauser (I) Pvt. Ltd.	India	Vortex Type	
			Yokogawa Electric Corporation (other than high temp & h2 services)	japan	Vortex Type	
			Krohne Messtechnik GmbH & Co. Kg	Germany	Vortex Type	
21	Level Indicator/ Gauge	III	Flow Star	Faridabad		
			Scientific Devices	Mumbai		
			Gauges Bourden	Parvel		
			SBEM	Pune		
			Pune Techtrol	Pune		
			Levcon	Kolkata		
			Sigma	Mumbai		
			V-Automat	New Delhi		
			DK Instruments	Kolkata		
22	Solenoid Valve	III	HERION	GERMANY/ ITALY		
			ROTEX AUTOMATION LTD.	V V NAGAR/ BARODA		
			ASCO	CHENNAI		
			JEFFERSON	ARGENTINA		
			AVCON	MUMBAI		
23	Cable trays (max 300 meters)	III	INAR PROFILE	ANNAKAPALLI		
			ANAND UDYOG	THANE		
			MJ ENGG.	DELHI		
			INDIANA	MUMBAI		Galvanizing. At Karnataka
			TECHNO ENGG	CHANDIGARH		
			JAMUNA METAL	DELHI		


 7/7/15
 Harish Kumar

247927/2021/PS-PEM-MAX

CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
			INDUSTRIAL PERFORATION	KOLKATA		Galvanizing at Unistar
			VATCO	MUMBAI		Galvanizing At Sigma Mumbai
24	Cable Glands	III	SUNIL& COMPANY	KOLKATA		
			ARUP ENGG	KOLKATA		
			COMMET	MUMBAI		
			QUALITY PRECISION	KOLKATA		
25	Cable Lugs	III	DOWELLS	MUMBAI		
			CHETNA ENGG	NASIK		
			3D	VALSAD		
26	DC LEAD ACID/NI-CD BATTERY	III	AMCO SAFT INDIA LTD	BANGALORE	Ni-Cd batteries only	
			EXIDE INDUSTRIES LTD	NEW DELHI	Lead Acid batteries only.	
			HBL POWER SYSTEMS LTD	Hyderabad	Ni/Cd and TUBULAR TYPE for Lead acid	
			HOPPECKE BATTERIEN GMBH & CO.KG,	Germany		
27	DC Battery Charger (for PLC Panel)	III	AMARA RAJA POWER SYSTEMS LIMITED	Tirupati		
			CHHABI ELECTRICALS PVT.LTD.	Jalgaon		
			CHLORIDE POWER SYSTEMS & SOLUTIONS LIMITED	Kolkata		
			DUBAS ENGG PVT LTD	BANGALORE		
			HBL POWER SYSTEMS	Hyderabad		
			JEMA ENERGY	Spain	For Static SCR Type Full Wave fully Control type	
			MASS-TECH CONTROLS PVT.LTD.	Mumbai		
			STATCON POWER CONTROLS LTD	Noida		
28	INSTRUMENT FITTINGS	III	AURA INCORPORATED	NEW DELHI		
			Astec Valves & Fittings Pvt. Ltd.,	Mumbai		
			Arya Crafts & Engineering Pvt. Ltd.	Mumbai		
			Comfit & Valve Pvt. Ltd.	Nandasan-Gujarat		
			FLUIDFIT ENGINEERS PVT. LTD.	Mumbai		
			Fluid Controls Pvt. Ltd.	Mumbai		
			HP VALVES & FITTINGS INDIA PVT. LTD.	Chennai		
			PRECISION ENGINEERING INDUSTRIES	Mumbai		
			Panam Engineers,	Mumbai		
			Perfect Instrumentation Control (India) Pvt. Ltd.	Mumbai		
			VIKAS INDUSTRIAL PRODUCTS	Noida		
29	SS Pipes	III	REMI	Mumbai		
			Ratmani	Ahmedabad		
			Apex Tubes	Behror		
			Choksi	Ahmedabad		
30	UPS	III	HITACHI-HIREL	Gandhinagar		
			APC	Bangalore		
			Delta	Gurgaon		
			Emerson	Mumbai		
			DB Power	Pune		
			Aplab	Mumbai		

Handwritten signature
 21/7/15
 Harish Kumar

CAS SUB-VENDOR LIST.xls

SL No	Item	QP / Insp.Cat	Proposed Subvendor	Place of Manufacturer	Technical Limit	Remarks
31	OWS/PC	III	HP/Compaq /Dell/HCL/IBM/Lenovo			
32	Printer	III	HP/Cannon/Epson/Xerox/IBM /Lexmark			
33	PLC Based Panels	I	SIEMENS	Nasik		
			SCHNEIDER	Nasik		
			ROCKWELL	Sahibabad		
			GE Intelligent Platform	BANGALORE		
			Honeywell Automation India Limited ,	Pune		
			ABB	Bangalore		
34	Fibre Optic Cable	III	Birta Ericsson	Rewa		
			Finolex	Pune/Goa		
			Aksh Fibre	Bhiwadi		
35	Junction Box	III	AJMERA INDUSTRIAL &	Mumbai	For galvanised & FRP Junction	
			FLEXPRO ELECTRICALS	Navsan, Gujarat	Metal type Junction boxes only	
			K.S. INSTRUMENTS	Bangalore		
			SUCHITRA INDUSTRIES	Bangalore		
			Shrenik & Company,	Ahemdabad		
36	PAINTS	III	Asian Paints (I) Ltd.	Mumbai		
			Berger Paints India Ltd	Delhi		
			Goodlass Nerolac	Mumbai		
			Jenson & Nicholson (I) Ltd	Gurgaon		
			CDC carboline (I) Ltd.	Delhi		
			Shalimar Paints Ltd.	Gurgaon		
			Addison Paints Ltd	Chennai		
			Grand Polycoat	Mumbai		
			Bombay Paints	Mumbai		
			Jotun Paints	Pune		
			Hemple Paints	Singapore		

NOTES:

1) INSP CAT I : FOR THOSE ITEMS THE QUALITY PLANS ARE APPROVED BY CUSTOMER AND FINAL ACCEPTANCE WILL BE ON PHYSICAL INSPECTION WITNESS BY BHEL & CUSTOMER.

2) INSP CAT II : FOR THOSE ITEMS THE QUALITY PLANS ARE APPROVED BY CUSTOMER, HOWEVER NO PHYSICAL INSPECTION WILL BE DONE BY BHEL / CUSTOMER. THE FINAL ACCEPTANCE BY BHEL / CUSTOMER SHALL BE ON THE BASIS OF REVIEW OF DOCUMENTS AS PER QP.


3) INSP CAT III : FOR THOSE ITEMS FINAL ACCEPTANCE BY BHEL / CUSTOMER BASED ON BIDDER'S COC.

4) THE ABOVE SUB VENDOR LIST IS INDICATIVE ONLY AND IS SUBJECT TO APPROVAL/ACCEPTANCE BY CUSTOMER/BHEL. BIDDER TO PROPOSE HIS SUB VENDOR LIST WITH BACK UP DOCUMENTS (EXPERIENCE LIST, END USER CERTIFICATE AS APPLICABLE) WHICH WILL SUBJECT TO BHEL AND CUSTOMER APPROVAL DURING DETAILED ENGINEERING STAGE WITHOUT ANY TECHNICAL , COMMERCIAL AND DELIVERY IMPLICATION TO BHEL/CUSTOMER.

Handwritten signature
 7/7/15
 (Harish Kumar)

APPENDIX... P
PAGE... 9... OF... 26


SR NO	ITEM	QP /INS- PN CAT *	QP NO.	QP SUB- MISSION SCHEDU -LE	QP APPL SCHED ULE	PROPOSED SUB SUPPLIER	PLACE	SS APPL STATUS / CAT	SS DETAIL SUB- SCHED ULE	SC APPL SCHED ULE	REMARKS
13	SCREENED CABLES	1				DELTON	FARIDABA D	A			
		1				THERMO CABLES	HYDERABA D	A			
		1				CORDS	BHIWADI /KAHARANI	A			
		1				POLYCAB	DAMAN	A			
		1				INCAB	PUNE	A			
		1				ELKAY TELELINKS	FARIDABA D	A			
		1				KEI	BHIWADI	A			
		1				CMI	FARIDABA D	DR			
		1				RELIANCE ENGRS LTD	BANGALOR E	DR*			
14	AUXILIARY CONTROL PANEL					REFER SEPARATE LIST					
15	LT MOTORS (Refer Note 1)	1				KEC	BANGALOR E/HUBLI	A			(HUBLI UPTO 90 KW ,RQP)For Flame Proof also
		1				NGEF	HUBLI	A			UP TO 15 KW ONLY.
		1				CGL	AHMEDNA GAR	A			RQP,For Flame Proof also
		1				MARATHON ELEC. INDIA LTD	KOLKATA	A			RQP,For Flame Proof also
		1				JYOTI	VADODARA	A			
		1				BBL	MUMBAI	A			RQP,upto 160 KW only,For Flame Proof also
		1				LAXMI HYDRAULIC PVT. LTD	SHOLAPUR	A			upto 120 KW
		1				ABB	FARIDABA D/BANGAL ORE	A			RQP. Faridabad upto 55 KW Bangalore above 55



Signature

APPENDIX B
PAGE 06 OF 20

SR NO	ITEM	QP /INS- PN CAT	QP NO.	QP SUB- MISSION SCHEDU- LE	QP APPL SCHED ULE	PROPOSED SUB SUPPLIER	PLACE	SS APPL STATUS / CAT	SS DETAIL SUB- SCHED ULE	SC APPL SCHED ULE	REMARKS
15	LT MOTORS (Refer Note 1)	I				SIEMENS	MUMBAI	A			RQP
16	ELECTRICAL ACTUATOR(WITH GEAR BOX ALSO)	II	QVI-Q-078			HAROLD BECK	GERMANY	A			
		II				DREHMO	GERMANY	A			
		II				AUMA	GERMANY	A			
		II				ROTORK	CHENNAI/B ANGALORE	A			
		II				ROTORK	UK	A			
		II				NIPPON GEAR	JAPAN	A			
		II				LIMITORQUE	USA	A			
		II				LIMITORQUE	FARIDABA D	A			
		II				AUMA INDIA	BANGLORE	A			
17	CABLE TRAY & ACCESSORIES					REFER SEPARATE LIST					
18	FLEXIBLE CABLE TRAY SUPPORT					REFER SEPARATE LIST					
19	CABLE GLANDS					REFER SEPARATE LIST					
20	CABLE LUGS					REFER SEPARATE LIST					
21	GEARED MOTOR	III				KIRLOSKAR ELEC LTD	HUBLI/BAN GALORE	A			
		III				NEW ALLENBERRY WORKS	KOLKATTA	A			
		III				SHANTI GEARS LTD	COIMBATO RE	A			
		III				POWER BUILD	VV NAGAR	A			
		III				LAXMI HYDRAULIC PVT. LTD	SHOLAPUR	A			




SR NO	ITEM	QP /INS- -PN CAT *	QP NO.	QP SUB- MISSION SCHEDU -LE	QP APPL SCHED ULE	PROPOSED SUB SUPPLIER	PLACE	SS APPL STATUS / CAT	SS DETAIL SUB- SCHED ULE	SC APPL SCHED ULE	REMARKS

APPENDIX

PAGE 102 OF 96


.Note1 : a) Acceptance of Motor less than 30 KW is based on COC of the manufacturer and the contractor confirming as follows: It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp. voltage and frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud and gland plate and tested in accordance with approved drawing /data sheets b) 30 KW and above Acceptance of Motor rating between 30 KW 50 KW is based on NTPC review of Routine Test inspection report as per IS 325 witnessed by main contractor along with COC of the manufacturer and the contractor confirming as follows: It is hereby confirmed that the above mentioned motor /motors was/ were manufactured taking care of NTPC specific requirements regarding ambient temp., voltage and frequency variation, hot starts, pull out torque, starting KVA/KW, temp. rise, distance between centre of stud and gland plate, space heater and tested in accordance with approved drawing /data sheets. Above 50 KW up to 200 KW NTPC inspection as per approved QP Note 2: Misc Items like name plate, wire marker, clamps and pads for thermocouple adaptor, union, cross, socket and plug, pneumatic fittings tubes shall be as per BHEL system

124



ANNEXURE-I

NTPC	PROJECT: NORTH KARANPURA STPP (3X660 MW)	LIST OF ITEMS REQUIRING QUALITY PLAN AND SUB- SUPPLIER APPROVAL				NTPC DOC NO	
	PACKAGE: EPC PACKAGE					REV. NO.	0
	MAIN SUPPLIER: BHEL	SUB SYSTEM: CIVIL WORKS				DATE	16.12.2013
	CONTRACT NO.: CS-4410-001-2						
SR. NO.	ITEM	QAP / INSP. CAT	QAP NO.	PROPOSED SUB SUPPLIER	PLACE OF MANUFACTURING	APPROVAL STATUS / CATEGORY	REMARKS
	PREPAINTED COIL COATED STEEL SYSTEM			INTERARCH	NOIDA	N	
				LLOYD INSULATION	-	N	
				MG INDUSTRIES	FARIDABAD	N	
				ARM STRONG	NEW DELHI	N	
9.	PAINT AND PAINTING SYSTEM	III	-	BERGER	-	N	
				SHALIMAR PAINTS	-	N	
				JENSON AND NICHOLSON	-	N	
				KANSAI NEROLAC	-	N	
				AKZO NOBEL	-	N	
				ASIAN PAINTS	-	N	
10.	COLOUR COATED SHEET (FOR COIL)	I	-	UNION STEEL	KOREA	A	
				DONGBU STEEL	KOREA	A	
				BHUSHAN STEEL AND STRIPS LTD.	RAIGAD	A	
				ESSAR STEEL LTD	PUNE	A	
				NATIONAL STEEL AND AGRO	DHAR	A	
				JSW STEEL COATED PRODUCTS LTD	KAMLESHWAR	A	Formerly JSW ISPAT Steel Ltd
				BHUSHAN STEEL LTD.	SAHIBABAD	A	
				JSW LTD	THANE	A	
				TATA BLUESCOPE STEEL LTD	JAMSHEDPUR	A	*AL-ZN COIL FOR CLADDING
	PROFILERS FOR DECKING SHEETS	I		UNIMET PROFILES LIMITED	DHARUHERA	A	
				MULTICOLOUR STEEL INDIA LIMITED	GURGAON	A	
				ISOLLOYD	SOLAN	A	
				NATIONAL STEEL AND	DHAR	A	



247927/2021/PS-PEM-MAX

PACKAGE WISE REGISTERED SUPPLIER LIST (PERMANENT CATEGORY) AS ON 11/3/2020 2:11:20 PM

SI No	Package Name	Supplier Name	Supplier Communication Address
1	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Kaustubha Udyog,	S.No. 36/1/1, Sinhgad Road, Vadgaon Khurd, Near Lokmat Press, Pune, Phone- 020-24393577, Pincode : Email : pressure@vsnl.com,
2	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
3	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in
4	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	DRESSER INDUSTRIES INC.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 02764-233682 Pincode : 382729 Email : Nishit.patel@ashcroftindia.com
5	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdesh@sherman-india.com,
6	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com
7	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Barksdale GmbH, Germany	Michael Weileder Dorn Assenheimer, Strasse 27 Reichelsheim Phone- +91-9999107840 Pincode : D-61203 Email : msingh@barksdale.de
8	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS INDUSTRIES LIMITED	B-20-21, INDUSTRIAL AREA, MEERUT ROAD, GHAZIABAD Phone- 0120-2712016 Pincode : Email : mktg@indfos.com
9	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS (INDIA) LIMITED	MR.L.C.VENKATRANGAN/MR.B.KANNAN New No.17, II Floor, Adwave Towers, Dr.Sevalia Shivaji Salai, T.Nagar Chennai Phone- +91 44 24353407 Pincode : 600017 Email : delhi@indfos.com
10	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mkssrinivasan@forbesmarshall.com
11	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
12	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
13	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
14	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
15	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
16	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	BOSE PANDA INSTRUMENTS PVT.LTD.	Mr. Partha Bose 44, Saheed Hemanta Kumar Bose, Sarani, Kolkata Phone- +91 33 2548 7220 Pincode : 700074 Email : parthabosebpi@gmail.com; boscopanda@vsnl.net
17	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in

247927/2021/PS-PEM-MAX

18	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
19	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
20	TEMPERATURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
21	TEMPERATURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
22	TEMPERATURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
23	TEMPERATURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
24	TEMPERATURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
25	TEMPERATURE GAUGE	GOA THERMOSTATIC INSTRUMENTS PVT.LTD.	FLAT -B , GF, HILL CROWN APTS., COLLEGE ROAD, MAPUSA Phone- Pincode : 403525 Email : gtilworks@pyro-electric.in
26	TEMPERATURE GAUGE	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
27	TEMPERATURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in
28	TEMPERATURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com
29	FLOW ELEMENT	TM TECNOMATIC SPA	MR. ANTONIO NOVIELLO/Mrs. Enrica Bazzocc VIA DELLE INDUSTRIE, 36 CREMONA Phone- 39037221574 Pincode : 26100 Email : info@tmtecnomatic.com
30	FLOW ELEMENT	STAR-MECH CONTROLS (I) PVT.LTD.	SUSHILLOTAM, SUSHILLOTAM, 29/3A/3, SASANE NAGAR, HADAPSAR, PUNE Phone- 02026970450 Pincode : 411028 Email : marketing@starmech.net
31	FLOW ELEMENT	INSTRUMENTATION LTD.	KANJIKODE WEST, PALALKKAD, PALAKKAD Phone- 2566127-130,2567128 Pincode : 678623 Email : icvldil@gmail.com;fa2@ilpgt.com
32	FLOW ELEMENT	MICRO PRECISION PRODUCTS PVT. LTD.	Mr. Anil Bhati, H.B. No.-40, Revenue Estate, Village-Dudhola,Tehsil & Distt. Palwal FARIDABAD Phone- 9560742713;095607427 Pincode : 121002 Email : anil.bhati@wika.com
33	TEMP. ELEMENT	DETRIVE INSTRUMENTATION & ELECTRONICS LTD.	320, TV INDUSTIAL ESTATE, OFF.DR.A.BESANT ROAD, BEHIND GLAXO, WORLI, MUMBAI Phone- 24934125,24938403 Pincode : 400025 Email : trivtech@vsnl.com
34	TEMP. ELEMENT	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
35	TEMP. ELEMENT	Thermal Instrument India Pvt. Ltd.	Mr. Raghavendra M. Kulkarni 194/195, Gopi Tank Road Behind Citylight Cinema,Mahim Mumbai Phone- 09322664709 Pincode : 400016 Email : ramk@giconindia.com
36	TEMP. ELEMENT	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com

247927/2021/PS-PEM-MAX

37	TEMP. ELEMENT	PYRO ELECTRIC INSTRUMENTS GOA PVT.LTD.	M. D. BICHU/R. M. BICHU G.B, HILL CROWN APARTMENTS, COLLEGE ROAD, MAPUSA Phone- 9326114601 Pincode : 403507 Email : priyanka.marketing@pyro-electric.in
38	TEMP. ELEMENT	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
39	TEMP. ELEMENT	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
40	TEMP. ELEMENT	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
41	TEMP. ELEMENT	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
42	TEMP. ELEMENT	Tempsens Instrument (I) Pvt Ltd	MR. V.P.RATHI/MR. HEMANT RATHI B-188A ROAD NO.5 , M.I.A UDAIPUR Phone- 09352420069 Pincode : 313003 Email : info@tempsens.com
43	TRANSMITTERS	ABB INDIA LIMITED	MR. RAJIV GOVIL 14, MATHURA ROAD, FARIDABAD Phone- 09971085678 Pincode : 121003 Email : vipin.swami@in.abb.com
44	TRANSMITTERS	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
45	TRANSMITTERS	Pune Techtrol Pvt. Ltd.	N.P.Khata/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
46	TRANSMITTERS	YOKOGAWA INDIA LIMITED,	PLOT NO.96, ELECTRONICS CITY COMPLEX, HOSUR ROAD, BANGALORE, Phone- 080-41586000, Pincode : Email : uday.shankar@in.yokogawa.com,
47	TRANSMITTERS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com,
48	TRANSMITTERS	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
49	TRANSMITTERS	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in
50	TRANSMITTERS	Endress + Hauser (India) Pvt. Ltd.,	Mr. Prakash Vaghela 215-216, DLF Tower 'A', Jasola District Centre, New Delhi, Phone- 9717593001, Pincode : 110025, Email : prakash.vaghela@in.endress.com,
51	TRANSMITTERS	Moore Industries International Inc.	Leonard.W. Moore/ Matt Moren 16650 Schoenborn St. North Hills Phone- +1 818 830 5548 Pincode : 91343 Email : mmoren@miinet.com
52	TRANSMITTERS	NIVO CONTROLS PVT. LTD.	Mr. Praveen Toshniwal 104-115, Electronic Complex, Indore Phone- 0731-4081305 Pincode : 452010 Email : sales@nivocontrols.com
53	TRANSMITTERS	EMERSON PROCESS MANAGEMENT (INDIA) PVT.LTD.	Mr. Amit Paithankar/Vikram Raj Singh 206-210,BALARAMA BUILDING 2ND FLR. BANDRA EAST MUMBAI Phone- 9619121500 Pincode : 400051 Email : vikramraj.singh@emerson.com
54	TRANSMITTERS	SIEMENS LIMITED	Dr. Armin Bruck/Sandeep Mathur 130, Pandurang Budhkar Marg Worli Mumbai Phone- 0124 383 7377 Pincode : 400018 Email : ankit.varshney@siemens.com
55	TRANSMITTERS	SMART INSTRUMENTS LTD, BRAZIL	Agents: Digital Electronic Ltd. 74/11 'C' Cross Road MIDC Andheri (East) MUMBAI Phone- 28208477 Pincode : 400093 Email : corp@delbby.rpgms.ems.vsnl.net.in

247927/2021/PS-PEM-MAX

56	TRANSMITTERS	Honeywell Automation India Limited	Mr. Ritwaj Kulkarni 917, INTERNATIONAL TRADE TOWER, NEHRU PLACE, NEW DELHI Phone- 9890200584 Pincode : 110019 Email : rajesh.chaudhary@honeywell.com
57	TEMPERATURE SWITCH	DRESSER INDUSTRIES INC.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 02764-233682 Pincode : 382729 Email : Nishit.patel@ashcroftindia.com
58	TEMPERATURE SWITCH	TOSHNIWAL BROTHERS PVT.LTD.	WORKS:TOSHNIWAL IND.PVT.LTD, INDUSTRIAL ESTATE MAKHUPURA, AJMER Phone- 441171 Pincode : 305002 Email : toshniwalprocess@gmail.com
59	TEMPERATURE SWITCH	INDFOS (INDIA) LIMITED	MR.L.C.VENKATRANGAN/MR.B.KANNAN New No.17, II Floor, Adwave Towers, Dr.Sevalia Shivaji Salai, T.Nagar Chennai Phone- +91 44 24353407 Pincode : 600017 Email : delhi@indfos.com
60	TEMPERATURE SWITCH	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in
61	TEMPERATURE SWITCH	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com,
62	SIGHT FLOW INDICATORS	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
63	SIGHT FLOW INDICATORS	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com
64	SIGHT FLOW INDICATORS	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
65	SIGHT FLOW INDICATORS	B.K.EQUIPMENTS PVT.LTD.	T. BALAKRISHNAN/S.VENKATESH 217 , ARCOT ROAD PORUR , CHENNAI Phone- 9444057761 Pincode : 600116 Email : bkequip@gmail.com
66	SIGHT FLOW INDICATORS	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
67	SIGHT FLOW INDICATORS	INSTRUMENTATION ENGINEERS PVT LTD	SH.N.V.RAM GOPAL/MS. N.NIHARIKA PLOTS 1,2,3, PHASE-III, IDA, JEEDIMETLA HYDERABAD Phone- 9848407365 Pincode : 500055 Email : iedelhi@iefflowmeters.com
68	DIFFERENTIAL PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com,
69	ANUBAR (DELTA TUBE)	STAR-MECH CONTROLS (I) PVT.LTD.	SUSHILLOTAM, SUSHILLOTAM, 29/3A/3, SASANE NAGAR, HADAPSAR, PUNE Phone- 02026970450 Pincode : 411028 Email : marketing@starmech.net
70	ANUBAR (DELTA TUBE)	DYNAFLUID VALVES AND FLOW CONTROLS (P) LTD.	Mr. Yogish M. Kulkarni Plot # 23, Udyambag, Belgaum Phone- 0831-4210386 Pincode : 590008 Email : yogish@dyna-fluid.com
71	ANUBAR (DELTA TUBE)	MICRO PRECISION PRODUCTS PVT. LTD.	Mr. Anil Bhati, H.B. No.-40, Revenue Estate, Village- Dudhola, Tehsil & Distt. Palwal FARIDABAD Phone- 9560742713;095607427 Pincode : 121002 Email : anil.bhati@wika.com
72	ANUBAR (DELTA TUBE)	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in
73	ANUBAR (DELTA TUBE)	MINCO (INDIA) PRIVATE LIMITED	Mr. Rajeev Vasudeva, D/35, TIVIM INDUSTRIAL ESTATE, KARASWADA, MAPUSA, Goa, Phone- 9313637073 Pincode : 403526, Email : gicdelhi@general-gauges.com

247927/2021/PS-PEM-MAX

74	JUNCTION BOX	K.S.INSTRUMENTS PVT.LTD.	S Raghavan No. 72, 3rd Main, 1st Stage Industrial Suburb, Yeshwanthpur Bangalore Phone- 9880385770 Pincode : 560022 Email : sales1@ksinstruments.net
75	JUNCTION BOX	SUCHITRA INDUSTRIES	NO-2,OPP-27 AECS LAYOUT 2ND STG REJAMAHALVILAS EXTN 2ND STG BANGALORE Phone- Pincode : Email : suchitra.industriesblr@gmail.com
76	JUNCTION BOX	FLEXPRO ELECTRICALS PVT. LTD.	Mr. Dineshbhai Zaveri C-1/ 27&37, GIDC, Kabilpore, Navsari Phone- 02637-265140,265003 Pincode : 396424 Email : flexpro@flexproltd.com
77	JUNCTION BOX	Shrenik & Company,	Mr. Mitesh Shah/Mr. Pulin Shah 39 A/3 ,Panchratna Industrial Estate, Sarkhej-Bavla Road Ahmedabad Phone- 9825024921 Pincode : 382213 Email : sales@pustron.com, pulin@sumip.com
78	JUNCTION BOX	AJMERIA INDUSTRIAL & ENGINEERING WORKS	JIGNESH MAHENDRA AJMERIA DENA BANK BLDG.,SHREE NAGESH INDL. ESTATE,STATION ROAD, MUMBAI Phone- 022 67973578 Pincode : 400 088 Email : ajmera@ajmera.net, jmajmera@yahoo.com
79	Cold Junction Compensation Box (CJCB)	CREATIVE INSTRUMENTS & CONTROLS	NO-17/1 , 1ST FLOOR , 11TH CROSS 1ST K BLOCK , RAJAJINAGAR, BANGALORE-560010 Phone- Pincode : Email : crinstruments@gmail.com
80	INSTRUMENTS TUBE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
81	INSTRUMENTS TUBE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
82	INSTRUMENTS TUBE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
83	INSTRUMENTS TUBE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Mochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
84	ROTAMETER	INSTRUMENTATION ENGINEERS PVT LTD	SH.N.V.RAM GOPAL/MS. N.NIHARIKA PLOTS 1,2,3, PHASE-III, IDA, JEEDIMETLA HYDERABAD Phone- 9848407365 Pincode : 500055 Email : iedelhi@iefflowmeters.com
85	ROTAMETER	TANSA EQUIPMENTS PVT. LTD.	Mr. Vardhan Tamhankar, Unit No35/36/41,Om Anand Industrial Est. Mohanjee Sundarjee Road,Raghnath Nagar, Thane Phone- 022-25832323 Pincode : 400604 Email : tansaindia@gmail.com
86	ROTAMETER	EUREKA INDUSTRIAL EQUIPMENTS PVT.LTD.	Mr V. K. Pandit/Mr Ashish Shaha 17-20, Royal chambers, Paud Road Pune Phone- 9370469466 Pincode : 411038 Email : sales@eurekaflow.com
87	ROTAMETER	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
88	INSTRUMENTS PIPE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
89	INSTRUMENTS PIPE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
90	INSTRUMENTS PIPE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
91	INSTRUMENTS PIPE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Mochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
92	ULTRASONIC FLOW METERS	Electronet Equipments Pvt Ltd.	Mr. Rajendra Nagaonkar/MD, Plot No. 84, 85 & 86, Tiny Industrial Estate Kondhwa Budruk, Pune Phone- 9822015256 Pincode : 411048 Email : ho@eeplindia.com

247927/2021/PS-PEM-MAX

93	ULTRASONIC FLOW METERS	Adept Fluidyne Pvt. Ltd.	Vinayak Gadre Plot No 4,S.No.17/1-B Kothrud Industrial Estate Pune Phone- 020 25464551 Pincode : 411038 Email : info@adeptfluidyne.com
94	ULTRASONIC FLOW METERS	FLEXIM Flexible Industriemesstechnik GmbH	Boxberger Str., 4, Berlin Berlin Phone- 0049 30 93 66 76 60 Pincode : 12681 Email : info@flexim.de
95	ULTRASONIC FLOW METERS	Rockwin Flowmeter India Pvt. Ltd.	B-24, Site-IV, Sahibabad Industrial Area Ghaziabad, Phone- 9810129687 Pincode : 201010, Email : amiya@rockwin.com
96	ULTRASONIC FLOW METERS	FLASH FORGE PVT LTD	Mr. Gautam Makker, 503, 'A'-wing, Delphi, Orchard Avenue Road, Powai Mumbai Phone- 022-42784300 Pincode : 400076 Email : hemendrapatil@f-f.co.in
97	ULTRASONIC FLOW METERS	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
98	ULTRASONIC FLOW METERS	NIVUS GMBH	Mr. Marcus Fischer Im Taele 2, D - 75031 Eppingen Phone- 00491712233770 Pincode : Email : carolin.schuster@nivus.com
99	FLOW ELEMENT - ORIFICE	TANSA EQUIPMENTS PVT. LTD.	Mr. Vardhan Tamhankar, Unit No35/36/41,Om Anand Industrial Est. Mohanjee Sundarjee Road,Raghunath Nagar, Thane Phone- 022-25832323 Pincode : 400604 Email : tansaindia@gmail.com
100	FLOW ELEMENT - ORIFICE	MINCO (INDIA) PRIVATE LIMITED	Mr. Rajeev Vasudeva, D/35, TIVIM INDUSTRIAL ESTATE, KARASWADA, MAPUSA, Goa, Phone- 9313637073 Pincode : 403526, Email : gicdelhi@general-gauges.com
101	FLOW ELEMENT - ORIFICE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
102	FLOW ELEMENT - ORIFICE	Electronet Equipments Pvt Ltd.	Mr. Rajendra Nagaonkar/MD, Plot No. 84, 85 & 86, Tiny Industrial Estate Kondhwa Budruk, Pune Phone- 9822015256 Pincode : 411048 Email : ho@eeplindia.com
103	FLOW ELEMENT - ORIFICE	INSTRUMENTATION LTD.	KANJIKODE WEST, PALALKKAD, PALAKKAD Phone- 2566127-130,2567128 Pincode : 678623 Email : icvldil@gmail.com;fa2@ilpgt.com
104	FLOW ELEMENT - ORIFICE	MICRO PRECISION PRODUCTS PVT. LTD.	Mr. Anil Bhati, H.B. No.-40, Revenue Estate, Village-Dudhola,Tehsil & Distt. Palwal FARIDABAD Phone- 9560742713;095607427 Pincode : 121002 Email : anil.bhati@wika.com
105	FLOW ELEMENT - ORIFICE	MINCO (INDIA) FLOW ELEMENTS PVT. LTD.	Mr. Raghavendra M. Kulkarni D2-49/50, Tivim Industrial Estate, Karaswada Mapusa Phone- 0832-2257059 Pincode : 403526 Email : gicflowelement@giconindia.com
106	FLOW ELEMENT - ORIFICE	STAR-MECH CONTROLS (I) PVT.LTD.	SUSHILLOTAM, SUSHILLOTAM, 29/3A/3, SASANE NAGAR, HADAPSAR, PUNE Phone- 02026970450 Pincode : 411028 Email : marketing@starmech.net
107	FLOW ELEMENT - ORIFICE	CHEMTROLS INDUSTRIES PVT. LTD.	Mr. K. NANDAKUMAR AMAR HILL, SAKI VIHAR ROAD, POWAI, MUMBAI Phone- 022-67151261 Pincode : 400072 Email : manikandan@chemtrols.com
108	FLOW ELEMENT - ORIFICE	INSTRUMENTATION ENGINEERS PVT LTD	SH.N.V.RAM GOPAL/MS. N.NIHARIKA PLOTS 1,2,3, PHASE-III, IDA, JEEDIMETLA HYDERABAD Phone- 9848407365 Pincode : 500055 Email : iedelhi@ieflowmeters.com
109	FLOW ELEMENT - ORIFICE	DYNAFLUID VALVES AND FLOW CONTROLS (P) LTD.	Mr. Yogish M. Kulkarni Plot # 23, Udyambag, Belgaum Phone- 0831-4210386 Pincode : 590008 Email : yogish@dyna-fluid.com
110	FLOW ELEMENT - NOZZLE	MICRO PRECISION PRODUCTS PVT. LTD.	Mr. Anil Bhati, H.B. No.-40, Revenue Estate, Village-Dudhola,Tehsil & Distt. Palwal FARIDABAD Phone- 9560742713;095607427 Pincode : 121002 Email : anil.bhati@wika.com
111	FLOW ELEMENT - NOZZLE	MINCO (INDIA) FLOW ELEMENTS PVT. LTD.	Mr. Raghavendra M. Kulkarni D2-49/50, Tivim Industrial Estate, Karaswada Mapusa Phone- 0832-2257059 Pincode : 403526 Email : gicflowelement@giconindia.com

247927/2021/PS-PEM-MAX

112	FLOW ELEMENT - NOZZLE	STAR-MECH CONTROLS (I) PVT.LTD.	SUSHILLOTAM, SUSHILLOTAM, 29/3A/3, SASANE NAGAR, HADAPSAR, PUNE Phone- 02026970450 Pincode : 411028 Email : marketing@starmech.net
113	FLOW ELEMENT - NOZZLE	DYNAFLUID VALVES AND FLOW CONTROLS (P) LTD.	Mr. Yogish M. Kulkarni Plot # 23, Udyambag, Belgaum Phone- 0831-4210386 Pincode : 590008 Email : yogish@dyna-fluid.com
114	FLOW ELEMENT - NOZZLE	INSTRUMENTATION LTD.	KANJIKODE WEST, PALALKKAD, PALAKKAD Phone- 2566127-130,2567128 Pincode : 678623 Email : icvldil@gmail.com;fa2@ilpgt.com
115	FLOW ELEMENT - NOZZLE	MINCO (INDIA) PRIVATE LIMITED	Mr. Rajeev Vasudeva, D/35, TIVIM INDUSTRIAL ESTATE, KARASWADA, MAPUSA, Goa, Phone- 9313637073 Pincode : 403526, Email : gicdelhi@general-gauges.com
116	INSTRUMENT FITTINGS	HP VALVES & FITTINGS INDIA PVT. LTD.	S. Harichandran/P.S. Pandi B-11, Mugappair Industrial Estate, CHENNAI Phone- 044 26252537 Pincode : 600037 Email : sales@hpvalvesindia.com
117	INSTRUMENT FITTINGS	Perfect Instrumentation Control (India) Pvt. Ltd.	MD Hussain Shaikh/Shahanawaz Khan Gala No. 168, Loheki Chwal,216/ 218, Maulana Azad Rd. Nagpada Junction Mumbai Phone- 91-9324383121 Pincode : 400008 Email : shahanawaz.khan@perfectinstrumentation.com
118	INSTRUMENT FITTINGS	Arya Crafts & Engineering Pvt. Ltd.	Mr.Sanjay Brahman/Mr.Shyam Vazirani 102, Vora Industrial Estate No.4 Navghar, Vasai Road (E) Dist.Thane, Mumbai Phone- +91-250-2392246 Pincode : 401210 Email : arya@aryaengg.com
119	INSTRUMENT FITTINGS	FLUIDFIT ENGINEERS PVT. LTD.	Mr. Abbas Bhola Potia Building No. 2, Office No. 3,292, Bellasis Road,Mumbai Central (East) Mumbai Phone- 9920044113 Pincode : 400008 Email : ab@fluidfitengg.com
120	INSTRUMENT FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
121	INSTRUMENT FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Mochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400012 Email : sales@fluidcontrols.com
122	INSTRUMENT FITTINGS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com,
123	INSTRUMENT FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
124	INSTRUMENT FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
125	INSTRUMENT FITTINGS	Comfit & Valve Pvt. Ltd.	Mr. Jeetu Jain/Mr. Vinay Sosa Survey No. 23/1, Part 2, Ahmedabad-Mehsana Highway Laxmipura, Nandasan Phone- 02764-267036/37 Pincode : 382705 Email : marketing@com-fit.com
126	ELECTROMAGNETIC FLOW METER	Adept Fluidyne Pvt. Ltd.	Vinayak Gadre Plot No 4,S.No.17/1-B Kothrud Industrial Estate Pune Phone- 020 25464551 Pincode : 411038 Email : info@adeptfluidyne.com
127	ELECTROMAGNETIC FLOW METER	Electronet Equipments Pvt Ltd.	Mr. Rajendra Nagaonkar/MD, Plot No. 84, 85 & 86, Tiny Industrial Estate Kondhwa Budruk, Pune Phone- 9822015256 Pincode : 411048 Email : ho@eeplindia.com
128	ELECTROMAGNETIC FLOW METER	V.A Valves	Mr.Vishal Jain, Udyog Nagar, Gadaipur, Jalandhar Phone- 9872626376 Pincode : 144004 Email : support@fedrelflowmeters.com
129	ELECTROMAGNETIC FLOW METER	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
130	ELECTROMAGNETIC FLOW METER	NIVO CONTROLS PVT. LTD.	Mr. Praveen Toshniwal 104-115, Electronic Complex, Indore Phone- 0731-4081305 Pincode : 452010 Email : sales@nivocontrols.com



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : II B

SECTION : E / ANNEXURE-II

REV 00

DATE: Nov. 20

SHEET: 1 OF 1

ANNEXURE-II
PAINTING & COLOUR SCHEME

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	in case the system pressure does not drop and compressor continues to idle for more than a pre-set time.			
9.02.04	The control system shall provide warning to the operator that a hot-start condition exists for the motor driver and adequate cool-down period has not occurred after the motor was shut down.			
9.02.05	The alarms and shutdown scheme mentioned below are suggestive and shall be provided as per manufacturer's standard practice meeting the safe operational requirement of the equipment/system each compressor:-			
	(a)	"Air temperature high" at inlet to last stage	Alarm & trip	
	(b)	"Low lube oil pressure"	Alarm & trip	
	(c)	"High Lube oil supply temperature"	Alarm & trip	
	(d)	"High oil filter differential pressure"	Alarm	
	(e)	"Low lube oil level in lube oil sump"	Alarm	
	(f)	"High inlet air filter differential pressure"	Alarm & trip	
	(g)	"Low cooling water flow to air compressor"	Alarm	
9.03.00	Air Drying Plant			
9.03.01	Sequential operation of the adsorber towers & air compressors shall be controlled automatically with a provision for manual take over.			
9.03.02	Change over of tower from drying mode to regeneration mode shall happen automatically if the dew point is high at the outlet of ADP sensed by the dew point (using aluminium oxide probe) meter/sensor. Automatic operation during regeneration, starting and stopping of blowers, starting and stopping of heaters, etc shall be timer controlled. During the process, in case, operation is taken over manually from the panel through push button or selector switch, the sequential operation shall start with the manual initiation for each of the steps.			
9.02.03	The control system shall provide the (as minimum) alarms, "High Reactivation air temperature", "Low Reactivation air temperature", "Low cooling water flow", "Low air pressure at the outlet of ADP" and "High dew point at the outlet of ADP". Adequate number of temperature elements etc. shall be provided for measurement and monitoring of the same.			
9.02.04	For rotary drum type Air drying plant, control philosophy as per manufacture's standard and proven practice is also acceptable.			
10.00.00	PAINTING			
	All the equipments shall be protected against external corrosion by providing suitable painting.			
	The surface of SS, galvanized steel, Gun metal, Brass, Bronze and non-metallic components shall not be applied with any painting.			
	The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by brushing, shot blasting etc as per standard procedure.			
LOT-4 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.:CS-0011-109(4)-9	PART-B SUB-SECTION-I-M3 COMPRESSED AIR SYSTEM	PAGE 6 OF 6

247927/2021/PS-PEM-MAX

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM		SPECIFICATION NO. PE-TS-481-555-A001	
			VOLUME : II B	
			SECTION : E / ANNEXURE-III	
			REV 00	DATE: Nov. 20
			SHEET: 1 OF 1	

ANNEXURE-III

MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION

247927/2021/PS-PEM-MAX

MDL FOR CAS PACKAGE FOR KAHALGAON TPS – FGD

PROJECT	KAHALGAON TPS	PACKAGE-COMPRESSED AIR SYSTEM	NOA DATE		
"A" S NO	"B" VENDOR_DRG_NO.	"D" DRAWING TITLE	"E" PURPOSE	"G" NAME OF BOI	"H" SCHEDULED SUBMISSION (NO. OF WEEKS FROM LOA DATE/SCH PO DATE)(*)
1	PE-V0-481-555-A001	QUALITY PLAN OF AIR COMPRESSOR FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	2
2	PE-V0-481-555-A002	QUALITY PLAN OF AIR DRYING PLANT FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	2
3	PE-V0-481-555-A003	QUALITY PLAN OF AIR RECEIVER FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	3
4	PE-V0-481-555-A004	QUALITY PLAN OF MOTOR FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	3
5	PE-V0-481-555-A005	TDS OF AIR COMPRESSOR FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	2
6	PE-V0-481-555-A006	TDS OF AIR DRYING PLANT FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	2
7	PE-V0-481-555-A007	TDS & CHARACTERISTIC CURVES OF MOTOR FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	3
8	PE-V0-481-555-A008	TDS & GA OF VALVES FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	5
9	PE-V0-481-555-A010	TDS OF INSTRUMENTS FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	5
10	PE-V0-481-555-A011	GA DRAWING OF AIR COMPRESSOR FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	3
11	PE-V0-481-555-A012	GA DRAWING OF AIR DRYER FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	3
12	PE-V0-481-555-A013	GA DRAWING OF MOTOR FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	3
13	PE-V0-481-555-A014	GA DRAWING OF AIR RECEIVER FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	3
14	PE-V0-481-555-A015	COMPRESSOR HOUSE LAYOUT	A-CUST	CAS	4
15	PE-V0-481-555-A016	P & I DIAGRAM OF AIR COMPRESSOR FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	2
16	PE-V0-481-555-A017	P&I DIAGRAM OF AIR DRYER FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	2
17	PE-V0-481-555-A018	P&I DIAGRAM OF FGD COMPRESSED AIR SYSTEM WITHIN COMPRESSOR HOUSE	A-CUST	CAS	3
18	PE-V0-481-555-A019	OPERATION & CONTROL PHILOSOPHY OF FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	3
19	PE-V0-481-555-A020	ELECTRICAL & INTERNAL WIRING DIAGRAM FOR COMPRESSOR PANEL FOR FGD COMPRESSED AIR SYSTEM.	I-CUST	CAS	2
20	PE-V0-481-555-A021	ELECTRICAL FEEDER LIST FOR FGD COMPRESSED AIR SYSTEM	I-G-P	CAS	3
21	PE-V0-481-555-A022	CONTROL CABLE SCHEDULE FOR FGD COMPRESSED AIR SYSTEM	I-G-P	CAS	5
22	PE-V0-481-555-A023	PG TEST PROCEDURE FOR FGD COMPRESSED AIR SYSTEM	I-CUST	CAS	7
23	PE-V0-481-555-A024	O&M MANUAL-FGD COMP AIR SYSTEM	I-CUST	CAS	12
24	PE-V0-481-555-A029	SUB-VENDOR LIST WITH INSPECTION CATEGORISATION PLAN FOR FGD COMPRESSED AIR SYSTEM	A-CUST	CAS	1



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : II B

SECTION : E / ANNEXURE-IV

REV 00

DATE: Nov. 20

SHEET: 1 OF 1

ANNEXURE-IV
SITE STORAGE AND PRESERVATION

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 1 OF 33

PURPOSE

To implement uniform system of storage and preservation throughout NTPC projects in order to ensure that all equipment/ materials/ spares/ components received at site are stored and preserved in accordance with the relevant preservation requirements to minimize impairment to equipment/materials/spares and financial loss to company due to improper storage and preservation.

1.0 SCOPE

These guidelines cover the requirements of storage and preservation of all equipment/ materials/ spares/ components received at site for corporate awarded and site awarded Contracts/Purchase Orders during Project construction stage/O&M phase of NTPC Projects/Power stations.

2.0 DEFINITIONS

As per ISO 9001-2000 and Divisional Procedure (Doc. No. QS-01-QAI-Q-00 – Quality System (General).

3.0 REFERENCES

3.1 ISO 9001-2008- Clause No. 7.4

4.0 PROCESS

- 4.1 The responsibility for distribution of the applicable “Material Storage and Preservation Guideline” at site (to concerned departments) shall rest with the Head (FQA). Implementation of the same shall be the responsibility of concerned departments.
- 4.2 Where storage is the responsibility of contractor: The execution/Erection/Construction department shall ensure proper storage and preservation of equipment/materials/spares/components as per supplier’s instructions. In absence of any supplier’s instructions and not specifically tied up, these guidelines shall be followed. It should be ensured that contractor’s stores for the materials are located within the Project area.

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 2 OF 33

- 4.3 Where storage is the responsibility of NTPC: Material Management Department at site shall ensure proper storage and preservation of equipment/materials/spares/components as per supplier's instructions. In absence of any supplier's instructions these guidelines shall be followed.
For long term storage, provisions of OGN, No.: OGN/OPS/SYST/017 issued by Corporate OS shall also be applicable in the above cases.
- 4.4 FQA engineer shall Audit storage and preservation activities at site as per QS-01-FQA-P-09(both NTPC and Contractor's stores.)
- 4.5 Any system deficiencies noticed by the FQA Engineer during Audit shall be brought to the notice of the HEAD (FQA). Exceptions shall be put up to the HEAD of Project by HEAD (FQA). FQA may avail the services of CQA for preparation of Audit Check Lists.

5.0 ASSOCIATED DOCUMENT: Nil

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 3 OF 33

LEGEND

Type of Storage:

Type I	Open Yard: Open yard shall be levelled & raised platform (Wooden sleeper/Concrete/Brick paved) free from water logging/shrubs/vegetation etc., with a provision of feeder road along with access roads running all sides. Fire fighting arrangements shall be provided at strategic locations. While stacking provide space for inserting slings for easy handling without disturbing nearby components. The components shall be stored in such a way that the identification marks are visible. The number of components stacked one over the other shall be restricted, as given below: - Coils received in crates shall be stored independently. - Panels shall not be stacked more than five numbers. - Stacking of duct wall, plates etc, shall be restricted to seven numbers. - Stacking of columns shall be restricted to three numbers. - APH modules shall be stored independently.
Type II	Open Yard with Tarpaulin Cover/Canopy: In the open Yard, some of the critical components (such as components having machined parts/components susceptible of water ingress) which may be adversely affected due to direct contact of water are covered with Tarpaulin/polyethylene sheet/Canopy.
Type III	Semi closed Shed: Raised & paved (Concrete/Cemented) levelled platform with covered Shed (Pre-coated profile sheets/GI sheets may be used for roofing) clean & free from rain, acid, fumes and direct sunlight. Sides need not be closed. Item to be stored in packed condition as supplied by Manufacturer. Item should be properly identified, tagged, each package should be accessible through walkway for material handling equipment. Adequate fire fighting equipments shall be provided & shall be suitably located in such a way that during emergency situation they could be easily handled. Small components properly identified, tagged and stored over steel racks/shelf.
Type IV	Fully closed Shed: Raised & paved (Concrete/ Cemented) platform with all sides covered shed in dry, dust free & ventilated environment. Shed shall be free from insect, rodent and pest. Item should be stored in packed condition as supplied by Manufacturer. Item should be properly Identified, Tagged, Accessible for material handling equipment. Adequate fire fighting equipments shall be provided & shall be suitably located in such a way that during emergency situation they could be easily handled. Components shall be stacked properly taking into consideration of handling and preservation. Small components shall be stored on racks/shelf with the components identification Nos. Written on tags. In no case, components which do not have packing shall be placed directly on the floor. Adequate space shall be left between the stacking for easy handling during storage, preservation and issue of components.
Type V	Fully closed Shed with dry, clean and controlled atmosphere: Fully closed Shed with additional provision of false ceiling & the room shall be maintained with dry, clean & Temperature and Humidity controlled atmosphere suitable for storing components like process instruments/ fitting/electronic control panels/ C&I items etc. The instruments shall be properly identified, tagged and stored over steel racks/shelf, cupboards as appropriate. The original packing need not be disturbed unless otherwise warranted.

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 4 OF 33

Preservation Class:

A	Preservation of machined surface with Temporary Rust Preventive Fluid (TRPF)/primer/grease.
B	Preservation of machined surface with Temporary Rust Preventive Fluid (TRPF)/grease, covered with fire proof Tarpaulin.
C	Cleaning and applying De-oxy aluminate or primer on weld edges and Zinc chromate primer on all other surfaces.
D	Application of Rust Guard/ Multipurpose Grease for Bearings etc.
E	Preservation with Zinc Chrome Primer/ Red Oxide for un-machined surfaces & multipurpose grease for threaded portion, for all storage types.
F	Preservation of internal surface of Tubes using Silica Gel (SS items).
G	Preservation of Control Panels using Silica Gel.
H	Nitrogen/Oil filled Transformer Tanks.

General Notes-

- (1) If storage type and preservation class have not been mentioned for items/components, the same shall be done as per OEM guidelines/manual.
- (2) Before storing the equipment it should be checked for any damage to packing.
- (3) Handling of equipments should be done with utmost care without damaging package/equipments and only by authorised manpower & requisite tools tackles.
- (4) All equipment should be accommodated in the designated place of storage immediately after arrival at destination. This is very essential particularly during the rainy season.
- (5) The store houses and areas around them should have proper drainage facility for the sub-soil, surface and rain water. The water should not be allowed to stand or get accumulated in these areas, especially where the material has been stored.
- (6) Level should be maintained for all the packages and equipment and should be uniformly supported to avoid distortion. The long packages should be supported at intermediate places also, so as to avoid sagging during storage.
- (7) Store houses should preferably be equipped with proper lifting devices to ensure normal handling of equipment.
- (8) Small and medium size parts can be kept on shelves with proper identification tags.
- (9) For heavier components under Type 'III', the roof/walls may be constructed/fabricated after placement of the component on cemented/pucca hard floor

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 5 OF 33

GENERAL GUIDELINES FOR STORAGE AND PRESERVATION

System /Package	Description of the Item/Components	Type of Storage	Preservation Class	Checks	Periodicity of checking	Remarks
Boiler & Aux. (Pressure parts)	Drum with Internal	I	E	Damage, Painting, end cap,	6 months	
	‘U’ Rod	II	A&E	Damage, painting, preservation of thread	do	
	Drum Internals (if sent loose)	IV	E	Damage, preservation	do	
	Water wall Headers & Links	I	C, E	Damage, painting, protective coating to threads, End cap	do	
	Water wall panels	I	C, E, F	do	do	
	Down comer pipes	I	C, E	do	do	
	Riser tubes	I	C, E	do	do	
	Hanger tubes	I	C, E	do	do	
	Arch tubes	I	C, E	do	do	
	Transition tubes	I	C, E	do	do	
	Furnace insert tubes	I	C, E	do	do	
	Water wall and down comer suspension	I	A, E	do	do	
	Transition tubes & Furnace insert tubes	I	C, E, F	Damage, End cap, painting	do	
	Constant Load Hanger & Variable Load Hanger	III	A, E	Protective coating to threads	do	Protection of threads portion to be ensured
	Seismic guide	IV	E	Damage, painting	do	
	Pressure parts seals, hand hold plate and seal weld removal tool	IV	A, E	Damage, painting, protective coating	do	
	Welding consumable	IV	-	Damage to packing, dryness room	do	Refer weld consumable storage work instruction QS-01-CQA-W-19
	Buck stays & Furnace bottom supports	I	E	Damage & painting	do	
	Fasteners & other small components	IV	A	Damage & protective coating	do	
	Seal boxes	I	E	Damage, painting,	do	
	Instrument tapings	IV	E	do	do	
	Super heater Headers	I	E, F	Damage, painting, End caps	do	
	Super heater coils, SH screen tubes and panels	I	C, E, F	do	do	
	Connecting tubes, terminal tubes, steam cooled spacer tubes and hanger tubes.	I	C, E, F	do	do	
	Supports, Roof casing & pressure parts attachment, Baffles	I	E	Damage, painting & protection for threads	do	
	Vibration snubber and mechanical spacer	IV	E	Mechanical damage	do	
	Economiser coil/ headers/ Hanger tube	I	C, E, F	Damage, painting, End caps	do	
	Economiser links and feed pipes	I	E, F	do	do	

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 6 OF 33

Boiler & Aux. (Soot blowing System)	Long retractable soot blower	II	B, E	Damage, painting preservative & end cap	6 months	
	Wall/ Rotary blowers	IV	A, E	do	do	
	Temperature probe	IV	B, E	do	do	
	Soot Blowing System Piping	I	C, E, F	do	do	
	Blower for seal oil	IV	E	do	do	
	HP/LP Bypass System	IV	A	Damage, Preservative	do	
	Boiler integral piping & fittings	I	E	Damage, painting & End cap	do	
	Instruments	IV	A	Damage	do	
	Valves, water level gauges, Sample cooler	IV	A	Damage, preservative & End cap	do	
Boiler & Aux. (Fixing Components, Lining & Insulation)	Doors	III	A, E	Damage & painting	do	
	Fixing components for boiler lining & insulation	IV	A	do	do	
	Skin casing	I	A	do	do	
	Fixing components for insulation (Boiler area)	I	E	do	do	
	Lining & insulation	IV	—	Damage to packing	do	
	Refractory material	IV	—	do	do	
	Pourable insulation	IV	—	do	do	
	Fire clay	IV	—	do	do	
	Binding mortar	IV	—	do	do	
Boiler & Aux. (structure including Bunker building, TPs etc)	Mineral wool	II	-	do	do	
	Boiler casing	I	E	Damage Painting	do	
	Foundation materials, column, Base plates	I	E	Protective coating for thread, damage painting, cement wash	do	
	Ceiling girders	I	A, E	Damage, painting & perseveration	do	
	Welded /rolled beams	I	E	do	do	
	Plates/ Gusset plates	I	A, E	do	do	Preservative for drilled holes only
	Fasteners and Foundation bolts, HSFG Bolts & Girder Pin connection	IV	A	Damage & preservative	do	
	Floor component: Beams, channels, angles & bracings	I	E	Damage & painting	do	
	Floor / Inter connecting walkway components: Post , hangers, Stairs, ladders, floor grills, hand rails	I	E	do	do	
Boiler & Aux. (Fuel Oil System)	External structure: Column, beams, channels , angles, plates, Floor grills, Stairs and ladders, Posts and hand rails.	I	E	do	do	
	Oil Burners, Eddy plate, Ignitor scanner, Head assembly, HEA Ignitor.	IV	A	Damage & preservative	do	
	Pipes & tubes: Fittings, Sleeves, Flanges/ Support	IV	A, C	do	do	

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 7 OF 33

Boiler & Aux. (Fuel Oil System)	Tees/ Elbows	IV	A, C, E	Damage & painting	6 months	
	LFO Pumping units, Heating units	IV	A,E	do	do	
	Ignitor Air System: Ducts, Ignitor Air fan with drive unit, Butterfly valves, Auto dampers	IV	A	Damage	do	
	Ignitor Air System: Gaskets	IV	—	Damage	do	
	Scanner Air System: Scanner air fan with drive unit, Fasteners, HSFG Bolts, Foundation bolts, & Girder Pin connections	IV	A	Damage & Preservative	do	
Boiler & Aux. (Coal Burner & P.F. Piping)	Wind Box	II	E,A	Damage & painting	do	
	Pulverised Fuel piping: Pipes	I	E	Damage, painting & end cap	do	
	Pulverised Fuel piping: Flanges, Couplings with bolt & Supports Tie rods	IV	A,E	Damage, painting/ preservative & end cap	do	
	Constant Load Hangers	III	A,E	do	do	
	Isolating gate	III	B & E	do	do	
Boiler & Aux. (Ducts, Dampers & Expansion pieces)	Fabricated ducts	I	E	damage painting	do	
	Elbow, walls, plates	I	E	do	do	
	Expansion Pieces	I	E	do	do	
	Gates	II	A & E	do	do	
	Suspensions, Fasteners	IV	A & E	Damage to thread, protective coating	do	
Boiler & Aux. (SCAPH & APH)	Actuators	IV	A	Damage & oil leak	do	
	SCAPH	III	A & E	Damage, End caps	do	
	Expansion arrangement	IV	E	Damage to carbon ring	do	
	Main pedestal, side pedestal	I	E	Damage	do	
	Drive panels & other panels	IV	E	Damage painting	do	
	Centre section	II	B	Damage, painting	do	
	Jack actuator assembly, Seals, Pin rack segment, Rotor drive unit	III	A	Damage, painting, Rust preventive coating on the machined area	do	Oil level in the gear box
	Support & Guide Bearing	IV	D	Oil level, check for any water collection	do	
	T-Bar, Water washing system	I	E	Damage, painting, End caps	do	
	Rotor post	II	A & E	Rust preventive coating	do	
	Oil circulating unit	II	A	Damage, End caps	do	
	Cleaning device	IV	A	Damage, painting, Rust preventive coating	do	
	Module assembly (with heating elements)	IV	B & E	do	do	
	Thermo states, thermocouples	IV	----	Damage	do	

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 8 OF 33

Boiler & Aux. (Fans)	Foundation Bolts and nuts, Coupling & its Bolts	IV	A	Protection to threaded portion	6 months	
	Base plates, sole plates	III	E	Damage, painting & Preservation	do	
	Machined packers and Shims	IV	A	do	do	
	Suction chamber assy.	I	E	do	do	
	Impeller housing	I	B & E	do	do	
	Diffuser/Damper assly.	I	E	do	do	
	Rigiflex shaft coupling	IV	A	do	do	
	Coupling (Flexible)	IV	A	do	do	
	Inlet wane control	II	A	do	do	
	Blades	IV	----	do	do	
	Outlet guide assembly	I	E	do	do	
	Shaft with Brg. Assly, & Rotor assembly	IV	A & E	do	do	
	Impeller with servo motor assembly.	IV	A & E	do	do	
	Bearing & Bearing Housing	IV	B,D & E	do	do	
	Bearing Pedestal	I	B & E	Damage painting	do	
	Lube oil system/Console	II	E	do	do	
	Silencer	II	E	do	do	
	Expansion piece (rubber)	IV	----	Damage	do	
	Pipes and Fittings	III	B	Damage paintings	do	
	Fan drive (HT motors)	II	B & E	do	do	
	Base /Wear/sole plates	I	B & E	do	do	
	Machined packers and shims	IV	A	do	do	
	Spiral casing parts	I	E	do	do	
	Diffuser cone	II	E	do	do	
	Hydraulic Couplings	IV	-	Damage, preservation, Oil leak	do	
	Labyrinth seal assy.	IV	E	Damage	do	
Boiler & Aux. (Mills)	Foundation fasteners	IV	A	Damage , painting / preservation	do	
	Studs, nuts & washers	IV	A	do	do	
	Mounting plates	IV	A	do	do	
	Mill base assembly	II	B & E	do	do	
	Bowl assembly	II	B & E	do	do	
	Mill side liner assembly	II	B & E	do	do	
	Separator body and classifiers assembly	II	B & E	do	do	
	Journal assembly	IV	A	do	do	
	Spring assembly	III	B & E	do	do	
	Coupling and oil seals	IV	A	do	do	
	Electric motors	III	B	Damage ,Rotation	Three months	
	Instruments	IV	A	Damage to packing	do	
	Tools and special accessories	IV	A	Damage , painting / preservation	do	
	Mill outlet port	III	B,E	do	6 months	
	Mill discharge valve	III	A	do	do	
	Converter Head (suction)	III	A	do	do	
	Exhauster discharge valve(suction)	III	B	do	do	
	Exhaust Brg-Housing (Suction)	III	B	do	do	

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 9 OF 33

Boiler & Aux. (Mills)	Multiport outlet assembly (pressurised)	III	B	Damage, condition of preservative/ painting	6 months	
	Lube oil unit	III	B & E	do	do	
	Mill body	II	E,A	do	do	
	Beater wheel & Girth gear	II	B	do	do	
	Main bearing assembly	III	D	do	do	
	Counter shaft bearing assembly	III	A	do	do	
	Separator	II	B & E	do	do	
	Screw conveyor	II	A & E	do	do	
	Trunion tubes	II	B	do	do	
	Conveyor body with sealing air box	II	B	do	do	
	Hot air box	II	E	do	do	
	Classifier body (upper)	II	E	do	do	
	Top cover	I	E	do	do	
	PF outlet	I	B & E	do	do	
	Loose Items: Liners	III	B	do	do	
	Grinding steel bar	II	E	do	do	
	Slide plates	IV	A	do	do	
	Beater wheel fixing/ Pointer device	III	A	do	do	
	Adjustable packing ring	III	A	do	do	
	Hydraulic ring	III	B	do	do	
	Double bearing	IV	D	do	do	
	Drive with coupling	III	B & E	do	do	
	Mill door transport trolley motor	III	A	do	do	
	Gas re-circulation duct with gate valve	II	B & E	do	do	
	Reduction duct tensioning device	II	A & E	do	do	
	Connection of flue gas duct	I	E	do	do	
	Beater wheel	II	B	do	do	
	Intermediate piece	I	E	do	do	
	Mill housing	I	E	do	do	
	Foundation frame	I	B & E	do	do	
	Sealing Air System classifier	III	B	do	do	
	Gravimetric feeder	III	B	do	do	
	Mill plant Auxiliaries	III	B & E	do	do	
Boiler & Aux. (ESP)	Supporting structure: Pipes Floor grills, Stairways	I	E	Damage & painting	do	
	Hopper & Funnel walls, ridges, Roof beams, Walls & roof panels	I	E	do	do	Not more than 5 Nos. shall be stacked
	Slide Support Bearings	IV	D	Damage , painting / preservation	Three months	
	Insulator Housing	I	E	do	6 months	
	Collective and Emitting Suspension frame	I	E	do	do	
	Shock bars, shock beams	I	E	do	do	
	Vertical Beams/Stays	I	E	do	do	
	Suspension Rods	IV	----	do	do	

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 10 OF 33

Boiler & Aux. (ESP)	Deflection Plates	II	E	Damage, painting	6 months	
	Ridge covers	I	E	do	do	
	Distribution Baffles	II	E	do	do	
	Screen sheets	II	E	do	do	
	Insulators	IV	----	Damage	do	
	Rapping shafts	III	B	Damage, preservative	do	
	Rapping motors	IV	B & E	Damage, Rotation	3 months	
	Couplings	IV	B	Damage	6 months	
	Emitting electrodes	IV	B	Damage & rusting	do	
	Collecting Electrodes	II	E	do	do	Max.3 Nos. stacking
	Rectifier Transformer	II	----	Damage , condition of silica gel, painting	do	
	Control panel, Interlocks, Thermostats, connecting switches, Heater element, Ash level Indicators	IV	G	Damage to packing	do	If packet is damage shall be kept in type-V
	Hangers: Variable Load hangers, Constant Load hangers, Tie rods	III	A & E	Damage, protective coating to threaded portions	do	
	Valves	IV	A & E	Damage , painting / preservation	do	
Boiler & Aux. (Fuel Firing Control)	Flame scanner head	V	A & E	Damage to packing	do	
	FSS, LGM Switch box	IV	G	do	do	
	FSSS cabinet Console cabinet	IV	G	do	do	
	SADC field instruments	V	G	do	do	
	SADC console	IV	G	do	do	
	Mill control cabinet	IV	G	do	do	
	Pulveriser Lube Oil panel	IV	G	do	do	
	UCB, Instruments Calibration kit	IV	G	do	do	If packet is damage shall be kept in type-V
	FSS panel	IV	G	do	do	
	SADC panel	IV	G	do	do	
	FLOS Erection materials	IV	A	do	do	
	Control cabinet	IV	G	do	do	
	AC distribution cabinet	IV	G	do	do	
	Electrical actuators in A & FG system	IV	A	do	do	
	Auxiliary control commissioning spares	IV	A	do	do	
	SB control panels	V	G	do	do	
	Temperature pad clamp J/C Junction Box	IV	A	do	do	
Boiler & Aux. (Misc).	Various lifting Tools & Tackles(Fan/Mill/ASH Handling DSL/Crane /FWH/Beams etc)	II	B	Damage, painting & protective coating to threads	do	
	Furnace maintenance platform	I	E	Damage, painting	do	
	Pressure Vessels, Storage Tanks, Fabricated Structural Items, Air Dryers, Gratings, Agitators, Dampers (Fire/ Volume control), Pan Humidifiers,	I	E	do	do	

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 11 OF 33

	Condensing Units, Cable Trays, Earthing Flats					
Turbine & Aux. Including Station Piping	Valves all type, TG area except Butterfly valve	IV	B	Damage, painting	3 Months	
	CI/SS Butterfly Valve	III	B	do	do	
	CRH, Deareator, Hotwell	III	B	do	do	
	Plate heat exchanger	III	B	do	do	
	Condensing pots	III	B	do	do	
	BFP-pump casing (outer)	III	B	do	do	
	BFP disch. cover/inner					
	BFP shaft, BFP balance drum spring disc	IV	E	Damage, Rotation/Preservation	do	Thread portion to be covered, preserved as per OEM guideline
	BFP impellers/diffusers	III	A	do	do	
	BFP suction branch/ring section	III	B	do	do	
	Pumps : BFP, Booster pump, Seal Oil Pump, Primary water pump, Vacuum pump, MOP & JOP & Hydraulic oil pump, Drip pump), CEP, CCW pumps, Vert/hor./ Submersible pumps & Sump/screw pumps	III	B	do	do	Preservative compound to be applied as per OEM guideline
	CEP impeller, CEP water rings	IV	A	do	do	do
	BP pump casing/impeller	III	A	do	do	
	BP wear rings (spun pipes)	IV	A	do	do	
	Bell mouth (suction bell)	II	A	Damage	do	
	Stage (delivery) bowl	II	A	do	do	
	Journal bearing (BFP & BP)	IV	D	Packing & greasing	do	Preservation as per OEM guideline
	Journal bearing cum thrust bearing for CEP	IV	D	do	do	do
	Hydraulic coupling/ connecting coupling between motor and HC BFP&BP & CEP	IV	A	Damage, Rotation	do	do
	Strainers, Filters, Pr. Damping devices, Orifice	IV	B	Damage	do	
	LPT inner/outer casing & stop valve body casing	IV	B	do	do	
	Intermediate piece valve cover & chamber	II	B	do	do	
	Guide blade carrier	II	B	do	do	
	Steam chamber	II	B	do	do	
	Gear box, Drive turbine, Disconnecting couplings, Centrifuge	III	B	Damage, Rotation	do	Preservation as per OEM guideline
	HP/IP turbine assembly, LP/IP rotor assembly	IV	A	do	do	do
	Vapour exhaustor	III	A	do	do	do
	Turning gear	IV	A	do	do	do
	Foundation frame for BFP, BP, drive turbine, Suspension & Motor	III	B	Damage	do	

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 12 OF 33

Turbine & Aux. Including Station Piping	LP/HP heaters	II	B	Damage	3 Months	
	Drain cooler/GSC	III	B	do	do	
	Dearator spary valves/ Dearator tray assembly	IV	B	do	do	
	Safety relief valve	IV	B	do	do	
	HP inner casing Casting & M/C LP stationary casings only	II	B	do	do	
	HP joint bolt & turbine assely & U seal	III	A	do	do	Thread portion to be protected
	Breach Nut	III	E	do	do	do
	HP support & thrust ring	III	C	do	do	
	HP inlet insert casting HP exhaust flange	III	B	do	do	
	Sealing rings all type	IV	A	Damage	do	
	IP inlet connections, IP inlet insert	III	A	do	do	
	LPT compensators	III	B	do	do	
	LP cross over pipe	II	B	do	do	
	Coupling bolts & Nuts(HP/IP/LP)	IV	E	do	do	Thread portion to be protected
	HP joint bolt	III	A	do	do	do
	BRG shell for journal Brg	IV	D	Packing & greasing	do	
	Bearing shell & thrust pad M/C	IV	D	do	do	
	Bearing pedestal with cover (casting)& (M/C)	III	B	Damage	do	
	Thermal insulation	III	-	Damage to Packing	do	
	Measuring/Heating Devices	IV	A	do	do	
	P W tank including PW piping	III	E	do	do	
	HP outer casing casting exhaust & inlet	II	A	do	do	
	HP valve assembly	III	A	Damage, Painting	do	
	Casing upper part, casing side wall(L&R), front wall (TS & GS)	III	B	Damage to Packing	do	
	EHA for turbine valves	IV	A	Physical Damage, Painting	do	
	Air cooled condenser	III	B	do	do	
	Servomotors	IV	A	do	do	
	Turbine integral piping	II	B	do	do	
	Oil module & oil purification system	III	B	do	do	
	Compensator for cross over pipe	III	B	do	do	
	Satellite bushes	IV	A	do	do	
	Valve assembly and IP & HP servomotor assly.	IV	A	do	do	
	Tube/Plate cooler, Control fluid cooler & other Misc.Coolers	IV	B	do	do	
	Main oil tank/Flash tank	II	B	do	do	
	Changeover double filter	IV	A	do	do	
	TG hall EOT cranes	II	B	do	do	

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 13 OF 33

Turbine & Aux. Including Station Piping	RE Joints, Metallic expansion joints/ compensator	III	B	Damage, Painting	3 Months	
	Drain /Leakage/Dirty fluid/Other misc. tanks	II	B	do	do	
	Continuous tube cleaning equipment, Debris filter	III	B	do	do	
	Secondary cooling water pumps (ACW/DMCW)	III	A	do	do	preservation as per OEM guideline
	AUX. cranes & hoists	III	B	do	do	
	LP pipes & fittings (CS/ SS)	III	B	do	do	
	Condenser tube & LP / HP heater tube	III	B	Damage, End caps	do	
	TG casings (all)	II	B	Damage, Painting	do	
	Blade ring all type	III	A	do	do	
	Dummy rings	IV	A	do	do	
	Nozzle chamber	IV	B	do	do	
	HP & IP thermal shield	IV	A	do	do	
	LP 1&2 steam chamber/ deflector (upper & lower)	IV	B	do	do	
	LP 6C/7C diaphragm (LP -1&2 /GOV & Gen end)	IV	B	do	do	Preservation as per OEM guideline
	LP flow guide ring (upper) / (lower) LP 1&2 /GOV & GEN END	IV	A	do	do	
	HP/LP & IP inner/outer gland (upper & lower/ Gov& Gen end)	IV	A	do	do	
	HP pedestal cover	II	B	do	do	
	Thrust bearing case (upper & lower)	IV	A	do	do	
	Spacer (HP & IP-LP) & (LP-1-2)	IV	A	do	do	
	HP pedestal base	III	A	do	do	
	Bearing covers	II	A	do	do	
	Coupling cover (HP&IP-LP) & coupling guard cover (LP-1-2) & coupling cover T/G	II	B	do	do	
	Condenser wall/ Dom wall, Stiffening Pipe/Rods	II	B	do	do	
	Hot well & Deaerator	II	B	do	do	
	Lower exhaust neck	II	B	do	do	
	SAW (spiral welded/ rolled & welded) pipes as per IS -3589	I	B	Damage, End caps	do	
	ERW pipe (IS 1239/ 3589)	I	B	do	do	
	SS pipe (weld/ seamless) as per ASTM A 312	II	B	do	do	
	CS seamless pipe as per ASTM A 106	II	B	do	do	
	Fitting (MS/SS) (forged/ formed)	III	B	do	do	
	Mono Rail Hoist	III	B	do	do	
	MS/GI/SS/forged flanges	III	B	do	do	
	Oil / Steam hoses	IV	E	do	do	
	Moisture trap	IV	-	do	do	

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 14 OF 33

Misc. Items including items of Off- site areas e.g AHS, CHP, MGR etc	Hor. & Vert. Pumps, Ash Slurry Pumps, Vacuum Pump, Submersible Pumps, Metering Pumps (Diaphragm Type)	III	B	Damage, Painting & condition of preservation	6 months	
	CW Pumps – Casing, Column Pipe, Motor Stool, Shafts	II	B	do	do	
	CW Pumps – Impeller, Hub, Bearings, Couplings, Loose Components	II	B	do	do	
	Valves various types (Dual Plate Check Valves, Balancing Valves, Ball/ Plug Valves, Gate/ Globe/ Check Valves, Air Release Valves, Diaphragm Valves, Pr. Reducing Valves, Hydrant Valves, Deluge Valves, Alarm Valves etc)	IV	B	do	do	
	Butterfly Valves	III	B	do	do	
	Pipes(MS/ GI/ SS/ CS/ CI/ DI/ Basalt Lined)	I	B	do	do	
	Pipe Fittings	II	B	do	do	
	Air Blowers (Lobe/ Centrifugal)	II	B	do	do	
	Electric Hoist	III	B	do	do	
	Gantry Crane	II	B	do	do	
	Chain Pulley Block	III	-	do	do	
	Ventilation Fans (Axial/ Radial/ Propeller/ Exhaust)	III	B	do	do	
	Hydraulic Actuators (Power Pack/ Cylinders)	IV	B	do	do	
	Motors	III	B	do	do	
	Wrapping & Coating Material	III	-	do	do	
	PVC Fills/ Drift Eliminators	II	-	do	do	
	Diesel Engine	II	B	do	do	
	Fire Hose, Bag Filters, Pre/ Fine Filters	III	-	do	do	
	Fire Extinguishers - Portable	III	B	do	do	
	Spray Nozzles (HV/ MV), QB Detectors, Water Monitor	IV	-	do	do	
	Pr. Relief Damper	III	B	do	do	
	Hose Box, Foam System Components	III	-	do	do	

ENGINEERING DIVISION	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 15 OF 33

Misc. & Common Items(Off site areas e.g AHS,CHP,MGR etc)	CO2/ Clean Agent Fire Suppression Sys. Components	III	B	Damage, painting & condition of preservation	6 months	
	Stacker/ Reclaimer	I	A	do	do	
	Wagon Tippler & Side arm Charger	I	A	do	do	
	Idlers/Pulleys	III	B	do	do	
	Apron/Paddle Feeder, Ring Granulator, Grizzly Feeder, Travelling Tripper	I	B	do	do	
	Conveyor Belts	II	-	do	do	
	Bearings all type	IV	D	do	do	
	Gear Box (Helical/ Planetary), Fluid Couplings	III	B	do	do	
	Couplings (Geared/ Flexible)	III	B	do	do	
	Gates (Flap/ Rod/ R&P)	III	B	do	do	
	Dust Extraction/ Suppression System Components	I	B	do	do	
	Elevators	II	B	do	do	
	Vibration Isolation System Components	II	B	do	do	
	Air Conditioners (Window/ Split/ Package/ Cassette), Air Handling Units	III	B	do	do	
	Coal Sampler System Components	II	-	do	do	
	Ducting Materials	I	A	do	do	
	Chimney Shells	I	E	do	do	
	Air Compressors (Screw/ Centrifugal/Reciprocating)	I	B	do	do	
	Air Intake Valves, Feed Gate, Clinker Grinder, rotary Feeders, Fly Ash/ Branch Header Valve, jet Pump, Centrifugal pumps, Jetting Nozzle	IV	B	do	do	
	Pipe Couplings, Trench Liners, Branch pipe	I	A	do	do	
	Paints	III	-	do	do	
	Screw Chillers	II	-	do	do	
	Gaskets, Asbestos ropes , pads	IV	-	do	do	
	Fasteners	IV	A	do	do	
	Instruments Misc.	IV	-	do	do	

ENGINEERING DIVISION	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 16 OF 33

ELECTRICAL - Transformer (Oil Filled)	Storage of Main Unit transported with Nitrogen / Dry Air Filled	I	H	Ensure Positive Pressure of dry air / Nitrogen - If the oil cannot be filled immediately after receipt at site. - After satisfactory observation for one week, the frequency of recording pressure readings can be done once in seven days	Daily	
				Dew point measurement (shall be -40 °C or better), if the transformer is filled with dry air or nitrogen	Once in a month Upto 90 days	
				Transformer shall be filled under vacuum with treated oil	After 90 days	
				Carry out oil test for BDV, Moisture content and resistivity	Monthly	
				Oil Circulation to achieve BDV & Moisture content of oil	See remark	At the time of oil filling and as & when required
				Open the valves between tank & heat exchanger and run the fan or/& oil pumps for two hours	After Oil Filling - Quarterly	
				Oil Level readings of MOG & Prismatic Oil Gauge	Weekly	
				IR & Tan Delta of windings & bushings	6 months	
				BDV & Moisture content of diverter switch oil		
				Operate Tap Changer 2-3 times over full range	Quarterly	
				LV Routine Tests on the transformer	6 months	
	Storage of Main Unit transported with Oil Filled	I	H	Carry out oil test for BDV, Moisture content and resistivity	Monthly	
				Oil Circulation to achieve BDV & Moisture content of oil	See remark	At the time of oil filling and as & when required
				Open the valves between tank & heat exchanger and run the fan or/& oil	Quarterly	

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 17 OF 33

ELECTRICAL - Transformer (Oil Filled)	Storage of Main Unit transported with Oil Filled	I	H	pumps for two hours	Weekly	
				Oil Level readings of MOG & Prismatic Oil Gauge		
				IR & Tan Delta of windings & bushings	6 months	
				BDV & Moisture contact of diverter switch oil		
				Operate Tap Changer 2-3 times over full range	Quarterly	
				LV Routine Tests on the transformer	6 months	
	Accessories - (Bushing CTs, Bushing Leads, MOG, Buchholtz Relay, PRV, RPRR, WTI, OTI, RTD, Prismatic Oil Gauge, Pressure Gauge, Breather, Explosion Vent with Diapharms, Oil Operated Relay, Oil Surge relay, etc)	I	-	Physical Damage, Rusting etc	Quarterly	Preservation as per OEM guideline, if required
	Accessories - Fans, Pumps, etc.	IV	-	Visual check to ensure covered storage for identified items. Rotate the motor rotor at least 10 complete turns. Shaft after rotations should rest at 90 degrees to where it was before rotation	Quarterly	do
	Condenser Bushings	I	-	Oil level in Condenser bushings	Monthly	do
		I	-	Safe Storage in vertical or angular position (bushing oil end side shall be down)		do
		I	-	IR & Tan Delta measurement & earthing point shall be ensured to restored to original position	6 months	do
	Conservator, Radiator, Turrets, Coolers, Terminal Connector, etc.	II	-	- Storage on raised platform to ensure protection against humidity from ground and sinking into soil - Blanking of openings with suitable blanking plates.	6 months	do

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 18 OF 33

ELECTRICAL - Transformer (Oil Filled)	Oil Drums	II	-	Storage on raised platform / hard surface. Ensure horizontal storage with bungs at 45 deg. This position ensures that bungs are under a positive oil pressure. Protection of oil drums from water, fire & explosion hazards	6 months	
	Marshalling Box, RTCC, Cable Boxes, etc	III	-	- Ensure vertical storage in their respective cases - Checking the condition of gaskets - Space heater should be connected to electric supply to be kept ON	6 months	Preservation as per OEM guideline, if required
	Silica Gel	IV	-	Condition/Colour of Silica Gel	Dry before use	do
	Porcelain / Epoxy Bushing & Pin/Post Insulators	III	-	Physical Damage	6 months	do
	OLTC & its Motor Drive Unit	IV	-	- Space heater should be connected to electric supply to be kept ON - All openings must be blanked off	Quarterly	do
ELECTRICAL - Transformer (Dry Type)	Storage of Main Unit	IV	-	LV Routine Tests on the transformer	6 months	do
	Accessories - (CTs, WTI, OTI, RTD, Thermistor , etc)	IV	-	Physical Damage, Rusting etc	Quarterly	do
	Marshalling Box, RTCC, Cable Boxes, etc	III	-	-Ensure vertical storage in their respective cases - Checking the condition of gaskets - Space heater should be connected to electric supply to be kept ON	6 months	do
	Porcelain / Epoxy Bushing & Pin/Post Insulators	III	-	Physical Damage	do	do
	Gasket	IV	-	do	do	do
ELECTRICAL: (Misc.)	Cables & Cable Tray (Galv & FRP) , Flexible Cable Support, Conduit, Lightning & Earthing Material, Lighting Mast, Rail Pole	I	E	Damage & Painting	do	do
	Generator stator/Rotor	II	H	IR & N2 gas pr.	Weekly	do
	Exciter Rotor	II	-	IR value	do	do

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 19 OF 33

ELECTRICAL: (Misc.)	Gen. Aux.(Primary water system/Seal oil System/H2 Drier)	III	B	IR value	Monthly	Preservation as per OEM guideline, if required
	LT Bus duct, H.T. JB	II	-	do	do	do
	Lightning Arrestor, Insulator, Overhead Conductor, Clamps & Connector, Instrument Transformer, AC Switch	II	-	do	do	do
	Magnetic Separators (SM & ILMS)& Metal Detector	II	-	do	do	do
	EM & EHT Brake	II	-	do	do	do
	HT Motor	III	B	Damage & rotation	3months	For sleeve, Brg. ,Motor ,bearing part & journal shall be preserved as per OEM guideline
	LT Motor, D.C. Motor	III	B	Damage	3months	
	WDB,ACDB, DCDB, ACFB, DCFB, LPBS, EPBS, MLDB, Lightning Panel, Battery & Battery Charger, Local Starter, Control Panel (PLC & Non-PLC), VFD/VMS Panel, Load Break Switch Panel	IV	G	No damage to packing	Monthly	Preservation as per OEM guideline, if required
	HT & LT Switchgear	III	-	do	do	do
	Belt Weigher / Weigh Bridge (Load cell & Controller), Belt Indication System, Heavy Duty Limit Switch	IV	-	do	do	do
	Junction Box (Galv., FRP & Painted), Cable Gland, Lug, HT Termination & Jointing kit, Welding Receptacle, Trefoil Clamp, Switch Box, Fan,	IV	-	do	do	do
	Linear /Rotary Actuator	IV	-	do	do	do
	Control Desk, Anemometer, Conveyor Switch (BSS & PCS), CCTV & PA System Components, Measuring Instruments, PC, Printer	IV	-	do	do	do
	Light Fitting& Luminary	IV	-	do	do	do
	Push Button Stations, Push Buttons, Panel Mountings, Cable Lugs, Cable Gland	IV	-	do	do	do
	Electric Heaters	IV	A	do	do	do

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 20 OF 33

ELECTRICAL: (Switchyard Equipments & Accessories)	Gas insulated sub-station comprising of CKT BKR, ISO, CT, CVT,PT & Surge arrester.	III	-	No damage to packing. To be stored vertically	Monthly	Preservation as per OEM guideline, if required
	CT,CVT & PT	III	-	do	do	do
	Surge arrester	III	-	No damage to packing	do	do
	Circuit Breaker	III	-	do	do	do
	Isolator	II	-	do	do	do
	WAVE TRAP	III	-	do	do	do
	Post insulator	I	-	do	do	do
	Disc insulator/ Pin insulator	I	-	do	do	do
	Control & Relay Panels	IV	G	do	do	do
	Substation/ Workstation	V	-	do	do	do
	Numerical Relays	V	-	do	do	do
	Energy Meter	V	-	do	do	do
	Event Logger	V	-	do	do	do
	GPS TIME Synchronisation Equipment	V	-	do	do	do
	RELAY TEST KIT	V	-	do	do	do
	Disturbance Recorder	V	-	do	do	do
	Operational Analyser with DCRM KIT	V	-	do	do	do
	Leakage current analyser for surge arrester	V	-	do	do	do
	LARGE VIDEO SCREEN (LVS)	V	-	do	do	do
	ACSR CONDUCTOR	II	-	Physical Damage	Quarterly	do
	Aluminium tube	II	-	do	do	do
	FIBRE OPTIC CABLE/ OPGW CABLE	III	-	do	do	do
	Clamps & connectors & welding sleeves	II	-	do	do	do
	BMK'S/ JB'S (ALL TYPES) / lighting panels	III	-	do	do	do
	Insulator hardware, conductor accessories & earth wire accessories	II	-	No damage to package.	Monthly	do
	AC Kiosk	II	-	do	do	do
	Industrial receptacles	III	-	do	do	do
	GS FLAT	I	-	do	do	do
	40MM DIA M.S EARTH RODS	I	-	do	do	do

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 21 OF 33

ELECTRICAL: (Switchyard Equipments & Accessories)	GI PIPE /GI EARTH PIPE	I	-	No damage to packing	Monthly	Preservation as per OEM guideline, if required
	GI Conduit (including bends)	I	-	do	do	do
	GS Earth wire / Lighting wire	I	-	do	do	do
	Vibration Damper	I	-	do	do	do
	SAG Compensating Spring	I	-	do	do	do
	Nitrogen gas Filling device	IV	-	do	do	do
	SF6 GAS Filling and evacuating plant	IV	-	do	do	do
	Gas recycling & Purifying plant	IV	-	do	do	do
	Gas Leakage Detector	IV	-	do	do	do
	SF6 Gas cylinders	IV	-	To be kept away from direct sunlight.	do	do
	Power transformer			do	do	do
	Circuit Breaker	III	-	do	do	do
	Isolator	II	-	do	do	do

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 22 OF 33

C & I	DDC MIS / HMI System	V	-	No damage to package	Monthly	Preservation as per OEM guideline, if required
	Operator work stations	V	-	do	do	do
	Flame Monitoring System(Scanner)	V	-	do	do	do
	HEA ignitor	IV	-	do	do	do
	Furnace Flame viewing system(High Temperature CCTV Components)	V	-	do	do	do
	Coal Flow Monitoring System	V	-	do	do	do
	Acoustic pyrometers	V	-	do	do	do
	Coal feeder control system	IV	-	do	do	do
	Acoustic Coal Flow Detector	IV	-	do	do	do
	On line carbon in Ash Analyser	IV	-	do	do	do
	Furnace Exit Gas Temperature Probe	IV	-	do	do	do
	Boiler tube leak detection system	IV	-	do	do	do
	Coal bunker Level monitor	IV	-	do	do	do
	Tube thickness Meter	IV	-	do	do	do
	Positive displacement Flow meter/ Transmitter	IV	-	do	do	do
	Coriolios Type Mass Flow meter	IV	-	do	do	do
	Control Valves for different System	IV	E	do	do	do
	Conduits/Pipe(GI)	I	E	do	do	do
	Thermocouples, RTD & Thermo well	IV	-	do	do	do
	Transmitter (Temp./ Level/ Pr./ DP/ Flow etc)	IV	-	do	do	do
	Gauges/ Indicators (Temp./ Pr./ DP/ Vacuum/ Level/ Flow/ Density/ Reverse Rotation etc)	IV	-	do	do	do
	Level gauge (Transparent & Reflex, Tubular type)	IV	-	do	do	do
	Switches(Temp./ Pr./ DP/ Vacuum/ Level/ Flow/ Limit etc)	IV	-	do	do	do
	Condensing Pots	IV	E	do	do	do
	Electric to Pneumatic converter	IV	-	do	do	do
	Conduits lead coated (Flexible)	II	E	do	do	do
	Intelligent Battery charger 24V DC & DCDB /BHM S	IV	-	do	do	do

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 23 OF 33

C & I	Battery Health Monitoring System	IV	-	No damage to package	Monthly	Preservation as per OEM guideline, if required
	Battery different types & Battery Chargers	IV	-	do	do	do
	Socket weld fittings	I	-	do	do	do
	Impulse pipe & tubes	I	-	do	do	do
	Compression fittings	IV	-	do	do	do
	Instrument valves	IV	-	do	do	do
	Valve manifolds	IV	-	do	do	do
	Local Instrument Enclosure/Rack	IV	-	do	do	do
	Instrument Cables/ Fibre Optic Cables	I	-	do	do	do
	Actuators Elect./Pneum.	IV	-	do	do	do
	Flow nozzle / Venturi assembly, Orifice Plate	IV	-	do	do	do
	HIGH Temp. cable (PTFE/FEP)	I	-	do	do	do
	Transducers	IV	-	do	do	do
	Mini UPS up to 3.5 KV A	IV	-	do	do	do
	Air filter regulator	IV	-	do	do	do
	Copper tubing/Brass connectors	II	-	do	do	do
	Coupling / Interposing relays	IV	-	do	do	do
	Solenoid valve	IV	-	do	do	do
	Guided wave Radar type level transmitter	IV	-	do	do	do
	Maintenance and Calibration Equipment	IV	-	do	do	do
	Furniture's	IV	-	do	do	do
	Terminal Block (Cage and Clamp type)	IV	-	do	do	do
	FRP Junction Box	IV	-	do	do	do
	PLC System	IV	-	do	do	do
	Smart Positioner	IV	-	do	do	do
	Rotameter	IV	-	do	do	do
	Single and multi-point temperature recorder (Micorprocessor based)	IV	-	do	do	do
	Reverse Rotation Indicator (RRI)	IV	-	do	do	do
	Instrument Tube Fittings	II	-	do	do	do
	pH/ Conductivity Analyser/ Meter	IV	-	do	do	do
	PADO	IV	-	do	do	do
	DEW Point Sensor /meter	IV	-	do	do	do
	Blank Panels / Cabinets	IV	-	do	do	do
	CCTV Components (IP)	IV	-	do	do	do

ENGINEERING DIVISON	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 24 OF 33

C&I	Control Desk, Server / PC Rack for Unit Control room and Auxiliary control room.	IV	-	No damage to package	Monthly	Preservation as per OEM guideline, if required
	Digital Indicators	IV	-	do	do	do
	Dust Emission Monitor	IV	-	do	do	do
	Electrical Indicating Instruments (Mosaic Compatible)	IV	-	do	do	do
	Flue Gas Analyser (CO, CO ₂ , SO ₂ , Nox & O ₂ - HT/LT)	IV	-	do	do	do
	Flue Gas Analyser Panel	IV	-	do	do	do
	Graphic Interface Unit	IV	-	do	do	do
	Hand Held Calibrator	IV	-	do	do	do
	Hart Management System	IV	-	do	do	do
	Impact Head Type Flow Element	II	-	do	do	do
	Isolator	IV	-	do	do	do
	Master Slave Clock System	IV	-	do	do	do
	Mosaic Tiles / Console Items	III	-	do	do	do
	Network Components	IV	-	do	do	do
	Online Mercury Analyser	IV	-	do	do	do
	P A System (IP Based)	IV	-	do	do	do
	Printer (Dot Matrix/ Inkjet/ Laser)	IV	-	do	do	do
	Semaphore Indicators	IV	-	do	do	do
	Synchronising Relay	IV	-	do	do	do
	Synchroscope	IV	-	do	do	do
	Ultrasonic Type Flow Meter (for Stack)	IV	-	do	do	do
	UPS / ACDB	V	-	do	do	do
	Vibration Monitoring System for BOP	IV	-	do	do	do
	Voltmeter	IV	-	do	do	do
	Watt-hour Meters	IV	-	do	do	do
	Wireless Solution (Microwave Tower Communication)	IV	-	do	do	do
	Large Video Screen (LED Based)	IV	-	do	do	do
	CJC Box (If applicable)	IV	-	do	do	do
	3 D level Scanner for Solid Application	IV	-	do	do	do
	Dust Sensor	IV	-	do	do	do
	Pulse jet Controller	IV	-	do	do	do
	Solid Mass Flow Meter	IV	-	do	do	do
	Nucleonic Density meter	IV	-	do	do	do
	Humidistat / Thermostat / Gyserstat / Air stat	V	-	do	do	do

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**



MATERIAL STORAGE AND PRESERVATION GUIDELINES

DOC. NO. : QS-01-CQA-W-21

REV. NO. : 0

REV. DATE :

PAGE : 25 OF 33

C & I	Turbine supervisory Instruments along with Vibration Analysis System	IV	-	No damage to package	Monthly	Preservation as per OEM guideline, if required
	Generator end winding monitoring system	IV	-	do	do	do
	Analysers(SAWS ,H2 Gas, Concentration)	IV	-	do	do	do
	Electromagnetic Flow Meter	IV	-	do	do	do
	Flow Nozzle for Performance Calibration.	IV	-	do	do	do
	Impulse/ Pneumatic Piping, Valve Manifolds, Compression Fittings	IV	-	do	do	do
	FRP/ GI Junction Box, Terminal Box	IV	-	do	do	do
	ORP Monitor & Analyser	IV	-	do	do	do
	Corrosion Rate Monitor	IV	-	do	do	do
	HART Communicator	IV	-	do	do	do
	Smoke Detectors	IV	-	do	do	do
	Fire Alarm Panels	IV	-	do	do	do
	UPS, Computers, Printers, PLC System	V	-	do	do	do

Note-1: If items are unpacked and their covers are opened, then Type-IV storage category item should be moved to Type-V (air conditioned environment).

-Valves and actuators are to be sent separately at site to avoid any damage to actuator due to improper handling, when both are in assembled condition.

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 26 OF 33

CIVIL: Construction materials	Mooram, fly ash, coarse & fine aggregates, bricks, stone boulders, RCC pipes, RCC covers, PSC Sleepers etc.	I	-	6 months	Cleanliness from mud, water and other deleterious materials	Materials to be stacked over levelled and raised ground free from grass & vegetation. (Refer IS:4082)
	Reinforcement steel, structural steel including I-section beams, channels, SS plates, MS pipes, GI Pipes, etc.	I	-	3 months	Damage of paints & primers, formation of rust.	(Refer IS:4082)
	Steel doors/windows, rails, steel sleepers, Flooring materials Lime stocks/Tiles, Precoated profiled shed sheets, CGI/Asbestos/PVC/FRP sheets, Translucent polymer sheets, Bitumen impregnated fibre boards, expansion boards	III	-	3 months	Physical Damage	-do-
	Cement, Lime,	IV	-	3 months	Expiry date of materials. Hydration/lu mp formation due to atmospheric conditions.	Materials to be stacked in gunny bags/sacks as per Technical Specification/ manufacturer's recommendation. Expiry date to be checked regularly. (Refer IS:4082)
	Blasting materials (Explosives)	-	-	Daily	Note-2	
	Bentonite	IV	-	As per manufacturer's guideline	Expiry date. Hydration & Moisture effect from atmosphere	Materials to be stored in stacks of gunny bags as per Technical specification/Manufa cturer's details. (Refer IS:4082)
	Admixtures, plasticizers, accelerators/chemicals, Paints & Primers etc., Damp proof course (DPC) items, Ready mix Grouts for any purpose Grease & Lubricants.	IV	-	3months	Expiry date. Protection from fire, dust etc.	To be placed on paved surface in containers having batch no., date of manufacture and expiry etc. To be kept under fire protection arrangement. (Refer IS:4082)
	Wooden doors/Windows, Wooden partitions, false ceiling material, Kraft paper, PVC doors, Fire Proof Doors, Aluminium doors/Windows, frames (Aluminium), Glass Glazy/ Glass Strips, structural glazy,	IV	-	3 months	Damage of paint/protecti ng cover/ anodization. Damage due to worms & white ants.	To be placed on paved ground with bottom support of wooden sleepers or concrete blocks. Glass & Glass strips to be kept in wooden packing.

ENGINEERING DIVISON

**DEPARTMENTAL MANUAL
WORK INSTRUCTION
CORPORATE QUALITY ASSURANCE**

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 27 OF 33

CIVIL: Construction materials	Asbestos ropes, glass wool and rock wool insulation material.					
	Steel bearings, MS nuts & bolts including foundation bolts, washers, screws, Anchor Fasteners, water supply & sanitary fittings of Mild steel/G.I/C.P. brass/Chinaclay /WS/ Wash basins/Other costly fittings & fixtures	IV	'D' & 'E'	3 months	Damage of galvanization, paints, protecting cover etc.	Material to be kept on shelves and preferably in bags/sacks. To be seen after every three months for protection from dust and damage etc.
	PVC water stoppers, water tanks, Bitumen drums	II	-	To be checked time to time preferably 3 months	Damage of material	Materials to be stored on paved ground preferably on support. To be inspected after every three months for protection from atmospheric effects.
	Lead sheets, Expansion compensators with bulsters, MS circumferential reinforcing bands.	IV	-	3 months	Damage of materials	Materials to be stored on paved grounds and fire protection arrangement to be done at store.
	Bio reactors (PP), MS epoxy coated bar screen, Tube settler, Dual Media Filters, flocculators.	V	-	3 months	Damage of materials	Materials to be kept on paved ground preferably on supports.
CIVIL: Fabricated Structures/Factory fabricated structures	Column, beam, post, truss, handrail, walkway, gusset plates etc.	I	E	Protective coating for thread, damage, paint	do	
	Fasteners and Foundation bolts, HSFG Bolts & Girder Pin connection	IV	A	Damage & preservative	do	

Note-

- 1) This document is to be read in conjunction with the provision of IS: 4082-"STACKING AND STORAGE OF CONSTRUCTION MATERIALS AND COMPONENTS AT SITE-RECOMMENDATIONS"
- 2) Materials to be kept on levelled and raised ground with concrete/brick paving below. Steel members to be kept on the support of wooden sleepers or concrete blocks to maintain distance from existing ground. Spacers of wood or steel to be provided after every three continuous layers. In case of damage or peeling off of the paints/primers and rust formation, materials to be cleaned appropriately and reapplied with paint/primer.

ENGINEERING DIVISION	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

	MATERIAL STORAGE AND PRESERVATION GUIDELINES	DOC. NO. : QS-01-CQA-W-21
		REV. NO. : 0
		REV. DATE :
		PAGE : 28 OF 33

- 3) Blasting materials/explosives are to be stored in isolated magazines specially constructed for the same. Storage magazines should be constructed at place free from grass vegetation, charged electric line etc. to avoid the chances of fire/spark. Blasting materials are to be stored and handled strictly as per Indian Explosive Act and explosive rules. Blasting materials are to be kept in dry, clean & well ventilated and fire proof closed magazines constructed in accordance with Indian Explosive Act and fenced with barbed wire for safety and security.
- 4) Cement and ready mix grouts to be stored in a way that they are used in '**first in-first out**' principle.

ENGINEERING DIVISION	DEPARTMENTAL MANUAL WORK INSTRUCTION CORPORATE QUALITY ASSURANCE

247927/2021/PS-PEM-MAX

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME : II B	
		SECTION : E / ANNEXURE-V	
		REV 00	DATE: Nov. 20
		SHEET: 1 OF 1	

ANNEXURE-V

PACKING PROCEDURE

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 1 of 24

DOMESTIC PACKING

COMMON GUIDELINES

1 GENERAL:

This standard lays down packing instructions for domestic packing of Components/ Assemblies/ Equipment to be despatched against Customer's contracts, for which there are no special instructions issued by the Engineering Departments. For Seaworthy Packing refer standard AA0490004 wherever applicable.

The Components/Assemblies need to be packed suitably to avoid physical damage & corrosion during transit & storage. For specific applications the concerned engineering department shall issue a product standard. Reference of this product standard, must appear in the Shipping list/Packing List.

2 SCOPE:

This procedure gives minimum guidelines to be complied with for domestic packing of Components /Assemblies/ Equipment. This domestic packing shall be suitable for different handling operations and for the adverse conditions during transportation and during indoor / outdoor storage of materials.

3 WOOD SPECIFICATION

Based on availability, the wood shall conform to specification AA51401 or AA51402.

4 TYPES OF PACKING:

The following 5 types of packing have been standardized for packing of General Components/ Assemblies.

- 1) 'OP' - Open Type.
- 2) 'PP' - Partially Packed.
- 3) 'CP' – Crate/Box Packing - Components/Equipment requiring physical protection.
- 4) 'CQ' - Case Packing – Machined components-Small & Medium Components/ Assemblies/ Equipment which require corrosion & physical protection.
- 5) 'CR' - Case Packing – Electrical/Electronic Components/ Assemblies, which require special packing viz. Water Proof, Shock Proof etc...

5 DESCRIPTION OF TYPES OF PACKING:

The various types of packing, as standardized above, are described below.

5.1 'OP' - Open Type

In case, of components which are not affected by water & dust and do not require special protection, are generally not machined, shall be sent as open packages. However, these components may be sent in crates, wherever necessary.

5.2 'PP' - Partially Packed

Components which need special protection at selected portions only shall be despatched partially packed. Machined surfaces should not be allowed to come directly in contact with the wood. Such surfaces should be protected with 100GSM(Colourless) Multi Layered Cross Laminated Polyethylene

Revisions:			APPROVED: PROCEDURAL GUIDELINES COMMITTEE – PGC (Packing)		
Rev. No. 02	Amd. No.	Reaffirmed	Prepared HPBP, Trichy	Issued Corp. R&D	Dt. of 1 st Issue 31-05-2018
Dt: 28-08-2018	Dt:	Year:			

AA0490010

Rev. No. 02

PAGE 2 of 24

CORPORATE STANDARD

Film to Specification No. AA51420. All sharp corners and edges shall be protected by rubber mats to prevent damage to the polyethylene film

5.3 'CP' - Crate Packing

Assemblies/Components which need only physical protection from the point of view of handling shall be despatched duly packed in crates.

5.4 'CQ' - Case Packing - Machined Components/Assemblies/Equipment

Small and medium sized components/assemblies/equipment due to size/weight and to avoid handling and pilferage problems shall be packed in Case/Containers. Wherever required adequate quantity of silica gel to AA55619 or VCI Powder/Tablets, packed in thin muslin cloth cotton bags shall be suitably placed. Small machines/components of less weight shall be provided with suitable cushioning by Rubberised coir. The components inside the case shall be entirely covered with 100GSM (Colourless) Multi Layered Cross Laminated Polyethylene Film Specification No. AA51420, wherever required. This may be prescribed for electronic parts/critical machined components/surfaces.

For mechanical product like valves where motors are separately securely wrapped in polyethylene, the requirement of individual component wrapping shall be exempted.

5.5 'CR' - Case Packing - Electrical & Electronic Components/Assemblies

Delicate components likely to be damaged e.g. Gauges, Instruments etc. are to be wrapped in waxed paper or polyethylene air bubble film and packed in cartons. Adequate quantity of Silica gel to AA55619 packed in cotton bags of 100grams each are to be suitably placed in the cartons. The cartons shall be entirely covered with 100GSM (Colourless) Multi Layered Cross Laminated Polyethylene Film Specification No. AA51420 before being packed in the cases. VCI Powder/Tablets can be used as an alternative to Silica Gel to AA55619.

Empty space in the cartons shall be filled with rubberized coir to get proper cushioning effect. The cartons shall be manufactured from corrugated Fiber Board, meeting requirements of AA51414.

6 PREPARATION OF PACKING CASES**6.1 DIMENSIONS:**

- a) Thickness of planks for Front, rear, top and bottom sides and binding, jointing battens shall be 25/20mm +2/-3 mm as per applicable drawings of the respective units.
- b) Width of all planks including the tongue shall be more than 125mm and after planing it shall be minimum 100mm.
- c) Minimum number of planks shall be used for a shook.
- d) Horizontal, vertical, diagonal planks shall be given for binding (number of such planks depend on the dimension of panel).
- e) Width of binding planks shall be minimum 100mm.
- f) Distance between any 2 binding planks shall be less than 750mm.
- g) diagonal planks shall be used in between vertical binding planks when distance between inner to inner of vertical planks is more than 750mm
- h) Distance of the outer edges of these planks from the edge of case shall be less than 250mm.
- i) Diagonal planks are not required for top planks and width side, if the width of pallet is less than 750mm.

6.2 JOINTING OF PLANKS

Single length planks shall be used for cubicles whose overall length is less than 2400mm. For cubicles of length more than 2400mm, jointing is permitted. The jointing shall be done with one single or maximum of 2 planks of wood same as other planks of width 250 mm (minimum) with two rows of nails on either side of the joint in zigzag manner. From the joint along height side, it shall be of lap joint with overlap of at least the width of plank.

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 3 of 24

6.3 TONGUE AND GROOVE JOINTS

Two consecutive planks shall be joined by tongue and groove joint. Depth of tongue shall be 12+1 mm, thickness of tongue shall be 8 +1 mm. The groove dimensions shall be such that the tongue fits tightly into the groove to make a good joint. This type of joint can be done based on the product requirement wherever required.

6.4 PERMISSIBLE DEFECTS

Wood shall be free from knots, bows, visible sign of infection and any kind of decay caused by insects, fungus, etc.

End splits: Longest end splits at each end shall be measured and lengths added together. The added length shall not exceed 60mm per meter run of shook's. Wood pins shall be used to prevent further development of split.

Surface cracks: Surface cracks with a maximum depth of 3mm are permissible. A continuous crack of any depth all along the length is not allowed.

6.5 OTHER MATERIALS

6.5.1 NAILS

The dia. of the nails shall be 3.15mm. The length of the nails shall be 65mm wherever two planks of 25mm thickness are joined and 75mm wherever a 25mm planks is joined to a 50mm plank.

6.5.2 BLUE NAILS

These are used for nailing bituminized Kraft paper/hessian cloth to the planks. The length of the nails shall be 16mm.

6.5.3 HOOP IRON STRIPS

These are used for strapping the boxes. The width of the strips shall be 19+1mm and thickness 0.6+0.01mm. The material shall be free from rust.If sufficient nailing is done for bigger boxes, strapping need not be done.

6.5.4 CLIPS

These shall be used for strapping the hoop iron strips on the boxes.

6.5.5 BRACKETS

These brackets are used for nailing to the corners of cubicle boxes. The brackets shall be of mild steel of thickness min 2mm and width 25+1mm. The brackets shall be of "L" shape, the length of each side being 100+2mm. Two holes shall be provided towards the end of each side for screwing /nailing.

6.5.6 FASTENERS

Bolts, double nuts, spring washers will have to be used for packing of some special items like transformers, reactors, breakers, etc., to hold the job to the bottom plank of the box. The bolts, nuts, washers will be provided by the vendor. Drilling of holes will have to be done using contractor's tools.

6.5.7 MULTI LAYERED CROSS LAMINATED POLYTHELENE FILM

100GSM (Colourless) Multi Layered Cross Laminated Polythelene Film Specification No: AA51420 are used to make covers to the jobs individually. The cross lamination gives qualities of extra toughness, together with flexibility and lightness coupled with good weather resistance to ultra violet rays.

6.5.8 RUBBERISED COIR:

The rubberized coir is used as cushioning material. For the packing of loose items, items are to be arrested by using rubberized coir. For the packing of cubicles rubberized coir of thickness 25mm and width 75mm shall be used.

6.5.9 FOAM RUBBER / 'U' FOAM:

This is used for covering the delicate items. This material is provided by the vendor.

AA0490010

Rev. No. 02

PAGE 4 of 24

CORPORATE STANDARD**6.5.10 MARKING PLATE:**

This shall be of anodized aluminium sheet. Size of the marking plate shall be maintained minimum of size as per the details specified in the Figure 4.

6.5.11 PACKING SLIP HOLDER:

This shall be of galvanized iron tinned sheet /Aluminium sheet

6.5.12 SILICA GEL:

This shall be of indicating type to conform to IS: 3401/AA55619. Silical gel shall be used for such products only where moisture needs to be avoided.

6.5.13 COTTON BAGS:

These are used for holding silica gel. The bags shall have the following matter indicated on them:

BHEL-UNIT NAME	PLACE-PINCODE
SILICA GEL	INDICATING TYPE
BLUE :	ACTIVE
ROSE :	REDUCED ACTIVITY
WHITE :	NO ACTIVITY. TO BE REPLACED WITH FRESH SILICA GEL

6.5.14 COTTON/ PLASTIC TAPE:

This is used for tying small items. And also to prevent vibrations of moving parts within the cubicles.

6.5.15 MARKING INK:

The ink used normally is black in color. In some special cases other color also will have to be used. The ink shall be non-fading/indelible and non-washable by water.

6.5.16 POLYETHYLENE BAGS:

These are to be used for keeping the Packing slips. The bag shall be of size 70mm X 100mm (minimum).

6.5.17 Hessian cloth, twine thread, paint will have to be used in packing certain items.**6.5.18 Mechanical Latching clamps:**

For CLW Railway panels and similar Panels self-locking clamps can also be used on need basis in conjunction with or apart from regular bolt and nut fixing arrangement. For reusable boxes, these clamps provide easy locking and unlocking arrangement. These clamps will be made available from BHEL in some cases.

6.5.19 STICKERS

The following stickers to be put by the vendor on cubicles/Boxes after packing.

- 1) Case No sticker: 2 nos. Size 25.Cm x 0.45Cm
- 2) BHEL Monogram sticker: 1 no. Size 1.75Cm x 2.3Cm
- 3) Address sticker: 2 nos. Size 3.8Cm x 3.0Cm
- 4) Direction sticker "Front" & "Back" - 4 nos. Size 2.0Cm x 0.75Cm
- 5) Chain Mark Sticker: 4 Nos. Size – 3.0Cm x 0.75Cm
- 6) "Fragile" sticker: 2 Nos. Size. 2.1Cm x 1.5Cm
- 7) "DO NOT STACK" sticker - 2 Nos. Size 3.0Cm x 2.2Cm

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 5 of 24

In place of stickers, writing all the details legibly with paint shall be allowed & respective units may take decision accordingly.

7 PACKING OF CUBICLES:

7.1 The packing is to be done as per clause 5 in all respects.

7.2 The cubicles are already fixed on wooden pallets. Hence the contractor need not arrange the bottom pallets normally.

7.3 The cubicles will be of different sizes both width wise and lengthwise. The cubicles may be made up of single suite, 2 Suite, 3 Suite, 4 Suite, etc., The width of the cubicles generally varies from 400 mm to 1650mm. The length of the cubicle, generally varies from 1500 mm to 4800 mm. The height is normally 2430 mm. In some cases, the height may be less/more.

7.4 MULTI LAYER CROSS LAMINATED POLY FILM

The inner surface of 4 sides of shooK's shall be nailed with Multi-layer cross laminated poly film (as per 6.5.7) using blue nails (as per 6.5.2) wherever 2 pieces of Cross laminated poly film are used, the joint shall have an overlap of minimum 20mm.

The inner surface of top cover shall be nailed with Multi-layer cross laminated poly film (as per 6.5.7). This sheet shall project outside on 4 sides by at least 100mm and shall be nailed properly on sides. Joining of sheets should have overlap of minimum 20mm.

The cubicles shall be covered with Multi-layer cross laminated poly film (as per 6.5.7).

7.5 SILICA GEL:

Silica gel (as per 6.5.12) packed in cotton bags shall be kept at different places inside the cubicle as per BHEL-Unit directions. Each suit of cubicle shall be provided with 1 kg of Silica gel (for a 4 suit cubicle 4 kgs of Silica Gel to be used. The bag containing silica gel to be as per 6.5.13).

7.6 LOOSE PARTS:

Any loose parts in the cubicles shall be tied using cotton/ plastic tape. Wooden battens shall be provided wherever necessary.

7.7 WOODEN BATTENS:

In case of cubicle which are not rectangular in shape like control desks, sufficient number of wooden rafters/battens of proper size shall be provided to give strength to the package.

7.8 RUBBERISED COIR:

Gap between the cubicle and the case shall be filled with rubberized coir (as per 6.5.8) with distance between consecutive layers less than 500mm.

7.9 CLAMPING:

Packing shall be bound at edges by nailing M.S. Clamps / Brackets (as per 6.5.5). Each vertical edge shall have minimum 3 clamps. Top horizontal edges will have one clamp for every meter length of package. However, minimum 4 clamps shall be nailed at the top for any cubicle.

7.10 PACKING SLIP:

Packing slip kept in the polyethylene bag (As per 6.5.16) shall be placed in the box at appropriate place. In addition, one more packing slip covered in polyethylene cover and packing slip holder (as per 6.5.11) shall be nailed to front / rear of case.

7.11 MARKING PLATE:

One no. (As per 6.5.10) shall be nailed to the front side of the case.

7.12 CASE MOUNTING:

After complete packing, stencil marking of various details and marking of symbols shall be done as per BHEL instructions using indelible / non washable marking ink.

AA0490010

Rev. No. 02

PAGE 6 of 24

CORPORATE STANDARD**7.13 Different types (Typical) of Cubicles with sizes for Packing**

1. Single suite cubicle - 900 x 950 x 2500
2. Two suite cubicle - 1650 x 950 x 2500
3. Three suite cubicle - 2400 x 950 x 2500
4. Four suite cubicle - 3150 x 950 x 2500
5. Regulation cub - 1300 x 1350 x 2500
6. Thy cub - 2870 x 1350 x 2500
7. VFD Cub - 3800 x 1550 x 2500

7.14 PACKING OF CUBICLES FOR EXPORT

Refer Corporate Standard AA0490009.

8 PACKING OF LOOSE ITEMS/SPARES

- 1) Shape of cases shall be square, rectangular with single gabled roof or with double gabled roof depending on the nature of the job to be packed. Construction shall be as per drawings enclosed. Only gable will be additional as required.
- 2) Wood shall conform to specification AA51401 or AA51402 with Tongue and Groove joint as per clause 6.3.
- 3) Width of planks shall be at least 100 mm. Width of binding planks (battens) shall be at least 75mm.
- 4) External surface of planks on front and rear shall be plane 100% (except bottom plank).
- 5) Inner surfaces of all 6 sides shall be lined with Multi Layered Cross Laminated Polythelene Film (as per clause 6.5.7) using blue nails.
- 6) Rubberized coir of minimum 25mm thickness and 100 mm width shall be nailed to inner surfaces of bottom and 4 sides of box.
- 7) Internal packing: Items that go into the box shall be packed using 100GSM, (Colourless) Multi Layered Cross Laminated Polyethylene Film Specification No: AA51420. Any space left between the job and the sides and the top of the box shall be filled with rubberized coir to get proper cushioning effect.
- 8) Certain items like transformers, reactors, breakers, etc., shall be bolted to the bottom of the box using bolts, nuts and washers.
- 9) Silica gel as per clause 6.5.12 held in cotton bags as per clause 6.5.13 shall be kept at proper places in the box.
- 10) Packing slip kept in polyethylene bag (clause 6.5.16) shall be placed in the box.
- 11) Marking plate as per clause 6.5.10 shall be nailed to side of the box.
- 12) Two numbers of hoop iron strips as per clause 6.5.3 shall be strapped tightly on the case using clips.
- 13) Stencil marking of various details and marking of various symbols shall be done as per BHEL instructions using indelible/non-washable marking ink.
- 14) Loose items to be kept inside the cubicle
 - The components which are removed from cubicle for shipping purpose only, such as meters shall be kept inside the cubicle individually, kept in wooden box and tied firmly in bottom of Cubicle.
 - Other items which are given loose in addition to cubicle shall be packed in separate boxes.

9 BOX SIZES**9.1 BOX SIZES**

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 7 of 24

Table 1 – SPARES WOODEN BOX DETAILS

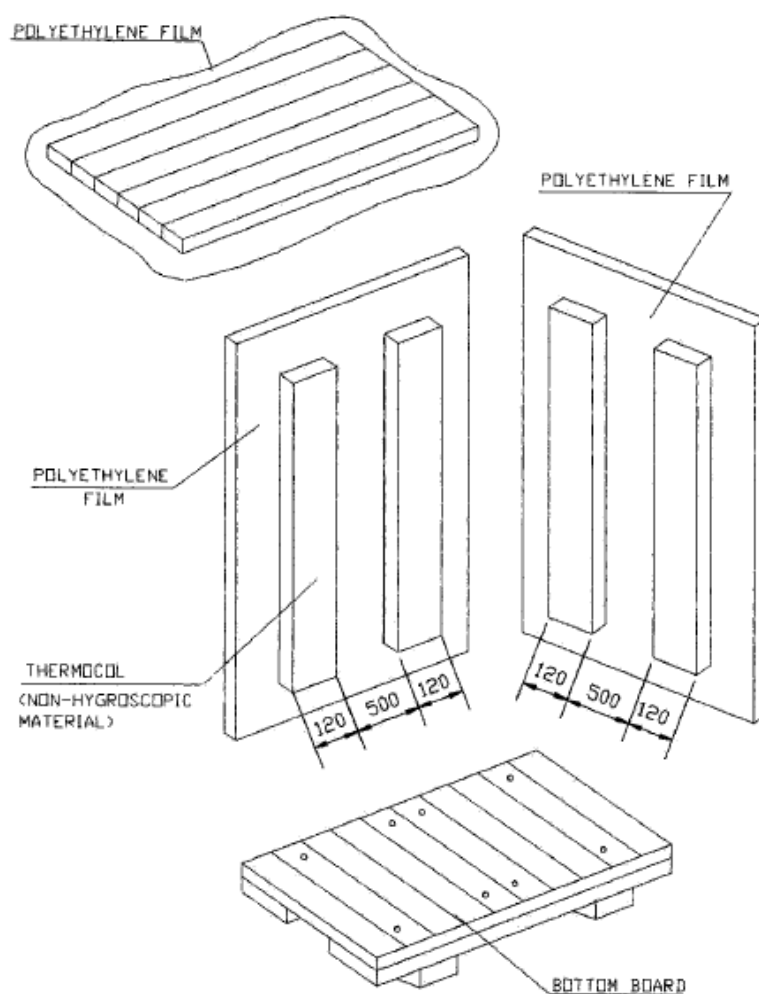
SNO	BOX TYPE	BOX SIZE (in mm)	BOX Wt (in KG)	Carrying Capacity
1	A	800 X 200 X 200	15	
2	B	1500 X 200 X 200	22	
3	C	2000 X 200 X 200	27	
4	D	1100 X 200 X 200	15	
5	E	200 X 200 X 200	5	
6	F	320 X 250 X 260	13	
7	G	320 X 250 X 430	16	
8	H	430 X 370 X 430	23	
9	I	1100 X 400 X 400	45	
10	J	1500 X 500 X 400	65	
11	K	2000 X 500 X 400	93	
12	L	2500 X 500 X 400	88	
13	M	900 X 600 X 600	100	
14	N	3000 X 400 X 400	60	
15	P	600 X 500 X 400	35	
16	Q	710 X 630 X 600	90	
17	R	850 X 630 X 670	102	
18	S	1000 X 770 X 670	140	
19	T	2500 X 850 X 800	180	
20	U	1500 X 700 X 700	120	
21	W	1200X900X600	120	
22	Y	450 X 200 X 200	10	

Table 2 – WOODEN BOX DETAILS

BOX TYPE	BOX SIZE (in MM)	BOX Wt (in KG)	Carrying Capacity
1	320X250X260	10	
2	320X250X430	15	
3	430X370X430	25	
4	670X670X470	65	
5	720X630X600	75	
6	1000X770X660	100	
7	1100X430X670	80	
8	1200X1200X900	80	
9	1300X770X1050	155	
10	2500X850X800	225	
11	2000X1500X1200	305	
12	1850X1050X1250	260	
13	2000X800X800	180	
14	2600X1500X1600	470	
15	250X250X600	20	
16	250X250X880	30	
17	300X300X700	25	
18	380X380X880	45	
19	510X510X1400	60	
20	570X570X1400	80	
21	575X575X1875	105	
22	3600X1100X1100	390	
23	900X500X800	110	
24	2000X950X740	225	
25	1600X1120X700	220	
26	2500X2000X1200	490	
27	2900X1900X1400	525	
28	3000X1000X900	370	
29	3200X2200X950	450	
30	2150X1100X750	325	
31	2000X2000X700	130	
32	700X1200X1325	130	

CORPORATE STANDARD**Table 3 – STEEL BOXES**

SL NO	TYPE	DIMENSION IN MM			WEIGHT	CARRYING CAPACITY (KGS)
		LENGTH	BREADTH	HEIGHT		
1	I	2480	1680	1500	339	4500
2	II	1200	900	600	061	2000
3	IIB	1800	850	950	115	2500
4	III	900	600	600	029	1000
5	IV	600	450	500	019	750
6	V	400	350	300	011	500

TYPICAL PATTERN OF WOODEN BOX**Figure 1**

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 9 of 24

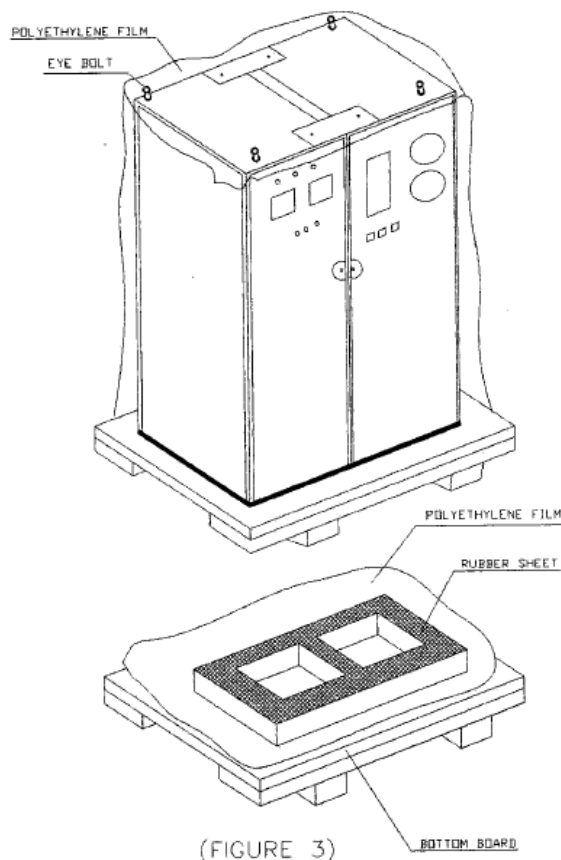


Figure 2

9.2 STEEL CONTAINERS:

Steel containers for packing can be used in case of repeated supplies of the same equipment. Empty steel containers are to be returned back from customer's end and to be reused for the next supplies. The containers are to be made of structural steel as per AA10108 with proper reinforcement with I, C and T Sections. Depends on the availability of resources & requirements units may be allowed to use standard cargo containers also instead of fabricated steel boxes.

- a) Following precautions are to be taken during packing: -
- b) Put the machine in the steel container properly,
- c) Cover the machine with polythene.
- d) To arrest the movement in the steel container necessary wooden Blocks/Battons may be put.
- e) Put cover on steel, container and Bolt Properly


9.3 SEALED PACKING:

Components sub-assemblies and assemblies sensitive to climatic conditions shall be packed seal tight. All the openings of the sensitive components, sub-assemblies and assemblies shall be blanketed to prevent the ingress of dust and moisture. The components sub-assemblies and assemblies are completely covered with 2 layers of polyethylene sheet. All sharp corners and edges are to be protected by rubber mats to prevent the polyethylene sheet from damage. Top surface of the case shall be free from dents to prevent rain water pockets.

10 MARKINGS/STENCILINGS

MARKINGS ON PACKING CASES

1. THIS PLANT STANDARD PRESCRIBES THE VARIOUS CAUTION SIGNS AND OTHER MARKINGS ON PACKING CASES.
2. DIMENSIONS IN THE TABLE 1 SHALL BE USED FOR MAKING STENCILS ONLY.

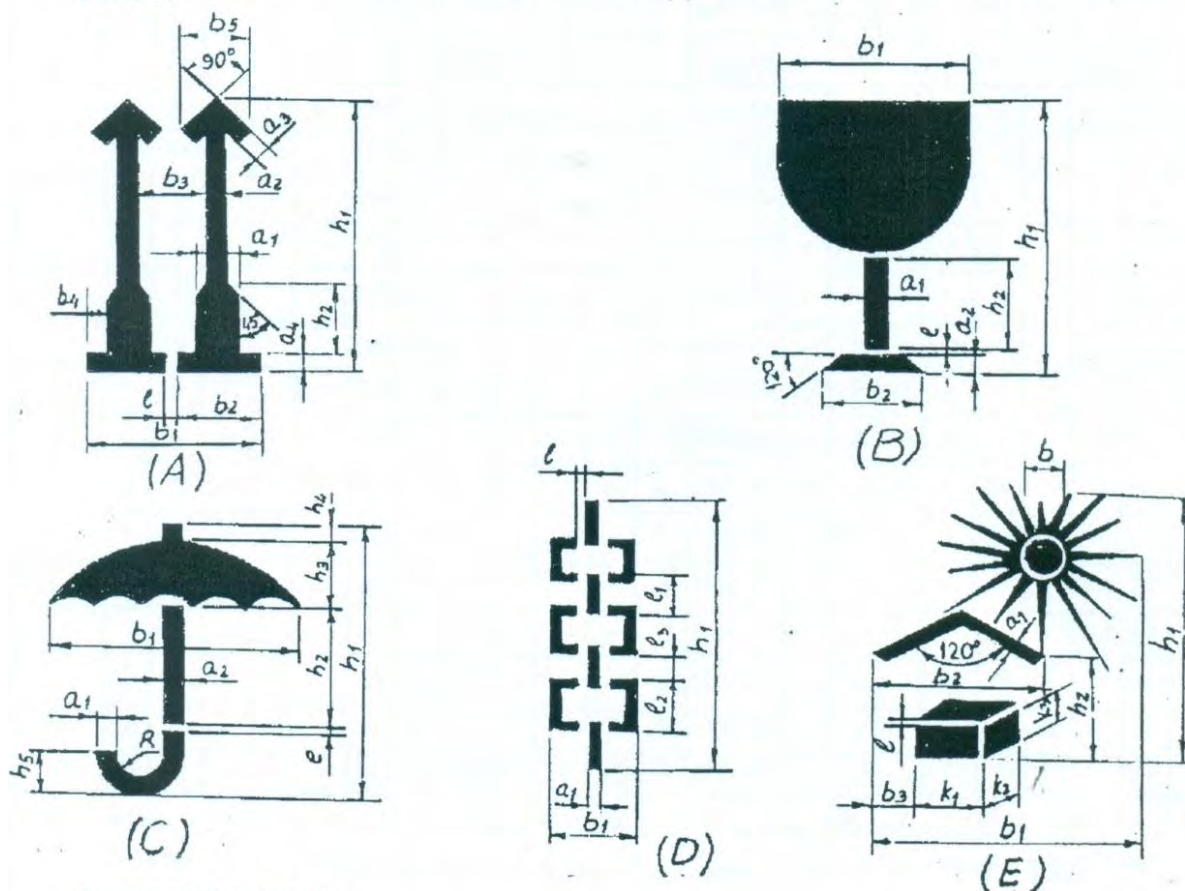

- A. UPRIGHT
- B. FRAGILE
- C. PROTECTION FROM FALLING OR CONDENSING MOISTURE.
- D. SLINGING POSITION
- E. PROTECTION FROM DIRECT RADIATIONS.




Figure 3

	CORPORATE STANDARD																			AA0490010				
																				Rev. No. 02				
																				PAGE 11 of 24				

DESIGN- ATION		DIMENSION IN MM																						
		a1	a2	a3	a4	b1	b2	b3	b4	b5	b	l	h1	h2	h3	h4	h5	k1	k2	k3	l1	l2	l3	R
A	1	12	5	5	4	52	25	19	8	21		2	84	23										
	2	17	7	7	6	75	36	29	11	30		3	119	33										
	3	24	10	10	8	104	50	38	16	42		4	168	46										
	4	34	14	14	11	147	71	59	23	60		5	239	65										
B	1	5	5			50	33					2	84	25										
	2	7	7			71	47					3	119	36										
	3	10	10			100	66					4	168	50										
	4	14	14			142	94					5	239	71										
C	1	4	3			66						2	80	39	19	5	11							6
	2	6	4			85						3	114	55	27	7	16							9
	3	8	6			120						4	160	78	38	10	22							12
	4	11	9			170						5	227	110	54	14	31							17
D	1	6				30						4	148								30	30	10	
	2	9				42						5	209								42	42	14	
E	1	3				69	47	10			16	2	91	26				17	8	11				
	2	4				98	67	15			23	3	128	33				24	11	16				
	3	6				138	94	20			32	4	182	62				34	16	22				

Table 4

Black and Red Marking Ink to IS:1234 "Ink, Stencil, Oil Base, For Marking Porous Surfaces" or duplicating ink stencilling, oil base for marking porous surfaces.

All cases containing fragile items are to be stencilled with red marking and stencilling paint/ink

"HANDLE WITH CARE", "FRAGILE DO NOT TURN OVER".

Besides the caution signs the product information's shall be stencilled of letters with 13mm to 50mm height.

In case of consignment consists of more than one package, each package shall carry its package no as given in shipping list. All caution signs shall be stencilled in high quality full glossy out door finishing paint red in colour (AA56126). All other markings shall be carried out in black enamel(AA56126).

Caution signs & other markings shall be stencilled on both the end shooks & the side shooks.

Caution sign (for slinging) shall be stencilled only on side shooks at the appropriate place.

Note: Incase the size of package is small for using the stencils, then hand written letters/figures shall be allowed.

AA0490010	CORPORATE STANDARD	
Rev. No. 02		
PAGE 12 of 24		

	BHEL – <unit> - <location> - <pin>				
CONSIGNEE					
MATERIAL					
CUSTOMER REF.				MO. NO.	
DESPATCH ADVICE NOTE NO				CASE NO	
DIMENSIONS(MM) L x B x H				NET WT –KGS	GROSS WT –KGS
SPECIAL INSTRUCTIONS	HANDLE WITH CARE - KEEP DRY DO NOT DROP - DO NOT TILT				

Figure 4 – TYPICAL MARKING PLATE (225 X 170)

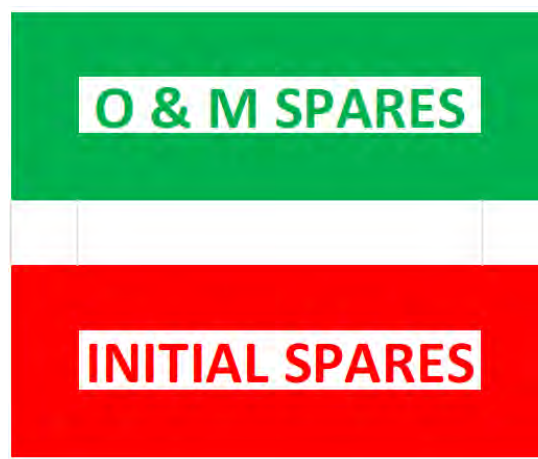


Figure 5

Easy spares [Initial and O&M] Traceability and Identification at units and as well as at sites:

11 RECYCLING OF INCOMING WOODEN PACKING CASES

OBJECTIVES

- To utilize useable wood of incoming packing cases, for manufacturing of new packing boxes.
- To recycle incoming wooden packing cases, as such, wherever possible.

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 13 of 24

- 1) All incoming wooden packing cases received from suppliers /customers will be opened carefully, with the intention of reusing them, by Shop.
- 2) After carefully taking out the contents, the empty wooden packing cases will be shifted by Shop to the specified locations i.e. bin / nearly spaces, already earmarked in stores.
- 3) Material shifting contractor engaged by store, will collect all such wooden packing cases and scrap wood from specified points, on a regular basis.
- 4) After collecting / loading the empty packing cases/ scrap wood, contractor will take the carrier first to Weighment Bridge for weighment, thereafter; he will go to Carpentry, where Carpentry representative will identify the packing cases which can be used by Carpentry for manufacturing of New Packing Boxes. All such identified packing boxes will be unloaded and handed over to Carpentry by contractor.
- 5) These packing boxes will be made re-useable after necessary rectification and additional work.
- 6) Contractor will again take the carrier for weighment and this second reading will also be recorded on the same "Weighment Slip".
- 7) Weight of empty packing cases / scrap wood taken will be calculated on the basis of 1st and 2nd weighment readings recorded on the "Weighment Slip". A copy of "Weighment Slip" (where both the weighment readings are recorded) will be given by the contractor to the carpentry representative. Based on this "Weighment Slip", carpentry will maintain a register in which details of quantity received will be recorded.
- 8) All "Weighment Slips" will invariably be signed by carpentry representative (even when no boxes have been unloaded by carpentry). Store will accept the scrap wood only if "Weighment Slips" are signed by carpentry representative.
- 9) Balance empty packing cases / scrap wood will be handed over by contractor to Store, for storing in scrap yard.
- 10) A separate area in Scrap yard will be provided, for executing the work of denailing of wooden packing cases, under supervision of carpentry.
- 11) Carpentry contractor will identify packing cases / scrap wood for denailing, which will be handed over to him by Store, at Scrap yard, for denailing and further operation.
- 12) Quality and Carpentry will jointly inspect the wood generated by de-nailing process and will prepare "INSPECTION CUM RECEIPT REPORT OF USEABLE WOOD RECEIVED FROM TPS – STORE BY CARPENTRY".
- 13) After acceptance of the wood by Quality and Carpentry, the same will be shifted to carpentry for receipt and its record will be maintained by carpentry.
- 14) This will be a Permanent Productivity Project executed by carpentry. "Productivity Savings" duly verified at the current Purchase Order rate of wood, will be sent every month to Resource Management Department, for highlighting it in their monthly progress report.

12 STANDARD METHOD OF PACKING

Table 5 - Standard Method of Packing

DESCRIPTION	CASE	CRATE	SKID	BUNDLE	BARE	DRUM	METAL DRUM	FIBRE DRUM
PRESSURE VESSELS								
TOWERS					O			
TANKS					O			
VESSELS					O			
GASKETS	O							
FASTENERS	O							
COVERS		O						
EXCHANGERS								

247927/2021/PS-PEM-MAX

AA0490010	CORPORATE STANDARD							
Rev. No. 02								
PAGE 14 of 24								
DESCRIPTION	CASE	CRATE	SKID	BUNDLE	BARE	DRUM	METAL DRUM	FIBRE DRUM
HEAT EXCHANGERS					O			
TUBE BUNDLE	O							
SHELL					O			
AIR FIN COOLERS					O			
COLOUMNS, MOTOR SUSPENSIONS, PLENUM CHAMBERS, SCREEN GUARDS, ETC					O			
BEARING BLOCKS	O							
FANS	O	O						
MOTORS	O							
GASKETS	O							
FASTENERS	O							
TEST FLANGES			O					
TEST RINGS			O					
COVERS			O					
CRYOGENIC VESSELS								
COLD CONVERTERS					O			
HORIZONTAL STORAGE TANKS					O			
TRANSPORTATION TANK					O			
COLD BOX					O			
DRYING UNIT					O			
DRYING BOTTLES					O			
MOISTURE SEPARATORS					O			
SILENCERS					O			
ONGC SKIDS					O			
VAPORISER		O						
SPECIAL PRODUCTS								
SI/VI PIPING		O						
CRO BIO CONTAINERS	O							
AIR BOTTLES	O							
TITANIUM BOTTLE	O							
WAR HEAD CONTAINER	O							
MISSILE CONTAINER	O							
FUEL CONTAINER	O							
AIR LOCK ASSEMBLY	O							
BOILER DRUMS					O			
BOILER ITEMS								
COILS			O					
PANELS					O			
HEADERS			O		O			
FEEDERS								
MACHINED ITEMS								
SHELL SEGMENTS					O			

247927/2021/PS-PEM-MAX

120211E3-FLM-MAX

बी एच ई एम

BHEL

CORPORATE STANDARD

AA0490010

Rev. No. 02

PAGE 15 of 24

DESCRIPTION	CASE	CRATE	SKID	BUNDLE	BARE	DRUM	METAL DRUM	FIBRE DRUM
SHELL SEGMENTS IN STACKS					O			
SPHERE PETALS								
COLOUMNS, BASE PLATES, TIERCOS, PIPES, NOZZLE E1, F1, INTERNAL PIPES, PADS ETC.					O			
ROLLERS	O							
VALVE TRAYS								
VALVE TRAY COMPONENTS	O							
LATTICE GIRDERS		O						
FASTENERS	O							
GASKETS	O							
SUB CONTRACTS								
FAB STRUCTURALS					O			
SUPPORTING STRUCTURALS					O			
STRUCTURE SUB ASSEMBLY					O			
FAB PIPES					O			
GRATINGS					O			
STAIR CASES					O			
HANDRAILS/ PLATFORMS					O			
BOUGHT OUT COMPONENTS								
IRON & STEEL (LIKE PLATES, BEAMS, ANGLES, CHANNELS ETC.)					O			
PIPE FITTINGS								
CS PIPES, TUBES					O			
SS PIPES, TUBES					O			
FIN TUBES	O							
ELBOWS		O			O			
FLANGES	O	O						
VALVES	O							
GAUGES	O							
DEMISTERS		O						
ABSCRBANTS (LIKE MOLECULAR SIEVES, ACTIVATED ALUMINA, MOBILE SORBID)						O		
PAINT TINS		O						
PAINT DRUMS						O		
IGNITORS	O							
SPRAY NOZZLES	O							
ELECTRICAL INSTRUMENTATION								
MOTORS, PUMPS, COMPRESSORS, TURBINES	O							
SWITCH BOARDS, DISTRIBUTION BOARDS, STARTERS, JUNCTION BOXES		O						
INDICATORS, VIBRATOR SWITCHES	O							

AA0490010	CORPORATE STANDARD	
Rev. No. 02		
PAGE 16 of 24		

DESCRIPTION	CASE	CRATE	SKID	BUNDLE	BARE	DRUM	METAL DRUM	FIBRE DRUM
CABLE BUNDLES, CABLE DRUMS					O			
CABLE TRAYS, CABLE RACKS, EARTHING MATERIAL		O						
OPERATIONAL SPARES	O							

13 PROCEDURE FOR HANDLING OF COMPONENTS

The purpose of this procedure is to protect the quality of the components/equipment while handling in various stages of manufacturing packing & despatching.

- 13.1** Adequate care shall be taken in handling the material, and components to avoid damage during receipts, storage issue manufacture & despatch operations.
- 13.2** Appropriate material handling equipment like fork lifters, cranes etc. shall be used where needed.
- 13.3** Lifting by crane and transportation by trolley of critical items and large components like rotors castings etc. shall be done carefully.
- 13.4** For critical items, where specified, special handling fixtures shall be used for lifting.
- 13.5** Slings and shackles used for lifting the components/equipment shall be checked for fitness and suitability before use.
- 13.6** Slings used on machined surfaces shall be suitably padded. No slings shall be used on journal surfaces.
- 13.7** Precision machined components like blades, catches, rollers etc. shall be lifted using suitable wooden pallets.

13.8 HANDLING OF COMPONENTS ON RECEIPT/DESPATCH

Before loading/unloading a packing case from the carrier look for the following shipping instructions painted on the packing case.

- a) The markings showing the upright position.
- b) The markings showing the sling position
- c) Markings showing the fragile contents.
- d) Other required markings as per clause no.10

- 13.8.1** Appropriate cranes and slings should be used for different components/ cases. Slings should normally make an angle as minimum as possible (width wise) but in no case more than 15°.
- 13.8.2** Handling and lifting should be done without jerks or impacts.
- 13.8.3** Immediately after receipt of the goods, the packing should be examined all-round for any sign of damage. If necessary, lift the cover or a number of boards of the case so as to make the contents visible. In the event of sealed packing being used the plastic sheeting should not be damaged. It is imperative that the packing material is restored in original condition after the inspection.
- 13.8.4** On receipt of the equipment it should be checked with the shipping list and missing or damage if any should be reported immediately. It is important to arrange for immediate examination to determine the extent of the damage, the cause of the damage and where applicable the person or persons responsible for the damage. According to general practice when transporting by railway or by road vehicle the carrier concerned should be immediately called upon (within specified periods) for jointly establishing a statement of the damage. This is essential as a basis for a subsequent claim and possible damage report to the insurance company.
- 13.8.5** Protective coating applied on machined surfaces should not be disturbed. The plastic covering should be put back carefully so that it prevents ingress of dust and moisture. Some packing may have vapour phase inhibitor (VPI) paper enclosed inside the packing cases. This should be restored to its original place as far as possible.

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 17 of 24

13.8.6 Silica gel and such other chemicals kept in the box as desiccants and indicators should also be left in the box itself.

14 GENERAL GUIDELINES FOR ODC TRANSPORTATION/DESPATCH

Based on the Dimensions/Weight indicated in the Transportation Sketch, the type of Trailer is decided and indicated in the Tender Enquiry.

14.1 TRANSPORTATION:

1. LOW BED TRAILERS (LB 8):

Well Bed Length	: 10000mm
Over Gooseneck	: 13000mm
Width	: 3000mm
Carrying Capacity	: 40MT

2. LOW BED TRAILERS (LB 16):

Well Bed Length	: 12000mm
Over Gooseneck	: 16000mm
Width	: 3000mm
Carrying Capacity	: 75MT

3. TOW TYPE TRAILERS (WITH FRONT DOLLEY 16 TYRES): 12000MM length (for Exceptional equipment length: 30000mm and above)

Bigger Dia equipment are loaded in the Well with overhanging.

Smaller Dia equipment with excess length are loaded over Gooseneck with rear hanging.
The Vehicle Dimensions are defined above are only guidelines for selection based on actual Dimensions/ Weight of the Consignment

14.2 PACKING:

For all ODCs, Wooden Saddles are cut to the diameter of equipment as per the Transportation Sketch.

Wooden Saddles	For Diameter up to 4000mm	For Diameter above 4000mm
Length:	1836/2743mm (6'0"/9'0")	3353mm (11'0")
Width:	300mm (1'0")	300mm (1'0")
Height:	Saddle + one/two wedges a top	Saddle + three/four wedges a top

Number of Saddles:	
Minimum	3 in case of Loading inside Well +1 when loaded on Gooseneck
Maximum:	4 in case of Loading inside Well +2 when loaded on Gooseneck

For Securing the equipment firmly on the Trailer, 19mm (3/4"), wire rope with 25mm (1") Heavy Duty Turn Buckles / BD Clamps are used as Lashing for the equipment.

14.3 NUMBER OF LASHINGS:

AA0490010

Rev. No. 02

PAGE 18 of 24

CORPORATE STANDARD

	CONSIGNMENT LOADED INSIDE WELL BED	CONSIGNMENT LOADED OVER GOOSENECK
a) up to 40MT	4 (2 Single Line lashing 2 Double Line Lashing)	5 (3 Single Line Lashing 2 Double Line Lashing)
b) 40MT to 60MT	5 (3 Single Line Lashing 2 Double Line Lashing)	5 (Single Line Lashing 3 Double Line Lashing)
c) 60MT and above	5 (2 Single Line Lashing 3 Double Line Lashing)	6 (3 Single Line Lashing 3 Double Line Lashing)

15 GUIDELINES FOR HANDLING/LOADING/LASHING**15.1 HANDLING****Figure 6**

Before unloading the jobs Completely painted and neatly stencilled will be checked.

Pipes with split type end cover will be checked



CORPORATE STANDARD

AA0490010

Rev. No. 02

PAGE 19 of 24



Figure 7

All Coil Tubes to be provided with End Caps.



Figure 8

Neatly stacked Coil Assemblies.

CORPORATE STANDARD**Figure 9**

Columns to be lifted with Nylon belts. This protect painting, edges and attachments.

**Figure 10****15.2 LOADING**

All the components to be transported by putting inside the properly fabricated Crating

	CORPORATE STANDARD	AA0490010
		Rev. No. 02
		PAGE 21 of 24



Figure 11

Small components may fall down while transporting without closed crating and there are chances of missing of small parts. Hence, it is always better to transport small components in closed containers/crating. Loose to be being shipped in a closed crating.



Figure 12

AA0490010

Rev. No. 02

PAGE 22 of 24

CORPORATE STANDARD

No component loaded over the crating.

**Figure 13**

Headers supported with wooden V blocks at 3 meters interval.

**Figure 14**

Spacers in between each coil assembly.



CORPORATE STANDARD

AA0490010

Rev. No. 02

PAGE 23 of 24



Figure 15

Goose pipe to be provided with rubber pad protects removal of painting and damage to the job.



Figure 16

15.3 LASHING

Use Nylon belts only for lashing of all components. It prevents removal off painting and cut in the materials.

CORPORATE STANDARD**Figure 17**

Nylon Belts used for lashing the beams.

**Figure 18****16 PRODUCT WISE SPECIAL INSTRUCTION**

Additional instructions of packing not included in this standard shall be covered by individual product standard.

17 REFERRED STANDARDS (Latest publications including amendments):

1) AA51420	2) AA55619	3) AA51414	4) IS:3401	5) AA10108
6) AA56126	7) AA51402	8) AA51401	9) IS:1234	

	CORPORATE STANDARD	AA0490006
		Rev. No. 01
		PAGE 1 of 3

VACUUM PACKING FOR ELECTRONIC COMPONENTS

1 GENERAL

This standard lays down the packing instructions for packing of components / Electronic module / Assemblies to be dispatched against Customer contracts.

2 SCOPE

This procedure covers method of packing electronic components using vacuum packing in a wooden packing boxes.

3 OBJECTIVE

To establish a rust proof safe packing procedure and where the components required to protect against temperature and humidity. In general minimum temperature +5 deg C and maximum temperature 45 deg C, and relative humidity between 10% to 40%.

4 PACKING BOX

Wooden Box shall be made as per BHEL Standard AA0490010 for Domestic/ AA0490009 for Export/ AA0490004 for Seaworthy packing. Size of the box as per the contract requirement which has to be checked by QC.

5 PACKING PROCEDURE

- a) Cleaning parts shall be thoroughly cleaned just before VCI (Volatile Corrosion Inhibitor) Vacuum packing. Finger prints on cleaned items are to be avoided as the same are very corrosive.
- b) VCI Rust preventive oil (Ferrous grade oil base) shall be applied to all the components to withstand any corrosion.

6 VCI VACUUM PACKING

- a) Bubble wrapping the items VCI vacuum packing.
- b) Appropriate vapour corrosive packets one pouch (1 gm. /pouch) of VCI Anticorrosive Powder and one pouch (10gm./ pouch) of VCI Desiccant per 1000 cub. meter packing space shall be placed inside the VCI vacuum packing.
- c) All the components shall be separately packed using VCI laminated Aluminium foils from which air/moisture are removed by the air vacuum device and sealed thoroughly using heat sealing machine. At the time of the evacuation the vacuum inside the pack should be less than 0.5 ata.
- d) One identification slip containing component information such as description of item, Material No. Customer PO, Item No. Quantity etc. shall be put inside the VCI vacuum packing.
- e) Top cover of the wooden box shall be sealed only after final clearance from QC for confirmation of above.
- f) All boxes should be covered by water proof tarpaulin over top and on all sides.
- g) The packing boxes shall be covered with GI sheets (0.25 -0.4mm thick) on all the sides for Export / Seaworthy packing.
- h) Vacuum packing room temperature and Relative Humidity should be maintained as mentioned below:

Min. +5 deg. C and Max. 45 deg. C, Relative humidity between 10% to 40%.

Revisions:			APPROVED: PROCEDURAL GUIDELINES COMMITTEE – PGC (Packing)		
Rev. No. 01	Amd. No.	Reaffirmed	Prepared EDN, Bangalore	Issued Corp. R&D	Dt. of 1 st Issue 31-05-2018
Dt: 12-06-2018	Dt:	Year:			

AA0490006

Rev. No. 01

PAGE 2 of 3

CORPORATE STANDARD**7 COMPONENTS REQUIRED****7.1 VCI laminated Aluminium foil**

Volatile Corrosion Inhibitor (VCI) safe foil shall be with aluminium barrier laminated which is flexible, heat sealable, water vapour and anticorrosion resistant barrier laminate of polyester, Aluminium foil and VCI Polyethylene. It is used as a primary packaging material for packing metal components and sealed with the help of a heat sealer after vacuuming with vacuum machine maintaining the humidity level below 40 RH inside the package.

7.2 Composition construction of VCI laminated Aluminium foil

- a) PET Film : 12 Microns
- b) Bonding layer : 2 Microns
- c) Aluminium Foil : 9 Microns
- d) Bonding layer : 2 Microns
- e) VCI Poly film : 100 Microns
- f) Total thickness : 125 Microns + or – 5%

7.3 Properties of VC Laminated Aluminium foil

- a) Basic Weight : 138 gsm +/- 8%
- b) Sealing condition : 180 C/ 2 sec
- c) Tensile strength
MD: 20 kgf
CD: 18 kgf
- d) Tear Strength
MD 4.8 kg
CD:3.4 kg
- e) Heat Seal Strength : 30.380 N/cm
- f) WVTR Value : 0.05gms/m /24 hrs.
- g) OTR Value : 0.1 cc/m/24 hrs

8 MARKING OF PACKING BOX

Mark the following information on the two adjacent sides of the each package


- a) Material No.
- b) Customer PO
- c) Item No.
- d) Quantity
- e) Storage Requirement : Indoor
- f) Content Description : Electronic Module
- g) Net weight (in kg)
- h) Dimension (L x W x H in centimetres)
- i) Project Name
- j) Consignee
- k) Water proofing (Umbrella Stencilling)
- l) Upside direction

**CORPORATE STANDARD**

AA0490006

Rev. No. 01

PAGE 3 of 3

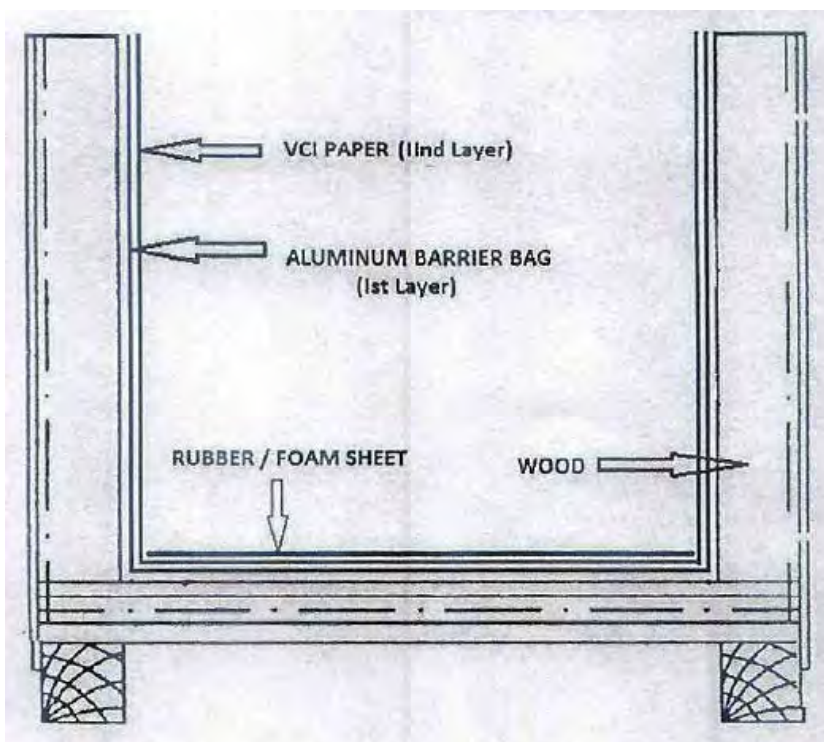**Figure 1**

	CORPORATE STANDARD	AA0490008
		Rev. No. 01
		PAGE 1 of 4

VACUUM PACKING FOR ELECTRICAL COMPONENT

1 GENERAL

This standard lays down the packing instructions for packing of components / Electrical components Stator/ Rim punching, Wound Pole/ Field Coils and Stator coils / bars to be dispatched against Customer contracts.

2 SCOPE

This procedure covers method of packing component in a wooden packing boxes.

3 OBJECTIVE

To establish a rust proof safe packing procedure and where the components required to protect against temperature and humidity. In general minimum temperature +5 deg C and maximum temperature 45 deg C, and relative humidity between 10% to 40%.

4 PACKING BOX

Wooden Box shall be made as per BHEL Standard AA0490010 for Domestic/AA0490009 for Export/AA0490004 for Seaworthy packing. Size of the box as per the contract requirement, which has to be checked by QC.

5 PACKING PROCEDURE

- All items packed are to be marked by QC with "OK" stickers. Varnished stator punchings are to be brought down to room temperature before labelling them "OK" for packing. Do not pack hot/warm stator punchings that have is just received from the varnishing.
- Packing of stator punchings, wound pole/ field coils and stator coils / bars should be done in a covered shed.
- Packed materials are to be stacked in proper alignment and to be kept in wooden packing.

6 Additional Packing Methodology for Stator / Rim Punchings (Double stacking) only

In order to eliminate the use of studs avoid double stack packaging per box. Where double stacked packing boxes are unavoidable, the stator /rim punchings are to be securely tightened using GI studs, nuts and soft material washers (rubber/plastic). GI studs, nuts and soft material only to be used in case of double stacking of rim / stator punchings (with holes). Use soft rubber washers to seal the punctured opening at the bottom from where the studs pass in each layer of VCI (Volatile Corrosion Inhibitor) paper, polythene and tarpaulin sheet in case of rim /stator punchings (with holes).

- GI studs with rubber washer to be placed initially inside the wooden packing box.
- Over the wooden base, place water proof tarpaulin sheet.
- Rubber washer shall be placed after the layer of tarpaulin sheet.
- Then place a layer of porous plastic sheet with total thickness of at least 5mm (for cushioning and reduces the chances of damage to punchings).
- Place the Aluminium Barrier laminated Bags over this porous sheet, place the rubber washer over it.
- Place VCI papers on the Aluminium barrier bag and fix with rubber washer.

Revisions:			APPROVED: PROCEDURAL GUIDELINES COMMITTEE – PGC (Packing)		
Rev. No. 01	Amd. No.	Reaffirmed	Prepared EDN, Bangalore	Issued Corp. R&D	Dt. of 1 st Issue 31-05-2018
Dt: 12-06-2018	Dt:	Year:			

AA0490008

Rev. No. 01

PAGE 2 of 4

CORPORATE STANDARD

- g) PVC Pipes shall be inserted over the GI studs. These pipes are to be used to cover each stud, to protect its direct contact and hence rubbing with punchings.
- h) Now place the stack of punchings over the VCI paper and securely tighten the punchings using nuts and soft material, washers.
- i) Each layer should be secured in position. Wrap the punchings with VCI paper and properly sealed separately using an adhesive tape.
- j) Silica Gel packets are to be placed over the VCI paper and uniformly distributed inside the boxes on the VCI paper to remove/prevent moisture.
- k) Aluminium barrier laminated bag has secured in position and properly sealed by using heat sealing machine and air to be drained out by using vacuum pump. At the time of the evacuation the vacuum inside the pack should be less than 0.5ata.

Use two separate VCI papers for doubled stacked boxes independently covering each stack. Similarly two Aluminium barrier laminated bag are to be used to wrap the two stacks independently, as explained above.

7 Additional Packing Methodology for Wound Pole/ Field Coils and Stator Coils/Bars only

- a) Over the wooden base, place the waterproof tarpaulin sheet.
- b) Then place a layer of porous plastic sheet with total thickness of at least 5mm (for cushioning and reduces the chances of damage to Wound pole/field coils and stator coils/ bars.
- c) Place the Aluminium barrier laminated bag over this porous sheet.
- d) Place the VCI paper (Volatile Corrosion Inhibitor as per BHEL Standard AA51406) on the Aluminium barrier laminated bag along with rubber washer.
- e) Bare copper portion of field coils and stator coils / bars to be covered by VCI paper pouch and fasten with VCI tape.
- f) Now place the wound pole, stack of field coil and stator coil / bars over the VCI paper.
- g) Each layer should be secured in position. Wrap wound pole / field coils and stator coils / bars with VCI paper and properly sealed separately using an adhesive tape.
- h) Silica Gel packets are to be placed and uniformly distributed inside the boxes on the VCI paper to remove/prevent moisture.
- i) Then Aluminium barrier laminated bag has secured in position and properly sealed by using heat sealing machine and air to be drained out by using vacuum pump. At the time of evacuation the vacuum inside the pack should be less than 0.5ata.
- j) The VCI paper must contact the stator / rim punchings, wound pole / field coils and stator coils/bars. It has to ensure that the VCI paper, Aluminium barrier bag should not get damage / puncture during the packing process.
- k) Top cover of the wooden box shall be sealed only after final clearance from QC for confirmation of above.
- l) All boxes should be covered by water proof tarpaulin over top and on all sides.
- m) The packing boxes shall be covered with GI sheets (0.25 -0.4mm thick) on all the sides for Export / Seaworthy packing.
- n) Vacuum packing room temperature and Relative Humidity should be maintained as mentioned below:
Min. +5 deg. C and Max. 45 deg. C, Relative humidity between 10% to 40%.

	CORPORATE STANDARD	AA0490008
		Rev. No. 01
		PAGE 3 of 4

8 COMPONENT REQUIRED

8.1 VCI laminated Aluminium foil

Volatile Corrosion Inhibitor (VCI) safe foil shall be with aluminium barrier laminated which is flexible, heat sealable, water vapour and anticorrosion resistant barrier laminate of polyester, Aluminium foil & VCI Polyethylene. It is used as a primary packaging material for packing metal components and sealed with the help of a heat sealer after vacuuming with vacuum machine maintaining the humidity level below 40 RH inside the package.

8.2 Composition construction of VCI laminated Aluminium foil

- a) PET Film : 12 Microns
- b) Bonding layer : 2 Microns
- c) Aluminium Foil : 9 Microns
- d) Bonding layer : 2 Microns
- e) VCI Poly film : 100 Microns
- f) Total thickness : 125 Microns + or – 5%


8.3 Properties of Aluminium Barrier laminated Bag

- a) Basic Weight : Unit: g/sq. m 150 +/- 5
- b) Tensile strength : Unit: N/sq. mm MD: 40 (min.)
Unit: N/sq. mm TD: 41 (min.)
- c) Water Vapour Transmission : Unit: g/m² 0.01 in 24 hrs. at 38 deg C & 90% RH(max)
- d) Oxygen Transmission : Unit: cm³/m² 0.02 in 24 hrs. at 38 deg C & 90% RH (max)
- e) Sealing Temp. : Unit : Degree C 180-220 deg C

9 MARKING ON PACKING BOX

Mark the following information on the two adjacent sides of the each package.

- a) Box No.
- b) Customer PO
- c) Product Name.
- d) Project Name
- e) Quantity
- f) Storage Requirement : Indoor
- g) Net weight (in kg)
- h) Dimension (L x W x H in centimetres)
- i) Consignee
- j) Water proofing (Umbrella Stencilling)
- k) Upside direction
- l) Sling position indicator

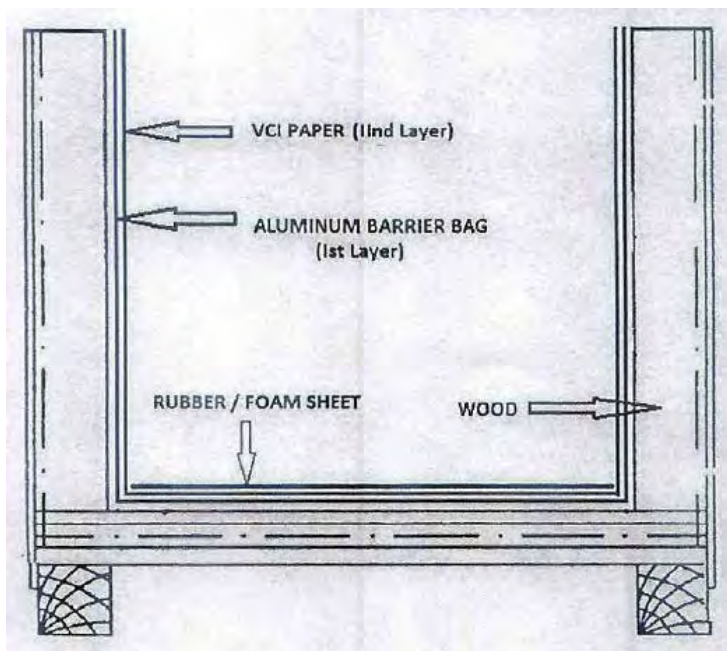CORPORATE STANDARD**Figure 1****Figure 2****Figure 3****Figure 4****Figure 5**

247927/2021/PS-PEM-MAX

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM	SPECIFICATION No: PE-TS-481-555-A001	
		VOLUME : II B	
		SECTION : E / ANNEXURE-VI	
		REV 00	DATE: Nov. 20
		SHEET: 1 OF 2	

ANNEXURE-VI

LIST OF OPERATIONAL SPARES

	KAHALGAON TPS – FGD COMPRESSED AIR SYSTEM		SPECIFICATION No: PE-TS-481-555-A001	
			VOLUME : II B	
			SECTION : E / ANNEXURE-VI	
			REV 00	DATE: Nov. 20
			SHEET: 2 OF 2	

LIST OF OPERATIONAL SPARES

Sl.no	Description	Qty. (Each compressor)			Unit	Qty. for 2 nos. Compress ors
		Initial fill (at vendor works)	Intervening Period	During PG Test		
1	Lube oil	Included	NA	1	Lot / Compressor	2
2	Lube oil filters with seals	Included	1	1	Sets / Compressor	4
3	Air filters with gaskets (as applicable)	Included	1	1	Sets / Compressor / Dryer	4
4	Service kit including seals, washers and rings for intercooler (as applicable)	NA	NA	1	Sets / Compressor / Dryer	2
5	Service kit including seals, washers and rings for after cooler (as applicable)	NA	NA	1	Sets / Compressor / Dryer	2

4 X 210 MW + 3 X 500 MW KAHALGAON TPS – FGD

TECHNICAL SPECIFICATION

FOR

COMPRESSED AIR SYSTEM

VOLUME-III

(TECHNICAL SCHEDULES)



BHARAT HEAVY ELECTRICALS LTD
POWER SECTOR PROJECT ENGINEERING MANAGEMENT
PPEI, NOIDA-INDIA

247927/2021/PS-PFM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : III

SECTION : 1

REV: 00

DATE: Nov. 20

SHEET 1 OF 1

VOLUME: III
SECTION: 1

LIST OF DOCUMENTS TO BE SUBMITTED
WITH BID

247927/2021/PS-PEM-MAX

**KAHALGAON TPS – FGD****COMPRESSED AIR SYSTEM**

SPEC. NO.: PE-TS-481-555-A001

VOLUME: III

SECTION: 1

REV. NO. 0 DATE: Nov. 20

SHEET 1 OF 1

**CHECK LIST FOR LIST OF DOCUMENTS TO BE SUBMITTED BY BIDDER ALONG WITH
THE BID**

SI No.	Item Description	Yes/No
1	Schedules to be submitted dully filled up with bidder's signature and stamp. 1) Technical Deviation Schedule, if any. 2) Filled, Signed & Stamped copy of Guaranteed Power Consumption for Compressed Air System. 3) Compliance cum Confirmation certificate.	
2	Resolution to pre-bid clarifications, if any, duly stamped and signed by the bidder enclosed with the bid	
3	Un-priced bid- clearly indicating 'QUOTED' and 'NOT-QUOTED' against each item.	
4	Signed & stamped copy of Electrical feeder list attached with specification.	
5	Supporting Documents meeting PQR requirements	

Name: _____

Signature: _____

Designation: _____

Company: _____

Date: _____

Bidder Stamp

247927/2021/PS-PEM-MAX



4 X 250 MW NABINAGAR FGD
COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-463-555-A001

VOLUME : III

SECTION : 2

REV: 00

DATE: Dec.,19

SHEET 1 OF 1

VOLUME-III
SECTION 2
COMPLIANCE CUM CONFIRMATION CERTIFICATE



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPEC. NO.: PE-TS-481-555-A001

VOLUME: III

SECTION: 2

REV. NO. 0 DATE: Nov. 20

SHEET 1 OF 2

COMPLIANCE CUM CONFIRMATION CERTIFICATE

The bidder shall confirm compliance with following by signing/ stamping this compliance certificate (every sheet) and furnish same with the offer.

- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions other than those mentioned under "exclusion" and those resolved as per 'Schedule of Deviations', if applicable, with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the 'Schedule of Deviations'. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the 'Schedule of Deviations'.
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL/ NTPC approval & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc. This shall be within the contracted price with no extra implications to BHEL after award of the contract.
- d) All drawings/ data-sheets/ calculations etc. submitted along with the offer shall be considered for reference only, same shall be subject to BHEL/ NTPC approval in the event of order.
- e) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified/ intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements then same shall be resolved by the bidder with BHEL during the pre - bid discussions, otherwise BHEL/ NTPC decision shall be binding on the bidder whenever the deficiency is pointed out.

For components where materials are not specified, same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- f) The commissioning spares shall be supplied on 'As Required Basis' & prices for same included in the base price itself.
- g) All sub vendors shall be subject to BHEL/ NTPC approval in the event of order.
- h) Guarantee for plant/equipment as applicable, shall be as per relevant clause of GCC /SCC /Other Commercial Terms & Conditions.
- i) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break up, approved drawing or approved Bill of quantities. This clause will apply in case during site commissioning additional requirements emerges due to NTPC comments. No extra claims shall be put on this account.
- j) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL / NTPC office for across the table resolution of issues and to get documents approved in the stipulated time.

247927/2021/PS-PEM-MAX

**KAHALGAON TPS – FGD****COMPRESSED AIR SYSTEM**

SPEC. NO.: PE-TS-481-555-A001

VOLUME: III

SECTION: 2

REV. NO. 0 DATE: Nov. 20

SHEET 2 OF 2

- k) As built drawings shall be submitted as and when required during the project execution.
- l) The bidder has not tempered with this compliance cum confirmation certificate and if at any stage any tempering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.

SIGNATURE: _____

NAME : _____

DESIGNATION: _____

COMPANY: _____

DATE: _____

COMPANY SEAL

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: III

SECTION : 3

REV. 00

DATE: Nov. 20

SHEET 1 OF 1

VOLUME: III
SECTION: 3
PRE-BID CLARIFICATION SCHEDULE

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM

VOLUME: III

PRE-BID CLARIFICATION SCHEDULE

S.No.	Section/Clause/ Page No.	Statement of the referred clause	Clarification required

The bidder hereby certifies that above mentioned are the only clarifications required on the technical specification for the subject package.

SIGNATURE : _____

NAME : _____

DESIGNATION : _____

COMPANY : _____

DATE : _____

COMPANY SEAL

247927/2021/PS-PEM-MAX



**KAHALGAON TPS – FGD
COMPRESSED AIR SYSTEM**

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : III

SECTION : 4

REV: 00

DATE: Nov. 20

SHEET 1 OF 1

**VOLUME-III
SECTION 4
ELECTRICAL LOAD DATA**

RANGE BOUND ELECTRICAL LOAD LIST FOR COMPRESSED AIR SYSTEM

LOAD TITLE	RATING (KW)		UNIT (U)/STN (S)	Nos.		VOLTAGE CODE*	FEEDER CODE**	EMER. LOAD (Y)	CONT.(C)/INTT.(I)	STARTING TIME >5 SEC (Y)	LOCATION	BOARD NO.	CABLE		BLOCK CABLE DRG. No.	CONTROL CODE	REMARKS	LOAD No.
	NAME PLATE (KW)	MAX. CONT. DEMAND (MCR)		RUNNING	STANDBY								SIZE CODE	NOs				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19
Common Compressor (Instrument Air & Service Air) Motor	160		S	1	1	D	U		C		Compressor House							
Common Compressor (Instrument Air & Service Air) Oil pump / cubicle fan (if applicable)	2 – 3.5		S	1	1	D	S		C		Compressor House							
Common Compressor (Instrument Air & Service Air) Control Panel	0.5-1.5		S	1	1	E	S		C		Compressor House						UPS grade supply by C&I	
Air Dryer Panel	0.12 - 0.5		S	1	1	E	S		C		Compressor House							
AUTO DRAIN TRAP	0.3		S	2	0	E	S		I		2 nos. feeder for air receivers outside compressor house.							

NOTES: 1. COLUMN 1 TO 12 & 18 SHALL BE FILLED BY THE REQUISITIONER (ORIGINATING AGENCY); REMAINING COLUMNS ARE TO BE FILLED UP BY PEM (ELECTRICAL)

2. ABBREVIATIONS : * VOLTAGE CODE (7):- (ac) A=11 KV, B=6.6 KV, C=3.3 KV, D=415 V, E=240 V (1 PH), F=110 V (cc): G=220 V, H=110 V, J=48 V, K=+24V, L=-24 V

: ** FEEDER CODE (8):- U=UNIDIRECTIONAL STARTER, B=BI-DIRECTIONAL STARTER, S=SUPPLY FEEDER, D=SUPPLY FEEDER (CONTACTOR CONTROLLED)

	LOAD DATA (ELECTRICAL)	JOB NO.	481	ORIGINATING AGENCY		PEM (ELECTRICAL)	
		PROJECT TITLE	KAHALGAON TPS – FGD	NAME	AMIT GARG	DATA FILLED UP ON	
		SYSTEM	COMPRESSED AIR SYSTEM	SIGN.	-sd-	DATA ENTERED ON	
		DEPTT. / SECTION	MAUX / PF	SHEET 1 OF 1	REV. 00	DE'S SIGN. & DATE	

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION No: PE-TS-481-555-A001

VOLUME: III

SECTION: 5


REV. 00

DATE: Nov. 21

SHEET 1 OF 1


SECTION: 5

LIST OF DRAWINGS

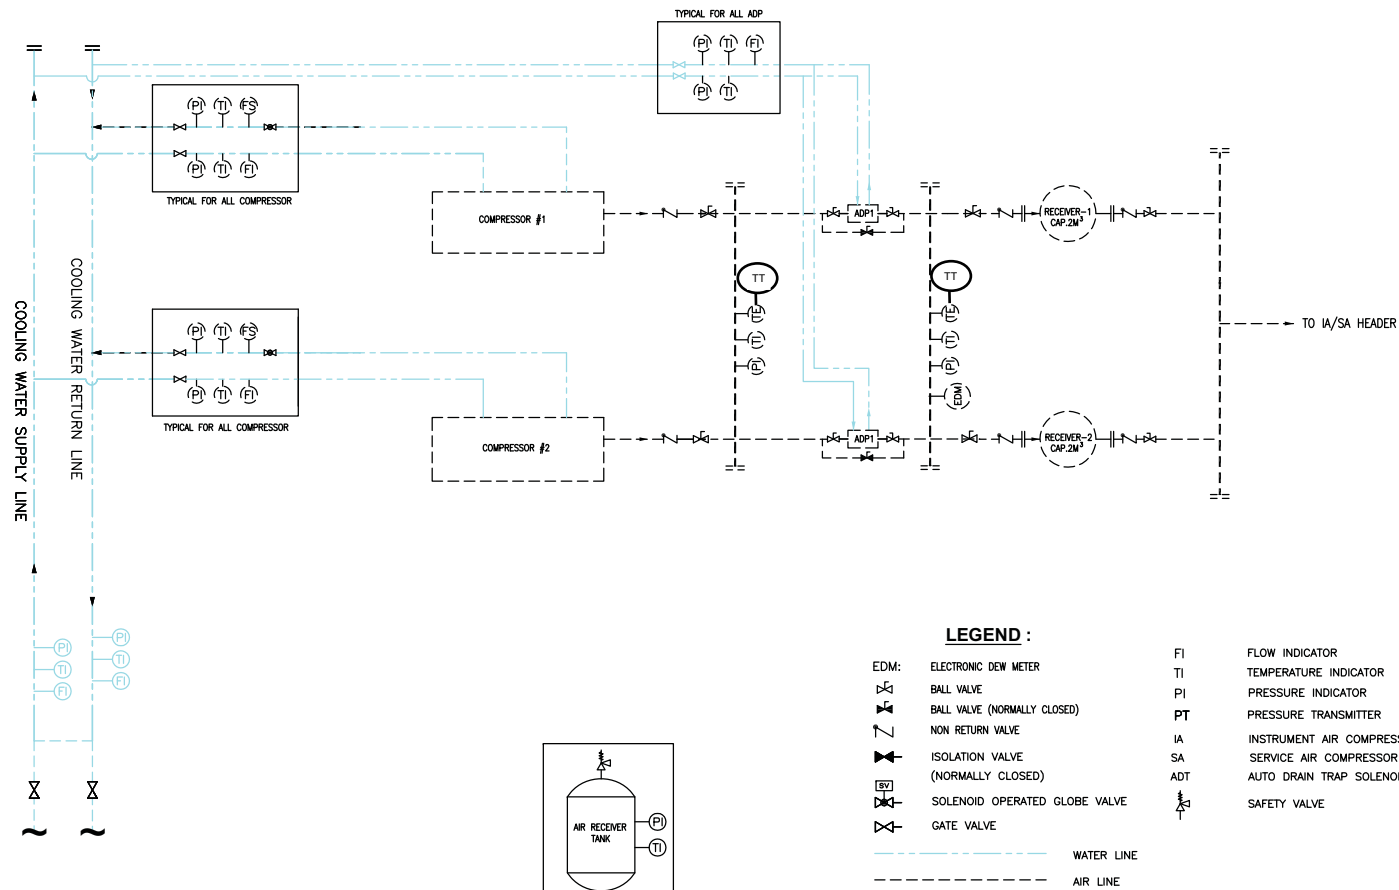

NOTES :

1. THE SCHEMATIC DRAWING SHALL BE READ IN CONJUNCTION WITH TECHNICAL SPECIFICATION.
2. ALL CONTROLS, INTERLOCKS & PROTECTIONS REQUIRE FOR SAFE, RELIABLE AND EFFICIENT OPERATION & MAINTENANCE OF AIR COMPRESSORS & ADP SHALL BE IMPLEMENTED IN CONTROL SYSTEM.
3. ALL IMPORTANT & CRITICAL MEASUREMENTS REQUIRED FOR PROTECTION OF EQUIPMENTS SHALL BE PROVIDED WITH REQUIRED/ADEQUATE
4. VARIOUS FIELD INSTRUMENTS ON AIR AND WATER HAVE BEEN SHOWN. HOWEVER ANY OTHER ADDITIONAL INSTRUMENTS TO MEET THE SYSTEM REQMT. & FOR SAFE OPERATION OF THE PLANT & EQUIPMENT SHALL BE INCORPORATED IN THE SCHEME BY CONTRACTOR AT NO ADDITIONAL COST TO EMPLOYER.
5. THE SCHEME DOES NOT SHOW THE CIRCUIT, INSTRUMENTS, VALVES ETC. FOR LOADING/ UNLOADING/MODULATION OF COMPRESSORS, REPRESSURISATION/DEPRESSURISATION OF ABSORBER TOWER OF ADP & THE SAME SHALL BE PROVIDED BY RESPECTIVE CONTRACTOR.
6. THE SCHEME HAS BEEN ENVISAGED CONSIDERING HEAT OF COMPRESSION TYPE AIR DRYER (TWIN TOWER TYPE) IN CASE OF ROTARY DRUM TYPE (HOC) AIR DRYER, SCHEME SHALL BE FINALISED DURING DETAILED ENGINEERING
7. IN CASE OF ZLD PLANT COMING FAR AWAY FROM COMPRESSOR LOCATION THEN ONE NUMBER AIR RECEIVER OF CAPACITY 2 CUM (NORMAL) SHALL BE PROVIDED FOR ZLD PLANT.



LEGEND :

EDM:	ELECTRONIC DEW METER	FI	FLOW INDICATOR
	BALL VALVE	TI	TEMPERATURE INDICATOR
	BALL VALVE (NORMALLY CLOSED)	PI	PRESSURE INDICATOR
	NON RETURN VALVE	PT	PRESSURE TRANSMITTER
	ISOLATION VALVE (NORMALLY CLOSED)	IA	INSTRUMENT AIR COMPRESSOR
	SOLENOID OPERATED GLOBE VALVE	SA	SERVICE AIR COMPRESSOR
	GATE VALVE	ADT	AUTO DRAIN TRAP SOLENOID OPERATED
			SAFETY VALVE
	WATER LINE		
	AIR LINE		

FOR TENDER PURPOSE ONLY

		NTPC Limited (A GOVT. OF INDIA INTERPRISE) ENGINEERING DIVISION	
PROJECT			
FGD			
TITLE			
SCHEMATIC DRAWING OF COMPRESSERD AIR SYSTEM			
SIZE	SCALE	DRG.NO.	REV.
A1		0011-109-POM-A-006	A

GAD FILE NAME : 0011-109-POM-A-006

247927/2021/PS-PEM-MAX



KAHALGAON TPS – FGD

COMPRESSED AIR SYSTEM

SPECIFICATION NO. PE-TS-481-555-A001

VOLUME : III

SECTION : 6

REV: 00

DATE: Nov. 20

SHEET 1 OF 1

VOLUME-III
SECTION 6
Guaranteed Power Consumption for Compressed Air
System

(To be filled by bidder & be submitted along with offer)

SECTION-6 Guaranteed Power Consumption For Compressed Air System				Doc No:	PE-TS-481-555-A001	
				Rev No:	0	
				Date of issue	Nov. 20	
NAME OF PROJECT:		KAHALGAON TPS – FGD				
NAME OF PACKAGE:		COMPRESSED AIR SYSTEM				
TECHNICAL SPECIFICATION:		PE-TS-481-555-A001				
S.No. (1)	Description of Equipments (2)	Nos. of Equipments (3)		Total Guaranteed Power Consumption for Each Equipment at Motor Input Terminals & control Panel (4)	Duty Factor (5)	Total (KW) (6) = (3A)*(4)*(5)
		Working	Standby			
		A	B			
1	Air Compressors (Oil free Screw type) of capacity 15 NM3/min.	1	1	to be filled by bidder	1.0	to be filled by bidder
2	HOC Air Dyrer of capacity 15 NM3/min.	1	1	to be filled by bidder	1.0	to be filled by bidder
					TOTAL	to be filled by bidder
Note :						
1	Estimated Power Consumption Figure for the compressed air system (For Working Drives Only) considered is 150.5 KW .					
2	Bidders Guaranteed power consumption at motor input terminal at rated duty of Air Compressor considering motor efficiency as confirmed by motor OEM including Air Drying Plant (Heater and Blowers, as applicable) as furnished in guranteed schedule shall be demonstrated by the successful bidder during performance testing at works/site.					
3	The price quoted by the bidder shall be loaded @ INR 1,43,944 /- for every additional KW increase in consumption from the base figure indicated at Note no. 1.0 above.					
4	In case the successful bidder fails to establish / prove the guaranteed values of power consumption (base figure of auxiliary power consumption or the GPC quoted by bidder, whichever is higher) on actual performance testing at the manufacturing works / site, penalty INR 1,43,944 /- per KW increase in power consumption figure shall be levied.					
Particulars of bidder / authorised representative						
Name	Designation	Signature	Date	Date	Company Seal	