

TD-106 Rev No. 00 Form No.		PRODUCT STANDARD PUMPS HYDERABAD		FP60317																	
				Rev No. 03																	
				Page 1 of 34																	
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED, It must not be used directly or indirectly in any way detrimental to the interest of the company.		<u>TECHNICAL SPECIFICATION FOR</u> <u>ABSORBER SLURRY RECIRCULATION PUMP</u>																			
		1. Intent of specification This specification is intended to cover the design, engineering, manufacturing, inspection and testing at manufacturer's works, packing and delivery to site, supervision of erection and commissioning of Slurry Recirculation pump along with its accessories complete in all respects. Each unit of 250/500/660/800MW, is associated with an FGD system. Each FGD system shall have recirculation pumps located inside Recirculation pump & Oxidation blower house. The pumps shall be suitable for outdoor application. The pumps shall be driven by a constant speed motor. The offered pump model shall be proven and must meet the proven-ness criteria indicated at clause 3. The list of deviations/exceptions with respect to the specification shall be submitted as per annexure-4. Deviations not listed in the format shall not be considered. No deviations/exceptions shall be permitted without the approval of purchaser. In case of additional requirement of instrumentation, controls and other accessories/auxiliaries for safe, reliable and trouble-free operation of the pump, necessary reasons for recommendation shall be furnished and the same shall be included in scope of supply with the purchaser's approval. 2. Applicable codes and standards The design, manufacture and performance testing of the pumps as specified herein shall comply with requirement of all applicable codes in particular the following. <table border="0"> <tr> <td>1. ANSI HI 12.1~12.6:</td> <td>Rotodynamic Centrifugal slurry pumps</td> </tr> <tr> <td>2. API 682:</td> <td>Shaft sealing system for centrifugal & rotary pump</td> </tr> <tr> <td>3. API 670:</td> <td>Machinery protection system</td> </tr> <tr> <td>4. ANSI B16.5, B16.47:</td> <td>Pipe flanges and flange fittings</td> </tr> <tr> <td>5. ANSI B16.9:</td> <td>Butt weld fittings</td> </tr> <tr> <td>6. ANSI B16.11:</td> <td>Forged steel fittings, socket welded and threaded</td> </tr> <tr> <td>7. ASTM:</td> <td>For various materials & tests</td> </tr> <tr> <td>8. ASME sec VIII div. 1</td> <td></td> </tr> <tr> <td>9. ISO 9906</td> <td>Rotodynamic pumps hydraulic performance acceptance</td> </tr> </table>				1. ANSI HI 12.1~12.6:	Rotodynamic Centrifugal slurry pumps	2. API 682:	Shaft sealing system for centrifugal & rotary pump	3. API 670:	Machinery protection system	4. ANSI B16.5, B16.47:	Pipe flanges and flange fittings	5. ANSI B16.9:	Butt weld fittings	6. ANSI B16.11:	Forged steel fittings, socket welded and threaded	7. ASTM:	For various materials & tests	8. ASME sec VIII div. 1	
1. ANSI HI 12.1~12.6:	Rotodynamic Centrifugal slurry pumps																				
2. API 682:	Shaft sealing system for centrifugal & rotary pump																				
3. API 670:	Machinery protection system																				
4. ANSI B16.5, B16.47:	Pipe flanges and flange fittings																				
5. ANSI B16.9:	Butt weld fittings																				
6. ANSI B16.11:	Forged steel fittings, socket welded and threaded																				
7. ASTM:	For various materials & tests																				
8. ASME sec VIII div. 1																					
9. ISO 9906	Rotodynamic pumps hydraulic performance acceptance																				
Ref. Doc		Revisions:	Prepared:	Approved:	Date:																
		Refer record of revisions	ASK	MSR	18.11.19																

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 2 of 34

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

3. Provenness Criteria

Supplier shall have previous experience of design, manufacturing, supplying, erecting and commissioning of the recirculation pump for Wet Limestone based FGD system for at least two (2) no's of PUMPS, each of capacity 9500 m³/hr or higher, in a pulverized coal fired power generating units such that the pump should have been in successful operation for a period of not less than two (2) years prior to January 2019. Documentary evidence as per annexure-3 at clause 23.3, shall be submitted along with the offer.

4. Scope of supply

Supplier scope shall include Design, Supply and Supervision of Erecting & Commissioning of slurry recirculation pump, gear box, connecting couplings, baseplate, along with instrumentation and associated sub systems. It shall cover complete recirculation pump unit including sub-systems, start-up spares and special tools and tackles.

Design includes basic and detail engineering, preparation and submission of engineering drawings, calculations, datasheets, quality assurance documents, field quality plans and storage instructions, commissioning procedures, operation & maintenance manuals and performance guarantee test procedures.

Supply includes manufacturing, shop floor testing, stage inspections, final inspections, painting, packing & transportation to site, customer clearance/port clearance and any other statutory clearances/receipts.

Supervision of Erection & commissioning includes supervision of erection & commissioning, supervision of trial operation, training of customer's O&M Personnel and handing over to customer.

5. Variant table

Project	:	Yadadri TPP, 5x800MW	Bhadradri TPP, 4x270MW	Bhusawal TPS, 1x660MW
End Customer	:	TSGENCO	TSGENCO	MPGCL
Location	:	Nalgonda, Telangana, India	Manuguru, Telangana, India	Jalgaon, Maharashtra, India
Service	:	Continuous	Continuous	Continuous
Installation	:	In-door	In-door	In-door
Total number of units	:	5 units of 800MW	4 units of 270MW	1 unit of 660MW
Total pumps in each unit	:	5	3	4
Stand-by pumps per unit	:	1	1	1
Total number of working pumps	:	20	8	3
Total number of pumps	:	25	12	4
Variant	:	Var. 01	Var. 02	Var. 03
Material code	:	FP9760317001	FP9760317028	FP9760317036

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 3 of 34

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

6. Design input data

6.1 Pump operating parameters

Discharge flow	12,800 m ³ /hr	9,988 m ³ /hr	13,800 m ³ /hr
Total Head developed	18.20 m H	17.50 m H	18.00 m H
Medium to be handled	Gypsum slurry	Gypsum slurry	Gypsum slurry
Operating Temperature	~60 deg C	~60 deg C	~55 deg C
Type of Recirculation pump	Horizontal, Centrifugal pump (non-clogging type)		
Nozzle Orientation	End Suction- Top Discharge		
Seal Type	Mechanical seal with external flushing		
Duty	Continuous operation		
Location	Outdoor		
Drive type	Motor driven		
Acceptable noise level	85 dBA (at 1-meter from pump centreline)		
NPSH(A)	10.3 mlc	10.0 mlc	9.78 mlc
Variant	Var. 01	Var. 02	Var. 03

6.2 Slurry Analysis

Slurry to be handled	Gypsum Slurry		
Chloride Content	Less than 20,000 ppm		
Specific Gravity at pump suction (t/m ³)	1.215 @ design point	1.215	1.204
	1.211 @guarantee Point.	1.207	1.203
Vapour Pressure at Pump	0.144 kg/cm ²	0.144 kg/cm ²	0.154 kg/cm ²
Viscosity of slurry	0.01 Pa.S	0.01 Pa.S	0.01 Pa.S
Concentration of Solid	30% wt.		
SiO ₂ Content	4 to 6 g/l		
pH	Normal = 4.0 – 7.0		
	Design = 4.0 – 8.0		
Slurry Temperature	51-60 deg C (normal)		54 deg C
	70 deg C (design)		70 deg C
Maximum solid particle size	150 mesh(140 microns)		
Normal solid particle size, d 50	325 mesh(43 microns) & fine particles		
Variant	Var. 01	Var. 02	Var.03

TD-106
Rev No. 00

Form No.


HYDERABAD

PRODUCT STANDARD
PUMPS
HYDERABAD

FP60317
Rev No. 03
Page 4 of 34


COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

6.3 Absorber Tank Level & NPSH

HH	Bottom +	7,000	7,000	7,000
NL	Bottom +	6,000	6,000	6,000
LL	Bottom +	4,500	4,200	4,200
CL	Bottom +	1,200	1,200	1,200
Variant		Var. 01	Var. 02	Var. 03

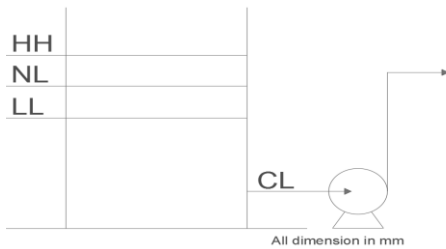

*NPSH (A) is based on Absorber LL level

NPSH Calculation	SI Unit	Value	Value	Value	
Discharge Pressure	kg/cm ² G	2.588	2.466	2.492	
Suction Pressure	kg/cm ² G	0.377	0.340	0.325	
Differential Pressure	kg/cm ² G	2.211	2.126	2.165	
Max. Suction Pressure	kg/cm ² G	0.680	0.680	0.662	
NPSH (A).	m	10.3	10.0	9.78	
Variant		Var. 01	Var. 02	Var. 03	

6.4 Flushing water analysis

Constituents	Units	Value	Value	Value	
Total Dissolved Solids	ppm	500	500	840	
Calcium as CaCO3	ppm	76.9	96	240	
Magnesium as CaCO3	ppm	59.5	52	120	
Sodium as CaCO3	ppm	148.2	76.6	252	
Potassium as CaCO3	ppm	2.5	N/D	33	
Iron as Fe	ppm	0.7	-	-	
Fluoride as F	ppm	2.6	-	-	
Bicarbonate as CaCO3	ppm	116	136	220	
Chlorides as CaCO3	ppm	82.6	72	140	
Sulphate as CaCO3	ppm	82.9	15	50	
Nitrate as NO ₃	ppm	7	1.6	7	
Silica	ppm	16.9	3.1	48	
pH	-	7.0 – 8.5	7.0 – 8.5	7.0 – 8.5	
Turbidity	NTU	<15	<10	<10	
Variant		Var. 01	Var. 02	Var. 03	

TD-106 Rev No. 00	Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317 Rev No. 03 Page 6 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		Ref Doc	pump for a previous installation for similar service. The material used by the contractor shall be proven in previous installations. 7.8 The pump casing shall be designed to withstand a pressure of 1.5 times the maximum possible pump shut off pressure under maximum suction pressure condition. 7.9 Flushing water lines and drains are to be supplied for each pump handling the prevailing water to avoid corrosion even if the pump is out of operation for extended periods. 7.10 Pumps must be carefully selected to ensure that the net positive suction head available under all operating conditions will be adequate. The NPSH values are to be referred to the least favorable operating conditions such as lowest atmospheric pressure, lowest level of water on the suction side of the pump and highest temperature of the pumped fluid. An adequate safety margin of normally greater than 1m to the max NPSH required shall be provided. 7.11 The Pump flow & head characteristics shall be such that within the operation range the head will continuously increase with decreasing flow. Shut off head being at least 20% higher than the duty point head. 7.12 Pumps shall have stable head-capacity characteristics curve from run-off to shut-off. Shut-off head should be minimum 125% of Best Efficiency Point (BEP). 7.13 Venting valve shall be fitted to all pumps at suitable points on the pump casing. Drainage facilities shall be provided on the pump casing or adjacent pipe work to facilitate the dismantling of pumps. 7.14 Pumps shall be designed such that they are not damaged during reverse rotation at up to 150% of design RPM, at full discharge head in the event where one pump trips while the other pumps are operational. 7.15 Selection of Duty point should preferably be at BEP (Best Efficiency Point). Selection point beyond 105% of BEP is not acceptable. It should be noted that head variation is due to level variation in tank. Pump has to run in the system without compromising the NPSH requirement at lowest water level in tank. Hence, when tanks are filled-up and is at normal water level, pump will operate at the right of BEP, pump's operating zone should be considered accordingly. 7.16 A factor for "Froth" should be taken into account for sizing the pump. Supplier from their past experience, may specify the froth factor to be taken into account for FGD pump. Suction size of the pump should be adequate to take this extra capacity and the same should be reflected in master curve. 7.17 External flushing is required to remove the accumulated particles and all related information such as flow rate, pressure etc. should be mentioned in data sheet. 7.18 Pump should have provision for adjusting the axial clearance between casing and impeller for maintaining the performance at best efficiency when there is wear in between impeller and casing. 7.19 In case rubber or nonmetallic linings are used, these will be two pieces molded under pressure and adjusted to the screwed metallic clamping which have been welded to the casting.	

TD-106 Rev No. 00		बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
Form No.				Rev No. 03
				Page 7 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc 7.20 The pump shall be provided with seals of proven type and shall be designed for minimization of seal water consumption. The shaft shall be supported on heavy duty ball/roller bearings. 7.21 The Antifriction bearing of the pumps shall be designed for minimum useful life (L-10) of 25,000 hours of continuous operation (Under the design condition). The thrust bearing will be selected for twice the operating load. 7.22 Mechanical seal with automatic flushing, and an additional connection for manual flushing shall be provided. 7.23 The mechanical seals of cartridge type with self-lubrication sliding ring cartridges are preferable. The static part will be mounted on the seal plate with circumferential ring (O-ring) or another flexible sealing ring. Built in seal design will not be accepted. 7.24 The sealing areas shall be designed in such a way so that solids do not precipitate in them and affect the cooling or affect the adjustment and mechanical functioning of the seals. Seals which do not need jet cleaning are preferred. 7.25 Flow induced vibration due to pressure pulsations shall be avoided by suitable design. 7.26 Each rotating equipment shall be first statically balanced and then dynamically balanced to G2.5 or better grade according to ISO 1940 (in the case of impellers this shall be done before and after mounting of the service rotor shaft). 8. Constructional features 8.1 Casing 8.1.1 The pump casing shall be split type for ease of maintenance and shall be designed such that the impeller and shaft can be withdrawn from the casing without disturbing the main pipework and valves carrying the pumped fluid and also without disturbing/removing the motor. 8.1.2 The casing and flanges shall be designed to withstand the 1.5 times the maximum shut-off pressure developed by the pump at the pump operating temperature. 8.1.3 Pressure casing shall be designed with a corrosion allowance (ASTM G46 & ASTM G48) to meet all the technical requirements, taking into account the Operating Parameters. 8.1.4 Lifting provision of pump as a whole and individual casing halves should be provided. 8.1.5 The casing material shall be Carbon steel / C.I with rubber lining or Silicon carbide or, Hi chrome or highly alloyed stainless steel or any equivalent. The material used by the contractor shall be proven in previous installations. 8.1.6 For replaceable rubber liner, hardness of rubber should be of Shore hardness- SA 65 (+/-) 5. Rubber should be of Type and Class as defined by ASTM D-2000 which is suitable for uninterrupted operation of 5 years (minimum). Guarantee to the affect shall be provided. 8.1.7 Pump casing shall be provided with a vent connection and piping with valves and fittings. Casing drain shall be provided with drain valves. 8.1.8 All the wear parts of the pump shall be guaranteed for a minimum wear life of not less than 25000 hrs. 8.1.9 Renewable wear rings shall be provided at points of minimum running clearances.				

TD-106 Rev No. 00	Form No.		PRODUCT STANDARD PUMPS HYDERABAD	FP60317 Rev No. 03 Page 9 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc		consecutive bearings must include a sufficiently large safety margin to satisfy this condition. 8.4.4 Shafts shall be conservatively designed to transmit maximum power required and to assure rigidity. Shafts shall be machined and ground to close tolerances and shall be tapered to permit easy assembly & withdrawal of the seals and bearings. 8.4.5 Shaft shall run in high precision heavy duty roller bearings. 8.4.6 The shaft shall be finished to close tolerance at the rotor, coupling and bearing diameters. 8.4.7 Shaft shall be made of carbon steel. No exposed part of the shaft shall come in contact with the medium handled. 8.4.8 Shaft sleeve should be CD4M Cu ASTM A-743 or equivalent. Sleeve should have this as a guaranteed value/parameter to prevent wear and corrosion of mating surface. Manufacture to indicate the diameter in data sheet. 8.4.9 Shaft shall have a keyed joint at impeller hub. Threaded connection between impeller and shaft is not acceptable. 8.5 Coupling 8.5.1 The HT drive motor is excluded from the scope of supply. However, the Supplier shall supply coupling between pump & gear box, coupling between gear box & motor along with gear box. 8.5.2 Couplings shall be of flexible membrane type and shall not need any lubrication. 8.5.3 Couplings shall be dynamically balanced as per ISO 1940 G2.5. Balancing shall be done before slotting the key ways. 8.5.4 Couplings shall be suitable for accommodating axial movements and parallel offsets. The maximum permissible axial and parallel misalignment to be indicated in the coupling drawings. 8.5.5 Construction of the coupling shall be such that in case of membrane failure, no component of the coupling shall fly off while the equipment is in rotation 8.5.6 Membrane element shall be independently replaceable without requiring the replacement of the spacer. 8.5.7 All the nuts and bolts shall be with metric threads. 8.5.8 The Couplings shall be provided with adapter plates on both ends of spacer assembly, to facilitate removal of spacer assembly without dismantling the membrane packs 8.5.9 Gaging Screws shall be provided for Transportation and Installation of coupling. These Screws must be accessible from outside when the Coupling is fully assembled. 8.5.10 All the couplings shall be provided with over load washers designed adequately 8.5.11 A notch of 30x15x3 mm shall be provided on the periphery of each coupling hub for speed measurement. 8.5.12 Coupling halves shall be machine matched to ensure accurate alignment. Couplings and gears must have a rated capacity of at least 120% of the maximum potential power transmission requirement. 8.5.13 All rotating parts such as coupling shall be covered with suitable protective guards. Guards shall be easily removable type. If weight of the coupling is heavy (>40 kgs), provision of tapped hole should be incorporated in right place of hub to handle the same effortlessly.		

TD-106 Rev No. 00	Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 11 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		Ref Doc	8.8 Gearbox	
			8.8.1 Pump shall be driven by a gear box and shall have a service factor of 2 or better. 8.8.2 Gear Box shall be designed for continuous duty. 8.8.3 Gear Box design shall be such that it shall not impose any axial or radial forces either on pump bearings or on motor bearings. 8.8.4 Gear Box shall be in accordance with AGMA-420 or 421 or any internationally accepted standard. 8.8.5 Gearing shall be enclosed in an oil and dust proof gear case made of close grained cast iron or fabricated steel. The gear case shall be horizontally split. The gear case shall be of rigid construction to provide permanent alignment of rotating parts. The arrangement shall be such that it will be possible to fit gear case cover without disturbing the alignment of the shaft, gear and pinion 8.8.6 Gear Box shall be provided with integral piping for lubrication and cooling. One terminal point each for oil inlet and oil return, CW inlet and CW outlet in the form of ANSI flange, with counter flange bolts, gasket and nuts shall be provided. 8.8.7 If Gearbox requires cooling water, volume and pressure of cooling water is to be indicated in Technical Data Sheet. Cooling water data for gearbox cooling: 8.8.7.1 Inlet temperature: 38 DegC 8.8.7.2 Maximum Allowable Temperature increase: 10 DegC at the outlet 8.8.7.3 Inlet Pressure: 4 to 6 bar 8.8.7.4 Maximum Allowable Pressure Drop: $\leq 1.0 \text{ Kg/cm}^2$. 8.8.8 Cooling water flow switch and sight glass shall be provided to monitor the flow of cooling water to Gearbox for each pump. 8.8.9 If heat exchanger is provided to cool gearbox then Temperature gauges and pressure gauges upstream and downstream, tube and shell side to be provided for each pump. 8.8.10 All RTD connections shall be terminated to Junction Box. Junction Box shall be provided along with Gear Box with 20% spare terminals. 8.8.11 Each bearing shall be provided with one capillary type dial thermometer of 160 mm dial size suitable for panel mounting with 5 meters capillary length. Thermometers shall be mounted on gauge board, to be fixed to the gear box by the vendor. Label shall be provided for each thermometer to indicate the purpose 8.9 Accessories 8.9.1 Expansion Joints 8.9.1.1 Expansion Rubber expansion Joints shall be provided at suction and discharge of each pump. 8.9.2 Pressure Gauges 8.9.2.1 Pressure Gauges shall be provided at suction & discharge of each pump. Pressure gauges of class 1.6 or better must be used. Pressure instrument for measurement of steady pressure at varying conditions shall operate in a band centered on 60% of its maximum range. Pressure gauges shall have a dial size of 160 mm. 8.9.3 Provision for Vibration Monitoring: 8.9.3.1 Suitable provision/pads for mounting vibration sensors, Key phase sensors shall be provided on gearbox and pump. For each bearing there shall be provisions for Two (02) No's of Vibration sensors (X and Y Axis) for vibration measurement. Provisions	

TD-106 Rev No. 00	Form No.		PRODUCT STANDARD PUMPS HYDERABAD	FP60317 Rev No. 03 Page 12 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		Ref Doc	shall be provided in line with API 670 Vth Edition Standard These provisions shall be covered suitably. Details to be provided along with the offer. 8.9.4 Temperature elements: 8.9.4.1 Temperature elements wherever provided shall be duplex 4 wire type RTDs. 8.9.4.2 All RTD connections along with signal cables shall be terminated to Junction Box. Junction Box shall be provided along with Gear Box & Pump with 20% spare terminals. 8.9.4.3 Triple redundancy shall be supplied for parameters concerning the safe operation of the pump, Double redundancy shall be supplied for interlock and alarm signals. 8.10 Pump Control 8.10.1 Each pump shall be provided with required instrumentation and electrical accessory devices mounted and connected in a control cabinet. 8.10.2 Provisions shall be made for the interface between the local cabinet and the DCS such that the operation of the pumps can be controlled from the control console in the FGD Control room. 8.10.2.1 <u>Alarm Signal</u> 8.10.2.1.1 Bearing temperature high 8.10.2.1.2 Gearbox cooling water flow low (if applicable) 8.10.2.1.3 Bearing temperature sensor for alarm when “Bearing Temperature high” shall be supplied by Supplier. 8.10.2.1.4 Cooling water flow switch for initiating alarm when “Cooling water flow low” shall be supplied by Supplier (if applicable). 9. General Requirements 9.1 Metric unit shall be used in the drawings and any displays on the equipment. Unit of pressure shall be in dual scales of kPa and kg/cm² (G). For instance the pressure gauges should have dual unit’s indication. 9.2 Descriptions in the drawings, documents and in the displays shall be in English. 9.3 The equipment shall be designed to withstand the corrosive and moist environment in which these are proposed to operate. 9.4 Noise level produced by the rotating equipment shall not exceed 85 dB measured at a distance of 1.0 meters from the source in any direction and 1.5m above operating floor. Predicted sound pressure levels for the pump drive assemblies shall be submitted as part of the proposal data. 9.5 The overall vibration level shall be as per ISO 10816. 9.6 Suitable drain connections shall be provided. 9.7 The equipment shall be suitable for stable continuous operation. 9.8 Service life: Entire pump except wearing parts shall be designed and fabricated for a minimum service life of 30 years of operation or 200,000 full load operating hours whichever is longer. 9.9 Corrosion allowance: Corrosion allowance for entire equipment shall be in accordance with latest applicable international standard ASTM G46 & ASTM G48. 9.10 Unless otherwise specified, flanges shall be in accordance with ANSI B16.5 Class 150 or ANSI B16.47 Class 150. Counter flanges along with suitable gaskets and fasteners shall be provided for all terminal points.	

TD-106 Rev No. 00	Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 13 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		Ref Doc	9.11 Name plate: All equipment shall be provided with nameplates indicating the item number and service name. Name plates shall be of 304 Stainless steel plate and placed at a readily visible location. Nameplate of main equipment shall have enough information, which will be confirmed during engineering phase. Stainless steel nameplates for all instruments and valves shall be provided. 9.12 Rotation arrows shall be cast in or attached with stainless steel plate on each item of rotation equipment at a readily visible location. 9.13 Unless otherwise specified, all equipment items where the weight exceeds 15 kg shall be provided with suitable lifting lugs, ears or ring bolts or tapped holes for lifting rings. Minimum shock factor for lifting lugs shall be minimum 2.0. The position of lifting lugs and reference dimension shall be shown on GA and/or outline drawings. NDT shall be conducted for lifting lugs. When any spreader bars are required for lifting and laydown, the Supplier shall provide spreader bar with equipment. 9.14 Equipment shall be fabricated as skid mount design as much as practical to minimize erection at the site. 9.15 The position of earth lugs shall be shown on the GA and/or outline drawing. 9.16 Foundation bolts shall be provided with double nuts. 9.17 Supplier shall provide allowable vibration level on foundation in foundation drawings and general arrangement drawings. 9.18 If the driver/driven equipment train is in the resonance condition or any vibration problems occur, the Supplier shall solve the problems in a timely manner. 9.19 The Supplier shall have responsibility for vibration control of the equipment train at the site and the unit's satisfactory performance, even if the foundation, driver are provided by the BHEL. 9.20 Supplier to quote for the Initial Spare parts (Mandatory Spares) for equipment. 9.21 Supplier shall provide the mating flanges with the necessary gaskets. 9.22 All the surfaces of the carbon steel should have rust preventive coating durable for at least 18 months for storage from day of shipping. 9.23 Supplier to indicate the weights of components for handling. 9.24 The list of all Bought out items with makes and country of origin to be mentioned along with offer to be submitted. 9.25 Quality Plan to be submitted along with the offer. 9.26 Cost towards the participation in discussions/meetings, providing technical assistance during technical discussions/meetings with customer for approval of drawing/documents etc. TA/DA, boarding and lodging to attend these meetings shall be borne by the Supplier and shall be inclusive in supply portion. 9.27 Supplier shall consider MOC for all equipment/component as per best engineering practice, global standard and global references. 9.28 The modalities of inspection (Stage, Final, In-process) shall be finalized during detail engineering after submission of quality assurance plan (QAP). It shall be reviewed by BHEL/end customer.	

TD-106 Rev No. 00		Form No.	बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317 Rev No. 03 Page 15 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.			Ref Doc	coated with oxidation preventive compounds. All parts subject to damage when in contact with water shall be coated with suitable grease and wrapped in heavy asphalt or tar impregnated paper. 10.5 Crates and packing material used for shipping will become the property of end customer. 10.6 Packaging or shipping units shall be designed within the limitations of the unloading facilities of the receiving ports and the ship used. It shall be the Supplier’s responsibility to investigate these limitations and to provide suitable packaging and shipping to permit transportation to site. 10.7 Packing (tare) shall be part of the equipment cost and shall not be subject to return. The packing should ensure integrity and cohesiveness of each delivery batch of equipment during transportation. In case of equipment assemblies and unit’s delivery in the packing of glass, plastics or paper the specification of packing with the material and weight characteristics are to be indicated. 10.8 Each package should have the following inscriptions and signs stenciled with an indelible ink legibly and clearly: 10.8.1 Destination 10.8.2 Package Number 10.8.3 Gross and Net Weight 10.8.4 Dimensions 10.8.5 Lifting places 10.8.6 Handling marks and the following delivery marking 10.9 Each package or shipping units shall be clearly marked or stenciled on at least two sides as follows. NAME OF THE PROJECT: AREA:, INDIA EPC CONTRACTOR: BHARAT HEAVY ELECTRICALS LIMITED, INDIA 10.10 Each case shall contain a packing list in waterproof material or protected by shellac or varnish to prevent obliteration in transit, showing the detailed contents of the package. When any technical documents are supplied together with the shipment of materials no single package shall contain more than one set of such documents. Shipping papers shall clearly indicate in which packages the technical documents are contained. 10.11 The case number shall be written in the form of a fraction, the numerator of which is the serial number of the case and the denominator the total number of case in which a complete unit of equipment is packed. 10.12 Wherever necessary besides usual inscriptions the cases shall bear special indication such as “Top”, “Do not turn over”, “Care” , “Keep Dry” etc. as well as indication of the center of gravity (with red vertical lines) and places for attaching slings (with chain marks) 10.13 Marking for Safe handling: To ensure safe handling, packing case shall be marked to show the following: 10.13.1 Upright position 10.13.2 Sling position and center of Gravity position 10.13.3 Storage category 10.13.4 Fragile components (to be marked properly with a clear warning for safe handling)	

TD-106 Rev No. 00	Form No.	 बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 16 of 34

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

11. Supervision of Erection and Commissioning

- 11.1** The erection of Recirculation Pumps will be done by owner as per Erection & commissioning Manual and check List. However, the Supplier shall make one visit per boiler for the supervision of erection, pre-commissioning & post- commissioning check-up, start-up, testing and trial runs of all the items covered under the scope of supply.
- 11.2** There will be one visit per boiler. Supplier shall include 10 working days per visit. Per day cost of visit shall be furnished separately. This shall be considered for evaluation of offer. Separate service order shall be issued for each visit.
- 11.3** TA/DA, boarding and lodging shall be borne by the Supplier.

12. Exclusions

The following shall be exclusions in the scope:

- 12.1** Supply of main drive Motor.
- 12.2** Civil foundations.
- 12.3** Vibration monitoring system including sensors.

13. Inspection and Testing

13.1 Minimum Testing requirements to be considered are as below:

- 13.1.1** Hydrostatic test is to be conducted at 150 % of design pressure for duration of 30 minutes at operating temperature of 60 degC.
- 13.1.2** Impeller and rotor shall be first statically balanced and then dynamically balanced according to ISO 1940 (in the case of impellers this shall be done before and after mounting of the service rotor shaft).
- 13.1.3** Vibration levels measured on the non-rotating parts shall not exceed the zone limit “B” as defined in ISO 10816 at steady conditions and shall not exceed the zone limit “C” as defined in ISO 10816 at transient conditions.
- 13.1.4** List of Non-Destructive test over and above the material test are as follows:
 - 13.1.4.1** Casing: Material test, Magnetic particle (MPI), DP and Hydro test as applicable
 - 13.1.4.2** Impeller- DPT and MPI as applicable
 - 13.1.4.3** Shaft- Ultrasonic (UT), DPT and MPI
 - 13.1.4.4** Sleeve- DP and Hardness test/ Manufacturer’s recommendation
 - 13.1.4.5** Mechanical Seal- Manufacturer’s recommendation.
 - 13.1.4.6** Base Plate- Stress relieving of weld if applicable.
 - 13.1.4.7** Replaceable Rubber liner- Shore Hardness, Class and Type certificate
- 13.1.5** Once mounting is finished, performance test will be conducted on each pump to determine the characteristic curves. The mechanical running & performance testing shall be performed & witnessed.
- 13.1.6** NPSH Test, Vibration test and Noise level test shall be witnessed at shop.
- 13.1.7** For surfaces with rubber lining Welding shall be visually inspected to verify the absence of rough area and unacceptable transition between surfaces which prevent



TD-106 Rev No. 00		Form No.	बी एच ई एल BHEL HYDERABAD		PRODUCT STANDARD PUMPS HYDERABAD		FP60317	
							Rev No. 03	
							Page 18 of 34	
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc 14. Painting 14.1 Surface Preparation: Blast Cleaning SA 2.5 14.2 Primer Coat 14.2.1 Zinc Epoxy 14.2.2 DFT= 80micron per coat 14.2.3 No of coats = 1. 14.2.4 Primer coat thickness 80 micron. 14.3 Finish Coat 14.3.1 Epoxy High Solid 14.3.2 DFT= 50micron per coat 14.3.3 No of coats = 2. 14.3.4 Coat thickness 100 micron. 14.3.5 Total DFT : 180 micron. 14.4 Color Code (based on DIN 2403:2007-05 & DIN 5381) 14.4.1 Base: Signal Orange, RAL: 2010 14.4.2 Lettering: Signal Black, RAL: 9004. 14.5 Rust preventive paint after inspection & before dispatch from shop is in Supplier's scope 14.6 Corrosion protection, coating and galvanizing, painting shall be taken care by the Supplier. Supplier shall submit the painting scheme during detail Engg and shall be subject to approval of end customer/BHEL. 15. Spares, Tools & Tackles 15.1 Start-up & Commissioning Spares Start-up & Commissioning Spares shall be part of the main supply of the Recirculation pumps. Start-up & commissioning spares are those spares which may be required during the start- up and commissioning of the equipment/system. Supplier shall provide an adequate stock of such start up and commissioning spares for the equipment erection and commissioning. The spares must be available at site before the equipment is energized. These start-up & commissioning spare part list shall not be included in "Initial Spare Parts List". 15.2 Recommended Spares Suppliers shall also furnish the recommended spares list along with the offer. Supplier shall provide a "Recommended Spare Parts List" which shall comprise of all items of the Initial Spare Parts List as well as other spares required for long term routine/planned and breakdown maintenance. Supplier shall indicate all details for each item of aforesaid Recommended Spare Parts List, such as Supplier's/ Original equipment manufacturers (OEM's) name and location, drawings, normal delivery period, quantity, service life, Supplier's/OEM's serial numbers and price etc. The format and content of the final spare parts list shall be agreed in the basic/detailed engineering phase. Then the final spare parts list shall be submitted by the Supplier to BHEL for approval not later than eighteen (18) months prior to the Scheduled Commercial Operation Date (COD) of the 1st Unit. The Supplier shall name OEM/ three (3) vendors with complete address for each of the spare parts.								

TD-106 Rev No. 00	Form No.	बी एच ई एल  HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 19 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		Ref Doc	Supplier shall quote for the “Recommended Spare Parts List”, however it shall not be considered for L1 evaluation, but these spares items shall remain available for order anytime during the first two (2) years commencing from COD of first unit, at the initial unit prices quoted in the offer as adjusted pursuant to the indexation mechanism approved by end customer. However, the end customer shall have the freedom to decide at its sole discretion to purchase spare parts either from OEM (according to quoted unit price as stated above) or directly from sub-vendors or from any other source.	
			15.3 Mandatory Spares: Supplier to quote for below mentioned mandatory spares with break up price. 15.3.1 Impeller assembly - 1 no. of each type 15.3.2 Casing liners-If applicable – 1 no. of each type 15.3.3 Seals - 1 no. of each type 15.3.4 Bearings - 1 no. of each type 15.3.5 Oil Cups-If applicable – 1 no. of each type 15.3.6 Shafts & Sleeve- 1 no. of each type 15.3.7 Pressure gauge- 1 no. of each type 15.3.8 Bearing Temp Transmitter- 1 no. of each type	
			Supplier shall quote for the “Mandatory Spares Part List”, and it will be considered for L1 evaluation. Mandatory spare parts items shall not be mixed with the supply of the main equipment parts. Spares shall be sent in pre-decided lots in containers/secure boxes, distinctly marked in red color with boldly written “S” mark on each face of the containers. The packing shall be sufficient for a minimum of 10 years storage in a dry weatherproof building. All spares shall be strictly inter-changeable with the pump parts. All the mandatory spares shall have same specification and quality plan.	
			15.4 Special Tools & Tackles Any special tools & tackles required for disassembly, assembly or maintaining the pumps, shall be included in the quotation and furnished as part of the initial supply of the machine. List of special tools & tackles shall be decided by Supplier as per his proven practice. They shall be packaged in separate boxes with lugs and marked as “Special Tools”.	
			16. Performance Guarantee All performance tests for Recirculation pumps shall be carried out in accordance with any latest international codes/standards. 16.1 Supplier shall furnish Performance guarantee for the design, manufacture, material, safe and trouble-free operation of the Recirculation pump and its accessories. 16.2 Capacity and its associated head of the pump to be guaranteed. 16.3 The Supplier shall ensure a design of the equipment to achieve an average target availability of 90%. 16.4 All the wear parts of the pump shall be guaranteed for a minimum wear life of not less than 25000 hrs.	

TD-106 Rev No. 00	Form No.	बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 20 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc 16.5 Scheduled Maintenance (Minor Overhauls): Recommended intervals between maintenance outages shall be >25000 hours operation. 16.6 Scheduled Maintenance (Major Overhauls): Recommended intervals between maintenance outages shall be >75000 hours operation. 16.7 Noise level-≤85 dB (A) at 1m horizontal distance from equipment/enclosures and 1.5m above operating floor is to be guaranteed. 16.8 Vibration levels measured on the non-rotating parts shall not exceed the zone limit “B” as defined in ISO 10816 at steady conditions and shall not exceed the zone limit “C” as defined in ISO 10816 at transient conditions. 16.9 Acceptance tests to be carried out as per the procedure defined by the Supplier which shall be submitted for BHEL/end customer approval. 16.10 In the event of unsuccessful performance test, Supplier shall take necessary remedial action at his cost and the performance test shall be repeated. 17. Bid Evaluation Criteria for Power Consumption 17.1 Power Guarantee Supplier to specify the guaranteed Shaft power per Pump operating at the duty point in their offer 17.2 Bid evaluation criteria for power consumption: Power consumption quoted by Supplier shall be limited to the ceiling value specified below. Ceiling value for Shaft power of Recirculation pump (refer variant table) In case, Guaranteed Shaft power offered by the Supplier exceeds the ceiling value specified above, his bid price will be loaded for excess power consumption as per the formula given below. Adjustment factor for excess power consumption in USD = (GPC-CV) X PL X No’s of Working pumps (as per variant table) GPC- Guaranteed Shaft Power Consumption quoted by Supplier in KW CV- Ceiling Value for Shaft Power Consumption PL- Power Loading @ 4060 USD/KW Exchange rate as applicable on price bid opening date will be considered. No Price advantage apart from NIL Power Loading will be given if Guaranteed Power consumption offered is less than the ceiling value. 18. Liquidated Damages for Power Consumption If actual shaft Power Consumption during prove out (or) PG Test operating at the duty point exceeds the value guaranteed by the Supplier, liquidated damages for shortfall in performance shall be deducted from contract price as per the formula given below Liquidated damage deductible in USD per pump = (GPC-APC) X P X No’s of Working pumps (as per variant table), where • GPC- Guaranteed Shaft Power Consumption quoted by Supplier in KW • APC- Actual Shaft Power Consumption in KW • P- Penalty @ 4060 USD per KW				

TD-106 Rev No. 00	Form No.	बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
				Rev No. 03
				Page 22 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc 22. Documentation 22.1 Documents to be submitted along with the offer The Supplier shall submit all documents, drawings, diagrams and all such information, which are necessary to fully understand the offer for techno – commercial evaluation. The following information shall be furnished along with duly filled-in Technical Data sheets at Annexure I and guarantee schedule furnished at Annexure-II. 22.1.1 Sectional Assembly, P&ID diagram 22.1.2 Performance curve 22.1.3 Terminal point details. 22.1.4 General Arrangement with civil loads and pocket details. 22.1.5 Rotor GD2 (kg-m2) 22.1.6 Connecting coupling technical data. 22.1.7 Torque Vs Speed curve 22.1.8 Calculation of Motor rating, Bearing capacity and coupling selection. 22.1.9 Bill of material along with ASTM or its equivalent materials. 22.1.10 Overall space and headroom requirement during Erection, maintenance of pump. 22.1.11 Erection, Operation & Maintenance manual with lubrication schedule 22.1.12 Procedure for shop / site performance tests 22.1.13 Time schedule for delivery. 22.1.14 Quality Assurance Plan. 22.1.15 Make of all bought out items. 22.1.16 Deviation list 22.1.17 Spares list. 22.1.18 Hoist / Crane requirement. 22.1.19 Reference list of similar projects executed. 22.1.20 List of proposed makes and vendors 22.1.21 Training program and schedule for BHEL & customer personnel 22.1.22 Equipment maintenance schedules				

TD-106 Rev No. 00		Form No.	बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
					Rev No. 03
					Page 23 of 34
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company. Ref Doc 22.2 Documents to be submitted after award of contract The Successful Supplier shall submit necessary data, documents and drawings for review, approval with requirements specified here under. However as minimum the following shall be submitted. 22.2.1 Duly filled technical datasheet. 22.2.2 General arrangement drawings indicating dimension and civil loading details. 22.2.3 Motor Data. 22.2.4 Recommended repair procedure etc. 22.2.5 Operation and maintenance manuals. 22.2.6 Assembly & Dis-assembly sequence shall be submitted as a separate document prior to the submission of the Operation and Maintenance Manual. 22.2.7 Erection schedule and component list. 22.2.8 Successful Supplier shall submit Calculation for HT Motor power requirement for sizing HT Motor within 2 weeks from the date of ordering. 22.2.9 The following performance curves of the pump shall be submitted: 22.2.9.1 Flow v/s Head 22.2.9.2 Flow v/s NPSH 22.2.9.3 Flow v/s Efficiency 22.2.9.4 Flow v/s power consumption 22.2.9.5 Torque vs. speed curve for Motor selection 22.2.10 The system-resistance point at different loads shall be indicated in the above performance curves. Drawings that are reviewed will be returned to Supplier with a transmittal letter with any comments and / or questions marked on the drawings or noted in the letter. All comments and questions must be resolved before a resubmission of drawings / documents. BHEL reserves the right to return drawings unprocessed to Supplier if there exists any evidence that Supplier has not acknowledged all comments and questions. All necessary GA drawings, sections, sub-assembly drawings, specifications of main and sub components and necessary set of operation & maintenance manual as asked by BHEL/end customer must be furnished by Supplier in soft and hard copy forms. For all documents softcopy format shall be searchable pdf, however in addition all drawings, diagrams like P&IDS shall be supplied in ACAD or other editable format and all lists in Excel format. Further break up of technical documents will be discussed during finalization of the purchase contract. Unless agreed otherwise, Ten (10) hard copies and five (05) sets of electronic copies of all documents are to be submitted in the English language. Electronic Copies shall be submitted in primary original data format (e.g. DOC, XLS, DWG) as well as in a printable non-proprietary document format (e.g. PDF). P&IDs & drawings shall be submitted as DWG files and PDF files. Supplier to ensure submission of hard copies as per end customer requirement for all engineering drg/doc and for all subsequent revisions along with a soft copy through email to concerned project team. All the engineering related information shall be furnished in soft form to BHEL.					

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317	
				Rev No. 03	
				Page 24 of 34	

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

Variant Table

S.NO	ITEM DESCRIPTION	QUANTITY	UNIT	MATERIAL CODE	VAR. No
1	PUMP-CASING LINERS	2 No. of each type	EA	FP9760317516	Var. 02
2	SEALS	2 No. of each type	SET	FP9760317524	Var. 02
3	TRANSMITTERS/SWITCHES/GAUGES ALONG WITH ACCESSORIES	2 no. of each type, along with accessories	SET	FP9760317532	Var. 02
4	TEMPERATURE ELEMENT(RTD/THERMOCOUPLE) WITH THERMOWELL	4 no. of each type, range and immersion length	SET	FP9760317540	Var. 02

TD-106 Rev No. 00 Form No.	 बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317	
				Rev No. 03	
				Page 25 of 34	

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

23. ANNEXURES

23.1 Annexure-1, Technical Data Sheet

S.No	Description	Data
1	GENERAL	
	a. Client	: Indicated in variant table.
	b. Project	: --do--
	c. End Customer	: --do--
	d. Location	: --do--
	e. Service	: --do--
	f. Installation	: --do--
	g. No of pumps for each unit	: --do--
	h. No of stand-by pumps per unit	: --do--
	i. Total number of pumps	: --do--
2	MANUFACTURER DETAILS	
	a. Model	: *
	b. Type	: Centrifugal (non- Clogging)
	c. Type of Driver	: Motor with Gearbox
3	OPERATING CONDITION	
	a. Medium to be handled	: Indicated in variant table.
	b. Maximum solid particle size	: --do--
	c. Normal solid particle size, d 50	: --do--
	d. Concentration of chloride	: --do--
	e. Viscosity of slurry	: --do--
	f. Concentration of slurry	: --do--
	g. Specific gravity of slurry	: --do--
	h. pH of slurry	: --do--
4	PERFORMANCE DATA	
	a. Capacity	m ³ /hr : *
	b. Head	M : *
	c. Pump efficiency	% : *
	d. BkW Normal / Maximum	KW : *
	e. Motor rating	KW : *
	f. Motor Speed	rpm : *
	g. Gear box Loss	% : *
	h. Differential pressure (inclusive of losses)	Kg/cm2 : *
	i. Speed Maximum/ Normal/Minimum	rpm : *
	j. Noise level	dB(A) : *
	k. Performance curve	: *

TD-106 Rev No. 00 Form No.		PRODUCT STANDARD PUMPS HYDERABAD		FP60317	
				Rev No. 03	
				Page 26 of 34	

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

5	CONSTRUCTION DATA				
a.	Manufacturer		:		
b.	Model No.		:	*	
c.	Suction Rating / Size		:	*	
d.	Discharge Rating / Size		:	*	
e.	Type of rotor		:	*	
f.	Size of rotor Dia	mm	:	*	
g.	Journal bearing: Type / Size:		:	*	
h.	Thrust bearing: Type / Size:		:	*	
i.	Bearing cooling required		:	Yes / No - Supplier to confirm	
j.	Cooling water required		:	Supplier to confirm the quantity	
k.	Type of drive		:	With Gearbox	
l.	Shaft seal		:	Mechanical	
m.	Size / Code		:	*	
n.	Type of coupling		:	*	
o.	Service factor		:	*	
p.	GD ² at drive shaft end		:	*	
q.	Rotation viewed from coupling end		:	Clock wise / Counter clock wise	
r.	Coupling type		:	Yes / No - Supplier to confirm	
s.	Coupling make		:	*	
t.	Base plate common to pump, Gearbox, bearing housing, coupling & Motor		:	Yes / No - Supplier to confirm	
u.	Total weight	kg	:	*	
v.	Maximum Erection weight	kg	:	*	
6	MATERIALS				
a.	Casing		:	*	
b.	Impeller		:	*	
c.	Shaft		:	*	
d.	Shaft Seal		:	*	
e.	Base frame		:	*	

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 27 of 34

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

7	INSPECTION AND TESTING		
	a. Material Test certificates required for : Casing, Impeller, shaft, shaft sleeve	:	[R] [O]
	b. DPT & MPI Test for impeller as applicable	:	[R] [O]
	c. Ultrasonic & Liquid penetrant test for shaft	:	[R] [O]
	d. Dimensional & visual inspection	:	[R] [W]
	e. Mechanical running test for 4 hrs.	:	[R] [W]
	f. Vibration test at rated speed	:	[R] [W]
	g. Performance test	:	[R] [W]
	h. Balancing test of Rotor Assembly	:	[R] [O]
	i. Noise level test	:	[R] [W]
	j. NPSH Test	:	[R] [W]
	k. Hydrostatic Test	:	[R] [W]
[R]: Required, [W]: Witnessed by BHEL/ end customer, [O]: Observed			

*: Supplier to provide

SIGNATURE OF SUPPLIER

NAME

DESIGNATION

TD-106 Rev No. 00 Form No.	 बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317	
				Rev No. 03	
				Page 28 of 34	

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
 It must not be used directly or indirectly in any way detrimental to the interest of the company.

23.2 Annexure-2, Schedule of guarantees

S.No	Description	Data
1.	Rated capacity of pump m³/hr	:
2.	Total head at design capacity m	:
3.	Guaranteed shaft power consumption at rated capacity & head kW	:
4.	Noise level at a distance of 1.0 meter from the equipment at site and 1.5 m above operating floor dB(A)	:
5.	Maximum vibration (peak to peak amplitude at site) microns	:
6.	Equipment Availability (%)	:
7.	Pump Efficiency (%)	:
8.	Life of Pump wear parts including, Casing liners, bearing etc Hours	≥25000 hours operation
9.	Scheduled Maintenance (Minor Overhauls): Recommended intervals between maintenance outages hours	>25000 hours operation.
10.	Scheduled Maintenance (Major Overhauls): Recommended intervals between maintenance outages shall be hours	>75000 hours operation.

SIGNATURE OF SUPPLIER

NAME

DESIGNATION

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD						FP60317																																									
								Rev No. 03																																									
								Page 29 of 34																																									
23.3 Annexure-3, Reference list (at least two power plant details) <table border="1"> <thead> <tr> <th>S.No</th> <th>Project Name , Customer & Plant capacity</th> <th>Coal fired Yes/No</th> <th>Wet Limestone Based FGD Yes/No</th> <th>Model</th> <th>Capacity m³/hr.</th> <th>Head m</th> <th>Speed rpm</th> <th>Year of Commissioning</th> <th>Qty</th> </tr> </thead> <tbody> <tr> <td>1</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>2</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>3</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> SIGNATURE OF SUPPLIER NAME DESIGNATION ----- ----- -----										S.No	Project Name , Customer & Plant capacity	Coal fired Yes/No	Wet Limestone Based FGD Yes/No	Model	Capacity m ³ /hr.	Head m	Speed rpm	Year of Commissioning	Qty	1										2										3									
S.No	Project Name , Customer & Plant capacity	Coal fired Yes/No	Wet Limestone Based FGD Yes/No	Model	Capacity m ³ /hr.	Head m	Speed rpm	Year of Commissioning	Qty																																								
1																																																	
2																																																	
3																																																	

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 30 of 34

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

23.4 Annexure-4, List of Deviations

S.No	Clause No	Page No	Description of Deviation

SIGNATURE OF SUPPLIER

NAME

DESIGNATION

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 31 of 34

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
 It must not be used directly or indirectly in any way detrimental to the interest of the company.

23.5 Annexure-5

23.5.1 Documents to be submitted along with offer

S.No.	Description	No of copies With proposal
1.	Duly signed Specification	1
2.	Price Sheet	1
3.	Anchor Plan & Civil foundation Loading details	1
4.	Data Sheet	1
5.	Performance curve, Motor T-S curve	1
6.	Pro-forma Packing List	1
7.	Manufacturing Time	1
8.	Approximate weight of each skid	1
9.	Reference plant details	1
10.	Required Electric power & other Utility List	1
11.	Deviation List	1
12.	General Assembly Drawing	1
13.	Pump and Motor Sizing Calculation	1
14.	Cross-sectional Drawing	1
15.	Sub-Vendor List	1
16.	Scope of Supply	1
17.	Quality Plan	1
18.	Spare List (Mandatory, Recommended)	1
19.	Start-up & Commissioning Spares	1
20.	List of Special Tools	1
21.	Delivery Schedule	1
22.	Test Arrangement & Test procedure	1
23.	Hoist/Crane requirement	1
24.	P & I Diagram	1
25.	Catalogue	1
26.		

SIGNATURE OF SUPPLIER

 NAME

 DESIGNATION

TD-106 Rev No. 00 Form No.	 बी एच ई एल BHEL HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD	FP60317
			Rev No. 03
			Page 32 of 34

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
 It must not be used directly or indirectly in any way detrimental to the interest of the company.

23.5.2 Documents to be submitted after award of contract

S.No.	Description	No of copies After award of contract	Delivery Time
1.	Utility Consumption	1	2 weeks after contract
2.	Foundation Data including Anchor plan	1	2 weeks after contract
3.	Performance curve	2	2 weeks after contract
4.	General arrangement drawing	1	1 month after contract
5.	Cross section detail drawing	1	1 month after contract
6.	Data Sheet	1	2 weeks after contract
7.	Lubricating oil list	1	2 months after contract
8.	Special tools list	1	2 months after contract
9.	Installation and assembly procedure	1	4 months after contract
10.	Inspection and Test Procedure	1	1 month after contract
11.	Inspection & Test record	1	In 2 weeks after test
12.	Inspection Certificate	1	In 2 weeks after test
13.	Sub vendors List	1	2 weeks after contract
14.	Manufacturing Schedule	1	2 weeks after contract
15.	Progress report	1	Every month
16.	Pro-forma Packing List	1	2 months prior to shipping
17.	Approximate weight of pump	1	2 months after contract
18.	Required Electric power	2	2 weeks after contract
19.	Pump and Motor Sizing Calculation	1	2 weeks after contract
20.	Material Test Certificates	2	In 2 weeks after test
21.	Pre Commissioning Check List	2	4 months after contract
22.	Scope of Supply	2	2 weeks after contract
23.	Quality Plan	4	1 month after contract
24.	Operation and Maintenance Manual	Hardcopies and soft copies as mentioned	4 months after contract
25.	Spare List (Mandatory, Recommended)	1	1 month after contract
26.	Start-up & Commissioning Spares	2	1 month after contract

TD-106 Rev No. 00 Form No.	 HYDERABAD	PRODUCT STANDARD PUMPS HYDERABAD		FP60317
				Rev No. 03
				Page 33 of 34

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

Ref Doc

S.No.	Description	No of copies After award of contract	Delivery Time
27.	List of Special Tools	1	1 month after contract
28.	Delivery Schedule	1	2 weeks after contract
29.	Test Arrangement & Test procedure	2	1 month after contract
30.	T-S curve	2	2 weeks after contract
31.	P & I Diagram	2	2 weeks after contract
32.	Catalogue	2	2 weeks after contract

SIGNATURE OF SUPPLIER _____

 NAME _____

 DESIGNATION _____

TD-106-3 Rev No. Form No.		PRODUCT STANDARD PUMPS HYDERABAD			FP60317
					Rev No. 03
					Page 34 of 34
RECORD OF REVISIONS					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED, It must not be used directly or indirectly in any way detrimental to the interest of the company.	Rev. No.	Date	Revision Details	Revised by	Approved By
	01	30.12.19	Technical parameters of Variant 02 added for Bhadradi TPP, 4x270MW. Scope of supply revised.	ASK	MSR
	02	07.02.20	Mandatory spares for Bhadradi TPP, 4x270MW added in variant table.	ASK	MSR
	03	13.02.20	Technical parameters of Variant 03 added for Bhusawal, 1x660MW.	ASK	MSR