

REQUEST FOR QUOTATION

	BHARAT HEAVY ELECTRICALS LIMITED Electronics Division PB No. 2606, Mysore Road Bangalore - 560026 INDIA	RFQ NUMBER: AKSPROP019 RFQ DATE : 22.07.2022	Due Date/Day: 03.08.2022 WED Time : 13:00 HRS
MMI:PU:RF:003			
(address for communication) :		(for all correspondence) Purchase Executive : ABHISHEK Phone : 26998102 Fax : 00918026989215 E-mail: singh.abhishek@bhel.in	

1) This RFQ is for entering into Rate contract (RC) with BHEL for the tendered item. Validity of the RC will be 1 year from the award of rate contract. Firm orders will be placed during the tenure of rate contract. Prices will remain firm till the validity of RC or till the completion of supplies against the Purchase Orders placed against this rate contract whichever is later. Please note that these quantities are projections based on the current business scenario and expected orders from customers. In the eventuality of business not coming through, BHEL is not obligated to exhaust the ordering of RC quantities.

2) Reverse Auction Clause: BHEL shall be resorting to Reverse Auction (RA) (Guidelines as available on www.bhel.com) for this tender. RA shall be conducted among all the techno-commercially qualified bidders. Price bids of all techno-commercially qualified bidders shall be opened and same shall be considered as initial bids of bidders in RA. In case any bidder(s) do(es) not participate in online Reverse Auction, their sealed envelope price bid along with applicable loading, if any, shall be considered for ranking.

Sl No.	Description	Qty	Unit	Delivery qty	Delivery Date
1	TI0668104333 Discharge Resistor 30KOhms + /-5% 2800VDC * HSN/SAC : 9032 DISCHARGE RESISTOR 30 kOhm + /-5% 2800Vdc As per Specification PS4452544 Rev No 01	500	NO	500	

Total Number of Items - 1

- 1.
- 2.

NOTES:

1. This RFQ is governed by:
 - a) INSTRUCTIONS TO BIDDERS/SELLERS and GENERAL CONDITIONS OF CONTRACT FOR PURCHASE available at <http://edn.bhel.com> (RFQ-PO Terms & Conditions)
 - b) Any other specific Terms and Conditions mentioned.

* The HSN/SAC no mentioned against the line items in the RFQ are indicative only.

For and On behalf of BHEL.

ABHISHEK
Control Equipment

1 OF 1



PREQUALIFICATION CRITERIA (PQC)
FOR EARTH RESISTOR
GROUP: TRACTION ENGINEERING

Ref: 445/PQ_ER/21

Rev. No.: 00

Page 1 of 1

1.0 PRE QUALIFICATION CRITERIA (PQC)

1. The Bidder should be Supplier of Power Resistor used in Traction applications.
2. BHEL shall approach and submit credentials/details furnished by vendor with their offers to customer and await customer's decision for a maximum of one month from the date of tender opening. If approval is not received within the above period, BHEL shall treat the offer as "Not meeting" Pre-qualification criteria and offer shall be rejected.
3. It is preferred that the bidder is the manufacturer of this item. If the bidder is importing some portion of the components, then minimum value addition shall be 20%. Bidder to confirm this in the offer. Value addition less than 20% is not acceptable

2.0 DOCUMENTS SUBMISSION

1. Bidder to submit clause by clause compliance to complete technical specification (Technical specification no. PS4452544 Rev. No.01, dated 22-12-2015) along with copy of type test report.
2. Should possess a valid type test report, not older than five years, conducted at a NABL accredited laboratory as per relevant standards mentioned in the specification with respect to time during the bid submission.
3. Proof of supply of Power Resistor used in traction applications directly or through any agency to Indian Railways during the last 5 years to be submitted.

3.0 REFERENCE DOCUMENTS

- a) Purchase Specification No PS4452544, Rev. No. 01 for Earth Discharge Resistor.

REVISION 00

APPROVED

AGOSH CHANDRAN R S

PREPARED

SUNITHA L

ISSUED

TRACTION ENGG

DATE

05.01.2020



A4 – 12

**PURCHASE SPECIFICATION FOR
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 00 OF 07

REVISION HISTORY SHEET

REV. NO.	DATE	NATURE OF CHANGE	REASONS	PREPARED BY	APPROVED BY
00	04.08.2015	FIRST ISSUE	--	SADAT	R.SHEKAR
01	22.12.2015	MAJOR	TYPE TEST CLAUSES MODIFIED	PURUSHOTTAMA	R.SHEKAR

THIS DOCUMENT IS A SPECIFICATION CUM DATA SHEET. VENDOR TO GIVE CONFIRMATIONS AND DATA AS REQUIRED AND SUBMIT THE SAME TO BHEL / EDN, BANGALORE. ANY DEVIATIONS TO THIS DOCUMENT TO BE BROUGHT OUT CLEARLY BY VENDOR.

Note:

Reference document :
Material Code :

REVISIONS 01 DT: 22.12.2015

APPROVED BY: R.SHEKAR

PREPARED BY:

ISSUED BY

DATE

TE

22.12.2015



A4 – 10

**PURCHASE SPECIFICATION FOR
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 01 OF 07

SPECIFICATION FOR DISCHARGE/EARTHING RESISTOR

Brief description

This resistor has two functionalities:

1. Global passive discharge of DC-link HV-capacitor
2. Earth fault detection

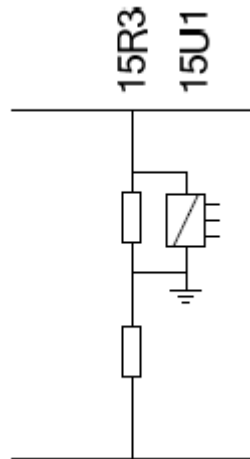


Fig1: Circuit Diagram

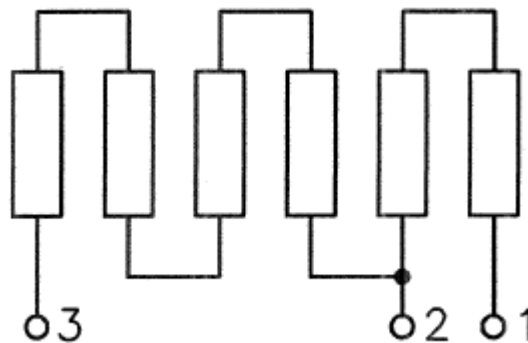


Fig2: Wiring Diagram



A4 – 11

**PURCHASE SPECIFICATION FOR
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 02 OF 07

Detailed Specification

1. Technical Parameters

a)	Nominal Resistance Value at 20°C (1-2)	:	10KΩ $\pm$ 5%
b)	Nominal Resistance Value at 20°C (1-3)	:	30KΩ $\pm$ 5%
c)	Maximum Voltage per Resistor	:	DC 3500 V
d)	Rated Voltage per Resistor	:	DC 2800V
d)	Insulation Test Voltage	:	AC 6900V/50Hz/1min
e)	Rated Power	:	3000W
f)	Maximum Temperature of the Resistive Material:		415°C
g)	Minimum Creeping Distance	:	75 mm
h)	Minimum Air Clearance	:	36mm
i)	Cooling	:	Natural Convection
j)	Degree of Protection	:	IP 20
k)	Total Weight of the Resistor	:	12 Kg $\pm$ 10%
m)	Thermal Capacity	:	5025 J/K
n)	Thermal Resistance	:	0.073 K/W
o)	Cooling Time Constant	:	360 s
p)	Material of Resistor Element	:	NiCr8020
q)	Material of Enclosure	:	AISI 304 (1.4301)

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in anyway detrimental to the interest of the company.



A4 – 11

**PURCHASE SPECIFICATION FOR
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 03 OF 07

2. Standards

Standard	Description	Notes
EN50125-1	Environmental conditions	
EN50124-1	Railway applications Isolation co-ordination, Basic requirements.	
IEC60077	Electric equipment for rolling stock	
IEC61287	Power converters	
IEC61376	Creepage and clearance	
IEC61373	Shock and vibration test	
IEC60322	Rules for ohmic resistors	

3. Functional requirements

Description	Value	Unit	Notes
operating hours traction converter	8640	hours/year	
operating hours resistor	8640	hours/year	normal operation

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in anyway detrimental to the interest of the company.



A4 – 11

**PURCHASE SPECIFICATION
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 04 OF 07

4. Ambient conditions / operating conditions

Description	Value	Unit	Notes
operation	-25..+75	°C	
temperature distribution over the year	+75	°C	10 days/year
	+65	°C	20 days/year
	+55	°C	90 days/year
	+40	°C	100 days/year
	< +40	°C	130 days/year
storage	-25..+70	°C	
average year temperature	+ 40	°C	
relative humidity	< 95	%	during app 3 - 4 months (rainy season) per year frequent condensation can occur
altitude	<1200	m	
pollution levels			
operation in coastal areas			
maximum PH	8.5		of water damp
max. concentration of sulphate	7	mg/liter	of water damp
max. concentration of chlorine	6	mg/liter	of water damp
maximum conductivity	130	µS/cm	of water damp
operation in desert terrain			
dust content in air	1.6	mg/m3	

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.



A4 – 11


**PURCHASE SPECIFICATION
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV.NO: 01

PAGE 05 OF 07

5. Dimensional details

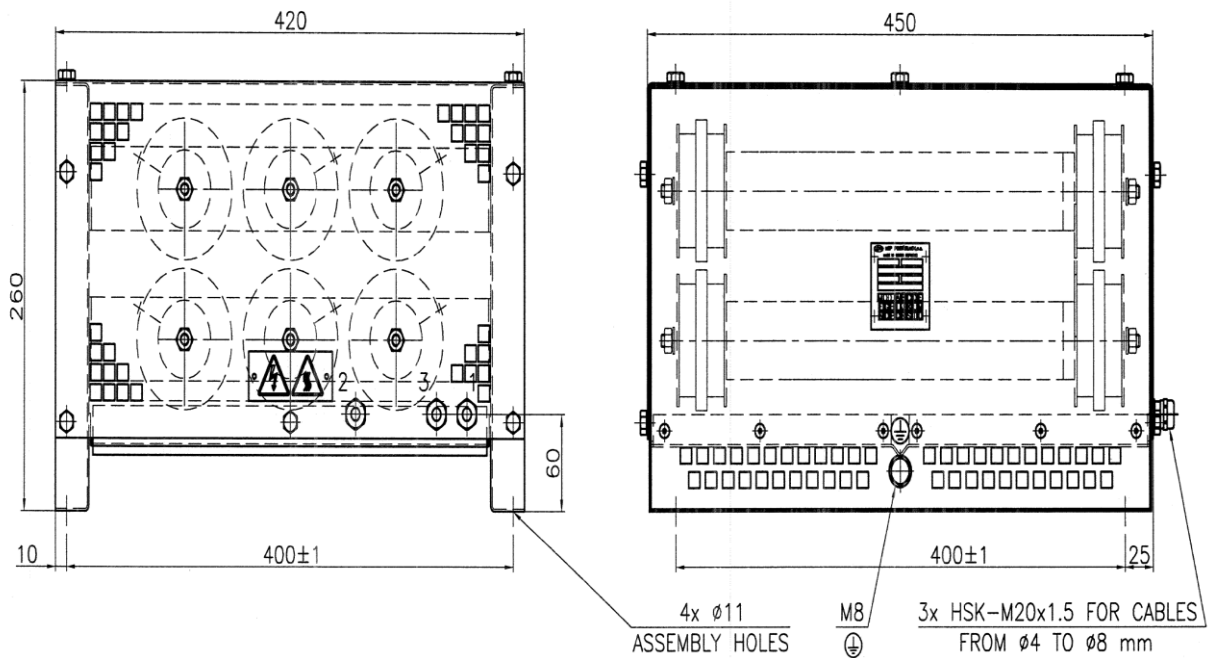

**DETAIL OF CONNECTING
TERMINAL
(part of resistor element)**




Fig3: Dimensional Drawing

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in anyway detrimental to the interest of the company.



A4 – 11

**PURCHASE SPECIFICATION
EARTH DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 06 OF 07

6. Testing

List of tests to be performed on prototype as follow

Sl No	Test	Acceptance criteria
1	Dimensional check	Dimensions to comply with drawing
2	Check on creepage and clearance distances	Min creepage 75mm and clearance 36mm
3	Check on rating label	Rating plate to have Make, Type no, Rated voltage, Rated Resistance, Sl no, year of manufacture and weight
4	Check on Ingress protection	The enclosure is IP 20 that means the cover protects against the incursion of foreign objects and is also used as a protection against accidental touch
5	Check on weight	12 Kg $\pm$ 10%. i.e. within range of 10.8 to 13.2 Kg
6	Measurement of Resistance	
6.1	Measurement of Resistance before temperature rise test	Between 1-2 10K Ω $\pm$ 10% Between 1-3 30K Ω $\pm$ 10%
6.2	Measurement of Resistance after temperature rise test	Readings should not differ from the first values indicated in clause 6.1 by more than 3%.
7	Check on Inductance	Measured inductance should be less than 5mH
8	Dielectric test	Carried out between the connection and earth terminals of the resistor with a voltage of AC 6900 V/ 50Hz/1 min. No flashover or breakdown occurred during the test
9	Insulation resistance test	The measurement to carried out with 1000 V megger tester connected across terminals and frame of the resistor. Required minimum value: 5 M Ω
10	Temperature rise tests ^{B)C)}	
10.1	Continuous power 3000W	Maximum Temperature of Active material $\leq$ 415 Deg Max temp of the connection terminals $\leq$ 125Deg Max Air temp 200mm above the resistor $\leq$ 95 Deg
10.2	Constant power at 2800 V and final single pulse of 5s ^{A)}	Between 1-2: Maximum Temperature of Active material $\leq$ 400Deg Between 2-3: Maximum Temperature of Active material $\leq$ 210Deg Between 1-2: Max temp of the connection terminals $\leq$ 135Deg Between 2-3: Max temp of the connection terminals $\leq$ 90Deg Between 1-2: Max Air temp 200mm above the resistor $\leq$ 100 Deg Between 2-3: Max Air temp 200mm above the resistor $\leq$ 100 Deg

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in anyway detrimental to the interest of the company.



A4 – 11

**PURCHASE SPECIFICATION
FOR EARTHY DISCHARGE RESISTOR
GROUP: TRACTION ENGINEERING**

P.S NO. : PS4452544

REV. NO: 01

PAGE 07 OF 07

Sl No	Test	Acceptance criteria
11	Vibration and shock withstand test ^{B)}	To be done as per the standard IEC 61373. No visual damage and no change in resistance value should occur. Also the specimen has to pass insulation test.

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in anyway detrimental to the interest of the company.

- A) This test has to be done in line with the procedure given below separately for terminals 1-2 and 2-3.
For conducting the test, constant power at 2800V needs to be applied between 1-2 terminals till the temperature stabilizes. During this time 2-3 terminals are open. After stabilization of temperatures, voltage will be increased to 3500V for 5sec.
The same procedure is repeated for the terminals 2-3 with 1-2 open terminals
- B) Visual inspection, Di electric test needs, measurement of cold resistance to be performed before and after the test.
- C) Critical hot spot points needs to be identified before the test to monitor and record the temperature during the test.