

ಭಾರತ್ ಹೆವಿ ಎಲೆಕ್ಟ್ರಿಕಲ್ಸ್ ಲಿಮಿಟೆಡ್ भारत हेवी इलेक्ट्रिकल्स लिमिटेड

Bharat Heavy Electricals Ltd., (A Government of India undertaking) Electronics Division

PB 2606, Mysore Road Bangalore, 560026 INDIA

CE: PR: 003- Rev 02

SPECIAL COMMERCIAL CONDITIONS OF CONTRACT

Reference is brought to BHEL's Instructions to Bidders (Document Ref: CE: PR: 001- Rev 05) and General Commercial Conditions for Contract (Document Ref: CE: PR: 002- Rev 03).

These two documents along with Special Conditions of Contract annexed to this RFQ will form an integral part of the contract as and when the RFQ culminates into a Purchase Order / Contract.

BHEL-EDN invites you to quote your best competitive prices as per the purchase specification. Kindly submit your quotation as a two-part bid in EPS portal: https://eprocurebhel.co.in/nicgep/app within Due-Date & Time as displayed in E-procurement website.

RFQ No. : ATLNIC0010

RFQ Date : As per E-procurement website RFQ Due Date : As per E-procurement website Project : Talcher TPS STAGE III (2 x 660MW)

Customer : M/s. NTPC

Item Description : VFD for 1200 KW, 3.3 KV Motor

Type of Bid: Two-Part Bid (Pre-Qualification Criteria + Techno-commercial bid: Part-I; Price-bid: Part-II)

Purchase Executives: Clarifications with regard to the tender shall be addressed to purchase officers whose email IDs are given below: sathishkumars@bhel.in or atulsood@bhel.in

Destination: Complete scope of items are to be directly despatched to BHEL site office/stores located at Talcher TPS STAGE III (2 x 660MW) site in TALCHER, DISTT. ANGUL, STATE OF ODISHA, INDIA, PIN - 759101.

Reverse Auction: Not applicable for this tender.

a. GeM Seller ID: _____

 <u>Indigenous scope of supply</u>: Ex-works,<indicate dispatch="" of="" station=""> (including Particular Forwarding charges but excluding Taxes).</indicate> 	acking &
<u>Under-mentioned details shall be provided against Indigenous supplies and services</u> :	

b.	If bidder is MSE vendo	r, is supporting document enclosed:	Yes /	'No

Detailed Consignee details will be issued by BHEL along with Despatch Clearance.

(If MSE, supporting document viz., Udyam certificate has to be enclosed)
c. GSTIN (no.) of place of supply: d. HSN (Harmonized System of Nomenclature) code:
Applicable tax and Rate:&
e. SAC (Service Accounting Code) no.:
Applicable tax and Rate:&
f GSTIN (no) of place of supply of service:

I. Bidder to mandatorily provide compliance/confirmation for the under-mentioned terms:

SL. NO.	TERMS	BHEL ACCEPTABLE TERM	BIDDER'S CONFIRMATION	REMARKS, if any
01	Delivery Period	Within 30 weeks from the date of issue of Manufacturing clearance along with approved document. Mandatory spares: Within 20 weeks from the date of issue of manufacturing clearance along with approved document Delay in contractual delivery will attract Penalty as per GCC Clause no.04.b. Note: i. Manufacturing clearance will be provided unit-wise as per the progress at respective project site/ unit. ii. The prescribed Delivery period is only indicative. Bidder is requested to quote the earliest and best	AGREEweeks (for main supply)weeks (for mand. spares)	uny
02	Terms of Payment at the time of	possible Delivery period if any, under the Remarks column. With reference to Clause:F of Instructions to Bidder, following is the BHEL standard Payment term:	AGREE	
	material supply	"100% of basic PO value with taxes and freight will be paid in 45 days from the date of dispatch or 15 days from the date of submission of complete set of documentation, whichever is later." Note: MSME vendors may opt to get payment through Trade Receivables electronic Discounting System (TReDS)	AGNEE	
03	Please provide Percentage of local content and details of location(s) at which the local value addition is made:	'Local content' means the amount of value added in India which shall, unless otherwise prescribed by the Nodal Ministry, be the total value of the item procured (excluding net domestic indirect taxes) minus the value of imported content in the item (including all customs duties) as a proportion of the total value, in percent. Note: Non-Local suppliers (i.e., local content < 20%) are not eligible to participate in this tender.	Percentage of local content:% Location(s) at which the local value addition is made:	

II. Bidder to note that Deviations shall not be permitted for the below mentioned terms and are deemed to be complied. In case of non-compliance/deviation, offer shall be liable for rejection:

- (1) Freight Charges: Freight charges for complete scope for total consignment up to project site shall be to vendor's account. Bidder to quote reasonable Freight charges along with applicable tax, in price bid.
- (2) Validity: The offer will be valid for a period of 90 days from the date of Part-I bid opening and in case of Negotiation/counter offer/RA, price validity will apply afresh for a period of 60 days from the date of according final price by bidder (or) up to original validity period, whichever is later.
- (3) Warranty period of the supplied products shall be applicable for a period of 18 months from the date of commissioning (or) 24 months from the date of dispatch of goods, whichever is earlier.
- (4) Evaluation criteria to determine L1 bidder: Items will not be split on item-wise lowest offer. Evaluation of the lowest bidder will be done as combined package basis. The Procuring Entity reserves its right to grant preferences to eligible Bidders under various Government Policies/ directives (policies relating to Make in India, MSME etc.)
 - a. Preference to Micro & Small Enterprises (MSEs): Purchase preference will be given to MSEs as defined in *Public Procurement Policy* for Micro and Small Enterprises (MSEs) Order, 2012 dated 23.03.2012 issued by Ministry of MSME (and its subsequent Orders/Notifications issued by concerned Ministry) & the latest *Office Memorandum* issued by Department of Expenditure dt:18.05.2023.
 - If the bidder wants to avail the Purchase preference, the bidder must be the manufacturer of the offered product in case of bid for supply of goods. Traders are excluded from the purview of Public Procurement Policy for Micro and Small Enterprises. Relevant documentary evidence in this regard shall be uploaded along with the bid in respect of the offered product.
 - <u>b.</u> <u>Preference to Make in India (MII) products</u>: Preference shall be given to Class 1 local supplier as defined in public procurement (Preference to Make in India) order 2017 as amended from time to time (and its subsequent Orders/Notifications issued by concerned Nodal Ministry for specific Goods/Products) & the latest *Office Memorandum* issued by Department of Expenditure dt:18.05.2023.

('Class-I local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, has local content equal to or more than 50%, as defined under Public procurement order no.P-45021/2/2017-PP (BE-II) dt: 16.09.2020 & revision dt: 19-07-2024.

'Class-II local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, has local content equal to or more than 20% but less than 50%, as defined under Public procurement order no.P-45021/2/2017-PP (BE-II) dt: 16.09.2020 & revision dt: 19-07-2024.

In the event of any Nodal Ministry prescribing higher or lower margin of purchase preference and/or higher or lower percentage of local content in respect of this procurement, same shall be applicable.'}

Penal provisions for false self-declaration of MII, in case of Contract more than Rs.10Crs.

For contract valuing more than Rs.10 Crores, local content (in case of self-declaration certification submitted by bidders at the time of tendering), the contractor/ supplier shall be required to give local content certification duly certified by cost/chartered accountant in practice, within 120 days from the date of release of the Purchase order by BHEL. In case the contractor/ supplier does not meet the stipulated local content requirement and the category of the supplier changes from Class-I to Class-II/Non-local or from Class-II to Non-local, a penalty upto 10% of the contract value may be imposed. However, contract once awarded shall not be terminated on this account.

Default margin of purchase preference shall be 20% to local suppliers with default minimum local content of 50%.

Operation methodology of Purchase preference clause to MSE & MII bidders is as detailed under clause:4.c.b) in the Office Memorandum issued by Department of Expenditure dt:18.05.2023 (ref. Annexure-VIII of ITB).

"For this procurement, the local content to categorize a supplier as a Class I local supplier/ Class II local Supplier/ Non local supplier and purchase preference to Class I local supplier, is as defined in Public Procurement (Preference to Make in India), Order 2017 dated 19.07.2024 issued by DPIIT. In case of subsequent orders issued by the nodal ministry, changing the definition of local content for the items of the NIT, the same shall be applicable even if issued after issue of this NIT, but before opening of Part-II bids against this NIT"

<u>Note</u>: In case of negotiations, the margin of purchase preference (20% for Class-I Non-MSE or 15% for MSE) shall be based on pre-negotiated L1 price and the eligible Class-I & MSE local bidder will have to match the negotiated L1 price.

(5) <u>Performance security</u>: Performance Bank Guarantee (PBG) or Security Deposit (SD), hereafter referred as performance security has to be submitted by successful bidder for 05% of the contract value.

PBG has to be furnished within 05 weeks after notification of the award and it should remain valid for a period of 60 days beyond the date of completion of all contractual obligations, including warranty obligations.

The PBG shall be denominated in the currency of the Contract. The PBG shall be returned to the supplier, without payment of any interest, on successful completion of all the contractual formalities.

Refer Clause "H" of Instructions to Bidders. Also note that PBG should be in the format specified in Annexure-VII of ITB and no deviation to this format will be allowed.

In case of breach of contract (failure of supplier), wherever the value of Performance security available with BHEL against the said contract is at least 10% of the contract value, the same shall be encashed. In case the value of the security instruments available is less than 10% of the contract value, the balance amount shall be recovered from other financial remedies (i.e. available bills of the contractor, retention amount, etc. with BHEL) or legal remedies be pursued.

(6) Submission of documents post PO viz., preliminary datasheet/drawing, sizing calculation etc. as indicated in CI: 04 of GCC: Within 28 days from the date of receipt of PO. Delay in the submission of complete set of specified documents in NIT, will attract Penalty as per GCC Clause no.04.a).

(7) **Despatch Documents:** Complete set of despatch documents (original + 1 photocopy set) as per Purchase Order shall be forwarded to Purchase Executive/BHEL directly.

Despatch documents shall include but not limited to the following documents:

Invoice (01 original and 01 copy with original sign & seal / digitally signed invoice), Lorry Receipt (L/R), Packing List, NIL Short-Shipment Certificate, Warranty Certificate, insurance intimation letter, Proof of Delivery on L/R, E-way bills (Part-A&B) etc.

One set of Invoice, L/R, Packing List & E-way bills (Part-A&B) shall be e-mailed to BHEL-EDN immediately after despatch.

Note: Detailed Packing List should indicate package-wise content details and also Net & Gross weight of each package.

(8) Erection Supervision & Commissioning:

Range of procurement value	Minimum percentage of basic material value proposed for Erection Supervision & Commissioning charges
Up to Rs. 2.50 crs.	05%
Greater than Rs. 2.50 crs. and lesser than	03% (or) Rs.12.50 lakhs, whichever is
Rs. 10 crs.	higher.
Greater than Rs. 10 crs. and lesser than Rs.	
20 crs.	02% (or) Rs.30 lakhs, whichever is higher.
	01.50% (or) Rs.40 lakhs, whichever is
Greater than Rs. 20 crs.	higher.

Depending on the material quotation value, the bidder will have to quote the corresponding Erection Supervision & Commissioning charges for the respective slab/range as per above table. In case the quoted total Erection Supervision & Commissioning value is less than above stipulated charges, BHEL shall evaluate Bidders offered Price deducting differential amount from main supply price (excluding mandatory spares, training charges) and apportioning towards Erection Supervision & Commissioning charges.

<u>Payment terms for E&C charges</u>: 100% payment (on per-diem basis), will be paid in 15 days from the date of submission of supplementary invoice/documents against proof of successful completion of installation & commissioning duly certified by Engineer-in-charge. Contractor's payment is subject to TDS, TCS as per applicable act of Govt.

(9) Based on the under-mentioned declarations in company letterhead of Bidder as insisted under Rule 144(Xi) of General Financial Rules,2017 amendment dt 24.02.2023, eligibility of offer will be ascertained in the tender:

"I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India; I certify that our firm is not from such a country or, if from such a country, has been registered with the Competent Authority. I hereby certify that our firm fulfils all requirements in this regard and is eligible to be considered."

<u>Note</u>: Wherever applicable, evidence of valid registration by the Competent Authority shall be attached.

Additional declaration by Bidder in the cases of specified Transfer of Technology (ToT):

"I have read the clause regarding restrictions on procurement from a bidder having Transfer of Technology (ToT) arrangement. I certify that our firm does not have any ToT arrangement requiring registration with the Competent Authority."

OR

"I have read the clause regarding restrictions on procurement from a bidder having Transfer of Technology (ToT) arrangement. I certify that our firm has valid registration to participate in this procurement."

- (10) Integrity Pact: Execution of Integrity Pact is applicable for this tender (Refer clause "K" of Instructions to Bidders). The IP as enclosed with the tender is to be submitted (duly signed by authorized signatory who signs in the offer) along with Part-I bid. Only those Bidders who have entered into such an IP with BHEL would be competent to participate in the bidding. In other words, entering into this Pact would be a preliminary qualification.
 - (11) It is the obligation on the part of supplier to discharge his liability by payment of GST to Government of India in cash (or) utilization of input Tax credit in respect of such supply or services through GST invoice under this contract, so that BHEL will avail input tax credit on such supply. In the event that the input tax credit of the GST charged by the supplier is denied by the tax authorities to BHEL due to reasons attributable to supplier, BHEL shall be entitled to recover such amount from the supplier by way of adjustment from the next invoice or from Bank Guarantee. In addition to the amount of GST, BHEL shall also be entitled to recover interest and penalty, in case same is imposed by the tax authorities on BHEL.

If BHEL is not able to avail the credit of CGST & SGST/IGST, partially or entirely because the supplier issued a defective invoice or failed to produce the requisite documents, then the supplier shall immediately indemnify BHEL for such loss of tax credit which would be otherwise available to BHEL. BHEL, in such case, may, at its sole discretion, decide to recover such loss by way of deduction from payment due to the supplier or invoking the contract Performance Bank Guarantee.

The classification of goods as per GST should be correctly done by the supplier to ensure that ITC benefit is not lost to the BHEL on account of any error on the part of the supplier.

Any statutory increase in taxes and duties (i.e GST) or introduction of new taxes and duties within the Contractual Delivery Period shall be to BHEL's account and shall be reimbursed against documentary evidence. However, any statutory increase in taxes and duties (i.e GST) or introduction of new taxes and duties beyond the Contractual Delivery Date shall be borne by BHEL to the extent documents are passed on to BHEL and BHEL is in the position to get the claim from the authorities. Any corresponding decrease on account of above shall be passed on to BHEL.

Any variation in CGST & SGST / IGST at the time of supplies for any reason other than statutory, including variations due to turnover, shall be borne by supplier.

In case GST or any taxes or duties is not applicable at present but become applicable at the time of contractual delivery period due to any reason other than statutory, the same shall be borne by supplier

With this, we hereby confirm that all the terms & conditions as indicated in Instructions to Bidders (Document Ref: CE: PR: 001- Rev 05) & General Commercial Conditions for Contract (Document Ref: CE: PR: 002- Rev 03) are also accepted without any deviation.

Vendor's Signature with Seal

Note: The above filled-in document shall be furnished as a part of Techno-commercial (i.e., Part-I) bid.



ಭಾರತ್ ಹೆವಿ ಎಲೆಕ್ಟ್ರಿಕಲ್ಸ್ ಲಿಮಿಟೆಡ್ भारत हेवी इलेक्ट्रिकल्स लिमिटेड

Bharat Heavy Electricals Ltd., (A Government of India undertaking) Electronics Division

PB 2606, Mysore Road Bangalore, 560026 INDIA

CE:PR:001- Rev 05

INSTRUCTIONS TO BIDDERS

Bidder is requested to read the instructions carefully and submit their quotation taking into consideration of all the points:

A. GENERAL INSTRUCTIONS:

- Any Purchase Order resulting from this enquiry shall be governed by the Instructions to Bidders (document reference: CE: PR: 001 – Rev 05), General Conditions of Contract (document reference: CE: PR: 002 - Rev 03) and Special Conditions of Contract, if any, of the enquiry. If any term mentioned in Special Conditions of Contract (SCC) contradicts relevant clause in either Instructions to Bidders (ITB) or General Conditions of Contract (GCC), the term mentioned in SCC will supersede the corresponding term in ITB / GCC.
- 2. Any deviations from or additions to the "General Conditions of Contract" or "Special Conditions of Contract" require BHEL's express written consent. The general terms of business or sale of the bidder shall not apply to this tender.
- 3. Regret letter (either through post or by mail or by EPS) indicating reasons for not quoting must be submitted without fail, in case of non-participation in this tender.
 - Supplier shall be liable for removal as a registered vendor of BHEL when the supplier fails to quote against four consecutive tender enquiries for the same item or all enquiries in last two years for the same item, whichever is earlier.
- 4. Procurement directly from the manufacturers is preferred. However, if the OEM/ Principal insist on engaging the services of an agent, such agent shall not be allowed to represent more than one manufacturer/ supplier in the same tender.
 - Moreover, either the agent could bid on behalf of the manufacturer/ supplier or the manufacturer/ supplier could bid directly but not both. Agent/Representative authorized by the OEM/Principal in turn cannot further sub authorize any other firm for submitting the offer or for placement of order.
 - In case bids are received from the manufacturer/ supplier and his agent, bid received from the agent shall be ignored.
- 5. Consultant / firm (and any of its affiliates) shall not be eligible to participate in the tender/s for the related goods for the same project if they were engaged for consultancy services for the same project.
- 6. If an Indian representative/associate/liaison office quotes on behalf of a foreign based bidder, such representative shall furnish the following documents:
 - a. Authorization letter to quote and negotiate on behalf of such foreign-based bidder.
 - b. Undertaking from such foreign based bidder that such contract will be honored and executed according to agreed scope of supply and commercial terms and conditions.

- c. Undertaking shall be furnished by the Indian representative stating that the co-ordination and smooth execution of the contract and settlement of shortages/damages/replacement/repair of imported scope till the equipment is commissioned and handed over to customer will be the sole responsibility of the Indian representative/associates/agent/liaison office.
- d. Refer Annexure I on "Guidelines for Indian Agents".
- 7. In case of imported scope of supply, customs clearance & customs duty payment will be to BHEL account after the consignment is received at Indian Airport /Seaport. Bidders must provide all original documents required for completing the customs clearance along with the shipment.
 - Warehousing charges due to incomplete or missing documentation will be to supplier's account. All offers for imported scope of supply by air, must be made from any of the gateway ports (within the country) indicated (Refer Annexure II).
- 8. The offers of the bidders who are on the banned list and also the offers of the bidders, who engage the services of the banned firms, shall be rejected. The list of the banned firms is available on BHEL website: http://www.bhel.com/vender_registration/vender.php
- 9. Business dealings with bidders will be suspended if they are found to have indulged in any malpractices/misconduct which are contrary to business ethics like bribery, corruption, fraud, pilferage, cartel formation, submission of fake/false/forged documents, certificates, information to BHEL or if they tamper with tendering procedure affecting the ordering process or fail to execute a contract, or rejection of 3 consecutive supplies or if their firms / works are under strike/lockout for a long period. Bidder may refer "Guidelines for Suspension of Business Dealings with Suppliers/ Contractors" available on www.bhel.com for more details.
 - The Bidder declares that they will not enter into any illegal or undisclosed agreement or understanding, whether formal or informal with other Bidder(s). This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process. In case, the Bidder is found having indulged in above activities, suitable action shall be taken by BHEL as per extant policies / guidelines.
- 10. The bidder along with its associate/collaborators/sub-contractors/sub-vendors/consultants/service providers shall strictly adhere to BHEL Fraud Prevention Policy displayed on BHEL website http://www.bhel.com and shall immediately bring to the notice of BHEL Management about any fraud or suspected fraud as soon as it comes to your notice.
- 11. Offer is to be submitted in English language only.
- 12. For this procurement, the local content to categorize a supplier as a Class-I local supplier/ Class-II local supplier/ Non-local supplier and purchase preference to Class-I local supplier, is as defined in Public procurement (Preference to Make in India), Order 2017 dated 16.09.2020 issued by DPIIT.
 - In case of subsequent Orders issued by the Nodal Ministry, changing the definition of local content for the items of the NIT, the same shall be applicable even if issued after issue of this NIT, but before opening of price bids against this NIT. Default margin of purchase preference shall be 20% for Class-I local supplier only.
- 13. The Bidder shall mandatorily submit Declaration as mentioned under Rule 144(xi) of General Financial Rules, 2017 amendment dt 23.07.2020 issued by Ministry of Finance, Govt. of India. Where applicable, evidence of valid registration by the Competent Authority shall be attached.

The Competent Authority for the purpose of registration under this Order shall be the Registration Committee constituted by the Department for Promotion of Industry and Internal Trade (DPIIT). Refer Annexure-IX for 'Restrictions under Rule 144(Xi) of General Financial Rules, 2017 amendment dt: 23.07.2020'.

B. GUIDELINES FOR PREPARATION OF OFFER:

- 1. Quotation shall be submitted in Single Part Bid, Two Part Bid or Three Part Bid, as called for in the tender:
 - **SINGLE PART BID**: Technical and Commercial Bid with prices along with price summary & filled in BHEL Standard Commercial terms and conditions in a single sealed envelope.
 - TWO PART BID: Unpriced offer i.e. "Techno-commercial Bid" with filled in BHEL Standard Commercial terms and conditions in a sealed envelope along with the copy of the "Price Bid" without the prices should be enclosed in one cover and the cover must be super scribed "Techno-commercial offer) and Priced offer i.e. "Price Bid "containing price summary in a separate sealed envelope and must be super scribed "Price Bid".

Both these envelopes shall be enclosed in a single sealed envelope superscribed with enquiry number, due date of tender and any other details as called for in the tender document.

• THREE PART BID: Pre-qualification Bid (Part-I), Techno Commercial Bid with filled in BHEL Standard Commercial terms and conditions (Part-II), and Price Bid (Part-III). All three envelopes shall be enclosed in a single sealed envelope superscribed with enquiry number, due date of tender and any other details as called for in the tender document.

If any of the offers (Part I, Part II or Part III) are not submitted before the due date and time of submission (or) if any part of the offer is incomplete, the entire offer of the bidder is liable for rejection.

- Supplier shall ensure to superscribe each envelope with RFQ number, RFQ Date, RFQ Due date and time, Item
 Description and Project clearly & boldly. Also mention on the envelope whether it is "Techno Commercial Bid"
 or "Price Bid" or "Pre-Qualification Bid".
 - Please ensure complete address, department name and purchase executive name is mentioned on the envelope (before dropping in the tender box or handing over) so that the tender is available in time for bid opening.
- 3. BHEL standard Commercial Terms and Conditions (duly filled, signed & stamped) must accompany Technical-Commercial offer without fail and should be submitted in original only.
 - The above indicated submission of Offers in "sealed envelope/hard copy" as mentioned in points B.1-B.3 is applicable for tenders that are not floated through E-Procurement System (EPS).
- 4. Validity: Unless otherwise specified in SCC (special commercial conditions of contract), the offer will be valid for a period of 90 days from the date of part-I bid opening and in case of Negotiation/Counter-offer/Reverse Auction, price validity will apply afresh for a period of 60 days from the date of according final price by bidder (or) up to original validity period, whichever is later.
- 5. Any of the terms and conditions not acceptable to supplier, shall be explicitly mentioned in the Techno-Commercial Bid.
 - If no deviations are brought out in the offer it will be treated as if all terms and conditions of this enquiry are accepted by the supplier without deviation.

- 6. Deviation to this specification/item description, if any, shall be brought out clearly indicating "DEVIATION TO BHEL SPECIFICATION" without fail, as a part of Techno-Commercial Bid.
 - If no deviations are brought out in the offer it will be treated as if the entire specification of this enquiry is accepted without deviation.
- 7. Suppliers shall submit one set of original catalogue, datasheets, bill of materials, dimensional drawings, mounting details and/or any other relevant documents called in purchase specification as part of Technical Bid.
- 8. "Price Bid" shall be complete in all respects containing price break-up of all components along with all applicable taxes and duties, freight charges (if applicable) etc. Once submitted no modification / addition / deletion will be allowed in the "Price Bid." Bidders are advised to thoroughly check the unit price, total price to avoid any discrepancy.
- 9. In addition, bidder shall also quote for erection & commissioning charges/erection supervision & commissioning charges (E&C service charges), documentation charges, testing Charges (type & routine), training charges etc. if & as applicable along with corresponding tax. The price summary must indicate all the elements clearly.
- 10. Wherever applicable, bidders should indicate "lumpsum" Erection and Commissioning (or) Erection Supervision and Commissioning charges, as applicable (including To & Fro Fare, Boarding, Lodging, Local Conveyance etc.) for carrying out E&C activity and further handing over to customer.
 - The quotation shall clearly indicate scope of work, likely duration of commissioning, pre-commissioning checklist (if any).
- 11. Wherever bidders require PAC (Project Authority Certificate)/applicable certificates for import of raw materials, components required for DECC, EPCG Power Projects, Export Projects or other similar projects wherein supplies are eligible for customs duty benefits, lists and quantities of such items and their values (CIF) has to be mentioned in the offer. Prices must be quoted taking into account of such benefits.
- 12. Prices should be indicated in both figures & words. Bid should be free from correction/overwriting, using corrective fluid, etc. Any interlineation, cutting, erasure or overwriting shall be valid only if they are attested under full signature(s) of person(s) signing the bid else bid shall be liable for rejection.
 - Any typographical error, totalling mistakes, currency mistake, multiplication mistake, summing mistakes etc. observed in the price bids will be evaluated as per **Annexure III** "Guidelines for dealing with Discrepancy in Words & Figures quoted in price bid" and BHEL decision will be final.
- 13. Documents submitted with the offer shall be signed and stamped in each page by authorized representative of the bidder. However, this requirement is not mandatory for offers uploaded through E-Procurement System (EPS).

C. <u>GUIDELINES FOR OFFER SUBMISSION:</u>

The under-mentioned clauses 1, 2&3 will not be applicable for EPS tenders.

 Offers / Quotations must be dropped in tender box before 13.00 Hrs. on or before due date mentioned in RFQ.The offers are to be dropped in the proper slot of the Tender Box kept in our reception area with caption "CE, SC&PV, DEFENCE".

Tenders are opened on 3 days in a week (Monday/Wednesday/Friday). Tender must be deposited in the slot corresponding to the day (Monday - Box no.4/Wednesday - Box no. 6 /Friday - Box no.8) while depositing the offer.

- 2. E-Mail/ Internet/EDI offers received in time shall be considered only when such offers are complete in all respects. In case of offers received through E-mail, please send the offer to the email ID specified in the SCC document of the tender.
- 3. Offers of Vendors who already have a valid Technical/Commercial MOU with BHEL-EDN for the items of the RFQ shall mention the relevant MOU reference no. and give only such other details not covered in the MOU.
- 4. In cases where tender documents are bulky, or due to some reasons tender documents are required to be submitted by hand or through posts/couriers, the offers are to be handed over either of the two purchase officers whose names are mentioned in the SCC document of tender RFQ.
- 5. Tenders will be opened on due date, time and venue as indicated in the RFQ in the presence of bidders at the venue indicated in the RFQ. For EPS tenders, e-mail notifications will be automatically generated and forwarded to registered e-mail ID/s of bidders during opening of tenders.
- 6. Bidder will be solely responsible:
 - a. For submission of offers before due date and time. Offers submitted after due date and time will be treated as "Late offers" and will be rejected.
 - b. For submission of offers in the correct compartment of the tender box based on the day of due date (Monday/Wednesday/Friday). Please check before dropping your offer in the correct tender box.
 - c. For depositing offers in proper sealed condition in the tender box. If the bidder drops the tender in the wrong tender box (or) if the tender document is handed over to the wrong person, BHEL will not be responsible for any such delays.
 - d. For offers received through email etc., suppliers are fully responsible for lack of secrecy on information and ensuring timely receipt of such offers in the tender box before due date & time (This clause will not be applicable for EPS tenders).

The above indicated submission of Offers as mentioned in points 6.a-6.d is applicable for tenders that are not floated through EPS.

e. In case of e-tender, all required documents should be uploaded before due date and time. Availability of power, internet connections, system/software requirements etc. will be the sole responsibility of the bidder.

Wherever assistance is needed for submission of e-tenders, help-line numbers as available in the website of service provider of BHEL may be contacted.

Purchase Executive/ BHEL shall not be responsible for any of the activities relating to submission of offer.

D. PROCESSING OF OFFERS RECEIVED:

- 1. Any discount/ revised offer submitted by the supplier on its own shall be accepted provided it is received on or before the due date and time of offer submission (i.e. Part-I bid).
 - The discount shall be applied on pro-rata basis to all items unless specified otherwise by the bidder.
- 2. Changes in offers or Revised offers given after Part-I bid opening shall not be considered as a part of the original offer unless such changes/revisions are requested by BHEL.

- In case of withdrawal of any Technical/Commercial deviation(s) by the bidder before opening of price bids/conducting the Reverse Auction, revision of price/impact bid will not be accepted.
- In case there is no change in the technical scope and/ or specifications and/ or commercial terms & conditions, the supplier will not be allowed to change any of their bids after Technical bids are opened (after the due date and time of tender opening).
- 4. In case of changes in scope and/ or technical specifications and/ or commercial terms & conditions by BHEL and it accounts for price implications from bidders, all techno-commercially acceptable bidders shall be asked by BHEL (after freezing the scope, technical specifications and commercial terms & conditions) to submit the impact of such changes on their price bid.
 - Impact price will be applicable only for changes in technical specification / commercial conditions by BHEL. The impact price must be submitted on or before the cut-off date specified by BHEL and the original price bid and the price impact bid will be opened together at the time of price bid opening.
- 5. Un-opened bids (including price bids) will be returned to the respective bidders after release of Purchase order.
 - Regarding Offers for EPS tenders that get rejected on PQC/ techno-commercial grounds, the bids for the subsequent parts will not be opened i.e., both technical bid and price bid (Parts-II & III) will not be opened in case of rejection on PQC ground and price bid (Part-II/Part-III, as applicable) will not be opened in case of rejection on techno-commercial ground.
- 6. After receipt of Purchase Order, supplier should submit required documents viz., specified drawings, bill of materials, datasheets, catalogues, quality plan, test procedure, type test report, O & M Manuals and/or any other relevant documents as per Specification/Purchase Order, as and when required by BHEL/Customer.
- 7. Any deviation to the terms and conditions not mentioned in the quotation by supplier in response to this enquiry will not be considered, if put forth subsequently or after issue of Purchase Order, unless clarification is sought for by BHEL and agreed upon in the Purchase Order.
- 8. Evaluation shall be on the basis of delivered cost (i.e. "Total Cost to BHEL").

"Total Cost to BHEL" shall include total basic cost, packing & forwarding charges, taxes and/or duties (as applicable), freight charges, taxes on Services, customs clearance charges for imported items, any other cost indicated by bidder for execution of the contract and loading factors (for non-compliance to BHEL Standard Commercial Terms & Conditions).

Benefits arising out of Nil Import Duty on DEEC, EPCG, DFIA Projects, Physical Exports or such 100% exemptions (statutory benefits), project imports, customer reimbursements of statutory duties (like Basic Customs Duty and cess on customs duty), Input tax credits as applicable will also be taken into account for arriving at the Total cost to BHEL (wherever applicable and as indicated in SCC document of tender).

For EPS tenders, it shall be noted that the prices (including discounts) vis-a-vis currency quoted in EPS portal only will be considered as Final for the purpose of evaluation of the lowest bidder.

Bidder shall ensure to indicate the applicable taxes against each line item in online portal, failing to which the same will be considered as inclusive/NIL.

In the course of evaluation, if more than one bidder happens to occupy L-1 status, effective L-1 will be decided by soliciting discounts from the respective L-1 bidders.

Incase more than one bidder happens to occupy the L-1 status even after soliciting discounts, the L-1 bidder shall be decided by a toss/draw of lots, in the presence of the respective L-1 bidder(s) or their representative(s).

Ranking will be done accordingly. BHEL's decision in such situations shall be final and binding.

9. The evaluation currency for this tender shall be INR. For evaluation of offers in foreign currency, the exchange rate (TT selling rate of SBI) shall be taken as under:

Single part bids: Date of tender opening

Two/three part bids: Date of Part-I bid opening

Reverse Auction: Date of Part-I bid opening

In case of Performance Bank Guarantee (PBG) also, exchange rate will be considered as mentioned above for converting foreign currency to Indian currency and vice versa.

If the relevant day happens to be a bank holiday, then the exchange rate as on the previous working day of the bank (SBI) shall be taken.

- 10. Ranking (L-1, L-2 etc.) shall be done only for the techno-commercially acceptable offers.
- 11. GeM Seller ID shall be mandatory before placement of order/award of contract for goods and services to the successful bidder(s), for orders exceeding Rs.25 lakhs (including all taxes etc.). Department of Expenditure (DoE) OM no.6/9/2020-PPD dated: 24.08.2020 may be referred in this regard.

E. INFORMATION ON PAYMENT TERMS:

- 1. All payments will be through Electronic Fund transfer (EFT). Vendor has to furnish necessary details as per BHEL standard format (Refer Annexure IV) for receiving all payments through NEFT. (Applicable for Indian vendors only).
- 2. In case of High Sea Sales transaction, customs clearance of the consignment landed on Indian Sea/Air ports will be done by BHEL based on the original HSS documents provided by vendors.
 - All warehousing charges due to delay in submission of complete and or correct HSS documents to BHEL will be to supplier's account only. Such recovery will be made out of any of the available bills (Refer Annexure V).
- 3. Statutory deductions, if any, will be made and the deduction certificate shall be issued.
 - A. In case vendor does not provide PAN details, the TDS deduction shall be at the maximum percentage stipulated as per the provisions of Income Tax Act.
 - In addition to the above, Foreign vendors shall also submit relevant details of their bankers like Swift Code, Banker's Name &Address etc.
 - B. TDS deduction as per section 51 of CGST Act,2017 shall be applicable as per Gazette Notification No. 50/2018-Central Tax, Dated: 13th September 2018 and subsequent notification/s, as and when released by Govt. authorities.
- 4. Procurement of Goods/ Works/ Services/ Consultancy Services [under clause relating to "Income Tax and Corporate Tax" or "TDS"]
 - a) Provision w.r.t. TDS on Purchase of Goods under section 194Q of Income Tax Act applicable from 01.07.2021 is as under:
 - i. TDS as applicable will be deducted by BHEL under section 194Q of the Income Tax Act, 1961 on Purchases exceeds, the amount of Rupees. 50 Lakhs or limit defined therein from time to time during the financial year under the Indian Income Tax act 1961.

- ii. Since BHEL is liable to deduct Income Tax TDS under section 194Q, the provision of TCS as per section 206C(1H) of the Income Tax Act, 1961 shall not be applicable.
- b) Higher rate of TDS for non-filers of ITR as per Section 206AB of Income Tax Act, 1961, in case of any vendor who does not filed their Income Tax Return for both of the two previous years preceding to current year and aggregate amount of TDS is more than or equal to Rs. 50,000/- in each of those previous two years (or limit defined by Govt. from time to time), then TDS will be deducted at the higher of following rates:
- (i) Twice the rate mentioned in relevant TDS section.
- (ii) Twice the rate or rates in force
- (iii) 5%.
- 5. Incomplete documentation will not be accepted. Delayed submission of invoice / documents may result in corresponding delay in payment. In this connection, request to also refer clause: G about invoicing & payment formalities under GST regime.

Applicable documents shall be submitted to the purchaser at the time of execution of supplies/services for availing GST input credits.

F. STANDARD PAYMENT TERMS OF BHEL-EDN:

PURCHASE	SUPPLY WITH SERVICE(S)	SUPPLY ONLY
ORDERS FOR:		
<u>INDIGENOUS</u>	a. 100% of basic value with taxes and freight will be	b. 100% of PO value with taxes and
<u>PROCUREMENT</u>	paid in 45 days from the date of dispatch or 15 days	freight will be paid in 45 days from the
	from the date of submission of complete set of	date of dispatch or 15 days from the
	documentation, whichever is later.	date of submission of complete set of
		documentation, whichever is later.
	Note: In case PBG is not furnished, only 90%	
	payment will be released against 100% claim without	
	the consent of Vendor. This 10% basic amount	
	withheld towards PBG will be paid either against	
	submission of supplementary invoice & Original PBG	
	(or) against supplementary invoice without PBG after	
	expiry of Warranty period.	
IMPORT	c. 100% of basic value will be paid against usance	d. 100% of PO value will be paid
PROCUREMENT	draft of 45 days from the date of AWB/BOL on	against usance draft of 45 days from
	submission of complete set of documents.	the date of AWB/BOL on submission of
		complete set of documents.
	Note: In case PBG is not furnished, only 90%	complete set of accuments.
	payment will be released against 100% claim without	
	the consent of Vendor. This 10% basic amount	
	withheld towards PBG will be paid either against	
	submission of supplementary invoice & Original PBG	
	(or) against supplementary invoice without PBG after	
	expiry of Warranty period.	

HIGH-SEA SALES PROCUREMENT

e. 100% of basic value will be paid in 45 days from the date of signing of High Sea Sale agreement or 15 days from the date of submission of complete set of documentation, whichever is later

Note: In case PBG is not furnished, only 90% payment will be released against 100% claim without the consent of Vendor. This 10% basic amount withheld towards PBG will be paid either against submission of supplementary invoice & Original PBG (or) against supplementary invoice without PBG after expiry of Warranty period.

f. 100% of basic value will be paid in 45 days from the date of signing of High Sea Sale agreement or 15 days from the date of submission of complete set of documentation, whichever is later.

g. Erection and Commissioning:

<u>Evaluation methodology:</u> Unless and otherwise specified in SCC, E&C charges should not be less than 05% of the main supply value. In case the quoted total E&C value is less than 05% of the main supply value, BHEL shall evaluate Bidders Price deducting differential amount from main supply price proportionally from all items and apportioning towards E&C charges.

<u>Payment term:</u> 100% E&C charges along with tax as applicable, will be paid in 15 days from the date of submission of supplementary invoice/documents against proof of completion of E&C.

h. **Erection Supervision and Commissioning:**

<u>Evaluation methodology:</u> Unless and otherwise specified in SCC, Commissioning charges should not be less than 05% of the main supply value. In case the quoted total Commissioning charges is less than 05% of the main supply value, BHEL shall evaluate Bidders Price deducting differential amount from main supply price proportionally from all items and apportioning towards Commissioning charges.

<u>Payment term:</u> 100% Commissioning charges along with tax as applicable, will be paid in 15 days from the date of submission of supplementary invoice/documents against proof of completion of Commissioning.

i. Comprehensive Annual Maintenance Contract:

Evaluation methodology: Unless and otherwise specified in SCC, CAMC will be applicable for a period of 04 years from the date of expiry of warranty period (or) from the date of completion of commissioning of equipment, whichever is later and the total CAMC value should not be less than 20% of the main supply value. In case the quoted total CAMC value is less than 20% of the main supply value, BHEL shall evaluate Bidders Price deducting differential amount from main supply price proportionally from all items and apportioning towards CAMC charges.

<u>Payment terms:</u> 100% CAMC charges along with tax as applicable, will be paid in 15 days from the date of submission of supplementary invoice/documents against proof of completion of CAMC on yearly basis.

j. <u>Terms of Payment for Training</u>: 100% payment will be made in 45 days from the date of completion of Training or 15 days from the date of submission of complete set of invoice along with documentary evidence, whichever is later.

LOADING FACTORS FOR DEVIATION IN PAYMENT TERMS:

i) **INDIGENOUS PROCUREMENT:**

For payment term with credit period of less than 45 days for indigenous supply, 'Base rate of SBI (as applicable on the date of bid opening; Techno-commercial bid opening in case of two part bids) +6%', shall be considered for loading for the period of relaxation sought.

ii) IMPORT PROCUREMENT:

- 1) For offers received with Sight draft payment term in place of Usance draft, loading applicable will be 1.0% of basic value.
- For offers received with Letter of Credit payment term with Usance of 45 days, loading applicable will be 2.5% of basic value. Additional loading of 2% will be applicable for payment term as Letter of Credit at Sight.
- **k.** Any other variation of payment terms are liable for rejection.
- **I.** Standard payment terms indicated in Clauses: F (a), (b), (c), (d), (e), (f), (g), (h), (i) & (j) will not attract any loading.
- **Note 1:** Basic value of Purchase Order mentioned above will include all components of the purchase order and will exclude only taxes, duties, freight, training charges, E&C and AMC charges (wherever applicable). Wherever the Purchase Order is split into import portion and indigenous portion of supply, minimum % to be quoted for Services, wherever mentioned, will be of both purchase order values put together.
- **Note 2:** In case of multiple packages/units in a power plant, payment of E&C charges will be processed on prorata basis.
- **Note 3:** No deviation will be permitted from the duration of Guarantee/Warranty and/or Comprehensive Annual Maintenance Contract period specified in SCC.
- **Note 4:** Indigenous bidder opting to quote with usance LC payment term of 120 days shall note that LC processing charges viz., opening, amendment/ discrepancy (if & as applicable) will be to supplier's account. Bank charges of Seller's bank shall be to Seller's account and bank charges of Owner's bank other than Bill collection charges shall be to Owner's account. Bill collection charges will be borne by Seller.

G. Terms & Conditions to be complied under GST regime:

- All invoices to contain BHEL-EDN (buyer) GSTIN number: 29AAACB4146P1ZB. However for CGST +SGST/UGST billing outside the state of Karnataka, invoice has to be generated with BHEL's Nodal Agency GSTIN number. Address of Nodal Agency along with GSTIN number will be provided by BHEL at the time of issuing dispatch clearance.
- 2. The Bidder shall mention Bidder's GSTIN number in all quotations and Invoices submitted.
- 3. The Bidder shall also mention HSN (Harmonized System of Nomenclature) / SAC (Services Accounting Code) mandatorily in all quotations and invoices submitted.
- 4. Invoice submitted should be in the format as specified under GST Laws viz., all details as mentioned in Invoice Rules like GST registration number(GSTIN), invoice number with date of issue, quantity, rate, value, taxes with

- nomenclature CGST, SGST, UGST, IGST mentioned separately, HSN Code / SAC Code etc. Invoice should be submitted in original for buyer plus duplicate for credit availment.
- 5. Payment of GST to Vendor will be made only if it is matching with data uploaded by the Vendor in GST portal.
- 6. For invoices paid on Reverse charge basis "Tax payable on reverse charge basis" to be mentioned on the invoice.
- 7. In case GST credit is delayed/denied to BHEL due to non/delayed receipt of goods and/or tax invoice or expiry of timeline prescribed in GST law for availing such ITC, or any other reasons not attributable to BHEL, GST amount will be recoverable from vendor along with interest levied/ leviable on BHEL.
- 8. In case vendor delays declaring such invoice in his return and GST credit availed by BHEL is denied or reversed subsequently as per GST law, GST amount paid by BHEL towards such ITC reversal as per GST law will be recoverable from vendor/contractor along with interest levied/ leviable on BHEL.
- 9. Vendor should intimate BHEL immediately on the same date of invoicing without any delay.
- 10. In case of discrepancy in the data uploaded by supplier in the GSTN portal or in case of any shortages or rejection in the supply, then BHEL will not be able to avail the tax credit and will notify the supplier of the same. Supplier has to rectify the data discrepancy in the GSTN portal or issue credit note (details to be uploaded in GSTN portal) for the shortages or rejections in the supplies, within the calendar month notified by BHEL.
- 11. Bidders to note that Rules & Regulations pertaining to E-way bill system are to be strictly adhered to, as and when notified by Govt. authorities.
- 12. As per Notification no.17/2022-Central Tax dated 01st August,2022 (applicable w.e.f. 01st day of October, 2022), the turnover for applicability of E-invoicing provisions has been reduced from 20 crore rupees to 10 crore rupees. In other words, registered person [other than a SEZ unit and those referred in Rule 54(2), 54(3), 54(4) and 54(4A) of the CGST Rules], whose aggregate turnover in any of the previous FY beginning from 2017-18 and onwards exceeds 10 crores, is required to comply with the requirement of IRN and QR code in respect of supply of goods or services or both to a registered person or for exports.
- **H.** <u>Performance security</u>: To ensure due performance of the contract, Performance Bank Guarantee (PBG) or Security Deposit (SD), hereafter referred as performance security has to be submitted by successful bidder for 05% (unless specified otherwise) of the contract value.

Modes of deposit:

- a) Performance security may be furnished in the following forms:
 - (i) Local cheques of Scheduled Banks (subject to realization)/ Pay Order/ Demand Draft/ Electronic Fund Transfer in favour of BHEL.
 - (ii) Bank Guarantee from Scheduled Banks / Public Financial Institutions as defined in the Companies Act. PBG should be in the format specified in Annexure-VII of ITB and no deviation to this format will be allowed.

- (iii) Fixed Deposit Receipt issued by Scheduled Banks / Public Financial Institutions as defined in the Companies Act (FDR should be in the name of the Contractor, a/c BHEL).
- (iv) Securities available from Indian Post offices such as National Savings Certificates, Kisan Vikas Patras etc. (held in the name of Contractor furnishing the security and duly endorsed/ hypothecated/ pledged, as applicable, in favour of BHEL).
- (v) Insurance Surety Bond.

<u>Note</u>: BHEL will not be liable or responsible in any manner for the collection of interest or renewal of the documents or in any other matter connected therewith)

- b) PBG has to be furnished within 14 days (unless specified otherwise) after notification of the award and it should remain valid for a period of 60 days beyond the date of completion of all contractual obligations, including warranty obligations.
- c) The Performance security will be forfeited and credited to BHEL's account in the event of a breach of contract by the supplier.
- d) Performance security shall be refunded to the supplier without interest, after duly performing and completing the contract in all respects but not later than 60 days of completion of all such obligations including the warranty under the contract.
- e) The Performance security shall not carry any interest.

I. PURCHASE PREFERENCE FOR MSE (MICRO AND SMALL ENTERPRISES) VENDORS:

Purchase preference will be given to MSEs as defined in Public Procurement Policy for Micro and Small Enterprises (MSEs) Order, 2012 dated 23.03.2012 issued by Ministry of Micro, Small and Medium Enterprises and its subsequent Orders/Notifications issued by concerned Ministry. If the bidder wants to avail the Purchase preference, the bidder must be the manufacturer of the offered product in case of bid for supply of goods.

Traders are excluded from the purview of Public Procurement Policy for Micro and Small Enterprises. Relevant documentary evidence in this regard shall be uploaded along with the bid in respect of the offered product. Purchase preference to Micro and Small Enterprises clause in the bid, the same will get precedence over this clause.

- 1. <u>If tendered quantity is Splitable</u>: In tender, participating MSEs quoting price within price band of L1+15 percent shall also be allowed to supply a portion of requirement by bringing down their price to L1 price in a situation where L1 price from someone other than a MSE and such MSE shall be allowed to supply at least 25% of total tendered value. In case of more than one such MSE, the supply shall be shared proportionately (to tendered quantity).
- 3% of the 25% will be earmarked for women owned MSEs.
- 25% of the 25% (i.e., 6.25% of the total enquired quantity) will be earmarked for SC/ST owned MSE firms provided conditions as mentioned in (1) & (2) are fulfilled.

- In case where no SC/ST category firms are meeting the conditions mentioned in (1) and (2) or have not participated in the tender, the 6.25% of earmarked quantity for SC/ST owned MSE firms will be distributed among the other eligible MSE vendors who have participated in the tender.
- 2. <u>If tendered quantity is Non-Splitable</u>: If L-1 is not an MSE and MSE Seller (s) has/have quoted price within L-1+ 15% of margin of purchase preference /price band defined in relevant policy, such Seller shall be given opportunity to match L-1 price and contract will be awarded for 100% of total value.

Operation methodology of Purchase preference clause to MSE & MII bidders is as detailed in the attached Office Memorandum issued by Department of Expenditure dt:18.05.2023 (Annexure-VIII).

J. INTEGRITY COMMITMENT IN THE TENDER PROCESS, AND EXECUTION OF CONTRACTS:

- 1. <u>Commitment by BHEL</u>: BHEL commits to take all measures necessary to prevent corruption in connection with the Tender process and execution of the Contract. BHEL will, during the tender process, treat all bidder / suppliers in a transparent and fair manner, and with equity.
- 2. <u>Commitment by Bidder(s)/ Contractor(s):</u>
- a. The Bidder(s)/ Contractor(s) commit(s) to take all measures to prevent corruption and will not directly or indirectly try to influence any decision or benefit which he is not legally entitled to.
- b. The Bidder(s)/ Contractor(s) will not enter with other Bidder(s) into any undisclosed agreement or understanding or any actions to restrict competition.
- c. The Bidder(s)/ Contractor(s) will not commit any offence under the relevant Acts. The Bidder(s)/ Contractor(s) will not use improperly, for purposes of competition or personal gain or pass on to others, any information or document provided by BHEL as part of business relationship.
- d. The Bidder(s)/ Contractor(s) will, when presenting his bid, disclose any and all payments he has made, and is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract and shall adhere to the relevant guidelines issued from time to time by Government of India/ BHEL.

If the Bidder(s) / Contractor(s), before award or during execution of the Contract commit(s) a transgression of the above or in any other manner such as to put his reliability or credibility in question, BHEL is entitled to disqualify the Bidder(s) / Contractor (s) from the tender process or terminate the contract and/ or take suitable action as deemed fit.

K. Integrity Pact (IP):

(a) IP is a tool to ensure that activities and transactions between the Company and its Bidders/ Contractors are handled in a fair, transparent and corruption free manner. Following Independent External Monitors (IEMs) on the present panel have been appointed by BHEL with the approval of CVC to oversee implementation of IP in BHEL.

SI	IEM	Email
1.	Shri Otem Dai, IAS (Retd.)	iem1@bhel.in
2.	Shri Bishwamitra Pandey, IRAS (Retd.)	iem2@bhel.in
3.	Shri Mukesh Mittal, IRS (Retd.)	iem3@bhel.in

- (b) The IP as enclosed with the tender is to be submitted (duly signed by authorized signatory) along with technocommercial bid (Part-I, in case of two/ three part bid). Only those bidders who have entered into such an IP with BHEL would be competent to participate in the bidding. In other words, entering into this Pact would be a preliminary qualification.
- (c) Please refer Section-8 of IP for Role and Responsibilities of IEMs. In case of any complaint arising out of the tendering process, the matter may be referred to any of the above IEM(s). All correspondence with the IEMs shall be done through email only.

<u>Note</u>: No routine correspondence shall be addressed to the IEM (phone/ post/ email) regarding the clarifications, time extensions or any other administrative queries, etc. on the tender issued. All such clarification/ issues shall be addressed directly to the tender issuing (procurement) department's officials whose contact details are provided in SCC document of tender.

L. Conflict of Interest among Bidders/Agents:

"A bidder shall not have conflict of interest with other bidders. Such conflict of interest can lead to anti-competitive practices to the detriment of Procuring Entity's interests. The bidder found to have a conflict of interest shall be disqualified. A bidder may be considered to have a conflict of interest with one or more parties in this bidding process, if:

- a) they have controlling partner (s) in common; or
- they receive or have received any direct or indirect subsidy/ financial stake from any of them; or
- c) they have the same legal representative/agent for purposes of this bid; or
- they have relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the bid of another Bidder; or
- e) Bidder participates in more than one bid in this bidding process. Participation by a Bidder in more than one Bid will result in the disqualification of all bids in which the parties are involved. However, this does not limit the inclusion of the components/ sub-assembly/ Assemblies from one bidding manufacturer in more than one bid; or

- f) In cases of agents quoting in offshore procurements, on behalf of their principal manufacturers, one agent cannot represent two manufacturers or quote on their behalf in a particular tender enquiry. One manufacturer can also authorise only one agent/dealer. There can be only one bid from the following:
 - The principal manufacturer directly or through one Indian agent on his behalf; and
 - 2. Indian/foreign agent on behalf of only one principal;

or

- A Bidder or any of its affiliates participated as a consultant in the preparation of the design or technical specifications of the contract that is the subject of the Bid; or
- h) In case of a holding company having more than one independently manufacturing units, or more than one unit having common business ownership/management, only one unit should quote. Similar restrictions would apply to closely related sister companies. Bidders must proactively declare such sister/ common business/ management units in same/ similar line of business."

BHEL-IP

AA:SSP:IP:R03 dtd 01-04-2022

Annexure-1

INTEGRITY PACT

Between

Bharat Heavy Electricals Ltd. (BHEL), a company registered under the Companies Act 1956 and having its registered office at "BHEL House", Siri Fort, New Delhi - 110049 (India) hereinafter referred to as "The Principal", which expression unless repugnant to the context or meaning hereof shall include its successors or assigns of the ONE PART

and

, (description of the party ald Bidder/ Contractor" which expression unless repugnant successors or assigns of the OTHER PART	ong with address), hereinafter referred to as "The to the context or meaning hereof shall include its
<u>Pream</u>	<u>ble</u>
The Principal intends to award, under laid-down organiz	ational procedures, contract/s for <u>Supply</u> of VFDs
for 1200 KW, 3.3 KV Motor for	NTPC Talcher TPS St. 111 (2×660 MW)

(hereinafter referred to as "Contract"). The Principal values full compliance with all relevant laws of the land, rules and regulations, and the principles of economic use of resources, and of fairness and transparency in its relations with its Bidder(s)/ Contractor(s).

In order to achieve these goals, the Principal will appoint panel of Independent External Monitor(s) (IEMs), who will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

Section 1- Commitments of the Principal

- 1.1 The Principal commits itself to take all measures necessary to prevent corruption and to observe the following principles: -
- 1.1.1 No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.
- 1.1.2 The Principal will, during the tender process treat all Bidder(s) with equity and reason. The Principal will in particular, before and during the tender process, provide to all Bidder(s) the same information and will not provide to any Bidder(s) confidential/ additional information through which the Bidder(s) could obtain an advantage in relation to the tender process or the contract execution.
- 1.1.3 The Principal will exclude from the process all known prejudiced persons.
 - 1.2 If the Principal obtains information on the conduct of any of its employees which is a penal offence under the Indian Penal Code 1860 and Prevention of Corruption Act 1988 or any other statutory penal enactment, or if there be a substantive suspicion in this regard, the Principal will inform its Vigilance Office and in addition can initiate disciplinary actions.

Section 2 - Commitments of the Bidder(s)/ Contractor(s)

2.1 The Bidder(s)/ Contractor(s) commit himself to take all measures necessary to prevent corruption. The Bidder(s)/ Contractor(s) commits himself to observe the following principles during participation in the tender process and during the contract execution.

Alusa Page 1 of 5

AA:SSP:IP:R03 dtd 01-04-2022

BHEL-IP

- 2.1.1 The Bidder(s)/ Contractor(s) will not, directly or through any other person or firm, offer, promise or give to the Principal or to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material, immaterial or any other benefit which he/ she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.
- 2.1.2 The Bidder(s)/ Contractor(s) will not enter with other Bidder(s) into any illegal or undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.
- 2.1.3 The Bidder(s)/ Contractor(s) will not commit any penal offence under the relevant Indian Penal Code (IPC) and Prevention of Corruption Act; further the Bidder(s)/ Contractor(s) will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
- 2.1.4 Foreign Bidder(s)/ Contractor(s) shall disclose the name and address of agents and representatives in India and Indian Bidder(s)/ Contractor(s) to disclose their foreign principals or associates. The Bidder(s)/ Contractor(s) will, when presenting his bid, disclose any and all payments he has made, and is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.
 - 2.2 The Bidder(s)/ Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.
 - 2.3 The Bidder(s)/ Contractor(s) shall not approach the Courts while representing the matters to IEMs and shall await their decision in the matter.

Section 3 - Disqualification from tender process and exclusion from future contracts

If the Bidder(s)/ Contractor(s), before award or during execution has committed a transgression through a violation of Section 2 above, or acts in any other manner such as to put his reliability or credibility in question, the Principal is entitled to disqualify the Bidder(s)/ Contractor(s) from the tender process, terminate the contract, if already awarded, exclude from future business dealings and/ or take action as per the separate "Guidelines on Banning of Business dealings with Suppliers/ Contractors", framed by the Principal.

Section 4 - Compensation for Damages

- 4.1 If the Principal has disqualified the Bidder (s) from the tender process before award / order acceptance according to Section 3, the Principal is entitled to demand and recover the damages equivalent to Earnest Money Deposit/ Bid Security.
- 4.2 If the Principal is entitled to terminate the Contract according to Section 3, or terminates the Contract in application of Section 3 above , the Bidder(s)/ Cotractor (s) transgression through a violation of Section 2 above shall be construed breach of contract and the Principal shall be entitled to demand and recover from the Contractor an amount equal to 5% of the contract value or the amount equivalent to Security Deposit/ Performance Bank Guarantee, whichever is higher, as damages, in addition to and without prejudice to its right to demand and recover compensation for any other loss or damages specified elsewhere in the contract.



Section 5 - Previous Transgression

- 5.1 The Bidder declares that no previous transgressions occurred in the last 3 (three) years with any other company in any country conforming to the anti-corruption approach or with any other Public Sector Enterprise in India that could justify his exclusion from the tender process.
- 5.2 If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason or action can be taken as per the separate "Guidelines on Banning of Business dealings with Suppliers/ Contractors", framed by the Principal.

Section 6 - Equal treatment of all Bidder (s)/ Contractor (s) / Sub-contractor (s)

- 6.1 The Principal will enter into Integrity Pacts with identical conditions as this Integrity Pact with all Bidders and Contractors.
- 6.2 In case of Sub-contracting, the Principal Contractor shall take the responsibility of the adoption of Integrity Pact by the Sub-contractor(s) and ensure that all Sub-contractors also sign the Integrity Pact.
- 6.3 The Principal will disqualify from the tender process all Bidders who do not sign this Integrity Pact or violate its provisions.

Section 7 - Criminal Charges against violating Bidders/ Contractors /Subcontractors

If the Principal obtains knowledge of conduct of a Bidder, Contractor or Subcontractor, or of an employee or a representative or an associate of a Bidder, Contractor or Subcontractor which constitutes corruption, or if the Principal has substantive suspicion in this regard, the Principal will inform the Vigilance Office.

Section 8 -Independent External Monitor(s)

- 8.1 The Principal appoints competent and credible panel of Independent External Monitor (s) (IEMs) for this Integrity Pact. The task of the IEMs is to review independently and objectively, whether and to what extent the parties comply with the obligations under this Integrity Pact.
- 8.2 The IEMs are not subject to instructions by the representatives of the parties and performs his functions neutrally and independently. He reports to the CMD, BHEL.
- 8.3 The IEMs shall be provided access to all documents/ records pertaining to the Contract, for which a complaint or issue is raised before them as and when warranted. However, the documents/records/information having National Security implications and those documents which have been classified as Secret/Top Secret are not to be disclosed.
- 8.4 The Principal will provide to the IEMs sufficient information about all meetings among the parties related to the Contract provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the IEMs the option to participate in such meetings.

- 8.5 The advisory role of IEMs is envisaged as that of a friend, philosopher and guide. The advice of IEMs would not be legally binding and it is restricted to resolving issues raised by a Bidder regarding any aspect of the tender which allegedly restricts competition or bias towards some Bidders. At the same time, it must be understood that IEMs are not consultants to the Management. Their role is independent in nature and the advice once tendered would not be subject to review at the request of the organization.
- 8.6 For ensuring the desired transparency and objectivity in dealing with the complaints arising out of any tendering process or during execution of Contract, the matter should be examined by the full panel of IEMs jointly, who would look into the records, conduct an investigation, and submit their joint recommendations to the Management.
- 8.7 The IEMs would examine all complaints received by them and give their recommendations/ views to the CMD, BHEL at the earliest. They may also send their report directly to the CVO, in case of suspicion of serious irregularities requiring legal/ administrative action. Only in case of very serious issue having a specific, verifiable Vigilance angle, the matter should be reported directly to the Commission. IEMs will tender their advice on the complaints within 30 days.
- 8.8 The CMD, BHEL shall decide the compensation to be paid to the IEMs and its terms and conditions.
- 8.9 IEMs should examine the process integrity, they are not expected to concern themselves with fixing of responsibility of officers. Complaints alleging mala fide on the part of any officer of the Principal should be looked into by the CVO of the Principal.
- 8.10 If the IEMs have reported to the CMD, BHEL, a substantiated suspicion of an offence under relevant Indian Penal Code / Prevention of Corruption Act, and the CMD, BHEL has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Office, the IEMs may also transmit this information directly to the Central Vigilance Commissioner, Government of India.
- 8.11 After award of work, the IEMs shall look into any issue relating to execution of Contract, if specifically raised before them. As an illustrative example, if a Contractor who has been awarded the Contract, during the execution of Contract, raises issue of delayed payment etc. before the IEMs, the same shall be examined by the panel of IEMs. Issues like warranty/ guarantee etc. shall be outside the purview of IEMs.
- 8.12 However, the IEMs may suggest systemic improvements to the management of the Principal, if considered necessary, to bring about transparency, equity and fairness in the system of procurement.
- 8.13 The word 'Monitor' would include both singular and plural.

Section 9 - Pact Duration

- 9.1 This Integrity Pact shall be operative from the date this Integrity Pact is signed by both the parties till the final completion of contract for successful Bidder, and for all other Bidders 6 months after the Contract has been awarded. Any violation of the same would entail disqualification of the bidders and exclusion from future business dealings.
- 9.2 If any claim is made/ lodged during currency of this Integrity Pact, the same shall be binding and continue to be valid despite the lapse of this Pact as specified above, unless it is discharged/ determined by the CMD, BHEL.

Atu Son L

Section 10 - Other Provisions

- 10.1 This Integrity Pact is subject to Indian Laws and exclusive jurisdiction shall be of the competent Courts as indicated in the Tender or Contract, as the case may be.
- 10.2 Changes and supplements as well as termination notices need to be made in writing.
- 10.3 If the Bidder(s)/ Contractor(s) is a partnership or a consortium or a joint venture, this Integrity Pact shall be signed by all partners of the partnership or joint venture or all consortium members.
- 10.4 Should one or several provisions of this Integrity Pact turn out to be invalid, the remainder of this Integrity Pact remains valid. In this case, the parties will strive to come to an agreement to their original intentions.
- Only those bidders / contractors who have entered into this Integrity Pact with the Principal would be competent to participate in the bidding. In other words, entering into this Integrity Pact would be a preliminary qualification.
- In the event of any dispute between the Principal and Bidder(s)/ Contractor(s) relating to the Contract, in case, both the parties are agreeable, they may try to settle dispute through Mediation before the panel of IEMs in a time bound manner. In case, the dispute remains unresolved even after mediation by the panel of IEMs, either party may take further action as the terms & conditions of the Contract. The fees/expenses on dispute resolution through mediation shall be shared by both the parties. Further, the mediation proceedings shall be confidential in nature and the parties shall keep confidential all matters relating to the mediation proceedings including any settlement agreement arrived at between the parties as outcome of mediation. Any views expressed, suggestions, admissions or proposals etc. made by either party in the course of mediation shall not be relied upon or introduced as evidence in any further arbitral or judicial proceedings, whether or not such proceedings relate to the dispute that is the subject of mediation proceedings. Neither of the parties shall present IEMs as witness in any Alternative Dispute Resolution or judicial proceedings in respect of the dispute that was subject of mediation.

Place Bangel are Date 09-05-25 Witness: Witness: (Name & Address)		
### For & On behalf of the Bidder/ Contractor ### ATUL SOOLO ################################	Ate Social	
ATUL SOOD EINBINEER / CE-MAN-PR BHEL-EDN, MYSURU ROAD, BENGALURU-560026 Place Bangel are Date 09-05-25 Witness: Witness: Witness: (Name & Address)		
BHEL-EDN, MYSURU ROAD, BENGALURU-560026 Place Bangel are Date 09-05-25 Witness: Witness: (Name & Address)	अर्जुला भ्रूकित भ्रम्भिस्ताक्षीक्षेत्राक्षाक्षात्रात्रात्रात्रात्रात्रात्रात्रात्रात्र	For & On behalf of the Bidder/ Contractor
BHEL-EDN, MYSURU ROAD, BENGALURU-560026 Place Bangclare Date 09-05-25 Witness: Witness: (Name & Address)	ATUL SOODO SINGISHER / CE-MM-PR	(Office Seal)
Witness:	BHEL-EDN, MYSURU ROAD, BENGALURU-560026	,
Witness: Witness: (Name & Address)	Place Bangclare	
(Name & Address)	Date 09-05-25	
(Name & Address) (Name & Address)	Witness: Witness:	Witness:
ಎಸ್. ಪ್ರತೀಶ್ ಸುಮಾರ್, ಹಿಡಿಯ ಪ್ರವಸ್ಥಾಪಕರು/ನಿ.ಉ ಸಂಪ್ರಿಸಿ ಪರ್	(Name & Address)	(Name & Address)
DN NOCO COMPONENT & 8.	<u>ಎಸ್. ಸ್ರತೀಶ್ ಕುಮಾರ್, ಓರಿಯ ವ್ಯವಸ್ಥಾಪ್ತರು/ನಿಕ್ಕಾಂತ ಜಾ. ಪಿ.ಅರ್.</u>	. ,
एस. सतीश कुमार, वरि. प्रवंधक/सी.ई-१म.एम.चो.आर.	एस. सतीश कुमार, वरि. प्रवंधक/सी.ई१३२,एसवरे.आर.	
C CATUICU ŽI IMAR SR. MANAGER / CE-MIVI-PR	C CATUICH VIIMAR SR. MANAGER / CE-MM-PR	
BHEL-EDN, MYSURU ROAD, BENGALURU-560026	BHEL-EDN, MYSURU ROAD, BENGALURU-560026	

Clause on IP in the tender

"Integrity Pact (IP)

(a) IP is a tool to ensure that activities and transactions between the Company and its Bidders/ Contractors are handled in a fair, transparent and corruption free manner. Following Independent External Monitors (IEMs) on the present panel have been appointed by BHEL with the approval of CVC to oversee implementation of IP in BHEL.

SI	IEM	Email
1.	Shri Arun Chandra Verma, IPS (Retd.)	acverma1@gmail.com
2.	Shri Virendra Bahadur Singh, IPS (Retd.)	vbsinghips@gmail.com

- (b) The IP as enclosed with the tender is to be submitted (duly signed by authorized signatory) along with techno-commercial bid (Part-I, in case of two/ three part bid). Only those bidders who have entered into such an IP with BHEL would be competent to participate in the bidding. In other words, entering into this Pact would be a preliminary qualification.
- (c) Please refer Section-8 of IP for Role and Responsibilities of IEMs. In case of any complaint arising out of the tendering process, the matter may be referred to any of the above IEM(s). All correspondence with the IEMs shall be done through email only.

Note:

No routine correspondence shall be addressed to the IEM (phone/ post/ email) regarding the clarifications, time extensions or any other administrative queries, etc on the tender issued. All such clarification/ issues shall be addressed directly to the tender issuing (procurement) department's officials whose contact details are provided below:

Details of contact person(s):

Name: Sathish Kumar S Dept.: CE-MM-PR

Address: BHEL-EDN, Bangalore

Phone: 9449869753

Email: sathishkumars@bhel.in

Name: Atul Sood Dept.: CE-MM-PR

Address: BHEL-EDN, Bangalore

Phone: 7795367467 Email: atulsood@bhel.in

Anneaux

Annexure I Guidelines for Indian Agents

Definition of Indian Agent: An Indian Agent of foreign prinicipal is an individual, a partnership, an
association of persons, a private or public company, that carries our specific obligation(s) towards
processing of BHEL tender or finalization or execution of BHEL's contract on behalf of the foreign
supplier.

In case of yes, vendor to note the following and reply accordingly:

- i. BHEL shall deal directly with foreign vendors, wherever required, for procurement of goods. However, if the foreign principal desires to avail of the services of an Indian agent, then the foreign principal should ensure compliance to regulatory guidelines which require mandatory submission of an Agency Agreement.
- ii. It shall be incumbent on the Indian agent and the foreign principal to adhere to the relevant guidelines of Government of India, issued from time to time.
- iii. The Agency Agreement should specify the precise relationship between the foreign OEM / foreign principal and their Indian agent and their mutual interest in the business. All services to be rendered by agent/ associate, whether of general nature or in relation to the particular contract, must be clearly stated by the foreign supplier/ Indian agent. Any payment, which the agent or associate receives in India or abroad from the OEM, whether as commission or as a general retainer fee should be brought on record in the Agreement and be made explicit in order to ensure compliance to laws of the country.
- iv. Any agency commission to be paid by BHEL to the Indian agent shall be in Indian currency only.
- v. Tax deduction at source is applicable to the agency commission paid to the Indian agent as per the prevailing rules.
- vi. In the absence of any agency agreement, BHEL shall not deal with any Indian agent (authorized representatives / associate / consultant, or by whatever name called) and shall deal directly with the foreign principal only for all correspondence and business purposes.
- vii. The "Guidelines for Indian Agents of Foreign Suppliers" enclosed at annexure -'A' shall apply in all such cases.

viii. The supply and execution of the Purchase Order (including indigenous supplies/ service) shall be in the scope of the OEM/ foreign principal. The OEM/ foreign principal should submit their offer inclusive of all indigenous supplies/ services and evaluation will be based on 'total cost to BHEL'. In case OEM/ foreign principal recommends placement of order(s) towards indigenous portion of supplies/ services on Indian supplier(s)/ agent on their behalf, the credentials/ capacity/ capability of the Indian supplier(s)/ agent to make the supplies/ services shall be checked by BHEL as per the extant guidelines of Supplier Evaluation, Approval & Review Procedure (SEARP), before opening of price bids. In this regard, details may be checked as per Annexure-B (copy enclosed). It will be the responsibility of the OEM/ foreign principal to get acquainted with the evaluation requirements of Indian supplier/ agent as per SEARP available on www.bhel.com.

The responsibility for successful execution of the contract (including indigenous supplies/ services) lies with the OEM/ foreign principal. All bank guarantees to this effect shall be in the scope of the OEM/ foreign principal.

---X---

Vendor's Signature with Seal

Guidelines for Indian Agents of Foreign Suppliers

- There shall be compulsory registration of agents for all Global (Open) Tender and Limited Tender. An agent who is not registered with BHEL shall apply for registration in the registration form in line with SEARP.
- 1.1 Registered agents will file an authenticated Photostat copy duly attested by a Notary Public/Original certificate of the Principal confirming the agency agreement and giving the status being enjoyed by the agent and the commission/ remuneration/ salary/ retainership being paid by the principal to the agent before the placement of order by BHEL.
- Wherever the Indian representatives have communicated on behalf of their principals and the foreign parties have stated that they are not paying any commission to the Indian agents, and the Indian representative is working on the basis of salary or as retainer, a written declaration to this effect should be submitted by the party (i.e. Principal) before finalizing the order.
- 2.0 Disclosure of particulars of agents/ representatives in India, if any.
- 2.1 Tenderers of Foreign nationality shall furnish the following details in their offers:
 - 2.1.1 The Bidder(s)/ Contractor(s) of foreign origin shall disclose the name and address of the agents/ representatives in India if any and the extent of authorization and authority given to commit the Principals. In case the agent/ representative be a foreign Company, it shall be confirmed whether it is existing Company and details of the same shall be furnished.
 - 2.1.2 The amount of commission/ remuneration included in the quoted price(s) for such agents/ representatives in India.
 - 2.1.3 Confirmation of the Tenderer that the commission/ remuneration, if any, payable to his agents/ representatives in India, may be paid by BHEL in Indian Rupees only.
- 2.2 Tenderers of <u>Indian Nationality</u> shall furnish the following details in their offers:
 - 2.2.1 The Bidder(s)/ Contractor(s) of Indian Nationality shall furnish the name and address of the foreign principals, if any, indicating their nationality as well as their status, i.e. whether manufacturer or agents of manufacturer holding the Letter of Authority of the Principal specifically authorizing the agent to make an offer in India in response to tender either directly or through the agents/ representatives.
 - 2.2.2 The amount of commission/ remuneration included in the price (s) quoted by the Tenderer for himself.
 - 2.2.3 Confirmation of the foreign principals of the Tenderer that the commission/ remuneration, if any, reserved for the Tenderer in the quoted price(s), may be paid by BHEL in India in equivalent Indian Rupees on satisfactory completion of the Project or supplies of Stores and Spares in case of operation items.
- 2.3 In either case, in the event of contract materializing, the terms of payment will provide for payment of the commission/ remuneration, if any payable to the agents/ representatives in India in Indian Rupees on expiry of 90 days after the discharge of the obligations under the contract.
- 2.4 Failure to furnish correct and detailed information as called for in paragraph 2.0 above will render the concerned tender liable to rejection or in the event of a contract materializing, the same liable to termination by BHEL. Besides this there would be a penalty of banning business dealings with BHEL or damage or payment of a named sum.

ANNEXURE - II LIST OF INTERNATIONAL GATEWAY AIRPORTS

For air based consignment, terms of delivery will be on FCA basis from following listed airports only. Vendors are requested to verify this list for use before submission of offer.

SCHEDULE NO	COUNTRY	CURRENCY CODE	AIRPORT
D01	UK	GBP	LONDON (HEATHROW)
D02	UK	GBP	NEW CASTLE
D03	UK	GBP	OXFORD. CHETLAM
D04	UK	GBP	BRISTOL. WELLINGBOROUGH
D05	UK	GBP	BIRMINGHAM
DO6	UK	GBP	EAST MIDLANDS
D07	UK	GBP	MANCHESTER
D08	UK	GBP	LEEDS
D09	UK	GBP	GLASGOW
D10	FRANCE	EURO	PARIS (ROISSY) & LYON
D11	SWEDEN	EURO	STOCKHOLM
D12	SWEDEN	EURO	GOTHENBERG & MALMO
D13	ITALY	EURO	ROMA, MILAN
D14	ITALY	EURO	TURIN, BOLOGNA, FLORENCE
D15	NETHERLANDS	EURO	AMSTERDAM, ROTTERDAM
	AUSTRIA	EURO	VIENNA, LINZ, GRAZ
D17	BELGIUM	EURO	ANTWERP, BRUSSELS
D18	DENMARK	DKK	COPENHAGEN
D19	JAPAN	JPY	TOKYO, OSAKA
D20	SINGAPORE	SGD	SINGAPORE
D21	CANADA	CAD	TORONTO
D22	CANADA	CAD	MONTREAL
D23	USA	USD	NEW YORK, BOSTON
	USA	USD	
D24			CHICAGO
D25	USA	USD	SAN FRANCISCO, LOS ANGELES
D26	USA	USD	ALANTA, HOUSTON
D27	GERMANY	EURO	MUNICH, KOLN, DUSSELDORF, HANNOVER, HAMBURG, STUTTGART, DAMSTADT, MANIHIEM, NURUMBERG
D28	GERMANY	EURO	FRANKFURT
D29	GERMANY	EURO	BERLIN
D30	SWITZERLAND	SFR	BASLE, ZURICH, GENEVA
D31	SPAIN	EURO	BARCELONA
D32	AUSTRALIA	AUD	SYDNEY
D33	AUSTRALIA	AUD	MELBOURNE
D34	AUSTRALIA	AUD	PERTH
D35	CZECH	EURO	PRAGUE
D36	HONG KONG	HKD	HONG KONG
D37	NEW ZELAND	NZD	AUCKLAND
D38	RUSSIA	USD	MOSCOW
D39	SOUTH KOREA	USD	KIMPO INTERNATIONAL, INCHEON
D40	FINLAND	EURO	
D40	ROMANIA	EURO	
D41		EURO	BUCHAREST
	NORWAY		OSLO
D43	IRELAND	EURO	DUBLIN
D44	ISRAEL	USD	TELAVIV
D45	UAE	USD	DUBAI
D46	OMAN	USD	MUSCAT
	EGYPT	USD	CAIRO
D47			
D47	TAIWAN	USD	TAIPEI
		USD USD	TAIPEI KIEV
D48	TAIWAN	USD	
D48 D49	TAIWAN UKRAINE	USD USD	KIEV
D48 D49 D50	TAIWAN UKRAINE CHINA	USD USD USD	KIEV SHANGHAI, SHENZHEN
D48 D49 D50 D51	TAIWAN UKRAINE CHINA PHILIPINES	USD USD USD USD	KIEV SHANGHAI, SHENZHEN MANILA
D48 D49 D50 D51 D52	TAIWAN UKRAINE CHINA PHILIPINES MALAYSIA	USD USD USD USD USD	KIEV SHANGHAI, SHENZHEN MANILA KUALALUMPUR, PE NANG
D48 D49 D50 D51 D52 D53	TAIWAN UKRAINE CHINA PHILIPINES MALAYSIA CYPRUS	USD USD USD USD USD USD USD USD	KIEV SHANGHAI, SHENZHEN MANILA KUALALUMPUR, PE NANG LARNACA
D48 D49 D50 D51 D52 D53 D54 D55	TAIWAN UKRAINE CHINA PHILIPINES MALAYSIA CYPRUS SOUTH AFRICA SLOVAKIA	USD	KIEV SHANGHAI, SHENZHEN MANILA KUALALUMPUR, PE NANG LARNACA JOHANNESBERG, DURBAN BARTISLOVA
D48 D49 D50 D51 D52 D53 D54 D55 D56	TAIWAN UKRAINE CHINA PHILIPINES MALAYSIA CYPRUS SOUTH AFRICA SLOVAKIA SAUDI ARABIA	USD	KIEV SHANGHAI, SHENZHEN MANILA KUALALUMPUR, PE NANG LARNACA JOHANNESBERG, DURBAN BARTISLOVA RIYADH
D48 D49 D50 D51 D52 D53 D54 D55	TAIWAN UKRAINE CHINA PHILIPINES MALAYSIA CYPRUS SOUTH AFRICA SLOVAKIA	USD	KIEV SHANGHAI, SHENZHEN MANILA KUALALUMPUR, PE NANG LARNACA JOHANNESBERG, DURBAN BARTISLOVA

ANNEXURE – III DISCREPANCY IN WORDS & FIGURES – QUOTED IN PRICE BID

Following guidelines will be followed in case of discrepancy in words & figures-quoted in price bid:

- (a) If, in the price structure quoted for the required goods/services/works, there is discrepancy between the unit price and the total price (which is obtained by multiplying the unit price by the quantity), the unit price shall prevail and the total price corrected accordingly, unless in the opinion of the purchaser there is an obvious misplacement of the decimal point in the unit price, in which case the total price as quoted shall govern and the unit price corrected accordingly.
- (b) If there is an error in a total corresponding to the addition or subtraction of subtotals, the subtotals shall prevail and the total shall be corrected; and
- (c) If there is a discrepancy between words and figures, the amount in words shall prevail, unless the amount expressed in words is related to an arithmetic error, in which case the amount in figures shall prevail subject to (a) and (b) above.
- (d) If there is such discrepancy in an offer, the same shall be conveyed to the bidder with target date upto which the bidder has to send his acceptance on the above lines and if the bidder does not agree to the decision of the purchaser, the bid is liable to be ignored.

ANNEXURE - IV Electronic Funds Transfer (EFT) OR Paylink Direct Credit Form

	Please Fill up the form in CAPITAL TYPE OF REQUEST(Tick one):	*
	BHEL Vendor / Supplier Code: Company Name :	
	Permanent Account Number(PAN): Address	
	City:	PINCODE STATE
	Contact Person(s) Telephone No: Fax No:	
	e-mail id:	
	Bank Name: Bank Address:	
	Bank Telephone No:	
5	Bank Account No: Account Type: Savings/Cash Credit 9 Digit Code Number of Bank and b	pranch
	appearing on MICR cheque issued Bank IFSC Code(applicable for NEF Bank IFSC code(applicable for RTG	FT)
	that I, as a representative for the ab Bangalore to electronically deposit p If the transaction is delayed or not e information, I would not hold BHEL. This authority remains in full force u requesting a change or cancellation	until BHEL, EDN,Bangalore receives written notification n. ering letter and agree to discharge the responsibility
	Date	
	Authorised Signatory: Designation:	Telephone No. with STD Code
		releptote No. with OTD code
	Company Seal	Bank Certificate
	We certify that we confirm that the bank details give	has an Account No with us and en above are correct as per our records.
	Date: Place:	() Signature
	Please return completed form along Bharath Heavy Electricals Ltd, Attn: Electronics Division, Mysore Road, BANGALORE - 560 026	g with a blank cancelled cheque or photocopy thereof to:

Α

В

С

<u>ANNEXURE - V</u> <u>PRESENT PROCEDURE FOR SALE IN TRANSIT (HIGH SEA SALES)</u>

In case of High Sea Sales, vendor should submit following documents:

1. ORIGINAL HIGH SEA SALES AGREEMENT

- Sale agreement (on Rs. 200/- non-judicial stamp paper & notarised with 2 witnesses with identity) has to be signed between BHEL and the Party importing material. The date of the sale documents should be in between the date of House Air Way Bill / Bill of Lading and before landing of the goods in Indian origin.
- Following shall be included in the High Sea Sales Agreement:
 "THE BUYER ALSO UNDERTAKE DISCHARGES, THE OBLIGATION AND FULFILLMENT OF CONDITIONS, IF ANY, ATTACHED TO THE IMPORTATION, ASSESSMENT AND CLEARANCE OF THE GOODS IN TERMS CUSTOMS TARIFF ACT 1975, THE CUSTOMS ACT 1962 & RULES & REGULATIONS MADE THERE UNDER AND OTHER RELEVANT ACTS, ORDERS, NOTIFICATIONS".

2. ORIGINAL INVOICES: INDIGENOUS RUPEE INVOICE & FOREIGN CURRENCY INVOICE

- Prices should be C.I.F., designated airport/seaport basis.
- I.E.C., C.S.T., K.S.T. Nos. to be mentioned.
- Description of item (Nomenclature), Unit & Quantity in both the Foreign Currency & the Indigenous Invoice in Rupee shall be exactly as per Purchase Order Description of item, Quantity and Unit. The Indigenous Invoice value shall be exactly as per Purchase Order value.
- Seller should give Foreign Currency Invoice from the original consignor. The Foreign Currency Invoice value should be at least 2% (two per cent) less than the Indigenous Rupee Invoice value in equivalent foreign currency.

4. ORIGINAL HOUSE AIR WAY BILL/ BILL OF LADING

- The sale agents should duly endorse House Air Way Bill (HAWB) for air shipments or original Bill of Lading (O.B.L.) for sea shipments and Foreign Currency Invoice in favour of BHEL-EDN.
- 5. ORIGINAL CARGO ARRIVAL NOTICE FROM FORWARDER.
- 6. ORIGINAL DELIVERY ORDER ISSUED IN NAME OF BHEL-EDN.
- 7. ORIGINAL PACKING LIST.
- 8. A LETTER TO THE COMMISSIONER OF CUSTOMS FOR EFFECTING ABOVE SALE.
- 9. A LETTER TO THE DEPUTY ASSESSOR (OCTROI) FOR EFFECTING ABOVE SALE IN FAVOUR OF BHEL.

REMARKS: In case vendor needs any clarifications on the above, the same may be sought in writing.

Annexure-VI (List of Consortium Banks)

SI No	Name of Bank	
1	State Bank of India	
2	Canara Bank	
3	IDBI Bank Limited	
4	ICICI Bank Limited	
5	HDFC Bank Limited	
6	Axis Bank	
7	IndusInd Bank Limited	
8	Bank of Baroda	
9	Exim Bank	
10	Indian Bank	
11	Punjab National Bank	
12	Union Bank of India	
13	Yes Bank Limited	
14	RBL Bank Ltd.	
15	Indian Overseas Bank	
16	Kotak Mahindra Bank Limited	
17	Federal Bank Limited	
18	Hongkong and Shanghai Banking Corporation Ltd	

Annexure-M

BANK GUARANTEE FOR PERFORMANCE SECURITY

Bank Guarantee No: Date:

To NAME & ADDRESSES OF THE BENEFICIARY Dear Sirs In consideration of Bharat Heavy Electricals Limited (hereinafter referred to as the 'Employer' which expression shall unless repugnant to the context or meaning thereof, include its successors and permitted assigns) incorporated under the Companies Act, 1956 and having its registered office at ___ through its Unit at......(name of the Unit) having awarded to (Name of the Vendor / Contractor / 2 hereinafter referred to as the 'Vendor / Contractor / Supplier ', Supplier) with its registered office at_ which expression shall unless repugnant to the context or meaning thereof, include its successors and permitted 'Contract') and the Vendor / Contractor / Supplier having agreed to provide a Contract Performance Bank Guarantee, equivalent to% (.... Percent) of the said value of the Contract to the Employer for the faithful performance of the Contract, alia a branch at being the Guarantor under this Guarantee, hereby, irrevocably and unconditionally undertake to forthwith and immediately pay to the Employer any sum or sums upto a maximum amount of Rs --"

G (Rupees ------) without any demur, immediately on first demand from the Employer and without any reservation, protest, and recourse and without the Employer needing to prove or demonstrate reasons for its such demand. Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding We undertake to pay to the Employer any money so demanded notwithstanding any dispute or disputes raised by the Vendor / Contractor / Supplier in any suit or proceeding pending before any Court or Tribunal, Arbitrator or any other authority, our liability under this present being absolute and unequivocal. The payment so made by us under this Guarantee shall be a valid discharge of our liability for payment thereunder and the Vendor / Contractor / Supplier shall have no claim against us for making such payment. We thebank further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said Contract/satisfactory completion of

the performance guarantee period as per the terms of the Contract and that it shall continue to be enforceable till

	e dues of the Employer under or by virtue of the said Contract have been fully pa scharged.	id and its claims satisfied
	BANK further agree with the Employer that the Employer shall have	the follows the standard the
	consent and without affecting in any manner our obligations hereunder to va	
	tions of the said Contract or to extend time of performance by the said <u>Vendor / I</u>	
	to time or to postpone for any time or from time to time any of the powers exe	
	st the said <u>Vendor / Contractor / Supplier</u> and to forbear or enforce any of the tem	
	e said Contract and we shall not be relieved from our liability by reason of any su	
	granted to the said <u>Vendor / Contractor / Supplier</u> or for any forbearance, act or o	
	over or any indulgence by the Employer to the said Vendor / Contractor / Suppl	
	ng whatsoever which under the law relating to sureties would but for this pro	
	ing us.	vision have effect of so
1011041	ing us.	
The B	ank also agrees that the Employer at its option shall be entitled to enforce this Gu	arantee against the Bank
	principal debtor, in the first instance without proceeding against the Vendor / C	
	histanding any security or other guarantee that the Employer may have in	
	actor / Supplier 's liabilities.	
This G	Suarantee shall remain in force upto and including	d shall be extended from
time to	o time for such period as may be desired by Employer.	o shall be extended from
5. W.	Guarantee shall not be determined or affected by liquidation or winding up,	Secolution or chance of
	tution or insolvency of the Vendor / Contractor / Supplier but shall in all respects	
	g and operative until payment of all money payable to the Employer in terms there	
31.530315.535	e de la company	
Unless	s a demand or claim under this guarantee is made on us in writi	ng on or before the
Mo	DANK INK.	
	BANK lastly undertake not to revoke this guarantee during its o	urrency except with the
	us consent of the Employer in writing.	
a)	hstanding anything to the contrary contained hereinabove:	
b)		
c)		THE STATE OF A PROCESS TO STATE OF A PAGE
	guarantee shall be forfeited and the Bank shall be relieved and discharged from	
	guarantee irrespective of whether or not the original bank guarantee is returned	to the Bank.
We, _	Bank, have power to issue this Guarantee under law and the	undersigned as a duly
authori	ized person has full powers to sign this Guarantee on behalf of the Bank.	missing as a any
		For and on behalf of
		(Name of the Bank)
Dated	Augustiana.	
200000000000000000000000000000000000000	of Issue	
race c	or reduce	

- 1 NAME AND ADDRESS OF EMPLOYER I.e Bharat Heavy Electricals Limited
- 2 NAME AND ADDRESS OF THE VENDOR /CONTRACTOR / SUPPLIER.
- 3 DETAILS ABOUT THE NOTICE OF AWARD/CONTRACT REFERENCE
- *CONTRACT VALUE
- 5 PROJECT/SUPPLY DETAILS
- ⁶ BG AMOUNT IN FIGURES AND WORDS
- 7 VALIDITY DATE
- * DATE OF EXPIRY OF CLAIM PERIOD

F. No. DPE/3(3)/10-Fin.
Government of India
Ministry of Finance
Department of Public Enterprises

Block No. 14, CGO Complex, Lodi Road, New Delhi-110003 Dated the 29th May, 2023

To,

Chief Executives of all CPSEs

Subject:- Concurrent application of Public Procurement Policy for Micro and Small Enterprises Order, 2012 and Public Procurement (Preference to Make in India) Order, 2017 - regarding

Sir/Madam,

The undersigned is directed to forward herewith a copy of Department of Expenditure O.M. dated 18th May, 2023 on the subject mentioned above for information and strict compliance.

Encl: As stated

(Kailash Bhandari)
Deputy Director
Tel: 2436-6247

Copy to :- Shri Kanwalpreet, Director, Department of Expenditure, Room No. 264-C. North Block, New Delhi.

No.F.1/4/2021-PPD Government of India Ministry of Finance Department of Expenditure Public Procurement Division

> 264-C, North Block, New Delhi. 18.05.2023.

OFFICE MEMORANDUM

Subject: Concurrent application of Public Procurement Policy for Micro and Small Enterprises Order, 2012 and Public Procurement (Preference to Make in India) Order, 2017.

The undersigned is directed to refer two Preferential Procurement Orders mandated for the Public Procurement in India, namely:

- Public Procurement Policy for Micro and Small Enterprises (MSEs) Order dated 23.03.2012 (PPP-MSE Order) issued by Ministry of Micro, Small and Medium Enterprises (MoMSME) in exercise of the powers conferred in Section 11 of the MSME Development Act, 2006. (Last revised on 09.11.2018)
- ii. Public Procurement (Preference to Make in India) Order, 2017 (PPP-MII order), under Rule 153(iii) of the General Financial Rules (GFRs) 2017, approved by the Cabinet. Implementation of this PPP-MII order is monitored by Department for Promotion of Industry and Internal Trade (DPIIT). (Last revised on 16.09.2020.)
- 2. It has been brought to the notice of this Department that concurrent application of these two orders are creating confusion to the procuring entities and different procuring entities interpret them differently. In order to bring predictability both to the procuring entities as well as bidders, following guidelines are being issued.

Guidelines

3. The Class-I local suppliers, under PPP-MII Order, participating in any government tender, may or may not be MSEs, as defined under the MSME Act. Similarly, MSEs participating in any government tender, may or may not be Class-I local suppliers. Suppliers may be categorised in following four broad categories for consideration or applicability of purchase preference:

Category	Terminology
Supplier is both MSE & Class-I local supplier.	"MSE Class-I local supplier"
Supplier is MSE but not Class-I local supplier.	"MSE but non-Class-I local supplier"
Supplier is not MSE but is Class-I loca supplier.	"Non-MSE but Class-I local supplier"
Supplier is neither MSE nor Class-I local.	"Non-MSE non-Class-I local supplier"

- 4. The applicability of PPP-MSE Order and PPP-MII Order in various scenarios, involving simultaneous purchase preference to MSEs and Class-I local suppliers under PPP-MSE Order and PPP-MII Order respectively, shall be as under:
- a) Items covered under Para 3(a) of PPP- MII Order, 2017 for which Nodal Ministry has notified sufficient local capacity and competition: For these items, only Class-I local suppliers are eligible to bid irrespective of purchase value. Hence, Class-II local suppliers or Non-local suppliers, including MSEs which are Class-II local suppliers/ Non-local suppliers, are not eligible to bid. Possible scenarios can be as under:
 - (i) L-1 is "MSE Class-I local supplier" 100% of the tendered quantity is to be awarded to L-1.
 - (ii) L-1 is "Non-MSE but Class-I local supplier" Purchase preference is given to MSEs as per PPP-MSE Order. Balance quantity is to be awarded to the L-1 bidder.
- b) Items reserved exclusively for procurement from MSEs as per PPP-MSE Order: These items are reserved exclusively for purchase from MSEs. Hence, non-MSEs are not eligible to bid for these items. Possible scenarios can be as under:
 - (i) L-1 is "MSE Class-I local supplier" 100% of the tendered quantity is to be awarded to L-1.
 - (ii) L-1 is "MSE non-Class–I local supplier" Purchase preference is to be given to Class-I local supplier as per PPP-MII Order. Balance quantity, is to be awarded to L-1 bidder.
- c) If items are neither notified for sufficient local capacity nor reserved for MSEs, then the process will be as follows:
 - c (a) Items covered under Para 3A(b) of PPP-MII Order are divisible items and both MSEs as well as Class-I local suppliers are eligible for purchase preference. Possible scenarios can be as under:
 - (i) L-1 is "MSE Class-I local supplier" 100% of the tendered quantity is to be awarded to L-1.
 - (ii) L-1 is "Non-MSE but Class-I local supplier" Purchase preference is to be given to MSEs, if eligible, as per PPP-MSE Order. Balance quantity is to be awarded to L-1 bidder.
 - (iii) L-1 is "MSE but non-Class-I local supplier" Purchase preference is to be given to Class-I local suppliers, if eligible, as per PPP-MII Order. Balance quantity is to be awarded to L-1 bidder.
 - (iv) L-1 is "Non-MSE non-Class-I local supplier" Purchase preference is to be given to MSEs as per PPP-MSE Order. Thereafter, purchase preference is to be given to Class-I local suppliers for "50% of the tendered quantity minus quantity allotted to MSEs

above" as per PPP- MII Order. For the balance quantity, contract is to be awarded to L-1 bidder. (Kindly refer to the illustrative example in the annexure).

- c (b) Items covered under Para 3A(c) of PPP-MII Order, 2017 are nondivisible items and both MSEs as well as Class-I local suppliers are eligible for purchase preference. Possible scenarios can be as under:
 - (i) L-1 is "MSE Class-I local supplier" Contract is awarded to L-1.
 - (ii) L-1 is not "MSE Class-I local supplier" but the "MSE Class-I local supplier" falls within 15% margin of purchase preference Purchase preference is to be given to lowest quoting "MSE Class-I local supplier". If lowest quoting "MSE Class-I local supplier" does not accept the L-1 rates, the next higher "MSE Class-I local supplier" falling within 15% margin of purchase preference is to be given purchase preference and so on.
 - (iii) If conditions mentioned in sub paras (i) and (ii) above are not met i.e. L-1 is neither "MSE Class-I local supplier" nor "MSE Class-I local supplier" is eligible to take benefit of purchase preference, the contract is to be awarded/ purchase preference to be given in different possible scenarios as under:
 - A. L1 is "MSE but non-Class-I local supplier" or "Non-MSE but Class-I local supplier" Contract is be awarded to L1.
 - B. L1 is "Non-MSE non-Class-I local supplier" First purchase preference to be given to MSE as per PPP-MSE Order. If MSE not eligible/ does not accept purchase preference to be given to Class- I Local supplier as per PPP-MII Order. If Class-I Local supplier also not eligible/ does not accept contract to be awarded to L-1.
- d) Items reserved for both MSEs and Class-I local suppliers: These items are reserved exclusively for purchase from MSEs as well as Class-I local suppliers. Hence, only "MSE Class-I local supplier" are eligible to bid for these items. Non-MSEs/Class-II local suppliers/ Non-local suppliers cannot bid for these items. Hence the question of purchase preference does not arise.

e) Non-local suppliers, including MSEs falling in the category of Non-local suppliers, shall be eligible to bid only against Global Tender Enquiry.

(Kanwalpreet)

Director

Tel.:-223093811; email: - kanwal.irss@gov.in

To

1. Secretaries of all Central Government Ministries/ Departments.

2. Secretary Department of Public Enterprises with a request for issuing suitable instructions to all Central Public Sector Enterprises in this regard.

Example explaining applicability in scenario explained in para 4 c (a)(iv)

(Scenario: Divisible items, both MSEs as well as Class-I local suppliers eligible for purchase preference and L-1 is "Non-MSE non-Class-I local supplier")

Item - Desktop computer

Qty - 50 Nos.

Details of bids received

Sr. No.	Name of bidder	Rates quoted	Price Ranking	Status of bidder
1.	А	100	L1	"Non-MSE non- Class-I local supplier"
2.	В	110	L2	"Non-MSE but Class-I local supplier"
3.	С	112	L3	"MSE but non- Class-I local supplier"
4.	D	115	L4	"Non-MSE but Class-I local supplier"
5.	Е	118	L5	"MSE but non- Class-I local supplier"
6.	F	120	L6	"MSE Class-I local supplier"

- 1. In this case, first purchase preference is to be given to MSEs as per PPP-MSE Order for 25% of tendered quantity of 50 Nos. i.e. 12.5 Nos. (rounded off to the next whole number say 13 Nos). Accordingly, invite L3 (bidder C), whose quoted rates falls within 15% margin of purchase preference to match L1 price i.e. Rs. 100/- for quantity of 13 Nos. Bidder "E" and "F", although MSEs, will not get purchase preference since their quoted rates don't fall within 15% margin of purchase preference. Bidder C will be considered for order of 13 Nos. on confirmation of reduction of price.
- 2. For 50% of balance quantity of 37 number (tendered quantity of 50 13 awarded to bidder C; assuming bidder C has confirmed to accept L1 rates), purchase preference will be given to lowest Class-I local supplier as per PPP-MII Order. Accordingly, bidder B will be invited to match L-1 price for 50% of 37 Nos i.e. 18.5 (say 19 Nos of computers). If bidder "B" does not accept the L1 price i.e. price of Rs. 100/- per unit, next higher Class-I local supplier falling within 20% margin of purchase preference, i.e. bidder "D", may be invited to match L-1 price for 19 Nos. of computers and so on.
- 3. For remaining quantity i.e. 18 Nos (50-13-19), the contract will be awarded to lowest quoting bidder i.e. Bidder "A", who is L-1 in the example.

Annexure-X

Restrictions under Rule 144(xi) of General Financial Rules, 2017 amendment dt: 23.07.2020

- I. Any bidder from a country which shares a land border with India will be eligible to bid in this tender only if the bidder is registered with the Competent Authority.
- II. "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any person or firm or company, including any member of a consortium or joint venture (that is an association of several persons, or firms or companies), every artificial juridical person not falling in any of the descriptions of bidders stated hereinbefore, including any agency branch or office controlled by such person, participating in a procurement process.
- III. "Bidder from a country which shares a land border with India" for the purpose of this Order means :
 - a. An entity incorporated, established or registered in such a country; or
 - b. A subsidiary of an entity incorporated, established or registered in such a country; or
 - c. An entity substantially controlled through entities incorporated, established or registered in such a country; or
 - d. An entity whose beneficial owner is situated in such a country; or
 - e. An Indian (or other) agent of such an entity; or
 - f. A natural person who is a citizen of such a country; or
 - g. A consortium or joint venture where any member of the consortium or joint venture falls under any of the above
- IV. The beneficial owner for the purpose of (iii) above will be as under:
 - 1. In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.

 Explanation-
 - a. "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent of shares or capital or profits of the company;
 - b. "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholders agreements or voting agreements;
 - 2. In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting alone or together, or through one or more juridical person, has ownership of entitlement to more than fifteen percent of capital or profits of the partnership;

- 3. In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has ownership of or entitlement to more than fifteen percent of the property or capital or profits of such association or body of individuals;
- 4. Where no natural person is identified under (1) or (2) or (3) above, the beneficial owner is the relevant natural person who holds the position of senior managing official;
- 5. In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen percent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.
- V. An Agent is a person employed to do any act for another, or to represent another in dealings with third person.

On Bidder Letter Head

Date:
To,
M/s Bharat Heavy Electricals Ltd.
Electronics Division, Mysore Road,'
Bangalore – 560026
Sub: Model Clause / Certificate as per clause 9 (a) of Revised Public Procurement (Preference to Make in India Order, 2017 of DPIIT dated 19.07.2024
Ref: BHEL Tender / RFQ / NIT Number
I (authorized signatory for M/s) a 'Class-I Local Supplier' / 'Class-II Local Supplier' at the time of tender, bidding or solicitation hereby confirm that the item meets the Local Content requirement for 'Class-I Local Supplier' / 'Class-II Local Supplier' .
Tick appropriate option & cut the other one:
1)We are the reseller/distributor of the quoted product and the Local Content percentage is Break up of Local value addition to be furnished below (inclusive of Taxes):
a)
b)
c)
OEM certificate for country of origin to be submitted for above.
2) We are not the reseller/distributor of the quoted product and the Local Content percentage is
The address is as below, where the local content / value addition is made:
[Factory Address]
For M/s
Authorized Signatory
(with company seal & Name)



ಭಾರತ್ ಹೆವಿ ಎಲೆಕ್ಟ್ರಿಕಲ್ಸ್ ಲಿಮಿಟೆಡ್ भारत हेवी इलेक्ट्रिकल्स लिमिटेड

Bharat Heavy Electricals Ltd., (A Government of India undertaking) Electronics Division

PB 2606, Mysore Road Bangalore, 560026 INDIA

CE: PR: 002- Rev 03

GENERAL COMMERCIAL CONDITIONS FOR CONTRACT

These 'General Commercial Conditions for Contract for Purchase' herein after referred to as GCC apply to all enquiries, tenders, requests for quotations, orders, contracts and agreements concerning the supply of goods and the rendering of related services (hereinafter referred to as "deliveries") to Bharat Heavy Electricals Limited and any of its units, regions or divisions (hereinafter referred to as "BHEL" or the Purchaser) or its projects/ customers.

Any deviations from or additions to these GCC require BHEL's express written consent. The general terms of business or sale of the vendor shall not apply to BHEL. Acceptance, receipt of shipments or services or effecting payment shall not mean that the general terms of business or sale of the vendor have been accepted.

Orders, agreements and amendments thereto shall be binding if made or confirmed by BHEL in writing. Only the Purchasing department of BHEL is authorized to issue the Purchase Order or any amendment thereof.

<u>Definitions:</u> Throughout these conditions and in the specifications, the following terms shall have the meanings assigned to them, unless the subject matter or the context requires otherwise.

- a) 'The Purchaser' means Bharat Heavy Electricals Limited, Electronics division, Mysore road, Bangalore 560 026, a Unit of Bharat Heavy Electricals Limited (A Govt. of India Undertaking) incorporated under the Companies Act having its registered office at BHEL House, Siri Fort, New Delhi-110049, India and shall be deemed to include its successors and assigns. It may also be referred to as BHEL.
- b) 'The vendor' means the person, firm, company or organization on whom the Purchase Order is placed and shall be deemed to include the vendor's successors, representative heirs, executors and administrator as the case may be. It may also be referred to as Seller, Contractor or Supplier.
- c) 'Contract' shall mean and include the Purchase Order incorporating various agreements, viz. tender/ RFQ, offer, letter of intent/acceptance/ award, the General Conditions of Contract and Special Conditions of Contract for Purchase, Specifications, Inspection/ Quality Plan, Schedule of Prices and Quantities, Drawings, if any enclosed or to be provided by BHEL or his authorized nominee and the samples or patterns if any to be provided under the provisions of the contract.
- d) 'Parties to the Contract' shall mean the 'The Vendor' and the Purchaser as named in the main body of the Purchase Order.

Order of Precedence:

In case of any inconsistency or contradiction between any of the documents, the order of precedence shall be Purchase Order, LOI / LOA, Special Conditions of Contract and General Conditions of Contract for commercial conditions; and specific agreement on technical conditions, RFQ/offer and specification for Technical Conditions.

Interpretation:

In the contract, except where the context requires otherwise:

- a) words indicating one gender include all genders;
- b) words indicating the singular also include the plural and words indicating the plural also include the singular;

- c) provisions including the word "agree", "agreed" or "agreement" require the agreement to be recorded in writing, and
- d) "Written" or "in writing" means hand-written, type-written, printed or electronically made, and resulting in a permanent record.

Applicable Conditions:

- 1. <u>Price Basis:</u> All prices shall be firm until the purchase order is executed / completed in all respects. No price variations / escalation shall be permitted.
- 2. Ordering and confirmation of Order: Vendor shall send the order acceptance on their company letter head/ through e-mail within a week from the date of receipt of Purchase Order or such other period as specified/ agreed by BHEL. BHEL reserves the right to revoke the order placed if the order confirmation differs from the original order placed. The acceptance of goods/services/supplies by BHEL as well as payments made in this regard shall not imply acceptance of any deviations.
 - The purchase order will be deemed to have been accepted if no communication to the contrary is received within one week (or the time limit as specified/agreed by BHEL) from the date of receipt of the purchase order.
- 3. <u>Documentation:</u> After receipt of Purchase Order, vendor should submit necessary documents (if & as applicable) like drawings specified, bill of materials, datasheets, catalogues, quality plan, test procedure, type test report, O & M Manuals and/or any other relevant documents as per Specification/Purchase Order, as and when required by BHEL/Customer.
 - At any stage within the contract period, the vendor shall notify of any error, fault or other defect found in BHEL's documents /specifications or any other items for reference. If and to the extent that (taking account of cost and time) any vendor exercising due care would have discovered the error, fault or other defect when examining the documents/specifications before submitting the tender, the time for completion shall not be extended. However if errors, omissions, ambiguities, inconsistencies, inadequacies or other defects are found in the vendor's documents, they shall be corrected at his cost, notwithstanding any consent or approval.

4. Penalty:

a. <u>For delay in documentation:</u> In the event of delay in submission of complete set of specified documents ((like drawings, bill of materials, datasheets, catalogues, quality plan etc. as called in tender specifications including soft copies wherever applicable) in required sets beyond two(02) weeks (or as agreed/indicated in the SCC/Purchase Order) from the date of receipt of Purchase Order(by email), penalty at 0.5% (half percent) per week or part thereof, limited to a maximum of 5% (five percent) of the basic material value of the Purchase Order will be applicable.

Penalty for delayed documentation if applicable, shall be deducted at the time of first supply payment. If penalty is applicable for duration of less than a week, penalty @ 0.5% (half percent) of the basic material value will be deducted. GST as applicable will be recovered along with penalty amount.

b. For delay in delivery: In the event of delay in agreed contractual delivery as per Purchase Order, penalty @ 0.5 % (half percent) per week or part thereof but limited to a max of 10% (ten percent) value of undelivered portion (basic material cost) will be applicable. Delivery will commence from the date of issue of Manufacturing clearance along with approved document. The date for which Inspection call is issued by vendor along with test certificates / test reports /Certificate of Conformance / calibration reports, as proof of completion of manufacturing will be treated as date of deemed delivery for penalty calculation. In the absence of furnishing such document indicated above as proof of completion of manufacturing along with inspection call, actual date of inspection will be considered as date of deemed delivery and BHEL will not be responsible for delay in actual date of inspection.

Penalty for delayed delivery if applicable, shall be deducted at the time of first supply payment. If penalty is applicable for duration of less than a week, penalty @ 0.5% (half percent) of the basic material value will be

deducted.

- 5. Contract variations (Increase or decrease in the scope of supply): BHEL may vary the contracted scope as per requirements at site. If vendor is of the opinion that the variation has an effect on the agreed price or delivery period, BHEL shall be informed of this immediately in writing along with technical details. Where unit rates are available in the Contract, the same shall be the basis for such additional work. Vendor shall not perform additional work before BHEL has issued written instructions/ amendment to the Purchase Order to that effect. The work which the vendor should have or could have anticipated in terms of delivering the service(s) and functionality (i.e.) as described in this agreement, or which is considered to be the result of an attributable error on the vendor's part, shall not be considered additional work.
- 6. <u>Pre-dispatch inspection at Seller premises</u>: Before dispatch, the goods will be inspected by Buyer / Consignee or their Authorized Representative or by Nominated External Inspection Agency (independently or jointly with Buyer or Consignee as decided by the Buyer) at Seller premises (or at designated place for inspection as declared / communicated by the seller) for their compliance to the contract specification. For in-house testing, the Sellers will provide necessary facilities free of cost.

Prior written notice of at least 10 days shall be given along with internal test certificates/COC and applicable test certificates. Buyer will notify the Seller about the Authorized Representative/ Nominated External Inspection Agency and the date for testing. Scope of inspection is limited to 'approved Quality plan or QA Checklist or Purchase specification'. BHEL reserves the right for conducting repeat test, if required. All tests have to be conducted as applicable in line with approved Quality plan or QA Checklist or Purchase specification and original reports shall be furnished to BHEL-EDN, Bangalore for verification/acceptance for issue of dispatch clearance.

All costs related to re-inspection(s) shall be borne by vendor. Whether the Contract provides for tests on the premises of the vendor or any of his Sub-contractor/s, vendor shall be responsible to provide such assistance, labour, materials, electricity, fuel, stores, apparatus, instruments as may be required and as may be reasonably demanded to carry out such tests efficiently. Cost of any type test or such other special tests shall be borne by BHEL only if specifically agreed to in the purchase order.

7. Transit Insurance: Transit insurance coverage between vendor's works and project site shall be to the account of BHEL, unless specifically agreed otherwise. However, vendor shall send intimation directly to insurance agency (as mentioned in dispatch instructions issued by BHEL) through fax/courier/e-mail, immediately on dispatch of goods for covering insurance. A copy of such intimation sent by vendor to insurance agency shall be given to BHEL along with dispatch documents. Dispatch documents will be treated as incomplete without such intimation copy. BHEL shall not be responsible for sending intimations to insurance agency on behalf of the vendor.

8. Mode of dispatch:

<u>Indigenous Scope</u>: By road on Door Delivery Consignee Copy attached basis through your approved transporter (unless otherwise indicated in Dispatch Instructions), only on receipt of Despatch Clearance from BHEL.

<u>Import Scope</u>: By Air/Sea through BHEL approved Freight Forwarder/supplier approved Consolidator respectively as per agreed contractual terms, only on receipt of Dispatch Clearance from BHEL.

9. Changes in Statutory levies:

If any rates of Tax are increased or decreased, a new Tax is introduced, an existing Tax is abolished, or any change in interpretation or application of any Tax occurs in the course of the execution of Contract, which was or will be assessed on the bidder in connection with performance of the Contract, an equitable adjustment of the Contract Price shall be made to fully take into account any such change by addition to the Contract Price or deduction there from, as the case may be. However, these adjustments would be restricted to direct transactions between BHEL and the bidder /agent of foreign bidder (if applicable). These adjustments shall not be applicable on procurement of raw materials, intermediary components etc. by the bidder /agent.

It is the obligation on the part of supplier to discharge his liability by payment of GST to Government of India in cash (or) utilization of input Tax credit in respect of such supply or services through GST invoice under this contract, so that BHEL will avail input tax credit on such supply. In the event that the input tax credit of the GST charged by the supplier is denied by the tax authorities to BHEL due to reasons attributable to supplier, BHEL shall be entitled to recover such amount from the supplier by way of adjustment from the next invoice or from Bank Guarantee. In addition to the amount of GST, BHEL shall also be entitled to recover interest and penalty, in case same is imposed by the tax authorities on BHEL.

If BHEL is not able to avail the credit of CGST & SGST/IGST, partially or entirely because the supplier issued a defective invoice or failed to produce the requisite documents, then the supplier shall immediately indemnify BHEL for such loss of tax credit which would be otherwise available to BHEL. BHEL, in such case, may, at its sole discretion, decide to recover such loss by way of deduction from payment due to the supplier or invoking the contract Performance Bank Guarantee.

The classification of goods as per GST should be correctly done by the supplier to ensure that ITC benefit is not lost to the BHEL on account of any error on the part of the supplier.

Any statutory increase in the CGST & SGST / IGST or any new or additional taxes or duties imposed within the Contractual Delivery Period or extended Contractual Delivery Period shall be to BHEL's account whereas if it is after Contractual Delivery period, it shall be to supplier's account. Any corresponding decrease on account of above shall be passed on to BHEL.

In case GST or any taxes or duties is not applicable at present but become applicable at the time of contractual delivery period due to any reason other than statutory, the same shall be borne by supplier.

- 10. <u>Availing duty/tax exemption benefits by bidder, wherever applicable</u>: BHEL shall issue the required Certificate/s, as per relevant policies of the Govt. of India, to facilitate the bidders to avail any such benefits under the Contract. In case of failure of the bidders to receive the benefits partly or fully from the Govt. of India and/or in case of any delay in receipt of such benefits, BHEL shall neither be liable nor responsible in any manner whatsoever.
- 11. Taxes against sub-vendor dispatches: All taxes/levies, as applicable in respect of all components, equipments and material to be despatched directly from the sub-vendor's works to Site irrespective of the fact whether such taxes and levies are assessable and chargeable on Vendor or the BHEL, shall be to the vendor's account and no separate claim in this regard will be entertained by BHEL.
- 12. <u>High Sea Sales (HSS):</u> Customs clearance of the consignment landed on Indian Sea/Air ports will be done by BHEL based on the original HSS documents provided by vendors.

 Any delay in submission of complete/correct HSS documents to BHEL may incur demurrage charges. All demurrage charges on account of incomplete /incorrect HSS documents submission by vendor will be to vendor's account and all such charges will be recovered from any of the available vendor bills with BHEL.
- 13. Packaging and dispatch: The Seller shall package the goods safely and carefully and pack them suitably in all respects considering the peculiarity of the material for normal safe transport by Sea/ Air / Rail/ Road to its destination suitably protected against loss, damage, corrosion in transit and the effect of tropical salt laden atmosphere. The packages shall be provided with fixtures/ hooks and sling marks as may be required for easy and safe handling. If any consignment needs special handling instruction, the same shall be clearly marked with standard symbols / instructions. Hazardous material should be notified as such and their packing, transportation and other protection must conform to relevant regulations.
 - The packing, shipping, storage and processing of the goods must comply with the prevailing legislation and regulations concerning safety, the environment and working conditions. For facilitating smooth movement of shipment, the consignment has to be in stackable condition. Any Imported/Physical Exports items packed with raw/ solid wood packing material should be treated as per ISPM 15 (fumigation) and accompanied by Phytosanitory/ Fumigation certificate. If safety information sheets (MSDS Material Safety Data Sheet)

exist for an item or the packaging, vendor must provide this information without fail along with the consignment.

Each package must be marked with Consignee name, Purchase order number, Package number, Gross weight and net weight, dimensions (LxBxH) and Seller's name. Packing list of goods inside each package with PO item number and quantity must also be fixed securely outside the box to indicate the contents of each box. Total number of packages in the consignment must also be indicated in the packing list.

- Separate packing & identification of items should be as follows.

 1. Main Scope All items must be tagged with part no. & item description.
- 2. Commissioning accessories/spares All items must be tagged with part no. & item description.
- 3. Mandatory spares All items must be tagged with part no. & item description.

Nevertheless, vendor shall adhere to dispatch & packing instructions issued by BHEL at the time of dispatch.

- 14. <u>Assignment of Rights & Obligations; Subcontracting:</u> Vendor is not permitted to subcontract the delivery or any part thereof to third party or to assign the rights and obligations resulting from this agreement in whole or in part to third parties without prior written permission from BHEL. Any permission or approval given by the BHEL shall, however, not absolve the vendor of the responsibility of his obligations under the Contract.
- 15. <u>Progress report:</u> Vendor shall render such report as to the progress of work and in such form as may be called for by the concerned purchase officer from time to time. The submission and acceptance of such reports shall not prejudice the rights of BHEL in any manner.
- 16. Non-disclosure and Information Obligations: Vendor shall provide with all necessary information pertaining to the goods as it could be of importance to BHEL. Vendor shall not reveal any specified confidential information that may be divulged by BHEL to Vendor's employees not involved with the tender/ contract & its execution and delivery or to third parties, unless BHEL has agreed to this in writing beforehand. Vendor shall not be entitled to use the BHEL name in advertisements and other commercial publications without prior written permission from BHEL.
- 17. <u>Cancellation /Termination of contract:</u> BHEL shall have the right to completely or partially terminate the agreement by means of written notice to that effect. Termination of the Contract, for whatever reason, shall be without prejudice to the rights of the parties accrued under the Contract up to the time of termination.
 - BHEL shall have the right to cancel/foreclose the Order/ Contract, wholly or in part, in case it is constrained to do so on account of any decline, diminution, curtailment or stoppage of the business.
- 18. <u>Breach of Contract, Remedies & Termination</u>: In case of breach of contract (failure of supplier), wherever the value of Performance security available with BHEL against the said contract is at least 10% of the contract value, the same shall be encashed.

In case the value of the security instruments available with BHEL is less than 10% of the contract value, the balance amount will be recovered from other financial remedies (i.e. available bills of the contractor, retention amount, etc. with BHEL) or legal remedies shall be pursued.

Further, levy of liquidated damages, debarment, termination, de-scoping, short-closure, etc. shall be applied as per provisions of the contract.

19. <u>Shortages:</u> In the event of shortage on receipt of goods and/or on opening of packages at site, all such shortages, caused by supplier's act or omission, shall be made good at free of cost within a reasonable time that BHEL may allow from such intimation.

<u>Transit Damages:</u> In the event of receipt of goods in damaged condition or having found them so upon opening of packages at site, supplier shall make good of all such damages within a reasonable time from such intimation by BHEL. In case BHEL raises an insurance claim, the cost of material limited to insurance settled amount less handling charges will be reimbursed to supplier.

- 20. Remedial work: Notwithstanding any previous test or certification, BHEL may instruct the vendor to remove and replace materials/goods or remove and re-execute works/services which are not in accordance with the purchase order. Similarly BHEL may ask the vendor to supply materials or to execute any services which are urgently required for any safety reasons, whether arising out of or because of an accident, unforeseeable event or otherwise. In such an event, Vendor shall provide such services within a reasonable time as specified by BHEL.
- 21. <u>Indemnity Clause:</u> Vendor shall comply with all applicable safety regulations and take care for the safety of all persons involved. Vendor is fully responsible for the safety of its personnel or that of his subcontractor's men / property, during execution of the Purchase Order and related services. All statutory payments including PF, ESI or other related charges have to be borne by the vendor. Vendor is fully responsible for ensuring that all legal compliances are followed in course of such employment. Vendor shall fully indemnify and keep indemnified BHEL against all claims of whatsoever nature arising during the course and out of execution of this Order/Contract.
- 22. Product Information, Drawings and Documents: All specified drawings, technical documents or other technical information received by Vendor from BHEL or vice versa shall not, without the consent of the other party, be used for any other purpose than that for which they were provided. They may not, without the consent of the Disclosing party, otherwise be used or copied, reproduced, transmitted or communicated to third parties. All information and data contained in general product documentation, whether in electronic or any other form, are binding only to the extent that they are by reference expressly included in the contract.

Vendor, as per agreed date/s but not later than the date of delivery, provide free of charge information and drawings which are necessary to permit and enable BHEL to erect, commission, operate and maintain the product. Such information and drawings shall be supplied in as many numbers of copies as may be agreed upon.

All intellectual properties, including designs, drawings and product information etc. exchanged during the formation and execution of the Contract shall continue to be the property of the disclosing party.

- 23. Intellectual Property Rights, Licenses: If any Patent, design, Trade mark or any other intellectual property rights apply to the delivery (goods/related service) or accompanying documentation shall be the exclusive property of the Vendor and BHEL shall be entitled to the legal use thereof free of charge by means of a non-exclusive, worldwide, perpetual license. All intellectual property rights that arise during the execution of the Purchase Order/ contract for delivery by vendor and/or by its employees or third parties involved by the vendor for performance of the agreement shall belong to BHEL. Vendor shall perform everything necessary to obtain or establish the above mentioned rights. The Vendor guarantees that the delivery does not infringe on any of the intellectual property rights of third parties. The Vendor shall do everything necessary to obtain or establish the alternate acceptable arrangement pending resolution of any (alleged) claims by third parties. The Vendor shall indemnify BHEL against any (alleged) claims by third parties in this regard and shall reimburse BHEL for any damages suffered as a result thereof.
- 24. Force Majeure: If at any time during the continuance of the Contract, the performance in whole or in part by either party of any obligation under this Contract shall be prevented or delayed by the reasons of any war, hostility, acts of the public enemy, epidemics, civil commotion, sabotage, fires, floods, explosion, quarantine restrictions, strikes, lockouts or act of God provided notice of happening of such event duly evidenced with documents is given by one party to the other within 10 days from the date of occurrence thereof, neither party shall be by reasons of such event, be entitled to terminate the Contract nor shall either party have any claim for damages against the other in respect of such non-performance or the delay in performance, and deliveries under the contract shall be resumed as soon as practicable after such event has come to an end or ceased to exist, and the decision of the Buyer as to whether the deliveries have been so resumed or not, shall be final and conclusive.

If force majeure applies, dates by which performance obligations are scheduled to be met will be extended for a period of time equal to the time lost due to any delay so caused.

Notwithstanding above provisions, in an event of Force Majeure, BHEL reserves for itself the right to cancel the order/ contract, wholly or partly, in order to meet the overall project schedule and make alternative arrangements for completion of deliveries and other schedules.

25. Warranty:

Wherever required, and so provided in the specifications/ Purchaser Order, the Seller shall ensure that the goods supplied shall comply with the specifications laid down, for materials, workmanship and performance.

Unless otherwise specified in SCC, warranty period shall be applicable for a period of 24 months from the date of delivery of goods or 18 months from the date of commissioning of goods, whichever is earlier.

The warranty period as described above shall apply afresh to replaced, repaired or re-executed parts of a delivery. Unless otherwise specifically provided in the Purchase Order, Vendor's liability shall be co terminus with the expiration of the applicable warranty period.

26. <u>Limitation of Liability:</u> Vendor's liability towards this contract is limited to a maximum of 100% of the contract value and consequential damages are excluded. However the limits of liability will have no effect in cases of criminal negligence or wilful misconduct.

The total liability of Vendor for all claims arising out of or relating to the performance or breach of the Contract or use of any Products or Services or any order shall not exceed the total Contract price.

27. <u>Liability during warranty</u>: Vendor shall arrange replacement / repair of all the defective materials / services under its obligation during the warranty period. The rejected goods shall be taken away by vendor and replaced / repaired. In the event of the vendor's failure to comply, BHEL may take appropriate action including disposal of rejections and replenishment by any other sources at the cost and risk of the vendor.

In case, defects attributable to vendor are detected during Warranty period or where the commissioning call is issued within the warranty period, vendor shall be responsible for replacement/ repair of the goods as required by BHEL at vendor's cost even after expiry of warranty period.

Further if the equipment or any part thereof cannot be used by reason of such defect and/or making good of such defect, the warranty period of the equipment or such part, as the case may be, shall be extended by a period equal to the period during which the equipment or such part cannot be used by BHEL because of any of the aforesaid reasons. Upon correction of the defects in the facilities or any part thereof by repair/replacement, such repair/replacement shall have the warranty period for a period of twelve (12) months from the time such replacement/repair of the equipment or any part thereof has been completed.

- 28. <u>Liability after warranty period</u>: At the end of the warranty, the Vendor's liability ceases except for latent defects. For the purpose of this clause, latent defects shall be the defects inherently lying within the material or arising out of design deficiency which do not manifest themselves during the warranty Period, but later. The Contractor's liability for latent defects warranty for the equipment including spares shall be limited to a period of six months from the end of the warranty period of the respective equipment including spares or first time commissioning, whichever is later but not later than one (01) year from the date of expiry of warranty period.
- 29. <u>Compliance with Laws:</u> Vendor shall, in performing the contract, comply with all applicable laws. The vendor shall make all remittances, give all notices, pay all taxes, duties and fees, and obtain all permits, licences and approvals, as required by the laws in relation to the execution and completion of the contract and for remedying of any defects; and the Contractor shall indemnify and hold BHEL harmless against and from the consequences of any failure to do so.
- 30. <u>Settlement of Disputes:</u>Except as otherwise specifically provided in the Purchase Order, decision of BHEL shall be binding on the vendor with respect to all questions relating to the interpretation or meaning of the

terms and conditions and instructions herein before mentioned and as to the completion of supplies/work/services, other questions, claim, right, matter or things whatsoever in any way arising out of or relating to the contract, instructions, orders or these conditions or otherwise concerning the supply or the execution or failure to execute the order, whether arising during the schedule of supply/work or after the completion or abandonment thereof. Any disputes or differences among the parties shall to the extent possible be settled amicably between the parties thereto, failing which the disputed issues shall be settled through arbitration. Vendor shall continue to perform the contract, pending settlement of dispute(s).

31. <u>Arbitration Clause in case of Contract with vendors other than Public Sector Enterprise (PSE) or a Government Department:</u>

Arbitration & Conciliation:

The parties shall attempt to settle any disputes or difference arising out of the formation, breach, termination, validity or execution of the Contract; or, the respective rights and liabilities of the parties; or, in relation to interpretation of any provision of the Contract; or, in any manner touching upon the Contract, or in connection with this contract through friendly discussions. In case no amicable settlement can be reached between the parties through such discussions, in respect of any dispute; then, either Party may, by a notice in writing to the other Party refer such dispute or difference to the sole arbitration of an arbitrator appointed by Head of the BHEL–EDN. Such Sole Arbitrator appointed, shall conduct the arbitration in English language.

The Arbitrator shall pass a reasoned award and the award of the Arbitration shall be final and binding upon the Parties.

Subject as aforesaid, the provisions of Arbitration and Conciliation Act 1996 (India) or statutory modifications or re-enactments thereof and the rules made thereunder and for the time being in force shall apply to the arbitration proceedings under this clause. The seat of arbitration shall be Bangalore. The cost of arbitration shall be borne as decided by the Arbitrator upon him entering the reference. Subject to the Arbitration Clause as above, the Courts at Bangalore alone shall have exclusive jurisdiction over any matter arising out of or in connection with this Contract.

Notwithstanding the existence or any dispute or differences and/or reference for the arbitration, the parties shall proceed with and continue without hindrance the performance of its obligations under this Contract with due diligence and efficiency in a professional manner except where the Contract has been terminated by either Party in terms of this Contract.

<u>Arbitration Clause in case of Contract with a Public Sector Enterprise (PSE) or a Government Department:</u>

In the event of any dispute or difference relating to the interpretation and application of the provisions of the Contract, such dispute or difference shall be referred by either party for Arbitration to the Sole Arbitrator in the Department of Public Enterprises to be nominated by the Secretary to the Government of India in-charge of the Department of Public Enterprises. The Arbitration and Conciliation Act, 1996 shall not be applicable to arbitration under this clause. The award of the Arbitrator shall be binding upon the parties to the dispute, provided, however, any Party aggrieved by such Award may make further reference for setting aside or revision of the Award to the Law Secretary, Department of Legal Affairs, Ministry of Law and Justice, Government of India. Upon such reference the dispute shall be decided by the Law Secretary or the Special Secretary or Additional Secretary when so authorized by the Law Secretary, whose decision shall bind the Parties hereto finally and conclusively. The Parties to the dispute will share equally the cost of arbitration as intimated by the Arbitrator.'

32. <u>Applicable Laws and Jurisdiction of Courts:</u> Prevailing Indian laws both substantive and procedural, including modifications thereto, shall govern the Contract. Subject to the conditions as aforesaid, the competent courts in Bangalore alone shall have jurisdiction to consider over any matters touching upon this contract.

33. <u>General Terms:</u> That any non-exercise, forbearance or omission of any of the powers conferred on BHEL and /or any of its authorities will not in any manner constitute waiver of the conditions hereto contained in these presents.

That the headings used in this agreement are for convenience of reference only.

That all notices etc., to be given under the Purchase order shall be in writing, type script or printed and if sent by registered post or by courier service to the address given in this document shall be deemed to have been served on the date when in the ordinary course, they would have been delivered to the addressee.

Pre-Qualification Criteria

Item: VFDs for CEP & RC Pump { 1200kW, 3.3kV Motor }

Project: Talcher TPS Project (2x 660 MW)

Customer: NTPC

- 1. The vendor shall be an Original Equipment Manufacturer (OEM) of VFD Equipment. Only the OEM can submit offers.
- 2. The vendor should have designed, engineered, manufactured, type tested or got type tested, supplied and commissioned or supervised commissioning of at least one (1) number of VFD system (of the type & model offered) for feeding squirrel cage induction motor/ synchronous motor of 1200kW, 3.3kV or higher rating, which is in successful operation for a period of at least one (1) year as on 01.04.2025. Necessary supporting document shall be provided. The Reference List of VFD supplies made giving the ratings, application, details of the customers, year of supply and commissioning status to be provided along with the offer.
- 3. Vendor should also have supply reference of the type & model of VFD offered with separately placed transformer.
 - Necessary supporting document shall be provided. The Reference List of VFD supplies made giving the ratings, year of supply, application and details of the customers etc. to be provided along with the offer.
- 4. The vendor or their authorized service representatives shall have trained engineers for commissioning & service for the offered equipment and shall be in a position to provide prompt after sales service and spares support for our installations. This service network shall necessarily be available in India.
- 5. The vendor shall be in a position to undertake AMC or provide service support for the equipment supplied, after the expiry of the warranty / guarantee period either directly or through a service representative.
- 6. Technical clearance of vendor offer will be based on Customer acceptance of Vendor Credentials (does not apply to Customer approved vendors for this project).

Note:

- a. Vendor must furnish all necessary supporting documents, as required, along with the bid to satisfy Pre-Qualification criteria as specified above.
- b. The Pre-Qualification criteria are mandatory requirements and the technical bids will be evaluated only when the Pre-Qualification criteria are met.

Checklist for Pre-Qualification Criteria

Sl.	Vendor	Reference of documents
No.	Confirmation to the	attached
	points above	
1	Yes / No	
2	Yes / No	
3	Yes / No	
4	Yes / No	
5	Yes / No	
6	Yes / No	

चारप डे एन स्ट्रीस
A4 – 12

COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 00 OF 21

REVISION HISTORY SHEET

ιy.						
of the compar	REV. NO.	DATE	NATURE OF CHANGE	REASONS	PREPARED BY	APPROVED BY
It must not be used directly or indirectly in anyway detrimental to the interest of the company.	00 01 02	31-07-2020 12-11-2021 11-03-2022	FIRST ISSUE SECOND ISSUE THIRD ISSUE	GENERALLY REVD. TRF. TEMP RISE CLAUSE UPDATED, LIMITING DIMENS. UPDATD. IN ANNEX		L SUBBALAKSHMI L. SUBBALAKSHMI L. SUBBALAKSHMI
It must n						

REVISION	02	APPROVED BY L SU	BBALAKSHMI	
		PREPARED BY GITESH DAS	ISSUED BY T&PD/COE	DATE 11-03-2022



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 01 OF 21

TECHNICAL SPECIFICATION OF IGBT/ IGCT/ SGCT BASED VFD FOR SQUIRREL CAGE INDUCTION MOTOR

1. Project Details

	SI. No.	Parameter	Specification
-	1	Project title	
	2	Customer	As per attached Annexure to Specification

2. Environment Specifications

SI. No.	Parameter	Specification
1	Maximum Ambient Temperature	
2	Minimum Ambient Temperature	
3	Equipment Design Temperature (IS-9676)	
4	Relative Humidity	As per attached Annexure to Specification
5	Altitude	
6	Location of VFD Panels	
7	Seismic Zone	
8	Environment	

	REVISION 02	APPROVED BY L SUBE	BALAKSHMI	
		PREPARED BY GITESH DAS	ISSUED BY T&PD/COE	DATE 11-03-2022



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 02 OF 21

3. Input and Transformer Data

SI. No.	Parameter	Specification
1	System Voltage / Frequency / Phase	
2	Voltage Variation	
3	Frequency Variation	Refer attached Annexure to Specification
4	Combined Voltage and Frequency Variation	
5	Fault Level	
6	Transformer Type	
7	Rating	Transformer must be designed to carry 110% current of calculated VFD rating. Transformer sizing calculation shall be provided along with offer.
8	Power Cables	 Cable glands (Weatherproof) to be provided by the vendor for Transformer HV side cable termination suitable for Cable size mentioned in Annexure to Specification. The exact no. and size will be intimated during drawing approval stage. Cables and termination kits are in Customer /BHEL scope. All interconnecting cables and cable lugs for VFD panel to Transformer connection to be provided by vendor. Refer attached Annexure to Specification for more details. For VFD with non-integrated Transformer, Power Cables selection between Transformer & VFD shall also consider adequate derating factor as
		these cables shall be routed through trenches and trays. 3. For VFD panel with non-integrated type transformer, Cables glands and termination kits for connection between Transformer LV side and VFD input side termination shall also be supplied by the vendor.
9	Termination cubicle	Any special termination cubicle, supporting structures, etc. if required for non-integrated type VFD system shall also be supplied by the VFD vendor.



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 03 OF 21

4. Motor Data

SI. No.	Parameter	Specification		
1	Туре	Squirrel Cage Induction Motor		
2	Scope	Manufactured by BHEL-Bhopal		
3	Rating (kW)	Refer attached Annexure to Specification		
4	Rated Voltage and Current	Refer attached Annexure to Specification		
5	Fed from	Variable Frequency Drive (V/f Control)		
6	Duty Class	Continuous - S1		
7	Efficiency and Power Factor	Refer attached Annexure to Specification		
8	Power Cables	Cable glands (Weatherproof) to be provided by the vendor for VFD Output side cable termination suitable for cable sizes mentioned in the attached Annexure.		
		The exact no. and size will be intimated during drawing approval stage. Cables and termination kits are in Customer /BHEL scope.		



PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 04 OF 21

5. Scope:

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

SI. No.	Scope of Supply	Description			
1	Refer Consolidated Scope of Supply and Services in attached Annexure for details.	The vendor shall be responsible for engineering and functioning of the complete VFD system comprising of Dry			
2	 a) All interconnecting cables between VFD panel and Transformer panel both for integrated type VFD system and non- Integrated type VFD system. b) Any special cable other than power and control cables from VFD to other equipment. c) Power Cable glands & lugs for VFD and transformer. d) Any special tools and tackles. 	type Transformer and VFD panel, meeting the intent and requirement of this specification, Customer specification and datasheet. This shall include but not be limited to inverter sizing, transformer sizing, transformer impedance selection, vector group, input and output harmonic filter design and sizing, output dv/dt filter sizing, adequacy of motor cable size selected by BHEL etc. All necessary interlocks as required for safe and reliable operation of VFD system along with Input breaker shall be provided in VFD system. If any special arrangement is required in input breaker, same shall be informed by the vendor in offer. The machine shall continuously run on VFD.			



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 05 OF 21

6. VFD Specifications:

SI.No.	Parameter	Specification	
1	Drive Application	Refer attached Annexure to Specification	
2	Input Voltage	From Dry type Transformer.	
3	Power/Torque vs Speed	Torque α Speed ² Power α Speed ³	
4	Single Line Diagram		
5	Output Voltage of VFD	Refer attached Annexure to Specification	
6	Output Current of VFD		
7	Output Frequency	0 to 50Hz , Resolution: +/- 0.01% under transient conditions; +/- 0.5% under steady state conditions	
8	Overload capacity	Refer attached Annexure to Specification	
9	Speed Regulation & Speed Accuracy	+ 0.5% +1%	
10	Drive Control	Sensorless Vector Control	
11	Braking Operation	Not Applicable	
12	Output LC Sinusoidal Filter	Motor is designed for PWM operation. Distance between VFD and Motor are as per Annexure attached with Specification. Vendor to clarify and offer output Filter, if required.	



PURCHASE SPECIFICATION

P.S NO. : PS/445/2636

REV. NO: 02

	11,,11			REV. NO: 02	
	A4 – 11	GROUP:	T&PD/COE	PAGE 06	OF 21
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.		D Panel nstruction	a) Protection Class: Please refer b) Panel: Free standing, floor morigid welded structural frames Steel enclosure of minimum bearing structure & frame and etc. (Enclosure Spec attack removable covers shall have washable dust filters. c) Busbar Material — Electrolytic coded. Sleeving/shrouding for done. d) Cooling: Forced Air Cooled VI Cooling system shall include adequate cooling air flow path the panel dimensions and designed for continuous runnin without overheating. e) Earth Bus — minimum 50*6 mm f) Door Interlock: The VFD shall safety. This interlock system s the power cabinets can be ope of power is disconnected or will power to trip. Additionally, the should ensure that power cadrive unless the doors are classed to be given for all surfaces of Epoxy Based with Powder RAL9002 front and rear part to be given for all surfaces of Epoxy Based with Powder RAL9002 front and rear part of begiven for all surfaces of Epoxy Based with Powder RAL9002 front and rear part of Epoxy Based with Po	swith Cold Rothickness 2 m 1.6 mm for Doched). All cave neoprender e easily remove the easily remove to the easily remove the easily remov	omprising of olled Sheet on olled Sheet olled



A4 – 11

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 07 OF 21

IMITED.	13	VFD Panel Construction	 j) All electronic modules and components shall be accessible from front of panel only. Modular assemblies for both the system control electronic equipment and power electronic equipments shall be used. k) All low voltage compartment and cabling shall be electrically and physically separated from the high voltage compartment. l) 20% spare terminals shall be provided for future use. m) For limiting dimensions (if applicable), refer attached annexure.
TRICALS L	14	Noise Level	Shall be less than 85dB at a distance of 1 metre from the outline of VFD Panels at a height of 1.5 metres from the floor with all the fans running in the VFD Panels.
LEC	15	Storage Temp.	-40°C to +60 °C
Y E he ii	16	Vibration	According to IEC68-2-6
COPYRIGHT AND CONFIDENTIAL ent is the property of BHARAT HEAV or indirectly in anyway derimental to t	17	Interference	According to IEC801 parts 2,3,4 Immunity: The panels shall be designed so as to have low Radio Freq Interference (RFI) & Electromagnetic Interference (EMI).
F AND Coperty of Bin anyway	18	VFD Efficiency	Shall be as per attached Annexure. Exact value to be specified by the Vendor in Datasheet.
GHT pro ctly	19	Duty Cycle	Class I Duty Cycle as per IEC 146-1
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.	20	VFD Requirements	 a) Input Choke: Input chokes to be provided, if necessary. b) Local/Remote: Selector switch shall be provided for operator to select type of operation: Local – Operation from VFD Panel for Speed Control from door mounted interface; Remote – Operation from DCS. If VFD is set for speed reference from Remote, it shall be possible to program the VFD to either shutdown, go to minimum speed or continue operation at its last known speed reference point whenever a loss of speed reference is detected. c) Local Start/Stop Push Button to be provided either on Panel door or on keypad. d) Door Mounted Lockable Push-Button with cover to be provided with 2NO + 2 NC contact for Emergency Stop. One normally open and close contact to be wired to Terminal Block for external Interlocking / Annunciation. e) Every Panel shall be provided with illumination lamp with limit switch and MCB. Space heater shall be provided in panel with switch fuse and variable setting thermostat. 240V power socket with MCB shall be provided.



A4 – 11

PURCHASE SPECIFICATION


GROUP: T&PD/COE

P.S NO. : PS/445/2636 REV. NO: 02

PAGE 08 OF 21

SI. N	lo. Parameter	Specification
20		 f) 230V, 1phase, 50Hz (exact rating during drawing approval stage) Power Supply to the motor space heater shall be derived from VFD. Necessary interlocking arrangement for this supply shall also be made available in the VFD panels. g) PLC: PLC shall be provided for Interlocking and Protection (if required) h) The expected life time of the drive system shall be minimum 20 years. The system including all individual components forming part of the system shall have an availability of minimum 0.997 and a minimum MTBF of 4 years. i) Any special requirement regarding CT/ PT, protection relay or any other device, in input breaker, which is required for functioning and protection of VFD system shall be considered by the VFD vendor in their scope.
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.	VFD Features	 a) Soft Start and Auto Restart b) Auto Speed Search Facility (Catch on Fly) shall be available for starting into rotating loads. c) Power loss ride through (Kinetic Buffering) and for voltage dips over 20% or Power interruption for less than 2 secs. d) Automatic VFD tuning during start-up. e) Flux optimisation function shall be provided to reduce the total energy consumption and noise level in case drive is operated below nominal load. f) Selectable reverse run prohibition g) Adjustable motor overload feature h) Settable minimum and maximum operating frequency i) VFD shall produce not greater than 1% torque pulsation to the shaft of driven equipment. j) Field adjustable Torque limits and acceleration and deceleration ramps k) Accelerate / Decelerate Times to be specified. l) Four (4) user programmable preset speeds. m) The equipment may be stored outdoors for long periods before installation. The packing should also be suitable for outdoor storage areas with heavy rains / high ambient temperatures. n) Vendor shall certify readiness of system fit for commissioning. Vendor's scope shall also include supply of all specialized tools and tackles required. o) VFDs shall be installed in Air-conditioned area but it shall be suitable for operation in non-air-conditioned area also. p) Earthing scheme should be provided by the vendor.

H f	हे एस हिंदि	PURC	CHASE SPECIFICATION	P.S NO. : PS/445/2636 REV. NO: 02		
A4 -	11	GRO	UP: T&PD/COE	PAGE	09	OF 21
21	VFI	D Features	q) Any special cable other than prequired to connect VFD to oth vendor scope.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.		ntrols and nitoring	a) VFD shall be with an interacti mounted digital operator interface sealed membrane type keypad. b) The operator interface shall be u drive monitoring and drive troub interface must also be able to state VFD faults and manually adjust the c) The operator interface shall have fault, drive run, and drive in currer d) The operator interface shall all operating conditions including torque, power etc. e) Messages shall be alphanume messages shall be in English. f) Provision shall be made available g) The operator interface shall be a operating variables and all drive parameter would typically be a important to the operator such as h) The following Control signals mus Local/Remote Emergency stop Trip/Close Input breaker These are indicative. Vendor to system during detailed Engineeri provided with individual relay have free contacts wired to terminal blow in All VFD operating parameter shall also be through Modbus link: i) Input & Output Frequency ii) Input & Output Current iii) Motor Speed iv) Input & Output Voltage v) DC Bus Voltage vi) Torque	sed for drivole shooting art and stopme VFD's specific terms and stopme VFD's specific terms and the speed, of the speed specific terms and the specific terms are specific terms and the specific terms and the specific terms are specific terms are specific terms and the specific terms are specific terms and the specific terms are	ve p g. The peed licate or ing page of the peed licate or ing page of the peed licate or ing page of the peed licate or ing page or ing peed licate or ing peed licat	rogramming, The operator of drive, reset reference. For drive of inverter of inverter of inverter of inverter of inverter of arameters. For drive of inverter of i

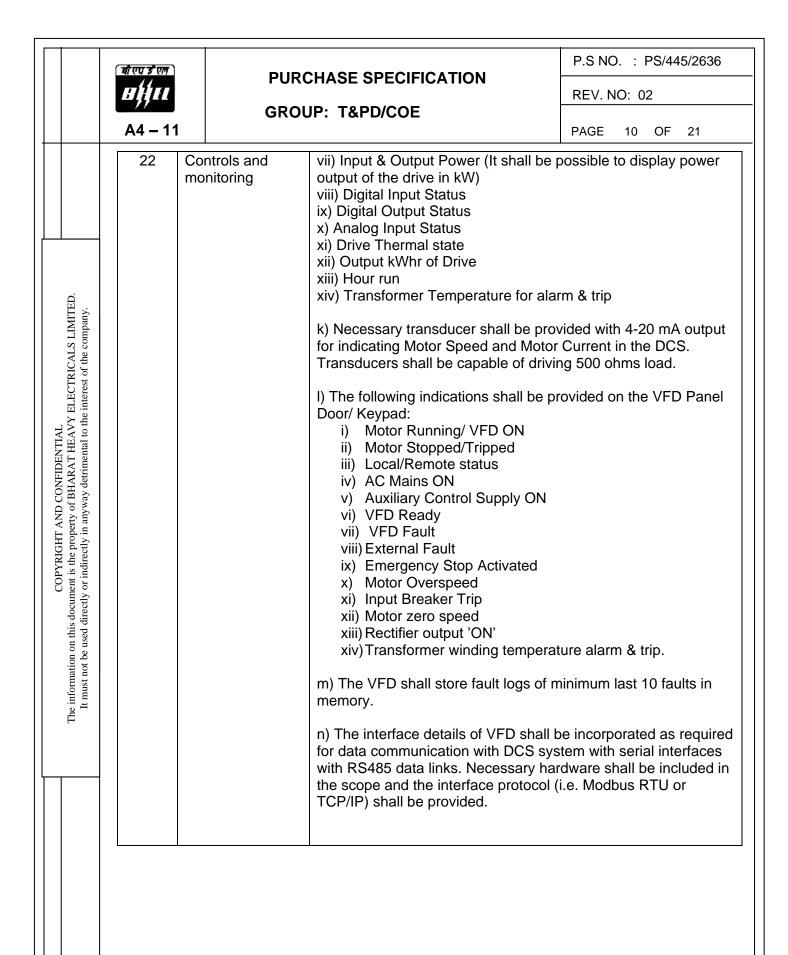

P.S NO. : PS/445/2636 PURCHASE SPECIFICATION **REV. NO: 02** GROUP: T&PD/COE A4 - 11**PAGE** OF 21 11 22 Controls and The following Audio-visual annunciations must be provided. 1) Rectifier fuse failure / drive fault Monitoring Main AC failure 3) Inverter fuse failure / Drive fault 4) Inverter overload 5) Inverter high temperature / Drive fault 6) Cooling system failure 7) Motor failed to start / Drive fault 8) Transformer fault and alarm ELECTRICALS LIMITED. The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITIE It must not be used directly or indirectly in anyway detrimental to the interest of the company. 9) Communication and measurement system unhealthy 23 Following protections shall be built in within the inverter and any Protection other protection as required: a) Motor Overload / Over Torque b) Instantaneous Over current (This device shall monitor the COPYRIGHT AND CONFIDENTIAI peak output current continuously and shall provide instantaneous shutdown without component failure whenever its trip point is surpassed. The trip point must be greater than or equal to 110% of the VFD's rated full load output current) c) Ground Fault Protection d) Over Voltage/Under Voltage - VFD shall be able to withstand >20% dip in supply voltage for 2 secs without damage to semiconductors or fuses. e) Output Short Circuit f) Output Phase Loss, Phase reversal, Locked rotor protection g) Phase Sequence Protection h) Input Phase Loss/Single Phasing Preventer Over Speed/Over frequency of motor i) Heat sink over temperature/VFD Panel Temperature High Stall prevention (During acceleration, deceleration and constant speed operation) k) Loss of Cooling Fans (Ventilation failure Indication and Alarm) I) External faults like Transformer Fault and Alarm m) Incoming and outgoing Line surge protection n) Loss of Speed reference o) Inverter fault (Converter/Inverter module failure indication) p) The system shall be designed to deliver the motor input current and torque for the complete speed torque characteristics of the driven equipment.

	<u> </u>			
चि	ारप इंस्ल स्ट्री	PURC	CHASE SPECIFICATION	P.S NO. : PS/445/2636
	7,711	CROU	P: T&PD/COE	REV. NO: 02
A	4 – 11	GROO	F. TAPDICOE	PAGE 12 OF 21
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.	23 Pro	tection	q) If the motor load exceeds the automatically reduce the frequence motor to guard against overload the current limit for more than down to prevent over heating of the drive. r) The drive shall trip in case the semaximum operational speed of minimum operational speed for researching failure of any of the segarding failure of the segarding failure of any of the segarding failure	iency and voltage to the d. If load demands exceed 1 min, the drive shall shut the motor and damage to peed exceeds 110% of the reduces to 95% of the more than 10 seconds. The information system including shut down for a period of minimum 4 ugh no supply available.



 $A4 - 1^{\circ}$

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 13 OF 21



A4 – 11

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 14 OF 21

SI. No.	Parameter	Specification
25	Type of Control:	Completely programmable by the user as: a) Flux vector control with speed feedback b) Flux vector control without speed feedback c) Scalar V/F. VFD shall be capable of maintaining motor speed within ±0.5% without the use of a motor mounted encoder or tachometer. The drive shall have programmable V/F patterns along with user definable custom V/F patterns.
26	Harmonic Limitations – Source	Shall be as per latest IEEE 519 Voltage harmonics: Vendor to inform the values with calculations during detailed engineering stage. Current harmonics: Vendor to inform the source side 5th, 7th & 11th harmonics values with calculations during detailed engineering stage. Vendor to supply harmonic filters, if required, to filter the harmonics generated by VFD at input/ supply side. The above compliance shall be verified by the field measurements of harmonics at the PCC with and without VFDs operation as per Customer Specification.
27	Harmonics at VFD Output / Motor Input	Shall be as per latest IEC 61800-4 Vendor to specify the maximum amount of voltage and current harmonics at the VFD Output / Motor Input terminals.
28	Switching frequency	To be specified by the vendor in Datasheet.
29	Auxiliary Supply	Refer attached Annexure to Specification



PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636 REV. NO: 02

PAGE 15 OF 21

SI. N	lo. Parameter	Specification
30		•
It must not be used directly or indirectly in anyway detrimental to the interest of the company.	Inspection, Training and Commissioning Support	a) Final Inspection: BHEL / Customer representative will
Some of the state	a)Laptop with Software for VFD Interface	Laptops shall be installed with Latest Compatible Licensed Operating System. The software must be loaded in the laptops & supplied along with interconnecting cables and accessories required for interface with the drive. The software should be an easy to use commissioning tool for drives and shall be provided along with the system. The interface details of VFD shall be incorporated as required for data communication with DCS system with serial interfaces with RS485 data links. Necessary hardware shall be included in the scope and the interface protocol (Modbus only) shall be provided.
	b) Printer	Printer shall be supplied for printing of VFD Data. For more details please refer attached Annexure.



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO.	:	PS/445/2636

REV. NO: 02

PAGE 16 OF 21

SI. No.	Parameter	Specification
33	Maintenance	The procedure for maintenance of VFD panels and the schedule thereof shall be mentioned in the offer.
34	Spares	Please refer attached Annexure with this Specification.
35	Confirmations/Deviations to Specification	Point-wise confirmation to this specification and NTPC Specification to be given along with offer. Deviations, if any, shall be indicated separately. If there are no deviations to the specifications, supplier shall mention the same explicitly. A reply from vendor stating that "Equipment will generally meet the specifications" will not be accepted by BHEL. Vendor to furnish only Clause-wise Clarifications/Deviations to the Purchase Specifications and shall be furnished in the format below.

Point No.	Page No.	Confirmation / Clarification / Information / Deviation	Details	Remarks, if any



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO.	: PS/445/2636
DEV NO.	00

REV. NO: 02

PAGE 17 OF 21

7. Documentation

SI. No.	Parameter	Specification
1	Attached Documents	 a) NTPC specification for VFD System and QA documents b) Motor Datasheet and Curves. c) Single Line Diagram d) "Annexure" to Specification for project specific data e) Pre-Qualification Criteria (PQC): Refer "Annexure attached with the Specification.
2	Technical Information required along with Offer	a) Dimensional Drawing of Panels along with minimum clearance to be maintained for effective cooling, and Weight b) Technical Catalogue of VFD System being offered. c) Reference list for similar rating VFDs giving the following: Model number, Application, Rating, Year of supply and commissioning. Provenness Criteria of Medium Voltage Variable Frequency Drive shall be used as qualifying criteria (if attached with this specification). d) Confirmation / Clarification / Information / Deviation List as per Point 35 in page no. 16. e) Confirmation / Clarification / Deviation List to NTPC Specifications and other documents in SI No. (1) above. f) Design calculation for sizing of Transformer and VFD. g) Filled-up Datasheet for VFD system. h) Filled-up, Signed PQC format of VFD System
3	Information / Confirmations required along with offer	 a) Supply of the VFD shall be by OEM only. The name of the country from which the drive is sourced and the location of the manufacturing plant should be mentioned in the offer. b) After Sales Service and Support shall be given by the Vendor for a minimum period of 10 (ten) years after commissioning. c) Vendor shall give a notice of at least 1 year to the end user of the equipment and BHEL before phasing out the product / spares to enable the end user for placement of order for spares and services.



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 18 OF 21

SI. No.	Parameter	Specification
4	Technical (unpriced) and Commercial (priced) Bids – For Evaluation	Refer "Consolidated Scope of Supply & Services" in Annexure attached with this Specification for Unpriced and Priced Bids.
5	Information required for Customer / Consultant Approval	a) Dimensional Drawing of Panels along with minimum clearance to be maintained for effective cooling, and Weight b) Schematic Diagram c) Bill of Materials for equipment to be supplied d) Feeder Requirements – UPS and 415V supply e) Losses at Rated Load (including Fans) f) Heat Loss for Air Conditioning System sizing g) Technical Catalogue of VFD System being offered h) Test Protocol and Quality Plan i) Type test certificates of similar or higher rating equipment j) Filled up Data sheet for VFD system and Transformer
6	Information Required along with Supply. Maintenance Manuals and Documentation	 a) Erection, Commissioning and Maintenance Manuals along with Final Drawings and Documentation b) Test and Guarantee Certificates. c) Complete Bill of Material (item wise) for the equipment supplied. d) 1 no. CD ROM consisting all of the above.



COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO.	:	PS/445/2636
---------	---	-------------

REV. NO: 02

PAGE 19 OF 21

VFD SYSTEM DATA SHEET

Α	VFD Data		
1	Manufacturer		
2	Model No.		
3	Manufacturing Location		
4	Rating and Application		
5	Applicable codes /standards		
6	Speed reference	4-20 mA from DCS	
7	Speed range		
8	Switching Frequency		
9	No. of Pulse		
10	Total number of Diodes/ IGBTs/ IGCTs		
11	Drive output Voltage		
12	Overload capability		
13	Inrush current 250% In for		
14	Combined efficiency (Transformer & Drive) at:		
	i) 100% Load		
	ii) 75% Load		
	iii) 50% Load		
	iii) 25% Load		
15	Overall power factor at:		
	i) 100% Load		
	ii) 75% Load		
	iii) 50% Load		
	iii) 25% Load		
16	Output voltage range and Accuracy		
17	Output Frequency range and Accuracy		
18	Type of Cooling		
19	Redundancy in Cooling		
20	Type of feedback for speed control		
21	Output Filter/ Choke:		
	i) Manufacturer		
	ii) Type/ Model No.		
	iii) Rated Current and Voltage		
22	Acceleration / Deceleration time		

मा एप स	F UM
A 4	40

PURCHASE SPECIFICATION

GROUP: T&PD/COE

P.S NO. : PS/445/2636

REV. NO: 02

PAGE 20 OF 21

2	B Degree of protection		
2	•		
	inclusive of all panels shall be furnished)		
	i) Length (mm)		
_	ii) Height (mm)		
	iii) Depth (mm)		
	iv) Weight (kg)		
2	Paint Shade		
2	Heat Load (kW)		
2 2 3 2 5 6		415V, 3ph, 4Wire	UPS supply
	i) KVA		
	ii) Voltage and Phase		
	Transform	ner Data	
	Manufacturer		
	Manufacturing Location		
3	Туре	Dry type Transfo	ormer
	Integrated / Non-Integrated		
5	Duty	Continuous (Cor	nverter Duty)
	Rating (Transformer must be designed to	,	• •
	carry 110% current of calculated VFD rating.))	
7			
8	Insulation level:		
	P. f withstand		
	i) HV Winding		
	ii) LV Winding		
	Impulse withstand		
	i) HV Winding		
	ii) LV Winding		
9	Fault Level on HV Side		
1	HV Voltage and Phase		
1	LV Voltage/ Current		
1	No. of LV Windings		
1	Rated Frequency	50Hz	
1			
1	•		
1		Electrolytic grad	e Copper
1		HV Winding	
	,	_	



PURCHASE SPECIFICATION

GROUP: T&PD/COE


P.S NO. : PS/445/2636

REV. NO: 02

PAGE 21 OF 21

19	Vector Group	
20	Neutral CT specification:	
	51G	
	64R	
	Vk	
	Im at Vk/2	
	RCT	
<u>÷</u> 21	Cable Size/Type	
mpa	i) HV Winding	
le co	ii) LV Winding	
th Jo 22	No Load Loss	
erest	i) At 100% Voltage	
e into	ii) At 110% Voltage	
g 23	Full Load Copper loss at 75°C	
24	No Load Current	
trime	i) At 100% Voltage	
y de	ii) At 110% Voltage	
ž 25	Efficiency at 75°C and unity power factor	
in ai	i) At 100% of Full Load	
ectly	ii) At 75% of Full Load	
indir	iii) At 50% of Full Load	
It must not be used directly or indirectly in anyway detrimental to the interest of the company.	iv) At 25% of Full Load	
26 gct	Efficiency at 75°C and 0.8 power factor	
ed di	i) At 100% of Full Load	
se us	ii) At 75% of Full Load	
not b	iii) At 50% of Full Load	
nust	iv) At 25% of Full Load	
27	Load at which maximum efficiency occurs	
28	Regulation at 75°C at full load	
	i) At 0.8 pf	
	ii) At UPF	
29	Dimensions	
	i) Length (mm)	
	ii) Height (mm)	
	iii) Depth (mm)	
	iv) Weight (kg)	
30	Degree of protection for enclosure.	
31	Paint Shade	
32	P Heat Load (kW)	

CLAUSE NO.	TECHNICAL REQUIREMENTS एनरीपीसी NTPC
	3 MCC control supply 110 V AC Neutral solidly earthed
	4) Space heater & lighting 240 V AC Neutral solidly earthed
2.02.00	CUBICLE DATA
2.03.00	Busbar Rating
	Continuous Current rating As per requirement /Sizing Calculation
	2) Short time rating where
	a) CB is used as incomer 50 kA(RMS) for one sec
	(Ph-Ph & Ph-N)
	b)MCCB is used as incomer Prospective current of 50 kA(RMS) for the MCCB clearing time , (Ph-Ph & Ph-N)
	3) Dynamic Rating where
	a) CB is used as incomer 105 kA(PEAK) , (Ph-Ph & Ph-N)
	b)MCCB is used as incomer
	(Ph-Ph & Ph-N)
	4) Busbar insulation
	a) For switchgear /MCC/ACDB/DCDB PVC Sleeve insulated(UL224)
	/MCCB Box CE/UL certified
	5) Horizontal Busbar & Jumper High Conductivity Aluminium Alloy/Copper Connection
	6) Vertical Busbar Copper Only
	7) Hardware for busbars(Bolts/Nuts/Spring Washer) High Tensile steels
2.04.00	Enclosure Details
	1) Material CRCA
	2mm: Load bearing Structure and Frame
	1.6mm: Doors, covers etc
	3mm for Gland Plates (CRCA/HR)
	4mm for Gland plates (Non-Magnetic) –Single Core Cable Entry
	RMAL POWER PROJECT TECHNICAL SPECIFICATION SUB SECTION B-06 PAGE 1 (2X660 MW) SECTION -VI, PART-B LT SWITCHGEARS & LT
	PC PACKAGE BID DOC NO.: CS-4540-001A-2 BUSDUCTS 3 OF 18

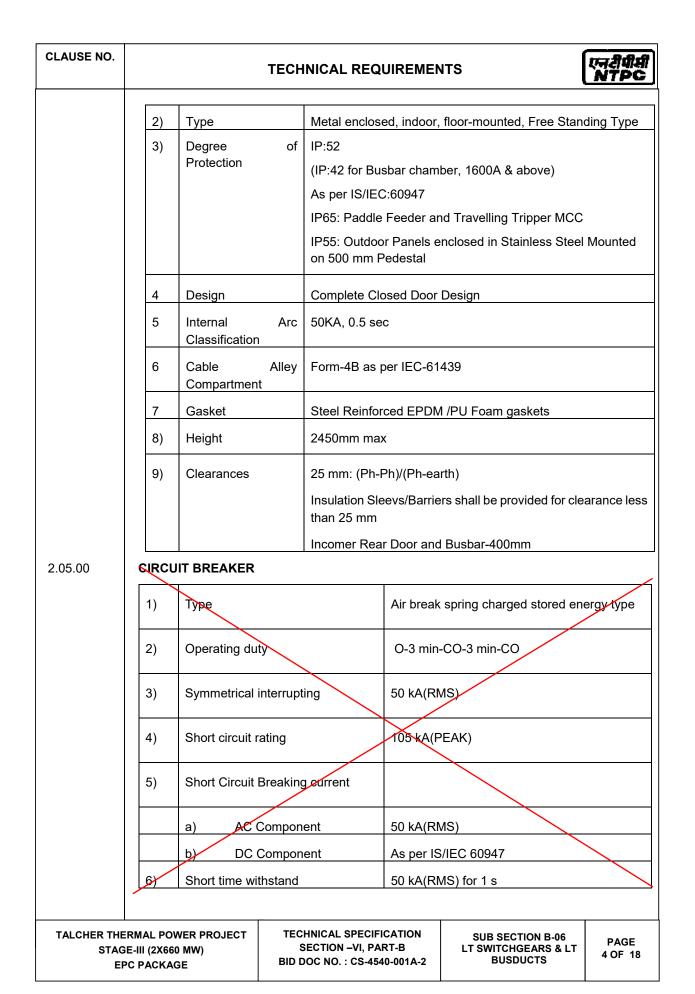

SCOPE OF SUPPLY AND SERVICES



2. Following requirements of construction power for employers' office/ construction use:

Construction power at 415 V at two locations with total load 100 KVA along with suitable metering arrangement at each location.

1.20.00 Deleted

1.21.00 OVERHEAD LINES

Transmission line to AWRS Pumphouse:

Two number 11kV or 33kV single circuit transmission line on poles for supplying power from plant to AWRS pumphouse The overhead lines for AWRS Pump house shall generally be laid along the AWRS route. However, exact routing shall be decided during detailed engineering. Scope of work includes route survey for line, civil works, design, supply, erection and commissioning of poles.

1.22.00 PAINTING FOR ELECTRICAL EQUIPMENT

Unless explicitly stated in relevant chapters of the specification, the painting of all electrical equipment shall be as follows:

The thickness of finish coat shall be minimum 50 microns (minimum total DFT shall be 100 microns). However, in case electrostatic process of painting is offered for any electrical equipment, minimum paint thickness of 50 microns shall be acceptable for finish coat. In case procedure is not indicated, Epoxy based paint with suitable additives shall be used. Paint shade for various Equipment shall be as follows

SI no.	Item Description	Procedure	Paint Shade
1.	Generator and Auxiliaries	-	RAL 5012
2.	Motors	-	RAL 5012
3.	VFD Transformer and Reactor Enclosures	-	RAL5012
4.	VFD Panels	-	RAL 9002 Front and Rear
			RAL 5012 Sides
5.	Transformers and Oil Tanker	a) Inside of Tank and Accessories- Oil and Heat Resistant	Full Glossy White
		b) External surface of transformer and accessories- Chemical resistant epoxy zinc phosphate primer, MIO (Micaceous iron oxide) as intermediate paint followed by polyurethane finish paint.	RAL 5012
6.	Transformers- Cooler & Radiators	a) External surface- ISO 12944- 5:2018, Table D.1, System no. G5.05	RAL 5012

TALCHER THERMAL POWER PROJECT STAGE- III (2X660 MW) EPC PACKAGE	TECHNICAL SPECIFICATION SECTION - VI, PART-A BID DOC NO. : CS-4540-001A-2	SUB-SECTION-IIB ELECTRICAL SYSTEM / EQUIPMENTS	PAGE 13 OF 17
---	---	--	------------------

SCOPE OF SUPPLY AND SERVICES



		b) Internal surface- Hot oil proof, low viscosity varnish and subsequent flushing with transformer oil	NA
7.	Transformer marshalling Box	-	SS No painting
8.	Dry Type Transformers	a) External Surface of Enclosure b) Internal Surface of Enclosure	RAL 5012 Full Glossy White
9.	MV and LT Switchgear,	a) Front and Rear b) Extreme ends c) AC and DC MCCB Box d) Local Push Button Stations e) Lighting and Welding trf	RAL 9002 RAL 5012 RAL 9002 RAL 9002 RAL 9002
10.	IPBD/ MV Bus Ducts/LT Bus Ducts	a) Exterior b) Interior c) Conductor surface	RAL 5012 Matt Mat Black/Manufacturers standard/Painted Aluminum alloy
11.	NGR Cubicle	a) Heat Resistant Paint system b) Interior	RAL 5012 Glossy White
12.	PT-VT Cubicle	a) High quality Primer and Two coats of Synthetic enamel paint b) Interior	RAL 5012 Glossy White
13.	DG SET	a) Enclosure b) DG Exterior c) Control Panel d) Day Oil Tank – Oil Resistant Paint	RAL 9002 RAL 9002 RAL 7032/9002 RAL 5012
14.	Battery Charger	a) Front and rear- Two coats of lead oxide primer followed by powder painting. b) end cover- Two coats of lead oxide primer followed by powder painting.	RAL 9002 RAL 5012
16.	Battery racks and associated cable supports	a) Three (3) coats of anti-alkali paint or	-

TALCHER THERMAL POWER PROJECT STAGE- III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC NO.: CS-4540-001A-2

SUB-SECTION-IIB ELECTRICAL SYSTEM / EQUIPMENTS

PAGE 14 OF 17

CLAUSE NO. TECI

TECHNICAL REQUIREMENTS



1.14.00 Installation and movement of spare GT on site

The spare transformer shall be erected and prepared for long term storage as well as for the rapid transfer of this unit into a service position as approved by the Owner.

1.15.00 TRANSPORTATION

The contractor shall be responsible to select and verify the route, mode of transportation and make all necessary arrangement with the appropriate authorities for the transportation of the equipment. All metal blanking plates and covers which

are specifically required to transport the transformer shall be considered part of the transformer and handed over to NTPC after completion of the erection. The total duration of storage at site with dry gas shall be limited to three (03) months after which transformer/reactor shall be processed and filled with oil.

The scope of any necessary modification/ extension/ improvement to existing road, bridges, culverts etc. shall be included in the scope of the bidder.

NOTE:

Despite all condition monitoring done by the Owner, the Contractor shall be responsible to obtain all required inputs such as DGA to evaluate the Transformer/ Reactor. The guarantee and costs of any repair done under the guarantee shall not be affected by any condition monitoring done or not done by the Owner during the guarantee period. A full DGA test shall be completed at the end but before expiry of the guarantee period.

2.00.00 DRY TYPE TRANSFORMER (LT INDOOR) (AUXILIARY TRANSFORMER)

Sr. No.	PARAMETERS	INDOOR TRANSFORMER
i)	Туре	Epoxy cast resin/resin encapsulated
ii)	Service	INDOOR
iii)	MVA & Voltage ratio	
iv)	Vector group	
v)	Impedance	
vi)	Tap changer type & range	As per system requirement/ Sub section B-0
vii)	SC withstand time & Fault Level	
viii)	Termination	
ix)	Number of phases	Three (3)
x)	Type of cooling	AN Additionally Transformer shall be provided with fans/blowers (total fan power min. 1350 W, 415 V) for forced air cooling however all tests and performance guarantee shall correspond to air natural (AN) cooling.
xi)	Duty	Continuous
xii)	Insulation level	As per chapter B-0, Part-B
xiii)	Maximum Temperature rise of winding over 50 deg. C ambient. (by resistance method) with Air Natural (AN) cooling.	70 deg.C.
xiv)	Earthing	Solidly earthed via cu flat.

TALCHER THERMAL POWER
PROJECT STAGE-III (2X660 MW)
EPC PACKAGE

TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.:CS-4540-001A-2 SUB-SECTION-B-04: TRANSFORMERS AND ASSOCIATED MAINTENANCE, MONITORING & TESTING PAGE 24 OF 33

CLAUSE NO.		TECHNIC	AL REQUIREMENTS 대견대체
	xv)	Noise Level	Not to exceed values specified in NEMA TR-1.
	xvi)	PD Level for HV coil (max.)	20 pc
	xvii)	Loading Capability	Continuous operation at rated KVA on any tap with voltage variation of +/-10% corresponding to the voltage of the tap as well as in accordance with IEC60076-7/IS: 6600.
	xviii)	Flux Density	Not to exceed 1.9 Wb/sq.m. at any tap position with +/-10% voltage variation from voltage corresponding to the tap. Transformer shall also withstand following over fluxing conditions due combined voltage and frequency fluctuations: a) 110% for continuous rating. b) 125% for at least one minute. c) 140% for at least five seconds.
		door transformers shall be 3 ig for equipment earthing.	phase, 4 wire system with additional LVN
2.01.00		D STANDARDS	
	Dry type to	ransformers IS: 11171,	IEC 60076-11
			Electricity Rules, BEE notification & CEA guidelines
2.02.00	DESIGN AN	D CONSTRUCTIONAL FEA	TURES
2.02.1	steel laminat	tions of M4 grade or better qι	grade non-ageing cold rolled grain oriented silicon uality. The insulation of core to clamp-plates shall be age of 2 kV (rms) for one (1) minute.
2.02.2	of IP-23. End also accommended should be provided with with pre-drille	closure shall be of a tested que modate cable terminations. ossible to open the door on h lifting lugs and other hardy	etal protective housing, having a degree of protection uality sheet steel of minimum thickness 2mm & shall The housing door shall be interlocked such that it lay when transformer is off. The enclosure shall be ware for floor mounting. Suitable bi-directional skids tegral with the enclosure or bi-directional rollers shall ment.
2.02.3		ductor shall be electrolytic gr are to be uniformly insulated	ade Copper. Windings shall be of class F insulation.
2.02.4	Bushing sha	Il be suitable for satisfactory of	nings can be either solid porcelain or epoxy type. operation in the high ambient temperature inside Bus area shall be of non-magnetic material.
2.02.5	Bushing CTs WTI, etc.	s shall be provided in the LV	neutral side of adequate rating for REF protection,
2.02.6	shall be tank 13947. Wirin	k mounted type. The degree	d shall be at least 1.6 mm thick cold rolled. The box of protection shall be IP-54 in accordance with IS- in a stainless steel plate with viewable font size and alling Box door.
2.02.7	however all		blowers (with 100 % standby) for forced air cooling, correspond to air natural cooling. Necessary wiring art shall be provided.
2.03.00	PAINTING		
	fully glossy	white colour with total DFT	(except M. Box) shall be painted with two coats of of 25 to 60 microns. The external paint colour of corresponding to RAL 5012. The external surface of

TALCHER THERMAL POWER
PROJECT STAGE-III (2X660 MW)
EPC PACKAGE

TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.:CS-4540-001A-2 SUB-SECTION-B-04: TRANSFORMERS AND ASSOCIATED MAINTENANCE, MONITORING & TESTING PAGE 25 OF 33

CLAUSE NO. **TECHNICAL REQUIREMENTS** transformer & accessories shall have two coats of chemical resistant epoxy zinc phosphate primer and two coats of polyurethane finish paint with total DFT of 80 to 150 microns. The internal surface of M.Box shall have two coats of chemical resistant epoxy zinc phosphate primer and two coats of chemical & thermal resistant epoxy enamel white paint with total DFT of 80 to 150 microns. 2.04.00 **FITTING** Winding Shall be Platinum resistance type temperature detector in temperature indicator (WTI) Single Indicating meter may be provided for display of temperature of all limbs. Accuracy class of Indicating meter shall be +/- 1% or better and it shall have least count of 0.1 °C or better. 1 no. 4-20 mA signal shall be provided for remote monitoring of winding Temperature. Blowers (AF cooling) shall have Manual and Auto control (with WTI user programmable temperature). 1 No. PT-RTD shall be embedded in each limb with alarm and trip RTD/Thermistors contacts for remote annunciation. Additional 1 No. thermistor/RTD shall be embedded in each limb. Fittings which are generally required for satisfactory operation of the transformers are deemed to be included, in the scope of supply of the Contractor. 2.05.00 **TESTING REQUIREMENTS** 2.05.1 The Type Test reports which have to be submitted should be of a transformer which is generally similar to the transformer being offered as per IEC 76-5, Annexure-B and also identical to the offered transformer in following aspects: i) Voltage ratio ii) MVA/KVA rating iii) Percentage Impedance iv) Internal design v) Type of tap changer equipment vi) Cooling arrangement vii) Temperature rise viii) Individual and total loss values of the offered transformer shall be same as that indicated in the GTP of transformer for which Type Test Reports are submitted 2.05.2 All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price. 2.05.3 All routine tests in accordance with IS: 11171 shall be carried out on each transformer. 2.05.4 Transformer shall be short circuit tested after conducting the routine tests. Rest of the type tests shall be conducted after successful short circuit testing. Routine / Type Tests (Dry Type Transformers) Measurement of winding Resistance for each tap position. Routine Test a.) Measurement of voltage ratio at each taps position. Routine Test b.) Vector group and polarity check Routine Test c.) Measurement of impedance voltage/short circuit impedance & load Routine Test d.) loss at principal tap and extreme taps Measurement of no load losses and magnetizing current at rated e.) Routine Test

TALCHER TO			TECHNICAL SPECIFICATIONS SECTION – VI, PART-B	SUB-SECTION-B-04: TRANSFORMERS AND ASSOCIATED MAINTENANCE,	- 1 -	PAGE 26 OF 33
		1 1) 1 1	70eparate source AC withstank	a voltage test.	TOU	une rest
	h)	Dielectri	c Tests F/Separate source AC withstand	d voltage test	Rou	tine Test
	g)		ement of capacitance and tan d	elta	Rou	tine Test
	f)	Measure	ement of insulation resistance		Rou	tine Test
	,	frequenc	cy and 90%, 100% and 110% ra	ated voltage.		

MONITORING & TESTING

BID DOC. NO.:CS-4540-001A-2

EPC PACKAGE

CLAUSE NO.		TECHNICAL REQUIREMENTS	एनरीपीमी NTPC	
		2) Chopped wave lightning impulse voltage test on all the three limbs as per IEC 60076-3	Type Test	
		Induced over voltage withstand test	Routine Test	
	i)	Partial discharge measurement (However if it is conducted as routine test on all the coils, this test can be performed as type test).	Routine Test	
	j)	Measurement of iron loss & IR (repeat after induced voltage test)	Routine Test	
	k)	k) Short Circuit test as per IEC Type Test		
	I)) Noise Level Measurement Type Test		
	o)	Temperature rise test as per IEC (HV & LV winding)	Type Test	

2.05.5

High voltage withstand test shall be performed on auxiliary equipment and wiring after assembly.

MAINTENANCE, TESTING & MONITORING EQUIPMENTS

3.00.00

1.	On Line DGA	Online monitoring system of dissolved gases for GTs	7 Nos.
2.	Oil BDV Measurement kit.	Automatic oil testing unit for checking BDV of transformer oil upto 80kV.	1 No.
3.	Oil tan delta and resistivity measurement kit.	Suitable for measurement of Volume resistivity, Di-electric constant, Watt loss, loss factor with elevated temperature read out for transformer oil.	1 No.
4.	Dew point meas. instrument		1 No.
5.	FRA Test Kit		1 No.
6.	Capacitance & Tan delta meas. Equip. (with cables etc.)	0-10kV (Fully Automatic)	1 No.
7.	Transformers turns ratio Kit	Display of ratio & phase angle deviation.	1 No.
8.	Winding Resistance measurement kit		1 No.
9.	Off Line laboratory model oil DGA kit.		1 No.
10.	Hydraulic jacking system	Suitable for lifting / wheel rotation for heaviest oil filled Transformer/Shunt Reactor.	1 No.
11.	On Line Moisture Removal System	(One for each 3 phase GT Bank)	2 Sets
12.	Oil Purifying Equipment	10,000 Litres / hr.	1 No.
13.	Oil Purifying Equipment	1,000 Litres / hr.	1 No.

TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.:CS-4540-001A-2	SUB-SECTION-B-04: TRANSFORMERS AND ASSOCIATED MAINTENANCE, MONITORING & TESTING	PAGE 27 OF 33
--	---	--	------------------



PURCHASE SPECIFICATION

GROUP: CE/Engg. Drives

PS/445/2636/ANNX/TALCHER
REV. NO: 01

1 OF 7

PAGE

ANNEXURE-TALCHER TO PS/445/2636

1. Input Data Sl. No. Parameter Specification TALCHER TPS STAGE III (2 X 660 MW). Project Title 1 Total 8 VFDs (4 VFDs in Each Unit) 2 Customer **Environmental Specification:** Specification Parameter 50°C Max. Ambient temperature 2°**C** Min. Ambient temperature 50°C Equipment Design temperature **Relative Humidity** 95% at 40°C 3 Altitude Less than 1000m above mean sea level Location of VFD Panels Indoor, Ventilated Room with Air Conditioning Seismic Zone As per IS-1893-Zone-II All cards/hardware of VFD panel shall be suitable **Environment** for operation in harsh environmental conditions with respect to high temperature, humidity & **CEP** (Condensate extraction pump) & **RCP** (Slurry Recirculation 4 **Drive Application** Pump) System Voltage / 5 3.3kV / 50 Hz / 3-phase Frequency / Phase 6 Voltage Variation ± 6% 7 Frequency Variation +3%, -5% Combined Voltage and 10% 8 Frequency Variation 9 Output Voltage of VFD 0 to 3.3kV (V/f = Constant) The overload capacity shall be 110% of rated current for 1 minute 10 Overload capacity at rated voltage. **Motor Rating** 1200kW, 3.3kV, 254 Amps, 1490 rpm 11 (considered for both CEP & RCP) Motor Efficiency & 12 95% & 0.87 **Power Factor** Fully assembled units of 3.3kV VFD Panels (IGBT/SGCT/IGCT), Air 13 VFD type Cooled with **Non-Integrated Dry Type Transformer** Non- integrated Dry type Transformer alongwith Cables & other accessories between VFD and transformer shall be in VFD vendor's 14 Transformer type scope (ref. specification clause 3.8). Transformer will be placed in non-AC room. Maximum distance between VFD and transformer shall be 50m



PURCHASE SPECIFICATION

GROUP: CE/Engg. Drives

PS/445/2636/ANNX/TALCHER

REV. NO: 01

	A	4 – 11	PAGE 2 OF 7
	15	Degree of Protection	IP:3X or better
	16	VFD Output Current	254 A at 50°C (Design Ambient)
	17	Fault Level at 3.3 kV input side	40kA for 1 Sec.
· ·	18	Distance between VFD & Motor (approx. in Meters)	a) CEP : 225 m (For Unit 1) & 180 m (For Unit 2) b) RCP : 200 m (For Unit 1 & Unit 2)
CALS LIMITE		Cable Sizes between: a) 3.3kV Swbd. & VFD Transform	a) 3R x 1C x 185 Sq. mm(for all Three Phases), 3.3kV,Al, Armoured (BHEL Scope)
DENTIAL AT HEAVY ELECTRI nental to the interest of	19	b) VFD Transformer & VFD c) VFD & Motor *Exact cable sizes shall be informed DDE (for both CEP & RCP)	 b) In VFD Vendor's scope (Inspection of cable by BHEL/BHEL nominated agency) c) 3R x 1C x 185 Sq. mm(for all Three Phases), 3.3kV,Al, Armoured (BHEL Scope)
COPYRIGHT AND CONFIDENTIAL he information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in anyway detrimental to the interest of the company.	20	Auxiliary Supply	 a) 230V UPS feeder will be provided by BHEL. KVA rating is to be given by the Vendor. Control supply for electronic modules has to be derived from the UPS. b) Auxiliary Supply – 415V, 3φ, 50Hz, 4 wire will be provided by BHEL. Feeder Power rating (short time & continuous) to be specified by the Vendor. c) Other supplies required by the VFD system to be generated internally within the VFD system.
this d	21	Single Line Diagram	Refer Drg. No. 3-660-00-52002
formation on nust not be us	22	Provenness Criteria	Provenness Criteria requirement of Medium Voltage Variable Frequency Drive (3.3 kV VFD) is attached. Vendor to furnish details in line with the document.
The in	23 Mandatory Spares		As per attached list (for CEP & RCP)
	24	Training	Training for Customer personnel for 15 Mandays at Manufacturer's works
	25	Reference date for type test purpose	Regarding clause no. 6(30)(b) of BHEL Specification, Sheet no. 15/21, bid opening date to be considered as 21.06.2022.
	26	Limiting Dimensions	Maximum height of False ceiling in VFD room shall be 3.5 meters. Vendor to ensure compliance to the same.
	27	Transformer Insulation class / Winding temperature rise	Temperature rise shall be Class-F (90 Deg C rise) for Class-H insulation and Class-B (70 Deg C rise) for Class –F Insulation winding over an ambient of 50 Deg C
	28	Efficiency	Efficiency of Drive(only) shall be minimum 98% and Overall Efficiency of VFD System (including Transformer) shall be minimum 96%

मा एवं डे एन **मानुस्य** A4 – 11

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: CE/Engg. Drives

PS/445/2636/ANNX/TALCHER					
REV. NO: 01					
PAGE	3	OF	7		

29	Packing	Wooden packing shall be provided suitable to withstand shocks and vibrations during equipment transit and to withstand handling during loading/unloading. Material handling marks should be provided on the packages. For safe preservation, proper packing shall be provided to avoid moisture ingress during equipment transit and when equipment is under covered storage.
30	Transformer inspection	Routine test witness of Transformer shall be carried out at Transformer Manufacturer's works on all Transformers by BHEL/Customer
31	Load test at VFD Shop floor with Motor	Confirm the availability of the facility for the VFD functional & performance testing with HT motor at Vendor's VFD test bed facility
32	Control & performance parameter monitoring (as per NTPC spec. clause 22.03.00)	a)CT/PT signal for input current monitoring shall be provided to VFD from input VCB supplied by BHEL. Vendor to provide MFM in VFD panel. b)Ambient temperature monitoring of drive.

2. Consolidated Scope of Supply and Services

Sl. No.	Items		
		(Nos.)	
1.	Fully Assembled Units of 3.3kV VFD Panels (IGBT/SGCT/IGCT), Air Cooled		
	with Non-integrated Dry type transformer, Termination cubicle, if required.	08 Nos.	
	(CEP-6nos. & RCP-2nos.)		
2	Cable Accessories (One set consists of total quantity for One VFD : CEP-	08 Sets	
2	6sets. & RCP-2sets)	08 3613	
2	HT Cables b/w VFD Panel & Transformer panel (One set consists of total	02 Cata	
3	quantity for one Unit i.e. Four VFDs: CEP-3nos. & RCP-1no.)	02 Sets	
4	Colour Laser Printer for printing of VFD data (CEP-2nos. & RCP-1no.)	03 Nos.	
5	Training charges	01 Lot	
6	Laptop loaded with Drive software (CEP-2nos. & RCP-1no.)	03 Nos.	
7	Mandatory Spares for CEP VFD	01 Set	
8	Mandatory Spares for RCP VFD	01 Set	
9	Erection Supervision & Commissioning		
	(Vendor to quote lumpsum commissioning charges for 8 mandays per VFD		
	which shall be considered for bid evaluation)		
	Payment shall be made for actual mandays consumed at Site with per	001.55	
	manday charges calculated on the basis of the lumpsum charges quoted	08 Lots.	
	above. Lumpsum charges quoted shall include travelling, boarding and		
	lodging expenses. (CEP-6Lots & RCP-2Lots)		
	,		



PURCHASE SPECIFICATION GROUP: CE/Engg. Drives

PS/445/2636/ANNX/TALCHER

REV. NO: 01

PAGE 4 OF 7

A4 - 11

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

NTPC TALCHER - MANDATORY SPARES LIST FOR CEP VFD					
S. No.	Item Description	Quantity			
1	HV bushing with metal parts and gaskets for VFD Tarnsformer	1 no. of each rating			
2	LV bushing with metal parts and gaskets for VFD Tarnsformer (if applicable)	1 no. of each rating			
3	Winding temperature indicator (WTI) with contacts	1 no. of each rating			
4	Electronic Cards (a) Control Modules (b) I/O Module (c) Power supply modules	1 nos. of each type and rating			
5	Power cell (complete replaceable – includes IGBT, Gate driver & snubber circuit etc.)	1no.			
6	a) Over voltage limiter and surge suppresor deviceb) Semi conductor fuses for Power cell	1 set* 1 set*			
7	Power & Control fuse	25% of installed quantity**			
8	Control Transformer	1 nos. of each type & rating			
9	Contactor/ Breaker	1 no.			
10	CT/ VT	1 nos. of each type and rating			
11	Indicating lamps	100% of each type & rating			
12	Auxiliary contactors & relays	1 no. of each type & rating			
13	Panel mounted meters /HMI/ Keypad	1 no.			
14	Indicating Lamp holder full set	15% of each type & colour			

चारवङ्ग संभूध
A4 – 11

PURCHASE SPECIFICATION GROUP: T&PD/COE

PS/445/2636/ANNX/TALCHER			
REV. NO: 01			
PAGE	5	OF	7

Note:-

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

1)	*Set means total quantity used in one VFD
2)	**Installed quantity means total quantity used for complete project. (Total 6 VFDs)
3)	All spares supplied under this contract shall be strictly interchangeable with parts for which they are intended for replacements.
4)	Wherever "% qty." is specified, Vendor to provide next higher rounded figure
5)	In case, spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered deisgn(functionally equivalent) with quantities generally in line with the approach followed in the above list
6)	Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc., these shall cover all the items supplied and installed and the breakup for these shall be furnished in the bid.
7)	Each spare shall be clearly marked and labeled on the outside of the packing with its description.
8)	W.r.t. item wise spares quantity, any variation(increase/decrease) in the quantity of spares found during detail engineering, vendor to supply the additional spares by considering the Unit price quoted in the offer only.



COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

PURCHASE SPECIFICATION

GROUP: CE/Engg. Drives

PS/445/2636/ANNX/TALCHER

REV. NO: 01

PAGE 6 OF 7

NTPC TALCHER - MANDATORY SPARES LIST FOR RCP VFD					
S. No.	Item Description	Quantity			
1	Primary bushings with metal parts and gaskets for VFD Tarnsformer (if applicable)	1 no. each rating			
2	Secondary bushings with metal parts and gaskets for VFD Tarnsformer	1 no. each rating			
3	Winding temperature indicator (WTI) with alaram & trip contacts	1 no.			
4	Electronic Cards (a) Control Modules (b) I/O Module (c) Power supply modules	1 nos. of each type & rating			
5	Power cell (complete replaceable – includes IGBT, gate driver & snubber circuit etc.)	1no.			
6	Over voltage limiter and surge suppresor device	1 set*			
7	Semi conductor fuses for Power cell	1 set*			
8	Power & Control fuse	25% of installed quantity**			
9	Control Transformer	1 nos. of each type & rating			
10	Contactor/ Breaker	1 no.			
11	CT/ VT	1 no. of each type & rating			
12	Indicating lamps	100% of each type & rating			
13	Auxiliary contactors & relays	1 no. of each type & rating			
14	Indicating Lamp holder full set	15% of each type & colour			
15	Panel mounted meters /HMI/ Keypad	1 no. of each type & rating			

गारप डे एल मध्या
A4 – 11

PURCHASE SPECIFICATION GROUP: T&PD/COE

PS/445/2636/ANNX/TALCHER						
REV. NO: 01						
PAGE	7	OF	7			


Note:-

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.

It must not be used directly or indirectly in anyway detrimental to the interest of the company.

1)	*Set means total quantity used in one VFD
2)	**Installed quantity means total quantity used for complete project. (Total 2 VFDs)
3)	All spares supplied under this contract shall be strictly interchangeable with parts for
	which they are intended for replacements.
4)	Wherever "% qty." is specified, Vendor to provide next higher rounded figure
5)	In case, spares indicated in the list are not applicable to the particular design offered by
	the bidder, the bidder should offer spares applicable to offered deisgn(functionally
	equvivalent) with quantities generally in line with the approach followed in the above list
6)	Wherever the quantities have been indicated for each type, size, thickness, material,
	radius, range etc., these shall cover all the items supplied and installed and the breakup
	for these shall be furnished in the bid.
7)	Each spare shall be clearly marked and labeled on the outside of the packing with its
	description.
8)	W.r.t. item wise spares quantity, any variation(increase/decrease) in the quantity of spares
	found during detail engineering, vendor to supply the additional spares by considering the
	Unit price quoted in the offer only.

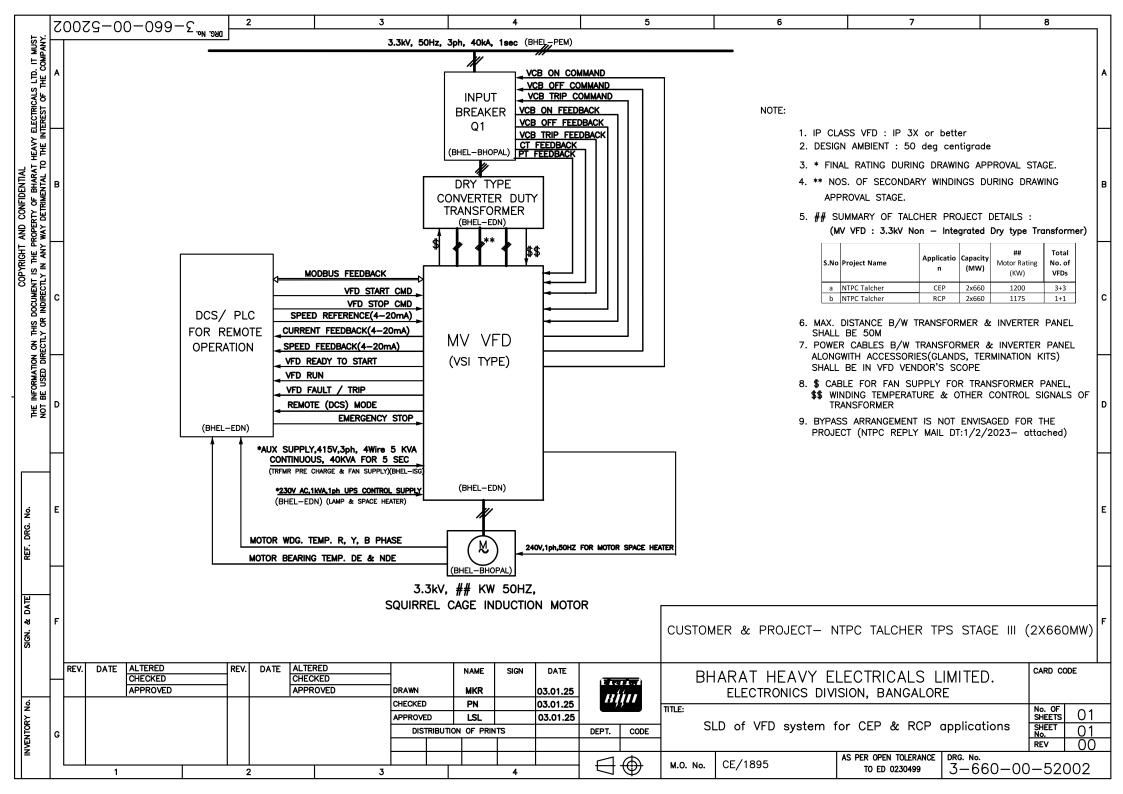



SUB-SECTION-B - 03

VFD

TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW)

EPC PACKAGE

BID DOC NO.: CS-4540-001A-2

TECHNICAL SPECIFICATION SECTION - VI PART-B

CLAUSE NO.	TECHNICAL REQUIREMENTS					
	<u>VFD</u>					
1.00.0	GENERAL					
	This chapter has to be read in conjunction with sub-section B-0 "General electrons specification" of Technical specification Section-VI, Part-B and Sub-Section-IIB Electrons Section-VI, Part-A.					
2.00.00	CODES AND STANDA	RDS				
	HT breaker	IEC:600	056			
	DC reactor	IEC 60289				
	Transformers	IS:2026, IEC:60076, IEC 61378				
	Bushing	IS: 209	9, IEC 60137			
	Adjustable Speed E	Electrical Power Drive Systems	IEC 61800			
	Semiconductor con	verters–General requirements	IEC 60146			
	IEEE Recommend	ed practices and requirements fo		ctrical powe		
	Degrees of protecti	on provided by enclosures (IP Cod	de) IEC 60529			
	Electrostatic immur	nity test	IEC1000-4-2			
	Fast transient immu	unity test	IEC1000-4-4			
	Surge immunity tes	t	IEC1000-4-5			
High-voltage switchgear and controlgear; Pt.102: Alternating curre earthing switches IEC 62271-102				nectors and		
STAG	TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-B VFD SUB-SECTION : B-03 VFD 1 OF 11					

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	High-voltage switchgear and controlgear; Pt.200: AC metal-enclosed switchgear and controlgear for rated voltages above 1 kV and up to and including 52 KV IS/IEC: 62271-200			
	AC electricity meters IS: 722			
	Metal oxide surge arrestor without gap for AC system IEC: 60099-4			
	Terminal blocks for copper conductors IEC: 60947-7-1			
	Dry transformer IS: 11171			
	Motor IS:15999, IEC-60034, IEC60034 / NEMA 30 & 31			
	Contactor/Switches/Fuses etc. IEC:60947, IS: 13947			
	Harmonics & EM compatibility IEEE:519/IEC: 61000			
	VFD IEC: 60034/ IEC: 61800			
3.00.00	OPERATING CONDITIONS			
3.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and also relative humidity of 95% at 40 deg. Celsius shall be considered.			
3.02.00	All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.			
3.03.00	The voltage level for the VFD output to be fed to motor shall be as follows:-			
	1. Upto 400 kW : 415V/690V, Low Voltage, Three Phase AC			
	2. Above 400kW and upto 700 KW : 690V, Low Voltage, Three Phase AC			
	3. Above 700KW : Medium Voltage			
	From here onwards in the specifications all the VFD Systems consisting of either 415 V or 690 V may be termed as LV VFD while the higher rated VFD System shall be termed as MV VFD. If nothing is mentioned than the Clause is applicable for both the LV and the MV VFD until deliberated otherwise.			
STAG	ERMAL POWER PROJECT E-III (2X660 MW) SECTION – VI, PART-B C PACKAGE BID DOC NO : CS-4540-001A-2 PAGE 2 OF 11			

CLAUSE NO.	TECHNICAL REQUIREMENTS				
4.00.00	SYSTEM DESCRIPTION	N		_	
	Type of drive	3-Phase Diode / Thyris IEGT	tor / Multi Stage IGBT / IO	GCT / SGCT/	
	Type of Cooling of V	/FD Naturally air cooled/forc	ed air cooled/Liquid cooled	d	
	Converter Type	Full wave diode rectifier	/active front end type		
	Inverter Type	Thyristor/IGBT/IGCT/S0	GCT/IEGT		
5.00.00	GENERAL REQUIREM	IENTS			
5.01.00	Medium Voltage VFD : The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum eighteen (18) pulse design.				
5.02.00	415 V/690 V LV VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum Twelve (12) pulse design / 6 pulse with active front end harmonic filter. For drives less than 100 KW Six (6) pulse can be offered meeting all other requirements. The offered equipment shall be with state of art technology and proven field track record. No prototype equipment shall be offered.				
5.05.00		shall ensure the proper coordination. The VFD operation shall have not system.			
6.00.00	TECHNICAL AND OPE	ERATIONAL REQUIREMENTS			
6.01.00	speed torque characte	esigned to deliver the motor input ristics of the driven equipment, we he system shall be suitable fo driven equipment.	vith worst input supply vo	ltage and	
6.02.00	minute for constant tord torque applications at	of the controller shall be 150% of t que applications and 110% of rate rated voltage. If the motor load e frequency and voltage to the mo	d current for one minute for exceeds the limit, the o	or variable Irive shall	
6.03.00		pe designed to operate in one or makes of the driven equipment or speci		ng modes	
	a. Variable torque chan	ging as a function of speed.			
	b. Constant torque over a specific speed range.				
	c. Constant power over a specific speed range.				
STAG	IERMAL POWER PROJECT E-III (2X660 MW) PC PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2	SUB-SECTION : B-03 VFD	PAGE 3 OF 11	

CLAUSE NO.		TECHNICAL REQUIREMENT	s	एनरीपीमी NTPC		
	d. Any other as specifie	d in data-sheet				
6.04.00	VFDs shall comply with the latest edition of IEEE 519 & IEC 61000 for both individual as well as total harmonic voltage and current distortion limits. The Voltage and Current limits shall be applicable at the Point of Common Coupling (PCC), which shall be the MCC/ Switchgear/ from which the VFD system is fed.					
6.05.00	The above compliance with and without VFDs	shall be verified by the field mea operation.	surements of harmonics at	t the PCC		
6.06.00	mechanical torque, resu	of withstanding the thermal and ulting from short circuit. Any dama limited to the component concerr	ge resulting from such a sh			
6.07.00	requirement of driven e	The system shall be suitable to maintain speed variation within range 10-110% or as per the requirement of driven equipment with speed set accuracy of +1% of rated maximum speed and steady state regulation of +0.5% of rated speed as per system requirement.				
6.08.00		The VFD System shall maintain a power factor of 0.95 (minimum) (for LV VFD system) and 0.9 (minimum) (for MV VFD system) in the entire operating range.				
6.09.00	Maximum allowable audible noise from the VFD system will be 85 dB (A) at a distance of one meter under rated loaded with all cooling fan operating conditions.					
6.10.00	All the circuit components shall be suitably protected against over voltages, surges, lightning etc.					
6.11.00		The panels shall be designed to provide easy access to hardware, to facilitate replacement of cards in case of any failure.				
6.12.00		All the VFDs for particular application shall be of same design so as to ensure 100 % interchangeability of components.				
6.13.00	For each programmed warning and fault protection function, the VFD shall display a message in complete English words or Standard English abbreviations. At least 30 time tagged fault messages shall be stored in the drive's fault history.					
6.14.00		be placed in air conditioned enviro to operate in non-air condition e				
6.15.00	The 3-Phase Thyristor/IGCT/SGCT/ multistage IGBT/IEGT based VFD system shall have minimum number of components to ensure very high reliability. The input side converter shall have 3-Phase Diode/Thyristor bridge configuration modular type and inverter shall be of 3-Phase Thyristor/IGCT/SGCT/multi stage IGBT/IEGT type, using Pulse Width Modulation or better technique for generating near sine wave output to motor.					
6.16.00	Fiber optic cable conne	ction shall be provided preferably	to ensure high network reli	ability.		
7.00.00	VFD COMPATIBILITY	WITH THE MOTOR				
7.01.00	MV VFD output current waveform, as measured at the motor, shall be inherently sinusoidal at nominal loads, with a total harmonic current and voltage distortion within acceptable/standard limits. VFD with transformers on output side are not acceptable.					
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2			SUB-SECTION : B-03 VFD	PAGE 4 OF 11		

CLAUSE NO.		TECHNICAL REQUIREMENT	s	एनहीपीसी NTPC		
7.02.00	The system design shall not have any inherent output harmonic resonance in the operating speed range.					
7.03.00	VFD shall provide stable operation of motor from high-voltage dv/dt stress, regardless of cable length to motor. The vendor shall clearly state the limitations in the motor cable distance in his proposal. However, due to system requirements & constraints if the cable length becomes critical, filters/ chokes etc. shall be provided by the VFD manufacturers as an integral part of the VFD to mitigate the reflected wave effect of harmonics.					
8.00.00	BYPASS ARRANGEM	ENT (OPTIONAL, IF SPECIFIED))			
8.01.00	The VFD System shall have an optional feature to run the motor under bypass arrangement for operation of Motor with VFD bypassed. During starting (under rated conditions) the motor will be switched on in VFD Mode to limit the starting current and after gaining speed, the load would be switched over to bypass mode.					
8.02.00		protection scheme for protection a inalized during detailed engineerir		FD during		
9.00.00	STANDBY VFD ARRA	NGEMENT (OPTIONAL, IF SPEC	CIFIED)			
9.01.00	A Common standby arrangement with auto/manual switchover shall be provided in case of failure of any VFD in a group of drives. Complete protection, interlocks & control required shall be provided in the changeover module.					
10.00.00	EFFICIENCY					
10.01.00	Efficiency (Drive only) shall be minimum 98% for both MV VFD and LV VFD. Overall efficiency (Includes the transformer if applicable) shall be minimum 96.5% for LV VFD and minimum 95% for MV VFD at rated load and speed. Overall Efficiency evaluation shall include input transformer, harmonic filters and power factor correction (if applicable), VFD converters, cooling fans and output filter, as applicable in the system. Auxiliary controls, such as internal VFD control boards, cooling fans/pumps.					
10.02.00	In absence of valid test report, a factory test shall be performed at the VFD manufacturer's facility verifying the efficiencies. Manufactures who are supplying Drive and transformer from different locations, efficiency test will be conducted separately for Drive and transformer.					
11.00.00	COOLING SYSTEM					
11.01.00	VFD manufacturer to primarily offer Air cooled Design. However in case of large ratings, liquid cooled drives may be accepted subject to employer's approval. In case of liquid cooled system, there shall be no necessity of continuous water supply system (Closed Loop System).					
11.2.00	In case of Air cooled design, the VFD Cooling system shall be such that it puts minimum heat load inside the room and preferably throw the hot air outside the room with ventilation ducts. The Cooling system shall be designed in such a way that the Air Conditioning & Ventilation Air requirements are kept to minimum. The VFD Manufacturer shall furnish the data regarding heat load, air flow requirements during the detailed engineering.					
11.03.00	Air cooled VFDs shall be provided with cooling fans mounted integral to the VFD/ enclosure. The VFD shall include air-flow pressure switches and temperature detectors to monitor proper operation of the air cooling system. If the fan fails, the system must generate the alarm/trip for the fan failure.					
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2 SUB-SECTION : B-03 VFD PAGE 5 OF 11				PAGE 5 OF 11		

CLAUSE NO.	TECHNICAL REQUIREMENTS						
12.00.00	TRANSFORMER:						
12.01.00		Type: Outdoor Mineral oil filled ONAN type or Indoor air-cooled Dry type, Three phase unit, rectifier/converter duty type transformer.					
12.02.00	All other components, t	echnical parameters shall be as p	er applicable IEC/IS.				
12.03.00	Enclosure for Dry Type Transformer (as applicable)						
	accommodate cable ter possible to open the do	a tested quality sheet steel of mi minations. The housing door shal for only when transformer is off. ⁻ rdware for floor mounting.	I be interlocked such that it	should be			
12.04.00	Core	Shall be High grade no silicon steel	on-ageing cold rolled grair Laminati				
12.05.00	Winding conductor		Shall be electrolytic grade copper. Windings shall be of class F insulation or better.				
12.06.00	Winding temperature Indicator (WTI)	Shall be Platinum resista detector in each limb.	Shall be Platinum resistance type temperature detector in each limb.				
12.07.00	Thermistors		Shall be embedded in each limb with alarm and trip contacts for remote annunciation.				
12.08.00	Temperature rise:	be 95 Deg. C for Class	For dry type transformer the winding temperature rise shall be 95 Deg. C for Class-H insulation or 70 Deg.C for Class – F Insulation. Tech. amendment is attached				
13.00.00	POWER CONVERTER	:					
13.01.00	a load side power conv	rter shall consist of a line side cor erter for operation as a fully cont efficient and low loss type.					
13.02.00		coordinated with the transformershort circuit current until interrup					
13.03.00	Adequate short circuit inverter system.	and over voltage protection shal	I be provided for the conv	erter and			
13.04.00	All power converter de networks as required.	evices shall include protective de	evices, snubber networks	and dv/dt			
13.05.00	of the nominal current f speed range. If the par	e converter's semi-conductor com lowing through the elements at fu allel connection of semiconductor 40% of the above values.	ill load of the VFD through	the whole			
13.06.00	All power diodes shall operating voltage.	be of silicon type with minimum	VBO rating at 2.5 times	the rated			
13.07.00	The power converter circuit shall be designed so that motor can be powered at its full nameplate rating continuously without exceeding its rated temperature rise nor reducing its service factor due to harmonic currents generated by the inverter operation. The conversion						
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION - VI, PART-B BID DOC NO : CS-4540-001A-2 SUB-SECTION : B-03 VFD PAGE 6 OF 11				_			

CLAUSE NO.		TECHNICAL REQUIREMENT	s	एनहीपीमी NTPC		
	devices and associated heat sinks shall be assembled such that individual devices can be replaced without requiring the use of any special precautions / tools.					
13.08.00	The cooling system of the electronic components, if provided, shall be monitored and necessary alarms shall be provided to prevent any consequential damage to the power control devices.					
14.00.00	OUTPUT FILTER (AS	APPLICABLE):				
14.01.00		Output/ dv/dt filter shall be provided, if required. It shall be an integral part of the VFD system and included within the VFD enclosure. It shall inherently protect motor from high voltage dv/dt stress.				
15.00.00	DC LINK CAPACITOR	(AS APPLICABLE):				
15.01.00	Capacitor shall be of self-healing film or electrolytic type having high life time. The capacitor shall be an integral part of VFD system. DC link Capacitors shall have discharge resistors which shall be capable of reducing the residual charges to zero just after the capacitor is disconnected from the supply source. The capacitor shall be suitable for high ripple currents.					
16.00.00	AC/DC Reactor (As ap	plicable)				
		air cored, self cooled, indoor type	Suitable for withstanding	earth fault		
	continuously. 2) Insulation: Thermal Class 155(F), temperature rise is limited to thermal class 130 (B). 3) Noise level shall not exceed value specified in NEMA TR-1.					
17.00.00	VFD PANEL REQUIRE	VFD PANEL REQUIREMENTS				
17.01.00	Enclosure frames and load bearing members shall be as per the Chapter B-05 and B06					
17.02.00	The cable entry shall be from the bottom of the panel and a removable bolted un-drilled gland plate.					
17.03.00	All Panels shall be of dust-proof and vermin-proof construction and shall be provided with a degree of protection of IP: 3X or better for MV VFD and IP: 4X or better for LV VFD as per IS/IEC 60947					
17.04.00	any outside equipment	esigned to avoid harmonic and inc from interference, enclosing and nterference. The construction of romagnetic emissions.	shielding the complete to	eliminate		
17.05.00	Each panel shall be pro setting thermostat.	vided with illuminating lamp, space	e heater with switch fuse an	d variable		
17.06.00		g air filters and fans/pumps shall bature inside the cubicle is within the system.				
18.00.00	NOT USED					
19.00.00	HT SWITCHGEAR					
19.01.00	The technical requirements of HT switchgear shall be as per chapter of HT switchgear in Part-B of Technical specifications.					
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2	SUB-SECTION : B-03 VFD	PAGE 7 OF 11		

CLAUSE NO.	TECHNICAL REQUIREMENTS					
20.00.00	MOTORS					
20.01.00	VFD shall be used to drive three (3) phase squirrel cage inverter duty Induction motor with VPI insulation (Resin poor) suitable for VFD application. These motors shall be provided with insulated bearing on at least one side for motor frame size above 250 frame. However, contractor's proven practice with respect to use of insulated bearing in VFD driven motor may be accepted subject to Employer's approval.					
20.02.00		Motors shall also meet the requirements mentioned in subsection for motors, relevant portions of the specifications for driven equipment and relevant IS/IEC.				
20.03.00	frequency inverter for sp	Motor shall be suitable for operation with a solid state power supply consisting of an adjustable frequency inverter for speed control & shall be suitable for the current waveforms produced by the power supply including the harmonics generated by the drive.				
20.04.00	Motor insulation shall be and dv/dt limits as per IE	e designed to accept the applied EC-61800.	voltage waveform, within t	he Vpeak		
20.05.00		Drive manufacturer shall coordinate with the motor manufacturer for proper selection of the motor for the given load application and the output characteristics of the drive.				
20.06.00	Other requirements of motor shall be as stipulated in technical chapter of Motors and driven equipment in Part-B of technical specifications.					
21.00.00	LT & HT CABLES					
21.01.00	Contractor's scope shall also include LT and HT cables suitable for VFD system and Motors.					
22.00.00	CONTROL AND PERFORMANCE REQUIREMENTS					
22.01.00	The VFD to provide an automatic current limiting feature to control motor currents during startup and provide a "soft start" torque profile for the motor load combination. Current and torque limit adjustments shall be provided to limit the maximum VFD output current and the maximum torque produced by the motor.					
22.02.00		ry the speed of the drive and cont n shall be done from VFD panel u		ote mode.		
22.03.00	Provision shall be kept parameters thru PLC/DI	for exchange of information bed	tween different VFD contro	ol system		
		or (MV) VFD shall have one flat T oom and a color laser printer for s				
Parameter Monitoring: -Input and output voltage of Drive - Input and output current of Drive - Motor speed - Input and output power frequency of Drive - Torque - Input and Output power of Drive system (covering transformer if applicable) - Output kWhr of Drive - Transformer (if applicable) temperature for alarm & trip Ambient temperature - Run/stop and local/remote status displayed						
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2	SUB-SECTION : B-03 VFD	PAGE 8 OF 11		

CLAUSE NO.		TECHNICAL REQUIREMENT	s	एनहीपीसी NTPC		
22.04.00	Drive shall be equipped with a front mounted operator console panel consisting of a backlit alphanumeric display and a keypad with keys for parameterization and adjusting parameter. Control panel shall be operable with password for changing the protection setting, safety interlock etc.					
22.05.00	Operator console/Main Control Card shall have facility / port to connect external hardware such as Lap-Top etc. Console shall have facility for upload and download of all parameter settings from one drive to another drive for start up and operation.					
22.06.00	User-friendly licensed s system panel before co	software for operation and fault diaminusioning.	agnostic shall be loaded ir	the drive		
23.00.00	PROTECTION FEATUR	RES				
23.01.00		Ill incorporate adequate protection inated for the drive control and for		0-4: 2002		
	i) Converter transforme protection.	er: short circuit, over current, ear	th fault & winding tempera	ature high		
	ii) Incoming and outgoir	ng line surge protection.				
	iii) Under / over voltage protection					
	iv) Phase loss, phase reversal, overload, negative phase sequence, locked rotor protection.					
	v) Instantaneous Over current & Earth fault protection					
	vi) Converter/Inverter module failure indication.					
	vii) Over frequency/speed protection.					
	viii) Ventilation failure indication & alarm.					
	ix) Over temperature of	VFD				
	x) Bearing temperature	protection.				
	xi) System earth fault pr	rotection.				
	xii) Speed reference los	s protection.				
23.02.00	Under VFD Bypass Modremain applicable.	de (if applicable) all the electrical	protections related to the N	lotor shall		
24.00.00	CONTROL FEATURES	3				
24.01.00	Following controls shall switches on the front pa	be provided as a part of the Opera nel door.	tor Control Panel or through	n separate		
	i) Start / stop (in local/remote mode)					
	ii) Speed control (Raise / lower)					
STAG	ERMAL POWER PROJECT E-III (2X660 MW) C PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2	SUB-SECTION : B-03 VFD	PAGE 9 OF 11		

CLAUSE NO.		TECHNICAL REQUIREMENT	s	एनशैपीमी NTPC			
	iii) Acknowledge/Accept	/ Test Push Button for annunciation	on				
	iv) Auto / Manual / Test	Mode select					
	v) Emergency stop						
	vi) Trip-Remote Breake	r					
25.00.00	DIAGNOSTIC FEATUR	DIAGNOSTIC FEATURES					
25.01.00	The VFD shall include a microprocessor/PLC based digital diagnostic system which monitors its own control functions and displays faults and operating conditions.						
25.02.00	Fault diagnostic shall be built into the system to supervise the operation and failure of the system. The information regarding failure of any of the system including shut down of the system shall be available. It shall be possible to retrieve the record of events prior to tripping of the system or de-energization. Auxiliary supply to the system components or to the electronics (firmware) for the diagnostics / display shall be taken care of by the manufacturer for this purpose.						
26.00.00	SERVICEABILITY / MA	AINTAINABILITY					
26.01.00		Power Component Accessibility: All power components in the converter sections shall be designed for rack-out accessibility for ease of maintenance and to minimize repair downtime.					
26.02.00	Marking / Labeling: Sleeve type wire marker tags or other acceptable means of permanent identification shall be applied to power and control wiring. Individual labels shall be provided for all major components of the VFD system.						
27.00.00	NOT USED						
28.00.00	TESTS						
28.01.00	ROUTINE TESTS						
		ine tests as envisaged in QA sect to be included in the equipment p		harges for			
28.02.00	TYPE TESTS						
	LIST OF TYPE TESTS	TO BE CONDUCTED					
	The following type tests	shall be conducted under this co	ntract for MV VFD				
	i) Overall efficiency determination of VFD system including transformer/ Harmonic filters etc at motor full load ii) Temperature rise test iii) Noise level iv) Harmonics of No load current.(Input/Output)						
	LIST OF TESTS FOR V	WHICH REPORTS HAVE TO BE	SUBMITTED				
	The following type test reports shall be submitted for VFD Panels'						
TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-4540-001A-2	SUB-SECTION : B-03 VFD	PAGE 10 OF 11			

CLAUSE NO.

TECHNICAL REQUIREMENTS



1) VFD panels (For LV VFD used with load >= 50 KW)

- i. Rated Current/ Output
- ii. Temperature rise test
- iii. Noise level test
- iv. Power Loss Determination Test
- v. Power factor measurement.
- vi. Degree of Protection Test
- vii. EMC Test
- viii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800

2) VFD panels (For MV VFD)

- i. Rated Current/ Output
- ii. Current Sharing
- iii. Voltage Division
- Power Loss Determination Test
- v. Power factor measurement.
- vi. Degree of Protection Test
- vii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800

3) AC/DC Reactor

- i. Lightning impulse test(If applicable)
- ii. Heat run test
- iii. Short time current test(If applicable)
- iv. Noise level test

4) Transformers (for Non Integrated type)

As per requirements mentioned in subsection for Transformer chapter in technical specifications.
 Transformer specs attached above

TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO: CS-4540-001A-2

SUB-SECTION : B-03 VFD

PAGE 11 OF 11

EPC PACKAGE FOR TALCHER THERMAL POWER PROJECT, STAGE-III (2x660 MW) Amendment No. 01 to Technical Specifications Section-VI of Bidding Document No.: CS-4540-001A-2

D 7	1.11.15 · A	1	0 -647	4.05.00	1	1			
B-7	VI/ Part-A		3 of 17	1.05.03	Switchgear /Numerical Relay Networking		/Numerical Relay Networking	the fellowing for all the 2314//44/07/ 2 2007 1	
		_			The Contractor's scope of work shall include the following for all the 33kV/11KV/ 3.3KV and LV Switchgears under this package. The communication architecture and design criteria have		The Contractor's scope of work shall include the following for all the 33kV/11KV/ 3.3KV and LV Switchgears under this package. The communication architecture and design criteria have		
					been explained in chapter B-05(B) of the specification.		ned in chapter B-05(B) of the spe		
1			_		The Contractor's scope of work shall include complete design, engineering, supply, installation,	The Contrac	The Contractor's scope of work shall include complete design, engineering, supply, installation,		
				_	testing and commissioning and AMC (Three Years) of the following.		testing and commissioning and AMC (Three Years) of the following. a) Communicable Numerical Relays (with IEC 61850) in all MV Switchgears & LV Switchgears in the bidder's scope. b) IEC 61850 Ethernet switches in Switchgear panels – Sufficient quantity of Ethernet		
					a) Communicable Numerical Relays (with IEC 61850) in all MV Switchgears & LV				
				_	Switchgears in the bidder's scope. b) Icc 61850 Ethernet switches in Switchgear panels – Sufficient quantity of Ethernet				
					switches as per requirement for all boards under bidder's scope. At least 2 ports per	switches as per requirement for all boards under bidder's scope. At least 2 ports per			
					switch shall be kept as spare ports.		switch shall be kept as spare ports. c) CatSe Ethernet cable / FO cable for connection of Numerical Relays to Ethernet		
					c) Cat5e Ethernet cable / FO cable for connection of Numerical Relays to Ethernet				
		0 " "			switches in all Switchgears.	switches in all Switchgears. d) Optical Fibre Cable with fire-retardant outer sheath as required for the complete			
		Section-IIB			d) Optical Fibre Cable with fire-retardant outer sheath as required for the complete				
		ELECTRICAL			numerical relay network.		numerical relay network.		
		SYSTEM /			e) Optical Fibre Cable termination equipment such as LIU, patch cord, etc. for the complete network.	e) Optical Fibre Cable termination equipment such as LIU, patch cord, etc. for the complete network.		t such as Liu, patch cord, etc. for the	
		EQUIPMENTS			f) HMI stations (Engineering & Operator Work Stations and printers) & suitable		f) HMI stations (Engineering & Operator Work Stations and printers) & suitable assengement for integration of HMI to LVS in Control Room. g) GPS, Time sunchronizing equipment & Digital Clocks.		
					arrangement for integration of HMI to LVS in Control Room.				
					g) GPS, Time synchronizing equipment & Digital Clocks.				
					h) Laptops – 5 Nos & Interface cable for connection of Numerical relay front port to the		h) Laptops – 5 Nos & Interface cable for connection of Numerical relay front port to the		
					laptop – One No. cable of length at least 5m per switchboard under bidder's scope. i) All other equipment required to meet the intended specification.		laptop – One No. cable of length of Least 5m per switchboard under bidder's scope. i) All other equipment required to meet the intended specification. j) The scope shall include the AMC Contract for the above specified system for a period of three years from the date of takeover by the Employer. k) Relay Test Equipment. 2 Nos. The typical Configuration of such a proposed system is as enclosed in Drawings 0000-205.		
					j) All other equipment required to meet the intended specification. j) The scope shall include the AMC Contract for the above specified system for a period				
					of three years from the date of takeover by the Employer.				
					k) Relay Test Equipment. 2 Nos.				
1					The typical configuration of such a proposed system is as enclosed in Drawings 0000-205-	The typical			
					POE-A-001 & 0000-205-POE-A-002. The numerical relay network shall include relays on all	POE-A-001. The numerical relay network shall include relays on all			
					MV & LV switchgears being supplied under this package including Employer's requirement	MV & LV switchgears being supplied under this package including Employer's requirement			
					indicated at 1.19.00.	indicated at	indicated at 1.19.00.		
B-8	VI / B	Sub- Section B-03	6 OF 11	12.08.00	Temperature rise: For dry type transformer the winding temperature rise shall be 95 Deg. C for Class-H insulation or 70 Deg.C for Class – F Insulation.	Temperature rise: For VFD dry type transformer temperature rise shall be Class-F (90 Deg C rise) for Class-H insulation and Class-B (70 Deg C rise) for Class –F Insulation winding over an ambient of 50 Deg C."			
					2.15.00 LIGHTING TRANSFORMER/WELDING TRANSFORMER	2.15.00 LIGHTING TRANSFORMER/WELDING TR		NG TRANSFORMER	
					2.13.00 Editing House Chillen Welling House Chillen	1)	Type & Rating	Dry type/ 100 KVA (Welding TRF),	
					[1- 1- 1- 1- 1- 1- 1- 1- 1- 1- 1- 1- 1	2)	Voltage Ratio	50KVA(Minimum)(Lighting TRF)	
					1) Type & Rating Dry type/ 100 KVA (Welding TRF), 2) Voltage Ratio 415/415, +/- 5% taps in steps of 2.5%	3)	Class of insulation	415/415, +/- 5% taps in steps of 2.5% B or better	
					3) Class of insulation B or better	4)	One minute power frequency	2.5 kV	
					One minute power frequency 2.5 kV	-	voltage	10.40	
					5) Enclosure protection IP-42 6) Type Test As per IS 2026	5)	Enclosure protection Type Test	IP-42 As per IS 2026	
					7) Fault level 3-5 kA secondary side	7)	Fault level	3-5 kA secondary side	
B-9	VI / B	Sub- Section B-06	8 OF 18	2.15.00					
	, 3	555555555	1 0. 10						
	VI-PartB	Chap:17	4 of 60	1.06.01	TYPE TEST REQUIREMENTS FOR EQUIPMENTS OTHER THAN GIS & 400KV AIS	TYPE TEST REQUIREMENTS FOR EQUIPMENTS OTHER THAN 400KV GIS .			
D 10	VI-LQI CD	Ciiap.17	4 01 00	1.06.01	CIRCUIT BREAKER	TIPE IES	O NEGUINEIVIEN IS FUR E	QUIFIVILINIS OTHER THAIN 400KV GIS.	
B-10		-		<u> </u>		T) (D = ==	T DECLUDED 12:120 2:22	216	
						TYPE TEST REQUIREMENTS FOR GIS_			
		Chap:17	4 of 60	1.06.01					
	VI-PartB				TYPE TEST REQUIREMENTS FOR GIS & 400KV AIS CIRCUIT BREAKER				
B-11								_	
						deleted. Not applicable.			
1	VI-PartB	Chap:17	6 of 60	1.07.00	Type tests to be conducted on 400KV AIS Circuit Breaker		applicable.		
	VI-Parts	Cnap:1/	0 01 00	1.07.00	Type lesis to be conducted on 400KV Als Circuit Breaker				
B-12									



SUB-SECTION-E-47 VFD MODULE

TALCHER THERMAL POWER PROJECT STAGE-III (2 X 660 MW) EPC PACKAGE TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC NO.:CS-4540-001A-2 CLAUSE NO.

QUALITY ASSURANCE

VFD MODULE					
ATTRIBUTES / CHARACTERISTICS	Visual & Dimensi onal checks	Make / Type / Ratin g etc.	Final Inspectio n as ISS / IEC	Remarks	
ITEMS/COMPONENTS, SUB SYSTEM ASSEMBLY					
HT Breaker (IEC 56)	Υ	Υ	Υ		
DC Reactor	Υ	Υ			
Transformer	Υ	Y		For details refer table for LT Indoor Transformer & Auxiliary Transformer	
Motor	Υ	Υ		For details refer separate table for Motor	
VFD Panel	Y	Υ		For details refer table for VFD Panel	

Note: 1) This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed alongwith relevant supporting documents during QP finalisation.

2) Make of all major Bought Out Items will be subject to NTPC approval.

CLAUSE NO.

QUALITY ASSURANCE

			V	FD I	PAN	IEL							
Electrical Properties	Mechanical Properties	Chemical Properties	Dimensions / Finish	Fype/ Rating/Functional check	HV/IR	Routine test as per relevant std.	Sonstructional Features	S:6005 ,Seven tank process	Paint finish/ shade/thickness	Mountings / BOM/ Make, ompleteness	nterlock Functional & Operation Festing / Simulation check	Degree of Protection Test	Final testing as per Relevant IS/IEC
	_	_		_			_	_		Ŏ]	
Υ	Υ	Υ	Υ										
Υ	Υ	Υ	Υ										
				Υ	Υ	Υ							
				Υ	Υ	Υ							
				Υ		Υ							
				Υ	Υ	Υ							
				Υ	Υ	Υ							
Υ			Υ	Υ	Υ	Υ							
				Υ	Υ	Υ							
				Υ	Υ	Υ							
				Υ	Υ	Υ							
				Υ		Υ							
	Υ	Υ	Υ	Υ		Υ							
							Υ						
								Υ	Υ				
i T									Υ	Υ	Υ	Υ	Υ
	Y	Y Y Y Y Y	Y Y Y Y Y Y Y Y Y Y Y Y Y Y Y Y Y Y Y	- -	A Clectrical Properties A	A C Electrical Properties A A A Mechanical Properties A A A A A A A A A A A Bimensions / Finish Bimensions / Finish A <td>A A A Electrical Properties A</td> <td>4 A A Electrical Properties 4 A</td> <td>4 A A Electrical Properties 4 A A A A A A Chemical Properties 4 A</td> <td> </td> <td> Complete Complete</td> <td> Completeness</td> <td> A</td>	A A A Electrical Properties A	4 A A Electrical Properties 4 A	4 A A Electrical Properties 4 A A A A A A Chemical Properties 4 A		Complete Complete	Completeness	A

NOTE:

- This is an indicative list of Test/ Checks. The manufacturer to furnish a detailed Quality Plan indicating the practice and procedure along with relevant supporting documents.
 All major Bought Out Items will be subject to NTPC approval.


TALCHER THERMAL POWER PROJECT STAGE-III (2X660 MW) EPC PACKAGE	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC.NO.: CS-4540-001A-2	SUB-SECTION -E-47 VFD MODULE	Page 2 of 2
--	---	---------------------------------	----------------





CUSTOMER	M/s THDC India Ltd.	INSPECTION BY	NTPC
PROJECT	TALCHER THERMAL POWER PROJECT STAGE-III (2x660MW) EPC PACKAGE	WO NO.	42112A40461 & 42112A40462 & SPARE
TD Date	18.05.23	NTPC DOC NO.	4540-001-110-PVE-Y-116

Note 1: Data given below is subject to tolerance as per IS/II the data is guaranteed.	EC:60034 unless specified otherwise as '*' for which
1. GENERAL	1.
(i) Manufacturer	(i) BHEL, BHOPAL
(ii) Equipment driven by motor	(ii) CEP PUMP
(iii) Motor type	(iii) SCIM
(iv) Country of origin	(iv) INDIA
(v) Quantity	(v) 03 Nos + 03 Nos + spare (as applicable).
2. DESIGN AND PERFORMANCE DATA	2.
(i) Frame Size	(i) 1LA7716-4
(Note: These CEP motors are suitable for V	
(ii) Type of duty	(ii) CONTINUOUS & INVERTER DUTY <u>R1</u>
(iii) Type of enclosure, Method of	(iii) TETV/IC511/IP55
Cooling, Degree of Protection	AS PER CL. 10 OF IEC: 34-5
Cooling, Degree of Frocetion	ASTERCE. 10 OF IEC. 54-5
(-) A	(:-) IC/IEC.(0024
(iv) Applicable standard to which	(iv) IS/IEC:60034
motor generally conforms	
(v) Type of mounting	(v) Vertical(V10)
(vi) Direction of rotation viewed	(vi) CW (BI-DIRECTIONAL)
from driving end.	(11) e ii (Bi Bilde Hervill)
from driving chd.	
(vii) Standard continuous rating	(vii) 1282
at 40deg.C ambient temp.(KW)	
(viii) (a)Derated rating for specified	(viii) 1200
normal condition i.e., ambient	
temperature of 50 Deg.C (KW)	
1 8 7	
(ix) Rated voltage (Volts)/	(ix) 3300 / 50
Rated Frequency (Hz)	(IX) 3300 / 30
(x) Permissible variation of	(\mathbf{v})
(a) Voltage (%)	(x)
	(a) ± 6
(b) Frequency (%)	(b) +3 -5
(c) Combined voltage and	(c) 10 % (Abs.)
frequency	(') 00
(xi) Minimum permissible starting voltage (%)	(xi) 80
(xii) Rated speed at rated voltage	(xii) 1489
	1184 / 1480





(xiii) At rated voltage and frequency	(xiii)
(a) Full load current (Amp)	(a) 254
(b) No load current (Amp)	(b) 64
(xiv) Power Factor at (a) 100% load	(xiv) (a) 0.87
(b) 75% load	(b) 0.82
(c) 50% load	(c) 0.75
(d) No load	(d) 0.045
(e) Starting	(e) 0.17
(xv) Efficiency (%) at rated voltage	(xv)
and frequency at (a) 100% load	(a) 95.0
(b) 75% load	(b) 94.5
(c) 50% load	(c) 93.0
(xvi) Starting current (%) at(a) Rated Voltage(b) Minimum starting Voltage	(xvi) (a) 720 % (Maximum)/ depends on VFD setting (b) 576 (Maximum) AT 80 % RV/ depends on VFD setting
(xvii) Starting time with minm. Permissible voltage(a) Without driven equipment coupled(b) With driven equipment coupled	(xvii) (a) depends on VFD setting (3.0 sec for DOL start) <u>R1</u> (b) depends on VFD setting (3.85 sec for DOL start) <u>R1</u>
(xviii)Safe stall time with 100 % rated voltage(a) From hot condition(b) From cold condition	(xviii) (a) 15 Sec (b) 20 Sec
(b) Pull up at 100% Voltage(c) Pull out at 100% Voltage(d) Rated load (kg-m) at 100 % Voltage	(xix) (a) depends on VFD setting (49 % of FLT for DOL) <u>R1</u> (b) depends on VFD setting (72 % of FLT for DOL) <u>R1</u> (c) 210 % / 1648.5 kg-m (d) 785 kg-m ends on VFD setting(Minimum 15% for DOL start) <u>R1</u>
(xx) Stator winding resistance per	(xx) 0.04139 +/- 5%
phase (ohms) ref. to 20 deg.C. (xxi) Flywheel Moment of motor (Kg-m2) (GD2)	(xxi) 188 kg-m ²
(xxii) No. of permissible starts from Hot/Cold condi	tion (xxii) 2 / 3
(xxiii)Locked Rotor KVA Input (at Rated Voltage)	(xxiii) 10452



बी एच ई एन **मिश्रीस**

BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL A.C. MACHINES ENGINEERING DIVISION MOTOR TECHNICAL DATA (Rev 01)

(xxiv)Locked Rotor kVA / Rated kW

(xxiv) 8.71 (Without any positive tolerance) <u>R1</u>

(xxiv)Locked Rotor kVA / Rated kW	(xxiv) 8.71 (Without any positive tolerance) <u>R1</u>
(xxv) Vibration at No Load (Brg.Housing)	(xxv)
(a) Velocity (mm/s)	(a) 2.3 (rms)
(b) Displacement (Microns)	(b) 37 (rms)
(xxvi)Noise Level at No Load	(xxvi) 85 dBA at 1.0 metre.
(xxvii) Core current rating(i.e earth fault current withstand cap	
(xviii) % THD considered for motor design due to VFD appli	ication: < 5% <u>R1</u>
3. CONSTRUCTIONAL FEATURES	3.
(i) Stator winding Insulation	(i)
(a) Class & type	(a) F/EPOXY MICA RESSIN POOR (VPI)
(b) Tropicalised (Yes/No)	(b) YES
(c) Temperature rise over specified	(c) 70
ambient of 50 deg C (deg C)	
(d) Method of temp. Measurement	(d) BY RESISTANCE
(e) Stator winding connection	(e) STAR
(f) No. of terminals brought out	(f) 6
(ii) Type of terminal box for	(ii)
	t tight phase segregated double walled(metallic and insulated
	terminal box. <u>R1</u>
(b) Space heater	(b) CAST / FABRICATED
(c) Temperature detectors	(c) CAST / FABRICATED
(d) Instrument switches etc.	(d) NIL
(iii) For main terminal box	(iii)
(a) Location (from DE)	(a) RHS
(b) Entry of cables	(b) BOTTOM OF TB
(c) Recommended cable size (c) 1R X 1C X 185 So (Runs/cores/x-section mm²/ material)	n.mm. per phase (i.e. 3 Rx 1C X 185 Sq.mm for all three phases) <u>R1</u>
(d) Fault level (MVA)/ Duration (Sec)	(d) 44 KA / 0.20 SEC
(iv)For Bearing	(iv)
(a) Type	(a) ANTIFRICTION
(b) Manufacturer	(b) NTPC APPVD. SUPPLIER
(c) Recommended lubricant	(c) IOC SERVOGEM-3/EQV. GREASE
(d) Guaranteed Life in Hrs.	(d) 40000 Hrs.
(e) Lubrication Type	(e) SELF
(f) Whether Dial Type Thermometer Provided	(f) YES
(v)Type of cooler (CACA/CACW)	(v) NA
(vi)Cooling water requirement for CACW motors	(vi)
(a) Quantity required	(a) NA
(b) Maximum permissible inlet water temperature (deg C)	(b) NA
(c) Pressure of water at inlet to coolers	(c) NA
(d) Outlet temperature of water at full load (anticipated value)	(d) NA
(vii)Weight of	(vii)
(a) Motor Stator (Kg)	(a) 6600
(b) Motor rotor (Kg)	(b) 1500
(c) Cooler (Kg)	(c) NA
(d) Total weight (Kg)	(d) 8100
(ix) Max. Perm. Temp. of Rotor	(ix) 350 Deg. C
(x) Total Temp. of Rotor during I Start	(x) 132 Deg. C
(xi) Total Temp. of Rotor during II Start	(xi) 144 Deg. C





(xii) Surge Withstand Voltage (Stator winding) (xii) As per IEC: 60034-15

(a) 0.3/3 Microsecond Surge (kVp) (a) 11.8 (b) 1.2/50 Microsecond Surge (kVp) (b) 18.2

4.00 LIST OF ACCESSORIES

4.01 RTDs for winding (Type/Nos/Leads
/location/make/Res. at 0 Deg.C)

Between Coil Sides in slots/
Reputed NTPC Appvd./ 100 Ohms

4.02 RTDs for bearing (Type/Nos./Leads : PT100 DUPLEX/ 3 nos per bearing side(Total=6) / 4 Wire

/location/make/Res. at 0 Deg.C) In Bearing Housing/

Reputed NTPC Appvd./ 100 Ohms

4.03.01 RTDs for Hot Air (Type/No/Leads) : NA 4.03.02 RTDs for Cold Air (Type/No/Leads) : NA

4.04 Space Heaters : YES

4.04.01 Nos. : 4 nos of 800W each.

4.04.02 Power (Watts) : 800 W

4.04.03 Supply Voltage : 1 PH. 240VAC 4.04.04 Location : In Air pockets

4.05 Stator Terminal Box

4.05.01 Type : PHASE SEPARATED T.B

4.05.02 Short time current rating : 44 KA 4.05.03 Duration (sec) : 0.20

4.06 Neutral TB : PHASE SEPARATED T.B.

 4.07
 Current Transformers
 : NA

 4.07.01 Nos.
 : -

 4.07.02 Ratio
 : -

 4.07.03 Accuracy Class
 : -

 4.07.04 Vk (V)/Rct
 : -

 4.07.05 Exciting Current
 : -

4.08 Dial Type Thermometer (Type/make : Mercury in Steel/ NTPC Appvd/ Accuracy/ Connection Type & size + - 1% Full Scale / BSP 3/4"

4.08.01For Bearings (Nos.) : NA. 4.08.02For Air Temp (Nos.) a. Hot Air : NA

b. Cold Air : NA

4.08.03Contact Rating : 5 A AT 240 V AC/ 0. 5 A AT 220 V DC.

4.08.04Range : 0 -120 Deg. C.

4.08.05 Supply Voltage : 240 V, 50 Hz, 1 Phase

4.09 Rotor Terminal Box : NA

4.10 TBs for RTDs, BTDs & Space Heater : YES

4.11 Sole Plate : NO

4.12 Anchoring items : YES (As per OGA)





4.13 Base Frame : NO

4.14 Speed Switch : NO 4.14.01 Supply Voltage : NA

4.15 Insulation of Bearing(NDE side housing) : Yes (DE side earth brush shall be provide to ground shaft)

4.16 Forced Oil lubrication : NA

4.17 Oil level Indicator : NA

4.18 Noise Reducer : NO

4.19 Water flow Indicator : NA 4.19.01No/Contact Rating : NA

4.20 Water leakage detector : NA

4.21 Tachogenerator : NA

4.22 Grounding Pads

4.22.01No & Size on motor body : 2 (at diagonally opposite side)

4.22.02Nos on Terminal Box : 2

4.23 Vibration Pads : YES

4.23.01Nos & Size: 02 (total), 60 mm cube4.23.02Location: On DE and NDE endshield.

4.24 Paint Shade : RAL 5012

4.25 Any other fitments : DE side earth brush shall be provide to ground shaft. *R1*

4.26 External Thrust on Motor : NA

NOTE: The motor is suitable for VFD start/operation. (Motor and insulation system shall be designed to accept the applied voltage waveform, within the Vpeak and dv/dt limit of IEC:61800) R1

5.00 LIST OF CURVES


Thermal Withstand Characteristics : 42112-61 /04 5.06 Efficiency & PF Vs Load Curves : 42112-61 /02 5.07 Negative sequence curve : 42112-61 /05 5.08 Calibration curve for RTD/BTD : 42112-61/06 5.09 Torque & Current Vs Speed Curves : 42112-61 /01 5.10 Speed & Current Vs Time Curves : 42112-61 /03


PREPARED BY:

(B N Jena) AME BHEL-BHOPAL






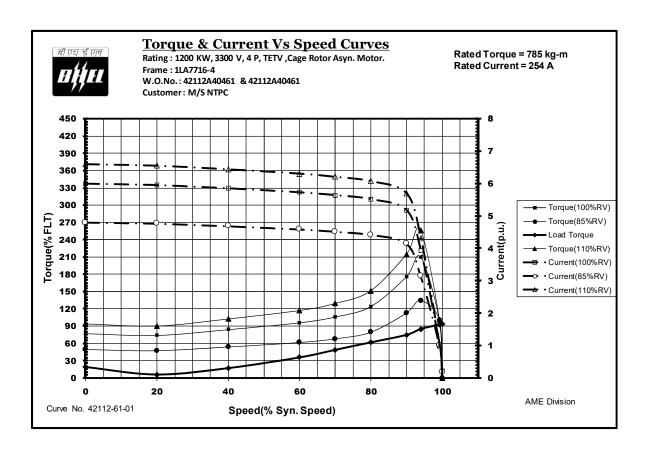


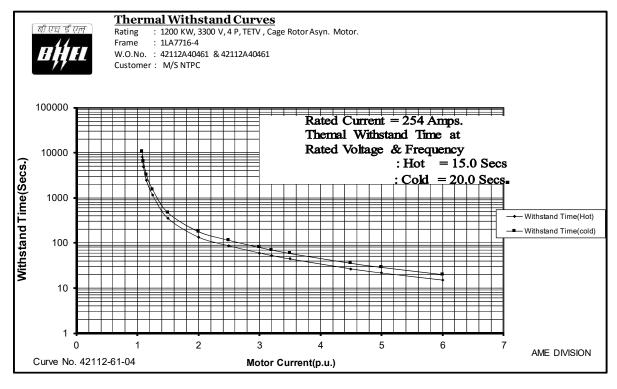







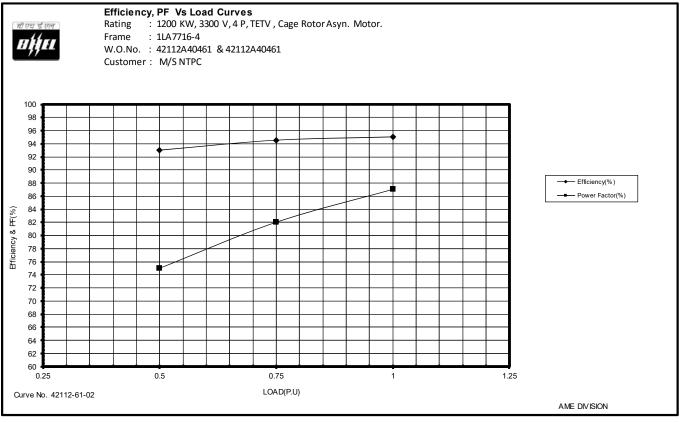

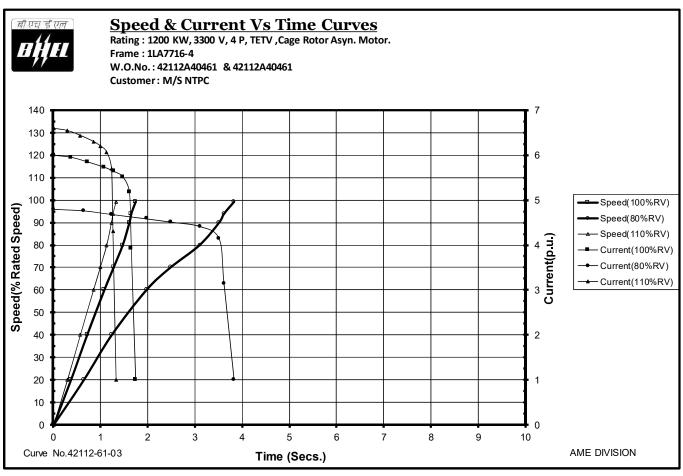



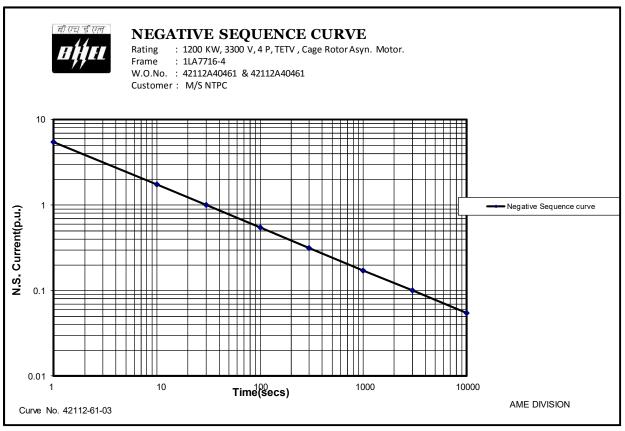


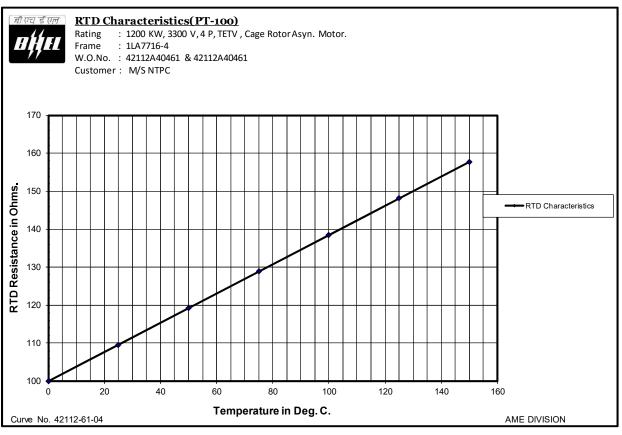

4540-001-109-PVE-Y-001/01/CAT-I/Page: 2 of 15



BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL A.C. MACHINES ENGINEERING DIVISION **MOTOR TECHNICAL DATA (REV-01)**



CUSTOMER	M/s NTPC Ltd through PSCM	INSPECTION BY	NTPC
PROJECT	NTPC Talcher 2x660MW Set-1	WO NO.	42112A40186,87
TD Date	11-Nov-2024 (Rev 00), 29-Jan-25 (Rev 01)	NTPC DOC NO.	4540-001-109-PVE-Y-001

Note 1: Data given below is subject to tolerance as per IS/IEC:60034 unless specified otherwise as '*' for which the data is guaranteed.

1. GENERAL	1.
(i) Manufacturer	(i) BHEL, BHOPAL
(ii) Equipment driven by motor	(ii) RC PUMP
(iii) Motor type	(iii) SCIM
(iv) Country of origin	(iv) INDIA
(v) Quantity	(v) 04 Nos. + 04 Nos. + spares as applicable.
2. DESIGN AND PERFORMANCE DATA	2.
(i) Frame Size (Note: RC PUMP motors are suitable for both	(i) 1LA7716-4 h VFD & DOL start / operation)
(ii) Type of duty	(ii) CONTINUOUS & Inverter Duty
(iii) Type of enclosure, Method of Cooling, Degree of Protection	(iii) TETV / IC511 / IP55 AS PER CL. 10 OF IEC: 34-5
(iv) Applicable standard to which motor generally conforms	(iv) IS/IEC:60034
(v) Type of mounting	(v) Horizontal (B3)
(vi) Direction of rotation viewed from driving end.	(vi) CW (BI-DIRECTIONAL)
(vii) Standard continuous rating at 40deg.C ambient temp.(KW)	(vii) 1256
(viii) Derated rating for specified normal condition i.e., ambient temperature of 50 Deg.C (KW)	(viii) 1175
(ix) Rated voltage (Volts) / Rated Frequency (Hz)	(ix) 3300 / 50
 (x) Permissible variation of (a) Voltage (%) (b) Frequency (%) (c) Combined voltage and frequency (xi) Minimum permissible starting voltage (%) 	(x) (a) ± 6 (b) + 3, - 5 (c) 10 % (Abs.) (xi) 80
(xii) Rated speed at rated voltage and frequency (r.p.m.)	(xii) 1490

^{*} Note: refer following document for motor sizing calculation: Doc no: 4540-001-109-PVM-Y-011. Margin of >10% has been considered on motor rating over Max kW demand by load.

4540-001-109-PVE-Y-001/01/CAT-I/Page: 3 of 15



BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL A.C. MACHINES ENGINEERING DIVISION MOTOR TECHNICAL DATA (REV-01)

(xiii) At rated voltage and frequency	(xiii)
(a) Full load current (Amp)	(a) 249
(b) No load current (Amp)	(b) 66
(xiv) Power Factor at (a) 100% load	(xiv) (a) 0.87
(b) 75% load	(b) 0.82
(c) 50% load	(c) 0.75
(d) No load	(d) 0.053
(e) Starting	(e) 0.18
(xv) Efficiency (%) at rated voltage and frequency at	(xv)
(a) 100% load	(a) 95.0
(b) 75% load	(b) 94.5
(c) 50% load	(c) 93.0
(xvi) Starting current (%) at(a) Rated Voltage(b) Minimum starting Voltage	(xvi) (a) 720 % (Maximum) (b) 480 AT 80 % RV
(xvii) Starting time with minm. Permissible voltage(a) Without driven equipment coupled(b) With driven equipment coupled	(xvii) (a) 3 Sec (b) 4.2 Sec
(xviii)Safe stall time with 100 % rated voltage (xviii)(a) From hot condition(b) From cold condition	(a) 15 Sec (b) 20 Sec
 (xix) Torque at (in % / kg-m) (a) Starting (at minimum permissible voltage) (b) Pull up at 100% Voltage (c) Pull out at 100% Voltage (d) Rated load (kg-m) at 100 % Voltage (e) Mínimum Accelerating Torque (Kg-m) at 80 % RV 	(xix) (a) 70 % / 537.6 kg-m (b) 110 % / 844.8 kg-m (c) 250% / 1920 kg-m (d) 768 kg-m (e) 28 % / 215.04
(xx) Stator winding resistance per phase (ohms) ref. to 20 deg.C.	(xx) 0.04139 +/- 5%
(xxi) Flywheel Moment of motor (Kg-m2) (GD2)	(xxi) 81.6 kg-m ²
(xxii) Permissible starts from Hot/Cold condition	(xxii) 2 / 3 Nos.
(xxiii)Locked Rotor KVA Input (at Rated Voltage)	(xxiii) 10247.22
(xxiv)Locked Rotor kVA / Rated kW	(xxiv) 8.72 (Maximum)

4540-001-109-PVE-Y-001/01/CAT-I/Page: 4 of 15



BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL A.C. MACHINES ENGINEERING DIVISION **MOTOR TECHNICAL DATA (REV-01)**

WO: 42112A401-86,87

(a) 0.3/3 Microsecond Surge (kVp)

(b) 1.2/50 Microsecond Surge (kVp)

(xxv) Vibration at No Load (Brg.Housing) (xxv) (a) Velocity (mm/s) 2.3 (rms) (a) (b) Displacement (Microns) (b) 37 (p-p) (xxvi)Noise Level at No Load (xxvi) 85 dBA at 1.0 metre. 3. CONSTRUCTIONAL FEATURES 3. (i) Stator winding Insulation (a) Class & type (a) F/EPOXY MICA RESSIN POOR (VPI) (b) Tropicalised (Yes/No) (b) YES (c) Temperature rise over specified (c) 70 ambient of 50 deg C (deg C) (d) Method of temp. Measurement (d) BY RESISTANCE (e) Stator winding connection (e) STAR (f) No. of terminals brought out (f) 6 (ii) Type of terminal box for (ii) (a) PSTB (a) Stator leads (b) Space heater (b) CAST / FABRICATED (c) Temperature detectors (c) CAST / FABRICATED (d) Instrument switches etc. (d) NIL (iii) For main terminal box (iii) (a) Location (from DE) (a) RHS (b) Entry of cables (b) BOTTOM OF TB (c) Recommended cable size (c) 1R X 1C X 185 Sq.mm. per phase (Runs/cores/x-section mm²/ material) (d) Fault level (kA or MVA)/ Duration (Sec) (d) 250 / 0.25 (iv)For Bearing (iv) (a) Type (a) ANTIFRICTION (b) Manufacturer (b) NTPC APPVD. SUPPLIER (c) Recommended lubricant (c) IOC SERVOGEM-3/EQV. GREASE (d) Guaranteed Life in Hrs. (d) 40000 Hrs. (e) Lubrication Type (e) SELF (f) Whether Dial Type Thermometer Provided (f) NO (v)Type of cooler (CACA/CACW) (v) NA (vi)Cooling water requirement for CACW motors (vi) (a) Quantity required (a) NA (b) Maximum permissible inlet (b) NA water temperature (deg C) (c) Pressure of water at inlet to coolers (c) NA (d) Outlet temperature of water (d) NA at full load (anticipated value) (vii)Weight of (vii) (a) Motor Stator (Kg) (a) 6150 (b) Motor rotor (Kg) (b) 1500 (c) Cooler (Kg) (c) NA (d) Total weight (Kg) (d) 7650 (ix) Max. Perm. Temp. of Rotor (ix) 350 Deg. C (x) Total Temp. of Rotor during I Start (x) 132 Deg. C (xi) Total Temp. of Rotor during II Start (xi) 144 Deg. C (xii) Surge Withstand Voltage (Stator winding) (xii) As per IEC: 60034-15


(a) 11.8

(b) 18.2

4540-001-109-PVE-Y-001/01/CAT-I/Page: 5 of 15



BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL **A.C. MACHINES ENGINEERING DIVISION MOTOR TECHNICAL DATA (REV-01)**



WO: 42112A401-86,87 4.00 LIST OF ACCESSORIES

4.01 RTDs for winding (Type/Nos/Leads : PT100 SIMPLEX / 12 / 3 Wire /location/make/Res. at 0 Deg.C) Between Coil Sides in slots/

Reputed NTPC Appvd./ 100 Ohms

4.02 RTDs for bearing (Type/Nos./Leads : PT100 DUPLEX/ 3 Nos. per bearing side(Total=6) / 4 Wire

In Bearing Housing / /location/make/Res. at 0 Deg.C)

Reputed NTPC Appvd./ 100 Ohms

4.03.01 RTDs for Hot Air (Type/No/Leads) : NA

4.03.02 RTDs for Cold Air (Type/No/Leads) : NA

Space Heaters 4.04 : YES

: 4 Nos of 800W each. 4.04.01 Nos.

: 800 W 4.04.02 Power (Watts)

4.04.03 Supply Voltage : 1 PH. 240VAC 4.04.04 Location : In air pockets

4.05 Stator Terminal Box

: PSTB 4.05.01 Type 4.05.02 Short time current rating : 250 4.05.03 Duration (sec) : 0.25

4.06 Neutral TB : PSTB

4.07 **Current Transformers** : NA 4.07.01 Nos. 4.07.02 Ratio 4.07.03 Accuracy Class 4.07.04 Vk (V)/Rct 4.07.05 Exciting Current

4.08 Dial Type Thermometer (Type/make : NA

Accuracy/ Connection Type & size

4.08.01For Bearings (Nos.) : NA 4.08.02For Air Temp (Nos.) a. Hot Air : NA b. Cold Air : NA 4.08.03Contact Rating : NA 4.08.04Range : NA 4.08.05Supply Voltage : NA

4.09 Rotor Terminal Box : NA

TBs for RTDs, BTDs & Space Heater 4.10 : YES

: YES* 4.11 Sole Plate

4.12 Anchoring items : YES (As per OGA)

4.13 Base Frame : YES* 4.14 Speed Switch : NO 4.14.01 Supply Voltage : NA

^{*} Sole plate/base frame shall be part of common skid, which shall be in a scope of BHEL-HYD.

4540-001-109-PVE-Y-001/01/CAT-I/Page: 6 of 15



BHARAT HEAVY ELECTRICALS LIMITED, BHOPAL A.C. MACHINES ENGINEERING DIVISION **MOTOR TECHNICAL DATA (REV-01)**

WO: 42112A401-86,87

4.15 **Insulation of Bearing** : Yes, NDE bearing housing

Forced Oil lubrication 4.16

4.17 Oil level Indicator : NA

4.18 Noise Reducer : Yes

4.19 Water flow Indicator : NA 4.19.01No/Contact Rating : NA

4.20 Water leakage detector : NA 4.21 Tachogenerator : NA

4.22 Grounding Pads

: 2, 6Tk X 25 X 55 mm 4.22.01Nos. & Size on motor body

4.22.02Nos. on Terminal Box : 2

4.23 Vibration Pads : Yes

4.23.01Nos & Size : 02 (total), 80 mm cube 4.23.02Location : At DE and NDE endshield.

4.24 Paint Shade : RAL 5012

4.25 Any other fitments : Earth Brush at DE

4.26 External Thrust on Motor : NA

4.27 Alarm trip values : (a) temperature alarm and trip values:

> Winding temperature high for Alarm: 125 deg C. Winding temperature very high for Trip:130 deg C. Bearing temperature high for Alarm: 85 deg C. Bearing temperature v. high for Trip: 90 deg C.

b) Vibration alarm and trip values (Loaded condition):

Alarm (velocity mode / displacement mode): 4.5 mm/sec (rms) / 57 microns.

Trip (velocity mode / displacement mode): 7.1 mm/sec

(rms) / 90 microns.

NOTE: The motor is suitable for both VFD and DOL start / operation.

(Motors will comply to the requirements as stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable

5.00 LIST OF CURVES

5.01	Thermal Withstand Characteristics	: 42112-86,87 /01
5.02	Torque Vs Speed Curves	: 42112-86,87 /02
5.03	Current Vs Speed Curves	: 42112-86,87 /02
5.04	Current Vs Time curves	: 42112-86,87 /03
5.05	Speed Vs Time curves	: 42112-86,87 /03
5.06	Efficiency & PF Vs Load Curves	: 42112-86,87 /04
5.07	Negative sequence curve	: 42112-86,87 /05
5.08	Calibration curve for RTD/BTD	: 42112-86,87 /06



