


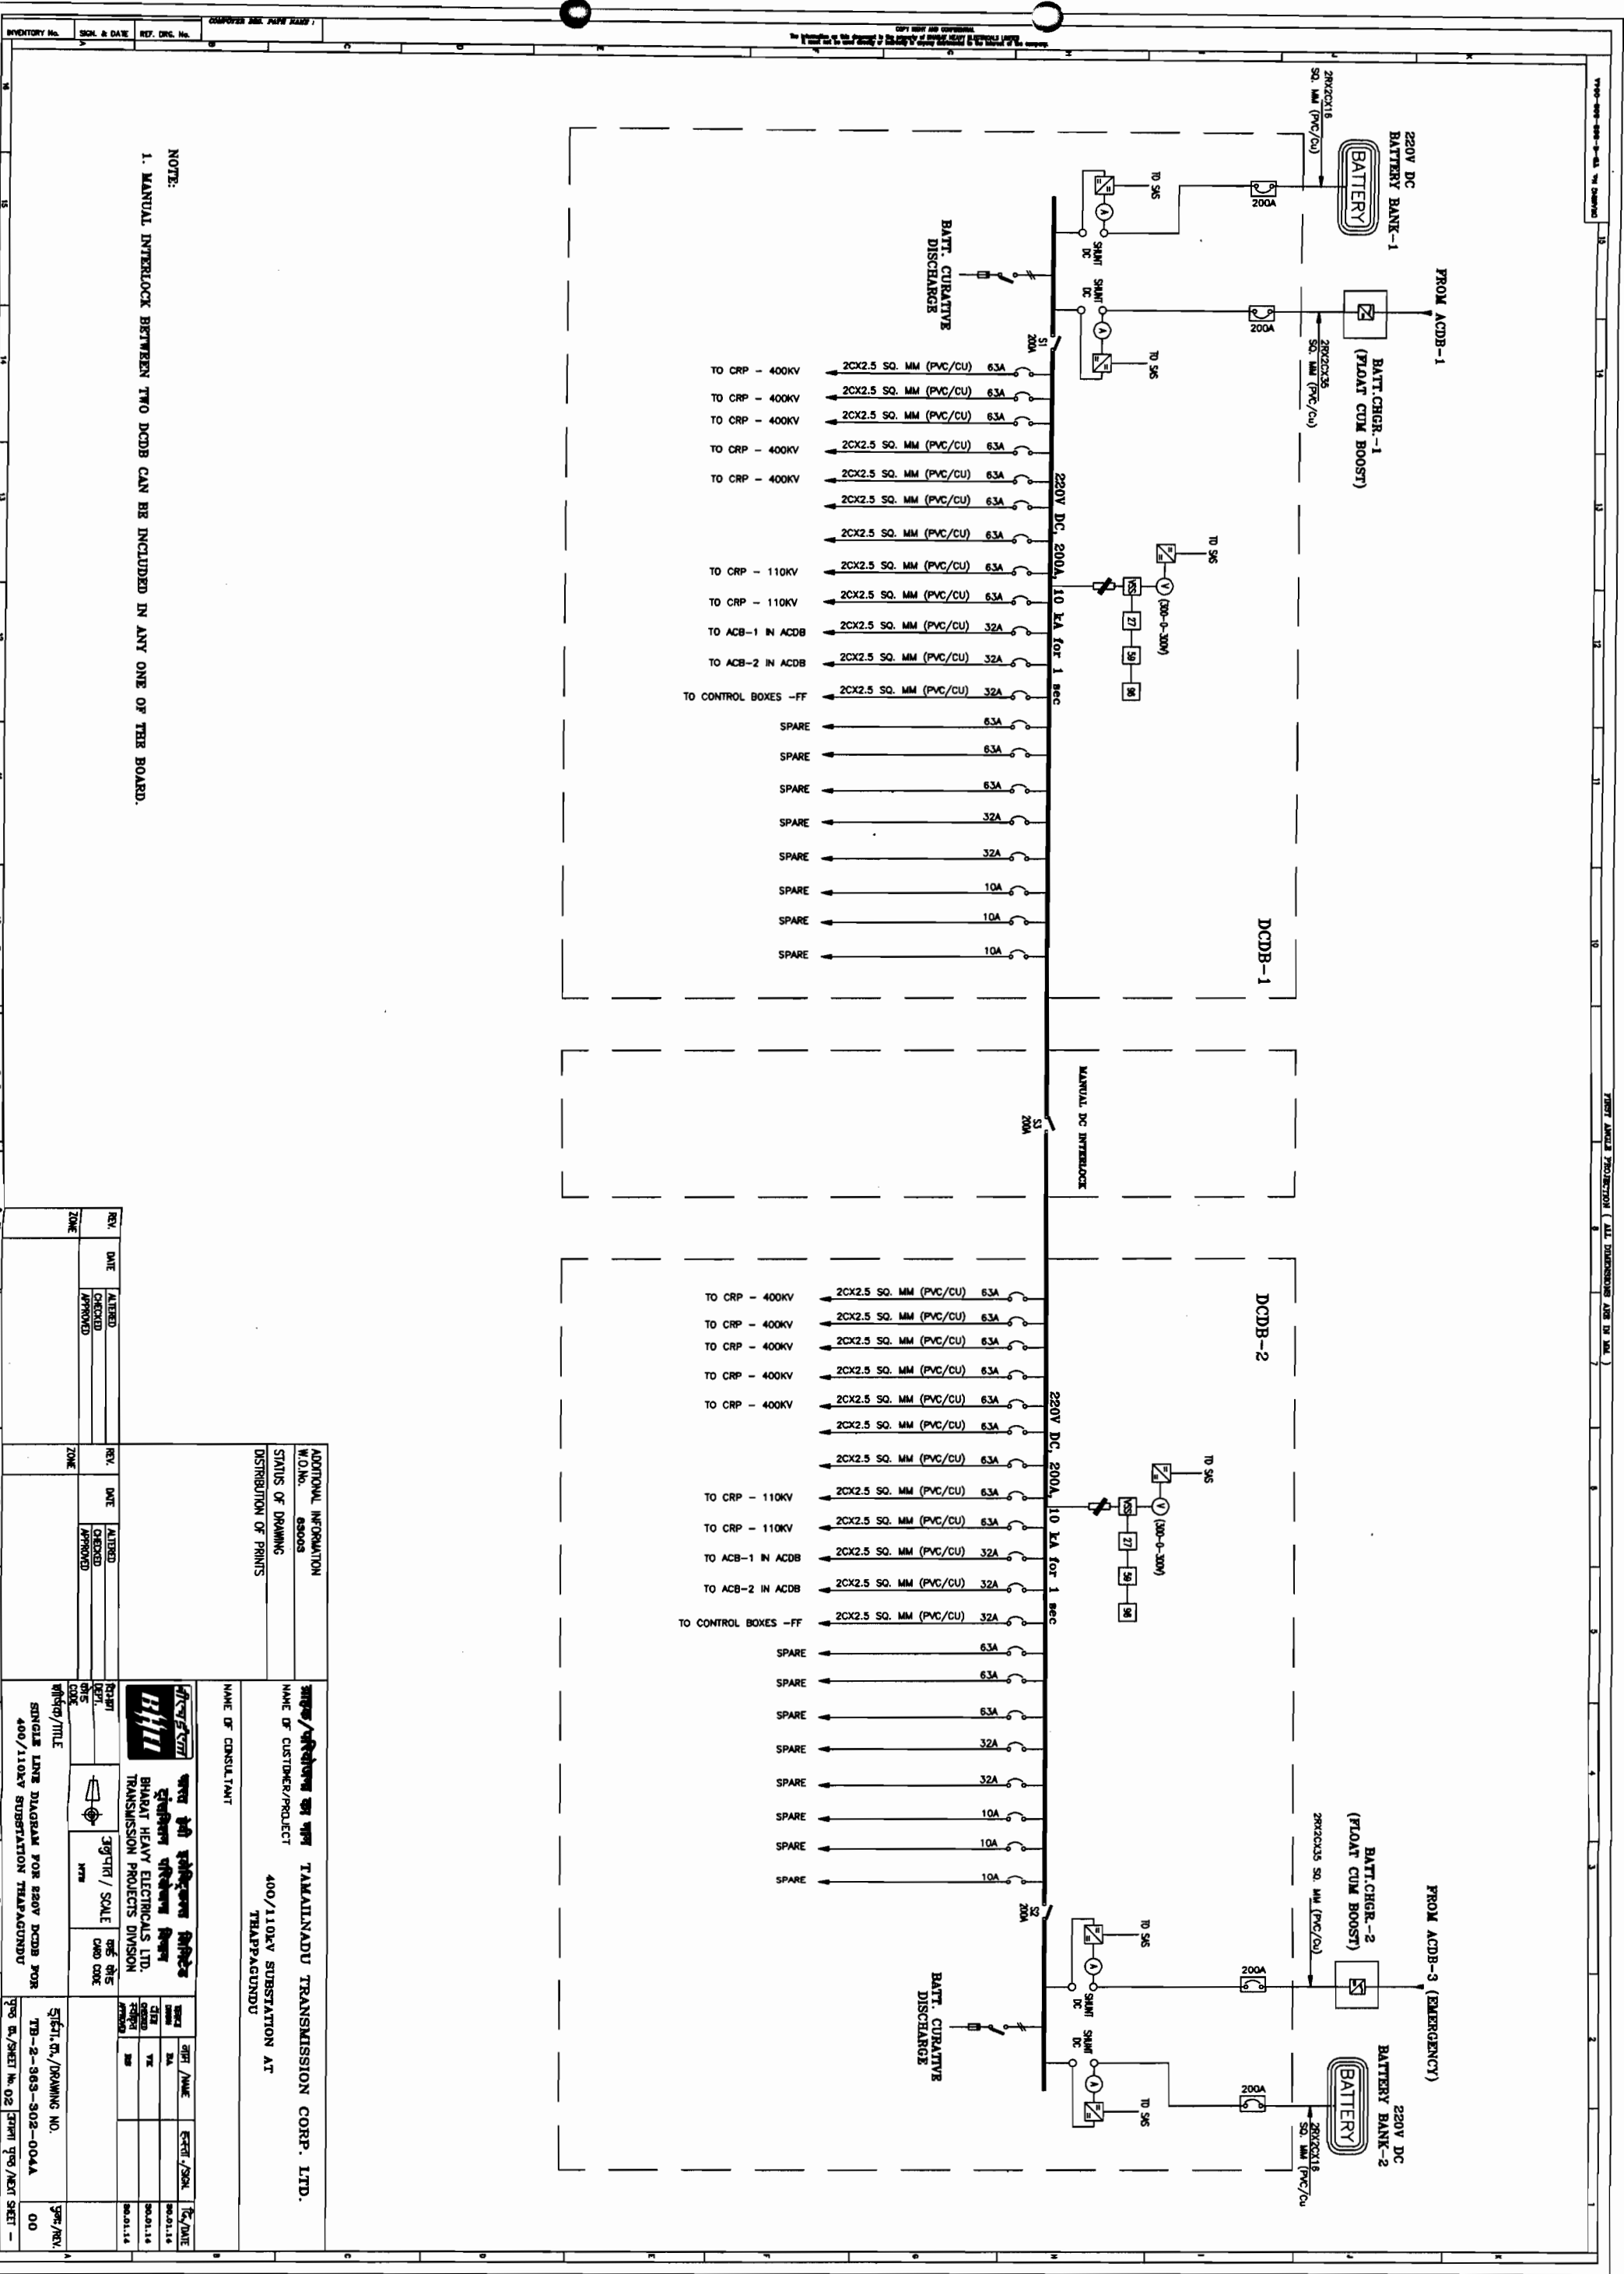


NOTE:
1. MANUAL INTERLOCK BETWEEN TWO DCDB CAN BE INCLUDED IN ANY ONE OF THE BOARD.

REVISION				REVISION			
REV.	DATE	ALTERED	BY	REV.	DATE	ALTERED	BY
1		CHECKED		2		CHECKED	
2		APPROVED		3		APPROVED	

ADDITIONAL INFORMATION		TAMAILNADU TRANSMISSION CORP. LTD.	
W.O. No.		400/110KV SUBSTATION AT	
STATUS OF DRAWING		THAPPAUNDU	
DISTRIBUTION OF PRINTS			

NAME OF CONSULTANT		BHIL	
NAME OF CUSTOMER/PROJECT		BHARAT HEAVY ELECTRICALS LTD.	
NAME OF CONSULTANT		TRANSMISSION PROJECTS DIVISION	
SCALE		300mm / 100mm	
SHEET NO.		TB-2-563-302-004A	
SHEET NO.		02	
SHEET NO.		00	

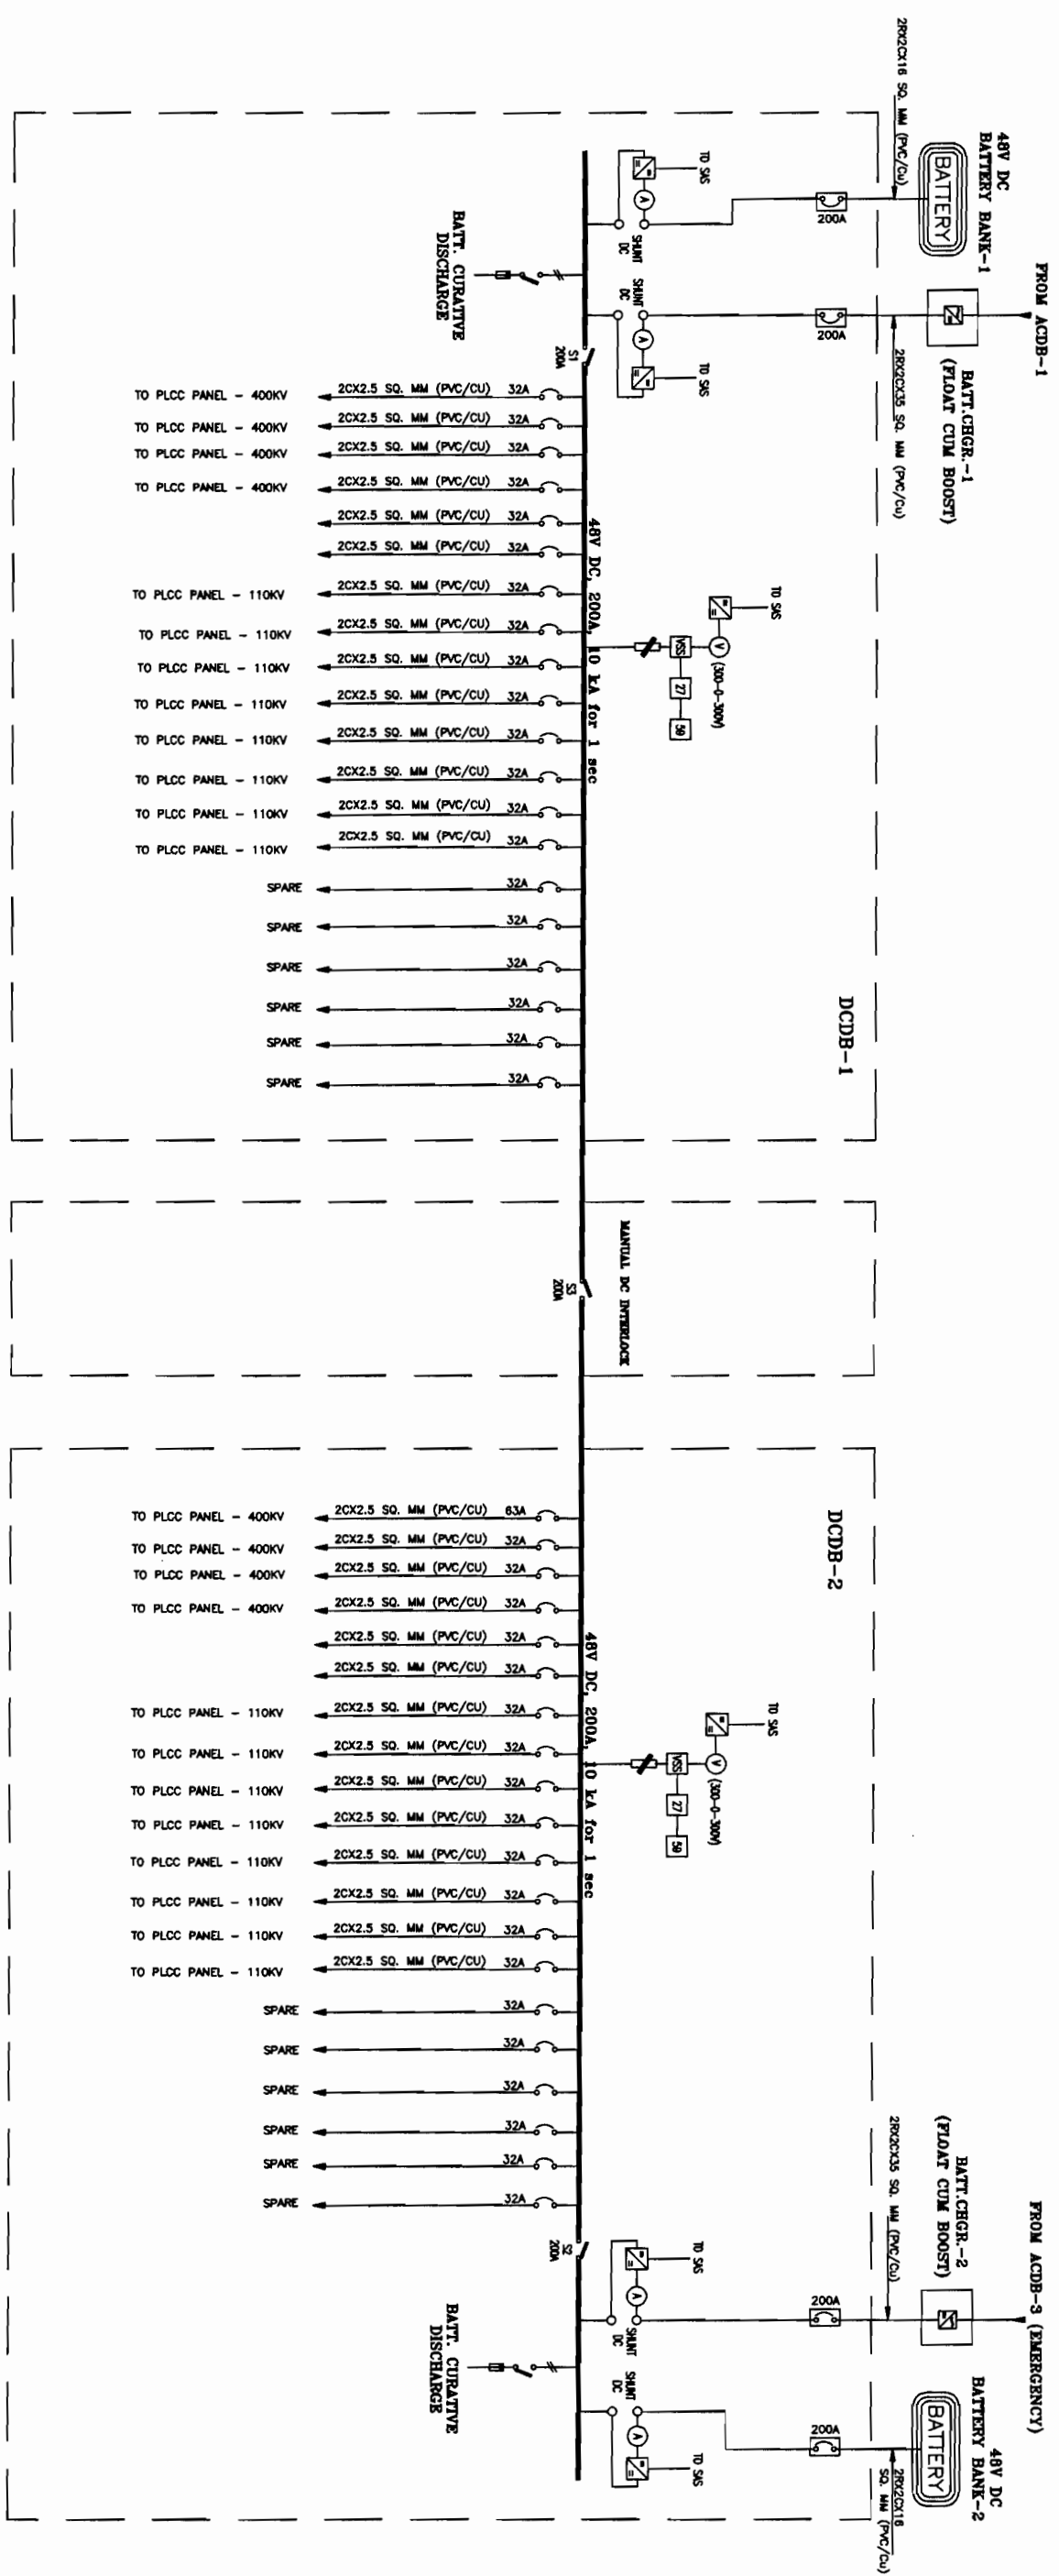

NOTE:-

1. PROVISION FOR MANUAL INTERLOCK BETWEEN THE TWO DCDS CAN BE GIVEN IN ANY ONE OF THE BOARD.
2. 20% SPARE FEEDERS TO BE PROVIDED FOR EACH TYPE AND RATING OF THE FEEDERS.

[illegible]

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED
it must not be used directly or indirectly in anyway detrimental to the interest of the company.

COMPUTER DRG. PATH NAME :
sd/-

REF. DRG. No.

SIGN. & DATE

INVENTORY No.

