

NTPC LIMITED


(3X200 MW+3x500 MW) RAMAGUNDAM STAGE-I & II FGD

TECHNICAL SPECIFICATION

FOR

AGITATORS

SPECIFICATION NO.: PE- TS- 467- 571- 18000- A001

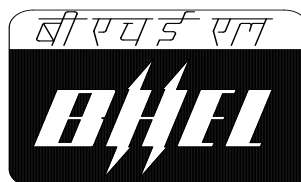

**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT PROJECT
ENGINEERING INSTITUTE BUILDING SECTOR-16A, PLOT
NO. 25, NOIDA, INDIA**



**(3x200+3x500) MW RAMAGUNDAM FGD
AGITATORS
TECHNICAL SPECIFICATION**

SPECIFICATION No: PE-TS-467-571-18000-A001

SECTION

REV. 00

SHEET :

CONTENTS**SECTION - I**

SUB- SECTIONS	TITLE	Page No.
Sub-Section-A	INTENT OF SPECIFICATION	3
Sub-Section-B	PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA	7
Sub-Section-C	TECHNICAL SPECIFICATIONS	
Sub Section-C1	SPECIFIC TECHNICAL REQUIREMENT– MECHANICAL	62
Sub Section-C2	CUSTOMER SPECIFICATION	81
	C2 - A TECHNICAL REQUIREMENT	
	C2 - B PROJECT SPECIFIC GENERAL REQUIREMENTS INCLUDING:	
	GENERAL TECHNICAL REQUIREMENT	
	QUALITY ASSURANCE	
	FUNCTIONAL GUARANTEES	
	C2 - C PAINTING SPECIFICATION	
Sub Section-C3	TECHNICAL SPECIFICATION (ELECTRICAL PORTION)	220
Sub Section-D	ANNEXURE-I LIST OF MAKES OF SUB-VENDOR ITEMS	249
	ANNEXURE-II MANDATORY SPARE LIST	251
	ANNEXURE-III INPUT DRAWINGS (SIZING CALCULATION FOR TANKS)	254
	ANNEXURE-IV MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION	269
	ANNEXURE-V SEA-WORTHY PACKING	272

SECTION - II

SUB SECTIONS	TITLE	Page No.
Annexure-1	LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	327
Annexure-2	COMPLIANCE CUM CONFIRMATION CERTIFICATE	328
Annexure-3	PRE BID CLARIFICATION SCHEDULE	330
Annexure-4	DEVIATION SHEET (COST OF WITHDRAWAL)	331
Annexure-5	ELECTRICAL LOAD DATA	332
Annexure-6	LIST OF MAKES OF SUB VENDOR ITEMS	333
Annexure-7	LIST OF TOOLS & TACKLES	334
Annexure-8	AGITATOR SCHEDULE	335
Annexure-9	LIST OF COMMISSIONING SPARES	338
Annexure-10	SCHEDULE OF GUARANTEES	340
Annexure-11	ATTACHMENT- 3K (OF NTPC)	341

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-A	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 3	

INTENT OF SPECIFICATION

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-A	
		REV. 00	DATE: MAY 2020
		SHEET : 2 OF 3	

1.0

SCOPE OF ENQUIRY/ INTENT OF SPECIFICATION

1.1

The specification covers Supply part, Services part and Mandatory spares comprising of design (i.e. Preparation and submission of drawing /documents including “As Built” drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor’s works, painting, maintenance tools & tackles, fill of lubricants & consumables till handing over, mandatory spares along with spares for erection, start-up and commissioning, forwarding, proper packing, shipment and delivery at site, assembly AND services part covers supervision services for erection & commissioning, trial run at site and carrying out Performance guarantee tests at site, training of customer/ client O&M staff covering all aspects of the Agitator- Operation & Maintenance, Troubleshooting etc., training of customer at manufacturer’s works (3 persons for 2 days including lodging and boarding) & handover in flawless condition of the package to the customer complete with all accessories for the total scope defined as per BHEL NIT & tender technical specification, amendment & agreements till placement of order for Flue Gas Desulphurization (FGD) plant of (3X200 MW RAMAGUNDAM STAGE-I + 3X500 MW RAMAGUNDAM STAGE-II, DISTRICT- PEDDAPALLI, TELANGANA OF M/S NTPC LIMITED.

The following points may be noted.

a.

Agitators are envisaged in various tanks, details of which are given in Technical Information of Agitators.

b.

Bidder shall assume full unit responsibility for the entire equipment assembly and make all possible efforts to comply strictly with the requirements of this specification and other specifications/attachments to inquiry/order.

c.

The Bidder shall offer only proven design which meets the Provenness /Pre-qualification requirement of NTPC. Necessary document evidences as per Attachment-3K for qualification shall be submitted along with the bid. If bidder doesn’t meet the specified Provenness criteria, their offer will be rejected.

1.2

The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve them of the responsibility of providing such facilities to complete the supply, erection and commissioning, performance and guarantee/demonstration testing of **Agitators.**

1.3

It is not the intent to specify herein all the details of design and manufacture. However, the equipment / system shall conform in all respects to high standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance herewith.

1.4

The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-A	
		REV. 00	DATE: MAY 2020
		SHEET : 3 OF 3	

specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing. Similarly, the extent of supply also includes all items required for completion of the system for its safe, efficient, reliable and trouble free operation.

1.5 Items though not specifically mentioned but needed to make the system complete as stipulated under these specifications are also to be furnished unless otherwise specifically excluded.

1.6 The general terms and conditions, instructions to tenderer and other attachment referred to elsewhere are hereby made part of the tender specifications. The equipment / material and works covered by this specification is subject to compliance to all the attachments referred in the specification. The tenderer shall be responsible for adherence to all requirements stipulated herein.

1.7 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders’ responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under Sec.-II of the specification **within 10 days of receipt of tender documents**. In absence of any such clarifications, in case of any contradictory requirement, the more stringent requirement as per interpretation of Purchaser/Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.

1.8 Deviations, if any, should be very clearly brought out clause by clause along with cost of withdrawal in the enclosed schedule (in Section -II); otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification. If no cost of withdrawal is given against the deviation, it will be presumed that deviation can be withdrawn without any cost to BHEL/it’s customer.

1.9 In the event of any conflict between the requirements of two clauses of this specification & requirements of different codes/standards and between respective clauses of sub-section C & sub-section D, more stringent clause as per the interpretation of the owner shall apply.

1.10 In case all above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.

1.11 Unless specified otherwise, all through the specification, the word contractor shall have same meaning as successful bidder/vendor and Customer/Purchaser/Employer will mean BHEL and/or Customer as interpreted by BHEL in the relevant context. Please refer GCC/SCC for better clarity.

1.12 The equipment covered under this specification shall not be dispatched unless the same have been finally inspected, accepted and dispatch release issued by BHEL/Customer.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-A	
		REV. 00	DATE: MAY 2020
		SHEET : 4 OF 3	

1.13

BHEL’s Customer’s representative shall be given full access to the shop in which the equipment’s are being manufactured or tested and all test records shall be made available to him.

1.14

Various codes and standards to be used shall be as indicated in various parts of the specification. In case bidder uses any standard other than those indicated in the specification, the onus of establishing equivalence of the same with the specified standards will rest with the bidder and acceptance of the same shall be sole prerogative of customer. The bidder will also arrange for BHEL a copy of the standards in ENGLISH language. The cost of such service will be deemed to have been included by the bidder in the total cost of the package. BHEL will not entertain any additional cost on account of the same.

1.15

All text/ numeric in the document / drawings to be generated by the successful bidder will be in English language only.

1.16

The bidder’s offer shall not carry any sections like clarification, interpretations and /or assumptions.

Note:

a)

Bidder to note that BHEL reserves the right for drawing/document submission through web based Document Management System. Bidder would be provided access to the DMS for drawing/document approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.

•

Internet explorer version – Minimum Internet Explorer 7.

•

Internet speed – 2 mbps (Minimum preferred).

•

Pop ups from our external DMS IP (124.124.36.198) should not be blocked.

•

Vendor’s internal proxy setting should not block DMS application’s link (<http://dmsserver.Bhelpem.com/Wrench%20Web%20Access/Login.aspx>).

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-B	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA

CS-PEM-MAA					
CLAUSE NO.	PROJECT INFORMATION				
1.00.00	Background Ramagundam stage- I (3x200 MW) steam generators were designed for coals with GCV of 4300 kcal/kg while presently the units are fired with coal having GCV in the range of 3500-3800 kcal/kg.				
1.01.00	Location and Approach NTPC Ramagundam (RSTPS) is a pit-head thermal power station based on the coal supplied from the nearby Singareni Mines of M/s. SCCL and water from Pochampad Dam. The station is located in the Peddapalli district of the Indian state of Telangana. about 60 kms from Karimnagar town and 100 kms from Warangal. Ramagundam Railway station is on the Delhi - Chennai main line. Ramagundam is well connected to Hyderabad by Rajiv Rahadari state highway. The aerial distance from Ramagundam to Hyderabad is 178 km while the road distance between Ramagundam to Hyderabad is 209 km and by train it is 224 Km. Nearest commercial airport is Rajiv Gandhi International Airport, Hyderabad at about 250 km. Vicinity plan of the proposed project is placed at Annexure –I.				
1.02.00	Not Used				
1.03.00	Unit Capacity The units are originally designed for 200 MW which is being uprated for unit TMCR (Turbine through separate R&M package) rating of 210 MW. This applies to all the three units. The BMCR shall remain the same and is considered adequate for the uprated steam turbine.				
1.04.00	Equipment cooling water The cooling water system for equipment/systems is taken from existing equipment cooling water (ECW) sources. Any requirement for equipment cooling shall be from the existing ECW system only. Water for ash disposal requirements, if any, shall also be taken from existing nearby ash water lines.				
1.05.00	Coal Quality Parameters / Fuel Oil Characteristics Coal Quality Parameters / Fuel Oil Characteristics & Plant Water details: (i) The Coal quality parameters and Fuel Oil characteristics are indicated in Table-1 & Table-2 respectively below. (ii) Process water: Process water quality is CW Blowdown based on the COC indicated in Table-4. (iii) Clarified water:				
<table><tr><td>LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</td><td>TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9</td><td>PART-A SUB SECTION-IIA5 PROJECT INFORMATION</td><td>PAGE 1 OF 32</td></tr></table>		LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 1 OF 32
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 1 OF 32		

CS-PEM-MAA					
CLAUSE NO.	PROJECT INFORMATION				
	Clarified water quality is indicated in Table-4. (iv) DM water for Equipment cooling water system. DM water quality is indicated in Table-5.				
1.06.00	Steam Generator and ESP data: refer Table-6.				
1.07.00	Drawings are enclosed as per Table-7 for initial overview to the Bidder.				
2.00.00	NOT USED				
3.00.00	Capacity				
	Stage-I 3 x 200 MW				
	Stage-II 3 x 500 MW				
4.00.00	Metrological Data				
	The metrological data from nearest observatory is placed at Annexure-II .				
5.00.00	Criteria for Earthquake Resistant Design of Structures and Equipment				
	All structures and equipment shall be designed for seismic forces adopting the site specific seismic information provided in this document and using the other provisions in accordance with IS:1893 (Part 1 to Part 4). Pending finalization of Part 5 of IS:1893, provisions of part 1 shall be read along with the relevant clauses of IS:1893:1984, for embankments. A site specific seismic study has been conducted for the project site. The peak ground horizontal acceleration for the project site, the site specific acceleration spectral coefficients (in units of gravity acceleration 'g') in the horizontal direction for the various damping values and the multiplying factor (to be used over the spectral coefficients) for evaluating the design acceleration spectra are as given at Appendix-I. Vertical acceleration spectral values shall be taken as 2/3rd of the corresponding horizontal values. The site specific design acceleration spectra shall be used in place of the response acceleration spectra, given at figure-2 in IS:1893 (Part 1) and Annex B of IS:1893 (Part 4). The site specific acceleration spectra along with multiplying factors specified in Appendix-I includes the effect of the seismic environment of the site, the importance factor related to the structures and the response reduction factor. Hence, the design spectra do not require any further consideration of the zone factor (Z), the importance factor (I) and response reduction factor (R) as used in the IS:1893 (Part 1 to Part 4).				
<table><tr><td>LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</td><td>TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9</td><td>PART-A SUB SECTION-IIA5 PROJECT INFORMATION</td><td>PAGE 2 OF 32</td></tr></table>		LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 2 OF 32
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 2 OF 32		

CLAUSE NO.	PROJECT INFORMATION																						
	Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: <table data-bbox="407 380 1281 611"> <tr> <td>a)</td><td>Steel structures</td><td>:</td><td>2%</td></tr> <tr> <td>b)</td><td></td><td>:</td><td>5%</td></tr> <tr> <td></td><td>Reinforced Concrete structures</td><td></td><td></td></tr> <tr> <td>c)</td><td>Reinforced Concrete Stacks</td><td>:</td><td>3%</td></tr> <tr> <td>d)</td><td>Steel stacks</td><td>:</td><td>2%</td></tr> </table> Method of Analysis Since most structures in a power plant are irregular in shape and have irregular distribution of mass and stiffness, dynamic analysis for obtaining the design seismic forces shall be carried out using the response spectrum method. The number of vibration modes used in the analysis should be such that the sum total of modal masses of all modes considered is at least 90 percent of the total seismic mass and shall also meet requirements of IS:1893 (Part 1). Modal combination of the peak response quantities shall be performed as per Complete Quadratic Combination (CQC) method or by an acceptable alternative as per IS:1893 (Part 1). In general, seismic analysis shall be performed for the three orthogonal (two principal horizontal and one vertical) components of earthquake motion. The seismic response from the three components shall be combined as specified in IS:1893 (Part 1). The spectral acceleration coefficient shall get restricted to the peak spectral value if the fundamental natural period of the structure falls to the left of the peak in the spectral acceleration curve. For buildings, if the design base shear (V_B) obtained from modal combination is less than the base shear ($\bar{V}_B$) computed using the approximate fundamental period (T_a) given in IS:1893:Part 1 and using site specific acceleration spectra with appropriate multiplying factor, the response quantities (e.g. member forces, displacements, storey forces, storey shears and base reactions) shall be enhanced in the ratio of $\bar{V}_B / V_B$. However, no reduction is permitted if $\bar{V}_B$ is less than V_B. Design/Detailing for Ductility for Structures The site specific design acceleration spectra is a reduced spectra and has an in-built allowance for ductility. Structures shall be engineered and detailed in accordance with relevant Indian/International standards to achieve ductility.			a)	Steel structures	:	2%	b)		:	5%		Reinforced Concrete structures			c)	Reinforced Concrete Stacks	:	3%	d)	Steel stacks	:	2%
a)	Steel structures	:	2%																				
b)		:	5%																				
	Reinforced Concrete structures																						
c)	Reinforced Concrete Stacks	:	3%																				
d)	Steel stacks	:	2%																				
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 3 OF 32																				

CLAUSE NO.	PROJECT INFORMATION			
	<u>APPENDIX – I</u> <u>SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT</u> The various site specific seismic parameters for the project site shall be as follows: 1) Peak ground horizontal acceleration (MCE) : 0.28 g 2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra a) for special moment resisting steel frames designed and detailed as per IS:800 : 0.082 b) For special concentrically braced steel frames designed and detailed as per IS:800 : 0.062 c) for special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.049 d) for RCC chimney, RCC Natural Draft Cooling Tower : 0.163 e) For Liquid retaining tanks : 0.098 f) for Steel chimney, Absorber tower, Vessels : 0.123 g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below, in general (excluding special structure/ configuration/materials) : 0.082 3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.163 Note: g = Acceleration due to gravity The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 4 OF 32	

CS-PEM-MAA			
CLAUSE NO.	PROJECT INFORMATION		
	APPENDIX – I SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT The various site specific seismic parameters for the project site shall be as follows: 1) Peak ground horizontal acceleration (MCE) : 0.28 g 2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra a) for special moment resisting steel frames designed and detailed as per IS:800 : 0.082 b) For special concentrically braced steel frames designed and detailed as per IS:800 : 0.062 c) for special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.049 d) for RCC chimney, RCC Natural Draft Cooling Tower : 0.163 e) For Liquid retaining tanks : 0.098 f) for Steel chimney, Absorber tower, Vessels : 0.123 g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below, in general (excluding special structure/ configuration/materials) : 0.082 3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.163 Note: g = Acceleration due to gravity The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 5 OF 32

CLAUSE NO.	PROJECT INFORMATION																																																																																																																																																	
	ANNEXURE-A <u>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</u> <u>(In units of 'g')</u> <table border="1"> <thead> <tr> <th rowspan="2">Time Period (Sec)</th><th colspan="3">Damping Factor (as a percentage of critical damping)</th></tr> <tr> <th>2%</th><th>3%</th><th>5%</th></tr> </thead> <tbody> <tr><td>0</td><td>1.000</td><td>1.000</td><td>1.000</td></tr> <tr><td>0.03</td><td>1.000</td><td>1.842</td><td>1.450</td></tr> <tr><td>0.04</td><td>1.355</td><td>2.032</td><td>1.600</td></tr> <tr><td>0.05</td><td>1.716</td><td>2.223</td><td>1.750</td></tr> <tr><td>0.06</td><td>2.081</td><td>2.413</td><td>1.900</td></tr> <tr><td>0.07</td><td>2.449</td><td>2.604</td><td>2.050</td></tr> <tr><td>0.08</td><td>2.820</td><td>2.794</td><td>2.200</td></tr> <tr><td>0.09</td><td>3.194</td><td>2.985</td><td>2.350</td></tr> <tr><td>0.10</td><td>3.570</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.105</td><td>3.759</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.106</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.11</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.115</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.12</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.125</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.13</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.135</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.14</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.145</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.15</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.20</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.25</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.27</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.30</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.32</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.35</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.372</td><td>3.760</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.40</td><td>3.500</td><td>3.175</td><td>2.500</td></tr> <tr><td>0.402</td><td>3.483</td><td>3.159</td><td>2.488</td></tr> <tr><td>0.405</td><td>3.457</td><td>3.136</td><td>2.469</td></tr> <tr><td>0.41</td><td>3.415</td><td>3.098</td><td>2.439</td></tr> <tr><td>0.425</td><td>3.294</td><td>2.988</td><td>2.353</td></tr> <tr><td>0.45</td><td>3.111</td><td>2.822</td><td>2.222</td></tr> <tr><td>0.50</td><td>2.800</td><td>2.540</td><td>2.000</td></tr> </tbody> </table>			Time Period (Sec)	Damping Factor (as a percentage of critical damping)			2%	3%	5%	0	1.000	1.000	1.000	0.03	1.000	1.842	1.450	0.04	1.355	2.032	1.600	0.05	1.716	2.223	1.750	0.06	2.081	2.413	1.900	0.07	2.449	2.604	2.050	0.08	2.820	2.794	2.200	0.09	3.194	2.985	2.350	0.10	3.570	3.175	2.500	0.105	3.759	3.175	2.500	0.106	3.760	3.175	2.500	0.11	3.760	3.175	2.500	0.115	3.760	3.175	2.500	0.12	3.760	3.175	2.500	0.125	3.760	3.175	2.500	0.13	3.760	3.175	2.500	0.135	3.760	3.175	2.500	0.14	3.760	3.175	2.500	0.145	3.760	3.175	2.500	0.15	3.760	3.175	2.500	0.20	3.760	3.175	2.500	0.25	3.760	3.175	2.500	0.27	3.760	3.175	2.500	0.30	3.760	3.175	2.500	0.32	3.760	3.175	2.500	0.35	3.760	3.175	2.500	0.372	3.760	3.175	2.500	0.40	3.500	3.175	2.500	0.402	3.483	3.159	2.488	0.405	3.457	3.136	2.469	0.41	3.415	3.098	2.439	0.425	3.294	2.988	2.353	0.45	3.111	2.822	2.222	0.50	2.800	2.540	2.000
Time Period (Sec)	Damping Factor (as a percentage of critical damping)																																																																																																																																																	
	2%	3%	5%																																																																																																																																															
0	1.000	1.000	1.000																																																																																																																																															
0.03	1.000	1.842	1.450																																																																																																																																															
0.04	1.355	2.032	1.600																																																																																																																																															
0.05	1.716	2.223	1.750																																																																																																																																															
0.06	2.081	2.413	1.900																																																																																																																																															
0.07	2.449	2.604	2.050																																																																																																																																															
0.08	2.820	2.794	2.200																																																																																																																																															
0.09	3.194	2.985	2.350																																																																																																																																															
0.10	3.570	3.175	2.500																																																																																																																																															
0.105	3.759	3.175	2.500																																																																																																																																															
0.106	3.760	3.175	2.500																																																																																																																																															
0.11	3.760	3.175	2.500																																																																																																																																															
0.115	3.760	3.175	2.500																																																																																																																																															
0.12	3.760	3.175	2.500																																																																																																																																															
0.125	3.760	3.175	2.500																																																																																																																																															
0.13	3.760	3.175	2.500																																																																																																																																															
0.135	3.760	3.175	2.500																																																																																																																																															
0.14	3.760	3.175	2.500																																																																																																																																															
0.145	3.760	3.175	2.500																																																																																																																																															
0.15	3.760	3.175	2.500																																																																																																																																															
0.20	3.760	3.175	2.500																																																																																																																																															
0.25	3.760	3.175	2.500																																																																																																																																															
0.27	3.760	3.175	2.500																																																																																																																																															
0.30	3.760	3.175	2.500																																																																																																																																															
0.32	3.760	3.175	2.500																																																																																																																																															
0.35	3.760	3.175	2.500																																																																																																																																															
0.372	3.760	3.175	2.500																																																																																																																																															
0.40	3.500	3.175	2.500																																																																																																																																															
0.402	3.483	3.159	2.488																																																																																																																																															
0.405	3.457	3.136	2.469																																																																																																																																															
0.41	3.415	3.098	2.439																																																																																																																																															
0.425	3.294	2.988	2.353																																																																																																																																															
0.45	3.111	2.822	2.222																																																																																																																																															
0.50	2.800	2.540	2.000																																																																																																																																															
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION																																																																																																																																															
			PAGE 6 OF 32																																																																																																																																															

ES-PEM-MAA	PROJECT INFORMATION			
CLAUSE NO.				
	ANNEXURE-A			
	<u>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</u> <u>(In units of 'g')</u>			
	Time Period (Sec)	Damping Factor (as a percentage of critical damping)		
		2%	3%	5%
	0.55	2.545	2.309	1.818
	0.60	2.333	2.117	1.667
	0.65	2.154	1.954	1.538
	0.70	2.000	1.814	1.429
	0.75	1.867	1.693	1.333
	0.80	1.750	1.588	1.250
	0.85	1.647	1.494	1.176
	0.9	1.556	1.411	1.111
	0.95	1.474	1.337	1.053
	1.0	1.400	1.270	1.000
	1.05	1.333	1.210	0.952
	1.10	1.273	1.155	0.909
	1.15	1.217	1.104	0.870
	1.20	1.167	1.058	0.833
	1.25	1.120	1.016	0.800
	1.30	1.077	0.977	0.769
	1.35	1.037	0.941	0.741
	1.40	1.000	0.907	0.714
	1.45	0.966	0.876	0.690
	1.50	0.933	0.847	0.667
	1.55	0.903	0.819	0.645
	1.60	0.875	0.794	0.625
	1.65	0.848	0.770	0.606
	1.70	0.824	0.747	0.588
	1.75	0.800	0.726	0.571
	1.80	0.778	0.706	0.556
	1.85	0.757	0.686	0.541
	1.90	0.737	0.668	0.526
	1.95	0.718	0.651	0.513
2.0	0.700	0.635	0.500	
2.05	0.683	0.620	0.488	
2.10	0.667	0.605	0.476	
2.15	0.651	0.591	0.465	
2.20	0.636	0.577	0.455	
2.25	0.622	0.564	0.444	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 7 OF 32

ES-PEM-MAA	PROJECT INFORMATION			
CLAUSE NO.				
	ANNEXURE-A			
	<u>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</u> <u>(In units of 'g')</u>			
	Time Period (Sec)	Damping Factor (as a percentage of critical damping)		
		2%	3%	5%
	2.30	0.609	0.552	0.435
	2.35	0.596	0.540	0.426
	2.40	0.583	0.529	0.417
	2.45	0.571	0.518	0.408
	2.50	0.560	0.508	0.400
	2.55	0.549	0.498	0.392
	2.60	0.538	0.488	0.385
	2.65	0.528	0.479	0.377
	2.70	0.519	0.470	0.370
	2.74	0.511	0.464	0.365
	2.80	0.500	0.454	0.357
	2.85	0.491	0.446	0.351
	2.88	0.486	0.441	0.347
	2.90	0.483	0.438	0.345
	2.95	0.475	0.431	0.339
	3.0	0.467	0.423	0.333
	3.05	0.459	0.416	0.328
	3.10	0.452	0.410	0.323
	3.15	0.444	0.403	0.317
	3.20	0.438	0.397	0.313
	3.25	0.431	0.391	0.308
	3.30	0.424	0.385	0.303
	3.35	0.418	0.379	0.299
	3.40	0.412	0.374	0.294
	3.45	0.406	0.368	0.290
	3.50	0.400	0.363	0.286
	LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 8 OF 32

CS-PEM-MAA													
CLAUSE NO.	PROJECT INFORMATION												
6.00.00	CRITERIA FOR WIND RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT All structures shall be designed for wind forces in accordance with IS: 875 (Part-3) and as specified in this document. See Annexure – B for site specific information. Along wind forces shall generally be computed by the Peak (i.e. 3 second gust) Wind Speed method as defined in the standard. Along wind forces on slender and wind sensitive structures and structural elements shall also be computed, for dynamic effects, using the Gust Factor or Gust Effectiveness Factor Method as defined in the standard. The structures shall be designed for the higher of the forces obtained from Gust Factor method and the Peak Wind Speed method. Analysis for dynamic effects of wind must be undertaken for any structure which has a height to minimum lateral dimension ratio greater than “5” and/or if the fundamental frequency of the structure is less than 1 Hz. Susceptibility of structures to across-wind forces, galloping, flutter, ovalling etc. should be examined and designed/detailed accordingly following the recommendations of IS:875(Part-3) and other relevant Indian standards. It should be estimated if size and relative position of other structures are likely to enhance the wind loading on the structure under consideration. Enhancement factor, if necessary, shall suitably be estimated and applied to the wind loading to account for the interference effects. Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: <table><tr><td>a) Welded steel structures</td><td>:</td><td>1.0%</td></tr><tr><td>b) Bolted steel structures/RCC structures</td><td>:</td><td>2.0%</td></tr><tr><td>c) Prestressed concrete structures</td><td>:</td><td>1.6%</td></tr><tr><td>d) Steel stacks</td><td>:</td><td>As per IS:6533 & CICIND Model Code whichever is more critical.</td></tr></table>	a) Welded steel structures	:	1.0%	b) Bolted steel structures/RCC structures	:	2.0%	c) Prestressed concrete structures	:	1.6%	d) Steel stacks	:	As per IS:6533 & CICIND Model Code whichever is more critical.
a) Welded steel structures	:	1.0%											
b) Bolted steel structures/RCC structures	:	2.0%											
c) Prestressed concrete structures	:	1.6%											
d) Steel stacks	:	As per IS:6533 & CICIND Model Code whichever is more critical.											
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 9 OF 32										

CLAUSE NO.	PROJECT INFORMATION
	ANNEXURE-B SITE SPECIFIC DESIGN PARAMETERS The various design parameters, as defined in IS: 875 (Part-3), to be adopted for the project site shall be as follows: a) The basic wind speed “V_b” at ten metres above the mean ground level : 44 meters/second b) The risk coefficient “K_1” : 1.07 c) Category of terrain : Category-2 7.00.00 FOUNDATION SYSTEM AND GEOTECHNICAL DATA 7.00.01 Geotechnical data and foundation system for the respective project are enclosed at annexure-III. The corresponding bore logs are enclosed at annexure-IV. 7.00.02 The available soil data is of vicinity of proposed structures, therefore, bidder shall carryout his own detailed soil investigation for facilities under this package and shall be as per the scheme approved by owner. The scheme for geotechnical investigation shall be as given at Clause 7.07.00 and shall be approved by owner before execution. Geotechnical investigation work shall got executed by the Contractor through the agencies as mentioned in Clause No. 7.07.03. However, no time extension shall be given on account of soil investigation carried out by the Bidder. The geotechnical investigation report shall be prepared with detailed recommendations regarding type of foundation and allowable bearing pressure for various structures/ facilities and other soil parameters. The report shall be submitted for Owner’s approval prior to commencement of design of foundation. 7.00.03 The furnished borelog details are specific to the co-ordinates where the boreholes have been carried out and are provided for bidder’s information only. Soil profile in the proposed area may vary with respect to the borelogs enclosed for bidder’s information. Bidder has to consider all such variations in his estimation, over the extent of the work to be carried out. The Bidder should note that nothing extra whatsoever on account of variation between soil data collected by Owner and that found by the Bidder during geotechnical investigation by him or during execution of works, shall be Payable 7.00.04 Tank Foundations a) The tanks shall rest on flexible tank pad foundation, resting on sand with concrete ring wall to retain sand. Base of the concrete ring wall shall not rest on the expansive soil, if any. b) Entire loose/ soft soil inside the concrete ring wall shall be removed and shall be filled with sand. Sand for filling shall be clean and well graded conforming to IS 383 with grading Zone I to III.
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9 PART-A SUB SECTION-IIA5 PROJECT INFORMATION PAGE 10 OF 32

CS-PEM-MAA			
CLAUSE NO.	PROJECT INFORMATION		
	c) Sand shall be spread in layers not exceeding 30cm compacted thickness over the area. Each layer shall be uniformly compacted by mechanical means like plate vibrators, small vibratory rollers, etc to achieve a relative density of not less than 80%. d) Other requirements of tank foundations shall be as per IS 803 and as specified elsewhere in the specifications.		
7.02.00	Foundation System The requirements for the foundation system to be adopted are as given in subsequent clauses. Depending upon the depth of competent strata/stratum, type of structures, functional requirement of facility, extent of cutting / filling, suitable foundation, open or pile shall be adopted with approval of owner.		
7.02.01	General Requirements a) All structures/equipment shall be supported either on suitable open foundations (isolated, combined, raft) or pile foundations depending on type of structures/facilities, sub-strata, topography etc. b) The roads, ground floor slabs, trenches, pipe pedestals, channels/drain and staircase foundation with foundation loading intensity less than 4 T / M2 may be supported on open / shallow foundations resting on virgin / controlled compacted filled up soil. c) No other foundation (other than as mentioned in (b) above) shall rest on the filled up ground / soil. d) No foundation shall rest on the black cotton soil. e) Before execution of work the bidder shall ensure that there is no obstruction to underground/overground facilities like sewer lines, pipe lines etc. Any such damage and remedial/ rectification measures shall be at the contractors cost. f) Bidder shall also ensure that there is no damage to existing nearby foundations and the foundations pertaining to this package are not placed at shallower depth than the nearby foundations. If required depth of foundation is deeper than the existing foundations, proper protection shall be provided to existing foundations. g) All foundations shall be designed in accordance with relevant parts of the latest revisions of Indian Standards. h) The water table for design purpose shall be considered at Finished Ground Level. i) A combination of open and pile foundations shall not be permitted under the same equipment / structure / building. j) Foundation for equipments on ground floor For equipments of static weight upto 1.5 T, the equipment may be supported on the ground floor slab by locally thickening the slab. Thickening of the ground floor slab shall be done upto an extent of about 0.6 m beyond the plan area of the equipment on all the sides. Further, the load intensity below the equipment shall be limited to 4T/m2. Other requirements of floor slab and compaction below the floor slab shall be adhered, as specified elsewhere in the specifications.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 11 OF 32

CLAUSE NO.	PROJECT INFORMATION			
7.02.02	For equipment's of static weight between 1.5 T and 20 T, the equipment may be supported on compacted sand filling with the load intensity below the equipment limited to 4T/m². The minimum depth of foundation is 1.0m below FFL. Other requirements of sand compaction below the foundation shall be adhered, as specified elsewhere in the specifications. For equipment of static weight more than 20 T, the equipment foundation shall be taken to the founding level or shall be built up with PCC from the level as mentioned in the Table 2. The pedestal of equipment foundation or the foundation Block shall be isolated from the adjoining floor slab by providing bitumen impregnated fiber board of minimum 50 mm thick, conforming to IS: 1838 all around the equipment pedestal for the full depth of the floor slab.			
	Open Foundations In case open foundations are adopted, following shall be adhered to. - The minimum width of foundation shall be 1.0 m. - Minimum depth of foundation shall be 1.0m below Ground Level. - It shall be ensured that all foundations of a particular structure/ buildings/ facility shall rest on one bearing stratum. - Wherever the intended bearing sub-strata is virgin soil stratum but the actual stratum encountered during foundation excavation consists of filled up soil at founding level, under such cases either the foundation shall be lowered completely into the virgin stratum or the filled up soil upto the virgin layers shall be removed and built up through PCC (1:4:8) up to designed foundation level.			
7.02.03	Pile Foundations – In case piles are adopted, following shall be adhered to : - The pile foundation shall be of RCC, Cast-in-situ bored piles as per IS:2911. Pile boring shall be done using Rotary Hydraulic Rigs. However, conventional tripod rig may be allowed in inaccessible areas subject to site specific conditions. Two stage flushing of pile bore shall be ensured by airlift technique duly approved by the Employer. If required, temporary or permanent MS liner may be provided for piling. - The minimum diameter of pile shall be 600 mm. The allowable load capacity of the pile in different modes (vertical compression, lateral and pullout) shall be as per approved geotechnical report & as enclosed in relevant annexure: - Only straight shaft piles shall be used. Minimum cast length of pile above cutoff level shall be 1.0 m. - The contractor shall furnish design of piles (in terms of rated capacity, length, diameter, termination criteria to locate the founding level for construction of pile in terms of measurable parameter, reinforcement for job as well as test piles, pile load test arrangement, locations of initial test piles etc.) for Engineer's approval.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 12 OF 32

PS-PEM-MAA			
CLAUSE NO.	PROJECT INFORMATION		
	v) The piling work shall be carried out in accordance with IS:2911 (Relevant part) and accepted construction methodology. The construction methodology shall be submitted by the Contractor for Engineer's approval. vi) Number of initial load tests to be performed for each diameter and rated capacity of pile shall be subject to minimum as under. Vertical Lateral Minimum of 2 Nos. in each mode. Uplift vii) The initial pile load test shall be conducted with test load upto three times the pile capacity. In case of vertical compression test (initial test) the method of loading shall be cyclic as per IS:2911 (relevant part). viii) Load test shall be conducted at pile Cut-off Level (COL). If the water table is above the COL the test pit shall be kept dry throughout the test period by suitable de-watering methods. Alternatively the vertical load test may be conducted at a level higher than COL. In such a case, an annular space shall be created to remove the effect of skin friction above COL by providing an outer casing of suitable diameter larger than the pile diameter. ix) Number of routine pile load tests to be performed for each diameter/allowable capacity of pile shall be as under : i) Vertical : 0.5% of the total number of piles provided. ii) Lateral : 0.5% of the total number of piles provided. x) The routine tests on piles shall be conducted upto test load of one and half times the allowable pile capacity. Piles for routine load tests shall be approved by the Employer. xi) In case, routine pile load test shows that the pile has not achieved the desired capacity or pile(s) have been rejected due to any other reason, then the Contractor shall install additional pile(s) as required and the pile cap design shall accordingly be reviewed and modified, if required. xii) Testing of piles and interpretation of pile load test results shall be carried out as per IS:2911 (Part-4). Contractor shall ensure that all the measuring equipment and instruments are properly calibrated at a reputed laboratory / institute prior to their use. Settlement / movement of the pile top shall be made by Linear Variable Differential Transducers (LVDT) having a least count of 0.01mm. xiii) The test load on initial test piles shall be applied by means of reaction from anchor piles / rock anchors alone or combination of anchor piles / rock anchors and kentledge with concrete blocks.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 13 OF 32

CS-PEM-MAA			
CLAUSE NO.	PROJECT INFORMATION		
	xiv) Low Strain Pile Integrity test shall be conducted on all test piles and job piles. This test shall be used to identify the routine load test and not intended to replace the use of static load test. This test is limited to assess the imperfection of the pile shaft and shall be undertaken by an independent specialist agency to be approved by Engineering department of Owner. The test equipment shall be of TNO or PDI make or equivalent. The process shall confirm to ASTM. xv) High Strain Dynamic Load Test may be carried out for routine load testing of working piles. However, at least two numbers of static routine vertical load tests shall be carried out on pile on which high strain dynamic load test has already been carried out for establishing the correlation between the two tests. In case of discrepancy if any between dynamic and static vertical load tests, then additional static routine vertical load tests shall be conducted as decided by the Engineer and the results of static routine vertical load shall prevail. Number of routine vertical pile load tests as per clause 7.02.03 (ix) shall be total of static routine vertical load test and high strain dynamic load tests. The procedure to carry out the test shall be submitted to the Engineer. The test and equipment shall conform to ASTM D4945-00. The test shall be conducted by an experienced independent test agency approved by the owner. Field data shall be submitted to the site engineer and shall include force velocity curves, pile capacity, simulated static load test curve, net and total pile displacement, pile integrity. A (Case pile wave analysis) CAPWAP or equivalent software analysis shall be conducted on the field data for correct capacity estimation and to evaluate end bearing and skin friction components of the pile. xvi) From load considerations, single pile may be used under a column/tower. In that case, pile shall be connected with tie beams at pile cut off level in both directions. xvii) Contribution of frictional resistance of filled up soil if any, shall not be considered for computation of frictional resistance of piles. xviii) Reinforcement for job piles shall be designed as following: (a) Compression + bending piles: For these piles, the allowable safe pile capacities in compression and bending shall be considered. (b) Tension + bending piles: For these piles, the actual pile forces to be considered. However, maximum 3 types of combinations for varying percentage of tension capacity + bending case may be designed & adopted by contractor for the entire scope of work under this package.		
7.03.00	Special Requirements		
7.03.01	Details of treatment for foundations / underground structures required to counteract soil / water chemical environment shall be as per detailed geotechnical investigation to be carried		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 14 OF 32

CS-PEM-MAA			
CLAUSE NO.	PROJECT INFORMATION		
	out by contractor. Contractor shall carry out chemical analysis during detailed geotechnical investigation and required treatment shall be provided accordingly.		
7.04.00	Excavation, Filling and Dewatering		
7.04.01	For excavation works, comprehensive dewatering with well point or deep wells arrangement, if required, shall be adopted. Scheme for dewatering and design with all computations and back up data for dewatering shall be submitted for the owner's information. The water table shall be maintained at 0.5m below the founding depth.		
7.04.02	Excavation for shallow foundations shall be covered with PCC immediately after reaching the founding level. In case of any local loosening of soil or any loose pockets are encountered at founding level during excavation the same shall be removed and compensated by PCC M7.5. The final layer of about 300 mm thickness above the founding level shall be excavated by suitable means, so as to avoid disturbance to founding stratum.		
7.04.03	Backfilling around foundations, pipes, trenches, sumps, pits, plinths, etc. shall be carried out with approved material in layers not exceeding 300 mm compacted thickness (higher thickness of layers upto 500mm with heavy mechanical compacting equipment) and each layer shall be compacted to 90% of standard proctor density for cohesive soils and to 80% of relative density for non-cohesive soils		
	Rock pieces having size less than 150 mm and interstices filled with soil may be used for backfilling around foundation, plinths etc. and shall be compacted to minimum of 85% of original stack of material after filling the interstices.		
7.04.04	Founding level for trenches/channels shall be decided as per functional requirement. The bottom of excavation shall be properly compacted prior to casting of bottom slab of trenches / channels.		
7.04.05	CBR tests for pavement/road design shall be carried out by the Contractor after earth filling (if applicable) has been completed upto the formation level.		
7.04.06	The contractor shall take all necessary measures during excavation to prevent the hazards of falling or sliding of material or article from any bank or side of such excavation which is more than one and a half meter above the footing by providing adequate piling, shoring, bracing etc. against such bank or sides. Adequate and suitable warning signs shall be put up at conspicuous places at the excavation work to prevent any persons or vehicles falling into the excavation trench. No worker should be allowed to work where he may be stuck or endangered by excavation machinery or collapse of excavations or trenches.		
7.05.00	EXCAVATION IN ROCK		
	Excavation in rock shall be carried out by mechanical means and if blasting is required for founding of some of the structures under this package, control blasting only shall be carried out.		
7.05.01	Controlled blasting shall be done by a specialised agency duly approved by Engineer. All controlled blasting shall be done by using time delay detonators (i.e. excel type).		
7.05.02	a) Contractor shall engage an agency expert in blasting such as, NIRM (National Institute of Rock Mechanics), CMPDIL, Central Institute of Mining and Fuel Research Dhanbad, Dept. of Mining of Govt. Institutions etc. to design detailed blasting scheme and get the same approved from Engineer before carrying out the blasting operation. All blasting shall be done as per the approved blasting scheme &		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 15 OF 32

CLAUSE NO.	PROJECT INFORMATION
	initial blasting operations shall be done under the supervision & guidance of the representative of the blasting expert. b) All the statutory laws, (Explosives Act etc.) rules, regulations, Indian Standards, etc. pertaining to the acquisition, transport, storage, handling and use of explosives, etc. shall be strictly followed. c) The Contractor shall obtain Licenses from Competent Authorities for undertaking blasting work as well as for procuring, transporting to site and storing the explosives as per explosives act. The Contractor shall be responsible for the safe transport, use, custody and proper accounting of the explosive Materials. d) The Contractor shall be responsible and liable for any accident and injury / damage which may occur to any person or property of the project or public on account of any operations connected with the storage, transportation, handling or use of explosive and blasting operations.
7.06.00	Sheeting & Shoring The contractor shall ascertain for himself the nature of materials to be excavated and difficulties, if any, likely to be encountered in excavation while executing the work. Sheet piling, sheeting and shoring, bracing and maintaining suitable slopes, drainage, etc. shall be provided and installed by the Contractor, to the satisfaction of the Engineer.
7.07.00	Geotechnical Investigation The Contractor shall carry out detailed geotechnical investigation in the areas under his scope for establishing the sub-surface conditions and to decide type of foundations for the structures envisaged, construction methods, any special requirements/treatment called for remedial measures for sub-soil/ foundations etc. in view of soft sub-soils, aggressive sub-soils and water, expansive/swelling soils etc. prior to commencement of detailed design/drawings. The Contractor shall obtain the approval for the field testing scheme proposed by him from the Owner before undertaking the geotechnical investigation work.
7.07.01.00	Scheme of geotechnical Investigation
7.07.02.01	Field test shall include but not be limited to the following: Boreholes, Standard Penetration Test (SPT), Dynamic Cone Penetration Test (DCPT), collection of disturbed samples (DS) and undisturbed soil samples (UDS), Trial Pits (TP), Plate Load Tests (PLT), Electrical Resistivity Test (ERT), In situ field permeability tests, collection of water samples, etc.
7.07.02.02	The diameter of borehole shall be minimum 150 mm in soil and 76 mm in rock. The diameter of UDS sampler shall be 100 mm minimum. Core drilling in rock shall be done by using hydraulically feed rotary drill & double tube core barrel with diamond bit.
7.07.02.03	The minimum tests are indicated in Clause No. 7.08.00. Adequate number of tests shall be conducted up to sufficient depth for complete determination of subsoil conditions. The depth of boreholes shall be as specified in Appendix A. SPT shall be carried out in all types of soil deposits and in all rock formations with core recovery up to 20%, met within a borehole. This test shall be conducted at every 3.0 m interval or at change of strata, up to the final depth. SPT 'N' of 100 and above shall be referred as refusal. UDS shall be collected at every 3.0 m interval or at change of strata up to depth of borehole. UDS may be replaced by additional SPT, if SPT'N' value in the strata is above 50.
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9 PART-A SUB SECTION-IIA5 PROJECT INFORMATION PAGE 16 OF 32

PS-PEM-MAA											
CLAUSE NO.	PROJECT INFORMATION										
7.07.02.04	Laboratory tests shall be done as per relevant IS codes. The laboratory tests, not be limited to the following shall be conducted on disturbed and undisturbed soil samples, rock samples & water samples collected during field investigations in sufficient numbers. Laboratory Tests on Soil Samples Laboratory tests shall be carried out on disturbed and undisturbed soil samples for Grain Size Analysis, Hydrometer Analysis, Atterberg Limits, Triaxial Shear Tests (UU), Natural Moisture Content, Specific Gravity and Bulk Unit Weight, Consolidation Tests, Unconfined Compression Test, Free swell Index, Shrinkage Limit, Swell Pressure Test, Chemical Analysis test on soil and water samples to determine the carbonates, sulphates, chlorides, nitrates, pH, organic matter and any other chemicals harmful to concrete and reinforcement/ steel. Laboratory Tests on Rock Samples Moisture content, porosity & density, Specific Gravity, Hardness, Soundness, Slake durability index, Unconfined compression test (Both at saturated and in-situ water content), Point load strength index and deformability test (Both at saturated and in-situ water content) shall be carried out on rock samples.										
7.07.02.05	Geotechnical investigation (field & laboratory) shall be carried out in accordance with the provisions of relevant Indian Standards. On completion of all field & laboratory work, geotechnical investigation report shall be submitted for Owner's review/approval. The Geotechnical investigation report shall contain geological information of the region, procedure adopted for investigation, field & laboratory observations/ data/ records, analysis of results & recommendations on type of foundation for different type of structures envisaged for all areas of work with supporting calculations. Recommendations on treatment for soil, foundation, based on subsoil characteristics, soft soils, aggressive chemicals, expansive soils, etc. Recommendations on foundation system and the net allowable bearing pressures and pile capacity shall be based on the conservative values of geotechnical investigation data.										
7.07.03.00	Geotechnical investigation work shall be got executed by the Contractor through the following agencies. 1. C.E.TESTING COMPANY Pvt. Ltd, Kolkata 2. Cengrs Geotechnica Pvt. Ltd, New Delhi 3. KCT Consultancy Services, Ahemdabad 4. M.K. Soil Testing Laboratory, Ahemdabad										
7.08.00	Geotechnical Investigation Scheme a) Boreholes (Minimum) <table><tr><th>S.No</th><th>Structure</th><th>Spacing/Number of borehole</th><th>Depth of borehole</th><th>Remarks</th></tr><tr><td>1</td><td>FGD</td><td>Minimum 14 Nos.</td><td>Depth of boreholes shall be 25m to 35m.</td><td>Depth of boreholes</td></tr></table>	S.No	Structure	Spacing/Number of borehole	Depth of borehole	Remarks	1	FGD	Minimum 14 Nos.	Depth of boreholes shall be 25m to 35m.	Depth of boreholes
S.No	Structure	Spacing/Number of borehole	Depth of borehole	Remarks							
1	FGD	Minimum 14 Nos.	Depth of boreholes shall be 25m to 35m.	Depth of boreholes							
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9 PART-A SUB SECTION-IIA5 PROJECT INFORMATION PAGE 17 OF 32											

ES-PEM-MAA	CLAUSE NO.	PROJECT INFORMATION			
	2	Crusher House	Minimum 2 Nos.	Depth of boreholes shall be 25m to 35m.	shall be as mentioned in column "Depth of Borehole" or 5m continuous in rock with RQD > 25% whichever is earlier.
	3	Gypsum and Lime storage area	Minimum 10 Nos.	Depth of boreholes shall be 15m to 25m	
	4	Other Structure/Facility	Minimum 2 Nos. boreholes under each area / facility	15 to 20 m	
	5	Chimney	Minimum 2 Nos.	30 to 35m	
	b) Other Field Tests (Minimum)				
	1	Cyclic Plate Load Test (CPLT)	3 nos	Test Depth from 2 to 4 m	
	2	TRIAL PIT (TP)	5 Nos.	Depth - 3 m	
	3	IN SITU PERMEABILITY TEST IN BOREHOLES	In minimum 3 Nos. of boreholes	Tests shall be conducted at depths of 1.0m, 3.0m, 5.0m, 8.0m and 12.0m.	
	4	ERT	Minimum 10 Nos.		
	• Depth and location of Boreholes and other field tests (PLT, ERT, field permeability tests etc.) shall be approved by Owner before execution of geotechnical investigation work. • Investigation in any other building / structure / facilities / trestles which are not mentioned above shall also be carried out, if required, by the bidder for the facilities under his scope.				
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9		PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 18 OF 32

[illegible]

28 of 354

CLAUSE NO.	PROJECT INFORMATION																												
	ANNEXURE-III SOIL DATA AND FOUNDATION SYSTEM (Ramagundam-I&II) Employer has carried out geotechnical investigation in vicinity to the proposed area. Logs of available boreholes solely for bidder's information in the vicinity of proposed area are enclosed with this Annexure. The bidder is required to carry out geotechnical investigation as per Clause No 7.07.00 & 7.08.00 and ascertain the bearing capacity. The onus of correct assessment / interpretation and understanding of the existing subsoil condition / data is on the Bidder. The existing ground level is varying as per enclosed contour/spot level drawing. a) The foundation system to be adopted for different structures shall be as given in Table – 1 below <table><tr><th colspan="2">Table – 1: Net Allowable Bearing Pressure</th></tr><tr><th>STRUCTURE</th><th>TYPE OF FOUNDATION TO BE ADOPTED</th></tr><tr><td>FGD and related structures</td><td>Open</td></tr></table> b) Bidder is required to carry out geotechnical investigation in this area. During detailed engineering, the Allowable Bearing Pressure shall be adopted after approval of geotechnical investigation report. However, the maximum allowable bearing pressure shall be lower of the two values i.e. as per approved geotechnical report and as per the values furnished in Table-2. <table><tr><th colspan="4">Table – 2: Net Allowable Bearing Pressure</th></tr><tr><th rowspan="3">Founding Depth/ Stratum</th><th colspan="3">Net Allowable Bearing PressureT/m2</th></tr><tr><td>Isolated and combined footings including raft for 25mm permissible settlement in case of soil and 12mm in case of rocky strata</td><td>Isolated and combined footings for 40mm permissible settlement in case of soil and 12mm in case of rocky strata</td><td>Rafts (width > 6m) for 75mm permissible settlement in case of soil and 12mm in case of rocky strata</td></tr><tr><td colspan="3">Width upto 6.0m</td></tr><tr><td colspan="4">In case of Soil</td></tr><tr><td>2.0m below NGL</td><td>8</td><td>10</td><td>12</td></tr></table>	Table – 1: Net Allowable Bearing Pressure		STRUCTURE	TYPE OF FOUNDATION TO BE ADOPTED	FGD and related structures	Open	Table – 2: Net Allowable Bearing Pressure				Founding Depth/ Stratum	Net Allowable Bearing PressureT/m2			Isolated and combined footings including raft for 25mm permissible settlement in case of soil and 12mm in case of rocky strata	Isolated and combined footings for 40mm permissible settlement in case of soil and 12mm in case of rocky strata	Rafts (width > 6m) for 75mm permissible settlement in case of soil and 12mm in case of rocky strata	Width upto 6.0m			In case of Soil				2.0m below NGL	8	10	12
Table – 1: Net Allowable Bearing Pressure																													
STRUCTURE	TYPE OF FOUNDATION TO BE ADOPTED																												
FGD and related structures	Open																												
Table – 2: Net Allowable Bearing Pressure																													
Founding Depth/ Stratum	Net Allowable Bearing PressureT/m2																												
	Isolated and combined footings including raft for 25mm permissible settlement in case of soil and 12mm in case of rocky strata	Isolated and combined footings for 40mm permissible settlement in case of soil and 12mm in case of rocky strata	Rafts (width > 6m) for 75mm permissible settlement in case of soil and 12mm in case of rocky strata																										
	Width upto 6.0m																												
In case of Soil																													
2.0m below NGL	8	10	12																										
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 22 OF 32																										

ES-PEM-MAA	PROJECT INFORMATION			
CLAUSE NO.				
	3.0m below NGL	10	12	15
	4.0m below NGL	14	16	18
	In case of rocky strata			
	1.0m Embedment in SDR (soft disintegrated rock)	30	30	30
	0.6m Embedment in fractured sandstone rock.	40	40	40
	1.0m Embedment in fractured sandstone rock.	45	45	45
	- For NGL, topographical survey drawing along with borehole details carried out by bidder shall be referred.			
	The net allowable bearing pressure higher than above mentioned values shall not be permitted. At intermediate levels the bearing capacity shall be same as the net allowable bearing pressure corresponding to the immediate shallower level mentioned above.			
	c) Permissible Settlement of Foundations:			
	For open foundations, the total permissible settlement and differential settlement shall be governed by IS: 1904 and from functional requirements whichever is more stringent. However, total settlement shall be restricted to the following:			
	Isolated, Strip & Raft (machine foundation)		25 mm	
	Isolated & Strip (Other than machine foundation)		40 mm	
	Raft (widths greater than 6 m) (Other than machine foundation)		75 mm	
	Foundations in rock		12 mm	
	In case the total permissible settlement is to be restricted to less than as above specified from functional requirements, then the net allowable bearing pressure shall be reduced after review in consultation with Engineer.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 23 OF 32	

CLAUSE NO.	PROJECT INFORMATION		
	ANNEXURE-IV (BORE LOG DATA REFERE ANNEXURE)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 24 OF 32

CLAUSES 3.1 AND 3.4

AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM

LOCATION STAGE IV MAIN PLANT AREA

BEARING OF HOLE

COLLAR ELEVATION : 30 cms

STARTED:19-07-2011

BORE HOLE NO. : 111

CO - ORDINATES : 18A+39,11B+66

ANGLE WITH HORIZONTAL NIL

GROUND ELEVATION : 151.514 mtr

COMPLETED : 31-07-2011

SHEET NO. : 01

FEATURE: Plain area

TOTAL DEPTH : 20.00 mtr

TYPE(S) OF CORE BARREL: NX

DRILLING AGENCY M/S GEO TECHNICAL SERVICES

[illegible]

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BEARING OF HOLE
 COLLAR ELEVATION : 30 cms
 STARTED : 19-07-2011

BORE HOLE NO. : 111
 CO - ORDINATES : 18A+39,11B+66
 ANGLE WITH HORIZONTAL : NIL
 GROUND ELEVATION : 151.514 mtr
 COMPLETED : 21-07-2011

SHEET NO. : 02
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE	CASING	WATER LEVEL	WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS		
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100	Diamond Core Bit			NX	3.00 mtr	5.00 mtr	PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON	MM/MIN			
10.00	11.00	Fractured ferrogenous sand stone rock	>>>>			60 60	130 120 80						45%				25%	over 15											
11.00	12.00		>>>>			50	90 100 120	160					52%				38%	15 to 8											
12.00	13.00		>>>>		20	70 30 30 60 40	150 100						50%				25%	over 15											
13.00	14.00		>>>>			30 60 60 60 60	150						42%				15%	over 15											
14.00	15.00		>>>>			40 30 60 60		290					48%				29%	15 to 8											
15.00	16.00	Ferrogenous sand stone rock	AAAAAAAA			60 60 30 40 40 60	130 90 90						60%				13%	over 15											
16.00	17.00		AAAAAAAA			40 50	90 80 150	190					60%				34%	15 to 8											
17.00	18.00		AAAAAAAA			40 70 60 50 60 60	120	490					95%				61%	5 to 3											
18.00	19.00		AAAAAAAA			30 50 60			170 200					51%				37%	15 to 8										
19.00	20.00			AAAAAAAA		10 10	40 50 30 50 60 70	90	160 160									32%	15 to 8										

33 of 354

Total Depth of Bore Hole : 20.00 m

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION STAGE IV MAIN PLANT AREA
 BEARING OF HOLE
 COLLAR ELEVATION : 30 cms
 STARTED :22-07-2011

BORE HOLE NO. : 112
 CO - ORDINATES : 19A+1,11B+66
 ANGLE WITH HORIZONTAL NIL
 GROUND ELEVATION : 151.924 mtr
 COMPLETED : 24-07-2011

SHEET NO. : 01
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT		R.Q.D	FRACT FREQ/M	SIZE OF HOLE			CASING		WATER LEVEL		WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100	Diamond Core Bit																
0.00	1.00	Silty Clay	***** *****																													D/S
1.00	1.50	SDR	//////// ////////																													SPT>50
1.50	3.00	SDR	//////// ////////																													SPT 15-17+19=36
3.00	4.50	Silty Clay	***** *****																													SPT>50
4.50	5.00	Silty Clay	***** *****																													SPT>50
5.00	6.00	SDR	//////// ////////																													D/S
6.00	7.00	SDR	//////// ////////																													
7.00	8.00	Fractured ferrogenous sand stone rock	>>>> >>>>			50 50 70	80				25%																					over 15
8.00	9.00		>>>> >>>>			40 60 70 70 70 60	110						48%																			over 15
9.00	10.00		>>>> >>>>			60 70 50		280						46%																		

34 of 354

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BEARING OF HOLE :
 COLLAR ELEVATION : 30 cms
 STARTED : 22-07-2011
 BORE HOLE NO. : 112
 CO - ORDINATES : 19A+1,11B+66
 ANGLE WITH HORIZONTAL : NIL
 GROUND ELEVATION : 151.924 mtr
 COMPLETED : 24-07-2011
 SHEET NO. : 02
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE	CASING	WATER LEVEL	WATER LOSS		PERMEABILITY MM/S OR LUGEON	PENETRATION RATE MM/MIN	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100							PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON	
10.00	11.00	Fractured ferrogenous sand stone rock	>>>>				150	360		>>>>			51%			Diamond Core Bit	51%		NX	3.00 mtr	5.30 mtr					
11.00	12.00		>>>>		20	30 70 50 60	90 110			>>>>			43%				11%									
12.00	13.00		>>>>			60 60 40 50	80 140 80 90 80			>>>>				68%			14%									
13.00	14.00		>>>>		20	70 50 60 50 60	80 80			>>>>			47%				-									
14.00	15.00		>>>>			60 40 50 60	80 130 100 80 80			>>>>				68%			23%									
15.00	16.00	Frogenous sand stone rock	AAAAAAAA			70	130 80 110	200		AAAAAAAA							44%									
16.00	17.00		AAAAAAAA			80	140 80 140 80 110			AAAAAAAA			55%				39%									
17.00	18.00		AAAAAAAA			60 70 60 70 60 70 70 50 60 60 60	90			AAAAAAAA			78%				-									
18.00	19.00		AAAAAAAA			60 60 70 70 60 60 70	150 80	160		AAAAAAAA							31%									
19.00	20.00		AAAAAAAA			60 70 50 70 60 70	80 110	180 170		AAAAAAAA				92%			46%									

35 of 354

Total Depth of Bore Hole : 20.00 m

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION

AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BEARING OF HOLE :
 COLLAR ELEVATION : 37 cms
 STARTED : 25-07-2011

BORE HOLE NO. : 113
 CO - ORDINATES : 18A+1,11B+31
 ANGLE WITH HORIZONTAL : NIL
 GROUND ELEVATION : 151.426 mtr
 COMPLETED : 27-07-2011

SHEET NO. : 01
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL : NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE	CASING	WATER LEVEL	WATER LOSS		PERMEABILITY		PENETRATION RATE MM/MIN	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100							PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON		
0.00	1.00	Silty Clay	***** *****																								D/S
1.00	1.50	SDR	////////																								SPT 13-15+17=32
1.50	3.00		////////																								SPT 5-17+20=37
3.00	4.50		////////																								SPT>50
4.50	6.00		////////																								SPT>50
6.00	7.00	Fractured ferrogenous sand stone rock	>>>>			40 40 30 30 30 30 40 50						29%															
7.00	8.00		>>>>		20	50 50 60 60 60	100					40%						10%	over 15								
8.00	9.00		>>>>			70 60 70 70 70 60	90						49%					-	over 15								
9.00	10.00		>>>>			50 60 60	110 120	160					56%					39%	15 to 8								
10.00	11.00		>>>>			70 70 60 60	130 100					49%						23%	over 15								

APPENDIX C	
CLAUSES 3.1 AND 3.4	
PROFORMA FOR PRESENTING DRILLING INFORMATION	
AS PER IS4464:1985	

PROJECT : NTPC RAMAGUNDAM		BORE HOLE NO. : 113		SHEET NO. : 02	
LOCATION STAGE IV MAIN PLANT AREA		CO - ORDINATES : 18A+1,11B+31		FEATURE : Plain area	
BEARING OF HOLE		ANGLE WITH HORIZONTAL NIL		TOTAL DEPTH : 20.00 mtr	
COLLAR ELEVATION : 37 cms		GROUND ELEVATION : 151.426 mtr		TYPE(S) OF CORE BARREL: NX	
STARTED :25-07-2011		COMPLETED : 27-07-2011		DRILLING AGENCY M/S GEO TECHNICAL SERVICES	

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE	CASING	WATER LEVEL	WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100	Diamond Core Bit	NX	4.00 mtr	5.00 mtr	PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON				
11.00	12.00	Fractured ferrogenous sand stone rock	>>>>		20 20 20	40 40 40 50 50 50	100						43%														
12.00	13.00		>>>>			60 60 60	80 90 100						45%														
13.00	14.00		>>>>				130 80 110	210					53%														
14.00	15.00		>>>>			70	140 80 140 80						51%														
15.00	16.00		>>>>		70	60 70 60 60 60	120						50%														
16.00	17.00	Ferrogenous sand stone rock	AAAAAAAA			70 70 70 70 50 60	100						49%														
17.00	18.00		AAAAAAAA			60 60 70 70 70	120 80 90	160						78%													
18.00	19.00		AAAAAAAA			60 70 40 60 60 70 70		170					60%														
19.00	20.00		AAAAAAAA			60	110	170 190 200						73%													

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BORE HOLE NO. : 114
 SHEET NO. : 01
 CO - ORDINATES : 18A+29,10B+95
 FEATURE : Plain area
 BEARING OF HOLE :
 ANGLE WITH HORIZONTAL : NIL
 TOTAL DEPTH : 20.00 mtr
 COLLAR ELEVATION :
 GROUND ELEVATION : 152.117 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES
 COMPLETED :

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT		R.Q.D	FRACT FREQ/M	NX			SIZE OF HOLE	CASING	WATER LEVEL		WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS	
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100		Diamond Core Bit																
0.00	1.00	Silty Clay	***** *****																														D/S obtained
1.00	1.50	SDR	//////// ////////																														

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BEARING OF HOLE :
 COLLAR ELEVATION :
 STARTED :
 COMPLETED :
 BORE HOLE NO. : 114
 CO - ORDINATES : 18A+29, 10B+95
 ANGLE WITH HORIZONTAL : NIL
 GROUND ELEVATION : 152.117 mtr
 SHEET NO. : 02
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE	CASING	WATER LEVEL	WATER LOSS		PERMEABILITY	TEST SECTION	MM/S OR LUGERON	PENETRATION RATE	MM/MIN	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100				NX	6.00 mtr		PARTIAL	COMPLETE						
10.00	11.00	Medium grained ferruginous sandstone rock	&&&&&&			70	100 110 140					42%					35%	15 to 8											
11.00	12.00		&&&&&&			50 70 30 60	150 100					46%					25%	over 15											
12.00	13.00		&&&&&&			30 50 40 60	150					33%					15%	over 15											
13.00	14.00		&&&&&&			60 40 30 50	150					33%					15%	over 15											
14.00	15.00		&&&&&&			70 50 30 40	130 90						41%				13%	over 15											
15.00	16.00		&&&&&&			40 30 30 50	150	180					48%				33%	15 to 8											
16.00	17.00		&&&&&&	10	20	30 30	120	240					45%				36%	15 to 8											
17.00	18.00		&&&&&&		20	30	90 90 120 120						47%				24%	over 15											
18.00	19.00		&&&&&&			50 30 50	90 100 80						40%				10%	over 15											
19.00	20.00		&&&&&&			50 50 60	90 150						40%				15%	over 15											

Total Depth of Bore Hole : 20.00 m

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION

AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM

SHEET NO. : 01

LOCATION : STAGE IV MAIN PLANT AREA

CO - ORDINATES : 19A+13, 10B+93

FEATURE : Plain area

BEARING OF HOLE

ANGLE WITH HORIZONTAL : NIL

TOTAL DEPTH : 20.00 mtr

COLLAR ELEVATION :

TYPE(S) OF CORE BARREL: NX

STARTED : 07-08-2011

COMPLETED : 08-08-2011

DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT		R.Q.D	FRACT FREQ/M	SIZE OF HOLE			CASING		WATER LEVEL	WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS	
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100		Diamond Core Bit				NX			4.00 mtr			PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON		
0.00	1.00	Filling up material	}}}}}}}							}}																						
1.00	2.00	Silty Clay	*****							*****																						SPT 4-6-13=19
2.00	3.00		*****							*****																						SPT 12-11-16=27
3.00	4.00		*****							*****																						SPT 16-16-23=39
4.00	5.00		////////								////////																					N>50
5.00	6.00	SDR	////////							////////																						N>50
6.00	7.00		??>>>>								??>>>>																					calcareous formation visible
7.00	8.00	calcarous fractured sand stone rock	??>>>>	20 20 20	40 40 40	80				??>>>>	22%																					
8.00	9.00		??>>>>		20	40 60	120				??>>>>	24%																				over 15
9.00	10.00	Medium grained ferrigenous sandstone rock	&&&&&	20	40 40 60	100				&&&&&	26%																				over 15	

12866/2020/PS-PEM-MAX

APPENDIX C

CLAUSES 3.1 AND 3.4

PROFORMA FOR PRESENTING DRILLING INFORMATION

AS PER IS4464:1985

PROJECT : NTPC RAMAGUNDAM
 LOCATION : STAGE IV MAIN PLANT AREA
 BEARING OF HOLE :
 COLLAR ELEVATION :
 STARTED : 07-08-2011
 BORE HOLE NO. : 115
 CO - ORDINATES : 19A+13,10B+93
 ANGLE WITH HORIZONTAL : NIL
 GROUND ELEVATION : 151.638 mtr
 COMPLETED : 08-08-2011
 SHEET NO. : 02
 FEATURE : Plain area
 TOTAL DEPTH : 20.00 mtr
 TYPE(S) OF CORE BARREL: NX
 DRILLING AGENCY M/S GEO TECHNICAL SERVICES

ELEV.	IN M	LITHOLOGY		SIZE OF CORE PIECES					STRUCTURAL CONDITIONS		% CORE RECOVERY					TYPE OF BIT	R.Q.D	FRACT FREQ/M	SIZE OF HOLE		CASING		WATER LEVEL		WATER LOSS		PERMEABILITY		PENETRATION RATE	SPECIAL OBSVS
		DESCRIPTION	LOG	<10MM	10 - 25 MM	25 - 75 MM	75 - 150 MM	>150 MM	DESCRIPTION	LOG	0 - 20	20 - 40	40 - 60	60 - 80	80 - 100				NX	SIZE OF HOLE	4.00 mtr				PARTIAL	COMPLETE	TEST SECTION	MM/S OR LUGEON		
10.00	11.00	Medium grained ferrigenous sandstoe rock	&&&&&&		40 40 60	80 80					30%																			
11.00	12.00		&&&&&&		60	80 100 110 100							45%																	
12.00	13.00		&&&&&&		20	40 40 60	110 100 100 110	200						78%																
13.00	14.00	calcarous fractured sand stone rock	??>>>>		20 20	50 60 40 50 60	100						40%																	calcarous formation visible
14.00	15.00		??>>>>		20 20 20	50 60 40	110					32%																		
15.00	16.00	Medium grained ferrigenous sandstoe rock	&&&&&&		20 20 20	30 40 50 40 60 60																								thin cross calcarous bands<10 mm
16.00	17.00		&&&&&&		20 20	40 40 80 40 60 60	80							44%																thick cross calcarous banks>10mm
17.00	18.00	calcarous fractured sand stone rock	??>>>>		20	40 60 30 60	100 100						41%																	
18.00	19.00		??>>>>			40 40 40 70	80 100 80																							
19.00	20.00	Medium grained ferrigenous sandstoe rock	&&&&&&		60 70 60 50 50	80																								

Total Depth of Bore Hole : 20.00 m

236

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.4

Co-ordinates N=13B+36
E=6A+64

Field Test	Nos	Samples	Nos	Commencement Date : 21/04/2018
Penetrometer (SPT)	2	Undisturbed (UDS)	0	Completion Date : 22/04/2018
Cone (Pc)		Penetrometer (SPT)	2	Bore Hole Diameter : 150 mm/N.X
Vane (V)		Disturbed (DS)	3	Level Of Ground : 154.72 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 4.70 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
Very dense brownish grey, silty sand with decomposed rock.		100	4.0 cm	Pentn.	Refusal			DS-1 DS-2 *SPT-1 *SPT-2	0.50 1.00 1.20-1.24 1.30-1.34
		100	4.0 cm	Pentn.	Refusal				1.30-1.34
		NX rotary drilling from 1.30m						R1	1.30-2.00
								R2	2.00-2.75
Moderately weathered, reddish brown to brownish grey, medium grained, fractured rock.								R3	2.75-3.50
								R4	3.50-4.25
								R5	4.25-5.00
								R6	5.00-5.75
								R7	5.75-6.50
								R8	6.50-7.25
								R9	7.25-8.00
								R10	8.00-8.75
								R11	8.75-9.50
								R12	9.50-10.25
								R13	10.25-11.00
								R14	11.00-11.75
								R15	11.75-12.50
								R16	12.50-13.25
								R17	13.25-14.00
								R18	14.00-14.75
								R19	14.75-15.50
								R20	15.50-16.25
								R21	16.25-17.00
									17.00

N.B. - '*' means sample could not be recovered.



12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.5

Co-ordinates N=13B+43
E=6A+92

Field Test	Nos	Samples	Nos	Commencement Date : 17/04/2018
Penetrometer (SPT)	3	Undisturbed (UDS)	0	Completion Date : 18/04/2018
Cone (Pc)		Penetrometer (SPT)	3	Bore Hole Diameter : 150 mm/N.X.
Vane (V)		Disturbed (DS)	2	Level Of Ground : 153.18 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 3.40 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Dense to very dense brownish grey, silty sand								DS-1	0.30
								DS-2	1.00
								SPT-1	1.50-1.95
2.50m Moderately weathered, reddish brown to brownish grey, medium grained, fractured rock.		3	10	37	47			*SPT-2	2.40-2.44
		100	4.0	cm	Pentn. Refusal			*SPT-3	2.50-2.54
		100	4.0	cm	Pentn. Refusal				2.50
		NX rotary drilling from 2.50m						R1	CR=44% RQD=36% ↓ 3.25
								R2	CR=64% RQD=33% ↓ 4.00
								R3	CR=66% RQD=16% ↓ 4.75
								R4	CR=63% RQD=NIL ↓ 5.50
								R5	CR=76% RQD=36% ↓ 6.25
								R6	CR=68% RQD=40% ↓ 7.00
								R7	CR=90% RQD=56% ↓ 7.75
								R8	CR=82% RQD=74% ↓ 8.50
								R9	CR=95% RQD=40% ↓ 9.25
								R10	CR=85% RQD=48% ↓ 10.00
								R11	CR=84% RQD=80% ↓ 10.75
								R12	CR=80% RQD=72% ↓ 11.50
								R13	CR=93% RQD=81% ↓ 12.25
								R14	CR=95% RQD=94% ↓ 13.00
								R15	CR=84% RQD=82% ↓ 13.75
								R16	CR=96% RQD=74% ↓ 15.00
15.00m Slightly weathered to fresh, reddish brown to brownish grey, medium grained, moderately fractured rock.									

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.6

Co-ordinates N=13B+50
E=6A+76

Field Test	Nos	Samples	Nos	Commencement Date : 19/04/2018
Penetrometer (SPT)	2	Undisturbed (UDS)	0	Completion Date : 20/04/2018
Cone (Pc)		Penetrometer (SPT)	2	Bore Hole Diameter : 150 mm/N.X.
Vane (V)		Disturbed (DS)	2	Level Of Ground : 154.66 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 4.60 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m									
Dense to very dense, brownish grey, silty sand with decomposed rocks.								DS-1	0.50
								SPT-1	1.50-1.95
2.50m								*SPT-2	2.50-2.54
Highly weathered, reddish brown to brownish grey, medium grained, fractured rock.								R1	2.50
								R2	3.25
								R3	4.00
								R4	4.75
								R5	5.50
								R6	6.25
								R7	7.00
								R8	7.75
								R9	8.50
								R10	9.25
								R11	10.00
								R12	10.75
								R13	11.50
								R14	12.25
								R15	13.00
								R16	13.75
								R17	14.50
								R18	15.25
								R19	16.00
								R20	16.75
18.00m									18.00

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.7

Co-ordinates N=13B+61
E=6A+66

Field Test	Nos	Samples	Nos	Commencement Date : 23/04/18
Penetrometer (SPT)	2	Undisturbed (UDS)	0	Completion Date : 24/04/18
Cone (Pc)		Penetrometer (SPT)	2	Bore Hole Diameter : 150 mm/N.X.
Vane (V)		Disturbed (DS)	1	Level Of Ground : 153.97 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 3.90 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
Very dense, brownish grey sandy silt with decomposed rock.		100	4.0 cm	Pentn.	Refusal			DS-1	0.50
		100	3.0 cm	Pentn.	Refusal			*SPT-1	1.00-1.04
								*SPT-2	1.10-1.13
Highly to moderately weathered, pinkish grey to whitish grey, medium grained, moderately fractured rock.		NX rotary drilling from 1.30m						R1	1.10
								R2	1.85
								R3	2.60
								R4	3.35
								R5	4.10
								R6	4.85
								R7	5.60
								R8	6.35
								R9	7.10
								R10	7.85
								R11	8.60
								R12	9.35
								R13	10.10
								R14	10.85
								R15	11.60
								R16	12.35
								R17	13.10
								R18	13.85
								R19	14.60
								R20	15.35
								R21	16.10
								R22	16.85
Moderately weathered to slightly weathered to fresh, brownish grey to reddish brown, medium grained, slightly fractured rock.									17.60

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.8

Co-ordinates N=13B+47
E=6A+31

Field Test	Nos	Samples	Nos	Commencement Date : 13/04/2018
Penetrometer (SPT)	3	Undisturbed (UDS)	0	Completion Date : 16/04/2018
Cone (Pc)		Penetrometer (SPT)	3	Bore Hole Diameter : 150mm./N.X
Vane (V)		Disturbed (DS)	2	Level Of Ground : 154.85 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 3.10 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Very dense, reddish brown, silty sand with decomposed rock.		50	52	2.0	cm	Pentn.	>100	DS-1	0.50
		100	3.0	cm	Pentn.	Refusal		DS-2	1.00
		100	2.0	cm	Pentn.	Refusal		SPT-1	1.50-1.67
1.90m Moderately weathered, brownish grey to reddish brown, medium grained, slightly fractured rock.								*SPT-2	1.80-1.83
								*SPT-3	1.90-1.92
								R1	1.90
								R2	2.65
								R3	3.40
								R4	4.15
								R5	4.90
								R6	5.65
								R7	6.40
								R8	7.15
								R9	7.90
								R10	8.65
								R11	9.40
								R12	10.15
								R13	10.90
								R14	11.65
								R15	12.40
								R16	13.15
								R17	13.90
								R18	14.65
								R19	15.40
								R20	16.15
								R21	16.90
								R22	17.65
								R23	18.40
								R24	19.15
								R25	19.90
								R26	20.65
21.00m									21.00



12866/2020/PS-PEM-MAX

Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS **CETEST**

Job No : 4147 Created by : S.NATH Created on : 04/06/2018 Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.9

Co-ordinates N=13B+51
E=6A+07

Field Test	Nos	Samples	Nos	Commencement Date : 16/04/2018
Penetrometer (SPT)	3	Undisturbed (UDS)	0	Completion Date : 19/04/2018
Cone (Pc)		Penetrometer (SPT)	3	Bore Hole Diameter : 150 mm / N.X
Vane (V)		Disturbed (DS)	3	Level Of Ground : 156.28 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 5.50 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Very dense, whitish grey, sandy silt with decomposed rock.								DS-1 DS-2	0.50 1.00
2.00m Very dense, reddish brown, silty sand with decomposed rock.		16	20	36	56			SPT-1	1.50-1.95
3.00m Moderately weathered, brownish grey to reddish brown, medium grained, moderately fractured rock.		21	150	5.0	N>100			DS-3 SPT-2 *SPT-3	2.50 2.70-2.90 3.00-3.03
3.75m Moderately weathered, brownish grey to reddish brown, medium grained, moderately fractured rock.		100	3.0	cm	Penth. Refusal				3.00
5.25m Slightly weathered, brownish grey to reddish brown, medium grained, slightly fractured rock.		NX rotary drilling from 3.00m						R1	CR=42% RQD=NIL 3.75
								R2	CR=53% RQD=13% 4.50
								R3	CR=56% RQD=32% 5.25
								R4	CR=68% RQD=37% 6.00
								R5	CR=76% RQD=13% 6.75
								R6	CR=60% RQD=NIL 7.50
								R7	CR=68% RQD=41% 8.25
								R8	CR=60% RQD=37% 9.00
								R9	CR=73% RQD=35% 9.75
								R10	CR=74% RQD=62% 10.50
								R11	CR=85% RQD=73% 11.25
								R12	CR=68% RQD=56% 12.00
								R13	CR=76% RQD=60% 12.75
								R14	CR=72% RQD=58% 13.50
								R15	CR=75% RQD=56% 14.25
15.00m								R16	CR=80% RQD=61% 15.00

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.10

Co-ordinates N=13B+44
E=5A+88

Field Test	Nos	Samples	Nos	Commencement Date : 20/04/2018
Penetrometer (SPT)	3	Undisturbed (UDS)	0	Completion Date : 22/04/2018
Cone (Pc)		Penetrometer (SPT)	3	Bore Hole Diameter : 150 mm/N.X.
Vane (V)		Disturbed (DS)	3	Level Of Ground : 156.00 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 5.60 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Dense, brownish grey, clayey silty sand/ clayey sandy silt.								DS-1	0.50
								DS-2	1.00
								SPT-1	1.50-1.95
								DS-3	2.20
2.20m Very dense, brownish grey, silty sand with decomposed rock.								*SPT-2	2.40-2.44
2.50m								*SPT-3	2.50-2.54
								R1	CR=38% RQD=NIL
								R2	CR=39% RQD=NIL
								R3	CR=41% RQD=NIL
								R4	CR=43% RQD=NIL
								R5	CR=52% RQD=NIL
								R6	CR=58% RQD=NIL
								R7	CR=52% RQD=NIL
								R8	CR=56% RQD=NIL
								R9	CR=52% RQD=17%
								R10	CR=60% RQD=32%
								R11	CR=54% RQD=17%
								R12	CR=65% RQD=NIL
								R13	CR=80% RQD=55%
								R14	CR=78% RQD=60%
								R15	CR=88% RQD=60%
								R16	CR=80% RQD=60%
								R17	CR=82% RQD=64%
								R18	CR=84% RQD=62%
								R19	CR=88% RQD=80%
16.75m									16.75

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.22

Co-ordinates N=14B+81
E=7A+06

Field Test	Nos	Samples	Nos	Commencement Date : 19/05/18
Penetrometer (SPT)	3	Undisturbed (UDS)	0	Completion Date : 20/05/18
Cone (Pc)		Penetrometer (SPT)	3	Bore Hole Diameter : 150 mm/N.X.
Vane (V)		Disturbed (DS)	3	Level Of Ground : 156.11 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 4.1 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m								DS-1	0.50
Filled up soil consists of silty sand with ash, brick bats & boulders.								DS-2	1.00
		14	18	26	44			SPT-1	1.50-1.95
2.30m								DS-3	2.50
Very dense, brownish grey, sandy silt/silty sand with decomposed rock.		100	4.0	cm	Pentn.	Refusal		*SPT-2	2.80-2.84
3.00m		100	4.0	cm	Pentn.	Refusal		*SPT-3	3.00-3.04
		NX rotary drilling from 3.00m						R1	CR=32% RQD=NIL
								R2	CR=36% RQD=NIL
								R3	CR=41% RQD=NIL
Highly to moderately weathered, pinkish grey to whitish grey, medium grained, moderately fractured rock.								R4	CR=37% RQD=NIL
								R5	CR=44% RQD=17%
								R6	CR=48% RQD=20%
7.50m								R7	CR=63% RQD=16%
								R8	CR=76% RQD=NIL
								R9	CR=80% RQD=20%
								R10	CR=78% RQD=NIL
Slightly weathered to fresh, pinkish grey to whitish grey, medium grained, slightly fractured rock.								R11	CR=84% RQD=60%
								R12	CR=75% RQD=55%
								R13	CR=80% RQD=56%
								R14	CR=84% RQD=60%
								R15	CR=78% RQD=54%
								R16	CR=84% RQD=68%
								R17	CR=90% RQD=80%
15.75m									

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX

Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS **CETEST**

Job No : 4147 Created by : S.NATH Created on : 04/06/2018 Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.23

Co-ordinates N=14B+68
E=7A+69

Field Test	Nos	Samples	Nos	Commencement Date : 29/05/18
Penetrometer (SPT)	4	Undisturbed (UDS)	0	Completion Date : 01/06/18
Cone (Pc)		Penetrometer (SPT)	4	Bore Hole Diameter : 150 mm/N.X
Vane (V)		Disturbed (DS)	4	Level Of Ground : 156.85 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 5.10 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Filled up soil consists of silty sand with ash, brick bats & boulders.								DS-1	0.50
								DS-2	1.00
						40		SPT-1	1.50-1.95
								DS-3	2.50
2.80m Very dense, pinkish grey, sandy silt/silty sand with decomposed rock.						N>100		SPT-2	3.00-3.37
								DS-4	3.50
3.80m								SPT-3	3.70-3.74
								*SPT-4	3.80-3.84
									3.80
								R1	CR=36% RQD=NIL
								R2	CR=33% RQD=NIL
								R3	CR=34% RQD=NIL
								R4	CR=39% RQD=NIL
								R5	CR=52% RQD=21%
								R6	CR=60% RQD=28%
								R7	CR=64% RQD=NIL
								R8	CR=74% RQD=32%
								R9	CR=80% RQD=36%
								R10	CR=82% RQD=20%
								R11	CR=82% RQD=56%
								R12	CR=86% RQD=60%
								R13	CR=81% RQD=58%
								R14	CR=87% RQD=60%
								R15	CR=86% RQD=60%
								R16	CR=90% RQD=62%
								R17	CR=92% RQD=80%
16.55m									16.55

N.B. - '*' means sample could not be recovered.

12866/2020/PS-PEM-MAX



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

CETEST

Job No : 4147

Created by : S.NATH

Created on : 04/06/2018

Sheet No:

BORE LOG DATA SHEET

BORE HOLE NO.24

Co-ordinates N=13B+99
E=7A+52

Field Test	Nos	Samples	Nos	Commencement Date : 27/05/18
Penetrometer (SPT)	2	Undisturbed (UDS)	0	Completion Date : 28/05/18
Cone (Pc)		Penetrometer (SPT)	2	Bore Hole Diameter : 150 mm/N.X
Vane (V)		Disturbed (DS)	2	Level Of Ground : 154.19 m.
		Water Sample (WS)	0	Water Struck At :
				Standing Water Level : 3.10 m.

DESCRIPTION	SYMBOL	N-VALUE						SAMPLES	
		Each divn.=15.0cm.						Ref. No	Depth (m)
0.00m Very dense, pinkish grey, sandy silt/ silty sand with decomposed rock.								DS-1	0.50
								DS-2	1.00
1.50m		100	4.0	cm	Pentn.	Refusal		*SPT-1	1.40-1.44
		100	4.0	cm	Pentn.	Refusal		*SPT-2	1.50-1.54
		NX rotary drilling from 1.50m						R1	CR=32% RQD=NIL
								R2	CR=43% RQD=NIL
								R3	CR=45% RQD=19%
								R4	CR=44% RQD=19%
								R5	CR=43% RQD=NIL
								R6	CR=47% RQD=NIL
								R7	CR=52% RQD=13%
								R8	CR=49% RQD=15%
								R9	CR=45% RQD=NIL
8.25m								R10	CR=56% RQD=20%
								R11	CR=58% RQD=21%
								R12	CR=74% RQD=48%
								R13	CR=76% RQD=61%
								R14	CR=80% RQD=62%
								R15	CR=78% RQD=74%
								R16	CR=84% RQD=76%
								R17	CR=86% RQD=78%
								R18	CR=90% RQD=60%
15.75m								R19	CR=93% RQD=82%
									15.75

N.B. - '*' means sample could not be recovered.



Project : G.I works for proposed FGD for Unit-7, Stage-III, Ramagundam STPS

Job No : 4147	Created by : S.NATH	Created on : 04/06/2018	Sheet No:
---------------	---------------------	-------------------------	-----------

BORE LOG DATA SHEET

BORE HOLE NO.25

Co-ordinates	$N=14B+53$ $F=7A+19$
--------------	-------------------------

Field Test	Nos	Samples	Nos	Commencement Date :	28/05/18
Penetrometer (SPT)	4	Undisturbed (UDS)	0	Completion Date :	29/05/18
Cone (Pc)		Penetrometer (SPT)	4	Bore Hole Diameter :	150 mm/N.X
		Disturbed (DS)	4	Level Of Ground :	156.58 m.
Vane (V)		Water Sample (WS)	0	Water Struck At :	
				Standing Water Level :	5.10 m.

[illegible]

ES-PEM-MAA	PROJECT INFORMATION			
CLAUSE NO.				
Table :1 COAL AND ASH CHARACTERISTICS				
Coal Properties for Ramagundam ESP Augmentation				
S.No.	Characteristics	Range of Coal Supplies 95%		
	(as received basis)	Column - 1	Column - 2	Column - 3
1.0	PROXIMATE ANALYSIS	Design	Worst	Best
1.1	Total Moisture (%)	12	15	11
1.2	Ash (%)	42	45	35
1.3	Volatlie Matter (%)	22	20	24
1.4	Fixed Carbon (%)	24	20	30
1.5	Total (%)	100	100	100
2.0	ULTIMATE ANALYSIS			
2.1	Carbon (%)	35.28	30.72	40.68
2.2	Hydrogen (%)	2.54	2.3	2.73
2.3	Sulphur (%)	0.45	0.6	0.4
2.4	Nitrogen(%)	0.68	0.6	0.85
2.5	Oxygen(%) (By difference)	7.05	5.78	9.38
2.6	Total Moisture (%)	12	15	11
2.7	Ash (%)	42	45	35
	Total	100	100	100
2.10	GCV (Kcal/Kg)	3400	3000	3800
2.11	Hard Grove Index	50	47	55
3.0	ASH ANALYSIS			
3.1	Silica (%)	61.85	61.3	62.4
3.2	Alumina(%)	27.36	27.42	27.31
3.3	Iron Oxide (%)	5.18	5.4	4.96
3.4	Titania	1.84	1.8	1.88
3.5	Phosphoric Anhydride (%)	0.54	0.54	0.55
3.6	Lime (%)	1.47	1.52	1.42
3.7	Magnesia (%)	1	0.97	1.03
3.8	Sulphuric Anhydride (%)	0.05	0.05	0.05
3.9	Sodium Oxide (%)	0.2	0.08	0.04
3.1	Balance Alkalies (by difference)	0.51	0.92	0.36
	Total	100	100	100
4.0	ASH FUSION RANGE			
	REDUCING ATMOSPHERE			
4.1	Initial Deformation Temp. (oC)	1150	1100	1200
4.2	Hemispherical Temp. (oC)	1300	1250	1350
4.3	Fusion Temperature (oC)	1400	1350	1400

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 25 OF 32
---	--	--	---------------

CS-PEM-MAX		PROJECT INFORMATION			
CLAUSE NO.	TABLE – 2				
	FUEL OIL CHARACTERISTICS				
	Sl. No.	Characteristics	Heavy Furnace Oil grade HV (HFO) IS-1593-1982	Low Sulphur Heavy Stock (LSHS) IS-11489-1985	Heavy Petroleum stock (HPS) IS-11489-1985
	1.	Total sulphur content	4.5% Max.	1.0% Max.	4.5% Max.
	2.	Gross calorific value (KCal/kg)	of the order of 10,000	of the order of 10,000	of the order of 10,000
	3.	Flash Point (Min)	66 deg C	76 deg C	66 deg C
	4.	Water content by volume (Max)	1.0%	1.0%	1.0%
	5.	Sediment by weight (Max)		0.25%	0.25% 0.25%
	6.	Asphaltene content by weight (Max.)	2.5%	2.5%	2.5%
	7.	Kinematic viscosity in Centistokes	370 at 50deg C	100 at 100deg C	100 at 100deg C
	8.	Ash Content by weight (Max.)	0.1%	0.1%	0.1%
	9.	Acidity (inorganic)	Nil	Nil	Nil
	10.	Pour Point (Max.)	57 deg C	66 deg C	72 deg C
	11.	Sodium content	—	—	100 ppm
	12.	Vanadium content	25 ppm	25ppm	25 ppm
13.	Specific heat below pour point (KCal/Kg °C)		0.65		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 26 OF 32	

PS-PEM-MAA																									
CLAUSE NO.	PROJECT INFORMATION																								
	TABLE – 2 LIGHT DIESEL OIL CHARACTERISTICS AS PER IS 1460-2000 <table><thead><tr><th>Characteristics</th><th>LDO</th></tr></thead><tbody><tr><td>1. Pour Point (max) Summer</td><td>21 deg.C & 12°C for and Winter respectively</td></tr><tr><td>2. Kinematic viscosity in centistokes at 40 deg.C</td><td>2.5 to 15.7</td></tr><tr><td>3. Sediment percent by mass (max)</td><td>0.10</td></tr><tr><td>4. Total sulphur percent by mass (max)</td><td>1.8</td></tr><tr><td>5. Ash percentage by mass (max)</td><td>0.02</td></tr><tr><td>6. Carbon residue (Rans bottom) percent by pass (max.)</td><td>1.50</td></tr><tr><td>7. Acidity in organic</td><td>Nil</td></tr><tr><td>8. Flash point(Min.) - Pensky Martens</td><td>66 deg.C</td></tr><tr><td>9. Copper strip corrosion for 3 hours at 100°C</td><td>Not worse than No. 2</td></tr><tr><td>10. Water content, % by volume(max)</td><td>0.25</td></tr><tr><td>11. GCV (Kcal/kg)</td><td>10,000</td></tr></tbody></table>	Characteristics	LDO	1. Pour Point (max) Summer	21 deg.C & 12°C for and Winter respectively	2. Kinematic viscosity in centistokes at 40 deg.C	2.5 to 15.7	3. Sediment percent by mass (max)	0.10	4. Total sulphur percent by mass (max)	1.8	5. Ash percentage by mass (max)	0.02	6. Carbon residue (Rans bottom) percent by pass (max.)	1.50	7. Acidity in organic	Nil	8. Flash point(Min.) - Pensky Martens	66 deg.C	9. Copper strip corrosion for 3 hours at 100°C	Not worse than No. 2	10. Water content, % by volume(max)	0.25	11. GCV (Kcal/kg)	10,000
Characteristics	LDO																								
1. Pour Point (max) Summer	21 deg.C & 12°C for and Winter respectively																								
2. Kinematic viscosity in centistokes at 40 deg.C	2.5 to 15.7																								
3. Sediment percent by mass (max)	0.10																								
4. Total sulphur percent by mass (max)	1.8																								
5. Ash percentage by mass (max)	0.02																								
6. Carbon residue (Rans bottom) percent by pass (max.)	1.50																								
7. Acidity in organic	Nil																								
8. Flash point(Min.) - Pensky Martens	66 deg.C																								
9. Copper strip corrosion for 3 hours at 100°C	Not worse than No. 2																								
10. Water content, % by volume(max)	0.25																								
11. GCV (Kcal/kg)	10,000																								
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9																								
PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 27 OF 32																								

CS-PEM-MAA

CLAUSE NO.	PROJECT INFORMATION				
	TABLE-3 (NOT USED)				
	TABLE-4				
	DESIGN CLARIFIED WATER ANALYSIS				
	S.No	Constituent	As	mg/l	
	1	Calcium	CaCO ₃	104	
	2	Magnesium	CaCO ₃	88	
	3	Sodium	CaCO ₃	59	
	4	Potassium	CaCO ₃	4	
		Total cations	CaCO ₃	255	
	5	HCO ₃	CaCO ₃	155	
	6	P- Alkalinity	CaCO ₃	0	
	7	Chloride	CaCO ₃	54	
	8	Sulphate	CaCO ₃	46	
		Total Anions	CaCO ₃	255	
	9	Silica, Reactive	Si	5	
10	Iron (Total)	Fe	0.5		
11	pH	-	7.0-7.8		
12	Turbidity	NTU	10		
13	Total dissolved solids		250-300		
14	Temperature	Deg C	20-35		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9		PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 28 OF 32

CLAUSE NO.	PROJECT INFORMATION																				
	TABLE-5 ANALYSIS OF DM WATER <table><thead><tr><th>Sl.No.</th><th>Characteristics</th><th>Value</th></tr></thead><tbody><tr><td>1.</td><td>Silica (Max.)</td><td>0.02 ppm as Sio2</td></tr><tr><td>2.</td><td>Iron as Fe</td><td>Nil</td></tr><tr><td>3.</td><td>Total hardness</td><td>Nil</td></tr><tr><td>4.</td><td>pH value</td><td>6.8 -7.2</td></tr><tr><td>5.</td><td>Conductivity</td><td>Not more than 0.1micro mho/cm excluding the effects of free CO2</td></tr></tbody></table>			Sl.No.	Characteristics	Value	1.	Silica (Max.)	0.02 ppm as Sio2	2.	Iron as Fe	Nil	3.	Total hardness	Nil	4.	pH value	6.8 -7.2	5.	Conductivity	Not more than 0.1micro mho/cm excluding the effects of free CO2
	Sl.No.	Characteristics	Value																		
	1.	Silica (Max.)	0.02 ppm as Sio2																		
	2.	Iron as Fe	Nil																		
	3.	Total hardness	Nil																		
	4.	pH value	6.8 -7.2																		
	5.	Conductivity	Not more than 0.1micro mho/cm excluding the effects of free CO2																		
	LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE																				
	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9																				
	PART-A SUB SECTION-IIA5 PROJECT INFORMATION																				
PAGE 29 OF 32																					

ES-PEM-MAA		CLAUSE NO.		PROJECT INFORMATION																																																																									
		TABLE-6 STEAM GENERATOR DATA Stage-I & Stage II (Per Unit basis) <table><tr><td>1.</td><td>Location</td><td colspan="2">Outdoor</td></tr><tr><td>2.</td><td>Operation</td><td colspan="2">Base load</td></tr><tr><td>3.</td><td>Type</td><td colspan="2">Pulverised coal fired</td></tr><tr><td>4.</td><td>Maximum Continuous Rating</td><td colspan="2">Stage-I 670 Tonns/hr.</td></tr><tr><td></td><td></td><td colspan="2">Stage-II 1725 Tonns/hr.</td></tr><tr><td>5.</td><td>Steam pressure at SH outlet</td><td colspan="2">Stage-I 157 Kg/cm²(a)</td></tr><tr><td></td><td></td><td colspan="2">Stage-II 178 Kg/cm²(a)</td></tr><tr><td>6.</td><td>Steam temperature at SH outlet</td><td colspan="2">Stage-I 540 Deg C</td></tr><tr><td></td><td></td><td colspan="2">Stage-II 540 Deg C</td></tr><tr><td>7.</td><td>Oil for start up and flame stabilisation</td><td colspan="2">LDO/HFO</td></tr><tr><td>8.</td><td>Fuel oil system sizing</td><td colspan="2">7.5% of Boiler MCR for LDO & 30% of Boiler MCR for HFO</td></tr><tr><td>9.</td><td>Pulverised coal size</td><td colspan="2">Minimum 70% through 200 Mesh and 99% thru 50 mesh</td></tr><tr><td>10.</td><td>Type of pulveriser</td><td colspan="2">Vertical spindle mills</td></tr><tr><td>11.</td><td>Type of oil burners</td><td colspan="2">Air atomised for LDO Steam atomised for HFO</td></tr><tr><td>12.</td><td>No. of air heaters</td><td colspan="2">Stage I Two (2) Tri-sector APH</td></tr><tr><td></td><td></td><td colspan="2">Stage II Four number (4) Bi-sector APH</td></tr><tr><td>13.</td><td>No. of ID Fans</td><td colspan="2">Stage-I Two (both working)</td></tr><tr><td></td><td></td><td colspan="2">Stage-II Two (Both working)</td></tr></table>				1.	Location	Outdoor		2.	Operation	Base load		3.	Type	Pulverised coal fired		4.	Maximum Continuous Rating	Stage-I 670 Tonns/hr.				Stage-II 1725 Tonns/hr.		5.	Steam pressure at SH outlet	Stage-I 157 Kg/cm ² (a)				Stage-II 178 Kg/cm ² (a)		6.	Steam temperature at SH outlet	Stage-I 540 Deg C				Stage-II 540 Deg C		7.	Oil for start up and flame stabilisation	LDO/HFO		8.	Fuel oil system sizing	7.5% of Boiler MCR for LDO & 30% of Boiler MCR for HFO		9.	Pulverised coal size	Minimum 70% through 200 Mesh and 99% thru 50 mesh		10.	Type of pulveriser	Vertical spindle mills		11.	Type of oil burners	Air atomised for LDO Steam atomised for HFO		12.	No. of air heaters	Stage I Two (2) Tri-sector APH				Stage II Four number (4) Bi-sector APH		13.	No. of ID Fans	Stage-I Two (both working)				Stage-II Two (Both working)	
1.	Location	Outdoor																																																																											
2.	Operation	Base load																																																																											
3.	Type	Pulverised coal fired																																																																											
4.	Maximum Continuous Rating	Stage-I 670 Tonns/hr.																																																																											
		Stage-II 1725 Tonns/hr.																																																																											
5.	Steam pressure at SH outlet	Stage-I 157 Kg/cm ² (a)																																																																											
		Stage-II 178 Kg/cm ² (a)																																																																											
6.	Steam temperature at SH outlet	Stage-I 540 Deg C																																																																											
		Stage-II 540 Deg C																																																																											
7.	Oil for start up and flame stabilisation	LDO/HFO																																																																											
8.	Fuel oil system sizing	7.5% of Boiler MCR for LDO & 30% of Boiler MCR for HFO																																																																											
9.	Pulverised coal size	Minimum 70% through 200 Mesh and 99% thru 50 mesh																																																																											
10.	Type of pulveriser	Vertical spindle mills																																																																											
11.	Type of oil burners	Air atomised for LDO Steam atomised for HFO																																																																											
12.	No. of air heaters	Stage I Two (2) Tri-sector APH																																																																											
		Stage II Four number (4) Bi-sector APH																																																																											
13.	No. of ID Fans	Stage-I Two (both working)																																																																											
		Stage-II Two (Both working)																																																																											
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9		PART-A SUB SECTION-IIA5 PROJECT INFORMATION																																																																									
				PAGE 30 OF 32																																																																									

CLAUSE NO.	PROJECT INFORMATION											
	ESP DATA Stage I & Stage II (Per Unit basis)											
	1.	Location:	Downstream side of Air preheaters									
	2.	Operation:	Base load									
	3.	Type:	Rigid Discharge frame									
	4.	Rapping:	Intermittent									
	TABLE-7											
	List of Drawings/Details placed below in this sub section:											
	<table><tr><th>Sl.No.</th><th>Drawing Description</th><th>Drawing No.</th></tr><tr><td>1.</td><td>General Layout Plan</td><td>Enclosed</td></tr><tr><td>2.</td><td>Chimney foundation</td><td>Refer details below</td></tr></table>			Sl.No.	Drawing Description	Drawing No.	1.	General Layout Plan	Enclosed	2.	Chimney foundation	Refer details below
	Sl.No.	Drawing Description	Drawing No.									
	1.	General Layout Plan	Enclosed									
2.	Chimney foundation	Refer details below										



NOTES:

1. ALL DIMENSIONS AND LEVELS ARE IN METRES.
2. BIDDER SHALL MAKE NOTE OF THE SPACE AVAILABLE AND THE LOCATION OF EXISTING FACILITIES. BIDDER SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING STAGE-I&II FACILITIES DURING EXECUTION OF STAGE-III FACILITIES AND SHALL MAKE ALL NECESSARY ARRANGEMENTS FOR PROTECTING THE SAME.

PRODUCT										RAMAGUNDAM SUPER THERMAL POWER PROJECT									
TITLE										GENERAL LAYOUT PLAN									
1										28.06.19									
2										22.08.14									
3																			
4																			
5																			
6																			
7																			
8																			
9																			
10																			
11																			
12																			
13																			
14																			
15																			
16																			
17																			
18																			
19																			
20																			
21																			
22																			
23																			
24																			
25																			
26																			
27																			
28																			
29																			
30																			
31																			
32																			
33																			
34																			
35																			
36																			
37																			
38																			
39																			
40																			
41																			
42																			
43																			
44																			
45																			
46																			
47																			
48																			
49																			
50																			
51																			
52																			
53																			
54																			
55																			
56																			
57																			
58																			
59																			
60																			
61																			
62																			
63																			
64																			
65																			
66																			
67																			
68																			
69																			
70																			
71																			
72																			
73																			
74																			
75																			
76																			
77																			
78																			
79																			
80																			
81																			
82																			
83																			
84																			
85																			
86																			
87																			
88																			
89																			
90																			
91																			
92																			
93																			
94																			
95																			
96																			
97																			
98																			
99																			
100																			
101																			
102																			
103																			
104																			
105																			
106																			
107																			
108																			
109																			
110																			
111																			
112																			
113																			
114																			
115																			
116																			
117																			
118																			
119																			
120																			
121																			
122																			
123																			
124																			
125																			
126																			
127																			
128																			
129																			
130																			
131																			
132																			
133																			
134																			
135																			
136																			
137																			
138																			
139																			
140																			
141																			
142																			
143																			
144																			
145																			
146																			
147																			
148																			
149																			
150																			
151																			
152																			
153																			
154																			
155																			
156																			
157																			
158																			
159																			
160																			
161																			
162																			
163																			
164																			
165																			
166																			
167																			
168																			
169																			
170																			
171																			
172										</									

FOR TENDER PURPOSE ONLY

WIPAC Limited
(A GOVERNMENT OF INDIA ENTERPRISE)

GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT
RAMACINDAM SUBBER THERMAL POWER PROJECT

WARMGONDAM SOI EN MEUMET I OTH EN I NOSECI

GENERAL LAYOUT PLAN

SIZE	SCALE	DRG. NO.	REV. NO.
------	-------	----------	----------

AD	1:3000	3150-999-POC-F-001
----	--------	--------------------

Case	Age	Sex	Occupation	Duration of illness	Site of infection	Outcome
1	25	M	Student	10 days	Stomach	Recovered
2	30	F	Teacher	15 days	Stomach	Recovered
3	35	M	Engineer	20 days	Stomach	Recovered
4	40	F	Homemaker	25 days	Stomach	Recovered
5	45	M	Doctor	30 days	Stomach	Recovered
6	50	F	Nurse	35 days	Stomach	Recovered
7	55	M	Lawyer	40 days	Stomach	Recovered
8	60	F	Retired	45 days	Stomach	Recovered
9	65	M	Businessman	50 days	Stomach	Recovered
10	70	F	Homemaker	55 days	Stomach	Recovered

[illegible]

2	1	FILE NAME :Romaquindom40
---	---	--------------------------

CLAUSE NO.		PROJECT INFORMATION									
Chimney Details											
LOT - 3 CHIMNEY DETAILS											
EXISTING											
Sl. No.	Project	Stage	UNIT	Type of Chimney (single/multi flue)	Chimney shell outer diameter at ground level (m)	Chimney foundation outer diameter (m)	Type of foundation	Level of Top of foundation (m)	Level of Bottom of foundation (m)		
1	FGU TPP	I	2X210	Twin	Foundation Data is not available, Bidder may conduct Ground Penetration Radar (GPR) Test to know the extent of existing chimney foundations. 25.00	36.22	Pile	RL (+) 106.00	RL (+) 103.00		
2		II	2X210	Twin							
3		III	1X210	Single							
4	Farakka	I	3X200	Multi	Foundation Data is not available, Bidder may conduct Ground Penetration Radar (GPR) Test to know the extent of existing chimney foundations. 32.00	44.1	Pile	RL (+) 25.5	RL (+) 21.75		
5		II	2X500	Twin							
6		III	1X500	Single							
7	Kahalgao	I	4X210	Multi							
8				Single							
9		II	3 X 500	Twin							
10		I	3X200	Single							
11		I		Single							
12		I		Single							
13	Korba	II	3X500	Single							
14				Single							
15				Twin							
16	Ramagundam	III	1X500	Single	32.0	41.0	Pile	RL (+) 288.5	RL (+) 285.0		
17		I	3X200	Multi							
18		II	3X500	Single							
19	Singrauli	I	5 X 200	Single							
20				Multi							
21				Twin							
22	Vindhyachal	II	2X500	Twin							
		I	6X200	Multi							
23		II	2X500	Twin							
24	Rihand	I	2X500	Twin							

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109 (3)-9	PART-A SUB SECTION-IIA5 PROJECT INFORMATION	PAGE 32 OF 32
---	--	--	---------------

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

SECTION-I,
SUB-SECTION-C1
SPECIFIC TECHNICAL REQUIREMENT –
MECHANICAL

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-C, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

1.0. APPLICABLE CODES & REGULATIONS

The design and materials shall conform to the requirements of applicable codes and regulations of the latest edition. The design, manufacture, installation and testing of the Agitator shall follow the latest applicable Indian/International (AISI / ASME/EN/Japanese) Standards.

Bidder shall supply the equipment in accordance with relevant regulations, codes and standards specified in the specification. If required by relevant regulations, codes and standards specified in the specification, Successful Bidder shall assist BHEL to obtain approval against the equipment, documents and drawings by Indian authorities.

2.0. PROVENNESS CRITERIA/Pre-QUALIFICATION REQUIREMENT

The Bidders are required to meet the Qualification Requirement (PQR) for Agitators as per Provenness Criteria & shall submit the credentials as called in the tender document. Only OEMs qualifying as per the Qualification requirement shall be considered for placement order.

3.0. MATERIAL OF CONSTRUCTION

Sl. No.	Material of construction	Horizontal agitators (side entry)	Vertical Agitators (Top entry)
i.	Impeller blade	Alloy 926 or better material	Alloy 926 or better material
ii.	Impeller Hub	Alloy 926 or better material	Alloy 926 or better material (or) Carbon steel with 6mm thick Bromo/Chloro Butyl Rubber Lining (as per Proven practice)
iii.	Shaft	Alloy 926 or better material	CS with Rubber Lining (min 6 mm thk Chloro/bromo butyl Rubber)
iv.	Fasteners in wetted parts	Alloy 926 or better material	Alloy 926 or better material
v.	Fasteners in Non Wetted	GI fastener (40 μ plated) / SS	GI fastener (40 μ plated) / SS
vi.	Mounting base	Alloy 926/SMO254 (Wetted parts)	Carbon Steel
vii.	Tank Nozzle (for inserting agitator) with Flange	Not applicable (in BHEL scope)	Not applicable (in BHEL scope)
viii.	Flush pipe for Start up with flange	Not applicable (in BHEL scope)	Not applicable (in BHEL scope)
ix.	Flush Pipe at the bottom of the mounting flange	Not applicable (in BHEL scope)	Not applicable (in BHEL scope)
x.	Lantern support with mounting flange and bolts	Carbon steel/MS	Carbon steel/MS
Xi	Tie rods	Bidder to select	Bidder to select
Xii	Seal type and shaft sleeve material	Bidder to select (as applicable)	Bidder to select (as applicable)

Castings used for any part of the agitator assembly ordered under the specification shall be of sound and free of shrink or blow holes, scale, blisters and other similar casting defects.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-C, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

3.1. POWER SUPPLY DETAILS:

1.	POWER SUPPLY	
	The following voltage levels shall apply:	
	3 phase, 6.6 kV AC ,50 Hz	Voltage for motors equal to / bigger than 200KW and for power distribution within the plant.
	3 phase, 415 V, AC , 50 Hz	Standard voltage for power supplies to electric power consumers and motors Above 0.2 KW and upto 200 kW.
	240V AC / 3 phase 415 V AC, 50 Hz	Standard voltage for power supplies to electric power consumers and motors Upto 0.2 kW.
	1. All equipments shall be suitable for rated frequency of 50 Hz with a variation of + 3% & -5%, and 10 % combined variation of voltage and frequency unless specifically brought out in the specification. 2. Bidder shall design and supply the equipment suitable for satisfactory operation under above mentioned power supply condition. 3. For further details, refer electrical specification under Section-I, Sub-Section-C3	

4.0. SCOPE OF SUPPLY & SERVICES

The bidder shall assume sole responsibility for the design, fabrication, testing, surface preparation & painting, packing, transportation and performance of the specified equipment with accessories, and shall ensure that the equipment with accessories are in conformance with this specification, as well as other documents which form part of the Purchase Order/Contract.

Various inspections by the BHEL/NTPC shall not relieve the Bidder in any way of his obligation to maintain an adequate test, inspection, and documentation program of his own, and shall not relieve the Bidder of any other obligation under this specification. Furthermore, any inadvertent overlook of deviations from some requirements of this specification by the buyer shall not constitute a waiver of these requirements, or of the Bidder's obligation to correct the condition when it is discovered, or of any other obligation under this specification.

This specification only states the lowest technical requirement, neither specifying all technical details, nor referring the pertaining code and standard fully. It is the Bidder's responsibility to ensure that the complete delivery complies with all relevant codes, standards and specifications.

The Bidder is obliged to supply relevant drawings and documentation to the buyer. All to be in English language and metric system, if not otherwise agreed in writing.

Scope for the bidders shall include Design, Manufacturing, Supply, and Supervision of Erection & Commissioning

Design: broadly includes basic engineering, detail engineering, preparation and submission of engineering drawings/calculations/datasheets/quality assurance documents/field quality plans, storage instructions, commissioning procedures, Erection & assembly Drawings, operation & maintenance manuals, performance guarantee test procedures and assisting BHEL in obtaining time bound approval from NTPC.

Supply: the scope includes the following:

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-C, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

- Includes manufacturing/fabrication, shop floor testing, stage inspections, final inspections, painting & packing.
- Mandatory spares as defined as Section-I, Sub-Section-D, Annexure-II.
- Recommended spare parts list to be furnished (is not part of scope of supply)
- Any special tools & tackles required for the entire equipment to disassemble assemble or maintain the units.
- Start-up & Commissioning Spares
- First fill of consumables

Services: Services to be provided by the bidder:

- Detailed Erection and commissioning procedure shall be submitted by successful bidder for carrying out the erection and commissioning at site by BHEL.
- Supervision for Erection & Commissioning, trial run at site
- Performance guarantee tests at site & handover in flawless condition of the package to the customer
- Training of customer/ client O&M staff covering all aspects of the GDS- Operation & Maintenance, Trouble-shooting etc. at site
- Training of customer at manufacturer's works (3 persons for 2 days including lodging and boarding)
- Visits shall be planned by BHEL site team and prior intimation shall be sent to supplier for visit to site for supervision services. Bidder shall be informed at least 10 days in advance for the requirement of visit at site. Visiting team shall consist of one or two expert of bidder as deemed necessary by them.

The scope of supply for AGITATORS shall include but not limited to the following:

A) For Horizontal (Side Entry) Agitators:

Sl. No	Scope
1.	AGITATOR complete with
	i. AGITATOR Blades
	ii. AGITATOR Shafts
	iii. Coupling arrangement (Flexible)
	iv. Single Mechanical Seals
	v. Shaft Sleeve
	vi. Lanterns/ Stools (Bearing Housing), Safety Guard
	vii. Bearings
	viii. Agitator Mounting Flanges with gaskets and fasteners
	ix. Drive Motor(IE3) with gearbox arrangement
	x. Supporting arrangement including tie rods, gusset plates etc. of Side Entry Agitator on the tank Wall. Nozzle mating flange for supporting on the tank wall, gaskets and fasteners.
	xi. Flushing system for startup consisting of pipe with flanges, Nozzle and mating flange, blind flange for plugging.
	xii. Foundation plate with foundation bolts.
	xiii. Painting and Rust Prevention during shipment and construction
	xiv. Packing and transportation

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-C, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

Sl. No	Scope
xv.	Supervision of Erection & commissioning at site
xvi.	Special tools & tackles as applicable
xvii.	Start-up spares, Spare parts for commissioning & erection, Mandatory Spares: As per Project Specific Requirement
xviii.	Installation, operation and maintenance manuals
xix.	Any other items required for completeness of the equipment except the items covered in the exclusions.

B) For Vertical (Top Entry) Agitators:

Sl. No	Scope
2.	AGITATOR complete with
i.	AGITATOR Blades
ii.	AGITATOR Shafts
iii.	Coupling arrangement (Flexible)
iv.	Gland Packing, Seals, O Rings, Glands
v.	Shaft Sleeve
vi.	Lanterns/ Stools (Bearing Housing), Safety Guard
vii.	Bearings
viii.	AGITATOR Mounting Flanges with gaskets and fasteners
ix.	Drive Motor(IE3) with gearbox arrangement
x.	Mating Flange for Supporting on Slurry Tank Roof
xi.	Shims
xii.	Painting and Rust Prevention during shipment and construction
xiii.	Packing and transportation
xiv.	Supervision of Erection & commissioning at site
xv.	Special tools & tackles as applicable
xvi.	Start-up spares, Spare parts for commissioning & erection, Mandatory Spares: As per Project Specific Requirement
xvii.	Installation, operation and maintenance manuals
xviii.	Any other items required for completeness of the equipment except the items covered in the exclusions.

The quantity, location of the agitators has been included in the agitator schedule (Section-II, Annexure-8)

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

4.1	TECHNICAL REQUIREMENTS
I	Agitators shall be supplied in tanks and vessels to prevent caking and settlement of particles out of the slurry, e.g. in the limestone slurry tank, Auxiliary Absorbent tank, and sumps etc.
II	All agitators shall be designed for continuous operation unless otherwise specified. The design of the agitators shall be of proven type.
III	Standard type agitators with suitable characteristics shall be used wherever practical. The agitators shall be complete with motor, gearbox, agitator shaft, coupling, safety guards, mechanical seal (for side entry agitators), impeller, support legs, agitator mounting flange including bolts nuts and gasket etc.
IV	All agitator parts and accessories in contact with the stirred fluid shall be constructed of materials specifically designed for the conditions and nature of the stirred fluid and be resistant to erosion and corrosion.
V	MOC of various agitator parts shall be as per Cl 3.0. This does not release the bidder of the responsibility for selecting the correct materials.
VI	Each agitator and its associated equipment shall be arranged in such a manner as to permit easy access for operation, maintenance and agitator removal without interrupting plant operation. It shall be possible to remove the sealing devices of the side mounted agitators without having to drain completely the slurry inside the tank.
VII	-VOID-
VIII	Lifting lugs and eyes and other special tackle shall be provided as necessary to permit easy handling of the agitators and their components.
IX	Static and dynamic (as far as applicable) balancing of all agitators shall be carried out after assembly.
X	All agitator parts and components shall be designed and calculated for fatigue life, considering maximum bending loads, induced by fluctuating hydraulic forces and torsional loads, based on the installed motor power. For side entry agitators the alternating bending moment resulting from impeller and shaft weight has to be considered additionally.
XI	All exposed moving parts shall be covered by guards.
XII	The shape of the impeller blades of side entry agitator's/top entry agitators shall be designed to avoid wear on the impellers which will affect the agitator performance as specified for a minimum period of 2 years of continuous operation under design conditions for the range of coal & limestone specified in the specification. In order to avoid excessive wear impeller tip speeds must not exceed 12 m/s.
XIII	Belt drives (if applied for side entry agitators) shall be properly designed to provide a minimum lifetime of 2 years under design conditions
XIV	It shall be noted that all Agitators are meant for keeping the solid particles in suspended mode in liquid with "Full off-Bottom Suspension" of solid particles to 98% of liquid column to virtually "Uniform Solid Concentration". No chemical reaction will takes place.
XV	Maintaining a uniform concentration over the 95% of liquid column. Absolute sweeping of solid particle from tank bottom is a must for all Agitators. If speed is required to be increased to guarantee the above requirements; the same can be increased by vendor. Bidder's machines that consume less power will be in an advantageous position.
XVI	It is to be noted that in continuous process any deposit at tank bottom is the loss of material which are not getting converted as per process. Hence, total loss of material by sedimentation is a loss to FGD Process & determines the "In efficiency of the Agitator".
XVII	Vendor should ensure nil settlement; utilization of solid material shall be a guaranteed parameter and will be assessed in percentage (%) term to net wet of solid mass of inflow or out flow. This is one of the guarantee parameter.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

XVIII	Agitator and its driver shall perform on the test stand at shop and on the Agitator’s permanent location at site within vibration limit the vibration of combined unit will be the responsibility of Agitator manufacturer. Agitator manufacturer is to ensure that Site performance of vibration is one of the “Acceptance Criteria” of the equipment. Please note vibration at test stand can only be taken as for information.
XIX	Every Tank will have a pump whose suction line shall be connected to tank. These pumps are to operate continuously at the lowest operating level which is decided by Process requirement. Hence, the minimum operating level of liquid in every tank for every Agitator is a must to assess the combined operation of Agitator as well as that of pump alone. The Tank water level is indicated as per “SECTION-II Annexure-8”.
XX	Agitator must have low-pitch propeller with low solidity ratio and Power Number of 0.3-0.35. The Maximum Input Power at motor terminal shall be considered as a guaranteed parameter under “Schedule of Guaranteed Parameters” in “SECTION-II Annexure-10-Schedule of Guarantees”- and the same shall be calculated for maximum liquid level in tank. A calculation of power specifying the hydraulic power of Agitator, Seal loss, Gear box and Motor internal loss must be submitted along with the offer. A characteristics curve showing power versus liquid level should be submitted from the lowest liquid level, required for Agitator to maximum liquid level in the tank. Motor should be selected based on the highest power demand with a 15%margin at maximum liquid level, taking into account frequency variation.
XXI	The agitator shall be suitably designed for mounting and operation in purchaser’s tank whose drawings is annexed with the enquiry specification (SECTION-I,SUB-SECTION-D, Annexure-III). The successful bidder shall review and comment on the BHEL’s tank drawings for number and size of the baffles, sparger locations, mounting nozzle details etc.
XXII	Unless otherwise specified, for small diameter impeller, it shall be possible to remove complete agitator assembly without dismantling through the opening provided on the tank/sump, and for large diameter impeller, the blade shall be of removable construction for ease of removal. Bidder shall also provide the headroom required for taking out the agitator as above.
XXIII	Any instruments provided shall be Profibus Compatible.
XXIV	Bidder shall provide the design and arrangement of baffle plates in circular tanks. Baffle plates are in BHEL scope.
XXV	Bidder shall provide proper dowelling between motor and base plate, gear box and mounting tool/base plate, for ease of assembly of agitator unit. Tapered dowell shall be provided.
XXVI	Successful bidder shall provide suitable arrangement for supporting the agitator shaft with impellers during removal of gear-box for maintenance and details of such arrangements shall be furnished during detail engineering.
4.2 CONSTRUCTIONAL FEATURES	
A) BLADE AND HUB OF PROPELLER	
I)	The Blade design of the Agitator to be of most efficient design in order to offer least power consumption. The Agitator power consumption is part of the guarantee parameters.
II)	Although Agitator will have substantial low speed because of reduction Gear Box, hydraulic unbalance at impeller can cause severe vibration, hence it is mandatory that rotating assembly shall be dynamically balanced to its rated speed.
III)	Impeller should be dynamically balanced to Gr: G16: ISO-1940 after rubber lining of shaft.
B) SEAL	
1	Horizontal / Side Entry Agitators:
I.	Agitators should be provided with Single Stage mechanical seal. the mechanical seal should be as per ISO-21049 / API 682
II.	The Mechanical Seals shall be so arranged that repacking or fitting of replacement seals can be carried out with the minimum of disruption to plant operation.
III.	Design the mechanical seals chamber to have sufficient room to lubricate and get seal face cool with

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

	its own slurry.
IV.	Provide requirements for periodical flushing to rinse the seal face for leaked slurry.
V.	All mechanical seals, regardless of type or arrangement, shall be of the cartridge design. Hook sleeve cartridge should not be used.
VI.	Requirement of flushing water, its quantity, and pressure to be indicated in data sheet.
VII.	Zero leakage is the intension of this specification. However, quantity of leakage, if it is unavoidable, it should have a provision of collecting / or discharging back to the tank.
VIII.	Mechanical seals shall be fitted and installed in the Agitator before shipment and shall be clean. Mechanical seals shall be plugged with screw for shipping.
IX.	Intention of the specification is not to specify Type of Seal, Seal design, Spring configuration, Seal configuration, Balanced or Unbalance type etc. Agitator manufacturer to decide the same along with seal manufacturer, the best seal that is suitable for the offered Agitator
X	Seal life has to be guaranteed, taking into consideration all its components for 25000 hrs. If the seals fail before the completion of guaranteed period, the same should be replaced free of cost by the bidder.
XI	The sub-vendor of the seal shall be approved by NTPC during contract execution.
2	<u>Vertical Agitators for Other Slurry Tanks & Drain Pit Tanks</u>
I	Agitator shall be supplied with stuffing box or any proven equivalent or superior sealing type. Mechanical and hydraulic conditions in the seal chamber, required to maintain a stable film at seal face, including temperature, pressure and flow, shall be jointly established by Agitator manufacturer and seal manufacturer, and shall be noted in data sheet submitted in tender. If mechanical seal is offered by bidder, the mechanical seal should be as per ISO-21049 / API 682.
C)	SHAFT
I.	Use of dissimilar material at flange joint shall be avoided to eliminate any crevice corrosion. Spacing of the shaft joint should not be more than 3.0 m for easy assembly if it is more than 40kg. If welding is used for joining two tubes, welding joint must be 100% radio graphed. If split shaft is proposed for larger tanks , shaft flange at the joining interface has to be rubber lined at manufacturer’s works and necessary fasteners have to be provided.
II.	Shaft shall be capable of transmitting full rated torque as mentioned in the driver's nameplate.
III.	Shaft shall be capable for jamming conditions considering the impeller is jammed at a point 0.75 R from the center. Unless otherwise specified a safety factor of 1.5 shall be taken on the motor rating to work out pull out torque for calculating the stresses as per maximum shear strain energy theory. The maximum stress thus calculated shall be limited to yeild stress of shaft material at tank design temperature.
IV.	Shaft runout shall be limited to a maximum value of 0.05mm at the face of the stuffing box/seal
V.	In assembled condition the maximum shaft runout at free end shall be limited to 1.0mm/ meter of overhung length of the shaft (measured from the nearest bearing/ seal face end)
VI.	There shall be a separation margin of minimum 20% between the critical speed and any operating speed.
D)	BEARING & BEARING HOUSING IN GEAR BOX
I	Bearing shall be of rolling type radial and thrust bearing (FAG/SKF/Timken make only) as required. Thrust bearing shall be sized for continuous operation under all specified condition.
II	Thrust bearing shall provide full load capability if the Agitator’s normal direction of rotation is reversed. Up-thrust and Down-thrust load must be taken into account in sizing bearing. Life of the every anti-friction bearing, used in the bearing housing as per manufacturer’s design, should have L10 of 25000 hr (minimum).
III	Bearing housing should be grease/oil lubricated. If bearing is oil lubricated, constant–level sight-feed oiler of 100cc size or bigger capacity is to be provided. Bearing housing should have oil drain, constant oil level indicator. A provision of one(1) numberG1/2” thread(ISO-228,Part-1)port is

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

	required for remote control of temperature of bearing housing oil bath RTD.
IV	If bearing housing requires cooling water, volume and pressure of cooling water is to be indicated in Technical Data Sheet.
V	Lubricating oil will be the responsibility of Gear Box manufacturer. Hence, manufacturer has to make arrangement of first fill of oil at installation and at commissioning stage. Quantity of oil and its grade is to be indicated in Drawing and Operation Manual.
E)	MATERIALS
I	Agitator components designated as “Full Compliance Material” shall meet the requirements of the industry specification as listed for the material in the table as well as in the specification in the respective section.
II	A detail quality plan is to be submitted along with offer for all items
III	Final acceptance of the quality plan will be approved by ultimate user (hereafter called NTPC). Comments, if any, given by NTPC during detail engineering, shall be incorporated by bidders without any price implication. QAP should be as per the best practice followed internationally to avoid any conflict of interest.
F)	DRIVER (MOTOR)
I	Driver shall be sized to meet all specified operating conditions including bearing housing , seal, external gear box and coupling loss(if any).
II	Motor shall be able to accelerate to speed at reduced voltage and frequency as specified in “Site Power Supply Condition” as per Clause: 3.1.
III	It should meet the electrical specification (SECTION-C, SUBSECTION-C3.
G)	GEAR BOX
I.	Gear box should be vertical flange mounted solid shaft type (Vertical Agitators), reducing speed type, specially designed for the requirement of Slurry mixing and to be manufactured by the Agitator supplier. Complete up-thrust and down-thrust, developed by Agitator shall be taken by thrust bearing housing of Gear Box. An auxiliary slow drive provision shall be provided in the Gear Box so that slurry is always kept in dynamic condition to avoid settling of slurry at bottom, in the event of Agitator is not operating at its rated speed. Rating of at Gear box shall be at least 1.5 times the rated torque of Agitator.
II.	The reduction unit shall be procured from a reputed manufacturer and shall confirm to BS:721 (latest edition)/AGMA/Equivalent specification. The sub-vendor of the gear-box shall be approved by NTPC during contract execution.
III.	Gear drives shall have splash type oil lubrication. If oil pumps are used, they shall be removable for maintenance without disturbing the motor or drive housing.
IV.	The gear reduction unit shall always be provided with an oil drain, a breather and oil level gauge. The lubrication to be designed keeping in view that the temperature within the bearing should not exceed 85 Deg.C.
V.	Drive housings shall be fabricated steel (fully stress relieved after welding) or of fine grain cast iron.
VI.	The bidder shall provide an easily accessible oil level gauge and a dipstick that will indicate oil level under standstill and operating conditions.
H)	COUPLING & COUPLING GUARD
I.	Coupling and coupling guard should be supplied between driver and driven equipment.
II.	Coupling should be designed taking into consideration adequate service factor.
III.	Design rating of the coupling (excluding service factor) should be indicated in data sheet.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

IV.	Coupling must be having locking screw so that it does not slide over shaft in due course operation.
V.	Vertical Agitators - Coupling between Motor and Gear Box shall be Spacer-type flexible coupling, made of Cast Iron. Spacer length shall be of sufficient length so than Motor and Gear Box shall be able to run independently at no-load condition by detaching the respective coupling.
VI.	It is desirable that for servicing of seal, coupling half should not be removed. Coupling should be dynamically balanced to Gr: G6.3, ISO-1940.
VII.	Removable coupling guard shall conform to the requirements of all applicable national, industrial or statutory regulations.
I) PLATE AND FASTENING BOLTS	
I.	Base plate shall be interpreted as the component of Agitator assembly through which the whole load will be transmitted to the Sole Plate/Nozzle over which the equipment will be mounted. The Base plate shall be fabricated with mild steel of structural quality (UTS=42N/sq mm minimum) with anti-corrosive paint of sufficient dry-film thickness.
II.	Base plate must have provision of leveling on its intended mounting place. Nozzle is not in the scope of supply of Agitator manufacturer. It should be noted that Nozzle will be rubber lined to prevent any leakage of corrosive gases
III.	Alignment between Gear Head Shaft and Agitator shaft shall be within the permissible limit of Gear Box. Similarly, misalignment between Motor shaft and Gear Box Shaft shall be within 0.050 micron (radial) and 2 degree (angular) or better as per requirement of Motor and Gear Box
IV.	Sole plate with desired number of hole shall be provided by the bidder, will be machined on one side. Sole Plate shall be welded to the structure after leveling, as recommended by Agitator manufacturer and rubber lining is completed before placing the equipment in its desired location.
J) OTHER COMPONENTS	
I	All fasteners used in wetted condition must be of Alloy 926 or better material so that even if it comes in contact with liquid by swelling of rubber, thread remains unaffected. Raw material of fastener must undergo Inter-granular Corrosion test as per ISO-3651, Part-1 for Nitric Acid test.
II	Wherever required, the bidder shall provide mounting stool for agitator unit. It shall house the shaft coupling, the bearing housing, the seal and the auxiliary coupling as applicable.
III	The lantern stool shall be designed to provide adequate accessibilty for ease of erection and maintenance. The stool shall be either in standard ERW construction as per IS: 1978 or shall be fabricated from IS: 2062 Gr.B plate. Plugged holes shall be provided at proper locations to drain the oil which may get collected in the stool due to improper functioning of gear box, oil seal etc.
IV	Mounting flange dimensions shall be as per ASME B16.5 upto 600 Nb, ASME B 16.47 for more than 600 NB.
V	Rubber Lining (As Applicable) a) Rubber lined surfaces shall utilize 6 mm nominal thickness chlorobutyl rubber. b) Areas of high wear (e.g. leading edges on impeller blades) shall have an additional 6 mm of rubber for abrasion protection. c) No field-applied linings are permitted except for file patch kits.
GENERAL REQUIREMENT OF SIDE ENTRY AGITATORS:	
I.	All Agitators shall be designed for continuous operation.
II.	The Material of Construction (MOC) of side entry Agitators shall be as per CI 3.0
III.	It should be of Flange mounted type.
IV.	Nozzle size, on which Agitator shall be mounted, shall have enough opening to Insert rotating assembly from side. Vendor to provide the nozzle and flange along with the agitator.
V.	The Bidder to consider Gypsum Sedimentation during stoppage of Agitator.

		TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS		SPECIFICATION No: PE-TS-467-571-18000-A001	
				SECTION-I, SUB-SECTION-C1	
				REV. 00	
				Date: May, 2020	
VI.		The following information to be provided along with the bid: a) Impeller Diameter b) Impeller Speed c) Agitator Pumping Capacity (m^3/min) d) Volume per Agitator:			
		GENERAL REQUIREMENT OF TOP ENTRY AGITATORS IN OTHER SLURRY TANKS & DRAIN PITS:			
I.		All Agitators shall be designed for continuous operation.			
II.		The Material of Construction (MOC) of Top Entry Agitators shall be as per CI 3.0			
III.		It should be roof mounted.			
IV.		Agitators shall be vertical mounted type and shall be driven by motor with reducing speed gear box of rigid type, solid shaft coupling between gear box and agitator and flexible coupling of spacer type coupling between Motor and Gear Box. Both Gear Box and Motor should be vertically/horizontally flange mounted type with a common frame of the whole equipment. The entire thrust load of agitator should be transmitted to the thrust bearing of Gear box.			
V.		Nozzle size, on which Agitator shall be mounted, shall have enough opening to Insert rotating assembly from top.			
VI.		Cable entry to the Motor terminal box should preferably be from top when motor is vertically mounted at its position and it should be easily accessible.			
VII.		Impeller should be dynamically balanced to Gr: G16: ISO-1940 after rubber lining of shaft.			
5		GENERAL REQUIREMENTS			
1		Metric unit shall be used in the drawings and in the any displays on the equipment's. Special attention should be taken that the unit of pressure shall be in dual scales of kPa and kg/cm2G. For instance the pressure gauges should have dual unit's indication.			
2		Descriptions in the drawings, in the documents, and in the displays shall be in English			
3		All rotating parts such as coupling shall be covered with suitable protective guards. Guards shall be easily removable type.			
4		The equipment shall be designed to withstand the corrosive and moist environment in which these are proposed to operate.			
5		Noise level produced by any rotating equipment individually or collectively shall not exceed 85 dB measured at a distance of 1.0 meters from the source in any direction and 1.5m above operating floor.			
6		The overall vibration level shall be as per ISO 10816.			
7		Suitable drain connections shall be provided.			
8		The equipment shall be suitable for stable operation continuously.			
9		Corrosion allowance: Corrosion allowance for entire equipment shall be in accordance with latest applicable Indian / International standard.			
10		Unless otherwise specified , flanges shall be in accordance with ANSI B16.5 Class 150			
11		Name plate: All equipment shall be provided with nameplates indicating the item number and service name. Name plates shall be of 304 Stainless steel plate and placed at a readily visible location. Nameplate of main equipment shall have enough information, which will be confirmed during engineering phase. Stainless steel nameplates for all instruments and valves shall be provided.			
12		Rotation arrows shall be cast in or attached with stainless steel plate on each item of rotation equipment at a readily visible location.			

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	
13	Unless otherwise specified, all equipment items where the weight exceeds 15 kg shall be provided with suitable lifting lugs, ears or ring bolts or tapped holes for lifting rings. Minimum shock factor for lifting lugs shall be minimum 2.0. The position of lifting lugs and reference dimension shall be shown on GA and/or outline drawings. NDT shall be conducted for lifting lugs. When any spreader bars are required for lifting and laydown, the bidder shall provide spreader bar with equipment.		
14	Skid Mount/Transportation: Equipment shall be fabricated as skid mount design as much as practical to minimize erection at the site.		
15	If the driver/driven equipment train is in the resonance condition or any vibration problems occur, the bidder shall solve the problems in a timely manner.		
16	Bidder shall provide the necessary gaskets.		
17	All the surfaces of the carbon steel should be rust prevented before shipment for the period of at least 12 months for storage and construction.		
18	Bidder to provide capacity of hoist required for material handling and the details of heaviest component to be handled. Bidder shall provide a typical arrangement/drawing of the handling arrangement.		
19	The list of all Bought out items with makes and country of origin to be mentioned along with offer to be submitted.		
20	Cost towards the participation in discussions/meetings, providing technical assistance during technical discussions/meetings with customer for approval of drawing/documents etc. TA/DA, boarding and lodging to attend these meetings shall be borne by the bidder and shall be inclusive in supply portion.		
21	Material of construction for all equipment/components shall be subject to NTPC/ BHEL approval during detail engineering. Accordingly bidder shall consider MOC for all equipment/component (complying tender specifications), as per best engineering practice, global standard and global references, in case no MOC is available in specs.		
22	Bidder to provide sub vendor list and Bidder shall strictly adhere to NTPC approved vendor list (reference list is included in SUB-SECTION-C1F). In case bidder proposes an additional vendor for an item or vendor approval is required for any new item, acceptance shall be subject to approval by NTPC/ BHEL before placing order and bidder shall submit relevant documents to take up with NTPC for approval.		
23	It shall be the complete responsibility of the successful bidder to obtain “Sub Vendor Approval” from BHEL / NTPC for all equipment’s & components. Any delay in sub vendor’s approval should not affect the project schedule. If any of the sub vendors does not have the approval of NTPC/ BHEL, the same may be replaced with another NTPC/BHEL approved sub-vendor only, without any price implications to BHEL.		
24	The modalities of inspection (Stage, Final, In-process) shall be finalized during detail engineering after submission of quality assurance plan (QAP). It shall be reviewed by the NTPC and BHEL. Bidder shall follow the procedures of inspection as per the approved QAP. Bidder has to submit the following documents along with inspection call and if any other documents required as per approved QAP. - Raw material inspection certificate - Internal test reports - Statutory certificates as required. - All inspection & testing shall be carried out based on the following documents: a. Relevant Standards b. Specifications c. Approved drawings d. Data Sheets e. Calibration certificate for all the measuring instruments		

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

25	During detail engineering, bidder to strictly adhere to BHEL/NTPC drawing formats, document numbering, quality plan & FQP formats
26	The identification and numbering of equipment, systems, items, etc. of supply, as well as of all documents and drawings shall be in accordance with reference Designation System for Power Plants - KKS system.
27	Complete detail engineering drawings, calculations, selection of components etc. shall be reviewed & subject to approval of BHEL/NTPC during detail engineering
28	Bidder shall furnish necessary inputs & drawings of all equipment in editable Auto CAD/ MS-Word /Excel format.
29	During detail engineering, successful bidder shall ensure flow of drawings/documents as per schedule. Any comments from BHEL/NTPC should be addressed timely by the bidder.
30	Bidder to note above mentioned points not exhaustive and any work /items required for completing the smooth operation and ensuring satisfactory running of the machines till final hand over to the end user shall also be in the scope of the bidder.
31	Bidder shall provide design support to assist the Purchaser in efficiently integrating the furnished equipment. Design support specifically includes: • Bidder shall verify/ validate the number and location of agitators to keep material in suspension. • Static and dynamic loading information and requirements for agitator support design (applicable for top & side type)
6	PACKING AND FORWARDING
1	Proper packing to be ensured. Indigenous Supply: Agitator & sub system assembly shall be wrapped in polythene bags & packed in a strong rigid wooden crate. Rain water should not enter into the Agitator internals during storage in the outer yard of power plant. Further the packing shall be done in line with requirements mentioned in point no. 2 to 20 of this section. Imported Supply: All imported supply should be packed as per Sea worthy packing standards as per Sub-Section C-1G. All imported items should have Sea worthy packing. Liberal packing materials and struts shall be provided to arrest rolling and to protect from transit damages.
2	Equipment and process materials shall be packed and semi-knocked down, to the extent possible, to facilitate handling and storage and to protect bearings and other machine surfaces from oxidation. Each container, box, crate or bundle shall be reinforced with steel strapping in such a manner that breaking of one strap will not cause complete failure of packaging. The packing shall be of best standard to withstand rough handling and to provide suitable protection from tropical weather while in transit and while awaiting erection at the site.
3	Equipment and materials in wooden cases or crates shall be properly cushioned to withstand the abuse of handling, transportation and storage. Packing shall include preservatives suitable to tropical conditions. All machine surfaces and bearings shall be coated with oxidation preventive compounds. All parts subject to damage when in contact with water shall be coated with suitable grease and wrapped in heavy asphalt or tar impregnated paper.
4	Crates and packing material used for shipping will become the property of owner (NTPC).
5	Packaging or shipping units shall be designed within the limitations of the unloading facilities of the receiving ports and the ship will be used. It shall be the bidder’s responsibility to investigate these limitations and to provide suitable packaging and shipping to permit transportation to site.
6	Packing (tare) shall be part of the equipment cost and shall not be subject to return. The packing should ensure integrity and cohesiveness of each delivery batch of equipment during transportation. In case of equipment assemblies and unit’s delivery in the packing of glass, plastics or paper the

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

	specification of packing with the material and weight characteristics are to be indicated.
7	Each package should have the following inscriptions and signs stenciled with an indelible ink legibly and clearly: a. Destination b. Package Number c. Gross and Net Weight d. Dimensions e. Lifting places f. Handling marks and the following delivery marking
8	Each package or shipping units shall be clearly marked or stenciled on at least two sides as per the dispatch instruction givens during the contract. In addition, each package or shipping unit shall have the symbol painted in red on at least two sides of the package, covering one fourth of the area of the side.
9	Each part of the equipment which is to be shipped as a separate piece or smaller parts packed within the same case shall be legibly marked to show the unit of which it is part, and match marked to show its relative position in the unit, to facilitate assembly in the field. Unit marks and match marks shall be made with steel stamps and with paint.
10	Each case shall contain a packing list showing the detailed contents of the package. When any technical documents are supplied together with the shipment of materials no single package shall contain more than one set of such documents. Shipping papers shall clearly indicate in which packages the technical documents are contained.
11	The case number shall be written in the form of a fraction, the numerator of which is the serial number of the case and the denominator the total number of case in which a complete unit of equipment is packed.
12	Wherever necessary besides usual inscriptions the cases shall bear special indication such as “Top”, “Do not turn over”, “Care” , “Keep Dry” etc. as well as indication of the center of gravity (with red vertical lines) and places for attaching slings (with chain marks)
13	Marking for Safe handling: To ensure safe handling, packing case shall be marked to show the following: a. Upright position b. Sling position and center of Gravity position c. Storage category d. Fragile components (to be marked properly with a clear warning for safe handling)
14	Each crate or package is to contain a packing list in a waterproof envelope. All items are to be clearly marked for easy identification against the packing List. All cases, packages etc. are to be clearly marked on the outside to indicate the total weight where the weight is bearing and the correct position of the slings are to bear an identification mark relating them to the appropriate shipping documents. All stencil marks on the outside of cases are either to be made in waterproof material or protected by shellac or varnish to prevent obliteration in transit.
15	The packing slip shall contain the following information: - Customer name, Name of the equipment, Purchase Order number with Date, Address of the delivery site, Name and Address of the Sender, Serial Number of Agitator, BHEL item Code, Gross Weight and Net weight of Supplied items.
16	Prior to transport from manufacturer’s work to destination, components of the unit shall be completely cleaned to remove any foreign particles. Flange faces and other machined surfaces shall be protected by an easily removable rust preventive coating followed by suitable wrapping.
17	All necessary painting, corrosion protection & preservation measures shall be taken as specified in painting schedule. Supplier shall consider the coastal environment zone which is defined as “very

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

	severe” during final finishing/shipping.
18	Successful bidder shall furnish the detail packing /shipment box details with information like packing box size, type of packing, weight of each consignment, sequence no. of dispatch, no. of consignment for each deliverable item against each billing break up units/ billable blocks. Without these details the BBU shall not be approved during detail engineering.
19	All items/equipment shall be dispatched in properly packed condition (i.e. no item shall be dispatched in loose condition such that it becomes difficult to store/identify its location at site at a later stage).
20	Cases which cannot be marked as above shall have metal tags with the necessary markings on them. The metal tags shall be securely attached to the packages with strong steel binding wire. Each piece, Skid, Case or package shipped separately shall be labelled or tagged properly.
8	SUPERVISION OF ERECTION, TESTING AND COMMISSIONING
1	The erection of Agitators will be done by owner, based on Erection Manual and check List to be provided by the bidder during detail engineering. However, the bidder shall make visit as per enquiry/PO for the supervision of erection, pre-commissioning & post- commissioning check-up, start-up, testing and trial runs of all the items covered under the scope of supply & Services.
2	The bidder will be informed well in advance for the visit.
3	BHEL shall submit fabrication dwgs to successful bidder for review and approval. Successful bidder to furnish its observations on fabrication dwgs. within 7 days of dwgs submission. The cost for the same shall be included by bidder in its offer.
4	Price comparison for evaluating the lowest bid will be considered all main supply, supervision of E&C charges and mandatory spares price all together.
5	Scope of Supervision for Erection & commissioning: Tentatively following visits shall be planned by site team which shall be as follows: - - Three visits (for all agitators) of 20 days each for supervision for erection, pre-commissioning & post- commissioning check-up, start-up, testing and trial runs of all the items covered under the scope of supply & Services. - Two visits of 10 days each (for all agitators) for performance demonstrations and handing over of system. - Any additional visit as per requirement of BHEL site office during erection of equipment.
6	Any other service required for making the installation complete in all respect within battery limits and for satisfactory erection & commissioning of the system shall be in bidders scope.
9	EXCLUSION
	The following work associated with the Agitators will be by others: a. Access, Walkways, platforms and ladders b. Handling equipment (hoist) along with the handling arrangement. However, bidder shall provide the details of the same to BHEL. c. Baffle plates d. Agitator mounts/supports except as specifically identified above e. Foundations f. Receiving, unloading, and storage at the project site g. Installation, however, supervision of erection and commissioning shall be in bidder’s scope h. Support steel structure for top entering agitators
10	INSPECTION AND TESTING
1	The General inspection requirements to be considered are as below:
2	Bidder shall furnish written copies of shop production, fabrication and quality test procedures and drawings to be used on the Agitators for review by BHEL/NTPC prior to manufacture.
3	The Bidder shall furnish performance test procedure along with standard. The test procedure will be reviewed and approved by the BHEL/NTPC.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	
4	Since there is no standard for “Acceptance Test Procedure” for Agitator, Agitator manufacturer is to submit a test procedure and Quality Plan, clearly indicating that equipment will meet the desired parameter.		
5	Power consumption at motor terminal and vibration of equipment will be conducted at site. Vendor to indicate other material tests that are to be conducted as per their practice in their Quality plan.		
6	No liquid should enter the tube through any flange joint. “O”-ring used in the flange joint will deteriorate at a highly chlorinated and acidic environment of medium at a maximum operating temperature unless right quality of rubber is used. Hydrostatic testing of tube assembly is required at a pressure of twice that of maximum liquid column in any tank or 30m whichever is higher. The hydro test duration will be for a minimum of 1 hr to check sweating at any flange. Hydrostatic test is meant in part for a check of equipment joint at new condition only. It is cannot be considered as a guarantee of functional objective of rubber used.		
7	Mechanical Run Test (in air) Each Agitator unit shall be given a 4-hour mechanical run test in air at vendor's shop. Agitator unit shall be mounted in the same manner as it will operate in the field. During this test the record shall be made of: a) Shaft run out at free end. b) Dynamic shaft deflection adjacent to the mechanical seal/packing/vapour seal. c) Gearbox oil temperature and temperature of bearing housing in stool. The temperature of the gear box oil shall not exceed ambient plus 40 Deg.C and that of bearing housing shall not exceed from room temperature plus 20 Deg.C after temperatures have stabilized. d) Bearing Housing vibration checks shall be carried out. maximum acceptable vibration velocity shall be 6 mm/sec. e) Noise level shall be checked and shall be within the specified limits mentioned in the specification. f) Agitator shaft RPM and motor RPM. g) Check of satisfactory operation of shut off and retracting arrangement.		
8	As a part of the Quality Assurance Plan, bidder has to demonstrate the power consumption of each agitator at shop with the available fluid along with relevant calculation to establish the correlation with the slurry used for the project.		
9	Acceptance Test (at Site) After the agitator has been installed at site and is ready for test, vendor shall depute his representative to supervise the site acceptance test		
10	DYNAMICS		
10.1	CRITICAL SPEED		
10.1.1	Operation speed of the Agitator motor shall be at least 25% below the first critical speed		
10.1.2	Additional to the requirement of the critical speed of Agitator, as specified above. Agitator manufacturer is to analyze the torsional critical speed of combined system of Agitator, Gear Box and Motor to establish there is a separation margin of minimum 20% between the torsional critical speed (dry/wet) and any operating speed.		
10.2	VIBRATION SEVERITY		
10.2.1	During performance test, unfiltered vibration measurements shall be made with running of Agitator in Air. Measurement shall be taken on the Gear Box thrust bearing housings as well in motor top.		
10.2.2	Guaranteed Site vibration of the equipment on its own pedestal, at commissioning with normal level of liquid and with maximum liquid at respective tank, Vibration limit at site will be as per ISO-10816, and 1.5-2.3mm/sec even if Motor rating falls below 15kw.		
10.2.3	Vibration measurements of bearing housing shall be made in root mean square (RMS) velocity.		
10.2.4	Vibration levels measured on the non-rotating parts shall not exceed the zone limit “B” as defined in ISO 10816 at steady conditions and shall not exceed the zone limit “C” as defined in ISO 10816 at transient conditions.		

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

11	For surfaces with rubber lining Welding shall be visually inspected to verify the absence of rough area and unacceptable transition between surfaces which prevent the adequate adherence of rubber. The acceptance criteria shall be as per latest standard.
12	For surfaces with rubber lining, degree of cleaning shall be visually checked before the application of the coating. There must be no area with oxidation, dirt or partially or generalized corrosion defects.
13	Test certificates shall be issued for each lot of raw material used in the coating, corresponding to specific weight and traction resistance.
14	For surfaces with rubber lining, adherence test shall be conducted on production samples. Adherence test shall be conducted on the actual surface through hammering. In order to verify the absence of air packets (or) surface without adherence.
15	For surfaces with rubber lining, Coating thickness shall be checked at 100%. A High voltage porosity test will be conducted on 100 % of the coated surface.
16	Out of all Agitators One Number of each type will be inspected at the Bidder’s works before dispatch or where the test facilities are available.
17	The Bidder shall conduct performance test for the remaining Agitators and submit the reports.
18	Contract shaft mechanical seals shall be used during shop tests, unless the seal design is unsuitable for the shop-test condition, if applicable.
19	Agitators shall not be released for shipment, until shop tests data and performance tests curves have been approved by Owner.
20	Bidder should furnish performance guarantee as per applicable standard guarantee for the design, manufacture, material and safe operation of the equipment.
21	Bidder to arrange all calibrated gauges, Instruments during inspection.
22	Mechanical running and the performance test shall be carried out. Bidder to arrange Motor of same / higher rating for the shop test and inspection.
11	PAINTING
	Please refer painting specification (SECTION-C, SUB-SECTION-C2C)
12	SPARES,TOOLS & TACKLES
	Bidder shall supply a set of special tools and tackles required either for erection or operation or maintenance of the agitator units. A list of such tools shall be submitted by bidder along with the offer.
	Any special tools & tackles required for the entire equipment to disassemble, assemble or maintain the units, they shall be included in the quotation and furnished as part of the initial supply of the machine. List of special tools & tackles shall be decided by bidder as per his proven practice. When special tools are provided, they shall be packaged in separate, boxes with lugs and marked as “Special Tools for (tag / item number).”Each tool shall be stamped or tagged to indicate its intended usage. Levers and eye bolts for the removal of parts to be serviced shall be submitted with special tools (SECTION-II Annexure-7).
12.1	START UP & COMMISSIONING SPARES
	Start-up & Commissioning Spares shall be part of the main supply of the Agitators. Start-up & commissioning spares are those spares which may be required during the start- up and commissioning of the equipment/system. All spares required for successful operation till commissioning of Agitator shall come under this category. Bidder shall provide an adequate stock of such start up and commissioning spares to be brought by him to the site for the equipment erection and commissioning. The spares must be available at site before the equipment’s are energized. The List of such spares to be provided during bidding stage (SECTION-II Annexure-9).

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	

12.2	RECOMMENDED SPARES
	Bidders shall also furnish the recommended spares list along with the offer required for 3 years of normal operation of the plant and should be independent of the list of the mandatory spares. Prices of recommended spares will not be used for evaluation of the bids. The price of these spares will remain valid up to 6 months after placement of Notification of Award for the main equipment.
12.3	MANDATORY SPARES:
	Bidder to quote for the mandatory spares as per the Mandatory Spare list given for a specific project (SECTION-I, SUB-SECTION-D Annexure-II). Bidder shall quote for the “Mandatory Spares Part List”, and it will be considered for L1 evaluation. Mandatory spare parts items shall be handed over separately and shall not be mixed with the supply of the main equipment parts. Spares shall be sent in pre-decided lots in containers/secure boxes. All boxes/containers are to be distinctly marked in red color with boldly written “S” mark on each face of the containers. Spares shall not be dispatched before dispatch of corresponding main equipment’s. Each item shall be labelled in English and be packed against damage and sealed to prevent deterioration from corrosion. The protection shall be sufficient for a minimum of 10 years’ storage in a dry weatherproof building. All spares supplied under this contract shall be strictly inter-changeable with the parts for which they are intended for replacements. All the mandatory spares shall be manufactured along with the main equipment components as a continuous operation as per same specification and quality plan. Any special tools & tackles required for the entire equipment to disassemble, assemble or maintain the units, they shall be included in the quotation and furnished as part of the initial supply of the machine. List of special tools & tackles shall be decided by bidder as per his proven practice. When special tools are provided, they shall be packaged in separate, boxes with lugs and marked as “Special Tools for (tag / item number).” Each tool shall be stamped or tagged to indicate its intended usage. Levers and eye bolts for the removal of parts to be serviced shall be submitted with special tools.
12.4	FIRST FILL OF CONSUMABLES
I	Bidder’s scope shall include supply and filling of all chemicals, lubricants, grease, filters and consumable items for operation up to commissioning including top up requirements. All lubricants proposed for the plant operation shall be suitable for all operating and environmental conditions that will be met on site consistent with good maintenance procedures as instructed in the maintenance manuals.
II	Bidder shall also supply a quantity not less than 10% of the full charge of each variety of lubricants, servo fluids, gases, chemicals etc. (as applicable) used which is expected to be utilized during the first year of operation. This additional quantity shall be supplied in separate containers.
III	Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals including items qualities and quantities required per month of the plant operation for the NTPC/BHEL’s approval herein shall be furnished within 2 months of placement of Order. On completion of erection, complete list of bearings/equipment giving their location and identification marks shall be furnished to BHEL along with lubrication requirements. All types of chemicals, consumables, lubricants and grease shall be readily obtainable locally and the number of different types shall be kept to a minimum. For each type and grade of lubricant recommended, bidder shall list at least three equivalent lubricants manufactured by alternative companies.
14	PERFORMANCE GUARANTEE
	All performance tests for Agitators shall be carried out in accordance with any latest international codes/standards. Bidder shall furnish Performance guarantee for the design, manufacture, material, safe and trouble-free operation of the Agitators and its accessories. The Bidder shall ensure a design of the equipment to achieve an average target availability of 98% for 120 days and average target availability of 95% for 1 year. Noise level ≤85 dB (A) at 1m horizontal distance from equipment/enclosures and 1.5m above operating floor is to be guaranteed.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C1	
		REV. 00	
		Date: May, 2020	
		Vibration levels measured on the non-rotating parts shall not exceed the zone limit “B” as defined in ISO 10816 at steady conditions and shall not exceed the zone limit “C” as defined in ISO 10816 at transient conditions. Acceptance tests to be carried out as per the procedure defined by the bidder which shall be submitted for BHEL/ NTPC approval. In the event that the performance test is unsuccessful, bidder shall take necessary remedial action at his cost and the performance test shall be repeated.	
14	DOCUMENTATION		
A	DOCUMENTS TO BE SUBMITTED ALONG WITH THE OFFER		
	The Bidder shall submit all documents, drawings, diagrams and all such information, which are necessary to fully understand the offer for techno – commercial Offer. Vendors are requested to comply with above in all respect. List of such documents have been indicated in (SECTION-II Annexure-1).		
B	DOCUMENTS TO BE SUBMITTED AFTER AWARD OF CONTRACT		
	The Successful bidder shall submit necessary data, documents and drawings for review, approval as specified in this specification. Drawings that are reviewed by the NTPC/ BHEL will be returned to bidder with a transmittal letter with any comments and / or questions marked on the drawings or noted in the letter. All comments and questions must be resolved before a resubmission of drawings / documents. If the design has not developed enough to resolve some of the comments or questions, bidder shall place a “hold” on those items or areas of design. NTPC/ BHEL reserves the right to return drawings unprocessed to bidder if there exists any evidence that bidder has not acknowledged all comments and questions. All necessary GA drawings, sections, sub-assembly drawings, specifications of main and sub components and necessary set of operation & maintenance manual as asked by NTPC must be furnished by bidder in soft and hard copy forms. For all documents softcopy format shall be searchable pdf, however in addition all drawings, diagrams shall be supplied in ACAD or other editable format and all lists in Excel format. Further break up of technical documents will be discussed during finalization of the purchase contract. All documents in hard and soft form are to be submitted in the English language. Electronic Copies shall be submitted in primary original data format (e.g. DOC, XLS, DWG) as well as in a printable non-proprietary document format (e.g. PDF). Especially P&IDs shall be submitted as DWG files and PDF files. Bidder to ensure submission of hard copies as per NTPC requirement for all engineering drg/doc and for all subsequent revisions along with a soft copy through email to concerned project team. The list of such drawing/documents have been indicated in (SECTION-I,SUB-SECTION-D Annexure-IV).		
15	LIST OF REFERENCE DRAWINGS BY BHEL		
I	The drawings specified in in Annexure-III, Sub-Section-D of Section-I are being provided along with the tender specification for estimation and calculation purpose of the bidder.		
16	BID EVALUATION CRITERIA FOR POWER CONSUMPTION		
I	Bidder is required to quote Guaranteed power consumption (GPC) in GPC format attached with the price schedule, declaring GPC value in KW. The power consumption values indicated by the bidders shall be used for bid evaluation. In case of any mis-match in the GPC values in the price and un-priced bids, the GPC figure in the un-priced bid shall be considered for evaluation.		

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C2-A	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

CUSTOMER SPECIFICATION:
TECHNICAL REQUIREMENT

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	and shall be proven in similar application.		
9.06.00	The pumps shall not be supported below the base plate level for easy withdrawal without entering the sump.		
10.00.00	SLURRY & PROCESS WATER TANKS		
10.01.00	All the slurry tanks (Slurry Tanks, Filtrate Tank, Secondary hydro cyclone feed tank, vacuum receiver tank, Waste water Tank, Lime Neutralization tanks etc.) shall be designed, fabricated, erected and tested in accordance with the IS:803, latest edition. Additional Corrosion allowance of 1.5 mm on the minimum tank shell thickness as calculated by IS:803, latest edition shall be provided by the Contractor. Tanks shall be made from IS:2062 quality mild steel plates of tested quality. The tanks shall be of welded construction. Interior surface of the tanks shall be lined with the following: Wastewater tank, Filtrate tank, Secondary hydro cyclone feed tank: Vinyl Ester based flake glass lining of minimum 3 mm thickness Slurry tanks: Replaceable Chlorobutyl/ Bromobutyl rubber lining of minimum 4 mm thickness The outside surface of the tanks shall be coated with paint as approved by the Employer. Coarse-screen(s) at suction-side of slurry recirculation pumps shall be provided.		
11.00.00	AGITATORS		
11.01.00	Agitators shall be supplied in tanks and vessels to prevent caking and settlement of particles out of the slurry, e.g. in the absorber vessel, limestone mill recycle tanks, limestone slurry tank, Auxiliary Absorbent tank, and sumps etc.		
11.02.00	All agitators shall be designed for continuous operation unless otherwise specified. Horizontal agitators shall be used for Absorber. Vertical agitators can also be used for Absorber, if it is only the standard & proven practice of the Contractor for the offered Absorber design. In other vessels and tanks vertical agitators are also acceptable if they are of proven make and the Bidders standard practice which can be proven by means of suitable references. The design of the agitators shall be of proven type.		
11.03.00	Standard type agitators with suitable characteristics shall be used wherever practical. The agitators shall be complete with motor, gearbox, agitator shaft, coupling, safety guards, mechanical seal (for side entry agitators), impeller, support legs, agitator mounting flange including bolts nuts and gasket etc.		
11.04.00	All agitator parts and accessories in contact with the stirred fluid shall be constructed of materials specifically designed for the conditions and nature of the stirred fluid and be resistant to erosion and corrosion.		
11.05.00	The material for the shaft (which is continuously in contact with slurry) and agitator		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109(3)-9	PART-B SUB-SECTION-I-M1 (FGD) PAGE 32 OF 51

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	blades of the Absorber Agitators shall be made with Alloy 926 or better material. For Agitators in other tanks, agitator blades shall be made with Alloy 926 or better material & shaft can be rubber lined. This does not release the Contractor of the responsibility for selecting the correct materials.			
11.06.00	Each agitator and its associated equipment shall be arranged in such a manner as to permit easy access for operation, maintenance and agitator removal without interrupting plant operation. It shall be possible to remove the sealing devices of the Agitators of the absorber vessel without having to drain completely the absorber.			
11.07.00	To prevent mechanical blocking load start-up after standstill of pumps, piping and agitators for slurries shall be applied with C-hose connection.			
11.08.00	Lifting lugs and eyes and other special tackle shall be provided as necessary to permit easy handling of the agitators and their components.			
11.09.00	Static and dynamic (as far as applicable) balancing of all agitators shall be carried out after assembly.			
11.10.00	All agitator parts and components shall be designed and calculated for fatigue life, considering maximum bending loads, induced by fluctuating hydraulic forces and torsional loads, based on the installed motor power. For side entry agitators the alternating bending moment resulting from impeller and shaft weight has to be considered additionally.			
11.11.00	All exposed moving parts shall be covered by guards.			
11.12.00	Side entry agitator shall be flange mounted.			
11.13.00	The shape of the impeller blades of side entry agitators shall be designed to avoid wear on the impellers which will affect the agitator performance as specified for a minimum period of 2 years of continuous operation under design conditions for the range of coal & limestone specified in the specification. In order to avoid excessive wear impeller tip speeds must not exceed 12 m/s.			
11.14.00	Belt drives (if applied) shall be properly designed to provide a minimum lifetime of 2 years under design conditions			
12.00.00	SLURRY LINES AND VALVES			
12.01.00	Slurry pipes shall be designed to keep the velocity above the settling velocity under all operating conditions. The contractor may provide a recirculation line with motorized isolation valve / restriction orifice made of erosion resistant material for the above purpose.			
12.02.00	All the pipes handling slurry shall be provided with replaceable rubber lining of proven quality. The Contractor can provide slurry pipes of size lower than 300 NB made up of FRP material (silicon carbide coating on slurry exposed surface) if it has previous experience of providing the same. Outer surface of the pipes should be fire retardant.			
12.03.00	The isolation valves provided in all the slurry lines shall be of knife gate type/butterfly			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI BID DOC. NO.: CS-0011-109(3)-9	PART-B SUB-SECTION-I-M1 (FGD)	PAGE 33 OF 51

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C2B	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

CUSTOMER SPECIFICATION: GENERAL TECHNICAL REQUIREMENTS



GENERAL TECHNICAL REQUIREMENTS

PART - C

CONTENTS

Clause No.	Description	Page No.
1.00.00	Introduction	1
2.00.00	Brand Name	1
3.00.00	Base Offer & Alternate Proposals	1
4.00.00	Completeness of Facilities	1
5.00.00	Codes & Standards	2
6.00.00	Equipment Functional Guarantee	4
7.00.00	Design of Facilities/ Maintenance & Availability Considerations	5
8.00.00	Documents, Data and Drawings to be furnished by Contractor	5
9.00.00	Technical Co-ordination Meeting	21
10.00.00	Design Improvements	22
11.00.00	Equipment Bases	22
12.00.00	Protective Guards	22
13.00.00	Lubricants, Servo fluids and Chemicals	23
14.00.00	Lubrication	23
15.00.00	Material of Construction	23
16.00.00	Rating Plates, Name Plates & Labels	23
17.00.00	Tools and Tackles	25
18.00.00	Welding	25

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(3)-9
--	--



Clause No.	Description	Page No.
19.00.00	Colour Code for All equipments/Pipings/PlpeServices	25
20.00.00	Protection and Preserveative shop Coating	25
21.00.00	Quality Assurance Programme	26
22.00.00	General Requirements - Quality Assurance	27
23.00.00	Quality Assurance Documents	32
24.00.00	Project Manager's Supervision	34
25.00.00	Inspection, Testing and Inspection Certificates	34
26.00.00	Pre-commissioning and Commissioning Facilities	37
27.00.00	Taking over	40
28.00.00	Training of Employer's Personnel	40
29.00.00	Safety Aspects during Construction and Erection	41
30.00.00	Noise Level	42
31.00.00	Packaging and Transportation	42
32.00.00	Electrical Equipments/Enclosures	42
33.00.00	Instrumentation and Control	42
34.00.00	Electrical Noise Control	43
35.00.00	Surge protection for solid state equipment	44
36.00.00	Instrument Air System	44
37.00.00	Tapping Points for Measurements	44
38.00.00	System Documentation	44
39.00.00	Maintenance Manuals of Electronic Modules	45
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(3)-9



Clause No.	Description	Page No.
	Annexure - I	76
	Annexure - II	77
	Annexure - III	78
	Annexure - IV	79
	Annexure - V	80
	Annexure - VI	81
	Annexure - VII	83
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(3)-9

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
1.00.00	INTRODUCTION This part covers technical requirements which will form an integral part of the Contract. The following provisions shall supplement all the detailed technical specifications and requirements brought out in Section-VI, the Technical Specification and the Technical Data Sheets.			
2.00.00	BRAND NAME Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific item mentioned shall be understood to be indicative of the function and quality desired, and not restrictive; other manufacturer's products may be considered provided sufficient information is furnished to enable the Employer to determine that the products proposed are equivalent to those named.			
3.00.00	BASE OFFER & ALTERNATE PROPOSALS The Bidder's proposal shall be based upon the use of equipment and material complying fully with the requirements specified herein. It is recognised that the Contractor may have standardized on the use of certain components, materials, processes or procedures different than those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered, provided the base offer is in line with technical specifications and such proposals meet the specified design standards and performance requirement and are acceptable to the Employer. Sufficient amount of information for justifying such proposals shall be furnished to Employer alongwith the bid to enable the Employer to determine the acceptability of these proposals.			
4.00.00	COMPLETENESS OF FACILITIES			
4.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant shall be engineered and designed in accordance with the specification requirement. All engineering and associated services are required to ensure a completely engineered plant shall be provided.			
4.02.00	All equipments furnished by the Contractor shall be complete in every respect, with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or those needed for erection, completion and safe operation of the equipment and for the safety of the operating personnel, as required by applicable codes, though they may not have been specifically detailed in the respective specifications, unless included in the list of exclusions. All same standard components/ parts of same equipment provided, shall be interchangeable with one another.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 1 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
4.03.00	For the C&I systems, the Contractor shall be required to provide regular information about future upgrades and migration paths to the Employer.			
5.00.00	RULES, REGULATIONS, CODES & STANDARDS			
5.01.00	In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India, NTPC rules/codes of practices as well as of the locality where they will be installed, including the following: a) Indian Electricity Act b) Indian Electricity Rules c) Indian Explosives Act d) Indian Factories Act and State Factories Act e) Indian Boiler Regulations (IBR) f) Regulations of the Central Pollution Control Board, India g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India h) Pollution Control Regulations of Department of Environment, Government of India i) State Pollution Control Board. (j.) Rules for Electrical installation by Tariff Advisory Committee (TAC). (k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996 (l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998 (m.) Explosive Rules, 1983 (n.) Petroleum Act, 1984 (o.) Petroleum Rules, 1976,			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 2 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
5.02.00	(p.) Gas Cylinder Rules, 1981 (q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981 (r.) Workmen's Compensation Act, 1923 (s.) Workmen's Compensation Rules, 1924 (t.) NTPC Safety Rules for Construction and Erection (u.) NTPC Safety Policy (v.) Any other statutory codes / standards / regulations, as may be applicable. Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply: a) Bureau of Indian standards (BIS) b) Japanese Industrial Standards (JIS) c) American National Standards Institute (ANSI) d) American Society of Testing and Materials (ASTM) e) American Society of Mechanical Engineers (ASME) f) American Petroleum Institute (API) g) Standards of the Hydraulic Institute, U.S.A. h) International Organisation for Standardisation (ISO) i) Tubular Exchanger Manufacturer's Association (TEMA) j) American Welding Society (AWS) k) National Electrical Manufacturers Association (NEMA) l) National Fire Protection Association (NFPA) m) International Electro-Technical Commission (IEC)/European Norm (EN) n) Expansion Joint Manufacturers Association (EJMA) o) Heat Exchange Institute (HEI)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 3 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
5.03.00 5.04.00 5.05.00 5.06.00 5.07.00 5.08.00	p) IEEE standard q) JEC standard Other International/ National standards such as DIN, JIS, VDI, EN, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English. Not used. In the event of any conflict between the codes and standards referred to in the above clauses and the requirement of this specification, the requirement of Technical Specification shall govern. Two (2) English language copies of all national and international codes and/or standards used in the design of the plant, equipment, civil, structural and architectural works shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award. In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the Employer shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of the Employer such changes and advise Employer of the resulting effect. A detailed list of standards apart from those mentioned in the respective detailed specifications in other parts of Section-VI to which all equipment/systems/civil works should conform as indicated in this Part C and elsewhere in the specification.			
6.00.00	EQUIPMENT FUNCTIONAL GUARANTEE			
6.01.00	The functional guarantees of the equipment under the scope of the Contract is given in Section-VI Part - A of Technical Specifications. These guarantees shall supplement the general functional guarantee provisions covered under Defect liabilities Section-IV, General Conditions of Contract.			
6.02.00	Liquidated damages for shortfall in meeting functional guarantee(s) during the performance and guarantee tests shall be assessed and recovered from the Contractor as specified elsewhere in this specification.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 4 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
7.00.00	DESIGN OF FACILITIES/ MAINTENANCE & AVAILABILITY CONSIDERATIONS			
7.01.00	DESIGN OF FACILITIES All the design procedures, systems and components proposed shall have already been adequately developed and shall have demonstrated good reliability under similar conditions elsewhere. The Contractor shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic requirements are detailed out in various clauses of the Technical Specifications. The design of various components, assemblies and subassemblies shall be done so that it facilitates easy field assembly and dismantling. All the rotating components shall be so selected that the natural frequency of the complete unit is not critical or close to the operating range of the unit.			
7.02.00	MAINTENANCE AND AVILABILITY CONSIDERATIONS Equipment/works offered shall be designed for high availability, low maintenance and ease of maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability/ availability and ease of maintenance. The Bidder shall also furnish details of availability records in the reference plants stated in his experience list. Bidder shall state in his offer the various maintenance intervals, spare parts and man-hour requirement during such operation. The intervals for each type of maintenance namely inspection of the furnace, inspection of the entire hot gas path and the minor and major overhauls shall be specified in terms of fired hours , clearly defining the spare parts and man-hour requirement for each stage. Lifting devices i.e. hoists and chain pulley jacks ,etc. shall be provided by the contractor for handling of any equipment or any of its part having weight in excess of 500 Kgs during erection and maintenance activities. Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist / crane shall be provided by the contractor for lifting the equipment and accessories covered under the specification.			
8.00.00	DOCUMENTS, DATA AND DRAWINGS TO BE FURNISHED BY CONTRACTOR			
8.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant and equipment shall be fully integrated, engineered and designed to perform in accordance with the technical specification. All engineering and technical services required to ensure a completely			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 5 OF 83

एनटीपीसी
NTPC

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.03.02	scope of the bidder civil calculation sheets including structural analysis and design alongwith output results. xxvii) Underground facilities, levelling, sanitary, land scaping drawings. xxviii) Geotechnical investigation and site survey reports (if and as applicable). xxix) Model study reports wherever applicable. xxx) Functional & guarantee test procedures and test reports. xxxi) Documentation in respect of Quality Assurance System, and Documentation in respect of Commissioning, as listed out elsewhere in this specification. xxxii) Maintenance schedule for Absorber & auxiliaries clearly indicating interval, duration if shutdown required, manhours required and tools & tackles required for maintenance. The Contractor's while submitting the above documents/ drawings for approval/ reference as the case may be, shall mark on each copy of submission the reference letter alongwith the date vide which the submissions are made.			
	INSTRUCTION MANUALS The Contractor shall make first submission of instruction manual for all the equipments covered under the Contract as per agreed engineering information schedule. The Instruction manuals shall contain full details required for erection, commissioning, operation and maintenance of each equipment. The manual shall be specifically compiled for this project. After finalisation and approval of the Employer the Instruction Manuals shall be submitted as indicated in Annexure-IV. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals have been supplied to the Employer. The Instruction Manuals shall comprise of the following. A) ERECTION MANUALS The erection manuals shall be submitted atleast three (3) months prior to the commencement of erection activities of particular equipment/system. The erection manual should contain the following as a minimum. a) Erection strategy. b) Sequence of erection.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 9 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	c) Erection instructions. d) Critical checks and permissible deviation/tolerances. e) List of tool, tackles, heavy equipments like cranes, dozers, etc. f) Bill of Materials g) Procedure for erection and General Safety procedures to followed during erection/installation. h) Procedure for initial checking after erection. i) Procedure for testing and acceptance norms. j) Procedure / Check list for pre-commissioning activities. k) Procedure / Check list for commissioning of the system. l) Safety precautions to be followed in electrical supply distribution during erection. B) OPERATION & MAINTENANCE MANUALS a) The manual shall be a two rim PVC bound stiff sided binder able to withstand constant usage or where a thicker type is required it shall have locking steel pins, the size of the manual shall not be larger than international size A3. The cover shall be printed with the Project Name, Services covered and Volume / Book number Each section of the manual shall be divided by a stiff divider of the same size as the holder. The dividers shall clearly state the section number and title. All written instructions within the manual not provided by the manufacturers shall be typewritten with a margin on the left hand side. b) The arrangement and contents of O & M manuals shall be as follows: 1) Chapter 1 - Plant Description: To contain the following sections specific to the equipment/system supplied a) Description of operating principle of equipment / system with schematic drawing / layouts.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 10 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(b) Functional description of associated accessories / controls. Control interlock protection write up. (c) Integrated operation of the equipment alongwith the intended system. (This is to be given by the supplier of the Main equipment by taking into account the operating instruction given by the associated suppliers). (d) Exploded view of the main equipment, associated accessories and auxiliaries with description. Schematic drawing of the equipment alongwith its accessories and auxiliaries. (e) Design data against which the plant performance will be compared. (f) Master list of equipments, Technical specification of the equipment/ system and approved data sheets. (g) Identification system adopted for the various components, (it will be of a simple process linked tagging system). (h) Master list of drawings (as built drawing - Drawings to be enclosed in a separate volume). 2) <u>Chapter 2.0 - Plant Operation</u>: To contain the following sections specific to the equipment supplied (a) Protection logics provided for the equipment alongwith brief philosophy behind the logic, Drawings etc. (b) Limiting values of all protection settings. (c) Various settings of annunciation/interlocks provided. (d) Startup and shut down procedure for equipment alongwith the associated systems in step mode. (e) Do's and Don'ts related to operation of the equipment. (f) Safety precautions to be take during normal operation. Emergency instruction on total power failure condition/lubrication failure/any other conditions. (g) Parameters to be monitored with normal value and limiting values. (h) Equipment isolating procedures.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 11 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(i) Trouble shooting with causes and remedial measures. (j) Routine testing procedure to ascertain healthiness of the safety devices alongwith schedule of testing. (k) Routine Operational Checks, Recommended Logs and Records (l) Change over schedule if more than one auxiliary for the same purpose is given. (m) Preservation procedure on long shut down. (n) System/plant commissioning procedure. 3) <u>Chapter 3.0 - Plant Maintenance</u>- To contain the following sections specific to the equipment supplied. (a) Exploded view of each of the equipments. Drawings alongwith bill of materials including name, code no. & population. (b) Exploded view of the spare parts and critical components with dimensional drawings (In case of Electronic cards, the circuit diagram to be given) and spare parts catalogue for each equipment. (c) List of Special T/ P required for Overhauling /Trouble shooting including special testing equipment required for calibration etc. (d) Stepwise dismantling and assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained etc. Clearance to be maintained etc. (e) Preventive Maintenance schedules linked with running hours/calendar period alongwith checks to be carried out. (f) Overhauling schedules linked with running hours/calendar period alongwith checks to be done. (g) Long term maintenance schedules (h) Consumables list alongwith the estimated quantity required during normal running and during maintenance like Preventive Maintenance and Overhauling. (i) List of lubricants with their Indian equivalent, Lubrication Schedule including charts showing lubrication checking, testing and replacement procedure to be carried daily, weekly, monthly & at			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 12 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	longer intervals to ensure trouble free operation and quantity required for complete replacement. (j) Tolerance for fitment of various components. (k) Details of sub vendors with their part no. in case of bought out items. (l) List of spare parts with their Part No, total population, life expediency & their interchangeability with already supplied spares to NTPC. (m) List of mandatory and recommended spare list along with manufacturing drawings, material specification & quality plan for fast moving consumable spares. (n) Lead time required for ordering of spares from the equipment supplier, instructions for storage and preservation of spares. (o) General information on the equipment such as modification carried out in the equipment from its inception, equipment population in the country / foreign country and list of utilities where similar equipments have been supplied.			
8.03.03	After finalization and approval of the Employer, the O & M Manuals shall be submitted as indicated in Annexure-VI. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals (both erection and O & M manuals have been supplied to the Employer. If after the commissioning and initial operation of the plant, the instruction manuals (Erection and /or O &M manuals) require modifications/additions/ changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer for records and number of copies shall be as mentioned in Annexure-VI.			
8.03.03	PLANT HANDBOOK AND PROJECT COMPLETION REPORT			
8.03.03.01	PLANT HANDBOOK			
	The Contractor shall submit to the Employer a preliminary plant hand book preferably in A-4 size sheets which shall contain the design and performance data of various plants, equipments and systems covering the complete project including i) Design and performance data. ii) Process & Instrumentation diagrams. iii) Single line diagrams.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 13 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	iv) Sequence & Protection Interlock Schemes. v) Alarm and trip values. vi) Performance Curves. vii) General layout plan and layout of main plant building and auxiliary buildings viii) Important Do's & Don't's The plant handbook shall be submitted within twelve (12) months from the date of award of contract. After the incorporation of Employer's comments, the final plant handbook complete in all respects shall be submitted three (3) months before start-up and commissioning activities.	
8.03.03.02	PROJECT COMPLETION REPORT The Contractor shall submit a Project Completion Report at the time of handing over the plant.	
8.03.04	DRAWINGS a) i) All the FGD plant layouts shall be made in computerised 3D modelling system. The Employer reserves the right to review the 3D model at different stages during the progress of engineering. The layout drawings submitted for Employer's review shall be fully dimensioned and extracted from 3D model after interference check. ii) All documents submitted by the Contractor for Employer's review shall be in electronic form (soft copies) along with the desired number of hard copies as per Annexure-VI of Part-C. The soft copies shall be uploaded by the vendors in C-folders, a Web-based system of NTPC ERP, for which a username and password will be allotted to the new vendor by NTPC. Similarly, the vendor can download the drawings/documents, approved/ commented by NTPC, through above site. The soft copies of identified drawings/documents shall be in pdf format, whereas the attachments/reply to the submitted document(s) can be in .doc, .xls, .pdf, .dwg or .std formats. iii) Final copies of the approved drawings along with requisite number of hard copies shall be submitted as per Annexure-VI of Part-C. iv) Contractor shall prepare the model of all the facilities located in FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE (including all	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 14 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	facilities), and any other facility in an integrated & intelligent 3D software solution using rule-based, data centric 3D Design software with equipment drawings, data sheets, intelligent P&ID correlated with intelligent 3D Model, BOQ, schematics and logic diagrams etc. attached to the respective equipment / systems in the aforesaid 3D model. Contractor shall make a presentation on 3D model every 3 months from LOA to enable NTPC to review the progress of engineering. After the completion of engineering the corresponding complete 3D review model shall be handed over to the employer for its reference. Contractor shall provide 3D model (which shall include visual interference check, walk-through animation, video simulation for major equipment placement and removal, visual effect, photo realism etc), which is extracted from intelligent 3D model, for employer's review as & when desired by employer. However, all piping layouts, equipment layouts, floor plans, ducting layout (Air/flue gas, A/C, Ventilation etc.), General Arrangement drawings of major buildings, structural arrangement drawings and RCC layout drawings shall necessarily be extracted from the aforesaid 3D model and submitted for employer's review along with the 3D review model to enable NTPC to review and approve these drawings. b) All documents/text information shall be in latest version of MS Office / MS Excel / PDF FORMAT as applicable. c) All drawings submitted by the Contractor including those submitted at the time of bid shall be in sufficient detail indicating the type, size, arrangement, weight of each component for packing and shipment, the external connection, fixing arrangement required, the dimensions required for installation and interconnections with other equipments and materials, clearance and spaces required between various portions of equipment and any other information specifically requested in the drawing schedules. d) Each drawing submitted by the Contractor (including those of subvendors) shall bear a title block at the right hand bottom corner with clear mention of the name of the Employer, the system designation, the specifications title, the specification number, the name of the Project, drawing number and revisions. If standard catalogue pages are submitted the applicable items shall be indicated therein. All titles, notings, markings and writings on the drawing shall be in English. All the dimensions should be in metric units. e) The drawings submitted by the Contractor (or their subvendors) shall bear Employer's drawing number in addition to contractor's (their sub-vendor's) own drawing number. Employer's drawing numbering system shall be made available to the successful bidder so as to enable him to assign Employer's drawing numbers to the drawings to be submitted by him during the course of execution of the Contract.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 15 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	The Contractor shall also furnish a "Master Drawing List" which shall be a comprehensive list of all drawings/ documents/ calculations envisaged to be furnished by him during the detailed engineering to the Employer. Such list should clearly indicate the purpose of submission of these drawings i.e. "FOR APPROVAL" or "FOR INFORMATION ONLY". Similarly, all the drawings/ documents submitted by the Contractor during detailed engineering stage shall be marked "FOR APPROVAL" or "FOR INFORMATION" prior to submission. Further, space shall be identified on each drawing for Approval stamp and electronic signature. f) The furnishing of detailed engineering data and drawings by the Contractor shall be in accordance with the time schedule for the project. The review of these documents/ data/ drawings by the Employer will cover only general conformance of the data/ drawings/ documents to the specifications and contract, interfaces with the equipments provided by others and external connections & dimensions which might affect plant layout. The review by the Employer should not be construed to be a thorough review of all dimensions, quantities and details of the equipments, materials, any devices or items indicated or the accuracy of the information submitted. The review and/ or approval by the Employer/ Project Manager shall not relieve the Contractor of any of his responsibilities and liabilities under this contract. g) After the approval of the drawings, further work by the Contractor shall be in strict accordance with these approved drawings and no deviation shall be permitted without the written approval of the Employer. h) All manufacturing, fabrication and execution of work in connection with the equipment / system, prior to the approval of the drawings, shall be at the Contractor's risk. The Contractor is expected not to make any changes in the design of the equipment /system, once they are approved by the Employer. However, if some changes are necessitated in the design of the equipment/system at a later date, the Contractor may do so, but such changes shall promptly be brought to the notice of the Employer indicating the reasons for the change and get the revised drawing approved again in strict conformance to the provisions of the Technical Specification. i) Drawings shall include all installations and detailed piping layout drawings. Layout drawings for all piping of 65 mm and larger diameter shall be submitted for review/ approval of Employer prior to erection. Small diameter pipes shall however be routed as per site conditions in consultation with site authority/ representative of Employer based on requirements of such piping indicated in approved/ finalised Flow Scheme/ Process & Instrumentation Diagrams and/or the requirements cropping up for draining & venting of larger diameter piping or otherwise after their erection as per actual physical condition for the entire scope of work of this package.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 16 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Assessing & anticipating the requirement and supply of all piping and equipment shall be done by the contractor well in advance so as not to hinder the progress of piping & equipment erection, subsequent system charging and its effective draining & venting arrangement as per site suitability. j) As Built Drawings After final acceptance of individual equipment / system by the Employer, the Contractor will update all original drawings and documents for the equipment / system to “as built” conditions and submit no. of copies as per Annexure VI. k) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to Engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data/ drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. l) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The Employer shall review the drawings and return soft copy to the Contractor authorizing either to proceed with manufacture or fabrication, or marked to show changes desired. When changes are required, drawings shall be re-submitted promptly, with revisions clearly marked, for final review. Any delays arising out of the failure of the Contractor to submit/rectify and resubmit in time shall not be accepted as a reason for delay in the contract schedule. m) All engineering data submitted by the Contractor after final process including review and approval by the Project Manager/ Employer shall form part of the contract documents and the entire works covered under these specification shall be performed in strict conformity with technical specifications unless otherwise expressly requested by the Project Manager in writing. n) The Contractor shall submit drawings in line with the suggestive MDL covered in Part-B, Section-VI of Technical Specification and which shall be duly integrated with approved PERT network.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 17 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.04.00	ENGINEERING INFORMATION SUBMISSION SCHEDULE Prior to the award of Contract, a Detailed Engineering Information Submission Scheduler/Master Drawing List duly integrated with approved PERT network shall be tied up with the Employer. For this, the bidder shall furnish a detailed list of engineering information alongwith the proposed submission schedule. This list would be a comprehensive one including all engineering data / drawings / information for all bought out items and manufactured items. The information shall be categorized into the following parts. i) Information that shall be submitted for the approval to the Employer before proceeding further, and ii) Information that would be submitted for Employer's information only. The Master Drawing List (MDL) shall be updated periodically and submitted to the employer, highlighting the changes made in MDL. The schedule should allow adequate time for proper review and incorporation of changes/ modifications, if any, to meet the contract without affecting the equipment delivery schedule and overall project schedule. The early submission of drawings and data is as important as the manufacture and delivery of equipment and hardware and this shall be duly considered while determining the overall performance and progress.			
8.05.00	ENGINEERING PROGRESS AND EXCEPTION REPORT			
8.05.01	The Contractor shall submit every month an Engineering progress and Exception Report giving the status of each engineering information including a) A list of drawings/engineering information which remains unapproved for more than four (4) weeks after the date of first submission b) Drawings which were not submitted as per agreed schedule.			
8.05.02	The draft format for this report shall be furnished to the Employer within four (4) weeks of the award of the contract, which shall then be discussed and finalised with the Employer.			
8.06.00	Engineering Co-ordination Procedure			
8.06.01	The following principal coordinators will be identified by respective organizations at time of award of contract: NTPC Engineering Coordinator (NTPC EC):			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 18 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE : Contractor's/ Vendor's Engineering Coordinator (VENDOR EC): Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE :			
8.06.02	All engineering correspondence shall be in the name of above coordinators on behalf of the respective organizations.			
8.06.03	Contractor's/Vendor's Drawing Submission and Approval Procedure: a) All data/information furnished by Vendor in the form of drawings/ documents/catalogues or in any other form for NTPC's information/ interface and or review and approval are referred by the general term "drawings". b) The 'Master drawings list' indicating titles, Drawing Number, Date of submission and approval etc. shall be finalised mutually between Contractor and Employer before the award of contract. This list shall be updated if required at suitable interval during detailed engineering. c) All drawings (including those of subvendor's) shall bear at the right hand bottom corner the 'title plate' with all relevant information duly filled in. The Contractor shall furnish this format to his subvendor along with his purchase order for subvendor's compliance.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 19 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	d) Employer and contractor shall follow their own numbering systems for the drawings. However, Employer shall intimate the contractor, NTPC drawing number on receipt of the first submission of each drawing. Vendor, thereafter, shall indicate NTPC's drawing number in subsequent Submission, in the space provided for this purpose in title plate, in addition to his own drawing number. e) The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data / drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. f) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper endorsement for checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. g) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The drawings submitted by the Contractor/vendor shall be reviewed by NTPC and their comments shall be forwarded within four (4) weeks of receipt of drawings. Upon review of each drawing, depending on the correctness and completeness of the drawing, the same will be categorized and approval accorded in one of the following categories : CATEGORY- I: Approved CATEGORY- II Approved, subject to incorporation of comments/ modification as noted. Resubmit revised drawing incorporating the comments. CATEGORY –III Not approved. Resubmit revised drawings for approval after incorporating comments/ modification as noted. CATEGORY -IV For information and records. h) Contractor shall resubmit the drawings approved under Category II, III & IV within three (3) weeks of receipt of comments on the drawings, incorporating all comments. Every revision of the drawing shall bear a revision index wherein such revisions shall be highlighted in the form of description or marked up in the drawing identifying the same with relevant revision Number			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 20 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	enclosed in a triangle (eg. 1, 2, 3 etc). Contractor shall not make any changes in the portions of the drawing other than those commented. If changes are required to be made in the portions already approved, the Contractor shall resubmit the drawing identifying the changes for Employer's review and approval. Drawings resubmitted shall show clearly the portions where the same are revised marking the relevant revision numbers and Employer shall review only such revised portion of documents. i) In case, the Contractor/ Vendor does not agree with any specific comment, he shall furnish the explanation for the same to NTPC for consideration. In all such cases the Contractor shall necessarily enclose explanations along with the revised drawing (taking care of balance comments) to avoid any delay and/or duplication in review work. j) It is responsibility of the Contractor/ Vendor to get all the drawings approved in the Category I & IV (as the case may be) and complete engineering activities within the agreed schedule. Any delay arising out of submission and modification of drawings shall not alter the contract completion schedule. k) If Contractor/ Vendor fails to resubmit the drawings as per the schedule, construction work at site will not be held up and work will be carried out on the basis of comments furnished on previous issues of the drawing. l) These comments will be taken care by the contractor while submitting the revised drawing. The contractor shall use a single transmittal for drawings. Submission. This shall include transmittal numbers and date, number of copies being sent, names of the agencies to whom copies being sent, drawing number and titles, remarks or special notes if any etc.			
9.00.00	TECHNICAL CO-ORDINATION MEETING			
9.01.00	The Contractor shall be called upon to organise and attend monthly Design/ Technical Co-ordination Meetings (TCMs) with the Employer/Employer's representatives and other Contractors of the Employer during the period of contract. The Contractor shall attend such meetings at his own cost at NEW DELHI / NOIDA or at mutually agreed venue as and when required and fully co-operate with such persons and agencies involved during the discussions.			
9.02.00	The Contractor should note that Time is the essence of the contract. In order to expedite the early completion of engineering activities, the Contractor shall submit all drawings as per the agreed Engineering Information Submission Schedule. The drawings submitted by the Contractor will be reviewed by the Employer as far as practicable within three (3) weeks from the date of receipt of the drawing .The			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 21 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	comments of the Employer shall then be discussed across the table during the above Technical Co-ordination Meeting (s) wherein best efforts shall be made by both sides to ensure the approval of the drawing.			
9.02.01	The Contractor shall ensure availability of the concerned experts / consultants/ personnel who are empowered to take necessary decisions during these meetings. The Contractor shall be equipped with necessary tools and facilities so that the drawings/documents can be resubmitted after incorporating necessary changes and approved during the meeting itself.			
9.02.02	Should any drawing remain unapproved for more than six (6) weeks after it's first submission ,this shall be brought out in the monthly Engineering Progress and Exception Report with reasons thereof.			
9.03.0	Any delays arising out of failure by the Contractor to incorporate Employer's comments and resubmit the same during the TCM shall be considered as a default and in no case shall entitle the Contractor to alter the Contract completion date.			
10.00.00	DESIGN IMPROVEMENTS The Employer or the Contractor may propose changes in the specification of the equipment or quality thereof and if the parties agree upon any such changes the specification shall be modified accordingly. If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any changing the price and/or schedule of completion before the Contractor proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.			
11.00.00	EQUIPMENT BASES A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base, unless otherwise specifically agreed to by the Employer. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.			
12.00.00	PROTECTIVE GUARDS Suitable guards shall be provided for protection of personnel on all exposed rotating and/or moving machine parts. All such guards shall be designed for easy installation and removal for maintenance purpose.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 22 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
13.00.00	LUBRICANTS, SERVO FLUIDS AND CHEMICALS	
13.01.00	I. All the first fills of consumables and one years topping requirement of consumables such as greases, oil, lubricants, servo fluids / control fluids, gases and essential chemicals etc. which will be required to put the equipment covered under the scope of specifications, into successful commissioning / initial operation and to establish completion of facilities shall be supplied by the Contractor. Suitable standard lubricants as available in India are desired. Efforts should be made to limit the variety of lubricants to minimum. Bidder shall supply a quantity not less than 10 % of the full charge or one (1) year topping requirement mentioned above (whichever is higher) of each variety of lubricants, servo fluids, gases, chemicals etc (as detailed above) which is expected to be utilized during the first year of operation. The additional quantity shall be supplied in separate container.	
13.02.00	As far as possible lubricants marketed by the Indian Oil Corporation shall be used. The variety of lubricants shall be kept to a minimum possible. Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals etc. required for the complete plant covered herein shall be furnished. On completion of erection, a complete list of bearings/ equipment giving their location and identification marks shall be furnished to the Employer alongwith lubrication requirements.	
14.00.00	LUBRICATION	
14.01.00	Equipment shall be lubricated by systems designed for continuous operation. Lubricant level indicators shall be furnished and marked to indicate proper levels under both standstill and operating conditions.	
15.00.00	MATERIAL OF CONSTRUCTION	
15.01.00	All materials used for the construction of the equipment shall be new and shall be in accordance with the requirements of this specification. Materials utilised for various components shall be those which have established themselves for use in such applications.	
16.00.00	RATING PLATES, NAME PLATES & LABELS	
16.01.00	Each main and auxiliary item of plant including instruments shall have permanently attached to it in a conspicuous position, a rating plate of non-corrosive material upon which shall be engraved manufacturer's name, equipment, type or serial number together with details of the ratings, service conditions under which the item of plant in question has been designed to operate, and such diagram plates as may be required by the Employer.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9
PART-C GENERAL TECHNICAL REQUIREMENTS		PAGE 23 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
16.02.00	Each item of plant shall be provided with nameplate or label designating the service of the particular equipment. The inscriptions shall be approved by the Employer or as detailed in appropriate section of the technical specifications.			
16.03.00	Such nameplates or labels shall be of white nonhygroscopic material with engraved black lettering or alternately, in the case of indoor circuit breakers, starters, etc. of transparent plastic material with suitably coloured lettering engraved on the back. The name plates shall be suitably fixed on both front and rear side.			
16.04.00	Items of plant such as valves, which are subject to handling, shall be provided with an engraved chromium plated nameplate or label with engraving filled with enamel. The name plates for valves shall be marked in accordance with MSS standard SP-25 and ANSI B 16.34 as a minimum.			
16.05.00	Hanger/ support numbers shall be marked on all pipe supports, anchors, hangers, snubbers and restraint assemblies. Each constant and variable spring support shall also have stamped upon it the designed hot and cold load which it is intended to support. Suitable scale shall also be provided to indicate load on support or hanger.			
16.06.00	Valves, steam traps and strainers shall be identified by Employer's tag number of a metal tap permanently attached to non pressure parts such as the yoke by a stainless steel wire. The direction of flow shall also be marked on the body.			
16.07.00	Safety and relief valves shall be provided with the following: a) Manufacturer's identification. b) Nominal inlet and outlet sizes in mm. c) Set pressure in Kg/cm² (abs). d) Blowdown and accumulation as percentage of set pressure. e) Certified capacity in Kg of saturated steam per hour or in case of liquid certified capacity in litres of water per minute.			
16.08.00	All such plates, instruction plates, etc. shall be bilingual with Hindi inscription first, followed by English. Alternatively, two separate plates one with Hindi and the other with English inscriptions may be provided.			
16.09.00	All segregated phases of conductors or bus ducts, indoor or outdoor, shall be provided with coloured phase plates to clearly identify the phase of the system.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 24 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
17.00.00	TOOLS AND TACKLES The Contractor shall supply with the equipment one complete set of all special tools and tackles and other instruments required and other instruments for the erection, assembly, disassembly and proper maintenance of the plant and equipment and systems (including software). These special tools will also include special material handling equipment, jigs and fixtures for maintenance and calibration / readjustment, checking and measurement aids etc. A list of such tools and tackles shall be submitted by the Bidder alongwith the offer. The price of each tool / tackle shall be deemed to have been included in the total bid price. These tools and tackles shall be separately packed and sent to site. The Contractor shall also ensure that these tools and tackles are not used by him during erection, commissioning and initial operation. For this period the Contractor should bring his own tools and tackles. In case these tools and tackles are used by the Contractor during erection, commissioning or initial operation the same shall be refurbished repaired/replaced as required to the satisfaction of the Employer before handing over to the Employer. All the tools and tackles shall be of reputed make acceptable to the Employer.			
18.00.00	WELDING			
18.01.00	If the manufacturer has special requirements relating to the welding procedures for welds at the terminals of the equipments to be performed by others the requirements shall be submitted to the Employer in advance of commencement of erection work.			
19.00.00	COLOUR CODE FOR ALL EQUIPMENTS/ PIPINGS/ PIPE SERVICES			
19.01.00	All equipment/ piping/ pipe services are to be painted by the Contractor in accordance with Employer's standard colour coding scheme, which will be furnished to the Contractor during detailed engineering stage.			
20.00.00	PROTECTION AND PRESERVATIVE SHOP COATING			
20.01.00	PROTECTION All coated surfaces shall be protected against abrasion, impact, discoloration and any other damages. All exposed threaded portions shall be suitably protected with either metallic or a nonmetallic protection device. All ends of all valves and piping and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage. The parts which are likely to get rusted, due to exposure to weather, should also be properly treated and protected in a suitable manner. All primers/paints/coatings shall take into account the hot humid, corrosive & alkaline, subsoil or over ground environment as the case may be. The requirements for			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 25 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	painting specification shall be complied with as detailed out in Part-A & B of the Technical Specification.	
20.02.00	PRESERVATIVE SHOP COATING	
	All exposed metallic surfaces subject to corrosion shall be protected by shop application of suitable coatings. All surfaces which will not be easily accessible after the shop assembly, shall be treated beforehand and protected for the life of the equipment. All surfaces shall be thoroughly cleaned of all mill scales, oxides and other coatings and prepared in the shop. The surfaces that are to be finish-painted after installation or require corrosion protection until installation, shall be shop painted as per the requirements covered in the relevant part of the Technical Specification. Transformers and other electrical equipments, if included shall be shop finished with one or more coats of primer and two coats of high grade resistance enamel. The finished colors shall be as per manufacturer's standards, to be selected and specified by the Employer at a later date.	
20.03.00	Shop primer for all steel surfaces which will be exposed to operating temperature below 95 degrees Celsius shall be selected by the Contractor after obtaining specific approval of the Employer regarding the quality of primer proposed to be applied. Special high temperature primer shall be used on surfaces exposed to temperature higher than 95 degrees Celsius and such primer shall also be subject to the approval of the Employer.	
20.04.00	All other steel surfaces which are not to be painted shall be coated with suitable dust preventive compound subject to the approval of the Employer.	
20.05.00	All piping shall be cleaned after shop assembly by shot blasting or other means approved by the Employer. Lube oil piping or carbon steel shall be pickled.	
20.06.00	Painting for Civil structures and equipment/system covered under this package shall be done as specified under technical requirements on civil works in relevant part of this specifications.	
21.00.00	QUALITY ASSURANCE PROGRAMME	
21.01.00	To ensure that the equipment and services under the scope of contract whether manufactured or performed within the Contractor's works or at his sub-contractor's premises or at the Employer's site or at any other place of work are in accordance with the specifications, the Contractor shall adopt suitable quality assurance programme to control such activities at all points, as necessary. Such programmes shall be outlined by the Contractor and shall be finally accepted by the Employer/authorised representative after discussions before the award of the contract. The QA programme shall be generally in line with ISO-9001/IS-14001. A	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 26 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	quality assurance programme of the contractor shall generally cover the following: a) His organisation structure for the management and implementation of the proposed quality assurance programme b) Quality System Manual c) Design Control System d) Documentation Control System e) Qualification data for Bidder's key Personnel. f) The procedure for purchase of materials, parts, components and selection of sub-contractor's services including vendor analysis, source inspection, incoming raw-material inspection, verification of materials purchased etc. g) System for shop manufacturing and site erection control including process controls and fabrication and assembly controls. h) Control of non-conforming items and system for corrective actions. i) Inspection and test procedure both for manufacture and field activities. j) Control of calibration and testing of measuring testing equipments. k) System for Quality Audits. l) System for indication and appraisal of inspection status. m) System for authorising release of manufactured product to the Employer. n) System for handling storage and delivery. o) System for maintenance of records, and p) Furnishing of quality plans for manufacturing and field activities detailing out the specific quality control procedure adopted for controlling the quality characteristics relevant to each item of equipment/component as per formats enclosed as Annexure-I and Annexure-II respectively.			
22.00.00	GENERAL REQUIREMENTS - QUALITY ASSURANCE			
22.01.00	All materials, components and equipment covered under this specification shall be procured, manufactured, erected, commissioned and tested at all the stages, as per a comprehensive Quality Assurance Programme. An indicative programme of			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 27 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	inspection/tests to be carried out by the contractor for some of the major items is given in the respective technical specification. This is, however, not intended to form a comprehensive programme as it is the contractor's responsibility to draw up and implement such programme duly approved by the Employer. The detailed Quality Plans for manufacturing and field activities shall be drawn up by the Bidder and will be submitted to Employer for approval. Schedule of finalisation of such quality plans will be finalised before award on enclosed format No. QS-01-QAI-P-1/F3-R0. Monthly progress reports shall be furnished.			
22.02.00	Manufacturing Quality Plan will detail out for all the components and equipment, various tests/inspection, to be carried out as per the requirements of this specification and standards mentioned therein and quality practices and procedures followed by Contractor's/ Sub-contractor's/ sub-supplier's Quality Control Organisation, the relevant reference documents and standards, acceptance norms, inspection documents raised etc., during all stages of materials procurement, manufacture, assembly and final testing/performance testing. The Quality Plan shall be submitted on electronic media through C-folders, a web based system of NTPC ERP in addition to hard copy, for review and approval. After approval the same shall be submitted in compiled form on CD-ROM (As per format at Annexure-I)			
22.03.00	Field Quality Plans will detail out for all the equipment, the quality practices and procedures etc. to be followed by the Contractor's "Site Quality Control Organisation", during various stages of site activities starting from receipt of materials/equipment at site (As per format at Annexure – II).			
22.04.00	The Bidder shall also furnish copies of the reference documents/plant standards/acceptance norms/tests and inspection procedure etc., as referred in Quality Plans along with Quality Plans. These Quality Plans and reference documents/standards etc. will be subject to Employer's approval without which manufacturer shall not proceed. These approved documents shall form a part of the contract. In these approved Quality Plans, Employer shall identify customer hold points (CHP), i.e. test/checks which shall be carried out in presence of the Employer's Project Manager or his authorised representative and beyond which the work will not proceed without consent of Employer in writing. All deviations to this specification, approved quality plans and applicable standards must be documented and referred to Employer along with technical justification for approval and dispositioning.			
22.05.00	The contractor shall submit to the Employer Field Welding Schedule for field welding activities in the format enclosed at Annexure-V . The field welding schedule shall be submitted to the Employer along with all supporting documents, like welding procedures, heat treatment procedures, NDT procedures etc. at least ninety days before schedule start of erection work at site.			
22.06.00	The contractor shall have suitable Field Quality Organization with adequate manpower at Employer's site, to effectively implement the Field Quality Plan (FQP)			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 28 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	and Field Quality Management System for site activities. The contractor shall submit the details of proposed FQA setup (organizational structure and manpower) for employer's approval. The FQA setup shall be in place at least one month before the start of site activities.			
22.07.00	No material shall be despatched from the manufacturer's works before the same is accepted, subsequent to predespatch final inspection including verification of records of all previous tests/inspections by Employer's Project Manager/Authorised representative and duly authorised for despatch by issuance of Material Despatch Clearance Certificate (MDCC).			
22.08.00	All material used for equipment manufacture including casting and forging etc. shall be of tested quality as per relevant codes/standards. Details of results of the tests conducted to determine the mechanical properties; chemical analysis and details of heat treatment procedure recommended and actually followed shall be recorded on certificates and time temperature chart. Tests shall be carried out as per applicable material standards and/or agreed details			
22.09.00	All welding and brazing shall be carried out as per procedure drawn and qualified in accordance with requirements of ASME Section IX/BS-4870 or other International equivalent standard acceptable to the Employer. All welding/brazing procedures shall be submitted to the Employer or its authorised representative for approval prior to carrying out the welding/brazing.			
22.10.00	All brazers, welders and welding operators employed on any part of the contract either in Contractor's/his sub-contractor's works or at site or elsewhere shall be qualified as per ASME Section-IX or BS-4871 or other equivalent International Standards acceptable to the Employer.			
22.11.00	Welding procedure qualification & Welder qualification test results shall be furnished to the Employer for approval. However, where required by the Employer, tests shall be conducted in presence of Employer/authorized representative.			
22.12.00	For all IBR pressure parts and high pressure piping welding, the latest applicable requirements of the IBR (Indian Boiler Regulations) shall also be essentially complied with. However, other piping system ASME B31.1 or other relevant code as applicable shall be followed. Similarly, any other statutory requirements for the equipment/systems shall also be complied with. On all back-gauged welds MPI/LPI shall be carried before seal welding			
22.13.00	All the heat treatment results shall be recorded on time temperature charts and verified with recommended regimes.			
22.14.00	No welding shall be carried out on cast iron components for repair.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 29 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.15.00	Unless otherwise proven and specifically agreed with the Employer, welding of dissimilar materials and high alloy materials shall be carried out at shop only.			
22.16.00	All non-destructive examination shall be performed in accordance with written procedures as per International Standards. The NDT operator shall be qualified as per SNT-TC-IA (of the American Society of non-destructive examination) or equivalent. NDT shall be recorded in a report, which includes details of methods and equipment used, result/evaluation, job data and identification of personnel employed and details of co-relation of the test report with the job. In general all plates of thickness greater than 40mm & for pressure parts plates of thickness equal to or greater than 25mm shall be ultrasonically tested otherwise as specified in respective equipment specification. All bar stock/Forging of diameter equal to or greater than 40 mm shall be ultrasonically tested.			
22.17.00	The Contractor shall list out all major items/ equipment/ components to be manufactured in house as well as procured from sub-contractors (BOI). All the sub-contractor proposed by the Contractor for procurement of major bought out items including castings, forging, semi-finished and finished components/equipment etc., list of which shall be drawn up by the Contractor and finalised with the Employer, shall be subject to Employer's approval on enclosed format No. QS-01-QAI-P-01/F3. The contractor's proposal shall include vendor's facilities established at the respective works, the process capability, process stabilization, QC systems followed, experience list, etc. along with his own technical evaluation for identified sub-contractors enclosed and shall be submitted to the Employer for approval within the period agreed at the time of pre-awards discussion and identified in "DR" category prior to any procurement. Monthly progress reports on sub-contractor detail submission / approval shall be furnished preferably on enclosed format at Annexure-IV. Such vendor approval shall not relieve the contractor from any obligation, duty or responsibility under the contract.			
22.18.00	For components/equipment procured by the contractors for the purpose of the contract, after obtaining the written approval of the Employer, the contractor's purchase specifications and inquiries shall call for quality plans to be submitted by the suppliers. The quality plans called for from the sub-contractor shall set out, during the various stages of manufacture and installation, the quality practices and procedures followed by the vendor's quality control organisation, the relevant reference documents/standards used, acceptance level, inspection of documentation raised, etc. Such quality plans of the successful vendors shall be finalised with the Employer and such approved Quality Plans shall form a part of the purchase order/contract between the Contractor and sub-contractor. Within three weeks of the release of the purchase orders /contracts for such bought out items /components, a copy of the same without price details but together with the detailed purchase specifications, quality plans and delivery conditions shall be furnished to the Employer on the			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 30 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	monthly basis by the Contractor along with a report of the Purchase Order placed so far for the contract.		
22.19.00	Employer reserves the right to carry out quality audit and quality surveillance of the systems and procedures of the Contractor's or their sub-contractor's quality management and control activities. The contractor shall provide all necessary assistance to enable the Employer carry out such audit and surveillance.		
22.20.00	The contractor shall carry out an inspection and testing programme during manufacture in his work and that of his sub-contractor's and at site to ensure the mechanical accuracy of components, compliance with drawings, conformance to functional and performance requirements, identity and acceptability of all materials parts and equipment. Contractor shall carry out all tests/inspection required to establish that the items/equipment conform to requirements of the specification and the relevant codes/standards specified in the specification, in addition to carrying out tests as per the approved quality plan.		
22.21.00	Quality audit/surveillance/approval of the results of the tests and inspection will not, however, prejudice the right of the Employer to reject the equipment if it does not comply with the specification when erected or does not give complete satisfaction in service and the above shall in no way limit the liabilities and responsibilities of the Contractor in ensuring complete conformance of the materials/equipment supplied to relevant specification, standard, data sheets, drawings, etc.		
22.22.00	For all spares and replacement items, the quality requirements as agreed for the main equipment supply shall be applicable.		
22.23.00	Repair/rectification procedures to be adopted to make the job acceptable shall be subject to the approval of the Employer/ authorised representative.		
22.24.00	Environmental Stress Screening Environmental stress screening test process / procedure for eliminating infant mortile components for DDCMIS / PLC based system & for other systems having substantial electronics components (as determined by employer) like Electronic transmitter, CCTV components, PA systems etc. shall be necessarily furnished for any sub vendors proposed for vendor assessment and approval for this contract. For other approved sub vendors of above mentioned systems, contractor shall furnish the test procedure for eliminating infant mortile components in case, if it is asked for by the employer before these items are offered for inspection / dispatched to site.		
22.25.00	The Contractor / Sub-contractor shall carry out routine test on 100% item at contractor / sub-contractor's works. The quantum of check / test for routine & acceptance test by employer shall be generally as per criteria / sampling plan defined in referred standards. Wherever standards have not been mentioned quantum of check / test for routine / acceptance test shall be as agreed during detailed engineering stage.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 31 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
22.26.00	Software Reliability / Quality Certification Certification from OEM's authorized signatory that software offered with DDCMIS, PLC, CCTV, PA, Pyrometer, CEMS, AAQMS, EQMS, BHMS etc. declaring that the all the offered software(s) had gone through the established software quality test and offered software is not of β-version and offered software is also free from all known bugs as on date of approval of systems documents by NTPC as a part of quality documentation review and approval process during detail engineering.		
23.00.00	QUALITY ASSURANCE DOCUMENTS		
23.01.00	The Contractor shall be required to submit the QA Documentation in two hard copies and two CD ROMs, as identified in respective quality plan with tick (✓) mark.		
23.01.01	Each QA Documentation shall have a project specific Cover Sheet bearing name & identification number of equipment and including an index of its contents with page control on each document. The QA Documentation file shall be progressively completed by the Supplier's sub-supplier to allow regular reviews by all parties during the manufacturing. The final quality document will be compiled and issued at the final assembly place of equipment before despatch. However CD-Rom may be issued not later than three weeks.		
23.02.00	Typical contents of QA Documentation is as below:- (a.) Quality Plan (b.) Material mill test reports on components as specified by the specification and approved Quality Plans. (c.) Manufacturer / works test reports/results for testing required as per applicable codes and standard referred in the specification and approved Quality Plans. (d.) Non-destructive examination results /reports including radiography interpretation reports. Sketches/drawings used for indicating the method of traceability of the radiographs to the location on the equipment. (e.) Heat Treatment Certificate/Record (Time- temperature Chart) (f.) All the accepted Non-conformance Reports (Major/Minor)/deviation, including complete technical details / repair procedure). (g.) CHP / Inspection reports duly signed by the Inspector of the Employer and Contractor for the agreed Customer Hold Points.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 32 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 
23.03.00 23.04.00 23.05.00	(h.) Certificate of Conformance (COC) wherever applicable. (i.) MDCC Similarly, the contractor shall be required to submit two sets (two hard copies and two CD ROMs), containing QA Documentation pertaining to field activities as per Approved Field Quality Plans and other agreed manuals/ procedures, prior to commissioning of individual system. Before despatch / commissioning of any equipment, the Supplier shall make sure that the corresponding quality document or in the case of protracted phased deliveries, the applicable section of the quality document file is completed. The supplier will then notify the Inspector regarding the readiness of the quality document (or applicable section) for review. (a.) If the result of the review carried out by the Inspector is satisfactory, the Inspector shall stamp the quality document (or applicable section) for release. (b.) If the quality document is unsatisfactory, the Supplier shall endeavor to correct the incompleteness, thus allowing to finalize the quality document (or applicable section) by time compatible with the requirements as per contract documents. When it is done, the quality document (or applicable section) is stamped by the Inspector. (c.) If a decision is made for despatch, whereas all outstanding actions cannot be readily cleared for the release of the quality document by that time, the supplier shall immediately, upon shipment of the equipment, send a copy of the quality document Review Status signed by the Supplier Representative to the Inspector and notify of the committed date for the completion of all outstanding actions & submission. The Inspector shall stamp the quality document for applicable section when it is effectively completed. The submission of QA documentation package shall not be later than 3 weeks after the despatch of equipment. TRANSMISSION OF QA DOCUMENTATION On release of QA Documentation by Inspector, one set of quality document shall be forwarded to Corporate Quality Assurance Department and other set to respective Project Site of Employer. For the particular case of phased deliveries, the complete quality document to the Employer shall be issued not later than 3 weeks after the date of the last delivery of equipment.
	LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9 PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 33 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
24.00.00	PROJECT MANAGER'S SUPERVISION	
24.01.00	To eliminate delays and avoid disputes and litigation, it is agreed between the parties to the Contract that all matters and questions shall be referred to the Project Manager and without prejudice to the provisions of 'Arbitration' clause in Section GCC, the Contractor shall proceed to comply with the Project Manager's decision.	
24.02.00	The work shall be performed under the supervision of the Project Manager. The scope of the duties of the Project Manager pursuant to the Contract, will include but not be limited to the following: (a.) Interpretation of all the terms and conditions of these documents and specifications (b.) Review and interpretation of all the Contractor's drawing, engineering data, etc (c.) Witness or his authorised representative to witness tests and trials either at the manufacturer's works or at site, or at any place where work is performed under the contract (d.) Inspect, accept or reject any equipment, material and work under the contract (e.) Issue certificate of acceptance and/or progressive payment and final payment certificates (f.) Review and suggest modifications and improvement in completion schedules from time to time, and (g.) Supervise Quality Assurance Programme implementation at all stages of the works.	
25.00.00	INSPECTION, TESTING AND INSPECTION CERTIFICATES	
25.01.00	The word 'Inspector' shall mean the Project Manager and/or his authorised representative and/or an outside inspection agency acting on behalf of the Employer to inspect and examine the materials and workmanship of the works during its manufacture or erection.	
25.02.00	The Project Manager or his duly authorised representative and/or an outside inspection agency acting on behalf of the Employer shall have access at all reasonable times to inspect and examine the materials and workmanship of the works during its manufacture or erection and if part of the works is being manufactured or assembled on other premises or works, the Contractor shall obtain	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 34 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	for the Project Manager and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works.			
25.03.00	The Contractor shall give the Project Manager/Inspector fifteen (15) days written notice of any material being ready for testing. Such tests shall be to the Contractor's account except for the expenses of the Inspector's. The Project Manager/Inspector, unless the witnessing of the tests is virtually waived and confirmed in writing, will attend such tests within fifteen (15) days of the date on which the equipment is noticed as being ready for test/inspection failing which the contractor may proceed with test which shall be deemed to have been made in the inspector's presence and he shall forthwith forward to the inspector duly certified copies of test reports in two (2) copies.			
25.04.00	The Project Manager or Inspector shall within fifteen (15) days from the date of inspection as defined herein give notice in writing to the Contractor, or any objection to any drawings and all or any equipment and workmanship which is in his opinion not in accordance with the contract. The Contractor shall give due consideration to such objections and shall either make modifications that may be necessary to meet the said objections or shall inform in writing to the Project Manager/Inspector giving reasons therein, that no modifications are necessary to comply with the contract.			
25.05.00	When the factory tests have been completed at the Contractor's or sub-contractor's works, the Project Manager /Inspector shall issue a certificate to this effect fifteen (15) days after completion of tests but if the tests are not witnessed by the Project Manager /Inspectors, the certificate shall be issued within fifteen (15) days of the receipt of the Contractor's test certificate by the Project Manager /Inspector. Project Manager /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the works. The completion of these tests or the issue of the certificates shall not bind the Employer to accept the equipment should it, on further tests after erection be found not to comply with the contract.			
25.06.00	In all cases where the contract provides for tests whether at the premises or works of the Contractor or any sub-contractor, the Contractor, except where otherwise specified shall provide free of charge such items as labour, material, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Project Manager /Inspector or his authorised representatives to carry out effectively such tests on the equipment in accordance with the Contractor and shall give facilities to the Project Manager/Inspector or to his authorised representative to accomplish testing.			
25.07.00	The inspection by Project Manager / Inspector and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed Quality Assurance Programme forming a part of the contract.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 35 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
25.08.00	To facilitate advance planning of inspection in addition to giving inspection notice as specified at clause no 25.03.00 of this chapter, the Contractor shall furnish quarterly inspection programme indicating schedule dates of inspection at Customer Hold Point and final inspection stages. Updated quarterly inspection plans will be made for each three consecutive months and shall be furnished before beginning of each calendar month.			
25.09.00	All inspection, measuring and test equipment used by contractor shall be calibrated periodically depending on its use and criticality of the test/measurement to be done. The Contractor shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by NTPC. Wherever asked specifically, the contractor shall re-calibrate the measuring/test equipment in the presence of Project Manager / Inspector.			
25.10.00	Associated document for Quality Assurance programme			
25.10.01	Manufacturing Quality Plan Format No. : QS-01-QAI-P-09/F1-R1 enclosed at Annexure-I.			
25.10.02	Field Quality Plan Format No.: QS-01-QAI-P-09/F2-R1 enclosed at Annexure-II.			
25.10.03	List of items requiring quality plan and sub supplier approval. Format No.: QS-01-QAI-P-01/F3-R0 (Annexure-III).			
25.10.04	Status of items requiring Quality Plan and sub supplier approval. Format enclosed at Annexure-IV.			
25.10.05	Field Welding Schedule Format enclosed at Annexure-V.			
25.11.00	Not Used			
25.12.00	DEMONSTRATION OF APPLICATION ENGINEERING			
25.12.01	Based on NTPC inputs, the Contractor shall prepare and submit typical implemented scheme in their system (Control system & HMI) on sample basis. The typical cases to be covered shall include but not be limited to the following. (i) Logics/Loops: a) Drive logics implementation for each type of binary drive along with its display in HMI. b) Sequence implementation along with its display in HMI. c) Single non-cascade controller implementation. d) Cascade loop implementation.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 36 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC	
	e)	Master slave implementation with different slave combination.			
	f)	Temperature & pressure compensation for flow signals & pressure compensation for level signals as applicable.			
	(ii)	HMI Functions:			
	a)	LVS Annunciation.			
	b)	Graphics.			
	c)	HSR			
	d)	Logs/Reports.			
	e)	Calculations (Basic & Performance Calculations).			
	25.12.02	The above typical cases shall be finalized with the Employer through Technical Co-ordination meetings. After review and finalization of the typical cases, the implementation of each logic & control loop shall be carried out by the Contractor based on NTPC inputs. After implementation of these logics & loops, the Contractor shall test each logic /loop and record the observations in a format to be provided by the Employer and demonstrate to Employer at Employer premises during engineering finalization. Any modifications as a result of the demonstration shall be done and documented as part of the test report along with the final scheme. Similarly, HMI functions shall also be demonstrated by the Contractor at Employer premises & the results shall be documented as part of test report.			
	25.12.03	During the integrated testing at the Contractor's works, only sample checks shall be done by the Employer for the items covered in above application engineering demonstration.			
26.00.00	PRE-COMMISSIONING AND COMMISSIONING FACILITIES				
26.01.00	(a)	As soon as the facilities or part thereof has been completed operationally and structurally and before start-up, each item of the equipment and systems forming part of facilities shall be thoroughly cleaned and then inspected jointly by the Employer and the Contractor for correctness of and completeness of facility or part thereof and acceptability for initial pre-commissioning tests, commissioning and start-up at Site. The list of pre-commissioning tests to be performed shall be as mutually agreed and included in the Contractor's quality assurance programme as well as those included in Part-D, Section-VI and elsewhere in the Technical Specifications.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 37 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(b) The Contractor's pre-commissioning/ commissioning/start-up engineers, specially identified as far as possible, shall be responsible for carrying out all the pre-commissioning tests at Site. On completion of inspection, checking and after the pre-commissioning tests are satisfactorily over, the commissioning of the complete facilities shall be commenced during which period the complete facilities, equipments shall be operated integral with sub-systems and supporting equipment as a complete plant. (c) All piping system shall be flushed, steam blown, air blown as required and cleanliness demonstrated using acceptable industry standards. Procedures to accomplish this work shall be submitted for approval to the Employer six months prior to the respective implementations. The Employer will approve final verification of cleanliness. (d) The time consumed in the inspection and checking of the units shall be considered as a part of the erection and installation period. (e) The check outs during the pre - commissioning period should be programmed to follow the construction completion schedule. Each equipment/system, as it is completed in construction and turned over to Employer's commissioning (start-up) Engineer(s), should be checked out and cleaned. The checking and inspection of individual systems should then follow a prescribed commissioning documentation [SLs(standard check list)/TS(testing schedule)/CS(commissioning schedule)] approved by the employer. (f) The Contractor during initial operation and performance testing shall conduct vibration testing to determine the 'base line' of performance of all plant rotating equipment. These tests shall be conducted when the equipment is running at the base load, peak load as well as lowest sustained operating condition as far as practicable.			
26.01.00	Contractor shall furnish the commissioning organization chart for review & acceptance of employer at least twelve months prior to the schedule date of commissioning of 1st unit. The chart should contain: (1.) Biodata including experience of the Commissioning Engineers. (2.) Role and responsibilities of the Commissioning Organisation members. (3.) Expected duration of posting of the above Commissioning Engineers at site.			
26.02.00	Initial Operation (a) On completion of all pre-commissioning activities/ tests and as a part of commissioning the complete facilities shall be put on 'Initial Operation' during			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 38 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
26.03.00	which period all necessary adjustments shall be made while operating over the full load range enabling the facilities to be made ready for the Guarantee Tests. (b) The 'Initial Operation' of the complete facility as an integral unit shall be conducted for 720 continuous hours. During the period of initial operation of 720 hours, the FGD System shall operate continuously at full load for a period not less than 72 hours. The Initial Operation shall be considered successful, provided that each item/part of the facility can operate continuously at the specified operating characteristics, for the period of Initial Operation with all operating parameters within the specified limits and at or near the predicted performance of the equipment/ facility. The Contractor shall intimate the Employer about the commencement of initial operation and shall furnish adequate notice to the Employer in this respect. (c) Any operational interruption in the FGD System due to constraints attributable to the Employer shall be construed as Deemed to be in operation. (d) An Initial Operation report comprising of observations and recordings of various parameters to be measured in respect of the above Initial Operation shall be prepared by the Contractor. This report, besides recording the details of the various observations during initial operation shall also include the dates of start and finish of the Initial Operation and shall be signed by the representatives of both the parties. The report shall have sheets, recording all the details of interruptions occurred, adjustments made and any minor repairs done during the Initial Operation. Based on the observations, necessary modifications/repairs to the plant shall be carried out by the Contractor to the full satisfaction of the Employer to enable the latter to accord permission to carry out the Guarantee tests on the facilities. However, minor defects which do not endanger the safe operation of the equipment, shall not be considered as reasons for with- holding the aforesaid permission.			
	Guarantee Tests a) The final test as to prove the Functional Guarantees shall be conducted at Site by the Contractor in presence of the Employer. The contractor's Commissioning, start-up Engineer shall make the unit ready to conduct such test before start of initial operation. Such test shall be conducted along with the Initial Operations.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 39 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	b) These tests shall be binding on both the parties of the Contract to determine compliance of the equipment with the functional guarantee. c) For performance/ demonstration tests instrumentations, of accuracy class shall be as per specified test codes. The numbers and location of the instruments shall be as per the specified test codes. In addition the values of parameters shall be logged from the information system provided under Employer's Distributed Digital Control Monitoring and Information system. Test will be conducted at specified load points. d) Any special equipment, tools and tackles required for the successful completion of the Guarantee Tests shall be provided by the Contractor, free of cost. e) The Guarantee tests and specific tests to be conducted on equipments have been brought out in detail elsewhere in the specifications.		
27.00.00	TAKING OVER Upon successful completion of Initial Operations and all the tests conducted to the Employer's satisfaction, the Employer shall issue to the Contractor a Taking over Certificate as a proof of the final acceptance of the equipment. Such certificate shall not unreasonably be withheld nor will the Employer delay the issuance thereof, on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the equipment. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issuance of such certificate.		
28.00.00	TRAINING OF EMPLOYER'S PERSONNEL		
28.01.00	Training for Employers O&M Personnel The scope of service under training of Employer's engineers shall include a training module covering upto six (6) man months in the areas of Operation & Maintenance. Such training should enable the personnel to individually take the responsibility of operating and maintaining the FGD system in a manner acceptable to the Employer.		
28.02.00	Training for Employers Engineering Personnel The scope of services under training for Employer's engineering personnel shall also necessarily include three (3) man months. This shall cover all disciplines viz, Mechanical, Electrical, C&I, & QA etc. and shall include all the related areas like		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 40 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
30.00.00	NOISE LEVEL The equivalent 'A' weighted sound pressure level measured at a height of 1.5 m above floor level in elevation and at a distance of one (1) metre horizontally from the nearest surface of any equipment/machine, furnished and installed under these specifications, expressed in decibels to a reference of 0.0002 microbar, shall not exceed 85 dBA . However for Ball Mills the noise levels as per following shall also be acceptable: a) Ball Mill < 90 dBA		
31.00.00	PACKAGING AND TRANSPORTATION All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. While packing all the materials, the limitation from the point of view of the sizes of railway wagons available in India should be taken account of. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. The Contractor shall ascertain the availability of Railway wagon sizes from the Indian Railways or any other agency concerned in India well before effecting despatch of equipment. Before despatch it shall be ensured that complete processing and manufacturing of the components is carried out at shop, only restricted by transport limitation, in order to ensure that site works like grinding, welding, cutting & preassembly to bare minimum. The Employer's Inspector shall have right to insist for completion of works in shops before despatch of materials for transportation.		
32.00.00	ELECTRICAL EQUIPMENTS/ENCLOSURES		
32.01.00	All electrical equipments and devices, including insulation, heating and ventilation devices shall be designed for ambient temperature and a maximum relative humidity as specified elsewhere in the specifications.		
33.00.00	INSTRUMENTATION AND CONTROL All instrumentation and control systems/ equipment/ devices/ components, furnished under this contract shall be in accordance with the requirements stated herein, unless otherwise specified in the detailed specifications.		
33.01.00	All instrument scales and charts shall be calibrated and printed in metric units and shall have linear graduation. The ranges shall be selected to have the normal reading at 75% of full scale. All scales and charts shall be calibrated and printed in Metric Units as follows: 1 Temperature - Degree centigrade (deg C)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 42 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	2. Pressure 3. Draught 4. Vacuum 5. Flow (Gas) 6. Flow (Steam) 7. Flow (Liquid) 8. Flow base 9. Density	- Kilograms per square centimetre (Kg/cm²). Pressure instrument shall have the unit suffixed with 'a' to indicate absolute pressure. If nothing is there, that will mean that the indicated pressure is gauge pressure. - Millimetres of water column (mm wc). - Millimeters of mercury gauge (mm Hg) or water column (mm Wcl). - Tonnes/ hour - Tonnes/ hour - Tonnes / hour - 760 mm Hg. 0 deg.C - Grams per cubic centimeter.		
33.02.00	All instruments and control devices provided on panels shall be of miniaturized design, suitable for modular flush mounting on panels with front draw out facility and flexible plan-in connection at rear.			
33.03.00	All electronic modules shall have gold plated connector fingers and further all input and output modules shall be short circuit proof. These shall also be tropicalised & components shall be of industrial grade or better.			
34.00.00	ELECTRICAL NOISE CONTROL The equipment furnished by the Contractor shall incorporate necessary techniques to eliminate measurement and control problems caused by electrical noise. Areas in Contractor's equipment which are vulnerable to electrical noise shall be hardened to eliminate possible problems. Any additional equipment, services required for effectively eliminating the noise problems shall be included in the proposal. The equipment shall be protected against ESD as per IEC-61000-2. Radio Frequency interference (RFI) and Electro Magnetic Interference (EMI) protection against hardware damage and control system mal-operations/errors shall be provided for all systems as per EN-50082-2 (1995).			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 43 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
35.00.00	SURGE PROTECTION FOR SOLID STATE EQUIPMENT All solid state systems /equipment shall be able to withstand the electrical noise and surge as encountered in actual service conditions and inherent in a power plant and shall meet the requirements of surge protection as defined in ANSI C37.90.1-1989 on its suitable equivalent class of IEC 254-4. Details of the features incorporated and relevant tests carried out. The test certificates. etc. shall be submitted by the Bidder.		
36.00.00	INSTRUMENT AIR SYSTEM The instrument air supply system as supplied by the Bidder for various pneumatic control & instrumentation devices like pneumatic actuators, power cylinders, E/P converters, piping / tubing etc. Each pneumatic instrument shall have an individual air shut - off valve. The pressure regulating valve shall be equipped with an internal filter, a 50 mm pressure gauge and a built-in filter housing blow down valve.		
37.00.00	TAPPING POINTS FOR MEASUREMENTS Tapping points shall include probes, wherever applicable, for analytical measurements and sampling. For direct temperature measurement of all working media, one stub with internal threading of approved pattern shall be provided along with suitable plug and washer. The Contractor will be intimated about thread standard to be adopted. The following shall be provided on equipment by the Bidder. The standard which is to be adopted, will be intimated to the Contractor. i) Temperature test pockets with stub and thermowell ii) Pressure test pockets		
38.00.00	SYSTEM DOCUMENTATION The Bidder shall provide drawings, system overview & description, hardware/ software details, technical literature, functional & hardware schemes, bill of material, parts list, interconnection diagrams, data sheets, erection/ installation/ commissioning procedures, instruction/ operating manuals, etc. for each of the C& I system / sub-systems/ equipment supplied under this package. The documentation shall include complete details of the C&I systems/ sub-systems/ equipment to enable review by Employer during detailed engineering stage and to provide information to plant personnel for operation & Maintenance (including quick diagnostics & trouble shooting) of these C&I systems/ sub-systems/ equipment at site. The minimum documentation requirements for C&I systems shall be as stipulated under C&I		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 44 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	"Technical Data Sheets" Part of specifications. In addition to this, system documentation for control system shall include as a minimum to that specified elsewhere in the Technical Specification. The exact format, submission schedule and contents of various documents shall be as finalised during detailed engineering stage.			
38.01.00	Bill of material (instrument list) for all C&I equipment/ devices shall be furnished by the bidder in standard formats as approved by the Employer.			
39.00.00	MAINTENANCE MANUALS OF ELECTRONIC MODULES The Contractor shall have to furnish two (2) sets of all maintenance manual of each and every electronic card/module as employed on the various systems and equipment including peripherals etc., offered by him. The Contractor will also have to furnish the data regarding the expected failure rate of various modules and other system components. Further , the contractor shall furnish a set of operating manuals which should include block diagrams ,make, model/type ,details wiring and external connection drawings etc as required to do the testing and maintenance of the electronic modules.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 45 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	LIST OF CODES AND STANDARDS			
	Indian Standards	Title	International and Internationally recognised standards	
	IS:277	Galvanised steel sheets (plain or corrugated)		
	IS:655	Specification for metal air duct		
	IS:800	Code of practice for use of structural steel in general building construction	BS 449:1969 BS 5950 ASA A57, 1-1952	
	IS:807	Code of practice for design, manufacture, erection and testing (Structural portion) of cranes and hoists 6588 (Issued by Standards Association of Australia). DIN 120:1936 (Sheet 1) DIN 120:1936 (Sheet 2) 327 part-I, 1951 BS 466 part-II, 1960 BS 644:1960 BS 1757:1951 BS 2573:part-I:1960	Draft Revision of A.S. NO. CS.2 SAA Crane and Hoist code Doc:No. BU/4 Rev	
	IS:875	Code of practice for design loads (other than earthquake) for buildings and structures Leading standards (issued by Canadian Standard) DIN-1055-1955 (Issued by ASA)	National Building code of Canada (1953)-Part-IV Design section 4.1	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 46 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:1239 Part-I	Mild steel tubes	(ISO/R 65-1957) (ISO/R-64-1958) (ISO/R-65-1958) (BS 1387 : 1957)	
	IS:1239 Part-II	Mild steel tubulars and other wrought steel pipe fittings	BS 1387 : 1967 BS 1387 :1967 BS 1740 :1965	
	IS:2825	Code for unfired vessels		
	IS:1520	Horizontal centrifugal pumps for clear cold and fresh water		
	IS:1600	Code for practice for performance of constant speed IC Engines for general purpose		
	IS:1601	Specification for performance of constant speed IC Engines for general Purpose		
	IS:1893	Criteria for earthquake resistant design of structures		
	IS1978-1971	Line Pipe April 1969.	API Standards 5L	
	IS:2254-1970	Dimensions of vertical shaft motor for pumps	IEC Pub 72-1 part I NEMA Pub MG 1 1954	
	IS:2266	Steel wire ropes for general engineering purposes	BS :302 : 1968	
	IS:2312	Propellant type Ventilation fans		
	IS:2365	Steel wire suspension ropes for lifts and hoists	BS : 1957	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 47 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:3346	Method for the determination of thermal conductivity of thermal insulation materials (two slab guarded hot plate method)	DIN 52612 (Deutscher Normenausschuss) ASTM C 163-1964 (American Society of Testing and materials) ASTM C 167-1974 ASTM C 177-1963	
	IS:3354	Outline dimensions for electric lifts.		
	IS:3401	Silica gel		
	IS:3588	Specification for electrical axial flow fans		
	IS:3589	Electrically welded steel pipes for water, gas and sewage (200mm to 2000 mm Nominal Diametre)		
	IS:3677	Unbonded rock and slag wool for thermal insulation		
	IS:3815	Point hook with shank for general engineering purposes	BS 482 - 1968 Doc.:67/3 1284 (Revision of BS 2903) (Issued BS)	
	IS:3895	Specification for monocrystalline semiconductor rectifier cells and stacks		
	IS:3963	Roof extractor unit		
	IS:3975	Mild steel wires, strips and tapes for armouring cables		
	IS:4503	Shell and tube type heat Exchanger		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 48 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:4540 IS:4671 IS:4736 IS:4894 IS:5456 IS:5749 IS:6392 IS:6524 Part-I IS:7098 IS:7373 IS:7938 ISO:1217 ASHRAE-33 and air heating coils. ASHRAE-52-76	Specification for monory- stallines rectifire assembly equipment Expanded polystyrene for thermal insulation purpose Hot dip zinc coating on steel tubes Centrifugal fans Code of practice for testing of positive displacement type air compressors and exhauster (For Test Tolerance Only) Forged ramshorn hooks Steel pipe flanges Code of practice for design of tower cranes Static and rail mounted Cross linked Polyethylene insulated PVC sheathed cables Specification for wrought aluminium and aluminium sheet and strips Air receivers for compressed air installation Displacement compressor-Acceptance test Methods of testing for rating of forced circulation air cooling Air cleaning device used in general ventilation for removing particle matter.	Entwurf DIN 15402 Blett 1 Entwurf DIN 15402 BS 3017-1958 BS 4504 : 1969 BS 2799 : 1956 Standard No. 1 to IPCEA (USA) Pub. No. 5-66-524	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 49 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	ASHRAE-22-72 Method of testing for rating of water cooled refrigerant condensers. ASHRAE 23-67 Methods of testing for rating of positive displacement refrigerant compressors. ARI-450-6 Standard for water cooled refrigerant condensers. ARI-550 Standard for centrifugal water chilling packages. ARI-410 Standard for forced circulation air cooling and air heating coils ARI-430/435 Central station AHU/Application of Central Station AHU BS:848 Fans (Part-1,2) BS:400 Low carbon steel cylinders for the storage & transport of permanent gases. BS:401 Low carbon steel cylinders for the storage & transport of liquified gases. CTI Code Acceptance test code for Water Cooling Tower. ACT-105 ANSI-31.5 Refrigerant piping ASME-PTC-23-1958 Atmospheric Water Cooling Equipment AMCA A-21C Test Code for air moving devices API:618 Reciprocating Compressor for general refinery services. HYDRAULIC INSTITUTE STANDARDS. HYDRANT SYSTEM MANUALS OF TAC. TAC MANUALS OF SPRAY SYSTEM NFPA USA/ NSC UK/ UL USA/ FM USA STANDARDS. INDIAN EXPLOSIVES ACT. INDIAN FACTORIES ACT. STANDARD OF TUBULAR EXCHANGER MANUFACTURER'S ASSOCIATION.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 50 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	CODE AND STANDARD FOR CIVIL WORKS Some of the applicable Standards, Codes and references are as follows: Excavation & Filling IS: 2720 (Part-II, IV TO VIII, XIV, XXI, XXIII, XXIV, XXVII TO XXIX, XL) Methods of test for soils-determination for water content etc. IS: 4701 Code of practice for earth work on canals. IS: 9758 Guide lines for Dewatering during construction. IS: 10379 Code of practice for field control of moisture and compaction of soils for embankment and sub-grade. Properties, Storage and Handling of Common Building Materials IS: 269 Specification for ordinary Portland cement, 33 grade. IS: 383 Specification for coarse and fine aggregates from natural sources for concrete. IS: 432 Specification for mild steel and (Parts 1&2) medium tensile steel bars and hard-drawn steel wires for concrete reinforcement. IS: 455 Specification for Portland slag cement. IS: 702 Specification for Industrial bitumen. IS: 712 Specification for building limes. IS: 808 Rolled steel Beam channel and angle sections. IS: 1077 Specification for common burnt clay building bricks. IS: 1161 Specification of steel tubes for structural purposes. IS: 1363 Hexagon head Bolts, Screws and nuts of production grade C. IS: 1364 Hexagon head Bolts, Screws and Nuts of Production grade A & B. IS: 1367 Technical supply conditions for Threaded fasteners. IS: 1489 Specification for Portland-pozzolana cement: (Part-I) Fly ash based.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 51 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	(Part-II) Calcined clay based. IS: 1542 Specification for sand for plaster. IS: 1566 Specification for hard-drawn steel wire fabric for concrete reinforcement. IS: 1786 Specification for high strength deformed bars for concrete reinforcement. IS: 2062 Specification for steel for general structural purposes. IS: 2116 Specification for sand for masonry mortars. IS: 2386 Testing of aggregates for concrete. (Parts-I to VIII) IS: 3150 Hexagonal wire netting for general purpose. IS: 3495 Methods of tests of burnt clay building bricks. (Parts-I to IV) IS: 3812 Specification for fly ash, for use as pozzolana and admixture. IS: 4031 Methods of physical tests for hydraulic cement. IS: 4032 Methods of chemical analysis of hydraulic cement. IS: 4082 Recommendations on stacking and storage of construction materials at site. IS: 8112 Specification for 43 grade ordinary portland cement. IS: 8500 Medium and high strength structural steel. IS: 12269 53 grade ordinary portland cement. IS: 12894 Specification for Fly ash lime bricks. Cast-In-Situ Concrete and Allied Works IS: 280 Specification for mild steel wire for general engineering purposes. IS: 456 Code of practice for plain and reinforced concrete.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 52 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS: 457 Code of practice for general construction of plain & reinforced concrete for dams & other massive structures. IS: 516 Method of test for strength of concrete. IS: 650 Specification for standard sand for testing of cement. IS: 1199 Methods of sampling and analysis of concrete. IS: 1791 General requirements for batch type concrete mixers. IS: 1838 (Part-I) Specification for preformed fillers for expansion joints in concrete pavements and structures (non-extruding and resilient type). IS: 2204 Code of practice for construction of reinforced concrete shell roof. IS: 2210 Criteria for the design of reinforced concrete shell structures and folded plates. IS: 2438 Specification for roller pan mixer. IS: 2502 Code of practice for bending and fixing of bars for concrete reinforcement. IS: 2505 General requirements for concrete vibrators, immersion type. IS: 2506 General requirements for concrete vibrators, screed board type. IS: 2514 Specification for concrete vibrating tables. IS: 2645 Specification for Integral cement water proofing compounds. IS: 2722 Specification for portable swing weigh batches for concrete. (single and double bucket type) IS: 2750 Specification for Steel scaffolding. IS: 2751 Code of practice for welding of mild steel plain and deformed bars for reinforced concrete construction. IS: 3025 Methods of sampling and test waste water. IS: 3366 Specification for Pan vibrators. IS: 3370 Code of practice for concrete structures for the storage of	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
PAGE 53 OF 83		

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	(Part I to IV)	liquids.		
	IS: 3414	Code of practice for design and installation of joints in buildings.		
	IS: 3550	Methods of test for routine control for water used in industry.		
	IS: 3558 concrete.	Code of practice for use of immersion vibrators for consolidating		
	IS: 4014 (Parts I & II)	Code of practice for steel tubular scaffolding.		
	IS: 4326 of buildings.	Code of practice for earthquake resistant design and construction		
	IS: 4461	Code of practice for joints in surface hydro-electric power stations.		
	IS: 4656	Specification for form vibrators for concrete.		
	IS: 4925	Specification for batching and mixing plant.		
	IS: 4990	Specification for plywood for concrete shuttering work.		
	IS: 4995 (Parts I & II)	Criteria for design of reinforced concrete bins for the storage of granular and powdery materials.		
	IS: 5256	Code or practice for sealing joints in concrete lining on canals.		
	IS: 5525 concrete work.	Recommendations for detailing of reinforcement in reinforced		
	IS: 5624	Specification for foundation bolts.		
	IS: 6461	Glossary of terms relating to cement concrete.		
	IS: 6494	Code of practice for water proofing of underground water reservoirs and swimming pools.		
	IS: 6509	Code of practice for installation of joints in concrete pavements.		
	IS: 7861	Code of practice for extreme weather concreting. (Parts I & II)		
	IS: 9012	Recommended practice for shot concreting.		
	IS: 9103	Specification for admixtures for concrete.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 54 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
		IS: 9417 Recommendations for welding cold worked steel bars for reinforced concrete construction. IS: 10262 Recommended guidelines for concrete mix design. IS: 11384 Code of practice for composite construction in structural steel and concrete. IS: 11504 Criteria for structural design of reinforced concrete natural draught cooling towers. IS: 12118 Specification for two-parts poly sulphide. IS: 12200 Code of practice for provision of water stops at transverse contraction joints in masonry and concrete dams. IS: 13311 Method of non-destructive testing of concrete. Part-1 Ultrasonic pulse velocity. Part-2 Rebound hammer. SP:23 Handbook of concrete mixes SP: 24 Explanatory Handbook on IS: 456-1978 SP: 34 Handbook on concrete reinforcement and detailing. Precast Concrete Works SP: 7(PartVI/ National Building Code- Structural design of prefabrication and Sec.7) systems building. IS: 10297 Code of practice for design and construction of floors and roofs using precast reinforced/prestressed concrete ribbed or cored slab units. IS: 10505 Code of practice for construction of floors and roofs using pre-cast reinforced concrete units. Masonry and Allied Works IS: 1905 Code of Practice for Structural Safety of Buildings-Masonry walls. IS: 2212 Code of Practice for Brickwork.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS PAGE 55 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
	IS: 2250 Code of Practice for Preparation and use of Masonry Mortar. SP: 20 Explanatory hand book on masonry code. Sheeting Works IS:277 Galvanised steel sheets (plain or corrugated). IS: 459 Unreinforced corrugated and semi-corrugated asbestos cement sheets. IS: 513 Cold-rolled carbon steel sheets. IS: 730 Specification for fixing accessories for corrugated sheet roofing. IS: 1626 Specification for Asbestos cement building pipes and pipe fittings, gutters and gutter fittings and roofing fittings. IS: 2527 Code of practice for fixing rain water gutters and down pipe for roof drainage. IS: 3007 Code of practice for laying of asbestos cement sheets. IS: 5913 Methods of test for asbestos cement products. IS: 7178 Technical supply conditions for tapping screw. IS: 8183 Bonded mineral wool. IS: 8869 Washers for corrugated sheet roofing. IS: 12093 Code of practice for laying and fixing of sloped roof covering using plain and corrugated galvanised steel sheets. IS: 12866 Plastic translucent sheets made from thermosetting polyster resin (glass fibre reinforced). IS: 14246 Specification for continuously pre-painted galvanised steel sheets and coils. Fabrication and Erection of Structural Steel Work IS: 2016 Specification for plain washers.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
			PAGE 56 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
	IS: 814 IS: 1852 IS: 3502 IS: 6911 IS: 3757 IS: 6623 IS: 6649 IS: 800 IS: 816 IS: 4000 IS: 9595 IS: 817 IS: 1811 IS: 9178 IS: 9006 IS: 7215 IS: 12843 IS: 4353 SP: 6 (Part 1 to 7)	Specification for covered Electrodes for Metal Arc Welding for weld steel. Specification for Rolling and Cutting Tolerances for Hot rolled steel products. Specifications for chequered plate. Specification for stainless steel plate, sheet and strip. Specification for high strength structural bolts Specification for high strength structural nuts. High Tensile friction grip washers. Code of practice for use of structural steel in general building construction. Code of practice for use of Metal Arc Welding for General Construction. Code of practice for assembly of structural joints using high tensile friction grip fasteners. Code of procedure of Manual Metal Arc Welding of Mild Steel. Code of practice for Training and Testing of Metal Arc Welders. Qualifying tests for Metal Arc Welders (engaged in welding structures other than pipes). Criteria for Design of steel bins for storage of Bulk Materials. Recommended Practice for Welding of Clad Steel. Tolerances for fabrication steel structures. Tolerance for erection of structural steel. Recommendations for submerged arc welding of mild steel and low alloy steels. ISI Hand book for structural Engineers.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 57 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	IS: 1608	Method of Tensile Testing of Steel products other than sheets, strip, wire and tube.	
	IS: 1599	Method of Bend Tests for Steel products other than sheet, strip, wire and tube	
	IS : 228	Methods of chemical Analysis of pig iron, cast iron and plain carbon and low alloy steel.	
	IS : 2595	Code of Practice for Radio graphic testing.	
	IS : 1182	Recommended practice for Radiographic Examination of fusion welded butt joints in steel plates.	
	IS : 3664	Code of practice for Ultra sonic Testing by pulse echo method.	
	IS : 3613	Acceptance tests for wire flux combination for submerged Arc Welding.	
	IS : 3658	Code of practice for Liquid penetrant Flaw Detection.	
	IS : 5334	Code of practice for Magnetic Particle Flaw Detection of Welds.	
	Plastering and Allied Works		
	IS : 1635	Code of practice for field slaking of Building lime and preparation of putty.	
	IS : 1661	Application of cement and cement lime plaster finishes.	
	IS : 2333	Plaster-of-paris.	
	IS : 2402	Code of practice for external rendered finishes.	
	IS : 2547	Gypsum building plaster.	
	IS : 3150	Hexagonal wire netting for general purpose.	
	Acid and Alkali Resistant Lining		
	IS : 158	Ready mixed paint, brushing, bituminous, black, lead free, acid, alkali & heat resisting.	
	IS : 412	Specification for expanded metal steel sheets for general purpose.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
			PAGE 58 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
	IS : 4441 IS : 4443 IS : 4456 IS : 4457 IS : 4832 IS : 4860 IS : 9510	Code of practice for use of silicate type chemical resistant mortars. Code of practice for use of resin type chemical resistant mortars. Method of test for chemical resistant tiles. (Part I & II) Specification for ceramic unglazed vitreous acid resistant tiles. Specification for chemical resistant mortars. Part I Silicate type Part II Resin type Part III Sulphur type Specification for acid resistant bricks. Specification for bitumasitc, Acid resisting grade. Water Supply, Drainage and Sanitation Specification for concrete pipes. Dimensions for pipe threads, where pressure tight joints are made on thread. Specification for salt glazed stoneware pipes. Flushing cisterns for water closets and urinals. Cast iron brackets and supports for wash basins and sinks. Copper alloy gate, globe and check valves for water works purposes. Cast copper alloy screw down bib taps and stop valves for water services. Caulking lead. Code of practice for laying of concrete pipes.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 59 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
	IS : 1172 IS : 1230 IS : 1239 IS : 1536 IS : 1537 IS : 1538 IS : 1703 IS : 1726 IS : 1729 IS : 1742 IS : 1795 IS : 1879 IS : 2064 IS : 2065 IS : 2326 IS : 2470 (Part-I & II) IS : 2501 IS : 2548 IS : 2556 (Part 1 to 15) IS : 2963	Basic requirements for water supply, drainage and sanitation. Cast iron rain water pipes and fittings. Mild steel tubes, tubulars and other wrought steel fittings. Centrifugally cast (Spun) iron pressure pipes for water, gas and sewage. Vertically cast iron pressure pipes for water, gas and sewage. Cast iron fittings for pressure pipe for water, gas and sewage. Ball valves (horizontal plunger type) including float for water supply purposes. Cast iron manhole covers and frames. Sand cast iron spigot and socket, soil, water and ventilating pipes, fittings and accessories. Code of practice for building drainage. Pillar taps for water supply purposes. Malleable cast iron pipe fittings. Code of practice for selection, installation and maintenance of sanitary appliances. Code of practice for water supply in building. Automatic flushing cisterns for urinals. Code of practice for installation of septic tanks. Copper tubes for general engineering purposes. Plastic seat and cover for water-closets. Vitreous sanitary appliances (vitreous china). Non-ferrous waste fittings for wash basins and sinks.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 60 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS : 3114 Code of practice for laying of cast iron pipes. IS : 3311 Waste plug and its accessories for sinks and wash basins. IS : 3438 Silvered glass mirrors for general purposes. IS : 3486 Cast iron spigot and socket drain pipes. IS : 3589 Electrically welded steel pipes for water, gas and sewage (200mm to 2000mm nominal diameter). IS : 3989 Centrifugally cast (Spun) iron spigot and socket soil, waste and ventilating pipes, fittings and accessories. IS : 4111 (Part I to IV) Code of practice for ancillary structure in sewerage system. IS : 4127 Code of practice for laying of glazed stone-ware pipes. IS : 4764 Tolerance limits for sewage effluents discharged into inland-surface waters. IS : 4827 Electro plated coating of nickel and chromium on copper and copper alloys. IS : 5329 Code of practice for sanitary pipe work above ground for buildings. IS : 5382 Rubber sealing rings for gas mains, water mains and sewers. IS : 5822 Code of practice for laying of welded steel pipes for water supply. IS : 5961 Cast iron grating for drainage purpose. IS : 7740 Code of practice for road gullies. IS : 8931 Cast copper alloy fancy bib taps and stop valves for water services. IS : 8934 Cast copper alloy fancy pillar taps for water services. IS : 9762 Polyethylene floats for ball valves. IS : 10446 Glossary of terms for water supply and sanitation.	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS
		PAGE 61 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS 		
	IS : 10592 IS : 12592 IS : 12701 SP: 35 - Doors, Windows and Allied Works IS : 204 Part-I Part-II IS : 208 IS : 281 IS : 362 IS : 420 IS : 1003 Part-I door IS : 1038 IS : 1081 IS : 1341 IS : 1361 IS : 1823 IS : 1868 IS : 2202 (Part-II)	Industrial emergency showers, eye and face fountains and combination units. Specification for precast concrete manhole covers and frames. Rotational moulded polyethylene water storage tanks. Hand book on water supply and drainage. Manual on Sewerage and sewage treatment (Published by CPH & EEO) As updated. Tower Bolts Ferrous metals. Nonferrous metals. Door Handles. Mild steel sliding door bolts for use with padlocks. Parliament Hinges. Specification for putty, for use on metal frames. Specification for timber panelled and glazed shutters- (Part-I) shutters. Steel doors, windows and ventilators. Code of practice for fixing and glazing of metal (steel and aluminium) doors, windows and ventilators. Steel butt hinges. Steel windows for industrial buildings. Floor door stoppers. Anodic coatings on Aluminium and its alloys. Specification for wooden flush door shutters (solid core type); particle board face panels and hard board face panels	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 62 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	IS:2209	Mortice locks (vertical type).		
	IS:2553	Safety glass		
	IS:2835	Flat transparent sheet glass.		
	IS:3548	Code of practice for glazing in buildings.		
	IS:3564	Door closers (Hydraulically regulated).		
	IS : 3614	Fire check doors; plate, metal covered and rolling type.		
	IS:4351	Steel door frames.		
	IS:5187	Flush bolts.		
	IS:5437	Wired and figured glass		
	IS:6248	Metal rolling shutters and rolling grills.		
	IS:6315	Floor springs (hydraulically regulated) for heavy doors.		
	IS:7196	Hold fasts.		
	IS:7452	Hot rolled steel sections for doors, windows and ventilators.		
	IS:10019	Mild steel stays and fasteners.		
	IS:10451	Steel sliding shutters (top hung type).		
	IS:10521	Collapsible gates.		
	R oof Water Proofing and AlliedWorks			
	IS:1203	Methods of testing tar and bitumen.		
	IS:1322	Specification for bitumen felts for water proofing and damp proofing.		
	IS:1346	Code of practice for water proofing of roofs with bitumen felts.		
	IS:1580	Specification for bituminous compound for water proofing and caulking purposes.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 63 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	IS:3067 Code of practice for general design details and preparatory work for damp proofing and water proofing of buildings. IS:3384 Specification for bitumen primer for use in water proofing and damp proofing. Floor Finishes and Allied Works IS:1237 Specification for cement concrete flooring tiles. IS:1443 Code of practice for laying and finishing of cement concrete flooring tiles. IS:2114 Code of practice for laying in-situ terrazzo floor finish. IS:2571 Code of practice for laying in-situ cement concrete flooring. IS:3462 Specification for unbacked flexible PVC flooring. IS:4971 Recommendations for selection of industrial floor finishes. IS:5318 Code of practice for laying of flexible PVC sheet and tile flooring. IS:8042 Specification for white portland cement. IS:13801 Specification for chequered cement concrete flooring tiles. Painting and Allied Works IS:162 Specification for fire resisting silicate type, brushing, for use on wood, colour as required. IS:1477 Code of practice for painting of ferrous metals in buildings. Part-I Pretreatment. Part-II Painting. IS:1650 Specification for colours for building and decorative finishes. IS:2074 Specification for red oxide-zinc chrome, priming, ready mixed paint air drying. IS:2338 Code of practice for finishing of wood and wood based materials. Part-I Operations and workmanship			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 64 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	Part-II	Schedules		
	IS:2395	Code of practice for painting concrete, masonry and plaster surfaces.		
	Part-I	Operations and workmanship.		
	Part-II	Schedule.		
	IS:2524	Code of practice for painting of nonferrous metals in buildings.		
	Part-I	Pretreatment.		
	Part-II	Painting.		
	IS:2932	Specification of synthetic enamel paint, exterior, under-coating and finishing.		
	IS:2933	Specification enamel paint, under coating and finishing.		
	IS:4759	Code of practice for hot dip zinc coating on structural steel and other allied products.		
	IS:5410	Specification for cement paint		
	IS:5411 (Part-I)	Specification for plastic emulsion paint-for exterior use		
	IS:6278	Code of practices for white washing and colour washing.		
	IS:10403	Glossary of terms relating to building finishes.		
	Piling and Foundation			
	IS:1080	Code of practice for design and construction of simple spread foundations.		
	IS:1904	Code of practice for design and construction of foundations in Soils; General Requirements.		
	IS:2911	Code of practice for designs and construction of Pile foundations (Relevant Parts).		
	IS:2950	Code of practice for designs and construction of Raft (Part-I) foundation.		
	IS:2974 (Part-I TO V)	Code of practice for design and construction of machine foundations.		
	IS:6403	Code of practice for determination of Allowable Bearing pressure on Shallow foundation.		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 65 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	IS:8009 Code of practice for calculation of settlement of foundation subjected to symmetrical vertical loads. Part-I Shallow foundations. Part-II Deep foundations. IS:12070 Code of practice for design and construction of shallow foundations on rocks. DIN:4024 Flexible supporting structures for machines with rotating machines. VDI:2056 Criteria for assessing mechanical vibrations of machines. VDI:2060 Criteria for assessing rotating imbalances in machines. Stop Log and Trash Rack IS:4622 Recommendations for fixed - wheel gates structural design. IS:5620 Recommendations for structural design criteria for low head slide gates. IS:11388 Recommendations for design of trash rack for intakes. IS:11855 General requirements for rubber seals for hydraulic gates. Roads IRC:5 Standard specifications and Code of practice for road bridges, section-I general Features of Design. IRC:14 Recommended practice of 2cm thick bitumen and tar carpets. IRC:16 Specification for priming of base course with bituminous primers. IRC:19 Standard specifications and code of practice for water bound macadam. IRC:21 Standard specifications and Code of practice for road bridges, section-III - Cement concrete (plain and reinforced). IRC:34 Recommendations for road construction in waterlogged areas. IRC:36 Recommended practice for the construction of earth embankments for road works. IRC:37 Guidelines for the Design of flexible pavements. IRC:56 Recommended practice for treatment of embankment slopes for erosion control. IRC:73 Geometric design standards for rural (non-urban) highways. IRC:86 Geometric Design standards for urban roads in plains.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 66 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	IRC:SP:13 Guidelines for the design of small bridges & culverts. IRC - Public- Ministry of Surface Transport (Roads Wing), Specifications ation for road and bridge works. IS:73 Specification for paving bitumen Loadings IS:875 Code of practice for design loads other than earthquake) for (Pt. I to V) buildings and structures. IS:1893 Criteria for earthquake resistant design of structures. IS:4091 Code of Practice for design and construction of foundation for transmission line towers & poles. IRC:6 Standard specifications & code of practice for road bridges, Section-II Loads and stresses. M.O.T. Deptt. of railways Bridge Rules. Safety IS:3696 Safety code for scaffolds and ladders. (Part I & II) IS:3764 Safety code for excavation work. IS:4081 Safety code for blasting and related drilling operations. IS:4130 Safety code for demolition of buildings. IS:5121 Safety code for piling and other deep foundations. IS:5916 Safety code for construction involving use of hot bituminous materials. IS:7205 Safety code for erection on structural steelwork. IS:7293 Safety code for working with construction machinery. IS:7969 Safety code for handling and storage of building materials IS:11769 Guidelines for safe use of products containing asbestos. - Indian Explosives Act. 1940 as updated. Architectural design of buildings SP:7 National Building Code of India SP:41 Hand book on functional requirements of buildings (other than industrial buildings)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 67 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	Miscellaneous IS:802 Code of practice for use of structural steel in (Relevant parts) overhead transmission line towers. IS:803 Code of practice for design, fabrication and erection of vertical mild steel cylindrically welded in storage tanks. IS:10430 Criteria for design of lined canals and liner for selection of type of lining. IS:11592 Code of practice for selection and design of belt conveyors. IS:12867 PVC handrails covers. CIRIA Design and construction of buried thin-wall pipes. Publication			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS	PAGE 68 OF 83	

MFGR.'s LOGO	MANUFACTURER'S NAME AND ADDRESS	MANUFACTURING QUALITY PLAN				PROJECT :
		ITEM :	QP NO.: REV.NO.: DATE: PAGE: OF	PACKAGE : CONTRACT NO. : MAIN-SUPPLIER:		

[illegible]

SUPPLIER'S LOGO	SUPPLIER'S NAME AND ADDRESS	FIELD QUALITY PLAN		PROJECT : PACKAGE : CONTRACT NO. : MAIN-SUPPLIER:
		ITEM :	QP NO.: REV. NO.: DATE: PAGE: OF	

[illegible]

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. LEGEND TO BE USED: CLASS # : A = CRITICAL, B=MAJOR, C=MINOR; 'A' SHALL BE WITNESSED BY NTPC FQA, 'B' SHALL BE WITNESSED BY NTPC ERECTION / CONSTRUCTION DEPTT, AND 'C' SHALL BE WITNESSED BY MAIN SUPPLIER (A & B CHECK SHALL BE NTPC CHP STAGE)		DOC. NO.:		REV.....	
MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER			FOR NTPC USE			
SIGNATURE				REVIEWED BY	APPROVED BY	APPROVAL SEAL	
FORMAT NO.: QS-01-QAI-P-09/F2-R1						1/1	
						ENGG. DIV./QA&I	

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI RID DOC NO.:CS-0011-109(3)1.9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 77 OF 83
---	--	--	-----------------------------

ANNEXURE-III

		Project : Package : Supplier : Contractor No. :		Stage :	LIST OF ITEMS REQUIRING QUALITY PLAN AND SUB-SUPPLIER APPROVAL					DOC. NO.: REV. NO.: DATE : PAGE : OF	
SUB-SYSTEM :											
S. N.	Item	QP/ Insp. Cat.	QP No.	QP Sub. Schedule	QP approval schedule	Proposed sub-supplier	Place	Sub-suppliers approval status / category	Sub-supplier Details on schedule	Remarks	

LEGENDS
SYSTEM SUPPLIER/SUB-SUPPLIER APPROVAL STATUS CATEGORY (SHALL BE FILLED BY NTPC)
A – For these items proposed vendor is acceptable to NTPC. To be indicated with letter “A” in the list alongwith the condition of approval, if any.
DR – For these items “Detailed required” for NTPC review. To be identified with letter “DR” in the list.
NOTED – For these items vendors are approved by Main Supplier and accepted by NTPC without specific vendor approval from NTPC. To be identified with “NOTED.”
QP/INSPN CATEGORY:
CAT-I : For these items the Quality Plans are approved by NTPC and the final acceptance will be on physical inspection witness by NTPC.
CAT-II : For these items the Quality Plans approved by NTPC. However no physical inspection shall be done by NTPC. The final acceptance by NTPC shall be on the basis review of documents as per approved QP.
CAT-III : For these items Main Supplier approves the Quality Plans. The final acceptance by NTPC shall be on the basis certificate of conformance by the main supplier.
UNITS/WORKS : Place of manufacturing Place of Main Supplier of multi units/works.

FORMAT NO.: QS-01-QAI-P-1/F3-R0

1/1

Engg. Div. / QA&I

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.: CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENT	PAGE 78 OF 83
---	---	---	---------------

ANNEXURE-IV

	Project : Package : Contractor : Contractor No. :		Stage :		STATUS OF ITEM REQUIRING QP& SUB-SUPPLIER APPROVAL					DOC. NO.: REV. NO.: DATE : PAGE : OF		
	S. N.	Item / Service	QP/ Insp. Cat.	QP Sub. Schedule Approval schedule	Date of sub-mission	Date of comm t Appl.	Status Code C/III	Proposed Sub-suppliers	Place of manufacturing works	Approval Status	Sub-supplier detail submission schedule	Remarks
FORMAT												
1/1 Engg. Div. / QA&I												

LOT-3 PROJECTS STEAM GENERATOR ISLAND PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(3)-2	GENERAL TECHNICAL REQUIREMENT	PAGE 79 OF 83
--	---	----------------------------------	---------------

ANNEXURE-V

		Project : _____		Stage : _____		FIELD WELDING SCHEDULE (To be raised by the contractor)				DOC. NO.: _____					
		Contractor : _____		Contractor No. : _____		Welding Code: _____				REV. NO.: _____					
		System : _____		_____		_____				DATE : _____					
		_____		_____		_____				PAGE : _____ OF _____					
Sl. No.	DKG No. for Weld Location and Identification mark	Description of parts to welded	Matl. Spec.	Dimensions	Process of welding	Type of Weld	Electrode filler spec.	WPS. No.	Min. pre-heat	Heat treatment Temp.	Holding time	NDT method/Quantum	REF Spec. No.	ACC Norm Ref.	Remarks
NOTES:															
SIGNATURE															
FORMAT															
Engg. Div. / QA&I															

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	LOT-3 PROJECTS	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(3)-2	GENERAL TECHNICAL REQUIREMENT	PAGE 80 OF 83
--	----------------	---	----------------------------------	---------------

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)																																																																																													
	<table border="1"> <thead> <tr> <th>S.No</th><th>Description of Drgs/Docs</th><th>No of Prints</th><th>No of ROMs/DVDs/Portable Hard Disk</th><th>CD</th></tr> </thead> <tbody> <tr> <td>1</td><td>Drawings, Data sheets, Design calculations, Purchase specifications and other documents</td><td></td><td></td><td></td></tr> <tr> <td></td><td>First submission and submission with major changes</td><td></td><td></td><td></td></tr> <tr> <td></td><td>▪ Layout (A0&A1 sizes)</td><td>4</td><td>-</td><td></td></tr> <tr> <td></td><td>▪ Other Drawings/Documents (A0&A1 sizes)</td><td>2</td><td>-</td><td></td></tr> <tr> <td></td><td>▪ P&ID (All sizes)</td><td>4</td><td>-</td><td></td></tr> <tr> <td></td><td>a) Final drawings/documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr> <tr> <td></td><td>b) "As Built" Drawing/Documents (Directly to site)</td><td>6</td><td>2</td><td></td></tr> <tr> <td></td><td>c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.</td><td>2</td><td>2</td><td></td></tr> <tr> <td>2</td><td>Erection Manual (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr> <tr> <td>3</td><td>Operation & Maintenance manual</td><td>1 set</td><td>--</td><td></td></tr> <tr> <td></td><td>i) First Submission</td><td></td><td></td><td></td></tr> <tr> <td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr> <tr> <td>4</td><td>Plant Hand Book</td><td></td><td></td><td></td></tr> <tr> <td></td><td>i) First Submission</td><td>1</td><td>1</td><td></td></tr> <tr> <td>5</td><td>Commissioning and Performance Test Procedure manual</td><td>1 set</td><td>--</td><td></td></tr> <tr> <td></td><td>i) First Submission</td><td></td><td></td><td></td></tr> <tr> <td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td><td></td></tr> </tbody> </table>				S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD	1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents					First submission and submission with major changes					▪ Layout (A0&A1 sizes)	4	-			▪ Other Drawings/Documents (A0&A1 sizes)	2	-			▪ P&ID (All sizes)	4	-			a) Final drawings/documents (Directly to site)	6	2			b) "As Built" Drawing/Documents (Directly to site)	6	2			c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2		2	Erection Manual (Directly to site)	4 sets	2		3	Operation & Maintenance manual	1 set	--			i) First Submission					ii) Final Submission (Directly to site)	4 sets	2		4	Plant Hand Book					i) First Submission	1	1		5	Commissioning and Performance Test Procedure manual	1 set	--			i) First Submission					ii) Final Submission (Directly to site)	4 sets	2	
S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD																																																																																										
1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents																																																																																													
	First submission and submission with major changes																																																																																													
	▪ Layout (A0&A1 sizes)	4	-																																																																																											
	▪ Other Drawings/Documents (A0&A1 sizes)	2	-																																																																																											
	▪ P&ID (All sizes)	4	-																																																																																											
	a) Final drawings/documents (Directly to site)	6	2																																																																																											
	b) "As Built" Drawing/Documents (Directly to site)	6	2																																																																																											
	c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2																																																																																											
2	Erection Manual (Directly to site)	4 sets	2																																																																																											
3	Operation & Maintenance manual	1 set	--																																																																																											
	i) First Submission																																																																																													
	ii) Final Submission (Directly to site)	4 sets	2																																																																																											
4	Plant Hand Book																																																																																													
	i) First Submission	1	1																																																																																											
5	Commissioning and Performance Test Procedure manual	1 set	--																																																																																											
	i) First Submission																																																																																													
	ii) Final Submission (Directly to site)	4 sets	2																																																																																											
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI																																																																																										
				PAGE 81 OF 83																																																																																										

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)				
	S.No	Description of Drgs/Docs	No of Prints	No of ROMs/DVDs/Portable Hard Disk	CD
	6	Performance and Functional Guarantee Test Report			
		i) First Submission	2 sets	—	
		ii) Approved Copies (Direct to Site)	4 sets	2	
	7	Project Completion Report (Directly to site)	6 sets	2	
	8	QA programme including Organisation for implementation and QA system manual(with revisions)	1	—	
	9	Vendor details in respect of proposed vendors including contractor's evaluation report.	2	—	
	10	Manufacturing QPs, Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc			
		i) For review/comment	1	—	
		ii) Approved final copies of Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc (Direct to Site)	4	2	
	11	Welding Manual, Heat Treatment Manuals, Storage & preservation manuals			
		i) For review/comment	1 set	—	
		ii) Approved copies (Direct to Site)	4 sets	2	
	12	QA Documentation Package for items / equipment manufactured and despatched to site	2 sets	2	
	13	QA Documentation Package for field activities on equipment/systems at site	2 sets	2	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-C GENERAL TECHNICAL REQUIREMENTS Annexure-VI	PAGE 82 OF 83

6/2020/PS-PEM-MAX		ANNEXURE-VII																					
GENERAL TECHNICAL REQUIREMENTS																							
CLAUSE NO.																							
<table border="1"> <thead> <tr> <th colspan="4">AREAS OF TRAINING REQUIREMENT</th> </tr> <tr> <th>PRODUCT</th> <th>PRODUCT DESIGN</th> <th>Plant Visit</th> <th>Visit to Manufacturer's Work</th> </tr> </thead> <tbody> <tr> <td>FGD</td> <td> Layout & model of FGD area, cable & piping trestles etc. FGD • Mass balance, Design, selection and sizing calculations of FGD system, • Training on factors affecting sizing/ efficiency of FGD system, equipments & auxiliaries • Materials for FGD & selection • Basic concepts, Design and sizing calculations on slurry systems including piping, valves, etc.. • FGD electrical system • FGD control system Erection strategies, erection procedures Performance as per applicable code and demonstration tests. </td> <td> Familiarization with various system and equipment Performance, data collection analysis and review O&M feed back Operation history of various equipments and system Failure analysis </td> <td> Manufacturing process of Absorber and equipments Welding process Testing facilities Product development in process Future plan for technology induction R&D work in progress </td> </tr> <tr> <td>MAN/MONTH</td> <td>2</td> <td>0.5</td> <td>0.5</td> </tr> <tr> <td colspan="4"> Control philosophy operation, notices, logic & protection schemes, O&M manual familiarization O&M issues. Familiarization of special maintenance techniques Special tool and tackles familiarization </td> </tr> </tbody> </table>				AREAS OF TRAINING REQUIREMENT				PRODUCT	PRODUCT DESIGN	Plant Visit	Visit to Manufacturer's Work	FGD	Layout & model of FGD area, cable & piping trestles etc. FGD • Mass balance, Design, selection and sizing calculations of FGD system, • Training on factors affecting sizing/ efficiency of FGD system, equipments & auxiliaries • Materials for FGD & selection • Basic concepts, Design and sizing calculations on slurry systems including piping, valves, etc.. • FGD electrical system • FGD control system Erection strategies, erection procedures Performance as per applicable code and demonstration tests.	Familiarization with various system and equipment Performance, data collection analysis and review O&M feed back Operation history of various equipments and system Failure analysis	Manufacturing process of Absorber and equipments Welding process Testing facilities Product development in process Future plan for technology induction R&D work in progress	MAN/MONTH	2	0.5	0.5	Control philosophy operation, notices, logic & protection schemes, O&M manual familiarization O&M issues. Familiarization of special maintenance techniques Special tool and tackles familiarization			
AREAS OF TRAINING REQUIREMENT																							
PRODUCT	PRODUCT DESIGN	Plant Visit	Visit to Manufacturer's Work																				
FGD	Layout & model of FGD area, cable & piping trestles etc. FGD • Mass balance, Design, selection and sizing calculations of FGD system, • Training on factors affecting sizing/ efficiency of FGD system, equipments & auxiliaries • Materials for FGD & selection • Basic concepts, Design and sizing calculations on slurry systems including piping, valves, etc.. • FGD electrical system • FGD control system Erection strategies, erection procedures Performance as per applicable code and demonstration tests.	Familiarization with various system and equipment Performance, data collection analysis and review O&M feed back Operation history of various equipments and system Failure analysis	Manufacturing process of Absorber and equipments Welding process Testing facilities Product development in process Future plan for technology induction R&D work in progress																				
MAN/MONTH	2	0.5	0.5																				
Control philosophy operation, notices, logic & protection schemes, O&M manual familiarization O&M issues. Familiarization of special maintenance techniques Special tool and tackles familiarization																							
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9	PART-C GENERAL TECHNICAL REQUIREMENTS ANNEXURE-VII																				
		PAGE 83 OF 83																					

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C2B	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

**PROJECT SPECIFIC GENERAL REQUIREMENTS:
QUALITY ASSURANCE**

CLAUSE NO.		QUALITY ASSURANCE			
1.08.00		STRUCTURES , DUCTS, HOPPERS:			
1.08.01		All materials shall be tested for chemical and mechanical properties as per relevant standard. All plates above 40mm shall be 100% Ultrasonically tested.			
1.08.02		Visual inspection of all welds shall be performed in accordance with AWS D1.1.			
1.08.03		NDT requirements of structural steel welds shall be as under:			
		i) 100% RT/UT on butt-welds of plate thickness>= 32mm.			
		ii) For plates of 25mm<=thickness<32mm-10% RT and 100% MPI.			
		iii) For plates of thickness <25mm-10% MPI/LPI.			
1.08.04		Edge for shop and field weld shall be examined by MPI for plate thickness >= 32mm.			
1.09.00		VACUUM BELT FILTER SYSTEM:			
1.09.01		Impeller, casing and shaft of vacuum pumps shall be tested for chemical and mechanical properties as per relevant standard. All plates above 40mm shall be 100% Ultrasonically tested.			
1.09.02		UT on shaft (if greater or equal to 40mm) and impeller shall be carried out.			
1.09.03		All vacuum pumps shall be tested at shop for capacity, power, pressure, efficiency, noise and vibration etc.			
1.09.04		Filter cloths and belts shall be tested for physical properties as per relevant standard			
1.09.05		Hydro cyclones shall be checked by visual, dimensional etc.			
1.10.00		SPRAY NOZZLES:			
1.10.01		Spray nozzles shall be tested for physical properties			
1.10.02		Spray nozzles also shall be subjected to performance test.			
1.11.00		AGITATORS:			
1.11.01		Rubber lining shall be tested for hardness and spark test			
1.11.02		Impellers shall be tested for dimensional and balancing check			
1.11.03		Gear Boxes shall be tested for run test as per standard practice			
1.12.00		FANS:			
1.12.01		Rotor components shall be subjected to ultrasonic test at mill and magnetic particle inspection / liquid penetrant examination after rough machining.			
1.12.02		Butt welds in rotor components shall be subjected to 100% RT and all welds shall be magnetic particle/dye penetrant tested after stress relieving.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-B SUB-SECTION-V-QM1 FGD SYSTEM	
				Page 3 of 4	

U/PS-PEM-MAX		QUALITY ASSURANCE			
CLAUSE NO.					
1.12.03	All rotating components and assemblies of fan shall be balanced dynamically				
1.12.04	Performance test shall be carried out on fans as per Technical specification/ Relevant standard				
1.12.05	Test for Natural Frequency and hardness of Fans blades shall be carried out as per Technical specification/ Relevant standard				
1.13.00	Thermal Insulation, Lagging & Cladding: (a) Lightly resin bonded mineral wool: LRB mattresses/sections of Rockwool/ Glasswool shall conform to & tested as per relevant clauses of Indian Standards and shall meet the requirements of NTPC data sheet. Type tests except Thermal Conductivity shall be regularly carried out once in three months, Thermal Conductivity Type Test shall be carried out minimum once in twelve months by the manufacturer. Requirements of various components like Binding wires, Lacing wires, Wire mesh, etc. shall be as per NTPC approved data sheet / as given in respective Sub-Section of Technical Requirements of Steam Generator & Auxiliaries. (b) Lagging & Cladding: All insulation shall be protected by means of an outer covering of Aluminium sheeting confirming to ASTM B-209-1060 temper H14 from reputed manufacturer meeting the requirements of NTPC data sheet.				
1.14.00	OTHER CRITICAL EQUIPMENTS:				
1.14.01	Checks/ NDTs shall be done as per relevant Indian Standards or equivalent International Standards.				
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9		PART-B SUB-SECTION-V-QM1 FGD SYSTEM	
				Page 4 of 4	

CLAUSE NO.	QUALITY ASSURANCE			
	(b.) Longitudinal butt weld on bellow shall be subjected to suitable NDT examination before forming, and after forming MPE / DP test shall be carried out. (c.) All welds shall be subjected to 100% magnetic particle/dye pentrant check and butt welds shall be subjected to 100% radiographic testing. (d.) All the bellows subjected to vacuum service shall be subjected to vacuum test. (e.) The bellows shall be subjected to movement test to establish suitability to perform satisfactorily in site conditions. During this test spring rate shall also be measured. (f.) The testing of MEJ shall be as per Expansion joint Manufacturer Association (EJMA) standard.			

QUALITY ASSURANCE

10. Atmospheric Storage Tanks/ Pressure Vessels		Y ^a	Y	Y ^b	Y	Y	Y ⁸	Y		Y ^c	Y ^f	
Tests/Check	Items / Components	Material Test	WPS/PQR/Welder Qualification	DPT/MPI	Assembly Fit up	Dimension	RT	Hydraulic / Water Fill	Performance Test	Test as per relevant Std/ Appd. Data Sheets	Other Tests	Remarks
11. Rubber lining		Y ^a				Y				Y	Y ⁹	Y ^f Heat Treatment of the Tank/Vessel shall be done per fabrication code requirement. Welded dished ends shall be stress relieved. Dished ends manufactured by cold working shall also be stress relieved as per the requirement of code.
12. Butterfly valves(HP)		Y ^a			Y	Y		Y	Y			
13. Ball valves(HP)		Y ^a			Y	Y		Y	Y			
12. Resins / Activated Carbon Filter		Y ^a	Y	Y ^b	Y	Y				Y	Y ¹⁰	
13. Hoists & Cranes		Y ^a	Y	Y ^b	Y	Y	Y ⁸		Y	Y		Y ⁸ RT as per fabrication code requirements. However, dished ends welds, if manufactured by using welded plates shall be subjected to 100% RT. Y ⁹ Rubber Lining Mix shall be subjected to Bleed Resistance Test on mould sample. Adhesion Test, Spark Test and Hardness Test for the Rubber lined jobs shall also be conducted. Y ¹⁰ Gear Boxes shall be checked for smooth No Load Operation at shop to verify noise and vibration levels. Gear Ratio and Kerosene Leak Test shall also be conducted. Y ¹¹ One Fan of each type & size shall be routine performance tested as per corresponding code for air flow, static pressure, total pressure, speed, efficiency, power consumption, noise & temperature rise. Also all Fans shall be subjected to run test of 4 hours during which noise, vibration, temperature rise and current drawn shall be measured. Y ¹² Dry cycle test on valve spring for 1, 00,000 cycles shall be carried out as type test, if not carried out earlier, for the similar MOC, size and type of spring.
14. Agitators /Flash Mixer/ Flocculator		Y ^a	Y	Y ^b	Y	Y			Y		Y ¹⁰	
15. Pipes (Fabricated)		Y ^a	Y	Y	Y	Y	Y	Y		Y		
16. Ventilation/Exhaust Fan		Y ^a		Y ^b	Y	Y			Y ¹¹	Y	Y ^{dc}	
After erection, the complete Piping system along with valves & fittings shall be hydraulically tested at 1.5 times design pressure or 2 times working pressure whichever is higher.												

		MANUFACTURING QUALITY PLAN												
		ITEM: AGITATOR												
		Page 1 of 2												
SL. NO.	COMPONENT OPERATION &	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTITY OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					M	C/N					M	C	N	
1	2	3	4	5	6		7	8	9	D*	10			11

1.0	Raw Material Inspection													
1.1	All materials including casting & forgings	Chem. & Mech. Dimensions Surface Defects	MA MA MA	Review of MTC Measurement Visual	1/Heat 100% 100%	1/H eat - -	As per Spec. & Appd. Dwg.	TC IR IR	√	P P P	V - -	V - -		
2.0	Motor: Review of Manufacture Test Certificate													
3.0	In Process Inspection													
3.1	Welding Qualifications	WPS & PQR	MA	WPS, PQR & WPQ	100%		ASME Sec IX	IR	√	P	V	V	Recent qualified WPS,PQR and WPQ shall be submitted for review during inspection.	
3.2	Marking, Cutting, Edge Preparation Tacking	Dimensions	MA	Measurement	100%	-	Appd. Dwg.	IR		P	-	-		
3.3	Welds	Dimensions & Surface Quality	MA	Measurement & Visual	100%		Appd. Dwg. & ASME Sec VIII	IR	√	P	W	V		
3.4	Machining of Components	Dimensions Surface Defects	MA	Measurement Visual	100% 100%	- -	Appd. Dwg.	IR		P P	- -	- -		
3.5	Impeller	Static balance test	MA	Measurement	100%		As per Specs.	TR	√	P	V	V		
3.6	Rubber Lining	Hardness test & Spark test	MA	Measurement	100%		As per Specs./ Appd. Drg.	TR	√	P	W	V		
3.7	Assembly	Dimensions Completeness	MA	Measurement Visual	100% 100%		Appd.Drg.	IR	√	P P	V V	V V		
4.0	Final Inspection													
4.1	Final Assembly	Overall Dimensions & Completeness	MA MA	Measurement Visual	100% 10%	*	As per Drawing / Data Sheet	Certification signature by Rakesh Sharma Rakesh_sharma@ntpcceoc.com Unknown Digitally signed by Rakesh Sharma Date: 2018.12.21 16:26:59 IST Reason: CAT IP Location: NTPCEOC						
4.2	Free Air Run Test of complete assembly	Measurement Current, RPM, Noise &	MA	Measurement	100%	10%	Vendor S				W	W		

* 10% of each type (Vertical/horizontal)

		MANUFACTURING QUALITY PLAN												
		ITEM: AGITATOR												
		Page 2 of 2												
SL. NO.	COMPONENT OPERATION &	CHARATERISTICS	CLASS	TYPE OF CHECK	QUATUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	M	C/N	7	8	9	D*	M	C	N	11

4.3	Review of QA Documents	Vibration Verification of QA Documents	MA	Verification	100%	100%	As per Appd.MQP	IR		P	V	V	
5.0	Painting & Preservation												
5.1		Painting material	MI	Review of MTC	100%		Appd. "Painting Procedure" / Approved Painting Schedule	IR	√	P	V	-	
5.2		Surface treatment and inspection	MI	Visual	100%	-	-do-	IR	√	P	-	-	
5.3		DFT Check	MI	Measurement	10%		-do-	IR	√	P	V	-	
5.4		Painting Surface Quality	MI	Visual	100%		-do-	IR	√	P	V	-	
6.0	Inspection before Delivery												
6.1	Packing	Size, appearance & firmness	MI	Measurement & Visual	100%		As per "Packing Procedure"	IR	√	P	V	-	
6.2	Deliver Documents	Markings, Packing List & Detail Packing List, etc. Check	MI	Verification	100%		As per "Packing Procedure"	IR	√	P	V	-	

NOTES: 1. For Agitator Motor | make NTPC/BHEL Approved source.

2. Routine test report duly witnessed by main contractor as per applicable standard shall be reviewed during inspection (more than 30KW Rating).

3. Bidder to consider these test as minimum, NTPC comments on this QAP for addition of any new test and / or witness of any test shall have no price implication on BHEL.

CLAUSE NO.

QUALITY ASSURANCE



MOTOR

TESTS/CHECKS TEMS/COMPONENTS	Visual	Dimensional	Make/Type/Rating Physical Inspection /General	Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034\IEC 60079-I/ IS-12615	Vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
Plates for stator frame, end shield, spider etc.	Y	Y	Y	Y	Y				Y										
Shaft	Y	Y	Y	Y	Y	Y			Y										
Magnetic Material	Y	Y	Y	Y			Y			Y									
Rotor Copper/Aluminium	Y	Y	Y	Y			Y		Y										
Stator copper	Y	Y	Y	Y			Y		Y			Y							
SC Ring	Y	Y	Y	Y	Y		Y	Y	Y										
Insulating Material	Y		Y	Y			Y					Y							
Tubes, for Cooler	Y	Y	Y	Y	Y				Y		Y								
Sleeve Bearing	Y	Y	Y	Y	Y				Y		Y								
Stator/Rotor, Exciter Coils	Y	Y	Y				Y	Y											
Castings, stator frame, terminal box and bearing housing etc.	Y	Y	Y	Y	Y			Y											
Fabrication & machining of stator, rotor, terminal box	Y	Y			Y			Y	Y										

LOT-3 PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION – VI
BID DOC. NO.:CS-0011-109(3)-9

PART-B
SUB-SECTION-V-QE1
MOTORS

PAGE 1 OF 2

CLAUSE NO.	QUALITY ASSURANCE																			
Wound stator	Y	Y					Y	Y												
Wound Exciter	Y	Y					Y	Y												
Rotor complete	Y	Y					Y						Y	Y						
Exciter, Stator, Rotor, Terminal Box assembly	Y	Y					Y													
Accessories, RTD, BTD,CT, Space heater, antifriction bearing, gaskets etc.	Y	Y	Y																	
Complete Motor	Y	Y	Y												Y	Y	Y	Y1 Y		
Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW. 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard 3. Makes of major bought out items for HT motors will be subject to NTPC approval. 4. Y1 = for HT Motor / Machines only.																				
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE						TECHNICAL SPECIFICATION SECTION – VI BID DOC. NO.:CS-0011-109(3)-9						PART-B SUB-SECTION-V-QE1 MOTORS				PAGE 2 OF 2				

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-C, SUB-SECTION-C2B	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

CUSTOMER SPECIFICATION: FUNCTIONAL GUARANTEES

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
2.02.00	Test Instrumentation, Flow Measurement and their Calibration			
2.02.01	All instruments required for performance testing shall be of the type and accuracy required by the code and prior to the test, the Contractor shall get these instruments calibrated in an independent test Institute approved by the Employer and submit the same to Employer prior to commencement of test. All test instrumentation required for performance tests shall be supplied by the Contractor and shall be retained by him upon satisfactory completion of all such tests at site. All calibration procedures and standards shall be subject to the approval of the Employer prior to commencement of test. The protecting tubes, pressure connections and other test connections required for conducting guarantee test shall conform to the relevant codes. Tools and tackles, thermowells (both screwed and welded) instruments/devices including flow devices, matching flanges, impulse piping & valves etc. and any special equipment, required for the successful completion of the tests, shall be provided by the Contractor free of cost. The Performance test shall be carried out as per the agreed procedure. The detailed PG test procedure shall be submitted within 90 days of the date of Notification of Award and finalization of the PG test procedure shall be done within 180 days from the date of Notification of Award.			
2.02.02	The P&G test procedures shall be submitted for equipments/system & subsystem under Contractor's scope for all Guarantees as mentioned below, as per latest International codes / standard including correction curves, meeting the specification requirements along with sample calculations & detailed activity plan of preparation (including test instrumentation), conductance and evaluation of Guarantees.			
2.02.03	The Contractor shall submit for Employer's approval the detailed Performance Test procedure containing the following: (a) Object of the test. (b) Various guaranteed parameters & tests as per contract. (c) Method of conductance of test and test code. (d) Duration of test, frequency of readings & number of test runs. (e) Method of calculation. (f) Correction calculations & curves. (g) Instrument list consisting of range, accuracy, least count, and location of instruments.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 2 OF 30

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
3.00.00	Accept the equipment /system/ plant after levying Liquidated Damages. The liquidated damages for shortfall in performance indicated in clause 3.00.00 of this sub-section shall be levied separately for each unit. The rates indicated in clause 3.00.00 of this sub-section are on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units where common absorber has been specified for two / three units based on scope of supply, LD values are applicable for combination of units as indicated in the clause 3.00.00 The liquidated damages shall be pro-rated for the fractional parts of the deficiencies. (ii) For Category-II Guarantees In case during performance guarantee test(s) it is found that the equipment/system has failed to meet the guarantees, the Contractor shall carry out all necessary modifications and/or replacements to make the equipment/system comply with the guaranteed requirements at no extra cost to the Employer and re-conduct the performance guarantee test(s) with Employer's consent. In case the specified performance guarantee(s) are still not met even after the above modifications/replacements within ninety (90) days or a reasonable period allowed by the Employer, after the tests have been completed, the Employer will have the right to either of the following: Reject the equipment /system / plant and recover from the Contractor the payments already made. OR Accept the equipment/system after assessing the deficiency in respect of the various ratings, performance parameters and capabilities and recover from the contract price an amount equivalent to the damages as determined by the Employer. Such damages shall, however be limited to the cost of replacement of the equipment(s)/system(s), replacement of which shall remove the deficiency so as to achieve the guaranteed performance. These parameters/capacities shall be termed as "Category-II" Guarantees. AMOUNT OF LIQUIDATED DAMAGES (LD) APPLICABLE FOR GUARANTEES FOR EACH PROJECT The rate of liquidated damages and acceptable shortfall limits for different guarantees shall be as under and such liquidated damages shall be deducted from the Contract Price of the project.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 4 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			एनटीपीसी NTPC
	<u>RAMAGUNDAM (3X500 MW)</u>			
	Sl.No	Guarantee	Rate of Liquidated Damage (LD)	Acceptable Shortfall Limit with LD
	i)	SO2 Removal Efficiency For shortfall in guaranteed SO2 removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.	INR 2,451,908 /- (INR Two Million Four Hundred Fifty One Thousand Nine Hundred Eight only) for every 0.1% point shortfall in SO2 removal efficiency from the guaranteed value.	(-)0.25% point from the guaranteed SO2 removal efficiency.
	ii)	Limestone Consumption For increase in the limestone consumption of FGD system in Kg/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.	INR 21,118,247 /- (INR Twenty One Million One Hundred Eighteen Thousand Two Hundred Forty Seven only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.	(+)10% of the guaranteed limestone consumption.
	iii)	Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.	INR 249,478 /- (INR Two Hundred Forty Nine Thousand Four Hundred Seventy Eight only) for every KW increase in Auxiliary power consumption from the guaranteed value.	(+)1% of the guaranteed auxiliary power consumption
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9 SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES PAGE 11 OF 30				

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	<u>RAMAGUNDAM St-II (3X200 MW) Common FGD system</u>			
	Sl.No	Guarantee	Rate of Liquidated Damage (LD)	Acceptable Shortfall Limit with LD
	i)	SO2 Removal Efficiency For shortfall in guaranteed SO2 removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.	INR 3,633,561/- (INR Three Million Six Hundred Thirty Three Thousand Five Hundred Sixty One only) for every 0.1% point shortfall in SO2 removal efficiency from the guaranteed value.	(-)0.25% point from the guaranteed SO2 removal efficiency.
	ii)	Limestone Consumption For increase in the limestone consumption of FGD system in Kg/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.	INR 20,812,843/- (INR Twenty Million Eight Hundred Twelve Thousand Eight Hundred Forty Three only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.	(+)10% of the guaranteed limestone consumption.
	iii)	Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.	INR 249,478 /- (INR Two Hundred Forty Nine Thousand Four Hundred Seventy Eight only) for every KW increase in Auxiliary power consumption from the guaranteed value.	(+)1% of the guaranteed auxiliary power consumption
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9		SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES
PAGE 12 OF 30				

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
4.00.00 4.01.00	NOTES APPLICABLE FOR EACH PROJECT: i) Each of the liquidated damages specified above shall be independent and these liquidated damages shall be levied concurrently as applicable. ii) All these liquidated damages for short fall in performance shall be deducted from the contract price as detailed in accompanying General Conditions of Contract (GCC)/ Special Conditions of Contract (SCC) iii) Contractor's aggregate liability to pay Liquidated Damages (LD) for failure to attain the functional guarantee shall not exceed twenty five percent (25%) of the Contract Price. iv) The LD values are applicable on per unit basis for unit capacity of 500 MW. For 200 MW / 210 MW units common absorber has been specified for two / three units based on scope of supply and LD values are applicable for combination of units as indicated in the clause 3.00.00 GUARANTEES PARAMETERS Guarantees Under Category-I The Performance Guarantees which attract Liquidated Damages (LD) are as follows: The following shall be guaranteed by the Bidder under guarantee point condition of Sub- Section-V, Part-A of section- VI: (i) SO₂ removal Efficiency The Contractor shall guarantee that SO₂ removal efficiency shall not be less than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (To be conducted as per the stipulation of Cl. no. 6.00.00 of this sub-section.) (ii) Limestone Consumption The Contractor shall guarantee that limestone consumption of FGD system in kg/hr shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (iii) Auxiliary Power Consumption The Contractor shall guarantee that total auxiliary power consumption for the unit in normal operation shall not be more than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 21 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
4.02.00	Sub-section-V, Part-A of Section-VI applicable for complete scope of work for the respective project), inline with the requirements stipulated in clause 5.00.00 of this Sub-Section.			
	Guarantees Under Category-II			
	The parameters/capabilities shall be demonstrated for various systems/ equipments shall include but not limited to the following:-			
	(i) Wet ball Mill capacity at rated fineness			
	The contractor shall demonstrate the guaranteed capacity of each limestone pulverizer under the following conditions:			
	i)	Limestone Output fineness :	90% or higher (as per the requirement of the absorber) through 325 mesh (for spray tower process) (OR) 90% or higher (as per the requirement of the absorber) through 200 mesh (for bubbling process)	
	ii)	Limestone Quality :	All available quality from the specified range.	
	(ii) Wet ball Mill wear parts guarantee			
	Contractor shall demonstrate the life of wet ball Mill wear parts in line with requirements stipulated in Part B of the Technical Specification. The establishment of the above guarantee shall be based on the operating records available at the Power station and will be computed for each pulverizer based on actual total hours of operation.			
	(iii) Wet ball Mill ball consumption			
	Contractor shall guarantee ball consumption per ton of limestone throughput in line with requirements stipulated in Part B of the Technical Specification. Contractor shall furnish the minimum ball diameter below which the balls shall be replaced.			
	(iv) Vacuum Belt Filter Capacity			
	Contractor shall demonstrate the Designed Capacity of the Vaccum Belt Filters to dewater the quantity of gypsum with the specified purity and moisture content as specified in Part B of the Technical Specification.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 22 OF 30

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	(v) Gypsum Purity The contractor shall demonstrate that the purity of the gypsum produced shall not be less than 90%, chloride content shall not be more than 100ppm and the moisture content shall not be more than 10% for guarantee point condition. (vi) NOT USED (vii) Performance characteristics of fans (capacity, head developed, etc.). (viii) Margins on fans in case Booster Fan is provided by the Contractor. Booster Fans - As specified in Part B of Technical Specifications (ix) Passenger cum Goods Elevator for FGD absorber & Limestone Grinding Building: Over load tests, travel and hoist speed checks. (x) Noise All the plant, equipment and systems covered under this specification shall perform continuously without exceeding the noise level over the entire range of output and operating frequency specified in Part-C of Section-VI of the technical specifications. Noise level measurement shall be carried out using applicable and internationally acceptable standards. The measurement shall be carried out with a calibrated integrating sound level meter meeting the requirement of IEC 651 or BS 5969 or is 9779. Sound pressure shall be measured all around the equipment at a distance of 1.0 m horizontally from the nearest surface of any equipment/ machine and at a height of 1.5 m above the floor level in elevation. A minimum of 6 points around each equipment shall be covered for measurement. additional measurement points shall be considered based on the applicable standards and the size of the equipment. the measurement shall be done with slow response on the a - weighting scale. the average of a-weighted sound pressure level measurements expressed in decibels to a reference of 0.0002 micro bar shall not exceed the guaranteed value. corrections for background noise shall be considered in line with the applicable standards. all the necessary data for determining these corrections, in line with the applicable standards, shall be collected during the tests.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 23 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	(xi) Mist Outlet Droplet Content The mist eliminator outlet droplet content shall be guaranteed to be ≤ 20 mg/Nm³ at absorber outlet measured over a period of 24 hrs continuous operation. Mist outlet-droplet content shall be measured as per applicable clauses in VDI Norm 3679 and the Contractor shall carry out the tests as per the test procedure approved by the Employer. (xii) Availability of FGD Plant The Contractor shall guarantee the maximum availability of FGD Plant for the range of coal and limestone specified inline with the requirements stipulated in clause 7.00.00 of this Sub-Section (xiii) Air Conditioning System A. Following shall be demonstrated at Shop 1) Capacity and static pressure of AHU fans at its rated duty point. B. Following shall be demonstrated at Site 1) Capacity (TR) of air cooled condensing units (D-X type) for A/C system of FGD control room building. 2) Guaranteed room conditions during summer for all the Air conditioned areas. 3) Vibration and noise level of condensing units & centrifugal fans of AHUs. (xiv) Ventilation System A. Following shall be demonstrated at Shop 1) Capacity and discharge pressure of pumps of UAF units at its rated duty point of Ventilation system. 2) Capacity and static pressure of UAF fans at its rated duty point of Ventilation system. B. Following shall be demonstrated at Site 1) Vibration & Noise level of centrifugal fans & pumps of UAF units. (xv) Compressed Air System a) Following shall be demonstrated at shop: i) Capacity and discharge pressure of each air compressor. b) Following shall be demonstrated at site: ii) Dew point of air at the outlet of air drying plants of air compressor.			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 24 OF 30

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC	
	iv) Pressure drop across air drying plant . v) Vibration and noise level of air compressors, blowers of air drying plant (if applicable) (xvi) Equipment Cooling Water System i) Vibration, noise and parallel operation without hunting & abnormal noise and with flow sharing within 10% of each other at the rated duty point shall be demonstrated at site. ii) Design heat load of plate type heat exchangers and Inlet & Outlet temperatures of the Plate type heat exchangers on the primary and secondary side to be demonstrated at site. Pressure drop across the Plate type heat exchanger on the primary & secondary water circuit to be demonstrated at site. (xvii) Limestone Handling System and Gypsum Handling System a) Limestone Handling Plant (i) The Bidder shall demonstrate the unloading at truck tippler, crushing and conveying to storage shed/silo and then reclaim from storage shed/silos and conveying to mill bunker at the guaranteed capacity including all intermediate equipment & conveyors. (ii) Bidder shall also demonstrate the guaranteed tipping rate of truck tipplers. b) Gypsum Handling Plant The Bidder shall demonstrate the guaranteed conveying from belt filter to storage shed/silo including all intermediate equipment & conveyors.		
5.00.00	AUXILIARY POWER CONSUMPTION (PA) FOR EACH PROJECT The unit auxiliary power consumption shall be calculated using the following relationship. $P_a = (P_{a1} + P_{a2} + \dots + P_{an})/n$ $P_{an} = P_{un} + T_{Ln}$ P_a = Guaranteed Auxiliary Power Consumption P_{an} = Auxiliary Power Consumption for unit # n (Where "n" is the unit number e.g. 1, 2,)		
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 25 OF 30

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	P_{un} = Power consumed by the auxiliaries of the unit under test T_{Ln} = Losses of the transformers supplied by bidder based on works test reports While guaranteeing the auxiliary power consumption of each project the bidder shall necessarily include all continuously operating auxiliaries under this package. The auxiliaries to be considered shall include but not be limited to the following: a. Bucket Elevator b. Fan/Blower for Bag Filter c. Rotary Feeder d. Screw Feeder e. Agitator f. Dosing pumps g. Any other additional drive* * Bidder to consider any other equipment/drive not listed above but required for continuous operation of the system for calculation of auxiliary power . vi. Limestone Slurry Pump(s) vii. Vacuum Belt Filter, Vacuum Pump and its integral auxiliaries divided by the number of units in the project viii. Power consumption of all working Booster water pumps (if provided) to ACW pumps after PHE divided by the number of units in the project ix. Power consumption of Clarified water pumps (if provided) and Clarified booster water pumps (if provided) divided by the number of units in the project x. Power consumption of Process water pump(s) divided by the number of units in the project xi. Mist Eliminator Wash Water pump(s) xii. Power consumption of Belt Filter Wash Water Pump divided by the number of units in the project xiii. Power consumption of total number of DM Cooling (working) Water pump to supply cooling water on the primary (DM) side of the plate type heat exchangers in the closed loop Equipment cooling water system divided by the number of units (working) in the project xiv. Power consumption of total number of Auxiliary Cooling (working) water pump/Permeate water pump to supply cooling water on the secondary side			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 26 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	of the plate type heat exchangers in the closed loop Equipment cooling (unit auxiliary) water system divided by the number of units (working) in the project xv. Booster Fans xvi. Power consumption of Limestone Slurry Tank Agitator(s) divided by the number of units in the project xvii. Power consumption of Filtrate Pump(s) divided by the number of units in the project xviii. Power consumption of Cloth Wash Water Pump divided by the number of units in the project xix. Power consumption of Hydro-cyclone and Waste Water Pump divided by the number of units in the project xx. Power consumption of all other continuous running Agitators divided by the number of units in the project xxi. Air Conditioning System (*) Total Power consumption at motor input terminals of working units (i.e. excluding stand-by) at its rated duty point of compressor and condenser fans of air cooled condensing unit, Air handling unit (AHU) fans for the Air conditioning system of FGD Control Room Building divided by total nos. of units in respective project xxii Total power consumption at motor input terminal at rated duty of fan of UAF divided by total nos. of units in respective project. (*) ((*) Above guaranteed power consumption values shall be at 20 deg C for centrifugal fans of AHUs and at 30 deg C for centrifugal fans of UAF units and at an elevation of RL (referring to GLP of respective projects) for both AHUs and UAF centrifugal fans.) xxiii Total power consumption at motor input terminal at rated duty of Air compressor, Air drying plant (Heater and blower, as applicable) divided by total nos. of units in respective project. xxiv) Power consumption of clarified Water Pumps at rated capacity and head divided by the no of units of the project for Singrauli STPP-I & II (5X200MW) & (2X500MW). xxv) Power consumption of clarified Water Pumps at rated capacity and head divided by the no of units of the project for Farakka STPP-I (3X200MW). xxvi) Power consumption of clarified Water Pumps at rated capacity and head divided by the no of units of the project for Farakka STPP-II (2X500MW). xxvi) Power consumption of clarified Water Pumps at rated capacity and head divided by the no of units of the project for Rihand STPP-I (2X500MW).			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 27 OF 30	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC	
	xxvii) Air Conditioning System (*) Total Power consumption at motor input terminals of working units (i.e. excluding stand-by) at its rated duty point of compressor and condenser fans of air cooled condensing unit, Air handling unit (AHU) fans for the Air conditioning system of FGD Control Room Building divided by total nos. of units in respective project. xxviii) Total power consumption at motor input terminal at rated duty of fan of UAF divided by total nos. of units in respective project. (*) ((*) Above guaranteed power consumption values shall be at 20 deg C for centrifugal fans of AHUs and at 30 deg C for centrifugal fans of UAF units and at an elevation of RL (referring to GLP of respective projects) for both AHUs and UAF centrifugal fans.) xxix) Total power consumption at motor input terminal at rated duty of Air compressor, Air drying plant (Heater and blower, as applicable) divided by total nos. of units in respective project NOTE: 1. The equipment's listed above for calculating auxiliary power consumption are indicative. Any other equipment required for continuous operation of the system shall also be considered for calculation of auxiliary power consumption. Power consumption of all equipments provided on unitized basis shall be included in the unit auxiliary power consumption. For common station auxiliaries, the power consumption shall be assigned to each unit based on unit load for the purpose of calculating the unit auxiliary power consumption. 2. The bidder shall furnish a list of equipments to be covered under auxiliary power consumption, which shall be subject to Employer's approval. 3. Transformer losses (TL) shall be considered as per following (as applicable)- Aux/LT Outdoor/ LT Indoor Transformer: 100 % No load loss and 25 % of Copper Losses. 4. Auxiliary power shall be measured without SCR (De-NOx) system. 5. Auxiliary power shall be measured at the switchgear of the drives. 6.00.00 METHOD OF COMPUTING TEST EFFICIENCY OF FGD The performance tests shall be carried out in accordance with ASME PTC 40 (1991) code. No tolerance or allowance on the test result will be permitted for instrument errors or inaccuracy, the method of testing or any other causes. The details of the		

LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 28 OF 30
---	--	--	---------------

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C 2-C	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

CUSTOMER SPECIFICATION: PAINTING

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		
1.00.00	SPECIFICATION OF SURFACE PREPARATION & PAINTING		
1.01.00	Surface preparation methods and paint/primer materials shall be of the type specified herein. If the contractor desires to use any paint/primer materials other than that specified, specific approval shall be obtained by the contractor in writing from the employer for using the substitute material.		
1.02.00	All paints shall be delivered to job site in manufacturers sealed containers. Each container shall be labelled by the manufacturer with the manufacturer's name, type of paint, batch number and colour.		
1.03.00	Unless specified otherwise, paint shall not be applied to surfaces of insulation, surfaces of stainless steel/nickel/ copper/brass/ monel/ aluminum/ hastelloy/lead/ galvanized steel items, valve stem, pump rods, shafts, gauges, bearing and contact surfaces, lined or clad surfaces.		
1.04.00	All pipelines shall be Colour coded for identification as per the NTPC Colour-coding scheme, which will be furnished to the contractor during detailed engineering.		
1.05.00	SURFACE PREPARATION		
1.05.01	All surfaces to be painted shall be thoroughly cleaned of oil. Grease and other foreign material. Surfaces shall be free of moisture and contamination from chemicals and solvents.		
1.05.02	The following surface preparation schemes are envisaged here. Depending upon requirement any one or a combination of these schemes may be used for surface preparation before application of primer. SP1 Solvent cleaning SP2 Application of rust converter (Ruskil or equivalent grade) SP3 Power tool cleaning SP4 Shot blasting (shot blasting shall be used as surface preparation method for hot worked pipes prior to application of primer) SP4* Shot blast cleaning/ abrasive blast cleaning to SA21/2 (near white metal) 35-50 microns SP5 Shot blasting/ abrasive blasting. SP6 Emery sheet cleaning/Manual wire brush cleaning.		
1.06.00	APPLICATION OF PRIMER/PAINT		
1.06.01	The paint/primer manufacturer's instructions covering thinning, mixing, method of application, handling and drying time shall be strictly followed and considered as part of this specification. The Dry film thickness (DFT) of primer/paint shall be as specified herein.		
1.06.02	Surfaces prepared as per the surface preparation scheme indicated herein shall be applied with primer paint within 6 hours after preparation of surfaces.		
1.06.03	Where primer coat has been applied in the shop, the primer coat shall be carefully examined, cleaned and spot primed with one coat of the primer before applying intermediate and finish coats. When the primer coat has not been applied in the shop, primer coat shall be applied by brushing, rolling or spraying on the same day		

188 of 354

CLAUSE NO.	एनटीपीसी NTPC TECHNICAL REQUIREMENTS
1.06.04 1.06.05 1.06.06 1.06.07 1.06.08 1.06.09	as the surface is prepared. Primer coat shall be applied prior to intermediate and finish coats. Steel surfaces that will be concealed by building walls shall be primed and finish painted before the floor is erected. Tops of structural steel members that will be covered by grating shall be primed and finish painted before the grating is permanently secured. Following are the Primer/painting schemes envisaged herein: PS3 - Zinc Chrome Primer (Alkyd base) by brush/Spray to IS104. PS3* - Zinc Chrome primer (Alkyd base) by dip coat. PS4 - Synthetic Enamel (long oil alkyd) to IS2932. PS5 - Red Oxide Zinc Phosphate primer (Alkyd base) to IS 12744 PS9 - Aluminium paint to IS 2339. PS9* - Heat resistant Aluminium paint to IS-13183 Gr.-1 PS13 - Rust preventive fluid by spray, dip or brush. PS14 - weldable primer-Deoxaluminate or equivalent. PS16 - High Build Epoxy CDC mastic `15` . PS17 - Aliphatic Acrylic Polyurethane CDE134 ,%V=40.0(min.) PS18 - Epoxy based TiO2 pigmented coat PS19 - Epoxy Zinc rich primer (92% zinc in dry film (min.), %VS=40.0(min.) PS-20 - Epoxy based finish paint All weld edge preparation for site welding shall be applied with one coat of weldable primer. For internal protection of pipes/tubes, VCI pellets shall be used at both ends after sponge testing and ends capped. VCI pellets shall not be used for SS components and composite assemblies. SG membrane walls and other Flue gas swept pressure part surfaces shall be applied with appropriate primer for protection of surfaces during transit, storage and erection. a) All un-insulated equipments, pipes, valves etc covered in sub-section A-08 (Steam Turbine & Auxiliary system) shall be painted with paint not inferior to Epoxy resin based paints with minimum DFT of 150 micron. The paint shall be applied in three stages i.e. primer, intermediate and finish coats in following manner: ▪ Primer coat – Epoxy based zinc phosphate ▪ Intermediate - Epoxy based TiO2 pigmented coat ▪ Finish coat - Epoxy based finish coat b) Equipment, pipes etc. with high temperature shall be painted with heat resistant aluminum paint (to be selected based on the service condition of component as per IS-13183). Two coats of paint shall be applied with total DFT 40 micron. c) Surface preparation before painting shall be carried out according to requirement indicated in this sub-section and international standard


CLAUSE NO.	TECHNICAL REQUIREMENTS 
1.06.10	A) Specification for the application of Epoxy coating for internal protection of DM tank & other vessels/tanks (as applicable) shall be as follows: Primer : One coat of unmodified epoxy resin along with polyimide hardener. Paint : Two (2) coats unmodified epoxy resin along with Aromatic adduct hardener. Total thickness of primer and paint should not be less than 400 microns. B) Specification for application of chlorinated Rubber paint for external protection vessel, tanks, piping, valves & other equipments shall be as follows: i) For Indoor vessel, tanks, piping, valves & other equipments: (a) Surface preparation shall be done either manually or by any other approved method. (b) Primer coat shall consist of one coat of chlorinated rubber based zinc phosphate primer having minimum DFT of 50 microns. (c) Intermediate coat (or under coat) shall consist of one coat of chlorinated rubber based paint pigmented with Titanium dioxide with minimum DFT of 50 microns. (d) Top coat shall consist of one coat of chlorinated rubber paint of approved shade and colour with glossy finish and DFT of 50 microns. Total DFT of paint system shall not be less than 150 microns. ii) For Outdoor vessel, tanks, piping, valves & other equipments: (a) Surface preparation shall be blast cleared using non-siliceous abrasive after usual wire brushing, which shall conform to Sa 2-1/2 Swiss Standard. (b) Primer coat shall consist of one coat of epoxy resin based zinc phosphate primer having minimum DFT of 100 microns. (c) Intermediate coat (or under coat) shall consist of epoxy resin based paint pigmented with Titanium dioxide with minimum DFT of 100 microns. (d) Top coat shall consist of one coat of epoxy paint suitable pigmented of approved shade and colour with glossy finish and DFT of 75 microns. Additionally finishing coat of polyurethane of minimum DFT of 25 microns shall be provided. The paint may be applied in one coat, in case high built paint is used, otherwise two coats shall be applied. Total DFT shall not be less than 300 microns.




- ii) Painting specification for inside surfaces (such as inner surfaces of ducts/ tanks/ mills/ dampers/ ESP etc.) that are not covered specifically in above clauses, shall be provided with 2 coats of suitable primer i.e. PS5/ PS9 (Total DFT 60/40 micron) based on the temperature.

F) FGD System

- (i) Surface preparation shall be blast cleaned conforming to Sa 2-1/2 Swiss Standard.
- (ii) Primer coat shall consist of epoxy resin based zinc phosphate primer having minimum DFT of 100 microns.
- (iii) Intermediate coat (or under coat) shall consist of epoxy resin based paint pigmented with Titanium dioxide with minimum DFT of 100 microns.
- (iv) Top coat shall consist of one coat of epoxy paint suitable pigmented of approved shade and colour with glossy finish and DFT of 75 microns. Additionally finishing coat of polyurethane of minimum DFT of 25 microns shall be provided.


		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020			
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

Ramagundam STPS Stage – I & II (3x200 MW + 3x500 MW) FGD PACKAGE
PAINTING SCHEME for FGD SYSTEM, BOOSTER FANS, GATES & DAMPERS

Prepared By	Reviewed & Approved By
	
K.S. Gopakumar, Dy Engineer / QA	Venkanna Rupani, Dy Manager / QA

Record of Revision

Rev No	Date	Details Of Revision
00	21/05/2020	First Submission

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020			
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	


1. FANS

[illegible]

Page: 3 of 28
194 of 354

Page: 4 of 28
195 of 354

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		

2. FGD SYSTEM

1	Slurry recirculation pump System (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 212	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50μ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50μ/ coat Shade: Light blue RAL 5012	100	210
2	Absorber System Internals – Structural items (Clause 1.04.00 of Part- A Section VI)	FW 213	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50μ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2, DFT- 100μ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75μ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213, DFT-25μ Shade: Grey White, RAL9002	75 25	300
3	Mist eliminator and accessories, Absorber baffle grating support, Mist eliminator support& Absorber Spray pipe support - Structural items (Clause 1.04.00 of Part- A Section VI)	FW 215 FW 216 FW 217 FW 218	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50μ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100μ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75μ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25μ Shade: Grey White, RAL9002	75 25	300

12866/2020/PS-PEM-MAX


		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
4	Absorber System- Base (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 219	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 			

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	
6	Absorber system casing bottom- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D) Inside surfaces are of C276 clad sheets, hence no paint is envisaged.	FW 221	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
7	Absorber system casing top- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D) Inside surfaces are of C276 clad sheets, hence no paint is envisaged.	FW 222	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240

8	Absorber system accessories (Clause 20.03.00 of Part- C Section VI)	FW 223	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
9	Emergency Quench water tank- Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 226	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
10	Emergency Quench water tank- Inside surfaces	FW 226	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm	Primer: Two coats of Red Oxide Zinc phosphate primer, DFT-30µ/coat; Total-60µ (Primer is only envisaged as lining is given in inside surfaces of the tank)				
11	Emergency quench system, Handling Equipment RC pump (Clause 20.03.00 of Part- C Section VI)	FW 227 FW 249	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	60	120
12	Air oxidation system, Viewing ports (Without glass)	FW 230 FW 239	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020			
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)
				Paint	DFT (μm min)	Paint	DFT(μm min)	

	(Clause 20.03.00 of Part- C Section VI)								
13	Absorber W/D interface, W/D wash system, Slurry distribution system, Oxidation Air distribution system (Clause 1.04.00 of Part- A Section VI)		FW 228 FW 229 FW 243 FW 244	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
14	Expansion joint between bypass (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 251	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (two coats)	60	--	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
15	Expansion joint (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 252	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
16	Ducts between bypass duct inlet& booster fan	Flue gas swept surface	FW 255	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	--	60

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)	
				Paint	DFT (µm min)	Paint	DFT(µm min)		

	(Clause 20.03.00 of Part- C Section VI)	Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
17	Ducts between Booster fan& Absorber (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 256	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
18	Ducts between Absorber& Stack (Clause 20.03.00 of Part- C Section VI)	Flue gas swept surface	FW 257	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	NIL	--	60
		Insulated surfaces		Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	NIL	--	40
19	Duct structure between bypass duct& Booster fan (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)		FW 260	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002	70	240

Page: 11 of 28
202 of 354

Page: 12 of 28
203 of 354


Page: 13 of 28
204 of 354

27	Galleries and railings for Stairs, Absorber, Dampers, Ducts, Tanks – Structures other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 237 FW 610 FW 612 FW 613 FW 722	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
28	Slurry pumps & accessories, Water pumps (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 701 FW 702	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) DFT- 30µ; Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Light blue RAL 5012	100	210
29	Monorail for hoist & cranes (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 710	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002	70	240

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)	
				Paint	DFT (µm min)	Paint	DFT(µm min)		

				Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
30	Handling Equipment- Hoists& Man hole door (Clause 20.03.00 of Part- C Section VI)	FW 713 FW 714 FW 717	Power Tool Cleaning to st3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Idler roller shall be applied with two coats of 70 microns at shop	70	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	60	130
31	Agitator support Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 721	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
32	Limestone silo structures Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 730	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2)	70	240

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020			
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)
				Paint	DFT (µm min)	Paint	DFT(µm min)	

[illegible]

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020					
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)								
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)		
				Paint	DFT (µm min)	Paint	DFT(µm min)			
35	Lime stone Silo- Inside surfaces (Cylindrical portion)	FW 731	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 µm per coat (min.) Zinc dust composition shall be Type-II as per ASTM D520-00		70	--	--	70	
36	Air cannon silo, Bag filter & Fan assy, Nozzles& Flanges (Clause 20.03.00 of Part- C Section VI)	FW 723 FW 724 FW 725	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)		60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)		40	100
37	Limestone silo approach platform, Platform for Pipe racks& Sub pipe racks (Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767	Blast cleaning to Sa 2½/ Acid pickling	Hand rails, Ladders, Gratings- Hot dip galvanizing to 610gms/sq. m (minimum) and to a coating thickness of 87µm (minimum)						
38	Limestone silo approach platform, Pipe racks, Sub pipe racks platform- Structures other than the above (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 733 FW 766 FW 767	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2)		70 				

12866/2020/PS-PEM-MAX


		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		

				DFT- 100μ		30 and colour change less than 2.0Δ E)		
39	Limestone Mill – Outside surfaces (Clause 1.04.00 of Part- A Section VI)	FW 735	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50μ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100μ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75μ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25μ Shade: Grey White, RAL9002	75 25	300
40	Lime stone mill- Inside surfaces	FW 735	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60μm conforming to ISO 8501-1	Primer Coat: One coat of two component moisture curing Inorganic Ethyl Zinc Silicate Primer to IS 14946, (Solid by volume- 60% (min)), (Metallic zinc content 80% (min)) DFT = 70 μm per coat (min.) Zinc dust composition shall be Type-II as per ASTM D520-00	70	--	--	70
41	Gypsum belt filter and accessories Structural items (Clause 1.04.00 of Part- A Section VI)	FW 738	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50μ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100μ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75μ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25μ Shade: Grey White, RAL9002	75 25	300

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		
42	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydro cyclone waste water tank, Neutralization tank, Process Water tank, Belt filter washing tank, Primary hydro cyclone feed tank, Clarified water tank Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 785 FW 786 FW 800 FW 802	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60μm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70μ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100μ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35μ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240	
43	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydrocyclone waste water tank, Neutralization tank, Process Water tank, Belt filter washing tank, Primary Hydrocyclone feed tank, Clarified water tank, Tank internal structure Inside surfaces	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 749 FW 800 FW 802	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50μm	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) (Liner is inside the tank, hence primer is only envisaged; Protection till erection only)	60	NIL	--	60	

12866/2020/PS-PEM-MAX


		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		

44	Process water pipe accessories, Cooling pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 751 FW 752	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Finish: Two coats of Synthetic Enamel to IS 2932, DFT- 50μ/ coat	100	210
				Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50μ	50	Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5		
45	Slurry pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 753	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Finish: Two coats of Synthetic Enamel to IS 2932, DFT- 50μ/ coat	100	210
				Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50μ	50	Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5		
46	Service Air pipe accessories (Referred from cl. 10.00 .00 of Section-VI, Part-B, Sub section-I-M3)	FW 754	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30μ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
47	Instrument air pipe accessories (Referred from cl. 10.00 .00 of Section-VI, Part-B, Sub section-I-M3)	FW 755	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30μ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme		BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)
				Paint	DFT (μm min)	Paint	DFT(μm min)	
48	All valves (Temp <95 deg C) (Clause 20.03.00 of Part- C Section VI)	FW 815 to FW 851	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30μ/ coat	60	120
49	Structure for Pipe racks, Sub pipe racks Trestle for pipe racks, Structures inside Gypsum dewatering building & Ball mill building (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 761 FW 765 FW 768 FW 769 FW 787	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60μm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70μ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100μ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35μ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
50	Supports for cable trays, Air receivers, commissioning& Mandatory spares, Tools & tackles (Clause 20.03.00 of Part- C Section VI)	FW 779 FW 798 FW 988 FW 996	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)	
				Paint	DFT (µm min)	Paint	DFT(µm min)		

3. GATES & DAMPERS

01	Gates & Dampers > 95° C Insulated Surfaces& Uninsulated surfaces	57 540 57 550 57 583	Power Tool Cleaning to St3 (SSPC-SP3)	HR Aluminium paint to IS 13183 Gr.II (upto 400 deg C)	40	--	--	40
02	Seal air piping	57 141	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
03	Blower with Motor Knife Gate valve Mounting bracket Mandatory spares	57 491 57 497 57 209	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100
04	Ladder, Cage for Ladder Toe Guard Plate Floor Grill, Hand Rails, Hand Rail Post Clause 31.06.00 of Sec.VI, Part-B, Subsection- IV-D	57 466 57 566	Blast cleaning to Sa 2½/ Acid Pickling	Hot Dip Galvanizing to 610 gm per sq. Meter (minimum) and to a coating thickness of 87 µm (minimum)				
05	Other Structural Items- Other than sl.no. 3 of above	57 466 57 566	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2)	70	240

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		


	(Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)		60μm conforming to ISO 8501-1	60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70μ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100μ	100	DFT- 35μ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
--	---	--	-------------------------------	--	-----	--	--	--

4. PAINTING OF DAMAGED AREAS

For areas where paint has deteriorated badly by erosion and areas where the paint film has lost its adhesion property and where the steel has got rusted appreciably: These areas are to be repainted as per the following procedure:

SL NO	SURFACE LOCATION	SURFACE PREPARATION	PRIMER, INTERMEDIATE & FINISH
1	Paint damaged Components falling under SI.no. 04,05,06,09,10,11 of Fans, SI no.02,03,04, 05,06,07, 09, 13,19,20,21,23,25,27, 29, 31,32 33,38,39,41,42, 49 of FGD and SI no. 5 of GAD.	Hand/ Power Tool cleaning to Bare metal to minimum 6 inches peripheral area adjoining to damaged area	Primer: Epoxy Zinc rich primer to IS 14589, DFT-70μ (If Metal surface exposed) followed by intermediate & finish coat as per respective schemes. If primer is intact- Intermediate & finish as per respective schemes.
2	Paint damaged components failing under other SI Nos of Fans, FGD& GAD	Power Tool Cleaning to Bare metal	Primer and Finish: As given in respective scheme


12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		

GENERAL NOTES

1. No painting is required for Galvanized, non-ferrous & stainless steel items, except as indicated above.
2. Machined items are to be applied with coat of temporary rust preventive oil
3. PGMA's covered in sub-supplier (ie., Purchased) items viz., Agitator / slide bearing and other sub-delivery components etc., are not indicated in the above list. However, the Painting Schedule for all items supplied by all sub-suppliers and BOI under the scope of BHEL shall be same as for main equipment covered in this document.
4. In sub-assy, wherever plates / sheets of thickness less than or equal to 5mm and rods are used, very minor items like clamps, small items etc.- Power Tool or Hand Tool Cleaning to SSPC - SP 3 / SP 2 shall be followed and painting under SI no:01 of Fans shall be followed.
5. Ground shade/colour of finish paints and identification tag/band for equipment, fans, piping, pipe services, supporting structures and other components is followed as per NTPC doc no: QS-01-DIV-W-4 at site.
6. All components covered under different PGMA's are to be painted. In case any component is left out, the same shall deemed to be included under the relevant section.
7. All threaded and other surfaces of foundation bolts and its materials, insulation pins, Anchor channels, Sleeves shall be coated with temporary rust preventive fluid and during execution of civil works; the dried film of coating shall be removed using organic solvents.
8. Painting requirement for all electrical equipment shall be as per the details identified in specification for the respective equipment.
9. All steel structures shall be provided with painting as given in the specification. Further, painting system shall also meet the requirements of corrosivity category C3 (durability high) as per ISO 12944.
10. Finish coat to be applied after an interval of min 10 hrs and within 6 months (after completion of intermediate coat).
11. Primer coat on steel shall be applied in shop immediately after blast cleaning by airless spray technique.
12. For the portion of steel surfaces embedded in concrete, the surface shall be prepared by Manual cleaning and provided with Primer coat of Chlorinated Rubber based Zinc Phosphate Primer of Minimum 50 Micron DFT.


12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020			
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)						
Sl No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)
				Paint	DFT (μm min)	Paint	DFT(μm min)	

PAINTING SCHEME- DETAILS OF PROCUREMENT & APPLICATION PROCESSES

SL NO	TYPE OF PAINT	SPECIFICATION OF PAINT	NO OF PACK	VOLUME OF SOLIDS (% Min)	MODE OF APPLICATION	MIN. OVER COATING INTERVAL (hours)	SHADE
01	Epoxy Zinc phosphate primer	IS 13238	2	40	Spray	24	Grey
02	Zinc Ethyl silicate primer (% Zn on dry film= 80 (min))	IS 14946	2	60	Airless Spray only At Shop	24	Grey
03	Epoxy High solid-Polyamide cured Epoxy based MIO pigmented intermediate coat	--	2	80	Airless Spray only At Shop	16	Brown
04	Aliphatic isocyanate acrylic polyurethane paint	IS 13213	2	55	Spray At Shop	16	Corresponding shade no
05	Heat resistant aluminum paint	IS 13183 Grade II	1	--	Brush/ Spray	24	--
06	Long oil alkyd Synthetic enamel finish paint	IS 2932	1	35	Brush/ Spray	12	Corresponding shade no
07	Synthetic Enamel Intermediate coat	IS 2932	1	40	Brush/ Spray	12	--
08	Red oxide Zinc phosphate primer	IS 12744	1	--	Brush/ spray	12	--


12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)	
				Paint	DFT (µm min)	Paint	DFT(µm min)		

PGMA Description & Product Details


SI No	PGMA	PGMA Description	Product /Items Details
01	FW 212	Slurry recirculation pump system	RC Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Gear Box, Expansion Bellow, Anchor Bolts & Fasteners, Special Tools
02	FW 219	Absorber system base	Absorber tank bottom plate
03	FW 220	Absorber system structures	Absorber tank structure, Absorber tower structure, Spray headers structure
04	FW 221	Absorber system casing bottom	Absorber tank wall casing- bottom
05	FW 222	Absorber system casing top	Absorber Tank wall casing –Top, Mist Eliminator supports, Spray pipe supports, Internal Beam, Shim plates in Absorber area, Internal Struts
06	FW 223	Absorber system accessories	Nozzles and flanges, Inspection doors & Man holes, Viewing ports, Antifoam dosing equipment, Suction strainers- FRP
07	FW 226	Emergency Quench water tank	Base Plate & its supports, Roof, Shell
08	FW 227	Emergency Quench System	Emergency Quenching Spray Pipe, Nozzle for Emergency Pipe, Fasteners, Gaskets
09	FW 230	Air oxidation System	Oxidation Blowers, Common Base Plate, Coupling and Guard, Anchor Bolts & Fasteners, Expansion Bellow, Special Tools, Suction & Discharge Silencers, Acoustic Enclosure, Water Injection cooling system, Pipe, Valves & Instruments
10	FW 244	Oxidation air distribution System	Pipe & Fittings, Flanges, Pipe Hanger, Bottom Elbow, Bottom sliding supports
11	FW 251	Expansion joint between bypass	Expansion joints, Seal Plates & Fasteners
12	FW 252	Expansion joint between scrubbers	Fabric & its fixing fasteners, Sleeves & Flanges, Gaskets
13	FW 255	Ducts between bypass duct inlet & booster fan	Plates & Stiffeners, Guide Vanes
14	FW 256	Ducts between Booster fan & Absorber	Plates & Stiffeners, Guide Vanes
15	FW 257	Ducts between Absorber & stack	Plates & Stiffeners, Guide Vanes
16	FW 260	Duct structure between bypass duct& Booster fan	Duct Supports, Gusset Plate, Divider plate, Internal Struts, Support bearings
17	FW 261 FW 262	Duct structure between booster fan& absorber & Absorber and Stack	Duct Supports, Gusset Plate, Divider plate, Internal Struts, Support bearings
18	FW 292	Structures for Elevator	Columns, Seal Plate, Bracings, Enclosure (Purlin& sheeting)

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (µm min)	
				Paint	DFT (µm min)	Paint	DFT(µm min)		

SI No	PGMA	PGMA Description	Product /Items Details
19	FW 293	Elevator and accessories	Base Frame, Buffer Spring, Mast Section, Cage, Control Panel & AC, Mandatory Spares
20	FW 310	Structures for booster fan handling	Columns, Beams, Bracings, Seal plate
21	FW 610 FW 722	Galleries & railings for Scrubbers, Tank	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
22	FW 701	Slurry pumps & accessories	Slurry Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Belt & Pulley, Expansion Bellow, Anchor Bolts & Fasteners, Motor & accessories, Sump Pumps incl Shaft seal, Common Base Plate, Coupling and Guard, Belt & Pulley, Anchor Bolts & Fasteners, Motor & accessories
23	FW 710	Monorail for hoist& cranes	Insert Plate, Stiffener plate, Monorail beam
24	FW 721	Agitator support	Channels & Beams
25	FW 730	Limestone silo structures	Columns, Beams, Bracings, Seal plate, Angles, channels
26	FW 731	Limestone silo	Base plate & its supports, Shell, Roof
27	FW 723 FW 724 FW 725	Air cannon Bag filter Nozzles & flanges	Bag filter, Air cannon bin activator, Nozzles & Flanges
28	FW 733	Limestone silo approach platforms	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
29	FW 734	Limestone mill	Wet ball mill, Hydro cyclone- Mill area, Mill circuit pump, Mill separator tank with Agitator
30	FW 742	Lime stone slurry storage tank	Base plate & its supports, Shell, Roof
31	FW 743	Auxiliary Absorber tank	Base plate & its supports, Shell, Roof
32	FW 744	Filtrate tank	Base plate & its supports, Shell, Roof
33	FW 745	Wastage water tank	Base plate & its supports, Shell, Roof
34	FW 747	Hydro cyclone waste water tank	Base plate & its supports, Shell, Roof
35	FW 748 FW 785 FW 786	Process Water tank Belt filter washing tank Primary Hydro cyclone feed tank	Base plate & its supports, Shell, Roof
36	FW 751 FW 752	Process water pipe accessories Cooling water pipe accessories	CS/FRP Pipes & Fittings, Sight Glass, R Orifice, Gaskets & Fasteners
37	FW 753	Slurry pipe accessories	CSRL/FRP Pipes & Fittings, Strainer (Cone), Expansion Joint-Rubber, R Orifice, Gaskets & Fasteners

12866/2020/PS-PEM-MAX

		BHEL, Ranipet - 632 406, India. Quality Assurance Department. Painting Scheme			BHEL DOC No: PS:RAMA:FGD:G208 Rev: 00 Dt: 21/05/2020 NTPC Contract No: CS-3120/3130-109(3)-9-FC-NOA-6845 Dt: 22/08/2019 NTPC Doc No: 3130-109-PVM-H-001 Rev: 00 Dt: 21/05/2020				
Project		Ramagundam STPS Stage- I & II FGD Package - BHEL Cust Nos: G208-G210 (3x200 MW) & G509-G511 (3x500 MW)							
SI No	Surface Location	PGMA	Surface Preparation	Primer & Intermediate Coats		Finish Coat		Total DFT (μm min)	
				Paint	DFT (μm min)	Paint	DFT(μm min)		

SI No	PGMA	PGMA Description	Product /Items Details
38	FW 754	Service air pipe accessories	GI Pipes & Fittings, Flexible Hose, Expansion Joint (Metallic), Hose connector, R Orifice, Gaskets & Fasteners
39	FW 755	Instrument air pipe accessories	SS Pipes & Fittings, Strainer(Y Type), Gaskets & Fasteners
40	FW 815 to FW 851	Valves and fittings	Globe valves, Ball Valves, Butterfly Valves, Diaphragm Valves, Gate Valves, Check Valves, Pinch Valves, Knife Gate Valves, Control Valves, Relief Valves
41	FW 761 FW 765	Structures for Pipe racks Structures for Sub pipe racks	Bracings Columns
42	FW 280 FW 281 FW 282 FW 283 FW 740 FW 760 FW 763	Foundation material for duct structure Foundation material for absorber Foundation material for Tanks Foundation material for Pipe racks Foundation material for Elevator Foundation material for RC pump shed	Foundation bolts Template
43	FW 766	Platforms for Pipe rack	Stairs, Handrail, Step treads, Floor grills, Ladders, Foundation bolts, Fasteners
44	FW 768 FW 769	Trestle for Main & sub Pipe racks	Truss, Beams, Supports for all Pipes
45	FW 779	Supports for cable tray	Double Sup Channel & Base plates, Single Sup Channel & Base plates Cantilever Arm, Fasteners & clamps, Brackets
46	FW 996	Tools	Erection , commissioning, special tools
47	FW 798	Air receivers	Instrument Air receivers, Any Instruments/Valves
48	FW 800	Clarified water tank	Base plate & its supports, Shell, Roof
49	FW 802	Neutralization tank & accessories	Base plate & its supports, Shell, Roof
50	FW 988 FW 997 FW 999	Commissioning spares & Mandatory spares	Startup & commissioning spares, Mandatory spares

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C3	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

TECHNICAL SPECIFICATION OF AGITATORS (ELECTRICAL PORTION)

	ELECTRICAL EQUIPMENT SPECIFICATION FOR AGITATOR Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	VOLUME NO. : II-B
		SECTION :
		REV NO. 00 : DATE : 08.05.2020
		SHEET : 1 OF 3
TECHNICAL SPECIFICATION FOR AGITATOR (ELECTRICAL PORTION)		

	ELECTRICAL EQUIPMENT SPECIFICATION FOR AGITATOR Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	SPECIFICATION NO.
		VOLUME NO. : II-B
		SECTION :
		REV NO. 00 : DATE : 08.05.2020
		SHEET : 2 OF 3

1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for **AGITATOR**.
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:

Refer “Electrical Scope between BHEL and Vendor”.

3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID

3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of

2 OF 28

	ELECTRICAL EQUIPMENT SPECIFICATION FOR AGITATOR Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	SPECIFICATION NO.
		VOLUME NO. : II-B
		SECTION :
		REV NO. 00 : DATE : 08.05.2020
		SHEET : 3 OF 3
compliance certificate/No deviation certificate. 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer. 4.0 List of enclosures : a) Electrical scope between BHEL & vendor b) Specification for Motors c) Specification for cable lugs and glands d) Quality plan for motors e) Electrical Load data format f) BHEL cable listing format		

REV: 0 DATE: 08.05.2020

STANDARD ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)
PACKAGE: AGITATOR (Supply Package)

PROJECT: Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	415 V MCC	BHEL	BHEL	240 V AC (supply feeder)/415 V AC (3 PHASE 4 WIRE) supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motors.
3	Power cables, control cables and screened control cables	BHEL	BHEL	Incoming cable from BHEL supplied MCC will be informed by BHEL. Vendor shall provide lugs & glands accordingly.
4	Cable trays, accessories & cable trays supporting system	BHEL	BHEL	
5	Cable glands and lugs for equipments supplied by Vendor	Vendor	BHEL	1. Double compression Ni-Cr plated brass cable glands 2. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
6	Conduit and conduit accessories for cabling between equipments supplied by vendor	BHEL	BHEL	
7	Equipment grounding & lightning protection	BHEL	BHEL	
8	Below grade grounding	BHEL	BHEL	
9	LT Motors with base plate and foundation hardware	Vendor	BHEL	Makes shall be subject to BHEL approval at contract stage.
10	Mandatory spares	Vendor	-	Vendor to quote as per specification.
11	Recommended O & M spares	Vendor	-	As per specification
12	Any other equipment/material/service required for completeness of system but not specified above (to ensure trouble free and efficient operation of the system).	Vendor	BHEL	
13	Electrical equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipments/items supplied shall be reputed make & shall be subject to approval of BHEL after award of contract.
2. All QPs shall be subject to approval of BHEL after award of contract without any commercial implication.

SUB-SECTION-II-E2

MOTORS

Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)

	TECHNICAL REQUIREMENTS
	MOTORS
1.00.00	GENERAL REQUIREMENTS
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.
1.02.00	All equipment's shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.
1.03.00	Contactor shall provide fully compatible electrical system, equipment's, accessories and services.
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for Contactors equipment and systems shall be under the Contactor scope.
1.07.00	Degree of Protection Degree of protection for various enclosures as per IEC60034-05 shall be as follows :- i) Indoor motors - IP 54 ii) Outdoor motors - IP 55 iii) Cable box-indoor area - IP 54 iv) Cable box-Outdoor area - IP 55
2.00.00	CODES AND STANDARDS
	1) Three phase induction motors : IS/IEC:60034
	2) Single phase AC motors : IS/ IEC:60034
	3) Crane duty motors : IS:3177, IS/IEC:60034
	4) DC motors/generators : IS:4722, IS/IEC:60034
	5) Energy Efficient motors : IS 12615, IEC:60034-30
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
3.00.00	TYPE
3.01.00	AC Motors: a) Squirrel cage induction motor suitable for direct-on-line starting. b) Continuous duty LT motors upto 200 KW Output rating (at 50 deg.C ambient temperature), shall be Premium Efficiency class-IE3, conforming to IS 12615, or IEC:60034-30. HT motors shall have minimum design efficiency of 95 %. However, tolerance on this efficiency value shall be applicable as per IEC 60034 c) Crane duty motors shall be slip ring/ squirrel cage Induction motor as per the requirement. d) Motor operating through variable frequency drives shall be suitable for inverter duty with VPI insulation. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable. e) Motors operating through variable frequency drives shall also meet the requirements mentioned in subsection for VFD.
3.02.00	DC Motors Shunt wound.
4.00.00	RATING
	(a) Continuously rated (S1). However, crane motors shall be rated for S4 duty, 40% cyclic duration factor. (b) Whenever the basis for motor or driven equipment ratings are not specified in the corresponding mechanical specification sub-sections, maximum continuous motor ratings shall be at least 10% above the maximum load demand of the driven equipment under entire operating range including voltage and frequency variations.
5.00.00	TEMPERATURE RISE
	Air cooled motors 70 deg. C by resistance method for both thermal class 130(B) & 155(F) insulation.
	Water cooled 80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for both thermal class 130(B) & 155(F) insulation.
6.00.00	OPERATIONAL REQUIREMENTS
6.01.00	Starting Time
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
6.01.01	For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.
6.01.02	For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.
6.01.03	For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.
6.01.04	Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.
6.02.00	Torque Requirements
6.02.01	Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor rated torque.
6.02.02	Pull out torque at rated voltage shall not be less than 205% of rated torque. It shall be 275% for crane duty motors.
6.03.00	Starting voltage requirement
	(a) Up to 85% of rated voltage for ratings below 110 KW
	(b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW
	(c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW
	(d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW
	(e) Up to 75 % of rated voltage for ratings above 4000KW
7.00.00	DESIGN AND CONSTRUCTIONAL FEATURES
7.01.00	Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable.
7.02.00	All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS:2148 as detailed below
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
7.03.00	(a) Fuel oil area : Group – IIB (b) Hydrogen generation : Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA /IEC60034) Winding and Insulation (a) Type : Non-hygroscopic, oil resistant, flame resistant (b) Starting duty : Two hot starts in succession, with motor initially at normal running temperature. (c) 11kV, 6.6 KV & 3.3 kV AC motors : Thermal class 155 (F) insulation. The winding insulation process shall be total Vacuum Pressure Impregnated i.e resin poor method. The lightning Impulse & interturn insulation surge withstand level shall be as per IEC-60034 part-15. (d) 240VAC, 415V AC & 220V DC motors : Thermal Class (B) or better
7.04.00	Motors rated above 1000KW shall have insulated bearings/housing to prevent flow of shaft currents.
7.05.00	Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature.
7.06.00	Noise level for all the motors shall be limited to 85 dB(A) except for BFP motor for which the maximum limit shall be 90dB(A). Vibration shall be limited within the limits prescribed in IS:12075 / IEC 60034-14 . Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.
7.07.00	In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer and minimum 2 numbers duplex platinum resistance type temperature detectors.
7.08.00	Motor body shall have two earthing points on opposite sides.
7.09.00	11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.
7.10.00	3.3/6.6 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Contractor shall provide termination kit for the offered Terminal box. The offered Terminal Box shall be
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
	suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non magnetic material for single core cables) shall be provided.
7.11.00	The spacing between gland plate & centre of bottom terminal stud shall be as per Table-I.
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 6.6 KV, 3.3 kV /415V systems without any injurious effect on its life.
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.
7.15.00	The size and number of cables (for HT motors) to be intimated to the successful Contactor during detailed engineering and the Contactor shall provide terminal box suitable for the same.
8.00.00	The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance): (a) From 50KW & upto 110KW : 11.0 (b) From 110 KW & upto 200 KW : 9.0 (c) Above 200 KW & upto 1000KW : 10.0 (d) From 1001KW & upto 4000KW : 9.0 (e) Above 4000KW : 6 to 6.5
10.00.00	TYPE TEST
10.01.00	HT MOTORS
10.01.01	The Contactor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The Contactor shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the Employer's engineer.
10.01.02	The type tests shall be carried out in presence of the Employer's representative, for which minimum 15 days notice shall be given by the Contactor. The Contactor shall obtain the Employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
10.01.03	parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out. In case the Contactor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contactor.
10.01.04	Further the Contactor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.
10.01.05	LIST OF TYPE TESTS TO BE CONDUCTED The following type tests shall be conducted on each type and rating of HT motor (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test(subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp.,coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose.
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
10.01.06	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of HT motor (a) Degree of protection test for the enclosure followed by IR, HV and no load run test. (b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on inter-turn insulation shall be as per clause no. 4.2 of IEC 60034, part-15
10.02.00	LT Motors
10.02.01	LT Motors supplied shall be of type tested design. During detailed engineering, the Contactor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.
10.02.02	However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.
10.02.03	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of LT motor of above 100 KW only 1. Measurement of resistance of windings of stator and wound rotor. 2. No load test at rated voltage to determine input current power and speed 3. Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) 4. Full load test to determine efficiency power factor and slip 5. Temperature rise test
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS
	6. Momentary excess torque test. 7. High voltage test 8. Test for vibration severity of motor. 9. Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section) 10. Test for degree of protection and 11. Overspeed test. 12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1
10.03.00	All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.
10.04.00	The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)	

	TECHNICAL REQUIREMENTS																												
	TABLE - I DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS <table> <tr> <th>Motor MCR in KW</th><th>Minimum distance between centre of bottom terminal stud and gland plate in mm</th></tr> <tr> <td>UP to 3 KW</td><td>As per manufacturer's practice.</td></tr> <tr> <td>Above 3 KW - upto 7 KW</td><td>85</td></tr> <tr> <td>Above 7 KW - upto 13 KW</td><td>115</td></tr> <tr> <td>Above 13 KW - upto 24 KW</td><td>167</td></tr> <tr> <td>Above 24 KW - upto 37 KW</td><td>196</td></tr> <tr> <td>Above 37 KW - upto 55 KW</td><td>249</td></tr> <tr> <td>Above 55 KW - upto 90 KW</td><td>277</td></tr> <tr> <td>Above 90 KW - upto 125 KW</td><td>331</td></tr> <tr> <td>Above 125 KW-upto 200 KW</td><td>385/203 (For Single core cables only)</td></tr> </table> For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm. PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE: NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows: <table> <tr> <th>Motor MCR in KW</th><th>Clearance</th></tr> <tr> <td>UP to 110 KW</td><td>10mm</td></tr> <tr> <td>Above 110 KW and upto 150 KW</td><td>12.5mm</td></tr> <tr> <td>Above 150 KW</td><td>19mm</td></tr> </table>	Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm	UP to 3 KW	As per manufacturer's practice.	Above 3 KW - upto 7 KW	85	Above 7 KW - upto 13 KW	115	Above 13 KW - upto 24 KW	167	Above 24 KW - upto 37 KW	196	Above 37 KW - upto 55 KW	249	Above 55 KW - upto 90 KW	277	Above 90 KW - upto 125 KW	331	Above 125 KW-upto 200 KW	385/203 (For Single core cables only)	Motor MCR in KW	Clearance	UP to 110 KW	10mm	Above 110 KW and upto 150 KW	12.5mm	Above 150 KW	19mm
Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm																												
UP to 3 KW	As per manufacturer's practice.																												
Above 3 KW - upto 7 KW	85																												
Above 7 KW - upto 13 KW	115																												
Above 13 KW - upto 24 KW	167																												
Above 24 KW - upto 37 KW	196																												
Above 37 KW - upto 55 KW	249																												
Above 55 KW - upto 90 KW	277																												
Above 90 KW - upto 125 KW	331																												
Above 125 KW-upto 200 KW	385/203 (For Single core cables only)																												
Motor MCR in KW	Clearance																												
UP to 110 KW	10mm																												
Above 110 KW and upto 150 KW	12.5mm																												
Above 150 KW	19mm																												
Ramagundam (FGD) STPP, Stage-I & II (3x200MW + 3x500 MW)																													

Cable glands

Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.

Cable lugs/ferrules

Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to DIN standards

	MANUFACTURER/ SUPPLIER NAME & ADDRESS		BIDDER/ ADDRESS		STANDARD QUALITY PLAN			SPEC. NO :		DATE:	
	CUSTOMER :				PE-QP-999-Q-006, REV-02			DATE: 17.04.2020			
	PROJECT:				PO NO:			DATE:			
	ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))				SYSTEM:			SECTION: II		SHEET 1 of 2	

S. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
1	2	3	4	5	6	7	8	9	10	
		1.WORKMANSHIP	MA	VISUAL	100%	MFG. SPEC.	MFG. SPEC.	LOG BOOK	P -	
		2.DIMENSIONS	MA	VISUAL	100%	MFG. DRG./ MFG. SPEC.	MFG. DRG./ MFG. SPEC.	LOG BOOK	P -	
1.0	ASSEMBLY	3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE	MA	VISUAL	100%	MFG.SPEC./	MFG.SPEC.	LOG BOOK	P -	
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	MFG. SPEC/ APPROVED DATASHEET	MFG. SPEC/ APPROVED DATASHEET	LOG BOOK	P V	
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST	MA	VISUAL	100%	IS-325 / IS-12615/ APPROVED DATA SHEET	IS-325 / IS-12615/ APPROVED DATA SHEET	TEST/ INSPN. REPORT	P V	* NOTE -1
		2.OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	APPROVED DRG/ DATA SHEET	APPROVED DRG/ DATA SHEET	TEST/ INSPN. REPORT	P V	* NOTE -1 & NOTE-2

BHEL				BIDDER/ SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		Sign & Date		Sign & Date		Doc No:		Sign & Date	
Prepared by:	HEMA KHUSHWAHA	Checked by:	KUNAL GANDHI	Seal		Reviewed by:		Name		Seal	
Reviewed by:	PRAVEEN DUTTA	Reviewed by:	RITESH KUMAR JAISWAL			Approved by:					

		MANUFACTURER/ SUPPLIER NAME & ADDRESS		BIDDER/ BIDDER/ SUPPLIER NAME & ADDRESS				STANDARD QUALITY PLAN				SPEC. NO. :		DATE:																	
								CUSTOMER :				QP NO.: PE-QP-999-Q-006, REV-02		DATE: 17.04.2020																	
								PROJECT:				PO NO.:		DATE:																	
								ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))				SYSTEM:		SECTION: II																	
		3.NAMEPLATE DETAILS		MA		VISUAL		100%		-		IS-325 / IS-12615 / APPROVED DATA SHEET		SAME AS COL. 7		TEST/ INSPN. REPORT		✓		P		V		-							
4.0		PACKING		MA		SURFACE FINISH & COMPLETENESS		MA		VISUAL		100%		100%		AS PER MFG. STANDARD / (#)		AS PER MFG. STANDARD / (#)		✓		P		W		-		(#)		REFER NOTE-8	
NOTES:																															
1. Routine tests on 100% motors shall be done by the vendor. However, BHEL/ Customer shall witness routine tests on random samples. The sampling plan shall be mutually agreed upon.																															
2. For exhaust/ventilation fan motors of rating up to 1.5 KW, only routine test certificates shall be furnished for scrutiny.																															
3. In case test certificates for these tests on similar type, size and design of motor from independent laboratory are available, the same is valid for 5 years.																															
4. BHEL reserves the right to perform repeat test, if required.																															
5. After packing and prior to issue MDCC, photographs of items to be despatched shall be sent to BHEL for review.																															
6. In case of any changes in QP commented by customer at contract stage, same shall be carried out by bidder without any implication to BHEL/ Customer.																															
7. Project specific QP to be developed based on customer requirement.																															
8. For export job, BHEL technical specification for seaworthy packing to be followed.																															
9. Packing shall be suitable for storage at site in tropical climate conditions.																															
10. Latest revision/ year of issue of all the standards (IS/ ASME/ IEC etc.) indicated in QP shall be referred.																															
LEGENDS:																															
*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION,																															
** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,																															
P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE																															
MA: MAJOR, MI: MINOR, CR: CRITICAL																															
D: DOCUMENTATION																															

237 of 341

BHEL				BIDDER/ SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL					
ENGINEERING		QUALITY		Sign & Date		Doc No:		Sign & Date		Name		Seal	
Prepared by:	HEMA KHUSHWAHA	Checked by:	KUNAL GANDHI	Seal				Reviewed by:					
Reviewed by:	PRAVEEN DUTTA	Reviewed by:	RITESH KUMAR JAISWAL					Approved by:					

17 OF 28

12866/2020/PS-PEM-MAX

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:	
			CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04	
			PROJECT:		PO NO.:	
			ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	
			SECTION: II		SHEET 1 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
1	2	3	4	5	6		7	8	9	* * D M C N			
1.0	RAW MATERIAL & BOUGHT OUT CONTROL				M	C/N							
1.1	SHEET STEEL PLATES, SECTION, EYEBOLTS	1.SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM BLINKS, CRACKS, WAVINESS ETC	LOG BOOK	P	-	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK	P	-	-	-
		3.PROOF LOAD TEST (EYE BOLT)	MA	MECH. TEST	SAMPLE	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TEST REPORT	PV	-	-	-
1.2	HARDWARES	1.SURFACE CONDITION	MA	VISUAL	100%	-		FREE FROM CRACKS, UN-EVENNESS ETC.	TEST REPORT	P	-	-	-
		2.PROPERTY CLASS	MA	VISUAL	SAMPLES	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TC	PV	-	-	PROPERTY CLASS MARKING SHALL BE CHECKED BY THE VENDOR
1.3	CASTING	1.SURFACE CONDITION	MA	VISUAL	100%	-	MANUFACTURER'S DRG./SPEC	FREE FROM CRACKS, BLOW HOLES ETC.	LOG BOOK	PV	-	-	
		2.CHEM. & PHY. PROP.	MA	CHEM & MECH TEST	1/HEAT NO.	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	TC	PV	-	-	HEAT NO. SHALL BE VERIFIED
		3.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG.	MANUFACTURER'S DRG.	LOG BOOK	PV	-	-	
1.4	PAINT & VARNISH	1.MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100% CONTINUOUS	-	MANUFACTURER'S DRG./SPEC	MANUFACTURER'S DRG./SPEC	LOG BOOK	PV	-	-	

ENGINEERING			QUALITY	
Sign & Date	Name		Sign & Date	Name
Prepared by:	HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI
Reviewed by:	PRAVEEN DUTTA	Reviewed by:		R K JAISWAL

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:		Sign & Date	Seal
Reviewed by:			
Approved by:			

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS				STANDARD QUALITY PLAN				SPEC. NO.:				DATE: 17.04.2020			
						CUSTOMER :				QP NO.: PE-QP-999-Q-007, REV-04							
						PROJECT:				PO NO.:							
						ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))				SYSTEM:				SECTION: II			
														SHEET 2 OF 9			

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	SHAFT (FORGED OR ROLLED)	1. SURFACE COND.	MA	5	6		7	8	9	10	11	12	13
1.5		1. SURFACE COND.	MA	VISUAL	100%	M	-	FREE FROM VISUAL DEFECTS	LOG BOOK	D	P	C	N
		2. CHEM. & PHYSICAL PROPERTIES	MA	CHEM. & PHYSICAL TESTS	100%	C/N	MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S DRG./ STD.	TC		PV	-	VENDOR'S APPROVAL IDENTIFICATION SHALL BE MAINTAINED
		3. DIMENSIONS	MA	MEASUREMENT	100%		MANUFACTURER'S DRG./ SPEC.	MANUFACTURER'S DRG.	LOG BOOK		PV	-	
		4. INTERNAL FLAWS	CR	ULTRASONIC TEST	100%		ASTM-A388	MANUFACTURER'S STD.	INSPECTION REPORT	✓	PW	V	FOR DIA OF 55 MM & ABOVE
1.6	SPACE HEATERS, CONNECTORS, TERMINAL BLOCKS, CABLES, CABLE LUGS, CARBON BRUSH TEMP. DETECTORS, RTD, STD'S	1. MAKE & RATING	MA	VISUAL	100%		MANUFACTURER'S DRG./STD.	MANUFACTURER'S DRG./STD.	INSPECTION REPORT		PV	-	
		2. PHYSICAL COND.	MA	VISUAL	100%		MANUFACTURER'S DRG./STD.	NO PHYS. DAMAGE, NO ELECTRICAL DISCONTINUITY	INSPECTION REPORT		PV	-	
		3. DIMENSIONS (WHEREVER APPLICABLE)	MA	MEASUREMENT	SAMPLE		MANUFACTURER'S DRG./ STD	MANUFACTURER'S DRG. / STD.	INSPECTION REPORT		PV	-	
		4. PERFORMANCE/ CALIBRATION	MA	TEST	100%		MANUFACTURER'S DRG/ STD	MANUFACTURER'S DRG. / STD.	TEST REPORT		PV	-	

ENGINEERING			BHEL			QUALITY		
Sign & Date	Name		Sign & Date	Name				
Prepared by:	HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI				
Reviewed by:	PRAVEEN DUTTA	Reviewed by:		R K JAISWAL				

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:		Sign & Date	Seal
Reviewed by:			
Approved by:			

[illegible][illegible]

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:			
			CUSTOMER :		QP NO.: PEQP-999-Q-007, REV-04			
			PROJECT:		PO NO.:			
			ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:			
					SECTION: II		SHEET 4 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
1	2	3	4	5	6		7	8	9	10			
					M	C/N				D	M	C	N
					SAMPLES	-	MANUFACTURER'S DRG/ SPEC.	MANUFACTURER'S / SPEC.	LOG BOOK		PV	-	-
1.10	BEARINGS	3.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG/ APPROVED DATASHEET	MANUFACTURER'S DRG/ APPROVED DATASHEET	LOG BOOK		PV	-	-
		1.MAKE & TYPE	MA	VISUAL									
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	APPROVED DATASHEET	APPROVED DATASHEET/ BEARING MANUFS CATALOGUES	LOG BOOK		PV	-	-
		3.SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		PV	-	-
1.11	SLIP RING (WHEREVER APPLICABLE)	1.SURFACE COND.	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-
		3.TEMP WITH- STAND CAPACITY	MA	ELECT TEST	SAMPLE	-	MANUFACTURER'S STD/ APPROVED DATASHEET	MANUFACTURER'S STD/ APPROVED DATASHEET	LOG BOOK		PV	-	-
		4.HV/IR	MA	-DO-	100%	-	MANUFACTURER'S STD/ APPROVED DATASHEET	MANUFACTURER'S STD/ APPROVED DATASHEET	LOG BOOK		PV	-	-
1.12	OIL SEALS & GASKETS	1.MATERIAL OF GASKET	MA	VISUAL	100%	-	MANUFACTURER'S DRG/SPECS	MANUFACTURER'S DRG/ SPECS.	LOG BOOK		P	-	-
		2.SURFACE COND.	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK		P	-	-
		3.DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-

BHEL				BIDDER/ SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL							
ENGINEERING		QUALITY		Sign & Date		Sign & Date		Doc No:		Sign & Date		Name		Seal	
Sign & Date		Name		Sign & Date		Name				Reviewed by:					
Prepared by:		HEMA KHUSHWAHA	Checked by:		KUNAL GANDHI					Approved by:					
Reviewed by:		PRAVEEN DUTTA	Reviewed by:		R K JAISWAL										

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS			STANDARD QUALITY PLAN			SPEC. NO.:		DATE:17.04.2020	
				CUSTOMER :			QP NO.: PE-QP-989-Q007, REV-04			
				PROJECT:			PO NO.:			
				ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))			SYSTEM:			
						SECTION: II		SHEET 5 OF 9		

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
1	2	3	4	5	6		7	8	9	10			
					M	C/N				D	M	C	N
2.0	IN PROCESS												
2.1	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNESS	MA	VISUAL	100%	-	MANUFACTURER'S DRG	GOOD FINISH	LOG BOOK		PW	-	-
		2.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-
2.2	MACHINING	1.FINISH	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK		P	-	-
		2.DIMENSIONS	MA	MEASUREMENT	100%	-	MANUFACTURER'S DRG	MANUFACTURER'S DRG	LOG BOOK		P	-	-
		3.SHAFT SURFACE FLOWS	MA	PT	100%	-	MANUFACTURER'S ASTM E165	MANUFACTURER'S STD./ APPROVED DATASHEET.	LOG BOOK	✓	P	V	-
2.3	PAINTING	1.SURFACE PREPARATION	MA	VISUAL	100%	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-
		2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MA	MEASUREMENT BY ELCOMETER	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-
		3.SHADE	MA	VISUAL	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-
		4.ADHESION	MA	CROSS CUTTING & TAPE TEST	SAMPLE	-	MANUFACTURER'S STD./APPROVED DATASHEET	MANUFACTURER'S STD./APPROVED DATASHEET	LOG BOOK		P	-	-

BHEL				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		BIDDER/ SUPPLIER		Doc No:	
Sign & Date	Name	Sign & Date	Name	Sign & Date	Seal	Sign & Date	Seal
Prepared by:	HEMA KHUSHWAHA	Checked by:	KUNAL GANDHI	Reviewed by:		Reviewed by:	
Reviewed by:	PRAVEEN DUTTA	Reviewed by:	R K JAISWAL	Approved by:		Approved by:	

	MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO. :			
			CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04			
			PROJECT:		PO NO.:			
			ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:			
					SECTION: II		SHEET 6 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
1	2	3	4	5	6		7	8	9	10			
					M	C/N							
2.4	SHEET STACKING	1.COMPLETENESS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-
		2.COMPRESSION & TIGHTENING	MA	MEASUREMENT	100%	-	MANUFACTURER'S STD.	MANUFACTURER'S STD.	LOG BOOK		P	-	-
2.5	WINDING	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STD/APPROVED DATASHEET	MANUFACTURER'S STD/APPROVED DATASHEET	LOG BOOK		P	-	-
		2.CLEANLINESS	CR	VISUAL	100%	-	MANUFACTURER'S STD/APPROVED DATASHEET	MANUFACTURER'S STD/APPROVED DATASHEET	LOG BOOK		P	-	-
		3.IR-HV-IR	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT	✓	P	V	-
		4.RESISTANCE	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT	✓	P	V	-
		5.INTERTURN INSULATION	CR	ELECT. TEST	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TEST/INSPC. REPORT		P	-	-
2.6	IMPREGNATION	1.VISCOSITY	MA	PHY. TEST	AT STARTING	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-
		2.TEMP. PRESSURE VACUUM	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-
		3.NO. OF DPS	MA	PROCESS CHECK	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-
THREE DPS TO BE GIVEN													

BHEL				BIDDER/ SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL					
ENGINEERING		QUALITY		Sign & Date		Sign & Date		Doc No:		Sign & Date		Name	
Sign & Date		Name		Sign & Date		Name				Sign & Date		Seal	
Prepared by:		HEMA KHUSHWAHA		Checked by:		KUNAL GANDHI		Reviewed by:					
Reviewed by:		PRAVEEN DUTTA		Reviewed by:		R K JAISWAL		Approved by:					

	STANDARD QUALITY PLAN		SPEC. NO.:	
	CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV-04	
	PROJECT:		PO NO.:	
	ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM: II	
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		DATE:17.04.2020		
		SHEET 7 OF 9		

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
					6				9		*	**		
1	2	3	4	5	M	C/N	7	8	D	M	C	N		
2.7	COMPLETE STATOR ASSEMBLY	4.DURATION	MA	PROCESS CHECK VISUAL	CONTINUOUS	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK	✓	P	V	-	
		1.COMPACTNESS & CLEANLINESS	MA		100%	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
2.8	BRAZING/COMPRESSION JOINT	1.COMPLETENESS	CR	VISUAL	100%	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	LOG BOOK		P	-	-	
		2.SOUNDNESS	CR	MALLETT TEST & UT	100%	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	TEST/INSPC. REPORT	✓	P	V	-	
2.9	COMPLETE ROTOR ASSEMBLY	3.HV	MA	ELECT. TEST	100%	-	MANUFACTURER'S STANDARD	MANUFACTURER'S STANDARD	TEST/INSPC. REPORT	✓	P	V	-	
		1.RESIDUAL UNBALANCE	CR	DYN. BALANCE	100%	-	MANUFACTURER'S SPEC / ISO 1940	MANUFACTURER'S DWG.	LOG BOOK		P	-	-	
2.10	ASSEMBLY	2.SOUNDNESS OF DIE CASTING	CR	ELECT. (GROWLER TEST)	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	TEST/INSPC. REPORT	✓	P	V	-	
		1.ALIGNMENT	MA	MEAS.	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK		P	-	-	
		2.WORKMANSHIP	MA	VISUAL	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK		P	-	-	
		3.AXIAL PLAY	MA	MEAS.	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK	✓	P	V	-	
		4.DIMENSIONS	MA	MEAS.	100%	-	MANUFACTURER'S DRG./ MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK		P	-	-	
		5.CORRECTNESS, COMPLETENESS, TERMINATIONS/ MARKING/ COLOUR CODE	MA	VISUAL	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK		P	-	-	
		6. RTD, BTD & SPACE HEATER MOUNTING.	MA	VISUAL	100%	-	MANUFACTURER'S SPEC.	MANUFACTURER'S SPEC.	LOG BOOK	✓	P	V	-	

ENGINEERING			BHEL		
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
Prepared by:	HEMA KHUSHWAHA	Checked by:	KUNAL GANDHI		
Reviewed by:	PRAVEEN DUTTA	Reviewed by:	R K JAISWAL		

BIDDER/ SUPPLIER		
Sign & Date		
Seal		

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:		Sign & Date	Seal
Reviewed by:			
Approved by:			

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check			Reference Document	Acceptance Norms	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6			7	8	9	10	11	12	13	14
					1/TYPE/SIZE	M	C/N								
3.0	TESTS	1.TYPE TESTS INCLUDING SPECIAL TESTS 2.ROUTINE TESTS INCLUDING SPECIAL TEST 3.VIBRATION & NOISE LEVEL 4.OVERALL DIMENSIONS AND ORIENTATION 5.DEGREE OF PROTECTION 6. MEASUREMENT OF RESISTANCE OF RTD & BTD 7. MEASUREMENT OF RESISTANCE IR OF SPACE HEATER 8. NAME PLATE DETAILS 9.EXPLOSION FLAME PROOF TESTS (IF SPECIFIED) 10. PAINT SHADE, THICKNESS & FINISH	MA	ELECT.TEST	1/TYPE/SIZE	100%	100%	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	✓	P	W*	-	* NOTE - 1
					1/TYPE/SIZE	100%	-	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	✓	P	V [§]	-	§ NOTE - 2
					1/TYPE/SIZE	100%	-	IS: 12075 / IEC 60034-14 & IS-12065	IS: 12075 / IEC 60034-14 & IS-12065	TEST REPORT	✓	P	V [§]	-	§ NOTE - 2
					1/TYPE/SIZE	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET &	TEST/INSPC. REPORT	✓	P	W	-	
					1/TYPE/ SIZE	100%	-	IEC 60034-5/IS-12615	APPROVED DATASHEET	TC	✓	P	V	-	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
					100%	100%	-	IS-325/IS-12615/IEC-60034 PART-1/IS: 12802	IS-325/IS-12615/IEC-60034 PART-1/IS: 12802	TC	✓	P	V [§]	-	§ NOTE - 2
					100%	100%	-	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	TC	✓	P	V [§]	-	§ NOTE - 2
					100%	100%	-	IS-325/IS-12615 & DATA SHEET	IS-325/IS-12615 & DATA SHEET	TEST/INSPC. REPORT	✓	P	V [§]	-	§ NOTE - 2
					1/TYPE	1/TYPE	-	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	-	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
					SAMPLE	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC	✓	P	W [§]	-	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY § NOTE - 2

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

		MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS				STANDARD QUALITY PLAN		SPEC. NO.:		DATE:17.04.2020	
PROJECT:						CUSTOMER :		QP NO.: PE-QP-999-Q-007, REV:04			
						PROJECT:		PO NO.:			
						ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		SECTION: II	
SHEET 9 OF 9											

S/ No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	PACKING	SURFACE FINISH & COMPLETENESS	4	5	6		7	8	9	* D	** M C N		
4.0					100%	C/N					P W -		
										NSPC. REPORT		(H): REFER NOTE-8	

NOTES:

1

DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.

2

ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.

3

IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THE SAME IS VALID FOR 5 YEARS.

4

BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.

5

AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.

6

IN CASE, ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/ CUSTOMER.

7

PROJECT SPECIFIC QP TO BE DEVELOPED BASED ON CUSTOMER REQUIREMENT.

8

FOR EXPORT JOB, BHEL TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING TO BE FOLLOWED.

9

PACKING SHALL BE SUITABLE FOR STORAGE AT SITE IN TROPICAL CLIMATE CONDITIONS.

10

LATEST REVISION/ YEAR OF ISSUE OF ALL THE STANDARDS (ISI/ ASME/ IEC ETC.) INDICATED IN QP SHALL BE REFERRED.

LEGENDS:

RECORDS, IDENTIFIED WITH "TICK"(X) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,

P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE

MA: MAJOR, MI: MINOR, CR: CRITICAL

D: DOCUMENT

BHEL			
ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
Prepared by:	HEMA KHUSHWAHA	Checked by:	KUNAL GANDHI
Reviewed by:	PRAVEEN DUTTA	Reviewed by:	R K JAISWAL

BIDDER/ SUPPLIER			
Sign & Date			
Seal			

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:		Sign & Date	Seal
Reviewed by:			
Approved by:			

[illegible]

[illegible]

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-D	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

ANNEXURE-I

LIST OF MAKES OF SUB-VENDOR ITEMS

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, Sub Section-D	
		REV. 00	DATE: MAY 2020
		SHEET : 1	

Sl.no.	Item	Category of Inspection	Sub-vendor	Place	Remarks
1.	PAINT	III	ASIAN PAINT		
		III	BERGER		
		III	KANSAI NEROLAC		
		III	JOTUN		
		III	SHALIMAR		
		III	JENSON & NICHOLSON (I) LTD		
		III	CDC CARBOLINE (I) LTD.		
		III	ADDISON PAINTS LTD		
		III	GRAND POLYCOAT		

NOTES: INSPECTION CATEGORIZATION

CAT I: INSPECTION BY OWNER, BHEL/BHEL NOMINATED TPIA & VENDOR. MDCC WILL BE ISSUED BASED ON INSPECTION REPORT IN LINE ITH APPROVED QAP.

CAT II: INSPECTION BY BHEL/BHEL NOMINATED TPIA & VENDOR. MDCC WILL BE ISSUED BASED ON INSPECTION REPORT IN LINE ITH APPROVED QAP.

CAT III: MDCC WILL BE ISSUED BASED COC & MTC ISSUED BY VENDOR AND VERIFICATION BY BHEL / OWNER IN LINE WITH APPROVED QAP/CHECK LIST

- Refer electrical specification for applicable sub-vendor list for motors.
- The list of all bought out items like gearbox, coupling, bearings etc. with makes and country of origin and contact details of the manufacturers to be mentioned along with offer to be submitted in the format attached in Section II, Annexure-6 as information to BHEL.
- Acceptance of makes shall be subject to BHEL/ End customer acceptance during the detailed engineering without cost and delivery implication to BHEL.
- Make of any unlisted items shall be subject to end customer / BHEL approval during detail engineering. For such items, bidder to furnish list of sub-vendors during detail engineering stage for end Customer / BHEL's review and approval. Bidder shall furnish following supporting documentation within 1 month of placement of LOI. Thereafter no request for additional sub-vendor shall be entertained.
 - a) Documentation to show that the equipment /system has been supplied for a plant of similar or higher capacity.
 - b) Documentation in the form of certificate that the equipment/system has been operating satisfactorily for two years as on the scheduled date of bid opening.
- The complete list will be necessarily submitted within one month of placement of LOI to ensure timely placement of order for BOIs. Bidder to assess the capability of their proposed sub-vendors in terms of preparation of drawings, calculations, documents, quality assurance, supply of material etc. as per project schedule before placing the order on them.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I Sub Section-D	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

ANNEXURE-II

MANDATORY SPARE LIST

12866/2020/PS-PEM-MAX

(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS		SPECIFICATION NO. :PE-TS-467-571-18000-A001
		ANNEXURE-II
Sl. No.	PARTICULARS	Unit /Quantity (Nos./SET/%)
1	AGITATORS	
1.1	AUXILIARY ABSORBENT TANK AGITATOR	
1	Impeller Assembly	1 no. of each type and size
2	Bearing Assembly	1 no. of each type and size
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type and size
5	Gear Box Assembly (If Applicable)	1 no. of each type and size
6	Agitator shaft assembly	1 no. of each type and size
7	Shaft Seal	1 no. of each type and size
8	Complete Agitator Assembly	1 no. of each type and size
1.2	LIMESTONE SLURRY STORAGE TANK AGITATORS	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.3	PRIMARY HYDRO-CYCLONE FEED TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.4	SECONDARY HYDROCYCLONE FEED TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.5	FILTRATE WATER TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.6	WASTE WATER TANK AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type

12866/2020/PS-PEM-MAX

(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS		SPECIFICATION NO. :PE-TS-467-571-18000-A001
		ANNEXURE-II
Sl. No.	PARTICULARS	Unit /Quantity (Nos./SET/%)
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.7	ABSORBER AREA DRAIN SUMP AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.8	GYPSUM AREA DRAIN SUMP AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
1.9	LIMESTONE AREA DRAIN SUMP AGITATOR	
1	Impeller Assembly	1 no. of each type
2	Bearing Assembly	1 no. of each type
3	Motor	1 no. of each type
4	Belt and Pulley (If applicable)	1 no. of each type
5	Gear Box Assembly (If Applicable)	1 no. of each type
6	Agitator shaft assembly	1 no. of each type and size
7	Complete Agitator Assembly	1 no. of each type and size
Note:		
1)One set means 100% complete replacement of the particular component/equipment, as mentioned i.e., Set for the particular equipment, would include all components required to replace the item. For example, a set of bearing shall include all hardware normally required while replacing the bearings. It is further, intended that the assembly / sub-assembly which have different orientation (like left hand or right hand, top or bottom), different direction of rotation or mirror image positioning or any other reasons which result in maintaining two different sets of the spares to be used for the subject assembly / sub-assembly, these shall be considered as different types of assembly/sub-assembly.		
2) Wherever the quantities have been indicated for each type, size, thickness, material, radius, range etc. these shall cover all the items supplied and installed.		
3) In case spares indicated in the list are not applicable to the particular design offered by the bidder, the bidder should offer spares applicable to offered design with quantities generally in line with the approach followed in the above list.		
4) Any item which is quoted as "not applicable" in the above list and is found to be "applicable" at a later date shall be supplied by the Bidder without any commercial implications. The Bidder shall note that if there is any change/ variation in equipment/ system during detail engineering which causes any change/ variation in the essential spares quantity, the same shall be supplied without any commercial implications. The price indicated for the mandatory spares shall be considered for the purpose of evaluation.		
5) Mandatory spares shall not be dispatched before dispatch of corresponding main equipment. The spares shall be treated and packed for a long storage under the climatic condition prevailing at site.		
6) All spares supplied under this contract shall be strictly interchangeable with parts for which they are intended for replacements. These spares should include all mounted accessories like components, boards, add or items, fitting, connectors etc. and be complete in all respects so that the replacement of the main items by these spares does not require any additional item. The vendors must conform the pair to pair compatibility of each electrical spares modules with the modules supplied in the original package. All electronic modules should be pre-set and/or pre-programmed for ready use at site. Alternatively, suitable instruction sheet indicating the details of required PCB jumper position, BCD which is setting, EPROM/PROM listing etc should be packed along with each module. Also a caution mark sign should be put on all such module which needs pre-setting/pre-programming before putting them in to service. The spare shall be treated and properly packed for long term storage.		
7) Each spare shall be clearly marked and labelled on the outside of the packing with its description. When more than one spare part is packed in single case, a general description of the contents shall be shown on the outside of such case and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purpose of identification.		
8) Bidder to provide mandatory spares ,as asked above, for each type of tank separately, even in case the type & size of tank of agitator is similar.		

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I Sub Section-D	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

ANNEXURE-III

SIZING CALCULATION, SELECTION PARAMETER
FOR ALL TANKS

Tank Sizing Basis(below 10.0 m dia):

Tank size is decided as per the following

LL – Pump LL level m

L – LL + 0.2 m

H - Effective height m


HH - H + 0.2 m

Top - HH + 0.5 m

Effective volume = $3.14 / 4 \times \Phi^2 \times (H-L)$

Hold volume = $3.14 / 4 \times \Phi^2 \times (HH)$

H/D ratio = ~1.2 (Max)

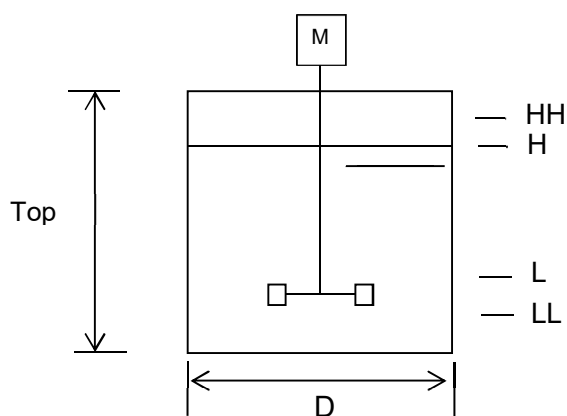**Tank Sizing basis (Above 10.0 m dia):**

Tank size is decided as per the following

LL – Pump LL level m

L – LL + 0.2 m

H - Effective height m


HH - H + 0.2 m

Top - HH + 0.8 m

Effective volume = $3.14 / 4 \times \Phi^2 \times (H)$


Hold volume = $3.14 / 4 \times \Phi^2 \times (HH)$

H/D ratio = ~1.0 (Max)

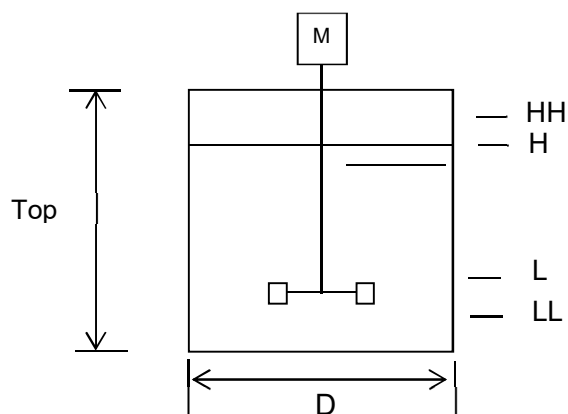**Gas condition for Tank Sizing:**

S.No	Gas Condition	Feature
1	VWO Worst coal	FGD Design Point

Tank Sizing:

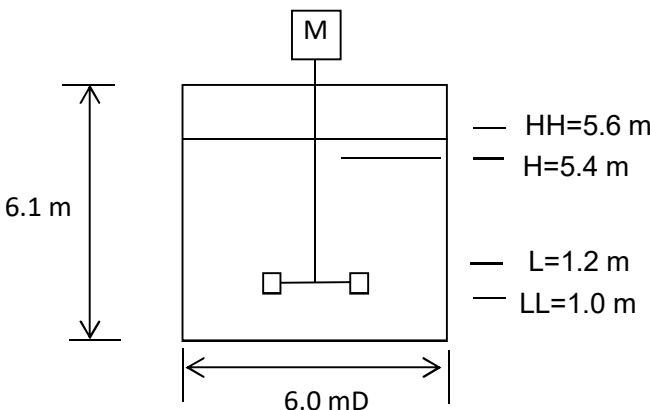S. No	Item No	Service	Design Spec	Process Parameter	Design Basis										
1	00HTM 03 BB001	Filtrate water Tank	6000 mm D X 6100 mmH Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	211.8m3/h (48.15 X 3 + 67.35) (Design point- 3X500MW- Stream No: <402> x 3 Units + Design point 3X200MW - Stream No: <402>)										
				Retention Time	0.5 Hr										
				Required volume	211.8 m3/h x 0.5 hr =105.9 m3										
															
					Tank Level is designated as follows										
					<table><tr><td>Top</td><td>6.1</td></tr><tr><td>HH</td><td>5.6</td></tr><tr><td>H</td><td>5.4</td></tr><tr><td>L</td><td>1.2*</td></tr><tr><td>LL</td><td>1.0*</td></tr></table>	Top	6.1	HH	5.6	H	5.4	L	1.2*	LL	1.0*
Top	6.1														
HH	5.6														
H	5.4														
L	1.2*														
LL	1.0*														
					<u>Circular Tank</u> Effective volume = 6.0 m Φ ^ 2 / 4 x π x (5.4-1.2) m = 118.75 m3>105.91 m3 Hold Volume = 6.0 m Φ ^ 2 / 4 x π x 5.6 m = 158.3m3										

*L and LL level is finalized by vendor's information of filtrate water pump and agitator.


S.No	Item No	Service	Design Spec	Process Parameter	Design Basis
2	00HTM00 BB001	Primary Hydro cyclone feed Tank	7500 mm D X 7800 mmH Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	235.45 m3/h (53.94 X 3+ 73.63) (Design point- 3X500MW- Stream No: <201> x 3 Units + Design point 3X200MW - Stream No: <201>)
				Retention Time	1 Hour
				Required volume	235.45 m3/h x 1 hr = 235.45 m3
				<	

*L and LL level is finalized by vendor's information of Waste water hydro cyclone feed pump and agitator.

S.No	Item No	Service	Design Spec	Process Parameter	Design Basis
3	00HTM04 BB001	Secondary Hydro cyclone feed Tank	6000 mm D X 7200mmH- Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	136.03 m3/h (31.17 X3 + 42.52) (Design point- 3X500MW- Stream No: <202> x 3 Units + Design point 3X200MW - Stream No: <202>)
				Retention Time	1 Hours
				Required volume	136.03 m3/h x 1 hr = 136.03 m3
<					

*L and LL level is finalized by vendor's information of Waste water hydro cyclone feed pump and agitator.

11/866/2020/PS-PEM-MAX

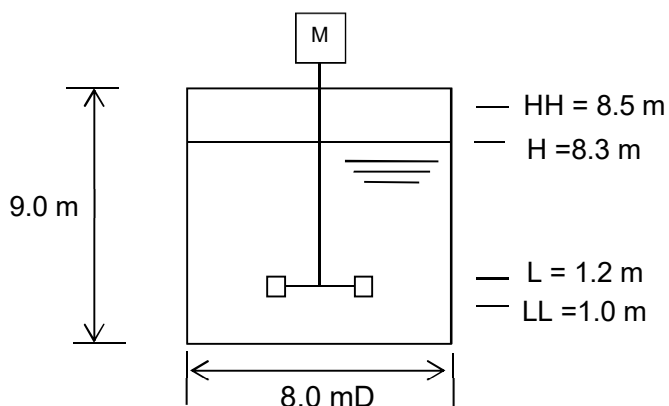S. No	Item No	Service	Design Spec	Process Parameter	Design Basis										
4	00HTM 05BB0 01	Waste water storage Tank	8000 mmD X 9000 mmH- Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	41.16 m3/h (9.81 X 3 +11.73) (Design point- 3X500MW- Stream No: <205> x 3 Units + Design point 3X200MW - Stream No: <205>)										
				Retention Time	8.0 Hours										
				Required volume	41.16 m3/h x 8.0 hr = 329.28 m3										
															
					Tank Level is designated as follows										
					<table><tr><td>Top</td><td>9.0</td></tr><tr><td>HH</td><td>8.5</td></tr><tr><td>H</td><td>8.3</td></tr><tr><td>L</td><td>1.2*</td></tr><tr><td>LL</td><td>1.0*</td></tr></table>	Top	9.0	HH	8.5	H	8.3	L	1.2*	LL	1.0*
Top	9.0														
HH	8.5														
H	8.3														
L	1.2*														
LL	1.0*														
					Circular Tank Effective volume = 8.0 m Φ ^ 2 / 4 x π x (8.3-1.2) m = 356.88 m3> 329.28m3 Hold Volume = 8.0 m Φ ^ 2 / 4 x π x 8.5 m =427.2 m3										

*L and LL level is finalized by vendor's information of Waste water pump and agitator.


S. No	Item No	Service	Design Spec	Process Parameter	Design Basis
5	00HTK0 3BB001/ 002	Lime stone slurry storage Tank	15000 mmD X 15000 mmH Quantity = 2 no. (1W+1S) (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity for each tank	a) Limestone required = 40.326 TPH (9.263 x 3 Units + 12.537) (Design point- 3X500MW- Stream No: <501> x 3 Units + Design point 3X200MW - Stream No: <501>) b) 20% (w/w) Limestone slurry = 40.326 TPH / 20% mass flow rate = 201.63 TPH per unit c) 20%(w/w) Limestone slurry density = 1.130 t/m3 d) 20% (w/w) Limestone slurry = 201.63 TPH / 1.130 volume flow rate = 178.44 m3/hr for all the 4 Absorbers.
				Retention Time	12.0 hr
				Required volume	178.44 m3/h x 12 hr = 2141.20 m3
				M 15.0 m <	

*L and LL level is finalized by vendor's information of Limestone slurry Feed pump and agitator.


11/866/2020/PS-PEM-MAX

S. No	Item No	Service	Design Spec	Process Parameter	Design Basis
6	00HTK0 0BB001	Auxiliary Absorbent Tank	13500mmDX 13500mmH Quantity = 1 no (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	Absorber Tank Volume = 1760 m3 (with 20 % margin) (3X200MW Absorber tank Size – 26.9mX10.9mX5.0m= 1466.05 m3 20 % margin =1466.05 X 1.2=1760.0 m3)
				Retention Time	Batch Operation
				Required volume	1760 m3

*L and LL level is finalized by vendor's information of Auxiliary Absorbent tank pump and agitator.

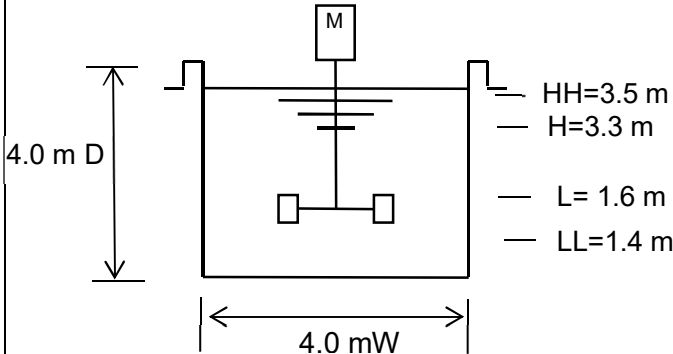
S. No	Item No	Service	Design Spec	Process Parameter	Design Basis
7	10/40HTT 00BB001	Absorber Area Drain Sump	4000mmW X 4000mmL X 4000mmH Quantity = 4 nos. (One (1) number for each absorber)	Process Capacity for each Sump	25 m3
				Retention Time	Batch Operation
				Required volume	25 m3
					
Tank Level is designated as follows					
Top	4.0				
HH	3.5				
H	3.3				
L	1.6*				
LL	1.4*				
Rectangular Tank Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m3 >25 m3 Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m3					

*L and LL level is finalized by vendor's information of Sump pump and agitator.

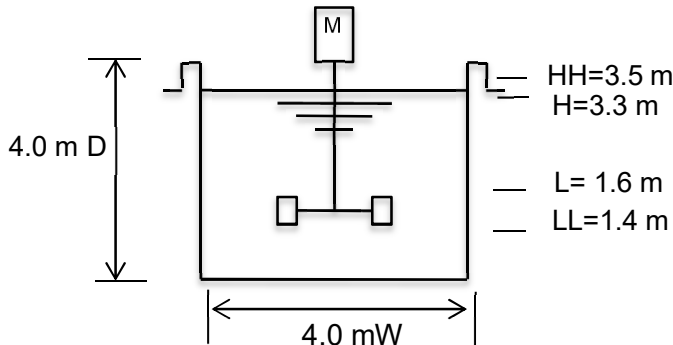S. No	Item No	Service	Design Spec	Process Parameter	Design Basis	
8	00HTT01 BB001	Gypsum Area Drain Sump	4000mmW X 4000mmL X 4000mmH	Process Capacity	25 m3	
			Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Retention Time	Batch Operation	
				Required volume	25 m3	
					Tank Level is designated as follows	
					Top	4.0
					HH	3.5
					H	3.3
					L	1.6*
					LL	1.4*
<u>Rectangular Tank</u>						
Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m3 >25 m3						
Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m3						

*L and LL level is finalized by vendor's information of Sump pump and agitator.

11866/2020/PS-PEM-MAX

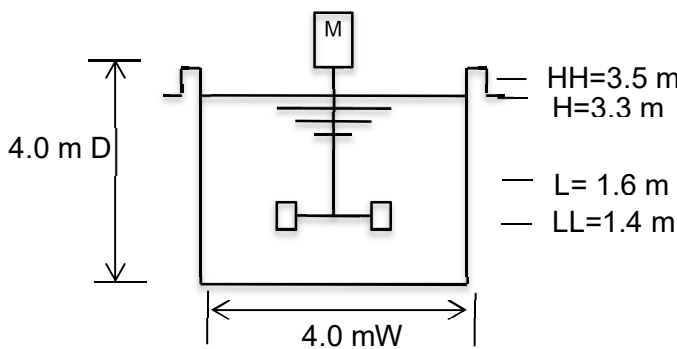S. No	Item No	Service	Design Spec	Process Parameter	Design Basis								
9	00HTT02 BB001	Lime Stone Area Drain Sump	4000mmW X 4000mmL X 4000mmH Quantity = 1 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	25 m3								
				Retention Time	Batch Operation								
				Required volume	25 m3								
				 <table><tr><th colspan="2">Tank Level is designated as follows</th></tr><tr><td>Top</td><td>4.0</td></tr><tr><td>HH</td><td>3.5</td></tr><tr><td>H</td><td>3.3</td></tr><tr><td>L</td><td>1.6*</td></tr><tr><td>LL</td><td>1.4*</td></tr></table> Rectangular Tank Effective volume = 4.0 m x 4.0 m x (3.3-1.6) m = 27.2 m3 >25 m3 Hold Volume = 4.0 m x 4.0 m x 3.5 m = 56 m3		Tank Level is designated as follows		Top	4.0	HH	3.5	H	3.3
Tank Level is designated as follows													
Top	4.0												
HH	3.5												
H	3.3												
L	1.6*												
LL	1.4*												

*L and LL level is finalized by vendor's information of Sump pump and agitator.

The above data is basic design data and may vary based on actual piping layout and selected vendor's recommendations.

Reference Documents

- Mass Flow Balance (3X500 MW Design Point + 3X200 MW Design Point) data- 3310-109-PV
M-W-002

1. Gas condition for Water Tank Sizing:

S.No.	Gas Condition	Feature
1	VWO	Maximum Absorbed SO ₂ Condition Maximum Inlet Gas flow condition

2. Water Tank Sizing Basis

Tank size is decided as per the following


LL – Pump LL level m

L – LL + 0.2 m

H – Effective height m

HH – H + 0.2 m

Top – HH + 0.5 m

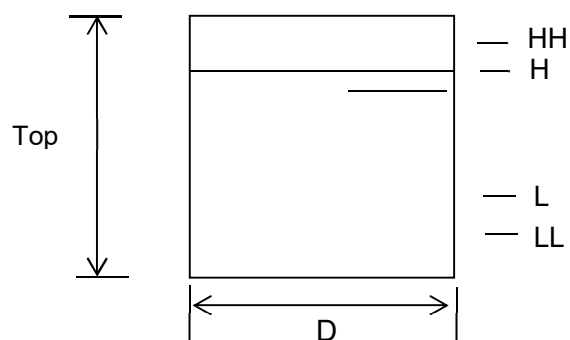

$$\text{Effective volume} = 3.14 / 4 \times \Phi^2 \times (H-L)$$

$$\text{Hold volume} = 3.14 / 4 \times \Phi^2 \times (HH)$$

$$\text{Top/D ratio} = 1-1.2$$

S. No	Item No	Service	Design Spec	Process Parameter	Design Basis
1	00HTQ0 0BB001/ 002	Process Water Tank	6500 mmD X 7000 mmH Quantity = 2 nos. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity	611.14m3/h ((7.60+25.83+0.77+76.18+11.38/2+ 21.83)X3) + ((9.63 +36.07+0.96 + 113.47 + 15.54/2 +29.54)) (Refer Mass Flow Balance (3X500 MW Design Point) data stream no. (<801> + <802> + <803> + <804> + <805>/2 + <806>) x 3 units) + (Refer Mass Flow Balance (3X200 MW Design Point) data stream no. (<801> + <802> + <803> + <804> + <805>/2 + <806>)).
				Retention Time	0.25 hr
				Required volume	611.14 m3/h x 0.25 hr = 152.79 m3
				<	

* LL level will be finalized by vendor's information of Process water pump.

S. No	Item No	Service	Design Spec	Process Parameter	Design Basis
2	00HTQ0 1BB001/ 002	Cake wash (Clarified water) Tank	4000 mmD X 4000 mmH Quantity = 2 nos. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity for each tank	24.84 m3/h (11.38/2X3 + 15.54/2) Refer (Mass Balance (3X500M Design Point data) stream no. (<805>/2) x 3 units) + (Mass Balance (3X200MW Design Point data) stream no. (<805>/2).
				Retention Time	1hr
				Required volume	24.84 m3/h x 1hr = 24.84 m3
				<	

*LL level is finalized by vendor's information of Cake wash tank pump.

11/866/2020/PS-PEM-MAX

S.N o	Item No	Service	Design Spec	Process Parameter	Design Basis						
3	00HTM01B B001/002	Belt Filter Wash Tank	4000 mmD X 4000 mmH Quantity = 2 no. (Common for combine absorber (3 X200 MW) and as well as for all 500 MW units.)	Process Capacity for each tank	24.84 m3/h (11.38/2X3 + 15.54/2) Refer (Mass Balance (3X500M Design Point data) stream no. (<805>/2) x 3 units) + (Mass Balance (3X200MW Design Point data) stream no. (<805>/2).						
				Retention Time	1hr						
				Required volume	24.84 m3/h x 1hr = 24.84 m3						
				Tank Level is designated as follows							
				<table><tr><td>Top</td><td>4.0</td></tr><tr><td>HH</td><td>3.5</td></tr><tr><td>H</td><td>3.3</td></tr><tr><td>L</td><td>1.2</td></tr><tr><td>LL</td><td>1.0*</td></tr></table>		Top	4.0	HH	3.5	H	3.3
Top	4.0										
HH	3.5										
H	3.3										
L	1.2										
LL	1.0*										

*LL level is finalized by vendor's information of belt filter wash tank pump.

Reference Documents

- Mass Flow Balance (3X500 MW Design Point + 3X200 MW Design Point) data- 3310-109-PVM-W-002

12866/2020/PS-PEM-MAX



TITLE:

**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPEC. NO.: PE-TS-467-571-18000-A001

SECTION-I, SUB-SECTION- D

REV. NO.: 00 DATE MAY 2020

ANNEXURE-IV

MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION

The successful bidder shall submit the following drawings / documents during detail engineering for approval / information / reference (as the case may be): -

Sl. No.	BHEL Drawing / Document No.	Title	Schedule Date	Drawing Classification
1	PE-V0-466-XXX-A001	GA drawing, Exploded view, sectional view with Material of construction, mechanical seal , gearbox for all Agitator models	2 weeks from LOI	Primary
2	PE-V0-466-XXX-A002	Data sheet for all Agitator	2 weeks from LOI	Primary
3	PE-V0-466-XXX-A003	Agitator Performance curve of all Agitators	2 weeks from LOI	Primary
4	PE-V0-466-XXX-A004	Electrical motor GA drawing & Data sheet and performance curves of all motors	2 weeks from LOI	Primary
5	PE-V0-466-XXX-A005	Quality plan & Inspection and Test Procedure	2 weeks from LOI	Primary
6	PE-V0-466-XXX-A006	Agitator and Motor Sizing Calculation	2 weeks from LOI	Primary
7	PE-V0-466-XXX-A007	O&M Manual for Agitator	4 weeks from LOI	Secondary
8	PE-V0-466-XXX-A008	Utility Consumption	4 weeks from LOI	Secondary
9	PE-V0-466-XXX-A009	Foundation Data including Anchor plan	4 weeks from LOI	Secondary
10	PE-V0-466-XXX-A010	Lubricating oil list	4 weeks from LOI	Secondary
11	PE-V0-466-XXX-A011	Special tools list, Start-up & Commissioning Spares	4 weeks from LOI	Secondary
12	PE-V0-466-XXX-A012	Installation and assembly procedure including Pre Commissioning Check List	4 weeks from LOI	Secondary

12866/2020/PS-PEM MAX



TITLE:

**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPEC. NO.: PE-TS-467-571-18000-A001

SECTION-I, SUB-SECTION- D

REV. NO.: 00 DATE MAY 2020

NOTE: Drwg/ Document shall be uploaded by the successful bidder on WRENCH /DMS. Procedure for the same will be informed after award of contract.

1. The above drawing list is tentative and shall be finalized with the successful bidder after placement of order. While some of the drawings indicated above may not be applicable, some additional drawings may also be required based on scope of work.
2. Drawings shall be prepared in Auto-Cad latest edition. Required no. of hard and soft copies (editable) of the drawings shall be furnished as per requirement specified elsewhere in the specification.
3. Only manual calculation with authentic supporting literature (e.g. extracts of hand Book/ standard/codes) shall be acceptable. All design calculations and drawings shall be in SI system only.
4. All the drawings and documents including general arrangement drawing, data sheet, calculation etc. to be furnished to the customer during detailed engineering stage shall include / indicate the following details for clarity w.r.t. Inspection, construction, erection and maintenance etc.:
 - a) All drawings and documents shall indicate the list of all reference drawings including General Arrangement.
 - b) All drawings shall include / show plan, elevation, side view, cross-section, skin section, blow-up view; all major self-manufactured and bought out items shall be labeled and included in BOQ / BOM in tabular form.
 - c) Painting schedule shall also be made as a part of general arrangement drawing of each equipment / items indicating at least 3 trade names.
 - d) All the drawings required to be furnished to customer during detailed engineering stage shall include technical parameters, details of paints and lubrication, hardness and BOQ / BOM in tabular form indicating all major components including bought out items and their quantity, material of construction indicating its applicable code / standard, weight, make etc.
 - e) Drawings/ documents to be submitted for purchaser's review/ approval shall be under Revision A, B, C... etc. while drawings documents to be submitted thereafter for customer's approval after purchaser's approval shall be under R-0, 1, 2, 3 etc.
 - f) Drawings and documents not covered above but required to check safety of machines/ system, shall be submitted during detailed engineering stage without any commercial implication.
 - g) All drawings shall include "B.O.M" and indicate quantity, material of construction, make along with IS/BS No., Technical parameters, dimensions,

12866/2020/PS-PEM-MAX



TITLE:

**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPEC. NO.: PE-TS-467-571-18000-A001

SECTION-I, SUB-SECTION- D

REV. NO.: 00 DATE MAY 2020

hardness, machining symbol and tolerance, requirement of radiography and hydraulic tests, painting details, elevation, side view, plan, skin section and blow-up view for clarity.

h) All drawings shall be prepared as per BHEL's title block and shall bear BHEL's drawing No. Documents marked for submission to BHEL's Customer shall also bear BHEL's Customer's drawing No.

i) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's/ Customer's/ Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.

j) Bidder to follow the following the drawing submission schedule:

- 1st submission of drawings from date of LOI as per the submission schedule.
- Every revised submission incorporating comments – within 7 days.

k) Bidder to submit revised drawings complete in all respects incorporating all comments.

l) The primary drawings are to be considered as the basic engineering drawings.

Any incomplete drawing submitted shall be treated as non-submission with delays attributable to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall depute his personal to BHEL for across the table discussions/ finalizations/ submissions of drawings.

COMPANY SEAL

SIGNATURE: _____

NAME : _____

DESIGNATION: _____

COMPANY: _____

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION- D	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

ANNEXURE-V

SEA-WORTHY PACKING PROCEDURE



Mechanical Auxiliaries Department,
PEM, PPEI Building,
NOIDA

Ref No.: PEA00-Misc/PKD

Date: 12/08/10


Sub: Technical specification for Seaworthy Packing for Export Jobs

A taskforce was constituted vide order dated 21/06/2010 for finalization of seaworthy packing specification for export jobs with the following members.

Mr. SK Anand,
 Mr. Ashwani Khanna
 Mr. Rajnish Goyal
 Mr. PK Das

After several rounds of discussions among task force members it was decided to have latest practices being followed in other industries for export packing. Same was arranged from few industries.

A detailed specification for seaworthy packing for export jobs has been prepared taking care of latest practices being followed and requirements in our existing specification for wooden box/crates. Same is enclosed for reference and final issue.



 (PK DAS)

Convener (Task Force)

GM/MAX


 12/08/10

ED/PEM


 31.08.2010

VOLUME IIB

**TECHNICAL SPECIFICATION
FOR
SEAWORTHY PACKING FOR EXPORT JOBS**

SPECIFICATION NO. PE-TS-888-100-A001



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NEW DELHI, INDIA**

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 1	OF 52

1.0 Purpose

The purpose of this specification is to describe minimum packing requirements for the different items/equipment for all export Project and also to define marking and shipping requirements during transportation by ship, road and air for all export jobs.

2.0 SCOPE

For export jobs, sea worthy packing capable of performing all necessary functions like prevention of damage to the contents, sufficient to support frequent handling and lengthy period of outdoor storage in adverse weather conditions are required. Workmanship and materials used shall be of high standard meeting the technical requirements and in accordance with best commercial export packing practices. Vendor shall be responsible for sea worthy export packing, however it shall meet the minimum requirements specified herein. Equivalent or better packing methods may be deployed subject to approval of the BHEL/Purchaser. Vendor shall submit the packing procedure for its equivalent for purchaser's approval during detailed engineering.

The scope this specification is to define VENDOR's responsibilities in terms of:

- Preservation of the GOODS/items/equipments before packing.
- Packing of the GOODS for road, rail, sea and/or air transportation to desired destination i.e. project site
- Making cases/crates
- Chemical Treatment/Fumigation before packing to prevent fungus, damage due to termite, borer, rats, etc.
- Marking of cases/crates.
- Other Services required.

3.0 Application

This specification is applicable to all the goods to be transported to project site and requires to be in transit for longer duration. *However, for "Misc cable erection items", "Fire sealing system" & "Exothermic welding material", the packing requirements shall be as per the procurement specification.*

4.0 Definitions

- "BHEL" : Main EPC vendor
- "OWNER" : Customer for a particular export project.
- "VENDOR" : Company(ies)/VENDOR(s) to whom the BHEL has placed Purchase Order for GOODS/ items/system/package.
- "GOODS": means all or part of the articles, material, equipment supplies including technical documentation, as described in the Purchase Order, to be supplied by VENDOR.
- "PACKER": Packaging Company to whom VENDOR intends to sub-contract the packing in case they do not have own packing capability/facilities .
- "FREIGHT FORWARDER" : Means the Company responsible for performing freight forwarding activities.

5. General Information

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 2	OF 52

The following requirements are intended as minimum requirements, and compliance to these requirements in no way absolves or relieves VENDOR of any responsibility or obligation outlined in the Purchase Order. In all circumstances, the packing will be designed and constructed in order to support GOODS during transportation as well as to prevent the Goods from damage due to impact, extreme climatic conditions, sun and rain. It must be ensured that the delivery of the GOODS to the jobsite by sea, road or air, in good condition.

GOODS shall be export packed in compliance with the best-established practices for international projects, in accordance with the following instructions. In the event of any conflict between these specified requirement and the established practices, specification requirement shall govern.

Due to climatic conditions and the complex transport operation(s), it is essential that protection and packing is of the highest standard. Packing means to efficiently protect the GOODS during the total transport operation; from the moment they leave the factory until they are delivered to the jobsite, including handling operations (loading/unloading) and storage.

When VENDOR do not have packing capabilities/facilities of their own and therefore intends to sub-contract, VENDOR have to inform BHEL/Purchaser of the name and address of proposed PACKER(s) for approval.

6.0 Criteria for Selection of Packaging

Packages are to be made according to categories, described in articles 8.1 to 8.5, depending on the type of materials, their fragility and size.

These categories have been established for the protection of equipment and material during multi-mode transports, i.e.: combination of overland and sea transport; containerization, air transportation.

In a general manner, the GOODS have to be packed in such a way that crates, bundles, pallets can be stored into General Purpose containers, wherever possible.

If VENDOR has any doubt about the correct method of protection or packing, he should contact BHEL/Purchaser in order to mutually agree on the adequate type of packing to be used.

Materials can be classified in following categories

- Hazardous Material
- Non-Hazardous Material

Further to above categorisation, non-hazardous materials can be sub- categorised for selection of packing.

6.1 Hazardous Materials

Though handling of hazardous material may is not applicable in the scope of this specification. All hazardous material must be packed in adherence to the detailed requirement relating to packing, marking and labelling set out in the most recent report of the Board's Standard Advisory Committee on the Carriage of Dangerous Goods in Ships for sea freight, and the Restricted Articles Regulations, laid down by the International Air Transport Association for airfreight.

6.2 Non-Hazardous GOODS

The scope of this specification is to provide necessary guidelines for packing for power plant equipment, components, Pipings & Valves, Fittings, other structural items, electrical items, spare parts and erection materials. The procedure is defined in subsequent paragraphs in details in clause no. 8.0.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 3	OF 52

7.0 Marking Instructions & Despatch details, Storage Code

7.1 Marking Instructions & despatch details

Packages and crates will be marked with indelible black paint, resistant to seawater. Marking must be perfectly legible.

The shipping marks, which will be as per fig-13, shall be stencilled on two sides and one end in clear characters at least 5 centimetres high (where crate size permits, otherwise use optimum size for each package dimension).

When the GOODS are to be shipped in containers then marking may be stencilled on one end only. However, packages must be stowed in a manner that shows these marks.

Crates containing fragile articles must be packed with special precaution against risk of breakage and must be stencilled on all sides "FRAGILE - HANDLE WITH CARE". Where crates are not to be overturned, VENDOR must show on the crates, clear and readily visible identification as per fig-12, to ensure they are kept in the correct position.

Packages/equipment of 2,000 kg or more must be marked with slinging points on all sides, in addition to the centre of gravity marks.

Number packages consecutively i.e. 1 of 10, 2 of 10, etc. Do not duplicate package numbers. VENDOR is responsible for any loss or damage caused by incorrect marking.

All cases/crates shall also be marked with the appropriate international standard graphic symbols for handling as shown in Fig 12.

As a minimum, all cases/crates are to be marked clearly on all four sides with:

- "HANDLE WITH CARE"
- "RIGHT SIDE UP"
- "KEEP DRY"

In the case of packages with a single gross weight totalling 2,000 kg and/or a height of more than 1m, the centre of gravity shall be clearly marked with the symbol on two adjoining sides. For all items of equipment with an eccentric centre of gravity this symbol shall be marked at the bottom, side and top of the package.

The slinging and lashing points shall be marked with a chain symbol.

When packing in cases/crates, these packages shall also have metal corners at the slinging points. (Fig-11)

External front and rear sides of the boxes to be planed for writing instructions.

Dispatch details such as consigner/consignee address, contract and case details, country of origin, port of delivery, stacking instructions shall be written on one side of the boxes. An anodized aluminum plate as per details and specifications given in fig-13 shall be provided on one side of the boxes.

One copy of packing slip wrapped in polyethylene bag covered with aluminum packing slip holder to be nailed on the external surface of the box. One more copy of the packing slip wrapped in polyethylene bag is to be kept inside the box at the pertinent place.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME	II B
		SECTION	D
		REV. NO. 0	DATE 10/08/2010
		SHEET	4 OF 52

7.2 Storage Code

The type of storage required is required to be specified, it will be shown on each packaging in RED colour.

- X Crates or packages to be stored outdoor without covers
- XX Crates or packages to be stored under tarpaulin
- XXX Crates or packages to be stored in covered or enclosed premises
- XXXX Crates or packages which must be stored in air-conditioned premises

8.0 GUIDELINES FOR PACKING GOODS

8.1 In the subsequent paragraphs details of different types of packings for different types of GOODS are defined. Vendor shall make packing details/procedure based on the guidelines and submit for approval.

8.1.1 Packing for Pipe, Fittings, Flanges and Valves, Structural Steel

Particular attention should be brought to pipe, fittings, flanges, valves and structural steel. Packing categories for piping and fittings will differ according to the diameter and wall thickness of these products. VENDOR shall comply with the following established practice.

IMPORTANT NOTE:

Depending on the project schedule and availability of ocean vessels, the piping and structural steel may be shipped in containers. In this event, VENDOR has to arrange the packages in such a way it allows the stuffing into Open Top in gauge containers.

8.1.2 Pipe

Where practicable, pipe lengths shall be limited to 11.8 meters.

All pipes 2" included and below shall be packed in crates. All pipes to be capped and ends sealed with waterproof tape.

Pipes over 2" up to 6", shall be bundled and banded in bundles of uniform length. Bundling is carried out with U-IRON or traversal planks, joined with threaded connecting rods with locknuts. Quantities and strapping positions depend on the lengths, with a 120 cm spacing to prevent distortion. Bundle weight shall not exceed 2,000 kg. All pipes are to be capped and ends sealed with waterproof tape (tape is not necessary if end caps are of the pre-shrunk or self-sealing type).

Pipes larger than 6" shall be shipped as single lengths with the ends capped. End caps are to be of the recessed type to enable the use of soft faced hooks, but still completely sealing the end and also protecting the weld.

All stainless steel piping must be packed separately in wooden crates. Any banding of bundles is to be with the same material.

8.1.3 Pipe Fittings, Flanges and Valves

All pipe fittings, flanges and valves up to 6", are to be packed in cases/crates. For items over 6", these may be fixed securely to a pallet base and enclosed in a crate, for protection. Where valves have actuators attached, rigidity must be ensured for the valve and actuator. The vulnerable parts of the actuator are to be completely protected within a wooden crate.

All stainless steel fittings, flanges and valves of all sizes, must be packed separately in wooden crates. Any strapping is to be with the same material.

8.1.4 Structural Steel

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME	II B
		SECTION	D
		REV. NO. 0	DATE 10/08/2010
		SHEET	5 OF 52


Structural Steel, reinforcing rods, bars, etc., should be packed in bundles of uniform length. Refer to articles 8.1.2, for strapping requirements. Bundle weight not normally to exceed 2,000 kg. Fabricated structures and structural steelwork, etc, should be bundled and packed using wooden beams and long bolting to secure the load.

8.2 Bundling – Packing Category I


8.2.1 Type of Equipment

Equipment which is not subject to damage by corrosion or mechanical effect, i.e. pipes, piping, structural steel.

Packing category I

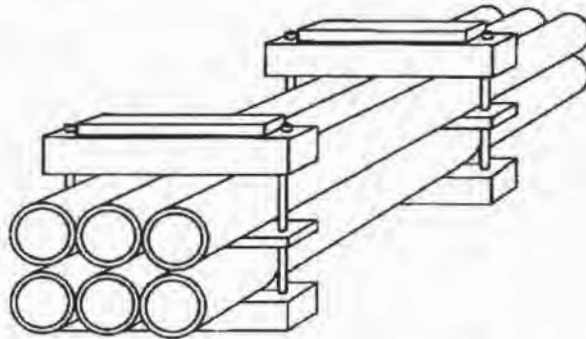

Bundling by U-shaped iron – packing category I A

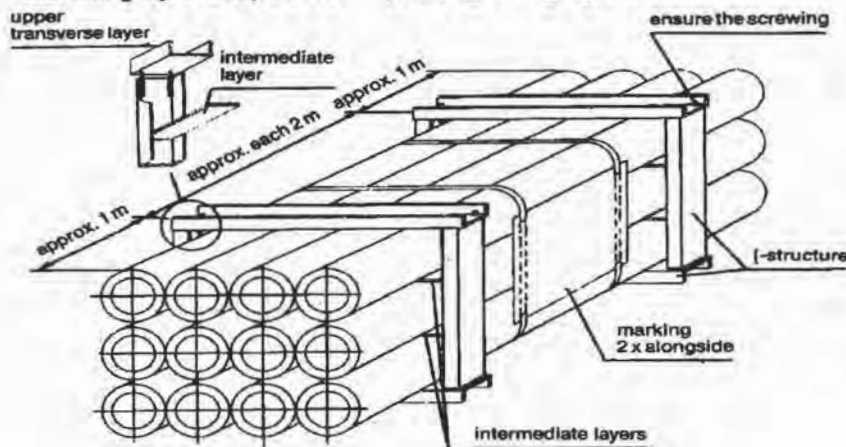

8.2.2 Type of Construction

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 6	OF 52

- Bundling has to be effected
- By squared timber and threaded rods.
- With an intermediate layer (threaded on tightening bolts) according to the weight of the package.
- Wedge-shaped timbers must be added at the outer points of lower layer.
- Between the bolts a spacer must be nailed.
- The bolts must be secured (e.g. by locking nut).
- If single parts could protrude, an appropriate protection must be installed (flat iron or plates).
- Bundling with steel straps or PVC straps is not accepted.

8.3 Skids, Square Timber Constructions, Casings – Packing (Category II)


8.3.1 Type of Equipment

Voluminous apparatus, tanks and/or heavy pieces those are not vulnerable to mechanical or corrosive effects.

8.3.2 Type of Construction

- The construction skid can be made of wood or of metal.
- The fastening of the packages on the skid will be made by steel straps (flat iron) which have to be elastically lined, non-slip and securely bolted onto the skids.
- Flange openings have to be closed with gaskets and blind flanges or, if necessary, provided with cover.
- Skid constructions may not be less than the dimensions of the package in length or in width.
- Tanks and apparatus with their own support cradles must be supplied with an anti-slip lining.

PACKING CATEGORY-II

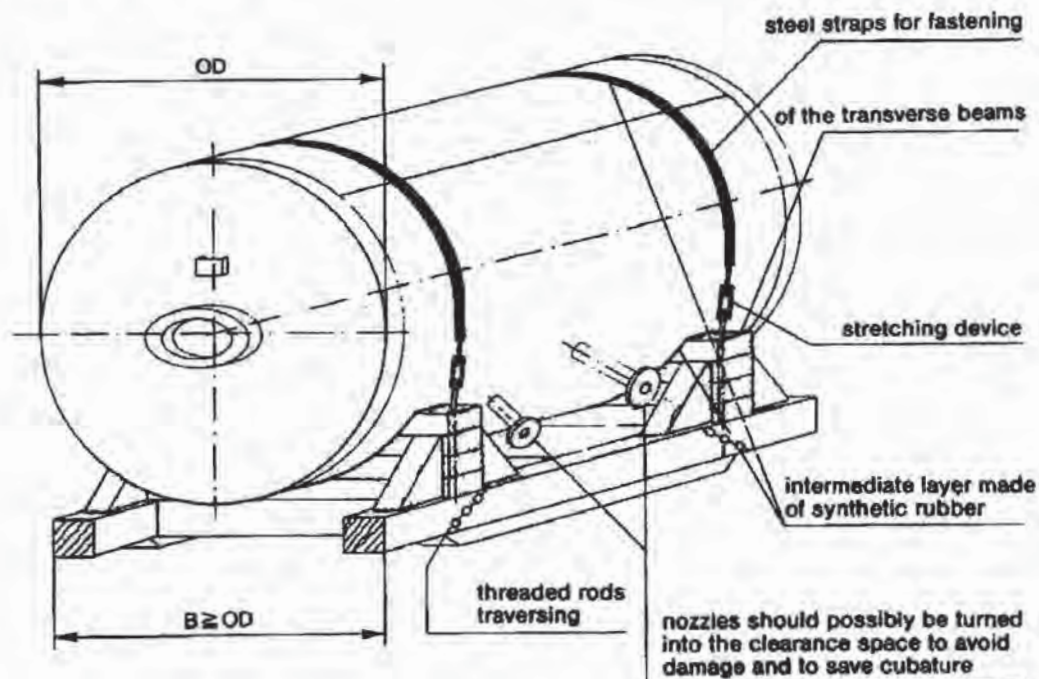

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 7	OF 52

8.4 Packing of GOODS in Wooden Crates/Cases/Boxes

The construction of wooden crate/cases/boxes shall be as per the details indicated in clause 9.0 & Fig 1 to 11. Details indicated in the sketches for different categories Packing crates/boxes are only for a typical equipment considered for illustration.

8.4.1 Packing Category III

8.4.1.1 Type of Equipment


Fabricated equipment, which cannot be transported on cradles; frame-works, prefabricated piping and fittings, mechanical and electrical assemblies. *This type of packing is recommended where many parts of the equipment/component/assembly are not protruding out.*

8.4.1.2 Type of Construction

The equipment must be safely fastened to the bottom with bolts, possibly by the runners or to be spread in such a manner that no protruding parts are possible. For parts, sensitive to rainwater and/or debris, a protection has to be made by a foil cap.

If it is possible that single part could protrude through the front/back side wall, they shall be closed completely. The marking of the package shall be done on plywood plates at the prescribed sides.

Packing Category III

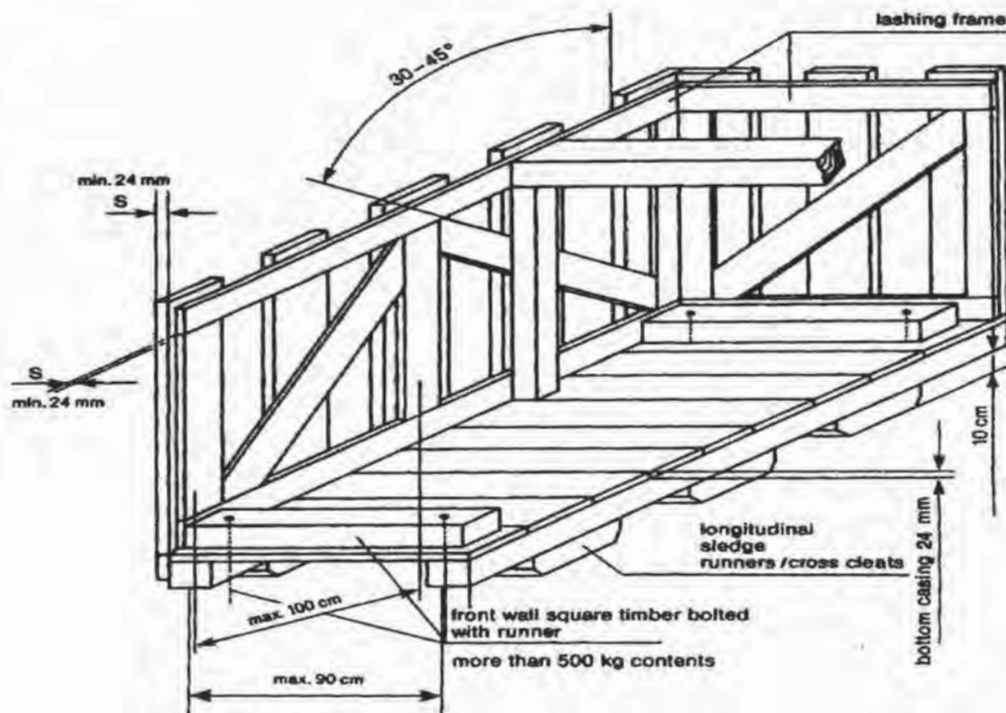

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 8	OF 52

8.4.2 Cases with Lining – Packing Category IV


8.4.2.1 Type of Equipment

Recommended for equipment and mechanical parts Equipment sensitive to mechanical damage or parts and components that are particularly at risk of theft or loss; pumps, elbows, flanges, fittings, tools, erection materials, etc.

8.4.2.2 Type of Construction

The same type of construction as article 8.4.1.2, but with all sides completely boarded without space between the boards. Sides to be provided with waterproof lining; fabric-reinforced waterproof tar paper or polyethylene-foils resistant to ultraviolet rays can be used. Polyethylene-foil shall be fixed under the lid cover to avoid penetration of water. At weights of more than 500 kg the longitudinal runner must be bolted to the front all square timber. For ventilation inside the case, an opening in the waterproof lining must be placed between the diagonal battens and diagonal joists.


Packing Category IV

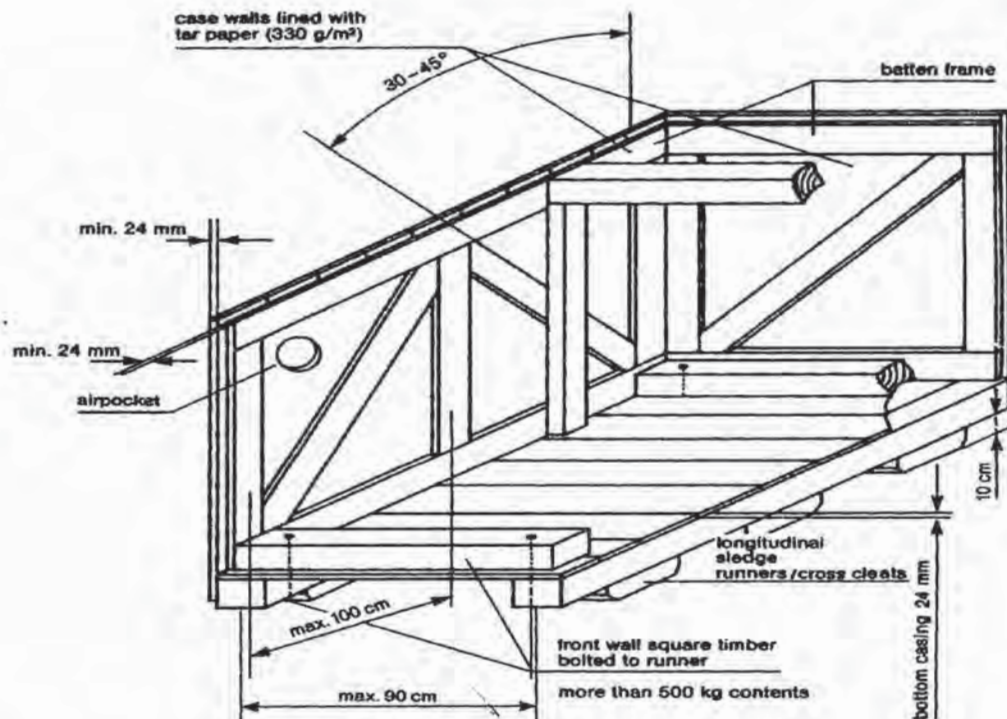

8.4.3 Cases with Alternative Surface Materials

8.4.3.1 Plywood Box – Packing Category IV A

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 9	OF 52

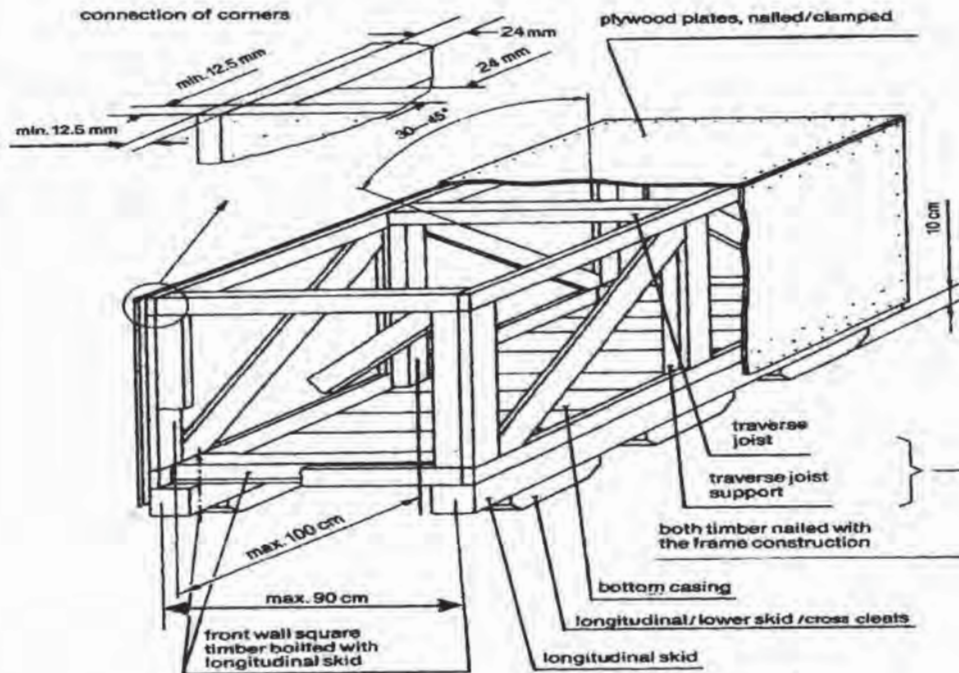

Case constructed of 5 layers of watertight, glued plywood with a total thickness of 12.5 mm. The frame must be constructed from minimum 24 mm timber or as per guide lines given above against clause 8.0, Fig 1 to 11 and must be suitable for the weight and nature of the parts to be packed. Planed square timber must be bolted with longitudinal skid and covered with diagonal joists. If applicable, construction of the cover and sides is to include diagonal bracing. Covers consisting of several layers of plywood are to be sealed with durable elastic putty or additional water-resistant sheets to be fixed.

8.4.4 Case with Barrier Material – Polyethylene Foil – Packing Category V

8.4.4.1 Type of Equipment

Sensitive equipment, simple electrical equipment, insulation materials, fire-resistant materials, with non-corrosion- guarantee for a period up to twelve (12) months.

8.4.4.2 Type of Construction

Preservation by welding in polyethylene-foil with addition of desiccants and if necessary, application of non-corrosive contact agents, otherwise, type of construction as indicated in article 8.4.2.2.

Additional marking:

- Case with desiccants.

8.4.5 Case with Barrier Material – Aluminium Compound Foil – Packing Category VI

8.4.5.1 Type of Equipment

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 10	OF 52

Electrical equipment such as, switchboards, electric motors, sensitive equipment, with non-corrosion guarantee, for a period up to twelve (12) months.


8.4.5.2 Type of Construction

Type of construction as indicated in article 8.4.2.2. Preservation by sealing an aluminium compound foil, with the addition of desiccants. Humidity indicators, if required and installed in the barrier wrapping, shall allow easy control from the outside.

Additional marking:

• Case with desiccants.

Packing Category V/VI

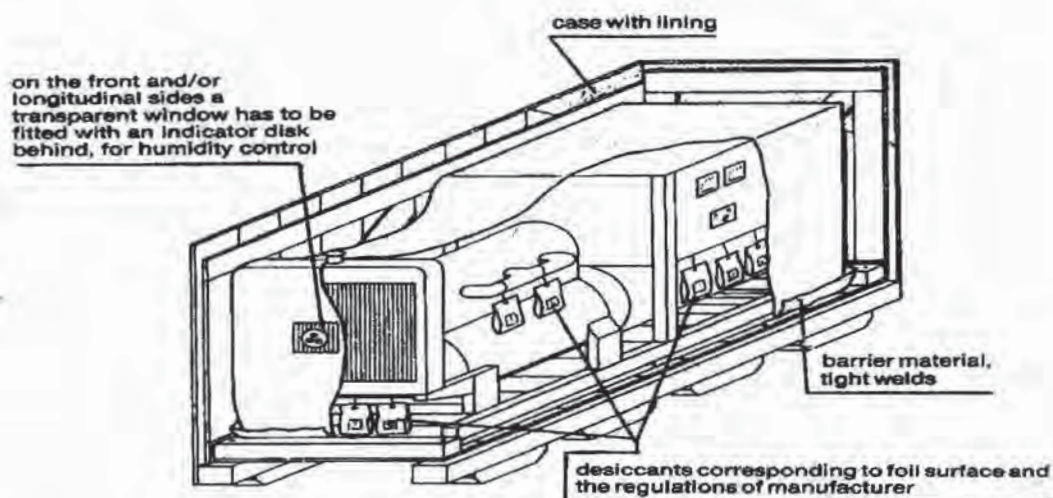

8.4.6 Double Case – Packing Category VII

8.4.6.1 Type of Equipment

GOODS which are of high sensitivity to shock, impact and vibration, for instance, special electrical equipment like computers, switchboards, laboratory instruments

8.4.6.2 Type of Construction

Case construction as indicated in article 8.4.2.2, with additional floating inner packing (case-in-case principle), padding corresponding to weight and sensitiveness. Preservation by sealing in aluminium compound foil with the addition of desiccants. The inner case has to be made of plywood or equivalent material with a thickness of 8-12 mm, depending on the weight of the GOODS to be packed. The inner buckles and/or frame borders have to be dimensioned so that the full stability of the inside case will be reached and no twisting is possible. The inner sides of the inside case will be lined with bituminous kraft paper on all sides (except bottom).

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 11	OF 52

8.4.7 Cable Drum – Packing Category VIII

8.4.7.1 Type of Equipment

All type of cables, wires, ropes, hoses.

8.4.7.2 Type of Construction

For all type of cables refer clause no. 11.1. For other items (wires, ropes, hoses) new or practically new drums are to be used. Planking of the e drums by use of boards, thickness minimum 20 mm, with additional double steel strapping, nailed, and carefully preserved/ protected cable ends prior to packing.

8.4.8 Hazardous Materials – Packing Category IX

8.4.8.1 Type of Equipment

Hazardous materials according to the law are explosives, compressed gases, liquefied gases dissolved under pressure or deeply refrigerated, flammable liquids, flammable solids; substances liable to spontaneous combustion; substances which, on contact with water, emit flammable gases, oxidizing substances, organic peroxides, poisonous (toxic) and infectious substances; radioactive materials, corrosives, miscellaneous dangerous goods.

8.4.8.2 Type of Construction

Hazardous materials shall always be packed and documented separately from any other material. Selection of packaging materials, execution of packing and marking as well as documentation shall always be in compliance with the applicable laws and regulations. Any certificates required for transportation or for authorities to be supplied before shipment of the GOODS.

8.4.9 Wooden Floor as a Transport Support – Packing Category X

8.4.9.1 Type of Equipment

Any materials to be stuffed in containers or on flat racks and that are not stowed on standard pallets or otherwise suitably packed

8.4.9.2 Type of Construction

- Longitudinal internal square timbers bolted to the front wall runners, longitudinal skid.
- Maximum distance between longitudinal runners 90 cm (middle to middle of the runner).
- Full boarding of the floor.
- Attaching of lifting lugs and/or iron ropes for lifting/pulling the units off the transport equipment.
- If applicable, preservation of the equipment by sealing in polyethylene-foil or aluminium compound foil and the addition of desiccants.

8.5 Air Transport Packing

8.5.1 General

Certain types of material may have to be shipped by air from their country of origin. This means of transport will be exceptional, and will be used only:

- For GOODS, which are highly sensitive to shock or vibrations, such as computers, electronic instruments, or those of small dimensions and weight.
- For GOODS urgently required at the module yard(s) and/or jobsite.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME	II B
		SECTION	D
		REV. NO. 0	DATE 10/08/2010
		SHEET	12 OF 52

8.5.2 Type of Packing

Depending on the goods to be packed, VENDOR may use one of the following types:

- A triple-corrugated cardboard container made with waterproofed glue and a barrier layer of polyethylene on the outsides to keep out humidity.
- Wooden/cardboard packing cases: the wood being used for the framework and base of the cases, waterproofed triple-corrugated cardboard being used for the sides and top. These cases are of the "Bell" type, and used for material of small or medium dimensions.
- For larger dimensions, plywood cases are acceptable. The timber characteristics, cross-sections and thickness will be systematically determined by the nature of the loads to be packed.

8.5.3 Dimensions

In order to optimize the existing transport facilities (passenger or cargo aircraft), the dimensions of:

- Triple-corrugated containers.
 - Wooden/cardboard packing cases.
 - Plywood cases.
- Are to be adapted to pallets used for air transportation.

9.0 Detailed specification for Wooden Crates/Boxes/Cases and other packing materials

9.1 Technical specification for wood

The wood shall be Fir, Chir, Silver Oak (Gravillea Robusta), chemically treated mango and Pinewood with moisture content not exceeding 50%. The wood shall have flexural and compressive strength, stiffness, shock absorption and nail retention properties. The wood shall be free from common defects such as warp, bone, twist, knot, cracks, splits, end splits, bend, visible sign of infection and any kind of decay caused by insects or fungus, etc. Surface cracks with maximum depth of 3mm are permissible. A continuous crack of any depth all along the length is not allowed.

9.2 Chemical Treatment of Wood:

The wood shall be chemically treated to provide protection against deterioration due to fungi and attack by termites, borers, marine organism and any other kind of infection. It shall be treated only after final processing like cutting, planning, joint grooving, etc.

9.3 TYPE, DESIGN & DIMENSION OF WOODEN PACKING CASES:

9.3.1 PACKING OF EQUIPMENTS

Various mechanical, electrical and C&I equipment e.g. Pumps, motors, equipment skids, heat exchangers, control panels, switch gears, transformers, etc. shall be wrapped in weather proof packing and then secured in wooden packing cases. The construction of wooden packing cases/crates shall be as per details given below and also given in figure 1 to 11.

9.3.1.1 Bottom Frame

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 13	OF 52

The construction of bottom frame shall be as per Fig-2. The No. of slides/runners for bottom frames shall be selected depending upon the weight and overall dimensions of the load to be carried. The equipment shall be secured by fixing their base frame/plate with the help of bolt and nuts etc. to bottom frame of the wooden packing cases/crates. The equipment not provided with base frame/plate like cylindrical vessels, etc to be secured to the bottom frame of the wooden cases with "C" clamps fabricated from steel channels/ angle iron.

9.3.1.2 TOP FRAME

The construction of top frame shall be as per fig-3.

9.3.1.3 END PANELS

The dimension of the end and lateral panels shall be calculated according to overall dimensions of the items to be packed. Diagonal braces shall be used for packing cases having height exceeding 500mm. Details of bracings shall be as per fig 5 to 9.

9.3.1.4 Sling Plate

To facilitate lifting of cases, longitudinal under slide boards shall be fixed. To avoid damage to the box while lifting sling plates shall be provided. Refer fig-11.

9.3.1.5 Angle Iron Cleats

Angle iron cleats shall be used for strengthening the joints as indicated in fig-10

9.3.1.6 Other Requirements


- The thickness of planks for top, bottom, side and end panels shall be at least 25mm. Planks used for this purpose shall be joined with each other by tongue and groove joint. The groove dimension shall be such that tongue fits tightly into groove to make the joint.
- Runners/slides, traverse bars, etc shall be of single length i.e. without any joint. Planks for sheathing, diagonal bracing etc shall also be of single length up to 2400mm, proper jointing is permitted for planks for sheathing and diagonal bracings.
- Each equipment to be individually covered with double polyethylene petticoat. Sheet thickness of polythene sheet shall not be less than 0.175 mm (175 microns). The sealing shall be such so as not to allow moisture inside.
- The inner surface of 4 sides of shooks shall be nailed with bituminized water proof craft paper. Wherever 2 pieces of kraft paper are used, joint shall have an overlap of minimum 20 mm.
- All the inner sides of the box shall be nailed with bitumen coated HESSIAN POLYTHYLENE KRAFT PAPER. For top frame it shall project on all sides by 100mm and shall be nailed on sides. Wherever 2 pieces of kraft paper are used, joint shall have an overlap of minimum 20 mm.
- For delicate equipment like control panels and switchgears, lighting panels and lighting transformers, suitable cushioning material like rubberised coir (min. 50 mm thick and 100 mm wide) shall be provided on their bottom support and the gap between the panel and casing

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 14	OF 52

shall be filled with rubberized coir with distance between consecutive supports less than 500 mm (ref fig15). For other equipment suitable support from sides of the casing shall be provided.

- Switchgear cubicles, control panels and control desks shall be packed and shipped in separate convenient sections. The components e.g. circuit breakers relays and instruments etc. which are removed from panels for shipping purpose and shall be separately packed and shipped as per packing instructions in clause 10.4.
- Packing case for control panels and switchgear panels shall be finally covered with GI sheet of minimum thickness of 0.4mm.
- Packing cases shall be bound at edges by nailing MS clamps/brackets at sufficient intervals. Further heavier boxes shall be strapped with C clamps (ref fig-4) fabricated from steel channels/angles and lighter boxes shall be strapped with hoop iron strips.
- Silica gel is used for this purpose to protect contents over sufficiently long time from corrosion. Silica gel shall be indicating type confirming to IS-304 (1979) packed in cotton bags placed at different positions inside the packing for absorbing moisture and shall not come into directly contact with equipment/material inside the package. The quantity of silica gel shall be adequate for storage period of one year, however it shall not be less than 4 gm. per ltr. Volume of case subject to minimum 400 gm. Per case.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 15	OF 52

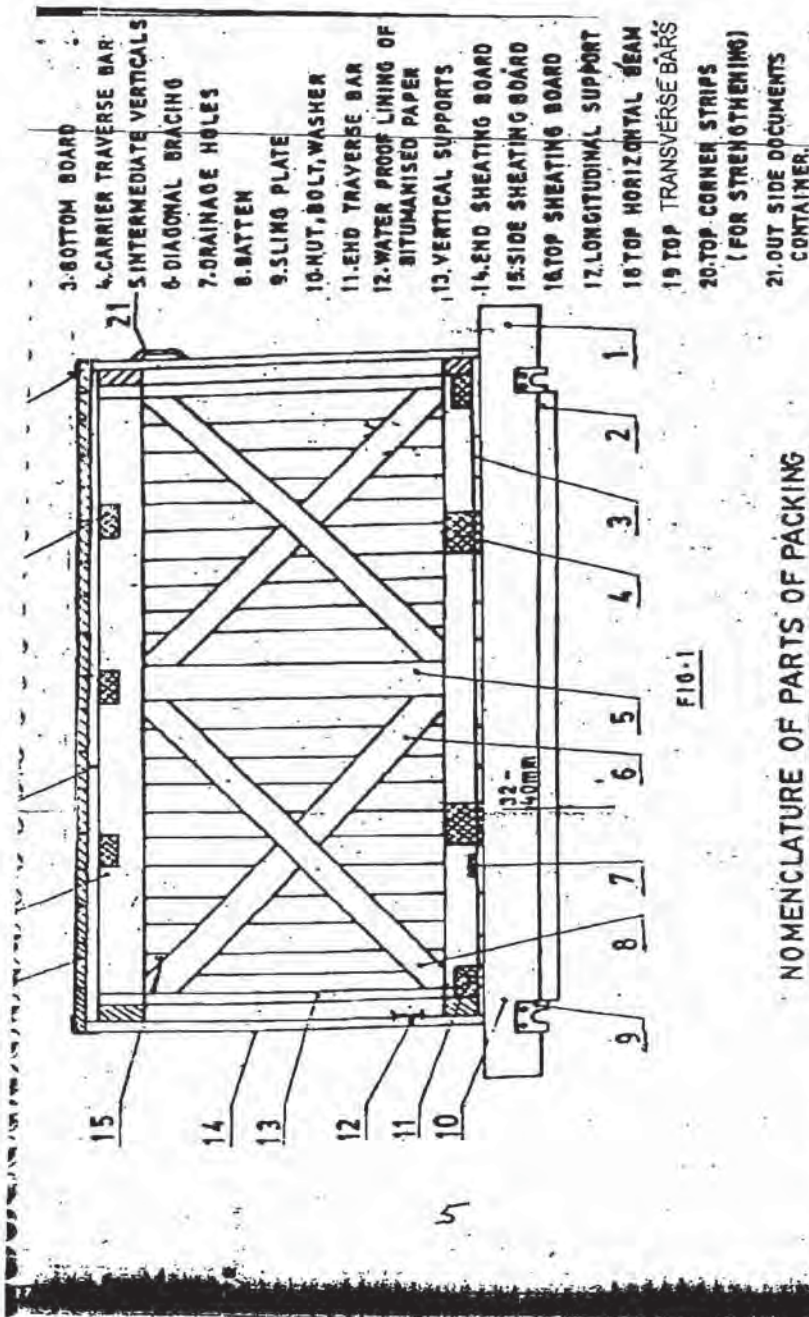

EC 009

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 16	OF 52

BOTTOM FRAME ARRANGEMENTS

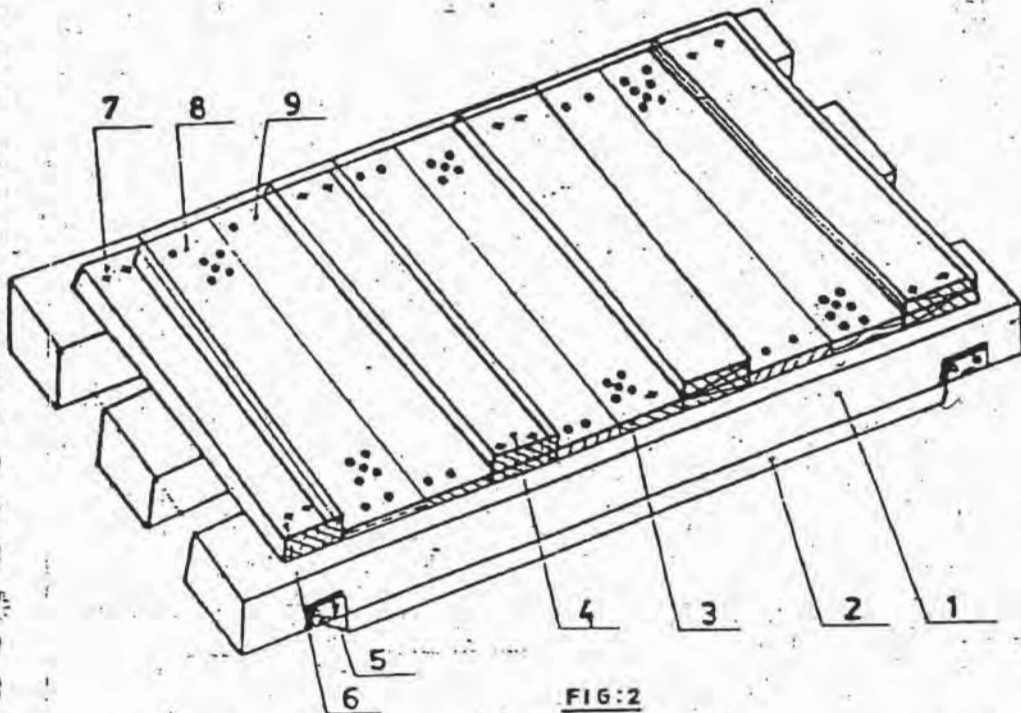


FIG:2


Nos. of slides: Minimum 2 Nos.
 For length more than 1800 mm or
 load more than 1000kg, nos. of
 slides shall be minimum 3 Nos.
 For dimensions of slides, refer Table 1
 Cross section of end traverse bar; 100x100 mm.
 (minimum)

1. SLIDE
2. UNDER SLIDE BOARD
3. BOTTOM BOARD
4. CARRIER TRAVERSE BAR
5. SLING PLATE
6. TRAVERSE BAR
7. BOLT, NUT & WASHER
8. DRAINAGE HOLES
9. NAILS



027

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 17	OF 52

TOP FRAME ARRANGEMENT

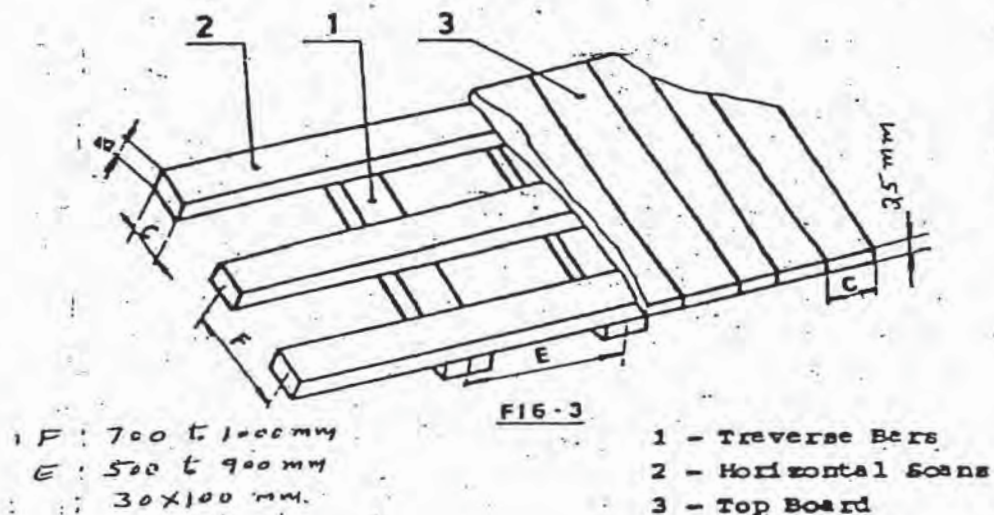

ARRANGEMENT OF C-CLAMPS AROUND CASES

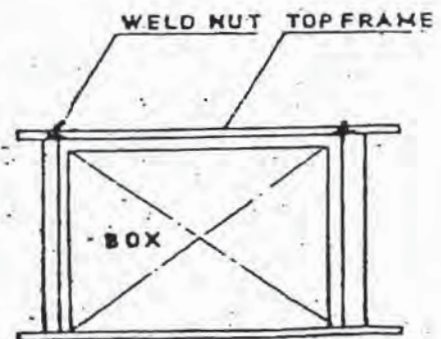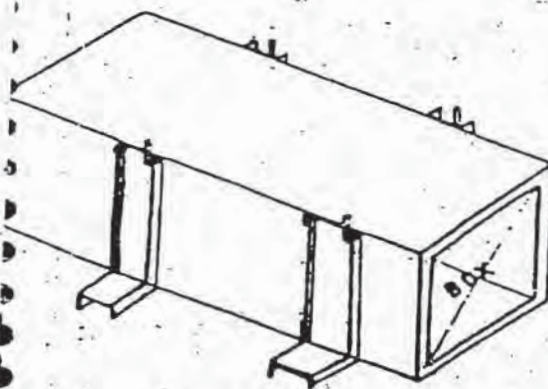

628

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 18	OF 52

ARRANGEMENT OF DIAGONAL BRACING AND HORIZONTAL SUPPORT

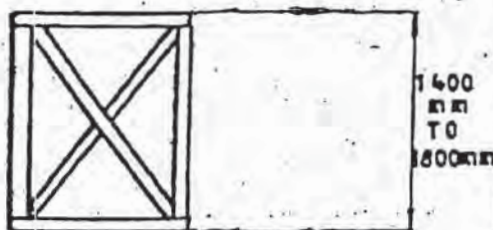


FIG: 6

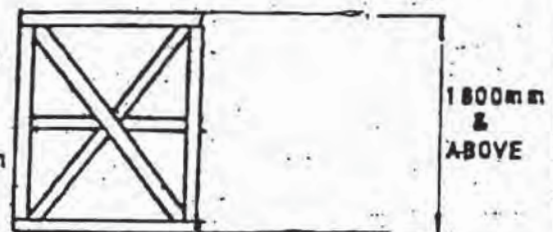


FIG: 8

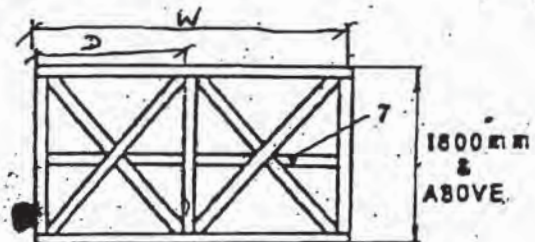


FIG: 9

7- Middle Horizontal Support

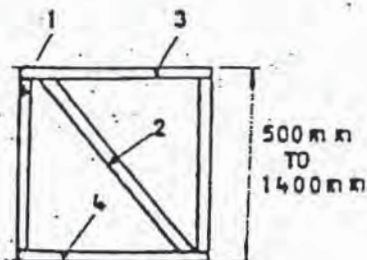


FIG: 5

1- Vertical Support

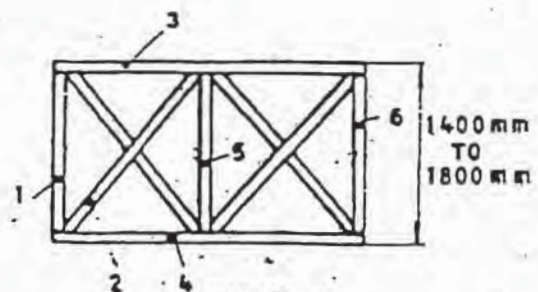



FIG: 7

1, 5, 6 - Vertical Support

029


	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 19	OF 52

ARRANGEMENT OF PACKING CASE

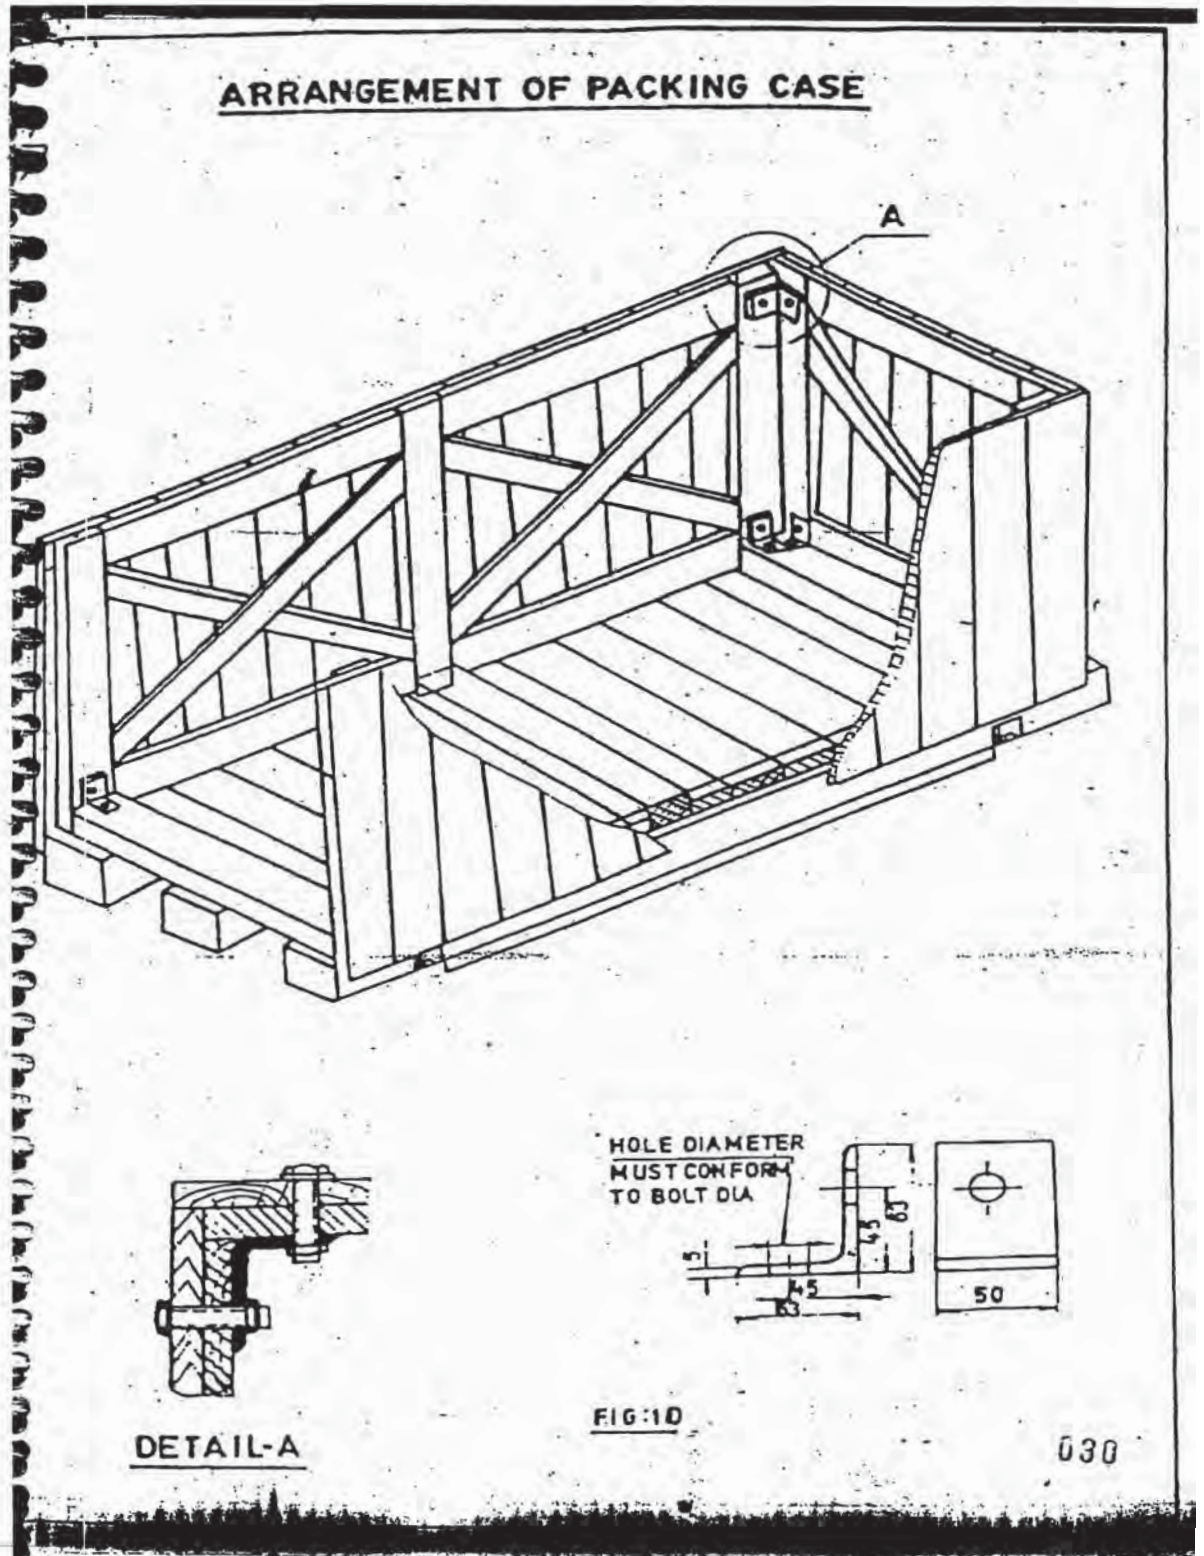

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 20	OF 52

**ARRANGEMENT OF SLING & PLATE ON
CASES**

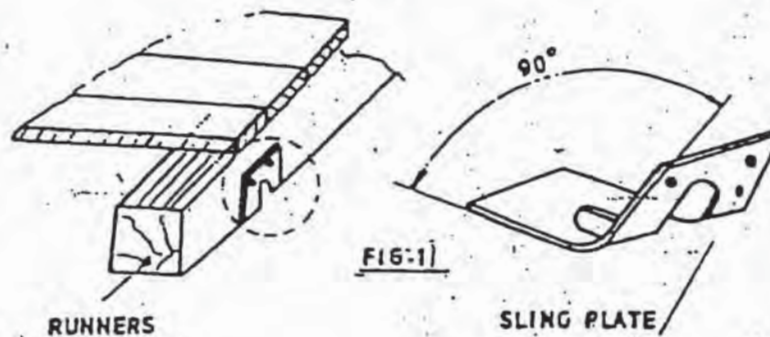

12866/2020/PS-PEM-MAX

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 21	OF 52

TABLE-1

LOADS	LENGTHS OF SLIDES						
	600	800	1000	1200	1300	1500	2000
	Cross section b x c				 b		
500	50 X 100	50 X 100	50 X 100	50 X 100	75 X 100	75 X 100	100 X 100
800	50 X 100	50 X 100	75 X 100	75 X 100	75 X 100	75 X 100	100 X 100
1000	75 X 100	75 X 100	75 X 100	100 X 100	100 X 100	100 X 110	100 X 150
1500	75 X 100	75 X 100	100 X 100	100 X 100	100 X 100	100 X 150	100 X 150
2000	75 X 100	100 X 100	100 X 100	100 X 150	100 X 150	100 X 150	150 X 150
2500	75 X 100	100 X 100	100 X 150	100 X 150	100 X 150	150 X 150	150 X 150
3000	100 X 100	100 X 150	150 X 150	150 X 150	150 X 150	150 X 150	150 X 150

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 22	OF 52

Table-2

End and side panels	Width of the panel "W"	Distance between longitudinal support (Dimension "D")						
		600	800	1000	1200	1400	1600	1800
		Cross section b x c				Item 1 to 7		
Fig- 5 to Fig-9	600 to 1200	30	30	30	30	30	30	30
		X	X	X	X	X	X	X
	1201 to 1600	100	100	100	130	130	130	130
		30	30	30	30	30	30	30
	1601 to 2000	X	X	X	X	X	X	X
		130	130	130	130	130	130	130
	2001 to 3000	30	30	30	30	30	30	30
		X	X	X	X	X	X	X
	3001 to 4000	130	130	130	130	130	130	150
		40	40	40	40	40	40	40
		X	X	X	X	X	X	X
		150	150	150	150	150	150	150

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 23	OF 52

INDICATION MARKS ON CASES/BOXES/CRATES

Designation	Symbol	Explanation
Fragile, Handle with care		The symbol should be applied to easily broken cargoes. Cargoes marked with this symbol should be handled carefully and should never be tipped over or slung.
Use no hooks		Any other kind of point load should also be avoided with cargoes marked with this symbol. The symbol does not automatically prohibit the use of the plate hooks used for handling bagged cargo.
Top		The package must always be transported, handled and stored in such a way that the arrows always point upwards. Rolling, swinging, severe tipping or tumbling or other such handling must be avoided.
Keep away from heat (solar radiation)		Compliance with the symbol is best achieved if the cargo is kept under the coolest possible conditions. In any event, it must be kept away from additional sources of heat. It may be appropriate to enquire whether prevailing or anticipated temperatures may be harmful.
Protect from heat and radioactive sources		Stowage as for the preceding symbol. The cargo must additionally be protected from radioactivity.
Sling here		The symbol indicates merely where the cargo should be slung, but not the method of lifting. If the symbols are applied equidistant from the middle or center of gravity, the package will hang level if the slings are of identical length. If this is not the case, the slinging equipment must be shortened on one side.
Keep dry		Cargo bearing this symbol must be protected from excessive humidity and must accordingly be stored under cover. If particularly large or bulky packages cannot be stored in warehouses or sheds, they must be carefully covered with tarpaulins.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 24	OF 52

Center of gravity		This symbol is intended to provide a clear indication of the position of the center of gravity. To be meaningful, this symbol should only be used where the center of gravity is not central. The meaning is unambiguous if the symbol is applied onto two upright surfaces at right angles to each other.
No hand truck here		The absence of this symbol on packages amounts to permission to use a hand truck on them.
Stacking limitation		The maximum stacking load must be stated as "... kg max.". Since such marking is sensible only on packages with little loading capacity, cargo bearing this symbol should be stowed in the uppermost layer.
Clamp here		Stating that the package may be clamped at the indicated point is logically equivalent to a prohibition of clamping anywhere else.
Temperature limitations		According to regulations, the symbol should either be provided with the suffix "...°C" for a specific temperature or, in the case of a temperature range, with an upper ("...°C max.") and lower ("...°C min.") temperature limit. The corresponding temperatures or temperature limits should also be noted on the consignment note.
Do not use forklift truck here		This symbol should only be applied to the sides where the forklift truck cannot be used. Absence of the symbol on other sides of the package amounts to permission to use forklift trucks on these sides.
Electrostatic sensitive device		Contact with packages bearing this symbol should be avoided at low levels of relative humidity, especially if insulating footwear is being worn or the ground/floor is nonconductive. Low levels of relative humidity must in particular be expected on hot, dry summer days and very cold winter days.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 25	OF 52

Do not destroy barrier		A barrier layer which is (virtually) impermeable to water vapor and contains desiccants for corrosion protection is located beneath the outer packaging. This protection will be ineffective if the barrier layer is damaged. Since the symbol has not yet been approved by the ISO, puncturing of the outer shell must in particular be avoided for any packages bearing the words "Packed with desiccants".
Tear off here		This symbol is intended only for the receiver.

FIG-12

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 26	OF 52

BHEL-PEM-DELHI-INDIA	
CONSIGNEE	
MATERIAL	
CUSTOMER REF.	MO. NO.
DISPATCH ADVISE NOTE NO.	CASE NO.
DIMENSIONS(MM) LXBXH	NET WT -KGS GROSS WT -KGS
SPECIAL INSTRUCTIONS	HANDLE WITH CARE -- KEEP DRY DO NOT DROP -- DO NOT TILT

FIG-13: MARKING PLATE

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 27	OF 52

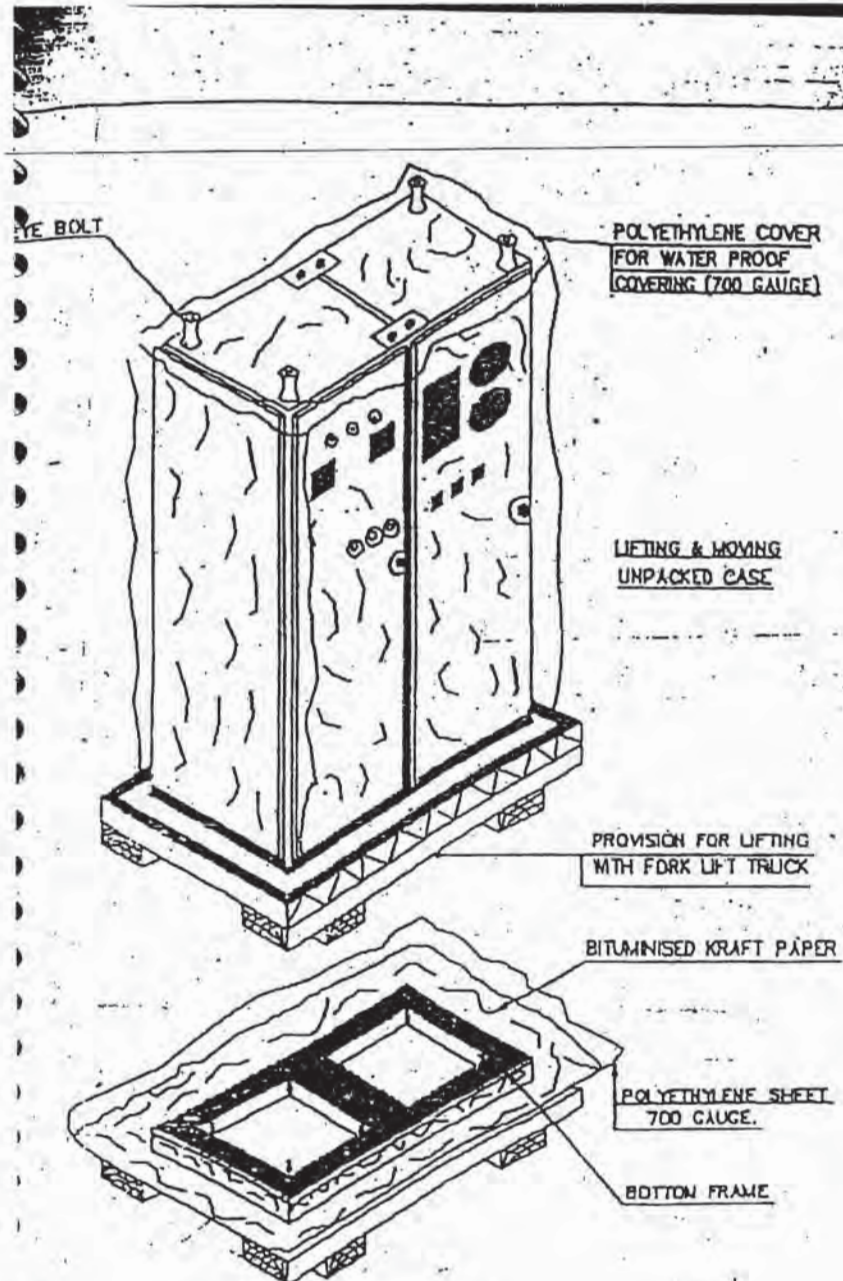


FIGURE-14

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 28	OF 52

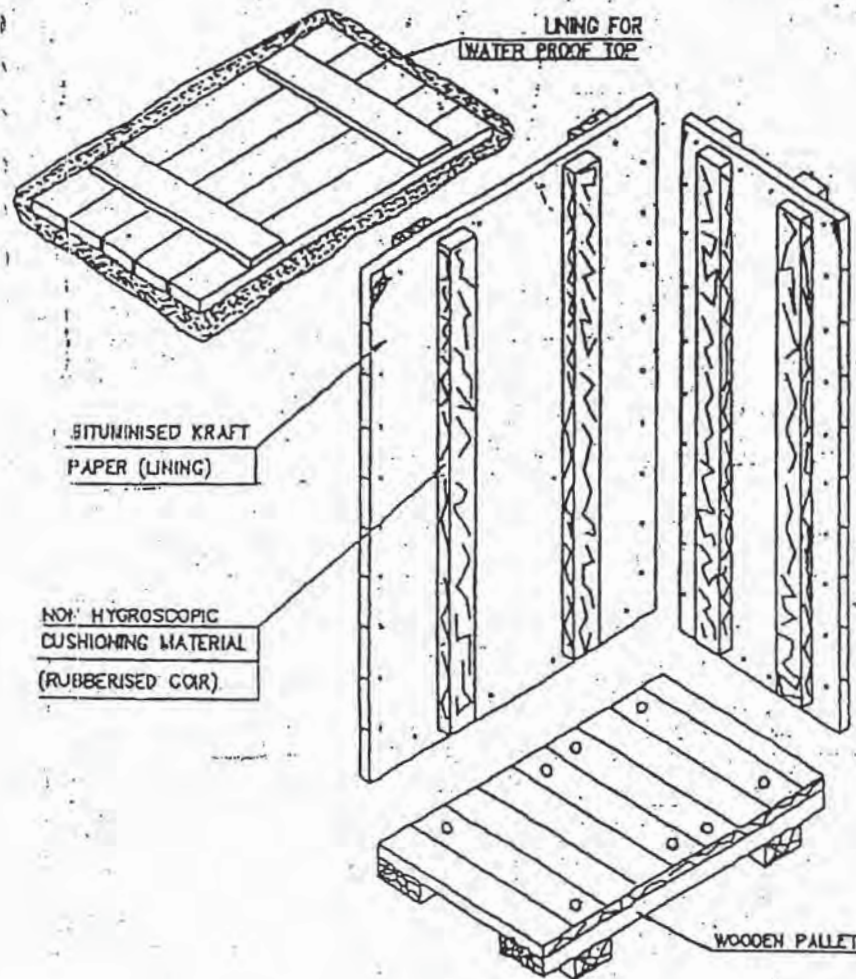
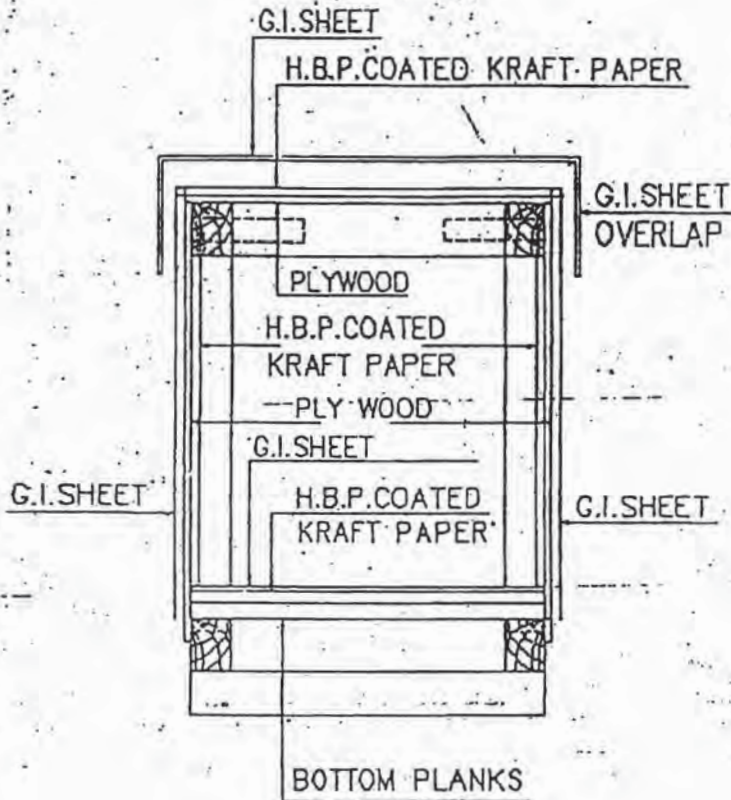


FIGURE-15

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 29	OF 52



**FIG-16 : CLOSED PACKING CASE WITH G.I.SHEET
SHOWING LAYERS OF PACKING MATERIALS.**

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001
		VOLUME II B
		SECTION D
		REV. NO. 0 DATE 10/08/2010
		SHEET 30 OF 52

10.0 TYPICAL PACKING DETAILS/PROCEDURE FOR MECHANICAL ITEMS

10.1 INSULATION MATERIAL (MINERAL WOOL MATTRESSES)

This specification covers the requirements of seaworthy packing and marking for bonded mineral (rock) wool mattresses having metallic hexagonal wire netting as facing on one or both sides.

10.1.1 TYPE OF CONSTRUCTION

Mattress shall be packed in Polythene (of 0.2 mm thickness) all around and sealed to prevent moisture absorption during transit and storage. Further it shall be wrapped with Bitumen coated Polythene bonded/lined Hessian and stitched and then packed in 5 ply DFC carton box.

Silica gel is used for this purpose to protect contents over sufficiently long time from corrosion. Silica gel shall be of indicating type conforming to IS:304-1979 packed in cotton bags placed at different positions inside the packing for absorbing moisture and shall not come into direct contact with the material inside the package. The quantity of silica gel shall be enough for storage period of one year. However, it shall not be less than 4 gms per litre volume of case subject to minimum of 400 gms per case.

Each mattress as well as the packages shall be serial numbered. Also, printed sheets indicating the nominal thickness, density and wire netting details (i.e. material and size) shall be placed below the wire netting.

Following details shall be legibly written on the packages. The details shall also be typed on a sheet of paper & kept in a sealed Polythene cover, inside the packages

- Project Name
- Purchase Order No.
- Sl. No. of package
- Size of mattress (Thickness x Length x Width)
- Density
- Wire netting material and size
- Weight of the package

10.2 INSULATION MATERIAL (ALUMINIUM COIL)

Heavy Gauge Aluminium Coil Packaging are done by Eye-to-Sky packaging or by Eye to eye packaging as per the proven practice being followed by manufacturer of Aluminium sheets.

10.2.1 Type of construction for Eye to Sky packaging

- Strapping of coil with polyester strap around circumference at one place.
- Putting paper I. D. Edge protector.
- Wrapping the coil with VCI stretch film after putting silica gel bags (4 nos.) Inside the coil.
- Wrapping the coil with HDPE film.
- Covering the coil including its build up & bore with masonite / particle board.
- Putting metallic I. D on coil.
- Putting O.D edge protector (paper) on coil.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 31	OF 52

- h. Putting circumferential polyester strap (3 nos.) & eye polyester strap (4 nos.).
- i. After placing the coil on coil tilter ply wood (10mm thick) of suitable size along with wooden pallet is to be put at the bottom side of the coil.
- j. Coil is to be tilted to eye-to-sky position.
- k. Final strapping with metallic strap to unit coil and skid at 2 places with top cover of plywood.
- l. Fixing the coil with wooden blocks at 4 corners.
- m. Labeling 2 nos.(one metallic & one adhesivetype) For specification, net wt. & gross wt.

10.2.2 Type of construction for Eye to Eye packaging

- a. Strapping of coil with polyester strap around circumference at one place.
 - b. Putting paper I. D. Edge protector.
 - c. Wrapping the coil with VCI stretch film after putting silica gel bags (4 nos.) inside the coil.
 - d. Wrapping the coil with HDPE film.
 - e. Covering the coil including its build up & bore with masonite / particle board.
 - f. Putting metallic I. D on coil.
 - g. Putting O.D edge protector (paper) on coil.
 - h. Putting circumferential polyester strap (3 nos.) & eye polyester strap (4 nos.).
 - i. Placing of coil on wooden skid Coil is to be tilted to eye-to-sky position.
 - j. Final strapping of coil and skid at 2 places with steel strap. Fixing the coil with wooden blocks at 4 corners.
- Labeling 2 nos.(one metallic & one adhesive type) For specification net wt. & gross wt.

10.3 Packing Procedure for Online Tube Cleaning System and accessories

This procedure is applicable for the shipment of Onload Tube Cleaning System and accessories by sea.

10.3.1 Packing details:

- The Packing case shall be made of treated rubber wood. The design of the case shall be as per Annexure IIIA & IIIB.
- The Equipments shall be placed on the wooden base of the Packing case and fastened if required to arrest the movement of the same.
- Equipment shall be covered by Polythene sheet and inside wall surfaces of the wooden cases also shall be covered by polythene sheet.
- All Nozzles shall be closed with plywood dummies.
- All electrical components assembled or loose shall be covered with polythene sheets along with silica gel pack.
- Silica gel desiccants shall be kept inside each case in sufficient quantities in order to absorb the moisture.


	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 32	OF 52

- Thermocol packing shall be made for glass items like Ball vessel sight glass, Vpiece
- sight glass & pressure gauge.
- Silica gel desiccants shall be kept inside of each case to absorb the moisture.
- A Packing list covered in a polythene envelope shall be fixed inside and outside of each packing case.
- Shipping marks and consignee address shall be painted on the outer surface of the case.
- All handling instruction required for the case like top, sling, rain, handle with care etc, shall be marked on the case as per the symbol attached.
- Machined surface will be applied with Anti rust oil and covered by polyurethane sheet to protect from external oxidation.
- All valves will be closed with dummies to protect the internals and placed in the wooden case which will covered by polyurethane sheet.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 33	OF 52


This Type of case to be used for following items:

1. BALL SEPARATOR
2. BALL COLLECTOR SKID

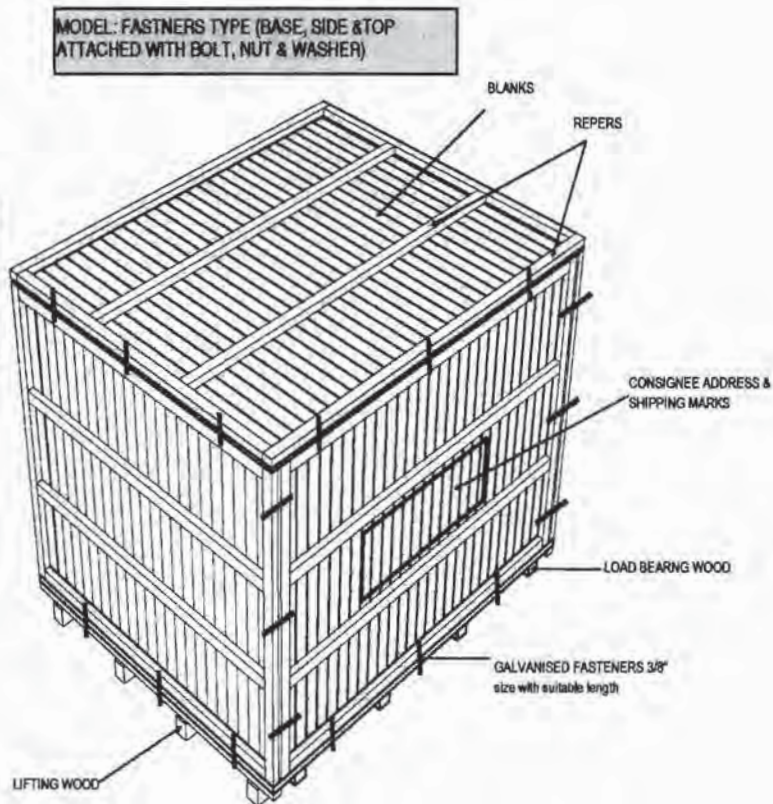

SHEET 05 of 10

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 34	OF 52

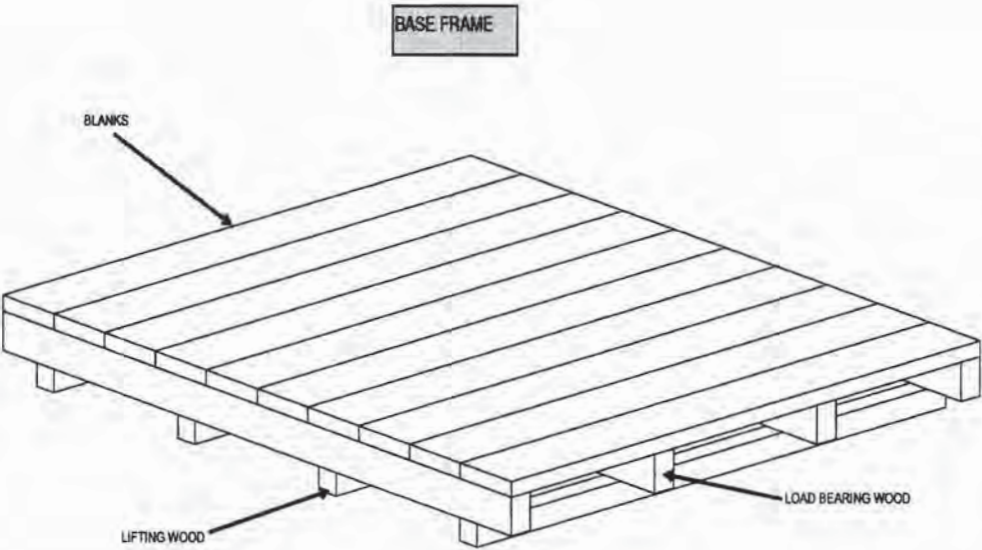


	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 35	OF 52


MODEL: FASTNERS TYPE - WITHOUT TOP



	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 36	OF 52

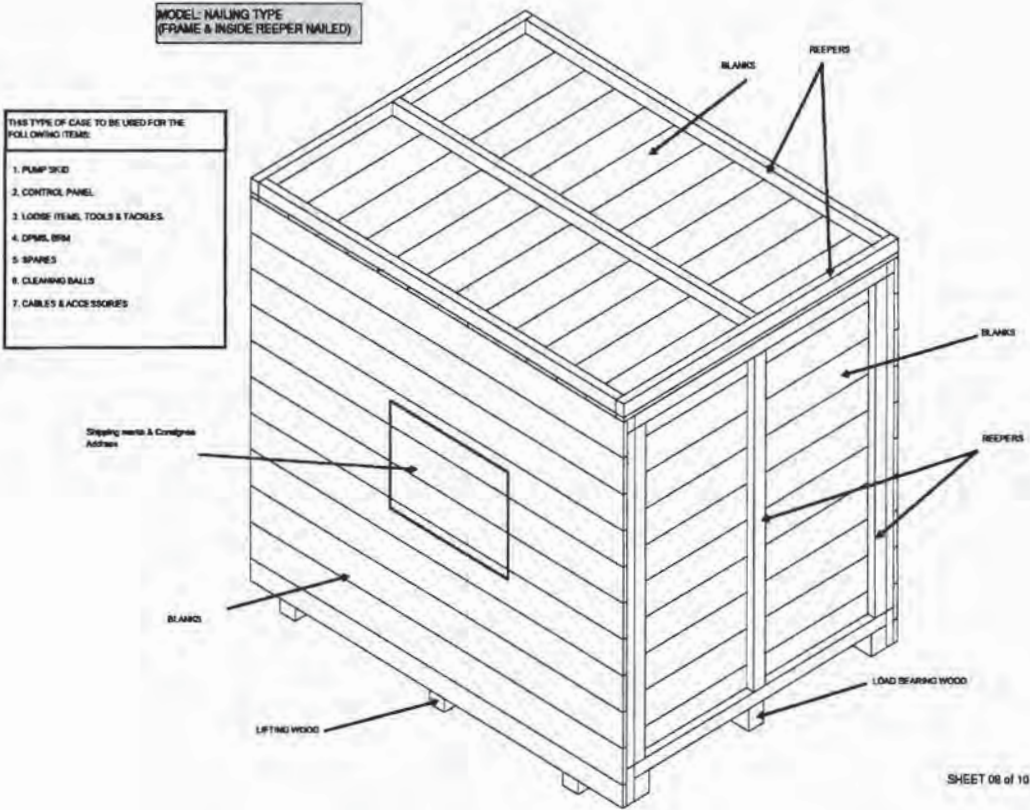


	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 37	OF 52

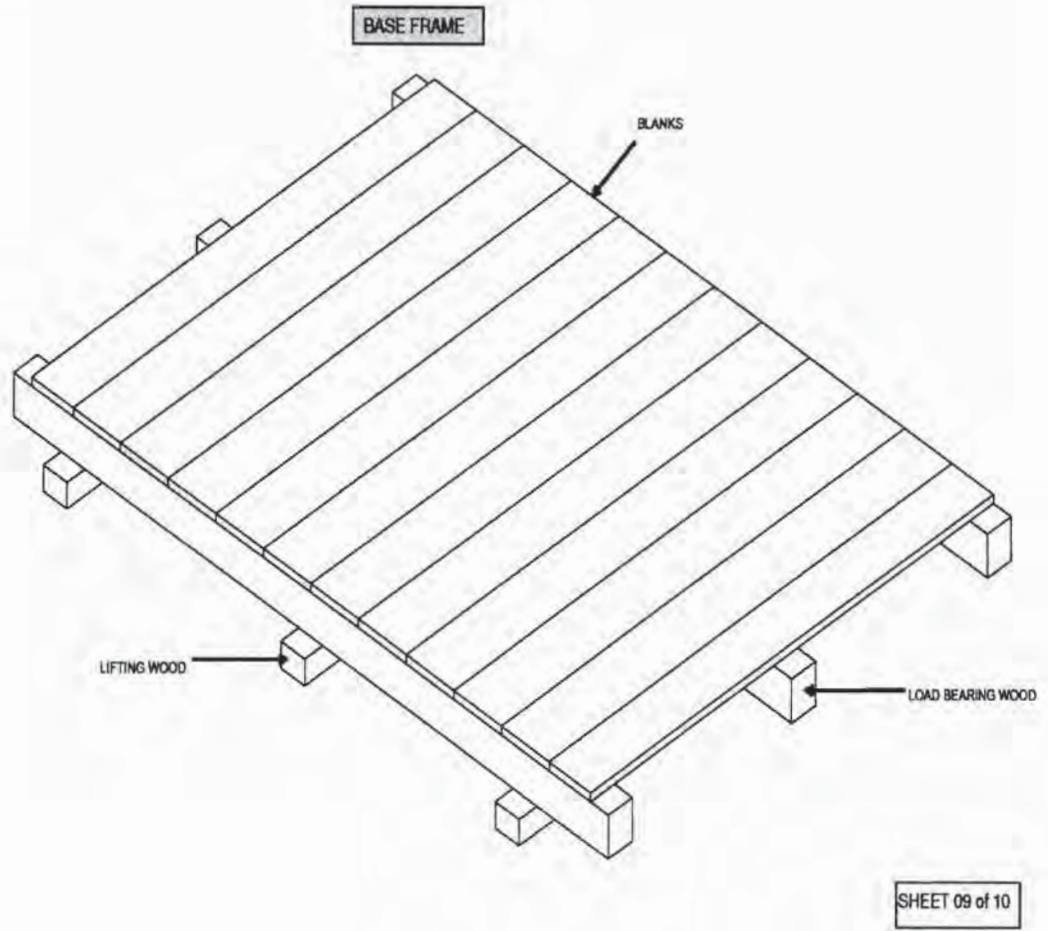

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 38	OF 52

NAILING TYPE MODEL WITH TOP OPEN

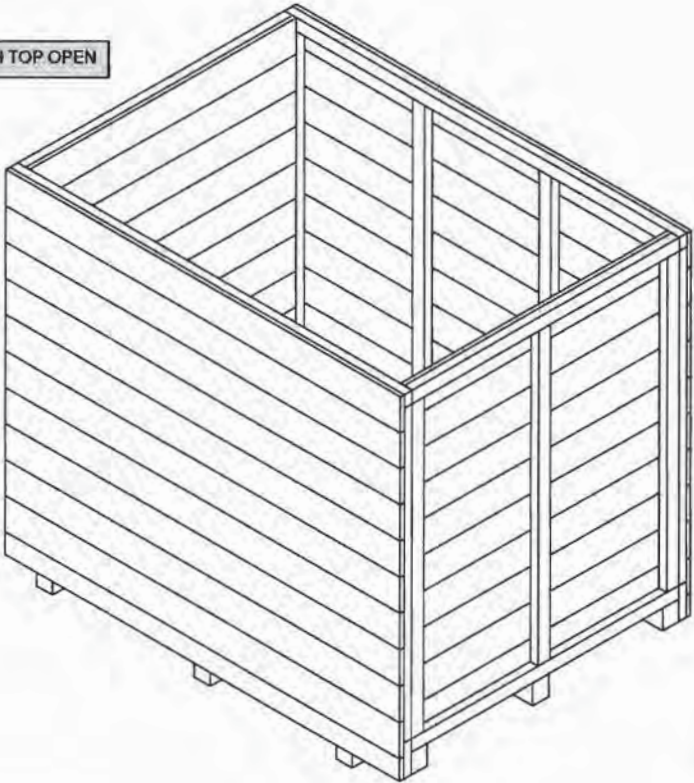

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 39	OF 52

10.4 PACKING OF LOOSE ITEMS

Loose mechanical, electrical and C&I items e.g. valves, fittings, pressure/temperature gauges/switches, circuit breakers, relays etc shall be individually wrapped using polyethylene sheets/U foam/ thermocol sheets/air bubble sheets depending upon the items and then packed in wooden boxes. The left out spaces and top of the boxes shall be filled with rubberized coir to get proper cushioning effect, Special attention shall be paid to relays, instruments etc for arresting the movements of their operating mechanism during transportation.

The construction of wooden packing cases shall be as per clause 9.3.1 retaining its all features concerning strength of the box. The construction of wooden packing case for electrical and C&I items shall be as per fig-16.

Inner surface of 6 sides of the box shall be lined with bitumen coated hessian polyethylene kraft paper. Rubberized coir of min. 25mm thickness and 100 mm width shall be nailed to inner surfaces of bottom and 4 sides of the boxes.

11.0 PACKING OF ELECTRICAL ITEMS

11.1 CABLES


11.1.1 Type of Equipment

All type of cables..


11.1.2 Type of Construction

New or practically new cable drums made of steel and painted with epoxy resin paint are to be used. Cable ends are carefully protected before packing. Over the cables polyethylene sheet shall be wrapped and then sealed properly. Cable drum can be put in wooden crates for ease in transportation and handling. (Wooden cable drum is also acceptable, however vendor to furnish constructional details for approval).

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 40	OF 52

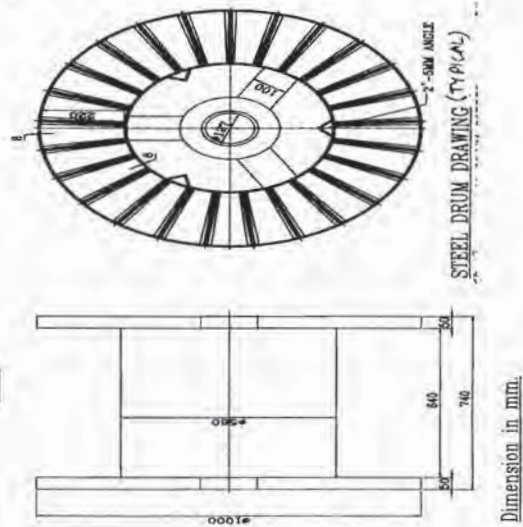

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 41	OF 52

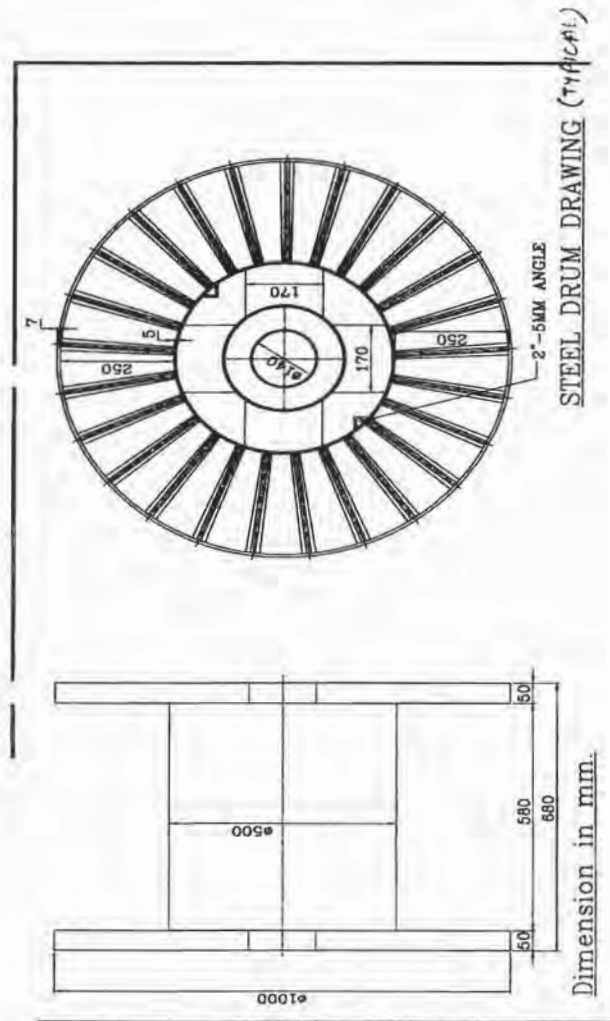

11.2 PACKING OF CABLE TRAYS & ACCESSORIES AND CABLE TRAY SUPPORT MATERIAL

11.2.1 Cable trays can be packed in wooden boxes as per fig 1 to 11 or in steel boxes. Details of steel box construction is as indicated below.



- 1) All Dimensions are in "mm" unless otherwise stated.
- 2) Packing Box shall be fabricated using 50x50x6mm MS Angle, 50x3mm Flat, 2.5 mm thick C Channel, 1mm & 1.6mm Thick sheet.
- 3) Finish of Packing Box Shall be Galvanized.
- 4) Angle & Channel Section forming part of the Main frame shall be welded thoroughly with each other to give a rigid structure.
- 5) Sheet Section and Flat section shall be bolted/ Riveted/ Welded suitably to the Main frame stated in '4' above.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 42	OF 52


- 6) Welding Portion on galvanized surfaces shall be painted with Zinc Rich Paint.
- 7) Dispatch details such as consignor/consignee address, contract and case details, 'country of origin, port of delivery, stacking instructions shall be written on one of the side of boxes. An anodized aluminium plate as per details and specifications given in page 3 of 5 shall be provided on the boxes
- 8) One copy of packing slip wrapped in polythylene bag covered with suitable aluminium .packing slip holder to be nailed on the external surface of the box. One more copy 9f the packing Slip wrapped in polythylene bag to be kept inside the box at the prominent place.
- 9) **INDICATION MARKS ON THE BOXES:** Markings shall be provided on the boxes indicating position of Boxes for handling, storage and nature of consignment. For guidelines referred page 4 of 5. The ink issued for this purpose as well as for marking dispatch instruction shall be indelible/non-washable marking ink.
- 10) Each item as mentioned in BOQ shall be packed & supplied as a set comprising of required numbers of associated fasteners & hardware etc

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 43	OF 52


STEEL PACKING (TYPICAL DETAILS)

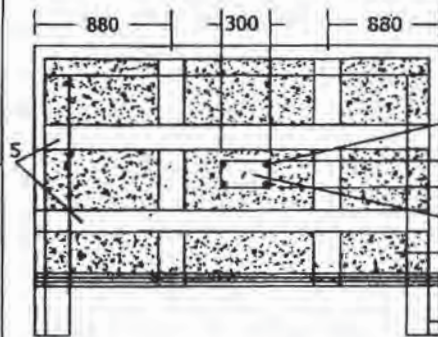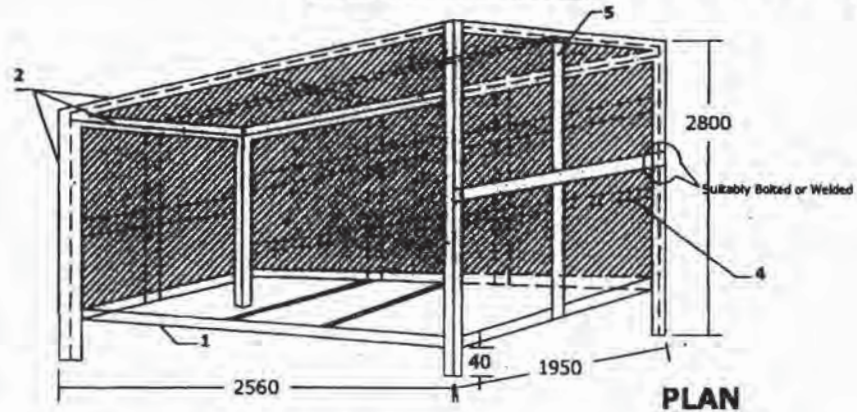

FRONT SIDE OF BOX

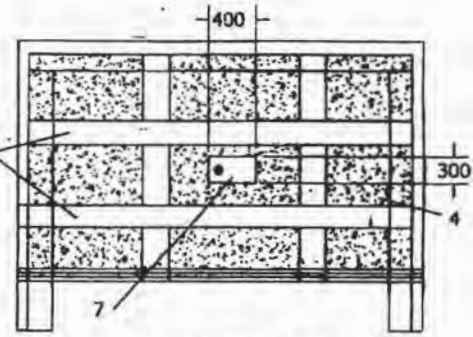


BACK SIDE OF BOX

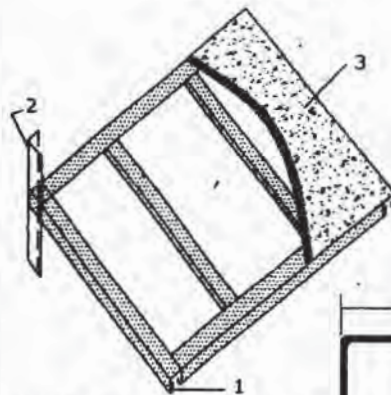

BOTTOM FRAME ARRANGEMENT

Note:

1. "C" Channel to be used on Bottom Frame.
2. 50x50x6 Angle to be used Vertically on four sides of the Box and Horizontally on four sides on the top Frame.
3. 1.6mm thick sheet (plain) on Bottom Plate.
4. 1.0mm thick sheet to cover top & four sides of BOX.
5. 50x3 Flat as additional cross members to be used Horizontally & Vertically on top & Four Sides of Box.
6. Anodised Aluminium Plate for Marking.
7. Hinged Inspection Window.



DETAILS OF "C" CHANNEL

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 44	OF 52

11.3 PACKING FOR STATION LIGHTING SYSTEM

Aspects of packing specific to equipments / items of station lighting system are given here. All other instructions / aspects as per the main specification of export packing which are not covered here shall also be applicable.

11.3.1 For LIGHTING TRANSFORMER, DISTRIBUTION BOARDS, LIGHTING PANELS,

- Construction of packing case for LIGHTING DIATRIBUTION BOARDS, LIGHTING PANELS, TRANSFORMER . shall be EITHER as per FIGURE 1,2,3,5,6,7,8,9,10,11 OR FIGURE 14,15,16.
- Each Panel/Transformer shall be individually covered with double polythene sheet of thickness 175 microns minimum.
- All the 6 inner surfaces of packing shall be nailed with bitumen coated hessian polythene craft paper. Wherever 2 pieces of craft paper are used, the joint shall have minimum overlap of 20mm.

For the top frame it shall be project on all sides by 100mm and shall be nailed on sides .

- The gap between the panels and packing case shall be filled with rubberized coir of thickness 50mm minimum and width 100mm. The distance between two consecutive supports of rubberized coir shall be less than 500mm.
- Silica get packed in cotton bags shall be placed at different positions inside the packing.
- Packing case shall be finally covered with GI sheet of thickness 0.4mm minimum.

11.3.2 For LUMINARIES, RECEPTACLES. EMERGENCY LIGHT, 240/24V TRANSFORMER, CEILING FAN, SWITCH BOARDS, FLEXIBLE CONDUIT, WIRES, EARTH WIRE. JUNCTION BOXES, ERECTION COMMISSIONING SPARES, RECOMMENDED SPARES , ERECTION MATERIAL AND CONSUMBALES

- Construction of packing case for THE ABOVE MATERIAL shall be as per FIGURE 1to11.
- Items placed inside the case shall be covered with double polythene sheet of thickness 175 microns minimum.
- All the 6 inner surfaces of packing shall be nailed with bitumen coated hessian craft paper. wherever 2 pieces of craft paper are used, the joint shall have minimum overlap of 20mm. For the top frame it shall be project on all sides by 100mm and shall be nailed on sides.
- Silica get packed in cotton bags shall be placed at different positions inside the packing.

11.3.3 For CONDUIT PIPE

As per international practice pipes are shipped in open bundles with metal strapping. Packing as per attached figure A shall be provided which is described as following:

- Each bundle shall be wrapped with 2 layers of 175 microns thick polythene sheet.
- Then bundle will be wrapped with bitumen coated hessian craft paper.
- Bundle shall be strapped with steel straps.
- An anodized aluminium packing description plate as per Figure No. 13 shall be provided.

11.3.4 For POLES

Poles will be wrapped with 2 layers of minimum 175 microns thick polythene sheet and then with bitumen coated hessian craft paper, packed as per Figure – C i.e. bundling.

11.3.5 For STRUCTURAL STEEL

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 45	OF 52

Structural steel will be different sizes and shapes. Hence it will be packed as per Figure No. B and described as following :

- a) Each bundle shall be wrapped with 2 layers of 175 microns thick polythene sheet.
- b) Then bundle will be wrapped with bitumen coated hessian craft paper.
- c) Bundle shall be strapped with steel straps.
- d) An anodized aluminium packing description plate as per Figure No. 13 shall be provided.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 46	OF 52

PACKING PROCEDURE FOR CONDUIT PIPE

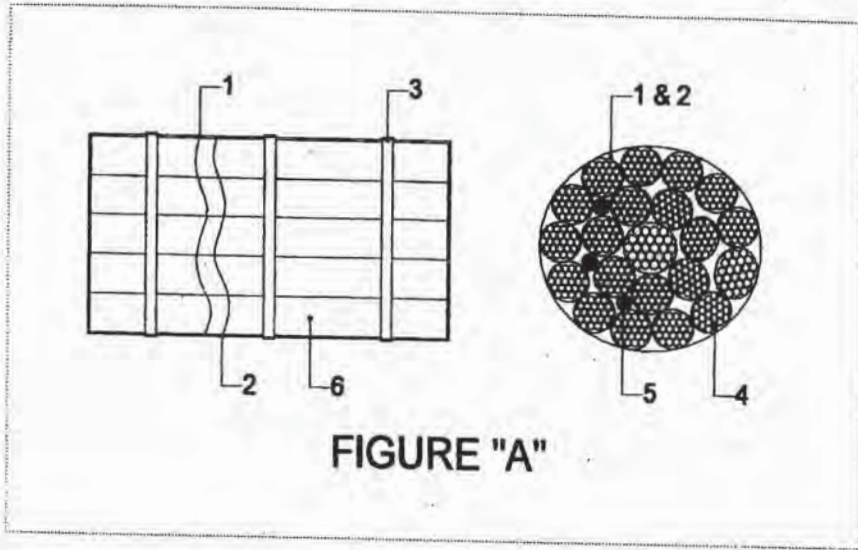


FIGURE "A"

- 1) LAYER OF BITUMEN COATED HESSIAN KRAFT PAPER.
- 2) LAYER OF POLYTHENE SHEET.
- 3) METAL STRAPPING.
- 4) CONDUIT PIPES.
- 5) SILICA GEL POUCHES.
- 6) BUNDLES OF CONDUIT PIPES.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 47	OF 52

PACKING PROCEDURE FOR STRUCTURAL STEEL

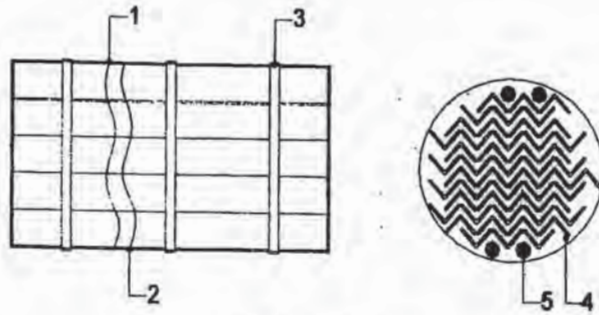


FIGURE "B"

- 1) LAYER OF BITUMEN COATED HESSIAN KRAFT PAPER.
- 2) LAYER OF POLYTHENE SHEET.
- 3) METAL STRAPPING.
- 4) STRUCTURAL STEEL.
- 5) SILICA GEL POUCHES.

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 48	OF 52

packing procedure for poles

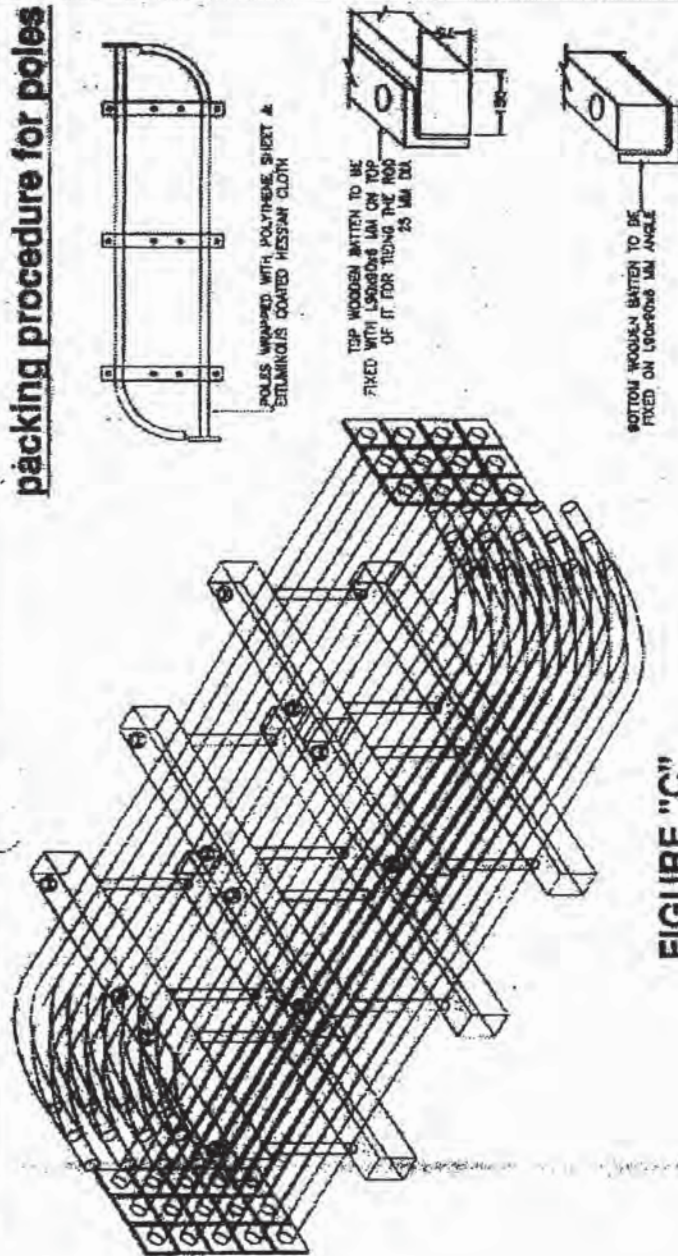


FIGURE "C"

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME	II B
		SECTION	D
		REV. NO. 0	DATE 10/08/2010
		SHEET	49 OF 52

11.4 PACKING FOR DC BATTERY

The packing procedure for seaworthy packing of DC Battery is defined below, which is capable of withstanding impacts, compression, vibration, toppling, sea water spray, prevention against rust, temperature and extreme atmospheric conditions. Aspects of packing specific to equipments / items of DC Battery are given here. All other instructions / aspects as per the main specification of export packing which are not covered here shall also be applicable.

The packing procedure consists of various stages namely primary packing, cushioning, securing, desiccant, outside packing box, Runners/ sliders/ transverse bars of plywood, etc., provided for each movement.

- a) The packing boxes shall be made up of plywood boxes (thickness 9mm min.) with blocks at the bottom of the box for provision for handling the boxes using the forklift. The packing boxes sizes are generally standardized to half-euro size (capable of handling equipment's weight).
- b) Rubberized coir of 25mm thickness shall be provided as cushioning material at the bottom and thermocole of 20mm shall be provided inside on all four sides. Other than this polyethylene film wrap or cover also will be provided. Left out spaces to be filled with rubberized coir/ thermocol to get cushioning effect.
- c) Silica gel in dust free air permeable cotton/paper bag shall be placed in the packing boxes for storage period of 1 year as per IS 304 (1979)
- d) While packing the cells, transit caps (polypropylene) of red and blue shall be used for big size cells for ensuring that cells does not get damaged during the transport due to vibrations etc.
- e) The battery accessories shall be packed with suitable precautions as follows:
 - i) Copper connectors shall be packed after making bunches with lead wire seals to avoid misplacement.
 - ii) Hardware items shall be packed in polyethylene bags (Thickness ≥ 0.175 mm) with item slip
 - iii) Battery rack shall be packed in dismantled condition, wrapped with polyethylene sheet
 - iv) For Ni-Cd type battery, electrolyte in solid form for dry cells shall be packed in cans with KOH, LiOH being packed separately.
 - f) Galvanized Steel straps are provided for binding the packing box sides.
 - g) The handling instructions shall be marked in indelible/ non-washable ink, indicating the upright position.

11.5 PACKING OF SERVICE TRANSFORMERS(OIL FILLED) & ACCESSORIES

This instruction is applicable for packing of transformers (oil filled), its accessories and components so as to ensure safe delivery to end user. Aspects of packing specific to equipments / items of transformers(oil filled) are given here. All other instructions / aspects as per the main specification of export packing which are not covered here shall also be applicable.

11.5.01 PACKING DETAILS :

- a) Items shall be packed in case / crates as per the shipping list.
- b) All fragile items and small items shall be packed in cases and to be marked as "Fragile, handle with care Fragile items".
- c) Fragile accessories are to be first packed in their original boxes (VENDOR's packing). Very

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME	II B
		SECTION	D
		REV. NO. 0	DATE 10/08/2010
		SHEET	50 OF 52

- d small / delicate items such as glass thermometer, door keys shall be packed in separate box.
In case original box is found damaged, suitable alternate box or packing method using felt or foam sheet and polythene wrap to be used.
- e These boxes are then placed in identified wooden boxes. Inside of such boxes are lined with a layer of polythene sheet, packing wool / grass and another layer of polythene sheet before placing the boxes. All boxes are then wrapped with this polythene sheet before closing the box. Fragile items shall not be placed loose, one above the other inside the case.
- f All wiring cables, connection flats of non-ferrous materials, CTs, valves bellows shall also be packed.
- g Items like CTs, Oil communicating bushings, insulators, wired equipments and housings such as RTCC Panel, M. Box, Drive Mechanism, thermometers, gauges shall be wrapped in polythene from all around.
- h Buchholz relay and OSR relay openings will be blanked using covers, before putting them in the box
- i Items shall be carefully lowered and arranged inside the crate / case and each item shall be locked from all sides in such a way to avoid its movement in any way. Wooden stoppers and separators shall be provided for this and nailed to the crate / case wood.
- j Wooden planks and batons in contact with fragile items shall be provided with kit foam at the locations of contact.
- k Oil communication bushings shall be packed in separate case on V or U shape wooden felted supports, as in case of condenser bushings.
- l While placing and arranging the items inside the crates / cases, these shall be verified for correctness and then the packing note shall be signed. The cover top of the crate / case shall then be closed.
- m The main equipment like transformer tank shall be packed suitably to prevent any damage during transit / storage. Support structures like frame, header supports etc. shall be crated. Conservator headers shall also be crated. Radiators pipe work and other instruments & components shall be packed in cases. All the cases shall be lined with polythene from inside.

11.6 ALTERNATIVE PACKING CASES FOR CONTROL PANELS AND SWITCH GEARS

For Control and switch gear panels, construction of wooden packing cases may be provided as per fig 14 & 15 and as detailed below.

Thickness of planks for all sides, binding and jointing battens shall be at least 25 mm. Width of the plank shall be at least 125mm and that of binding and jointing planks shall be at least 100mm.

Top frame shall be suitable so that it does not collapse due to sandwiching between slings while lifting. Longitudinal and traverse bars for the bottom wooden pallet to be suitably selected.

Diagonal bracings shall be as per cl 9.3.1.3 and all other requirements shall be as per clauses 9.3.1.4 to 9.3.1.6.

12.0 Containerization

As required by BHEL, the VENDOR shall stuff the GOODS into 20 or 40 foot containers (dry, open top, flat racks, etc.).

The maximum inside dimensions of containers are to be considered:

	TITLE TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 51	OF 52

- 40 foot containers: 11.80 m x 2.20 m x 2.05 m
- 20 foot containers: 5.80 m x 2.20 m x 2.05m
-

The present definition of containerization is valid for sea containers only. Vendor to check the size of containers before start of packing of equipment.

12.1 Protection of Cases/Crates

Since shipping containers are in general not water tight, packing in contact with the floor of the container shall be raised in order to prevent it from being damaged by the accumulation of water.

12.2 Mechanical Constraints

The mechanical constraints for "general use" closed containers are of a different nature (height of "stacking" being limited inside the containers), the packing for the GOODS may be of a lighter structure. However, it is necessary that the packing be appropriate so as to protect the GOODS on site during the storage period, as required after discharging of the GOOD'S from the containers.

Note:

It is the responsibility of the VENDOR to ensure that the cases/crates are stowed, secured and fastened inside the container. The VENDOR will take all necessary precautions to conform to the maximum weight allowed and the centre of gravity of the container. The securing and fastening of the cases/ crates can be carried out by nailing timbers on the bottom or on the vertical sides of the container.

13.0 Other Services to be provided by Vendor

In addition to the packing and shipping documents, VENDOR must also carry out the following services, which shall be included in his quotation:

Carriage of VENDOR's sub-contracted equipment and material, which must be re-grouped in VENDOR's or PACKER's workshops, whilst waiting for packaging.

BHEL reserves the right to postpone the shipping of the GOODS. In this event, any storage and insurance costs during the first ninety (90) days shall be borne by the VENDOR.

Loading, including lifting, securing, lashing, and stowing, of all cases, crates, or packages onto means of transportation such as, but not limited to, trailers, containers, etc.

14.0 Responsibilities and Guarantees

VENDOR is responsible for the choice of category for packing according to the transport facilities used, and on the basis of the present document. In case of doubt or disagreement regarding the choice, VENDOR must inform BHEL prior to packing and await BHEL's approval. All phases of packaging, marking, loading, etc. will be subject to BHEL inspection.

BHEL reserves the right to reject the packing when the packing does not conform to these instructions and/or when the packing does not ensure perfect protection of the GOODS. VENDOR is responsible for the weights and dimensions declared, and the marking of the packages.

The documents must be in strict conformity with the packing contents.

The packing specified in these "Packing, Marking and Shipping Instructions" is guaranteed for a twelve (12) months storage period after delivery on site.

VENDOR is responsible for providing storage recommendation adapted to the GOODS. According to this guarantee, VENDOR is held responsible in the event of goods becoming

12866/2020/PS-PEM-MAX

	TITLE	SPECIFICATION NO. PE-TS-888-100-A001	
	TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 52	OF 52

useless, damaged or broken, as a result of poor packing and/or stowing, or due to corrosion, subsequent to insufficient or inadequate protection. All direct or indirect costs resulting thereof, will be back-charged to VENDOR.

	(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION : II	
		REV: 00	DATE: MAY 2020
		SHEET 1 OF 1	

ANNEXURE-1

BIDDER SHOULD SUBMIT THE SIGNED AND STAMPED COPY OF THE FOLLOWING DOCUMENTS:

1. Compliance cum confirmation certificate (Refer Annexure-2 of section-II)
2. Pre-bid clarification schedule as per format given under Section-II (Annexure-3), in case of any clarifications.
3. Deviation schedule as per format given under Section-II (Annexure-4), in case of any deviations by bidder.
4. Guaranteed power consumption format (In the format attached in the price schedule) declaring guaranteed power consumption value in KW.
5. Un priced format for main package (mentioning quoted against each item)
6. Un priced format for mandatory spare (mentioning quoted against each item)
7. Un priced format for Tools and Tackles (mentioning quoted against each item)
8. Un priced format for Commissioning spare (mentioning quoted against each item)
9. List of makes of sub vendor items (Refer Annexure-6 of section-II)
10. Agitator Schedule filled up by the bidder (Refer Annexure-8 of section-II)
11. GA drawing, Exploded view with Material of construction, total weight of all Agitators models offered
12. Agitator and Motor Sizing Calculation
13. Electrical Load data filled up by the bidder (Refer Annexure-5 of section-II)
14. Documents for meeting the Pre-Qualification Requirement (3K format has to be submitted along with supporting documents)
15. Schedule of guarantees (Refer Annexure-10 of section-II)
16. Priced offer



**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPECIFICATION No: PE-TS-467-571-18000-A001

SECTION : II

REV. NO. 00

MAY 2020

SHEET: 1 OF 2

ANNEXURE -2

COMPLIANCE CUM CONFIRMATION CERTIFICATE

The bidder shall confirm compliance with following by signing / stamping this compliance certificate (every sheet) and furnish same with the offer.

- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions, other than those mentioned under "exclusion and those resolved as per 'Schedule of Deviations', with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the 'Schedule of Deviations'. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the 'Schedule of Deviations'
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL / CUSTOMER approval & customer hold points for inspection / testing shall be marked in the QP at the contract stage. Inspection / testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc. This is within the contracted price without any extra implications to BHEL after award of the contract.
- d) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified / intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements then same shall be resolved by the bidder with BHEL during the pre-bid discussions, otherwise BHEL / Customer's decision shall be binding on the bidder whenever the deficiency is pointed out.

For components where materials are not specified, same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- e) The commissioning spares shall be supplied on 'As Required Basis' & prices for same included in the base price itself.
- f) All sub vendors shall be subject to BHEL / CUSTOMER approval in the event of order.
- g) Guarantee for plant/equipment shall be as per relevant clause of GCC / SCC / Other Commercial Terms & Conditions
- h) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break up, approved drawing or approved Bill of quantities within the scope of work as per tender specification. This clause will apply in case during site commissioning, additional requirements emerges due to customer and / or consultant's comments. No extra claims shall be put on this account

12866/2020/PS-PEM-MAX



**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPECIFICATION No: PE-TS-467-571-18000-A001

SECTION : II

REV. NO. 00

MAY 2020

SHEET: 2 OF 2

- i) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's / Customer's / Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- j) As built drawings shall be submitted as and when required during the project execution.
- k) The bidder has not tempered with this compliance cum confirmation certificate and if at any stage any tempering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.
- l) Successful bidder shall furnish detailed erection manual for each of the equipment supplied under this contract at least 3 months before the scheduled erection of the concerned equipment / component or along with supply of concerned equipment / component whichever is earlier.
- m) Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations of completing the work as per specification requirement. Any deviation from specified requirement shall be reported by the vendor in writing and require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.
- n) In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor's account and shall not be used as a reason for extension in contract completion.



(3X200MW+3X500MW) RAMAGUNDAM STG-I & II

TECHNICAL SPECIFICATION
FOR AGITATORS

SPECIFICATION NO. PE-TS-467-571-18000-A001

SECTION-II

REV: R 00

MAY 2020

SHEET: 1 OF 1

ANNEXURE-3**PRE-BID CLARIFICATION SCHEDULE**

S.No.	Section/Clause/ Page No.	Statement of the referred clause	Clarification required

The bidder hereby certifies that above mentioned are the only clarifications required on the technical specification for the subject package.

SIGNATURE: _____

NAME : _____

DESIGNATION: _____

COMPANY: _____

DATE: _____

COMPANY SEAL

DEVIATION SHEET (COST OF WITHDRAWL)									
 TITLE: TECHNICAL SPECIFICATION FOR AGITATORS PROJECT: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II									
TECH SPC NO: PE-TS-467-571-18000-A001									
TENDER ENQUIRY REFERENCE:-									
NAME OF BIDDER:-									
SL NO	VOULME/ SECTION	PAGE NO.	CLAUSE NO.	TECHNICAL SPECIFICATION/ TENDER DOCUMENT	COMPLETE DESCRIPTION OF DEVIATION	COST OF WITHDRAWL OF DEVIATION	REFERENCE OF PRICE SCHEDULE ON WHICH COST OF WITHDRAWL OF DEVIATION IS APPLICABLE	NATURE OF COST OF WITHDRAWL OF DEVIATION (POSITIVE/ NEGATIVE)	REASON FOR QUOTING DEVIATION
TECHNICAL DEVIATIONS									
COMMERCIAL DEVIATIONS									
PARTICULARS OF BIDDERS/ AUTHORISED REPRESENTATIVE									
NAME				DESIGNATIONS		SIGN & DATE			
NOTES:									
1. Cost of withdrawal of deviation will be applicable on the basic price (i.e, excluding taxes, duties & freight) only.									
2. All the bidders has to list out all their Technical and Commercial Deviations (if any) in detail in the above format.									
3. Any deviation not mentioned above and shown separately of found hidden in offer, will not be taken cognizance of.									
4. Bidder shall submit duly filled unpriced copy of above format indicating "quoted" in "cost of withdrawal of deviation" column of the schedule above along with their Techno-commercial offer, wherever applicable. in the absence of same, such deviation(s) shall not be considered and offer shall be considered in total compliance to NIT									
5. Bidder shall furnish price copy of above format along with price bid.									
6. The final decision of acceptance/ rejection of the deviations quoted by the bidder shall be at discretion of the Purchaser.									
7. Bidders to note that any deviation (technical/commercial) not listed in above and asked after Part-I opening shall not be considered.									
8. For deviations w.r.t. Credit Period, Liquidated damages, Firm prices if a bidder chooses not to give any cost of withdrawal of deviation loading as per Annexure-VII of GCC, Rev-07 will apply. For any other deviation mentioned in un-priced copy of this format submitted with Part-I bid but not mentioned in priced copy of this format submitted with Priced bid, the cost of withdrawal of deviation shall be taken as NIL.									
9. Any deviation mentioned in priced copy of this format, but not mentioned in the un-priced copy, shall not be accepted.									
10. All techno-commercial terms and conditions of NIT shall be deemed to have been accepted by the bidder, other than those listed in un-priced copy of this format.									
11. Cost of withdrawal is to be given separately for each deviation. In no event bidder should club cost of withdrawal of more than one deviation else cost of withdrawal of such deviations which have been clubbed together shall be considered as NIL.									
12. In case nature of cost of withdrawal (positive/negative) is not specified it shall be assumed as positive.									
13. In case of discrepancy in the nature of impact (positive/ negative), positive will be considered for evaluation and negative for ordering.									

LOAD TITLE	RATING (KW / A)		UNIT (U)/STN (S)	Nos.		VOLTAGE CODE*	FEEDER CODE**	EMER. LOAD (Y)	CONT.(C)/ INTT.(I)	STARTING TIME >5 SEC (Y)	LOCATION	BOARD NO.	CABLE		BLOCK CABLE DRG. No.	CONTROL CODE	REMARKS	LOAD No.
	NAME PLATE	MAX. CONT. DEMAND (MCR)		RUNNING	STANDBY								SIZE CODE	NOS				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19

ANNEXURE-5

Filtrate Water Tank Agitator				1	0				C									
Secondary Waste Water Hydro-cyclone Feed Tank Agitator				1	0				C									
Waste Water Tank Agitator				1	0				C									
Limestone Slurry Storage Tank Agitator				2	0				C									
Absorber Area Drain Sump Agitators				4	0				C									
Gypsum Area Drain Sump Agitator				1	0				C									
Limestone Area Drain Sump Agitator				1	0				C									
Auxiliary Absorbent Tank Agitator				3	0				C									
Primary hydro cyclone feed tank Agitator				1	0				C									

NOTES:

1. COLUMN 1 TO 12 & 18 SHALL BE FILLED BY THE REQUISITIONER (ORIGINATING AGENCY); REMAINING COLUMNS ARE TO BE FILLED UP BY PEM (ELECTRICAL)/ CUSTOMER
2. ABBREVIATIONS : * VOLTAGE CODE (7):- (ac) A=11 KV, B=6.6 KV, C=3.3 KV, D=415 V, E=240 V (1 PH), F=110 V (cc): G=220 V, H=110 V, J=48 V, K=+24V, L=-24 V
: ** FEEDER CODE (8):- U=UNIDIRECTIONAL STARTER, B=BI-DIRECTIONAL STARTER, S=SUPPLY FEEDER, D=SUPPLY FEEDER (CONTACTER CONTROLLED)

ANNEXURE-5 LOAD DATA (ELECTRICAL)	JOB NO.	467	ORIGINATING AGENCY		PEM (ELECTRICAL)	
	PROJECT TITLE	RAMAGUNDAM FGD- STG I & II	NAME		DATA FILLED UP ON	
	SYSTEM	AGITATOR	SIGN.		DATA ENTERED ON	
	DEPTT. / SECTION	MAUX	SHEET 1 OF 1	REV. 00	DE'S SIGN. & DATE	332 of 354

	(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS SUB-VENDOR LIST	SPECIFICATION NO. PE-TS-467-571-18000-A001	
		SECTION : II	
		REV 00	MAY 2020
		SHEET 1 OF 1	

ANNEXURE -6

LIST OF MAKES OF ITEMS

<u>S.N.</u>	<u>ITEM NAME</u>	<u>MANUFACTURER</u>	<u>LOCATION</u>

	(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS		SPECIFICATION NO. PE-TS-467-571-18000-A001	
			SECTION : II	
			REV 00	DATE: MAY 2020
			SHEET: 1 OF 1	

ANNEXURE-7

Bidder shall supply a set of special tools and tackles required either for erection or operation or maintenance of the agitator units. A list of such tools and tackles shall be submitted along with the offer.

	TITLE: (3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-II	
		REV. 00	DATE: MAY 2020
		SHEET : 1 OF 1	

ANNEXURE-8

AGITATOR SCHEDULE

	Description	AUXILIARY ABSORBENT TANK	LIMESTONE SLURRY STORAGE TANK	PRIMARY HYDROCYCLONE FEED TANK	SECONDARY HYDROCYCLONE FEED TANK	FILTRATE WATER TANK	WASTE WATER TANK	ABSORBER AREA DRAIN SUMP	GYPSUM AREA DRAIN SUMP	LIMESTONE AREA DRAIN SUMP
		1	2	3	4	5	6	7	8	9
1	Tank Details									
a	Tank shape	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Vertical Cylindrical	Rectangular(RCC sump)	Rectangular(RCC sump)	Rectangular(RCC sump)
b	Dimension of tank (m)	13.5 Dia X 13.5 H*	15 Dia X 15 H*	7.5 Dia X7.8H*	6.0 Dia X 7.2 H*	6.0 Dia X 6.1 H*	8.0 Dia X 9.0 H*	4 W X4 L X4 H*	4 W X4 L X4 H*	4 W X4 L X4 H*
c	Capacity of tank (hold volume in m3)	1818 m ³	2509.34 m ³	322.5 m ³	189.4m ³	158.3 m ³	427.2 m ³	56 m ³	56 m ³	56 m ³
d	No. of tanks	1 no.	2 nos. (1W + 1S)	1 no.	1 no.	1 no.	1 no.	1 nos.	1 no.	1 no.
e	Total no. of tanks for four (3x200 MW + 3x500 MW) units	1 no.	2 no.	1 no.	1 no.	1 no.	1 no.	4 nos. (1 for each unit)	1 no.	1 no.
f	Minimum liquid level in the tank	1.0	1.0	1.0	1.0	1.0	1.0	1.4	1.4	1.4
g	Normal liquid level in the tank	12.5	14.0	7.1	6.5	5.4	8.3	3.3	3.3	3.3
h	Maximum liquid level in the tank	12.7	14.2	7.3	6.7	5.6	8.5	3.5	3.5	3.5
2	Agitator selection data									
a	Type	Blade turbine - marine propeller side entry	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)	Vertical Type – (Center Mounted)
b	Medium to be handled	Gypsum slurry	Limestone slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Limestone slurry
c	Seal Type	Mechanical seal (emergency flush start)	Not required	Not required	Not required	Not required	Not required	Not required	Not required	Not required
d	Duty	Continuous	Continuous	Continuous	Continuous	Continuous	Continuous	Continuous	Continuous	Continuous
e	Agitator location	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor	Outdoor
f	Operation	Intermittent -Whenever FGD is under maintenance	Continuous.	Continuous.	Continuous.	Continuous.	Continuous.	Intermittent	Intermittent	Intermittent
g	MOC of Agitator	side entry - Agitator Shaft (which is continuously in contact with slurry) and blades shall be made with Alloy 926 or better material.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.	Agitator blades shall be made with Alloy 926 or better material & Agitator shaft can be rubber lined.
h	Quantity of Agitators per Tank	3 nos. - side entry	1 No.	1 No.	1 No.	1 No.	1 No.	1 No.	1 No.	1 No.
i	Total Quantity for four units	3 nos. - side entry	2 No’s	1 No.	1 No.	1 No.	1 No.	4 No’s	1 No.	1 No.
3	Slurry Analysis									
a	Slurry to be handled	Gypsum slurry	Limestone slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Gypsum slurry	Limestone slurry
b	Maximum solid particle size	200 mesh (75 μ)	200 mesh (75 μ)	200 mesh (75 μ)	200 mesh (75 μ)	200 mesh (75 μ)	200 mesh (75 μ)	6-7 mm	6-7 mm	6-7 mm
c	Normal solid particle size, d50	325 mesh (43 μ)	325 mesh (43 μ)	325 mesh (43 μ)	325 mesh (43 μ)	325 mesh (43 μ)	325 mesh (43 μ)	6-7 mm	6-7 mm	6-7 mm
d	Solid to be handled	gypsum along with Limestone & other impurities	Limestone + impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	gypsum along with Limestone & other impurities	Limestone + impurities
e	Chloride concentration	max 30000 ppm	max 1000 ppm	max 30000 ppm	max 30000 ppm	max 30000 ppm	max 30000 ppm	max 30000 ppm	max 30000 ppm	max 1000 ppm
f	Hardness of particle	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale	5-7 mho scale
g	Slurry concentration, wt%	25%	30 wt%	25 wt%	16.60%	14%	3%	25%	25%	30 wt%
h	Sp. Gravity of slurry	1.177	1.218	1.177	1.114	1.098	1.025	1.177	1.177	1.218
i	Sp. Gravity of Lime Stone & Gypsum	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)	2.32(avg)
j	Viscosity of Slurry	10 cP	30 cP	10 cP	4 cP	4 cP	3 cP	10 cP	10 cP	30 cP
k	pH	4 to 8	5 to 8	4 to 8	4 to 8	4 to 8	4 to 8	4 to 8	4 to 8	5 to 8
l	SiO ₂ Content	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l	4 to 6 g/l
m	Temperature	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.	Normal -62 deg C; Design-70 deg C.
4	Motor									
a)	Total Power consumed	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
b)	Motor Rating	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder	To be filled by bidder
c)	Motor Explosion Proof Class	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof	Non-Flame Proof
d)	Motor Protection Class	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor	IP-55/ Outdoor
e)	Motor Efficiency Class	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3	IE-3

1	There shall be complete re-suspension of all solids after a 24 hour outage. Accumulation of solids shall not prevent agitator restart.
2	Agitation shall be provided to prevent settlement of slurry by side entry agitators . All the side-entry agitators shall be similar.
3	Tank low level trip requirement shall be provided by the bidder
4	Maximum Sound Pressure Level at a height of 1.5 m above floor level in elevation, and at a distance of 1.0 m horizontally shall be 85 dBA.
5	*Although the height of all tanks is fixed above, same may vary slightly during detailed engineering as per design calculation of tanks.

	(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION : II	
		REV 00	DATE: MAY 2020
		SHEET: 1 OF 1	

SECTION-II

ANNEXURE - 9

RAMAGUNDAM TPP FGD - AGITATOR PACKAGE
LIST OF COMMISSIONING SPARES (Required for Commissioning of Agitators)
Break up price for COMMISSIONING SPARES

[illegible]

NOTE -

1) Bidder shall furnish unit price of commissioning spares in above format alongwith the Bid. Any part even though not mentioned in list furnished but required at later date shall be supplied free of cost.



**(3X200MW+3x500MW)
RAMAGUNDAM STG-I & II
TECHNICAL SPECIFICATIONS FOR
AGITATORS**

SPECIFICATION No: PE-TS-467-571-18000-A001

SECTION : II

REV 00

DATE: MAY 2020

SHEET: 1 OF 1

Annexure- 10

Schedule of Guarantees (TO BE FILLED FOR EACH AGITATOR)

Project:

Enquiry No:

Sl. No.	Description	Unit	Data
1	Rated Input Power at Motor Terminal at Normal water level and at Normal voltage and Frequency	KW	
2	Possible Rate of deposit of solid particles at tank bottom of total solid particle inflow/outflow	%	
2	Noise level at a distance of 1.0 meter from the equipment at site	dB(A)	85
3	Maximum vibration velocity (at site) (RMS)	mm/sec	
4	Life of Agitator components parts from the date of Commissioning for continuous operation		24 months
5	Anti-friction Bearing		25000 hrs.

BIDDER SIGN : _____

DESIGNATION : _____

DATE : _____

	(3X200MW+3x500MW) RAMAGUNDAM STG-I & II TECHNICAL SPECIFICATIONS FOR AGITATORS	SPECIFICATION No: PE-TS-467-571-18000-A001	
		SECTION-I, SUB-SECTION-C2-A	
		REV 00	DATE: MAY 2020
		SHEET: 1 OF 1	

ANNEXURE -11

ATTACHMENT-3 K

CLAUSE NO.	INTENT OF SPECIFICATION																	
	SECTION-B PROVENNESS The Bidder / Bidder's sub-vendor(s) is required to meet the provenness criteria and/or qualification requirement for the items/ services listed below as per the stipulated criteria indicated in the respective clauses. For the purpose of qualification of Bidders / Sub-vendor(s), experience shall be reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder unless otherwise specified in the respective clauses. 1.0 Provenness Criteria/Qualifying Requirements for Equipments/Systems 1.1 The Bidder / Bidder's sub-vendor(s) is required to meet the provenness criteria and/or qualification requirement for critical equipments, auxiliaries, systems and bought out items as per criteria stipulated below: 1.2 Booster Fans, Slurry Recirculation Pumps, Oxidation Blowers, Wet Limestone Grinding Mills, Slurry Pumps, Agitators & Vacuum Belt Filters for the Wet Limestone based Flue Gas Desulphurisation (FGD) System offered by the Bidder shall be only from such manufacturer(s) who has previously designed (either by itself or under collaboration / licensing agreement), manufactured / got manufactured the respective equipment(s) of the type, application and minimum equipment rating as stipulated below such that the respective equipment(s) should have been in successful operation in at least one (1) plant for a period not less than one(1) year. Type and Rating for Qualification <table><tr><th>Sl. No.</th><th>Name of Equipment</th><th>Type of Equipment</th><th>Application</th><th>Equipment Rating</th></tr><tr><td rowspan="2">(a)</td><td rowspan="2">Booster Fans</td><td rowspan="2">Axial type with variable pitch control</td><td rowspan="2">Coal fired power plant</td><td>Unit size of 500 MW – Flow 490 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)</td></tr><tr><td>Unit size of 210 MW & Below – Flow 225 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)</td></tr><tr><td>(b)</td><td>Slurry Recirculation Pumps</td><td>Centrifugal type</td><td>Wet Limestone based FGD application in Coal fired</td><td>Unit size of 500 MW & Above - Flow 10200 m3/hr (min.) with Head 16</td></tr></table>		Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating	(a)	Booster Fans	Axial type with variable pitch control	Coal fired power plant	Unit size of 500 MW – Flow 490 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)	Unit size of 210 MW & Below – Flow 225 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)	(b)	Slurry Recirculation Pumps	Centrifugal type	Wet Limestone based FGD application in Coal fired	Unit size of 500 MW & Above - Flow 10200 m3/hr (min.) with Head 16
Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating														
(a)	Booster Fans	Axial type with variable pitch control	Coal fired power plant	Unit size of 500 MW – Flow 490 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)														
				Unit size of 210 MW & Below – Flow 225 m3/s (min.) with Head 400 mmwc (min.) & Fan Speed 900 rpm (max.)														
(b)	Slurry Recirculation Pumps	Centrifugal type	Wet Limestone based FGD application in Coal fired	Unit size of 500 MW & Above - Flow 10200 m3/hr (min.) with Head 16														
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 7 OF 19														

CLAUSE NO.	INTENT OF SPECIFICATION					
				power plant	Meters of Liquid Column (min.)	
					Unit size of 210 MW & Below – Flow 5680 m3/hr (min.) with Head 16 Meters of Liquid Column (min.)	
	(c)	Oxidation Blowers	Centrifugal/ positive displacement type blower	Wet Limestone based FGD application in Coal fired power plant or any other process application	Unit size of 500 MW & Above - Flow 7300 Nm3/hr Dry Basis (min.) with Head 8500 mmwc (min.) for spray tower process Or Head 3500 mmwc (min.) for bubbling type process	
					Unit size of 210 MW & Below - Flow 5000 Nm3/hr Dry Basis (min.) with Head 6500 mmwc (min.) for spray tower process Or Head 3500 mmwc (min.) for bubbling type process	
	(d)	Wet limestone Grinding mills	Horizontal Wet Ball mill	Wet Limestone based FGD application in Coal fired power plant	Station size of 2001 MW – 2600 MW Capacity 40 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh	
					Station size of 1501 MW – 2000 MW - Capacity 30 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh	
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9		SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 8 OF 19	

CLAUSE NO.	INTENT OF SPECIFICATION					
		Sl. No.	Name of Equipment	Type of Equipment	Application	Equipment Rating
						Station Size of 1000 MW -1500 MW Capacity 20 T/hr (min.) with pulverizing fineness not less than 90% thru 325 mesh
	(e)	Slurry Pumps	Centrifugal type	Wet Limestone based FGD application or ash slurry application in Coal fired power plant	Unit size of 500 MW & Above - Flow 50 m3/hr (min.) with head 30 Meters of Liquid Column (min.)	
					Unit size of 210 MW & Below - Flow 25 m3/hr (min.) with head 30 Meters of Liquid Column (min.)	
	(f)	Agitators	Vertical/Horizontal	Wet Limestone based FGD application in Coal fired power plant	Agitator rating not less than that supplied for 500 MW or higher size unit for similar application	
	(g)	Vacuum Belt filters	Belt type	Wet Limestone based FGD application in Coal fired power plant or in any other process application	Station size of 2001 MW- 2600 MW-Capacity 65 T/hr (min.)	
					Station size of 1501 MW-2000 MW-Capacity 50 T/hr (min.)	
					Station Size of 1000 MW – 1500 MW-Capacity 35 T/hr (min.)	
	The provenness criteria for equipment (Booster Fans) stipulated at Sl. No. 1.2 (a) above shall also be considered acceptable provided the rating parameters (i.e., flow, head and rated rpm) is covered within the operating regime of the respective fan performance curve of the reference plant equipment.					
	LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9		SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 9 OF 19

CLAUSE NO.	INTENT OF SPECIFICATION									
1.3	The provenness criteria for equipment (Slurry Recirculation Pumps) stipulated at Sl. No. 1.2 (b) above shall also be considered acceptable provided the rating parameters (i.e., flow and head) is covered within the operating regime of the respective Slurry Recirculation Pump performance curve of the reference plant equipment. In case the Bidder or the proposed sub-vendor is not manufacturer of proven Booster Fans as per clause 1.2 (a) above but is a manufacturer of such equipment for units of at least * MW rating, the Bidder or the proposed sub vendor shall be considered qualified for manufacturing such equipment for ** MW units also, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such equipment in India with such manufacturer who meets the requirements stipulated at clause 1.2 (a) above for the Booster Fans. For value of * and ** refer table below. <table><tr><td>*</td><td>**</td></tr><tr><td>195 MW</td><td>195 MW – 500 MW</td></tr><tr><td>500 MW</td><td>660 MW</td></tr></table>				*	**	195 MW	195 MW – 500 MW	500 MW	660 MW
*	**									
195 MW	195 MW – 500 MW									
500 MW	660 MW									
1.4	A JV / Subsidiary Company formed for manufacturing and supply of equipment(s) as listed at clause no. 1.2 above in India, shall also be considered qualified for manufacturing such equipment(s), provided that it has a valid collaboration or licensing agreement for design, engineering, manufacturing of such equipment(s) in India with a qualified equipment manufacturer who meets the requirements stipulated at clause 1.2 above (or the technology provider of the qualified equipment manufacturer) for the respective equipment(s). Before taking up the manufacturing of such equipment(s), the bidder/ his sub-vendor(s) must create /have created manufacturing facilities at his works as per collaborator's/licenser's design, manufacturing and quality control system for such equipment(s). Further, in such a case, such qualified equipment manufacturers should have, directly or indirectly through its holding company/ subsidiary company, at least 26% equity participation in the Indian Joint Venture Company/ Subsidiary Company, which shall be maintained for a lock-in period of seven (7) years from the date of incorporation of such Joint Venture/ Subsidiary or upto the end of defect liability period of the contract, whichever is later.									
1.5	In case the Bidder or the proposed sub-vendor is not manufacturer of proven Oxidation Blowers as per clause 1.2 (c) above but is a manufacturer of Blowers/compressors for minimum 50 NM³/min capacity, the Bidder or the proposed sub-vendor shall also be considered qualified for manufactur-ing Oxidation Blowers, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Oxidation Blowers in India with such manufacturer who meets the requirements stipulated at clause 1.2 (c) above for the Oxidation Blowers. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments.									
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 10 OF 19						

CLAUSE NO.	INTENT OF SPECIFICATION	एनटीपीसी NTPC		
1.6	(i) In case the Bidder or the proposed sub-vendor is not manufacturer of proven Wet limestone Grinding mills as per clause 1.2 (d) above but is a manufacturer of dry Grinding mills for power or cement industry of minimum 20 T/h capacity, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Wet limestone Grinding mills, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Wet limestone Grinding mills in India with such manufacturer who meets the requirements stipulated at clause 1.2 (d) above for the Wet limestone Grinding mills. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments. In addition, the Bidder shall be required to furnish a letter of support from Collaborator(s) / Licensor / Technology provider for successful performance of the equipment valid up to the end of defect liability period of the contract as per the format enclosed in the bidding documents, at the time of placement of order on the approved sub-vendor. OR			
1.6	(ii) In case, the bidder or proposed sub vendor is not a manufacturer of proven Wet Limestone Grinding Mills as per clause 1.2 (d) above, but have designed, manufactured & supplied dry Grinding Ball Tube mills for at least 500 MW pulverized coal fired power plant, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Wet limestone Grinding Mills provided it has a licensing agreement with a Wet limestone Grinding mills manufacturer who meets the requirements stipulated at clause 1.2 (d) above for the Wet limestone Grinding mills and provides extended warranty of three (3) years for the Wet Limestone Grinding Mills.			
1.7	In case the Bidder or the proposed sub-vendor is not manufacturer of proven Agitators as per clause 1.2 (f) above but is a manufacturer of Agitators for similar process/duty application in petrochemical or metals and mining industry, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Agitators, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such Agitators in India with such manufacturer who meets the requirements stipulated at clause 1.2 (f) above for the Agitators. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his works as per collaborator's /licenser's design, manufacturing and quality control system for such equipments.			
1.8	In case the Bidder or the proposed sub-vendor is a manufacturer of Slurry Pumps who meets the requirements stipulated at clause 1.2 (e) above, the Bidder or the proposed sub-vendor shall also be considered qualified for manufacturing Slurry Recirculation Pumps, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such equipment in India with such manufacturer who meets the requirements stipulated at clause 1.2 (b) above for the Slurry Recirculation Pumps. Before taking up the manufacturing of such equipment, the bidder/ his sub-vendor must create /have created manufacturing facilities at his			
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-I INTENT OF SPECIFICATION	PAGE 11 OF 19

एनटीपीसी
NTPC

CLAUSE NO.	INTENT OF SPECIFICATION							
2.4	In case Bidder or its agency do not meet the requirements at 2.1 and the Bidder proposes to engage agency (ies) for civil & structural works on work volume basis (except for Chimney), Bidder or its agency (ies) should have executed such works in the past and the annual rate of execution in the reference works should not be less than eighty percent (80%) of the asking rate of such works, (structural steel fabrication, erection, RCC, earthwork in filling involving mechanical compaction and cutting in hard rock, piling, RCC in underground storage hopper and underground tunnels) for which it is being engaged. Successful Bidder shall finalize the agency (ies) for each work in consultation with Engineer-in-charge at site before engaging them. Design agency for Civil & Steel Structural Works:							
2.5	Bidder or its agency (ies) should have carried out the design and detailed engineering of following works: (i) Civil & Structural works associated with at least one bulk material handling plant for * or higher capacity coal based/Lignite based power plant (applicable for project having ** MW unit rating). (ii) For Chimney, Bidder or its design agency (ies) should have carried out design & detailed engineering of at least one reinforced concrete chimney with steel flues, of minimum 100m height. (iii) Machine foundations such as Mill foundations/ Block foundations.							
2.6	Bidder can engage more than one agency (of repute), in case the Bidder itself is not able to meet the requirement at 2.5. The design agency (ies) proposed by the Bidder shall be subject to Employer's approval. NOTE:- For value of “*”and “**” refer table below:- <table><tr><td>*</td><td>**</td></tr><tr><td>195 MW</td><td>195 MW – 500 MW</td></tr><tr><td>500 MW</td><td>660 MW</td></tr></table>	*	**	195 MW	195 MW – 500 MW	500 MW	660 MW	
*	**							
195 MW	195 MW – 500 MW							
500 MW	660 MW							
LOT-3 PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(3)-9	SUB-SECTION-I INTENT OF SPECIFICATION						
PAGE 13 OF 19								

**FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE
FOR
LOT-3 PROJECTS
BIDDING DOCUMENT NO. CS-0011-109(3)-9**

Bidder's Name and Address:

To
Contract Services-III
NTPC Limited
Noida-201301

Summary of Critical Equipment indicated under clause 4.01.00, sub-section-I, Part-A of Section-VI.

Equipment Name	Sub-Vendor Name	Collaborator's Name, if applicable	Seeking Qualification as per clause..... Sub-Section-I, Part-A of Section-VI
Booster Fans			*4.01.01 / *4.01.02 / *4.01.03
*Slurry Recirculation Pumps			*4.01.01 / *4.01.03 / *4.01.07
Oxidation Blowers			*4.01.01 / *4.01.03 / *4.01.04
Wet limestone Grinding mills			*4.01.01 / *4.01.03 / *4.01.05 (i)/ 4.01.05 (ii)
Slurry Pumps			*4.01.01 / *4.01.03
Agitators			*4.01.01 / *4.01.03 / *4.01.06
Vacuum Belt filters			*4.01.01 / *4.01.03

Note : *Strike-off whichever is not applicable.

Signature of authorized signatory.....

1. If qualification sought as per clause 4.01.01, sub-section-I-A, Part-A of Section-VI then the details of the sub vendor (manufacturer) shall be filled by the bidder in the format A to G.
- ~~2. If the qualification sought as per the clause 4.01.02, sub-section-I-A, Part-A of Section-VI, then the details of proposed sub vendor (i.e manufacturer of such equipment for at least *195/*250/*500/*660 MW unit rating) shall be filled individually by the bidder in the format A and the details of collaborator who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI shall also be filled by the bidder in the format A separately. Further, in case of qualification vide clause 4.01.02, sub-section-I-A, Part-A of Section-VI a copy of valid ongoing collaboration and technology transfer agreement for design, engineering, manufacturing, supply of such equipment in India with the collaborator who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI shall also be furnished.~~
3. If the qualification sought as per the clause 4.01.03, sub-section-I-A, Part-A of Section-VI then the details of JV/Subsidiary Company formed for manufacturing of such equipment in India shall be furnished individually for each equipment by the bidder such as,
 - i) Copy of document of incorporation of JV/Subsidiary company in India
 - ii) Copy of valid ongoing collaboration and technology transfer agreement for design, engineering, manufacturing, supply of such equipment in India with the collaborator who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI.
 - iii) Copy of document of at least 26% equity participation of qualified equipment manufacturer in the Indian JV company/subsidiary company directly or indirectly through its holding company /Subsidiary company, which shall be maintained for a lock -in period of seven (7) years from the date of incorporation of such JV/subsidiary or up to the end of defect liability period of the contract which ever is later.

Further, the details of collaborator or technology provider of the qualified equipment manufacturer who meets the requirement stipulated at 4.01.01, sub-section-I-A, Part-A of Section-VI shall be filled by the Bidder in the format A to G (format given at 1.00.00). In addition to that, the sub vendor along with the Indian JV company/subsidiary company, qualified equipment manufacturer and its holding company/subsidiary company as applicable shall furnish the Letter of Support as per the format enclosed at Annexure-I.

*** strike out whichever is not applicable.**

- 1.00.00 (Applicable for Bidder/his sub vendors seeking qualification as per clause no. 4.01.01, Sub section-I, Part-A of Section-VI. Bidder shall furnish the required data only for those equipments / auxiliaries which are proposed to be sourced under this route.)

Signature of authorized signatory.....

We, hereby furnish the data on proveness criteria for critical equipment, auxiliaries, systems and Bought Out Items such as Booster Fans, *Slurry Recirculation Pumps, Oxidation Blowers, Wet Limestone Grinding Mills, Slurry Pumps, & Agitators which have been designed (either by self manufacturer or under valid ongoing collaboration and technology transfer agreement), *manufactured/ *got manufactured and supplied by us /Manufacturer (or manufactured/ got manufactured & supplied by our proposed sub-vendors) and these are in successful operation in at least one (1) plant for a period not less than one year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder. The details of type and minimum equipment rating of such equipment are given below :

A. For Booster Fans: We declare that, we/our Sub-Vendor, have designed (either by itself or under collaboration / licensing agreement), *manufactured/*got manufactured and supplied at least one (1) number of Booster Fan of required flow & head of the offered Booster Fan with Fan Speed 900 rpm (maximum), Axial type with variable pitch control working in a Coal fired power plant and which has been in successful operation for minimum one(1) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder, as per the details furnished below:

Sl. No.	Description	Reference Work
1.	Name of the reference plant & location:	
2.	Client name and his address:	
3.	No. of units and capacity in MW of unit:	
4.	Whether equipment operating in a coal fired power plant	- *Yes/*No
5.	Name of equipment manufacturer & address:	

Signature of authorized signatory.....

F. Agitators: We declare that, we/our Sub-Vendor, have designed (either by itself or under collaboration / licensing agreement),*manufactured/*got manufactured and supplied at least one (1) number of Agitators with rating not less than that supplied for 500 MW or higher size unit for similar application, Vertical/Horizontal type working in Wet Limestone based FGD application in Coal fired power plant and which has been in successful operation for minimum one(1) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder, as per the details furnished below::

Sl. No.	Description	Reference Work
1.	Name of the reference plant & location:	
2.	Client name and his address:	
3.	No. of units and capacity in MW of unit:	
4.	Whether power plant is coal fired	-*Yes/*No
5.	Whether operating in a Wet Limestone based FGD application in coal fired power plant	-*Yes/*No
6.	Name of equipment manufacturer & address:	
7.	Date of commission of the equipments:	
8.	Model no. of the equipment:	
9.	Brief Technical particulars of the equipments:	
10.	Agitators supplied for	MW unit size

Signature of authorized signatory.....

Sl. No.	Description	Reference Work
11.	Whether the equipment(s) are in successful operation in atleast one(01) plant for a period not less than one(01) year reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder	-*Yes/*No
12.	Flue gas Desulphurization system details:	*Technical extract/ *paper letter/ *email/ *Drwaing from user or *contract document or *scheme or *any document in public domain enclosed at annexure....to Attachment-3K
13.	Scope of Work:	*Letter of Award or *Contract or *P.O. enclosed at Annexure.....to Attachment-3K
14.	Performance details:	*Certificate/*Letter/*E-mail from End user enclosed at Annexure.....to Attachment-3K

* Strike off whichever is not applicable.

Signature of authorized signatory.....

***7.00.00** **Applicable for Bidder/his sub vendors seeking provenness criteria as per clause no. 4.01.06, Sub section-I, Part-A of Section-VI.**

7.01.00 We, hereby confirm that *we/*our sub-vendors is a manufacturer of a manufacturer of Agitators for similar process/duty application in petrochemical or metals and mining industry. (Details of references enclosed at Annexure)

(Data to be furnished in line with format given at 1.00.00 of this Attachment))

7.02.00 We further confirm that details in respect of collaboration / valid licencing agreement for the Agitator between *us/*our sub-vendors, as per 6.01.00 above, and with qualified Agitator manufacturer, who meets the requirement stipulated at clause **4.01.01**, sub-section-I, Part-A, Section-VI are enclosed at **Annexure-.....** to this Attachment. The data in respect of provenness criteria for the qualified Agitator manufacturer, which is in successful operation in at least one (1) plant for a period not less than one reckoned as on the date of consideration for approval but not later than six months to award date of contract to the Main bidder are furnished below.

We further confirm that before taking up the manufacturing of such Agitator, *we/ *our sub vendor(s) *will create /*have created manufacturing facilities at his works as per collaborator's/licenser's design, manufacturing and quality control system.

(Data to be furnished in line with format given at 1.00.00 of this Attachment)

Signature of authorized signatory.....
354 of 354