


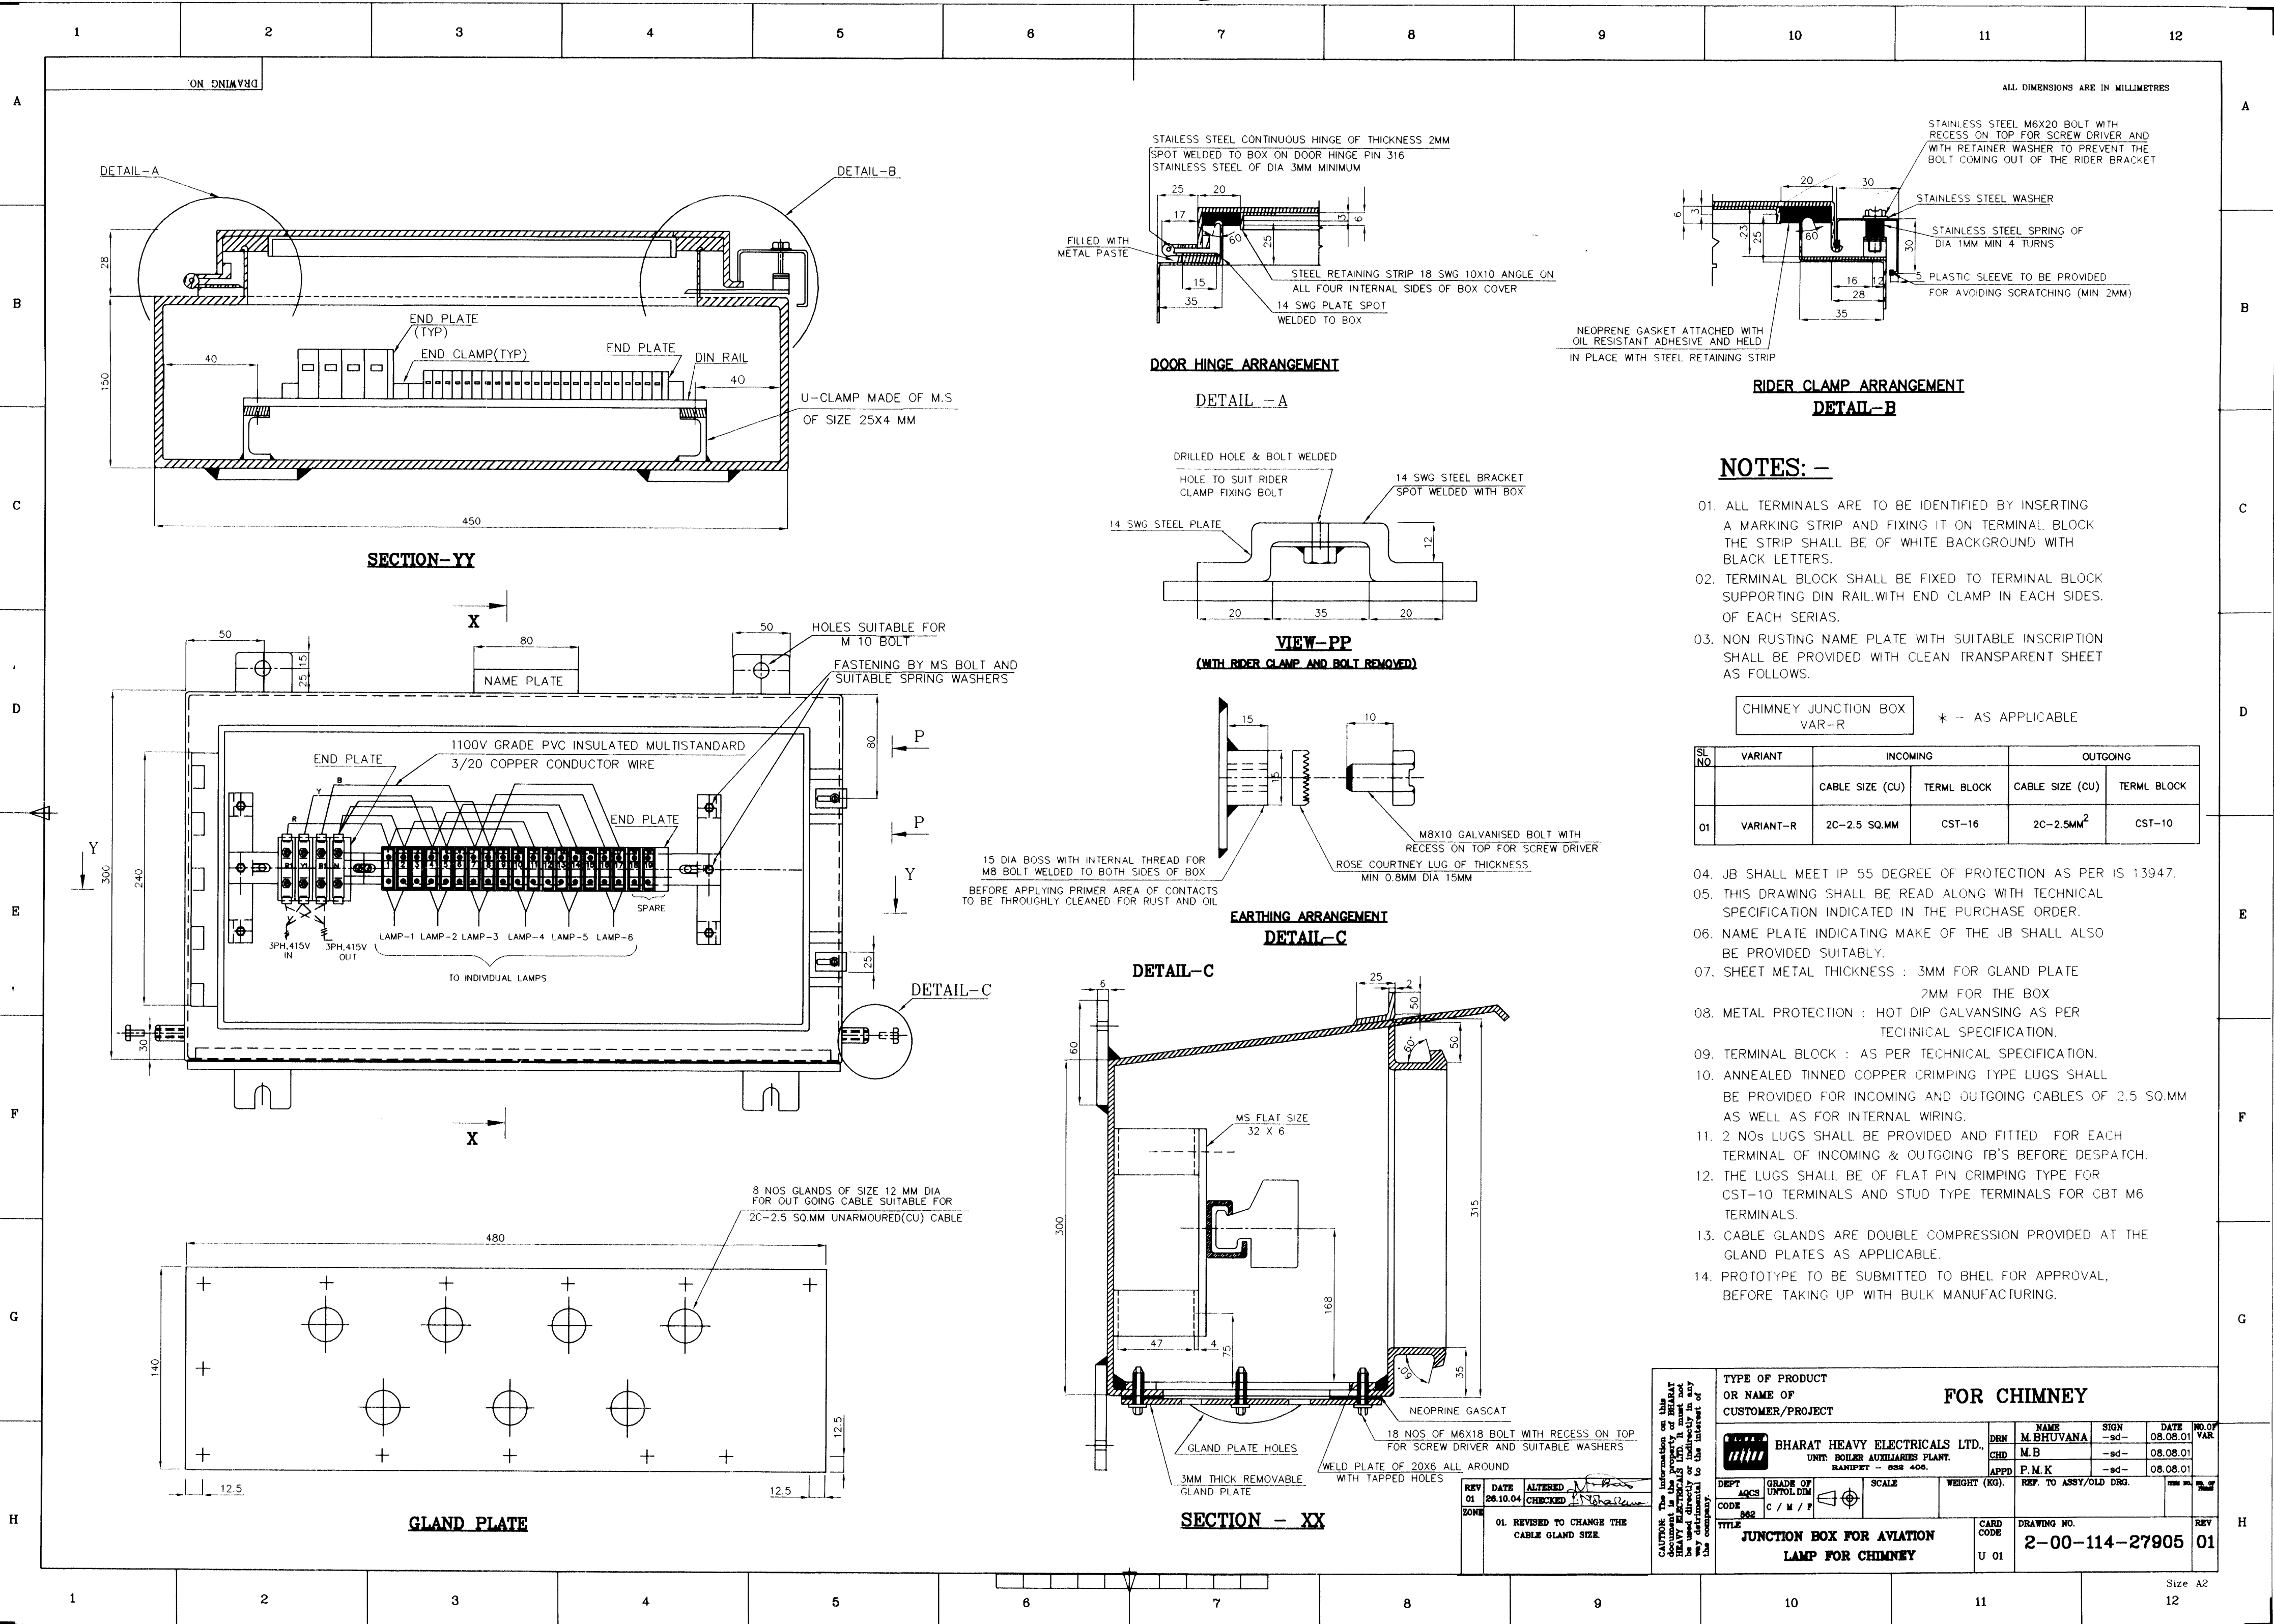

NOTES:-

- 01. ALL TERMINALS ARE TO BE IDENTIFIED BY INSERTING A MARKING STRIP AND FIXING IT ON TERMINAL BLOCK THE STRIP SHALL BE OF WHITE BACKGROUND WITH BLACK LETTERS.
- 02. TERMINAL BLOCK SHALL BE FIXED TO TERMINAL BLOCK SUPPORTING DIN RAIL WITH END CLAMP IN EACH SIDES OF EACH SERIES.
- 03. NON RUSTING NAME PLATE WITH SUITABLE INSCRIPTION SHALL BE PROVIDED WITH CLEAN TRANSPARENT SHEET AS FOLLOWS.

CHIMNEY JUNCTION BOX
VAR-R

* -- AS APPLICABLE

SL NO	VARIANT	INCOMING		OUTGOING	
		CABLE SIZE (CU)	TERML BLOCK	CABLE SIZE (CU)	TERML BLOCK
01	VARIANT-R	2C-2.5 SQ.MM	CST-16	2C-2.5MM ²	CST-10

- 04. JB SHALL MEET IP 55 DEGREE OF PROTECTION AS PER IS 13947.
- 05. THIS DRAWING SHALL BE READ ALONG WITH TECHNICAL SPECIFICATION INDICATED IN THE PURCHASE ORDER.
- 06. NAME PLATE INDICATING MAKE OF THE JB SHALL ALSO BE PROVIDED SUITABLY.
- 07. SHEET METAL THICKNESS : 3MM FOR GLAND PLATE 2MM FOR THE BOX
- 08. METAL PROTECTION : HOT DIP GALVANISING AS PER TECHNICAL SPECIFICATION.
- 09. TERMINAL BLOCK : AS PER TECHNICAL SPECIFICATION.
- 10. ANNEALED TINNED COPPER CRIMPING TYPE LUGS SHALL BE PROVIDED FOR INCOMING AND OUTGOING CABLES OF 2.5 SQ.MM AS WELL AS FOR INTERNAL WIRING.
- 11. 2 NOS LUGS SHALL BE PROVIDED AND FITTED FOR EACH TERMINAL OF INCOMING & OUTGOING TB'S BEFORE DESPATCH.
- 12. THE LUGS SHALL BE OF FLAT PIN CRIMPING TYPE FOR CST-10 TERMINALS AND STUD TYPE TERMINALS FOR CBT M6 TERMINALS.
- 13. CABLE GLANDS ARE DOUBLE COMPRESSION PROVIDED AT THE GLAND PLATES AS APPLICABLE.
- 14. PROTOTYPE TO BE SUBMITTED TO BHEL FOR APPROVAL, BEFORE TAKING UP WITH BULK MANUFACTURING.


CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any form without the written consent of the company.

TYPE OF PRODUCT OR NAME OF CUSTOMER/PROJECT		FOR CHIMNEY						
	BHARAT HEAVY ELECTRICALS LTD., UNIT. BOILER AUXILIARIES PLANT, RAIPUR - 552 405.			DRN	NAME M. BHUVANA	SIGN	DATE 08.08.01	NO. OF VAR.
				CHD	M. B		08.08.01	
				APPD	P. M. K		08.08.01	
DEPT AGCS	GRADE OF UNTOLO DIM	SCALE	WEIGHT (KG).	REF. TO ASSY/OLD DRG.			REV	REV
562	C / M / F							
TITLE				CARD CODE	DRAWING NO.			REV
JUNCTION BOX FOR AVIATION LAMP FOR CHIMNEY				U 01	2-00-114-27905			01


ELECTRICALS LTD. it must not be used in any way detrimental to the interest of the company.

REV	DATE	ALTERED
		CHECKED

ALL DIMENSIONS ARE IN MILLIMETRES

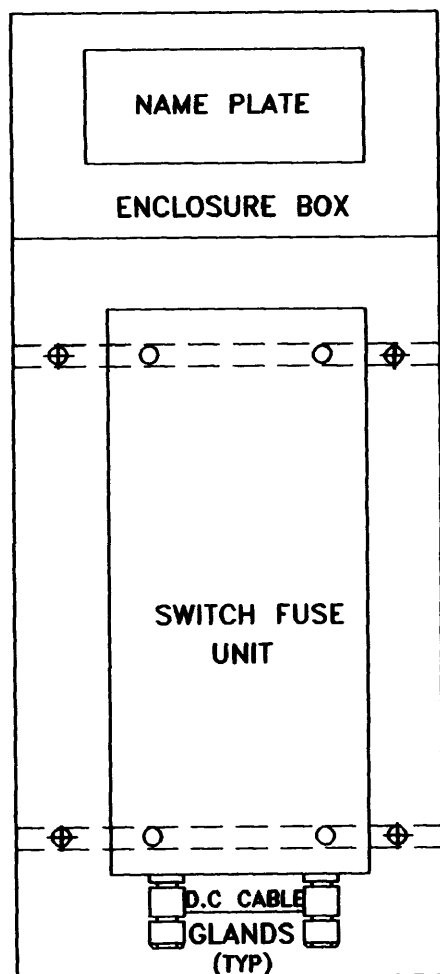

ELEVATION

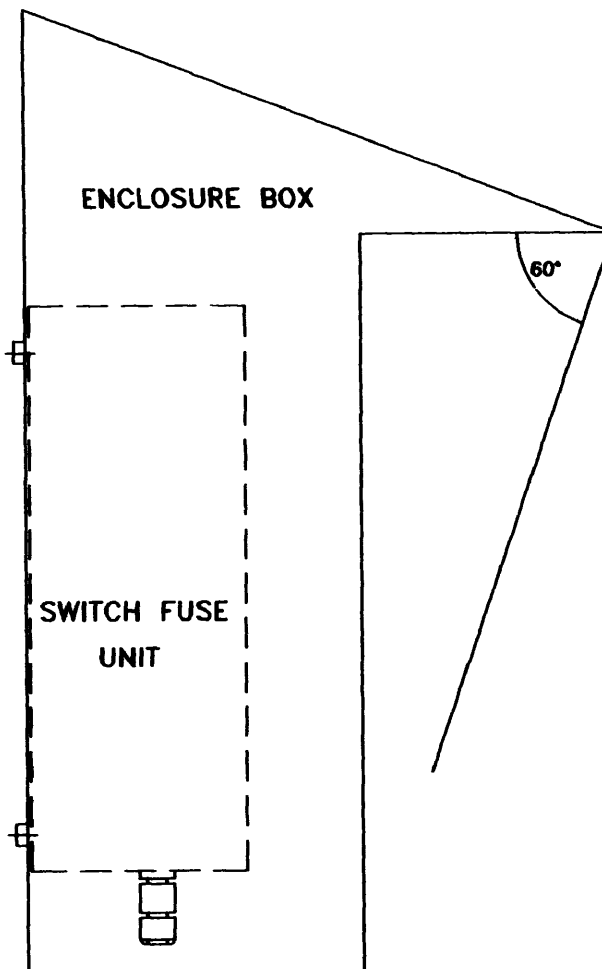

END VIEW

NOTE:-

1. THE ENCLOSURE BOX SHALL BE MADE OF 2mm COLD ROLLED SHEET STEEL.
2. THE BOX SHALL BE PAINTED WITH EPOXY RED AFTER RED OXIDE.
3. 3mm STIFFNER PLATE SHALL WELDED AT THE BACK FOR MOUNTING THE SWITCH FUSE UNIT AND FOR MOUNTING THE BOX.
4. NECESSARY FASTNERS(GALVANISHED) SHALL BE SUPPLIED FOR MOUNTING THE SWITCH FUSE UNIT & ENCLOSURE COVER.
- 5."AVIATION LAMP SWITCH BOX" NAME PLATE SHALL BE PROVIDED ON THE BOX.

		BHARAT HEAVY ELECTRICALS LTD., UNIT: BOILER AUXILIARIES PLANT. RANIPET - 632 406.		DRN	NAME M. BOOPATHY	SIGN <i>M. Boopathy</i>	DATE 02.03.2000	NO. OF VAR
				CHD	P.M.K	<i>P. Mohalekumar</i>	03.03.2000	
				APPD	P.M.K	<i>P. Mohalekumar</i>	03.03.2000	
DEPT AQCS CODE 862	GRADE OF UNTOL DIM C / M / F		SCALE NTS	WEIGHT (KG). ---	REF. TO ASSY./OLD DRG. ---		ITEM NO.	NO. OF ITEMS
TITLE AVIATION LAMP SWITCH FUSE UNIT ENCLOSURE BOX				CARD CODE U 01	DRAWING NO. 4-87-930-80094			REV 00

Size A4

ANNEXURE – A2 TO ENQUIRY
REQUIREMENT OF TECHNICAL DETAILS /CONFIRMATION
(To be filled in full and to be submitted along with offer)

S.NO	DESCRIPTION	BHEL'S REQUIREMENT	SUPPLIER'S COMMENTS
01	SPECIFICATION	Clause wise / Point wise confirmation to be given in TOTO for all specifications & to be submitted along with offer. (i.e. Xerox copy of specn duly filled with your acceptance / comments duly signed & sealed).	
02	Specification	AS PER ITEM DESCRIPTION	
03	Quality specification	Not Applicable	
04	Drawings	4-87-930-80094/00 & 2-00-114-27905/01	
05	SPECIFICATION DEVIATION DISPOSITION REPORT (SDDR)	Attached SDDR to be filled & submit along with offer.[In case of NO deviation is taken, NIL report to be submitted]	

Date:

VENDOR's SIGNATURE WITH SEAL

(To be submitted along with the offer)

SPECIFICATION DEVIATION DISPOSITION REPORT			
Specn			Item
Enq.No & Date			
Vendor Name			
SPECN			
Page	Clause	Details Of Deviation With Reason	Disposition By BHEL
Signature Of Vendor			Reviewed By
"AGREED DEVIATION " if any to be incorporated in the PO in the event of order.			APPROVED BY

The above Commercial Terms and Conditions are confirmed by us for this tender. In case there is a variance between the conditions confirmed above and the main offer, we certify that the Commercial Terms and Conditions given above is applicable. Such Commercial Terms and Conditions in the main offer may be considered null and void by the Purchaser and this is accepted by us.

Date:

VENDOR's SIGNATURE WITH SEAL