


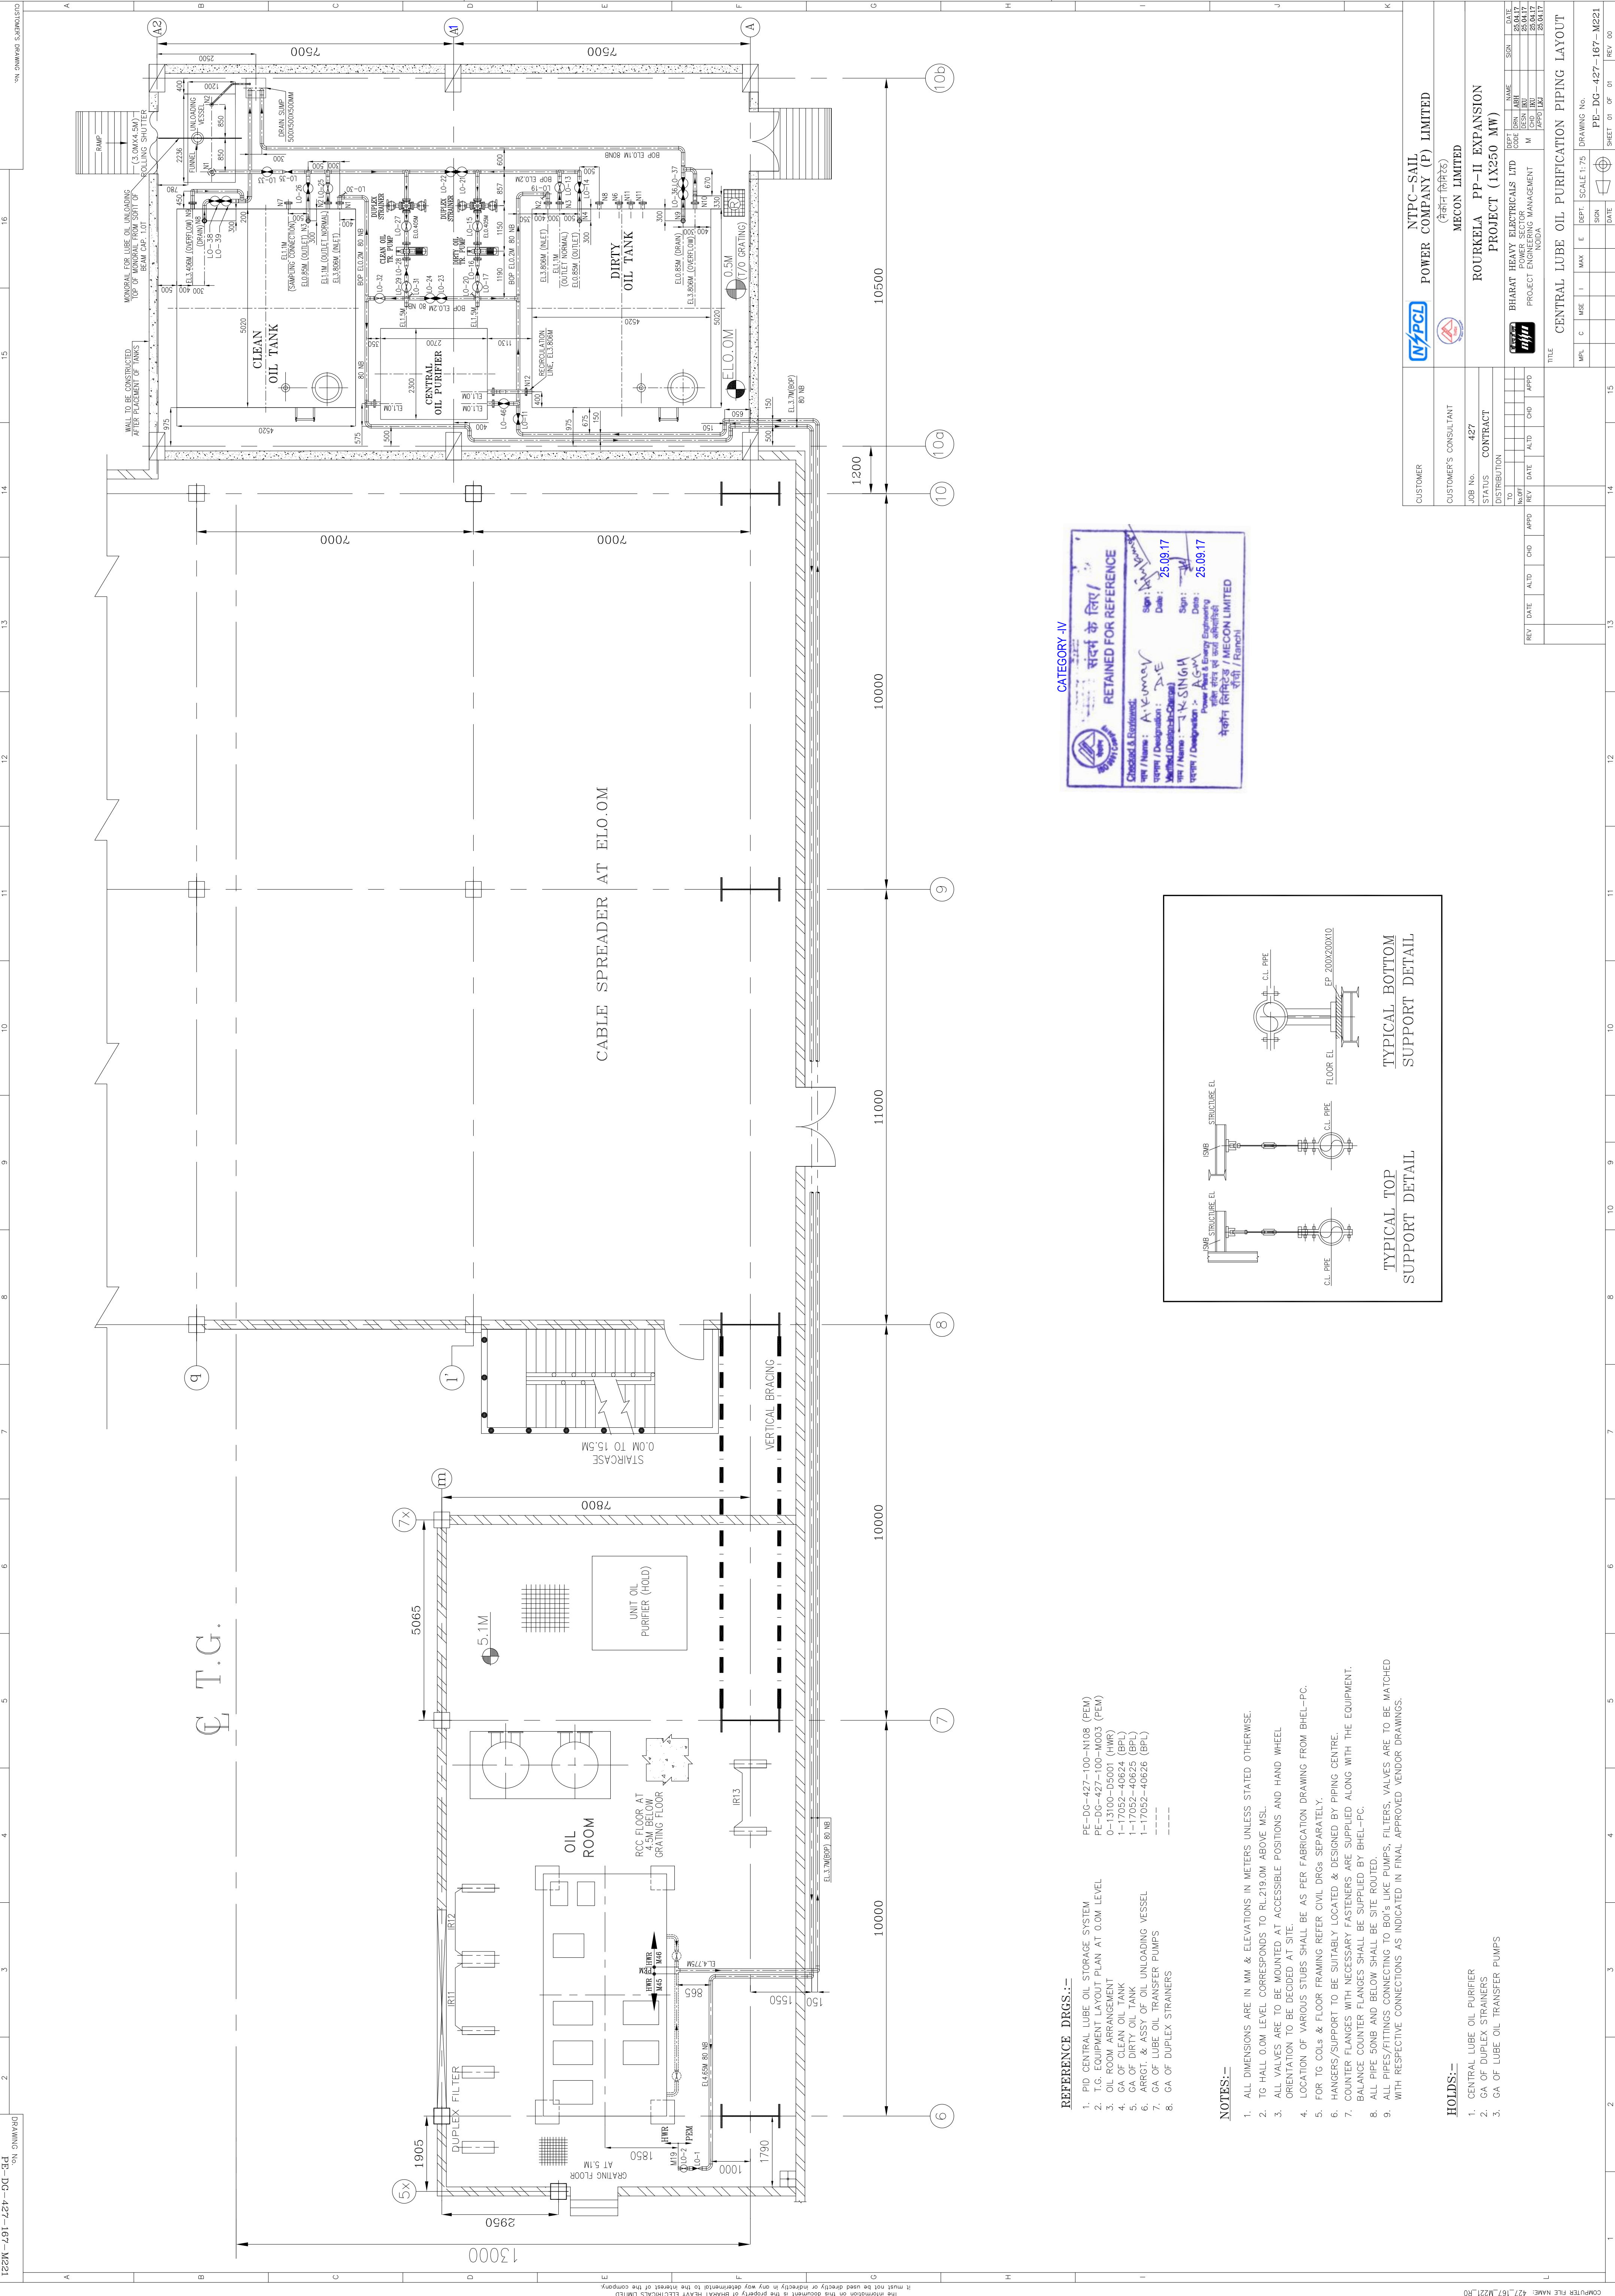

REFERENCE DRGS.:-

- 1. PID CENTRAL LUBE OIL STORAGE SYSTEM PE-DG-427-100-N108 (PEM)
- 2. T.G. EQUIPMENT LAYOUT PLAN AT 0.0M LEVEL PE-DG-427-100-M003 (PEM)
- 3. OIL ROOM ARRANGEMENT 0-13100-D5001 (HWR)
- 4. GA OF CLEAN OIL TANK 1-17052-40624 (BPL)
- 5. GA OF DIRTY OIL TANK 1-17052-40625 (BPL)
- 6. ARROT. & ASSY OF OIL UNLOADING VESSEL 1-17052-40626 (BPL)
- 7. GA OF LUBE OIL TRANSFER PUMPS ----
- 8. GA OF DUPLEX STRAINERS ----

NOTES:-

- 1. ALL DIMENSIONS ARE IN MM & ELEVATIONS IN METERS UNLESS STATED OTHERWISE.
- 2. TG HALL 0.0M LEVEL CORRESPONDS TO RL.219.0M ABOVE MSL.
- 3. ALL VALVES ARE TO BE MOUNTED AT ACCESSIBLE POSITIONS AND HAND WHEEL ORIENTATION TO BE DECIDED AT SITE.
- 4. LOCATION OF VARIOUS STUDS SHALL BE AS PER FABRICATION DRAWING FROM BHEL-PC.
- 5. FOR TG COLS & FLOOR FRAMING REFER CIVIL DRGS SEPARATELY.
- 6. HANGERS/SUPPORT TO BE SUITABLY LOCATED & DESIGNED BY PIPING CENTRE.
- 7. COUNTER FLANGES WITH NECESSARY FASTENERS ARE SUPPLIED ALONG WITH THE EQUIPMENT. BALANCE COUNTER FLANGES SHALL BE SUPPLIED BY BHEL-PC.
- 8. ALL PIPE SONE AND BELOW SHALL BE SITE ROUTED.
- 9. ALL PIPES/FITTINGS CONNECTING TO BOT'S LIKE PUMPS, FILTERS, VALVES ARE TO BE MATCHED WITH RESPECTIVE CONNECTIONS AS INDICATED IN FINAL APPROVED VENDOR DRAWINGS.

HOLDS:-

- 1. CENTRAL LUBE OIL PURIFIER
- 2. GA OF DUPLEX STRAINERS
- 3. GA OF LUBE OIL TRANSFER PUMPS

CATEGORY-IV

