


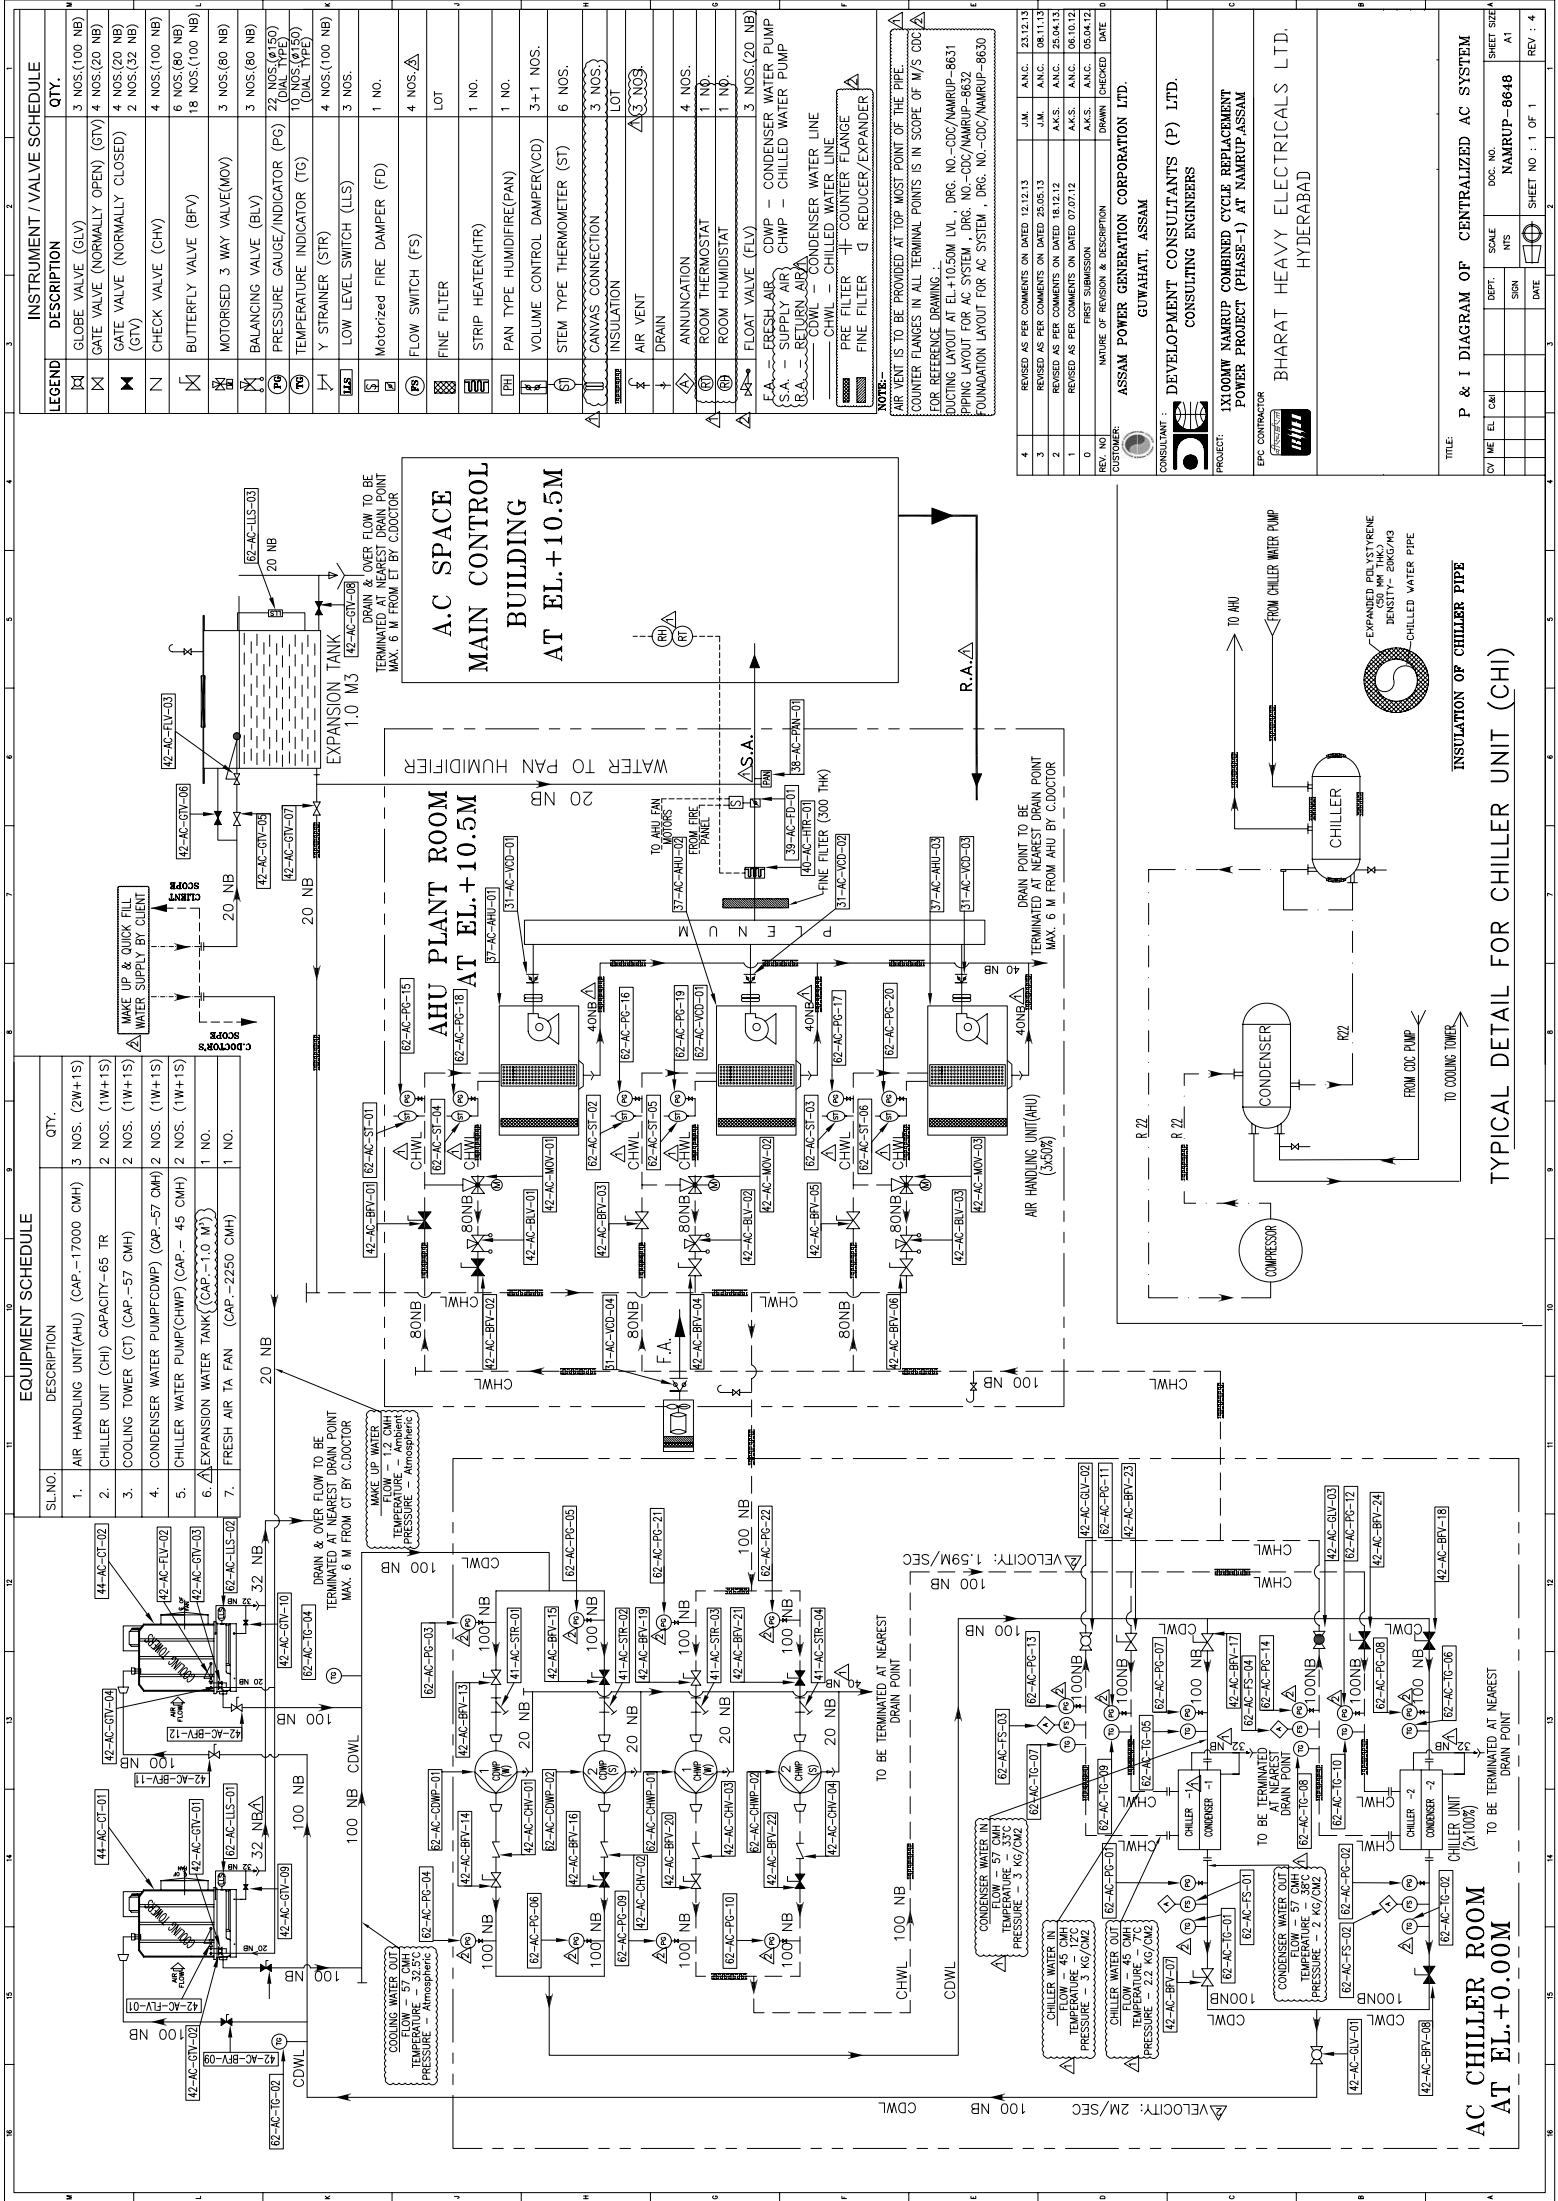

EQUIPMENT SCHEDULE		
SL.NO.	DESCRIPTION	QTY.
1.	AIR HANDLING UNIT(AHU) (CAP-17000 CMH)	3 NOS. (2W+1S)
2.	CHILLER UNIT (CHI) CAPACITY-65 TR	2 NOS. (1W+1S)
3.	COOLING TOWER (CT) (CAP-57 CMH)	2 NOS. (1W+1S)
4.	CONDENSER WATER PUMP(CDWP) (CAP-57 CMH)	2 NOS. (1W+1S)
5.	CHILLER WATER PUMP(CHWP) (CAP-45 CMH)	2 NOS. (1W+1S)
6.	EXPANSION WATER TANK (CAP-1.0 M ³)	1 NO.
7.	FRESH AIR TA FAN (CAP-2250 CMH)	1 NO.

INSTRUMENT / VALVE SCHEDULE		
LEGEND	DESCRIPTION	QTY.
GV	GLOBE VALVE (GV)	3 NOS.(100 NB)
GV	GATE VALVE (NORMALLY OPEN) (GV)	4 NOS.(20 NB)
GV	GATE VALVE (NORMALLY CLOSED) (GV)	2 NOS.(20 NB)
GV	GATE VALVE (NORMALLY CLOSED) (GV)	4 NOS.(32 NB)
CV	CHECK VALVE (CV)	4 NOS.(100 NB)
CV	CHECK VALVE (CV)	6 NOS.(80 NB)
CV	CHECK VALVE (CV)	18 NOS.(100 NB)
CV	CHECK VALVE (CV)	3 NOS.(80 NB)
CV	CHECK VALVE (CV)	3 NOS.(80 NB)
CV	CHECK VALVE (CV)	22 NOS.(150 NB)
CV	CHECK VALVE (CV)	10 NOS.(150 NB)
CV	CHECK VALVE (CV)	4 NOS.(100 NB)
CV	CHECK VALVE (CV)	3 NOS.

EQUIPMENT SCHEDULE		
SL.NO.	DESCRIPTION	QTY.
1.	AIR HANDLING UNIT(AHU) (CAP-17000 CMH)	3 NOS. (2W+1S)
2.	CHILLER UNIT (CHI) CAPACITY-65 TR	2 NOS. (1W+1S)
3.	COOLING TOWER (CT) (CAP-57 CMH)	2 NOS. (1W+1S)
4.	CONDENSER WATER PUMP(CDWP) (CAP-57 CMH)	2 NOS. (1W+1S)
5.	CHILLER WATER PUMP(CHWP) (CAP-45 CMH)	2 NOS. (1W+1S)
6.	EXPANSION WATER TANK (CAP-1.0 M ³)	1 NO.
7.	FRESH AIR TA FAN (CAP-2250 CMH)	1 NO.