

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	

ANNEXURE V

**CONTROL AND INSTRUMENTATION
FOR
NATURAL DRAUGHT COOLING TOWER**

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	

Specific Technical Requirements (C&I):

- 1.1 Bidder to supply the following items as a minimum
- i) One no. Pressure Gauge and One no. Temp Gauge at Hot Water pipe header at T.P..
 - ii) One no. of Anemometer for measurement of wind velocity.
 - iii) One no. of Psychrometer.
 - iv) Removable type Pitot Tube at each hot water inlet- piping header to measure the flow (during performance Guarantee test only). The Pitot Tube shall be left with customer after the completion of the test.
 - v) Local Control Panel for Sump Pumps (Submersible Type).
 - vi) Level switches for sump/tank level high/normal/low/very low interlocks.
- 1.2 The detailed specification of instruments is given in detail as below.
- 1.3 The make/model of various instruments/items/systems shall be subject to approval of owner/purchaser during detailed engineering stage. No commercial implication in this regard shall be acceptable. In case of any conflict and repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
- 1.4 Drawings/Documents and data to be furnished after award of the contract as per deliverables list.

**SPECIFIC TECHNICAL REQUIREMENTS (C&I)
NATURAL DRAUGHT COOLING TOWER****MEASURING INSTRUMENTS**

- 1.1 All field instruments shall be weatherproof, drip tight, dust tight and splash proof suitable for use under outdoor ambient conditions prevalent in the subject plant. All field-mounted instruments shall be mounted in suitable locations where maximum accessibility for maintenance is achieved. The enclosures of all electronic instruments shall conform to IP-65 unless otherwise specified (Explosion proof for NEC article 500, class 1, Division 1 area & flame proof) and an anti corrosive paint shall be applied to the field mounted enclosures / instruments. All the field instruments shall also be provided with SS tag nameplate and double compression type Nickel-plated brass cable gland. Gaskets, Fasteners, Counter and mating flange shall also be included wherever required with the field instruments.
- 1.2 All local gauges as well as transmitters, sensors and switches for parameters like pressure, temperature, level, flow etc. as required for the safe and efficient operation and maintenance under the scope of specification shall be provided. The necessary root valves, impulse piping, drain cock, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting / erection of these local instruments shall be furnished even if not specifically asked for. The proposal shall include the necessary cables, flexible conduits, junction boxes and accessories for the above purpose. Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kg / Cm².
- 1.3 All primary instruments installed at “minus level or Floor” shall be with protection class of IP 68.
- 1.4 All field mounted push button, selector switch etc. shall be as per IEC or NEMA 4X protection.
- 1.5 All limit switch shall be conform to IEC-60947-5-1.
- 1.6 Field switches will be micro switch type with auto reset. Switches will have NO and NC contacts. Switch contacts shall be snap acting, 2 Nos of SPDT, hermetically sealed, potential-free with a minimum contact rating of 230 V AC 5A/ 24V DC 1A.

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
1.7	All Field Instruments used in acid or alkaline atmosphere shall be with standard Anti corrosion coating i.e. the combination of Polyurethane and epoxy resin baked coating (ANSI/ISA-71.04).	
1.8	All wetted parts of instrument shall be suitable for sea water application (Duplex stainless steel or better).	
1.9	Painting of I & C equipment: Epoxy coating required for all I & C equipment.	
2.0	All valve actuator shall be provided with conventional actuators with integral starter for ON/OFF valves. The detailed specification of actuator is given in detail as below.	
2.1	These requirements are to be read in conjunction with detail Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre-bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of Customer shall prevail without any commercial implication.	

2X660 MW TANGEDCO UDANGUDI STAGE-I STPP

**SPECIFIC TECHNICAL REQUIREMENTS (C&I)
NATURAL DRAUGHT COOLING TOWER**

C&I DELIVERABLES LIST

C&I DELIVERABLES LIST FOR NDCT		
Sl.No.	DRAWING NO.	DRAWING/DOCUMENT TITLE
INSTRUMENTATION		
1	PE-V9-435-165-I901	INSTRUMENT DATA SHEETS
3	PE-V9-435-165-I903	INSTRUMENT QP / CHECK LIST
RELAY BASED LCP		
1	PE-V9-435-165-I950	LOCAL CONTROL PANEL DATA SHEET
2	PE-V9-435-165-I951	WIRING DIAGRAM
3	PE-V9-435-165-I952	PANEL GA DRAWING
7	PE-V9-435-165-I956	BILL OF MATERIAL
8	PE-V9-435-165-I957	LOCAL CONTROL PANEL QUALITY PLAN
9	PE-V9-435-165-I958	RELAY BASED PANEL O & M MANUAL

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
FIELD & MEASURING INSTRUMENTS		

1.0.0 TECHNICAL REQUIREMENT FOR INSTRUMENTATION

1.1.0 Field Instruments

- a) Analog outputs signals from field instrumentation to the control systems are 4-20 Ma DC signals. Instrumentation can be self-powered, or loop powered from the control systems. Self-powered analog signals shall be true “isolated from ground” signals.
- b) Field switches will be micro switch type with auto reset. Switches will have NO and NC contacts. Switch contacts shall be snap acting, 2 Nos of SPDT, hermetically sealed, potential-free with a minimum contact rating of 230 V AC 5A/ 24V DC 1A.

g) All instruments and analyzers shall employ EMI,RF protection in the system design.

h) Instrument tags should be permanently attached to the device. If this is not possible, the instrument tag should be fastened to the instrument with stainless steel wire.



- n) For saline applications and other applications which are corrosive in nature, the wetted part material to be selected which shall meet the process applications, preferably diaphragm seal to be used. Hastelloy C wetted part material and SS316L impulse piping / root valve material to be considered for the above applications.
- o) All field instruments junction boxes & local panels located in hazardous area shall be explosion proof as per the relevant applicable standards.



- f) Pressure gauges will be generally 150mm dial, solid front safety case type with blowout back, 1/2" NPT bottom connection, drawn stainless steel case, 316SS bourdon and socket, stainless steel movement, micrometer pointer. Pulsation dampers will be provided for pulsating pressure services. Liquid filled gauges shall be used for all pump discharges, vibrating or pulsating services. Pigtail ressu shall be used for the steam service where gauges are mounted close to the tap.
- j) All the switches are internally connected and brought to the surface with Amphenol male/female connection. Cabling need not be terminated inside the switch. Cable ends are to be soldered in connector and to be inserted for easy maintenance.
- l) The switches shall have the following:.
- | | | |
|----------------|---|--------------------------|
| Contact rating | : | 230V AC, 5A / 24V DC 1A. |
| Repeatability | : | ±0.5% FSR |
- m) Turn down ratio to be 100:1
- n) Response time for pressure and differential pressure transmitter shall be 100 ms.
- o) Protection for gauges fitted in the vibration lines/equipments shall be provided

1.1.2 Temperature Instrumentation

- a) For temperature up to 300°C 3-wire RTD duplex type, PT 100 type shall be used. For temperature beyond 300°C thermocouples shall be used. Thermocouples shall be manufactured in accordance with the ISA Standard MC96.1, Temperature Measurement Thermocouples. All thermocouples shall be Chromel Alumel (Type K) for $300^{\circ}\text{C} \leq T < 850^{\circ}\text{C}$. R or S type for $T > 850^{\circ}\text{C}$.



- b) The Mv signal of thermocouple shall be used as input to the DCS. Cold junction compensation shall be achieved in the DCS
- c) Thermocouples shall have duplex elements and ungrounded measuring junction.
- e) RTDs of Duplex type furnished by the Supplier shall be of the three-wire type made with 100 ohm platinum resistance elements. They shall be certified to meet the requirements of the International Temperature Scale, calibrated to the IEC-751 standard ($\text{Alpha} = 0.00385 \text{ Ohms/Ohm/}^\circ\text{C}$). The RTDs shall be contained in an insulated material and a sheath or sleeve of stainless steel SS-316 and shall be so mounted that they can withstand the greatest shocks and vibrations that can be imposed upon them in the system piping without deterioration. Specific information shall be furnished concerning type and accuracy of bridge circuits to be used with the RTDs. RTDs shall be directly connected to DCS without any transmitters
- f) Unless specified otherwise, each temperature element and thermometer shall be provided with a 1" socket weld type, 316 stainless steel tapered thermowell suitable for the requirements of the given application. Temperature element process connection shall be $\frac{1}{2}$ NPTM.
- h) Thermocouples will be of duplex MI type in ISA, K(chromel-Alumel), Platinum-Rhodium/Platinum with sheath OD 6 mm. RTD will be Duplex, Pt 100 ohm, 3 wire type as per DIN standard 43760 or equivalent. Thermo wells will be ASME PTC 19.3 latest revision with process connection M 33x2 for threaded connection and flanged connection for Air and Gas system & tanks.
- i) Thermowell immersion length will generally be between $\frac{1}{3}$ and $\frac{1}{2}$ the distance to the center of the pipe. Where thermo wells are installed in lines smaller than 4 inches, the piping shall be expanded to 4 inch size to accommodate the thermo well. Thermowell shall be drilled from solid bar stock.
- j) All thermo well in a high velocity line or duct shall have an ASME PTC 19.3 calculation for determination of the wells resonant frequency. Thermo wells that do not meet the acceptance criteria shall be resized or relocated as necessary.
- k) Thermocouple extension wire is to be solid, shielded, twisted pairs.
- m) Dial thermometers shall be bimetallic, minimum 150mm dial, every angle form, hermetically sealed with external recalibration adjustment, $\frac{1}{4}$ " OD SS stem, $\frac{1}{2}$ " NPT connection and SS case.
- o) Temperature gauges shall have $\pm 1\%$ accuracy and overage protection of 125%.



p) Switches shall have the following:

Max. contact rating	:	230V AC, 5A
Repeatability	:	±0.5% FSR
Contact type	:	snap acting
Over all accuracy 0.1% of calibrated span		

q) Protection for gauges fitted in the vibration lines/equipments shall be provided



1.1.4 Level Instrumentation

- a) Differential pressure type level transmitters are electronic, analog 2-wire transmitters with isolated 4-20 Ma dc output signals. Radar and ultrasonic level transmitters will be 24V DC powered, with isolated 4-20 Ma dc output signals powered from the transmitters.
- b) Constant head chambers shall be furnished for all differential pressure-type level transmitters used with pressurized vessels. Reservoir piping connections shall be ½ inch outlet and a ½ inch inlet socket-welded type suitable for the pressure and temperature encountered.
- c) Transparent gauge glasses will be used for low-pressure applications. Transparent or reflex gauges will be used for high-pressure applications. All gauge glasses will be equipped with gauge valves, including a safety ball check.
- d) Level switches shall generally be cage float / Displacer type, rated for ANSI B31.1 requirements.
- e) Non contact type level measurement shall be provided for CW sumps and for CW make-up applications.
- f) Electronic level indicator of discrete type based on electric conductivity of water and steam with 50mm gap between successive electrodes in the measuring range shall be provided in addition to level transmitter. The **vessel** holding electrodes **shall be IBR certified**.

**D. CONTROL BOARD****I. Control ~~Desk / Console~~ Panel Construction**

- | | | |
|------------------------------|---|--|
| 01. Applicable for | : | Indoor Panel, Desk & console. |
| 02. Material of construction | : | Cold rolled steel sheet (Metal and plastic - Heat resistant, shrinkage free for mosaic tiles). |
| 03. Thickness of Sheet | : | a) 3.2 mm for faces supporting instruments / terminals.
b) 2 mm for other sides and top. |
| 04. Construction | : | Welded throughout as per (metallic parts) approved National Standards. |
| 05. i) Corners | : | 7 mm inner radius |
| ii) Dimensional Tolerances | : | a) In height & length - 3 mm
b) In height between adjacent sections - 2 mm.
c) Total for a group - 6 mm |
| 06. Doors | : | Double, recessed, turned back edges |
| i) Thickness of Sheet | : | 2 mm |
| ii) Hinges | : | Stainless steel |
| iii) Door latches | : | Three point type |
| iv) Door gaskets | : | Neoprene rubber on fixed frame to result dust proof / weatherproof enclosure. |
| v) Opening of the doors | : | Outward |
| vi) Louvers | : | With removable wire mesh to ensure dust and vermin proof. |
| 07. Color of interior | : | Glossy white |
| 08. Colour external | : | IS 5 No. 628 (Typical) [To be decided later] |
| 09. Protection of painting | : | Plastic peel coating |
| 10. Gland plates | : | Removable 4 mm thick (bottom) |
| 11. Cable entry | : | Bottom |
| 12. Hardware | : | a) Vibration dampeners
b) Predrilled base channel ISMC - 100 or equivalent for all sides.
c) Stainless steel buff- finished 2 mm thick kick plate for all sides.
d) Stainless steel scratch strips along desk edges fixed with pan-head recessed screws.
e) Rubber strips to ensure air tightness between kick plate and finished floor.
f) Power supply points 5/15 A plug point with indication lamp 5 Nos. |

Panels shall be freestanding type and fabricated preferably from 2.5 mm thick cold rolled steel sheet. Angle iron framework shall use a minimum section of 50 × 50 × 6 mm angle. The finish shall include sand blasting, grinding, chemical cleaning, and surface finishing by suitable filter and two coats of high-grade lacquer with wet sanding between coats. Two coats of paint in panel color shall be given for non-glossy high stain finish. Panel face final color in general shall be RAL 7035. A final coat of paint shall be given at site. Panels shall have removable hinged doors, generally at the back for easy maintenance and accessibility of the instruments. Doors shall be double leaved type with handle and shall be provided with lock and key. Adequate illumination shall be provided inside the panel. All light fittings shall be suitable for 230V, 50Hz A.C. The local panel construction shall be suitable for the site condition and shall meet IEC requirements in accordance with electrical area classification. Pressurization or purging shall be as per NFPA 496 or equivalent. No process fluid except air shall be piped to the control panel.



E. Pressure Gauge and Differential Pressure Gauge

- | | | | |
|-----|-----------------------|---|--|
| 01. | Type | : | Bourdon/Bellows/Diaphragm |
| 02. | MOC Sensing & Socket | : | AISI-316 SS |
| 03. | Movement Material | : | AISI-304 SS |
| 04. | Case Material | : | Stainless steel casing bayonet type. Enclosure IP-65. |
| 05. | Dial Size | : | Generally 150 mm (100 mm for SWAS gauges) |
| 06. | Scale | : | Black lettering on white background in 270 Deg. arcs. |
| 07. | Window | : | shatterproof toughened glass |
| 08. | Range Selection | : | Normal process pressure – 50 ~ 70 % of range (approximately). |
| 09. | Over-range Protection | : | 125% of maximum range by internal stop. External stop at zero |
| 10. | Adjustment | : | Micrometer screw for zero adjustment. Internal micrometer screw for range adjustment. |
| 11. | Element Connection | : | Argon welding |
| 12. | Process Connection | : | 1/2" NPT (M) Bottom connection for local mounting, back connection for panel mounting. |
| 13. | Performance | : | Accuracy of ± 1.0 % of span or better for Pressure gauge |



- Accuracy of ± 1.6 % of span or better for Differential Pressure gauge
14. Operating ambient Temperature : 0 - 50 °C
15. Safety Feature : Blow out disc. /diaphragm at the back
16. Accessories : a) Snubbers and Glycerin filled for pulsating fluid applications and at pump discharge.
b) Stainless steel 316 Diaphragm with Teflon coated seals for corrosive, viscous and solid-bearing or slurry type process fluids.
c) 3-Way stainless steel Gauge cock for pressure gauges. Process connection 1/2" NPT.
d) 5-valve SS316 manifold constructed from barstock for differential pressure gauge. Process connection 1/2" NPT.
e) Union, nut & tail piece and other Installation accessories as required.
17. Applicable standard : IS-3624 / 1996
18. Electrical Contact rating : 240V, 5A AC/ 220V, 0.5A DC (for gauges with alarm contact). Number of Contacts:2 SPDT
19. Nameplate : Tag number, service engraved in stainless steel tag plate

**D. Level Switch**

- | | | |
|----------------------------------|---|---|
| 01. Type | : | External cage float operated. Magnetically coupled. |
| 02. Float Material | : | AISI-316 stainless steel |
| 03. Other wetted parts | : | AISI-316 stainless steel |
| 04. External Cage | : | Carbon steel / Stainless steel as per process requirements, welded type / flanged construction. Cage pressure rating shall equal or exceed the rating of the main vessel. |
| 05. External cage mounting | : | Side – Side with drain valve. |
| 06. External cage connection | : | 25 NB socket weld to vessel or RF flanged. |
| 07. Switch housing | : | Epoxy coated die-cast aluminum alloy with neoprene gasket conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 08. Type of switch Configuration | : | 2 SPDT (two nos.) Snap acting magnetically operated hermetically sealed. |
| 09. Contact rating | : | 5A, 240V/AC, 0.5A, 220V DC |
| 10. Accessories | : | a) Counter flange, nuts & bolts, suitable gasket etc.
b) Steel globe type drain valve.
c) 3/4" ET cable gland
d) Stainless steel alpha-numeric engraved for service and tag. |
| 11. Preferred feature | : | Switch operating point marked on cage |
| 12. Temperature rating | : | As per application |

E. Conductivity Type Level Switch

- | | | |
|--------------------------|---|--|
| 01 Type | : | Conductivity discrimination. |
| 03 Mounting | : | Flanged – on standpipe. |
| 04 Probe MOC | : | Stainless steel with high purity ceramic. |
| 05 Probe rating | : | > Maximum design pressure of vessel. |
| 06 Input | : | four independent channels with selectable switching threshold for water conductivity. |
| 07 Relay Output | : | Four isolated output relays for HI, LO, HI-HI, LO-LO. |
| 08 Contact type & rating | : | 2SPDT @ 0.5A 220V DC / 5 A 240V AC |
| 09 Local Display | : | Colored LEDs for HI, LO, HI-HI, LO-LO. Power & fault. |
| 10 Power supply | : | Dual (90-250) V AC, 50 Hz, 1Ph. |
| 11 Enclosure | : | IP-65, corrosion resistant & wall mounting type (Explosion proof for NEC Class-1, Division-1 area). |
| 12 Accessories | : | Teflon (PTFE) cable having Teflon wrapped individual cores and necessary sheathing shall be used to connect the probe with electronics |
| 13 Test pressure | : | Two times rated pressure |
| 14. Cable connection | : | 3/4" ET Compression gland |

**F. Capacitance Type Level Switch**

- | | | | |
|-----|--------------------------|---|--|
| 01 | Type | : | Capacitance type |
| 02 | Probe | : | a) Rod or suspended electrode
b) Rope type probes may be used only where required probe length is greater than 3 meters. |
| 03. | Probe Mounting | : | Stainless steel 1 1/2" ANSI RF Flange / 3/4 "NPT (M) |
| 04. | Material of construction | : | 316 SS |
| 05. | Insulation | : | PTFE Part/Full as per service. |
| 06. | Enclosure | : | Powder/Epoxy coated Die cast Aluminium with neoprene gasket conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 07. | Ambient temperature | : | 0-60 °C. |
| 08. | Mounting | : | On Tap |
| 09. | Supply voltage | : | (90-250) V AC, 50 Hz / 18-36 V DC |
| 10. | Relay output | : | 2 SPDT @ 0.5 A 220V DC / 5A 240V AC |
| 11. | Response time | : | 100 msec or better |
| 12. | Cable connection | : | 3/4" ET Compression gland |
| 13. | Accessories | : | Counter flange, Cable gland, prefab cable and stainless steel name plate engraved with alpha-numeric. |

G. Level Switch (Ultrasonic Type)

Ultrasonic type level switch, IP-65 protection; Switch with 2 nos. of SPDT contacts (1 NO and 1 NC) rated for 0.2 A, 220 V DC; Accuracy $\pm 0.25\%$; Resolution 1mm; Repeatability $\pm 0.1\%$; Linearity $\pm 1\%$; Response time 150ms; Beam angle $< 12^\circ$; Auto false echo-suppression; Accessories like integral cable between sensor and transmitter unit with connectors on both side, gasket and cable gland, digital panel meter, name plate & metal tag; the material of accessories will be SS.

H. Level Switch (Radar Type)

Radar type level switch, top mounted, IP-65 protection; Switch with 2 nos. of SPDT contacts (1 NO and 1 NC) rated for 0.2 A, 220 V DC, Accuracy $\pm 1\%$; Resolution 0.04"; Repeatability $\pm 0.04\%$; Linearity $\pm 0.01\%$; Beam angle $< 20^\circ$; Accessories like integral cable between sensor and transmitter unit with connectors on both side, gasket and cable gland, name plate & metal tag; the material of accessories will be SS.

I. Conductivity Type Electronic Level Indicator

- | | | | |
|----|-----------------------|---|--|
| 01 | Type | : | Conductivity discrimination. |
| 02 | No. of Probes | : | 14, 16 or 32 as per application. |
| 03 | Probe Mounting | : | Screw type / Flanged – on standpipe. |
| 04 | Probe MOC | : | Stainless steel with high purity ceramic. |
| 05 | Probe rating | : | > Maximum design pressure of vessel. |
| 06 | Input | : | Independent channel with selectable switching threshold for water conductivity. |
| 07 | Relay Output | : | Four isolated output relays for Hi, Lo, Hi-Hi, Lo-Lo. |
| 08 | Contact type & rating | : | 2 SPDT @ 0.5 A 220V DC / 5A 240V AC |
| 09 | Current output | : | Isolated 4-20 mA DC & HART |
| 10 | Local Display | : | Red, Green and flashing yellow LED's for steam, water and fault indication respectively. |
| 11 | Remote Display | : | Red, Green & flashing yellow LEDs for steam, Water & Fault indication respectively. |
| 12 | Power supply | : | Dual (90-250) V AC, 50 Hz, 1Ph. |

**2. Resistance Temperature Detector**

- 01. Type : Platinum (Duplex), ungrounded class 'A'
- 02. Resistance : 100 ohm at 0 °C
- 03. Base : Wound on ceramic (anti-inductive)
- 04. Wiring : 3 Wire
- 05. Protecting Tube :-
 - i) O.D. : 8 mm (approx).
 - ii) Material : SS-316, Seamless
 - iii) Filling : Magnesium oxide (Purity above 99.4%).
 - iv) Length : As per application
- 06. Response time : a) 1 to 2 seconds
- 07. Head:
 - i) Type : IP-65 universal screwed type. (Explosion proof for NEC Class-1, Division 1 area)
 - ii) Material : Die cast aluminum or better
 - iii) Terminal blocks : Nickel plated Brass-screw type / silver plated
 - iv) Cable connection : 3/4" ET gland and grommet.
 - v) Others : Terminal head cover with SS chain and suitable gasket
- 08. Accessories :
 - a) Adjustable nipple-union-nipple with thermowell connection
 - b) Compression fittings/unions
 - c) Flanges etc. (for flanged connections only)
 - d) SS 316 forged thermowell as per ASME PTC code.
- 09. Nameplate : Tag number, service engraved in stainless steel tag plate
- 10. Standard : Standard DIN 43760
- 11. Limit of error :
 - @ 0 Deg C ± 0.06 Ohm
 - @ 100 Deg C ± 0.13 Ohm
 - @ 200 Deg C ± 0.20 Ohm
 - @ 300 Deg C ± 0.27 Ohm



4. Thermo Well

Thermo wells Pipe/equipment mounted temperature test wells of 316 SS with a process connection of M33x2 thread or 150 RF flanged and instrument connection of 1/2" NPT (F) in general or 150 RF flanged.. Accessories like name plate, plug with chain, etc. shall be provided. Material of accessories shall be SS. Thermowell shall be hex head of barstock assembly. In case flanged wells are required for any specific application, the same shall be supplied as required. The thermo well construction shall meet the ANSI 19.3 (latest) requirements. Thermo well shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid. All Test thermo well shall have the plug of SS316.

For measurement of pulveriser outlet temperature tungsten carbide block thermowells abrasion resistant not tungsten carbide coated thermowell shall be used. Also the terminals of Thermocouple shall not be at the top of Mills itself. The thermocouple wires are to be laid up to JB through SS tubing of required diameter and the head shall be placed nearer to the JB. Compensating cable exposed to atmosphere in the conventional method melts away due to high temperature at the top of Mill.

For measurement of sea water temperature SS with titanium sleeve thermo wells or better, shall be used.

**6. Temperature Gauge**

- | | | |
|------------------------------|---|--|
| 01. Type | : | Mercury filled-in remote mounting system
Capillary armoured / rigid system type (backward entry / bottom entry) |
| 02. Sensing Element Material | : | Bourdon - AISI-316 SS |
| 03. Capillary Armoring | : | Stainless steel flexible |
| 04. Movement Material | : | AISI 304 SS / Direct Bourdon tip connection to pointer spindle |
| 05. Bulb Diameter and Length | : | As required |
| 06. Bulb Material | : | AISI 316 |
| 07. Capillary | : | Stainless Steel |
| 08. Thermometer | : | M 20 x 1.5 Male adjustable gland on stem to suit associated Thermowell |
| 09. Case Material | : | Stainless steel bayonet type with clear glass cover conforming to IP-65. |
| 10. Dial Size | : | 150 mm in general (100 mm for SWAS gauges) |
| 11. Scale | : | Black lettering on white background in 270 Deg. arc. |
| 12. Mounting | : | Surface/Panel |
| 13. Over range Protection | : | 125 % of range or more |
| 14. Instrument connection | : | Bottom connection for local mounting and back connection for panel mounting. |
| 15. Range | : | 50% ~ 70% range of operating temperature of application approximately. |
| 16. Compensation | : | Case compensation |
| 17. Zero adjuster | : | Micrometer screw adjustable from front. |
| 18. Window | : | Shatterproof toughened glass. |
| 19. Performance | : | Accuracy of ± 1 % of full-scale deflection or better. |
| 20. Enclosure Class | : | IP-65 |
| 21. Capillary | : | 5 meters (local)/15.0 meters (local panel) - armored stainless steel |
| 22. Preferred Feature | : | Capillary Compensation |
| 23. Accessories | : | a) Forged SS 316 thermowell weldable or screwed as per ASME PTC code
b) Installation accessories as required. |
| 24. Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 25. Immersion length | : | Adjustable up to 300 mm including bulb length or as per application |



G. ELECTRICAL SYSTEMS METERS AND ACCESSORIES

A. Push Button

- | | | |
|---------------------------|---|--|
| 01. Type | : | Shrouded square format |
| 02. Face Dimension | : | 32 x 32 mm (maximum) |
| 03. Contact Configuration | : | 2 NO + 2 NC |
| 04. Contact Addition | : | Add-on block up to 4 each with 2 pairs of contacts |
| 05. Contact Material | : | Hard Silver Alloy |
| 06. Contact Rating | : | 500V / 10 A |



- | | | | |
|-----|----------------------|---|---|
| 07. | Utilization Category | : | AC11 / DC11 |
| 08. | Insulation Voltage | : | 2 KV for 1 minute between terminals and earth |
| 09. | Mechanical Life | : | 1 million operations |
| 10. | Construction | : | Aluminum shrouding with plastic lens |
| 11. | Colors | : | Red, Green, Yellow, Black, etc. |
| 12. | Connection | : | Screw terminals |
| 13. | Enclosure Class | : | IP-52 |
| 14. | Legend | : | Engraving |

B. Illuminated Push Button

- | | | | |
|-----|---------------------------|---|--|
| 01. | Type | : | Square format |
| 02. | Face Dimension | : | 32 x 32 mm (maximum) |
| 03. | Contact Configuration | : | 2 NO + 2 NC (minimum) |
| 04. | Contact Addition | : | Add-on-Block up to 4 each with 2 pairs of contacts |
| 05. | Contact Material | : | Hard Silver Alloy |
| 06. | Contact Rating | : | 500 V/ 10A |
| 07. | Utilization Category | : | A C11 / DC11 |
| 08. | Insulation Voltage | : | 2 KV for 1 minute between terminals and earth |
| 09. | Mechanical Life | : | 1 Million Operations |
| 10. | Lamp | : | LED with built-in resistors as required |
| 11. | Lamp Rating:- | | |
| | a) Voltage | : | 240 V AC |
| | b) Watt | : | 2 Watt (approx.) |
| 12. | Lamp and Lens Replacement | : | From front |
| 13. | Construction | : | Transparent Plastic Lens |
| 14. | Color | : | Red, Green, Amber, Yellow etc. |
| 15. | Connection | : | Screw terminals |
| 16. | Enclosure Class | : | IP-52 |
| 17. | Legend | : | Engraving |

C. Selector Switch

- | | | | |
|-----|-----------------------|---|--|
| 01. | Type | : | 2/3/4 position stay put type with rotary lever actuator. |
| 02. | Face Dimension | : | 32 x 32 mm (maximum) |
| 03. | Contact Configuration | : | 4 pair of contacts |
| 04. | Contact Addition | : | Add-on-Block up to 4 each with 2 pairs of contact |
| 05. | Contact Material | : | Hard silver Alloy |
| 06. | Contact Rating | : | 500 V / 10 A |
| 07. | Utilization Category | : | AC11 / DC11 |
| 08. | Insulation Voltage | : | 2 KV for 1 minute between terminals and earth |
| 09. | Mechanical Life | : | 1 million operation |
| 10. | Construction | : | Aluminum shrouding |
| 11. | Connection | : | Screw terminals |
| 12. | Enclosure Class | : | IP-52 |

D. Indicating Lamp

- | | | | |
|-----|---------------------------|---|--|
| 01. | Type | : | LED with built-in resistor (LED must not glow if the voltage is less than 180 V) |
| 02. | Face Dimension | : | 32 x 32 mm (maximum) |
| 03. | Voltage | : | 230 V, 50 Hz, 1 Phase |
| 04. | Watt | : | 2.5 Watt (approximate) |
| 05. | Lamp and Lens Replacement | : | From front |
| 06. | Construction | : | Transparent Plastic lens |
| 07. | Color | : | Red, Green, Amber, Yellow etc. |
| 08. | Connection | : | Screw terminals |



09. Legend : Engraving

E. Indicating Meters (A.C)

01. Type : Rectifier type taut band
02. Face Dimension : 96 x 96 mm
03. Scale : Radial arc of 240 Deg.
04. Accuracy : 1.5% of full scale.
±0.5 Hz for frequency meter
05. Input : 0-1/0-5A for current measurement, 0-240V, 50 ± 2.5 Hz for voltage measurement
06. Zero Adjustment : Screw on meter face
07. Enclosure : Shielded Case IP-52
08. Mounting : Flush Panel
09. End Scale Suppression : 6 times the measuring range only for motor ammeters

F. Indicating Meters (D.C)

01. Type : Taut band moving coil
02. Face Dimension : 96 x 96 mm
03. Scale : Radial arc of 240 Deg.
04. Accuracy : 1.5% of full scale
05. Input : 0-75 mV for current measurement. Direct reading for voltage measurement.
06. Zero Adjustment : Screw on meter face
07. Enclosure : Shielded case IP-52
08. Mounting : Flush Panel
09. End Scale Suppression : 2 times the measuring range only for motor ammeters.

G. Auxiliary Relay

01. Type : Plug-in type with base/DIN rail Mounted
02. Coil voltage : 230 V, 50 Hz, 1 Phase
03. Contact Configuration : 2 NO & 2 NC (Minimum), additional contacts as per requirement
04. Contact rating : 250V/5A (A.C/D.C.)
05. Operating range : 80 to 110% of rated voltage
06. Insulation : 2 KV for 1 minute between terminals & earth.
07. Mechanical life : 20 million operations
08. Enclosure : Transparent cover
09. Connection : Screw terminals.
10. Mounting : Projection mounting inside panel /DIN rail mounting

H. Coupling Relay

01. Type : Miniature plug-in type/ DIN rail Mounting
02. Coil voltage : 24 V D.C. / 48V DC
03. Contact : 2 NO & 2 NC (Minimum)-Additional contact as per requirement
04. Contact rating : 250 V/5A (A.C)/220V/2A (D.C)
05. Operating range : 70 to 110% of rated voltage.
06. Insulation : 2 KV for 1 minute between terminal & earth.
07. Mechanical life : 20 million operations
08. Coil protection : Diode
09. Indication : Coil on LED
10. Enclosure : Transparent cover
11. Connection : Screw terminals.
12. Mounting : Projection mounting inside panel / DIN rail mounting

**I. Distribution Boards**

- | | | |
|------------------------|---|---|
| 01. Type | : | Fixed, Modular. |
| 02. Power distribution | : | Through MCCB |
| 02. Enclosure | : | Sheet Steel, IP54 |
| 03. Mounting | : | Free standing
(Can be attended from both front & back) |

J. Electrical Junction Box

- | | | |
|---------------------------|---|--|
| 01. Type of Enclosure | : | Dust tight, Weatherproof and Waterproof, generally conforming to IP 65. |
| 02. Material | : | 16 SWG sheet steel hot-dip galvanized / Cast aluminum LM6. |
| 03. Type of Cover | : | Solid unhinged with retention chain |
| 04. Number of Paint | : | One base + two finish coatings of anti corrosive epoxy |
| 05. Mounting | : | Surface |
| 06. Cable Entry | : | Conduit Knockout/Threaded Hub |
| 07. Gasket | : | Neoprene |
| 08. Grounding | : | Brass earth lug with green screw head
External-2 Nos, Internal-1 no.M6. |
| 09. Number of Drain Holes | : | Two at bottom capped. |
| 10. Tag Plate | : | a) JB Number
b) Cable Numbers on top
c) Cable numbers with ferrules (side) |
| 11. Accessories | : | a) Rail mounted Terminal blocks with makers
b) Cable gland |

K. Cable Gland

- | | | |
|------------------|---|--|
| 01. Type | : | Double compression |
| 02. Entry Thread | : | ET |
| 03. Material | : | Brass |
| 04. Finish | : | Cadmium Plated. |
| 05. Protection | : | IP – 54 or better |
| 06. Accessories | : | Neoprene gasket, locknuts, reducers etc. |

L. Cable Tray

- | | | |
|-----------------|---|----------------------|
| 01. Material | : | Mild steel |
| 02. Thickness | : | not less than 2.5 mm |
| 03. Finish | : | Hot dip galvanized |
| 04. Perforation | : | As per MFR standard. |
| 05. Cover | : | Suitable for tray |

**2. Instrumentation Pair Signal Cable**

- | | | | |
|-----|----------------------------------|---|---|
| 01. | Conductor type | : | Stranded (7) annealed tinned copper |
| 02. | Conductor size | : | 0.5 Sq.mm |
| 03. | Resistance | : | 39 Ohms / Km (max.) at 20 °C |
| 04. | Conductor Insulation | : | HRPVC Type-C (IS-5831,1984) 0.6 mm thick |
| 05. | Voltage grade | : | 600V (peak value.) |
| 06. | Twisting | : | Twin twisted with lay of 75 mm |
| 07. | Twisting Direction | : | All pairs in the same direction. Lapped to form bunch with mylar tape. |
| 08. | Individual Pair & Overall Shield | : | Aluminium mylar tape with a thickness of 2.35MIL and 25% overlapped edges. |
| 09. | Drain wire | : | Annealed Tinned copper wire, Stranded. Size 0.5 Sq. mm. (No. of strands / size:- 7 / 0.3mm) |
| 10. | Inner Sheath | : | Extruded FRLS PVC
Type ST2 of IS-5831,1984
Thickness as per IS-1554 Part-I 1976 |
| 11. | Armoring | : | G.I. Wire/Strip as per IS-3975 |
| 12. | Outer Sheath | : | Extruded FRLS PVC (anti rodent, anti termite & moisture resistant properties)
Type ST2 of IS-5831, 1984
Thickness as per IS-1554, Part-I 1976 |
| 13. | Rip Cord | : | Yes |
| 14. | Temperature Range | : | 85 °C |
| 15. | Insulation at 20 Deg.C | : | 100 MOhms/Km [Min] |
| 16. | Capacitance at 800 Hz | : | 70 nf/km [Typical] |
| 17. | Codes & Standards | : | a) IPCEA-S-61-402
b) IEC 332-1
c) ASTM-B-33
d) IS-8130-1984 |



18. Tests
- :
- a) Oxygen Index: Min.29 at room temp. (ASTM-D-2863)
 - b) Acid Gas Gen.: Max.20% by weight as per IEC 754 Part-I
 - c) Temp Index: Min 250 ° C at 21Oxy. Ind. (ASTM-D-2863)
 - d) Smoke Density Rating: Max.60% (ASTM-D-2843).
 - e) Flammability Test: as per IEC 332 Part-I
 - f) Swedish Chimney Test-S-424-1475
 - g) Insulation Test Core to core: 1.0 KV r.m.s for1 Min
 - h) Insulation Test Core to armour: 1.0 KV r.m.s for1 Min
 - i) Insulation Resistance 100 M Ohm / Km Min
 - j) Type test for material
 - k) Fire resistance test to IS 5831 for 20 Minute CPVC insulation & sheath of electrical cable.
 - l) Rodent & termite proof
 - m) Thermal Stability of 200 OYC to IEC 540 for 100 Nos.



1.3.0 Process Impulse Lines /Tubes & Fittings

Impulse lines for instruments shall be 1/2" OD tubing of SS316 material according to ASTM A-269. All fittings to be used for tubing shall also be SS316, double compression type of standard make. Impulse pipes for high pressure applications shall be used with material and rating as same as that of the process line. Size and thickness of piping/tubing shall be suitable for the design pressure and temperature conditions as per ANSI16.11. Compression tube fittings are used in low pressure process systems. Socket weld tube fittings shall be used in high pressure process systems

For impulse pipes/tubes and fittings, IBR certificate shall be provided as applicable. The bidder shall provide thermal insulation (preferably mineral wool) for sampling pipes for the purpose of personnel protection so that temperature outside the insulation is 60 deg. C. Tubing shall be complete with union connections and end fittings at supply and receiving ends. Nipple shall be provided for root valves size more than 1/2" and the nipple size shall be same as the root valve size. Reducer / adapter shall be provided to suit instrument connection, where nipple, root valve size is more than 1/2". Bulk head fitting socket welded type to be provided at instrument rack/enclosure.

Impulse pipes, fittings and air supply and signal piping/tubing shall be supplied for all the instruments under the scope of this specification. Instrument piping shall be designed for maximum design pressure and temperature of the process. Pressure measurement connection shall be 1/2" or 12mm pipe depending on the temperature and pressure conditions of the fluid. Instrument on Vacuum system at CEP inlet should have vent lines connected to high point in the condenser. Instrument air tubing shall be SS.

Minimum bending radius of instrument sensing line is 3 times the tube diameter. Independent impulse lines shall be installed between the flow elements and the transmitter in case of dual/triple redundant

Instrument sensing lines are sloped in their horizontal runs, a minimum of 1/2" per foot. In general, liquid and steam lines slope from their process tap connection down to the instrument. In general, gas and non-condensing vapor lines slope from their process tap connection up to the instrument.

Instrument sensing lines shall be routed as directly as practicable from the process root valve to the instrument. The length of instrument tubing from the root valve to the instrument shall be limited to maximum of 12 meters for compressible fluids and 15 meters for non-compressible fluids. Wherever it is not possible to access the main root valve a additional root valve shall be provided near to the instrument.

Instrument sensing lines shall be grouped together as much as possible to benefit from the use of common support members and to present a finished installation that is routed in a neat and orderly manner.

The maximum process temperature for all transmitters shall be limited to 80°C. To dissipate the excess heat, a minimum of 1 meter of tubing for each 30°C of excess heat shall be installed to isolate the process media from the instrument. An additional isolation valve shall be used at the instrument for isolation on those instruments without valve manifolds

Funnel with drain header shall be provided in the racks for blowing/draining out the process fluid in the impulse tubings. The size of the drain header shall be 1". When instruments are mounted local to the tapping point and are not mounted in the rack, or panel or enclosure, the drains shall be connected to the nearest floor level or plant drain.



The erection hardware shall meet the following specifications:-

Item	Specification
a) Impulse Piping	
i) High pressure and high temperature services (Medium: Steam & Water and furnace region)	Seamless Alloy Steel Piping to ASTM A335 GR.P22 (schedule 160 for high pressure & high temperature)
ii) Low pressure and low temperature services Gr.B (Medium: Steam & Water)	Seamless carbon steel piping to ASTM A106
iv) Steam and Water Analysis system	Seamless stainless steel piping to ASTM A312 Gr. TP-321
v) Seamless copper tubing	ASTM B-75
b) Fittings	
i) Material for socket weld fittings	ASTM A105 ASTM A182 Gr. F22 6000/3000 lbs
ii) Dimensions of fittings	ANSI B16.11
iii) Fittings for steam and water analysis	ASTM A182 Gr. F-321



1.5.0 Instrument Support / Structural Steel

Bidder shall supply instrument stands (stanchions) and other structural steel material required for supporting the Junction boxes, cable trays, impulse lines and instruments.

All field mounted instrument tubing shall be supported with steel angles/channels of a minimum 1/8" thickness fabricated to present a neat appearance. Sharp corners in the support material to be avoided



1.8.0 Junction Boxes

Bidder shall supply junction boxes wherever required. These shall be of Industrial grade Fibre glass Reinforced Polyester (FRP) to weather proof, with cable entering on bottom and side entry shall be provided.

These boxes shall have terminals suitable for min 2.5 mm² cable termination (klip on) mounted on rails. 30% spare terminals shall be supplied in each junction box.

Junction box shall be provided with double compression glands.

Telephone socket shall be provided in junction boxes. Each junction box shall have a minimum of 20% or 2 nos., whichever is more, spare entry duly provided with plugs (weather proof/explosion proof, as applicable). Protection class shall be IP-65 minimum for JB and enclosures.

In general junction boxes shall be designed in accordance with NEC, Article 370, paragraphs 18, 19 and 20 or equivalent standards. Junction boxes for use in outdoor or damp locations shall be galvanized malleable iron or steel coated inside and outside. The enclosure shall conform to NEMA-4 with hinged door lockable type. Conduit and cable shall enter the lower portion of the box in such a manner that all terminals strips are above conduit entry points.

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
LOCAL CONTROL PANEL		



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE :

SHEET 1 OF 5

1.0 SCOPE

This specification covers the Design, Manufacture, Inspection and Testing at the manufacturer's works, proper packing for transportation and delivery to site, supervision, erection, and commissioning at site of Local Panels required for control and monitoring of the Auxiliary Plant & Equipment.

2.0 CODES AND STANDARDS

2.1 All the equipments specified herein shall comply with the requirements of the latest issue of the relevant National and International standards.

2.2 As a minimum requirement, the following standards shall be complied with:

- a) IS-6005 : 1998 : Code of practice for phosphating of iron and steel.
- b) IS-5 : 2007 : Colors for ready mixed paints and enamels.
- c) IS-1248:2003 : Direct Acting Indicating Analog Elec Measuring Instruments.
- d) IS/IEC 60947:Part 1:2004 : Low Voltage switchgear & control gear: Part-I (General Rules)
- e) IS-8828:1996 : Circuit breaker for household and similar installations.
- f) IS-13947 (Part-I):1993 : Low Voltage switchgear & control gear : Part-I (General Rules)
- g) ISA-18.1:1979 : Annunciator Sequences and Specification
- h) NFPA-496:2003 : Purged & Pressurised Enclosure for Electrical Equipment in Hazardous Locations.

3.0 TECHNICAL REQUIREMENTS

3.1 Panel Construction

3.1.1 The local panels shall house the secondary instruments, annunciation system, Single loop controller, Control switches / push buttons, indicating lamps/LED cluster, relays, timers and other devices required for operation and monitoring of the equipment locally.

3.1.2 The panels shall be of free standing type either welded construction on angle iron (minimum section of 50 x 50 x 4 mm) structure or folded construction by sheet metal formation depending upon the equipments to be mounted on it. The panels shall be robustly built and stiffeners as necessary shall be provided.

3.1.3 The panel shall be suitably reinforced to ensure adequate support for all instruments mounted thereon. All welds on exposed panel surfaces shall be ground smooth.

3.1.4 The salient features of construction shall be:

Sheet material: Cold rolled sheet steel

Frame thickness: Not less than 3.0mm

Enclosure thickness: Not less than 2.5 mm for load bearing sections (Mounted with instruments)
1.6 mm for doors and Not less than 2.0 mm for others

Gland plate thickness: 3.0mm

Base channel: ISMC 100 with anti-vibration mounting & foundation bolts.

3.1.5 The panel shall be provided with doors with integral lockable handle. The door when locked shall be held at minimum three places. The door width shall not be more than 550mm. The doors shall be provided with suitable stiffeners to prevent buckling. The handle shall be on the right side of the door. The door shall be removable type with concealed hinges to facilitate maintenance work. Suitable pocket inside the door shall be provided for keeping the drawings / documents.

3.1.6 Suitable neoprene gasket shall be provided on all doors and removable covers. Suitable ventilation system along with louvers shall be provided at bottom and top of the doors covered with removable wire mesh.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE :

SHEET 2 OF 5

- 3.1.7 The class of protection shall be in accordance with IP-55 unless otherwise specified in the data sheet – A (No. PES-145-54A-DS1-0).
- 3.1.8 All steel surfaces shall be cleaned by sand / pellet blasting, treated for pickling, degreasing and phosphating etc. by seven tank method. The panel shall have a high quality finish and appearance. The panel shall be painted with two coats of primer followed by two coats of epoxy / synthetic enamel based final paint of color shade and finish as given in data sheet-A (No. PES-145A-DS1-0). Minimum thickness of the paint shall be 85 microns for external paint and 70 microns for internal paint.
- 3.1.9 The cable glands of the required size and type as given in data sheet-A (No. PES-145A-DS1-0) shall be supplied alongwith the Panel.
- 3.1.10 All operable and indicating devices shall be mounted on the front of the panel while aux. Relays / timers MCBs etc. required for realization of control logics shall be mounted on a mounting plate inside the panel. Auxiliary relays and timers etc. shall be grouped according to the control function. The devices shall be located in such a way so as to ensure easy access for operation / maintenance.
- 3.1.11 Single / dual control power supply feeders of voltage class as specified in data sheet-A (No. PES-145A-DS1-0) shall be provided by the purchaser. In case redundant power supply feeders are provided then auto changeover unit shall be mounted on the panel are in the panel supplier's scope. Where DC control power supply is specified an additional 240V, 50 Hz AC supply feeder for powering of space heater and lighting shall be provided by the purchaser. Suitable arrangement shall be provided inside the panel to receive and terminate the power supply feeder(s). For this purpose MCBs of suitable current rating shall be provided by the vendor. A supervisory relay along with a pilot lamp to indicate control supply 'ON' shall be provided on the panel. Any other power supply required for the operation of the devices mounted in the panel shall be arranged by the vendor.
- 3.1.12 The internal wiring shall be carried out with 1100 volt grade PVC insulated copper multi strand wire / flexible of 1.5mm² size. AC & DC wires shall be kept separate from each other. Separate coloured wires to be used for AC and DC circuits. All wires shall be properly numbered and identified with ferrules as per the Control scheme / wiring diagram. Wires shall be routed and run through PVC troughs.
- 3.1.13 Terminal blocks shall be clip on type, 1100 volts grade. Separate terminal blocks shall be used for AC & DC circuits. The terminals shall be suitable for terminating 0.5 mm² to 2.5mm² external cables. The TB points in terminal block shall be cage clamp type / screw type. The terminal for ammeters shall be provided with removable links for shorting CTs. Each terminal strip shall be provided with identification strip. The panel shall have ten (20) percent spare terminal.
- 3.1.14 The interior of each panel shall be suitably illuminated through fluorescent lamps / tube lights with shrouded cover of minimum 15W operable on 240V 50 Hz AC power supply through panel door switch. A 15 Amp. 3-pin Power receptacle shall be provided.
- 3.1.15 Suitable space heaters operable on 240 Volts 50 Hz AC power system shall be provided at the panel bottom. These shall be designed to maintain the panel temperature five (5) deg. C above the ambient temperature during maintenance shutdown. Suitable isolating and control devices comprising of MCB, thermostat etc. shall be provided for the space heater.
- 3.1.16 The panel shall be provided with a copper earth bus of 50 x 6 mm size running throughout the width of the panel. It shall be terminated internally with 10 mm bolts at extreme ends for connection to; main station earth. The panel mounted equipments / devices shall be connected to earth bus through green coloured PVC insulated stranded copper conductor of 2.5 mm² size.
- 3.1.17 Local Panel shall be provided with main name plate of 150 mm x 40 mm size having inscription of 20 mm height. The individual devices on the panels shall be as provided with separate name plate with inscription of 3 mm height. The instrument / devices shall be provided with stick on label plates inside the panel. The material of the main and individual labels shall be three (3) ply 3 mm thick Traffolyte Sheet / 2 mm Anodised Aluminium Plate. The inscription shall be with white letters on black background on traffolyte sheet. The labels shall be fixed by self tapping non-rusting screws.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE :

SHEET 3 OF 5

3.1.18 Vendor shall furnish electric load and heat load list (in case panel is to be placed in ac environment) of each panel.

3.2 Hazardous Area Panel Requirement

3.2.1 The Local Panel located in hazardous area shall be pressurized as per NFPA-496 requirements to render it non-hazardous. Alarms shall be provided for local and remote annunciation when pressurisation falls below 2.5 mm of water column. Protection shall be of type Z of NFPA-496. It shall not be possible to switch ON the power of purged section unless it is purged as per the recommendation of NFPA-496. Vendor must provide a protective device on the panel to protect the panel from over pressurisation.

3.2.2 Vendor shall supply pressurisation kit consisting of valves, restriction orifices, dual filter regulation, pressure gauges, pressure switches, rotameter etc. Pressurisation kit shall be surface mounting on a metal board and located outside the local panel. Pressurisation kit shall further consist of solenoid valve flow switch, timer blow off safety device etc., so as to make purging fully automatic. However final start shall be manual. Panel protection against over pressure to be provided as per NFPA-496.

3.2.3 Pressurised local control panel pressurization kit assembly design shall provide minimum leakage flow through the Local Control Panel. Panel venting shall be as per NFPA-496.

3.2.4 All components in the local panel like indicating instruments, push buttons switches, lamps etc., which are required to be energized without panel pressurization or before completion of purge cycle shall be explosion proof as per NEMA-7 & suitable for area classification.

3.2.5 All push buttons etc. requiring frequent operation during machine running shall have good positive sealing. Weatherproof housing or cover to be provided wherever necessary. Vendor shall provide pressurisation bypass switch outside explosion proof enclosure of pressurized panel with lamp indication. This shall be used only during maintenance. All hinges, screws, other non-painted metallic parts shall be of stainless steel material.

3.2.6 Provision to switch off manually all types of power shall be provided in the panel. In addition, it shall also be possible to switch off power circuits / components which are powered from motor control centre or control room manually in case of pressurization failure. All such cables from MCC and main control room shall be terminated in explosion proof boxes (NEMA-7).

3.3 Control & Monitoring devices

3.3.1 Instruments like Indicators, recorders, single loop controllers etc. as applicable and specified elsewhere for the plant / equipment shall be supplied and mounted on the panel.

3.3.2 Alarm Annunciator System

It shall be solid state discrete facia type having a sequence of ISA-S18.1A or as specified, opaque facia windows of 70 mm x 50 mm size, having two (2) lamps per window, and hooter of 10W, and provision for repeat group alarm at remote. The annunciator shall be provided with ten (10) percent spare windows or minimum two (2) windows along with electronics.

3.3.3 Relays

The relays shall be electromagnetic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable. There shall be ten (10) percent spare contacts.

3.3.4 Timers

The timers shall be electronic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However, minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable.

3.3.5 Control / Selector Switches

Switches shall be Rotary Cam type with minimum of 5 Amps AC & 2 Amp DC continuous current rating. Selector switches shall be stay put type while control switches shall be spring-return-to-neutral type.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE :

SHEET 4 OF 5

Contact configuration and rating shall be as per the control function requirement. The switches shall be lockable type wherever specified. Each switch shall be provided with engraved plates indicating the switch position / functions.

3.3.6 Push Buttons / Indicating Lights

The push buttons shall be momentary action self-resetting type, however stop P.B. for unidirectional drives shall be provided with manual reset facility. Its contact configuration & rating shall be as required for the control function but minimum 2 NO + 2 NC of 5 Amp. AC rating. It shall have round coloured projecting tab and engraved escutcheon plate / inscription plate. Colour coding of push buttons shall be as under:

RED	Motor OFF / Valve CLOSE	YELLOW	Alarm acknowledge	Left Hand Side
GREEN	Motor ON / Valve OPEN	BLACK	Lamp test	Right Hand Side

Indicating lights shall be suitable for direct connections across specified power supplies. It shall be fitted with built in resistance to prevent circuit tripping on shorting of lamp filament. It shall be fitted with LED cluster type lamp replaceable from front.

GREEN	Motor OFF / Valve CLOSED condition	AMBER	Motor tripped	Left Hand Side
RED	Motor ON / Valve OPEN condition	WHITE	Normal / healthy	Right Hand Side

3.3.7 Ammeters

Ammeter shall be 96 x 96 mm size, 90 deg. deflection, 1.5% accuracy, 1 Amp. CT operated or with 4-20mA input and Flush mounting type as called for in the data sheet-A (No. PES-145-54A-DS1-0). Ammeters for motors shall have six (6) times folded scale at upper end to enable motor starting current indication

3.3.8 Miniature Circuit Breaker (MCB)

These shall be instantaneous magnetic trip type for short circuit in addition to current time inverse delayed thermal trip feature for over current protection. The housing of MCB shall be made of non-ignitable, high impact material. It shall have minimum short circuit rating of 9 KA for AC Voltages and 4 KA for DC Voltages.

3.3.9 Makes of various instruments / devices shall be as given below

1.	Alarm Annunciators	:	Procon / IIC
2.	Ammeters	:	AEP / IMP
3.	Control / Selector Switches	:	Alsthom / Kaycee / Siemens / L&T
4.	Push Buttons / Indicating Lamps	:	Siemens / L&T / Teknic / Alsthom
5.	Auxiliary Relays	:	Jyoti / Siemens / L&T / OEN
6.	Timers	:	L&T / Alsthom / Bhartiya Cutler Hammer
7.	MCBs	:	S&S Power Engg. / Indo Asian / MDS
8.	Terminal Blocks	:	Jyoti / Elmex

4.0 TESTING AND INSPECTION

4.1 The bidder shall adopt suitable quality assurance program to ensure that the equipments offered will meet the specification requirements in full.

4.2 BHEL's standard Quality Plan for LCP is enclosed with the specification. The bidder shall furnish his acceptance to BHEL's QP and submit the signed and stamped copy of QP along with the offer.

4.3 The vendor shall conduct the following tests as a minimum requirement:

4.3.1 Routine Tests

1. High Voltage (H.V.)
2. Insulation Resistance (I.R.)
3. Functional

4.3.2 Type Tests

1. Enclosure Class Test



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE :

SHEET 5 OF 5

5.0 SPARES AND CONSUMABLES

5.1 Commissioning Spares and consumables

The bidder shall supply all commissioning spares and consumables 'as required' during Start-up, as part of the main equipment supply.

5.2. Mandatory Spares

The bidder shall offer alongwith main offer, the Mandatory Spares as specified elsewhere in the specification. The Mandatory Spares offered shall be of the same make and type as the main equipment.

5.3. Recommended Spares

The bidder shall furnish a list of Recommended Spares indicating the normal service expectancy period and frequency of replacement; quantities recommended for 3 years operation alongwith unit rate against each item to enable BHEL/BHEL's Customer to place a separate order later, if required.

6.0 DRAWINGS AND DOCUMENTS

6.1 The bidder shall furnish the following documents in required number of copies along with the bid :

1. Data Sheet no. PES-145A-DS1-0
2. General Arrangement Drawing.
3. Catalogue and technical information for instruments and devices.
4. Quality Plan.

6.2 The vendor shall furnish the following documents in required number as agreed after the award of contract:

1. Data Shee No. PES-145A-DS2-0
2. GA Drawing indicating layout of instruments, construction details, foundation details, cable gland plate alongwith cable glands and all details mentioned in this specification.
3. Control Schematic Diagram along with grouping of different terminals for various functions.
4. Catalogue and technical information for instruments and devices with selected options clearly marked.
5. O&M Manuals.
6. "As Built" Drawing.
7. CDs.

7.0 MARKING AND PACKING

7.1 Panel with all instruments / devices mounted on it shall be suitably packed & protected for the entire period of despatch, storage and erection against impact, abrasion, corrosion, incidental damage due to vermin, sunlight, high temperature, rain moisture, humidity, dust, sea-water spray (where applicable) as well as rough handling and delays in Transit and storage in open.

8.0 APPLICABLE DATA SHEET FORMS

This document shall be read with one or more of the following data sheet forms :

- | | | |
|-----------------------------------|---|-------------------------------|
| - Data sheet A&B for Local Panels | : | Data sheet no. PES-145A-DS1-0 |
| - Data sheet C for Local Panels | : | Data sheet no. PES-145A-DS2-0 |



DATA SHEET FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO. 00

DATE:

SHEET 1 OF 2

TAG No. Qty.....

Data Sheet No.: PES-145A-DS1-0

Data Sheet A & B

DATA SHEET-A FOR LOCAL PANEL
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY
BIDDER)

GENERAL

MANUFACTURER

CONSTRUCTION

☐ FOLDED ☐ WELDED
(As per requirement EDN)

ENCLOSURE SHEET THICKNESS

FRONT

2.5 mm

OTHER

2.5 mm

DOOR

2.5 mm

OTHER

Load bearing sheet front shall have 2.5mm thickness

TECHNICAL

INPUT POWER SUPPLY *

(ANY OTHER POWER REQUIREMENT
TO BE DERIVED FROM THIS SUPPLY ONLY)

☐ 240V 50 Hz AC ☐ 220V DC
☐ 415V 3 PHASE 3W ☐ 415V 3 PHASE 4W

NO. OF FEEDERS

☐ ONE ☒ TWO

STARTER WITH MCC

(CHECK WITH MAUX/ELEC)

☒ REQUIRED ☐ NOT REQUIRED

IPR POSITION

☐ MCC ☒ RELAY PANEL

CONTACT RATING OF RELAY

☐ 5 Amp, 230 V AC ☐ 0.25 Amp, 220V DC

CONTROL SUPPLY

☐ 110V AC ☐ 220V AC
☐ 220V DC ☐ Other.
(As per requirement)

ALARM ANNUNCIATOR WINDOW

(EXCLUDING SPARES)

____ NOS. (AS REQUIRED)

TEMP SCANNER

(IF REQUIRED –NO. OF CHANNELS TO BE
SPECIFIED UNDER SEC-C)

☐ REQUIRED ☒ NOT REQUIRED

PAINT TYPE

☒ EPOXY

MIMIC (TYPE OF MIMIC- MATERAIL, THICKNESS
TO BE SPECIFIED DURING DETAILED ENGG.)

☐ REQUIRED ☐ NOT REQUIRED

PANEL COLOUR (EXTERNAL)

☐ LIGHT GREY (Shade 631 IS-5)
☐ OPALINE GREEN (Shade 275)
☒ RAL 7032/RAL7035 (This shall be decided by
BHEL during detailed engg.)

FINISH (EXTERNAL)

☐ MATT
☐ GLOSSY ☐ SEMI GLOSSY

PANEL COLOUR (INTERNAL)

☐ WHITE ☐ CREAM
☐ OFF WHITE
☒ GLOSSY WHITE TWO COATS/ RAL 7035 WITH
FIRE RESISTANT PAINT (This shall be decided by
BHEL during detailed engg.)

FINISH (INTERNAL)

☐ MATT
☒ GLOSSY ☐ SEMI GLOSSY



DATA SHEET FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO.

00

DATE:

SHEET

2

OF

2

TAG No. Qty.....

Data Sheet No.: **PES-145A-DS1-0**

Data Sheet A & B

DATA SHEET-A FOR LOCAL PANEL
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY
BIDDER)

CLASS OF PROTECTION

☐ IP-42 (FOR INDOOR SERVICE)
☒ IP-55 (FOR OUTDOOR SERVICE) ☐ ANY
OTHER

CONTROL HARDWARE

☒ RELAY BASED

FOUNDATION ARRANGEMENT

☐ FOUNDATION BOLTS ☐ ANCHOR
FASTENERS

WEIGHT OF PANEL (Kg.)

.....(Vendor to specify)

PANEL TYPE

☐ PRESSURISED ☐ UNPRESSURISED

As per Requirement

CABLE GLAND

☐ DOUBLE COMPRESSION

AMMETER (TYPE OF INPUT, IF REQUIRED)

☐ 1 Amp CT☐ 4-20 mASCOPE OF SUPERVISION FOR
ERECTION & COMMISSIONING☐ APPLICABLE☐ NA

PREPARED BY

CHECKED BY

APPROVED BY

NAME
DESIGNATION

SIGNATURE

DATE

COMPANY SEAL

NAME:

SIGNATURE:

DATE:



DATA SHEET FOR LOCAL PANELS

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO.

00

DATE:

SHEET

1

OF

2

TAG No. Qty.....

Data Sheet No.: **PES-145A-DS1-0**

Data Sheet C

DATA SHEET-C FOR LOCAL PANEL
(TO BE FILLED BY CONTRACTOR AFTER AWARD OF CONTRACT)

GENERAL	MANUFACTURER			
	CONSTRUCTION		☐ FOLDED ☐ WELDED (As per requirement EDN)	
	ENCLOSURE SHEET THICKNESS	FRONT		
		OTHER		
		DOOR		
		HEIGHT		
OTHER				
TECHNICAL	INPUT POWER SUPPLY			
	NO. OF FEEDERS			
	CONTACT RATING OF RELAY			
	TEMP SCANNER			
	CONTROL SUPPLY			
	ALARM ANNUNCIATOR WINDOW (EXCLUDING SPARES)			
	PAINT TYPE			
	PANEL COLOUR (EXTERNAL)			
	FINISH (EXTERNAL)			
	TYPE OF MIMIC MATERIAL OF MIMIC THICKNESS OF MIMIC			
	PANEL COLOUR (INTERNAL)			
	FINISH (INTERNAL)			
	CLASS OF PROTECTION			
	CONTROL HARDWARE			
	FOUNDATION ARRANGEMENT			
	WEIGHT OF PANEL (Kg.)			

	DATA SHEET FOR LOCAL PANELS			SPECIFICATION NO.:		
				VOLUME		
				SECTION		
				REV. NO.	00	DATE:
				SHEET	2	OF
TAG No. Qty.....			Data Sheet No.: PES-145A-DS1-0			
Data Sheet C						
DATA SHEET-C FOR LOCAL PANEL (TO BE FILLED BY CONTRACTOR AFTER AWARD OF CONTRACT)						
	PANEL TYPE					
	CABLE GLAND					
	AMMETER (TYPE OF INPUT)					
	SCOPE OF SUPERVISION					
NAME SIGNATURE DATE	PREPARED BY	CHECKED BY	APPROVED BY		COMPANY SEAL NAME: SIGNATURE: DATE:	

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
MOTORISED VALVE ACTUATOR		



SPECIFICATION FOR MOTORISED VALVE ACTUATOR

SPECIFICATION NO.:

VOLUME II B

SECTION D

REV. NO. 00

DATE: 25.04.18

SHEET 1

OF 4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

GENERAL *	* PROJECT	2 X 660 MW UDANGUDI TPP	
	OFFER REFERENCE		
	* TAG NO. SERVICE		
	* DUTY	☐ ON / OFF	☐ INCHING
	* LINE SIZE (inlet/outlet): MATERIAL		
	* VALVE TYPE	☐ GLOBE ☐ GATE ☐ REG. GLOBE ☐ BUTTERFLY	
	* OPENING / CLOSING TIME		
	* WORKING PRESSURE		
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF -20 to 70 DEG C AND RELATIVE HUMIDITY OF 0-95% IN HOT HUMID AND TROPICAL ATMOSPHERE AND HIGHLY POLLUTED AT PLACES OF COAL DUST AND FLY DUST	
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY	
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY	
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY	
CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, WEATHER PROOF, DUST TIGHT SUITABLE FOR OUTDOOR USE WITHOUT CANOPY, NEMA6/IP:68	
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL	
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.	
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.	
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING SERVICE - 150 STARTS/HR MINIMUM.	
HANDWHEEL	* REQUIRED	☒ YES ☐ NO	
	* ORIENTATION	☐ TOP MOUNTED ☐ SIDE MOUNTED	
	* TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.		
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY	
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY	
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT-INCLUSIVE OF I.S. TOLERANCE	
	ACTUATOR APPLICABLE WIRING DIAGRAM	☒ ENCLOSED (BIDDER TO CONFIRM) A: ☐ DRG. NO. 3-V-MISC-24227 R00 B: ☐ DRG. NO. 3-V-MISC-24550 R00 C: ☒ DRG. NO. 3-V-MISC-24283 R00 D: ☐ DRG. NO. 4-V-MISC-90271 R11 E: ☐ For Thyristor based Integral starter, Bidder/Vendor to furnish wiring diagram	
	COLOUR SHADE	☐ BLUE (RAL 5012) ☒ SIEMENS GRAY RAL 7030	
	PAINT TYPE (## Refer Notes)	☐ ENAMEL ☒ EPOXY ☐	
	SHAFT RPM	BIDDER TO SPECIFY	
	OLR SET VALUE	BIDDER TO SPECIFY	
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY	
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY	
	@ PWR SUPP TO MTR / STARTER	415V +/- 10%, 3 Phase, 3 Wire 50HZ +/- 5%	
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER ☐ 230 V ☒ 110 V	



SPECIFICATION FOR MOTORISED VALVE ACTUATOR

SPECIFICATION NO.:

VOLUME II B

SECTION D

REV. NO. 00

DATE: 25.04.18

SHEET 2

OF 4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)


	@ ENCLOSURE CLASS OF MOTOR	☐ IP 68 ☐ FLAME PROOF			
	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B			
	@ WINDING TEMP PROTECTION	☒ THERMOSTAT (3 Nos.,1 IN EACH PHASE) ☐ -----			
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED			
INTEGRAL STARTER	INTEGRAL STARTER	☒ REQUIRED ☐ NOT REQUIRED			
	TYPE OF SWITCHING DEVICE	☒ CONTACTORS(Reversing type) ☐ THYRISTORS			
	TYPE	☒ CONVENTIONAL ☐ SMART (NON-INTRUSIVE)			
	IF SMART				
	a) SERIAL LINK INTERFACE	☐ INTEGRAL ☐ FIELD MOUNTED			
	b) SERIAL LINK PROTOCOL	☐ FOUNDATION FIELD-BUS ☐ PROFI-BUS ☐ DEVICE NET ☐			
	c) SERIAL LINK MEDIA	☐ TWISTED PAIR Cu-CBL ☐ CO-AXIAL Cu-CBL ☐ OFC			
	d) HAND HELD PROGRAMMER	☐ REQUIRED ☐ NOT REQUIRED			
	e) TYPE OF HAND HELD PROGRAMMER	☐ BLUETOOTH ☐ INFRARED ☐			
	f) MASTER STATION	☐ REQUIRED ☐ NOT REQUIRED			
	g) MASTER STN INTRFACE WITH DCS	☐ MODBUS ☐ TCP/IP			
	h) DETAILS OF SPECIAL CABLE	☐ ENCLOSED ☐ NOT REQUIRED			
	STEP DOWN CONT. TRANSFORMER	☒ REQUIRED			
	OPEN-STOP-CLOSE PB(running open/close LED) THREE POSITION SELECTOR SWITCH	☒ REQUIRED ☐ NOT REQUIRED			
	INDICATING LAMPS	☒ REQUIRED ☐ NOT REQUIRED			
	LOCAL-OFF- REMOTE S/S(THREE POSITION SELECTOR SWITCH)	☒ REQUIRED ☐ NOT REQUIRED			
	STATUS CONTACTS FOR MONITORING	☒ REQUIRED ☐ NOT REQUIRED			
	INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (MOTOR THERMOSTAT TRIP/O/L RELAY OPERATED, CONT. /POWER SUPPLY FAILED, S/S IN LOCAL/REMOTE/OFF MODE, TORQUE SWITCH OPEN/CLOSE CUT OFF/STOP PB OPTD.)			
	INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	☐ INTERPOSING RELAY ☒ OPTO COUPLER ☐ EITHER		
		QUANTITY	☒ 2 Nos. ☐ 3 Nos.		
DRIVING VOLTAGE		☒ 20.5 – 24V DC ☐ _____ V DC			
DRIVING CURRENT		☒ 125mA MAX ☐ _____ mA MAX			
LOAD RESISTANCE		☒ > 192 ohms - <25 k ohms ☐ > _____ ohms - < _____ ohms			
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY			
	OPEN / CLOSE	☒ 1 No. ☐ 2Nos. / ☒ 1 No. ☐ 2Nos			
	CONTACT TYPE	2 NO + 2 NC			
	RATING	10A 240V AC AND 0.5A 220V DC			
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE			
	ACCURACY	+3% OF SET VALUE			
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY			
	OPEN : INT : CLOSE	☒ 2 Nos. 2 nos(adj) 1 No.	☒ 2Nos.		
	CONTACT TYPE	2 NO + 2 NC			
	RATING (AC / DC)	10A 240V AC AND 0.5A 220V DC			

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.04.18
			SHEET 3	OF 4
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty & other specific applications)	REQUIRED for regulating/inching duty only.		
	MFR & MODEL NO.	BIDDER TO SPECIFY		
	TYPE	☐ ELECTRONIC (2 WIRE) R/I CONVERTER ☒ ELECTRONIC (2 WIRE) contactless inductive type		
	SUPPLY	☒ 24V DC ☐		
	OUTPUT	☒ 4-20mA		
	ACCURACY	$\pm 1\%$ FS		
SPACE HEATER	@SPACE HEATER	REQUIRED		
	@ POWER SUPPLY (NON INTEGRAL)	240V AC, 1 PH., 50 Hz		
	@ POWER SUPPLY (INTEGRAL)	BIDDER TO SPECIFY		
	@ RATING			
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED		
	ENCL CLASS ACTUATOR/MOTOR T.B.	☒ IP 68 @ ☐ NEMA6		
	@ EARTHING TERMINAL	REQUIRED		
	PLUG & SOCKET (9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	☒ REQUIRED ☐ NOT REQUIRED ☐ ☒ 2 NOS. ☐		
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:-----		
	@ SPACE HEATER CABLE GLAND	SIZE:-----		
	OTHER CONTROL CABLE GLANDS-1	☐ 1No. for BFV of CW PUMP (Cable size 2Px1.5mm ²)		
	OTHER CONTROL CABLE GLANDS-2	1 no suitable for 8P X 0.5 sq mm Additional 1 no suitable for 2P X 0.5 sq mm (inching duty only)		

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.04.18
			SHEET 4	OF 4
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.	
NOTES: SCOPE: DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY. CODES & STANDARDS: DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH: IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722 - TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C. - CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED. - THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE. - THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%. - THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING. \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE. ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS. - IT SHOULD BE POSSIBLE TO OPERATE THE ACTUATOR LOCALLY. LOCKABLE LOCAL/REMOTE SELECTION SHALL BE PROVIDED ON THE ACTUATOR. - POSITION INDICATOR SHALL BE PROVIDED FOR 0 TO 100 % TRAVEL - WIRING SHALL BE SUITABLE VOLTAGE GRADE COPPER WIRE 1.5 SQ. MM. - THE MOTOR SHALL BE CAPABLE OF STARTING AT 85 PERCENT OF RATED VOLTAGE AND RUNNING AT 80 PERCENT OF RATED VOLTAGE AT RATED TORQUE AND 85 PERCENT RATED VOLTAGE AT 33 PERCENT EXCESS RATED TORQUE FOR A PERIOD OF 5 MINUTES EACH. - THE ACTUATORS SHALL BE DESIGNED TO BE SELF-LOCKING UPON LOSS OF POWER. MOTOR SHALL BE DESIGNED TO CLOSE IN 30 SECS. FROM FULL OPEN POSITION AND SHALL HAVE ADEQUATE CAPACITY TO OPEN AND CLOSE UNDER FULL UNBALANCED DESIGN PRESSURE. - THE INTEGRAL STARTER WHICH SHALL HAVE SOPHISTICATED ELECTRONIC CONTROLS WITH FIELD PROGRAMMING FEATURE. IT SHALL BE DESIGNED FOR REMOTE CONTROL FROM DCS/RESPECTIVE CONTROL SYSTEM. REQUIRED INTERPOSING RELAYS FOR RECEIVING OPEN/CLOSE/STOP COMMAND FROM DCS/RESPECTIVE CONTROL SYSTEM SHALL BE PROVIDED. POTENTIAL FREE CONTACTS AND TRANSDUCERS SHALL BE PROVIDED TO PROVIDE STATUS INDICATION AT REMOTE DCS/RESPECTIVE CONTROL SYSTEM. - THE REMOTE COMMAND SIGNAL (OPEN-STOP-CLOSE) FROM DCS/RESPECTIVE CONTROL SYSTEM/CONTROL PANEL SHALL BE ISOLATED FROM CONTROL ELECTRONICS THROUGH OPTO-ISOLATOR. - THE FOLLOWING INDIVIDUAL STATUS ANNUNCIATION LED'S (COLOUR-GREEN) SHALL BE PROVIDED LOCALLY (INTEGRAL TO ACTUATOR) TO ANNUNCIATE THE FOLLOWING FOR EASY LOCAL MONITORING. ACTUATOR IN LOCAL MODE ACTUATOR IN REMOTE MODE ACTUATOR RUNNING IN OPEN DIRECTION ACTUATOR RUNNING IN CLOSE DIRECTION ACTUATOR IN INCHING MODE. ACTUATOR IN SELF-RETAINING MODE LIMIT SWITCH OPEN TRIP LIMIT SWITCH CLOSE TRIP CONTROL VOLTAGE AVAILABILITY				
NOTES* = TO BE FILLED BY MPL (LEAD AGENCY). @ = TO BE FILLED BY ES				

3-V-MISC-24283

DRAWING NO.

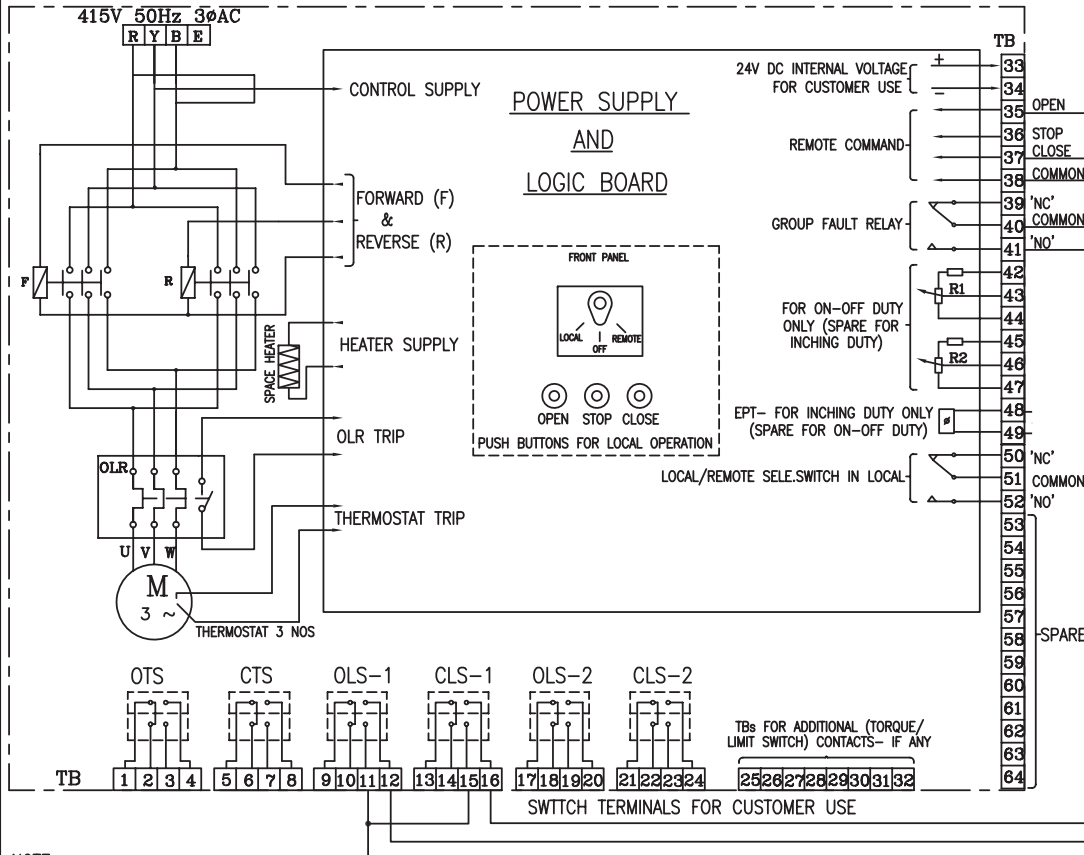

NOTE:-

- ALL TORQUE AND LIMIT SWITCHES (OTS, CTS, OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
- CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
- OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
- OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
- CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
- EPT - ELECTRONIC POSITION TRANSMITTER (CONTACTLESS TYPE, FOR INCHING DUTY)
- R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
- FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
- M - MOTOR 3Φ 415V 50 Hz AC SUPPLY
- TORQUE SWITCH BYPASS WITH LIMITSWITCH BOTH ON OPEN & CLOSE DIRECTION TO BE DONE INTERNALLY.

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT

ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS
2 X 800 MW UPPLUR TPE
(DRAWN FOR INTERMEDIATE POSITION OF VALVES)



BHARAT HEAVY ELECTRICALS LTD.,
UNIT: HIGH PRESSURE BOILER PLANT.
TIRUCHIRAPALLI-620014.

DEPT VL
CODE -



SCALE
NTS

WEIGHT (KG).
-

TITLE
WIRING DIAGRAM (TERMINAL PLAN)
FOR ACTUATOR WITH INTEGRAL STARTER WITH PLUG & SOCKET


DRN	NAME	SIGN	DATE	NO. OF VAR.
CHD	N.P.ESWAR	N.P.	17.03.05	-
APPD	D.DINAKARAN	D.D	17.03.05	-
	K.ARUNACHALAM	K.A	17.03.05	-

REFERENCE INFORMATION
DRAWING NO.
3-V-MISC-24283


CARD CODE
U 01

REV
0

9 PIN PLUG & SOCKET
(FOR ALL ACTUATORS)

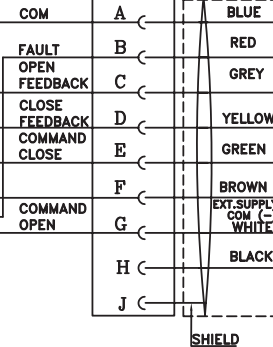

9 pin PLUG & SOCKET
(FOR ALL ACTUATOR)

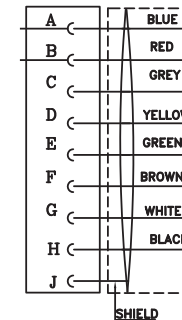

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL				
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL				
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL				
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL				
OLS-1	9-10					
	11-12					
CLS-1	13-14					
	15-16					
OLS-2	17-18					
	19-20					
CLS-2	21-22					
	23-24					
SWITCH	TERMINAL NO.	FULL OPEN	a	INTERMEDIATE	b	FULL CLOSE
		VALVE POSITION				

INDICATES CONTACT CLOSED

INDICATES CONTACT OPEN

CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#
# - CLS NOT TO BE CONNECTED IN TRIP CIRCUIT				
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)				

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
SUMP PUMP		



CONTROL WRITE-UP FOR SUMP PUMPS SYSTEM

PROJECT: 2X660 MW TANGEDCO
UDANGUDI STAGE-I STPP

DRAWING NO:

REV. NO. 00

DATE:

SHEET 1 OF 2

CONTROL & INSTRUMENTATION FOR SUMP PUMP SYSTEM

Introduction- Sump pumps are used to dewater various sump pits to nearest surface drain in the power house and other plant areas to ensure general housekeeping.

The system shall normally have 2 pumps. The measuring instruments recommended are level switches(float/displacer type) for level measurement and control of the system and pressure gauges at pump discharge for local pressure measurement. Any other instruments can be included dependent on the requirement or if demanded by the customer.

The sump pumps can be fixed submersible type where the pumps are fixed and submerged or can be portable submersible type where the pumps are trolley based and can be moved as per the need. In fixed type the level switches can be mounted at a suitable mounting place while in portable type the level switches are ported to the sump along with the pumps. The mounting of switches and location of LCP shall be chosen so as to have minimum cable length between the level switches and the LCP.

CONTROL WRITEUP

The operation of Sump pumps(fixed and portable type) shall be as follows:

Sump Pumps shall be controlled through a starter cum control panel. The local control panel shall be front opening, relay based. The starter cum control panel shall be suitable for indoor or outdoor as per the location of the sump pumps. Normally one pump will be running and the other shall be on auto standby. The following controls/interlocks shall be provided in the local control panel.

Controls philosophy

CONTROLS

- (a) Start/stop facility for each pump from LCP.
- (b) Selector switch for main/standby selection.
- (c) Auto/Manual selector switch for each pump.

AUTO START/STOP

- a) One number level switch (high level) provided in the sump shall start one number sump pump in the event of high water level in the sump.
- b) One number level switch (very high level) provided in the sump shall start second sump pump in the event of very high water level in the sump.
- c) One number level switch (low level) provided in the sump shall stop the running pumps in the event of low water level in the sump.
- d) If any of the working sump pumps trips the standby sump pump will come into operation automatically provided the very low level signal is not present.

Indications

- a) Sump pumps status (ON/Off/Trip).
- b) Level indications(Low,High,V.High)



CONTROL WRITE-UP FOR SUMP PUMPS SYSTEM

PROJECT: 2X660 MW TANGEDCO
UDANGUDI STAGE-I STPP

DRAWING NO:

REV. NO. 00

DATE:

SHEET 2 OF 2

General requirements for measuring instruments

Measuring instruments/equipment and subsystems offered by the Bidder shall be from reputed experience manufacturers (from BHEL/customer approved vendor list) of specified type and range of equipment.. Further, all instruments shall be of proven reliability, accuracy, repeatability requiring a minimum of maintenance. All instrumentation equipment and accessories under this specification shall be furnished as per technical specifications, ranges, makes/ numbers as approved by BHEL during detailed engineering.

1. Every panel-mounted instrument, requiring power supply, shall be provided with a pair of easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a ground terminal and shall be suitably connected to panel grounding bus.
2. The necessary root valves, impulse pipings and all the other accessories required for mounting/erection of local instruments shall be furnished even if not specifically asked for.
3. Instruments shall be terminated up to LCP with control cable (1.5sqmm). The LCP shall be fully wired. All the necessary cables, flexible conduits, junction boxes and accessories for the above purpose shall be included.

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
QUALITY PLAN/CHECK LIST		



STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL

STD QUALITY PLAN NO.: PE-QP-999-145-I056	
VOLUME	IIB
SECTION	D
REV. NO.	01
DATE:	22-02-2008
SHEET	1 OF 7

Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks
									P	W	V	
1.0	INCOMING Sheet Steel (CRCA & HR)	1. Chemical Composition	MA	Chemical analysis	Sample	IS:1079 IS:513	IS:1079 IS:513	Test Certificate	3	---	2	
		2. Bend Test	CR	Mech. test	Sample	IS:1079 IS:513	IS:1079 IS:513	Log Book	2	---	---	
		3. Surface finish	MA	Visual	100%	Factory Standard / Sample	Factory Standard / Sample	Log Book	2	---	---	
		4. Waviness	MA	Visual	100%	Factory Standard	No Waviness	Log Book	2	---	---	
		5. Thickness	MA	Measurement	100%	BHEL Spec.	BHEL Spec.	Log Book	2	---	---	
		6. Mill marking	MA	Visual	100%	Factory Standard	Factory Standard	Log Book	2	---	1	
2.0	Flats / Angles / Channels	1. Dimensions	MA	Measurement	Sample	IS:2062	IS:2062	Log Book	2	---	---	
		2. Surface Defects	MA	Visual	100%	Factory Standard / Sample	Factory Standard / Sample	Log Book	2	---	---	
		3. Straightness	MA	Measurement	100%	Factory Std.	Factory Std.	Log Book	2	---	---	
		4. Mill marking	MA	Visual	100%	IS:2062	IS:2062	Log Book	2	---	1	
3.0	Cables / Wires	1. Visual / Surface defects	MA	Visual	100%	BHEL Spec. and IS:1554 or IS:694	BHEL Spec. and IS:1554 or IS:694	Log Book	2	---	---	
		2. IR and HV	MA	Electrical	100%	BHEL Spec. and IS:1554 or IS:694	BHEL Spec. and IS:1554 or IS:694	Log Book	2	---	---	

LEGEND: * CR - Critical characteristics
MA - Major characteristics
MI - Minor characteristics

^{\$} P - Agency Performing the Test.
W - Agency Witnessing the Test.
V - Agency Verifying the Test.

1 - BHEL
2 - Vendor
3 - Sub-vendor



PEM :: C&I

STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL

STD QUALITY PLAN NO.: **PE-QP-999-145-I056**

VOLUME IIB

SECTION D

REV. NO. **01** DATE: **22-02-2008**

SHEET 2 OF 7

Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks
									P	W	V	
		3. Conductor a) Resistance b) Size c) Sheet colour	MA MA MA	Electrical Measurement Visual	100% 100% 100%	BHEL Spec. and IS:1554 or IS:694	BHEL Spec. and IS:1554 or IS:694	Log Book	2	---	---	
		4. Type / Routine Test Certificates	MA	Verification	100%	BHEL Spec. and IS:1554 or IS:694	BHEL Spec. and IS:1554 or IS:694	Log Book	3	---	2	
4.0	Electrical Components like Annunciator Transformers Lamps Switches PBs Contactors Relays Timers Space Heaters Thermostat Indicating meters etc.	1. Verification at make and Type	CR	Visual	Sample	BHEL Spec. and BOM	BHEL Spec. and BOM	Log Book	2	---	---	+ for relay & contactors only @ for all components except relays & contactors.
		2. Verification of Test Certificates	CR	Scrutiny of Type / Routine T.Cs.	100%	Relevant IS	Relevant IS	Log Book	2	---	---	
		3. Operation / Functional check	CR	Electrical	Sample+ 100%@	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Log Book	2	---	---	
		4. I.R.	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Log Book	2	---	---	
		5. H.V.	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Log Book	2	---	---	
		6. Calibration	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Log Book	2	---	1	
		7. Pick up / Drop off Voltage	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Log Book	2	---	---	
LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics \$ P - Agency Performing the Test. W - Agency Witnessing the Test. V - Agency Verifying the Test. 1 - BHEL 2 - Vendor 3 - Sub-vendor												

 PEM :: C&I	STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL							STD QUALITY PLAN NO.: PE-QP-999-145-I056				
								VOLUME IIB				
								SECTION D				
								REV. NO. 01 DATE: 22-02-2008				
								SHEET 3 OF 7				
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks
5.0	Misc. Components like Gaskets, Terminal Blocks etc.	1. Verification of Type / Make	MA	Visual	Sample	BHEL Spec. & Mfrs. Catalogue	BHEL Spec. & Mfrs. Catalogue	Log Book	2	---	---	
		2. Surface defects	MA	Visual	Sample	BHEL Spec. & Mfrs. Catalogue	BHEL Spec. & Mfrs. Catalogue	Log Book	2	---	---	
		3. IR / HV on Terminal Blocks	MA	Electrical	Sample	BHEL Spec. & Mfrs. Catalogue	BHEL Spec. & Mfrs. Catalogue	Log Book	2	---	---	
6.0	IN PROCESS Blanking / Bending / Forming	1. Dimensions	MI	Measurement	100%	Approved Mfr. drgs.	Approved Mfr. drgs.	Log Book	2	---	---	
		2. Surface defects after bending	MA	Visual	100%	Factory Standard	Factory Standard	Log Book	2	---	---	
7.0	Nibbling / Punching	1. Cutout Sizes	MI	Measurement	100%	Approved Mfr. drgs.	Approved Mfr. drgs.	Log Book	2	---	---	
		2. Deburring	MA	Visual	100%	Approved Mfr. drgs.	Approved Mfr. drgs.	Log Book	2	---	---	
8.0	ASSEMBLY Frame Assembly & Sheet fixing	1. Dimensions	MA	Measurement	100%	Approved drg. / Mfr. Standards	Approved drg. / Mfr. Standards	Log Book	2	---	2	
		2. Alignment	MA	Measurement	100%	Approved drg. / Mfr. Standards	Approved drg. / Mfr. Standards	Log Book	2	---	2	
		3. Welding Quality	MA	Visual	100%	Approved drg. / Mfr. Standards	Approved drg. / Mfr. Standards	Log Book	2	---	2	
		4. Surface defects	MA	Visual	100%	Approved drg. / Mfr. Standards	Approved drg. / Mfr. Standards	Log Book	2	---	2	
LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics ^{\$} P - Agency Performing the Test. 1 - BHEL W - Agency Witnessing the Test. 2 - Vendor V - Agency Verifying the Test. 3 - Sub-vendor												



STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL

STD QUALITY PLAN NO.: PE-QP-999-145-I056	
VOLUME	IIB
SECTION	D
REV. NO.	01
DATE:	22-02-2008
SHEET	4 OF 7

Sl. No.	Component / operation	Characteristics Checked	* Cate gory	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks
									P	W	V	
9.0	Pre-treatment and Painting	1. Pretreatment Process	MA	Visual	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		2. Process parameters like bath temp. concentration etc.	MA	Measurement	Periodic	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		3. Dipping / Removal Time	MA	Measurement	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		4. Surface quality after every dip	MA	Visual	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		5. Primer after phosphating	MA	Visual, Thickness	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		6. Putty Application & Rubbing after primer	MA	Visual	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		7. Paint first coat	MA	Visual, Thickness	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		8. Putty Application and Rubbing after first coat of paint	MA	Visual	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
		9. Paint second coat	MA	Visual, Thickness, Scratch test Colour adhesion	100%	Factory Standard & IS: 6005	Factory Standard & IS: 6005	Log Book	2	---	1	
LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics \$ P - Agency Performing the Test. W - Agency Witnessing the Test. V - Agency Verifying the Test. 1 - BHEL 2 - Vendor 3 - Sub-vendor												

 PEM :: C&I	STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL							STD QUALITY PLAN NO.: PE-QP-999-145-I056				
								VOLUME IIB				
								SECTION D				
								REV. NO. 01 DATE: 22-02-2008				
								SHEET 5 OF 7				
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency \$			Remarks
P	W	V										
10.	Panel Wiring	1. Wiring Layout	MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
		2. Wiring Termination (Crimped Lugs)	MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
		3. Ferrule numbers	MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	---	
		4. Colour of wiring	MA	Visual	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	1	
		5. Size of Conductor	MA	Measurement	100%	Approved drgs. & Specs.	Approved drgs. & Specs.	Log Book	2	---	1	
11.	Component Mounting	1. Correct components	MA	Visual	100%	Approved drgs., Specs. & BOM	Approved drgs., Specs. & BOM	Log Book	2	---	---	
		2. Fixing	MA	Visual	100%	Approved drgs., Specs. & BOM	Approved drgs., Specs. & BOM	Log Book	2	---	---	
12.	FINAL Final Inspection	1. Workmanship	MA	Visual	100%	Factory Standard	Factory Standard	Inspection Report	2	1	1	At Random by BHEL, based on 100 % internal test reports by Mfr.
		2. Component layout (neatness, accessibility & safety) Mounting / Proper fixing of all components	MA	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
		3. Components identification Marking / Name plates	MA	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1	
LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics												
						\$	P - Agency Performing the Test.	1 - BHEL				
							W - Agency Witnessing the Test.	2 - Vendor				
							V - Agency Verifying the Test.	3 - Sub-vendor				

 PEM :: C&I		STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL						STD QUALITY PLAN NO.: PE-QP-999-145-I056					
								VOLUME		IIB			
								SECTION		D			
								REV. NO.		01		DATE: 22-02-2008	
								SHEET		6		OF 7	
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks	
									P	W	V		
		5. Dimensions	MA	Measurement	100%	BHEL approved drg. / Spec., BOM	BHEL approved drg. / Spec., BOM	Inspection Report	2	1	1	At Random by BHEL, based on 100 % internal test reports by Mfr.	
		6. Door functioning	MA	Functional	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1		
		7. Paint Shade	CR	Visual	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1		
		8. Paint Thickness	CR	Measurement	100%	BHEL approved drg. / Spec.	BHEL approved drg. / Spec.	Inspection Report	2	1	1		
		9. Workmanship of Gaskets	MA	Visual	100%	Factory Standard	Factory Standard	Inspection Report	2	1	1		
		10. Wiring Layout	MA	Visual	100%	BHEL approved drg.	BHEL approved drg.	Inspection Report	2	1	1		
		11. Wire Termination	MA	Pulling manually	Sample	-----	Firm termination	Inspection Report	2	1	1		
		12. Continuity	MA	Electrical	100%	-----	Continuity OK	Inspection Report	2	1	1		

LEGEND: *	CR	- Critical characteristics	\$	P	- Agency Performing the Test.	1	- BHEL
	MA	- Major characteristics		W	- Agency Witnessing the Test.	2	- Vendor
	MI	- Minor characteristics		V	- Agency Verifying the Test.	3	- Sub-vendor

 PEM :: C&I		STANDARD QUALITY PLAN FOR LOCAL CONTROL PANEL							STD QUALITY PLAN NO.: PE-QP-999-145-I056			
									VOLUME IIB			
									SECTION D			
									REV. NO. 01		DATE: 22-02-2008	
									SHEET 7		OF 7	
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency ^{\$}			Remarks
									P	W	V	
13.	TYPE TEST	Degree of Protection	CR	Mech. Protection	Sample	BHEL approved spec., drg relevant IS-13947 Part-1, IS-2148.	BHEL approved spec., drg relevant IS-13947 Part-1, IS-2148.	Type Test Certificate	3	---	1	
14	ROUTINE TEST	IR before & after HV Test	CR	Electrical	100%	BHEL approved spec., drg., BOM & relevant IS.	BHEL approved spec., drg., BOM & relevant IS.	Test Report	2	1	1	
15	FUNCTIONAL TEST	1. Control Logic Operation	CR	Electrical	100%	BHEL approved spec. / drg.	BHEL approved spec. / drg.	Inspection Report	2	1	1	
		2. Instrument Calibration	CR	Electrical	10%	BHEL approved spec. / drg.	BHEL approved spec. / drg.	Inspection Report	2	1	1	
		3. Temperature rise	CR	Electrical	100%	BHEL approved spec/drg. & relevant IS.	BHEL approved spec/drg & relevant IS.	Inspection Report	2	1	1	

LEGEND: * CR - Critical characteristics MA - Major characteristics MI - Minor characteristics			^{\$} P - Agency Performing the Test. W - Agency Witnessing the Test. V - Agency Verifying the Test.			1 - BHEL 2 - Vendor 3 - Sub-vendor		
---	--	--	--	--	--	--	--	--



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR TEMPERATURE GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	DIAL SIZE						
	MODEL NO./TAG NO./TYPE						
	RANGE/SCALE						
	END CONNECTION						
2	CALIBRATION			P	W	V	
	ACCURACY						
	REPEATABILITY						
	HYSTERESIS						
3	OVER TEMP. TEST	P		W	V		
4	AMBIENT TEMP. COMPENSATION CHECK	1 OF TYPE		P	V	V	
5	REVIEW OF TC FOR MATERIALS OF	FOR LOT		V	V	V	
	SENSOR						
	MOVEMENT						
	PROCESS CONNECTION						
	THERMOWELL						
	HOUSING						
	6			REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST	V	
7	THERMOWELL	SEE NOTE-1 BELOW	AS PER APPD DWG		V	V	
	MATERIAL TC & DIMN. CHECK						
	HYD.TEST						
	OVER RANGE TEST						

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- IBR certificate to be provided if called for in specn.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR PRESSURE & DP GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	SENSOR TYPE						
	DIAL SIZE						
	MODEL NO/TAG NO						
	RANGE/SCALE						
	SWITCH CONTACT RATING & NOS.						
	END CONNECTION						
2	CALIBRATION			P	W	V	
	ACCURACY						
	REPEATABILITY						
	SET POINT ADJUSTMENT						
3	OVER PRESSURE & LEAK TEST			P	W	V	
4	OPERATION OF PRESSURE. RELIEF DEVICE	ONE		P	W	V	
5	REVIEW OF TC FOR	FOR LOT		V	V	V	
	MATERIALS OF SENSOR						
	MOVEMENT						
	PROCESS CONNECTION						
	HOUSING						
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST		V	V	V	
7	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW		V	V	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- When material correlation is not available, MFR's compliance to be provided
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR FLOAT OPERATED LEVEL SWITCH

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	V	V	
	MODEL NO/TAG NO						
	TYPE						
	END CONNECTION						
2	ON/OFF DIFFL			P	W	V	
3	REPEATABILITY	SEE NOTE-5	---	P	W	V	
4	IR TEST			P	W	V	
5	HV TEST			P	V	V	
6	PR. TEST ON CHAMBER			P	V	V	
7	MATL. TC FOR CHAMBER & FLOAT	FOR LOT	---	V	V	V	
8	CONTACT CONFIG. & RATING FOR MICROSWITCH	FOR LOT	---	V	V	V	
9	TC FOR DEGREE OF PROTECTION	TYPE TEST	---	V	V	V	
10	MANUFACTURER TO ENSURE WELDING PROCEDURE, WELDERS & NDT AS PER ASME FOR PR >40 KG/CM ²	SEE NOTE-1 BELOW	---	P	V	V	
11	CHECK FOR TEMP. SUITABILITY FOR MICROSWITCH AND LEAD WIRE		---	V	V	V	
12	ACCESSORIES AS APPLICABLE		APPROVED SPEC./ DATA SHEETS	V	V	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- When material correlation is not available, MFR's compliance to be provided
- IBR certificates shall be provided wherever required.
- Contractor to provide compliance certificate for tests/checks verified by contractor and the same alongwith test certificates to be verified by BHEL



1.0.0 ERECTION, FIELD TESTING AND COMMISSIONING

- 1.1.0 The Bidder shall select and adopt methods and procedures for equipment erection to suit the nature of equipment and erection, involved according to the best modern industrial practice and his own experience.
- 1.2.0 The Bidder shall arrange for the transportation and handling of cabinets and desks from stores to work site suitably without any damage. If any damage is observed before handling, this shall be brought to the notice of the OWNER
- 1.3.0 Before installation of cabinets and desks, the necessary openings and inserts required to be made on the floor by the Bidder shall be checked and then after proper alignment, the cabinets and desks shall be installed on the floor by the Bidder. All necessary civil work to be carried out for this shall be in Bidder's scope of supply. The cabinets and desks shall be cleaned by blowing air to remove dust or foreign particles.
- 1.4.0 Nameplates shall be installed for all the I&C equipments bearing the service description, instrument number and calibrated range.
- 1.5.0 The data base covering the instrument No. type, application, process parameters, range, set point, calibrated/feasible range & span, maximum admissible value, recommended periodicity of calibration, other information for all the instruments, final control elements etc., for the unit, BOP, etc., shall be given in soft form.
- 1.6.0 All cables shall be tested for insulation level. Cable ends shall be properly cleaned. The entry to and exit from pipes shall be smooth and free from burr where cables are run through pipes. Cable shall be pulled into the pipes in such a way that there shall be no damage to the cables. Flexible conduits shall be provided wherever necessary. Cable in hot areas shall have proper heat protection. A minimum distance of 300 mm shall be kept between instrument / signal cables and power cables. Each tray shall be filled with a maximum of two layers for instrument and control cables and one layer for power cables providing 20% spare space in the number of layers specified. Instrument Cable Trays, shall be erected vertically as far as possible to avoid dust accumulation. All the cables laid shall be tied individually to the Tray. Thermocouple cables shall be run completely independent of all other cables with minimum separation as per relevant standard and with cross over at right angles. The cabling accessories shall include terminal blocks, splicing materials, crimping tools, cable support grips, insulating tapes, GI flexible conduits, conduit fittings, GI perforated covered trays, supports, accessories, and cadmium plated trays & cable glands.
- 1.7.0 The Bidder shall get prior approval as per approved quality assurance plan of the Owner Representative before any installation work starts. If any work is carried out by the Bidder before prior approval from Owner Representative and modification is sought by Owner Representative later, then the work shall be redone by Bidder without any cost / material implications to the Owner Representative. Impulse / sample piping, air supply and pneumatic tubing, cable trays and equipment shall be supported rigid enough to prevent vibration and anchored sufficiently to prevent strains on equipment installed. Supporting clamps shall be provided at least at every one meter distance for better rigidity. Impulse / sampling piping shall be provided with adequate slope, (preferably 1:10). Hanger and supports shall be so installed as not to interfere with free expansion and contraction of the piping and tubing between anchors. Suitable vibration dampeners, etc., shall be provided wherever necessary. In addition, care shall be taken that the arrangement of impulse / sampling piping, air supply and pneumatic tubing from detrimental sagging, mechanical injury, abuse due to unusual



service conditions from sources other than those due to pressure, temperature and vibrations. All impulse lines of joints shall be welded type unless otherwise specified.

- 1.8.0 The Bidder shall set up his own instrument laboratory. The calibration equipment shall cover complete range and shall have the desired accuracy of less than 0.1% or better. The Bidder shall follow the standard procedures for calibration of various instruments and as set by the manufacturer of instruments and as instructed by the Owner including any requirements of field calibration. First, the calibrations shall be carried out independently by the Bidder and later in the presence of Owner who shall certify the same. Proper documentation in this regard shall be maintained and handed over to the Owner
- 1.9.0 All the instruments shall be calibrated for the entire range of the instrument for which it is designed. Calibration shall include test for repeatability. After first commissioning, the instruments shall be tested for calibration again to check whether the instrument maintains its zero and maximum of the range. All instruments and control equipment shall be calibrated to read correctly to the satisfaction of Owner. All switches shall be tested for the actuation of both normally open and normally closed contacts at the desired set points and also for the fixed / differential settings. All the float / displacer operated level switches shall be tested for the movement of the float and linkages to make to break the switch contacts by filling up with water before installation. For such tests, necessary testing set up required shall be arranged by the Bidder. Air leak tests shall be performed on all flue gas impulse / sample lines, air supply and pneumatic lines. Necessary equipment such as portable compressor, connecting pipes, materials, cables and test gauges shall be provided by the Bidder. All the welding shall be carried out as per the relevant codes with electrodes approved by the Engineer-in-Charge. Only qualified welders approved by the Engineer-in-charge shall carry out the welding. IBR grade of welder will be required wherever IBR grade welding is involved. After IBR welding, radiography as per the required standard to be done by qualified welder. All threaded joints shall be jointed using teflon tapes and no other pipe jointing compound shall be used except on higher temperature services where graphited sealing compounds shall be used. Brand of Teflon tape, insulation tape, graphite compound is to be approved by the engineer in charge. Tubing shall be bent with correct size tubing bender whenever possible to avoid the use of fittings. Tubing cutter shall always be used to cut tubing. The use of short length of tubing in long runs shall be avoided. All tubing shall be run in such a manner as to give the maximum protection against mechanical damage. Tubing runs shall be grouped together where possible. Tubing shall be arranged so that couplings can be tightened without disturbing lines. Pipes or tubes installed but not connected, shall have the ends closed in an approved fashion to prevent the entry of foreign material such as caps or plugs. All cables finally entering JB's / cabinets shall run through flexible PVC conduits for approximately 500mm. Field mounted instruments shall be mounted on brackets, subpanels, or placed on a suitable pedestal. They shall be easily accessible from grade, ladder or platform. All local indicators shall be readable from grade or operating level, and if used for manual control, shall be visible from the related valve. Wherever possible, local mounted instruments shall be mounted at approximately 1.35 meters (4' 6") above the platform or floor in an accessible position. When an instrument is located at a distance of 2.5 meters or more from its pressure connection, an additional block valve and a vent valve shall be provided adjacent to the instrument. Vent valves shall be arranged, if necessary, with drain lines to ensure that operation of these valves does not create a hazard. If the pressure piping is of such length that the isolating valve is inaccessible from the instrument location, a suitable valve shall also be fitted at the instrument itself. All pressure instruments shall be installed vertically. Those for steam must be tapped directly from above, for pressure transmitters and switches, there shall also be a condensing leg. The same applies to gas and vacuum measurements, but adequate provision should be made to ensure no condensation can take place along the line, i.e. the slope shall be adequate to drain any condensate back to the main lines (sloping upwards from the sensing point). Tapping points for liquids shall be made at an angle of 45° from the bottom of the main pipe and these are to be sloped downwards from the sensing point. An exception is made in the case of the tapping point for fuel oil or corrosive fluid in which the pressure instrument shall not have direct contact with the process fluid. Glycerine or other suitable liquid shall be used as a medium to separate the fuel oil from the pressure instrument. When the pressure impulse line



is liquid filled, the measuring unit shall be compensated for static head. The head correction shall be stated on the unit.

- 1.10.0 Pipes shall be bent using pipe benders and any hot bending will be totally rejected. Pipe shall be cut, using pipe-cutting devices. Hot cutting will not be allowed.
- 1.11.0 Hydro test shall be performed for all other impulse lines / sampling lines / sensors. Necessary equipment such as hydro test pumps and temporary piping to the required point, fill pump etc., materials such as temporary gaskets, miscellaneous fasteners, etc. tools and tackles including test pressure gauges, etc. are to be provided by the Bidder. For all electrical actuators of the valves, functioning, setting and performance of limit switches / torque switches of various positions shall be checked before and after installation of the actuators. The position transmitters for inching applications shall also be calibrated. Pneumatic actuators shall be calibrated at site. PG test points shall be provided on the process line at various location by the Bidder.
- 1.12.0 Chipping of foundations, alignment, as required for instrumentation installations.
- 1.13.0 Fabrication and erection of stanchions/supports for all local instruments, junction boxes, etc. Fabrication and erection of suitable supports for surface mounted instruments.
- 1.14.0 Fabrication and erection of structural steel plates, angles, pipes, required for supporting ducts, trays, local instruments, etc., complete with bolts and nuts. (GI bolts and nuts shall be used wherever applicable or directed).
- 1.15.0 Painting of all stanchion/structures meant for instrumentation work (ducts, trays, pipe/ angle, supports, etc. as per specification). Colour and codes shall be strictly followed as per guidelines/ specifications as per direction of the Engineer-in-charge.
- 1.16.0 Earthing of the Instrumentation panels on the separate earthing pits (by others).
- 1.17.0 Double compression cable glands, cable lug, ferrules, cable identification tags, trefoil clamps for single core cables, cable dressing materials etc.
- 1.18.0 Cable sealing compound to prevent water entry wherever cables enters from outdoor to indoor areas.
- 1.19.0 Supporting structures for cable trays, cable racks, etc. using mild steel sections like channels, angles, flats, chequered plates etc. shall be in bidder's scope
- 1.20.0 Excavation & refilling of soil for buried cable trench / earthing with necessary materials.
- 1.21.0 GI Cable tray with all accessories and its MS supports.
- 1.22.0 Minor civil works like drilling, chipping and punching holes and openings in concrete floors, slabs, brick walls, fabrication of supporting structures, drainage of water from cable trenches and cleaning of all debris due to instrumentation installation.
- 1.23.0 Primary impulse tubing, laying of all types of cables, glanding and wiring and all kinds of pipe/tube fittings.
- 1.24.0 Fabrication and installation of primary tubing for pressure and differential pressure instruments complete with manifolds as per standards.
- 1.25.0 Erection & supply of the PVC instrument ducts(if required for the internal wiring of GCP cables), and perforated cable trays generally as per drawing including bends, tees, supports and opening wherever required, including provision of covers wherever required. No jumping of cables will be allowed.



- 1.26.0 Laying of multi-core / pair cables for all applications on perforated trays with proper tagging, dressing clamping, glanding and terminations (including proper termination of shields) at both the ends.
- 1.27.0 Laying of multi/single pair cables in trenches wherever required.
- 1.28.0 Interconnection wiring/tubing of various field mounted instruments, viz., transmitters, transducers, positioners etc.
- 1.29.0 Identification of each cable by proper tags at every 10 meters on the main tray as per cable schedule.
- 1.30.0 Fabrication of nipples from pipes and threading of the same wherever required.
- 1.31.0 Tapping/threading of coupling wherever required for special instruments.
- 1.32.0 Welding electrodes required for the complete of the job shall be in bidder's scope..
- 1.33.0 Completion/updating of Owner's drawings/documents as per the work done at site. This should be done before applying for completion certificate.
- 1.34.0 Pre-commissioning service and commissioning assistance during start-up of plant, wherever required.
- 1.35.0 Provision of copper wire, GI wires to panel earth bus, laying and grounding of the same to the system earth pits.
- 1.36.0 Fabrication and erection of canopy (single) for instruments, wherever required.
- 1.37.0 Minor modifications/repairs required to be done on the existing instruments namely, replacement of damaged signal tubes, tapping of damaged threads on couplings, tees and other fittings.
- 1.38.0 Identification of each cable by proper tag plate/ferrules at instrument ends, inside junction boxes and inside control room outside JB's by tagging the cables with SS tags as per the cable schedule.
- 1.39.0 Drilling holes on all Panels etc. for cables/ glands/ grommets, if required, after obtaining approval from the owner. Unused holes to be plugged after completion of job.
- 1.40.0 Grounding of shield for all shielded cables to respective instrument earth bus provided in the thermocouple head/junction boxes.
- 1.41.0 Sealing of switches with standard lead seals after final setting in the presence of Engineer-in-charge.
- 1.42.0 Painting of welded joints etc. as per the engineer in charge's instruction.
- 1.43.0 Excavating roads, laying cable road crossing sleeves and refilling and finishing wherever required.



2.0.0 LOOP TESTING

- 2.1.0 The action of the controller is set as prescribed. Controller settings for various modes of operation (Proportional band, reset and rate action) are at nominal value. For current signals, 4 – 20 mA shall be injected and checked the loop for 0%, 25%, 50%, 75% and 100% of full-scale inputs. For temperature loops with thermocouples, a known milli volt signal shall be injected and the output display shall be checked for input signals of 0%, 25%, 50%, 75% and 100%. For temperature loops with RTDs, a known resistance shall be injected in the control cable through decade resistance box and Output display shall be checked for 0%, 25%, 50%, 75% and 100%. For field mounted switches for alarms / interlocks, the action shall be simulated by disconnecting the wires / shorting the terminals and the function of the associated system shall be checked. Any equipment required by the Bidder for testing, calibration and commissioning shall be brought by the Bidder at site. The list of such equipment shall be furnished along with the offer
- 2.2.0 Prior to taking the instruments in service, all impulse lines, sampling lines and air supply lines shall be blown as required with the establishment of adequate line pressure and temperature conditions to keep the lines thoroughly clean. On-line i.e., without removing control valves from the pipe, calibration of the positioners and stroking of control valves / control dampers shall be carried out as required during control system tuning. Pre-commissioning checks, individuals loop checks, power initialisation, verification of system functioning, trouble shooting final solutions to application and / or instrument problems, etc., is Bidder's responsibility. All the required software and hardware changes shall be incorporated as required for successful commissioning to Owner satisfaction. Any other tests as may be directed by the Owner Representative. After delivery of the equipment, the Bidder shall locate all the equipment including electronic cards in its final position, check all the power wiring, grounding and interconnection cables, all in accordance with manufacturer's recommendations. The Bidder shall perform initialisation of system power, field loading of system configuration / software and data base, demonstration of system functionality to verify conformance with manufacturer's instructions and specifications, tuning of control loops, implementation of any configuration changes including hardware, software and additional tapping's / instruments, cabinets as required and providing general trouble shooting and final solutions to application and / or instrument problems.
- 2.3.0 The Bidder shall take care to complete all pre-commissioning activities and simulation tests after erection to suit the over all start up of respective plant equipment. The controllers shall be tuned as per the process requirement. The list of set points, alarms / Interlocks, settings for the controllers shall be furnished in the standard format and handed over to the Owner.. Control loops shall be put in auto mode as per the operational requirement of different phases. Processor, Bus Worst loading conditions calculation and other control system performance requirements shall be proved at the time of commissioning. Before taking over of the plant by the OWNER , all the system and auto control loops shall run satisfactorily for at least one month at varying loads without disturbing any adjustment. During this period, supervision and maintenance of the system shall be the scope and responsibility of the Bidder. The performance test shall be carried out for the system offered and certificates to these effects shall be approved by the OWNER .

3.0.0 INSPECTION, TESTING, GUARANTEE & SPECIAL TOOLS / TACKLES

- 3.1.0 After manufacturing all the I&C equipments / instruments shall be factory tested and calibrated. All the required test certificates, calibration certificates for the I & C equipments / instruments to be submitted to the Owner for approval before the dispatch of the same is allowed from the factory. As a minimum hydro-test, accuracy & repeatability test, over-range test, leak test, HV test, insulation test, functional tests, temperature rise test shall be conducted as applicable for the instruments and the control system. The electronic equipments shall be subjected to burn in test and tests as per IEC 68. The details of the test to be carried out for the I & C equipment shall be submitted for the Owner consent/approval



before proceeding with the test. Bidder shall submit a detailed quality assurance program for individual I & C equipments / instruments for Owners for approval.

3.2.0 Tests for DCS / SG control / STG control / PLC system will include the following:

3.2.1 Factory Acceptance Test (FAT):

To be carried out at BIDDER's / Sub-Vendor's works and witnessed by Owner/Engineer, successful completion of which will be the basis for 'Authorization for Shipment to Site'. FAT shall be a complete integrated test of the system and carried out at BIDDER's / Sub-Vendor's works on completion of manufacturing of the system. The test shall be performed with the completely assembled system and performing all the functions, it is expected to perform while in actual service. The BIDDER shall submit a detailed "Factory Acceptance Test Procedure" in line with the above specified guidelines for Owner approval. The FAT shall be conducted as an integrated test of plant I&C system integrating the control system supplied by Other Vendors.

FAT shall be preceded by a 'Pre- FAT Inspection/ Test' to be carried out by Bidder/Vendor. Pre-FAT inspection / test shall be carried out as per approved FAT procedure detailed above and shall submit 'Pre- FAT Inspection/ Test' report for Owners review and approval. Owner shall witness the actual FAT on the basis of successful completion of 'Pre- FAT Inspection/ Test'.

3.2.2 Site Test (SAT):

Involves tests for site commissioning, calibration of monitoring and control equipment, Integrated loop test wiring, Trial Operation of the system functioning. Site guarantee tests for system performance & availability to be conducted in the presence of Owner. The reliability run shall be conducted for one month period. During the reliability run if the I&C system fails to meet the specific requirements, then the Bidder shall take immediate remedial actions and the procedure shall be restarted again for the reliability run. After the completion of the reliability run with full satisfaction of the Owner, the system shall be deemed for take over and this shall mark the commencement of warranty period.

Special tools and equipment for the maintenance, inspection and repair of the individual main equipment and auxiliary equipment shall be supplied by the Bidders in sufficient quantity to equip the shift personnel, maintenance personnel and workshop craftsman.

The special tools and equipment for maintenance and repair shall be delivered by the bidder in lockable steel boxes and they shall be marked in an approved manner for identification purposes and a corresponding tool chart shall be supplied with the steel boxes

The I&C systems offered by the Bidder shall be provided with guarantee period which will start from the date of handing over to the owner and Bidder to indicate the same in his offer.

Latest version of hardware and software available at the time of system designing shall be provided. In case of future up-gradation of software, Bidder shall remain committed to upgrade the supplied system with the new version within the warranty period. Beyond the warranty period and during the remaining life of the plant, any up gradation in hardware and software shall be brought to the notice of Buyer. Bidder shall ensure that supplied controls & instruments should be supported by the supplier such that spare parts are guaranteed to be available for purchase for a period of 15 (Fifteen) years. Similarly the service shall also be guaranteed for a period of 15 (Fifteen) years.

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
MANDATORY SPARES		

2x660 MW UDANGUDI TPS STAGE-I - EPC		
MANDATORY SPARES FOR CONTROL & INSTRUMENTATION		
SI. NO.	PARTICULARS	QUANTITY
1	RTD's of each type and length(with head assembly, terminal block & nipple)	10% or 2 nos. of each type and length, whichever is more
2	Thermocouples of each type like K-type, R-type, metal etc. (with head assembly, terminal block & nipple)	10% or 2 nos. of each type and length which ever is more
3	Local Indicators like temperature gauges, pressure gauges, differential pressure gauges, flow gauges, flow meters etc.,	10% or 2 no. of each make, model and type whichever is more and for each plant (to be divided to various ranges in proportion to main of all make, model, type population)
4	Process Actuated Switch Devices Includes all types of Pressure, differential pressure, flow, temperature, differential temperature, level switch Devices	5% or 1 no. of each type and model whichever is more
5	POWER SUPPLY SYSTEM – 24 VDC (To be provided for each system)	
	Silicon controlled thyristors, diodes, power transistors	100%(1 Lot)
	Capacitors	1 set
	Filter regulators	20% of each model or 2 nos. whichever is more.
6	INSTRUMENTATION CABLE, INTERNAL WIRING & ELECTRICAL FIELD	
	Pre fabricated cable of each type.	10% of installed quantity
	Pre fabricated cable connector of each type	10% or 1 no. of each type and model, whichever is more.
	Other cables	5% of each type, pair and size of actual installed quantity
7	Electrical actuator, complete assembly, of each rating	2 Nos.
Note: Mandatory Spares mentioned here are inline with spares list received from PG vide email dated 23.03.2018. Quantity mentioned is considered for 2 Units		

	2X660 MW TANGEDCO UDANGUDI STAGE-I STPP	
	SPECIFIC TECHNICAL REQUIREMENTS (C&I) NATURAL DRAUGHT COOLING TOWER	
SUB VENDOR LIST		

PACKAGE WISE REGISTERED SUPPLIER LIST AS ON 18/05/2018

Package Name	Supplier Name	Supplier Communication Address
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	BOSE PANDA INSTRUMENTS PVT.LTD.	Mr. Partha Bose 44, Saheed Hemanta Kumar Bose, Sarani, Kolkata Phone- +91 33 2548 7220 Pincode : 700074 Email : parthabosebpi@gmail.com; bsepanda@vsnl.net
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
TEMPERATURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com
TEMPERATURE GAUGE	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
TEMPERATURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
TEMPERATURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
TEMPERATURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
TEMPERATURE GAUGE	GOA THERMOSTATIC INSTRUMENTS PVT.LTD.	FLAT -B , GF, HILL CROWN APTS., COLLEGE ROAD, MAPUSA Phone- Pincode : 403525 Email : gtilworks@pyro-electric.in
TEMPERATURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in
TEMPERATURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
TEMPERATURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
LEVEL GAUGE	TOSHNIWAL BROTHERS PVT.LTD.	WORKS:TOSHNIWAL IND.PVT.LTD, INDUSTRIAL ESTATE MAKHUPURA, AJMER Phone- 441171 Pincode : 305002 Email : toshniwalprocess@gmail.com
LEVEL GAUGE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com

Package Name	Supplier Name	Supplier Communication Address
LEVEL GAUGE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
TEMP. ELEMENT	PYRO ELECTRIC INSTRUMENTS GOA PVT.LTD.	M. D. BICHU/R. M. BICHU G.B, HILL CROWN APARTMENTS, COLLEGE ROAD, MAPUSA Phone- 9326114601 Pincode : 403507 Email : priyanka.marketing@pyro-electric.in
TEMP. ELEMENT	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
TEMP. ELEMENT	DETRIVE INSTRUMENTATION & ELECTRONICS LTD.	320, TV INDUSTRIAL ESTATE, OFF.DR.A.BESANT ROAD, BEHIND GLAXO, WORLI, MUMBAI Phone- 24934125,24938403 Pincode : 400025 Email : trivitech@vsnl.com
TEMP. ELEMENT	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
TEMP. ELEMENT	Thermal Instrument India Pvt. Ltd.	Mr. Raghavendra M. Kulkarni 194/195, Gopi Tank Road Behind Citylight Cinema,Mahim Mumbai Phone- 09322664709 Pincode : 400016 Email : ramk@giconindia.com
TEMP. ELEMENT	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
TEMP. ELEMENT	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
TEMP. ELEMENT	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
TEMP. ELEMENT	Tempsens Instrument (I) Pvt Ltd	MR. V.P.RATHI/MR. HEMANT RATHI B-188A ROAD NO.5 , M.I.A UDAIPUR Phone- 09352420069 Pincode : 313003 Email : info@tempsens.com
TEMP. ELEMENT	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
JUNCTION BOX	SUCHITRA INDUSTRIES	NO-2,OPP-27 AECS LAYOUT 2ND STG REJAMAHALVILAS EXTN 2ND STG BANGALORE Phone- Pincode : Email : suchitra.industriesblr@gmail.com
JUNCTION BOX	K.S.INSTRUMENTS PVT.LTD.	S Raghavan No. 72, 3rd Main, 1st Stage Industrial Suburb, Yeshwanthpur Bangalore Phone- 9880385770 Pincode : 560022 Email : sales1@ksinstruments.net
JUNCTION BOX	Shrenik & Company,	Mr. Mitesh Shah/Mr. Pulin Shah 39 A/3 ,Panchratna Industrial Estate, Sarkhej-Bavla Road Ahmedabad Phone- 9825024921 Pincode : 382213 Email : sales@pustron.com, pulin@sumip.com
JUNCTION BOX	FLEXPRO ELECTRICALS PVT. LTD.	Mr. Dineshbhai Zaveri C-1/ 27&37, GIDC, Kabilpore, Navsari Phone- 02637-265140,265003 Pincode : 396424 Email : flexpro@flexproltd.com
JUNCTION BOX	AJMERA INDUSTRIAL & ENGINEERING WORKS	JIGNESH MAHENDRA AJMERA DENA BANK BLDG.,SHREE NAGESH INDL. ESTATE,STATION ROAD, MUMBAI Phone- 022 67973578 Pincode : 400 088 Email : ajmera@ajmera.net, imajmera@yahoo.com
INSTRUMENTS TUBE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
INSTRUMENTS TUBE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
INSTRUMENTS TUBE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
INSTRUMENTS TUBE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
LEVEL SWITCH-CAPACITANCE TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
LEVEL SWITCH-CAPACITANCE TYPE	V. AUTOMAT & INTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
LEVEL SWITCH-CAPACITANCE TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com

Package Name	Supplier Name	Supplier Communication Address
LEVEL SWITCH-CAPACITANCE TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
LEVEL SWITCH-CAPACITANCE TYPE	Flow Star Engineering Pvt. Ltd.,	MR. KHALID AKHTAR/MR. TAPAN KUMAR JANA Plot No-7 F/2, Northern India Industrial 20/3, Mathura Road FARIDABAD Phone- 9818176380 Pincode : 121005 Email : khalid@flowstar.co.in
LEVEL SWITCH-CAPACITANCE TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
LEVEL SWITCH-CAPACITANCE TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
LEVEL SWITCH-CONDUTIVITY TYPE	Sapcon Instrument Pvt Ltd.	131, PALSHIKAR COLONY Contact Person- Mr. Ashwin (9826080207) INDORE Phone- +91-731-4085751, Pincode : 452004 Email : sales@sapconinstruments.com
LEVEL SWITCH-CONDUTIVITY TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
LEVEL SWITCH-CONDUTIVITY TYPE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com
LEVEL SWITCH-CONDUTIVITY TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
LEVEL SWITCH-CONDUTIVITY TYPE	HI-TECH SYSTEMS & SERVICES LTD.	Mr. Vikash Agrawal/Mr. Tarun Debnath 119, PARK STREET , KOLKATA Phone- 033-2290045 Pincode : 700016 Email : sandeep@hitech.in
LEVEL SWITCH-CONDUTIVITY TYPE	RAMAN INSTRUMENTS PVT.LTD.	Mr. N R Shenoy/Mr G B Vijh 8, First Floor.Plot : 160A Bait-Ush-Sharaf, 29th Road,Bandra(W) MUMBAI Phone- 09892331381 Pincode : 400050 Email : ramanbpl@vsnl.com
LEVEL SWITCH-CONDUTIVITY TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
LEVEL SWITCH-CONDUTIVITY TYPE	SOR INC.	LARRY DEGARMO/Avdhes Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhes@shermanindia.com,
LEVEL SWITCH-FLOAT TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
LEVEL SWITCH-FLOAT TYPE	D.K. INSTRUMENTS PVT.LTD.	N.SIKDAR/ SUMIT SIKDAR 76/2,SELIMPUR RD DHAKURIA Kolkata Phone- 033-2415-1310. Pincode : 700031 Email : dkinst@vsnl.net
LEVEL SWITCH-FLOAT TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
LEVEL SWITCH-FLOAT TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
LEVEL SWITCH-FLOAT TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
LEVEL SWITCH-FLOAT TYPE	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com
LEVEL SWITCH-FLOAT TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
LEVEL SWITCH-FLOAT TYPE	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in
LEVEL SWITCH-FLOAT TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
LEVEL SWITCH-FLOAT TYPE	SOR INC.	LARRY DEGARMO/Avdhes Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhes@shermanindia.com,
INSTRUMENTS PIPE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com

Package Name	Supplier Name	Supplier Communication Address
INSTRUMENTS PIPE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
INSTRUMENTS PIPE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
INSTRUMENTS PIPE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
INSTRUMENT FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
INSTRUMENT FITTINGS	Comfit & Valve Pvt. Ltd.	Mr. Jeetu Jain/Mr. Vinay Sosa Survey No. 23/1, Part 2, Ahmedabad-Mehsana Highway Laxmipura, Nandasan Phone- 02764-267036/37 Pincode : 382705 Email : marketing@com-fit.com
INSTRUMENT FITTINGS	HP VALVES & FITTINGS INDIA PVT. LTD.	S. Harichandran/P.S. Pandi B-11, Mugappair Industrial Estate, CHENNAI Phone- 044 26252537 Pincode : 600037 Email : sales@hpvalvesindia.com
INSTRUMENT FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
INSTRUMENT FITTINGS	Perfect Instrumentation Control (India) Pvt. Ltd.	MD Hussain Shaikh/Shahanawaz Khan Gala No. 168, Loheki Chwal,216/ 218, Maulana Azad Rd. Nagpada Junction Mumbai Phone- 91-9324383121 Pincode : 400008 Email : shahanawaz.khan@perfectinstrumentation.com
INSTRUMENT FITTINGS	Arya Crafts & Engineering Pvt. Ltd.	Mr.Sanjay Brahman/Mr.Shyam Vazirani 102, Vora Industrial Estate No.4 Navghar, Vasai Road (E) Dist.Thane, Mumbai Phone- +91-250-2392246 Pincode : 401210 Email : arya@aryaengg.com
INSTRUMENT FITTINGS	FLUIDFIT ENGINEERS PVT. LTD.	Mr. Abbas Bhola Potia Building No. 2, Office No. 3,292, Bellasis Road,Mumbai Central (East) Mumbai Phone- 9920044113 Pincode : 400008 Email : ab@fluidfitengg.com
INSTRUMENT FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
INSTRUMENT FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
INSTRUMENT FITTINGS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com.

Notes:

- The above sub-vendor list is tentative & reference only. However Sub-Vendor List is subject to BHEL/ end user approval without any commercial/ delivery implication.
- New Sub-Vendor if proposed by Vendor during contract stage shall subject to BHEL/ end user approval without any commercial/ delivery implication.