


APPROVED WITH
COMMENTS MENTIONED
IN MAIL DT. 21.09.2017

Rakesh Mondal

राकेश मंडल / RAKESH MONDAL
एच.ई. अभियंता / Sr. Engineer
नवीकरण एवं अनुसंधान विभाग भारतीय रेलवे
R & M Systems Group
बी.एस.ई.एल., भोपाल / BHEL, BHOPAL

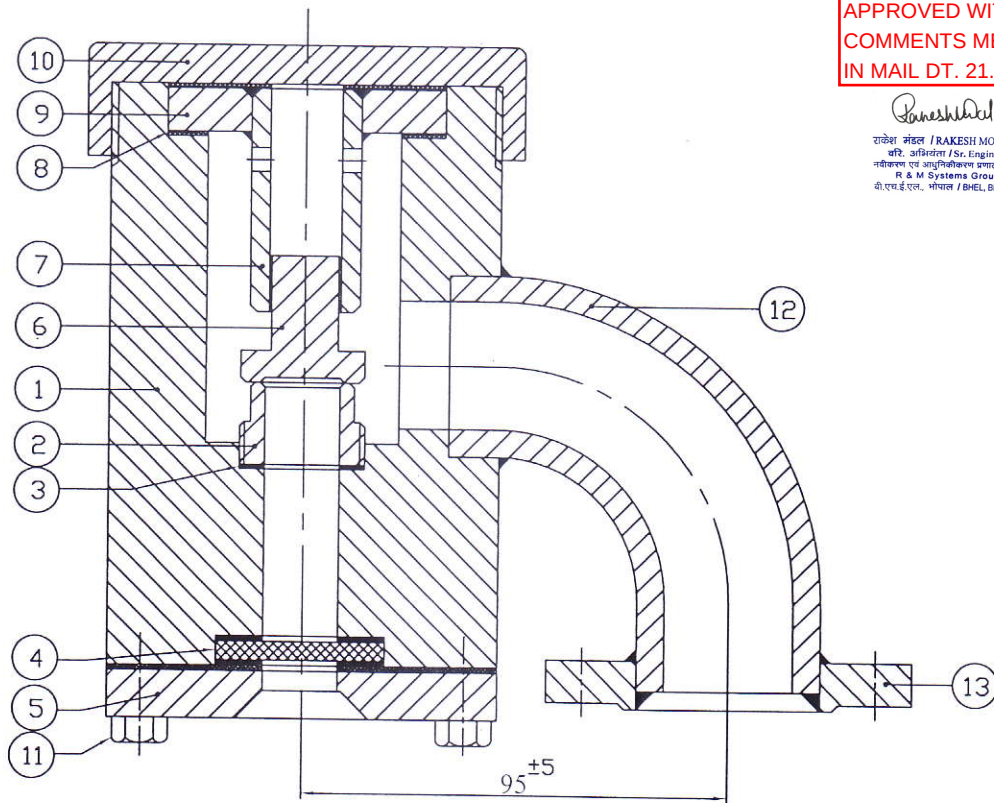

NOTES :-


1. Type : Pallet
2. Size : 1" (25NB)
3. Connection : Flanged to ANSI B16.5, 150# RF.
4. Vacuum Setting : -660 mm of Hg
5. Hyd.test Pressure : 50 psig
6. Qty. : 02 Nos.

* Hyd. test pressure for 3 minutes
at room temperature.

13	Conn.flange	AISI 316
12	Conn.pipe	AISI 316
11	Bolt	Stainless Steel
10	Top Cover	AISI 316
9	Guide flange	AISI 316
8	Gasket	CAF IS 2712 Gr.W/I
7	Guide	AISI 316
6	Pallet	AISI 316
5	Bottom Cover	AISI 316
4	Filter	AISI 316
3	Gasket	CAF IS 2712 Gr.W/I
2	Nozzle	AISI 316
1	Valve Body	AISI 316
ItemNo.	Description	Material

All dimensions are in 'mm'. Unless otherwise specified.

BILL OF MATERIAL

UN CONTROLLED COPY				ASIAN INDUSTRIAL VALVES AND INSTRUMENTS, CHENNAI-600 037. (India)				
				TITLE : VACUUM RELIEF VALVE				
		SIGN.	DATE	CUSTOMER : M/S. Aqua Designs India Pvt. Limited P.O. No. : 1718DPLA-106 DT.: 31.07.17 Our C.No. : A17 059				
		R.Krishnan	D RN.	09.08.17				
		R.Krishnan	CHD.	18.08.17				
		M.S.Rajan	APPD.	18.08.17				
1.	Top cover	<i>[Signature]</i>	DATE	28/08/17				
REV.	CHANGES	SIGN.	DATE	DRAWING NO : 17-VRV-048				
ENGINEERING CHANGES				 SCALE NTS.	REV. 1			